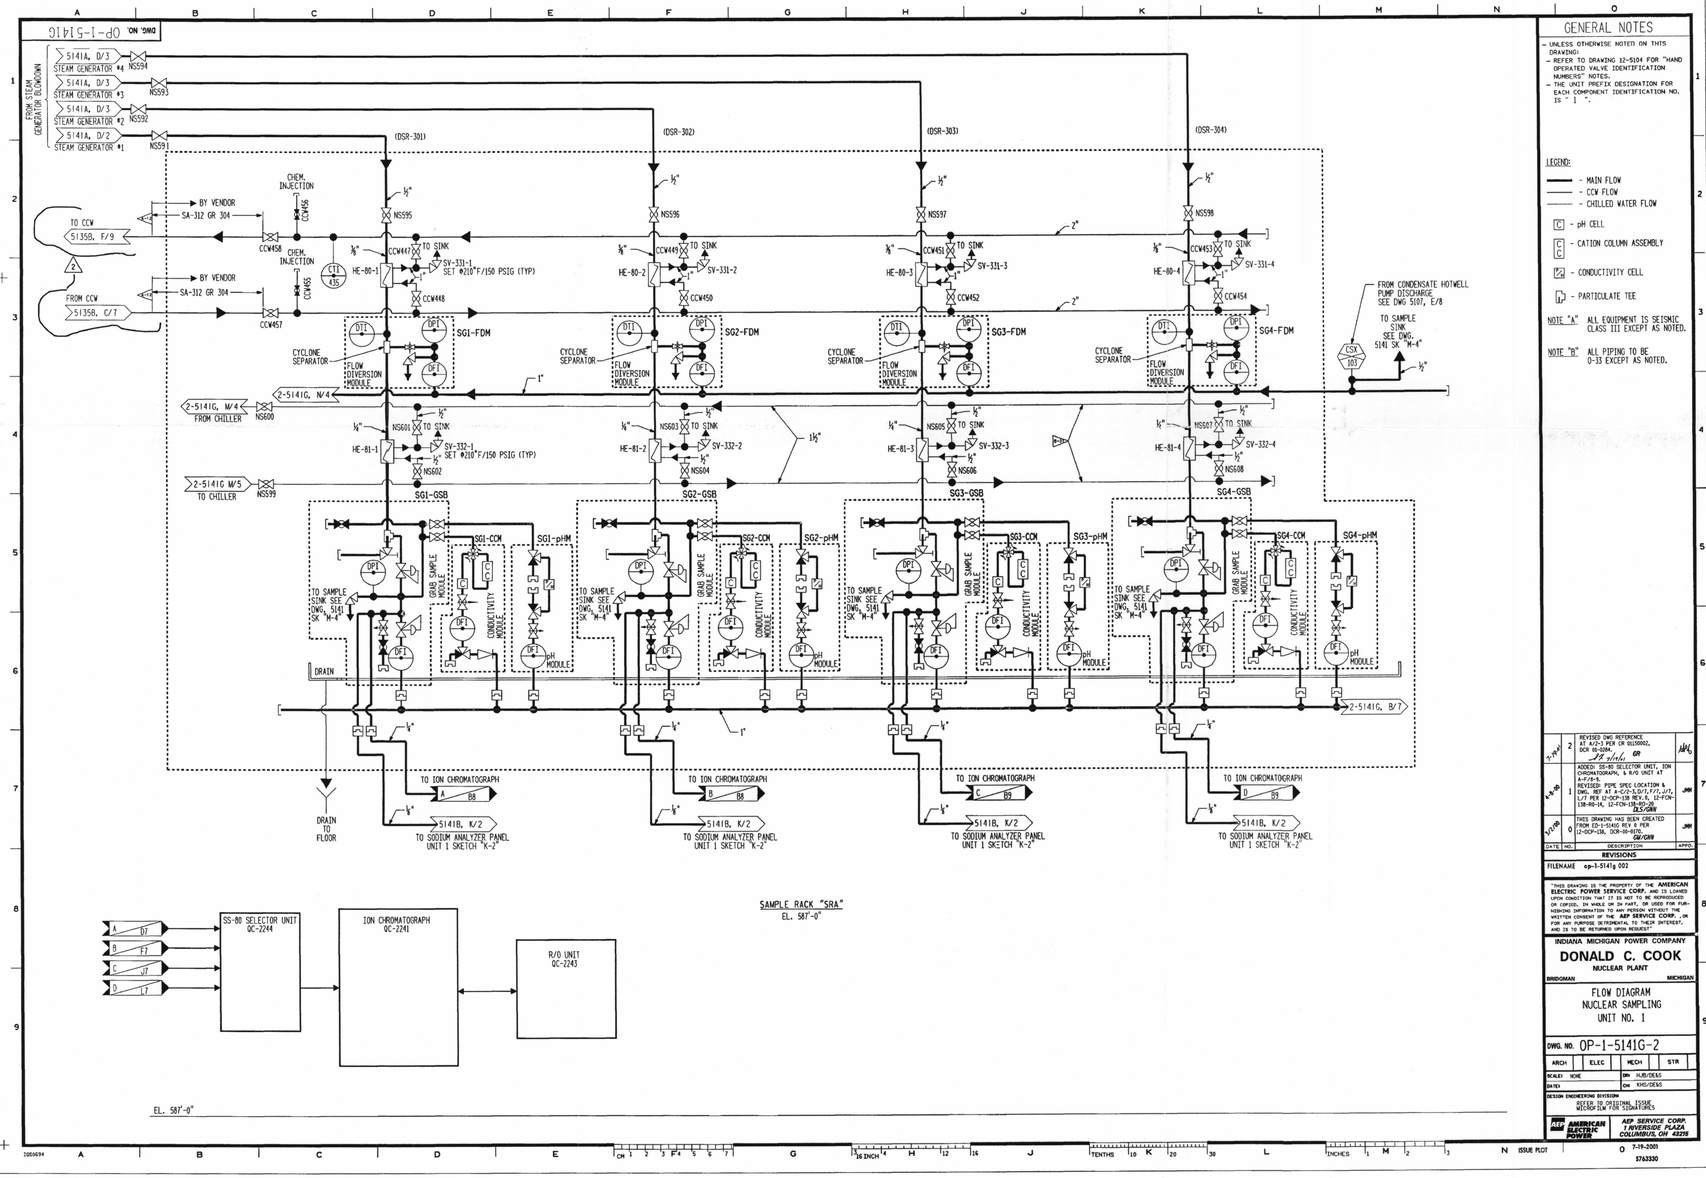

GENERAL NOTES

- UNLESS OTHERWISE NOTED ON THIS DRAWING:
- REFER TO DRAWING 12-5104 FOR "HAND OPERATED VALVE IDENTIFICATION NUMBERS" NOTES.
- THE UNIT PREFIX DESIGNATION FOR EACH COMPONENT IDENTIFICATION NO. IS "1".

LEGEND:

- MAIN FLOW
- CCW FLOW
- CHILLED WATER FLOW
- C - pH CELL
- C C - CATION COLUMN ASSEMBLY
- C - CONDUCTIVITY CELL
- P - PARTICULATE TEE

NOTE "A" ALL EQUIPMENT IS SEISMIC CLASS III EXCEPT AS NOTED.

NOTE "B" ALL PIPING TO BE O-33 EXCEPT AS NOTED.

DATE	NO.	DESCRIPTION	APPD.
7-19-01	2	REVISED DWG REFERENCE AT A/2-3 PER CR 01100002, DCN 10-0284. *AP Sirohi* GR	APS
4-4-96	1	ADDED: SS-80 SELECTOR UNIT, ION CHROMATOGRAPH, & R/O UNIT AT SRA. REVISED: PIPE SPEC LOCATION & DWG. REF AT A-C/2-3,D-F/1,J/1, L/1 PER 12-OCP-138 REV. 6, 12-FCH-138-RR-14, 12-FCH-138-RD-26. DLS/GHW	JMH
11-7-95	0	THIS DRAWING HAS BEEN CREATED FROM ED-1-5141G REV 9 PER 12-SOP-136, DCR-95-0170. GW/GHW	JMH

REVISIONS

FILENAME op-1-5141g 002

"THIS DRAWING IS THE PROPERTY OF THE AMERICAN ELECTRIC POWER SERVICE CORP. AND IS LOANED SUBJECT TO AGREEMENT THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN CONSENT OF THE AEP SERVICE CORP., OR FOR ANY PURPOSE DETRIMENTAL TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST"

INDIANA MICHIGAN POWER COMPANY
DONALD C. COOK
NUCLEAR PLANT
BRIDGMAN MICHIGAN

FLOW DIAGRAM
NUCLEAR SAMPLING
UNIT NO. 1

DWG. NO. OP-1-5141G-2

ARCH	ELEC	MECH	STR
SCALE: NONE		BM: HJB/DEKS	
DATE:		CM: KMS/DEKS	

DESIGN ENGINEERING DIVISION
DETAIL IS ORIGINAL ISSUE
MICHIGAN SIM FOR SIGNATURES

AEP AMERICAN ELECTRIC POWER

AEP SERVICE CORP.
1 RIVERSIDE PLAZA
COLUMBUS, OH 43215

ISSUE PLOT 0 7-19-2001

5763330

D-02