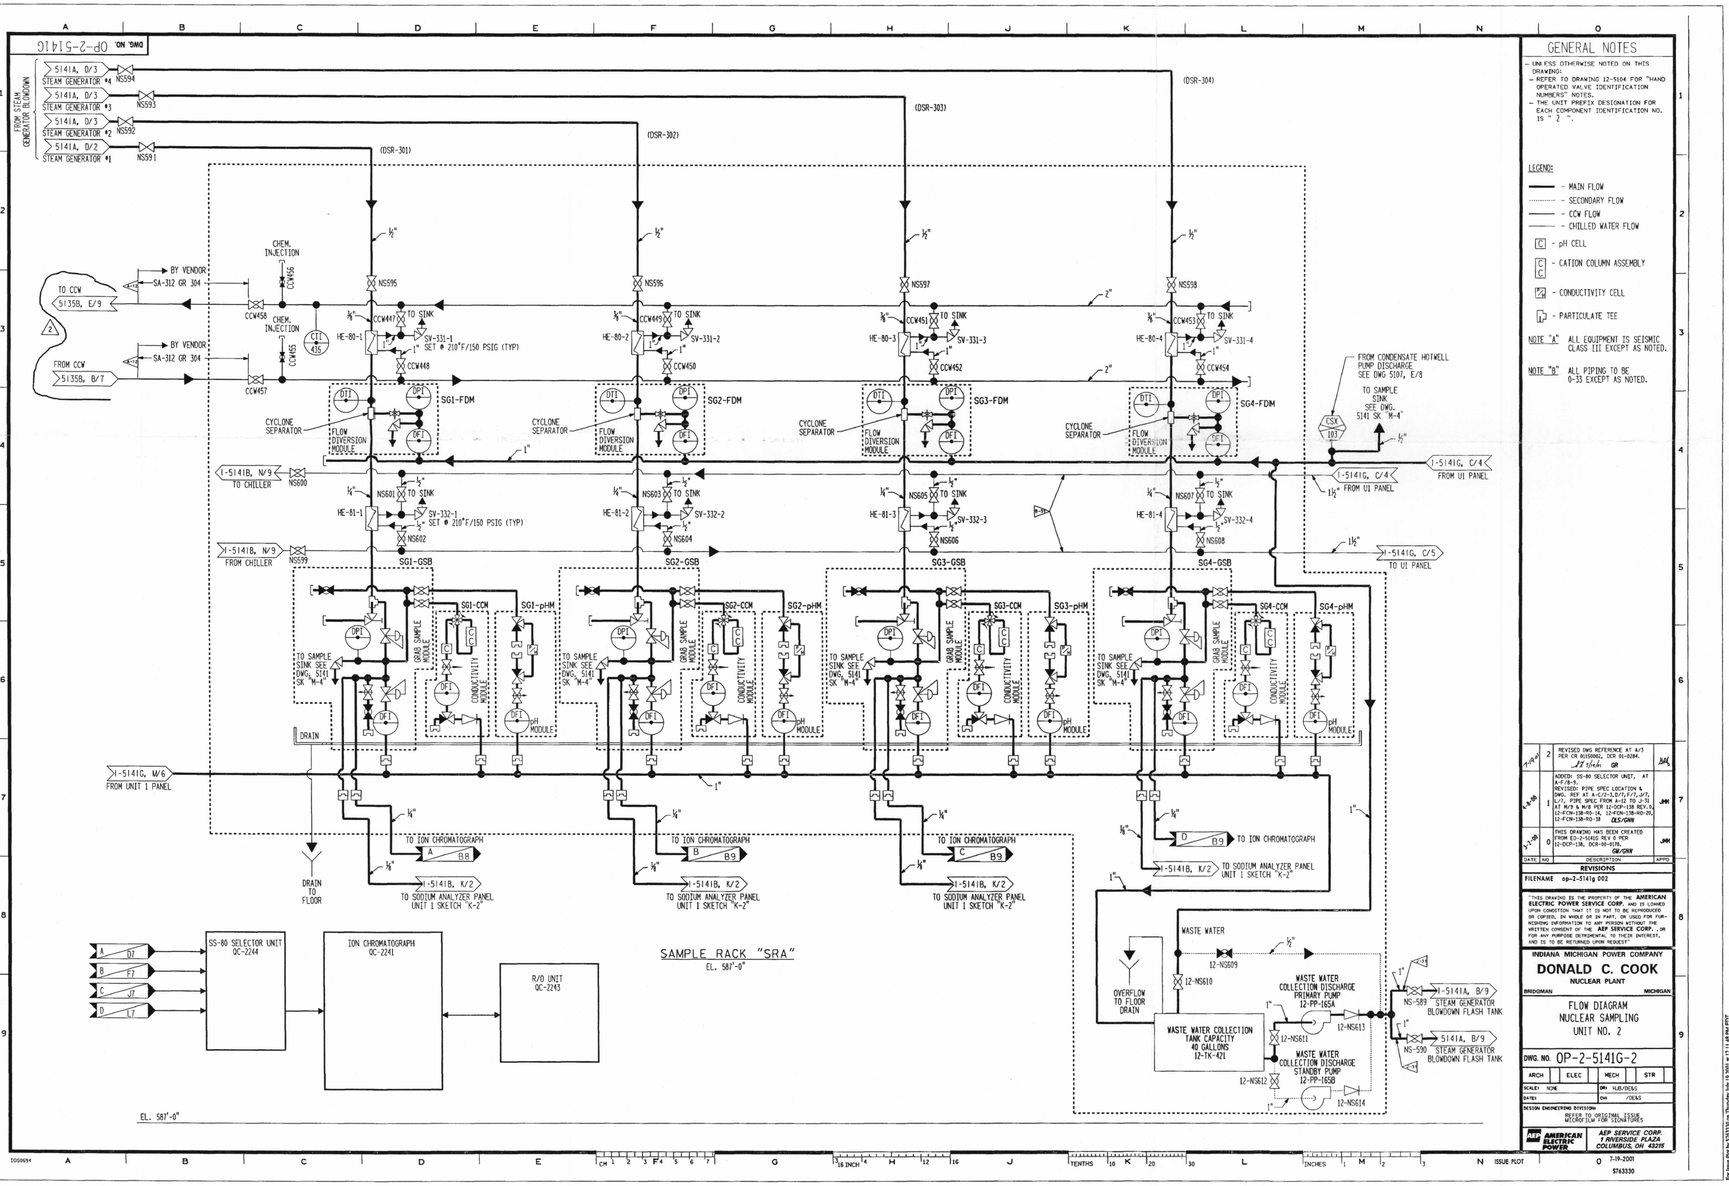

GENERAL NOTES

- UNLESS OTHERWISE NOTED ON THIS DRAWING:
- REFER TO DRAWING 12-5104 FOR "HAND OPERATED VALVE IDENTIFICATION NUMBERS" NOTES.
- THE UNIT PREFIX DESIGNATION FOR EACH COMPONENT IDENTIFICATION NO. IS " 2 ".

LEGEND:

- MAIN FLOW
- SECONDARY FLOW
- CCW FLOW
- CHILLED WATER FLOW
- C - pH CELL
- C C - CATION COLUMN ASSEMBLY
- C - CONDUCTIVITY CELL
- P - PARTICULATE TEE

NOTE "A" ALL EQUIPMENT IS SEISMIC CLASS III EXCEPT AS NOTED.

NOTE "B" ALL PIPING TO BE O-33 EXCEPT AS NOTED.

DATE	NO	DESCRIPTION	APPD
7-7-97	2	REVISED DWG REFERENCE AT A/3 PER CR 8105092, DCR 01-0284. JAK
4-4-96	1	ADDED SS-80 SELECTOR UNIT, AT B-7 TO B-9. REVISED PIPE SPEC LOCATION & DWG. REF AT A-C/2-3,D/1,F/1,J/1, L/1, PIPE SPEC FROM A-12 TO J-31 AT M/5 & M/6 PER 12-SOP-138 REV.2, 12-FCM-138-RO-1A, 12-FCM-138-RO-2D, 12-FCM-138-RO-3B. JAK/GRM
3-7-95	0	THIS DRAWING HAS BEEN CREATED FROM EX-2-5141G REV 8 PER 12-SOP-138, DCR-00-0178. JAK/GRM

REVISIONS

FILENAME op-2-5141g 002

"THIS DRAWING IS THE PROPERTY OF THE AMERICAN ELECTRIC POWER SERVICE CORP., AND IS LOANED UPON CONDITION THAT IT IS NOT TO BE REPRODUCED OR COPIED, IN WHOLE OR IN PART, OR USED FOR FURNISHING INFORMATION TO ANY PERSON WITHOUT THE WRITTEN PERMISSION OF THE AMERICAN ELECTRIC POWER SERVICE CORP., OR ITS SAID PURPOSES OTHERWISE THAN AS PREVIOUSLY AUTHORIZED, RETROPACKAGE TO THEIR INTEREST, AND IS TO BE RETURNED UPON REQUEST"

INDIANA MICHIGAN POWER COMPANY

DONALD C. COOK
NUCLEAR PLANT

BRIDGMAN MICHIGAN

FLOW DIAGRAM NUCLEAR SAMPLING UNIT NO. 2

DWG. NO. OP-2-5141G-2

ARCH	ELEC	MECH	STR

SCALE: NONE DR: KLB/DCKS

DATE: 7-19-2000 CH: /DCKS

DESIGN ENGINEERING DIVISION

REFER TO ORIGINAL ISSUE MICROFILM FOR SIGNATURES

AEP AMERICAN ELECTRIC POWER

AEP SERVICE CORP. 1 RIVERSIDE PLAZA COLUMBUS, OH 43215

ISSUE PLOT 0 7-19-2000

5763330

D.03