


2
LR-18018-C

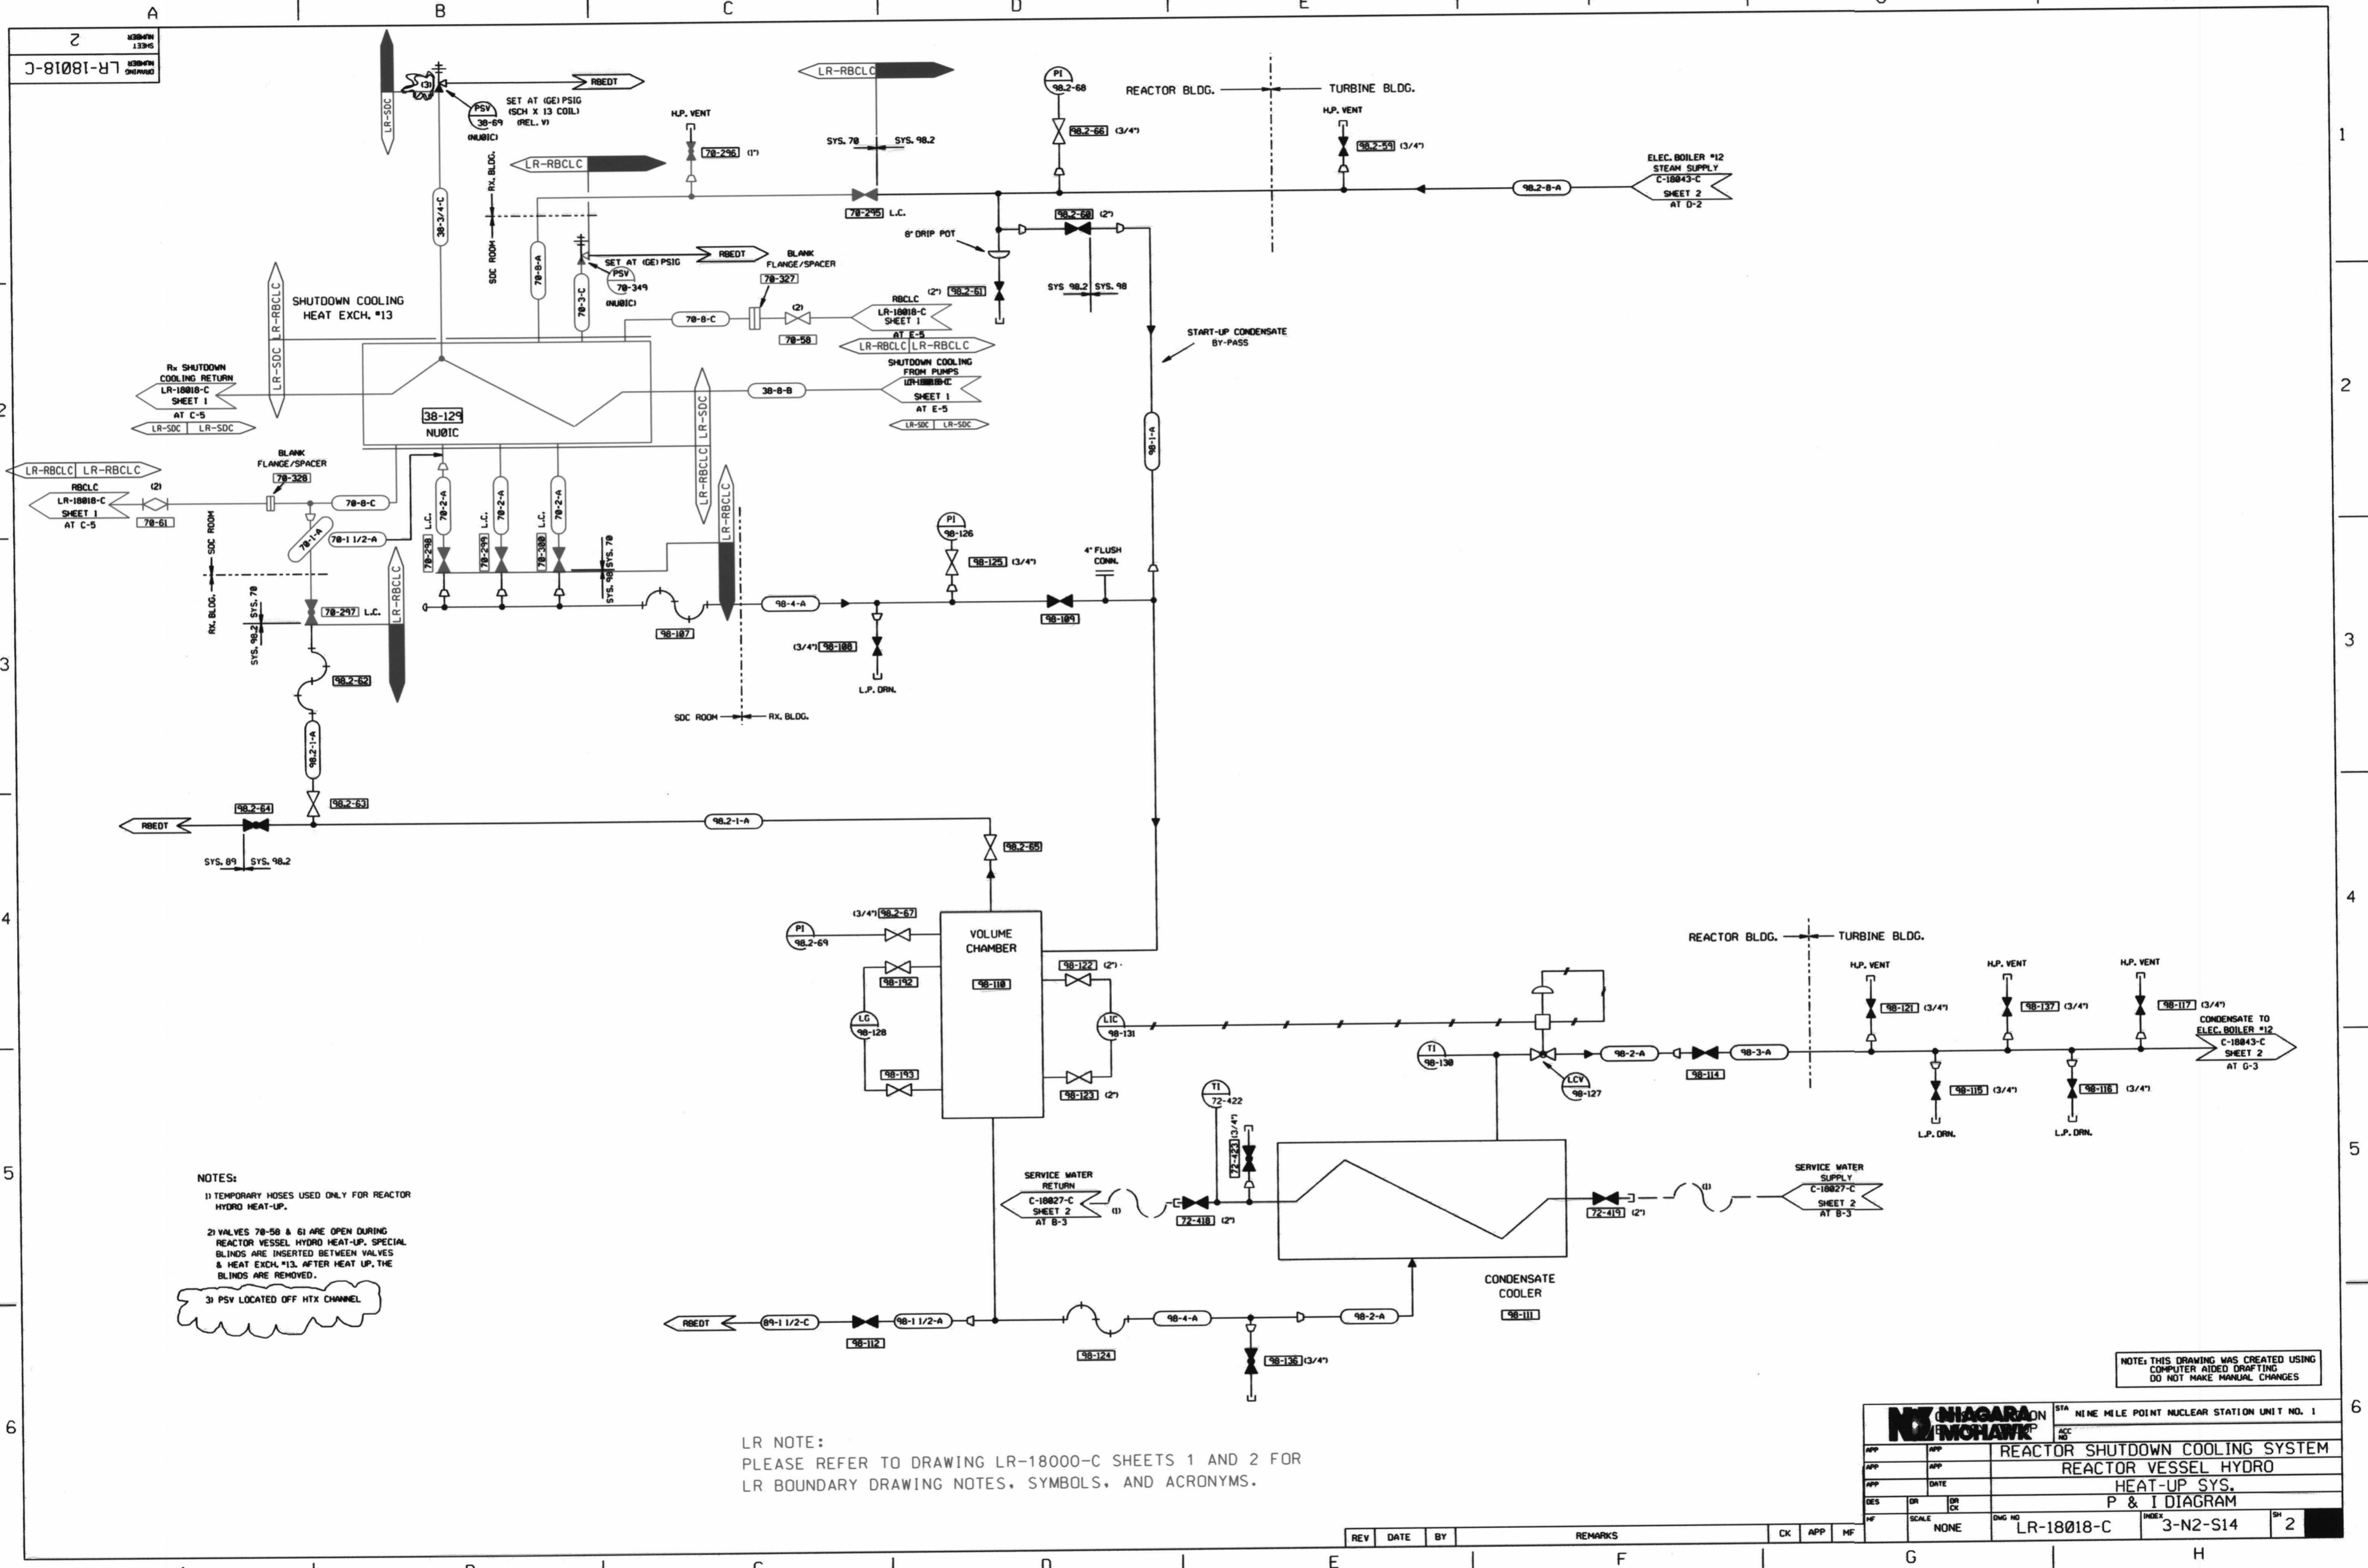

NOTES:
 1) TEMPORARY NOSES USED ONLY FOR REACTOR HYDRO HEAT-UP.
 2) VALVES 78-58 & 61 ARE OPEN DURING REACTOR VESSEL HYDRO HEAT-UP. SPECIAL BLINDS ARE INSERTED BETWEEN VALVES & HEAT EXCH. #13. AFTER HEAT UP, THE BLINDS ARE REMOVED.
 3) PSV LOCATED OFF HTX CHANNEL

LR NOTE:
 PLEASE REFER TO DRAWING LR-18000-C SHEETS 1 AND 2 FOR LR BOUNDARY DRAWING NOTES, SYMBOLS, AND ACRONYMS.

NOTE: THIS DRAWING WAS CREATED USING COMPUTER AIDED DRAFTING DO NOT MAKE MANUAL CHANGES

		STA NINE MILE POINT NUCLEAR STATION UNIT NO. 1	
APP	APP	REACTOR SHUTDOWN COOLING SYSTEM REACTOR VESSEL HYDRO HEAT-UP SYS. P & I DIAGRAM	
DES	OR	DR	INDEX
SCALE	NONE	DWG NO	LR-18018-C
		INDEX	3-N2-S14
		SH	2

REV	DATE	BY	REMARKS	CK	APP	HF

D041