LR-62B-0 ON SHEWAG

LR NOTE:
PLEASE REFER TO DRAWING LR-000 SHEETS 2A THROUGH 2F
FOR LR BOUNDARY DRAWING NOTES, SYMBOLS, AND ACRONYMS.

MARK NUMBER	VALVE DESCRIPTION	SIZE	NO. OF VALVES
MOV25A,25B	VENDOR SUPPLIED	3"	2
MOV26A,26B	VENDOR SUPPLIED	3/4"	2
V36,37,45,46	VENDOR SUPPLIED	3/4"	4
V65,66,67,68	V05600-S	1/2"	4

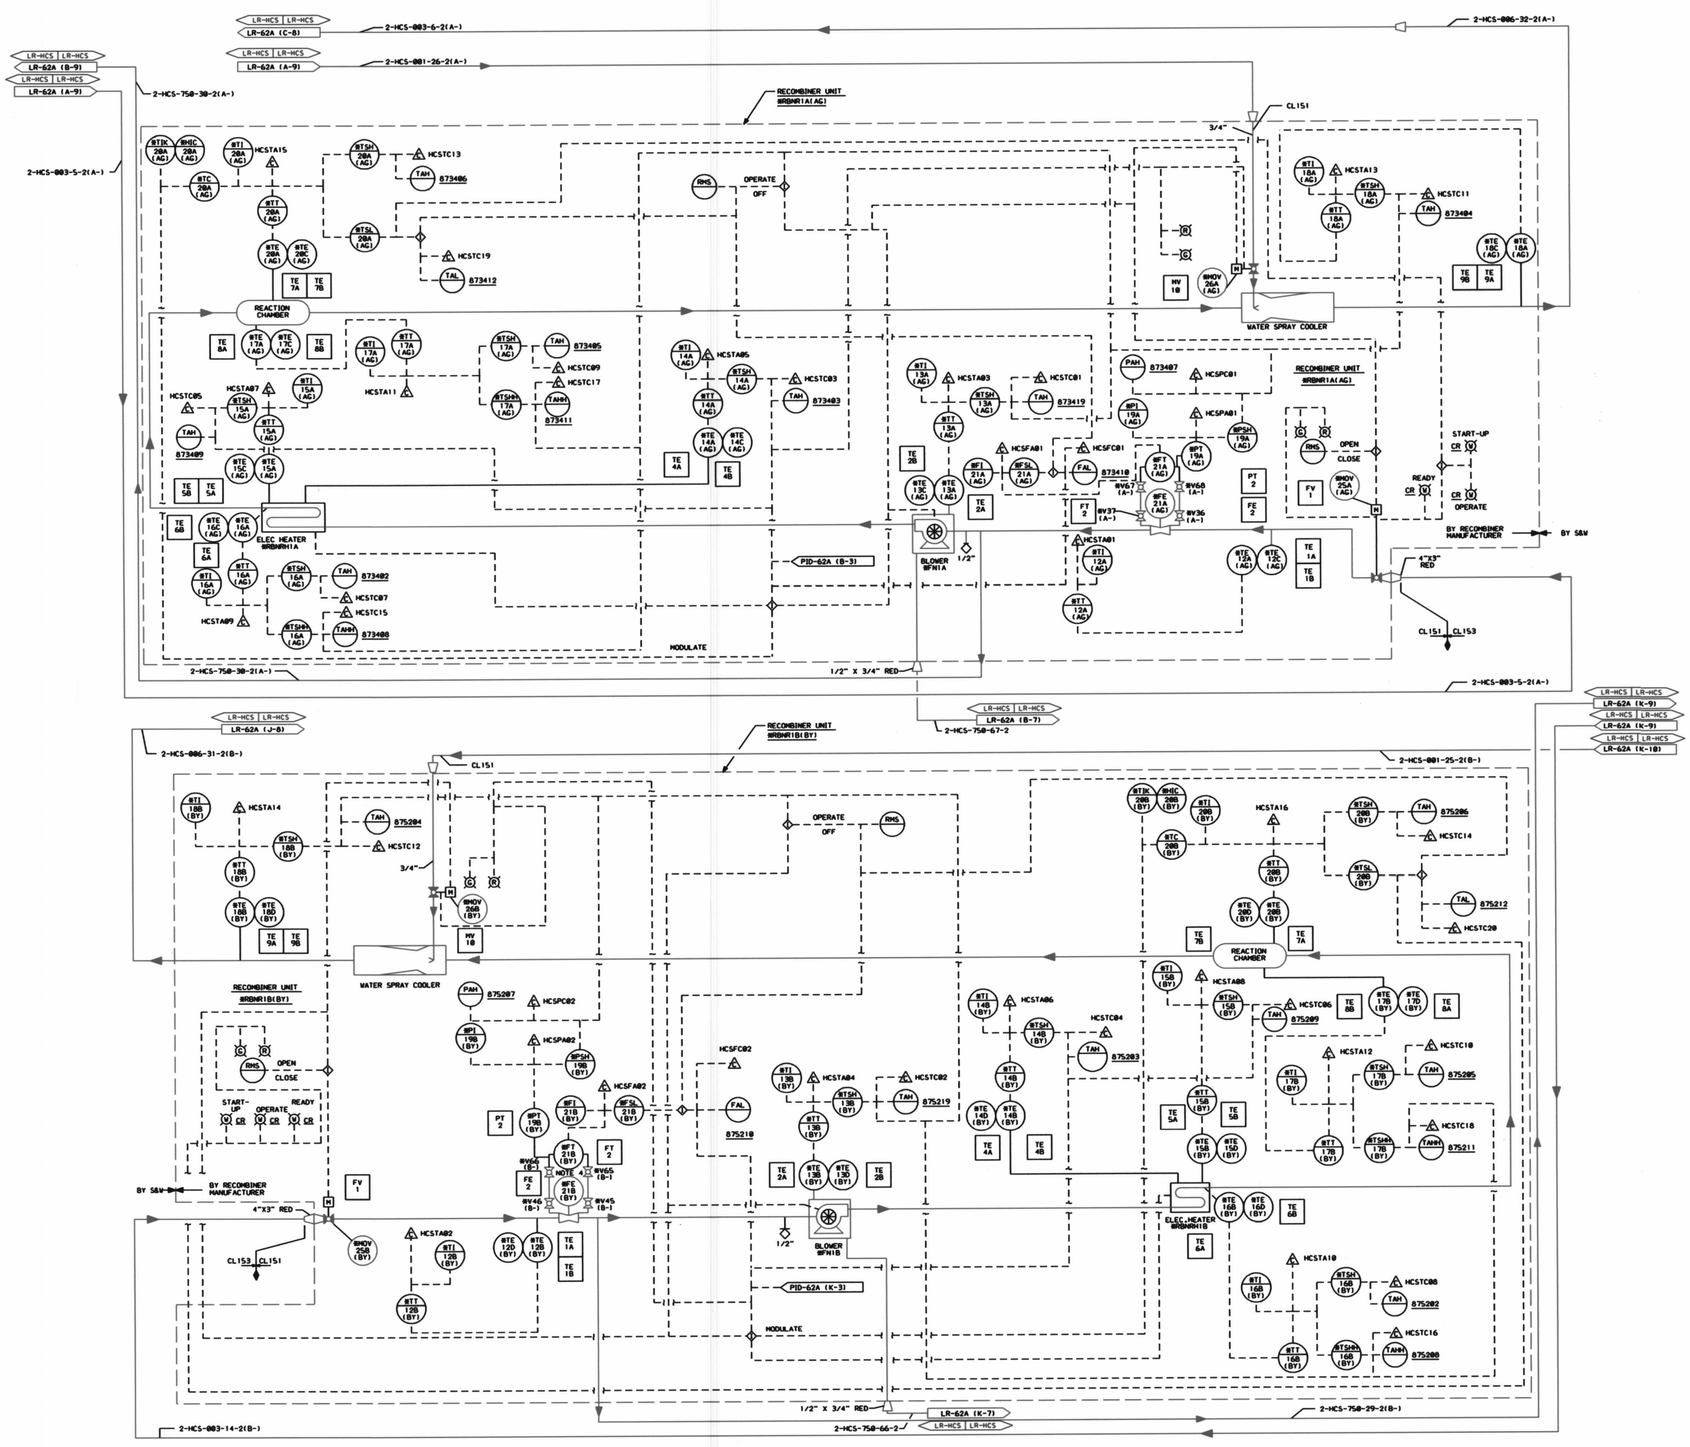

NOTES.
1. ALL INSTRUMENT & EQUIPMENT NUMBERS WITHIN A CIRCLE WITH "PIPE-" EXCEPT WHERE A DIFFERENT PREFIX IS SHOWN. THE VENDOR DESIGNATED MARKINGS ARE INDICATED BY NUMBERS WITHIN A SQUARE, I.E. FV 1
2. ALL PIPING IS CLASS 153 EXCEPT AS NOTED.
3. SYMBOLS USED FOR VENDOR SUPPLIED EQUIPMENT ARE IN ACCORDANCE WITH VENDOR P&ID #N116000106 S&W MODF #16.361-146-81A. WITHIN A SQUARE, I.E.
4. SUPPLIED BY SWEC. MARK NUMBERS ARE PROVIDED FOR OPERATIONS AND/OR I & C PROCEDURES.

THIS DRAWING WAS PRODUCED ELECTRONICALLY. DO NOT MAKE ANY CHANGES MANUALLY.

SAFETY RELATED
(REF. SAR FIG. 6.2-72b & ISPT-62B)

Constellation Energy Group
NINE MILE POINT NUCLEAR STATION
UNIT 2 - SCRIBA, N.Y.

PIPING & INSTRUMENTATION DIAGRAM
DBA HYDROGEN RECOMBINER

SCALE NONE | DRAWING NO LR-62B-0

NF	REV	DATE	DESCRIPTION OF REVISION	M.O.	DFT	DES	CHKD	ENG	ELEC	MECH	STR

...\LR-062_b.dgn 5/14/2004 2:28:16 PM

205