LR-53F-0
DRAWING NO

MARK NUMBER	VALVE DESCRIPTION	SIZE	NO. OF VALVES
V31,32,33,34 V2000,2001	BY CONTROLS	1/4"	6

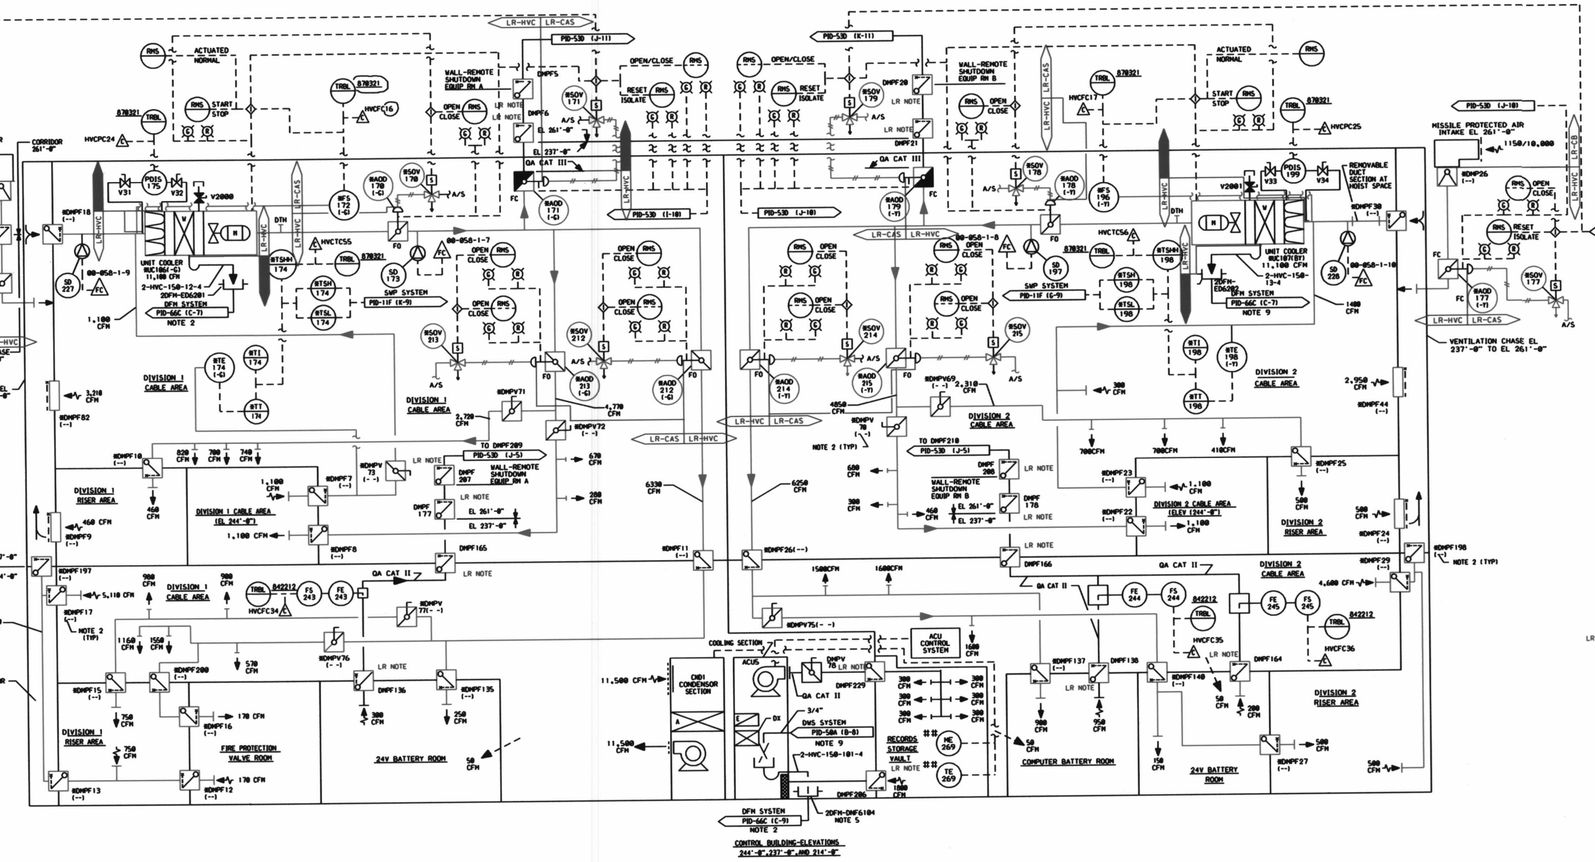



LR NOTE:
PLEASE REFER TO DRAWING LR-000 SHEETS 2A THROUGH 2F FOR LR BOUNDARY DRAWING NOTES, SYMBOLS, AND ACRONYMS.

NOTES

1. ALL INSTRUMENT AND EQUIPMENT NUMBERS TO BE PREFIXED WITH "2HVC-" EXCEPT WHERE A DIFFERENT PREFIX IS SHOWN. AN ASTERISK (*) WILL REPLACE THE DASH (-) IN THE PREFIX FOR EQUIPMENT OR INSTRUMENTS WHICH ARE PART OF NUCLEAR SAFETY FEATURE SYSTEMS.
2. NO FLAG SHOWN ON CORRESPONDING DOCUMENT. COORDINATES PROVIDE INTERFACE LOCATION.
3. FOR SERVICE WATER PIPING TO UNIT COOLERS SEE PID-11F.
4. UNIT COOLER DRAIN AND ACUS LINES DISCHARGE TO MISCELLANEOUS BUILDINGS FLOOR AND EQUIPMENT DRAINS PID-66.
5. ALL DUCTWORK IS QA CAT I EXCEPT WHERE NOTED.
6. BATTERY ROOMS MAINTAINED UNDER A SLIGHTLY NEGATIVE PRESSURE.
7. VENTILATION FOR DIVISION 3 CABLE AREA LOCATED ON ELEVATION 244'-0" IS SHOWN ON PID-53E (E-3).
8. SYMBOL (###) INDICATES COMPONENTS FURNISHED BY 2HVC-ACUS EQUIPMENT MANUFACTURER.
9. NO FLAG SHOWN ON CORRESPONDING DOCUMENT. COORDINATES PROVIDE INTERFACE LOCATION.

THIS DRAWING WAS PRODUCED ELECTRONICALLY. DO NOT MAKE ANY CHANGES MANUALLY.

SAFETY RELATED
QUALITY RELATED
NON-SAFETY RELATED

(REF SAR FIG. 9.4-19)

Constellation Energy Group

NINE MILE POINT NUCLEAR STATION UNIT 2 - SCRIBA, N.Y.

PIPING & INSTRUMENTATION DIAGRAM
CONTROL BUILDING VENTILATION AND AIR CONDITIONING

SCALE NONE | DRAWING NO LR-53F-0

NF	REV	DATE	DESCRIPTION OF REVISION	M.O.	DFT	DES	CHKD	ENG	ELEC	MECH	STR

...\LR-053_f.dgn 5/14/2004 2:00:34 PM

194