



Westinghouse Electric Company
Nuclear Power Plants
P.O. Box 355
Pittsburgh, Pennsylvania 15230-0355
USA

U.S. Nuclear Regulatory Commission
ATTENTION Document Control Desk
Washington, D.C. 20555

Direct tel: 412-374-4728
Direct fax: 412-374-5005
e-mail: vijukrp@westinghouse.com

Your ref: Docket No. 52-006
Our ref: DCP/NRC1713

August 2, 2004

SUBJECT: Transmittal of Westinghouse AP1000 Probabilistic Risk Assessment Report Revision 8

Attached please find Revision 8 of the AP1000 Probabilistic Risk Assessment (PRA) report. Revision 8 incorporates the revisions that have been discussed with the U.S. Nuclear Regulatory Commission staff since the last revision on May 12, 2004. The PRA report contains a Revision 8 Change Roadmap that provides the basis for each of the changes incorporated in the PRA. Please note that Revision 8 only includes an update to those sections of the PRA that contain changes.

There is no information proprietary to Westinghouse included in this transmittal. The Westinghouse Electric Company copyright notice is included within the document.

Please contact me if you have any questions concerning this transmittal.

Very truly yours,

A handwritten signature in black ink, appearing to read 'R. P. Vijuk'.

R. P. Vijuk, Manager
Passive Plant Engineering
AP600 & AP1000 Projects

/Attachment

1. APP-GW-GL-022, Revision 8, "AP1000 Probabilistic Risk Assessment," August 2004

D063

| | | PRA |
|------|---|-------------------|
| | | <u>Attachment</u> |
| bcc: | C. B. Brinkman - Westinghouse, Rockville, MD | 1 |
| | W. E. Cummins* - Westinghouse, Pittsburgh, PA, EC E3 | |
| | Doc Control Desk - U.S. NRC, Rockville, MD | Original |
| | J. A. Gresham* - Westinghouse, Pittsburgh, PA, EC E4-07A | |
| | E. H. Kennedy - Westinghouse, Windsor, CT | 1 |
| | D. T. McLaughlin - Westinghouse, Pittsburgh, PA, EC E469h | 1 |
| | T. L. Schulz - Westinghouse, Pittsburgh, PA, EC E3-08 | 1 |
| | J. P. Segala - U.S. NRC, Rockville, MD | 6 + 3 cd-rom |
| | R. P. Vijuk - Westinghouse, Pittsburgh, PA, EC E3-05 | 1 |
| | J. W. Winters - Westinghouse, Pittsburgh, PA, EC E3-08 | 1 |

* Letter only

DCP/NRC1713
Docket No. 52-006

August 2, 2004

Attachment 1

APP-GW-GL-022, Revision 8
“AP1000 Probabilistic Risk Assessment”
dated August 2004

AP1000 Probabilistic Risk Assessment

Instructions for Inserting Revision 8 Change Pages

(July 2004)

Volume 1

Remove the Revision No. 7 "AP1000 Document Cover Sheet" from the front of the volume, and insert the Revision No. 8 "AP1000 Document Cover Sheet."

Then after the AP1000 Volume 1 Title Page (color), remove the following pages and insert the Revision 8 pages as follows:

| Remove Pages | Insert Pages |
|---|---|
| i (Rev. 7)/ii (Rev. 7) <u>through</u> cxvii (Rev. 7)/Blank | i (Rev. 8)/ii (Rev. 8) <u>through</u> cxvii (Rev. 8)/cxviii (Rev. 8) |

Volume 2

After the AP1000 Volume 2 Title Page (color), remove the following pages and insert the Revision 8 pages as follows:

| Remove Pages | Insert Pages |
|---|---|
| i (Rev. 7)/ii (Rev. 7) <u>through</u> cxvii (Rev. 7)/Blank | i (Rev. 8)/ii (Rev. 8) <u>through</u> cxvii (Rev. 8)/cxviii (Rev. 8) |

Volume 3

After the AP1000 Volume 3 Title Page (color), remove the following pages and insert the Revision 8 pages as follows:

| Remove Pages | Insert Pages |
|---|---|
| i (Rev. 7)/ii (Rev. 7) <u>through</u> cxvii (Rev. 7)/Blank | i (Rev. 8)/ii (Rev. 8) <u>through</u> cxvii (Rev. 8)/cxviii (Rev. 8) |

Volume 4

After the AP1000 Volume 4 Title Page (color), remove the following pages and insert the Revision 8 pages as follows:

| Remove Pages | Insert Pages |
|---|---|
| i (Rev. 7)/ii (Rev. 7) <u>through</u> cxvii (Rev. 7)/Blank | i (Rev. 8)/ii (Rev. 8) <u>through</u> cxvii (Rev. 8)/cxviii (Rev. 8) |

After Tab 59 “PRA Results and Insights,” remove all of the pages within this tab and insert the Revision 8 pages as follows:

| Remove Pages | Insert Pages |
|--|--|
| 59-1 (Rev. 7)/59-2 (Rev. 7) <u>through</u> 59-99 (Rev. 7)/59-100 (Rev. 7) | 59-1 (Rev. 8)/59-2 (Rev. 8) <u>through</u> 59-99 (Rev. 8)/59-100 (Rev. 8) |

Volume 5

After the AP1000 Volume 5 Title Page (color), remove the following pages and insert the Revision 8 pages as follows:

| Remove Pages | Insert Pages |
|---|---|
| i (Rev. 7)/ii (Rev. 7) <u>through</u> cxvii (Rev. 7)/Blank | i (Rev. 8)/ii (Rev. 8) <u>through</u> cxvii (Rev. 8)/cxviii (Rev. 8) |

Volume 1

AP1000 DOCUMENT COVER SHEET

TDC: _____ Permanent File: _____ S _____
 RFS#: _____ RFS ITEM #: _____

| | | | |
|--------------------------------------|-------------------|-------------|--------------------------------|
| AP1000 DOCUMENT NO. APP-GW-GL-022 | REVISION NO. 8 | Page 1 of 1 | ASSIGNED TO W - R. P. Vijuk |
|--------------------------------------|-------------------|-------------|--------------------------------|

ALTERNATE DOCUMENT NUMBER: _____ WORK BREAKDOWN #: _____
 ORIGINATING ORGANIZATION: Westinghouse Electric Company LLC
 TITLE: **AP1000 Probabilistic Risk Assessment**

| | |
|-------------------------------------|---|
| ATTACHMENTS: | DCP #/REV. INCORPORATED IN THIS DOCUMENT REVISION: Class 3 revision to incorporate Draft Safety Evaluation Report Open Item Responses. |
| CALCULATION/ANALYSIS REFERENCE: N/A | |

| ELECTRONIC FILENAME | ELECTRONIC FILE FORMAT | ELECTRONIC FILE DESCRIPTION |
|---------------------|------------------------|-----------------------------|
| | | |

(C) WESTINGHOUSE ELECTRIC COMPANY LLC - 2004

- WESTINGHOUSE PROPRIETARY CLASS 2
 This document is the property of and contains Proprietary Information owned by Westinghouse Electric Company LLC and/or its subcontractors and suppliers. It is transmitted to you in confidence and trust, and you agree to treat this document in strict accordance with the terms and conditions of the agreement under which it was provided to you.
- WESTINGHOUSE CLASS 3 (NON PROPRIETARY)

| | | |
|---|--|--|
| ORIGINATOR T. L. Schulz | SIGNATURE/DATE <i>Tyrol Self</i> 7/30/04 | |
| REVIEWERS | SIGNATURE/DATE | |
| | | |
| | | |
| | | |
| VERIFIER R. F. Wright | SIGNATURE/DATE <i>R.F. Wright</i> 7/30/04 | VERIFICATION METHOD <i>Independent Review</i> |
| AP1000 RESPONSIBLE MANAGER R. P. Vijuk | SIGNATURE <i>R.P. Vijuk</i> | APPROVAL DATE 7/30/04 |

*Approval of the responsible manager signifies that document is complete, all required reviews are complete, electronic file is attached and document is released for use.



AP1000

Probabilistic Risk Assessment, Revision 8

Copyright © 2004
Westinghouse Electric Company LLC

All Rights Reserved

The design, engineering, and other information contained in this document have been prepared by or on behalf of the Westinghouse Electric Company LLC in connection with its application to the United States Nuclear Regulatory Commission (NRC) for design certification of the AP1000 passive nuclear plant design pursuant to Title 10, Code of Federal Regulations Part 52. No use of or right to copy any of this information, other than by the NRC and its contractors in support of Westinghouse's application, is authorized.

The information provided in this document is a subset of a much larger set of know-how, technology and intellectual property rights pertaining to standardized, modularized, nuclear powered, electric generating facilities that utilize a minimum of active components and are characterized by a passive shutdown system, designed by Westinghouse and referred to as the AP1000™ nuclear power plant design. Without access and a Westinghouse grant of rights to that larger set of know-how, technology and intellectual property rights, this document is not practically or rightfully usable by others, except by the NRC as set forth in the previous paragraph.

For information address: Westinghouse Electric Company LLC
Nuclear Plant Projects
P. O. Box 355
Pittsburgh, PA 15230

TABLE OF CONTENTS

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------------|--|-------------|
| | LIST OF TABLES | xxxv |
| | LIST OF FIGURES | liii |
| | REVISION 1 CHANGE ROADMAP | civ |
| | REVISION 2 CHANGE ROADMAP | cviii |
| | REVISION 3 CHANGE ROADMAP | cxi |
| | REVISION 4 CHANGE ROADMAP | cxii |
| | REVISION 5 CHANGE ROADMAP | cxiv |
| | REVISION 6 CHANGE ROADMAP | cxvi |
| | REVISION 7 CHANGE ROADMAP | cxvii |
| | REVISION 8 CHANGE ROADMAP | cxviii |
| CHAPTER 1 | INTRODUCTION | |
| 1.1 | Introduction | 1-1 |
| 1.1.1 | Background and Overview | 1-1 |
| 1.1.2 | Objectives | 1-1 |
| 1.1.3 | Technical Scope | 1-2 |
| 1.1.4 | Project Methodology Overview | 1-3 |
| 1.1.5 | Results | 1-4 |
| 1.1.6 | Plant Definition | 1-6 |
| 1.1.7 | References | 1-6 |
| CHAPTER 2 | INTERNAL INITIATING EVENTS | |
| 2.1 | Introduction | 2-1 |
| 2.2 | Internal Initiating Event Identification and Categorization | 2-1 |
| 2.2.1 | Logic Diagram for Internal Initiating Events | 2-2 |
| 2.2.2 | Loss-of-Coolant Accidents | 2-3 |
| 2.2.3 | Transients | 2-6 |
| 2.2.4 | Anticipated Transient without Scram | 2-8 |
| 2.2.5 | AP1000 Specific Initiating Event Analysis | 2-10 |
| 2.2.6 | Consequential Events | 2-19 |
| 2.2.7 | Summary of Internal Initiating Event Categories | 2-19 |
| 2.3 | Internal Initiating Event Frequency Quantification | 2-20 |
| 2.3.1 | Quantification of LOCA Initiating Event Frequencies | 2-20 |
| 2.3.2 | Quantification of Transient Initiating Event Frequencies | 2-24 |
| 2.3.3 | ATWS Precursor Initiating Event Frequency | 2-27 |
| 2.3.4 | Summary of Internal Initiating Event Frequencies | 2-27 |
| 2.4 | References | 2-27 |
| ATTACHMENT 2A | QUANTIFICATION OF LOCA INITIATING EVENT FREQUENCIES | |
| 2A-1 | Primary System Pipe Break Frequencies | 2A-1 |
| 2A-2 | Reactor Cooling System Leakage Initiating Event Frequency | 2A-1 |
| 2A-3 | Steam Generator Tube Rupture Initiating Event Frequency | 2A-1 |
| 2A-4 | Quantification of Stuck-Open Pressurizer Safety Valve, Accumulator Interface Break, and IRWST Interface Break | 2A-1 |
| 2A-5 | Initiating Events Review Data Summary and INPO Data | 2A-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| ATTACHMENT 2B QUANTIFICATION OF TRANSIENT INITIATING EVENT FREQUENCIES | | |
| 2B-1 | Secondary Side Line Breaks & Stuck-open Main Steam Line Safety Valve Frequencies..... | 2B-1 |
| CHAPTER 3 MODELING OF SPECIAL INITIATORS | | |
| 3.1 | Introduction..... | 3-1 |
| 3.2 | Ground Rules for Special Initiating Event Analysis..... | 3-1 |
| 3.3 | Loss of Component Cooling Water System/Service Water System Initiating Event..... | 3-1 |
| 3.4 | Loss of Compressed and Instrument Air System Initiating Event..... | 3-2 |
| 3.5 | Spurious Actuation of Automatic Depressurization System..... | 3-2 |
| 3.5.1 | Evaluation of Automatic Depressurization System Spurious Actuation | 3-3 |
| CHAPTER 4 EVENT TREE MODELS | | |
| 4.1 | Introduction..... | 4-1 |
| 4.2 | Large LOCA Event Tree Model..... | 4-1 |
| 4.2.1 | Event Description | 4-1 |
| 4.2.2 | Event Tree Model and its Nodes..... | 4-2 |
| 4.2.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-4 |
| 4.2.4 | Operator Actions..... | 4-4 |
| 4.2.5 | Transfers and Consequential Events | 4-4 |
| 4.3 | Large Spurious ADS Event Tree Model | 4-4 |
| 4.3.1 | Event Description | 4-4 |
| 4.3.2 | Event Tree Model and its Nodes..... | 4-4 |
| 4.3.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-6 |
| 4.3.4 | Operator Actions..... | 4-6 |
| 4.3.5 | Transfers and Consequential Events | 4-6 |
| 4.4 | Medium LOCA Event Tree Model | 4-6 |
| 4.4.1 | Event Description | 4-6 |
| 4.4.2 | Event Tree Model and its Nodes..... | 4-7 |
| 4.4.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-9 |
| 4.4.4 | Operator Actions..... | 4-9 |
| 4.4.5 | Transfers and Consequential Events | 4-10 |
| 4.5 | Core Makeup Tank Line Break Event Tree Model | 4-10 |
| 4.5.1 | Event Description | 4-10 |
| 4.5.2 | Event Tree Model and its Nodes..... | 4-10 |
| 4.5.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-13 |
| 4.5.4 | Operator Actions..... | 4-13 |
| 4.5.5 | Transfers and Consequential Events | 4-13 |
| 4.6 | Safety Injection Line Break Event Tree Model | 4-13 |
| 4.6.1 | Event Description | 4-13 |
| 4.6.2 | Event Tree Model and its Nodes..... | 4-14 |
| 4.6.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| | 4.6.4 Operator Actions..... | 4-16 |
| | 4.6.5 Transfers and Consequential Events..... | 4-17 |
| 4.7 | Small LOCA Event Tree Model..... | 4-17 |
| | 4.7.1 Event Description..... | 4-17 |
| | 4.7.2 Event Tree Model and its Nodes..... | 4-17 |
| | 4.7.3 Event Tree Success Criteria and Core Damage Categories..... | 4-20 |
| | 4.7.4 Operator Actions..... | 4-20 |
| | 4.7.5 Transfers and Consequential Events..... | 4-21 |
| 4.8 | RCS Leak Event Tree Model..... | 4-21 |
| | 4.8.1 Event Description..... | 4-21 |
| | 4.8.2 Event Tree Model and its Nodes..... | 4-21 |
| | 4.8.3 Event Tree Success Criteria..... | 4-22 |
| | 4.8.4 Operator Actions..... | 4-22 |
| | 4.8.5 Transfers and Consequential Events..... | 4-22 |
| | 4.8.6 Core Damage Categories..... | 4-23 |
| 4.9 | PRHR Tube Rupture Event Tree Model..... | 4-23 |
| | 4.9.1 Event Description..... | 4-23 |
| | 4.9.2 Event Tree Model and its Nodes..... | 4-23 |
| | 4.9.3 Event Tree Success Criteria..... | 4-24 |
| | 4.9.4 Operator Actions..... | 4-24 |
| | 4.9.5 Transfers and Consequential Events..... | 4-24 |
| | 4.9.6 Core Damage Categories..... | 4-24 |
| 4.10 | Steam Generator Tube Rupture Event Tree Model..... | 4-25 |
| | 4.10.1 Event Description..... | 4-25 |
| | 4.10.2 Event Tree Model and its Nodes..... | 4-27 |
| | 4.10.3 Event Tree Success Criteria and Core Damage Categories..... | 4-33 |
| | 4.10.4 Operator Actions..... | 4-33 |
| | 4.10.5 Transfers and Consequential Events..... | 4-33 |
| 4.11 | Reactor Vessel Rupture Event Tree Model..... | 4-34 |
| | 4.11.1 Event Description..... | 4-34 |
| | 4.11.2 Event Tree Model and its Nodes..... | 4-34 |
| | 4.11.3 Event Tree Success Criteria..... | 4-34 |
| | 4.11.4 Operator Actions..... | 4-34 |
| | 4.11.5 Transfers and Consequential Events..... | 4-34 |
| | 4.11.6 Core Damage Categories..... | 4-34 |
| 4.12 | Interfacing System LOCA Event Tree Model..... | 4-34 |
| | 4.12.1 Event Description..... | 4-34 |
| | 4.12.2 Event Tree Model and its Nodes..... | 4-35 |
| | 4.12.3 Event Tree Success Criteria..... | 4-35 |
| | 4.12.4 Operator Actions..... | 4-35 |
| | 4.12.5 Transfers and Consequential Events..... | 4-35 |
| | 4.12.6 Core Damage Categories..... | 4-35 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 4.13 | Transients With MFW Event Tree Model..... | 4-35 |
| | 4.13.1 Event Description | 4-35 |
| | 4.13.2 Event Tree Model and its Nodes..... | 4-37 |
| | 4.13.3 Event Tree Success Criteria and Core Damage Categories..... | 4-41 |
| | 4.13.4 Operator Actions..... | 4-41 |
| | 4.13.5 Transfers and Consequential Events | 4-42 |
| 4.14 | Transients With Loss of RCS Flow Event Tree Model..... | 4-42 |
| | 4.14.1 Event Description | 4-42 |
| | 4.14.2 Event Tree Model and its Nodes..... | 4-42 |
| | 4.14.3 Event Tree Success Criteria and Core Damage Categories..... | 4-46 |
| | 4.14.4 Operator Actions..... | 4-46 |
| | 4.14.5 Transfers and Consequential Events | 4-46 |
| 4.15 | Transients With Loss of MFW to One Steam Generator Event Tree Model..... | 4-46 |
| | 4.15.1 Event Description | 4-46 |
| | 4.15.2 Event Tree Model and its Nodes..... | 4-47 |
| | 4.15.3 Event Tree Success Criteria and Core Damage Categories..... | 4-50 |
| | 4.15.4 Operator Actions..... | 4-50 |
| | 4.15.5 Transfers and Consequential Events | 4-51 |
| 4.16 | Transients With Core Power Excursion Event Tree Model..... | 4-51 |
| | 4.16.1 Event Description | 4-51 |
| | 4.16.2 Event Tree Model and its Nodes..... | 4-51 |
| | 4.16.3 Event Tree Success Criteria and Core Damage Categories..... | 4-55 |
| | 4.16.4 Operator Actions..... | 4-55 |
| | 4.16.5 Transfers and Consequential Events | 4-55 |
| 4.17 | Transients With Loss of CCW/SW Event Tree Model..... | 4-56 |
| | 4.17.1 Event Description | 4-56 |
| | 4.17.2 Event Tree Model and its Nodes..... | 4-56 |
| | 4.17.3 Event Tree Success Criteria and Core Damage Categories..... | 4-59 |
| | 4.17.4 Operator Actions..... | 4-59 |
| | 4.17.5 Transfers and Consequential Events | 4-60 |
| 4.18 | Loss of Main Feedwater Event Tree Model | 4-60 |
| | 4.18.1 Event Description | 4-60 |
| | 4.18.2 Event Tree Model and its Nodes..... | 4-62 |
| | 4.18.3 Event Tree Success Criteria and Core Damage Categories..... | 4-65 |
| | 4.18.4 Operator Actions..... | 4-65 |
| | 4.18.5 Transfers and Consequential Events | 4-66 |
| 4.19 | Loss of Condenser Event Tree Model | 4-66 |
| | 4.19.1 Event Description | 4-66 |
| | 4.19.2 Event Tree Model and its Nodes..... | 4-66 |
| | 4.19.3 Event Tree Success Criteria and Core Damage Categories..... | 4-70 |
| | 4.19.4 Operator Actions..... | 4-70 |
| | 4.19.5 Transfers and Consequential Events | 4-70 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 4.20 | Loss of Compressed Air Event Tree Model | 4-70 |
| 4.20.1 | Event Description | 4-70 |
| 4.20.2 | Event Tree Model and its Nodes..... | 4-71 |
| 4.20.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-74 |
| 4.20.4 | Operator Actions..... | 4-74 |
| 4.20.5 | Transfers and Consequential Events..... | 4-75 |
| 4.21 | Loss of Offsite Power Event Tree Model | 4-75 |
| 4.21.1 | Event Description | 4-75 |
| 4.21.2 | Event Tree Model and its Nodes..... | 4-75 |
| 4.21.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-79 |
| 4.21.4 | Operator Actions..... | 4-79 |
| 4.21.5 | Transfers and Consequential Events..... | 4-80 |
| 4.22 | Main Steam Line Break Downstream of MSIVs Event Tree Model | 4-80 |
| 4.22.1 | Event Description | 4-80 |
| 4.22.2 | Event Tree Model and its Nodes..... | 4-81 |
| 4.22.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-84 |
| 4.22.4 | Operator Actions..... | 4-84 |
| 4.22.5 | Transfers and Consequential Events..... | 4-85 |
| 4.23 | Main Steam Line Break Upstream of MSIVs Event Tree Model..... | 4-85 |
| 4.23.1 | Event Description | 4-85 |
| 4.23.2 | Event Tree Model and its Nodes..... | 4-85 |
| 4.23.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-89 |
| 4.23.4 | Operator Actions..... | 4-89 |
| 4.23.5 | Transfers and Consequential Events..... | 4-90 |
| 4.24 | Stuck-Open Secondary Side Safety Valve Event Tree Model..... | 4-90 |
| 4.24.1 | Event Description | 4-90 |
| 4.24.2 | Event Tree Model and its Nodes..... | 4-91 |
| 4.24.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-94 |
| 4.24.4 | Operator Actions..... | 4-94 |
| 4.24.5 | Transfers and Consequential Events..... | 4-94 |
| 4.25 | ATWS Precursors Without MFW Event Tree Model | 4-95 |
| 4.25.1 | Event Description | 4-95 |
| 4.25.2 | Event Tree Model and its Nodes..... | 4-96 |
| 4.25.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-101 |
| 4.25.4 | Operator Actions..... | 4-101 |
| 4.25.5 | Transfers and Consequential Events..... | 4-101 |
| 4.26 | ATWS Precursor with SI Event Tree Model..... | 4-101 |
| 4.26.1 | Event Description | 4-101 |
| 4.26.2 | Event Tree Model and its Nodes..... | 4-102 |
| 4.26.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-106 |
| 4.26.4 | Operator Actions..... | 4-106 |
| 4.26.5 | Transfers and Consequential Events..... | 4-106 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 4.27 | ATWS Precursor Transients with MFW Event Tree Model | 4-106 |
| 4.27.1 | Event Description | 4-106 |
| 4.27.2 | Event Tree Model and its Nodes..... | 4-107 |
| 4.27.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-110 |
| 4.27.4 | Operator Actions..... | 4-111 |
| 4.27.5 | Transfers and Consequential Events..... | 4-111 |
| | | |
| ATTACHMENT 4A EVENT TREE GUIDELINES | | |
| 4A.1 | Event Tree Analysis Methodology..... | 4A-1 |
| 4A.2 | Event Tree Guidelines for Core Damage | 4A-3 |
| 4A.2.1 | Event Trees | 4A-3 |
| 4A.2.2 | Success Criteria..... | 4A-6 |
| 4A.2.3 | Definition of End States..... | 4A-7 |
| 4A.2.4 | Plant Response Functions | 4A-9 |
| 4A.2.5 | Event Tree Node Notation | 4A-13 |
| 4A.2.6 | Consequential Events..... | 4A-13 |
| 4A.2.7 | Transient Template | 4A-14 |
| 4A.2.8 | Small LOCA Template | 4A-15 |
| | | |
| ATTACHMENT 4B EVENT TREE PICTURES..... | | 4B-1 |
| | | |
| CHAPTER 5 SUPPORT SYSTEMS | | |
| 5.1 | Introduction..... | 5-1 |
| 5.2 | Support Systems and Their Interdependencies..... | 5-1 |
| 5.3 | Front Line Systems and Their Dependencies | 5-1 |
| | | |
| CHAPTER 6 SUCCESS CRITERIA ANALYSIS | | |
| 6.1 | Introduction..... | 6-1 |
| 6.2 | Acceptance Criteria and Critical Functions for Success Criteria..... | 6-1 |
| 6.3 | Event Sequences and Timing, Passive/Active System Interactions..... | 6-3 |
| 6.3.1 | General Sequence Success Criteria..... | 6-3 |
| 6.3.2 | Timing of Events and Key Operator Actions..... | 6-9 |
| 6.3.3 | Passive/Active System Interactions..... | 6-15 |
| 6.3.4 | Sequence Success Criteria Summary | 6-18 |
| 6.4 | Event Tree Top Events Success Criteria | 6-18 |
| 6.5 | References..... | 6-19 |
| | | |
| CHAPTER 7 FAULT TREE GUIDELINES | | |
| 7.1 | Purpose..... | 7-1 |
| 7.2 | Fault Tree Development..... | 7-1 |
| 7.2.1 | Procedural Steps for Fault Tree Preparation | 7-1 |
| 7.2.2 | Procedural Steps for Fault Tree Construction | 7-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 7.3 | Primary Events to be Considered in Fault Trees | 7-3 |
| 7.3.1 | Random Component Failure | 7-3 |
| 7.3.2 | Outage for Maintenance and Testing | 7-5 |
| 7.3.3 | Common Cause Failures | 7-6 |
| 7.3.4 | Human Errors..... | 7-6 |
| 7.3.5 | Power and Control Model..... | 7-9 |
| 7.4 | Data Base | 7-10 |
| 7.5 | Fault Tree Model: Identification Codes..... | 7-10 |
| 7.5.1 | Identification Code for Fault Tree Names..... | 7-10 |
| 7.5.2 | Identification Code for Support Systems | 7-10 |
| 7.5.3 | Identification Code for Primary Event Names | 7-11 |
| 7.5.4 | Identification Code for Common Cause Failures..... | 7-11 |
| 7.5.5 | Identification Code for Undeveloped Events (Modules)..... | 7-12 |
| 7.5.6 | Identification Code for Operator Errors | 7-13 |
| 7.6 | Fault Tree Quantification | 7-13 |
| 7.7 | References..... | 7-14 |
| | | |
| CHAPTER 8 | PASSIVE CORE COOLING SYSTEM – PASSIVE RESIDUAL HEAT REMOVAL | |
| 8.1 | System Function..... | 8-1 |
| 8.2 | System Description | 8-1 |
| 8.2.1 | Support Systems | 8-1 |
| 8.2.2 | Instrumentation and Control | 8-2 |
| 8.2.3 | Test and Maintenance | 8-2 |
| 8.3 | System Operation | 8-3 |
| 8.4 | Performance During Accident Conditions | 8-3 |
| 8.4.1 | Plant Shutdown..... | 8-3 |
| 8.4.2 | Loss of Coolant Accidents | 8-3 |
| 8.4.3 | Passive Residual Heat Removal Heat Exchanger Tube Rupture..... | 8-3 |
| 8.5 | Initiating Events Review | 8-4 |
| 8.5.1 | Initiating Events Impacting the PRHR System | 8-4 |
| 8.5.2 | Initiating Events Caused by PRHR System Malfunction | 8-4 |
| 8.6 | System Logic Models..... | 8-4 |
| 8.6.1 | Assumptions and Boundary Conditions..... | 8-5 |
| 8.6.2 | Fault Tree Models..... | 8-6 |
| 8.6.3 | Human Interactions..... | 8-6 |
| 8.6.4 | Common Cause Failures | 8-6 |
| 8.7 | Quantification and Results | 8-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| CHAPTER 9 | PASSIVE CORE COOLING SYSTEM – CORE MAKEUP TANK | |
| 9.1 | System Description | 9-1 |
| 9.1.1 | Support Systems | 9-1 |
| 9.1.2 | Instrumentation and Control | 9-1 |
| 9.1.3 | Test and Maintenance Assumptions..... | 9-2 |
| 9.2 | System Operation | 9-2 |
| 9.3 | Performance During Accident Conditions | 9-3 |
| 9.3.1 | Inadvertent Opening of a Steam Generator Relief or Safety Valve..... | 9-3 |
| 9.3.2 | Steam Line Break..... | 9-3 |
| 9.3.3 | Steam Generator Tube Rupture..... | 9-3 |
| 9.3.4 | Reactor Coolant System Heatup Transients | 9-4 |
| 9.3.5 | Loss-of-Coolant Accidents..... | 9-4 |
| 9.3.6 | Loss of Offsite Power | 9-4 |
| 9.3.7 | Anticipated Transient without Trip | 9-4 |
| 9.4 | Initiating Event Review..... | 9-4 |
| 9.4.1 | Initiating Events Impacting the Core Makeup Tank Subsystem | 9-5 |
| 9.4.2 | Initiating Events Due to Loss of the Core Makeup Tank Subsystem | 9-5 |
| 9.5 | System Logic Models..... | 9-5 |
| 9.5.1 | Assumptions and Boundary Conditions..... | 9-5 |
| 9.5.2 | Fault Tree Models..... | 9-7 |
| 9.5.3 | Human Interactions..... | 9-7 |
| 9.5.4 | Common Cause Failures | 9-8 |
| CHAPTER 10 | PASSIVE CORE COOLING SYSTEM – ACCUMULATOR | |
| 10.1 | System Description | 10-1 |
| 10.1.1 | Support Systems | 10-1 |
| 10.1.2 | Instrumentation and Control | 10-1 |
| 10.1.3 | Test and Maintenance Assumptions..... | 10-1 |
| 10.2 | System Operation | 10-1 |
| 10.3 | Performance During Accident Conditions | 10-2 |
| 10.3.1 | Steam Line Break..... | 10-2 |
| 10.3.2 | Loss-of-Coolant Accidents or Non-Loss-of-Coolant Accidents with Automatic Depressurization System | 10-2 |
| 10.4 | Initiating Event Review..... | 10-3 |
| 10.4.1 | Initiating Events Impacting the Accumulator Subsystem..... | 10-3 |
| 10.4.2 | Initiating Events Due to Loss of the Accumulator Subsystem | 10-3 |
| 10.5 | System Logic Models..... | 10-3 |
| 10.5.1 | Assumptions and Boundary Conditions..... | 10-3 |
| 10.5.2 | Fault Tree Models..... | 10-4 |
| 10.5.3 | Human Interactions..... | 10-4 |
| 10.5.4 | Common Cause Failures | 10-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 11 PASSIVE COOLING SYSTEM – AUTOMATIC DEPRESSURIZATION SYSTEM | | |
| 11.1 | System Function..... | 11-1 |
| 11.2 | System Description | 11-1 |
| | 11.2.1 Support Systems | 11-1 |
| | 11.2.2 Instrumentation and Control | 11-2 |
| | 11.2.3 Test and Maintenance | 11-2 |
| 11.3 | System Operation | 11-2 |
| 11.4 | Performance During Accident Conditions | 11-3 |
| | 11.4.1 Loss of Coolant Accidents | 11-3 |
| | 11.4.2 Transients..... | 11-3 |
| 11.5 | Initiating Events Review | 11-3 |
| | 11.5.1 Initiating Events Impacting the Automatic Depressurization System | 11-3 |
| | 11.5.2 Initiating Events Caused by the ADS Malfunction | 11-4 |
| 11.6 | System Logic Model | 11-4 |
| | 11.6.1 Assumptions and Boundary Conditions..... | 11-4 |
| | 11.6.2 Fault Tree Models..... | 11-5 |
| | 11.6.3 Human Interactions..... | 11-6 |
| | 11.6.4 Common Cause Failures | 11-7 |
| 11.7 | Quantification and Results | 11-7 |
| CHAPTER 12 PASSIVE CORE COOLING SYSTEM – IN-CONTAINMENT REFUELING WATER STORAGE TANK | | |
| 12.1 | System Function..... | 12-1 |
| 12.2 | System Description | 12-1 |
| | 12.2.1 Support Systems | 12-1 |
| | 12.2.2 Instrumentation and Control | 12-1 |
| | 12.2.3 Test and Maintenance | 12-2 |
| 12.3 | System Operation | 12-2 |
| 12.4 | Performance During Accident Conditions | 12-2 |
| | 12.4.1 Transients..... | 12-3 |
| | 12.4.2 Loss of Coolant Accidents..... | 12-4 |
| | 12.4.3 In-Vessel Core Damage Mitigation..... | 12-5 |
| | 12.4.4 Containment Isolation System Failure | 12-5 |
| 12.5 | Initiating Event..... | 12-5 |
| | 12.5.1 Initiating Event Impacting IRWST/Gravity Injection Subsystem | 12-5 |
| | 12.5.2 Initiating Event due to Loss of IRWST/Gravity Injection Subsystem..... | 12-5 |
| 12.6 | System Logic Models..... | 12-6 |
| | 12.6.1 Assumptions and Boundary Conditions..... | 12-6 |
| | 12.6.2 Fault Tree Models..... | 12-8 |
| | 12.6.3 Human Interactions..... | 12-8 |
| | 12.6.4 Common Cause Failures | 12-8 |
| 12.7 | Quantification and Results | 12-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 13 PASSIVE CONTAINMENT COOLING SYSTEM | | |
| 13.1 | System Description | 13-1 |
| 13.1.1 | Support Systems | 13-1 |
| 13.1.2 | Instrumentation and Control | 13-1 |
| 13.1.3 | Test and Maintenance Assumptions..... | 13-2 |
| 13.2 | System Operation | 13-2 |
| 13.3 | Performance During Accident Conditions | 13-2 |
| 13.3.1 | Post-Reactor Trip with Loss of All ac Power..... | 13-2 |
| 13.3.2 | Automatic Depressurization System Actuation..... | 13-2 |
| 13.3.3 | Post-Loss-of-Coolant Accident | 13-3 |
| 13.3.4 | Post-Main Steam Line Break | 13-3 |
| 13.4 | Initiating Event Review..... | 13-3 |
| 13.4.1 | Initiating Events Impacting the Passive Containment Cooling System..... | 13-3 |
| 13.4.2 | Initiating Events due to Loss of the Passive Containment Cooling System | 13-3 |
| 13.5 | System Logic Model | 13-3 |
| 13.5.1 | Assumptions and Boundary Conditions..... | 13-4 |
| 13.5.2 | Fault Tree Model | 13-5 |
| 13.5.3 | Human Interactions..... | 13-6 |
| 13.5.4 | Common Cause Failures..... | 13-6 |
| CHAPTER 14 MAIN AND STARTUP FEEDWATER SYSTEM | | |
| 14.1 | System Description | 14-1 |
| 14.1.1 | Support Systems | 14-1 |
| 14.1.2 | Instrumentation and Control | 14-2 |
| 14.1.3 | Test and Maintenance | 14-2 |
| 14.2 | System Operation | 14-2 |
| 14.3 | Performance During Accident Conditions | 14-2 |
| 14.4 | Initiating Event Review..... | 14-4 |
| 14.4.1 | Initiating Event Impacting Main and Startup Feedwater/ Condensate System..... | 14-4 |
| 14.4.2 | Initiating Event due to Loss of Main and Startup Feedwater/ Condensate System..... | 14-4 |
| 14.5 | System Logic Models..... | 14-4 |
| 14.5.1 | Assumptions and Boundary Conditions..... | 14-5 |
| 14.5.2 | Fault Tree Models..... | 14-7 |
| 14.5.3 | Human Interactions..... | 14-7 |
| 14.5.4 | Common Cause Failures..... | 14-7 |
| 14.6 | Quantification and Results | 14-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 15 CHEMICAL AND VOLUME CONTROL SYSTEM | | |
| 15.1 | System Description | 15-1 |
| 15.1.1 | Support Systems | 15-1 |
| 15.1.2 | Instrumentation and Control Assumptions..... | 15-1 |
| 15.1.3 | Test and Maintenance Assumptions..... | 15-2 |
| 15.2 | System Operation | 15-3 |
| 15.3 | Performance During Accident Conditions | 15-3 |
| 15.4 | Initiating Event Review..... | 15-4 |
| 15.4.1 | Initiating Events Impacting the Chemical and Volume Control System | 15-5 |
| 15.4.2 | Initiating Events Due to Loss of the Chemical and Volume Control System | 15-5 |
| 15.5 | System Logic Models..... | 15-5 |
| 15.5.1 | Assumptions and Boundary Conditions..... | 15-5 |
| 15.5.2 | Fault Tree Models..... | 15-7 |
| 15.5.3 | Human Interactions..... | 15-7 |
| 15.5.4 | Common Cause Failures..... | 15-8 |
| CHAPTER 16 CONTAINMENT HYDROGEN CONTROL SYSTEM | | |
| 16.1 | System Description | 16-1 |
| 16.1.1 | Support Systems | 16-1 |
| 16.1.2 | Instrumentation and Control | 16-1 |
| 16.1.3 | Test and Maintenance | 16-1 |
| 16.2 | System Operation | 16-2 |
| 16.3 | Performance During Accident Conditions | 16-2 |
| 16.4 | Initiating Event Review..... | 16-2 |
| 16.5 | System Logic Model | 16-2 |
| 16.5.1 | Assumptions and Boundary Conditions..... | 16-2 |
| 16.5.2 | Fault Tree Model | 16-3 |
| 16.5.3 | Human Interactions..... | 16-3 |
| 16.5.4 | Common Cause Failures..... | 16-4 |
| CHAPTER 17 NORMAL RESIDUAL HEAT REMOVAL SYSTEM | | |
| 17.1 | System Description | 17-1 |
| 17.1.1 | Support Systems | 17-1 |
| 17.1.2 | Instrumentation and Control | 17-1 |
| 17.1.3 | Test and Maintenance Assumptions..... | 17-1 |
| 17.2 | System Operation | 17-1 |
| 17.3 | Performance During Accident Conditions | 17-2 |
| 17.4 | Initiating Event Review..... | 17-3 |
| 17.4.1 | Initiating Events Impacting the Normal Residual Heat Removal System | 17-3 |
| 17.4.2 | Initiating Events Due to Loss of the Normal Residual Heat Removal System | 17-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 17.5 | System Logic Models..... | 17-4 |
| | 17.5.1 Assumptions and Boundary Conditions..... | 17-4 |
| | 17.5.2 Fault Tree Models..... | 17-6 |
| | 17.5.3 Human Interactions..... | 17-6 |
| | 17.5.4 Common Cause Failures..... | 17-6 |
| 17.6 | References..... | 17-6 |
| | | |
| CHAPTER 18 | COMPONENT COOLING WATER SYSTEM | |
| 18.1 | System Description | 18-1 |
| | 18.1.1 Support Systems | 18-1 |
| | 18.1.2 Instrumentation and Control | 18-1 |
| | 18.1.3 Test and Maintenance Assumptions..... | 18-1 |
| 18.2 | System Operation | 18-2 |
| 18.3 | Performance During Accident Conditions | 18-2 |
| 18.4 | Initiating Event Review..... | 18-2 |
| | 18.4.1 Initiating Events Impacting the Component Cooling Water System..... | 18-2 |
| | 18.4.2 Initiating Events Due to Loss of the Component Cooling Water System..... | 18-3 |
| 18.5 | System Logic Models..... | 18-3 |
| | 18.5.1 Assumptions and Boundary Conditions..... | 18-3 |
| | 18.5.2 Fault Tree Models..... | 18-4 |
| | 18.5.3 Human Interactions..... | 18-4 |
| | 18.5.4 Common Cause Failures..... | 18-5 |
| | | |
| CHAPTER 19 | SERVICE WATER SYSTEM | |
| 19.1 | System Description | 19-1 |
| | 19.1.1 Support Systems | 19-1 |
| | 19.1.2 Instrumentation and Control | 19-1 |
| | 19.1.3 Test and Maintenance Assumptions..... | 19-1 |
| 19.2 | System Operation | 19-2 |
| 19.3 | Performance During Accident Conditions | 19-2 |
| 19.4 | Initiating Event Review..... | 19-2 |
| | 19.4.1 Initiating Events Impacting the Service Water System | 19-2 |
| | 19.4.2 Initiating Events Due to Loss of the Service Water System..... | 19-2 |
| 19.5 | System Logic Models..... | 19-3 |
| | 19.5.1 Assumptions and Boundary Conditions..... | 19-3 |
| | 19.5.2 Fault Tree Models..... | 19-4 |
| | 19.5.3 Human Interactions..... | 19-5 |
| | 19.5.4 Common Cause Failures..... | 19-5 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|-------------|
| CHAPTER 20 CENTRAL CHILLED WATER SYSTEM | | |
| 20.1 | System Description | 20-1 |
| 20.1.1 | Support Systems | 20-1 |
| 20.1.2 | Instrumentation and Control | 20-1 |
| 20.1.3 | Test and Maintenance Assumptions..... | 20-1 |
| 20.2 | System Operation | 20-2 |
| 20.3 | Performance During Accident Conditions | 20-2 |
| 20.4 | Initiating Event Review..... | 20-2 |
| 20.4.1 | Initiating Events Impacting the Central Chilled Water System..... | 20-2 |
| 20.4.2 | Initiating Events Due to Loss of the Central Chilled Water System | 20-3 |
| 20.5 | System Logic Model | 20-3 |
| 20.5.1 | Assumptions and Boundary Conditions..... | 20-3 |
| 20.5.2 | Fault Tree Model | 20-4 |
| 20.5.3 | Human Interactions..... | 20-4 |
| 20.5.4 | Common Cause Failures | 20-4 |
| CHAPTER 21 AC POWER SYSTEM | | |
| 21.1 | System Description | 21-1 |
| 21.1.1 | Support Systems | 21-1 |
| 21.1.2 | Instrumentation and Control | 21-2 |
| 21.1.3 | Test and Maintenance Assumptions..... | 21-2 |
| 21.2 | System Operation | 21-2 |
| 21.3 | Performance During Accident Conditions | 21-3 |
| 21.3.1 | Automatic Load Shedding | 21-3 |
| 21.3.2 | Manual Transfer..... | 21-3 |
| 21.3.3 | Electric Circuit Protection..... | 21-3 |
| 21.4 | Initiating Event Review..... | 21-3 |
| 21.4.1 | Loss of the Main Generator | 21-4 |
| 21.4.2 | Loss of Offsite Power | 21-4 |
| 21.4.3 | Loss of 6900-vac and 480-vac Busses | 21-4 |
| 21.5 | System Logic Models..... | 21-4 |
| 21.5.1 | Assumptions and Boundary Conditions..... | 21-5 |
| 21.5.2 | Fault Tree Models..... | 21-7 |
| 21.5.3 | Human Interactions..... | 21-8 |
| 21.5.4 | Common Cause Failures | 21-8 |
| CHAPTER 22 CLASS 1E DC AND UNINTERRUPTIBLE POWER SUPPLY SYSTEM | | |
| 22.1 | System Description | 22-1 |
| 22.1.1 | Support Systems | 22-1 |
| 22.1.2 | Instrumentation and Control | 22-1 |
| 22.1.3 | Test and Maintenance Assumptions..... | 22-1 |
| 22.2 | System Operation | 22-2 |
| 22.3 | Performance During Accident Conditions | 22-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 22.4 | Initiating Event Review..... | 22-2 |
| 22.4.1 | Initiating Events Impacting the Class 1E dc and UPS System..... | 22-3 |
| 22.4.2 | Initiating Events Due to Loss of the Class 1E dc and UPS System..... | 22-3 |
| 22.5 | System Logic Models..... | 22-3 |
| 22.5.1 | Assumptions and Boundary Conditions..... | 22-3 |
| 22.5.2 | Fault Tree Models..... | 22-4 |
| 22.5.3 | Human Interactions..... | 22-4 |
| 22.5.4 | Common Cause Failures..... | 22-4 |
| 22.6 | References..... | 22-5 |
| | | |
| CHAPTER 23 | NON-CLASS 1E DC AND UPS SYSTEM | |
| 23.1 | System Description | 23-1 |
| 23.1.1 | Support Systems | 23-1 |
| 23.1.2 | Instrumentation and Control | 23-1 |
| 23.1.3 | Test and Maintenance Assumptions..... | 23-1 |
| 23.2 | System Operation | 23-2 |
| 23.3 | Performance During Accident Conditions | 23-2 |
| 23.4 | Initiating Event Review..... | 23-2 |
| 23.4.1 | Initiating Events Impacting the Non-Class 1E dc and UPS System..... | 23-2 |
| 23.4.2 | Initiating Events Due to Loss of the Non-Class 1E dc and UPS Power System | 23-3 |
| 23.5 | System Logic Models..... | 23-3 |
| 23.5.1 | Assumptions and Boundary Conditions..... | 23-3 |
| 23.5.2 | Fault Tree Models..... | 23-4 |
| 23.5.3 | Human Interactions..... | 23-5 |
| 23.5.4 | Common Cause Failures..... | 23-5 |
| 23.6 | References..... | 23-5 |
| | | |
| CHAPTER 24 | CONTAINMENT ISOLATION | |
| 24.1 | System Description | 24-1 |
| 24.1.1 | Support Systems | 24-1 |
| 24.1.2 | Instrumentation and Control | 24-1 |
| 24.1.3 | Test and Maintenance Assumptions..... | 24-2 |
| 24.2 | System Operation | 24-2 |
| 24.3 | Performance During Accident Conditions | 24-2 |
| 24.4 | Initiating Event Review..... | 24-2 |
| 24.4.1 | Initiating Events Impacting Containment Isolation..... | 24-2 |
| 24.4.2 | Initiating Events Due to Loss of the Containment Isolation System | 24-2 |
| 24.5 | System Logic Models..... | 24-3 |
| 24.5.1 | Assumptions and Boundary Conditions..... | 24-4 |
| 24.5.2 | Fault Tree Models..... | 24-5 |
| 24.5.3 | Human Interactions..... | 24-6 |
| 24.5.4 | Common Cause Failures..... | 24-6 |
| 24.6 | References..... | 24-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|-------------|
| CHAPTER 25 COMPRESSED AND INSTRUMENT AIR SYSTEM | | |
| 25.1 | System Description | 25-1 |
| 25.1.1 | Support Systems | 25-2 |
| 25.1.2 | Instrumentation and Control | 25-2 |
| 25.1.3 | Test and Maintenance Assumptions..... | 25-3 |
| 25.2 | System Operation | 25-3 |
| 25.3 | Performance During Accident Conditions | 25-3 |
| 25.4 | Initiating Event Review..... | 25-4 |
| 25.4.1 | Initiating Events Impacting the Instrument Air Subsystem..... | 25-4 |
| 25.4.2 | Initiating Events Due to Loss of the Instrument Air Subsystem | 25-4 |
| 25.5 | System Logic Models..... | 25-4 |
| 25.5.1 | Assumptions and Boundary Conditions..... | 25-4 |
| 25.5.2 | Fault Tree Models..... | 25-6 |
| 25.5.3 | Human Interactions..... | 25-7 |
| 25.5.4 | Common Cause Failures | 25-7 |
| CHAPTER 26 PROTECTION AND SAFETY MONITORING SYSTEM | | |
| 26.1 | System Analysis Description..... | 26-1 |
| 26.1.1 | Analysis of Support Systems..... | 26-4 |
| 26.1.2 | Analysis of Instrumentation | 26-5 |
| 26.1.3 | Test and Maintenance Assumptions..... | 26-6 |
| 26.2 | Performance During Accident Conditions | 26-7 |
| 26.3 | Initiating Event Review..... | 26-7 |
| 26.3.1 | Initiating Event Impacting PMS..... | 26-7 |
| 26.3.2 | Initiating Event due to Loss of PMS | 26-8 |
| 26.4 | System Logic Model Development | 26-8 |
| 26.4.1 | Assumptions and Boundary Conditions..... | 26-8 |
| 26.4.2 | Fault Tree Models..... | 26-12 |
| 26.4.3 | Description of I&C Subtree Development | 26-12 |
| 26.4.4 | Human Interactions..... | 26-19 |
| 26.5 | Discussion of Methodology..... | 26-19 |
| 26.5.1 | Fault Tree Analysis..... | 26-20 |
| 26.5.2 | Unavailability..... | 26-20 |
| 26.5.3 | Spurious Failure Rate Per Year..... | 26-20 |
| 26.5.4 | Common Cause Failures | 26-22 |
| 26.5.5 | Data Manipulation | 26-23 |
| 26.6 | References..... | 26-24 |
| CHAPTER 27 DIVERSE ACTUATION SYSTEM | | |
| 27.1 | System Analysis Description..... | 27-1 |
| 27.1.1 | Support Systems Analysis..... | 27-2 |
| 27.1.2 | Analysis of Instrumentation and Control | 27-2 |
| 27.1.3 | Test and Maintenance | 27-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 27.2 | Analysis of System Operation | 27-2 |
| 27.3 | Performance During Accident Conditions | 27-6 |
| 27.4 | Initiating Event Review..... | 27-6 |
| | 27.4.1 Initiating Events Impacting the Diverse Actuation System..... | 27-6 |
| | 27.4.2 Initiating Events Due to Loss of the Diverse Actuation System..... | 27-6 |
| 27.5 | System Logic Model | 27-6 |
| | 27.5.1 Assumptions and Boundary Conditions..... | 27-7 |
| | 27.5.2 Fault Tree Model | 27-7 |
| | 27.5.3 Human Interactions..... | 27-7 |
| | 27.5.4 Common Cause Failures | 27-8 |
| | | |
| CHAPTER 28 | PLANT CONTROL SYSTEM | |
| 28.1 | System Analysis Description..... | 28-1 |
| | 28.1.1 Analysis of Support Systems..... | 28-3 |
| | 28.1.2 Analysis of Instrumentation | 28-4 |
| | 28.1.3 Test and Maintenance Assumptions..... | 28-4 |
| 28.2 | Performance During Accident Conditions | 28-6 |
| 28.3 | Initiating Event Review..... | 28-6 |
| | 28.3.1 Initiating Events Impacting the Plant Control System..... | 28-6 |
| | 28.3.2 Initiating Event due to Loss of the Plant Control System..... | 28-6 |
| 28.4 | System Logic Model Development | 28-7 |
| | 28.4.1 Assumptions and Boundary Conditions..... | 28-7 |
| | 28.4.2 Fault Tree Models..... | 28-9 |
| | 28.4.3 Description of I&C Subtree Development | 28-10 |
| | 28.4.4 Human Interactions..... | 28-16 |
| 28.5 | Discussion of Methodology..... | 28-17 |
| | 28.5.1 Fault Tree Analysis..... | 28-17 |
| | 28.5.2 Unavailability..... | 28-17 |
| | 28.5.3 Common Cause Failures | 28-17 |
| | 28.5.4 Data Manipulation | 28-18 |
| | | |
| CHAPTER 29 | COMMON-CAUSE ANALYSIS | |
| 29.1 | Introduction..... | 29-1 |
| 29.2 | Dependent Failures | 29-1 |
| 29.3 | Common-Cause Analysis | 29-4 |
| | 29.3.1 Assumptions | 29-4 |
| | 29.3.2 Analysis of Potential Common-Cause Failures within the Systems..... | 29-6 |
| | 29.3.3 Analysis of Potential Common-Cause Failures among Several Systems | 29-6 |
| 29.4 | Calculations For Component Groups | 29-6 |
| | 29.4.1 DC Batteries..... | 29-7 |
| | 29.4.2 Reactor Trip Breakers | 29-8 |
| | 29.4.3 Automatic Depressurization System Explosive Valves..... | 29-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 29.4.4 | Air-Operated Valves in Core Makeup Tanks..... | 29-10 |
| 29.4.5 | Automatic Depressurization System Motor-Operated Valves..... | 29-11 |
| 29.4.6 | Common-Cause Failure for IRWST Valves..... | 29-14 |
| 29.5 | Results..... | 29-17 |
| 29.6 | References..... | 29-17 |
| ATTACHMENT 29A COMMON-CAUSE ANALYSIS GUIDELINES..... | | 29A-1 |
| 29A.1 | Introduction..... | 29A-1 |
| 29A.2 | Types of Dependencies | 29A-1 |
| 29A.3 | Common Cause Failures Definition | 29A-2 |
| 29A.4 | Methodology | 29A-3 |
| 29A.5 | Common Cause Failures Calculation Procedure | 29A-4 |
| | 29A.5.1 Procedure for Treatment of Common Cause Failures Within a System..... | 29A-5 |
| | 29A.5.2 Procedure for Treatment of Common Cause Failures Among More Systems | 29A-7 |
| 29A.6 | Common Cause Failure Numerical Evaluation | 29A-8 |
| | 29A.6.1 Evaluation through Beta Factor Method | 29A-8 |
| | 29A.6.2 Evaluation through Multiple-Greek Letter (MGL) Method | 29A-8 |
| 29A.7 | References..... | 29A-10 |
| CHAPTER 30 HUMAN RELIABILITY ANALYSIS | | |
| 30.1 | Introduction..... | 30-1 |
| 30.2 | Summary of Results | 30-1 |
| 30.3 | Methodology | 30-2 |
| 30.4 | Major Assumptions | 30-4 |
| 30.5 | Types of Human Interactions | 30-10 |
| | 30.5.1 Quantification Model..... | 30-11 |
| 30.6 | Quantification..... | 30-12 |
| | 30.6.1 ZON-MAN01 (Start the Onsite Standby Diesel Generator)..... | 30-12 |
| | 30.6.2 LPM-MAN01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-13 |
| | 30.6.3 LPM-MAN02 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-15 |
| | 30.6.4 LPM-MAN05 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-16 |
| | 30.6.5 LPM-REC01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-17 |
| | 30.6.6 ADN-MAN01 (Actuate the Automatic Depressurization System) | 30-17 |
| | 30.6.7 ADN-REC01 (Actuate the Automatic Depressurization System)..... | 30-19 |
| | 30.6.8 CCB-MAN01 (Start the Standby Component Cooling Water Pump)..... | 30-19 |
| | 30.6.9 CCN-MAN02 (Inadvertent Misalignment of Heat Exchanger) | 30-20 |
| | 30.6.10 CIB-MAN00 (Diagnose Steam Generator Tube Rupture)..... | 30-21 |
| | 30.6.11 DUMP-MAN01 (Operate Steam Dump Valves) | 30-22 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 30.6.12 | CIC-MAN01 (Isolate Containment)..... | 30-23 |
| 30.6.13 | ADS-MANTEST (Recognize the Need and Reclose ADS Stage MOV)..... | 30-24 |
| 30.6.14 | CAN-MAN0S (Locally Close Manual Valve CAS-V204 to Isolate Containment) | 30-25 |
| 30.6.15 | CIT-MAN0S (Isolate Containment)..... | 30-26 |
| 30.6.16 | CMN-MAN01 (Actuate Core Makeup Tank)..... | 30-27 |
| 30.6.17 | CMN-REC01 (Actuate the Core Makeup Tanks) | 30-28 |
| 30.6.18 | CVN-MAN00 (Align Chemical and Volume Control System) | 30-29 |
| 30.6.19 | CVN-MAN02 (Align Chemical and Volume Control System) | 30-30 |
| 30.6.20 | CVN-MAN03 (Start Chemical and Volume Control System Pump B) | 30-30 |
| 30.6.21 | ADF-MAN01 (Depressurize the RCS to Refill the Pressurizer)..... | 30-31 |
| 30.6.22 | SGHL-MAN01 (Isolate Feedwater to Failed Steam Generator) | 30-32 |
| 30.6.23 | CAN-MAN01 (Start Standby Compressor) | 30-33 |
| 30.6.24 | REN-MAN02 (Initiate Recirculation)..... | 30-33 |
| 30.6.25 | REN-MAN03 (Initiate Recirculation)..... | 30-34 |
| 30.6.26 | IWN-MAN00 (Operate In-Containment Refueling Water Storage Tank Motor-Operated Valves)..... | 30-35 |
| 30.6.27 | RHN-MAN01 (Align Normal Residual Heat Removal System)..... | 30-36 |
| 30.6.28 | RHN-MANDIV (Align Normal Residual Heat Removal System)..... | 30-37 |
| 30.6.29 | RHN-MAN02/RHN-MAN03 (Align Normal Residual Heat Removal System)..... | 30-38 |
| 30.6.30 | PCN-MAN01 (Actuate Passive Containment Cooling System)..... | 30-40 |
| 30.6.31 | HPM-MAN01 (Diagnose Need for High Pressure Heat Removal)..... | 30-40 |
| 30.6.32 | PRN-MAN01 (Align Passive Residual Heat Removal System) | 30-41 |
| 30.6.33 | PRN-MAN02 (Align Passive Residual Heat Removal System) | 30-42 |
| 30.6.34 | PRN-MAN03 (Align Passive Residual Heat Removal System) | 30-43 |
| 30.6.35 | PRI-MAN01 (Isolate Failed Passive Residual Heat Removal Heat Exchanger) | 30-44 |
| 30.6.36 | REN-MAN04 (Initiate Recirculation)..... | 30-45 |
| 30.6.37 | RCN-MAN01 (Trip Reactor Coolant Pumps) | 30-46 |
| 30.6.38 | ATW-MAN01 (Manually Insert Control Rods)..... | 30-47 |
| 30.6.39 | ATW-MAN03 (Manually Trip the Reactor through Protection and Safety Monitoring System in One Minute) | 30-48 |
| 30.6.40 | ATW-MAN04 (Manually Trip the Reactor through Diverse Actuation System in One Minute) | 30-49 |
| 30.6.41 | ATW-MAN05 (Manually Trip the Reactor through Protection and Safety Monitoring System in Seven Minutes)..... | 30-49 |
| 30.6.42 | ATW-MAN06 (Manually Trip the Reactor through Diverse Actuation System In Seven Minutes)..... | 30-50 |
| 30.6.43 | RTN-MAN01 (Perform Controlled Reactor Shutdown)..... | 30-51 |
| 30.6.44 | FWN-MAN02 (Start the Startup Feedwater Pumps) | 30-52 |
| 30.6.45 | FWN-MAN03 (Start the Startup Feedwater Pumps) | 30-53 |
| 30.6.46 | REG-MAN00 (Regulate Startup Feedwater)..... | 30-54 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|--------------|
| 30.6.47 | CIA-MAN01 (Isolate Failed Steam Generator) | 30-55 |
| 30.6.48 | CIB-MAN01 (Close Main Steam Isolation Valve) | 30-56 |
| 30.6.49 | SGA-MAN01 (Inadvertent Opening of Steam Generator Power-Operated Relief Valve) | 30-57 |
| 30.6.50 | SWN-MAN01N (Open Air-Operated Valve on Motor Strainer Line) | 30-58 |
| 30.6.51 | SWB-MAN02 (Start Standby Service Water Pump) | 30-58 |
| 30.6.52 | SWB-MAN02N (Start Standby Service Water Pump) | 30-59 |
| 30.6.53 | TCB-MAN01 (Start Standby Turbine Closed Cooling Water Pump) | 30-60 |
| 30.6.54 | TCB-MAN02 (Locally Align Standby Turbine Closed Cooling Water Heat Exchanger) | 30-61 |
| 30.6.55 | VLN-MAN01 (Actuate Hydrogen Control System) | 30-62 |
| 30.6.56 | VWN-MAN01 (Align Standby Chiller) | 30-63 |
| 30.6.57 | ATW-MAN11 (Recognize the Need for Manual Boration) | 30-64 |
| 30.6.58 | REC-MANDAS (Diagnosis of an Event Through DAS Signals or Perform an Activity by Operating DAS Controls) | 30-65 |
| 30.6.59 | RHN-MAN04 (Isolate the RNS During Shutdown Conditions) | 30-65 |
| 30.6.60 | RHN-MAN05 (Initiate Gravity Injection from IRWST via RNS Suction Line) | 30-66 |
| 30.6.61 | RHN-MAN06 (Recognize the Need and Throttle RNS Valve V011) | 30-68 |
| 30.6.62 | RCS-MANODS1 (Close AOVs CVS-V045 or -V047, Given Failure of HL Level Instruments) | 30-68 |
| 30.6.63 | RCS-MANODS2 (Close AOVs CVS-V045 or -V047, Given Failure of Valves to Close Automatically) | 30-70 |
| 30.6.64 | SWN-MAN03 (Recognize the Need and Locally Refill Service Water Basin) | 30-70 |
| 30.7 | Conditional Probability Evaluation | 30-71 |
| 30.7.1 | Application | 30-72 |
| 30.7.2 | Process Used to Determine Dependencies | 30-72 |
| 30.7.3 | Calculation of Dependent Human Error Probabilities | 30-72 |
| 30.8 | References | 30-74 |
| ATTACHMENT 30A HUMAN RELIABILITY ANALYSIS GUIDELINES | | 30A-1 |
| 30A.1 | Introduction | 30A-1 |
| 30A.2 | Schedule for Human Reliability Analysis | 30A-1 |
| 30A.3 | Methodology | 30A-1 |
| 30A.4 | Responsibility | 30A-2 |
| 30A.5 | Procedure for Human Interaction Evaluation | 30A-2 |
| 30A.5.1 | Type A | 30A-3 |
| 30A.5.2 | Type B | 30A-3 |
| 30A.5.3 | Type C | 30A-4 |
| 30A.5.4 | Commission Errors That Have Detrimental Effects | 30A-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 30A.6 | Procedure for Human Error Probabilities Quantification | 30A-8 |
| | 30A.6.1 Basic Assumptions for Human Interaction Analysis..... | 30A-8 |
| 30A.7 | References..... | 30A-9 |
| CHAPTER 31 | OTHER EVENT TREE NODE PROBABILITIES | |
| 31.1 | Introduction..... | 31-1 |
| 31.2 | Identification of Cases Requiring Calculations | 31-1 |
| | 31.2.1 BL – Main Steam Line Break Occurs Inside Containment | 31-1 |
| | 31.2.2 CNB – Containment Isolation Fails Due to Reactor Coolant System Vessel Rupture..... | 31-1 |
| | 31.2.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-1 |
| | 31.2.4 NSGTR – Consequential Steam Generator Tube Rupture..... | 31-2 |
| | 31.2.5 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-2 |
| | 31.2.6 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-2 |
| | 31.2.7 PRSOV – Pressurizer Safety Valves Reclose | 31-2 |
| | 31.2.8 R05 – Offsite Power Recovered within One-Half Hour..... | 31-2 |
| | 31.2.9 SLSOV – Main Steam Line Relief Valves Reclose | 31-2 |
| 31.3 | Case-Specific Calculations..... | 31-3 |
| | 31.3.1 BL – Main Steam Line Break Occurs Inside Containment | 31-3 |
| | 31.3.2 CNB – Containment Isolation Fails Due to RCS Vessel Rupture..... | 31-3 |
| | 31.3.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-3 |
| | 31.3.4 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-4 |
| | 31.3.5 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-4 |
| | 31.3.6 PRSOV – Pressurizer Safety Valves Reclose | 31-5 |
| | 31.3.7 R05 – Offsite Power Recovered within One-Half Hour..... | 31-6 |
| | 31.3.8 SGTR1 – Single Consequential Steam Generator Tube Rupture..... | 31-6 |
| | 31.3.9 SGTR – Multiple Consequential Steam Generator Tube Rupture | 31-8 |
| | 31.3.10 SLSOV – Main Steam Line Relief and Safety Valves Reclose | 31-8 |
| | 31.3.11 SLSOV1 – Main Steam Line Relief and Safety Valves Reclose | 31-9 |
| | 31.3.12 SLSOV2 – Main Steam Line Safety Valves Reclose..... | 31-10 |
| | 31.3.13 SLSOV3 – Main Steamline Relief and Safety Valves Reclose, SGTR..... | 31-10 |
| 31.4 | References..... | 31-11 |
| CHAPTER 32 | DATA ANALYSIS AND MASTER DATA BANK | |
| 32.1 | Data Analysis | 32-1 |
| | 32.1.1 Random Component Failure Data..... | 32-1 |
| | 32.1.2 Test and Maintenance Unavailability..... | 32-2 |
| | 32.1.3 Common Cause Failure Data | 32-2 |
| | 32.1.4 Human Reliability Data | 32-2 |
| | 32.1.5 Initiating Event Frequency Data | 32-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 32.2 | Master Data Bank..... | 32-2 |
| 32.2.1 | Initiating Event Frequencies | 32-3 |
| 32.2.2 | Random Component Failures..... | 32-3 |
| 32.2.3 | Common Cause Failure Probabilities..... | 32-3 |
| 32.2.4 | Human Error Probabilities | 32-3 |
| 32.2.5 | System-Specific Calculations..... | 32-3 |
| 32.2.6 | Other Event Tree Node Probabilities | 32-3 |
| 32.2.7 | Master Data Bank | 32-4 |
| 32.3 | References..... | 32-4 |
| | | |
| CHAPTER 33 | FAULT TREE AND CORE DAMAGE QUANTIFICATION | |
| 33.1 | Introduction..... | 33-1 |
| 33.2 | Fault Tree Model Quantification | 33-1 |
| 33.3 | Event Tree Model Calculation | 33-1 |
| 33.3.1 | Core Damage Quantification Method | 33-2 |
| 33.3.2 | Core Damage Quantification Input Files and Data | 33-4 |
| 33.3.3 | Definition of Consequential Event Categories | 33-4 |
| 33.3.4 | Incorporate Operator Action Dependencies Into Plant Core Damage Frequency Quantification..... | 33-6 |
| 33.3.5 | Core Damage Frequency Results | 33-6 |
| | | |
| CHAPTER 34 | SEVERE ACCIDENT PHENOMENA TREATMENT | |
| 34.1 | Introduction..... | 34-1 |
| 34.2 | Treatment of Physical Processes | 34-1 |
| 34.2.1 | In-Vessel Retention of Molten Core Debris..... | 34-1 |
| 34.2.2 | Fuel-Coolant Interaction (Steam Explosions) | 34-2 |
| 34.2.3 | Hydrogen Combustion and Detonation..... | 34-4 |
| 34.2.4 | High-Pressure Melt Ejection..... | 34-5 |
| 34.2.5 | Core Debris Coolability | 34-5 |
| 34.2.6 | Containment Pressurization from Decay Heat | 34-6 |
| 34.2.7 | Elevated Temperature (Equipment Survivability)..... | 34-7 |
| 34.2.8 | Summary..... | 34-7 |
| 34.3 | Analysis Method | 34-7 |
| 34.4 | Severe Accident Analyses..... | 34-8 |
| 34.4.1 | Accident Class 3BE – Intact Containment..... | 34-8 |
| 34.4.2 | Accident Class 3BE – Failed Containment..... | 34-10 |
| 34.4.3 | Accident Class 3BL – Intact Containment..... | 34-11 |
| 34.4.4 | Accident Class 3BR – Intact Containment..... | 34-12 |
| 34.4.5 | Accident Class 3C – Intact Containment | 34-13 |
| 34.4.6 | Accident Class 3C – Failed Containment | 34-14 |
| 34.4.7 | Accident Class 3D – Intact Containment..... | 34-14 |
| 34.4.8 | Accident Class 3D – Failed Containment | 34-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 34.4.9 | Accident Class 6E – Bypass Containment | 34-16 |
| 34.4.10 | Accident Class 6L – Bypass Containment | 34-17 |
| 34.4.11 | Accident Class 1AP | 34-17 |
| 34.4.12 | Accident Class 1A | 34-18 |
| 34.4.13 | Intermediate and Late Containment Failure Cases | 34-19 |
| 34.5 | Insights and Conclusions | 34-21 |
| 34.6 | References | 34-21 |
| | | |
| CHAPTER 35 | CONTAINMENT EVENT TREE ANALYSIS | |
| 35.1 | Introduction | 35-1 |
| 35.2 | Containment Event Tree – General Discussion | 35-1 |
| 35.3 | Event Tree Construction | 35-2 |
| 35.4 | Level 1/Level 2 Interface | 35-3 |
| 35.5 | Containment Event Tree Top Events | 35-3 |
| 35.5.1 | Severe Accident Phenomena Considerations | 35-3 |
| 35.5.2 | Operator Action and Systems Top-Event Considerations | 35-5 |
| 35.6 | Release Category Definitions | 35-7 |
| 35.6.1 | Release Category BP – Containment Bypass | 35-8 |
| 35.6.2 | Release Category CI – Containment Isolation Failure | 35-9 |
| 35.6.3 | Release Category CFE – Early Containment Failure | 35-9 |
| 35.6.4 | Release Category CFI – Intermediate Containment Failure | 35-9 |
| 35.6.5 | Release Category CFL – Late Containment Failure | 35-9 |
| 35.6.6 | Release Category CFV – Containment Venting | 35-10 |
| 35.6.7 | Release Category IC – Intact Containment | 35-10 |
| 35.7 | Top-Event Nodal Questions and Success Criteria | 35-10 |
| 35.7.1 | Top Event DP – RCS Depressurization After Core Uncovery | 35-11 |
| 35.7.2 | Top Event IS – Containment Isolation | 35-12 |
| 35.7.3 | Top Event IR – Reactor Cavity Flooding | 35-13 |
| 35.7.4 | Top Event RFL – Reflooding of a Degraded Core | 35-14 |
| 35.7.5 | Top Event VF – Debris Relocation to the Reactor Cavity | 35-14 |
| 35.7.6 | Top Event PC – Passive Containment Cooling | 35-15 |
| 35.7.7 | Top Event VNT – Containment Venting | 35-16 |
| 35.7.8 | Top Event IF – Intermediate Containment Failure | 35-16 |
| 35.7.9 | Top Event IG – Hydrogen Control System | 35-17 |
| 35.7.10 | Top Event DF – Diffusion Flame | 35-17 |
| 35.7.11 | Top Event DTE – Early Hydrogen Detonation | 35-18 |
| 35.7.12 | Top Event DFG – Hydrogen Deflagration | 35-19 |
| 35.7.13 | Top Event DTI – Intermediate Hydrogen Detonation | 35-19 |
| 35.8 | Summary | 35-20 |
| 35.9 | References | 35-20 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 36 REACTOR COOLANT SYSTEM DEPRESSURIZATION | | |
| 36.1 | Introduction..... | 36-1 |
| 36.2 | Definition of High Pressure..... | 36-1 |
| 36.3 | Node DP..... | 36-2 |
| 36.4 | Success Criteria..... | 36-2 |
| 36.4.1 | Accident Classes 3BE, 3BL, 3BR, 3C..... | 36-2 |
| 36.4.2 | Accident Class 3D/1D..... | 36-3 |
| 36.4.3 | Accident Classes 1A and 1AP..... | 36-3 |
| 36.4.4 | Steam Generator Tube Rupture – Accident Class 6..... | 36-4 |
| 36.4.5 | Anticipated Transient Without Scram – Accident Class 3A..... | 36-5 |
| 36.6 | References..... | 36-5 |
| CHAPTER 37 CONTAINMENT ISOLATION | | |
| 37.1 | Introduction..... | 37-1 |
| 37.2 | Definition of Containment Isolation..... | 37-1 |
| 37.3 | Success Criteria..... | 37-1 |
| 37.3.1 | Accident Classes 1A and 1AP..... | 37-2 |
| 37.3.2 | Accident Class 3A..... | 37-2 |
| 37.3.3 | Accident Class 3BR..... | 37-2 |
| 37.3.4 | Accident Class 3BE..... | 37-2 |
| 37.3.5 | Accident Class 3BL..... | 37-2 |
| 37.3.6 | Accident Class 3C..... | 37-2 |
| 37.3.7 | Accident Class 3D/1D..... | 37-3 |
| 37.3.8 | Accident Class 6..... | 37-3 |
| 37.4 | Summary..... | 37-3 |
| CHAPTER 38 REACTOR VESSEL REFLOODING | | |
| 38.1 | Introduction..... | 38-1 |
| 38.2 | Definition of Reflooding Success..... | 38-1 |
| 38.3 | Success Criteria..... | 38-1 |
| 38.3.1 | Accident Classes 1A and 1AP..... | 38-1 |
| 38.3.2 | Accident Class 3BR..... | 38-2 |
| 38.3.3 | Accident Class 3BE..... | 38-2 |
| 38.3.4 | Accident Class 3BL..... | 38-3 |
| 38.3.5 | Accident Class 3D/1D..... | 38-3 |
| 38.3.6 | Accident Class 6..... | 38-3 |
| 38.3.7 | Accident Class 3C..... | 38-3 |
| 38.3.8 | Accident Class 3A..... | 38-4 |
| 38.4 | Summary..... | 38-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 39 IN-VESSEL RETENTION OF MOLTEN CORE DEBRIS | | |
| 39.1 | Introduction..... | 39-1 |
| 39.2 | Background on the Application of IVR to the Passive Plant..... | 39-1 |
| 39.3 | Application of IVR to the AP1000 Passive Plant..... | 39-2 |
| 39.4 | Reactor Vessel Failure Criteria | 39-3 |
| 39.5 | In-Vessel Melt Progression and Relocation..... | 39-4 |
| 39.6 | Application of Heat Transfer Correlations to the AP1000 | 39-6 |
| | 39.6.1 Debris Pool to Vessel Wall Heat Transfer | 39-6 |
| | 39.6.2 Vessel Wall to External Cooling Water Heat Transfer | 39-7 |
| 39.7 | Quantification of Margin to Failure of the Reactor Vessel Wall | 39-8 |
| | 39.7.1 Zirconium Oxidation Fraction Input Probability Distribution..... | 39-9 |
| | 39.7.2 Steel Mass Input Probability Distribution..... | 39-9 |
| | 39.7.3 Final Bounding State Timing Input Probability Distribution..... | 39-10 |
| | 39.7.4 Critical Heat Flux..... | 39-10 |
| | 39.7.5 Results and Conclusions of Heat Flux Quantification | 39-10 |
| 39.8 | Reactor Coolant System Depressurization | 39-11 |
| 39.9 | Reactor Cavity Flooding (Node IR) | 39-11 |
| | 39.9.1 Node IR Success Criteria..... | 39-12 |
| | 39.9.2 Cavity Flooding Scenario Dependencies | 39-13 |
| 39.10 | Reactor Vessel Insulation Design Concept..... | 39-15 |
| | 39.10.1 Description of Reactor Vessel Insulation and Venting | 39-15 |
| | 39.10.2 Design Analysis of the Insulation and Support Frame..... | 39-17 |
| 39.11 | Reactor Vessel External Surface Treatment..... | 39-18 |
| 39.12 | Reactor Vessel Failure (Node VF) | 39-18 |
| | 39.12.1 Node VF Success Criteria..... | 39-18 |
| 39.13 | Summary | 39-19 |
| 39.14 | References..... | 39-19 |
| ATTACHMENT 39A AP1000 IN-VESSEL CORE MELTING RELOCATION | | |
| 39A.1 | Introduction..... | 39A-1 |
| 39A.2 | Phenomenological Issues | 39A-1 |
| | 39A.2.1 Focusing Effect..... | 39A-1 |
| | 39A.2.2 Material Interaction..... | 39A-1 |
| 39A.3 | AP1000 Reactor Vessel Lower Internals Geometry..... | 39A-1 |
| 39A.4 | Modeling of Core and Reactor Vessel Lower Internals Heatup | 39A-2 |
| | 39A.4.1 MAAP4 Model | 39A-2 |
| | 39A.4.2 Finite Difference Modeling..... | 39A-3 |
| | 39A.4.3 Relocation of In-Core Debris to Lower Plenum..... | 39A-3 |
| 39A-5 | Base Core Damage Sequence for In-Vessel Retention..... | 39A-3 |
| | 39A.5.1 Core Heatup and Formation of In-Core Molten Debris Layers..... | 39A-4 |
| | 39A.5.2 Melting of Core Shroud and Core Barrel..... | 39A-6 |
| | 39A.5.3 Initial Relocation of Molten Core Debris to Lower Plenum | 39A-7 |
| | 39A.5.4 Lower Plenum Debris Pool Formation..... | 39A-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 39A.6 | Potential for Debris Interaction | 39A-12 |
| 39A.7 | Conclusions from Analysis of AP1000 In-Vessel Core Melting and Relocation | 39A-12 |
| 39A.8 | References..... | 39A-13 |
| CHAPTER 40 PASSIVE CONTAINMENT COOLING, LONG TERM CONTAINMENT INTEGRITY AND CONTAINMENT VENTING | | |
| 40.1 | Passive Containment Cooling System..... | 40-1 |
| 40.2 | Passive Containment Cooling Water – Node PC | 40-2 |
| | 40.2.1 Node PC Success Criteria | 40-2 |
| | 40.2.2 Operator Action | 40-2 |
| | 40.2.3 Node PC Failure Probability..... | 40-3 |
| 40.3 | Containment Venting – Node VT | 40-3 |
| | 40.3.1 Venting Success Criteria..... | 40-3 |
| | 40.3.2 Venting Failure Probability..... | 40-4 |
| 40.4 | Intermediate Containment Failure – Node IF | 40-4 |
| | 40.4.1 Success Criterion | 40-5 |
| | 40.4.2 Intermediate Containment Failure Probability | 40-5 |
| 40.5 | References..... | 40-5 |
| CHAPTER 41 HYDROGEN MIXING AND COMBUSTION ANALYSIS | | |
| 41.1 | Discussion of the Issue..... | 41-1 |
| 41.2 | Controlling Phenomena..... | 41-2 |
| 41.3 | Major Assumptions and Phenomenological Uncertainties | 41-3 |
| | 41.3.1 Hydrogen Generation..... | 41-3 |
| | 41.3.2 Containment Pressure | 41-3 |
| | 41.3.3 Flammability Limits..... | 41-3 |
| | 41.3.4 Detonation Limits and Loads..... | 41-4 |
| | 41.3.5 Igniter System | 41-4 |
| | 41.3.6 Other Ignition Sources | 41-5 |
| | 41.3.7 Severe Accident Management Actions | 41-5 |
| 41.4 | Hydrogen Generation and Mixing..... | 41-5 |
| | 41.4.1 Accident Class 3BE – Failure of Gravity Injection..... | 41-6 |
| | 41.4.2 Accident Class 3BL – Failure of Gravity Recirculation..... | 41-9 |
| | 41.4.3 Accident Class 3BR – Large LOCA with Accumulator Failure | 41-10 |
| | 41.4.4 Accident Class 3C..... | 41-11 |
| | 41.4.5 Accident Classes 3D and 1D..... | 41-12 |
| | 41.4.6 Accident Class 1AP | 41-12 |
| | 41.4.7 Accident Class 1A | 41-13 |
| | 41.4.8 Accident Class 3A | 41-13 |
| | 41.4.9 Accident Class 6 | 41-13 |
| | 41.4.10 Overall Mixing Insights | 41-14 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| 41.5 | Hydrogen Burning at Igniters..... | 41-15 |
| 41.6 | Early Hydrogen Combustion..... | 41-15 |
| | 41.6.1 Hydrogen Generation Rates..... | 41-15 |
| | 41.6.2 Hydrogen Release Locations..... | 41-17 |
| | 41.6.3 Early Hydrogen Combustion Ignition Sources..... | 41-18 |
| 41.7 | Diffusion Flame Analysis – CET Node DF..... | 41-18 |
| | 41.7.1 AP1000 Diffusion Flame Mitigation Strategy | 41-19 |
| | 41.7.2 Node DF Containment Failure Probability Assignment..... | 41-20 |
| 41.8 | Early Hydrogen Detonation – Containment Event Tree Node DTE..... | 41-21 |
| | 41.8.1 Containment Success Criteria at Node DTE | 41-21 |
| | 41.8.2 Early Hydrogen Detonation Decomposition Event Tree..... | 41-22 |
| 41.9 | Deflagration in Time Frame 3 | 41-23 |
| | 41.9.1 Containment Success Criterion at Node DFL | 41-23 |
| | 41.9.2 AICC Peak Pressure..... | 41-24 |
| | 41.9.3 Conditional Containment Failure Probability from Deflagration | 41-25 |
| 41.10 | Detonation in Intermediate Time Frame..... | 41-29 |
| | 41.10.1 Containment Success Criterion at Node DTI | 41-29 |
| | 41.10.2 Mixing and Stratification | 41-29 |
| | 41.10.3 Quantification of DTI Failure Probabilities | 41-30 |
| 41.11 | Safety Margin Basis Containment Performance Requirement | 41-30 |
| 41.12 | Summary | 41-31 |
| 41.13 | References..... | 41-31 |
| ATTACHMENT 41A AP1000 SPECIFIC MAAP4.04 ANALYSES | | 41A-1 |
| ATTACHMENT 41B ANALYSIS OF HYDROGEN BURNING AT IGNITERS | | 41B-1 |
| CHAPTER 42 CONDITIONAL CONTAINMENT FAILURE PROBABILITY DISTRIBUTION | | |
| 42.1 | Introduction..... | 42-1 |
| 42.2 | Probabilistic Model | 42-1 |
| 42.3 | Containment Failure Characteristics | 42-2 |
| | 42.3.1 Median Values for Containment Failure..... | 42-2 |
| | 42.3.2 Uncertainties in Containment Failure | 42-3 |
| 42.4 | Containment Failure Predictions | 42-4 |
| | 42.4.1 Containment Cylindrical Shell..... | 42-4 |
| | 42.4.2 Ellipsoidal Upper Head..... | 42-5 |
| | 42.4.3 Equipment Hatches..... | 42-5 |
| | 42.4.4 Personnel Airlock | 42-6 |
| 42.5 | Overall Failure Distribution | 42-6 |
| 42.6 | Summary and Conclusions..... | 42-7 |
| 42.7 | References..... | 42-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| CHAPTER 43 | RELEASE FREQUENCY QUANTIFICATION | |
| 43.1 | Introduction..... | 43-1 |
| 43.2 | Plant Damage State Frequency Calculations..... | 43-2 |
| 43.3 | Containment Event Tree Node Frequencies..... | 43-2 |
| 43.3.1 | CET Nodes | 43-2 |
| 43.3.2 | CET Node Probabilities From Boolean Expressions | 43-3 |
| 43.3.3 | Probabilities for Hydrogen-Related CET Nodes | 43-6 |
| 43.3.4 | Other CET Node Probabilities | 43-6 |
| 43.4 | Containment Event Tree Quantification..... | 43-7 |
| 43.4.1 | Containment Event Tree | 43-7 |
| 43.4.2 | Dominant CET Sequences | 43-7 |
| 43.4.3 | LRF Cutsets for Dominant Sequences | 43-7 |
| 43.5 | Summary of Results | 43-7 |
| 43.6 | Importance and Sensitivity Analyses..... | 43-8 |
| 43.6.1 | CET Event Node Importance Analysis | 43-8 |
| 43.6.2 | No Credit Taken for DP Node for PDS-6 | 43-8 |
| 43.6.3 | Lesser Reliability for Containment Isolation..... | 43-8 |
| 43.6.4 | Lesser Reliability for Hydrogen Igniters | 43-8 |
| 43.6.5 | Lesser Reliability for PCS..... | 43-9 |
| 43.6.6 | No Credit for Depressurization for High Pressure PDS | 43-9 |
| 43.6.7 | Set PDS-3C Vessel Failure Probability to 1.0..... | 43-9 |
| 43.6.8 | Set 3D and 1AP Diffusion Flame and Detonation Failure Probability to 1.0 | 43-9 |
| 43.7 | Other Importance and Sensitivity Analyses..... | 43-9 |
| 43.7.1 | Initiating Event Importances | 43-9 |
| 43.7.2 | Sensitivity to Standby Systems | 43-10 |
| 43.7.3 | Sensitivity to Standby Systems With Credit for Manual DAS | 43-10 |
| 43.7.4 | Treatment of PCS Annulus Drain Plugging in the AP1000 PRA | 43-10 |
| 43.8 | Conclusions and Insights..... | 43-11 |
| ATTACHMENT 43A | PDS CALCULATIONS | 43A-1 |
| ATTACHMENT 43B | DP NODE PROBABILITY FOR PDS..... | 43B-1 |
| ATTACHMENT 43C | EVALUATION OF OPERATOR ACTIONS..... | 43C-1 |
| ATTACHMENT 43D | EFFECT OF "PRE-EXISTING CONTAINMENT OPENING" ON LRF..... | 43D-1 |
| ATTACHMENT 43E | EFFECT OF CONTAINMENT AIR-COOLING FAILURE ON PLANT RISK | 43E-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 44 MAAP4 CODE DESCRIPTION AND AP1000 MODELING | | |
| 44.0 | MAAP Background..... | 44-1 |
| 44.1 | MAAP4..... | 44-1 |
| 44.2 | The AP1000 MAAP4 Modeling..... | 44-3 |
| 44.3 | Benchmarking..... | 44-5 |
| 44.4 | Summary and Conclusions..... | 44-6 |
| 44.5 | References..... | 44-7 |
| CHAPTER 45 FISSION-PRODUCT SOURCE TERMS | | |
| 45.1 | Summary of AP1000 Release Categories..... | 45-1 |
| 45.2 | Release Category Source Terms..... | 45-2 |
| 45.2.1 | Release Category IC..... | 45-2 |
| 45.2.2 | Release Category BP..... | 45-2 |
| 45.2.3 | Release Category CI..... | 45-2 |
| 45.2.4 | Release Category CFE..... | 45-3 |
| 45.2.5 | Release Category CFI..... | 45-3 |
| 45.2.6 | Release Category CFL..... | 45-3 |
| 45.2.7 | Release Category CFV..... | 45-4 |
| 45.3 | Direct-Release Sensitivity Case..... | 45-4 |
| 45.4 | Summary..... | 45-4 |
| 45.5 | References..... | 45-4 |
| CHAPTERS 46 THROUGH 48 NOT USED | | |
| CHAPTER 49 OFFSITE DOSE RISK QUANTIFICATION | | |
| 49.1 | Introduction..... | 49-1 |
| 49.2 | Conformance with Regulatory Requirements..... | 49-2 |
| 49.3 | Assumptions..... | 49-2 |
| 49.4 | Methodology..... | 49-2 |
| 49.5 | Dose Evaluation Results and Discussion..... | 49-5 |
| 49.6 | Quantification of Site Risk..... | 49-6 |
| 49.7 | Risk Quantification Results..... | 49-7 |
| 49.8 | References..... | 49-7 |
| CHAPTER 50 IMPORTANCE AND SENSITIVITY ANALYSES | | |
| 50.1 | Introduction..... | 50-1 |
| 50.2 | Importance Analyses for Core Damage..... | 50-1 |
| 50.2.1 | Initiating Event Importances..... | 50-2 |
| 50.2.2 | Accident Sequence Importances..... | 50-3 |
| 50.2.3 | End State Importances..... | 50-4 |
| 50.2.4 | Common Cause Failure Importances..... | 50-4 |
| 50.2.5 | Human Error Importances..... | 50-5 |
| 50.2.6 | Component Importances..... | 50-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|--------------|
| 50.3 | System Importances for Core Damage | 50-7 |
| 50.4 | Human Error Sensitivity Analyses | 50-8 |
| 50.4.1 | Set HEPs to 1.0 (Failure) in Core Damage Output File | 50-9 |
| 50.4.2 | Set HEPs to 0.0 (Success) in Core Damage Output File..... | 50-10 |
| 50.4.3 | Set HEPs to 0.1 in Core Damage Output File..... | 50-10 |
| 50.5 | Other Sensitivity Analyses for Core Damage | 50-10 |
| 50.5.1 | Impact of Passive System Check Valves on Core Damage Frequency | 50-10 |
| 50.5.2 | Sensitivity to Squib Valve Failure Probability | 50-11 |
| 50.5.3 | Sensitivity to Circuit Breaker Failure Probability | 50-11 |
| 50.5.4 | Sensitivity to Standby Systems | 50-12 |
| 50.5.5 | Sensitivity to Standby Systems; Manual DAS Credited..... | 50-14 |
| 50.6 | Results..... | 50-15 |
| CHAPTER 51 UNCERTAINTY ANALYSIS | | |
| 51.1 | Introduction..... | 51-1 |
| 51.2 | Input Data/Error Factors..... | 51-2 |
| 51.3 | Input Files | 51-3 |
| 51.4 | Output Files..... | 51-3 |
| 51.5 | Sensitivity Analyses | 51-3 |
| 51.5.1 | Sensitivity to Simulation Parameters..... | 51-3 |
| 51.5.2 | Sensitivity to Key Basic Events | 51-3 |
| 51.5.3 | Sensitivity to Operator Actions | 51-4 |
| 51.6 | Summary of Results | 51-6 |
| 51.7 | References..... | 51-8 |
| ATTACHMENT 51A ASSIGNMENT OF ERROR FACTORS TO BASIC EVENT PROBABILITIES..... | | |
| | | 51A-1 |
| ATTACHMENT 51B @RISK UNCERTAINTY ANALYSIS RESULTS | | |
| | | 51B-1 |
| CHAPTERS 52 AND 53 NOT USED | | |
| CHAPTER 54 LOW-POWER AND SHUTDOWN RISK ASSESSMENT | | |
| 54.1 | Introduction..... | 54-1 |
| 54.2 | Data Analysis | 54-2 |
| 54.3 | Initiating Event Analysis | 54-3 |
| 54.4 | Event Tree/Mitigation System Evaluation..... | 54-3 |
| 54.5 | Common Cause Analysis Update for AP1000 | 54-3 |
| 54.6 | Human Reliability Assessment for AP1000..... | 54-5 |
| 54.7 | Core Damage Quantification..... | 54-6 |
| 54.7.1 | Discussion of Results..... | 54-9 |
| 54.8 | Estimation of Shutdown Large Release Frequency | 54-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 54.9 | Sensitivity Analyses | 54-10 |
| 54.9.1 | Case 1 – Minimum Equipment per Tech Specs During Drained Conditions | 54-10 |
| 54.9.2 | Case 2 – No Credit for Standby Nonsafety Systems | 54-11 |
| 54.9.3 | Case 3 – HEPs Set Equal to 0.5 | 54-12 |
| 54.9.4 | Case 4 – No Credit for Standby Nonsafety Systems – Credit for Manual DAS | 54-12 |
| 54.9.5 | Case 5 – Assessment of Containment Closure Failure Probability | 54-13 |
| 54.10 | Conclusions | 54-17 |
| 54.11 | Reference | 54-17 |
| CHAPTER 55 | AP1000 SEISMIC MARGINS EVALUATION | |
| 55.1 | Seismic Margin HCLPF Methodology | 55-1 |
| 55.2 | Calculation of HCLPF Values | 55-1 |
| 55.2.1 | Seismic Margin HCLPF Methodology | 55-1 |
| 55.2.2 | Calculation of HCLPF Values | 55-2 |
| 55.3 | Seismic Margin Model | 55-11 |
| 55.3.1 | Major SMA Model Assumptions | 55-11 |
| 55.3.2 | Seismic Initiating Events | 55-12 |
| 55.3.3 | Initiating Event Category HCLPFs | 55-13 |
| 55.4 | Calculation of Plant HCLPF | 55-16 |
| 55.4.1 | HCLPFs for Basic Events | 55-16 |
| 55.4.2 | Calculation of Initiating Event HCLPFs | 55-17 |
| 55.5 | Results and Insights | 55-17 |
| 55.5.1 | AP1000 SMA Results | 55-17 |
| 55.5.2 | AP1000 SMA Insights | 55-18 |
| 55.6 | References | 55-20 |
| CHAPTER 56 | INTERNAL FLOODING ANALYSIS | |
| 56.1 | Introduction | 56-1 |
| 56.1.1 | Definitions | 56-1 |
| 56.2 | Methodology | 56-1 |
| 56.2.1 | Summary of Methodology | 56-1 |
| 56.2.2 | Information Collection | 56-2 |
| 56.2.3 | Initial Screening Assessment | 56-2 |
| 56.2.4 | Detailed Screening Assessment | 56-4 |
| 56.2.5 | Identification of Flood-Induced Initiating Events | 56-5 |
| 56.2.6 | Initiating Event Frequencies | 56-6 |
| 56.3 | Assumptions | 56-6 |
| 56.3.1 | General Flooding Analysis Assumptions and Engineering Judgments | 56-6 |
| 56.3.2 | AP1000-Specific Assumptions | 56-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 56.4 | Information Collection | 56-10 |
| 56.4.1 | PRA-Modeled Equipment and Locations | 56-10 |
| 56.4.2 | Identification of Areas for Flooding Evaluation..... | 56-10 |
| 56.5 | At-Power Operations..... | 56-10 |
| 56.5.1 | Initial Screening Assessment | 56-11 |
| 56.5.2 | Detailed Screening Assessment | 56-11 |
| 56.5.3 | Identification of Flood-Induced Initiating Events | 56-26 |
| 56.5.4 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-29 |
| 56.5.5 | Quantification of At-Power Flood-Induced Events..... | 56-36 |
| 56.6 | Internal Flooding During Low-Power and Shutdown Conditions..... | 56-38 |
| 56.6.1 | Detailed Screening Assessment | 56-38 |
| 56.6.2 | Identification of Flood-Induced Initiating Events | 56-39 |
| 56.6.3 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-40 |
| 56.6.4 | Quantification of Shutdown Internal Flooding Scenario CDFs | 56-45 |
| 56.6.5 | Total Shutdown Flooding Core Damage Frequency | 56-47 |
| 56.6.6 | Seismically Induced Flooding..... | 56-47 |
| 56.6.7 | Flooding Hazards During Refueling Outages | 56-47 |
| 56.6.8 | Summary of Results | 56-47 |
| 56.7 | Large Release Frequency Estimates for Internal Flooding | 56-48 |
| 56.8 | Results of AP1000 Internal Flooding Analysis | 56-49 |
| | | |
| CHAPTER 57 FIRE RISK ASSESSMENT | | |
| 57.1 | Introduction..... | 57-1 |
| 57.2 | Qualitative Analysis | 57-1 |
| 57.2.1 | AP600 Qualitative Analysis..... | 57-1 |
| 57.2.2 | AP1000 Qualitative Analysis..... | 57-5 |
| 57.2.3 | AP1000 Fire Areas | 57-6 |
| 57.3 | Initiating Event Frequencies..... | 57-6 |
| 57.3.1 | Introduction..... | 57-6 |
| 57.3.2 | Methodology..... | 57-7 |
| 57.3.3 | Results for Plant Except Containment and the Main Control Room..... | 57-7 |
| 57.3.4 | Results for the Containment..... | 57-7 |
| 57.3.5 | Results for the Main Control Room | 57-7 |
| 57.4 | Development of Fire Scenarios | 57-10 |
| 57.4.1 | Spurious Actuation Model | 57-11 |
| 57.4.2 | Propagation Model..... | 57-14 |
| 57.4.3 | Fire Suppression Model..... | 57-15 |
| 57.4.4 | Operation Actions | 57-15 |
| 57.4.5 | Development of Fire Scenarios..... | 57-16 |
| 57.5 | Calculation of Conditional Core Damage Probabilities (CCDP)..... | 57-22 |
| 57.6 | Calculation of CDF from Fire Events | 57-23 |
| 57.6.1 | Calculation of Plant Fire CDF | 57-23 |
| 57.6.2 | Comments on Plant Areas..... | 57-23 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| | 57.6.3 Importances of Fire Areas..... | 57-25 |
| | 57.6.4 Conclusion | 57-27 |
| 57.7 | Sensitivity Studies | 57-27 |
| | 57.7.1 Manual Fire Suppression Systems | 57-27 |
| | 57.7.2 Sensitivity Analysis of the Probability of a Spurious Actuation of ADS Valves..... | 57-27 |
| | 57.7.3 Sensitivity of Human Action on Fire | 57-28 |
| | 57.7.4 Sensitivity Analysis on Ignition Frequencies | 57-28 |
| | 57.7.5 Sensitivity Analysis on ADS Actuation by DAS | 57-29 |
| | 57.7.6 Sensitivity Analysis on 1E to Non-1E Separation in the Containment..... | 57-29 |
| | 57.7.7 Sensitivity Analysis to Area to Area Propagation | 57-30 |
| | 57.7.8 Importance of Hot Shorts | 57-30 |
| 57.8 | Shutdown Fire Analysis | 57-30 |
| | 57.8.1 Introduction..... | 57-30 |
| | 57.8.2 Evaluation of AP1000 Shutdown Risk (Non-Drained Conditions)..... | 57-33 |
| | 57.8.3 Evaluation for Drained Shutdown Operations | 57-37 |
| | 57.8.4 Evaluation of Main Control Room..... | 57-40 |
| 57.9 | Conclusion and Insights | 57-40 |
| | 57.9.1 At-Power Analysis | 57-40 |
| | 57.9.2 Shutdown Fire Analysis..... | 57-41 |
| | 57.9.3 Conclusions..... | 57-42 |
| 57.10 | References..... | 57-42 |
| ATTACHMENT 57A CALCULATION OF SCENARIO CCDPs | | 57A-1 |
| | 57A.1 Calculation of Scenario CCDPs | 57A-1 |
| | 57A.2 Calculation of Scenario CCDPs for Overly Conservative Cases | 57A-3 |
| ATTACHMENT 57B MODELING OF OPERATOR ACTIONS IN FIRE SCENARIOS | | 57B-1 |
| | 57B.1 Calculation of Failure Probability of OPA-01 | 57B-1 |
| | 57B.2 Calculation of Failure Probability of OPA-02 | 57B-3 |
| | 57B.3 Operator Actions at Remote Shutdown Panel | 57B-6 |
| | 57B.4 More Reliable REC-MANDAS | 57B-6 |
| ATTACHMENT 57C FIRE AREA EVENT TREES DEFINING SCENARIOS | | 57C-1 |
| ATTACHMENT 57D AP1000 POTENTIAL FOR FIRE-INDUCED SPURIOUS ACTUATION OF FUNCTIONS THAT RESULT IN A BREACH OF HIGH/LOW PRESSURE BOUNDARY | | 57D-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 58 WINDS, FLOODS, AND OTHER EXTERNAL EVENTS | | |
| 58.1 | Introduction..... | 58-1 |
| 58.2 | External Events Analysis..... | 58-1 |
| | 58.2.1 Severe Winds and Tornadoes..... | 58-1 |
| | 58.2.2 External Floods..... | 58-2 |
| | 58.2.3 Transportation and Nearby Facility Accidents..... | 58-2 |
| 58.3 | Conclusion..... | 58-2 |
| 58.4 | References..... | 58-3 |
| CHAPTER 59 PRA RESULTS AND INSIGHTS | | |
| 59.1 | Introduction..... | 59-1 |
| 59.2 | Use of PRA in the Design Process..... | 59-3 |
| 59.3 | Core Damage Frequency from Internal Initiating Events at Power..... | 59-4 |
| | 59.3.1 Dominant Core Damage Sequences..... | 59-6 |
| | 59.3.2 Component Importances for At-Power Core Damage Frequency..... | 59-7 |
| | 59.3.3 System Importances for At-Power Core Damage..... | 59-8 |
| | 59.3.4 System Failure Probabilities for At-Power Core Damage..... | 59-9 |
| | 59.3.5 Common Cause Failure Importances for At-Power Core Damage..... | 59-9 |
| | 59.3.6 Human Error Importances for At-Power Core Damage..... | 59-9 |
| | 59.3.7 Accident Class Importances..... | 59-10 |
| | 59.3.8 Sensitivity Analyses Summary for At-Power Core Damage..... | 59-11 |
| | 59.3.9 Summary of Important Level 1 At-Power Results..... | 59-12 |
| 59.4 | Large Release Frequency for Internal Initiating Events at Power..... | 59-15 |
| | 59.4.1 Dominant Large Release Frequency Sequences..... | 59-15 |
| | 59.4.2 Summary of Important Level 2 At-Power Results..... | 59-16 |
| 59.5 | Core Damage and Severe Release Frequency from Events at Shutdown..... | 59-19 |
| | 59.5.1 Summary of Shutdown Level 1 Results..... | 59-19 |
| | 59.5.2 Large Release Frequency for Shutdown and Low-Power Events..... | 59-22 |
| | 59.5.3 Shutdown Results Summary..... | 59-22 |
| 59.6 | Results from Internal Flooding, Internal Fire, and Seismic Margin Analyses..... | 59-23 |
| | 59.6.1 Results of Internal Flooding Assessment..... | 59-23 |
| | 59.6.2 Results of Internal Fire Assessment..... | 59-24 |
| | 59.6.3 Results of Seismic Margin Analysis..... | 59-25 |
| 59.7 | Plant Dose Risk From Release of Fission-Products..... | 59-26 |
| 59.8 | Overall Plant Risk Results..... | 59-26 |
| 59.9 | Plant Features Important to Reducing Risk..... | 59-27 |
| | 59.9.1 Reactor Design..... | 59-28 |
| | 59.9.2 Systems Design..... | 59-28 |
| | 59.9.3 Instrumentation and Control Design..... | 59-31 |
| | 59.9.4 Plant Layout..... | 59-32 |
| | 59.9.5 Containment Design..... | 59-32 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 59.10 | PRA Input to Design Certification Process | 59-36 |
| 59.10.1 | PRA Input to Reliability Assurance Program | 59-36 |
| 59.10.2 | PRA Input to Tier 1 Information..... | 59-36 |
| 59.10.3 | PRA Input to MMI/Human Factors/Emergency Response Guidelines | 59-36 |
| 59.10.4 | Summary of PRA Based Insights..... | 59-37 |
| 59.10.5 | Combined License Information..... | 59-37 |
| 59.11 | References..... | 59-38 |
| APPENDIX A | THERMAL HYDRAULIC ANALYSIS TO SUPPORT SUCCESS CRITERIA | A-1 |
| APPENDIX B | EX-VESSEL SEVERE ACCIDENT PHENOMENA | B-1 |
| APPENDIX C | ADDITIONAL ASSESSMENT OF AP1000 DESIGN FEATURES..... | C-1 |
| APPENDIX D | EQUIPMENT SURVIVABILITY ASSESSMENT..... | D-1 |
| APPENDIX E | AP1000 PRA FAULT TREE PICTURES FOR LEVEL 1 ANALYSIS FOR EVENTS AT POWER OPERATION | E-1 |

LIST OF TABLES

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 2-1 | Internal Initiating Event Grouping Plant Systems and Equipment Available for Transient/Accident Conditions (Sheets 1 – 10)..... | 2-28 |
| 2-2 | NUREG/CR 3862 Initiator Categories (Sheets 1 – 4)..... | 2-38 |
| 2-3 | NUREG/CR 3862 Initiator Categories not Considered in the AP1000 PRA Analysis..... | 2-42 |
| 2-4 | AP1000 Internal Initiating Event Frequencies (Sheets 1 – 3) | 2-43 |
| 2-5 | Initiating Event Frequencies Used in Event Trees Quantification..... | 2-46 |
| 2A-1 | Summary of Primary System Piping Data | 2A-2 |
| 2A-2 | Summary of Primary System Pipe Break Frequency Quantification | 2A-3 |
| 2A-3 | Summary of Steam Generator Tube Rupture Events..... | 2A-4 |
| 2A-4 | Spurious Stuck-Open Pressurizer Safety Valve..... | 2A-5 |
| 2A-5 | Interface Break on Accumulator Lines..... | 2A-6 |
| 2A-6 | Interface Break on IRWST Injection Lines..... | 2A-7 |
| 2A-7 | Initiating Events Review Data Summary (Sheets 1 – 8)..... | 2A-8 |
| 2B-1 | Summary of Main Steam Line and Feedwater Line Piping Data for Secondary Side Break Frequency Quantification..... | 2B-2 |
| 2B-2 | Secondary Side Line Break Frequency Quantification..... | 2B-3 |
| 2B-3 | Stuck-Open Main Steam Line Safety Valve Frequency Quantification (Sheets 1 – 2) | 2B-4 |
| 3-1 | Loss of CCS/SWS Initiating Event Fault Tree CSWF Success Criteria Summary | 3-8 |
| 3-2 | Spurious Actuation of Automatic Depressurization Failure Criteria Summary | 3-9 |
| 3-3 | Evaluation of Spurious Automatic Depressurization System Frequencies (Sheets 1 – 6) | 3-10 |
| 4-1 | AP1000 Large LOCA Event End State Summary..... | 4-112 |
| 4-2 | AP1000 Spurious ADS Actuation Event End State Summary..... | 4-112 |
| 4-3 | AP1000 Medium LOCA Event End State Summary | 4-113 |
| 4-4 | AP1000 CMT Line Break LOCA Event End State Summary..... | 4-114 |
| 4-5 | AP1000 SI Line Break Event End State Summary | 4-115 |
| 4-6 | AP1000 Small LOCA Event End State Summary..... | 4-116 |
| 4-7 | AP1000 RCS Leak Event End State Summary | 4-117 |
| 4-8 | AP1000 PRHR Tube Rupture Event End State Summary | 4-117 |
| 4-9 | AP1000 SGTR Event End State Summary | 4-118 |
| 4-10 | AP1000 Vessel Rupture Event End State Summary | 4-119 |
| 4-11 | AP1000 Interfacing Systems LOCA Event End State Summary..... | 4-119 |
| 4-12 | AP1000 Transients with MFW Event End State Summary..... | 4-120 |
| 4-13 | AP1000 Transients with Loss of RCS Flow Event End State Summary..... | 4-121 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 4-14 | AP1000 Transients with Loss of MFW to One SG Event End State Summary | 4-122 |
| 4-15 | AP1000 Transients with Core Power Excursion Event End State Summary | 4-123 |
| 4-16 | AP1000 Transients with Loss of CCW/SW Event End State Summary | 4-124 |
| 4-17 | AP1000 Transients without Main Feedwater Event End State Summary | 4-125 |
| 4-18 | AP1000 Transients with Loss of Condenser Event End State Summary..... | 4-126 |
| 4-19 | AP1000 Transients with Loss of Compressed Air Event End State Summary..... | 4-127 |
| 4-20 | AP1000 Loss of Offsite Power Event End State Summary..... | 4-128 |
| 4-21 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-129 |
| 4-22 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-130 |
| 4-23 | AP1000 Stuck Open Secondary Side Safety Valve Event End State Summary..... | 4-131 |
| 4-24 | AP1000 ATWS Precursor without MFW Event End State Summary..... | 4-132 |
| 4-25 | AP1000 ATWS Precursor with SI Event End State Summary..... | 4-133 |
| 4-26 | AP1000 ATWS Precursor Transients with MFW Event End State Summary | 4-134 |
| 4A-1 | End States (Plant Damage States) | 4A-17 |
| 4A-2 | Summary of Systems Associated with Mitigating Functions for AP1000..... | 4A-18 |
| 5-1 | AP1000 Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-2 | AP1000 Non Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-3 | AP1000 Support Systems Interdependency Matrix (Sheets 1 – 14)..... | 5-4 |
| 5-4 | AP1000 Safety-Related Front Line Plant Systems Letter Designators..... | 5-18 |
| 5-5 | AP1000 Non Safety-Related Front Line Plant Systems Letter Designators | 5-18 |
| 5-6 | AP1000 Front Line System Dependencies Matrix (Sheets 1 – 18) | 5-19 |
| 6-1 | Summary of Event Tree Top Events Success Criteria (Internal Initiating Events at Power Cases) (Sheets 1 – 34) | 6-20 |
| 6-2 | Summary of Success Criteria for the Mitigating Systems (Sheets 1 – 9) | 6-54 |
| 6-3 | Summary of Success Criteria for Operator Actions and Mission Times (Sheets 1 – 4) | 6-68 |
| 7-1 | Example for Fault Tree XXX Success Criteria Summary | 7-15 |
| 7-2 | Example for System Dependency Matrix | 7-15 |
| 7-3 | Example for Component Test Assumptions | 7-16 |
| 7-4 | Example for Component Maintenance Assumptions | 7-16 |
| 7-5 | Example for Operator Actions and Misposition Analysis Summary | 7-16 |
| 7-6 | Fault Tree Identification Codes (Sheets 1 – 3) | 7-17 |
| 7-7 | System Identification Codes for Basic Events (Sheets 1 – 3)..... | 7-20 |
| 7-8 | Component Identification Codes (Sheets 1 – 7)..... | 7-23 |
| 7-9 | Failure Mode Identification Codes (Sheets 1 – 3)..... | 7-30 |
| 8-1 | List of Passive Residual Heat Removal System Fault Trees | 8-7 |
| 8-2a | Fault Tree “PRT” Success Criteria..... | 8-8 |
| 8-2b | Fault Tree “PRTA” Success Criteria..... | 8-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 8-2c | Fault Tree "PRL" Success Criteria..... | 8-10 |
| 8-2d | Fault Tree "PRP" Success Criteria..... | 8-11 |
| 8-2e | Fault Tree "PRS" Success Criteria..... | 8-12 |
| 8-2f | Fault Tree "PRW" Success Criteria..... | 8-13 |
| 8-2g | Fault Tree "PRI" Success Criteria..... | 8-14 |
| 8-3 | System Dependency Matrix..... | 8-15 |
| 8-4 | Component Test Assumptions..... | 8-16 |
| 8-5 | Component Maintenance Assumptions..... | 8-17 |
| 8-6 | Operator Actions and Misposition Analysis Summary..... | 8-18 |
| 8-7 | Common Cause Failures Summary..... | 8-19 |
| 8-8 | Basic Events Database for the PRHR System Fault Trees (Sheets 1 – 3)..... | 8-20 |
| 9-1 | List of System Fault Trees..... | 9-9 |
| 9-2a | Fault Tree CM2AB Success Criteria Summary..... | 9-10 |
| 9-2b | Fault Tree CM2SL Success Criteria Summary..... | 9-11 |
| 9-2c | Fault Tree CM2L Success Criteria Summary..... | 9-12 |
| 9-2d | Fault Tree CM2P Success Criteria Summary..... | 9-13 |
| 9-2e | Fault Tree CM1A Success Criteria Summary..... | 9-14 |
| 9-2f | Fault Tree CM2LLT Success Criteria Summary..... | 9-15 |
| 9-2g | Fault Tree CMBOTH Success Criteria Summary..... | 9-16 |
| 9-2h | Fault Tree CM2LA Success Criteria Summary..... | 9-17 |
| 9-3 | Notes Related to System Fault Tree Assumptions..... | 9-18 |
| 9-4 | System Dependency Matrix..... | 9-18 |
| 9-5 | Component Test Assumptions..... | 9-19 |
| 9-6 | Component Maintenance Assumptions..... | 9-19 |
| 9-7 | Operator Actions and Misposition Analysis Summary..... | 9-20 |
| 9-8 | Common Cause Failure Analysis Summary..... | 9-20 |
| 9-9 | Fault Tree Basic Events for Core Makeup Tank Subsystem (Sheets 1 – 3)..... | 9-21 |
| 10-1 | List of System Fault Trees..... | 10-5 |
| 10-2a | Fault Tree AC2AB Success Criteria Summary..... | 10-6 |
| 10-2b | Fault Tree AC1A Success Criteria Summary..... | 10-7 |
| 10-2c | Fault Tree ACBOTH Success Criteria Summary..... | 10-8 |
| 10-3 | Notes Related to System Fault Tree Assumptions..... | 10-9 |
| 10-4 | System Dependency Matrix..... | 10-9 |
| 10-5 | Component Test Assumptions..... | 10-9 |
| 10-6 | Component Maintenance Assumptions..... | 10-10 |
| 10-7 | Operator Actions and Misposition Analysis Summary..... | 10-10 |
| 10-8 | Common Cause Failure Analysis Summary..... | 10-10 |
| 10-9 | Fault Tree Basic Events for Accumulator Subsystem..... | 10-11 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 11-1a | List of ADS System Fault Trees (Sheets 1 – 2)..... | 11-8 |
| 11-1b | List of ADS System Fault Trees (for Plant Damage States Analysis)..... | 11-10 |
| 11-2a | ADS Success Criteria Versus Accident Conditions (Full Depressurization)..... | 11-11 |
| 11-2b | ADS Success Criteria Versus Accident Conditions (Partial Depressurization)..... | 11-12 |
| 11-2c | Automatic Depressurization System Fault Tree Summary (For Plant Damage States)..... | 11-13 |
| 11-2d | Fault Tree “ADA” Success Criteria | 11-13 |
| 11-2e | Fault Tree “ADAB” Success Criteria..... | 11-14 |
| 11-2f | Fault Tree “ADAL” Success Criteria..... | 11-15 |
| 11-2g | Fault Tree “ADB” Success Criteria..... | 11-15 |
| 11-2h | Fault Tree “ADL” Success Criteria..... | 11-16 |
| 11-2i | Fault Tree “ADM” Success Criteria..... | 11-16 |
| 11-2j | Fault Tree “ADMA” Success Criteria..... | 11-17 |
| 11-2k | Fault Tree “ADQ” Success Criteria | 11-17 |
| 11-2l | Fault Tree “ADS” Success Criteria | 11-18 |
| 11-2m | Fault Tree “ADT” Success Criteria..... | 11-18 |
| 11-2n | Fault Tree “ADW” Success Criteria..... | 11-19 |
| 11-2o | Fault Tree “AD1” Success Criteria | 11-19 |
| 11-2p | Fault Tree “AD1A” Success Criteria | 11-20 |
| 11-2q | Fault Tree “ADF” Success Criteria | 11-20 |
| 11-2r | Fault Tree “ADR” Success Criteria..... | 11-21 |
| 11-2s | Fault Tree “ADRA” Success Criteria..... | 11-21 |
| 11-2t | Fault Tree “ADU” Success Criteria | 11-22 |
| 11-2u | Fault Tree “ADUM” Success Criteria..... | 11-22 |
| 11-2v | Fault Tree “ADV” Success Criteria | 11-23 |
| 11-2w | Fault Tree “ADZ” Success Criteria..... | 11-23 |
| 11-2x | Fault Tree “ADQLT” Data Summary | 11-24 |
| 11-2y | Fault Tree “ADTLT” Success Criteria..... | 11-24 |
| 11-3 | Notes Related to ADS System Fault Tree Assumptions..... | 11-25 |
| 11-4 | System Dependencies Matrix | 11-26 |
| 11-5 | Component Test Assumptions..... | 11-27 |
| 11-6 | Component Maintenance Assumptions..... | 11-27 |
| 11-7 | Failure Probabilities Calculated | 11-27 |
| 11-8 | Operator Action Analysis Summary..... | 11-28 |
| 11-9 | Common Cause Failures Summary | 11-28 |
| 11-10 | Basic Events Data Base for the ADA System Fault Tree (Sheets 1 – 20)..... | 11-29 |
| 12-1 | List of System Fault Trees (FT) | 12-10 |
| 12-2a | Fault Tree “IW2AB” Success Criteria Summary | 12-11 |
| 12-2b | Fault Tree “IW2ABM” Success Criteria Summary..... | 12-12 |
| 12-2c | Fault Tree “IW2ABA” Success Criteria Summary | 12-13 |
| 12-2d | Fault Tree “IW2ABP” Success Criteria Summary..... | 12-14 |
| 12-2e | Fault Tree “IW2ABPM” Success Criteria Summary..... | 12-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 12-2f | Fault Tree "IW2ABB" Success Criteria Summary..... | 12-16 |
| 12-2g | Fault Tree "IW2ABBM" Success Criteria Summary | 12-17 |
| 12-2h | Fault Tree "IW1A" Success Criteria Summary | 12-18 |
| 12-2i | Fault Tree "IW1AM" Success Criteria Summary | 12-19 |
| 12-2j | Fault Tree "IWF" Success Criteria Summary..... | 12-20 |
| 12-2k | Fault Tree "RECIRC" Success Criteria Summary | 12-21 |
| 12-2l | Fault Tree "RECIRCP" Success Criteria Summary | 12-22 |
| 12-2m | Fault Tree "RECIRCB" Success Criteria Summary..... | 12-23 |
| 12-2n | Fault Tree "RECIRC1" Success Criteria Summary | 12-24 |
| 12-2o | Fault Tree "RECIRC1P" Success Criteria Summary | 12-25 |
| 12-2p | Fault Tree "RECIRC1B" Success Criteria Summary..... | 12-26 |
| 12-3 | System Dependency Matrix | 12-27 |
| 12-4 | Component Test Assumptions..... | 12-28 |
| 12-5 | Component Maintenance Assumptions..... | 12-28 |
| 12-6 | Failure Probabilities Calculated | 12-29 |
| 12-7 | Operator Actions and Misposition Analysis Summary..... | 12-29 |
| 12-8 | Common Cause Failure Analysis Summary | 12-30 |
| 12-9 | Fault Tree Basic Events (Sheets 1 – 11)..... | 12-31 |
| 13-1 | List of System Fault Trees..... | 13-7 |
| 13-2 | Fault Tree PCT Success Criteria Summary | 13-7 |
| 13-3 | Notes Related to System Fault Trees Assumptions | 13-7 |
| 13-4 | System Dependency Matrix | 13-8 |
| 13-5 | Component Test Assumptions..... | 13-8 |
| 13-6 | Component Maintenance Assumptions | 13-9 |
| 13-7 | Operator Actions and Misposition Analysis Summary..... | 13-9 |
| 13-8 | Common Cause Failure Analysis Summary | 13-9 |
| 13-9 | Fault Tree Basic Events for Passive Containment Cooling System..... | 13-10 |
| 14-1 | List of System Fault Trees (At-Power)..... | 14-8 |
| 14-2.a | Success Criteria Summary Fault Tree "FWT" | 14-9 |
| 14-2.b | Success Criteria Summary Fault Tree "FWF"..... | 14-10 |
| 14-2.c | Success Criteria Summary Fault Tree "SFWT" | 14-11 |
| 14-2.d | Success Criteria Summary Fault Tree "SFW" | 14-12 |
| 14-2.e | Success Criteria Summary Fault Tree "SFW1" | 14-13 |
| 14-2.f | Success Criteria Summary Fault Tree "SFWP" | 14-14 |
| 14-2.g | Success Criteria Summary Fault Tree "SFWM" | 14-15 |
| 14-2.h | Success Criteria Summary Fault Tree "SFWA" | 14-16 |
| 14-2.i | Success Criteria Summary Fault Tree "COND"..... | 14-17 |
| 14-2.j | Success Criteria Summary Fault Tree "COND1"..... | 14-18 |
| 14-2.k | Success Criteria Summary Fault Tree "CDS"..... | 14-19 |
| 14-2.l | Success Criteria Summary Fault Tree "TCCW" | 14-20 |
| 14-3 | Notes to System Fault Tree Assumptions..... | 14-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 14-4 | System Dependency Matrix (Sheets 1 – 2)..... | 14-22 |
| 14-5 | Component Test Assumptions..... | 14-24 |
| 14-6 | Component Maintenance Assumptions..... | 14-25 |
| 14-7 | Failure Probabilities Calculated in this Section..... | 14-25 |
| 14-8 | Operator Action Analysis Summary..... | 14-26 |
| 14-9 | Common Cause Failure (CCF) Summary..... | 14-27 |
| 14-10 | Fault Tree Basic Event for Main and Startup Feedwater System (Sheets 1 – 9)..... | 14-28 |
| 15-1 | List of System Fault Trees..... | 15-9 |
| 15-2a | Fault Tree CSBOR1 Success Criteria Summary | 15-10 |
| 15-2b | Fault Tree CVS1 Success Criteria Summary..... | 15-11 |
| 15-2c | Fault Tree CSAX Success Criteria Summary..... | 15-12 |
| 15-2d | Fault Tree SGHL Success Criteria Summary..... | 15-13 |
| 15-2e | Fault Tree CSP Success Criteria Summary | 15-14 |
| 15-3 | Notes Related to System Fault Tree Assumptions..... | 15-15 |
| 15-4 | System Dependency Matrix | 15-16 |
| 15-5 | Component Test Assumptions..... | 15-17 |
| 15-6 | Component Maintenance Assumptions | 15-18 |
| 15-7 | Operator Actions and Misposition Analysis Summary..... | 15-19 |
| 15-8 | Common Cause Failure Analysis Summary..... | 15-20 |
| 15-9 | Fault Tree Basic Events for Chemical and Volume Control System (Sheets 1 – 4)..... | 15-21 |
| 16-1 | List of System Fault Trees..... | 16-5 |
| 16-2 | Fault Tree VLH Success Criteria Summary | 16-5 |
| 16-3 | Notes Related to System Fault Tree Assumptions..... | 16-5 |
| 16-4 | System Dependency Matrix | 16-6 |
| 16-5 | Component Test Assumptions..... | 16-6 |
| 16-6 | Component Maintenance Assumptions | 16-6 |
| 16-7 | Operator Actions and Misposition Analysis Summary..... | 16-7 |
| 16-8 | Common Cause Failure Analysis Summary..... | 16-7 |
| 16-9 | Fault Tree Basic Events for Containment Hydrogen Control System | 16-8 |
| 17-1 | List of System Fault Trees..... | 17-7 |
| 17-2 | Fault Tree Success Criteria Summary (Sheets 1 – 2) | 17-8 |
| 17-3 | Notes Related to System Fault Tree Assumptions..... | 17-10 |
| 17-4 | System Dependencies Matrix..... | 17-11 |
| 17-5 | Component Test Assumptions..... | 17-12 |
| 17-6 | Component Maintenance Assumptions | 17-12 |
| 17-7 | Operator Actions and System Misposition Analysis Summary | 17-13 |
| 17-8 | Common Cause Failure Summary..... | 17-13 |
| 17-9 | Fault Tree Basic Events for Normal Residual Heat Removal System (Sheets 1 – 5) | 17-14 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 18-1 | List of System Fault Trees..... | 18-6 |
| 18-2a | Fault Tree CCN Success Criteria Summary | 18-6 |
| 18-2b | Fault Tree CCT Success Criteria Summary..... | 18-7 |
| 18-2c | Fault Tree CCP Success Criteria Summary..... | 18-7 |
| 18-3 | Notes Related to System Fault Tree Assumptions..... | 18-8 |
| 18-4 | System Dependency Matrix | 18-8 |
| 18-5 | Component Test Assumptions..... | 18-9 |
| 18-6 | Component Maintenance Assumptions..... | 18-9 |
| 18-7 | Operator Actions and Misposition Analysis Summary..... | 18-10 |
| 18-8 | Common Cause Failure Analysis Summary..... | 18-10 |
| 18-9 | Fault Tree Basic Events for Component Cooling Water System (Sheets 1 – 2)..... | 18-11 |
| 19-1 | List of System Fault Trees..... | 19-6 |
| 19-2a | Fault Tree SWN Success Criteria Summary | 19-6 |
| 19-2b | Fault Tree SWT Success Criteria Summary..... | 19-7 |
| 19-2c | Fault Tree SWP Success Criteria Summary..... | 19-7 |
| 19-3 | Notes Related to System Fault Tree Assumptions..... | 19-8 |
| 19-4 | System Dependency Matrix | 19-9 |
| 19-5 | Component Test Assumptions..... | 19-10 |
| 19-6 | Component Maintenance Assumptions..... | 19-10 |
| 19-7 | Operator Actions and Misposition Analysis Summary..... | 19-11 |
| 19-8 | Common Cause Failure Analysis Summary..... | 19-11 |
| 19-9 | Fault Tree Basic Events for Service Water System (Sheets 1 – 4)..... | 19-12 |
| 20-1 | List of System Fault Trees..... | 20-5 |
| 20-2 | Fault Tree VWH Success Criteria Summary..... | 20-5 |
| 20-3 | Notes Related to System Fault Tree Assumptions..... | 20-5 |
| 20-4 | System Dependency Matrix | 20-6 |
| 20-5 | Component Test Assumptions..... | 20-7 |
| 20-6 | Component Maintenance Assumptions..... | 20-7 |
| 20-7 | Operator Actions and Misposition Analysis Summary..... | 20-8 |
| 20-8 | Common Cause Failure Analysis Summary..... | 20-8 |
| 20-9 | Fault Tree Basic Events for Central Chilled Water System (Sheets 1 – 2)..... | 20-9 |
| 21-1 | List of System Fault Trees (Sheets 1 – 3)..... | 21-9 |
| 21-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 21-12 |
| 21-3 | Notes Related to System Fault Tree Assumptions (Sheets 1 – 3)..... | 21-28 |
| 21-4 | System Dependency Matrix | 21-31 |
| 21-5 | Component Test Assumptions..... | 21-31 |
| 21-6 | Component Maintenance Assumptions..... | 21-32 |
| 21-7 | Operator Actions and Misposition Analysis Summary..... | 21-32 |
| 21-8 | Common Cause Failure Analysis Summary..... | 21-32 |
| 21-9 | Fault Tree Basic Events for AC Power System (Sheets 1 – 22)..... | 21-33 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 22-1 | List of System Fault Trees (Sheets 1 – 4)..... | 22-6 |
| 22-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 22-10 |
| 22-3 | Notes Related to System Fault Tree Assumptions..... | 22-26 |
| 22-4 | Systems Dependency Matrix | 22-26 |
| 22-5 | Component Test Assumptions..... | 22-27 |
| 22-6 | Component Maintenance Assumptions | 22-27 |
| 22-7 | Operator Actions and Misposition Analysis Summary..... | 22-27 |
| 22-8 | Common Cause Failure Analysis Summary | 22-28 |
| 22-9 | Fault Tree Basic Events for Class 1E DC and UPS System (Sheets 1 – 12)..... | 22-29 |
| 22-10 | System Power Requirements/Dependencies (Sheets 1 – 11)..... | 22-41 |
| 23-1 | List of System Fault Trees (Sheets 1 – 3)..... | 23-6 |
| 23-2 | Fault Tree Success Criteria Summary (Sheets 1 – 10) | 23-9 |
| 23-3 | Notes Related to System Fault Tree Assumptions..... | 23-19 |
| 23-4 | System Dependency Matrix | 23-19 |
| 23-5 | Component Test Assumptions..... | 23-20 |
| 23-6 | Component Maintenance Assumptions | 23-20 |
| 23-7 | Operator Actions and Misposition Analysis Summary..... | 23-20 |
| 23-8 | Common Cause Failure Analysis Summary | 23-21 |
| 23-9 | Fault Tree Basic Events for Non-Class 1E DC and UPS Power System (Sheets 1 – 20)..... | 23-22 |
| 24-1 | AP1000 Containment Penetration List (Sheets 1 – 4)..... | 24-7 |
| 24-2 | Screening Analysis Evaluation (Sheets 1 – 5)..... | 24-16 |
| 24-3 | Containment Penetrations Not Screened Out for Normal Operation at Power Analysis..... | 24-21 |
| 24-4 | List of System Fault Trees..... | 24-21 |
| 24-5a | Fault Tree CIC Success Criteria Summary..... | 24-22 |
| 24-5b | Fault Tree CIA Success Criteria Summary..... | 24-22 |
| 24-5c | Fault Tree CIB Success Criteria Summary..... | 24-23 |
| 24-6 | Notes Related to System Fault Tree Assumptions..... | 24-23 |
| 24-7 | System Dependency Matrix (Sheets 1 – 3)..... | 24-24 |
| 24-8 | Component Test Assumptions..... | 24-27 |
| 24-9 | Component Maintenance Assumptions | 24-27 |
| 24-10 | Operator Actions and Misposition Analysis Summary..... | 24-28 |
| 24-11 | Common Cause Failure Analysis Summary | 24-28 |
| 24-12 | Fault Tree Basic Events for Containment Isolation System (Sheets 1 – 3) | 24-29 |
| 25-1 | List of System Fault Trees..... | 25-8 |
| 25-2a | Fault Tree CAIAIR Success Criteria Summary..... | 25-9 |
| 25-2b | Fault Tree CAIR Success Criteria Summary..... | 25-9 |
| 25-2c | Fault Tree CAIAIRP Success Criteria Summary..... | 25-10 |
| 25-2d | Fault Tree ENDCAIAI Success Criteria Summary | 25-10 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 25-2e | Fault Tree ENDCAIAP Success Criteria Summary | 25-11 |
| 25-2f | Fault Tree CASF Success Criteria Summary | 25-11 |
| 25-3 | Notes Related to System Fault Tree Assumptions..... | 25-12 |
| 25-4 | System Dependency Matrix | 25-12 |
| 25-5 | Component Test Assumptions..... | 25-12 |
| 25-6 | Component Maintenance Assumptions..... | 25-13 |
| 25-7 | Operator Actions and Misposition Analysis Summary..... | 25-13 |
| 25-8 | Common Cause Failure Analysis Summary..... | 25-13 |
| 25-9 | Fault Tree Basic Events for Instrument Air Subsystem (Sheets 1 – 4)..... | 25-14 |
| 26-1 | List of System Fault Trees..... | 26-25 |
| 26-2a | Fault Tree RTPMS, and RTPMS1 Success Criteria Summary | 26-26 |
| 26-2b | Fault Tree RTSTP Success Criteria Summary | 26-26 |
| 26-2c | Fault Tree RCL Success Criteria Summary..... | 26-27 |
| 26-2d.1 | Fault Tree RCT Success Criteria Summary..... | 26-27 |
| 26-2d.2 | Fault Tree RCN Success Criteria Summary | 26-28 |
| 26-2e | I&C Subtree Success Criteria Summary (Sheets 1 – 98)..... | 26-29 |
| 26-3a | PMS I&C Subtree Constructions (Sheets 1 – 19)..... | 26-127 |
| 26-3b | Representative PMS I&C Subtree Plot Listing (Sheets 1 – 14)..... | 26-146 |
| 26-4 | PMS Dependency Matrix (Sheets 1 – 3) | 26-160 |
| 26-5 | PMS Components Test Assumptions | 26-163 |
| 26-6 | Component Maintenance Assumptions..... | 26-163 |
| 26-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 5)..... | 26-164 |
| 26-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 3) | 26-169 |
| 26-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2)..... | 26-172 |
| 26-10a | Fault Tree Basic Events for Reactor Trip System (Sheets 1 – 4)..... | 26-174 |
| 26-10b | Fault Tree Basic Events for the I&C Subsystem (Sheets 1 – 49) | 26-178 |
| 26-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3)..... | 26-227 |
| 27-1 | List of System Fault Trees..... | 27-9 |
| 27-2a | Fault Tree DAS Success Criteria Summary | 27-9 |
| 27-2b | Fault Tree DAS1 Success Criteria Summary | 27-9 |
| 27-3 | Notes Related to System Fault Tree Assumptions..... | 27-10 |
| 27-4 | System Dependency Matrix | 27-10 |
| 27-5 | Component Test Assumptions..... | 27-10 |
| 27-6 | Component Maintenance Assumptions..... | 27-10 |
| 27-7 | Operator Actions and Misposition Analysis Summary..... | 27-10 |
| 27-8 | Common Cause Failure Analysis Summary..... | 27-11 |
| 27-9 | Fault Tree Basic Events for Diverse Actuation System..... | 27-12 |
| 28-1 | List of System Fault Trees..... | 28-20 |
| 28-2 | Fault Tree Success Criteria Summary (Sheets 1 – 22) | 28-21 |
| 28-3 | PLS I&C Subtree Constructions (Sheets 1 – 9)..... | 28-43 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 28-4 | PLS Dependency Matrix (Sheets 1 – 2) | 28-52 |
| 28-5 | PLS Components Test Assumptions | 28-54 |
| 28-6 | Component Maintenance Assumptions | 28-54 |
| 28-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 3)..... | 28-55 |
| 28-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 2) | 28-58 |
| 28-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2)..... | 28-60 |
| 28-10 | Fault Tree Basic Events for I&C Subsystem (Sheets 1 – 68)..... | 28-62 |
| 28-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3)..... | 28-130 |
| 28-12 | Assignments of Plant Systems to Logic Cabinets..... | 28-133 |
| 28-13 | Assignments of Plant Systems to the Control Group Cabinets..... | 28-134 |
| 29-1 | Electrical Components with Low CCF Rate | 29-18 |
| 29-2 | Common-Cause Failure Calculations (Sheets 1 – 5)..... | 29-19 |
| 29-3 | Simplification of Q_K/Q_T Equations..... | 29-24 |
| 29A-1 | Extreme Environmental Conditions (Generic Causes of Dependent Failures) Excerpted from the ANS/IEEE PRA Procedures Guide (NUREG-2300)..... | 29A-11 |
| 29A-2 | Common-Cause Failures Among Systems | 29A-12 |
| 29A-3 | Common-Cause Failure Equations for MGL Method | 29A-13 |
| 30-1 | AP1000 Human Error Probability Summary Results (Sheets 1 – 16)..... | 30-75 |
| 30-2 | Manual DAS Actuation (Sheets 1 – 2)..... | 30-91 |
| 30-3 | Dependency Level Evaluation Summary (Sheets 1 – 14)..... | 30-93 |
| 30-4 | Dependency Level Evaluation (Sheets 1 – 3)..... | 30-107 |
| 30-5 | List of Acronyms..... | 30-110 |
| 30A-1 | Analyst Responsibility Based on Sharp Steps | 30A-10 |
| 30A-2 | Summary of Screening Values | 30A-11 |
| 30A-3 | Example of Operator Action Definition | 30A-12 |
| 30A-4 | HEP Data Bank (Sheets 1 – 5)..... | 30A-13 |
| 31-1 | Summary of Event Tree Scalar Probabilities..... | 31-12 |
| 32-1 | Generic Data Base (Sheets 1 – 13)..... | 32-5 |
| 32-2 | Test and Maintenance Outage Generic Data | 32-21 |
| 32-3 | Test and Maintenance Unavailabilities Used in AP1000 Core Damage Quantification..... | 32-22 |
| 32-4 | Common Cause Factors (Sheets 1 – 5)..... | 32-23 |
| 32-5 | SIMON.OUT File (Sheets 1 – 21) | 32-29 |
| 33-1 | Summary of AP1000 System Fault Tree Failure Probabilities (Sheets 1 – 13)..... | 33-7 |
| 33-2 | Example Accident Sequence Definitions for Large LOCA..... | 33-20 |
| 33-3 | AP1000 PRA Dominant CDF Cutsets (Sheets 1 – 10) | 33-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 33-4 | AP1000 PRA Dominant CDF Sequences (Sheets 1 – 18) | 33-31 |
| 33-5 | Contribution of Initiating Events to Plant Core Damage Frequency | 33-49 |
| 33-6 | List of Basic Events and Their Descriptions (Sheets 1 – 33) | 33-50 |
| 34-1 | Post-Accident Monitoring Equipment (Sheets 1 – 2)..... | 34-23 |
| 34-2 | Level 1 Accident Class..... | 34-25 |
| 34-3 | Summary of Release Categories..... | 34-26 |
| 34-4 | 3BE-1 Event Summary..... | 34-27 |
| 34-5 | 3BE-2 Event Summary..... | 34-28 |
| 34-6 | 3BE-4 Event Summary..... | 34-29 |
| 34-7 | 3BE-5 Event Summary..... | 34-30 |
| 34-8 | 3BE-6 Event Summary..... | 34-31 |
| 34-9 | 3BE-7 Event Summary..... | 34-32 |
| 34-10 | 3BE-3 Event Summary..... | 34-33 |
| 34-11 | 3BL-1 Event Summary..... | 34-34 |
| 34-12 | 3BL-2 Event Summary..... | 34-35 |
| 34-13 | 3BR-1 Event Summary | 34-36 |
| 34-14 | 3BR-1a Event Summary..... | 34-37 |
| 34-15 | 3C-1 Event Summary | 34-38 |
| 34-16 | 3C-2 Event Summary | 34-39 |
| 34-17 | 3D-1 Event Summary..... | 34-40 |
| 34-18 | 3D-2 Event Summary..... | 34-41 |
| 34-19 | 3D-3 Event Summary..... | 34-42 |
| 34-20 | 3D-4 Event Summary..... | 34-43 |
| 34-21 | 6E-1 Event Summary | 34-44 |
| 34-22 | 6L-1 Event Summary | 34-45 |
| 34-23 | 1AP-1 Event Summary..... | 34-46 |
| 34-24 | 1AP-2 Event Summary..... | 34-47 |
| 34-25 | 1A-1 Event Summary..... | 34-48 |
| 34-26 | 1A-2 Event Summary..... | 34-49 |
| 34-27 | CFI Event Summary..... | 34-50 |
| 34-28 | CFL Event Summary..... | 34-51 |
| 35-1 | Functional Definitions of Level 1 Accident Classes | 35-21 |
| 35-2 | CET Initial Conditions for Level 1 Accident Classes..... | 35-22 |
| 35-3 | Containment Event Tree Nodal Questions | 35-23 |
| 35-4 | Summary of Release Category Definitions..... | 35-24 |
| 35-5 | Summary of Containment Event Tree Success Criteria (Sheets 1 – 3)..... | 35-25 |
| 35-6 | Summary of Operator Actions Credited on Containment Event Tree | 35-28 |
| 36-1 | Summary Table for RCS Depressurization (CET Node DP)..... | 36-6 |
| 37-1 | Summary Table for Containment Isolation (CET Node IS) | 37-4 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 38-1 | Summary Table for Reflooding (CET Node RFL)..... | 38-5 |
| 39-1 | Material Inventories in AP1000 Reactor Vessel..... | 39-21 |
| 39-2 | Summary Table for Reactor Cavity Flooding (CET Node IR)..... | 39-22 |
| 39-3 | Summary Table for Debris Relocation to Cavity (CET Node VF)..... | 39-22 |
| 39A-1 | Core and Lower Internals Material Inventories in AP1000 Reactor Vessel | 39A-14 |
| 39A-2a | Mass and Power Distributions of Debris Layers in Top-Skewed Power Shape Case | 39A-15 |
| 39A-2b | Mass and Power Distributions of Debris Layers in Chopped Cosine Power Shape Case | 39A-16 |
| 39A-3a | Results of Top-Skewed Power Shape Case | 39A-17 |
| 39A-3b | Relocation Results of the Chopped Cosine Power Shape Case | 39A-18 |
| 39A-4 | Material Properties Used in In-Vessel Melting and Relocation Calculation | 39A-19 |
| 39A-5 | Debris Relocation Time Line | 39A-20 |
| 40-1 | Summary of Nodal Failure Probabilities | 40-6 |
| 40-2 | Nominal and Bounding Containment Failure Probability at 24 and 72 Hours | 40-6 |
| 41-1 | Containment Event Tree IG Nodal Failure Probability | 41-33 |
| 41-2 | Containment Event Tree Nodal Failure Probabilities | 41-33 |
| 41-3 | AP600 Scenario Dependencies for Early Detonation Analysis | 41-34 |
| 41-4 | Safety Margin Basis Containment Performance Requirement | 41-35 |
| 41A-1 | Summary of System Assumptions for AP1000 MAAP4.04 Hydrogen Analyses (Sheets 1 – 7) | 41A-2 |
| 41A-2 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-10 |
| 41A-3 | Summary of Early Compartment Gas Composition Results For MAAP4 Hydrogen Mixing Analyses..... | 41A-10 |
| 41A-4 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-11 |
| 41A-5 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-11 |
| 41A-6 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-7 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-8 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-13 |
| 41A-9 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-14 |
| 41A-10 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-15 |
| 41A-11 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 41A-12 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-13 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-14 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-17 |
| 41A-15 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-17 |
| 41A-16 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-18 |
| 41A-17 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-18 |
| 41A-18 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-19 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-20 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-20 |
| 41A-21 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-20 |
| 41A-22 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-21 |
| 41A-23 | Sequence 1A-3a | 41A-22 |
| 41A-24 | Sequence 1A-4a | 41A-23 |
| 41A-25 | Sequence 1AP-3..... | 41A-24 |
| 41A-26 | Sequence 1AP-4..... | 41A-25 |
| 41A-27 | Sequence 3D-1 | 41A-26 |
| 41A-28 | Sequence 3D-2 | 41A-27 |
| 41A-29 | Sequence 3D-3 | 41A-28 |
| 41A-30 | Sequence 3D-5 | 41A-29 |
| 41A-31 | Sequence 3BL-1 | 41A-30 |
| 41A-32 | Sequence 3BL-2..... | 41A-31 |
| 41A-33 | Sequence 3C-1 | 41A-32 |
| 41A-34 | Sequence 3BR-1a..... | 41A-33 |
| 41A-35 | Sequence 3BE-1..... | 41A-34 |
| 41A-36 | Sequence 3BE-2..... | 41A-35 |
| 41A-37 | Sequence 3BE-4..... | 41A-36 |
| 41A-38 | Sequence 3BE-5..... | 41A-37 |
| 41A-39 | Sequence 3BE-6..... | 41A-38 |
| 41A-40 | Sequence 3BE-8..... | 41A-39 |
| 41A-41 | Sequence 3BE-9..... | 41A-40 |
| 42-1 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 400°F..... | 42-9 |
| 42-2 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 331°F..... | 42-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 42-3 | Cumulative Containment Failure Probability, Temperature = 400°F | 42-10 |
| 42-4 | Cumulative Containment Failure Probability, Temperature = 331°F | 42-11 |
| 43-1 | Accident Class Frequencies | 43-13 |
| 43-2 | Boolean Expressions to Calculate Q1-Q29 | 43-14 |
| 43-3 | CET Node Probabilities (Sheets 1 – 3) | 43-15 |
| 43-4 | Boolean Expressions for P1-P15 | 43-18 |
| 43-5 | Contribution of PDS to LRF (Sheets 1 – 3) | 43-19 |
| 43-6 | Dominant CET Sequences Contributing to LRF (Sheets 1 – 69)..... | 43-22 |
| 43-7 | Summary of Release Frequency Calculations (Sheets 1 – 2) | 43-91 |
| 43-8 | LRF and Containment Effectiveness by Accident Class | 43-93 |
| 43-9 | Summary of AP1000 LRF Quantification for Internal Events At-Power | 43-94 |
| 43-10 | CET Event Tree Node Importances | 43-95 |
| 43-11 | Contribution of Initiating Events to Large Release | 43-96 |
| 43-12 | LRF Sensitivity Case – Non Credit for Standby Non-Safety Systems (Sheets 1 – 9) | 43-97 |
| 43-13 | LRF Cutsets for the Case – Sensitivity to Standby Systems With Credit for Manual DAS (Sheets 1 – 13)..... | 43-106 |
| 43A-1 | AP1000 PRA Dominant CDF Sequences for At-Power Events (Sheets 1 – 6)..... | 43A-2 |
| 43A-2 | AP1000 PRA PDS Frequencies for At-Power Events..... | 43A-8 |
| 43B-1 | Calculation of Failure Probability of DP for PDS 6 (Sheets 1 – 7)..... | 43B-2 |
| 43C-1 | Evaluation of CET-Related Operator Actions..... | 43C-2 |
| 44-1 | MAAP Model Benchmarks (Sheets 1 – 4)..... | 44-8 |
| 45-1 | Environmental Release Fractions at 24 Hours After Core Damage Per Release Category..... | 45-5 |
| 45-2 | Environmental Release Fractions at 72 Hours After Core Damage Per Release Category..... | 45-6 |
| 49-1 | AP1000 Source Terms from Level 2 Analysis (MAAP)..... | 49-9 |
| 49-2 | AP1000 Source Terms for Dose Evaluation (MACCS2)..... | 49-10 |
| 49-3 | Site Boundary Whole Body Dose [Effective Dose Equivalent (EDE)], Sieverts | 49-11 |
| 49-4 | Site Boundary Thyroid Dose, Sieverts | 49-12 |
| 49-5 | Population Whole Body Dose [Effective Dose Equivalent (EDE)], 0-80.5 km Person-Sieverts | 49-13 |
| 49-6 | Site Boundary Red Marrow Dose (Total Acute), Sieverts..... | 49-14 |
| 49-7 | Dose Summary | 49-15 |
| 49-8 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 49-16 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 49-9 | Site Boundary Whole Body EDE Dose Risk – 72 Hours..... | 49-17 |
| 49-10 | Population Whole Body EDE Dose Risk – 24 Hours..... | 49-18 |
| 49-11 | Population Whole Body EDE Dose Risk – 72 Hours..... | 49-19 |
| 50-1 | Core Damage for At-Power Events Contribution of Initiating Events to Plant Core Damage Frequency..... | 50-16 |
| 50-2 | Core Damage for At-Power Events Conditional Core Damage Probability of Initiating Events..... | 50-17 |
| 50-3 | AP1000 PRA Core Damage for At-Power Events Accident Sequence Importances (Sheets 1 – 5)..... | 50-18 |
| 50-4 | Core Damage for At-Power Events End State Importances..... | 50-23 |
| 50-5 | Common Cause Importances – Risk Decrease (Sheets 1 – 2)..... | 50-24 |
| 50-6 | Common Cause Importances – Risk Increase (Sheets 1 – 3)..... | 50-26 |
| 50-7 | Human Error Risk Importances – Risk Decrease (Sheets 1 – 2)..... | 50-29 |
| 50-8 | Human Error Risk Importances – Risk Increase (Sheets 1 – 2)..... | 50-31 |
| 50-9 | Component Importances – Risk Decrease (Sheets 1 – 2)..... | 50-33 |
| 50-10 | Component Importances – Risk Increase (Sheets 1 – 4)..... | 50-35 |
| 50-11 | List of Systems for System Importance Analyses (Sheets 1 – 4)..... | 50-39 |
| 50-12 | System Importance Calculation Results (Sheets 1 – 2)..... | 50-43 |
| 50-13 | Systems Grouped by PRA System Importance..... | 50-45 |
| 50-14 | Operator Actions in “CMTOT.OUT” File..... | 50-46 |
| 50-15 | Contribution of IEVs to Core Damage Frequency..... | 50-47 |
| 50-16 | Case 29 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-48 |
| 50-17 | Case 30 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-50 |
| 50-18 | Case 31 – Top 50 Dominant Cutsets (Sheets 1 – 3)..... | 50-52 |
| 50-19 | Passive System Check Valves in “CMTOT.OUT” File..... | 50-55 |
| 50-20 | Sensitivity Case 36 – Contribution of Initiating Events to CDF..... | 50-56 |
| 50-21 | Sensitivity Case 36 – Top 50 CDF Cutsets (Sheets 1 – 8)..... | 50-57 |
| 50-22 | Risk Importances Sorted by Basic Event Identification (Sheets 1 – 13)..... | 50-65 |
| 50-23 | Risk Importances Sorted by Risk Increase (Sheets 1 – 15)..... | 50-78 |
| 50-24 | Risk Importances Sorted by Risk Decrease (Sheets 1 – 15)..... | 50-93 |
| 50-25 | Risk Increases Sorted by Slope (Birnbaum) Importance (Sheets 1 – 13)..... | 50-108 |
| 51-1 | Summary of Results of AP1000 PRA Uncertainty Analysis for Internal Initiating Events at Power..... | 51-9 |
| 51-2 | List of Input Cutset Files..... | 51-10 |
| 51A-1 | Basic Event Uncertainties (Sheets 1 – 32)..... | 51A-3 |
| 54-1 | AP1000 Initiating Event Frequencies During Shutdown Conditions..... | 54-18 |
| 54-2 | AP1000 Design Impact on AP600 Shutdown Model..... | 54-19 |
| 54-3 | Times for Loss of RNS at Mid-loop Without IRWST Injection..... | 54-20 |
| 54-4 | AP1000 & AP600 Initiating Event CDF Contributions..... | 54-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 54-5 | AP600 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-22 |
| 54-6 | AP1000 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-47 |
| 54-7 | Basic Event Probabilities Revised in Case 1 | 54-72 |
| 54-8 | Revised CCF Basic Event Probabilities (Sheets 1 – 2) | 54-73 |
| 54-9 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 1 | 54-75 |
| 54-9A | Dominant CDF Cutsets for Drained Conditions Only for AP1000 Shutdown PRA Sensitivity Case 1 (Sheets 1 – 24) | 54-76 |
| 54-10 | AP1000 Shutdown PRA Sensitivity Case 2 CDF Cutsets (Sheets 1 – 5)..... | 54-100 |
| 54-11 | List of Basic Events “Dropped” to Make the Sensitivity Case 2..... | 54-105 |
| 54-12 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 2 | 54-106 |
| 54-13 | Shutdown PRA Sensitivity Case 3 (Sheets 1 – 28) | 54-107 |
| 54-14 | Basic Events Whose Probabilities are Changed in Case 3 | 54-135 |
| 54-15 | AP1000 Shutdown PRA Sensitivity Case 4 CDF Cutsets (Sheets 1 – 7)..... | 54-136 |
| 54-16 | List of Basic Events “Dropped” to Make the Sensitivity Case 4..... | 54-143 |
| 54-17 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 4 | 54-144 |
| 54-18 | AP1000 Shutdown PRA Basic Event Risk Importances – RAW (Sheets 1 – 8)..... | 54-145 |
| 54-19 | AP1000 Shutdown PRA Basic Event Risk Importances – RRW (Sheets 1 – 3)..... | 54-153 |
| 54-20 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RAW (Sheets 1 – 4) | 54-156 |
| 54-21 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RRW (Sheets 1 – 2) | 54-160 |
| 55-1 | Seismic Margin HCLPF Values (Sheets 1 – 4)..... | 55-21 |
| 55-2 | Basic Event HCLPF Values (Sheets 1 – 3) | 55-25 |
| 55-3 | EQ-IEV-STRUC HCLPF..... | 55-28 |
| 55-4 | EQ-IEV-RVFA HCLPF | 55-28 |
| 55-5 | EQ-IEV-LLOCA HCLPF | 55-29 |
| 55-6 | EQ-IEV-SLOCA HCLPF..... | 55-29 |
| 55-7 | EQ-IEV-ATWS HCLPF | 55-29 |
| 56-1 | Flooding Analysis Initial Screening Results (Sheets 1 – 3)..... | 56-50 |
| 56-2 | At-Power Detailed Screening Results (Sheets 1 – 5) | 56-53 |
| 56-3 | At-Power Flooding-Induced Core Damage Frequency Quantification Summary Results (Sheets 1 – 6)..... | 56-58 |
| 56-4 | Power Upgrade Difference Between AP1000 and AP600 | 56-64 |
| 56-5 | Shutdown Flooding PRA | 56-65 |
| 56-6 | Shutdown Initiating Event CCDPs..... | 56-66 |
| 57-1 | AP1000 Fire Areas Excluding the Containment (Sheets 1 – 6) | 57-43 |
| 57-2 | AP1000 Fire Areas in the Containment (Sheets 1 – 2)..... | 57-49 |
| 57-3 | Fire Ignition Frequencies for AP1000 Fire Areas (Sheets 1 – 4) | 57-51 |
| 57-4 | Fire Ignition Frequencies for AP1000 Containment Fire Area | 57-58 |
| 57-5 | Fire Barrier Failure Probabilities..... | 57-61 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 57-6 | Automatic Suppression System Reliability | 57-62 |
| 57-7 | Summary of Qualitative Evaluation Results – Power Operation – Plant except Containment and Main Control Room (Sheets 1 – 15)..... | 57-63 |
| 57-8 | Summary of Qualitative Evaluation Results for Containment at Power Operation (Sheets 1 – 4)..... | 57-82 |
| 57-9 | Summary of Results (Sheets 1 – 5) | 57-88 |
| 57-10 | Distribution of Fire CDF Frequency by Three Major Plant Areas | 57-93 |
| 57-11 | Distribution of Fire CDF Frequency by Eight Plant Areas..... | 57-94 |
| 57-12 | Fire Areas Sorted by CDF (Sheets 1 – 5) | 57-95 |
| 57-13 | Fire Areas Sorted by CDF/FIEV (Sheets 1 – 5) | 57-100 |
| 57-14 | Credit for Manual Fire Suppression | 57-105 |
| 57-15 | Reduction of Hot Short Probability | 57-106 |
| 57-16 | Increase of Hot Short Probability | 57-107 |
| 57-17 | Sensitivity to Human Actions..... | 57-108 |
| 57-18 | Sensitivity to Fire Ignition Frequencies..... | 57-109 |
| 57-19 | Sensitivity to Actuation by DAS | 57-110 |
| 57-20 | Plant Fire CDF Without Hot Shorts | 57-111 |
| 57-21 | Contribution of the Plant Areas to CDF | 57-112 |
| 57-22 | Dominant Fire Scenarios (Sheets 1 – 4)..... | 57-113 |
| 57-23 | AP1000 Shutdown CCDPs | 57-117 |
| 57-24 | AP1000 Dominant Fire Sequences (Sheets 1 – 4)..... | 57-118 |
| 57-25 | Dominant Fire Scenarios from AP600 Shutdown Fire PRA | 57-122 |
| 57-26 | Summary of AP1000 Shutdown Fire Evaluation | 57-123 |
| 57-27 | Main Contributors for Shutdown Fire Risk..... | 57-124 |
| 57A-1 | Summary of Scenario CCDPs (Sheets 1 – 5) | 57A-7 |
| 57A-2 | AP1000 Base Case CCDPs for Initiating Events | 57A-12 |
| 57A-3 | DAS-ACT Fault Tree Cutsets Before Subtree Reduction | 57A-13 |
| 57A-4 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 10)..... | 57A-14 |
| 57A-5 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 9)..... | 57A-24 |
| 57A-6 | AP1000 Fire PRA Scenario CCDPs for Over-Conservative Cases (Sheets 1 – 3) | 57A-33 |
| 57C-1 | Data Used in Event Tree Scenario Frequency Calculations (Sheets 1 – 5) | 57C-2 |
| 57C-2 | CCDPs Used in Fire Event Trees (Sheets 1 – 5)..... | 57C-7 |
| 59-1 | Contribution of Initiating Events to Core Damage..... | 59-39 |
| 59-2 | Conditional Core Damage Probability of Initiating Events | 59-40 |
| 59-3 | Internal Initiating Events at Power Dominant Core Damage Sequences (Sheets 1 – 4) | 59-41 |
| 59-4 | Sequence 1 – Safety Injection Line Break Dominant Cutsets (SI-LB-07) (Sheets 1 – 3) | 59-45 |
| 59-5 | Sequence 2 – Large LOCA Dominant Cutsets (LLOCA-09)..... | 59-48 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 59-6 | Sequence 3 – Spurious ADS Actuation Dominant Cutsets (SPADS-08) (Sheets 1 – 3) | 59-49 |
| 59-7 | Sequence 4 – Safety Injection Line Break Dominant Cutsets (SI-LB-08) (Sheets 1 – 3) | 59-52 |
| 59-8 | Sequence 5 – Reactor Vessel Rupture Cutset (RV-RP-02) | 59-55 |
| 59-9 | Sequence 6 – Small LOCA Dominant Cutsets (SLOCA-05) (Sheets 1 – 3) | 59-56 |
| 59-10 | Sequence 7 – Medium LOCA Dominant Cutsets (MLOCA-05) (Sheets 1 – 3) | 59-59 |
| 59-11 | Sequence 8 – Small LOCA Dominant Cutsets (SLOCA-12) (Sheets 1 – 3) | 59-62 |
| 59-12 | Sequence 9 – Medium LOCA Dominant Cutsets (MLOCA-12) (Sheets 1 – 3) | 59-65 |
| 59-13 | Sequence 10 – Spurious ADS Actuation Dominant Cutsets (SPADS-09) (Sheets 1 – 3) | 59-68 |
| 59-14 | Typical System Failure Probabilities, Showing Higher Reliabilities for Safety Systems | 59-71 |
| 59-15 | Summary of AP1000 PRA Results | 59-72 |
| 59-16 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 59-73 |
| 59-17 | Comparison of AP1000 PRA Results to Risk Goals | 59-74 |
| 59-18 | AP1000 PRA-Based Insights (Sheets 1 –24) | 59-75 |

LIST OF FIGURES

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 2-1 | Core Damage Logic Diagram for Internal Initiators (Sheets 1 – 4)..... | 2-47 |
| 4A-1 | Example Event Tree for Illustration of Terminology | 4A-19 |
| 4A-2 | Functional Event Tree | 4A-20 |
| 4A-3 | Illustration of A/B and A&B Notation | 4A-21 |
| 4A-4 | Illustration of Consequential Event and ATWS End States | 4A-22 |
| 4A-5 | AP1000 PRA Transients Template Event Tree (Sheets 1 – 3)..... | 4A-23 |
| 4A-6 | AP1000 PRA Small LOCA Template Event Tree (Sheets 1 – 2) | 4A-26 |
| 4B-1 | AP1000 Large LOCA Event Tree (Sheets 1 – 2)..... | 4B-2 |
| 4B-2 | AP1000 Large Spurious ADS Actuation Event Tree (Sheets 1 – 2) | 4B-4 |
| 4B-3 | AP1000 Medium LOCA Event Tree (Sheets 1 – 4)..... | 4B-6 |
| 4B-4 | AP1000 CMT Line Break Event Tree (Sheets 1 – 4)..... | 4B-10 |
| 4B-5 | AP1000 SI Line Break Event Tree (Sheets 1 – 3)..... | 4B-14 |
| 4B-6 | AP1000 Small LOCA Event Tree (Sheets 1 – 6)..... | 4B-17 |
| 4B-7 | AP1000 RCS Leak Event Tree | 4B-23 |
| 4B-8 | AP1000 Passive RHR Tube Rupture Event Tree..... | 4B-24 |
| 4B-9a | AP1000 Steam Generator Tube Rupture Event Tree (Sheets 1 – 3) | 4B-25 |
| 4B-9b | AP1000 SGTR Continues Event Tree (Sheets 1 – 6)..... | 4B-28 |
| 4B-10 | AP1000 Reactor Vessel Rupture Event Tree | 4B-34 |
| 4B-11 | AP1000 Interfacing Systems LOCA Event Tree..... | 4B-35 |
| 4B-12 | AP1000 Transients With Main Feedwater Event Tree (Sheets 1 – 4)..... | 4B-36 |
| 4B-13 | AP1000 Loss of Reactor Coolant Flow Event Tree (Sheets 1 – 4) | 4B-40 |
| 4B-14 | AP1000 Loss of Feedwater to One SG Tree (Sheets 1 – 4) | 4B-44 |
| 4B-15 | AP1000 Transients With Core Power Excursion Event Tree (Sheets 1 – 4)..... | 4B-48 |
| 4B-16 | AP1000 Transients With Loss of CCW/SW Event Tree (Sheets 1 – 4)..... | 4B-52 |
| 4B-17 | AP1000 Loss of MFW Event Tree (Sheets 1 – 4)..... | 4B-56 |
| 4B-18 | AP1000 Loss of Condenser Event Tree (Sheets 1 – 4) | 4B-60 |
| 4B-19 | AP1000 Loss of Main Compressed Air Event Tree (Sheets 1 – 4) | 4B-64 |
| 4B-20 | AP1000 Loss of Offsite Power Event Tree (Sheets 1 – 7) | 4B-68 |
| 4B-21 | Main Steam Line Break Downstream of MSIVs Event Tree (Sheets 1 – 5) | 4B-75 |
| 4B-22 | Main Steam Line Break Upstream of MSIVs Event Tree (Sheets 1 – 9) | 4B-80 |
| 4B-23 | Stuck Open Secondary Side Safety Valve Event Tree (Sheets 1 – 5) | 4B-89 |
| 4B-24a | ATWS Precursor Without Main Feedwater | 4B-94 |
| 4B-24b | AP1000 ATWS Precursor Without Main Feedwater Continues Event Tree (Sheets 1 – 6) | 4B-95 |
| 4B-25 | ATWS Precursor With SI (Sheets 1 – 6)..... | 4B-101 |
| 4B-26 | ATWS Precursor With MFW (Sheets 1 – 4)..... | 4B-107 |
| 7-1 | Power/Control Model for Large Loads (6900-vac/480-vac Pumps, Fans, and Motors)..... | 7-33 |
| 7-2 | Power/Control Model for Motor-Operated Valves..... | 7-35 |
| 7-3 | Power/Control Model for Air-Operated Valves | 7-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 7-4 | Power/Control Model for Variable Speed Motor | 7-39 |
| 7-5 | An Illustration of Fault Tree Basic Events for a Pump Following the Model Given in Figure 7-1 | 7-41 |
| 8-1 | PRHR – Simplified Piping and Instrumentation Diagram..... | 8-23 |
| 8-2 | PRHR – Simplified Valve Control Diagram | 8-25 |
| 9-1 | Passive Core Cooling System Simplified Sketch | 9-24 |
| 9-2 | Passive Core Cooling System Piping and Instrumentation Diagram | 9-25 |
| 10-1 | Passive Core Cooling System – Accumulator Subsystem | 10-12 |
| 11-1 | Automatic Depressurization System Simplified Piping and Instrumentation Diagram..... | 11-49 |
| 12-1 | Simplified Piping & Instrumentation Diagram of the IRWST/Gravity Injection Subsystem..... | 12-42 |
| 13-1 | Passive Containment Cooling System Sketch | 13-11 |
| 15-1 | Chemical and Volume Control System Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 15-25 |
| 17-1 | Normal Residual Heat Removal System Sketch..... | 17-19 |
| 18-1 | Component Cooling Water System Piping and Instrumentation Diagram | 18-13 |
| 19-1 | Service Water System Piping and Instrumentation Diagram..... | 19-17 |
| 20-1 | Central Chilled Water Low-Capacity Subsystem Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 20-11 |
| 21-1 | AC Power System One-Line Diagram | 21-55 |
| 22-1 | Class 1E DC System One-Line Diagram (Sheets 1 – 2)..... | 22-53 |
| 22-2 | Class 1E UPS One-Line Diagram | 22-57 |
| 25-1 | Compressed & Instrument Air System Piping and Instrumentation Diagram | 25-19 |
| 29-1 | IRWST Valve Configuration..... | 29-25 |
| 30-1 | Human Reliability Analysis Quantification Model | 30-111 |
| 30A-1 | Links Between SHARP Steps | 30A-18 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-1 | Case 3BE-1: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Containment Water Level..... | 34-52 |
| 34-2 | Case 3BE-1: ADS Stage 4 Flow Rates DVI Line Break, Containment Water Level..... | 34-52 |
| 34-3 | Case 3BE-1: Accumulator/CMT Water Mass DVI Line Break, Containment Water Level | 34-53 |
| 34-4 | Case 3BE-1: IRWST Injection Flow Rate DVI Line Break, Containment Water Level | 34-53 |
| 34-5 | Case 3BE-1: Break Flow Rate DVI Line Break, Containment Water Level..... | 34-54 |
| 34-6 | Case 3BE-1: Reactor Vessel Water Level DVI Line Break, Containment Water Level | 34-54 |
| 34-7 | Case 3BE-1: Core Temperatures DVI Line Break, Containment Water Level..... | 34-55 |
| 34-8 | Case 3BE-1: Containment Water Pool Elevations DVI Line Break, Containment Water Level | 34-55 |
| 34-9 | Case 3BE-1: Containment Pressure DVI Line Break, Containment Water Level..... | 34-56 |
| 34-10 | Case 3BE-1: Containment Gas Temperatures DVI Line Break, Containment Water Level | 34-56 |
| 34-11 | Case 3BE-1: Core Mass DVI Line Break, Containment Water Level..... | 34-57 |
| 34-12 | Case 3BE-1: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Containment Water Level..... | 34-57 |
| 34-13 | Case 3BE-1: In-Vessel Hydrogen Generation DVI Line Break, Containment Water Level | 34-58 |
| 34-14 | Case 3BE-1: Mass Fraction of CsI Released to Containment DVI Line Break, Containment Water Level..... | 34-58 |
| 34-15 | Case 3BE-1: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-16 | Case 3BE-1: Mass Fraction of Fission Products Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-17 | Case 3BE-1: Mass Fraction of SrO Released to Environment DVI Line Break, Containment Water Level..... | 34-60 |
| 34-18 | Case 3BE-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-60 |
| 34-19 | Case 3BE-2: ADS Stage 4 Flow Rates DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-20 | Case 3BE-2: Accumulator/CMT Water Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-21 | Case 3BE-2: IRWST Injection Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |
| 34-22 | Case 3BE-2: Break Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-23 | Case 3BE-2: Reactor Vessel Water Level DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-24 | Case 3BE-2: Core Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-25 | Case 3BE-2: Containment Water Pool Elevations DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-26 | Case 3BE-2: Containment Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-27 | Case 3BE-2: Containment Gas Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-28 | Case 3BE-2: Core Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-29 | Case 3BE-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-66 |
| 34-30 | Case 3BE-2: In-Vessel Hydrogen Generation DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-66 |
| 34-31 | Case 3BE-2: Mass Fraction of CsI Released to Containment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-32 | Case 3BE-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-33 | Case 3BE-2: Mass Fraction of Fission Products Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-34 | Case 3BE-2: Mass Fraction of SrO Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-35 | Case 3BE-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS, Failed Gravity Injection..... | 34-69 |
| 34-36 | Case 3BE-4: ADS Stage 4 Flow Rates Spurious ADS, Failed Gravity Injection | 34-69 |
| 34-37 | Case 3BE-4: Accumulator/CMT Water Mass Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-38 | Case 3BE-4: IRWST Injection Flow Rate Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-39 | Case 3BE-4: Break Flow Rate Spurious ADS, Failed Gravity Injection..... | 34-71 |
| 34-40 | Case 3BE-4: Reactor Vessel Water Level Spurious ADS, Failed Gravity Injection | 34-71 |
| 34-41 | Case 3BE-4: Core Temperatures Spurious ADS, Failed Gravity Injection | 34-72 |
| 34-42 | Case 3BE-4: Containment Water Pool Elevations Spurious ADS, Failed Gravity Injection..... | 34-72 |
| 34-43 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection | 34-73 |
| 34-44 | Case 3BE-4: Containment Gas Temperatures Spurious ADS, Failed Gravity Injection..... | 34-73 |
| 34-45 | Case 3BE-4: Core Mass Spurious ADS, Failed Gravity Injection | 34-74 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-46 | Case 3BE-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS, Failed Gravity Injection..... | 34-74 |
| 34-47 | Case 3BE-4: In-Vessel Hydrogen Generation Spurious ADS, Failed Gravity Injection | 34-75 |
| 34-48 | Case 3BE-4: Mass Fraction of CsI Released to Containment Spurious ADS, Failed Gravity Injection..... | 34-75 |
| 34-49 | Case 3BE-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-50 | Case 3BE-4: Mass Fraction of Fission Products Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-51 | Case 3BE-4: Mass Fraction of SrO Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-77 |
| 34-52 | Case 3BE-5: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-77 |
| 34-53 | Case 3BE-5: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-78 |
| 34-54 | Case 3BE-5: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-78 |
| 34-55 | Case 3BE-5: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-56 | Case 3BE-5: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-57 | Case 3BE-5: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-80 |
| 34-58 | Case 3BE-5: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-80 |
| 34-59 | Case 3BE-5: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-81 |
| 34-60 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 34-81 |
| 34-61 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-82 |
| 34-62 | Case 3BE-5: Core Mass SBLOCA with Failed Gravity Injection..... | 34-82 |
| 34-63 | Case 3BE-5: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-83 |
| 34-64 | Case 3BE-5: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-83 |
| 34-65 | Case 3BE-5: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-84 |
| 34-66 | Case 3BE-5: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-84 |
| 34-67 | Case 3BE-5: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |
| 34-68 | Case 3BE-5: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-69 | Case 3BE-6: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-86 |
| 34-70 | Case 3BE-6: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection..... | 34-86 |
| 34-71 | Case 3BE-6: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection..... | 34-87 |
| 34-72 | Case 3BE-6: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection..... | 34-87 |
| 34-73 | Case 3BE-6: Break Flow Rate SBLOCA with Failed Gravity Injection..... | 34-88 |
| 34-74 | Case 3BE-6: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection..... | 34-88 |
| 34-75 | Case 3BE-6: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-76 | Case 3BE-6: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-77 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection..... | 34-90 |
| 34-78 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection..... | 34-90 |
| 34-79 | Case 3BE-6: Core Mass SBLOCA with Failed Gravity Injection..... | 34-91 |
| 34-80 | Case 3BE-6: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-91 |
| 34-81 | Case 3BE-6: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection..... | 34-92 |
| 34-82 | Case 3BE-6: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-92 |
| 34-83 | Case 3BE-6: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-93 |
| 34-84 | Case 3BE-6: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-93 |
| 34-85 | Case 3BE-6: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-94 |
| 34-86 | Case 3BE-7: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-94 |
| 34-87 | Case 3BE-7: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection..... | 34-95 |
| 34-88 | Case 3BE-7: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection..... | 34-95 |
| 34-89 | Case 3BE-7: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection..... | 34-96 |
| 34-90 | Case 3BE-7: Break Flow Rate SBLOCA with Failed Gravity Injection..... | 34-96 |
| 34-91 | Case 3BE-7: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection..... | 34-97 |
| 34-92 | Case 3BE-7: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-97 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-93 | Case 3BE-7: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-98 |
| 34-94 | Case 3BE-7: Containment Pressure SBLOCA with Failed Gravity Injection | 34-98 |
| 34-95 | Case 3BE-7: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-99 |
| 34-96 | Case 3BE-7: Core Mass SBLOCA with Failed Gravity Injection..... | 34-99 |
| 34-97 | Case 3BE-7: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-100 |
| 34-98 | Case 3BE-7: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-100 |
| 34-99 | Case 3BE-7: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-101 |
| 34-100 | Case 3BE-7: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-101 |
| 34-101 | Case 3BE-7: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-102 | Case 3BE-7: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-103 | Case 3BE-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-103 |
| 34-104 | Case 3BE-3: ADS Stage 4 Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-103 |
| 34-105 | Case 3BE-3: Accumulator/CMT Water Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-106 | Case 3BE-3: IRWST Injection Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-107 | Case 3BE-3: Break Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-105 |
| 34-108 | Case 3BE-3: Reactor Vessel Water Level DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-105 |
| 34-109 | Case 3BE-3: Core Temperatures DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-106 |
| 34-110 | Case 3BE-3: Containment Water Pool Elevations DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-106 |
| 34-111 | Case 3BE-3: Containment Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-107 |
| 34-112 | Case 3BE-3: Containment Gas Temperature DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-107 |
| 34-113 | Case 3BE-3: Core Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |
| 34-114 | Case 3BE-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-115 | Case 3BE-3: In-Vessel Hydrogen Generation DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-109 |
| 34-116 | Case 3BE-3: Mass Fraction of CsI Released to Containment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-109 |
| 34-117 | Case 3BE-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-110 |
| 34-118 | Case 3BE-3: Mass Fraction of Fission Products Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-110 |
| 34-119 | Case 3BE-3: Mass Fraction of SrO Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-111 |
| 34-120 | Case 3BL-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection | 34-111 |
| 34-121 | Case 3BL-1: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-112 |
| 34-122 | Case 3BL-1: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-112 |
| 34-123 | Case 3BL-1: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-113 |
| 34-124 | Case 3BL-1: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-113 |
| 34-125 | Case 3BL-1: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-114 |
| 34-126 | Case 3BL-1: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-114 |
| 34-127 | Case 3BL-1: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection | 34-115 |
| 34-128 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Injection | 34-115 |
| 34-129 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-116 |
| 34-130 | Case 3BL-1: Core Mass SBLOCA with Failed Gravity Injection..... | 34-116 |
| 34-131 | Case 3BL-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-117 |
| 34-132 | Case 3BL-1: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-117 |
| 34-133 | Case 3BL-1: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-134 | Case 3BL-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-135 | Case 3BL-1: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-136 | Case 3BL-1: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-137 | Case 3BL-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed Gravity Injection | 34-120 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-138 | Case 3BL-2: ADS Stage 4 Flow Rates DVI Line Break with Failed Gravity Injection | 34-120 |
| 34-139 | Case 3BL-2: Accumulator/CMT Water Mass DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-140 | Case 3BL-2: IRWST Injection Flow Rate DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-141 | Case 3BL-2: Break Flow Rate DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-142 | Case 3BL-2: Reactor Vessel Water Level DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-143 | Case 3BL-2: Core Temperatures DVI Line Break with Failed Gravity Injection | 34-123 |
| 34-144 | Case 3BL-2: Containment Water Pool Elevations DVI Line Break with Failed Gravity Injection..... | 34-123 |
| 34-145 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Injection | 34-124 |
| 34-146 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection..... | 34-124 |
| 34-147 | Case 3BL-2: Core Mass DVI Line Break with Failed Gravity Injection | 34-125 |
| 34-148 | Case 3BL-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed Gravity Injection..... | 34-125 |
| 34-149 | Case 3BL-2: In-Vessel Hydrogen Generation DVI Line Break with Failed Gravity Injection..... | 34-126 |
| 34-150 | Case 3BL-2: Mass Fraction of CsI Released to Containment DVI Line Break with Failed Gravity Injection | 34-126 |
| 34-151 | Case 3BL-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-152 | Case 3BL-2: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-153 | Case 3BL-2: Mass Fraction of SrO Released to Environment DVI Line Break with Failed Gravity Injection | 34-128 |
| 34-154 | Case 3BR-1: Reactor Coolant System and Steam Generator Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-128 |
| 34-155 | Case 3BR-1: ADS Stage 4 Flow Rates CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-156 | Case 3BR-1: Accumulator/CMT Water Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-157 | Case 3BR-1: IRWST Injection Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-130 |
| 34-158 | Case 3BR-1: Break Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-130 |
| 34-159 | Case 3BR-1: Reactor Vessel Water Level CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-160 | Case 3BR-1: Core Temperatures CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |
| 34-161 | Case 3BR-1: Containment Water Pool Elevations CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-132 |
| 34-162 | Case 3BR-1: Containment Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-132 |
| 34-163 | Case 3BR-1: Containment Gas Temperature CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-133 |
| 34-164 | Case 3BR-1: Core Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-133 |
| 34-165 | Case 3BR-1: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-166 | Case 3BR-1: In-Vessel Hydrogen Generation CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-167 | Case 3BR-1: Mass Fraction of CsI Released to Containment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-168 | Case 3BR-1: Mass Fraction of Noble Gases Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-169 | Case 3BR-1: Mass Fraction of Fission Products Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-136 |
| 34-170 | Case 3BR-1: Mass Fraction of SrO Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-136 |
| 34-171 | Case 3BR-1a: Reactor Coolant System and Steam Generator Pressure CL LBLOCA with Failed Accumulators..... | 34-137 |
| 34-172 | Case 3BR-1a: ADS Stage 4 Flow Rates CL LBLOCA with Failed Accumulators | 34-137 |
| 34-173 | Case 3BR-1a: Accumulator/CMT Water Mass CL LBLOCA with Failed Accumulators | 34-138 |
| 34-174 | Case 3BR-1a: IRWST Injection Flow Rate CL LBLOCA with Failed Accumulators | 34-138 |
| 34-175 | Case 3BR-1a: Break Flow Rate CL LBLOCA with Failed Accumulators..... | 34-139 |
| 34-176 | Case 3BR-1a: Reactor Vessel Water Level CL LBLOCA with Failed Accumulators | 34-139 |
| 34-177 | Case 3BR-1a: Core Temperatures CL LBLOCA with Failed Accumulators | 34-140 |
| 34-178 | Case 3BR-1a: Containment Water Pool Elevations CL LBLOCA with Failed Accumulators | 34-140 |
| 34-179 | Case 3BR-1a: Containment Pressure CL LBLOCA with Failed Accumulators | 34-141 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-180 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Failed Accumulators | 34-141 |
| 34-181 | Case 3BR-1a: Core Mass CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-182 | Case 3BR-1a: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-183 | Case 3BR-1a: In-Vessel Hydrogen Generation CL LBLOCA with Failed Accumulators | 34-143 |
| 34-184 | Case 3BR-1a: Mass Fraction of CsI Released to Containment CL LBLOCA with Failed Accumulators..... | 34-143 |
| 34-185 | Case 3BR-1a: Mass Fraction of Noble Gases Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-186 | Case 3BR-1a: Mass Fraction of Fission Products Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-187 | Case 3BR-1a: Mass Fraction of SrO Released to Environment CL LBLOCA with Failed Accumulators | 34-145 |
| 34-188 | Case 3C-1: Reactor Coolant System and Steam Generator Pressure Vessel Rupture | 34-145 |
| 34-189 | Case 3C-1: ADS Stage 4 Flow Rates Vessel Rupture | 34-146 |
| 34-190 | Case 3C-1: Accumulator/CMT Water Mass Vessel Rupture | 34-146 |
| 34-191 | Case 3C-1: IRWST Injection Flow Rate Vessel Rupture..... | 34-147 |
| 34-192 | Case 3C-1: Break Flow Rate Vessel Rupture..... | 34-147 |
| 34-193 | Case 3C-1: Reactor Vessel Water Level Vessel Rupture | 34-148 |
| 34-194 | Case 3C-1: Core Temperatures Vessel Rupture | 34-148 |
| 34-195 | Case 3C-1: Containment Water Pool Elevations Vessel Rupture..... | 34-149 |
| 34-196 | Case 3C-1: Containment Pressure Vessel Rupture..... | 34-149 |
| 34-197 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 34-150 |
| 34-198 | Case 3C-1: Core Mass Vessel Rupture | 34-150 |
| 34-199 | Case 3C-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture | 34-151 |
| 34-200 | Case 3C-1: In-Vessel Hydrogen Generation Vessel Rupture | 34-151 |
| 34-201 | Case 3C-1: Mass Fraction of CsI Released to Containment Vessel Rupture..... | 34-152 |
| 34-202 | Case 3C-1: Mass Fraction of Noble Gas Released to Environment Vessel Rupture..... | 34-152 |
| 34-203 | Case 3C-1: Mass Fraction of Fission Products Released to Environment Vessel Rupture | 34-153 |
| 34-204 | Case 3C-1: Mass Fraction of SrO Released to Environment Vessel Rupture | 34-153 |
| 34-205 | Case 3C-2: Reactor Coolant System and Steam Generator Pressure Vessel Rupture with Containment Failure | 34-154 |
| 34-206 | Case 3C-2: ADS Stage 4 Flow Rates Vessel Rupture with Containment Failure | 34-154 |
| 34-207 | Case 3C-2: Accumulator/CMT Water Mass Vessel Rupture with Containment Failure..... | 34-155 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-208 | Case 3C-2: IRWST Injection Flow Rate Vessel Rupture with Containment Failure..... | 34-155 |
| 34-209 | Case 3C-2: Break Flow Rate Vessel Rupture with Containment Failure | 34-156 |
| 34-210 | Case 3C-2: Reactor Vessel Water Level Vessel Rupture with Containment Failure..... | 34-156 |
| 34-211 | Case 3C-2: Core Temperatures Vessel Rupture with Containment Failure..... | 34-157 |
| 34-212 | Case 3C-2: Containment Water Pool Elevations Vessel Rupture with Containment Failure..... | 34-157 |
| 34-213 | Case 3C-2: Containment Pressure Vessel Rupture with Containment Failure | 34-158 |
| 34-214 | Case 3C-2: Containment Gas Temperature Vessel Rupture with Containment Failure..... | 34-158 |
| 34-215 | Case 3C-2: Core Mass Vessel Rupture with Containment Failure..... | 34-159 |
| 34-216 | Case 3C-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture with Containment Failure..... | 34-159 |
| 34-217 | Case 3C-2: In-Vessel Hydrogen Generation Vessel Rupture with Containment Failure..... | 34-160 |
| 34-218 | Case 3C-2: Mass Fraction of CsI Released to Containment Vessel Rupture with Containment Failure | 34-160 |
| 34-219 | Case 3C-2: Mass Fraction of Noble Gases Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-220 | Case 3C-2: Mass Fraction of Fission Products Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-221 | Case 3C-2: Mass Fraction of SrO Released to Environment Vessel Rupture with Containment Failure | 34-162 |
| 34-222 | Case 3D-1: Reactor Coolant System and Steam Generator Pressure Spurious ADS-4 with Failed CMTs..... | 34-162 |
| 34-223 | Case 3D-1: ADS Stage 4 Flow Rates Spurious ADS-4 with Failed CMTs..... | 34-163 |
| 34-224 | Case 3D-1: Accumulator/CMT Water Mass Spurious ADS-4 with Failed CMTs | 34-163 |
| 34-225 | Case 3D-1: IRWST Injection Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-226 | Case 3D-1: Break Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-227 | Case 3D-1: Reactor Vessel Water Level Spurious ADS-4 with Failed CMTs | 34-165 |
| 34-228 | Case 3D-1: Core Temperatures Spurious ADS-4 with Failed CMTs..... | 34-165 |
| 34-229 | Case 3D-1: Containment Water Pool Elevations Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-230 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-231 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs | 34-167 |
| 34-232 | Case 3D-1: Core Mass Spurious ADS-4 with Failed CMTs | 34-167 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-233 | Case 3D-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-4 with Failed CMTs..... | 34-168 |
| 34-234 | Case 3D-1: In-Vessel Hydrogen Generation Spurious ADS-4 with Failed CMTs..... | 34-168 |
| 34-235 | Case 3D-1: Mass Fraction of CsI Released to Containment Spurious ADS-4 with Failed CMTs..... | 34-169 |
| 34-236 | Case 3D-1: Mass Fraction of Noble Gases Released to Environment Spurious ADS-4 with Failed CMTs..... | 34-169 |
| 34-237 | Case 3D-1: Mass Fraction of Fission Products Released to Environment Spurious ADS-4 with Failed CMTs..... | 34-170 |
| 34-238 | Case 3D-1: Mass Fraction of SrO Released to Environment Spurious ADS-4 with Failed CMTs..... | 34-170 |
| 34-239 | Case 3D-2: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2 with Failed CMTs..... | 34-171 |
| 34-240 | Case 3D-2: ADS Stage 4 Flow Rates Spurious ADS-2 with Failed CMTs..... | 34-171 |
| 34-241 | Case 3D-2: Accumulator/CMT Water Mass Spurious ADS-2 with Failed CMTs..... | 34-172 |
| 34-242 | Case 3D-2: IRWST Injection Flow Rate Spurious ADS-2 with Failed CMTs..... | 34-172 |
| 34-243 | Case 3D-2: Break Flow Rate Spurious ADS-2 with Failed CMTs..... | 34-173 |
| 34-244 | Case 3D-2: Reactor Vessel Water Level Spurious ADS-2 with Failed CMTs..... | 34-173 |
| 34-245 | Case 3D-2: Core Temperatures Spurious ADS-2 with Failed CMTs..... | 34-174 |
| 34-246 | Case 3D-2: Containment Pool Water Elevations Spurious ADS-2 with Failed CMTs..... | 34-174 |
| 34-247 | Case 3D-2: Containment Pressure Spurious ADS-2 with Failed CMTs..... | 34-175 |
| 34-248 | Case 3D-2: Containment Gas Temperature Spurious ADS-2 with Failed CMTs..... | 34-175 |
| 34-249 | Case 3D-2: Core Mass Spurious ADS-2 with Failed CMTs..... | 34-176 |
| 34-250 | Case 3D-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2 with Failed CMTs..... | 34-176 |
| 34-251 | Case 3D-2: In-Vessel Hydrogen Generation Spurious ADS-2 with Failed CMTs..... | 34-177 |
| 34-252 | Case 3D-2: Mass Fraction of CsI Released to Containment Spurious ADS-2 with Failed CMTs..... | 34-177 |
| 34-253 | Case 3D-2: Mass Fraction of Noble Gas Released to Environment Spurious ADS-2 with Failed CMTs..... | 34-178 |
| 34-254 | Case 3D-2: Mass Fraction of Fission Products Released to Environment Spurious ADS-2 with Failed CMTs..... | 34-178 |
| 34-255 | Case 3D-2: Mass Fraction of SrO Released to Environment Spurious ADS-2 with Failed CMTs..... | 34-179 |
| 34-256 | Case 3D-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed ADS..... | 34-179 |
| 34-257 | Case 3D-3: ADS Stage 4 Flow Rates DVI Line Break with Failed ADS..... | 34-180 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-258 | Case 3D-3: Accumulator/CMT Water Mass DVI Line Break with Failed ADS..... | 34-180 |
| 34-259 | Case 3D-3: IRWST Injection Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-260 | Case 3D-3: Break Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-261 | Case 3D-3: Reactor Vessel Water Level DVI Line Break with Failed ADS..... | 34-182 |
| 34-262 | Case 3D-3: Core Temperatures DVI Line Break with Failed ADS..... | 34-182 |
| 34-263 | Case 3D-3: Containment Water Pool Elevations DVI Line Break with Failed ADS..... | 34-183 |
| 34-264 | Case 3D-3: Containment Pressure DVI Line Break with Failed ADS | 34-183 |
| 34-265 | Case 3D-3: Containment Gas Temperature DVI Line Break with Failed ADS | 34-184 |
| 34-266 | Case 3D-3: Core Mass DVI Line Break with Failed ADS | 34-184 |
| 34-267 | Case 3D-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed ADS..... | 34-185 |
| 34-268 | Case 3D-3: In-Vessel Hydrogen Generation DVI Line Break with Failed ADS..... | 34-185 |
| 34-269 | Case 3D-3: Mass Fraction of CsI Released to Containment DVI Line Break with Failed ADS..... | 34-186 |
| 34-270 | Case 3D-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed ADS..... | 34-186 |
| 34-271 | Case 3D-3: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed ADS..... | 34-187 |
| 34-272 | Case 3D-3: Mass Fraction of SrO Released to Environment DVI Line Break with Failed ADS..... | 34-187 |
| 34-273 | Case 3D-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-274 | Case 3D-4: ADS Stage 4 Flow Rates Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-275 | Case 3D-4: Accumulator/CMT Water Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-276 | Case 3D-4: IRWST Injection Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-277 | Case 3D-4: Break Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame..... | 34-190 |
| 34-278 | Case 3D-4: Reactor Vessel Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-190 |
| 34-279 | Case 3D-4: Core Temperatures Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-280 | Case 3D-4: Containment Water Pool Elevations Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-281 | Case 3D-4: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-282 | Case 3D-4: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |
| 34-283 | Case 3D-4: Core Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-284 | Case 3D-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-285 | Case 3D-4: In-Vessel Hydrogen Generation Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-286 | Case 3D-4: Mass Fraction of CsI Released to Containment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-287 | Case 3D-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-288 | Case 3D-4: Mass Fraction of Fission Products Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-289 | Case 3D-4: Mass Fraction of SrO Release to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-196 |
| 34-290 | Case 6E-1: Reactor Coolant System and Steam Generator Pressure SGTR Early Core Melt..... | 34-196 |
| 34-291 | Case 6E-1: ADS Stage 4 Flow Rates SGTR Early Core Melt..... | 34-197 |
| 34-292 | Case 6E-1: Accumulator/CMT Water Mass SGTR Early Core Melt..... | 34-197 |
| 34-293 | Case 6E-1: IRWST Injection Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-294 | Case 6E-1: Break Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-295 | Case 6E-1: Reactor Vessel Water Level SGTR Early Core Melt..... | 34-199 |
| 34-296 | Case 6E-1: Core Temperatures SGTR Early Core Melt..... | 34-199 |
| 34-297 | Case 6E-1: Containment Water Pool Elevations SGTR Early Core Melt | 34-200 |
| 34-298 | Case 6E-1: Containment Pressure SGTR Early Core Melt | 34-200 |
| 34-299 | Case 6E-1: Containment Gas Temperature SGTR Early Core Melt..... | 34-201 |
| 34-300 | Case 6E-1: Core Mass SGTR Early Core Melt | 34-201 |
| 34-301 | Case 6E-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Early Core Melt..... | 34-202 |
| 34-302 | Case 6E-1: In-Vessel Hydrogen Generation SGTR Early Core Melt..... | 34-202 |
| 34-303 | Case 6E-1: Mass Fraction of CsI Released to Containment SGTR Early Core Melt | 34-203 |
| 34-304 | Case 6E-1: Mass Fraction of Noble Gases Released to Environment SGTR Early Core Melt..... | 34-203 |
| 34-305 | Case 6E-1: Mass Fraction of Fission Products Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-306 | Case 6E-1: Mass Fraction of SrO Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-307 | Case 6L-1: Reactor Coolant System and Steam Generator Pressure SGTR Core Melt Failure at Recirculation..... | 34-205 |
| 34-308 | Case 6L-1: ADS Stage 4 Flow Rates SGTR Core Melt Failure at Recirculation | 34-205 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-309 | Case 6L-1: Accumulator/CMT Water Mass SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-310 | Case 6L-1: IRWST Injection Flow Rate SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-311 | Case 6L-1: Break Flow Rate SGTR Core Melt Failure at Recirculation..... | 34-207 |
| 34-312 | Case 6L-1: Reactor Vessel Water Level SGTR Core Melt Failure at Recirculation | 34-207 |
| 34-313 | Case 6L-1: Core Temperatures SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-314 | Case 6L-1: Containment Water Pool Elevations SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-315 | Case 6L-1: Containment Pressure SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-316 | Case 6L-1: Containment Gas Temperature SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-317 | Case 6L-1: Core Mass SGTR Core Melt Failure at Recirculation..... | 34-210 |
| 34-318 | Case 6L-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Core Melt Failure at Recirculation | 34-210 |
| 34-319 | Case 6L-1: In-Vessel Hydrogen Generation SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-320 | Case 6L-1: Mass Fraction of CsI Released to Containment SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-321 | Case 6L-1: Mass Fraction of Noble Gases Released to Environment SGTR Core Melt Failure at Recirculation | 34-212 |
| 34-322 | Case 6L-1: Mass Fraction of Fission Products Released to Environment SGTR Core Melt Failure at Recirculation | 34-212 |
| 34-323 | Case 6L-1: Mass Fraction of SrO Released to Environment SGTR Core Melt Failure at Recirculation | 34-213 |
| 34-324 | Case 1AP-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-213 |
| 34-325 | Case 1AP-1: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed..... | 34-214 |
| 34-326 | Case 1AP-1: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-214 |
| 34-327 | Case 1AP-1: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-215 |
| 34-328 | Case 1AP-1: Break Flow Rate SBLOCA with PRHR, CMTs Failed..... | 34-215 |
| 34-329 | Case 1AP-1: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-216 |
| 34-330 | Case 1AP-1: Core Temperatures SBLOCA with PRHR, CMTs Failed..... | 34-216 |
| 34-331 | Case 1AP-1: Containment Pool Water Elevations SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-332 | Case 1AP-1: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-333 | Case 1AP-1: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-334 | Case 1AP-1: Core Mass SBLOCA with PRHR, CMTs Failed | 34-218 |
| 34-335 | Case 1AP-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-336 | Case 1AP-1: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-337 | Case 1AP-1: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-338 | Case 1AP-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-339 | Case 1AP-1: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-340 | Case 1AP-1: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-341 | Case 1AP-2: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-342 | Case 1AP-2: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-343 | Case 1AP-2: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-344 | Case 1AP-2: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-345 | Case 1AP-2: Break Flow Rate SBLOCA with PRHR, CMTs Failed..... | 34-224 |
| 34-346 | Case 1AP-2: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-224 |
| 34-347 | Case 1AP-2: Core Temperatures SBLOCA with PRHR, CMTs Failed..... | 34-225 |
| 34-348 | Case 1AP-2: Containment Water Pool Elevations SBLOCA with PRHR, CMTs Failed | 34-225 |
| 34-349 | Case 1AP-2: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-350 | Case 1AP-2: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-351 | Case 1AP-2: Core Mass SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-352 | Case 1AP-2: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-353 | Case 1AP-2: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-228 |
| 34-354 | Case 1AP-2: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed..... | 34-228 |
| 34-355 | Case 1AP-2: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-356 | Case 1AP-2: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-357 | Case 1AP-2: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed..... | 34-230 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-358 | Case 1A-1: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes | 34-230 |
| 34-359 | Case 1A-1: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-231 |
| 34-360 | Case 1A-1: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-231 |
| 34-361 | Case 1A-1: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-362 | Case 1A-1: Break Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-363 | Case 1A-1: Reactor Vessel Water Level Transient with Creep of SG Tubes..... | 34-233 |
| 34-364 | Case 1A-1: Core Temperatures Transient with Creep of SG Tubes..... | 34-233 |
| 34-365 | Case 1A-1: Containment Pool Water Elevations Transient with Creep of SG Tubes..... | 34-234 |
| 34-366 | Case 1A-1: Containment Pressure Transient with Creep of SG Tubes | 34-234 |
| 34-367 | Case 1A-1: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-235 |
| 34-368 | Case 1A-1: Core Mass Transient with Creep of SG Tubes | 34-235 |
| 34-369 | Case 1A-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes..... | 34-236 |
| 34-370 | Case 1A-1: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-236 |
| 34-371 | Case 1A-1: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-237 |
| 34-372 | Case 1A-1: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes..... | 34-237 |
| 34-373 | Case 1A-1: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes..... | 34-238 |
| 34-374 | Case 1A-1: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-238 |
| 34-375 | Case 1A-2: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes..... | 34-239 |
| 34-376 | Case 1A-2: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-239 |
| 34-377 | Case 1A-2: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-240 |
| 34-378 | Case 1A-2: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-240 |
| 34-379 | Case 1A-2: Break Flow Rate Transient with Creep of SG Tubes | 34-241 |
| 34-380 | Case 1A-2: Reactor Vessel Water Level Transient with Creep of SG Tubes..... | 34-241 |
| 34-381 | Case 1A-2: Core Temperatures Transient with Creep of SG Tubes..... | 34-242 |
| 34-382 | Case 1A-2: Containment Water Pool Elevations Transient with Creep of SG Tubes | 34-242 |
| 34-383 | Case 1A-2: Containment Pressure Transient with Creep of SG Tubes | 34-243 |
| 34-384 | Case 1A-2: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-243 |
| 34-385 | Case 1A-2: Core Mass Transient with Creep of SG Tubes | 34-244 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-386 | Case 1A-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes..... | 34-244 |
| 34-387 | Case 1A-2: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-245 |
| 34-388 | Case 1A-2: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-245 |
| 34-389 | Case 1A-2: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes..... | 34-246 |
| 34-390 | Case 1A-2: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes..... | 34-246 |
| 34-391 | Case 1A-2: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-247 |
| 34-392 | Case 3BE-1: Containment Pressure DDT Intermediate Containment Failure..... | 34-247 |
| 34-393 | Case 3BE-1: Containment Gas Temperature DDT Intermediate Containment Failure..... | 34-248 |
| 34-394 | Case 3BE-1: Containment Hydrogen Concentration DDT Intermediate Containment Failure..... | 34-248 |
| 34-395 | Case 3BE-1: Noble Gases Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-396 | Case 3BE-1: CsI and RbI Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-397 | Case 3BE-1: TeO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-250 |
| 34-398 | Case 3BE-1: SrO Release Fraction DDT Intermediate Containment Failure..... | 34-250 |
| 34-399 | Case 3BE-1: MoO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-400 | Case 3BE-1: CsOH and RbOH Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-401 | Case 3BE-1: BaO Release Fraction DDT Intermediate Containment Failure..... | 34-252 |
| 34-402 | Case 3BE-1: La ₂ O ₃ Release Fraction DDT Intermediate Containment Failure..... | 34-252 |
| 34-403 | Case 3BE-1: CeO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-253 |
| 34-404 | Case 3BE-1: Sb Release Fraction DDT Intermediate Containment Failure..... | 34-253 |
| 34-405 | Case 3BE-1: Te ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-254 |
| 34-406 | Case 3BE-1: UO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-254 |
| 34-407 | Case 3BE-1: RCS Pressure No PCS Water Cooling and Late Containment Failure..... | 34-255 |
| 34-408 | Case 3BE-1: Reactor Vessel Mixture Level No PCS Water Cooling and Late Containment Failure..... | 34-255 |
| 34-409 | Case 3BE-1: Core-Exit Temperature No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-410 | Case 3BE-1: In-Vessel Hydrogen Generation No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-411 | Case 3BE-1: Containment Pressure No PCS Water Cooling and Late Containment Failure..... | 34-257 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-412 | Case 3BE-1: Containment Gas Temperature No PCS Water Cooling and Late Containment Failure..... | 34-257 |
| 34-413 | Case 3BE-1: Containment Hydrogen Concentration No PCS Water Cooling and Late Containment Failure..... | 34-258 |
| 34-414 | Case 3BE-1: Noble Gas Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-258 |
| 34-415 | Case 3BE-1: CsI and RbI Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-416 | Case 3BE-1: TeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-417 | Case 3BE-1: SrO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-418 | Case 3BE-1: MoO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-419 | Case 3BE-1: CsOH and RbOH Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-420 | Case 3BE-1: BaO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-421 | Case 3BE-1: La ₂ O ₃ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-422 | Case 3BE-1: CeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-423 | Case 3BE-1: Sb Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-263 |
| 34-424 | Case 3BE-1: Te ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-263 |
| 34-425 | Case 3BE-1: UO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-264 |
| 35-1 | Containment Event Tree..... | 35-29 |
| 36-1 | AP1000 Accident Class 1A Base Case for Node DP Success – RCS Pressure..... | 36-7 |
| 36-2 | AP1000 Accident Class 1A Base Case for Node DP Success – Core-Exit Gas Temperature..... | 36-8 |
| 36-3 | AP1000 Accident Class 1A Base Case for Node DP Success – Steam Generator Tube Creep Damage..... | 36-9 |
| 36-4 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Passive RHR Heat Removal..... | 36-10 |
| 36-5 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core Makeup Tank Flow (one tank)..... | 36-11 |
| 36-6 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Reactor Coolant System Pressure..... | 36-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 36-7 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core-Exit Gas Temperature..... | 36-13 |
| 39-1 | AP1000 Base Case In-Vessel Retention of Molten Core Debris..... | 39-23 |
| 39-2 | AP1000 Core Shroud | 39-24 |
| 39-3 | Comparison of ULPU-2000 Configuration III and ULPU-2000 Configuration IV..... | 39-25 |
| 39-4 | Effect of Water Level on Water Circulation During IVR..... | 39-26 |
| 39-5 | ULPU-2000 Configuration IV Results (Reference 39-4)..... | 39-27 |
| 39-6 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Zirconium Oxidation Fraction Input Probability Distribution..... | 39-28 |
| 39-7 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Mass of Steel in Debris Input Probability Distribution | 39-29 |
| 39-8 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Time of Final Bounding State Input Probability Distribution..... | 39-30 |
| 39-9 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Oxide Layer..... | 39-31 |
| 39-10 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Metal Layer | 39-32 |
| 39-11 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Power Density in Oxide Debris..... | 39-33 |
| 39-12 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Internal Rayleigh Number in the Oxide Layer..... | 39-34 |
| 39-13 | AP1000 In-Vessel Retention of Molten Core Debris Quantification External Rayleigh Number in the Metal Layer | 39-35 |
| 39-14 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Normalized Heat Fluxes..... | 39-36 |
| 39-15 | AP1000 Passive Core Cooling System..... | 39-37 |
| 39-16 | Containment Floodable Region..... | 39-38 |
| 39-17 | Containment Floodable Region – Exploded View | 39-39 |
| 39-18 | AP1000 Cavity Flooding Rate | 39-40 |
| 39-19 | Schematic of the AP1000 Reactor Vessel, Vessel Cavity, Vessel Insulation, and Vents | 39-41 |
| 39A-1 | AP1000 Reactor Pressure Vessel, Core and Lower Internals..... | 39A-21 |
| 39A-2 | Core Shroud | 39A-22 |
| 39A-3 | Bottom of Core Shroud, Core Barrel, and Lower Core Support Plate (Not to Scale) | 39A-23 |
| 39A-4 | Axial Power Shapes Used for Core Relocation Analysis | 39A-24 |
| 39A-5 | Radial Power Shape Used for Core Relocation Analysis | 39A-25 |
| 39A-6 | Cross Section Geometry of Finite Difference Computational Model..... | 39A-26 |
| 39A-7 | Computational Mesh for Finite Difference Computational Model..... | 39A-27 |
| 39A-8 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Reactor – Coolant System Pressure..... | 39A-28 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 39A-9 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Containment and Reactor Coolant System Pressure..... | 39A-28 |
| 39A-10 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-29 |
| 39A-11 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Hottest Temperature in Core | 39A-29 |
| 39A-12 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Hydrogen Generated in Core | 39A-30 |
| 39A-13 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.7 – 2.0 m)..... | 39A-30 |
| 39A-14 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 2.0 – 2.3 m)..... | 39A-31 |
| 39A-15 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Core Shroud/Barrel..... | 39A-31 |
| 39A-16 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Volume of Debris in Reactor Vessel Lower Plenum..... | 39A-32 |
| 39A-17 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Coolant System Pressure | 39A-32 |
| 39A-18 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Containment and Reactor Coolant System Pressure | 39A-33 |
| 39A-19 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-33 |
| 39A-20 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Hottest Temperature in Core | 39A-34 |
| 39A-21 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Hydrogen Generated in Core | 39A-34 |
| 39A-22 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.1 – 1.4 m)..... | 39A-35 |
| 39A-23 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.4 – 1.7 m)..... | 39A-35 |
| 39A-24 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Core Shroud/Barrel | 39A-36 |
| 39A-25 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Volume of Debris in Reactor Vessel Lower Plenum | 39A-36 |
| 39A-26 | Initial Oxide Relocation to Lower Plenum | 39A-37 |
| 39A-27 | Finite Difference Result for Top-Skewed Power Shape at Level 5 | 39A-38 |
| 39A-28 | Finite Difference Temperature Map Level 5 at 5380 Seconds for Top-Skewed Power Shape Case..... | 39A-38 |
| 39A-29 | MAAP4 Core Temperature Profile for Top-Skewed Power Shape Core Elevation = 2.0 – 2.3 m Above Bottom of Active Fuel (Core Axial Row 12) | 39A-39 |
| 39A-30 | Relocation of Corium | 39A-39 |
| 39A-31 | Model for Relocation to Lower Plenum | 39A-40 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 40-1 | AP1000 Passive Containment Cooling System..... | 40-7 |
| 40-2 | Schematic of Passive Containment Cooling System Piping..... | 40-8 |
| 40-3 | AP1000 Containment Venting Pressure Response..... | 40-9 |
| 40-4 | AP1000 Containment Venting Loss of Containment Air..... | 40-10 |
| 40-5 | AP1000 Dry PCS Containment Pressure Response..... | 40-11 |
| 40-6 | AP1000 Dry PCS Containment Temperature Response..... | 40-12 |
| 41-1 | IRWST Hydrogen Venting..... | 41-36 |
| 41-2 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Success..... | 41-37 |
| 41-3 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Failure..... | 41-38 |
| 41-4 | Accident Class 3BL Early Detonation Decomposition Event Tree..... | 41-39 |
| 41-5 | Accident Class 3C/3BR Early Detonation Decomposition Event Tree..... | 41-40 |
| 41-6 | Accident Class 3D/1D Early Detonation Decomposition Event Tree..... | 41-41 |
| 41-7 | Accident Class AP Early Detonation Decomposition Event Tree..... | 41-42 |
| 41-8 | Boil-Off Hydrogen Generation Probability Density Function..... | 41-43 |
| 41-9 | No Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-44 |
| 41-10 | No-Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-45 |
| 41-11 | Early Reflood Hydrogen Generation Probability Density Function..... | 41-46 |
| 41-12 | Early Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-47 |
| 41-13 | Early Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-48 |
| 41-14 | Late Reflood Hydrogen Generation Probability Density Function..... | 41-49 |
| 41-15 | Late Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-50 |
| 41-16 | Late Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-51 |
| 41-17 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Success..... | 41-52 |
| 41-18 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Failure..... | 41-53 |
| 41-19 | Accident Class 3BL Intermediate Detonation Decomposition Event Tree..... | 41-54 |
| 41-20 | Accident Class 3C/3BR Intermediate Detonation Decomposition Event Tree..... | 41-55 |
| 41-21 | Accident Class 3D/1D Intermediate Detonation Decomposition Event Tree..... | 41-56 |
| 41-22 | Accident Class 1AP Intermediate Detonation Decomposition Event Tree..... | 41-57 |
| 41A-1 | Case 3BE-1: Reactor Coolant System Pressure DVI Line Break for Containment Water Level..... | 41A-41 |
| 41A-2 | Case 3BE-1: Core-Exit Gas Temperature DVI Line Break for Containment Water Level..... | 41A-41 |
| 41A-3 | Case 3BE-1: Reactor Vessel Mixture Level DVI Line Break for Containment Water Level..... | 41A-42 |
| 41A-4 | Case 3BE-1: Hydrogen Generated In-Vessel DVI Line Break for Containment Water Level..... | 41A-42 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-5 | Case 3BE-1: Containment Pressure DVI Line Break for Containment Water Level..... | 41A-43 |
| 41A-6 | Case 3BE-1: Containment Gas Temperature DVI Line Break for Containment Water Level | 41A-43 |
| 41A-7 | Case 3BE-1: Containment Compartments Water Level DVI Line Break for Containment Water Level | 41A-44 |
| 41A-8 | Case 3BE-1: Well-Mixed Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-44 |
| 41A-9 | Case 3BE-1: Well-Mixed Compartment Steam Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-10 | Case 3BE-1: Well-Mixed Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-11 | Case 3BE-1: Confined Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-46 |
| 41A-12 | Case 3BE-1: Confined Compartment Steam Concentration DVI Line Break for Containment Water Level..... | 41A-46 |
| 41A-13 | Case 3BE-1: Confined Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-47 |
| 41A-14 | Case 3BE-1: Equivalence Ratio in SG Room DVI Line Break for Containment Water Level | 41A-47 |
| 41A-15 | Case 3BE-1: Equivalence Ratio in CMT Room DVI Line Break for Containment Water Level | 41A-48 |
| 41A-16 | Case 3BE-1: Equivalence Ratio in IRWST DVI Line Break for Containment Water Level | 41A-48 |
| 41A-17 | Case 3BE-1: Equivalence Ratio in PXS DVI Line Break for Containment Water Level..... | 41A-49 |
| 41A-18 | Case 3BE-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-49 |
| 41A-19 | Case 3BE-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-20 | Case 3BE-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-21 | Case 3BE-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-22 | Case 3BE-2: Containment Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-23 | Case 3BE-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-24 | Case 3BE-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-25 | Case 3BE-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding..... | 41A-53 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-26 | Case 3BE-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-53 |
| 41A-27 | Case 3BE-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-28 | Case 3BE-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-29 | Case 3BE-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-30 | Case 3BE-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-31 | Case 3BE-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-32 | Case 3BE-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-33 | Case 3BE-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-34 | Case 3BE-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-35 | Case 3BE-4: Reactor Coolant System Pressure Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-36 | Case 3BE-4: Core-Exit Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-37 | Case 3BE-4: Reactor Vessel Mixture Level Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-38 | Case 3BE-4: Hydrogen Generated In-Vessel Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-39 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection..... | 41A-60 |
| 41A-40 | Case 3BE-4: Containment Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-60 |
| 41A-41 | Case 3BE-4: Containment Compartments Water Level Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-42 | Case 3BE-4: Well-Mixed Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-43 | Case 3BE-4: Well-Mixed Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-44 | Case 3BE-4: Well-Mixed Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-45 | Case 3BE-4: Confined Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-46 | Case 3BE-4: Confined Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-47 | Case 3BE-4: Confined Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-64 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-48 | Case 3BE-4: Equivalence Ratio in SG Room Spurious ADS, Failed Gravity Injection | 41A-64 |
| 41A-49 | Case 3BE-4: Equivalence Ratio in CMT Room Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-50 | Case 3BE-4: Equivalence Ratio in IRWST Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-51 | Case 3BE-4: Equivalence Ratio in PXS Spurious ADS, Failed Gravity Injection | 41A-66 |
| 41A-52 | Case 3BE-5: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-66 |
| 41A-53 | Case 3BE-5: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-54 | Case 3BE-5: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-55 | Case 3BE-5: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-56 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-57 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-69 |
| 41A-58 | Case 3BE-5: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-69 |
| 41A-59 | Case 3BE-5: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-60 | Case 3BE-5: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-61 | Case 3BE-5: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-62 | Case 3BE-5: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-63 | Case 3BE-5: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-64 | Case 3BE-5: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-65 | Case 3BE-5: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-66 | Case 3BE-5: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-67 | Case 3BE-5: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-68 | Case 3BE-5: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-69 | Case 3BE-6: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-75 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-70 | Case 3BE-6: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-75 |
| 41A-71 | Case 3BE-6: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-72 | Case 3BE-6: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-73 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-74 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-75 | Case 3BE-6: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-76 | Case 3BE-6: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-77 | Case 3BE-6: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-78 | Case 3BE-6: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-79 | Case 3BE-6: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-80 | Case 3BE-6: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-81 | Case 3BE-6: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-81 |
| 41A-82 | Case 3BE-6: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-81 |
| 41A-83 | Case 3BE-6: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-84 | Case 3BE-6: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-85 | Case 3BE-6: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-83 |
| 41A-86 | Case 3BE-8: Reactor Coolant System Pressure SGTR..... | 41A-83 |
| 41A-87 | Case 3BE-8: Core-Exit Gas Temperature SGTR | 41A-84 |
| 41A-88 | Case 3BE-8: Reactor Vessel Mixture Level SGTR | 41A-84 |
| 41A-89 | Case 3BE-8: Hydrogen Generated In-Vessel SGTR | 41A-85 |
| 41A-90 | Case 3BE-8: Containment Pressure SGTR | 41A-85 |
| 41A-91 | Case 3BE-8: Containment Gas Temperature SGTR | 41A-86 |
| 41A-92 | Case 3BE-8: Containment Compartments Water Level SGTR..... | 41A-86 |
| 41A-93 | Case 3BE-8: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-87 |
| 41A-94 | Case 3BE-8: Well-Mixed Compartment Steam Concentration SGTR..... | 41A-87 |
| 41A-95 | Case 3BE-8: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-88 |
| 41A-96 | Case 3BE-8: Confined Compartment Hydrogen Concentration SGTR..... | 41A-88 |
| 41A-97 | Case 3BE-8: Confined Compartment Steam Concentration SGTR..... | 41A-89 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-98 | Case 3BE-8: Confined Compartment Oxygen Concentration SGTR..... | 41A-89 |
| 41A-99 | Case 3BE-8: Equivalence Ratio in SG Room SGTR | 41A-90 |
| 41A-100 | Case 3BE-8: Equivalence Ratio in CMT Room SGTR..... | 41A-90 |
| 41A-101 | Case 3BE-8: Equivalence Ratio in IRWST SGTR..... | 41A-91 |
| 41A-102 | Case 3BE-8: Equivalence Ratio in PXS SGTR..... | 41A-91 |
| 41A-103 | Case 3BE-9: Reactor Coolant System Pressure SGTR..... | 41A-92 |
| 41A-104 | Case 3BE-9: Core-Exit Gas Temperature SGTR | 41A-92 |
| 41A-105 | Case 3BE-9: Reactor Vessel Mixture Level SGTR..... | 41A-93 |
| 41A-106 | Case 3BE-9: Hydrogen Generated In-Vessel SGTR | 41A-93 |
| 41A-107 | Case 3BE-9: Containment Pressure SGTR | 41A-94 |
| 41A-108 | Case 3BE-9: Containment Gas Temperature SGTR | 41A-94 |
| 41A-109 | Case 3BE-9: Containment Compartments Water Level SGTR..... | 41A-95 |
| 41A-110 | Case 3BE-9: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-95 |
| 41A-111 | Case 3BE-9: Well-Mixed Compartment Steam Concentration SGTR..... | 41A-96 |
| 41A-112 | Case 3BE-9: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-96 |
| 41A-113 | Case 3BE-9: Confined Compartment Hydrogen Concentration SGTR..... | 41A-97 |
| 41A-114 | Case 3BE-9: Confined Compartment Steam Concentration SGTR..... | 41A-97 |
| 41A-115 | Case 3BE-9: Confined Compartment Oxygen Concentration SGTR..... | 41A-98 |
| 41A-116 | Case 3BE-9: Equivalence Ratio in SG Room SGTR | 41A-98 |
| 41A-117 | Case 3BE-9: Equivalence Ratio in CMT Room SGTR..... | 41A-99 |
| 41A-118 | Case 3BE-9: Equivalence Ratio in IRWST SGTR..... | 41A-99 |
| 41A-119 | Case 3BE-9: Equivalence Ratio in PXS SGTR..... | 41A-100 |
| 41A-120 | Case 3BL-1: Reactor Coolant System Pressure SBLOCA with Failed Gravity Recirculation | 41A-100 |
| 41A-121 | Case 3BL-1: Core-Exit Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-122 | Case 3BL-1: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-123 | Case 3BL-1: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-124 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-125 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-126 | Case 3BL-1: Containment Compartments Water Level SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-127 | Case 3BL-1: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-128 | Case 3BL-1: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-129 | Case 3BL-1: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-130 | Case 3BL-1: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |
| 41A-131 | Case 3BL-1: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-132 | Case 3BL-1: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-133 | Case 3BL-1: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-134 | Case 3BL-1: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-135 | Case 3BL-1: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-136 | Case 3BL-1: Equivalence Ratio in PXS SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-137 | Case 3BL-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-138 | Case 3BL-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-139 | Case 3BL-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-140 | Case 3BL-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-141 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-142 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-143 | Case 3BL-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Recirculation | 41A-112 |
| 41A-144 | Case 3BL-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation..... | 41A-112 |
| 41A-145 | Case 3BL-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-146 | Case 3BL-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-147 | Case 3BL-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation..... | 41A-114 |
| 41A-148 | Case 3BL-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-114 |
| 41A-149 | Case 3BL-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-115 |
| 41A-150 | Case 3BL-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Recirculation | 41A-115 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-151 | Case 3BL-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-152 | Case 3BL-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-153 | Case 3BL-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Recirculation | 41A-117 |
| 41A-154 | Case 3BR-1: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-117 |
| 41A-155 | Case 3BR-1: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-156 | Case 3BR-1: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-157 | Case 3BR-1: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-119 |
| 41A-158 | Case 3BR-1: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-119 |
| 41A-159 | Case 3BR-1: Containment Gas Temperature CL LBLOCA with Accumulator Failure | 41A-120 |
| 41A-160 | Case 3BR-1: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-120 |
| 41A-161 | Case 3BR-1: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-162 | Case 3BR-1: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-163 | Case 3BR-1: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-164 | Case 3BR-1: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-165 | Case 3BR-1: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-166 | Case 3BR-1: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-167 | Case 3BR-1: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-168 | Case 3BR-1: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-169 | Case 3BR-1: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-125 |
| 41A-170 | Case 3BR-1: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure | 41A-125 |
| 41A-171 | Case 3BR-1a: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-126 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-172 | Case 3BR-1a: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-126 |
| 41A-173 | Case 3BR-1a: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-174 | Case 3BR-1a: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-175 | Case 3BR-1a: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-128 |
| 41A-176 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-128 |
| 41A-177 | Case 3BR-1a: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-178 | Case 3BR-1a: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-179 | Case 3BR-1a: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-180 | Case 3BR-1a: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-181 | Case 3BR-1a: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-182 | Case 3BR-1a: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-183 | Case 3BR-1a: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-184 | Case 3BR-1a: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-185 | Case 3BR-1a: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-186 | Case 3BR-1a: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-187 | Case 3BR-1a: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure..... | 41A-134 |
| 41A-188 | Case 3C-1: Reactor Coolant System Pressure Vessel Rupture..... | 41A-134 |
| 41A-189 | Case 3C-1: Core-Exit Gas Temperature Vessel Rupture..... | 41A-135 |
| 41A-190 | Case 3C-1: Reactor Vessel Mixture Level Vessel Rupture | 41A-135 |
| 41A-191 | Case 3C-1: Hydrogen Generated In-Vessel Vessel Rupture..... | 41A-136 |
| 41A-192 | Case 3C-1: Containment Pressure Vessel Rupture..... | 41A-136 |
| 41A-193 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 41A-137 |
| 41A-194 | Case 3C-1: Containment Compartments Water Level Vessel Rupture | 41A-137 |
| 41A-195 | Case 3C-1: Well-Mixed Compartment Hydrogen Concentration Vessel Rupture..... | 41A-138 |
| 41A-196 | Case 3C-1: Well-Mixed Compartment Steam Concentration Vessel Rupture..... | 41A-138 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-197 | Case 3C-1: Well-Mixed Compartment Oxygen Concentration Vessel Rupture..... | 41A-139 |
| 41A-198 | Case 3C-1: Confined Compartment Hydrogen Concentration Vessel Rupture..... | 41A-139 |
| 41A-199 | Case 3C-1: Confined Compartment Steam Concentration Vessel Rupture..... | 41A-140 |
| 41A-200 | Case 3C-1: Confined Compartment Oxygen Concentration Vessel Rupture..... | 41A-140 |
| 41A-201 | Case 3C-1: Equivalence Ratio in SG Room Vessel Rupture..... | 41A-141 |
| 41A-202 | Case 3C-1: Equivalence Ratio in CMT Room Vessel Rupture | 41A-141 |
| 41A-203 | Case 3C-1: Equivalence Ratio in IRWST Vessel Rupture | 41A-142 |
| 41A-204 | Case 3C-1: Equivalence Ratio in PXS Vessel Rupture | 41A-142 |
| 41A-205 | Case 3D-1: Reactor Coolant System Pressure Spurious ADS-4 with Failed CMTs | 41A-143 |
| 41A-206 | Case 3D-1: Core-Exit Gas Temperature Spurious ADS-4 with Failed CMTs | 41A-143 |
| 41A-207 | Case 3D-1: Reactor Vessel Mixture Level Spurious ADS-4 with Failed CMTs | 41A-144 |
| 41A-208 | Case 3D-1: Hydrogen Generated In-Vessel Spurious ADS-4 with Failed CMTs | 41A-144 |
| 41A-209 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs | 41A-145 |
| 41A-210 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs | 41A-145 |
| 41A-211 | Case 3D-1: Containment Compartments Water Level Spurious ADS-4 with Failed CMTs | 41A-146 |
| 41A-212 | Case 3D-1: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs | 41A-146 |
| 41A-213 | Case 3D-1: Well-Mixed Compartment Steam Concentration Spurious ADS-4 with Failed CMTs | 41A-147 |
| 41A-214 | Case 3D-1: Well-Mixed Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs | 41A-147 |
| 41A-215 | Case 3D-1: Confined Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs | 41A-148 |
| 41A-216 | Case 3D-1: Confined Compartment Steam Concentration Spurious ADS-4 with Failed CMTs | 41A-148 |
| 41A-217 | Case 3D-1: Confined Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs | 41A-149 |
| 41A-218 | Case 3D-1: Equivalence Ratio in SG Room Spurious ADS-4 with Failed CMTs | 41A-149 |
| 41A-219 | Case 3D-1: Equivalence Ratio in CMT Room Spurious ADS-4 with Failed CMTs | 41A-150 |
| 41A-220 | Case 3D-1: Equivalence Ratio in IRWST Spurious ADS-4 with Failed CMTs | 41A-150 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-221 | Case 3D-1: Equivalence Ratio in PXS Spurious ADS-4 with Failed CMTs | 41A-151 |
| 41A-222 | Case 3D-2: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs | 41A-151 |
| 41A-223 | Case 3D-2: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-224 | Case 3D-2: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-225 | Case 3D-2: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-226 | Case 3D-2: Containment Pressure Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-227 | Case 3D-2: Containment Gas Temperature Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-228 | Case 3D-2: Containment Compartments Water Level Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-229 | Case 3D-2: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-230 | Case 3D-2: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-231 | Case 3D-2: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-232 | Case 3D-2: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-233 | Case 3D-2: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-234 | Case 3D-2: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-235 | Case 3D-2: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-236 | Case 3D-2: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-237 | Case 3D-2: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs | 41A-159 |
| 41A-238 | Case 3D-2: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs..... | 41A-159 |
| 41A-239 | Case 3D-3: Reactor Coolant System Pressure DVI Line Break with no ADS | 41A-160 |
| 41A-240 | Case 3D-3: Core-Exit Gas Temperature DVI Line Break with no ADS | 41A-160 |
| 41A-241 | Case 3D-3: Reactor Vessel Mixture Level DVI Line Break with no ADS | 41A-161 |
| 41A-242 | Case 3D-3: Hydrogen Generated In-Vessel DVI Line Break with no ADS | 41A-161 |
| 41A-243 | Case 3D-3: Containment Pressure DVI Line Break with no ADS | 41A-162 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-244 | Case 3D-3: Containment Gas Temperature DVI Line Break with no ADS | 41A-162 |
| 41A-245 | Case 3D-3: Containment Compartments Water Level DVI Line Break with no ADS | 41A-163 |
| 41A-246 | Case 3D-3: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with no ADS | 41A-163 |
| 41A-247 | Case 3D-3: Well-Mixed Compartment Steam Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-248 | Case 3D-3: Well-Mixed Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-249 | Case 3D-3: Confined Compartment Hydrogen Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-250 | Case 3D-3: Confined Compartment Steam Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-251 | Case 3D-3: Confined Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-166 |
| 41A-252 | Case 3D-3: Equivalence Ratio in SG Room DVI Line Break with no ADS | 41A-166 |
| 41A-253 | Case 3D-3: Equivalence Ratio in CMT Room DVI Line Break with no ADS | 41A-167 |
| 41A-254 | Case 3D-3: Equivalence Ratio in IRWST DVI Line Break with no ADS | 41A-167 |
| 41A-255 | Case 3D-3: Equivalence Ratio in PXS DVI Line Break with no ADS..... | 41A-168 |
| 41A-256 | Case 3D-5: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-168 |
| 41A-257 | Case 3D-5: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-258 | Case 3D-5: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-259 | Case 3D-5: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-260 | Case 3D-5: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-261 | Case 3D-5: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-262 | Case 3D-5: Containment Compartments Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-263 | Case 3D-5: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-264 | Case 3D-5: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-265 | Case 3D-5: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-266 | Case 3D-5: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |
| 41A-267 | Case 3D-5: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-268 | Case 3D-5: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-269 | Case 3D-5: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-270 | Case 3D-5: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-271 | Case 3D-5: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-272 | Case 3D-5: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-273 | Case 1A-3: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-274 | Case 1A-3: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-275 | Case 1A-3: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-276 | Case 1A-3: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-277 | Case 1A-3: Containment Pressure FW Failure with Creep of SG Tubes | 41A-179 |
| 41A-278 | Case 1A-3: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-179 |
| 41A-279 | Case 1A-3: Containment Compartments Water Level FW Failure with Creep of SG Tubes..... | 41A-180 |
| 41A-280 | Case 1A-3: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-180 |
| 41A-281 | Case 1A-3: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-282 | Case 1A-3: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-283 | Case 1A-3: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-284 | Case 1A-3: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-285 | Case 1A-3: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-286 | Case 1A-3: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-287 | Case 1A-3: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-184 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-288 | Case 1A-3: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-184 |
| 41A-289 | Case 1A-3: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-185 |
| 41A-290 | Case 1A-3a: Reactor Coolant System Pressure Transient with Creep of SG Tubes | 41A-185 |
| 41A-291 | Case 1A-3a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-292 | Case 1A-3a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-293 | Case 1A-3a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-294 | Case 1A-3a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-295 | Case 1A-3a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-296 | Case 1A-3a: Containment Compartments Water Level Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-297 | Case 1A-3a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes | 41A-189 |
| 41A-298 | Case 1A-3a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-189 |
| 41A-299 | Case 1A-3a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-190 |
| 41A-300 | Case 1A-3a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-190 |
| 41A-301 | Case 1A-3a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-302 | Case 1A-3a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-303 | Case 1A-3a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes..... | 41A-192 |
| 41A-304 | Case 1A-3a: Approximate Detonation Cell Width in CMT Room Transient with Creep of SG Tubes..... | 41A-192 |
| 41A-305 | Case 1A-3a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-193 |
| 41A-306 | Case 1A-3a: Approximate Detonation Cell Width in PXS Transient with Creep of SG Tubes..... | 41A-193 |
| 41A-307 | Case 1A-4: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes | 41A-194 |
| 41A-308 | Case 1A-4: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-194 |
| 41A-309 | Case 1A-4: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-195 |
| 41A-310 | Case 1A-4: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-195 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-311 | Case 1A-4: Containment Pressure FW Failure with Creep of SG Tubes | 41A-196 |
| 41A-312 | Case 1A-4: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-196 |
| 41A-313 | Case 1A-4: Containment Compartments Water Level FW Failure with Creep of SG Tubes..... | 41A-197 |
| 41A-314 | Case 1A-4: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-197 |
| 41A-315 | Case 1A-4: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-316 | Case 1A-4: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-317 | Case 1A-4: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-318 | Case 1A-4: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-319 | Case 1A-4: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-320 | Case 1A-4: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-321 | Case 1A-4: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-201 |
| 41A-322 | Case 1A-4: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-201 |
| 41A-323 | Case 1A-4: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-202 |
| 41A-324 | Case 1A-4a: Reactor Coolant System Pressure Transient with Creep of SG Tubes..... | 41A-202 |
| 41A-325 | Case 1A-4a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-326 | Case 1A-4a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-327 | Case 1A-4a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-328 | Case 1A-4a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-329 | Case 1A-4a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-205 |
| 41A-330 | Case 1A-4a: Containment Compartments Water Level Transient with Creep of SG Tubes..... | 41A-205 |
| 41A-331 | Case 1A-4a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-332 | Case 1A-4a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-333 | Case 1A-4a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-207 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-334 | Case 1A-4a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-207 |
| 41A-335 | Case 1A-4a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-336 | Case 1A-4a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-337 | Case 1A-4a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-338 | Case 1A-4a: Equivalence Ratio in CMT Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-339 | Case 1A-4a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-340 | Case 1A-4a: Equivalence Ratio in PXS Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-341 | Case 1AP-3: Reactor Coolant System Pressure SBLOCA, Failed PRHR and CMTs..... | 41A-211 |
| 41A-342 | Case 1AP-3: Core-Exit Gas Temperature SBLOCA, Failed PRHR and CMTs..... | 41A-211 |
| 41A-343 | Case 1AP-3: Reactor Vessel Mixture Level SBLOCA, Failed PRHR and CMTs..... | 41A-212 |
| 41A-344 | Case 1AP-3: Hydrogen Generated In-Vessel SBLOCA, Failed PRHR and CMTs..... | 41A-212 |
| 41A-345 | Case 1AP-3: Containment Pressure SBLOCA, Failed PRHR and CMTs..... | 41A-213 |
| 41A-346 | Case 1AP-3: Containment Gas Temperature SBLOCA, Failed PRHR and CMTs..... | 41A-213 |
| 41A-347 | Case 1AP-3: Containment Compartments Water Level SBLOCA, Failed PRHR and CMTs..... | 41A-214 |
| 41A-348 | Case 1AP-3: Well-Mixed Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs..... | 41A-214 |
| 41A-349 | Case 1AP-3: Well-Mixed Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs..... | 41A-215 |
| 41A-350 | Case 1AP-3: Well-Mixed Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs..... | 41A-215 |
| 41A-351 | Case 1AP-3: Confined Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs..... | 41A-216 |
| 41A-352 | Case 1AP-3: Confined Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs..... | 41A-216 |
| 41A-353 | Case 1AP-3: Confined Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs..... | 41A-217 |
| 41A-354 | Case 1AP-3: Equivalence Ratio in SG Room SBLOCA, Failed PRHR and CMTs..... | 41A-217 |
| 41A-355 | Case 1AP-3: Equivalence Ratio in CMT Room SBLOCA, Failed PRHR and CMTs..... | 41A-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-356 | Case 1AP-3: Equivalence Ratio in IRWST SBLOCA, Failed PRHR and CMTs | 41A-218 |
| 41A-357 | Case 1AP-3: Equivalence Ratio in PXS SBLOCA, Failed PRHR and CMTs | 41A-219 |
| 41A-358 | Case 1AP-4: Reactor Coolant System Pressure SBLOCA with Failed PRHR and ADS | 41A-219 |
| 41A-359 | Case 1AP-4: Core-Exit Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-360 | Case 1AP-4: Reactor Vessel Mixture Level SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-361 | Case 1AP-4: Hydrogen Generated In-Vessel SBLOCA with Failed PRHR and ADS..... | 41A-221 |
| 41A-362 | Case 1AP-4: Containment Pressure SBLOCA with Failed PRHR and ADS | 41A-221 |
| 41A-363 | Case 1AP-4: Containment Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-222 |
| 41A-364 | Case 1AP-4: Containment Compartments Water Level SBLOCA with Failed PRHR and ADS | 41A-222 |
| 41A-365 | Case 1AP-4: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-366 | Case 1AP-4: Well-Mixed Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-367 | Case 1AP-4: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-368 | Case 1AP-4: Confined Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-369 | Case 1AP-4: Confined Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-370 | Case 1AP-4: Confined Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-371 | Case 1AP-4: Equivalence Ratio in SG Room SBLOCA with Failed PRHR and ADS..... | 41A-226 |
| 41A-372 | Case 1AP-4: Equivalence Ratio in CMT Room SBLOCA with Failed PRHR and ADS | 41A-226 |
| 41A-373 | Case 1AP-4: Equivalence Ratio in IRWST SBLOCA with Failed PRHR and ADS..... | 41A-227 |
| 41A-374 | Case 1AP-4: Equivalence Ratio in PXS SBLOCA with Failed PRHR and ADS | 41A-227 |
| 41B-1 | Case 3BR – LLOCA with Accumulator Failure Reactor Coolant System Pressure..... | 41B-3 |
| 41B-2 | Case 3BR – LLOCA with Accumulator Failure Reactor Vessel Mixture Level..... | 41B-3 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41B-3 | Case 3BR – LLOCA with Accumulator Failure Core-Exit Gas Temperature..... | 41B-4 |
| 41B-4 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Generated In-Vessel | 41B-4 |
| 41B-5 | Case 3BR – LLOCA with Accumulator Failure Containment Pressure..... | 41B-5 |
| 41B-6 | Case 3BR – LLOCA with Accumulator Failure Containment Gas Temperature | 41B-5 |
| 41B-7 | Case 3BR – LLOCA with Accumulator Failure Containment Compartment Hydrogen Concentration..... | 41B-6 |
| 41B-8 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through Break | 41B-6 |
| 41B-9 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Hydrogen Concentration..... | 41B-7 |
| 41B-10 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Oxygen Concentration | 41B-7 |
| 41B-11 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Steam Concentration..... | 41B-8 |
| 41B-12 | Case 3BR – LLOCA with Accumulator Failure Approximate Detonation Cell Width in Steam Generator Compartment..... | 41B-8 |
| 41B-13 | Case 3BR – LLOCA with Accumulator Failure Containment Compartments Water Level..... | 41B-9 |
| 41B-14 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through ADS to IRWST | 41B-9 |
| 41B-15 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Hydrogen Concentration..... | 41B-10 |
| 41B-16 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Oxygen Concentration | 41B-10 |
| 41B-17 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Steam Concentration..... | 41B-11 |
| 42-1 | AP1000 Containment Fragility at Containment Temperature of 400°F | 42-12 |
| 42-2 | AP1000 Containment Fragility at Containment Temperature of 331°F | 42-13 |
| 43-1 | Plant Damage State Contributions to CDF | 43-119 |
| 43-2 | Containment Event Tree – CET (Sheets 1 – 3) | 43-120 |
| 43-3 | 3BE CET (Sheets 1 – 3)..... | 43-123 |
| 43-4 | 3BL CET (Sheets 1 – 3)..... | 43-126 |
| 43-5 | 3BR CET (Sheets 1 – 3)..... | 43-129 |
| 43-6 | 1A CET (Sheets 1 – 3) | 43-132 |
| 43-7 | 1AP CET (Sheets 1 – 3)..... | 43-135 |
| 43-8 | 3A CET (Sheets 1 – 3)..... | 43-138 |
| 43-9 | 3C CET (Sheets 1 – 3) | 43-141 |
| 43-10 | 3D CET (Sheets 1 – 3)..... | 43-144 |
| 43-11 | 6 CET (Sheets 1 – 3)..... | 43-147 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 43-12 | Contribution of PDS to LRF | 43-150 |
| 43-13 | Summary of CET Quantification (Sheets 1 – 2)..... | 43-151 |
| 44-1 | MAAP4 AP1000 Containment Nodalization | 44-12 |
| 45-1 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-7 |
| 45-2 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-7 |
| 45-3 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide | 45-8 |
| 45-4 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide | 45-8 |
| 45-5 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-9 |
| 45-6 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-9 |
| 45-7 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide | 45-10 |
| 45-8 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide | 45-10 |
| 45-9 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide | 45-11 |
| 45-10 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tin | 45-11 |
| 45-11 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium..... | 45-12 |
| 45-12 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide..... | 45-12 |
| 45-13 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Noble Gases..... | 45-13 |
| 45-14 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Iodide..... | 45-13 |
| 45-15 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium Dioxide | 45-14 |
| 45-16 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Strontium Oxide | 45-14 |
| 45-17 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Molybdenum Dioxide..... | 45-15 |
| 45-18 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Hydroxide..... | 45-15 |
| 45-19 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Barium Oxide | 45-16 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-20 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Dilanthanum Trioxide | 45-16 |
| 45-21 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cerium Dioxide | 45-17 |
| 45-22 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tin | 45-17 |
| 45-23 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium | 45-18 |
| 45-24 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Uranium Dioxide | 45-18 |
| 45-25 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Noble Gases | 45-19 |
| 45-26 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Iodide | 45-19 |
| 45-27 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium Dioxide | 45-20 |
| 45-28 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Strontium Oxide | 45-20 |
| 45-29 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Molybdenum Dioxide | 45-21 |
| 45-30 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Hydroxide | 45-21 |
| 45-31 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Barium Oxide | 45-22 |
| 45-32 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Dilanthanum Trioxide | 45-22 |
| 45-33 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cerium Dioxide | 45-23 |
| 45-34 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tin | 45-23 |
| 45-35 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium | 45-24 |
| 45-36 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Uranium Dioxide | 45-24 |
| 45-37 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Noble Gases | 45-25 |
| 45-38 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Iodide | 45-25 |
| 45-39 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium Dioxide | 45-26 |
| 45-40 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Strontium Oxide | 45-26 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-41 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Molybdenum Dioxide..... | 45-27 |
| 45-42 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Hydroxide..... | 45-27 |
| 45-43 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Barium Oxide | 45-28 |
| 45-44 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Dilanthanum Trioxide | 45-28 |
| 45-45 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cerium Dioxide | 45-29 |
| 45-46 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tin | 45-29 |
| 45-47 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium..... | 45-30 |
| 45-48 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Uranium Dioxide | 45-30 |
| 45-49 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Noble Gases | 45-31 |
| 45-50 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Iodide | 45-31 |
| 45-51 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium Dioxide..... | 45-32 |
| 45-52 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Strontium Oxide..... | 45-32 |
| 45-53 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Molybdenum Dioxide | 45-33 |
| 45-54 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Hydroxide | 45-33 |
| 45-55 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Barium Oxide..... | 45-34 |
| 45-56 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Dilanthanum Trioxide..... | 45-34 |
| 45-57 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cerium Dioxide..... | 45-35 |
| 45-58 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tin..... | 45-35 |
| 45-59 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium | 45-36 |
| 45-60 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Uranium Dioxide | 45-36 |
| 45-61 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-62 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-37 |
| 45-63 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide | 45-38 |
| 45-64 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide | 45-38 |
| 45-65 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-39 |
| 45-66 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-39 |
| 45-67 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide | 45-40 |
| 45-68 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide | 45-40 |
| 45-69 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide | 45-41 |
| 45-70 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tin | 45-41 |
| 45-71 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium..... | 45-42 |
| 45-72 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide..... | 45-42 |
| 45-73 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Noble Gases..... | 45-43 |
| 45-74 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Iodide..... | 45-43 |
| 45-75 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium Dioxide | 45-44 |
| 45-76 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Strontium Oxide | 45-44 |
| 45-77 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Molybdenum Dioxide..... | 45-45 |
| 45-78 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Hydroxide..... | 45-45 |
| 45-79 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Barium Oxide | 45-46 |
| 45-80 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Dilanthanum Trioxide | 45-46 |
| 45-81 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cerium Dioxide | 45-47 |
| 45-82 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tin | 45-47 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-83 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium..... | 45-48 |
| 45-84 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Uranium Dioxide..... | 45-48 |
| 45A-1 | AP1000 Fission Product Release Fractions for Release Category CFE – Noble Gases | 45A-3 |
| 45A-2 | AP1000 Fission Product Release Fractions for Release Category CFE – CsI and RbI | 45A-3 |
| 45A-3 | AP1000 Fission Product Release Fractions for Release Category CFE – TeO ₂ | 45A-4 |
| 45A-4 | AP1000 Fission Product Release Fractions for Release Category CFE – SrO | 45A-4 |
| 45A-5 | AP1000 Fission Product Release Fractions for Release Category CFE – MoO ₂ | 45A-5 |
| 45A-6 | AP1000 Fission Product Release Fractions for Release Category CFE – CsOH and RbOH | 45A-5 |
| 45A-7 | AP1000 Fission Product Release Fractions for Release Category CFE – BaO | 45A-6 |
| 45A-8 | AP1000 Fission Product Release Fractions for Release Category CFE – La ₂ O ₃ | 45A-6 |
| 45A-9 | AP1000 Fission Product Release Fractions for Release Category CFE – CeO ₂ | 45A-7 |
| 45A-10 | AP1000 Fission Product Release Fractions for Release Category CFE – Sb | 45A-7 |
| 45A-11 | AP1000 Fission Product Release Fractions for Release Category CFE – Te ₂ | 45A-8 |
| 45A-12 | AP1000 Fission Product Release Fractions for Release Category CFE – UO ₂ | 45A-8 |
| 45A-13 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – RCS Pressure | 45A-9 |
| 45A-14 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Reactor Vessel Mixture Level..... | 45A-9 |
| 45A-15 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Core-Exit Temperature..... | 45A-10 |
| 45A-16 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – In-Vessel Hydrogen Generation | 45A-10 |
| 45A-17 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Pressure..... | 45A-11 |
| 45A-18 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Gas Temperature..... | 45A-11 |
| 45A-19 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Hydrogen Concentration..... | 45A-12 |
| 45A-20 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Noble Gases Release Fraction | 45A-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 45A-21 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsI and RbI Release Fraction..... | 45A-13 |
| 45A-22 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – TeO ₂ Release Fraction..... | 45A-13 |
| 45A-23 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – SrO Release Fraction..... | 45A-14 |
| 45A-24 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – MoO ₂ Release Fraction..... | 45A-14 |
| 45A-25 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsOH and RbOH Release Fraction..... | 45A-15 |
| 45A-26 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – BaO Release Fraction..... | 45A-15 |
| 45A-27 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – La ₂ O ₃ Release Fraction..... | 45A-16 |
| 45A-28 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CeO ₂ Release Fraction..... | 45A-16 |
| 45A-29 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Sb Release Fraction..... | 45A-17 |
| 45A-30 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Te ₂ Release Fraction..... | 45A-17 |
| 45A-31 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – UO ₂ Release Fraction..... | 45A-18 |
| 45A-32 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Containment Pressure..... | 45A-18 |
| 45A-33 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Noble Gases Release Fraction..... | 45A-19 |
| 45A-34 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsI and RbI Release Fraction..... | 45A-19 |
| 45A-35 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – TeO ₂ Release Fraction..... | 45A-20 |
| 45A-36 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – SrO Release Fraction..... | 45A-20 |
| 45A-37 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – MoO ₂ Release Fraction..... | 45A-21 |
| 45A-38 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsOH and RbOH Release Fraction..... | 45A-21 |
| 45A-39 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – BaO Release Fraction..... | 45A-22 |
| 45A-40 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – La ₂ O ₃ Release Fraction..... | 45A-22 |
| 45A-41 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CeO ₂ Release Fraction..... | 45A-23 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45A-42 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Sb Release Fraction..... | 45A-23 |
| 45A-43 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Te ₂ Release Fraction | 45A-24 |
| 45A-44 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – UO ₂ Release Fraction..... | 45A-24 |
| 49-1 | Population Whole Body Dose – BP Source Term, 24 Hours | 49-20 |
| 49-2 | Population Whole Body Dose – BP Source Term 72 Hours | 49-20 |
| 49-3 | Site Boundary Whole Body Dose – BP Source Term, 24 Hours..... | 49-21 |
| 49-4 | Site Boundary Whole Body Dose – BP Source Term, 72 Hours..... | 49-21 |
| 49-5 | Site Boundary Red Bone Marrow Dose – BP Source Term, 24 Hours | 49-22 |
| 49-6 | Site Boundary Red Bone Marrow Dose – BP Source Term, 72 Hours | 49-22 |
| 49-7 | Site Boundary Thyroid Dose – BP Source Term, 24 Hours | 49-23 |
| 49-8 | Site Boundary Thyroid Dose – BP Source Term, 72 Hours | 49-23 |
| 49-9 | Population Whole Body Dose – CFE Source Term, 24 Hours..... | 49-24 |
| 49-10 | Population Whole Body Dose – CFE Source Term, 72 Hours..... | 49-24 |
| 49-11 | Site Boundary Whole Body Dose – CFE Source Term, 24 Hours | 49-25 |
| 49-12 | Site Boundary Whole Body Dose – CFE Source Term, 72 Hours | 49-25 |
| 49-13 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 24 Hours..... | 49-26 |
| 49-14 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 72 Hours..... | 49-26 |
| 49-15 | Site Boundary Thyroid Dose – CFE Source Term, 24 Hours..... | 49-27 |
| 49-16 | Site Boundary Thyroid Dose – CFE Source Term, 72 Hours..... | 49-27 |
| 49-17 | Population Whole Body Dose – CFI Source Term, 24 Hours | 49-28 |
| 49-18 | Population Whole Body Dose – CFI Source Term, 72 Hours | 49-28 |
| 49-19 | Site Boundary Whole Body Dose – CFI Source Term, 24 Hours | 49-29 |
| 49-20 | Site Boundary Whole Body Dose – CFI Source Term, 72 Hours | 49-29 |
| 49-21 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 24 Hours..... | 49-30 |
| 49-22 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 72 Hours..... | 49-30 |
| 49-23 | Site Boundary Thyroid Dose – CFI Source Term, 24 Hours..... | 49-31 |
| 49-24 | Site Boundary Thyroid Dose – CFI Source Term, 72 Hours..... | 49-31 |
| 49-25 | Population Whole Body Dose – CFL Source Term, 24 Hours..... | 49-32 |
| 49-26 | Population Whole Body Dose – CFL Source Term, 72 Hours..... | 49-32 |
| 49-27 | Site Boundary Whole Body Dose – CFL Source Term, 24 Hours | 49-33 |
| 49-28 | Site Boundary Whole Body Dose – CFL Source Term, 72 Hours | 49-33 |
| 49-29 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 24 Hours..... | 49-34 |
| 49-30 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 72 Hours..... | 49-34 |
| 49-31 | Site Boundary Thyroid Dose – CFL Source Term, 24 Hours..... | 49-35 |
| 49-32 | Site Boundary Thyroid Dose – CFL Source Term, 72 Hours..... | 49-35 |
| 49-33 | Population Whole Body Dose – CI Source Term, 24 Hours | 49-36 |
| 49-34 | Population Whole Body Dose – CI Source Term, 72 Hours | 49-36 |
| 49-35 | Site Boundary Whole Body Dose – CI Source Term, 24 Hours..... | 49-37 |
| 49-36 | Site Boundary Whole Body Dose – CI Source Term, 72 Hours..... | 49-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 49-37 | Site Boundary Red Bone Marrow Dose – CI Source Term, 24 Hours | 49-38 |
| 49-38 | Site Boundary Red Bone Marrow Dose – CI Source Term, 72 Hours | 49-38 |
| 49-39 | Site Boundary Thyroid Dose – CI Source Term, 24 Hours | 49-39 |
| 49-40 | Site Boundary Thyroid Dose – CI Source Term, 72 Hours | 49-39 |
| 49-41 | Population Whole Body Dose – DIRECT Source Term, 24 Hours | 49-40 |
| 49-42 | Population Whole Body Dose – DIRECT Source Term, 72 Hours | 49-40 |
| 49-43 | Site Boundary Whole Body Dose – DIRECT Source Term, 24 Hours | 49-41 |
| 49-44 | Site Boundary Whole Body Dose – DIRECT Source Term, 72 Hours | 49-41 |
| 49-45 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 24 Hours | 49-42 |
| 49-46 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 72 Hours | 49-42 |
| 49-47 | Site Boundary Thyroid Dose – DIRECT Source Term, 24 Hours | 49-43 |
| 49-48 | Site Boundary Thyroid Dose – DIRECT Source Term, 72 Hours | 49-43 |
| 49-49 | Population Whole Body Dose – IC Source Term, 24 Hours | 49-44 |
| 49-50 | Population Whole Body Dose – IC Source Term, 72 Hours | 49-44 |
| 49-51 | Site Boundary Whole Body Dose – IC Source Term, 24 Hours | 49-45 |
| 49-52 | Site Boundary Whole Body Dose – IC Source Term, 72 Hours | 49-45 |
| 49-53 | Site Boundary Red Bone Marrow Dose – IC Source Term, 24 Hours | 49-46 |
| 49-54 | Site Boundary Red Bone Marrow Dose – IC Source Term, 72 Hours | 49-46 |
| 49-55 | Site Boundary Thyroid Dose – IC Source Term, 24 Hours | 49-47 |
| 49-56 | Site Boundary Thyroid Dose – IC Source Term, 72 Hours | 49-47 |
| 49-57 | Overall Dose Risk – Site Boundary Whole Body EDE Dose, 24 Hours | 49-48 |
| 49-58 | Overall Dose Risk – Site Boundary Red Bone Marrow Dose (Acute), 24 Hours | 49-49 |
| 51-1 | AP1000 Base Core Damage Frequency Uncertainty Analysis | 51-11 |
| 51-2 | AP1000 Sensitivity Case Uncertainty Analysis | 51-11 |
| 51B-1 | Distribution for Plant Core Damage Frequency | 51B-2 |
| 51B-2 | Safety Injection Line Break | 51B-2 |
| 51B-3 | Large LOCA | 51B-3 |
| 51B-4 | Large Spurious ADS Actuation | 51B-3 |
| 51B-5 | Small LOCA | 51B-4 |
| 51B-6 | Medium LOCA | 51B-4 |
| 51B-7 | Reactor Vessel Rupture | 51B-5 |
| 51B-8 | Steam Generator Tube Rupture | 51B-5 |
| 51B-9 | Safety Injection Line Break – Sequence 7 | 51B-6 |
| 51B-10 | Large LOCA – Sequence 9 | 51B-6 |
| 51B-11 | Spurious ADS – Sequence 8 | 51B-7 |
| 51B-12 | Safety Injection Line Break – Sequence 8d | 51B-7 |
| 51B-13 | Reactor Vessel Rupture – Sequence 2 | 51B-8 |
| 51B-14 | Small LOCA – Sequence 5 | 51B-8 |
| 51B-15 | Medium LOCA – Sequence 5 | 51B-9 |
| 51B-16 | Small LOCA – Sequence 12 | 51B-9 |
| 51B-17 | Medium LOCA – Sequence 12 | 51B-10 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 51B-18 | Spurious ADS – Sequence 9 | 51B-10 |
| 51B-19 | Spurious ADS – Sequence 7 | 51B-11 |
| 51B-20 | Safety Injection Line Break – Sequence 3..... | 51B-11 |
| 51B-21 | SGTR Event – Sequence 41 | 51B-12 |
| 51B-22 | ATWS Precursor with no MFW – Sequence 23 | 51B-12 |
| 51B-23 | Small LOCA – Sequence 9 | 51B-13 |
| 51B-24 | Medium LOCA – Sequence 9 | 51B-13 |
| 51B-25 | SGTR Event – Sequence 13 | 51B-14 |
| 51B-26 | Large LOCA – Sequence 8 | 51B-14 |
| 51B-27 | CMT Line Break – Sequence 5 | 51B-15 |
| 54-1 | Loss of Offsite Power During Hot/Cold Shutdown (RCS Filled) Event Tree (Sheets 1 – 2) | 54-162 |
| 54-2 | Loss of RNS During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-164 |
| 54-3 | Loss of CCW/SW During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-165 |
| 54-4 | LOCA/RNS-V024 Opens During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-166 |
| 54-5 | LOCA/RNS Pipe Rupture During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-167 |
| 54-6 | Overdraining of Reactor Coolant System During Drindown to Mid-loop Event Tree | 54-168 |
| 54-7 | Loss of Offsite Power During RCS Drained Condition Event Tree | 54-169 |
| 54-8 | Loss of RNS During RCS Drained Condition Event Tree | 54-170 |
| 54-9 | Loss of CCW/SW During RCS Drained Condition Event Tree | 54-171 |
| 54-10 | LOCA/RNS-V024 Opens During RCS Drained Condition Event Tree..... | 54-172 |
| 55-1 | Seismic Initiating Event Hierarchy Tree | 55-30 |
| 57-1 | Example Event Tree Model..... | 57-125 |
| 57-2 | Contribution of Plant Areas to Fire CDF | 57-126 |
| 57-3 | Contribution of Fire Area to Fire CDF | 57-127 |
| 57A-1 | DAS-ACT Fault Tree..... | 57A-37 |
| 57C-1 | 0000 AF 00 Yard Building (Including Transformer Yard) | 57C-12 |
| 57C-2 | 1200 AF 01 RCA of Auxiliary Building (All Zones)..... | 57C-13 |
| 57C-3 | 1200 AF 02 New Fuel and Used Fuel Storage, Waste Disposal Container (All Zones)..... | 57C-14 |
| 57C-4 | 1200 AF 03 Corridors 100' & 117' 6" | 57C-15 |
| 57C-5 | 1201 AF 02 Division B Batteries/DC Equipment Room/Instrumentation and Control..... | 57C-16 |
| 57C-6 | 1201 AF 03 Division D DC Equipment/I&C | 57C-17 |
| 57C-7 | 1201 AF 04 Division B/D VBS Equipment..... | 57C-18 |
| 57C-8 | 1201 AF 05 MSIV Compartment A | 57C-19 |
| 57C-9 | 1201 AF 06 MSIV Compartment B | 57C-20 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 57C-10 | 1202 AF 02 Northeast Elevator Shaft | 57C-21 |
| 57C-11 | 1202 AF 03 Division C Batteries/DC Equipment/I&C Room/ RCP Trip Switchgear Room/I&C Penetration Room | 57C-22 |
| 57C-12 | 1202 AF 04 Division A Electrical Equipment/Battery Room/I&C Room..... | 57C-23 |
| 57C-13 | 1204 AF 01 RNS Pump Room B | 57C-24 |
| 57C-14 | 1204 AF 03 South Shield Building Elevator Shaft | 57C-25 |
| 57C-15 | 1205 AF 02 Southeast Elevator Shaft | 57C-26 |
| 57C-16 | 1210 AF 01 Corridor/Spare Battery Room/Spare Room/Spare Battery Charger Room | 57C-27 |
| 57C-17 | 1220 AF 01 Division B RCP Trip Switchgear/Spare Room/Corridor 82' 6" | 57C-28 |
| 57C-18 | 1220 AF 02 Lower Annulus Valve Area..... | 57C-29 |
| 57C-19 | 1230 AF 01 Corridor Division A, B, C, D and Remote Shutdown Workstation..... | 57C-30 |
| 57C-20 | 1230 AF 02 Non-Class 1E Electrical Compartment - 100' | 57C-31 |
| 57C-21 | 1232 AF 01 Remote Shutdown Workstation..... | 57C-32 |
| 57C-22 | 1240 AF 01 Non-Class 1E Electrical Compartment - 117' | 57C-33 |
| 57C-23 | 1242 AF 02 Division A Penetration Area | 57C-34 |
| 57C-24 | 1243 AF 01 Reactor Trip Switchgear I | 57C-35 |
| 57C-25 | 1243 AF 02 Reactor Trip Switchgear II | 57C-36 |
| 57C-26 | 1250 AF 01 Nonradioactive Ventilation System..... | 57C-37 |
| 57C-27 | 2000 AF 01 Turbine Building Floor | 57C-38 |
| 57C-28 | 2003 AF 01 Auxiliary Boiler Equipment Room | 57C-39 |
| 57C-29 | 2009 AF 02 Elevator Machine Room..... | 57C-40 |
| 57C-30 | 2033 AF 02 Motor-Driven Fire Pump Room..... | 57C-41 |
| 57C-31 | 2040 AF 01 Clean and Dirty Lube Oil Storage..... | 57C-42 |
| 57C-32 | 2043 AF 01 Chemical Laboratory..... | 57C-43 |
| 57C-33 | 2050 AF 01 Lube Oil Conditioner Room..... | 57C-44 |
| 57C-34 | 2052 AF 01 Southwest 6.9KV Switchgear Room..... | 57C-45 |
| 57C-35 | 2053 AF 01 Electrical Equipment Room | 57C-46 |
| 57C-36 | 2053 AF 02 Northwest 6.9KV Switchgear Room..... | 57C-47 |
| 57C-37 | 4003 AF 01 Demineralized Water Deoxygenating Room/ Air Handling Equipment Rooms..... | 57C-48 |
| 57C-38 | 4031 AF 01 Battery Room and Battery Charger Room 1..... | 57C-49 |
| 57C-39 | 4031 AF 02 Battery Room and Battery Charger Room 2/ Computer Room B/Shift Turnover Room | 57C-50 |
| 57C-40 | 4031 AF 05 Corridor/Spare Battery Room/Spare Room/ Spare Battery Charger Room..... | 57C-51 |
| 57C-41 | 4031 AF 06 Central Alarm Station/Security Room 1..... | 57C-52 |
| 57C-42 | 4032 AF 01 Decontamination Room, Non-Radiological and Radiological Controlled Area Entry/Exit Area..... | 57C-53 |
| 57C-43 | 4032 AF 02 Containment Access Corridor Elevation 107' 2"..... | 57C-54 |
| 57C-44 | 4033 AF 01 Hot Machine Shop | 57C-55 |
| 57C-45 | 4034 AF 01 General Offices | 57C-56 |
| 57C-46 | 4041 AF 01 Conference Rooms/Computer Room A/Corridor..... | 57C-57 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 57C-47 | 4041 AF 02 Corridor/Restroom | 57C-58 |
| 57C-48 | 4042 AF 01 Non-Class 1E Switchgear #1..... | 57C-59 |
| 57C-49 | 4042 AF 02 Non-Class 1E Switchgear #2..... | 57C-60 |
| 57C-50 | 4052 AF 01 Staging and Storage Area/Containment Air Filtration Exhaust Rooms A & B | 57C-61 |
| 57C-51 | 5031 AF 01 Radwaste Building | 57C-62 |
| 57C-52 | 6030 AF 01 Diesel Generator Room A | 57C-63 |
| 57C-53 | 6030 AF 02 Diesel Generator Room B | 57C-64 |
| 57C-54 | 6030 AF 03 Fuel Oil Day Tank Room A | 57C-65 |
| 57C-55 | 6030 AF 04 Fuel Oil Day Take Room B..... | 57C-66 |
| 57C-56 | 1100 AF 11204 Reactor Coolant Drain Tank Room..... | 57C-67 |
| 57C-57 | 1100 AF 11206 Accumulator Room A | 57C-68 |
| 57C-58 | 1100 AF 11207 Accumulator Room B | 57C-69 |
| 57C-59 | 1100 AF 11208 RNS Valve Room..... | 57C-70 |
| 57C-60 | 1100 AF 11300A Maintenance Floor (SE Quadrant Access) | 57C-71 |
| 57C-61 | 1100 AF 11300B Maintenance Floor (NNE Quadrant) and RCDT Access..... | 57C-72 |
| 57C-62 | 1100 AF 11301 SG Compartment 1..... | 57C-73 |
| 57C-63 | 1100 AF 11302 SG Compartment 2..... | 57C-74 |
| 57C-64 | 1100 AF 11303 Pressurizer Compartment | 57C-75 |
| 57C-65 | 1100 AF 11303A ADS Lower Valve Area | 57C-76 |
| 57C-66 | 1100 AF 11303B ADS Upper Valve Area..... | 57C-77 |
| 57C-67 | 1100 AF 11500 Operating Deck | 57C-78 |
| 57C-68 | 1200 AF 12341 Middle Annulus | 57C-79 |
| 57C-69 | 1200 AF 12555 Main Control Room Emergency Habitability System Air Storage/Operating Deck Staging Area | 57C-80 |
| 59-1 | Contribution of Initiating Events to Core Damage | 59-99 |
| 59-2 | 24-Hour Site Boundary Dose Cumulative Frequency Distribution | 59-100 |

REVISION 1 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 1 Change Roadmap | ci through civ | Editorial |
| 1 | 1-6 | Editorial |
| 3 | 3-4 | Editorial |
| Attachment 4B | 4B-24 | 720.027 |
| Attachment 4B | 4B-74 | Editorial |
| 6 | 6-9 | 720.025 (720.029) |
| 6 | 6-12 | 720.025 (720.029) Editorial |
| 6 | 6-16 | Editorial |
| 6 | 6-17 | 720.026 |
| 6 | 6-19 through 6-53 | 720.023 (720.024) (720.097) |
| 6 | 6-62 | 720.031 |
| 6 | 6-69 | 720.025 (720.029) |
| 6 | 6-71 | 720.025 (720.029) |
| 8 | 8-23 and 8-25 | Editorial |
| 12 | 12-6 | 720.033 |
| 12 | 12-30 | 720.033 |
| 26 | 26-11 and 26-12 | Editorial |
| 28 | 28-10 and 28-11 | Editorial |
| 29 | 29-17 | 720.033 |
| 29 | 29-21 | 720.033 |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|---|
| 30 | 30-35 and 30-36 | 720.068 |
| 30 | 30-66 and 30-67 | 720.068 |
| 30 | 30-110 | Editorial |
| 34 | 34-1 | 720.042 |
| 34 | 34-4 and 34-5 | 720.042 |
| 34 | 34-6 and 34-7 | 720.042 |
| | | Editorial |
| 34 | 34-8 through 34-243 | 720.042 |
| 35 | 35-28 | 720.043 |
| 39 | 39-4 | 720.073 |
| | | Editorial |
| 39 | 39-5 | 720.088 |
| | | (720.048, 720.074, 720.083, 720.089) |
| 39 | 39-6 | 720.088 |
| | | 720.073 |
| | | (720.048, 720.074, 720.083, and 720.089) |
| 39 | 39-12 | Editorial |
| 39 | 39-19 | Editorial |
| 39 | 39-20 | 720.073 |
| 39 | 39-21 | Editorial |
| | | 720.088 |
| Attachment 39A | 39A-1 through 39A-40 | 720.088 |
| | | (720.048, 720.074, 720.083, and 720.089) |
| 41 | 41-6 | 720.042 |
| 41 | 41-15 | 720.093 |
| 41 | 41-20 | 720.054 |
| 41 | 41-31 | Editorial |
| Attachment 41A | 41A-1 through 41A-228 | 720.042 |
| Attachment 41B | 41B-1 through 41B-11 | 720.093 |
| 43 | 43-126 and 43-127 | Editorial |
| Attachment 43C | 43C-1 and 43C-2 | 720.043 |
| 44 | 44-7 | Editorial |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|----------------------|--|
| 45 | 45-1 through 45-3 | 470.013 (470.012) |
| 45 | 45-4 | 470.013 (470.012) Editorial |
| 45 | 45-5 through 45-48 | 470.013 (470.012) |
| 49 | 49-1 | 720.056 |
| 49 | 49-4 through 49-6 | 720.056 |
| 49 | 49-9 through 49-49 | 720.056 |
| 50 | 50-14 | 720.034 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 57 | 57-1 through 57-109 | Letter DCP/NRC1515 |
| Attachment 57A | 57A-1 through 57A-37 | Letter DCP/NRC1515 |
| Attachment 57B | 57B-1 through 57B-6 | Letter DCP/NRC1515 |
| Attachment 57C | 57C-1 through 57C-80 | Letter DCP/NRC1515 |
| Attachment 57D | 57D-1 through 57D-7 | Letter DCP/NRC1515 |
| 59 | 59-20 and 59-21 | Editorial |
| 59 | 59-23 through 59-25 | Letter DCP/NRC1515 |
| 59 | 59-26 | 720.056 |
| 59 | 59-28 | Editorial |
| 59 | 59-29 through 59-32 | 720.038 |
| 59 | 59-34 through 59-38 | 720.038 |
| 59 | 59-72 | Editorial |
| 59 | 59-73 | Technical |
| 59 | 59-83 | Editorial |
| 59 | 59-75 through 59-96 | 720.038 |
| 59 | 59-97 | 720.038 720.066 |
| 59 | 59-98 | 720.038 |
| 59 | 59-100 | Technical |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-------------------|-------------------------------------|
| Appendix A | A-1 through A-166 | 720.007 |
| | | 720.010 |
| | | 720.011 |
| | | 720.012 |
| | | 720.013 |
| | | 720.015 |
| | | 720.016 |
| Appendix B | B-6 | 720.058 |
| Appendix B | B-13 | 720.076 |
| Appendix D | D-14 and D-15 | 720.078 |
| Appendix D | D-31 | 720.078 |
| Appendix D | D-35 and D-36 | Technical |
| Appendix D | D-37 through D-58 | 720.078 |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number. RAI number in parenthesis contains a reference to RAI response listed above.

REVISION 2 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 2 Change Roadmap | cv through cvii | Editorial |
| 6 | 6-17 | 720.026 (R1) |
| 6 | 6-28 | 720.024 (R1) |
| 6 | 6-32 and 6-33 | 720.024 (R1) |
| 6 | 6-37 through 6-39 | 720.024 (R1) |
| 6 | 6-41 | 720.024 (R1) |
| 6 | 6-50 through 6-53 | 720.024 (R1) |
| 6 | 6-69 | 720.029 (R1) |
| 24 | 24-17 | 720.046 (R1) |
| 24 | 24-22 and 24-23 | 720.046 (R1) |
| 24 | 24-27 | 720.046 (R1) |
| 30 | 30-26a through 30-28 | 720.029 (R1) |
| 35 | 35-28 | 720.043 (R1) |
| 43 | 43-9 and 43-9a | 720.039 (R2) |
| 43 | 43-9b | Editorial |
| 43 | 43-10a | 720.039 (R2) |
| 43 | 43-10b | Editorial |
| 43 | 43-93a through 43-93w | 720.039 (R2) |
| 43 | 93-93x | Editorial |
| Attachment 43C | 43C-2 | 720.043 (R1) |
| 50 | 50-1 | |
| 50 | 50-1a and 50-1b | Editorial |
| 50 | 50-14 | 720.039 (R2) |
| 50 | 50-14a | 720.039 (R2) |
| 50 | 50-14b | Editorial |
| 54 | 54-1 through 54-131 | 720.038 (R2) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|-------------------------------------|
| 56 | 56-1 | 720.038 (R1) Editorial |
| 56 | 56-9 | Editorial |
| 56 | 56-17 and 56-18 | Editorial |
| 56 | 56-20 | Editorial |
| 56 | 56-36 and 56-37 | Editorial |
| 56 | 56-38 | Editorial |
| | | 720.038 (R1) |
| 56 | 56-38a through 56-38k | 720.038 (R1) |
| 56 | 56-38l | Editorial |
| 56 | 56-47 through 56-49 | Editorial |
| 56 | 56-51 | Editorial |
| 56 | 56-54 and 56-55 | 720.038 (R1) |
| 57 | 57-14 and 57-15 | 280.011 (R1) |
| 57 | 57-15a and 57-15b | Editorial |
| 59 | 59-23 and 59-23a | 720.038 (R1) |
| 59 | 59-23b | Editorial |
| 59 | 59-34 | 720.038 (R1) |
| 59 | 59-72 | 720.038 (R1) |
| Appendix A | A-12 | Editorial |
| Appendix A | A-24 through A-26 | 440.014 (R1) |
| Appendix A | A-26a | 440.014 (R1) 720.024 (R1) |
| Appendix A | A-26b | Editorial |
| Appendix A | A-27 | 720.012 (R1) |
| Appendix A | A-31 | 720.012 (R1) |
| Appendix A | A-33 | 720.010 (R1) |
| Appendix A | A-33a and A-33b | Editorial |
| Appendix A | A-44 | Editorial |
| Appendix A | A-57 through A-61 | 720.012 (R1) |
| Appendix A | A-63 | 720.012 (R1) |
| Appendix A | A-66 | 720.012 (R1) |
| Appendix A | A-103a through A-103b | 440.014 (R1) |
| Appendix A | A-103c and A-103d | 720.012 (R1) |
| Appendix A | A-151 and A-152 | 720.013 (R1) |
| Appendix A | A-165 and A-166 | 720.013 (R1) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------|-------------------------------------|
| Appendix D | D-13 and D-14 | 720.080 (R1) |
| Appendix D | D-35 and D-36 | 720.080 (R1) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 3 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|--------------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through cii | Editorial |
| Revision 3 Change Roadmap | cx | Editorial |
| Attachment 45A | 45A-1 through 45A-24 | Technical |
| 57 | 57-1 and 57-2 | Editorial |
| 57 | 57-4 | Editorial |
| 57 | 57-11 and 57-12 | Editorial |
| 57 | 57-17 | Editorial |
| 57 | 57-22 and 57-23 | Editorial |
| 57 | 57-30 through 57-39 | 720.038 (R1) |
| 57 | 57-40 | 720.038 (R1) |
| | | Editorial |
| 57 | 57-41 and 57-42 | 720.038 (R1) |
| 57 | 57-78 | Editorial |
| 57 | 57-117 through 57-124 | 720.038 (R1) |
| Appendix A | A-23 through A-25 | 720.009 (R2) |
| Appendix A | A-105 through A-111 | 720.009 (R2) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 4 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|---|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 4 Change Roadmap | cxii and cxiii | Editorial |
| 34 | 34-4 | Editorial |
| 34 | 34-16 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-19 through 34-21 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-50 and 34-51 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-247 through 34-264 | DSER OI 19.1.10.3-1 (R1) |
| 42 | 42-3 | DSER OI 19.2.6-1 (R1) |
| 42 | 42-6 | DSER OI 19.2.6-3 |
| 42 | 42-7 and 42-8 | Editorial |
| 43 | 43-10 | Editorial |
| 43 | 43-13 | Editorial |
| Attachment 43D | 43D-1 | DSER OI 19.1.3.2-1 |
| Attachment 43E | 43E-1 and 43E-2 | DSER OI 19.1.3.2-2 |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-5 and 45-6 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-13 through 45-18 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R1) |
| Attachment 45A | 45A-1 through 45A-24 | Deleted per DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-6 | DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-9 through 49-49 | DSER OI 19.1.10.3-1 (R1) |
| 50 | 50-1 | Editorial |
| 54 | 54-9 | DSER OI 19.1.10.2-3 |
| 54 | 54-12 | DSER OI 19.1.10.2-3 |
| 54 | 54-13 | Editorial |
| 54 | 54-22 through 54-71 | Editorial |
| 54 | 54-76 through 54-80 | DSER OI 19.1.10.2-5 Editorial |

REVISION 4 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|---|
| 54 | 54-83 through 54-110 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-112 through 54-118 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-121 through 54-137 | DSER OI 19.1.10.2-3 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) Editorial |
| 55 | 55-16 through 55-18 | Editorial |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 55 | 55-25 through 55-29 | Editorial |
| 56 | 56-46 | DSER OI 19.3.10-1 |
| 59 | 59-26 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-37 | DSER OI 19A.3-2 (R1) |
| 59 | 59-45 through 59-70 | Editorial |
| 59 | 59-73 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-74 | Editorial |
| 59 | 59-100 | DSER OI 19.1.10.3-1 (R1) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 5 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 5 Change Roadmap | cxiv and cxv | Editorial |
| 43 | 43-10 and 43-11 | DSER OI 19.1.3.2-2 (R1) |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R2) |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R2) |
| | | Editorial |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R2) |
| 54 | 54-3 | Editorial |
| 54 | 54-11 | DSER OI 19.1.10.2-4 (R1) |
| 54 | 54-76 through 54-99 | DSER OI 19.1.10.2-4 (R1) |
| 55 | 55-23 | DSER OI 19A.2-8 (R2) |
| 59 | 59-45 | Editorial |
| 59 | 59-77 | Editorial |
| 59 | 59-81 | Editorial |
| 59 | 59-83 | Editorial |
| 59 | 59-90 | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.1-2 (R2) |
| Appendix A | A-8 | Editorial |
| Appendix A | A-17 | Editorial |
| Appendix A | A-19 | Editorial |
| Appendix A | A-21 | Editorial |
| Appendix A | A-23 and A-24 | DSER OI 19.1.10.1-5 (R2) |
| | | Editorial |
| Appendix A | A-25 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-43 | Editorial |
| Appendix A | A-45 and A-46 | DSER OI 19.1.10.1-5 (R2) |
| | | Editorial |
| Appendix A | A-47 and A-48 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-104 through A-109 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-154 through A-158 | DSER OI 19.1.10.1-5 (R2) |

REVISION 5 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change</u>⁽¹⁾ |
|-----------------------|------------------------|--|
| Appendix A | A-159 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-160 and A-161 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-162 and A-163 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-164 through A-175 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-176 and A-177 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-178 through A-181 | DSER OI 19.1.10.1-5 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 6 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 6 Change Roadmap | cxvi | Editorial |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R3) |
| 55 | 55-11 | Editorial |
| 55 | 55-20 | Editorial |
| 55 | 55-21 through 55-24 | Editorial (per Oct. 6-9 meeting) |
| 59 | 59-98 | DSER OI 19.1.10.2-6 (R2) |
| Appendix A | A-41 | DSER OI 21.5-2 |
| Appendix A | A-46 and A-47 | DSER OI 15.2.7-1 Item 7 (R5) |
| Appendix A | A-135 through A-141 | DSER OI 21.5-2 |
| Appendix A | A-154 through A-167 | DSER OI 15.2.7-1 Item 7 (R5) |

- Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 7 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through cihi | Editorial |
| Revision 7 Change Roadmap | cxvii | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.2-1 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 8 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 8 Change Roadmap | cxviii | Editorial |
| 59 | 59-92 | NRC Comments |
| 59 | 59-98 | NRC Comments |

Volume 2

TABLE OF CONTENTS

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------------|--|-------------|
| | LIST OF TABLES | xxxv |
| | LIST OF FIGURES | liii |
| | REVISION 1 CHANGE ROADMAP | civ |
| | REVISION 2 CHANGE ROADMAP | cviii |
| | REVISION 3 CHANGE ROADMAP | cxi |
| | REVISION 4 CHANGE ROADMAP | cxii |
| | REVISION 5 CHANGE ROADMAP | cxiv |
| | REVISION 6 CHANGE ROADMAP | cxvi |
| | REVISION 7 CHANGE ROADMAP | cxvii |
| | REVISION 8 CHANGE ROADMAP | cxviii |
| CHAPTER 1 | INTRODUCTION | |
| 1.1 | Introduction | 1-1 |
| 1.1.1 | Background and Overview | 1-1 |
| 1.1.2 | Objectives | 1-1 |
| 1.1.3 | Technical Scope | 1-2 |
| 1.1.4 | Project Methodology Overview | 1-3 |
| 1.1.5 | Results | 1-4 |
| 1.1.6 | Plant Definition | 1-6 |
| 1.1.7 | References | 1-6 |
| CHAPTER 2 | INTERNAL INITIATING EVENTS | |
| 2.1 | Introduction | 2-1 |
| 2.2 | Internal Initiating Event Identification and Categorization | 2-1 |
| 2.2.1 | Logic Diagram for Internal Initiating Events | 2-2 |
| 2.2.2 | Loss-of-Coolant Accidents | 2-3 |
| 2.2.3 | Transients | 2-6 |
| 2.2.4 | Anticipated Transient without Scram | 2-8 |
| 2.2.5 | AP1000 Specific Initiating Event Analysis | 2-10 |
| 2.2.6 | Consequential Events | 2-19 |
| 2.2.7 | Summary of Internal Initiating Event Categories | 2-19 |
| 2.3 | Internal Initiating Event Frequency Quantification | 2-20 |
| 2.3.1 | Quantification of LOCA Initiating Event Frequencies | 2-20 |
| 2.3.2 | Quantification of Transient Initiating Event Frequencies | 2-24 |
| 2.3.3 | ATWS Precursor Initiating Event Frequency | 2-27 |
| 2.3.4 | Summary of Internal Initiating Event Frequencies | 2-27 |
| 2.4 | References | 2-27 |
| ATTACHMENT 2A | QUANTIFICATION OF LOCA INITIATING EVENT FREQUENCIES | |
| 2A-1 | Primary System Pipe Break Frequencies | 2A-1 |
| 2A-2 | Reactor Cooling System Leakage Initiating Event Frequency | 2A-1 |
| 2A-3 | Steam Generator Tube Rupture Initiating Event Frequency | 2A-1 |
| 2A-4 | Quantification of Stuck-Open Pressurizer Safety Valve, Accumulator Interface Break, and IRWST Interface Break | 2A-1 |
| 2A-5 | Initiating Events Review Data Summary and INPO Data | 2A-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| ATTACHMENT 2B QUANTIFICATION OF TRANSIENT INITIATING EVENT FREQUENCIES | | |
| 2B-1 | Secondary Side Line Breaks & Stuck-open Main Steam Line Safety Valve Frequencies..... | 2B-1 |
| CHAPTER 3 MODELING OF SPECIAL INITIATORS | | |
| 3.1 | Introduction..... | 3-1 |
| 3.2 | Ground Rules for Special Initiating Event Analysis..... | 3-1 |
| 3.3 | Loss of Component Cooling Water System/Service Water System Initiating Event..... | 3-1 |
| 3.4 | Loss of Compressed and Instrument Air System Initiating Event..... | 3-2 |
| 3.5 | Spurious Actuation of Automatic Depressurization System..... | 3-2 |
| 3.5.1 | Evaluation of Automatic Depressurization System Spurious Actuation..... | 3-3 |
| CHAPTER 4 EVENT TREE MODELS | | |
| 4.1 | Introduction..... | 4-1 |
| 4.2 | Large LOCA Event Tree Model..... | 4-1 |
| 4.2.1 | Event Description..... | 4-1 |
| 4.2.2 | Event Tree Model and its Nodes..... | 4-2 |
| 4.2.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-4 |
| 4.2.4 | Operator Actions..... | 4-4 |
| 4.2.5 | Transfers and Consequential Events..... | 4-4 |
| 4.3 | Large Spurious ADS Event Tree Model..... | 4-4 |
| 4.3.1 | Event Description..... | 4-4 |
| 4.3.2 | Event Tree Model and its Nodes..... | 4-4 |
| 4.3.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-6 |
| 4.3.4 | Operator Actions..... | 4-6 |
| 4.3.5 | Transfers and Consequential Events..... | 4-6 |
| 4.4 | Medium LOCA Event Tree Model..... | 4-6 |
| 4.4.1 | Event Description..... | 4-6 |
| 4.4.2 | Event Tree Model and its Nodes..... | 4-7 |
| 4.4.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-9 |
| 4.4.4 | Operator Actions..... | 4-9 |
| 4.4.5 | Transfers and Consequential Events..... | 4-10 |
| 4.5 | Core Makeup Tank Line Break Event Tree Model..... | 4-10 |
| 4.5.1 | Event Description..... | 4-10 |
| 4.5.2 | Event Tree Model and its Nodes..... | 4-10 |
| 4.5.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-13 |
| 4.5.4 | Operator Actions..... | 4-13 |
| 4.5.5 | Transfers and Consequential Events..... | 4-13 |
| 4.6 | Safety Injection Line Break Event Tree Model..... | 4-13 |
| 4.6.1 | Event Description..... | 4-13 |
| 4.6.2 | Event Tree Model and its Nodes..... | 4-14 |
| 4.6.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| | 4.6.4 Operator Actions..... | 4-16 |
| | 4.6.5 Transfers and Consequential Events | 4-17 |
| 4.7 | Small LOCA Event Tree Model..... | 4-17 |
| | 4.7.1 Event Description | 4-17 |
| | 4.7.2 Event Tree Model and its Nodes..... | 4-17 |
| | 4.7.3 Event Tree Success Criteria and Core Damage Categories..... | 4-20 |
| | 4.7.4 Operator Actions..... | 4-20 |
| | 4.7.5 Transfers and Consequential Events | 4-21 |
| 4.8 | RCS Leak Event Tree Model | 4-21 |
| | 4.8.1 Event Description | 4-21 |
| | 4.8.2 Event Tree Model and its Nodes..... | 4-21 |
| | 4.8.3 Event Tree Success Criteria | 4-22 |
| | 4.8.4 Operator Actions..... | 4-22 |
| | 4.8.5 Transfers and Consequential Events | 4-22 |
| | 4.8.6 Core Damage Categories..... | 4-23 |
| 4.9 | PRHR Tube Rupture Event Tree Model | 4-23 |
| | 4.9.1 Event Description | 4-23 |
| | 4.9.2 Event Tree Model and its Nodes..... | 4-23 |
| | 4.9.3 Event Tree Success Criteria | 4-24 |
| | 4.9.4 Operator Actions..... | 4-24 |
| | 4.9.5 Transfers and Consequential Events | 4-24 |
| | 4.9.6 Core Damage Categories..... | 4-24 |
| 4.10 | Steam Generator Tube Rupture Event Tree Model | 4-25 |
| | 4.10.1 Event Description | 4-25 |
| | 4.10.2 Event Tree Model and its Nodes..... | 4-27 |
| | 4.10.3 Event Tree Success Criteria and Core Damage Categories..... | 4-33 |
| | 4.10.4 Operator Actions..... | 4-33 |
| | 4.10.5 Transfers and Consequential Events | 4-33 |
| 4.11 | Reactor Vessel Rupture Event Tree Model | 4-34 |
| | 4.11.1 Event Description | 4-34 |
| | 4.11.2 Event Tree Model and its Nodes..... | 4-34 |
| | 4.11.3 Event Tree Success Criteria | 4-34 |
| | 4.11.4 Operator Actions..... | 4-34 |
| | 4.11.5 Transfers and Consequential Events | 4-34 |
| | 4.11.6 Core Damage Categories..... | 4-34 |
| 4.12 | Interfacing System LOCA Event Tree Model | 4-34 |
| | 4.12.1 Event Description | 4-34 |
| | 4.12.2 Event Tree Model and its Nodes..... | 4-35 |
| | 4.12.3 Event Tree Success Criteria | 4-35 |
| | 4.12.4 Operator Actions..... | 4-35 |
| | 4.12.5 Transfers and Consequential Events | 4-35 |
| | 4.12.6 Core Damage Categories..... | 4-35 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 4.13 | Transients With MFW Event Tree Model..... | 4-35 |
| 4.13.1 | Event Description | 4-35 |
| 4.13.2 | Event Tree Model and its Nodes..... | 4-37 |
| 4.13.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-41 |
| 4.13.4 | Operator Actions..... | 4-41 |
| 4.13.5 | Transfers and Consequential Events | 4-42 |
| 4.14 | Transients With Loss of RCS Flow Event Tree Model | 4-42 |
| 4.14.1 | Event Description | 4-42 |
| 4.14.2 | Event Tree Model and its Nodes..... | 4-42 |
| 4.14.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-46 |
| 4.14.4 | Operator Actions..... | 4-46 |
| 4.14.5 | Transfers and Consequential Events | 4-46 |
| 4.15 | Transients With Loss of MFW to One Steam Generator Event Tree Model..... | 4-46 |
| 4.15.1 | Event Description | 4-46 |
| 4.15.2 | Event Tree Model and its Nodes..... | 4-47 |
| 4.15.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-50 |
| 4.15.4 | Operator Actions..... | 4-50 |
| 4.15.5 | Transfers and Consequential Events | 4-51 |
| 4.16 | Transients With Core Power Excursion Event Tree Model..... | 4-51 |
| 4.16.1 | Event Description | 4-51 |
| 4.16.2 | Event Tree Model and its Nodes..... | 4-51 |
| 4.16.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-55 |
| 4.16.4 | Operator Actions..... | 4-55 |
| 4.16.5 | Transfers and Consequential Events | 4-55 |
| 4.17 | Transients With Loss of CCW/SW Event Tree Model..... | 4-56 |
| 4.17.1 | Event Description | 4-56 |
| 4.17.2 | Event Tree Model and its Nodes..... | 4-56 |
| 4.17.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-59 |
| 4.17.4 | Operator Actions..... | 4-59 |
| 4.17.5 | Transfers and Consequential Events | 4-60 |
| 4.18 | Loss of Main Feedwater Event Tree Model | 4-60 |
| 4.18.1 | Event Description | 4-60 |
| 4.18.2 | Event Tree Model and its Nodes..... | 4-62 |
| 4.18.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-65 |
| 4.18.4 | Operator Actions..... | 4-65 |
| 4.18.5 | Transfers and Consequential Events | 4-66 |
| 4.19 | Loss of Condenser Event Tree Model | 4-66 |
| 4.19.1 | Event Description | 4-66 |
| 4.19.2 | Event Tree Model and its Nodes..... | 4-66 |
| 4.19.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-70 |
| 4.19.4 | Operator Actions..... | 4-70 |
| 4.19.5 | Transfers and Consequential Events | 4-70 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 4.20 | Loss of Compressed Air Event Tree Model | 4-70 |
| 4.20.1 | Event Description | 4-70 |
| 4.20.2 | Event Tree Model and its Nodes..... | 4-71 |
| 4.20.3 | Event Tree Success Criteria and Core Damage Categories | 4-74 |
| 4.20.4 | Operator Actions..... | 4-74 |
| 4.20.5 | Transfers and Consequential Events | 4-75 |
| 4.21 | Loss of Offsite Power Event Tree Model | 4-75 |
| 4.21.1 | Event Description | 4-75 |
| 4.21.2 | Event Tree Model and its Nodes..... | 4-75 |
| 4.21.3 | Event Tree Success Criteria and Core Damage Categories | 4-79 |
| 4.21.4 | Operator Actions..... | 4-79 |
| 4.21.5 | Transfers and Consequential Events | 4-80 |
| 4.22 | Main Steam Line Break Downstream of MSIVs Event Tree Model | 4-80 |
| 4.22.1 | Event Description | 4-80 |
| 4.22.2 | Event Tree Model and its Nodes..... | 4-81 |
| 4.22.3 | Event Tree Success Criteria and Core Damage Categories | 4-84 |
| 4.22.4 | Operator Actions..... | 4-84 |
| 4.22.5 | Transfers and Consequential Events | 4-85 |
| 4.23 | Main Steam Line Break Upstream of MSIVs Event Tree Model..... | 4-85 |
| 4.23.1 | Event Description | 4-85 |
| 4.23.2 | Event Tree Model and its Nodes..... | 4-85 |
| 4.23.3 | Event Tree Success Criteria and Core Damage Categories | 4-89 |
| 4.23.4 | Operator Actions..... | 4-89 |
| 4.23.5 | Transfers and Consequential Events | 4-90 |
| 4.24 | Stuck-Open Secondary Side Safety Valve Event Tree Model..... | 4-90 |
| 4.24.1 | Event Description | 4-90 |
| 4.24.2 | Event Tree Model and its Nodes..... | 4-91 |
| 4.24.3 | Event Tree Success Criteria and Core Damage Categories | 4-94 |
| 4.24.4 | Operator Actions..... | 4-94 |
| 4.24.5 | Transfers and Consequential Events | 4-94 |
| 4.25 | ATWS Precursors Without MFW Event Tree Model | 4-95 |
| 4.25.1 | Event Description | 4-95 |
| 4.25.2 | Event Tree Model and its Nodes..... | 4-96 |
| 4.25.3 | Event Tree Success Criteria and Core Damage Categories | 4-101 |
| 4.25.4 | Operator Actions..... | 4-101 |
| 4.25.5 | Transfers and Consequential Events | 4-101 |
| 4.26 | ATWS Precursor with SI Event Tree Model..... | 4-101 |
| 4.26.1 | Event Description | 4-101 |
| 4.26.2 | Event Tree Model and its Nodes..... | 4-102 |
| 4.26.3 | Event Tree Success Criteria and Core Damage Categories | 4-106 |
| 4.26.4 | Operator Actions..... | 4-106 |
| 4.26.5 | Transfers and Consequential Events | 4-106 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 4.27 | ATWS Precursor Transients with MFW Event Tree Model | 4-106 |
| 4.27.1 | Event Description | 4-106 |
| 4.27.2 | Event Tree Model and its Nodes | 4-107 |
| 4.27.3 | Event Tree Success Criteria and Core Damage Categories | 4-110 |
| 4.27.4 | Operator Actions | 4-111 |
| 4.27.5 | Transfers and Consequential Events | 4-111 |
| | | |
| ATTACHMENT 4A EVENT TREE GUIDELINES | | |
| 4A.1 | Event Tree Analysis Methodology | 4A-1 |
| 4A.2 | Event Tree Guidelines for Core Damage | 4A-3 |
| 4A.2.1 | Event Trees | 4A-3 |
| 4A.2.2 | Success Criteria | 4A-6 |
| 4A.2.3 | Definition of End States | 4A-7 |
| 4A.2.4 | Plant Response Functions | 4A-9 |
| 4A.2.5 | Event Tree Node Notation | 4A-13 |
| 4A.2.6 | Consequential Events | 4A-13 |
| 4A.2.7 | Transient Template | 4A-14 |
| 4A.2.8 | Small LOCA Template | 4A-15 |
| | | |
| ATTACHMENT 4B EVENT TREE PICTURES | | 4B-1 |
| | | |
| CHAPTER 5 SUPPORT SYSTEMS | | |
| 5.1 | Introduction | 5-1 |
| 5.2 | Support Systems and Their Interdependencies | 5-1 |
| 5.3 | Front Line Systems and Their Dependencies | 5-1 |
| | | |
| CHAPTER 6 SUCCESS CRITERIA ANALYSIS | | |
| 6.1 | Introduction | 6-1 |
| 6.2 | Acceptance Criteria and Critical Functions for Success Criteria | 6-1 |
| 6.3 | Event Sequences and Timing, Passive/Active System Interactions | 6-3 |
| 6.3.1 | General Sequence Success Criteria | 6-3 |
| 6.3.2 | Timing of Events and Key Operator Actions | 6-9 |
| 6.3.3 | Passive/Active System Interactions | 6-15 |
| 6.3.4 | Sequence Success Criteria Summary | 6-18 |
| 6.4 | Event Tree Top Events Success Criteria | 6-18 |
| 6.5 | References | 6-19 |
| | | |
| CHAPTER 7 FAULT TREE GUIDELINES | | |
| 7.1 | Purpose | 7-1 |
| 7.2 | Fault Tree Development | 7-1 |
| 7.2.1 | Procedural Steps for Fault Tree Preparation | 7-1 |
| 7.2.2 | Procedural Steps for Fault Tree Construction | 7-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 7.3 | Primary Events to be Considered in Fault Trees | 7-3 |
| 7.3.1 | Random Component Failure | 7-3 |
| 7.3.2 | Outage for Maintenance and Testing | 7-5 |
| 7.3.3 | Common Cause Failures | 7-6 |
| 7.3.4 | Human Errors..... | 7-6 |
| 7.3.5 | Power and Control Model..... | 7-9 |
| 7.4 | Data Base | 7-10 |
| 7.5 | Fault Tree Model: Identification Codes..... | 7-10 |
| 7.5.1 | Identification Code for Fault Tree Names..... | 7-10 |
| 7.5.2 | Identification Code for Support Systems | 7-10 |
| 7.5.3 | Identification Code for Primary Event Names | 7-11 |
| 7.5.4 | Identification Code for Common Cause Failures | 7-11 |
| 7.5.5 | Identification Code for Undeveloped Events (Modules)..... | 7-12 |
| 7.5.6 | Identification Code for Operator Errors | 7-13 |
| 7.6 | Fault Tree Quantification | 7-13 |
| 7.7 | References | 7-14 |
| | | |
| CHAPTER 8 | PASSIVE CORE COOLING SYSTEM – PASSIVE RESIDUAL HEAT REMOVAL | |
| 8.1 | System Function..... | 8-1 |
| 8.2 | System Description | 8-1 |
| 8.2.1 | Support Systems | 8-1 |
| 8.2.2 | Instrumentation and Control | 8-2 |
| 8.2.3 | Test and Maintenance | 8-2 |
| 8.3 | System Operation | 8-3 |
| 8.4 | Performance During Accident Conditions | 8-3 |
| 8.4.1 | Plant Shutdown..... | 8-3 |
| 8.4.2 | Loss of Coolant Accidents | 8-3 |
| 8.4.3 | Passive Residual Heat Removal Heat Exchanger Tube Rupture..... | 8-3 |
| 8.5 | Initiating Events Review | 8-4 |
| 8.5.1 | Initiating Events Impacting the PRHR System | 8-4 |
| 8.5.2 | Initiating Events Caused by PRHR System Malfunction | 8-4 |
| 8.6 | System Logic Models..... | 8-4 |
| 8.6.1 | Assumptions and Boundary Conditions..... | 8-5 |
| 8.6.2 | Fault Tree Models..... | 8-6 |
| 8.6.3 | Human Interactions..... | 8-6 |
| 8.6.4 | Common Cause Failures | 8-6 |
| 8.7 | Quantification and Results | 8-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| CHAPTER 9 | PASSIVE CORE COOLING SYSTEM – CORE MAKEUP TANK | |
| 9.1 | System Description | 9-1 |
| 9.1.1 | Support Systems | 9-1 |
| 9.1.2 | Instrumentation and Control | 9-1 |
| 9.1.3 | Test and Maintenance Assumptions..... | 9-2 |
| 9.2 | System Operation | 9-2 |
| 9.3 | Performance During Accident Conditions | 9-3 |
| 9.3.1 | Inadvertent Opening of a Steam Generator Relief or Safety Valve..... | 9-3 |
| 9.3.2 | Steam Line Break..... | 9-3 |
| 9.3.3 | Steam Generator Tube Rupture..... | 9-3 |
| 9.3.4 | Reactor Coolant System Heatup Transients | 9-4 |
| 9.3.5 | Loss-of-Coolant Accidents..... | 9-4 |
| 9.3.6 | Loss of Offsite Power | 9-4 |
| 9.3.7 | Anticipated Transient without Trip..... | 9-4 |
| 9.4 | Initiating Event Review..... | 9-4 |
| 9.4.1 | Initiating Events Impacting the Core Makeup Tank Subsystem | 9-5 |
| 9.4.2 | Initiating Events Due to Loss of the Core Makeup Tank Subsystem..... | 9-5 |
| 9.5 | System Logic Models..... | 9-5 |
| 9.5.1 | Assumptions and Boundary Conditions..... | 9-5 |
| 9.5.2 | Fault Tree Models..... | 9-7 |
| 9.5.3 | Human Interactions..... | 9-7 |
| 9.5.4 | Common Cause Failures..... | 9-8 |
| CHAPTER 10 | PASSIVE CORE COOLING SYSTEM – ACCUMULATOR | |
| 10.1 | System Description | 10-1 |
| 10.1.1 | Support Systems | 10-1 |
| 10.1.2 | Instrumentation and Control | 10-1 |
| 10.1.3 | Test and Maintenance Assumptions..... | 10-1 |
| 10.2 | System Operation | 10-1 |
| 10.3 | Performance During Accident Conditions | 10-2 |
| 10.3.1 | Steam Line Break..... | 10-2 |
| 10.3.2 | Loss-of-Coolant Accidents or Non-Loss-of-Coolant Accidents with Automatic Depressurization System | 10-2 |
| 10.4 | Initiating Event Review..... | 10-3 |
| 10.4.1 | Initiating Events Impacting the Accumulator Subsystem..... | 10-3 |
| 10.4.2 | Initiating Events Due to Loss of the Accumulator Subsystem | 10-3 |
| 10.5 | System Logic Models..... | 10-3 |
| 10.5.1 | Assumptions and Boundary Conditions..... | 10-3 |
| 10.5.2 | Fault Tree Models..... | 10-4 |
| 10.5.3 | Human Interactions..... | 10-4 |
| 10.5.4 | Common Cause Failures..... | 10-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 11 PASSIVE COOLING SYSTEM – AUTOMATIC DEPRESSURIZATION SYSTEM | | |
| 11.1 | System Function..... | 11-1 |
| 11.2 | System Description | 11-1 |
| | 11.2.1 Support Systems | 11-1 |
| | 11.2.2 Instrumentation and Control | 11-2 |
| | 11.2.3 Test and Maintenance | 11-2 |
| 11.3 | System Operation | 11-2 |
| 11.4 | Performance During Accident Conditions | 11-3 |
| | 11.4.1 Loss of Coolant Accidents | 11-3 |
| | 11.4.2 Transients..... | 11-3 |
| 11.5 | Initiating Events Review | 11-3 |
| | 11.5.1 Initiating Events Impacting the Automatic Depressurization System | 11-3 |
| | 11.5.2 Initiating Events Caused by the ADS Malfunction | 11-4 |
| 11.6 | System Logic Model | 11-4 |
| | 11.6.1 Assumptions and Boundary Conditions..... | 11-4 |
| | 11.6.2 Fault Tree Models..... | 11-5 |
| | 11.6.3 Human Interactions..... | 11-6 |
| | 11.6.4 Common Cause Failures | 11-7 |
| 11.7 | Quantification and Results | 11-7 |
| CHAPTER 12 PASSIVE CORE COOLING SYSTEM – IN-CONTAINMENT REFUELING WATER STORAGE TANK | | |
| 12.1 | System Function..... | 12-1 |
| 12.2 | System Description | 12-1 |
| | 12.2.1 Support Systems | 12-1 |
| | 12.2.2 Instrumentation and Control | 12-1 |
| | 12.2.3 Test and Maintenance | 12-2 |
| 12.3 | System Operation | 12-2 |
| 12.4 | Performance During Accident Conditions | 12-2 |
| | 12.4.1 Transients..... | 12-3 |
| | 12.4.2 Loss of Coolant Accidents | 12-4 |
| | 12.4.3 In-Vessel Core Damage Mitigation..... | 12-5 |
| | 12.4.4 Containment Isolation System Failure | 12-5 |
| 12.5 | Initiating Event..... | 12-5 |
| | 12.5.1 Initiating Event Impacting IRWST/Gravity Injection Subsystem | 12-5 |
| | 12.5.2 Initiating Event due to Loss of IRWST/Gravity Injection Subsystem..... | 12-5 |
| 12.6 | System Logic Models..... | 12-6 |
| | 12.6.1 Assumptions and Boundary Conditions..... | 12-6 |
| | 12.6.2 Fault Tree Models..... | 12-8 |
| | 12.6.3 Human Interactions..... | 12-8 |
| | 12.6.4 Common Cause Failures | 12-8 |
| 12.7 | Quantification and Results | 12-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 13 PASSIVE CONTAINMENT COOLING SYSTEM | | |
| 13.1 | System Description | 13-1 |
| 13.1.1 | Support Systems | 13-1 |
| 13.1.2 | Instrumentation and Control | 13-1 |
| 13.1.3 | Test and Maintenance Assumptions..... | 13-2 |
| 13.2 | System Operation | 13-2 |
| 13.3 | Performance During Accident Conditions | 13-2 |
| 13.3.1 | Post-Reactor Trip with Loss of All ac Power..... | 13-2 |
| 13.3.2 | Automatic Depressurization System Actuation..... | 13-2 |
| 13.3.3 | Post-Loss-of-Coolant Accident | 13-3 |
| 13.3.4 | Post-Main Steam Line Break | 13-3 |
| 13.4 | Initiating Event Review..... | 13-3 |
| 13.4.1 | Initiating Events Impacting the Passive Containment Cooling System..... | 13-3 |
| 13.4.2 | Initiating Events due to Loss of the Passive Containment Cooling System | 13-3 |
| 13.5 | System Logic Model | 13-3 |
| 13.5.1 | Assumptions and Boundary Conditions..... | 13-4 |
| 13.5.2 | Fault Tree Model | 13-5 |
| 13.5.3 | Human Interactions..... | 13-6 |
| 13.5.4 | Common Cause Failures | 13-6 |
| CHAPTER 14 MAIN AND STARTUP FEEDWATER SYSTEM | | |
| 14.1 | System Description | 14-1 |
| 14.1.1 | Support Systems | 14-1 |
| 14.1.2 | Instrumentation and Control | 14-2 |
| 14.1.3 | Test and Maintenance | 14-2 |
| 14.2 | System Operation | 14-2 |
| 14.3 | Performance During Accident Conditions | 14-2 |
| 14.4 | Initiating Event Review..... | 14-4 |
| 14.4.1 | Initiating Event Impacting Main and Startup Feedwater/ Condensate System..... | 14-4 |
| 14.4.2 | Initiating Event due to Loss of Main and Startup Feedwater/ Condensate System..... | 14-4 |
| 14.5 | System Logic Models..... | 14-4 |
| 14.5.1 | Assumptions and Boundary Conditions..... | 14-5 |
| 14.5.2 | Fault Tree Models..... | 14-7 |
| 14.5.3 | Human Interactions..... | 14-7 |
| 14.5.4 | Common Cause Failures | 14-7 |
| 14.6 | Quantification and Results | 14-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 15 CHEMICAL AND VOLUME CONTROL SYSTEM | | |
| 15.1 | System Description | 15-1 |
| 15.1.1 | Support Systems | 15-1 |
| 15.1.2 | Instrumentation and Control Assumptions..... | 15-1 |
| 15.1.3 | Test and Maintenance Assumptions..... | 15-2 |
| 15.2 | System Operation | 15-3 |
| 15.3 | Performance During Accident Conditions | 15-3 |
| 15.4 | Initiating Event Review..... | 15-4 |
| 15.4.1 | Initiating Events Impacting the Chemical and Volume Control System | 15-5 |
| 15.4.2 | Initiating Events Due to Loss of the Chemical and Volume Control System | 15-5 |
| 15.5 | System Logic Models..... | 15-5 |
| 15.5.1 | Assumptions and Boundary Conditions..... | 15-5 |
| 15.5.2 | Fault Tree Models..... | 15-7 |
| 15.5.3 | Human Interactions..... | 15-7 |
| 15.5.4 | Common Cause Failures..... | 15-8 |
| CHAPTER 16 CONTAINMENT HYDROGEN CONTROL SYSTEM | | |
| 16.1 | System Description | 16-1 |
| 16.1.1 | Support Systems | 16-1 |
| 16.1.2 | Instrumentation and Control | 16-1 |
| 16.1.3 | Test and Maintenance | 16-1 |
| 16.2 | System Operation | 16-2 |
| 16.3 | Performance During Accident Conditions | 16-2 |
| 16.4 | Initiating Event Review..... | 16-2 |
| 16.5 | System Logic Model | 16-2 |
| 16.5.1 | Assumptions and Boundary Conditions..... | 16-2 |
| 16.5.2 | Fault Tree Model | 16-3 |
| 16.5.3 | Human Interactions..... | 16-3 |
| 16.5.4 | Common Cause Failures..... | 16-4 |
| CHAPTER 17 NORMAL RESIDUAL HEAT REMOVAL SYSTEM | | |
| 17.1 | System Description | 17-1 |
| 17.1.1 | Support Systems | 17-1 |
| 17.1.2 | Instrumentation and Control | 17-1 |
| 17.1.3 | Test and Maintenance Assumptions..... | 17-1 |
| 17.2 | System Operation | 17-1 |
| 17.3 | Performance During Accident Conditions | 17-2 |
| 17.4 | Initiating Event Review..... | 17-3 |
| 17.4.1 | Initiating Events Impacting the Normal Residual Heat Removal System | 17-3 |
| 17.4.2 | Initiating Events Due to Loss of the Normal Residual Heat Removal System | 17-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 17.5 | System Logic Models..... | 17-4 |
| 17.5.1 | Assumptions and Boundary Conditions..... | 17-4 |
| 17.5.2 | Fault Tree Models..... | 17-6 |
| 17.5.3 | Human Interactions..... | 17-6 |
| 17.5.4 | Common Cause Failures..... | 17-6 |
| 17.6 | References..... | 17-6 |
| | | |
| CHAPTER 18 | COMPONENT COOLING WATER SYSTEM | |
| 18.1 | System Description | 18-1 |
| 18.1.1 | Support Systems | 18-1 |
| 18.1.2 | Instrumentation and Control | 18-1 |
| 18.1.3 | Test and Maintenance Assumptions..... | 18-1 |
| 18.2 | System Operation | 18-2 |
| 18.3 | Performance During Accident Conditions | 18-2 |
| 18.4 | Initiating Event Review..... | 18-2 |
| 18.4.1 | Initiating Events Impacting the Component Cooling Water System..... | 18-2 |
| 18.4.2 | Initiating Events Due to Loss of the Component Cooling Water System..... | 18-3 |
| 18.5 | System Logic Models..... | 18-3 |
| 18.5.1 | Assumptions and Boundary Conditions..... | 18-3 |
| 18.5.2 | Fault Tree Models..... | 18-4 |
| 18.5.3 | Human Interactions..... | 18-4 |
| 18.5.4 | Common Cause Failures..... | 18-5 |
| | | |
| CHAPTER 19 | SERVICE WATER SYSTEM | |
| 19.1 | System Description | 19-1 |
| 19.1.1 | Support Systems | 19-1 |
| 19.1.2 | Instrumentation and Control | 19-1 |
| 19.1.3 | Test and Maintenance Assumptions..... | 19-1 |
| 19.2 | System Operation | 19-2 |
| 19.3 | Performance During Accident Conditions | 19-2 |
| 19.4 | Initiating Event Review..... | 19-2 |
| 19.4.1 | Initiating Events Impacting the Service Water System | 19-2 |
| 19.4.2 | Initiating Events Due to Loss of the Service Water System..... | 19-2 |
| 19.5 | System Logic Models..... | 19-3 |
| 19.5.1 | Assumptions and Boundary Conditions..... | 19-3 |
| 19.5.2 | Fault Tree Models..... | 19-4 |
| 19.5.3 | Human Interactions..... | 19-5 |
| 19.5.4 | Common Cause Failures..... | 19-5 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| CHAPTER 20 | CENTRAL CHILLED WATER SYSTEM | |
| 20.1 | System Description | 20-1 |
| 20.1.1 | Support Systems | 20-1 |
| 20.1.2 | Instrumentation and Control | 20-1 |
| 20.1.3 | Test and Maintenance Assumptions..... | 20-1 |
| 20.2 | System Operation | 20-2 |
| 20.3 | Performance During Accident Conditions | 20-2 |
| 20.4 | Initiating Event Review..... | 20-2 |
| 20.4.1 | Initiating Events Impacting the Central Chilled Water System..... | 20-2 |
| 20.4.2 | Initiating Events Due to Loss of the Central Chilled Water System | 20-3 |
| 20.5 | System Logic Model | 20-3 |
| 20.5.1 | Assumptions and Boundary Conditions..... | 20-3 |
| 20.5.2 | Fault Tree Model | 20-4 |
| 20.5.3 | Human Interactions..... | 20-4 |
| 20.5.4 | Common Cause Failures..... | 20-4 |
| CHAPTER 21 | AC POWER SYSTEM | |
| 21.1 | System Description | 21-1 |
| 21.1.1 | Support Systems | 21-1 |
| 21.1.2 | Instrumentation and Control | 21-2 |
| 21.1.3 | Test and Maintenance Assumptions..... | 21-2 |
| 21.2 | System Operation | 21-2 |
| 21.3 | Performance During Accident Conditions | 21-3 |
| 21.3.1 | Automatic Load Shedding | 21-3 |
| 21.3.2 | Manual Transfer..... | 21-3 |
| 21.3.3 | Electric Circuit Protection..... | 21-3 |
| 21.4 | Initiating Event Review..... | 21-3 |
| 21.4.1 | Loss of the Main Generator | 21-4 |
| 21.4.2 | Loss of Offsite Power | 21-4 |
| 21.4.3 | Loss of 6900-vac and 480-vac Busses | 21-4 |
| 21.5 | System Logic Models..... | 21-4 |
| 21.5.1 | Assumptions and Boundary Conditions..... | 21-5 |
| 21.5.2 | Fault Tree Models..... | 21-7 |
| 21.5.3 | Human Interactions..... | 21-8 |
| 21.5.4 | Common Cause Failures | 21-8 |
| CHAPTER 22 | CLASS 1E DC AND UNINTERRUPTIBLE POWER SUPPLY SYSTEM | |
| 22.1 | System Description | 22-1 |
| 22.1.1 | Support Systems | 22-1 |
| 22.1.2 | Instrumentation and Control | 22-1 |
| 22.1.3 | Test and Maintenance Assumptions..... | 22-1 |
| 22.2 | System Operation | 22-2 |
| 22.3 | Performance During Accident Conditions | 22-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 22.4 | Initiating Event Review..... | 22-2 |
| 22.4.1 | Initiating Events Impacting the Class 1E dc and UPS System..... | 22-3 |
| 22.4.2 | Initiating Events Due to Loss of the Class 1E dc and UPS System..... | 22-3 |
| 22.5 | System Logic Models..... | 22-3 |
| 22.5.1 | Assumptions and Boundary Conditions..... | 22-3 |
| 22.5.2 | Fault Tree Models..... | 22-4 |
| 22.5.3 | Human Interactions..... | 22-4 |
| 22.5.4 | Common Cause Failures..... | 22-4 |
| 22.6 | References..... | 22-5 |
| | | |
| CHAPTER 23 | NON-CLASS 1E DC AND UPS SYSTEM | |
| 23.1 | System Description..... | 23-1 |
| 23.1.1 | Support Systems..... | 23-1 |
| 23.1.2 | Instrumentation and Control..... | 23-1 |
| 23.1.3 | Test and Maintenance Assumptions..... | 23-1 |
| 23.2 | System Operation..... | 23-2 |
| 23.3 | Performance During Accident Conditions..... | 23-2 |
| 23.4 | Initiating Event Review..... | 23-2 |
| 23.4.1 | Initiating Events Impacting the Non-Class 1E dc and UPS System..... | 23-2 |
| 23.4.2 | Initiating Events Due to Loss of the Non-Class 1E dc and UPS Power System..... | 23-3 |
| 23.5 | System Logic Models..... | 23-3 |
| 23.5.1 | Assumptions and Boundary Conditions..... | 23-3 |
| 23.5.2 | Fault Tree Models..... | 23-4 |
| 23.5.3 | Human Interactions..... | 23-5 |
| 23.5.4 | Common Cause Failures..... | 23-5 |
| 23.6 | References..... | 23-5 |
| | | |
| CHAPTER 24 | CONTAINMENT ISOLATION | |
| 24.1 | System Description..... | 24-1 |
| 24.1.1 | Support Systems..... | 24-1 |
| 24.1.2 | Instrumentation and Control..... | 24-1 |
| 24.1.3 | Test and Maintenance Assumptions..... | 24-2 |
| 24.2 | System Operation..... | 24-2 |
| 24.3 | Performance During Accident Conditions..... | 24-2 |
| 24.4 | Initiating Event Review..... | 24-2 |
| 24.4.1 | Initiating Events Impacting Containment Isolation..... | 24-2 |
| 24.4.2 | Initiating Events Due to Loss of the Containment Isolation System..... | 24-2 |
| 24.5 | System Logic Models..... | 24-3 |
| 24.5.1 | Assumptions and Boundary Conditions..... | 24-4 |
| 24.5.2 | Fault Tree Models..... | 24-5 |
| 24.5.3 | Human Interactions..... | 24-6 |
| 24.5.4 | Common Cause Failures..... | 24-6 |
| 24.6 | References..... | 24-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 25 COMPRESSED AND INSTRUMENT AIR SYSTEM | | |
| 25.1 | System Description | 25-1 |
| | 25.1.1 Support Systems | 25-2 |
| | 25.1.2 Instrumentation and Control | 25-2 |
| | 25.1.3 Test and Maintenance Assumptions..... | 25-3 |
| 25.2 | System Operation | 25-3 |
| 25.3 | Performance During Accident Conditions | 25-3 |
| 25.4 | Initiating Event Review..... | 25-4 |
| | 25.4.1 Initiating Events Impacting the Instrument Air Subsystem..... | 25-4 |
| | 25.4.2 Initiating Events Due to Loss of the Instrument Air Subsystem | 25-4 |
| 25.5 | System Logic Models | 25-4 |
| | 25.5.1 Assumptions and Boundary Conditions..... | 25-4 |
| | 25.5.2 Fault Tree Models..... | 25-6 |
| | 25.5.3 Human Interactions..... | 25-7 |
| | 25.5.4 Common Cause Failures | 25-7 |
| CHAPTER 26 PROTECTION AND SAFETY MONITORING SYSTEM | | |
| 26.1 | System Analysis Description..... | 26-1 |
| | 26.1.1 Analysis of Support Systems..... | 26-4 |
| | 26.1.2 Analysis of Instrumentation | 26-5 |
| | 26.1.3 Test and Maintenance Assumptions..... | 26-6 |
| 26.2 | Performance During Accident Conditions | 26-7 |
| 26.3 | Initiating Event Review..... | 26-7 |
| | 26.3.1 Initiating Event Impacting PMS..... | 26-7 |
| | 26.3.2 Initiating Event due to Loss of PMS | 26-8 |
| 26.4 | System Logic Model Development | 26-8 |
| | 26.4.1 Assumptions and Boundary Conditions..... | 26-8 |
| | 26.4.2 Fault Tree Models..... | 26-12 |
| | 26.4.3 Description of I&C Subtree Development | 26-12 |
| | 26.4.4 Human Interactions..... | 26-19 |
| 26.5 | Discussion of Methodology..... | 26-19 |
| | 26.5.1 Fault Tree Analysis | 26-20 |
| | 26.5.2 Unavailability..... | 26-20 |
| | 26.5.3 Spurious Failure Rate Per Year..... | 26-20 |
| | 26.5.4 Common Cause Failures | 26-22 |
| | 26.5.5 Data Manipulation | 26-23 |
| 26.6 | References..... | 26-24 |
| CHAPTER 27 DIVERSE ACTUATION SYSTEM | | |
| 27.1 | System Analysis Description..... | 27-1 |
| | 27.1.1 Support Systems Analysis..... | 27-2 |
| | 27.1.2 Analysis of Instrumentation and Control | 27-2 |
| | 27.1.3 Test and Maintenance | 27-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| 27.2 | Analysis of System Operation | 27-2 |
| 27.3 | Performance During Accident Conditions | 27-6 |
| 27.4 | Initiating Event Review..... | 27-6 |
| | 27.4.1 Initiating Events Impacting the Diverse Actuation System..... | 27-6 |
| | 27.4.2 Initiating Events Due to Loss of the Diverse Actuation System..... | 27-6 |
| 27.5 | System Logic Model | 27-6 |
| | 27.5.1 Assumptions and Boundary Conditions..... | 27-7 |
| | 27.5.2 Fault Tree Model | 27-7 |
| | 27.5.3 Human Interactions..... | 27-7 |
| | 27.5.4 Common Cause Failures..... | 27-8 |
| CHAPTER 28 PLANT CONTROL SYSTEM | | |
| 28.1 | System Analysis Description..... | 28-1 |
| | 28.1.1 Analysis of Support Systems..... | 28-3 |
| | 28.1.2 Analysis of Instrumentation | 28-4 |
| | 28.1.3 Test and Maintenance Assumptions..... | 28-4 |
| 28.2 | Performance During Accident Conditions | 28-6 |
| 28.3 | Initiating Event Review..... | 28-6 |
| | 28.3.1 Initiating Events Impacting the Plant Control System..... | 28-6 |
| | 28.3.2 Initiating Event due to Loss of the Plant Control System..... | 28-6 |
| 28.4 | System Logic Model Development..... | 28-7 |
| | 28.4.1 Assumptions and Boundary Conditions..... | 28-7 |
| | 28.4.2 Fault Tree Models..... | 28-9 |
| | 28.4.3 Description of I&C Subtree Development | 28-10 |
| | 28.4.4 Human Interactions..... | 28-16 |
| 28.5 | Discussion of Methodology..... | 28-17 |
| | 28.5.1 Fault Tree Analysis..... | 28-17 |
| | 28.5.2 Unavailability..... | 28-17 |
| | 28.5.3 Common Cause Failures..... | 28-17 |
| | 28.5.4 Data Manipulation | 28-18 |
| CHAPTER 29 COMMON-CAUSE ANALYSIS | | |
| 29.1 | Introduction..... | 29-1 |
| 29.2 | Dependent Failures | 29-1 |
| 29.3 | Common-Cause Analysis | 29-4 |
| | 29.3.1 Assumptions | 29-4 |
| | 29.3.2 Analysis of Potential Common-Cause Failures within the Systems..... | 29-6 |
| | 29.3.3 Analysis of Potential Common-Cause Failures among Several Systems | 29-6 |
| 29.4 | Calculations For Component Groups | 29-6 |
| | 29.4.1 DC Batteries..... | 29-7 |
| | 29.4.2 Reactor Trip Breakers | 29-8 |
| | 29.4.3 Automatic Depressurization System Explosive Valves..... | 29-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|--------------|
| 29.4.4 | Air-Operated Valves in Core Makeup Tanks..... | 29-10 |
| 29.4.5 | Automatic Depressurization System Motor-Operated Valves..... | 29-11 |
| 29.4.6 | Common-Cause Failure for IRWST Valves..... | 29-14 |
| 29.5 | Results..... | 29-17 |
| 29.6 | References..... | 29-17 |
| ATTACHMENT 29A COMMON-CAUSE ANALYSIS GUIDELINES..... | | 29A-1 |
| 29A.1 | Introduction..... | 29A-1 |
| 29A.2 | Types of Dependencies | 29A-1 |
| 29A.3 | Common Cause Failures Definition | 29A-2 |
| 29A.4 | Methodology | 29A-3 |
| 29A.5 | Common Cause Failures Calculation Procedure | 29A-4 |
| | 29A.5.1 Procedure for Treatment of Common Cause Failures Within a System..... | 29A-5 |
| | 29A.5.2 Procedure for Treatment of Common Cause Failures Among More Systems | 29A-7 |
| 29A.6 | Common Cause Failure Numerical Evaluation | 29A-8 |
| | 29A.6.1 Evaluation through Beta Factor Method | 29A-8 |
| | 29A.6.2 Evaluation through Multiple-Greek Letter (MGL) Method | 29A-8 |
| 29A.7 | References..... | 29A-10 |
| CHAPTER 30 HUMAN RELIABILITY ANALYSIS | | |
| 30.1 | Introduction..... | 30-1 |
| 30.2 | Summary of Results | 30-1 |
| 30.3 | Methodology | 30-2 |
| 30.4 | Major Assumptions | 30-4 |
| 30.5 | Types of Human Interactions | 30-10 |
| | 30.5.1 Quantification Model..... | 30-11 |
| 30.6 | Quantification..... | 30-12 |
| | 30.6.1 ZON-MAN01 (Start the Onsite Standby Diesel Generator)..... | 30-12 |
| | 30.6.2 LPM-MAN01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-13 |
| | 30.6.3 LPM-MAN02 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-15 |
| | 30.6.4 LPM-MAN05 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-16 |
| | 30.6.5 LPM-REC01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-17 |
| | 30.6.6 ADN-MAN01 (Actuate the Automatic Depressurization System) | 30-17 |
| | 30.6.7 ADN-REC01 (Actuate the Automatic Depressurization System)..... | 30-19 |
| | 30.6.8 CCB-MAN01 (Start the Standby Component Cooling Water Pump)..... | 30-19 |
| | 30.6.9 CCN-MAN02 (Inadvertent Misalignment of Heat Exchanger) | 30-20 |
| | 30.6.10 CIB-MAN00 (Diagnose Steam Generator Tube Rupture)..... | 30-21 |
| | 30.6.11 DUMP-MAN01 (Operate Steam Dump Valves) | 30-22 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 30.6.12 | CIC-MAN01 (Isolate Containment)..... | 30-23 |
| 30.6.13 | ADS-MANTEST (Recognize the Need and Reclose ADS Stage MOV)..... | 30-24 |
| 30.6.14 | CAN-MAN0S (Locally Close Manual Valve CAS-V204 to Isolate Containment) | 30-25 |
| 30.6.15 | CIT-MAN0S (Isolate Containment)..... | 30-26 |
| 30.6.16 | CMN-MAN01 (Actuate Core Makeup Tank)..... | 30-27 |
| 30.6.17 | CMN-REC01 (Actuate the Core Makeup Tanks)..... | 30-28 |
| 30.6.18 | CVN-MAN00 (Align Chemical and Volume Control System) | 30-29 |
| 30.6.19 | CVN-MAN02 (Align Chemical and Volume Control System) | 30-30 |
| 30.6.20 | CVN-MAN03 (Start Chemical and Volume Control System Pump B)..... | 30-30 |
| 30.6.21 | ADF-MAN01 (Depressurize the RCS to Refill the Pressurizer)..... | 30-31 |
| 30.6.22 | SGHL-MAN01 (Isolate Feedwater to Failed Steam Generator) | 30-32 |
| 30.6.23 | CAN-MAN01 (Start Standby Compressor) | 30-33 |
| 30.6.24 | REN-MAN02 (Initiate Recirculation)..... | 30-33 |
| 30.6.25 | REN-MAN03 (Initiate Recirculation)..... | 30-34 |
| 30.6.26 | IWN-MAN00 (Operate In-Containment Refueling Water Storage Tank Motor-Operated Valves)..... | 30-35 |
| 30.6.27 | RHN-MAN01 (Align Normal Residual Heat Removal System)..... | 30-36 |
| 30.6.28 | RHN-MANDIV (Align Normal Residual Heat Removal System)..... | 30-37 |
| 30.6.29 | RHN-MAN02/RHN-MAN03 (Align Normal Residual Heat Removal System) | 30-38 |
| 30.6.30 | PCN-MAN01 (Actuate Passive Containment Cooling System)..... | 30-40 |
| 30.6.31 | HPM-MAN01 (Diagnose Need for High Pressure Heat Removal)..... | 30-40 |
| 30.6.32 | PRN-MAN01 (Align Passive Residual Heat Removal System) | 30-41 |
| 30.6.33 | PRN-MAN02 (Align Passive Residual Heat Removal System) | 30-42 |
| 30.6.34 | PRN-MAN03 (Align Passive Residual Heat Removal System) | 30-43 |
| 30.6.35 | PRI-MAN01 (Isolate Failed Passive Residual Heat Removal Heat Exchanger) | 30-44 |
| 30.6.36 | REN-MAN04 (Initiate Recirculation)..... | 30-45 |
| 30.6.37 | RCN-MAN01 (Trip Reactor Coolant Pumps) | 30-46 |
| 30.6.38 | ATW-MAN01 (Manually Insert Control Rods)..... | 30-47 |
| 30.6.39 | ATW-MAN03 (Manually Trip the Reactor through Protection and Safety Monitoring System in One Minute) | 30-48 |
| 30.6.40 | ATW-MAN04 (Manually Trip the Reactor through Diverse Actuation System in One Minute) | 30-49 |
| 30.6.41 | ATW-MAN05 (Manually Trip the Reactor through Protection and Safety Monitoring System in Seven Minutes)..... | 30-49 |
| 30.6.42 | ATW-MAN06 (Manually Trip the Reactor through Diverse Actuation System In Seven Minutes)..... | 30-50 |
| 30.6.43 | RTN-MAN01 (Perform Controlled Reactor Shutdown)..... | 30-51 |
| 30.6.44 | FWN-MAN02 (Start the Startup Feedwater Pumps) | 30-52 |
| 30.6.45 | FWN-MAN03 (Start the Startup Feedwater Pumps) | 30-53 |
| 30.6.46 | REG-MAN00 (Regulate Startup Feedwater) | 30-54 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|--------------|
| 30.6.47 | CIA-MAN01 (Isolate Failed Steam Generator) | 30-55 |
| 30.6.48 | CIB-MAN01 (Close Main Steam Isolation Valve) | 30-56 |
| 30.6.49 | SGA-MAN01 (Inadvertent Opening of Steam Generator Power-Operated Relief Valve)..... | 30-57 |
| 30.6.50 | SWN-MAN01N (Open Air-Operated Valve on Motor Strainer Line)..... | 30-58 |
| 30.6.51 | SWB-MAN02 (Start Standby Service Water Pump) | 30-58 |
| 30.6.52 | SWB-MAN02N (Start Standby Service Water Pump) | 30-59 |
| 30.6.53 | TCB-MAN01 (Start Standby Turbine Closed Cooling Water Pump)..... | 30-60 |
| 30.6.54 | TCB-MAN02 (Locally Align Standby Turbine Closed Cooling Water Heat Exchanger)..... | 30-61 |
| 30.6.55 | VLN-MAN01 (Actuate Hydrogen Control System) | 30-62 |
| 30.6.56 | VWN-MAN01 (Align Standby Chiller)..... | 30-63 |
| 30.6.57 | ATW-MAN11 (Recognize the Need for Manual Boration)..... | 30-64 |
| 30.6.58 | REC-MANDAS (Diagnosis of an Event Through DAS Signals or Perform an Activity by Operating DAS Controls)..... | 30-65 |
| 30.6.59 | RHN-MAN04 (Isolate the RNS During Shutdown Conditions)..... | 30-65 |
| 30.6.60 | RHN-MAN05 (Initiate Gravity Injection from IRWST via RNS Suction Line)..... | 30-66 |
| 30.6.61 | RHN-MAN06 (Recognize the Need and Throttle RNS Valve V011) | 30-68 |
| 30.6.62 | RCS-MANODS1 (Close AOVs CVS-V045 or -V047, Given Failure of HL Level Instruments) | 30-68 |
| 30.6.63 | RCS-MANODS2 (Close AOVs CVS-V045 or -V047, Given Failure of Valves to Close Automatically)..... | 30-70 |
| 30.6.64 | SWN-MAN03 (Recognize the Need and Locally Refill Service Water Basin)..... | 30-70 |
| 30.7 | Conditional Probability Evaluation | 30-71 |
| 30.7.1 | Application | 30-72 |
| 30.7.2 | Process Used to Determine Dependencies | 30-72 |
| 30.7.3 | Calculation of Dependent Human Error Probabilities..... | 30-72 |
| 30.8 | References..... | 30-74 |
| ATTACHMENT 30A HUMAN RELIABILITY ANALYSIS GUIDELINES..... | | 30A-1 |
| 30A.1 | Introduction..... | 30A-1 |
| 30A.2 | Schedule for Human Reliability Analysis | 30A-1 |
| 30A.3 | Methodology | 30A-1 |
| 30A.4 | Responsibility..... | 30A-2 |
| 30A.5 | Procedure for Human Interaction Evaluation..... | 30A-2 |
| 30A.5.1 | Type A | 30A-3 |
| 30A.5.2 | Type B | 30A-3 |
| 30A.5.3 | Type C | 30A-4 |
| 30A.5.4 | Commission Errors That Have Detrimental Effects..... | 30A-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 30A.6 | Procedure for Human Error Probabilities Quantification | 30A-8 |
| | 30A.6.1 Basic Assumptions for Human Interaction Analysis..... | 30A-8 |
| 30A.7 | References..... | 30A-9 |
| | | |
| CHAPTER 31 | OTHER EVENT TREE NODE PROBABILITIES | |
| 31.1 | Introduction..... | 31-1 |
| 31.2 | Identification of Cases Requiring Calculations | 31-1 |
| | 31.2.1 BL – Main Steam Line Break Occurs Inside Containment..... | 31-1 |
| | 31.2.2 CNB – Containment Isolation Fails Due to Reactor Coolant System Vessel Rupture..... | 31-1 |
| | 31.2.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-1 |
| | 31.2.4 NSGTR – Consequential Steam Generator Tube Rupture..... | 31-2 |
| | 31.2.5 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-2 |
| | 31.2.6 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-2 |
| | 31.2.7 PRSOV – Pressurizer Safety Valves Reclose | 31-2 |
| | 31.2.8 R05 – Offsite Power Recovered within One-Half Hour..... | 31-2 |
| | 31.2.9 SLSOV – Main Steam Line Relief Valves Reclose | 31-2 |
| 31.3 | Case-Specific Calculations..... | 31-3 |
| | 31.3.1 BL – Main Steam Line Break Occurs Inside Containment..... | 31-3 |
| | 31.3.2 CNB – Containment Isolation Fails Due to RCS Vessel Rupture..... | 31-3 |
| | 31.3.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-3 |
| | 31.3.4 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-4 |
| | 31.3.5 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-4 |
| | 31.3.6 PRSOV – Pressurizer Safety Valves Reclose | 31-5 |
| | 31.3.7 R05 – Offsite Power Recovered within One-Half Hour..... | 31-6 |
| | 31.3.8 SGTR1 – Single Consequential Steam Generator Tube Rupture..... | 31-6 |
| | 31.3.9 SGTR – Multiple Consequential Steam Generator Tube Rupture | 31-8 |
| | 31.3.10 SLSOV – Main Steam Line Relief and Safety Valves Reclose | 31-8 |
| | 31.3.11 SLSOV1 – Main Steam Line Relief and Safety Valves Reclose | 31-9 |
| | 31.3.12 SLSOV2 – Main Steam Line Safety Valves Reclose..... | 31-10 |
| | 31.3.13 SLSOV3 – Main Steamline Relief and Safety Valves Reclose, SGTR..... | 31-10 |
| 31.4 | References..... | 31-11 |
| | | |
| CHAPTER 32 | DATA ANALYSIS AND MASTER DATA BANK | |
| 32.1 | Data Analysis | 32-1 |
| | 32.1.1 Random Component Failure Data..... | 32-1 |
| | 32.1.2 Test and Maintenance Unavailability..... | 32-2 |
| | 32.1.3 Common Cause Failure Data | 32-2 |
| | 32.1.4 Human Reliability Data | 32-2 |
| | 32.1.5 Initiating Event Frequency Data | 32-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| 32.2 | Master Data Bank..... | 32-2 |
| 32.2.1 | Initiating Event Frequencies | 32-3 |
| 32.2.2 | Random Component Failures..... | 32-3 |
| 32.2.3 | Common Cause Failure Probabilities..... | 32-3 |
| 32.2.4 | Human Error Probabilities | 32-3 |
| 32.2.5 | System-Specific Calculations..... | 32-3 |
| 32.2.6 | Other Event Tree Node Probabilities | 32-3 |
| 32.2.7 | Master Data Bank | 32-4 |
| 32.3 | References..... | 32-4 |
| CHAPTER 33 FAULT TREE AND CORE DAMAGE QUANTIFICATION | | |
| 33.1 | Introduction..... | 33-1 |
| 33.2 | Fault Tree Model Quantification | 33-1 |
| 33.3 | Event Tree Model Calculation | 33-1 |
| 33.3.1 | Core Damage Quantification Method | 33-2 |
| 33.3.2 | Core Damage Quantification Input Files and Data | 33-4 |
| 33.3.3 | Definition of Consequential Event Categories | 33-4 |
| 33.3.4 | Incorporate Operator Action Dependencies Into Plant Core Damage Frequency Quantification..... | 33-6 |
| 33.3.5 | Core Damage Frequency Results | 33-6 |
| CHAPTER 34 SEVERE ACCIDENT PHENOMENA TREATMENT | | |
| 34.1 | Introduction..... | 34-1 |
| 34.2 | Treatment of Physical Processes | 34-1 |
| 34.2.1 | In-Vessel Retention of Molten Core Debris..... | 34-1 |
| 34.2.2 | Fuel-Coolant Interaction (Steam Explosions) | 34-2 |
| 34.2.3 | Hydrogen Combustion and Detonation..... | 34-4 |
| 34.2.4 | High-Pressure Melt Ejection..... | 34-5 |
| 34.2.5 | Core Debris Coolability | 34-5 |
| 34.2.6 | Containment Pressurization from Decay Heat | 34-6 |
| 34.2.7 | Elevated Temperature (Equipment Survivability)..... | 34-7 |
| 34.2.8 | Summary..... | 34-7 |
| 34.3 | Analysis Method | 34-7 |
| 34.4 | Severe Accident Analyses | 34-8 |
| 34.4.1 | Accident Class 3BE – Intact Containment..... | 34-8 |
| 34.4.2 | Accident Class 3BE – Failed Containment..... | 34-10 |
| 34.4.3 | Accident Class 3BL – Intact Containment..... | 34-11 |
| 34.4.4 | Accident Class 3BR – Intact Containment..... | 34-12 |
| 34.4.5 | Accident Class 3C – Intact Containment | 34-13 |
| 34.4.6 | Accident Class 3C – Failed Containment | 34-14 |
| 34.4.7 | Accident Class 3D – Intact Containment | 34-14 |
| 34.4.8 | Accident Class 3D – Failed Containment | 34-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 34.4.9 | Accident Class 6E – Bypass Containment | 34-16 |
| 34.4.10 | Accident Class 6L – Bypass Containment | 34-17 |
| 34.4.11 | Accident Class 1AP | 34-17 |
| 34.4.12 | Accident Class 1A | 34-18 |
| 34.4.13 | Intermediate and Late Containment Failure Cases..... | 34-19 |
| 34.5 | Insights and Conclusions..... | 34-21 |
| 34.6 | References..... | 34-21 |
| | | |
| CHAPTER 35 | CONTAINMENT EVENT TREE ANALYSIS | |
| 35.1 | Introduction..... | 35-1 |
| 35.2 | Containment Event Tree – General Discussion..... | 35-1 |
| 35.3 | Event Tree Construction..... | 35-2 |
| 35.4 | Level 1/Level 2 Interface..... | 35-3 |
| 35.5 | Containment Event Tree Top Events | 35-3 |
| 35.5.1 | Severe Accident Phenomena Considerations | 35-3 |
| 35.5.2 | Operator Action and Systems Top-Event Considerations | 35-5 |
| 35.6 | Release Category Definitions | 35-7 |
| 35.6.1 | Release Category BP – Containment Bypass..... | 35-8 |
| 35.6.2 | Release Category CI – Containment Isolation Failure | 35-9 |
| 35.6.3 | Release Category CFE – Early Containment Failure | 35-9 |
| 35.6.4 | Release Category CFI – Intermediate Containment Failure | 35-9 |
| 35.6.5 | Release Category CFL – Late Containment Failure..... | 35-9 |
| 35.6.6 | Release Category CFV – Containment Venting..... | 35-10 |
| 35.6.7 | Release Category IC – Intact Containment | 35-10 |
| 35.7 | Top-Event Nodal Questions and Success Criteria..... | 35-10 |
| 35.7.1 | Top Event DP – RCS Depressurization After Core Uncovery..... | 35-11 |
| 35.7.2 | Top Event IS – Containment Isolation | 35-12 |
| 35.7.3 | Top Event IR – Reactor Cavity Flooding..... | 35-13 |
| 35.7.4 | Top Event RFL – Reflooding of a Degraded Core | 35-14 |
| 35.7.5 | Top Event VF – Debris Relocation to the Reactor Cavity | 35-14 |
| 35.7.6 | Top Event PC – Passive Containment Cooling..... | 35-15 |
| 35.7.7 | Top Event VNT – Containment Venting | 35-16 |
| 35.7.8 | Top Event IF – Intermediate Containment Failure..... | 35-16 |
| 35.7.9 | Top Event IG – Hydrogen Control System | 35-17 |
| 35.7.10 | Top Event DF – Diffusion Flame | 35-17 |
| 35.7.11 | Top Event DTE – Early Hydrogen Detonation | 35-18 |
| 35.7.12 | Top Event DFG – Hydrogen Deflagration | 35-19 |
| 35.7.13 | Top Event DTI – Intermediate Hydrogen Detonation..... | 35-19 |
| 35.8 | Summary | 35-20 |
| 35.9 | References..... | 35-20 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 36 REACTOR COOLANT SYSTEM DEPRESSURIZATION | | |
| 36.1 | Introduction..... | 36-1 |
| 36.2 | Definition of High Pressure..... | 36-1 |
| 36.3 | Node DP..... | 36-2 |
| 36.4 | Success Criteria..... | 36-2 |
| 36.4.1 | Accident Classes 3BE, 3BL, 3BR, 3C..... | 36-2 |
| 36.4.2 | Accident Class 3D/1D..... | 36-3 |
| 36.4.3 | Accident Classes 1A and 1AP..... | 36-3 |
| 36.4.4 | Steam Generator Tube Rupture – Accident Class 6..... | 36-4 |
| 36.4.5 | Anticipated Transient Without Scram – Accident Class 3A..... | 36-5 |
| 36.6 | References..... | 36-5 |
| CHAPTER 37 CONTAINMENT ISOLATION | | |
| 37.1 | Introduction..... | 37-1 |
| 37.2 | Definition of Containment Isolation..... | 37-1 |
| 37.3 | Success Criteria..... | 37-1 |
| 37.3.1 | Accident Classes 1A and 1AP..... | 37-2 |
| 37.3.2 | Accident Class 3A..... | 37-2 |
| 37.3.3 | Accident Class 3BR..... | 37-2 |
| 37.3.4 | Accident Class 3BE..... | 37-2 |
| 37.3.5 | Accident Class 3BL..... | 37-2 |
| 37.3.6 | Accident Class 3C..... | 37-2 |
| 37.3.7 | Accident Class 3D/1D..... | 37-3 |
| 37.3.8 | Accident Class 6..... | 37-3 |
| 37.4 | Summary..... | 37-3 |
| CHAPTER 38 REACTOR VESSEL REFLOODING | | |
| 38.1 | Introduction..... | 38-1 |
| 38.2 | Definition of Reflooding Success..... | 38-1 |
| 38.3 | Success Criteria..... | 38-1 |
| 38.3.1 | Accident Classes 1A and 1AP..... | 38-1 |
| 38.3.2 | Accident Class 3BR..... | 38-2 |
| 38.3.3 | Accident Class 3BE..... | 38-2 |
| 38.3.4 | Accident Class 3BL..... | 38-3 |
| 38.3.5 | Accident Class 3D/1D..... | 38-3 |
| 38.3.6 | Accident Class 6..... | 38-3 |
| 38.3.7 | Accident Class 3C..... | 38-3 |
| 38.3.8 | Accident Class 3A..... | 38-4 |
| 38.4 | Summary..... | 38-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 39 IN-VESSEL RETENTION OF MOLTEN CORE DEBRIS | | |
| 39.1 | Introduction..... | 39-1 |
| 39.2 | Background on the Application of IVR to the Passive Plant..... | 39-1 |
| 39.3 | Application of IVR to the AP1000 Passive Plant..... | 39-2 |
| 39.4 | Reactor Vessel Failure Criteria | 39-3 |
| 39.5 | In-Vessel Melt Progression and Relocation..... | 39-4 |
| 39.6 | Application of Heat Transfer Correlations to the AP1000 | 39-6 |
| | 39.6.1 Debris Pool to Vessel Wall Heat Transfer | 39-6 |
| | 39.6.2 Vessel Wall to External Cooling Water Heat Transfer | 39-7 |
| 39.7 | Quantification of Margin to Failure of the Reactor Vessel Wall | 39-8 |
| | 39.7.1 Zirconium Oxidation Fraction Input Probability Distribution..... | 39-9 |
| | 39.7.2 Steel Mass Input Probability Distribution | 39-9 |
| | 39.7.3 Final Bounding State Timing Input Probability Distribution | 39-10 |
| | 39.7.4 Critical Heat Flux..... | 39-10 |
| | 39.7.5 Results and Conclusions of Heat Flux Quantification | 39-10 |
| 39.8 | Reactor Coolant System Depressurization | 39-11 |
| 39.9 | Reactor Cavity Flooding (Node IR) | 39-11 |
| | 39.9.1 Node IR Success Criteria | 39-12 |
| | 39.9.2 Cavity Flooding Scenario Dependencies | 39-13 |
| 39.10 | Reactor Vessel Insulation Design Concept..... | 39-15 |
| | 39.10.1 Description of Reactor Vessel Insulation and Venting | 39-15 |
| | 39.10.2 Design Analysis of the Insulation and Support Frame | 39-17 |
| 39.11 | Reactor Vessel External Surface Treatment..... | 39-18 |
| 39.12 | Reactor Vessel Failure (Node VF) | 39-18 |
| | 39.12.1 Node VF Success Criteria..... | 39-18 |
| 39.13 | Summary | 39-19 |
| 39.14 | References..... | 39-19 |
| ATTACHMENT 39A AP1000 IN-VESSEL CORE MELTING RELOCATION | | |
| | 39A.1 Introduction..... | 39A-1 |
| | 39A.2 Phenomenological Issues | 39A-1 |
| | 39A.2.1 Focusing Effect..... | 39A-1 |
| | 39A.2.2 Material Interaction..... | 39A-1 |
| | 39A.3 AP1000 Reactor Vessel Lower Internals Geometry..... | 39A-1 |
| | 39A.4 Modeling of Core and Reactor Vessel Lower Internals Heatup | 39A-2 |
| | 39A.4.1 MAAP4 Model | 39A-2 |
| | 39A.4.2 Finite Difference Modeling..... | 39A-3 |
| | 39A.4.3 Relocation of In-Core Debris to Lower Plenum..... | 39A-3 |
| | 39A-5 Base Core Damage Sequence for In-Vessel Retention..... | 39A-3 |
| | 39A.5.1 Core Heatup and Formation of In-Core Molten Debris Layers..... | 39A-4 |
| | 39A.5.2 Melting of Core Shroud and Core Barrel..... | 39A-6 |
| | 39A.5.3 Initial Relocation of Molten Core Debris to Lower Plenum | 39A-7 |
| | 39A.5.4 Lower Plenum Debris Pool Formation..... | 39A-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 39A.6 | Potential for Debris Interaction | 39A-12 |
| 39A.7 | Conclusions from Analysis of AP1000 In-Vessel Core Melting and Relocation | 39A-12 |
| 39A.8 | References..... | 39A-13 |
| CHAPTER 40 PASSIVE CONTAINMENT COOLING, LONG TERM CONTAINMENT INTEGRITY AND CONTAINMENT VENTING | | |
| 40.1 | Passive Containment Cooling System..... | 40-1 |
| 40.2 | Passive Containment Cooling Water – Node PC | 40-2 |
| | 40.2.1 Node PC Success Criteria | 40-2 |
| | 40.2.2 Operator Action | 40-2 |
| | 40.2.3 Node PC Failure Probability..... | 40-3 |
| 40.3 | Containment Venting – Node VT | 40-3 |
| | 40.3.1 Venting Success Criteria..... | 40-3 |
| | 40.3.2 Venting Failure Probability..... | 40-4 |
| 40.4 | Intermediate Containment Failure – Node IF..... | 40-4 |
| | 40.4.1 Success Criterion | 40-5 |
| | 40.4.2 Intermediate Containment Failure Probability | 40-5 |
| 40.5 | References..... | 40-5 |
| CHAPTER 41 HYDROGEN MIXING AND COMBUSTION ANALYSIS | | |
| 41.1 | Discussion of the Issue..... | 41-1 |
| 41.2 | Controlling Phenomena..... | 41-2 |
| 41.3 | Major Assumptions and Phenomenological Uncertainties..... | 41-3 |
| | 41.3.1 Hydrogen Generation..... | 41-3 |
| | 41.3.2 Containment Pressure | 41-3 |
| | 41.3.3 Flammability Limits..... | 41-3 |
| | 41.3.4 Detonation Limits and Loads..... | 41-4 |
| | 41.3.5 Igniter System | 41-4 |
| | 41.3.6 Other Ignition Sources | 41-5 |
| | 41.3.7 Severe Accident Management Actions | 41-5 |
| 41.4 | Hydrogen Generation and Mixing..... | 41-5 |
| | 41.4.1 Accident Class 3BE – Failure of Gravity Injection..... | 41-6 |
| | 41.4.2 Accident Class 3BL – Failure of Gravity Recirculation..... | 41-9 |
| | 41.4.3 Accident Class 3BR – Large LOCA with Accumulator Failure | 41-10 |
| | 41.4.4 Accident Class 3C..... | 41-11 |
| | 41.4.5 Accident Classes 3D and 1D..... | 41-12 |
| | 41.4.6 Accident Class 1AP | 41-12 |
| | 41.4.7 Accident Class 1A | 41-13 |
| | 41.4.8 Accident Class 3A | 41-13 |
| | 41.4.9 Accident Class 6 | 41-13 |
| | 41.4.10 Overall Mixing Insights | 41-14 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| 41.5 | Hydrogen Burning at Igniters..... | 41-15 |
| 41.6 | Early Hydrogen Combustion..... | 41-15 |
| 41.6.1 | Hydrogen Generation Rates..... | 41-15 |
| 41.6.2 | Hydrogen Release Locations..... | 41-17 |
| 41.6.3 | Early Hydrogen Combustion Ignition Sources..... | 41-18 |
| 41.7 | Diffusion Flame Analysis – CET Node DF..... | 41-18 |
| 41.7.1 | AP1000 Diffusion Flame Mitigation Strategy..... | 41-19 |
| 41.7.2 | Node DF Containment Failure Probability Assignment..... | 41-20 |
| 41.8 | Early Hydrogen Detonation – Containment Event Tree Node DTE..... | 41-21 |
| 41.8.1 | Containment Success Criteria at Node DTE..... | 41-21 |
| 41.8.2 | Early Hydrogen Detonation Decomposition Event Tree..... | 41-22 |
| 41.9 | Deflagration in Time Frame 3..... | 41-23 |
| 41.9.1 | Containment Success Criterion at Node DFL..... | 41-23 |
| 41.9.2 | AICC Peak Pressure..... | 41-24 |
| 41.9.3 | Conditional Containment Failure Probability from Deflagration..... | 41-25 |
| 41.10 | Detonation in Intermediate Time Frame..... | 41-29 |
| 41.10.1 | Containment Success Criterion at Node DTI..... | 41-29 |
| 41.10.2 | Mixing and Stratification..... | 41-29 |
| 41.10.3 | Quantification of DTI Failure Probabilities..... | 41-30 |
| 41.11 | Safety Margin Basis Containment Performance Requirement..... | 41-30 |
| 41.12 | Summary..... | 41-31 |
| 41.13 | References..... | 41-31 |
| ATTACHMENT 41A AP1000 SPECIFIC MAAP4.04 ANALYSES..... | | 41A-1 |
| ATTACHMENT 41B ANALYSIS OF HYDROGEN BURNING AT IGNITERS..... | | 41B-1 |
| CHAPTER 42 CONDITIONAL CONTAINMENT FAILURE PROBABILITY DISTRIBUTION | | |
| 42.1 | Introduction..... | 42-1 |
| 42.2 | Probabilistic Model..... | 42-1 |
| 42.3 | Containment Failure Characteristics..... | 42-2 |
| 42.3.1 | Median Values for Containment Failure..... | 42-2 |
| 42.3.2 | Uncertainties in Containment Failure..... | 42-3 |
| 42.4 | Containment Failure Predictions..... | 42-4 |
| 42.4.1 | Containment Cylindrical Shell..... | 42-4 |
| 42.4.2 | Ellipsoidal Upper Head..... | 42-5 |
| 42.4.3 | Equipment Hatches..... | 42-5 |
| 42.4.4 | Personnel Airlock..... | 42-6 |
| 42.5 | Overall Failure Distribution..... | 42-6 |
| 42.6 | Summary and Conclusions..... | 42-7 |
| 42.7 | References..... | 42-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| CHAPTER 43 | RELEASE FREQUENCY QUANTIFICATION | |
| 43.1 | Introduction..... | 43-1 |
| 43.2 | Plant Damage State Frequency Calculations..... | 43-2 |
| 43.3 | Containment Event Tree Node Frequencies..... | 43-2 |
| | 43.3.1 CET Nodes..... | 43-2 |
| | 43.3.2 CET Node Probabilities From Boolean Expressions..... | 43-3 |
| | 43.3.3 Probabilities for Hydrogen-Related CET Nodes..... | 43-6 |
| | 43.3.4 Other CET Node Probabilities..... | 43-6 |
| 43.4 | Containment Event Tree Quantification..... | 43-7 |
| | 43.4.1 Containment Event Tree..... | 43-7 |
| | 43.4.2 Dominant CET Sequences..... | 43-7 |
| | 43.4.3 LRF Cutsets for Dominant Sequences..... | 43-7 |
| 43.5 | Summary of Results..... | 43-7 |
| 43.6 | Importance and Sensitivity Analyses..... | 43-8 |
| | 43.6.1 CET Event Node Importance Analysis..... | 43-8 |
| | 43.6.2 No Credit Taken for DP Node for PDS-6..... | 43-8 |
| | 43.6.3 Lesser Reliability for Containment Isolation..... | 43-8 |
| | 43.6.4 Lesser Reliability for Hydrogen Igniters..... | 43-8 |
| | 43.6.5 Lesser Reliability for PCS..... | 43-9 |
| | 43.6.6 No Credit for Depressurization for High Pressure PDS..... | 43-9 |
| | 43.6.7 Set PDS-3C Vessel Failure Probability to 1.0..... | 43-9 |
| | 43.6.8 Set 3D and 1AP Diffusion Flame and Detonation Failure Probability to 1.0..... | 43-9 |
| 43.7 | Other Importance and Sensitivity Analyses..... | 43-9 |
| | 43.7.1 Initiating Event Importances..... | 43-9 |
| | 43.7.2 Sensitivity to Standby Systems..... | 43-10 |
| | 43.7.3 Sensitivity to Standby Systems With Credit for Manual DAS..... | 43-10 |
| | 43.7.4 Treatment of PCS Annulus Drain Plugging in the AP1000 PRA..... | 43-10 |
| 43.8 | Conclusions and Insights..... | 43-11 |
| ATTACHMENT 43A | PDS CALCULATIONS..... | 43A-1 |
| ATTACHMENT 43B | DP NODE PROBABILITY FOR PDS..... | 43B-1 |
| ATTACHMENT 43C | EVALUATION OF OPERATOR ACTIONS..... | 43C-1 |
| ATTACHMENT 43D | EFFECT OF "PRE-EXISTING CONTAINMENT OPENING" ON LRF..... | 43D-1 |
| ATTACHMENT 43E | EFFECT OF CONTAINMENT AIR-COOLING FAILURE ON PLANT RISK..... | 43E-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 44 MAAP4 CODE DESCRIPTION AND AP1000 MODELING | | |
| 44.0 | MAAP Background..... | 44-1 |
| 44.1 | MAAP4..... | 44-1 |
| 44.2 | The AP1000 MAAP4 Modeling..... | 44-3 |
| 44.3 | Benchmarking..... | 44-5 |
| 44.4 | Summary and Conclusions..... | 44-6 |
| 44.5 | References..... | 44-7 |
| CHAPTER 45 FISSION-PRODUCT SOURCE TERMS | | |
| 45.1 | Summary of AP1000 Release Categories..... | 45-1 |
| 45.2 | Release Category Source Terms..... | 45-2 |
| 45.2.1 | Release Category IC..... | 45-2 |
| 45.2.2 | Release Category BP..... | 45-2 |
| 45.2.3 | Release Category CI..... | 45-2 |
| 45.2.4 | Release Category CFE..... | 45-3 |
| 45.2.5 | Release Category CFI..... | 45-3 |
| 45.2.6 | Release Category CFL..... | 45-3 |
| 45.2.7 | Release Category CFV..... | 45-4 |
| 45.3 | Direct-Release Sensitivity Case..... | 45-4 |
| 45.4 | Summary..... | 45-4 |
| 45.5 | References..... | 45-4 |
| CHAPTERS 46 THROUGH 48 NOT USED | | |
| CHAPTER 49 OFFSITE DOSE RISK QUANTIFICATION | | |
| 49.1 | Introduction..... | 49-1 |
| 49.2 | Conformance with Regulatory Requirements..... | 49-2 |
| 49.3 | Assumptions..... | 49-2 |
| 49.4 | Methodology..... | 49-2 |
| 49.5 | Dose Evaluation Results and Discussion..... | 49-5 |
| 49.6 | Quantification of Site Risk..... | 49-6 |
| 49.7 | Risk Quantification Results..... | 49-7 |
| 49.8 | References..... | 49-7 |
| CHAPTER 50 IMPORTANCE AND SENSITIVITY ANALYSES | | |
| 50.1 | Introduction..... | 50-1 |
| 50.2 | Importance Analyses for Core Damage..... | 50-1 |
| 50.2.1 | Initiating Event Importances..... | 50-2 |
| 50.2.2 | Accident Sequence Importances..... | 50-3 |
| 50.2.3 | End State Importances..... | 50-4 |
| 50.2.4 | Common Cause Failure Importances..... | 50-4 |
| 50.2.5 | Human Error Importances..... | 50-5 |
| 50.2.6 | Component Importances..... | 50-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|--------------|
| 50.3 | System Importances for Core Damage | 50-7 |
| 50.4 | Human Error Sensitivity Analyses | 50-8 |
| 50.4.1 | Set HEPs to 1.0 (Failure) in Core Damage Output File | 50-9 |
| 50.4.2 | Set HEPs to 0.0 (Success) in Core Damage Output File | 50-10 |
| 50.4.3 | Set HEPs to 0.1 in Core Damage Output File | 50-10 |
| 50.5 | Other Sensitivity Analyses for Core Damage | 50-10 |
| 50.5.1 | Impact of Passive System Check Valves on Core Damage Frequency | 50-10 |
| 50.5.2 | Sensitivity to Squib Valve Failure Probability | 50-11 |
| 50.5.3 | Sensitivity to Circuit Breaker Failure Probability | 50-11 |
| 50.5.4 | Sensitivity to Standby Systems | 50-12 |
| 50.5.5 | Sensitivity to Standby Systems; Manual DAS Credited | 50-14 |
| 50.6 | Results | 50-15 |
| CHAPTER 51 UNCERTAINTY ANALYSIS | | |
| 51.1 | Introduction | 51-1 |
| 51.2 | Input Data/Error Factors | 51-2 |
| 51.3 | Input Files | 51-3 |
| 51.4 | Output Files | 51-3 |
| 51.5 | Sensitivity Analyses | 51-3 |
| 51.5.1 | Sensitivity to Simulation Parameters | 51-3 |
| 51.5.2 | Sensitivity to Key Basic Events | 51-3 |
| 51.5.3 | Sensitivity to Operator Actions | 51-4 |
| 51.6 | Summary of Results | 51-6 |
| 51.7 | References | 51-8 |
| ATTACHMENT 51A ASSIGNMENT OF ERROR FACTORS TO BASIC EVENT PROBABILITIES | | |
| | | 51A-1 |
| ATTACHMENT 51B @RISK UNCERTAINTY ANALYSIS RESULTS | | |
| | | 51B-1 |
| CHAPTERS 52 AND 53 NOT USED | | |
| CHAPTER 54 LOW-POWER AND SHUTDOWN RISK ASSESSMENT | | |
| 54.1 | Introduction | 54-1 |
| 54.2 | Data Analysis | 54-2 |
| 54.3 | Initiating Event Analysis | 54-3 |
| 54.4 | Event Tree/Mitigation System Evaluation | 54-3 |
| 54.5 | Common Cause Analysis Update for AP1000 | 54-3 |
| 54.6 | Human Reliability Assessment for AP1000 | 54-5 |
| 54.7 | Core Damage Quantification | 54-6 |
| 54.7.1 | Discussion of Results | 54-9 |
| 54.8 | Estimation of Shutdown Large Release Frequency | 54-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 54.9 | Sensitivity Analyses | 54-10 |
| 54.9.1 | Case 1 – Minimum Equipment per Tech Specs During Drained Conditions..... | 54-10 |
| 54.9.2 | Case 2 – No Credit for Standby Nonsafety Systems | 54-11 |
| 54.9.3 | Case 3 – HEPs Set Equal to 0.5 | 54-12 |
| 54.9.4 | Case 4 – No Credit for Standby Nonsafety Systems – Credit for Manual DAS | 54-12 |
| 54.9.5 | Case 5 – Assessment of Containment Closure Failure Probability | 54-13 |
| 54.10 | Conclusions..... | 54-17 |
| 54.11 | Reference | 54-17 |
| CHAPTER 55 | AP1000 SEISMIC MARGINS EVALUATION | |
| 55.1 | Seismic Margin HCLPF Methodology..... | 55-1 |
| 55.2 | Calculation of HCLPF Values..... | 55-1 |
| 55.2.1 | Seismic Margin HCLPF Methodology..... | 55-1 |
| 55.2.2 | Calculation of HCLPF Values | 55-2 |
| 55.3 | Seismic Margin Model | 55-11 |
| 55.3.1 | Major SMA Model Assumptions..... | 55-11 |
| 55.3.2 | Seismic Initiating Events | 55-12 |
| 55.3.3 | Initiating Event Category HCLPFs | 55-13 |
| 55.4 | Calculation of Plant HCLPF | 55-16 |
| 55.4.1 | HCLPFs for Basic Events | 55-16 |
| 55.4.2 | Calculation of Initiating Event HCLPFs..... | 55-17 |
| 55.5 | Results and Insights..... | 55-17 |
| 55.5.1 | AP1000 SMA Results..... | 55-17 |
| 55.5.2 | AP1000 SMA Insights..... | 55-18 |
| 55.6 | References..... | 55-20 |
| CHAPTER 56 | INTERNAL FLOODING ANALYSIS | |
| 56.1 | Introduction..... | 56-1 |
| 56.1.1 | Definitions | 56-1 |
| 56.2 | Methodology | 56-1 |
| 56.2.1 | Summary of Methodology | 56-1 |
| 56.2.2 | Information Collection..... | 56-2 |
| 56.2.3 | Initial Screening Assessment | 56-2 |
| 56.2.4 | Detailed Screening Assessment | 56-4 |
| 56.2.5 | Identification of Flood-Induced Initiating Events | 56-5 |
| 56.2.6 | Initiating Event Frequencies | 56-6 |
| 56.3 | Assumptions..... | 56-6 |
| 56.3.1 | General Flooding Analysis Assumptions and Engineering Judgments | 56-6 |
| 56.3.2 | AP1000-Specific Assumptions | 56-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 56.4 | Information Collection | 56-10 |
| 56.4.1 | PRA-Modeled Equipment and Locations | 56-10 |
| 56.4.2 | Identification of Areas for Flooding Evaluation..... | 56-10 |
| 56.5 | At-Power Operations..... | 56-10 |
| 56.5.1 | Initial Screening Assessment | 56-11 |
| 56.5.2 | Detailed Screening Assessment | 56-11 |
| 56.5.3 | Identification of Flood-Induced Initiating Events | 56-26 |
| 56.5.4 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-29 |
| 56.5.5 | Quantification of At-Power Flood-Induced Events..... | 56-36 |
| 56.6 | Internal Flooding During Low-Power and Shutdown Conditions | 56-38 |
| 56.6.1 | Detailed Screening Assessment | 56-38 |
| 56.6.2 | Identification of Flood-Induced Initiating Events | 56-39 |
| 56.6.3 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-40 |
| 56.6.4 | Quantification of Shutdown Internal Flooding Scenario CDFs | 56-45 |
| 56.6.5 | Total Shutdown Flooding Core Damage Frequency..... | 56-47 |
| 56.6.6 | Seismically Induced Flooding..... | 56-47 |
| 56.6.7 | Flooding Hazards During Refueling Outages | 56-47 |
| 56.6.8 | Summary of Results..... | 56-47 |
| 56.7 | Large Release Frequency Estimates for Internal Flooding | 56-48 |
| 56.8 | Results of AP1000 Internal Flooding Analysis | 56-49 |
| CHAPTER 57 FIRE RISK ASSESSMENT | | |
| 57.1 | Introduction..... | 57-1 |
| 57.2 | Qualitative Analysis | 57-1 |
| 57.2.1 | AP600 Qualitative Analysis..... | 57-1 |
| 57.2.2 | AP1000 Qualitative Analysis..... | 57-5 |
| 57.2.3 | AP1000 Fire Areas | 57-6 |
| 57.3 | Initiating Event Frequencies..... | 57-6 |
| 57.3.1 | Introduction..... | 57-6 |
| 57.3.2 | Methodology..... | 57-7 |
| 57.3.3 | Results for Plant Except Containment and the Main Control Room..... | 57-7 |
| 57.3.4 | Results for the Containment..... | 57-7 |
| 57.3.5 | Results for the Main Control Room..... | 57-7 |
| 57.4 | Development of Fire Scenarios | 57-10 |
| 57.4.1 | Spurious Actuation Model | 57-11 |
| 57.4.2 | Propagation Model..... | 57-14 |
| 57.4.3 | Fire Suppression Model | 57-15 |
| 57.4.4 | Operation Actions | 57-15 |
| 57.4.5 | Development of Fire Scenarios..... | 57-16 |
| 57.5 | Calculation of Conditional Core Damage Probabilities (CCDP)..... | 57-22 |
| 57.6 | Calculation of CDF from Fire Events | 57-23 |
| 57.6.1 | Calculation of Plant Fire CDF | 57-23 |
| 57.6.2 | Comments on Plant Areas..... | 57-23 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| | 57.6.3 Importances of Fire Areas | 57-25 |
| | 57.6.4 Conclusion | 57-27 |
| 57.7 | Sensitivity Studies | 57-27 |
| | 57.7.1 Manual Fire Suppression Systems | 57-27 |
| | 57.7.2 Sensitivity Analysis of the Probability of a Spurious Actuation of ADS Valves | 57-27 |
| | 57.7.3 Sensitivity of Human Action on Fire | 57-28 |
| | 57.7.4 Sensitivity Analysis on Ignition Frequencies | 57-28 |
| | 57.7.5 Sensitivity Analysis on ADS Actuation by DAS | 57-29 |
| | 57.7.6 Sensitivity Analysis on 1E to Non-1E Separation in the Containment | 57-29 |
| | 57.7.7 Sensitivity Analysis to Area to Area Propagation | 57-30 |
| | 57.7.8 Importance of Hot Shorts | 57-30 |
| 57.8 | Shutdown Fire Analysis | 57-30 |
| | 57.8.1 Introduction | 57-30 |
| | 57.8.2 Evaluation of AP1000 Shutdown Risk (Non-Drained Conditions) | 57-33 |
| | 57.8.3 Evaluation for Drained Shutdown Operations | 57-37 |
| | 57.8.4 Evaluation of Main Control Room | 57-40 |
| 57.9 | Conclusion and Insights | 57-40 |
| | 57.9.1 At-Power Analysis | 57-40 |
| | 57.9.2 Shutdown Fire Analysis | 57-41 |
| | 57.9.3 Conclusions | 57-42 |
| 57.10 | References | 57-42 |
| ATTACHMENT 57A CALCULATION OF SCENARIO CCDPs | | 57A-1 |
| | 57A.1 Calculation of Scenario CCDPs | 57A-1 |
| | 57A.2 Calculation of Scenario CCDPs for Overly Conservative Cases | 57A-3 |
| ATTACHMENT 57B MODELING OF OPERATOR ACTIONS IN FIRE SCENARIOS | | 57B-1 |
| | 57B.1 Calculation of Failure Probability of OPA-01 | 57B-1 |
| | 57B.2 Calculation of Failure Probability of OPA-02 | 57B-3 |
| | 57B.3 Operator Actions at Remote Shutdown Panel | 57B-6 |
| | 57B.4 More Reliable REC-MANDAS | 57B-6 |
| ATTACHMENT 57C FIRE AREA EVENT TREES DEFINING SCENARIOS | | 57C-1 |
| ATTACHMENT 57D AP1000 POTENTIAL FOR FIRE-INDUCED SPURIOUS ACTUATION OF FUNCTIONS THAT RESULT IN A BREACH OF HIGH/LOW PRESSURE BOUNDARY | | 57D-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 58 WINDS, FLOODS, AND OTHER EXTERNAL EVENTS | | |
| 58.1 | Introduction..... | 58-1 |
| 58.2 | External Events Analysis..... | 58-1 |
| 58.2.1 | Severe Winds and Tornadoes..... | 58-1 |
| 58.2.2 | External Floods..... | 58-2 |
| 58.2.3 | Transportation and Nearby Facility Accidents..... | 58-2 |
| 58.3 | Conclusion..... | 58-2 |
| 58.4 | References..... | 58-3 |
| CHAPTER 59 PRA RESULTS AND INSIGHTS | | |
| 59.1 | Introduction..... | 59-1 |
| 59.2 | Use of PRA in the Design Process..... | 59-3 |
| 59.3 | Core Damage Frequency from Internal Initiating Events at Power..... | 59-4 |
| 59.3.1 | Dominant Core Damage Sequences..... | 59-6 |
| 59.3.2 | Component Importances for At-Power Core Damage Frequency..... | 59-7 |
| 59.3.3 | System Importances for At-Power Core Damage..... | 59-8 |
| 59.3.4 | System Failure Probabilities for At-Power Core Damage..... | 59-9 |
| 59.3.5 | Common Cause Failure Importances for At-Power Core Damage..... | 59-9 |
| 59.3.6 | Human Error Importances for At-Power Core Damage..... | 59-9 |
| 59.3.7 | Accident Class Importances..... | 59-10 |
| 59.3.8 | Sensitivity Analyses Summary for At-Power Core Damage..... | 59-11 |
| 59.3.9 | Summary of Important Level 1 At-Power Results..... | 59-12 |
| 59.4 | Large Release Frequency for Internal Initiating Events at Power..... | 59-15 |
| 59.4.1 | Dominant Large Release Frequency Sequences..... | 59-15 |
| 59.4.2 | Summary of Important Level 2 At-Power Results..... | 59-16 |
| 59.5 | Core Damage and Severe Release Frequency from Events at Shutdown..... | 59-19 |
| 59.5.1 | Summary of Shutdown Level 1 Results..... | 59-19 |
| 59.5.2 | Large Release Frequency for Shutdown and Low-Power Events..... | 59-22 |
| 59.5.3 | Shutdown Results Summary..... | 59-22 |
| 59.6 | Results from Internal Flooding, Internal Fire, and Seismic Margin Analyses..... | 59-23 |
| 59.6.1 | Results of Internal Flooding Assessment..... | 59-23 |
| 59.6.2 | Results of Internal Fire Assessment..... | 59-24 |
| 59.6.3 | Results of Seismic Margin Analysis..... | 59-25 |
| 59.7 | Plant Dose Risk From Release of Fission-Products..... | 59-26 |
| 59.8 | Overall Plant Risk Results..... | 59-26 |
| 59.9 | Plant Features Important to Reducing Risk..... | 59-27 |
| 59.9.1 | Reactor Design..... | 59-28 |
| 59.9.2 | Systems Design..... | 59-28 |
| 59.9.3 | Instrumentation and Control Design..... | 59-31 |
| 59.9.4 | Plant Layout..... | 59-32 |
| 59.9.5 | Containment Design..... | 59-32 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 59.10 | PRA Input to Design Certification Process | 59-36 |
| 59.10.1 | PRA Input to Reliability Assurance Program | 59-36 |
| 59.10.2 | PRA Input to Tier 1 Information..... | 59-36 |
| 59.10.3 | PRA Input to MMI/Human Factors/Emergency Response Guidelines | 59-36 |
| 59.10.4 | Summary of PRA Based Insights..... | 59-37 |
| 59.10.5 | Combined License Information..... | 59-37 |
| 59.11 | References..... | 59-38 |
| APPENDIX A | THERMAL HYDRAULIC ANALYSIS TO SUPPORT SUCCESS CRITERIA | A-1 |
| APPENDIX B | EX-VESSEL SEVERE ACCIDENT PHENOMENA | B-1 |
| APPENDIX C | ADDITIONAL ASSESSMENT OF AP1000 DESIGN FEATURES..... | C-1 |
| APPENDIX D | EQUIPMENT SURVIVABILITY ASSESSMENT..... | D-1 |
| APPENDIX E | AP1000 PRA FAULT TREE PICTURES FOR LEVEL 1 ANALYSIS FOR EVENTS AT POWER OPERATION | E-1 |

LIST OF TABLES

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 2-1 | Internal Initiating Event Grouping Plant Systems and Equipment Available for Transient/Accident Conditions (Sheets 1 – 10)..... | 2-28 |
| 2-2 | NUREG/CR 3862 Initiator Categories (Sheets 1 – 4)..... | 2-38 |
| 2-3 | NUREG/CR 3862 Initiator Categories not Considered in the AP1000 PRA Analysis..... | 2-42 |
| 2-4 | AP1000 Internal Initiating Event Frequencies (Sheets 1 – 3) | 2-43 |
| 2-5 | Initiating Event Frequencies Used in Event Trees Quantification..... | 2-46 |
| 2A-1 | Summary of Primary System Piping Data | 2A-2 |
| 2A-2 | Summary of Primary System Pipe Break Frequency Quantification | 2A-3 |
| 2A-3 | Summary of Steam Generator Tube Rupture Events..... | 2A-4 |
| 2A-4 | Spurious Stuck-Open Pressurizer Safety Valve..... | 2A-5 |
| 2A-5 | Interface Break on Accumulator Lines..... | 2A-6 |
| 2A-6 | Interface Break on IRWST Injection Lines..... | 2A-7 |
| 2A-7 | Initiating Events Review Data Summary (Sheets 1 – 8)..... | 2A-8 |
| 2B-1 | Summary of Main Steam Line and Feedwater Line Piping Data for Secondary Side Break Frequency Quantification | 2B-2 |
| 2B-2 | Secondary Side Line Break Frequency Quantification..... | 2B-3 |
| 2B-3 | Stuck-Open Main Steam Line Safety Valve Frequency Quantification (Sheets 1 – 2) | 2B-4 |
| 3-1 | Loss of CCS/SWS Initiating Event Fault Tree CSWF Success Criteria Summary | 3-8 |
| 3-2 | Spurious Actuation of Automatic Depressurization Failure Criteria Summary | 3-9 |
| 3-3 | Evaluation of Spurious Automatic Depressurization System Frequencies (Sheets 1 – 6) | 3-10 |
| 4-1 | AP1000 Large LOCA Event End State Summary..... | 4-112 |
| 4-2 | AP1000 Spurious ADS Actuation Event End State Summary..... | 4-112 |
| 4-3 | AP1000 Medium LOCA Event End State Summary | 4-113 |
| 4-4 | AP1000 CMT Line Break LOCA Event End State Summary..... | 4-114 |
| 4-5 | AP1000 SI Line Break Event End State Summary | 4-115 |
| 4-6 | AP1000 Small LOCA Event End State Summary..... | 4-116 |
| 4-7 | AP1000 RCS Leak Event End State Summary | 4-117 |
| 4-8 | AP1000 PRHR Tube Rupture Event End State Summary | 4-117 |
| 4-9 | AP1000 SGTR Event End State Summary | 4-118 |
| 4-10 | AP1000 Vessel Rupture Event End State Summary | 4-119 |
| 4-11 | AP1000 Interfacing Systems LOCA Event End State Summary..... | 4-119 |
| 4-12 | AP1000 Transients with MFW Event End State Summary..... | 4-120 |
| 4-13 | AP1000 Transients with Loss of RCS Flow Event End State Summary..... | 4-121 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 4-14 | AP1000 Transients with Loss of MFW to One SG Event End State Summary | 4-122 |
| 4-15 | AP1000 Transients with Core Power Excursion Event End State Summary | 4-123 |
| 4-16 | AP1000 Transients with Loss of CCW/SW Event End State Summary | 4-124 |
| 4-17 | AP1000 Transients without Main Feedwater Event End State Summary | 4-125 |
| 4-18 | AP1000 Transients with Loss of Condenser Event End State Summary..... | 4-126 |
| 4-19 | AP1000 Transients with Loss of Compressed Air Event End State Summary..... | 4-127 |
| 4-20 | AP1000 Loss of Offsite Power Event End State Summary..... | 4-128 |
| 4-21 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-129 |
| 4-22 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-130 |
| 4-23 | AP1000 Stuck Open Secondary Side Safety Valve Event End State Summary | 4-131 |
| 4-24 | AP1000 ATWS Precursor without MFW Event End State Summary..... | 4-132 |
| 4-25 | AP1000 ATWS Precursor with SI Event End State Summary..... | 4-133 |
| 4-26 | AP1000 ATWS Precursor Transients with MFW Event End State Summary | 4-134 |
| 4A-1 | End States (Plant Damage States) | 4A-17 |
| 4A-2 | Summary of Systems Associated with Mitigating Functions for AP1000..... | 4A-18 |
| 5-1 | AP1000 Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-2 | AP1000 Non Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-3 | AP1000 Support Systems Interdependency Matrix (Sheets 1 – 14)..... | 5-4 |
| 5-4 | AP1000 Safety-Related Front Line Plant Systems Letter Designators | 5-18 |
| 5-5 | AP1000 Non Safety-Related Front Line Plant Systems Letter Designators | 5-18 |
| 5-6 | AP1000 Front Line System Dependencies Matrix (Sheets 1 – 18) | 5-19 |
| 6-1 | Summary of Event Tree Top Events Success Criteria (Internal Initiating Events at Power Cases) (Sheets 1 – 34) | 6-20 |
| 6-2 | Summary of Success Criteria for the Mitigating Systems (Sheets 1 – 9) | 6-54 |
| 6-3 | Summary of Success Criteria for Operator Actions and Mission Times (Sheets 1 – 4) | 6-68 |
| 7-1 | Example for Fault Tree XXX Success Criteria Summary | 7-15 |
| 7-2 | Example for System Dependency Matrix..... | 7-15 |
| 7-3 | Example for Component Test Assumptions..... | 7-16 |
| 7-4 | Example for Component Maintenance Assumptions | 7-16 |
| 7-5 | Example for Operator Actions and Misposition Analysis Summary | 7-16 |
| 7-6 | Fault Tree Identification Codes (Sheets 1 – 3)..... | 7-17 |
| 7-7 | System Identification Codes for Basic Events (Sheets 1 – 3)..... | 7-20 |
| 7-8 | Component Identification Codes (Sheets 1 – 7)..... | 7-23 |
| 7-9 | Failure Mode Identification Codes (Sheets 1 – 3)..... | 7-30 |
| 8-1 | List of Passive Residual Heat Removal System Fault Trees | 8-7 |
| 8-2a | Fault Tree “PRT” Success Criteria..... | 8-8 |
| 8-2b | Fault Tree “PRTA” Success Criteria..... | 8-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 8-2c | Fault Tree "PRL" Success Criteria..... | 8-10 |
| 8-2d | Fault Tree "PRP" Success Criteria..... | 8-11 |
| 8-2e | Fault Tree "PRS" Success Criteria..... | 8-12 |
| 8-2f | Fault Tree "PRW" Success Criteria..... | 8-13 |
| 8-2g | Fault Tree "PRI" Success Criteria..... | 8-14 |
| 8-3 | System Dependency Matrix..... | 8-15 |
| 8-4 | Component Test Assumptions..... | 8-16 |
| 8-5 | Component Maintenance Assumptions..... | 8-17 |
| 8-6 | Operator Actions and Misposition Analysis Summary..... | 8-18 |
| 8-7 | Common Cause Failures Summary..... | 8-19 |
| 8-8 | Basic Events Database for the PRHR System Fault Trees (Sheets 1 – 3)..... | 8-20 |
| 9-1 | List of System Fault Trees..... | 9-9 |
| 9-2a | Fault Tree CM2AB Success Criteria Summary..... | 9-10 |
| 9-2b | Fault Tree CM2SL Success Criteria Summary..... | 9-11 |
| 9-2c | Fault Tree CM2L Success Criteria Summary..... | 9-12 |
| 9-2d | Fault Tree CM2P Success Criteria Summary..... | 9-13 |
| 9-2e | Fault Tree CM1A Success Criteria Summary..... | 9-14 |
| 9-2f | Fault Tree CM2LLT Success Criteria Summary..... | 9-15 |
| 9-2g | Fault Tree CMBOTH Success Criteria Summary..... | 9-16 |
| 9-2h | Fault Tree CM2LA Success Criteria Summary..... | 9-17 |
| 9-3 | Notes Related to System Fault Tree Assumptions..... | 9-18 |
| 9-4 | System Dependency Matrix..... | 9-18 |
| 9-5 | Component Test Assumptions..... | 9-19 |
| 9-6 | Component Maintenance Assumptions..... | 9-19 |
| 9-7 | Operator Actions and Misposition Analysis Summary..... | 9-20 |
| 9-8 | Common Cause Failure Analysis Summary..... | 9-20 |
| 9-9 | Fault Tree Basic Events for Core Makeup Tank Subsystem (Sheets 1 – 3)..... | 9-21 |
| 10-1 | List of System Fault Trees..... | 10-5 |
| 10-2a | Fault Tree AC2AB Success Criteria Summary..... | 10-6 |
| 10-2b | Fault Tree AC1A Success Criteria Summary..... | 10-7 |
| 10-2c | Fault Tree ACBOTH Success Criteria Summary..... | 10-8 |
| 10-3 | Notes Related to System Fault Tree Assumptions..... | 10-9 |
| 10-4 | System Dependency Matrix..... | 10-9 |
| 10-5 | Component Test Assumptions..... | 10-9 |
| 10-6 | Component Maintenance Assumptions..... | 10-10 |
| 10-7 | Operator Actions and Misposition Analysis Summary..... | 10-10 |
| 10-8 | Common Cause Failure Analysis Summary..... | 10-10 |
| 10-9 | Fault Tree Basic Events for Accumulator Subsystem..... | 10-11 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 11-1a | List of ADS System Fault Trees (Sheets 1 – 2)..... | 11-8 |
| 11-1b | List of ADS System Fault Trees (for Plant Damage States Analysis)..... | 11-10 |
| 11-2a | ADS Success Criteria Versus Accident Conditions (Full Depressurization)..... | 11-11 |
| 11-2b | ADS Success Criteria Versus Accident Conditions (Partial Depressurization)..... | 11-12 |
| 11-2c | Automatic Depressurization System Fault Tree Summary (For Plant Damage States)..... | 11-13 |
| 11-2d | Fault Tree “ADA” Success Criteria | 11-13 |
| 11-2e | Fault Tree “ADAB” Success Criteria..... | 11-14 |
| 11-2f | Fault Tree “ADAL” Success Criteria..... | 11-15 |
| 11-2g | Fault Tree “ADB” Success Criteria..... | 11-15 |
| 11-2h | Fault Tree “ADL” Success Criteria..... | 11-16 |
| 11-2i | Fault Tree “ADM” Success Criteria..... | 11-16 |
| 11-2j | Fault Tree “ADMA” Success Criteria..... | 11-17 |
| 11-2k | Fault Tree “ADQ” Success Criteria | 11-17 |
| 11-2l | Fault Tree “ADS” Success Criteria | 11-18 |
| 11-2m | Fault Tree “ADT” Success Criteria..... | 11-18 |
| 11-2n | Fault Tree “ADW” Success Criteria..... | 11-19 |
| 11-2o | Fault Tree “AD1” Success Criteria | 11-19 |
| 11-2p | Fault Tree “AD1A” Success Criteria | 11-20 |
| 11-2q | Fault Tree “ADF” Success Criteria | 11-20 |
| 11-2r | Fault Tree “ADR” Success Criteria..... | 11-21 |
| 11-2s | Fault Tree “ADRA” Success Criteria..... | 11-21 |
| 11-2t | Fault Tree “ADU” Success Criteria | 11-22 |
| 11-2u | Fault Tree “ADUM” Success Criteria..... | 11-22 |
| 11-2v | Fault Tree “ADV” Success Criteria | 11-23 |
| 11-2w | Fault Tree “ADZ” Success Criteria..... | 11-23 |
| 11-2x | Fault Tree “ADQLT” Data Summary | 11-24 |
| 11-2y | Fault Tree “ADTLT” Success Criteria..... | 11-24 |
| 11-3 | Notes Related to ADS System Fault Tree Assumptions..... | 11-25 |
| 11-4 | System Dependencies Matrix..... | 11-26 |
| 11-5 | Component Test Assumptions..... | 11-27 |
| 11-6 | Component Maintenance Assumptions..... | 11-27 |
| 11-7 | Failure Probabilities Calculated | 11-27 |
| 11-8 | Operator Action Analysis Summary..... | 11-28 |
| 11-9 | Common Cause Failures Summary | 11-28 |
| 11-10 | Basic Events Data Base for the ADA System Fault Tree (Sheets 1 – 20)..... | 11-29 |
| 12-1 | List of System Fault Trees (FT) | 12-10 |
| 12-2a | Fault Tree “IW2AB” Success Criteria Summary | 12-11 |
| 12-2b | Fault Tree “IW2ABM” Success Criteria Summary..... | 12-12 |
| 12-2c | Fault Tree “IW2ABA” Success Criteria Summary | 12-13 |
| 12-2d | Fault Tree “IW2ABP” Success Criteria Summary | 12-14 |
| 12-2e | Fault Tree “IW2ABPM” Success Criteria Summary..... | 12-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 12-2f | Fault Tree "IW2ABB" Success Criteria Summary..... | 12-16 |
| 12-2g | Fault Tree "IW2ABBM" Success Criteria Summary..... | 12-17 |
| 12-2h | Fault Tree "IW1A" Success Criteria Summary..... | 12-18 |
| 12-2i | Fault Tree "IW1AM" Success Criteria Summary..... | 12-19 |
| 12-2j | Fault Tree "IWF" Success Criteria Summary..... | 12-20 |
| 12-2k | Fault Tree "RECIRC" Success Criteria Summary..... | 12-21 |
| 12-2l | Fault Tree "RECIRCP" Success Criteria Summary..... | 12-22 |
| 12-2m | Fault Tree "RECIRCB" Success Criteria Summary..... | 12-23 |
| 12-2n | Fault Tree "RECIRC1" Success Criteria Summary..... | 12-24 |
| 12-2o | Fault Tree "RECIRC1P" Success Criteria Summary..... | 12-25 |
| 12-2p | Fault Tree "RECIRC1B" Success Criteria Summary..... | 12-26 |
| 12-3 | System Dependency Matrix..... | 12-27 |
| 12-4 | Component Test Assumptions..... | 12-28 |
| 12-5 | Component Maintenance Assumptions..... | 12-28 |
| 12-6 | Failure Probabilities Calculated..... | 12-29 |
| 12-7 | Operator Actions and Misposition Analysis Summary..... | 12-29 |
| 12-8 | Common Cause Failure Analysis Summary..... | 12-30 |
| 12-9 | Fault Tree Basic Events (Sheets 1 – 11)..... | 12-31 |
| 13-1 | List of System Fault Trees..... | 13-7 |
| 13-2 | Fault Tree PCT Success Criteria Summary..... | 13-7 |
| 13-3 | Notes Related to System Fault Trees Assumptions..... | 13-7 |
| 13-4 | System Dependency Matrix..... | 13-8 |
| 13-5 | Component Test Assumptions..... | 13-8 |
| 13-6 | Component Maintenance Assumptions..... | 13-9 |
| 13-7 | Operator Actions and Misposition Analysis Summary..... | 13-9 |
| 13-8 | Common Cause Failure Analysis Summary..... | 13-9 |
| 13-9 | Fault Tree Basic Events for Passive Containment Cooling System..... | 13-10 |
| 14-1 | List of System Fault Trees (At-Power)..... | 14-8 |
| 14-2.a | Success Criteria Summary Fault Tree "FWT"..... | 14-9 |
| 14-2.b | Success Criteria Summary Fault Tree "FWF"..... | 14-10 |
| 14-2.c | Success Criteria Summary Fault Tree "SFWT"..... | 14-11 |
| 14-2.d | Success Criteria Summary Fault Tree "SFW"..... | 14-12 |
| 14-2.e | Success Criteria Summary Fault Tree "SFW1"..... | 14-13 |
| 14-2.f | Success Criteria Summary Fault Tree "SFWP"..... | 14-14 |
| 14-2.g | Success Criteria Summary Fault Tree "SFWM"..... | 14-15 |
| 14-2.h | Success Criteria Summary Fault Tree "SFWA"..... | 14-16 |
| 14-2.i | Success Criteria Summary Fault Tree "COND"..... | 14-17 |
| 14-2.j | Success Criteria Summary Fault Tree "COND1"..... | 14-18 |
| 14-2.k | Success Criteria Summary Fault Tree "CDS"..... | 14-19 |
| 14-2.l | Success Criteria Summary Fault Tree "TCCW"..... | 14-20 |
| 14-3 | Notes to System Fault Tree Assumptions..... | 14-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 14-4 | System Dependency Matrix (Sheets 1 – 2)..... | 14-22 |
| 14-5 | Component Test Assumptions..... | 14-24 |
| 14-6 | Component Maintenance Assumptions..... | 14-25 |
| 14-7 | Failure Probabilities Calculated in this Section..... | 14-25 |
| 14-8 | Operator Action Analysis Summary..... | 14-26 |
| 14-9 | Common Cause Failure (CCF) Summary..... | 14-27 |
| 14-10 | Fault Tree Basic Event for Main and Startup Feedwater System (Sheets 1 – 9) | 14-28 |
| 15-1 | List of System Fault Trees..... | 15-9 |
| 15-2a | Fault Tree CSBOR1 Success Criteria Summary | 15-10 |
| 15-2b | Fault Tree CVS1 Success Criteria Summary..... | 15-11 |
| 15-2c | Fault Tree CSAX Success Criteria Summary..... | 15-12 |
| 15-2d | Fault Tree SGHL Success Criteria Summary..... | 15-13 |
| 15-2e | Fault Tree CSP Success Criteria Summary | 15-14 |
| 15-3 | Notes Related to System Fault Tree Assumptions..... | 15-15 |
| 15-4 | System Dependency Matrix | 15-16 |
| 15-5 | Component Test Assumptions..... | 15-17 |
| 15-6 | Component Maintenance Assumptions..... | 15-18 |
| 15-7 | Operator Actions and Misposition Analysis Summary..... | 15-19 |
| 15-8 | Common Cause Failure Analysis Summary..... | 15-20 |
| 15-9 | Fault Tree Basic Events for Chemical and Volume Control System (Sheets 1 – 4)..... | 15-21 |
| 16-1 | List of System Fault Trees..... | 16-5 |
| 16-2 | Fault Tree VLH Success Criteria Summary | 16-5 |
| 16-3 | Notes Related to System Fault Tree Assumptions..... | 16-5 |
| 16-4 | System Dependency Matrix | 16-6 |
| 16-5 | Component Test Assumptions..... | 16-6 |
| 16-6 | Component Maintenance Assumptions..... | 16-6 |
| 16-7 | Operator Actions and Misposition Analysis Summary..... | 16-7 |
| 16-8 | Common Cause Failure Analysis Summary..... | 16-7 |
| 16-9 | Fault Tree Basic Events for Containment Hydrogen Control System | 16-8 |
| 17-1 | List of System Fault Trees..... | 17-7 |
| 17-2 | Fault Tree Success Criteria Summary (Sheets 1 – 2) | 17-8 |
| 17-3 | Notes Related to System Fault Tree Assumptions..... | 17-10 |
| 17-4 | System Dependencies Matrix | 17-11 |
| 17-5 | Component Test Assumptions..... | 17-12 |
| 17-6 | Component Maintenance Assumptions..... | 17-12 |
| 17-7 | Operator Actions and System Misposition Analysis Summary | 17-13 |
| 17-8 | Common Cause Failure Summary..... | 17-13 |
| 17-9 | Fault Tree Basic Events for Normal Residual Heat Removal System (Sheets 1 – 5) | 17-14 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 18-1 | List of System Fault Trees..... | 18-6 |
| 18-2a | Fault Tree CCN Success Criteria Summary | 18-6 |
| 18-2b | Fault Tree CCT Success Criteria Summary..... | 18-7 |
| 18-2c | Fault Tree CCP Success Criteria Summary..... | 18-7 |
| 18-3 | Notes Related to System Fault Tree Assumptions..... | 18-8 |
| 18-4 | System Dependency Matrix | 18-8 |
| 18-5 | Component Test Assumptions..... | 18-9 |
| 18-6 | Component Maintenance Assumptions | 18-9 |
| 18-7 | Operator Actions and Misposition Analysis Summary..... | 18-10 |
| 18-8 | Common Cause Failure Analysis Summary | 18-10 |
| 18-9 | Fault Tree Basic Events for Component Cooling Water System (Sheets 1 – 2)..... | 18-11 |
| 19-1 | List of System Fault Trees..... | 19-6 |
| 19-2a | Fault Tree SWN Success Criteria Summary | 19-6 |
| 19-2b | Fault Tree SWT Success Criteria Summary..... | 19-7 |
| 19-2c | Fault Tree SWP Success Criteria Summary..... | 19-7 |
| 19-3 | Notes Related to System Fault Tree Assumptions..... | 19-8 |
| 19-4 | System Dependency Matrix | 19-9 |
| 19-5 | Component Test Assumptions..... | 19-10 |
| 19-6 | Component Maintenance Assumptions | 19-10 |
| 19-7 | Operator Actions and Misposition Analysis Summary..... | 19-11 |
| 19-8 | Common Cause Failure Analysis Summary | 19-11 |
| 19-9 | Fault Tree Basic Events for Service Water System (Sheets 1 – 4)..... | 19-12 |
| 20-1 | List of System Fault Trees..... | 20-5 |
| 20-2 | Fault Tree VWH Success Criteria Summary..... | 20-5 |
| 20-3 | Notes Related to System Fault Tree Assumptions..... | 20-5 |
| 20-4 | System Dependency Matrix | 20-6 |
| 20-5 | Component Test Assumptions..... | 20-7 |
| 20-6 | Component Maintenance Assumptions | 20-7 |
| 20-7 | Operator Actions and Misposition Analysis Summary..... | 20-8 |
| 20-8 | Common Cause Failure Analysis Summary | 20-8 |
| 20-9 | Fault Tree Basic Events for Central Chilled Water System (Sheets 1 – 2)..... | 20-9 |
| 21-1 | List of System Fault Trees (Sheets 1 – 3)..... | 21-9 |
| 21-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 21-12 |
| 21-3 | Notes Related to System Fault Tree Assumptions (Sheets 1 – 3)..... | 21-28 |
| 21-4 | System Dependency Matrix | 21-31 |
| 21-5 | Component Test Assumptions..... | 21-31 |
| 21-6 | Component Maintenance Assumptions | 21-32 |
| 21-7 | Operator Actions and Misposition Analysis Summary..... | 21-32 |
| 21-8 | Common Cause Failure Analysis Summary | 21-32 |
| 21-9 | Fault Tree Basic Events for AC Power System (Sheets 1 – 22)..... | 21-33 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 22-1 | List of System Fault Trees (Sheets 1 – 4)..... | 22-6 |
| 22-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 22-10 |
| 22-3 | Notes Related to System Fault Tree Assumptions..... | 22-26 |
| 22-4 | Systems Dependency Matrix | 22-26 |
| 22-5 | Component Test Assumptions..... | 22-27 |
| 22-6 | Component Maintenance Assumptions..... | 22-27 |
| 22-7 | Operator Actions and Misposition Analysis Summary..... | 22-27 |
| 22-8 | Common Cause Failure Analysis Summary | 22-28 |
| 22-9 | Fault Tree Basic Events for Class 1E DC and UPS System (Sheets 1 – 12) | 22-29 |
| 22-10 | System Power Requirements/Dependencies (Sheets 1 – 11)..... | 22-41 |
| 23-1 | List of System Fault Trees (Sheets 1 – 3)..... | 23-6 |
| 23-2 | Fault Tree Success Criteria Summary (Sheets 1 – 10) | 23-9 |
| 23-3 | Notes Related to System Fault Tree Assumptions..... | 23-19 |
| 23-4 | System Dependency Matrix | 23-19 |
| 23-5 | Component Test Assumptions..... | 23-20 |
| 23-6 | Component Maintenance Assumptions..... | 23-20 |
| 23-7 | Operator Actions and Misposition Analysis Summary..... | 23-20 |
| 23-8 | Common Cause Failure Analysis Summary | 23-21 |
| 23-9 | Fault Tree Basic Events for Non-Class 1E DC and UPS Power System (Sheets 1 – 20)..... | 23-22 |
| 24-1 | AP1000 Containment Penetration List (Sheets 1 – 4)..... | 24-7 |
| 24-2 | Screening Analysis Evaluation (Sheets 1 – 5)..... | 24-16 |
| 24-3 | Containment Penetrations Not Screened Out for Normal Operation at Power Analysis..... | 24-21 |
| 24-4 | List of System Fault Trees..... | 24-21 |
| 24-5a | Fault Tree CIC Success Criteria Summary..... | 24-22 |
| 24-5b | Fault Tree CIA Success Criteria Summary..... | 24-22 |
| 24-5c | Fault Tree CIB Success Criteria Summary..... | 24-23 |
| 24-6 | Notes Related to System Fault Tree Assumptions..... | 24-23 |
| 24-7 | System Dependency Matrix (Sheets 1 – 3)..... | 24-24 |
| 24-8 | Component Test Assumptions..... | 24-27 |
| 24-9 | Component Maintenance Assumptions..... | 24-27 |
| 24-10 | Operator Actions and Misposition Analysis Summary..... | 24-28 |
| 24-11 | Common Cause Failure Analysis Summary | 24-28 |
| 24-12 | Fault Tree Basic Events for Containment Isolation System (Sheets 1 – 3) | 24-29 |
| 25-1 | List of System Fault Trees..... | 25-8 |
| 25-2a | Fault Tree CAIAIR Success Criteria Summary..... | 25-9 |
| 25-2b | Fault Tree CAIR Success Criteria Summary..... | 25-9 |
| 25-2c | Fault Tree CAIAIRP Success Criteria Summary..... | 25-10 |
| 25-2d | Fault Tree ENDCAIAI Success Criteria Summary | 25-10 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 25-2e | Fault Tree ENDCAIAP Success Criteria Summary | 25-11 |
| 25-2f | Fault Tree CASF Success Criteria Summary | 25-11 |
| 25-3 | Notes Related to System Fault Tree Assumptions..... | 25-12 |
| 25-4 | System Dependency Matrix | 25-12 |
| 25-5 | Component Test Assumptions..... | 25-12 |
| 25-6 | Component Maintenance Assumptions..... | 25-13 |
| 25-7 | Operator Actions and Misposition Analysis Summary..... | 25-13 |
| 25-8 | Common Cause Failure Analysis Summary | 25-13 |
| 25-9 | Fault Tree Basic Events for Instrument Air Subsystem (Sheets 1 – 4)..... | 25-14 |
| 26-1 | List of System Fault Trees..... | 26-25 |
| 26-2a | Fault Tree RTPMS, and RTPMS1 Success Criteria Summary | 26-26 |
| 26-2b | Fault Tree RTSTP Success Criteria Summary | 26-26 |
| 26-2c | Fault Tree RCL Success Criteria Summary..... | 26-27 |
| 26-2d.1 | Fault Tree RCT Success Criteria Summary..... | 26-27 |
| 26-2d.2 | Fault Tree RCN Success Criteria Summary | 26-28 |
| 26-2e | I&C Subtree Success Criteria Summary (Sheets 1 – 98)..... | 26-29 |
| 26-3a | PMS I&C Subtree Constructions (Sheets 1 – 19)..... | 26-127 |
| 26-3b | Representative PMS I&C Subtree Plot Listing (Sheets 1 – 14)..... | 26-146 |
| 26-4 | PMS Dependency Matrix (Sheets 1 – 3)..... | 26-160 |
| 26-5 | PMS Components Test Assumptions | 26-163 |
| 26-6 | Component Maintenance Assumptions..... | 26-163 |
| 26-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 5)..... | 26-164 |
| 26-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 3) | 26-169 |
| 26-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2)..... | 26-172 |
| 26-10a | Fault Tree Basic Events for Reactor Trip System (Sheets 1 – 4)..... | 26-174 |
| 26-10b | Fault Tree Basic Events for the I&C Subsystem (Sheets 1 – 49) | 26-178 |
| 26-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3)..... | 26-227 |
| 27-1 | List of System Fault Trees..... | 27-9 |
| 27-2a | Fault Tree DAS Success Criteria Summary | 27-9 |
| 27-2b | Fault Tree DAS1 Success Criteria Summary | 27-9 |
| 27-3 | Notes Related to System Fault Tree Assumptions..... | 27-10 |
| 27-4 | System Dependency Matrix | 27-10 |
| 27-5 | Component Test Assumptions..... | 27-10 |
| 27-6 | Component Maintenance Assumptions..... | 27-10 |
| 27-7 | Operator Actions and Misposition Analysis Summary..... | 27-10 |
| 27-8 | Common Cause Failure Analysis Summary | 27-11 |
| 27-9 | Fault Tree Basic Events for Diverse Actuation System..... | 27-12 |
| 28-1 | List of System Fault Trees..... | 28-20 |
| 28-2 | Fault Tree Success Criteria Summary (Sheets 1 – 22) | 28-21 |
| 28-3 | PLS I&C Subtree Constructions (Sheets 1 – 9)..... | 28-43 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 28-4 | PLS Dependency Matrix (Sheets 1 – 2) | 28-52 |
| 28-5 | PLS Components Test Assumptions | 28-54 |
| 28-6 | Component Maintenance Assumptions | 28-54 |
| 28-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 3)..... | 28-55 |
| 28-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 2) | 28-58 |
| 28-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2)..... | 28-60 |
| 28-10 | Fault Tree Basic Events for I&C Subsystem (Sheets 1 – 68)..... | 28-62 |
| 28-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3)..... | 28-130 |
| 28-12 | Assignments of Plant Systems to Logic Cabinets..... | 28-133 |
| 28-13 | Assignments of Plant Systems to the Control Group Cabinets..... | 28-134 |
| 29-1 | Electrical Components with Low CCF Rate | 29-18 |
| 29-2 | Common-Cause Failure Calculations (Sheets 1 – 5)..... | 29-19 |
| 29-3 | Simplification of Q_K/Q_T Equations..... | 29-24 |
| 29A-1 | Extreme Environmental Conditions (Generic Causes of Dependent Failures) Excerpted from the ANS/IEEE PRA Procedures Guide (NUREG-2300)..... | 29A-11 |
| 29A-2 | Common-Cause Failures Among Systems | 29A-12 |
| 29A-3 | Common-Cause Failure Equations for MGL Method | 29A-13 |
| 30-1 | AP1000 Human Error Probability Summary Results (Sheets 1 – 16)..... | 30-75 |
| 30-2 | Manual DAS Actuation (Sheets 1 – 2)..... | 30-91 |
| 30-3 | Dependency Level Evaluation Summary (Sheets 1 – 14)..... | 30-93 |
| 30-4 | Dependency Level Evaluation (Sheets 1 – 3)..... | 30-107 |
| 30-5 | List of Acronyms..... | 30-110 |
| 30A-1 | Analyst Responsibility Based on Sharp Steps | 30A-10 |
| 30A-2 | Summary of Screening Values | 30A-11 |
| 30A-3 | Example of Operator Action Definition | 30A-12 |
| 30A-4 | HEP Data Bank (Sheets 1 – 5)..... | 30A-13 |
| 31-1 | Summary of Event Tree Scalar Probabilities..... | 31-12 |
| 32-1 | Generic Data Base (Sheets 1 – 13)..... | 32-5 |
| 32-2 | Test and Maintenance Outage Generic Data | 32-21 |
| 32-3 | Test and Maintenance Unavailabilities Used in AP1000 Core Damage Quantification..... | 32-22 |
| 32-4 | Common Cause Factors (Sheets 1 – 5)..... | 32-23 |
| 32-5 | SIMON.OUT File (Sheets 1 – 21) | 32-29 |
| 33-1 | Summary of AP1000 System Fault Tree Failure Probabilities (Sheets 1 – 13)..... | 33-7 |
| 33-2 | Example Accident Sequence Definitions for Large LOCA..... | 33-20 |
| 33-3 | AP1000 PRA Dominant CDF Cutsets (Sheets 1 – 10) | 33-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 33-4 | AP1000 PRA Dominant CDF Sequences (Sheets 1 – 18) | 33-31 |
| 33-5 | Contribution of Initiating Events to Plant Core Damage Frequency | 33-49 |
| 33-6 | List of Basic Events and Their Descriptions (Sheets 1 – 33) | 33-50 |
| 34-1 | Post-Accident Monitoring Equipment (Sheets 1 – 2)..... | 34-23 |
| 34-2 | Level 1 Accident Class..... | 34-25 |
| 34-3 | Summary of Release Categories..... | 34-26 |
| 34-4 | 3BE-1 Event Summary..... | 34-27 |
| 34-5 | 3BE-2 Event Summary..... | 34-28 |
| 34-6 | 3BE-4 Event Summary..... | 34-29 |
| 34-7 | 3BE-5 Event Summary..... | 34-30 |
| 34-8 | 3BE-6 Event Summary..... | 34-31 |
| 34-9 | 3BE-7 Event Summary..... | 34-32 |
| 34-10 | 3BE-3 Event Summary..... | 34-33 |
| 34-11 | 3BL-1 Event Summary..... | 34-34 |
| 34-12 | 3BL-2 Event Summary..... | 34-35 |
| 34-13 | 3BR-1 Event Summary | 34-36 |
| 34-14 | 3BR-1a Event Summary..... | 34-37 |
| 34-15 | 3C-1 Event Summary | 34-38 |
| 34-16 | 3C-2 Event Summary | 34-39 |
| 34-17 | 3D-1 Event Summary..... | 34-40 |
| 34-18 | 3D-2 Event Summary..... | 34-41 |
| 34-19 | 3D-3 Event Summary..... | 34-42 |
| 34-20 | 3D-4 Event Summary..... | 34-43 |
| 34-21 | 6E-1 Event Summary | 34-44 |
| 34-22 | 6L-1 Event Summary | 34-45 |
| 34-23 | 1AP-1 Event Summary..... | 34-46 |
| 34-24 | 1AP-2 Event Summary..... | 34-47 |
| 34-25 | 1A-1 Event Summary..... | 34-48 |
| 34-26 | 1A-2 Event Summary..... | 34-49 |
| 34-27 | CFI Event Summary..... | 34-50 |
| 34-28 | CFL Event Summary..... | 34-51 |
| 35-1 | Functional Definitions of Level 1 Accident Classes | 35-21 |
| 35-2 | CET Initial Conditions for Level 1 Accident Classes..... | 35-22 |
| 35-3 | Containment Event Tree Nodal Questions | 35-23 |
| 35-4 | Summary of Release Category Definitions..... | 35-24 |
| 35-5 | Summary of Containment Event Tree Success Criteria (Sheets 1 – 3)..... | 35-25 |
| 35-6 | Summary of Operator Actions Credited on Containment Event Tree | 35-28 |
| 36-1 | Summary Table for RCS Depressurization (CET Node DP)..... | 36-6 |
| 37-1 | Summary Table for Containment Isolation (CET Node IS) | 37-4 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 38-1 | Summary Table for Reflooding (CET Node RFL)..... | 38-5 |
| 39-1 | Material Inventories in AP1000 Reactor Vessel..... | 39-21 |
| 39-2 | Summary Table for Reactor Cavity Flooding (CET Node IR)..... | 39-22 |
| 39-3 | Summary Table for Debris Relocation to Cavity (CET Node VF)..... | 39-22 |
| 39A-1 | Core and Lower Internals Material Inventories in AP1000 Reactor Vessel | 39A-14 |
| 39A-2a | Mass and Power Distributions of Debris Layers in Top-Skewed Power Shape Case | 39A-15 |
| 39A-2b | Mass and Power Distributions of Debris Layers in Chopped Cosine Power Shape Case | 39A-16 |
| 39A-3a | Results of Top-Skewed Power Shape Case | 39A-17 |
| 39A-3b | Relocation Results of the Chopped Cosine Power Shape Case | 39A-18 |
| 39A-4 | Material Properties Used in In-Vessel Melting and Relocation Calculation | 39A-19 |
| 39A-5 | Debris Relocation Time Line | 39A-20 |
| 40-1 | Summary of Nodal Failure Probabilities | 40-6 |
| 40-2 | Nominal and Bounding Containment Failure Probability at 24 and 72 Hours | 40-6 |
| 41-1 | Containment Event Tree IG Nodal Failure Probability | 41-33 |
| 41-2 | Containment Event Tree Nodal Failure Probabilities | 41-33 |
| 41-3 | AP600 Scenario Dependencies for Early Detonation Analysis | 41-34 |
| 41-4 | Safety Margin Basis Containment Performance Requirement | 41-35 |
| 41A-1 | Summary of System Assumptions for AP1000 MAAP4.04 Hydrogen Analyses (Sheets 1 – 7) | 41A-2 |
| 41A-2 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-10 |
| 41A-3 | Summary of Early Compartment Gas Composition Results For MAAP4 Hydrogen Mixing Analyses..... | 41A-10 |
| 41A-4 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-11 |
| 41A-5 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-11 |
| 41A-6 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-7 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-8 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-13 |
| 41A-9 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-14 |
| 41A-10 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-15 |
| 41A-11 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 41A-12 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-13 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-14 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-17 |
| 41A-15 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-17 |
| 41A-16 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-18 |
| 41A-17 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-18 |
| 41A-18 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-19 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-20 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-20 |
| 41A-21 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-20 |
| 41A-22 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-21 |
| 41A-23 | Sequence 1A-3a | 41A-22 |
| 41A-24 | Sequence 1A-4a | 41A-23 |
| 41A-25 | Sequence 1AP-3..... | 41A-24 |
| 41A-26 | Sequence 1AP-4..... | 41A-25 |
| 41A-27 | Sequence 3D-1 | 41A-26 |
| 41A-28 | Sequence 3D-2 | 41A-27 |
| 41A-29 | Sequence 3D-3 | 41A-28 |
| 41A-30 | Sequence 3D-5 | 41A-29 |
| 41A-31 | Sequence 3BL-1 | 41A-30 |
| 41A-32 | Sequence 3BL-2..... | 41A-31 |
| 41A-33 | Sequence 3C-1 | 41A-32 |
| 41A-34 | Sequence 3BR-1a..... | 41A-33 |
| 41A-35 | Sequence 3BE-1 | 41A-34 |
| 41A-36 | Sequence 3BE-2..... | 41A-35 |
| 41A-37 | Sequence 3BE-4..... | 41A-36 |
| 41A-38 | Sequence 3BE-5..... | 41A-37 |
| 41A-39 | Sequence 3BE-6..... | 41A-38 |
| 41A-40 | Sequence 3BE-8..... | 41A-39 |
| 41A-41 | Sequence 3BE-9..... | 41A-40 |
| 42-1 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 400°F..... | 42-9 |
| 42-2 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 331°F..... | 42-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 42-3 | Cumulative Containment Failure Probability, Temperature = 400°F | 42-10 |
| 42-4 | Cumulative Containment Failure Probability, Temperature = 331°F | 42-11 |
| 43-1 | Accident Class Frequencies | 43-13 |
| 43-2 | Boolean Expressions to Calculate Q1-Q29 | 43-14 |
| 43-3 | CET Node Probabilities (Sheets 1 – 3) | 43-15 |
| 43-4 | Boolean Expressions for P1-P15 | 43-18 |
| 43-5 | Contribution of PDS to LRF (Sheets 1 – 3) | 43-19 |
| 43-6 | Dominant CET Sequences Contributing to LRF (Sheets 1 – 69)..... | 43-22 |
| 43-7 | Summary of Release Frequency Calculations (Sheets 1 – 2) | 43-91 |
| 43-8 | LRF and Containment Effectiveness by Accident Class | 43-93 |
| 43-9 | Summary of AP1000 LRF Quantification for Internal Events At-Power | 43-94 |
| 43-10 | CET Event Tree Node Importances | 43-95 |
| 43-11 | Contribution of Initiating Events to Large Release | 43-96 |
| 43-12 | LRF Sensitivity Case – Non Credit for Standby Non-Safety Systems (Sheets 1 – 9) | 43-97 |
| 43-13 | LRF Cutsets for the Case – Sensitivity to Standby Systems With Credit for Manual DAS (Sheets 1 – 13)..... | 43-106 |
| 43A-1 | AP1000 PRA Dominant CDF Sequences for At-Power Events (Sheets 1 – 6)..... | 43A-2 |
| 43A-2 | AP1000 PRA PDS Frequencies for At-Power Events..... | 43A-8 |
| 43B-1 | Calculation of Failure Probability of DP for PDS 6 (Sheets 1 – 7) | 43B-2 |
| 43C-1 | Evaluation of CET-Related Operator Actions | 43C-2 |
| 44-1 | MAAP Model Benchmarks (Sheets 1 – 4)..... | 44-8 |
| 45-1 | Environmental Release Fractions at 24 Hours After Core Damage Per Release Category..... | 45-5 |
| 45-2 | Environmental Release Fractions at 72 Hours After Core Damage Per Release Category..... | 45-6 |
| 49-1 | AP1000 Source Terms from Level 2 Analysis (MAAP)..... | 49-9 |
| 49-2 | AP1000 Source Terms for Dose Evaluation (MACCS2)..... | 49-10 |
| 49-3 | Site Boundary Whole Body Dose [Effective Dose Equivalent (EDE)], Sieverts | 49-11 |
| 49-4 | Site Boundary Thyroid Dose, Sieverts | 49-12 |
| 49-5 | Population Whole Body Dose [Effective Dose Equivalent (EDE)], 0-80.5 km Person-Sieverts | 49-13 |
| 49-6 | Site Boundary Red Marrow Dose (Total Acute), Sieverts..... | 49-14 |
| 49-7 | Dose Summary | 49-15 |
| 49-8 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 49-16 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 49-9 | Site Boundary Whole Body EDE Dose Risk – 72 Hours | 49-17 |
| 49-10 | Population Whole Body EDE Dose Risk – 24 Hours..... | 49-18 |
| 49-11 | Population Whole Body EDE Dose Risk – 72 Hours..... | 49-19 |
| 50-1 | Core Damage for At-Power Events Contribution of Initiating Events to Plant Core Damage Frequency | 50-16 |
| 50-2 | Core Damage for At-Power Events Conditional Core Damage Probability of Initiating Events | 50-17 |
| 50-3 | AP1000 PRA Core Damage for At-Power Events Accident Sequence Importances (Sheets 1 – 5)..... | 50-18 |
| 50-4 | Core Damage for At-Power Events End State Importances | 50-23 |
| 50-5 | Common Cause Importances – Risk Decrease (Sheets 1 – 2)..... | 50-24 |
| 50-6 | Common Cause Importances – Risk Increase (Sheets 1 – 3) | 50-26 |
| 50-7 | Human Error Risk Importances – Risk Decrease (Sheets 1 – 2)..... | 50-29 |
| 50-8 | Human Error Risk Importances – Risk Increase (Sheets 1 – 2)..... | 50-31 |
| 50-9 | Component Importances – Risk Decrease (Sheets 1 – 2)..... | 50-33 |
| 50-10 | Component Importances – Risk Increase (Sheets 1 – 4) | 50-35 |
| 50-11 | List of Systems for System Importance Analyses (Sheets 1 – 4)..... | 50-39 |
| 50-12 | System Importance Calculation Results (Sheets 1 – 2) | 50-43 |
| 50-13 | Systems Grouped by PRA System Importance..... | 50-45 |
| 50-14 | Operator Actions in “CMTOT.OUT” File | 50-46 |
| 50-15 | Contribution of IEVs to Core Damage Frequency | 50-47 |
| 50-16 | Case 29 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-48 |
| 50-17 | Case 30 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-50 |
| 50-18 | Case 31 – Top 50 Dominant Cutsets (Sheets 1 – 3)..... | 50-52 |
| 50-19 | Passive System Check Valves in “CMTOT.OUT” File | 50-55 |
| 50-20 | Sensitivity Case 36 – Contribution of Initiating Events to CDF..... | 50-56 |
| 50-21 | Sensitivity Case 36 – Top 50 CDF Cutsets (Sheets 1 – 8) | 50-57 |
| 50-22 | Risk Importances Sorted by Basic Event Identification (Sheets 1 – 13)..... | 50-65 |
| 50-23 | Risk Importances Sorted by Risk Increase (Sheets 1 – 15) | 50-78 |
| 50-24 | Risk Importances Sorted by Risk Decrease (Sheets 1 – 15)..... | 50-93 |
| 50-25 | Risk Increases Sorted by Slope (Birnbaum) Importance (Sheets 1 – 13) | 50-108 |
| 51-1 | Summary of Results of AP1000 PRA Uncertainty Analysis for Internal Initiating Events at Power | 51-9 |
| 51-2 | List of Input Cutset Files | 51-10 |
| 51A-1 | Basic Event Uncertainties (Sheets 1 – 32) | 51A-3 |
| 54-1 | AP1000 Initiating Event Frequencies During Shutdown Conditions..... | 54-18 |
| 54-2 | AP1000 Design Impact on AP600 Shutdown Model..... | 54-19 |
| 54-3 | Times for Loss of RNS at Mid-loop Without IRWST Injection..... | 54-20 |
| 54-4 | AP1000 & AP600 Initiating Event CDF Contributions | 54-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 54-5 | AP600 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-22 |
| 54-6 | AP1000 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-47 |
| 54-7 | Basic Event Probabilities Revised in Case 1 | 54-72 |
| 54-8 | Revised CCF Basic Event Probabilities (Sheets 1 – 2) | 54-73 |
| 54-9 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 1 | 54-75 |
| 54-9A | Dominant CDF Cutsets for Drained Conditions Only for AP1000 Shutdown PRA Sensitivity Case 1 (Sheets 1 – 24) | 54-76 |
| 54-10 | AP1000 Shutdown PRA Sensitivity Case 2 CDF Cutsets (Sheets 1 – 5)..... | 54-100 |
| 54-11 | List of Basic Events “Dropped” to Make the Sensitivity Case 2..... | 54-105 |
| 54-12 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 2 | 54-106 |
| 54-13 | Shutdown PRA Sensitivity Case 3 (Sheets 1 – 28) | 54-107 |
| 54-14 | Basic Events Whose Probabilities are Changed in Case 3 | 54-135 |
| 54-15 | AP1000 Shutdown PRA Sensitivity Case 4 CDF Cutsets (Sheets 1 – 7)..... | 54-136 |
| 54-16 | List of Basic Events “Dropped” to Make the Sensitivity Case 4..... | 54-143 |
| 54-17 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 4 | 54-144 |
| 54-18 | AP1000 Shutdown PRA Basic Event Risk Importances – RAW (Sheets 1 – 8)..... | 54-145 |
| 54-19 | AP1000 Shutdown PRA Basic Event Risk Importances – RRW (Sheets 1 – 3)..... | 54-153 |
| 54-20 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RAW (Sheets 1 – 4) | 54-156 |
| 54-21 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RRW (Sheets 1 – 2) | 54-160 |
| 55-1 | Seismic Margin HCLPF Values (Sheets 1 – 4)..... | 55-21 |
| 55-2 | Basic Event HCLPF Values (Sheets 1 – 3) | 55-25 |
| 55-3 | EQ-IEV-STRUC HCLPF..... | 55-28 |
| 55-4 | EQ-IEV-RVFA HCLPF | 55-28 |
| 55-5 | EQ-IEV-LLOCA HCLPF | 55-29 |
| 55-6 | EQ-IEV-SLOCA HCLPF..... | 55-29 |
| 55-7 | EQ-IEV-ATWS HCLPF | 55-29 |
| 56-1 | Flooding Analysis Initial Screening Results (Sheets 1 – 3)..... | 56-50 |
| 56-2 | At-Power Detailed Screening Results (Sheets 1 – 5) | 56-53 |
| 56-3 | At-Power Flooding-Induced Core Damage Frequency Quantification Summary Results (Sheets 1 – 6)..... | 56-58 |
| 56-4 | Power Upgrade Difference Between AP1000 and AP600 | 56-64 |
| 56-5 | Shutdown Flooding PRA | 56-65 |
| 56-6 | Shutdown Initiating Event CCDPs..... | 56-66 |
| 57-1 | AP1000 Fire Areas Excluding the Containment (Sheets 1 – 6) | 57-43 |
| 57-2 | AP1000 Fire Areas in the Containment (Sheets 1 – 2)..... | 57-49 |
| 57-3 | Fire Ignition Frequencies for AP1000 Fire Areas (Sheets 1 – 4) | 57-51 |
| 57-4 | Fire Ignition Frequencies for AP1000 Containment Fire Area | 57-58 |
| 57-5 | Fire Barrier Failure Probabilities..... | 57-61 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 57-6 | Automatic Suppression System Reliability | 57-62 |
| 57-7 | Summary of Qualitative Evaluation Results – Power Operation – Plant except Containment and Main Control Room (Sheets 1 – 15)..... | 57-63 |
| 57-8 | Summary of Qualitative Evaluation Results for Containment at Power Operation (Sheets 1 – 4)..... | 57-82 |
| 57-9 | Summary of Results (Sheets 1 – 5) | 57-88 |
| 57-10 | Distribution of Fire CDF Frequency by Three Major Plant Areas | 57-93 |
| 57-11 | Distribution of Fire CDF Frequency by Eight Plant Areas..... | 57-94 |
| 57-12 | Fire Areas Sorted by CDF (Sheets 1 – 5)..... | 57-95 |
| 57-13 | Fire Areas Sorted by CDF/FIEV (Sheets 1 – 5)..... | 57-100 |
| 57-14 | Credit for Manual Fire Suppression | 57-105 |
| 57-15 | Reduction of Hot Short Probability..... | 57-106 |
| 57-16 | Increase of Hot Short Probability | 57-107 |
| 57-17 | Sensitivity to Human Actions..... | 57-108 |
| 57-18 | Sensitivity to Fire Ignition Frequencies..... | 57-109 |
| 57-19 | Sensitivity to Actuation by DAS | 57-110 |
| 57-20 | Plant Fire CDF Without Hot Shorts | 57-111 |
| 57-21 | Contribution of the Plant Areas to CDF | 57-112 |
| 57-22 | Dominant Fire Scenarios (Sheets 1 – 4)..... | 57-113 |
| 57-23 | AP1000 Shutdown CCDPs | 57-117 |
| 57-24 | AP1000 Dominant Fire Sequences (Sheets 1 – 4)..... | 57-118 |
| 57-25 | Dominant Fire Scenarios from AP600 Shutdown Fire PRA | 57-122 |
| 57-26 | Summary of AP1000 Shutdown Fire Evaluation | 57-123 |
| 57-27 | Main Contributors for Shutdown Fire Risk..... | 57-124 |
| 57A-1 | Summary of Scenario CCDPs (Sheets 1 – 5)..... | 57A-7 |
| 57A-2 | AP1000 Base Case CCDPs for Initiating Events | 57A-12 |
| 57A-3 | DAS-ACT Fault Tree Cutsets Before Subtree Reduction | 57A-13 |
| 57A-4 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 10)..... | 57A-14 |
| 57A-5 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 9)..... | 57A-24 |
| 57A-6 | AP1000 Fire PRA Scenario CCDPs for Over-Conservative Cases (Sheets 1 – 3) | 57A-33 |
| 57C-1 | Data Used in Event Tree Scenario Frequency Calculations (Sheets 1 – 5) | 57C-2 |
| 57C-2 | CCDPs Used in Fire Event Trees (Sheets 1 – 5)..... | 57C-7 |
| 59-1 | Contribution of Initiating Events to Core Damage | 59-39 |
| 59-2 | Conditional Core Damage Probability of Initiating Events | 59-40 |
| 59-3 | Internal Initiating Events at Power Dominant Core Damage Sequences (Sheets 1 – 4) | 59-41 |
| 59-4 | Sequence 1 – Safety Injection Line Break Dominant Cutsets (SI-LB-07) (Sheets 1 – 3) | 59-45 |
| 59-5 | Sequence 2 – Large LOCA Dominant Cutsets (LLOCA-09)..... | 59-48 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 59-6 | Sequence 3 – Spurious ADS Actuation Dominant Cutsets (SPADS-08) (Sheets 1 – 3) | 59-49 |
| 59-7 | Sequence 4 – Safety Injection Line Break Dominant Cutsets (SI-LB-08) (Sheets 1 – 3) | 59-52 |
| 59-8 | Sequence 5 – Reactor Vessel Rupture Cutset (RV-RP-02) | 59-55 |
| 59-9 | Sequence 6 – Small LOCA Dominant Cutsets (SLOCA-05) (Sheets 1 – 3) | 59-56 |
| 59-10 | Sequence 7 – Medium LOCA Dominant Cutsets (MLOCA-05) (Sheets 1 – 3) | 59-59 |
| 59-11 | Sequence 8 – Small LOCA Dominant Cutsets (SLOCA-12) (Sheets 1 – 3) | 59-62 |
| 59-12 | Sequence 9 – Medium LOCA Dominant Cutsets (MLOCA-12) (Sheets 1 – 3) | 59-65 |
| 59-13 | Sequence 10 – Spurious ADS Actuation Dominant Cutsets (SPADS-09) (Sheets 1 – 3) | 59-68 |
| 59-14 | Typical System Failure Probabilities, Showing Higher Reliabilities for Safety Systems | 59-71 |
| 59-15 | Summary of AP1000 PRA Results | 59-72 |
| 59-16 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 59-73 |
| 59-17 | Comparison of AP1000 PRA Results to Risk Goals | 59-74 |
| 59-18 | AP1000 PRA-Based Insights (Sheets 1 –24) | 59-75 |

LIST OF FIGURES

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 2-1 | Core Damage Logic Diagram for Internal Initiators (Sheets 1 – 4)..... | 2-47 |
| 4A-1 | Example Event Tree for Illustration of Terminology | 4A-19 |
| 4A-2 | Functional Event Tree | 4A-20 |
| 4A-3 | Illustration of A/B and A&B Notation | 4A-21 |
| 4A-4 | Illustration of Consequential Event and ATWS End States | 4A-22 |
| 4A-5 | AP1000 PRA Transients Template Event Tree (Sheets 1 – 3)..... | 4A-23 |
| 4A-6 | AP1000 PRA Small LOCA Template Event Tree (Sheets 1 – 2)..... | 4A-26 |
| 4B-1 | AP1000 Large LOCA Event Tree (Sheets 1 – 2)..... | 4B-2 |
| 4B-2 | AP1000 Large Spurious ADS Actuation Event Tree (Sheets 1 – 2)..... | 4B-4 |
| 4B-3 | AP1000 Medium LOCA Event Tree (Sheets 1 – 4)..... | 4B-6 |
| 4B-4 | AP1000 CMT Line Break Event Tree (Sheets 1 – 4)..... | 4B-10 |
| 4B-5 | AP1000 SI Line Break Event Tree (Sheets 1 – 3)..... | 4B-14 |
| 4B-6 | AP1000 Small LOCA Event Tree (Sheets 1 – 6)..... | 4B-17 |
| 4B-7 | AP1000 RCS Leak Event Tree | 4B-23 |
| 4B-8 | AP1000 Passive RHR Tube Rupture Event Tree..... | 4B-24 |
| 4B-9a | AP1000 Steam Generator Tube Rupture Event Tree (Sheets 1 – 3) | 4B-25 |
| 4B-9b | AP1000 SGTR Continues Event Tree (Sheets 1 – 6)..... | 4B-28 |
| 4B-10 | AP1000 Reactor Vessel Rupture Event Tree | 4B-34 |
| 4B-11 | AP1000 Interfacing Systems LOCA Event Tree..... | 4B-35 |
| 4B-12 | AP1000 Transients With Main Feedwater Event Tree (Sheets 1 – 4)..... | 4B-36 |
| 4B-13 | AP1000 Loss of Reactor Coolant Flow Event Tree (Sheets 1 – 4) | 4B-40 |
| 4B-14 | AP1000 Loss of Feedwater to One SG Tree (Sheets 1 – 4) | 4B-44 |
| 4B-15 | AP1000 Transients With Core Power Excursion Event Tree (Sheets 1 – 4)..... | 4B-48 |
| 4B-16 | AP1000 Transients With Loss of CCW/SW Event Tree (Sheets 1 – 4)..... | 4B-52 |
| 4B-17 | AP1000 Loss of MFW Event Tree (Sheets 1 – 4)..... | 4B-56 |
| 4B-18 | AP1000 Loss of Condenser Event Tree (Sheets 1 – 4) | 4B-60 |
| 4B-19 | AP1000 Loss of Main Compressed Air Event Tree (Sheets 1 – 4) | 4B-64 |
| 4B-20 | AP1000 Loss of Offsite Power Event Tree (Sheets 1 – 7) | 4B-68 |
| 4B-21 | Main Steam Line Break Downstream of MSIVs Event Tree (Sheets 1 – 5) | 4B-75 |
| 4B-22 | Main Steam Line Break Upstream of MSIVs Event Tree (Sheets 1 – 9) | 4B-80 |
| 4B-23 | Stuck Open Secondary Side Safety Valve Event Tree (Sheets 1 – 5) | 4B-89 |
| 4B-24a | ATWS Precursor Without Main Feedwater | 4B-94 |
| 4B-24b | AP1000 ATWS Precursor Without Main Feedwater Continues Event Tree (Sheets 1 – 6) | 4B-95 |
| 4B-25 | ATWS Precursor With SI (Sheets 1 – 6)..... | 4B-101 |
| 4B-26 | ATWS Precursor With MFW (Sheets 1 – 4)..... | 4B-107 |
| 7-1 | Power/Control Model for Large Loads (6900-vac/480-vac Pumps, Fans, and Motors)..... | 7-33 |
| 7-2 | Power/Control Model for Motor-Operated Valves..... | 7-35 |
| 7-3 | Power/Control Model for Air-Operated Valves | 7-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 7-4 | Power/Control Model for Variable Speed Motor | 7-39 |
| 7-5 | An Illustration of Fault Tree Basic Events for a Pump Following the Model Given in Figure 7-1 | 7-41 |
| 8-1 | PRHR – Simplified Piping and Instrumentation Diagram..... | 8-23 |
| 8-2 | PRHR – Simplified Valve Control Diagram | 8-25 |
| 9-1 | Passive Core Cooling System Simplified Sketch | 9-24 |
| 9-2 | Passive Core Cooling System Piping and Instrumentation Diagram | 9-25 |
| 10-1 | Passive Core Cooling System – Accumulator Subsystem | 10-12 |
| 11-1 | Automatic Depressurization System Simplified Piping and Instrumentation Diagram..... | 11-49 |
| 12-1 | Simplified Piping & Instrumentation Diagram of the IRWST/Gravity Injection Subsystem..... | 12-42 |
| 13-1 | Passive Containment Cooling System Sketch | 13-11 |
| 15-1 | Chemical and Volume Control System Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 15-25 |
| 17-1 | Normal Residual Heat Removal System Sketch..... | 17-19 |
| 18-1 | Component Cooling Water System Piping and Instrumentation Diagram | 18-13 |
| 19-1 | Service Water System Piping and Instrumentation Diagram..... | 19-17 |
| 20-1 | Central Chilled Water Low-Capacity Subsystem Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 20-11 |
| 21-1 | AC Power System One-Line Diagram | 21-55 |
| 22-1 | Class 1E DC System One-Line Diagram (Sheets 1 – 2)..... | 22-53 |
| 22-2 | Class 1E UPS One-Line Diagram | 22-57 |
| 25-1 | Compressed & Instrument Air System Piping and Instrumentation Diagram | 25-19 |
| 29-1 | IRWST Valve Configuration..... | 29-25 |
| 30-1 | Human Reliability Analysis Quantification Model | 30-111 |
| 30A-1 | Links Between SHARP Steps | 30A-18 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-1 | Case 3BE-1: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Containment Water Level..... | 34-52 |
| 34-2 | Case 3BE-1: ADS Stage 4 Flow Rates DVI Line Break, Containment Water Level..... | 34-52 |
| 34-3 | Case 3BE-1: Accumulator/CMT Water Mass DVI Line Break, Containment Water Level | 34-53 |
| 34-4 | Case 3BE-1: IRWST Injection Flow Rate DVI Line Break, Containment Water Level | 34-53 |
| 34-5 | Case 3BE-1: Break Flow Rate DVI Line Break, Containment Water Level..... | 34-54 |
| 34-6 | Case 3BE-1: Reactor Vessel Water Level DVI Line Break, Containment Water Level | 34-54 |
| 34-7 | Case 3BE-1: Core Temperatures DVI Line Break, Containment Water Level..... | 34-55 |
| 34-8 | Case 3BE-1: Containment Water Pool Elevations DVI Line Break, Containment Water Level | 34-55 |
| 34-9 | Case 3BE-1: Containment Pressure DVI Line Break, Containment Water Level..... | 34-56 |
| 34-10 | Case 3BE-1: Containment Gas Temperatures DVI Line Break, Containment Water Level | 34-56 |
| 34-11 | Case 3BE-1: Core Mass DVI Line Break, Containment Water Level..... | 34-57 |
| 34-12 | Case 3BE-1: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Containment Water Level..... | 34-57 |
| 34-13 | Case 3BE-1: In-Vessel Hydrogen Generation DVI Line Break, Containment Water Level | 34-58 |
| 34-14 | Case 3BE-1: Mass Fraction of CsI Released to Containment DVI Line Break, Containment Water Level..... | 34-58 |
| 34-15 | Case 3BE-1: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-16 | Case 3BE-1: Mass Fraction of Fission Products Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-17 | Case 3BE-1: Mass Fraction of SrO Released to Environment DVI Line Break, Containment Water Level..... | 34-60 |
| 34-18 | Case 3BE-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-60 |
| 34-19 | Case 3BE-2: ADS Stage 4 Flow Rates DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-20 | Case 3BE-2: Accumulator/CMT Water Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-21 | Case 3BE-2: IRWST Injection Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |
| 34-22 | Case 3BE-2: Break Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-23 | Case 3BE-2: Reactor Vessel Water Level DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-24 | Case 3BE-2: Core Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-25 | Case 3BE-2: Containment Water Pool Elevations DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-26 | Case 3BE-2: Containment Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-27 | Case 3BE-2: Containment Gas Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-28 | Case 3BE-2: Core Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-29 | Case 3BE-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-66 |
| 34-30 | Case 3BE-2: In-Vessel Hydrogen Generation DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-66 |
| 34-31 | Case 3BE-2: Mass Fraction of CsI Released to Containment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-32 | Case 3BE-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-33 | Case 3BE-2: Mass Fraction of Fission Products Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-34 | Case 3BE-2: Mass Fraction of SrO Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-35 | Case 3BE-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS, Failed Gravity Injection..... | 34-69 |
| 34-36 | Case 3BE-4: ADS Stage 4 Flow Rates Spurious ADS, Failed Gravity Injection | 34-69 |
| 34-37 | Case 3BE-4: Accumulator/CMT Water Mass Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-38 | Case 3BE-4: IRWST Injection Flow Rate Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-39 | Case 3BE-4: Break Flow Rate Spurious ADS, Failed Gravity Injection..... | 34-71 |
| 34-40 | Case 3BE-4: Reactor Vessel Water Level Spurious ADS, Failed Gravity Injection | 34-71 |
| 34-41 | Case 3BE-4: Core Temperatures Spurious ADS, Failed Gravity Injection | 34-72 |
| 34-42 | Case 3BE-4: Containment Water Pool Elevations Spurious ADS, Failed Gravity Injection..... | 34-72 |
| 34-43 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection | 34-73 |
| 34-44 | Case 3BE-4: Containment Gas Temperatures Spurious ADS, Failed Gravity Injection..... | 34-73 |
| 34-45 | Case 3BE-4: Core Mass Spurious ADS, Failed Gravity Injection | 34-74 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-46 | Case 3BE-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS, Failed Gravity Injection..... | 34-74 |
| 34-47 | Case 3BE-4: In-Vessel Hydrogen Generation Spurious ADS, Failed Gravity Injection | 34-75 |
| 34-48 | Case 3BE-4: Mass Fraction of CsI Released to Containment Spurious ADS, Failed Gravity Injection..... | 34-75 |
| 34-49 | Case 3BE-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-50 | Case 3BE-4: Mass Fraction of Fission Products Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-51 | Case 3BE-4: Mass Fraction of SrO Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-77 |
| 34-52 | Case 3BE-5: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-77 |
| 34-53 | Case 3BE-5: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-78 |
| 34-54 | Case 3BE-5: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-78 |
| 34-55 | Case 3BE-5: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-56 | Case 3BE-5: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-57 | Case 3BE-5: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-80 |
| 34-58 | Case 3BE-5: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-80 |
| 34-59 | Case 3BE-5: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-81 |
| 34-60 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 34-81 |
| 34-61 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-82 |
| 34-62 | Case 3BE-5: Core Mass SBLOCA with Failed Gravity Injection | 34-82 |
| 34-63 | Case 3BE-5: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-83 |
| 34-64 | Case 3BE-5: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-83 |
| 34-65 | Case 3BE-5: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-84 |
| 34-66 | Case 3BE-5: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection | 34-84 |
| 34-67 | Case 3BE-5: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |
| 34-68 | Case 3BE-5: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-69 | Case 3BE-6: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-86 |
| 34-70 | Case 3BE-6: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-86 |
| 34-71 | Case 3BE-6: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-87 |
| 34-72 | Case 3BE-6: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-87 |
| 34-73 | Case 3BE-6: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-88 |
| 34-74 | Case 3BE-6: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-88 |
| 34-75 | Case 3BE-6: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-76 | Case 3BE-6: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-77 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection | 34-90 |
| 34-78 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-90 |
| 34-79 | Case 3BE-6: Core Mass SBLOCA with Failed Gravity Injection..... | 34-91 |
| 34-80 | Case 3BE-6: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-91 |
| 34-81 | Case 3BE-6: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-92 |
| 34-82 | Case 3BE-6: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-92 |
| 34-83 | Case 3BE-6: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection | 34-93 |
| 34-84 | Case 3BE-6: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-93 |
| 34-85 | Case 3BE-6: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-94 |
| 34-86 | Case 3BE-7: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-94 |
| 34-87 | Case 3BE-7: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-95 |
| 34-88 | Case 3BE-7: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-95 |
| 34-89 | Case 3BE-7: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-96 |
| 34-90 | Case 3BE-7: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-96 |
| 34-91 | Case 3BE-7: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-97 |
| 34-92 | Case 3BE-7: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-97 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-93 | Case 3BE-7: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-98 |
| 34-94 | Case 3BE-7: Containment Pressure SBLOCA with Failed Gravity Injection | 34-98 |
| 34-95 | Case 3BE-7: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-99 |
| 34-96 | Case 3BE-7: Core Mass SBLOCA with Failed Gravity Injection..... | 34-99 |
| 34-97 | Case 3BE-7: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-100 |
| 34-98 | Case 3BE-7: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-100 |
| 34-99 | Case 3BE-7: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-101 |
| 34-100 | Case 3BE-7: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-101 |
| 34-101 | Case 3BE-7: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-102 | Case 3BE-7: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-103 | Case 3BE-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-103 |
| 34-104 | Case 3BE-3: ADS Stage 4 Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-103 |
| 34-105 | Case 3BE-3: Accumulator/CMT Water Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-106 | Case 3BE-3: IRWST Injection Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-107 | Case 3BE-3: Break Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-105 |
| 34-108 | Case 3BE-3: Reactor Vessel Water Level DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-105 |
| 34-109 | Case 3BE-3: Core Temperatures DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-106 |
| 34-110 | Case 3BE-3: Containment Water Pool Elevations DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-106 |
| 34-111 | Case 3BE-3: Containment Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-107 |
| 34-112 | Case 3BE-3: Containment Gas Temperature DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-107 |
| 34-113 | Case 3BE-3: Core Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |
| 34-114 | Case 3BE-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-115 | Case 3BE-3: In-Vessel Hydrogen Generation DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-109 |
| 34-116 | Case 3BE-3: Mass Fraction of CsI Released to Containment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-109 |
| 34-117 | Case 3BE-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-110 |
| 34-118 | Case 3BE-3: Mass Fraction of Fission Products Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-110 |
| 34-119 | Case 3BE-3: Mass Fraction of SrO Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-111 |
| 34-120 | Case 3BL-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-111 |
| 34-121 | Case 3BL-1: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection..... | 34-112 |
| 34-122 | Case 3BL-1: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection..... | 34-112 |
| 34-123 | Case 3BL-1: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection..... | 34-113 |
| 34-124 | Case 3BL-1: Break Flow Rate SBLOCA with Failed Gravity Injection..... | 34-113 |
| 34-125 | Case 3BL-1: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection..... | 34-114 |
| 34-126 | Case 3BL-1: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-114 |
| 34-127 | Case 3BL-1: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-115 |
| 34-128 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Injection..... | 34-115 |
| 34-129 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Injection..... | 34-116 |
| 34-130 | Case 3BL-1: Core Mass SBLOCA with Failed Gravity Injection..... | 34-116 |
| 34-131 | Case 3BL-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-117 |
| 34-132 | Case 3BL-1: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection..... | 34-117 |
| 34-133 | Case 3BL-1: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-134 | Case 3BL-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-135 | Case 3BL-1: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-136 | Case 3BL-1: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-137 | Case 3BL-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed Gravity Injection..... | 34-120 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-138 | Case 3BL-2: ADS Stage 4 Flow Rates DVI Line Break with Failed Gravity Injection | 34-120 |
| 34-139 | Case 3BL-2: Accumulator/CMT Water Mass DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-140 | Case 3BL-2: IRWST Injection Flow Rate DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-141 | Case 3BL-2: Break Flow Rate DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-142 | Case 3BL-2: Reactor Vessel Water Level DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-143 | Case 3BL-2: Core Temperatures DVI Line Break with Failed Gravity Injection | 34-123 |
| 34-144 | Case 3BL-2: Containment Water Pool Elevations DVI Line Break with Failed Gravity Injection..... | 34-123 |
| 34-145 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Injection | 34-124 |
| 34-146 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection..... | 34-124 |
| 34-147 | Case 3BL-2: Core Mass DVI Line Break with Failed Gravity Injection | 34-125 |
| 34-148 | Case 3BL-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed Gravity Injection | 34-125 |
| 34-149 | Case 3BL-2: In-Vessel Hydrogen Generation DVI Line Break with Failed Gravity Injection..... | 34-126 |
| 34-150 | Case 3BL-2: Mass Fraction of CsI Released to Containment DVI Line Break with Failed Gravity Injection | 34-126 |
| 34-151 | Case 3BL-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-152 | Case 3BL-2: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-153 | Case 3BL-2: Mass Fraction of SrO Released to Environment DVI Line Break with Failed Gravity Injection..... | 34-128 |
| 34-154 | Case 3BR-1: Reactor Coolant System and Steam Generator Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-128 |
| 34-155 | Case 3BR-1: ADS Stage 4 Flow Rates CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-156 | Case 3BR-1: Accumulator/CMT Water Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-157 | Case 3BR-1: IRWST Injection Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-130 |
| 34-158 | Case 3BR-1: Break Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-130 |
| 34-159 | Case 3BR-1: Reactor Vessel Water Level CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-160 | Case 3BR-1: Core Temperatures CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |
| 34-161 | Case 3BR-1: Containment Water Pool Elevations CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-132 |
| 34-162 | Case 3BR-1: Containment Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-132 |
| 34-163 | Case 3BR-1: Containment Gas Temperature CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-133 |
| 34-164 | Case 3BR-1: Core Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-133 |
| 34-165 | Case 3BR-1: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-166 | Case 3BR-1: In-Vessel Hydrogen Generation CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-167 | Case 3BR-1: Mass Fraction of CsI Released to Containment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-168 | Case 3BR-1: Mass Fraction of Noble Gases Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-169 | Case 3BR-1: Mass Fraction of Fission Products Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-136 |
| 34-170 | Case 3BR-1: Mass Fraction of SrO Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-136 |
| 34-171 | Case 3BR-1a: Reactor Coolant System and Steam Generator Pressure CL LBLOCA with Failed Accumulators..... | 34-137 |
| 34-172 | Case 3BR-1a: ADS Stage 4 Flow Rates CL LBLOCA with Failed Accumulators | 34-137 |
| 34-173 | Case 3BR-1a: Accumulator/CMT Water Mass CL LBLOCA with Failed Accumulators | 34-138 |
| 34-174 | Case 3BR-1a: IRWST Injection Flow Rate CL LBLOCA with Failed Accumulators | 34-138 |
| 34-175 | Case 3BR-1a: Break Flow Rate CL LBLOCA with Failed Accumulators..... | 34-139 |
| 34-176 | Case 3BR-1a: Reactor Vessel Water Level CL LBLOCA with Failed Accumulators | 34-139 |
| 34-177 | Case 3BR-1a: Core Temperatures CL LBLOCA with Failed Accumulators | 34-140 |
| 34-178 | Case 3BR-1a: Containment Water Pool Elevations CL LBLOCA with Failed Accumulators | 34-140 |
| 34-179 | Case 3BR-1a: Containment Pressure CL LBLOCA with Failed Accumulators | 34-141 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-180 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Failed Accumulators | 34-141 |
| 34-181 | Case 3BR-1a: Core Mass CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-182 | Case 3BR-1a: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-183 | Case 3BR-1a: In-Vessel Hydrogen Generation CL LBLOCA with Failed Accumulators | 34-143 |
| 34-184 | Case 3BR-1a: Mass Fraction of CsI Released to Containment CL LBLOCA with Failed Accumulators..... | 34-143 |
| 34-185 | Case 3BR-1a: Mass Fraction of Noble Gases Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-186 | Case 3BR-1a: Mass Fraction of Fission Products Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-187 | Case 3BR-1a: Mass Fraction of SrO Released to Environment CL LBLOCA with Failed Accumulators | 34-145 |
| 34-188 | Case 3C-1: Reactor Coolant System and Steam Generator Pressure Vessel Rupture | 34-145 |
| 34-189 | Case 3C-1: ADS Stage 4 Flow Rates Vessel Rupture..... | 34-146 |
| 34-190 | Case 3C-1: Accumulator/CMT Water Mass Vessel Rupture | 34-146 |
| 34-191 | Case 3C-1: IRWST Injection Flow Rate Vessel Rupture..... | 34-147 |
| 34-192 | Case 3C-1: Break Flow Rate Vessel Rupture..... | 34-147 |
| 34-193 | Case 3C-1: Reactor Vessel Water Level Vessel Rupture | 34-148 |
| 34-194 | Case 3C-1: Core Temperatures Vessel Rupture | 34-148 |
| 34-195 | Case 3C-1: Containment Water Pool Elevations Vessel Rupture..... | 34-149 |
| 34-196 | Case 3C-1: Containment Pressure Vessel Rupture..... | 34-149 |
| 34-197 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 34-150 |
| 34-198 | Case 3C-1: Core Mass Vessel Rupture | 34-150 |
| 34-199 | Case 3C-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture | 34-151 |
| 34-200 | Case 3C-1: In-Vessel Hydrogen Generation Vessel Rupture | 34-151 |
| 34-201 | Case 3C-1: Mass Fraction of CsI Released to Containment Vessel Rupture..... | 34-152 |
| 34-202 | Case 3C-1: Mass Fraction of Noble Gas Released to Environment Vessel Rupture..... | 34-152 |
| 34-203 | Case 3C-1: Mass Fraction of Fission Products Released to Environment Vessel Rupture | 34-153 |
| 34-204 | Case 3C-1: Mass Fraction of SrO Released to Environment Vessel Rupture | 34-153 |
| 34-205 | Case 3C-2: Reactor Coolant System and Steam Generator Pressure Vessel Rupture with Containment Failure | 34-154 |
| 34-206 | Case 3C-2: ADS Stage 4 Flow Rates Vessel Rupture with Containment Failure | 34-154 |
| 34-207 | Case 3C-2: Accumulator/CMT Water Mass Vessel Rupture with Containment Failure..... | 34-155 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-208 | Case 3C-2: IRWST Injection Flow Rate Vessel Rupture with Containment Failure..... | 34-155 |
| 34-209 | Case 3C-2: Break Flow Rate Vessel Rupture with Containment Failure | 34-156 |
| 34-210 | Case 3C-2: Reactor Vessel Water Level Vessel Rupture with Containment Failure..... | 34-156 |
| 34-211 | Case 3C-2: Core Temperatures Vessel Rupture with Containment Failure..... | 34-157 |
| 34-212 | Case 3C-2: Containment Water Pool Elevations Vessel Rupture with Containment Failure..... | 34-157 |
| 34-213 | Case 3C-2: Containment Pressure Vessel Rupture with Containment Failure | 34-158 |
| 34-214 | Case 3C-2: Containment Gas Temperature Vessel Rupture with Containment Failure..... | 34-158 |
| 34-215 | Case 3C-2: Core Mass Vessel Rupture with Containment Failure..... | 34-159 |
| 34-216 | Case 3C-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture with Containment Failure..... | 34-159 |
| 34-217 | Case 3C-2: In-Vessel Hydrogen Generation Vessel Rupture with Containment Failure..... | 34-160 |
| 34-218 | Case 3C-2: Mass Fraction of CsI Released to Containment Vessel Rupture with Containment Failure | 34-160 |
| 34-219 | Case 3C-2: Mass Fraction of Noble Gases Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-220 | Case 3C-2: Mass Fraction of Fission Products Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-221 | Case 3C-2: Mass Fraction of SrO Released to Environment Vessel Rupture with Containment Failure | 34-162 |
| 34-222 | Case 3D-1: Reactor Coolant System and Steam Generator Pressure Spurious ADS-4 with Failed CMTs..... | 34-162 |
| 34-223 | Case 3D-1: ADS Stage 4 Flow Rates Spurious ADS-4 with Failed CMTs..... | 34-163 |
| 34-224 | Case 3D-1: Accumulator/CMT Water Mass Spurious ADS-4 with Failed CMTs | 34-163 |
| 34-225 | Case 3D-1: IRWST Injection Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-226 | Case 3D-1: Break Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-227 | Case 3D-1: Reactor Vessel Water Level Spurious ADS-4 with Failed CMTs | 34-165 |
| 34-228 | Case 3D-1: Core Temperatures Spurious ADS-4 with Failed CMTs..... | 34-165 |
| 34-229 | Case 3D-1: Containment Water Pool Elevations Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-230 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-231 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs | 34-167 |
| 34-232 | Case 3D-1: Core Mass Spurious ADS-4 with Failed CMTs | 34-167 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-233 | Case 3D-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-4 with Failed CMTs | 34-168 |
| 34-234 | Case 3D-1: In-Vessel Hydrogen Generation Spurious ADS-4 with Failed CMTs | 34-168 |
| 34-235 | Case 3D-1: Mass Fraction of CsI Released to Containment Spurious ADS-4 with Failed CMTs | 34-169 |
| 34-236 | Case 3D-1: Mass Fraction of Noble Gases Released to Environment Spurious ADS-4 with Failed CMTs | 34-169 |
| 34-237 | Case 3D-1: Mass Fraction of Fission Products Released to Environment Spurious ADS-4 with Failed CMTs | 34-170 |
| 34-238 | Case 3D-1: Mass Fraction of SrO Released to Environment Spurious ADS-4 with Failed CMTs | 34-170 |
| 34-239 | Case 3D-2: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2 with Failed CMTs | 34-171 |
| 34-240 | Case 3D-2: ADS Stage 4 Flow Rates Spurious ADS-2 with Failed CMTs..... | 34-171 |
| 34-241 | Case 3D-2: Accumulator/CMT Water Mass Spurious ADS-2 with Failed CMTs | 34-172 |
| 34-242 | Case 3D-2: IRWST Injection Flow Rate Spurious ADS-2 with Failed CMTs..... | 34-172 |
| 34-243 | Case 3D-2: Break Flow Rate Spurious ADS-2 with Failed CMTs | 34-173 |
| 34-244 | Case 3D-2: Reactor Vessel Water Level Spurious ADS-2 with Failed CMTs..... | 34-173 |
| 34-245 | Case 3D-2: Core Temperatures Spurious ADS-2 with Failed CMTs..... | 34-174 |
| 34-246 | Case 3D-2: Containment Pool Water Elevations Spurious ADS-2 with Failed CMTs | 34-174 |
| 34-247 | Case 3D-2: Containment Pressure Spurious ADS-2 with Failed CMTs | 34-175 |
| 34-248 | Case 3D-2: Containment Gas Temperature Spurious ADS-2 with Failed CMTs | 34-175 |
| 34-249 | Case 3D-2: Core Mass Spurious ADS-2 with Failed CMTs | 34-176 |
| 34-250 | Case 3D-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2 with Failed CMTs | 34-176 |
| 34-251 | Case 3D-2: In-Vessel Hydrogen Generation Spurious ADS-2 with Failed CMTs | 34-177 |
| 34-252 | Case 3D-2: Mass Fraction of CsI Released to Containment Spurious ADS-2 with Failed CMTs | 34-177 |
| 34-253 | Case 3D-2: Mass Fraction of Noble Gas Released to Environment Spurious ADS-2 with Failed CMTs..... | 34-178 |
| 34-254 | Case 3D-2: Mass Fraction of Fission Products Released to Environment Spurious ADS-2 with Failed CMTs..... | 34-178 |
| 34-255 | Case 3D-2: Mass Fraction of SrO Released to Environment Spurious ADS-2 with Failed CMTs | 34-179 |
| 34-256 | Case 3D-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed ADS..... | 34-179 |
| 34-257 | Case 3D-3: ADS Stage 4 Flow Rates DVI Line Break with Failed ADS..... | 34-180 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-258 | Case 3D-3: Accumulator/CMT Water Mass DVI Line Break with Failed ADS..... | 34-180 |
| 34-259 | Case 3D-3: IRWST Injection Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-260 | Case 3D-3: Break Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-261 | Case 3D-3: Reactor Vessel Water Level DVI Line Break with Failed ADS..... | 34-182 |
| 34-262 | Case 3D-3: Core Temperatures DVI Line Break with Failed ADS..... | 34-182 |
| 34-263 | Case 3D-3: Containment Water Pool Elevations DVI Line Break with Failed ADS..... | 34-183 |
| 34-264 | Case 3D-3: Containment Pressure DVI Line Break with Failed ADS | 34-183 |
| 34-265 | Case 3D-3: Containment Gas Temperature DVI Line Break with Failed ADS | 34-184 |
| 34-266 | Case 3D-3: Core Mass DVI Line Break with Failed ADS | 34-184 |
| 34-267 | Case 3D-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed ADS..... | 34-185 |
| 34-268 | Case 3D-3: In-Vessel Hydrogen Generation DVI Line Break with Failed ADS..... | 34-185 |
| 34-269 | Case 3D-3: Mass Fraction of CsI Released to Containment DVI Line Break with Failed ADS | 34-186 |
| 34-270 | Case 3D-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed ADS..... | 34-186 |
| 34-271 | Case 3D-3: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed ADS..... | 34-187 |
| 34-272 | Case 3D-3: Mass Fraction of SrO Released to Environment DVI Line Break with Failed ADS..... | 34-187 |
| 34-273 | Case 3D-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-274 | Case 3D-4: ADS Stage 4 Flow Rates Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-275 | Case 3D-4: Accumulator/CMT Water Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-276 | Case 3D-4: IRWST Injection Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-277 | Case 3D-4: Break Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame..... | 34-190 |
| 34-278 | Case 3D-4: Reactor Vessel Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-190 |
| 34-279 | Case 3D-4: Core Temperatures Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-280 | Case 3D-4: Containment Water Pool Elevations Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-281 | Case 3D-4: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-282 | Case 3D-4: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |
| 34-283 | Case 3D-4: Core Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-284 | Case 3D-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-285 | Case 3D-4: In-Vessel Hydrogen Generation Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-286 | Case 3D-4: Mass Fraction of CsI Released to Containment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-287 | Case 3D-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-288 | Case 3D-4: Mass Fraction of Fission Products Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-289 | Case 3D-4: Mass Fraction of SrO Release to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-196 |
| 34-290 | Case 6E-1: Reactor Coolant System and Steam Generator Pressure SGTR Early Core Melt..... | 34-196 |
| 34-291 | Case 6E-1: ADS Stage 4 Flow Rates SGTR Early Core Melt..... | 34-197 |
| 34-292 | Case 6E-1: Accumulator/CMT Water Mass SGTR Early Core Melt..... | 34-197 |
| 34-293 | Case 6E-1: IRWST Injection Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-294 | Case 6E-1: Break Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-295 | Case 6E-1: Reactor Vessel Water Level SGTR Early Core Melt..... | 34-199 |
| 34-296 | Case 6E-1: Core Temperatures SGTR Early Core Melt..... | 34-199 |
| 34-297 | Case 6E-1: Containment Water Pool Elevations SGTR Early Core Melt | 34-200 |
| 34-298 | Case 6E-1: Containment Pressure SGTR Early Core Melt | 34-200 |
| 34-299 | Case 6E-1: Containment Gas Temperature SGTR Early Core Melt..... | 34-201 |
| 34-300 | Case 6E-1: Core Mass SGTR Early Core Melt | 34-201 |
| 34-301 | Case 6E-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Early Core Melt..... | 34-202 |
| 34-302 | Case 6E-1: In-Vessel Hydrogen Generation SGTR Early Core Melt..... | 34-202 |
| 34-303 | Case 6E-1: Mass Fraction of CsI Released to Containment SGTR Early Core Melt | 34-203 |
| 34-304 | Case 6E-1: Mass Fraction of Noble Gases Released to Environment SGTR Early Core Melt..... | 34-203 |
| 34-305 | Case 6E-1: Mass Fraction of Fission Products Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-306 | Case 6E-1: Mass Fraction of SrO Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-307 | Case 6L-1: Reactor Coolant System and Steam Generator Pressure SGTR Core Melt Failure at Recirculation..... | 34-205 |
| 34-308 | Case 6L-1: ADS Stage 4 Flow Rates SGTR Core Melt Failure at Recirculation | 34-205 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-309 | Case 6L-1: Accumulator/CMT Water Mass SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-310 | Case 6L-1: IRWST Injection Flow Rate SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-311 | Case 6L-1: Break Flow Rate SGTR Core Melt Failure at Recirculation..... | 34-207 |
| 34-312 | Case 6L-1: Reactor Vessel Water Level SGTR Core Melt Failure at Recirculation | 34-207 |
| 34-313 | Case 6L-1: Core Temperatures SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-314 | Case 6L-1: Containment Water Pool Elevations SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-315 | Case 6L-1: Containment Pressure SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-316 | Case 6L-1: Containment Gas Temperature SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-317 | Case 6L-1: Core Mass SGTR Core Melt Failure at Recirculation..... | 34-210 |
| 34-318 | Case 6L-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Core Melt Failure at Recirculation | 34-210 |
| 34-319 | Case 6L-1: In-Vessel Hydrogen Generation SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-320 | Case 6L-1: Mass Fraction of CsI Released to Containment SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-321 | Case 6L-1: Mass Fraction of Noble Gases Released to Environment SGTR Core Melt Failure at Recirculation..... | 34-212 |
| 34-322 | Case 6L-1: Mass Fraction of Fission Products Released to Environment SGTR Core Melt Failure at Recirculation..... | 34-212 |
| 34-323 | Case 6L-1: Mass Fraction of SrO Released to Environment SGTR Core Melt Failure at Recirculation | 34-213 |
| 34-324 | Case 1AP-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-213 |
| 34-325 | Case 1AP-1: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed..... | 34-214 |
| 34-326 | Case 1AP-1: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-214 |
| 34-327 | Case 1AP-1: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-215 |
| 34-328 | Case 1AP-1: Break Flow Rate SBLOCA with PRHR, CMTs Failed..... | 34-215 |
| 34-329 | Case 1AP-1: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-216 |
| 34-330 | Case 1AP-1: Core Temperatures SBLOCA with PRHR, CMTs Failed..... | 34-216 |
| 34-331 | Case 1AP-1: Containment Pool Water Elevations SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-332 | Case 1AP-1: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-333 | Case 1AP-1: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-334 | Case 1AP-1: Core Mass SBLOCA with PRHR, CMTs Failed | 34-218 |
| 34-335 | Case 1AP-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-336 | Case 1AP-1: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-337 | Case 1AP-1: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-338 | Case 1AP-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-339 | Case 1AP-1: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-340 | Case 1AP-1: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-341 | Case 1AP-2: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-342 | Case 1AP-2: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-343 | Case 1AP-2: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-344 | Case 1AP-2: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-345 | Case 1AP-2: Break Flow Rate SBLOCA with PRHR, CMTs Failed | 34-224 |
| 34-346 | Case 1AP-2: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-224 |
| 34-347 | Case 1AP-2: Core Temperatures SBLOCA with PRHR, CMTs Failed | 34-225 |
| 34-348 | Case 1AP-2: Containment Water Pool Elevations SBLOCA with PRHR, CMTs Failed | 34-225 |
| 34-349 | Case 1AP-2: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-350 | Case 1AP-2: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-351 | Case 1AP-2: Core Mass SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-352 | Case 1AP-2: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-353 | Case 1AP-2: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-228 |
| 34-354 | Case 1AP-2: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed | 34-228 |
| 34-355 | Case 1AP-2: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-356 | Case 1AP-2: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-357 | Case 1AP-2: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed | 34-230 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-358 | Case 1A-1: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes..... | 34-230 |
| 34-359 | Case 1A-1: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-231 |
| 34-360 | Case 1A-1: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-231 |
| 34-361 | Case 1A-1: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-362 | Case 1A-1: Break Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-363 | Case 1A-1: Reactor Vessel Water Level Transient with Creep of SG Tubes | 34-233 |
| 34-364 | Case 1A-1: Core Temperatures Transient with Creep of SG Tubes..... | 34-233 |
| 34-365 | Case 1A-1: Containment Pool Water Elevations Transient with Creep of SG Tubes..... | 34-234 |
| 34-366 | Case 1A-1: Containment Pressure Transient with Creep of SG Tubes | 34-234 |
| 34-367 | Case 1A-1: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-235 |
| 34-368 | Case 1A-1: Core Mass Transient with Creep of SG Tubes..... | 34-235 |
| 34-369 | Case 1A-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes..... | 34-236 |
| 34-370 | Case 1A-1: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-236 |
| 34-371 | Case 1A-1: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-237 |
| 34-372 | Case 1A-1: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes..... | 34-237 |
| 34-373 | Case 1A-1: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes..... | 34-238 |
| 34-374 | Case 1A-1: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-238 |
| 34-375 | Case 1A-2: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes..... | 34-239 |
| 34-376 | Case 1A-2: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-239 |
| 34-377 | Case 1A-2: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-240 |
| 34-378 | Case 1A-2: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-240 |
| 34-379 | Case 1A-2: Break Flow Rate Transient with Creep of SG Tubes | 34-241 |
| 34-380 | Case 1A-2: Reactor Vessel Water Level Transient with Creep of SG Tubes..... | 34-241 |
| 34-381 | Case 1A-2: Core Temperatures Transient with Creep of SG Tubes..... | 34-242 |
| 34-382 | Case 1A-2: Containment Water Pool Elevations Transient with Creep of SG Tubes | 34-242 |
| 34-383 | Case 1A-2: Containment Pressure Transient with Creep of SG Tubes | 34-243 |
| 34-384 | Case 1A-2: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-243 |
| 34-385 | Case 1A-2: Core Mass Transient with Creep of SG Tubes | 34-244 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-386 | Case 1A-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes | 34-244 |
| 34-387 | Case 1A-2: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-245 |
| 34-388 | Case 1A-2: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-245 |
| 34-389 | Case 1A-2: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes | 34-246 |
| 34-390 | Case 1A-2: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes | 34-246 |
| 34-391 | Case 1A-2: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-247 |
| 34-392 | Case 3BE-1: Containment Pressure DDT Intermediate Containment Failure | 34-247 |
| 34-393 | Case 3BE-1: Containment Gas Temperature DDT Intermediate Containment Failure..... | 34-248 |
| 34-394 | Case 3BE-1: Containment Hydrogen Concentration DDT Intermediate Containment Failure..... | 34-248 |
| 34-395 | Case 3BE-1: Noble Gases Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-396 | Case 3BE-1: CsI and RbI Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-397 | Case 3BE-1: TeO ₂ Release Fraction DDT Intermediate Containment Failure | 34-250 |
| 34-398 | Case 3BE-1: SrO Release Fraction DDT Intermediate Containment Failure..... | 34-250 |
| 34-399 | Case 3BE-1: MoO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-400 | Case 3BE-1: CsOH and RbOH Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-401 | Case 3BE-1: BaO Release Fraction DDT Intermediate Containment Failure | 34-252 |
| 34-402 | Case 3BE-1: La ₂ O ₃ Release Fraction DDT Intermediate Containment Failure..... | 34-252 |
| 34-403 | Case 3BE-1: CeO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-253 |
| 34-404 | Case 3BE-1: Sb Release Fraction DDT Intermediate Containment Failure | 34-253 |
| 34-405 | Case 3BE-1: Te ₂ Release Fraction DDT Intermediate Containment Failure | 34-254 |
| 34-406 | Case 3BE-1: UO ₂ Release Fraction DDT Intermediate Containment Failure | 34-254 |
| 34-407 | Case 3BE-1: RCS Pressure No PCS Water Cooling and Late Containment Failure | 34-255 |
| 34-408 | Case 3BE-1: Reactor Vessel Mixture Level No PCS Water Cooling and Late Containment Failure..... | 34-255 |
| 34-409 | Case 3BE-1: Core-Exit Temperature No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-410 | Case 3BE-1: In-Vessel Hydrogen Generation No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-411 | Case 3BE-1: Containment Pressure No PCS Water Cooling and Late Containment Failure..... | 34-257 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-412 | Case 3BE-1: Containment Gas Temperature No PCS Water Cooling and Late Containment Failure..... | 34-257 |
| 34-413 | Case 3BE-1: Containment Hydrogen Concentration No PCS Water Cooling and Late Containment Failure | 34-258 |
| 34-414 | Case 3BE-1: Noble Gas Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-258 |
| 34-415 | Case 3BE-1: CsI and RbI Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-416 | Case 3BE-1: TeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-417 | Case 3BE-1: SrO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-418 | Case 3BE-1: MoO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-419 | Case 3BE-1: CsOH and RbOH Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-420 | Case 3BE-1: BaO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-421 | Case 3BE-1: La ₂ O ₃ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-422 | Case 3BE-1: CeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-423 | Case 3BE-1: Sb Release Fraction No PCS Water Cooling and Late Containment Failure | 34-263 |
| 34-424 | Case 3BE-1: Te ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-263 |
| 34-425 | Case 3BE-1: UO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-264 |
| 35-1 | Containment Event Tree..... | 35-29 |
| 36-1 | AP1000 Accident Class 1A Base Case for Node DP Success – RCS Pressure..... | 36-7 |
| 36-2 | AP1000 Accident Class 1A Base Case for Node DP Success – Core-Exit Gas Temperature | 36-8 |
| 36-3 | AP1000 Accident Class 1A Base Case for Node DP Success – Steam Generator Tube Creep Damage..... | 36-9 |
| 36-4 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Passive RHR Heat Removal..... | 36-10 |
| 36-5 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core Makeup Tank Flow (one tank) | 36-11 |
| 36-6 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Reactor Coolant System Pressure..... | 36-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 36-7 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core-Exit Gas Temperature..... | 36-13 |
| 39-1 | AP1000 Base Case In-Vessel Retention of Molten Core Debris..... | 39-23 |
| 39-2 | AP1000 Core Shroud..... | 39-24 |
| 39-3 | Comparison of ULPU-2000 Configuration III and ULPU-2000 Configuration IV..... | 39-25 |
| 39-4 | Effect of Water Level on Water Circulation During IVR..... | 39-26 |
| 39-5 | ULPU-2000 Configuration IV Results (Reference 39-4)..... | 39-27 |
| 39-6 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Zirconium Oxidation Fraction Input Probability Distribution..... | 39-28 |
| 39-7 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Mass of Steel in Debris Input Probability Distribution..... | 39-29 |
| 39-8 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Time of Final Bounding State Input Probability Distribution..... | 39-30 |
| 39-9 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Oxide Layer..... | 39-31 |
| 39-10 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Metal Layer..... | 39-32 |
| 39-11 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Power Density in Oxide Debris..... | 39-33 |
| 39-12 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Internal Rayleigh Number in the Oxide Layer..... | 39-34 |
| 39-13 | AP1000 In-Vessel Retention of Molten Core Debris Quantification External Rayleigh Number in the Metal Layer..... | 39-35 |
| 39-14 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Normalized Heat Fluxes..... | 39-36 |
| 39-15 | AP1000 Passive Core Cooling System..... | 39-37 |
| 39-16 | Containment Floodable Region..... | 39-38 |
| 39-17 | Containment Floodable Region – Exploded View..... | 39-39 |
| 39-18 | AP1000 Cavity Flooding Rate..... | 39-40 |
| 39-19 | Schematic of the AP1000 Reactor Vessel, Vessel Cavity, Vessel Insulation, and Vents..... | 39-41 |
| 39A-1 | AP1000 Reactor Pressure Vessel, Core and Lower Internals..... | 39A-21 |
| 39A-2 | Core Shroud..... | 39A-22 |
| 39A-3 | Bottom of Core Shroud, Core Barrel, and Lower Core Support Plate (Not to Scale)..... | 39A-23 |
| 39A-4 | Axial Power Shapes Used for Core Relocation Analysis..... | 39A-24 |
| 39A-5 | Radial Power Shape Used for Core Relocation Analysis..... | 39A-25 |
| 39A-6 | Cross Section Geometry of Finite Difference Computational Model..... | 39A-26 |
| 39A-7 | Computational Mesh for Finite Difference Computational Model..... | 39A-27 |
| 39A-8 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Reactor – Coolant System Pressure..... | 39A-28 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 39A-9 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Containment and Reactor Coolant System Pressure..... | 39A-28 |
| 39A-10 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-29 |
| 39A-11 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Hottest Temperature in Core | 39A-29 |
| 39A-12 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Hydrogen Generated in Core | 39A-30 |
| 39A-13 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.7 – 2.0 m)..... | 39A-30 |
| 39A-14 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 2.0 – 2.3 m)..... | 39A-31 |
| 39A-15 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Core Shroud/Barrel..... | 39A-31 |
| 39A-16 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Volume of Debris in Reactor Vessel Lower Plenum..... | 39A-32 |
| 39A-17 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Coolant System Pressure | 39A-32 |
| 39A-18 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Containment and Reactor Coolant System Pressure | 39A-33 |
| 39A-19 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-33 |
| 39A-20 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Hottest Temperature in Core | 39A-34 |
| 39A-21 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Hydrogen Generated in Core | 39A-34 |
| 39A-22 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.1 – 1.4 m)..... | 39A-35 |
| 39A-23 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.4 – 1.7 m)..... | 39A-35 |
| 39A-24 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Core Shroud/Barrel | 39A-36 |
| 39A-25 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Volume of Debris in Reactor Vessel Lower Plenum | 39A-36 |
| 39A-26 | Initial Oxide Relocation to Lower Plenum..... | 39A-37 |
| 39A-27 | Finite Difference Result for Top-Skewed Power Shape at Level 5 | 39A-38 |
| 39A-28 | Finite Difference Temperature Map Level 5 at 5380 Seconds for Top-Skewed Power Shape Case..... | 39A-38 |
| 39A-29 | MAAP4 Core Temperature Profile for Top-Skewed Power Shape Core Elevation = 2.0 – 2.3 m Above Bottom of Active Fuel (Core Axial Row 12) | 39A-39 |
| 39A-30 | Relocation of Corium..... | 39A-39 |
| 39A-31 | Model for Relocation to Lower Plenum | 39A-40 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 40-1 | AP1000 Passive Containment Cooling System..... | 40-7 |
| 40-2 | Schematic of Passive Containment Cooling System Piping..... | 40-8 |
| 40-3 | AP1000 Containment Venting Pressure Response..... | 40-9 |
| 40-4 | AP1000 Containment Venting Loss of Containment Air..... | 40-10 |
| 40-5 | AP1000 Dry PCS Containment Pressure Response | 40-11 |
| 40-6 | AP1000 Dry PCS Containment Temperature Response | 40-12 |
| 41-1 | IRWST Hydrogen Venting..... | 41-36 |
| 41-2 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Success..... | 41-37 |
| 41-3 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Failure | 41-38 |
| 41-4 | Accident Class 3BL Early Detonation Decomposition Event Tree | 41-39 |
| 41-5 | Accident Class 3C/3BR Early Detonation Decomposition Event Tree | 41-40 |
| 41-6 | Accident Class 3D/1D Early Detonation Decomposition Event Tree | 41-41 |
| 41-7 | Accident Class AP Early Detonation Decomposition Event Tree | 41-42 |
| 41-8 | Boil-Off Hydrogen Generation Probability Density Function..... | 41-43 |
| 41-9 | No Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-44 |
| 41-10 | No-Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-45 |
| 41-11 | Early Reflood Hydrogen Generation Probability Density Function | 41-46 |
| 41-12 | Early Reflood Pre-Burn Containment Pressure Probability Density Function | 41-47 |
| 41-13 | Early Reflood Hydrogen Deflagration Peak Pressure Probability | 41-48 |
| 41-14 | Late Reflood Hydrogen Generation Probability Density Function..... | 41-49 |
| 41-15 | Late Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-50 |
| 41-16 | Late Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-51 |
| 41-17 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Success..... | 41-52 |
| 41-18 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Failure | 41-53 |
| 41-19 | Accident Class 3BL Intermediate Detonation Decomposition Event Tree..... | 41-54 |
| 41-20 | Accident Class 3C/3BR Intermediate Detonation Decomposition Event Tree..... | 41-55 |
| 41-21 | Accident Class 3D/1D Intermediate Detonation Decomposition Event Tree..... | 41-56 |
| 41-22 | Accident Class 1AP Intermediate Detonation Decomposition Event Tree..... | 41-57 |
| 41A-1 | Case 3BE-1: Reactor Coolant System Pressure DVI Line Break for Containment Water Level | 41A-41 |
| 41A-2 | Case 3BE-1: Core-Exit Gas Temperature DVI Line Break for Containment Water Level | 41A-41 |
| 41A-3 | Case 3BE-1: Reactor Vessel Mixture Level DVI Line Break for Containment Water Level | 41A-42 |
| 41A-4 | Case 3BE-1: Hydrogen Generated In-Vessel DVI Line Break for Containment Water Level | 41A-42 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-5 | Case 3BE-1: Containment Pressure DVI Line Break for Containment Water Level..... | 41A-43 |
| 41A-6 | Case 3BE-1: Containment Gas Temperature DVI Line Break for Containment Water Level | 41A-43 |
| 41A-7 | Case 3BE-1: Containment Compartments Water Level DVI Line Break for Containment Water Level | 41A-44 |
| 41A-8 | Case 3BE-1: Well-Mixed Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-44 |
| 41A-9 | Case 3BE-1: Well-Mixed Compartment Steam Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-10 | Case 3BE-1: Well-Mixed Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-11 | Case 3BE-1: Confined Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-46 |
| 41A-12 | Case 3BE-1: Confined Compartment Steam Concentration DVI Line Break for Containment Water Level..... | 41A-46 |
| 41A-13 | Case 3BE-1: Confined Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-47 |
| 41A-14 | Case 3BE-1: Equivalence Ratio in SG Room DVI Line Break for Containment Water Level | 41A-47 |
| 41A-15 | Case 3BE-1: Equivalence Ratio in CMT Room DVI Line Break for Containment Water Level | 41A-48 |
| 41A-16 | Case 3BE-1: Equivalence Ratio in IRWST DVI Line Break for Containment Water Level | 41A-48 |
| 41A-17 | Case 3BE-1: Equivalence Ratio in PXS DVI Line Break for Containment Water Level..... | 41A-49 |
| 41A-18 | Case 3BE-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-49 |
| 41A-19 | Case 3BE-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-20 | Case 3BE-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-21 | Case 3BE-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-22 | Case 3BE-2: Containment Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-23 | Case 3BE-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-24 | Case 3BE-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-25 | Case 3BE-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-53 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-26 | Case 3BE-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-53 |
| 41A-27 | Case 3BE-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-28 | Case 3BE-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-29 | Case 3BE-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-30 | Case 3BE-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-31 | Case 3BE-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-32 | Case 3BE-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-33 | Case 3BE-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-34 | Case 3BE-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-35 | Case 3BE-4: Reactor Coolant System Pressure Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-36 | Case 3BE-4: Core-Exit Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-37 | Case 3BE-4: Reactor Vessel Mixture Level Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-38 | Case 3BE-4: Hydrogen Generated In-Vessel Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-39 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection..... | 41A-60 |
| 41A-40 | Case 3BE-4: Containment Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-60 |
| 41A-41 | Case 3BE-4: Containment Compartments Water Level Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-42 | Case 3BE-4: Well-Mixed Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-43 | Case 3BE-4: Well-Mixed Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-44 | Case 3BE-4: Well-Mixed Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-45 | Case 3BE-4: Confined Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-46 | Case 3BE-4: Confined Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-47 | Case 3BE-4: Confined Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-64 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-48 | Case 3BE-4: Equivalence Ratio in SG Room Spurious ADS, Failed Gravity Injection | 41A-64 |
| 41A-49 | Case 3BE-4: Equivalence Ratio in CMT Room Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-50 | Case 3BE-4: Equivalence Ratio in IRWST Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-51 | Case 3BE-4: Equivalence Ratio in PXS Spurious ADS, Failed Gravity Injection | 41A-66 |
| 41A-52 | Case 3BE-5: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-66 |
| 41A-53 | Case 3BE-5: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-54 | Case 3BE-5: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-55 | Case 3BE-5: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-56 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-57 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-69 |
| 41A-58 | Case 3BE-5: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-69 |
| 41A-59 | Case 3BE-5: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-60 | Case 3BE-5: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-61 | Case 3BE-5: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-62 | Case 3BE-5: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-63 | Case 3BE-5: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-64 | Case 3BE-5: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-65 | Case 3BE-5: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-66 | Case 3BE-5: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-67 | Case 3BE-5: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-68 | Case 3BE-5: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-69 | Case 3BE-6: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-75 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-70 | Case 3BE-6: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-75 |
| 41A-71 | Case 3BE-6: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-72 | Case 3BE-6: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-73 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-74 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-75 | Case 3BE-6: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-76 | Case 3BE-6: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-77 | Case 3BE-6: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-78 | Case 3BE-6: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-79 | Case 3BE-6: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-80 | Case 3BE-6: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-81 | Case 3BE-6: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-81 |
| 41A-82 | Case 3BE-6: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-81 |
| 41A-83 | Case 3BE-6: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-84 | Case 3BE-6: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-85 | Case 3BE-6: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-83 |
| 41A-86 | Case 3BE-8: Reactor Coolant System Pressure SGTR..... | 41A-83 |
| 41A-87 | Case 3BE-8: Core-Exit Gas Temperature SGTR | 41A-84 |
| 41A-88 | Case 3BE-8: Reactor Vessel Mixture Level SGTR..... | 41A-84 |
| 41A-89 | Case 3BE-8: Hydrogen Generated In-Vessel SGTR | 41A-85 |
| 41A-90 | Case 3BE-8: Containment Pressure SGTR | 41A-85 |
| 41A-91 | Case 3BE-8: Containment Gas Temperature SGTR | 41A-86 |
| 41A-92 | Case 3BE-8: Containment Compartments Water Level SGTR..... | 41A-86 |
| 41A-93 | Case 3BE-8: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-87 |
| 41A-94 | Case 3BE-8: Well-Mixed Compartment Steam Concentration SGTR..... | 41A-87 |
| 41A-95 | Case 3BE-8: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-88 |
| 41A-96 | Case 3BE-8: Confined Compartment Hydrogen Concentration SGTR..... | 41A-88 |
| 41A-97 | Case 3BE-8: Confined Compartment Steam Concentration SGTR..... | 41A-89 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-98 | Case 3BE-8: Confined Compartment Oxygen Concentration SGTR..... | 41A-89 |
| 41A-99 | Case 3BE-8: Equivalence Ratio in SG Room SGTR | 41A-90 |
| 41A-100 | Case 3BE-8: Equivalence Ratio in CMT Room SGTR..... | 41A-90 |
| 41A-101 | Case 3BE-8: Equivalence Ratio in IRWST SGTR..... | 41A-91 |
| 41A-102 | Case 3BE-8: Equivalence Ratio in PXS SGTR..... | 41A-91 |
| 41A-103 | Case 3BE-9: Reactor Coolant System Pressure SGTR..... | 41A-92 |
| 41A-104 | Case 3BE-9: Core-Exit Gas Temperature SGTR | 41A-92 |
| 41A-105 | Case 3BE-9: Reactor Vessel Mixture Level SGTR..... | 41A-93 |
| 41A-106 | Case 3BE-9: Hydrogen Generated In-Vessel SGTR | 41A-93 |
| 41A-107 | Case 3BE-9: Containment Pressure SGTR | 41A-94 |
| 41A-108 | Case 3BE-9: Containment Gas Temperature SGTR | 41A-94 |
| 41A-109 | Case 3BE-9: Containment Compartments Water Level SGTR | 41A-95 |
| 41A-110 | Case 3BE-9: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-95 |
| 41A-111 | Case 3BE-9: Well-Mixed Compartment Steam Concentration SGTR | 41A-96 |
| 41A-112 | Case 3BE-9: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-96 |
| 41A-113 | Case 3BE-9: Confined Compartment Hydrogen Concentration SGTR..... | 41A-97 |
| 41A-114 | Case 3BE-9: Confined Compartment Steam Concentration SGTR..... | 41A-97 |
| 41A-115 | Case 3BE-9: Confined Compartment Oxygen Concentration SGTR..... | 41A-98 |
| 41A-116 | Case 3BE-9: Equivalence Ratio in SG Room SGTR | 41A-98 |
| 41A-117 | Case 3BE-9: Equivalence Ratio in CMT Room SGTR..... | 41A-99 |
| 41A-118 | Case 3BE-9: Equivalence Ratio in IRWST SGTR..... | 41A-99 |
| 41A-119 | Case 3BE-9: Equivalence Ratio in PXS SGTR..... | 41A-100 |
| 41A-120 | Case 3BL-1: Reactor Coolant System Pressure SBLOCA with Failed Gravity Recirculation | 41A-100 |
| 41A-121 | Case 3BL-1: Core-Exit Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-122 | Case 3BL-1: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-123 | Case 3BL-1: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-124 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-125 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-126 | Case 3BL-1: Containment Compartments Water Level SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-127 | Case 3BL-1: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-128 | Case 3BL-1: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-129 | Case 3BL-1: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-130 | Case 3BL-1: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |
| 41A-131 | Case 3BL-1: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-132 | Case 3BL-1: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-133 | Case 3BL-1: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-134 | Case 3BL-1: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-135 | Case 3BL-1: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-136 | Case 3BL-1: Equivalence Ratio in PXS SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-137 | Case 3BL-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-138 | Case 3BL-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-139 | Case 3BL-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-140 | Case 3BL-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-141 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-142 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-143 | Case 3BL-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Recirculation | 41A-112 |
| 41A-144 | Case 3BL-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-112 |
| 41A-145 | Case 3BL-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-146 | Case 3BL-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-147 | Case 3BL-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-114 |
| 41A-148 | Case 3BL-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-114 |
| 41A-149 | Case 3BL-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-115 |
| 41A-150 | Case 3BL-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Recirculation | 41A-115 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-151 | Case 3BL-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-152 | Case 3BL-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-153 | Case 3BL-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Recirculation | 41A-117 |
| 41A-154 | Case 3BR-1: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-117 |
| 41A-155 | Case 3BR-1: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-156 | Case 3BR-1: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-157 | Case 3BR-1: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-119 |
| 41A-158 | Case 3BR-1: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-119 |
| 41A-159 | Case 3BR-1: Containment Gas Temperature CL LBLOCA with Accumulator Failure | 41A-120 |
| 41A-160 | Case 3BR-1: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-120 |
| 41A-161 | Case 3BR-1: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-162 | Case 3BR-1: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-163 | Case 3BR-1: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-164 | Case 3BR-1: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-165 | Case 3BR-1: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-166 | Case 3BR-1: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-167 | Case 3BR-1: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-168 | Case 3BR-1: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-169 | Case 3BR-1: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-125 |
| 41A-170 | Case 3BR-1: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure | 41A-125 |
| 41A-171 | Case 3BR-1a: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-126 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-172 | Case 3BR-1a: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-126 |
| 41A-173 | Case 3BR-1a: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-174 | Case 3BR-1a: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-175 | Case 3BR-1a: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-128 |
| 41A-176 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-128 |
| 41A-177 | Case 3BR-1a: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-178 | Case 3BR-1a: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-179 | Case 3BR-1a: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-180 | Case 3BR-1a: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-181 | Case 3BR-1a: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-182 | Case 3BR-1a: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-183 | Case 3BR-1a: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-184 | Case 3BR-1a: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-185 | Case 3BR-1a: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-186 | Case 3BR-1a: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-187 | Case 3BR-1a: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure..... | 41A-134 |
| 41A-188 | Case 3C-1: Reactor Coolant System Pressure Vessel Rupture..... | 41A-134 |
| 41A-189 | Case 3C-1: Core-Exit Gas Temperature Vessel Rupture..... | 41A-135 |
| 41A-190 | Case 3C-1: Reactor Vessel Mixture Level Vessel Rupture | 41A-135 |
| 41A-191 | Case 3C-1: Hydrogen Generated In-Vessel Vessel Rupture..... | 41A-136 |
| 41A-192 | Case 3C-1: Containment Pressure Vessel Rupture..... | 41A-136 |
| 41A-193 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 41A-137 |
| 41A-194 | Case 3C-1: Containment Compartments Water Level Vessel Rupture | 41A-137 |
| 41A-195 | Case 3C-1: Well-Mixed Compartment Hydrogen Concentration Vessel Rupture..... | 41A-138 |
| 41A-196 | Case 3C-1: Well-Mixed Compartment Steam Concentration Vessel Rupture..... | 41A-138 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-197 | Case 3C-1: Well-Mixed Compartment Oxygen Concentration Vessel Rupture..... | 41A-139 |
| 41A-198 | Case 3C-1: Confined Compartment Hydrogen Concentration Vessel Rupture..... | 41A-139 |
| 41A-199 | Case 3C-1: Confined Compartment Steam Concentration Vessel Rupture..... | 41A-140 |
| 41A-200 | Case 3C-1: Confined Compartment Oxygen Concentration Vessel Rupture..... | 41A-140 |
| 41A-201 | Case 3C-1: Equivalence Ratio in SG Room Vessel Rupture..... | 41A-141 |
| 41A-202 | Case 3C-1: Equivalence Ratio in CMT Room Vessel Rupture | 41A-141 |
| 41A-203 | Case 3C-1: Equivalence Ratio in IRWST Vessel Rupture | 41A-142 |
| 41A-204 | Case 3C-1: Equivalence Ratio in PXS Vessel Rupture | 41A-142 |
| 41A-205 | Case 3D-1: Reactor Coolant System Pressure Spurious ADS-4 with Failed CMTs | 41A-143 |
| 41A-206 | Case 3D-1: Core-Exit Gas Temperature Spurious ADS-4 with Failed CMTs | 41A-143 |
| 41A-207 | Case 3D-1: Reactor Vessel Mixture Level Spurious ADS-4 with Failed CMTs | 41A-144 |
| 41A-208 | Case 3D-1: Hydrogen Generated In-Vessel Spurious ADS-4 with Failed CMTs | 41A-144 |
| 41A-209 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs | 41A-145 |
| 41A-210 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs | 41A-145 |
| 41A-211 | Case 3D-1: Containment Compartments Water Level Spurious ADS-4 with Failed CMTs | 41A-146 |
| 41A-212 | Case 3D-1: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs | 41A-146 |
| 41A-213 | Case 3D-1: Well-Mixed Compartment Steam Concentration Spurious ADS-4 with Failed CMTs | 41A-147 |
| 41A-214 | Case 3D-1: Well-Mixed Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs | 41A-147 |
| 41A-215 | Case 3D-1: Confined Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs | 41A-148 |
| 41A-216 | Case 3D-1: Confined Compartment Steam Concentration Spurious ADS-4 with Failed CMTs | 41A-148 |
| 41A-217 | Case 3D-1: Confined Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs | 41A-149 |
| 41A-218 | Case 3D-1: Equivalence Ratio in SG Room Spurious ADS-4 with Failed CMTs | 41A-149 |
| 41A-219 | Case 3D-1: Equivalence Ratio in CMT Room Spurious ADS-4 with Failed CMTs | 41A-150 |
| 41A-220 | Case 3D-1: Equivalence Ratio in IRWST Spurious ADS-4 with Failed CMTs | 41A-150 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-221 | Case 3D-1: Equivalence Ratio in PXS Spurious ADS-4 with Failed CMTs | 41A-151 |
| 41A-222 | Case 3D-2: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs | 41A-151 |
| 41A-223 | Case 3D-2: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-224 | Case 3D-2: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-225 | Case 3D-2: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-226 | Case 3D-2: Containment Pressure Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-227 | Case 3D-2: Containment Gas Temperature Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-228 | Case 3D-2: Containment Compartments Water Level Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-229 | Case 3D-2: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-230 | Case 3D-2: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-231 | Case 3D-2: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-232 | Case 3D-2: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-233 | Case 3D-2: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-234 | Case 3D-2: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-235 | Case 3D-2: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-236 | Case 3D-2: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-237 | Case 3D-2: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs | 41A-159 |
| 41A-238 | Case 3D-2: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs..... | 41A-159 |
| 41A-239 | Case 3D-3: Reactor Coolant System Pressure DVI Line Break with no ADS | 41A-160 |
| 41A-240 | Case 3D-3: Core-Exit Gas Temperature DVI Line Break with no ADS | 41A-160 |
| 41A-241 | Case 3D-3: Reactor Vessel Mixture Level DVI Line Break with no ADS | 41A-161 |
| 41A-242 | Case 3D-3: Hydrogen Generated In-Vessel DVI Line Break with no ADS | 41A-161 |
| 41A-243 | Case 3D-3: Containment Pressure DVI Line Break with no ADS | 41A-162 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-244 | Case 3D-3: Containment Gas Temperature DVI Line Break with no ADS | 41A-162 |
| 41A-245 | Case 3D-3: Containment Compartments Water Level DVI Line Break with no ADS | 41A-163 |
| 41A-246 | Case 3D-3: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with no ADS | 41A-163 |
| 41A-247 | Case 3D-3: Well-Mixed Compartment Steam Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-248 | Case 3D-3: Well-Mixed Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-249 | Case 3D-3: Confined Compartment Hydrogen Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-250 | Case 3D-3: Confined Compartment Steam Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-251 | Case 3D-3: Confined Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-166 |
| 41A-252 | Case 3D-3: Equivalence Ratio in SG Room DVI Line Break with no ADS | 41A-166 |
| 41A-253 | Case 3D-3: Equivalence Ratio in CMT Room DVI Line Break with no ADS | 41A-167 |
| 41A-254 | Case 3D-3: Equivalence Ratio in IRWST DVI Line Break with no ADS | 41A-167 |
| 41A-255 | Case 3D-3: Equivalence Ratio in PXS DVI Line Break with no ADS..... | 41A-168 |
| 41A-256 | Case 3D-5: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-168 |
| 41A-257 | Case 3D-5: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-258 | Case 3D-5: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-259 | Case 3D-5: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-260 | Case 3D-5: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-261 | Case 3D-5: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-262 | Case 3D-5: Containment Compartments Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-263 | Case 3D-5: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-264 | Case 3D-5: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-265 | Case 3D-5: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-266 | Case 3D-5: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |
| 41A-267 | Case 3D-5: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-268 | Case 3D-5: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-269 | Case 3D-5: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-270 | Case 3D-5: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-271 | Case 3D-5: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-272 | Case 3D-5: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-273 | Case 1A-3: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-274 | Case 1A-3: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-275 | Case 1A-3: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-276 | Case 1A-3: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-277 | Case 1A-3: Containment Pressure FW Failure with Creep of SG Tubes | 41A-179 |
| 41A-278 | Case 1A-3: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-179 |
| 41A-279 | Case 1A-3: Containment Compartments Water Level FW Failure with Creep of SG Tubes..... | 41A-180 |
| 41A-280 | Case 1A-3: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-180 |
| 41A-281 | Case 1A-3: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-282 | Case 1A-3: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-283 | Case 1A-3: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-284 | Case 1A-3: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-285 | Case 1A-3: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-286 | Case 1A-3: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-287 | Case 1A-3: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-184 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-288 | Case 1A-3: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-184 |
| 41A-289 | Case 1A-3: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-185 |
| 41A-290 | Case 1A-3a: Reactor Coolant System Pressure Transient with Creep of SG Tubes | 41A-185 |
| 41A-291 | Case 1A-3a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-292 | Case 1A-3a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-293 | Case 1A-3a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-294 | Case 1A-3a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-295 | Case 1A-3a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-296 | Case 1A-3a: Containment Compartments Water Level Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-297 | Case 1A-3a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-189 |
| 41A-298 | Case 1A-3a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-189 |
| 41A-299 | Case 1A-3a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-190 |
| 41A-300 | Case 1A-3a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-190 |
| 41A-301 | Case 1A-3a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-302 | Case 1A-3a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-303 | Case 1A-3a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes..... | 41A-192 |
| 41A-304 | Case 1A-3a: Approximate Detonation Cell Width in CMT Room Transient with Creep of SG Tubes..... | 41A-192 |
| 41A-305 | Case 1A-3a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-193 |
| 41A-306 | Case 1A-3a: Approximate Detonation Cell Width in PXS Transient with Creep of SG Tubes..... | 41A-193 |
| 41A-307 | Case 1A-4: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes | 41A-194 |
| 41A-308 | Case 1A-4: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-194 |
| 41A-309 | Case 1A-4: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-195 |
| 41A-310 | Case 1A-4: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-195 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-311 | Case 1A-4: Containment Pressure FW Failure with Creep of SG Tubes | 41A-196 |
| 41A-312 | Case 1A-4: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-196 |
| 41A-313 | Case 1A-4: Containment Compartments Water Level FW Failure with Creep of SG Tubes..... | 41A-197 |
| 41A-314 | Case 1A-4: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-197 |
| 41A-315 | Case 1A-4: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-316 | Case 1A-4: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-317 | Case 1A-4: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-318 | Case 1A-4: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-319 | Case 1A-4: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-320 | Case 1A-4: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-321 | Case 1A-4: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-201 |
| 41A-322 | Case 1A-4: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-201 |
| 41A-323 | Case 1A-4: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-202 |
| 41A-324 | Case 1A-4a: Reactor Coolant System Pressure Transient with Creep of SG Tubes..... | 41A-202 |
| 41A-325 | Case 1A-4a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-326 | Case 1A-4a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-327 | Case 1A-4a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-328 | Case 1A-4a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-329 | Case 1A-4a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-205 |
| 41A-330 | Case 1A-4a: Containment Compartments Water Level Transient with Creep of SG Tubes..... | 41A-205 |
| 41A-331 | Case 1A-4a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-332 | Case 1A-4a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-333 | Case 1A-4a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-207 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-334 | Case 1A-4a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-207 |
| 41A-335 | Case 1A-4a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-336 | Case 1A-4a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-337 | Case 1A-4a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-338 | Case 1A-4a: Equivalence Ratio in CMT Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-339 | Case 1A-4a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-340 | Case 1A-4a: Equivalence Ratio in PXS Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-341 | Case 1AP-3: Reactor Coolant System Pressure SBLOCA, Failed PRHR and CMTs | 41A-211 |
| 41A-342 | Case 1AP-3: Core-Exit Gas Temperature SBLOCA, Failed PRHR and CMTs | 41A-211 |
| 41A-343 | Case 1AP-3: Reactor Vessel Mixture Level SBLOCA, Failed PRHR and CMTs | 41A-212 |
| 41A-344 | Case 1AP-3: Hydrogen Generated In-Vessel SBLOCA, Failed PRHR and CMTs | 41A-212 |
| 41A-345 | Case 1AP-3: Containment Pressure SBLOCA, Failed PRHR and CMTs..... | 41A-213 |
| 41A-346 | Case 1AP-3: Containment Gas Temperature SBLOCA, Failed PRHR and CMTs | 41A-213 |
| 41A-347 | Case 1AP-3: Containment Compartments Water Level SBLOCA, Failed PRHR and CMTs..... | 41A-214 |
| 41A-348 | Case 1AP-3: Well-Mixed Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs | 41A-214 |
| 41A-349 | Case 1AP-3: Well-Mixed Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs | 41A-215 |
| 41A-350 | Case 1AP-3: Well-Mixed Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs | 41A-215 |
| 41A-351 | Case 1AP-3: Confined Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs | 41A-216 |
| 41A-352 | Case 1AP-3: Confined Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs | 41A-216 |
| 41A-353 | Case 1AP-3: Confined Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs | 41A-217 |
| 41A-354 | Case 1AP-3: Equivalence Ratio in SG Room SBLOCA, Failed PRHR and CMTs | 41A-217 |
| 41A-355 | Case 1AP-3: Equivalence Ratio in CMT Room SBLOCA, Failed PRHR and CMTs | 41A-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-356 | Case 1AP-3: Equivalence Ratio in IRWST SBLOCA, Failed PRHR and CMTs | 41A-218 |
| 41A-357 | Case 1AP-3: Equivalence Ratio in PXS SBLOCA, Failed PRHR and CMTs | 41A-219 |
| 41A-358 | Case 1AP-4: Reactor Coolant System Pressure SBLOCA with Failed PRHR and ADS | 41A-219 |
| 41A-359 | Case 1AP-4: Core-Exit Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-360 | Case 1AP-4: Reactor Vessel Mixture Level SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-361 | Case 1AP-4: Hydrogen Generated In-Vessel SBLOCA with Failed PRHR and ADS..... | 41A-221 |
| 41A-362 | Case 1AP-4: Containment Pressure SBLOCA with Failed PRHR and ADS | 41A-221 |
| 41A-363 | Case 1AP-4: Containment Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-222 |
| 41A-364 | Case 1AP-4: Containment Compartments Water Level SBLOCA with Failed PRHR and ADS | 41A-222 |
| 41A-365 | Case 1AP-4: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-366 | Case 1AP-4: Well-Mixed Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-367 | Case 1AP-4: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-368 | Case 1AP-4: Confined Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-369 | Case 1AP-4: Confined Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-370 | Case 1AP-4: Confined Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-371 | Case 1AP-4: Equivalence Ratio in SG Room SBLOCA with Failed PRHR and ADS..... | 41A-226 |
| 41A-372 | Case 1AP-4: Equivalence Ratio in CMT Room SBLOCA with Failed PRHR and ADS | 41A-226 |
| 41A-373 | Case 1AP-4: Equivalence Ratio in IRWST SBLOCA with Failed PRHR and ADS..... | 41A-227 |
| 41A-374 | Case 1AP-4: Equivalence Ratio in PXS SBLOCA with Failed PRHR and ADS | 41A-227 |
| 41B-1 | Case 3BR – LLOCA with Accumulator Failure Reactor Coolant System Pressure..... | 41B-3 |
| 41B-2 | Case 3BR – LLOCA with Accumulator Failure Reactor Vessel Mixture Level..... | 41B-3 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41B-3 | Case 3BR – LLOCA with Accumulator Failure Core-Exit Gas Temperature..... | 41B-4 |
| 41B-4 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Generated In-Vessel | 41B-4 |
| 41B-5 | Case 3BR – LLOCA with Accumulator Failure Containment Pressure..... | 41B-5 |
| 41B-6 | Case 3BR – LLOCA with Accumulator Failure Containment Gas Temperature | 41B-5 |
| 41B-7 | Case 3BR – LLOCA with Accumulator Failure Containment Compartment Hydrogen Concentration..... | 41B-6 |
| 41B-8 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through Break | 41B-6 |
| 41B-9 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Hydrogen Concentration..... | 41B-7 |
| 41B-10 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Oxygen Concentration..... | 41B-7 |
| 41B-11 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Steam Concentration..... | 41B-8 |
| 41B-12 | Case 3BR – LLOCA with Accumulator Failure Approximate Detonation Cell Width in Steam Generator Compartment..... | 41B-8 |
| 41B-13 | Case 3BR – LLOCA with Accumulator Failure Containment Compartments Water Level..... | 41B-9 |
| 41B-14 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through ADS to IRWST | 41B-9 |
| 41B-15 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Hydrogen Concentration..... | 41B-10 |
| 41B-16 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Oxygen Concentration..... | 41B-10 |
| 41B-17 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Steam Concentration..... | 41B-11 |
| 42-1 | AP1000 Containment Fragility at Containment Temperature of 400°F | 42-12 |
| 42-2 | AP1000 Containment Fragility at Containment Temperature of 331°F | 42-13 |
| 43-1 | Plant Damage State Contributions to CDF..... | 43-119 |
| 43-2 | Containment Event Tree – CET (Sheets 1 – 3) | 43-120 |
| 43-3 | 3BE CET (Sheets 1 – 3)..... | 43-123 |
| 43-4 | 3BL CET (Sheets 1 – 3)..... | 43-126 |
| 43-5 | 3BR CET (Sheets 1 – 3)..... | 43-129 |
| 43-6 | 1A CET (Sheets 1 – 3)..... | 43-132 |
| 43-7 | 1AP CET (Sheets 1 – 3)..... | 43-135 |
| 43-8 | 3A CET (Sheets 1 – 3)..... | 43-138 |
| 43-9 | 3C CET (Sheets 1 – 3) | 43-141 |
| 43-10 | 3D CET (Sheets 1 – 3)..... | 43-144 |
| 43-11 | 6 CET (Sheets 1 – 3)..... | 43-147 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 43-12 | Contribution of PDS to LRF | 43-150 |
| 43-13 | Summary of CET Quantification (Sheets 1 – 2)..... | 43-151 |
| 44-1 | MAAP4 AP1000 Containment Nodalization | 44-12 |
| 45-1 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-7 |
| 45-2 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-7 |
| 45-3 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide | 45-8 |
| 45-4 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide | 45-8 |
| 45-5 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-9 |
| 45-6 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-9 |
| 45-7 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide | 45-10 |
| 45-8 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide | 45-10 |
| 45-9 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide | 45-11 |
| 45-10 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tin | 45-11 |
| 45-11 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium..... | 45-12 |
| 45-12 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide | 45-12 |
| 45-13 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Noble Gases..... | 45-13 |
| 45-14 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Iodide..... | 45-13 |
| 45-15 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium Dioxide | 45-14 |
| 45-16 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Strontium Oxide | 45-14 |
| 45-17 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Molybdenum Dioxide..... | 45-15 |
| 45-18 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Hydroxide..... | 45-15 |
| 45-19 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Barium Oxide | 45-16 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-20 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Dilanthanum Trioxide | 45-16 |
| 45-21 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cerium Dioxide | 45-17 |
| 45-22 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tin | 45-17 |
| 45-23 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium | 45-18 |
| 45-24 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Uranium Dioxide | 45-18 |
| 45-25 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Noble Gases | 45-19 |
| 45-26 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Iodide | 45-19 |
| 45-27 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium Dioxide | 45-20 |
| 45-28 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Strontium Oxide | 45-20 |
| 45-29 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Molybdenum Dioxide | 45-21 |
| 45-30 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Hydroxide | 45-21 |
| 45-31 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Barium Oxide | 45-22 |
| 45-32 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Dilanthanum Trioxide | 45-22 |
| 45-33 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cerium Dioxide | 45-23 |
| 45-34 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tin | 45-23 |
| 45-35 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium | 45-24 |
| 45-36 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Uranium Dioxide | 45-24 |
| 45-37 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Noble Gases | 45-25 |
| 45-38 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Iodide | 45-25 |
| 45-39 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium Dioxide | 45-26 |
| 45-40 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Strontium Oxide | 45-26 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-41 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Molybdenum Dioxide..... | 45-27 |
| 45-42 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Hydroxide..... | 45-27 |
| 45-43 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Barium Oxide | 45-28 |
| 45-44 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Dilanthanum Trioxide | 45-28 |
| 45-45 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cerium Dioxide | 45-29 |
| 45-46 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tin | 45-29 |
| 45-47 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium..... | 45-30 |
| 45-48 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Uranium Dioxide..... | 45-30 |
| 45-49 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Noble Gases | 45-31 |
| 45-50 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Iodide | 45-31 |
| 45-51 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium Dioxide..... | 45-32 |
| 45-52 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Strontium Oxide..... | 45-32 |
| 45-53 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Molybdenum Dioxide | 45-33 |
| 45-54 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Hydroxide | 45-33 |
| 45-55 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Barium Oxide..... | 45-34 |
| 45-56 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Dilanthanum Trioxide..... | 45-34 |
| 45-57 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cerium Dioxide..... | 45-35 |
| 45-58 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tin..... | 45-35 |
| 45-59 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium | 45-36 |
| 45-60 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Uranium Dioxide | 45-36 |
| 45-61 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-62 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-37 |
| 45-63 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide | 45-38 |
| 45-64 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide | 45-38 |
| 45-65 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-39 |
| 45-66 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-39 |
| 45-67 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide | 45-40 |
| 45-68 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide | 45-40 |
| 45-69 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide | 45-41 |
| 45-70 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tin | 45-41 |
| 45-71 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium..... | 45-42 |
| 45-72 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide..... | 45-42 |
| 45-73 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Noble Gases..... | 45-43 |
| 45-74 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Iodide..... | 45-43 |
| 45-75 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium Dioxide | 45-44 |
| 45-76 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Strontium Oxide | 45-44 |
| 45-77 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Molybdenum Dioxide..... | 45-45 |
| 45-78 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Hydroxide..... | 45-45 |
| 45-79 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Barium Oxide | 45-46 |
| 45-80 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Dilanthanum Trioxide | 45-46 |
| 45-81 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cerium Dioxide | 45-47 |
| 45-82 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tin | 45-47 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-83 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium..... | 45-48 |
| 45-84 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Uranium Dioxide..... | 45-48 |
| 45A-1 | AP1000 Fission Product Release Fractions for Release Category CFE – Noble Gases | 45A-3 |
| 45A-2 | AP1000 Fission Product Release Fractions for Release Category CFE – CsI and RbI | 45A-3 |
| 45A-3 | AP1000 Fission Product Release Fractions for Release Category CFE – TeO ₂ | 45A-4 |
| 45A-4 | AP1000 Fission Product Release Fractions for Release Category CFE – SrO | 45A-4 |
| 45A-5 | AP1000 Fission Product Release Fractions for Release Category CFE – MoO ₂ | 45A-5 |
| 45A-6 | AP1000 Fission Product Release Fractions for Release Category CFE – CsOH and RbOH | 45A-5 |
| 45A-7 | AP1000 Fission Product Release Fractions for Release Category CFE – BaO | 45A-6 |
| 45A-8 | AP1000 Fission Product Release Fractions for Release Category CFE – La ₂ O ₃ | 45A-6 |
| 45A-9 | AP1000 Fission Product Release Fractions for Release Category CFE – CeO ₂ | 45A-7 |
| 45A-10 | AP1000 Fission Product Release Fractions for Release Category CFE – Sb | 45A-7 |
| 45A-11 | AP1000 Fission Product Release Fractions for Release Category CFE – Te ₂ | 45A-8 |
| 45A-12 | AP1000 Fission Product Release Fractions for Release Category CFE – UO ₂ | 45A-8 |
| 45A-13 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – RCS Pressure | 45A-9 |
| 45A-14 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Reactor Vessel Mixture Level | 45A-9 |
| 45A-15 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Core-Exit Temperature..... | 45A-10 |
| 45A-16 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – In-Vessel Hydrogen Generation | 45A-10 |
| 45A-17 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Pressure..... | 45A-11 |
| 45A-18 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Gas Temperature..... | 45A-11 |
| 45A-19 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Hydrogen Concentration..... | 45A-12 |
| 45A-20 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Noble Gases Release Fraction | 45A-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45A-21 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsI and RbI Release Fraction..... | 45A-13 |
| 45A-22 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – TeO ₂ Release Fraction..... | 45A-13 |
| 45A-23 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – SrO Release Fraction..... | 45A-14 |
| 45A-24 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – MoO ₂ Release Fraction | 45A-14 |
| 45A-25 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsOH and RbOH Release Fraction..... | 45A-15 |
| 45A-26 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – BaO Release Fraction..... | 45A-15 |
| 45A-27 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – La ₂ O ₃ Release Fraction | 45A-16 |
| 45A-28 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CeO ₂ Release Fraction | 45A-16 |
| 45A-29 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Sb Release Fraction..... | 45A-17 |
| 45A-30 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Te ₂ Release Fraction..... | 45A-17 |
| 45A-31 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – UO ₂ Release Fraction..... | 45A-18 |
| 45A-32 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Containment Pressure | 45A-18 |
| 45A-33 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Noble Gases Release Fraction..... | 45A-19 |
| 45A-34 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsI and RbI Release Fraction..... | 45A-19 |
| 45A-35 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – TeO ₂ Release Fraction..... | 45A-20 |
| 45A-36 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – SrO Release Fraction | 45A-20 |
| 45A-37 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – MoO ₂ Release Fraction | 45A-21 |
| 45A-38 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsOH and RbOH Release Fraction..... | 45A-21 |
| 45A-39 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – BaO Release Fraction..... | 45A-22 |
| 45A-40 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – La ₂ O ₃ Release Fraction | 45A-22 |
| 45A-41 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CeO ₂ Release Fraction | 45A-23 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45A-42 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Sb Release Fraction..... | 45A-23 |
| 45A-43 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Te ₂ Release Fraction | 45A-24 |
| 45A-44 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – UO ₂ Release Fraction..... | 45A-24 |
| 49-1 | Population Whole Body Dose – BP Source Term, 24 Hours | 49-20 |
| 49-2 | Population Whole Body Dose – BP Source Term 72 Hours | 49-20 |
| 49-3 | Site Boundary Whole Body Dose – BP Source Term, 24 Hours..... | 49-21 |
| 49-4 | Site Boundary Whole Body Dose – BP Source Term, 72 Hours..... | 49-21 |
| 49-5 | Site Boundary Red Bone Marrow Dose – BP Source Term, 24 Hours | 49-22 |
| 49-6 | Site Boundary Red Bone Marrow Dose – BP Source Term, 72 Hours | 49-22 |
| 49-7 | Site Boundary Thyroid Dose – BP Source Term, 24 Hours..... | 49-23 |
| 49-8 | Site Boundary Thyroid Dose – BP Source Term, 72 Hours..... | 49-23 |
| 49-9 | Population Whole Body Dose – CFE Source Term, 24 Hours..... | 49-24 |
| 49-10 | Population Whole Body Dose – CFE Source Term, 72 Hours..... | 49-24 |
| 49-11 | Site Boundary Whole Body Dose – CFE Source Term, 24 Hours | 49-25 |
| 49-12 | Site Boundary Whole Body Dose – CFE Source Term, 72 Hours | 49-25 |
| 49-13 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 24 Hours..... | 49-26 |
| 49-14 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 72 Hours..... | 49-26 |
| 49-15 | Site Boundary Thyroid Dose – CFE Source Term, 24 Hours..... | 49-27 |
| 49-16 | Site Boundary Thyroid Dose – CFE Source Term, 72 Hours..... | 49-27 |
| 49-17 | Population Whole Body Dose – CFI Source Term, 24 Hours..... | 49-28 |
| 49-18 | Population Whole Body Dose – CFI Source Term, 72 Hours..... | 49-28 |
| 49-19 | Site Boundary Whole Body Dose – CFI Source Term, 24 Hours | 49-29 |
| 49-20 | Site Boundary Whole Body Dose – CFI Source Term, 72 Hours | 49-29 |
| 49-21 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 24 Hours..... | 49-30 |
| 49-22 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 72 Hours..... | 49-30 |
| 49-23 | Site Boundary Thyroid Dose – CFI Source Term, 24 Hours..... | 49-31 |
| 49-24 | Site Boundary Thyroid Dose – CFI Source Term, 72 Hours..... | 49-31 |
| 49-25 | Population Whole Body Dose – CFL Source Term, 24 Hours..... | 49-32 |
| 49-26 | Population Whole Body Dose – CFL Source Term, 72 Hours..... | 49-32 |
| 49-27 | Site Boundary Whole Body Dose – CFL Source Term, 24 Hours | 49-33 |
| 49-28 | Site Boundary Whole Body Dose – CFL Source Term, 72 Hours | 49-33 |
| 49-29 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 24 Hours..... | 49-34 |
| 49-30 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 72 Hours..... | 49-34 |
| 49-31 | Site Boundary Thyroid Dose – CFL Source Term, 24 Hours..... | 49-35 |
| 49-32 | Site Boundary Thyroid Dose – CFL Source Term, 72 Hours..... | 49-35 |
| 49-33 | Population Whole Body Dose – CI Source Term, 24 Hours | 49-36 |
| 49-34 | Population Whole Body Dose – CI Source Term, 72 Hours | 49-36 |
| 49-35 | Site Boundary Whole Body Dose – CI Source Term, 24 Hours..... | 49-37 |
| 49-36 | Site Boundary Whole Body Dose – CI Source Term, 72 Hours..... | 49-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 49-37 | Site Boundary Red Bone Marrow Dose – CI Source Term, 24 Hours | 49-38 |
| 49-38 | Site Boundary Red Bone Marrow Dose – CI Source Term, 72 Hours | 49-38 |
| 49-39 | Site Boundary Thyroid Dose – CI Source Term, 24 Hours | 49-39 |
| 49-40 | Site Boundary Thyroid Dose – CI Source Term, 72 Hours | 49-39 |
| 49-41 | Population Whole Body Dose – DIRECT Source Term, 24 Hours | 49-40 |
| 49-42 | Population Whole Body Dose – DIRECT Source Term, 72 Hours | 49-40 |
| 49-43 | Site Boundary Whole Body Dose – DIRECT Source Term, 24 Hours | 49-41 |
| 49-44 | Site Boundary Whole Body Dose – DIRECT Source Term, 72 Hours | 49-41 |
| 49-45 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 24 Hours | 49-42 |
| 49-46 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 72 Hours | 49-42 |
| 49-47 | Site Boundary Thyroid Dose – DIRECT Source Term, 24 Hours | 49-43 |
| 49-48 | Site Boundary Thyroid Dose – DIRECT Source Term, 72 Hours | 49-43 |
| 49-49 | Population Whole Body Dose – IC Source Term, 24 Hours | 49-44 |
| 49-50 | Population Whole Body Dose – IC Source Term, 72 Hours | 49-44 |
| 49-51 | Site Boundary Whole Body Dose – IC Source Term, 24 Hours | 49-45 |
| 49-52 | Site Boundary Whole Body Dose – IC Source Term, 72 Hours | 49-45 |
| 49-53 | Site Boundary Red Bone Marrow Dose – IC Source Term, 24 Hours | 49-46 |
| 49-54 | Site Boundary Red Bone Marrow Dose – IC Source Term, 72 Hours | 49-46 |
| 49-55 | Site Boundary Thyroid Dose – IC Source Term, 24 Hours | 49-47 |
| 49-56 | Site Boundary Thyroid Dose – IC Source Term, 72 Hours | 49-47 |
| 49-57 | Overall Dose Risk – Site Boundary Whole Body EDE Dose, 24 Hours | 49-48 |
| 49-58 | Overall Dose Risk – Site Boundary Red Bone Marrow Dose (Acute), 24 Hours | 49-49 |
| 51-1 | AP1000 Base Core Damage Frequency Uncertainty Analysis | 51-11 |
| 51-2 | AP1000 Sensitivity Case Uncertainty Analysis | 51-11 |
| 51B-1 | Distribution for Plant Core Damage Frequency | 51B-2 |
| 51B-2 | Safety Injection Line Break | 51B-2 |
| 51B-3 | Large LOCA | 51B-3 |
| 51B-4 | Large Spurious ADS Actuation | 51B-3 |
| 51B-5 | Small LOCA | 51B-4 |
| 51B-6 | Medium LOCA | 51B-4 |
| 51B-7 | Reactor Vessel Rupture | 51B-5 |
| 51B-8 | Steam Generator Tube Rupture | 51B-5 |
| 51B-9 | Safety Injection Line Break – Sequence 7 | 51B-6 |
| 51B-10 | Large LOCA – Sequence 9 | 51B-6 |
| 51B-11 | Spurious ADS – Sequence 8 | 51B-7 |
| 51B-12 | Safety Injection Line Break – Sequence 8d | 51B-7 |
| 51B-13 | Reactor Vessel Rupture – Sequence 2 | 51B-8 |
| 51B-14 | Small LOCA – Sequence 5 | 51B-8 |
| 51B-15 | Medium LOCA – Sequence 5 | 51B-9 |
| 51B-16 | Small LOCA – Sequence 12 | 51B-9 |
| 51B-17 | Medium LOCA – Sequence 12 | 51B-10 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 51B-18 | Spurious ADS – Sequence 9 | 51B-10 |
| 51B-19 | Spurious ADS – Sequence 7 | 51B-11 |
| 51B-20 | Safety Injection Line Break – Sequence 3..... | 51B-11 |
| 51B-21 | SGTR Event – Sequence 41 | 51B-12 |
| 51B-22 | ATWS Precursor with no MFW – Sequence 23 | 51B-12 |
| 51B-23 | Small LOCA – Sequence 9 | 51B-13 |
| 51B-24 | Medium LOCA – Sequence 9 | 51B-13 |
| 51B-25 | SGTR Event – Sequence 13..... | 51B-14 |
| 51B-26 | Large LOCA – Sequence 8 | 51B-14 |
| 51B-27 | CMT Line Break – Sequence 5 | 51B-15 |
| 54-1 | Loss of Offsite Power During Hot/Cold Shutdown (RCS Filled) Event Tree (Sheets 1 – 2)..... | 54-162 |
| 54-2 | Loss of RNS During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-164 |
| 54-3 | Loss of CCW/SW During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-165 |
| 54-4 | LOCA/RNS-V024 Opens During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-166 |
| 54-5 | LOCA/RNS Pipe Rupture During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-167 |
| 54-6 | Overdraining of Reactor Coolant System During Drindown to Mid-loop Event Tree | 54-168 |
| 54-7 | Loss of Offsite Power During RCS Drained Condition Event Tree | 54-169 |
| 54-8 | Loss of RNS During RCS Drained Condition Event Tree | 54-170 |
| 54-9 | Loss of CCW/SW During RCS Drained Condition Event Tree..... | 54-171 |
| 54-10 | LOCA/RNS-V024 Opens During RCS Drained Condition Event Tree..... | 54-172 |
| 55-1 | Seismic Initiating Event Hierarchy Tree | 55-30 |
| 57-1 | Example Event Tree Model..... | 57-125 |
| 57-2 | Contribution of Plant Areas to Fire CDF | 57-126 |
| 57-3 | Contribution of Fire Area to Fire CDF..... | 57-127 |
| 57A-1 | DAS-ACT Fault Tree | 57A-37 |
| 57C-1 | 0000 AF 00 Yard Building (Including Transformer Yard) | 57C-12 |
| 57C-2 | 1200 AF 01 RCA of Auxiliary Building (All Zones)..... | 57C-13 |
| 57C-3 | 1200 AF 02 New Fuel and Used Fuel Storage, Waste Disposal Container (All Zones)..... | 57C-14 |
| 57C-4 | 1200 AF 03 Corridors 100' & 117' 6" | 57C-15 |
| 57C-5 | 1201 AF 02 Division B Batteries/DC Equipment Room/Instrumentation and Control..... | 57C-16 |
| 57C-6 | 1201 AF 03 Division D DC Equipment/I&C..... | 57C-17 |
| 57C-7 | 1201 AF 04 Division B/D VBS Equipment..... | 57C-18 |
| 57C-8 | 1201 AF 05 MSIV Compartment A..... | 57C-19 |
| 57C-9 | 1201 AF 06 MSIV Compartment B | 57C-20 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 57C-10 | 1202 AF 02 Northeast Elevator Shaft | 57C-21 |
| 57C-11 | 1202 AF 03 Division C Batteries/DC Equipment/I&C Room/ RCP Trip Switchgear Room/I&C Penetration Room | 57C-22 |
| 57C-12 | 1202 AF 04 Division A Electrical Equipment/Battery Room/I&C Room..... | 57C-23 |
| 57C-13 | 1204 AF 01 RNS Pump Room B | 57C-24 |
| 57C-14 | 1204 AF 03 South Shield Building Elevator Shaft | 57C-25 |
| 57C-15 | 1205 AF 02 Southeast Elevator Shaft | 57C-26 |
| 57C-16 | 1210 AF 01 Corridor/Spare Battery Room/Spare Room/Spare Battery Charger Room | 57C-27 |
| 57C-17 | 1220 AF 01 Division B RCP Trip Switchgear/Spare Room/Corridor 82' 6" | 57C-28 |
| 57C-18 | 1220 AF 02 Lower Annulus Valve Area..... | 57C-29 |
| 57C-19 | 1230 AF 01 Corridor Division A, B, C, D and Remote Shutdown Workstation..... | 57C-30 |
| 57C-20 | 1230 AF 02 Non-Class 1E Electrical Compartment - 100' | 57C-31 |
| 57C-21 | 1232 AF 01 Remote Shutdown Workstation..... | 57C-32 |
| 57C-22 | 1240 AF 01 Non-Class 1E Electrical Compartment - 117' | 57C-33 |
| 57C-23 | 1242 AF 02 Division A Penetration Area | 57C-34 |
| 57C-24 | 1243 AF 01 Reactor Trip Switchgear I | 57C-35 |
| 57C-25 | 1243 AF 02 Reactor Trip Switchgear II..... | 57C-36 |
| 57C-26 | 1250 AF 01 Nonradioactive Ventilation System..... | 57C-37 |
| 57C-27 | 2000 AF 01 Turbine Building Floor | 57C-38 |
| 57C-28 | 2003 AF 01 Auxiliary Boiler Equipment Room | 57C-39 |
| 57C-29 | 2009 AF 02 Elevator Machine Room..... | 57C-40 |
| 57C-30 | 2033 AF 02 Motor-Driven Fire Pump Room..... | 57C-41 |
| 57C-31 | 2040 AF 01 Clean and Dirty Lube Oil Storage..... | 57C-42 |
| 57C-32 | 2043 AF 01 Chemical Laboratory..... | 57C-43 |
| 57C-33 | 2050 AF 01 Lube Oil Conditioner Room..... | 57C-44 |
| 57C-34 | 2052 AF 01 Southwest 6.9KV Switchgear Room..... | 57C-45 |
| 57C-35 | 2053 AF 01 Electrical Equipment Room | 57C-46 |
| 57C-36 | 2053 AF 02 Northwest 6.9KV Switchgear Room..... | 57C-47 |
| 57C-37 | 4003 AF 01 Demineralized Water Deoxygenating Room/ Air Handling Equipment Rooms..... | 57C-48 |
| 57C-38 | 4031 AF 01 Battery Room and Battery Charger Room 1..... | 57C-49 |
| 57C-39 | 4031 AF 02 Battery Room and Battery Charger Room 2/ Computer Room B/Shift Turnover Room | 57C-50 |
| 57C-40 | 4031 AF 05 Corridor/Spare Battery Room/Spare Room/ Spare Battery Charger Room..... | 57C-51 |
| 57C-41 | 4031 AF 06 Central Alarm Station/Security Room 1..... | 57C-52 |
| 57C-42 | 4032 AF 01 Decontamination Room, Non-Radiological and Radiological Controlled Area Entry/Exit Area..... | 57C-53 |
| 57C-43 | 4032 AF 02 Containment Access Corridor Elevation 107' 2" | 57C-54 |
| 57C-44 | 4033 AF 01 Hot Machine Shop | 57C-55 |
| 57C-45 | 4034 AF 01 General Offices | 57C-56 |
| 57C-46 | 4041 AF 01 Conference Rooms/Computer Room A/Corridor..... | 57C-57 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 57C-47 | 4041 AF 02 Corridor/Restroom | 57C-58 |
| 57C-48 | 4042 AF 01 Non-Class 1E Switchgear #1..... | 57C-59 |
| 57C-49 | 4042 AF 02 Non-Class 1E Switchgear #2..... | 57C-60 |
| 57C-50 | 4052 AF 01 Staging and Storage Area/Containment Air Filtration Exhaust Rooms A & B..... | 57C-61 |
| 57C-51 | 5031 AF 01 Radwaste Building..... | 57C-62 |
| 57C-52 | 6030 AF 01 Diesel Generator Room A..... | 57C-63 |
| 57C-53 | 6030 AF 02 Diesel Generator Room B..... | 57C-64 |
| 57C-54 | 6030 AF 03 Fuel Oil Day Tank Room A..... | 57C-65 |
| 57C-55 | 6030 AF 04 Fuel Oil Day Take Room B..... | 57C-66 |
| 57C-56 | 1100 AF 11204 Reactor Coolant Drain Tank Room..... | 57C-67 |
| 57C-57 | 1100 AF 11206 Accumulator Room A..... | 57C-68 |
| 57C-58 | 1100 AF 11207 Accumulator Room B..... | 57C-69 |
| 57C-59 | 1100 AF 11208 RNS Valve Room..... | 57C-70 |
| 57C-60 | 1100 AF 11300A Maintenance Floor (SE Quadrant Access)..... | 57C-71 |
| 57C-61 | 1100 AF 11300B Maintenance Floor (NNE Quadrant) and RCDT Access..... | 57C-72 |
| 57C-62 | 1100 AF 11301 SG Compartment 1..... | 57C-73 |
| 57C-63 | 1100 AF 11302 SG Compartment 2..... | 57C-74 |
| 57C-64 | 1100 AF 11303 Pressurizer Compartment..... | 57C-75 |
| 57C-65 | 1100 AF 11303A ADS Lower Valve Area..... | 57C-76 |
| 57C-66 | 1100 AF 11303B ADS Upper Valve Area..... | 57C-77 |
| 57C-67 | 1100 AF 11500 Operating Deck..... | 57C-78 |
| 57C-68 | 1200 AF 12341 Middle Annulus..... | 57C-79 |
| 57C-69 | 1200 AF 12555 Main Control Room Emergency Habitability System Air Storage/Operating Deck Staging Area..... | 57C-80 |
| 59-1 | Contribution of Initiating Events to Core Damage..... | 59-99 |
| 59-2 | 24-Hour Site Boundary Dose Cumulative Frequency Distribution..... | 59-100 |

REVISION 1 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 1 Change Roadmap | ci through civ | Editorial |
| 1 | 1-6 | Editorial |
| 3 | 3-4 | Editorial |
| Attachment 4B | 4B-24 | 720.027 |
| Attachment 4B | 4B-74 | Editorial |
| 6 | 6-9 | 720.025 (720.029) |
| 6 | 6-12 | 720.025 (720.029) Editorial |
| 6 | 6-16 | Editorial |
| 6 | 6-17 | 720.026 |
| 6 | 6-19 through 6-53 | 720.023 (720.024) (720.097) |
| 6 | 6-62 | 720.031 |
| 6 | 6-69 | 720.025 (720.029) |
| 6 | 6-71 | 720.025 (720.029) |
| 8 | 8-23 and 8-25 | Editorial |
| 12 | 12-6 | 720.033 |
| 12 | 12-30 | 720.033 |
| 26 | 26-11 and 26-12 | Editorial |
| 28 | 28-10 and 28-11 | Editorial |
| 29 | 29-17 | 720.033 |
| 29 | 29-21 | 720.033 |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|---|
| 30 | 30-35 and 30-36 | 720.068 |
| 30 | 30-66 and 30-67 | 720.068 |
| 30 | 30-110 | Editorial |
| 34 | 34-1 | 720.042 |
| 34 | 34-4 and 34-5 | 720.042 |
| 34 | 34-6 and 34-7 | 720.042 |
| | | Editorial |
| 34 | 34-8 through 34-243 | 720.042 |
| 35 | 35-28 | 720.043 |
| 39 | 39-4 | 720.073 |
| | | Editorial |
| 39 | 39-5 | 720.088 |
| | | (720.048, 720.074, 720.083, 720.089) |
| 39 | 39-6 | 720.088 |
| | | 720.073 |
| | | (720.048, 720.074, 720.083, and 720.089) |
| 39 | 39-12 | Editorial |
| 39 | 39-19 | Editorial |
| 39 | 39-20 | 720.073 |
| 39 | 39-21 | Editorial |
| | | 720.088 |
| Attachment 39A | 39A-1 through 39A-40 | 720.088 |
| | | (720.048, 720.074, 720.083, and 720.089) |
| 41 | 41-6 | 720.042 |
| 41 | 41-15 | 720.093 |
| 41 | 41-20 | 720.054 |
| 41 | 41-31 | Editorial |
| Attachment 41A | 41A-1 through 41A-228 | 720.042 |
| Attachment 41B | 41B-1 through 41B-11 | 720.093 |
| 43 | 43-126 and 43-127 | Editorial |
| Attachment 43C | 43C-1 and 43C-2 | 720.043 |
| 44 | 44-7 | Editorial |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|----------------------|--|
| 45 | 45-1 through 45-3 | 470.013 (470.012) |
| 45 | 45-4 | 470.013 (470.012) Editorial |
| 45 | 45-5 through 45-48 | 470.013 (470.012) |
| 49 | 49-1 | 720.056 |
| 49 | 49-4 through 49-6 | 720.056 |
| 49 | 49-9 through 49-49 | 720.056 |
| 50 | 50-14 | 720.034 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 57 | 57-1 through 57-109 | Letter DCP/NRC1515 |
| Attachment 57A | 57A-1 through 57A-37 | Letter DCP/NRC1515 |
| Attachment 57B | 57B-1 through 57B-6 | Letter DCP/NRC1515 |
| Attachment 57C | 57C-1 through 57C-80 | Letter DCP/NRC1515 |
| Attachment 57D | 57D-1 through 57D-7 | Letter DCP/NRC1515 |
| 59 | 59-20 and 59-21 | Editorial |
| 59 | 59-23 through 59-25 | Letter DCP/NRC1515 |
| 59 | 59-26 | 720.056 |
| 59 | 59-28 | Editorial |
| 59 | 59-29 through 59-32 | 720.038 |
| 59 | 59-34 through 59-38 | 720.038 |
| 59 | 59-72 | Editorial |
| 59 | 59-73 | Technical |
| 59 | 59-83 | Editorial |
| 59 | 59-75 through 59-96 | 720.038 |
| 59 | 59-97 | 720.038 720.066 |
| 59 | 59-98 | 720.038 |
| 59 | 59-100 | Technical |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-------------------|-------------------------------------|
| Appendix A | A-1 through A-166 | 720.007 |
| | | 720.010 |
| | | 720.011 |
| | | 720.012 |
| | | 720.013 |
| | | 720.015 |
| | | 720.016 |
| Appendix B | B-6 | 720.058 |
| Appendix B | B-13 | 720.076 |
| Appendix D | D-14 and D-15 | 720.078 |
| Appendix D | D-31 | 720.078 |
| Appendix D | D-35 and D-36 | Technical |
| Appendix D | D-37 through D-58 | 720.078 |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number. RAI number in parenthesis contains a reference to RAI response listed above.

REVISION 2 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 2 Change Roadmap | cv through cvii | Editorial |
| 6 | 6-17 | 720.026 (R1) |
| 6 | 6-28 | 720.024 (R1) |
| 6 | 6-32 and 6-33 | 720.024 (R1) |
| 6 | 6-37 through 6-39 | 720.024 (R1) |
| 6 | 6-41 | 720.024 (R1) |
| 6 | 6-50 through 6-53 | 720.024 (R1) |
| 6 | 6-69 | 720.029 (R1) |
| 24 | 24-17 | 720.046 (R1) |
| 24 | 24-22 and 24-23 | 720.046 (R1) |
| 24 | 24-27 | 720.046 (R1) |
| 30 | 30-26a through 30-28 | 720.029 (R1) |
| 35 | 35-28 | 720.043 (R1) |
| 43 | 43-9 and 43-9a | 720.039 (R2) |
| 43 | 43-9b | Editorial |
| 43 | 43-10a | 720.039 (R2) |
| 43 | 43-10b | Editorial |
| 43 | 43-93a through 43-93w | 720.039 (R2) |
| 43 | 93-93x | Editorial |
| Attachment 43C | 43C-2 | 720.043 (R1) |
| 50 | 50-1 | |
| 50 | 50-1a and 50-1b | Editorial |
| 50 | 50-14 | 720.039 (R2) |
| 50 | 50-14a | 720.039 (R2) |
| 50 | 50-14b | Editorial |
| 54 | 54-1 through 54-131 | 720.038 (R2) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|-------------------------------------|
| 56 | 56-1 | 720.038 (R1) Editorial |
| 56 | 56-9 | Editorial |
| 56 | 56-17 and 56-18 | Editorial |
| 56 | 56-20 | Editorial |
| 56 | 56-36 and 56-37 | Editorial |
| 56 | 56-38 | Editorial 720.038 (R1) |
| 56 | 56-38a through 56-38k | 720.038 (R1) |
| 56 | 56-38l | Editorial |
| 56 | 56-47 through 56-49 | Editorial |
| 56 | 56-51 | Editorial |
| 56 | 56-54 and 56-55 | 720.038 (R1) |
| 57 | 57-14 and 57-15 | 280.011 (R1) |
| 57 | 57-15a and 57-15b | Editorial |
| 59 | 59-23 and 59-23a | 720.038 (R1) |
| 59 | 59-23b | Editorial |
| 59 | 59-34 | 720.038 (R1) |
| 59 | 59-72 | 720.038 (R1) |
| Appendix A | A-12 | Editorial |
| Appendix A | A-24 through A-26 | 440.014 (R1) |
| Appendix A | A-26a | 440.014 (R1) 720.024 (R1) |
| Appendix A | A-26b | Editorial |
| Appendix A | A-27 | 720.012 (R1) |
| Appendix A | A-31 | 720.012 (R1) |
| Appendix A | A-33 | 720.010 (R1) |
| Appendix A | A-33a and A-33b | Editorial |
| Appendix A | A-44 | Editorial |
| Appendix A | A-57 through A-61 | 720.012 (R1) |
| Appendix A | A-63 | 720.012 (R1) |
| Appendix A | A-66 | 720.012 (R1) |
| Appendix A | A-103a through A-103b | 440.014 (R1) |
| Appendix A | A-103c and A-103d | 720.012 (R1) |
| Appendix A | A-151 and A-152 | 720.013 (R1) |
| Appendix A | A-165 and A-166 | 720.013 (R1) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------|-------------------------------------|
| Appendix D | D-13 and D-14 | 720.080 (R1) |
| Appendix D | D-35 and D-36 | 720.080 (R1) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 3 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through cii | Editorial |
| Revision 3 Change Roadmap | cx | Editorial |
| Attachment 45A | 45A-1 through 45A-24 | Technical |
| 57 | 57-1 and 57-2 | Editorial |
| 57 | 57-4 | Editorial |
| 57 | 57-11 and 57-12 | Editorial |
| 57 | 57-17 | Editorial |
| 57 | 57-22 and 57-23 | Editorial |
| 57 | 57-30 through 57-39 | 720.038 (R1) |
| 57 | 57-40 | 720.038 (R1) |
| | | Editorial |
| 57 | 57-41 and 57-42 | 720.038 (R1) |
| 57 | 57-78 | Editorial |
| 57 | 57-117 through 57-124 | 720.038 (R1) |
| Appendix A | A-23 through A-25 | 720.009 (R2) |
| Appendix A | A-105 through A-111 | 720.009 (R2) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 4 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|---|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 4 Change Roadmap | cxii and cxiii | Editorial |
| 34 | 34-4 | Editorial |
| 34 | 34-16 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-19 through 34-21 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-50 and 34-51 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-247 through 34-264 | DSER OI 19.1.10.3-1 (R1) |
| 42 | 42-3 | DSER OI 19.2.6-1 (R1) |
| 42 | 42-6 | DSER OI 19.2.6-3 |
| 42 | 42-7 and 42-8 | Editorial |
| 43 | 43-10 | Editorial |
| 43 | 43-13 | Editorial |
| Attachment 43D | 43D-1 | DSER OI 19.1.3.2-1 |
| Attachment 43E | 43E-1 and 43E-2 | DSER OI 19.1.3.2-2 |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-5 and 45-6 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-13 through 45-18 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R1) |
| Attachment 45A | 45A-1 through 45A-24 | Deleted per DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-6 | DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-9 through 49-49 | DSER OI 19.1.10.3-1 (R1) |
| 50 | 50-1 | Editorial |
| 54 | 54-9 | DSER OI 19.1.10.2-3 |
| 54 | 54-12 | DSER OI 19.1.10.2-3 |
| 54 | 54-13 | Editorial |
| 54 | 54-22 through 54-71 | Editorial |
| 54 | 54-76 through 54-80 | DSER OI 19.1.10.2-5 Editorial |

REVISION 4 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|---|
| 54 | 54-83 through 54-110 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-112 through 54-118 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-121 through 54-137 | DSER OI 19.1.10.2-3 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) Editorial |
| 55 | 55-16 through 55-18 | Editorial |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 55 | 55-25 through 55-29 | Editorial |
| 56 | 56-46 | DSER OI 19.3.10-1 |
| 59 | 59-26 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-37 | DSER OI 19A.3-2 (R1) |
| 59 | 59-45 through 59-70 | Editorial |
| 59 | 59-73 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-74 | Editorial |
| 59 | 59-100 | DSER OI 19.1.10.3-1 (R1) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 5 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|---------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 5 Change Roadmap | cxiv and cxv | Editorial |
| 43 | 43-10 and 43-11 | DSER OI 19.1.3.2-2 (R1) |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R2) |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R2) Editorial |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R2) |
| 54 | 54-3 | Editorial |
| 54 | 54-11 | DSER OI 19.1.10.2-4 (R1) |
| 54 | 54-76 through 54-99 | DSER OI 19.1.10.2-4 (R1) |
| 55 | 55-23 | DSER OI 19A.2-8 (R2) |
| 59 | 59-45 | Editorial |
| 59 | 59-77 | Editorial |
| 59 | 59-81 | Editorial |
| 59 | 59-83 | Editorial |
| 59 | 59-90 | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.1-2 (R2) |
| Appendix A | A-8 | Editorial |
| Appendix A | A-17 | Editorial |
| Appendix A | A-19 | Editorial |
| Appendix A | A-21 | Editorial |
| Appendix A | A-23 and A-24 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-25 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-43 | Editorial |
| Appendix A | A-45 and A-46 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-47 and A-48 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-104 through A-109 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-154 through A-158 | DSER OI 19.1.10.1-5 (R2) |

REVISION 5 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|-----------------------|------------------------|--|
| Appendix A | A-159 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-160 and A-161 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-162 and A-163 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-164 through A-175 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-176 and A-177 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-178 through A-181 | DSER OI 19.1.10.1-5 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 6 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 6 Change Roadmap | cxvi | Editorial |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R3) |
| 55 | 55-11 | Editorial |
| 55 | 55-20 | Editorial |
| 55 | 55-21 through 55-24 | Editorial (per Oct. 6-9 meeting) |
| 59 | 59-98 | DSER OI 19.1.10.2-6 (R2) |
| Appendix A | A-41 | DSER OI 21.5-2 |
| Appendix A | A-46 and A-47 | DSER OI 15.2.7-1 Item 7 (R5) |
| Appendix A | A-135 through A-141 | DSER OI 21.5-2 |
| Appendix A | A-154 through A-167 | DSER OI 15.2.7-1 Item 7 (R5) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 7 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|------------------------|--|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 7 Change Roadmap | cxvii | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.2-1 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 8 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 8 Change Roadmap | cxviii | Editorial |
| 59 | 59-92 | NRC Comments |
| 59 | 59-98 | NRC Comments |

Volume 3

TABLE OF CONTENTS

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------------|--|-------------|
| | LIST OF TABLES | xxxv |
| | LIST OF FIGURES | liii |
| | REVISION 1 CHANGE ROADMAP | civ |
| | REVISION 2 CHANGE ROADMAP | cviii |
| | REVISION 3 CHANGE ROADMAP | cxi |
| | REVISION 4 CHANGE ROADMAP | cxii |
| | REVISION 5 CHANGE ROADMAP | cxiv |
| | REVISION 6 CHANGE ROADMAP | cxvi |
| | REVISION 7 CHANGE ROADMAP | cxvii |
| | REVISION 8 CHANGE ROADMAP | cxviii |
| CHAPTER 1 | INTRODUCTION | |
| 1.1 | Introduction | 1-1 |
| 1.1.1 | Background and Overview | 1-1 |
| 1.1.2 | Objectives | 1-1 |
| 1.1.3 | Technical Scope | 1-2 |
| 1.1.4 | Project Methodology Overview | 1-3 |
| 1.1.5 | Results | 1-4 |
| 1.1.6 | Plant Definition | 1-6 |
| 1.1.7 | References | 1-6 |
| CHAPTER 2 | INTERNAL INITIATING EVENTS | |
| 2.1 | Introduction | 2-1 |
| 2.2 | Internal Initiating Event Identification and Categorization | 2-1 |
| 2.2.1 | Logic Diagram for Internal Initiating Events | 2-2 |
| 2.2.2 | Loss-of-Coolant Accidents | 2-3 |
| 2.2.3 | Transients | 2-6 |
| 2.2.4 | Anticipated Transient without Scram | 2-8 |
| 2.2.5 | AP1000 Specific Initiating Event Analysis | 2-10 |
| 2.2.6 | Consequential Events | 2-19 |
| 2.2.7 | Summary of Internal Initiating Event Categories | 2-19 |
| 2.3 | Internal Initiating Event Frequency Quantification | 2-20 |
| 2.3.1 | Quantification of LOCA Initiating Event Frequencies | 2-20 |
| 2.3.2 | Quantification of Transient Initiating Event Frequencies | 2-24 |
| 2.3.3 | ATWS Precursor Initiating Event Frequency | 2-27 |
| 2.3.4 | Summary of Internal Initiating Event Frequencies | 2-27 |
| 2.4 | References | 2-27 |
| ATTACHMENT 2A | QUANTIFICATION OF LOCA INITIATING EVENT FREQUENCIES | |
| 2A-1 | Primary System Pipe Break Frequencies | 2A-1 |
| 2A-2 | Reactor Cooling System Leakage Initiating Event Frequency | 2A-1 |
| 2A-3 | Steam Generator Tube Rupture Initiating Event Frequency | 2A-1 |
| 2A-4 | Quantification of Stuck-Open Pressurizer Safety Valve, Accumulator Interface Break, and IRWST Interface Break | 2A-1 |
| 2A-5 | Initiating Events Review Data Summary and INPO Data | 2A-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| ATTACHMENT 2B QUANTIFICATION OF TRANSIENT INITIATING EVENT FREQUENCIES | | |
| 2B-1 | Secondary Side Line Breaks & Stuck-open Main Steam Line Safety Valve Frequencies..... | 2B-1 |
| CHAPTER 3 MODELING OF SPECIAL INITIATORS | | |
| 3.1 | Introduction..... | 3-1 |
| 3.2 | Ground Rules for Special Initiating Event Analysis..... | 3-1 |
| 3.3 | Loss of Component Cooling Water System/Service Water System Initiating Event..... | 3-1 |
| 3.4 | Loss of Compressed and Instrument Air System Initiating Event..... | 3-2 |
| 3.5 | Spurious Actuation of Automatic Depressurization System..... | 3-2 |
| 3.5.1 | Evaluation of Automatic Depressurization System Spurious Actuation | 3-3 |
| CHAPTER 4 EVENT TREE MODELS | | |
| 4.1 | Introduction..... | 4-1 |
| 4.2 | Large LOCA Event Tree Model..... | 4-1 |
| 4.2.1 | Event Description | 4-1 |
| 4.2.2 | Event Tree Model and its Nodes..... | 4-2 |
| 4.2.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-4 |
| 4.2.4 | Operator Actions..... | 4-4 |
| 4.2.5 | Transfers and Consequential Events | 4-4 |
| 4.3 | Large Spurious ADS Event Tree Model | 4-4 |
| 4.3.1 | Event Description | 4-4 |
| 4.3.2 | Event Tree Model and its Nodes..... | 4-4 |
| 4.3.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-6 |
| 4.3.4 | Operator Actions..... | 4-6 |
| 4.3.5 | Transfers and Consequential Events | 4-6 |
| 4.4 | Medium LOCA Event Tree Model | 4-6 |
| 4.4.1 | Event Description | 4-6 |
| 4.4.2 | Event Tree Model and its Nodes..... | 4-7 |
| 4.4.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-9 |
| 4.4.4 | Operator Actions..... | 4-9 |
| 4.4.5 | Transfers and Consequential Events | 4-10 |
| 4.5 | Core Makeup Tank Line Break Event Tree Model | 4-10 |
| 4.5.1 | Event Description | 4-10 |
| 4.5.2 | Event Tree Model and its Nodes..... | 4-10 |
| 4.5.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-13 |
| 4.5.4 | Operator Actions..... | 4-13 |
| 4.5.5 | Transfers and Consequential Events | 4-13 |
| 4.6 | Safety Injection Line Break Event Tree Model | 4-13 |
| 4.6.1 | Event Description | 4-13 |
| 4.6.2 | Event Tree Model and its Nodes..... | 4-14 |
| 4.6.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| | 4.6.4 Operator Actions..... | 4-16 |
| | 4.6.5 Transfers and Consequential Events | 4-17 |
| 4.7 | Small LOCA Event Tree Model..... | 4-17 |
| | 4.7.1 Event Description | 4-17 |
| | 4.7.2 Event Tree Model and its Nodes..... | 4-17 |
| | 4.7.3 Event Tree Success Criteria and Core Damage Categories..... | 4-20 |
| | 4.7.4 Operator Actions..... | 4-20 |
| | 4.7.5 Transfers and Consequential Events | 4-21 |
| 4.8 | RCS Leak Event Tree Model | 4-21 |
| | 4.8.1 Event Description | 4-21 |
| | 4.8.2 Event Tree Model and its Nodes..... | 4-21 |
| | 4.8.3 Event Tree Success Criteria | 4-22 |
| | 4.8.4 Operator Actions..... | 4-22 |
| | 4.8.5 Transfers and Consequential Events | 4-22 |
| | 4.8.6 Core Damage Categories..... | 4-23 |
| 4.9 | PRHR Tube Rupture Event Tree Model | 4-23 |
| | 4.9.1 Event Description | 4-23 |
| | 4.9.2 Event Tree Model and its Nodes..... | 4-23 |
| | 4.9.3 Event Tree Success Criteria | 4-24 |
| | 4.9.4 Operator Actions..... | 4-24 |
| | 4.9.5 Transfers and Consequential Events | 4-24 |
| | 4.9.6 Core Damage Categories..... | 4-24 |
| 4.10 | Steam Generator Tube Rupture Event Tree Model | 4-25 |
| | 4.10.1 Event Description | 4-25 |
| | 4.10.2 Event Tree Model and its Nodes..... | 4-27 |
| | 4.10.3 Event Tree Success Criteria and Core Damage Categories..... | 4-33 |
| | 4.10.4 Operator Actions..... | 4-33 |
| | 4.10.5 Transfers and Consequential Events | 4-33 |
| 4.11 | Reactor Vessel Rupture Event Tree Model | 4-34 |
| | 4.11.1 Event Description | 4-34 |
| | 4.11.2 Event Tree Model and its Nodes..... | 4-34 |
| | 4.11.3 Event Tree Success Criteria | 4-34 |
| | 4.11.4 Operator Actions..... | 4-34 |
| | 4.11.5 Transfers and Consequential Events | 4-34 |
| | 4.11.6 Core Damage Categories..... | 4-34 |
| 4.12 | Interfacing System LOCA Event Tree Model | 4-34 |
| | 4.12.1 Event Description | 4-34 |
| | 4.12.2 Event Tree Model and its Nodes..... | 4-35 |
| | 4.12.3 Event Tree Success Criteria | 4-35 |
| | 4.12.4 Operator Actions..... | 4-35 |
| | 4.12.5 Transfers and Consequential Events | 4-35 |
| | 4.12.6 Core Damage Categories..... | 4-35 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 4.13 | Transients With MFW Event Tree Model..... | 4-35 |
| 4.13.1 | Event Description | 4-35 |
| 4.13.2 | Event Tree Model and its Nodes..... | 4-37 |
| 4.13.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-41 |
| 4.13.4 | Operator Actions..... | 4-41 |
| 4.13.5 | Transfers and Consequential Events | 4-42 |
| 4.14 | Transients With Loss of RCS Flow Event Tree Model..... | 4-42 |
| 4.14.1 | Event Description | 4-42 |
| 4.14.2 | Event Tree Model and its Nodes..... | 4-42 |
| 4.14.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-46 |
| 4.14.4 | Operator Actions..... | 4-46 |
| 4.14.5 | Transfers and Consequential Events | 4-46 |
| 4.15 | Transients With Loss of MFW to One Steam Generator Event Tree Model..... | 4-46 |
| 4.15.1 | Event Description | 4-46 |
| 4.15.2 | Event Tree Model and its Nodes..... | 4-47 |
| 4.15.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-50 |
| 4.15.4 | Operator Actions..... | 4-50 |
| 4.15.5 | Transfers and Consequential Events | 4-51 |
| 4.16 | Transients With Core Power Excursion Event Tree Model..... | 4-51 |
| 4.16.1 | Event Description | 4-51 |
| 4.16.2 | Event Tree Model and its Nodes..... | 4-51 |
| 4.16.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-55 |
| 4.16.4 | Operator Actions..... | 4-55 |
| 4.16.5 | Transfers and Consequential Events | 4-55 |
| 4.17 | Transients With Loss of CCW/SW Event Tree Model..... | 4-56 |
| 4.17.1 | Event Description | 4-56 |
| 4.17.2 | Event Tree Model and its Nodes..... | 4-56 |
| 4.17.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-59 |
| 4.17.4 | Operator Actions..... | 4-59 |
| 4.17.5 | Transfers and Consequential Events | 4-60 |
| 4.18 | Loss of Main Feedwater Event Tree Model | 4-60 |
| 4.18.1 | Event Description | 4-60 |
| 4.18.2 | Event Tree Model and its Nodes..... | 4-62 |
| 4.18.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-65 |
| 4.18.4 | Operator Actions..... | 4-65 |
| 4.18.5 | Transfers and Consequential Events | 4-66 |
| 4.19 | Loss of Condenser Event Tree Model | 4-66 |
| 4.19.1 | Event Description | 4-66 |
| 4.19.2 | Event Tree Model and its Nodes..... | 4-66 |
| 4.19.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-70 |
| 4.19.4 | Operator Actions..... | 4-70 |
| 4.19.5 | Transfers and Consequential Events | 4-70 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 4.20 | Loss of Compressed Air Event Tree Model | 4-70 |
| 4.20.1 | Event Description | 4-70 |
| 4.20.2 | Event Tree Model and its Nodes..... | 4-71 |
| 4.20.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-74 |
| 4.20.4 | Operator Actions..... | 4-74 |
| 4.20.5 | Transfers and Consequential Events | 4-75 |
| 4.21 | Loss of Offsite Power Event Tree Model | 4-75 |
| 4.21.1 | Event Description | 4-75 |
| 4.21.2 | Event Tree Model and its Nodes..... | 4-75 |
| 4.21.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-79 |
| 4.21.4 | Operator Actions..... | 4-79 |
| 4.21.5 | Transfers and Consequential Events | 4-80 |
| 4.22 | Main Steam Line Break Downstream of MSIVs Event Tree Model | 4-80 |
| 4.22.1 | Event Description | 4-80 |
| 4.22.2 | Event Tree Model and its Nodes..... | 4-81 |
| 4.22.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-84 |
| 4.22.4 | Operator Actions..... | 4-84 |
| 4.22.5 | Transfers and Consequential Events | 4-85 |
| 4.23 | Main Steam Line Break Upstream of MSIVs Event Tree Model..... | 4-85 |
| 4.23.1 | Event Description | 4-85 |
| 4.23.2 | Event Tree Model and its Nodes..... | 4-85 |
| 4.23.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-89 |
| 4.23.4 | Operator Actions..... | 4-89 |
| 4.23.5 | Transfers and Consequential Events | 4-90 |
| 4.24 | Stuck-Open Secondary Side Safety Valve Event Tree Model..... | 4-90 |
| 4.24.1 | Event Description | 4-90 |
| 4.24.2 | Event Tree Model and its Nodes..... | 4-91 |
| 4.24.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-94 |
| 4.24.4 | Operator Actions..... | 4-94 |
| 4.24.5 | Transfers and Consequential Events | 4-94 |
| 4.25 | ATWS Precursors Without MFW Event Tree Model | 4-95 |
| 4.25.1 | Event Description | 4-95 |
| 4.25.2 | Event Tree Model and its Nodes..... | 4-96 |
| 4.25.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-101 |
| 4.25.4 | Operator Actions..... | 4-101 |
| 4.25.5 | Transfers and Consequential Events | 4-101 |
| 4.26 | ATWS Precursor with SI Event Tree Model..... | 4-101 |
| 4.26.1 | Event Description | 4-101 |
| 4.26.2 | Event Tree Model and its Nodes..... | 4-102 |
| 4.26.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-106 |
| 4.26.4 | Operator Actions..... | 4-106 |
| 4.26.5 | Transfers and Consequential Events | 4-106 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 4.27 | ATWS Precursor Transients with MFW Event Tree Model | 4-106 |
| 4.27.1 | Event Description | 4-106 |
| 4.27.2 | Event Tree Model and its Nodes | 4-107 |
| 4.27.3 | Event Tree Success Criteria and Core Damage Categories | 4-110 |
| 4.27.4 | Operator Actions | 4-111 |
| 4.27.5 | Transfers and Consequential Events | 4-111 |
| ATTACHMENT 4A EVENT TREE GUIDELINES | | |
| 4A.1 | Event Tree Analysis Methodology | 4A-1 |
| 4A.2 | Event Tree Guidelines for Core Damage | 4A-3 |
| 4A.2.1 | Event Trees | 4A-3 |
| 4A.2.2 | Success Criteria | 4A-6 |
| 4A.2.3 | Definition of End States | 4A-7 |
| 4A.2.4 | Plant Response Functions | 4A-9 |
| 4A.2.5 | Event Tree Node Notation | 4A-13 |
| 4A.2.6 | Consequential Events | 4A-13 |
| 4A.2.7 | Transient Template | 4A-14 |
| 4A.2.8 | Small LOCA Template | 4A-15 |
| ATTACHMENT 4B EVENT TREE PICTURES | | 4B-1 |
| CHAPTER 5 SUPPORT SYSTEMS | | |
| 5.1 | Introduction | 5-1 |
| 5.2 | Support Systems and Their Interdependencies | 5-1 |
| 5.3 | Front Line Systems and Their Dependencies | 5-1 |
| CHAPTER 6 SUCCESS CRITERIA ANALYSIS | | |
| 6.1 | Introduction | 6-1 |
| 6.2 | Acceptance Criteria and Critical Functions for Success Criteria | 6-1 |
| 6.3 | Event Sequences and Timing, Passive/Active System Interactions | 6-3 |
| 6.3.1 | General Sequence Success Criteria | 6-3 |
| 6.3.2 | Timing of Events and Key Operator Actions | 6-9 |
| 6.3.3 | Passive/Active System Interactions | 6-15 |
| 6.3.4 | Sequence Success Criteria Summary | 6-18 |
| 6.4 | Event Tree Top Events Success Criteria | 6-18 |
| 6.5 | References | 6-19 |
| CHAPTER 7 FAULT TREE GUIDELINES | | |
| 7.1 | Purpose | 7-1 |
| 7.2 | Fault Tree Development | 7-1 |
| 7.2.1 | Procedural Steps for Fault Tree Preparation | 7-1 |
| 7.2.2 | Procedural Steps for Fault Tree Construction | 7-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 7.3 | Primary Events to be Considered in Fault Trees | 7-3 |
| 7.3.1 | Random Component Failure | 7-3 |
| 7.3.2 | Outage for Maintenance and Testing | 7-5 |
| 7.3.3 | Common Cause Failures | 7-6 |
| 7.3.4 | Human Errors..... | 7-6 |
| 7.3.5 | Power and Control Model..... | 7-9 |
| 7.4 | Data Base | 7-10 |
| 7.5 | Fault Tree Model: Identification Codes..... | 7-10 |
| 7.5.1 | Identification Code for Fault Tree Names..... | 7-10 |
| 7.5.2 | Identification Code for Support Systems | 7-10 |
| 7.5.3 | Identification Code for Primary Event Names | 7-11 |
| 7.5.4 | Identification Code for Common Cause Failures | 7-11 |
| 7.5.5 | Identification Code for Undeveloped Events (Modules)..... | 7-12 |
| 7.5.6 | Identification Code for Operator Errors | 7-13 |
| 7.6 | Fault Tree Quantification | 7-13 |
| 7.7 | References..... | 7-14 |
| | | |
| CHAPTER 8 | PASSIVE CORE COOLING SYSTEM – PASSIVE RESIDUAL HEAT REMOVAL | |
| 8.1 | System Function..... | 8-1 |
| 8.2 | System Description | 8-1 |
| 8.2.1 | Support Systems | 8-1 |
| 8.2.2 | Instrumentation and Control | 8-2 |
| 8.2.3 | Test and Maintenance | 8-2 |
| 8.3 | System Operation | 8-3 |
| 8.4 | Performance During Accident Conditions | 8-3 |
| 8.4.1 | Plant Shutdown..... | 8-3 |
| 8.4.2 | Loss of Coolant Accidents | 8-3 |
| 8.4.3 | Passive Residual Heat Removal Heat Exchanger Tube Rupture..... | 8-3 |
| 8.5 | Initiating Events Review | 8-4 |
| 8.5.1 | Initiating Events Impacting the PRHR System | 8-4 |
| 8.5.2 | Initiating Events Caused by PRHR System Malfunction | 8-4 |
| 8.6 | System Logic Models..... | 8-4 |
| 8.6.1 | Assumptions and Boundary Conditions..... | 8-5 |
| 8.6.2 | Fault Tree Models..... | 8-6 |
| 8.6.3 | Human Interactions..... | 8-6 |
| 8.6.4 | Common Cause Failures | 8-6 |
| 8.7 | Quantification and Results | 8-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| CHAPTER 9 | PASSIVE CORE COOLING SYSTEM – CORE MAKEUP TANK | |
| 9.1 | System Description | 9-1 |
| 9.1.1 | Support Systems | 9-1 |
| 9.1.2 | Instrumentation and Control | 9-1 |
| 9.1.3 | Test and Maintenance Assumptions..... | 9-2 |
| 9.2 | System Operation | 9-2 |
| 9.3 | Performance During Accident Conditions | 9-3 |
| 9.3.1 | Inadvertent Opening of a Steam Generator Relief or Safety Valve..... | 9-3 |
| 9.3.2 | Steam Line Break..... | 9-3 |
| 9.3.3 | Steam Generator Tube Rupture..... | 9-3 |
| 9.3.4 | Reactor Coolant System Heatup Transients | 9-4 |
| 9.3.5 | Loss-of-Coolant Accidents..... | 9-4 |
| 9.3.6 | Loss of Offsite Power | 9-4 |
| 9.3.7 | Anticipated Transient without Trip..... | 9-4 |
| 9.4 | Initiating Event Review..... | 9-4 |
| 9.4.1 | Initiating Events Impacting the Core Makeup Tank Subsystem | 9-5 |
| 9.4.2 | Initiating Events Due to Loss of the Core Makeup Tank Subsystem | 9-5 |
| 9.5 | System Logic Models..... | 9-5 |
| 9.5.1 | Assumptions and Boundary Conditions..... | 9-5 |
| 9.5.2 | Fault Tree Models..... | 9-7 |
| 9.5.3 | Human Interactions..... | 9-7 |
| 9.5.4 | Common Cause Failures | 9-8 |
| CHAPTER 10 | PASSIVE CORE COOLING SYSTEM – ACCUMULATOR | |
| 10.1 | System Description | 10-1 |
| 10.1.1 | Support Systems | 10-1 |
| 10.1.2 | Instrumentation and Control | 10-1 |
| 10.1.3 | Test and Maintenance Assumptions..... | 10-1 |
| 10.2 | System Operation | 10-1 |
| 10.3 | Performance During Accident Conditions | 10-2 |
| 10.3.1 | Steam Line Break..... | 10-2 |
| 10.3.2 | Loss-of-Coolant Accidents or Non-Loss-of-Coolant Accidents with Automatic Depressurization System | 10-2 |
| 10.4 | Initiating Event Review..... | 10-3 |
| 10.4.1 | Initiating Events Impacting the Accumulator Subsystem..... | 10-3 |
| 10.4.2 | Initiating Events Due to Loss of the Accumulator Subsystem | 10-3 |
| 10.5 | System Logic Models..... | 10-3 |
| 10.5.1 | Assumptions and Boundary Conditions..... | 10-3 |
| 10.5.2 | Fault Tree Models..... | 10-4 |
| 10.5.3 | Human Interactions..... | 10-4 |
| 10.5.4 | Common Cause Failures | 10-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 11 PASSIVE COOLING SYSTEM – AUTOMATIC DEPRESSURIZATION SYSTEM | | |
| 11.1 | System Function..... | 11-1 |
| 11.2 | System Description | 11-1 |
| | 11.2.1 Support Systems | 11-1 |
| | 11.2.2 Instrumentation and Control | 11-2 |
| | 11.2.3 Test and Maintenance | 11-2 |
| 11.3 | System Operation | 11-2 |
| 11.4 | Performance During Accident Conditions | 11-3 |
| | 11.4.1 Loss of Coolant Accidents | 11-3 |
| | 11.4.2 Transients..... | 11-3 |
| 11.5 | Initiating Events Review | 11-3 |
| | 11.5.1 Initiating Events Impacting the Automatic Depressurization System | 11-3 |
| | 11.5.2 Initiating Events Caused by the ADS Malfunction | 11-4 |
| 11.6 | System Logic Model | 11-4 |
| | 11.6.1 Assumptions and Boundary Conditions..... | 11-4 |
| | 11.6.2 Fault Tree Models..... | 11-5 |
| | 11.6.3 Human Interactions..... | 11-6 |
| | 11.6.4 Common Cause Failures | 11-7 |
| 11.7 | Quantification and Results | 11-7 |
| CHAPTER 12 PASSIVE CORE COOLING SYSTEM – IN-CONTAINMENT REFUELING WATER STORAGE TANK | | |
| 12.1 | System Function..... | 12-1 |
| 12.2 | System Description | 12-1 |
| | 12.2.1 Support Systems | 12-1 |
| | 12.2.2 Instrumentation and Control | 12-1 |
| | 12.2.3 Test and Maintenance | 12-2 |
| 12.3 | System Operation | 12-2 |
| 12.4 | Performance During Accident Conditions | 12-2 |
| | 12.4.1 Transients..... | 12-3 |
| | 12.4.2 Loss of Coolant Accidents | 12-4 |
| | 12.4.3 In-Vessel Core Damage Mitigation..... | 12-5 |
| | 12.4.4 Containment Isolation System Failure | 12-5 |
| 12.5 | Initiating Event..... | 12-5 |
| | 12.5.1 Initiating Event Impacting IRWST/Gravity Injection Subsystem | 12-5 |
| | 12.5.2 Initiating Event due to Loss of IRWST/Gravity Injection Subsystem..... | 12-5 |
| 12.6 | System Logic Models..... | 12-6 |
| | 12.6.1 Assumptions and Boundary Conditions..... | 12-6 |
| | 12.6.2 Fault Tree Models..... | 12-8 |
| | 12.6.3 Human Interactions..... | 12-8 |
| | 12.6.4 Common Cause Failures | 12-8 |
| 12.7 | Quantification and Results | 12-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 13 PASSIVE CONTAINMENT COOLING SYSTEM | | |
| 13.1 | System Description | 13-1 |
| 13.1.1 | Support Systems | 13-1 |
| 13.1.2 | Instrumentation and Control | 13-1 |
| 13.1.3 | Test and Maintenance Assumptions..... | 13-2 |
| 13.2 | System Operation | 13-2 |
| 13.3 | Performance During Accident Conditions | 13-2 |
| 13.3.1 | Post-Reactor Trip with Loss of All ac Power..... | 13-2 |
| 13.3.2 | Automatic Depressurization System Actuation..... | 13-2 |
| 13.3.3 | Post-Loss-of-Coolant Accident | 13-3 |
| 13.3.4 | Post-Main Steam Line Break | 13-3 |
| 13.4 | Initiating Event Review..... | 13-3 |
| 13.4.1 | Initiating Events Impacting the Passive Containment Cooling System..... | 13-3 |
| 13.4.2 | Initiating Events due to Loss of the Passive Containment Cooling System | 13-3 |
| 13.5 | System Logic Model | 13-3 |
| 13.5.1 | Assumptions and Boundary Conditions..... | 13-4 |
| 13.5.2 | Fault Tree Model | 13-5 |
| 13.5.3 | Human Interactions..... | 13-6 |
| 13.5.4 | Common Cause Failures | 13-6 |
| CHAPTER 14 MAIN AND STARTUP FEEDWATER SYSTEM | | |
| 14.1 | System Description | 14-1 |
| 14.1.1 | Support Systems | 14-1 |
| 14.1.2 | Instrumentation and Control | 14-2 |
| 14.1.3 | Test and Maintenance | 14-2 |
| 14.2 | System Operation | 14-2 |
| 14.3 | Performance During Accident Conditions | 14-2 |
| 14.4 | Initiating Event Review..... | 14-4 |
| 14.4.1 | Initiating Event Impacting Main and Startup Feedwater/ Condensate System..... | 14-4 |
| 14.4.2 | Initiating Event due to Loss of Main and Startup Feedwater/ Condensate System..... | 14-4 |
| 14.5 | System Logic Models | 14-4 |
| 14.5.1 | Assumptions and Boundary Conditions..... | 14-5 |
| 14.5.2 | Fault Tree Models..... | 14-7 |
| 14.5.3 | Human Interactions..... | 14-7 |
| 14.5.4 | Common Cause Failures | 14-7 |
| 14.6 | Quantification and Results | 14-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 15 CHEMICAL AND VOLUME CONTROL SYSTEM | | |
| 15.1 | System Description | 15-1 |
| 15.1.1 | Support Systems | 15-1 |
| 15.1.2 | Instrumentation and Control Assumptions..... | 15-1 |
| 15.1.3 | Test and Maintenance Assumptions..... | 15-2 |
| 15.2 | System Operation | 15-3 |
| 15.3 | Performance During Accident Conditions | 15-3 |
| 15.4 | Initiating Event Review | 15-4 |
| 15.4.1 | Initiating Events Impacting the Chemical and Volume Control System | 15-5 |
| 15.4.2 | Initiating Events Due to Loss of the Chemical and Volume Control System | 15-5 |
| 15.5 | System Logic Models | 15-5 |
| 15.5.1 | Assumptions and Boundary Conditions..... | 15-5 |
| 15.5.2 | Fault Tree Models..... | 15-7 |
| 15.5.3 | Human Interactions..... | 15-7 |
| 15.5.4 | Common Cause Failures | 15-8 |
| CHAPTER 16 CONTAINMENT HYDROGEN CONTROL SYSTEM | | |
| 16.1 | System Description | 16-1 |
| 16.1.1 | Support Systems | 16-1 |
| 16.1.2 | Instrumentation and Control | 16-1 |
| 16.1.3 | Test and Maintenance | 16-1 |
| 16.2 | System Operation | 16-2 |
| 16.3 | Performance During Accident Conditions | 16-2 |
| 16.4 | Initiating Event Review..... | 16-2 |
| 16.5 | System Logic Model | 16-2 |
| 16.5.1 | Assumptions and Boundary Conditions..... | 16-2 |
| 16.5.2 | Fault Tree Model | 16-3 |
| 16.5.3 | Human Interactions..... | 16-3 |
| 16.5.4 | Common Cause Failures | 16-4 |
| CHAPTER 17 NORMAL RESIDUAL HEAT REMOVAL SYSTEM | | |
| 17.1 | System Description | 17-1 |
| 17.1.1 | Support Systems | 17-1 |
| 17.1.2 | Instrumentation and Control | 17-1 |
| 17.1.3 | Test and Maintenance Assumptions..... | 17-1 |
| 17.2 | System Operation | 17-1 |
| 17.3 | Performance During Accident Conditions | 17-2 |
| 17.4 | Initiating Event Review..... | 17-3 |
| 17.4.1 | Initiating Events Impacting the Normal Residual Heat Removal System | 17-3 |
| 17.4.2 | Initiating Events Due to Loss of the Normal Residual Heat Removal System | 17-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 17.5 | System Logic Models..... | 17-4 |
| | 17.5.1 Assumptions and Boundary Conditions..... | 17-4 |
| | 17.5.2 Fault Tree Models..... | 17-6 |
| | 17.5.3 Human Interactions..... | 17-6 |
| | 17.5.4 Common Cause Failures..... | 17-6 |
| 17.6 | References..... | 17-6 |
| | | |
| CHAPTER 18 COMPONENT COOLING WATER SYSTEM | | |
| 18.1 | System Description | 18-1 |
| | 18.1.1 Support Systems | 18-1 |
| | 18.1.2 Instrumentation and Control | 18-1 |
| | 18.1.3 Test and Maintenance Assumptions..... | 18-1 |
| 18.2 | System Operation | 18-2 |
| 18.3 | Performance During Accident Conditions | 18-2 |
| 18.4 | Initiating Event Review..... | 18-2 |
| | 18.4.1 Initiating Events Impacting the Component Cooling Water System..... | 18-2 |
| | 18.4.2 Initiating Events Due to Loss of the Component Cooling Water System..... | 18-3 |
| 18.5 | System Logic Models..... | 18-3 |
| | 18.5.1 Assumptions and Boundary Conditions..... | 18-3 |
| | 18.5.2 Fault Tree Models..... | 18-4 |
| | 18.5.3 Human Interactions..... | 18-4 |
| | 18.5.4 Common Cause Failures..... | 18-5 |
| | | |
| CHAPTER 19 SERVICE WATER SYSTEM | | |
| 19.1 | System Description | 19-1 |
| | 19.1.1 Support Systems | 19-1 |
| | 19.1.2 Instrumentation and Control | 19-1 |
| | 19.1.3 Test and Maintenance Assumptions..... | 19-1 |
| 19.2 | System Operation | 19-2 |
| 19.3 | Performance During Accident Conditions | 19-2 |
| 19.4 | Initiating Event Review..... | 19-2 |
| | 19.4.1 Initiating Events Impacting the Service Water System | 19-2 |
| | 19.4.2 Initiating Events Due to Loss of the Service Water System..... | 19-2 |
| 19.5 | System Logic Models..... | 19-3 |
| | 19.5.1 Assumptions and Boundary Conditions..... | 19-3 |
| | 19.5.2 Fault Tree Models..... | 19-4 |
| | 19.5.3 Human Interactions..... | 19-5 |
| | 19.5.4 Common Cause Failures..... | 19-5 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 20 CENTRAL CHILLED WATER SYSTEM | | |
| 20.1 | System Description | 20-1 |
| | 20.1.1 Support Systems | 20-1 |
| | 20.1.2 Instrumentation and Control | 20-1 |
| | 20.1.3 Test and Maintenance Assumptions..... | 20-1 |
| 20.2 | System Operation | 20-2 |
| 20.3 | Performance During Accident Conditions | 20-2 |
| 20.4 | Initiating Event Review..... | 20-2 |
| | 20.4.1 Initiating Events Impacting the Central Chilled Water System..... | 20-2 |
| | 20.4.2 Initiating Events Due to Loss of the Central Chilled Water System | 20-3 |
| 20.5 | System Logic Model | 20-3 |
| | 20.5.1 Assumptions and Boundary Conditions..... | 20-3 |
| | 20.5.2 Fault Tree Model | 20-4 |
| | 20.5.3 Human Interactions..... | 20-4 |
| | 20.5.4 Common Cause Failures | 20-4 |
| CHAPTER 21 AC POWER SYSTEM | | |
| 21.1 | System Description | 21-1 |
| | 21.1.1 Support Systems | 21-1 |
| | 21.1.2 Instrumentation and Control | 21-2 |
| | 21.1.3 Test and Maintenance Assumptions..... | 21-2 |
| 21.2 | System Operation | 21-2 |
| 21.3 | Performance During Accident Conditions | 21-3 |
| | 21.3.1 Automatic Load Shedding | 21-3 |
| | 21.3.2 Manual Transfer..... | 21-3 |
| | 21.3.3 Electric Circuit Protection..... | 21-3 |
| 21.4 | Initiating Event Review..... | 21-3 |
| | 21.4.1 Loss of the Main Generator | 21-4 |
| | 21.4.2 Loss of Offsite Power | 21-4 |
| | 21.4.3 Loss of 6900-vac and 480-vac Busses | 21-4 |
| 21.5 | System Logic Models..... | 21-4 |
| | 21.5.1 Assumptions and Boundary Conditions..... | 21-5 |
| | 21.5.2 Fault Tree Models..... | 21-7 |
| | 21.5.3 Human Interactions..... | 21-8 |
| | 21.5.4 Common Cause Failures | 21-8 |
| CHAPTER 22 CLASS 1E DC AND UNINTERRUPTIBLE POWER SUPPLY SYSTEM | | |
| 22.1 | System Description | 22-1 |
| | 22.1.1 Support Systems | 22-1 |
| | 22.1.2 Instrumentation and Control | 22-1 |
| | 22.1.3 Test and Maintenance Assumptions..... | 22-1 |
| 22.2 | System Operation | 22-2 |
| 22.3 | Performance During Accident Conditions | 22-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 22.4 | Initiating Event Review..... | 22-2 |
| 22.4.1 | Initiating Events Impacting the Class 1E dc and UPS System..... | 22-3 |
| 22.4.2 | Initiating Events Due to Loss of the Class 1E dc and UPS System..... | 22-3 |
| 22.5 | System Logic Models..... | 22-3 |
| 22.5.1 | Assumptions and Boundary Conditions..... | 22-3 |
| 22.5.2 | Fault Tree Models..... | 22-4 |
| 22.5.3 | Human Interactions..... | 22-4 |
| 22.5.4 | Common Cause Failures..... | 22-4 |
| 22.6 | References..... | 22-5 |
| CHAPTER 23 NON-CLASS 1E DC AND UPS SYSTEM | | |
| 23.1 | System Description | 23-1 |
| 23.1.1 | Support Systems | 23-1 |
| 23.1.2 | Instrumentation and Control | 23-1 |
| 23.1.3 | Test and Maintenance Assumptions..... | 23-1 |
| 23.2 | System Operation | 23-2 |
| 23.3 | Performance During Accident Conditions | 23-2 |
| 23.4 | Initiating Event Review..... | 23-2 |
| 23.4.1 | Initiating Events Impacting the Non-Class 1E dc and UPS System..... | 23-2 |
| 23.4.2 | Initiating Events Due to Loss of the Non-Class 1E dc and UPS Power System | 23-3 |
| 23.5 | System Logic Models..... | 23-3 |
| 23.5.1 | Assumptions and Boundary Conditions..... | 23-3 |
| 23.5.2 | Fault Tree Models..... | 23-4 |
| 23.5.3 | Human Interactions..... | 23-5 |
| 23.5.4 | Common Cause Failures..... | 23-5 |
| 23.6 | References..... | 23-5 |
| CHAPTER 24 CONTAINMENT ISOLATION | | |
| 24.1 | System Description | 24-1 |
| 24.1.1 | Support Systems | 24-1 |
| 24.1.2 | Instrumentation and Control | 24-1 |
| 24.1.3 | Test and Maintenance Assumptions..... | 24-2 |
| 24.2 | System Operation | 24-2 |
| 24.3 | Performance During Accident Conditions | 24-2 |
| 24.4 | Initiating Event Review..... | 24-2 |
| 24.4.1 | Initiating Events Impacting Containment Isolation..... | 24-2 |
| 24.4.2 | Initiating Events Due to Loss of the Containment Isolation System | 24-2 |
| 24.5 | System Logic Models..... | 24-3 |
| 24.5.1 | Assumptions and Boundary Conditions..... | 24-4 |
| 24.5.2 | Fault Tree Models..... | 24-5 |
| 24.5.3 | Human Interactions..... | 24-6 |
| 24.5.4 | Common Cause Failures..... | 24-6 |
| 24.6 | References..... | 24-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 25 COMPRESSED AND INSTRUMENT AIR SYSTEM | | |
| 25.1 | System Description | 25-1 |
| | 25.1.1 Support Systems | 25-2 |
| | 25.1.2 Instrumentation and Control | 25-2 |
| | 25.1.3 Test and Maintenance Assumptions..... | 25-3 |
| 25.2 | System Operation | 25-3 |
| 25.3 | Performance During Accident Conditions | 25-3 |
| 25.4 | Initiating Event Review..... | 25-4 |
| | 25.4.1 Initiating Events Impacting the Instrument Air Subsystem..... | 25-4 |
| | 25.4.2 Initiating Events Due to Loss of the Instrument Air Subsystem | 25-4 |
| 25.5 | System Logic Models..... | 25-4 |
| | 25.5.1 Assumptions and Boundary Conditions..... | 25-4 |
| | 25.5.2 Fault Tree Models..... | 25-6 |
| | 25.5.3 Human Interactions..... | 25-7 |
| | 25.5.4 Common Cause Failures | 25-7 |
| CHAPTER 26 PROTECTION AND SAFETY MONITORING SYSTEM | | |
| 26.1 | System Analysis Description..... | 26-1 |
| | 26.1.1 Analysis of Support Systems..... | 26-4 |
| | 26.1.2 Analysis of Instrumentation | 26-5 |
| | 26.1.3 Test and Maintenance Assumptions..... | 26-6 |
| 26.2 | Performance During Accident Conditions | 26-7 |
| 26.3 | Initiating Event Review..... | 26-7 |
| | 26.3.1 Initiating Event Impacting PMS..... | 26-7 |
| | 26.3.2 Initiating Event due to Loss of PMS | 26-8 |
| 26.4 | System Logic Model Development | 26-8 |
| | 26.4.1 Assumptions and Boundary Conditions | 26-8 |
| | 26.4.2 Fault Tree Models..... | 26-12 |
| | 26.4.3 Description of I&C Subtree Development | 26-12 |
| | 26.4.4 Human Interactions..... | 26-19 |
| 26.5 | Discussion of Methodology..... | 26-19 |
| | 26.5.1 Fault Tree Analysis | 26-20 |
| | 26.5.2 Unavailability..... | 26-20 |
| | 26.5.3 Spurious Failure Rate Per Year..... | 26-20 |
| | 26.5.4 Common Cause Failures | 26-22 |
| | 26.5.5 Data Manipulation | 26-23 |
| 26.6 | References..... | 26-24 |
| CHAPTER 27 DIVERSE ACTUATION SYSTEM | | |
| 27.1 | System Analysis Description..... | 27-1 |
| | 27.1.1 Support Systems Analysis..... | 27-2 |
| | 27.1.2 Analysis of Instrumentation and Control | 27-2 |
| | 27.1.3 Test and Maintenance | 27-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 27.2 | Analysis of System Operation | 27-2 |
| 27.3 | Performance During Accident Conditions | 27-6 |
| 27.4 | Initiating Event Review..... | 27-6 |
| | 27.4.1 Initiating Events Impacting the Diverse Actuation System..... | 27-6 |
| | 27.4.2 Initiating Events Due to Loss of the Diverse Actuation System..... | 27-6 |
| 27.5 | System Logic Model | 27-6 |
| | 27.5.1 Assumptions and Boundary Conditions..... | 27-7 |
| | 27.5.2 Fault Tree Model | 27-7 |
| | 27.5.3 Human Interactions..... | 27-7 |
| | 27.5.4 Common Cause Failures | 27-8 |
| | | |
| CHAPTER 28 | PLANT CONTROL SYSTEM | |
| 28.1 | System Analysis Description..... | 28-1 |
| | 28.1.1 Analysis of Support Systems..... | 28-3 |
| | 28.1.2 Analysis of Instrumentation | 28-4 |
| | 28.1.3 Test and Maintenance Assumptions..... | 28-4 |
| 28.2 | Performance During Accident Conditions | 28-6 |
| 28.3 | Initiating Event Review..... | 28-6 |
| | 28.3.1 Initiating Events Impacting the Plant Control System..... | 28-6 |
| | 28.3.2 Initiating Event due to Loss of the Plant Control System..... | 28-6 |
| 28.4 | System Logic Model Development | 28-7 |
| | 28.4.1 Assumptions and Boundary Conditions..... | 28-7 |
| | 28.4.2 Fault Tree Models..... | 28-9 |
| | 28.4.3 Description of I&C Subtree Development | 28-10 |
| | 28.4.4 Human Interactions..... | 28-16 |
| 28.5 | Discussion of Methodology..... | 28-17 |
| | 28.5.1 Fault Tree Analysis..... | 28-17 |
| | 28.5.2 Unavailability..... | 28-17 |
| | 28.5.3 Common Cause Failures | 28-17 |
| | 28.5.4 Data Manipulation | 28-18 |
| | | |
| CHAPTER 29 | COMMON-CAUSE ANALYSIS | |
| 29.1 | Introduction..... | 29-1 |
| 29.2 | Dependent Failures | 29-1 |
| 29.3 | Common-Cause Analysis | 29-4 |
| | 29.3.1 Assumptions | 29-4 |
| | 29.3.2 Analysis of Potential Common-Cause Failures within the Systems..... | 29-6 |
| | 29.3.3 Analysis of Potential Common-Cause Failures among Several Systems | 29-6 |
| 29.4 | Calculations For Component Groups | 29-6 |
| | 29.4.1 DC Batteries..... | 29-7 |
| | 29.4.2 Reactor Trip Breakers | 29-8 |
| | 29.4.3 Automatic Depressurization System Explosive Valves..... | 29-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 29.4.4 | Air-Operated Valves in Core Makeup Tanks..... | 29-10 |
| 29.4.5 | Automatic Depressurization System Motor-Operated Valves..... | 29-11 |
| 29.4.6 | Common-Cause Failure for IRWST Valves..... | 29-14 |
| 29.5 | Results..... | 29-17 |
| 29.6 | References..... | 29-17 |
| ATTACHMENT 29A COMMON-CAUSE ANALYSIS GUIDELINES..... | | 29A-1 |
| 29A.1 | Introduction..... | 29A-1 |
| 29A.2 | Types of Dependencies..... | 29A-1 |
| 29A.3 | Common Cause Failures Definition..... | 29A-2 |
| 29A.4 | Methodology..... | 29A-3 |
| 29A.5 | Common Cause Failures Calculation Procedure..... | 29A-4 |
| 29A.5.1 | Procedure for Treatment of Common Cause Failures Within a System..... | 29A-5 |
| 29A.5.2 | Procedure for Treatment of Common Cause Failures Among More Systems..... | 29A-7 |
| 29A.6 | Common Cause Failure Numerical Evaluation..... | 29A-8 |
| 29A.6.1 | Evaluation through Beta Factor Method..... | 29A-8 |
| 29A.6.2 | Evaluation through Multiple-Greek Letter (MGL) Method..... | 29A-8 |
| 29A.7 | References..... | 29A-10 |
| CHAPTER 30 HUMAN RELIABILITY ANALYSIS | | |
| 30.1 | Introduction..... | 30-1 |
| 30.2 | Summary of Results..... | 30-1 |
| 30.3 | Methodology..... | 30-2 |
| 30.4 | Major Assumptions..... | 30-4 |
| 30.5 | Types of Human Interactions..... | 30-10 |
| 30.5.1 | Quantification Model..... | 30-11 |
| 30.6 | Quantification..... | 30-12 |
| 30.6.1 | ZON-MAN01 (Start the Onsite Standby Diesel Generator)..... | 30-12 |
| 30.6.2 | LPM-MAN01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-13 |
| 30.6.3 | LPM-MAN02 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-15 |
| 30.6.4 | LPM-MAN05 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-16 |
| 30.6.5 | LPM-REC01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-17 |
| 30.6.6 | ADN-MAN01 (Actuate the Automatic Depressurization System)..... | 30-17 |
| 30.6.7 | ADN-REC01 (Actuate the Automatic Depressurization System)..... | 30-19 |
| 30.6.8 | CCB-MAN01 (Start the Standby Component Cooling Water Pump)..... | 30-19 |
| 30.6.9 | CCN-MAN02 (Inadvertent Misalignment of Heat Exchanger)..... | 30-20 |
| 30.6.10 | CIB-MAN00 (Diagnose Steam Generator Tube Rupture)..... | 30-21 |
| 30.6.11 | DUMP-MAN01 (Operate Steam Dump Valves)..... | 30-22 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 30.6.12 | CIC-MAN01 (Isolate Containment)..... | 30-23 |
| 30.6.13 | ADS-MANTEST (Recognize the Need and Reclose ADS Stage MOV)..... | 30-24 |
| 30.6.14 | CAN-MAN0S (Locally Close Manual Valve CAS-V204 to Isolate Containment) | 30-25 |
| 30.6.15 | CIT-MAN0S (Isolate Containment)..... | 30-26 |
| 30.6.16 | CMN-MAN01 (Actuate Core Makeup Tank)..... | 30-27 |
| 30.6.17 | CMN-REC01 (Actuate the Core Makeup Tanks)..... | 30-28 |
| 30.6.18 | CVN-MAN00 (Align Chemical and Volume Control System) | 30-29 |
| 30.6.19 | CVN-MAN02 (Align Chemical and Volume Control System) | 30-30 |
| 30.6.20 | CVN-MAN03 (Start Chemical and Volume Control System Pump B) | 30-30 |
| 30.6.21 | ADF-MAN01 (Depressurize the RCS to Refill the Pressurizer)..... | 30-31 |
| 30.6.22 | SGHL-MAN01 (Isolate Feedwater to Failed Steam Generator) | 30-32 |
| 30.6.23 | CAN-MAN01 (Start Standby Compressor) | 30-33 |
| 30.6.24 | REN-MAN02 (Initiate Recirculation)..... | 30-33 |
| 30.6.25 | REN-MAN03 (Initiate Recirculation)..... | 30-34 |
| 30.6.26 | IWN-MAN00 (Operate In-Containment Refueling Water Storage Tank Motor-Operated Valves)..... | 30-35 |
| 30.6.27 | RHN-MAN01 (Align Normal Residual Heat Removal System)..... | 30-36 |
| 30.6.28 | RHN-MANDIV (Align Normal Residual Heat Removal System)..... | 30-37 |
| 30.6.29 | RHN-MAN02/RHN-MAN03 (Align Normal Residual Heat Removal System)..... | 30-38 |
| 30.6.30 | PCN-MAN01 (Actuate Passive Containment Cooling System)..... | 30-40 |
| 30.6.31 | HPM-MAN01 (Diagnose Need for High Pressure Heat Removal)..... | 30-40 |
| 30.6.32 | PRN-MAN01 (Align Passive Residual Heat Removal System) | 30-41 |
| 30.6.33 | PRN-MAN02 (Align Passive Residual Heat Removal System) | 30-42 |
| 30.6.34 | PRN-MAN03 (Align Passive Residual Heat Removal System) | 30-43 |
| 30.6.35 | PRI-MAN01 (Isolate Failed Passive Residual Heat Removal Heat Exchanger) | 30-44 |
| 30.6.36 | REN-MAN04 (Initiate Recirculation)..... | 30-45 |
| 30.6.37 | RCN-MAN01 (Trip Reactor Coolant Pumps) | 30-46 |
| 30.6.38 | ATW-MAN01 (Manually Insert Control Rods)..... | 30-47 |
| 30.6.39 | ATW-MAN03 (Manually Trip the Reactor through Protection and Safety Monitoring System in One Minute) | 30-48 |
| 30.6.40 | ATW-MAN04 (Manually Trip the Reactor through Diverse Actuation System in One Minute) | 30-49 |
| 30.6.41 | ATW-MAN05 (Manually Trip the Reactor through Protection and Safety Monitoring System in Seven Minutes)..... | 30-49 |
| 30.6.42 | ATW-MAN06 (Manually Trip the Reactor through Diverse Actuation System In Seven Minutes)..... | 30-50 |
| 30.6.43 | RTN-MAN01 (Perform Controlled Reactor Shutdown)..... | 30-51 |
| 30.6.44 | FWN-MAN02 (Start the Startup Feedwater Pumps) | 30-52 |
| 30.6.45 | FWN-MAN03 (Start the Startup Feedwater Pumps) | 30-53 |
| 30.6.46 | REG-MAN00 (Regulate Startup Feedwater)..... | 30-54 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 30.6.47 | CIA-MAN01 (Isolate Failed Steam Generator) | 30-55 |
| 30.6.48 | CIB-MAN01 (Close Main Steam Isolation Valve) | 30-56 |
| 30.6.49 | SGA-MAN01 (Inadvertent Opening of Steam Generator Power-Operated Relief Valve) | 30-57 |
| 30.6.50 | SWN-MAN01N (Open Air-Operated Valve on Motor Strainer Line) | 30-58 |
| 30.6.51 | SWB-MAN02 (Start Standby Service Water Pump) | 30-58 |
| 30.6.52 | SWB-MAN02N (Start Standby Service Water Pump) | 30-59 |
| 30.6.53 | TCB-MAN01 (Start Standby Turbine Closed Cooling Water Pump) | 30-60 |
| 30.6.54 | TCB-MAN02 (Locally Align Standby Turbine Closed Cooling Water Heat Exchanger) | 30-61 |
| 30.6.55 | VLN-MAN01 (Actuate Hydrogen Control System) | 30-62 |
| 30.6.56 | VWN-MAN01 (Align Standby Chiller) | 30-63 |
| 30.6.57 | ATW-MAN11 (Recognize the Need for Manual Boration) | 30-64 |
| 30.6.58 | REC-MANDAS (Diagnosis of an Event Through DAS Signals or Perform an Activity by Operating DAS Controls) | 30-65 |
| 30.6.59 | RHN-MAN04 (Isolate the RNS During Shutdown Conditions) | 30-65 |
| 30.6.60 | RHN-MAN05 (Initiate Gravity Injection from IRWST via RNS Suction Line) | 30-66 |
| 30.6.61 | RHN-MAN06 (Recognize the Need and Throttle RNS Valve V011) | 30-68 |
| 30.6.62 | RCS-MANODS1 (Close AOVs CVS-V045 or -V047, Given Failure of HL Level Instruments) | 30-68 |
| 30.6.63 | RCS-MANODS2 (Close AOVs CVS-V045 or -V047, Given Failure of Valves to Close Automatically) | 30-70 |
| 30.6.64 | SWN-MAN03 (Recognize the Need and Locally Refill Service Water Basin) | 30-70 |
| 30.7 | Conditional Probability Evaluation | 30-71 |
| 30.7.1 | Application | 30-72 |
| 30.7.2 | Process Used to Determine Dependencies | 30-72 |
| 30.7.3 | Calculation of Dependent Human Error Probabilities | 30-72 |
| 30.8 | References | 30-74 |
| ATTACHMENT 30A HUMAN RELIABILITY ANALYSIS GUIDELINES | | 30A-1 |
| 30A.1 | Introduction | 30A-1 |
| 30A.2 | Schedule for Human Reliability Analysis | 30A-1 |
| 30A.3 | Methodology | 30A-1 |
| 30A.4 | Responsibility | 30A-2 |
| 30A.5 | Procedure for Human Interaction Evaluation | 30A-2 |
| 30A.5.1 | Type A | 30A-3 |
| 30A.5.2 | Type B | 30A-3 |
| 30A.5.3 | Type C | 30A-4 |
| 30A.5.4 | Commission Errors That Have Detrimental Effects | 30A-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|-------------|
| 30A.6 | Procedure for Human Error Probabilities Quantification | 30A-8 |
| | 30A.6.1 Basic Assumptions for Human Interaction Analysis..... | 30A-8 |
| 30A.7 | References..... | 30A-9 |
| CHAPTER 31 OTHER EVENT TREE NODE PROBABILITIES | | |
| 31.1 | Introduction..... | 31-1 |
| 31.2 | Identification of Cases Requiring Calculations | 31-1 |
| | 31.2.1 BL – Main Steam Line Break Occurs Inside Containment..... | 31-1 |
| | 31.2.2 CNB – Containment Isolation Fails Due to Reactor Coolant System Vessel Rupture..... | 31-1 |
| | 31.2.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-1 |
| | 31.2.4 NSGTR – Consequential Steam Generator Tube Rupture..... | 31-2 |
| | 31.2.5 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-2 |
| | 31.2.6 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-2 |
| | 31.2.7 PRSOV – Pressurizer Safety Valves Reclose | 31-2 |
| | 31.2.8 R05 – Offsite Power Recovered within One-Half Hour..... | 31-2 |
| | 31.2.9 SLSOV – Main Steam Line Relief Valves Reclose | 31-2 |
| 31.3 | Case-Specific Calculations..... | 31-3 |
| | 31.3.1 BL – Main Steam Line Break Occurs Inside Containment..... | 31-3 |
| | 31.3.2 CNB – Containment Isolation Fails Due to RCS Vessel Rupture..... | 31-3 |
| | 31.3.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-3 |
| | 31.3.4 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-4 |
| | 31.3.5 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-4 |
| | 31.3.6 PRSOV – Pressurizer Safety Valves Reclose | 31-5 |
| | 31.3.7 R05 – Offsite Power Recovered within One-Half Hour..... | 31-6 |
| | 31.3.8 SGTR1 – Single Consequential Steam Generator Tube Rupture..... | 31-6 |
| | 31.3.9 SGTR – Multiple Consequential Steam Generator Tube Rupture | 31-8 |
| | 31.3.10 SLSOV – Main Steam Line Relief and Safety Valves Reclose | 31-8 |
| | 31.3.11 SLSOV1 – Main Steam Line Relief and Safety Valves Reclose | 31-9 |
| | 31.3.12 SLSOV2 – Main Steam Line Safety Valves Reclose..... | 31-10 |
| | 31.3.13 SLSOV3 – Main Steamline Relief and Safety Valves Reclose, SGTR..... | 31-10 |
| 31.4 | References..... | 31-11 |
| CHAPTER 32 DATA ANALYSIS AND MASTER DATA BANK | | |
| 32.1 | Data Analysis | 32-1 |
| | 32.1.1 Random Component Failure Data..... | 32-1 |
| | 32.1.2 Test and Maintenance Unavailability..... | 32-2 |
| | 32.1.3 Common Cause Failure Data | 32-2 |
| | 32.1.4 Human Reliability Data | 32-2 |
| | 32.1.5 Initiating Event Frequency Data | 32-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| 32.2 | Master Data Bank..... | 32-2 |
| 32.2.1 | Initiating Event Frequencies | 32-3 |
| 32.2.2 | Random Component Failures..... | 32-3 |
| 32.2.3 | Common Cause Failure Probabilities..... | 32-3 |
| 32.2.4 | Human Error Probabilities | 32-3 |
| 32.2.5 | System-Specific Calculations..... | 32-3 |
| 32.2.6 | Other Event Tree Node Probabilities | 32-3 |
| 32.2.7 | Master Data Bank | 32-4 |
| 32.3 | References..... | 32-4 |
| CHAPTER 33 FAULT TREE AND CORE DAMAGE QUANTIFICATION | | |
| 33.1 | Introduction..... | 33-1 |
| 33.2 | Fault Tree Model Quantification | 33-1 |
| 33.3 | Event Tree Model Calculation | 33-1 |
| 33.3.1 | Core Damage Quantification Method | 33-2 |
| 33.3.2 | Core Damage Quantification Input Files and Data | 33-4 |
| 33.3.3 | Definition of Consequential Event Categories..... | 33-4 |
| 33.3.4 | Incorporate Operator Action Dependencies Into Plant Core Damage Frequency Quantification..... | 33-6 |
| 33.3.5 | Core Damage Frequency Results | 33-6 |
| CHAPTER 34 SEVERE ACCIDENT PHENOMENA TREATMENT | | |
| 34.1 | Introduction..... | 34-1 |
| 34.2 | Treatment of Physical Processes | 34-1 |
| 34.2.1 | In-Vessel Retention of Molten Core Debris..... | 34-1 |
| 34.2.2 | Fuel-Coolant Interaction (Steam Explosions) | 34-2 |
| 34.2.3 | Hydrogen Combustion and Detonation..... | 34-4 |
| 34.2.4 | High-Pressure Melt Ejection..... | 34-5 |
| 34.2.5 | Core Debris Coolability | 34-5 |
| 34.2.6 | Containment Pressurization from Decay Heat | 34-6 |
| 34.2.7 | Elevated Temperature (Equipment Survivability)..... | 34-7 |
| 34.2.8 | Summary..... | 34-7 |
| 34.3 | Analysis Method | 34-7 |
| 34.4 | Severe Accident Analyses..... | 34-8 |
| 34.4.1 | Accident Class 3BE – Intact Containment..... | 34-8 |
| 34.4.2 | Accident Class 3BE – Failed Containment..... | 34-10 |
| 34.4.3 | Accident Class 3BL – Intact Containment..... | 34-11 |
| 34.4.4 | Accident Class 3BR – Intact Containment..... | 34-12 |
| 34.4.5 | Accident Class 3C – Intact Containment | 34-13 |
| 34.4.6 | Accident Class 3C – Failed Containment | 34-14 |
| 34.4.7 | Accident Class 3D – Intact Containment..... | 34-14 |
| 34.4.8 | Accident Class 3D – Failed Containment | 34-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 34.4.9 | Accident Class 6E – Bypass Containment | 34-16 |
| 34.4.10 | Accident Class 6L – Bypass Containment | 34-17 |
| 34.4.11 | Accident Class 1AP | 34-17 |
| 34.4.12 | Accident Class 1A | 34-18 |
| 34.4.13 | Intermediate and Late Containment Failure Cases..... | 34-19 |
| 34.5 | Insights and Conclusions..... | 34-21 |
| 34.6 | References..... | 34-21 |
| | | |
| CHAPTER 35 | CONTAINMENT EVENT TREE ANALYSIS | |
| 35.1 | Introduction..... | 35-1 |
| 35.2 | Containment Event Tree – General Discussion..... | 35-1 |
| 35.3 | Event Tree Construction..... | 35-2 |
| 35.4 | Level 1/Level 2 Interface..... | 35-3 |
| 35.5 | Containment Event Tree Top Events | 35-3 |
| 35.5.1 | Severe Accident Phenomena Considerations..... | 35-3 |
| 35.5.2 | Operator Action and Systems Top-Event Considerations..... | 35-5 |
| 35.6 | Release Category Definitions | 35-7 |
| 35.6.1 | Release Category BP – Containment Bypass..... | 35-8 |
| 35.6.2 | Release Category CI – Containment Isolation Failure | 35-9 |
| 35.6.3 | Release Category CFE – Early Containment Failure | 35-9 |
| 35.6.4 | Release Category CFI – Intermediate Containment Failure..... | 35-9 |
| 35.6.5 | Release Category CFL – Late Containment Failure..... | 35-9 |
| 35.6.6 | Release Category CFV – Containment Venting..... | 35-10 |
| 35.6.7 | Release Category IC – Intact Containment | 35-10 |
| 35.7 | Top-Event Nodal Questions and Success Criteria..... | 35-10 |
| 35.7.1 | Top Event DP – RCS Depressurization After Core Uncovery..... | 35-11 |
| 35.7.2 | Top Event IS – Containment Isolation..... | 35-12 |
| 35.7.3 | Top Event IR – Reactor Cavity Flooding..... | 35-13 |
| 35.7.4 | Top Event RFL – Reflooding of a Degraded Core | 35-14 |
| 35.7.5 | Top Event VF – Debris Relocation to the Reactor Cavity | 35-14 |
| 35.7.6 | Top Event PC – Passive Containment Cooling..... | 35-15 |
| 35.7.7 | Top Event VNT – Containment Venting | 35-16 |
| 35.7.8 | Top Event IF – Intermediate Containment Failure..... | 35-16 |
| 35.7.9 | Top Event IG – Hydrogen Control System | 35-17 |
| 35.7.10 | Top Event DF – Diffusion Flame | 35-17 |
| 35.7.11 | Top Event DTE – Early Hydrogen Detonation | 35-18 |
| 35.7.12 | Top Event DFG – Hydrogen Deflagration..... | 35-19 |
| 35.7.13 | Top Event DTI – Intermediate Hydrogen Detonation..... | 35-19 |
| 35.8 | Summary..... | 35-20 |
| 35.9 | References..... | 35-20 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 36 REACTOR COOLANT SYSTEM DEPRESSURIZATION | | |
| 36.1 | Introduction..... | 36-1 |
| 36.2 | Definition of High Pressure..... | 36-1 |
| 36.3 | Node DP..... | 36-2 |
| 36.4 | Success Criteria..... | 36-2 |
| 36.4.1 | Accident Classes 3BE, 3BL, 3BR, 3C..... | 36-2 |
| 36.4.2 | Accident Class 3D/1D..... | 36-3 |
| 36.4.3 | Accident Classes 1A and 1AP..... | 36-3 |
| 36.4.4 | Steam Generator Tube Rupture – Accident Class 6..... | 36-4 |
| 36.4.5 | Anticipated Transient Without Scram – Accident Class 3A..... | 36-5 |
| 36.6 | References..... | 36-5 |
| CHAPTER 37 CONTAINMENT ISOLATION | | |
| 37.1 | Introduction..... | 37-1 |
| 37.2 | Definition of Containment Isolation..... | 37-1 |
| 37.3 | Success Criteria..... | 37-1 |
| 37.3.1 | Accident Classes 1A and 1AP..... | 37-2 |
| 37.3.2 | Accident Class 3A..... | 37-2 |
| 37.3.3 | Accident Class 3BR..... | 37-2 |
| 37.3.4 | Accident Class 3BE..... | 37-2 |
| 37.3.5 | Accident Class 3BL..... | 37-2 |
| 37.3.6 | Accident Class 3C..... | 37-2 |
| 37.3.7 | Accident Class 3D/1D..... | 37-3 |
| 37.3.8 | Accident Class 6..... | 37-3 |
| 37.4 | Summary..... | 37-3 |
| CHAPTER 38 REACTOR VESSEL REFLOODING | | |
| 38.1 | Introduction..... | 38-1 |
| 38.2 | Definition of Reflooding Success..... | 38-1 |
| 38.3 | Success Criteria..... | 38-1 |
| 38.3.1 | Accident Classes 1A and 1AP..... | 38-1 |
| 38.3.2 | Accident Class 3BR..... | 38-2 |
| 38.3.3 | Accident Class 3BE..... | 38-2 |
| 38.3.4 | Accident Class 3BL..... | 38-3 |
| 38.3.5 | Accident Class 3D/1D..... | 38-3 |
| 38.3.6 | Accident Class 6..... | 38-3 |
| 38.3.7 | Accident Class 3C..... | 38-3 |
| 38.3.8 | Accident Class 3A..... | 38-4 |
| 38.4 | Summary..... | 38-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 39 IN-VESSEL RETENTION OF MOLTEN CORE DEBRIS | | |
| 39.1 | Introduction..... | 39-1 |
| 39.2 | Background on the Application of IVR to the Passive Plant..... | 39-1 |
| 39.3 | Application of IVR to the AP1000 Passive Plant..... | 39-2 |
| 39.4 | Reactor Vessel Failure Criteria | 39-3 |
| 39.5 | In-Vessel Melt Progression and Relocation..... | 39-4 |
| 39.6 | Application of Heat Transfer Correlations to the AP1000 | 39-6 |
| | 39.6.1 Debris Pool to Vessel Wall Heat Transfer | 39-6 |
| | 39.6.2 Vessel Wall to External Cooling Water Heat Transfer | 39-7 |
| 39.7 | Quantification of Margin to Failure of the Reactor Vessel Wall | 39-8 |
| | 39.7.1 Zirconium Oxidation Fraction Input Probability Distribution..... | 39-9 |
| | 39.7.2 Steel Mass Input Probability Distribution | 39-9 |
| | 39.7.3 Final Bounding State Timing Input Probability Distribution | 39-10 |
| | 39.7.4 Critical Heat Flux..... | 39-10 |
| | 39.7.5 Results and Conclusions of Heat Flux Quantification | 39-10 |
| 39.8 | Reactor Coolant System Depressurization | 39-11 |
| 39.9 | Reactor Cavity Flooding (Node IR) | 39-11 |
| | 39.9.1 Node IR Success Criteria | 39-12 |
| | 39.9.2 Cavity Flooding Scenario Dependencies | 39-13 |
| 39.10 | Reactor Vessel Insulation Design Concept..... | 39-15 |
| | 39.10.1 Description of Reactor Vessel Insulation and Venting | 39-15 |
| | 39.10.2 Design Analysis of the Insulation and Support Frame | 39-17 |
| 39.11 | Reactor Vessel External Surface Treatment..... | 39-18 |
| 39.12 | Reactor Vessel Failure (Node VF) | 39-18 |
| | 39.12.1 Node VF Success Criteria..... | 39-18 |
| 39.13 | Summary | 39-19 |
| 39.14 | References..... | 39-19 |
| ATTACHMENT 39A AP1000 IN-VESSEL CORE MELTING RELOCATION | | |
| 39A.1 | Introduction..... | 39A-1 |
| 39A.2 | Phenomenological Issues | 39A-1 |
| | 39A.2.1 Focusing Effect..... | 39A-1 |
| | 39A.2.2 Material Interaction..... | 39A-1 |
| 39A.3 | AP1000 Reactor Vessel Lower Internals Geometry..... | 39A-1 |
| 39A.4 | Modeling of Core and Reactor Vessel Lower Internals Heatup | 39A-2 |
| | 39A.4.1 MAAP4 Model | 39A-2 |
| | 39A.4.2 Finite Difference Modeling..... | 39A-3 |
| | 39A.4.3 Relocation of In-Core Debris to Lower Plenum..... | 39A-3 |
| 39A-5 | Base Core Damage Sequence for In-Vessel Retention..... | 39A-3 |
| | 39A.5.1 Core Heatup and Formation of In-Core Molten Debris Layers..... | 39A-4 |
| | 39A.5.2 Melting of Core Shroud and Core Barrel | 39A-6 |
| | 39A.5.3 Initial Relocation of Molten Core Debris to Lower Plenum | 39A-7 |
| | 39A.5.4 Lower Plenum Debris Pool Formation..... | 39A-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 39A.6 | Potential for Debris Interaction | 39A-12 |
| 39A.7 | Conclusions from Analysis of AP1000 In-Vessel Core Melting and Relocation | 39A-12 |
| 39A.8 | References..... | 39A-13 |
| CHAPTER 40 | PASSIVE CONTAINMENT COOLING, LONG TERM CONTAINMENT INTEGRITY AND CONTAINMENT VENTING | |
| 40.1 | Passive Containment Cooling System..... | 40-1 |
| 40.2 | Passive Containment Cooling Water – Node PC | 40-2 |
| | 40.2.1 Node PC Success Criteria | 40-2 |
| | 40.2.2 Operator Action | 40-2 |
| | 40.2.3 Node PC Failure Probability..... | 40-3 |
| 40.3 | Containment Venting – Node VT | 40-3 |
| | 40.3.1 Venting Success Criteria..... | 40-3 |
| | 40.3.2 Venting Failure Probability..... | 40-4 |
| 40.4 | Intermediate Containment Failure – Node IF | 40-4 |
| | 40.4.1 Success Criterion | 40-5 |
| | 40.4.2 Intermediate Containment Failure Probability | 40-5 |
| 40.5 | References..... | 40-5 |
| CHAPTER 41 | HYDROGEN MIXING AND COMBUSTION ANALYSIS | |
| 41.1 | Discussion of the Issue..... | 41-1 |
| 41.2 | Controlling Phenomena..... | 41-2 |
| 41.3 | Major Assumptions and Phenomenological Uncertainties | 41-3 |
| | 41.3.1 Hydrogen Generation..... | 41-3 |
| | 41.3.2 Containment Pressure | 41-3 |
| | 41.3.3 Flammability Limits..... | 41-3 |
| | 41.3.4 Detonation Limits and Loads..... | 41-4 |
| | 41.3.5 Igniter System | 41-4 |
| | 41.3.6 Other Ignition Sources | 41-5 |
| | 41.3.7 Severe Accident Management Actions | 41-5 |
| 41.4 | Hydrogen Generation and Mixing..... | 41-5 |
| | 41.4.1 Accident Class 3BE – Failure of Gravity Injection..... | 41-6 |
| | 41.4.2 Accident Class 3BL – Failure of Gravity Recirculation..... | 41-9 |
| | 41.4.3 Accident Class 3BR – Large LOCA with Accumulator Failure | 41-10 |
| | 41.4.4 Accident Class 3C..... | 41-11 |
| | 41.4.5 Accident Classes 3D and 1D..... | 41-12 |
| | 41.4.6 Accident Class 1AP | 41-12 |
| | 41.4.7 Accident Class 1A | 41-13 |
| | 41.4.8 Accident Class 3A | 41-13 |
| | 41.4.9 Accident Class 6 | 41-13 |
| | 41.4.10 Overall Mixing Insights | 41-14 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|-------------|
| 41.5 | Hydrogen Burning at Igniters..... | 41-15 |
| 41.6 | Early Hydrogen Combustion..... | 41-15 |
| | 41.6.1 Hydrogen Generation Rates..... | 41-15 |
| | 41.6.2 Hydrogen Release Locations..... | 41-17 |
| | 41.6.3 Early Hydrogen Combustion Ignition Sources..... | 41-18 |
| 41.7 | Diffusion Flame Analysis – CET Node DF..... | 41-18 |
| | 41.7.1 AP1000 Diffusion Flame Mitigation Strategy..... | 41-19 |
| | 41.7.2 Node DF Containment Failure Probability Assignment..... | 41-20 |
| 41.8 | Early Hydrogen Detonation – Containment Event Tree Node DTE..... | 41-21 |
| | 41.8.1 Containment Success Criteria at Node DTE..... | 41-21 |
| | 41.8.2 Early Hydrogen Detonation Decomposition Event Tree..... | 41-22 |
| 41.9 | Deflagration in Time Frame 3..... | 41-23 |
| | 41.9.1 Containment Success Criterion at Node DFL..... | 41-23 |
| | 41.9.2 AICC Peak Pressure..... | 41-24 |
| | 41.9.3 Conditional Containment Failure Probability from Deflagration..... | 41-25 |
| 41.10 | Detonation in Intermediate Time Frame..... | 41-29 |
| | 41.10.1 Containment Success Criterion at Node DTI..... | 41-29 |
| | 41.10.2 Mixing and Stratification..... | 41-29 |
| | 41.10.3 Quantification of DTI Failure Probabilities..... | 41-30 |
| 41.11 | Safety Margin Basis Containment Performance Requirement..... | 41-30 |
| 41.12 | Summary..... | 41-31 |
| 41.13 | References..... | 41-31 |
| ATTACHMENT 41A AP1000 SPECIFIC MAAP4.04 ANALYSES..... | | 41A-1 |
| ATTACHMENT 41B ANALYSIS OF HYDROGEN BURNING AT IGNITERS..... | | 41B-1 |
| CHAPTER 42 CONDITIONAL CONTAINMENT FAILURE PROBABILITY DISTRIBUTION | | |
| 42.1 | Introduction..... | 42-1 |
| 42.2 | Probabilistic Model..... | 42-1 |
| 42.3 | Containment Failure Characteristics..... | 42-2 |
| | 42.3.1 Median Values for Containment Failure..... | 42-2 |
| | 42.3.2 Uncertainties in Containment Failure..... | 42-3 |
| 42.4 | Containment Failure Predictions..... | 42-4 |
| | 42.4.1 Containment Cylindrical Shell..... | 42-4 |
| | 42.4.2 Ellipsoidal Upper Head..... | 42-5 |
| | 42.4.3 Equipment Hatches..... | 42-5 |
| | 42.4.4 Personnel Airlock..... | 42-6 |
| 42.5 | Overall Failure Distribution..... | 42-6 |
| 42.6 | Summary and Conclusions..... | 42-7 |
| 42.7 | References..... | 42-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| CHAPTER 43 | RELEASE FREQUENCY QUANTIFICATION | |
| 43.1 | Introduction | 43-1 |
| 43.2 | Plant Damage State Frequency Calculations | 43-2 |
| 43.3 | Containment Event Tree Node Frequencies | 43-2 |
| | 43.3.1 CET Nodes | 43-2 |
| | 43.3.2 CET Node Probabilities From Boolean Expressions | 43-3 |
| | 43.3.3 Probabilities for Hydrogen-Related CET Nodes | 43-6 |
| | 43.3.4 Other CET Node Probabilities | 43-6 |
| 43.4 | Containment Event Tree Quantification..... | 43-7 |
| | 43.4.1 Containment Event Tree | 43-7 |
| | 43.4.2 Dominant CET Sequences | 43-7 |
| | 43.4.3 LRF Cutsets for Dominant Sequences | 43-7 |
| 43.5 | Summary of Results | 43-7 |
| 43.6 | Importance and Sensitivity Analyses..... | 43-8 |
| | 43.6.1 CET Event Node Importance Analysis | 43-8 |
| | 43.6.2 No Credit Taken for DP Node for PDS-6 | 43-8 |
| | 43.6.3 Lesser Reliability for Containment Isolation..... | 43-8 |
| | 43.6.4 Lesser Reliability for Hydrogen Igniters | 43-8 |
| | 43.6.5 Lesser Reliability for PCS..... | 43-9 |
| | 43.6.6 No Credit for Depressurization for High Pressure PDS | 43-9 |
| | 43.6.7 Set PDS-3C Vessel Failure Probability to 1.0..... | 43-9 |
| | 43.6.8 Set 3D and 1AP Diffusion Flame and Detonation Failure Probability to 1.0 | 43-9 |
| 43.7 | Other Importance and Sensitivity Analyses..... | 43-9 |
| | 43.7.1 Initiating Event Importances | 43-9 |
| | 43.7.2 Sensitivity to Standby Systems | 43-10 |
| | 43.7.3 Sensitivity to Standby Systems With Credit for Manual DAS | 43-10 |
| | 43.7.4 Treatment of PCS Annulus Drain Plugging in the AP1000 PRA | 43-10 |
| 43.8 | Conclusions and Insights..... | 43-11 |
| ATTACHMENT 43A | PDS CALCULATIONS | 43A-1 |
| ATTACHMENT 43B | DP NODE PROBABILITY FOR PDS..... | 43B-1 |
| ATTACHMENT 43C | EVALUATION OF OPERATOR ACTIONS..... | 43C-1 |
| ATTACHMENT 43D | EFFECT OF "PRE-EXISTING CONTAINMENT OPENING" ON LRF..... | 43D-1 |
| ATTACHMENT 43E | EFFECT OF CONTAINMENT AIR-COOLING FAILURE ON PLANT RISK | 43E-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 44 MAAP4 CODE DESCRIPTION AND AP1000 MODELING | | |
| 44.0 | MAAP Background..... | 44-1 |
| 44.1 | MAAP4..... | 44-1 |
| 44.2 | The AP1000 MAAP4 Modeling..... | 44-3 |
| 44.3 | Benchmarking..... | 44-5 |
| 44.4 | Summary and Conclusions..... | 44-6 |
| 44.5 | References..... | 44-7 |
| CHAPTER 45 FISSION-PRODUCT SOURCE TERMS | | |
| 45.1 | Summary of AP1000 Release Categories..... | 45-1 |
| 45.2 | Release Category Source Terms..... | 45-2 |
| 45.2.1 | Release Category IC..... | 45-2 |
| 45.2.2 | Release Category BP..... | 45-2 |
| 45.2.3 | Release Category CI..... | 45-2 |
| 45.2.4 | Release Category CFE..... | 45-3 |
| 45.2.5 | Release Category CFI..... | 45-3 |
| 45.2.6 | Release Category CFL..... | 45-3 |
| 45.2.7 | Release Category CFV..... | 45-4 |
| 45.3 | Direct-Release Sensitivity Case..... | 45-4 |
| 45.4 | Summary..... | 45-4 |
| 45.5 | References..... | 45-4 |
| CHAPTERS 46 THROUGH 48 NOT USED | | |
| CHAPTER 49 OFFSITE DOSE RISK QUANTIFICATION | | |
| 49.1 | Introduction..... | 49-1 |
| 49.2 | Conformance with Regulatory Requirements..... | 49-2 |
| 49.3 | Assumptions..... | 49-2 |
| 49.4 | Methodology..... | 49-2 |
| 49.5 | Dose Evaluation Results and Discussion..... | 49-5 |
| 49.6 | Quantification of Site Risk..... | 49-6 |
| 49.7 | Risk Quantification Results..... | 49-7 |
| 49.8 | References..... | 49-7 |
| CHAPTER 50 IMPORTANCE AND SENSITIVITY ANALYSES | | |
| 50.1 | Introduction..... | 50-1 |
| 50.2 | Importance Analyses for Core Damage..... | 50-1 |
| 50.2.1 | Initiating Event Importances..... | 50-2 |
| 50.2.2 | Accident Sequence Importances..... | 50-3 |
| 50.2.3 | End State Importances..... | 50-4 |
| 50.2.4 | Common Cause Failure Importances..... | 50-4 |
| 50.2.5 | Human Error Importances..... | 50-5 |
| 50.2.6 | Component Importances..... | 50-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 50.3 | System Importances for Core Damage | 50-7 |
| 50.4 | Human Error Sensitivity Analyses | 50-8 |
| 50.4.1 | Set HEPs to 1.0 (Failure) in Core Damage Output File | 50-9 |
| 50.4.2 | Set HEPs to 0.0 (Success) in Core Damage Output File | 50-10 |
| 50.4.3 | Set HEPs to 0.1 in Core Damage Output File | 50-10 |
| 50.5 | Other Sensitivity Analyses for Core Damage | 50-10 |
| 50.5.1 | Impact of Passive System Check Valves on Core Damage Frequency | 50-10 |
| 50.5.2 | Sensitivity to Squib Valve Failure Probability | 50-11 |
| 50.5.3 | Sensitivity to Circuit Breaker Failure Probability | 50-11 |
| 50.5.4 | Sensitivity to Standby Systems | 50-12 |
| 50.5.5 | Sensitivity to Standby Systems; Manual DAS Credited | 50-14 |
| 50.6 | Results | 50-15 |
| CHAPTER 51 UNCERTAINTY ANALYSIS | | |
| 51.1 | Introduction | 51-1 |
| 51.2 | Input Data/Error Factors | 51-2 |
| 51.3 | Input Files | 51-3 |
| 51.4 | Output Files | 51-3 |
| 51.5 | Sensitivity Analyses | 51-3 |
| 51.5.1 | Sensitivity to Simulation Parameters | 51-3 |
| 51.5.2 | Sensitivity to Key Basic Events | 51-3 |
| 51.5.3 | Sensitivity to Operator Actions | 51-4 |
| 51.6 | Summary of Results | 51-6 |
| 51.7 | References | 51-8 |
| ATTACHMENT 51A ASSIGNMENT OF ERROR FACTORS TO BASIC EVENT PROBABILITIES | | |
| | | 51A-1 |
| ATTACHMENT 51B @RISK UNCERTAINTY ANALYSIS RESULTS | | |
| | | 51B-1 |
| CHAPTERS 52 AND 53 NOT USED | | |
| CHAPTER 54 LOW-POWER AND SHUTDOWN RISK ASSESSMENT | | |
| 54.1 | Introduction | 54-1 |
| 54.2 | Data Analysis | 54-2 |
| 54.3 | Initiating Event Analysis | 54-3 |
| 54.4 | Event Tree/Mitigation System Evaluation | 54-3 |
| 54.5 | Common Cause Analysis Update for AP1000 | 54-3 |
| 54.6 | Human Reliability Assessment for AP1000 | 54-5 |
| 54.7 | Core Damage Quantification | 54-6 |
| 54.7.1 | Discussion of Results | 54-9 |
| 54.8 | Estimation of Shutdown Large Release Frequency | 54-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 54.9 | Sensitivity Analyses | 54-10 |
| 54.9.1 | Case 1 – Minimum Equipment per Tech Specs During Drained Conditions..... | 54-10 |
| 54.9.2 | Case 2 – No Credit for Standby Nonsafety Systems | 54-11 |
| 54.9.3 | Case 3 – HEPs Set Equal to 0.5 | 54-12 |
| 54.9.4 | Case 4 – No Credit for Standby Nonsafety Systems – Credit for Manual DAS | 54-12 |
| 54.9.5 | Case 5 – Assessment of Containment Closure Failure Probability | 54-13 |
| 54.10 | Conclusions..... | 54-17 |
| 54.11 | Reference | 54-17 |
| | | |
| CHAPTER 55 | AP1000 SEISMIC MARGINS EVALUATION | |
| 55.1 | Seismic Margin HCLPF Methodology..... | 55-1 |
| 55.2 | Calculation of HCLPF Values..... | 55-1 |
| 55.2.1 | Seismic Margin HCLPF Methodology..... | 55-1 |
| 55.2.2 | Calculation of HCLPF Values | 55-2 |
| 55.3 | Seismic Margin Model..... | 55-11 |
| 55.3.1 | Major SMA Model Assumptions..... | 55-11 |
| 55.3.2 | Seismic Initiating Events | 55-12 |
| 55.3.3 | Initiating Event Category HCLPFs | 55-13 |
| 55.4 | Calculation of Plant HCLPF | 55-16 |
| 55.4.1 | HCLPFs for Basic Events | 55-16 |
| 55.4.2 | Calculation of Initiating Event HCLPFs..... | 55-17 |
| 55.5 | Results and Insights..... | 55-17 |
| 55.5.1 | AP1000 SMA Results..... | 55-17 |
| 55.5.2 | AP1000 SMA Insights..... | 55-18 |
| 55.6 | References..... | 55-20 |
| | | |
| CHAPTER 56 | INTERNAL FLOODING ANALYSIS | |
| 56.1 | Introduction..... | 56-1 |
| 56.1.1 | Definitions | 56-1 |
| 56.2 | Methodology | 56-1 |
| 56.2.1 | Summary of Methodology | 56-1 |
| 56.2.2 | Information Collection..... | 56-2 |
| 56.2.3 | Initial Screening Assessment | 56-2 |
| 56.2.4 | Detailed Screening Assessment | 56-4 |
| 56.2.5 | Identification of Flood-Induced Initiating Events | 56-5 |
| 56.2.6 | Initiating Event Frequencies | 56-6 |
| 56.3 | Assumptions..... | 56-6 |
| 56.3.1 | General Flooding Analysis Assumptions and Engineering Judgments | 56-6 |
| 56.3.2 | AP1000-Specific Assumptions | 56-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 56.4 | Information Collection | 56-10 |
| 56.4.1 | PRA-Modeled Equipment and Locations | 56-10 |
| 56.4.2 | Identification of Areas for Flooding Evaluation..... | 56-10 |
| 56.5 | At-Power Operations..... | 56-10 |
| 56.5.1 | Initial Screening Assessment | 56-11 |
| 56.5.2 | Detailed Screening Assessment | 56-11 |
| 56.5.3 | Identification of Flood-Induced Initiating Events | 56-26 |
| 56.5.4 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-29 |
| 56.5.5 | Quantification of At-Power Flood-Induced Events..... | 56-36 |
| 56.6 | Internal Flooding During Low-Power and Shutdown Conditions | 56-38 |
| 56.6.1 | Detailed Screening Assessment | 56-38 |
| 56.6.2 | Identification of Flood-Induced Initiating Events | 56-39 |
| 56.6.3 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-40 |
| 56.6.4 | Quantification of Shutdown Internal Flooding Scenario CDFs | 56-45 |
| 56.6.5 | Total Shutdown Flooding Core Damage Frequency | 56-47 |
| 56.6.6 | Seismically Induced Flooding..... | 56-47 |
| 56.6.7 | Flooding Hazards During Refueling Outages | 56-47 |
| 56.6.8 | Summary of Results | 56-47 |
| 56.7 | Large Release Frequency Estimates for Internal Flooding | 56-48 |
| 56.8 | Results of AP1000 Internal Flooding Analysis | 56-49 |
| CHAPTER 57 FIRE RISK ASSESSMENT | | |
| 57.1 | Introduction..... | 57-1 |
| 57.2 | Qualitative Analysis | 57-1 |
| 57.2.1 | AP600 Qualitative Analysis..... | 57-1 |
| 57.2.2 | AP1000 Qualitative Analysis..... | 57-5 |
| 57.2.3 | AP1000 Fire Areas | 57-6 |
| 57.3 | Initiating Event Frequencies..... | 57-6 |
| 57.3.1 | Introduction..... | 57-6 |
| 57.3.2 | Methodology..... | 57-7 |
| 57.3.3 | Results for Plant Except Containment and the Main Control Room..... | 57-7 |
| 57.3.4 | Results for the Containment..... | 57-7 |
| 57.3.5 | Results for the Main Control Room..... | 57-7 |
| 57.4 | Development of Fire Scenarios | 57-10 |
| 57.4.1 | Spurious Actuation Model | 57-11 |
| 57.4.2 | Propagation Model..... | 57-14 |
| 57.4.3 | Fire Suppression Model..... | 57-15 |
| 57.4.4 | Operation Actions | 57-15 |
| 57.4.5 | Development of Fire Scenarios..... | 57-16 |
| 57.5 | Calculation of Conditional Core Damage Probabilities (CCDP)..... | 57-22 |
| 57.6 | Calculation of CDF from Fire Events | 57-23 |
| 57.6.1 | Calculation of Plant Fire CDF | 57-23 |
| 57.6.2 | Comments on Plant Areas..... | 57-23 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| | 57.6.3 Importances of Fire Areas | 57-25 |
| | 57.6.4 Conclusion | 57-27 |
| 57.7 | Sensitivity Studies | 57-27 |
| | 57.7.1 Manual Fire Suppression Systems | 57-27 |
| | 57.7.2 Sensitivity Analysis of the Probability of a Spurious Actuation of ADS Valves..... | 57-27 |
| | 57.7.3 Sensitivity of Human Action on Fire | 57-28 |
| | 57.7.4 Sensitivity Analysis on Ignition Frequencies | 57-28 |
| | 57.7.5 Sensitivity Analysis on ADS Actuation by DAS | 57-29 |
| | 57.7.6 Sensitivity Analysis on 1E to Non-1E Separation in the Containment..... | 57-29 |
| | 57.7.7 Sensitivity Analysis to Area to Area Propagation | 57-30 |
| | 57.7.8 Importance of Hot Shorts..... | 57-30 |
| 57.8 | Shutdown Fire Analysis | 57-30 |
| | 57.8.1 Introduction..... | 57-30 |
| | 57.8.2 Evaluation of AP1000 Shutdown Risk (Non-Drained Conditions)..... | 57-33 |
| | 57.8.3 Evaluation for Drained Shutdown Operations | 57-37 |
| | 57.8.4 Evaluation of Main Control Room..... | 57-40 |
| 57.9 | Conclusion and Insights | 57-40 |
| | 57.9.1 At-Power Analysis..... | 57-40 |
| | 57.9.2 Shutdown Fire Analysis..... | 57-41 |
| | 57.9.3 Conclusions..... | 57-42 |
| 57.10 | References..... | 57-42 |
| ATTACHMENT 57A CALCULATION OF SCENARIO CCDPs | | 57A-1 |
| | 57A.1 Calculation of Scenario CCDPs | 57A-1 |
| | 57A.2 Calculation of Scenario CCDPs for Overly Conservative Cases..... | 57A-3 |
| ATTACHMENT 57B MODELING OF OPERATOR ACTIONS IN FIRE SCENARIOS | | 57B-1 |
| | 57B.1 Calculation of Failure Probability of OPA-01 | 57B-1 |
| | 57B.2 Calculation of Failure Probability of OPA-02..... | 57B-3 |
| | 57B.3 Operator Actions at Remote Shutdown Panel | 57B-6 |
| | 57B.4 More Reliable REC-MANDAS | 57B-6 |
| ATTACHMENT 57C FIRE AREA EVENT TREES DEFINING SCENARIOS | | 57C-1 |
| ATTACHMENT 57D AP1000 POTENTIAL FOR FIRE-INDUCED SPURIOUS ACTUATION OF FUNCTIONS THAT RESULT IN A BREACH OF HIGH/LOW PRESSURE BOUNDARY | | 57D-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 58 WINDS, FLOODS, AND OTHER EXTERNAL EVENTS | | |
| 58.1 | Introduction | 58-1 |
| 58.2 | External Events Analysis..... | 58-1 |
| | 58.2.1 Severe Winds and Tornadoes..... | 58-1 |
| | 58.2.2 External Floods | 58-2 |
| | 58.2.3 Transportation and Nearby Facility Accidents..... | 58-2 |
| 58.3 | Conclusion | 58-2 |
| 58.4 | References..... | 58-3 |
| CHAPTER 59 PRA RESULTS AND INSIGHTS | | |
| 59.1 | Introduction | 59-1 |
| 59.2 | Use of PRA in the Design Process | 59-3 |
| 59.3 | Core Damage Frequency from Internal Initiating Events at Power | 59-4 |
| | 59.3.1 Dominant Core Damage Sequences..... | 59-6 |
| | 59.3.2 Component Importances for At-Power Core Damage Frequency | 59-7 |
| | 59.3.3 System Importances for At-Power Core Damage..... | 59-8 |
| | 59.3.4 System Failure Probabilities for At-Power Core Damage..... | 59-9 |
| | 59.3.5 Common Cause Failure Importances for At-Power Core Damage..... | 59-9 |
| | 59.3.6 Human Error Importances for At-Power Core Damage | 59-9 |
| | 59.3.7 Accident Class Importances..... | 59-10 |
| | 59.3.8 Sensitivity Analyses Summary for At-Power Core Damage | 59-11 |
| | 59.3.9 Summary of Important Level 1 At-Power Results | 59-12 |
| 59.4 | Large Release Frequency for Internal Initiating Events at Power..... | 59-15 |
| | 59.4.1 Dominant Large Release Frequency Sequences..... | 59-15 |
| | 59.4.2 Summary of Important Level 2 At-Power Results | 59-16 |
| 59.5 | Core Damage and Severe Release Frequency from Events at Shutdown | 59-19 |
| | 59.5.1 Summary of Shutdown Level 1 Results | 59-19 |
| | 59.5.2 Large Release Frequency for Shutdown and Low-Power Events | 59-22 |
| | 59.5.3 Shutdown Results Summary | 59-22 |
| 59.6 | Results from Internal Flooding, Internal Fire, and Seismic Margin Analyses..... | 59-23 |
| | 59.6.1 Results of Internal Flooding Assessment..... | 59-23 |
| | 59.6.2 Results of Internal Fire Assessment | 59-24 |
| | 59.6.3 Results of Seismic Margin Analysis | 59-25 |
| 59.7 | Plant Dose Risk From Release of Fission-Products | 59-26 |
| 59.8 | Overall Plant Risk Results..... | 59-26 |
| 59.9 | Plant Features Important to Reducing Risk..... | 59-27 |
| | 59.9.1 Reactor Design..... | 59-28 |
| | 59.9.2 Systems Design..... | 59-28 |
| | 59.9.3 Instrumentation and Control Design | 59-31 |
| | 59.9.4 Plant Layout..... | 59-32 |
| | 59.9.5 Containment Design | 59-32 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 59.10 | PRA Input to Design Certification Process | 59-36 |
| 59.10.1 | PRA Input to Reliability Assurance Program | 59-36 |
| 59.10.2 | PRA Input to Tier 1 Information..... | 59-36 |
| 59.10.3 | PRA Input to MMI/Human Factors/Emergency Response Guidelines | 59-36 |
| 59.10.4 | Summary of PRA Based Insights..... | 59-37 |
| 59.10.5 | Combined License Information..... | 59-37 |
| 59.11 | References..... | 59-38 |
| APPENDIX A | THERMAL HYDRAULIC ANALYSIS TO SUPPORT SUCCESS CRITERIA | A-1 |
| APPENDIX B | EX-VESSEL SEVERE ACCIDENT PHENOMENA | B-1 |
| APPENDIX C | ADDITIONAL ASSESSMENT OF AP1000 DESIGN FEATURES..... | C-1 |
| APPENDIX D | EQUIPMENT SURVIVABILITY ASSESSMENT..... | D-1 |
| APPENDIX E | AP1000 PRA FAULT TREE PICTURES FOR LEVEL 1 ANALYSIS FOR EVENTS AT POWER OPERATION | E-1 |

LIST OF TABLES

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 2-1 | Internal Initiating Event Grouping Plant Systems and Equipment Available for Transient/Accident Conditions (Sheets 1 – 10)..... | 2-28 |
| 2-2 | NUREG/CR 3862 Initiator Categories (Sheets 1 – 4)..... | 2-38 |
| 2-3 | NUREG/CR 3862 Initiator Categories not Considered in the AP1000 PRA Analysis..... | 2-42 |
| 2-4 | AP1000 Internal Initiating Event Frequencies (Sheets 1 – 3) | 2-43 |
| 2-5 | Initiating Event Frequencies Used in Event Trees Quantification..... | 2-46 |
| 2A-1 | Summary of Primary System Piping Data | 2A-2 |
| 2A-2 | Summary of Primary System Pipe Break Frequency Quantification | 2A-3 |
| 2A-3 | Summary of Steam Generator Tube Rupture Events..... | 2A-4 |
| 2A-4 | Spurious Stuck-Open Pressurizer Safety Valve..... | 2A-5 |
| 2A-5 | Interface Break on Accumulator Lines..... | 2A-6 |
| 2A-6 | Interface Break on IRWST Injection Lines..... | 2A-7 |
| 2A-7 | Initiating Events Review Data Summary (Sheets 1 – 8)..... | 2A-8 |
| 2B-1 | Summary of Main Steam Line and Feedwater Line Piping Data for Secondary Side Break Frequency Quantification | 2B-2 |
| 2B-2 | Secondary Side Line Break Frequency Quantification..... | 2B-3 |
| 2B-3 | Stuck-Open Main Steam Line Safety Valve Frequency Quantification (Sheets 1 – 2) | 2B-4 |
| 3-1 | Loss of CCS/SWS Initiating Event Fault Tree CSWF Success Criteria Summary | 3-8 |
| 3-2 | Spurious Actuation of Automatic Depressurization Failure Criteria Summary | 3-9 |
| 3-3 | Evaluation of Spurious Automatic Depressurization System Frequencies (Sheets 1 – 6) | 3-10 |
| 4-1 | AP1000 Large LOCA Event End State Summary..... | 4-112 |
| 4-2 | AP1000 Spurious ADS Actuation Event End State Summary..... | 4-112 |
| 4-3 | AP1000 Medium LOCA Event End State Summary | 4-113 |
| 4-4 | AP1000 CMT Line Break LOCA Event End State Summary..... | 4-114 |
| 4-5 | AP1000 SI Line Break Event End State Summary | 4-115 |
| 4-6 | AP1000 Small LOCA Event End State Summary..... | 4-116 |
| 4-7 | AP1000 RCS Leak Event End State Summary | 4-117 |
| 4-8 | AP1000 PRHR Tube Rupture Event End State Summary | 4-117 |
| 4-9 | AP1000 SGTR Event End State Summary | 4-118 |
| 4-10 | AP1000 Vessel Rupture Event End State Summary | 4-119 |
| 4-11 | AP1000 Interfacing Systems LOCA Event End State Summary..... | 4-119 |
| 4-12 | AP1000 Transients with MFW Event End State Summary..... | 4-120 |
| 4-13 | AP1000 Transients with Loss of RCS Flow Event End State Summary..... | 4-121 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 4-14 | AP1000 Transients with Loss of MFW to One SG Event End State Summary | 4-122 |
| 4-15 | AP1000 Transients with Core Power Excursion Event End State Summary | 4-123 |
| 4-16 | AP1000 Transients with Loss of CCW/SW Event End State Summary | 4-124 |
| 4-17 | AP1000 Transients without Main Feedwater Event End State Summary | 4-125 |
| 4-18 | AP1000 Transients with Loss of Condenser Event End State Summary..... | 4-126 |
| 4-19 | AP1000 Transients with Loss of Compressed Air Event End State Summary..... | 4-127 |
| 4-20 | AP1000 Loss of Offsite Power Event End State Summary..... | 4-128 |
| 4-21 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-129 |
| 4-22 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-130 |
| 4-23 | AP1000 Stuck Open Secondary Side Safety Valve Event End State Summary | 4-131 |
| 4-24 | AP1000 ATWS Precursor without MFW Event End State Summary..... | 4-132 |
| 4-25 | AP1000 ATWS Precursor with SI Event End State Summary..... | 4-133 |
| 4-26 | AP1000 ATWS Precursor Transients with MFW Event End State Summary | 4-134 |
| 4A-1 | End States (Plant Damage States) | 4A-17 |
| 4A-2 | Summary of Systems Associated with Mitigating Functions for AP1000..... | 4A-18 |
| 5-1 | AP1000 Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-2 | AP1000 Non Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-3 | AP1000 Support Systems Interdependency Matrix (Sheets 1 – 14)..... | 5-4 |
| 5-4 | AP1000 Safety-Related Front Line Plant Systems Letter Designators | 5-18 |
| 5-5 | AP1000 Non Safety-Related Front Line Plant Systems Letter Designators | 5-18 |
| 5-6 | AP1000 Front Line System Dependencies Matrix (Sheets 1 – 18) | 5-19 |
| 6-1 | Summary of Event Tree Top Events Success Criteria (Internal Initiating Events at Power Cases) (Sheets 1 – 34) | 6-20 |
| 6-2 | Summary of Success Criteria for the Mitigating Systems (Sheets 1 – 9) | 6-54 |
| 6-3 | Summary of Success Criteria for Operator Actions and Mission Times (Sheets 1 – 4) | 6-68 |
| 7-1 | Example for Fault Tree XXX Success Criteria Summary | 7-15 |
| 7-2 | Example for System Dependency Matrix | 7-15 |
| 7-3 | Example for Component Test Assumptions | 7-16 |
| 7-4 | Example for Component Maintenance Assumptions | 7-16 |
| 7-5 | Example for Operator Actions and Misposition Analysis Summary | 7-16 |
| 7-6 | Fault Tree Identification Codes (Sheets 1 – 3) | 7-17 |
| 7-7 | System Identification Codes for Basic Events (Sheets 1 – 3)..... | 7-20 |
| 7-8 | Component Identification Codes (Sheets 1 – 7)..... | 7-23 |
| 7-9 | Failure Mode Identification Codes (Sheets 1 – 3) | 7-30 |
| 8-1 | List of Passive Residual Heat Removal System Fault Trees | 8-7 |
| 8-2a | Fault Tree “PRT” Success Criteria..... | 8-8 |
| 8-2b | Fault Tree “PRTA” Success Criteria..... | 8-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 8-2c | Fault Tree "PRL" Success Criteria..... | 8-10 |
| 8-2d | Fault Tree "PRP" Success Criteria..... | 8-11 |
| 8-2e | Fault Tree "PRS" Success Criteria..... | 8-12 |
| 8-2f | Fault Tree "PRW" Success Criteria..... | 8-13 |
| 8-2g | Fault Tree "PRI" Success Criteria..... | 8-14 |
| 8-3 | System Dependency Matrix..... | 8-15 |
| 8-4 | Component Test Assumptions..... | 8-16 |
| 8-5 | Component Maintenance Assumptions..... | 8-17 |
| 8-6 | Operator Actions and Misposition Analysis Summary..... | 8-18 |
| 8-7 | Common Cause Failures Summary..... | 8-19 |
| 8-8 | Basic Events Database for the PRHR System Fault Trees (Sheets 1 – 3)..... | 8-20 |
| 9-1 | List of System Fault Trees..... | 9-9 |
| 9-2a | Fault Tree CM2AB Success Criteria Summary..... | 9-10 |
| 9-2b | Fault Tree CM2SL Success Criteria Summary..... | 9-11 |
| 9-2c | Fault Tree CM2L Success Criteria Summary..... | 9-12 |
| 9-2d | Fault Tree CM2P Success Criteria Summary..... | 9-13 |
| 9-2e | Fault Tree CM1A Success Criteria Summary..... | 9-14 |
| 9-2f | Fault Tree CM2LLT Success Criteria Summary..... | 9-15 |
| 9-2g | Fault Tree CMBOTH Success Criteria Summary..... | 9-16 |
| 9-2h | Fault Tree CM2LA Success Criteria Summary..... | 9-17 |
| 9-3 | Notes Related to System Fault Tree Assumptions..... | 9-18 |
| 9-4 | System Dependency Matrix..... | 9-18 |
| 9-5 | Component Test Assumptions..... | 9-19 |
| 9-6 | Component Maintenance Assumptions..... | 9-19 |
| 9-7 | Operator Actions and Misposition Analysis Summary..... | 9-20 |
| 9-8 | Common Cause Failure Analysis Summary..... | 9-20 |
| 9-9 | Fault Tree Basic Events for Core Makeup Tank Subsystem (Sheets 1 – 3)..... | 9-21 |
| 10-1 | List of System Fault Trees..... | 10-5 |
| 10-2a | Fault Tree AC2AB Success Criteria Summary..... | 10-6 |
| 10-2b | Fault Tree AC1A Success Criteria Summary..... | 10-7 |
| 10-2c | Fault Tree ACBOTH Success Criteria Summary..... | 10-8 |
| 10-3 | Notes Related to System Fault Tree Assumptions..... | 10-9 |
| 10-4 | System Dependency Matrix..... | 10-9 |
| 10-5 | Component Test Assumptions..... | 10-9 |
| 10-6 | Component Maintenance Assumptions..... | 10-10 |
| 10-7 | Operator Actions and Misposition Analysis Summary..... | 10-10 |
| 10-8 | Common Cause Failure Analysis Summary..... | 10-10 |
| 10-9 | Fault Tree Basic Events for Accumulator Subsystem..... | 10-11 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 11-1a | List of ADS System Fault Trees (Sheets 1 – 2)..... | 11-8 |
| 11-1b | List of ADS System Fault Trees (for Plant Damage States Analysis)..... | 11-10 |
| 11-2a | ADS Success Criteria Versus Accident Conditions (Full Depressurization)..... | 11-11 |
| 11-2b | ADS Success Criteria Versus Accident Conditions (Partial Depressurization)..... | 11-12 |
| 11-2c | Automatic Depressurization System Fault Tree Summary (For Plant Damage States)..... | 11-13 |
| 11-2d | Fault Tree “ADA” Success Criteria | 11-13 |
| 11-2e | Fault Tree “ADAB” Success Criteria..... | 11-14 |
| 11-2f | Fault Tree “ADAL” Success Criteria | 11-15 |
| 11-2g | Fault Tree “ADB” Success Criteria..... | 11-15 |
| 11-2h | Fault Tree “ADL” Success Criteria..... | 11-16 |
| 11-2i | Fault Tree “ADM” Success Criteria..... | 11-16 |
| 11-2j | Fault Tree “ADMA” Success Criteria..... | 11-17 |
| 11-2k | Fault Tree “ADQ” Success Criteria | 11-17 |
| 11-2l | Fault Tree “ADS” Success Criteria | 11-18 |
| 11-2m | Fault Tree “ADT” Success Criteria..... | 11-18 |
| 11-2n | Fault Tree “ADW” Success Criteria..... | 11-19 |
| 11-2o | Fault Tree “AD1” Success Criteria | 11-19 |
| 11-2p | Fault Tree “AD1A” Success Criteria | 11-20 |
| 11-2q | Fault Tree “ADF” Success Criteria | 11-20 |
| 11-2r | Fault Tree “ADR” Success Criteria..... | 11-21 |
| 11-2s | Fault Tree “ADRA” Success Criteria..... | 11-21 |
| 11-2t | Fault Tree “ADU” Success Criteria | 11-22 |
| 11-2u | Fault Tree “ADUM” Success Criteria..... | 11-22 |
| 11-2v | Fault Tree “ADV” Success Criteria | 11-23 |
| 11-2w | Fault Tree “ADZ” Success Criteria..... | 11-23 |
| 11-2x | Fault Tree “ADQLT” Data Summary | 11-24 |
| 11-2y | Fault Tree “ADTLT” Success Criteria..... | 11-24 |
| 11-3 | Notes Related to ADS System Fault Tree Assumptions..... | 11-25 |
| 11-4 | System Dependencies Matrix | 11-26 |
| 11-5 | Component Test Assumptions..... | 11-27 |
| 11-6 | Component Maintenance Assumptions | 11-27 |
| 11-7 | Failure Probabilities Calculated | 11-27 |
| 11-8 | Operator Action Analysis Summary..... | 11-28 |
| 11-9 | Common Cause Failures Summary | 11-28 |
| 11-10 | Basic Events Data Base for the ADA System Fault Tree (Sheets 1 – 20)..... | 11-29 |
| 12-1 | List of System Fault Trees (FT) | 12-10 |
| 12-2a | Fault Tree “IW2AB” Success Criteria Summary | 12-11 |
| 12-2b | Fault Tree “IW2ABM” Success Criteria Summary..... | 12-12 |
| 12-2c | Fault Tree “IW2ABA” Success Criteria Summary | 12-13 |
| 12-2d | Fault Tree “IW2ABP” Success Criteria Summary..... | 12-14 |
| 12-2e | Fault Tree “IW2ABPM” Success Criteria Summary..... | 12-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 12-2f | Fault Tree "IW2ABB" Success Criteria Summary..... | 12-16 |
| 12-2g | Fault Tree "IW2ABBM" Success Criteria Summary..... | 12-17 |
| 12-2h | Fault Tree "IW1A" Success Criteria Summary..... | 12-18 |
| 12-2i | Fault Tree "IW1AM" Success Criteria Summary..... | 12-19 |
| 12-2j | Fault Tree "IWF" Success Criteria Summary..... | 12-20 |
| 12-2k | Fault Tree "RECIRC" Success Criteria Summary..... | 12-21 |
| 12-2l | Fault Tree "RECIRCP" Success Criteria Summary..... | 12-22 |
| 12-2m | Fault Tree "RECIRCB" Success Criteria Summary..... | 12-23 |
| 12-2n | Fault Tree "RECIRC1" Success Criteria Summary..... | 12-24 |
| 12-2o | Fault Tree "RECIRC1P" Success Criteria Summary..... | 12-25 |
| 12-2p | Fault Tree "RECIRC1B" Success Criteria Summary..... | 12-26 |
| 12-3 | System Dependency Matrix..... | 12-27 |
| 12-4 | Component Test Assumptions..... | 12-28 |
| 12-5 | Component Maintenance Assumptions..... | 12-28 |
| 12-6 | Failure Probabilities Calculated..... | 12-29 |
| 12-7 | Operator Actions and Misposition Analysis Summary..... | 12-29 |
| 12-8 | Common Cause Failure Analysis Summary..... | 12-30 |
| 12-9 | Fault Tree Basic Events (Sheets 1 – 11)..... | 12-31 |
| 13-1 | List of System Fault Trees..... | 13-7 |
| 13-2 | Fault Tree PCT Success Criteria Summary..... | 13-7 |
| 13-3 | Notes Related to System Fault Trees Assumptions..... | 13-7 |
| 13-4 | System Dependency Matrix..... | 13-8 |
| 13-5 | Component Test Assumptions..... | 13-8 |
| 13-6 | Component Maintenance Assumptions..... | 13-9 |
| 13-7 | Operator Actions and Misposition Analysis Summary..... | 13-9 |
| 13-8 | Common Cause Failure Analysis Summary..... | 13-9 |
| 13-9 | Fault Tree Basic Events for Passive Containment Cooling System..... | 13-10 |
| 14-1 | List of System Fault Trees (At-Power)..... | 14-8 |
| 14-2.a | Success Criteria Summary Fault Tree "FWT"..... | 14-9 |
| 14-2.b | Success Criteria Summary Fault Tree "FWF"..... | 14-10 |
| 14-2.c | Success Criteria Summary Fault Tree "SFWT"..... | 14-11 |
| 14-2.d | Success Criteria Summary Fault Tree "SFW"..... | 14-12 |
| 14-2.e | Success Criteria Summary Fault Tree "SFW1"..... | 14-13 |
| 14-2.f | Success Criteria Summary Fault Tree "SFWP"..... | 14-14 |
| 14-2.g | Success Criteria Summary Fault Tree "SFWM"..... | 14-15 |
| 14-2.h | Success Criteria Summary Fault Tree "SFWA"..... | 14-16 |
| 14-2.i | Success Criteria Summary Fault Tree "COND"..... | 14-17 |
| 14-2.j | Success Criteria Summary Fault Tree "COND1"..... | 14-18 |
| 14-2.k | Success Criteria Summary Fault Tree "CDS"..... | 14-19 |
| 14-2.l | Success Criteria Summary Fault Tree "TCCW"..... | 14-20 |
| 14-3 | Notes to System Fault Tree Assumptions..... | 14-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 14-4 | System Dependency Matrix (Sheets 1 – 2)..... | 14-22 |
| 14-5 | Component Test Assumptions..... | 14-24 |
| 14-6 | Component Maintenance Assumptions..... | 14-25 |
| 14-7 | Failure Probabilities Calculated in this Section..... | 14-25 |
| 14-8 | Operator Action Analysis Summary..... | 14-26 |
| 14-9 | Common Cause Failure (CCF) Summary..... | 14-27 |
| 14-10 | Fault Tree Basic Event for Main and Startup Feedwater System (Sheets 1 – 9)..... | 14-28 |
| 15-1 | List of System Fault Trees..... | 15-9 |
| 15-2a | Fault Tree CSBOR1 Success Criteria Summary..... | 15-10 |
| 15-2b | Fault Tree CVS1 Success Criteria Summary..... | 15-11 |
| 15-2c | Fault Tree CSAX Success Criteria Summary..... | 15-12 |
| 15-2d | Fault Tree SGHL Success Criteria Summary..... | 15-13 |
| 15-2e | Fault Tree CSP Success Criteria Summary..... | 15-14 |
| 15-3 | Notes Related to System Fault Tree Assumptions..... | 15-15 |
| 15-4 | System Dependency Matrix..... | 15-16 |
| 15-5 | Component Test Assumptions..... | 15-17 |
| 15-6 | Component Maintenance Assumptions..... | 15-18 |
| 15-7 | Operator Actions and Misposition Analysis Summary..... | 15-19 |
| 15-8 | Common Cause Failure Analysis Summary..... | 15-20 |
| 15-9 | Fault Tree Basic Events for Chemical and Volume Control System (Sheets 1 – 4)..... | 15-21 |
| 16-1 | List of System Fault Trees..... | 16-5 |
| 16-2 | Fault Tree VLH Success Criteria Summary..... | 16-5 |
| 16-3 | Notes Related to System Fault Tree Assumptions..... | 16-5 |
| 16-4 | System Dependency Matrix..... | 16-6 |
| 16-5 | Component Test Assumptions..... | 16-6 |
| 16-6 | Component Maintenance Assumptions..... | 16-6 |
| 16-7 | Operator Actions and Misposition Analysis Summary..... | 16-7 |
| 16-8 | Common Cause Failure Analysis Summary..... | 16-7 |
| 16-9 | Fault Tree Basic Events for Containment Hydrogen Control System..... | 16-8 |
| 17-1 | List of System Fault Trees..... | 17-7 |
| 17-2 | Fault Tree Success Criteria Summary (Sheets 1 – 2)..... | 17-8 |
| 17-3 | Notes Related to System Fault Tree Assumptions..... | 17-10 |
| 17-4 | System Dependencies Matrix..... | 17-11 |
| 17-5 | Component Test Assumptions..... | 17-12 |
| 17-6 | Component Maintenance Assumptions..... | 17-12 |
| 17-7 | Operator Actions and System Misposition Analysis Summary..... | 17-13 |
| 17-8 | Common Cause Failure Summary..... | 17-13 |
| 17-9 | Fault Tree Basic Events for Normal Residual Heat Removal System (Sheets 1 – 5)..... | 17-14 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 18-1 | List of System Fault Trees..... | 18-6 |
| 18-2a | Fault Tree CCN Success Criteria Summary | 18-6 |
| 18-2b | Fault Tree CCT Success Criteria Summary..... | 18-7 |
| 18-2c | Fault Tree CCP Success Criteria Summary..... | 18-7 |
| 18-3 | Notes Related to System Fault Tree Assumptions..... | 18-8 |
| 18-4 | System Dependency Matrix | 18-8 |
| 18-5 | Component Test Assumptions..... | 18-9 |
| 18-6 | Component Maintenance Assumptions..... | 18-9 |
| 18-7 | Operator Actions and Misposition Analysis Summary..... | 18-10 |
| 18-8 | Common Cause Failure Analysis Summary..... | 18-10 |
| 18-9 | Fault Tree Basic Events for Component Cooling Water System (Sheets 1 – 2)..... | 18-11 |
| 19-1 | List of System Fault Trees..... | 19-6 |
| 19-2a | Fault Tree SWN Success Criteria Summary | 19-6 |
| 19-2b | Fault Tree SWT Success Criteria Summary..... | 19-7 |
| 19-2c | Fault Tree SWP Success Criteria Summary..... | 19-7 |
| 19-3 | Notes Related to System Fault Tree Assumptions..... | 19-8 |
| 19-4 | System Dependency Matrix | 19-9 |
| 19-5 | Component Test Assumptions..... | 19-10 |
| 19-6 | Component Maintenance Assumptions..... | 19-10 |
| 19-7 | Operator Actions and Misposition Analysis Summary..... | 19-11 |
| 19-8 | Common Cause Failure Analysis Summary..... | 19-11 |
| 19-9 | Fault Tree Basic Events for Service Water System (Sheets 1 – 4) | 19-12 |
| 20-1 | List of System Fault Trees..... | 20-5 |
| 20-2 | Fault Tree VWH Success Criteria Summary..... | 20-5 |
| 20-3 | Notes Related to System Fault Tree Assumptions..... | 20-5 |
| 20-4 | System Dependency Matrix | 20-6 |
| 20-5 | Component Test Assumptions..... | 20-7 |
| 20-6 | Component Maintenance Assumptions..... | 20-7 |
| 20-7 | Operator Actions and Misposition Analysis Summary..... | 20-8 |
| 20-8 | Common Cause Failure Analysis Summary..... | 20-8 |
| 20-9 | Fault Tree Basic Events for Central Chilled Water System (Sheets 1 – 2)..... | 20-9 |
| 21-1 | List of System Fault Trees (Sheets 1 – 3)..... | 21-9 |
| 21-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 21-12 |
| 21-3 | Notes Related to System Fault Tree Assumptions (Sheets 1 – 3)..... | 21-28 |
| 21-4 | System Dependency Matrix | 21-31 |
| 21-5 | Component Test Assumptions..... | 21-31 |
| 21-6 | Component Maintenance Assumptions..... | 21-32 |
| 21-7 | Operator Actions and Misposition Analysis Summary..... | 21-32 |
| 21-8 | Common Cause Failure Analysis Summary..... | 21-32 |
| 21-9 | Fault Tree Basic Events for AC Power System (Sheets 1 – 22)..... | 21-33 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 22-1 | List of System Fault Trees (Sheets 1 – 4)..... | 22-6 |
| 22-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 22-10 |
| 22-3 | Notes Related to System Fault Tree Assumptions..... | 22-26 |
| 22-4 | Systems Dependency Matrix | 22-26 |
| 22-5 | Component Test Assumptions..... | 22-27 |
| 22-6 | Component Maintenance Assumptions..... | 22-27 |
| 22-7 | Operator Actions and Misposition Analysis Summary..... | 22-27 |
| 22-8 | Common Cause Failure Analysis Summary..... | 22-28 |
| 22-9 | Fault Tree Basic Events for Class 1E DC and UPS System (Sheets 1 – 12)..... | 22-29 |
| 22-10 | System Power Requirements/Dependencies (Sheets 1 – 11)..... | 22-41 |
| 23-1 | List of System Fault Trees (Sheets 1 – 3)..... | 23-6 |
| 23-2 | Fault Tree Success Criteria Summary (Sheets 1 – 10) | 23-9 |
| 23-3 | Notes Related to System Fault Tree Assumptions..... | 23-19 |
| 23-4 | System Dependency Matrix | 23-19 |
| 23-5 | Component Test Assumptions..... | 23-20 |
| 23-6 | Component Maintenance Assumptions..... | 23-20 |
| 23-7 | Operator Actions and Misposition Analysis Summary..... | 23-20 |
| 23-8 | Common Cause Failure Analysis Summary..... | 23-21 |
| 23-9 | Fault Tree Basic Events for Non-Class 1E DC and UPS Power System (Sheets 1 – 20)..... | 23-22 |
| 24-1 | AP1000 Containment Penetration List (Sheets 1 – 4)..... | 24-7 |
| 24-2 | Screening Analysis Evaluation (Sheets 1 – 5)..... | 24-16 |
| 24-3 | Containment Penetrations Not Screened Out for Normal Operation at Power Analysis..... | 24-21 |
| 24-4 | List of System Fault Trees..... | 24-21 |
| 24-5a | Fault Tree CIC Success Criteria Summary..... | 24-22 |
| 24-5b | Fault Tree CIA Success Criteria Summary..... | 24-22 |
| 24-5c | Fault Tree CIB Success Criteria Summary..... | 24-23 |
| 24-6 | Notes Related to System Fault Tree Assumptions..... | 24-23 |
| 24-7 | System Dependency Matrix (Sheets 1 – 3)..... | 24-24 |
| 24-8 | Component Test Assumptions..... | 24-27 |
| 24-9 | Component Maintenance Assumptions..... | 24-27 |
| 24-10 | Operator Actions and Misposition Analysis Summary..... | 24-28 |
| 24-11 | Common Cause Failure Analysis Summary..... | 24-28 |
| 24-12 | Fault Tree Basic Events for Containment Isolation System (Sheets 1 – 3) | 24-29 |
| 25-1 | List of System Fault Trees..... | 25-8 |
| 25-2a | Fault Tree CAIAIR Success Criteria Summary..... | 25-9 |
| 25-2b | Fault Tree CAIR Success Criteria Summary..... | 25-9 |
| 25-2c | Fault Tree CAIAIRP Success Criteria Summary..... | 25-10 |
| 25-2d | Fault Tree ENDCAIAI Success Criteria Summary | 25-10 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 25-2e | Fault Tree ENDCAIAP Success Criteria Summary | 25-11 |
| 25-2f | Fault Tree CASF Success Criteria Summary | 25-11 |
| 25-3 | Notes Related to System Fault Tree Assumptions..... | 25-12 |
| 25-4 | System Dependency Matrix | 25-12 |
| 25-5 | Component Test Assumptions..... | 25-12 |
| 25-6 | Component Maintenance Assumptions..... | 25-13 |
| 25-7 | Operator Actions and Misposition Analysis Summary..... | 25-13 |
| 25-8 | Common Cause Failure Analysis Summary..... | 25-13 |
| 25-9 | Fault Tree Basic Events for Instrument Air Subsystem (Sheets 1 – 4)..... | 25-14 |
| 26-1 | List of System Fault Trees..... | 26-25 |
| 26-2a | Fault Tree RTPMS, and RTPMS1 Success Criteria Summary | 26-26 |
| 26-2b | Fault Tree RTSTP Success Criteria Summary | 26-26 |
| 26-2c | Fault Tree RCL Success Criteria Summary..... | 26-27 |
| 26-2d.1 | Fault Tree RCT Success Criteria Summary..... | 26-27 |
| 26-2d.2 | Fault Tree RCN Success Criteria Summary | 26-28 |
| 26-2e | I&C Subtree Success Criteria Summary (Sheets 1 – 98)..... | 26-29 |
| 26-3a | PMS I&C Subtree Constructions (Sheets 1 – 19)..... | 26-127 |
| 26-3b | Representative PMS I&C Subtree Plot Listing (Sheets 1 – 14)..... | 26-146 |
| 26-4 | PMS Dependency Matrix (Sheets 1 – 3)..... | 26-160 |
| 26-5 | PMS Components Test Assumptions | 26-163 |
| 26-6 | Component Maintenance Assumptions..... | 26-163 |
| 26-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 5)..... | 26-164 |
| 26-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 3) | 26-169 |
| 26-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2)..... | 26-172 |
| 26-10a | Fault Tree Basic Events for Reactor Trip System (Sheets 1 – 4)..... | 26-174 |
| 26-10b | Fault Tree Basic Events for the I&C Subsystem (Sheets 1 – 49) | 26-178 |
| 26-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3)..... | 26-227 |
| 27-1 | List of System Fault Trees..... | 27-9 |
| 27-2a | Fault Tree DAS Success Criteria Summary | 27-9 |
| 27-2b | Fault Tree DAS1 Success Criteria Summary | 27-9 |
| 27-3 | Notes Related to System Fault Tree Assumptions..... | 27-10 |
| 27-4 | System Dependency Matrix | 27-10 |
| 27-5 | Component Test Assumptions..... | 27-10 |
| 27-6 | Component Maintenance Assumptions..... | 27-10 |
| 27-7 | Operator Actions and Misposition Analysis Summary..... | 27-10 |
| 27-8 | Common Cause Failure Analysis Summary..... | 27-11 |
| 27-9 | Fault Tree Basic Events for Diverse Actuation System..... | 27-12 |
| 28-1 | List of System Fault Trees..... | 28-20 |
| 28-2 | Fault Tree Success Criteria Summary (Sheets 1 – 22) | 28-21 |
| 28-3 | PLS I&C Subtree Constructions (Sheets 1 – 9)..... | 28-43 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 28-4 | PLS Dependency Matrix (Sheets 1 – 2) | 28-52 |
| 28-5 | PLS Components Test Assumptions | 28-54 |
| 28-6 | Component Maintenance Assumptions | 28-54 |
| 28-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 3) | 28-55 |
| 28-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 2) | 28-58 |
| 28-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2) | 28-60 |
| 28-10 | Fault Tree Basic Events for I&C Subsystem (Sheets 1 – 68) | 28-62 |
| 28-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3) | 28-130 |
| 28-12 | Assignments of Plant Systems to Logic Cabinets | 28-133 |
| 28-13 | Assignments of Plant Systems to the Control Group Cabinets | 28-134 |
| 29-1 | Electrical Components with Low CCF Rate | 29-18 |
| 29-2 | Common-Cause Failure Calculations (Sheets 1 – 5) | 29-19 |
| 29-3 | Simplification of Q_K/Q_T Equations | 29-24 |
| 29A-1 | Extreme Environmental Conditions (Generic Causes of Dependent Failures) Excerpted from the ANS/IEEE PRA Procedures Guide (NUREG-2300) | 29A-11 |
| 29A-2 | Common-Cause Failures Among Systems | 29A-12 |
| 29A-3 | Common-Cause Failure Equations for MGL Method | 29A-13 |
| 30-1 | AP1000 Human Error Probability Summary Results (Sheets 1 – 16) | 30-75 |
| 30-2 | Manual DAS Actuation (Sheets 1 – 2) | 30-91 |
| 30-3 | Dependency Level Evaluation Summary (Sheets 1 – 14) | 30-93 |
| 30-4 | Dependency Level Evaluation (Sheets 1 – 3) | 30-107 |
| 30-5 | List of Acronyms | 30-110 |
| 30A-1 | Analyst Responsibility Based on Sharp Steps | 30A-10 |
| 30A-2 | Summary of Screening Values | 30A-11 |
| 30A-3 | Example of Operator Action Definition | 30A-12 |
| 30A-4 | HEP Data Bank (Sheets 1 – 5) | 30A-13 |
| 31-1 | Summary of Event Tree Scalar Probabilities | 31-12 |
| 32-1 | Generic Data Base (Sheets 1 – 13) | 32-5 |
| 32-2 | Test and Maintenance Outage Generic Data | 32-21 |
| 32-3 | Test and Maintenance Unavailabilities Used in AP1000 Core Damage Quantification | 32-22 |
| 32-4 | Common Cause Factors (Sheets 1 – 5) | 32-23 |
| 32-5 | SIMON.OUT File (Sheets 1 – 21) | 32-29 |
| 33-1 | Summary of AP1000 System Fault Tree Failure Probabilities (Sheets 1 – 13) | 33-7 |
| 33-2 | Example Accident Sequence Definitions for Large LOCA | 33-20 |
| 33-3 | AP1000 PRA Dominant CDF Cutsets (Sheets 1 – 10) | 33-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 33-4 | AP1000 PRA Dominant CDF Sequences (Sheets 1 – 18) | 33-31 |
| 33-5 | Contribution of Initiating Events to Plant Core Damage Frequency | 33-49 |
| 33-6 | List of Basic Events and Their Descriptions (Sheets 1 – 33) | 33-50 |
| 34-1 | Post-Accident Monitoring Equipment (Sheets 1 – 2)..... | 34-23 |
| 34-2 | Level 1 Accident Class..... | 34-25 |
| 34-3 | Summary of Release Categories..... | 34-26 |
| 34-4 | 3BE-1 Event Summary..... | 34-27 |
| 34-5 | 3BE-2 Event Summary..... | 34-28 |
| 34-6 | 3BE-4 Event Summary..... | 34-29 |
| 34-7 | 3BE-5 Event Summary..... | 34-30 |
| 34-8 | 3BE-6 Event Summary..... | 34-31 |
| 34-9 | 3BE-7 Event Summary..... | 34-32 |
| 34-10 | 3BE-3 Event Summary..... | 34-33 |
| 34-11 | 3BL-1 Event Summary..... | 34-34 |
| 34-12 | 3BL-2 Event Summary..... | 34-35 |
| 34-13 | 3BR-1 Event Summary | 34-36 |
| 34-14 | 3BR-1a Event Summary..... | 34-37 |
| 34-15 | 3C-1 Event Summary | 34-38 |
| 34-16 | 3C-2 Event Summary | 34-39 |
| 34-17 | 3D-1 Event Summary..... | 34-40 |
| 34-18 | 3D-2 Event Summary..... | 34-41 |
| 34-19 | 3D-3 Event Summary..... | 34-42 |
| 34-20 | 3D-4 Event Summary..... | 34-43 |
| 34-21 | 6E-1 Event Summary | 34-44 |
| 34-22 | 6L-1 Event Summary | 34-45 |
| 34-23 | 1AP-1 Event Summary..... | 34-46 |
| 34-24 | 1AP-2 Event Summary..... | 34-47 |
| 34-25 | 1A-1 Event Summary..... | 34-48 |
| 34-26 | 1A-2 Event Summary..... | 34-49 |
| 34-27 | CFI Event Summary..... | 34-50 |
| 34-28 | CFL Event Summary..... | 34-51 |
| 35-1 | Functional Definitions of Level 1 Accident Classes | 35-21 |
| 35-2 | CET Initial Conditions for Level 1 Accident Classes..... | 35-22 |
| 35-3 | Containment Event Tree Nodal Questions | 35-23 |
| 35-4 | Summary of Release Category Definitions..... | 35-24 |
| 35-5 | Summary of Containment Event Tree Success Criteria (Sheets 1 – 3)..... | 35-25 |
| 35-6 | Summary of Operator Actions Credited on Containment Event Tree | 35-28 |
| 36-1 | Summary Table for RCS Depressurization (CET Node DP)..... | 36-6 |
| 37-1 | Summary Table for Containment Isolation (CET Node IS) | 37-4 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 38-1 | Summary Table for Reflooding (CET Node RFL)..... | 38-5 |
| 39-1 | Material Inventories in AP1000 Reactor Vessel..... | 39-21 |
| 39-2 | Summary Table for Reactor Cavity Flooding (CET Node IR)..... | 39-22 |
| 39-3 | Summary Table for Debris Relocation to Cavity (CET Node VF)..... | 39-22 |
| 39A-1 | Core and Lower Internals Material Inventories in AP1000 Reactor Vessel | 39A-14 |
| 39A-2a | Mass and Power Distributions of Debris Layers in Top-Skewed Power Shape Case | 39A-15 |
| 39A-2b | Mass and Power Distributions of Debris Layers in Chopped Cosine Power Shape Case | 39A-16 |
| 39A-3a | Results of Top-Skewed Power Shape Case | 39A-17 |
| 39A-3b | Relocation Results of the Chopped Cosine Power Shape Case | 39A-18 |
| 39A-4 | Material Properties Used in In-Vessel Melting and Relocation Calculation | 39A-19 |
| 39A-5 | Debris Relocation Time Line | 39A-20 |
| 40-1 | Summary of Nodal Failure Probabilities | 40-6 |
| 40-2 | Nominal and Bounding Containment Failure Probability at 24 and 72 Hours | 40-6 |
| 41-1 | Containment Event Tree IG Nodal Failure Probability | 41-33 |
| 41-2 | Containment Event Tree Nodal Failure Probabilities | 41-33 |
| 41-3 | AP600 Scenario Dependencies for Early Detonation Analysis | 41-34 |
| 41-4 | Safety Margin Basis Containment Performance Requirement | 41-35 |
| 41A-1 | Summary of System Assumptions for AP1000 MAAP4.04 Hydrogen Analyses (Sheets 1 – 7) | 41A-2 |
| 41A-2 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses | 41A-10 |
| 41A-3 | Summary of Early Compartment Gas Composition Results For MAAP4 Hydrogen Mixing Analyses..... | 41A-10 |
| 41A-4 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-11 |
| 41A-5 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses | 41A-11 |
| 41A-6 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-7 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-8 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses | 41A-13 |
| 41A-9 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-14 |
| 41A-10 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-15 |
| 41A-11 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses | 41A-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 41A-12 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-13 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-14 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-17 |
| 41A-15 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-17 |
| 41A-16 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-18 |
| 41A-17 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-18 |
| 41A-18 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-19 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-20 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-20 |
| 41A-21 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-20 |
| 41A-22 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-21 |
| 41A-23 | Sequence 1A-3a | 41A-22 |
| 41A-24 | Sequence 1A-4a | 41A-23 |
| 41A-25 | Sequence 1AP-3..... | 41A-24 |
| 41A-26 | Sequence 1AP-4..... | 41A-25 |
| 41A-27 | Sequence 3D-1 | 41A-26 |
| 41A-28 | Sequence 3D-2..... | 41A-27 |
| 41A-29 | Sequence 3D-3..... | 41A-28 |
| 41A-30 | Sequence 3D-5..... | 41A-29 |
| 41A-31 | Sequence 3BL-1..... | 41A-30 |
| 41A-32 | Sequence 3BL-2..... | 41A-31 |
| 41A-33 | Sequence 3C-1 | 41A-32 |
| 41A-34 | Sequence 3BR-1a..... | 41A-33 |
| 41A-35 | Sequence 3BE-1..... | 41A-34 |
| 41A-36 | Sequence 3BE-2..... | 41A-35 |
| 41A-37 | Sequence 3BE-4..... | 41A-36 |
| 41A-38 | Sequence 3BE-5..... | 41A-37 |
| 41A-39 | Sequence 3BE-6..... | 41A-38 |
| 41A-40 | Sequence 3BE-8..... | 41A-39 |
| 41A-41 | Sequence 3BE-9..... | 41A-40 |
| 42-1 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 400°F..... | 42-9 |
| 42-2 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 331°F..... | 42-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 42-3 | Cumulative Containment Failure Probability, Temperature = 400°F | 42-10 |
| 42-4 | Cumulative Containment Failure Probability, Temperature = 331°F | 42-11 |
| 43-1 | Accident Class Frequencies | 43-13 |
| 43-2 | Boolean Expressions to Calculate Q1-Q29 | 43-14 |
| 43-3 | CET Node Probabilities (Sheets 1 – 3) | 43-15 |
| 43-4 | Boolean Expressions for P1-P15 | 43-18 |
| 43-5 | Contribution of PDS to LRF (Sheets 1 – 3) | 43-19 |
| 43-6 | Dominant CET Sequences Contributing to LRF (Sheets 1 – 69)..... | 43-22 |
| 43-7 | Summary of Release Frequency Calculations (Sheets 1 – 2) | 43-91 |
| 43-8 | LRF and Containment Effectiveness by Accident Class | 43-93 |
| 43-9 | Summary of AP1000 LRF Quantification for Internal Events At-Power | 43-94 |
| 43-10 | CET Event Tree Node Importances | 43-95 |
| 43-11 | Contribution of Initiating Events to Large Release | 43-96 |
| 43-12 | LRF Sensitivity Case – Non Credit for Standby Non-Safety Systems (Sheets 1 – 9) | 43-97 |
| 43-13 | LRF Cutsets for the Case – Sensitivity to Standby Systems With Credit for Manual DAS (Sheets 1 – 13)..... | 43-106 |
| 43A-1 | AP1000 PRA Dominant CDF Sequences for At-Power Events (Sheets 1 – 6)..... | 43A-2 |
| 43A-2 | AP1000 PRA PDS Frequencies for At-Power Events..... | 43A-8 |
| 43B-1 | Calculation of Failure Probability of DP for PDS 6 (Sheets 1 – 7)..... | 43B-2 |
| 43C-1 | Evaluation of CET-Related Operator Actions..... | 43C-2 |
| 44-1 | MAAP Model Benchmarks (Sheets 1 – 4)..... | 44-8 |
| 45-1 | Environmental Release Fractions at 24 Hours After Core Damage Per Release Category..... | 45-5 |
| 45-2 | Environmental Release Fractions at 72 Hours After Core Damage Per Release Category..... | 45-6 |
| 49-1 | AP1000 Source Terms from Level 2 Analysis (MAAP)..... | 49-9 |
| 49-2 | AP1000 Source Terms for Dose Evaluation (MACCS2)..... | 49-10 |
| 49-3 | Site Boundary Whole Body Dose [Effective Dose Equivalent (EDE)], Sieverts | 49-11 |
| 49-4 | Site Boundary Thyroid Dose, Sieverts | 49-12 |
| 49-5 | Population Whole Body Dose [Effective Dose Equivalent (EDE)], 0-80.5 km Person-Sieverts | 49-13 |
| 49-6 | Site Boundary Red Marrow Dose (Total Acute), Sieverts..... | 49-14 |
| 49-7 | Dose Summary | 49-15 |
| 49-8 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 49-16 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 49-9 | Site Boundary Whole Body EDE Dose Risk – 72 Hours | 49-17 |
| 49-10 | Population Whole Body EDE Dose Risk – 24 Hours..... | 49-18 |
| 49-11 | Population Whole Body EDE Dose Risk – 72 Hours..... | 49-19 |
| 50-1 | Core Damage for At-Power Events Contribution of Initiating Events to Plant Core Damage Frequency | 50-16 |
| 50-2 | Core Damage for At-Power Events Conditional Core Damage Probability of Initiating Events | 50-17 |
| 50-3 | AP1000 PRA Core Damage for At-Power Events Accident Sequence Importances (Sheets 1 – 5)..... | 50-18 |
| 50-4 | Core Damage for At-Power Events End State Importances | 50-23 |
| 50-5 | Common Cause Importances – Risk Decrease (Sheets 1 – 2)..... | 50-24 |
| 50-6 | Common Cause Importances – Risk Increase (Sheets 1 – 3) | 50-26 |
| 50-7 | Human Error Risk Importances – Risk Decrease (Sheets 1 – 2) | 50-29 |
| 50-8 | Human Error Risk Importances – Risk Increase (Sheets 1 – 2)..... | 50-31 |
| 50-9 | Component Importances – Risk Decrease (Sheets 1 – 2)..... | 50-33 |
| 50-10 | Component Importances – Risk Increase (Sheets 1 – 4) | 50-35 |
| 50-11 | List of Systems for System Importance Analyses (Sheets 1 – 4)..... | 50-39 |
| 50-12 | System Importance Calculation Results (Sheets 1 – 2) | 50-43 |
| 50-13 | Systems Grouped by PRA System Importance..... | 50-45 |
| 50-14 | Operator Actions in “CMTOT.OUT” File | 50-46 |
| 50-15 | Contribution of IEVs to Core Damage Frequency | 50-47 |
| 50-16 | Case 29 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-48 |
| 50-17 | Case 30 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-50 |
| 50-18 | Case 31 – Top 50 Dominant Cutsets (Sheets 1 – 3)..... | 50-52 |
| 50-19 | Passive System Check Valves in “CMTOT.OUT” File | 50-55 |
| 50-20 | Sensitivity Case 36 – Contribution of Initiating Events to CDF..... | 50-56 |
| 50-21 | Sensitivity Case 36 – Top 50 CDF Cutsets (Sheets 1 – 8) | 50-57 |
| 50-22 | Risk Importances Sorted by Basic Event Identification (Sheets 1 – 13)..... | 50-65 |
| 50-23 | Risk Importances Sorted by Risk Increase (Sheets 1 – 15) | 50-78 |
| 50-24 | Risk Importances Sorted by Risk Decrease (Sheets 1 – 15)..... | 50-93 |
| 50-25 | Risk Increases Sorted by Slope (Birnbaum) Importance (Sheets 1 – 13)..... | 50-108 |
| 51-1 | Summary of Results of AP1000 PRA Uncertainty Analysis for Internal Initiating Events at Power | 51-9 |
| 51-2 | List of Input Cutset Files..... | 51-10 |
| 51A-1 | Basic Event Uncertainties (Sheets 1 – 32) | 51A-3 |
| 54-1 | AP1000 Initiating Event Frequencies During Shutdown Conditions..... | 54-18 |
| 54-2 | AP1000 Design Impact on AP600 Shutdown Model..... | 54-19 |
| 54-3 | Times for Loss of RNS at Mid-loop Without IRWST Injection..... | 54-20 |
| 54-4 | AP1000 & AP600 Initiating Event CDF Contributions | 54-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 54-5 | AP600 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-22 |
| 54-6 | AP1000 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-47 |
| 54-7 | Basic Event Probabilities Revised in Case 1 | 54-72 |
| 54-8 | Revised CCF Basic Event Probabilities (Sheets 1 – 2) | 54-73 |
| 54-9 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 1 | 54-75 |
| 54-9A | Dominant CDF Cutsets for Drained Conditions Only for AP1000 Shutdown PRA Sensitivity Case 1 (Sheets 1 – 24) | 54-76 |
| 54-10 | AP1000 Shutdown PRA Sensitivity Case 2 CDF Cutsets (Sheets 1 – 5)..... | 54-100 |
| 54-11 | List of Basic Events “Dropped” to Make the Sensitivity Case 2 | 54-105 |
| 54-12 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 2 | 54-106 |
| 54-13 | Shutdown PRA Sensitivity Case 3 (Sheets 1 – 28) | 54-107 |
| 54-14 | Basic Events Whose Probabilities are Changed in Case 3 | 54-135 |
| 54-15 | AP1000 Shutdown PRA Sensitivity Case 4 CDF Cutsets (Sheets 1 – 7)..... | 54-136 |
| 54-16 | List of Basic Events “Dropped” to Make the Sensitivity Case 4 | 54-143 |
| 54-17 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 4 | 54-144 |
| 54-18 | AP1000 Shutdown PRA Basic Event Risk Importances – RAW (Sheets 1 – 8)..... | 54-145 |
| 54-19 | AP1000 Shutdown PRA Basic Event Risk Importances – RRW (Sheets 1 – 3)..... | 54-153 |
| 54-20 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RAW (Sheets 1 – 4) | 54-156 |
| 54-21 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RRW (Sheets 1 – 2) | 54-160 |
| 55-1 | Seismic Margin HCLPF Values (Sheets 1 – 4) | 55-21 |
| 55-2 | Basic Event HCLPF Values (Sheets 1 – 3) | 55-25 |
| 55-3 | EQ-IEV-STRUC HCLPF | 55-28 |
| 55-4 | EQ-IEV-RVFA HCLPF | 55-28 |
| 55-5 | EQ-IEV-LLOCA HCLPF | 55-29 |
| 55-6 | EQ-IEV-SLOCA HCLPF | 55-29 |
| 55-7 | EQ-IEV-ATWS HCLPF | 55-29 |
| 56-1 | Flooding Analysis Initial Screening Results (Sheets 1 – 3)..... | 56-50 |
| 56-2 | At-Power Detailed Screening Results (Sheets 1 – 5) | 56-53 |
| 56-3 | At-Power Flooding-Induced Core Damage Frequency Quantification Summary Results (Sheets 1 – 6)..... | 56-58 |
| 56-4 | Power Upgrade Difference Between AP1000 and AP600 | 56-64 |
| 56-5 | Shutdown Flooding PRA | 56-65 |
| 56-6 | Shutdown Initiating Event CCDPs..... | 56-66 |
| 57-1 | AP1000 Fire Areas Excluding the Containment (Sheets 1 – 6) | 57-43 |
| 57-2 | AP1000 Fire Areas in the Containment (Sheets 1 – 2)..... | 57-49 |
| 57-3 | Fire Ignition Frequencies for AP1000 Fire Areas (Sheets 1 – 4) | 57-51 |
| 57-4 | Fire Ignition Frequencies for AP1000 Containment Fire Area | 57-58 |
| 57-5 | Fire Barrier Failure Probabilities..... | 57-61 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 57-6 | Automatic Suppression System Reliability | 57-62 |
| 57-7 | Summary of Qualitative Evaluation Results – Power Operation – Plant except Containment and Main Control Room (Sheets 1 – 15)..... | 57-63 |
| 57-8 | Summary of Qualitative Evaluation Results for Containment at Power Operation (Sheets 1 – 4)..... | 57-82 |
| 57-9 | Summary of Results (Sheets 1 – 5) | 57-88 |
| 57-10 | Distribution of Fire CDF Frequency by Three Major Plant Areas | 57-93 |
| 57-11 | Distribution of Fire CDF Frequency by Eight Plant Areas..... | 57-94 |
| 57-12 | Fire Areas Sorted by CDF (Sheets 1 – 5)..... | 57-95 |
| 57-13 | Fire Areas Sorted by CDF/FIEV (Sheets 1 – 5)..... | 57-100 |
| 57-14 | Credit for Manual Fire Suppression | 57-105 |
| 57-15 | Reduction of Hot Short Probability | 57-106 |
| 57-16 | Increase of Hot Short Probability | 57-107 |
| 57-17 | Sensitivity to Human Actions..... | 57-108 |
| 57-18 | Sensitivity to Fire Ignition Frequencies..... | 57-109 |
| 57-19 | Sensitivity to Actuation by DAS | 57-110 |
| 57-20 | Plant Fire CDF Without Hot Shorts | 57-111 |
| 57-21 | Contribution of the Plant Areas to CDF | 57-112 |
| 57-22 | Dominant Fire Scenarios (Sheets 1 – 4)..... | 57-113 |
| 57-23 | AP1000 Shutdown CCDPs | 57-117 |
| 57-24 | AP1000 Dominant Fire Sequences (Sheets 1 – 4)..... | 57-118 |
| 57-25 | Dominant Fire Scenarios from AP600 Shutdown Fire PRA | 57-122 |
| 57-26 | Summary of AP1000 Shutdown Fire Evaluation | 57-123 |
| 57-27 | Main Contributors for Shutdown Fire Risk..... | 57-124 |
| 57A-1 | Summary of Scenario CCDPs (Sheets 1 – 5) | 57A-7 |
| 57A-2 | AP1000 Base Case CCDPs for Initiating Events | 57A-12 |
| 57A-3 | DAS-ACT Fault Tree Cutsets Before Subtree Reduction | 57A-13 |
| 57A-4 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 10)..... | 57A-14 |
| 57A-5 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 9)..... | 57A-24 |
| 57A-6 | AP1000 Fire PRA Scenario CCDPs for Over-Conservative Cases (Sheets 1 – 3) | 57A-33 |
| 57C-1 | Data Used in Event Tree Scenario Frequency Calculations (Sheets 1 – 5) | 57C-2 |
| 57C-2 | CCDPs Used in Fire Event Trees (Sheets 1 – 5)..... | 57C-7 |
| 59-1 | Contribution of Initiating Events to Core Damage..... | 59-39 |
| 59-2 | Conditional Core Damage Probability of Initiating Events | 59-40 |
| 59-3 | Internal Initiating Events at Power Dominant Core Damage Sequences (Sheets 1 – 4) | 59-41 |
| 59-4 | Sequence 1 – Safety Injection Line Break Dominant Cutsets (SI-LB-07) (Sheets 1 – 3) | 59-45 |
| 59-5 | Sequence 2 – Large LOCA Dominant Cutsets (LLOCA-09)..... | 59-48 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 59-6 | Sequence 3 – Spurious ADS Actuation Dominant Cutsets (SPADS-08) (Sheets 1 – 3) | 59-49 |
| 59-7 | Sequence 4 – Safety Injection Line Break Dominant Cutsets (SI-LB-08) (Sheets 1 – 3) | 59-52 |
| 59-8 | Sequence 5 – Reactor Vessel Rupture Cutset (RV-RP-02)..... | 59-55 |
| 59-9 | Sequence 6 – Small LOCA Dominant Cutsets (SLOCA-05) (Sheets 1 – 3)..... | 59-56 |
| 59-10 | Sequence 7 – Medium LOCA Dominant Cutsets (MLOCA-05) (Sheets 1 – 3)..... | 59-59 |
| 59-11 | Sequence 8 – Small LOCA Dominant Cutsets (SLOCA-12) (Sheets 1 – 3)..... | 59-62 |
| 59-12 | Sequence 9 – Medium LOCA Dominant Cutsets (MLOCA-12) (Sheets 1 – 3)..... | 59-65 |
| 59-13 | Sequence 10 – Spurious ADS Actuation Dominant Cutsets (SPADS-09) (Sheets 1 – 3) | 59-68 |
| 59-14 | Typical System Failure Probabilities, Showing Higher Reliabilities for Safety Systems | 59-71 |
| 59-15 | Summary of AP1000 PRA Results | 59-72 |
| 59-16 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 59-73 |
| 59-17 | Comparison of AP1000 PRA Results to Risk Goals | 59-74 |
| 59-18 | AP1000 PRA-Based Insights (Sheets 1 –24) | 59-75 |

LIST OF FIGURES

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 2-1 | Core Damage Logic Diagram for Internal Initiators (Sheets 1 – 4)..... | 2-47 |
| 4A-1 | Example Event Tree for Illustration of Terminology | 4A-19 |
| 4A-2 | Functional Event Tree | 4A-20 |
| 4A-3 | Illustration of A/B and A&B Notation | 4A-21 |
| 4A-4 | Illustration of Consequential Event and ATWS End States | 4A-22 |
| 4A-5 | AP1000 PRA Transients Template Event Tree (Sheets 1 – 3)..... | 4A-23 |
| 4A-6 | AP1000 PRA Small LOCA Template Event Tree (Sheets 1 – 2) | 4A-26 |
| 4B-1 | AP1000 Large LOCA Event Tree (Sheets 1 – 2)..... | 4B-2 |
| 4B-2 | AP1000 Large Spurious ADS Actuation Event Tree (Sheets 1 – 2)..... | 4B-4 |
| 4B-3 | AP1000 Medium LOCA Event Tree (Sheets 1 – 4)..... | 4B-6 |
| 4B-4 | AP1000 CMT Line Break Event Tree (Sheets 1 – 4)..... | 4B-10 |
| 4B-5 | AP1000 SI Line Break Event Tree (Sheets 1 – 3)..... | 4B-14 |
| 4B-6 | AP1000 Small LOCA Event Tree (Sheets 1 – 6)..... | 4B-17 |
| 4B-7 | AP1000 RCS Leak Event Tree | 4B-23 |
| 4B-8 | AP1000 Passive RHR Tube Rupture Event Tree..... | 4B-24 |
| 4B-9a | AP1000 Steam Generator Tube Rupture Event Tree (Sheets 1 – 3) | 4B-25 |
| 4B-9b | AP1000 SGTR Continues Event Tree (Sheets 1 – 6)..... | 4B-28 |
| 4B-10 | AP1000 Reactor Vessel Rupture Event Tree | 4B-34 |
| 4B-11 | AP1000 Interfacing Systems LOCA Event Tree..... | 4B-35 |
| 4B-12 | AP1000 Transients With Main Feedwater Event Tree (Sheets 1 – 4)..... | 4B-36 |
| 4B-13 | AP1000 Loss of Reactor Coolant Flow Event Tree (Sheets 1 – 4) | 4B-40 |
| 4B-14 | AP1000 Loss of Feedwater to One SG Tree (Sheets 1 – 4) | 4B-44 |
| 4B-15 | AP1000 Transients With Core Power Excursion Event Tree (Sheets 1 – 4)..... | 4B-48 |
| 4B-16 | AP1000 Transients With Loss of CCW/SW Event Tree (Sheets 1 – 4)..... | 4B-52 |
| 4B-17 | AP1000 Loss of MFW Event Tree (Sheets 1 – 4)..... | 4B-56 |
| 4B-18 | AP1000 Loss of Condenser Event Tree (Sheets 1 – 4) | 4B-60 |
| 4B-19 | AP1000 Loss of Main Compressed Air Event Tree (Sheets 1 – 4)..... | 4B-64 |
| 4B-20 | AP1000 Loss of Offsite Power Event Tree (Sheets 1 – 7) | 4B-68 |
| 4B-21 | Main Steam Line Break Downstream of MSIVs Event Tree (Sheets 1 – 5) | 4B-75 |
| 4B-22 | Main Steam Line Break Upstream of MSIVs Event Tree (Sheets 1 – 9) | 4B-80 |
| 4B-23 | Stuck Open Secondary Side Safety Valve Event Tree (Sheets 1 – 5) | 4B-89 |
| 4B-24a | ATWS Precursor Without Main Feedwater | 4B-94 |
| 4B-24b | AP1000 ATWS Precursor Without Main Feedwater Continues Event Tree (Sheets 1 – 6) | 4B-95 |
| 4B-25 | ATWS Precursor With SI (Sheets 1 – 6)..... | 4B-101 |
| 4B-26 | ATWS Precursor With MFW (Sheets 1 – 4)..... | 4B-107 |
| 7-1 | Power/Control Model for Large Loads (6900-vac/480-vac Pumps, Fans, and Motors)..... | 7-33 |
| 7-2 | Power/Control Model for Motor-Operated Valves..... | 7-35 |
| 7-3 | Power/Control Model for Air-Operated Valves | 7-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 7-4 | Power/Control Model for Variable Speed Motor | 7-39 |
| 7-5 | An Illustration of Fault Tree Basic Events for a Pump Following the Model Given in Figure 7-1 | 7-41 |
| 8-1 | PRHR – Simplified Piping and Instrumentation Diagram..... | 8-23 |
| 8-2 | PRHR – Simplified Valve Control Diagram | 8-25 |
| 9-1 | Passive Core Cooling System Simplified Sketch | 9-24 |
| 9-2 | Passive Core Cooling System Piping and Instrumentation Diagram | 9-25 |
| 10-1 | Passive Core Cooling System – Accumulator Subsystem | 10-12 |
| 11-1 | Automatic Depressurization System Simplified Piping and Instrumentation Diagram..... | 11-49 |
| 12-1 | Simplified Piping & Instrumentation Diagram of the IRWST/Gravity Injection Subsystem..... | 12-42 |
| 13-1 | Passive Containment Cooling System Sketch | 13-11 |
| 15-1 | Chemical and Volume Control System Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 15-25 |
| 17-1 | Normal Residual Heat Removal System Sketch..... | 17-19 |
| 18-1 | Component Cooling Water System Piping and Instrumentation Diagram | 18-13 |
| 19-1 | Service Water System Piping and Instrumentation Diagram..... | 19-17 |
| 20-1 | Central Chilled Water Low-Capacity Subsystem Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 20-11 |
| 21-1 | AC Power System One-Line Diagram | 21-55 |
| 22-1 | Class 1E DC System One-Line Diagram (Sheets 1 – 2)..... | 22-53 |
| 22-2 | Class 1E UPS One-Line Diagram | 22-57 |
| 25-1 | Compressed & Instrument Air System Piping and Instrumentation Diagram | 25-19 |
| 29-1 | IRWST Valve Configuration..... | 29-25 |
| 30-1 | Human Reliability Analysis Quantification Model | 30-111 |
| 30A-1 | Links Between SHARP Steps | 30A-18 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-1 | Case 3BE-1: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Containment Water Level..... | 34-52 |
| 34-2 | Case 3BE-1: ADS Stage 4 Flow Rates DVI Line Break, Containment Water Level..... | 34-52 |
| 34-3 | Case 3BE-1: Accumulator/CMT Water Mass DVI Line Break, Containment Water Level | 34-53 |
| 34-4 | Case 3BE-1: IRWST Injection Flow Rate DVI Line Break, Containment Water Level | 34-53 |
| 34-5 | Case 3BE-1: Break Flow Rate DVI Line Break, Containment Water Level..... | 34-54 |
| 34-6 | Case 3BE-1: Reactor Vessel Water Level DVI Line Break, Containment Water Level | 34-54 |
| 34-7 | Case 3BE-1: Core Temperatures DVI Line Break, Containment Water Level..... | 34-55 |
| 34-8 | Case 3BE-1: Containment Water Pool Elevations DVI Line Break, Containment Water Level | 34-55 |
| 34-9 | Case 3BE-1: Containment Pressure DVI Line Break, Containment Water Level..... | 34-56 |
| 34-10 | Case 3BE-1: Containment Gas Temperatures DVI Line Break, Containment Water Level | 34-56 |
| 34-11 | Case 3BE-1: Core Mass DVI Line Break, Containment Water Level..... | 34-57 |
| 34-12 | Case 3BE-1: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Containment Water Level..... | 34-57 |
| 34-13 | Case 3BE-1: In-Vessel Hydrogen Generation DVI Line Break, Containment Water Level | 34-58 |
| 34-14 | Case 3BE-1: Mass Fraction of CsI Released to Containment DVI Line Break, Containment Water Level..... | 34-58 |
| 34-15 | Case 3BE-1: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-16 | Case 3BE-1: Mass Fraction of Fission Products Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-17 | Case 3BE-1: Mass Fraction of SrO Released to Environment DVI Line Break, Containment Water Level..... | 34-60 |
| 34-18 | Case 3BE-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-60 |
| 34-19 | Case 3BE-2: ADS Stage 4 Flow Rates DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-20 | Case 3BE-2: Accumulator/CMT Water Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-21 | Case 3BE-2: IRWST Injection Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |
| 34-22 | Case 3BE-2: Break Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-23 | Case 3BE-2: Reactor Vessel Water Level DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-24 | Case 3BE-2: Core Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-25 | Case 3BE-2: Containment Water Pool Elevations DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-26 | Case 3BE-2: Containment Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-27 | Case 3BE-2: Containment Gas Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-28 | Case 3BE-2: Core Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-29 | Case 3BE-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-66 |
| 34-30 | Case 3BE-2: In-Vessel Hydrogen Generation DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-66 |
| 34-31 | Case 3BE-2: Mass Fraction of CsI Released to Containment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-32 | Case 3BE-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-33 | Case 3BE-2: Mass Fraction of Fission Products Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-34 | Case 3BE-2: Mass Fraction of SrO Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-35 | Case 3BE-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS, Failed Gravity Injection..... | 34-69 |
| 34-36 | Case 3BE-4: ADS Stage 4 Flow Rates Spurious ADS, Failed Gravity Injection | 34-69 |
| 34-37 | Case 3BE-4: Accumulator/CMT Water Mass Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-38 | Case 3BE-4: IRWST Injection Flow Rate Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-39 | Case 3BE-4: Break Flow Rate Spurious ADS, Failed Gravity Injection..... | 34-71 |
| 34-40 | Case 3BE-4: Reactor Vessel Water Level Spurious ADS, Failed Gravity Injection | 34-71 |
| 34-41 | Case 3BE-4: Core Temperatures Spurious ADS, Failed Gravity Injection | 34-72 |
| 34-42 | Case 3BE-4: Containment Water Pool Elevations Spurious ADS, Failed Gravity Injection..... | 34-72 |
| 34-43 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection | 34-73 |
| 34-44 | Case 3BE-4: Containment Gas Temperatures Spurious ADS, Failed Gravity Injection..... | 34-73 |
| 34-45 | Case 3BE-4: Core Mass Spurious ADS, Failed Gravity Injection | 34-74 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-46 | Case 3BE-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS, Failed Gravity Injection..... | 34-74 |
| 34-47 | Case 3BE-4: In-Vessel Hydrogen Generation Spurious ADS, Failed Gravity Injection | 34-75 |
| 34-48 | Case 3BE-4: Mass Fraction of CsI Released to Containment Spurious ADS, Failed Gravity Injection..... | 34-75 |
| 34-49 | Case 3BE-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-50 | Case 3BE-4: Mass Fraction of Fission Products Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-51 | Case 3BE-4: Mass Fraction of SrO Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-77 |
| 34-52 | Case 3BE-5: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-77 |
| 34-53 | Case 3BE-5: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-78 |
| 34-54 | Case 3BE-5: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-78 |
| 34-55 | Case 3BE-5: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-56 | Case 3BE-5: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-57 | Case 3BE-5: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-80 |
| 34-58 | Case 3BE-5: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-80 |
| 34-59 | Case 3BE-5: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-81 |
| 34-60 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 34-81 |
| 34-61 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-82 |
| 34-62 | Case 3BE-5: Core Mass SBLOCA with Failed Gravity Injection..... | 34-82 |
| 34-63 | Case 3BE-5: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-83 |
| 34-64 | Case 3BE-5: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-83 |
| 34-65 | Case 3BE-5: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-84 |
| 34-66 | Case 3BE-5: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-84 |
| 34-67 | Case 3BE-5: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |
| 34-68 | Case 3BE-5: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-69 | Case 3BE-6: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-86 |
| 34-70 | Case 3BE-6: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-86 |
| 34-71 | Case 3BE-6: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-87 |
| 34-72 | Case 3BE-6: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-87 |
| 34-73 | Case 3BE-6: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-88 |
| 34-74 | Case 3BE-6: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-88 |
| 34-75 | Case 3BE-6: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-76 | Case 3BE-6: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-77 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection | 34-90 |
| 34-78 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-90 |
| 34-79 | Case 3BE-6: Core Mass SBLOCA with Failed Gravity Injection..... | 34-91 |
| 34-80 | Case 3BE-6: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-91 |
| 34-81 | Case 3BE-6: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-92 |
| 34-82 | Case 3BE-6: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-92 |
| 34-83 | Case 3BE-6: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-93 |
| 34-84 | Case 3BE-6: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-93 |
| 34-85 | Case 3BE-6: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-94 |
| 34-86 | Case 3BE-7: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-94 |
| 34-87 | Case 3BE-7: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-95 |
| 34-88 | Case 3BE-7: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-95 |
| 34-89 | Case 3BE-7: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-96 |
| 34-90 | Case 3BE-7: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-96 |
| 34-91 | Case 3BE-7: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-97 |
| 34-92 | Case 3BE-7: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-97 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-93 | Case 3BE-7: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-98 |
| 34-94 | Case 3BE-7: Containment Pressure SBLOCA with Failed Gravity Injection | 34-98 |
| 34-95 | Case 3BE-7: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-99 |
| 34-96 | Case 3BE-7: Core Mass SBLOCA with Failed Gravity Injection..... | 34-99 |
| 34-97 | Case 3BE-7: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection | 34-100 |
| 34-98 | Case 3BE-7: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-100 |
| 34-99 | Case 3BE-7: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-101 |
| 34-100 | Case 3BE-7: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection | 34-101 |
| 34-101 | Case 3BE-7: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-102 | Case 3BE-7: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-103 | Case 3BE-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-103 |
| 34-104 | Case 3BE-3: ADS Stage 4 Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-103 |
| 34-105 | Case 3BE-3: Accumulator/CMT Water Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-106 | Case 3BE-3: IRWST Injection Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-107 | Case 3BE-3: Break Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-105 |
| 34-108 | Case 3BE-3: Reactor Vessel Water Level DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-105 |
| 34-109 | Case 3BE-3: Core Temperatures DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-106 |
| 34-110 | Case 3BE-3: Containment Water Pool Elevations DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-106 |
| 34-111 | Case 3BE-3: Containment Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-107 |
| 34-112 | Case 3BE-3: Containment Gas Temperature DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-107 |
| 34-113 | Case 3BE-3: Core Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |
| 34-114 | Case 3BE-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-115 | Case 3BE-3: In-Vessel Hydrogen Generation DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-109 |
| 34-116 | Case 3BE-3: Mass Fraction of CsI Released to Containment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-109 |
| 34-117 | Case 3BE-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-110 |
| 34-118 | Case 3BE-3: Mass Fraction of Fission Products Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-110 |
| 34-119 | Case 3BE-3: Mass Fraction of SrO Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-111 |
| 34-120 | Case 3BL-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-111 |
| 34-121 | Case 3BL-1: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection..... | 34-112 |
| 34-122 | Case 3BL-1: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection..... | 34-112 |
| 34-123 | Case 3BL-1: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection..... | 34-113 |
| 34-124 | Case 3BL-1: Break Flow Rate SBLOCA with Failed Gravity Injection..... | 34-113 |
| 34-125 | Case 3BL-1: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection..... | 34-114 |
| 34-126 | Case 3BL-1: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-114 |
| 34-127 | Case 3BL-1: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-115 |
| 34-128 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Injection..... | 34-115 |
| 34-129 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Injection..... | 34-116 |
| 34-130 | Case 3BL-1: Core Mass SBLOCA with Failed Gravity Injection..... | 34-116 |
| 34-131 | Case 3BL-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-117 |
| 34-132 | Case 3BL-1: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection..... | 34-117 |
| 34-133 | Case 3BL-1: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-134 | Case 3BL-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-135 | Case 3BL-1: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-136 | Case 3BL-1: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-137 | Case 3BL-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed Gravity Injection..... | 34-120 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-138 | Case 3BL-2: ADS Stage 4 Flow Rates DVI Line Break with Failed Gravity Injection | 34-120 |
| 34-139 | Case 3BL-2: Accumulator/CMT Water Mass DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-140 | Case 3BL-2: IRWST Injection Flow Rate DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-141 | Case 3BL-2: Break Flow Rate DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-142 | Case 3BL-2: Reactor Vessel Water Level DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-143 | Case 3BL-2: Core Temperatures DVI Line Break with Failed Gravity Injection | 34-123 |
| 34-144 | Case 3BL-2: Containment Water Pool Elevations DVI Line Break with Failed Gravity Injection..... | 34-123 |
| 34-145 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Injection | 34-124 |
| 34-146 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection..... | 34-124 |
| 34-147 | Case 3BL-2: Core Mass DVI Line Break with Failed Gravity Injection | 34-125 |
| 34-148 | Case 3BL-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed Gravity Injection | 34-125 |
| 34-149 | Case 3BL-2: In-Vessel Hydrogen Generation DVI Line Break with Failed Gravity Injection..... | 34-126 |
| 34-150 | Case 3BL-2: Mass Fraction of CsI Released to Containment DVI Line Break with Failed Gravity Injection | 34-126 |
| 34-151 | Case 3BL-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-152 | Case 3BL-2: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-153 | Case 3BL-2: Mass Fraction of SrO Released to Environment DVI Line Break with Failed Gravity Injection | 34-128 |
| 34-154 | Case 3BR-1: Reactor Coolant System and Steam Generator Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-128 |
| 34-155 | Case 3BR-1: ADS Stage 4 Flow Rates CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-156 | Case 3BR-1: Accumulator/CMT Water Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-157 | Case 3BR-1: IRWST Injection Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-130 |
| 34-158 | Case 3BR-1: Break Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-130 |
| 34-159 | Case 3BR-1: Reactor Vessel Water Level CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-160 | Case 3BR-1: Core Temperatures CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |
| 34-161 | Case 3BR-1: Containment Water Pool Elevations CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-132 |
| 34-162 | Case 3BR-1: Containment Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-132 |
| 34-163 | Case 3BR-1: Containment Gas Temperature CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-133 |
| 34-164 | Case 3BR-1: Core Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-133 |
| 34-165 | Case 3BR-1: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-166 | Case 3BR-1: In-Vessel Hydrogen Generation CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-167 | Case 3BR-1: Mass Fraction of CsI Released to Containment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-168 | Case 3BR-1: Mass Fraction of Noble Gases Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-169 | Case 3BR-1: Mass Fraction of Fission Products Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-136 |
| 34-170 | Case 3BR-1: Mass Fraction of SrO Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-136 |
| 34-171 | Case 3BR-1a: Reactor Coolant System and Steam Generator Pressure CL LBLOCA with Failed Accumulators..... | 34-137 |
| 34-172 | Case 3BR-1a: ADS Stage 4 Flow Rates CL LBLOCA with Failed Accumulators | 34-137 |
| 34-173 | Case 3BR-1a: Accumulator/CMT Water Mass CL LBLOCA with Failed Accumulators | 34-138 |
| 34-174 | Case 3BR-1a: IRWST Injection Flow Rate CL LBLOCA with Failed Accumulators | 34-138 |
| 34-175 | Case 3BR-1a: Break Flow Rate CL LBLOCA with Failed Accumulators..... | 34-139 |
| 34-176 | Case 3BR-1a: Reactor Vessel Water Level CL LBLOCA with Failed Accumulators | 34-139 |
| 34-177 | Case 3BR-1a: Core Temperatures CL LBLOCA with Failed Accumulators | 34-140 |
| 34-178 | Case 3BR-1a: Containment Water Pool Elevations CL LBLOCA with Failed Accumulators | 34-140 |
| 34-179 | Case 3BR-1a: Containment Pressure CL LBLOCA with Failed Accumulators | 34-141 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-180 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Failed Accumulators | 34-141 |
| 34-181 | Case 3BR-1a: Core Mass CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-182 | Case 3BR-1a: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-183 | Case 3BR-1a: In-Vessel Hydrogen Generation CL LBLOCA with Failed Accumulators | 34-143 |
| 34-184 | Case 3BR-1a: Mass Fraction of CsI Released to Containment CL LBLOCA with Failed Accumulators..... | 34-143 |
| 34-185 | Case 3BR-1a: Mass Fraction of Noble Gases Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-186 | Case 3BR-1a: Mass Fraction of Fission Products Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-187 | Case 3BR-1a: Mass Fraction of SrO Released to Environment CL LBLOCA with Failed Accumulators | 34-145 |
| 34-188 | Case 3C-1: Reactor Coolant System and Steam Generator Pressure Vessel Rupture | 34-145 |
| 34-189 | Case 3C-1: ADS Stage 4 Flow Rates Vessel Rupture | 34-146 |
| 34-190 | Case 3C-1: Accumulator/CMT Water Mass Vessel Rupture | 34-146 |
| 34-191 | Case 3C-1: IRWST Injection Flow Rate Vessel Rupture..... | 34-147 |
| 34-192 | Case 3C-1: Break Flow Rate Vessel Rupture..... | 34-147 |
| 34-193 | Case 3C-1: Reactor Vessel Water Level Vessel Rupture | 34-148 |
| 34-194 | Case 3C-1: Core Temperatures Vessel Rupture | 34-148 |
| 34-195 | Case 3C-1: Containment Water Pool Elevations Vessel Rupture..... | 34-149 |
| 34-196 | Case 3C-1: Containment Pressure Vessel Rupture..... | 34-149 |
| 34-197 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 34-150 |
| 34-198 | Case 3C-1: Core Mass Vessel Rupture | 34-150 |
| 34-199 | Case 3C-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture | 34-151 |
| 34-200 | Case 3C-1: In-Vessel Hydrogen Generation Vessel Rupture | 34-151 |
| 34-201 | Case 3C-1: Mass Fraction of CsI Released to Containment Vessel Rupture..... | 34-152 |
| 34-202 | Case 3C-1: Mass Fraction of Noble Gas Released to Environment Vessel Rupture..... | 34-152 |
| 34-203 | Case 3C-1: Mass Fraction of Fission Products Released to Environment Vessel Rupture | 34-153 |
| 34-204 | Case 3C-1: Mass Fraction of SrO Released to Environment Vessel Rupture | 34-153 |
| 34-205 | Case 3C-2: Reactor Coolant System and Steam Generator Pressure Vessel Rupture with Containment Failure | 34-154 |
| 34-206 | Case 3C-2: ADS Stage 4 Flow Rates Vessel Rupture with Containment Failure | 34-154 |
| 34-207 | Case 3C-2: Accumulator/CMT Water Mass Vessel Rupture with Containment Failure..... | 34-155 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-208 | Case 3C-2: IRWST Injection Flow Rate Vessel Rupture with Containment Failure..... | 34-155 |
| 34-209 | Case 3C-2: Break Flow Rate Vessel Rupture with Containment Failure | 34-156 |
| 34-210 | Case 3C-2: Reactor Vessel Water Level Vessel Rupture with Containment Failure..... | 34-156 |
| 34-211 | Case 3C-2: Core Temperatures Vessel Rupture with Containment Failure..... | 34-157 |
| 34-212 | Case 3C-2: Containment Water Pool Elevations Vessel Rupture with Containment Failure..... | 34-157 |
| 34-213 | Case 3C-2: Containment Pressure Vessel Rupture with Containment Failure | 34-158 |
| 34-214 | Case 3C-2: Containment Gas Temperature Vessel Rupture with Containment Failure..... | 34-158 |
| 34-215 | Case 3C-2: Core Mass Vessel Rupture with Containment Failure..... | 34-159 |
| 34-216 | Case 3C-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture with Containment Failure..... | 34-159 |
| 34-217 | Case 3C-2: In-Vessel Hydrogen Generation Vessel Rupture with Containment Failure..... | 34-160 |
| 34-218 | Case 3C-2: Mass Fraction of CsI Released to Containment Vessel Rupture with Containment Failure | 34-160 |
| 34-219 | Case 3C-2: Mass Fraction of Noble Gases Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-220 | Case 3C-2: Mass Fraction of Fission Products Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-221 | Case 3C-2: Mass Fraction of SrO Released to Environment Vessel Rupture with Containment Failure | 34-162 |
| 34-222 | Case 3D-1: Reactor Coolant System and Steam Generator Pressure Spurious ADS-4 with Failed CMTs | 34-162 |
| 34-223 | Case 3D-1: ADS Stage 4 Flow Rates Spurious ADS-4 with Failed CMTs..... | 34-163 |
| 34-224 | Case 3D-1: Accumulator/CMT Water Mass Spurious ADS-4 with Failed CMTs | 34-163 |
| 34-225 | Case 3D-1: IRWST Injection Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-226 | Case 3D-1: Break Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-227 | Case 3D-1: Reactor Vessel Water Level Spurious ADS-4 with Failed CMTs | 34-165 |
| 34-228 | Case 3D-1: Core Temperatures Spurious ADS-4 with Failed CMTs..... | 34-165 |
| 34-229 | Case 3D-1: Containment Water Pool Elevations Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-230 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-231 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs | 34-167 |
| 34-232 | Case 3D-1: Core Mass Spurious ADS-4 with Failed CMTs | 34-167 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-233 | Case 3D-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-4 with Failed CMTs | 34-168 |
| 34-234 | Case 3D-1: In-Vessel Hydrogen Generation Spurious ADS-4 with Failed CMTs | 34-168 |
| 34-235 | Case 3D-1: Mass Fraction of CsI Released to Containment Spurious ADS-4 with Failed CMTs | 34-169 |
| 34-236 | Case 3D-1: Mass Fraction of Noble Gases Released to Environment Spurious ADS-4 with Failed CMTs | 34-169 |
| 34-237 | Case 3D-1: Mass Fraction of Fission Products Released to Environment Spurious ADS-4 with Failed CMTs | 34-170 |
| 34-238 | Case 3D-1: Mass Fraction of SrO Released to Environment Spurious ADS-4 with Failed CMTs | 34-170 |
| 34-239 | Case 3D-2: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2 with Failed CMTs | 34-171 |
| 34-240 | Case 3D-2: ADS Stage 4 Flow Rates Spurious ADS-2 with Failed CMTs | 34-171 |
| 34-241 | Case 3D-2: Accumulator/CMT Water Mass Spurious ADS-2 with Failed CMTs | 34-172 |
| 34-242 | Case 3D-2: IRWST Injection Flow Rate Spurious ADS-2 with Failed CMTs | 34-172 |
| 34-243 | Case 3D-2: Break Flow Rate Spurious ADS-2 with Failed CMTs | 34-173 |
| 34-244 | Case 3D-2: Reactor Vessel Water Level Spurious ADS-2 with Failed CMTs | 34-173 |
| 34-245 | Case 3D-2: Core Temperatures Spurious ADS-2 with Failed CMTs | 34-174 |
| 34-246 | Case 3D-2: Containment Pool Water Elevations Spurious ADS-2 with Failed CMTs | 34-174 |
| 34-247 | Case 3D-2: Containment Pressure Spurious ADS-2 with Failed CMTs | 34-175 |
| 34-248 | Case 3D-2: Containment Gas Temperature Spurious ADS-2 with Failed CMTs | 34-175 |
| 34-249 | Case 3D-2: Core Mass Spurious ADS-2 with Failed CMTs | 34-176 |
| 34-250 | Case 3D-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2 with Failed CMTs | 34-176 |
| 34-251 | Case 3D-2: In-Vessel Hydrogen Generation Spurious ADS-2 with Failed CMTs | 34-177 |
| 34-252 | Case 3D-2: Mass Fraction of CsI Released to Containment Spurious ADS-2 with Failed CMTs | 34-177 |
| 34-253 | Case 3D-2: Mass Fraction of Noble Gas Released to Environment Spurious ADS-2 with Failed CMTs | 34-178 |
| 34-254 | Case 3D-2: Mass Fraction of Fission Products Released to Environment Spurious ADS-2 with Failed CMTs | 34-178 |
| 34-255 | Case 3D-2: Mass Fraction of SrO Released to Environment Spurious ADS-2 with Failed CMTs | 34-179 |
| 34-256 | Case 3D-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed ADS | 34-179 |
| 34-257 | Case 3D-3: ADS Stage 4 Flow Rates DVI Line Break with Failed ADS | 34-180 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-258 | Case 3D-3: Accumulator/CMT Water Mass DVI Line Break with Failed ADS..... | 34-180 |
| 34-259 | Case 3D-3: IRWST Injection Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-260 | Case 3D-3: Break Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-261 | Case 3D-3: Reactor Vessel Water Level DVI Line Break with Failed ADS..... | 34-182 |
| 34-262 | Case 3D-3: Core Temperatures DVI Line Break with Failed ADS..... | 34-182 |
| 34-263 | Case 3D-3: Containment Water Pool Elevations DVI Line Break with Failed ADS..... | 34-183 |
| 34-264 | Case 3D-3: Containment Pressure DVI Line Break with Failed ADS | 34-183 |
| 34-265 | Case 3D-3: Containment Gas Temperature DVI Line Break with Failed ADS | 34-184 |
| 34-266 | Case 3D-3: Core Mass DVI Line Break with Failed ADS | 34-184 |
| 34-267 | Case 3D-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed ADS..... | 34-185 |
| 34-268 | Case 3D-3: In-Vessel Hydrogen Generation DVI Line Break with Failed ADS..... | 34-185 |
| 34-269 | Case 3D-3: Mass Fraction of CsI Released to Containment DVI Line Break with Failed ADS | 34-186 |
| 34-270 | Case 3D-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed ADS | 34-186 |
| 34-271 | Case 3D-3: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed ADS..... | 34-187 |
| 34-272 | Case 3D-3: Mass Fraction of SrO Released to Environment DVI Line Break with Failed ADS | 34-187 |
| 34-273 | Case 3D-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-274 | Case 3D-4: ADS Stage 4 Flow Rates Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-275 | Case 3D-4: Accumulator/CMT Water Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-276 | Case 3D-4: IRWST Injection Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-277 | Case 3D-4: Break Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame..... | 34-190 |
| 34-278 | Case 3D-4: Reactor Vessel Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-190 |
| 34-279 | Case 3D-4: Core Temperatures Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-280 | Case 3D-4: Containment Water Pool Elevations Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-281 | Case 3D-4: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-282 | Case 3D-4: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |
| 34-283 | Case 3D-4: Core Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-284 | Case 3D-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-285 | Case 3D-4: In-Vessel Hydrogen Generation Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-286 | Case 3D-4: Mass Fraction of CsI Released to Containment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-287 | Case 3D-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-288 | Case 3D-4: Mass Fraction of Fission Products Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-289 | Case 3D-4: Mass Fraction of SrO Release to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-196 |
| 34-290 | Case 6E-1: Reactor Coolant System and Steam Generator Pressure SGTR Early Core Melt..... | 34-196 |
| 34-291 | Case 6E-1: ADS Stage 4 Flow Rates SGTR Early Core Melt..... | 34-197 |
| 34-292 | Case 6E-1: Accumulator/CMT Water Mass SGTR Early Core Melt | 34-197 |
| 34-293 | Case 6E-1: IRWST Injection Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-294 | Case 6E-1: Break Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-295 | Case 6E-1: Reactor Vessel Water Level SGTR Early Core Melt | 34-199 |
| 34-296 | Case 6E-1: Core Temperatures SGTR Early Core Melt..... | 34-199 |
| 34-297 | Case 6E-1: Containment Water Pool Elevations SGTR Early Core Melt | 34-200 |
| 34-298 | Case 6E-1: Containment Pressure SGTR Early Core Melt | 34-200 |
| 34-299 | Case 6E-1: Containment Gas Temperature SGTR Early Core Melt..... | 34-201 |
| 34-300 | Case 6E-1: Core Mass SGTR Early Core Melt | 34-201 |
| 34-301 | Case 6E-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Early Core Melt..... | 34-202 |
| 34-302 | Case 6E-1: In-Vessel Hydrogen Generation SGTR Early Core Melt | 34-202 |
| 34-303 | Case 6E-1: Mass Fraction of CsI Released to Containment SGTR Early Core Melt | 34-203 |
| 34-304 | Case 6E-1: Mass Fraction of Noble Gases Released to Environment SGTR Early Core Melt..... | 34-203 |
| 34-305 | Case 6E-1: Mass Fraction of Fission Products Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-306 | Case 6E-1: Mass Fraction of SrO Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-307 | Case 6L-1: Reactor Coolant System and Steam Generator Pressure SGTR Core Melt Failure at Recirculation..... | 34-205 |
| 34-308 | Case 6L-1: ADS Stage 4 Flow Rates SGTR Core Melt Failure at Recirculation | 34-205 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-309 | Case 6L-1: Accumulator/CMT Water Mass SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-310 | Case 6L-1: IRWST Injection Flow Rate SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-311 | Case 6L-1: Break Flow Rate SGTR Core Melt Failure at Recirculation..... | 34-207 |
| 34-312 | Case 6L-1: Reactor Vessel Water Level SGTR Core Melt Failure at Recirculation | 34-207 |
| 34-313 | Case 6L-1: Core Temperatures SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-314 | Case 6L-1: Containment Water Pool Elevations SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-315 | Case 6L-1: Containment Pressure SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-316 | Case 6L-1: Containment Gas Temperature SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-317 | Case 6L-1: Core Mass SGTR Core Melt Failure at Recirculation..... | 34-210 |
| 34-318 | Case 6L-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Core Melt Failure at Recirculation | 34-210 |
| 34-319 | Case 6L-1: In-Vessel Hydrogen Generation SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-320 | Case 6L-1: Mass Fraction of CsI Released to Containment SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-321 | Case 6L-1: Mass Fraction of Noble Gases Released to Environment SGTR Core Melt Failure at Recirculation..... | 34-212 |
| 34-322 | Case 6L-1: Mass Fraction of Fission Products Released to Environment SGTR Core Melt Failure at Recirculation..... | 34-212 |
| 34-323 | Case 6L-1: Mass Fraction of SrO Released to Environment SGTR Core Melt Failure at Recirculation | 34-213 |
| 34-324 | Case 1AP-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-213 |
| 34-325 | Case 1AP-1: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed..... | 34-214 |
| 34-326 | Case 1AP-1: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-214 |
| 34-327 | Case 1AP-1: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-215 |
| 34-328 | Case 1AP-1: Break Flow Rate SBLOCA with PRHR, CMTs Failed..... | 34-215 |
| 34-329 | Case 1AP-1: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-216 |
| 34-330 | Case 1AP-1: Core Temperatures SBLOCA with PRHR, CMTs Failed..... | 34-216 |
| 34-331 | Case 1AP-1: Containment Pool Water Elevations SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-332 | Case 1AP-1: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-333 | Case 1AP-1: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-334 | Case 1AP-1: Core Mass SBLOCA with PRHR, CMTs Failed | 34-218 |
| 34-335 | Case 1AP-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-336 | Case 1AP-1: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-337 | Case 1AP-1: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-338 | Case 1AP-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-339 | Case 1AP-1: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-340 | Case 1AP-1: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-341 | Case 1AP-2: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-342 | Case 1AP-2: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-343 | Case 1AP-2: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-344 | Case 1AP-2: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-345 | Case 1AP-2: Break Flow Rate SBLOCA with PRHR, CMTs Failed..... | 34-224 |
| 34-346 | Case 1AP-2: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-224 |
| 34-347 | Case 1AP-2: Core Temperatures SBLOCA with PRHR, CMTs Failed | 34-225 |
| 34-348 | Case 1AP-2: Containment Water Pool Elevations SBLOCA with PRHR, CMTs Failed | 34-225 |
| 34-349 | Case 1AP-2: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-350 | Case 1AP-2: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-351 | Case 1AP-2: Core Mass SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-352 | Case 1AP-2: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-353 | Case 1AP-2: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-228 |
| 34-354 | Case 1AP-2: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed..... | 34-228 |
| 34-355 | Case 1AP-2: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-356 | Case 1AP-2: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-357 | Case 1AP-2: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed..... | 34-230 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-358 | Case 1A-1: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes | 34-230 |
| 34-359 | Case 1A-1: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-231 |
| 34-360 | Case 1A-1: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-231 |
| 34-361 | Case 1A-1: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-362 | Case 1A-1: Break Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-363 | Case 1A-1: Reactor Vessel Water Level Transient with Creep of SG Tubes | 34-233 |
| 34-364 | Case 1A-1: Core Temperatures Transient with Creep of SG Tubes..... | 34-233 |
| 34-365 | Case 1A-1: Containment Pool Water Elevations Transient with Creep of SG Tubes..... | 34-234 |
| 34-366 | Case 1A-1: Containment Pressure Transient with Creep of SG Tubes | 34-234 |
| 34-367 | Case 1A-1: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-235 |
| 34-368 | Case 1A-1: Core Mass Transient with Creep of SG Tubes | 34-235 |
| 34-369 | Case 1A-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes | 34-236 |
| 34-370 | Case 1A-1: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-236 |
| 34-371 | Case 1A-1: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-237 |
| 34-372 | Case 1A-1: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes | 34-237 |
| 34-373 | Case 1A-1: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes | 34-238 |
| 34-374 | Case 1A-1: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-238 |
| 34-375 | Case 1A-2: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes..... | 34-239 |
| 34-376 | Case 1A-2: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-239 |
| 34-377 | Case 1A-2: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-240 |
| 34-378 | Case 1A-2: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-240 |
| 34-379 | Case 1A-2: Break Flow Rate Transient with Creep of SG Tubes | 34-241 |
| 34-380 | Case 1A-2: Reactor Vessel Water Level Transient with Creep of SG Tubes | 34-241 |
| 34-381 | Case 1A-2: Core Temperatures Transient with Creep of SG Tubes..... | 34-242 |
| 34-382 | Case 1A-2: Containment Water Pool Elevations Transient with Creep of SG Tubes | 34-242 |
| 34-383 | Case 1A-2: Containment Pressure Transient with Creep of SG Tubes | 34-243 |
| 34-384 | Case 1A-2: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-243 |
| 34-385 | Case 1A-2: Core Mass Transient with Creep of SG Tubes | 34-244 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-386 | Case 1A-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes | 34-244 |
| 34-387 | Case 1A-2: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-245 |
| 34-388 | Case 1A-2: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-245 |
| 34-389 | Case 1A-2: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes..... | 34-246 |
| 34-390 | Case 1A-2: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes..... | 34-246 |
| 34-391 | Case 1A-2: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-247 |
| 34-392 | Case 3BE-1: Containment Pressure DDT Intermediate Containment Failure | 34-247 |
| 34-393 | Case 3BE-1: Containment Gas Temperature DDT Intermediate Containment Failure..... | 34-248 |
| 34-394 | Case 3BE-1: Containment Hydrogen Concentration DDT Intermediate Containment Failure..... | 34-248 |
| 34-395 | Case 3BE-1: Noble Gases Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-396 | Case 3BE-1: CsI and RbI Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-397 | Case 3BE-1: TeO ₂ Release Fraction DDT Intermediate Containment Failure | 34-250 |
| 34-398 | Case 3BE-1: SrO Release Fraction DDT Intermediate Containment Failure..... | 34-250 |
| 34-399 | Case 3BE-1: MoO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-400 | Case 3BE-1: CsOH and RbOH Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-401 | Case 3BE-1: BaO Release Fraction DDT Intermediate Containment Failure | 34-252 |
| 34-402 | Case 3BE-1: La ₂ O ₃ Release Fraction DDT Intermediate Containment Failure..... | 34-252 |
| 34-403 | Case 3BE-1: CeO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-253 |
| 34-404 | Case 3BE-1: Sb Release Fraction DDT Intermediate Containment Failure | 34-253 |
| 34-405 | Case 3BE-1: Te ₂ Release Fraction DDT Intermediate Containment Failure | 34-254 |
| 34-406 | Case 3BE-1: UO ₂ Release Fraction DDT Intermediate Containment Failure | 34-254 |
| 34-407 | Case 3BE-1: RCS Pressure No PCS Water Cooling and Late Containment Failure | 34-255 |
| 34-408 | Case 3BE-1: Reactor Vessel Mixture Level No PCS Water Cooling and Late Containment Failure..... | 34-255 |
| 34-409 | Case 3BE-1: Core-Exit Temperature No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-410 | Case 3BE-1: In-Vessel Hydrogen Generation No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-411 | Case 3BE-1: Containment Pressure No PCS Water Cooling and Late Containment Failure..... | 34-257 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-412 | Case 3BE-1: Containment Gas Temperature No PCS Water Cooling and Late Containment Failure..... | 34-257 |
| 34-413 | Case 3BE-1: Containment Hydrogen Concentration No PCS Water Cooling and Late Containment Failure..... | 34-258 |
| 34-414 | Case 3BE-1: Noble Gas Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-258 |
| 34-415 | Case 3BE-1: CsI and RbI Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-416 | Case 3BE-1: TeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-417 | Case 3BE-1: SrO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-418 | Case 3BE-1: MoO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-419 | Case 3BE-1: CsOH and RbOH Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-420 | Case 3BE-1: BaO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-421 | Case 3BE-1: La ₂ O ₃ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-422 | Case 3BE-1: CeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-423 | Case 3BE-1: Sb Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-263 |
| 34-424 | Case 3BE-1: Te ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-263 |
| 34-425 | Case 3BE-1: UO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-264 |
| 35-1 | Containment Event Tree..... | 35-29 |
| 36-1 | AP1000 Accident Class 1A Base Case for Node DP Success – RCS Pressure..... | 36-7 |
| 36-2 | AP1000 Accident Class 1A Base Case for Node DP Success – Core-Exit Gas Temperature..... | 36-8 |
| 36-3 | AP1000 Accident Class 1A Base Case for Node DP Success – Steam Generator Tube Creep Damage..... | 36-9 |
| 36-4 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Passive RHR Heat Removal..... | 36-10 |
| 36-5 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core Makeup Tank Flow (one tank)..... | 36-11 |
| 36-6 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Reactor Coolant System Pressure..... | 36-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 36-7 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core-Exit Gas Temperature..... | 36-13 |
| 39-1 | AP1000 Base Case In-Vessel Retention of Molten Core Debris..... | 39-23 |
| 39-2 | AP1000 Core Shroud | 39-24 |
| 39-3 | Comparison of ULPU-2000 Configuration III and ULPU-2000 Configuration IV..... | 39-25 |
| 39-4 | Effect of Water Level on Water Circulation During IVR..... | 39-26 |
| 39-5 | ULPU-2000 Configuration IV Results (Reference 39-4)..... | 39-27 |
| 39-6 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Zirconium Oxidation Fraction Input Probability Distribution..... | 39-28 |
| 39-7 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Mass of Steel in Debris Input Probability Distribution | 39-29 |
| 39-8 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Time of Final Bounding State Input Probability Distribution | 39-30 |
| 39-9 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Oxide Layer..... | 39-31 |
| 39-10 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Metal Layer | 39-32 |
| 39-11 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Power Density in Oxide Debris..... | 39-33 |
| 39-12 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Internal Rayleigh Number in the Oxide Layer..... | 39-34 |
| 39-13 | AP1000 In-Vessel Retention of Molten Core Debris Quantification External Rayleigh Number in the Metal Layer | 39-35 |
| 39-14 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Normalized Heat Fluxes..... | 39-36 |
| 39-15 | AP1000 Passive Core Cooling System..... | 39-37 |
| 39-16 | Containment Floodable Region..... | 39-38 |
| 39-17 | Containment Floodable Region – Exploded View | 39-39 |
| 39-18 | AP1000 Cavity Flooding Rate | 39-40 |
| 39-19 | Schematic of the AP1000 Reactor Vessel, Vessel Cavity, Vessel Insulation, and Vents | 39-41 |
| 39A-1 | AP1000 Reactor Pressure Vessel, Core and Lower Internals..... | 39A-21 |
| 39A-2 | Core Shroud | 39A-22 |
| 39A-3 | Bottom of Core Shroud, Core Barrel, and Lower Core Support Plate (Not to Scale) | 39A-23 |
| 39A-4 | Axial Power Shapes Used for Core Relocation Analysis | 39A-24 |
| 39A-5 | Radial Power Shape Used for Core Relocation Analysis | 39A-25 |
| 39A-6 | Cross Section Geometry of Finite Difference Computational Model..... | 39A-26 |
| 39A-7 | Computational Mesh for Finite Difference Computational Model..... | 39A-27 |
| 39A-8 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Reactor – Coolant System Pressure..... | 39A-28 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 39A-9 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Containment and Reactor Coolant System Pressure..... | 39A-28 |
| 39A-10 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-29 |
| 39A-11 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Hottest Temperature in Core | 39A-29 |
| 39A-12 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Hydrogen Generated in Core | 39A-30 |
| 39A-13 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.7 – 2.0 m)..... | 39A-30 |
| 39A-14 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 2.0 – 2.3 m)..... | 39A-31 |
| 39A-15 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Core Shroud/Barrel..... | 39A-31 |
| 39A-16 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Volume of Debris in Reactor Vessel Lower Plenum..... | 39A-32 |
| 39A-17 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Coolant System Pressure | 39A-32 |
| 39A-18 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Containment and Reactor Coolant System Pressure | 39A-33 |
| 39A-19 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-33 |
| 39A-20 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Hottest Temperature in Core | 39A-34 |
| 39A-21 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Hydrogen Generated in Core | 39A-34 |
| 39A-22 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.1 – 1.4 m)..... | 39A-35 |
| 39A-23 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.4 – 1.7 m)..... | 39A-35 |
| 39A-24 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Core Shroud/Barrel | 39A-36 |
| 39A-25 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Volume of Debris in Reactor Vessel Lower Plenum | 39A-36 |
| 39A-26 | Initial Oxide Relocation to Lower Plenum..... | 39A-37 |
| 39A-27 | Finite Difference Result for Top-Skewed Power Shape at Level 5 | 39A-38 |
| 39A-28 | Finite Difference Temperature Map Level 5 at 5380 Seconds for Top-Skewed Power Shape Case..... | 39A-38 |
| 39A-29 | MAAP4 Core Temperature Profile for Top-Skewed Power Shape Core Elevation = 2.0 – 2.3 m Above Bottom of Active Fuel (Core Axial Row 12) | 39A-39 |
| 39A-30 | Relocation of Corium..... | 39A-39 |
| 39A-31 | Model for Relocation to Lower Plenum | 39A-40 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 40-1 | AP1000 Passive Containment Cooling System..... | 40-7 |
| 40-2 | Schematic of Passive Containment Cooling System Piping..... | 40-8 |
| 40-3 | AP1000 Containment Venting Pressure Response..... | 40-9 |
| 40-4 | AP1000 Containment Venting Loss of Containment Air..... | 40-10 |
| 40-5 | AP1000 Dry PCS Containment Pressure Response..... | 40-11 |
| 40-6 | AP1000 Dry PCS Containment Temperature Response..... | 40-12 |
| 41-1 | IRWST Hydrogen Venting..... | 41-36 |
| 41-2 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Success..... | 41-37 |
| 41-3 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Failure..... | 41-38 |
| 41-4 | Accident Class 3BL Early Detonation Decomposition Event Tree..... | 41-39 |
| 41-5 | Accident Class 3C/3BR Early Detonation Decomposition Event Tree..... | 41-40 |
| 41-6 | Accident Class 3D/1D Early Detonation Decomposition Event Tree..... | 41-41 |
| 41-7 | Accident Class AP Early Detonation Decomposition Event Tree..... | 41-42 |
| 41-8 | Boil-Off Hydrogen Generation Probability Density Function..... | 41-43 |
| 41-9 | No Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-44 |
| 41-10 | No-Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-45 |
| 41-11 | Early Reflood Hydrogen Generation Probability Density Function..... | 41-46 |
| 41-12 | Early Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-47 |
| 41-13 | Early Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-48 |
| 41-14 | Late Reflood Hydrogen Generation Probability Density Function..... | 41-49 |
| 41-15 | Late Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-50 |
| 41-16 | Late Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-51 |
| 41-17 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Success..... | 41-52 |
| 41-18 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Failure..... | 41-53 |
| 41-19 | Accident Class 3BL Intermediate Detonation Decomposition Event Tree..... | 41-54 |
| 41-20 | Accident Class 3C/3BR Intermediate Detonation Decomposition Event Tree..... | 41-55 |
| 41-21 | Accident Class 3D/1D Intermediate Detonation Decomposition Event Tree..... | 41-56 |
| 41-22 | Accident Class 1AP Intermediate Detonation Decomposition Event Tree..... | 41-57 |
| 41A-1 | Case 3BE-1: Reactor Coolant System Pressure DVI Line Break for Containment Water Level..... | 41A-41 |
| 41A-2 | Case 3BE-1: Core-Exit Gas Temperature DVI Line Break for Containment Water Level..... | 41A-41 |
| 41A-3 | Case 3BE-1: Reactor Vessel Mixture Level DVI Line Break for Containment Water Level..... | 41A-42 |
| 41A-4 | Case 3BE-1: Hydrogen Generated In-Vessel DVI Line Break for Containment Water Level..... | 41A-42 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-5 | Case 3BE-1: Containment Pressure DVI Line Break for Containment Water Level..... | 41A-43 |
| 41A-6 | Case 3BE-1: Containment Gas Temperature DVI Line Break for Containment Water Level | 41A-43 |
| 41A-7 | Case 3BE-1: Containment Compartments Water Level DVI Line Break for Containment Water Level | 41A-44 |
| 41A-8 | Case 3BE-1: Well-Mixed Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-44 |
| 41A-9 | Case 3BE-1: Well-Mixed Compartment Steam Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-10 | Case 3BE-1: Well-Mixed Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-11 | Case 3BE-1: Confined Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-46 |
| 41A-12 | Case 3BE-1: Confined Compartment Steam Concentration DVI Line Break for Containment Water Level..... | 41A-46 |
| 41A-13 | Case 3BE-1: Confined Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-47 |
| 41A-14 | Case 3BE-1: Equivalence Ratio in SG Room DVI Line Break for Containment Water Level | 41A-47 |
| 41A-15 | Case 3BE-1: Equivalence Ratio in CMT Room DVI Line Break for Containment Water Level | 41A-48 |
| 41A-16 | Case 3BE-1: Equivalence Ratio in IRWST DVI Line Break for Containment Water Level | 41A-48 |
| 41A-17 | Case 3BE-1: Equivalence Ratio in PXS DVI Line Break for Containment Water Level..... | 41A-49 |
| 41A-18 | Case 3BE-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-49 |
| 41A-19 | Case 3BE-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-20 | Case 3BE-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-21 | Case 3BE-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-22 | Case 3BE-2: Containment Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-23 | Case 3BE-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-24 | Case 3BE-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-25 | Case 3BE-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding..... | 41A-53 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-26 | Case 3BE-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-53 |
| 41A-27 | Case 3BE-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-28 | Case 3BE-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-29 | Case 3BE-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-30 | Case 3BE-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-31 | Case 3BE-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-32 | Case 3BE-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-33 | Case 3BE-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-34 | Case 3BE-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-35 | Case 3BE-4: Reactor Coolant System Pressure Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-36 | Case 3BE-4: Core-Exit Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-37 | Case 3BE-4: Reactor Vessel Mixture Level Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-38 | Case 3BE-4: Hydrogen Generated In-Vessel Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-39 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection..... | 41A-60 |
| 41A-40 | Case 3BE-4: Containment Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-60 |
| 41A-41 | Case 3BE-4: Containment Compartments Water Level Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-42 | Case 3BE-4: Well-Mixed Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-43 | Case 3BE-4: Well-Mixed Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-44 | Case 3BE-4: Well-Mixed Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-45 | Case 3BE-4: Confined Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-46 | Case 3BE-4: Confined Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-47 | Case 3BE-4: Confined Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-64 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-48 | Case 3BE-4: Equivalence Ratio in SG Room Spurious ADS, Failed Gravity Injection | 41A-64 |
| 41A-49 | Case 3BE-4: Equivalence Ratio in CMT Room Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-50 | Case 3BE-4: Equivalence Ratio in IRWST Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-51 | Case 3BE-4: Equivalence Ratio in PXS Spurious ADS, Failed Gravity Injection | 41A-66 |
| 41A-52 | Case 3BE-5: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-66 |
| 41A-53 | Case 3BE-5: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-54 | Case 3BE-5: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-55 | Case 3BE-5: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-56 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-57 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-69 |
| 41A-58 | Case 3BE-5: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-69 |
| 41A-59 | Case 3BE-5: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-60 | Case 3BE-5: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-61 | Case 3BE-5: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-62 | Case 3BE-5: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-63 | Case 3BE-5: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-64 | Case 3BE-5: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-65 | Case 3BE-5: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-66 | Case 3BE-5: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-67 | Case 3BE-5: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-68 | Case 3BE-5: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-69 | Case 3BE-6: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-75 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-70 | Case 3BE-6: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-75 |
| 41A-71 | Case 3BE-6: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-72 | Case 3BE-6: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-73 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-74 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-75 | Case 3BE-6: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-76 | Case 3BE-6: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-77 | Case 3BE-6: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-78 | Case 3BE-6: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-79 | Case 3BE-6: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-80 | Case 3BE-6: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-81 | Case 3BE-6: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-81 |
| 41A-82 | Case 3BE-6: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-81 |
| 41A-83 | Case 3BE-6: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-84 | Case 3BE-6: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-85 | Case 3BE-6: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-83 |
| 41A-86 | Case 3BE-8: Reactor Coolant System Pressure SGTR..... | 41A-83 |
| 41A-87 | Case 3BE-8: Core-Exit Gas Temperature SGTR | 41A-84 |
| 41A-88 | Case 3BE-8: Reactor Vessel Mixture Level SGTR..... | 41A-84 |
| 41A-89 | Case 3BE-8: Hydrogen Generated In-Vessel SGTR | 41A-85 |
| 41A-90 | Case 3BE-8: Containment Pressure SGTR | 41A-85 |
| 41A-91 | Case 3BE-8: Containment Gas Temperature SGTR | 41A-86 |
| 41A-92 | Case 3BE-8: Containment Compartments Water Level SGTR..... | 41A-86 |
| 41A-93 | Case 3BE-8: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-87 |
| 41A-94 | Case 3BE-8: Well-Mixed Compartment Steam Concentration SGTR..... | 41A-87 |
| 41A-95 | Case 3BE-8: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-88 |
| 41A-96 | Case 3BE-8: Confined Compartment Hydrogen Concentration SGTR..... | 41A-88 |
| 41A-97 | Case 3BE-8: Confined Compartment Steam Concentration SGTR..... | 41A-89 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-98 | Case 3BE-8: Confined Compartment Oxygen Concentration SGTR..... | 41A-89 |
| 41A-99 | Case 3BE-8: Equivalence Ratio in SG Room SGTR | 41A-90 |
| 41A-100 | Case 3BE-8: Equivalence Ratio in CMT Room SGTR..... | 41A-90 |
| 41A-101 | Case 3BE-8: Equivalence Ratio in IRWST SGTR..... | 41A-91 |
| 41A-102 | Case 3BE-8: Equivalence Ratio in PXS SGTR..... | 41A-91 |
| 41A-103 | Case 3BE-9: Reactor Coolant System Pressure SGTR..... | 41A-92 |
| 41A-104 | Case 3BE-9: Core-Exit Gas Temperature SGTR | 41A-92 |
| 41A-105 | Case 3BE-9: Reactor Vessel Mixture Level SGTR..... | 41A-93 |
| 41A-106 | Case 3BE-9: Hydrogen Generated In-Vessel SGTR | 41A-93 |
| 41A-107 | Case 3BE-9: Containment Pressure SGTR | 41A-94 |
| 41A-108 | Case 3BE-9: Containment Gas Temperature SGTR | 41A-94 |
| 41A-109 | Case 3BE-9: Containment Compartments Water Level SGTR..... | 41A-95 |
| 41A-110 | Case 3BE-9: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-95 |
| 41A-111 | Case 3BE-9: Well-Mixed Compartment Steam Concentration SGTR..... | 41A-96 |
| 41A-112 | Case 3BE-9: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-96 |
| 41A-113 | Case 3BE-9: Confined Compartment Hydrogen Concentration SGTR..... | 41A-97 |
| 41A-114 | Case 3BE-9: Confined Compartment Steam Concentration SGTR..... | 41A-97 |
| 41A-115 | Case 3BE-9: Confined Compartment Oxygen Concentration SGTR..... | 41A-98 |
| 41A-116 | Case 3BE-9: Equivalence Ratio in SG Room SGTR | 41A-98 |
| 41A-117 | Case 3BE-9: Equivalence Ratio in CMT Room SGTR..... | 41A-99 |
| 41A-118 | Case 3BE-9: Equivalence Ratio in IRWST SGTR..... | 41A-99 |
| 41A-119 | Case 3BE-9: Equivalence Ratio in PXS SGTR..... | 41A-100 |
| 41A-120 | Case 3BL-1: Reactor Coolant System Pressure SBLOCA with Failed Gravity Recirculation | 41A-100 |
| 41A-121 | Case 3BL-1: Core-Exit Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-122 | Case 3BL-1: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-123 | Case 3BL-1: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-124 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-125 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-126 | Case 3BL-1: Containment Compartments Water Level SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-127 | Case 3BL-1: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-128 | Case 3BL-1: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-129 | Case 3BL-1: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-130 | Case 3BL-1: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |
| 41A-131 | Case 3BL-1: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-132 | Case 3BL-1: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-133 | Case 3BL-1: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-134 | Case 3BL-1: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-135 | Case 3BL-1: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-136 | Case 3BL-1: Equivalence Ratio in PXS SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-137 | Case 3BL-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-138 | Case 3BL-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-139 | Case 3BL-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-140 | Case 3BL-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-141 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-142 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-143 | Case 3BL-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Recirculation | 41A-112 |
| 41A-144 | Case 3BL-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-112 |
| 41A-145 | Case 3BL-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-146 | Case 3BL-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-147 | Case 3BL-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-114 |
| 41A-148 | Case 3BL-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-114 |
| 41A-149 | Case 3BL-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-115 |
| 41A-150 | Case 3BL-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Recirculation | 41A-115 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-151 | Case 3BL-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-152 | Case 3BL-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-153 | Case 3BL-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Recirculation | 41A-117 |
| 41A-154 | Case 3BR-1: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-117 |
| 41A-155 | Case 3BR-1: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-156 | Case 3BR-1: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-157 | Case 3BR-1: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-119 |
| 41A-158 | Case 3BR-1: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-119 |
| 41A-159 | Case 3BR-1: Containment Gas Temperature CL LBLOCA with Accumulator Failure | 41A-120 |
| 41A-160 | Case 3BR-1: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-120 |
| 41A-161 | Case 3BR-1: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-162 | Case 3BR-1: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-163 | Case 3BR-1: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-164 | Case 3BR-1: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-165 | Case 3BR-1: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-166 | Case 3BR-1: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-167 | Case 3BR-1: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-168 | Case 3BR-1: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-169 | Case 3BR-1: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-125 |
| 41A-170 | Case 3BR-1: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure | 41A-125 |
| 41A-171 | Case 3BR-1a: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-126 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-172 | Case 3BR-1a: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-126 |
| 41A-173 | Case 3BR-1a: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-174 | Case 3BR-1a: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-175 | Case 3BR-1a: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-128 |
| 41A-176 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-128 |
| 41A-177 | Case 3BR-1a: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-178 | Case 3BR-1a: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-179 | Case 3BR-1a: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-180 | Case 3BR-1a: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-181 | Case 3BR-1a: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-182 | Case 3BR-1a: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-183 | Case 3BR-1a: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-184 | Case 3BR-1a: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-185 | Case 3BR-1a: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-186 | Case 3BR-1a: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-187 | Case 3BR-1a: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure..... | 41A-134 |
| 41A-188 | Case 3C-1: Reactor Coolant System Pressure Vessel Rupture | 41A-134 |
| 41A-189 | Case 3C-1: Core-Exit Gas Temperature Vessel Rupture..... | 41A-135 |
| 41A-190 | Case 3C-1: Reactor Vessel Mixture Level Vessel Rupture | 41A-135 |
| 41A-191 | Case 3C-1: Hydrogen Generated In-Vessel Vessel Rupture..... | 41A-136 |
| 41A-192 | Case 3C-1: Containment Pressure Vessel Rupture..... | 41A-136 |
| 41A-193 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 41A-137 |
| 41A-194 | Case 3C-1: Containment Compartments Water Level Vessel Rupture | 41A-137 |
| 41A-195 | Case 3C-1: Well-Mixed Compartment Hydrogen Concentration Vessel Rupture..... | 41A-138 |
| 41A-196 | Case 3C-1: Well-Mixed Compartment Steam Concentration Vessel Rupture..... | 41A-138 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-197 | Case 3C-1: Well-Mixed Compartment Oxygen Concentration Vessel Rupture..... | 41A-139 |
| 41A-198 | Case 3C-1: Confined Compartment Hydrogen Concentration Vessel Rupture..... | 41A-139 |
| 41A-199 | Case 3C-1: Confined Compartment Steam Concentration Vessel Rupture..... | 41A-140 |
| 41A-200 | Case 3C-1: Confined Compartment Oxygen Concentration Vessel Rupture..... | 41A-140 |
| 41A-201 | Case 3C-1: Equivalence Ratio in SG Room Vessel Rupture..... | 41A-141 |
| 41A-202 | Case 3C-1: Equivalence Ratio in CMT Room Vessel Rupture..... | 41A-141 |
| 41A-203 | Case 3C-1: Equivalence Ratio in IRWST Vessel Rupture..... | 41A-142 |
| 41A-204 | Case 3C-1: Equivalence Ratio in PXS Vessel Rupture..... | 41A-142 |
| 41A-205 | Case 3D-1: Reactor Coolant System Pressure Spurious ADS-4 with Failed CMTs..... | 41A-143 |
| 41A-206 | Case 3D-1: Core-Exit Gas Temperature Spurious ADS-4 with Failed CMTs..... | 41A-143 |
| 41A-207 | Case 3D-1: Reactor Vessel Mixture Level Spurious ADS-4 with Failed CMTs..... | 41A-144 |
| 41A-208 | Case 3D-1: Hydrogen Generated In-Vessel Spurious ADS-4 with Failed CMTs..... | 41A-144 |
| 41A-209 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs..... | 41A-145 |
| 41A-210 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs..... | 41A-145 |
| 41A-211 | Case 3D-1: Containment Compartments Water Level Spurious ADS-4 with Failed CMTs..... | 41A-146 |
| 41A-212 | Case 3D-1: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-146 |
| 41A-213 | Case 3D-1: Well-Mixed Compartment Steam Concentration Spurious ADS-4 with Failed CMTs..... | 41A-147 |
| 41A-214 | Case 3D-1: Well-Mixed Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-147 |
| 41A-215 | Case 3D-1: Confined Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-148 |
| 41A-216 | Case 3D-1: Confined Compartment Steam Concentration Spurious ADS-4 with Failed CMTs..... | 41A-148 |
| 41A-217 | Case 3D-1: Confined Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-149 |
| 41A-218 | Case 3D-1: Equivalence Ratio in SG Room Spurious ADS-4 with Failed CMTs..... | 41A-149 |
| 41A-219 | Case 3D-1: Equivalence Ratio in CMT Room Spurious ADS-4 with Failed CMTs..... | 41A-150 |
| 41A-220 | Case 3D-1: Equivalence Ratio in IRWST Spurious ADS-4 with Failed CMTs..... | 41A-150 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-221 | Case 3D-1: Equivalence Ratio in PXS Spurious ADS-4 with Failed CMTs | 41A-151 |
| 41A-222 | Case 3D-2: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs | 41A-151 |
| 41A-223 | Case 3D-2: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-224 | Case 3D-2: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-225 | Case 3D-2: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-226 | Case 3D-2: Containment Pressure Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-227 | Case 3D-2: Containment Gas Temperature Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-228 | Case 3D-2: Containment Compartments Water Level Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-229 | Case 3D-2: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-230 | Case 3D-2: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-231 | Case 3D-2: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-232 | Case 3D-2: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-233 | Case 3D-2: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-234 | Case 3D-2: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-235 | Case 3D-2: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-236 | Case 3D-2: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-237 | Case 3D-2: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs | 41A-159 |
| 41A-238 | Case 3D-2: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs | 41A-159 |
| 41A-239 | Case 3D-3: Reactor Coolant System Pressure DVI Line Break with no ADS | 41A-160 |
| 41A-240 | Case 3D-3: Core-Exit Gas Temperature DVI Line Break with no ADS | 41A-160 |
| 41A-241 | Case 3D-3: Reactor Vessel Mixture Level DVI Line Break with no ADS | 41A-161 |
| 41A-242 | Case 3D-3: Hydrogen Generated In-Vessel DVI Line Break with no ADS | 41A-161 |
| 41A-243 | Case 3D-3: Containment Pressure DVI Line Break with no ADS | 41A-162 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-244 | Case 3D-3: Containment Gas Temperature DVI Line Break with no ADS | 41A-162 |
| 41A-245 | Case 3D-3: Containment Compartments Water Level DVI Line Break with no ADS | 41A-163 |
| 41A-246 | Case 3D-3: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with no ADS | 41A-163 |
| 41A-247 | Case 3D-3: Well-Mixed Compartment Steam Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-248 | Case 3D-3: Well-Mixed Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-249 | Case 3D-3: Confined Compartment Hydrogen Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-250 | Case 3D-3: Confined Compartment Steam Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-251 | Case 3D-3: Confined Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-166 |
| 41A-252 | Case 3D-3: Equivalence Ratio in SG Room DVI Line Break with no ADS | 41A-166 |
| 41A-253 | Case 3D-3: Equivalence Ratio in CMT Room DVI Line Break with no ADS | 41A-167 |
| 41A-254 | Case 3D-3: Equivalence Ratio in IRWST DVI Line Break with no ADS | 41A-167 |
| 41A-255 | Case 3D-3: Equivalence Ratio in PXS DVI Line Break with no ADS..... | 41A-168 |
| 41A-256 | Case 3D-5: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-168 |
| 41A-257 | Case 3D-5: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-258 | Case 3D-5: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-259 | Case 3D-5: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-260 | Case 3D-5: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-261 | Case 3D-5: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-262 | Case 3D-5: Containment Compartments Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-263 | Case 3D-5: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-264 | Case 3D-5: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-265 | Case 3D-5: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-266 | Case 3D-5: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |
| 41A-267 | Case 3D-5: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-268 | Case 3D-5: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-269 | Case 3D-5: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-270 | Case 3D-5: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-271 | Case 3D-5: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-272 | Case 3D-5: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-273 | Case 1A-3: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-274 | Case 1A-3: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-275 | Case 1A-3: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-276 | Case 1A-3: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-277 | Case 1A-3: Containment Pressure FW Failure with Creep of SG Tubes | 41A-179 |
| 41A-278 | Case 1A-3: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-179 |
| 41A-279 | Case 1A-3: Containment Compartments Water Level FW Failure with Creep of SG Tubes | 41A-180 |
| 41A-280 | Case 1A-3: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-180 |
| 41A-281 | Case 1A-3: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-282 | Case 1A-3: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-283 | Case 1A-3: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-284 | Case 1A-3: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-285 | Case 1A-3: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-286 | Case 1A-3: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-287 | Case 1A-3: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-184 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-288 | Case 1A-3: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-184 |
| 41A-289 | Case 1A-3: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-185 |
| 41A-290 | Case 1A-3a: Reactor Coolant System Pressure Transient with Creep of SG Tubes | 41A-185 |
| 41A-291 | Case 1A-3a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-292 | Case 1A-3a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-293 | Case 1A-3a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-294 | Case 1A-3a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-295 | Case 1A-3a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-296 | Case 1A-3a: Containment Compartments Water Level Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-297 | Case 1A-3a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes | 41A-189 |
| 41A-298 | Case 1A-3a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-189 |
| 41A-299 | Case 1A-3a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes | 41A-190 |
| 41A-300 | Case 1A-3a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-190 |
| 41A-301 | Case 1A-3a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-302 | Case 1A-3a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-303 | Case 1A-3a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes | 41A-192 |
| 41A-304 | Case 1A-3a: Approximate Detonation Cell Width in CMT Room Transient with Creep of SG Tubes..... | 41A-192 |
| 41A-305 | Case 1A-3a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-193 |
| 41A-306 | Case 1A-3a: Approximate Detonation Cell Width in PXS Transient with Creep of SG Tubes | 41A-193 |
| 41A-307 | Case 1A-4: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes | 41A-194 |
| 41A-308 | Case 1A-4: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-194 |
| 41A-309 | Case 1A-4: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-195 |
| 41A-310 | Case 1A-4: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-195 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-311 | Case 1A-4: Containment Pressure FW Failure with Creep of SG Tubes | 41A-196 |
| 41A-312 | Case 1A-4: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-196 |
| 41A-313 | Case 1A-4: Containment Compartments Water Level FW Failure with Creep of SG Tubes..... | 41A-197 |
| 41A-314 | Case 1A-4: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-197 |
| 41A-315 | Case 1A-4: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-316 | Case 1A-4: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-317 | Case 1A-4: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-318 | Case 1A-4: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-319 | Case 1A-4: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-320 | Case 1A-4: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-321 | Case 1A-4: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-201 |
| 41A-322 | Case 1A-4: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-201 |
| 41A-323 | Case 1A-4: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-202 |
| 41A-324 | Case 1A-4a: Reactor Coolant System Pressure Transient with Creep of SG Tubes..... | 41A-202 |
| 41A-325 | Case 1A-4a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-326 | Case 1A-4a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-327 | Case 1A-4a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-328 | Case 1A-4a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-329 | Case 1A-4a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-205 |
| 41A-330 | Case 1A-4a: Containment Compartments Water Level Transient with Creep of SG Tubes..... | 41A-205 |
| 41A-331 | Case 1A-4a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-332 | Case 1A-4a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-333 | Case 1A-4a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-207 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-334 | Case 1A-4a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-207 |
| 41A-335 | Case 1A-4a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-336 | Case 1A-4a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-337 | Case 1A-4a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-338 | Case 1A-4a: Equivalence Ratio in CMT Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-339 | Case 1A-4a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-340 | Case 1A-4a: Equivalence Ratio in PXS Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-341 | Case 1AP-3: Reactor Coolant System Pressure SBLOCA, Failed PRHR and CMTs | 41A-211 |
| 41A-342 | Case 1AP-3: Core-Exit Gas Temperature SBLOCA, Failed PRHR and CMTs | 41A-211 |
| 41A-343 | Case 1AP-3: Reactor Vessel Mixture Level SBLOCA, Failed PRHR and CMTs | 41A-212 |
| 41A-344 | Case 1AP-3: Hydrogen Generated In-Vessel SBLOCA, Failed PRHR and CMTs | 41A-212 |
| 41A-345 | Case 1AP-3: Containment Pressure SBLOCA, Failed PRHR and CMTs..... | 41A-213 |
| 41A-346 | Case 1AP-3: Containment Gas Temperature SBLOCA, Failed PRHR and CMTs | 41A-213 |
| 41A-347 | Case 1AP-3: Containment Compartments Water Level SBLOCA, Failed PRHR and CMTs | 41A-214 |
| 41A-348 | Case 1AP-3: Well-Mixed Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs | 41A-214 |
| 41A-349 | Case 1AP-3: Well-Mixed Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs | 41A-215 |
| 41A-350 | Case 1AP-3: Well-Mixed Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs | 41A-215 |
| 41A-351 | Case 1AP-3: Confined Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs | 41A-216 |
| 41A-352 | Case 1AP-3: Confined Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs | 41A-216 |
| 41A-353 | Case 1AP-3: Confined Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs | 41A-217 |
| 41A-354 | Case 1AP-3: Equivalence Ratio in SG Room SBLOCA, Failed PRHR and CMTs | 41A-217 |
| 41A-355 | Case 1AP-3: Equivalence Ratio in CMT Room SBLOCA, Failed PRHR and CMTs | 41A-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-356 | Case 1AP-3: Equivalence Ratio in IRWST SBLOCA, Failed PRHR and CMTs | 41A-218 |
| 41A-357 | Case 1AP-3: Equivalence Ratio in PXS SBLOCA, Failed PRHR and CMTs | 41A-219 |
| 41A-358 | Case 1AP-4: Reactor Coolant System Pressure SBLOCA with Failed PRHR and ADS | 41A-219 |
| 41A-359 | Case 1AP-4: Core-Exit Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-360 | Case 1AP-4: Reactor Vessel Mixture Level SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-361 | Case 1AP-4: Hydrogen Generated In-Vessel SBLOCA with Failed PRHR and ADS..... | 41A-221 |
| 41A-362 | Case 1AP-4: Containment Pressure SBLOCA with Failed PRHR and ADS | 41A-221 |
| 41A-363 | Case 1AP-4: Containment Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-222 |
| 41A-364 | Case 1AP-4: Containment Compartments Water Level SBLOCA with Failed PRHR and ADS | 41A-222 |
| 41A-365 | Case 1AP-4: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-366 | Case 1AP-4: Well-Mixed Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-367 | Case 1AP-4: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-368 | Case 1AP-4: Confined Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-369 | Case 1AP-4: Confined Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-370 | Case 1AP-4: Confined Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-371 | Case 1AP-4: Equivalence Ratio in SG Room SBLOCA with Failed PRHR and ADS..... | 41A-226 |
| 41A-372 | Case 1AP-4: Equivalence Ratio in CMT Room SBLOCA with Failed PRHR and ADS | 41A-226 |
| 41A-373 | Case 1AP-4: Equivalence Ratio in IRWST SBLOCA with Failed PRHR and ADS..... | 41A-227 |
| 41A-374 | Case 1AP-4: Equivalence Ratio in PXS SBLOCA with Failed PRHR and ADS | 41A-227 |
| 41B-1 | Case 3BR – LLOCA with Accumulator Failure Reactor Coolant System Pressure..... | 41B-3 |
| 41B-2 | Case 3BR – LLOCA with Accumulator Failure Reactor Vessel Mixture Level..... | 41B-3 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41B-3 | Case 3BR – LLOCA with Accumulator Failure Core-Exit Gas Temperature..... | 41B-4 |
| 41B-4 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Generated In-Vessel | 41B-4 |
| 41B-5 | Case 3BR – LLOCA with Accumulator Failure Containment Pressure..... | 41B-5 |
| 41B-6 | Case 3BR – LLOCA with Accumulator Failure Containment Gas Temperature | 41B-5 |
| 41B-7 | Case 3BR – LLOCA with Accumulator Failure Containment Compartment Hydrogen Concentration..... | 41B-6 |
| 41B-8 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through Break | 41B-6 |
| 41B-9 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Hydrogen Concentration..... | 41B-7 |
| 41B-10 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Oxygen Concentration | 41B-7 |
| 41B-11 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Steam Concentration..... | 41B-8 |
| 41B-12 | Case 3BR – LLOCA with Accumulator Failure Approximate Detonation Cell Width in Steam Generator Compartment..... | 41B-8 |
| 41B-13 | Case 3BR – LLOCA with Accumulator Failure Containment Compartments Water Level..... | 41B-9 |
| 41B-14 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through ADS to IRWST | 41B-9 |
| 41B-15 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Hydrogen Concentration..... | 41B-10 |
| 41B-16 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Oxygen Concentration | 41B-10 |
| 41B-17 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Steam Concentration..... | 41B-11 |
| 42-1 | AP1000 Containment Fragility at Containment Temperature of 400°F | 42-12 |
| 42-2 | AP1000 Containment Fragility at Containment Temperature of 331°F | 42-13 |
| 43-1 | Plant Damage State Contributions to CDF..... | 43-119 |
| 43-2 | Containment Event Tree – CET (Sheets 1 – 3) | 43-120 |
| 43-3 | 3BE CET (Sheets 1 – 3)..... | 43-123 |
| 43-4 | 3BL CET (Sheets 1 – 3)..... | 43-126 |
| 43-5 | 3BR CET (Sheets 1 – 3)..... | 43-129 |
| 43-6 | 1A CET (Sheets 1 – 3)..... | 43-132 |
| 43-7 | 1AP CET (Sheets 1 – 3)..... | 43-135 |
| 43-8 | 3A CET (Sheets 1 – 3)..... | 43-138 |
| 43-9 | 3C CET (Sheets 1 – 3)..... | 43-141 |
| 43-10 | 3D CET (Sheets 1 – 3)..... | 43-144 |
| 43-11 | 6 CET (Sheets 1 – 3)..... | 43-147 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 43-12 | Contribution of PDS to LRF | 43-150 |
| 43-13 | Summary of CET Quantification (Sheets 1 – 2)..... | 43-151 |
| 44-1 | MAAP4 AP1000 Containment Nodalization | 44-12 |
| 45-1 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-7 |
| 45-2 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-7 |
| 45-3 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide | 45-8 |
| 45-4 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide | 45-8 |
| 45-5 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-9 |
| 45-6 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-9 |
| 45-7 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide | 45-10 |
| 45-8 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide | 45-10 |
| 45-9 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide | 45-11 |
| 45-10 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tin | 45-11 |
| 45-11 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium..... | 45-12 |
| 45-12 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide..... | 45-12 |
| 45-13 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Noble Gases..... | 45-13 |
| 45-14 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Iodide..... | 45-13 |
| 45-15 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium Dioxide | 45-14 |
| 45-16 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Strontium Oxide | 45-14 |
| 45-17 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Molybdenum Dioxide..... | 45-15 |
| 45-18 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Hydroxide..... | 45-15 |
| 45-19 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Barium Oxide | 45-16 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-20 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Dilanthanum Trioxide | 45-16 |
| 45-21 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cerium Dioxide | 45-17 |
| 45-22 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tin | 45-17 |
| 45-23 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium | 45-18 |
| 45-24 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Uranium Dioxide | 45-18 |
| 45-25 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Noble Gases | 45-19 |
| 45-26 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Iodide | 45-19 |
| 45-27 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium Dioxide | 45-20 |
| 45-28 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Strontium Oxide | 45-20 |
| 45-29 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Molybdenum Dioxide | 45-21 |
| 45-30 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Hydroxide | 45-21 |
| 45-31 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Barium Oxide | 45-22 |
| 45-32 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Dilanthanum Trioxide | 45-22 |
| 45-33 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cerium Dioxide | 45-23 |
| 45-34 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tin | 45-23 |
| 45-35 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium | 45-24 |
| 45-36 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Uranium Dioxide | 45-24 |
| 45-37 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Noble Gases | 45-25 |
| 45-38 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Iodide | 45-25 |
| 45-39 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium Dioxide | 45-26 |
| 45-40 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Strontium Oxide | 45-26 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 45-41 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Molybdenum Dioxide..... | 45-27 |
| 45-42 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Hydroxide..... | 45-27 |
| 45-43 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Barium Oxide | 45-28 |
| 45-44 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Dilanthanum Trioxide | 45-28 |
| 45-45 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cerium Dioxide | 45-29 |
| 45-46 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tin | 45-29 |
| 45-47 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium..... | 45-30 |
| 45-48 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Uranium Dioxide..... | 45-30 |
| 45-49 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Noble Gases | 45-31 |
| 45-50 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Iodide | 45-31 |
| 45-51 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium Dioxide..... | 45-32 |
| 45-52 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Strontium Oxide..... | 45-32 |
| 45-53 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Molybdenum Dioxide | 45-33 |
| 45-54 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Hydroxide | 45-33 |
| 45-55 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Barium Oxide..... | 45-34 |
| 45-56 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Dilanthanum Trioxide | 45-34 |
| 45-57 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cerium Dioxide..... | 45-35 |
| 45-58 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tin..... | 45-35 |
| 45-59 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium | 45-36 |
| 45-60 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Uranium Dioxide | 45-36 |
| 45-61 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 45-62 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-37 |
| 45-63 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide..... | 45-38 |
| 45-64 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide..... | 45-38 |
| 45-65 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-39 |
| 45-66 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-39 |
| 45-67 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide..... | 45-40 |
| 45-68 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide..... | 45-40 |
| 45-69 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide..... | 45-41 |
| 45-70 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tin..... | 45-41 |
| 45-71 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium..... | 45-42 |
| 45-72 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide..... | 45-42 |
| 45-73 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Noble Gases..... | 45-43 |
| 45-74 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Iodide..... | 45-43 |
| 45-75 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium Dioxide..... | 45-44 |
| 45-76 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Strontium Oxide..... | 45-44 |
| 45-77 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Molybdenum Dioxide..... | 45-45 |
| 45-78 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Hydroxide..... | 45-45 |
| 45-79 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Barium Oxide..... | 45-46 |
| 45-80 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Dilanthanum Trioxide..... | 45-46 |
| 45-81 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cerium Dioxide..... | 45-47 |
| 45-82 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tin..... | 45-47 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-83 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium..... | 45-48 |
| 45-84 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Uranium Dioxide..... | 45-48 |
| 45A-1 | AP1000 Fission Product Release Fractions for Release Category CFE – Noble Gases | 45A-3 |
| 45A-2 | AP1000 Fission Product Release Fractions for Release Category CFE – CsI and RbI | 45A-3 |
| 45A-3 | AP1000 Fission Product Release Fractions for Release Category CFE – TeO ₂ | 45A-4 |
| 45A-4 | AP1000 Fission Product Release Fractions for Release Category CFE – SrO | 45A-4 |
| 45A-5 | AP1000 Fission Product Release Fractions for Release Category CFE – MoO ₂ | 45A-5 |
| 45A-6 | AP1000 Fission Product Release Fractions for Release Category CFE – CsOH and RbOH | 45A-5 |
| 45A-7 | AP1000 Fission Product Release Fractions for Release Category CFE – BaO | 45A-6 |
| 45A-8 | AP1000 Fission Product Release Fractions for Release Category CFE – La ₂ O ₃ | 45A-6 |
| 45A-9 | AP1000 Fission Product Release Fractions for Release Category CFE – CeO ₂ | 45A-7 |
| 45A-10 | AP1000 Fission Product Release Fractions for Release Category CFE – Sb | 45A-7 |
| 45A-11 | AP1000 Fission Product Release Fractions for Release Category CFE – Te ₂ | 45A-8 |
| 45A-12 | AP1000 Fission Product Release Fractions for Release Category CFE – UO ₂ | 45A-8 |
| 45A-13 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – RCS Pressure | 45A-9 |
| 45A-14 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Reactor Vessel Mixture Level..... | 45A-9 |
| 45A-15 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Core-Exit Temperature..... | 45A-10 |
| 45A-16 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – In-Vessel Hydrogen Generation | 45A-10 |
| 45A-17 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Pressure..... | 45A-11 |
| 45A-18 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Gas Temperature..... | 45A-11 |
| 45A-19 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Hydrogen Concentration..... | 45A-12 |
| 45A-20 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Noble Gases Release Fraction..... | 45A-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 45A-21 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsI and RbI Release Fraction..... | 45A-13 |
| 45A-22 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – TeO ₂ Release Fraction..... | 45A-13 |
| 45A-23 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – SrO Release Fraction..... | 45A-14 |
| 45A-24 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – MoO ₂ Release Fraction | 45A-14 |
| 45A-25 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsOH and RbOH Release Fraction | 45A-15 |
| 45A-26 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – BaO Release Fraction..... | 45A-15 |
| 45A-27 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – La ₂ O ₃ Release Fraction | 45A-16 |
| 45A-28 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CeO ₂ Release Fraction | 45A-16 |
| 45A-29 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Sb Release Fraction..... | 45A-17 |
| 45A-30 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Te ₂ Release Fraction..... | 45A-17 |
| 45A-31 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – UO ₂ Release Fraction..... | 45A-18 |
| 45A-32 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Containment Pressure | 45A-18 |
| 45A-33 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Noble Gases Release Fraction..... | 45A-19 |
| 45A-34 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsI and RbI Release Fraction..... | 45A-19 |
| 45A-35 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – TeO ₂ Release Fraction..... | 45A-20 |
| 45A-36 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – SrO Release Fraction | 45A-20 |
| 45A-37 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – MoO ₂ Release Fraction | 45A-21 |
| 45A-38 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsOH and RbOH Release Fraction..... | 45A-21 |
| 45A-39 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – BaO Release Fraction..... | 45A-22 |
| 45A-40 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – La ₂ O ₃ Release Fraction | 45A-22 |
| 45A-41 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CeO ₂ Release Fraction | 45A-23 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45A-42 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Sb Release Fraction..... | 45A-23 |
| 45A-43 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Te ₂ Release Fraction | 45A-24 |
| 45A-44 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – UO ₂ Release Fraction..... | 45A-24 |
| 49-1 | Population Whole Body Dose – BP Source Term, 24 Hours | 49-20 |
| 49-2 | Population Whole Body Dose – BP Source Term 72 Hours | 49-20 |
| 49-3 | Site Boundary Whole Body Dose – BP Source Term, 24 Hours..... | 49-21 |
| 49-4 | Site Boundary Whole Body Dose – BP Source Term, 72 Hours..... | 49-21 |
| 49-5 | Site Boundary Red Bone Marrow Dose – BP Source Term, 24 Hours | 49-22 |
| 49-6 | Site Boundary Red Bone Marrow Dose – BP Source Term, 72 Hours | 49-22 |
| 49-7 | Site Boundary Thyroid Dose – BP Source Term, 24 Hours..... | 49-23 |
| 49-8 | Site Boundary Thyroid Dose – BP Source Term, 72 Hours..... | 49-23 |
| 49-9 | Population Whole Body Dose – CFE Source Term, 24 Hours..... | 49-24 |
| 49-10 | Population Whole Body Dose – CFE Source Term, 72 Hours..... | 49-24 |
| 49-11 | Site Boundary Whole Body Dose – CFE Source Term, 24 Hours | 49-25 |
| 49-12 | Site Boundary Whole Body Dose – CFE Source Term, 72 Hours | 49-25 |
| 49-13 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 24 Hours..... | 49-26 |
| 49-14 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 72 Hours..... | 49-26 |
| 49-15 | Site Boundary Thyroid Dose – CFE Source Term, 24 Hours..... | 49-27 |
| 49-16 | Site Boundary Thyroid Dose – CFE Source Term, 72 Hours..... | 49-27 |
| 49-17 | Population Whole Body Dose – CFI Source Term, 24 Hours..... | 49-28 |
| 49-18 | Population Whole Body Dose – CFI Source Term, 72 Hours..... | 49-28 |
| 49-19 | Site Boundary Whole Body Dose – CFI Source Term, 24 Hours | 49-29 |
| 49-20 | Site Boundary Whole Body Dose – CFI Source Term, 72 Hours | 49-29 |
| 49-21 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 24 Hours..... | 49-30 |
| 49-22 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 72 Hours..... | 49-30 |
| 49-23 | Site Boundary Thyroid Dose – CFI Source Term, 24 Hours..... | 49-31 |
| 49-24 | Site Boundary Thyroid Dose – CFI Source Term, 72 Hours..... | 49-31 |
| 49-25 | Population Whole Body Dose – CFL Source Term, 24 Hours..... | 49-32 |
| 49-26 | Population Whole Body Dose – CFL Source Term, 72 Hours..... | 49-32 |
| 49-27 | Site Boundary Whole Body Dose – CFL Source Term, 24 Hours | 49-33 |
| 49-28 | Site Boundary Whole Body Dose – CFL Source Term, 72 Hours | 49-33 |
| 49-29 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 24 Hours..... | 49-34 |
| 49-30 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 72 Hours..... | 49-34 |
| 49-31 | Site Boundary Thyroid Dose – CFL Source Term, 24 Hours..... | 49-35 |
| 49-32 | Site Boundary Thyroid Dose – CFL Source Term, 72 Hours..... | 49-35 |
| 49-33 | Population Whole Body Dose – CI Source Term, 24 Hours | 49-36 |
| 49-34 | Population Whole Body Dose – CI Source Term, 72 Hours | 49-36 |
| 49-35 | Site Boundary Whole Body Dose – CI Source Term, 24 Hours..... | 49-37 |
| 49-36 | Site Boundary Whole Body Dose – CI Source Term, 72 Hours..... | 49-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 49-37 | Site Boundary Red Bone Marrow Dose – CI Source Term, 24 Hours | 49-38 |
| 49-38 | Site Boundary Red Bone Marrow Dose – CI Source Term, 72 Hours | 49-38 |
| 49-39 | Site Boundary Thyroid Dose – CI Source Term, 24 Hours | 49-39 |
| 49-40 | Site Boundary Thyroid Dose – CI Source Term, 72 Hours | 49-39 |
| 49-41 | Population Whole Body Dose – DIRECT Source Term, 24 Hours..... | 49-40 |
| 49-42 | Population Whole Body Dose – DIRECT Source Term, 72 Hours..... | 49-40 |
| 49-43 | Site Boundary Whole Body Dose – DIRECT Source Term, 24 Hours | 49-41 |
| 49-44 | Site Boundary Whole Body Dose – DIRECT Source Term, 72 Hours | 49-41 |
| 49-45 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 24 Hours..... | 49-42 |
| 49-46 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 72 Hours..... | 49-42 |
| 49-47 | Site Boundary Thyroid Dose – DIRECT Source Term, 24 Hours..... | 49-43 |
| 49-48 | Site Boundary Thyroid Dose – DIRECT Source Term, 72 Hours..... | 49-43 |
| 49-49 | Population Whole Body Dose – IC Source Term, 24 Hours | 49-44 |
| 49-50 | Population Whole Body Dose – IC Source Term, 72 Hours | 49-44 |
| 49-51 | Site Boundary Whole Body Dose – IC Source Term, 24 Hours..... | 49-45 |
| 49-52 | Site Boundary Whole Body Dose – IC Source Term, 72 Hours..... | 49-45 |
| 49-53 | Site Boundary Red Bone Marrow Dose – IC Source Term, 24 Hours | 49-46 |
| 49-54 | Site Boundary Red Bone Marrow Dose – IC Source Term, 72 Hours | 49-46 |
| 49-55 | Site Boundary Thyroid Dose – IC Source Term, 24 Hours | 49-47 |
| 49-56 | Site Boundary Thyroid Dose – IC Source Term, 72 Hours..... | 49-47 |
| 49-57 | Overall Dose Risk – Site Boundary Whole Body EDE Dose, 24 Hours | 49-48 |
| 49-58 | Overall Dose Risk – Site Boundary Red Bone Marrow Dose (Acute), 24 Hours | 49-49 |
| 51-1 | AP1000 Base Core Damage Frequency Uncertainty Analysis | 51-11 |
| 51-2 | AP1000 Sensitivity Case Uncertainty Analysis..... | 51-11 |
| 51B-1 | Distribution for Plant Core Damage Frequency | 51B-2 |
| 51B-2 | Safety Injection Line Break..... | 51B-2 |
| 51B-3 | Large LOCA | 51B-3 |
| 51B-4 | Large Spurious ADS Actuation..... | 51B-3 |
| 51B-5 | Small LOCA | 51B-4 |
| 51B-6 | Medium LOCA | 51B-4 |
| 51B-7 | Reactor Vessel Rupture..... | 51B-5 |
| 51B-8 | Steam Generator Tube Rupture..... | 51B-5 |
| 51B-9 | Safety Injection Line Break – Sequence 7..... | 51B-6 |
| 51B-10 | Large LOCA – Sequence 9 | 51B-6 |
| 51B-11 | Spurious ADS – Sequence 8 | 51B-7 |
| 51B-12 | Safety Injection Line Break – Sequence 8d..... | 51B-7 |
| 51B-13 | Reactor Vessel Rupture – Sequence 2..... | 51B-8 |
| 51B-14 | Small LOCA – Sequence 5 | 51B-8 |
| 51B-15 | Medium LOCA – Sequence 5 | 51B-9 |
| 51B-16 | Small LOCA – Sequence 12 | 51B-9 |
| 51B-17 | Medium LOCA – Sequence 12 | 51B-10 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 51B-18 | Spurious ADS – Sequence 9 | 51B-10 |
| 51B-19 | Spurious ADS – Sequence 7 | 51B-11 |
| 51B-20 | Safety Injection Line Break – Sequence 3..... | 51B-11 |
| 51B-21 | SGTR Event – Sequence 41..... | 51B-12 |
| 51B-22 | ATWS Precursor with no MFW – Sequence 23 | 51B-12 |
| 51B-23 | Small LOCA – Sequence 9 | 51B-13 |
| 51B-24 | Medium LOCA – Sequence 9 | 51B-13 |
| 51B-25 | SGTR Event – Sequence 13..... | 51B-14 |
| 51B-26 | Large LOCA – Sequence 8 | 51B-14 |
| 51B-27 | CMT Line Break – Sequence 5 | 51B-15 |
| 54-1 | Loss of Offsite Power During Hot/Cold Shutdown (RCS Filled) Event Tree (Sheets 1 – 2)..... | 54-162 |
| 54-2 | Loss of RNS During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-164 |
| 54-3 | Loss of CCW/SW During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-165 |
| 54-4 | LOCA/RNS-V024 Opens During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-166 |
| 54-5 | LOCA/RNS Pipe Rupture During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-167 |
| 54-6 | Overdraining of Reactor Coolant System During Draindown to Mid-loop Event Tree..... | 54-168 |
| 54-7 | Loss of Offsite Power During RCS Drained Condition Event Tree | 54-169 |
| 54-8 | Loss of RNS During RCS Drained Condition Event Tree | 54-170 |
| 54-9 | Loss of CCW/SW During RCS Drained Condition Event Tree..... | 54-171 |
| 54-10 | LOCA/RNS-V024 Opens During RCS Drained Condition Event Tree..... | 54-172 |
| 55-1 | Seismic Initiating Event Hierarchy Tree | 55-30 |
| 57-1 | Example Event Tree Model..... | 57-125 |
| 57-2 | Contribution of Plant Areas to Fire CDF | 57-126 |
| 57-3 | Contribution of Fire Area to Fire CDF..... | 57-127 |
| 57A-1 | DAS-ACT Fault Tree..... | 57A-37 |
| 57C-1 | 0000 AF 00 Yard Building (Including Transformer Yard) | 57C-12 |
| 57C-2 | 1200 AF 01 RCA of Auxiliary Building (All Zones)..... | 57C-13 |
| 57C-3 | 1200 AF 02 New Fuel and Used Fuel Storage, Waste Disposal Container (All Zones)..... | 57C-14 |
| 57C-4 | 1200 AF 03 Corridors 100' & 117' 6"..... | 57C-15 |
| 57C-5 | 1201 AF 02 Division B Batteries/DC Equipment Room/Instrumentation and Control..... | 57C-16 |
| 57C-6 | 1201 AF 03 Division D DC Equipment/I&C..... | 57C-17 |
| 57C-7 | 1201 AF 04 Division B/D VBS Equipment..... | 57C-18 |
| 57C-8 | 1201 AF 05 MSIV Compartment A..... | 57C-19 |
| 57C-9 | 1201 AF 06 MSIV Compartment B | 57C-20 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 57C-10 | 1202 AF 02 Northeast Elevator Shaft | 57C-21 |
| 57C-11 | 1202 AF 03 Division C Batteries/DC Equipment/I&C Room/ RCP Trip Switchgear Room/I&C Penetration Room | 57C-22 |
| 57C-12 | 1202 AF 04 Division A Electrical Equipment/Battery Room/I&C Room..... | 57C-23 |
| 57C-13 | 1204 AF 01 RNS Pump Room B | 57C-24 |
| 57C-14 | 1204 AF 03 South Shield Building Elevator Shaft | 57C-25 |
| 57C-15 | 1205 AF 02 Southeast Elevator Shaft | 57C-26 |
| 57C-16 | 1210 AF 01 Corridor/Spare Battery Room/Spare Room/Spare Battery Charger Room | 57C-27 |
| 57C-17 | 1220 AF 01 Division B RCP Trip Switchgear/Spare Room/Corridor 82' 6" | 57C-28 |
| 57C-18 | 1220 AF 02 Lower Annulus Valve Area..... | 57C-29 |
| 57C-19 | 1230 AF 01 Corridor Division A, B, C, D and Remote Shutdown Workstation..... | 57C-30 |
| 57C-20 | 1230 AF 02 Non-Class 1E Electrical Compartment - 100' | 57C-31 |
| 57C-21 | 1232 AF 01 Remote Shutdown Workstation..... | 57C-32 |
| 57C-22 | 1240 AF 01 Non-Class 1E Electrical Compartment - 117' | 57C-33 |
| 57C-23 | 1242 AF 02 Division A Penetration Area | 57C-34 |
| 57C-24 | 1243 AF 01 Reactor Trip Switchgear I | 57C-35 |
| 57C-25 | 1243 AF 02 Reactor Trip Switchgear II | 57C-36 |
| 57C-26 | 1250 AF 01 Nonradioactive Ventilation System..... | 57C-37 |
| 57C-27 | 2000 AF 01 Turbine Building Floor | 57C-38 |
| 57C-28 | 2003 AF 01 Auxiliary Boiler Equipment Room | 57C-39 |
| 57C-29 | 2009 AF 02 Elevator Machine Room..... | 57C-40 |
| 57C-30 | 2033 AF 02 Motor-Driven Fire Pump Room | 57C-41 |
| 57C-31 | 2040 AF 01 Clean and Dirty Lube Oil Storage..... | 57C-42 |
| 57C-32 | 2043 AF 01 Chemical Laboratory | 57C-43 |
| 57C-33 | 2050 AF 01 Lube Oil Conditioner Room..... | 57C-44 |
| 57C-34 | 2052 AF 01 Southwest 6.9KV Switchgear Room..... | 57C-45 |
| 57C-35 | 2053 AF 01 Electrical Equipment Room | 57C-46 |
| 57C-36 | 2053 AF 02 Northwest 6.9KV Switchgear Room..... | 57C-47 |
| 57C-37 | 4003 AF 01 Demineralized Water Deoxygenating Room/ Air Handling Equipment Rooms..... | 57C-48 |
| 57C-38 | 4031 AF 01 Battery Room and Battery Charger Room 1..... | 57C-49 |
| 57C-39 | 4031 AF 02 Battery Room and Battery Charger Room 2/ Computer Room B/Shift Turnover Room | 57C-50 |
| 57C-40 | 4031 AF 05 Corridor/Spare Battery Room/Spare Room/ Spare Battery Charger Room..... | 57C-51 |
| 57C-41 | 4031 AF 06 Central Alarm Station/Security Room 1 | 57C-52 |
| 57C-42 | 4032 AF 01 Decontamination Room, Non-Radiological and Radiological Controlled Area Entry/Exit Area..... | 57C-53 |
| 57C-43 | 4032 AF 02 Containment Access Corridor Elevation 107' 2" | 57C-54 |
| 57C-44 | 4033 AF 01 Hot Machine Shop | 57C-55 |
| 57C-45 | 4034 AF 01 General Offices | 57C-56 |
| 57C-46 | 4041 AF 01 Conference Rooms/Computer Room A/Corridor..... | 57C-57 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 57C-47 | 4041 AF 02 Corridor/Restroom | 57C-58 |
| 57C-48 | 4042 AF 01 Non-Class 1E Switchgear #1..... | 57C-59 |
| 57C-49 | 4042 AF 02 Non-Class 1E Switchgear #2..... | 57C-60 |
| 57C-50 | 4052 AF 01 Staging and Storage Area/Containment Air Filtration Exhaust Rooms A & B..... | 57C-61 |
| 57C-51 | 5031 AF 01 Radwaste Building | 57C-62 |
| 57C-52 | 6030 AF 01 Diesel Generator Room A | 57C-63 |
| 57C-53 | 6030 AF 02 Diesel Generator Room B | 57C-64 |
| 57C-54 | 6030 AF 03 Fuel Oil Day Tank Room A | 57C-65 |
| 57C-55 | 6030 AF 04 Fuel Oil Day Take Room B..... | 57C-66 |
| 57C-56 | 1100 AF 11204 Reactor Coolant Drain Tank Room..... | 57C-67 |
| 57C-57 | 1100 AF 11206 Accumulator Room A | 57C-68 |
| 57C-58 | 1100 AF 11207 Accumulator Room B | 57C-69 |
| 57C-59 | 1100 AF 11208 RNS Valve Room..... | 57C-70 |
| 57C-60 | 1100 AF 11300A Maintenance Floor (SE Quadrant Access) | 57C-71 |
| 57C-61 | 1100 AF 11300B Maintenance Floor (NNE Quadrant) and RCDT Access..... | 57C-72 |
| 57C-62 | 1100 AF 11301 SG Compartment 1..... | 57C-73 |
| 57C-63 | 1100 AF 11302 SG Compartment 2..... | 57C-74 |
| 57C-64 | 1100 AF 11303 Pressurizer Compartment | 57C-75 |
| 57C-65 | 1100 AF 11303A ADS Lower Valve Area | 57C-76 |
| 57C-66 | 1100 AF 11303B ADS Upper Valve Area..... | 57C-77 |
| 57C-67 | 1100 AF 11500 Operating Deck | 57C-78 |
| 57C-68 | 1200 AF 12341 Middle Annulus | 57C-79 |
| 57C-69 | 1200 AF 12555 Main Control Room Emergency Habitability System Air Storage/Operating Deck Staging Area | 57C-80 |
| 59-1 | Contribution of Initiating Events to Core Damage..... | 59-99 |
| 59-2 | 24-Hour Site Boundary Dose Cumulative Frequency Distribution | 59-100 |

REVISION 1 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 1 Change Roadmap | ci through civ | Editorial |
| 1 | 1-6 | Editorial |
| 3 | 3-4 | Editorial |
| Attachment 4B | 4B-24 | 720.027 |
| Attachment 4B | 4B-74 | Editorial |
| 6 | 6-9 | 720.025 (720.029) |
| 6 | 6-12 | 720.025 (720.029) Editorial |
| 6 | 6-16 | Editorial |
| 6 | 6-17 | 720.026 |
| 6 | 6-19 through 6-53 | 720.023 (720.024) (720.097) |
| 6 | 6-62 | 720.031 |
| 6 | 6-69 | 720.025 (720.029) |
| 6 | 6-71 | 720.025 (720.029) |
| 8 | 8-23 and 8-25 | Editorial |
| 12 | 12-6 | 720.033 |
| 12 | 12-30 | 720.033 |
| 26 | 26-11 and 26-12 | Editorial |
| 28 | 28-10 and 28-11 | Editorial |
| 29 | 29-17 | 720.033 |
| 29 | 29-21 | 720.033 |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|---|
| 30 | 30-35 and 30-36 | 720.068 |
| 30 | 30-66 and 30-67 | 720.068 |
| 30 | 30-110 | Editorial |
| 34 | 34-1 | 720.042 |
| 34 | 34-4 and 34-5 | 720.042 |
| 34 | 34-6 and 34-7 | 720.042 |
| | | Editorial |
| 34 | 34-8 through 34-243 | 720.042 |
| 35 | 35-28 | 720.043 |
| 39 | 39-4 | 720.073 |
| | | Editorial |
| 39 | 39-5 | 720.088 |
| | | (720.048, 720.074, 720.083, 720.089) |
| 39 | 39-6 | 720.088 |
| | | 720.073 |
| | | (720.048, 720.074, 720.083, and 720.089) |
| 39 | 39-12 | Editorial |
| 39 | 39-19 | Editorial |
| 39 | 39-20 | 720.073 |
| 39 | 39-21 | Editorial |
| | | 720.088 |
| Attachment 39A | 39A-1 through 39A-40 | 720.088 |
| | | (720.048, 720.074, 720.083, and 720.089) |
| 41 | 41-6 | 720.042 |
| 41 | 41-15 | 720.093 |
| 41 | 41-20 | 720.054 |
| 41 | 41-31 | Editorial |
| Attachment 41A | 41A-1 through 41A-228 | 720.042 |
| Attachment 41B | 41B-1 through 41B-11 | 720.093 |
| 43 | 43-126 and 43-127 | Editorial |
| Attachment 43C | 43C-1 and 43C-2 | 720.043 |
| 44 | 44-7 | Editorial |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|----------------------|--|
| 45 | 45-1 through 45-3 | 470.013 (470.012) |
| 45 | 45-4 | 470.013 (470.012) Editorial |
| 45 | 45-5 through 45-48 | 470.013 (470.012) |
| 49 | 49-1 | 720.056 |
| 49 | 49-4 through 49-6 | 720.056 |
| 49 | 49-9 through 49-49 | 720.056 |
| 50 | 50-14 | 720.034 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 57 | 57-1 through 57-109 | Letter DCP/NRC1515 |
| Attachment 57A | 57A-1 through 57A-37 | Letter DCP/NRC1515 |
| Attachment 57B | 57B-1 through 57B-6 | Letter DCP/NRC1515 |
| Attachment 57C | 57C-1 through 57C-80 | Letter DCP/NRC1515 |
| Attachment 57D | 57D-1 through 57D-7 | Letter DCP/NRC1515 |
| 59 | 59-20 and 59-21 | Editorial |
| 59 | 59-23 through 59-25 | Letter DCP/NRC1515 |
| 59 | 59-26 | 720.056 |
| 59 | 59-28 | Editorial |
| 59 | 59-29 through 59-32 | 720.038 |
| 59 | 59-34 through 59-38 | 720.038 |
| 59 | 59-72 | Editorial |
| 59 | 59-73 | Technical |
| 59 | 59-83 | Editorial |
| 59 | 59-75 through 59-96 | 720.038 |
| 59 | 59-97 | 720.038 720.066 |
| 59 | 59-98 | 720.038 |
| 59 | 59-100 | Technical |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-------------------|-------------------------------------|
| Appendix A | A-1 through A-166 | 720.007 |
| | | 720.010 |
| | | 720.011 |
| | | 720.012 |
| | | 720.013 |
| | | 720.015 |
| | | 720.016 |
| | | 720.058 |
| Appendix B | B-6 | 720.058 |
| Appendix B | B-13 | 720.076 |
| Appendix D | D-14 and D-15 | 720.078 |
| Appendix D | D-31 | 720.078 |
| Appendix D | D-35 and D-36 | Technical |
| Appendix D | D-37 through D-58 | 720.078 |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number. RAI number in parenthesis contains a reference to RAI response listed above.

REVISION 2 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 2 Change Roadmap | cv through cvii | Editorial |
| 6 | 6-17 | 720.026 (R1) |
| 6 | 6-28 | 720.024 (R1) |
| 6 | 6-32 and 6-33 | 720.024 (R1) |
| 6 | 6-37 through 6-39 | 720.024 (R1) |
| 6 | 6-41 | 720.024 (R1) |
| 6 | 6-50 through 6-53 | 720.024 (R1) |
| 6 | 6-69 | 720.029 (R1) |
| 24 | 24-17 | 720.046 (R1) |
| 24 | 24-22 and 24-23 | 720.046 (R1) |
| 24 | 24-27 | 720.046 (R1) |
| 30 | 30-26a through 30-28 | 720.029 (R1) |
| 35 | 35-28 | 720.043 (R1) |
| 43 | 43-9 and 43-9a | 720.039 (R2) |
| 43 | 43-9b | Editorial |
| 43 | 43-10a | 720.039 (R2) |
| 43 | 43-10b | Editorial |
| 43 | 43-93a through 43-93w | 720.039 (R2) |
| 43 | 93-93x | Editorial |
| Attachment 43C | 43C-2 | 720.043 (R1) |
| 50 | 50-1 | |
| 50 | 50-1a and 50-1b | Editorial |
| 50 | 50-14 | 720.039 (R2) |
| 50 | 50-14a | 720.039 (R2) |
| 50 | 50-14b | Editorial |
| 54 | 54-1 through 54-131 | 720.038 (R2) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|-------------------------------------|
| 56 | 56-1 | 720.038 (R1) Editorial |
| 56 | 56-9 | Editorial |
| 56 | 56-17 and 56-18 | Editorial |
| 56 | 56-20 | Editorial |
| 56 | 56-36 and 56-37 | Editorial |
| 56 | 56-38 | Editorial 720.038 (R1) |
| 56 | 56-38a through 56-38k | 720.038 (R1) |
| 56 | 56-38l | Editorial |
| 56 | 56-47 through 56-49 | Editorial |
| 56 | 56-51 | Editorial |
| 56 | 56-54 and 56-55 | 720.038 (R1) |
| 57 | 57-14 and 57-15 | 280.011 (R1) |
| 57 | 57-15a and 57-15b | Editorial |
| 59 | 59-23 and 59-23a | 720.038 (R1) |
| 59 | 59-23b | Editorial |
| 59 | 59-34 | 720.038 (R1) |
| 59 | 59-72 | 720.038 (R1) |
| Appendix A | A-12 | Editorial |
| Appendix A | A-24 through A-26 | 440.014 (R1) |
| Appendix A | A-26a | 440.014 (R1) 720.024 (R1) |
| Appendix A | A-26b | Editorial |
| Appendix A | A-27 | 720.012 (R1) |
| Appendix A | A-31 | 720.012 (R1) |
| Appendix A | A-33 | 720.010 (R1) |
| Appendix A | A-33a and A-33b | Editorial |
| Appendix A | A-44 | Editorial |
| Appendix A | A-57 through A-61 | 720.012 (R1) |
| Appendix A | A-63 | 720.012 (R1) |
| Appendix A | A-66 | 720.012 (R1) |
| Appendix A | A-103a through A-103b | 440.014 (R1) |
| Appendix A | A-103c and A-103d | 720.012 (R1) |
| Appendix A | A-151 and A-152 | 720.013 (R1) |
| Appendix A | A-165 and A-166 | 720.013 (R1) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------|-------------------------------------|
| Appendix D | D-13 and D-14 | 720.080 (R1) |
| Appendix D | D-35 and D-36 | 720.080 (R1) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 3 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through cii | Editorial |
| Revision 3 Change Roadmap | cx | Editorial |
| Attachment 45A | 45A-1 through 45A-24 | Technical |
| 57 | 57-1 and 57-2 | Editorial |
| 57 | 57-4 | Editorial |
| 57 | 57-11 and 57-12 | Editorial |
| 57 | 57-17 | Editorial |
| 57 | 57-22 and 57-23 | Editorial |
| 57 | 57-30 through 57-39 | 720.038 (R1) |
| 57 | 57-40 | 720.038 (R1) |
| | | Editorial |
| 57 | 57-41 and 57-42 | 720.038 (R1) |
| 57 | 57-78 | Editorial |
| 57 | 57-117 through 57-124 | 720.038 (R1) |
| Appendix A | A-23 through A-25 | 720.009 (R2) |
| Appendix A | A-105 through A-111 | 720.009 (R2) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 4 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|---|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 4 Change Roadmap | cxii and cxiii | Editorial |
| 34 | 34-4 | Editorial |
| 34 | 34-16 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-19 through 34-21 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-50 and 34-51 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-247 through 34-264 | DSER OI 19.1.10.3-1 (R1) |
| 42 | 42-3 | DSER OI 19.2.6-1 (R1) |
| 42 | 42-6 | DSER OI 19.2.6-3 |
| 42 | 42-7 and 42-8 | Editorial |
| 43 | 43-10 | Editorial |
| 43 | 43-13 | Editorial |
| Attachment 43D | 43D-1 | DSER OI 19.1.3.2-1 |
| Attachment 43E | 43E-1 and 43E-2 | DSER OI 19.1.3.2-2 |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-5 and 45-6 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-13 through 45-18 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R1) |
| Attachment 45A | 45A-1 through 45A-24 | Deleted per DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-6 | DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-9 through 49-49 | DSER OI 19.1.10.3-1 (R1) |
| 50 | 50-1 | Editorial |
| 54 | 54-9 | DSER OI 19.1.10.2-3 |
| 54 | 54-12 | DSER OI 19.1.10.2-3 |
| 54 | 54-13 | Editorial |
| 54 | 54-22 through 54-71 | Editorial |
| 54 | 54-76 through 54-80 | DSER OI 19.1.10.2-5 Editorial |

REVISION 4 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|---|
| 54 | 54-83 through 54-110 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-112 through 54-118 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-121 through 54-137 | DSER OI 19.1.10.2-3 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) Editorial |
| 55 | 55-16 through 55-18 | Editorial |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 55 | 55-25 through 55-29 | Editorial |
| 56 | 56-46 | DSER OI 19.3.10-1 |
| 59 | 59-26 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-37 | DSER OI 19A.3-2 (R1) |
| 59 | 59-45 through 59-70 | Editorial |
| 59 | 59-73 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-74 | Editorial |
| 59 | 59-100 | DSER OI 19.1.10.3-1 (R1) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 5 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 5 Change Roadmap | cxiv and cxv | Editorial |
| 43 | 43-10 and 43-11 | DSER OI 19.1.3.2-2 (R1) |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R2) |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R2) |
| | | Editorial |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R2) |
| 54 | 54-3 | Editorial |
| 54 | 54-11 | DSER OI 19.1.10.2-4 (R1) |
| 54 | 54-76 through 54-99 | DSER OI 19.1.10.2-4 (R1) |
| 55 | 55-23 | DSER OI 19A.2-8 (R2) |
| 59 | 59-45 | Editorial |
| 59 | 59-77 | Editorial |
| 59 | 59-81 | Editorial |
| 59 | 59-83 | Editorial |
| 59 | 59-90 | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.1-2 (R2) |
| Appendix A | A-8 | Editorial |
| Appendix A | A-17 | Editorial |
| Appendix A | A-19 | Editorial |
| Appendix A | A-21 | Editorial |
| Appendix A | A-23 and A-24 | DSER OI 19.1.10.1-5 (R2) |
| | | Editorial |
| Appendix A | A-25 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-43 | Editorial |
| Appendix A | A-45 and A-46 | DSER OI 19.1.10.1-5 (R2) |
| | | Editorial |
| Appendix A | A-47 and A-48 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-104 through A-109 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-154 through A-158 | DSER OI 19.1.10.1-5 (R2) |

REVISION 5 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|-----------------------|------------------------|--|
| Appendix A | A-159 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-160 and A-161 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-162 and A-163 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-164 through A-175 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-176 and A-177 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-178 through A-181 | DSER OI 19.1.10.1-5 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 6 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 6 Change Roadmap | cxvi | Editorial |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R3) |
| 55 | 55-11 | Editorial |
| 55 | 55-20 | Editorial |
| 55 | 55-21 through 55-24 | Editorial (per Oct. 6-9 meeting) |
| 59 | 59-98 | DSER OI 19.1.10.2-6 (R2) |
| Appendix A | A-41 | DSER OI 21.5-2 |
| Appendix A | A-46 and A-47 | DSER OI 15.2.7-1 Item 7 (R5) |
| Appendix A | A-135 through A-141 | DSER OI 21.5-2 |
| Appendix A | A-154 through A-167 | DSER OI 15.2.7-1 Item 7 (R5) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 7 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|------------------------|--|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 7 Change Roadmap | cxvii | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.2-1 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 8 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 8 Change Roadmap | cxviii | Editorial |
| 59 | 59-92 | NRC Comments |
| 59 | 59-98 | NRC Comments |

Volume 4

TABLE OF CONTENTS

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------------|---|-------------|
| | LIST OF TABLES | xxxv |
| | LIST OF FIGURES | liii |
| | REVISION 1 CHANGE ROADMAP | civ |
| | REVISION 2 CHANGE ROADMAP | cviii |
| | REVISION 3 CHANGE ROADMAP | cxi |
| | REVISION 4 CHANGE ROADMAP | cxii |
| | REVISION 5 CHANGE ROADMAP | cxiv |
| | REVISION 6 CHANGE ROADMAP | cxvi |
| | REVISION 7 CHANGE ROADMAP | cxvii |
| | REVISION 8 CHANGE ROADMAP | cxviii |
| CHAPTER 1 | INTRODUCTION | |
| 1.1 | Introduction | 1-1 |
| 1.1.1 | Background and Overview..... | 1-1 |
| 1.1.2 | Objectives | 1-1 |
| 1.1.3 | Technical Scope..... | 1-2 |
| 1.1.4 | Project Methodology Overview | 1-3 |
| 1.1.5 | Results | 1-4 |
| 1.1.6 | Plant Definition..... | 1-6 |
| 1.1.7 | References..... | 1-6 |
| CHAPTER 2 | INTERNAL INITIATING EVENTS | |
| 2.1 | Introduction | 2-1 |
| 2.2 | Internal Initiating Event Identification and Categorization | 2-1 |
| 2.2.1 | Logic Diagram for Internal Initiating Events | 2-2 |
| 2.2.2 | Loss-of-Coolant Accidents..... | 2-3 |
| 2.2.3 | Transients..... | 2-6 |
| 2.2.4 | Anticipated Transient without Scram..... | 2-8 |
| 2.2.5 | AP1000 Specific Initiating Event Analysis..... | 2-10 |
| 2.2.6 | Consequential Events..... | 2-19 |
| 2.2.7 | Summary of Internal Initiating Event Categories | 2-19 |
| 2.3 | Internal Initiating Event Frequency Quantification | 2-20 |
| 2.3.1 | Quantification of LOCA Initiating Event Frequencies..... | 2-20 |
| 2.3.2 | Quantification of Transient Initiating Event Frequencies | 2-24 |
| 2.3.3 | ATWS Precursor Initiating Event Frequency | 2-27 |
| 2.3.4 | Summary of Internal Initiating Event Frequencies..... | 2-27 |
| 2.4 | References..... | 2-27 |
| ATTACHMENT 2A | QUANTIFICATION OF LOCA INITIATING EVENT FREQUENCIES | |
| 2A-1 | Primary System Pipe Break Frequencies..... | 2A-1 |
| 2A-2 | Reactor Cooling System Leakage Initiating Event Frequency | 2A-1 |
| 2A-3 | Steam Generator Tube Rupture Initiating Event Frequency..... | 2A-1 |
| 2A-4 | Quantification of Stuck-Open Pressurizer Safety Valve, Accumulator Interface Break, and IRWST Interface Break..... | 2A-1 |
| 2A-5 | Initiating Events Review Data Summary and INPO Data | 2A-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| ATTACHMENT 2B QUANTIFICATION OF TRANSIENT INITIATING EVENT FREQUENCIES | | |
| 2B-1 | Secondary Side Line Breaks & Stuck-open Main Steam Line Safety Valve Frequencies..... | 2B-1 |
| CHAPTER 3 MODELING OF SPECIAL INITIATORS | | |
| 3.1 | Introduction..... | 3-1 |
| 3.2 | Ground Rules for Special Initiating Event Analysis..... | 3-1 |
| 3.3 | Loss of Component Cooling Water System/Service Water System Initiating Event..... | 3-1 |
| 3.4 | Loss of Compressed and Instrument Air System Initiating Event..... | 3-2 |
| 3.5 | Spurious Actuation of Automatic Depressurization System..... | 3-2 |
| 3.5.1 | Evaluation of Automatic Depressurization System Spurious Actuation | 3-3 |
| CHAPTER 4 EVENT TREE MODELS | | |
| 4.1 | Introduction..... | 4-1 |
| 4.2 | Large LOCA Event Tree Model..... | 4-1 |
| 4.2.1 | Event Description | 4-1 |
| 4.2.2 | Event Tree Model and its Nodes..... | 4-2 |
| 4.2.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-4 |
| 4.2.4 | Operator Actions..... | 4-4 |
| 4.2.5 | Transfers and Consequential Events | 4-4 |
| 4.3 | Large Spurious ADS Event Tree Model | 4-4 |
| 4.3.1 | Event Description | 4-4 |
| 4.3.2 | Event Tree Model and its Nodes..... | 4-4 |
| 4.3.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-6 |
| 4.3.4 | Operator Actions..... | 4-6 |
| 4.3.5 | Transfers and Consequential Events | 4-6 |
| 4.4 | Medium LOCA Event Tree Model | 4-6 |
| 4.4.1 | Event Description | 4-6 |
| 4.4.2 | Event Tree Model and its Nodes..... | 4-7 |
| 4.4.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-9 |
| 4.4.4 | Operator Actions..... | 4-9 |
| 4.4.5 | Transfers and Consequential Events | 4-10 |
| 4.5 | Core Makeup Tank Line Break Event Tree Model | 4-10 |
| 4.5.1 | Event Description | 4-10 |
| 4.5.2 | Event Tree Model and its Nodes..... | 4-10 |
| 4.5.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-13 |
| 4.5.4 | Operator Actions..... | 4-13 |
| 4.5.5 | Transfers and Consequential Events | 4-13 |
| 4.6 | Safety Injection Line Break Event Tree Model | 4-13 |
| 4.6.1 | Event Description | 4-13 |
| 4.6.2 | Event Tree Model and its Nodes..... | 4-14 |
| 4.6.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| | 4.6.4 Operator Actions..... | 4-16 |
| | 4.6.5 Transfers and Consequential Events..... | 4-17 |
| 4.7 | Small LOCA Event Tree Model..... | 4-17 |
| | 4.7.1 Event Description..... | 4-17 |
| | 4.7.2 Event Tree Model and its Nodes..... | 4-17 |
| | 4.7.3 Event Tree Success Criteria and Core Damage Categories..... | 4-20 |
| | 4.7.4 Operator Actions..... | 4-20 |
| | 4.7.5 Transfers and Consequential Events..... | 4-21 |
| 4.8 | RCS Leak Event Tree Model..... | 4-21 |
| | 4.8.1 Event Description..... | 4-21 |
| | 4.8.2 Event Tree Model and its Nodes..... | 4-21 |
| | 4.8.3 Event Tree Success Criteria..... | 4-22 |
| | 4.8.4 Operator Actions..... | 4-22 |
| | 4.8.5 Transfers and Consequential Events..... | 4-22 |
| | 4.8.6 Core Damage Categories..... | 4-23 |
| 4.9 | PRHR Tube Rupture Event Tree Model..... | 4-23 |
| | 4.9.1 Event Description..... | 4-23 |
| | 4.9.2 Event Tree Model and its Nodes..... | 4-23 |
| | 4.9.3 Event Tree Success Criteria..... | 4-24 |
| | 4.9.4 Operator Actions..... | 4-24 |
| | 4.9.5 Transfers and Consequential Events..... | 4-24 |
| | 4.9.6 Core Damage Categories..... | 4-24 |
| 4.10 | Steam Generator Tube Rupture Event Tree Model..... | 4-25 |
| | 4.10.1 Event Description..... | 4-25 |
| | 4.10.2 Event Tree Model and its Nodes..... | 4-27 |
| | 4.10.3 Event Tree Success Criteria and Core Damage Categories..... | 4-33 |
| | 4.10.4 Operator Actions..... | 4-33 |
| | 4.10.5 Transfers and Consequential Events..... | 4-33 |
| 4.11 | Reactor Vessel Rupture Event Tree Model..... | 4-34 |
| | 4.11.1 Event Description..... | 4-34 |
| | 4.11.2 Event Tree Model and its Nodes..... | 4-34 |
| | 4.11.3 Event Tree Success Criteria..... | 4-34 |
| | 4.11.4 Operator Actions..... | 4-34 |
| | 4.11.5 Transfers and Consequential Events..... | 4-34 |
| | 4.11.6 Core Damage Categories..... | 4-34 |
| 4.12 | Interfacing System LOCA Event Tree Model..... | 4-34 |
| | 4.12.1 Event Description..... | 4-34 |
| | 4.12.2 Event Tree Model and its Nodes..... | 4-35 |
| | 4.12.3 Event Tree Success Criteria..... | 4-35 |
| | 4.12.4 Operator Actions..... | 4-35 |
| | 4.12.5 Transfers and Consequential Events..... | 4-35 |
| | 4.12.6 Core Damage Categories..... | 4-35 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 4.13 | Transients With MFW Event Tree Model..... | 4-35 |
| 4.13.1 | Event Description | 4-35 |
| 4.13.2 | Event Tree Model and its Nodes..... | 4-37 |
| 4.13.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-41 |
| 4.13.4 | Operator Actions..... | 4-41 |
| 4.13.5 | Transfers and Consequential Events | 4-42 |
| 4.14 | Transients With Loss of RCS Flow Event Tree Model..... | 4-42 |
| 4.14.1 | Event Description | 4-42 |
| 4.14.2 | Event Tree Model and its Nodes..... | 4-42 |
| 4.14.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-46 |
| 4.14.4 | Operator Actions..... | 4-46 |
| 4.14.5 | Transfers and Consequential Events | 4-46 |
| 4.15 | Transients With Loss of MFW to One Steam Generator Event Tree Model..... | 4-46 |
| 4.15.1 | Event Description | 4-46 |
| 4.15.2 | Event Tree Model and its Nodes..... | 4-47 |
| 4.15.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-50 |
| 4.15.4 | Operator Actions..... | 4-50 |
| 4.15.5 | Transfers and Consequential Events | 4-51 |
| 4.16 | Transients With Core Power Excursion Event Tree Model..... | 4-51 |
| 4.16.1 | Event Description | 4-51 |
| 4.16.2 | Event Tree Model and its Nodes..... | 4-51 |
| 4.16.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-55 |
| 4.16.4 | Operator Actions..... | 4-55 |
| 4.16.5 | Transfers and Consequential Events | 4-55 |
| 4.17 | Transients With Loss of CCW/SW Event Tree Model..... | 4-56 |
| 4.17.1 | Event Description | 4-56 |
| 4.17.2 | Event Tree Model and its Nodes..... | 4-56 |
| 4.17.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-59 |
| 4.17.4 | Operator Actions..... | 4-59 |
| 4.17.5 | Transfers and Consequential Events | 4-60 |
| 4.18 | Loss of Main Feedwater Event Tree Model | 4-60 |
| 4.18.1 | Event Description | 4-60 |
| 4.18.2 | Event Tree Model and its Nodes..... | 4-62 |
| 4.18.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-65 |
| 4.18.4 | Operator Actions..... | 4-65 |
| 4.18.5 | Transfers and Consequential Events | 4-66 |
| 4.19 | Loss of Condenser Event Tree Model | 4-66 |
| 4.19.1 | Event Description | 4-66 |
| 4.19.2 | Event Tree Model and its Nodes..... | 4-66 |
| 4.19.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-70 |
| 4.19.4 | Operator Actions..... | 4-70 |
| 4.19.5 | Transfers and Consequential Events | 4-70 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 4.20 | Loss of Compressed Air Event Tree Model | 4-70 |
| 4.20.1 | Event Description | 4-70 |
| 4.20.2 | Event Tree Model and its Nodes | 4-71 |
| 4.20.3 | Event Tree Success Criteria and Core Damage Categories | 4-74 |
| 4.20.4 | Operator Actions | 4-74 |
| 4.20.5 | Transfers and Consequential Events | 4-75 |
| 4.21 | Loss of Offsite Power Event Tree Model | 4-75 |
| 4.21.1 | Event Description | 4-75 |
| 4.21.2 | Event Tree Model and its Nodes | 4-75 |
| 4.21.3 | Event Tree Success Criteria and Core Damage Categories | 4-79 |
| 4.21.4 | Operator Actions | 4-79 |
| 4.21.5 | Transfers and Consequential Events | 4-80 |
| 4.22 | Main Steam Line Break Downstream of MSIVs Event Tree Model | 4-80 |
| 4.22.1 | Event Description | 4-80 |
| 4.22.2 | Event Tree Model and its Nodes | 4-81 |
| 4.22.3 | Event Tree Success Criteria and Core Damage Categories | 4-84 |
| 4.22.4 | Operator Actions | 4-84 |
| 4.22.5 | Transfers and Consequential Events | 4-85 |
| 4.23 | Main Steam Line Break Upstream of MSIVs Event Tree Model | 4-85 |
| 4.23.1 | Event Description | 4-85 |
| 4.23.2 | Event Tree Model and its Nodes | 4-85 |
| 4.23.3 | Event Tree Success Criteria and Core Damage Categories | 4-89 |
| 4.23.4 | Operator Actions | 4-89 |
| 4.23.5 | Transfers and Consequential Events | 4-90 |
| 4.24 | Stuck-Open Secondary Side Safety Valve Event Tree Model | 4-90 |
| 4.24.1 | Event Description | 4-90 |
| 4.24.2 | Event Tree Model and its Nodes | 4-91 |
| 4.24.3 | Event Tree Success Criteria and Core Damage Categories | 4-94 |
| 4.24.4 | Operator Actions | 4-94 |
| 4.24.5 | Transfers and Consequential Events | 4-94 |
| 4.25 | ATWS Precursors Without MFW Event Tree Model | 4-95 |
| 4.25.1 | Event Description | 4-95 |
| 4.25.2 | Event Tree Model and its Nodes | 4-96 |
| 4.25.3 | Event Tree Success Criteria and Core Damage Categories | 4-101 |
| 4.25.4 | Operator Actions | 4-101 |
| 4.25.5 | Transfers and Consequential Events | 4-101 |
| 4.26 | ATWS Precursor with SI Event Tree Model | 4-101 |
| 4.26.1 | Event Description | 4-101 |
| 4.26.2 | Event Tree Model and its Nodes | 4-102 |
| 4.26.3 | Event Tree Success Criteria and Core Damage Categories | 4-106 |
| 4.26.4 | Operator Actions | 4-106 |
| 4.26.5 | Transfers and Consequential Events | 4-106 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-----------------|
| 4.27 | ATWS Precursor Transients with MFW Event Tree Model | 4-106 |
| 4.27.1 | Event Description | 4-106 |
| 4.27.2 | Event Tree Model and its Nodes..... | 4-107 |
| 4.27.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-110 |
| 4.27.4 | Operator Actions..... | 4-111 |
| 4.27.5 | Transfers and Consequential Events..... | 4-111 |
| ATTACHMENT 4A EVENT TREE GUIDELINES | | |
| 4A.1 | Event Tree Analysis Methodology | 4A-1 |
| 4A.2 | Event Tree Guidelines for Core Damage | 4A-3 |
| 4A.2.1 | Event Trees | 4A-3 |
| 4A.2.2 | Success Criteria..... | 4A-6 |
| 4A.2.3 | Definition of End States..... | 4A-7 |
| 4A.2.4 | Plant Response Functions | 4A-9 |
| 4A.2.5 | Event Tree Node Notation | 4A-13 |
| 4A.2.6 | Consequential Events..... | 4A-13 |
| 4A.2.7 | Transient Template | 4A-14 |
| 4A.2.8 | Small LOCA Template | 4A-15 |
| ATTACHMENT 4B EVENT TREE PICTURES..... | | 4B-1 |
| CHAPTER 5 SUPPORT SYSTEMS | | |
| 5.1 | Introduction..... | 5-1 |
| 5.2 | Support Systems and Their Interdependencies..... | 5-1 |
| 5.3 | Front Line Systems and Their Dependencies | 5-1 |
| CHAPTER 6 SUCCESS CRITERIA ANALYSIS | | |
| 6.1 | Introduction..... | 6-1 |
| 6.2 | Acceptance Criteria and Critical Functions for Success Criteria..... | 6-1 |
| 6.3 | Event Sequences and Timing, Passive/Active System Interactions..... | 6-3 |
| 6.3.1 | General Sequence Success Criteria..... | 6-3 |
| 6.3.2 | Timing of Events and Key Operator Actions..... | 6-9 |
| 6.3.3 | Passive/Active System Interactions..... | 6-15 |
| 6.3.4 | Sequence Success Criteria Summary | 6-18 |
| 6.4 | Event Tree Top Events Success Criteria | 6-18 |
| 6.5 | References..... | 6-19 |
| CHAPTER 7 FAULT TREE GUIDELINES | | |
| 7.1 | Purpose..... | 7-1 |
| 7.2 | Fault Tree Development..... | 7-1 |
| 7.2.1 | Procedural Steps for Fault Tree Preparation | 7-1 |
| 7.2.2 | Procedural Steps for Fault Tree Construction | 7-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 7.3 | Primary Events to be Considered in Fault Trees | 7-3 |
| 7.3.1 | Random Component Failure | 7-3 |
| 7.3.2 | Outage for Maintenance and Testing | 7-5 |
| 7.3.3 | Common Cause Failures | 7-6 |
| 7.3.4 | Human Errors..... | 7-6 |
| 7.3.5 | Power and Control Model..... | 7-9 |
| 7.4 | Data Base | 7-10 |
| 7.5 | Fault Tree Model: Identification Codes..... | 7-10 |
| 7.5.1 | Identification Code for Fault Tree Names..... | 7-10 |
| 7.5.2 | Identification Code for Support Systems | 7-10 |
| 7.5.3 | Identification Code for Primary Event Names | 7-11 |
| 7.5.4 | Identification Code for Common Cause Failures..... | 7-11 |
| 7.5.5 | Identification Code for Undeveloped Events (Modules)..... | 7-12 |
| 7.5.6 | Identification Code for Operator Errors | 7-13 |
| 7.6 | Fault Tree Quantification | 7-13 |
| 7.7 | References..... | 7-14 |
| | | |
| CHAPTER 8 | PASSIVE CORE COOLING SYSTEM – PASSIVE RESIDUAL HEAT REMOVAL | |
| 8.1 | System Function..... | 8-1 |
| 8.2 | System Description | 8-1 |
| 8.2.1 | Support Systems | 8-1 |
| 8.2.2 | Instrumentation and Control | 8-2 |
| 8.2.3 | Test and Maintenance | 8-2 |
| 8.3 | System Operation | 8-3 |
| 8.4 | Performance During Accident Conditions | 8-3 |
| 8.4.1 | Plant Shutdown..... | 8-3 |
| 8.4.2 | Loss of Coolant Accidents | 8-3 |
| 8.4.3 | Passive Residual Heat Removal Heat Exchanger Tube Rupture..... | 8-3 |
| 8.5 | Initiating Events Review | 8-4 |
| 8.5.1 | Initiating Events Impacting the PRHR System | 8-4 |
| 8.5.2 | Initiating Events Caused by PRHR System Malfunction | 8-4 |
| 8.6 | System Logic Models..... | 8-4 |
| 8.6.1 | Assumptions and Boundary Conditions..... | 8-5 |
| 8.6.2 | Fault Tree Models..... | 8-6 |
| 8.6.3 | Human Interactions..... | 8-6 |
| 8.6.4 | Common Cause Failures | 8-6 |
| 8.7 | Quantification and Results | 8-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| CHAPTER 9 | PASSIVE CORE COOLING SYSTEM – CORE MAKEUP TANK | |
| 9.1 | System Description | 9-1 |
| 9.1.1 | Support Systems | 9-1 |
| 9.1.2 | Instrumentation and Control | 9-1 |
| 9.1.3 | Test and Maintenance Assumptions..... | 9-2 |
| 9.2 | System Operation | 9-2 |
| 9.3 | Performance During Accident Conditions | 9-3 |
| 9.3.1 | Inadvertent Opening of a Steam Generator Relief or Safety Valve..... | 9-3 |
| 9.3.2 | Steam Line Break..... | 9-3 |
| 9.3.3 | Steam Generator Tube Rupture..... | 9-3 |
| 9.3.4 | Reactor Coolant System Heatup Transients..... | 9-4 |
| 9.3.5 | Loss-of-Coolant Accidents..... | 9-4 |
| 9.3.6 | Loss of Offsite Power | 9-4 |
| 9.3.7 | Anticipated Transient without Trip..... | 9-4 |
| 9.4 | Initiating Event Review..... | 9-4 |
| 9.4.1 | Initiating Events Impacting the Core Makeup Tank Subsystem | 9-5 |
| 9.4.2 | Initiating Events Due to Loss of the Core Makeup Tank Subsystem..... | 9-5 |
| 9.5 | System Logic Models..... | 9-5 |
| 9.5.1 | Assumptions and Boundary Conditions..... | 9-5 |
| 9.5.2 | Fault Tree Models..... | 9-7 |
| 9.5.3 | Human Interactions..... | 9-7 |
| 9.5.4 | Common Cause Failures | 9-8 |
| CHAPTER 10 | PASSIVE CORE COOLING SYSTEM – ACCUMULATOR | |
| 10.1 | System Description | 10-1 |
| 10.1.1 | Support Systems | 10-1 |
| 10.1.2 | Instrumentation and Control | 10-1 |
| 10.1.3 | Test and Maintenance Assumptions..... | 10-1 |
| 10.2 | System Operation | 10-1 |
| 10.3 | Performance During Accident Conditions | 10-2 |
| 10.3.1 | Steam Line Break..... | 10-2 |
| 10.3.2 | Loss-of-Coolant Accidents or Non-Loss-of-Coolant Accidents with Automatic Depressurization System | 10-2 |
| 10.4 | Initiating Event Review..... | 10-3 |
| 10.4.1 | Initiating Events Impacting the Accumulator Subsystem..... | 10-3 |
| 10.4.2 | Initiating Events Due to Loss of the Accumulator Subsystem | 10-3 |
| 10.5 | System Logic Models..... | 10-3 |
| 10.5.1 | Assumptions and Boundary Conditions..... | 10-3 |
| 10.5.2 | Fault Tree Models..... | 10-4 |
| 10.5.3 | Human Interactions..... | 10-4 |
| 10.5.4 | Common Cause Failures | 10-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 11 PASSIVE COOLING SYSTEM – AUTOMATIC DEPRESSURIZATION SYSTEM | | |
| 11.1 | System Function..... | 11-1 |
| 11.2 | System Description | 11-1 |
| | 11.2.1 Support Systems | 11-1 |
| | 11.2.2 Instrumentation and Control | 11-2 |
| | 11.2.3 Test and Maintenance | 11-2 |
| 11.3 | System Operation | 11-2 |
| 11.4 | Performance During Accident Conditions | 11-3 |
| | 11.4.1 Loss of Coolant Accidents | 11-3 |
| | 11.4.2 Transients..... | 11-3 |
| 11.5 | Initiating Events Review | 11-3 |
| | 11.5.1 Initiating Events Impacting the Automatic Depressurization System | 11-3 |
| | 11.5.2 Initiating Events Caused by the ADS Malfunction | 11-4 |
| 11.6 | System Logic Model | 11-4 |
| | 11.6.1 Assumptions and Boundary Conditions..... | 11-4 |
| | 11.6.2 Fault Tree Models..... | 11-5 |
| | 11.6.3 Human Interactions..... | 11-6 |
| | 11.6.4 Common Cause Failures | 11-7 |
| 11.7 | Quantification and Results | 11-7 |
| CHAPTER 12 PASSIVE CORE COOLING SYSTEM – IN-CONTAINMENT REFUELING WATER STORAGE TANK | | |
| 12.1 | System Function..... | 12-1 |
| 12.2 | System Description | 12-1 |
| | 12.2.1 Support Systems | 12-1 |
| | 12.2.2 Instrumentation and Control | 12-1 |
| | 12.2.3 Test and Maintenance | 12-2 |
| 12.3 | System Operation | 12-2 |
| 12.4 | Performance During Accident Conditions | 12-2 |
| | 12.4.1 Transients..... | 12-3 |
| | 12.4.2 Loss of Coolant Accidents | 12-4 |
| | 12.4.3 In-Vessel Core Damage Mitigation..... | 12-5 |
| | 12.4.4 Containment Isolation System Failure | 12-5 |
| 12.5 | Initiating Event..... | 12-5 |
| | 12.5.1 Initiating Event Impacting IRWST/Gravity Injection Subsystem | 12-5 |
| | 12.5.2 Initiating Event due to Loss of IRWST/Gravity Injection Subsystem..... | 12-5 |
| 12.6 | System Logic Models..... | 12-6 |
| | 12.6.1 Assumptions and Boundary Conditions..... | 12-6 |
| | 12.6.2 Fault Tree Models..... | 12-8 |
| | 12.6.3 Human Interactions..... | 12-8 |
| | 12.6.4 Common Cause Failures | 12-8 |
| 12.7 | Quantification and Results | 12-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 13 PASSIVE CONTAINMENT COOLING SYSTEM | | |
| 13.1 | System Description | 13-1 |
| | 13.1.1 Support Systems | 13-1 |
| | 13.1.2 Instrumentation and Control | 13-1 |
| | 13.1.3 Test and Maintenance Assumptions..... | 13-2 |
| 13.2 | System Operation | 13-2 |
| 13.3 | Performance During Accident Conditions | 13-2 |
| | 13.3.1 Post-Reactor Trip with Loss of All ac Power..... | 13-2 |
| | 13.3.2 Automatic Depressurization System Actuation..... | 13-2 |
| | 13.3.3 Post-Loss-of-Coolant Accident..... | 13-3 |
| | 13.3.4 Post-Main Steam Line Break | 13-3 |
| 13.4 | Initiating Event Review..... | 13-3 |
| | 13.4.1 Initiating Events Impacting the Passive Containment Cooling System..... | 13-3 |
| | 13.4.2 Initiating Events due to Loss of the Passive Containment Cooling System | 13-3 |
| 13.5 | System Logic Model | 13-3 |
| | 13.5.1 Assumptions and Boundary Conditions..... | 13-4 |
| | 13.5.2 Fault Tree Model | 13-5 |
| | 13.5.3 Human Interactions..... | 13-6 |
| | 13.5.4 Common Cause Failures..... | 13-6 |
| CHAPTER 14 MAIN AND STARTUP FEEDWATER SYSTEM | | |
| 14.1 | System Description | 14-1 |
| | 14.1.1 Support Systems | 14-1 |
| | 14.1.2 Instrumentation and Control | 14-2 |
| | 14.1.3 Test and Maintenance | 14-2 |
| 14.2 | System Operation | 14-2 |
| 14.3 | Performance During Accident Conditions | 14-2 |
| 14.4 | Initiating Event Review..... | 14-4 |
| | 14.4.1 Initiating Event Impacting Main and Startup Feedwater/ Condensate System..... | 14-4 |
| | 14.4.2 Initiating Event due to Loss of Main and Startup Feedwater/ Condensate System | 14-4 |
| 14.5 | System Logic Models..... | 14-4 |
| | 14.5.1 Assumptions and Boundary Conditions..... | 14-5 |
| | 14.5.2 Fault Tree Models..... | 14-7 |
| | 14.5.3 Human Interactions..... | 14-7 |
| | 14.5.4 Common Cause Failures..... | 14-7 |
| 14.6 | Quantification and Results | 14-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 15 CHEMICAL AND VOLUME CONTROL SYSTEM | | |
| 15.1 | System Description | 15-1 |
| 15.1.1 | Support Systems | 15-1 |
| 15.1.2 | Instrumentation and Control Assumptions..... | 15-1 |
| 15.1.3 | Test and Maintenance Assumptions..... | 15-2 |
| 15.2 | System Operation | 15-3 |
| 15.3 | Performance During Accident Conditions | 15-3 |
| 15.4 | Initiating Event Review..... | 15-4 |
| 15.4.1 | Initiating Events Impacting the Chemical and Volume Control System | 15-5 |
| 15.4.2 | Initiating Events Due to Loss of the Chemical and Volume Control System | 15-5 |
| 15.5 | System Logic Models..... | 15-5 |
| 15.5.1 | Assumptions and Boundary Conditions..... | 15-5 |
| 15.5.2 | Fault Tree Models..... | 15-7 |
| 15.5.3 | Human Interactions..... | 15-7 |
| 15.5.4 | Common Cause Failures..... | 15-8 |
| CHAPTER 16 CONTAINMENT HYDROGEN CONTROL SYSTEM | | |
| 16.1 | System Description | 16-1 |
| 16.1.1 | Support Systems | 16-1 |
| 16.1.2 | Instrumentation and Control | 16-1 |
| 16.1.3 | Test and Maintenance | 16-1 |
| 16.2 | System Operation | 16-2 |
| 16.3 | Performance During Accident Conditions | 16-2 |
| 16.4 | Initiating Event Review..... | 16-2 |
| 16.5 | System Logic Model | 16-2 |
| 16.5.1 | Assumptions and Boundary Conditions..... | 16-2 |
| 16.5.2 | Fault Tree Model | 16-3 |
| 16.5.3 | Human Interactions..... | 16-3 |
| 16.5.4 | Common Cause Failures..... | 16-4 |
| CHAPTER 17 NORMAL RESIDUAL HEAT REMOVAL SYSTEM | | |
| 17.1 | System Description | 17-1 |
| 17.1.1 | Support Systems | 17-1 |
| 17.1.2 | Instrumentation and Control | 17-1 |
| 17.1.3 | Test and Maintenance Assumptions..... | 17-1 |
| 17.2 | System Operation | 17-1 |
| 17.3 | Performance During Accident Conditions | 17-2 |
| 17.4 | Initiating Event Review..... | 17-3 |
| 17.4.1 | Initiating Events Impacting the Normal Residual Heat Removal System | 17-3 |
| 17.4.2 | Initiating Events Due to Loss of the Normal Residual Heat Removal System | 17-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 17.5 | System Logic Models..... | 17-4 |
| 17.5.1 | Assumptions and Boundary Conditions..... | 17-4 |
| 17.5.2 | Fault Tree Models..... | 17-6 |
| 17.5.3 | Human Interactions..... | 17-6 |
| 17.5.4 | Common Cause Failures..... | 17-6 |
| 17.6 | References..... | 17-6 |
| | | |
| CHAPTER 18 COMPONENT COOLING WATER SYSTEM | | |
| 18.1 | System Description..... | 18-1 |
| 18.1.1 | Support Systems..... | 18-1 |
| 18.1.2 | Instrumentation and Control..... | 18-1 |
| 18.1.3 | Test and Maintenance Assumptions..... | 18-1 |
| 18.2 | System Operation..... | 18-2 |
| 18.3 | Performance During Accident Conditions..... | 18-2 |
| 18.4 | Initiating Event Review..... | 18-2 |
| 18.4.1 | Initiating Events Impacting the Component Cooling Water System..... | 18-2 |
| 18.4.2 | Initiating Events Due to Loss of the Component Cooling Water System..... | 18-3 |
| 18.5 | System Logic Models..... | 18-3 |
| 18.5.1 | Assumptions and Boundary Conditions..... | 18-3 |
| 18.5.2 | Fault Tree Models..... | 18-4 |
| 18.5.3 | Human Interactions..... | 18-4 |
| 18.5.4 | Common Cause Failures..... | 18-5 |
| | | |
| CHAPTER 19 SERVICE WATER SYSTEM | | |
| 19.1 | System Description..... | 19-1 |
| 19.1.1 | Support Systems..... | 19-1 |
| 19.1.2 | Instrumentation and Control..... | 19-1 |
| 19.1.3 | Test and Maintenance Assumptions..... | 19-1 |
| 19.2 | System Operation..... | 19-2 |
| 19.3 | Performance During Accident Conditions..... | 19-2 |
| 19.4 | Initiating Event Review..... | 19-2 |
| 19.4.1 | Initiating Events Impacting the Service Water System..... | 19-2 |
| 19.4.2 | Initiating Events Due to Loss of the Service Water System..... | 19-2 |
| 19.5 | System Logic Models..... | 19-3 |
| 19.5.1 | Assumptions and Boundary Conditions..... | 19-3 |
| 19.5.2 | Fault Tree Models..... | 19-4 |
| 19.5.3 | Human Interactions..... | 19-5 |
| 19.5.4 | Common Cause Failures..... | 19-5 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 20 CENTRAL CHILLED WATER SYSTEM | | |
| 20.1 | System Description | 20-1 |
| | 20.1.1 Support Systems | 20-1 |
| | 20.1.2 Instrumentation and Control | 20-1 |
| | 20.1.3 Test and Maintenance Assumptions..... | 20-1 |
| 20.2 | System Operation | 20-2 |
| 20.3 | Performance During Accident Conditions | 20-2 |
| 20.4 | Initiating Event Review..... | 20-2 |
| | 20.4.1 Initiating Events Impacting the Central Chilled Water System..... | 20-2 |
| | 20.4.2 Initiating Events Due to Loss of the Central Chilled Water System | 20-3 |
| 20.5 | System Logic Model | 20-3 |
| | 20.5.1 Assumptions and Boundary Conditions..... | 20-3 |
| | 20.5.2 Fault Tree Model | 20-4 |
| | 20.5.3 Human Interactions..... | 20-4 |
| | 20.5.4 Common Cause Failures | 20-4 |
| CHAPTER 21 AC POWER SYSTEM | | |
| 21.1 | System Description | 21-1 |
| | 21.1.1 Support Systems | 21-1 |
| | 21.1.2 Instrumentation and Control | 21-2 |
| | 21.1.3 Test and Maintenance Assumptions..... | 21-2 |
| 21.2 | System Operation | 21-2 |
| 21.3 | Performance During Accident Conditions | 21-3 |
| | 21.3.1 Automatic Load Shedding | 21-3 |
| | 21.3.2 Manual Transfer..... | 21-3 |
| | 21.3.3 Electric Circuit Protection..... | 21-3 |
| 21.4 | Initiating Event Review | 21-3 |
| | 21.4.1 Loss of the Main Generator | 21-4 |
| | 21.4.2 Loss of Offsite Power | 21-4 |
| | 21.4.3 Loss of 6900-vac and 480-vac Busses | 21-4 |
| 21.5 | System Logic Models..... | 21-4 |
| | 21.5.1 Assumptions and Boundary Conditions..... | 21-5 |
| | 21.5.2 Fault Tree Models..... | 21-7 |
| | 21.5.3 Human Interactions..... | 21-8 |
| | 21.5.4 Common Cause Failures | 21-8 |
| CHAPTER 22 CLASS 1E DC AND UNINTERRUPTIBLE POWER SUPPLY SYSTEM | | |
| 22.1 | System Description | 22-1 |
| | 22.1.1 Support Systems | 22-1 |
| | 22.1.2 Instrumentation and Control | 22-1 |
| | 22.1.3 Test and Maintenance Assumptions..... | 22-1 |
| 22.2 | System Operation | 22-2 |
| 22.3 | Performance During Accident Conditions | 22-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 22.4 | Initiating Event Review..... | 22-2 |
| 22.4.1 | Initiating Events Impacting the Class 1E dc and UPS System..... | 22-3 |
| 22.4.2 | Initiating Events Due to Loss of the Class 1E dc and UPS System..... | 22-3 |
| 22.5 | System Logic Models..... | 22-3 |
| 22.5.1 | Assumptions and Boundary Conditions..... | 22-3 |
| 22.5.2 | Fault Tree Models..... | 22-4 |
| 22.5.3 | Human Interactions..... | 22-4 |
| 22.5.4 | Common Cause Failures..... | 22-4 |
| 22.6 | References..... | 22-5 |
| | | |
| CHAPTER 23 | NON-CLASS 1E DC AND UPS SYSTEM | |
| 23.1 | System Description..... | 23-1 |
| 23.1.1 | Support Systems..... | 23-1 |
| 23.1.2 | Instrumentation and Control..... | 23-1 |
| 23.1.3 | Test and Maintenance Assumptions..... | 23-1 |
| 23.2 | System Operation..... | 23-2 |
| 23.3 | Performance During Accident Conditions..... | 23-2 |
| 23.4 | Initiating Event Review..... | 23-2 |
| 23.4.1 | Initiating Events Impacting the Non-Class 1E dc and UPS System..... | 23-2 |
| 23.4.2 | Initiating Events Due to Loss of the Non-Class 1E dc and UPS Power System..... | 23-3 |
| 23.5 | System Logic Models..... | 23-3 |
| 23.5.1 | Assumptions and Boundary Conditions..... | 23-3 |
| 23.5.2 | Fault Tree Models..... | 23-4 |
| 23.5.3 | Human Interactions..... | 23-5 |
| 23.5.4 | Common Cause Failures..... | 23-5 |
| 23.6 | References..... | 23-5 |
| | | |
| CHAPTER 24 | CONTAINMENT ISOLATION | |
| 24.1 | System Description..... | 24-1 |
| 24.1.1 | Support Systems..... | 24-1 |
| 24.1.2 | Instrumentation and Control..... | 24-1 |
| 24.1.3 | Test and Maintenance Assumptions..... | 24-2 |
| 24.2 | System Operation..... | 24-2 |
| 24.3 | Performance During Accident Conditions..... | 24-2 |
| 24.4 | Initiating Event Review..... | 24-2 |
| 24.4.1 | Initiating Events Impacting Containment Isolation..... | 24-2 |
| 24.4.2 | Initiating Events Due to Loss of the Containment Isolation System..... | 24-2 |
| 24.5 | System Logic Models..... | 24-3 |
| 24.5.1 | Assumptions and Boundary Conditions..... | 24-4 |
| 24.5.2 | Fault Tree Models..... | 24-5 |
| 24.5.3 | Human Interactions..... | 24-6 |
| 24.5.4 | Common Cause Failures..... | 24-6 |
| 24.6 | References..... | 24-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|-------------|
| CHAPTER 25 COMPRESSED AND INSTRUMENT AIR SYSTEM | | |
| 25.1 | System Description | 25-1 |
| 25.1.1 | Support Systems | 25-2 |
| 25.1.2 | Instrumentation and Control | 25-2 |
| 25.1.3 | Test and Maintenance Assumptions..... | 25-3 |
| 25.2 | System Operation | 25-3 |
| 25.3 | Performance During Accident Conditions | 25-3 |
| 25.4 | Initiating Event Review..... | 25-4 |
| 25.4.1 | Initiating Events Impacting the Instrument Air Subsystem..... | 25-4 |
| 25.4.2 | Initiating Events Due to Loss of the Instrument Air Subsystem | 25-4 |
| 25.5 | System Logic Models..... | 25-4 |
| 25.5.1 | Assumptions and Boundary Conditions..... | 25-4 |
| 25.5.2 | Fault Tree Models..... | 25-6 |
| 25.5.3 | Human Interactions..... | 25-7 |
| 25.5.4 | Common Cause Failures | 25-7 |
| CHAPTER 26 PROTECTION AND SAFETY MONITORING SYSTEM | | |
| 26.1 | System Analysis Description..... | 26-1 |
| 26.1.1 | Analysis of Support Systems..... | 26-4 |
| 26.1.2 | Analysis of Instrumentation | 26-5 |
| 26.1.3 | Test and Maintenance Assumptions..... | 26-6 |
| 26.2 | Performance During Accident Conditions | 26-7 |
| 26.3 | Initiating Event Review..... | 26-7 |
| 26.3.1 | Initiating Event Impacting PMS..... | 26-7 |
| 26.3.2 | Initiating Event due to Loss of PMS | 26-8 |
| 26.4 | System Logic Model Development | 26-8 |
| 26.4.1 | Assumptions and Boundary Conditions..... | 26-8 |
| 26.4.2 | Fault Tree Models..... | 26-12 |
| 26.4.3 | Description of I&C Subtree Development | 26-12 |
| 26.4.4 | Human Interactions..... | 26-19 |
| 26.5 | Discussion of Methodology..... | 26-19 |
| 26.5.1 | Fault Tree Analysis | 26-20 |
| 26.5.2 | Unavailability..... | 26-20 |
| 26.5.3 | Spurious Failure Rate Per Year..... | 26-20 |
| 26.5.4 | Common Cause Failures | 26-22 |
| 26.5.5 | Data Manipulation | 26-23 |
| 26.6 | References..... | 26-24 |
| CHAPTER 27 DIVERSE ACTUATION SYSTEM | | |
| 27.1 | System Analysis Description..... | 27-1 |
| 27.1.1 | Support Systems Analysis..... | 27-2 |
| 27.1.2 | Analysis of Instrumentation and Control | 27-2 |
| 27.1.3 | Test and Maintenance | 27-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 27.2 | Analysis of System Operation | 27-2 |
| 27.3 | Performance During Accident Conditions | 27-6 |
| 27.4 | Initiating Event Review..... | 27-6 |
| 27.4.1 | Initiating Events Impacting the Diverse Actuation System..... | 27-6 |
| 27.4.2 | Initiating Events Due to Loss of the Diverse Actuation System..... | 27-6 |
| 27.5 | System Logic Model | 27-6 |
| 27.5.1 | Assumptions and Boundary Conditions..... | 27-7 |
| 27.5.2 | Fault Tree Model | 27-7 |
| 27.5.3 | Human Interactions..... | 27-7 |
| 27.5.4 | Common Cause Failures..... | 27-8 |
| | | |
| CHAPTER 28 | PLANT CONTROL SYSTEM | |
| 28.1 | System Analysis Description..... | 28-1 |
| 28.1.1 | Analysis of Support Systems..... | 28-3 |
| 28.1.2 | Analysis of Instrumentation | 28-4 |
| 28.1.3 | Test and Maintenance Assumptions..... | 28-4 |
| 28.2 | Performance During Accident Conditions | 28-6 |
| 28.3 | Initiating Event Review..... | 28-6 |
| 28.3.1 | Initiating Events Impacting the Plant Control System..... | 28-6 |
| 28.3.2 | Initiating Event due to Loss of the Plant Control System..... | 28-6 |
| 28.4 | System Logic Model Development | 28-7 |
| 28.4.1 | Assumptions and Boundary Conditions..... | 28-7 |
| 28.4.2 | Fault Tree Models..... | 28-9 |
| 28.4.3 | Description of I&C Subtree Development | 28-10 |
| 28.4.4 | Human Interactions..... | 28-16 |
| 28.5 | Discussion of Methodology..... | 28-17 |
| 28.5.1 | Fault Tree Analysis | 28-17 |
| 28.5.2 | Unavailability..... | 28-17 |
| 28.5.3 | Common Cause Failures | 28-17 |
| 28.5.4 | Data Manipulation | 28-18 |
| | | |
| CHAPTER 29 | COMMON-CAUSE ANALYSIS | |
| 29.1 | Introduction..... | 29-1 |
| 29.2 | Dependent Failures | 29-1 |
| 29.3 | Common-Cause Analysis..... | 29-4 |
| 29.3.1 | Assumptions | 29-4 |
| 29.3.2 | Analysis of Potential Common-Cause Failures within the Systems..... | 29-6 |
| 29.3.3 | Analysis of Potential Common-Cause Failures among Several Systems | 29-6 |
| 29.4 | Calculations For Component Groups | 29-6 |
| 29.4.1 | DC Batteries..... | 29-7 |
| 29.4.2 | Reactor Trip Breakers | 29-8 |
| 29.4.3 | Automatic Depressurization System Explosive Valves..... | 29-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|--------------|
| 29.4.4 | Air-Operated Valves in Core Makeup Tanks..... | 29-10 |
| 29.4.5 | Automatic Depressurization System Motor-Operated Valves..... | 29-11 |
| 29.4.6 | Common-Cause Failure for IRWST Valves..... | 29-14 |
| 29.5 | Results..... | 29-17 |
| 29.6 | References..... | 29-17 |
| ATTACHMENT 29A COMMON-CAUSE ANALYSIS GUIDELINES..... | | 29A-1 |
| 29A.1 | Introduction..... | 29A-1 |
| 29A.2 | Types of Dependencies | 29A-1 |
| 29A.3 | Common Cause Failures Definition | 29A-2 |
| 29A.4 | Methodology..... | 29A-3 |
| 29A.5 | Common Cause Failures Calculation Procedure | 29A-4 |
| 29A.5.1 | Procedure for Treatment of Common Cause Failures Within a System..... | 29A-5 |
| 29A.5.2 | Procedure for Treatment of Common Cause Failures Among More Systems | 29A-7 |
| 29A.6 | Common Cause Failure Numerical Evaluation | 29A-8 |
| 29A.6.1 | Evaluation through Beta Factor Method | 29A-8 |
| 29A.6.2 | Evaluation through Multiple-Greek Letter (MGL) Method | 29A-8 |
| 29A.7 | References..... | 29A-10 |
| CHAPTER 30 HUMAN RELIABILITY ANALYSIS | | |
| 30.1 | Introduction..... | 30-1 |
| 30.2 | Summary of Results | 30-1 |
| 30.3 | Methodology..... | 30-2 |
| 30.4 | Major Assumptions | 30-4 |
| 30.5 | Types of Human Interactions | 30-10 |
| 30.5.1 | Quantification Model..... | 30-11 |
| 30.6 | Quantification..... | 30-12 |
| 30.6.1 | ZON-MAN01 (Start the Onsite Standby Diesel Generator)..... | 30-12 |
| 30.6.2 | LPM-MAN01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-13 |
| 30.6.3 | LPM-MAN02 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-15 |
| 30.6.4 | LPM-MAN05 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-16 |
| 30.6.5 | LPM-REC01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-17 |
| 30.6.6 | ADN-MAN01 (Actuate the Automatic Depressurization System) | 30-17 |
| 30.6.7 | ADN-REC01 (Actuate the Automatic Depressurization System)..... | 30-19 |
| 30.6.8 | CCB-MAN01 (Start the Standby Component Cooling Water Pump)..... | 30-19 |
| 30.6.9 | CCN-MAN02 (Inadvertent Misalignment of Heat Exchanger) | 30-20 |
| 30.6.10 | CIB-MAN00 (Diagnose Steam Generator Tube Rupture)..... | 30-21 |
| 30.6.11 | DUMP-MAN01 (Operate Steam Dump Valves) | 30-22 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 30.6.12 | CIC-MAN01 (Isolate Containment)..... | 30-23 |
| 30.6.13 | ADS-MANTEST (Recognize the Need and Reclose ADS Stage MOV)..... | 30-24 |
| 30.6.14 | CAN-MAN0S (Locally Close Manual Valve CAS-V204 to Isolate Containment) | 30-25 |
| 30.6.15 | CIT-MAN0S (Isolate Containment)..... | 30-26 |
| 30.6.16 | CMN-MAN01 (Actuate Core Makeup Tank)..... | 30-27 |
| 30.6.17 | CMN-REC01 (Actuate the Core Makeup Tanks)..... | 30-28 |
| 30.6.18 | CVN-MAN00 (Align Chemical and Volume Control System) | 30-29 |
| 30.6.19 | CVN-MAN02 (Align Chemical and Volume Control System) | 30-30 |
| 30.6.20 | CVN-MAN03 (Start Chemical and Volume Control System Pump B)..... | 30-30 |
| 30.6.21 | ADF-MAN01 (Depressurize the RCS to Refill the Pressurizer)..... | 30-31 |
| 30.6.22 | SGHL-MAN01 (Isolate Feedwater to Failed Steam Generator) | 30-32 |
| 30.6.23 | CAN-MAN01 (Start Standby Compressor) | 30-33 |
| 30.6.24 | REN-MAN02 (Initiate Recirculation)..... | 30-33 |
| 30.6.25 | REN-MAN03 (Initiate Recirculation)..... | 30-34 |
| 30.6.26 | IWN-MAN00 (Operate In-Containment Refueling Water Storage Tank Motor-Operated Valves)..... | 30-35 |
| 30.6.27 | RHN-MAN01 (Align Normal Residual Heat Removal System)..... | 30-36 |
| 30.6.28 | RHN-MANDIV (Align Normal Residual Heat Removal System)..... | 30-37 |
| 30.6.29 | RHN-MAN02/RHN-MAN03 (Align Normal Residual Heat Removal System)..... | 30-38 |
| 30.6.30 | PCN-MAN01 (Actuate Passive Containment Cooling System)..... | 30-40 |
| 30.6.31 | HPM-MAN01 (Diagnose Need for High Pressure Heat Removal)..... | 30-40 |
| 30.6.32 | PRN-MAN01 (Align Passive Residual Heat Removal System) | 30-41 |
| 30.6.33 | PRN-MAN02 (Align Passive Residual Heat Removal System) | 30-42 |
| 30.6.34 | PRN-MAN03 (Align Passive Residual Heat Removal System) | 30-43 |
| 30.6.35 | PRI-MAN01 (Isolate Failed Passive Residual Heat Removal Heat Exchanger) | 30-44 |
| 30.6.36 | REN-MAN04 (Initiate Recirculation)..... | 30-45 |
| 30.6.37 | RCN-MAN01 (Trip Reactor Coolant Pumps) | 30-46 |
| 30.6.38 | ATW-MAN01 (Manually Insert Control Rods)..... | 30-47 |
| 30.6.39 | ATW-MAN03 (Manually Trip the Reactor through Protection and Safety Monitoring System in One Minute) | 30-48 |
| 30.6.40 | ATW-MAN04 (Manually Trip the Reactor through Diverse Actuation System in One Minute) | 30-49 |
| 30.6.41 | ATW-MAN05 (Manually Trip the Reactor through Protection and Safety Monitoring System in Seven Minutes)..... | 30-49 |
| 30.6.42 | ATW-MAN06 (Manually Trip the Reactor through Diverse Actuation System In Seven Minutes)..... | 30-50 |
| 30.6.43 | RTN-MAN01 (Perform Controlled Reactor Shutdown)..... | 30-51 |
| 30.6.44 | FWN-MAN02 (Start the Startup Feedwater Pumps) | 30-52 |
| 30.6.45 | FWN-MAN03 (Start the Startup Feedwater Pumps) | 30-53 |
| 30.6.46 | REG-MAN00 (Regulate Startup Feedwater) | 30-54 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 30.6.47 | CIA-MAN01 (Isolate Failed Steam Generator) | 30-55 |
| 30.6.48 | CIB-MAN01 (Close Main Steam Isolation Valve) | 30-56 |
| 30.6.49 | SGA-MAN01 (Inadvertent Opening of Steam Generator Power-Operated Relief Valve) | 30-57 |
| 30.6.50 | SWN-MAN01N (Open Air-Operated Valve on Motor Strainer Line) | 30-58 |
| 30.6.51 | SWB-MAN02 (Start Standby Service Water Pump) | 30-58 |
| 30.6.52 | SWB-MAN02N (Start Standby Service Water Pump) | 30-59 |
| 30.6.53 | TCB-MAN01 (Start Standby Turbine Closed Cooling Water Pump) | 30-60 |
| 30.6.54 | TCB-MAN02 (Locally Align Standby Turbine Closed Cooling Water Heat Exchanger) | 30-61 |
| 30.6.55 | VLN-MAN01 (Actuate Hydrogen Control System) | 30-62 |
| 30.6.56 | VWN-MAN01 (Align Standby Chiller) | 30-63 |
| 30.6.57 | ATW-MAN11 (Recognize the Need for Manual Boration) | 30-64 |
| 30.6.58 | REC-MANDAS (Diagnosis of an Event Through DAS Signals or Perform an Activity by Operating DAS Controls) | 30-65 |
| 30.6.59 | RHN-MAN04 (Isolate the RNS During Shutdown Conditions) | 30-65 |
| 30.6.60 | RHN-MAN05 (Initiate Gravity Injection from IRWST via RNS Suction Line) | 30-66 |
| 30.6.61 | RHN-MAN06 (Recognize the Need and Throttle RNS Valve V011) | 30-68 |
| 30.6.62 | RCS-MANODS1 (Close AOVs CVS-V045 or -V047, Given Failure of HL Level Instruments) | 30-68 |
| 30.6.63 | RCS-MANODS2 (Close AOVs CVS-V045 or -V047, Given Failure of Valves to Close Automatically) | 30-70 |
| 30.6.64 | SWN-MAN03 (Recognize the Need and Locally Refill Service Water Basin) | 30-70 |
| 30.7 | Conditional Probability Evaluation | 30-71 |
| 30.7.1 | Application | 30-72 |
| 30.7.2 | Process Used to Determine Dependencies | 30-72 |
| 30.7.3 | Calculation of Dependent Human Error Probabilities | 30-72 |
| 30.8 | References | 30-74 |
| ATTACHMENT 30A HUMAN RELIABILITY ANALYSIS GUIDELINES | | 30A-1 |
| 30A.1 | Introduction | 30A-1 |
| 30A.2 | Schedule for Human Reliability Analysis | 30A-1 |
| 30A.3 | Methodology | 30A-1 |
| 30A.4 | Responsibility | 30A-2 |
| 30A.5 | Procedure for Human Interaction Evaluation | 30A-2 |
| 30A.5.1 | Type A | 30A-3 |
| 30A.5.2 | Type B | 30A-3 |
| 30A.5.3 | Type C | 30A-4 |
| 30A.5.4 | Commission Errors That Have Detrimental Effects | 30A-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|-------------|
| 30A.6 | Procedure for Human Error Probabilities Quantification | 30A-8 |
| | 30A.6.1 Basic Assumptions for Human Interaction Analysis..... | 30A-8 |
| 30A.7 | References..... | 30A-9 |
| CHAPTER 31 OTHER EVENT TREE NODE PROBABILITIES | | |
| 31.1 | Introduction..... | 31-1 |
| 31.2 | Identification of Cases Requiring Calculations | 31-1 |
| | 31.2.1 BL – Main Steam Line Break Occurs Inside Containment..... | 31-1 |
| | 31.2.2 CNB – Containment Isolation Fails Due to Reactor Coolant System Vessel Rupture..... | 31-1 |
| | 31.2.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-1 |
| | 31.2.4 NSGTR – Consequential Steam Generator Tube Rupture..... | 31-2 |
| | 31.2.5 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-2 |
| | 31.2.6 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-2 |
| | 31.2.7 PRSOV – Pressurizer Safety Valves Reclose | 31-2 |
| | 31.2.8 R05 – Offsite Power Recovered within One-Half Hour..... | 31-2 |
| | 31.2.9 SLSOV – Main Steam Line Relief Valves Reclose | 31-2 |
| 31.3 | Case-Specific Calculations..... | 31-3 |
| | 31.3.1 BL – Main Steam Line Break Occurs Inside Containment..... | 31-3 |
| | 31.3.2 CNB – Containment Isolation Fails Due to RCS Vessel Rupture..... | 31-3 |
| | 31.3.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-3 |
| | 31.3.4 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-4 |
| | 31.3.5 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-4 |
| | 31.3.6 PRSOV – Pressurizer Safety Valves Reclose | 31-5 |
| | 31.3.7 R05 – Offsite Power Recovered within One-Half Hour..... | 31-6 |
| | 31.3.8 SGTR1 – Single Consequential Steam Generator Tube Rupture..... | 31-6 |
| | 31.3.9 SGTR – Multiple Consequential Steam Generator Tube Rupture | 31-8 |
| | 31.3.10 SLSOV – Main Steam Line Relief and Safety Valves Reclose | 31-8 |
| | 31.3.11 SLSOV1 – Main Steam Line Relief and Safety Valves Reclose | 31-9 |
| | 31.3.12 SLSOV2 – Main Steam Line Safety Valves Reclose..... | 31-10 |
| | 31.3.13 SLSOV3 – Main Steamline Relief and Safety Valves Reclose, SGTR..... | 31-10 |
| 31.4 | References..... | 31-11 |
| CHAPTER 32 DATA ANALYSIS AND MASTER DATA BANK | | |
| 32.1 | Data Analysis | 32-1 |
| | 32.1.1 Random Component Failure Data..... | 32-1 |
| | 32.1.2 Test and Maintenance Unavailability..... | 32-2 |
| | 32.1.3 Common Cause Failure Data | 32-2 |
| | 32.1.4 Human Reliability Data | 32-2 |
| | 32.1.5 Initiating Event Frequency Data | 32-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 32.2 | Master Data Bank..... | 32-2 |
| 32.2.1 | Initiating Event Frequencies | 32-3 |
| 32.2.2 | Random Component Failures..... | 32-3 |
| 32.2.3 | Common Cause Failure Probabilities..... | 32-3 |
| 32.2.4 | Human Error Probabilities | 32-3 |
| 32.2.5 | System-Specific Calculations..... | 32-3 |
| 32.2.6 | Other Event Tree Node Probabilities | 32-3 |
| 32.2.7 | Master Data Bank | 32-4 |
| 32.3 | References..... | 32-4 |
| | | |
| CHAPTER 33 | FAULT TREE AND CORE DAMAGE QUANTIFICATION | |
| 33.1 | Introduction..... | 33-1 |
| 33.2 | Fault Tree Model Quantification..... | 33-1 |
| 33.3 | Event Tree Model Calculation | 33-1 |
| 33.3.1 | Core Damage Quantification Method..... | 33-2 |
| 33.3.2 | Core Damage Quantification Input Files and Data | 33-4 |
| 33.3.3 | Definition of Consequential Event Categories..... | 33-4 |
| 33.3.4 | Incorporate Operator Action Dependencies Into Plant Core Damage Frequency Quantification..... | 33-6 |
| 33.3.5 | Core Damage Frequency Results | 33-6 |
| | | |
| CHAPTER 34 | SEVERE ACCIDENT PHENOMENA TREATMENT | |
| 34.1 | Introduction..... | 34-1 |
| 34.2 | Treatment of Physical Processes | 34-1 |
| 34.2.1 | In-Vessel Retention of Molten Core Debris..... | 34-1 |
| 34.2.2 | Fuel-Coolant Interaction (Steam Explosions)..... | 34-2 |
| 34.2.3 | Hydrogen Combustion and Detonation..... | 34-4 |
| 34.2.4 | High-Pressure Melt Ejection..... | 34-5 |
| 34.2.5 | Core Debris Coolability | 34-5 |
| 34.2.6 | Containment Pressurization from Decay Heat | 34-6 |
| 34.2.7 | Elevated Temperature (Equipment Survivability)..... | 34-7 |
| 34.2.8 | Summary..... | 34-7 |
| 34.3 | Analysis Method | 34-7 |
| 34.4 | Severe Accident Analyses..... | 34-8 |
| 34.4.1 | Accident Class 3BE – Intact Containment..... | 34-8 |
| 34.4.2 | Accident Class 3BE – Failed Containment..... | 34-10 |
| 34.4.3 | Accident Class 3BL – Intact Containment..... | 34-11 |
| 34.4.4 | Accident Class 3BR – Intact Containment..... | 34-12 |
| 34.4.5 | Accident Class 3C – Intact Containment | 34-13 |
| 34.4.6 | Accident Class 3C – Failed Containment | 34-14 |
| 34.4.7 | Accident Class 3D – Intact Containment..... | 34-14 |
| 34.4.8 | Accident Class 3D – Failed Containment | 34-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 34.4.9 | Accident Class 6E – Bypass Containment | 34-16 |
| 34.4.10 | Accident Class 6L – Bypass Containment | 34-17 |
| 34.4.11 | Accident Class 1AP | 34-17 |
| 34.4.12 | Accident Class 1A | 34-18 |
| 34.4.13 | Intermediate and Late Containment Failure Cases | 34-19 |
| 34.5 | Insights and Conclusions..... | 34-21 |
| 34.6 | References..... | 34-21 |
| | | |
| CHAPTER 35 | CONTAINMENT EVENT TREE ANALYSIS | |
| 35.1 | Introduction..... | 35-1 |
| 35.2 | Containment Event Tree – General Discussion..... | 35-1 |
| 35.3 | Event Tree Construction..... | 35-2 |
| 35.4 | Level 1/Level 2 Interface..... | 35-3 |
| 35.5 | Containment Event Tree Top Events | 35-3 |
| 35.5.1 | Severe Accident Phenomena Considerations | 35-3 |
| 35.5.2 | Operator Action and Systems Top-Event Considerations | 35-5 |
| 35.6 | Release Category Definitions | 35-7 |
| 35.6.1 | Release Category BP – Containment Bypass | 35-8 |
| 35.6.2 | Release Category CI – Containment Isolation Failure | 35-9 |
| 35.6.3 | Release Category CFE – Early Containment Failure | 35-9 |
| 35.6.4 | Release Category CFI – Intermediate Containment Failure | 35-9 |
| 35.6.5 | Release Category CFL – Late Containment Failure..... | 35-9 |
| 35.6.6 | Release Category CFV – Containment Venting..... | 35-10 |
| 35.6.7 | Release Category IC – Intact Containment | 35-10 |
| 35.7 | Top-Event Nodal Questions and Success Criteria..... | 35-10 |
| 35.7.1 | Top Event DP – RCS Depressurization After Core Uncovery..... | 35-11 |
| 35.7.2 | Top Event IS – Containment Isolation..... | 35-12 |
| 35.7.3 | Top Event IR – Reactor Cavity Flooding..... | 35-13 |
| 35.7.4 | Top Event RFL – Reflooding of a Degraded Core | 35-14 |
| 35.7.5 | Top Event VF – Debris Relocation to the Reactor Cavity | 35-14 |
| 35.7.6 | Top Event PC – Passive Containment Cooling..... | 35-15 |
| 35.7.7 | Top Event VNT – Containment Venting | 35-16 |
| 35.7.8 | Top Event IF – Intermediate Containment Failure..... | 35-16 |
| 35.7.9 | Top Event IG – Hydrogen Control System | 35-17 |
| 35.7.10 | Top Event DF – Diffusion Flame | 35-17 |
| 35.7.11 | Top Event DTE – Early Hydrogen Detonation | 35-18 |
| 35.7.12 | Top Event DFG – Hydrogen Deflagration..... | 35-19 |
| 35.7.13 | Top Event DTI – Intermediate Hydrogen Detonation..... | 35-19 |
| 35.8 | Summary..... | 35-20 |
| 35.9 | References..... | 35-20 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 36 REACTOR COOLANT SYSTEM DEPRESSURIZATION | | |
| 36.1 | Introduction | 36-1 |
| 36.2 | Definition of High Pressure..... | 36-1 |
| 36.3 | Node DP..... | 36-2 |
| 36.4 | Success Criteria..... | 36-2 |
| 36.4.1 | Accident Classes 3BE, 3BL, 3BR, 3C..... | 36-2 |
| 36.4.2 | Accident Class 3D/1D | 36-3 |
| 36.4.3 | Accident Classes 1A and 1AP | 36-3 |
| 36.4.4 | Steam Generator Tube Rupture – Accident Class 6..... | 36-4 |
| 36.4.5 | Anticipated Transient Without Scram – Accident Class 3A..... | 36-5 |
| 36.6 | References..... | 36-5 |
| CHAPTER 37 CONTAINMENT ISOLATION | | |
| 37.1 | Introduction..... | 37-1 |
| 37.2 | Definition of Containment Isolation..... | 37-1 |
| 37.3 | Success Criteria..... | 37-1 |
| 37.3.1 | Accident Classes 1A and 1AP | 37-2 |
| 37.3.2 | Accident Class 3A | 37-2 |
| 37.3.3 | Accident Class 3BR..... | 37-2 |
| 37.3.4 | Accident Class 3BE | 37-2 |
| 37.3.5 | Accident Class 3BL | 37-2 |
| 37.3.6 | Accident Class 3C..... | 37-2 |
| 37.3.7 | Accident Class 3D/1D | 37-3 |
| 37.3.8 | Accident Class 6 | 37-3 |
| 37.4 | Summary | 37-3 |
| CHAPTER 38 REACTOR VESSEL REFLOODING | | |
| 38.1 | Introduction..... | 38-1 |
| 38.2 | Definition of Reflooding Success..... | 38-1 |
| 38.3 | Success Criteria..... | 38-1 |
| 38.3.1 | Accident Classes 1A and 1AP | 38-1 |
| 38.3.2 | Accident Class 3BR..... | 38-2 |
| 38.3.3 | Accident Class 3BE | 38-2 |
| 38.3.4 | Accident Class 3BL | 38-3 |
| 38.3.5 | Accident Class 3D/1D | 38-3 |
| 38.3.6 | Accident Class 6 | 38-3 |
| 38.3.7 | Accident Class 3C..... | 38-3 |
| 38.3.8 | Accident Class 3A | 38-4 |
| 38.4 | Summary | 38-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| CHAPTER 39 | IN-VESSEL RETENTION OF MOLTEN CORE DEBRIS | |
| 39.1 | Introduction..... | 39-1 |
| 39.2 | Background on the Application of IVR to the Passive Plant..... | 39-1 |
| 39.3 | Application of IVR to the AP1000 Passive Plant..... | 39-2 |
| 39.4 | Reactor Vessel Failure Criteria | 39-3 |
| 39.5 | In-Vessel Melt Progression and Relocation..... | 39-4 |
| 39.6 | Application of Heat Transfer Correlations to the AP1000 | 39-6 |
| | 39.6.1 Debris Pool to Vessel Wall Heat Transfer | 39-6 |
| | 39.6.2 Vessel Wall to External Cooling Water Heat Transfer | 39-7 |
| 39.7 | Quantification of Margin to Failure of the Reactor Vessel Wall | 39-8 |
| | 39.7.1 Zirconium Oxidation Fraction Input Probability Distribution..... | 39-9 |
| | 39.7.2 Steel Mass Input Probability Distribution | 39-9 |
| | 39.7.3 Final Bounding State Timing Input Probability Distribution | 39-10 |
| | 39.7.4 Critical Heat Flux..... | 39-10 |
| | 39.7.5 Results and Conclusions of Heat Flux Quantification | 39-10 |
| 39.8 | Reactor Coolant System Depressurization | 39-11 |
| 39.9 | Reactor Cavity Flooding (Node IR) | 39-11 |
| | 39.9.1 Node IR Success Criteria | 39-12 |
| | 39.9.2 Cavity Flooding Scenario Dependencies | 39-13 |
| 39.10 | Reactor Vessel Insulation Design Concept..... | 39-15 |
| | 39.10.1 Description of Reactor Vessel Insulation and Venting | 39-15 |
| | 39.10.2 Design Analysis of the Insulation and Support Frame | 39-17 |
| 39.11 | Reactor Vessel External Surface Treatment..... | 39-18 |
| 39.12 | Reactor Vessel Failure (Node VF) | 39-18 |
| | 39.12.1 Node VF Success Criteria..... | 39-18 |
| 39.13 | Summary | 39-19 |
| 39.14 | References..... | 39-19 |
| ATTACHMENT 39A | AP1000 IN-VESSEL CORE MELTING RELOCATION | 39A-1 |
| 39A.1 | Introduction..... | 39A-1 |
| 39A.2 | Phenomenological Issues | 39A-1 |
| | 39A.2.1 Focusing Effect..... | 39A-1 |
| | 39A.2.2 Material Interaction..... | 39A-1 |
| 39A.3 | AP1000 Reactor Vessel Lower Internals Geometry..... | 39A-1 |
| 39A.4 | Modeling of Core and Reactor Vessel Lower Internals Heatup | 39A-2 |
| | 39A.4.1 MAAP4 Model | 39A-2 |
| | 39A.4.2 Finite Difference Modeling..... | 39A-3 |
| | 39A.4.3 Relocation of In-Core Debris to Lower Plenum..... | 39A-3 |
| 39A-5 | Base Core Damage Sequence for In-Vessel Retention..... | 39A-3 |
| | 39A.5.1 Core Heatup and Formation of In-Core Molten Debris Layers..... | 39A-4 |
| | 39A.5.2 Melting of Core Shroud and Core Barrel | 39A-6 |
| | 39A.5.3 Initial Relocation of Molten Core Debris to Lower Plenum | 39A-7 |
| | 39A.5.4 Lower Plenum Debris Pool Formation..... | 39A-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 39A.6 | Potential for Debris Interaction | 39A-12 |
| 39A.7 | Conclusions from Analysis of AP1000 In-Vessel Core Melting and Relocation | 39A-12 |
| 39A.8 | References..... | 39A-13 |
| | | |
| CHAPTER 40 | PASSIVE CONTAINMENT COOLING, LONG TERM CONTAINMENT INTEGRITY AND CONTAINMENT VENTING | |
| 40.1 | Passive Containment Cooling System..... | 40-1 |
| 40.2 | Passive Containment Cooling Water – Node PC | 40-2 |
| | 40.2.1 Node PC Success Criteria | 40-2 |
| | 40.2.2 Operator Action | 40-2 |
| | 40.2.3 Node PC Failure Probability..... | 40-3 |
| 40.3 | Containment Venting – Node VT | 40-3 |
| | 40.3.1 Venting Success Criteria..... | 40-3 |
| | 40.3.2 Venting Failure Probability..... | 40-4 |
| 40.4 | Intermediate Containment Failure – Node IF..... | 40-4 |
| | 40.4.1 Success Criterion | 40-5 |
| | 40.4.2 Intermediate Containment Failure Probability | 40-5 |
| 40.5 | References..... | 40-5 |
| | | |
| CHAPTER 41 | HYDROGEN MIXING AND COMBUSTION ANALYSIS | |
| 41.1 | Discussion of the Issue | 41-1 |
| 41.2 | Controlling Phenomena..... | 41-2 |
| 41.3 | Major Assumptions and Phenomenological Uncertainties | 41-3 |
| | 41.3.1 Hydrogen Generation..... | 41-3 |
| | 41.3.2 Containment Pressure | 41-3 |
| | 41.3.3 Flammability Limits..... | 41-3 |
| | 41.3.4 Detonation Limits and Loads..... | 41-4 |
| | 41.3.5 Igniter System | 41-4 |
| | 41.3.6 Other Ignition Sources | 41-5 |
| | 41.3.7 Severe Accident Management Actions | 41-5 |
| 41.4 | Hydrogen Generation and Mixing..... | 41-5 |
| | 41.4.1 Accident Class 3BE – Failure of Gravity Injection..... | 41-6 |
| | 41.4.2 Accident Class 3BL – Failure of Gravity Recirculation..... | 41-9 |
| | 41.4.3 Accident Class 3BR – Large LOCA with Accumulator Failure | 41-10 |
| | 41.4.4 Accident Class 3C..... | 41-11 |
| | 41.4.5 Accident Classes 3D and 1D..... | 41-12 |
| | 41.4.6 Accident Class 1AP | 41-12 |
| | 41.4.7 Accident Class 1A | 41-13 |
| | 41.4.8 Accident Class 3A | 41-13 |
| | 41.4.9 Accident Class 6 | 41-13 |
| | 41.4.10 Overall Mixing Insights | 41-14 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| 41.5 | Hydrogen Burning at Igniters | 41-15 |
| 41.6 | Early Hydrogen Combustion | 41-15 |
| | 41.6.1 Hydrogen Generation Rates | 41-15 |
| | 41.6.2 Hydrogen Release Locations | 41-17 |
| | 41.6.3 Early Hydrogen Combustion Ignition Sources | 41-18 |
| 41.7 | Diffusion Flame Analysis – CET Node DF | 41-18 |
| | 41.7.1 AP1000 Diffusion Flame Mitigation Strategy | 41-19 |
| | 41.7.2 Node DF Containment Failure Probability Assignment | 41-20 |
| 41.8 | Early Hydrogen Detonation – Containment Event Tree Node DTE | 41-21 |
| | 41.8.1 Containment Success Criteria at Node DTE | 41-21 |
| | 41.8.2 Early Hydrogen Detonation Decomposition Event Tree | 41-22 |
| 41.9 | Deflagration in Time Frame 3 | 41-23 |
| | 41.9.1 Containment Success Criterion at Node DFL | 41-23 |
| | 41.9.2 AICC Peak Pressure | 41-24 |
| | 41.9.3 Conditional Containment Failure Probability from Deflagration | 41-25 |
| 41.10 | Detonation in Intermediate Time Frame | 41-29 |
| | 41.10.1 Containment Success Criterion at Node DTI | 41-29 |
| | 41.10.2 Mixing and Stratification | 41-29 |
| | 41.10.3 Quantification of DTI Failure Probabilities | 41-30 |
| 41.11 | Safety Margin Basis Containment Performance Requirement | 41-30 |
| 41.12 | Summary | 41-31 |
| 41.13 | References | 41-31 |
| ATTACHMENT 41A AP1000 SPECIFIC MAAP4.04 ANALYSES | | 41A-1 |
| ATTACHMENT 41B ANALYSIS OF HYDROGEN BURNING AT IGNITERS | | 41B-1 |
| CHAPTER 42 CONDITIONAL CONTAINMENT FAILURE PROBABILITY DISTRIBUTION | | |
| 42.1 | Introduction | 42-1 |
| 42.2 | Probabilistic Model | 42-1 |
| 42.3 | Containment Failure Characteristics | 42-2 |
| | 42.3.1 Median Values for Containment Failure | 42-2 |
| | 42.3.2 Uncertainties in Containment Failure | 42-3 |
| 42.4 | Containment Failure Predictions | 42-4 |
| | 42.4.1 Containment Cylindrical Shell | 42-4 |
| | 42.4.2 Ellipsoidal Upper Head | 42-5 |
| | 42.4.3 Equipment Hatches | 42-5 |
| | 42.4.4 Personnel Airlock | 42-6 |
| 42.5 | Overall Failure Distribution | 42-6 |
| 42.6 | Summary and Conclusions | 42-7 |
| 42.7 | References | 42-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| CHAPTER 43 | RELEASE FREQUENCY QUANTIFICATION | |
| 43.1 | Introduction..... | 43-1 |
| 43.2 | Plant Damage State Frequency Calculations..... | 43-2 |
| 43.3 | Containment Event Tree Node Frequencies..... | 43-2 |
| 43.3.1 | CET Nodes | 43-2 |
| 43.3.2 | CET Node Probabilities From Boolean Expressions | 43-3 |
| 43.3.3 | Probabilities for Hydrogen-Related CET Nodes..... | 43-6 |
| 43.3.4 | Other CET Node Probabilities..... | 43-6 |
| 43.4 | Containment Event Tree Quantification..... | 43-7 |
| 43.4.1 | Containment Event Tree | 43-7 |
| 43.4.2 | Dominant CET Sequences..... | 43-7 |
| 43.4.3 | LRF Cutsets for Dominant Sequences | 43-7 |
| 43.5 | Summary of Results | 43-7 |
| 43.6 | Importance and Sensitivity Analyses..... | 43-8 |
| 43.6.1 | CET Event Node Importance Analysis | 43-8 |
| 43.6.2 | No Credit Taken for DP Node for PDS-6 | 43-8 |
| 43.6.3 | Lesser Reliability for Containment Isolation..... | 43-8 |
| 43.6.4 | Lesser Reliability for Hydrogen Igniters | 43-8 |
| 43.6.5 | Lesser Reliability for PCS..... | 43-9 |
| 43.6.6 | No Credit for Depressurization for High Pressure PDS..... | 43-9 |
| 43.6.7 | Set PDS-3C Vessel Failure Probability to 1.0..... | 43-9 |
| 43.6.8 | Set 3D and 1AP Diffusion Flame and Detonation Failure Probability to 1.0 | 43-9 |
| 43.7 | Other Importance and Sensitivity Analyses..... | 43-9 |
| 43.7.1 | Initiating Event Importances | 43-9 |
| 43.7.2 | Sensitivity to Standby Systems | 43-10 |
| 43.7.3 | Sensitivity to Standby Systems With Credit for Manual DAS | 43-10 |
| 43.7.4 | Treatment of PCS Annulus Drain Plugging in the AP1000 PRA..... | 43-10 |
| 43.8 | Conclusions and Insights..... | 43-11 |
| ATTACHMENT 43A | PDS CALCULATIONS | 43A-1 |
| ATTACHMENT 43B | DP NODE PROBABILITY FOR PDS..... | 43B-1 |
| ATTACHMENT 43C | EVALUATION OF OPERATOR ACTIONS..... | 43C-1 |
| ATTACHMENT 43D | EFFECT OF "PRE-EXISTING CONTAINMENT OPENING" ON LRF..... | 43D-1 |
| ATTACHMENT 43E | EFFECT OF CONTAINMENT AIR-COOLING FAILURE ON PLANT RISK | 43E-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 44 MAAP4 CODE DESCRIPTION AND AP1000 MODELING | | |
| 44.0 | MAAP Background..... | 44-1 |
| 44.1 | MAAP4..... | 44-1 |
| 44.2 | The AP1000 MAAP4 Modeling | 44-3 |
| 44.3 | Benchmarking | 44-5 |
| 44.4 | Summary and Conclusions..... | 44-6 |
| 44.5 | References..... | 44-7 |
| CHAPTER 45 FISSION-PRODUCT SOURCE TERMS | | |
| 45.1 | Summary of AP1000 Release Categories..... | 45-1 |
| 45.2 | Release Category Source Terms..... | 45-2 |
| 45.2.1 | Release Category IC..... | 45-2 |
| 45.2.2 | Release Category BP..... | 45-2 |
| 45.2.3 | Release Category CI..... | 45-2 |
| 45.2.4 | Release Category CFE | 45-3 |
| 45.2.5 | Release Category CFI | 45-3 |
| 45.2.6 | Release Category CFL | 45-3 |
| 45.2.7 | Release Category CFV..... | 45-4 |
| 45.3 | Direct-Release Sensitivity Case..... | 45-4 |
| 45.4 | Summary | 45-4 |
| 45.5 | References..... | 45-4 |
| CHAPTERS 46 THROUGH 48 NOT USED | | |
| CHAPTER 49 OFFSITE DOSE RISK QUANTIFICATION | | |
| 49.1 | Introduction..... | 49-1 |
| 49.2 | Conformance with Regulatory Requirements..... | 49-2 |
| 49.3 | Assumptions..... | 49-2 |
| 49.4 | Methodology | 49-2 |
| 49.5 | Dose Evaluation Results and Discussion..... | 49-5 |
| 49.6 | Quantification of Site Risk..... | 49-6 |
| 49.7 | Risk Quantification Results..... | 49-7 |
| 49.8 | References..... | 49-7 |
| CHAPTER 50 IMPORTANCE AND SENSITIVITY ANALYSES | | |
| 50.1 | Introduction..... | 50-1 |
| 50.2 | Importance Analyses for Core Damage..... | 50-1 |
| 50.2.1 | Initiating Event Importances..... | 50-2 |
| 50.2.2 | Accident Sequence Importances | 50-3 |
| 50.2.3 | End State Importances | 50-4 |
| 50.2.4 | Common Cause Failure Importances | 50-4 |
| 50.2.5 | Human Error Importances..... | 50-5 |
| 50.2.6 | Component Importances | 50-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|--------------|
| 50.3 | System Importances for Core Damage | 50-7 |
| 50.4 | Human Error Sensitivity Analyses | 50-8 |
| 50.4.1 | Set HEPs to 1.0 (Failure) in Core Damage Output File | 50-9 |
| 50.4.2 | Set HEPs to 0.0 (Success) in Core Damage Output File | 50-10 |
| 50.4.3 | Set HEPs to 0.1 in Core Damage Output File | 50-10 |
| 50.5 | Other Sensitivity Analyses for Core Damage | 50-10 |
| 50.5.1 | Impact of Passive System Check Valves on Core Damage Frequency | 50-10 |
| 50.5.2 | Sensitivity to Squib Valve Failure Probability | 50-11 |
| 50.5.3 | Sensitivity to Circuit Breaker Failure Probability | 50-11 |
| 50.5.4 | Sensitivity to Standby Systems | 50-12 |
| 50.5.5 | Sensitivity to Standby Systems; Manual DAS Credited..... | 50-14 |
| 50.6 | Results..... | 50-15 |
| CHAPTER 51 UNCERTAINTY ANALYSIS | | |
| 51.1 | Introduction..... | 51-1 |
| 51.2 | Input Data/Error Factors..... | 51-2 |
| 51.3 | Input Files | 51-3 |
| 51.4 | Output Files..... | 51-3 |
| 51.5 | Sensitivity Analyses | 51-3 |
| 51.5.1 | Sensitivity to Simulation Parameters..... | 51-3 |
| 51.5.2 | Sensitivity to Key Basic Events | 51-3 |
| 51.5.3 | Sensitivity to Operator Actions | 51-4 |
| 51.6 | Summary of Results | 51-6 |
| 51.7 | References..... | 51-8 |
| ATTACHMENT 51A ASSIGNMENT OF ERROR FACTORS TO BASIC EVENT PROBABILITIES..... | | |
| | | 51A-1 |
| ATTACHMENT 51B @RISK UNCERTAINTY ANALYSIS RESULTS | | |
| | | 51B-1 |
| CHAPTERS 52 AND 53 NOT USED | | |
| CHAPTER 54 LOW-POWER AND SHUTDOWN RISK ASSESSMENT | | |
| 54.1 | Introduction..... | 54-1 |
| 54.2 | Data Analysis | 54-2 |
| 54.3 | Initiating Event Analysis | 54-3 |
| 54.4 | Event Tree/Mitigation System Evaluation..... | 54-3 |
| 54.5 | Common Cause Analysis Update for AP1000 | 54-3 |
| 54.6 | Human Reliability Assessment for AP1000 | 54-5 |
| 54.7 | Core Damage Quantification..... | 54-6 |
| 54.7.1 | Discussion of Results..... | 54-9 |
| 54.8 | Estimation of Shutdown Large Release Frequency | 54-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 54.9 | Sensitivity Analyses | 54-10 |
| 54.9.1 | Case 1 – Minimum Equipment per Tech Specs During Drained Conditions..... | 54-10 |
| 54.9.2 | Case 2 – No Credit for Standby Nonsafety Systems | 54-11 |
| 54.9.3 | Case 3 – HEPs Set Equal to 0.5 | 54-12 |
| 54.9.4 | Case 4 – No Credit for Standby Nonsafety Systems – Credit for Manual DAS | 54-12 |
| 54.9.5 | Case 5 – Assessment of Containment Closure Failure Probability | 54-13 |
| 54.10 | Conclusions..... | 54-17 |
| 54.11 | Reference | 54-17 |
| CHAPTER 55 | AP1000 SEISMIC MARGINS EVALUATION | |
| 55.1 | Seismic Margin HCLPF Methodology..... | 55-1 |
| 55.2 | Calculation of HCLPF Values..... | 55-1 |
| 55.2.1 | Seismic Margin HCLPF Methodology..... | 55-1 |
| 55.2.2 | Calculation of HCLPF Values | 55-2 |
| 55.3 | Seismic Margin Model..... | 55-11 |
| 55.3.1 | Major SMA Model Assumptions..... | 55-11 |
| 55.3.2 | Seismic Initiating Events | 55-12 |
| 55.3.3 | Initiating Event Category HCLPFs | 55-13 |
| 55.4 | Calculation of Plant HCLPF | 55-16 |
| 55.4.1 | HCLPFs for Basic Events | 55-16 |
| 55.4.2 | Calculation of Initiating Event HCLPFs | 55-17 |
| 55.5 | Results and Insights..... | 55-17 |
| 55.5.1 | AP1000 SMA Results..... | 55-17 |
| 55.5.2 | AP1000 SMA Insights..... | 55-18 |
| 55.6 | References..... | 55-20 |
| CHAPTER 56 | INTERNAL FLOODING ANALYSIS | |
| 56.1 | Introduction..... | 56-1 |
| 56.1.1 | Definitions | 56-1 |
| 56.2 | Methodology | 56-1 |
| 56.2.1 | Summary of Methodology | 56-1 |
| 56.2.2 | Information Collection..... | 56-2 |
| 56.2.3 | Initial Screening Assessment | 56-2 |
| 56.2.4 | Detailed Screening Assessment | 56-4 |
| 56.2.5 | Identification of Flood-Induced Initiating Events | 56-5 |
| 56.2.6 | Initiating Event Frequencies | 56-6 |
| 56.3 | Assumptions..... | 56-6 |
| 56.3.1 | General Flooding Analysis Assumptions and Engineering Judgments | 56-6 |
| 56.3.2 | AP1000-Specific Assumptions | 56-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 56.4 | Information Collection | 56-10 |
| 56.4.1 | PRA-Modeled Equipment and Locations | 56-10 |
| 56.4.2 | Identification of Areas for Flooding Evaluation..... | 56-10 |
| 56.5 | At-Power Operations..... | 56-10 |
| 56.5.1 | Initial Screening Assessment | 56-11 |
| 56.5.2 | Detailed Screening Assessment | 56-11 |
| 56.5.3 | Identification of Flood-Induced Initiating Events | 56-26 |
| 56.5.4 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-29 |
| 56.5.5 | Quantification of At-Power Flood-Induced Events..... | 56-36 |
| 56.6 | Internal Flooding During Low-Power and Shutdown Conditions | 56-38 |
| 56.6.1 | Detailed Screening Assessment | 56-38 |
| 56.6.2 | Identification of Flood-Induced Initiating Events | 56-39 |
| 56.6.3 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-40 |
| 56.6.4 | Quantification of Shutdown Internal Flooding Scenario CDFs | 56-45 |
| 56.6.5 | Total Shutdown Flooding Core Damage Frequency | 56-47 |
| 56.6.6 | Seismically Induced Flooding..... | 56-47 |
| 56.6.7 | Flooding Hazards During Refueling Outages | 56-47 |
| 56.6.8 | Summary of Results..... | 56-47 |
| 56.7 | Large Release Frequency Estimates for Internal Flooding..... | 56-48 |
| 56.8 | Results of AP1000 Internal Flooding Analysis | 56-49 |
| CHAPTER 57 FIRE RISK ASSESSMENT | | |
| 57.1 | Introduction..... | 57-1 |
| 57.2 | Qualitative Analysis | 57-1 |
| 57.2.1 | AP600 Qualitative Analysis..... | 57-1 |
| 57.2.2 | AP1000 Qualitative Analysis..... | 57-5 |
| 57.2.3 | AP1000 Fire Areas | 57-6 |
| 57.3 | Initiating Event Frequencies..... | 57-6 |
| 57.3.1 | Introduction..... | 57-6 |
| 57.3.2 | Methodology..... | 57-7 |
| 57.3.3 | Results for Plant Except Containment and the Main Control Room..... | 57-7 |
| 57.3.4 | Results for the Containment..... | 57-7 |
| 57.3.5 | Results for the Main Control Room | 57-7 |
| 57.4 | Development of Fire Scenarios | 57-10 |
| 57.4.1 | Spurious Actuation Model | 57-11 |
| 57.4.2 | Propagation Model..... | 57-14 |
| 57.4.3 | Fire Suppression Model..... | 57-15 |
| 57.4.4 | Operation Actions | 57-15 |
| 57.4.5 | Development of Fire Scenarios..... | 57-16 |
| 57.5 | Calculation of Conditional Core Damage Probabilities (CCDP)..... | 57-22 |
| 57.6 | Calculation of CDF from Fire Events | 57-23 |
| 57.6.1 | Calculation of Plant Fire CDF | 57-23 |
| 57.6.2 | Comments on Plant Areas..... | 57-23 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| | 57.6.3 Importances of Fire Areas | 57-25 |
| | 57.6.4 Conclusion | 57-27 |
| 57.7 | Sensitivity Studies | 57-27 |
| | 57.7.1 Manual Fire Suppression Systems | 57-27 |
| | 57.7.2 Sensitivity Analysis of the Probability of a Spurious Actuation of ADS Valves | 57-27 |
| | 57.7.3 Sensitivity of Human Action on Fire | 57-28 |
| | 57.7.4 Sensitivity Analysis on Ignition Frequencies | 57-28 |
| | 57.7.5 Sensitivity Analysis on ADS Actuation by DAS | 57-29 |
| | 57.7.6 Sensitivity Analysis on 1E to Non-1E Separation in the Containment | 57-29 |
| | 57.7.7 Sensitivity Analysis to Area to Area Propagation | 57-30 |
| | 57.7.8 Importance of Hot Shorts | 57-30 |
| 57.8 | Shutdown Fire Analysis | 57-30 |
| | 57.8.1 Introduction | 57-30 |
| | 57.8.2 Evaluation of AP1000 Shutdown Risk (Non-Drained Conditions) | 57-33 |
| | 57.8.3 Evaluation for Drained Shutdown Operations | 57-37 |
| | 57.8.4 Evaluation of Main Control Room | 57-40 |
| 57.9 | Conclusion and Insights | 57-40 |
| | 57.9.1 At-Power Analysis | 57-40 |
| | 57.9.2 Shutdown Fire Analysis | 57-41 |
| | 57.9.3 Conclusions | 57-42 |
| 57.10 | References | 57-42 |
| ATTACHMENT 57A CALCULATION OF SCENARIO CCDPs | | 57A-1 |
| | 57A.1 Calculation of Scenario CCDPs | 57A-1 |
| | 57A.2 Calculation of Scenario CCDPs for Overly Conservative Cases | 57A-3 |
| ATTACHMENT 57B MODELING OF OPERATOR ACTIONS IN FIRE SCENARIOS | | 57B-1 |
| | 57B.1 Calculation of Failure Probability of OPA-01 | 57B-1 |
| | 57B.2 Calculation of Failure Probability of OPA-02 | 57B-3 |
| | 57B.3 Operator Actions at Remote Shutdown Panel | 57B-6 |
| | 57B.4 More Reliable REC-MANDAS | 57B-6 |
| ATTACHMENT 57C FIRE AREA EVENT TREES DEFINING SCENARIOS | | 57C-1 |
| ATTACHMENT 57D AP1000 POTENTIAL FOR FIRE-INDUCED SPURIOUS ACTUATION OF FUNCTIONS THAT RESULT IN A BREACH OF HIGH/LOW PRESSURE BOUNDARY | | 57D-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| CHAPTER 58 | WINDS, FLOODS, AND OTHER EXTERNAL EVENTS | |
| 58.1 | Introduction..... | 58-1 |
| 58.2 | External Events Analysis..... | 58-1 |
| | 58.2.1 Severe Winds and Tornadoes..... | 58-1 |
| | 58.2.2 External Floods..... | 58-2 |
| | 58.2.3 Transportation and Nearby Facility Accidents..... | 58-2 |
| 58.3 | Conclusion..... | 58-2 |
| 58.4 | References..... | 58-3 |
| CHAPTER 59 | PRA RESULTS AND INSIGHTS | |
| 59.1 | Introduction..... | 59-1 |
| 59.2 | Use of PRA in the Design Process..... | 59-3 |
| 59.3 | Core Damage Frequency from Internal Initiating Events at Power..... | 59-4 |
| | 59.3.1 Dominant Core Damage Sequences..... | 59-6 |
| | 59.3.2 Component Importances for At-Power Core Damage Frequency..... | 59-7 |
| | 59.3.3 System Importances for At-Power Core Damage..... | 59-8 |
| | 59.3.4 System Failure Probabilities for At-Power Core Damage..... | 59-9 |
| | 59.3.5 Common Cause Failure Importances for At-Power Core Damage..... | 59-9 |
| | 59.3.6 Human Error Importances for At-Power Core Damage..... | 59-9 |
| | 59.3.7 Accident Class Importances..... | 59-10 |
| | 59.3.8 Sensitivity Analyses Summary for At-Power Core Damage..... | 59-11 |
| | 59.3.9 Summary of Important Level 1 At-Power Results..... | 59-12 |
| 59.4 | Large Release Frequency for Internal Initiating Events at Power..... | 59-15 |
| | 59.4.1 Dominant Large Release Frequency Sequences..... | 59-15 |
| | 59.4.2 Summary of Important Level 2 At-Power Results..... | 59-16 |
| 59.5 | Core Damage and Severe Release Frequency from Events at Shutdown..... | 59-19 |
| | 59.5.1 Summary of Shutdown Level 1 Results..... | 59-19 |
| | 59.5.2 Large Release Frequency for Shutdown and Low-Power Events..... | 59-22 |
| | 59.5.3 Shutdown Results Summary..... | 59-22 |
| 59.6 | Results from Internal Flooding, Internal Fire, and Seismic Margin Analyses..... | 59-23 |
| | 59.6.1 Results of Internal Flooding Assessment..... | 59-23 |
| | 59.6.2 Results of Internal Fire Assessment..... | 59-24 |
| | 59.6.3 Results of Seismic Margin Analysis..... | 59-25 |
| 59.7 | Plant Dose Risk From Release of Fission-Products..... | 59-26 |
| 59.8 | Overall Plant Risk Results..... | 59-26 |
| 59.9 | Plant Features Important to Reducing Risk..... | 59-27 |
| | 59.9.1 Reactor Design..... | 59-28 |
| | 59.9.2 Systems Design..... | 59-28 |
| | 59.9.3 Instrumentation and Control Design..... | 59-31 |
| | 59.9.4 Plant Layout..... | 59-32 |
| | 59.9.5 Containment Design..... | 59-32 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 59.10 | PRA Input to Design Certification Process | 59-36 |
| 59.10.1 | PRA Input to Reliability Assurance Program | 59-36 |
| 59.10.2 | PRA Input to Tier 1 Information..... | 59-36 |
| 59.10.3 | PRA Input to MMI/Human Factors/Emergency Response Guidelines | 59-36 |
| 59.10.4 | Summary of PRA Based Insights..... | 59-37 |
| 59.10.5 | Combined License Information..... | 59-37 |
| 59.11 | References..... | 59-38 |
| APPENDIX A | THERMAL HYDRAULIC ANALYSIS TO SUPPORT SUCCESS CRITERIA | A-1 |
| APPENDIX B | EX-VESSEL SEVERE ACCIDENT PHENOMENA | B-1 |
| APPENDIX C | ADDITIONAL ASSESSMENT OF AP1000 DESIGN FEATURES..... | C-1 |
| APPENDIX D | EQUIPMENT SURVIVABILITY ASSESSMENT..... | D-1 |
| APPENDIX E | AP1000 PRA FAULT TREE PICTURES FOR LEVEL 1 ANALYSIS FOR EVENTS AT POWER OPERATION | E-1 |

LIST OF TABLES

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 2-1 | Internal Initiating Event Grouping Plant Systems and Equipment Available for Transient/Accident Conditions (Sheets 1 – 10)..... | 2-28 |
| 2-2 | NUREG/CR 3862 Initiator Categories (Sheets 1 – 4)..... | 2-38 |
| 2-3 | NUREG/CR 3862 Initiator Categories not Considered in the AP1000 PRA Analysis..... | 2-42 |
| 2-4 | AP1000 Internal Initiating Event Frequencies (Sheets 1 – 3)..... | 2-43 |
| 2-5 | Initiating Event Frequencies Used in Event Trees Quantification..... | 2-46 |
| 2A-1 | Summary of Primary System Piping Data..... | 2A-2 |
| 2A-2 | Summary of Primary System Pipe Break Frequency Quantification..... | 2A-3 |
| 2A-3 | Summary of Steam Generator Tube Rupture Events..... | 2A-4 |
| 2A-4 | Spurious Stuck-Open Pressurizer Safety Valve..... | 2A-5 |
| 2A-5 | Interface Break on Accumulator Lines..... | 2A-6 |
| 2A-6 | Interface Break on IRWST Injection Lines..... | 2A-7 |
| 2A-7 | Initiating Events Review Data Summary (Sheets 1 – 8)..... | 2A-8 |
| 2B-1 | Summary of Main Steam Line and Feedwater Line Piping Data for Secondary Side Break Frequency Quantification..... | 2B-2 |
| 2B-2 | Secondary Side Line Break Frequency Quantification..... | 2B-3 |
| 2B-3 | Stuck-Open Main Steam Line Safety Valve Frequency Quantification (Sheets 1 – 2)..... | 2B-4 |
| 3-1 | Loss of CCS/SWS Initiating Event Fault Tree CSWF Success Criteria Summary..... | 3-8 |
| 3-2 | Spurious Actuation of Automatic Depressurization Failure Criteria Summary..... | 3-9 |
| 3-3 | Evaluation of Spurious Automatic Depressurization System Frequencies (Sheets 1 – 6)..... | 3-10 |
| 4-1 | AP1000 Large LOCA Event End State Summary..... | 4-112 |
| 4-2 | AP1000 Spurious ADS Actuation Event End State Summary..... | 4-112 |
| 4-3 | AP1000 Medium LOCA Event End State Summary..... | 4-113 |
| 4-4 | AP1000 CMT Line Break LOCA Event End State Summary..... | 4-114 |
| 4-5 | AP1000 SI Line Break Event End State Summary..... | 4-115 |
| 4-6 | AP1000 Small LOCA Event End State Summary..... | 4-116 |
| 4-7 | AP1000 RCS Leak Event End State Summary..... | 4-117 |
| 4-8 | AP1000 PRHR Tube Rupture Event End State Summary..... | 4-117 |
| 4-9 | AP1000 SGTR Event End State Summary..... | 4-118 |
| 4-10 | AP1000 Vessel Rupture Event End State Summary..... | 4-119 |
| 4-11 | AP1000 Interfacing Systems LOCA Event End State Summary..... | 4-119 |
| 4-12 | AP1000 Transients with MFW Event End State Summary..... | 4-120 |
| 4-13 | AP1000 Transients with Loss of RCS Flow Event End State Summary..... | 4-121 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 4-14 | AP1000 Transients with Loss of MFW to One SG Event End State Summary | 4-122 |
| 4-15 | AP1000 Transients with Core Power Excursion Event End State Summary | 4-123 |
| 4-16 | AP1000 Transients with Loss of CCW/SW Event End State Summary | 4-124 |
| 4-17 | AP1000 Transients without Main Feedwater Event End State Summary | 4-125 |
| 4-18 | AP1000 Transients with Loss of Condenser Event End State Summary..... | 4-126 |
| 4-19 | AP1000 Transients with Loss of Compressed Air Event End State Summary..... | 4-127 |
| 4-20 | AP1000 Loss of Offsite Power Event End State Summary..... | 4-128 |
| 4-21 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-129 |
| 4-22 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-130 |
| 4-23 | AP1000 Stuck Open Secondary Side Safety Valve Event End State Summary | 4-131 |
| 4-24 | AP1000 ATWS Precursor without MFW Event End State Summary..... | 4-132 |
| 4-25 | AP1000 ATWS Precursor with SI Event End State Summary..... | 4-133 |
| 4-26 | AP1000 ATWS Precursor Transients with MFW Event End State Summary | 4-134 |
| 4A-1 | End States (Plant Damage States) | 4A-17 |
| 4A-2 | Summary of Systems Associated with Mitigating Functions for AP1000..... | 4A-18 |
| 5-1 | AP1000 Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-2 | AP1000 Non Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-3 | AP1000 Support Systems Interdependency Matrix (Sheets 1 – 14)..... | 5-4 |
| 5-4 | AP1000 Safety-Related Front Line Plant Systems Letter Designators | 5-18 |
| 5-5 | AP1000 Non Safety-Related Front Line Plant Systems Letter Designators | 5-18 |
| 5-6 | AP1000 Front Line System Dependencies Matrix (Sheets 1 – 18) | 5-19 |
| 6-1 | Summary of Event Tree Top Events Success Criteria (Internal Initiating Events at Power Cases) (Sheets 1 – 34) | 6-20 |
| 6-2 | Summary of Success Criteria for the Mitigating Systems (Sheets 1 – 9) | 6-54 |
| 6-3 | Summary of Success Criteria for Operator Actions and Mission Times (Sheets 1 – 4) | 6-68 |
| 7-1 | Example for Fault Tree XXX Success Criteria Summary | 7-15 |
| 7-2 | Example for System Dependency Matrix | 7-15 |
| 7-3 | Example for Component Test Assumptions | 7-16 |
| 7-4 | Example for Component Maintenance Assumptions | 7-16 |
| 7-5 | Example for Operator Actions and Misposition Analysis Summary | 7-16 |
| 7-6 | Fault Tree Identification Codes (Sheets 1 – 3)..... | 7-17 |
| 7-7 | System Identification Codes for Basic Events (Sheets 1 – 3)..... | 7-20 |
| 7-8 | Component Identification Codes (Sheets 1 – 7)..... | 7-23 |
| 7-9 | Failure Mode Identification Codes (Sheets 1 – 3)..... | 7-30 |
| 8-1 | List of Passive Residual Heat Removal System Fault Trees | 8-7 |
| 8-2a | Fault Tree “PRT” Success Criteria..... | 8-8 |
| 8-2b | Fault Tree “PRTA” Success Criteria..... | 8-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 8-2c | Fault Tree "PRL" Success Criteria..... | 8-10 |
| 8-2d | Fault Tree "PRP" Success Criteria..... | 8-11 |
| 8-2e | Fault Tree "PRS" Success Criteria..... | 8-12 |
| 8-2f | Fault Tree "PRW" Success Criteria | 8-13 |
| 8-2g | Fault Tree "PRI" Success Criteria..... | 8-14 |
| 8-3 | System Dependency Matrix | 8-15 |
| 8-4 | Component Test Assumptions..... | 8-16 |
| 8-5 | Component Maintenance Assumptions..... | 8-17 |
| 8-6 | Operator Actions and Misposition Analysis Summary..... | 8-18 |
| 8-7 | Common Cause Failures Summary | 8-19 |
| 8-8 | Basic Events Database for the PRHR System Fault Trees (Sheets 1 – 3) | 8-20 |
| 9-1 | List of System Fault Trees..... | 9-9 |
| 9-2a | Fault Tree CM2AB Success Criteria Summary..... | 9-10 |
| 9-2b | Fault Tree CM2SL Success Criteria Summary..... | 9-11 |
| 9-2c | Fault Tree CM2L Success Criteria Summary..... | 9-12 |
| 9-2d | Fault Tree CM2P Success Criteria Summary..... | 9-13 |
| 9-2e | Fault Tree CM1A Success Criteria Summary | 9-14 |
| 9-2f | Fault Tree CM2LLT Success Criteria Summary..... | 9-15 |
| 9-2g | Fault Tree CMBOTH Success Criteria Summary | 9-16 |
| 9-2h | Fault Tree CM2LA Success Criteria Summary..... | 9-17 |
| 9-3 | Notes Related to System Fault Tree Assumptions..... | 9-18 |
| 9-4 | System Dependency Matrix | 9-18 |
| 9-5 | Component Test Assumptions..... | 9-19 |
| 9-6 | Component Maintenance Assumptions..... | 9-19 |
| 9-7 | Operator Actions and Misposition Analysis Summary..... | 9-20 |
| 9-8 | Common Cause Failure Analysis Summary..... | 9-20 |
| 9-9 | Fault Tree Basic Events for Core Makeup Tank Subsystem (Sheets 1 – 3) | 9-21 |
| 10-1 | List of System Fault Trees..... | 10-5 |
| 10-2a | Fault Tree AC2AB Success Criteria Summary | 10-6 |
| 10-2b | Fault Tree AC1A Success Criteria Summary..... | 10-7 |
| 10-2c | Fault Tree ACBOTH Success Criteria Summary..... | 10-8 |
| 10-3 | Notes Related to System Fault Tree Assumptions..... | 10-9 |
| 10-4 | System Dependency Matrix | 10-9 |
| 10-5 | Component Test Assumptions..... | 10-9 |
| 10-6 | Component Maintenance Assumptions..... | 10-10 |
| 10-7 | Operator Actions and Misposition Analysis Summary..... | 10-10 |
| 10-8 | Common Cause Failure Analysis Summary..... | 10-10 |
| 10-9 | Fault Tree Basic Events for Accumulator Subsystem | 10-11 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 11-1a | List of ADS System Fault Trees (Sheets 1 – 2)..... | 11-8 |
| 11-1b | List of ADS System Fault Trees (for Plant Damage States Analysis)..... | 11-10 |
| 11-2a | ADS Success Criteria Versus Accident Conditions (Full Depressurization)..... | 11-11 |
| 11-2b | ADS Success Criteria Versus Accident Conditions (Partial Depressurization)..... | 11-12 |
| 11-2c | Automatic Depressurization System Fault Tree Summary (For Plant Damage States)..... | 11-13 |
| 11-2d | Fault Tree “ADA” Success Criteria | 11-13 |
| 11-2e | Fault Tree “ADAB” Success Criteria..... | 11-14 |
| 11-2f | Fault Tree “ADAL” Success Criteria | 11-15 |
| 11-2g | Fault Tree “ADB” Success Criteria..... | 11-15 |
| 11-2h | Fault Tree “ADL” Success Criteria..... | 11-16 |
| 11-2i | Fault Tree “ADM” Success Criteria..... | 11-16 |
| 11-2j | Fault Tree “ADMA” Success Criteria..... | 11-17 |
| 11-2k | Fault Tree “ADQ” Success Criteria | 11-17 |
| 11-2l | Fault Tree “ADS” Success Criteria | 11-18 |
| 11-2m | Fault Tree “ADT” Success Criteria..... | 11-18 |
| 11-2n | Fault Tree “ADW” Success Criteria..... | 11-19 |
| 11-2o | Fault Tree “AD1” Success Criteria | 11-19 |
| 11-2p | Fault Tree “AD1A” Success Criteria | 11-20 |
| 11-2q | Fault Tree “ADF” Success Criteria | 11-20 |
| 11-2r | Fault Tree “ADR” Success Criteria..... | 11-21 |
| 11-2s | Fault Tree “ADRA” Success Criteria..... | 11-21 |
| 11-2t | Fault Tree “ADU” Success Criteria | 11-22 |
| 11-2u | Fault Tree “ADUM” Success Criteria..... | 11-22 |
| 11-2v | Fault Tree “ADV” Success Criteria | 11-23 |
| 11-2w | Fault Tree “ADZ” Success Criteria..... | 11-23 |
| 11-2x | Fault Tree “ADQLT” Data Summary | 11-24 |
| 11-2y | Fault Tree “ADTLT” Success Criteria | 11-24 |
| 11-3 | Notes Related to ADS System Fault Tree Assumptions..... | 11-25 |
| 11-4 | System Dependencies Matrix | 11-26 |
| 11-5 | Component Test Assumptions..... | 11-27 |
| 11-6 | Component Maintenance Assumptions..... | 11-27 |
| 11-7 | Failure Probabilities Calculated | 11-27 |
| 11-8 | Operator Action Analysis Summary..... | 11-28 |
| 11-9 | Common Cause Failures Summary | 11-28 |
| 11-10 | Basic Events Data Base for the ADA System Fault Tree (Sheets 1 – 20)..... | 11-29 |
| 12-1 | List of System Fault Trees (FT) | 12-10 |
| 12-2a | Fault Tree “IW2AB” Success Criteria Summary | 12-11 |
| 12-2b | Fault Tree “IW2ABM” Success Criteria Summary..... | 12-12 |
| 12-2c | Fault Tree “IW2ABA” Success Criteria Summary | 12-13 |
| 12-2d | Fault Tree “IW2ABP” Success Criteria Summary..... | 12-14 |
| 12-2e | Fault Tree “IW2ABPM” Success Criteria Summary..... | 12-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 12-2f | Fault Tree "IW2ABB" Success Criteria Summary..... | 12-16 |
| 12-2g | Fault Tree "IW2ABBM" Success Criteria Summary..... | 12-17 |
| 12-2h | Fault Tree "IW1A" Success Criteria Summary..... | 12-18 |
| 12-2i | Fault Tree "IW1AM" Success Criteria Summary..... | 12-19 |
| 12-2j | Fault Tree "IWF" Success Criteria Summary..... | 12-20 |
| 12-2k | Fault Tree "RECIRC" Success Criteria Summary..... | 12-21 |
| 12-2l | Fault Tree "RECIRCP" Success Criteria Summary..... | 12-22 |
| 12-2m | Fault Tree "RECIRCB" Success Criteria Summary..... | 12-23 |
| 12-2n | Fault Tree "RECIRC1" Success Criteria Summary..... | 12-24 |
| 12-2o | Fault Tree "RECIRC1P" Success Criteria Summary..... | 12-25 |
| 12-2p | Fault Tree "RECIRC1B" Success Criteria Summary..... | 12-26 |
| 12-3 | System Dependency Matrix..... | 12-27 |
| 12-4 | Component Test Assumptions..... | 12-28 |
| 12-5 | Component Maintenance Assumptions..... | 12-28 |
| 12-6 | Failure Probabilities Calculated..... | 12-29 |
| 12-7 | Operator Actions and Misposition Analysis Summary..... | 12-29 |
| 12-8 | Common Cause Failure Analysis Summary..... | 12-30 |
| 12-9 | Fault Tree Basic Events (Sheets 1 – 11)..... | 12-31 |
| 13-1 | List of System Fault Trees..... | 13-7 |
| 13-2 | Fault Tree PCT Success Criteria Summary..... | 13-7 |
| 13-3 | Notes Related to System Fault Trees Assumptions..... | 13-7 |
| 13-4 | System Dependency Matrix..... | 13-8 |
| 13-5 | Component Test Assumptions..... | 13-8 |
| 13-6 | Component Maintenance Assumptions..... | 13-9 |
| 13-7 | Operator Actions and Misposition Analysis Summary..... | 13-9 |
| 13-8 | Common Cause Failure Analysis Summary..... | 13-9 |
| 13-9 | Fault Tree Basic Events for Passive Containment Cooling System..... | 13-10 |
| 14-1 | List of System Fault Trees (At-Power)..... | 14-8 |
| 14-2.a | Success Criteria Summary Fault Tree "FWT"..... | 14-9 |
| 14-2.b | Success Criteria Summary Fault Tree "FWF"..... | 14-10 |
| 14-2.c | Success Criteria Summary Fault Tree "SFWT"..... | 14-11 |
| 14-2.d | Success Criteria Summary Fault Tree "SFW"..... | 14-12 |
| 14-2.e | Success Criteria Summary Fault Tree "SFW1"..... | 14-13 |
| 14-2.f | Success Criteria Summary Fault Tree "SFWP"..... | 14-14 |
| 14-2.g | Success Criteria Summary Fault Tree "SFWM"..... | 14-15 |
| 14-2.h | Success Criteria Summary Fault Tree "SFWA"..... | 14-16 |
| 14-2.i | Success Criteria Summary Fault Tree "COND"..... | 14-17 |
| 14-2.j | Success Criteria Summary Fault Tree "COND1"..... | 14-18 |
| 14-2.k | Success Criteria Summary Fault Tree "CDS"..... | 14-19 |
| 14-2.l | Success Criteria Summary Fault Tree "TCCW"..... | 14-20 |
| 14-3 | Notes to System Fault Tree Assumptions..... | 14-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 14-4 | System Dependency Matrix (Sheets 1 – 2)..... | 14-22 |
| 14-5 | Component Test Assumptions..... | 14-24 |
| 14-6 | Component Maintenance Assumptions..... | 14-25 |
| 14-7 | Failure Probabilities Calculated in this Section..... | 14-25 |
| 14-8 | Operator Action Analysis Summary..... | 14-26 |
| 14-9 | Common Cause Failure (CCF) Summary..... | 14-27 |
| 14-10 | Fault Tree Basic Event for Main and Startup Feedwater System (Sheets 1 – 9)..... | 14-28 |
| 15-1 | List of System Fault Trees..... | 15-9 |
| 15-2a | Fault Tree CSBOR1 Success Criteria Summary..... | 15-10 |
| 15-2b | Fault Tree CVS1 Success Criteria Summary..... | 15-11 |
| 15-2c | Fault Tree CSAX Success Criteria Summary..... | 15-12 |
| 15-2d | Fault Tree SGHL Success Criteria Summary..... | 15-13 |
| 15-2e | Fault Tree CSP Success Criteria Summary..... | 15-14 |
| 15-3 | Notes Related to System Fault Tree Assumptions..... | 15-15 |
| 15-4 | System Dependency Matrix..... | 15-16 |
| 15-5 | Component Test Assumptions..... | 15-17 |
| 15-6 | Component Maintenance Assumptions..... | 15-18 |
| 15-7 | Operator Actions and Misposition Analysis Summary..... | 15-19 |
| 15-8 | Common Cause Failure Analysis Summary..... | 15-20 |
| 15-9 | Fault Tree Basic Events for Chemical and Volume Control System (Sheets 1 – 4)..... | 15-21 |
| 16-1 | List of System Fault Trees..... | 16-5 |
| 16-2 | Fault Tree VLH Success Criteria Summary..... | 16-5 |
| 16-3 | Notes Related to System Fault Tree Assumptions..... | 16-5 |
| 16-4 | System Dependency Matrix..... | 16-6 |
| 16-5 | Component Test Assumptions..... | 16-6 |
| 16-6 | Component Maintenance Assumptions..... | 16-6 |
| 16-7 | Operator Actions and Misposition Analysis Summary..... | 16-7 |
| 16-8 | Common Cause Failure Analysis Summary..... | 16-7 |
| 16-9 | Fault Tree Basic Events for Containment Hydrogen Control System..... | 16-8 |
| 17-1 | List of System Fault Trees..... | 17-7 |
| 17-2 | Fault Tree Success Criteria Summary (Sheets 1 – 2)..... | 17-8 |
| 17-3 | Notes Related to System Fault Tree Assumptions..... | 17-10 |
| 17-4 | System Dependencies Matrix..... | 17-11 |
| 17-5 | Component Test Assumptions..... | 17-12 |
| 17-6 | Component Maintenance Assumptions..... | 17-12 |
| 17-7 | Operator Actions and System Misposition Analysis Summary..... | 17-13 |
| 17-8 | Common Cause Failure Summary..... | 17-13 |
| 17-9 | Fault Tree Basic Events for Normal Residual Heat Removal System (Sheets 1 – 5)..... | 17-14 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 18-1 | List of System Fault Trees..... | 18-6 |
| 18-2a | Fault Tree CCN Success Criteria Summary | 18-6 |
| 18-2b | Fault Tree CCT Success Criteria Summary..... | 18-7 |
| 18-2c | Fault Tree CCP Success Criteria Summary..... | 18-7 |
| 18-3 | Notes Related to System Fault Tree Assumptions..... | 18-8 |
| 18-4 | System Dependency Matrix | 18-8 |
| 18-5 | Component Test Assumptions..... | 18-9 |
| 18-6 | Component Maintenance Assumptions..... | 18-9 |
| 18-7 | Operator Actions and Misposition Analysis Summary..... | 18-10 |
| 18-8 | Common Cause Failure Analysis Summary..... | 18-10 |
| 18-9 | Fault Tree Basic Events for Component Cooling Water System (Sheets 1 – 2)..... | 18-11 |
| 19-1 | List of System Fault Trees..... | 19-6 |
| 19-2a | Fault Tree SWN Success Criteria Summary | 19-6 |
| 19-2b | Fault Tree SWT Success Criteria Summary..... | 19-7 |
| 19-2c | Fault Tree SWP Success Criteria Summary | 19-7 |
| 19-3 | Notes Related to System Fault Tree Assumptions..... | 19-8 |
| 19-4 | System Dependency Matrix | 19-9 |
| 19-5 | Component Test Assumptions..... | 19-10 |
| 19-6 | Component Maintenance Assumptions..... | 19-10 |
| 19-7 | Operator Actions and Misposition Analysis Summary..... | 19-11 |
| 19-8 | Common Cause Failure Analysis Summary..... | 19-11 |
| 19-9 | Fault Tree Basic Events for Service Water System (Sheets 1 – 4)..... | 19-12 |
| 20-1 | List of System Fault Trees..... | 20-5 |
| 20-2 | Fault Tree VWH Success Criteria Summary | 20-5 |
| 20-3 | Notes Related to System Fault Tree Assumptions..... | 20-5 |
| 20-4 | System Dependency Matrix | 20-6 |
| 20-5 | Component Test Assumptions..... | 20-7 |
| 20-6 | Component Maintenance Assumptions..... | 20-7 |
| 20-7 | Operator Actions and Misposition Analysis Summary..... | 20-8 |
| 20-8 | Common Cause Failure Analysis Summary..... | 20-8 |
| 20-9 | Fault Tree Basic Events for Central Chilled Water System (Sheets 1 – 2)..... | 20-9 |
| 21-1 | List of System Fault Trees (Sheets 1 – 3)..... | 21-9 |
| 21-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 21-12 |
| 21-3 | Notes Related to System Fault Tree Assumptions (Sheets 1 – 3)..... | 21-28 |
| 21-4 | System Dependency Matrix | 21-31 |
| 21-5 | Component Test Assumptions..... | 21-31 |
| 21-6 | Component Maintenance Assumptions..... | 21-32 |
| 21-7 | Operator Actions and Misposition Analysis Summary..... | 21-32 |
| 21-8 | Common Cause Failure Analysis Summary..... | 21-32 |
| 21-9 | Fault Tree Basic Events for AC Power System (Sheets 1 – 22)..... | 21-33 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 22-1 | List of System Fault Trees (Sheets 1 – 4)..... | 22-6 |
| 22-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 22-10 |
| 22-3 | Notes Related to System Fault Tree Assumptions..... | 22-26 |
| 22-4 | Systems Dependency Matrix | 22-26 |
| 22-5 | Component Test Assumptions..... | 22-27 |
| 22-6 | Component Maintenance Assumptions | 22-27 |
| 22-7 | Operator Actions and Misposition Analysis Summary..... | 22-27 |
| 22-8 | Common Cause Failure Analysis Summary | 22-28 |
| 22-9 | Fault Tree Basic Events for Class 1E DC and UPS System (Sheets 1 – 12)..... | 22-29 |
| 22-10 | System Power Requirements/Dependencies (Sheets 1 – 11)..... | 22-41 |
| 23-1 | List of System Fault Trees (Sheets 1 – 3)..... | 23-6 |
| 23-2 | Fault Tree Success Criteria Summary (Sheets 1 – 10) | 23-9 |
| 23-3 | Notes Related to System Fault Tree Assumptions..... | 23-19 |
| 23-4 | System Dependency Matrix | 23-19 |
| 23-5 | Component Test Assumptions..... | 23-20 |
| 23-6 | Component Maintenance Assumptions | 23-20 |
| 23-7 | Operator Actions and Misposition Analysis Summary..... | 23-20 |
| 23-8 | Common Cause Failure Analysis Summary | 23-21 |
| 23-9 | Fault Tree Basic Events for Non-Class 1E DC and UPS Power System (Sheets 1 – 20)..... | 23-22 |
| 24-1 | AP1000 Containment Penetration List (Sheets 1 – 4)..... | 24-7 |
| 24-2 | Screening Analysis Evaluation (Sheets 1 – 5)..... | 24-16 |
| 24-3 | Containment Penetrations Not Screened Out for Normal Operation at Power Analysis..... | 24-21 |
| 24-4 | List of System Fault Trees..... | 24-21 |
| 24-5a | Fault Tree CIC Success Criteria Summary..... | 24-22 |
| 24-5b | Fault Tree CIA Success Criteria Summary..... | 24-22 |
| 24-5c | Fault Tree CIB Success Criteria Summary..... | 24-23 |
| 24-6 | Notes Related to System Fault Tree Assumptions..... | 24-23 |
| 24-7 | System Dependency Matrix (Sheets 1 – 3)..... | 24-24 |
| 24-8 | Component Test Assumptions..... | 24-27 |
| 24-9 | Component Maintenance Assumptions..... | 24-27 |
| 24-10 | Operator Actions and Misposition Analysis Summary..... | 24-28 |
| 24-11 | Common Cause Failure Analysis Summary | 24-28 |
| 24-12 | Fault Tree Basic Events for Containment Isolation System (Sheets 1 – 3) | 24-29 |
| 25-1 | List of System Fault Trees..... | 25-8 |
| 25-2a | Fault Tree CAIAIR Success Criteria Summary..... | 25-9 |
| 25-2b | Fault Tree CAIR Success Criteria Summary..... | 25-9 |
| 25-2c | Fault Tree CAAIRP Success Criteria Summary..... | 25-10 |
| 25-2d | Fault Tree ENDCAIAI Success Criteria Summary | 25-10 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 25-2e | Fault Tree ENDCAIAP Success Criteria Summary | 25-11 |
| 25-2f | Fault Tree CASF Success Criteria Summary | 25-11 |
| 25-3 | Notes Related to System Fault Tree Assumptions..... | 25-12 |
| 25-4 | System Dependency Matrix | 25-12 |
| 25-5 | Component Test Assumptions..... | 25-12 |
| 25-6 | Component Maintenance Assumptions..... | 25-13 |
| 25-7 | Operator Actions and Misposition Analysis Summary..... | 25-13 |
| 25-8 | Common Cause Failure Analysis Summary..... | 25-13 |
| 25-9 | Fault Tree Basic Events for Instrument Air Subsystem (Sheets 1 – 4)..... | 25-14 |
| 26-1 | List of System Fault Trees..... | 26-25 |
| 26-2a | Fault Tree RTPMS, and RTPMS1 Success Criteria Summary | 26-26 |
| 26-2b | Fault Tree RTSTP Success Criteria Summary | 26-26 |
| 26-2c | Fault Tree RCL Success Criteria Summary..... | 26-27 |
| 26-2d.1 | Fault Tree RCT Success Criteria Summary..... | 26-27 |
| 26-2d.2 | Fault Tree RCN Success Criteria Summary | 26-28 |
| 26-2e | I&C Subtree Success Criteria Summary (Sheets 1 – 98)..... | 26-29 |
| 26-3a | PMS I&C Subtree Constructions (Sheets 1 – 19)..... | 26-127 |
| 26-3b | Representative PMS I&C Subtree Plot Listing (Sheets 1 – 14)..... | 26-146 |
| 26-4 | PMS Dependency Matrix (Sheets 1 – 3)..... | 26-160 |
| 26-5 | PMS Components Test Assumptions | 26-163 |
| 26-6 | Component Maintenance Assumptions..... | 26-163 |
| 26-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 5)..... | 26-164 |
| 26-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 3) | 26-169 |
| 26-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2)..... | 26-172 |
| 26-10a | Fault Tree Basic Events for Reactor Trip System (Sheets 1 – 4)..... | 26-174 |
| 26-10b | Fault Tree Basic Events for the I&C Subsystem (Sheets 1 – 49)..... | 26-178 |
| 26-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3)..... | 26-227 |
| 27-1 | List of System Fault Trees..... | 27-9 |
| 27-2a | Fault Tree DAS Success Criteria Summary | 27-9 |
| 27-2b | Fault Tree DAS1 Success Criteria Summary | 27-9 |
| 27-3 | Notes Related to System Fault Tree Assumptions..... | 27-10 |
| 27-4 | System Dependency Matrix | 27-10 |
| 27-5 | Component Test Assumptions..... | 27-10 |
| 27-6 | Component Maintenance Assumptions..... | 27-10 |
| 27-7 | Operator Actions and Misposition Analysis Summary..... | 27-10 |
| 27-8 | Common Cause Failure Analysis Summary..... | 27-11 |
| 27-9 | Fault Tree Basic Events for Diverse Actuation System..... | 27-12 |
| 28-1 | List of System Fault Trees..... | 28-20 |
| 28-2 | Fault Tree Success Criteria Summary (Sheets 1 – 22) | 28-21 |
| 28-3 | PLS I&C Subtree Constructions (Sheets 1 – 9)..... | 28-43 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 28-4 | PLS Dependency Matrix (Sheets 1 – 2) | 28-52 |
| 28-5 | PLS Components Test Assumptions | 28-54 |
| 28-6 | Component Maintenance Assumptions | 28-54 |
| 28-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 3)..... | 28-55 |
| 28-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 2) | 28-58 |
| 28-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2)..... | 28-60 |
| 28-10 | Fault Tree Basic Events for I&C Subsystem (Sheets 1 – 68)..... | 28-62 |
| 28-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3)..... | 28-130 |
| 28-12 | Assignments of Plant Systems to Logic Cabinets..... | 28-133 |
| 28-13 | Assignments of Plant Systems to the Control Group Cabinets..... | 28-134 |
| 29-1 | Electrical Components with Low CCF Rate | 29-18 |
| 29-2 | Common-Cause Failure Calculations (Sheets 1 – 5)..... | 29-19 |
| 29-3 | Simplification of Q_K/Q_T Equations..... | 29-24 |
| 29A-1 | Extreme Environmental Conditions (Generic Causes of Dependent Failures) Excerpted from the ANS/IEEE PRA Procedures Guide (NUREG-2300)..... | 29A-11 |
| 29A-2 | Common-Cause Failures Among Systems | 29A-12 |
| 29A-3 | Common-Cause Failure Equations for MGL Method | 29A-13 |
| 30-1 | AP1000 Human Error Probability Summary Results (Sheets 1 – 16)..... | 30-75 |
| 30-2 | Manual DAS Actuation (Sheets 1 – 2)..... | 30-91 |
| 30-3 | Dependency Level Evaluation Summary (Sheets 1 – 14)..... | 30-93 |
| 30-4 | Dependency Level Evaluation (Sheets 1 – 3)..... | 30-107 |
| 30-5 | List of Acronyms..... | 30-110 |
| 30A-1 | Analyst Responsibility Based on Sharp Steps | 30A-10 |
| 30A-2 | Summary of Screening Values | 30A-11 |
| 30A-3 | Example of Operator Action Definition | 30A-12 |
| 30A-4 | HEP Data Bank (Sheets 1 – 5)..... | 30A-13 |
| 31-1 | Summary of Event Tree Scalar Probabilities..... | 31-12 |
| 32-1 | Generic Data Base (Sheets 1 – 13)..... | 32-5 |
| 32-2 | Test and Maintenance Outage Generic Data | 32-21 |
| 32-3 | Test and Maintenance Unavailabilities Used in AP1000 Core Damage Quantification..... | 32-22 |
| 32-4 | Common Cause Factors (Sheets 1 – 5)..... | 32-23 |
| 32-5 | SIMON.OUT File (Sheets 1 – 21) | 32-29 |
| 33-1 | Summary of AP1000 System Fault Tree Failure Probabilities (Sheets 1 – 13)..... | 33-7 |
| 33-2 | Example Accident Sequence Definitions for Large LOCA..... | 33-20 |
| 33-3 | AP1000 PRA Dominant CDF Cutsets (Sheets 1 – 10) | 33-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 33-4 | AP1000 PRA Dominant CDF Sequences (Sheets 1 – 18) | 33-31 |
| 33-5 | Contribution of Initiating Events to Plant Core Damage Frequency | 33-49 |
| 33-6 | List of Basic Events and Their Descriptions (Sheets 1 – 33) | 33-50 |
| 34-1 | Post-Accident Monitoring Equipment (Sheets 1 – 2)..... | 34-23 |
| 34-2 | Level 1 Accident Class..... | 34-25 |
| 34-3 | Summary of Release Categories..... | 34-26 |
| 34-4 | 3BE-1 Event Summary..... | 34-27 |
| 34-5 | 3BE-2 Event Summary..... | 34-28 |
| 34-6 | 3BE-4 Event Summary..... | 34-29 |
| 34-7 | 3BE-5 Event Summary..... | 34-30 |
| 34-8 | 3BE-6 Event Summary..... | 34-31 |
| 34-9 | 3BE-7 Event Summary..... | 34-32 |
| 34-10 | 3BE-3 Event Summary..... | 34-33 |
| 34-11 | 3BL-1 Event Summary..... | 34-34 |
| 34-12 | 3BL-2 Event Summary..... | 34-35 |
| 34-13 | 3BR-1 Event Summary | 34-36 |
| 34-14 | 3BR-1a Event Summary..... | 34-37 |
| 34-15 | 3C-1 Event Summary | 34-38 |
| 34-16 | 3C-2 Event Summary | 34-39 |
| 34-17 | 3D-1 Event Summary..... | 34-40 |
| 34-18 | 3D-2 Event Summary..... | 34-41 |
| 34-19 | 3D-3 Event Summary..... | 34-42 |
| 34-20 | 3D-4 Event Summary..... | 34-43 |
| 34-21 | 6E-1 Event Summary | 34-44 |
| 34-22 | 6L-1 Event Summary | 34-45 |
| 34-23 | 1AP-1 Event Summary..... | 34-46 |
| 34-24 | 1AP-2 Event Summary..... | 34-47 |
| 34-25 | 1A-1 Event Summary..... | 34-48 |
| 34-26 | 1A-2 Event Summary..... | 34-49 |
| 34-27 | CFI Event Summary..... | 34-50 |
| 34-28 | CFL Event Summary..... | 34-51 |
| 35-1 | Functional Definitions of Level 1 Accident Classes | 35-21 |
| 35-2 | CET Initial Conditions for Level 1 Accident Classes..... | 35-22 |
| 35-3 | Containment Event Tree Nodal Questions | 35-23 |
| 35-4 | Summary of Release Category Definitions..... | 35-24 |
| 35-5 | Summary of Containment Event Tree Success Criteria (Sheets 1 – 3)..... | 35-25 |
| 35-6 | Summary of Operator Actions Credited on Containment Event Tree | 35-28 |
| 36-1 | Summary Table for RCS Depressurization (CET Node DP)..... | 36-6 |
| 37-1 | Summary Table for Containment Isolation (CET Node IS) | 37-4 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 38-1 | Summary Table for Reflooding (CET Node RFL)..... | 38-5 |
| 39-1 | Material Inventories in AP1000 Reactor Vessel..... | 39-21 |
| 39-2 | Summary Table for Reactor Cavity Flooding (CET Node IR)..... | 39-22 |
| 39-3 | Summary Table for Debris Relocation to Cavity (CET Node VF)..... | 39-22 |
| 39A-1 | Core and Lower Internals Material Inventories in AP1000 Reactor Vessel | 39A-14 |
| 39A-2a | Mass and Power Distributions of Debris Layers in Top-Skewed Power Shape Case | 39A-15 |
| 39A-2b | Mass and Power Distributions of Debris Layers in Chopped Cosine Power Shape Case | 39A-16 |
| 39A-3a | Results of Top-Skewed Power Shape Case | 39A-17 |
| 39A-3b | Relocation Results of the Chopped Cosine Power Shape Case | 39A-18 |
| 39A-4 | Material Properties Used in In-Vessel Melting and Relocation Calculation | 39A-19 |
| 39A-5 | Debris Relocation Time Line | 39A-20 |
| 40-1 | Summary of Nodal Failure Probabilities | 40-6 |
| 40-2 | Nominal and Bounding Containment Failure Probability at 24 and 72 Hours | 40-6 |
| 41-1 | Containment Event Tree IG Nodal Failure Probability | 41-33 |
| 41-2 | Containment Event Tree Nodal Failure Probabilities..... | 41-33 |
| 41-3 | AP600 Scenario Dependencies for Early Detonation Analysis | 41-34 |
| 41-4 | Safety Margin Basis Containment Performance Requirement | 41-35 |
| 41A-1 | Summary of System Assumptions for AP1000 MAAP4.04 Hydrogen Analyses (Sheets 1 – 7)..... | 41A-2 |
| 41A-2 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-10 |
| 41A-3 | Summary of Early Compartment Gas Composition Results For MAAP4 Hydrogen Mixing Analyses..... | 41A-10 |
| 41A-4 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-11 |
| 41A-5 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-11 |
| 41A-6 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-7 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-8 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-13 |
| 41A-9 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-14 |
| 41A-10 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-15 |
| 41A-11 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 41A-12 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-13 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-14 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-17 |
| 41A-15 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-17 |
| 41A-16 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-18 |
| 41A-17 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-18 |
| 41A-18 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-19 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-20 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-20 |
| 41A-21 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-20 |
| 41A-22 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-21 |
| 41A-23 | Sequence 1A-3a | 41A-22 |
| 41A-24 | Sequence 1A-4a | 41A-23 |
| 41A-25 | Sequence 1AP-3..... | 41A-24 |
| 41A-26 | Sequence 1AP-4..... | 41A-25 |
| 41A-27 | Sequence 3D-1 | 41A-26 |
| 41A-28 | Sequence 3D-2 | 41A-27 |
| 41A-29 | Sequence 3D-3 | 41A-28 |
| 41A-30 | Sequence 3D-5 | 41A-29 |
| 41A-31 | Sequence 3BL-1 | 41A-30 |
| 41A-32 | Sequence 3BL-2..... | 41A-31 |
| 41A-33 | Sequence 3C-1 | 41A-32 |
| 41A-34 | Sequence 3BR-1a..... | 41A-33 |
| 41A-35 | Sequence 3BE-1..... | 41A-34 |
| 41A-36 | Sequence 3BE-2..... | 41A-35 |
| 41A-37 | Sequence 3BE-4..... | 41A-36 |
| 41A-38 | Sequence 3BE-5..... | 41A-37 |
| 41A-39 | Sequence 3BE-6..... | 41A-38 |
| 41A-40 | Sequence 3BE-8..... | 41A-39 |
| 41A-41 | Sequence 3BE-9..... | 41A-40 |
| 42-1 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 400°F..... | 42-9 |
| 42-2 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 331°F..... | 42-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 42-3 | Cumulative Containment Failure Probability, Temperature = 400°F..... | 42-10 |
| 42-4 | Cumulative Containment Failure Probability, Temperature = 331°F..... | 42-11 |
| 43-1 | Accident Class Frequencies | 43-13 |
| 43-2 | Boolean Expressions to Calculate Q1-Q29 | 43-14 |
| 43-3 | CET Node Probabilities (Sheets 1 – 3) | 43-15 |
| 43-4 | Boolean Expressions for P1-P15 | 43-18 |
| 43-5 | Contribution of PDS to LRF (Sheets 1 – 3) | 43-19 |
| 43-6 | Dominant CET Sequences Contributing to LRF (Sheets 1 – 69)..... | 43-22 |
| 43-7 | Summary of Release Frequency Calculations (Sheets 1 – 2) | 43-91 |
| 43-8 | LRF and Containment Effectiveness by Accident Class | 43-93 |
| 43-9 | Summary of AP1000 LRF Quantification for Internal Events At-Power..... | 43-94 |
| 43-10 | CET Event Tree Node Importances | 43-95 |
| 43-11 | Contribution of Initiating Events to Large Release | 43-96 |
| 43-12 | LRF Sensitivity Case – Non Credit for Standby Non-Safety Systems (Sheets 1 – 9) | 43-97 |
| 43-13 | LRF Cutsets for the Case – Sensitivity to Standby Systems With Credit for Manual DAS (Sheets 1 – 13)..... | 43-106 |
| 43A-1 | AP1000 PRA Dominant CDF Sequences for At-Power Events (Sheets 1 – 6)..... | 43A-2 |
| 43A-2 | AP1000 PRA PDS Frequencies for At-Power Events..... | 43A-8 |
| 43B-1 | Calculation of Failure Probability of DP for PDS 6 (Sheets 1 – 7)..... | 43B-2 |
| 43C-1 | Evaluation of CET-Related Operator Actions..... | 43C-2 |
| 44-1 | MAAP Model Benchmarks (Sheets 1 – 4)..... | 44-8 |
| 45-1 | Environmental Release Fractions at 24 Hours After Core Damage Per Release Category..... | 45-5 |
| 45-2 | Environmental Release Fractions at 72 Hours After Core Damage Per Release Category..... | 45-6 |
| 49-1 | AP1000 Source Terms from Level 2 Analysis (MAAP)..... | 49-9 |
| 49-2 | AP1000 Source Terms for Dose Evaluation (MACCS2)..... | 49-10 |
| 49-3 | Site Boundary Whole Body Dose [Effective Dose Equivalent (EDE)], Sieverts | 49-11 |
| 49-4 | Site Boundary Thyroid Dose, Sieverts | 49-12 |
| 49-5 | Population Whole Body Dose [Effective Dose Equivalent (EDE)], 0-80.5 km Person-Sieverts | 49-13 |
| 49-6 | Site Boundary Red Marrow Dose (Total Acute), Sieverts..... | 49-14 |
| 49-7 | Dose Summary | 49-15 |
| 49-8 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 49-16 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 49-9 | Site Boundary Whole Body EDE Dose Risk – 72 Hours | 49-17 |
| 49-10 | Population Whole Body EDE Dose Risk – 24 Hours..... | 49-18 |
| 49-11 | Population Whole Body EDE Dose Risk – 72 Hours..... | 49-19 |
| 50-1 | Core Damage for At-Power Events Contribution of Initiating Events to Plant Core Damage Frequency | 50-16 |
| 50-2 | Core Damage for At-Power Events Conditional Core Damage Probability of Initiating Events | 50-17 |
| 50-3 | AP1000 PRA Core Damage for At-Power Events Accident Sequence Importances (Sheets 1 – 5)..... | 50-18 |
| 50-4 | Core Damage for At-Power Events End State Importances | 50-23 |
| 50-5 | Common Cause Importances – Risk Decrease (Sheets 1 – 2)..... | 50-24 |
| 50-6 | Common Cause Importances – Risk Increase (Sheets 1 – 3) | 50-26 |
| 50-7 | Human Error Risk Importances – Risk Decrease (Sheets 1 – 2) | 50-29 |
| 50-8 | Human Error Risk Importances – Risk Increase (Sheets 1 – 2)..... | 50-31 |
| 50-9 | Component Importances – Risk Decrease (Sheets 1 – 2)..... | 50-33 |
| 50-10 | Component Importances – Risk Increase (Sheets 1 – 4) | 50-35 |
| 50-11 | List of Systems for System Importance Analyses (Sheets 1 – 4)..... | 50-39 |
| 50-12 | System Importance Calculation Results (Sheets 1 – 2) | 50-43 |
| 50-13 | Systems Grouped by PRA System Importance..... | 50-45 |
| 50-14 | Operator Actions in “CMTOT.OUT” File | 50-46 |
| 50-15 | Contribution of IEVs to Core Damage Frequency | 50-47 |
| 50-16 | Case 29 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-48 |
| 50-17 | Case 30 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-50 |
| 50-18 | Case 31 – Top 50 Dominant Cutsets (Sheets 1 – 3)..... | 50-52 |
| 50-19 | Passive System Check Valves in “CMTOT.OUT” File | 50-55 |
| 50-20 | Sensitivity Case 36 – Contribution of Initiating Events to CDF..... | 50-56 |
| 50-21 | Sensitivity Case 36 – Top 50 CDF Cutsets (Sheets 1 – 8) | 50-57 |
| 50-22 | Risk Importances Sorted by Basic Event Identification (Sheets 1 – 13)..... | 50-65 |
| 50-23 | Risk Importances Sorted by Risk Increase (Sheets 1 – 15) | 50-78 |
| 50-24 | Risk Importances Sorted by Risk Decrease (Sheets 1 – 15)..... | 50-93 |
| 50-25 | Risk Increases Sorted by Slope (Birbaum) Importance (Sheets 1 – 13)..... | 50-108 |
| 51-1 | Summary of Results of AP1000 PRA Uncertainty Analysis for Internal Initiating Events at Power | 51-9 |
| 51-2 | List of Input Cutset Files..... | 51-10 |
| 51A-1 | Basic Event Uncertainties (Sheets 1 – 32) | 51A-3 |
| 54-1 | AP1000 Initiating Event Frequencies During Shutdown Conditions..... | 54-18 |
| 54-2 | AP1000 Design Impact on AP600 Shutdown Model..... | 54-19 |
| 54-3 | Times for Loss of RNS at Mid-loop Without IRWST Injection..... | 54-20 |
| 54-4 | AP1000 & AP600 Initiating Event CDF Contributions | 54-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 54-5 | AP600 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-22 |
| 54-6 | AP1000 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-47 |
| 54-7 | Basic Event Probabilities Revised in Case 1 | 54-72 |
| 54-8 | Revised CCF Basic Event Probabilities (Sheets 1 – 2) | 54-73 |
| 54-9 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 1 | 54-75 |
| 54-9A | Dominant CDF Cutsets for Drained Conditions Only for AP1000 Shutdown PRA Sensitivity Case 1 (Sheets 1 – 24) | 54-76 |
| 54-10 | AP1000 Shutdown PRA Sensitivity Case 2 CDF Cutsets (Sheets 1 – 5)..... | 54-100 |
| 54-11 | List of Basic Events “Dropped” to Make the Sensitivity Case 2..... | 54-105 |
| 54-12 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 2 | 54-106 |
| 54-13 | Shutdown PRA Sensitivity Case 3 (Sheets 1 – 28) | 54-107 |
| 54-14 | Basic Events Whose Probabilities are Changed in Case 3 | 54-135 |
| 54-15 | AP1000 Shutdown PRA Sensitivity Case 4 CDF Cutsets (Sheets 1 – 7)..... | 54-136 |
| 54-16 | List of Basic Events “Dropped” to Make the Sensitivity Case 4..... | 54-143 |
| 54-17 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 4 | 54-144 |
| 54-18 | AP1000 Shutdown PRA Basic Event Risk Importances – RAW (Sheets 1 – 8)..... | 54-145 |
| 54-19 | AP1000 Shutdown PRA Basic Event Risk Importances – RRW (Sheets 1 – 3)..... | 54-153 |
| 54-20 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RAW (Sheets 1 – 4) | 54-156 |
| 54-21 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RRW (Sheets 1 – 2) | 54-160 |
| 55-1 | Seismic Margin HCLPF Values (Sheets 1 – 4)..... | 55-21 |
| 55-2 | Basic Event HCLPF Values (Sheets 1 – 3)..... | 55-25 |
| 55-3 | EQ-IEV-STRUC HCLPF..... | 55-28 |
| 55-4 | EQ-IEV-RVFA HCLPF | 55-28 |
| 55-5 | EQ-IEV-LLOCA HCLPF | 55-29 |
| 55-6 | EQ-IEV-SLOCA HCLPF..... | 55-29 |
| 55-7 | EQ-IEV-ATWS HCLPF | 55-29 |
| 56-1 | Flooding Analysis Initial Screening Results (Sheets 1 – 3)..... | 56-50 |
| 56-2 | At-Power Detailed Screening Results (Sheets 1 – 5) | 56-53 |
| 56-3 | At-Power Flooding-Induced Core Damage Frequency Quantification Summary Results (Sheets 1 – 6)..... | 56-58 |
| 56-4 | Power Upgrade Difference Between AP1000 and AP600 | 56-64 |
| 56-5 | Shutdown Flooding PRA | 56-65 |
| 56-6 | Shutdown Initiating Event CCDPs..... | 56-66 |
| 57-1 | AP1000 Fire Areas Excluding the Containment (Sheets 1 – 6) | 57-43 |
| 57-2 | AP1000 Fire Areas in the Containment (Sheets 1 – 2)..... | 57-49 |
| 57-3 | Fire Ignition Frequencies for AP1000 Fire Areas (Sheets 1 – 4) | 57-51 |
| 57-4 | Fire Ignition Frequencies for AP1000 Containment Fire Area | 57-58 |
| 57-5 | Fire Barrier Failure Probabilities..... | 57-61 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 57-6 | Automatic Suppression System Reliability | 57-62 |
| 57-7 | Summary of Qualitative Evaluation Results – Power Operation – Plant except Containment and Main Control Room (Sheets 1 – 15)..... | 57-63 |
| 57-8 | Summary of Qualitative Evaluation Results for Containment at Power Operation (Sheets 1 – 4)..... | 57-82 |
| 57-9 | Summary of Results (Sheets 1 – 5) | 57-88 |
| 57-10 | Distribution of Fire CDF Frequency by Three Major Plant Areas | 57-93 |
| 57-11 | Distribution of Fire CDF Frequency by Eight Plant Areas..... | 57-94 |
| 57-12 | Fire Areas Sorted by CDF (Sheets 1 – 5) | 57-95 |
| 57-13 | Fire Areas Sorted by CDF/FIEV (Sheets 1 – 5) | 57-100 |
| 57-14 | Credit for Manual Fire Suppression | 57-105 |
| 57-15 | Reduction of Hot Short Probability | 57-106 |
| 57-16 | Increase of Hot Short Probability | 57-107 |
| 57-17 | Sensitivity to Human Actions..... | 57-108 |
| 57-18 | Sensitivity to Fire Ignition Frequencies..... | 57-109 |
| 57-19 | Sensitivity to Actuation by DAS | 57-110 |
| 57-20 | Plant Fire CDF Without Hot Shorts | 57-111 |
| 57-21 | Contribution of the Plant Areas to CDF | 57-112 |
| 57-22 | Dominant Fire Scenarios (Sheets 1 – 4) | 57-113 |
| 57-23 | AP1000 Shutdown CCDPs | 57-117 |
| 57-24 | AP1000 Dominant Fire Sequences (Sheets 1 – 4)..... | 57-118 |
| 57-25 | Dominant Fire Scenarios from AP600 Shutdown Fire PRA | 57-122 |
| 57-26 | Summary of AP1000 Shutdown Fire Evaluation | 57-123 |
| 57-27 | Main Contributors for Shutdown Fire Risk..... | 57-124 |
| 57A-1 | Summary of Scenario CCDPs (Sheets 1 – 5) | 57A-7 |
| 57A-2 | AP1000 Base Case CCDPs for Initiating Events | 57A-12 |
| 57A-3 | DAS-ACT Fault Tree Cutsets Before Subtree Reduction | 57A-13 |
| 57A-4 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 10)..... | 57A-14 |
| 57A-5 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 9)..... | 57A-24 |
| 57A-6 | AP1000 Fire PRA Scenario CCDPs for Over-Conservative Cases (Sheets 1 – 3) | 57A-33 |
| 57C-1 | Data Used in Event Tree Scenario Frequency Calculations (Sheets 1 – 5) | 57C-2 |
| 57C-2 | CCDPs Used in Fire Event Trees (Sheets 1 – 5) | 57C-7 |
| 59-1 | Contribution of Initiating Events to Core Damage | 59-39 |
| 59-2 | Conditional Core Damage Probability of Initiating Events | 59-40 |
| 59-3 | Internal Initiating Events at Power Dominant Core Damage Sequences (Sheets 1 – 4) | 59-41 |
| 59-4 | Sequence 1 – Safety Injection Line Break Dominant Cutsets (SI-LB-07) (Sheets 1 – 3) | 59-45 |
| 59-5 | Sequence 2 – Large LOCA Dominant Cutsets (LLOCA-09)..... | 59-48 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 59-6 | Sequence 3 – Spurious ADS Actuation Dominant Cutsets (SPADS-08) (Sheets 1 – 3) | 59-49 |
| 59-7 | Sequence 4 – Safety Injection Line Break Dominant Cutsets (SI-LB-08) (Sheets 1 – 3) | 59-52 |
| 59-8 | Sequence 5 – Reactor Vessel Rupture Cutset (RV-RP-02) | 59-55 |
| 59-9 | Sequence 6 – Small LOCA Dominant Cutsets (SLOCA-05) (Sheets 1 – 3) | 59-56 |
| 59-10 | Sequence 7 – Medium LOCA Dominant Cutsets (MLOCA-05) (Sheets 1 – 3) | 59-59 |
| 59-11 | Sequence 8 – Small LOCA Dominant Cutsets (SLOCA-12) (Sheets 1 – 3) | 59-62 |
| 59-12 | Sequence 9 – Medium LOCA Dominant Cutsets (MLOCA-12) (Sheets 1 – 3) | 59-65 |
| 59-13 | Sequence 10 – Spurious ADS Actuation Dominant Cutsets (SPADS-09) (Sheets 1 – 3) | 59-68 |
| 59-14 | Typical System Failure Probabilities, Showing Higher Reliabilities for Safety Systems | 59-71 |
| 59-15 | Summary of AP1000 PRA Results | 59-72 |
| 59-16 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 59-73 |
| 59-17 | Comparison of AP1000 PRA Results to Risk Goals | 59-74 |
| 59-18 | AP1000 PRA-Based Insights (Sheets 1 –24) | 59-75 |

LIST OF FIGURES

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 2-1 | Core Damage Logic Diagram for Internal Initiators (Sheets 1 – 4)..... | 2-47 |
| 4A-1 | Example Event Tree for Illustration of Terminology | 4A-19 |
| 4A-2 | Functional Event Tree | 4A-20 |
| 4A-3 | Illustration of A/B and A&B Notation | 4A-21 |
| 4A-4 | Illustration of Consequential Event and ATWS End States | 4A-22 |
| 4A-5 | AP1000 PRA Transients Template Event Tree (Sheets 1 – 3)..... | 4A-23 |
| 4A-6 | AP1000 PRA Small LOCA Template Event Tree (Sheets 1 – 2) | 4A-26 |
| 4B-1 | AP1000 Large LOCA Event Tree (Sheets 1 – 2)..... | 4B-2 |
| 4B-2 | AP1000 Large Spurious ADS Actuation Event Tree (Sheets 1 – 2)..... | 4B-4 |
| 4B-3 | AP1000 Medium LOCA Event Tree (Sheets 1 – 4)..... | 4B-6 |
| 4B-4 | AP1000 CMT Line Break Event Tree (Sheets 1 – 4)..... | 4B-10 |
| 4B-5 | AP1000 SI Line Break Event Tree (Sheets 1 – 3)..... | 4B-14 |
| 4B-6 | AP1000 Small LOCA Event Tree (Sheets 1 – 6)..... | 4B-17 |
| 4B-7 | AP1000 RCS Leak Event Tree | 4B-23 |
| 4B-8 | AP1000 Passive RHR Tube Rupture Event Tree..... | 4B-24 |
| 4B-9a | AP1000 Steam Generator Tube Rupture Event Tree (Sheets 1 – 3)..... | 4B-25 |
| 4B-9b | AP1000 SGTR Continues Event Tree (Sheets 1 – 6)..... | 4B-28 |
| 4B-10 | AP1000 Reactor Vessel Rupture Event Tree | 4B-34 |
| 4B-11 | AP1000 Interfacing Systems LOCA Event Tree..... | 4B-35 |
| 4B-12 | AP1000 Transients With Main Feedwater Event Tree (Sheets 1 – 4)..... | 4B-36 |
| 4B-13 | AP1000 Loss of Reactor Coolant Flow Event Tree (Sheets 1 – 4) | 4B-40 |
| 4B-14 | AP1000 Loss of Feedwater to One SG Tree (Sheets 1 – 4) | 4B-44 |
| 4B-15 | AP1000 Transients With Core Power Excursion Event Tree (Sheets 1 – 4)..... | 4B-48 |
| 4B-16 | AP1000 Transients With Loss of CCW/SW Event Tree (Sheets 1 – 4)..... | 4B-52 |
| 4B-17 | AP1000 Loss of MFW Event Tree (Sheets 1 – 4)..... | 4B-56 |
| 4B-18 | AP1000 Loss of Condenser Event Tree (Sheets 1 – 4) | 4B-60 |
| 4B-19 | AP1000 Loss of Main Compressed Air Event Tree (Sheets 1 – 4)..... | 4B-64 |
| 4B-20 | AP1000 Loss of Offsite Power Event Tree (Sheets 1 – 7) | 4B-68 |
| 4B-21 | Main Steam Line Break Downstream of MSIVs Event Tree (Sheets 1 – 5) | 4B-75 |
| 4B-22 | Main Steam Line Break Upstream of MSIVs Event Tree (Sheets 1 – 9) | 4B-80 |
| 4B-23 | Stuck Open Secondary Side Safety Valve Event Tree (Sheets 1 – 5) | 4B-89 |
| 4B-24a | ATWS Precursor Without Main Feedwater | 4B-94 |
| 4B-24b | AP1000 ATWS Precursor Without Main Feedwater Continues Event Tree (Sheets 1 – 6) | 4B-95 |
| 4B-25 | ATWS Precursor With SI (Sheets 1 – 6)..... | 4B-101 |
| 4B-26 | ATWS Precursor With MFW (Sheets 1 – 4)..... | 4B-107 |
| 7-1 | Power/Control Model for Large Loads (6900-vac/480-vac Pumps, Fans, and Motors)..... | 7-33 |
| 7-2 | Power/Control Model for Motor-Operated Valves..... | 7-35 |
| 7-3 | Power/Control Model for Air-Operated Valves | 7-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 7-4 | Power/Control Model for Variable Speed Motor | 7-39 |
| 7-5 | An Illustration of Fault Tree Basic Events for a Pump Following the Model Given in Figure 7-1 | 7-41 |
| 8-1 | PRHR – Simplified Piping and Instrumentation Diagram..... | 8-23 |
| 8-2 | PRHR – Simplified Valve Control Diagram | 8-25 |
| 9-1 | Passive Core Cooling System Simplified Sketch | 9-24 |
| 9-2 | Passive Core Cooling System Piping and Instrumentation Diagram | 9-25 |
| 10-1 | Passive Core Cooling System – Accumulator Subsystem | 10-12 |
| 11-1 | Automatic Depressurization System Simplified Piping and Instrumentation Diagram..... | 11-49 |
| 12-1 | Simplified Piping & Instrumentation Diagram of the IRWST/Gravity Injection Subsystem..... | 12-42 |
| 13-1 | Passive Containment Cooling System Sketch | 13-11 |
| 15-1 | Chemical and Volume Control System Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 15-25 |
| 17-1 | Normal Residual Heat Removal System Sketch..... | 17-19 |
| 18-1 | Component Cooling Water System Piping and Instrumentation Diagram | 18-13 |
| 19-1 | Service Water System Piping and Instrumentation Diagram..... | 19-17 |
| 20-1 | Central Chilled Water Low-Capacity Subsystem Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 20-11 |
| 21-1 | AC Power System One-Line Diagram | 21-55 |
| 22-1 | Class 1E DC System One-Line Diagram (Sheets 1 – 2)..... | 22-53 |
| 22-2 | Class 1E UPS One-Line Diagram | 22-57 |
| 25-1 | Compressed & Instrument Air System Piping and Instrumentation Diagram | 25-19 |
| 29-1 | IRWST Valve Configuration..... | 29-25 |
| 30-1 | Human Reliability Analysis Quantification Model | 30-111 |
| 30A-1 | Links Between SHARP Steps | 30A-18 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-1 | Case 3BE-1: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Containment Water Level..... | 34-52 |
| 34-2 | Case 3BE-1: ADS Stage 4 Flow Rates DVI Line Break, Containment Water Level..... | 34-52 |
| 34-3 | Case 3BE-1: Accumulator/CMT Water Mass DVI Line Break, Containment Water Level | 34-53 |
| 34-4 | Case 3BE-1: IRWST Injection Flow Rate DVI Line Break, Containment Water Level | 34-53 |
| 34-5 | Case 3BE-1: Break Flow Rate DVI Line Break, Containment Water Level..... | 34-54 |
| 34-6 | Case 3BE-1: Reactor Vessel Water Level DVI Line Break, Containment Water Level | 34-54 |
| 34-7 | Case 3BE-1: Core Temperatures DVI Line Break, Containment Water Level..... | 34-55 |
| 34-8 | Case 3BE-1: Containment Water Pool Elevations DVI Line Break, Containment Water Level | 34-55 |
| 34-9 | Case 3BE-1: Containment Pressure DVI Line Break, Containment Water Level..... | 34-56 |
| 34-10 | Case 3BE-1: Containment Gas Temperatures DVI Line Break, Containment Water Level | 34-56 |
| 34-11 | Case 3BE-1: Core Mass DVI Line Break, Containment Water Level..... | 34-57 |
| 34-12 | Case 3BE-1: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Containment Water Level..... | 34-57 |
| 34-13 | Case 3BE-1: In-Vessel Hydrogen Generation DVI Line Break, Containment Water Level | 34-58 |
| 34-14 | Case 3BE-1: Mass Fraction of CsI Released to Containment DVI Line Break, Containment Water Level..... | 34-58 |
| 34-15 | Case 3BE-1: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-16 | Case 3BE-1: Mass Fraction of Fission Products Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-17 | Case 3BE-1: Mass Fraction of SrO Released to Environment DVI Line Break, Containment Water Level..... | 34-60 |
| 34-18 | Case 3BE-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-60 |
| 34-19 | Case 3BE-2: ADS Stage 4 Flow Rates DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-20 | Case 3BE-2: Accumulator/CMT Water Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-21 | Case 3BE-2: IRWST Injection Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |
| 34-22 | Case 3BE-2: Break Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-23 | Case 3BE-2: Reactor Vessel Water Level DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-24 | Case 3BE-2: Core Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-25 | Case 3BE-2: Containment Water Pool Elevations DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-26 | Case 3BE-2: Containment Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-27 | Case 3BE-2: Containment Gas Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-28 | Case 3BE-2: Core Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-29 | Case 3BE-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-66 |
| 34-30 | Case 3BE-2: In-Vessel Hydrogen Generation DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-66 |
| 34-31 | Case 3BE-2: Mass Fraction of CsI Released to Containment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-32 | Case 3BE-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-33 | Case 3BE-2: Mass Fraction of Fission Products Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-34 | Case 3BE-2: Mass Fraction of SrO Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-35 | Case 3BE-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS, Failed Gravity Injection..... | 34-69 |
| 34-36 | Case 3BE-4: ADS Stage 4 Flow Rates Spurious ADS, Failed Gravity Injection | 34-69 |
| 34-37 | Case 3BE-4: Accumulator/CMT Water Mass Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-38 | Case 3BE-4: IRWST Injection Flow Rate Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-39 | Case 3BE-4: Break Flow Rate Spurious ADS, Failed Gravity Injection..... | 34-71 |
| 34-40 | Case 3BE-4: Reactor Vessel Water Level Spurious ADS, Failed Gravity Injection | 34-71 |
| 34-41 | Case 3BE-4: Core Temperatures Spurious ADS, Failed Gravity Injection | 34-72 |
| 34-42 | Case 3BE-4: Containment Water Pool Elevations Spurious ADS, Failed Gravity Injection..... | 34-72 |
| 34-43 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection | 34-73 |
| 34-44 | Case 3BE-4: Containment Gas Temperatures Spurious ADS, Failed Gravity Injection..... | 34-73 |
| 34-45 | Case 3BE-4: Core Mass Spurious ADS, Failed Gravity Injection | 34-74 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-46 | Case 3BE-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS, Failed Gravity Injection..... | 34-74 |
| 34-47 | Case 3BE-4: In-Vessel Hydrogen Generation Spurious ADS, Failed Gravity Injection | 34-75 |
| 34-48 | Case 3BE-4: Mass Fraction of CsI Released to Containment Spurious ADS, Failed Gravity Injection..... | 34-75 |
| 34-49 | Case 3BE-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-50 | Case 3BE-4: Mass Fraction of Fission Products Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-51 | Case 3BE-4: Mass Fraction of SrO Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-77 |
| 34-52 | Case 3BE-5: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-77 |
| 34-53 | Case 3BE-5: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-78 |
| 34-54 | Case 3BE-5: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-78 |
| 34-55 | Case 3BE-5: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-56 | Case 3BE-5: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-57 | Case 3BE-5: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-80 |
| 34-58 | Case 3BE-5: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-80 |
| 34-59 | Case 3BE-5: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-81 |
| 34-60 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 34-81 |
| 34-61 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-82 |
| 34-62 | Case 3BE-5: Core Mass SBLOCA with Failed Gravity Injection..... | 34-82 |
| 34-63 | Case 3BE-5: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-83 |
| 34-64 | Case 3BE-5: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-83 |
| 34-65 | Case 3BE-5: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-84 |
| 34-66 | Case 3BE-5: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-84 |
| 34-67 | Case 3BE-5: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |
| 34-68 | Case 3BE-5: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-69 | Case 3BE-6: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-86 |
| 34-70 | Case 3BE-6: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-86 |
| 34-71 | Case 3BE-6: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-87 |
| 34-72 | Case 3BE-6: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-87 |
| 34-73 | Case 3BE-6: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-88 |
| 34-74 | Case 3BE-6: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-88 |
| 34-75 | Case 3BE-6: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-76 | Case 3BE-6: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-77 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection | 34-90 |
| 34-78 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-90 |
| 34-79 | Case 3BE-6: Core Mass SBLOCA with Failed Gravity Injection..... | 34-91 |
| 34-80 | Case 3BE-6: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-91 |
| 34-81 | Case 3BE-6: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-92 |
| 34-82 | Case 3BE-6: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-92 |
| 34-83 | Case 3BE-6: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-93 |
| 34-84 | Case 3BE-6: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-93 |
| 34-85 | Case 3BE-6: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-94 |
| 34-86 | Case 3BE-7: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-94 |
| 34-87 | Case 3BE-7: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-95 |
| 34-88 | Case 3BE-7: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-95 |
| 34-89 | Case 3BE-7: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-96 |
| 34-90 | Case 3BE-7: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-96 |
| 34-91 | Case 3BE-7: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-97 |
| 34-92 | Case 3BE-7: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-97 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-93 | Case 3BE-7: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-98 |
| 34-94 | Case 3BE-7: Containment Pressure SBLOCA with Failed Gravity Injection | 34-98 |
| 34-95 | Case 3BE-7: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-99 |
| 34-96 | Case 3BE-7: Core Mass SBLOCA with Failed Gravity Injection..... | 34-99 |
| 34-97 | Case 3BE-7: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-100 |
| 34-98 | Case 3BE-7: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-100 |
| 34-99 | Case 3BE-7: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-101 |
| 34-100 | Case 3BE-7: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-101 |
| 34-101 | Case 3BE-7: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-102 | Case 3BE-7: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-103 | Case 3BE-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-103 |
| 34-104 | Case 3BE-3: ADS Stage 4 Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-103 |
| 34-105 | Case 3BE-3: Accumulator/CMT Water Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-106 | Case 3BE-3: IRWST Injection Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-107 | Case 3BE-3: Break Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-105 |
| 34-108 | Case 3BE-3: Reactor Vessel Water Level DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-105 |
| 34-109 | Case 3BE-3: Core Temperatures DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-106 |
| 34-110 | Case 3BE-3: Containment Water Pool Elevations DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-106 |
| 34-111 | Case 3BE-3: Containment Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-107 |
| 34-112 | Case 3BE-3: Containment Gas Temperature DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-107 |
| 34-113 | Case 3BE-3: Core Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |
| 34-114 | Case 3BE-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-115 | Case 3BE-3: In-Vessel Hydrogen Generation DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-109 |
| 34-116 | Case 3BE-3: Mass Fraction of CsI Released to Containment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-109 |
| 34-117 | Case 3BE-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-110 |
| 34-118 | Case 3BE-3: Mass Fraction of Fission Products Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-110 |
| 34-119 | Case 3BE-3: Mass Fraction of SrO Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-111 |
| 34-120 | Case 3BL-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-111 |
| 34-121 | Case 3BL-1: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-112 |
| 34-122 | Case 3BL-1: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-112 |
| 34-123 | Case 3BL-1: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-113 |
| 34-124 | Case 3BL-1: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-113 |
| 34-125 | Case 3BL-1: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-114 |
| 34-126 | Case 3BL-1: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-114 |
| 34-127 | Case 3BL-1: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection | 34-115 |
| 34-128 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Injection | 34-115 |
| 34-129 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-116 |
| 34-130 | Case 3BL-1: Core Mass SBLOCA with Failed Gravity Injection | 34-116 |
| 34-131 | Case 3BL-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-117 |
| 34-132 | Case 3BL-1: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-117 |
| 34-133 | Case 3BL-1: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-134 | Case 3BL-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-135 | Case 3BL-1: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-136 | Case 3BL-1: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-137 | Case 3BL-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed Gravity Injection | 34-120 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-138 | Case 3BL-2: ADS Stage 4 Flow Rates DVI Line Break with Failed Gravity Injection | 34-120 |
| 34-139 | Case 3BL-2: Accumulator/CMT Water Mass DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-140 | Case 3BL-2: IRWST Injection Flow Rate DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-141 | Case 3BL-2: Break Flow Rate DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-142 | Case 3BL-2: Reactor Vessel Water Level DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-143 | Case 3BL-2: Core Temperatures DVI Line Break with Failed Gravity Injection | 34-123 |
| 34-144 | Case 3BL-2: Containment Water Pool Elevations DVI Line Break with Failed Gravity Injection..... | 34-123 |
| 34-145 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Injection | 34-124 |
| 34-146 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection..... | 34-124 |
| 34-147 | Case 3BL-2: Core Mass DVI Line Break with Failed Gravity Injection | 34-125 |
| 34-148 | Case 3BL-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed Gravity Injection | 34-125 |
| 34-149 | Case 3BL-2: In-Vessel Hydrogen Generation DVI Line Break with Failed Gravity Injection..... | 34-126 |
| 34-150 | Case 3BL-2: Mass Fraction of CsI Released to Containment DVI Line Break with Failed Gravity Injection | 34-126 |
| 34-151 | Case 3BL-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-152 | Case 3BL-2: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-153 | Case 3BL-2: Mass Fraction of SrO Released to Environment DVI Line Break with Failed Gravity Injection | 34-128 |
| 34-154 | Case 3BR-1: Reactor Coolant System and Steam Generator Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-128 |
| 34-155 | Case 3BR-1: ADS Stage 4 Flow Rates CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-156 | Case 3BR-1: Accumulator/CMT Water Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-157 | Case 3BR-1: IRWST Injection Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-130 |
| 34-158 | Case 3BR-1: Break Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-130 |
| 34-159 | Case 3BR-1: Reactor Vessel Water Level CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-160 | Case 3BR-1: Core Temperatures CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |
| 34-161 | Case 3BR-1: Containment Water Pool Elevations CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-132 |
| 34-162 | Case 3BR-1: Containment Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-132 |
| 34-163 | Case 3BR-1: Containment Gas Temperature CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-133 |
| 34-164 | Case 3BR-1: Core Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-133 |
| 34-165 | Case 3BR-1: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-166 | Case 3BR-1: In-Vessel Hydrogen Generation CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-167 | Case 3BR-1: Mass Fraction of CsI Released to Containment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-168 | Case 3BR-1: Mass Fraction of Noble Gases Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-169 | Case 3BR-1: Mass Fraction of Fission Products Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-136 |
| 34-170 | Case 3BR-1: Mass Fraction of SrO Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-136 |
| 34-171 | Case 3BR-1a: Reactor Coolant System and Steam Generator Pressure CL LBLOCA with Failed Accumulators..... | 34-137 |
| 34-172 | Case 3BR-1a: ADS Stage 4 Flow Rates CL LBLOCA with Failed Accumulators | 34-137 |
| 34-173 | Case 3BR-1a: Accumulator/CMT Water Mass CL LBLOCA with Failed Accumulators | 34-138 |
| 34-174 | Case 3BR-1a: IRWST Injection Flow Rate CL LBLOCA with Failed Accumulators | 34-138 |
| 34-175 | Case 3BR-1a: Break Flow Rate CL LBLOCA with Failed Accumulators..... | 34-139 |
| 34-176 | Case 3BR-1a: Reactor Vessel Water Level CL LBLOCA with Failed Accumulators | 34-139 |
| 34-177 | Case 3BR-1a: Core Temperatures CL LBLOCA with Failed Accumulators | 34-140 |
| 34-178 | Case 3BR-1a: Containment Water Pool Elevations CL LBLOCA with Failed Accumulators | 34-140 |
| 34-179 | Case 3BR-1a: Containment Pressure CL LBLOCA with Failed Accumulators | 34-141 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-180 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Failed Accumulators | 34-141 |
| 34-181 | Case 3BR-1a: Core Mass CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-182 | Case 3BR-1a: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-183 | Case 3BR-1a: In-Vessel Hydrogen Generation CL LBLOCA with Failed Accumulators | 34-143 |
| 34-184 | Case 3BR-1a: Mass Fraction of CsI Released to Containment CL LBLOCA with Failed Accumulators..... | 34-143 |
| 34-185 | Case 3BR-1a: Mass Fraction of Noble Gases Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-186 | Case 3BR-1a: Mass Fraction of Fission Products Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-187 | Case 3BR-1a: Mass Fraction of SrO Released to Environment CL LBLOCA with Failed Accumulators | 34-145 |
| 34-188 | Case 3C-1: Reactor Coolant System and Steam Generator Pressure Vessel Rupture | 34-145 |
| 34-189 | Case 3C-1: ADS Stage 4 Flow Rates Vessel Rupture | 34-146 |
| 34-190 | Case 3C-1: Accumulator/CMT Water Mass Vessel Rupture | 34-146 |
| 34-191 | Case 3C-1: IRWST Injection Flow Rate Vessel Rupture..... | 34-147 |
| 34-192 | Case 3C-1: Break Flow Rate Vessel Rupture..... | 34-147 |
| 34-193 | Case 3C-1: Reactor Vessel Water Level Vessel Rupture | 34-148 |
| 34-194 | Case 3C-1: Core Temperatures Vessel Rupture | 34-148 |
| 34-195 | Case 3C-1: Containment Water Pool Elevations Vessel Rupture..... | 34-149 |
| 34-196 | Case 3C-1: Containment Pressure Vessel Rupture..... | 34-149 |
| 34-197 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 34-150 |
| 34-198 | Case 3C-1: Core Mass Vessel Rupture | 34-150 |
| 34-199 | Case 3C-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture | 34-151 |
| 34-200 | Case 3C-1: In-Vessel Hydrogen Generation Vessel Rupture | 34-151 |
| 34-201 | Case 3C-1: Mass Fraction of CsI Released to Containment Vessel Rupture..... | 34-152 |
| 34-202 | Case 3C-1: Mass Fraction of Noble Gas Released to Environment Vessel Rupture..... | 34-152 |
| 34-203 | Case 3C-1: Mass Fraction of Fission Products Released to Environment Vessel Rupture | 34-153 |
| 34-204 | Case 3C-1: Mass Fraction of SrO Released to Environment Vessel Rupture | 34-153 |
| 34-205 | Case 3C-2: Reactor Coolant System and Steam Generator Pressure Vessel Rupture with Containment Failure | 34-154 |
| 34-206 | Case 3C-2: ADS Stage 4 Flow Rates Vessel Rupture with Containment Failure | 34-154 |
| 34-207 | Case 3C-2: Accumulator/CMT Water Mass Vessel Rupture with Containment Failure..... | 34-155 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-208 | Case 3C-2: IRWST Injection Flow Rate Vessel Rupture with Containment Failure..... | 34-155 |
| 34-209 | Case 3C-2: Break Flow Rate Vessel Rupture with Containment Failure | 34-156 |
| 34-210 | Case 3C-2: Reactor Vessel Water Level Vessel Rupture with Containment Failure..... | 34-156 |
| 34-211 | Case 3C-2: Core Temperatures Vessel Rupture with Containment Failure..... | 34-157 |
| 34-212 | Case 3C-2: Containment Water Pool Elevations Vessel Rupture with Containment Failure..... | 34-157 |
| 34-213 | Case 3C-2: Containment Pressure Vessel Rupture with Containment Failure | 34-158 |
| 34-214 | Case 3C-2: Containment Gas Temperature Vessel Rupture with Containment Failure..... | 34-158 |
| 34-215 | Case 3C-2: Core Mass Vessel Rupture with Containment Failure..... | 34-159 |
| 34-216 | Case 3C-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture with Containment Failure..... | 34-159 |
| 34-217 | Case 3C-2: In-Vessel Hydrogen Generation Vessel Rupture with Containment Failure..... | 34-160 |
| 34-218 | Case 3C-2: Mass Fraction of CsI Released to Containment Vessel Rupture with Containment Failure | 34-160 |
| 34-219 | Case 3C-2: Mass Fraction of Noble Gases Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-220 | Case 3C-2: Mass Fraction of Fission Products Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-221 | Case 3C-2: Mass Fraction of SrO Released to Environment Vessel Rupture with Containment Failure | 34-162 |
| 34-222 | Case 3D-1: Reactor Coolant System and Steam Generator Pressure Spurious ADS-4 with Failed CMTs | 34-162 |
| 34-223 | Case 3D-1: ADS Stage 4 Flow Rates Spurious ADS-4 with Failed CMTs..... | 34-163 |
| 34-224 | Case 3D-1: Accumulator/CMT Water Mass Spurious ADS-4 with Failed CMTs | 34-163 |
| 34-225 | Case 3D-1: IRWST Injection Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-226 | Case 3D-1: Break Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-227 | Case 3D-1: Reactor Vessel Water Level Spurious ADS-4 with Failed CMTs | 34-165 |
| 34-228 | Case 3D-1: Core Temperatures Spurious ADS-4 with Failed CMTs..... | 34-165 |
| 34-229 | Case 3D-1: Containment Water Pool Elevations Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-230 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-231 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs | 34-167 |
| 34-232 | Case 3D-1: Core Mass Spurious ADS-4 with Failed CMTs | 34-167 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-233 | Case 3D-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-4 with Failed CMTs | 34-168 |
| 34-234 | Case 3D-1: In-Vessel Hydrogen Generation Spurious ADS-4 with Failed CMTs | 34-168 |
| 34-235 | Case 3D-1: Mass Fraction of CsI Released to Containment Spurious ADS-4 with Failed CMTs | 34-169 |
| 34-236 | Case 3D-1: Mass Fraction of Noble Gases Released to Environment Spurious ADS-4 with Failed CMTs | 34-169 |
| 34-237 | Case 3D-1: Mass Fraction of Fission Products Released to Environment Spurious ADS-4 with Failed CMTs | 34-170 |
| 34-238 | Case 3D-1: Mass Fraction of SrO Released to Environment Spurious ADS-4 with Failed CMTs | 34-170 |
| 34-239 | Case 3D-2: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2 with Failed CMTs | 34-171 |
| 34-240 | Case 3D-2: ADS Stage 4 Flow Rates Spurious ADS-2 with Failed CMTs..... | 34-171 |
| 34-241 | Case 3D-2: Accumulator/CMT Water Mass Spurious ADS-2 with Failed CMTs | 34-172 |
| 34-242 | Case 3D-2: IRWST Injection Flow Rate Spurious ADS-2 with Failed CMTs..... | 34-172 |
| 34-243 | Case 3D-2: Break Flow Rate Spurious ADS-2 with Failed CMTs | 34-173 |
| 34-244 | Case 3D-2: Reactor Vessel Water Level Spurious ADS-2 with Failed CMTs..... | 34-173 |
| 34-245 | Case 3D-2: Core Temperatures Spurious ADS-2 with Failed CMTs..... | 34-174 |
| 34-246 | Case 3D-2: Containment Pool Water Elevations Spurious ADS-2 with Failed CMTs | 34-174 |
| 34-247 | Case 3D-2: Containment Pressure Spurious ADS-2 with Failed CMTs | 34-175 |
| 34-248 | Case 3D-2: Containment Gas Temperature Spurious ADS-2 with Failed CMTs | 34-175 |
| 34-249 | Case 3D-2: Core Mass Spurious ADS-2 with Failed CMTs | 34-176 |
| 34-250 | Case 3D-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2 with Failed CMTs..... | 34-176 |
| 34-251 | Case 3D-2: In-Vessel Hydrogen Generation Spurious ADS-2 with Failed CMTs | 34-177 |
| 34-252 | Case 3D-2: Mass Fraction of CsI Released to Containment Spurious ADS-2 with Failed CMTs | 34-177 |
| 34-253 | Case 3D-2: Mass Fraction of Noble Gas Released to Environment Spurious ADS-2 with Failed CMTs..... | 34-178 |
| 34-254 | Case 3D-2: Mass Fraction of Fission Products Released to Environment Spurious ADS-2 with Failed CMTs..... | 34-178 |
| 34-255 | Case 3D-2: Mass Fraction of SrO Released to Environment Spurious ADS-2 with Failed CMTs | 34-179 |
| 34-256 | Case 3D-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed ADS..... | 34-179 |
| 34-257 | Case 3D-3: ADS Stage 4 Flow Rates DVI Line Break with Failed ADS..... | 34-180 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-258 | Case 3D-3: Accumulator/CMT Water Mass DVI Line Break with Failed ADS..... | 34-180 |
| 34-259 | Case 3D-3: IRWST Injection Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-260 | Case 3D-3: Break Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-261 | Case 3D-3: Reactor Vessel Water Level DVI Line Break with Failed ADS..... | 34-182 |
| 34-262 | Case 3D-3: Core Temperatures DVI Line Break with Failed ADS..... | 34-182 |
| 34-263 | Case 3D-3: Containment Water Pool Elevations DVI Line Break with Failed ADS..... | 34-183 |
| 34-264 | Case 3D-3: Containment Pressure DVI Line Break with Failed ADS | 34-183 |
| 34-265 | Case 3D-3: Containment Gas Temperature DVI Line Break with Failed ADS | 34-184 |
| 34-266 | Case 3D-3: Core Mass DVI Line Break with Failed ADS | 34-184 |
| 34-267 | Case 3D-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed ADS | 34-185 |
| 34-268 | Case 3D-3: In-Vessel Hydrogen Generation DVI Line Break with Failed ADS..... | 34-185 |
| 34-269 | Case 3D-3: Mass Fraction of CsI Released to Containment DVI Line Break with Failed ADS | 34-186 |
| 34-270 | Case 3D-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed ADS..... | 34-186 |
| 34-271 | Case 3D-3: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed ADS | 34-187 |
| 34-272 | Case 3D-3: Mass Fraction of SrO Released to Environment DVI Line Break with Failed ADS | 34-187 |
| 34-273 | Case 3D-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-274 | Case 3D-4: ADS Stage 4 Flow Rates Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-275 | Case 3D-4: Accumulator/CMT Water Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-276 | Case 3D-4: IRWST Injection Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-277 | Case 3D-4: Break Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame..... | 34-190 |
| 34-278 | Case 3D-4: Reactor Vessel Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-190 |
| 34-279 | Case 3D-4: Core Temperatures Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-280 | Case 3D-4: Containment Water Pool Elevations Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-281 | Case 3D-4: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-282 | Case 3D-4: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |
| 34-283 | Case 3D-4: Core Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-284 | Case 3D-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-285 | Case 3D-4: In-Vessel Hydrogen Generation Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-286 | Case 3D-4: Mass Fraction of CsI Released to Containment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-287 | Case 3D-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-288 | Case 3D-4: Mass Fraction of Fission Products Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-289 | Case 3D-4: Mass Fraction of SrO Release to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-196 |
| 34-290 | Case 6E-1: Reactor Coolant System and Steam Generator Pressure SGTR Early Core Melt..... | 34-196 |
| 34-291 | Case 6E-1: ADS Stage 4 Flow Rates SGTR Early Core Melt..... | 34-197 |
| 34-292 | Case 6E-1: Accumulator/CMT Water Mass SGTR Early Core Melt..... | 34-197 |
| 34-293 | Case 6E-1: IRWST Injection Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-294 | Case 6E-1: Break Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-295 | Case 6E-1: Reactor Vessel Water Level SGTR Early Core Melt..... | 34-199 |
| 34-296 | Case 6E-1: Core Temperatures SGTR Early Core Melt..... | 34-199 |
| 34-297 | Case 6E-1: Containment Water Pool Elevations SGTR Early Core Melt | 34-200 |
| 34-298 | Case 6E-1: Containment Pressure SGTR Early Core Melt | 34-200 |
| 34-299 | Case 6E-1: Containment Gas Temperature SGTR Early Core Melt..... | 34-201 |
| 34-300 | Case 6E-1: Core Mass SGTR Early Core Melt | 34-201 |
| 34-301 | Case 6E-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Early Core Melt..... | 34-202 |
| 34-302 | Case 6E-1: In-Vessel Hydrogen Generation SGTR Early Core Melt..... | 34-202 |
| 34-303 | Case 6E-1: Mass Fraction of CsI Released to Containment SGTR Early Core Melt | 34-203 |
| 34-304 | Case 6E-1: Mass Fraction of Noble Gases Released to Environment SGTR Early Core Melt..... | 34-203 |
| 34-305 | Case 6E-1: Mass Fraction of Fission Products Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-306 | Case 6E-1: Mass Fraction of SrO Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-307 | Case 6L-1: Reactor Coolant System and Steam Generator Pressure SGTR Core Melt Failure at Recirculation..... | 34-205 |
| 34-308 | Case 6L-1: ADS Stage 4 Flow Rates SGTR Core Melt Failure at Recirculation | 34-205 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-309 | Case 6L-1: Accumulator/CMT Water Mass SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-310 | Case 6L-1: IRWST Injection Flow Rate SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-311 | Case 6L-1: Break Flow Rate SGTR Core Melt Failure at Recirculation..... | 34-207 |
| 34-312 | Case 6L-1: Reactor Vessel Water Level SGTR Core Melt Failure at Recirculation | 34-207 |
| 34-313 | Case 6L-1: Core Temperatures SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-314 | Case 6L-1: Containment Water Pool Elevations SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-315 | Case 6L-1: Containment Pressure SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-316 | Case 6L-1: Containment Gas Temperature SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-317 | Case 6L-1: Core Mass SGTR Core Melt Failure at Recirculation..... | 34-210 |
| 34-318 | Case 6L-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Core Melt Failure at Recirculation..... | 34-210 |
| 34-319 | Case 6L-1: In-Vessel Hydrogen Generation SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-320 | Case 6L-1: Mass Fraction of CsI Released to Containment SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-321 | Case 6L-1: Mass Fraction of Noble Gases Released to Environment SGTR Core Melt Failure at Recirculation..... | 34-212 |
| 34-322 | Case 6L-1: Mass Fraction of Fission Products Released to Environment SGTR Core Melt Failure at Recirculation..... | 34-212 |
| 34-323 | Case 6L-1: Mass Fraction of SrO Released to Environment SGTR Core Melt Failure at Recirculation | 34-213 |
| 34-324 | Case 1AP-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-213 |
| 34-325 | Case 1AP-1: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed..... | 34-214 |
| 34-326 | Case 1AP-1: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-214 |
| 34-327 | Case 1AP-1: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-215 |
| 34-328 | Case 1AP-1: Break Flow Rate SBLOCA with PRHR, CMTs Failed..... | 34-215 |
| 34-329 | Case 1AP-1: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-216 |
| 34-330 | Case 1AP-1: Core Temperatures SBLOCA with PRHR, CMTs Failed..... | 34-216 |
| 34-331 | Case 1AP-1: Containment Pool Water Elevations SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-332 | Case 1AP-1: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-333 | Case 1AP-1: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-334 | Case 1AP-1: Core Mass SBLOCA with PRHR, CMTs Failed | 34-218 |
| 34-335 | Case 1AP-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-336 | Case 1AP-1: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-337 | Case 1AP-1: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-338 | Case 1AP-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-339 | Case 1AP-1: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-340 | Case 1AP-1: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-341 | Case 1AP-2: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-342 | Case 1AP-2: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-343 | Case 1AP-2: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-344 | Case 1AP-2: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-345 | Case 1AP-2: Break Flow Rate SBLOCA with PRHR, CMTs Failed..... | 34-224 |
| 34-346 | Case 1AP-2: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-224 |
| 34-347 | Case 1AP-2: Core Temperatures SBLOCA with PRHR, CMTs Failed..... | 34-225 |
| 34-348 | Case 1AP-2: Containment Water Pool Elevations SBLOCA with PRHR, CMTs Failed | 34-225 |
| 34-349 | Case 1AP-2: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-350 | Case 1AP-2: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-351 | Case 1AP-2: Core Mass SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-352 | Case 1AP-2: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-353 | Case 1AP-2: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-228 |
| 34-354 | Case 1AP-2: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed..... | 34-228 |
| 34-355 | Case 1AP-2: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-356 | Case 1AP-2: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-357 | Case 1AP-2: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed..... | 34-230 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-358 | Case 1A-1: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes | 34-230 |
| 34-359 | Case 1A-1: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-231 |
| 34-360 | Case 1A-1: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-231 |
| 34-361 | Case 1A-1: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-362 | Case 1A-1: Break Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-363 | Case 1A-1: Reactor Vessel Water Level Transient with Creep of SG Tubes..... | 34-233 |
| 34-364 | Case 1A-1: Core Temperatures Transient with Creep of SG Tubes..... | 34-233 |
| 34-365 | Case 1A-1: Containment Pool Water Elevations Transient with Creep of SG Tubes..... | 34-234 |
| 34-366 | Case 1A-1: Containment Pressure Transient with Creep of SG Tubes | 34-234 |
| 34-367 | Case 1A-1: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-235 |
| 34-368 | Case 1A-1: Core Mass Transient with Creep of SG Tubes | 34-235 |
| 34-369 | Case 1A-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes | 34-236 |
| 34-370 | Case 1A-1: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-236 |
| 34-371 | Case 1A-1: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-237 |
| 34-372 | Case 1A-1: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes..... | 34-237 |
| 34-373 | Case 1A-1: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes..... | 34-238 |
| 34-374 | Case 1A-1: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-238 |
| 34-375 | Case 1A-2: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes..... | 34-239 |
| 34-376 | Case 1A-2: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-239 |
| 34-377 | Case 1A-2: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-240 |
| 34-378 | Case 1A-2: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-240 |
| 34-379 | Case 1A-2: Break Flow Rate Transient with Creep of SG Tubes | 34-241 |
| 34-380 | Case 1A-2: Reactor Vessel Water Level Transient with Creep of SG Tubes..... | 34-241 |
| 34-381 | Case 1A-2: Core Temperatures Transient with Creep of SG Tubes..... | 34-242 |
| 34-382 | Case 1A-2: Containment Water Pool Elevations Transient with Creep of SG Tubes | 34-242 |
| 34-383 | Case 1A-2: Containment Pressure Transient with Creep of SG Tubes | 34-243 |
| 34-384 | Case 1A-2: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-243 |
| 34-385 | Case 1A-2: Core Mass Transient with Creep of SG Tubes | 34-244 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-386 | Case 1A-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes..... | 34-244 |
| 34-387 | Case 1A-2: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-245 |
| 34-388 | Case 1A-2: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-245 |
| 34-389 | Case 1A-2: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes..... | 34-246 |
| 34-390 | Case 1A-2: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes..... | 34-246 |
| 34-391 | Case 1A-2: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-247 |
| 34-392 | Case 3BE-1: Containment Pressure DDT Intermediate Containment Failure..... | 34-247 |
| 34-393 | Case 3BE-1: Containment Gas Temperature DDT Intermediate Containment Failure..... | 34-248 |
| 34-394 | Case 3BE-1: Containment Hydrogen Concentration DDT Intermediate Containment Failure..... | 34-248 |
| 34-395 | Case 3BE-1: Noble Gases Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-396 | Case 3BE-1: CsI and RbI Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-397 | Case 3BE-1: Te ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-250 |
| 34-398 | Case 3BE-1: SrO Release Fraction DDT Intermediate Containment Failure..... | 34-250 |
| 34-399 | Case 3BE-1: MoO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-400 | Case 3BE-1: CsOH and RbOH Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-401 | Case 3BE-1: BaO Release Fraction DDT Intermediate Containment Failure..... | 34-252 |
| 34-402 | Case 3BE-1: La ₂ O ₃ Release Fraction DDT Intermediate Containment Failure..... | 34-252 |
| 34-403 | Case 3BE-1: CeO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-253 |
| 34-404 | Case 3BE-1: Sb Release Fraction DDT Intermediate Containment Failure..... | 34-253 |
| 34-405 | Case 3BE-1: Te ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-254 |
| 34-406 | Case 3BE-1: UO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-254 |
| 34-407 | Case 3BE-1: RCS Pressure No PCS Water Cooling and Late Containment Failure..... | 34-255 |
| 34-408 | Case 3BE-1: Reactor Vessel Mixture Level No PCS Water Cooling and Late Containment Failure..... | 34-255 |
| 34-409 | Case 3BE-1: Core-Exit Temperature No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-410 | Case 3BE-1: In-Vessel Hydrogen Generation No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-411 | Case 3BE-1: Containment Pressure No PCS Water Cooling and Late Containment Failure..... | 34-257 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-412 | Case 3BE-1: Containment Gas Temperature No PCS Water Cooling and Late Containment Failure..... | 34-257 |
| 34-413 | Case 3BE-1: Containment Hydrogen Concentration No PCS Water Cooling and Late Containment Failure..... | 34-258 |
| 34-414 | Case 3BE-1: Noble Gas Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-258 |
| 34-415 | Case 3BE-1: CsI and RbI Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-416 | Case 3BE-1: TeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-417 | Case 3BE-1: SrO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-418 | Case 3BE-1: MoO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-419 | Case 3BE-1: CsOH and RbOH Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-420 | Case 3BE-1: BaO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-421 | Case 3BE-1: La ₂ O ₃ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-422 | Case 3BE-1: CeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-423 | Case 3BE-1: Sb Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-263 |
| 34-424 | Case 3BE-1: Te ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-263 |
| 34-425 | Case 3BE-1: UO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-264 |
| 35-1 | Containment Event Tree..... | 35-29 |
| 36-1 | AP1000 Accident Class 1A Base Case for Node DP Success – RCS Pressure..... | 36-7 |
| 36-2 | AP1000 Accident Class 1A Base Case for Node DP Success – Core-Exit Gas Temperature..... | 36-8 |
| 36-3 | AP1000 Accident Class 1A Base Case for Node DP Success – Steam Generator Tube Creep Damage..... | 36-9 |
| 36-4 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Passive RHR Heat Removal..... | 36-10 |
| 36-5 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core Makeup Tank Flow (one tank)..... | 36-11 |
| 36-6 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Reactor Coolant System Pressure..... | 36-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 36-7 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core-Exit Gas Temperature..... | 36-13 |
| 39-1 | AP1000 Base Case In-Vessel Retention of Molten Core Debris..... | 39-23 |
| 39-2 | AP1000 Core Shroud | 39-24 |
| 39-3 | Comparison of ULPU-2000 Configuration III and ULPU-2000 Configuration IV..... | 39-25 |
| 39-4 | Effect of Water Level on Water Circulation During IVR..... | 39-26 |
| 39-5 | ULPU-2000 Configuration IV Results (Reference 39-4)..... | 39-27 |
| 39-6 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Zirconium Oxidation Fraction Input Probability Distribution..... | 39-28 |
| 39-7 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Mass of Steel in Debris Input Probability Distribution..... | 39-29 |
| 39-8 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Time of Final Bounding State Input Probability Distribution..... | 39-30 |
| 39-9 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Oxide Layer..... | 39-31 |
| 39-10 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Metal Layer | 39-32 |
| 39-11 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Power Density in Oxide Debris..... | 39-33 |
| 39-12 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Internal Rayleigh Number in the Oxide Layer..... | 39-34 |
| 39-13 | AP1000 In-Vessel Retention of Molten Core Debris Quantification External Rayleigh Number in the Metal Layer..... | 39-35 |
| 39-14 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Normalized Heat Fluxes..... | 39-36 |
| 39-15 | AP1000 Passive Core Cooling System..... | 39-37 |
| 39-16 | Containment Floodable Region..... | 39-38 |
| 39-17 | Containment Floodable Region – Exploded View..... | 39-39 |
| 39-18 | AP1000 Cavity Flooding Rate | 39-40 |
| 39-19 | Schematic of the AP1000 Reactor Vessel, Vessel Cavity, Vessel Insulation, and Vents | 39-41 |
| 39A-1 | AP1000 Reactor Pressure Vessel, Core and Lower Internals..... | 39A-21 |
| 39A-2 | Core Shroud | 39A-22 |
| 39A-3 | Bottom of Core Shroud, Core Barrel, and Lower Core Support Plate (Not to Scale) | 39A-23 |
| 39A-4 | Axial Power Shapes Used for Core Relocation Analysis | 39A-24 |
| 39A-5 | Radial Power Shape Used for Core Relocation Analysis | 39A-25 |
| 39A-6 | Cross Section Geometry of Finite Difference Computational Model..... | 39A-26 |
| 39A-7 | Computational Mesh for Finite Difference Computational Model..... | 39A-27 |
| 39A-8 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Reactor – Coolant System Pressure..... | 39A-28 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 39A-9 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Containment and Reactor Coolant System Pressure..... | 39A-28 |
| 39A-10 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-29 |
| 39A-11 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Hottest Temperature in Core | 39A-29 |
| 39A-12 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Hydrogen Generated in Core | 39A-30 |
| 39A-13 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.7 – 2.0 m)..... | 39A-30 |
| 39A-14 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 2.0 – 2.3 m)..... | 39A-31 |
| 39A-15 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Core Shroud/Barrel..... | 39A-31 |
| 39A-16 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Volume of Debris in Reactor Vessel Lower Plenum..... | 39A-32 |
| 39A-17 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Coolant System Pressure | 39A-32 |
| 39A-18 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Containment and Reactor Coolant System Pressure | 39A-33 |
| 39A-19 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-33 |
| 39A-20 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Hottest Temperature in Core | 39A-34 |
| 39A-21 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Hydrogen Generated in Core | 39A-34 |
| 39A-22 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.1 – 1.4 m)..... | 39A-35 |
| 39A-23 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.4 – 1.7 m)..... | 39A-35 |
| 39A-24 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Core Shroud/Barrel | 39A-36 |
| 39A-25 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Volume of Debris in Reactor Vessel Lower Plenum | 39A-36 |
| 39A-26 | Initial Oxide Relocation to Lower Plenum..... | 39A-37 |
| 39A-27 | Finite Difference Result for Top-Skewed Power Shape at Level 5 | 39A-38 |
| 39A-28 | Finite Difference Temperature Map Level 5 at 5380 Seconds for Top-Skewed Power Shape Case..... | 39A-38 |
| 39A-29 | MAAP4 Core Temperature Profile for Top-Skewed Power Shape Core Elevation = 2.0 – 2.3 m Above Bottom of Active Fuel (Core Axial Row 12) | 39A-39 |
| 39A-30 | Relocation of Corium..... | 39A-39 |
| 39A-31 | Model for Relocation to Lower Plenum | 39A-40 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 40-1 | AP1000 Passive Containment Cooling System..... | 40-7 |
| 40-2 | Schematic of Passive Containment Cooling System Piping..... | 40-8 |
| 40-3 | AP1000 Containment Venting Pressure Response..... | 40-9 |
| 40-4 | AP1000 Containment Venting Loss of Containment Air..... | 40-10 |
| 40-5 | AP1000 Dry PCS Containment Pressure Response..... | 40-11 |
| 40-6 | AP1000 Dry PCS Containment Temperature Response..... | 40-12 |
| 41-1 | IRWST Hydrogen Venting..... | 41-36 |
| 41-2 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Success..... | 41-37 |
| 41-3 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Failure..... | 41-38 |
| 41-4 | Accident Class 3BL Early Detonation Decomposition Event Tree..... | 41-39 |
| 41-5 | Accident Class 3C/3BR Early Detonation Decomposition Event Tree..... | 41-40 |
| 41-6 | Accident Class 3D/1D Early Detonation Decomposition Event Tree..... | 41-41 |
| 41-7 | Accident Class AP Early Detonation Decomposition Event Tree..... | 41-42 |
| 41-8 | Boil-Off Hydrogen Generation Probability Density Function..... | 41-43 |
| 41-9 | No Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-44 |
| 41-10 | No-Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-45 |
| 41-11 | Early Reflood Hydrogen Generation Probability Density Function..... | 41-46 |
| 41-12 | Early Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-47 |
| 41-13 | Early Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-48 |
| 41-14 | Late Reflood Hydrogen Generation Probability Density Function..... | 41-49 |
| 41-15 | Late Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-50 |
| 41-16 | Late Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-51 |
| 41-17 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Success..... | 41-52 |
| 41-18 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Failure..... | 41-53 |
| 41-19 | Accident Class 3BL Intermediate Detonation Decomposition Event Tree..... | 41-54 |
| 41-20 | Accident Class 3C/3BR Intermediate Detonation Decomposition Event Tree..... | 41-55 |
| 41-21 | Accident Class 3D/1D Intermediate Detonation Decomposition Event Tree..... | 41-56 |
| 41-22 | Accident Class 1AP Intermediate Detonation Decomposition Event Tree..... | 41-57 |
| 41A-1 | Case 3BE-1: Reactor Coolant System Pressure DVI Line Break for Containment Water Level..... | 41A-41 |
| 41A-2 | Case 3BE-1: Core-Exit Gas Temperature DVI Line Break for Containment Water Level..... | 41A-41 |
| 41A-3 | Case 3BE-1: Reactor Vessel Mixture Level DVI Line Break for Containment Water Level..... | 41A-42 |
| 41A-4 | Case 3BE-1: Hydrogen Generated In-Vessel DVI Line Break for Containment Water Level..... | 41A-42 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-5 | Case 3BE-1: Containment Pressure DVI Line Break for Containment Water Level..... | 41A-43 |
| 41A-6 | Case 3BE-1: Containment Gas Temperature DVI Line Break for Containment Water Level | 41A-43 |
| 41A-7 | Case 3BE-1: Containment Compartments Water Level DVI Line Break for Containment Water Level | 41A-44 |
| 41A-8 | Case 3BE-1: Well-Mixed Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-44 |
| 41A-9 | Case 3BE-1: Well-Mixed Compartment Steam Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-10 | Case 3BE-1: Well-Mixed Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-11 | Case 3BE-1: Confined Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-46 |
| 41A-12 | Case 3BE-1: Confined Compartment Steam Concentration DVI Line Break for Containment Water Level..... | 41A-46 |
| 41A-13 | Case 3BE-1: Confined Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-47 |
| 41A-14 | Case 3BE-1: Equivalence Ratio in SG Room DVI Line Break for Containment Water Level | 41A-47 |
| 41A-15 | Case 3BE-1: Equivalence Ratio in CMT Room DVI Line Break for Containment Water Level | 41A-48 |
| 41A-16 | Case 3BE-1: Equivalence Ratio in IRWST DVI Line Break for Containment Water Level | 41A-48 |
| 41A-17 | Case 3BE-1: Equivalence Ratio in PXS DVI Line Break for Containment Water Level..... | 41A-49 |
| 41A-18 | Case 3BE-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-49 |
| 41A-19 | Case 3BE-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-20 | Case 3BE-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-21 | Case 3BE-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-22 | Case 3BE-2: Containment Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-23 | Case 3BE-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-24 | Case 3BE-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-25 | Case 3BE-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-53 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-26 | Case 3BE-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-53 |
| 41A-27 | Case 3BE-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-28 | Case 3BE-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-29 | Case 3BE-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-30 | Case 3BE-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-31 | Case 3BE-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-32 | Case 3BE-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-33 | Case 3BE-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-34 | Case 3BE-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-35 | Case 3BE-4: Reactor Coolant System Pressure Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-36 | Case 3BE-4: Core-Exit Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-37 | Case 3BE-4: Reactor Vessel Mixture Level Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-38 | Case 3BE-4: Hydrogen Generated In-Vessel Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-39 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection..... | 41A-60 |
| 41A-40 | Case 3BE-4: Containment Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-60 |
| 41A-41 | Case 3BE-4: Containment Compartments Water Level Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-42 | Case 3BE-4: Well-Mixed Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-43 | Case 3BE-4: Well-Mixed Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-44 | Case 3BE-4: Well-Mixed Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-45 | Case 3BE-4: Confined Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-46 | Case 3BE-4: Confined Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-47 | Case 3BE-4: Confined Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-64 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-48 | Case 3BE-4: Equivalence Ratio in SG Room Spurious ADS, Failed Gravity Injection | 41A-64 |
| 41A-49 | Case 3BE-4: Equivalence Ratio in CMT Room Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-50 | Case 3BE-4: Equivalence Ratio in IRWST Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-51 | Case 3BE-4: Equivalence Ratio in PXS Spurious ADS, Failed Gravity Injection | 41A-66 |
| 41A-52 | Case 3BE-5: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-66 |
| 41A-53 | Case 3BE-5: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-54 | Case 3BE-5: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-55 | Case 3BE-5: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-56 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-57 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-69 |
| 41A-58 | Case 3BE-5: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-69 |
| 41A-59 | Case 3BE-5: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-60 | Case 3BE-5: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-61 | Case 3BE-5: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-62 | Case 3BE-5: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-63 | Case 3BE-5: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-64 | Case 3BE-5: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-65 | Case 3BE-5: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-66 | Case 3BE-5: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-67 | Case 3BE-5: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-68 | Case 3BE-5: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-69 | Case 3BE-6: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-75 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-70 | Case 3BE-6: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-75 |
| 41A-71 | Case 3BE-6: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-72 | Case 3BE-6: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-73 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-74 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-75 | Case 3BE-6: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-76 | Case 3BE-6: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-77 | Case 3BE-6: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-78 | Case 3BE-6: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-79 | Case 3BE-6: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-80 | Case 3BE-6: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-81 | Case 3BE-6: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-81 |
| 41A-82 | Case 3BE-6: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-81 |
| 41A-83 | Case 3BE-6: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-84 | Case 3BE-6: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-85 | Case 3BE-6: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-83 |
| 41A-86 | Case 3BE-8: Reactor Coolant System Pressure SGTR..... | 41A-83 |
| 41A-87 | Case 3BE-8: Core-Exit Gas Temperature SGTR | 41A-84 |
| 41A-88 | Case 3BE-8: Reactor Vessel Mixture Level SGTR..... | 41A-84 |
| 41A-89 | Case 3BE-8: Hydrogen Generated In-Vessel SGTR | 41A-85 |
| 41A-90 | Case 3BE-8: Containment Pressure SGTR | 41A-85 |
| 41A-91 | Case 3BE-8: Containment Gas Temperature SGTR | 41A-86 |
| 41A-92 | Case 3BE-8: Containment Compartments Water Level SGTR..... | 41A-86 |
| 41A-93 | Case 3BE-8: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-87 |
| 41A-94 | Case 3BE-8: Well-Mixed Compartment Steam Concentration SGTR..... | 41A-87 |
| 41A-95 | Case 3BE-8: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-88 |
| 41A-96 | Case 3BE-8: Confined Compartment Hydrogen Concentration SGTR..... | 41A-88 |
| 41A-97 | Case 3BE-8: Confined Compartment Steam Concentration SGTR..... | 41A-89 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-98 | Case 3BE-8: Confined Compartment Oxygen Concentration SGTR..... | 41A-89 |
| 41A-99 | Case 3BE-8: Equivalence Ratio in SG Room SGTR | 41A-90 |
| 41A-100 | Case 3BE-8: Equivalence Ratio in CMT Room SGTR..... | 41A-90 |
| 41A-101 | Case 3BE-8: Equivalence Ratio in IRWST SGTR..... | 41A-91 |
| 41A-102 | Case 3BE-8: Equivalence Ratio in PXS SGTR..... | 41A-91 |
| 41A-103 | Case 3BE-9: Reactor Coolant System Pressure SGTR..... | 41A-92 |
| 41A-104 | Case 3BE-9: Core-Exit Gas Temperature SGTR | 41A-92 |
| 41A-105 | Case 3BE-9: Reactor Vessel Mixture Level SGTR..... | 41A-93 |
| 41A-106 | Case 3BE-9: Hydrogen Generated In-Vessel SGTR | 41A-93 |
| 41A-107 | Case 3BE-9: Containment Pressure SGTR | 41A-94 |
| 41A-108 | Case 3BE-9: Containment Gas Temperature SGTR | 41A-94 |
| 41A-109 | Case 3BE-9: Containment Compartments Water Level SGTR | 41A-95 |
| 41A-110 | Case 3BE-9: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-95 |
| 41A-111 | Case 3BE-9: Well-Mixed Compartment Steam Concentration SGTR | 41A-96 |
| 41A-112 | Case 3BE-9: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-96 |
| 41A-113 | Case 3BE-9: Confined Compartment Hydrogen Concentration SGTR..... | 41A-97 |
| 41A-114 | Case 3BE-9: Confined Compartment Steam Concentration SGTR..... | 41A-97 |
| 41A-115 | Case 3BE-9: Confined Compartment Oxygen Concentration SGTR..... | 41A-98 |
| 41A-116 | Case 3BE-9: Equivalence Ratio in SG Room SGTR | 41A-98 |
| 41A-117 | Case 3BE-9: Equivalence Ratio in CMT Room SGTR..... | 41A-99 |
| 41A-118 | Case 3BE-9: Equivalence Ratio in IRWST SGTR..... | 41A-99 |
| 41A-119 | Case 3BE-9: Equivalence Ratio in PXS SGTR..... | 41A-100 |
| 41A-120 | Case 3BL-1: Reactor Coolant System Pressure SBLOCA with Failed Gravity Recirculation | 41A-100 |
| 41A-121 | Case 3BL-1: Core-Exit Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-122 | Case 3BL-1: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-123 | Case 3BL-1: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-124 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-125 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-126 | Case 3BL-1: Containment Compartments Water Level SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-127 | Case 3BL-1: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-128 | Case 3BL-1: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-129 | Case 3BL-1: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-130 | Case 3BL-1: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |
| 41A-131 | Case 3BL-1: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-132 | Case 3BL-1: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-133 | Case 3BL-1: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-134 | Case 3BL-1: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-135 | Case 3BL-1: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-136 | Case 3BL-1: Equivalence Ratio in PXS SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-137 | Case 3BL-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-138 | Case 3BL-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-139 | Case 3BL-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-140 | Case 3BL-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-141 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-142 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-143 | Case 3BL-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Recirculation | 41A-112 |
| 41A-144 | Case 3BL-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-112 |
| 41A-145 | Case 3BL-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-146 | Case 3BL-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-147 | Case 3BL-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-114 |
| 41A-148 | Case 3BL-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-114 |
| 41A-149 | Case 3BL-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-115 |
| 41A-150 | Case 3BL-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Recirculation | 41A-115 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-151 | Case 3BL-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-152 | Case 3BL-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-153 | Case 3BL-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Recirculation | 41A-117 |
| 41A-154 | Case 3BR-1: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-117 |
| 41A-155 | Case 3BR-1: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-156 | Case 3BR-1: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-157 | Case 3BR-1: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-119 |
| 41A-158 | Case 3BR-1: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-119 |
| 41A-159 | Case 3BR-1: Containment Gas Temperature CL LBLOCA with Accumulator Failure | 41A-120 |
| 41A-160 | Case 3BR-1: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-120 |
| 41A-161 | Case 3BR-1: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-162 | Case 3BR-1: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-163 | Case 3BR-1: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-164 | Case 3BR-1: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-165 | Case 3BR-1: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-166 | Case 3BR-1: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-167 | Case 3BR-1: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-168 | Case 3BR-1: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-169 | Case 3BR-1: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-125 |
| 41A-170 | Case 3BR-1: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure | 41A-125 |
| 41A-171 | Case 3BR-1a: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-126 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-172 | Case 3BR-1a: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-126 |
| 41A-173 | Case 3BR-1a: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-174 | Case 3BR-1a: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-175 | Case 3BR-1a: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-128 |
| 41A-176 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-128 |
| 41A-177 | Case 3BR-1a: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-178 | Case 3BR-1a: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-179 | Case 3BR-1a: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-180 | Case 3BR-1a: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-181 | Case 3BR-1a: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-182 | Case 3BR-1a: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-183 | Case 3BR-1a: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-184 | Case 3BR-1a: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-185 | Case 3BR-1a: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-186 | Case 3BR-1a: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-187 | Case 3BR-1a: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure..... | 41A-134 |
| 41A-188 | Case 3C-1: Reactor Coolant System Pressure Vessel Rupture | 41A-134 |
| 41A-189 | Case 3C-1: Core-Exit Gas Temperature Vessel Rupture..... | 41A-135 |
| 41A-190 | Case 3C-1: Reactor Vessel Mixture Level Vessel Rupture | 41A-135 |
| 41A-191 | Case 3C-1: Hydrogen Generated In-Vessel Vessel Rupture..... | 41A-136 |
| 41A-192 | Case 3C-1: Containment Pressure Vessel Rupture..... | 41A-136 |
| 41A-193 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 41A-137 |
| 41A-194 | Case 3C-1: Containment Compartments Water Level Vessel Rupture | 41A-137 |
| 41A-195 | Case 3C-1: Well-Mixed Compartment Hydrogen Concentration Vessel Rupture..... | 41A-138 |
| 41A-196 | Case 3C-1: Well-Mixed Compartment Steam Concentration Vessel Rupture..... | 41A-138 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-197 | Case 3C-1: Well-Mixed Compartment Oxygen Concentration Vessel Rupture..... | 41A-139 |
| 41A-198 | Case 3C-1: Confined Compartment Hydrogen Concentration Vessel Rupture..... | 41A-139 |
| 41A-199 | Case 3C-1: Confined Compartment Steam Concentration Vessel Rupture..... | 41A-140 |
| 41A-200 | Case 3C-1: Confined Compartment Oxygen Concentration Vessel Rupture..... | 41A-140 |
| 41A-201 | Case 3C-1: Equivalence Ratio in SG Room Vessel Rupture..... | 41A-141 |
| 41A-202 | Case 3C-1: Equivalence Ratio in CMT Room Vessel Rupture..... | 41A-141 |
| 41A-203 | Case 3C-1: Equivalence Ratio in IRWST Vessel Rupture..... | 41A-142 |
| 41A-204 | Case 3C-1: Equivalence Ratio in PXS Vessel Rupture..... | 41A-142 |
| 41A-205 | Case 3D-1: Reactor Coolant System Pressure Spurious ADS-4 with Failed CMTs..... | 41A-143 |
| 41A-206 | Case 3D-1: Core-Exit Gas Temperature Spurious ADS-4 with Failed CMTs..... | 41A-143 |
| 41A-207 | Case 3D-1: Reactor Vessel Mixture Level Spurious ADS-4 with Failed CMTs..... | 41A-144 |
| 41A-208 | Case 3D-1: Hydrogen Generated In-Vessel Spurious ADS-4 with Failed CMTs..... | 41A-144 |
| 41A-209 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs..... | 41A-145 |
| 41A-210 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs..... | 41A-145 |
| 41A-211 | Case 3D-1: Containment Compartments Water Level Spurious ADS-4 with Failed CMTs..... | 41A-146 |
| 41A-212 | Case 3D-1: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-146 |
| 41A-213 | Case 3D-1: Well-Mixed Compartment Steam Concentration Spurious ADS-4 with Failed CMTs..... | 41A-147 |
| 41A-214 | Case 3D-1: Well-Mixed Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-147 |
| 41A-215 | Case 3D-1: Confined Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-148 |
| 41A-216 | Case 3D-1: Confined Compartment Steam Concentration Spurious ADS-4 with Failed CMTs..... | 41A-148 |
| 41A-217 | Case 3D-1: Confined Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-149 |
| 41A-218 | Case 3D-1: Equivalence Ratio in SG Room Spurious ADS-4 with Failed CMTs..... | 41A-149 |
| 41A-219 | Case 3D-1: Equivalence Ratio in CMT Room Spurious ADS-4 with Failed CMTs..... | 41A-150 |
| 41A-220 | Case 3D-1: Equivalence Ratio in IRWST Spurious ADS-4 with Failed CMTs..... | 41A-150 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-221 | Case 3D-1: Equivalence Ratio in PXS Spurious ADS-4 with Failed CMTs | 41A-151 |
| 41A-222 | Case 3D-2: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs | 41A-151 |
| 41A-223 | Case 3D-2: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-224 | Case 3D-2: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-225 | Case 3D-2: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-226 | Case 3D-2: Containment Pressure Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-227 | Case 3D-2: Containment Gas Temperature Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-228 | Case 3D-2: Containment Compartments Water Level Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-229 | Case 3D-2: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-230 | Case 3D-2: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-231 | Case 3D-2: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-232 | Case 3D-2: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-233 | Case 3D-2: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-234 | Case 3D-2: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-235 | Case 3D-2: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-236 | Case 3D-2: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-237 | Case 3D-2: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs | 41A-159 |
| 41A-238 | Case 3D-2: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs | 41A-159 |
| 41A-239 | Case 3D-3: Reactor Coolant System Pressure DVI Line Break with no ADS | 41A-160 |
| 41A-240 | Case 3D-3: Core-Exit Gas Temperature DVI Line Break with no ADS | 41A-160 |
| 41A-241 | Case 3D-3: Reactor Vessel Mixture Level DVI Line Break with no ADS | 41A-161 |
| 41A-242 | Case 3D-3: Hydrogen Generated In-Vessel DVI Line Break with no ADS | 41A-161 |
| 41A-243 | Case 3D-3: Containment Pressure DVI Line Break with no ADS | 41A-162 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-244 | Case 3D-3: Containment Gas Temperature DVI Line Break with no ADS | 41A-162 |
| 41A-245 | Case 3D-3: Containment Compartments Water Level DVI Line Break with no ADS | 41A-163 |
| 41A-246 | Case 3D-3: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with no ADS | 41A-163 |
| 41A-247 | Case 3D-3: Well-Mixed Compartment Steam Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-248 | Case 3D-3: Well-Mixed Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-249 | Case 3D-3: Confined Compartment Hydrogen Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-250 | Case 3D-3: Confined Compartment Steam Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-251 | Case 3D-3: Confined Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-166 |
| 41A-252 | Case 3D-3: Equivalence Ratio in SG Room DVI Line Break with no ADS | 41A-166 |
| 41A-253 | Case 3D-3: Equivalence Ratio in CMT Room DVI Line Break with no ADS | 41A-167 |
| 41A-254 | Case 3D-3: Equivalence Ratio in IRWST DVI Line Break with no ADS | 41A-167 |
| 41A-255 | Case 3D-3: Equivalence Ratio in PXS DVI Line Break with no ADS | 41A-168 |
| 41A-256 | Case 3D-5: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-168 |
| 41A-257 | Case 3D-5: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-258 | Case 3D-5: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-259 | Case 3D-5: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-260 | Case 3D-5: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-261 | Case 3D-5: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-262 | Case 3D-5: Containment Compartments Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-263 | Case 3D-5: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-264 | Case 3D-5: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-265 | Case 3D-5: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-266 | Case 3D-5: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |
| 41A-267 | Case 3D-5: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-268 | Case 3D-5: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-269 | Case 3D-5: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-270 | Case 3D-5: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-271 | Case 3D-5: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-272 | Case 3D-5: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-273 | Case 1A-3: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-274 | Case 1A-3: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-275 | Case 1A-3: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-276 | Case 1A-3: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-277 | Case 1A-3: Containment Pressure FW Failure with Creep of SG Tubes | 41A-179 |
| 41A-278 | Case 1A-3: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-179 |
| 41A-279 | Case 1A-3: Containment Compartments Water Level FW Failure with Creep of SG Tubes..... | 41A-180 |
| 41A-280 | Case 1A-3: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-180 |
| 41A-281 | Case 1A-3: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-282 | Case 1A-3: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-283 | Case 1A-3: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-284 | Case 1A-3: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-285 | Case 1A-3: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-286 | Case 1A-3: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-287 | Case 1A-3: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-184 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-288 | Case 1A-3: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-184 |
| 41A-289 | Case 1A-3: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-185 |
| 41A-290 | Case 1A-3a: Reactor Coolant System Pressure Transient with Creep of SG Tubes | 41A-185 |
| 41A-291 | Case 1A-3a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-292 | Case 1A-3a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-293 | Case 1A-3a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-294 | Case 1A-3a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-295 | Case 1A-3a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-296 | Case 1A-3a: Containment Compartments Water Level Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-297 | Case 1A-3a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-189 |
| 41A-298 | Case 1A-3a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-189 |
| 41A-299 | Case 1A-3a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-190 |
| 41A-300 | Case 1A-3a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-190 |
| 41A-301 | Case 1A-3a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-302 | Case 1A-3a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-303 | Case 1A-3a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes..... | 41A-192 |
| 41A-304 | Case 1A-3a: Approximate Detonation Cell Width in CMT Room Transient with Creep of SG Tubes..... | 41A-192 |
| 41A-305 | Case 1A-3a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-193 |
| 41A-306 | Case 1A-3a: Approximate Detonation Cell Width in PXS Transient with Creep of SG Tubes..... | 41A-193 |
| 41A-307 | Case 1A-4: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes | 41A-194 |
| 41A-308 | Case 1A-4: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-194 |
| 41A-309 | Case 1A-4: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-195 |
| 41A-310 | Case 1A-4: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-195 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-311 | Case 1A-4: Containment Pressure FW Failure with Creep of SG Tubes | 41A-196 |
| 41A-312 | Case 1A-4: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-196 |
| 41A-313 | Case 1A-4: Containment Compartments Water Level FW Failure with Creep of SG Tubes..... | 41A-197 |
| 41A-314 | Case 1A-4: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-197 |
| 41A-315 | Case 1A-4: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-316 | Case 1A-4: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-317 | Case 1A-4: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-318 | Case 1A-4: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-319 | Case 1A-4: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-320 | Case 1A-4: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-321 | Case 1A-4: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-201 |
| 41A-322 | Case 1A-4: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-201 |
| 41A-323 | Case 1A-4: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-202 |
| 41A-324 | Case 1A-4a: Reactor Coolant System Pressure Transient with Creep of SG Tubes..... | 41A-202 |
| 41A-325 | Case 1A-4a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-326 | Case 1A-4a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-327 | Case 1A-4a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-328 | Case 1A-4a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-329 | Case 1A-4a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-205 |
| 41A-330 | Case 1A-4a: Containment Compartments Water Level Transient with Creep of SG Tubes..... | 41A-205 |
| 41A-331 | Case 1A-4a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-332 | Case 1A-4a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-333 | Case 1A-4a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-207 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-334 | Case 1A-4a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-207 |
| 41A-335 | Case 1A-4a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-336 | Case 1A-4a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-337 | Case 1A-4a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-338 | Case 1A-4a: Equivalence Ratio in CMT Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-339 | Case 1A-4a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-340 | Case 1A-4a: Equivalence Ratio in PXS Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-341 | Case 1AP-3: Reactor Coolant System Pressure SBLOCA, Failed PRHR and CMTs | 41A-211 |
| 41A-342 | Case 1AP-3: Core-Exit Gas Temperature SBLOCA, Failed PRHR and CMTs | 41A-211 |
| 41A-343 | Case 1AP-3: Reactor Vessel Mixture Level SBLOCA, Failed PRHR and CMTs | 41A-212 |
| 41A-344 | Case 1AP-3: Hydrogen Generated In-Vessel SBLOCA, Failed PRHR and CMTs | 41A-212 |
| 41A-345 | Case 1AP-3: Containment Pressure SBLOCA, Failed PRHR and CMTs..... | 41A-213 |
| 41A-346 | Case 1AP-3: Containment Gas Temperature SBLOCA, Failed PRHR and CMTs | 41A-213 |
| 41A-347 | Case 1AP-3: Containment Compartments Water Level SBLOCA, Failed PRHR and CMTs..... | 41A-214 |
| 41A-348 | Case 1AP-3: Well-Mixed Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs | 41A-214 |
| 41A-349 | Case 1AP-3: Well-Mixed Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs | 41A-215 |
| 41A-350 | Case 1AP-3: Well-Mixed Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs | 41A-215 |
| 41A-351 | Case 1AP-3: Confined Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs | 41A-216 |
| 41A-352 | Case 1AP-3: Confined Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs | 41A-216 |
| 41A-353 | Case 1AP-3: Confined Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs | 41A-217 |
| 41A-354 | Case 1AP-3: Equivalence Ratio in SG Room SBLOCA, Failed PRHR and CMTs | 41A-217 |
| 41A-355 | Case 1AP-3: Equivalence Ratio in CMT Room SBLOCA, Failed PRHR and CMTs | 41A-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-356 | Case 1AP-3: Equivalence Ratio in IRWST SBLOCA, Failed PRHR and CMTs | 41A-218 |
| 41A-357 | Case 1AP-3: Equivalence Ratio in PXS SBLOCA, Failed PRHR and CMTs | 41A-219 |
| 41A-358 | Case 1AP-4: Reactor Coolant System Pressure SBLOCA with Failed PRHR and ADS | 41A-219 |
| 41A-359 | Case 1AP-4: Core-Exit Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-360 | Case 1AP-4: Reactor Vessel Mixture Level SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-361 | Case 1AP-4: Hydrogen Generated In-Vessel SBLOCA with Failed PRHR and ADS..... | 41A-221 |
| 41A-362 | Case 1AP-4: Containment Pressure SBLOCA with Failed PRHR and ADS | 41A-221 |
| 41A-363 | Case 1AP-4: Containment Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-222 |
| 41A-364 | Case 1AP-4: Containment Compartments Water Level SBLOCA with Failed PRHR and ADS | 41A-222 |
| 41A-365 | Case 1AP-4: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-366 | Case 1AP-4: Well-Mixed Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-367 | Case 1AP-4: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-368 | Case 1AP-4: Confined Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-369 | Case 1AP-4: Confined Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-370 | Case 1AP-4: Confined Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-371 | Case 1AP-4: Equivalence Ratio in SG Room SBLOCA with Failed PRHR and ADS..... | 41A-226 |
| 41A-372 | Case 1AP-4: Equivalence Ratio in CMT Room SBLOCA with Failed PRHR and ADS | 41A-226 |
| 41A-373 | Case 1AP-4: Equivalence Ratio in IRWST SBLOCA with Failed PRHR and ADS..... | 41A-227 |
| 41A-374 | Case 1AP-4: Equivalence Ratio in PXS SBLOCA with Failed PRHR and ADS | 41A-227 |
| 41B-1 | Case 3BR – LLOCA with Accumulator Failure Reactor Coolant System Pressure..... | 41B-3 |
| 41B-2 | Case 3BR – LLOCA with Accumulator Failure Reactor Vessel Mixture Level..... | 41B-3 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41B-3 | Case 3BR – LLOCA with Accumulator Failure Core-Exit Gas Temperature..... | 41B-4 |
| 41B-4 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Generated In-Vessel | 41B-4 |
| 41B-5 | Case 3BR – LLOCA with Accumulator Failure Containment Pressure..... | 41B-5 |
| 41B-6 | Case 3BR – LLOCA with Accumulator Failure Containment Gas Temperature | 41B-5 |
| 41B-7 | Case 3BR – LLOCA with Accumulator Failure Containment Compartment Hydrogen Concentration..... | 41B-6 |
| 41B-8 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through Break | 41B-6 |
| 41B-9 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Hydrogen Concentration..... | 41B-7 |
| 41B-10 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Oxygen Concentration..... | 41B-7 |
| 41B-11 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Steam Concentration..... | 41B-8 |
| 41B-12 | Case 3BR – LLOCA with Accumulator Failure Approximate Detonation Cell Width in Steam Generator Compartment..... | 41B-8 |
| 41B-13 | Case 3BR – LLOCA with Accumulator Failure Containment Compartments Water Level..... | 41B-9 |
| 41B-14 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through ADS to IRWST | 41B-9 |
| 41B-15 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Hydrogen Concentration..... | 41B-10 |
| 41B-16 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Oxygen Concentration | 41B-10 |
| 41B-17 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Steam Concentration..... | 41B-11 |
| 42-1 | AP1000 Containment Fragility at Containment Temperature of 400°F | 42-12 |
| 42-2 | AP1000 Containment Fragility at Containment Temperature of 331°F | 42-13 |
| 43-1 | Plant Damage State Contributions to CDF | 43-119 |
| 43-2 | Containment Event Tree – CET (Sheets 1 – 3)..... | 43-120 |
| 43-3 | 3BE CET (Sheets 1 – 3)..... | 43-123 |
| 43-4 | 3BL CET (Sheets 1 – 3)..... | 43-126 |
| 43-5 | 3BR CET (Sheets 1 – 3)..... | 43-129 |
| 43-6 | 1A CET (Sheets 1 – 3)..... | 43-132 |
| 43-7 | 1AP CET (Sheets 1 – 3)..... | 43-135 |
| 43-8 | 3A CET (Sheets 1 – 3)..... | 43-138 |
| 43-9 | 3C CET (Sheets 1 – 3) | 43-141 |
| 43-10 | 3D CET (Sheets 1 – 3)..... | 43-144 |
| 43-11 | 6 CET (Sheets 1 – 3)..... | 43-147 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 43-12 | Contribution of PDS to LRF | 43-150 |
| 43-13 | Summary of CET Quantification (Sheets 1 – 2)..... | 43-151 |
| 44-1 | MAAP4 AP1000 Containment Nodalization | 44-12 |
| 45-1 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-7 |
| 45-2 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-7 |
| 45-3 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide | 45-8 |
| 45-4 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide | 45-8 |
| 45-5 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-9 |
| 45-6 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-9 |
| 45-7 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide | 45-10 |
| 45-8 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide | 45-10 |
| 45-9 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide | 45-11 |
| 45-10 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tin | 45-11 |
| 45-11 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium | 45-12 |
| 45-12 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide..... | 45-12 |
| 45-13 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Noble Gases..... | 45-13 |
| 45-14 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Iodide..... | 45-13 |
| 45-15 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium Dioxide | 45-14 |
| 45-16 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Strontium Oxide | 45-14 |
| 45-17 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Molybdenum Dioxide..... | 45-15 |
| 45-18 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Hydroxide..... | 45-15 |
| 45-19 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Barium Oxide | 45-16 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-20 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Dilanthanum Trioxide | 45-16 |
| 45-21 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cerium Dioxide | 45-17 |
| 45-22 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tin | 45-17 |
| 45-23 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium..... | 45-18 |
| 45-24 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Uranium Dioxide..... | 45-18 |
| 45-25 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Noble Gases..... | 45-19 |
| 45-26 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Iodide..... | 45-19 |
| 45-27 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium Dioxide | 45-20 |
| 45-28 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Strontium Oxide | 45-20 |
| 45-29 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Molybdenum Dioxide..... | 45-21 |
| 45-30 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Hydroxide..... | 45-21 |
| 45-31 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Barium Oxide | 45-22 |
| 45-32 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Dilanthanum Trioxide | 45-22 |
| 45-33 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cerium Dioxide | 45-23 |
| 45-34 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tin | 45-23 |
| 45-35 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium..... | 45-24 |
| 45-36 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Uranium Dioxide..... | 45-24 |
| 45-37 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Noble Gases..... | 45-25 |
| 45-38 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Iodide..... | 45-25 |
| 45-39 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium Dioxide | 45-26 |
| 45-40 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Strontium Oxide | 45-26 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-41 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Molybdenum Dioxide..... | 45-27 |
| 45-42 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Hydroxide..... | 45-27 |
| 45-43 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Barium Oxide | 45-28 |
| 45-44 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Dilanthanum Trioxide | 45-28 |
| 45-45 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cerium Dioxide | 45-29 |
| 45-46 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tin | 45-29 |
| 45-47 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium..... | 45-30 |
| 45-48 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Uranium Dioxide | 45-30 |
| 45-49 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Noble Gases | 45-31 |
| 45-50 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Iodide | 45-31 |
| 45-51 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium Dioxide..... | 45-32 |
| 45-52 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Strontium Oxide..... | 45-32 |
| 45-53 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Molybdenum Dioxide | 45-33 |
| 45-54 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Hydroxide | 45-33 |
| 45-55 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Barium Oxide..... | 45-34 |
| 45-56 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Dilanthanum Trioxide..... | 45-34 |
| 45-57 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cerium Dioxide..... | 45-35 |
| 45-58 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tin..... | 45-35 |
| 45-59 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium | 45-36 |
| 45-60 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Uranium Dioxide | 45-36 |
| 45-61 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-62 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-37 |
| 45-63 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide | 45-38 |
| 45-64 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide | 45-38 |
| 45-65 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-39 |
| 45-66 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-39 |
| 45-67 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide | 45-40 |
| 45-68 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide | 45-40 |
| 45-69 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide | 45-41 |
| 45-70 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tin | 45-41 |
| 45-71 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium..... | 45-42 |
| 45-72 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide..... | 45-42 |
| 45-73 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Noble Gases..... | 45-43 |
| 45-74 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Iodide..... | 45-43 |
| 45-75 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium Dioxide | 45-44 |
| 45-76 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Strontium Oxide | 45-44 |
| 45-77 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Molybdenum Dioxide..... | 45-45 |
| 45-78 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Hydroxide..... | 45-45 |
| 45-79 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Barium Oxide..... | 45-46 |
| 45-80 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Dilanthanum Trioxide | 45-46 |
| 45-81 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cerium Dioxide | 45-47 |
| 45-82 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tin | 45-47 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-83 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium..... | 45-48 |
| 45-84 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Uranium Dioxide..... | 45-48 |
| 45A-1 | AP1000 Fission Product Release Fractions for Release Category CFE – Noble Gases | 45A-3 |
| 45A-2 | AP1000 Fission Product Release Fractions for Release Category CFE – CsI and RbI | 45A-3 |
| 45A-3 | AP1000 Fission Product Release Fractions for Release Category CFE – TeO ₂ | 45A-4 |
| 45A-4 | AP1000 Fission Product Release Fractions for Release Category CFE – SrO | 45A-4 |
| 45A-5 | AP1000 Fission Product Release Fractions for Release Category CFE – MoO ₂ | 45A-5 |
| 45A-6 | AP1000 Fission Product Release Fractions for Release Category CFE – CsOH and RbOH | 45A-5 |
| 45A-7 | AP1000 Fission Product Release Fractions for Release Category CFE – BaO | 45A-6 |
| 45A-8 | AP1000 Fission Product Release Fractions for Release Category CFE – La ₂ O ₃ | 45A-6 |
| 45A-9 | AP1000 Fission Product Release Fractions for Release Category CFE – CeO ₂ | 45A-7 |
| 45A-10 | AP1000 Fission Product Release Fractions for Release Category CFE – Sb | 45A-7 |
| 45A-11 | AP1000 Fission Product Release Fractions for Release Category CFE – Te ₂ | 45A-8 |
| 45A-12 | AP1000 Fission Product Release Fractions for Release Category CFE – UO ₂ | 45A-8 |
| 45A-13 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – RCS Pressure | 45A-9 |
| 45A-14 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Reactor Vessel Mixture Level..... | 45A-9 |
| 45A-15 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Core-Exit Temperature..... | 45A-10 |
| 45A-16 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – In-Vessel Hydrogen Generation | 45A-10 |
| 45A-17 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Pressure..... | 45A-11 |
| 45A-18 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Gas Temperature..... | 45A-11 |
| 45A-19 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Hydrogen Concentration..... | 45A-12 |
| 45A-20 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Noble Gases Release Fraction..... | 45A-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 45A-21 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsI and RbI Release Fraction..... | 45A-13 |
| 45A-22 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – TeO ₂ Release Fraction..... | 45A-13 |
| 45A-23 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – SrO Release Fraction..... | 45A-14 |
| 45A-24 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – MoO ₂ Release Fraction | 45A-14 |
| 45A-25 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsOH and RbOH Release Fraction..... | 45A-15 |
| 45A-26 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – BaO Release Fraction..... | 45A-15 |
| 45A-27 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – La ₂ O ₃ Release Fraction | 45A-16 |
| 45A-28 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CeO ₂ Release Fraction | 45A-16 |
| 45A-29 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Sb Release Fraction..... | 45A-17 |
| 45A-30 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Te ₂ Release Fraction..... | 45A-17 |
| 45A-31 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – UO ₂ Release Fraction..... | 45A-18 |
| 45A-32 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Containment Pressure | 45A-18 |
| 45A-33 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Noble Gases Release Fraction..... | 45A-19 |
| 45A-34 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsI and RbI Release Fraction..... | 45A-19 |
| 45A-35 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – TeO ₂ Release Fraction..... | 45A-20 |
| 45A-36 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – SrO Release Fraction | 45A-20 |
| 45A-37 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – MoO ₂ Release Fraction | 45A-21 |
| 45A-38 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsOH and RbOH Release Fraction..... | 45A-21 |
| 45A-39 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – BaO Release Fraction..... | 45A-22 |
| 45A-40 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – La ₂ O ₃ Release Fraction | 45A-22 |
| 45A-41 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CeO ₂ Release Fraction | 45A-23 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45A-42 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Sb Release Fraction..... | 45A-23 |
| 45A-43 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Te ₂ Release Fraction | 45A-24 |
| 45A-44 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – UO ₂ Release Fraction..... | 45A-24 |
| 49-1 | Population Whole Body Dose – BP Source Term, 24 Hours | 49-20 |
| 49-2 | Population Whole Body Dose – BP Source Term 72 Hours | 49-20 |
| 49-3 | Site Boundary Whole Body Dose – BP Source Term, 24 Hours..... | 49-21 |
| 49-4 | Site Boundary Whole Body Dose – BP Source Term, 72 Hours..... | 49-21 |
| 49-5 | Site Boundary Red Bone Marrow Dose – BP Source Term, 24 Hours | 49-22 |
| 49-6 | Site Boundary Red Bone Marrow Dose – BP Source Term, 72 Hours | 49-22 |
| 49-7 | Site Boundary Thyroid Dose – BP Source Term, 24 Hours..... | 49-23 |
| 49-8 | Site Boundary Thyroid Dose – BP Source Term, 72 Hours..... | 49-23 |
| 49-9 | Population Whole Body Dose – CFE Source Term, 24 Hours..... | 49-24 |
| 49-10 | Population Whole Body Dose – CFE Source Term, 72 Hours..... | 49-24 |
| 49-11 | Site Boundary Whole Body Dose – CFE Source Term, 24 Hours | 49-25 |
| 49-12 | Site Boundary Whole Body Dose – CFE Source Term, 72 Hours | 49-25 |
| 49-13 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 24 Hours..... | 49-26 |
| 49-14 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 72 Hours..... | 49-26 |
| 49-15 | Site Boundary Thyroid Dose – CFE Source Term, 24 Hours..... | 49-27 |
| 49-16 | Site Boundary Thyroid Dose – CFE Source Term, 72 Hours..... | 49-27 |
| 49-17 | Population Whole Body Dose – CFI Source Term, 24 Hours..... | 49-28 |
| 49-18 | Population Whole Body Dose – CFI Source Term, 72 Hours..... | 49-28 |
| 49-19 | Site Boundary Whole Body Dose – CFI Source Term, 24 Hours | 49-29 |
| 49-20 | Site Boundary Whole Body Dose – CFI Source Term, 72 Hours | 49-29 |
| 49-21 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 24 Hours..... | 49-30 |
| 49-22 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 72 Hours..... | 49-30 |
| 49-23 | Site Boundary Thyroid Dose – CFI Source Term, 24 Hours..... | 49-31 |
| 49-24 | Site Boundary Thyroid Dose – CFI Source Term, 72 Hours..... | 49-31 |
| 49-25 | Population Whole Body Dose – CFL Source Term, 24 Hours..... | 49-32 |
| 49-26 | Population Whole Body Dose – CFL Source Term, 72 Hours..... | 49-32 |
| 49-27 | Site Boundary Whole Body Dose – CFL Source Term, 24 Hours | 49-33 |
| 49-28 | Site Boundary Whole Body Dose – CFL Source Term, 72 Hours | 49-33 |
| 49-29 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 24 Hours..... | 49-34 |
| 49-30 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 72 Hours..... | 49-34 |
| 49-31 | Site Boundary Thyroid Dose – CFL Source Term, 24 Hours..... | 49-35 |
| 49-32 | Site Boundary Thyroid Dose – CFL Source Term, 72 Hours..... | 49-35 |
| 49-33 | Population Whole Body Dose – CI Source Term, 24 Hours | 49-36 |
| 49-34 | Population Whole Body Dose – CI Source Term, 72 Hours | 49-36 |
| 49-35 | Site Boundary Whole Body Dose – CI Source Term, 24 Hours..... | 49-37 |
| 49-36 | Site Boundary Whole Body Dose – CI Source Term, 72 Hours..... | 49-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 49-37 | Site Boundary Red Bone Marrow Dose – CI Source Term, 24 Hours | 49-38 |
| 49-38 | Site Boundary Red Bone Marrow Dose – CI Source Term, 72 Hours | 49-38 |
| 49-39 | Site Boundary Thyroid Dose – CI Source Term, 24 Hours | 49-39 |
| 49-40 | Site Boundary Thyroid Dose – CI Source Term, 72 Hours | 49-39 |
| 49-41 | Population Whole Body Dose – DIRECT Source Term, 24 Hours | 49-40 |
| 49-42 | Population Whole Body Dose – DIRECT Source Term, 72 Hours | 49-40 |
| 49-43 | Site Boundary Whole Body Dose – DIRECT Source Term, 24 Hours | 49-41 |
| 49-44 | Site Boundary Whole Body Dose – DIRECT Source Term, 72 Hours | 49-41 |
| 49-45 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 24 Hours | 49-42 |
| 49-46 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 72 Hours | 49-42 |
| 49-47 | Site Boundary Thyroid Dose – DIRECT Source Term, 24 Hours | 49-43 |
| 49-48 | Site Boundary Thyroid Dose – DIRECT Source Term, 72 Hours | 49-43 |
| 49-49 | Population Whole Body Dose – IC Source Term, 24 Hours | 49-44 |
| 49-50 | Population Whole Body Dose – IC Source Term, 72 Hours | 49-44 |
| 49-51 | Site Boundary Whole Body Dose – IC Source Term, 24 Hours | 49-45 |
| 49-52 | Site Boundary Whole Body Dose – IC Source Term, 72 Hours | 49-45 |
| 49-53 | Site Boundary Red Bone Marrow Dose – IC Source Term, 24 Hours | 49-46 |
| 49-54 | Site Boundary Red Bone Marrow Dose – IC Source Term, 72 Hours | 49-46 |
| 49-55 | Site Boundary Thyroid Dose – IC Source Term, 24 Hours | 49-47 |
| 49-56 | Site Boundary Thyroid Dose – IC Source Term, 72 Hours | 49-47 |
| 49-57 | Overall Dose Risk – Site Boundary Whole Body EDE Dose, 24 Hours | 49-48 |
| 49-58 | Overall Dose Risk – Site Boundary Red Bone Marrow Dose (Acute), 24 Hours | 49-49 |
| 51-1 | AP1000 Base Core Damage Frequency Uncertainty Analysis | 51-11 |
| 51-2 | AP1000 Sensitivity Case Uncertainty Analysis | 51-11 |
| 51B-1 | Distribution for Plant Core Damage Frequency | 51B-2 |
| 51B-2 | Safety Injection Line Break | 51B-2 |
| 51B-3 | Large LOCA | 51B-3 |
| 51B-4 | Large Spurious ADS Actuation | 51B-3 |
| 51B-5 | Small LOCA | 51B-4 |
| 51B-6 | Medium LOCA | 51B-4 |
| 51B-7 | Reactor Vessel Rupture | 51B-5 |
| 51B-8 | Steam Generator Tube Rupture | 51B-5 |
| 51B-9 | Safety Injection Line Break – Sequence 7 | 51B-6 |
| 51B-10 | Large LOCA – Sequence 9 | 51B-6 |
| 51B-11 | Spurious ADS – Sequence 8 | 51B-7 |
| 51B-12 | Safety Injection Line Break – Sequence 8d | 51B-7 |
| 51B-13 | Reactor Vessel Rupture – Sequence 2 | 51B-8 |
| 51B-14 | Small LOCA – Sequence 5 | 51B-8 |
| 51B-15 | Medium LOCA – Sequence 5 | 51B-9 |
| 51B-16 | Small LOCA – Sequence 12 | 51B-9 |
| 51B-17 | Medium LOCA – Sequence 12 | 51B-10 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 51B-18 | Spurious ADS – Sequence 9 | 51B-10 |
| 51B-19 | Spurious ADS – Sequence 7 | 51B-11 |
| 51B-20 | Safety Injection Line Break – Sequence 3..... | 51B-11 |
| 51B-21 | SGTR Event – Sequence 41 | 51B-12 |
| 51B-22 | ATWS Precursor with no MFW – Sequence 23 | 51B-12 |
| 51B-23 | Small LOCA – Sequence 9 | 51B-13 |
| 51B-24 | Medium LOCA – Sequence 9 | 51B-13 |
| 51B-25 | SGTR Event – Sequence 13 | 51B-14 |
| 51B-26 | Large LOCA – Sequence 8 | 51B-14 |
| 51B-27 | CMT Line Break – Sequence 5 | 51B-15 |
| 54-1 | Loss of Offsite Power During Hot/Cold Shutdown (RCS Filled) Event Tree (Sheets 1 – 2)..... | 54-162 |
| 54-2 | Loss of RNS During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-164 |
| 54-3 | Loss of CCW/SW During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-165 |
| 54-4 | LOCA/RNS-V024 Opens During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-166 |
| 54-5 | LOCA/RNS Pipe Rupture During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-167 |
| 54-6 | Overdraining of Reactor Coolant System During Draindown to Mid-loop Event Tree | 54-168 |
| 54-7 | Loss of Offsite Power During RCS Drained Condition Event Tree | 54-169 |
| 54-8 | Loss of RNS During RCS Drained Condition Event Tree | 54-170 |
| 54-9 | Loss of CCW/SW During RCS Drained Condition Event Tree..... | 54-171 |
| 54-10 | LOCA/RNS-V024 Opens During RCS Drained Condition Event Tree..... | 54-172 |
| 55-1 | Seismic Initiating Event Hierarchy Tree | 55-30 |
| 57-1 | Example Event Tree Model..... | 57-125 |
| 57-2 | Contribution of Plant Areas to Fire CDF | 57-126 |
| 57-3 | Contribution of Fire Area to Fire CDF..... | 57-127 |
| 57A-1 | DAS-ACT Fault Tree..... | 57A-37 |
| 57C-1 | 0000 AF 00 Yard Building (Including Transformer Yard)..... | 57C-12 |
| 57C-2 | 1200 AF 01 RCA of Auxiliary Building (All Zones)..... | 57C-13 |
| 57C-3 | 1200 AF 02 New Fuel and Used Fuel Storage, Waste Disposal Container (All Zones)..... | 57C-14 |
| 57C-4 | 1200 AF 03 Corridors 100' & 117' 6"..... | 57C-15 |
| 57C-5 | 1201 AF 02 Division B Batteries/DC Equipment Room/Instrumentation and Control..... | 57C-16 |
| 57C-6 | 1201 AF 03 Division D DC Equipment/I&C..... | 57C-17 |
| 57C-7 | 1201 AF 04 Division B/D VBS Equipment..... | 57C-18 |
| 57C-8 | 1201 AF 05 MSIV Compartment A..... | 57C-19 |
| 57C-9 | 1201 AF 06 MSIV Compartment B | 57C-20 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 57C-10 | 1202 AF 02 Northeast Elevator Shaft | 57C-21 |
| 57C-11 | 1202 AF 03 Division C Batteries/DC Equipment/I&C Room/ RCP Trip Switchgear Room/I&C Penetration Room | 57C-22 |
| 57C-12 | 1202 AF 04 Division A Electrical Equipment/Battery Room/I&C Room..... | 57C-23 |
| 57C-13 | 1204 AF 01 RNS Pump Room B | 57C-24 |
| 57C-14 | 1204 AF 03 South Shield Building Elevator Shaft | 57C-25 |
| 57C-15 | 1205 AF 02 Southeast Elevator Shaft | 57C-26 |
| 57C-16 | 1210 AF 01 Corridor/Spare Battery Room/Spare Room/Spare Battery Charger Room | 57C-27 |
| 57C-17 | 1220 AF 01 Division B RCP Trip Switchgear/Spare Room/Corridor 82' 6" | 57C-28 |
| 57C-18 | 1220 AF 02 Lower Annulus Valve Area..... | 57C-29 |
| 57C-19 | 1230 AF 01 Corridor Division A, B, C, D and Remote Shutdown Workstation..... | 57C-30 |
| 57C-20 | 1230 AF 02 Non-Class 1E Electrical Compartment - 100' | 57C-31 |
| 57C-21 | 1232 AF 01 Remote Shutdown Workstation..... | 57C-32 |
| 57C-22 | 1240 AF 01 Non-Class 1E Electrical Compartment - 117' | 57C-33 |
| 57C-23 | 1242 AF 02 Division A Penetration Area | 57C-34 |
| 57C-24 | 1243 AF 01 Reactor Trip Switchgear I | 57C-35 |
| 57C-25 | 1243 AF 02 Reactor Trip Switchgear II..... | 57C-36 |
| 57C-26 | 1250 AF 01 Nonradioactive Ventilation System..... | 57C-37 |
| 57C-27 | 2000 AF 01 Turbine Building Floor | 57C-38 |
| 57C-28 | 2003 AF 01 Auxiliary Boiler Equipment Room | 57C-39 |
| 57C-29 | 2009 AF 02 Elevator Machine Room..... | 57C-40 |
| 57C-30 | 2033 AF 02 Motor-Driven Fire Pump Room..... | 57C-41 |
| 57C-31 | 2040 AF 01 Clean and Dirty Lube Oil Storage..... | 57C-42 |
| 57C-32 | 2043 AF 01 Chemical Laboratory..... | 57C-43 |
| 57C-33 | 2050 AF 01 Lube Oil Conditioner Room..... | 57C-44 |
| 57C-34 | 2052 AF 01 Southwest 6.9KV Switchgear Room..... | 57C-45 |
| 57C-35 | 2053 AF 01 Electrical Equipment Room | 57C-46 |
| 57C-36 | 2053 AF 02 Northwest 6.9KV Switchgear Room..... | 57C-47 |
| 57C-37 | 4003 AF 01 Demineralized Water Deoxygenating Room/ Air Handling Equipment Rooms..... | 57C-48 |
| 57C-38 | 4031 AF 01 Battery Room and Battery Charger Room 1..... | 57C-49 |
| 57C-39 | 4031 AF 02 Battery Room and Battery Charger Room 2/ Computer Room B/Shift Turnover Room | 57C-50 |
| 57C-40 | 4031 AF 05 Corridor/Spare Battery Room/Spare Room/ Spare Battery Charger Room..... | 57C-51 |
| 57C-41 | 4031 AF 06 Central Alarm Station/Security Room 1..... | 57C-52 |
| 57C-42 | 4032 AF 01 Decontamination Room, Non-Radiological and Radiological Controlled Area Entry/Exit Area..... | 57C-53 |
| 57C-43 | 4032 AF 02 Containment Access Corridor Elevation 107' 2" | 57C-54 |
| 57C-44 | 4033 AF 01 Hot Machine Shop | 57C-55 |
| 57C-45 | 4034 AF 01 General Offices | 57C-56 |
| 57C-46 | 4041 AF 01 Conference Rooms/Computer Room A/Corridor..... | 57C-57 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 57C-47 | 4041 AF 02 Corridor/Restroom | 57C-58 |
| 57C-48 | 4042 AF 01 Non-Class 1E Switchgear #1..... | 57C-59 |
| 57C-49 | 4042 AF 02 Non-Class 1E Switchgear #2..... | 57C-60 |
| 57C-50 | 4052 AF 01 Staging and Storage Area/Containment Air Filtration Exhaust Rooms A & B..... | 57C-61 |
| 57C-51 | 5031 AF 01 Radwaste Building | 57C-62 |
| 57C-52 | 6030 AF 01 Diesel Generator Room A | 57C-63 |
| 57C-53 | 6030 AF 02 Diesel Generator Room B | 57C-64 |
| 57C-54 | 6030 AF 03 Fuel Oil Day Tank Room A | 57C-65 |
| 57C-55 | 6030 AF 04 Fuel Oil Day Take Room B..... | 57C-66 |
| 57C-56 | 1100 AF 11204 Reactor Coolant Drain Tank Room..... | 57C-67 |
| 57C-57 | 1100 AF 11206 Accumulator Room A | 57C-68 |
| 57C-58 | 1100 AF 11207 Accumulator Room B | 57C-69 |
| 57C-59 | 1100 AF 11208 RNS Valve Room..... | 57C-70 |
| 57C-60 | 1100 AF 11300A Maintenance Floor (SE Quadrant Access) | 57C-71 |
| 57C-61 | 1100 AF 11300B Maintenance Floor (NNE Quadrant) and RCDT Access..... | 57C-72 |
| 57C-62 | 1100 AF 11301 SG Compartment 1..... | 57C-73 |
| 57C-63 | 1100 AF 11302 SG Compartment 2..... | 57C-74 |
| 57C-64 | 1100 AF 11303 Pressurizer Compartment | 57C-75 |
| 57C-65 | 1100 AF 11303A ADS Lower Valve Area | 57C-76 |
| 57C-66 | 1100 AF 11303B ADS Upper Valve Area..... | 57C-77 |
| 57C-67 | 1100 AF 11500 Operating Deck | 57C-78 |
| 57C-68 | 1200 AF 12341 Middle Annulus | 57C-79 |
| 57C-69 | 1200 AF 12555 Main Control Room Emergency Habitability System Air Storage/Operating Deck Staging Area | 57C-80 |
| 59-1 | Contribution of Initiating Events to Core Damage..... | 59-99 |
| 59-2 | 24-Hour Site Boundary Dose Cumulative Frequency Distribution | 59-100 |

REVISION 1 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 1 Change Roadmap | ci through civ | Editorial |
| 1 | 1-6 | Editorial |
| 3 | 3-4 | Editorial |
| Attachment 4B | 4B-24 | 720.027 |
| Attachment 4B | 4B-74 | Editorial |
| 6 | 6-9 | 720.025 (720.029) |
| 6 | 6-12 | 720.025 (720.029) Editorial |
| 6 | 6-16 | Editorial |
| 6 | 6-17 | 720.026 |
| 6 | 6-19 through 6-53 | 720.023 (720.024) (720.097) |
| 6 | 6-62 | 720.031 |
| 6 | 6-69 | 720.025 (720.029) |
| 6 | 6-71 | 720.025 (720.029) |
| 8 | 8-23 and 8-25 | Editorial |
| 12 | 12-6 | 720.033 |
| 12 | 12-30 | 720.033 |
| 26 | 26-11 and 26-12 | Editorial |
| 28 | 28-10 and 28-11 | Editorial |
| 29 | 29-17 | 720.033 |
| 29 | 29-21 | 720.033 |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|---|
| 30 | 30-35 and 30-36 | 720.068 |
| 30 | 30-66 and 30-67 | 720.068 |
| 30 | 30-110 | Editorial |
| 34 | 34-1 | 720.042 |
| 34 | 34-4 and 34-5 | 720.042 |
| 34 | 34-6 and 34-7 | 720.042 |
| | | Editorial |
| 34 | 34-8 through 34-243 | 720.042 |
| 35 | 35-28 | 720.043 |
| 39 | 39-4 | 720.073 |
| | | Editorial |
| 39 | 39-5 | 720.088 |
| | | (720.048, 720.074, 720.083, 720.089) |
| 39 | 39-6 | 720.088 |
| | | 720.073 |
| | | (720.048, 720.074, 720.083, and 720.089) |
| 39 | 39-12 | Editorial |
| 39 | 39-19 | Editorial |
| 39 | 39-20 | 720.073 |
| 39 | 39-21 | Editorial |
| | | 720.088 |
| Attachment 39A | 39A-1 through 39A-40 | 720.088 |
| | | (720.048, 720.074, 720.083, and 720.089) |
| 41 | 41-6 | 720.042 |
| 41 | 41-15 | 720.093 |
| 41 | 41-20 | 720.054 |
| 41 | 41-31 | Editorial |
| Attachment 41A | 41A-1 through 41A-228 | 720.042 |
| Attachment 41B | 41B-1 through 41B-11 | 720.093 |
| 43 | 43-126 and 43-127 | Editorial |
| Attachment 43C | 43C-1 and 43C-2 | 720.043 |
| 44 | 44-7 | Editorial |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|----------------------|--|
| 45 | 45-1 through 45-3 | 470.013 (470.012) |
| 45 | 45-4 | 470.013 (470.012) Editorial |
| 45 | 45-5 through 45-48 | 470.013 (470.012) |
| 49 | 49-1 | 720.056 |
| 49 | 49-4 through 49-6 | 720.056 |
| 49 | 49-9 through 49-49 | 720.056 |
| 50 | 50-14 | 720.034 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 57 | 57-1 through 57-109 | Letter DCP/NRC1515 |
| Attachment 57A | 57A-1 through 57A-37 | Letter DCP/NRC1515 |
| Attachment 57B | 57B-1 through 57B-6 | Letter DCP/NRC1515 |
| Attachment 57C | 57C-1 through 57C-80 | Letter DCP/NRC1515 |
| Attachment 57D | 57D-1 through 57D-7 | Letter DCP/NRC1515 |
| 59 | 59-20 and 59-21 | Editorial |
| 59 | 59-23 through 59-25 | Letter DCP/NRC1515 |
| 59 | 59-26 | 720.056 |
| 59 | 59-28 | Editorial |
| 59 | 59-29 through 59-32 | 720.038 |
| 59 | 59-34 through 59-38 | 720.038 |
| 59 | 59-72 | Editorial |
| 59 | 59-73 | Technical |
| 59 | 59-83 | Editorial |
| 59 | 59-75 through 59-96 | 720.038 |
| 59 | 59-97 | 720.038 720.066 |
| 59 | 59-98 | 720.038 |
| 59 | 59-100 | Technical |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change</u>⁽¹⁾ |
|-----------------------|------------------------|---|
| Appendix A | A-1 through A-166 | 720.007 720.010 720.011 720.012 720.013 720.015 720.016 |
| Appendix B | B-6 | 720.058 |
| Appendix B | B-13 | 720.076 |
| Appendix D | D-14 and D-15 | 720.078 |
| Appendix D | D-31 | 720.078 |
| Appendix D | D-35 and D-36 | Technical |
| Appendix D | D-37 through D-58 | 720.078 |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number. RAI number in parenthesis contains a reference to RAI response listed above.

REVISION 2 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 2 Change Roadmap | cv through cvii | Editorial |
| 6 | 6-17 | 720.026 (R1) |
| 6 | 6-28 | 720.024 (R1) |
| 6 | 6-32 and 6-33 | 720.024 (R1) |
| 6 | 6-37 through 6-39 | 720.024 (R1) |
| 6 | 6-41 | 720.024 (R1) |
| 6 | 6-50 through 6-53 | 720.024 (R1) |
| 6 | 6-69 | 720.029 (R1) |
| 24 | 24-17 | 720.046 (R1) |
| 24 | 24-22 and 24-23 | 720.046 (R1) |
| 24 | 24-27 | 720.046 (R1) |
| 30 | 30-26a through 30-28 | 720.029 (R1) |
| 35 | 35-28 | 720.043 (R1) |
| 43 | 43-9 and 43-9a | 720.039 (R2) |
| 43 | 43-9b | Editorial |
| 43 | 43-10a | 720.039 (R2) |
| 43 | 43-10b | Editorial |
| 43 | 43-93a through 43-93w | 720.039 (R2) |
| 43 | 93-93x | Editorial |
| Attachment 43C | 43C-2 | 720.043 (R1) |
| 50 | 50-1 | |
| 50 | 50-1a and 50-1b | Editorial |
| 50 | 50-14 | 720.039 (R2) |
| 50 | 50-14a | 720.039 (R2) |
| 50 | 50-14b | Editorial |
| 54 | 54-1 through 54-131 | 720.038 (R2) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|-------------------------------------|
| 56 | 56-1 | 720.038 (R1) Editorial |
| 56 | 56-9 | Editorial |
| 56 | 56-17 and 56-18 | Editorial |
| 56 | 56-20 | Editorial |
| 56 | 56-36 and 56-37 | Editorial |
| 56 | 56-38 | Editorial 720.038 (R1) |
| 56 | 56-38a through 56-38k | 720.038 (R1) |
| 56 | 56-38l | Editorial |
| 56 | 56-47 through 56-49 | Editorial |
| 56 | 56-51 | Editorial |
| 56 | 56-54 and 56-55 | 720.038 (R1) |
| 57 | 57-14 and 57-15 | 280.011 (R1) |
| 57 | 57-15a and 57-15b | Editorial |
| 59 | 59-23 and 59-23a | 720.038 (R1) |
| 59 | 59-23b | Editorial |
| 59 | 59-34 | 720.038 (R1) |
| 59 | 59-72 | 720.038 (R1) |
| Appendix A | A-12 | Editorial |
| Appendix A | A-24 through A-26 | 440.014 (R1) |
| Appendix A | A-26a | 440.014 (R1) 720.024 (R1) |
| Appendix A | A-26b | Editorial |
| Appendix A | A-27 | 720.012 (R1) |
| Appendix A | A-31 | 720.012 (R1) |
| Appendix A | A-33 | 720.010 (R1) |
| Appendix A | A-33a and A-33b | Editorial |
| Appendix A | A-44 | Editorial |
| Appendix A | A-57 through A-61 | 720.012 (R1) |
| Appendix A | A-63 | 720.012 (R1) |
| Appendix A | A-66 | 720.012 (R1) |
| Appendix A | A-103a through A-103b | 440.014 (R1) |
| Appendix A | A-103c and A-103d | 720.012 (R1) |
| Appendix A | A-151 and A-152 | 720.013 (R1) |
| Appendix A | A-165 and A-166 | 720.013 (R1) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------|-------------------------------------|
| Appendix D | D-13 and D-14 | 720.080 (R1) |
| Appendix D | D-35 and D-36 | 720.080 (R1) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 3 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through cii | Editorial |
| Revision 3 Change Roadmap | cx | Editorial |
| | | |
| Attachment 45A | 45A-1 through 45A-24 | Technical |
| | | |
| 57 | 57-1 and 57-2 | Editorial |
| 57 | 57-4 | Editorial |
| 57 | 57-11 and 57-12 | Editorial |
| 57 | 57-17 | Editorial |
| 57 | 57-22 and 57-23 | Editorial |
| 57 | 57-30 through 57-39 | 720.038 (R1) |
| 57 | 57-40 | 720.038 (R1) |
| | | Editorial |
| 57 | 57-41 and 57-42 | 720.038 (R1) |
| 57 | 57-78 | Editorial |
| 57 | 57-117 through 57-124 | 720.038 (R1) |
| | | |
| Appendix A | A-23 through A-25 | 720.009 (R2) |
| Appendix A | A-105 through A-111 | 720.009 (R2) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 4 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|---|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 4 Change Roadmap | cxii and cxiii | Editorial |
| 34 | 34-4 | Editorial |
| 34 | 34-16 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-19 through 34-21 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-50 and 34-51 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-247 through 34-264 | DSER OI 19.1.10.3-1 (R1) |
| 42 | 42-3 | DSER OI 19.2.6-1 (R1) |
| 42 | 42-6 | DSER OI 19.2.6-3 |
| 42 | 42-7 and 42-8 | Editorial |
| 43 | 43-10 | Editorial |
| 43 | 43-13 | Editorial |
| Attachment 43D | 43D-1 | DSER OI 19.1.3.2-1 |
| Attachment 43E | 43E-1 and 43E-2 | DSER OI 19.1.3.2-2 |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-5 and 45-6 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-13 through 45-18 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R1) |
| Attachment 45A | 45A-1 through 45A-24 | Deleted per DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-6 | DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-9 through 49-49 | DSER OI 19.1.10.3-1 (R1) |
| 50 | 50-1 | Editorial |
| 54 | 54-9 | DSER OI 19.1.10.2-3 |
| 54 | 54-12 | DSER OI 19.1.10.2-3 |
| 54 | 54-13 | Editorial |
| 54 | 54-22 through 54-71 | Editorial |
| 54 | 54-76 through 54-80 | DSER OI 19.1.10.2-5 Editorial |

REVISION 4 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|-----------------------|------------------------|---|
| 54 | 54-83 through 54-110 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-112 through 54-118 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-121 through 54-137 | DSER OI 19.1.10.2-3 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) Editorial |
| 55 | 55-16 through 55-18 | Editorial |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 55 | 55-25 through 55-29 | Editorial |
| 56 | 56-46 | DSER OI 19.3.10-1 |
| 59 | 59-26 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-37 | DSER OI 19A.3-2 (R1) |
| 59 | 59-45 through 59-70 | Editorial |
| 59 | 59-73 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-74 | Editorial |
| 59 | 59-100 | DSER OI 19.1.10.3-1 (R1) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 5 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 5 Change Roadmap | cxiv and cxv | Editorial |
| 43 | 43-10 and 43-11 | DSER OI 19.1.3.2-2 (R1) |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R2) |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R2) |
| | | Editorial |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R2) |
| 54 | 54-3 | Editorial |
| 54 | 54-11 | DSER OI 19.1.10.2-4 (R1) |
| 54 | 54-76 through 54-99 | DSER OI 19.1.10.2-4 (R1) |
| 55 | 55-23 | DSER OI 19A.2-8 (R2) |
| 59 | 59-45 | Editorial |
| 59 | 59-77 | Editorial |
| 59 | 59-81 | Editorial |
| 59 | 59-83 | Editorial |
| 59 | 59-90 | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.1-2 (R2) |
| Appendix A | A-8 | Editorial |
| Appendix A | A-17 | Editorial |
| Appendix A | A-19 | Editorial |
| Appendix A | A-21 | Editorial |
| Appendix A | A-23 and A-24 | DSER OI 19.1.10.1-5 (R2) |
| | | Editorial |
| Appendix A | A-25 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-43 | Editorial |
| Appendix A | A-45 and A-46 | DSER OI 19.1.10.1-5 (R2) |
| | | Editorial |
| Appendix A | A-47 and A-48 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-104 through A-109 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-154 through A-158 | DSER OI 19.1.10.1-5 (R2) |

REVISION 5 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|-----------------------|------------------------|--|
| Appendix A | A-159 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-160 and A-161 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-162 and A-163 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-164 through A-175 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-176 and A-177 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-178 through A-181 | DSER OI 19.1.10.1-5 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 6 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 6 Change Roadmap | cxvi | Editorial |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R3) |
| 55 | 55-11 | Editorial |
| 55 | 55-20 | Editorial |
| 55 | 55-21 through 55-24 | Editorial (per Oct. 6-9 meeting) |
| 59 | 59-98 | DSER OI 19.1.10.2-6 (R2) |
| Appendix A | A-41 | DSER OI 21.5-2 |
| Appendix A | A-46 and A-47 | DSER OI 15.2.7-1 Item 7 (R5) |
| Appendix A | A-135 through A-141 | DSER OI 21.5-2 |
| Appendix A | A-154 through A-167 | DSER OI 15.2.7-1 Item 7 (R5) |

- Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 7 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|------------------------|--|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 7 Change Roadmap | cxvii | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.2-1 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 8 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 8 Change Roadmap | cxviii | Editorial |
| 59 | 59-92 | NRC Comments |
| 59 | 59-98 | NRC Comments |

CHAPTER 59

PRA RESULTS AND INSIGHTS

59.1 Introduction

This chapter summarizes the use of the AP1000 PRA in the design process, PRA results and insights, plant features important to reducing risk, and PRA input to the design certification process.

AP1000 is expected to achieve a higher standard of severe accident safety performance than current operating plants, because both prevention and mitigation of severe accidents have been addressed during the design stage, taking advantage of PRA insights, PRA success criteria analysis, severe accident research, and severe accident analysis. Since PRA considerations have been integrated into the AP1000 design process from the beginning, many of the traditional PRA insights relating to current operating plants are not at issue for the AP1000. The Level 1, Level 2, and Level 3 results show that addressing PRA issues in the design process leads to a low level of risk. The PRA results indicate that the AP1000 design meets the higher expectations and goals for new generation passive pressurized water reactors (PWRs).

The core damage frequency (CDF) and large release frequency (LRF) for at-power internal events (excluding seismic, fire, and flood events) are $2.41\text{E-}07$ events per reactor-year and $1.95\text{E-}08$ events per reactor-year, respectively. These frequencies are at least two orders of magnitude less than a typical pressurized water reactor plant currently in operation. This reduction in risk is due to many plant design features, with the dominant reduction coming from highly reliable and redundant passive safety-related systems that impact both at-power and shutdown risks. These passive systems are much less dependent on operator action and support systems than plant systems in current operating plants.

The Level 3 analysis shows the potential offsite dose from a severe accident is very small and well within the established goals. The risk measured by the potential offsite dose does not increase significantly after the first 24 hours after a severe accident is assumed to cause a release to the environment.

Conservative, bounding fire and flood assessments show the core damage risk from these events is small compared to the core damage risk from at-power and shutdown events.

A synopsis of the insights gained from the PRA about the AP1000 design includes:

- The AP1000 design benefits from the high level of redundancy and diversity of the passive safety-related systems. The passive systems have been shown to be highly reliable, their designs are simple so that a limited number of components are required to function.
- AP1000 is less dependent on nonsafety-related systems than current plants or advanced light water reactor evolutionary plants.

- The nonsafety-related support systems (ac power, component cooling water, service water, and instrument air) have a limited role in the plant risk profile because the passive safety-related systems do not require cooling water or ac power.
- AP1000 is less dependent on human actions than current plants or advanced light water reactor evolutionary plants. Even when no credit is taken for operator actions, the AP1000 meets the NRC safety goal, whereas current plants may not.
- The core damage and large release frequencies are low despite the conservative assumptions made in specifying success criteria for the passive systems. The success criteria have been developed in a more systematic, rigorous manner than typical PRA success criteria. The baseline success criteria are bounding cases for a large number of PRA success sequences. The baseline success sequences, in most cases, have been defined with:
 - Worst (i.e., the most limiting) break size and location for a given initiating event
 - Worst automatic depressurization system (ADS) assumption in the success criterion
 - Worst number of core makeup tanks (CMT) and accumulators
 - Worst containment conditions for in-containment refueling water storage tank (IRWST) gravity injection

Many less-limiting sequences are therefore represented by a baseline success criterion.

- Single system or component failures are not overly important due to the redundancy and diversity of safety-related systems in the design. For example, the following lines of defense are available for reactor coolant system (RCS) makeup:
 - Chemical and volume control system (CVS)
 - Core makeup tanks
 - Partial automatic depressurization system in combination with normal residual heat removal
 - Full automatic depressurization system with accumulators and in-containment refueling water storage tank
 - Full automatic depressurization system with core makeup tanks and in-containment refueling water storage tank
- Typical current PRA dominant initiating events are significantly less important for the AP1000. For example, the reactor coolant pump (RCP) seal loss-of-coolant accident (LOCA) event has been eliminated as a core damage initiator since AP1000 uses canned motor reactor coolant pumps which do not have seals. Another example is the loss of offsite power (LOOP) event. The station blackout and loss of offsite power event is a

minor contributor to AP1000 since the passive safety-related systems do not require the support of ac power.

- Passive safety-related systems are available in all shutdown modes. Planned maintenance of passive features is only performed during shutdown modes when that feature is not risk important. In addition, planned maintenance of nonsafety-related defense-in-depth features used during shutdown is performed at power.
- The AP1000 passive containment cooling design is highly robust. Air cooling alone is significant and may prevent containment failure, although the design has other lines of defense for containment cooling such as fan coolers and passive containment cooling water.
- The potential for containment isolation and containment bypass is lessened by having fewer penetrations to allow fission product release. In addition, normally open and risk important penetrations are fail-closed, thus eliminating the dependence on instrumentation and control (I&C) and batteries.
- The reactor vessel lower head has no vessel penetrations, thus eliminating penetration failure as a potential vessel failure mode. Preventing the relocation of molten core debris to the containment eliminates the occurrence of several severe accident phenomena, such as ex-vessel fuel-coolant interactions and core-concrete interaction, which may threaten the containment integrity. Therefore, AP1000, through the prevention of core debris relocation to the containment, significantly reduces the likelihood of containment failure.
- The potential for the spreading of fires and floods to safety-related equipment is significantly reduced by the AP1000 layout.

59.2 Use of PRA in the Design Process

The AP1000 design has evolved over a period of years, including the work done for the AP600 design. PRA techniques have been used since the beginning in an iterative process to optimize the AP600/AP1000 with respect to public safety. Each of these iterations has included:

- Development of a PRA model
- Use of the model to identify weaknesses
- Quantification of PRA benefits of alternate designs and operational strategies
- Adoption of selected design and operational improvements.

The scope and detail of the PRA model has increased from the early studies as the plant design has matured. This iterative design process has resulted in a number of design and operational improvements.

59.3 Core Damage Frequency from Internal Initiating Events at Power

Internal initiating events are transient and accident initiators that are caused by plant system, component, or operator failures. External initiating events, which include internal fire and flooding events and events at shutdown are discussed in other subsections.

The AP1000 mean plant core damage frequency for internal initiating events at power is calculated to be $2.41\text{E-}07$ events per year. Twenty-six separate initiating event categories were defined to accurately represent the AP1000 design. Of these event categories, 11 are loss-of-coolant accidents, 12 are transients, and 3 are anticipated transients without scram precursors (initiating events that result in an anticipated transient without scram sequence as a result of failure to trip the reactor). Initiating event categories unique to the AP1000 design have been defined and evaluated, including safety injection line breaks, core makeup tank line breaks, and passive residual heat removal heat exchanger (HX) tube ruptures. The resulting core damage frequency is very small; a value of $2.41\text{E-}07$ means that only one core damage event is expected in 4 million plant-years of operation. This core damage frequency value is two orders of magnitude (i.e., 100 times) smaller than corresponding values typically calculated for current pressurized water reactors.

The contribution of initiating events to the total plant core damage frequency is summarized in Table 59-1. Figure 59-1 illustrates the relative contributions to core damage frequency from the various at-power initiating events. Table 59-2 shows the conditional core damage probability of the initiating events. The conditional core damage probability listed in Table 59-2 is the ratio of the core damage frequency contribution for an initiating event divided by the initiating event frequency.

Seven initiating events, including 6 loss-of-coolant accidents, and steam generator tube rupture (SGTR), make up approximately 92 percent of the total at-power plant core damage frequency. The remaining initiating events contribute a total of approximately 8 percent to the core damage frequency from internal events. The dominant initiating events are:

- Safety injection (DVI) line break
- Large loss-of-coolant accident
- Spurious ADS actuation
- Small loss-of-coolant accident
- Medium loss-of-coolant accident
- Reactor vessel rupture
- Steam generator tube rupture

Within this group of events, each of the first three contribute more than 10 percent to the total core damage frequency. These three events account for approximately 70 percent of the total core damage frequency. Small LOCA, medium LOCA, and reactor vessel rupture events contribute 7 percent, 6 percent and 4 percent, respectively.

The results show a very low core damage frequency dominated by rare events (initiating events that are not expected to occur during the lifetime of a plant). This indicates that the AP1000 design is robust with respect to its ability to withstand challenges from more

frequent events (e.g., transients) and that adequate protection against the more severe events is provided through the defense-in-depth features.

Information regarding loss-of-coolant accident categories defined for the AP1000 PRA was presented in the discussion of PRA success criteria. For the PRA, the various loss-of-coolant accident categories have been defined based on which plant features are required to mitigate the events. As a result, the PRA and loss-of-coolant accident size definitions are not identical to the loss of coolant accident size definitions used in the Chapter 15, Accident Analyses included in the *AP1000 Design Control Document* (DCD). The following listing shows how the PRA and DCD break sizes are related and identifies the PRA size criteria:

- DCD Chapter 15 break size definitions are large (break size greater than 1 ft.²) or small (break size less than 1 ft.²).
- PRA break sizes are defined as follows:
 - Large breaks are those with an equivalent inside diameter of approximately 9 in. or larger. Reactor vessel rupture is included in this category. The automatic depressurization system is not required for in-containment refueling water storage tank injection for large breaks. (For large breaks that are slightly larger than a medium break, there is a potential effect of containment isolation upon in-containment refueling water storage tank injection. The success criteria include automatic depressurization system in these cases.)
 - Medium breaks are those with an equivalent inside diameter between approximately 2 in. and 9 in. Core makeup tank line breaks and safety injection line breaks are included in this category (but are evaluated separately). Operation of automatic depressurization system stages 1, 2, or 3 (or, alternatively, passive residual heat removal) is not required to satisfy the automatic depressurization system stage 4 automatic actuation pressure interlock, but is required to depressurize the reactor coolant system to the normal residual heat removal system operating pressure.
 - Small breaks are those with an equivalent inside diameter between approximately 3/8 in. and 2 in. Steam generator tube rupture and passive residual heat removal heat exchanger tube rupture break sizes fall within this range, but are evaluated as separate events based on differing initial plant response. Small breaks are larger than those for which the chemical and volume control system can maintain reactor coolant system water level, but not large enough to allow automatic actuation of automatic depressurization system stage 4 without operation of either automatic depressurization system stages 1, 2, or 3 or passive residual heat removal.
 - Coolant losses smaller than those resulting from small breaks are defined as reactor coolant system leaks. Operation of one chemical and volume control system makeup pump can maintain reactor coolant system water inventory for reactor coolant system leaks.

59.3.1 Dominant Core Damage Sequences

A total of 791 potential core damage event sequences for internal initiating events at power are modeled in the AP1000 PRA. These core damage sequences are the combinations of initiating event occurrences and subsequent successes and failures of plant systems and operator actions that result in core damage. Of these 791 event sequences, 190 result in frequencies ranging from $7 \cdot 10^{-8}$ to $1 \cdot 10^{-15}$ events per year. The remaining sequences do not produce any cutsets representing them in the top 19,000 cutsets; that is, their core damage frequencies are not significant relative to the core damage frequencies for the other sequences.

- The 10 sequences with the highest core damage frequencies together contribute 79 percent of the total (approximately $1.92 \cdot 10^{-7}$ events per year).
- The top 19 sequences contribute 90 percent of the total (approximately $2.18 \cdot 10^{-7}$ events per year).
- The top 58 sequences contribute 99 percent of the total (approximately $2.39 \cdot 10^{-7}$ events per year).
- The top 100 sequences contribute 99.9 percent of the total (approximately $2.41 \cdot 10^{-7}$ events per year).

The 19 dominant sequences are given in Table 59-3.

Moreover, each core damage sequence is composed of component-level cutsets, with a total of approximately 19,000 cutsets included in the baseline internal initiating events at-power analysis (100 percent of $2.41 \cdot 10^{-7}$ events per year core damage frequency). A cutset is a combination of initiating event occurrence and the component or operator failures that constitute the various system-level failures that lead to core damage.

- The 100 highest-frequency cutsets together contribute approximately 86 percent of the total core damage frequency (approximately $2.1 \cdot 10^{-7}$ events per year).
- The top 200 cutsets contribute approximately 91 percent ($2.2 \cdot 10^{-7}$ events per year). These cutsets are reported in Section 36.
- The top 500 cutsets contribute approximately 95 percent ($2.3 \cdot 10^{-7}$ events per year).
- The top 1,000 cutsets contribute approximately 97 percent ($2.35 \cdot 10^{-7}$ events per year).
- The top 2,000 cutsets contribute approximately 98 percent ($2.37 \cdot 10^{-7}$ events per year).

The top 10 accident sequences contribute 79 percent of the core damage frequency from internal initiating events at power. These sequences are listed in Table 59-3. The top 25 cutsets for these sequences are given in Tables 59-4 through 59-13.

The first four dominant accident sequences make up 63 percent of the core damage frequency. These sequences are:

1. Safety injection line break event occurs, which is postulated to lead to spilling of one train of core makeup tank, in-containment refueling water storage tank, and recirculation flows. The reactor is tripped. The second core makeup tank successfully injects, and the automatic depressurization system is successfully actuated. Thus, the reactor coolant system pressure is low. However, the remaining in-containment refueling water storage tank line fails to inject; core damage occurs with low reactor coolant system pressure, leading to a postulated 3BE end state. The sequence frequency is $6.9E-08$ per year, contributing 29 percent to the plant core damage frequency.
2. Large loss-of-coolant accident event occurs, and the reactor is tripped or is rendered subcritical because of voids in the reactor coolant system. Reactor coolant system rapidly depressurizes but one of the accumulators does not inject water into the RCS. Core damage with low reactor coolant system pressure, leading to the 3BR end state is postulated. The sequence frequency is $4.3E-08$ per year, contributing 18 percent to the plant core damage frequency.
3. Spurious ADS actuation event occurs, and the reactor is tripped or is rendered subcritical because of voids in the reactor coolant system. Reactor coolant system rapidly depressurizes and at least one of the two accumulators injects, making up the RCS water loss in the short time frame. The CMT injection or ADS actuation fails. Thus, automatic IRWST injection is not actuated. Core damage with medium reactor coolant system pressure, leading to the 3D end state is postulated. The sequence frequency is $2.1E-08$ per year, contributing 9 percent to the plant core damage frequency.
4. Safety injection line break event occurs, which is postulated to lead to spilling of one train of core makeup tank, in-containment refueling water storage tank, and recirculation flows. The reactor is tripped. The second core makeup tank successfully injects, but the automatic depressurization system actuation fails. Core damage is postulated with a medium reactor coolant system pressure, leading to a 3D end state. The sequence frequency is $2.0E-08$ per year, contributing 8 percent to the plant core damage frequency.

The fifth dominant sequence, with 4 percent contribution to plant core damage frequency, is a reactor vessel rupture event. By the definition of this event, core damage is postulated to occur. The end state is 3C.

59.3.2 Component Importances for At-Power Core Damage Frequency

Chapter 50 presents tables of the relative importances of all basic events appearing in the cutsets for the baseline core damage quantification. These tables indicate risk decrease and risk increase. Risk decrease is the factor by which the core damage frequency would decrease if the failure probability for a given basic event is set to 0.0; it is a useful measure of the benefit that might be obtained as a result of improved component maintenance or testing, better procedures, or operator training. Risk increase is the factor by which the core damage frequency would increase if the failure probability for a given basic event is set to 1.0; it is a

useful measure of which components or actions would most adversely affect the core damage frequency if actual operating practices resulted in higher failure probabilities than assumed in the PRA.

The risk decrease results (as discussed in detail in Chapter 50) show that only six components have a risk reduction worth (RRW) of greater than or equal to 1.05. The in-containment refueling water storage tank discharge line strainer plugging has the highest RRW value, followed by common cause failure (CCF) of various components as shown in the following table.

| | | |
|------------|------|--|
| IWA-PLUG | 1.27 | IRWST discharge Line "A" strainer plugged |
| ADX-EV-SA2 | 1.11 | CCF of 2 squib valves to operate |
| REX-FL-GP | 1.08 | CCF plugging of both recirculation lines due to sump screens |
| ADX-EV-SA | 1.05 | CCF of 4th stage ADS squib valves to operate |
| IWX-CV-AO | 1.05 | CCF of 4 gravity injection check valves |
| IWX-EV-SA | 1.05 | CCF of 4 gravity injection & 2 recirculation squib valves |

The remaining components each have a risk reduction worth of 1.04 or less. The contribution to the core damage frequency from unscheduled maintenance is also small. These results indicate that there are no components for which an improvement in design, test, or maintenance (i.e., a change resulting in a significant reduction of the component failure rate) would have a significant impact on the core damage frequency.

Excluding common cause failures, the risk increase results indicate that the accumulator system components have high risk achievement worth (RAW) values, followed by one Non-Class 1E dc and uninterruptible power supply system (EDS) bus, various Class 1E dc and uninterruptible power supply system (IDS) components and CMT components. Other single-component failures have significantly lower risk increase values, corresponding to a factor of six or lower increase in core damage frequency given an assumption of total unreliability for these components.

59.3.3 System Importances for At-Power Core Damage

System importances for plant core damage frequency from internal initiating events at power are presented in Chapter 50. They are obtained by setting the failure probabilities for the affected system components to 1.0 in the baseline cutsets and recalculating the core damage frequency.

The results of the sensitivity analyses show that the protection and safety monitoring system and the Class 1E dc power system are most important in maintaining a low core damage frequency. The risk-important systems are safety-related systems. The safety-related systems are all of high or medium importance. The nonsafety-related systems are only marginally important to the plant core damage frequency.

A sensitivity analysis is made for the unavailability of all five of the standby non-safety related systems (chemical and volume control system (CVS), startup feedwater system (SFW), normal residual heat removal system (RNS), diverse actuation system (DAS), diesel generators (DGs)). The plant CDF obtained is 7.40E-6, which is a factor of 31 increase over the base case. This sensitivity analysis shows that the plant CDF is somewhat sensitive to the simultaneous failure of the five systems listed above.

59.3.4 System Failure Probabilities for At-Power Core Damage

Some selected system failure probabilities for typical success criteria used in the at-power PRA are listed in Table 59-14. A system may have different failure probabilities based on the success criteria assigned. For a key safety-related system such as the automatic depressurization system, this is especially pronounced; the automatic depressurization system has many success criteria and corresponding failure probabilities that range over a factor of 100. The values in the table are representative of the various cases.

As can be seen from the system unavailabilities listed in Table 59-14, the highest unavailabilities (i.e., 10^{-2} to 10^{-3} , indicating lower reliability) are associated with nonsafety-related systems or functions. The lower unavailabilities (i.e., 10^{-4} to 10^{-6} , indicating higher reliability) are associated with safety-related systems.

59.3.5 Common Cause Failure Importances for At-Power Core Damage

The common cause importance results are presented in Chapter 50. The risk increase importances for common cause failures of the following sets of components show that these are also of potential significance to the current low level of core damage frequency from internal events: common cause failure of software in the protection and safety monitoring system and plant control system, logic board failures of the protection and safety monitoring system; failures of transmitters used in the protection and safety monitoring system; failures of reactor trip breakers; plugging of containment sump recirculation screens; failures of in-containment refueling water storage tank gravity injection line check valves and squib valves; plugging of strainers in the in-containment refueling water storage tank; failures of fourth-stage automatic depressurization system squib valves and failures of output cards for the protection and safety monitoring system. These and similar common cause failures are of potential significance in maintaining the current level of low plant core damage frequency.

The leading risk decrease common cause failures of hardware are associated with ADS fourth stage squib valves, gravity injection and recirculation line components, and I&C components and sensors.

59.3.6 Human Error Importances for At-Power Core Damage

In the PRA, credit is taken for various tasks to be performed in the control room by the trained operators. These tasks are rule-based and proceduralized. Although these tasks are usually termed operator actions, the tasks almost always refer to the completion of a well-defined mission by trained operators following procedures. Further, not every individual or group error during a mission necessarily fails the mission, since procedural recovery is built into the emergency procedures. Moreover, a very strong diversity is introduced through

monitoring of the emergency procedure status trees by a shift technical advisor. These considerations are factored into the PRA evaluation of human errors.

The risk decrease results for operator actions (discussed in Chapter 50) show that there are 10 human actions with importances greater than 1 percent. There are no actions for which the internal initiating events at-power core damage frequency contribution would decrease by more than 3 percent if it were assumed that the operators always were successful. This indicates that there would be no significant benefit from additional refinement of the actions modeled, nor from special emphasis on operator training in these actions (versus other emergency actions).

The risk increase results show that there are only 7 operator actions with importance greater than 100 percent; i.e., these are the only modeled operator actions whose guaranteed failure would result in a core damage increase greater than the base case core damage frequency. The most important action in this ranking (operator fails to diagnose a steam generator tube rupture event) has a risk achievement worth of 6.3. It is followed by manual actuation of ADS with a RAW value of 4.25. These results indicate that the plant design is not overly sensitive to failure of operator actions and the core damage models do not take undue credit for operator response.

A sensitivity analysis was performed in which the failure probabilities for the 30 operator actions are set to 0.0 (perfect operator). The resulting core damage frequency is only slightly smaller. This indicates that perfection in human error probabilities is not risk important at the level of plant risk obtained by the base case; there is no significant benefit to be gained by improving operator response beyond the assumptions made in the PRA.

Another sensitivity analysis was performed in which the failure probabilities for the 30 human error probabilities and also for indication failure (protection and safety monitoring system, plant control system, or diverse actuation system originated) are set to 1.0 (failure). The result of the sensitivity analysis shows that the core damage frequency increased to 1.4E-05 events per year. The resulting core damage frequency with no credit for operator actions is still low (about one event in 71,000 reactor-years), on the order of core damage frequency for current plants with credit for operators. This means that, in general, operator actions are important in maintaining a very low plant core damage frequency for internal events at power but are not essential to establishing the acceptability of plant risk. The presence of trained operators will help ensure that the very low core damage frequency prediction is valid. This finding demonstrates a significantly lower dependence on human actions than exists for current plants. The AP1000 meets the core damage frequency safety goal without human action, whereas current plants typically do not.

59.3.7 Accident Class Importances

The accident classes (also referred to as end states) are described in Chapter 44, and the contribution of accident classes to plant core damage frequency is presented in the same chapter. Two low-pressure reactor coolant system core damage end states, 3BE and 3BL, contribute 43 percent to the total core damage frequency. Together with 3BR and 3D, full or partially depressurized core damage states make up 87 percent of the core damage. In these

end states, the probability of retaining containment integrity is very likely. Thus, severe release potential for these end states is low.

59.3.8 Sensitivity Analyses Summary for At-Power Core Damage

Thirty-six importance and sensitivity analyses were performed on the core damage model for internal initiating events at power. These cases and results are discussed in Chapter 50.

The analyses were chosen to address the following issues:

- Importances of individual basic events and their effect on plant core damage frequency
- Importances of safety-related and nonsafety-related systems in maintaining a low plant core damage frequency
- Importances of containment safeguards systems in maintaining a low large-release frequency
- Effect of human reliabilities as a group on plant core damage frequency
- Other specific issues such as passive system check valve reliability, etc.

The sensitivity analyses results are discussed in Chapter 50. They show that:

- If no credit is taken for operator actions, the plant core damage frequency is $1.4\text{E-}05$ events per year. This compares well with core damage frequencies for existing plants where credit is taken for operator actions.
- The most important systems for core damage prevention are the protection and safety monitoring system, Class 1E dc power, automatic depressurization system, in-containment refueling water storage tank recirculation, core makeup tanks, and accumulators. None of the nonsafety-related systems have high system importance.
- There are no operator actions that would provide a significant risk decrease if they were made to be more reliable. There are only eight operator actions that would increase the core damage frequency by more than the base case if they were assumed to fail. The most important of these is the failure to diagnose a steam generator tube rupture event.
- If the reliability of all check valves is assumed to be a factor of 10 worse, the total plant core damage frequency would only increase to $8.8\text{E-}7$ events per year. This shows that the passive safety-related systems that depend on check valve opening will perform acceptably, even if pessimistic check valve reliabilities are assumed.
- The plant core damage frequency is not affected by the diesel generator mission time duration. This is due to the AP1000 design's passive features, which do not require ac power for operation.

- The common cause failure basic events, particularly those associated with safety-related systems, are important individually, and also as a group for plant core damage frequency. This is expected for a plant with highly redundant safety-related systems, for which individual component random failure contributions are of reduced significance.

59.3.9 Summary of Important Level 1 At-Power Results

The results of the PRA show that the following AP1000 design features provide the ability to respond to internal initiating events and contribute to a very low core damage frequency:

- The manual feed and bleed operation in current pressurized water reactors is replaced by the automatic depressurization system and core makeup tank/in-containment refueling water storage tank injection. This increases the success probability for feed and bleed and helps reduce core damage contribution from transients with failure of decay heat removal.
- The switchover-to-recirculation operation in current pressurized water reactors is replaced with automatic recirculation of sump water into the reactor coolant system loops by natural circulation.
- The diverse actuation system provides diverse backup for automatic or manual actuation of safety-related systems, increasing the system reliability for the passive residual heat removal, core makeup tank, and automatic depressurization systems.
- The AP1000 plant design is based on a defense-in-depth concept. There are several means (both active and passive) of providing reactor coolant system makeup following a loss-of-coolant accident, at both high and low pressures (i.e., chemical and volume control system pumps, core makeup tanks, accumulators, in-containment refueling water storage tank gravity injection, and normal residual heat removal system). Similarly, there are diverse means of core cooling, including the passive residual heat removal and normal residual heat removal systems.
- The ability to depressurize and establish feed and bleed heat removal via the automatic depressurization system and core makeup tanks without operator action provides an additional reliable means of core cooling and inventory control.
- The diversity and redundancy in the design of the automatic depressurization system provide a highly reliable system for depressurizing to allow injection and core cooling by the various sources of water.
- The design of the reactor coolant pumps eliminates the dependence on component cooling water and accompanying reactor coolant pump seal loss-of-coolant accident core damage contribution, which is typically significant for current plants.
- The design of the safety-related heat removal systems eliminates the dependence on service water and ac power during accidents; such dependencies can be significant contributors to core damage for current plants.

Core Damage Contribution from Important Initiating Events

Loss-of-Coolant Events. The at-power core damage results are dominated (top 8 dominant contributors with 93 percent) by various loss-of-coolant events. Thirty-four percent of the contribution is due to the safety injection line break, which is a special initiator, in that its occurrence partially defeats features incorporated into the plant to respond to losses of primary coolant. Even though the safety injection line break core damage frequency dominates the results, its value is very small (one event in 10 million reactor years), with little credit for nonsafety-related systems.

The conditional probability of core damage, given the occurrence of a “conventional” loss-of-coolant accident, is generally in the range of about $1\text{E-}03$ to $1\text{E-}05$ (with the exception of reactor vessel rupture and interfacing systems loss-of-coolant accident, for which core damage is assumed). These events have frequencies of about $1\text{E-}08$ per year to $5\text{E-}04$ per year. This indicates that the various features of the AP1000 would act to prevent core damage from all but between 1 in 1000 and 1 in 100,000 loss-of-coolant accidents. Since loss-of-coolant accidents are relatively rare events, this is a significant level of protection.

Anticipated Transients Without Scram. Anticipated transients without scram (ATWS) sequences contribute about 2 percent of the at-power core damage frequency, in part due to modeling simplifications whereby, in the absence of specific modeling and success criteria, it has been assumed that core damage will occur given certain combinations of failures. With additional analysis and modeling detail, it is expected that the anticipated transient without scram core damage frequency could be shown to be lower.

Transients. The contribution of transients to core damage frequency is about 5 percent of the at-power core damage frequency (total contribution from all transient initiators with reactor trip is 1 event in 100 million reactor years). This is the result of the defense-in-depth features of the AP1000 design, whereby core cooling following transients is available from main feedwater, startup feedwater, and passive residual heat removal, as well as from feed and bleed, using diverse and redundant sources of makeup (core makeup tanks, accumulators, in-containment refueling water storage tank, normal residual heat removal system), and of depressurization (four stages of automatic depressurization system).

Loss of Offsite Power. The loss of offsite power core damage frequency contribution at power is insignificant (less than 1 percent). AP1000 passive systems require only dc power provided by the long-term batteries for actuation to provide cooling. In addition, the passive residual heat removal heat exchanger is backed up by bleed and feed cooling using the automatic depressurization system and core makeup tanks or in-containment refueling water storage tank gravity injection, which also require only dc power provided by long-term batteries. With onsite power available, startup feedwater provides an additional means of decay heat removal.

Steam Generator Tube Rupture. The steam generator tube rupture event contributes about 3 percent of the at-power core damage frequency. Compared to operating pressurized water

reactors this is a very low contribution. Among the reasons for the small steam generator tube rupture core damage contribution are the following:

- The first line of defense is the startup feedwater system and chemical and volume control system
- A reliable safety-related passive residual heat removal system coupled with the core make-up tank subsystem, which provides automatic protection
- A third line of defense using automatic depressurization system and in-containment refueling water storage tank for accident mitigation should the above-mentioned systems fail.

Further, the automatic depressurization system provides a more reliable alternate decay heat removal path through feed and bleed than the high-pressure manual feed and bleed cooling of current operating plants.

Finally, the large capacity of the in-containment refueling water storage tank increases the long-term recovery probability for unisolable steam generator leaks that bypass containment, by preventing depletion of borated water and core damage.

Dependence on Operator Action

The results of the PRA show that the AP1000 is significantly less dependent on operator action to reduce plant risk to acceptable levels than are current plants. This was shown through the sensitivity analyses and the operator action contributions from both the risk decrease and risk increase measures. Almost all operator actions credited in this PRA are performed in the control room; there are very few local actions outside the control room. Further, the human actions modeled in the AP1000 PRA are generally simpler than those for current plants. Thus, the tasks for AP1000 operators are easier and less likely to fail. If it were assumed that the operators never perform any actions credited in the PRA, the internal events core damage frequency would still be lower than the result obtained for many current pressurized water reactors including operator actions.

Dominant System/Component Failure Contributors

Contribution to Core Damage Frequency. Component-related contributors to core damage frequency from internal events at power are dominated by common cause failures. The single component failures are limited to strainer or tank failures, and accumulator check valve failures.

Dependence on Component Reliability. Most of the component failures with relatively high risk increase worth are common cause failures. This is an indication of the high degree of built-in redundancy and diversity of AP1000 safety-related systems, particularly in view of the low baseline core damage frequency. The results demonstrate a well-balanced design, for which diversity eliminates the strong dependence on active valves or on the specific type of valve.

Sensitivity to Numerical Values and Modeling Assumptions. The core damage results are not strongly sensitive to increases in the failure probabilities of basic events. Check valves are relatively important; if the check valve failure probability is increased by a factor of 10, the core damage frequency increases by a factor of 4. This increase is not large, and the core damage goal of $1E-05$ is comfortably met. Finally, the modeling assumptions in system and accident sequence success criteria are bounding (e.g., conservative) whenever a range of conditions are represented by a single selected condition or success criterion. Since the modeling assumptions already represent an upper bound type estimate, there are no significant contributions to core damage due to conditions outside the assumed ranges that are unaccounted for. As an example, the automatic depressurization system success criteria for loss-of-coolant accident events are selected to cover the worst conditions (e.g., break size, break location) of the range.

System Reliability and Defense-in-Depth. The results show that the safety-related systems have demonstrated high reliabilities (e.g., failure probability in the range of $1E-05$ to $1E-03$), due to the nature of the system designs (passive systems). Moreover, multiple means of success exist for transients and credible loss-of-coolant accident events. This means that a failure of a safety-related system will not lead to core damage, because other diverse systems back up the first one. This defense-in-depth philosophy contributes to the low core damage frequency.

59.4 Large Release Frequency for Internal Initiating Events at Power

The results of the Level 2 (containment response) and Level 3 (plant risk) analyses for the internal initiating events at power demonstrate that the AP1000 containment design is robust in its ability to prevent releases following a severe accident and that the risk to the public due to severe accidents for AP1000 is very low. The large release frequency (containment failure frequency) of the AP1000 can be divided into two types of failures: 1) initially failed containment, in which the integrity of the containment is either failed due to the initiating event or never achieved from the beginning of the accident; and 2) containment failure induced by high-energy severe accident phenomena. The total of these failures is the overall large release frequency. The following summarizes important results of the containment event tree quantification with respect to large release frequency.

The overall release frequency for AP1000 is $1.95E-08$ events per year. This is approximately 8 percent of the core damage frequency for internal initiating events at power. The ability of the containment to prevent releases (i.e., the containment effectiveness) is 92 percent.

The Level 3 analysis shows that the resulting risk to the population is small and well within the established goals.

59.4.1 Dominant Large Release Frequency Sequences

The large release frequency is dominated by release categories BP (bypass), with a 54-percent contribution and CFE (early containment failure) with a contribution of 38 percent. The total frequency of these two categories is $1.8E-08$ events per year. These two categories make up 92 percent of the plant large release frequency, followed by 7.0 percent contribution from containment isolation failure category. Contributions of the late

containment failure (CFL) and intermediate containment failure (CFI) release categories to large release frequency are negligible.

The early containment failures are caused by sump flooding, vessel failure, and core reflooding failure plus containment overtemperature failure due to diffusion flame.

The dominant accident class in the large release frequency is the Class 6 with a 21-percent contribution. This class represents sequences in which steam generator tube rupture or interfacing LOCA events occur. It is followed by accident class 3A, with a 21 percent contribution. 3A contains core damage events with high RCS pressure and ATWS events.

The dominant large release frequency sequences are shown below. These sequences make up 98 percent of the large release frequency. Two containment bypass sequences from 3A and 6 accident classes contribute 21 percent and 19 percent, followed by 2 early containment failures from 3BE and 3D accident sequences with 14 and 11 percent contributions. These four sequences add up to 65 percent of the plant LRF.

| Dominant Containment Event Tree (CET) Sequences | | | | | |
|---|---------|-----|----------|-------|---|
| CET SEQ | REL CAT | PDS | FREQ | % | SEQUENCE DESCRIPTION |
| 23 | BP | 3A | 4.08E-09 | 20.9% | Containment Bypass |
| 23 | BP | 6 | 3.78E-09 | 19.4% | Containment Bypass |
| 21 | CFE | 2E | 2.67E-09 | 13.7% | Sump Flooding Fails |
| 21 | CFE | 3D | 2.05E-09 | 10.5% | Sump Flooding Fails |
| 23 | BP | 1A | 2.04E-09 | 10.5% | Containment Bypass |
| 10 | CFE | 3C | 9.97E-10 | 5.1% | Vessel Failure |
| 12 | CFE | 3D | 9.71E-10 | 5.0% | Core Reflooding Fails; Diffusion Flame |
| 23 | BP | 1P | 6.05E-10 | 3.1% | Containment Bypass |
| 22 | CI | 2L | 5.83E-10 | 3.0% | Containment Isolation Fails |
| 6 | CFE | 2E | 4.75E-10 | 2.4% | Hydrogen Igniters Fail; Early deflagration to detonation transition (DDT) |
| 22 | CI | 3D | 3.62E-10 | 1.9% | Containment Isolation Fails |
| 21 | CFE | 6 | 1.86E-10 | 1.0% | Sump Flooding Fails |
| 4 | CFI | 2E | 1.82E-10 | 0.9% | Hydrogen Igniters fail; Intermediate DDT |

59.4.2 Summary of Important Level 2 At-Power Results

The results of the PRA show that the following AP1000 design features provide the ability to respond to various severe accidents and contribute to a very small release frequency and a small release of radioactive material to the environment.

- The capability to flood the reactor cavity prevents the failure of the reactor vessel given a severe accident without water in the cavity. The vessel and its insulation are designed so that the water in the cavity is able to cool the vessel and prevent it from failing (in-vessel retention - IVR). By maintaining the vessel integrity, the core debris in the vessel eliminates the potential of a large release due to ex-vessel phenomena and its potential to fail the containment.
- The capability to depressurize the reactor coolant system in a high-pressure transient mitigates the consequences of a high-pressure severe accident. Such accidents have a large potential to fail the reactor coolant system pressure boundary vessel, piping, or steam generator tubes, and such a failure is assumed without further analysis if the reactor coolant system remains at high pressure. A high-pressure failure of the reactor coolant system pressure boundary is assumed to fail or bypass the containment. Thus, the capability to depressurize the reactor coolant system reduces the large release frequency due to high-pressure severe accidents.
- The annular spaces between the steel containment vessel and the shield building help to reduce the release of radioactive materials to the environment by enhancing the deposition of the materials before they exit the containment.

The Level 2 results highlight some insights in the AP1000 design:

- The containment effectiveness for AP1000 is over 90 percent, which provides an order of magnitude decrease from CDF to LRF. Since this result already includes CDF sequences that directly bypass the containment, the containment effectiveness for remaining sequences is actually much better. For example, for 5 (3BE, 3BL, 3BR, 3C, 3D) of the 9 accident classes studied, the containment effectiveness ranges from 90 to 99.8 percent.
- The containment effectiveness is lowest for the 3A accident class where the RCS pressure is high after core damage. The post-core-damage depressurization for this class proves to be ineffective since failure of ADS by common cause failures leading to core damage also causes failure of post-core-damage depressurization.
- Based on detailed analysis, the containment effectiveness for accident class 6, mainly SGTR events, is 56.9 percent, due to those sequences where the RCS pressure is low after the postulated core damage. In such sequences, the fission products can be retained in the pressure vessel, shielded by the water in the faulted steam generator. A sensitivity analysis where all accident class 6 events are assigned to LRF shows that the plant containment effectiveness drops slightly to 89.7 percent (from 91.9 percent). Thus, the LRF results are not very sensitive to the treatment of the SGTR events for LRF.
- A frequency of 1.0E-08/year has been assigned to the vessel failure initiating event (accident class 3C). In 90 percent of these events, the vessel is assumed to undergo failures that will be above the beltline – in which case the molten core could be cooled and containment would not be challenged. In the remaining 10 percent of the cases, the failure is assumed to be below the pressure vessel beltline, whereby the molten core would drop into the containment. In this case, it is conservatively assumed that the

containment would fail. A sensitivity analysis is made where by 100 percent of the failures would be below the beltline. The result shows that the containment effectiveness drops to 88.2 percent. This change is not significant, and the assumptions behind the case are very conservative.

- The LRF results are sensitive to failure of hydrogen igniters. If no credit is taken for hydrogen igniters, the containment effectiveness drops to 74 percent.
- However, LRF is not very sensitive to the reliability of hydrogen igniters; if IG reliability is assumed to be degraded (0.1) across the board for all accident classes, the containment effectiveness becomes 90.5 percent, which is an insignificant change from the base case.
- For accident classes 3D and 1AP, if the large hydrogen releases through the IRWST is conservatively assumed to cause containment failure, the containment effectiveness drops to 84.5 percent. The LRF increases to $7.58E-08$ /year. The increase is about a factor of 4 of the base. Such an increase is significant. This sensitivity analysis addresses the uncertainties in hydrogen mixing model for the case where the hydrogen is released into the IRWST and comes out from the IRWST vents above the operating deck.
- The LRF is dominated (53.9 percent) by containment failures or bypasses due to SGTR, and unmitigated high-RCS-pressure core damage sequences, classified as BP. The remaining containment failures are dominated by an early containment failure due to reactor cavity flooding failure.
- The LRF is not very sensitive to the reliability of PCS. If PCS reliability is assumed to be 0.001 across the board for all accident classes, the LRF becomes $1.97E-08$, which is an insignificant change from the base case.
- The LRF is sensitive to the operator action to flood the reactor cavity in a short time following core damage. This operator action has been moved to the beginning of Emergency Response Guideline (ERG) AFR.C-1 to increase its likelihood of success.
- The potential for a release of radioactive materials to the environment is very small. This is largely due to the very small core damage frequency and very small release frequency. The containment design provides enhanced deposition of core materials that could be released in a severe accident, and the passive containment cooling system minimizes the energy available to expel such materials from the containment.

The results of the at-power analyses show the AP1000 design includes redundancy and diversity not found in current plants. The safety-related passive systems do not require ac power or operator actions to actuate, and the plant design is robust in the prevention and mitigation of the consequences of an accident. The AP1000 core damage frequency and large release frequency are much lower than has been seen in current generation plants, despite the many conservatisms built into the PRA models. The assumed dose to the environment given a severe accident and a large release is well within the goals set for that analysis.

59.5 Core Damage and Severe Release Frequency from Events at Shutdown

59.5.1 Summary of Shutdown Level 1 Results

As shown by the dominant cutsets of the AP600 and AP1000 shutdown models (shutdown risk evaluation is presented in Chapter 54), the risk profiles of these plants for events during shutdown conditions are almost identical. The results indicate that the three events dominating the CDF are loss of component cooling/service water during drained condition, loss of offsite power during drained condition, and loss of RNS during drained condition. The AP1000 and AP600 initiating event core damage contributions are included in Chapter 54. This data shows the initiating event importance to be similar for the two plants.

The dominant sequences are described in the subsections that follow. The 12 dominant accident sequences comprise 77 percent of the level 1 shutdown core damage frequency. These dominant sequences consist of:

- Loss of component cooling or service water system initiating event during drained condition with a contribution of 64 percent of the CDF
- Loss of RNS initiating event during drained condition with a contribution of 6 percent of the CDF
- Loss of offsite power initiating event during drained condition with a contribution of 5 percent of the CDF
- RCS overdraining event during drainage to mid-loop with a contribution of a 2 percent of the CDF

Loss of Component Cooling or Service Water System Initiating Event During Drained Condition

These sequences are described as the loss of decay heat removal initiated by failure of the component cooling water or service water system during drained condition. The loss of decay heat removal occurs following loss of circulating water system (CWS) or service water system (SWS) during mid-loop/vessel flange operation, which has an estimated duration of 120 hours per 18 months refueling.

The major contributors to risk due to loss of CWS or SWS during drained condition are the following failures:

- Hardware failures of both service water pumps or common cause failure of output logic inputs/outputs (I/Os) from the plant control system (PLS)
- Common cause failure of the ADS 4th stage squib valves
- Common cause failure of the IRWST high-pressure squib valves

- Common cause failure of the strainers in the IRWST tank
- Common cause failure of the recirculation sump strainers

Loss of RNS Initiating Event During Drained Condition

This sequence is described as the loss of decay heat removal initiated by failure of the RNS during drained condition. The loss of decay heat removal occurs following loss of RNS during mid-loop/vessel flange operation, which has an estimated duration of 120 hours per 18 months refueling.

The major contributors to risk due to loss of RNS during drained condition are the following failures:

- Common cause failure of the RNS pumps to run
- Common cause failure of the ADS 4th stage squib valves
- Common cause failure of the IRWST injection squib valves
- Common cause failure of the strainers in the IRWST tank
- Common cause failure of the recirculation sump strainers

Loss of Offsite Power Initiating Event During Drained Condition (with failure of grid recovery within 1 hour)

This sequence is initiated by loss of offsite power during mid-loop/vessel flange operation, which has an estimated duration of 120 hours per 18 months refueling. Following this initiating event, the RNS does not restart automatically, and the grid is not recovered within 1 hour.

The major contributors to risk given loss of offsite power (without grid recovery) are the following failures:

- Software common cause failure of all cards
- Failure of the RNS pump to run or restart
- Failure of the diesel generator to start or run
- Failure of the main breaker to open
- Failure to recover ac power within 1 hour
- Common cause failure of the ADS 4th stage squib valves
- Common cause failure of the IRWST injection squib valves
- Common cause failure of the strainers in the IRWST tank
- Common cause failure of the recirculation sump strainers

Loss of Offsite Power Initiating Event During Drained Condition (with success of grid recovery within 1 hour)

This sequence is initiated by loss of offsite power during mid-loop/vessel flange operation which has an estimated duration of 120 hours per 18 months refueling. Following this

initiating event, the RNS does not restart automatically, the grid is recovered within 1 hour but manual RNS restart after grid recovery fails.

The major contributors to risk, given loss of offsite power (with grid recovery), are the following failures:

- Software common cause failure of all cards
- Failure of the RNS pump to run or restart
- Common cause failure of the ADS 4th stage squib valves
- Common cause failure of the IRWST injection squib valves
- Common cause failure of the strainers in the IRWST tank
- Common cause failure of the recirculation sump strainers

RCS Overdraining Event During Drainage to Mid-loop

This sequence is described as RCS overdraining initiating event during drainage to mid-loop condition; draining to mid-loop has an estimated duration of 39 hours per 18 months refueling. Following the initiating event, manual isolation of the RNS fails.

The major contributors to risk due to RCS overdraining are the following failures:

- Common cause failure of the CVS air-operated valves to close automatically upon receipt of low hot leg level signals and failure of the operator to stop draining
- Operator fails to isolate the RNS
- Common cause failure of the ADS 4th stage squib valves
- Operator fails to open IRWST injection squib valves
- Common cause failure of the strainers in the IRWST tank
- Common cause failure of the recirculation sump strainers

Conclusions

The conclusions drawn from the shutdown Level 1 study are as follows:

- The overall shutdown core damage frequency is very small (1.23E-07/year).
- Initiating events during reactor coolant system drained conditions contribute approximately 90 percent of the total shutdown core damage frequency. Loss of decay heat removal capability (during drained condition) due to failure of the component cooling water system or service water system are the initiating events with the greatest contribution (approximately 70 percent of the shutdown core damage frequency).
- Common cause failures of in-containment refueling water storage tank components contribute approximately 59 percent of the total shutdown core damage frequency.

Common cause failure of the in-containment refueling water storage tank valves contributes approximately 33 percent of the total shutdown core damage frequency.

- Common cause failures of the automatic depressurization system stage 4 squib valves contribute approximately 18 percent to the total shutdown core damage frequency. The function of the automatic depressurization system is important to preclude the effects of surge line flooding. This indicates that maintaining the reliability of the automatic depressurization system is important.
- Common cause failures of the containment sump recirculation squib valves contribute approximately 15 percent to the total shutdown core damage frequency. This function is important during drained conditions. This indicates that maintaining the reliability of the recirculation line squib valves is important.
- Human errors are not overly important to shutdown core damage frequency. There is no particular dominant contributor. Sensitivity results show that the shutdown core damage frequency would remain very low even with little credit for operator actions.

One action, operator failure to recognize the need for reactor coolant system depressurization during safe/cold shutdown conditions, is identified as having a significant risk increase value. This indicates it is important that the procedures include this action and the operators understand and are appropriately trained for it.

- Individual component failures are not significant contributors to shutdown core damage frequency, and there is no particular dominant contributor. This confirms the at-power conclusion that single independent component failures do not have a large impact on core damage frequency for AP1000 and reflects the redundancy and diversity of protection at shutdown as well.
- The in-containment refueling water storage tank provides a significant benefit during shutdown because it serves as a passive backup to the normal residual heat removal system.

59.5.2 Large Release Frequency for Shutdown and Low-Power Events

The baseline PRA shutdown large release frequency for AP600 was calculated to be $1.5E-08$ per reactor-year, associated with a shutdown CDF of $9.0E-08$ per year. The AP1000 LRF is estimated to be $2.05E-08$ per year, with the same risk profile as that of AP600 (see Table 19.59-15). This LRF compares well with the at-power LRF of $1.95E-08$ per year.

59.5.3 Shutdown Results Summary

The results of the low-power and shutdown assessment show that the AP1000 design includes redundancy and diversity at shutdown not found in current plants. In particular, the in-containment refueling water storage tank provides a unique safety backup to the normal residual heat removal system. Maintenance at shutdown has less impact on the defense-in-depth features for AP1000 than for current plants. In accordance with plant technical specifications, safety-related system planned maintenance is performed only during

those shutdown modes when the protection provided by the safety-related system is not required. Further, maintenance of nonsafety systems, such as the normal residual heat removal system, component cooling water system, and service water system, is performed at power to avoid adversely affecting shutdown risk. These contribute to the extremely low shutdown core damage and the small release frequency.

59.6 Results from Internal Flooding, Internal Fire, and Seismic Margin Analyses

59.6.1 Results of Internal Flooding Assessment

A scoping internal flooding analysis was performed based on AP1000 design information, with conservative assumptions or engineering judgement used for simplifying the analysis.

The AP1000 design philosophy of minimizing the number of potential flooding sources in safety-related areas, along with the physical separation of redundant safety-related components and systems from each other and from nonsafety-related components, minimizes the consequences of internal flooding. The core damage frequencies from flooding events at power is not an appreciable contributor to the overall AP1000 core damage frequency. The internal flooding-induced core damage frequencies are estimated to be $8.8\text{E-}10$ events per year for power operations.

The internal flooding analysis conservatively assumes that flooding of nonsafety-related equipment results in system failure of the affected system. As shown in AP600 PRA, this results in a higher flooding-induced core damage frequency at shutdown than at power, because of the use of the nonsafety-related normal residual heat removal system as the primary means of decay heat removal at shutdown.

The top five at-power flooding scenarios comprise 91 percent of the at-power flooding-induced core damage frequency. Each of these scenarios relate to large pipe breaks in the turbine building with an initiating event frequency in the range of $1.4 - 2.0\text{E-}03/\text{year}$, leading to a loss of CCS/SWS event. Each scenario has a CDF of $1.2 - 1.8\text{E-}10/\text{year}$.

Internal flooding events during shutdown operations are also evaluated. A quantitative internal flooding PRA of AP1000 design performed to estimate plant CDF and LRF for at-power and during low-power and shutdown events provided the following results:

| | Plant CDF | Plant LRF |
|--|-----------------------------|-----------------------------|
| Internal Flooding During At-Power Events | $8.82\text{E-}10/\text{yr}$ | $7.14\text{E-}11/\text{yr}$ |
| Internal Flooding During Low-Power and Shutdown Events | $3.22\text{E-}09/\text{yr}$ | $5.37\text{E-}10/\text{yr}$ |

The minimization of potential flooding sources in the safety-related areas, in addition to the physical separation of redundant safety-related components and systems from each other and from nonsafety-related components, reduces the consequences of internal flooding. The core damage and large release frequencies arising from flooding events during shutdown operations are not appreciable contributors to overall AP1000 risk.

59.6.2 Results of Internal Fire Assessment

The total at-power, fire-induced core damage frequency is $5.61\text{E-}08$ per reactor year. The estimated LRF is $4.54\text{E-}09/\text{yr}$. Results of the AP1000 fire PRA analysis are summarized below.

The estimated core damage frequency from main control room fires at power is insignificant (less than $3.18\text{E-}12$ per year). This low contribution is a result of the following:

- The ignition frequency is low because of the use of low-voltage 48v 10 mA dc cables in the control room. These low-voltage cables do not produce enough energy to heat the cables, thus ignition is not probable.
- Redundancy in control room operations is available within the control room itself; that is, if control room evacuation is not required, there is at least one other means available within the control room to shut down and control the plant.
- If control room evacuation is necessary, the remote shutdown workstation provides complete redundancy in terms of control for safe shutdown functions.
- Loss of control of one division of power or for a whole system is not risk-significant. In addition, the passive systems are designed to operate without the need for operator interaction. Therefore, operator actions that might be disrupted by the fire scenario are backup actions, and are not significant for AP1000.

The results of the internal fire evaluation indicate that the plant's system and layout promote a low fire-induced core damage frequency compared with existing plants. Also, the results indicate that, when nonsafety-related systems are not credited and containment is treated as a special case, the fire-induced core damage frequency profile is relatively flat (i.e., no fire area is significantly more important than others).

The results from the AP1000 fire analysis confirm that the inherent design characteristics of the AP1000 also provide an effective barrier against fire hazards. This is true even within the pessimistic assumptions used throughout the study.

Conservatisms employed in the AP1000 fire analysis included the following:

- In order to minimize potential uncertainty in the results arising from the lack of as-built equipment location and cable routing information, a bounding approach to quantification was taken in accordance with the reference methodology.
- A fire originating from any ignition source in an area is assumed to disable all equipment located in the fire area. The historical evidence indicates that most fires are localized fires with limited severity.
- An assumed total at-power fire initiating event frequency corresponding to about one fire with significant consequences every 4 reactor years, well in excess of current plant experience and of that anticipated for AP1000, was assumed.

- Manual fire suppression is not credited to limit the extent of damage in an area nor to prevent fire propagation to an adjoining area. Historical evidence indicates that the majority of suppressed fires were manually suppressed with little or no additional damage.
- The assumption was made that a single hot short could result in spurious automatic depressurization system actuation.
- The estimation of containment fire frequency, not normally included in fire risk assessments, was done by making a conservative interpretation of the limited available data.

Because the approach taken in performing the internal fire analysis makes various conservative assumptions and is bounding, the results of uncertainty, sensitivity, or importance analyses would be biased. Therefore, these analyses were not performed based on the judgement that they would be of little value in providing additional insights to determine whether fire vulnerabilities exist for beyond-design-basis fires.

The major reasons for the AP1000's relatively low overall fire-induced core damage frequency, even on a bounding basis, include the following:

- The fire protection design provides, to the extent possible, separation of the alternate safety-related shutdown components and cabling using 3-hour-rated fire barriers. For example, areas containing safety-related cabling or components are physically separated from one another and from the areas that do not contain any safety-related equipment by 3-hour-rated fire barriers. This defense-in-depth feature diminishes the probability of a fire to impact more than one safety-related shutdown system.
- Since the passive safety-related systems do not require cooling water or ac power, they are less susceptible to being unavailable due to a fire than currently operating plants' active safe shutdown equipment. As a result, the impact of fires on the shutdown capability is significantly reduced compared to current plants.

The results of this analysis show that the AP1000 design is sufficiently robust that internal fires during either power operation or shutdown do not represent a significant contribution to core damage frequency.

59.6.3 Results of Seismic Margin Analysis

The seismic margin analysis (SMA) shows the systems, structures, and components required for safe shutdown. The high confidence, low probability of failure (HCLPF) values are greater than or equal to 0.50g. This HCLPF is determined by the seismically induced failure of the fuel in the reactor vessel, core assembly failures, IRWST failure, or containment interior failures. The SMA result assumes no credit for operator actions at the 0.50g review level earthquake, and assumes a loss of offsite power for all sequences.

The seismic margin analysis shows the plant to be robust against seismic event sequences that contain station blackout coupled with other seismic or random failures. The analysis also

shows the plant's capability to respond to seismic events without benefit of the operators' actions.

59.7 Plant Dose Risk From Release of Fission-Products

Chapter 49 discusses the Level 3 results for at-power and shutdown internal events. The dose risks are quantified by multiplying the fission product release category frequency vector by the release category mean dose vectors. The goal is that a 24-hour, whole-body, site boundary dose greater than 25 rem has a frequency (large release frequency) of less than 1E-06 per year. The AP1000 large release frequency is 1.95E-08 per year, which is a factor of 50 times less than the goal.

The total at-power risk from a postulated release of fission products (the 24-hour, site boundary effective dose equivalent (EDE) is 1.83E-04 rem per reactor-year. For shutdown, this risk was calculated to be 7.1E-05 rem per reactor-year for AP600. For AP1000, this shutdown risk could be estimated as 9.7E-05 rem per reactor-year (estimated the same way as shutdown LRF in Table 59-15). Table 59-16 and Figure 59-2 summarize the plant dose results.

Containment bypass failures account for 79 percent of the dose risk. These types of failures are usually assumed as a result of steam generator tube rupture. A less conservative analysis of the containment bypass failures may show a smaller frequency, and, as a result, a smaller dose risk.

59.8 Overall Plant Risk Results

The total plant risk expressed in terms of plant core damage frequency and severe release frequency for all events studied in this PRA are summarized in Table 59-17.

The contribution of various events to the at-power core damage frequency is shown in Figure 59-1.

The total plant core damage and large release frequency analysis results show the following:

- The total mean core damage frequency is at least two orders of magnitude smaller than those for existing pressurized water reactors. The cumulative core damage probability for a population of 50 AP1000 units operating for 60 years each would be less than 0.001, which is a low probability of occurrence.
- The total plant severe release frequency is another order of magnitude smaller than that of the core damage frequency; that places such a release frequency in the range of incredible events.
- A bounding analysis of the core damage due to internal fire and internal flooding events shows that these two categories of internal events are lower for AP1000 than are calculated for currently operating plants.

- The severe release frequency is about equal for at-power and shutdown events. The severe release frequency as a percentage of core damage frequency is 8 percent for at-power events and 17 percent for shutdown events.
- The results show that the design goals of low core damage frequency and low severe release frequency have been met. The AP1000 frequencies are lower than the Nuclear Regulatory Commission (NRC) goals set for new plant designs, as shown in Table 59-17. These results show the effectiveness of passive systems in mitigating severe accidents and reflect the reduced dependence of AP1000 on nonsafety systems and human actions.

Figure 59-2 shows the 24-hour, whole-body EDE site boundary dose cumulative distribution.

59.9 Plant Features Important to Reducing Risk

Westinghouse used PRA results extensively in the AP1000 design process to identify areas for design improvement and areas for further risk reduction. These results were also compared with existing commercial nuclear power plants to identify additional area of risk reduction. Examples of the more significant AP1000 plant features and operator actions that reduce risk are discussed in this section. Examples are provided in the area of reactor design, system design, plant structures and layout, and containment design.

AP1000 has more lines of defense as compared to current operating plants, which provide more success paths following an initiating event and provide redundancy and diversity to address common cause-related concerns. Examples of extensive AP1000 lines of defense follow:

- Criticality control:
 - Control rod insertion via reactor trip breaker opening
 - Control rod insertion via motor-generator set de-energization
 - Ride out via turbine trip
- Core heat removal:
 - Main feedwater
 - Startup feedwater
 - Passive residual heat removal
 - Automatic depressurization system and feed-and-bleed via normal residual heat removal injection
 - Automatic depressurization system and passive feed-and-bleed via in-containment refueling water storage tank injection

- Reactor coolant system makeup:
 - Chemical and volume control system
 - Core makeup tanks
 - Automatic depressurization system and normal residual heat removal
 - Automatic depressurization system, accumulators, and in-containment refueling water storage tank injection
 - Automatic depressurization system, core makeup tanks, and in-containment refueling water storage tank injection
- Containment cooling:
 - Fan coolers
 - Normal residual heat removal
 - Passive containment cooling system with passive water drain
 - Passive containment cooling system with alternate water supply
 - Passive containment cooling system without water (air only)
 - Fire water

59.9.1 Reactor Design

The AP1000 reactor coolant system has many features that reduce the plant risk profile. The pressurizer is larger than those used in comparable current operating plants, resulting in a longer drainage time during small loss-of-coolant accident events. The larger pressurizer increases transient operation margins, resulting in a more reliable plant with fewer reactor trips, avoiding challenges to the plant and operator during transients. The larger pressurizer also eliminates the need for fast-acting power-operated relief valves (PORVs), which are a possible source of reactor coolant system leaks.

The AP1000 steam generators have large secondary-side water inventories, allowing significant time to recover steam generator feedwater or other means of core heat removal. The AP1000 steam generators also employ improved materials and design features that significantly reduce the probability of forced outages or tube rupture.

The AP1000 has canned reactor coolant pumps, thus avoiding seal loss-of-coolant accident issues and simplifying the chemical and volume control system. The reactor coolant system has fewer welds, which reduces the potential for loss-of-coolant accident events. The probability of a loss-of-coolant accident is also reduced by the application of “leak-before-break” to reactor coolant system piping.

59.9.2 Systems Design

System design aspects that are intended to reduce plant risk are discussed in terms of safety-related and nonsafety-related systems.

59.9.2.1 Safety-Related Systems

The AP1000 uses passive safety-related systems to mitigate design basis accidents and reduce public risk. The passive safety-related systems rely on natural forces such as density differences, gravity, and stored energy to provide water for core and containment cooling. These passive systems do not include active equipment such as pumps. One-time valve alignment of safety-related valves actuates the passive safety-related systems using valve operators such as:

- DC motor-operators with power provided by Class 1E batteries
- Air-operators that reposition to the safeguards position on a loss of the nonsafety-related compressed air that keeps the safety-related equipment in standby
- Squib valves
- Check valves

The passive systems are designed to function with no operator actions for 72 hours following a design basis accident. These systems include the passive containment cooling system and the passive residual heat removal system.

Diversity among the passive systems further reduces the overall plant risk. An example of operational diversity is the option to use passive residual heat removal versus feed-and-bleed for decay heat removal functions, and an example of equipment diversity is the use of different valve operators (motor, air, squib) to avoid common cause failures.

The passive residual heat removal heat exchanger protects the plant against transients that upset the normal steam generator feedwater and steam systems. The passive residual heat removal subsystem of the passive core cooling system contains no pumps and significantly fewer valves than conventional plant auxiliary feedwater systems, thus increasing the reliability of the system. There are fewer potential equipment failures (pumps and valves) and less maintenance activities.

For reactor coolant system water inventory makeup during loss-of-coolant accident events, the passive core cooling system uses three passive sources of water to maintain core cooling through safety injection: the core makeup tanks, accumulators, and in-containment refueling water storage tank. These sources are directly connected to two nozzles on the reactor vessel so that no injection flow can be spilled for larger pipe break events.

The automatic depressurization system is incorporated into the design for depressurization of the reactor coolant system. The automatic depressurization system has 10 paths with diverse valves to avoid common cause failures and is designed for automatic or manual actuation by the protection and safety monitoring system or manual actuation by the diverse actuation system. The automatic depressurization system can be used in a partial depressurization mode to provide long-term reactor coolant system cooling with normal residual heat removal system injection, or it can be used in full depressurization mode for passive in-containment

refueling water storage tank injection for long-term reactor coolant system cooling. Switchover from injection to recirculation is automatic without manual actions.

The safety-related Class 1E dc and UPS system has a battery capacity sufficient to support passive safety-related systems for 72 hours. This system has four 24-hour batteries, two 72-hour batteries, and a spare battery. The presence of the spare battery improves testability.

The passive containment cooling system provides the safety-related ultimate heat sink for the plant. Heat is removed from the containment vessel following an accident by a continuous natural circulation flow of air, without any system actuations. By using the passive containment cooling system following an accident, the containment stays well below the predicted failure pressure. The steaming and condensing action of the passive containment cooling system enhances activity removal.

AP1000 containment isolation is significantly improved over that of conventional PWRs due to a large reduction in the number of penetrations. The number of normally open penetrations is reduced. Containment isolation is improved due to the chemical and volume control system being a closed system, the safety-related passive safety injection components being located inside the containment, and the number of heating, ventilation, and air-conditioning (HVAC) penetrations being reduced (no maxi purge connection).

Vessel failure potential upon core damage is reduced (in-vessel retention of the damaged core) by providing a provision to dump in-containment refueling water storage tank water into the reactor cavity. The vessel insulation enables this water to cool the vessel.

For events at shutdown, AP1000 has passive safety-related systems for shutdown conditions as a backup to the normal residual heat removal system. This reduces the risk at shutdown through redundancy and diversity.

Post-72-hour connections are incorporated into the passive system design to allow for long-term accident management. These connections allow for the refill of the in-containment refueling water storage tank, or the reactor cavity, should such actions become necessary.

59.9.2.2 Nonsafety-Related Systems

AP1000 has nonsafety-related systems capable of mitigating accidents. These systems use redundant components, which are powered by offsite and onsite power supplies. AP1000 has certain design features in the nonsafety-related systems to reduce plant risk compared to current operating plants. During transient events, the startup feedwater system can act as a backup to the main feedwater system if the latter is unavailable due to the nature of the initiating event or fails during the transient. During loss of ac power events, startup feedwater pumps are powered by the diesel generators and can be used to remove decay heat since main feedwater is not available. The main feedwater and startup feedwater pumps are motor-driven, rather than steam-driven, for better reliability. Main feedwater controls are digital for better reliability. Thus, the main feedwater and startup feedwater system creates fewer transients and provides additional nonsafety-related means for decay heat removal for transients. This makes the plant response to transients very robust due to the existence of

two nonsafety-related systems in addition to the passive safety-related means of removing decay heat.

The nonsafety-related normal residual heat removal system plays a role in decay heat removal in response to power and shutdown events. The normal residual heat removal system has additional isolation valves and is designed to withstand the reactor coolant system pressure to eliminate interfacing systems loss-of-coolant accident concerns that lead to containment bypass. The normal residual heat removal system provides reliable shutdown cooling, incorporating lessons learned from shutdown events. During mid-loop operations, operation procedures require both normal residual heat removal system pumps to be operable for risk reduction.

Component cooling water and service water systems have a very limited role in the plant risk profile because the passive safety-related systems do not require cooling, and the canned-motor reactor coolant pumps do not require seal cooling from the component cooling water.

The nonsafety-related ac power system (onsite and offsite) also has a very limited role in the plant risk profile since the plant safety-related systems do not depend on ac power. The loss of offsite power event is less important for the AP1000 than in current operating plants. The plant has full load rejection capability to minimize the number of reactor trips although this is not modeled in the PRA and no credit is taken for it. The onsite ac power has two nonsafety-related diesel generators. The diesel generator life is improved and the run failure rate is reduced by avoiding fast starts.

The compressed and instrument air system has low risk importance since the safety-related air-operated valves are fail safe if the air system fails. This causes the loss of air event to be less important than in current plant PRAs.

59.9.3 Instrumentation and Control Design

Three instrumentation and control systems are modeled in the AP1000 PRA: protection and safety monitoring system, plant control system, and diverse actuation system. Both the protection and safety monitoring system and plant control system are microprocessor-based. Four trains of redundancy are provided for the protection and safety monitoring system; 2-out-of-4 actuation logic in the protection and safety monitoring system reduces the potential for spurious trips due to testing and allows for better testing. Automatic testing for the protection and safety monitoring system, and diagnostic self-testing for the protection and safety monitoring system and the plant control system, provide higher reliability in these systems. Both the protection and safety monitoring system and the plant control system use fiber-optic cables (with fire separation) for data transmission. Unlike current plants, there is no cable spreading room, thus eliminating a potential fire hazard. Additional fault tolerance is built into the plant control system so that one failure does not prevent the operation of important functions.

Improvements in the plant control system and the protection and safety monitoring system are coupled with an improved control room and man-machine interfaces; these include improvements in the form and contents of the information provided to control room operators

for decision making to limit commission errors. In addition, the remote shutdown workstation is designed to have functions similar to the control room.

The diverse actuation system provides a diverse automatic and manual backup function to the protection and safety monitoring system and reduces risk from anticipated transients without scram events. The diverse actuation system also compensates for common cause failures in the protection and safety monitoring system.

59.9.4 Plant Layout

The plant layout minimizes the consequences of fire and flooding by maximizing the separation of electrical and mechanical equipment areas in the non-radiologically controlled area of the auxiliary building. This separation is designed to minimize the potential for propagation of leaks from the piping areas and the mechanical equipment areas to the Class 1E electrical and Class 1E instrumentation and control equipment rooms. The potential flooding sources and volumes in areas of the plant that contain safety-related electrical and I&C equipment are limited to minimize the consequences of internal flooding.

AP1000 is designed to provide better separation between divisions of safety-related equipment.

59.9.5 Containment Design

The containment pressure boundary is the final barrier to the release of fission products to the environment. The AP1000 containment has provisions that help to maintain containment integrity in the event of a severe accident.

59.9.5.1 Containment Isolation and Leakage

Failure of the containment isolation system prior to a severe accident will lead to a direct release pathway from the containment volume to the environment. AP1000 has approximately 55 percent fewer piping penetrations and a lower percentage of normally open penetrations compared to current generation plants. Normally open penetrations are closed by automatic valves, and diverse actuation is provided for valves on penetrations with significant leakage potential. All isolation valves have control room indication to inform the operator of the current valve position.

Similarly to containment isolation failure, leakage of closed containment isolation valves in excess of technical specifications may result in larger releases to the environment. Valves that historically have the greatest leakage problems have been eliminated, or their number significantly reduced in the design. Large purge valves have been replaced by smaller more reliable valves, and check valves have only been used in mild service where wear and service conditions would not be a challenge to successful operation.

Equipment and personnel hatches have the capability of being tested individually to ensure a leak-tight seal. Hatch seals can easily be verified.

Therefore, AP1000 provides significant protection against the failure to isolate the containment and against failure of isolation valves to fully close.

59.9.5.2 Containment Bypass

Historically, containment bypass, an accident in which the fission products are released directly to the environment from the reactor coolant system, is the leading contributor to risk in a nuclear power plant. Typically the containment bypass accident class consists of two types of accident sequences: interfacing systems loss-of-coolant accidents and steam generator tube ruptures.

An interfacing systems loss-of-coolant accident is the failure of valves that separate the high pressure reactor coolant system with a lower pressure interfacing system, which extends outside the containment pressure boundary. The failure of the valve causes the reactor coolant system to pressurize the interfacing system beyond its ultimate capacity and can result in a loss-of-coolant accident outside the containment. Reactor coolant is lost outside the containment, providing a pathway for the direct release of fission products to the environment. In AP1000, systems connected to the reactor coolant system are designed with higher design pressure, which reduces the likelihood of a pipe rupture in the event of the failure of the interfacing valves. This results in a very low interfacing systems loss-of-coolant-accident contribution to core damage to containment bypass.

Steam generator tube ruptures release coolant from the reactor coolant system to the secondary system. The AP1000 has multiple and diverse automatically actuated systems to reduce the reactor coolant system pressure and mitigate the steam generator tube rupture. The passive residual heat removal subsystem is actuated automatically on the S-signal and effectively reduces the reactor coolant system pressure to stop the break flow. If the passive residual heat removal does not stop the loss of coolant, the secondary relief valve can open to keep the secondary system pressure below the opening pressure of the steam generator safety valve. If the loss of reactor coolant continues, the RCS automatic depressurization system will actuate and depressurize the system. No operator actions are required to mitigate the accident, and the secondary system remains sealed against releases to the environment after the relief valve or its block valve are closed.

To create a containment bypass release pathway from a steam generator tube rupture, the accident scenario must include multiple system failures such that the steam generator tube rupture is not mitigated, and the secondary system pressure increases enough to open a safety valve. The safety valve must fail to reseal, thereby providing a containment bypass pathway for the loss of coolant and for the possible release of fission products to the environment.

Multiple, diverse systems act to mitigate steam generator tube rupture. Therefore, the likelihood of a steam generator tube rupture progressing to containment bypass has been significantly reduced in AP1000.

59.9.5.3 Passive Containment Cooling

The passive containment cooling system provides protection to the containment pressure boundary by removing the decay and chemical heat that slowly pressurize the containment.

The heat is transferred to the environment through the steel pressure boundary. The heat transfer on the outside of the steel shell is enhanced by an annular flow path, which creates a convective air flow across the shell and by the evaporation of water that is directed onto the top of the containment in the event of an accident. The evaporative heat transfer prevents the containment from pressurizing above the design conditions during design basis accidents.

In some postulated multiple-failure accident scenarios, the water flow may fail. The heat removal is limited to convection heat transfer to the air flow and radiation to the annulus baffle. With no water film on the containment shell to provide evaporative cooling, the containment pressurizes above the design pressure to remove decay heat. Containment failure within 24 hours is highly unlikely.

59.9.5.4 High-Pressure Core Melt Scenarios

The automatic depressurization system and the passive residual heat removal heat exchanger provide reliable and diverse reactor coolant system depressurization, which significantly reduces the likelihood of high pressure core damage. High-pressure core damage sequences have the potential to fail steam generator tubes and create a containment bypass release, or to cause severe accident phenomena at the time of vessel failure which may threaten the containment pressure boundary. Reducing the reactor coolant system pressure during a severe accident significantly lowers the likelihood of phenomena that may induce large fission product releases early in the accident sequence.

59.9.5.5 In-Vessel Retention of Molten Core Debris

The AP1000 reactor vessel and containment configuration has features that enhance the design's ability to maintain molten core debris in the reactor vessel. The AP1000 automatic depressurization system provides reliable pressure reduction in the reactor coolant system to reduce the stresses on the vessel wall. The reactor vessel lower head has no vessel penetrations, thus eliminating penetration failure as a potential vessel failure mode. The containment configuration directs water to the reactor cavity and allows the in-containment refueling water storage tank water to be drained into the cavity to submerge the vessel to cool the external surface of the lower head. Cooling the vessel and reducing the stresses prevents the creep rupture failure of the vessel wall. The reactor vessel reflective insulation has been designed with provisions to allow water inside the insulation panel to cool the vessel surface, and with vents to allow steam to exit the insulation without failing the insulation support structures. The insulation is designed so that it promotes the cooling of the external surface of the vessel.

Preventing the relocation of molten core debris to the containment eliminates the occurrence of several severe accident phenomena, such as ex-vessel fuel-coolant interactions and core-concrete interaction, which may threaten the containment integrity. Through the prevention of core debris relocation to the containment, the AP1000 design significantly reduces the likelihood of containment failure.

59.9.5.6 Combustible Gases Generation and Burning

In severe accident sequences, high temperature metal oxidation, particularly zirconium, results in the rapid generation of hydrogen and possibly carbon monoxide. The first combustible gas release occurs in the accident sequence during core uncover when the oxidation of the zircaloy cladding by passing steam generates hydrogen. A second release may occur if the vessel fails and ex-vessel debris degrades the concrete basemat. Steam and carbon dioxide are liberated from the concrete and are reduced to hydrogen and carbon monoxide as they pass through the molten metal in the debris. These gases are highly combustible and in high concentrations in the containment may lead to detonable mixtures.

The AP1000 uses a nonsafety-related hydrogen igniter system for severe releases of combustible gases. The igniters are powered from ac buses from either of the nonsafety-related diesel generators or from the non-Class 1E batteries. Multiple glow plugs are located in each compartment. The igniters burn the gases at the lower flammability limit. At this low concentration, the containment pressure increase from the burning is small and the likelihood of detonation is negligible. The igniters are spaced such that the distance between them will not allow the burn to transition from deflagration to detonation. The combustible gases are removed with no threat to the containment integrity.

There is little threat of the failure of the system power in the event that it is required to operate. The igniters are needed only in core damage accidents, and the AP1000 is designed to mitigate loss of power events without the sequence evolving into a severe accident. Loss of ac power is a small contributor to the core damage frequency.

The reliability of reactor coolant system depressurization reduces the threat to the containment from sudden releases of hydrogen from the reactor coolant system. Low pressure release of in-vessel hydrogen enhances the ability of the igniter system to maintain the containment atmosphere at the lower flammability limit.

During a severe accident, hydrogen that could be injected from the reactor coolant system into the containment through the spargers in the in-containment refueling water storage tank or into the core makeup tank room has the potential to produce a diffusion flame. A diffusion flame is produced when a combustible gas plume that is too rich to burn enters an oxygen-rich atmosphere and is ignited by a glow plug or a random ignition source. The plume is ignited into a standing flame which lasts as long as there is a fuel source. Via convection and radiation, the flame can heat the containment wall to high temperatures, increasing the likelihood of creep rupture failure of the containment pressure boundary. The AP1000 uses a defense-in-depth approach to release hydrogen in benign locations away from the containment shell and penetrations. Therefore, the potential for containment failure from the formation of a diffusion flame at the in-containment refueling water storage tank vents is considered to be very low.

There is little threat to the containment integrity from severe accident hydrogen releases, and hydrogen combustion events. The igniter system maintains the hydrogen concentration at the lower flammability limit.

59.9.5.7 Intermediate and Long-Term Containment Failure

The passive containment cooling system reduces the potential for decay heat pressurization of the containment. However, containment failure can also occur as a result of combustion. Due to the high likelihood of in-vessel retention of core debris, the potential for ex-vessel combustible gas generation from core-concrete interaction is very low. The frequency of containment failures due to hydrogen combustion events is very low given the high reliability of the hydrogen igniters.

59.9.5.8 Fission-Product Removal

AP1000 relies on the passive, natural removal of aerosol fission products from the containment atmosphere, primarily from gravitational settling, diffusiophoresis and thermophoresis. Natural removal is enhanced by the passive containment cooling system, which provides a large, cold surface area for condensation of steam. This increases the diffusiophoretic and thermophoretic removal processes. Accident offsite doses at the site boundary that could exist in the first 24 hours after a severe accident are either less than 25 rem, or for those releases that are greater than 25 rem, have a frequency of much less than 1E-06. Minimal credit is taken for deposition of fission products in the auxiliary building. The site boundary dose and large release frequency are much less than the established goals.

59.10 PRA Input to Design Certification Process

The AP1000 PRA was used in the design certification process to identify important safety insights and assumptions to support certification requirements, such as the reliability assurance program (RAP).

59.10.1 PRA Input to Reliability Assurance Program

The AP1000 RAP identifies those systems, structures, and components (SSC) that should be given priority in maintaining their reliability through surveillance, maintenance, and quality control actions during plant operation. The PRA importance and sensitivity analyses identify those systems and components important in plant risk in terms of either risk increase (for example, what happens to plant risk if a system or component, or a train is unavailable), or in terms of risk decrease (for example, what happens to plant risk if a component or a train is perfectly reliable/available). This ranking of components and systems in such a way provides an input for the reliability assurance program. For more information on the AP1000 reliability assurance program, refer to AP1000 DCD Section 17.4.

59.10.2 PRA Input to Tier 1 Information

AP1000 DCD Section 14.3 summarizes the design material contained in AP1000 that has been incorporated into the AP1000 DCD Tier 1 Information from the PRA.

59.10.3 PRA Input to MMI/Human Factors/Emergency Response Guidelines

The PRA models, including modeling of operator actions in response to severe accident sequences, follow the ERGs. The most risk-important of these actions is manual actuation of

systems in the highly unlikely event of automatic actuation failure. These operator actions and the main human reliability analysis (HRA) model assumptions are reviewed by human factors engineers for insights that they may provide to the human system interface (HSI) and human factors areas. For more information on the AP1000 HSI, refer to AP1000 DCD Chapter 18.

In addition, the human reliability analysis models and operator actions modeled in the PRA were reviewed by the engineers writing the ERGs for consistency between the PRA models and the actual ERGs.

The PRA results and sensitivity studies show that the AP1000 design has no critical operator actions and few risk-important actions. A critical operator action is defined as that action when assumed to fail would result in a plant core damage frequency of greater than $1.0E-04$ per year; there are no such operator actions in the AP1000 PRA.

59.10.4 Summary of PRA Based Insights

The use of the PRA in the design process is discussed in Section 59.2. A summary of the overall PRA results is provided in Sections 59.3 through 59.8. A discussion of the AP1000 plant features important to reducing risk is provided in Section 59.9. PRA-based insights are developed from this information and are summarized in Table 59-18.

59.10.5 Combined License Information

The Combined License applicant referencing the AP1000 certified design will review differences between the as-built plant and the design used as the basis for the AP1000 seismic margins analysis. A verification walkdown will be performed with the purpose of identifying differences between the as-built plant and the design. Any differences will be evaluated to determine if there is significant adverse effect on the seismic margins analysis results. Spatial interactions are addressed by COL information item 3.7-3. Details of the process will be developed by the Combined License applicant.

The Combined License applicant referencing the AP1000 certified design should compare the as-built SSC HCLPFs to those assumed in the AP1000 seismic margin evaluation. Deviations from the HCLPF values or assumptions in the seismic margin evaluation should be evaluated to determine if vulnerabilities have been introduced.

The Combined License applicant referencing the AP1000 certified design will review differences between the as-built plant and the design used as the basis for the AP1000 PRA and Table 59-18. If the effects of the differences are shown, by a screening analysis, to potentially result in a significant increase in core damage frequency or large release frequency, the PRA will be updated to reflect these differences.

The Combined License applicant referencing the AP1000 certified design will review differences between the as-built plant and the design used as the basis for the AP1000 internal fire and internal flood analysis. Differences will be evaluated to determine if there is significant adverse effect on the internal fire and internal flood analysis results.

The Combined License applicant referencing the AP1000 certified design will develop and implement severe accident management guidance using the suggested framework provided in WCAP-13914, "Framework for AP600 Severe Accident Management Guidance," (Reference 59-1).

The Combined License applicant referencing the AP1000 certified design will perform a thermal lag assessment of the as-built equipment required to mitigate severe accidents (hydrogen igniters and containment penetrations) to provide additional assurance that this equipment can perform its severe accident functions during environmental conditions resulting from hydrogen burns associated with severe accidents. This assessment is required only for equipment used for severe accident mitigation that has not been tested at severe accident conditions. The Combined License applicant will assess the ability of the as-built equipment to perform during severe accident hydrogen burns, using the Environment Enveloping method or the Test Based Thermal Analysis method discussed in EPRI NP-4354 (Reference 59-2).

59.11 References

- 59-1 "Framework for AP600 Severe Accident Management Guidance," WCAP-13914, Revision 3, January 1998.
- 59-2 "Large Scale Hydrogen Burn Equipment Experiments," EPRI-NP-4354, December 1985.

Table 59-1

CONTRIBUTION OF INITIATING EVENTS TO CORE DAMAGE

| | Core Damage Contribution | Initiating Event Category | Percent Contribution | Initiating Event Frequency |
|----|--------------------------|---|----------------------|----------------------------|
| 1 | 9.50E-08 | SAFETY INJECTION LINE BREAK INITIATING EVENT | 39.4% | 2.12E-04 |
| 2 | 4.50E-08 | LARGE LOCA INITIATING EVENT | 18.7% | 5.00E-06 |
| 3 | 2.96E-08 | SPURIOUS ADS INITIATING EVENT | 12.3% | 5.40E-05 |
| 4 | 1.81E-08 | SMALL LOCA INITIATING EVENT | 7.5% | 5.00E-04 |
| 5 | 1.61E-08 | MEDIUM LOCA INITIATING EVENT | 6.7% | 4.36E-04 |
| 6 | 1.00E-08 | REACTOR VESSEL RUPTURE INITIATING EVENT | 4.2% | 1.00E-08 |
| 7 | 6.79E-09 | STEAM GENERATOR TUBE RUPTURE INITIATING EVENT | 2.8% | 3.88E-03 |
| 8 | 3.68E-09 | CMT LINE BREAK INITIATING EVENT | 1.5% | 9.31E-05 |
| 9 | 3.61E-09 | ATWS PRECURSOR WITH NO MFW INITIATING EVENT | 1.5% | 4.81E-01(*) |
| 10 | 3.08E-09 | TRANSIENT WITH MFW INITIATING EVENT | 1.3% | 1.40E+00 |
| 11 | 1.71E-09 | RCS LEAK INITIATING EVENT | 0.7% | 6.20E-03 |
| 12 | 1.66E-09 | CORE POWER EXCURSION INITIATING EVENT | 0.7% | 4.50E-03 |
| 13 | 1.24E-09 | LOSS OF CONDENSER INITIATING EVENT | 0.5% | 1.12E-01 |
| 14 | 9.58E-10 | LOSS OF OFFSITE POWER INITIATING EVENT | 0.4% | 1.20E-01 |
| 15 | 8.70E-10 | LOSS OF MAIN FEEDWATER INITIATING EVENT | 0.4% | 3.35E-01 |
| 16 | 7.12E-10 | ATWS PRECURSOR WITH MFW AVAILABLE INITIATING EVENT | 0.3% | 1.17E+00(*) |
| 17 | 6.72E-10 | LOSS OF COMPRESSED AIR INITIATING EVENT | 0.3% | 3.48E-02 |
| 18 | 6.06E-10 | MAIN STEAM LINE STUCK-OPEN SV INITIATING EVENT | 0.3% | 2.39E-3 |
| 19 | 5.02E-10 | PASSIVE RHR TUBE RUPTURE INITIATING EVENT | 0.2% | 1.34E-04 |
| 20 | 4.53E-10 | LOSS OF MFW TO ONE SG INITIATING EVENT | 0.2% | 1.92E-01 |
| 21 | 3.23E-10 | LOSS OF CCW/SW INITIATING EVENT | 0.1% | 1.44E-01 |
| 22 | 1.31E-10 | MAIN STEAM LINE BREAK UPSTREAM OF MSIV INITIATING EVENT | 0.1% | 3.72E-04 |
| 23 | 1.11E-10 | ATWS PRECURSOR WITH SI SIGNAL INITIATING EVENT | 0.1% | 1.48E-02(*) |
| 24 | 5.00E-11 | INTERFACING SYSTEMS LOCA INITIATING EVENT | 0.0% | 5.00E-11 |
| 25 | 3.52E-11 | LOSS OF RCS FLOW INITIATING EVENT | 0.0% | 1.80E-02 |
| 26 | 9.15E-12 | MAIN STEAM LINE BREAK DOWNSTREAM OF MSIV INITIATING EVENT | 0.0% | 5.96E-04 |
| | 2.41E-07 | Totals | 100.0% | 2.38(*) |

(*) Note that the ATWS precursor frequencies are not included in the total initiating event frequency, since they are already accounted for in the other categories.

Table 59-2

CONDITIONAL CORE DAMAGE PROBABILITY OF INITIATING EVENTS

| | Core Damage Contribution | Initiating Event Category | Initiating Event Frequency | Conditional CD Prob. |
|----|--------------------------|---|----------------------------|----------------------|
| 6 | 1.00E-08 | REACTOR VESSEL RUPTURE INITIATING EVENT | 1.00E-08 | 1.00E+00 |
| 24 | 5.00E-11 | INTERFACING SYSTEMS LOCA INITIATING EVENT | 5.00E-11 | 1.00E+00 |
| 2 | 4.50E-08 | LARGE LOCA INITIATING EVENT | 5.00E-06 | 8.99E-03 |
| 3 | 2.96E-08 | SPURIOUS ADS INITIATING EVENT | 5.40E-05 | 5.48E-04 |
| 1 | 9.50E-08 | SAFETY INJECTION LINE BREAK INITIATING EVENT | 2.12E-04 | 4.48E-04 |
| 8 | 3.68E-09 | CMT LINE BREAK INITIATING EVENT | 9.31E-05 | 3.95E-05 |
| 5 | 1.61E-08 | MEDIUM LOCA INITIATING EVENT | 4.36E-04 | 3.70E-05 |
| 4 | 1.81E-08 | SMALL LOCA INITIATING EVENT | 5.00E-04 | 3.62E-05 |
| 19 | 5.02E-10 | PASSIVE RHR TUBE RUPTURE INITIATING EVENT | 1.34E-04 | 3.74E-06 |
| 7 | 6.79E-09 | STEAM GENERATOR TUBE RUPTURE INITIATING EVENT | 3.88E-03 | 1.75E-06 |
| 18 | 6.06E-10 | MAIN STEAM LINE STUCK-OPEN SV INITIATING EVENT | 2.39E-03 | 2.54E-07 |
| 12 | 1.66E-09 | CORE POWER EXCURSION INITIATING EVENT | 4.50E-03 | 3.69E-07 |
| 22 | 1.31E-10 | MAIN STEAM LINE BREAK UPSTREAM OF MSIV INITIATING EVENT | 3.72E-04 | 3.51E-07 |
| 11 | 1.71E-09 | RCS LEAK INITIATING EVENT | 6.20E-03 | 2.75E-07 |
| 17 | 6.72E-10 | LOSS OF COMPRESSED AIR INITIATING EVENT | 3.48E-02 | 1.93E-08 |
| 26 | 9.15E-12 | MAIN STEAM LINE BREAK DOWNSTREAM OF MSIV INITIATING EVENT | 5.96E-04 | 1.54E-08 |
| 13 | 1.24E-09 | LOSS OF CONDENSER INITIATING EVENT | 1.12E-01 | 1.11E-08 |
| 14 | 9.58E-10 | LOSS OF OFFSITE POWER INITIATING EVENT | 1.20E-01 | 7.98E-09 |
| 9 | 3.61E-09 | ATWS PRECURSOR WITH NO MFW INITIATING EVENT | 4.81E-01 | 7.49E-09 |
| 23 | 1.11E-10 | ATWS PRECURSOR WITH SI SIGNAL INITIATING EVENT | 1.48E-02 | 7.48E-09 |
| 15 | 8.70E-10 | LOSS OF MAIN FEEDWATER INITIATING EVENT | 3.35E-01 | 2.60E-09 |
| 20 | 4.53E-10 | LOSS OF MFW TO ONE SG INITIATING EVENT | 1.92E-01 | 2.36E-09 |
| 21 | 3.23E-10 | LOSS OF CCW/SW INITIATING EVENT | 1.44E-01 | 2.24E-09 |
| 10 | 3.08E-09 | TRANSIENT WITH MFW INITIATING EVENT | 1.40E+00 | 2.20E-09 |
| 25 | 3.52E-11 | LOSS OF RSC FLOW INITIATING EVENT | 1.80E-02 | 1.96E-09 |
| 16 | 7.12E-10 | ATWS PRECURSOR WITH MFW AVAILABLE INITIATING EVENT | 1.17E+00 | 6.09E-10 |
| | 2.41E-07 | Totals | 2.38E+00 | |

Table 59-3 (Sheet 1 of 4)

INTERNAL INITIATING EVENTS AT POWER DOMINANT CORE DAMAGE SEQUENCES

| | Sequence Frequency | Percent Contrib | Cumulative % Contrib | Sequence Identifier | Sequence Description |
|---|--------------------|-----------------|----------------------|---------------------|---|
| 1 | 6.88E-08 | 28.52 | 28.52 | 2esil-07 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS RCPS TRIP AND CMT INJECTION IS SUCCESSFUL – 1 OF 2 CMT TRAINS SUCCESS OF FULL ADS DEPRESSURIZATION FAILURE OF ONE OF ONE IRWST INJECTION LINE |
| 2 | 4.26E-08 | 17.66 | 46.18 | 2rll0-09 | LARGE LOCA INITIATING EVENT OCCURS ANY ONE OF TWO ACCUMULATOR TRAINS FAIL |
| 3 | 2.13E-08 | 8.82 | 55.00 | 3dsad-08 | SPURIOUS ADS INITIATING EVENT OCCURS SUCCESS OF 1/2 OR 2/2 ACCUMULATORS FAILURE OF ADS OR CMT |
| 4 | 1.98E-08 | 8.23 | 63.23 | 3dsil-08 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS RCPS TRIP AND CMT INJECTION IS SUCCESSFUL – 1 OF 2 CMT TRAINS FAILURE OF FULL ADS DEPRESSURIZATION |
| 5 | 1.00E-08 | 4.15 | 67.38 | 3crvr-02 | REACTOR VESSEL RUPTURE INITIATING EVENT OCCURS |
| 6 | 8.44E-09 | 3.5 | 70.88 | 2lslo-05 | SMALL LOCA INITIATING EVENT OCCURS SUCCESS OF CMT & RCP TRIP SUCCESS OF PASSIVE RHR SYSTEM SUCCESS OF FULL ADS DEPRESSURIZATION FAILURE OF NORMAL RHR IN INJECTION MODE SUCCESS OF TWO OF TWO IRWST INJECTION LINES SUCCESS OF CIS & PRE-EXISTING CONTAINMENT OPENING FAILURE OF RECIRCULATION |

Table 59-3 (Sheet 2 of 4)

INTERNAL INITIATING EVENTS AT POWER DOMINANT CORE DAMAGE SEQUENCES

| | Sequence Frequency | Percent Contrib | Cumulative % Contrib | Sequence Identifier | Sequence Description |
|----|--------------------|-----------------|----------------------|---------------------|---|
| 7 | 7.35E-09 | 3.05 | 73.93 | 2lmlo-05 | MEDIUM LOCA INITIATING EVENT OCCURS SUCCESS OF CMT & RCP TRIP SUCCESS OF FULL ADS DEPRESSURIZATION FAILURE OF NORMAL RHR IN INJECTION MODE SUCCESS OF TWO OF TWO IRWST INJECTION LINES SUCCESS OF CIS & PRE-EXISTING CONTAINMENT OPENING FAILURE OF RECIRCULATION |
| 8 | 5.11E-09 | 2.12 | 76.05 | 3dslo-12 | SMALL LOCA INITIATING EVENT OCCURS SUCCESS OF CMT & RCP TRIP SUCCESS OF PASSIVE RHR SYSTEM FAILURE OF FULL ADS DEPRESSURIZATION SUCCESS OF PARTIAL ADS DEPRESSURIZATION FAILURE OF NORMAL RHR IN INJECTION MODE |
| 9 | 4.46E-09 | 1.85 | 77.90 | 3dmlo-12 | MEDIUM LOCA INITIATING EVENT OCCURS SUCCESS OF CMT & RCP TRIP FAILURE OF FULL ADS DEPRESSURIZATION SUCCESS OF PARTIAL ADS DEPRESSURIZATION FAILURE OF NORMAL RHR IN INJECTION MODE |
| 10 | 3.72E-09 | 1.54 | 79.44 | 2rsad-09 | SPURIOUS ADS INITIATING EVENT OCCURS FAILURE OF 2/2 ACCUMULATORS |
| 11 | 3.67E-09 | 1.52 | 80.96 | 2esad-07 | SPURIOUS ADS INITIATING EVENT OCCURS SUCCESS OF 1/2 OR 2/2 ACCUMULATORS SUCCESS OF ADS & CMT FAILURE OF IRW OR CMT |

Table 59-3 (Sheet 3 of 4)

INTERNAL INITIATING EVENTS AT POWER DOMINANT CORE DAMAGE SEQUENCES

| | Sequence Frequency | Percent Contrib | Cumulative % Contrib | Sequence Identifier | Sequence Description |
|----|--------------------|-----------------|----------------------|---------------------|--|
| 12 | 3.57E-09 | 1.48 | 82.44 | 2lsil-03 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS RCPS TRIP AND CMT INJECTION IS SUCCESSFUL – 1 OF 2 CMT TRAINS SUCCESS OF FULL ADS DEPRESSURIZATION IRWST INJECTION IS SUCCESSFUL – 1 OF 1 TRAINS SUCCESS OF CIS & PRE-EXISTING CONTAINMENT OPENING FAILURE OF RECIRCULATION |
| 13 | 3.55E-09 | 1.47 | 83.91 | 6esgt-41 | SGTR EVENT SEQUENCE CONTINUES FAILURE OF CMT OR RCP TRIP SUCCESS OF PASSIVE RHR SYSTEM FAILURE OF FULL ADS DEPRESSURIZATION FAILURE OF PARTIAL ADS DEPRESSURIZATION |
| 14 | 3.31E-09 | 1.37 | 85.28 | 3aatw-23 | ATWS PRECURSOR WITH NO MFW EVENT SEQUENCE CONTINUES SUCCESS OF SFW OR PRHR SYSTEM SUCCESS OF MANUAL REACTOR TRIP FAILURE OF MANUAL BORATION BY CVS FAILURE OF CMT OR RCP TRIP |
| 15 | 3.30E-09 | 1.37 | 86.65 | 2eslo-09 | SMALL LOCA INITIATING EVENT OCCURS SUCCESS OF CMT & RCP TRIP SUCCESS OF PASSIVE RHR SYSTEM SUCCESS OF FULL ADS DEPRESSURIZATION FAILURE OF NORMAL RHR IN INJECTION MODE FAILURE OF TWO OF TWO IRWST INJECTION LINES |

Table 59-3 (Sheet 4 of 4)

INTERNAL INITIATING EVENTS AT POWER DOMINANT CORE DAMAGE SEQUENCES

| | Sequence Frequency | Percent Contrib | Cumulative % Contrib | Sequence Identifier | Sequence Description |
|----|--------------------|-----------------|----------------------|---------------------|--|
| 16 | 2.88E-09 | 1.19 | 87.84 | 2emlo-09 | MEDIUM LOCA INITIATING EVENT OCCURS SUCCESS OF CMT & RCP TRIP SUCCESS OF FULL ADS DEPRESSURIZATION FAILURE OF NORMAL RHR IN INJECTION MODE FAILURE OF TWO OF TWO IRWST INJECTION LINES |
| 17 | 2.19E-09 | 0.91 | 88.75 | 6esgt-13 | SGTR EVENT SEQUENCE CONTINUES SUCCESS OF CMT & RCP TRIP SUCCESS OF PASSIVE RHR SYSTEM FAILURE OF FULL ADS DEPRESSURIZATION FAILURE OF PARTIAL ADS DEPRESSURIZATION |
| 18 | 1.97E-09 | 0.82 | 89.57 | 3dllo-08 | LARGE LOCA INITIATING EVENT OCCURS ACCUMULATOR INJECTION IS SUCCESSFUL – 2 OF 2 TRAINS FAILURE OF ADS OR CMT |
| 19 | 1.57E-09 | 0.65 | 90.22 | 2lcmt-05 | CMT LINE BREAK INITIATING EVENT OCCURS RCPS TRIP AND CMT INJECTION IS SUCCESSFUL – 1 OF 2 CMT TRAINS SUCCESS OF FULL ADS DEPRESSURIZATION FAILURE OF NORMAL RHR IN INJECTION MODE SUCCESS OF TWO OF TWO IRWST INJECTION LINES SUCCESS OF CIS & PRE-EXISTING CONTAINMENT OPENING FAILURE OF RECIRCULATION |

Table 59-4 (Sheet 1 of 3)

SEQUENCE 1 – SAFETY INJECTION LINE BREAK DOMINANT CUTSETS (SI-LB-07)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------------------------------|--|
| 1 | 5.09E-08 | 74.04 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS IRWST DISCHARGE LINE "A" STRAINER PLUGGED | 2.12E-04 2.40E-04 | IEV-SI-LB IWA-PLUG |
| 2 | 6.36E-09 | 9.25 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS CCF OF 4 GRAVITY INJECTION CVs | 2.12E-04 3.00E-05 | IEV-SI-LB IWX-CV-AO |
| 3 | 5.51E-09 | 8.01 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS CCF OF 4 GRAVITY INJECTION & 2 RECIRCULATION SQUIB VALVES | 2.12E-04 2.60E-05 | IEV-SI-LB IWX-EV-SA |
| 4 | 1.23E-09 | 1.79 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS CCF OF 2 GRAVITY INJECTION SQUIB VALVES IN 1/1 LINES TO OPEN | 2.12E-04 5.80E-06 | IEV-SI-LB IWX-EV1-SA |
| 5 | 6.49E-10 | .94 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS CHECK VALVE 122A FAILS TO OPEN CHECK VALVE 124A FAILS TO OPEN | 2.12E-04 1.75E-03 1.75E-03 | IEV-SI-LB IWACV122AO IWACV124AO |
| 6 | 5.42E-10 | .79 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS CHECK VALVE 122A FAILS TO OPEN HARDWARE FAILURE OF VALVE 125A | 2.12E-04 1.75E-03 1.46E-03 | IEV-SI-LB IWACV122AO IRWMOD06 |
| 7 | 5.42E-10 | .79 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS HARDWARE FAILURE OF VALVE 123A CHECK VALVE 124A FAILS TO OPEN | 2.12E-04 1.46E-03 1.75E-03 | IEV-SI-LB IRWMOD05 IWACV124AO |
| 8 | 4.52E-10 | .66 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS HARDWARE FAILURE OF VALVE 123A HARDWARE FAILURE OF VALVE 125A | 2.12E-04 1.46E-03 1.46E-03 | IEV-SI-LB IRWMOD05 IRWMOD06 |
| 9 | 3.25E-10 | .47 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS CHECK VALVE 122A FAILS TO OPEN RELAY FAILS TO OPERATE | 2.12E-04 1.75E-03 8.76E-04 | IEV-SI-LB IWACV122AO IWDRS125AFA |
| 10 | 3.25E-10 | .47 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS CHECK VALVE 124A FAILS TO OPEN RELAY FAILS TO OPERATE | 2.12E-04 1.75E-03 8.76E-04 | IEV-SI-LB IWACV124AO IWBR123AFA |
| 11 | 2.71E-10 | .39 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS HARDWARE FAILURE OF VALVE 123A RELAY FAILS TO OPERATE | 2.12E-04 1.46E-03 8.76E-04 | IEV-SI-LB IRWMOD05 IWDRS125AFA |

Table 59-4 (Sheet 2 of 3)

SEQUENCE 1 – SAFETY INJECTION LINE BREAK DOMINANT CUTSETS (SI-LB-07)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------|------------|
| 12 | 2.71E-10 | .39 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | HARDWARE FAILURE OF VALVE 125A | 1.46E-03 | IRWMOD06 |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWBR123AFA |
| 13 | 1.63E-10 | .24 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWBR123AFA |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWDR125AFA |
| 14 | 1.14E-10 | .17 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | CCF OF GRAVITY INJECTION CVs IN 1/1 LINES TO OPEN | 5.40E-07 | IWX-CV1-AO |
| 15 | 1.11E-10 | .16 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | CHECK VALVE 122A FAILS TO OPEN | 1.75E-03 | IWACV122AO |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBS1TM |
| 16 | 1.11E-10 | .16 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | CHECK VALVE 122A FAILS TO OPEN | 1.75E-03 | IWACV122AO |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBS1TM |
| 17 | 1.11E-10 | .16 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | CHECK VALVE 124A FAILS TO OPEN | 1.75E-03 | IWACV124AO |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBS1TM |
| 18 | 1.11E-10 | .16 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | CHECK VALVE 124A FAILS TO OPEN | 1.75E-03 | IWACV124AO |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBS1TM |
| 19 | 9.29E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | HARDWARE FAILURE OF VALVE 123A | 1.46E-03 | IRWMOD05 |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBS1TM |
| 20 | 9.29E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | HARDWARE FAILURE OF VALVE 123A | 1.46E-03 | IRWMOD05 |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBS1TM |
| 21 | 9.29E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | HARDWARE FAILURE OF VALVE 125A | 1.46E-03 | IRWMOD06 |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBS1TM |

Table 59-4 (Sheet 3 of 3)

SEQUENCE 1 – SAFETY INJECTION LINE BREAK DOMINANT CUTSETS (SI-LB-07)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------|-------------|
| 22 | 9.29E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | HARDWARE FAILURE OF VALVE 125A | 1.46E-03 | IRWMOD06 |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDD1TM |
| 23 | 5.57E-11 | .08 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWDRS125AFA |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDS1TM |
| 24 | 5.57E-11 | .08 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWDRS125AFA |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDD1TM |
| 25 | 5.57E-11 | .08 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWDRS123AFA |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDS1TM |

Table 59-5

SEQUENCE 2 - LARGE LOCA DOMINANT CUTSETS (LLOCA-09)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|--|----------------------|-------------------------|
| 1 | 8.75E-09 | 20.55 | LARGE LOCA INITIATING EVENT OCCURS CHECK VALVE 029A FAILS TO OPEN | 5.00E-06 1.75E-03 | IEV-LLOCA ACACV029GO |
| 2 | 8.75E-09 | 20.55 | LARGE LOCA INITIATING EVENT OCCURS CHECK VALVE 028A FAILS TO OPEN | 5.00E-06 1.75E-03 | IEV-LLOCA ACACV028GO |
| 3 | 8.75E-09 | 20.55 | LARGE LOCA INITIATING EVENT OCCURS CHECK VALVE 029B FAILS TO OPEN | 5.00E-06 1.75E-03 | IEV-LLOCA ACBCV029GO |
| 4 | 8.75E-09 | 20.55 | LARGE LOCA INITIATING EVENT OCCURS CHECK VALVE 028B FAILS TO OPEN | 5.00E-06 1.75E-03 | IEV-LLOCA ACBCV028GO |
| 5 | 3.64E-09 | 8.55 | LARGE LOCA INITIATING EVENT OCCURS FLOW TUNING ORIFICE PLUGS | 5.00E-06 7.27E-04 | IEV-LLOCA ACAOR001SP |
| 6 | 3.64E-09 | 8.55 | LARGE LOCA INITIATING EVENT OCCURS FLOW TUNING ORIFICE PLUGS | 5.00E-06 7.27E-04 | IEV-LLOCA ACBOR001SP |
| 7 | 2.55E-10 | .60 | LARGE LOCA INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF 2 ACCUMULATOR CHECK VALVES | 5.00E-06 5.10E-05 | IEV-LLOCA ACX-CV-GO |
| 8 | 1.20E-11 | .03 | LARGE LOCA INITIATING EVENT OCCURS ACCUMULATOR TANK A (T001A) RUPTURES | 5.00E-06 2.40E-06 | IEV-LLOCA ACATK001AF |
| 9 | 1.20E-11 | .03 | LARGE LOCA INITIATING EVENT OCCURS ACCUMULATOR TANK B (T001B) RUPTURES | 5.00E-06 2.40E-06 | IEV-LLOCA ACBTK001AF |
| 10 | 3.60E-12 | .01 | LARGE LOCA INITIATING EVENT OCCURS FLOW TUNING ORIFICE RUPTURE | 5.00E-06 7.20E-07 | IEV-LLOCA ACAOR001EB |
| 11 | 3.60E-12 | .01 | LARGE LOCA INITIATING EVENT OCCURS FLOW TUNING ORIFICE RUPTURE | 5.00E-06 7.20E-07 | IEV-LLOCA ACBOR001EB |
| 12 | 6.00E-13 | .00 | LARGE LOCA INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF ACCUMULATOR TANKS | 5.00E-06 1.20E-07 | IEV-LLOCA ACX-TK-AF |

Table 59-6 (Sheet 1 of 3)

SEQUENCE 3 – SPURIOUS ADS ACTUATION DOMINANT CUTSETS (SPADS-08)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|--|----------------------------------|-----------------------------------|
| 1 | 5.56E-09 | 26.14 | SPURIOUS ADS INITIATING EVENT OCCURS CCF OF ESF INPUT LOGIC (HARDWARE) | 5.40E-05 1.03E-04 | IEV-SPADS CCX-INPUT-LOGIC |
| 2 | 3.35E-09 | 15.75 | SPURIOUS ADS INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF 4 AOV'S TO OPEN | 5.40E-05 6.20E-05 | IEV-SPADS CCX-AV-LA |
| 3 | 3.19E-09 | 15.00 | SPURIOUS ADS INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE | 5.40E-05 5.90E-05 | IEV-SPADS ADX-EV-SA2 |
| 4 | 2.75E-09 | 12.93 | SPURIOUS ADS INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF 4 CHECK VALVES TO OPEN | 5.40E-05 5.10E-05 | IEV-SPADS CMX-CV-GO |
| 5 | 2.07E-09 | 9.73 | SPURIOUS ADS INITIATING EVENT OCCURS CCF OF RTD LEVEL TRANSMITTERS | 5.40E-05 3.84E-05 | IEV-SPADS CMX-VS-FA |
| 6 | 1.62E-09 | 7.62 | SPURIOUS ADS INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE | 5.40E-05 3.00E-05 | IEV-SPADS ADX-EV-SA |
| 7 | 5.94E-10 | 2.79 | SPURIOUS ADS INITIATING EVENT OCCURS CCF OF ESF INPUT LOGIC SOFTWARE | 5.40E-05 1.10E-05 | IEV-SPADS CCX-IN-LOGIC-SW |
| 8 | 5.94E-10 | 2.79 | SPURIOUS ADS INITIATING EVENT OCCURS CCF OF PMS ESF ACTUATION LOGIC SOFTWARE | 5.40E-05 1.10E-05 | IEV-SPADS CCX-PMXMOD2-SW |
| 9 | 5.94E-10 | 2.79 | SPURIOUS ADS INITIATING EVENT OCCURS CCF OF PMS ESF OUTPUT LOGIC SOFTWARE | 5.40E-05 1.10E-05 | IEV-SPADS CCX-PMXMOD1-SW |
| 10 | 4.65E-10 | 2.19 | SPURIOUS ADS INITIATING EVENT OCCURS CCF OF EPO BOARDS IN PMS | 5.40E-05 8.62E-06 | IEV-SPADS CCX-EP-SAM |
| 11 | 6.48E-11 | .30 | SPURIOUS ADS INITIATING EVENT OCCURS SOFTWARE CCF OF ALL CARDS | 5.40E-05 1.20E-06 | IEV-SPADS CCX-SFTW |
| 12 | 2.85E-11 | .13 | SPURIOUS ADS INITIATING EVENT OCCURS FLOW TUNING ORIFICE PLUGS FLOW TUNING ORIFICE PLUGS | 5.40E-05 7.27E-04 7.27E-04 | IEV-SPADS CMA-PLUG CMB-PLUG |
| 13 | 1.82E-11 | .09 | SPURIOUS ADS INITIATING EVENT OCCURS HARDWARE FAILURE OF ST. #4 LINE 3 HARDWARE FAILURE OF ST. #4 LINE 4 | 5.40E-05 5.80E-04 5.80E-04 | IEV-SPADS AD4MOD09 AD4MOD10 |

Table 59-6 (Sheet 2 of 3)

SEQUENCE 3 – SPURIOUS ADS ACTUATION DOMINANT CUTSETS (SPADS-08)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------|------------|
| 14 | 1.82E-11 | .09 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | HARDWARE FAILURE OF ST. #4 LINE 2 | 5.80E-04 | AD4MOD08 |
| | | | HARDWARE FAILURE OF ST. #4 LINE 4 | 5.80E-04 | AD4MOD10 |
| 15 | 1.82E-11 | .09 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | HARDWARE FAILURE OF ST. #4 LINE 2 | 5.80E-04 | AD4MOD08 |
| | | | HARDWARE FAILURE OF ST. #4 LINE 3 | 5.80E-04 | AD4MOD09 |
| 16 | 1.82E-11 | .09 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | HARDWARE FAILURE OF ST. #4 LINE 1 | 5.80E-04 | AD4MOD07 |
| | | | HARDWARE FAILURE OF ST. #4 LINE 4 | 5.80E-04 | AD4MOD10 |
| 17 | 1.82E-11 | .09 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | HARDWARE FAILURE OF ST. #4 LINE 1 | 5.80E-04 | AD4MOD07 |
| | | | HARDWARE FAILURE OF ST. #4 LINE 3 | 5.80E-04 | AD4MOD09 |
| 18 | 1.82E-11 | .09 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | HARDWARE FAILURE OF ST. #4 LINE 1 | 5.80E-04 | AD4MOD07 |
| | | | HARDWARE FAILURE OF ST. #4 LINE 2 | 5.80E-04 | AD4MOD08 |
| 19 | 6.85E-12 | .03 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | UNAVAILABILITY OF BUS ECS ES 2 DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC2BS002TM |
| 20 | 6.85E-12 | .03 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC2BS022TM |
| 21 | 6.85E-12 | .03 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC2BS221TM |
| 22 | 6.85E-12 | .03 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | UNAVAILABILITY OF BUS ECS ES 1 DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC1BS001TM |
| 23 | 6.85E-12 | .03 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC1BS012TM |

Table 59-6 (Sheet 3 of 3)

SEQUENCE 3 – SPURIOUS ADS ACTUATION DOMINANT CUTSETS (SPADS-08)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------|------------|
| 24 | 6.85E-12 | .03 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC1BS121TM |
| 25 | 6.83E-12 | .03 | SPURIOUS ADS INITIATING EVENT OCCURS | 5.40E-05 | IEV-SPADS |
| | | | PMBMOD32 | 5.02E-03 | PMBMOD32 |
| | | | PMCMOD33 | 5.02E-03 | PMCMOD33 |
| | | | PMDMOD34 | 5.02E-03 | PMDMOD34 |

Table 59-7 (Sheet 1 of 3)

SEQUENCE 4 – SAFETY INJECTION LINE BREAK DOMINANT CUTSETS (SI-LB-08)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|--|--|
| 1 | 1.25E-08 | 63.00 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE | 2.12E-04 5.90E-05 | IEV-SI-LB ADX-EV-SA2 |
| 2 | 6.36E-09 | 32.06 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE | 2.12E-04 3.00E-05 | IEV-SI-LB ADX-EV-SA |
| 3 | 7.13E-11 | .36 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS HARDWARE FAILURE OF ST. #4 LINE 3 HARDWARE FAILURE OF ST. #4 LINE 4 | 2.12E-04 5.80E-04 5.80E-04 | IEV-SI-LB AD4MOD09 AD4MOD10 |
| 4 | 7.13E-11 | .36 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS HARDWARE FAILURE OF ST. #4 LINE 2 HARDWARE FAILURE OF ST. #4 LINE 4 | 2.12E-04 5.80E-04 5.80E-04 | IEV-SI-LB AD4MOD08 AD4MOD10 |
| 5 | 7.13E-11 | .36 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS HARDWARE FAILURE OF ST. #4 LINE 2 HARDWARE FAILURE OF ST. #4 LINE 3 | 2.12E-04 5.80E-04 5.80E-04 | IEV-SI-LB AD4MOD08 AD4MOD09 |
| 6 | 7.13E-11 | .36 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS HARDWARE FAILURE OF ST. #4 LINE 1 HARDWARE FAILURE OF ST. #4 LINE 4 | 2.12E-04 5.80E-04 5.80E-04 | IEV-SI-LB AD4MOD07 AD4MOD10 |
| 7 | 7.13E-11 | .36 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS HARDWARE FAILURE OF ST. #4 LINE 1 HARDWARE FAILURE OF ST. #4 LINE 3 | 2.12E-04 5.80E-04 5.80E-04 | IEV-SI-LB AD4MOD07 AD4MOD09 |
| 8 | 7.13E-11 | .36 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS HARDWARE FAILURE OF ST. #4 LINE 1 HARDWARE FAILURE OF ST. #4 LINE 2 | 2.12E-04 5.80E-04 5.80E-04 | IEV-SI-LB AD4MOD07 AD4MOD08 |
| 9 | 3.65E-11 | .18 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS COND. PROB. OF REC-MANDAS (FAILURE OF MANUAL DAS AC OPER. FAILS TO RECOG. THE NEED FOR RCS DEPRESS. DURING MLOCA CCF OF ESF INPUT LOGIC (HARDWARE) | 2.12E-04 5.06E-01 3.30E-03 1.03E-04 | IEV-SI-LB REC-MANDASC LPM-MAN02 CCX-INPUT-LOGIC |
| 10 | 3.34E-11 | .17 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS COND. PROB. OF REC-MANDAS (FAILURE OF MANUAL DAS AC OPER. FAILS TO FULFIL MANUAL ACTUATION OF ADS CCF OF ESF INPUT LOGIC (HARDWARE) | 2.12E-04 5.06E-01 3.02E-03 1.03E-04 | IEV-SI-LB REC-MANDASC ADN-MAN01 CCX-INPUT-LOGIC |

Table 59-7 (Sheet 2 of 3)

SEQUENCE 4 – SAFETY INJECTION LINE BREAK DOMINANT CUTSETS (SI-LB-08)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------------------------------|---|
| 11 | 2.71E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS FAILURE OF MANUAL DAS ACT. CCF OF PMS ESF OUTPUT LOGIC SOFTWARE | 2.12E-04 1.16E-02 1.10E-05 | IEV-SI-LB REC-MANDAS CCX-PMXMOD1-SW |
| 12 | 2.69E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B UNAVAILABILITY OF BUS ECS ES 2 DUE TO UNSCHEDUL MAINTENANCE | 2.12E-04 4.70E-05 2.70E-03 | IEV-SI-LB CCX-BY-PN EC2BS002TM |
| 13 | 2.69E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.12E-04 4.70E-05 2.70E-03 | IEV-SI-LB CCX-BY-PN EC2BS022TM |
| 14 | 2.69E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.12E-04 4.70E-05 2.70E-03 | IEV-SI-LB CCX-BY-PN EC2BS221TM |
| 15 | 2.69E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B UNAVAILABILITY OF BUS ECS ES 1 DUE TO UNSCHEDULED MAINTENANCE | 2.12E-04 4.70E-05 2.70E-03 | IEV-SI-LB CCX-BY-PN EC1BS001TM |
| 16 | 2.69E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.12E-04 4.70E-05 2.70E-03 | IEV-SI-LB CCX-BY-PN EC1BS012TM |
| 17 | 2.69E-11 | .14 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.12E-04 4.70E-05 2.70E-03 | IEV-SI-LB CCX-BY-PN EC1BS121TM |
| 18 | 2.33E-11 | .12 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS FAILURE OF MANUAL DAS REACTOR TRIP HARDWARE CCF OF PMS ESF OUTPUT LOGIC SOFTWARE | 2.12E-04 1.00E-02 1.10E-05 | IEV-SI-LB MDAS CCX-PMXMOD1-SW |
| 19 | 2.12E-11 | .11 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS FAILURE OF MANUAL DAS ACT. CCF OF EPO BOARDS IN PMS | 2.12E-04 1.16E-02 8.62E-06 | IEV-SI-LB REC-MANDAS CCX-EP-SAM |
| 20 | 1.91E-11 | .10 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 2.12E-04 3.00E-04 3.00E-04 | IEV-SI-LB IDDBSDS1TM IDDBSDS1TM |

Table 59-7 (Sheet 3 of 3)

SEQUENCE 4 – SAFETY INJECTION LINE BREAK DOMINANT CUTSETS (SI-LB-08)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------|------------|
| 21 | 1.91E-11 | .10 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDS1TM |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDD1TM |
| 22 | 1.91E-11 | .10 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDD1TM |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDS1TM |
| 23 | 1.91E-11 | .10 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDD1TM |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDD1TM |
| 24 | 1.91E-11 | .10 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDCBSDS1TM |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDABS1TM |
| 25 | 1.91E-11 | .10 | SAFETY INJECTION LINE BREAK INITIATING EVENT OCCURS | 2.12E-04 | IEV-SI-LB |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDCBSDS1TM |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDABSDD1TM |

Table 59-8

SEQUENCE 5 – REACTOR VESSEL RUPTURE CUTSET (RV-RP-02)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|-----------------|------------|--|----------|-----------|
| 1 | 1.00E-08 | 100.00 | REACTOR VESSEL RUPTURE INITIATING EVENT OCCURS | 1.00E-08 | IEV-RV-RP |

Table 59-9 (Sheet 1 of 3)

SEQUENCE 6 – SMALL LOCA DOMINANT CUTSETS (SLOCA-05)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|--|---|
| 1 | 6.00E-09 | 71.10 | SMALL LOCA INITIATING EVENT OCCURS PLUGGING OF BOTH RECIRC LINES DUE TO CCF OF SUMP SCREENS | 5.00E-04 1.20E-05 | IEV-SLOCA REX-FL-GP |
| 2 | 2.39E-09 | 28.32 | SMALL LOCA INITIATING EVENT OCCURS CCF OF TANK LEVEL TRANSMITTERS OPER. FAILS TO ACT. SUMP RECIRC GIVEN IRW LEVEL SIGNAL FAILUR | 5.00E-04 4.78E-04 1.00E-02 | IEV-SLOCA IWX-XMTR REN-MAN04 |
| 3 | 2.88E-11 | .34 | SMALL LOCA INITIATING EVENT OCCURS SUMP SCREEN A PLUGS AND PREVENTS FLOW SUMP SCREEN B PLUGS AND PREVENTS FLOW | 5.00E-04 2.40E-04 2.40E-04 | IEV-SLOCA REA-PLUG REB-PLUG |
| 4 | 9.18E-12 | .11 | SMALL LOCA INITIATING EVENT OCCURS CCF OF TANK LEVEL TRANSMITTERS CCF OF CMT LEVEL SWITCHES | 5.00E-04 4.78E-04 3.84E-05 | IEV-SLOCA IWX-XMTR CCX-VS-FA |
| 5 | 2.63E-12 | .03 | SMALL LOCA INITIATING EVENT OCCURS CCF OF PMS ESF OUTPUT LOGIC SOFTWARE CCF OF TANK LEVEL TRANSMITTERS | 5.00E-04 1.10E-05 4.78E-04 | IEV-SLOCA CCX-PMXMOD1-SW IWX-XMTR |
| 6 | 2.63E-12 | .03 | SMALL LOCA INITIATING EVENT OCCURS CCX-PMXMOD4-SW CCF OF TANK LEVEL TRANSMITTERS | 5.00E-04 1.10E-05 4.78E-04 | IEV-SLOCA CCX-PMXMOD4-SW IWX-XMTR |
| 7 | 2.06E-12 | .02 | SMALL LOCA INITIATING EVENT OCCURS CCF OF EPO BOARDS IN PMS CCF OF TANK LEVEL TRANSMITTERS | 5.00E-04 8.62E-06 4.78E-04 | IEV-SLOCA CCX-EP-SAM IWX-XMTR |
| 8 | 3.07E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119A FAILS TO OPEN SUMP SCREEN B PLUGS AND PREVENTS FLOW HARDWARE FAILURE OF SQUIB VALVE 118A | 5.00E-04 1.75E-03 2.40E-04 1.46E-03 | IEV-SLOCA REACV119GO REB-PLUG IRWMOD09 |
| 9 | 3.07E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119B FAILS TO OPEN SUMP SCREEN A PLUGS AND PREVENTS FLOW HARDWARE FAILURE OF SQUIB VALVE 118B | 5.00E-04 1.75E-03 2.40E-04 1.46E-03 | IEV-SLOCA REBCV119GO REA-PLUG IRWMOD11 |
| 10 | 2.87E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS SOFTWARE CCF OF ALL CARDS CCF OF TANK LEVEL TRANSMITTERS | 5.00E-04 1.20E-06 4.78E-04 | IEV-SLOCA CCX-SFTW IWX-XMTR |

Table 59-9 (Sheet 2 of 3)

SEQUENCE 6 – SMALL LOCA DOMINANT CUTSETS (SLOCA-05)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|--|----------|--------------|
| 11 | 2.56E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | HARDWARE FAILURE OF SQUIB VALVE 120A | 1.46E-03 | IRWMOD10 |
| | | | SUMP SCREEN B PLUGS AND PREVENTS FLOW | 2.40E-04 | REB-PLUG |
| | | | HARDWARE FAILURE OF SQUIB VALVE 118A | 1.46E-03 | IRWMOD09 |
| 12 | 2.56E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | HARDWARE FAILURE OF SQUIB VALVE 120B | 1.46E-03 | IRWMOD12 |
| | | | SUMP SCREEN A PLUGS AND PREVENTS FLOW | 2.40E-04 | REA-PLUG |
| | | | HARDWARE FAILURE OF SQUIB VALVE 118B | 1.46E-03 | IRWMOD11 |
| 13 | 2.39E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | INDICATION FAILURE | 1.00E-06 | ALL-IND-FAIL |
| | | | CCF OF TANK LEVEL TRANSMITTERS | 4.78E-04 | IWX-XMTR |
| 14 | 1.84E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | HARDWARE FAILURE CAUSE RECIRC. CV 119A FAILS TO OPEN | 1.75E-03 | REACV119GO |
| | | | SUMP SCREEN B PLUGS AND PREVENTS FLOW | 2.40E-04 | REB-PLUG |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWBR118AFA |
| 15 | 1.84E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | HARDWARE FAILURE CAUSE RECIRC. CV 119B FAILS TO OPEN | 1.75E-03 | REBCV119GO |
| | | | SUMP SCREEN A PLUGS AND PREVENTS FLOW | 2.40E-04 | REA-PLUG |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWARS118BFA |
| 16 | 1.68E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | CCF OF 2 OUT 2 LOW PRESSURE RECIRCULATION SQUIB VALVES | 5.80E-05 | IWX-EV4-SA |
| | | | CCF OF MOV 120A AND 120B | 5.80E-06 | IWX-EV2-SA |
| 17 | 1.53E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | HARDWARE FAILURE OF SQUIB VALVE 120A | 1.46E-03 | IRWMOD10 |
| | | | SUMP SCREEN B PLUGS AND PREVENTS FLOW | 2.40E-04 | REB-PLUG |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWBR118AFA |
| 18 | 1.53E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | HARDWARE FAILURE OF SQUIB VALVE 118A | 1.46E-03 | IRWMOD09 |
| | | | SUMP SCREEN B PLUGS AND PREVENTS FLOW | 2.40E-04 | REB-PLUG |
| | | | RELAY FAILS TO OPERATE | 8.76E-04 | IWDRS120AFA |

Table 59-9 (Sheet 3 of 3)

SEQUENCE 6 – SMALL LOCA DOMINANT CUTSETS (SLOCA-05)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|--|--|---|
| 19 | 1.53E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS HARDWARE FAILURE OF SQUIB VALVE 120B SUMP SCREEN A PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 5.00E-04 1.46E-03 2.40E-04 8.76E-04 | IEV-SLOCA IRWMOD12 REA-PLUG IWARS118BFA |
| 20 | 1.53E-13 | .00 | SMALL LOCA INITIATING EVENT OCCURS HARDWARE FAILURE OF SQUIB VALVE 118B SUMP SCREEN A PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 5.00E-04 1.46E-03 2.40E-04 8.76E-04 | IEV-SLOCA IRWMOD11 REA-PLUG IWCRS120BFA |
| 21 | 9.21E-14 | .00 | SMALL LOCA INITIATING EVENT OCCURS RELAY FAILS TO OPERATE SUMP SCREEN B PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 5.00E-04 8.76E-04 2.40E-04 8.76E-04 | IEV-SLOCA IWDRS120AFA REB-PLUG IWBR118AFA |
| 22 | 9.21E-14 | .00 | SMALL LOCA INITIATING EVENT OCCURS RELAY FAILS TO OPERATE SUMP SCREEN A PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 5.00E-04 8.76E-04 2.40E-04 8.76E-04 | IEV-SLOCA IWCRS120BFA REA-PLUG IWARS118BFA |
| 23 | 8.88E-14 | .00 | SMALL LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119B FAILS TO OPEN CCF OF 2 OUT 2 LOW PRESSURE RECIRCULATION SQUIB VALVES HARDWARE FAILURE CAUSE RECIRC. CV 119A FAILS TO OPEN | 5.00E-04 1.75E-03 5.80E-05 1.75E-03 | IEV-SLOCA REBCV119GO IWX-EV4-SA REACV119GO |
| 24 | 7.41E-14 | .00 | SMALL LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119B FAILS TO OPEN CCF OF 2 OUT 2 LOW PRESSURE RECIRCULATION SQUIB VALVES HARDWARE FAILURE OF SQUIB VALVE 120A | 5.00E-04 1.75E-03 5.80E-05 1.46E-03 | IEV-SLOCA REBCV119GO IWX-EV4-SA IRWMOD10 |
| 25 | 7.41E-14 | .00 | SMALL LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119A FAILS TO OPEN CCF OF 2 OUT 2 LOW PRESSURE RECIRCULATION SQUIB VALVES HARDWARE FAILURE OF SQUIB VALVE 120B | 5.00E-04 1.75E-03 5.80E-05 1.46E-03 | IEV-SLOCA REACV119GO IWX-EV4-SA IRWMOD12 |

Table 59-10 (Sheet 1 of 3)

SEQUENCE 7 – MEDIUM LOCA DOMINANT CUTSETS (MLOCA-05)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|--|--|---|
| 1 | 5.23E-09 | 71.13 | MEDIUM LOCA INITIATING EVENT OCCURS PLUGGING OF BOTH RECIRC LINES DUE TO CCF OF SUMP SCREENS | 4.36E-04 1.20E-05 | IEV-MLOCA REX-FL-GP |
| 2 | 2.08E-09 | 28.29 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF TANK LEVEL TRANSMITTERS OPER. FAILS TO ACT. SUMP RECIRC GIVEN IRW LEVEL SIGNAL FAILUR | 4.36E-04 4.78E-04 1.00E-02 | IEV-MLOCA IWX-XMTR REN-MAN04 |
| 3 | 2.51E-11 | .34 | MEDIUM LOCA INITIATING EVENT OCCURS SUMP SCREEN A PLUGS AND PREVENTS FLOW SUMP SCREEN B PLUGS AND PREVENTS FLOW | 4.36E-04 2.40E-04 2.40E-04 | IEV-MLOCA REA-PLUG REB-PLUG |
| 4 | 8.00E-12 | .11 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF TANK LEVEL TRANSMITTERS CCX-VS-FA | 4.36E-04 4.78E-04 3.84E-05 | IEV-MLOCA IWX-XMTR CCX-VS-FA |
| 5 | 2.29E-12 | .03 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF PMS ESF OUTPUT LOGIC SOFTWARE CCF OF TANK LEVEL TRANSMITTERS | 4.36E-04 1.10E-05 4.78E-04 | IEV-MLOCA CCX-PMXMOD1-SW IWX-XMTR |
| 6 | 2.29E-12 | .03 | MEDIUM LOCA INITIATING EVENT OCCURS CCX-PMXMOD4-SW CCF OF TANK LEVEL TRANSMITTERS | 4.36E-04 1.10E-05 4.78E-04 | IEV-MLOCA CCX-PMXMOD4-SW IWX-XMTR |
| 7 | 1.80E-12 | .02 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF EPO BOARDS IN PMS CCF OF TANK LEVEL TRANSMITTERS | 4.36E-04 8.62E-06 4.78E-04 | IEV-MLOCA CCX-EP-SAM IWX-XMTR |
| 8 | 2.67E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119A FAILS TO OPEN SUMP SCREEN B PLUGS AND PREVENTS FLOW HARDWARE FAILURE OF SQUIB VALVE 118A | 4.36E-04 1.75E-03 2.40E-04 1.46E-03 | IEV-MLOCA REACV119GO REB-PLUG IRWMOD09 |
| 9 | 2.67E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119B FAILS TO OPEN SUMP SCREEN A PLUGS AND PREVENTS FLOW HARDWARE FAILURE OF SQUIB VALVE 118B | 4.36E-04 1.75E-03 2.40E-04 1.46E-03 | IEV-MLOCA REBCV119GO REA-PLUG IRWMOD11 |
| 10 | 2.50E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS SOFTWARE CCF OF ALL CARDS CCF OF TANK LEVEL TRANSMITTERS | 4.36E-04 1.20E-06 4.78E-04 | IEV-MLOCA CCX-SFTW IWX-XMTR |

Table 59-10 (Sheet 2 of 3)

SEQUENCE 7 – MEDIUM LOCA DOMINANT CUTSETS (MLOCA-05)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|--|--|--|
| 11 | 2.23E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE OF SQUIB VALVE 120A SUMP SCREEN B PLUGS AND PREVENTS FLOW HARDWARE FAILURE OF SQUIB VALVE 118A | 4.36E-04 1.46E-03 2.40E-04 1.46E-03 | IEV-MLOCA IRWMOD10 REB-PLUG IRWMOD09 |
| 12 | 2.23E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE OF SQUIB VALVE 120B SUMP SCREEN A PLUGS AND PREVENTS FLOW HARDWARE FAILURE OF SQUIB VALVE 118B | 4.36E-04 1.46E-03 2.40E-04 1.46E-03 | IEV-MLOCA IRWMOD12 REA-PLUG IRWMOD11 |
| 13 | 2.08E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS INDICATION FAILURE CCF OF TANK LEVEL TRANSMITTERS | 4.36E-04 1.00E-06 4.78E-04 | IEV-MLOCA ALL-IND-FAIL IWX-XMTR |
| 14 | 1.60E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119A FAILS TO OPEN SUMP SCREEN B PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 4.36E-04 1.75E-03 2.40E-04 8.76E-04 | IEV-MLOCA REACV119GO REB-PLUG IWBS118AFA |
| 15 | 1.60E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119B FAILS TO OPEN SUMP SCREEN A PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 4.36E-04 1.75E-03 2.40E-04 8.76E-04 | IEV-MLOCA REBCV119GO REA-PLUG IWARS118BFA |
| 16 | 1.47E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 OUT 2 LOW PRESSURE RECIRCULATION SQUIB VALVES CCF OF MOV 120A AND 120B | 4.36E-04 5.80E-05 5.80E-06 | IEV-MLOCA IWX-EV4-SA IWX-EV2-SA |
| 17 | 1.34E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE OF SQUIB VALVE 120A SUMP SCREEN B PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 4.36E-04 1.46E-03 2.40E-04 8.76E-04 | IEV-MLOCA IRWMOD10 REB-PLUG IWBS118AFA |
| 18 | 1.34E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE OF SQUIB VALVE 118A SUMP SCREEN B PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 4.36E-04 1.46E-03 2.40E-04 8.76E-04 | IEV-MLOCA IRWMOD09 REB-PLUG IWDRS120AFA |

Table 59-10 (Sheet 3 of 3)

SEQUENCE 7 – MEDIUM LOCA DOMINANT CUTSETS (MLOCA-05)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|--|---|
| 19 | 1.34E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE OF SQUIB VALVE 120B SUMP SCREEN A PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 4.36E-04 1.46E-03 2.40E-04 8.76E-04 | IEV-MLOCA IRWMOD12 REA-PLUG IWARSI18BFA |
| 20 | 1.34E-13 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE OF SQUIB VALVE 118B SUMP SCREEN A PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 4.36E-04 1.46E-03 2.40E-04 8.76E-04 | IEV-MLOCA IRWMOD11 REA-PLUG IWCRS120BFA |
| 21 | 8.03E-14 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS RELAY FAILS TO OPERATE SUMP SCREEN B PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 4.36E-04 8.76E-04 2.40E-04 8.76E-04 | IEV-MLOCA IWDRS120AFA REB-PLUG IWBRSI18AFA |
| 22 | 8.03E-14 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS RELAY FAILS TO OPERATE SUMP SCREEN A PLUGS AND PREVENTS FLOW RELAY FAILS TO OPERATE | 4.36E-04 8.76E-04 2.40E-04 8.76E-04 | IEV-MLOCA IWCRS120BFA REA-PLUG IWARSI18BFA |
| 23 | 7.74E-14 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119B FAILS TO OPEN CCF OF 2 OUT 2 LOW PRESSURE RECIRCULATION SQUIB VALVES HARDWARE FAILURE CAUSE RECIRC. CV 119A FAILS TO OPEN | 4.36E-04 1.75E-03 5.80E-05 1.75E-03 | IEV-MLOCA REBCV119GO IWX-EV4-SA REACV119GO |
| 24 | 6.46E-14 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119B FAILS TO OPEN CCF OF 2 OUT 2 LOW PRESSURE RECIRCULATION SQUIB VALVES HARDWARE FAILURE OF SQUIB VALVE 120A | 4.36E-04 1.75E-03 5.80E-05 1.46E-03 | IEV-MLOCA REBCV119GO IWX-EV4-SA IRWMOD10 |
| 25 | 6.46E-14 | .00 | MEDIUM LOCA INITIATING EVENT OCCURS HARDWARE FAILURE CAUSE RECIRC. CV 119A FAILS TO OPEN CCF OF 2 OUT 2 LOW PRESSURE RECIRCULATION SQUIB VALVES HARDWARE FAILURE OF SQUIB VALVE 120B | 4.36E-04 1.75E-03 5.80E-05 1.46E-03 | IEV-MLOCA REACV119GO IWX-EV4-SA IRWMOD12 |

Table 59-11 (Sheet 1 of 3)

SEQUENCE 8 – SMALL LOCA DOMINANT CUTSETS (SLOCA-12)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|--|----------------------------------|--|
| 1 | 4.16E-10 | 8.14 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE MECHANICAL FAILURE OF RNS MOV V055 | 5.00E-04 5.90E-05 1.41E-02 | IEV-SLOCA ADX-EV-SA2 RN55MOD1 |
| 2 | 4.16E-10 | 8.14 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE HARDWARE FAILURE OF ISOLATION MOV 011 | 5.00E-04 5.90E-05 1.41E-02 | IEV-SLOCA ADX-EV-SA2 RN11MOD3 |
| 3 | 4.16E-10 | 8.14 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE HARDWARE FAILS TO OPEN MOV V022/CB FTC/RELAY FTC | 5.00E-04 5.90E-05 1.41E-02 | IEV-SLOCA ADX-EV-SA2 RN22MOD4 |
| 4 | 4.16E-10 | 8.14 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE HARDWARE FAILS TO OPEN MOV V023/CB FTC/RELAY FTC | 5.00E-04 5.90E-05 1.41E-02 | IEV-SLOCA ADX-EV-SA2 RN23MOD5 |
| 5 | 2.95E-10 | 5.77 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE CASK LOADING PIT UNAVAILABLE DUE TO FUEL UNLOADING OPERATIONS | 5.00E-04 5.90E-05 1.00E-02 | IEV-SLOCA ADX-EV-SA2 CLP-UNAVAILABLE |
| 6 | 2.11E-10 | 4.13 | SMALL LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE MECHANICAL FAILURE OF RNS MOV V055 | 5.00E-04 3.00E-05 1.41E-02 | IEV-SLOCA ADX-EV-SA RN55MOD1 |
| 7 | 2.11E-10 | 4.13 | SMALL LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE HARDWARE FAILURE OF ISOLATION MOV 011 | 5.00E-04 3.00E-05 1.41E-02 | IEV-SLOCA ADX-EV-SA RN11MOD3 |
| 8 | 2.11E-10 | 4.13 | SMALL LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE HARDWARE FAILS TO OPEN MOV V022/CB FTC/RELAY FTC | 5.00E-04 3.00E-05 1.41E-02 | IEV-SLOCA ADX-EV-SA RN22MOD4 |
| 9 | 2.11E-10 | 4.13 | SMALL LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE HARDWARE FAILS TO OPEN MOV V023/CB FTC/RELAY FTC | 5.00E-04 3.00E-05 1.41E-02 | IEV-SLOCA ADX-EV-SA RN23MOD5 |
| 10 | 1.50E-10 | 2.93 | SMALL LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE CASK LOADING PIT UNAVAILABLE DUE TO FUEL UNLOADING OPERATIONS | 5.00E-04 3.00E-05 1.00E-02 | IEV-SLOCA ADX-EV-SA CLP-UNAVAILABLE |

Table 59-11 (Sheet 2 of 3)

SEQUENCE 8 – SMALL LOCA DOMINANT CUTSETS (SLOCA-12)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|--|--|--|
| 11 | 1.45E-10 | 2.84 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE CCF OF STOP CHECK VALVES V015A/B TO OPEN | 5.00E-04 5.90E-05 4.90E-03 | IEV-SLOCA ADX-EV-SA2 RNX-KV1-GO |
| 12 | 8.55E-11 | 1.67 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE OPERATOR FAILS TO ALIGN AND ACTUATE THE RNS | 5.00E-04 5.90E-05 2.90E-03 | IEV-SLOCA ADX-EV-SA2 RHN-MAN01 |
| 13 | 7.97E-11 | 1.56 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE UNAVAILABILITY OF BUS ECS ES 1 DUE TO UNSCHEDUL MAINTENANCE | 5.00E-04 5.90E-05 2.70E-03 | IEV-SLOCA ADX-EV-SA2 EC1BS001TM |
| 14 | 7.97E-11 | 1.56 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 5.00E-04 5.90E-05 2.70E-03 | IEV-SLOCA ADX-EV-SA2 EC1BS012TM |
| 15 | 7.97E-11 | 1.56 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 5.00E-04 5.90E-05 2.70E-03 | IEV-SLOCA ADX-EV-SA2 EC1BS122TM |
| 16 | 7.58E-11 | 1.48 | SMALL LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE HARDWARE FAILURE OF VALVES ON DVI LINE A (V015A & 017) HARDWARE FAILURE OF VALVES ON DVI LINE B (V015B & 017) | 5.00E-04 5.90E-05 5.07E-02 5.07E-02 | IEV-SLOCA ADX-EV-SA2 RNAME09 RNBMOD10 |
| 17 | 7.35E-11 | 1.44 | SMALL LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE CCF OF STOP CHECK VALVES V015A/B TO OPEN | 5.00E-04 3.00E-05 4.90E-03 | IEV-SLOCA ADX-EV-SA RNX-KV1-GO |
| 18 | 6.35E-11 | 1.24 | SMALL LOCA INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B UNAVAILABILITY OF BUS ECS ES 2 DUE TO UNSCHEDULED MAINTENANCE | 5.00E-04 4.70E-05 2.70E-03 | IEV-SLOCA CCX-BY-PN EC2BS002TM |
| 19 | 6.35E-11 | 1.24 | SMALL LOCA INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 5.00E-04 4.70E-05 2.70E-03 | IEV-SLOCA CCX-BY-PN EC2BS022TM |
| 20 | 6.35E-11 | 1.24 | SMALL LOCA INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 5.00E-04 4.70E-05 2.70E-03 | IEV-SLOCA CCX-BY-PN EC2BS221TM |

Table 59-11 (Sheet 3 of 3)

SEQUENCE 8 – SMALL LOCA DOMINANT CUTSETS (SLOCA-12)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------|------------|
| 21 | 6.35E-11 | 1.24 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | UNAVAILABILITY OF BUS ECS ES 1 DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC1BS001TM |
| 22 | 6.35E-11 | 1.24 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC1BS012TM |
| 23 | 6.35E-11 | 1.24 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC1BS121TM |
| 24 | 5.16E-11 | 1.01 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | CCF OF 2 SQUIB VALVES TO OPERATE | 5.90E-05 | ADX-EV-SA2 |
| | | | CHECK VALVE V013 FAILURE TO OPEN | 1.75E-03 | RNNCV013GO |
| 25 | 4.50E-11 | .88 | SMALL LOCA INITIATING EVENT OCCURS | 5.00E-04 | IEV-SLOCA |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDS1TM |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDS1TM |

Table 59-12 (Sheet 1 of 3)

SEQUENCE 9 – MEDIUM LOCA DOMINANT CUTSETS (MLOCA-12)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------------------------------|--|
| 1 | 3.63E-10 | 8.14 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE MECHANICAL FAILURE OF RNS MOV V055 | 4.36E-04 5.90E-05 1.41E-02 | IEV-MLOCA ADX-EV-SA2 RN55MOD1 |
| 2 | 3.63E-10 | 8.14 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE HARDWARE FAILURE OF ISOLATION MOV 011 | 4.36E-04 5.90E-05 1.41E-02 | IEV-MLOCA ADX-EV-SA2 RN11MOD3 |
| 3 | 3.63E-10 | 8.14 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE HARDWARE FAILS TO OPEN MOV V022/CB FTC/RELAY FTC | 4.36E-04 5.90E-05 1.41E-02 | IEV-MLOCA ADX-EV-SA2 RN22MOD4 |
| 4 | 3.63E-10 | 8.14 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE HARDWARE FAILS TO OPEN MOV V023/CB FTC/RELAY FTC | 4.36E-04 5.90E-05 1.41E-02 | IEV-MLOCA ADX-EV-SA2 RN23MOD5 |
| 5 | 2.57E-10 | 5.77 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE CASK LOADING PIT UNAVAILABLE DUE TO FUEL UNLOADING OPERATIONS | 4.36E-04 5.90E-05 1.00E-02 | IEV-MLOCA ADX-EV-SA2 CLP-UNAVAILABLE |
| 6 | 1.84E-10 | 4.13 | MEDIUM LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE MECHANICAL FAILURE OF RNS MOV V055 | 4.36E-04 3.00E-05 1.41E-02 | IEV-MLOCA ADX-EV-SA RN55MOD1 |
| 7 | 1.84E-10 | 4.13 | MEDIUM LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE HARDWARE FAILURE OF ISOLATION MOV 011 | 4.36E-04 3.00E-05 1.41E-02 | IEV-MLOCA ADX-EV-SA RN11MOD3 |
| 8 | 1.84E-10 | 4.13 | MEDIUM LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE HARDWARE FAILS TO OPEN MOV V022/CB FTC/RELAY FTC | 4.36E-04 3.00E-05 1.41E-02 | IEV-MLOCA ADX-EV-SA RN22MOD4 |
| 9 | 1.84E-10 | 4.13 | MEDIUM LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE HARDWARE FAILS TO OPEN MOV V023/CB FTC/RELAY FTC | 4.36E-04 3.00E-05 1.41E-02 | IEV-MLOCA ADX-EV-SA RN23MOD5 |
| 10 | 1.31E-10 | 2.94 | MEDIUM LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE CASK LOADING PIT UNAVAILABLE DUE TO FUEL UNLOADING OPERATIONS | 4.36E-04 3.00E-05 1.00E-02 | IEV-MLOCA ADX-EV-SA CLP-UNAVAILABLE |

Table 59-12 (Sheet 2 of 3)

SEQUENCE 9 – MEDIUM LOCA DOMINANT CUTSETS (MLOCA-12)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|--|---|
| 11 | 1.26E-10 | 2.83 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE CCF OF STOP CHECK VALVES V015A/B TO OPEN | 4.36E-04 5.90E-05 4.90E-03 | IEV-MLOCA ADX-EV-SA2 RNX-KV1-GO |
| 12 | 7.46E-11 | 1.67 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE OPERATOR FAILS TO ALIGN AND ACTUATE THE RNS | 4.36E-04 5.90E-05 2.90E-03 | IEV-MLOCA ADX-EV-SA2 RHN-MAN01 |
| 13 | 6.95E-11 | 1.56 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE UNAVAILABILITY OF BUS ECS ES 1 DUE TO UNSCHEDULED MAINTENANCE | 4.36E-04 5.90E-05 2.70E-03 | IEV-MLOCA ADX-EV-SA2 EC1BS001TM |
| 14 | 6.95E-11 | 1.56 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 4.36E-04 5.90E-05 2.70E-03 | IEV-MLOCA ADX-EV-SA2 EC1BS012TM |
| 15 | 6.95E-11 | 1.56 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 4.36E-04 5.90E-05 2.70E-03 | IEV-MLOCA ADX-EV-SA2 EC1BS122TM |
| 16 | 6.61E-11 | 1.48 | MEDIUM LOCA INITIATING EVENT OCCURS CCF OF 2 SQUIB VALVES TO OPERATE HARDWARE FAILURE OF VALVES ON DVI LINE A (V015A & 017) HARDWARE FAILURE OF VALVES ON DVI LINE B (V015B & 017) | 4.36E-04 5.90E-05 5.07E-02 5.07E-02 | IEV-MLOCA ADX-EV-SA2 RNAMOD09 RNBMOD10 |
| 17 | 6.41E-11 | 1.44 | MEDIUM LOCA INITIATING EVENT OCCURS DUE TO CCF OF 4TH STAGE ADS SQUIB VALVES TO OPERATE CCF OF STOP CHECK VALVES V015A/B TO OPEN | 4.36E-04 3.00E-05 4.90E-03 | IEV-MLOCA ADX-EV-SA RNX-KV1-GO |
| 18 | 5.53E-11 | 1.24 | MEDIUM LOCA INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B UNAVAILABILITY OF BUS ECS ES 2 DUE TO UNSCHEDULED MAINTENANCE | 4.36E-04 4.70E-05 2.70E-03 | IEV-MLOCA CCX-BY-PN EC2BS002TM |
| 19 | 5.53E-11 | 1.24 | MEDIUM LOCA INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 4.36E-04 4.70E-05 2.70E-03 | IEV-MLOCA CCX-BY-PN EC2BS022TM |

Table 59-12 (Sheet 3 of 3)

SEQUENCE 9 – MEDIUM LOCA DOMINANT CUTSETS (MLOCA-12)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------|------------|
| 20 | 5.53E-11 | 1.24 | MEDIUM LOCA INITIATING EVENT OCCURS | 4.36E-04 | IEV-MLOCA |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC2BS221TM |
| 21 | 5.53E-11 | 1.24 | MEDIUM LOCA INITIATING EVENT OCCURS | 4.36E-04 | IEV-MLOCA |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | UNAVAILABILITY OF BUS ECS ES 1 DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC1BS001TM |
| 22 | 5.53E-11 | 1.24 | MEDIUM LOCA INITIATING EVENT OCCURS | 4.36E-04 | IEV-MLOCA |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC1BS012TM |
| 23 | 5.53E-11 | 1.24 | MEDIUM LOCA INITIATING EVENT OCCURS | 4.36E-04 | IEV-MLOCA |
| | | | COMMON CAUSE FAILURE OF THE BATTERIES IDSA-DB-1A/1B | 4.70E-05 | CCX-BY-PN |
| | | | BUS UNAVAILABLE DUE TO UNSCHEDULED MAINTENANCE | 2.70E-03 | EC1BS121TM |
| 24 | 4.50E-11 | 1.01 | MEDIUM LOCA INITIATING EVENT OCCURS | 4.36E-04 | IEV-MLOCA |
| | | | CCF OF 2 SQUIB VALVES TO OPERATE | 5.90E-05 | ADX-EV-SA2 |
| | | | CHECK VALVE V013 FAILURE TO OPEN | 1.75E-03 | RNNCV013GO |
| 25 | 3.92E-11 | .88 | MEDIUM LOCA INITIATING EVENT OCCURS | 4.36E-04 | IEV-MLOCA |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDS1TM |
| | | | BUS UNAVAILABLE DUE TO TEST OR CORRECTIVE MAINTENANCE | 3.00E-04 | IDBBSDS1TM |

Table 59-13 (Sheet 1 of 3)

SEQUENCE 10 – SPURIOUS ADS ACTUATION DOMINANT CUTSETS (SPADS-09)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|--|----------------------------------|---------------------------------------|
| 1 | 2.75E-09 | 73.90 | SPURIOUS ADS INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF 2 ACCUMULATOR CHECK VALVES | 5.40E-05 5.10E-05 | IEV-SPADS ACX-CV-GO |
| 2 | 1.65E-10 | 4.43 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 029B FAILS TO OPEN CHECK VALVE 029A FAILS TO OPEN | 5.40E-05 1.75E-03 1.75E-03 | IEV-SPADS ACBCV029GO ACACV029GO |
| 3 | 1.65E-10 | 4.43 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 029B FAILS TO OPEN CHECK VALVE 028A FAILS TO OPEN | 5.40E-05 1.75E-03 1.75E-03 | IEV-SPADS ACBCV029GO ACACV028GO |
| 4 | 1.65E-10 | 4.43 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 028B FAILS TO OPEN CHECK VALVE 029A FAILS TO OPEN | 5.40E-05 1.75E-03 1.75E-03 | IEV-SPADS ACBCV028GO ACACV029GO |
| 5 | 1.65E-10 | 4.43 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 028B FAILS TO OPEN CHECK VALVE 028A FAILS TO OPEN | 5.40E-05 1.75E-03 1.75E-03 | IEV-SPADS ACBCV028GO ACACV028GO |
| 6 | 6.87E-11 | 1.85 | SPURIOUS ADS INITIATING EVENT OCCURS FLOW TUNING ORIFICE PLUGS CHECK VALVE 029A FAILS TO OPEN | 5.40E-05 7.27E-04 1.75E-03 | IEV-SPADS ACBOR001SP ACACV029GO |
| 7 | 6.87E-11 | 1.85 | SPURIOUS ADS INITIATING EVENT OCCURS FLOW TUNING ORIFICE PLUGS CHECK VALVE 028A FAILS TO OPEN | 5.40E-05 7.27E-04 1.75E-03 | IEV-SPADS ACBOR001SP ACACV028GO |
| 8 | 6.87E-11 | 1.85 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 029B FAILS TO OPEN FLOW TUNING ORIFICE PLUGS | 5.40E-05 1.75E-03 7.27E-04 | IEV-SPADS ACBCV029GO ACAOR001SP |
| 9 | 6.87E-11 | 1.85 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 028B FAILS TO OPEN FLOW TUNING ORIFICE PLUGS | 5.40E-05 1.75E-03 7.27E-04 | IEV-SPADS ACBCV028GO ACAOR001SP |
| 10 | 2.85E-11 | .77 | SPURIOUS ADS INITIATING EVENT OCCURS FLOW TUNING ORIFICE PLUGS FLOW TUNING ORIFICE PLUGS | 5.40E-05 7.27E-04 7.27E-04 | IEV-SPADS ACBOR001SP ACAOR001SP |

Table 59-13 (Sheet 2 of 3)

SEQUENCE 10 – SPURIOUS ADS ACTUATION DOMINANT CUTSETS (SPADS-09)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------------------------------|---------------------------------------|
| 11 | 6.48E-12 | .17 | SPURIOUS ADS INITIATING EVENT OCCURS COMMON CAUSE FAILURE OF ACCUMULATOR TANKS | 5.40E-05 1.20E-07 | IEV-SPADS ACX-TK-AF |
| 12 | 2.27E-13 | .01 | SPURIOUS ADS INITIATING EVENT OCCURS ACCUMULATOR TANK B (T001B) RUPTURES CHECK VALVE 029A FAILS TO OPEN | 5.40E-05 2.40E-06 1.75E-03 | IEV-SPADS ACBTK001AF ACACV029GO |
| 13 | 2.27E-13 | .01 | SPURIOUS ADS INITIATING EVENT OCCURS ACCUMULATOR TANK B (T001B) RUPTURES CHECK VALVE 028A FAILS TO OPEN | 5.40E-05 2.40E-06 1.75E-03 | IEV-SPADS ACBTK001AF ACACV028GO |
| 14 | 2.27E-13 | .01 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 029B FAILS TO OPEN ACCUMULATOR TANK A (T001A) RUPTURES | 5.40E-05 1.75E-03 2.40E-06 | IEV-SPADS ACBCV029GO ACATK001AF |
| 15 | 2.27E-13 | .01 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 028B FAILS TO OPEN ACCUMULATOR TANK A (T001A) RUPTURES | 5.40E-05 1.75E-03 2.40E-06 | IEV-SPADS ACBCV028GO ACATK001AF |
| 16 | 9.42E-14 | .00 | SPURIOUS ADS INITIATING EVENT OCCURS ACCUMULATOR TANK B (T001B) RUPTURES FLOW TUNING ORIFICE PLUGS | 5.40E-05 2.40E-06 7.27E-04 | IEV-SPADS ACBTK001AF ACAOR001SP |
| 17 | 9.42E-14 | .00 | SPURIOUS ADS INITIATING EVENT OCCURS FLOW TUNING ORIFICE PLUGS ACCUMULATOR TANK A (T001A) RUPTURES | 5.40E-05 7.27E-04 2.40E-06 | IEV-SPADS ACBOR001SP ACATK001AF |
| 18 | 6.80E-14 | .00 | SPURIOUS ADS INITIATING EVENT OCCURS FLOW TUNING ORIFICE RUPTURE CHECK VALVE 029A FAILS TO OPEN | 5.40E-05 7.20E-07 1.75E-03 | IEV-SPADS ACBOR001EB ACACV029GO |
| 19 | 6.80E-14 | .00 | SPURIOUS ADS INITIATING EVENT OCCURS FLOW TUNING ORIFICE RUPTURE CHECK VALVE 028A FAILS TO OPEN | 5.40E-05 7.20E-07 1.75E-03 | IEV-SPADS ACBOR001EB ACACV028GO |
| 20 | 6.80E-14 | .00 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 029B FAILS TO OPEN FLOW TUNING ORIFICE RUPTURE | 5.40E-05 1.75E-03 7.20E-07 | IEV-SPADS ACBCV029GO ACAOR001EB |

Table 59-13 (Sheet 3 of 3)

SEQUENCE 10 – SPURIOUS ADS ACTUATION DOMINANT CUTSETS (SPADS-09)

| NUMBER | CUTSET PROB. | PERCENTAGE | BASIC EVENT NAME | | |
|--------|--------------|------------|---|----------------------------------|---------------------------------------|
| 21 | 6.80E-14 | .00 | SPURIOUS ADS INITIATING EVENT OCCURS CHECK VALVE 028B FAILS TO OPEN FLOW TUNING ORIFICE RUPTURE | 5.40E-05 1.75E-03 7.20E-07 | IEV-SPADS ACBCV028GO ACAOR001EB |
| 22 | 2.83E-14 | .00 | SPURIOUS ADS INITIATING EVENT OCCURS FLOW TUNING ORIFICE RUPTURE FLOW TUNING ORIFICE PLUGS | 5.40E-05 7.20E-07 7.27E-04 | IEV-SPADS ACBOR001EB ACAOR001SP |
| 23 | 2.83E-14 | .00 | SPURIOUS ADS INITIATING EVENT OCCURS FLOW TUNING ORIFICE PLUGS FLOW TUNING ORIFICE RUPTURE | 5.40E-05 7.27E-04 7.20E-07 | IEV-SPADS ACBOR001SP ACAOR001EB |

| Table 59-14 | | | |
|---|-------------|-----------------|--|
| TYPICAL SYSTEM FAILURE PROBABILITIES, SHOWING HIGHER RELIABILITIES FOR SAFETY SYSTEMS | | | |
| Failure System/Function | Probability | Fault Tree Name | |
| CMT Valve Signal | 5.7E-07 | CMT-IC11 | (one train; auto and manual actuation) |
| PRHR Valve Signal | 1.1E-06 | RHR-IC01 | (one train; auto and manual actuation) |
| Passive Cont. Cool. | 1.8E-06 | PCT | |
| Reactor Trip by PMS | 1.2E-05 | RTPMS | (including operator actions) |
| Accumulators | 6.9E-05 | AC2AB | |
| IRWST Inj. | 6.9E-05 | IW2AB | |
| ADS | 9.3E-05 | ADS | (including operator actions) |
| Passive PRHR | 2.0E-04 | PRT | |
| Core Makeup Tanks | 1.1E-04 | CM2SL | |
| 125 vdc 1E Bus | 3.1E-04 | IDADS1 | (one bus only) |
| DC Bus (Non-1E) | 3.4E-04 | ED1DS1 | (one bus only) |
| RC Pump Trip | 5.9E-04 | RCT | |
| Hydrogen Control | 1.0E-01 | VLH | |
| Chilled Water | 1.4E-03 | VWH | |
| Containment Isol. | 1.6E-03 | CIC | |
| Reactor Trip by DAS | 1.7E-03 | DAS | (including operator action; excluding MGSET failure) |
| 6900 vac Bus | 3.2E-03 | ECES1 | (one bus only) |
| CVS | 3.4E-03 | CVS1 | |
| 480 vac Bus | 5.9E-03 | ECEK11 | (one bus only) |
| Service Water | 6.2E-03 | SWT | |
| Comp. Cooling Water | 6.3E-03 | CCT | |
| Diesel Generators | 1.0E-02 | DGEN | |
| Startup Feedwater | 1.7E-02 | SFWT | |
| Compressed Air | 1.3E-02 | CAIR | |
| Condenser | 2.4E-02 | CDS | |
| Main Feedwater | 2.8E-02 | FWT | (including condenser) |
| RNS | 9.1E-02 | RNR | |
| Hydrogen Control | 1.0E-01 | VLH | |

| Table 59-15 | | | | |
|-------------------------------|-------------------------------------|------------------------|---------------------------------------|-----------------|
| SUMMARY OF AP1000 PRA RESULTS | | | | |
| Events | Core Damage Frequency (per year) | | Large Release Frequency (per year) | |
| | At-Power | Shutdown | At-Power | Shutdown |
| Internal Events | 2.41E-07 | 1.23E-07 | 1.95E-08 | 2.05E-08 |
| Internal Flood | 8.82E-10 | 3.22E-09 | 7.14E-11 | 5.37E-10 |
| Internal Fire | 5.61E-08 | 8.5E-08 ⁽¹⁾ | 4.54E-09 | 1.43E-08 |
| Sum = | 2.97E-07 | 2.11E-07 | 2.41E-08 | 3.53E-08 |

Note:

1. Internal fire during shutdown is evaluated quantitatively as a response to an NRC question and is not reported elsewhere in this document.

Table 59-16

SITE BOUNDARY WHOLE BODY EDE DOSE RISK – 24 HOURS

| Release Category | Release Frequency (/reactor year) | Mean Dose (sieverts) | Dose (REM) | Risk (REM/reactor year) | Percent Contribution to Total Risk |
|-------------------------|--|-----------------------------|---------------------|--------------------------------|---|
| CFI | 1.89E-10 | 2.59E+01 | 2.59E+03 | 4.90E-07 | 0.3 |
| CFE | 7.47E-09 | 4.23E+01 | 4.23E+03 | 3.16E-05 | 17.3 |
| IC | 2.21E-07 | 1.82E-02 | 1.82E+00 | 4.02E-07 | 0.2 |
| BP | 1.05E-08 | 1.37E+02 | 1.37E+04 | 1.44E-04 | 78.6 |
| CI | 1.33E-09 | 5.10E+01 | 5.10E+03 | 6.78E-06 | 3.7 |
| CFL | 3.45E-13 | 3.84E-02 | 3.84E+00 | 1.32E-12 | 0.0 |
| | 2.4E-07 | | Total Risk = | 1.83E-04 | 100.0 |

Table 59-17

COMPARISON OF AP1000 PRA RESULTS TO RISK GOALS

| Plant/Goal | Core Damage Frequency | Large Release Frequency | Containment Success Probability |
|----------------------------|------------------------------|--------------------------------|--|
| Current PWR ⁽¹⁾ | 6.7E-05 | 5.3E-06 | 92% |
| NRC Safety Goal | 1E-04 | 1E-06 | 90% |
| AP600 | 1.7E-07 | 1.8E-08 | 89% |
| AP1000 | 2.41E-07 | 1.95E-08 | 92% |

Note:

1. Selected IPE result (two-loop Westinghouse PWR – internal at-power events and at-power flooding only). Note that there is no shutdown PRA requirement for currently operating plants.

| Table 59-18 (Sheet 1 of 24) | |
|---|--|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>1. The passive core cooling system (PXS) is composed of the following:</p> <ul style="list-style-type: none"> - Accumulator subsystem - Core makeup tank (CMT) subsystem - In-containment refueling water storage tank (IRWST) subsystem - Passive residual heat removal (PRHR) subsystem. <p>The automatic depressurization system (ADS), which is part of the reactor coolant system (RCS), also supports passive core cooling functions.</p> | |
| <p>1a. The accumulators provide a safety-related means of safety injection of borated water to the RCS.</p> <p>The following are some important aspects of the accumulator subsystem as represented in the PRA:</p> <ul style="list-style-type: none"> - There are two accumulators, each with an injection line to the reactor vessel/direct vessel injection (DVI) nozzle. Each injection line has two check valves in series. - The reliability of the accumulator subsystem is important. The accumulator subsystem is included in the D-RAP. - Diversity between the accumulator check valves and the CMT check valves minimizes the potential for common cause failures. | <p>6.3.2</p> <p>Tier 1 Information</p> <p>17.4</p> <p>6.3.2</p> |
| <p>1b. ADS provides a safety-related means of depressurizing the RCS.</p> <p>The following are some important aspects of ADS as represented in the PRA:</p> <p>ADS has four stages. Each stage is arranged into two separate groups of valves and lines.</p> <ul style="list-style-type: none"> - Stages 1, 2, and 3 discharge from the top of the pressurizer to the IRWST - Stage 4 discharges from the hot leg to the RCS loop compartment. <p>Each stage 1, 2, and 3 line contains two motor-operated valves (MOVs).</p> <p>Each stage 4 line contains an MOV valve and a squib valve.</p> <p>The valve arrangement and positioning for each stage is designed to reduce spurious actuation of ADS.</p> <ul style="list-style-type: none"> - Stage 1, 2, and 3 MOVs are normally closed and have separate controls. - Each stage 4 squib valve actuation requires signals from two separate PMS cabinets. - Stage 4 is blocked from opening at high RCS pressures. | <p>Tier 1 Information</p> <p>Tier 1 Information</p> <p>Tier 1 Information</p> <p>Tier 1 Information</p> <p>6.3.2 & 7.3</p> |

Table 59-18 (Sheet 2 of 24)

AP1000 PRA-BASED INSIGHTS

| Insight | Disposition |
|--|-------------------------------|
| 1b. (cont.) | |
| <p>The ADS valves are automatically and manually actuated via the protection and safety monitoring system (PMS), and manually actuated via the diverse actuation system (DAS).</p> | Tier 1 Information |
| <p>The ADS valves are powered from Class 1E power.</p> | Tier 1 Information |
| <p>The ADS valve positions are indicated and alarmed in the control room.</p> | 6.3.7 |
| <p>Stage 1, 2, and 3 valves are stroke-tested every cold shutdown. Stage 4 squib valve actuators are tested every 2 years for 20% of the valves.</p> | 3.9.6 |
| <p>Because of the potential for counter-current flow limitation in the surgeline, it is essential to establish and maintain venting capability with ADS Stage 4 for gravity injection and containment recirculation following an extended loss of RNS when the RCS is open during shutdown operations.</p> | 6.3.3.4.3 |
| <p>ADS 4th stage squib valves receive a signal to open during shutdown conditions using PMS low hot leg level logic.</p> | 6.3.3.4.3 |
| <p>The reliability of the ADS is important. The ADS is included in the D-RAP.</p> | 17.4 |
| <p>ADS is required by the Technical Specifications to be available in Modes 1 through 6 without the cavity flooded.</p> | 16.1 |
| <p>Stages 1, 2, and 3, connected to the top of the pressurizer, provide a vent path to preclude pressurization of the RCS during shutdown conditions if decay heat removal is lost.</p> | 16.1 |
| <p>Depressurization of the RCS through ADS minimizes the potential for high-pressure melt ejection events.</p> | |
| <ul style="list-style-type: none"> - Procedures will be provided for use of the ADS for depressurization of the RCS after core uncover. | Emergency Response Guidelines |
| <p>The ADS mitigates high pressure core damage events which can produce challenges to containment integrity due to the following severe accident phenomena:</p> | 19.36 |
| <ul style="list-style-type: none"> - High pressure melt ejection - Direct containment heating - Induced steam generator tube rupture - Induced RCS piping rupture and rapid hydrogen release to containment | |

| Table 59-18 (Sheet 3 of 24) | |
|---|--|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>1c. The CMTs provide safety-related means of high-pressure safety injection of borated water to the RCS.</p> <p>The following are some important aspects of CMT subsystem as represented in the PRA:</p> <p>There are two CMTs, each with an injection line to the reactor vessel/DVI nozzle.</p> <ul style="list-style-type: none"> - Each CMT has a normally open pressure balance line from an RCS cold leg. - Each injection line is isolated with a parallel set of air-operated valves (AOVs). - These AOVs open on loss of Class 1E dc power, loss of air, or loss of the signal from the PMS. - The injection line for each CMT also has two normally open check valves in series. <p>The CMT AOVs are automatically and manually actuated from PMS and DAS.</p> <p>CMT level instrumentation provides an actuation signal to initiate automatic ADS and provides the actuation signal for the IRWST squib valves to open.</p> <p>The CMT AOV positions are indicated and alarmed in the control room.</p> <p>CMT AOVs are stroke-tested quarterly.</p> <p>The CMTs are risk-important for power conditions because the level indicators in the CMTs provide an open signal to ADS and to the IRWST squib valves as the CMTs empty.</p> <ul style="list-style-type: none"> - The CMT subsystem is included in the D-RAP. <p>CMT is required by the Technical Specifications to be available in Modes 1 through 5 with RCS pressure boundary intact.</p> | <p>6.3.1</p> <p>6.3.2</p> <p>Tier 1 Information</p> <p>6.3.1 & 7.3.1</p> <p>6.3.7</p> <p>3.9.6</p> <p>17.4</p> <p>16.1</p> |

| Table 59-18 (Sheet 5 of 24) | |
|---|---|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>1d. (cont.)</p> <p>The positions of the squib valves and MOVs are indicated and alarmed in the control room.</p> <p>IRWST injection and recirculation check valves are exercised at each refueling. IRWST injection and recirculation squib valve actuators are tested every 2 years for 20% of the valves (This does not require valve actuation). IRWST recirculation MOVs are stroke-tested quarterly.</p> <p>The reliability of the IRWST subsystem is important. The IRWST subsystem is included in the D-RAP.</p> <p>IRWST injection and recirculation are required by Technical Specifications to be available in Modes 1 through 6 without the cavity flooded.</p> <p>The operator action to flood the reactor cavity is determined in Emergency Response Guideline AFR-C.1, which instructs the operator to flood the reactor cavity when the core-exit thermocouples reach 1200°F.</p> <p>PXS recirculation valves are automatically actuated by a low IRWST level signal or manually from the control room, if automatic actuation fails.</p> | <p>6.3.7</p> <p>3.9.6</p> <p>17.4</p> <p>16.1</p> <p>Emergency Response Guidelines</p> <p>6.3</p> |
| <p>1e. Passive residual heat removal (PRHR) provides a safety-related means of performing the following functions:</p> <ul style="list-style-type: none"> - Removes core decay heat during accidents - Allows automatic termination of RCS leak during a steam generator tube rupture (SGTR) without ADS - Allows plant to ride out an ATWS event without rod insertion. <p>The following are some important aspects of the PRHR subsystem as represented in the PRA:</p> <p>PRHR is actuated by opening redundant parallel air-operated valves. These air-operated valves open on loss of Class 1E power, loss of air, or loss of the signal from PMS.</p> <p>The PRHR air-operated valves are automatically actuated and manually actuated from the control room by either PMS or DAS.</p> <p>Diversity of the PRHR air-operated valves from the CMT air-operated valves minimizes the probability for common cause failure of both PRHR and CMT air-operated valves.</p> | <p>6.3.1 & 6.3.3</p> <p>PRA App. A4</p> <p>6.3.2</p> <p>Tier 1 Information</p> <p>6.3.2</p> |

Table 59-18 (Sheet 6 of 24)

AP1000 PRA-BASED INSIGHTS

| Insight | Disposition |
|--|-------------------------|
| 1e. (cont.) | |
| <p>Long-term cooling of PRHR will result in steaming to the containment. The steam will normally condense on the containment shell and return to the IRWST by safety-related features. Connections are provided to IRWST from the spent fuel system (SFS) and chemical and volume control system (CVS) to extend PRHR operation. A safety-related makeup connection is also provided from outside the containment through the normal residual heat removal system (RNS) to the IRWST.</p> | 6.3.1 & system drawings |
| <p>Capability exists and guidance is provided for the control room operator to identify a leak in the PRHR HX of 500 gpd. This limit is based on the assumption that a single crack leaking this amount would not lead to a PRHR HX tube rupture under the stress conditions involving the pressure and temperature gradients expected during design basis accidents, which the PRHR HX is designed to mitigate.</p> | 6.3.3 & 16.1 |
| <p>The positions of the inlet and outlet PRHR valves are indicated and alarmed in the control room.</p> | 6.3.7 |
| <p>PRHR air-operated valves are stroke-tested quarterly. The PRHR HX is tested to detect system performance degradation every 10 years.</p> | 3.9.6 |
| <p>PRHR is required by Technical Specifications to be available from Modes 1 through 5 with RCS pressure boundary intact.</p> | 16.1 |
| <p>The PRHR HX, in conjunction with the PCS, can provide core cooling for an indefinite period of time. After the IRWST water reaches its saturation temperature, the process of steaming to the containment initiates. Condensation occurs on the steel containment vessel, and the condensate is collected in a safety-related gutter arrangement, which returns the condensate to the IRWST. The gutter normally drains to the containment sump, but when the PRHR HX actuates, safety-related isolation valves in the gutter drain line shut and the gutter overflow returns directly to the IRWST. The following design features provide proper re-alignment for the gutter system valves to direct water to the IRWST:</p> | 6.3.2.1.1 & 6.3.7.6 |
| <ul style="list-style-type: none"> - IRWST gutter and its drain isolation valves are safety-related - These isolation valves are designed to fail closed on loss of compressed air, loss of Class 1E dc power, or loss of the PMS signal - These isolation valves are actuated automatically by PMS and DAS. | 7.3.1.2.7 |
| <p>The PRHR subsystem provides a safety-related means of removing decay heat following loss of RNS cooling during shutdown conditions with the RCS intact.</p> | 16.1 |

| Table 59-18 (Sheet 7 of 24) | |
|---|--|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>2. The protection and safety monitoring system (PMS) provides a safety-related means of performing the following functions:</p> <ul style="list-style-type: none"> - Initiates automatic and manual reactor trip - Automatic and manual actuation of engineered safety features (ESF). <p>PMS monitors the safety-related functions during and following an accident as required by Regulatory Guide 1.97.</p> <p>PMS initiates an automatic reactor trip and an automatic actuation of ESF. PMS provides manual initiation of reactor trip. PMS 2-out-of-4 initiation logic reverts to a 2-out-of-3 coincidence logic if one of the 4 channels is bypassed. PMS does not allow simultaneous bypass of 2 redundant channels.</p> <p>PMS has redundant divisions of safety-related post-accident parameter display.</p> <p>Each PMS division is powered from its respective Class 1E dc and UPS division.</p> <p>PMS provides fixed position controls in the control room.</p> <p>Reliability of the PMS is provided by the following:</p> <ul style="list-style-type: none"> - The reactor trip functions are divided into two subsystems. - The ESF functions are processed by two microprocessor-based subsystems that are functionally identical in both hardware and software. <p>Four sensors normally monitor variables used for an ESF actuation. These sensors may monitor the same variable for a reactor trip function.</p> <p>Continuous automatic PMS system monitoring and failure detection/alarm is provided.</p> <p>PMS equipment is designed to accommodate a loss of the normal heating, ventilation, and air conditioning (HVAC). PMS equipment is protected by the passive heat sinks upon failure or degradation of the active HVAC.</p> <p>The reliability of the PMS is important. The PMS is included in the D-RAP.</p> <p>The PMS software is designed, tested, and maintained to be reliable under a controlled verification and validation program written in accordance with IEEE 7-4.3.2 (1993) that has been endorsed by Regulatory Guide 1.152. Elements that contribute to a reliable software design include:</p> <ul style="list-style-type: none"> - A formalized development, modification, and acceptance process in accordance with an approved software QA plan (paraphrased from IEEE standard, section 5.3, "Quality") | <p>Tier 1 Information</p> <p>7.1.1</p> <p>Tier 1 Information</p> <p>7.5.2.2.1 & 7.5.4</p> <p>Tier 1 Information</p> <p>Tier 1 Information</p> <p>7.1.2.1.1</p> <p>7.1.2.2</p> <p>7.3.1</p> <p>7.1.2</p> <p>3.11 & 6.4</p> <p>17.4</p> <p>App 1A (Compliance with Reg. Guide 1.152)</p> |

| Table 59-18 (Sheet 9 of 24) | |
|--|--|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>3. (cont.)</p> <p>In the PRA it is assumed the following eliminates the potential for common cause failures between automatic and manual DAS functions.</p> <ul style="list-style-type: none"> - DAS manual initiation functions are implemented in a manner that bypasses the signal processing equipment of the DAS automatic logic. <p>The DAS, including the M-G set field breakers, is included in the D-RAP.</p> | <p>Tier 1 Information</p> <p>17.4</p> |
| <p>4. The plant control system (PLS) provides a nonsafety-related means of controlling nonsafety-related equipment.</p> <ul style="list-style-type: none"> - Automatic and manual control of nonsafety-related functions, including “defense-in-depth” functions. - Provides control room indication for monitoring overall plant and nonsafety-related system performance. <p>PLS has appropriate redundancy to minimize plant transients.</p> <p>PLS provides capability for both automatic control and manual control.</p> <p>Signal selector algorithms provide the PLS with the ability to obtain inputs from the PMS. The signal selector algorithms select those protection system signals that represent the actual status of the plant and reject erroneous signals.</p> <p>PLS control functions are distributed across multiple distributed controllers so that single failures within a controller do not degrade the performance of control functions performed by other controllers.</p> | <p>7.1.3 & 7.7.1</p> <p>7.1.3 & 7.7.1.12</p> <p>7.1.3</p> <p>7.1.3.2</p> <p>7.1.3.1</p> |
| <p>5. The onsite power system consists of the main ac power system and the dc power system. The main ac power system is a non-Class 1E system. The dc power system consists of two independent systems: the Class 1E dc system and the non-Class 1E dc system.</p> | |
| <p>5a. The onsite main ac power system is a non-Class 1E system comprised of a normal, preferred, and standby power supplies.</p> <p>The main ac power system distributes power to the reactor, turbine, and balance of plant auxiliary electrical loads for startup, normal operation, and normal/emergency shutdown.</p> <p>The arrangement of the buses permits feeding functionally redundant pumps or groups of loads from separate buses and enhances the plant operational reliability.</p> | <p>8.3.1.1</p> <p>8.3.1.1.1</p> <p>8.3.1.1.1</p> |

| Table 59-18 (Sheet 10 of 24) | |
|---|---|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>5a. (cont.)</p> <p>During power generation mode, the turbine generator normally supplies electric power to the plant auxiliary loads through the unit auxiliary transformers. During plant startup, shutdown, and maintenance, the main ac power is provided from the high-voltage switchyard. The onsite standby power system powered by the two onsite standby diesel generators supplies power to selected loads in the event of loss of normal and preferred ac power supplies.</p> <p>Two onsite standby diesel generator units, each furnished with its own support subsystems, provide power to the selected plant nonsafety-related ac loads.</p> <p>On loss of power to a 6900 V diesel-backed bus, the associated diesel generator automatically starts and produces ac power. The normal source circuit breaker and bus load circuit breakers are opened, and the generator is connected to the bus. Each generator has an automatic load sequencer to enable controlled loading on the associated buses.</p> | <p>8.3.1.1.1</p> <p>8.3.1.1.2.1</p> <p>Tier 1 Information</p> |
| <p>5b. The Class 1E dc and uninterruptible power supply (UPS) system (IDS) provides reliable power for the safety-related equipment required for the plant instrumentation, control, monitoring, and other vital functions needed for shutdown of the plant.</p> <p>There are four independent, Class 1E 125 Vdc divisions. Divisions A and D each consists of one battery bank, one switchboard, and one battery charger. Divisions B and C are each composed of two battery banks, two switchboards, and two battery chargers. The first battery bank in the four divisions is designated as the 24-hour battery bank. The second battery bank in Divisions B and C is designated as the 72-hour battery bank.</p> <p>The 24-hour battery banks provide power to the loads required for the first 24 hours following an event of loss of all ac power sources concurrent with a design basis accident. The 72-hour battery banks provide power to those loads requiring power for 72 hours following the same event.</p> <p>Battery chargers are connected to dc switchboard buses. The input ac power for the Class 1E dc battery chargers is supplied from non-Class 1E 480 Vac diesel-generator-backed motor control centers.</p> <p>The 24-hour and the 72-hour battery banks are housed in ventilated rooms apart from chargers and distribution equipment.</p> <p>Each of the four divisions of dc systems are electrically isolated and physically separated to prevent an event from causing the loss of more than one division.</p> <p>The Class 1E batteries are included in the D-RAP.</p> | <p>8.3.2.1</p> <p>Tier 1 Information</p> <p>Tier 1 Information</p> <p>8.3.2.1.1.1</p> <p>8.3.2.1.3</p> <p>8.3.2.1.3</p> <p>17.4</p> |

Table 59-18 (Sheet 11 of 24)

AP1000 PRA-BASED INSIGHTS

| Insight | Disposition |
|--|--|
| <p>5c. The non-Class 1E dc and UPS system (EDS) consists of the electric power supply and distribution equipment that provide dc and uninterruptible ac power to nonsafety-related loads.</p> <p>The non-Class 1E dc and UPS system consists of two subsystems representing two separate power supply trains.</p> <p>EDS load groups 1, 2, and 3 provide 125 Vdc power to the associated inverter units that supply the ac power to the non-Class 1E uninterruptible power supply ac system.</p> <p>The onsite standby diesel-generator-backed 480 Vac distribution system provides the normal ac power to the battery chargers.</p> <p>The batteries are sized to supply the system loads for a period of at least two hours after loss of all ac power sources.</p> | <p>Tier 1 Information</p> <p>8.3.2.1.2</p> <p>Tier 1 Information</p> <p>Tier 1 Information</p> <p>8.3.2.1.2</p> |
| <p>6. The normal residual heat removal system (RNS) provides a safety-related means of performing the following functions:</p> <ul style="list-style-type: none"> - Containment isolation for the RNS lines that penetrate the containment. - Isolation of the reactor coolant system at the RNS suction and discharge lines. - Pathway for long-term, post-accident makeup of containment inventory. <p>RNS provides a nonsafety-related means of core cooling through:</p> <ul style="list-style-type: none"> - RCS recirculation cooling during shutdown conditions. - Low pressure pumped makeup flow from the SFS cask loading pit and long-term recirculation from the IRWST and the containment. - Heat removal from IRWST during PRHR operation. <p>The RNS has redundant pumps and heat exchangers. The pumps are powered by non-Class 1E power with backup connections from the diesel generators.</p> <p>RNS is manually aligned from the control room to perform its core cooling functions. The performance of the RNS is indicated in the control room.</p> <p>The RNS containment isolation and pressure boundary valves are safety-related. The motor-operated valves are powered by Class 1E dc power.</p> <p>The RNS containment isolation MOVs are automatically and manually actuated via PMS.</p> | <p>Tier 1 Information</p> <p>5.4.7</p> <p>5.4.7 & 8.3</p> <p>5.4.7</p> <p>Tier 1 Information</p> <p>7.3.1.2.20</p> |

| Table 59-18 (Sheet 13 of 24) | |
|--|---|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>9. The chemical and volume control system (CVS) provides a safety-related means to terminate inadvertent RCS boron dilution and to preserve containment integrity by isolation of the CVS lines penetrating the containment.</p> <p>The CVS provides a nonsafety-related means to perform the following functions:</p> <ul style="list-style-type: none"> - Makeup water to the RCS during normal plant operation. - Boration following a failure of reactor trip - Makeup water to the pressurizer auxiliary spray line. <p>Two makeup pumps are provided. Each pump provides capability for normal makeup.</p> <p>Two safety-related air-operated valves provide isolation of normal CVS letdown during shutdown operation on low hot leg level.</p> | <p>Tier 1 Information</p> <p>Tier 1 Information</p> <p>9.3.6.3.1</p> <p>9.3.6.7</p> |
| <p>10. The operation of RNS and its support systems (CCS, SWS, main ac power and onsite power) is RTNSS-important for shutdown decay heat removal during reduced RCS inventory operations.</p> <ul style="list-style-type: none"> - These systems are included in the D-RAP. <p>Short-term availability controls for the RNS during at-power conditions reduce PRA uncertainties.</p> | <p>16.3</p> <p>17.4</p> <p>16.3</p> |
| <p>11. The information used by the COL regarding critical human actions (if any) and risk-important tasks from the PRA, as presented in Chapter 18 of the DCD on human factors engineering, is important in developing and implementing procedures, training, and other human reliability related programs.</p> | <p>18</p> |
| <p>12. Sufficient instrumentation and control is provided at the remote shutdown workstation to bring the plant to safe shutdown conditions in case the control room must be evacuated.</p> <p>There are no differences between the main control room and remote shutdown workstation controls and monitoring that would be expected to affect safety system redundancy and reliability.</p> | <p>7.4.3</p> <p>7.4.3.1.1</p> |
| <p>13. Separation or protection of the equipment and cabling among the divisions of safety-related equipment and separation of safety-related from nonsafety-related equipment minimizes the probability that a fire or flood would affect more than one safety-related system or train, except in some areas inside containment where equipment will be capable of achieving safe shutdown prior to damage.</p> <p>Although the containment is a single fire area, adequate design features exist for separation (structural or space), suppression, lack of combustibles, or operator action to ensure the plant can achieve safe shutdown.</p> | <p>3.4.1.1.2 & 9.5.1.1.1, 9.5.1.2.1.1 & 9A</p> <p>9A</p> |

| Table 59-18 (Sheet 14 of 24) | |
|---|---|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>13. (cont.)</p> <p>To prevent flooding in a radiologically controlled area (RCA) in the Auxiliary Building from propagating to non-radiologically controlled areas, the non-RCAs are separated from the RCAs by 2 and 3-foot walls and floor slabs. In addition, electrical penetrations between RCAs and non-RCAs in the Auxiliary Building are located above the maximum flood level.</p> | 3.4.1.2.2.2 |
| <p>14. The following minimizes the probability for fire and flood propagation from one area to another and helps limit risk from internal fires and floods:</p> <ul style="list-style-type: none"> - Fire barriers are sealed, to the extent possible (i.e., doors). - Structural barriers which function as flood barriers are watertight below the maximum flood level. - Establishing administrative controls to maintain the performance of the fire protection system is the responsibility of the COL applicant. | <p>9.5.1.2.1.1</p> <p>3.4.1.1.2</p> <p>Table 9.5.1-1, Item 29</p> |
| <p>15. Fire detection and suppression capability is provided in the design. Flooding control features and sump level indication are provided in the design.</p> <p>Establishing administrative controls to maintain the performance of the fire protection system is the responsibility of the COL applicant.</p> | <p>3.4.1, 9.5.1.2.1.2, & 9.5.1.8</p> <p>Table 9.5.1-1, Item 29</p> |
| <p>16. AP1000 main control room fire ignition frequency is limited as a result of the use of low-voltage, low-current equipment and fiber optic cables.</p> <p>There is no cable spreading room in the AP1000 design.</p> | <p>7.1.2 & 7.1.3</p> <p>Table 9.5.1-1</p> |
| <p>17. Redundancy in control room operations is provided within the control room itself for fires in which control room evacuation is not required.</p> | 9.5.1.2.1.1 |
| <p>18. The remote shutdown workstation provides redundancy of control and monitoring for safe shutdown functions in the event that main control room evacuation is required.</p> <p>The remote shutdown workstation is in a fire and flood area separate from the main control room.</p> | <p>7.4.3 & 9.5</p> <p>3.4.1.2.2.2, 7.1.2, 7.4.3.1.1. & 9A.3.1.2.5</p> |
| <p>19. Although a main control room fire may defeat manual actuation of equipment from the main control room, it will not affect the automatic functioning of safe shutdown equipment via PMS or manual operation from the remote shutdown workstation. This is because the PMS cabinets, in which the automatic functions are housed, are located in fire areas separate from the main control room.</p> | 7.1.2.7 & 9A.3 |

| Table 59-18 (Sheet 15 of 24) | |
|--|--|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>20. The main control room has its own ventilation system, and is pressurized. This prevents smoke, hot gases, or fire suppressants originating in areas outside the control room from entering the control room via the ventilation system.</p> <p>There are separate ventilation systems for safety-related equipment divisions (A & C and B & D). This prevents smoke, hot gases, or fire suppressants originating from one fire area to another to the extent that they could adversely affect safe shutdown capabilities.</p> <p>The ventilation system for the remote shutdown workstation is independent of the ventilation system for the main control room.</p> | <p>9.4.1</p> <p>9.4.1 9.5.1.1.1</p> <p>9.4.1</p> |
| <p>21. AP1000 does not rely on ac power sources for safe shutdown capability since the safety-related passive systems do not require ac power sources for operation. Individual fires resulting in loss of offsite power or affecting onsite standby diesel generator operability do not affect safe shutdown capability.</p> | 8.1.4.2 |
| <p>22. Containment isolation functions are not compromised by internal fire or flood. Redundant containment isolation valves in a given line are located in separate fire and flood areas or zones and, if powered, are served by different control and electrical divisions.</p> <p>One isolation component in a given line is located inside containment, while the other is located outside containment, and the containment wall is a fire/flood barrier.</p> | <p>6.2.3</p> <p>6.2.3, 9.5 & 9A</p> |
| <p>23. The AP1000 design minimizes potential flooding sources in safety-related equipment areas, to the extent possible. The design also minimizes the number of penetrations through enclosure or barrier walls below the probable maximum flood level. Walls, floors, and penetrations are designed to withstand the maximum anticipated hydrodynamic loads.</p> | 3.4.1 |
| <p>24. The Combined License applicant will confirm the AP1000 certified design will review differences between the as-built plant and the basis for the AP1000 seismic margin analysis.</p> | 19.59.10.5 |
| <p>25. The depressurization of the reactor coolant system below 150 psi facilitates in-vessel retention of molten core debris.</p> | 19.36 |
| <p>26. The reflective reactor vessel insulation provides an engineered flow path to allow the ingress of water and venting of steam for externally cooling the vessel in the event of a severe accident involving core relocation to the lower plenum.</p> <p>The reflective insulation panels and support members can withstand pressure differential loading due to the IVR boiling phenomena.</p> <p>Water inlets and steam vents are provided at the entrance and exit of the insulation boundary.</p> <p>The reactor vessel insulation is included in the D-RAP.</p> | <p>19.39, 5.3.5 & Tier 1 Information</p> <p>17.4</p> |

| Table 59-18 (Sheet 16 of 24) | |
|--|---|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| 27. The reactor cavity design provides a reasonable balance between the regulatory requirements for sufficient ex-vessel debris spreading area and the need to quickly submerge the reactor vessel for the in-vessel retention of core debris. | 19.39 & Appendix 19B |
| 28. The design can withstand a best-estimate ex-vessel steam explosion without failing the containment integrity. | Appendix 19B |
| 29. The containment design incorporates defense-in-depth for mitigating direct containment heating by providing no significant direct flow path for the transport of particulated molten debris from the reactor cavity to the upper containment regions. | Appendix 19B |
| 30. The hydrogen control system is comprised of passive autocatalytic recombiners (PARs) and hydrogen igniters to limit the concentration of hydrogen in the containment during accidents and beyond design basis accidents, respectively. Operability of the hydrogen igniters is addressed by short-term availability controls during modes 1, 2, 5 (with RCS pressure boundary open), and 6 (with upper internals in place or cavity levels less than full). The operator action to activate the igniters is the first step in ERG AFR.C-1 to ensure that the igniter activation occurs prior to rapid cladding oxidation. | Tier 1 Information 16.3 Emergency Response Guidelines |
| 31. Mitigation of the effects of a diffusion flames on the containment shell are addressed by the following containment layout features: - Vents from the PXS and CVS compartments (where hydrogen releases can be postulated) to the CMT room are located well away from the containment shell and containment penetrations. The access hatch to the PXS-B compartment is located near the containment wall and is normally closed to address severe accident considerations. The access hatch to the PXS-B compartment is accessible from Room 11300 on elevation 107'-2". - IRWST vents are designed so that those located away from the containment wall open to vent hydrogen releases. In this situation IRWST vents located close to the containment wall would not open because flow of hydrogen through the other vents would not result in a IRWST pressure sufficient to open them. | 1.2, General Arrangement Drawings 3.4.1.2.2.1 & 19.41.7 6.2.4.5.1 |
| 32. The containment structure can withstand the pressurization from a LOCA and the global combustion of hydrogen released in-vessel (10 CFR 50.34(f)). | 19.41 |
| 33. The steam generator should not be depressurized to cool down the RCS if water is not available to the secondary side. This action protects the tubes from large pressure differential and minimizes the potential for creep rupture. The COL will develop and implement severe accident management guidance using the suggested framework provided in WCAP-13914. | 19.59.10 |

| Table 59-18 (Sheet 17 of 24) | |
|---|------------------------------|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| 34. Depressurizing the RCS and maintaining a water level covering the SG tubes on the secondary side can mitigate fission product releases from a steam generator tube rupture accident. The COL will develop and implement severe accident management guidance using the suggested framework provided in WCAP-13914. | 19.59.10 |
| 35. Loss of ac power does not contribute significantly to the core damage frequency. - Nonsafety-related containment spray does not need to be ac independent. | 19.59 |
| 36. AP1000 has a nonsafety-related containment spray system. Containment spray is not credited in the PRA. Failure of the nonsafety-related containment spray does not prevent the plant achieving the safety goals. The COL will develop and implement severe accident management guidance for operation of the nonsafety-related containment spray system using the suggested framework provided in WCAP-13914. | 6.5.2 19.59 19.59.10 |
| 37. Passive containment can withstand severe accidents without PCS water cooling the containment shell. Air cooling alone is sufficient to maintain containment pressure below failure pressure with high probability. | 19.40 |
| 38. Operation of ADS stage 4 provides a vent path for the severe accident hydrogen to the steam generator compartments, bypassing the IRWST, and mitigating the conditions required to produce a diffusion flame near the containment wall. | 19.41 |
| 39. Containment isolation valves controlled by DAS are important in limiting offsite releases following core melt accidents. The containment isolation valves are included in the D-RAP. Operability of DAS for selected containment isolation actuations is addressed by short-term availability controls. | 17.4 16.3 |
| 40. Reflooding the reactor pressure vessel through the break can have a significant effect on a severe accident by quenching core debris, achieving a controlled stable state, and producing hydrogen. | 19.38 & 19.41 |
| 41. The type of concrete used in the basemat is not important. The reactor cavity design incorporates features that extend the time to basemat melt-through in the event of RPV failure. The cavity design includes: - A minimum floor area of 48 m ² available for spreading of the molten core debris - A minimum thickness of concrete above the embedded containment liner of 0.85 m | Appendix 19B Appendix 19B |

| Table 59-18 (Sheet 18 of 24) | |
|--|-------------------------------|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>41. (cont.)</p> <ul style="list-style-type: none"> - There is no piping buried in the concrete beneath the reactor cavity; sump drain lines are not enclosed in either of the reactor cavity floor or reactor cavity sump concrete. Thus, there is no direct pathway from the reactor cavity to outside the containment in the event of core-concrete interactions. - The openings between the reactor cavity and cavity sump are small diameter openings in which core debris in the cavity will solidify. Thus, there is no direct pathway for core debris to enter the sump, except in the case where it might spill over the sump curbing. | |
| 42. No safety-related equipment is located outside the Nuclear Island. | 1.2 & 3.4.1 |
| <p>43. Capability exists to vent the containment.</p> <p>The COL will develop and implement severe accident management guidance for venting containment using the suggested framework provided in WCAP-13914.</p> | Appendix 19D 19.59.10 |
| <p>44. A list of risk-important systems, structures, and components (SSCs) has been provided in the D-RAP.</p> <p>The risk-significant SSCs are included in the D-RAP.</p> | 17.4 17.4 |
| 45. The Combined License applicant referencing the AP1000 certified design will review differences between the as-built plant and the design used as the basis for the AP1000 PRA and Table 59-18. If the effects of the differences are shown, by a screening analysis, to potentially result in a significant increase in core damage frequency or large release frequency, the PRA will be updated to reflect these differences. Based on site-specific information, the COL should also reevaluate the qualitative screening of external events (PRA Section 58.1). If any site-specific susceptibilities are found, the PRA should be updated to include the applicable external event. | 19.59.10 |
| <p>46. There are no watertight doors used for flood protection in the AP1000 design.</p> <p>Plugging of the drain headers is minimized by designing them large enough to accommodate more than the design flow and by making the flow path as straight as possible.</p> | 3.4.1.1.2 9.3.5.1.2 |
| 47. The maintenance guidelines as described in the Shutdown Evaluation Report (WCAP-14837) should be considered when developing the plant specific operations procedures. | 13.5.1 |
| 48. The COL will establish procedures to control transient combustibles. | Table 9.5.1-1, Items 77-83 |

Table 59-18 (Sheet 19 of 24)

AP1000 PRA-BASED INSIGHTS

| Insight | Disposition |
|---|----------------|
| 49. There are two compartments inside containment (PXS-A and PXS-B) containing safe shutdown equipment that normally do not flood although they are below the maximum flood height. Each of these two compartments contains redundant and essentially identical equipment (one accumulator with associated isolation valves as well as isolation valves for one CMT, one IRWST injection line, and one containment recirculation line). A pipe break in one of these compartments can cause that room to flood. These two compartments are physically separated to ensure that a flood in one compartment does not propagate to the other. Drain lines from the PXS-A and PXS-B compartments to the reactor vessel cavity and steam generator compartment are protected from backflow by redundant backflow preventers. | 3.4.1.2.2.1 |
| 50. There are seven automatically actuated containment isolation valves inside containment subject to flooding. These seven normally closed containment isolation valves would not fail open as a result of the compartment flooding. Also, there is a redundant, normally closed, containment isolation valve located outside containment in series with each of these valves. | 3.4.1.2.2.1 |
| 51. The passive containment cooling system (PCS) cooling water not evaporated from the vessel wall flows down to the bottom of the containment annulus. Two 100-percent drain openings, located in the side wall of the Shield Building, are always open with screens provided to prevent entry of small animals into the drains. | 19.40 |
| 52. The major rooms housing divisional cabling and equipment (the battery rooms, dc equipment rooms, I&C rooms, and penetration rooms) are separated by 3-hour fire rated walls. Separate ventilation subsystems are provided for A and C and for B and D division rooms. In order for a fire to propagate from one divisional room to another, it must move past a 3-hour barrier (e.g., a door) into a common corridor and enter the other room through another 3-hour barrier (e.g., another door). | 9.5.1 & 9A.3 |
| 53. An access bay in the turbine building is provided to protect the north end of the Auxiliary Building, from potential debris produced by a postulated seismic damage of the adjacent Turbine Building. | 1.2 |
| 54. There are no normally open connections to sources of "unlimited" quantity of water in the electrical and I&C portions of the Auxiliary Building such as that it could affect safe shutdown capabilities. | Figure 9.5.1-1 |
| 55. To prevent flooding in a radiologically controlled area (RCA) in the Auxiliary Building from propagating to non-RCAs, the non-RCAs are separated from the RCAs by 2- and 3-foot walls and floor slabs. In addition, electrical penetrations between RCAs and non-RCAs in the Auxiliary Building are located above the maximum flood level. | 3.4.1.2.2.2 |
| 56. The two 72-hour rated Class 1E division B and C batteries are located above the maximum flood height in the Auxiliary Building considering all possible flooding sources. | 3.4.1.2.2.2 |

| Table 59-18 (Sheet 20 of 24) | |
|---|----------------|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| 57. Flood water in the Turbine Building drains to the yard and does not affect the Auxiliary Building. The presence of watertight walls and floor of the Auxiliary Building valve/penetration room prevents flooding from propagating beyond this area. | 3.4.1.2.2.2 |
| 58. The mechanical equipment and electrical equipment in the Auxiliary Building are separated to prevent propagation of leaks from the piping and mechanical equipment areas to the Class 1E equipment and Class 1E I&C equipment rooms. | 3.4.1.2.2.2 |
| 59. Connections to sources of "large" quantity of water are located in the Turbine Building. They are the service water system, which interfaces with the component cooling water system; and the circulating water system, which interfaces with the Turbine Building closed cooling system and the condenser. Features that minimize the flood propagation to other buildings are: <ul style="list-style-type: none"> - Flow from any postulated ruptures above grade level (elevation 100') in the Turbine Building flows down to grade level via floor grating and stairwells. This grating in the floors also prevents any significant propagation of water to the Auxiliary Building via flow under the doors. - A relief panel in the Turbine Building west wall at grade level directs the water outside the building to the yard and limits the maximum flood level in the Turbine Building to less than 6 inches. Flooding propagation to areas of the adjacent Auxiliary Building, via flow under doors or backflow through the drains, is possible but is bounded by a postulated break in those areas. | 3.4.1.2.2.3 |
| 60. Flood water in the Annex Building grade level is directed by the sloped floor to drains and to the yard area through the door of the Annex Building. Flow from postulated ruptures above grade level in the Annex Building is directed by floor drains to the Annex Building sump, which discharges to the Turbine Building drain tank. Alternate paths include flow to the Turbine Building via flow under access doors and down to grade level via stairwells and elevator shaft. The floors of the Annex Building are sloped away from the access doors to the Auxiliary Building in the vicinity of the access doors to prevent migration of flood water to the non-RCAs of the Nuclear Island where all safety-related equipment is located. | 3.4.1.2.2.3 |
| 61. There are no connections to sources of "unlimited" quantity of water, except for fire protection, in the Annex Building. | Figure 9.5.1-1 |

Table 59-18 (Sheet 21 of 24)

AP1000 PRA-BASED INSIGHTS

| Insight | Disposition |
|--|--|
| <p>62. To prevent overdraining, the RCS hot and cold legs are vertically offset, which permits draining of the steam generators for nozzle dam insertion with a hot leg level much higher than traditional designs.</p> <p>To lower the RCS hot leg level at which a vortex occurs in the RNS suction line, a step nozzle connection between the RCS hot leg and the RNS suction line is used.</p> <p>Should vortexing occur, air entrainment into the RNS pump suction is limited.</p> <p>There are two safety-related RCS hot leg level channels, one located in each hot leg. These level instruments are independent and do not share instrument lines. These level indicators are provided primarily to monitor RCS level during midloop operations. One level tap is at the bottom of the hot leg, and the other tap is on the top of the hot leg close to the steam generator.</p> <p>Wide range pressurizer level indication (cold calibrated) is provided that can measure RCS level to the bottom of the hot legs. This nonsafety-related pressurizer level indication can be used as an alternative way of monitoring level and can be used to identify inconsistencies in the safety-related hot leg level instrumentation.</p> <p>The RNS pump suction line is sloped continuously upward from the pump to the reactor coolant system hot leg with no local high points. This design eliminates potential problems in refilling the pump suction line if an RNS pump is stopped when cavitating due to excessive air entrainment. This self-venting suction line allows the RNS pumps to be immediately restarted once an adequate level in the hot leg is re-established.</p> <p>It is important to maximize the availability of the nonsafety-related wide range pressurizer level indication during RCS draining operations during cold shutdown. The Combined License applicant is responsible for developing procedures and training that encompass this item.</p> | <p>7.2.1</p> <p>5.4.7.2.1 & Figure 5.1-5</p> <p>5.4.7.2.1</p> <p>Tier 1 Information Figure 5.1-5 19E.2.1.1</p> <p>Tier 1 Information Figure 5.1-5 19E.2.1.1</p> <p>5.4.7.2.1</p> <p>13.5</p> |
| <p>63. Solid-state switching devices and electro-mechanical relays resistant to relay chatter will be used in the AP1000 safety-related I&C system.</p> | 19.55.2.3 |
| <p>64. The annulus drains will have the same or higher HCLPF value as the Shield Building so that the drain system will not fail at lower acceleration levels causing water blocking of the PCS air baffle.</p> | 19.59.10 |
| <p>65. The ability to close containment hatches and penetrations during Modes 5 & 6 prior to steaming to containment is important. The COL is responsible for developing procedures and training that encompass this item.</p> | 13.5 & 16.1 |
| <p>66. Spurious actuation of squib valves is prevented by the use of a squib valve controller circuit which requires multiple hot shorts for actuation, physical separation of potential hot short locations (e.g., routing of ADS cables in low voltage cable trays, and, in the case of PMS, the use of arm and fire signals from separate PMS cabinets), and provisions for operator action to remove power from the fire zone.</p> | 9A.2.7.1 |

| Table 59-18 (Sheet 22 of 24) | |
|--|--|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| <p>67. For long-term recirculation operation, the RNS pumps can take suction from one of the two sump recirculation lines. Unrestricted flow through both parallel paths is required for success of the sump recirculation function when both RNS pumps are running. If one of the two parallel paths fails to open, operator action is required to manually throttle the RNS discharge valve to prevent pump cavitation.</p> <p>The containment isolation valves in the RNS piping automatically close via PMS with a high radiation signal. The actuation setpoint was established consistent with a DBA non-mechanistic source term associated with a large LOCA. The containment radiation level for other accidents is expected to be below the point that would cause the RNS MOVs to automatically close.</p> <p>With the RNS pumps aligned either to the IRWST or the containment sump, the pumps' net positive suction head is adequate to prevent pump cavitation and failure even when the IRWST or sump inventory is saturated.</p> <p>Emergency response guidelines are provided for aligning the RNS from the control room for RCS injection and recirculation.</p> <p>The following are additional AP1000 features which contribute to the low likelihood of interfacing system LOCAs between the RNS and the RCS:</p> <ul style="list-style-type: none"> - A relief valve located in the common RNS discharge line outside containment provides protection against excess pressure. - Two remotely operated MOVs connecting the suction and discharge headers to the IRWST are interlocked with the isolation valves connecting the RNS pumps to the hot leg. This prevents inadvertent opening of these two MOVs when the RNS is aligned for shutdown cooling and potential diversion and draining of reactor coolant system. - Power to the four isolation MOVs connecting the RNS pumps to the RCS hot leg is administratively blocked at their motor control centers during normal power operation. <p>Per the Shutdown Evaluation, operability of the RNS is tested, via connections to the IRWST, before its alignment to the RCS hot leg for shutdown cooling.</p> <p>Inadvertent opening of RNS valve V024 results in a draindown of RCS inventory to the IRWST and requires gravity injection from the IRWST. The COL applicant is responsible for developing administrative controls to ensure that inadvertent opening of this valve is unlikely.</p> <p>The reliability of the IRWST suction isolation valve (V023) to open on demand is important. The IRWST suction isolation valve is included in the D-RAP.</p> | <p>Emergency Response Guidelines</p> <p>6.2.3 & 7.3.1.2.20</p> <p>5.4.7</p> <p>Emergency Response Guidelines</p> <p>5.4.7.2</p> <p>19E</p> <p>13.5</p> <p>17.4</p> |

| Table 59-18 (Sheet 23 of 24) | |
|--|---|
| AP1000 PRA-BASED INSIGHTS | |
| Insight | Disposition |
| 68. The startup feedwater system pumps provide feedwater to the steam generator. This capability provides an alternate core cooling mechanism to the PRHR heat exchangers for non-LOCA or steam generator tube ruptures. The startup feedwater pumps are included in the D-RAP. | 17.4 |
| 69. Capability is provided for on-line testing and calibration of the DAS channels, including sensors. Short-term availability controls of the DAS during at-power conditions reduce PRA uncertainties. | 7.7.1.11 16.3 |
| 70. One CVS pump is configured to operate on demand while the other CVS pump is in standby. The operation of these pumps will alternate periodically. The safety-related PMS boron dilution signal automatically re-aligns CVS pump suction to the boric acid tank. This signal also closes the two safety-related CVS demineralized water supply valves. This signal actuates on reactor trip signal (interlock P-4), source range flux doubling signal, or low input voltage to the Class 1E dc power system battery chargers. | 9.3.6.3.1 & 19.15 7.3.1.2.14 |
| 71. The COL applicant will maintain procedures to respond to low hot leg level alarms. | Emergency Response Guidelines |
| 72. The containment recirculation screens are configured such that the chance of clogging is minimized during operation following accidents at power and at shutdown. The configuration features that reduce the chance of clogging include: <ul style="list-style-type: none"> - Redundant screens are provided and located in separate locations. - Bottom of screens are located well above the lowest containment level as well as the floors around them. - Top of screens are located well below the containment floodup level. - Screens have protective plates that are located close to the top of the screens and extend out in front and to the side of the screens. - Screens have conservative flow areas to account for plugging. Adequate PXS performance can be supported by one screen with at least 90 percent of its surface area completely blocked. - During recirculation operation, the velocities approaching the screens are very low which limits the transport of debris. | 6.3.2 |
| 73. A COL applicant cleanliness program controls foreign debris from being introduced into the IRWST tank and into the containment during maintenance and inspection operations. | 6.3.2.2.7.2, 6.3.2.2.7.3, & 6.3.8.1 |

Table 59-18 (Sheet 24 of 24)

AP1000 PRA-BASED INSIGHTS

| Insight | Disposition |
|--|---|
| 74. For floor drains, from the reactor cavity PXS-A and PXS-B rooms, appropriate precautions such as check valves, back flow preventers, and siphon breaks are assumed to prevent back flow from a flooded space to a nonflooded space. | 3.4.1.2.2 |
| 75. Plant ventilation systems include features to prevent smoke originating from one fire area to another to the extent that they could adversely affect safe shutdown capabilities. | 9.4.2.2 |
| 76. An alternative gravity injection path is provided through RNS V-023 during cold shutdown and refueling conditions with the RCS open. The COL applicant is responsible for developing administrative controls to maximize the likelihood that RNS valve V-023 will be able to open if needed during Mode 5 when the RCS is open, and PRHR cannot be used for core cooling. | Emergency Response Guidelines 13.5 |
| 77. The IRWST suction isolation valve (V023) and the RCS pressure boundary isolation valves (V001A/B, V002A/B) are environmentally qualified to perform their safety functions. | Tier 1 Information |
| 78. Following an extended loss of RNS during safe/cold shutdown with the RCS intact and PRHR unavailable, it is essential to establish and maintain venting capability with ADS Stage 4 for gravity injection and containment recirculation. | 19.59.5 |
| 79. Combined License applicants referencing the AP1000 certified design will provide resolution for generic open items and plant-specific action items resulting from NRC review of the I&C platform. | 7.1.6 |
| 80. The Combined License applicant will provide an analysis that demonstrates that operator actions, which minimize the probability of the potential for spurious ADS actuation as a result of a fire, can be accomplished within 30 minutes following detection of the fire and the procedure for the manual actuation of the valve to allow fire water to reach the automatic fire system in the containment maintenance floor. | 9.5.1.8 |
| 81. The Combined License applicant will establish procedures to minimize risk when fire areas are breached during maintenance. These procedures will address a fire watch for fire areas breached during maintenance. | 9.5.1.8 |
| 82. It is important to maintain the low-temperature overpressure protection provided by the RNS relief valve to ensure that the reactor vessel pressure and temperature limits are not exceeded during shutdown conditions. Isolation of the RNS and its relief valve is permitted during shutdown conditions in case the hot legs empty due to a loss of RCS inventory; if the RNS is isolated, an alternate vent path would be opened, such as the ADS Stage 1, 2, and 3 valves. | 16.1 (LCO Basis 3.4.14) |

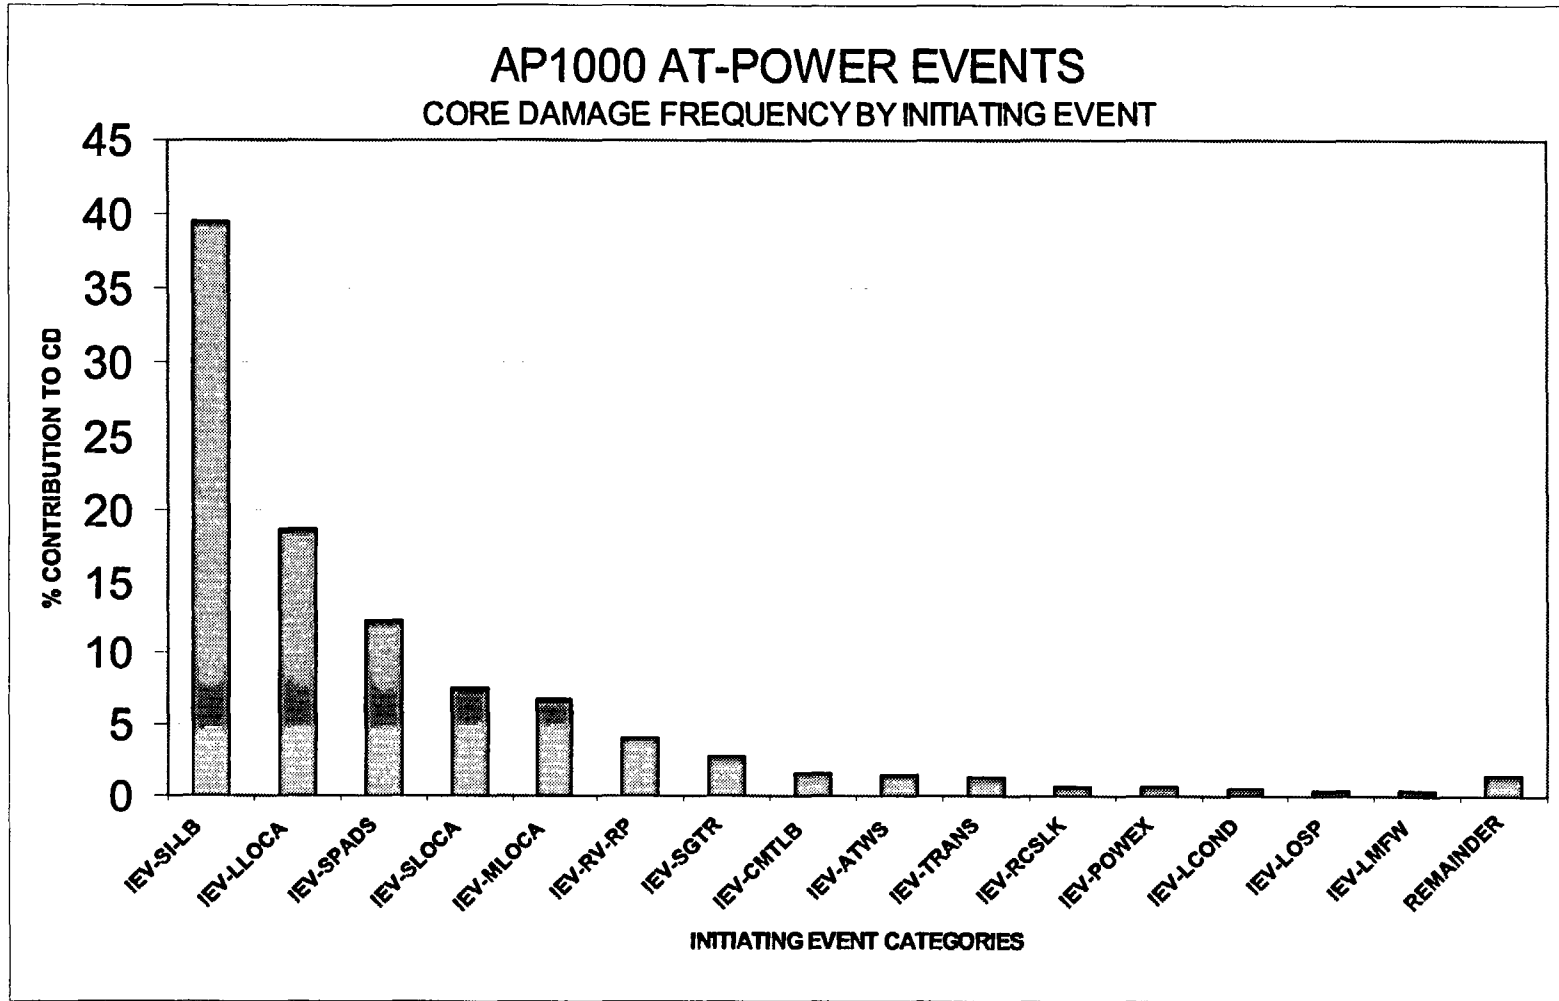


Figure 59-1

Contribution of Initiating Events to Core Damage

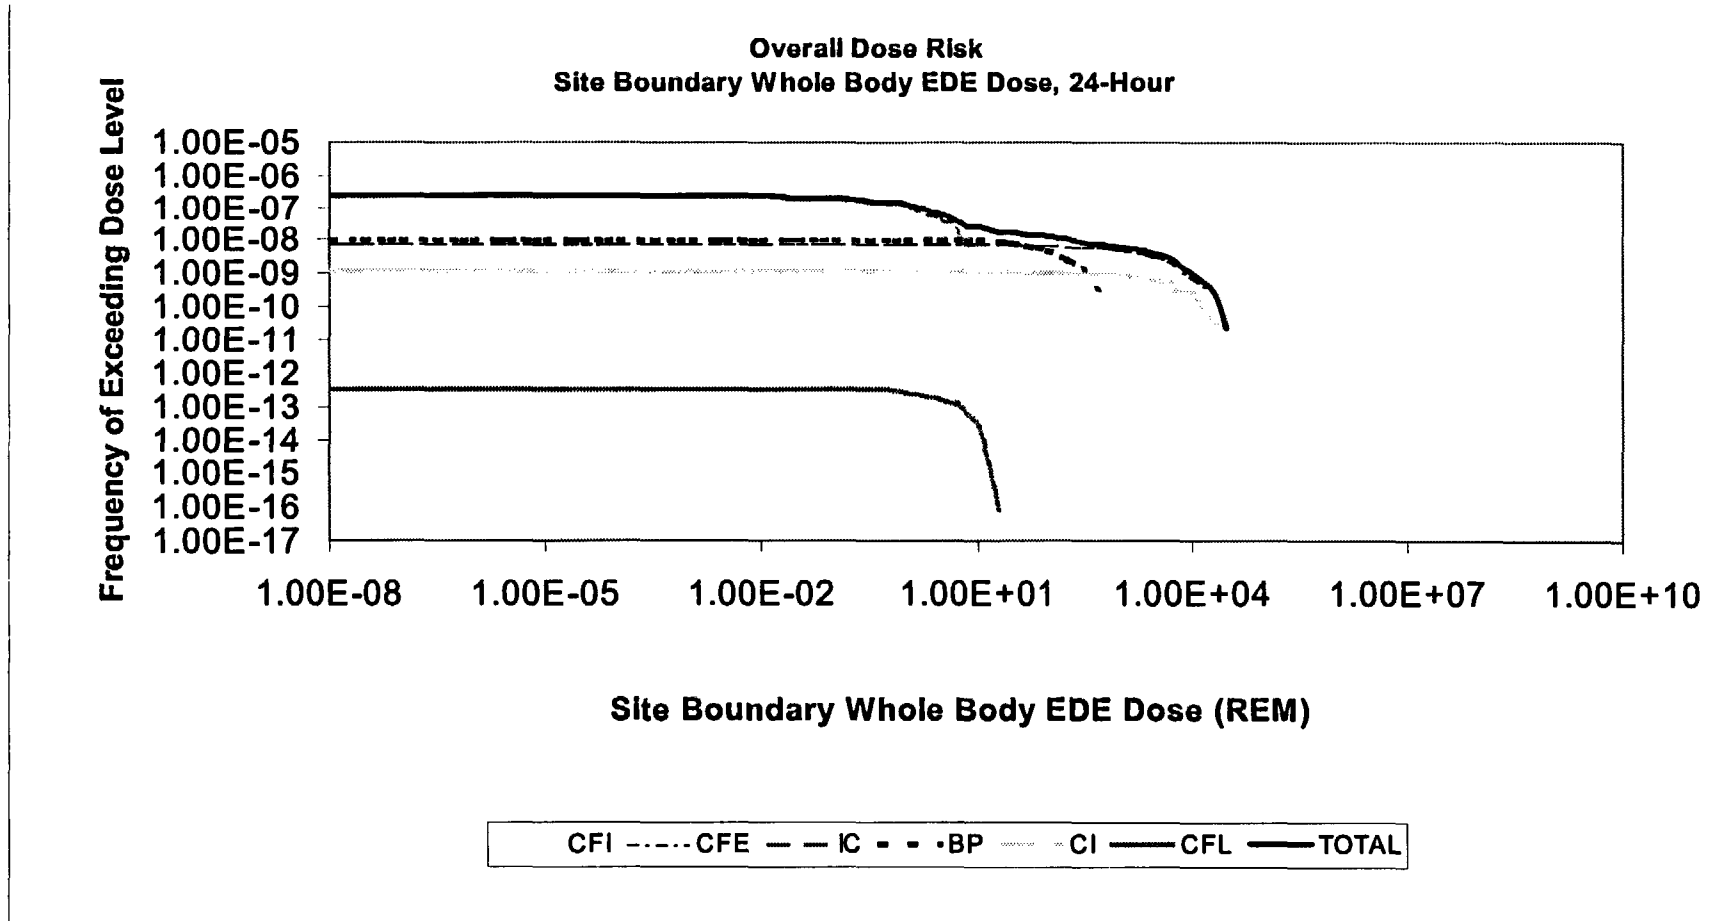


Figure 59-2

24-Hour Site Boundary Dose Cumulative Frequency Distribution

Volume 5

TABLE OF CONTENTS

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------------|---|-------------|
| | LIST OF TABLES | xxxv |
| | LIST OF FIGURES | liii |
| | REVISION 1 CHANGE ROADMAP | civ |
| | REVISION 2 CHANGE ROADMAP | cviii |
| | REVISION 3 CHANGE ROADMAP | cxi |
| | REVISION 4 CHANGE ROADMAP | cxii |
| | REVISION 5 CHANGE ROADMAP | cxiv |
| | REVISION 6 CHANGE ROADMAP | cxvi |
| | REVISION 7 CHANGE ROADMAP | cxvii |
| | REVISION 8 CHANGE ROADMAP | cxviii |
| CHAPTER 1 | INTRODUCTION | |
| 1.1 | Introduction | 1-1 |
| 1.1.1 | Background and Overview..... | 1-1 |
| 1.1.2 | Objectives | 1-1 |
| 1.1.3 | Technical Scope..... | 1-2 |
| 1.1.4 | Project Methodology Overview | 1-3 |
| 1.1.5 | Results | 1-4 |
| 1.1.6 | Plant Definition..... | 1-6 |
| 1.1.7 | References..... | 1-6 |
| CHAPTER 2 | INTERNAL INITIATING EVENTS | |
| 2.1 | Introduction | 2-1 |
| 2.2 | Internal Initiating Event Identification and Categorization | 2-1 |
| 2.2.1 | Logic Diagram for Internal Initiating Events | 2-2 |
| 2.2.2 | Loss-of-Coolant Accidents..... | 2-3 |
| 2.2.3 | Transients..... | 2-6 |
| 2.2.4 | Anticipated Transient without Scram..... | 2-8 |
| 2.2.5 | AP1000 Specific Initiating Event Analysis..... | 2-10 |
| 2.2.6 | Consequential Events..... | 2-19 |
| 2.2.7 | Summary of Internal Initiating Event Categories | 2-19 |
| 2.3 | Internal Initiating Event Frequency Quantification | 2-20 |
| 2.3.1 | Quantification of LOCA Initiating Event Frequencies..... | 2-20 |
| 2.3.2 | Quantification of Transient Initiating Event Frequencies | 2-24 |
| 2.3.3 | ATWS Precursor Initiating Event Frequency | 2-27 |
| 2.3.4 | Summary of Internal Initiating Event Frequencies..... | 2-27 |
| 2.4 | References..... | 2-27 |
| ATTACHMENT 2A | QUANTIFICATION OF LOCA INITIATING EVENT FREQUENCIES | |
| 2A-1 | Primary System Pipe Break Frequencies..... | 2A-1 |
| 2A-2 | Reactor Cooling System Leakage Initiating Event Frequency | 2A-1 |
| 2A-3 | Steam Generator Tube Rupture Initiating Event Frequency..... | 2A-1 |
| 2A-4 | Quantification of Stuck-Open Pressurizer Safety Valve, Accumulator Interface Break, and IRWST Interface Break..... | 2A-1 |
| 2A-5 | Initiating Events Review Data Summary and INPO Data | 2A-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| ATTACHMENT 2B QUANTIFICATION OF TRANSIENT INITIATING EVENT FREQUENCIES | | |
| 2B-1 | Secondary Side Line Breaks & Stuck-open Main Steam Line Safety Valve Frequencies..... | 2B-1 |
| CHAPTER 3 MODELING OF SPECIAL INITIATORS | | |
| 3.1 | Introduction..... | 3-1 |
| 3.2 | Ground Rules for Special Initiating Event Analysis..... | 3-1 |
| 3.3 | Loss of Component Cooling Water System/Service Water System Initiating Event..... | 3-1 |
| 3.4 | Loss of Compressed and Instrument Air System Initiating Event..... | 3-2 |
| 3.5 | Spurious Actuation of Automatic Depressurization System..... | 3-2 |
| 3.5.1 | Evaluation of Automatic Depressurization System Spurious Actuation | 3-3 |
| CHAPTER 4 EVENT TREE MODELS | | |
| 4.1 | Introduction..... | 4-1 |
| 4.2 | Large LOCA Event Tree Model..... | 4-1 |
| 4.2.1 | Event Description | 4-1 |
| 4.2.2 | Event Tree Model and its Nodes..... | 4-2 |
| 4.2.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-4 |
| 4.2.4 | Operator Actions..... | 4-4 |
| 4.2.5 | Transfers and Consequential Events | 4-4 |
| 4.3 | Large Spurious ADS Event Tree Model | 4-4 |
| 4.3.1 | Event Description | 4-4 |
| 4.3.2 | Event Tree Model and its Nodes..... | 4-4 |
| 4.3.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-6 |
| 4.3.4 | Operator Actions..... | 4-6 |
| 4.3.5 | Transfers and Consequential Events | 4-6 |
| 4.4 | Medium LOCA Event Tree Model | 4-6 |
| 4.4.1 | Event Description | 4-6 |
| 4.4.2 | Event Tree Model and its Nodes..... | 4-7 |
| 4.4.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-9 |
| 4.4.4 | Operator Actions..... | 4-9 |
| 4.4.5 | Transfers and Consequential Events | 4-10 |
| 4.5 | Core Makeup Tank Line Break Event Tree Model | 4-10 |
| 4.5.1 | Event Description | 4-10 |
| 4.5.2 | Event Tree Model and its Nodes..... | 4-10 |
| 4.5.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-13 |
| 4.5.4 | Operator Actions..... | 4-13 |
| 4.5.5 | Transfers and Consequential Events | 4-13 |
| 4.6 | Safety Injection Line Break Event Tree Model | 4-13 |
| 4.6.1 | Event Description | 4-13 |
| 4.6.2 | Event Tree Model and its Nodes..... | 4-14 |
| 4.6.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| | 4.6.4 Operator Actions..... | 4-16 |
| | 4.6.5 Transfers and Consequential Events..... | 4-17 |
| 4.7 | Small LOCA Event Tree Model..... | 4-17 |
| | 4.7.1 Event Description | 4-17 |
| | 4.7.2 Event Tree Model and its Nodes..... | 4-17 |
| | 4.7.3 Event Tree Success Criteria and Core Damage Categories..... | 4-20 |
| | 4.7.4 Operator Actions..... | 4-20 |
| | 4.7.5 Transfers and Consequential Events | 4-21 |
| 4.8 | RCS Leak Event Tree Model | 4-21 |
| | 4.8.1 Event Description | 4-21 |
| | 4.8.2 Event Tree Model and its Nodes..... | 4-21 |
| | 4.8.3 Event Tree Success Criteria | 4-22 |
| | 4.8.4 Operator Actions..... | 4-22 |
| | 4.8.5 Transfers and Consequential Events | 4-22 |
| | 4.8.6 Core Damage Categories..... | 4-23 |
| 4.9 | PRHR Tube Rupture Event Tree Model | 4-23 |
| | 4.9.1 Event Description | 4-23 |
| | 4.9.2 Event Tree Model and its Nodes..... | 4-23 |
| | 4.9.3 Event Tree Success Criteria | 4-24 |
| | 4.9.4 Operator Actions..... | 4-24 |
| | 4.9.5 Transfers and Consequential Events | 4-24 |
| | 4.9.6 Core Damage Categories..... | 4-24 |
| 4.10 | Steam Generator Tube Rupture Event Tree Model | 4-25 |
| | 4.10.1 Event Description | 4-25 |
| | 4.10.2 Event Tree Model and its Nodes..... | 4-27 |
| | 4.10.3 Event Tree Success Criteria and Core Damage Categories..... | 4-33 |
| | 4.10.4 Operator Actions..... | 4-33 |
| | 4.10.5 Transfers and Consequential Events | 4-33 |
| 4.11 | Reactor Vessel Rupture Event Tree Model | 4-34 |
| | 4.11.1 Event Description | 4-34 |
| | 4.11.2 Event Tree Model and its Nodes..... | 4-34 |
| | 4.11.3 Event Tree Success Criteria | 4-34 |
| | 4.11.4 Operator Actions..... | 4-34 |
| | 4.11.5 Transfers and Consequential Events | 4-34 |
| | 4.11.6 Core Damage Categories..... | 4-34 |
| 4.12 | Interfacing System LOCA Event Tree Model | 4-34 |
| | 4.12.1 Event Description | 4-34 |
| | 4.12.2 Event Tree Model and its Nodes..... | 4-35 |
| | 4.12.3 Event Tree Success Criteria | 4-35 |
| | 4.12.4 Operator Actions..... | 4-35 |
| | 4.12.5 Transfers and Consequential Events | 4-35 |
| | 4.12.6 Core Damage Categories..... | 4-35 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 4.13 | Transients With MFW Event Tree Model..... | 4-35 |
| 4.13.1 | Event Description | 4-35 |
| 4.13.2 | Event Tree Model and its Nodes..... | 4-37 |
| 4.13.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-41 |
| 4.13.4 | Operator Actions..... | 4-41 |
| 4.13.5 | Transfers and Consequential Events | 4-42 |
| 4.14 | Transients With Loss of RCS Flow Event Tree Model..... | 4-42 |
| 4.14.1 | Event Description | 4-42 |
| 4.14.2 | Event Tree Model and its Nodes..... | 4-42 |
| 4.14.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-46 |
| 4.14.4 | Operator Actions..... | 4-46 |
| 4.14.5 | Transfers and Consequential Events | 4-46 |
| 4.15 | Transients With Loss of MFW to One Steam Generator Event Tree Model..... | 4-46 |
| 4.15.1 | Event Description | 4-46 |
| 4.15.2 | Event Tree Model and its Nodes..... | 4-47 |
| 4.15.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-50 |
| 4.15.4 | Operator Actions..... | 4-50 |
| 4.15.5 | Transfers and Consequential Events | 4-51 |
| 4.16 | Transients With Core Power Excursion Event Tree Model..... | 4-51 |
| 4.16.1 | Event Description | 4-51 |
| 4.16.2 | Event Tree Model and its Nodes..... | 4-51 |
| 4.16.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-55 |
| 4.16.4 | Operator Actions..... | 4-55 |
| 4.16.5 | Transfers and Consequential Events | 4-55 |
| 4.17 | Transients With Loss of CCW/SW Event Tree Model..... | 4-56 |
| 4.17.1 | Event Description | 4-56 |
| 4.17.2 | Event Tree Model and its Nodes..... | 4-56 |
| 4.17.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-59 |
| 4.17.4 | Operator Actions..... | 4-59 |
| 4.17.5 | Transfers and Consequential Events | 4-60 |
| 4.18 | Loss of Main Feedwater Event Tree Model | 4-60 |
| 4.18.1 | Event Description | 4-60 |
| 4.18.2 | Event Tree Model and its Nodes..... | 4-62 |
| 4.18.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-65 |
| 4.18.4 | Operator Actions..... | 4-65 |
| 4.18.5 | Transfers and Consequential Events | 4-66 |
| 4.19 | Loss of Condenser Event Tree Model | 4-66 |
| 4.19.1 | Event Description | 4-66 |
| 4.19.2 | Event Tree Model and its Nodes..... | 4-66 |
| 4.19.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-70 |
| 4.19.4 | Operator Actions..... | 4-70 |
| 4.19.5 | Transfers and Consequential Events | 4-70 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 4.20 | Loss of Compressed Air Event Tree Model | 4-70 |
| 4.20.1 | Event Description | 4-70 |
| 4.20.2 | Event Tree Model and its Nodes..... | 4-71 |
| 4.20.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-74 |
| 4.20.4 | Operator Actions..... | 4-74 |
| 4.20.5 | Transfers and Consequential Events | 4-75 |
| 4.21 | Loss of Offsite Power Event Tree Model..... | 4-75 |
| 4.21.1 | Event Description | 4-75 |
| 4.21.2 | Event Tree Model and its Nodes..... | 4-75 |
| 4.21.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-79 |
| 4.21.4 | Operator Actions..... | 4-79 |
| 4.21.5 | Transfers and Consequential Events | 4-80 |
| 4.22 | Main Steam Line Break Downstream of MSIVs Event Tree Model..... | 4-80 |
| 4.22.1 | Event Description | 4-80 |
| 4.22.2 | Event Tree Model and its Nodes..... | 4-81 |
| 4.22.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-84 |
| 4.22.4 | Operator Actions..... | 4-84 |
| 4.22.5 | Transfers and Consequential Events | 4-85 |
| 4.23 | Main Steam Line Break Upstream of MSIVs Event Tree Model..... | 4-85 |
| 4.23.1 | Event Description | 4-85 |
| 4.23.2 | Event Tree Model and its Nodes..... | 4-85 |
| 4.23.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-89 |
| 4.23.4 | Operator Actions..... | 4-89 |
| 4.23.5 | Transfers and Consequential Events | 4-90 |
| 4.24 | Stuck-Open Secondary Side Safety Valve Event Tree Model..... | 4-90 |
| 4.24.1 | Event Description | 4-90 |
| 4.24.2 | Event Tree Model and its Nodes..... | 4-91 |
| 4.24.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-94 |
| 4.24.4 | Operator Actions..... | 4-94 |
| 4.24.5 | Transfers and Consequential Events | 4-94 |
| 4.25 | ATWS Precursors Without MFW Event Tree Model | 4-95 |
| 4.25.1 | Event Description | 4-95 |
| 4.25.2 | Event Tree Model and its Nodes..... | 4-96 |
| 4.25.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-101 |
| 4.25.4 | Operator Actions..... | 4-101 |
| 4.25.5 | Transfers and Consequential Events | 4-101 |
| 4.26 | ATWS Precursor with SI Event Tree Model..... | 4-101 |
| 4.26.1 | Event Description | 4-101 |
| 4.26.2 | Event Tree Model and its Nodes..... | 4-102 |
| 4.26.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-106 |
| 4.26.4 | Operator Actions..... | 4-106 |
| 4.26.5 | Transfers and Consequential Events | 4-106 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| 4.27 | ATWS Precursor Transients with MFW Event Tree Model | 4-106 |
| 4.27.1 | Event Description | 4-106 |
| 4.27.2 | Event Tree Model and its Nodes..... | 4-107 |
| 4.27.3 | Event Tree Success Criteria and Core Damage Categories..... | 4-110 |
| 4.27.4 | Operator Actions..... | 4-111 |
| 4.27.5 | Transfers and Consequential Events | 4-111 |
| ATTACHMENT 4A EVENT TREE GUIDELINES | | |
| 4A.1 | Event Tree Analysis Methodology | 4A-1 |
| 4A.2 | Event Tree Guidelines for Core Damage | 4A-3 |
| 4A.2.1 | Event Trees | 4A-3 |
| 4A.2.2 | Success Criteria..... | 4A-6 |
| 4A.2.3 | Definition of End States..... | 4A-7 |
| 4A.2.4 | Plant Response Functions | 4A-9 |
| 4A.2.5 | Event Tree Node Notation | 4A-13 |
| 4A.2.6 | Consequential Events..... | 4A-13 |
| 4A.2.7 | Transient Template | 4A-14 |
| 4A.2.8 | Small LOCA Template | 4A-15 |
| ATTACHMENT 4B EVENT TREE PICTURES..... | | 4B-1 |
| CHAPTER 5 SUPPORT SYSTEMS | | |
| 5.1 | Introduction..... | 5-1 |
| 5.2 | Support Systems and Their Interdependencies..... | 5-1 |
| 5.3 | Front Line Systems and Their Dependencies | 5-1 |
| CHAPTER 6 SUCCESS CRITERIA ANALYSIS | | |
| 6.1 | Introduction..... | 6-1 |
| 6.2 | Acceptance Criteria and Critical Functions for Success Criteria..... | 6-1 |
| 6.3 | Event Sequences and Timing, Passive/Active System Interactions..... | 6-3 |
| 6.3.1 | General Sequence Success Criteria..... | 6-3 |
| 6.3.2 | Timing of Events and Key Operator Actions | 6-9 |
| 6.3.3 | Passive/Active System Interactions..... | 6-15 |
| 6.3.4 | Sequence Success Criteria Summary | 6-18 |
| 6.4 | Event Tree Top Events Success Criteria | 6-18 |
| 6.5 | References..... | 6-19 |
| CHAPTER 7 FAULT TREE GUIDELINES | | |
| 7.1 | Purpose..... | 7-1 |
| 7.2 | Fault Tree Development..... | 7-1 |
| 7.2.1 | Procedural Steps for Fault Tree Preparation | 7-1 |
| 7.2.2 | Procedural Steps for Fault Tree Construction | 7-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 7.3 | Primary Events to be Considered in Fault Trees | 7-3 |
| 7.3.1 | Random Component Failure | 7-3 |
| 7.3.2 | Outage for Maintenance and Testing | 7-5 |
| 7.3.3 | Common Cause Failures | 7-6 |
| 7.3.4 | Human Errors..... | 7-6 |
| 7.3.5 | Power and Control Model..... | 7-9 |
| 7.4 | Data Base | 7-10 |
| 7.5 | Fault Tree Model: Identification Codes..... | 7-10 |
| 7.5.1 | Identification Code for Fault Tree Names..... | 7-10 |
| 7.5.2 | Identification Code for Support Systems | 7-10 |
| 7.5.3 | Identification Code for Primary Event Names | 7-11 |
| 7.5.4 | Identification Code for Common Cause Failures | 7-11 |
| 7.5.5 | Identification Code for Undeveloped Events (Modules)..... | 7-12 |
| 7.5.6 | Identification Code for Operator Errors | 7-13 |
| 7.6 | Fault Tree Quantification | 7-13 |
| 7.7 | References | 7-14 |
| | | |
| CHAPTER 8 | PASSIVE CORE COOLING SYSTEM – PASSIVE RESIDUAL HEAT REMOVAL | |
| 8.1 | System Function..... | 8-1 |
| 8.2 | System Description | 8-1 |
| 8.2.1 | Support Systems | 8-1 |
| 8.2.2 | Instrumentation and Control | 8-2 |
| 8.2.3 | Test and Maintenance | 8-2 |
| 8.3 | System Operation | 8-3 |
| 8.4 | Performance During Accident Conditions | 8-3 |
| 8.4.1 | Plant Shutdown..... | 8-3 |
| 8.4.2 | Loss of Coolant Accidents | 8-3 |
| 8.4.3 | Passive Residual Heat Removal Heat Exchanger Tube Rupture..... | 8-3 |
| 8.5 | Initiating Events Review | 8-4 |
| 8.5.1 | Initiating Events Impacting the PRHR System | 8-4 |
| 8.5.2 | Initiating Events Caused by PRHR System Malfunction | 8-4 |
| 8.6 | System Logic Models | 8-4 |
| 8.6.1 | Assumptions and Boundary Conditions..... | 8-5 |
| 8.6.2 | Fault Tree Models..... | 8-6 |
| 8.6.3 | Human Interactions | 8-6 |
| 8.6.4 | Common Cause Failures | 8-6 |
| 8.7 | Quantification and Results | 8-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| CHAPTER 9 | PASSIVE CORE COOLING SYSTEM – CORE MAKEUP TANK | |
| 9.1 | System Description | 9-1 |
| 9.1.1 | Support Systems | 9-1 |
| 9.1.2 | Instrumentation and Control | 9-1 |
| 9.1.3 | Test and Maintenance Assumptions..... | 9-2 |
| 9.2 | System Operation | 9-2 |
| 9.3 | Performance During Accident Conditions | 9-3 |
| 9.3.1 | Inadvertent Opening of a Steam Generator Relief or Safety Valve..... | 9-3 |
| 9.3.2 | Steam Line Break..... | 9-3 |
| 9.3.3 | Steam Generator Tube Rupture..... | 9-3 |
| 9.3.4 | Reactor Coolant System Heatup Transients | 9-4 |
| 9.3.5 | Loss-of-Coolant Accidents..... | 9-4 |
| 9.3.6 | Loss of Offsite Power | 9-4 |
| 9.3.7 | Anticipated Transient without Trip..... | 9-4 |
| 9.4 | Initiating Event Review..... | 9-4 |
| 9.4.1 | Initiating Events Impacting the Core Makeup Tank Subsystem | 9-5 |
| 9.4.2 | Initiating Events Due to Loss of the Core Makeup Tank Subsystem | 9-5 |
| 9.5 | System Logic Models..... | 9-5 |
| 9.5.1 | Assumptions and Boundary Conditions..... | 9-5 |
| 9.5.2 | Fault Tree Models..... | 9-7 |
| 9.5.3 | Human Interactions..... | 9-7 |
| 9.5.4 | Common Cause Failures | 9-8 |
| CHAPTER 10 | PASSIVE CORE COOLING SYSTEM – ACCUMULATOR | |
| 10.1 | System Description | 10-1 |
| 10.1.1 | Support Systems | 10-1 |
| 10.1.2 | Instrumentation and Control | 10-1 |
| 10.1.3 | Test and Maintenance Assumptions..... | 10-1 |
| 10.2 | System Operation | 10-1 |
| 10.3 | Performance During Accident Conditions | 10-2 |
| 10.3.1 | Steam Line Break..... | 10-2 |
| 10.3.2 | Loss-of-Coolant Accidents or Non-Loss-of-Coolant Accidents with Automatic Depressurization System | 10-2 |
| 10.4 | Initiating Event Review..... | 10-3 |
| 10.4.1 | Initiating Events Impacting the Accumulator Subsystem..... | 10-3 |
| 10.4.2 | Initiating Events Due to Loss of the Accumulator Subsystem | 10-3 |
| 10.5 | System Logic Models..... | 10-3 |
| 10.5.1 | Assumptions and Boundary Conditions..... | 10-3 |
| 10.5.2 | Fault Tree Models..... | 10-4 |
| 10.5.3 | Human Interactions..... | 10-4 |
| 10.5.4 | Common Cause Failures | 10-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 11 PASSIVE COOLING SYSTEM – AUTOMATIC DEPRESSURIZATION SYSTEM | | |
| 11.1 | System Function..... | 11-1 |
| 11.2 | System Description | 11-1 |
| | 11.2.1 Support Systems | 11-1 |
| | 11.2.2 Instrumentation and Control | 11-2 |
| | 11.2.3 Test and Maintenance | 11-2 |
| 11.3 | System Operation | 11-2 |
| 11.4 | Performance During Accident Conditions | 11-3 |
| | 11.4.1 Loss of Coolant Accidents | 11-3 |
| | 11.4.2 Transients..... | 11-3 |
| 11.5 | Initiating Events Review | 11-3 |
| | 11.5.1 Initiating Events Impacting the Automatic Depressurization System | 11-3 |
| | 11.5.2 Initiating Events Caused by the ADS Malfunction | 11-4 |
| 11.6 | System Logic Model | 11-4 |
| | 11.6.1 Assumptions and Boundary Conditions..... | 11-4 |
| | 11.6.2 Fault Tree Models..... | 11-5 |
| | 11.6.3 Human Interactions..... | 11-6 |
| | 11.6.4 Common Cause Failures..... | 11-7 |
| 11.7 | Quantification and Results | 11-7 |
| CHAPTER 12 PASSIVE CORE COOLING SYSTEM – IN-CONTAINMENT REFUELING WATER STORAGE TANK | | |
| 12.1 | System Function..... | 12-1 |
| 12.2 | System Description | 12-1 |
| | 12.2.1 Support Systems | 12-1 |
| | 12.2.2 Instrumentation and Control | 12-1 |
| | 12.2.3 Test and Maintenance | 12-2 |
| 12.3 | System Operation | 12-2 |
| 12.4 | Performance During Accident Conditions | 12-2 |
| | 12.4.1 Transients..... | 12-3 |
| | 12.4.2 Loss of Coolant Accidents | 12-4 |
| | 12.4.3 In-Vessel Core Damage Mitigation..... | 12-5 |
| | 12.4.4 Containment Isolation System Failure | 12-5 |
| 12.5 | Initiating Event..... | 12-5 |
| | 12.5.1 Initiating Event Impacting IRWST/Gravity Injection Subsystem | 12-5 |
| | 12.5.2 Initiating Event due to Loss of IRWST/Gravity Injection Subsystem..... | 12-5 |
| 12.6 | System Logic Models..... | 12-6 |
| | 12.6.1 Assumptions and Boundary Conditions..... | 12-6 |
| | 12.6.2 Fault Tree Models..... | 12-8 |
| | 12.6.3 Human Interactions..... | 12-8 |
| | 12.6.4 Common Cause Failures..... | 12-8 |
| 12.7 | Quantification and Results | 12-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 13 PASSIVE CONTAINMENT COOLING SYSTEM | | |
| 13.1 | System Description | 13-1 |
| | 13.1.1 Support Systems | 13-1 |
| | 13.1.2 Instrumentation and Control | 13-1 |
| | 13.1.3 Test and Maintenance Assumptions..... | 13-2 |
| 13.2 | System Operation | 13-2 |
| 13.3 | Performance During Accident Conditions | 13-2 |
| | 13.3.1 Post-Reactor Trip with Loss of All ac Power..... | 13-2 |
| | 13.3.2 Automatic Depressurization System Actuation..... | 13-2 |
| | 13.3.3 Post-Loss-of-Coolant Accident | 13-3 |
| | 13.3.4 Post-Main Steam Line Break | 13-3 |
| 13.4 | Initiating Event Review..... | 13-3 |
| | 13.4.1 Initiating Events Impacting the Passive Containment Cooling System..... | 13-3 |
| | 13.4.2 Initiating Events due to Loss of the Passive Containment Cooling System | 13-3 |
| 13.5 | System Logic Model | 13-3 |
| | 13.5.1 Assumptions and Boundary Conditions..... | 13-4 |
| | 13.5.2 Fault Tree Model | 13-5 |
| | 13.5.3 Human Interactions..... | 13-6 |
| | 13.5.4 Common Cause Failures | 13-6 |
| CHAPTER 14 MAIN AND STARTUP FEEDWATER SYSTEM | | |
| 14.1 | System Description | 14-1 |
| | 14.1.1 Support Systems | 14-1 |
| | 14.1.2 Instrumentation and Control | 14-2 |
| | 14.1.3 Test and Maintenance | 14-2 |
| 14.2 | System Operation | 14-2 |
| 14.3 | Performance During Accident Conditions | 14-2 |
| 14.4 | Initiating Event Review..... | 14-4 |
| | 14.4.1 Initiating Event Impacting Main and Startup Feedwater/ Condensate System | 14-4 |
| | 14.4.2 Initiating Event due to Loss of Main and Startup Feedwater/ Condensate System | 14-4 |
| 14.5 | System Logic Models..... | 14-4 |
| | 14.5.1 Assumptions and Boundary Conditions..... | 14-5 |
| | 14.5.2 Fault Tree Models..... | 14-7 |
| | 14.5.3 Human Interactions..... | 14-7 |
| | 14.5.4 Common Cause Failures | 14-7 |
| 14.6 | Quantification and Results | 14-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 15 CHEMICAL AND VOLUME CONTROL SYSTEM | | |
| 15.1 | System Description | 15-1 |
| 15.1.1 | Support Systems | 15-1 |
| 15.1.2 | Instrumentation and Control Assumptions..... | 15-1 |
| 15.1.3 | Test and Maintenance Assumptions..... | 15-2 |
| 15.2 | System Operation | 15-3 |
| 15.3 | Performance During Accident Conditions | 15-3 |
| 15.4 | Initiating Event Review..... | 15-4 |
| 15.4.1 | Initiating Events Impacting the Chemical and Volume Control System | 15-5 |
| 15.4.2 | Initiating Events Due to Loss of the Chemical and Volume Control System | 15-5 |
| 15.5 | System Logic Models..... | 15-5 |
| 15.5.1 | Assumptions and Boundary Conditions..... | 15-5 |
| 15.5.2 | Fault Tree Models..... | 15-7 |
| 15.5.3 | Human Interactions..... | 15-7 |
| 15.5.4 | Common Cause Failures | 15-8 |
| CHAPTER 16 CONTAINMENT HYDROGEN CONTROL SYSTEM | | |
| 16.1 | System Description | 16-1 |
| 16.1.1 | Support Systems | 16-1 |
| 16.1.2 | Instrumentation and Control | 16-1 |
| 16.1.3 | Test and Maintenance | 16-1 |
| 16.2 | System Operation | 16-2 |
| 16.3 | Performance During Accident Conditions | 16-2 |
| 16.4 | Initiating Event Review..... | 16-2 |
| 16.5 | System Logic Model | 16-2 |
| 16.5.1 | Assumptions and Boundary Conditions..... | 16-2 |
| 16.5.2 | Fault Tree Model | 16-3 |
| 16.5.3 | Human Interactions..... | 16-3 |
| 16.5.4 | Common Cause Failures | 16-4 |
| CHAPTER 17 NORMAL RESIDUAL HEAT REMOVAL SYSTEM | | |
| 17.1 | System Description | 17-1 |
| 17.1.1 | Support Systems | 17-1 |
| 17.1.2 | Instrumentation and Control | 17-1 |
| 17.1.3 | Test and Maintenance Assumptions..... | 17-1 |
| 17.2 | System Operation | 17-1 |
| 17.3 | Performance During Accident Conditions | 17-2 |
| 17.4 | Initiating Event Review..... | 17-3 |
| 17.4.1 | Initiating Events Impacting the Normal Residual Heat Removal System | 17-3 |
| 17.4.2 | Initiating Events Due to Loss of the Normal Residual Heat Removal System | 17-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 17.5 | System Logic Models..... | 17-4 |
| 17.5.1 | Assumptions and Boundary Conditions..... | 17-4 |
| 17.5.2 | Fault Tree Models..... | 17-6 |
| 17.5.3 | Human Interactions..... | 17-6 |
| 17.5.4 | Common Cause Failures..... | 17-6 |
| 17.6 | References..... | 17-6 |
| | | |
| CHAPTER 18 COMPONENT COOLING WATER SYSTEM | | |
| 18.1 | System Description..... | 18-1 |
| 18.1.1 | Support Systems..... | 18-1 |
| 18.1.2 | Instrumentation and Control..... | 18-1 |
| 18.1.3 | Test and Maintenance Assumptions..... | 18-1 |
| 18.2 | System Operation..... | 18-2 |
| 18.3 | Performance During Accident Conditions..... | 18-2 |
| 18.4 | Initiating Event Review..... | 18-2 |
| 18.4.1 | Initiating Events Impacting the Component Cooling Water System..... | 18-2 |
| 18.4.2 | Initiating Events Due to Loss of the Component Cooling Water System..... | 18-3 |
| 18.5 | System Logic Models..... | 18-3 |
| 18.5.1 | Assumptions and Boundary Conditions..... | 18-3 |
| 18.5.2 | Fault Tree Models..... | 18-4 |
| 18.5.3 | Human Interactions..... | 18-4 |
| 18.5.4 | Common Cause Failures..... | 18-5 |
| | | |
| CHAPTER 19 SERVICE WATER SYSTEM | | |
| 19.1 | System Description..... | 19-1 |
| 19.1.1 | Support Systems..... | 19-1 |
| 19.1.2 | Instrumentation and Control..... | 19-1 |
| 19.1.3 | Test and Maintenance Assumptions..... | 19-1 |
| 19.2 | System Operation..... | 19-2 |
| 19.3 | Performance During Accident Conditions..... | 19-2 |
| 19.4 | Initiating Event Review..... | 19-2 |
| 19.4.1 | Initiating Events Impacting the Service Water System..... | 19-2 |
| 19.4.2 | Initiating Events Due to Loss of the Service Water System..... | 19-2 |
| 19.5 | System Logic Models..... | 19-3 |
| 19.5.1 | Assumptions and Boundary Conditions..... | 19-3 |
| 19.5.2 | Fault Tree Models..... | 19-4 |
| 19.5.3 | Human Interactions..... | 19-5 |
| 19.5.4 | Common Cause Failures..... | 19-5 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| CHAPTER 20 | CENTRAL CHILLED WATER SYSTEM | |
| 20.1 | System Description | 20-1 |
| | 20.1.1 Support Systems | 20-1 |
| | 20.1.2 Instrumentation and Control | 20-1 |
| | 20.1.3 Test and Maintenance Assumptions..... | 20-1 |
| 20.2 | System Operation | 20-2 |
| 20.3 | Performance During Accident Conditions | 20-2 |
| 20.4 | Initiating Event Review | 20-2 |
| | 20.4.1 Initiating Events Impacting the Central Chilled Water System..... | 20-2 |
| | 20.4.2 Initiating Events Due to Loss of the Central Chilled Water System | 20-3 |
| 20.5 | System Logic Model | 20-3 |
| | 20.5.1 Assumptions and Boundary Conditions..... | 20-3 |
| | 20.5.2 Fault Tree Model | 20-4 |
| | 20.5.3 Human Interactions..... | 20-4 |
| | 20.5.4 Common Cause Failures | 20-4 |
| CHAPTER 21 | AC POWER SYSTEM | |
| 21.1 | System Description | 21-1 |
| | 21.1.1 Support Systems | 21-1 |
| | 21.1.2 Instrumentation and Control | 21-2 |
| | 21.1.3 Test and Maintenance Assumptions..... | 21-2 |
| 21.2 | System Operation | 21-2 |
| 21.3 | Performance During Accident Conditions | 21-3 |
| | 21.3.1 Automatic Load Shedding | 21-3 |
| | 21.3.2 Manual Transfer..... | 21-3 |
| | 21.3.3 Electric Circuit Protection..... | 21-3 |
| 21.4 | Initiating Event Review..... | 21-3 |
| | 21.4.1 Loss of the Main Generator | 21-4 |
| | 21.4.2 Loss of Offsite Power | 21-4 |
| | 21.4.3 Loss of 6900-vac and 480-vac Busses | 21-4 |
| 21.5 | System Logic Models..... | 21-4 |
| | 21.5.1 Assumptions and Boundary Conditions..... | 21-5 |
| | 21.5.2 Fault Tree Models..... | 21-7 |
| | 21.5.3 Human Interactions..... | 21-8 |
| | 21.5.4 Common Cause Failures | 21-8 |
| CHAPTER 22 | CLASS 1E DC AND UNINTERRUPTIBLE POWER SUPPLY SYSTEM | |
| 22.1 | System Description | 22-1 |
| | 22.1.1 Support Systems | 22-1 |
| | 22.1.2 Instrumentation and Control | 22-1 |
| | 22.1.3 Test and Maintenance Assumptions..... | 22-1 |
| 22.2 | System Operation | 22-2 |
| 22.3 | Performance During Accident Conditions | 22-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 22.4 | Initiating Event Review..... | 22-2 |
| 22.4.1 | Initiating Events Impacting the Class 1E dc and UPS System..... | 22-3 |
| 22.4.2 | Initiating Events Due to Loss of the Class 1E dc and UPS System..... | 22-3 |
| 22.5 | System Logic Models..... | 22-3 |
| 22.5.1 | Assumptions and Boundary Conditions..... | 22-3 |
| 22.5.2 | Fault Tree Models..... | 22-4 |
| 22.5.3 | Human Interactions..... | 22-4 |
| 22.5.4 | Common Cause Failures..... | 22-4 |
| 22.6 | References..... | 22-5 |
| CHAPTER 23 NON-CLASS 1E DC AND UPS SYSTEM | | |
| 23.1 | System Description | 23-1 |
| 23.1.1 | Support Systems | 23-1 |
| 23.1.2 | Instrumentation and Control | 23-1 |
| 23.1.3 | Test and Maintenance Assumptions..... | 23-1 |
| 23.2 | System Operation | 23-2 |
| 23.3 | Performance During Accident Conditions | 23-2 |
| 23.4 | Initiating Event Review..... | 23-2 |
| 23.4.1 | Initiating Events Impacting the Non-Class 1E dc and UPS System..... | 23-2 |
| 23.4.2 | Initiating Events Due to Loss of the Non-Class 1E dc and UPS Power System | 23-3 |
| 23.5 | System Logic Models..... | 23-3 |
| 23.5.1 | Assumptions and Boundary Conditions..... | 23-3 |
| 23.5.2 | Fault Tree Models..... | 23-4 |
| 23.5.3 | Human Interactions..... | 23-5 |
| 23.5.4 | Common Cause Failures..... | 23-5 |
| 23.6 | References..... | 23-5 |
| CHAPTER 24 CONTAINMENT ISOLATION | | |
| 24.1 | System Description | 24-1 |
| 24.1.1 | Support Systems | 24-1 |
| 24.1.2 | Instrumentation and Control | 24-1 |
| 24.1.3 | Test and Maintenance Assumptions..... | 24-2 |
| 24.2 | System Operation | 24-2 |
| 24.3 | Performance During Accident Conditions | 24-2 |
| 24.4 | Initiating Event Review..... | 24-2 |
| 24.4.1 | Initiating Events Impacting Containment Isolation..... | 24-2 |
| 24.4.2 | Initiating Events Due to Loss of the Containment Isolation System | 24-2 |
| 24.5 | System Logic Models..... | 24-3 |
| 24.5.1 | Assumptions and Boundary Conditions..... | 24-4 |
| 24.5.2 | Fault Tree Models..... | 24-5 |
| 24.5.3 | Human Interactions..... | 24-6 |
| 24.5.4 | Common Cause Failures..... | 24-6 |
| 24.6 | References..... | 24-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|-------------|
| CHAPTER 25 COMPRESSED AND INSTRUMENT AIR SYSTEM | | |
| 25.1 | System Description | 25-1 |
| 25.1.1 | Support Systems | 25-2 |
| 25.1.2 | Instrumentation and Control | 25-2 |
| 25.1.3 | Test and Maintenance Assumptions..... | 25-3 |
| 25.2 | System Operation | 25-3 |
| 25.3 | Performance During Accident Conditions | 25-3 |
| 25.4 | Initiating Event Review..... | 25-4 |
| 25.4.1 | Initiating Events Impacting the Instrument Air Subsystem..... | 25-4 |
| 25.4.2 | Initiating Events Due to Loss of the Instrument Air Subsystem | 25-4 |
| 25.5 | System Logic Models..... | 25-4 |
| 25.5.1 | Assumptions and Boundary Conditions..... | 25-4 |
| 25.5.2 | Fault Tree Models..... | 25-6 |
| 25.5.3 | Human Interactions..... | 25-7 |
| 25.5.4 | Common Cause Failures..... | 25-7 |
| CHAPTER 26 PROTECTION AND SAFETY MONITORING SYSTEM | | |
| 26.1 | System Analysis Description..... | 26-1 |
| 26.1.1 | Analysis of Support Systems..... | 26-4 |
| 26.1.2 | Analysis of Instrumentation | 26-5 |
| 26.1.3 | Test and Maintenance Assumptions..... | 26-6 |
| 26.2 | Performance During Accident Conditions | 26-7 |
| 26.3 | Initiating Event Review..... | 26-7 |
| 26.3.1 | Initiating Event Impacting PMS..... | 26-7 |
| 26.3.2 | Initiating Event due to Loss of PMS | 26-8 |
| 26.4 | System Logic Model Development | 26-8 |
| 26.4.1 | Assumptions and Boundary Conditions..... | 26-8 |
| 26.4.2 | Fault Tree Models..... | 26-12 |
| 26.4.3 | Description of I&C Subtree Development | 26-12 |
| 26.4.4 | Human Interactions..... | 26-19 |
| 26.5 | Discussion of Methodology..... | 26-19 |
| 26.5.1 | Fault Tree Analysis..... | 26-20 |
| 26.5.2 | Unavailability..... | 26-20 |
| 26.5.3 | Spurious Failure Rate Per Year..... | 26-20 |
| 26.5.4 | Common Cause Failures | 26-22 |
| 26.5.5 | Data Manipulation | 26-23 |
| 26.6 | References..... | 26-24 |
| CHAPTER 27 DIVERSE ACTUATION SYSTEM | | |
| 27.1 | System Analysis Description..... | 27-1 |
| 27.1.1 | Support Systems Analysis..... | 27-2 |
| 27.1.2 | Analysis of Instrumentation and Control | 27-2 |
| 27.1.3 | Test and Maintenance | 27-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|-------------|
| 27.2 | Analysis of System Operation | 27-2 |
| 27.3 | Performance During Accident Conditions | 27-6 |
| 27.4 | Initiating Event Review..... | 27-6 |
| 27.4.1 | Initiating Events Impacting the Diverse Actuation System..... | 27-6 |
| 27.4.2 | Initiating Events Due to Loss of the Diverse Actuation System..... | 27-6 |
| 27.5 | System Logic Model | 27-6 |
| 27.5.1 | Assumptions and Boundary Conditions..... | 27-7 |
| 27.5.2 | Fault Tree Model | 27-7 |
| 27.5.3 | Human Interactions..... | 27-7 |
| 27.5.4 | Common Cause Failures | 27-8 |
| | | |
| CHAPTER 28 PLANT CONTROL SYSTEM | | |
| 28.1 | System Analysis Description..... | 28-1 |
| 28.1.1 | Analysis of Support Systems..... | 28-3 |
| 28.1.2 | Analysis of Instrumentation | 28-4 |
| 28.1.3 | Test and Maintenance Assumptions..... | 28-4 |
| 28.2 | Performance During Accident Conditions | 28-6 |
| 28.3 | Initiating Event Review..... | 28-6 |
| 28.3.1 | Initiating Events Impacting the Plant Control System..... | 28-6 |
| 28.3.2 | Initiating Event due to Loss of the Plant Control System..... | 28-6 |
| 28.4 | System Logic Model Development | 28-7 |
| 28.4.1 | Assumptions and Boundary Conditions..... | 28-7 |
| 28.4.2 | Fault Tree Models..... | 28-9 |
| 28.4.3 | Description of I&C Subtree Development | 28-10 |
| 28.4.4 | Human Interactions..... | 28-16 |
| 28.5 | Discussion of Methodology..... | 28-17 |
| 28.5.1 | Fault Tree Analysis | 28-17 |
| 28.5.2 | Unavailability..... | 28-17 |
| 28.5.3 | Common Cause Failures | 28-17 |
| 28.5.4 | Data Manipulation | 28-18 |
| | | |
| CHAPTER 29 COMMON-CAUSE ANALYSIS | | |
| 29.1 | Introduction | 29-1 |
| 29.2 | Dependent Failures | 29-1 |
| 29.3 | Common-Cause Analysis | 29-4 |
| 29.3.1 | Assumptions | 29-4 |
| 29.3.2 | Analysis of Potential Common-Cause Failures within the Systems | 29-6 |
| 29.3.3 | Analysis of Potential Common-Cause Failures among Several Systems | 29-6 |
| 29.4 | Calculations For Component Groups | 29-6 |
| 29.4.1 | DC Batteries..... | 29-7 |
| 29.4.2 | Reactor Trip Breakers | 29-8 |
| 29.4.3 | Automatic Depressurization System Explosive Valves..... | 29-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|--|-------------|
| 29.4.4 | Air-Operated Valves in Core Makeup Tanks..... | 29-10 |
| 29.4.5 | Automatic Depressurization System Motor-Operated Valves..... | 29-11 |
| 29.4.6 | Common-Cause Failure for IRWST Valves..... | 29-14 |
| 29.5 | Results..... | 29-17 |
| 29.6 | References..... | 29-17 |
| ATTACHMENT 29A COMMON-CAUSE ANALYSIS GUIDELINES..... | | 29A-1 |
| 29A.1 | Introduction..... | 29A-1 |
| 29A.2 | Types of Dependencies | 29A-1 |
| 29A.3 | Common Cause Failures Definition | 29A-2 |
| 29A.4 | Methodology | 29A-3 |
| 29A.5 | Common Cause Failures Calculation Procedure | 29A-4 |
| 29A.5.1 | Procedure for Treatment of Common Cause Failures Within a System..... | 29A-5 |
| 29A.5.2 | Procedure for Treatment of Common Cause Failures Among More Systems | 29A-7 |
| 29A.6 | Common Cause Failure Numerical Evaluation | 29A-8 |
| 29A.6.1 | Evaluation through Beta Factor Method | 29A-8 |
| 29A.6.2 | Evaluation through Multiple-Greek Letter (MGL) Method | 29A-8 |
| 29A.7 | References..... | 29A-10 |
| CHAPTER 30 HUMAN RELIABILITY ANALYSIS | | |
| 30.1 | Introduction..... | 30-1 |
| 30.2 | Summary of Results | 30-1 |
| 30.3 | Methodology | 30-2 |
| 30.4 | Major Assumptions | 30-4 |
| 30.5 | Types of Human Interactions | 30-10 |
| 30.5.1 | Quantification Model..... | 30-11 |
| 30.6 | Quantification..... | 30-12 |
| 30.6.1 | ZON-MAN01 (Start the Onsite Standby Diesel Generator)..... | 30-12 |
| 30.6.2 | LPM-MAN01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-13 |
| 30.6.3 | LPM-MAN02 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-15 |
| 30.6.4 | LPM-MAN05 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-16 |
| 30.6.5 | LPM-REC01 (Recognize the Need for Reactor Coolant System Depressurization)..... | 30-17 |
| 30.6.6 | ADN-MAN01 (Actuate the Automatic Depressurization System) | 30-17 |
| 30.6.7 | ADN-REC01 (Actuate the Automatic Depressurization System)..... | 30-19 |
| 30.6.8 | CCB-MAN01 (Start the Standby Component Cooling Water Pump)..... | 30-19 |
| 30.6.9 | CCN-MAN02 (Inadvertent Misalignment of Heat Exchanger) | 30-20 |
| 30.6.10 | CIB-MAN00 (Diagnose Steam Generator Tube Rupture)..... | 30-21 |
| 30.6.11 | DUMP-MAN01 (Operate Steam Dump Valves) | 30-22 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 30.6.12 | CIC-MAN01 (Isolate Containment)..... | 30-23 |
| 30.6.13 | ADS-MANTEST (Recognize the Need and Reclose ADS Stage MOV)..... | 30-24 |
| 30.6.14 | CAN-MAN0S (Locally Close Manual Valve CAS-V204 to Isolate Containment) | 30-25 |
| 30.6.15 | CIT-MAN0S (Isolate Containment)..... | 30-26 |
| 30.6.16 | CMN-MAN01 (Actuate Core Makeup Tank)..... | 30-27 |
| 30.6.17 | CMN-REC01 (Actuate the Core Makeup Tanks)..... | 30-28 |
| 30.6.18 | CVN-MAN00 (Align Chemical and Volume Control System) | 30-29 |
| 30.6.19 | CVN-MAN02 (Align Chemical and Volume Control System) | 30-30 |
| 30.6.20 | CVN-MAN03 (Start Chemical and Volume Control System Pump B) | 30-30 |
| 30.6.21 | ADF-MAN01 (Depressurize the RCS to Refill the Pressurizer)..... | 30-31 |
| 30.6.22 | SGHL-MAN01 (Isolate Feedwater to Failed Steam Generator) | 30-32 |
| 30.6.23 | CAN-MAN01 (Start Standby Compressor) | 30-33 |
| 30.6.24 | REN-MAN02 (Initiate Recirculation)..... | 30-33 |
| 30.6.25 | REN-MAN03 (Initiate Recirculation)..... | 30-34 |
| 30.6.26 | IWN-MAN00 (Operate In-Containment Refueling Water Storage Tank Motor-Operated Valves)..... | 30-35 |
| 30.6.27 | RHN-MAN01 (Align Normal Residual Heat Removal System)..... | 30-36 |
| 30.6.28 | RHN-MANDIV (Align Normal Residual Heat Removal System)..... | 30-37 |
| 30.6.29 | RHN-MAN02/RHN-MAN03 (Align Normal Residual Heat Removal System)..... | 30-38 |
| 30.6.30 | PCN-MAN01 (Actuate Passive Containment Cooling System)..... | 30-40 |
| 30.6.31 | HPM-MAN01 (Diagnose Need for High Pressure Heat Removal)..... | 30-40 |
| 30.6.32 | PRN-MAN01 (Align Passive Residual Heat Removal System) | 30-41 |
| 30.6.33 | PRN-MAN02 (Align Passive Residual Heat Removal System) | 30-42 |
| 30.6.34 | PRN-MAN03 (Align Passive Residual Heat Removal System) | 30-43 |
| 30.6.35 | PRI-MAN01 (Isolate Failed Passive Residual Heat Removal Heat Exchanger) | 30-44 |
| 30.6.36 | REN-MAN04 (Initiate Recirculation)..... | 30-45 |
| 30.6.37 | RCN-MAN01 (Trip Reactor Coolant Pumps) | 30-46 |
| 30.6.38 | ATW-MAN01 (Manually Insert Control Rods)..... | 30-47 |
| 30.6.39 | ATW-MAN03 (Manually Trip the Reactor through Protection and Safety Monitoring System in One Minute) | 30-48 |
| 30.6.40 | ATW-MAN04 (Manually Trip the Reactor through Diverse Actuation System in One Minute) | 30-49 |
| 30.6.41 | ATW-MAN05 (Manually Trip the Reactor through Protection and Safety Monitoring System in Seven Minutes)..... | 30-49 |
| 30.6.42 | ATW-MAN06 (Manually Trip the Reactor through Diverse Actuation System In Seven Minutes)..... | 30-50 |
| 30.6.43 | RTN-MAN01 (Perform Controlled Reactor Shutdown)..... | 30-51 |
| 30.6.44 | FWN-MAN02 (Start the Startup Feedwater Pumps) | 30-52 |
| 30.6.45 | FWN-MAN03 (Start the Startup Feedwater Pumps) | 30-53 |
| 30.6.46 | REG-MAN00 (Regulate Startup Feedwater)..... | 30-54 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|--------------|
| 30.6.47 | CIA-MAN01 (Isolate Failed Steam Generator) | 30-55 |
| 30.6.48 | CIB-MAN01 (Close Main Steam Isolation Valve) | 30-56 |
| 30.6.49 | SGA-MAN01 (Inadvertent Opening of Steam Generator Power-Operated Relief Valve)..... | 30-57 |
| 30.6.50 | SWN-MAN01N (Open Air-Operated Valve on Motor Strainer Line)..... | 30-58 |
| 30.6.51 | SWB-MAN02 (Start Standby Service Water Pump) | 30-58 |
| 30.6.52 | SWB-MAN02N (Start Standby Service Water Pump) | 30-59 |
| 30.6.53 | TCB-MAN01 (Start Standby Turbine Closed Cooling Water Pump)..... | 30-60 |
| 30.6.54 | TCB-MAN02 (Locally Align Standby Turbine Closed Cooling Water Heat Exchanger)..... | 30-61 |
| 30.6.55 | VLN-MAN01 (Actuate Hydrogen Control System) | 30-62 |
| 30.6.56 | VWN-MAN01 (Align Standby Chiller)..... | 30-63 |
| 30.6.57 | ATW-MAN11 (Recognize the Need for Manual Boration)..... | 30-64 |
| 30.6.58 | REC-MANDAS (Diagnosis of an Event Through DAS Signals or Perform an Activity by Operating DAS Controls)..... | 30-65 |
| 30.6.59 | RHN-MAN04 (Isolate the RNS During Shutdown Conditions)..... | 30-65 |
| 30.6.60 | RHN-MAN05 (Initiate Gravity Injection from IRWST via RNS Suction Line)..... | 30-66 |
| 30.6.61 | RHN-MAN06 (Recognize the Need and Throttle RNS Valve V011) | 30-68 |
| 30.6.62 | RCS-MANODS1 (Close AOVs CVS-V045 or -V047, Given Failure of HL Level Instruments) | 30-68 |
| 30.6.63 | RCS-MANODS2 (Close AOVs CVS-V045 or -V047, Given Failure of Valves to Close Automatically)..... | 30-70 |
| 30.6.64 | SWN-MAN03 (Recognize the Need and Locally Refill Service Water Basin) | 30-70 |
| 30.7 | Conditional Probability Evaluation | 30-71 |
| 30.7.1 | Application | 30-72 |
| 30.7.2 | Process Used to Determine Dependencies | 30-72 |
| 30.7.3 | Calculation of Dependent Human Error Probabilities..... | 30-72 |
| 30.8 | References | 30-74 |
| ATTACHMENT 30A HUMAN RELIABILITY ANALYSIS GUIDELINES..... | | 30A-1 |
| 30A.1 | Introduction..... | 30A-1 |
| 30A.2 | Schedule for Human Reliability Analysis | 30A-1 |
| 30A.3 | Methodology | 30A-1 |
| 30A.4 | Responsibility..... | 30A-2 |
| 30A.5 | Procedure for Human Interaction Evaluation | 30A-2 |
| 30A.5.1 | Type A | 30A-3 |
| 30A.5.2 | Type B | 30A-3 |
| 30A.5.3 | Type C | 30A-4 |
| 30A.5.4 | Commission Errors That Have Detrimental Effects..... | 30A-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 30A.6 | Procedure for Human Error Probabilities Quantification | 30A-8 |
| | 30A.6.1 Basic Assumptions for Human Interaction Analysis..... | 30A-8 |
| 30A.7 | References..... | 30A-9 |
| CHAPTER 31 | OTHER EVENT TREE NODE PROBABILITIES | |
| 31.1 | Introduction..... | 31-1 |
| 31.2 | Identification of Cases Requiring Calculations | 31-1 |
| | 31.2.1 BL – Main Steam Line Break Occurs Inside Containment | 31-1 |
| | 31.2.2 CNB – Containment Isolation Fails Due to Reactor Coolant System Vessel Rupture..... | 31-1 |
| | 31.2.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-1 |
| | 31.2.4 NSGTR – Consequential Steam Generator Tube Rupture..... | 31-2 |
| | 31.2.5 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-2 |
| | 31.2.6 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-2 |
| | 31.2.7 PRSOV – Pressurizer Safety Valves Reclose | 31-2 |
| | 31.2.8 R05 – Offsite Power Recovered within One-Half Hour..... | 31-2 |
| | 31.2.9 SLSOV – Main Steam Line Relief Valves Reclose | 31-2 |
| 31.3 | Case-Specific Calculations..... | 31-3 |
| | 31.3.1 BL – Main Steam Line Break Occurs Inside Containment..... | 31-3 |
| | 31.3.2 CNB – Containment Isolation Fails Due to RCS Vessel Rupture..... | 31-3 |
| | 31.3.3 MGSET – Control Rods Motor-Generator Set Trip..... | 31-3 |
| | 31.3.4 PO – Pre-existing Containment Opening Allowing Bypass..... | 31-4 |
| | 31.3.5 PRES – Reactor Coolant System Pressure Relief via Pressurizer Safety Valves | 31-4 |
| | 31.3.6 PRSOV – Pressurizer Safety Valves Reclose | 31-5 |
| | 31.3.7 R05 – Offsite Power Recovered within One-Half Hour..... | 31-6 |
| | 31.3.8 SGTR1 – Single Consequential Steam Generator Tube Rupture..... | 31-6 |
| | 31.3.9 SGTR – Multiple Consequential Steam Generator Tube Rupture | 31-8 |
| | 31.3.10 SLSOV – Main Steam Line Relief and Safety Valves Reclose | 31-8 |
| | 31.3.11 SLSOV1 – Main Steam Line Relief and Safety Valves Reclose | 31-9 |
| | 31.3.12 SLSOV2 – Main Steam Line Safety Valves Reclose..... | 31-10 |
| | 31.3.13 SLSOV3 – Main Steamline Relief and Safety Valves Reclose, SGTR..... | 31-10 |
| 31.4 | References..... | 31-11 |
| CHAPTER 32 | DATA ANALYSIS AND MASTER DATA BANK | |
| 32.1 | Data Analysis | 32-1 |
| | 32.1.1 Random Component Failure Data..... | 32-1 |
| | 32.1.2 Test and Maintenance Unavailability..... | 32-2 |
| | 32.1.3 Common Cause Failure Data | 32-2 |
| | 32.1.4 Human Reliability Data | 32-2 |
| | 32.1.5 Initiating Event Frequency Data | 32-2 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|--|-------------|
| 32.2 | Master Data Bank..... | 32-2 |
| 32.2.1 | Initiating Event Frequencies | 32-3 |
| 32.2.2 | Random Component Failures..... | 32-3 |
| 32.2.3 | Common Cause Failure Probabilities..... | 32-3 |
| 32.2.4 | Human Error Probabilities | 32-3 |
| 32.2.5 | System-Specific Calculations..... | 32-3 |
| 32.2.6 | Other Event Tree Node Probabilities | 32-3 |
| 32.2.7 | Master Data Bank | 32-4 |
| 32.3 | References..... | 32-4 |
| | | |
| CHAPTER 33 | FAULT TREE AND CORE DAMAGE QUANTIFICATION | |
| 33.1 | Introduction..... | 33-1 |
| 33.2 | Fault Tree Model Quantification..... | 33-1 |
| 33.3 | Event Tree Model Calculation | 33-1 |
| 33.3.1 | Core Damage Quantification Method | 33-2 |
| 33.3.2 | Core Damage Quantification Input Files and Data | 33-4 |
| 33.3.3 | Definition of Consequential Event Categories | 33-4 |
| 33.3.4 | Incorporate Operator Action Dependencies Into Plant Core Damage Frequency Quantification..... | 33-6 |
| 33.3.5 | Core Damage Frequency Results | 33-6 |
| | | |
| CHAPTER 34 | SEVERE ACCIDENT PHENOMENA TREATMENT | |
| 34.1 | Introduction..... | 34-1 |
| 34.2 | Treatment of Physical Processes | 34-1 |
| 34.2.1 | In-Vessel Retention of Molten Core Debris..... | 34-1 |
| 34.2.2 | Fuel-Coolant Interaction (Steam Explosions) | 34-2 |
| 34.2.3 | Hydrogen Combustion and Detonation..... | 34-4 |
| 34.2.4 | High-Pressure Melt Ejection..... | 34-5 |
| 34.2.5 | Core Debris Coolability | 34-5 |
| 34.2.6 | Containment Pressurization from Decay Heat | 34-6 |
| 34.2.7 | Elevated Temperature (Equipment Survivability)..... | 34-7 |
| 34.2.8 | Summary..... | 34-7 |
| 34.3 | Analysis Method | 34-7 |
| 34.4 | Severe Accident Analyses | 34-8 |
| 34.4.1 | Accident Class 3BE – Intact Containment..... | 34-8 |
| 34.4.2 | Accident Class 3BE – Failed Containment..... | 34-10 |
| 34.4.3 | Accident Class 3BL – Intact Containment..... | 34-11 |
| 34.4.4 | Accident Class 3BR – Intact Containment..... | 34-12 |
| 34.4.5 | Accident Class 3C – Intact Containment | 34-13 |
| 34.4.6 | Accident Class 3C – Failed Containment | 34-14 |
| 34.4.7 | Accident Class 3D – Intact Containment | 34-14 |
| 34.4.8 | Accident Class 3D – Failed Containment..... | 34-16 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| 34.4.9 | Accident Class 6E – Bypass Containment | 34-16 |
| 34.4.10 | Accident Class 6L – Bypass Containment | 34-17 |
| 34.4.11 | Accident Class 1AP | 34-17 |
| 34.4.12 | Accident Class 1A | 34-18 |
| 34.4.13 | Intermediate and Late Containment Failure Cases | 34-19 |
| 34.5 | Insights and Conclusions..... | 34-21 |
| 34.6 | References..... | 34-21 |
| | | |
| CHAPTER 35 | CONTAINMENT EVENT TREE ANALYSIS | |
| 35.1 | Introduction..... | 35-1 |
| 35.2 | Containment Event Tree – General Discussion..... | 35-1 |
| 35.3 | Event Tree Construction..... | 35-2 |
| 35.4 | Level 1/Level 2 Interface..... | 35-3 |
| 35.5 | Containment Event Tree Top Events | 35-3 |
| 35.5.1 | Severe Accident Phenomena Considerations | 35-3 |
| 35.5.2 | Operator Action and Systems Top-Event Considerations | 35-5 |
| 35.6 | Release Category Definitions | 35-7 |
| 35.6.1 | Release Category BP – Containment Bypass | 35-8 |
| 35.6.2 | Release Category CI – Containment Isolation Failure | 35-9 |
| 35.6.3 | Release Category CFE – Early Containment Failure | 35-9 |
| 35.6.4 | Release Category CFI – Intermediate Containment Failure | 35-9 |
| 35.6.5 | Release Category CFL – Late Containment Failure..... | 35-9 |
| 35.6.6 | Release Category CFV – Containment Venting..... | 35-10 |
| 35.6.7 | Release Category IC – Intact Containment | 35-10 |
| 35.7 | Top-Event Nodal Questions and Success Criteria..... | 35-10 |
| 35.7.1 | Top Event DP – RCS Depressurization After Core Uncovery..... | 35-11 |
| 35.7.2 | Top Event IS – Containment Isolation..... | 35-12 |
| 35.7.3 | Top Event IR – Reactor Cavity Flooding..... | 35-13 |
| 35.7.4 | Top Event RFL – Reflooding of a Degraded Core | 35-14 |
| 35.7.5 | Top Event VF – Debris Relocation to the Reactor Cavity | 35-14 |
| 35.7.6 | Top Event PC – Passive Containment Cooling..... | 35-15 |
| 35.7.7 | Top Event VNT – Containment Venting | 35-16 |
| 35.7.8 | Top Event IF – Intermediate Containment Failure..... | 35-16 |
| 35.7.9 | Top Event IG – Hydrogen Control System | 35-17 |
| 35.7.10 | Top Event DF – Diffusion Flame | 35-17 |
| 35.7.11 | Top Event DTE – Early Hydrogen Detonation | 35-18 |
| 35.7.12 | Top Event DFG – Hydrogen Deflagration | 35-19 |
| 35.7.13 | Top Event DTI – Intermediate Hydrogen Detonation..... | 35-19 |
| 35.8 | Summary | 35-20 |
| 35.9 | References..... | 35-20 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| CHAPTER 36 REACTOR COOLANT SYSTEM DEPRESSURIZATION | | |
| 36.1 | Introduction..... | 36-1 |
| 36.2 | Definition of High Pressure..... | 36-1 |
| 36.3 | Node DP..... | 36-2 |
| 36.4 | Success Criteria..... | 36-2 |
| 36.4.1 | Accident Classes 3BE, 3BL, 3BR, 3C..... | 36-2 |
| 36.4.2 | Accident Class 3D/1D..... | 36-3 |
| 36.4.3 | Accident Classes 1A and 1AP..... | 36-3 |
| 36.4.4 | Steam Generator Tube Rupture – Accident Class 6..... | 36-4 |
| 36.4.5 | Anticipated Transient Without Scram – Accident Class 3A..... | 36-5 |
| 36.6 | References..... | 36-5 |
| CHAPTER 37 CONTAINMENT ISOLATION | | |
| 37.1 | Introduction..... | 37-1 |
| 37.2 | Definition of Containment Isolation..... | 37-1 |
| 37.3 | Success Criteria..... | 37-1 |
| 37.3.1 | Accident Classes 1A and 1AP..... | 37-2 |
| 37.3.2 | Accident Class 3A..... | 37-2 |
| 37.3.3 | Accident Class 3BR..... | 37-2 |
| 37.3.4 | Accident Class 3BE..... | 37-2 |
| 37.3.5 | Accident Class 3BL..... | 37-2 |
| 37.3.6 | Accident Class 3C..... | 37-2 |
| 37.3.7 | Accident Class 3D/1D..... | 37-3 |
| 37.3.8 | Accident Class 6..... | 37-3 |
| 37.4 | Summary..... | 37-3 |
| CHAPTER 38 REACTOR VESSEL REFLOODING | | |
| 38.1 | Introduction..... | 38-1 |
| 38.2 | Definition of Reflooding Success..... | 38-1 |
| 38.3 | Success Criteria..... | 38-1 |
| 38.3.1 | Accident Classes 1A and 1AP..... | 38-1 |
| 38.3.2 | Accident Class 3BR..... | 38-2 |
| 38.3.3 | Accident Class 3BE..... | 38-2 |
| 38.3.4 | Accident Class 3BL..... | 38-3 |
| 38.3.5 | Accident Class 3D/1D..... | 38-3 |
| 38.3.6 | Accident Class 6..... | 38-3 |
| 38.3.7 | Accident Class 3C..... | 38-3 |
| 38.3.8 | Accident Class 3A..... | 38-4 |
| 38.4 | Summary..... | 38-4 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 39 IN-VESSEL RETENTION OF MOLTEN CORE DEBRIS | | |
| 39.1 | Introduction..... | 39-1 |
| 39.2 | Background on the Application of IVR to the Passive Plant..... | 39-1 |
| 39.3 | Application of IVR to the AP1000 Passive Plant..... | 39-2 |
| 39.4 | Reactor Vessel Failure Criteria | 39-3 |
| 39.5 | In-Vessel Melt Progression and Relocation..... | 39-4 |
| 39.6 | Application of Heat Transfer Correlations to the AP1000 | 39-6 |
| | 39.6.1 Debris Pool to Vessel Wall Heat Transfer | 39-6 |
| | 39.6.2 Vessel Wall to External Cooling Water Heat Transfer | 39-7 |
| 39.7 | Quantification of Margin to Failure of the Reactor Vessel Wall | 39-8 |
| | 39.7.1 Zirconium Oxidation Fraction Input Probability Distribution..... | 39-9 |
| | 39.7.2 Steel Mass Input Probability Distribution | 39-9 |
| | 39.7.3 Final Bounding State Timing Input Probability Distribution | 39-10 |
| | 39.7.4 Critical Heat Flux..... | 39-10 |
| | 39.7.5 Results and Conclusions of Heat Flux Quantification | 39-10 |
| 39.8 | Reactor Coolant System Depressurization | 39-11 |
| 39.9 | Reactor Cavity Flooding (Node IR) | 39-11 |
| | 39.9.1 Node IR Success Criteria | 39-12 |
| | 39.9.2 Cavity Flooding Scenario Dependencies | 39-13 |
| 39.10 | Reactor Vessel Insulation Design Concept..... | 39-15 |
| | 39.10.1 Description of Reactor Vessel Insulation and Venting | 39-15 |
| | 39.10.2 Design Analysis of the Insulation and Support Frame | 39-17 |
| 39.11 | Reactor Vessel External Surface Treatment..... | 39-18 |
| 39.12 | Reactor Vessel Failure (Node VF) | 39-18 |
| | 39.12.1 Node VF Success Criteria..... | 39-18 |
| 39.13 | Summary | 39-19 |
| 39.14 | References..... | 39-19 |
| ATTACHMENT 39A AP1000 IN-VESSEL CORE MELTING RELOCATION | | |
| 39A.1 | Introduction..... | 39A-1 |
| 39A.2 | Phenomenological Issues | 39A-1 |
| | 39A.2.1 Focusing Effect..... | 39A-1 |
| | 39A.2.2 Material Interaction..... | 39A-1 |
| 39A.3 | AP1000 Reactor Vessel Lower Internals Geometry | 39A-1 |
| 39A.4 | Modeling of Core and Reactor Vessel Lower Internals Heatup | 39A-2 |
| | 39A.4.1 MAAP4 Model | 39A-2 |
| | 39A.4.2 Finite Difference Modeling..... | 39A-3 |
| | 39A.4.3 Relocation of In-Core Debris to Lower Plenum..... | 39A-3 |
| 39A-5 | Base Core Damage Sequence for In-Vessel Retention..... | 39A-3 |
| | 39A.5.1 Core Heatup and Formation of In-Core Molten Debris Layers..... | 39A-4 |
| | 39A.5.2 Melting of Core Shroud and Core Barrel..... | 39A-6 |
| | 39A.5.3 Initial Relocation of Molten Core Debris to Lower Plenum | 39A-7 |
| | 39A.5.4 Lower Plenum Debris Pool Formation..... | 39A-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 39A.6 | Potential for Debris Interaction | 39A-12 |
| 39A.7 | Conclusions from Analysis of AP1000 In-Vessel Core Melting and Relocation | 39A-12 |
| 39A.8 | References | 39A-13 |
| CHAPTER 40 PASSIVE CONTAINMENT COOLING, LONG TERM CONTAINMENT INTEGRITY AND CONTAINMENT VENTING | | |
| 40.1 | Passive Containment Cooling System | 40-1 |
| 40.2 | Passive Containment Cooling Water – Node PC | 40-2 |
| | 40.2.1 Node PC Success Criteria | 40-2 |
| | 40.2.2 Operator Action | 40-2 |
| | 40.2.3 Node PC Failure Probability | 40-3 |
| 40.3 | Containment Venting – Node VT | 40-3 |
| | 40.3.1 Venting Success Criteria | 40-3 |
| | 40.3.2 Venting Failure Probability | 40-4 |
| 40.4 | Intermediate Containment Failure – Node IF | 40-4 |
| | 40.4.1 Success Criterion | 40-5 |
| | 40.4.2 Intermediate Containment Failure Probability | 40-5 |
| 40.5 | References | 40-5 |
| CHAPTER 41 HYDROGEN MIXING AND COMBUSTION ANALYSIS | | |
| 41.1 | Discussion of the Issue | 41-1 |
| 41.2 | Controlling Phenomena | 41-2 |
| 41.3 | Major Assumptions and Phenomenological Uncertainties | 41-3 |
| | 41.3.1 Hydrogen Generation | 41-3 |
| | 41.3.2 Containment Pressure | 41-3 |
| | 41.3.3 Flammability Limits | 41-3 |
| | 41.3.4 Detonation Limits and Loads | 41-4 |
| | 41.3.5 Igniter System | 41-4 |
| | 41.3.6 Other Ignition Sources | 41-5 |
| | 41.3.7 Severe Accident Management Actions | 41-5 |
| 41.4 | Hydrogen Generation and Mixing | 41-5 |
| | 41.4.1 Accident Class 3BE – Failure of Gravity Injection | 41-6 |
| | 41.4.2 Accident Class 3BL – Failure of Gravity Recirculation | 41-9 |
| | 41.4.3 Accident Class 3BR – Large LOCA with Accumulator Failure | 41-10 |
| | 41.4.4 Accident Class 3C | 41-11 |
| | 41.4.5 Accident Classes 3D and 1D | 41-12 |
| | 41.4.6 Accident Class 1AP | 41-12 |
| | 41.4.7 Accident Class 1A | 41-13 |
| | 41.4.8 Accident Class 3A | 41-13 |
| | 41.4.9 Accident Class 6 | 41-13 |
| | 41.4.10 Overall Mixing Insights | 41-14 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|---|-------------|
| 41.5 | Hydrogen Burning at Igniters..... | 41-15 |
| 41.6 | Early Hydrogen Combustion..... | 41-15 |
| | 41.6.1 Hydrogen Generation Rates..... | 41-15 |
| | 41.6.2 Hydrogen Release Locations..... | 41-17 |
| | 41.6.3 Early Hydrogen Combustion Ignition Sources..... | 41-18 |
| 41.7 | Diffusion Flame Analysis – CET Node DF..... | 41-18 |
| | 41.7.1 AP1000 Diffusion Flame Mitigation Strategy..... | 41-19 |
| | 41.7.2 Node DF Containment Failure Probability Assignment..... | 41-20 |
| 41.8 | Early Hydrogen Detonation – Containment Event Tree Node DTE..... | 41-21 |
| | 41.8.1 Containment Success Criteria at Node DTE..... | 41-21 |
| | 41.8.2 Early Hydrogen Detonation Decomposition Event Tree..... | 41-22 |
| 41.9 | Deflagration in Time Frame 3..... | 41-23 |
| | 41.9.1 Containment Success Criterion at Node DFL..... | 41-23 |
| | 41.9.2 AICC Peak Pressure..... | 41-24 |
| | 41.9.3 Conditional Containment Failure Probability from Deflagration..... | 41-25 |
| 41.10 | Detonation in Intermediate Time Frame..... | 41-29 |
| | 41.10.1 Containment Success Criterion at Node DTI..... | 41-29 |
| | 41.10.2 Mixing and Stratification..... | 41-29 |
| | 41.10.3 Quantification of DTI Failure Probabilities..... | 41-30 |
| 41.11 | Safety Margin Basis Containment Performance Requirement..... | 41-30 |
| 41.12 | Summary..... | 41-31 |
| 41.13 | References..... | 41-31 |
| ATTACHMENT 41A AP1000 SPECIFIC MAAP4.04 ANALYSES..... | | 41A-1 |
| ATTACHMENT 41B ANALYSIS OF HYDROGEN BURNING AT IGNITERS..... | | 41B-1 |
| CHAPTER 42 CONDITIONAL CONTAINMENT FAILURE PROBABILITY DISTRIBUTION | | |
| 42.1 | Introduction..... | 42-1 |
| 42.2 | Probabilistic Model..... | 42-1 |
| 42.3 | Containment Failure Characteristics..... | 42-2 |
| | 42.3.1 Median Values for Containment Failure..... | 42-2 |
| | 42.3.2 Uncertainties in Containment Failure..... | 42-3 |
| 42.4 | Containment Failure Predictions..... | 42-4 |
| | 42.4.1 Containment Cylindrical Shell..... | 42-4 |
| | 42.4.2 Ellipsoidal Upper Head..... | 42-5 |
| | 42.4.3 Equipment Hatches..... | 42-5 |
| | 42.4.4 Personnel Airlock..... | 42-6 |
| 42.5 | Overall Failure Distribution..... | 42-6 |
| 42.6 | Summary and Conclusions..... | 42-7 |
| 42.7 | References..... | 42-7 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|----------------|---|-------------|
| CHAPTER 43 | RELEASE FREQUENCY QUANTIFICATION | |
| 43.1 | Introduction..... | 43-1 |
| 43.2 | Plant Damage State Frequency Calculations..... | 43-2 |
| 43.3 | Containment Event Tree Node Frequencies..... | 43-2 |
| | 43.3.1 CET Nodes..... | 43-2 |
| | 43.3.2 CET Node Probabilities From Boolean Expressions..... | 43-3 |
| | 43.3.3 Probabilities for Hydrogen-Related CET Nodes..... | 43-6 |
| | 43.3.4 Other CET Node Probabilities..... | 43-6 |
| 43.4 | Containment Event Tree Quantification..... | 43-7 |
| | 43.4.1 Containment Event Tree..... | 43-7 |
| | 43.4.2 Dominant CET Sequences..... | 43-7 |
| | 43.4.3 LRF Cutsets for Dominant Sequences..... | 43-7 |
| 43.5 | Summary of Results..... | 43-7 |
| 43.6 | Importance and Sensitivity Analyses..... | 43-8 |
| | 43.6.1 CET Event Node Importance Analysis..... | 43-8 |
| | 43.6.2 No Credit Taken for DP Node for PDS-6..... | 43-8 |
| | 43.6.3 Lesser Reliability for Containment Isolation..... | 43-8 |
| | 43.6.4 Lesser Reliability for Hydrogen Igniters..... | 43-8 |
| | 43.6.5 Lesser Reliability for PCS..... | 43-9 |
| | 43.6.6 No Credit for Depressurization for High Pressure PDS..... | 43-9 |
| | 43.6.7 Set PDS-3C Vessel Failure Probability to 1.0..... | 43-9 |
| | 43.6.8 Set 3D and 1AP Diffusion Flame and Detonation Failure Probability to 1.0..... | 43-9 |
| 43.7 | Other Importance and Sensitivity Analyses..... | 43-9 |
| | 43.7.1 Initiating Event Importances..... | 43-9 |
| | 43.7.2 Sensitivity to Standby Systems..... | 43-10 |
| | 43.7.3 Sensitivity to Standby Systems With Credit for Manual DAS..... | 43-10 |
| | 43.7.4 Treatment of PCS Annulus Drain Plugging in the AP1000 PRA..... | 43-10 |
| 43.8 | Conclusions and Insights..... | 43-11 |
| ATTACHMENT 43A | PDS CALCULATIONS..... | 43A-1 |
| ATTACHMENT 43B | DP NODE PROBABILITY FOR PDS..... | 43B-1 |
| ATTACHMENT 43C | EVALUATION OF OPERATOR ACTIONS..... | 43C-1 |
| ATTACHMENT 43D | EFFECT OF "PRE-EXISTING CONTAINMENT OPENING" ON LRF..... | 43D-1 |
| ATTACHMENT 43E | EFFECT OF CONTAINMENT AIR-COOLING FAILURE ON PLANT RISK..... | 43E-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 44 MAAP4 CODE DESCRIPTION AND AP1000 MODELING | | |
| 44.0 | MAAP Background..... | 44-1 |
| 44.1 | MAAP4..... | 44-1 |
| 44.2 | The AP1000 MAAP4 Modeling | 44-3 |
| 44.3 | Benchmarking | 44-5 |
| 44.4 | Summary and Conclusions | 44-6 |
| 44.5 | References | 44-7 |
| CHAPTER 45 FISSION-PRODUCT SOURCE TERMS | | |
| 45.1 | Summary of AP1000 Release Categories..... | 45-1 |
| 45.2 | Release Category Source Terms..... | 45-2 |
| 45.2.1 | Release Category IC..... | 45-2 |
| 45.2.2 | Release Category BP..... | 45-2 |
| 45.2.3 | Release Category CI..... | 45-2 |
| 45.2.4 | Release Category CFE | 45-3 |
| 45.2.5 | Release Category CFI | 45-3 |
| 45.2.6 | Release Category CFL | 45-3 |
| 45.2.7 | Release Category CFV | 45-4 |
| 45.3 | Direct-Release Sensitivity Case..... | 45-4 |
| 45.4 | Summary | 45-4 |
| 45.5 | References..... | 45-4 |
| CHAPTERS 46 THROUGH 48 NOT USED | | |
| CHAPTER 49 OFFSITE DOSE RISK QUANTIFICATION | | |
| 49.1 | Introduction..... | 49-1 |
| 49.2 | Conformance with Regulatory Requirements..... | 49-2 |
| 49.3 | Assumptions..... | 49-2 |
| 49.4 | Methodology | 49-2 |
| 49.5 | Dose Evaluation Results and Discussion..... | 49-5 |
| 49.6 | Quantification of Site Risk..... | 49-6 |
| 49.7 | Risk Quantification Results..... | 49-7 |
| 49.8 | References..... | 49-7 |
| CHAPTER 50 IMPORTANCE AND SENSITIVITY ANALYSES | | |
| 50.1 | Introduction..... | 50-1 |
| 50.2 | Importance Analyses for Core Damage..... | 50-1 |
| 50.2.1 | Initiating Event Importances | 50-2 |
| 50.2.2 | Accident Sequence Importances | 50-3 |
| 50.2.3 | End State Importances | 50-4 |
| 50.2.4 | Common Cause Failure Importances | 50-4 |
| 50.2.5 | Human Error Importances..... | 50-5 |
| 50.2.6 | Component Importances | 50-6 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| 50.3 | System Importances for Core Damage | 50-7 |
| 50.4 | Human Error Sensitivity Analyses | 50-8 |
| 50.4.1 | Set HEPs to 1.0 (Failure) in Core Damage Output File | 50-9 |
| 50.4.2 | Set HEPs to 0.0 (Success) in Core Damage Output File | 50-10 |
| 50.4.3 | Set HEPs to 0.1 in Core Damage Output File | 50-10 |
| 50.5 | Other Sensitivity Analyses for Core Damage | 50-10 |
| 50.5.1 | Impact of Passive System Check Valves on Core Damage Frequency | 50-10 |
| 50.5.2 | Sensitivity to Squib Valve Failure Probability | 50-11 |
| 50.5.3 | Sensitivity to Circuit Breaker Failure Probability | 50-11 |
| 50.5.4 | Sensitivity to Standby Systems | 50-12 |
| 50.5.5 | Sensitivity to Standby Systems; Manual DAS Credited..... | 50-14 |
| 50.6 | Results..... | 50-15 |
| CHAPTER 51 UNCERTAINTY ANALYSIS | | |
| 51.1 | Introduction | 51-1 |
| 51.2 | Input Data/Error Factors..... | 51-2 |
| 51.3 | Input Files | 51-3 |
| 51.4 | Output Files..... | 51-3 |
| 51.5 | Sensitivity Analyses | 51-3 |
| 51.5.1 | Sensitivity to Simulation Parameters..... | 51-3 |
| 51.5.2 | Sensitivity to Key Basic Events | 51-3 |
| 51.5.3 | Sensitivity to Operator Actions | 51-4 |
| 51.6 | Summary of Results | 51-6 |
| 51.7 | References..... | 51-8 |
| ATTACHMENT 51A ASSIGNMENT OF ERROR FACTORS TO BASIC EVENT PROBABILITIES..... | | |
| | | 51A-1 |
| ATTACHMENT 51B @RISK UNCERTAINTY ANALYSIS RESULTS | | |
| | | 51B-1 |
| CHAPTERS 52 AND 53 NOT USED | | |
| CHAPTER 54 LOW-POWER AND SHUTDOWN RISK ASSESSMENT | | |
| 54.1 | Introduction | 54-1 |
| 54.2 | Data Analysis | 54-2 |
| 54.3 | Initiating Event Analysis | 54-3 |
| 54.4 | Event Tree/Mitigation System Evaluation..... | 54-3 |
| 54.5 | Common Cause Analysis Update for AP1000 | 54-3 |
| 54.6 | Human Reliability Assessment for AP1000 | 54-5 |
| 54.7 | Core Damage Quantification..... | 54-6 |
| 54.7.1 | Discussion of Results..... | 54-9 |
| 54.8 | Estimation of Shutdown Large Release Frequency | 54-9 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 54.9 | Sensitivity Analyses | 54-10 |
| 54.9.1 | Case 1 – Minimum Equipment per Tech Specs During Drained Conditions..... | 54-10 |
| 54.9.2 | Case 2 – No Credit for Standby Nonsafety Systems | 54-11 |
| 54.9.3 | Case 3 – HEPs Set Equal to 0.5 | 54-12 |
| 54.9.4 | Case 4 – No Credit for Standby Nonsafety Systems – Credit for Manual DAS | 54-12 |
| 54.9.5 | Case 5 – Assessment of Containment Closure Failure Probability | 54-13 |
| 54.10 | Conclusions..... | 54-17 |
| 54.11 | Reference | 54-17 |
| CHAPTER 55 | AP1000 SEISMIC MARGINS EVALUATION | |
| 55.1 | Seismic Margin HCLPF Methodology..... | 55-1 |
| 55.2 | Calculation of HCLPF Values..... | 55-1 |
| 55.2.1 | Seismic Margin HCLPF Methodology..... | 55-1 |
| 55.2.2 | Calculation of HCLPF Values | 55-2 |
| 55.3 | Seismic Margin Model..... | 55-11 |
| 55.3.1 | Major SMA Model Assumptions..... | 55-11 |
| 55.3.2 | Seismic Initiating Events | 55-12 |
| 55.3.3 | Initiating Event Category HCLPFs | 55-13 |
| 55.4 | Calculation of Plant HCLPF | 55-16 |
| 55.4.1 | HCLPFs for Basic Events | 55-16 |
| 55.4.2 | Calculation of Initiating Event HCLPFs | 55-17 |
| 55.5 | Results and Insights..... | 55-17 |
| 55.5.1 | AP1000 SMA Results..... | 55-17 |
| 55.5.2 | AP1000 SMA Insights..... | 55-18 |
| 55.6 | References..... | 55-20 |
| CHAPTER 56 | INTERNAL FLOODING ANALYSIS | |
| 56.1 | Introduction..... | 56-1 |
| 56.1.1 | Definitions | 56-1 |
| 56.2 | Methodology | 56-1 |
| 56.2.1 | Summary of Methodology | 56-1 |
| 56.2.2 | Information Collection..... | 56-2 |
| 56.2.3 | Initial Screening Assessment | 56-2 |
| 56.2.4 | Detailed Screening Assessment | 56-4 |
| 56.2.5 | Identification of Flood-Induced Initiating Events | 56-5 |
| 56.2.6 | Initiating Event Frequencies | 56-6 |
| 56.3 | Assumptions..... | 56-6 |
| 56.3.1 | General Flooding Analysis Assumptions and Engineering Judgments | 56-6 |
| 56.3.2 | AP1000-Specific Assumptions | 56-8 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| 56.4 | Information Collection | 56-10 |
| 56.4.1 | PRA-Modeled Equipment and Locations | 56-10 |
| 56.4.2 | Identification of Areas for Flooding Evaluation..... | 56-10 |
| 56.5 | At-Power Operations..... | 56-10 |
| 56.5.1 | Initial Screening Assessment | 56-11 |
| 56.5.2 | Detailed Screening Assessment | 56-11 |
| 56.5.3 | Identification of Flood-Induced Initiating Events | 56-26 |
| 56.5.4 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-29 |
| 56.5.5 | Quantification of At-Power Flood-Induced Events..... | 56-36 |
| 56.6 | Internal Flooding During Low-Power and Shutdown Conditions | 56-38 |
| 56.6.1 | Detailed Screening Assessment | 56-38 |
| 56.6.2 | Identification of Flood-Induced Initiating Events | 56-39 |
| 56.6.3 | Calculation of Flood-Induced Initiating Event Frequencies..... | 56-40 |
| 56.6.4 | Quantification of Shutdown Internal Flooding Scenario CDFs | 56-45 |
| 56.6.5 | Total Shutdown Flooding Core Damage Frequency..... | 56-47 |
| 56.6.6 | Seismically Induced Flooding..... | 56-47 |
| 56.6.7 | Flooding Hazards During Refueling Outages | 56-47 |
| 56.6.8 | Summary of Results..... | 56-47 |
| 56.7 | Large Release Frequency Estimates for Internal Flooding | 56-48 |
| 56.8 | Results of AP1000 Internal Flooding Analysis | 56-49 |
| | | |
| CHAPTER 57 FIRE RISK ASSESSMENT | | |
| 57.1 | Introduction..... | 57-1 |
| 57.2 | Qualitative Analysis | 57-1 |
| 57.2.1 | AP600 Qualitative Analysis..... | 57-1 |
| 57.2.2 | AP1000 Qualitative Analysis..... | 57-5 |
| 57.2.3 | AP1000 Fire Areas | 57-6 |
| 57.3 | Initiating Event Frequencies..... | 57-6 |
| 57.3.1 | Introduction..... | 57-6 |
| 57.3.2 | Methodology..... | 57-7 |
| 57.3.3 | Results for Plant Except Containment and the Main Control Room..... | 57-7 |
| 57.3.4 | Results for the Containment..... | 57-7 |
| 57.3.5 | Results for the Main Control Room | 57-7 |
| 57.4 | Development of Fire Scenarios | 57-10 |
| 57.4.1 | Spurious Actuation Model | 57-11 |
| 57.4.2 | Propagation Model..... | 57-14 |
| 57.4.3 | Fire Suppression Model | 57-15 |
| 57.4.4 | Operation Actions | 57-15 |
| 57.4.5 | Development of Fire Scenarios..... | 57-16 |
| 57.5 | Calculation of Conditional Core Damage Probabilities (CCDP)..... | 57-22 |
| 57.6 | Calculation of CDF from Fire Events | 57-23 |
| 57.6.1 | Calculation of Plant Fire CDF | 57-23 |
| 57.6.2 | Comments on Plant Areas..... | 57-23 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|---|--|-------------|
| | 57.6.3 Importances of Fire Areas..... | 57-25 |
| | 57.6.4 Conclusion..... | 57-27 |
| 57.7 | Sensitivity Studies..... | 57-27 |
| | 57.7.1 Manual Fire Suppression Systems..... | 57-27 |
| | 57.7.2 Sensitivity Analysis of the Probability of a Spurious Actuation of ADS Valves..... | 57-27 |
| | 57.7.3 Sensitivity of Human Action on Fire..... | 57-28 |
| | 57.7.4 Sensitivity Analysis on Ignition Frequencies..... | 57-28 |
| | 57.7.5 Sensitivity Analysis on ADS Actuation by DAS..... | 57-29 |
| | 57.7.6 Sensitivity Analysis on 1E to Non-1E Separation in the Containment..... | 57-29 |
| | 57.7.7 Sensitivity Analysis to Area to Area Propagation..... | 57-30 |
| | 57.7.8 Importance of Hot Shorts..... | 57-30 |
| 57.8 | Shutdown Fire Analysis..... | 57-30 |
| | 57.8.1 Introduction..... | 57-30 |
| | 57.8.2 Evaluation of AP1000 Shutdown Risk (Non-Drained Conditions)..... | 57-33 |
| | 57.8.3 Evaluation for Drained Shutdown Operations..... | 57-37 |
| | 57.8.4 Evaluation of Main Control Room..... | 57-40 |
| 57.9 | Conclusion and Insights..... | 57-40 |
| | 57.9.1 At-Power Analysis..... | 57-40 |
| | 57.9.2 Shutdown Fire Analysis..... | 57-41 |
| | 57.9.3 Conclusions..... | 57-42 |
| 57.10 | References..... | 57-42 |
| ATTACHMENT 57A CALCULATION OF SCENARIO CCDPs..... | | 57A-1 |
| | 57A.1 Calculation of Scenario CCDPs..... | 57A-1 |
| | 57A.2 Calculation of Scenario CCDPs for Overly Conservative Cases..... | 57A-3 |
| ATTACHMENT 57B MODELING OF OPERATOR ACTIONS IN FIRE SCENARIOS..... | | 57B-1 |
| | 57B.1 Calculation of Failure Probability of OPA-01..... | 57B-1 |
| | 57B.2 Calculation of Failure Probability of OPA-02..... | 57B-3 |
| | 57B.3 Operator Actions at Remote Shutdown Panel..... | 57B-6 |
| | 57B.4 More Reliable REC-MANDAS..... | 57B-6 |
| ATTACHMENT 57C FIRE AREA EVENT TREES DEFINING SCENARIOS..... | | 57C-1 |
| ATTACHMENT 57D AP1000 POTENTIAL FOR FIRE-INDUCED SPURIOUS ACTUATION OF FUNCTIONS THAT RESULT IN A BREACH OF HIGH/LOW PRESSURE BOUNDARY..... | | 57D-1 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|--|---|-------------|
| CHAPTER 58 WINDS, FLOODS, AND OTHER EXTERNAL EVENTS | | |
| 58.1 | Introduction..... | 58-1 |
| 58.2 | External Events Analysis..... | 58-1 |
| | 58.2.1 Severe Winds and Tornadoes..... | 58-1 |
| | 58.2.2 External Floods..... | 58-2 |
| | 58.2.3 Transportation and Nearby Facility Accidents..... | 58-2 |
| 58.3 | Conclusion | 58-2 |
| 58.4 | References..... | 58-3 |
| CHAPTER 59 PRA RESULTS AND INSIGHTS | | |
| 59.1 | Introduction..... | 59-1 |
| 59.2 | Use of PRA in the Design Process | 59-3 |
| 59.3 | Core Damage Frequency from Internal Initiating Events at Power | 59-4 |
| | 59.3.1 Dominant Core Damage Sequences..... | 59-6 |
| | 59.3.2 Component Importances for At-Power Core Damage Frequency..... | 59-7 |
| | 59.3.3 System Importances for At-Power Core Damage..... | 59-8 |
| | 59.3.4 System Failure Probabilities for At-Power Core Damage..... | 59-9 |
| | 59.3.5 Common Cause Failure Importances for At-Power Core Damage..... | 59-9 |
| | 59.3.6 Human Error Importances for At-Power Core Damage | 59-9 |
| | 59.3.7 Accident Class Importances..... | 59-10 |
| | 59.3.8 Sensitivity Analyses Summary for At-Power Core Damage | 59-11 |
| | 59.3.9 Summary of Important Level 1 At-Power Results | 59-12 |
| 59.4 | Large Release Frequency for Internal Initiating Events at Power..... | 59-15 |
| | 59.4.1 Dominant Large Release Frequency Sequences..... | 59-15 |
| | 59.4.2 Summary of Important Level 2 At-Power Results | 59-16 |
| 59.5 | Core Damage and Severe Release Frequency from Events at Shutdown | 59-19 |
| | 59.5.1 Summary of Shutdown Level 1 Results | 59-19 |
| | 59.5.2 Large Release Frequency for Shutdown and Low-Power Events | 59-22 |
| | 59.5.3 Shutdown Results Summary | 59-22 |
| 59.6 | Results from Internal Flooding, Internal Fire, and Seismic Margin Analyses..... | 59-23 |
| | 59.6.1 Results of Internal Flooding Assessment | 59-23 |
| | 59.6.2 Results of Internal Fire Assessment | 59-24 |
| | 59.6.3 Results of Seismic Margin Analysis | 59-25 |
| 59.7 | Plant Dose Risk From Release of Fission-Products | 59-26 |
| 59.8 | Overall Plant Risk Results..... | 59-26 |
| 59.9 | Plant Features Important to Reducing Risk..... | 59-27 |
| | 59.9.1 Reactor Design..... | 59-28 |
| | 59.9.2 Systems Design..... | 59-28 |
| | 59.9.3 Instrumentation and Control Design | 59-31 |
| | 59.9.4 Plant Layout..... | 59-32 |
| | 59.9.5 Containment Design | 59-32 |

TABLE OF CONTENTS (Cont.)

| <u>Section</u> | <u>Title</u> | <u>Page</u> |
|-----------------------|--|--------------------|
| 59.10 | PRA Input to Design Certification Process | 59-36 |
| 59.10.1 | PRA Input to Reliability Assurance Program | 59-36 |
| 59.10.2 | PRA Input to Tier 1 Information..... | 59-36 |
| 59.10.3 | PRA Input to MMI/Human Factors/Emergency Response Guidelines | 59-36 |
| 59.10.4 | Summary of PRA Based Insights..... | 59-37 |
| 59.10.5 | Combined License Information..... | 59-37 |
| 59.11 | References..... | 59-38 |
| APPENDIX A | THERMAL HYDRAULIC ANALYSIS TO SUPPORT SUCCESS CRITERIA | A-1 |
| APPENDIX B | EX-VESSEL SEVERE ACCIDENT PHENOMENA | B-1 |
| APPENDIX C | ADDITIONAL ASSESSMENT OF AP1000 DESIGN FEATURES..... | C-1 |
| APPENDIX D | EQUIPMENT SURVIVABILITY ASSESSMENT..... | D-1 |
| APPENDIX E | AP1000 PRA FAULT TREE PICTURES FOR LEVEL 1 ANALYSIS FOR EVENTS AT POWER OPERATION | E-1 |

LIST OF TABLES

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 2-1 | Internal Initiating Event Grouping Plant Systems and Equipment Available for Transient/Accident Conditions (Sheets 1 – 10)..... | 2-28 |
| 2-2 | NUREG/CR 3862 Initiator Categories (Sheets 1 – 4)..... | 2-38 |
| 2-3 | NUREG/CR 3862 Initiator Categories not Considered in the AP1000 PRA Analysis..... | 2-42 |
| 2-4 | AP1000 Internal Initiating Event Frequencies (Sheets 1 – 3) | 2-43 |
| 2-5 | Initiating Event Frequencies Used in Event Trees Quantification..... | 2-46 |
| 2A-1 | Summary of Primary System Piping Data | 2A-2 |
| 2A-2 | Summary of Primary System Pipe Break Frequency Quantification | 2A-3 |
| 2A-3 | Summary of Steam Generator Tube Rupture Events..... | 2A-4 |
| 2A-4 | Spurious Stuck-Open Pressurizer Safety Valve..... | 2A-5 |
| 2A-5 | Interface Break on Accumulator Lines..... | 2A-6 |
| 2A-6 | Interface Break on IRWST Injection Lines..... | 2A-7 |
| 2A-7 | Initiating Events Review Data Summary (Sheets 1 – 8)..... | 2A-8 |
| 2B-1 | Summary of Main Steam Line and Feedwater Line Piping Data for Secondary Side Break Frequency Quantification..... | 2B-2 |
| 2B-2 | Secondary Side Line Break Frequency Quantification..... | 2B-3 |
| 2B-3 | Stuck-Open Main Steam Line Safety Valve Frequency Quantification (Sheets 1 – 2) | 2B-4 |
| 3-1 | Loss of CCS/SWS Initiating Event Fault Tree CSWF Success Criteria Summary | 3-8 |
| 3-2 | Spurious Actuation of Automatic Depressurization Failure Criteria Summary | 3-9 |
| 3-3 | Evaluation of Spurious Automatic Depressurization System Frequencies (Sheets 1 – 6) | 3-10 |
| 4-1 | AP1000 Large LOCA Event End State Summary..... | 4-112 |
| 4-2 | AP1000 Spurious ADS Actuation Event End State Summary..... | 4-112 |
| 4-3 | AP1000 Medium LOCA Event End State Summary | 4-113 |
| 4-4 | AP1000 CMT Line Break LOCA Event End State Summary..... | 4-114 |
| 4-5 | AP1000 SI Line Break Event End State Summary | 4-115 |
| 4-6 | AP1000 Small LOCA Event End State Summary..... | 4-116 |
| 4-7 | AP1000 RCS Leak Event End State Summary | 4-117 |
| 4-8 | AP1000 PRHR Tube Rupture Event End State Summary | 4-117 |
| 4-9 | AP1000 SGTR Event End State Summary | 4-118 |
| 4-10 | AP1000 Vessel Rupture Event End State Summary | 4-119 |
| 4-11 | AP1000 Interfacing Systems LOCA Event End State Summary..... | 4-119 |
| 4-12 | AP1000 Transients with MFW Event End State Summary..... | 4-120 |
| 4-13 | AP1000 Transients with Loss of RCS Flow Event End State Summary..... | 4-121 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 4-14 | AP1000 Transients with Loss of MFW to One SG Event End State Summary | 4-122 |
| 4-15 | AP1000 Transients with Core Power Excursion Event End State Summary | 4-123 |
| 4-16 | AP1000 Transients with Loss of CCW/SW Event End State Summary | 4-124 |
| 4-17 | AP1000 Transients without Main Feedwater Event End State Summary | 4-125 |
| 4-18 | AP1000 Transients with Loss of Condenser Event End State Summary..... | 4-126 |
| 4-19 | AP1000 Transients with Loss of Compressed Air Event End State Summary..... | 4-127 |
| 4-20 | AP1000 Loss of Offsite Power Event End State Summary..... | 4-128 |
| 4-21 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-129 |
| 4-22 | AP1000 SLB Downstream of MSIVs Event End State Summary..... | 4-130 |
| 4-23 | AP1000 Stuck Open Secondary Side Safety Valve Event End State Summary | 4-131 |
| 4-24 | AP1000 ATWS Precursor without MFW Event End State Summary..... | 4-132 |
| 4-25 | AP1000 ATWS Precursor with SI Event End State Summary..... | 4-133 |
| 4-26 | AP1000 ATWS Precursor Transients with MFW Event End State Summary | 4-134 |
| 4A-1 | End States (Plant Damage States) | 4A-17 |
| 4A-2 | Summary of Systems Associated with Mitigating Functions for AP1000..... | 4A-18 |
| 5-1 | AP1000 Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-2 | AP1000 Non Safety-Related Plant Support Systems with Letter Designators | 5-3 |
| 5-3 | AP1000 Support Systems Interdependency Matrix (Sheets 1 – 14)..... | 5-4 |
| 5-4 | AP1000 Safety-Related Front Line Plant Systems Letter Designators | 5-18 |
| 5-5 | AP1000 Non Safety-Related Front Line Plant Systems Letter Designators | 5-18 |
| 5-6 | AP1000 Front Line System Dependencies Matrix (Sheets 1 – 18) | 5-19 |
| 6-1 | Summary of Event Tree Top Events Success Criteria (Internal Initiating Events at Power Cases) (Sheets 1 – 34) | 6-20 |
| 6-2 | Summary of Success Criteria for the Mitigating Systems (Sheets 1 – 9) | 6-54 |
| 6-3 | Summary of Success Criteria for Operator Actions and Mission Times (Sheets 1 – 4) | 6-68 |
| 7-1 | Example for Fault Tree XXX Success Criteria Summary | 7-15 |
| 7-2 | Example for System Dependency Matrix..... | 7-15 |
| 7-3 | Example for Component Test Assumptions..... | 7-16 |
| 7-4 | Example for Component Maintenance Assumptions | 7-16 |
| 7-5 | Example for Operator Actions and Misposition Analysis Summary | 7-16 |
| 7-6 | Fault Tree Identification Codes (Sheets 1 – 3)..... | 7-17 |
| 7-7 | System Identification Codes for Basic Events (Sheets 1 – 3)..... | 7-20 |
| 7-8 | Component Identification Codes (Sheets 1 – 7)..... | 7-23 |
| 7-9 | Failure Mode Identification Codes (Sheets 1 – 3)..... | 7-30 |
| 8-1 | List of Passive Residual Heat Removal System Fault Trees | 8-7 |
| 8-2a | Fault Tree “PRT” Success Criteria..... | 8-8 |
| 8-2b | Fault Tree “PRTA” Success Criteria..... | 8-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 8-2c | Fault Tree "PRL" Success Criteria..... | 8-10 |
| 8-2d | Fault Tree "PRP" Success Criteria..... | 8-11 |
| 8-2e | Fault Tree "PRS" Success Criteria..... | 8-12 |
| 8-2f | Fault Tree "PRW" Success Criteria..... | 8-13 |
| 8-2g | Fault Tree "PRI" Success Criteria..... | 8-14 |
| 8-3 | System Dependency Matrix..... | 8-15 |
| 8-4 | Component Test Assumptions..... | 8-16 |
| 8-5 | Component Maintenance Assumptions..... | 8-17 |
| 8-6 | Operator Actions and Misposition Analysis Summary..... | 8-18 |
| 8-7 | Common Cause Failures Summary..... | 8-19 |
| 8-8 | Basic Events Database for the PRHR System Fault Trees (Sheets 1 – 3)..... | 8-20 |
| 9-1 | List of System Fault Trees..... | 9-9 |
| 9-2a | Fault Tree CM2AB Success Criteria Summary..... | 9-10 |
| 9-2b | Fault Tree CM2SL Success Criteria Summary..... | 9-11 |
| 9-2c | Fault Tree CM2L Success Criteria Summary..... | 9-12 |
| 9-2d | Fault Tree CM2P Success Criteria Summary..... | 9-13 |
| 9-2e | Fault Tree CM1A Success Criteria Summary..... | 9-14 |
| 9-2f | Fault Tree CM2LLT Success Criteria Summary..... | 9-15 |
| 9-2g | Fault Tree CMBOTH Success Criteria Summary..... | 9-16 |
| 9-2h | Fault Tree CM2LA Success Criteria Summary..... | 9-17 |
| 9-3 | Notes Related to System Fault Tree Assumptions..... | 9-18 |
| 9-4 | System Dependency Matrix..... | 9-18 |
| 9-5 | Component Test Assumptions..... | 9-19 |
| 9-6 | Component Maintenance Assumptions..... | 9-19 |
| 9-7 | Operator Actions and Misposition Analysis Summary..... | 9-20 |
| 9-8 | Common Cause Failure Analysis Summary..... | 9-20 |
| 9-9 | Fault Tree Basic Events for Core Makeup Tank Subsystem (Sheets 1 – 3)..... | 9-21 |
| 10-1 | List of System Fault Trees..... | 10-5 |
| 10-2a | Fault Tree AC2AB Success Criteria Summary..... | 10-6 |
| 10-2b | Fault Tree AC1A Success Criteria Summary..... | 10-7 |
| 10-2c | Fault Tree ACBOTH Success Criteria Summary..... | 10-8 |
| 10-3 | Notes Related to System Fault Tree Assumptions..... | 10-9 |
| 10-4 | System Dependency Matrix..... | 10-9 |
| 10-5 | Component Test Assumptions..... | 10-9 |
| 10-6 | Component Maintenance Assumptions..... | 10-10 |
| 10-7 | Operator Actions and Misposition Analysis Summary..... | 10-10 |
| 10-8 | Common Cause Failure Analysis Summary..... | 10-10 |
| 10-9 | Fault Tree Basic Events for Accumulator Subsystem..... | 10-11 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 11-1a | List of ADS System Fault Trees (Sheets 1 – 2)..... | 11-8 |
| 11-1b | List of ADS System Fault Trees (for Plant Damage States Analysis)..... | 11-10 |
| 11-2a | ADS Success Criteria Versus Accident Conditions (Full Depressurization)..... | 11-11 |
| 11-2b | ADS Success Criteria Versus Accident Conditions (Partial Depressurization)..... | 11-12 |
| 11-2c | Automatic Depressurization System Fault Tree Summary (For Plant Damage States)..... | 11-13 |
| 11-2d | Fault Tree “ADA” Success Criteria | 11-13 |
| 11-2e | Fault Tree “ADAB” Success Criteria..... | 11-14 |
| 11-2f | Fault Tree “ADAL” Success Criteria | 11-15 |
| 11-2g | Fault Tree “ADB” Success Criteria..... | 11-15 |
| 11-2h | Fault Tree “ADL” Success Criteria..... | 11-16 |
| 11-2i | Fault Tree “ADM” Success Criteria..... | 11-16 |
| 11-2j | Fault Tree “ADMA” Success Criteria..... | 11-17 |
| 11-2k | Fault Tree “ADQ” Success Criteria | 11-17 |
| 11-2l | Fault Tree “ADS” Success Criteria | 11-18 |
| 11-2m | Fault Tree “ADT” Success Criteria..... | 11-18 |
| 11-2n | Fault Tree “ADW” Success Criteria..... | 11-19 |
| 11-2o | Fault Tree “AD1” Success Criteria | 11-19 |
| 11-2p | Fault Tree “AD1A” Success Criteria | 11-20 |
| 11-2q | Fault Tree “ADF” Success Criteria..... | 11-20 |
| 11-2r | Fault Tree “ADR” Success Criteria..... | 11-21 |
| 11-2s | Fault Tree “ADRA” Success Criteria..... | 11-21 |
| 11-2t | Fault Tree “ADU” Success Criteria | 11-22 |
| 11-2u | Fault Tree “ADUM” Success Criteria..... | 11-22 |
| 11-2v | Fault Tree “ADV” Success Criteria | 11-23 |
| 11-2w | Fault Tree “ADZ” Success Criteria..... | 11-23 |
| 11-2x | Fault Tree “ADQLT” Data Summary | 11-24 |
| 11-2y | Fault Tree “ADTLT” Success Criteria..... | 11-24 |
| 11-3 | Notes Related to ADS System Fault Tree Assumptions..... | 11-25 |
| 11-4 | System Dependencies Matrix | 11-26 |
| 11-5 | Component Test Assumptions..... | 11-27 |
| 11-6 | Component Maintenance Assumptions..... | 11-27 |
| 11-7 | Failure Probabilities Calculated | 11-27 |
| 11-8 | Operator Action Analysis Summary..... | 11-28 |
| 11-9 | Common Cause Failures Summary | 11-28 |
| 11-10 | Basic Events Data Base for the ADA System Fault Tree (Sheets 1 – 20)..... | 11-29 |
| 12-1 | List of System Fault Trees (FT) | 12-10 |
| 12-2a | Fault Tree “IW2AB” Success Criteria Summary | 12-11 |
| 12-2b | Fault Tree “IW2ABM” Success Criteria Summary..... | 12-12 |
| 12-2c | Fault Tree “IW2ABA” Success Criteria Summary | 12-13 |
| 12-2d | Fault Tree “IW2ABP” Success Criteria Summary | 12-14 |
| 12-2e | Fault Tree “IW2ABPM” Success Criteria Summary..... | 12-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 12-2f | Fault Tree "IW2ABB" Success Criteria Summary..... | 12-16 |
| 12-2g | Fault Tree "IW2ABBM" Success Criteria Summary..... | 12-17 |
| 12-2h | Fault Tree "IW1A" Success Criteria Summary..... | 12-18 |
| 12-2i | Fault Tree "IW1AM" Success Criteria Summary..... | 12-19 |
| 12-2j | Fault Tree "IWF" Success Criteria Summary..... | 12-20 |
| 12-2k | Fault Tree "RECIRC" Success Criteria Summary..... | 12-21 |
| 12-2l | Fault Tree "RECIRCP" Success Criteria Summary..... | 12-22 |
| 12-2m | Fault Tree "RECIRCB" Success Criteria Summary..... | 12-23 |
| 12-2n | Fault Tree "RECIRC1" Success Criteria Summary..... | 12-24 |
| 12-2o | Fault Tree "RECIRC1P" Success Criteria Summary..... | 12-25 |
| 12-2p | Fault Tree "RECIRC1B" Success Criteria Summary..... | 12-26 |
| 12-3 | System Dependency Matrix..... | 12-27 |
| 12-4 | Component Test Assumptions..... | 12-28 |
| 12-5 | Component Maintenance Assumptions..... | 12-28 |
| 12-6 | Failure Probabilities Calculated..... | 12-29 |
| 12-7 | Operator Actions and Misposition Analysis Summary..... | 12-29 |
| 12-8 | Common Cause Failure Analysis Summary..... | 12-30 |
| 12-9 | Fault Tree Basic Events (Sheets 1 – 11)..... | 12-31 |
| 13-1 | List of System Fault Trees..... | 13-7 |
| 13-2 | Fault Tree PCT Success Criteria Summary..... | 13-7 |
| 13-3 | Notes Related to System Fault Trees Assumptions..... | 13-7 |
| 13-4 | System Dependency Matrix..... | 13-8 |
| 13-5 | Component Test Assumptions..... | 13-8 |
| 13-6 | Component Maintenance Assumptions..... | 13-9 |
| 13-7 | Operator Actions and Misposition Analysis Summary..... | 13-9 |
| 13-8 | Common Cause Failure Analysis Summary..... | 13-9 |
| 13-9 | Fault Tree Basic Events for Passive Containment Cooling System..... | 13-10 |
| 14-1 | List of System Fault Trees (At-Power)..... | 14-8 |
| 14-2.a | Success Criteria Summary Fault Tree "FWT"..... | 14-9 |
| 14-2.b | Success Criteria Summary Fault Tree "FWF"..... | 14-10 |
| 14-2.c | Success Criteria Summary Fault Tree "SFWT"..... | 14-11 |
| 14-2.d | Success Criteria Summary Fault Tree "SFW"..... | 14-12 |
| 14-2.e | Success Criteria Summary Fault Tree "SFW1"..... | 14-13 |
| 14-2.f | Success Criteria Summary Fault Tree "SFWP"..... | 14-14 |
| 14-2.g | Success Criteria Summary Fault Tree "SFWM"..... | 14-15 |
| 14-2.h | Success Criteria Summary Fault Tree "SFWA"..... | 14-16 |
| 14-2.i | Success Criteria Summary Fault Tree "COND"..... | 14-17 |
| 14-2.j | Success Criteria Summary Fault Tree "COND1"..... | 14-18 |
| 14-2.k | Success Criteria Summary Fault Tree "CDS"..... | 14-19 |
| 14-2.l | Success Criteria Summary Fault Tree "TCCW"..... | 14-20 |
| 14-3 | Notes to System Fault Tree Assumptions..... | 14-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 14-4 | System Dependency Matrix (Sheets 1 – 2)..... | 14-22 |
| 14-5 | Component Test Assumptions..... | 14-24 |
| 14-6 | Component Maintenance Assumptions..... | 14-25 |
| 14-7 | Failure Probabilities Calculated in this Section..... | 14-25 |
| 14-8 | Operator Action Analysis Summary..... | 14-26 |
| 14-9 | Common Cause Failure (CCF) Summary..... | 14-27 |
| 14-10 | Fault Tree Basic Event for Main and Startup Feedwater System (Sheets 1 – 9) | 14-28 |
| 15-1 | List of System Fault Trees..... | 15-9 |
| 15-2a | Fault Tree CSBOR1 Success Criteria Summary | 15-10 |
| 15-2b | Fault Tree CVS1 Success Criteria Summary..... | 15-11 |
| 15-2c | Fault Tree CSAX Success Criteria Summary..... | 15-12 |
| 15-2d | Fault Tree SGHL Success Criteria Summary..... | 15-13 |
| 15-2e | Fault Tree CSP Success Criteria Summary | 15-14 |
| 15-3 | Notes Related to System Fault Tree Assumptions..... | 15-15 |
| 15-4 | System Dependency Matrix | 15-16 |
| 15-5 | Component Test Assumptions..... | 15-17 |
| 15-6 | Component Maintenance Assumptions | 15-18 |
| 15-7 | Operator Actions and Misposition Analysis Summary..... | 15-19 |
| 15-8 | Common Cause Failure Analysis Summary..... | 15-20 |
| 15-9 | Fault Tree Basic Events for Chemical and Volume Control System (Sheets 1 – 4)..... | 15-21 |
| 16-1 | List of System Fault Trees..... | 16-5 |
| 16-2 | Fault Tree VLH Success Criteria Summary | 16-5 |
| 16-3 | Notes Related to System Fault Tree Assumptions..... | 16-5 |
| 16-4 | System Dependency Matrix | 16-6 |
| 16-5 | Component Test Assumptions..... | 16-6 |
| 16-6 | Component Maintenance Assumptions | 16-6 |
| 16-7 | Operator Actions and Misposition Analysis Summary..... | 16-7 |
| 16-8 | Common Cause Failure Analysis Summary..... | 16-7 |
| 16-9 | Fault Tree Basic Events for Containment Hydrogen Control System | 16-8 |
| 17-1 | List of System Fault Trees..... | 17-7 |
| 17-2 | Fault Tree Success Criteria Summary (Sheets 1 – 2) | 17-8 |
| 17-3 | Notes Related to System Fault Tree Assumptions..... | 17-10 |
| 17-4 | System Dependencies Matrix | 17-11 |
| 17-5 | Component Test Assumptions..... | 17-12 |
| 17-6 | Component Maintenance Assumptions | 17-12 |
| 17-7 | Operator Actions and System Misposition Analysis Summary | 17-13 |
| 17-8 | Common Cause Failure Summary..... | 17-13 |
| 17-9 | Fault Tree Basic Events for Normal Residual Heat Removal System (Sheets 1 – 5) | 17-14 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 18-1 | List of System Fault Trees..... | 18-6 |
| 18-2a | Fault Tree CCN Success Criteria Summary | 18-6 |
| 18-2b | Fault Tree CCT Success Criteria Summary..... | 18-7 |
| 18-2c | Fault Tree CCP Success Criteria Summary..... | 18-7 |
| 18-3 | Notes Related to System Fault Tree Assumptions..... | 18-8 |
| 18-4 | System Dependency Matrix | 18-8 |
| 18-5 | Component Test Assumptions..... | 18-9 |
| 18-6 | Component Maintenance Assumptions..... | 18-9 |
| 18-7 | Operator Actions and Misposition Analysis Summary..... | 18-10 |
| 18-8 | Common Cause Failure Analysis Summary | 18-10 |
| 18-9 | Fault Tree Basic Events for Component Cooling Water System (Sheets 1 – 2)..... | 18-11 |
| 19-1 | List of System Fault Trees..... | 19-6 |
| 19-2a | Fault Tree SWN Success Criteria Summary | 19-6 |
| 19-2b | Fault Tree SWT Success Criteria Summary..... | 19-7 |
| 19-2c | Fault Tree SWP Success Criteria Summary | 19-7 |
| 19-3 | Notes Related to System Fault Tree Assumptions..... | 19-8 |
| 19-4 | System Dependency Matrix | 19-9 |
| 19-5 | Component Test Assumptions..... | 19-10 |
| 19-6 | Component Maintenance Assumptions..... | 19-10 |
| 19-7 | Operator Actions and Misposition Analysis Summary..... | 19-11 |
| 19-8 | Common Cause Failure Analysis Summary | 19-11 |
| 19-9 | Fault Tree Basic Events for Service Water System (Sheets 1 – 4) | 19-12 |
| 20-1 | List of System Fault Trees..... | 20-5 |
| 20-2 | Fault Tree VWH Success Criteria Summary..... | 20-5 |
| 20-3 | Notes Related to System Fault Tree Assumptions..... | 20-5 |
| 20-4 | System Dependency Matrix | 20-6 |
| 20-5 | Component Test Assumptions..... | 20-7 |
| 20-6 | Component Maintenance Assumptions..... | 20-7 |
| 20-7 | Operator Actions and Misposition Analysis Summary..... | 20-8 |
| 20-8 | Common Cause Failure Analysis Summary | 20-8 |
| 20-9 | Fault Tree Basic Events for Central Chilled Water System (Sheets 1 – 2)..... | 20-9 |
| 21-1 | List of System Fault Trees (Sheets 1 – 3)..... | 21-9 |
| 21-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 21-12 |
| 21-3 | Notes Related to System Fault Tree Assumptions (Sheets 1 – 3)..... | 21-28 |
| 21-4 | System Dependency Matrix | 21-31 |
| 21-5 | Component Test Assumptions..... | 21-31 |
| 21-6 | Component Maintenance Assumptions..... | 21-32 |
| 21-7 | Operator Actions and Misposition Analysis Summary..... | 21-32 |
| 21-8 | Common Cause Failure Analysis Summary | 21-32 |
| 21-9 | Fault Tree Basic Events for AC Power System (Sheets 1 – 22)..... | 21-33 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 22-1 | List of System Fault Trees (Sheets 1 – 4)..... | 22-6 |
| 22-2 | Fault Tree Success Criteria Summary (Sheets 1 – 16) | 22-10 |
| 22-3 | Notes Related to System Fault Tree Assumptions..... | 22-26 |
| 22-4 | Systems Dependency Matrix | 22-26 |
| 22-5 | Component Test Assumptions..... | 22-27 |
| 22-6 | Component Maintenance Assumptions..... | 22-27 |
| 22-7 | Operator Actions and Misposition Analysis Summary..... | 22-27 |
| 22-8 | Common Cause Failure Analysis Summary..... | 22-28 |
| 22-9 | Fault Tree Basic Events for Class 1E DC and UPS System (Sheets 1 – 12)..... | 22-29 |
| 22-10 | System Power Requirements/Dependencies (Sheets 1 – 11)..... | 22-41 |
| 23-1 | List of System Fault Trees (Sheets 1 – 3)..... | 23-6 |
| 23-2 | Fault Tree Success Criteria Summary (Sheets 1 – 10) | 23-9 |
| 23-3 | Notes Related to System Fault Tree Assumptions..... | 23-19 |
| 23-4 | System Dependency Matrix | 23-19 |
| 23-5 | Component Test Assumptions..... | 23-20 |
| 23-6 | Component Maintenance Assumptions..... | 23-20 |
| 23-7 | Operator Actions and Misposition Analysis Summary..... | 23-20 |
| 23-8 | Common Cause Failure Analysis Summary..... | 23-21 |
| 23-9 | Fault Tree Basic Events for Non-Class 1E DC and UPS Power System (Sheets 1 – 20)..... | 23-22 |
| 24-1 | AP1000 Containment Penetration List (Sheets 1 – 4)..... | 24-7 |
| 24-2 | Screening Analysis Evaluation (Sheets 1 – 5)..... | 24-16 |
| 24-3 | Containment Penetrations Not Screened Out for Normal Operation at Power Analysis..... | 24-21 |
| 24-4 | List of System Fault Trees..... | 24-21 |
| 24-5a | Fault Tree CIC Success Criteria Summary..... | 24-22 |
| 24-5b | Fault Tree CIA Success Criteria Summary..... | 24-22 |
| 24-5c | Fault Tree CIB Success Criteria Summary..... | 24-23 |
| 24-6 | Notes Related to System Fault Tree Assumptions..... | 24-23 |
| 24-7 | System Dependency Matrix (Sheets 1 – 3)..... | 24-24 |
| 24-8 | Component Test Assumptions..... | 24-27 |
| 24-9 | Component Maintenance Assumptions..... | 24-27 |
| 24-10 | Operator Actions and Misposition Analysis Summary..... | 24-28 |
| 24-11 | Common Cause Failure Analysis Summary..... | 24-28 |
| 24-12 | Fault Tree Basic Events for Containment Isolation System (Sheets 1 – 3) | 24-29 |
| 25-1 | List of System Fault Trees..... | 25-8 |
| 25-2a | Fault Tree CAIAIR Success Criteria Summary..... | 25-9 |
| 25-2b | Fault Tree CAIR Success Criteria Summary..... | 25-9 |
| 25-2c | Fault Tree CAIAIRP Success Criteria Summary..... | 25-10 |
| 25-2d | Fault Tree ENDCAIAI Success Criteria Summary | 25-10 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 25-2e | Fault Tree ENDCAIAP Success Criteria Summary | 25-11 |
| 25-2f | Fault Tree CASF Success Criteria Summary | 25-11 |
| 25-3 | Notes Related to System Fault Tree Assumptions..... | 25-12 |
| 25-4 | System Dependency Matrix | 25-12 |
| 25-5 | Component Test Assumptions..... | 25-12 |
| 25-6 | Component Maintenance Assumptions..... | 25-13 |
| 25-7 | Operator Actions and Misposition Analysis Summary..... | 25-13 |
| 25-8 | Common Cause Failure Analysis Summary..... | 25-13 |
| 25-9 | Fault Tree Basic Events for Instrument Air Subsystem (Sheets 1 – 4)..... | 25-14 |
| 26-1 | List of System Fault Trees..... | 26-25 |
| 26-2a | Fault Tree RTPMS, and RTPMS1 Success Criteria Summary | 26-26 |
| 26-2b | Fault Tree RTSTP Success Criteria Summary | 26-26 |
| 26-2c | Fault Tree RCL Success Criteria Summary..... | 26-27 |
| 26-2d.1 | Fault Tree RCT Success Criteria Summary..... | 26-27 |
| 26-2d.2 | Fault Tree RCN Success Criteria Summary | 26-28 |
| 26-2e | I&C Subtree Success Criteria Summary (Sheets 1 – 98)..... | 26-29 |
| 26-3a | PMS I&C Subtree Constructions (Sheets 1 – 19)..... | 26-127 |
| 26-3b | Representative PMS I&C Subtree Plot Listing (Sheets 1 – 14)..... | 26-146 |
| 26-4 | PMS Dependency Matrix (Sheets 1 – 3)..... | 26-160 |
| 26-5 | PMS Components Test Assumptions | 26-163 |
| 26-6 | Component Maintenance Assumptions..... | 26-163 |
| 26-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 5)..... | 26-164 |
| 26-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 3) | 26-169 |
| 26-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2) | 26-172 |
| 26-10a | Fault Tree Basic Events for Reactor Trip System (Sheets 1 – 4)..... | 26-174 |
| 26-10b | Fault Tree Basic Events for the I&C Subsystem (Sheets 1 – 49) | 26-178 |
| 26-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3)..... | 26-227 |
| 27-1 | List of System Fault Trees..... | 27-9 |
| 27-2a | Fault Tree DAS Success Criteria Summary | 27-9 |
| 27-2b | Fault Tree DAS1 Success Criteria Summary | 27-9 |
| 27-3 | Notes Related to System Fault Tree Assumptions..... | 27-10 |
| 27-4 | System Dependency Matrix | 27-10 |
| 27-5 | Component Test Assumptions..... | 27-10 |
| 27-6 | Component Maintenance Assumptions..... | 27-10 |
| 27-7 | Operator Actions and Misposition Analysis Summary..... | 27-10 |
| 27-8 | Common Cause Failure Analysis Summary | 27-11 |
| 27-9 | Fault Tree Basic Events for Diverse Actuation System..... | 27-12 |
| 28-1 | List of System Fault Trees..... | 28-20 |
| 28-2 | Fault Tree Success Criteria Summary (Sheets 1 – 22) | 28-21 |
| 28-3 | PLS I&C Subtree Constructions (Sheets 1 – 9)..... | 28-43 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 28-4 | PLS Dependency Matrix (Sheets 1 – 2) | 28-52 |
| 28-5 | PLS Components Test Assumptions | 28-54 |
| 28-6 | Component Maintenance Assumptions | 28-54 |
| 28-7 | Failure Probabilities Calculated in this Section (Sheets 1 – 3)..... | 28-55 |
| 28-8 | Operator Actions and System Misposition Analysis Summary (Sheets 1 – 2) | 28-58 |
| 28-9 | Common Cause Failure Analysis Summary (Sheets 1 – 2)..... | 28-60 |
| 28-10 | Fault Tree Basic Events for I&C Subsystem (Sheets 1 – 68)..... | 28-62 |
| 28-11 | Assumed List of I&C Instrumentation (Sheets 1 – 3)..... | 28-130 |
| 28-12 | Assignments of Plant Systems to Logic Cabinets..... | 28-133 |
| 28-13 | Assignments of Plant Systems to the Control Group Cabinets..... | 28-134 |
| 29-1 | Electrical Components with Low CCF Rate | 29-18 |
| 29-2 | Common-Cause Failure Calculations (Sheets 1 – 5)..... | 29-19 |
| 29-3 | Simplification of Q_K/Q_T Equations..... | 29-24 |
| 29A-1 | Extreme Environmental Conditions (Generic Causes of Dependent Failures) Excerpted from the ANS/IEEE PRA Procedures Guide (NUREG-2300)..... | 29A-11 |
| 29A-2 | Common-Cause Failures Among Systems | 29A-12 |
| 29A-3 | Common-Cause Failure Equations for MGL Method | 29A-13 |
| 30-1 | AP1000 Human Error Probability Summary Results (Sheets 1 – 16)..... | 30-75 |
| 30-2 | Manual DAS Actuation (Sheets 1 – 2)..... | 30-91 |
| 30-3 | Dependency Level Evaluation Summary (Sheets 1 – 14)..... | 30-93 |
| 30-4 | Dependency Level Evaluation (Sheets 1 – 3)..... | 30-107 |
| 30-5 | List of Acronyms..... | 30-110 |
| 30A-1 | Analyst Responsibility Based on Sharp Steps | 30A-10 |
| 30A-2 | Summary of Screening Values | 30A-11 |
| 30A-3 | Example of Operator Action Definition | 30A-12 |
| 30A-4 | HEP Data Bank (Sheets 1 – 5)..... | 30A-13 |
| 31-1 | Summary of Event Tree Scalar Probabilities..... | 31-12 |
| 32-1 | Generic Data Base (Sheets 1 – 13)..... | 32-5 |
| 32-2 | Test and Maintenance Outage Generic Data | 32-21 |
| 32-3 | Test and Maintenance Unavailabilities Used in AP1000 Core Damage Quantification..... | 32-22 |
| 32-4 | Common Cause Factors (Sheets 1 – 5)..... | 32-23 |
| 32-5 | SIMON.OUT File (Sheets 1 – 21) | 32-29 |
| 33-1 | Summary of AP1000 System Fault Tree Failure Probabilities (Sheets 1 – 13)..... | 33-7 |
| 33-2 | Example Accident Sequence Definitions for Large LOCA..... | 33-20 |
| 33-3 | AP1000 PRA Dominant CDF Cutsets (Sheets 1 – 10) | 33-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 33-4 | AP1000 PRA Dominant CDF Sequences (Sheets 1 – 18) | 33-31 |
| 33-5 | Contribution of Initiating Events to Plant Core Damage Frequency | 33-49 |
| 33-6 | List of Basic Events and Their Descriptions (Sheets 1 – 33) | 33-50 |
| 34-1 | Post-Accident Monitoring Equipment (Sheets 1 – 2)..... | 34-23 |
| 34-2 | Level 1 Accident Class..... | 34-25 |
| 34-3 | Summary of Release Categories..... | 34-26 |
| 34-4 | 3BE-1 Event Summary..... | 34-27 |
| 34-5 | 3BE-2 Event Summary..... | 34-28 |
| 34-6 | 3BE-4 Event Summary..... | 34-29 |
| 34-7 | 3BE-5 Event Summary..... | 34-30 |
| 34-8 | 3BE-6 Event Summary..... | 34-31 |
| 34-9 | 3BE-7 Event Summary..... | 34-32 |
| 34-10 | 3BE-3 Event Summary..... | 34-33 |
| 34-11 | 3BL-1 Event Summary..... | 34-34 |
| 34-12 | 3BL-2 Event Summary..... | 34-35 |
| 34-13 | 3BR-1 Event Summary | 34-36 |
| 34-14 | 3BR-1a Event Summary..... | 34-37 |
| 34-15 | 3C-1 Event Summary | 34-38 |
| 34-16 | 3C-2 Event Summary | 34-39 |
| 34-17 | 3D-1 Event Summary..... | 34-40 |
| 34-18 | 3D-2 Event Summary..... | 34-41 |
| 34-19 | 3D-3 Event Summary..... | 34-42 |
| 34-20 | 3D-4 Event Summary..... | 34-43 |
| 34-21 | 6E-1 Event Summary | 34-44 |
| 34-22 | 6L-1 Event Summary | 34-45 |
| 34-23 | 1AP-1 Event Summary..... | 34-46 |
| 34-24 | 1AP-2 Event Summary..... | 34-47 |
| 34-25 | 1A-1 Event Summary..... | 34-48 |
| 34-26 | 1A-2 Event Summary..... | 34-49 |
| 34-27 | CFI Event Summary..... | 34-50 |
| 34-28 | CFL Event Summary..... | 34-51 |
| 35-1 | Functional Definitions of Level 1 Accident Classes | 35-21 |
| 35-2 | CET Initial Conditions for Level 1 Accident Classes..... | 35-22 |
| 35-3 | Containment Event Tree Nodal Questions | 35-23 |
| 35-4 | Summary of Release Category Definitions..... | 35-24 |
| 35-5 | Summary of Containment Event Tree Success Criteria (Sheets 1 – 3)..... | 35-25 |
| 35-6 | Summary of Operator Actions Credited on Containment Event Tree | 35-28 |
| 36-1 | Summary Table for RCS Depressurization (CET Node DP)..... | 36-6 |
| 37-1 | Summary Table for Containment Isolation (CET Node IS) | 37-4 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|---|-------------|
| 38-1 | Summary Table for Reflooding (CET Node RFL)..... | 38-5 |
| 39-1 | Material Inventories in AP1000 Reactor Vessel..... | 39-21 |
| 39-2 | Summary Table for Reactor Cavity Flooding (CET Node IR)..... | 39-22 |
| 39-3 | Summary Table for Debris Relocation to Cavity (CET Node VF)..... | 39-22 |
| 39A-1 | Core and Lower Internals Material Inventories in AP1000 Reactor Vessel | 39A-14 |
| 39A-2a | Mass and Power Distributions of Debris Layers in Top-Skewed Power Shape Case..... | 39A-15 |
| 39A-2b | Mass and Power Distributions of Debris Layers in Chopped Cosine Power Shape Case..... | 39A-16 |
| 39A-3a | Results of Top-Skewed Power Shape Case..... | 39A-17 |
| 39A-3b | Relocation Results of the Chopped Cosine Power Shape Case..... | 39A-18 |
| 39A-4 | Material Properties Used in In-Vessel Melting and Relocation Calculation | 39A-19 |
| 39A-5 | Debris Relocation Time Line | 39A-20 |
| 40-1 | Summary of Nodal Failure Probabilities | 40-6 |
| 40-2 | Nominal and Bounding Containment Failure Probability at 24 and 72 Hours..... | 40-6 |
| 41-1 | Containment Event Tree IG Nodal Failure Probability | 41-33 |
| 41-2 | Containment Event Tree Nodal Failure Probabilities..... | 41-33 |
| 41-3 | AP600 Scenario Dependencies for Early Detonation Analysis | 41-34 |
| 41-4 | Safety Margin Basis Containment Performance Requirement | 41-35 |
| 41A-1 | Summary of System Assumptions for AP1000 MAAP4.04 Hydrogen Analyses (Sheets 1 – 7) | 41A-2 |
| 41A-2 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-10 |
| 41A-3 | Summary of Early Compartment Gas Composition Results For MAAP4 Hydrogen Mixing Analyses..... | 41A-10 |
| 41A-4 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-11 |
| 41A-5 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-11 |
| 41A-6 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-7 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-12 |
| 41A-8 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-13 |
| 41A-9 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-14 |
| 41A-10 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-15 |
| 41A-11 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-15 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 41A-12 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-13 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-16 |
| 41A-14 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-17 |
| 41A-15 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-17 |
| 41A-16 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-18 |
| 41A-17 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-18 |
| 41A-18 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-19 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-19 |
| 41A-20 | Summary of Hydrogen Generation Results MAAP4 Hydrogen Mixing Analyses.... | 41A-20 |
| 41A-21 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-20 |
| 41A-22 | Summary of Early Compartment Gas Composition Results for MAAP4 Hydrogen Mixing Analyses..... | 41A-21 |
| 41A-23 | Sequence 1A-3a | 41A-22 |
| 41A-24 | Sequence 1A-4a | 41A-23 |
| 41A-25 | Sequence 1AP-3 | 41A-24 |
| 41A-26 | Sequence 1AP-4 | 41A-25 |
| 41A-27 | Sequence 3D-1 | 41A-26 |
| 41A-28 | Sequence 3D-2 | 41A-27 |
| 41A-29 | Sequence 3D-3 | 41A-28 |
| 41A-30 | Sequence 3D-5 | 41A-29 |
| 41A-31 | Sequence 3BL-1 | 41A-30 |
| 41A-32 | Sequence 3BL-2..... | 41A-31 |
| 41A-33 | Sequence 3C-1 | 41A-32 |
| 41A-34 | Sequence 3BR-1a..... | 41A-33 |
| 41A-35 | Sequence 3BE-1..... | 41A-34 |
| 41A-36 | Sequence 3BE-2..... | 41A-35 |
| 41A-37 | Sequence 3BE-4..... | 41A-36 |
| 41A-38 | Sequence 3BE-5..... | 41A-37 |
| 41A-39 | Sequence 3BE-6..... | 41A-38 |
| 41A-40 | Sequence 3BE-8..... | 41A-39 |
| 41A-41 | Sequence 3BE-9..... | 41A-40 |
| 42-1 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 400°F..... | 42-9 |
| 42-2 | Parameters Used in the Construction of the AP1000 Conditional Containment Failure Probability Distribution for Containment Temperature = 331°F..... | 42-9 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 42-3 | Cumulative Containment Failure Probability, Temperature = 400°F | 42-10 |
| 42-4 | Cumulative Containment Failure Probability, Temperature = 331°F | 42-11 |
| 43-1 | Accident Class Frequencies | 43-13 |
| 43-2 | Boolean Expressions to Calculate Q1-Q29 | 43-14 |
| 43-3 | CET Node Probabilities (Sheets 1 – 3) | 43-15 |
| 43-4 | Boolean Expressions for P1-P15 | 43-18 |
| 43-5 | Contribution of PDS to LRF (Sheets 1 – 3) | 43-19 |
| 43-6 | Dominant CET Sequences Contributing to LRF (Sheets 1 – 69)..... | 43-22 |
| 43-7 | Summary of Release Frequency Calculations (Sheets 1 – 2) | 43-91 |
| 43-8 | LRF and Containment Effectiveness by Accident Class | 43-93 |
| 43-9 | Summary of AP1000 LRF Quantification for Internal Events At-Power | 43-94 |
| 43-10 | CET Event Tree Node Importances | 43-95 |
| 43-11 | Contribution of Initiating Events to Large Release | 43-96 |
| 43-12 | LRF Sensitivity Case – Non Credit for Standby Non-Safety Systems (Sheets 1 – 9) | 43-97 |
| 43-13 | LRF Cutsets for the Case – Sensitivity to Standby Systems With Credit for Manual DAS (Sheets 1 – 13)..... | 43-106 |
| 43A-1 | AP1000 PRA Dominant CDF Sequences for At-Power Events (Sheets 1 – 6)..... | 43A-2 |
| 43A-2 | AP1000 PRA PDS Frequencies for At-Power Events..... | 43A-8 |
| 43B-1 | Calculation of Failure Probability of DP for PDS 6 (Sheets 1 – 7)..... | 43B-2 |
| 43C-1 | Evaluation of CET-Related Operator Actions | 43C-2 |
| 44-1 | MAAP Model Benchmarks (Sheets 1 – 4)..... | 44-8 |
| 45-1 | Environmental Release Fractions at 24 Hours After Core Damage Per Release Category..... | 45-5 |
| 45-2 | Environmental Release Fractions at 72 Hours After Core Damage Per Release Category..... | 45-6 |
| 49-1 | AP1000 Source Terms from Level 2 Analysis (MAAP)..... | 49-9 |
| 49-2 | AP1000 Source Terms for Dose Evaluation (MACCS2)..... | 49-10 |
| 49-3 | Site Boundary Whole Body Dose [Effective Dose Equivalent (EDE)], Sieverts | 49-11 |
| 49-4 | Site Boundary Thyroid Dose, Sieverts | 49-12 |
| 49-5 | Population Whole Body Dose [Effective Dose Equivalent (EDE)], 0-80.5 km Person-Sieverts | 49-13 |
| 49-6 | Site Boundary Red Marrow Dose (Total Acute), Sieverts..... | 49-14 |
| 49-7 | Dose Summary | 49-15 |
| 49-8 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 49-16 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 49-9 | Site Boundary Whole Body EDE Dose Risk – 72 Hours..... | 49-17 |
| 49-10 | Population Whole Body EDE Dose Risk – 24 Hours..... | 49-18 |
| 49-11 | Population Whole Body EDE Dose Risk – 72 Hours..... | 49-19 |
| 50-1 | Core Damage for At-Power Events Contribution of Initiating Events to Plant Core Damage Frequency..... | 50-16 |
| 50-2 | Core Damage for At-Power Events Conditional Core Damage Probability of Initiating Events..... | 50-17 |
| 50-3 | AP1000 PRA Core Damage for At-Power Events Accident Sequence Importances (Sheets 1 – 5)..... | 50-18 |
| 50-4 | Core Damage for At-Power Events End State Importances..... | 50-23 |
| 50-5 | Common Cause Importances – Risk Decrease (Sheets 1 – 2)..... | 50-24 |
| 50-6 | Common Cause Importances – Risk Increase (Sheets 1 – 3)..... | 50-26 |
| 50-7 | Human Error Risk Importances – Risk Decrease (Sheets 1 – 2)..... | 50-29 |
| 50-8 | Human Error Risk Importances – Risk Increase (Sheets 1 – 2)..... | 50-31 |
| 50-9 | Component Importances – Risk Decrease (Sheets 1 – 2)..... | 50-33 |
| 50-10 | Component Importances – Risk Increase (Sheets 1 – 4)..... | 50-35 |
| 50-11 | List of Systems for System Importance Analyses (Sheets 1 – 4)..... | 50-39 |
| 50-12 | System Importance Calculation Results (Sheets 1 – 2)..... | 50-43 |
| 50-13 | Systems Grouped by PRA System Importance..... | 50-45 |
| 50-14 | Operator Actions in “CMTOT.OUT” File..... | 50-46 |
| 50-15 | Contribution of IEVs to Core Damage Frequency..... | 50-47 |
| 50-16 | Case 29 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-48 |
| 50-17 | Case 30 – Top 50 Dominant Cutsets (Sheets 1 – 2)..... | 50-50 |
| 50-18 | Case 31 – Top 50 Dominant Cutsets (Sheets 1 – 3)..... | 50-52 |
| 50-19 | Passive System Check Valves in “CMTOT.OUT” File..... | 50-55 |
| 50-20 | Sensitivity Case 36 – Contribution of Initiating Events to CDF..... | 50-56 |
| 50-21 | Sensitivity Case 36 – Top 50 CDF Cutsets (Sheets 1 – 8)..... | 50-57 |
| 50-22 | Risk Importances Sorted by Basic Event Identification (Sheets 1 – 13)..... | 50-65 |
| 50-23 | Risk Importances Sorted by Risk Increase (Sheets 1 – 15)..... | 50-78 |
| 50-24 | Risk Importances Sorted by Risk Decrease (Sheets 1 – 15)..... | 50-93 |
| 50-25 | Risk Increases Sorted by Slope (Birnbaum) Importance (Sheets 1 – 13)..... | 50-108 |
| 51-1 | Summary of Results of AP1000 PRA Uncertainty Analysis for Internal Initiating Events at Power..... | 51-9 |
| 51-2 | List of Input Cutset Files..... | 51-10 |
| 51A-1 | Basic Event Uncertainties (Sheets 1 – 32)..... | 51A-3 |
| 54-1 | AP1000 Initiating Event Frequencies During Shutdown Conditions..... | 54-18 |
| 54-2 | AP1000 Design Impact on AP600 Shutdown Model..... | 54-19 |
| 54-3 | Times for Loss of RNS at Mid-loop Without IRWST Injection..... | 54-20 |
| 54-4 | AP1000 & AP600 Initiating Event CDF Contributions..... | 54-21 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 54-5 | AP600 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-22 |
| 54-6 | AP1000 Shutdown Level 1 PRA Top 200 Cutsets (Sheets 1 – 25)..... | 54-47 |
| 54-7 | Basic Event Probabilities Revised in Case 1 | 54-72 |
| 54-8 | Revised CCF Basic Event Probabilities (Sheets 1 – 2) | 54-73 |
| 54-9 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 1 | 54-75 |
| 54-9A | Dominant CDF Cutsets for Drained Conditions Only for AP1000 Shutdown PRA Sensitivity Case 1 (Sheets 1 – 24) | 54-76 |
| 54-10 | AP1000 Shutdown PRA Sensitivity Case 2 CDF Cutsets (Sheets 1 – 5)..... | 54-100 |
| 54-11 | List of Basic Events “Dropped” to Make the Sensitivity Case 2..... | 54-105 |
| 54-12 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 2 | 54-106 |
| 54-13 | Shutdown PRA Sensitivity Case 3 (Sheets 1 – 28) | 54-107 |
| 54-14 | Basic Events Whose Probabilities are Changed in Case 3 | 54-135 |
| 54-15 | AP1000 Shutdown PRA Sensitivity Case 4 CDF Cutsets (Sheets 1 – 7)..... | 54-136 |
| 54-16 | List of Basic Events “Dropped” to Make the Sensitivity Case 4..... | 54-143 |
| 54-17 | Contribution of Initiating Events to Plant CDF – Shutdown Sensitivity Case 4 | 54-144 |
| 54-18 | AP1000 Shutdown PRA Basic Event Risk Importances – RAW (Sheets 1 – 8)..... | 54-145 |
| 54-19 | AP1000 Shutdown PRA Basic Event Risk Importances – RRW (Sheets 1 – 3)..... | 54-153 |
| 54-20 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RAW (Sheets 1 – 4) | 54-156 |
| 54-21 | AP1000 Shutdown PRA Case 2 Basic Event Risk Importances – RRW (Sheets 1 – 2) | 54-160 |
| 55-1 | Seismic Margin HCLPF Values (Sheets 1 – 4) | 55-21 |
| 55-2 | Basic Event HCLPF Values (Sheets 1 – 3) | 55-25 |
| 55-3 | EQ-IEV-STRUC HCLPF | 55-28 |
| 55-4 | EQ-IEV-RVFA HCLPF | 55-28 |
| 55-5 | EQ-IEV-LLOCA HCLPF | 55-29 |
| 55-6 | EQ-IEV-SLOCA HCLPF..... | 55-29 |
| 55-7 | EQ-IEV-ATWS HCLPF | 55-29 |
| 56-1 | Flooding Analysis Initial Screening Results (Sheets 1 – 3)..... | 56-50 |
| 56-2 | At-Power Detailed Screening Results (Sheets 1 – 5) | 56-53 |
| 56-3 | At-Power Flooding-Induced Core Damage Frequency Quantification Summary Results (Sheets 1 – 6)..... | 56-58 |
| 56-4 | Power Upgrade Difference Between AP1000 and AP600 | 56-64 |
| 56-5 | Shutdown Flooding PRA | 56-65 |
| 56-6 | Shutdown Initiating Event CCDPs..... | 56-66 |
| 57-1 | AP1000 Fire Areas Excluding the Containment (Sheets 1 – 6) | 57-43 |
| 57-2 | AP1000 Fire Areas in the Containment (Sheets 1 – 2)..... | 57-49 |
| 57-3 | Fire Ignition Frequencies for AP1000 Fire Areas (Sheets 1 – 4) | 57-51 |
| 57-4 | Fire Ignition Frequencies for AP1000 Containment Fire Area | 57-58 |
| 57-5 | Fire Barrier Failure Probabilities..... | 57-61 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 57-6 | Automatic Suppression System Reliability | 57-62 |
| 57-7 | Summary of Qualitative Evaluation Results – Power Operation – Plant except Containment and Main Control Room (Sheets 1 – 15)..... | 57-63 |
| 57-8 | Summary of Qualitative Evaluation Results for Containment at Power Operation (Sheets 1 – 4)..... | 57-82 |
| 57-9 | Summary of Results (Sheets 1 – 5) | 57-88 |
| 57-10 | Distribution of Fire CDF Frequency by Three Major Plant Areas | 57-93 |
| 57-11 | Distribution of Fire CDF Frequency by Eight Plant Areas..... | 57-94 |
| 57-12 | Fire Areas Sorted by CDF (Sheets 1 – 5)..... | 57-95 |
| 57-13 | Fire Areas Sorted by CDF/FIEV (Sheets 1 – 5) | 57-100 |
| 57-14 | Credit for Manual Fire Suppression | 57-105 |
| 57-15 | Reduction of Hot Short Probability | 57-106 |
| 57-16 | Increase of Hot Short Probability | 57-107 |
| 57-17 | Sensitivity to Human Actions..... | 57-108 |
| 57-18 | Sensitivity to Fire Ignition Frequencies..... | 57-109 |
| 57-19 | Sensitivity to Actuation by DAS | 57-110 |
| 57-20 | Plant Fire CDF Without Hot Shorts | 57-111 |
| 57-21 | Contribution of the Plant Areas to CDF | 57-112 |
| 57-22 | Dominant Fire Scenarios (Sheets 1 – 4)..... | 57-113 |
| 57-23 | AP1000 Shutdown CCDPs | 57-117 |
| 57-24 | AP1000 Dominant Fire Sequences (Sheets 1 – 4)..... | 57-118 |
| 57-25 | Dominant Fire Scenarios from AP600 Shutdown Fire PRA | 57-122 |
| 57-26 | Summary of AP1000 Shutdown Fire Evaluation | 57-123 |
| 57-27 | Main Contributors for Shutdown Fire Risk..... | 57-124 |
| 57A-1 | Summary of Scenario CCDPs (Sheets 1 – 5) | 57A-7 |
| 57A-2 | AP1000 Base Case CCDPs for Initiating Events | 57A-12 |
| 57A-3 | DAS-ACT Fault Tree Cutsets Before Subtree Reduction | 57A-13 |
| 57A-4 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 10)..... | 57A-14 |
| 57A-5 | DAS-ACT Fault Tree Cutsets After Subtree Reduction (Sheets 1 – 9)..... | 57A-24 |
| 57A-6 | AP1000 Fire PRA Scenario CCDPs for Over-Conservative Cases (Sheets 1 – 3) | 57A-33 |
| 57C-1 | Data Used in Event Tree Scenario Frequency Calculations (Sheets 1 – 5) | 57C-2 |
| 57C-2 | CCDPs Used in Fire Event Trees (Sheets 1 – 5)..... | 57C-7 |
| 59-1 | Contribution of Initiating Events to Core Damage..... | 59-39 |
| 59-2 | Conditional Core Damage Probability of Initiating Events | 59-40 |
| 59-3 | Internal Initiating Events at Power Dominant Core Damage Sequences (Sheets 1 – 4) | 59-41 |
| 59-4 | Sequence 1 – Safety Injection Line Break Dominant Cutsets (SI-LB-07) (Sheets 1 – 3) | 59-45 |
| 59-5 | Sequence 2 – Large LOCA Dominant Cutsets (LLOCA-09)..... | 59-48 |

LIST OF TABLES (Cont.)

| <u>Table No.</u> | <u>Title</u> | <u>Page</u> |
|------------------|--|-------------|
| 59-6 | Sequence 3 – Spurious ADS Actuation Dominant Cutsets (SPADS-08) (Sheets 1 – 3) | 59-49 |
| 59-7 | Sequence 4 – Safety Injection Line Break Dominant Cutsets (SI-LB-08) (Sheets 1 – 3) | 59-52 |
| 59-8 | Sequence 5 – Reactor Vessel Rupture Cutset (RV-RP-02) | 59-55 |
| 59-9 | Sequence 6 – Small LOCA Dominant Cutsets (SLOCA-05) (Sheets 1 – 3) | 59-56 |
| 59-10 | Sequence 7 – Medium LOCA Dominant Cutsets (MLOCA-05) (Sheets 1 – 3) | 59-59 |
| 59-11 | Sequence 8 – Small LOCA Dominant Cutsets (SLOCA-12) (Sheets 1 – 3) | 59-62 |
| 59-12 | Sequence 9 – Medium LOCA Dominant Cutsets (MLOCA-12) (Sheets 1 – 3) | 59-65 |
| 59-13 | Sequence 10 – Spurious ADS Actuation Dominant Cutsets (SPADS-09) (Sheets 1 – 3) | 59-68 |
| 59-14 | Typical System Failure Probabilities, Showing Higher Reliabilities for Safety Systems | 59-71 |
| 59-15 | Summary of AP1000 PRA Results | 59-72 |
| 59-16 | Site Boundary Whole Body EDE Dose Risk – 24 Hours | 59-73 |
| 59-17 | Comparison of AP1000 PRA Results to Risk Goals | 59-74 |
| 59-18 | AP1000 PRA-Based Insights (Sheets 1 –24) | 59-75 |

LIST OF FIGURES

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 2-1 | Core Damage Logic Diagram for Internal Initiators (Sheets 1 – 4)..... | 2-47 |
| 4A-1 | Example Event Tree for Illustration of Terminology | 4A-19 |
| 4A-2 | Functional Event Tree | 4A-20 |
| 4A-3 | Illustration of A/B and A&B Notation | 4A-21 |
| 4A-4 | Illustration of Consequential Event and ATWS End States | 4A-22 |
| 4A-5 | AP1000 PRA Transients Template Event Tree (Sheets 1 – 3)..... | 4A-23 |
| 4A-6 | AP1000 PRA Small LOCA Template Event Tree (Sheets 1 – 2)..... | 4A-26 |
| 4B-1 | AP1000 Large LOCA Event Tree (Sheets 1 – 2)..... | 4B-2 |
| 4B-2 | AP1000 Large Spurious ADS Actuation Event Tree (Sheets 1 – 2)..... | 4B-4 |
| 4B-3 | AP1000 Medium LOCA Event Tree (Sheets 1 – 4)..... | 4B-6 |
| 4B-4 | AP1000 CMT Line Break Event Tree (Sheets 1 – 4)..... | 4B-10 |
| 4B-5 | AP1000 SI Line Break Event Tree (Sheets 1 – 3)..... | 4B-14 |
| 4B-6 | AP1000 Small LOCA Event Tree (Sheets 1 – 6)..... | 4B-17 |
| 4B-7 | AP1000 RCS Leak Event Tree | 4B-23 |
| 4B-8 | AP1000 Passive RHR Tube Rupture Event Tree..... | 4B-24 |
| 4B-9a | AP1000 Steam Generator Tube Rupture Event Tree (Sheets 1 – 3) | 4B-25 |
| 4B-9b | AP1000 SGTR Continues Event Tree (Sheets 1 – 6)..... | 4B-28 |
| 4B-10 | AP1000 Reactor Vessel Rupture Event Tree | 4B-34 |
| 4B-11 | AP1000 Interfacing Systems LOCA Event Tree..... | 4B-35 |
| 4B-12 | AP1000 Transients With Main Feedwater Event Tree (Sheets 1 – 4)..... | 4B-36 |
| 4B-13 | AP1000 Loss of Reactor Coolant Flow Event Tree (Sheets 1 – 4) | 4B-40 |
| 4B-14 | AP1000 Loss of Feedwater to One SG Tree (Sheets 1 – 4) | 4B-44 |
| 4B-15 | AP1000 Transients With Core Power Excursion Event Tree (Sheets 1 – 4)..... | 4B-48 |
| 4B-16 | AP1000 Transients With Loss of CCW/SW Event Tree (Sheets 1 – 4)..... | 4B-52 |
| 4B-17 | AP1000 Loss of MFW Event Tree (Sheets 1 – 4)..... | 4B-56 |
| 4B-18 | AP1000 Loss of Condenser Event Tree (Sheets 1 – 4) | 4B-60 |
| 4B-19 | AP1000 Loss of Main Compressed Air Event Tree (Sheets 1 – 4)..... | 4B-64 |
| 4B-20 | AP1000 Loss of Offsite Power Event Tree (Sheets 1 – 7) | 4B-68 |
| 4B-21 | Main Steam Line Break Downstream of MSIVs Event Tree (Sheets 1 – 5) | 4B-75 |
| 4B-22 | Main Steam Line Break Upstream of MSIVs Event Tree (Sheets 1 – 9) | 4B-80 |
| 4B-23 | Stuck Open Secondary Side Safety Valve Event Tree (Sheets 1 – 5) | 4B-89 |
| 4B-24a | ATWS Precursor Without Main Feedwater | 4B-94 |
| 4B-24b | AP1000 ATWS Precursor Without Main Feedwater Continues Event Tree (Sheets 1 – 6) | 4B-95 |
| 4B-25 | ATWS Precursor With SI (Sheets 1 – 6)..... | 4B-101 |
| 4B-26 | ATWS Precursor With MFW (Sheets 1 – 4)..... | 4B-107 |
| 7-1 | Power/Control Model for Large Loads (6900-vac/480-vac Pumps, Fans, and Motors)..... | 7-33 |
| 7-2 | Power/Control Model for Motor-Operated Valves..... | 7-35 |
| 7-3 | Power/Control Model for Air-Operated Valves | 7-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 7-4 | Power/Control Model for Variable Speed Motor | 7-39 |
| 7-5 | An Illustration of Fault Tree Basic Events for a Pump Following the Model Given in Figure 7-1 | 7-41 |
| 8-1 | PRHR – Simplified Piping and Instrumentation Diagram..... | 8-23 |
| 8-2 | PRHR – Simplified Valve Control Diagram | 8-25 |
| 9-1 | Passive Core Cooling System Simplified Sketch | 9-24 |
| 9-2 | Passive Core Cooling System Piping and Instrumentation Diagram | 9-25 |
| 10-1 | Passive Core Cooling System – Accumulator Subsystem | 10-12 |
| 11-1 | Automatic Depressurization System Simplified Piping and Instrumentation Diagram..... | 11-49 |
| 12-1 | Simplified Piping & Instrumentation Diagram of the IRWST/Gravity Injection Subsystem..... | 12-42 |
| 13-1 | Passive Containment Cooling System Sketch | 13-11 |
| 15-1 | Chemical and Volume Control System Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 15-25 |
| 17-1 | Normal Residual Heat Removal System Sketch..... | 17-19 |
| 18-1 | Component Cooling Water System Piping and Instrumentation Diagram | 18-13 |
| 19-1 | Service Water System Piping and Instrumentation Diagram..... | 19-17 |
| 20-1 | Central Chilled Water Low-Capacity Subsystem Piping and Instrumentation Diagram (Sheets 1 – 2)..... | 20-11 |
| 21-1 | AC Power System One-Line Diagram | 21-55 |
| 22-1 | Class 1E DC System One-Line Diagram (Sheets 1 – 2)..... | 22-53 |
| 22-2 | Class 1E UPS One-Line Diagram | 22-57 |
| 25-1 | Compressed & Instrument Air System Piping and Instrumentation Diagram | 25-19 |
| 29-1 | IRWST Valve Configuration..... | 29-25 |
| 30-1 | Human Reliability Analysis Quantification Model | 30-111 |
| 30A-1 | Links Between SHARP Steps | 30A-18 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-1 | Case 3BE-1: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Containment Water Level..... | 34-52 |
| 34-2 | Case 3BE-1: ADS Stage 4 Flow Rates DVI Line Break, Containment Water Level..... | 34-52 |
| 34-3 | Case 3BE-1: Accumulator/CMT Water Mass DVI Line Break, Containment Water Level | 34-53 |
| 34-4 | Case 3BE-1: IRWST Injection Flow Rate DVI Line Break, Containment Water Level | 34-53 |
| 34-5 | Case 3BE-1: Break Flow Rate DVI Line Break, Containment Water Level..... | 34-54 |
| 34-6 | Case 3BE-1: Reactor Vessel Water Level DVI Line Break, Containment Water Level | 34-54 |
| 34-7 | Case 3BE-1: Core Temperatures DVI Line Break, Containment Water Level..... | 34-55 |
| 34-8 | Case 3BE-1: Containment Water Pool Elevations DVI Line Break, Containment Water Level | 34-55 |
| 34-9 | Case 3BE-1: Containment Pressure DVI Line Break, Containment Water Level..... | 34-56 |
| 34-10 | Case 3BE-1: Containment Gas Temperatures DVI Line Break, Containment Water Level | 34-56 |
| 34-11 | Case 3BE-1: Core Mass DVI Line Break, Containment Water Level..... | 34-57 |
| 34-12 | Case 3BE-1: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Containment Water Level..... | 34-57 |
| 34-13 | Case 3BE-1: In-Vessel Hydrogen Generation DVI Line Break, Containment Water Level | 34-58 |
| 34-14 | Case 3BE-1: Mass Fraction of CsI Released to Containment DVI Line Break, Containment Water Level..... | 34-58 |
| 34-15 | Case 3BE-1: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-16 | Case 3BE-1: Mass Fraction of Fission Products Released to Environment DVI Line Break, Containment Water Level..... | 34-59 |
| 34-17 | Case 3BE-1: Mass Fraction of SrO Released to Environment DVI Line Break, Containment Water Level..... | 34-60 |
| 34-18 | Case 3BE-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-60 |
| 34-19 | Case 3BE-2: ADS Stage 4 Flow Rates DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-20 | Case 3BE-2: Accumulator/CMT Water Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-61 |
| 34-21 | Case 3BE-2: IRWST Injection Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |
| 34-22 | Case 3BE-2: Break Flow Rate DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-62 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-23 | Case 3BE-2: Reactor Vessel Water Level DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-24 | Case 3BE-2: Core Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-63 |
| 34-25 | Case 3BE-2: Containment Water Pool Elevations DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-26 | Case 3BE-2: Containment Pressure DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-64 |
| 34-27 | Case 3BE-2: Containment Gas Temperatures DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-28 | Case 3BE-2: Core Mass DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-65 |
| 34-29 | Case 3BE-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-66 |
| 34-30 | Case 3BE-2: In-Vessel Hydrogen Generation DVI Line Break, Fail Gravity Injection, No DVI Flooding | 34-66 |
| 34-31 | Case 3BE-2: Mass Fraction of CsI Released to Containment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-32 | Case 3BE-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-67 |
| 34-33 | Case 3BE-2: Mass Fraction of Fission Products Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-34 | Case 3BE-2: Mass Fraction of SrO Released to Environment DVI Line Break, Fail Gravity Injection, No DVI Flooding..... | 34-68 |
| 34-35 | Case 3BE-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS, Failed Gravity Injection..... | 34-69 |
| 34-36 | Case 3BE-4: ADS Stage 4 Flow Rates Spurious ADS, Failed Gravity Injection | 34-69 |
| 34-37 | Case 3BE-4: Accumulator/CMT Water Mass Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-38 | Case 3BE-4: IRWST Injection Flow Rate Spurious ADS, Failed Gravity Injection | 34-70 |
| 34-39 | Case 3BE-4: Break Flow Rate Spurious ADS, Failed Gravity Injection..... | 34-71 |
| 34-40 | Case 3BE-4: Reactor Vessel Water Level Spurious ADS, Failed Gravity Injection | 34-71 |
| 34-41 | Case 3BE-4: Core Temperatures Spurious ADS, Failed Gravity Injection | 34-72 |
| 34-42 | Case 3BE-4: Containment Water Pool Elevations Spurious ADS, Failed Gravity Injection..... | 34-72 |
| 34-43 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection | 34-73 |
| 34-44 | Case 3BE-4: Containment Gas Temperatures Spurious ADS, Failed Gravity Injection..... | 34-73 |
| 34-45 | Case 3BE-4: Core Mass Spurious ADS, Failed Gravity Injection | 34-74 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-46 | Case 3BE-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS, Failed Gravity Injection..... | 34-74 |
| 34-47 | Case 3BE-4: In-Vessel Hydrogen Generation Spurious ADS, Failed Gravity Injection | 34-75 |
| 34-48 | Case 3BE-4: Mass Fraction of CsI Released to Containment Spurious ADS, Failed Gravity Injection..... | 34-75 |
| 34-49 | Case 3BE-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-50 | Case 3BE-4: Mass Fraction of Fission Products Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-76 |
| 34-51 | Case 3BE-4: Mass Fraction of SrO Released to Environment Spurious ADS, Failed Gravity Injection..... | 34-77 |
| 34-52 | Case 3BE-5: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection | 34-77 |
| 34-53 | Case 3BE-5: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-78 |
| 34-54 | Case 3BE-5: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-78 |
| 34-55 | Case 3BE-5: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-56 | Case 3BE-5: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-79 |
| 34-57 | Case 3BE-5: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-80 |
| 34-58 | Case 3BE-5: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-80 |
| 34-59 | Case 3BE-5: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-81 |
| 34-60 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 34-81 |
| 34-61 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-82 |
| 34-62 | Case 3BE-5: Core Mass SBLOCA with Failed Gravity Injection..... | 34-82 |
| 34-63 | Case 3BE-5: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-83 |
| 34-64 | Case 3BE-5: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-83 |
| 34-65 | Case 3BE-5: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-84 |
| 34-66 | Case 3BE-5: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-84 |
| 34-67 | Case 3BE-5: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |
| 34-68 | Case 3BE-5: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-85 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-69 | Case 3BE-6: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-86 |
| 34-70 | Case 3BE-6: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-86 |
| 34-71 | Case 3BE-6: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-87 |
| 34-72 | Case 3BE-6: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-87 |
| 34-73 | Case 3BE-6: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-88 |
| 34-74 | Case 3BE-6: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-88 |
| 34-75 | Case 3BE-6: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-76 | Case 3BE-6: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-89 |
| 34-77 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection | 34-90 |
| 34-78 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-90 |
| 34-79 | Case 3BE-6: Core Mass SBLOCA with Failed Gravity Injection..... | 34-91 |
| 34-80 | Case 3BE-6: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection | 34-91 |
| 34-81 | Case 3BE-6: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-92 |
| 34-82 | Case 3BE-6: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-92 |
| 34-83 | Case 3BE-6: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection | 34-93 |
| 34-84 | Case 3BE-6: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection | 34-93 |
| 34-85 | Case 3BE-6: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-94 |
| 34-86 | Case 3BE-7: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection | 34-94 |
| 34-87 | Case 3BE-7: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection | 34-95 |
| 34-88 | Case 3BE-7: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection | 34-95 |
| 34-89 | Case 3BE-7: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection | 34-96 |
| 34-90 | Case 3BE-7: Break Flow Rate SBLOCA with Failed Gravity Injection | 34-96 |
| 34-91 | Case 3BE-7: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection | 34-97 |
| 34-92 | Case 3BE-7: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-97 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-93 | Case 3BE-7: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-98 |
| 34-94 | Case 3BE-7: Containment Pressure SBLOCA with Failed Gravity Injection | 34-98 |
| 34-95 | Case 3BE-7: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 34-99 |
| 34-96 | Case 3BE-7: Core Mass SBLOCA with Failed Gravity Injection..... | 34-99 |
| 34-97 | Case 3BE-7: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-100 |
| 34-98 | Case 3BE-7: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection | 34-100 |
| 34-99 | Case 3BE-7: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-101 |
| 34-100 | Case 3BE-7: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-101 |
| 34-101 | Case 3BE-7: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-102 | Case 3BE-7: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-102 |
| 34-103 | Case 3BE-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-103 |
| 34-104 | Case 3BE-3: ADS Stage 4 Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-103 |
| 34-105 | Case 3BE-3: Accumulator/CMT Water Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-106 | Case 3BE-3: IRWST Injection Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-104 |
| 34-107 | Case 3BE-3: Break Flow Rate DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-105 |
| 34-108 | Case 3BE-3: Reactor Vessel Water Level DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-105 |
| 34-109 | Case 3BE-3: Core Temperatures DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-106 |
| 34-110 | Case 3BE-3: Containment Water Pool Elevations DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-106 |
| 34-111 | Case 3BE-3: Containment Pressure DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-107 |
| 34-112 | Case 3BE-3: Containment Gas Temperature DVI Line Break, Failed Gravity Injection, No PXS Flooding | 34-107 |
| 34-113 | Case 3BE-3: Core Mass DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |
| 34-114 | Case 3BE-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-108 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-115 | Case 3BE-3: In-Vessel Hydrogen Generation DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-109 |
| 34-116 | Case 3BE-3: Mass Fraction of CsI Released to Containment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-109 |
| 34-117 | Case 3BE-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-110 |
| 34-118 | Case 3BE-3: Mass Fraction of Fission Products Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-110 |
| 34-119 | Case 3BE-3: Mass Fraction of SrO Released to Environment DVI Line Break, Failed Gravity Injection, No PXS Flooding..... | 34-111 |
| 34-120 | Case 3BL-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with Failed Gravity Injection..... | 34-111 |
| 34-121 | Case 3BL-1: ADS Stage 4 Flow Rates SBLOCA with Failed Gravity Injection..... | 34-112 |
| 34-122 | Case 3BL-1: Accumulator/CMT Water Mass SBLOCA with Failed Gravity Injection..... | 34-112 |
| 34-123 | Case 3BL-1: IRWST Injection Flow Rate SBLOCA with Failed Gravity Injection..... | 34-113 |
| 34-124 | Case 3BL-1: Break Flow Rate SBLOCA with Failed Gravity Injection..... | 34-113 |
| 34-125 | Case 3BL-1: Reactor Vessel Water Level SBLOCA with Failed Gravity Injection..... | 34-114 |
| 34-126 | Case 3BL-1: Core Temperatures SBLOCA with Failed Gravity Injection..... | 34-114 |
| 34-127 | Case 3BL-1: Containment Water Pool Elevations SBLOCA with Failed Gravity Injection..... | 34-115 |
| 34-128 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Injection..... | 34-115 |
| 34-129 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Injection..... | 34-116 |
| 34-130 | Case 3BL-1: Core Mass SBLOCA with Failed Gravity Injection..... | 34-116 |
| 34-131 | Case 3BL-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with Failed Gravity Injection..... | 34-117 |
| 34-132 | Case 3BL-1: In-Vessel Hydrogen Generation SBLOCA with Failed Gravity Injection..... | 34-117 |
| 34-133 | Case 3BL-1: Mass Fraction of CsI Released to Containment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-134 | Case 3BL-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with Failed Gravity Injection..... | 34-118 |
| 34-135 | Case 3BL-1: Mass Fraction of Fission Products Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-136 | Case 3BL-1: Mass Fraction of SrO Released to Environment SBLOCA with Failed Gravity Injection..... | 34-119 |
| 34-137 | Case 3BL-2: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed Gravity Injection..... | 34-120 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-138 | Case 3BL-2: ADS Stage 4 Flow Rates DVI Line Break with Failed Gravity Injection | 34-120 |
| 34-139 | Case 3BL-2: Accumulator/CMT Water Mass DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-140 | Case 3BL-2: IRWST Injection Flow Rate DVI Line Break with Failed Gravity Injection..... | 34-121 |
| 34-141 | Case 3BL-2: Break Flow Rate DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-142 | Case 3BL-2: Reactor Vessel Water Level DVI Line Break with Failed Gravity Injection | 34-122 |
| 34-143 | Case 3BL-2: Core Temperatures DVI Line Break with Failed Gravity Injection | 34-123 |
| 34-144 | Case 3BL-2: Containment Water Pool Elevations DVI Line Break with Failed Gravity Injection..... | 34-123 |
| 34-145 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Injection | 34-124 |
| 34-146 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection..... | 34-124 |
| 34-147 | Case 3BL-2: Core Mass DVI Line Break with Failed Gravity Injection | 34-125 |
| 34-148 | Case 3BL-2: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed Gravity Injection..... | 34-125 |
| 34-149 | Case 3BL-2: In-Vessel Hydrogen Generation DVI Line Break with Failed Gravity Injection..... | 34-126 |
| 34-150 | Case 3BL-2: Mass Fraction of CsI Released to Containment DVI Line Break with Failed Gravity Injection | 34-126 |
| 34-151 | Case 3BL-2: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-152 | Case 3BL-2: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed Gravity Injection | 34-127 |
| 34-153 | Case 3BL-2: Mass Fraction of SrO Released to Environment DVI Line Break with Failed Gravity Injection | 34-128 |
| 34-154 | Case 3BR-1: Reactor Coolant System and Steam Generator Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-128 |
| 34-155 | Case 3BR-1: ADS Stage 4 Flow Rates CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-156 | Case 3BR-1: Accumulator/CMT Water Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-129 |
| 34-157 | Case 3BR-1: IRWST Injection Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-130 |
| 34-158 | Case 3BR-1: Break Flow Rate CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-130 |
| 34-159 | Case 3BR-1: Reactor Vessel Water Level CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-160 | Case 3BR-1: Core Temperatures CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-131 |
| 34-161 | Case 3BR-1: Containment Water Pool Elevations CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-132 |
| 34-162 | Case 3BR-1: Containment Pressure CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-132 |
| 34-163 | Case 3BR-1: Containment Gas Temperature CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-133 |
| 34-164 | Case 3BR-1: Core Mass CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-133 |
| 34-165 | Case 3BR-1: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-166 | Case 3BR-1: In-Vessel Hydrogen Generation CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-134 |
| 34-167 | Case 3BR-1: Mass Fraction of CsI Released to Containment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-168 | Case 3BR-1: Mass Fraction of Noble Gases Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-135 |
| 34-169 | Case 3BR-1: Mass Fraction of Fission Products Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines..... | 34-136 |
| 34-170 | Case 3BR-1: Mass Fraction of SrO Released to Environment CL LBLOCA to Loop Compartment 2/2 Gravity Injection/Recirculation Lines | 34-136 |
| 34-171 | Case 3BR-1a: Reactor Coolant System and Steam Generator Pressure CL LBLOCA with Failed Accumulators..... | 34-137 |
| 34-172 | Case 3BR-1a: ADS Stage 4 Flow Rates CL LBLOCA with Failed Accumulators | 34-137 |
| 34-173 | Case 3BR-1a: Accumulator/CMT Water Mass CL LBLOCA with Failed Accumulators | 34-138 |
| 34-174 | Case 3BR-1a: IRWST Injection Flow Rate CL LBLOCA with Failed Accumulators | 34-138 |
| 34-175 | Case 3BR-1a: Break Flow Rate CL LBLOCA with Failed Accumulators..... | 34-139 |
| 34-176 | Case 3BR-1a: Reactor Vessel Water Level CL LBLOCA with Failed Accumulators | 34-139 |
| 34-177 | Case 3BR-1a: Core Temperatures CL LBLOCA with Failed Accumulators | 34-140 |
| 34-178 | Case 3BR-1a: Containment Water Pool Elevations CL LBLOCA with Failed Accumulators | 34-140 |
| 34-179 | Case 3BR-1a: Containment Pressure CL LBLOCA with Failed Accumulators | 34-141 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-180 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Failed Accumulators | 34-141 |
| 34-181 | Case 3BR-1a: Core Mass CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-182 | Case 3BR-1a: Reactor Pressure Vessel to Cavity Water Heat Transfer CL LBLOCA with Failed Accumulators..... | 34-142 |
| 34-183 | Case 3BR-1a: In-Vessel Hydrogen Generation CL LBLOCA with Failed Accumulators | 34-143 |
| 34-184 | Case 3BR-1a: Mass Fraction of CsI Released to Containment CL LBLOCA with Failed Accumulators..... | 34-143 |
| 34-185 | Case 3BR-1a: Mass Fraction of Noble Gases Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-186 | Case 3BR-1a: Mass Fraction of Fission Products Released to Environment CL LBLOCA with Failed Accumulators..... | 34-144 |
| 34-187 | Case 3BR-1a: Mass Fraction of SrO Released to Environment CL LBLOCA with Failed Accumulators | 34-145 |
| 34-188 | Case 3C-1: Reactor Coolant System and Steam Generator Pressure Vessel Rupture | 34-145 |
| 34-189 | Case 3C-1: ADS Stage 4 Flow Rates Vessel Rupture | 34-146 |
| 34-190 | Case 3C-1: Accumulator/CMT Water Mass Vessel Rupture | 34-146 |
| 34-191 | Case 3C-1: IRWST Injection Flow Rate Vessel Rupture..... | 34-147 |
| 34-192 | Case 3C-1: Break Flow Rate Vessel Rupture..... | 34-147 |
| 34-193 | Case 3C-1: Reactor Vessel Water Level Vessel Rupture | 34-148 |
| 34-194 | Case 3C-1: Core Temperatures Vessel Rupture | 34-148 |
| 34-195 | Case 3C-1: Containment Water Pool Elevations Vessel Rupture..... | 34-149 |
| 34-196 | Case 3C-1: Containment Pressure Vessel Rupture..... | 34-149 |
| 34-197 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 34-150 |
| 34-198 | Case 3C-1: Core Mass Vessel Rupture | 34-150 |
| 34-199 | Case 3C-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture | 34-151 |
| 34-200 | Case 3C-1: In-Vessel Hydrogen Generation Vessel Rupture | 34-151 |
| 34-201 | Case 3C-1: Mass Fraction of CsI Released to Containment Vessel Rupture..... | 34-152 |
| 34-202 | Case 3C-1: Mass Fraction of Noble Gas Released to Environment Vessel Rupture..... | 34-152 |
| 34-203 | Case 3C-1: Mass Fraction of Fission Products Released to Environment Vessel Rupture | 34-153 |
| 34-204 | Case 3C-1: Mass Fraction of SrO Released to Environment Vessel Rupture | 34-153 |
| 34-205 | Case 3C-2: Reactor Coolant System and Steam Generator Pressure Vessel Rupture with Containment Failure..... | 34-154 |
| 34-206 | Case 3C-2: ADS Stage 4 Flow Rates Vessel Rupture with Containment Failure | 34-154 |
| 34-207 | Case 3C-2: Accumulator/CMT Water Mass Vessel Rupture with Containment Failure..... | 34-155 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-208 | Case 3C-2: IRWST Injection Flow Rate Vessel Rupture with Containment Failure..... | 34-155 |
| 34-209 | Case 3C-2: Break Flow Rate Vessel Rupture with Containment Failure | 34-156 |
| 34-210 | Case 3C-2: Reactor Vessel Water Level Vessel Rupture with Containment Failure..... | 34-156 |
| 34-211 | Case 3C-2: Core Temperatures Vessel Rupture with Containment Failure..... | 34-157 |
| 34-212 | Case 3C-2: Containment Water Pool Elevations Vessel Rupture with Containment Failure..... | 34-157 |
| 34-213 | Case 3C-2: Containment Pressure Vessel Rupture with Containment Failure | 34-158 |
| 34-214 | Case 3C-2: Containment Gas Temperature Vessel Rupture with Containment Failure..... | 34-158 |
| 34-215 | Case 3C-2: Core Mass Vessel Rupture with Containment Failure..... | 34-159 |
| 34-216 | Case 3C-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Vessel Rupture with Containment Failure..... | 34-159 |
| 34-217 | Case 3C-2: In-Vessel Hydrogen Generation Vessel Rupture with Containment Failure..... | 34-160 |
| 34-218 | Case 3C-2: Mass Fraction of CsI Released to Containment Vessel Rupture with Containment Failure | 34-160 |
| 34-219 | Case 3C-2: Mass Fraction of Noble Gases Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-220 | Case 3C-2: Mass Fraction of Fission Products Released to Environment Vessel Rupture with Containment Failure..... | 34-161 |
| 34-221 | Case 3C-2: Mass Fraction of SrO Released to Environment Vessel Rupture with Containment Failure | 34-162 |
| 34-222 | Case 3D-1: Reactor Coolant System and Steam Generator Pressure Spurious ADS-4 with Failed CMTs..... | 34-162 |
| 34-223 | Case 3D-1: ADS Stage 4 Flow Rates Spurious ADS-4 with Failed CMTs..... | 34-163 |
| 34-224 | Case 3D-1: Accumulator/CMT Water Mass Spurious ADS-4 with Failed CMTs | 34-163 |
| 34-225 | Case 3D-1: IRWST Injection Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-226 | Case 3D-1: Break Flow Rate Spurious ADS-4 with Failed CMTs | 34-164 |
| 34-227 | Case 3D-1: Reactor Vessel Water Level Spurious ADS-4 with Failed CMTs | 34-165 |
| 34-228 | Case 3D-1: Core Temperatures Spurious ADS-4 with Failed CMTs..... | 34-165 |
| 34-229 | Case 3D-1: Containment Water Pool Elevations Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-230 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs | 34-166 |
| 34-231 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs | 34-167 |
| 34-232 | Case 3D-1: Core Mass Spurious ADS-4 with Failed CMTs | 34-167 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-233 | Case 3D-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-4 with Failed CMTs | 34-168 |
| 34-234 | Case 3D-1: In-Vessel Hydrogen Generation Spurious ADS-4 with Failed CMTs | 34-168 |
| 34-235 | Case 3D-1: Mass Fraction of CsI Released to Containment Spurious ADS-4 with Failed CMTs | 34-169 |
| 34-236 | Case 3D-1: Mass Fraction of Noble Gases Released to Environment Spurious ADS-4 with Failed CMTs | 34-169 |
| 34-237 | Case 3D-1: Mass Fraction of Fission Products Released to Environment Spurious ADS-4 with Failed CMTs | 34-170 |
| 34-238 | Case 3D-1: Mass Fraction of SrO Released to Environment Spurious ADS-4 with Failed CMTs | 34-170 |
| 34-239 | Case 3D-2: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2 with Failed CMTs | 34-171 |
| 34-240 | Case 3D-2: ADS Stage 4 Flow Rates Spurious ADS-2 with Failed CMTs..... | 34-171 |
| 34-241 | Case 3D-2: Accumulator/CMT Water Mass Spurious ADS-2 with Failed CMTs | 34-172 |
| 34-242 | Case 3D-2: IRWST Injection Flow Rate Spurious ADS-2 with Failed CMTs..... | 34-172 |
| 34-243 | Case 3D-2: Break Flow Rate Spurious ADS-2 with Failed CMTs | 34-173 |
| 34-244 | Case 3D-2: Reactor Vessel Water Level Spurious ADS-2 with Failed CMTs..... | 34-173 |
| 34-245 | Case 3D-2: Core Temperatures Spurious ADS-2 with Failed CMTs..... | 34-174 |
| 34-246 | Case 3D-2: Containment Pool Water Elevations Spurious ADS-2 with Failed CMTs | 34-174 |
| 34-247 | Case 3D-2: Containment Pressure Spurious ADS-2 with Failed CMTs | 34-175 |
| 34-248 | Case 3D-2: Containment Gas Temperature Spurious ADS-2 with Failed CMTs | 34-175 |
| 34-249 | Case 3D-2: Core Mass Spurious ADS-2 with Failed CMTs | 34-176 |
| 34-250 | Case 3D-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2 with Failed CMTs | 34-176 |
| 34-251 | Case 3D-2: In-Vessel Hydrogen Generation Spurious ADS-2 with Failed CMTs | 34-177 |
| 34-252 | Case 3D-2: Mass Fraction of CsI Released to Containment Spurious ADS-2 with Failed CMTs | 34-177 |
| 34-253 | Case 3D-2: Mass Fraction of Noble Gas Released to Environment Spurious ADS-2 with Failed CMTs | 34-178 |
| 34-254 | Case 3D-2: Mass Fraction of Fission Products Released to Environment Spurious ADS-2 with Failed CMTs | 34-178 |
| 34-255 | Case 3D-2: Mass Fraction of SrO Released to Environment Spurious ADS-2 with Failed CMTs | 34-179 |
| 34-256 | Case 3D-3: Reactor Coolant System and Steam Generator Pressure DVI Line Break with Failed ADS..... | 34-179 |
| 34-257 | Case 3D-3: ADS Stage 4 Flow Rates DVI Line Break with Failed ADS..... | 34-180 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-258 | Case 3D-3: Accumulator/CMT Water Mass DVI Line Break with Failed ADS..... | 34-180 |
| 34-259 | Case 3D-3: IRWST Injection Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-260 | Case 3D-3: Break Flow Rate DVI Line Break with Failed ADS | 34-181 |
| 34-261 | Case 3D-3: Reactor Vessel Water Level DVI Line Break with Failed ADS..... | 34-182 |
| 34-262 | Case 3D-3: Core Temperatures DVI Line Break with Failed ADS..... | 34-182 |
| 34-263 | Case 3D-3: Containment Water Pool Elevations DVI Line Break with Failed ADS..... | 34-183 |
| 34-264 | Case 3D-3: Containment Pressure DVI Line Break with Failed ADS | 34-183 |
| 34-265 | Case 3D-3: Containment Gas Temperature DVI Line Break with Failed ADS | 34-184 |
| 34-266 | Case 3D-3: Core Mass DVI Line Break with Failed ADS | 34-184 |
| 34-267 | Case 3D-3: Reactor Pressure Vessel to Cavity Water Heat Transfer DVI Line Break with Failed ADS..... | 34-185 |
| 34-268 | Case 3D-3: In-Vessel Hydrogen Generation DVI Line Break with Failed ADS..... | 34-185 |
| 34-269 | Case 3D-3: Mass Fraction of CsI Released to Containment DVI Line Break with Failed ADS | 34-186 |
| 34-270 | Case 3D-3: Mass Fraction of Noble Gases Released to Environment DVI Line Break with Failed ADS | 34-186 |
| 34-271 | Case 3D-3: Mass Fraction of Fission Products Released to Environment DVI Line Break with Failed ADS..... | 34-187 |
| 34-272 | Case 3D-3: Mass Fraction of SrO Released to Environment DVI Line Break with Failed ADS..... | 34-187 |
| 34-273 | Case 3D-4: Reactor Coolant System and Steam Generator Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-274 | Case 3D-4: ADS Stage 4 Flow Rates Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-188 |
| 34-275 | Case 3D-4: Accumulator/CMT Water Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-276 | Case 3D-4: IRWST Injection Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-189 |
| 34-277 | Case 3D-4: Break Flow Rate Spurious ADS-2, Failed CMTs, Diffusion Flame..... | 34-190 |
| 34-278 | Case 3D-4: Reactor Vessel Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-190 |
| 34-279 | Case 3D-4: Core Temperatures Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-280 | Case 3D-4: Containment Water Pool Elevations Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-191 |
| 34-281 | Case 3D-4: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-282 | Case 3D-4: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-192 |
| 34-283 | Case 3D-4: Core Mass Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-284 | Case 3D-4: Reactor Pressure Vessel to Cavity Water Heat Transfer Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-193 |
| 34-285 | Case 3D-4: In-Vessel Hydrogen Generation Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-286 | Case 3D-4: Mass Fraction of CsI Released to Containment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-194 |
| 34-287 | Case 3D-4: Mass Fraction of Noble Gases Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-288 | Case 3D-4: Mass Fraction of Fission Products Released to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-195 |
| 34-289 | Case 3D-4: Mass Fraction of SrO Release to Environment Spurious ADS-2, Failed CMTs, Diffusion Flame | 34-196 |
| 34-290 | Case 6E-1: Reactor Coolant System and Steam Generator Pressure SGTR Early Core Melt..... | 34-196 |
| 34-291 | Case 6E-1: ADS Stage 4 Flow Rates SGTR Early Core Melt..... | 34-197 |
| 34-292 | Case 6E-1: Accumulator/CMT Water Mass SGTR Early Core Melt..... | 34-197 |
| 34-293 | Case 6E-1: IRWST Injection Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-294 | Case 6E-1: Break Flow Rate SGTR Early Core Melt..... | 34-198 |
| 34-295 | Case 6E-1: Reactor Vessel Water Level SGTR Early Core Melt..... | 34-199 |
| 34-296 | Case 6E-1: Core Temperatures SGTR Early Core Melt..... | 34-199 |
| 34-297 | Case 6E-1: Containment Water Pool Elevations SGTR Early Core Melt | 34-200 |
| 34-298 | Case 6E-1: Containment Pressure SGTR Early Core Melt | 34-200 |
| 34-299 | Case 6E-1: Containment Gas Temperature SGTR Early Core Melt..... | 34-201 |
| 34-300 | Case 6E-1: Core Mass SGTR Early Core Melt | 34-201 |
| 34-301 | Case 6E-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Early Core Melt..... | 34-202 |
| 34-302 | Case 6E-1: In-Vessel Hydrogen Generation SGTR Early Core Melt..... | 34-202 |
| 34-303 | Case 6E-1: Mass Fraction of CsI Released to Containment SGTR Early Core Melt | 34-203 |
| 34-304 | Case 6E-1: Mass Fraction of Noble Gases Released to Environment SGTR Early Core Melt..... | 34-203 |
| 34-305 | Case 6E-1: Mass Fraction of Fission Products Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-306 | Case 6E-1: Mass Fraction of SrO Released to Environment SGTR Early Core Melt..... | 34-204 |
| 34-307 | Case 6L-1: Reactor Coolant System and Steam Generator Pressure SGTR Core Melt Failure at Recirculation..... | 34-205 |
| 34-308 | Case 6L-1: ADS Stage 4 Flow Rates SGTR Core Melt Failure at Recirculation | 34-205 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-309 | Case 6L-1: Accumulator/CMT Water Mass SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-310 | Case 6L-1: IRWST Injection Flow Rate SGTR Core Melt Failure at Recirculation | 34-206 |
| 34-311 | Case 6L-1: Break Flow Rate SGTR Core Melt Failure at Recirculation..... | 34-207 |
| 34-312 | Case 6L-1: Reactor Vessel Water Level SGTR Core Melt Failure at Recirculation | 34-207 |
| 34-313 | Case 6L-1: Core Temperatures SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-314 | Case 6L-1: Containment Water Pool Elevations SGTR Core Melt Failure at Recirculation | 34-208 |
| 34-315 | Case 6L-1: Containment Pressure SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-316 | Case 6L-1: Containment Gas Temperature SGTR Core Melt Failure at Recirculation | 34-209 |
| 34-317 | Case 6L-1: Core Mass SGTR Core Melt Failure at Recirculation..... | 34-210 |
| 34-318 | Case 6L-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SGTR Core Melt Failure at Recirculation..... | 34-210 |
| 34-319 | Case 6L-1: In-Vessel Hydrogen Generation SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-320 | Case 6L-1: Mass Fraction of CsI Released to Containment SGTR Core Melt Failure at Recirculation | 34-211 |
| 34-321 | Case 6L-1: Mass Fraction of Noble Gases Released to Environment SGTR Core Melt Failure at Recirculation..... | 34-212 |
| 34-322 | Case 6L-1: Mass Fraction of Fission Products Released to Environment SGTR Core Melt Failure at Recirculation | 34-212 |
| 34-323 | Case 6L-1: Mass Fraction of SrO Released to Environment SGTR Core Melt Failure at Recirculation | 34-213 |
| 34-324 | Case 1AP-1: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-213 |
| 34-325 | Case 1AP-1: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed..... | 34-214 |
| 34-326 | Case 1AP-1: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-214 |
| 34-327 | Case 1AP-1: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-215 |
| 34-328 | Case 1AP-1: Break Flow Rate SBLOCA with PRHR, CMTs Failed..... | 34-215 |
| 34-329 | Case 1AP-1: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-216 |
| 34-330 | Case 1AP-1: Core Temperatures SBLOCA with PRHR, CMTs Failed..... | 34-216 |
| 34-331 | Case 1AP-1: Containment Pool Water Elevations SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-332 | Case 1AP-1: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-217 |
| 34-333 | Case 1AP-1: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-334 | Case 1AP-1: Core Mass SBLOCA with PRHR, CMTs Failed | 34-218 |
| 34-335 | Case 1AP-1: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-336 | Case 1AP-1: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-219 |
| 34-337 | Case 1AP-1: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-338 | Case 1AP-1: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-220 |
| 34-339 | Case 1AP-1: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-340 | Case 1AP-1: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed | 34-221 |
| 34-341 | Case 1AP-2: Reactor Coolant System and Steam Generator Pressure SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-342 | Case 1AP-2: ADS Stage 4 Flow Rates SBLOCA with PRHR, CMTs Failed | 34-222 |
| 34-343 | Case 1AP-2: Accumulator/CMT Water Mass SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-344 | Case 1AP-2: IRWST Injection Flow Rate SBLOCA with PRHR, CMTs Failed | 34-223 |
| 34-345 | Case 1AP-2: Break Flow Rate SBLOCA with PRHR, CMTs Failed..... | 34-224 |
| 34-346 | Case 1AP-2: Reactor Vessel Water Level SBLOCA with PRHR, CMTs Failed | 34-224 |
| 34-347 | Case 1AP-2: Core Temperatures SBLOCA with PRHR, CMTs Failed..... | 34-225 |
| 34-348 | Case 1AP-2: Containment Water Pool Elevations SBLOCA with PRHR, CMTs Failed | 34-225 |
| 34-349 | Case 1AP-2: Containment Pressure SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-350 | Case 1AP-2: Containment Gas Temperature SBLOCA with PRHR, CMTs Failed | 34-226 |
| 34-351 | Case 1AP-2: Core Mass SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-352 | Case 1AP-2: Reactor Pressure Vessel to Cavity Water Heat Transfer SBLOCA with PRHR, CMTs Failed | 34-227 |
| 34-353 | Case 1AP-2: In-Vessel Hydrogen Generation SBLOCA with PRHR, CMTs Failed | 34-228 |
| 34-354 | Case 1AP-2: Mass Fraction of CsI Released to Containment SBLOCA with PRHR, CMTs Failed | 34-228 |
| 34-355 | Case 1AP-2: Mass Fraction of Noble Gases Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-356 | Case 1AP-2: Mass Fraction of Fission Products Released to Environment SBLOCA with PRHR, CMTs Failed | 34-229 |
| 34-357 | Case 1AP-2: Mass Fraction of SrO Released to Environment SBLOCA with PRHR, CMTs Failed | 34-230 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-358 | Case 1A-1: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes | 34-230 |
| 34-359 | Case 1A-1: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-231 |
| 34-360 | Case 1A-1: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-231 |
| 34-361 | Case 1A-1: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-362 | Case 1A-1: Break Flow Rate Transient with Creep of SG Tubes | 34-232 |
| 34-363 | Case 1A-1: Reactor Vessel Water Level Transient with Creep of SG Tubes..... | 34-233 |
| 34-364 | Case 1A-1: Core Temperatures Transient with Creep of SG Tubes..... | 34-233 |
| 34-365 | Case 1A-1: Containment Pool Water Elevations Transient with Creep of SG Tubes..... | 34-234 |
| 34-366 | Case 1A-1: Containment Pressure Transient with Creep of SG Tubes | 34-234 |
| 34-367 | Case 1A-1: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-235 |
| 34-368 | Case 1A-1: Core Mass Transient with Creep of SG Tubes | 34-235 |
| 34-369 | Case 1A-1: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes | 34-236 |
| 34-370 | Case 1A-1: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-236 |
| 34-371 | Case 1A-1: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-237 |
| 34-372 | Case 1A-1: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes | 34-237 |
| 34-373 | Case 1A-1: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes | 34-238 |
| 34-374 | Case 1A-1: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-238 |
| 34-375 | Case 1A-2: Reactor Coolant System and Steam Generator Pressure Transient with Creep of SG Tubes | 34-239 |
| 34-376 | Case 1A-2: ADS Stage 4 Flow Rates Transient with Creep of SG Tubes..... | 34-239 |
| 34-377 | Case 1A-2: Accumulator/CMT Water Mass Transient with Creep of SG Tubes..... | 34-240 |
| 34-378 | Case 1A-2: IRWST Injection Flow Rate Transient with Creep of SG Tubes | 34-240 |
| 34-379 | Case 1A-2: Break Flow Rate Transient with Creep of SG Tubes | 34-241 |
| 34-380 | Case 1A-2: Reactor Vessel Water Level Transient with Creep of SG Tubes..... | 34-241 |
| 34-381 | Case 1A-2: Core Temperatures Transient with Creep of SG Tubes..... | 34-242 |
| 34-382 | Case 1A-2: Containment Water Pool Elevations Transient with Creep of SG Tubes | 34-242 |
| 34-383 | Case 1A-2: Containment Pressure Transient with Creep of SG Tubes | 34-243 |
| 34-384 | Case 1A-2: Containment Gas Temperature Transient with Creep of SG Tubes..... | 34-243 |
| 34-385 | Case 1A-2: Core Mass Transient with Creep of SG Tubes | 34-244 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 34-386 | Case 1A-2: Reactor Pressure Vessel to Cavity Water Heat Transfer Transient with Creep of SG Tubes | 34-244 |
| 34-387 | Case 1A-2: In-Vessel Hydrogen Generation Transient with Creep of SG Tubes..... | 34-245 |
| 34-388 | Case 1A-2: Mass Fraction of CsI Released to Containment Transient with Creep of SG Tubes..... | 34-245 |
| 34-389 | Case 1A-2: Mass Fraction of Noble Gases Released to Environment Transient with Creep of SG Tubes..... | 34-246 |
| 34-390 | Case 1A-2: Mass Fraction of Fission Products Released to Environment Transient with Creep of SG Tubes..... | 34-246 |
| 34-391 | Case 1A-2: Mass Fraction of SrO Released to Environment Transient with Creep of SG Tubes..... | 34-247 |
| 34-392 | Case 3BE-1: Containment Pressure DDT Intermediate Containment Failure | 34-247 |
| 34-393 | Case 3BE-1: Containment Gas Temperature DDT Intermediate Containment Failure..... | 34-248 |
| 34-394 | Case 3BE-1: Containment Hydrogen Concentration DDT Intermediate Containment Failure..... | 34-248 |
| 34-395 | Case 3BE-1: Noble Gases Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-396 | Case 3BE-1: CsI and RbI Release Fraction DDT Intermediate Containment Failure..... | 34-249 |
| 34-397 | Case 3BE-1: TeO ₂ Release Fraction DDT Intermediate Containment Failure | 34-250 |
| 34-398 | Case 3BE-1: SrO Release Fraction DDT Intermediate Containment Failure | 34-250 |
| 34-399 | Case 3BE-1: MoO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-400 | Case 3BE-1: CsOH and RbOH Release Fraction DDT Intermediate Containment Failure..... | 34-251 |
| 34-401 | Case 3BE-1: BaO Release Fraction DDT Intermediate Containment Failure | 34-252 |
| 34-402 | Case 3BE-1: La ₂ O ₃ Release Fraction DDT Intermediate Containment Failure..... | 34-252 |
| 34-403 | Case 3BE-1: CeO ₂ Release Fraction DDT Intermediate Containment Failure..... | 34-253 |
| 34-404 | Case 3BE-1: Sb Release Fraction DDT Intermediate Containment Failure | 34-253 |
| 34-405 | Case 3BE-1: Te ₂ Release Fraction DDT Intermediate Containment Failure | 34-254 |
| 34-406 | Case 3BE-1: UO ₂ Release Fraction DDT Intermediate Containment Failure | 34-254 |
| 34-407 | Case 3BE-1: RCS Pressure No PCS Water Cooling and Late Containment Failure | 34-255 |
| 34-408 | Case 3BE-1: Reactor Vessel Mixture Level No PCS Water Cooling and Late Containment Failure..... | 34-255 |
| 34-409 | Case 3BE-1: Core-Exit Temperature No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-410 | Case 3BE-1: In-Vessel Hydrogen Generation No PCS Water Cooling and Late Containment Failure..... | 34-256 |
| 34-411 | Case 3BE-1: Containment Pressure No PCS Water Cooling and Late Containment Failure..... | 34-257 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 34-412 | Case 3BE-1: Containment Gas Temperature No PCS Water Cooling and Late Containment Failure..... | 34-257 |
| 34-413 | Case 3BE-1: Containment Hydrogen Concentration No PCS Water Cooling and Late Containment Failure..... | 34-258 |
| 34-414 | Case 3BE-1: Noble Gas Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-258 |
| 34-415 | Case 3BE-1: CsI and RbI Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-416 | Case 3BE-1: TeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-259 |
| 34-417 | Case 3BE-1: SrO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-418 | Case 3BE-1: MoO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-260 |
| 34-419 | Case 3BE-1: CsOH and RbOH Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-420 | Case 3BE-1: BaO Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-261 |
| 34-421 | Case 3BE-1: La ₂ O ₃ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-422 | Case 3BE-1: CeO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-262 |
| 34-423 | Case 3BE-1: Sb Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-263 |
| 34-424 | Case 3BE-1: Te ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-263 |
| 34-425 | Case 3BE-1: UO ₂ Release Fraction No PCS Water Cooling and Late Containment Failure..... | 34-264 |
| 35-1 | Containment Event Tree..... | 35-29 |
| 36-1 | AP1000 Accident Class 1A Base Case for Node DP Success – RCS Pressure..... | 36-7 |
| 36-2 | AP1000 Accident Class 1A Base Case for Node DP Success – Core-Exit Gas Temperature..... | 36-8 |
| 36-3 | AP1000 Accident Class 1A Base Case for Node DP Success – Steam Generator Tube Creep Damage..... | 36-9 |
| 36-4 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Passive RHR Heat Removal..... | 36-10 |
| 36-5 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core Makeup Tank Flow (one tank)..... | 36-11 |
| 36-6 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Reactor Coolant System Pressure..... | 36-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 36-7 | AP1000 Steam Generator Tube Rupture with PRHR and Stuck-Open SV – Core-Exit Gas Temperature..... | 36-13 |
| 39-1 | AP1000 Base Case In-Vessel Retention of Molten Core Debris..... | 39-23 |
| 39-2 | AP1000 Core Shroud | 39-24 |
| 39-3 | Comparison of ULPU-2000 Configuration III and ULPU-2000 Configuration IV..... | 39-25 |
| 39-4 | Effect of Water Level on Water Circulation During IVR..... | 39-26 |
| 39-5 | ULPU-2000 Configuration IV Results (Reference 39-4)..... | 39-27 |
| 39-6 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Zirconium Oxidation Fraction Input Probability Distribution..... | 39-28 |
| 39-7 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Mass of Steel in Debris Input Probability Distribution | 39-29 |
| 39-8 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Time of Final Bounding State Input Probability Distribution..... | 39-30 |
| 39-9 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Oxide Layer..... | 39-31 |
| 39-10 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Height of the Metal Layer | 39-32 |
| 39-11 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Power Density in Oxide Debris..... | 39-33 |
| 39-12 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Internal Rayleigh Number in the Oxide Layer..... | 39-34 |
| 39-13 | AP1000 In-Vessel Retention of Molten Core Debris Quantification External Rayleigh Number in the Metal Layer | 39-35 |
| 39-14 | AP1000 In-Vessel Retention of Molten Core Debris Quantification Normalized Heat Fluxes..... | 39-36 |
| 39-15 | AP1000 Passive Core Cooling System..... | 39-37 |
| 39-16 | Containment Floodable Region..... | 39-38 |
| 39-17 | Containment Floodable Region – Exploded View | 39-39 |
| 39-18 | AP1000 Cavity Flooding Rate | 39-40 |
| 39-19 | Schematic of the AP1000 Reactor Vessel, Vessel Cavity, Vessel Insulation, and Vents | 39-41 |
| 39A-1 | AP1000 Reactor Pressure Vessel, Core and Lower Internals..... | 39A-21 |
| 39A-2 | Core Shroud | 39A-22 |
| 39A-3 | Bottom of Core Shroud, Core Barrel, and Lower Core Support Plate (Not to Scale) | 39A-23 |
| 39A-4 | Axial Power Shapes Used for Core Relocation Analysis | 39A-24 |
| 39A-5 | Radial Power Shape Used for Core Relocation Analysis | 39A-25 |
| 39A-6 | Cross Section Geometry of Finite Difference Computational Model..... | 39A-26 |
| 39A-7 | Computational Mesh for Finite Difference Computational Model..... | 39A-27 |
| 39A-8 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Reactor – Coolant System Pressure..... | 39A-28 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 39A-9 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Containment and Reactor Coolant System Pressure..... | 39A-28 |
| 39A-10 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-29 |
| 39A-11 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Hottest Temperature in Core | 39A-29 |
| 39A-12 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Hydrogen Generated in Core | 39A-30 |
| 39A-13 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.7 – 2.0 m)..... | 39A-30 |
| 39A-14 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Temperature of Core Shroud/Barrel (Core Elevation 2.0 – 2.3 m)..... | 39A-31 |
| 39A-15 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape – Mass of Core Shroud/Barrel..... | 39A-31 |
| 39A-16 | MAAP4 AP1000 Core Melting and Relocation, Top-Skewed Power Shape Volume of Debris in Reactor Vessel Lower Plenum..... | 39A-32 |
| 39A-17 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Coolant System Pressure | 39A-32 |
| 39A-18 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Containment and Reactor Coolant System Pressure..... | 39A-33 |
| 39A-19 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Reactor Vessel Mixture Level | 39A-33 |
| 39A-20 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Hottest Temperature in Core | 39A-34 |
| 39A-21 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Hydrogen Generated in Core | 39A-34 |
| 39A-22 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.1 – 1.4 m)..... | 39A-35 |
| 39A-23 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Temperature of Core Shroud/Barrel (Core Elevation 1.4 – 1.7 m)..... | 39A-35 |
| 39A-24 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape – Mass of Core Shroud/Barrel..... | 39A-36 |
| 39A-25 | MAAP4 AP1000 Core Melting and Relocation, Chopped Cosine Power Shape Volume of Debris in Reactor Vessel Lower Plenum..... | 39A-36 |
| 39A-26 | Initial Oxide Relocation to Lower Plenum..... | 39A-37 |
| 39A-27 | Finite Difference Result for Top-Skewed Power Shape at Level 5..... | 39A-38 |
| 39A-28 | Finite Difference Temperature Map Level 5 at 5380 Seconds for Top-Skewed Power Shape Case..... | 39A-38 |
| 39A-29 | MAAP4 Core Temperature Profile for Top-Skewed Power Shape Core Elevation = 2.0 – 2.3 m Above Bottom of Active Fuel (Core Axial Row 12) | 39A-39 |
| 39A-30 | Relocation of Corium..... | 39A-39 |
| 39A-31 | Model for Relocation to Lower Plenum..... | 39A-40 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 40-1 | AP1000 Passive Containment Cooling System..... | 40-7 |
| 40-2 | Schematic of Passive Containment Cooling System Piping..... | 40-8 |
| 40-3 | AP1000 Containment Venting Pressure Response..... | 40-9 |
| 40-4 | AP1000 Containment Venting Loss of Containment Air..... | 40-10 |
| 40-5 | AP1000 Dry PCS Containment Pressure Response | 40-11 |
| 40-6 | AP1000 Dry PCS Containment Temperature Response | 40-12 |
| 41-1 | IRWST Hydrogen Venting..... | 41-36 |
| 41-2 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Success..... | 41-37 |
| 41-3 | Accident Class 3BE Early Detonation Decomposition Event Tree – Given RFL Failure | 41-38 |
| 41-4 | Accident Class 3BL Early Detonation Decomposition Event Tree | 41-39 |
| 41-5 | Accident Class 3C/3BR Early Detonation Decomposition Event Tree | 41-40 |
| 41-6 | Accident Class 3D/1D Early Detonation Decomposition Event Tree | 41-41 |
| 41-7 | Accident Class AP Early Detonation Decomposition Event Tree | 41-42 |
| 41-8 | Boil-Off Hydrogen Generation Probability Density Function | 41-43 |
| 41-9 | No Reflood Pre-Burn Containment Pressure Probability Density Function | 41-44 |
| 41-10 | No-Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-45 |
| 41-11 | Early Reflood Hydrogen Generation Probability Density Function | 41-46 |
| 41-12 | Early Reflood Pre-Burn Containment Pressure Probability Density Function | 41-47 |
| 41-13 | Early Reflood Hydrogen Deflagration Peak Pressure Probability | 41-48 |
| 41-14 | Late Reflood Hydrogen Generation Probability Density Function..... | 41-49 |
| 41-15 | Late Reflood Pre-Burn Containment Pressure Probability Density Function..... | 41-50 |
| 41-16 | Late Reflood Hydrogen Deflagration Peak Pressure Probability..... | 41-51 |
| 41-17 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Success..... | 41-52 |
| 41-18 | Accident Class 3BE Intermediate Detonation Decomposition Event Tree – Given RFL Failure | 41-53 |
| 41-19 | Accident Class 3BL Intermediate Detonation Decomposition Event Tree..... | 41-54 |
| 41-20 | Accident Class 3C/3BR Intermediate Detonation Decomposition Event Tree..... | 41-55 |
| 41-21 | Accident Class 3D/1D Intermediate Detonation Decomposition Event Tree..... | 41-56 |
| 41-22 | Accident Class 1AP Intermediate Detonation Decomposition Event Tree..... | 41-57 |
| 41A-1 | Case 3BE-1: Reactor Coolant System Pressure DVI Line Break for Containment Water Level | 41A-41 |
| 41A-2 | Case 3BE-1: Core-Exit Gas Temperature DVI Line Break for Containment Water Level | 41A-41 |
| 41A-3 | Case 3BE-1: Reactor Vessel Mixture Level DVI Line Break for Containment Water Level | 41A-42 |
| 41A-4 | Case 3BE-1: Hydrogen Generated In-Vessel DVI Line Break for Containment Water Level | 41A-42 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-5 | Case 3BE-1: Containment Pressure DVI Line Break for Containment Water Level..... | 41A-43 |
| 41A-6 | Case 3BE-1: Containment Gas Temperature DVI Line Break for Containment Water Level | 41A-43 |
| 41A-7 | Case 3BE-1: Containment Compartments Water Level DVI Line Break for Containment Water Level | 41A-44 |
| 41A-8 | Case 3BE-1: Well-Mixed Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-44 |
| 41A-9 | Case 3BE-1: Well-Mixed Compartment Steam Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-10 | Case 3BE-1: Well-Mixed Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-45 |
| 41A-11 | Case 3BE-1: Confined Compartment Hydrogen Concentration DVI Line Break for Containment Water Level | 41A-46 |
| 41A-12 | Case 3BE-1: Confined Compartment Steam Concentration DVI Line Break for Containment Water Level..... | 41A-46 |
| 41A-13 | Case 3BE-1: Confined Compartment Oxygen Concentration DVI Line Break for Containment Water Level | 41A-47 |
| 41A-14 | Case 3BE-1: Equivalence Ratio in SG Room DVI Line Break for Containment Water Level | 41A-47 |
| 41A-15 | Case 3BE-1: Equivalence Ratio in CMT Room DVI Line Break for Containment Water Level | 41A-48 |
| 41A-16 | Case 3BE-1: Equivalence Ratio in IRWST DVI Line Break for Containment Water Level | 41A-48 |
| 41A-17 | Case 3BE-1: Equivalence Ratio in PXS DVI Line Break for Containment Water Level..... | 41A-49 |
| 41A-18 | Case 3BE-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-49 |
| 41A-19 | Case 3BE-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-20 | Case 3BE-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-50 |
| 41A-21 | Case 3BE-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-22 | Case 3BE-2: Containment Pressure DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-51 |
| 41A-23 | Case 3BE-2: Containment Gas Temperature DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-24 | Case 3BE-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-52 |
| 41A-25 | Case 3BE-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-53 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-26 | Case 3BE-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-53 |
| 41A-27 | Case 3BE-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-28 | Case 3BE-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-54 |
| 41A-29 | Case 3BE-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-30 | Case 3BE-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-55 |
| 41A-31 | Case 3BE-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-32 | Case 3BE-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-56 |
| 41A-33 | Case 3BE-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-34 | Case 3BE-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Injection and No PXS Flooding | 41A-57 |
| 41A-35 | Case 3BE-4: Reactor Coolant System Pressure Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-36 | Case 3BE-4: Core-Exit Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-58 |
| 41A-37 | Case 3BE-4: Reactor Vessel Mixture Level Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-38 | Case 3BE-4: Hydrogen Generated In-Vessel Spurious ADS, Failed Gravity Injection | 41A-59 |
| 41A-39 | Case 3BE-4: Containment Pressure Spurious ADS, Failed Gravity Injection..... | 41A-60 |
| 41A-40 | Case 3BE-4: Containment Gas Temperature Spurious ADS, Failed Gravity Injection | 41A-60 |
| 41A-41 | Case 3BE-4: Containment Compartments Water Level Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-42 | Case 3BE-4: Well-Mixed Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-61 |
| 41A-43 | Case 3BE-4: Well-Mixed Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-44 | Case 3BE-4: Well-Mixed Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-62 |
| 41A-45 | Case 3BE-4: Confined Compartment Hydrogen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-46 | Case 3BE-4: Confined Compartment Steam Concentration Spurious ADS, Failed Gravity Injection..... | 41A-63 |
| 41A-47 | Case 3BE-4: Confined Compartment Oxygen Concentration Spurious ADS, Failed Gravity Injection..... | 41A-64 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-48 | Case 3BE-4: Equivalence Ratio in SG Room Spurious ADS, Failed Gravity Injection | 41A-64 |
| 41A-49 | Case 3BE-4: Equivalence Ratio in CMT Room Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-50 | Case 3BE-4: Equivalence Ratio in IRWST Spurious ADS, Failed Gravity Injection | 41A-65 |
| 41A-51 | Case 3BE-4: Equivalence Ratio in PXS Spurious ADS, Failed Gravity Injection | 41A-66 |
| 41A-52 | Case 3BE-5: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-66 |
| 41A-53 | Case 3BE-5: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-54 | Case 3BE-5: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-67 |
| 41A-55 | Case 3BE-5: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-56 | Case 3BE-5: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-68 |
| 41A-57 | Case 3BE-5: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-69 |
| 41A-58 | Case 3BE-5: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-69 |
| 41A-59 | Case 3BE-5: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-60 | Case 3BE-5: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-70 |
| 41A-61 | Case 3BE-5: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-62 | Case 3BE-5: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-71 |
| 41A-63 | Case 3BE-5: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-64 | Case 3BE-5: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-72 |
| 41A-65 | Case 3BE-5: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-66 | Case 3BE-5: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-73 |
| 41A-67 | Case 3BE-5: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-68 | Case 3BE-5: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-74 |
| 41A-69 | Case 3BE-6: Reactor Coolant System Pressure SBLOCA with Failed Gravity Injection | 41A-75 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-70 | Case 3BE-6: Core-Exit Gas Temperature SBLOCA with Failed Gravity Injection | 41A-75 |
| 41A-71 | Case 3BE-6: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-72 | Case 3BE-6: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Injection | 41A-76 |
| 41A-73 | Case 3BE-6: Containment Pressure SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-74 | Case 3BE-6: Containment Gas Temperature SBLOCA with Failed Gravity Injection | 41A-77 |
| 41A-75 | Case 3BE-6: Containment Compartments Water Level SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-76 | Case 3BE-6: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-78 |
| 41A-77 | Case 3BE-6: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-78 | Case 3BE-6: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-79 |
| 41A-79 | Case 3BE-6: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-80 | Case 3BE-6: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Injection..... | 41A-80 |
| 41A-81 | Case 3BE-6: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Injection..... | 41A-81 |
| 41A-82 | Case 3BE-6: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Injection | 41A-81 |
| 41A-83 | Case 3BE-6: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-84 | Case 3BE-6: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Injection | 41A-82 |
| 41A-85 | Case 3BE-6: Equivalence Ratio in PXS SBLOCA with Failed Gravity Injection | 41A-83 |
| 41A-86 | Case 3BE-8: Reactor Coolant System Pressure SGTR..... | 41A-83 |
| 41A-87 | Case 3BE-8: Core-Exit Gas Temperature SGTR | 41A-84 |
| 41A-88 | Case 3BE-8: Reactor Vessel Mixture Level SGTR..... | 41A-84 |
| 41A-89 | Case 3BE-8: Hydrogen Generated In-Vessel SGTR | 41A-85 |
| 41A-90 | Case 3BE-8: Containment Pressure SGTR | 41A-85 |
| 41A-91 | Case 3BE-8: Containment Gas Temperature SGTR | 41A-86 |
| 41A-92 | Case 3BE-8: Containment Compartments Water Level SGTR..... | 41A-86 |
| 41A-93 | Case 3BE-8: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-87 |
| 41A-94 | Case 3BE-8: Well-Mixed Compartment Steam Concentration SGTR..... | 41A-87 |
| 41A-95 | Case 3BE-8: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-88 |
| 41A-96 | Case 3BE-8: Confined Compartment Hydrogen Concentration SGTR..... | 41A-88 |
| 41A-97 | Case 3BE-8: Confined Compartment Steam Concentration SGTR..... | 41A-89 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-98 | Case 3BE-8: Confined Compartment Oxygen Concentration SGTR..... | 41A-89 |
| 41A-99 | Case 3BE-8: Equivalence Ratio in SG Room SGTR | 41A-90 |
| 41A-100 | Case 3BE-8: Equivalence Ratio in CMT Room SGTR..... | 41A-90 |
| 41A-101 | Case 3BE-8: Equivalence Ratio in IRWST SGTR..... | 41A-91 |
| 41A-102 | Case 3BE-8: Equivalence Ratio in PXS SGTR..... | 41A-91 |
| 41A-103 | Case 3BE-9: Reactor Coolant System Pressure SGTR..... | 41A-92 |
| 41A-104 | Case 3BE-9: Core-Exit Gas Temperature SGTR | 41A-92 |
| 41A-105 | Case 3BE-9: Reactor Vessel Mixture Level SGTR..... | 41A-93 |
| 41A-106 | Case 3BE-9: Hydrogen Generated In-Vessel SGTR | 41A-93 |
| 41A-107 | Case 3BE-9: Containment Pressure SGTR | 41A-94 |
| 41A-108 | Case 3BE-9: Containment Gas Temperature SGTR | 41A-94 |
| 41A-109 | Case 3BE-9: Containment Compartments Water Level SGTR..... | 41A-95 |
| 41A-110 | Case 3BE-9: Well-Mixed Compartment Hydrogen Concentration SGTR | 41A-95 |
| 41A-111 | Case 3BE-9: Well-Mixed Compartment Steam Concentration SGTR..... | 41A-96 |
| 41A-112 | Case 3BE-9: Well-Mixed Compartment Oxygen Concentration SGTR | 41A-96 |
| 41A-113 | Case 3BE-9: Confined Compartment Hydrogen Concentration SGTR..... | 41A-97 |
| 41A-114 | Case 3BE-9: Confined Compartment Steam Concentration SGTR..... | 41A-97 |
| 41A-115 | Case 3BE-9: Confined Compartment Oxygen Concentration SGTR..... | 41A-98 |
| 41A-116 | Case 3BE-9: Equivalence Ratio in SG Room SGTR | 41A-98 |
| 41A-117 | Case 3BE-9: Equivalence Ratio in CMT Room SGTR..... | 41A-99 |
| 41A-118 | Case 3BE-9: Equivalence Ratio in IRWST SGTR..... | 41A-99 |
| 41A-119 | Case 3BE-9: Equivalence Ratio in PXS SGTR..... | 41A-100 |
| 41A-120 | Case 3BL-1: Reactor Coolant System Pressure SBLOCA with Failed Gravity Recirculation | 41A-100 |
| 41A-121 | Case 3BL-1: Core-Exit Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-122 | Case 3BL-1: Reactor Vessel Mixture Level SBLOCA with Failed Gravity Recirculation | 41A-101 |
| 41A-123 | Case 3BL-1: Hydrogen Generated In-Vessel SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-124 | Case 3BL-1: Containment Pressure SBLOCA with Failed Gravity Recirculation | 41A-102 |
| 41A-125 | Case 3BL-1: Containment Gas Temperature SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-126 | Case 3BL-1: Containment Compartments Water Level SBLOCA with Failed Gravity Recirculation | 41A-103 |
| 41A-127 | Case 3BL-1: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-128 | Case 3BL-1: Well-Mixed Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-104 |
| 41A-129 | Case 3BL-1: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-130 | Case 3BL-1: Confined Compartment Hydrogen Concentration SBLOCA with Failed Gravity Recirculation | 41A-105 |
| 41A-131 | Case 3BL-1: Confined Compartment Steam Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-132 | Case 3BL-1: Confined Compartment Oxygen Concentration SBLOCA with Failed Gravity Recirculation | 41A-106 |
| 41A-133 | Case 3BL-1: Equivalence Ratio in SG Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-134 | Case 3BL-1: Equivalence Ratio in CMT Room SBLOCA with Failed Gravity Recirculation | 41A-107 |
| 41A-135 | Case 3BL-1: Equivalence Ratio in IRWST SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-136 | Case 3BL-1: Equivalence Ratio in PXS SBLOCA with Failed Gravity Recirculation | 41A-108 |
| 41A-137 | Case 3BL-2: Reactor Coolant System Pressure DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-138 | Case 3BL-2: Core-Exit Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-109 |
| 41A-139 | Case 3BL-2: Reactor Vessel Mixture Level DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-140 | Case 3BL-2: Hydrogen Generated In-Vessel DVI Line Break with Failed Gravity Recirculation | 41A-110 |
| 41A-141 | Case 3BL-2: Containment Pressure DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-142 | Case 3BL-2: Containment Gas Temperature DVI Line Break with Failed Gravity Recirculation | 41A-111 |
| 41A-143 | Case 3BL-2: Containment Compartments Water Level DVI Line Break with Failed Gravity Recirculation | 41A-112 |
| 41A-144 | Case 3BL-2: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-112 |
| 41A-145 | Case 3BL-2: Well-Mixed Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-146 | Case 3BL-2: Well-Mixed Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-113 |
| 41A-147 | Case 3BL-2: Confined Compartment Hydrogen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-114 |
| 41A-148 | Case 3BL-2: Confined Compartment Steam Concentration DVI Line Break with Failed Gravity Recirculation | 41A-114 |
| 41A-149 | Case 3BL-2: Confined Compartment Oxygen Concentration DVI Line Break with Failed Gravity Recirculation | 41A-115 |
| 41A-150 | Case 3BL-2: Equivalence Ratio in SG Room DVI Line Break with Failed Gravity Recirculation | 41A-115 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-151 | Case 3BL-2: Equivalence Ratio in CMT Room DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-152 | Case 3BL-2: Equivalence Ratio in IRWST DVI Line Break with Failed Gravity Recirculation | 41A-116 |
| 41A-153 | Case 3BL-2: Equivalence Ratio in PXS DVI Line Break with Failed Gravity Recirculation | 41A-117 |
| 41A-154 | Case 3BR-1: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-117 |
| 41A-155 | Case 3BR-1: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-156 | Case 3BR-1: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-118 |
| 41A-157 | Case 3BR-1: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-119 |
| 41A-158 | Case 3BR-1: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-119 |
| 41A-159 | Case 3BR-1: Containment Gas Temperature CL LBLOCA with Accumulator Failure | 41A-120 |
| 41A-160 | Case 3BR-1: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-120 |
| 41A-161 | Case 3BR-1: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-162 | Case 3BR-1: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-121 |
| 41A-163 | Case 3BR-1: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-164 | Case 3BR-1: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-122 |
| 41A-165 | Case 3BR-1: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-166 | Case 3BR-1: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-123 |
| 41A-167 | Case 3BR-1: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-168 | Case 3BR-1: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-124 |
| 41A-169 | Case 3BR-1: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-125 |
| 41A-170 | Case 3BR-1: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure | 41A-125 |
| 41A-171 | Case 3BR-1a: Reactor Coolant System Pressure CL LBLOCA with Accumulator Failure..... | 41A-126 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-172 | Case 3BR-1a: Core-Exit Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-126 |
| 41A-173 | Case 3BR-1a: Reactor Vessel Mixture Level CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-174 | Case 3BR-1a: Hydrogen Generated In-Vessel CL LBLOCA with Accumulator Failure..... | 41A-127 |
| 41A-175 | Case 3BR-1a: Containment Pressure CL LBLOCA with Accumulator Failure | 41A-128 |
| 41A-176 | Case 3BR-1a: Containment Gas Temperature CL LBLOCA with Accumulator Failure..... | 41A-128 |
| 41A-177 | Case 3BR-1a: Containment Compartments Water Level CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-178 | Case 3BR-1a: Well-Mixed Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-129 |
| 41A-179 | Case 3BR-1a: Well-Mixed Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-180 | Case 3BR-1a: Well-Mixed Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-130 |
| 41A-181 | Case 3BR-1a: Confined Compartment Hydrogen Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-182 | Case 3BR-1a: Confined Compartment Steam Concentration CL LBLOCA with Accumulator Failure..... | 41A-131 |
| 41A-183 | Case 3BR-1a: Confined Compartment Oxygen Concentration CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-184 | Case 3BR-1a: Equivalence Ratio in SG Room CL LBLOCA with Accumulator Failure..... | 41A-132 |
| 41A-185 | Case 3BR-1a: Equivalence Ratio in CMT Room CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-186 | Case 3BR-1a: Equivalence Ratio in IRWST CL LBLOCA with Accumulator Failure..... | 41A-133 |
| 41A-187 | Case 3BR-1a: Equivalence Ratio in PXS CL LBLOCA with Accumulator Failure..... | 41A-134 |
| 41A-188 | Case 3C-1: Reactor Coolant System Pressure Vessel Rupture..... | 41A-134 |
| 41A-189 | Case 3C-1: Core-Exit Gas Temperature Vessel Rupture..... | 41A-135 |
| 41A-190 | Case 3C-1: Reactor Vessel Mixture Level Vessel Rupture | 41A-135 |
| 41A-191 | Case 3C-1: Hydrogen Generated In-Vessel Vessel Rupture..... | 41A-136 |
| 41A-192 | Case 3C-1: Containment Pressure Vessel Rupture..... | 41A-136 |
| 41A-193 | Case 3C-1: Containment Gas Temperature Vessel Rupture..... | 41A-137 |
| 41A-194 | Case 3C-1: Containment Compartments Water Level Vessel Rupture | 41A-137 |
| 41A-195 | Case 3C-1: Well-Mixed Compartment Hydrogen Concentration Vessel Rupture..... | 41A-138 |
| 41A-196 | Case 3C-1: Well-Mixed Compartment Steam Concentration Vessel Rupture..... | 41A-138 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-197 | Case 3C-1: Well-Mixed Compartment Oxygen Concentration Vessel Rupture..... | 41A-139 |
| 41A-198 | Case 3C-1: Confined Compartment Hydrogen Concentration Vessel Rupture..... | 41A-139 |
| 41A-199 | Case 3C-1: Confined Compartment Steam Concentration Vessel Rupture..... | 41A-140 |
| 41A-200 | Case 3C-1: Confined Compartment Oxygen Concentration Vessel Rupture..... | 41A-140 |
| 41A-201 | Case 3C-1: Equivalence Ratio in SG Room Vessel Rupture..... | 41A-141 |
| 41A-202 | Case 3C-1: Equivalence Ratio in CMT Room Vessel Rupture..... | 41A-141 |
| 41A-203 | Case 3C-1: Equivalence Ratio in IRWST Vessel Rupture..... | 41A-142 |
| 41A-204 | Case 3C-1: Equivalence Ratio in PXS Vessel Rupture..... | 41A-142 |
| 41A-205 | Case 3D-1: Reactor Coolant System Pressure Spurious ADS-4 with Failed CMTs..... | 41A-143 |
| 41A-206 | Case 3D-1: Core-Exit Gas Temperature Spurious ADS-4 with Failed CMTs..... | 41A-143 |
| 41A-207 | Case 3D-1: Reactor Vessel Mixture Level Spurious ADS-4 with Failed CMTs..... | 41A-144 |
| 41A-208 | Case 3D-1: Hydrogen Generated In-Vessel Spurious ADS-4 with Failed CMTs..... | 41A-144 |
| 41A-209 | Case 3D-1: Containment Pressure Spurious ADS-4 with Failed CMTs..... | 41A-145 |
| 41A-210 | Case 3D-1: Containment Gas Temperature Spurious ADS-4 with Failed CMTs..... | 41A-145 |
| 41A-211 | Case 3D-1: Containment Compartments Water Level Spurious ADS-4 with Failed CMTs..... | 41A-146 |
| 41A-212 | Case 3D-1: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-146 |
| 41A-213 | Case 3D-1: Well-Mixed Compartment Steam Concentration Spurious ADS-4 with Failed CMTs..... | 41A-147 |
| 41A-214 | Case 3D-1: Well-Mixed Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-147 |
| 41A-215 | Case 3D-1: Confined Compartment Hydrogen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-148 |
| 41A-216 | Case 3D-1: Confined Compartment Steam Concentration Spurious ADS-4 with Failed CMTs..... | 41A-148 |
| 41A-217 | Case 3D-1: Confined Compartment Oxygen Concentration Spurious ADS-4 with Failed CMTs..... | 41A-149 |
| 41A-218 | Case 3D-1: Equivalence Ratio in SG Room Spurious ADS-4 with Failed CMTs..... | 41A-149 |
| 41A-219 | Case 3D-1: Equivalence Ratio in CMT Room Spurious ADS-4 with Failed CMTs..... | 41A-150 |
| 41A-220 | Case 3D-1: Equivalence Ratio in IRWST Spurious ADS-4 with Failed CMTs..... | 41A-150 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-221 | Case 3D-1: Equivalence Ratio in PXS Spurious ADS-4 with Failed CMTs | 41A-151 |
| 41A-222 | Case 3D-2: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs | 41A-151 |
| 41A-223 | Case 3D-2: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-224 | Case 3D-2: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs | 41A-152 |
| 41A-225 | Case 3D-2: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-226 | Case 3D-2: Containment Pressure Spurious ADS-2, Failed CMTs | 41A-153 |
| 41A-227 | Case 3D-2: Containment Gas Temperature Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-228 | Case 3D-2: Containment Compartments Water Level Spurious ADS-2, Failed CMTs | 41A-154 |
| 41A-229 | Case 3D-2: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-230 | Case 3D-2: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-155 |
| 41A-231 | Case 3D-2: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-232 | Case 3D-2: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs | 41A-156 |
| 41A-233 | Case 3D-2: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-234 | Case 3D-2: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs | 41A-157 |
| 41A-235 | Case 3D-2: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-236 | Case 3D-2: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs | 41A-158 |
| 41A-237 | Case 3D-2: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs | 41A-159 |
| 41A-238 | Case 3D-2: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs..... | 41A-159 |
| 41A-239 | Case 3D-3: Reactor Coolant System Pressure DVI Line Break with no ADS | 41A-160 |
| 41A-240 | Case 3D-3: Core-Exit Gas Temperature DVI Line Break with no ADS | 41A-160 |
| 41A-241 | Case 3D-3: Reactor Vessel Mixture Level DVI Line Break with no ADS | 41A-161 |
| 41A-242 | Case 3D-3: Hydrogen Generated In-Vessel DVI Line Break with no ADS | 41A-161 |
| 41A-243 | Case 3D-3: Containment Pressure DVI Line Break with no ADS | 41A-162 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-244 | Case 3D-3: Containment Gas Temperature DVI Line Break with no ADS | 41A-162 |
| 41A-245 | Case 3D-3: Containment Compartments Water Level DVI Line Break with no ADS | 41A-163 |
| 41A-246 | Case 3D-3: Well-Mixed Compartment Hydrogen Concentration DVI Line Break with no ADS..... | 41A-163 |
| 41A-247 | Case 3D-3: Well-Mixed Compartment Steam Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-248 | Case 3D-3: Well-Mixed Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-164 |
| 41A-249 | Case 3D-3: Confined Compartment Hydrogen Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-250 | Case 3D-3: Confined Compartment Steam Concentration DVI Line Break with no ADS | 41A-165 |
| 41A-251 | Case 3D-3: Confined Compartment Oxygen Concentration DVI Line Break with no ADS | 41A-166 |
| 41A-252 | Case 3D-3: Equivalence Ratio in SG Room DVI Line Break with no ADS | 41A-166 |
| 41A-253 | Case 3D-3: Equivalence Ratio in CMT Room DVI Line Break with no ADS | 41A-167 |
| 41A-254 | Case 3D-3: Equivalence Ratio in IRWST DVI Line Break with no ADS | 41A-167 |
| 41A-255 | Case 3D-3: Equivalence Ratio in PXS DVI Line Break with no ADS..... | 41A-168 |
| 41A-256 | Case 3D-5: Reactor Coolant System Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-168 |
| 41A-257 | Case 3D-5: Core-Exit Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-258 | Case 3D-5: Reactor Vessel Mixture Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-169 |
| 41A-259 | Case 3D-5: Hydrogen Generated In-Vessel Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-260 | Case 3D-5: Containment Pressure Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-170 |
| 41A-261 | Case 3D-5: Containment Gas Temperature Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-262 | Case 3D-5: Containment Compartments Water Level Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-171 |
| 41A-263 | Case 3D-5: Well-Mixed Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-264 | Case 3D-5: Well-Mixed Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-172 |
| 41A-265 | Case 3D-5: Well-Mixed Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-266 | Case 3D-5: Confined Compartment Hydrogen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-173 |
| 41A-267 | Case 3D-5: Confined Compartment Steam Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-268 | Case 3D-5: Confined Compartment Oxygen Concentration Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-174 |
| 41A-269 | Case 3D-5: Equivalence Ratio in SG Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-270 | Case 3D-5: Equivalence Ratio in CMT Room Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-175 |
| 41A-271 | Case 3D-5: Equivalence Ratio in IRWST Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-272 | Case 3D-5: Equivalence Ratio in PXS Spurious ADS-2, Failed CMTs, Diffusion Flame | 41A-176 |
| 41A-273 | Case 1A-3: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-274 | Case 1A-3: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-177 |
| 41A-275 | Case 1A-3: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-276 | Case 1A-3: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-178 |
| 41A-277 | Case 1A-3: Containment Pressure FW Failure with Creep of SG Tubes | 41A-179 |
| 41A-278 | Case 1A-3: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-179 |
| 41A-279 | Case 1A-3: Containment Compartments Water Level FW Failure with Creep of SG Tubes..... | 41A-180 |
| 41A-280 | Case 1A-3: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-180 |
| 41A-281 | Case 1A-3: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-282 | Case 1A-3: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-181 |
| 41A-283 | Case 1A-3: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-284 | Case 1A-3: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-182 |
| 41A-285 | Case 1A-3: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-286 | Case 1A-3: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-183 |
| 41A-287 | Case 1A-3: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-184 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-288 | Case 1A-3: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-184 |
| 41A-289 | Case 1A-3: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-185 |
| 41A-290 | Case 1A-3a: Reactor Coolant System Pressure Transient with Creep of SG Tubes | 41A-185 |
| 41A-291 | Case 1A-3a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-292 | Case 1A-3a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-186 |
| 41A-293 | Case 1A-3a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-294 | Case 1A-3a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-187 |
| 41A-295 | Case 1A-3a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-296 | Case 1A-3a: Containment Compartments Water Level Transient with Creep of SG Tubes..... | 41A-188 |
| 41A-297 | Case 1A-3a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-189 |
| 41A-298 | Case 1A-3a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-189 |
| 41A-299 | Case 1A-3a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-190 |
| 41A-300 | Case 1A-3a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-190 |
| 41A-301 | Case 1A-3a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-302 | Case 1A-3a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-191 |
| 41A-303 | Case 1A-3a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes..... | 41A-192 |
| 41A-304 | Case 1A-3a: Approximate Detonation Cell Width in CMT Room Transient with Creep of SG Tubes..... | 41A-192 |
| 41A-305 | Case 1A-3a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-193 |
| 41A-306 | Case 1A-3a: Approximate Detonation Cell Width in PXS Transient with Creep of SG Tubes..... | 41A-193 |
| 41A-307 | Case 1A-4: Reactor Coolant System Pressure FW Failure with Creep of SG Tubes | 41A-194 |
| 41A-308 | Case 1A-4: Core-Exit Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-194 |
| 41A-309 | Case 1A-4: Reactor Vessel Mixture Level FW Failure with Creep of SG Tubes..... | 41A-195 |
| 41A-310 | Case 1A-4: Hydrogen Generated In-Vessel FW Failure with Creep of SG Tubes..... | 41A-195 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-311 | Case 1A-4: Containment Pressure FW Failure with Creep of SG Tubes | 41A-196 |
| 41A-312 | Case 1A-4: Containment Gas Temperature FW Failure with Creep of SG Tubes..... | 41A-196 |
| 41A-313 | Case 1A-4: Containment Compartments Water Level FW Failure with Creep of SG Tubes | 41A-197 |
| 41A-314 | Case 1A-4: Well-Mixed Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-197 |
| 41A-315 | Case 1A-4: Well-Mixed Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-316 | Case 1A-4: Well-Mixed Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-198 |
| 41A-317 | Case 1A-4: Confined Compartment Hydrogen Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-318 | Case 1A-4: Confined Compartment Steam Concentration FW Failure with Creep of SG Tubes..... | 41A-199 |
| 41A-319 | Case 1A-4: Confined Compartment Oxygen Concentration FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-320 | Case 1A-4: Equivalence Ratio in SG Room FW Failure with Creep of SG Tubes..... | 41A-200 |
| 41A-321 | Case 1A-4: Equivalence Ratio in CMT Room FW Failure with Creep of SG Tubes | 41A-201 |
| 41A-322 | Case 1A-4: Equivalence Ratio in IRWST FW Failure with Creep of SG Tubes..... | 41A-201 |
| 41A-323 | Case 1A-4: Equivalence Ratio in PXS FW Failure with Creep of SG Tubes | 41A-202 |
| 41A-324 | Case 1A-4a: Reactor Coolant System Pressure Transient with Creep of SG Tubes..... | 41A-202 |
| 41A-325 | Case 1A-4a: Core-Exit Gas Temperature Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-326 | Case 1A-4a: Reactor Vessel Mixture Level Transient with Creep of SG Tubes..... | 41A-203 |
| 41A-327 | Case 1A-4a: Hydrogen Generated In-Vessel Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-328 | Case 1A-4a: Containment Pressure Transient with Creep of SG Tubes..... | 41A-204 |
| 41A-329 | Case 1A-4a: Containment Gas Temperature Transient with Creep of SG Tubes..... | 41A-205 |
| 41A-330 | Case 1A-4a: Containment Compartments Water Level Transient with Creep of SG Tubes | 41A-205 |
| 41A-331 | Case 1A-4a: Well-Mixed Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-332 | Case 1A-4a: Well-Mixed Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-206 |
| 41A-333 | Case 1A-4a: Well-Mixed Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-207 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 41A-334 | Case 1A-4a: Confined Compartment Hydrogen Concentration Transient with Creep of SG Tubes..... | 41A-207 |
| 41A-335 | Case 1A-4a: Confined Compartment Steam Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-336 | Case 1A-4a: Confined Compartment Oxygen Concentration Transient with Creep of SG Tubes..... | 41A-208 |
| 41A-337 | Case 1A-4a: Approximate Detonation Cell Width in SG Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-338 | Case 1A-4a: Equivalence Ratio in CMT Room Transient with Creep of SG Tubes..... | 41A-209 |
| 41A-339 | Case 1A-4a: Equivalence Ratio in IRWST Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-340 | Case 1A-4a: Equivalence Ratio in PXS Transient with Creep of SG Tubes..... | 41A-210 |
| 41A-341 | Case 1AP-3: Reactor Coolant System Pressure SBLOCA, Failed PRHR and CMTs | 41A-211 |
| 41A-342 | Case 1AP-3: Core-Exit Gas Temperature SBLOCA, Failed PRHR and CMTs | 41A-211 |
| 41A-343 | Case 1AP-3: Reactor Vessel Mixture Level SBLOCA, Failed PRHR and CMTs | 41A-212 |
| 41A-344 | Case 1AP-3: Hydrogen Generated In-Vessel SBLOCA, Failed PRHR and CMTs | 41A-212 |
| 41A-345 | Case 1AP-3: Containment Pressure SBLOCA, Failed PRHR and CMTs..... | 41A-213 |
| 41A-346 | Case 1AP-3: Containment Gas Temperature SBLOCA, Failed PRHR and CMTs | 41A-213 |
| 41A-347 | Case 1AP-3: Containment Compartments Water Level SBLOCA, Failed PRHR and CMTs..... | 41A-214 |
| 41A-348 | Case 1AP-3: Well-Mixed Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs | 41A-214 |
| 41A-349 | Case 1AP-3: Well-Mixed Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs | 41A-215 |
| 41A-350 | Case 1AP-3: Well-Mixed Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs | 41A-215 |
| 41A-351 | Case 1AP-3: Confined Compartment Hydrogen Concentration SBLOCA, Failed PRHR and CMTs | 41A-216 |
| 41A-352 | Case 1AP-3: Confined Compartment Steam Concentration SBLOCA, Failed PRHR and CMTs | 41A-216 |
| 41A-353 | Case 1AP-3: Confined Compartment Oxygen Concentration SBLOCA, Failed PRHR and CMTs | 41A-217 |
| 41A-354 | Case 1AP-3: Equivalence Ratio in SG Room SBLOCA, Failed PRHR and CMTs | 41A-217 |
| 41A-355 | Case 1AP-3: Equivalence Ratio in CMT Room SBLOCA, Failed PRHR and CMTs | 41A-218 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41A-356 | Case 1AP-3: Equivalence Ratio in IRWST SBLOCA, Failed PRHR and CMTs | 41A-218 |
| 41A-357 | Case 1AP-3: Equivalence Ratio in PXS SBLOCA, Failed PRHR and CMTs | 41A-219 |
| 41A-358 | Case 1AP-4: Reactor Coolant System Pressure SBLOCA with Failed PRHR and ADS | 41A-219 |
| 41A-359 | Case 1AP-4: Core-Exit Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-360 | Case 1AP-4: Reactor Vessel Mixture Level SBLOCA with Failed PRHR and ADS..... | 41A-220 |
| 41A-361 | Case 1AP-4: Hydrogen Generated In-Vessel SBLOCA with Failed PRHR and ADS..... | 41A-221 |
| 41A-362 | Case 1AP-4: Containment Pressure SBLOCA with Failed PRHR and ADS | 41A-221 |
| 41A-363 | Case 1AP-4: Containment Gas Temperature SBLOCA with Failed PRHR and ADS..... | 41A-222 |
| 41A-364 | Case 1AP-4: Containment Compartments Water Level SBLOCA with Failed PRHR and ADS | 41A-222 |
| 41A-365 | Case 1AP-4: Well-Mixed Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-366 | Case 1AP-4: Well-Mixed Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-223 |
| 41A-367 | Case 1AP-4: Well-Mixed Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-368 | Case 1AP-4: Confined Compartment Hydrogen Concentration SBLOCA with Failed PRHR and ADS | 41A-224 |
| 41A-369 | Case 1AP-4: Confined Compartment Steam Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-370 | Case 1AP-4: Confined Compartment Oxygen Concentration SBLOCA with Failed PRHR and ADS | 41A-225 |
| 41A-371 | Case 1AP-4: Equivalence Ratio in SG Room SBLOCA with Failed PRHR and ADS..... | 41A-226 |
| 41A-372 | Case 1AP-4: Equivalence Ratio in CMT Room SBLOCA with Failed PRHR and ADS | 41A-226 |
| 41A-373 | Case 1AP-4: Equivalence Ratio in IRWST SBLOCA with Failed PRHR and ADS..... | 41A-227 |
| 41A-374 | Case 1AP-4: Equivalence Ratio in PXS SBLOCA with Failed PRHR and ADS | 41A-227 |
| 41B-1 | Case 3BR – LLOCA with Accumulator Failure Reactor Coolant System Pressure..... | 41B-3 |
| 41B-2 | Case 3BR – LLOCA with Accumulator Failure Reactor Vessel Mixture Level..... | 41B-3 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 41B-3 | Case 3BR – LLOCA with Accumulator Failure Core-Exit Gas Temperature..... | 41B-4 |
| 41B-4 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Generated In-Vessel | 41B-4 |
| 41B-5 | Case 3BR – LLOCA with Accumulator Failure Containment Pressure..... | 41B-5 |
| 41B-6 | Case 3BR – LLOCA with Accumulator Failure Containment Gas Temperature | 41B-5 |
| 41B-7 | Case 3BR – LLOCA with Accumulator Failure Containment Compartment Hydrogen Concentration..... | 41B-6 |
| 41B-8 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through Break | 41B-6 |
| 41B-9 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Hydrogen Concentration..... | 41B-7 |
| 41B-10 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Oxygen Concentration | 41B-7 |
| 41B-11 | Case 3BR – LLOCA with Accumulator Failure Well-Mixed Compartment Steam Concentration..... | 41B-8 |
| 41B-12 | Case 3BR – LLOCA with Accumulator Failure Approximate Detonation Cell Width in Steam Generator Compartment | 41B-8 |
| 41B-13 | Case 3BR – LLOCA with Accumulator Failure Containment Compartments Water Level..... | 41B-9 |
| 41B-14 | Case 3BR – LLOCA with Accumulator Failure Hydrogen Flow Rate Through ADS to IRWST | 41B-9 |
| 41B-15 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Hydrogen Concentration..... | 41B-10 |
| 41B-16 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Oxygen Concentration | 41B-10 |
| 41B-17 | Case 3BR – LLOCA with Accumulator Failure Confined Compartment Steam Concentration..... | 41B-11 |
| 42-1 | AP1000 Containment Fragility at Containment Temperature of 400°F | 42-12 |
| 42-2 | AP1000 Containment Fragility at Containment Temperature of 331°F | 42-13 |
| 43-1 | Plant Damage State Contributions to CDF..... | 43-119 |
| 43-2 | Containment Event Tree – CET (Sheets 1 – 3) | 43-120 |
| 43-3 | 3BE CET (Sheets 1 – 3)..... | 43-123 |
| 43-4 | 3BL CET (Sheets 1 – 3)..... | 43-126 |
| 43-5 | 3BR CET (Sheets 1 – 3)..... | 43-129 |
| 43-6 | 1A CET (Sheets 1 – 3)..... | 43-132 |
| 43-7 | 1AP CET (Sheets 1 – 3)..... | 43-135 |
| 43-8 | 3A CET (Sheets 1 – 3)..... | 43-138 |
| 43-9 | 3C CET (Sheets 1 – 3)..... | 43-141 |
| 43-10 | 3D CET (Sheets 1 – 3)..... | 43-144 |
| 43-11 | 6 CET (Sheets 1 – 3)..... | 43-147 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 43-12 | Contribution of PDS to LRF | 43-150 |
| 43-13 | Summary of CET Quantification (Sheets 1 – 2)..... | 43-151 |
| 44-1 | MAAP4 AP1000 Containment Nodalization | 44-12 |
| 45-1 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-7 |
| 45-2 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-7 |
| 45-3 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide | 45-8 |
| 45-4 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide | 45-8 |
| 45-5 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-9 |
| 45-6 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-9 |
| 45-7 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide | 45-10 |
| 45-8 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide | 45-10 |
| 45-9 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide | 45-11 |
| 45-10 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tin | 45-11 |
| 45-11 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium..... | 45-12 |
| 45-12 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide | 45-12 |
| 45-13 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Noble Gases..... | 45-13 |
| 45-14 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Iodide..... | 45-13 |
| 45-15 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium Dioxide | 45-14 |
| 45-16 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Strontium Oxide | 45-14 |
| 45-17 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Molybdenum Dioxide..... | 45-15 |
| 45-18 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cesium Hydroxide..... | 45-15 |
| 45-19 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Barium Oxide | 45-16 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-20 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Dilanthanum Trioxide | 45-16 |
| 45-21 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Cerium Dioxide | 45-17 |
| 45-22 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tin | 45-17 |
| 45-23 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Tellurium | 45-18 |
| 45-24 | Release Category BP, Case 6E-1 – SGTR with Stuck Open SG Safety Valve: Release Fraction of Uranium Dioxide | 45-18 |
| 45-25 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Noble Gases | 45-19 |
| 45-26 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Iodide | 45-19 |
| 45-27 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium Dioxide | 45-20 |
| 45-28 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Strontium Oxide | 45-20 |
| 45-29 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Molybdenum Dioxide | 45-21 |
| 45-30 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cesium Hydroxide | 45-21 |
| 45-31 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Barium Oxide | 45-22 |
| 45-32 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Dilanthanum Trioxide | 45-22 |
| 45-33 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Cerium Dioxide | 45-23 |
| 45-34 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tin | 45-23 |
| 45-35 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Tellurium | 45-24 |
| 45-36 | Release Category CI, Case 3C-2 – Vessel Rupture with Containment Failure: Release Fraction of Uranium Dioxide | 45-24 |
| 45-37 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Noble Gases | 45-25 |
| 45-38 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Iodide | 45-25 |
| 45-39 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium Dioxide | 45-26 |
| 45-40 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Strontium Oxide | 45-26 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-41 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Molybdenum Dioxide..... | 45-27 |
| 45-42 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cesium Hydroxide..... | 45-27 |
| 45-43 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Barium Oxide | 45-28 |
| 45-44 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Dilanthanum Trioxide | 45-28 |
| 45-45 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Cerium Dioxide | 45-29 |
| 45-46 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tin | 45-29 |
| 45-47 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Tellurium..... | 45-30 |
| 45-48 | Release Category CFE, Case 3D-4 – Spurious ADS-2, Failed CMTs, Diffusion Flame: Release Fraction of Uranium Dioxide | 45-30 |
| 45-49 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Noble Gases | 45-31 |
| 45-50 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Iodide | 45-31 |
| 45-51 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium Dioxide..... | 45-32 |
| 45-52 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Strontium Oxide..... | 45-32 |
| 45-53 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Molybdenum Dioxide | 45-33 |
| 45-54 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cesium Hydroxide | 45-33 |
| 45-55 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Barium Oxide..... | 45-34 |
| 45-56 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Dilanthanum Trioxide..... | 45-34 |
| 45-57 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Cerium Dioxide..... | 45-35 |
| 45-58 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding/ Release Fraction of Tin..... | 45-35 |
| 45-59 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Tellurium | 45-36 |
| 45-60 | Release Category CFI, Case CFI – DVI Line Break, Failed Gravity Injection, No PXS Flooding: Release Fraction of Uranium Dioxide | 45-36 |
| 45-61 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Noble Gases..... | 45-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 45-62 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Iodide..... | 45-37 |
| 45-63 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium Dioxide..... | 45-38 |
| 45-64 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Strontium Oxide..... | 45-38 |
| 45-65 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Molybdenum Dioxide..... | 45-39 |
| 45-66 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cesium Hydroxide..... | 45-39 |
| 45-67 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Barium Oxide..... | 45-40 |
| 45-68 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Dilanthanum Trioxide..... | 45-40 |
| 45-69 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Cerium Dioxide..... | 45-41 |
| 45-70 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tin..... | 45-41 |
| 45-71 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Tellurium..... | 45-42 |
| 45-72 | Release Category CFL, Case CFL – SBLOCA with Failed Gravity Injection: Release Fraction of Uranium Dioxide..... | 45-42 |
| 45-73 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Noble Gases..... | 45-43 |
| 45-74 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Iodide..... | 45-43 |
| 45-75 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium Dioxide..... | 45-44 |
| 45-76 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Strontium Oxide..... | 45-44 |
| 45-77 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Molybdenum Dioxide..... | 45-45 |
| 45-78 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cesium Hydroxide..... | 45-45 |
| 45-79 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Barium Oxide..... | 45-46 |
| 45-80 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Dilanthanum Trioxide..... | 45-46 |
| 45-81 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Cerium Dioxide..... | 45-47 |
| 45-82 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tin..... | 45-47 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45-83 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Tellurium..... | 45-48 |
| 45-84 | Release Category IC, Case 3BE-5 – SBLOCA with Failed Gravity Injection Direct-Release Sensitivity: Release Fraction of Uranium Dioxide..... | 45-48 |
| 45A-1 | AP1000 Fission Product Release Fractions for Release Category CFE – Noble Gases | 45A-3 |
| 45A-2 | AP1000 Fission Product Release Fractions for Release Category CFE – CsI and RbI | 45A-3 |
| 45A-3 | AP1000 Fission Product Release Fractions for Release Category CFE – TeO ₂ | 45A-4 |
| 45A-4 | AP1000 Fission Product Release Fractions for Release Category CFE – SrO | 45A-4 |
| 45A-5 | AP1000 Fission Product Release Fractions for Release Category CFE – MoO ₂ | 45A-5 |
| 45A-6 | AP1000 Fission Product Release Fractions for Release Category CFE – CsOH and RbOH | 45A-5 |
| 45A-7 | AP1000 Fission Product Release Fractions for Release Category CFE – BaO | 45A-6 |
| 45A-8 | AP1000 Fission Product Release Fractions for Release Category CFE – La ₂ O ₃ | 45A-6 |
| 45A-9 | AP1000 Fission Product Release Fractions for Release Category CFE – CeO ₂ | 45A-7 |
| 45A-10 | AP1000 Fission Product Release Fractions for Release Category CFE – Sb | 45A-7 |
| 45A-11 | AP1000 Fission Product Release Fractions for Release Category CFE – Te ₂ | 45A-8 |
| 45A-12 | AP1000 Fission Product Release Fractions for Release Category CFE – UO ₂ | 45A-8 |
| 45A-13 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – RCS Pressure | 45A-9 |
| 45A-14 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Reactor Vessel Mixture Level..... | 45A-9 |
| 45A-15 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Core-Exit Temperature..... | 45A-10 |
| 45A-16 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – In-Vessel Hydrogen Generation | 45A-10 |
| 45A-17 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Pressure..... | 45A-11 |
| 45A-18 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Gas Temperature..... | 45A-11 |
| 45A-19 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Containment Hydrogen Concentration..... | 45A-12 |
| 45A-20 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Noble Gases Release Fraction | 45A-12 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 45A-21 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsI and RbI Release Fraction..... | 45A-13 |
| 45A-22 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – TeO ₂ Release Fraction..... | 45A-13 |
| 45A-23 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – SrO Release Fraction..... | 45A-14 |
| 45A-24 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – MoO ₂ Release Fraction | 45A-14 |
| 45A-25 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CsOH and RbOH Release Fraction..... | 45A-15 |
| 45A-26 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – BaO Release Fraction..... | 45A-15 |
| 45A-27 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – La ₂ O ₃ Release Fraction | 45A-16 |
| 45A-28 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – CeO ₂ Release Fraction | 45A-16 |
| 45A-29 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Sb Release Fraction..... | 45A-17 |
| 45A-30 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – Te ₂ Release Fraction..... | 45A-17 |
| 45A-31 | AP1000 3BE-1 Case with Intermediate DDT Containment Failure – UO ₂ Release Fraction..... | 45A-18 |
| 45A-32 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Containment Pressure | 45A-18 |
| 45A-33 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Noble Gases Release Fraction..... | 45A-19 |
| 45A-34 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsI and RbI Release Fraction..... | 45A-19 |
| 45A-35 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – TeO ₂ Release Fraction..... | 45A-20 |
| 45A-36 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – SrO Release Fraction | 45A-20 |
| 45A-37 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – MoO ₂ Release Fraction | 45A-21 |
| 45A-38 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CsOH and RbOH Release Fraction..... | 45A-21 |
| 45A-39 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – BaO Release Fraction..... | 45A-22 |
| 45A-40 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – La ₂ O ₃ Release Fraction | 45A-22 |
| 45A-41 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – CeO ₂ Release Fraction | 45A-23 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 45A-42 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Sb Release Fraction..... | 45A-23 |
| 45A-43 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – Te ₂ Release Fraction | 45A-24 |
| 45A-44 | AP1000 3BE-1 Case with no PCS Water Cooling and Late Containment Failure – UO ₂ Release Fraction..... | 45A-24 |
| 49-1 | Population Whole Body Dose – BP Source Term, 24 Hours | 49-20 |
| 49-2 | Population Whole Body Dose – BP Source Term 72 Hours | 49-20 |
| 49-3 | Site Boundary Whole Body Dose – BP Source Term, 24 Hours..... | 49-21 |
| 49-4 | Site Boundary Whole Body Dose – BP Source Term, 72 Hours..... | 49-21 |
| 49-5 | Site Boundary Red Bone Marrow Dose – BP Source Term, 24 Hours | 49-22 |
| 49-6 | Site Boundary Red Bone Marrow Dose – BP Source Term, 72 Hours | 49-22 |
| 49-7 | Site Boundary Thyroid Dose – BP Source Term, 24 Hours..... | 49-23 |
| 49-8 | Site Boundary Thyroid Dose – BP Source Term, 72 Hours..... | 49-23 |
| 49-9 | Population Whole Body Dose – CFE Source Term, 24 Hours..... | 49-24 |
| 49-10 | Population Whole Body Dose – CFE Source Term, 72 Hours..... | 49-24 |
| 49-11 | Site Boundary Whole Body Dose – CFE Source Term, 24 Hours | 49-25 |
| 49-12 | Site Boundary Whole Body Dose – CFE Source Term, 72 Hours | 49-25 |
| 49-13 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 24 Hours..... | 49-26 |
| 49-14 | Site Boundary Red Bone Marrow Dose – CFE Source Term, 72 Hours..... | 49-26 |
| 49-15 | Site Boundary Thyroid Dose – CFE Source Term, 24 Hours..... | 49-27 |
| 49-16 | Site Boundary Thyroid Dose – CFE Source Term, 72 Hours..... | 49-27 |
| 49-17 | Population Whole Body Dose – CFI Source Term, 24 Hours..... | 49-28 |
| 49-18 | Population Whole Body Dose – CFI Source Term, 72 Hours..... | 49-28 |
| 49-19 | Site Boundary Whole Body Dose – CFI Source Term, 24 Hours | 49-29 |
| 49-20 | Site Boundary Whole Body Dose – CFI Source Term, 72 Hours | 49-29 |
| 49-21 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 24 Hours..... | 49-30 |
| 49-22 | Site Boundary Red Bone Marrow Dose – CFI Source Term, 72 Hours..... | 49-30 |
| 49-23 | Site Boundary Thyroid Dose – CFI Source Term, 24 Hours..... | 49-31 |
| 49-24 | Site Boundary Thyroid Dose – CFI Source Term, 72 Hours..... | 49-31 |
| 49-25 | Population Whole Body Dose – CFL Source Term, 24 Hours..... | 49-32 |
| 49-26 | Population Whole Body Dose – CFL Source Term, 72 Hours..... | 49-32 |
| 49-27 | Site Boundary Whole Body Dose – CFL Source Term, 24 Hours | 49-33 |
| 49-28 | Site Boundary Whole Body Dose – CFL Source Term, 72 Hours | 49-33 |
| 49-29 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 24 Hours..... | 49-34 |
| 49-30 | Site Boundary Red Bone Marrow Dose – CFL Source Term, 72 Hours..... | 49-34 |
| 49-31 | Site Boundary Thyroid Dose – CFL Source Term, 24 Hours..... | 49-35 |
| 49-32 | Site Boundary Thyroid Dose – CFL Source Term, 72 Hours..... | 49-35 |
| 49-33 | Population Whole Body Dose – CI Source Term, 24 Hours | 49-36 |
| 49-34 | Population Whole Body Dose – CI Source Term, 72 Hours | 49-36 |
| 49-35 | Site Boundary Whole Body Dose – CI Source Term, 24 Hours..... | 49-37 |
| 49-36 | Site Boundary Whole Body Dose – CI Source Term, 72 Hours..... | 49-37 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|--|-------------|
| 49-37 | Site Boundary Red Bone Marrow Dose – CI Source Term, 24 Hours | 49-38 |
| 49-38 | Site Boundary Red Bone Marrow Dose – CI Source Term, 72 Hours | 49-38 |
| 49-39 | Site Boundary Thyroid Dose – CI Source Term, 24 Hours | 49-39 |
| 49-40 | Site Boundary Thyroid Dose – CI Source Term, 72 Hours | 49-39 |
| 49-41 | Population Whole Body Dose – DIRECT Source Term, 24 Hours | 49-40 |
| 49-42 | Population Whole Body Dose – DIRECT Source Term, 72 Hours | 49-40 |
| 49-43 | Site Boundary Whole Body Dose – DIRECT Source Term, 24 Hours | 49-41 |
| 49-44 | Site Boundary Whole Body Dose – DIRECT Source Term, 72 Hours | 49-41 |
| 49-45 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 24 Hours | 49-42 |
| 49-46 | Site Boundary Red Bone Marrow Dose – DIRECT Source Term, 72 Hours | 49-42 |
| 49-47 | Site Boundary Thyroid Dose – DIRECT Source Term, 24 Hours | 49-43 |
| 49-48 | Site Boundary Thyroid Dose – DIRECT Source Term, 72 Hours | 49-43 |
| 49-49 | Population Whole Body Dose – IC Source Term, 24 Hours | 49-44 |
| 49-50 | Population Whole Body Dose – IC Source Term, 72 Hours | 49-44 |
| 49-51 | Site Boundary Whole Body Dose – IC Source Term, 24 Hours | 49-45 |
| 49-52 | Site Boundary Whole Body Dose – IC Source Term, 72 Hours | 49-45 |
| 49-53 | Site Boundary Red Bone Marrow Dose – IC Source Term, 24 Hours | 49-46 |
| 49-54 | Site Boundary Red Bone Marrow Dose – IC Source Term, 72 Hours | 49-46 |
| 49-55 | Site Boundary Thyroid Dose – IC Source Term, 24 Hours | 49-47 |
| 49-56 | Site Boundary Thyroid Dose – IC Source Term, 72 Hours | 49-47 |
| 49-57 | Overall Dose Risk – Site Boundary Whole Body EDE Dose, 24 Hours | 49-48 |
| 49-58 | Overall Dose Risk – Site Boundary Red Bone Marrow Dose (Acute), 24 Hours | 49-49 |
| 51-1 | AP1000 Base Core Damage Frequency Uncertainty Analysis | 51-11 |
| 51-2 | AP1000 Sensitivity Case Uncertainty Analysis | 51-11 |
| 51B-1 | Distribution for Plant Core Damage Frequency | 51B-2 |
| 51B-2 | Safety Injection Line Break | 51B-2 |
| 51B-3 | Large LOCA | 51B-3 |
| 51B-4 | Large Spurious ADS Actuation | 51B-3 |
| 51B-5 | Small LOCA | 51B-4 |
| 51B-6 | Medium LOCA | 51B-4 |
| 51B-7 | Reactor Vessel Rupture | 51B-5 |
| 51B-8 | Steam Generator Tube Rupture | 51B-5 |
| 51B-9 | Safety Injection Line Break – Sequence 7 | 51B-6 |
| 51B-10 | Large LOCA – Sequence 9 | 51B-6 |
| 51B-11 | Spurious ADS – Sequence 8 | 51B-7 |
| 51B-12 | Safety Injection Line Break – Sequence 8d | 51B-7 |
| 51B-13 | Reactor Vessel Rupture – Sequence 2 | 51B-8 |
| 51B-14 | Small LOCA – Sequence 5 | 51B-8 |
| 51B-15 | Medium LOCA – Sequence 5 | 51B-9 |
| 51B-16 | Small LOCA – Sequence 12 | 51B-9 |
| 51B-17 | Medium LOCA – Sequence 12 | 51B-10 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 51B-18 | Spurious ADS – Sequence 9 | 51B-10 |
| 51B-19 | Spurious ADS – Sequence 7 | 51B-11 |
| 51B-20 | Safety Injection Line Break – Sequence 3..... | 51B-11 |
| 51B-21 | SGTR Event – Sequence 41..... | 51B-12 |
| 51B-22 | ATWS Precursor with no MFW – Sequence 23 | 51B-12 |
| 51B-23 | Small LOCA – Sequence 9 | 51B-13 |
| 51B-24 | Medium LOCA – Sequence 9..... | 51B-13 |
| 51B-25 | SGTR Event – Sequence 13..... | 51B-14 |
| 51B-26 | Large LOCA – Sequence 8 | 51B-14 |
| 51B-27 | CMT Line Break – Sequence 5 | 51B-15 |
| 54-1 | Loss of Offsite Power During Hot/Cold Shutdown (RCS Filled) Event Tree (Sheets 1 – 2)..... | 54-162 |
| 54-2 | Loss of RNS During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-164 |
| 54-3 | Loss of CCW/SW During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-165 |
| 54-4 | LOCA/RNS-V024 Opens During Hot/Cold Shutdown (RCS Filled) Event Tree..... | 54-166 |
| 54-5 | LOCA/RNS Pipe Rupture During Hot/Cold Shutdown (RCS Filled) Event Tree | 54-167 |
| 54-6 | Overdraining of Reactor Coolant System During Draindown to Mid-loop Event Tree..... | 54-168 |
| 54-7 | Loss of Offsite Power During RCS Drained Condition Event Tree | 54-169 |
| 54-8 | Loss of RNS During RCS Drained Condition Event Tree | 54-170 |
| 54-9 | Loss of CCW/SW During RCS Drained Condition Event Tree..... | 54-171 |
| 54-10 | LOCA/RNS-V024 Opens During RCS Drained Condition Event Tree..... | 54-172 |
| 55-1 | Seismic Initiating Event Hierarchy Tree | 55-30 |
| 57-1 | Example Event Tree Model..... | 57-125 |
| 57-2 | Contribution of Plant Areas to Fire CDF | 57-126 |
| 57-3 | Contribution of Fire Area to Fire CDF..... | 57-127 |
| 57A-1 | DAS-ACT Fault Tree..... | 57A-37 |
| 57C-1 | 0000 AF 00 Yard Building (Including Transformer Yard)..... | 57C-12 |
| 57C-2 | 1200 AF 01 RCA of Auxiliary Building (All Zones)..... | 57C-13 |
| 57C-3 | 1200 AF 02 New Fuel and Used Fuel Storage, Waste Disposal Container (All Zones)..... | 57C-14 |
| 57C-4 | 1200 AF 03 Corridors 100' & 117' 6" | 57C-15 |
| 57C-5 | 1201 AF 02 Division B Batteries/DC Equipment Room/Instrumentation and Control..... | 57C-16 |
| 57C-6 | 1201 AF 03 Division D DC Equipment/I&C..... | 57C-17 |
| 57C-7 | 1201 AF 04 Division B/D VBS Equipment..... | 57C-18 |
| 57C-8 | 1201 AF 05 MSIV Compartment A..... | 57C-19 |
| 57C-9 | 1201 AF 06 MSIV Compartment B | 57C-20 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 57C-10 | 1202 AF 02 Northeast Elevator Shaft | 57C-21 |
| 57C-11 | 1202 AF 03 Division C Batteries/DC Equipment/I&C Room/ RCP Trip Switchgear Room/I&C Penetration Room | 57C-22 |
| 57C-12 | 1202 AF 04 Division A Electrical Equipment/Battery Room/I&C Room..... | 57C-23 |
| 57C-13 | 1204 AF 01 RNS Pump Room B | 57C-24 |
| 57C-14 | 1204 AF 03 South Shield Building Elevator Shaft | 57C-25 |
| 57C-15 | 1205 AF 02 Southeast Elevator Shaft | 57C-26 |
| 57C-16 | 1210 AF 01 Corridor/Spare Battery Room/Spare Room/Spare Battery Charger Room | 57C-27 |
| 57C-17 | 1220 AF 01 Division B RCP Trip Switchgear/Spare Room/Corridor 82' 6" | 57C-28 |
| 57C-18 | 1220 AF 02 Lower Annulus Valve Area..... | 57C-29 |
| 57C-19 | 1230 AF 01 Corridor Division A, B, C, D and Remote Shutdown Workstation..... | 57C-30 |
| 57C-20 | 1230 AF 02 Non-Class 1E Electrical Compartment - 100' | 57C-31 |
| 57C-21 | 1232 AF 01 Remote Shutdown Workstation..... | 57C-32 |
| 57C-22 | 1240 AF 01 Non-Class 1E Electrical Compartment - 117' | 57C-33 |
| 57C-23 | 1242 AF 02 Division A Penetration Area | 57C-34 |
| 57C-24 | 1243 AF 01 Reactor Trip Switchgear I | 57C-35 |
| 57C-25 | 1243 AF 02 Reactor Trip Switchgear II | 57C-36 |
| 57C-26 | 1250 AF 01 Nonradioactive Ventilation System..... | 57C-37 |
| 57C-27 | 2000 AF 01 Turbine Building Floor | 57C-38 |
| 57C-28 | 2003 AF 01 Auxiliary Boiler Equipment Room | 57C-39 |
| 57C-29 | 2009 AF 02 Elevator Machine Room..... | 57C-40 |
| 57C-30 | 2033 AF 02 Motor-Driven Fire Pump Room | 57C-41 |
| 57C-31 | 2040 AF 01 Clean and Dirty Lube Oil Storage..... | 57C-42 |
| 57C-32 | 2043 AF 01 Chemical Laboratory..... | 57C-43 |
| 57C-33 | 2050 AF 01 Lube Oil Conditioner Room..... | 57C-44 |
| 57C-34 | 2052 AF 01 Southwest 6.9KV Switchgear Room..... | 57C-45 |
| 57C-35 | 2053 AF 01 Electrical Equipment Room | 57C-46 |
| 57C-36 | 2053 AF 02 Northwest 6.9KV Switchgear Room..... | 57C-47 |
| 57C-37 | 4003 AF 01 Demineralized Water Deoxygenating Room/ Air Handling Equipment Rooms..... | 57C-48 |
| 57C-38 | 4031 AF 01 Battery Room and Battery Charger Room 1 | 57C-49 |
| 57C-39 | 4031 AF 02 Battery Room and Battery Charger Room 2/ Computer Room B/Shift Turnover Room | 57C-50 |
| 57C-40 | 4031 AF 05 Corridor/Spare Battery Room/Spare Room/ Spare Battery Charger Room..... | 57C-51 |
| 57C-41 | 4031 AF 06 Central Alarm Station/Security Room 1 | 57C-52 |
| 57C-42 | 4032 AF 01 Decontamination Room, Non-Radiological and Radiological Controlled Area Entry/Exit Area..... | 57C-53 |
| 57C-43 | 4032 AF 02 Containment Access Corridor Elevation 107' 2" | 57C-54 |
| 57C-44 | 4033 AF 01 Hot Machine Shop | 57C-55 |
| 57C-45 | 4034 AF 01 General Offices | 57C-56 |
| 57C-46 | 4041 AF 01 Conference Rooms/Computer Room A/Corridor..... | 57C-57 |

LIST OF FIGURES (Cont.)

| <u>Figure No.</u> | <u>Title</u> | <u>Page</u> |
|-------------------|---|-------------|
| 57C-47 | 4041 AF 02 Corridor/Restroom | 57C-58 |
| 57C-48 | 4042 AF 01 Non-Class 1E Switchgear #1..... | 57C-59 |
| 57C-49 | 4042 AF 02 Non-Class 1E Switchgear #2..... | 57C-60 |
| 57C-50 | 4052 AF 01 Staging and Storage Area/Containment Air Filtration Exhaust Rooms A & B..... | 57C-61 |
| 57C-51 | 5031 AF 01 Radwaste Building..... | 57C-62 |
| 57C-52 | 6030 AF 01 Diesel Generator Room A..... | 57C-63 |
| 57C-53 | 6030 AF 02 Diesel Generator Room B..... | 57C-64 |
| 57C-54 | 6030 AF 03 Fuel Oil Day Tank Room A..... | 57C-65 |
| 57C-55 | 6030 AF 04 Fuel Oil Day Take Room B..... | 57C-66 |
| 57C-56 | 1100 AF 11204 Reactor Coolant Drain Tank Room..... | 57C-67 |
| 57C-57 | 1100 AF 11206 Accumulator Room A..... | 57C-68 |
| 57C-58 | 1100 AF 11207 Accumulator Room B..... | 57C-69 |
| 57C-59 | 1100 AF 11208 RNS Valve Room..... | 57C-70 |
| 57C-60 | 1100 AF 11300A Maintenance Floor (SE Quadrant Access)..... | 57C-71 |
| 57C-61 | 1100 AF 11300B Maintenance Floor (NNE Quadrant) and RCDT Access..... | 57C-72 |
| 57C-62 | 1100 AF 11301 SG Compartment 1..... | 57C-73 |
| 57C-63 | 1100 AF 11302 SG Compartment 2..... | 57C-74 |
| 57C-64 | 1100 AF 11303 Pressurizer Compartment..... | 57C-75 |
| 57C-65 | 1100 AF 11303A ADS Lower Valve Area..... | 57C-76 |
| 57C-66 | 1100 AF 11303B ADS Upper Valve Area..... | 57C-77 |
| 57C-67 | 1100 AF 11500 Operating Deck..... | 57C-78 |
| 57C-68 | 1200 AF 12341 Middle Annulus..... | 57C-79 |
| 57C-69 | 1200 AF 12555 Main Control Room Emergency Habitability System Air Storage/Operating Deck Staging Area..... | 57C-80 |
| 59-1 | Contribution of Initiating Events to Core Damage..... | 59-99 |
| 59-2 | 24-Hour Site Boundary Dose Cumulative Frequency Distribution..... | 59-100 |

REVISION 1 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 1 Change Roadmap | ci through civ | Editorial |
| 1 | 1-6 | Editorial |
| 3 | 3-4 | Editorial |
| Attachment 4B | 4B-24 | 720.027 |
| Attachment 4B | 4B-74 | Editorial |
| 6 | 6-9 | 720.025 (720.029) |
| 6 | 6-12 | 720.025 (720.029) Editorial |
| 6 | 6-16 | Editorial |
| 6 | 6-17 | 720.026 |
| 6 | 6-19 through 6-53 | 720.023 (720.024) (720.097) |
| 6 | 6-62 | 720.031 |
| 6 | 6-69 | 720.025 (720.029) |
| 6 | 6-71 | 720.025 (720.029) |
| 8 | 8-23 and 8-25 | Editorial |
| 12 | 12-6 | 720.033 |
| 12 | 12-30 | 720.033 |
| 26 | 26-11 and 26-12 | Editorial |
| 28 | 28-10 and 28-11 | Editorial |
| 29 | 29-17 | 720.033 |
| 29 | 29-21 | 720.033 |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|---|
| 30 | 30-35 and 30-36 | 720.068 |
| 30 | 30-66 and 30-67 | 720.068 |
| 30 | 30-110 | Editorial |
| 34 | 34-1 | 720.042 |
| 34 | 34-4 and 34-5 | 720.042 |
| 34 | 34-6 and 34-7 | 720.042 |
| | | Editorial |
| 34 | 34-8 through 34-243 | 720.042 |
| 35 | 35-28 | 720.043 |
| 39 | 39-4 | 720.073 Editorial |
| 39 | 39-5 | 720.088 (720.048, 720.074, 720.083, 720.089) |
| 39 | 39-6 | 720.088 720.073 (720.048, 720.074, 720.083, and 720.089) |
| 39 | 39-12 | Editorial |
| 39 | 39-19 | Editorial |
| 39 | 39-20 | 720.073 |
| 39 | 39-21 | Editorial |
| Attachment 39A | 39A-1 through 39A-40 | 720.088 (720.048, 720.074, 720.083, and 720.089) |
| 41 | 41-6 | 720.042 |
| 41 | 41-15 | 720.093 |
| 41 | 41-20 | 720.054 |
| 41 | 41-31 | Editorial |
| Attachment 41A | 41A-1 through 41A-228 | 720.042 |
| Attachment 41B | 41B-1 through 41B-11 | 720.093 |
| 43 | 43-126 and 43-127 | Editorial |
| Attachment 43C | 43C-1 and 43C-2 | 720.043 |
| 44 | 44-7 | Editorial |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|----------------------|--|
| 45 | 45-1 through 45-3 | 470.013 (470.012) |
| 45 | 45-4 | 470.013 (470.012) Editorial |
| 45 | 45-5 through 45-48 | 470.013 (470.012) |
| 49 | 49-1 | 720.056 |
| 49 | 49-4 through 49-6 | 720.056 |
| 49 | 49-9 through 49-49 | 720.056 |
| 50 | 50-14 | 720.034 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 57 | 57-1 through 57-109 | Letter DCP/NRC1515 |
| Attachment 57A | 57A-1 through 57A-37 | Letter DCP/NRC1515 |
| Attachment 57B | 57B-1 through 57B-6 | Letter DCP/NRC1515 |
| Attachment 57C | 57C-1 through 57C-80 | Letter DCP/NRC1515 |
| Attachment 57D | 57D-1 through 57D-7 | Letter DCP/NRC1515 |
| 59 | 59-20 and 59-21 | Editorial |
| 59 | 59-23 through 59-25 | Letter DCP/NRC1515 |
| 59 | 59-26 | 720.056 |
| 59 | 59-28 | Editorial |
| 59 | 59-29 through 59-32 | 720.038 |
| 59 | 59-34 through 59-38 | 720.038 |
| 59 | 59-72 | Editorial |
| 59 | 59-73 | Technical |
| 59 | 59-83 | Editorial |
| 59 | 59-75 through 59-96 | 720.038 |
| 59 | 59-97 | 720.038 720.066 |
| 59 | 59-98 | 720.038 |
| 59 | 59-100 | Technical |

REVISION 1 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change</u> ⁽¹⁾ |
|----------------|-------------------|--------------------------------------|
| Appendix A | A-1 through A-166 | 720.007 |
| | | 720.010 |
| | | 720.011 |
| | | 720.012 |
| | | 720.013 |
| | | 720.015 |
| | | 720.016 |
| Appendix B | B-6 | 720.058 |
| Appendix B | B-13 | 720.076 |
| Appendix D | D-14 and D-15 | 720.078 |
| Appendix D | D-31 | 720.078 |
| Appendix D | D-35 and D-36 | Technical |
| Appendix D | D-37 through D-58 | 720.078 |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number. RAI number in parenthesis contains a reference to RAI response listed above.

REVISION 2 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through c | Editorial |
| Revision 2 Change Roadmap | cv through cvii | Editorial |
| 6 | 6-17 | 720.026 (R1) |
| 6 | 6-28 | 720.024 (R1) |
| 6 | 6-32 and 6-33 | 720.024 (R1) |
| 6 | 6-37 through 6-39 | 720.024 (R1) |
| 6 | 6-41 | 720.024 (R1) |
| 6 | 6-50 through 6-53 | 720.024 (R1) |
| 6 | 6-69 | 720.029 (R1) |
| 24 | 24-17 | 720.046 (R1) |
| 24 | 24-22 and 24-23 | 720.046 (R1) |
| 24 | 24-27 | 720.046 (R1) |
| 30 | 30-26a through 30-28 | 720.029 (R1) |
| 35 | 35-28 | 720.043 (R1) |
| 43 | 43-9 and 43-9a | 720.039 (R2) |
| 43 | 43-9b | Editorial |
| 43 | 43-10a | 720.039 (R2) |
| 43 | 43-10b | Editorial |
| 43 | 43-93a through 43-93w | 720.039 (R2) |
| 43 | 93-93x | Editorial |
| Attachment 43C | 43C-2 | 720.043 (R1) |
| 50 | 50-1 | |
| 50 | 50-1a and 50-1b | Editorial |
| 50 | 50-14 | 720.039 (R2) |
| 50 | 50-14a | 720.039 (R2) |
| 50 | 50-14b | Editorial |
| 54 | 54-1 through 54-131 | 720.038 (R2) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|-------------------------------------|
| 56 | 56-1 | 720.038 (R1) Editorial |
| 56 | 56-9 | Editorial |
| 56 | 56-17 and 56-18 | Editorial |
| 56 | 56-20 | Editorial |
| 56 | 56-36 and 56-37 | Editorial |
| 56 | 56-38 | Editorial 720.038 (R1) |
| 56 | 56-38a through 56-38k | 720.038 (R1) |
| 56 | 56-38l | Editorial |
| 56 | 56-47 through 56-49 | Editorial |
| 56 | 56-51 | Editorial |
| 56 | 56-54 and 56-55 | 720.038 (R1) |
| 57 | 57-14 and 57-15 | 280.011 (R1) |
| 57 | 57-15a and 57-15b | Editorial |
| 59 | 59-23 and 59-23a | 720.038 (R1) |
| 59 | 59-23b | Editorial |
| 59 | 59-34 | 720.038 (R1) |
| 59 | 59-72 | 720.038 (R1) |
| Appendix A | A-12 | Editorial |
| Appendix A | A-24 through A-26 | 440.014 (R1) |
| Appendix A | A-26a | 440.014 (R1) 720.024 (R1) |
| Appendix A | A-26b | Editorial |
| Appendix A | A-27 | 720.012 (R1) |
| Appendix A | A-31 | 720.012 (R1) |
| Appendix A | A-33 | 720.010 (R1) |
| Appendix A | A-33a and A-33b | Editorial |
| Appendix A | A-44 | Editorial |
| Appendix A | A-57 through A-61 | 720.012 (R1) |
| Appendix A | A-63 | 720.012 (R1) |
| Appendix A | A-66 | 720.012 (R1) |
| Appendix A | A-103a through A-103b | 440.014 (R1) |
| Appendix A | A-103c and A-103d | 720.012 (R1) |
| Appendix A | A-151 and A-152 | 720.013 (R1) |
| Appendix A | A-165 and A-166 | 720.013 (R1) |

REVISION 2 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------|-------------------------------------|
| Appendix D | D-13 and D-14 | 720.080 (R1) |
| Appendix D | D-35 and D-36 | 720.080 (R1) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 3 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through cii | Editorial |
| Revision 3 Change Roadmap | cx | Editorial |
| Attachment 45A | 45A-1 through 45A-24 | Technical |
| 57 | 57-1 and 57-2 | Editorial |
| 57 | 57-4 | Editorial |
| 57 | 57-11 and 57-12 | Editorial |
| 57 | 57-17 | Editorial |
| 57 | 57-22 and 57-23 | Editorial |
| 57 | 57-30 through 57-39 | 720.038 (R1) |
| 57 | 57-40 | 720.038 (R1) |
| | | Editorial |
| 57 | 57-41 and 57-42 | 720.038 (R1) |
| 57 | 57-78 | Editorial |
| 57 | 57-117 through 57-124 | 720.038 (R1) |
| Appendix A | A-23 through A-25 | 720.009 (R2) |
| Appendix A | A-105 through A-111 | 720.009 (R2) |

1. Changes incorporated as a result of Westinghouse responses to NRC Request for Additional Information (RAI) identified by RAI number.

REVISION 4 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------------|---|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 4 Change Roadmap | cxii and cxiii | Editorial |
| 34 | 34-4 | Editorial |
| 34 | 34-16 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-19 through 34-21 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-50 and 34-51 | DSER OI 19.1.10.3-1 (R1) |
| 34 | 34-247 through 34-264 | DSER OI 19.1.10.3-1 (R1) |
| 42 | 42-3 | DSER OI 19.2.6-1 (R1) |
| 42 | 42-6 | DSER OI 19.2.6-3 |
| 42 | 42-7 and 42-8 | Editorial |
| 43 | 43-10 | Editorial |
| 43 | 43-13 | Editorial |
| Attachment 43D | 43D-1 | DSER OI 19.1.3.2-1 |
| Attachment 43E | 43E-1 and 43E-2 | DSER OI 19.1.3.2-2 |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-5 and 45-6 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-13 through 45-18 | DSER OI 19.1.10.3-1 (R1) |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R1) |
| Attachment 45A | 45A-1 through 45A-24 | Deleted per DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-6 | DSER OI 19.1.10.3-1 (R1) |
| 49 | 49-9 through 49-49 | DSER OI 19.1.10.3-1 (R1) |
| 50 | 50-1 | Editorial |
| 54 | 54-9 | DSER OI 19.1.10.2-3 |
| 54 | 54-12 | DSER OI 19.1.10.2-3 |
| 54 | 54-13 | Editorial |
| 54 | 54-22 through 54-71 | Editorial |
| 54 | 54-76 through 54-80 | DSER OI 19.1.10.2-5 Editorial |

REVISION 4 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|----------------|-----------------------|---|
| 54 | 54-83 through 54-110 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-112 through 54-118 | DSER OI 19.1.10.2-5 Editorial |
| 54 | 54-121 through 54-137 | DSER OI 19.1.10.2-3 |
| 55 | 55-5 | DSER OI 19A.2-5 (R1) |
| 55 | 55-7 | DSER OI 19A.2-4 (R1) DSER OI 19A.2-5 (R1) DSER OI 19A.2-6 (R1) Editorial |
| 55 | 55-16 through 55-18 | Editorial |
| 55 | 55-20 | DSER OI 19A.2-6 (R1) |
| 55 | 55-25 through 55-29 | Editorial |
| 56 | 56-46 | DSER OI 19.3.10-1 |
| 59 | 59-26 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-37 | DSER OI 19A.3-2 (R1) |
| 59 | 59-45 through 59-70 | Editorial |
| 59 | 59-73 | DSER OI 19.1.10.3-1 (R1) |
| 59 | 59-74 | Editorial |
| 59 | 59-100 | DSER OI 19.1.10.3-1 (R1) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 5 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|---------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 5 Change Roadmap | cxiv and cxv | Editorial |
| 43 | 43-10 and 43-11 | DSER OI 19.1.3.2-2 (R1) |
| 45 | 45-2 | DSER OI 19.1.10.3-1 (R2) |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R2) Editorial |
| 45 | 45-31 through 45-42 | DSER OI 19.1.10.3-1 (R2) |
| 54 | 54-3 | Editorial |
| 54 | 54-11 | DSER OI 19.1.10.2-4 (R1) |
| 54 | 54-76 through 54-99 | DSER OI 19.1.10.2-4 (R1) |
| 55 | 55-23 | DSER OI 19A.2-8 (R2) |
| 59 | 59-45 | Editorial |
| 59 | 59-77 | Editorial |
| 59 | 59-81 | Editorial |
| 59 | 59-83 | Editorial |
| 59 | 59-90 | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.1-2 (R2) |
| Appendix A | A-8 | Editorial |
| Appendix A | A-17 | Editorial |
| Appendix A | A-19 | Editorial |
| Appendix A | A-21 | Editorial |
| Appendix A | A-23 and A-24 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-25 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-43 | Editorial |
| Appendix A | A-45 and A-46 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-47 and A-48 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-104 through A-109 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-154 through A-158 | DSER OI 19.1.10.1-5 (R2) |

REVISION 5 CHANGE ROADMAP (Cont.)

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|-----------------------|------------------------|--|
| Appendix A | A-159 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-160 and A-161 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-162 and A-163 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-164 through A-175 | DSER OI 19.1.10.1-5 (R2) |
| Appendix A | A-176 and A-177 | DSER OI 19.1.10.1-5 (R2) Editorial |
| Appendix A | A-178 through A-181 | DSER OI 19.1.10.1-5 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 6 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|---------------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 6 Change Roadmap | cxvi | Editorial |
| 45 | 45-3 | DSER OI 19.1.10.3-1 (R3) |
| 55 | 55-11 | Editorial |
| 55 | 55-20 | Editorial |
| 55 | 55-21 through 55-24 | Editorial (per Oct. 6-9 meeting) |
| 59 | 59-98 | DSER OI 19.1.10.2-6 (R2) |
| Appendix A | A-41 | DSER OI 21.5-2 |
| Appendix A | A-46 and A-47 | DSER OI 15.2.7-1 Item 7 (R5) |
| Appendix A | A-135 through A-141 | DSER OI 21.5-2 |
| Appendix A | A-154 through A-167 | DSER OI 15.2.7-1 Item 7 (R5) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 7 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 7 Change Roadmap | cxvii | Editorial |
| 59 | 59-98 | DSER OI 19.1.10.2-1 (R2) |

1. Changes incorporated as a result of Draft Safety Evaluation Report (DSER) Open Item (OI) Response identified by DSER OI number.

REVISION 8 CHANGE ROADMAP

| <u>Section</u> | <u>Page No.</u> | <u>Type of Change⁽¹⁾</u> |
|--|-----------------|-------------------------------------|
| AP1000 Document Cover Sheet | | Editorial |
| Probabilistic Risk Assessment, Title Page | | Editorial |
| T of C | i through ciii | Editorial |
| Revision 8 Change Roadmap | cxviii | Editorial |
| 59 | 59-92 | NRC Comments |
| 59 | 59-98 | NRC Comments |