



Entergy Nuclear Northeast  
Entergy Nuclear Operations, Inc.  
James A. Fitzpatrick NPP  
P.O. Box 110  
Lycoming, NY 13093  
Tel 315 349 6024 Fax 315 349 6480

March 15, 2005  
JAFP-05-0039

T.A. Sullivan  
Site Vice President - JAF

United States Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, DC 20555-0001

Subject: James A. FitzPatrick Nuclear Power Plant  
Docket No. 50-333  
**Core Operating Limits Report**  
**Revision 16 (Cycle 17 update)**

Dear Sir;

Attached is Revision 16 to the James A. FitzPatrick (JAF) Core Operating Limits Report (COLR). This report is submitted in accordance with Technical Specifications (T.S.) 5.6.5.

Revision 16 of the COLR incorporates T.S. Amendment No. 281 regarding minimum critical power ratio (MCPR) limits. The Amendment revised the safety limit values in TS 2.1.1.2 for the safety limit MCPR (SLMCPR) for both single and two recirculation loop operation. The COLR incorporates the new operating limit MCPR (OLMCPR) to reflect the T.S. SLMCPR and associated reference.

In addition, editorial corrections and administrative changes are included that do not alter the intent.

There are no commitments contained in this letter.

Questions concerning this report may be addressed to Mr. William Drews at (315) 349-6562.

Very truly yours,

  
T.A. SULLIVAN

TAS:GB:dr

Attachment as stated

cc: next page

A001

cc:

Regional Administrator  
U.S. Nuclear Regulatory Commission  
475 Allendale Road  
King of Prussia, PA 19406

Office of the Resident Inspector  
U.S. Nuclear Regulatory Commission  
P.O. Box 136  
Lycoming, New York 13093

Mr. Patrick D. Milano, Project Manager  
Project Directorate I  
Division of Licensing Project Management  
U.S. Nuclear Regulatory Commission  
Mail Stop 8C2  
Washington, DC 20555



ENTERGY NUCLEAR OPERATIONS, INC.  
JAMES A. FITZPATRICK NUCLEAR POWER PLANT  
REPORT

CORE OPERATING LIMITS REPORT  
REVISION 16

REVIEWED BY: ONSITE SAFETY REVIEW COMMITTEE *Q*

MEETING NO. 05-009

DATE: 3/3/05

APPROVED BY: William Drews *William Drews*

REACTOR ENGINEERING SUPERINTENDENT

DATE: 3/3/05

APPROVED BY: Kevin Mulligan *Kevin Mulligan*

GENERAL MANAGER - PLANT OPERATIONS

DATE: 3-3-05

## TABLE OF CONTENTS

<u>SECTION</u>		<u>PAGE</u>
1.0	PURPOSE.....	3
2.0	APPLICABILITY.....	3
3.0	REFERENCES .....	3
4.0	DEFINITIONS.....	4
5.0	RESPONSIBILITIES .....	5
6.0	SPECIAL INSTRUCTIONS/REQUIREMENTS .....	5
7.0	PROCEDURE.....	6
7.1	Operating Limit MCPR.....	6
7.2	Average Planar Linear Heat Generation Rate (APLHGR).....	8
7.3	Linear Heat Generation Rate (LHGR).....	8
7.4	APRM Trip Settings.....	9
7.5	RBM Upscale Rod Block Trip Setting .....	10
7.6	Stability Option 1-D Exclusion Region and Buffer Zone.....	10
7.7	$K_f$ - Flow Dependent MCPR Limit.....	11
8.0	FIGURES AND TABLES .....	12
9.0	EXHIBITS.....	13

## 1.0 PURPOSE

This report provides the cycle-specific operating limits for Cycle 17 of the James A. FitzPatrick Nuclear Power Plant. The following limits are addressed:

- Operating Limit Minimum Critical Power Ratio (MCPR)
- Flow Dependent MCPR Limits
- Average Planar Linear Heat Generation Rate (APLHGR)
- Linear Heat Generation Rate (LHGR)
- Flow-Biased Average Power Range Monitor (APRM) and Rod Block Monitor (RBM) Settings
- Stability Option ID Exclusion Region

## 2.0 APPLICABILITY

The plant shall be operated within the limits specified in this report. If any of these limits are exceeded, the corrective actions specified in the Technical Specifications shall be taken.

## 3.0 REFERENCES

- 3.1 JAFNPP Administrative Procedure 12.05, Control of Core Operating Limits Report.
- 3.2 JAFNPP Technical Specifications.
- 3.3 Design Change Package ER-JF-03-0155, Cycle 17 Core Reload
- 3.4 RAP-7.3.17, Core Monitoring Software and Database Changes.
- 3.5 Plant Operation Up To 100% Power With One Steam Line Isolated, JAF-SE-96-035.
- 3.6 James A. FitzPatrick Nuclear Power Plant  $K_f$  Curve Update, GE-NE-J11-03426-00-01, September 1998.
- 3.7 General Electric Standard Application for Reload Fuel, NEDE-24011-P-A-14
- 3.8 GNF Report, Supplemental Reload Licensing Report for James A. FitzPatrick Reload 16 Cycle17, 0000-0026-1984SRLR, Rev.0, Class I, September, 2004.
- 3.9 JAF-SE-00-032, Rev.0, Extended Loadline Limit Analysis (ELLLA) Implementation.

- 
- 3.10 JAF-RPT-MISC-04054, Rev.0, Operation under Extended Loadline Limit Analysis (ELLLA) and Power Uprate
  - 3.11 GE Letter, FitzPatrick APRM Flow Biased Rod Block and Scram Setpoints, NSA01-273, July 3, 2001
  - 3.12 GE Letter, R. Kingston to P. Lemberg, Scram Time Versus Notch Positions for Option B, REK-E: 02-009, May 28, 2002
  - 3.13 GE Report, James A. FitzPatrick Nuclear Power Plant Final Feedwater Temperature Reduction NEDC-33077, September 2002.
  - 3.14 JD-02-122, Final Feedwater Temperature Reduction Implementation.
  - 3.15 GE Report, GE14 Fuel Design Cycle-Independent Analyses for J. A. Fitzpatrick Nuclear Power Plant, GE-NE-0000-0002-1752-01P, Rev. 0, DRF 0000-0002-1752, September 2002.
  - 3.16 GNF Report, GNF Report, Fuel Bundle Information Report for James A. FitzPatrick Reload 16 Cycle 17, 0000-0026-1984FBIR, Revision 0, September 2004.
  - 3.17 GNF Report, Supplemental Reload Licensing Report for James A. FitzPatrick Reload 15 Cycle16, 0003-9220SRLR, Rev.0, Class I, August, 2002.
  - 3.18 GNF Report, Validation of FitzPatrick Cycle 16 Exclusion and Buffer Region Application for Cycle 17 Operation Up to 6000 MWD/ST Exposure, GE-NE-0000-0033-3112-R0, October 8, 2004
  - 3.19 GNF Letter, Updated SLMCPRs for JAF Cycle 17, February 28, 2005

#### 4.0 DEFINITIONS

##### 4.1 Average Planar Linear Heat Generation Rate (APLHGR):

The APLHGR shall be applicable to a specific planar height and is equal to the sum of the heat generation rate per unit length of fuel rod for all the fuel rods in the specified assembly at the specified height divided by the number of fuel rods in the fuel assembly at the height.

##### 4.2 Fraction of Limiting Power Density:

The ratio of the linear heat generation rate (LHGR) existing at a given location to the design LHGR. The design LHGR is given in Table 8.2.

##### 4.3 Linear Heat Generation Rate(LHGR):

The LHGR shall be the heat generation rate per unit length of fuel rod. It is the integral of the heat flux over the heat transfer area associated with the unit length.

- 4.4 Maximum Fraction of Limiting Power Density (MFLPD):  
The MFLPD shall be the largest value of the fraction of limiting power density in the core. The fraction of limiting power density shall be the LHGR existing at a given location divided by the specified LHGR limit for that bundle type.
- 4.5 Minimum critical power ratio (MCPR):  
The MCPR shall be the smallest critical power ratio (CPR) that exists in the core for each type of fuel. The CPR is that power in the assembly that is calculated by application of the appropriate correlation(s) to cause some point in the assembly to experience boiling transition, divided by the actual assembly operating power.
- 4.6 Rated Recirculation Flow :  
That drive flow which produces a core flow of  $77.0 \times 10^6$  lb/hr.

## 5.0 RESPONSIBILITIES

**NOTE:** See AP-12.05 (Reference 3.1).

### 5.1 Shift Manager:

Assure that the reactor is operated within the limits described herein.

### 5.2 Reactor Engineering Superintendent:

Assure that the limits described herein are properly installed in the 3D-Monicores databank used for thermal limit surveillance (Reference 3.4)

## 6.0 SPECIAL INSTRUCTIONS/REQUIREMENTS

Not Applicable

**7.0 PROCEDURE****7.1 Operating Limit MCPR**

During operation, with thermal power  $\geq 25\%$  of rated thermal power, the Operating Limit MCPR shall be equal to or greater than the limits given below.

7.1.1 Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)

7.1.2 The Operating Limit MCPR shall be determined based on the following requirement:

7.1.2.1 The average scram time to notch position 36 shall be:

$$\tau_{AVE} \leq \tau_B$$

7.1.2.2 The average scram time to notch position 36 is determined as follows:

$$\tau_{AVE} = \frac{\sum_{i=1}^n N_i \tau_i}{\sum_{i=1}^n N_i}$$

**WHERE:**

n = Number of surveillance tests performed to date in the cycle,

N<sub>i</sub> = Number of active rods measured in the surveillance i

$\tau_i$  = Average scram time to notch position 36 of all rods measured in surveillance test i.



7.1.2.3. The adjusted analysis mean scram time is calculated as follows:

$$\tau_B(\text{sec}) = \mu + 1.65 \sigma \left[ \frac{N_1}{\sum_{i=1}^n N_i} \right]^{1/2}$$

WHERE:

- $\mu$  = Mean of the distribution for the average scram insertion time to the dropout of notch position 36 = 0.830 sec.
- $\sigma$  = Standard deviation of the distribution for average scram insertion time to the dropout of notch position 36 = 0.019 sec.
- $N_1$  = The total number of active rods measured in Technical Specification SR 3.1.4.4.

The number of rods to be scram tested and the test intervals are given in Technical Specification LCO 3.1.4, Control Rod Scram Times

7.1.3 When requirement of 7.1.2.1 is met, the Operating Limit MCPR shall not be less than that specified in Table 8.1, Table 8.1.A, Table 8.1.B or Table 8.1.C as applicable.

7.1.4 **WHEN** the requirement 7.1.2.1 is not met (i.e.  $\tau_B < \tau_{AVE}$ ), **THEN** the Operating Limit MCPR values (as a function of  $\tau$ ) are given in Figure 8.1, Figure 8.1.A, Figure 8.1.B or Figure 8.1.C as applicable.

$$\tau = \frac{(\tau_{AVE} - \tau_B)}{(\tau_A - \tau_B)}$$

WHERE:

- $\tau_{AVE}$  = The average scram time to notch position 36 as defined in 7.1.2.2.
- $\tau_B$  = The adjusted analysis mean scram time as defined in 7.1.2.3.
- $\tau_A$  = the scram time to notch position 36 as defined in Technical Specification Table 3.1.4-1.

**NOTE:** IF the operating limit MCPR obtained from these figures is determined to be less than the operating limit MCPR found in 7.1.3, THEN 7.1.3 shall apply.

7.1.5 During single-loop operation, the Operating Limit MCPR shall be increased by 0.02.

7.1.6 During reactor power operation with core flow less than 100 percent of rated, the Operating Limit MCPR shall be multiplied by the appropriate  $K_f$  specified in Figure 8.2.

## 7.2 Average Planar Linear Heat Generation Rate (APLHGR)

7.2.1 Technical Specification LCO 3.2.1, Average Planar Linear Heat Generation Rate (APLHGR)

7.2.2 During operation, with thermal power  $\geq$  25% rated thermal power, the APLHGR shall be within the limits given in Tables 8.3 and 8.3.A (Figures 8.3 and 8.3.A) for the appropriate fuel type.

7.2.3 During single loop operation, the APLHGR for each fuel type shall not exceed the values given in 7.2.2 above multiplied by the appropriate value (0.78 for GE12 and GE14 fuel).

## 7.3 Linear Heat Generation Rate (LHGR)

7.3.1 Technical Specification LCO 3.2.3, Linear Heat Generation Rate (LHGR)

7.3.2 During operation, with thermal power  $\geq$  25% rated thermal power, the LHGR for each fuel rod as a function of axial location and exposure shall be within limits based on applicable LHGR limit values given in Tables 8.2 and 8.2.A for appropriate fuel and rod type.

7.3.3 During single loop operation, the LHGR for each fuel type shall not exceed the values given in 7.3.2 above multiplied by the appropriate value (0.78 for GE12 and GE14 fuel).

7.4 **APRM Trip Settings**7.4.1 **APRM Flow Referenced Flux Scram Trip Setting (Run Mode)**

7.4.1.1. **Technical Specifications:**  
 LCO 3.2.4, Average Power Range Monitor (APRM) Gain and Setpoint  
 LCO 3.3.1.1, Reactor Protection System (RPS) Instrumentation

7.4.1.2. When operating in Mode 1, the APRM Neutron Flux-High (Flow Biased) Trip setting shall be:

$$S \leq 0.58W + 66\% \text{ for two loop operation;}$$

$$S \leq 0.58W + 66\% - 0.58 \Delta W \text{ for single loop operation;}$$

**WHERE:**

S = Setting in percent of rated thermal power;

W = Recirculation flow in percent of rated;

$\Delta W$  = Difference between two loop and single-loop effective drive flow at the same core flow.

**NOTE:** Concerning APRM Neutron Flux-High (Flow Biased) Rod Block and Scram Trip settings: Reference 3.11 establishes Equivalent Analytical Limits for these settings. The nominal trip setpoint  $S \leq 0.58W + 62\%$  (with clamp at 117%) for the Scram. Compliance with the "Allowed Region of Operation" on the Power-Flow Map, Figure 3.7-1 of the FSAR is defined by the equation  $0.58W + 50\%$  and is individually controlled and assures boundaries are not exceeded during normal operation.

7.4.1.3. In the event of operation with a Maximum Fraction of Limiting Power Density (MFLPD) greater than the Fraction of Rated Power (FRP), the setting shall be modified as follows:

$$S \leq (0.58W + 66\%)(FRP/MFLPD) \text{ for two loop operation;}$$

$$S \leq (0.58W + 66\% - 0.58 \Delta W)(FRP/MFLPD) \text{ for single-loop operation;}$$

**WHERE:**

FRP = Fraction of Rated Power;

MFLPD = Maximum Fraction Of Limiting Power Density, see Definition 4.4.

The ratio of FRP to MFLPD shall be set equal to 1.0 unless the actual operating value is less than the design value of 1.0, in which case the actual operating value will be used.

7.4.2       APRM Neutron Flux-High (Flow Biased) Rod Block Trip Setting  
(Relocated to the Technical Requirements Manual)

7.5       **RBM Upscale Rod Block Trip Setting**

7.5.1       Technical Specification LCO 3.3.2.1, Control Rod Block Instrumentation

7.5.2       The RBM upscale rod block trip setting shall be:

$$S \leq 0.66W + K \text{ for two loop operation;}$$

$$S \leq 0.66W + K - 0.66 \Delta W \text{ for single loop operation;}$$

**WHERE:**

S       =       rod block setting in percent of initial;

W       =       Loop flow in percent of rated

K       =       Any intercept value may be used because the RBM  
intercept value does not effect the MCPR  
Operating Limit

$\Delta W$    =       Difference between two loop and single loop  
effective drive flow at the same core flow.

7.6       **Stability Option 1-D Exclusion Region and Buffer Zone.**

7.6.1       Technical Specification LCO 3.4.1, Recirculation Loops Operating

7.6.2       The reactor shall not be intentionally operated within the Exclusion Region  
given in Figure 8.4 when the SOLOMON Code is operable.

7.6.3       The reactor shall not be intentionally operated within the Buffer Zone given  
in Figure 8.4 when the SOLOMON Code is inoperable.

### 7.7 $K_f$ – Flow Dependent MCPR Limit

Figure 8.2 is the  $K_f$  limit. Values of  $K_f$  are obtained using the following equation (see Reference 3.6):

$$K_f = \text{MAX} [1.0, A - \text{SLOPE} * \text{WT}]$$

WHERE:

WT = Core Flow as % of Rated,  $30\% \leq \text{WT} \leq 100\%$

SLOPE =  $(A_F/100/\text{OLMCPR}) * (\text{SLMCPR} / \text{SLMCPR}_{\text{generic}})$

A =  $(B_F/\text{OLMCPR}) * (\text{SLMCPR} / \text{SLMCPR}_{\text{generic}})$

$\text{SLMCPR}_{\text{generic}} = 1.07$

SLMCPR = Technical Specification LCO 2.1.1, Reactor Core SLs

OLMCPR = The lowest value obtained from Figures 8.1, 8.1.A, 8.1.B and 8.1.C as per 7.1.4, or, if the note in 7.1.4 applies, then 7.1.3 requirement must be met.

$A_F, B_F$  = Coefficients for the  $K_f$  curve listed below:

Scoop Tube Setpoint %	$A_F$	$B_F$
102.5	0.571	1.655
107.0	0.586	1.697
112.0	0.602	1.747
117.0	0.632	1.809

All coefficients apply to Manual Flow Control Mode

---

**8.0 FIGURES AND TABLES****8.1 FIGURES**

Figure 8.1. MCPR Operating Limit Versus  $\tau$  for GE12 and GE14.

Figure 8.1.A. MCPR Operating Limit Versus  $\tau$  for Operation above 75% of Rated Thermal Power with Three Steam Lines in Service for GE12 and GE14.

Figure 8.1.B MCPR Operating Limit Versus  $\tau$  for Operation with Turbine Bypass Valves Out of Service

Figure 8.1.C MCPR Operating Limit Versus  $\tau$  for Operation with Final Feedwater Temperature Reduction

Figure 8.2  $K_f$  Factor

Figure 8.3 Exposure Dependent APLHGR Limit for GE14 Fuel

Figure 8.3.A Exposure Dependent APLHGR Limit for GE12 Fuel

Figure 8.4 Stability Option 1D Exclusion Region

Figure 8.5 Exposure Dependent LHGR Limit for GE14 Fuel.

Figure 8.5.A Exposure Dependent LHGR Limit for GE12 Fuel.

Figure 8.6. Cycle 17 Loading Pattern, Full Core by Bundle Design

Figure 8.7 Users Guide

---

**8.2 TABLES**

Table 8.1	MCPR Operating Limit for Incremental Cycle Core Average Exposure
Table 8.1.A	MCPR Operating Limit for Incremental Cycle Core Average Exposure for Operation above 75% of Rated Thermal Power with Three Steam Lines in Service
Table 8.1.B	MCPR Operating Limit for Operation with Turbine Bypass Valves Out of Service
Table 8.1.C	MCPR Operating Limit for Operation with Final Feedwater Temperature Reduction
Table 8.2	Maximum LHGR – GE14
Table 8.2.A	Maximum LHGR – GE12
Table 8.3	APLHGR Limits for GE14 Fuel
Table 8.3.A	APLHGR Limits for GE12 Fuel

**9.0 EXHIBITS**

NONE

TABLE 8.1

## MCPR Operating Limit For Incremental Cycle Core Average Exposure

Cycle 17 Exposure Range	All Fuel Types
BOC to <EOC – 2.7 GWD/ST	1.39
EOC – 2.7 GWD/ST to EOC	1.43

Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)

For single loop operation, these limits shall be increased as given in Section 7.1.5.

- NOTE:**
1. When entering a new Exposure Range, check the current value of  $\tau$  to assure adjustment per Step 7.1.4
  2. Applicable for any value of  $K$ , see Step 7.5.2



TABLE 8.1.A

M CPR Operating Limit for Incremental Cycle Core Average  
Exposure for Operation above 75% of Rated Thermal Power with  
Three Steam Lines in Service

Cycle 17 Exposure Range	All Fuel Types
BOC to <EOC - 2.7 GWD/ST	1.41
EOC - 2.7 GWD/ST to EOC	1.45

Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)

For single loop operation, these limits shall be increased as given in Section 7.1.5.

- NOTE:** 1. When entering a new Exposure Range, check the current value of  $\tau$  to assure adjustment per Step 7.1.4
2. Applicable for any value of K, see Step 7.5.2

TABLE 8.1.B

MCPR Operating Limit for Operation with Turbine Bypass Valves  
Out of Service

Cycle 17 Exposure Range	All Fuel Types
ALL	1.47

Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)

Technical Specification LCO 3.7.6, Main Turbine Bypass System

For single loop operation, these limits shall be increased as given in Section 7.1.5.

- NOTE:** 1. When entering a new Exposure Range, check the current value of  $\tau$  to assure adjustment per Step 7.1.4
2. Applicable for any value of K, see Step 7.5.2

TABLE 8.1.C

MCPR Operating Limit for Operation with Final Feedwater  
Temperature Reduction

Cycle 17 Exposure Range	All Fuel Types
At EOC only (see below)	1.43

Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)

For single loop operation, these limits shall be increased as given in Section 7.1.5.

- NOTE:** 1. When entering a new Exposure Range, check the current value of  $\tau$  to assure adjustment per Step 7.1.4
2. Applicable for any value of  $K$ , see Step 7.5.2

MCPR Operating Limits in this table apply when at reduced feedwater temperature near end-of-cycle, see JD-02-122 (Reference 3.14) for further information.

TABLE 8.2

Maximum LHGR – GE14

Peak Pellet Exposure	UO <sub>2</sub> LHGR Limit
GWd/ST	kW/ft
0.00	13.40
14.51	13.40
57.61	8.00
63.50	5.00

Peak Pellet Exposure	Most Limiting Gadolinia LHGR Limit
GWd/ST	kW/ft
0.00	12.26
12.28	12.26
55.00	7.32
60.84	4.57

Technical Specification LCO 3.2.3, Linear Heat Generation Rate (LHGR)

Design features of the fuel assemblies in the Cycle 17 core are provided in References 3.3, 3.16

For single loop operation these LHGR values shall be multiplied by 0.78

Linearly interpolate for LHGR at intermediate exposure

TABLE 8.2.A

## Maximum LHGR – GE12

Peak Pellet Exposure	UO <sub>2</sub> LHGR Limit
GWd/ST	kW/ft
0.00	11.80
13.24	11.80
63.50	6.39

Peak Pellet Exposure	Most Limiting Gadolinia LHGR Limit
GWd/ST	kW/ft
0.00	11.35
11.69	11.35
63.50	6.20

Technical Specification LCO 3.2.3, Linear Heat Generation Rate (LHGR)

Design features of the fuel assemblies in the Cycle 17 core are provided in References 3.3, 3.16

For single loop operation these LHGR values shall be multiplied by 0.78

Linearly interpolate for LHGR at intermediate exposure

TABLE 8.3

Exposure Dependent APLHGR Limit for GE14 Fuel

Average Planar Exposure	APLHGR Limit
GWd/ST	kW/ft
0.00	12.82
14.51	12.82
19.13	12.82
57.61	8.00
63.50	5.00

TABLE 8.3.A

Exposure Dependent APLHGR Limit for GE12 Fuel


Average Planar Exposure	APLHGR Limit
GWd/ST	kW/ft
0.00	10.62
13.24	10.62
24.20	10.62
63.50	6.39

Technical Specification LCO 3.2.1, Average Planar Linear Heat Generation Rate (APLHGR)

For single loop operation these APLHGR values shall be multiplied by 0.78

Linearly interpolate for APLHGR at intermediate exposure

**FIGURE 8.1**  
**MCPR Operating Limit Versus  $\tau$**   
**For All Fuel Types**

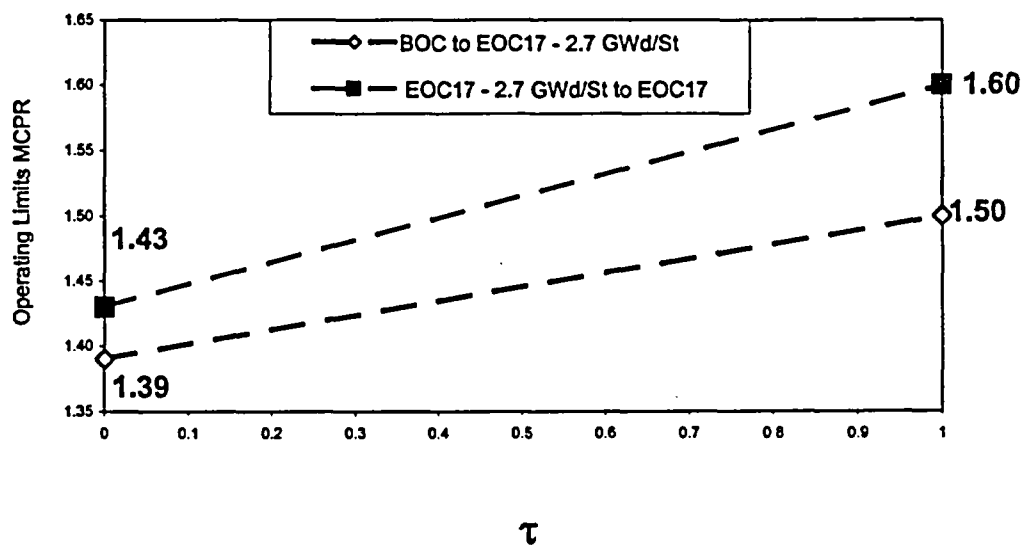


Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)

For single loop operation, these limits shall be increased as given in Section 7.1.5.

**NOTE:** Should the operating limit MCPR obtained from this figure be less than the operating limit MCPR found in 7.1.3 for the applicable RBM Upscale Rod Block trip level setting then 7.1.3 shall apply (Not applicable in Cycle 17).

FIGURE 8.1.A

**MCPR Operating Limit Versus  $\tau$   
For Operating Above 75% of Rated  
Thermal Power with Three Steam  
Lines in Service For all Fuel Types**

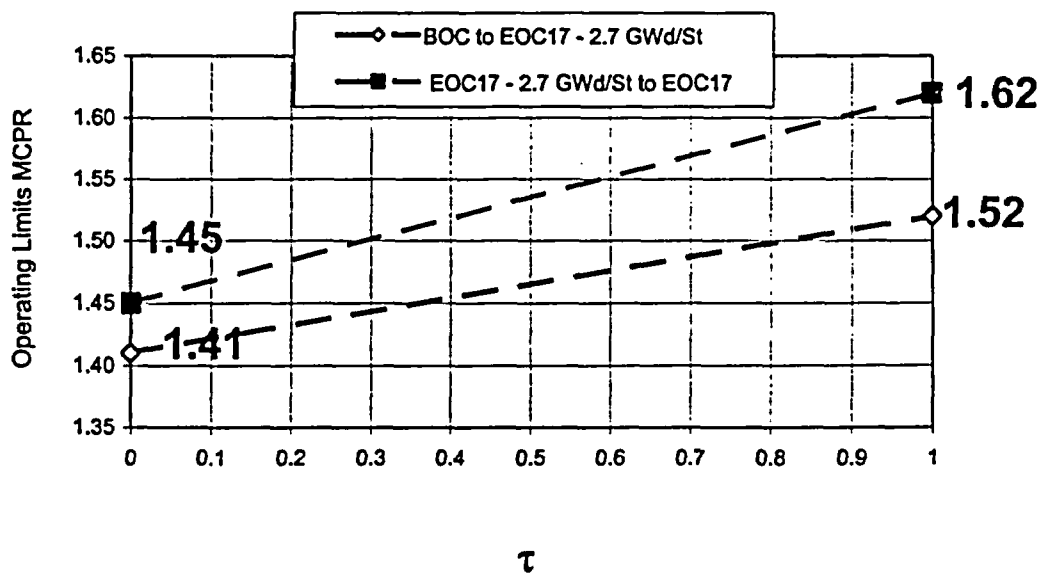

Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)


For single loop operation, these limits shall be increased as given in Section 7.1.5.

**NOTE:** Should the operating limit MCPR obtained from this figure be less than the operating limit MCPR found in 7.1.3 for the applicable RBM Upscale Rod Block trip level setting then 7.1.3 shall apply (Not applicable in Cycle 17).



FIGURE 8.1.B

M CPR Operating Limit Versus  $\tau$   
for Operation with Turbine Bypass  
Valves Out of Service

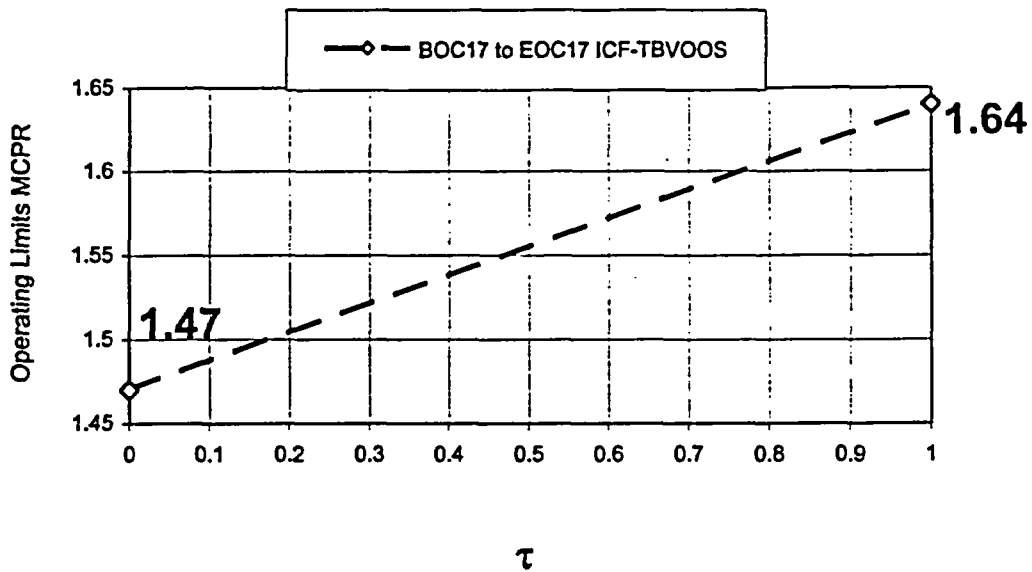


Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)

For single loop operation, these limits shall be increased as given in Section 7.1.5.

**NOTE:** Should the operating limit MCPR obtained from this figure be less than the operating limit MCPR found in 7.1.3 for the applicable RBM Upscale Rod Block trip level setting then 7.1.3 shall apply (Not applicable in Cycle 17).

FIGURE 8.1.C

M CPR Operating Limit Versus  $\tau$   
for Operation with Final Feedwater  
Temperature Reduction

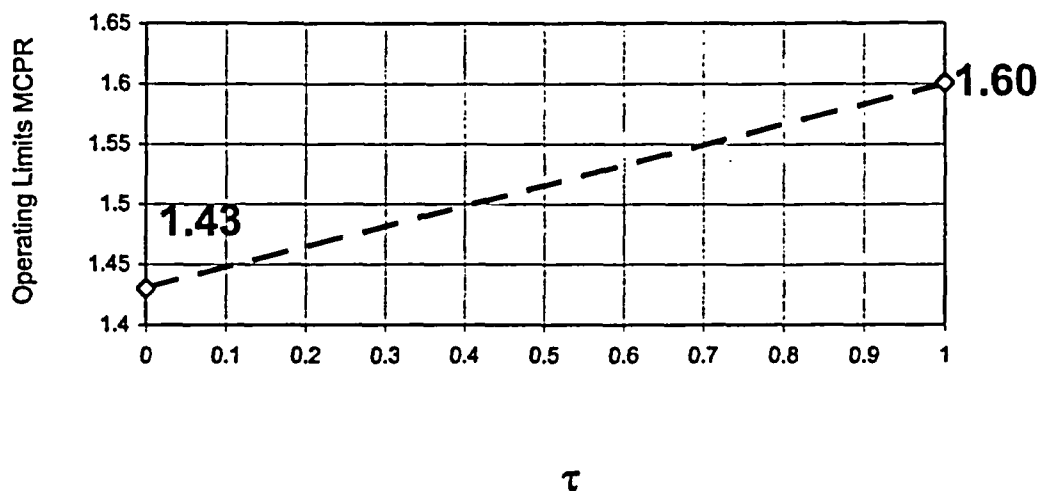


Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)

For single loop operation, these limits shall be increased as given in Section 7.1.5.

**NOTE:** Should the operating limit MCPR obtained from this figure be less than the operating limit MCPR found in 7.1.3 for the applicable RBM Upscale Rod Block trip level setting then 7.1.3 shall apply (Not applicable in Cycle 17).

FIGURE 8.2

$K_f$  Factor

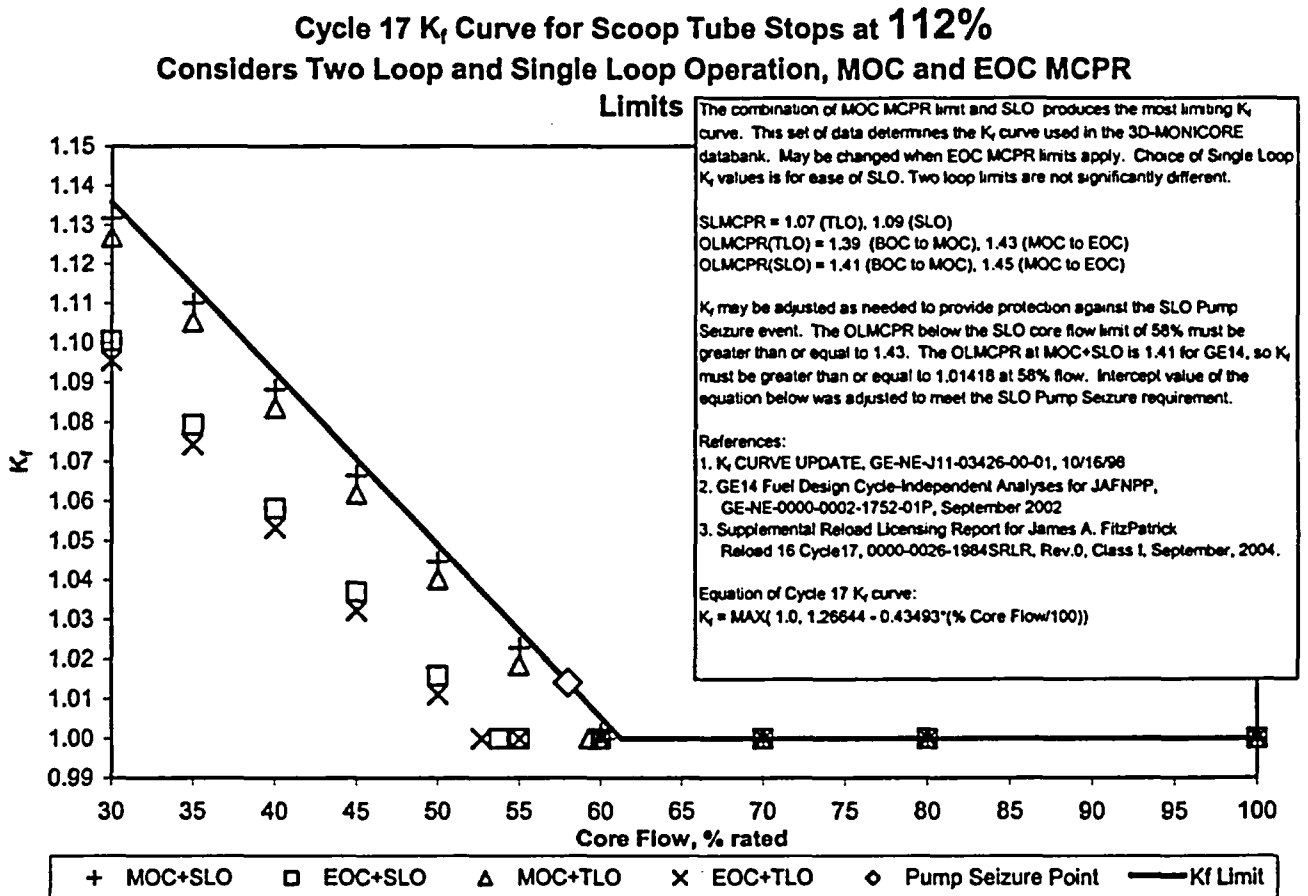


Technical Specification LCO 3.2.2, Minimum Critical Power Ratio (MCPR)

See Section 7.7

**NOTE:**  $K_f$  for Single Loop Operation is slightly greater than for Dual Loop Operation limits. Therefore,  $K_f$  calculated for Single Loop Operation is more conservative and will be applied to Dual Loop Operation as well.

FIGURE 8.3

Exposure Dependent APLHGR Limit for GE14 Fuel

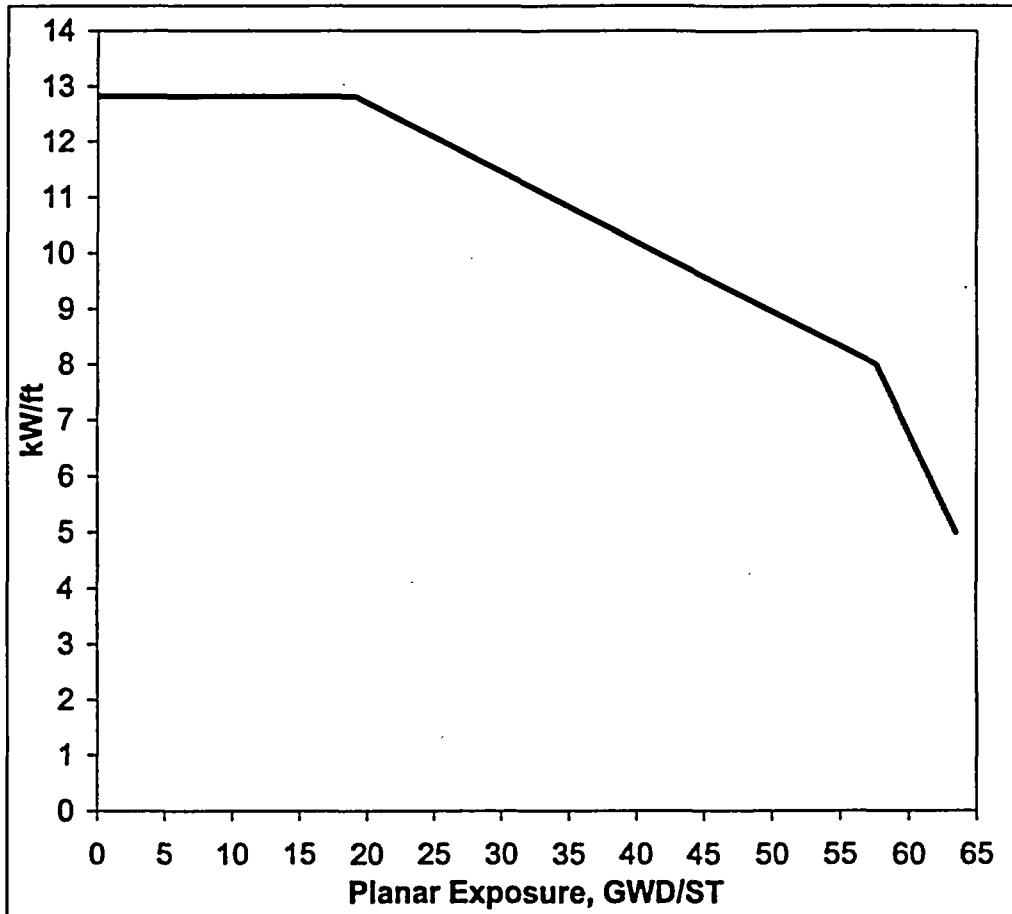


Technical Specification LCO 3.2.1, Average Planar Linear Heat Generation Rate (APLHGR)

For single loop operation these APLHGR values shall be multiplied by 0.78.

FIGURE 8.3.A

Exposure Dependent APLHGR Limit for GE12 Fuel

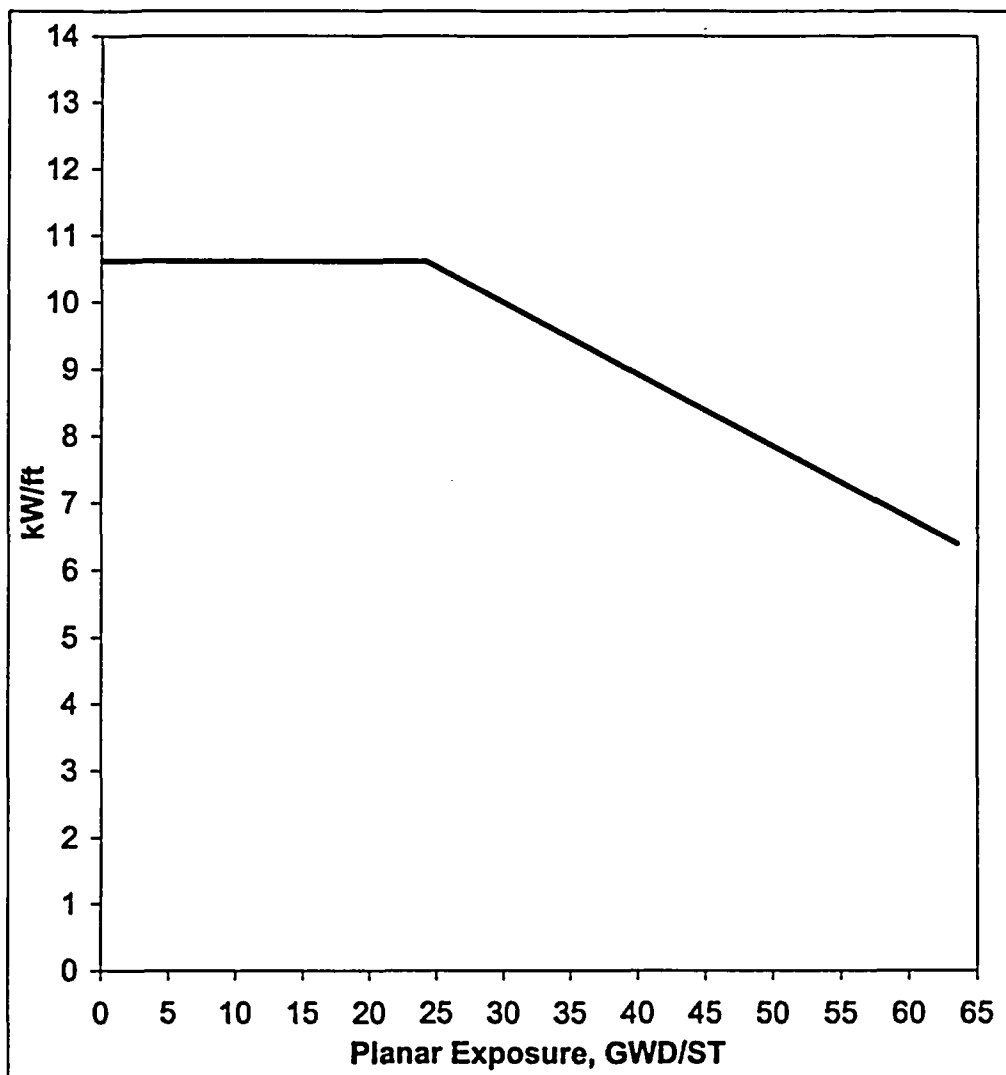


Technical Specification LCO 3.2.1, Average Planar Linear Heat Generation Rate (APLHGR)

For single loop operation these APLHGR values shall be multiplied by 0.78.

FIGURE 8.4

Stability Option 1-D Exclusion Region

THE EXCLUSION REGION SHOWN BELOW IS  
APPLICABLE TO A CYCLE 17 EXPOSURE OF 6000  
MWD/ST (see CR-JAF-2004-04360)

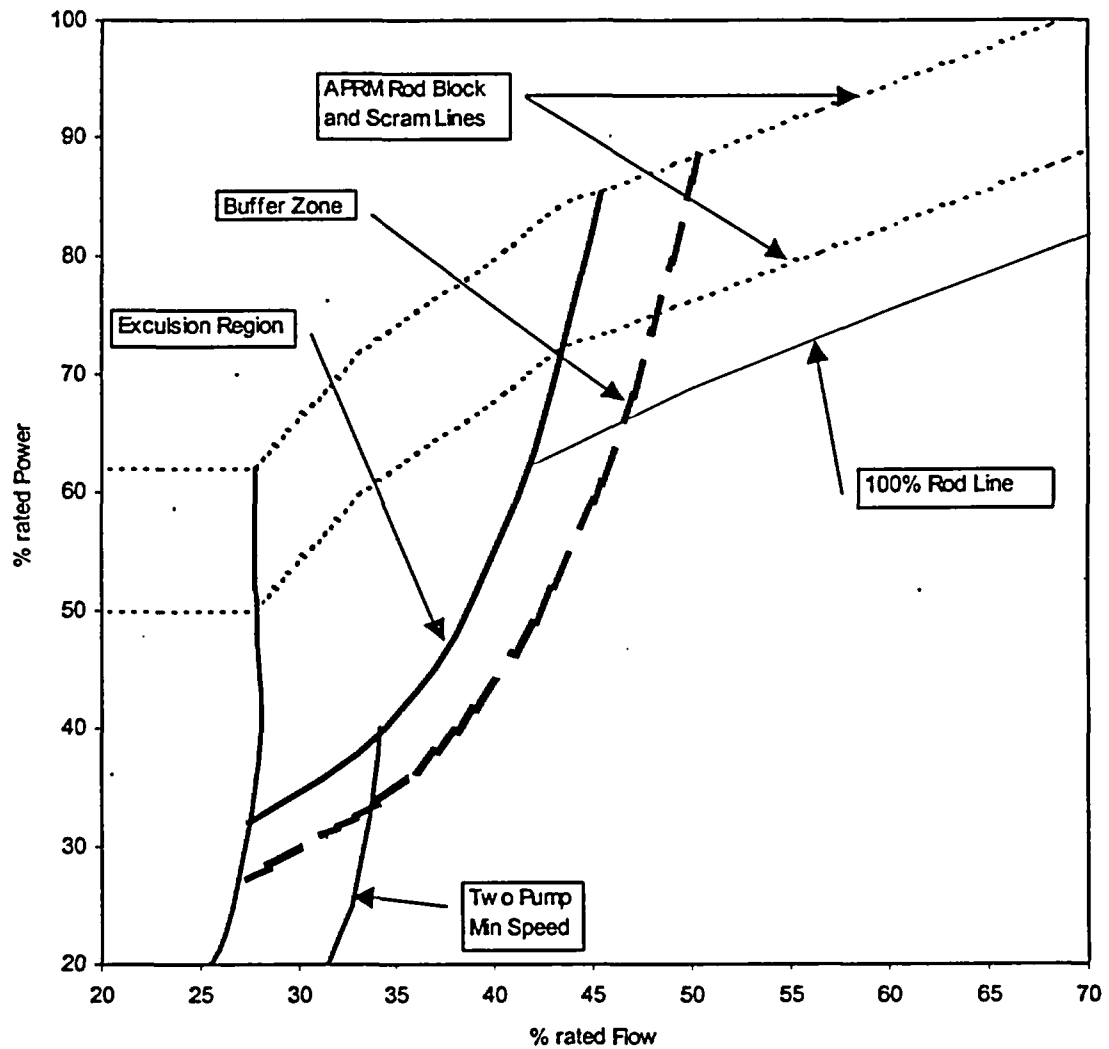


Technical Specification LCO 3.4.1, Recirculation Loops Operating

References 3.17, 3.18

FIGURE 8.5

Exposure Dependent LHGR Limit for GE14 Fuel

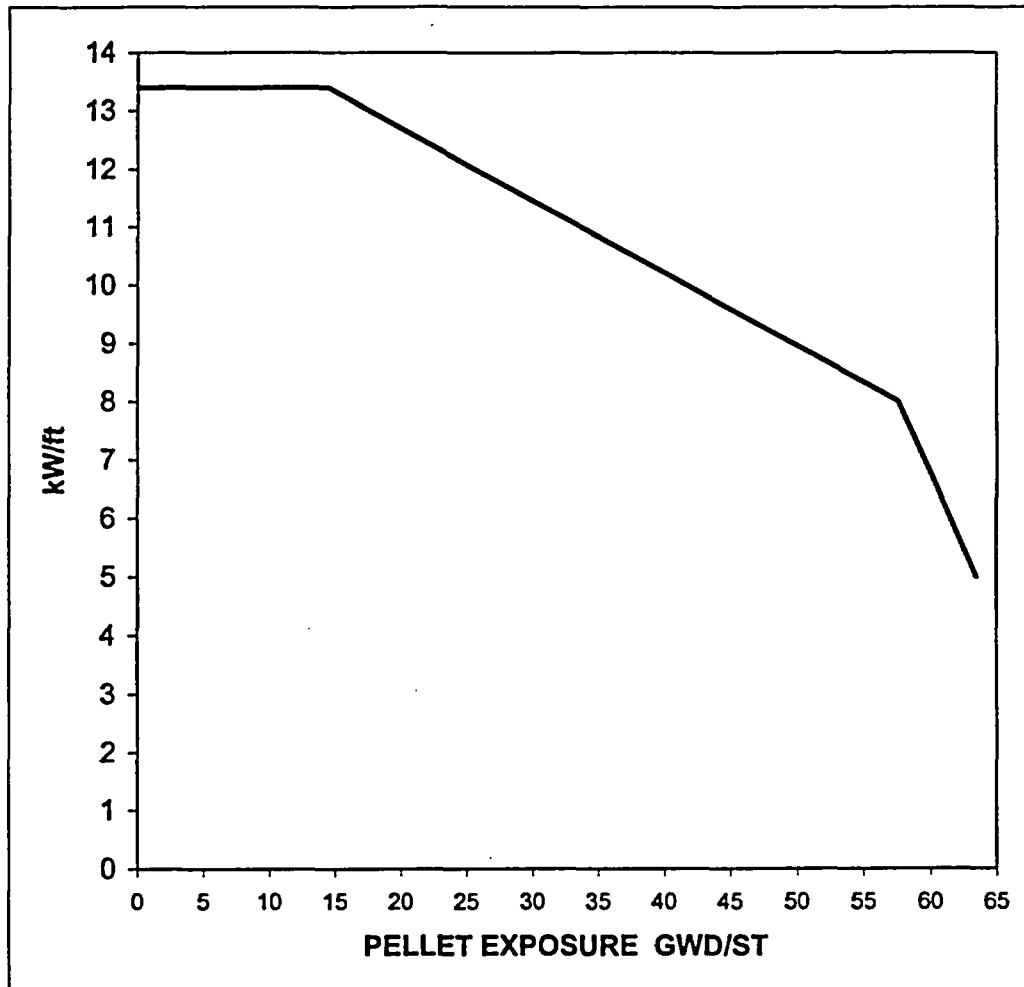


Technical Specification LCO 3.2.3, Linear Heat Generation Rate (LHGR)

This curve represents the limiting exposure dependent LHGR values per Reference 3.16

Design features of the fuel assemblies in the Cycle 17 core are provided in Reference 3.3

FIGURE 8.5.A

Exposure Dependent LHGR Limit for GE12 Fuel

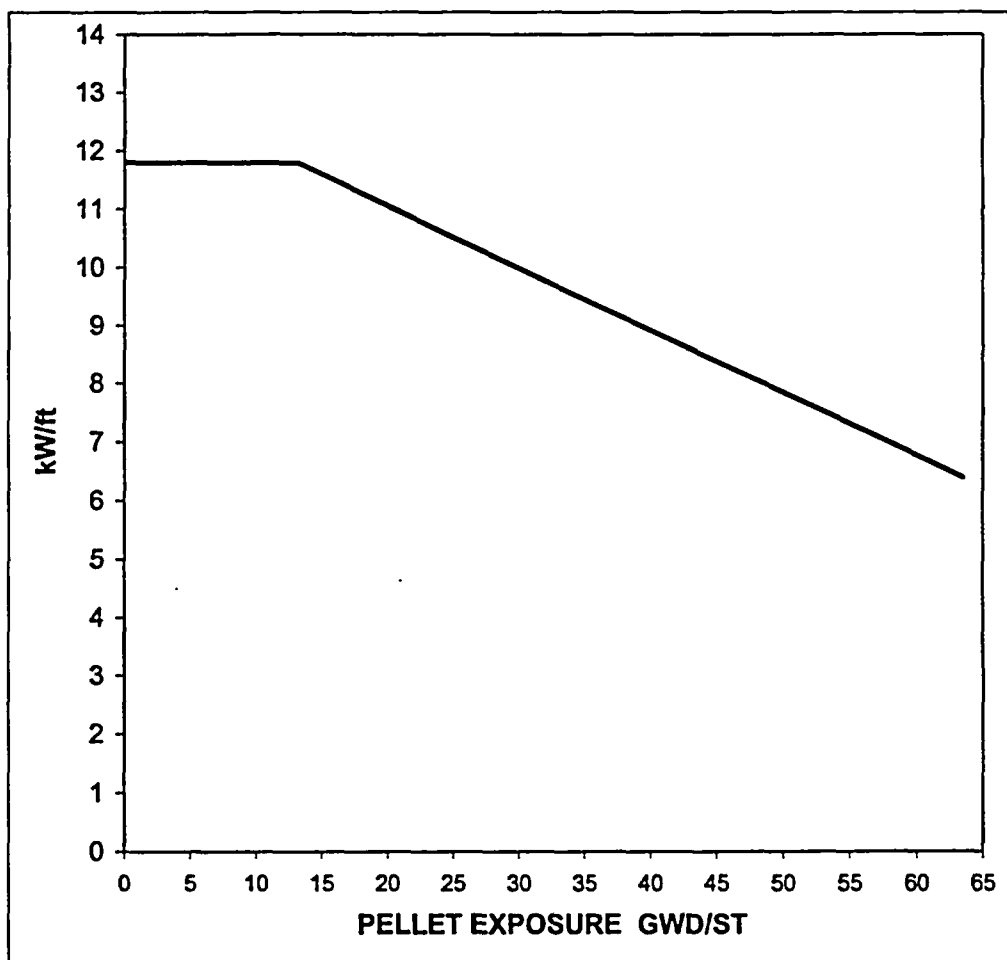

Technical Specification LCO 3.2.3, Linear Heat Generation Rate (LHGR)


This curve represents the limiting exposure dependent LHGR values per Reference 3.16

Design features of the fuel assemblies in the Cycle 17 core are provided in Reference 3.3



FIGURE 8.6

Cycle 17 Loading Pattern by Bundle Design

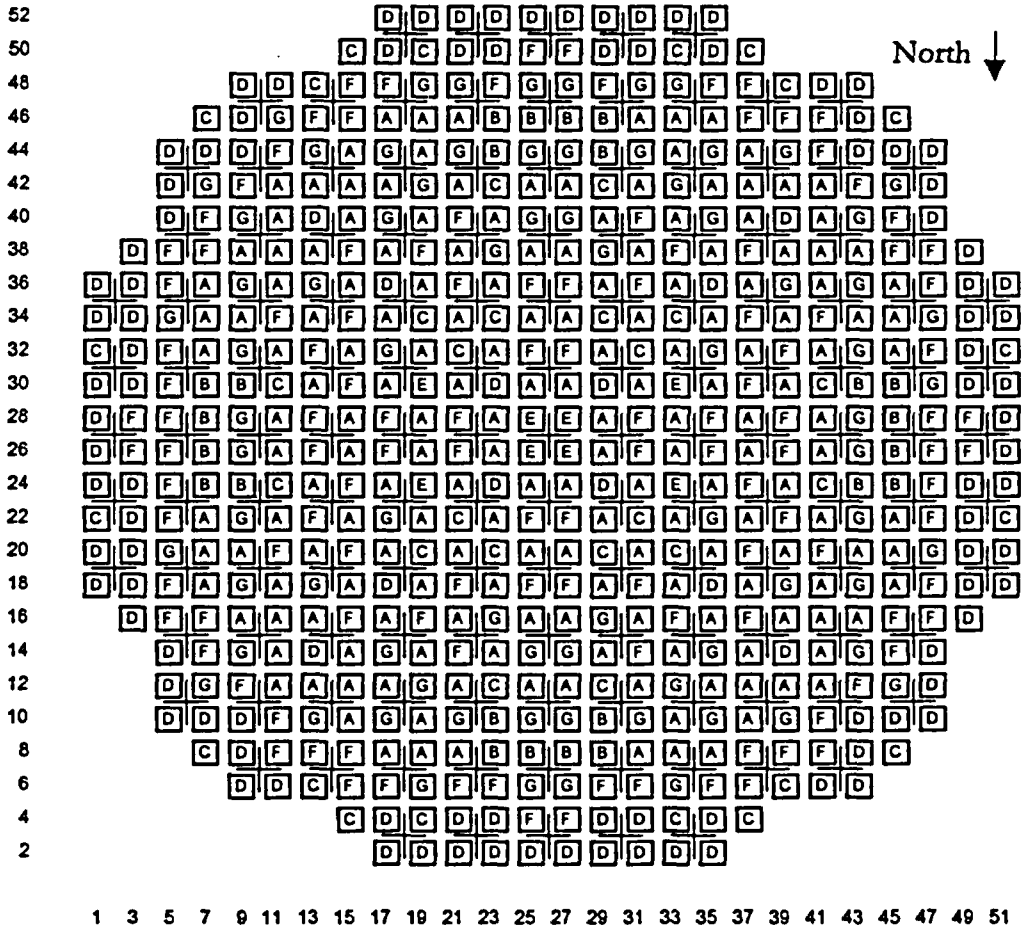

Fuel Type	
A=GE14-P10DNAB405-16GZ-100T-150-T6(Cycle 17)	E=GE12-P10DSB407-14G6.0-100T-150-T6 (Cycle 15)
B=GE14-P10DNAB405-15G6.0-100T-150-T6 (Cycle 17)	F=GE14-P10DNAB405-16GZ-100T-150-T6 (Cycle 16)
C=GE12-P10DSB405-16GZ-100T-150-T6 (Cycle 15)	G=GE14-P10DNAB405-16GZ-100T-150-T6 (Cycle 16)
D=GE12-P10DSB405-17GZ-100T-150-T6 (Cycle 15)	

FIGURE 8.7

USERS GUIDE

The COLR defines thermal limits for the various operating conditions expected during the cycle. At the start of the cycle the 3D-Monicores databank contains limits for;

- Cycle exposure range of BOC to < EOC17 – 2.7 GWD/ST
- $\tau = 0$
- Dual recirculation pump operation
- Four steam line operation, and
- Operation with Turbine Bypass Valves Out-of-Service
- Final Feedwater Temperature Reduction

The following is a table that offers a check to assure the correct limits are applied when operating states or conditions change.

Change in Operating State	Change in Limits	Procedure Reference
Cycle Exposure = EOC17 – 2.7 GWD/ST OLMCPR changes to EOC values at cycle exposure of 12.0 GWD/ST	See Table 8.1(8.1.A for 3SL) or Figure 8.1 for $\tau \neq 0$ (8.1.A for 3SL) for change in MCPR.  $K_f$ limit may be changed in recognition of higher OLMCPR.	None
Scram Time Test Results such that $\tau \neq 0$ Option B limits for OLMCPR must be interpolated with Option A limits	Use new $\tau$ and see Figure 8.1 or 8.1.A for 3SL. $K_f$ limit may be changed in recognition of higher OLMCPR.	RAP-7.4.1
Single Loop Operation The SLMCPR increases by 0.02 and therefore OLMCPR limits increase by 0.02. MFLPD and MAPLHGR are reduced by a multiplier in SLO.	Increase MCPR Limits by 0.02, or change acceptance criterion in ST-5E to 0.98. $K_f$ does not change.  Verify that 3D-Monicores has recognized the idle recirculation loop and is applying the SLO MFLPD and MAPLHGR multiplier of 0.78.	RAP-7.4.2, ST-5E, RAP-7.3.25
Three Steam Line Operation (3SL) OLMCPR values increase by 0.02 when operating on 3SL	Increase OLMCPR according to Table 8.1.A or Figure 8.1.A( $\tau \neq 0$ ). $K_f$ limit may be changed in recognition of higher OLMCPR.	None
Operation with Turbine Bypass Valves Out-of-Service OLMCPR values increase, no LHGR change required	Increase OLMCPR according to Table 8.1.B or Figure 8.1.B( $\tau \neq 0$ ). $K_f$ limit may be changed in recognition of higher OLMCPR.	None
Operation under Final Feedwater Temperature Reduction OLMCPR values increase, no LHGR change required	Increase OLMCPR according to Table 8.1.C or Figure 8.1.C( $\tau \neq 0$ ). $K_f$ limit may be changed in recognition of higher OLMCPR.	None