

15:03:13 3CNVA
MASTER HOST A

Analog Point Display

Done

APDSP 17-APR-05
MP3 Page 1 of 1

AIN

Plant ID: **CVPRZRLVL**

PRESSURIZER LEVEL


68.97397 %

(11378) CALC_AI **66.000**
Security: 10 In Scan: YES
In Alarm-Scan: YES
Alarm Priority Disabled: NO

Start Time: **4/17/05 14:45:00**
End Time: **4/17/05 15:00:00**
Archive Sample Rate: **60.000**
Real-time Sample Rate: **60.000**

To change time parameters, RIGHT mouse click inside the trend, then PAUSE the trend. After updating time parameters, RESUME the trend in similar fashion.
Data is displayed and plotted using alarm colors (white = not in alarm scan)

Trend Help

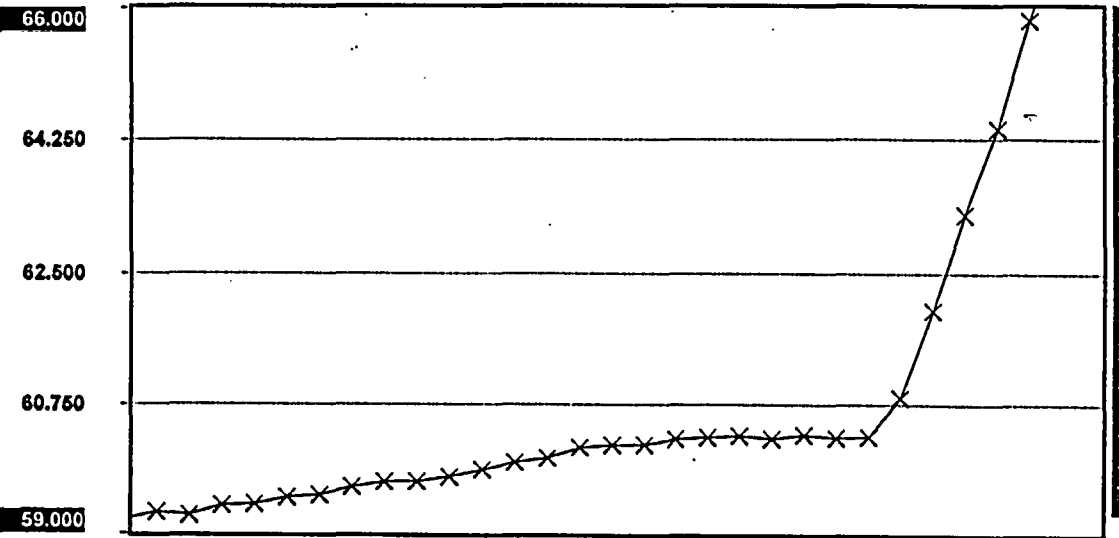

Event	No Def	No Def	No Def
High Limit:	70		
Low Limit:	22		
Deadband:	0		
Deviation:			

Most recent alarms			Alarm Priority	Trend	Trend Range -or- Deadband
Date	Time	Value	High Low OK	High Low OK	Low High Deadband

SUB CRIT CORE COOL HEAT SINK RCS INTG CTMT RCS INVN RAD PLC