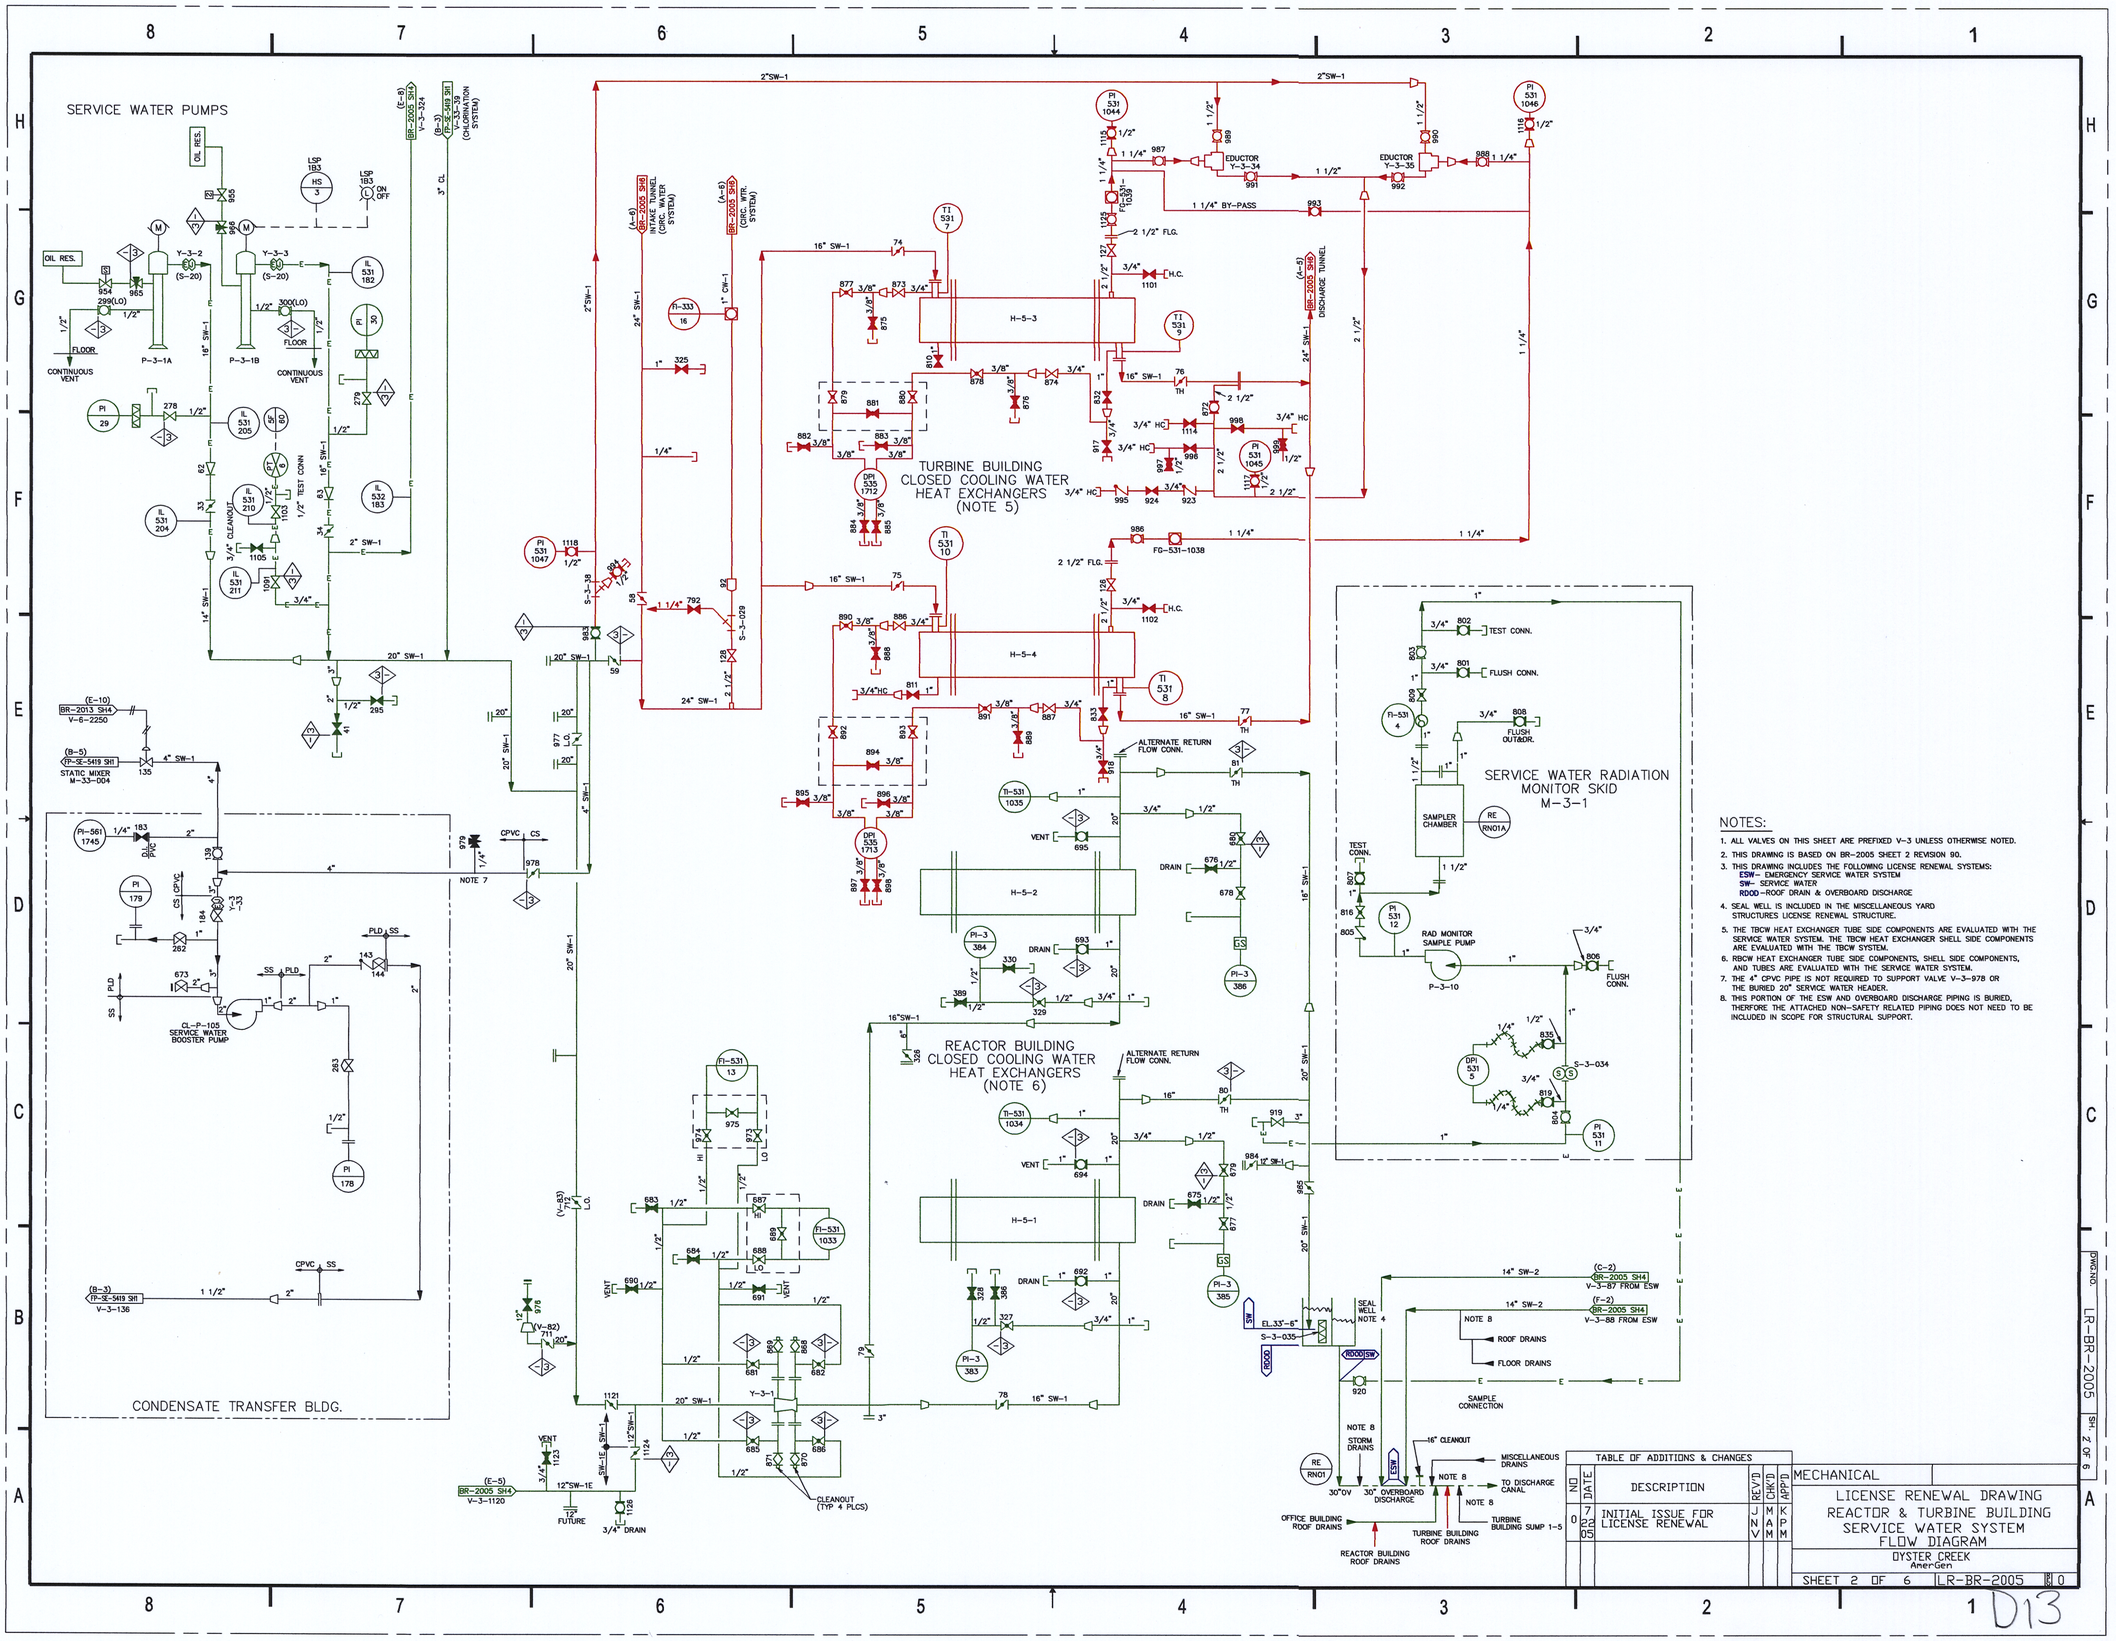

NOTES:

1. ALL VALVES ON THIS SHEET ARE PREFIXED V-3 UNLESS OTHERWISE NOTED.
2. THIS DRAWING IS BASED ON BR-2005 SHEET 2 REVISION 90.
3. THIS DRAWING INCLUDES THE FOLLOWING LICENSE RENEWAL SYSTEMS:
   ESW– EMERGENCY SERVICE WATER SYSTEM
   SW– SERVICE WATER
   RDOD–ROOF DRAIN & OVERBOARD DISCHARGE
4. SEAL WELL IS INCLUDED IN THE MISCELLANEOUS YARD STRUCTURES LICENSE RENEWAL STRUCTURE.
5. THE TBCW HEAT EXCHANGER TUBE SIDE COMPONENTS ARE EVALUATED WITH THE SERVICE WATER SYSTEM. THE TBCW HEAT EXCHANGER SHELL SIDE COMPONENTS ARE EVALUATED WITH THE TBCW SYSTEM.
6. RBCW HEAT EXCHANGER TUBE SIDE COMPONENTS, SHELL SIDE COMPONENTS, AND TUBES ARE EVALUATED WITH THE SERVICE WATER SYSTEM.
7. THE 4" CPVC PIPE IS NOT REQUIRED TO SUPPORT VALVE V-3-978 OR THE BURIED 20" SERVICE WATER HEADER.
8. THIS PORTION OF THE ESW AND OVERBOARD DISCHARGE PIPING IS BURIED, THERFORE THE ATTACHED NON-SAFETY RELATED PIPING DOES NOT NEED TO BE INCLUDED IN SCOPE FOR STRUCTURAL SUPPORT.

TABLE OF ADDITIONS & CHANGES

NO	DATE	DESCRIPTION	REV'D	CHK'D	APP'D
0	7/05	INITIAL ISSUE FOR LICENSE RENEWAL	LNV	MAM	KPM

MECHANICAL

LICENSE RENEWAL DRAWING
REACTOR & TURBINE BUILDING
SERVICE WATER SYSTEM
FLOW DIAGRAM

OYSTER CREEK
AmerGen

SHEET 2 OF 6 LR-BR-2005 0

PWG NO. LR-BR-2005 SH. 2 OF 6

D13