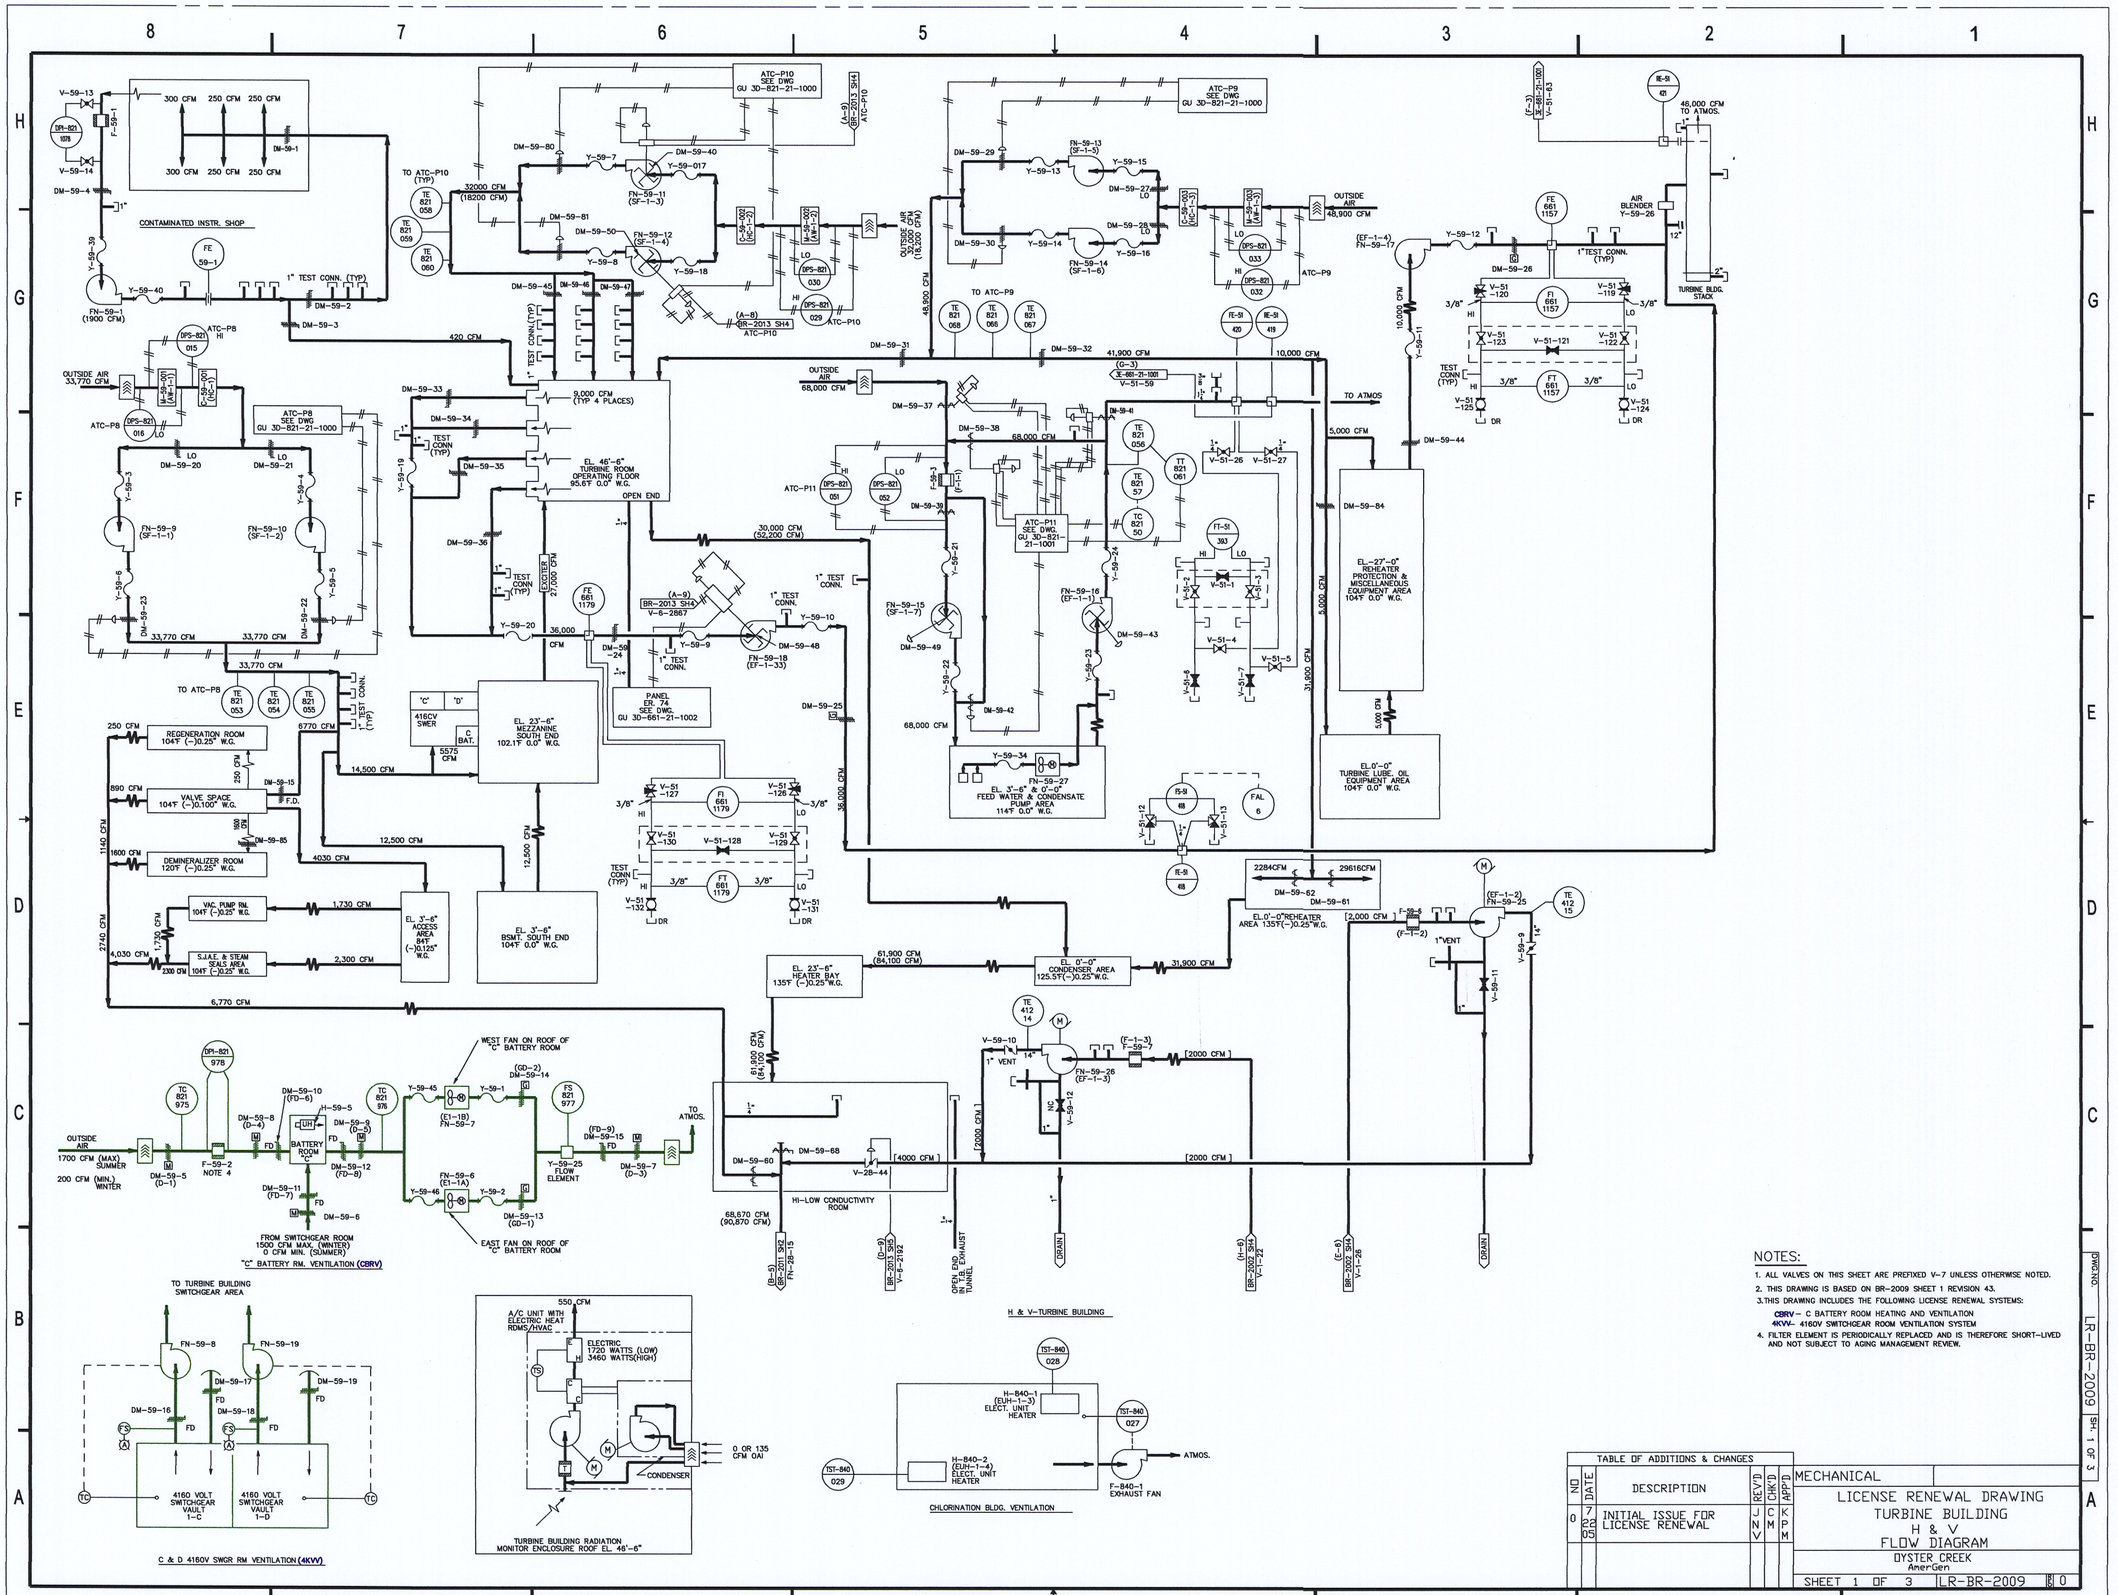

NOTES:

1. ALL VALVES ON THIS SHEET ARE PREFIXED V-7 UNLESS OTHERWISE NOTED.
2. THIS DRAWING IS BASED ON BR-2009 SHEET 1 REVISION 43.
3. THIS DRAWING INCLUDES THE FOLLOWING LICENSE RENEWAL SYSTEMS:
   CBRV – C BATTERY ROOM HEATING AND VENTILATION
   4KVV– 4160V SWITCHGEAR ROOM VENTILATION SYSTEM
4. FILTER ELEMENT IS PERIODICALLY REPLACED AND IS THEREFORE SHORT-LIVED AND NOT SUBJECT TO AGING MANAGEMENT REVIEW.

TABLE OF ADDITIONS & CHANGES

NO	DATE	DESCRIPTION	REV'D	CHK'D	APP'D
0	7 22 05	INITIAL ISSUE FOR LICENSE RENEWAL	JNV	CMM	KPM

MECHANICAL

LICENSE RENEWAL DRAWING
TURBINE BUILDING
H & V
FLOW DIAGRAM

OYSTER CREEK
AmerGen

SHEET 1 OF 3 LR-BR-2009 0

DWG.NO. LR-BR-2009 SH. 1 OF 3

D-27