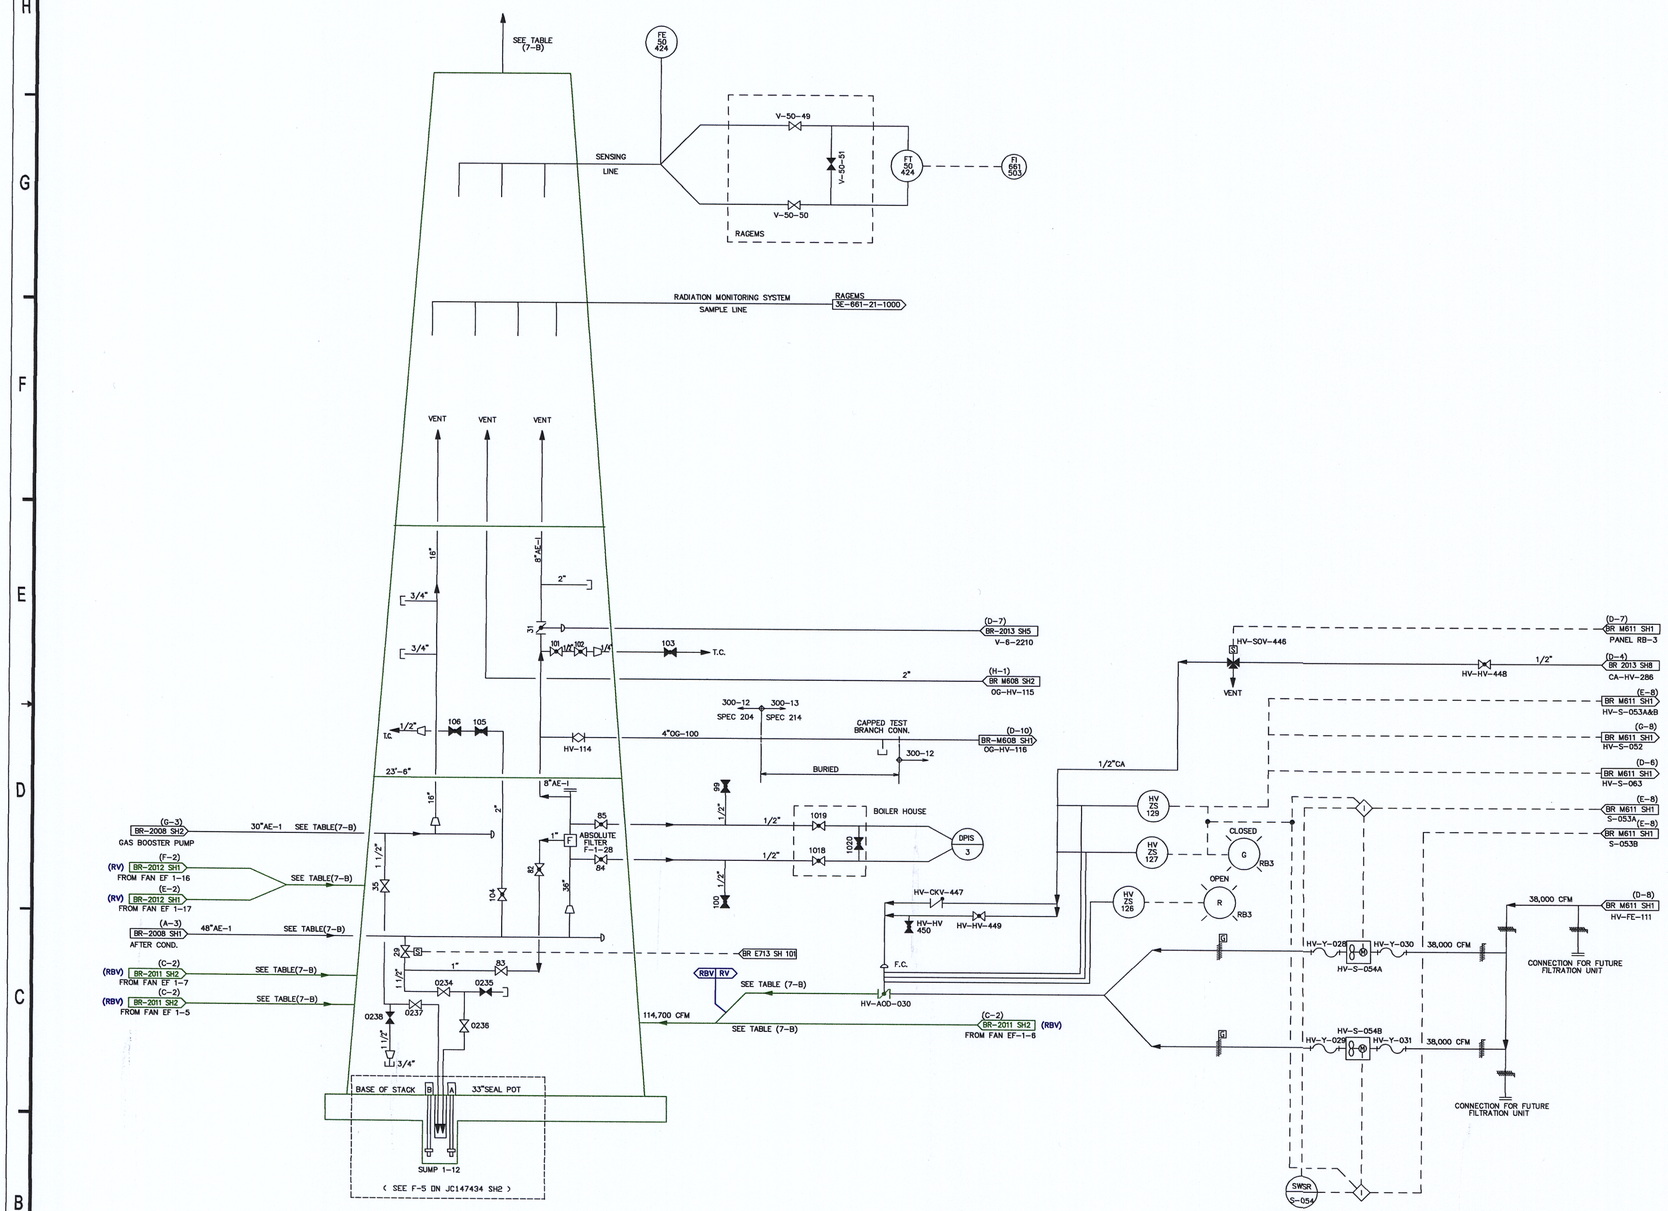

	EXHAUST SYSTEMS	START-UP (CFM)	NORMAL POWER (CFM)	EMERG OR SURV. TEST (CFM)	SHUTDOWN (CFM)	NOTES
1.	AIR EXTRACTION & OFF GAS SYS.	2800	120	–	–	6
2.	R.B. VENTILATION (EF-1-5/6)	76,700	76,700	–	76,700	7
3.	T.B. VENTILATION (EF-1-6/7)	68,670	68,670	68,670	68,670	5
4.	N.R.W. BLDG & VENTILATION (HV-5053A & B/HV-5054A & B)	38,000	38,000	38,000	38,000	–
5.	OLD RADWASTE BLDG VENTILATION (EF-1-16 OR EF-1-17)	22,475	22,475	22,475	22,475	–
6.	STANDBY GAS TREATMENT SYS. (EF-1-8 OR EF-1-9)	–	–	2600	–	7
7.	AUGMENTED OFF GAS	NEGLIGIBLE	NEGLIGIBLE	NEGLIGIBLE	NEGLIGIBLE	–
	TOTAL STACK FLOWS	208,645	205,965	131,745	205,845	–

NOTES:

1. ALL VALVES ARE PREFIXED BY V-7 UNLESS OTHERWISE NOTED.
2. THIS DRAWING IS BASED ON DRAWING BR-2009 SHEET 2, REVISION 37.
3. THIS DRAWING INCLUDES THE FOLLOWING LICENSE RENEWAL SYSTEMS:
   RBV – REACTOR BUILDING VENTILATION SYSTEM
   RV – RADWASTE AREA HEATING AND VENTILATION SYSTEM

TABLE OF ADDITIONS & CHANGES

NO	DATE	DESCRIPTION	REV'D	CHK'D	APP'D
0	7 22 05	INITIAL ISSUE FOR LICENSE RENEWAL	JNV	CM	KPM

MECHANICAL

LICENSE RENEWAL DRAWING
H & V
MAIN STACK
FLOW DIAGRAM

OYSTER CREEK
AmerGen

SHEET 2 OF 3 LR-BR-2009 0

DWG.NO. LR-BR-2009 SH. 2 OF 3

D-28