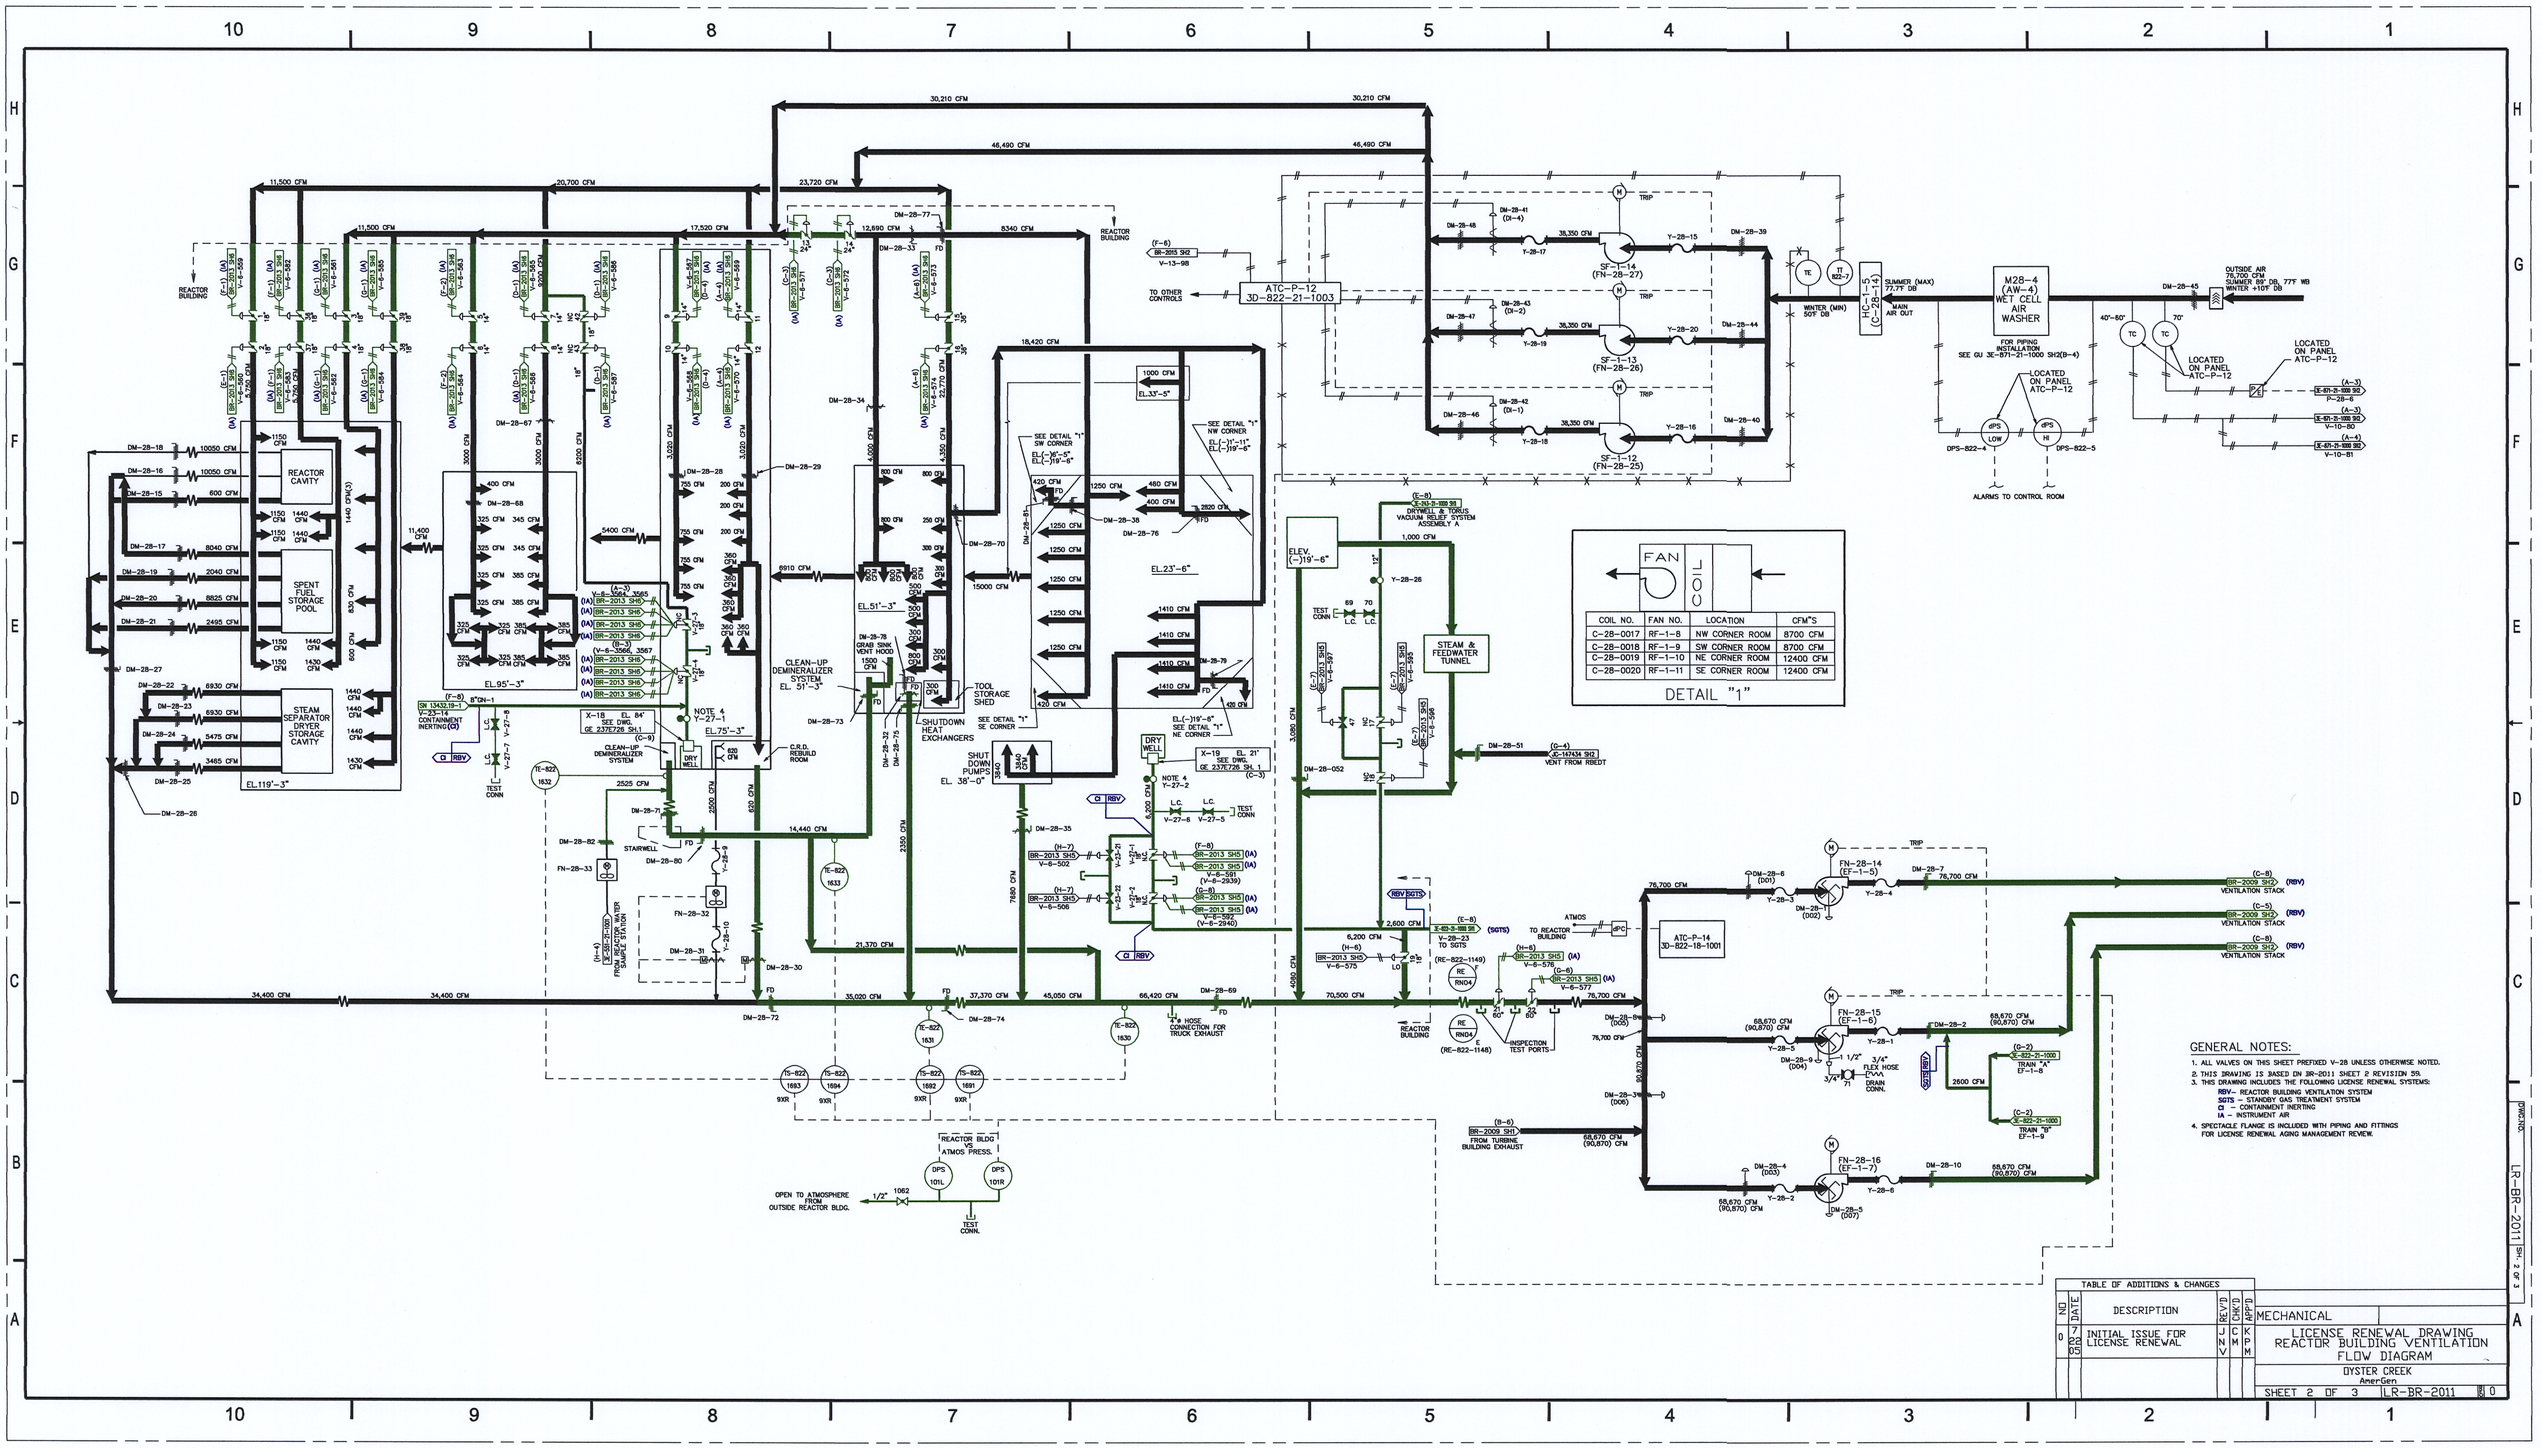

COIL NO.	FAN NO.	LOCATION	CFM'S
C-28-0017	RF-1-8	NW CORNER ROOM	8700 CFM
C-28-0018	RF-1-9	SW CORNER ROOM	8700 CFM
C-28-0019	RF-1-10	NE CORNER ROOM	12400 CFM
C-28-0020	RF-1-11	SE CORNER ROOM	12400 CFM

GENERAL NOTES:

1. ALL VALVES ON THIS SHEET PREFIXED V-28 UNLESS OTHERWISE NOTED.
2. THIS DRAWING IS BASED ON BR-2011 SHEET 2 REVISION 59.
3. THIS DRAWING INCLUDES THE FOLLOWING LICENSE RENEWAL SYSTEMS:
   RBV - REACTOR BUILDING VENTILATION SYSTEM
   SGTS - STANDBY GAS TREATMENT SYSTEM
   CI - CONTAINMENT INERTING
   IA - INSTRUMENT AIR
4. SPECTACLE FLANGE IS INCLUDED WITH PIPING AND FITTINGS FOR LICENSE RENEWAL AGING MANAGEMENT REVIEW.

TABLE OF ADDITIONS & CHANGES

NO	DATE	DESCRIPTION	REV'D	CHK'D	APP'D
0	7-22-05	INITIAL ISSUE FOR LICENSE RENEWAL	JNV	CMP	MK

MECHANICAL

LICENSE RENEWAL DRAWING
REACTOR BUILDING VENTILATION
FLOW DIAGRAM

OYSTER CREEK
AmerGen

SHEET 2 OF 3 LR-BR-2011 0

DWG NO. LR-BR-2011 SH. 2 OF 3

D-32