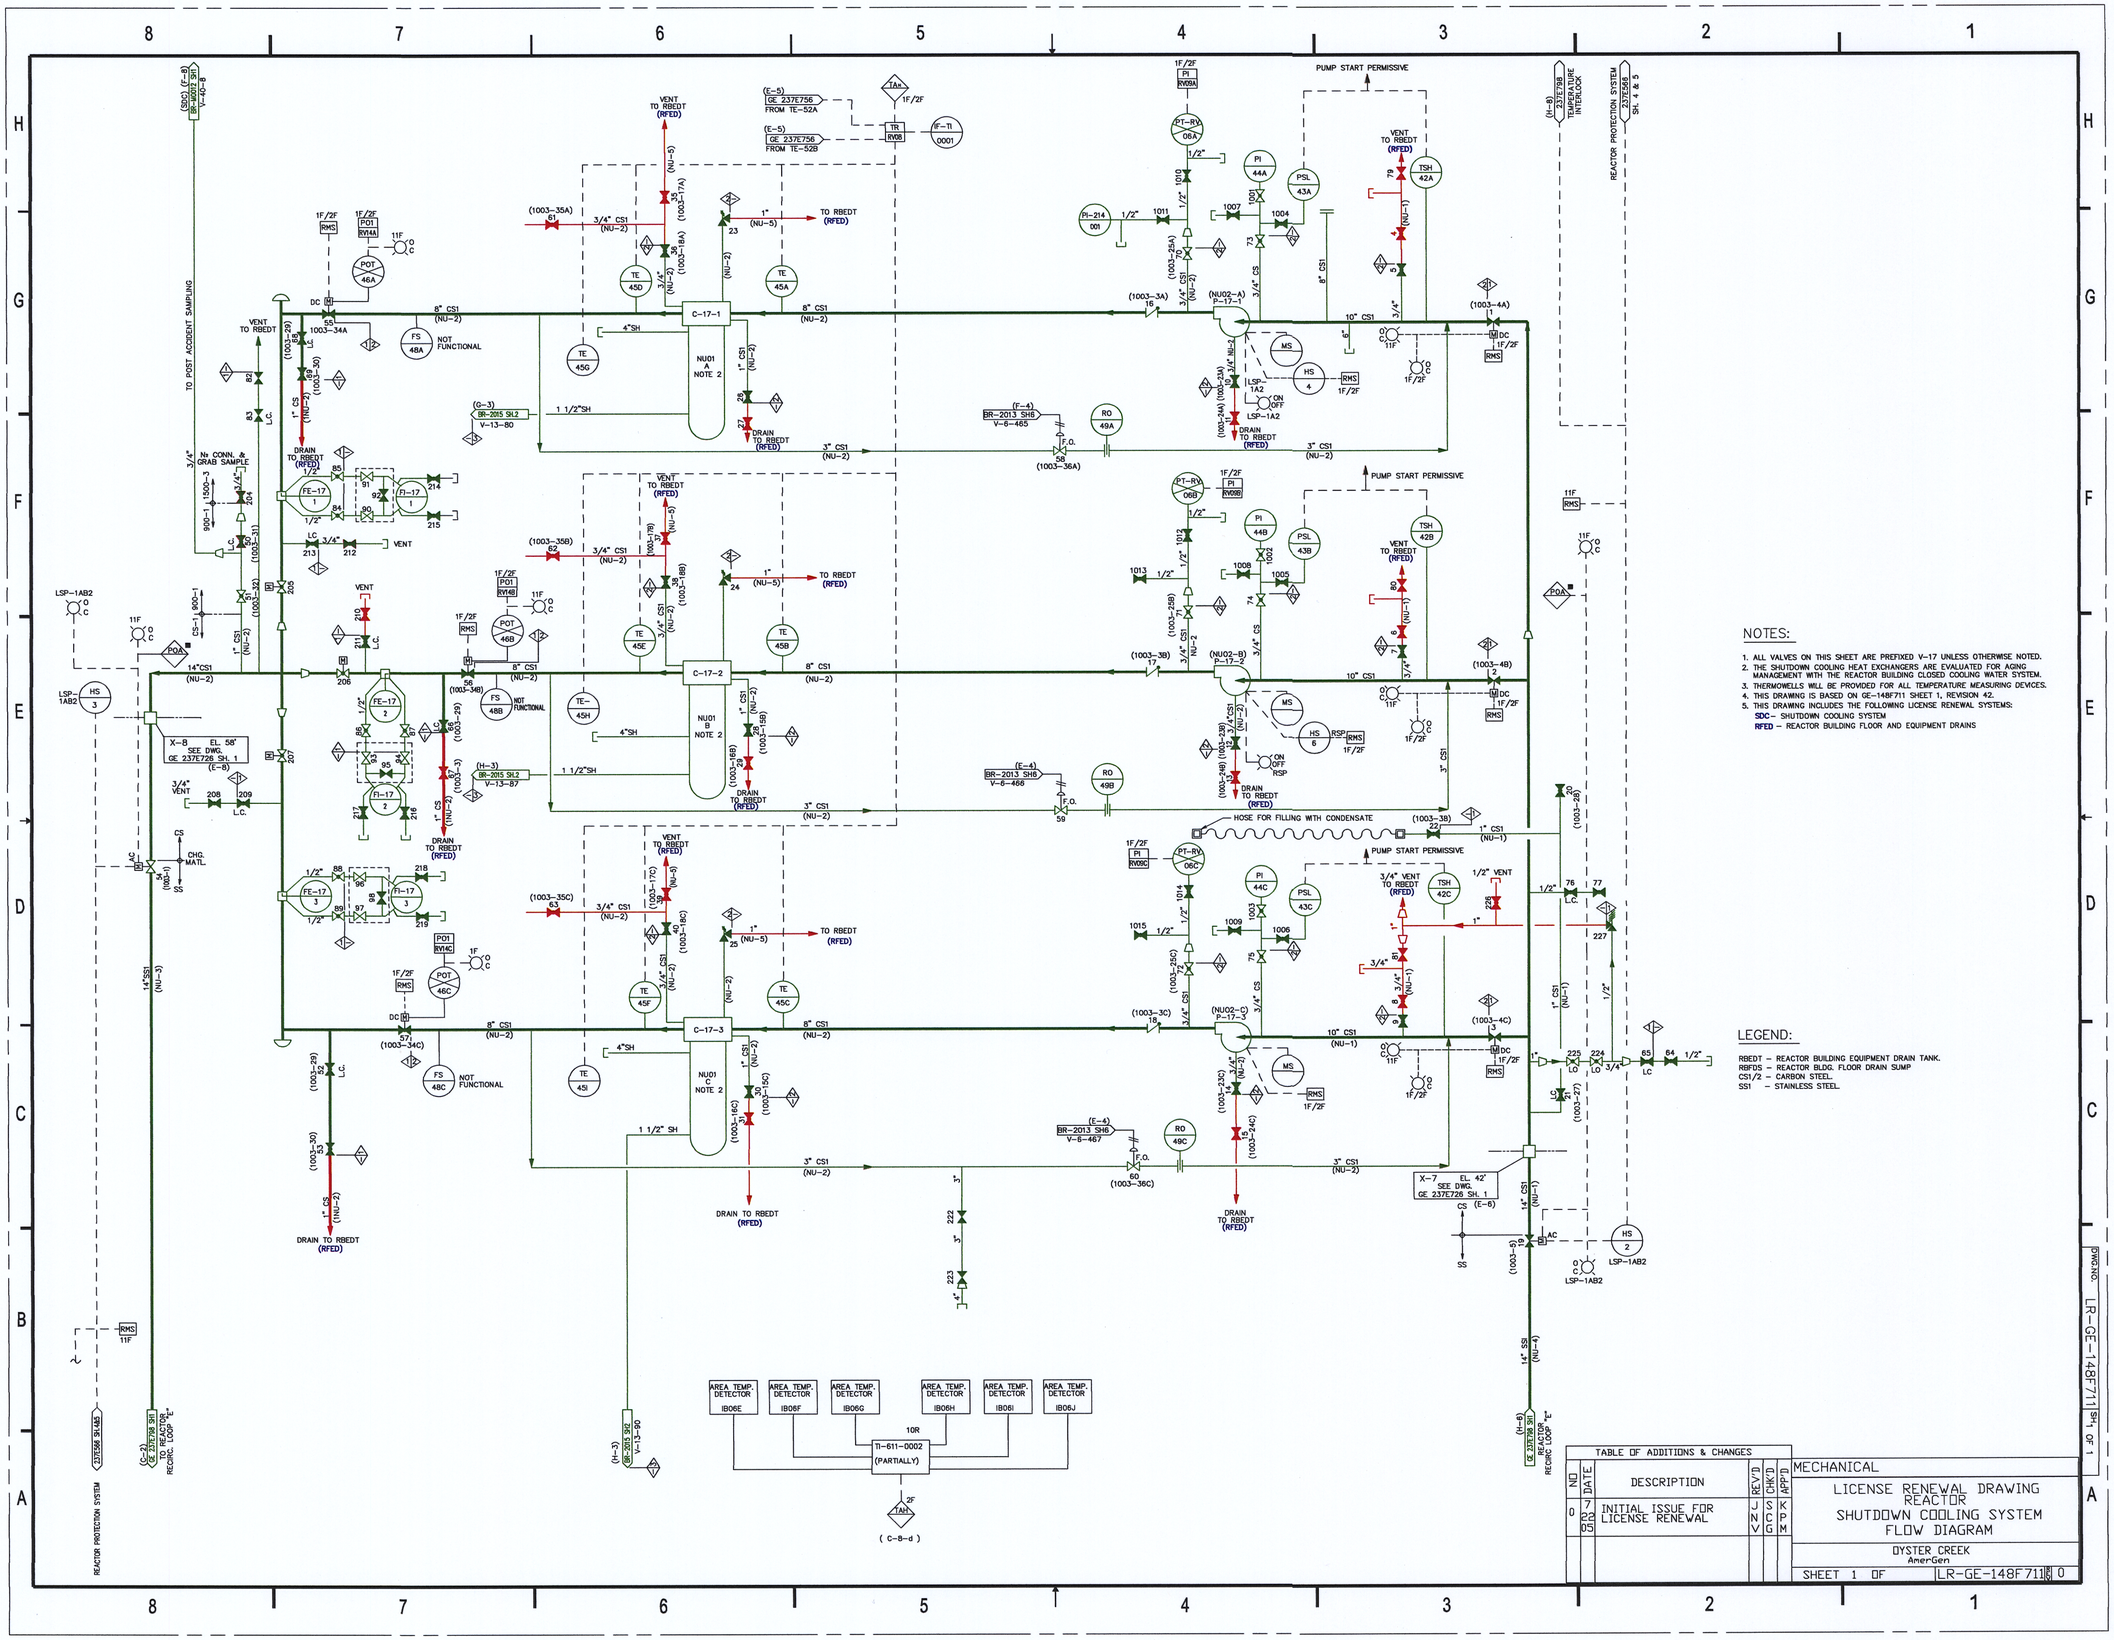


## NOTES:

1. ALL VALVES ON THIS SHEET ARE PREFIXED V-17 UNLESS OTHERWISE NOTED.
2. THE SHUTDOWN COOLING HEAT EXCHANGERS ARE EVALUATED FOR AGING MANAGEMENT WITH THE REACTOR BUILDING CLOSED COOLING WATER SYSTEM.
3. THERMOWELLS WILL BE PROVIDED FOR ALL TEMPERATURE MEASURING DEVICES.
4. THIS DRAWING IS BASED ON GE-148F711 SHEET 1, REVISION 42.
5. THIS DRAWING INCLUDES THE FOLLOWING LICENSE RENEWAL SYSTEMS:
   SDC – SHUTDOWN COOLING SYSTEM
   RFED – REACTOR BUILDING FLOOR AND EQUIPMENT DRAINS

## LEGEND:

RBEDT – REACTOR BUILDING EQUIPMENT DRAIN TANK.
RBFDS – REACTOR BLDG. FLOOR DRAIN SUMP
CS1/2 – CARBON STEEL.
SS1 – STAINLESS STEEL.

TABLE OF ADDITIONS & CHANGES

| NO | DATE | DESCRIPTION | REV'D | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | 7 22 05 | INITIAL ISSUE FOR LICENSE RENEWAL | J N V | S C G | K P M |

MECHANICAL

LICENSE RENEWAL DRAWING
REACTOR
SHUTDOWN COOLING SYSTEM
FLOW DIAGRAM

OYSTER CREEK
AmerGen

SHEET 1 OF LR-GE-148F711 0

DWG.NO. LR-GE-148F711 SH 1 OF 1

D-50