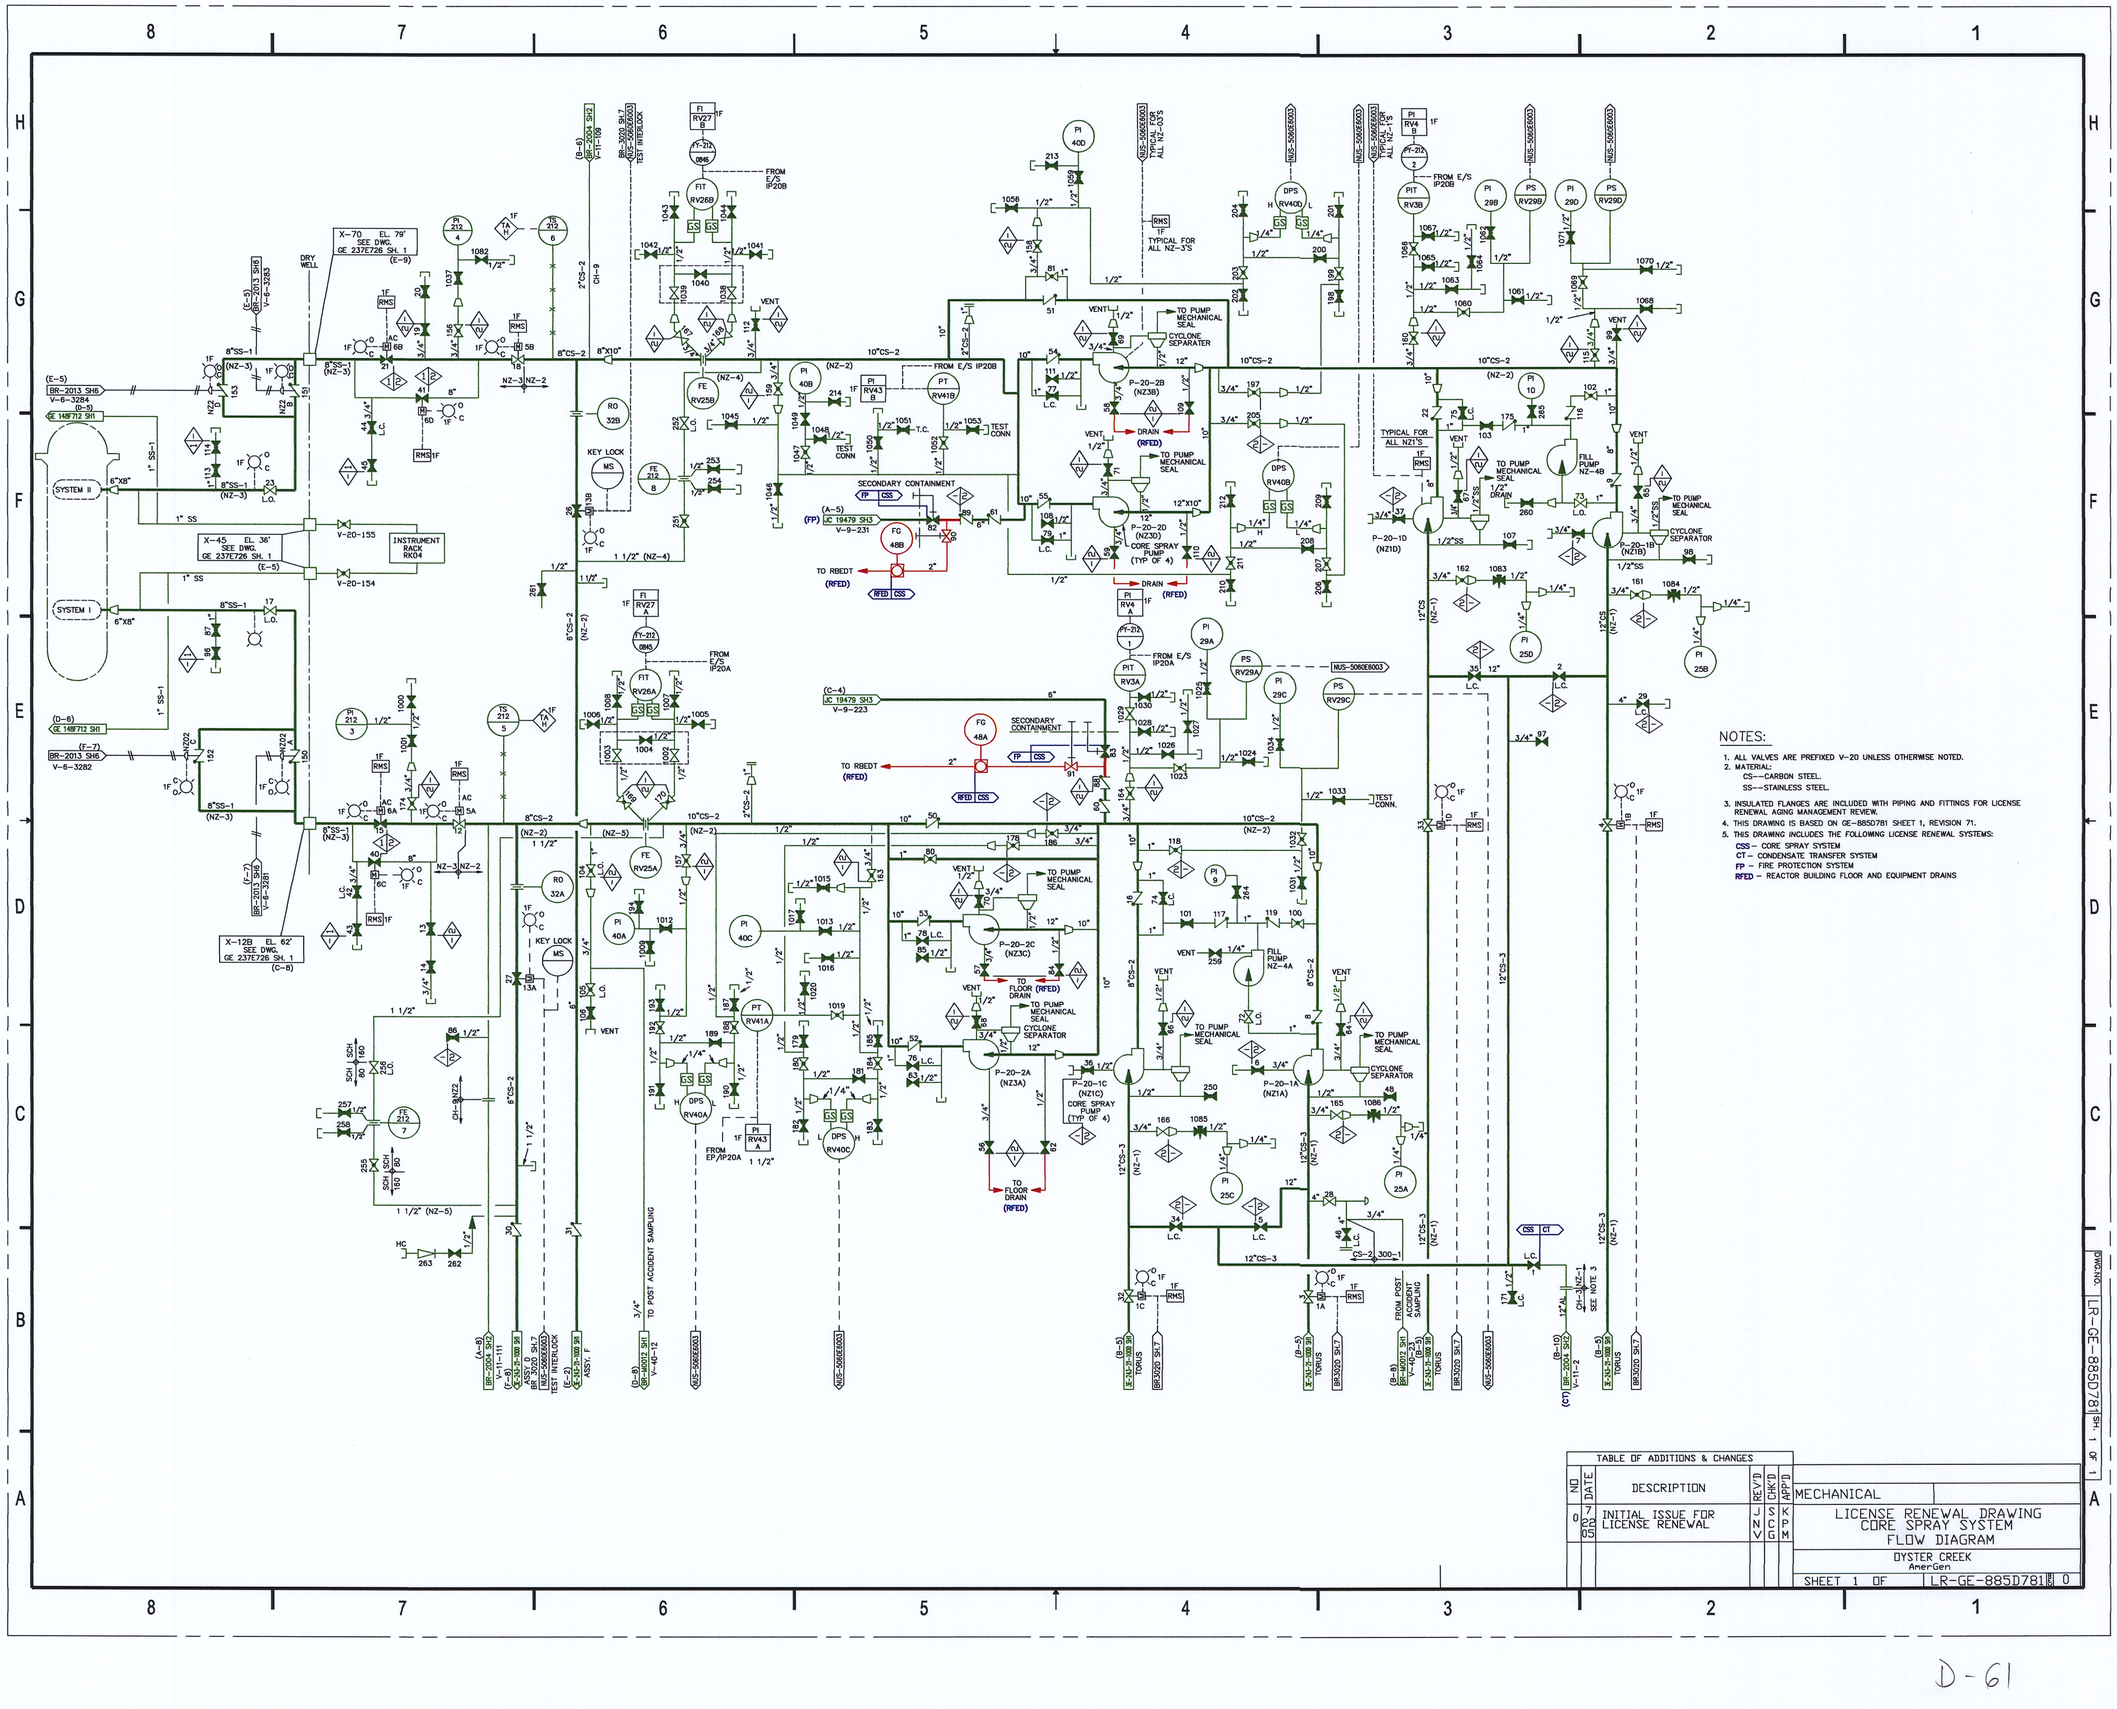
NOTES:
1. ALL VALVES ARE PREFIXED V-20 UNLESS OTHERWISE NOTED.
2. MATERIAL:
CS---CARBON STEEL.
SS---STAINLESS STEEL.
3. INSULATED FLANGES ARE INCLUDED WITH PIPING AND FITTINGS FOR LICENSE RENEWAL AGING MANAGEMENT REVIEW.
4. THIS DRAWING IS BASED ON GE-885D781 SHEET 1, REVISION 7I.
5. THIS DRAWING INCLUDES THE FOLLOWING LICENSE RENEWAL SYSTEMS:
CSS– CORE SPRAY SYSTEM
CT– CONDENSATE TRANSFER SYSTEM
FP – FIRE PROTECTION SYSTEM
RFED – REACTOR BUILDING FLOOR AND EQUIPMENT DRAINS
TABLE OF ADDITIONS & CHANGES
NO
DATE
DESCRIPTION
REV'D
CHK'D
APP'D
0
INITIAL ISSUE FOR LICENSE RENEWAL
MECHANICAL
LICENSE RENEWAL DRAWING
CORE SPRAY SYSTEM
FLOW DIAGRAM
OYSTER CREEK
AmerGen
SHEET 1 OF
LR-GE-885D781
DWG NO. LR-GE-885D781 SH. 1 OF 1

D-61