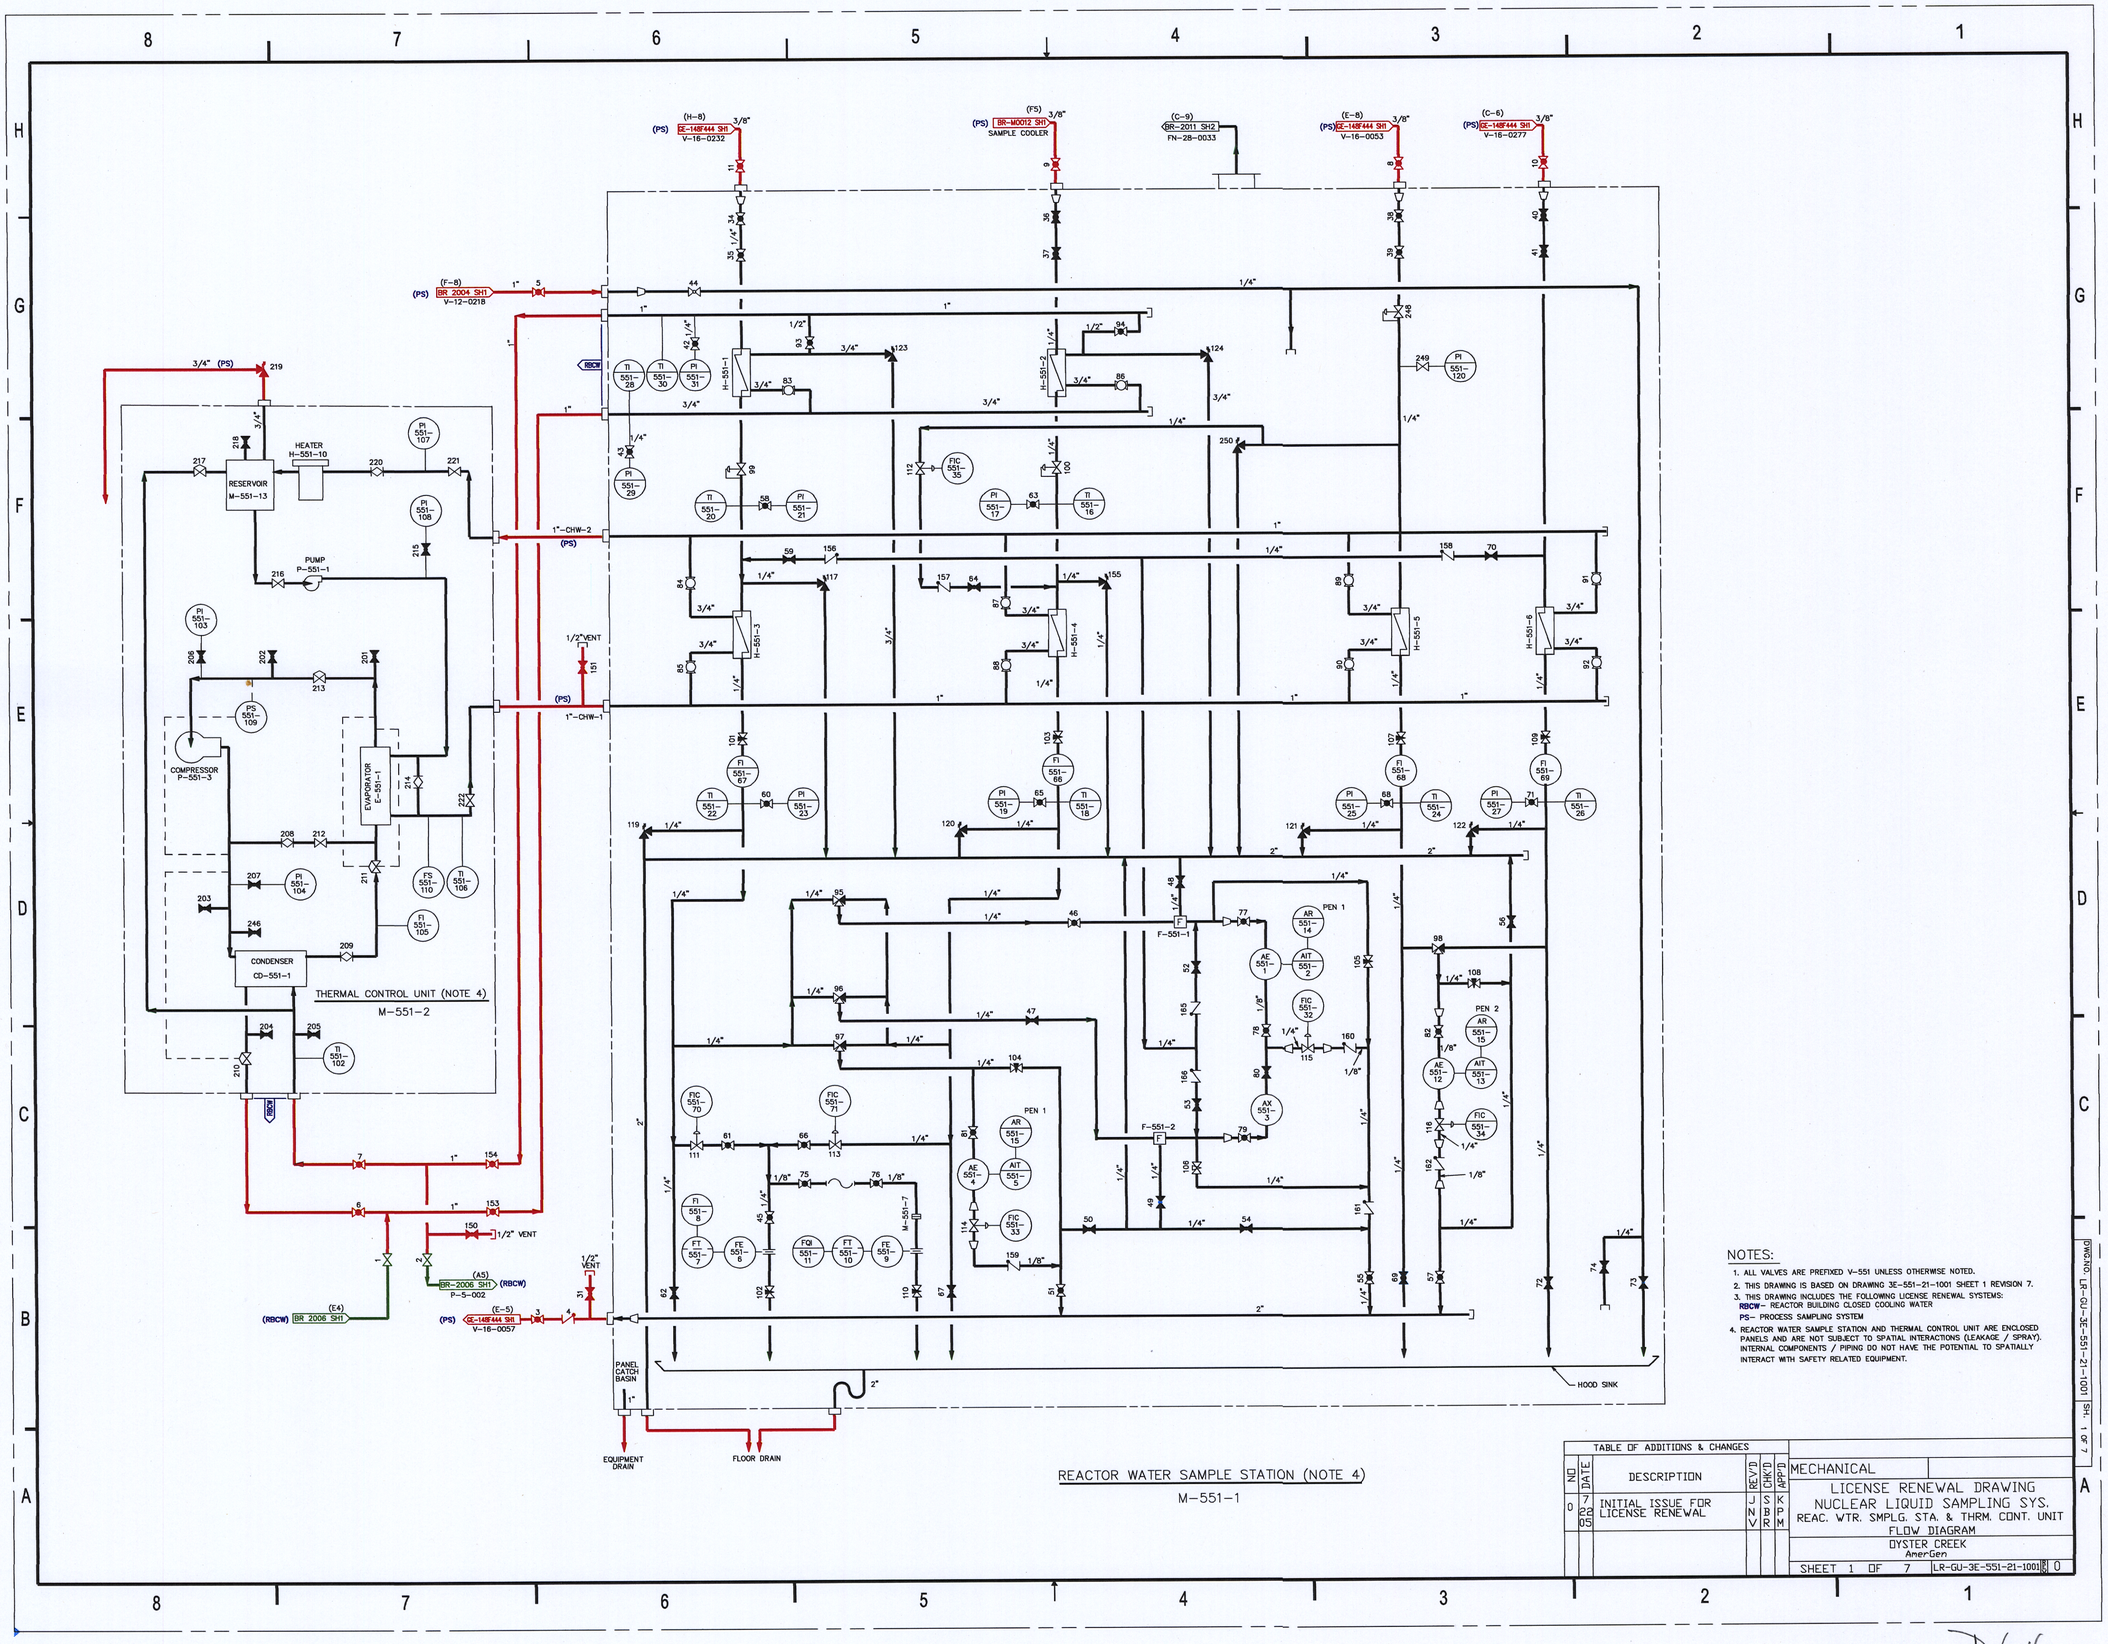


NOTES:

1. ALL VALVES ARE PREFIXED V-551 UNLESS OTHERWISE NOTED.
2. THIS DRAWING IS BASED ON DRAWING 3E-551-21-1001 SHEET 1 REVISION 7.
3. THIS DRAWING INCLUDES THE FOLLOWING LICENSE RENEWAL SYSTEMS:
   RBCW- REACTOR BUILDING CLOSED COOLING WATER
   PS- PROCESS SAMPLING SYSTEM
4. REACTOR WATER SAMPLE STATION AND THERMAL CONTROL UNIT ARE ENCLOSED PANELS AND ARE NOT SUBJECT TO SPATIAL INTERACTIONS (LEAKAGE / SPRAY). INTERNAL COMPONENTS / PIPING DO NOT HAVE THE POTENTIAL TO SPATIALLY INTERACT WITH SAFETY RELATED EQUIPMENT.

TABLE OF ADDITIONS & CHANGES

| NO | DATE | DESCRIPTION | REV'D | CHK'D | APP'D |
|---|---|---|---|---|---|
| 0 | 7 22 05 | INITIAL ISSUE FOR LICENSE RENEWAL | JNV | SBR | KPM |

MECHANICAL

LICENSE RENEWAL DRAWING
NUCLEAR LIQUID SAMPLING SYS.
REAC. WTR. SMPLG. STA. & THRM. CONT. UNIT
FLOW DIAGRAM
OYSTER CREEK
AmerGen

SHEET 1 OF 7 | LR-GU-3E-551-21-1001 | REV 0

DWG.NO. LR-GU-3E-551-21-1001 | SH. 1 OF 7

D64