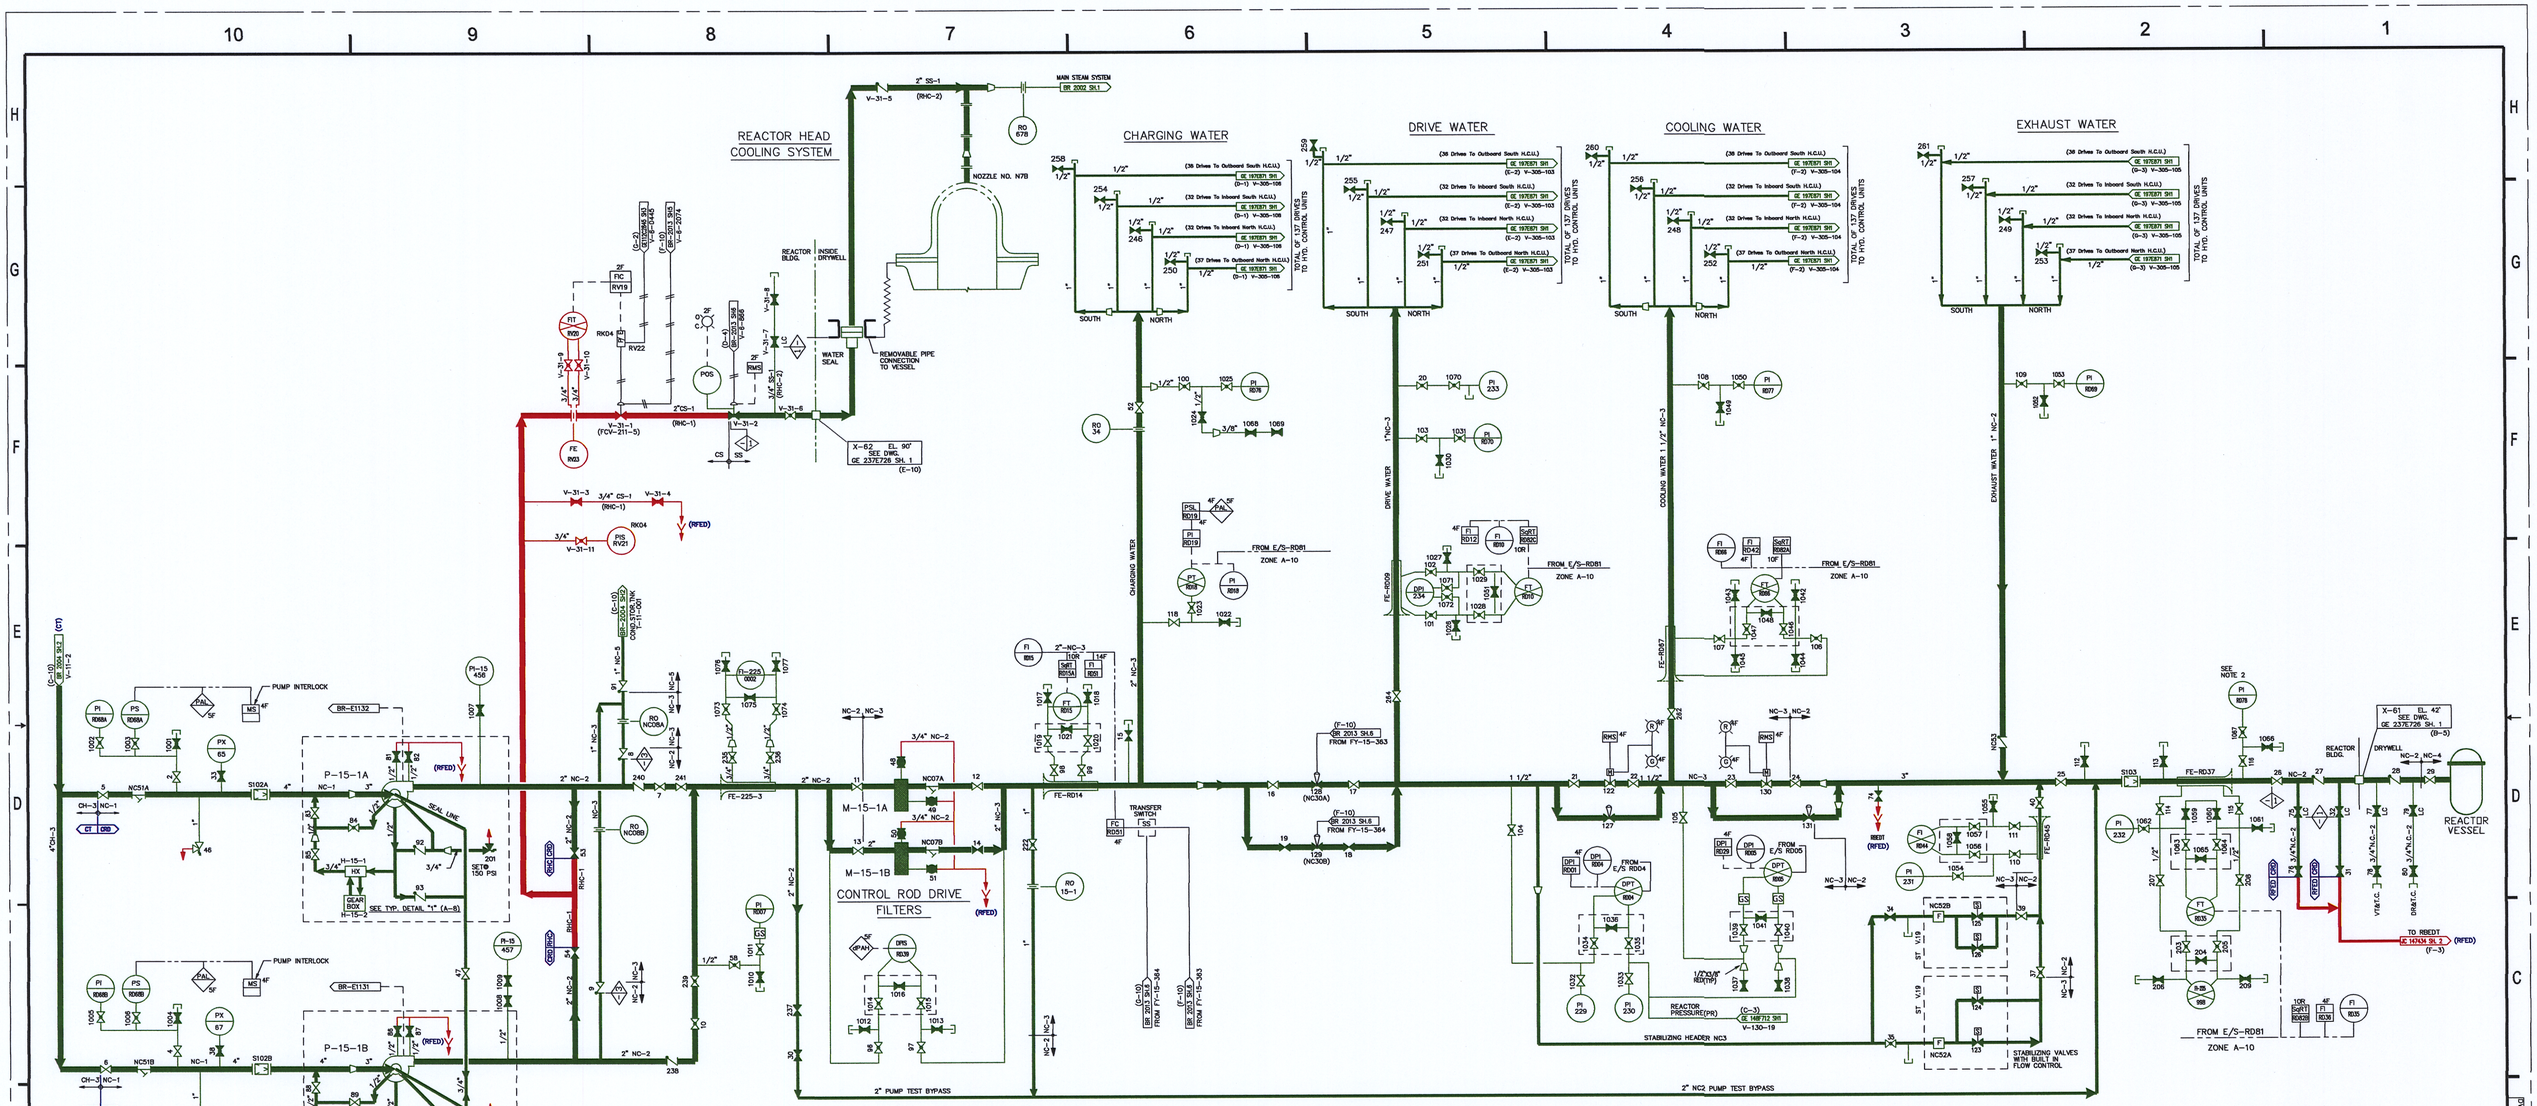

GENERAL NOTES:

1. ALL VALVES ARE PREFIXED V-15 UNLESS OTHERWISE NOTED.
2. THIS DRAWING IS BASED ON DRAWING GE-237E487 REVISION 65.
3. THIS DRAWING INCLUDES THE FOLLOWING LICENSE RENEWAL SYSTEMS:
   - CRD – CONTROL ROD DRIVE SYSTEM
   - RHC – REACTOR HEAD COOLING SYSTEM
   - RFED – REACTOR BUILDING FLOOR AND EQUIPMENT DRAINS
   - CT – CONDENSATE TRANSFER SYSTEM
4. THE CRD PUMP GEAR BOX LUBE OIL COOLER HEAT EXCHANGER IS PERIODICALLY REPLACED AND IS THEREFORE NOT LONG-LIVED AND NOT SUBJECT TO AGING MANAGEMENT REVIEW.

TABLE OF ADDITIONS & CHANGES

NO	DATE	DESCRIPTION	REV'D	CHK'D	APP'D
0	7 05	INITIAL ISSUE FOR LICENSE RENEWAL	JNV	HDH	KPM

MECHANICAL

LICENSE RENEWAL DRAWING
CONTROL ROD DRIVE SYSTEM
FLOW DIAGRAM

OYSTER CREEK
AmerGen

SHEET 1 OF 1 LR-GE-237E487 0

DWG NO. LR-GE-237E487 SH. 1 OF 1

D-56