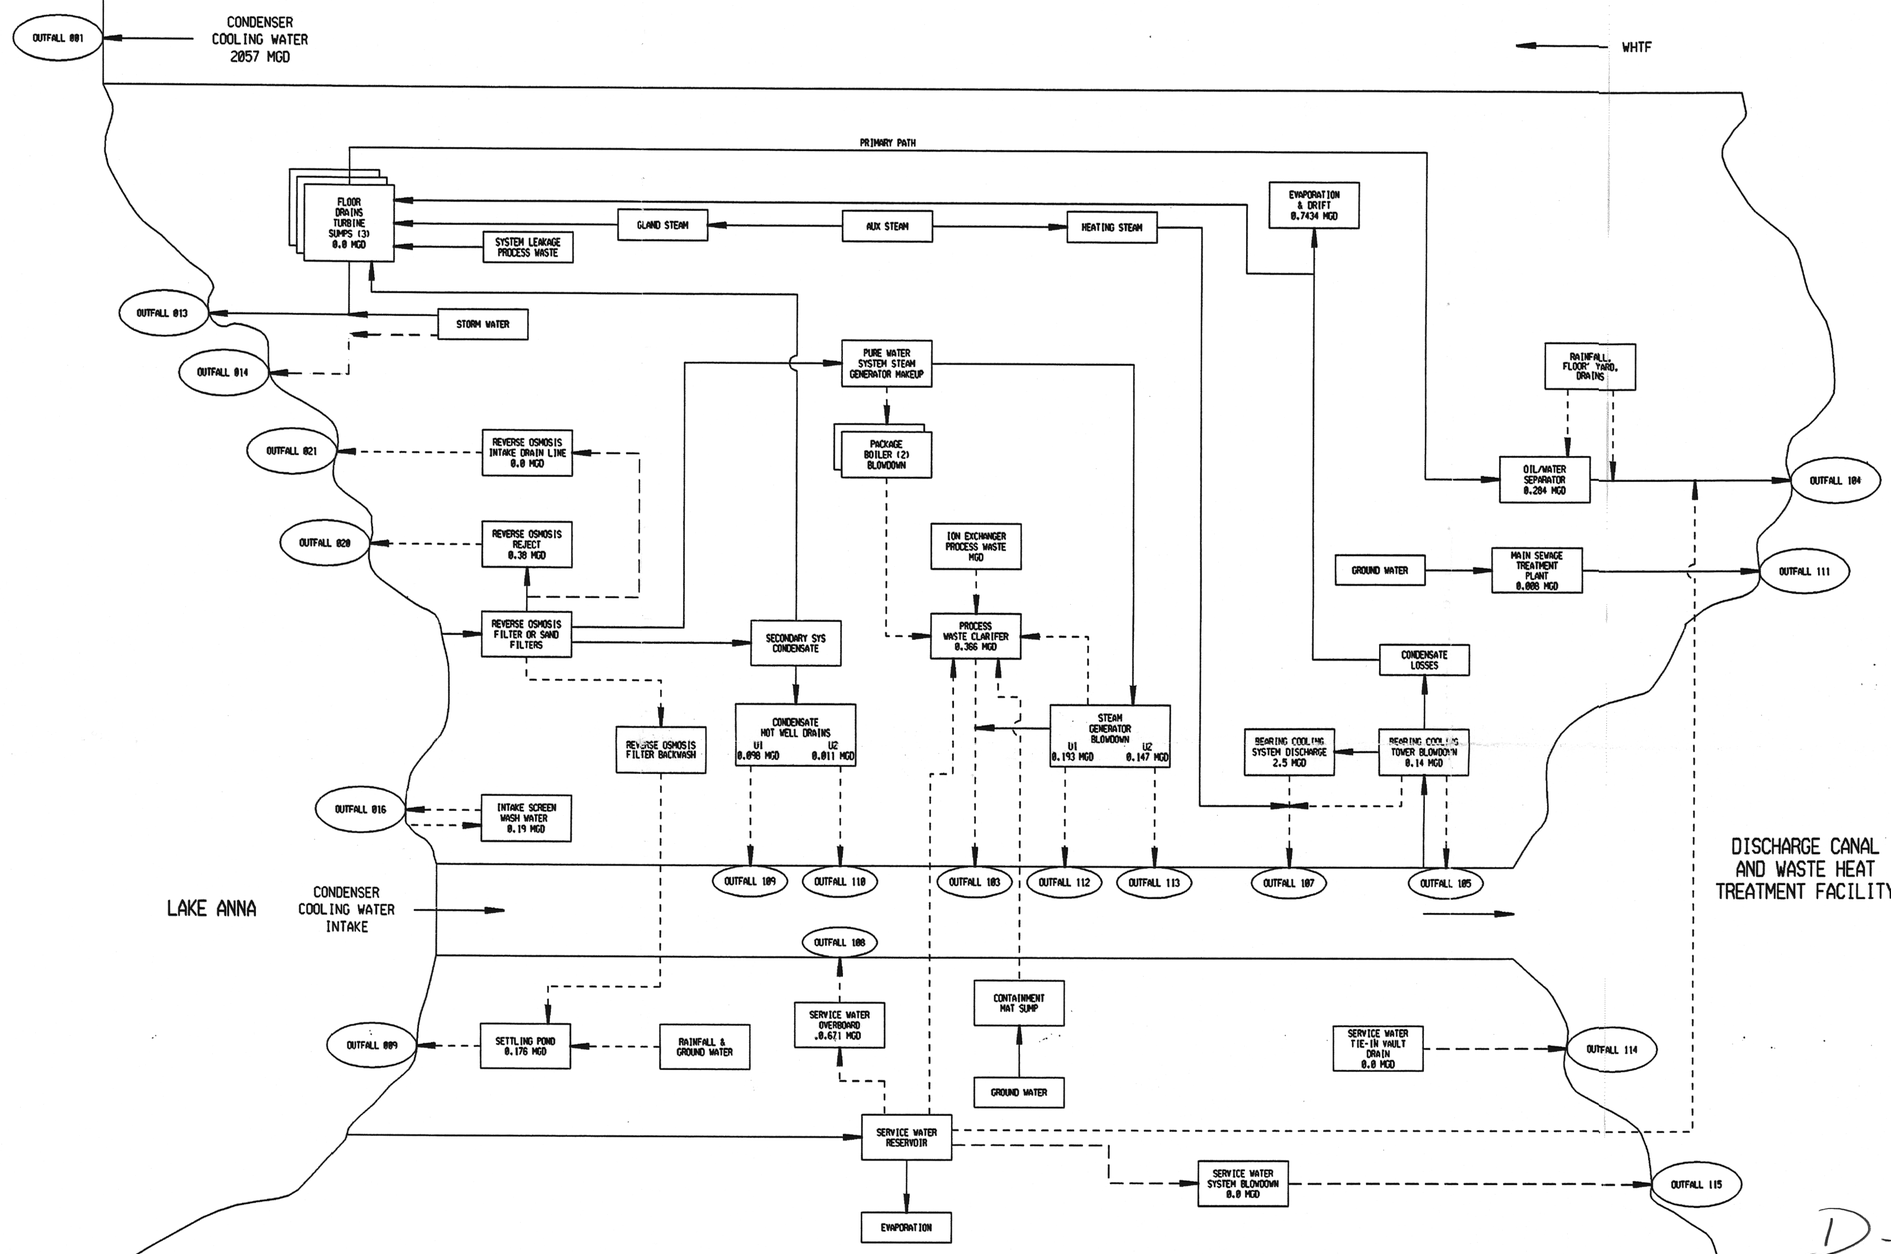

D-04

NOTES:
1. THIS DRAWING IS REQUIRED BY EPA FORM 3510-2C, ITEM II.A. TO SUPPORT NORTH ANNA VPDES PERMIT NO. VA0052451.
2. FLOWS BASED ON REPRESENTATIVE AVERAGES UNLESS OTHERWISE NOTED.
3. DASHED LINES REPRESENT INTERMITTENT DISCHARGES.

Dominion

NUCLEAR ENGINEERING
RICHMOND, VIRGINIA

ONE LINE DIAGRAM
STATION WATER FLOW
NORTH ANNA POWER STATION

REVISION DESCRIPTION	CAD NO: C:\usr\dgn\OUTFLOW3DGNj21	
REVISED FLOW RATES AND ADDED NOTES	DRAWING NO: NA-VPDES-083199-001	REV 2
DSGN SJO	SCALE: NONE UNLESS OTHERWISE NOTED	SH 1 OF 1

PC=EC1 & MC1

27-JUN-2005 08:07
STEV260

PRIOR TO USING FOR DESIGN WORK CHECK DMIS FOR WORK PENDING