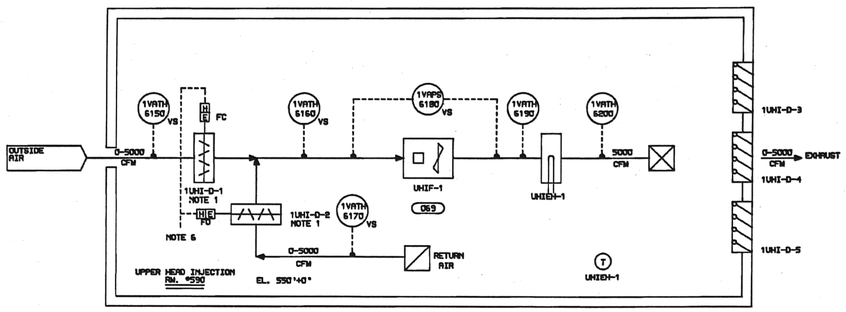

UPPER HEAD INJECTION ROOMS

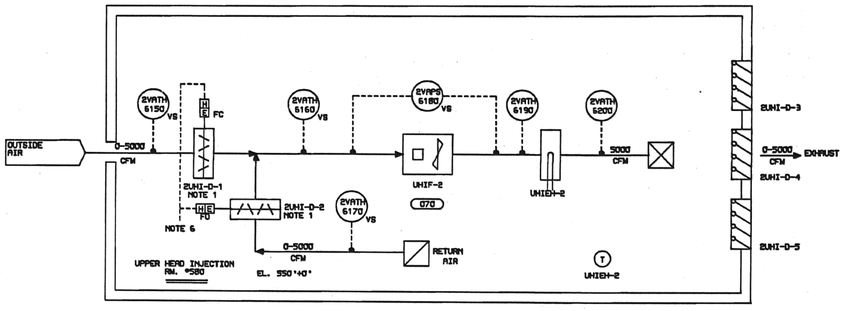

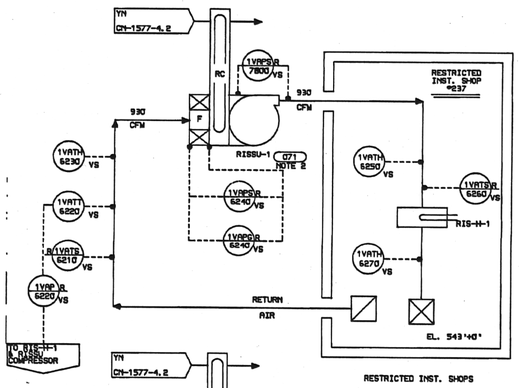

RESTRICTED INST. SHOPS

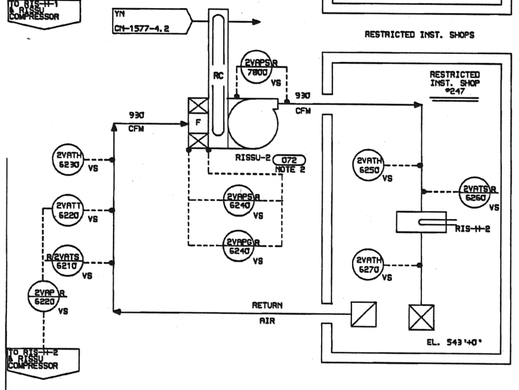

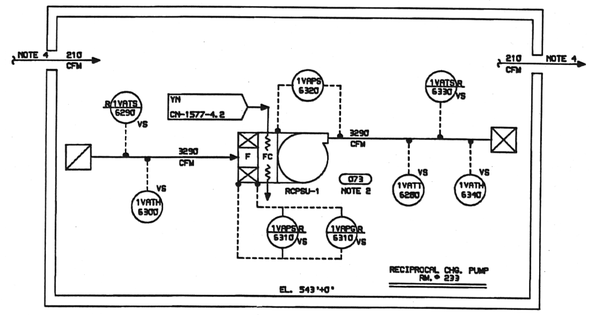

RECIPROCAL CHARGING PUMP ROOMS

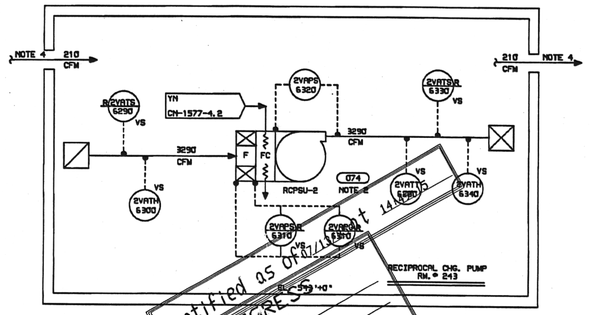

Certified as of Unit 1 MOD IN PROGRESS REV
MDR CE-28102
VNs 28102R

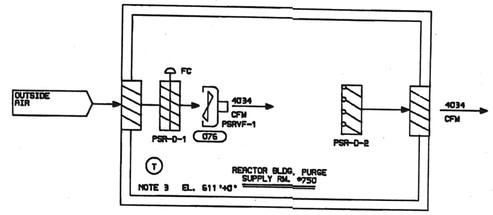

REACTOR BLDG. PURGE SUPPLY ROOMS

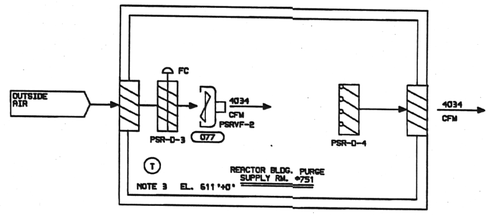

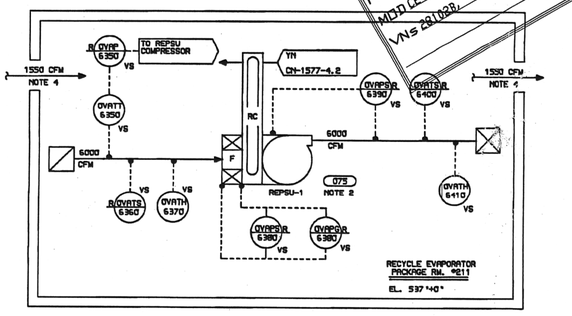

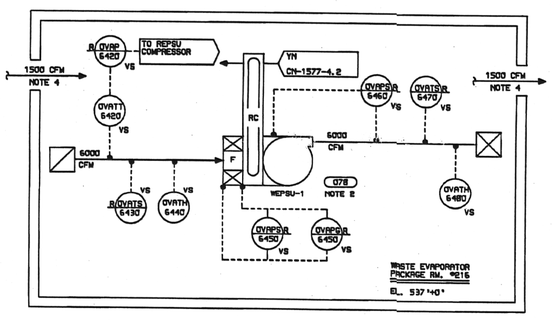

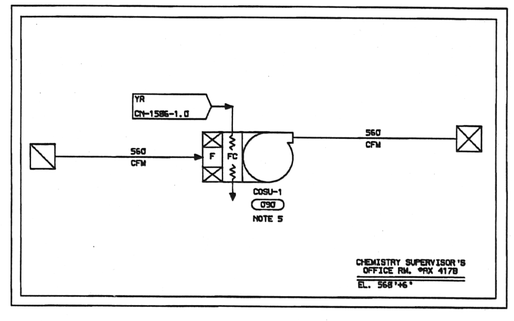

NOTES:
1. ROOM TEMP. CONTROLLER MODULATES OUTSIDE & RETURN AIR DAMPERS.
2. FOR CONDENSATE DRAINS SEE DWG. CN-1565-1.7.
3. ROOM T'STAT CONTROLS FAN.
4. SEE DWG. CN-1577-1.1.
5. FOR CONDENSATE DRAINS SEE DWG. CN-1565-1.0.
6. DAMPERS CONTROLLED FROM ROOM RTD.

2	REV. PER CN-1577-1.7 CO. 02 & 03	DHP	11-10-87	Eddie 11-11-87	DLA	RH	RRD		
1	REV. PER CO #CN-1577-1.7-C001	PWM	8-5-87	MWB	8-5-87	JFM			
	APPROVED & RELEASED	PWM	8-5-87	MWB	8-5-87	JFM			

NF CRILLEY	12-22-87	WAIVED	
WL PATTON	12-22-87	DH MURDOCK	8-6-88
PH WHITE	8-6-88	MR SMITH	8-6-88

CATAWBA NUCLEAR STATION UNITS 1 & 2

FLOW DIAGRAMS OF
AUXILIARY BUILDING VENTILATION
SYSTEM (VA)
MISC. ROOMS

CN-1577-1.7 2

D-08

W-8-29

ERN: CN0000405