



TXU Power
Comanche Peak Steam
Electric Station
P. O. Box 1002 (E01)
Glen Rose, TX 76043
Tel: 254 897 5209
Fax: 254 897 6652
mike.blevins@txu.com

Mike Blevins
Senior Vice President &
Chief Nuclear Officer

Ref: Tech. Spec. 5.6.5

CPSES-200502312
Log # TXX-05195

November 2, 2005

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, DC 20555

**SUBJECT: COMANCHE PEAK STEAM ELECTRIC STATION (CPSES)
DOCKET NO. 50-445
SUBMITTAL OF UNIT 1, CYCLE 12
CORE OPERATING LIMITS REPORT**

Gentlemen:

Enclosed is Revision 0 of the Core Operating Limits Reports for CPSES Unit 1, Cycle 12. This report is prepared and submitted pursuant to Technical Specification 5.6.5.

This communication contains no new licensing basis commitments regarding CPSES Units 1 and 2.

A001

A member of the **STARS** (Strategic Teaming and Resource Sharing) Alliance

Callaway • Comanche Peak • Diablo Canyon • Palo Verde • South Texas Project • Wolf Creek

TXX-05195
Page 2 of 2


Should you have any questions, please contact Mr. J. D. Seawright at (254) 897-0140.

Sincerely,

TXU Generation Company LP

By: TXU Generation Management Company LLC,
Its General Partner

Mike Blevins

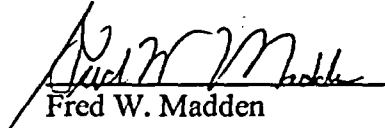By: 
Fred W. Madden
Director, Regulatory Affairs

JDS/js
Enclosure

c - B. S. Mallett, Region IV
M. C. Thadani, NRR
Resident Inspectors, CPSES

CPSES UNIT 1 CYCLE 12

CORE OPERATING LIMITS REPORT

October 2005

Prepared: Daniel E. Brozak Date: 10/21/2005
Daniel E. Brozak
Reactor Physics

Reviewed: Jonathan M. Ralston Date: 10-21-2005
Jonathan M. Ralston
Reactor Physics

Reviewed: Hugo da Silva Date: 10-21-2005
Hugo da Silva
Safety Analysis

Approved: Steve M. Maier Date: 10-21-2005
Steve M. Maier
Reactor Physics Supervisor

Approved: Whee G. Choe Date: 10-21-2005
Whee G. Choe
Safety Analysis Manager

DISCLAIMER

The information contained in this report was prepared for the specific requirement of TXU Generation Company LP and may not be appropriate for use in situations other than those for which it was specifically prepared. TXU Generation Company LP PROVIDES NO WARRANTY HEREUNDER, EXPRESS OR IMPLIED, OR STATUTORY, OF ANY KIND OR NATURE WHATSOEVER, REGARDING THIS REPORT OR ITS USE, INCLUDING BUT NOT LIMITED TO ANY WARRANTIES ON MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE.

By making this report available, TXU Generation Company LP does not authorize its use by others, and any such use is forbidden except with the prior written approval of TXU Generation Company LP. Any such written approval shall itself be deemed to incorporate the disclaimers of liability and disclaimers of warranties provided herein. In no event shall TXU Generation Company LP have any liability for any incidental or consequential damages of any type in connection with the use, authorized or unauthorized, of this report or of the information in it.

COLR for CPSES Unit 1 Cycle 12

TABLE OF CONTENTS

DISCLAIMER ii
TABLE OF CONTENTS iii
LIST OF TABLES iv
LIST OF FIGURES v

<u>SECTION</u>	<u>PAGE</u>
1.0 CORE OPERATING LIMITS REPORT	1
2.0 OPERATING LIMITS	2
2.1 SAFETY LIMITS	2
2.2 SHUTDOWN MARGIN	2
2.3 MODERATOR TEMPERATURE COEFFICIENT	2
2.4 ROD GROUP ALIGNMENT LIMITS	3
2.5 SHUTDOWN BANK INSERTION LIMITS	3
2.6 CONTROL BANK INSERTION LIMITS	4
2.7 PHYSICS TESTS EXCEPTIONS - MODE 2	4
2.8 HEAT FLUX HOT CHANNEL FACTOR	4
2.9 NUCLEAR ENTHALPY RISE HOT CHANNEL FACTOR	5
2.10 AXIAL FLUX DIFFERENCE	6
2.11 REACTOR TRIP SYSTEM INSTRUMENTATION	6
2.12 RCS PRESSURE, TEMPERATURE, AND FLOW DEPARTURE FROM NUCLEATE BOILING LIMITS	7
2.13 BORON CONCENTRATION	8
3.0 REFERENCES	8

COLR for CPSES Unit 1 Cycle 12

LIST OF TABLES

<u>TABLE</u>		<u>PAGE</u>
1	$F_0(Z)$ MARGIN DECREASES IN EXCESS OF 2 % PER 31 EFPD	9

COLR for CPSES Unit 1 Cycle 12

LIST OF FIGURES

<u>FIGURE</u>		<u>PAGE</u>
1	REACTOR CORE SAFETY LIMITS	10
2	ROD BANK INSERTION LIMITS VERSUS THERMAL POWER	11
3	K(Z) - NORMALIZED $F_0(Z)$ AS A FUNCTION OF CORE HEIGHT	12
4	W(Z) AS A FUNCTION OF CORE HEIGHT - (MAXIMUM)	13
5	W(Z) AS A FUNCTION OF CORE HEIGHT - (150 MWD/MTU)	14
6	W(Z) AS A FUNCTION OF CORE HEIGHT - (10,000 MWD/MTU)	15
7	W(Z) AS A FUNCTION OF CORE HEIGHT - (19,000 MWD/MTU)	16
8	AXIAL FLUX DIFFERENCE LIMITS AS A FUNCTION OF RATED THERMAL POWER	17

COLR for CPSES Unit 1 Cycle 12

1.0 CORE OPERATING LIMITS REPORT

This Core Operating Limits Report (COLR) for CPSES UNIT 1 CYCLE 12 has been prepared in accordance with the requirements of Technical Specification 5.6.5.

The Technical Specifications affected by this report are listed below:

SL 2.1	SAFETY LIMITS
LCO 3.1.1	SHUTDOWN MARGIN
LCO 3.1.3	MODERATOR TEMPERATURE COEFFICIENT
LCO 3.1.4	ROD GROUP ALIGNMENT LIMITS
LCO 3.1.5	SHUTDOWN BANK INSERTION LIMITS
LCO 3.1.6	CONTROL BANK INSERTION LIMITS
LCO 3.1.8	PHYSICS TESTS EXCEPTIONS - MODE 2
LCO 3.2.1	HEAT FLUX HOT CHANNEL FACTOR
LCO 3.2.2	NUCLEAR ENTHALPY RISE HOT CHANNEL FACTOR
LCO 3.2.3	AXIAL FLUX DIFFERENCE
LCO 3.3.1	REACTOR TRIP SYSTEM INSTRUMENTATION
LCO 3.4.1	RCS PRESSURE, TEMPERATURE, AND FLOW DEPARTURE FROM NUCLEATE BOILING LIMITS
LCO 3.9.1	BORON CONCENTRATION

2.0 OPERATING LIMITS

The cycle-specific parameter limits for the specifications listed in Section 1.0 are presented in the following subsections. These limits have been developed using the NRC-approved methodologies specified in Technical Specification 5.6.5b, Items 3, 6 through 16 and 18. These limits have been determined such that all applicable limits of the safety analysis are met.

2.1 SAFETY LIMITS (SL 2.1)

2.1.1 In MODES 1 and 2, the combination of thermal power, reactor coolant system highest loop average temperature, and pressurizer pressure shall not exceed the safety limits specified in Figure 1.

2.2 SHUTDOWN MARGIN (SDM) (LCO 3.1.1)

2.2.1 The SDM shall be greater than or equal to 1.3% $\Delta k/k$ in MODE 2 with $K_{eff} < 1.0$, and in MODES 3, 4, and 5.

2.3 MODERATOR TEMPERATURE COEFFICIENT (MTC) (LCO 3.1.3)

2.3.1 The MTC upper and lower limits, respectively, are:

The BOL/ARO/HZP-MTC shall be less positive than +5 pcm/F.

The EOL/ARO/RTP-MTC shall be less negative than -40 pcm/F.

COLR for CPSES Unit 1 Cycle 12

2.3.2 SR 3.1.3.2

The MTC surveillance limit is:

The 300 ppm/ARO/RTP-MTC shall be less negative than or equal to -31 pcm/F.

The 60 ppm/ARO/RTP-MTC shall be less negative than or equal to -38 pcm/F.

where: BOL stands for Beginning of Cycle Life

ARO stands for All Rods Out

HZP stands for Hot Zero THERMAL POWER

EOL stands for End of Cycle Life

RTP stands for RATED THERMAL POWER

2.4 ROD GROUP ALIGNMENT LIMITS (LCO 3.1.4)

2.4.1 The SDM shall be greater than or equal to 1.3% $\Delta k/k$ in MODES 1 and 2.

2.5 SHUTDOWN BANK INSERTION LIMITS (LCO 3.1.5)

2.5.1 The shutdown rods shall be fully withdrawn. Fully withdrawn shall be the condition where shutdown rods are at a position within the interval of 218 and 231 steps withdrawn, inclusive.

COLR for CPSES Unit 1 Cycle 12

2.6 CONTROL BANK INSERTION LIMITS (LCO 3.1.6)

2.6.1 The control banks shall be limited in physical insertion as shown in Figure 2.

2.6.2 The control banks shall always be withdrawn and inserted in the prescribed sequence. For withdrawal, the sequence is control bank A, control bank B, control bank C, and control bank D. The insertion sequence is the reverse of the withdrawal sequence.

2.6.3 A 115 step Tip-to-Tip relationship between each sequential control bank shall be maintained.

2.7 PHYSICS TESTS EXCEPTIONS - MODE 2 (LCO 3.1.8)

2.7.1 The SDM shall be greater than or equal to 1.3% $\Delta k/k$ in MODE 2 during PHYSICS TESTS.

2.8 HEAT FLUX HOT CHANNEL FACTOR ($F_q(Z)$) (LCO 3.2.1)

$$2.8.1 \quad F_q(Z) \leq \frac{F_0^{HTT}}{P} [K(Z)] \text{ for } P > 0.5$$

$$F_q(Z) \leq \frac{F_0^{HTT}}{0.5} [K(Z)] \text{ for } P \leq 0.5$$

where: $P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$

COLR for CPSES Unit 1 Cycle 12

2.8.2 $F_0^{HT} = 2.42$

2.8.3 $K(Z)$ is provided in Figure 3.

2.8.4 Maximum elevation dependent $W(Z)$ values are given in Figure 4. Figures 5, 6, and 7 give burnup dependent values for $W(Z)$. Figures 5, 6, and 7 can be used in place of Figure 4 to interpolate or extrapolate (via a three point fit) the $W(Z)$ at a particular burnup.

2.8.5 SR 3.2.1.2

If the two most recent $F_0(Z)$ evaluations show an increase in the expression

maximum over Z $[F_0^c(Z) / K(Z)],$

the burnup dependent values in Table 1 shall be used instead of a constant 2% to increase $F_0^N(Z)$ per Surveillance Requirement 3.2.1.2.a. A constant factor of 2% shall be used for all cycle burnups that are outside the range of Table 1.

2.9 NUCLEAR ENTHALPY RISE HOT CHANNEL FACTOR ($F_{\Delta H}^N$) (LCO 3.2.2)

2.9.1 $F_{\Delta H}^N \leq F_{\Delta H}^{HT} [1 + PF_{\Delta H} (1-P)]$

where: $P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$

2.9.2 $F_{\Delta H}^{HT} = 1.55$

2.9.3 $PF_{\Delta H} = 0.3$

COLR for CPSES Unit 1 Cycle 12

2.10 AXIAL FLUX DIFFERENCE (AFD) (LCO 3.2.3)

2.10.1 The AFD target band is +5%, -12% at 100% RTP linearly expanding to +20%, -17% at 50% RTP. Below 50% RTP, the AFD target band remains constant at +20%, -17%.

2.10.2 The AFD Acceptable Operation Limits are provided in Figure 8.

2.11 REACTOR TRIP SYSTEM (RTS) INSTRUMENTATION (LCO 3.3.1)

2.11.1 The numerical values pertaining to the Overtemperature N-16 reactor trip setpoint are listed below;

$$K_1 = 1.138$$

$$K_2 = 0.0139 / ^\circ\text{F}$$

$$K_3 = 0.00071 / \text{psig}$$

$$T_c = 559.7 ^\circ\text{F}$$

$$P^1 \geq 2235 \text{ psig}$$

$$T_1 \geq 10 \text{ sec}$$

$$T_2 \leq 3 \text{ sec}$$

$$\begin{aligned} f_1(\Delta q) &= 0.00 \cdot \{(q_t - q_b) + 65\} \quad \text{when } (q_t - q_b) \leq -65\% \text{ RTP} \\ &= 0\% \quad \text{when } -65\% \text{ RTP} < (q_t - q_b) < +7.4\% \text{ RTP} \\ &= 2.335 \cdot \{(q_t - q_b) - 7.4\} \quad \text{when } (q_t - q_b) \geq +7.4\% \text{ RTP} \end{aligned}$$

COLR for CPSES Unit 1 Cycle 12

2.12 RCS PRESSURE, TEMPERATURE, AND FLOW DEPARTURE FROM
NUCLEATE BOILING (DNB) LIMITS (LCO 3.4.1)

2.12.1 RCS DNB parameters for pressurizer pressure, RCS average temperature, and RCS total flow rate shall be within the surveillance limits specified below:

2.12.2 SR 3.4.1.1

Pressurizer pressure \geq 2220 psig (4 channels)
 \geq 2222 psig (3 channels)

The pressurizer pressure limits correspond to the analytical limit of 2205 psig used in the safety analysis with allowance for measurement uncertainty. These uncertainties are based on the use of control board indications and the number of available channels.

2.12.3 SR 3.4.1.2

RCS average temperature \leq 592 °F (4 channels)
 \leq 592 °F (3 channels)

The RCS average temperature limits correspond to the analytical limit of 595.7 °F used in the safety analysis with allowance for measurement uncertainty. These uncertainties are based on the use of control board indications and the number of available channels.

COLR for CPSES Unit 1 Cycle 12

2.12.4 SR 3.4.1.3

The RCS total flow rate based on precision heat balance shall be $\geq 397,200$ gpm

2.12.5 SR 3.4.1.4

The RCS total flow rate based on precision heat balance shall be $\geq 397,200$ gpm

The required RCS flow, based on an elbow tap differential pressure instrument measurement prior to MODE 1 after the refueling outage, shall be greater than 317,000 gpm.

2.13 BORON CONCENTRATION (LCO 3.9.1)

2.13.1 The required refueling boron concentration is 1832 ppm.

3.0 REFERENCES

Technical Specification 5.6.5.

COLR for CPSES Unit 1 Cycle 12


Table 1

$F_0(Z)$ MARGIN DECREASES IN EXCESS OF 2 % PER 31 EFPD

Cycle Burnup (MWD/MTU)	Maximum Decrease In $F_0(Z)$ Margin (Percent)
9320	2.00
9530	2.03
9730	2.15
9940	2.20
10150	2.20
10360	2.18
10570	2.11
10780	2.00

Note: All Cycle burnups outside the range of the table shall use a constant 2% decrease in $F_0(Z)$ margin for compliance with the 3.2.1.2.a Surveillance Requirements. Linear interpolation is acceptable to determine the $F_0(Z)$ margin decrease for cycle burnups which fall between the specified burnups.


COLR for CPSES Unit 1 Cycle 12
 FIGURE 1
 REACTOR CORE SAFETY LIMITS

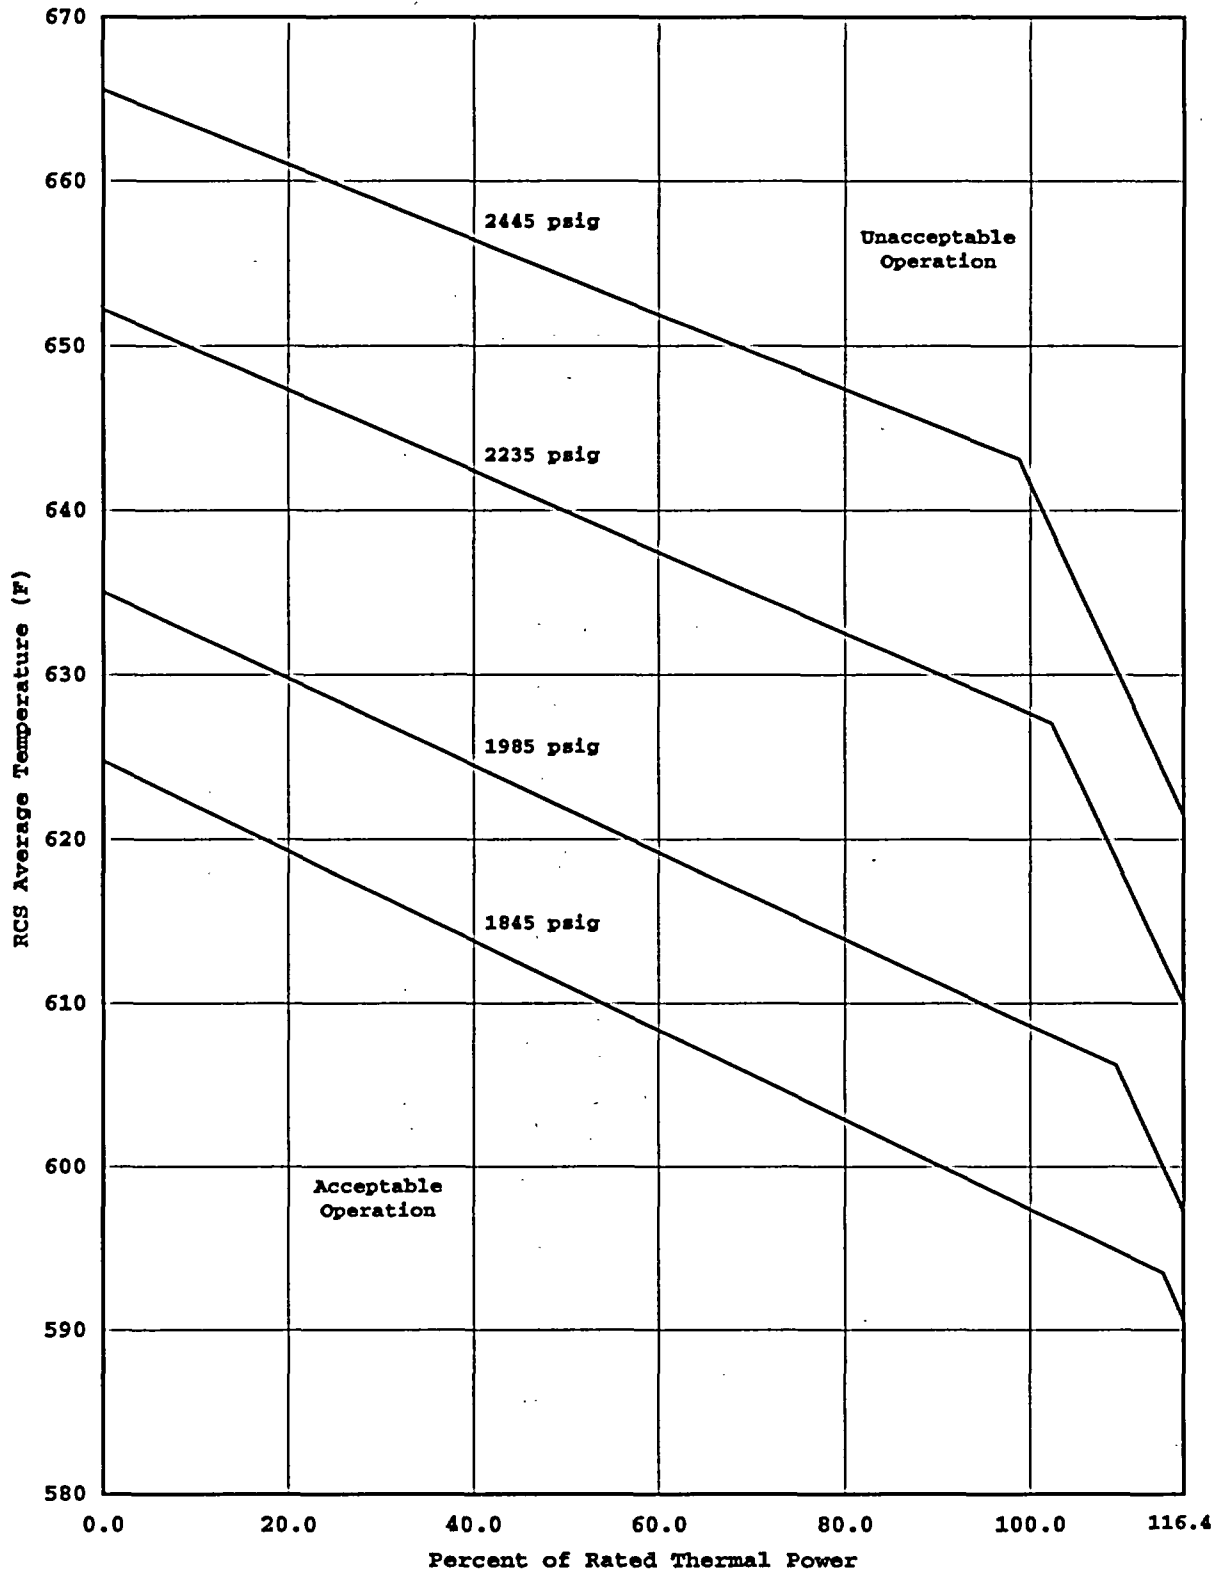

COLR for CPSES Unit 1 Cycle 12

FIGURE 2

ROD BANK INSERTION LIMITS VERSUS THERMAL POWER

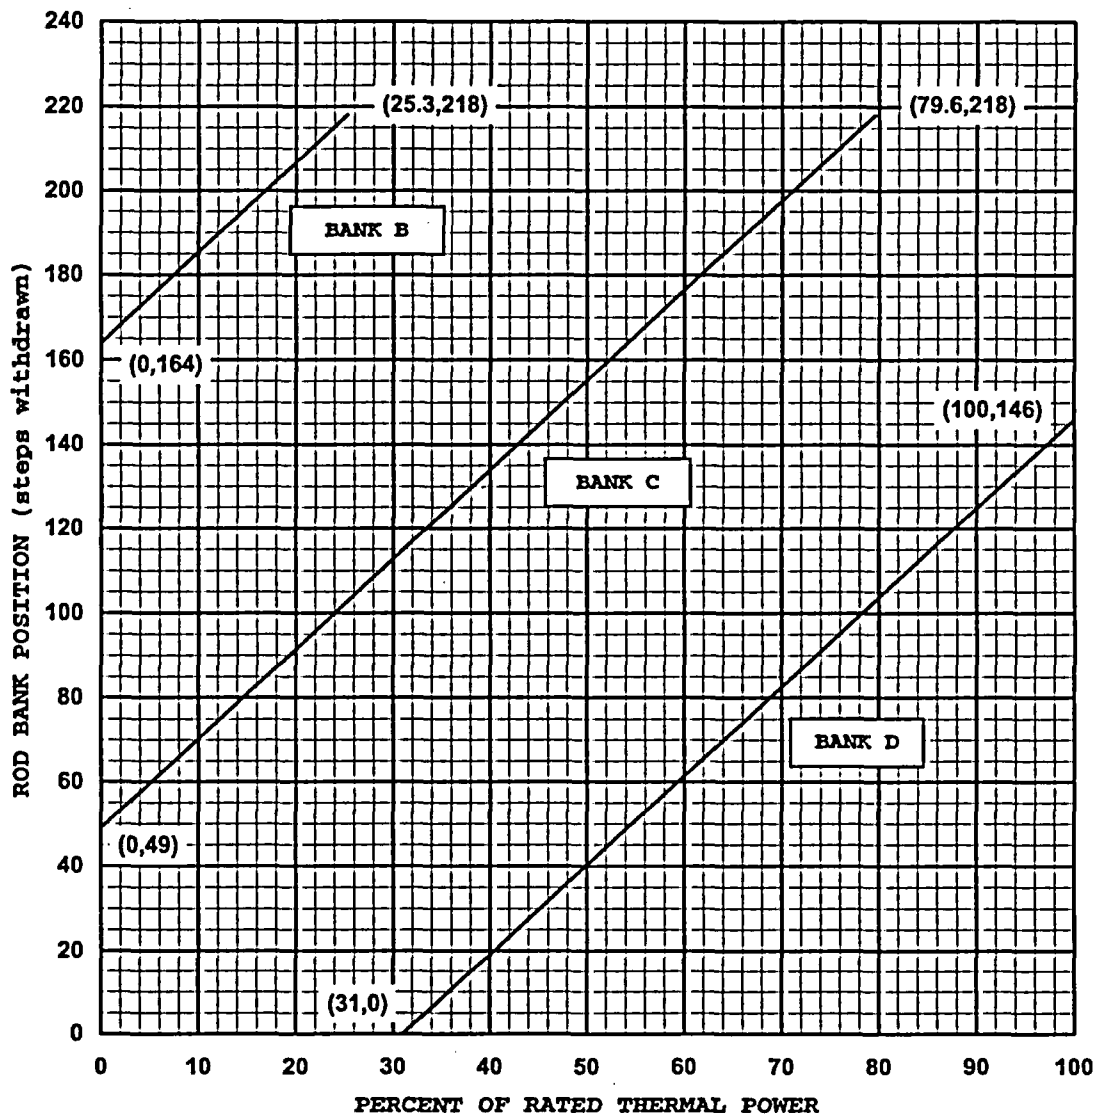


- NOTES:
1. Fully withdrawn shall be the condition where control rods are at a position within the interval of 218 and 231 steps withdrawn, inclusive.
 2. Control Bank A shall be fully withdrawn.

COLR for CPSES Unit 1 Cycle 12

FIGURE 3

K(Z) - NORMALIZED $F_0(Z)$ AS A FUNCTION OF CORE HEIGHT

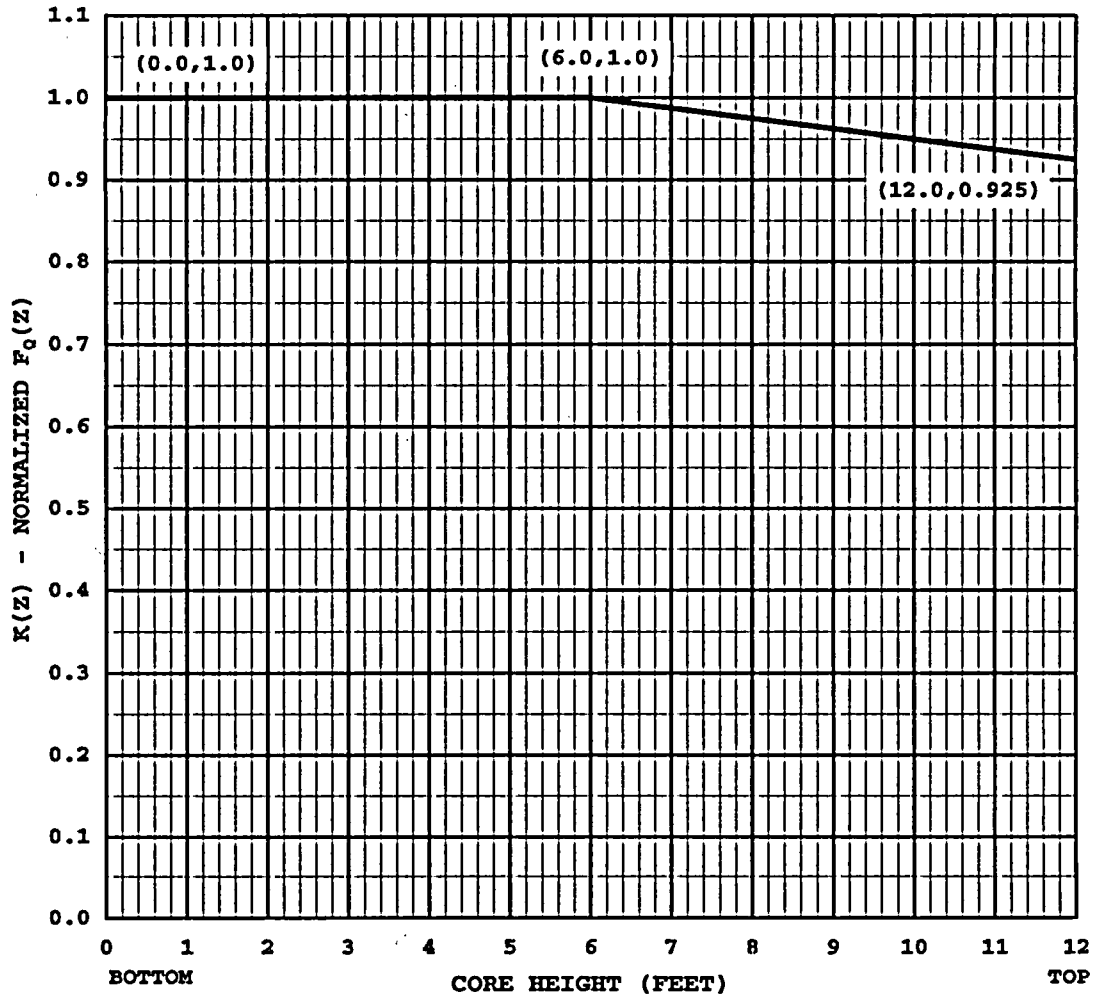


Axial Node	K(Z)	Axial Node	K(Z)	Axial Node	K(Z)	Axial Node	K(Z)
61	0.9250	53	0.9450	45	0.9650	37	0.9850
60	0.9275	52	0.9475	44	0.9675	36	0.9875
59	0.9300	51	0.9500	43	0.9700	35	0.9900
58	0.9325	50	0.9525	42	0.9725	34	0.9925
57	0.9350	49	0.9550	41	0.9750	33	0.9950
56	0.9375	48	0.9575	40	0.9775	32	0.9975
55	0.9400	47	0.9600	39	0.9800	1 - 31	1.0000
54	0.9425	46	0.9625	38	0.9825		

Core Height (ft) = (Node - 1) * 0.2

COLR for CPSES Unit 1 Cycle 12

FIGURE 4

W(Z) AS A FUNCTION OF CORE HEIGHT
(MAXIMUM)

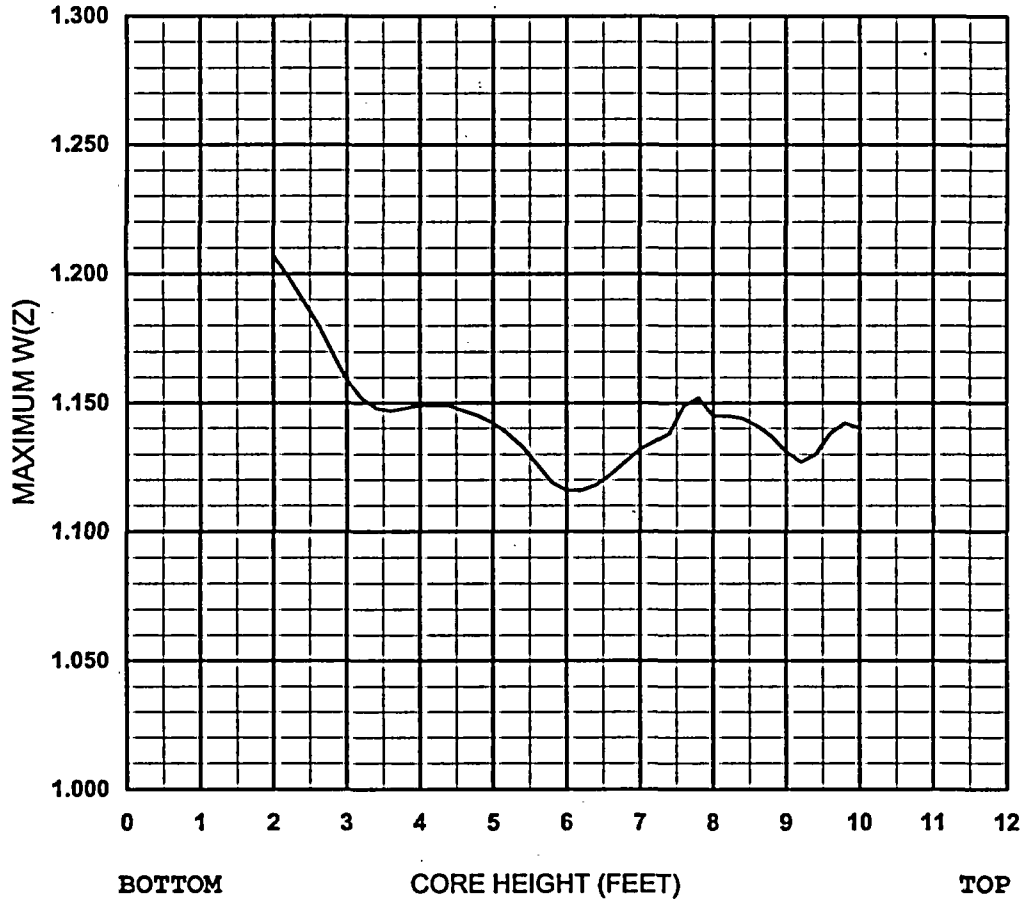


Axial Node	W(Z)	Axial Node	W(Z)	Axial Node	W(Z)	Axial Node	W(Z)
52 - 61	---	41	1.145	30	1.119	19	1.147
51	1.140	40	1.152	29	1.126	18	1.148
50	1.142	39	1.149	28	1.133	17	1.152
49	1.138	38	1.138	27	1.138	16	1.159
48	1.130	37	1.135	26	1.142	15	1.170
47	1.127	36	1.132	25	1.145	14	1.181
46	1.131	35	1.127	24	1.147	13	1.190
45	1.137	34	1.122	23	1.149	12	1.199
44	1.141	33	1.118	22	1.149	11	1.207
43	1.144	32	1.116	21	1.149	1 - 10	---
42	1.145	31	1.116	20	1.148		

$$\text{Core Height (ft)} = (\text{Node} - 1) * 0.2$$

COLR for CPSES Unit 1 Cycle 12

FIGURE 5

W(Z) AS A FUNCTION OF CORE HEIGHT
(150 MWD/MTU)

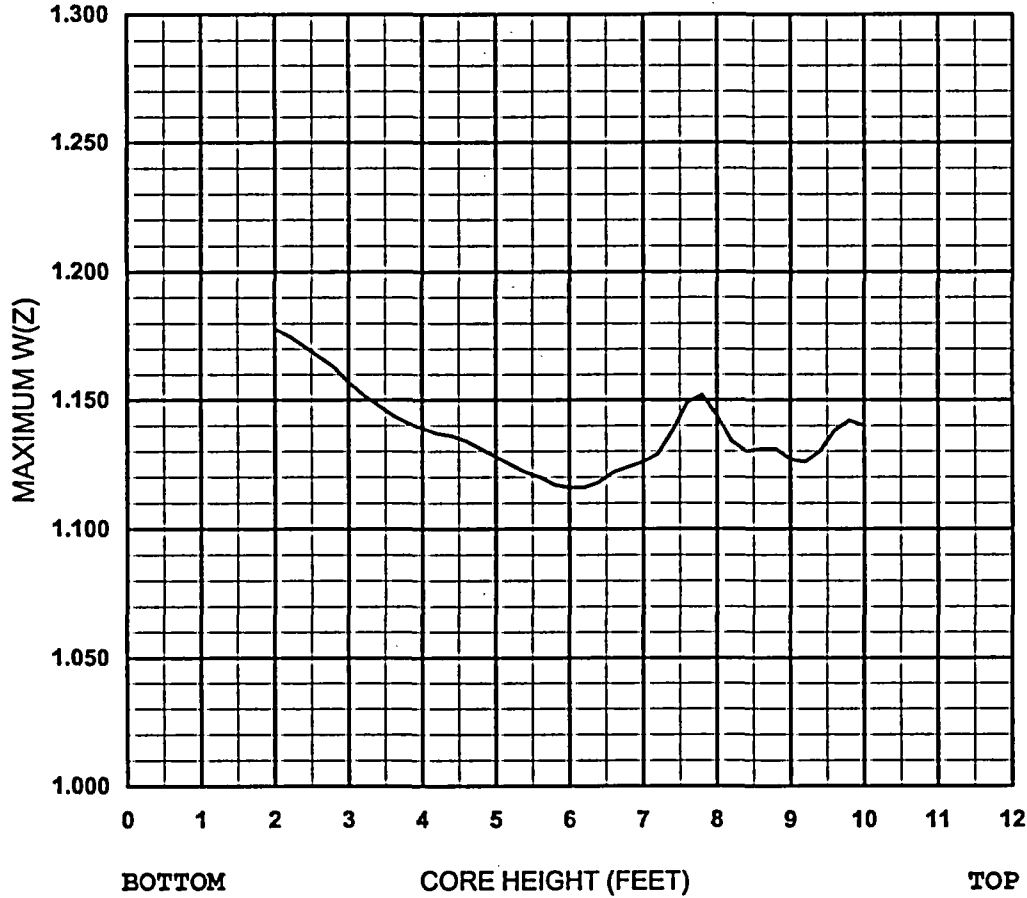


Axial Node	W(Z)	Axial Node	W(Z)	Axial Node	W(Z)	Axial Node	W(Z)
52 - 61	---	41	1.144	30	1.117	19	1.144
51	1.140	40	1.152	29	1.120	18	1.148
50	1.142	39	1.149	28	1.122	17	1.152
49	1.138	38	1.138	27	1.125	16	1.157
48	1.130	37	1.129	26	1.128	15	1.163
47	1.126	36	1.126	25	1.131	14	1.167
46	1.127	35	1.124	24	1.134	13	1.171
45	1.131	34	1.122	23	1.136	12	1.175
44	1.131	33	1.118	22	1.137	11	1.178
43	1.130	32	1.116	21	1.139	1 - 10	---
42	1.134	31	1.116	20	1.141		

Core Height (ft) = (Node - 1) * 0.2

COLR for CPSES Unit 1 Cycle 12

FIGURE 6

W(Z) AS A FUNCTION OF CORE HEIGHT
(10,000 MWD/MTU)

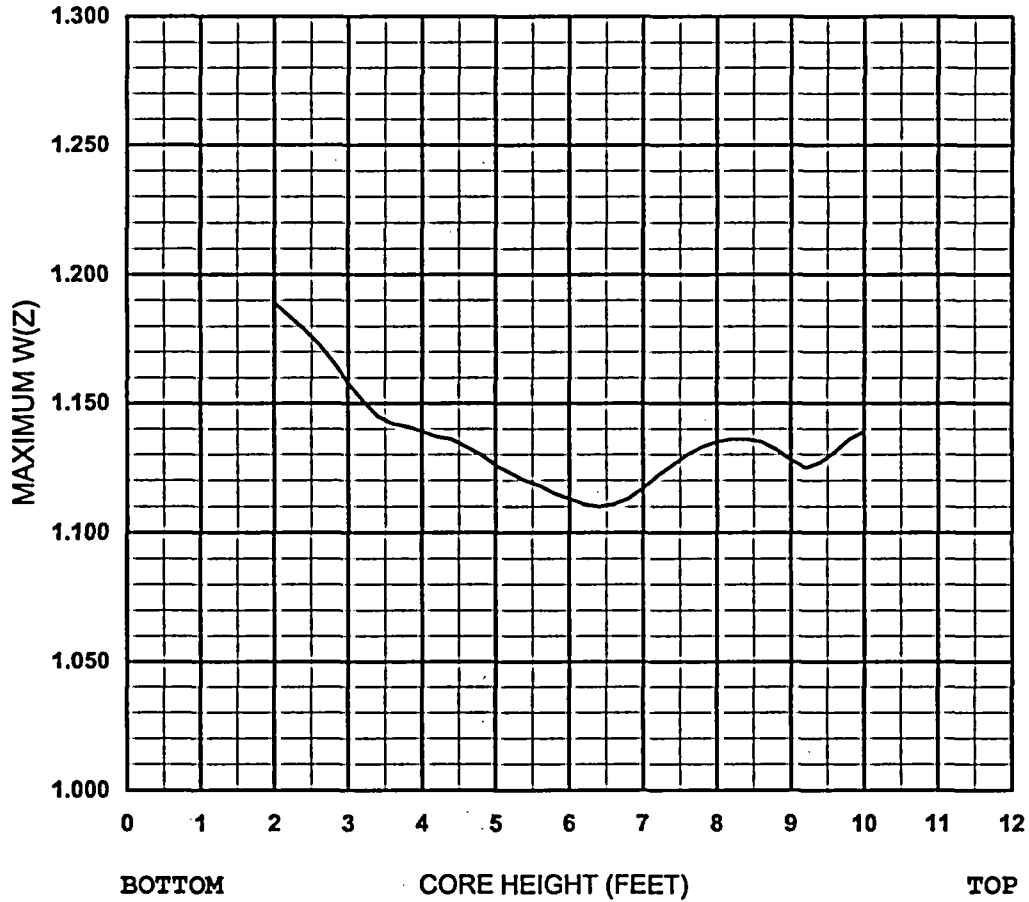


Axial Node	W(Z)	Axial Node	W(Z)	Axial Node	W(Z)	Axial Node	W(Z)
52 - 61	---	41	1.135	30	1.115	19	1.142
51	1.139	40	1.133	29	1.118	18	1.145
50	1.136	39	1.130	28	1.120	17	1.151
49	1.131	38	1.126	27	1.123	16	1.158
48	1.127	37	1.122	26	1.126	15	1.166
47	1.125	36	1.117	25	1.130	14	1.173
46	1.128	35	1.113	24	1.133	13	1.179
45	1.132	34	1.111	23	1.136	12	1.184
44	1.135	33	1.110	22	1.137	11	1.189
43	1.136	32	1.111	21	1.139	1 - 10	---
42	1.136	31	1.113	20	1.141		

Core Height (ft) = (Node - 1) * 0.2

COLR for CPSES Unit 1 Cycle 12

FIGURE 7

W(Z) AS A FUNCTION OF CORE HEIGHT
(19,000 MWD/MTU)

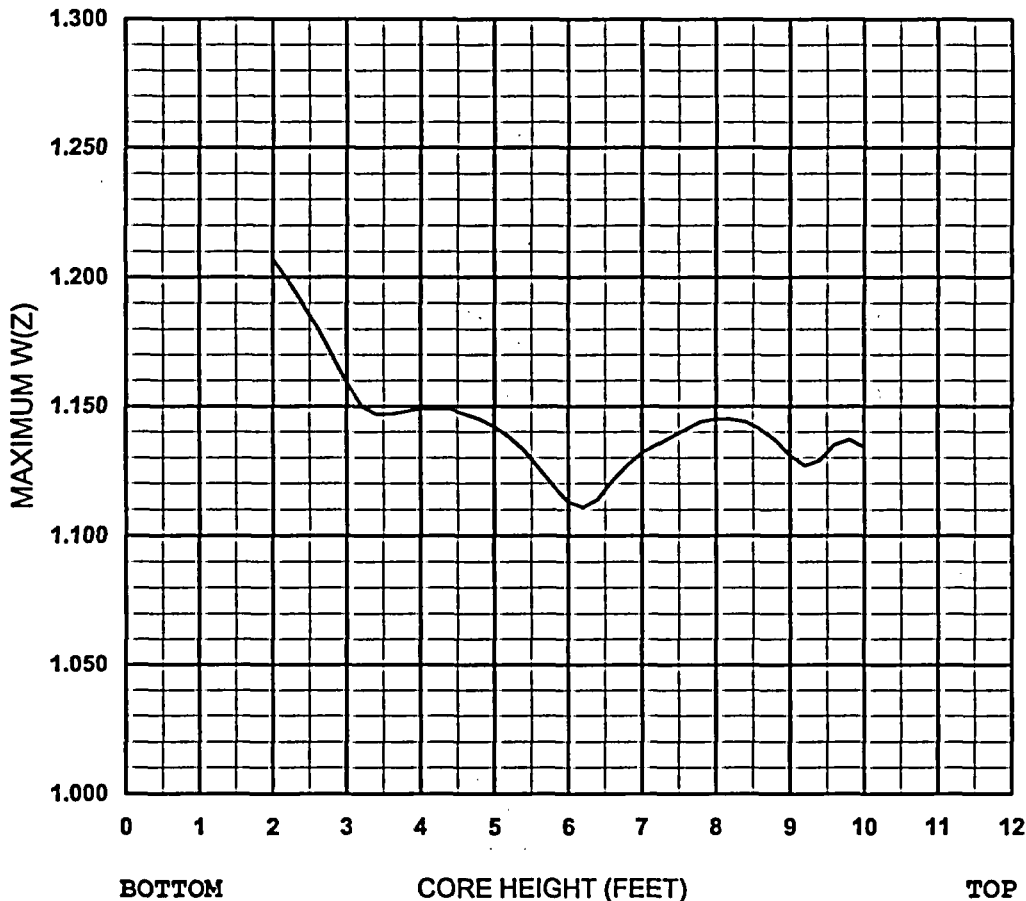

Axial Node	W(Z)	Axial Node	W(Z)	Axial Node	W(Z)	Axial Node	W(Z)
52 - 61	---	41	1.145	30	1.119	19	1.147
51	1.134	40	1.144	29	1.126	18	1.147
50	1.137	39	1.141	28	1.133	17	1.150
49	1.135	38	1.138	27	1.138	16	1.159
48	1.129	37	1.135	26	1.142	15	1.170
47	1.127	36	1.132	25	1.145	14	1.181
46	1.131	35	1.127	24	1.147	13	1.190
45	1.137	34	1.121	23	1.149	12	1.199
44	1.141	33	1.114	22	1.149	11	1.207
43	1.144	32	1.111	21	1.149	1 - 10	---
42	1.145	31	1.113	20	1.148		

Core Height (ft) = (Node - 1) * 0.2

FIGURE 8

AXIAL FLUX DIFFERENCE LIMITS AS A FUNCTION OF RATED THERMAL POWER

