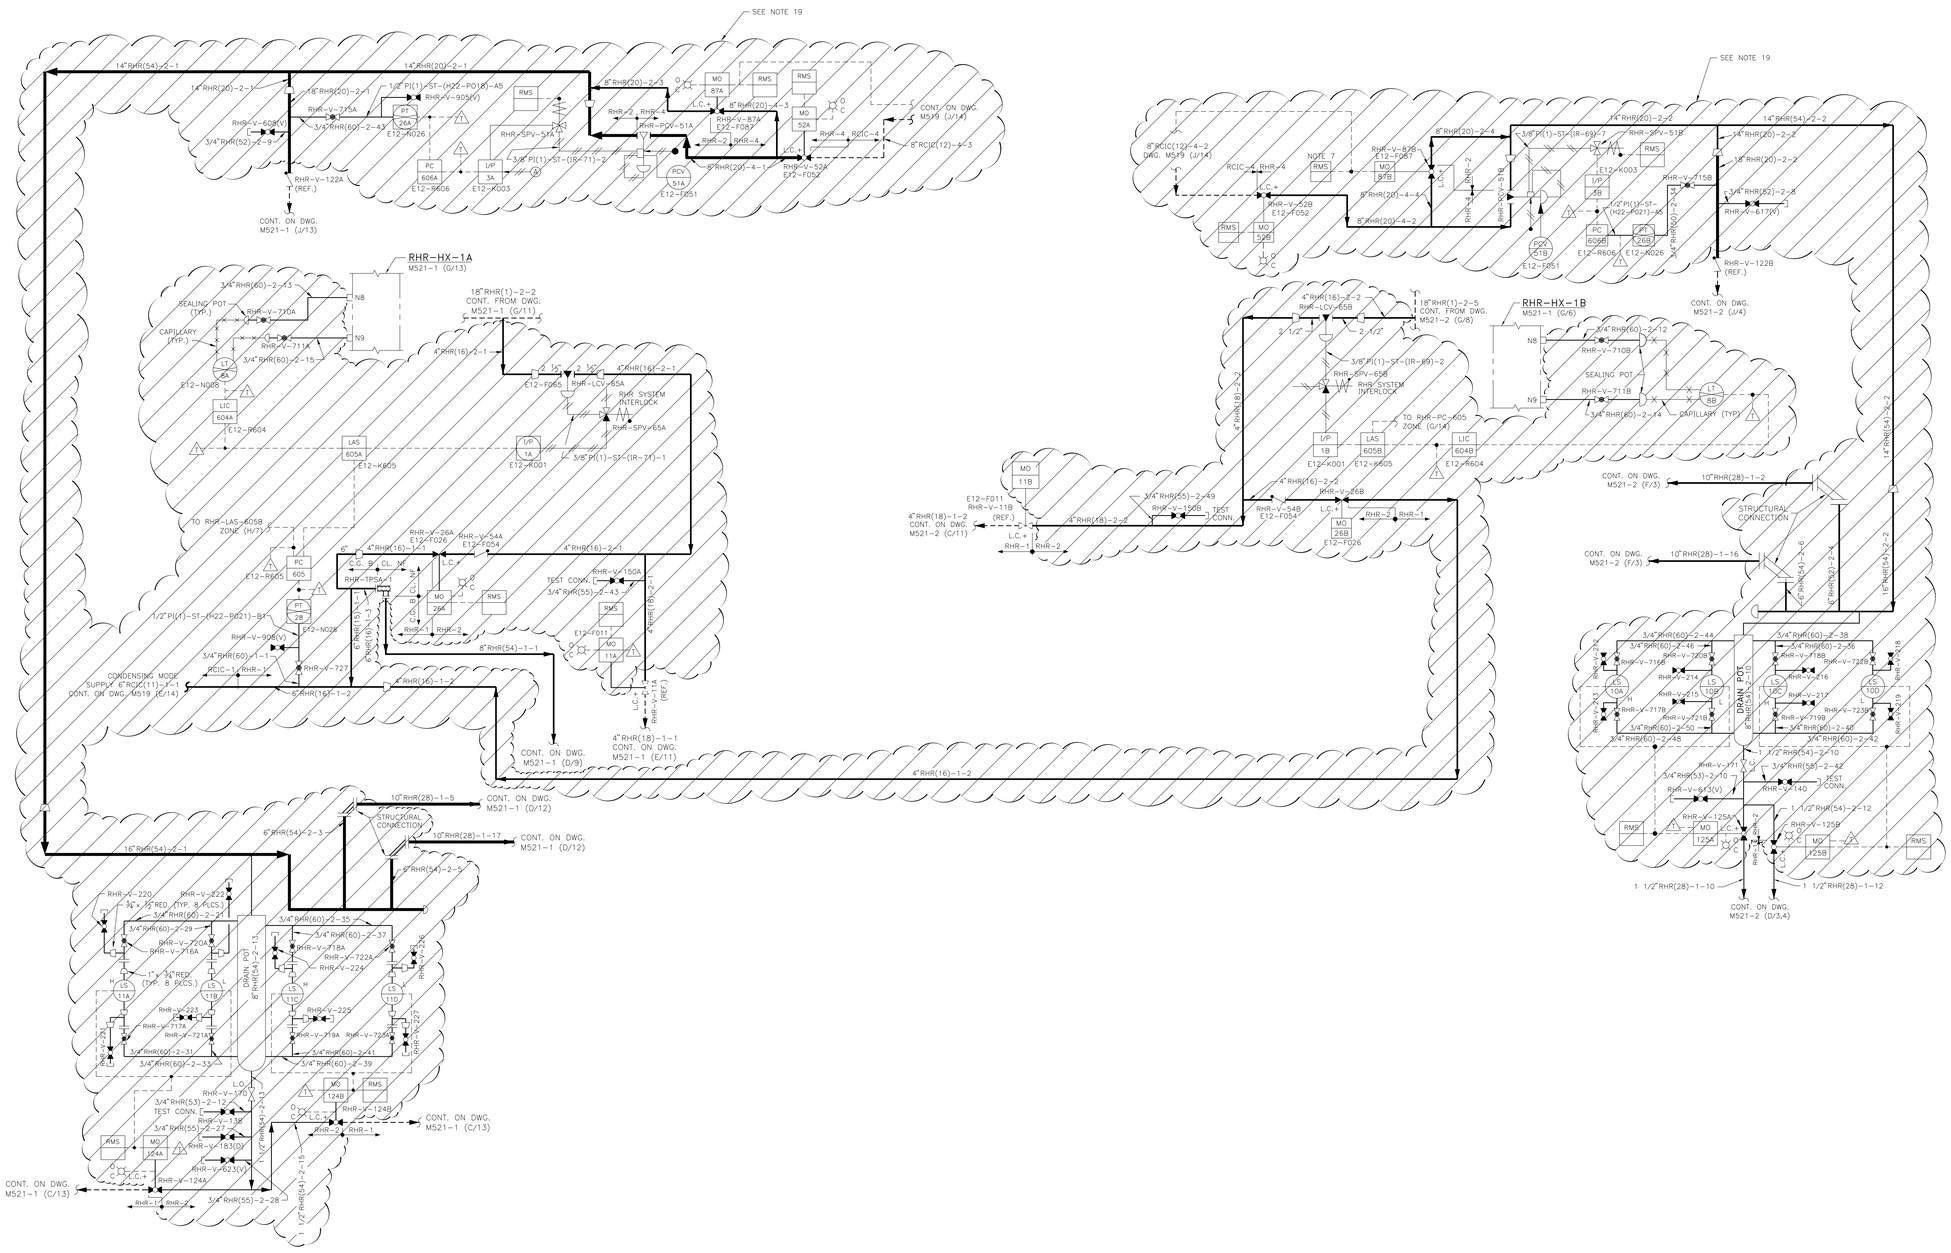

NOTES:

SEE M521-1 FOR NOTES

LEGEND:

1. ALL VALVES (EXCEPT THOSE ON INSTRUMENT LINES AND AS NOTED ON DIAGRAM) SUFFIXED WITH A (V) DENOTE A 3/4" VENT VALVE.
2. ALL VALVES (EXCEPT THOSE ON INSTRUMENT LINES) SUFFIXED WITH A (D) DENOTE A 3/4" DRAIN VALVE.
3. ALL VALVES SUFFIXED WITH A (TH) DENOTE A THROTTLED VALVE.

REFERENCES TO CONTRACT NUMBERS, SUCH AS 215, 206, 220, FOUND IN THE NOTES ON THIS DRAWING REFER TO ORIGINAL CONSTRUCTION DESIGN REQUIREMENTS.

CURRENT DESIGN REQUIREMENTS ARE DOCUMENTED IN THE STATION DESIGN SPECIFICATIONS AND ACTIVE CONTRACT SPECIFICATIONS WHICH STILL APPLY.

REV	DATE	DESCRIPTION	DWN	CHK	APVD
0	4-29-02	NEW DRAWING PER 01476-011.	BLS	HL	DRJ

ENERGY NORTHWEST — COLUMBIA GENERATING STATION

	SIGNATURE	DATE
APPROVED	D. R. JACOBSEN	4-29-02
CHECKED	H. LE	1-23-02
DRAWN	B. L. STAFFORD	10-9-01

TITLE: FLOW DIAGRAM RESIDUAL HEAT REMOVAL SYSTEM DEACTIVATED STEAM CONDENSING MODE

SCALE: NTS — DWG NO. M521-4 — REV. 0

SERVER04\MECH\DOC\M521-4.dwg

TOP TIER