

**Enclosure 1 of AET 06-0013**

**Report A1PH-9-K007-00001-1**

**Entitled *Final Report of Site-Specific Seismic Study - USEC American Centrifuge*  
Dated January 2006**

**FLUOR.**

**FINAL REPORT OF SITE-SPECIFIC SEISMIC STUDY**

**USEC AMERICAN CENTRIFUGE  
PIKETON, OHIO**

*Prepared For*

**FLUOR DANIEL**





ECS  
Geotechnical • Construction Materials • Environmental

January 31, 2006

Mr. Sayle Lewis, P.E.  
Flour Daniel  
100 Fluor Daniel Drive  
Greenville, SC 29607-2762

Reference: Final Report of Site-Specific Seismic Study  
USEC American Centrifuge  
Piketon, Ohio  
ECS Project No. 14-3046  
Fluor Document Number A1PH-9-K007-00001-1

Gentlemen:

As authorized, ECS performed a site-specific seismic study for the USEC American Centrifuge in Piketon, Ohio. The site specific seismic hazard (SSHA) was performed in general accordance with Specification No. 000210 02010 for the project dated August 23, 2005. The seismic design considerations for the project are attached to this letter. Subsurface soil and rock information used to perform the current study was contained in current borings and cone penetration tests (CPTs) performed by ECS. In addition, we reviewed the subsurface and laboratory information contained in a previous study for the site prepared by Law Engineering Testing Company entitled, "Final Report, Gas Centrifuge Enrichment Plant Geotechnical Investigation, Portsmouth, Ohio", dated April 28, 1978. This report shall supercede our previous report dated October 21, 2005.

### SEISMIC CONSIDERATIONS

The seismic evaluation consisted of:

1. Evaluation of the site response spectrum using the probabilistic methods described in the IBC 2003 using the 1996 and 2002 USGS attenuation relationships;
2. Performing a probabilistic seismic hazard analysis (PSHA);
3. The PSHA included return periods (Probability of Exceedance) of 475 years (10% in 50 years), 975 years (5% in 50 years), 2,475 years (2% in 50 years), 9,975 years (0.5 % in 50 years), and 99,750 years (0.05% in 50 years); and
4. Using the results of the PSHA and the subsurface soil and rock properties to develop site-specific response spectra.

The 475-, 975-, 2,475-, 9,975- and 99,750-year return periods are referred to as the 500-, 1,000-, 2,500-, 10,000- and 100,000-year return periods, respectively, for the purpose of this report.

The IBC 2003 allows the use of site-specific procedures to determine ground motion accelerations. When site specific procedures are used to determine ground motions, the results have to be 90 percent or greater than the ground motions determined by the general spectral response acceleration determined by using Code Section 1615.1.4. The results of the above analyses are presented in more detail below.

## **INTERNATIONAL BUILDING CODE 2003**

### General

The Site Classification for seismic design was determined using Section 1615.1.5 of the IBC 2003. The Code allows the use of Standard Penetration Tests (SPT), undrained shear strength ( $S_u$ ), and Shear Wave Velocity ( $V_s$ ), measurements to define the soil profile at the site. The purpose is to determine the short period acceleration values of the Site Coefficient ( $F_a$ ) and the mid-period velocity Site Coefficient ( $F_v$ ) presented in Tables 1615.1.2(1) and 1615.1.2(2), respectively.

The site coefficients were developed by a seismic group appointed by the Building Seismic Safety Council (BSSC) to more closely consider site soil effects that are known to have a large influence on seismic site response in recent Western U.S. earthquakes. The 1996 maps presented in the 2000 and 2003 editions of the IBC are based on attenuation relationships for a geologic site condition that corresponds to the National Earthquake Hazards Reduction Program (NEHRP) B-C boundary. The maps were based on data from earthquake ground motions recorded at typical rock sites in the Western U.S. and were developed for the Central and Eastern United States (CEUS). The earthquake input motion is for typical "soft" rock sites; hence care must be taken in evaluating the site class using a profile that has rock like materials (defined as shear wave velocities of 2,500 feet per second or greater) should this occur in the top 100 feet of the site profile. Such was the case at the project site where rock-like materials were encountered at depths ranging from about 20 to 35 feet.

For the USEC American Centrifuge site, shear wave velocity test results from the current ECS study and the previous from the Law Engineering Testing Company report were used to evaluate the seismic Site Class. Based on these test results, a seismic Site Class "C" was determined for the site.

The USGS and several working committees have assembled new paleoseismological data that indicates different return periods and maximum magnitudes for the CEUS seismic region. As a result of these studies, the 1996 maps were updated in the 2002 National Hazard Seismic Maps prepared by the USGS. The 2002 maps included changes in mean recurrence time, characteristic magnitude and sources for the New Madrid Seismic Zone (NMSZ) and Charleston source zones, and incorporated additional attenuation relationships. The 1996 USGS maps and the 2002 USGS maps were used in this study.

Figure 1 shows a map with the site location and the locations of the primary source zones affecting the site seismicity. The primary source zones are the New Madrid Source Zone (NMSZ) to the west and to a lesser extent the Charleston Fault Zone, the Anna Ohio area source and area sources to the north in Canada.

A seismic hazard deaggregation of the site is shown on Figure 2. Based on this figure, the primary contributions to the seismic hazard at the site are from a far-field high magnitude event along the NMSZ in combination with the smaller source events primarily located within 250 kilometers of the site. The Anna Ohio earthquakes are modeled in the PSHA and an overview of the seismicity of the state of Ohio as described by the USGS website abridged from *Earthquake Information Bulletin, Volume 8, Number 1, January - February 1976*, by Carl A. von Hakeis presented below:

An earthquake on June 18, 1875, caused damage in western Ohio, and affected a total area estimated at 104,000 square kilometers. Walls were cracked and chimneys thrown down (intensity VII) at Sidney and Urbana. The shock was felt sharply at Jeffersonville, Indiana; the affected area included parts of Illinois, Indiana, Kentucky, and Missouri.

Slight damage (intensity VI) was reported at Lima from a September 19, 1884, earthquake. At Columbus, chandeliers kept swinging for several minutes after the tremor. The shock was felt in Washington, D.C., by workmen on top of the then unfinished Washington Monument, about 500 feet above the ground. This earthquake was felt throughout a broad area, from Pennsylvania to Kentucky and West Virginia to Michigan (about 324,000 square kilometers).

Several towns in southeastern Ohio experienced moderate damage on November 5, 1926. Chimneys toppled at Keno and Pomeroy (intensity VI to VII); in addition, a stove was overturned at Pomeroy. The earthquake was also felt at Letart, West Virginia.

A brief but strong shock was felt over a wide area in western Ohio on September 30, 1930. The strongest intensity at Anna knocked down a chimney on the school and caused plaster to crack and fall (intensity VII). The tremor was accompanied by a rumbling noise. Less than one year later (September 20, 1931), another damaging earthquake occurred in the same area. At Anna, Houston, and Sidney cornices were thrown down from church buildings, several chimneys were toppled, and plaster fell from some walls (intensity VII). Intensity V to VI was experienced over an area of approximately 100,000 square kilometers, including most of western Ohio and parts of Indiana and Kentucky.

On March 2, 1937, much additional damage occurred at Anna. Plaster fell and walls cracked in a school house (intensity VII), which was later declared unsafe. Many chimneys were thrown down and other minor damage was inflicted at Anna, Sidney, and Wapokoneta; in Bellefontaine and Lima, alarm was general but damage was minor. Two to five shocks were felt in many places. The total felt area included approximately 181,000 square kilometers in Ohio, Indiana, and Michigan;

felt reports were also received from a few places in Illinois, Kentucky, West Virginia, and Wisconsin, and one place in Canada.

The next day, March 3, at 3:50 a.m., a moderate earthquake (intensity V) shook the same area. It awakened many persons, rattled windows, and shook some bricks from chimneys.

The strongest tremor of this series occurred at 11:45 p.m., March 8, 1937. At Anna, chimneys repaired after the March 2, 1937 earthquake were again thrown down, with scarcely a chimney undamaged (intensity VII to VIII). Organ pipes were twisted in one church and other church and school buildings were badly cracked. A few chimneys also fell at Sidney and there was damage to plaster. The affected area was much larger than that of the previous earthquake. The 388,000 square kilometer area covered all of Ohio and Indiana, parts of Illinois, Kentucky, Michigan, and a few places in Missouri, Pennsylvania, West Virginia, Wisconsin, and Ontario, Canada.

Outstanding phenomena common to both the March 2 and 8, 1937 earthquakes were the rotation of tombstones and subsurface changes revealed by the activities of wells. Marked changes in the behavior of wells were reported from Botkins, Huntsville, and New Knoxville.

On March 9, 1943, an earthquake centered east of Cleveland, was felt over a 100,000 square kilometer area, but only caused minor damage at points nearest the epicenter. Reports of cracked plaster and broken windows and dishes (intensity V) were received after the shock. It was noted over a large part of Ohio and in parts of Michigan, New York, and Pennsylvania, and Ontario, Canada.

On June 20, 1952, an early morning (3:38 a.m.) tremor awoke most of the people in the Zanesville area. An old chimney was toppled (intensity VI), doors were thrown open, pictures shook, and dishes rattled. The earthquake was felt over about 26,000 square kilometers in southeastern Ohio.

#### Site Specific Evaluation

ECS used the computer program EZ-FRISK Version 7.14 written by Risk Engineering to evaluate the earthquake hazard at the site. The predominant earthquake sources that would affect the site were modeled, the characteristics of the earthquakes were inputted, and the ground motions that the earthquakes would generate were calculated. The site is located at 39.02 degrees north latitude and 83.00 degrees west longitude. A PSHA was performed using various ground motion attenuation relationships. Several attenuation relationships were chosen including Toro (1997), Mid-Continent USGS 2002, Somerville (2001) USGS 2002, Campbell (2003), USGS 2002, Frankel (1996) and Atkinson and Boore (1995) USGS. The analysis included the Charleston and New Madrid source zones and nearby Background Zones. The results of the EZ-FRISK Total Hazard Analysis (Figure 3) show the mean peak bedrock accelerations versus the annual frequency of exceedence.

The EZ-FRISK probabilistic analysis results are presented on the Total Hazard plot shown on Figure 3. The earthquake Hazard by Seismic Source is shown on Figure 4.

Of the sources listed in Figure 4, the CEUS gridded is the most significant, along with the Anna Ohio. This is consistent with the deaggregation figure in that the hazard is being controlled mainly by local seismicity as opposed to a larger magnitude event in the far field such as the New Madrid. In order of significant contribution the list would be:

1. CEUS Gridded Background Zone
2. Anna Ohio Area Source
3. Central New Madrid
4. Southeast New Madrid
5. Northwest New Madrid
6. Charleston Broad Zone
7. Charleston Narrow Zone

The USGS, CEUS 1996 and CEUS 2002 documentation was used as a basis for development of the tectonic environment. The USGS has a gridded seismicity hazard calculation for both high and low magnitude earthquakes on a 0.1 degree by 0.1 degree grid which is normalized by the counting window duration to get a seismicity rate in each grid cell in the CEUS. The radius of this background source was 1,000 kilometers. At the project site, the USGS counts all earthquakes with magnitudes greater than 3 since 1924, > 4 magnitudes since 1860 and >5 magnitudes since 1700. For magnitudes over 6, they used finite faults centered on each grid cell. The Central, NW and Southeast New Madrid fault zones were modeled with an upper bound magnitude of 7.297. The Anna Ohio was given a minimum magnitude of 5 and a maximum magnitude of 7. The Charleston Broad and Narrow zones are assigned an upper bound magnitude of 7.035.

The sources and the characteristics of the sources are consistent with the guidelines presented in DOE standard 1023-95 and with the results generally consistent with results obtained by previous studies at the site. For the analysis associated with the site-specific study the mean was used. Given the relative risk level associated with the various facilities that comprise the American Centrifuge Plant, use of a weighted mean or the 84<sup>th</sup> percentile estimate of ground motion for the seismic analysis is considered unnecessary. A weighted mean or 84<sup>th</sup> percentile estimate of ground motion is typically used for high risk facilities such as nuclear power reactors. It is our understanding that none of the American Centrifuge Plant facilities present that level of risk.

The EZ-FRISK Uniform Hazard Spectra shown on Figure 5 for the above specified 5 return periods show the spectral acceleration vs. period generated by EZ-FRISK. The frequency of exceedance vs. peak bedrock acceleration and the  $S_s$  and  $S_1$  values are shown in Table 1.

**TABLE 1**  
**Annual Frequency of Exceedence vs. Peak Bedrock Acceleration (g) and  $S_s$  and  $S_1$  Values**

Return Period (Years)	Peak Bedrock Acceleration (g)	$S_s$ (g)	$S_1$ (g)
500	0.05	0.09	0.03
1,000	0.07	0.13	0.04
2,500	0.09	0.20	0.07
10,000	0.20	0.37	0.12
100,000	0.70	1.00	0.26

The IBC response spectra were prepared for the 5 specified return periods using the general procedure presented in Section 1615.1.4. All of the results for this study are at 5% damping. The 1996 and the 2002 USGS map code spectra for Site Class C are shown on Figures 6 and 7, respectively. It is important to note that the Code has a 2/3 decrease for the 2,500 year return period. This factor was used on all of the Code spectra although this factor is not explicitly applied to other return periods in the code.

A SHAKE analysis was performed using Shake 91+. Several earthquakes were scaled to the target PSHA spectra. The earthquakes were then used as input motions in the Shake program at the base of the soil column. The soil profiles used in the Shake analysis are shown on Figure 8 (Profile 1) and Figure 9 (Profile 2). The soil test borings, cone penetration test soundings and laboratory test data are attached as Supplemental Data. It should be noted that the two profiles consider variability in the shear wave velocity of Soil Layer 4 ranging from 500 to 1,000 ft. per second which accounts for the variations in the consistency of the soil profile.

The results of the Shake analysis for the 2,500-year return period earthquake event is plotted on Figure 10. The 2,500 year return period plot is presented with the Code spectra. It should be noted that the Shake analysis appears to indicate a higher amplitude response in the high frequency range (>3Hz) than the code spectra. It should also be noted that the Shake analysis did include a 2/3 reduction smoothing between about 3½ and 6½ Hz for the 2,500 year return period. Section 1615.1.3 of the IBC 2003 (Equations 16-40 and 16-41) allows for a 2/3 reduction in the maximum considered earthquake spectral response for the short (0.2 second) and long (1.0 second) periods.

The 10,000 year return period broad-band response spectrum is shown on Figure 11. The curves for the softer soil Profile 1, and the stiffer Profile 2, are shown. As expected, the stiffer profile created a higher amplitude response in the short period range. Using Section 1615.1.3 of the IBC 2003 as a basis, a 2/3 reduction is typically used to smooth the high amplitude peaks that occur over very small frequency ranges in the spectrum. For this study, 80 percent of the Shake values between 2.5 to 3.3 Hz was used which did not have an affect on the structures for this study.

This resulted in the top of the curve being truncated at 0.85g. The broad-band response is shown on Figure 11. Based on the variation in the soil profile and the results of the Shake analysis, it is concluded that the broad-band response envelopes the potential earthquake ground motion for the 10,000 year return period event.

The input motions used to run the Shake analyses are scaled from actual earthquake records having a similar magnitude, distance and duration. The earthquakes chosen are those that reasonably match the probability densities shown in the deaggregation shown in Figure 2. In order to scale the actual earthquake records to match the target spectrum, a spectral matching program written by Abrahamson was used. The program code is embedded in the EZ-FRISK software. The results of the spectral matches for the earthquakes used in the 2,500 year return period analyses are shown on Figures 12, 13 and 14. The corresponding acceleration velocity and displacement time histories associated with those input motions are shown on Figures 15, 16 and 17. The results of the spectral matches for the earthquakes used in the 10,000 year return period analyses are shown on Figures 18, 19 and 20. The corresponding acceleration velocity and displacement time histories associated with those input motions are shown on Figures 21, 22 and 23. The amplification ratios for the 10,000 year return period are presented on Figures 24, 25 and 26 for the Shake Profile 1 and Figures 27, 28, and 29 for the Shake Profile 2. The amplification of the soil profile ranges from 1 to about 2.4. Using the highest amplification ratio, the response at the zero period was anchored at 0.48g as reflected in Figure 11.

A summary of the Shake and the Code  $S_{DS}$  and  $S_{D1}$  values are for the 2,500 year and the 10,000 year return period events are presented in Table 2.

**TABLE 2**  
 **$S_{DS}$  and  $S_{D1}$  Values**

Return Period (years)	Parameter	PSHA Analysis (g)	1996 USGS IBC 2003 (g)	2002 USGS (g)
2,500	$S_{DS}$	0.30	0.16	0.14
2,500	$S_{D1}$	0.07	0.09	0.07
10,000	$S_{DS}$	0.43	0.32	0.29
10,000	$S_{D1}$	0.15	0.15	0.13

PSHA = Probabilistic Seismic Hazard Analysis.

The shear strain versus damping curves used in the Shake analysis is shown on Figure 30. The modulus reduction curves are shown on Figure 31.

### Comparison of Results to License Application

The USEC license application utilized the Beavers (1995) report and extrapolated that data to the 10,000 year return period. In order to compare the results obtained for this analysis with the previous analysis prepared for the site by Beavers (1995), we ran an analysis for the 1,000 year return period event using the above described methodology. The result of our analysis was plotted with the Beavers result. The plots are shown on Figure 32. The results indicate that the current analysis closely matches the previous analysis for this return period event.

For the 1,000 year return period event, this site-specific study indicated a peak bedrock acceleration of 0.07g (Table 1) with a site amplification factor of approximately 2.0. Multiplying the peak bedrock acceleration by the site amplification factor yields a peak ground acceleration of 0.14g, which is slightly lower, but very close to the Beavers result of 0.15g.

Similarly for the 10,000-year return period event, the site-specific study indicated a peak bedrock acceleration of 0.20g (Table 1). The amplification factors observed for this return period typically ranged from 1.7 to 2.4, which would yield a peak ground acceleration ranging from 0.34g to 0.48g. The amplification factors are approximated from Figures 24 through 29. Using the highest amplification factor (2.4), the peak ground acceleration would be 0.48g, which exceeds the 0.32g peak ground acceleration identified in the USEC license application.

The 100,000 year return period spectral acceleration is shown on Figure 33. This spectrum was derived from using the 100,000 year return period Uniform Hazard and scaling using the  $F_a$  and  $F_v$  values presented in the IBC 2003.

### **CLOSURE**

This report was prepared in accordance with generally accepted geotechnical engineering practice. No other warranty is expressed or implied. The analyses and recommendations presented in this report are based on the available project information, as well as on the results of limited field exploration. The results of this report should not be used for facilities outside the American Centrifuge Plant without the review and approval of ECS.

Thank you for the opportunity to provide geotechnical engineering services on this project and we look forward to our continued involvement during the construction phase. Should you have questions regarding our findings or need additional consultations, please do not hesitate to contact our office.

Respectfully,

ECS represented by;

  
Donald L. Anderson, P.E.  
Senior Engineer

  
Lawrence P. Goldfarb, P.E.  
Principal Engineer

  
Stephen J. Geiger, P.E.  
Principal Engineer  
OH Registration/No. E-64822



## **ATTACHMENTS**

1. References
2. Figure 1: Source Map Legend
3. Figure 2: Seismic Hazard Deaggregation
4. Figure 3: Total Hazard - Probabilistic Analysis
5. Figure 4: Hazard By Seismic Source
6. Figure 5: Uniform Hazard Spectra
7. Figure 6: 1996 USGS Code Response Spectra
8. Figure 7: 2002 USGS Code Response Spectra
9. Figure 8: Soil Profile For Shake Analysis –Profile 1
10. Figure 9: Soil Profile For Shake Analysis – Profile 2
11. Figure 10: 2,500 Yr Return Period Shake Analysis
12. Figure 11: 10,000 Yr Return Period Shake Analysis
13. Figure 12: 2,500 Yr TAP060 Spectral Match
14. Figure 13: 2,500 Yr Landers SIL Spectral Match
15. Figure 14: 2,500 Yr Taiwan Chi Chi KAU-078N Spectral Match
16. Figure 15: 2,500 Yr TAP 060V Time History
17. Figure 16: 2,500 Landers SIL Time History
18. Figure 17: 2,500 Taiwan Chi Chi KAU-078N Time History
19. Figure 18: 10,000 Yr Taiwan Chi Chi ILA002-V Spectral Match
20. Figure 19: 10,000 Yr Taiwan Chi Chi 046-W Spectral Match
21. Figure 20: 10,000 Yr Tabas Bajestan V-1 Spectral Match
22. Figure 21: 10,000 Yr Taiwan Chi Chi ILA002-V Time History
23. Figure 22: 10,000 Yr Taiwan Chi Chi 046-W Time History
24. Figure 23: 10,000 Yr Tabas Bajestan V-1 Time History
25. Figure 24: 10,000 Yr Taiwan Chi Chi ILA002-V Amplification Ratio – Profile 1
26. Figure 25: 10,000 Yr Taiwan Chi Chi 046-W Amplification Ratio – Profile 1
27. Figure 26: 10,000 Yr Tabas Bajestan V1 Amplification Ratio- Profile 1
28. Figure 27: 10,000 Yr Taiwan Chi Chi ILA002-V Amplification Ratio – Profile 2
29. Figure 28: 10,000 Yr Taiwan Chi Chi 046-W Amplification Ratio –Profile 2
30. Figure 29: 10,000 Yr Tabas Bajestan V1 Amplification Ratio –Profile 2
31. Figure 30: Shake Analysis Shear Strain Versus Damping
32. Figure 31: Shake Analysis Modulus Reduction Curves
33. Figure 32: 1,000 Yr Return Period Spectra Comparison
34. Figure 33: 100,000 Yr Return Period Spectrum
35. Supplemental Data: Subsurface and Laboratory Testing Data

## REFERENCES

- Atkinson, G. M., and D.M. Boore (1995) Ground Motion Relations for eastern North America, Bull. Seism. Soc. Am., Volume, 85, pp17-30.
- Bakun, W.H. and M.G. Hopper, (2004), "Magnitudes and Locations of the 1811-1812 New Madrid, Missouri and the 1886 Charleston, South Carolina, Earthquakes, Bull. Seis. Soc. Am., Vol. 94, No. 1, Feb, 2004, pp. 64-75.
- Beavers, James E., (1995), "Seismic Hazard Criteria For The Oak Ridge Tennessee; Paducah, Kentucky; And Portsmouth, Ohio U.S. Department Of Energy Reservations"., MS Technology, Inc., December, 1995.
- Boore, D.M. ,W.B. Joyner and T.E. Fumal (1993), Estimation of Response and Peak Acceleration from Western North American Earthquakes, Interim Report, USGS File Report 93-509.
- Building Seismic Safety Council (1997 Edition), NEHRP Recommended Provisions For Seismic Regulations For New Buildings and Other Structures, Part 1, (FEMA 302)
- Campbell, K.W., (2002) Prediction of strong ground motion using the hybrid empirical method: example application to eastern North America, submitted to Bull. Seism. Soc. Am.
- Campbell, K.W. (2003). "Prediction of Strong Ground Motion Using the Hybrid Empirical Method and Its Use in the Development of Ground-Motion (Attenuation) Relations in Eastern North America." Bulletin Seismological Society of America, Vol. 93, No. 3, pp. 1012-1033, June.
- Frankel, A., S. Harmsen, C. Mueller, T. Barnhard, E.V. Lyendecker, D. Perkins, S. Hanson, N. Dickman, M. Hopper, USGS National Seismic Hazard Maps: Uniform Hazard Spectra, De-Aggregation, and Uncertainty, Published in the "Proceedings of the FHWA/NCEER Workshop on the Nationals Representation of Seismic Ground Motion for New and Existing Highway Facilities," NCEER Technical Report 97-00010 , pp. 39-73, 1997.
- Frankel, A.D., M.D. Peterson, C.S. Mueller, K.M. Haller, R.L. Wheeler, E.V. Lyendecker, R.L. Wesson, S.C. Harmsen, C.H. Cramer, D.M. Perkins, and K.S. Rukstales, Documentaion for the 2002 Update of the National Seismic Hazard Maps, USGS Open File Report 02-420, 2002.
- International Code Council, International Building Code (2003)
- Kramer, S.L., (1996), Geotechnical Earthquake Engineering, Prentice Hall, Upper Saddle River, NJ, 653 pp.
- Mueller, C. M. Hopper, and A. Frankel, Department of the Interior, U.S. Geological Survey, Preparation of Earthquake Catalogs for the National Seismic-Hazard Maps: Contiguous 48 States, Open File Report 97-464.

Obermeier, S.F., Jacobson, R.B., Smoot, J.P., Weems, R.E., Gohn, G.S., Monroe, J.E. and D.S. Powars, (1990), "Earthquake Induced Liquefaction Features in the Coastal Setting of South Carolina and in the Fluvial Setting of the New Madrid Seismic Zone, U.S.G.S. Professional Paper 1504, 44p.

Risk Engineering Inc. (1996) EZ-Frisk, Users Manual.

Schnabel, P.B., Lysmer, J., and Seed, H.B., (1972), "SHAKE, A computer program for earthquake response analysis of horizontally layered sites", Report No. EERC 72-12, EERC, UC Berkeley, Berkeley, CA.

Seed, H.B., and I.M. Idriss, (1970), "Soil moduli and damping factors for dynamic response analyses," EERC, U.C. Berkeley, Report No. UCB/EERC-70-10.

Seed, H.B., Wong, R.T., Idriss, I.M., and K. Tokimatsu, (1986) "Moduli and damping factors for analysis of cohesionless soils, " Journal of Geotechnical Engineering, ASCE Volume 112, No. 11, pp. 1016-1032.

Somerville, P. et al (2001), "Ground Motion Attenuation Relations for the Central and Eastern United States," USGS Reports under award number 99HQGR0098, June 30, 2001, [http://erp-web.er.usgs.gov/reports/abstract/1999/cu/cu\\_abstr.htm](http://erp-web.er.usgs.gov/reports/abstract/1999/cu/cu_abstr.htm).


Talwani, P. and W.T. Schaeffer (2001), "Recurrence Rates of Large Earthquakes in the South Carolina Coastal Plain Based on Paleoliquefaction Data, Jour. of Geophys. Res. , V. 106( B4), pp.6621-6642.

Toro, G.R. (1999) Modification of the Toro et Al. (1997) Attenuation Equations for Large Magnitudes and Short Distances," Risk Engineering, Inc., website [www.riskeng.com](http://www.riskeng.com), pp. 4-1 to 4

Toro, G., N. Abrahamson, and J. Schneider, (1997) Model of Strong Ground Motions from Earthquakes in Central and Eastern North America: Best Estimates and Uncertainties," Seism. Res. Letters, V.68 pp.41-57.

Toro, G.R., and W.J. Silva, (2001), Scenario Earthquakes For Saint Louis, MO, and Memphis, TN, and Seismic Hazard Maps For The Central United States Region Including The Effect of Site conditions, Final Technical Report, Risk Engineering, Jan. 2001.

Wheeler, R.L., and David M. Perkins, Research, methodology, and applications of probabilistic seismic hazard-mapping of the central and eastern United States – Minutes of a workshop on June 13-14, 2000, at Saint Louis University, Open-File Report 00-0390.

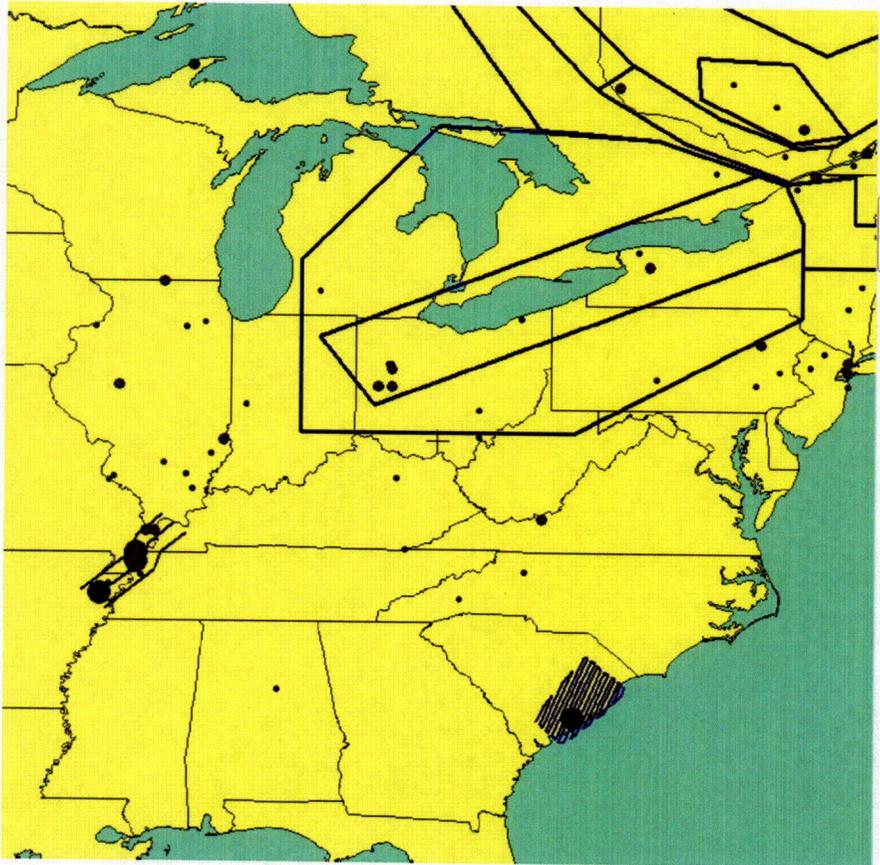

**MAP LEGEND**

- + Site
- \ State Boundaries
- \ Faults
- \ Area Sources

**SEISMICITY**

- 8.5 to 9.5
- 7.5 to 8.5
- 6.5 to 7.5
- 5.5 to 6.5
- Less than 5.5
- ▲ Unknown Magnitude



**NORTH**

**SOURCE MAP LEGEND**

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 1  
ECS Project No. 14-3046  
January 2006

CO1

**Prob. Seismic Hazard Deaggregation**

USEC\_Centrifuge 83.000° W, 39.020 N.

SA period 0.50 sec. Accel. $\geq$ 0.10609 g


Mean Return Time of GM 2475 yrs

Mean (R,M, $\epsilon_0$ ) =572.7 km, 6.75, 0.86

Modal (R,M, $\epsilon_0$ ) =572.6 km, 7.70, 1.45 (from peak R,M bin)

Modal (R,M, $\epsilon_0$ ) =572.7 km, 7.70, 1 to 2 sigma (from peak R,M, $\epsilon$  bin)

Binning: DeltaR=25. km, deltaM=0.2, Delta $\epsilon$ =1.0

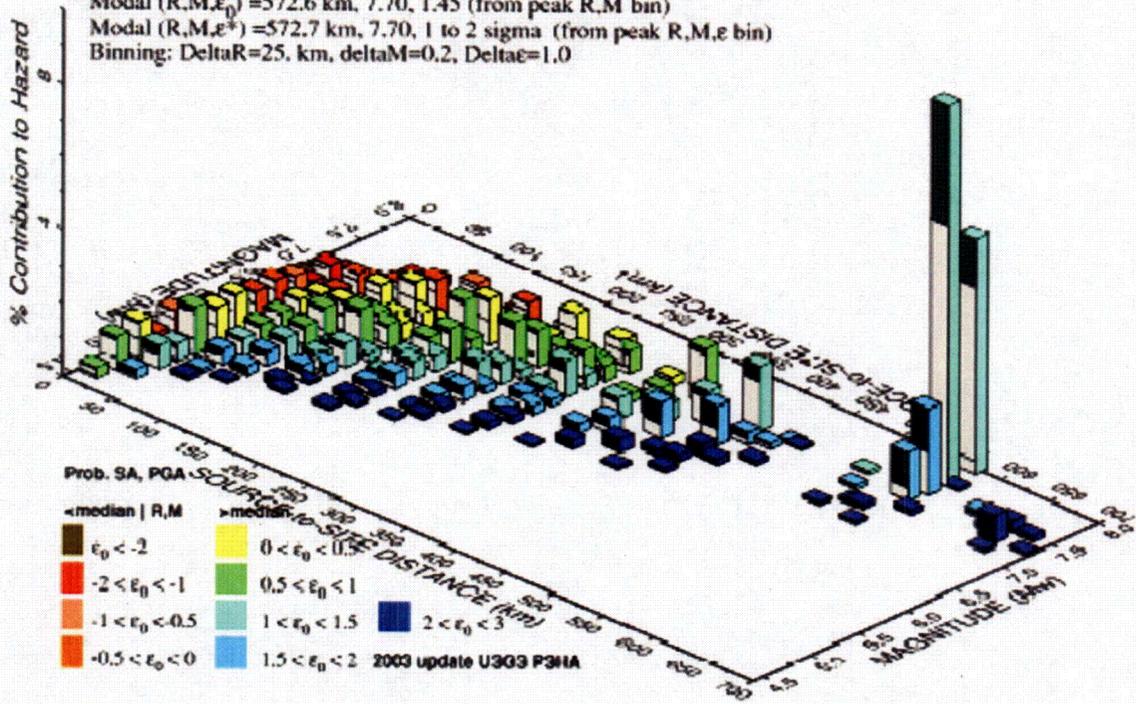

GMT Oct 21 09 22 Distance (R), magnitude (M), epsilon (EQE) deaggregation for a site on ROCK avg V=700 m/s top 30 m USGS CGMT PSHA2002V3 UPDATE. Site with 11 0.05% contour. created

**SEISMIC HAZARD DEAGGREGATION**


USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 2  
ECS Project No. 14-3046  
January 2006

COZ

### Total Hazard

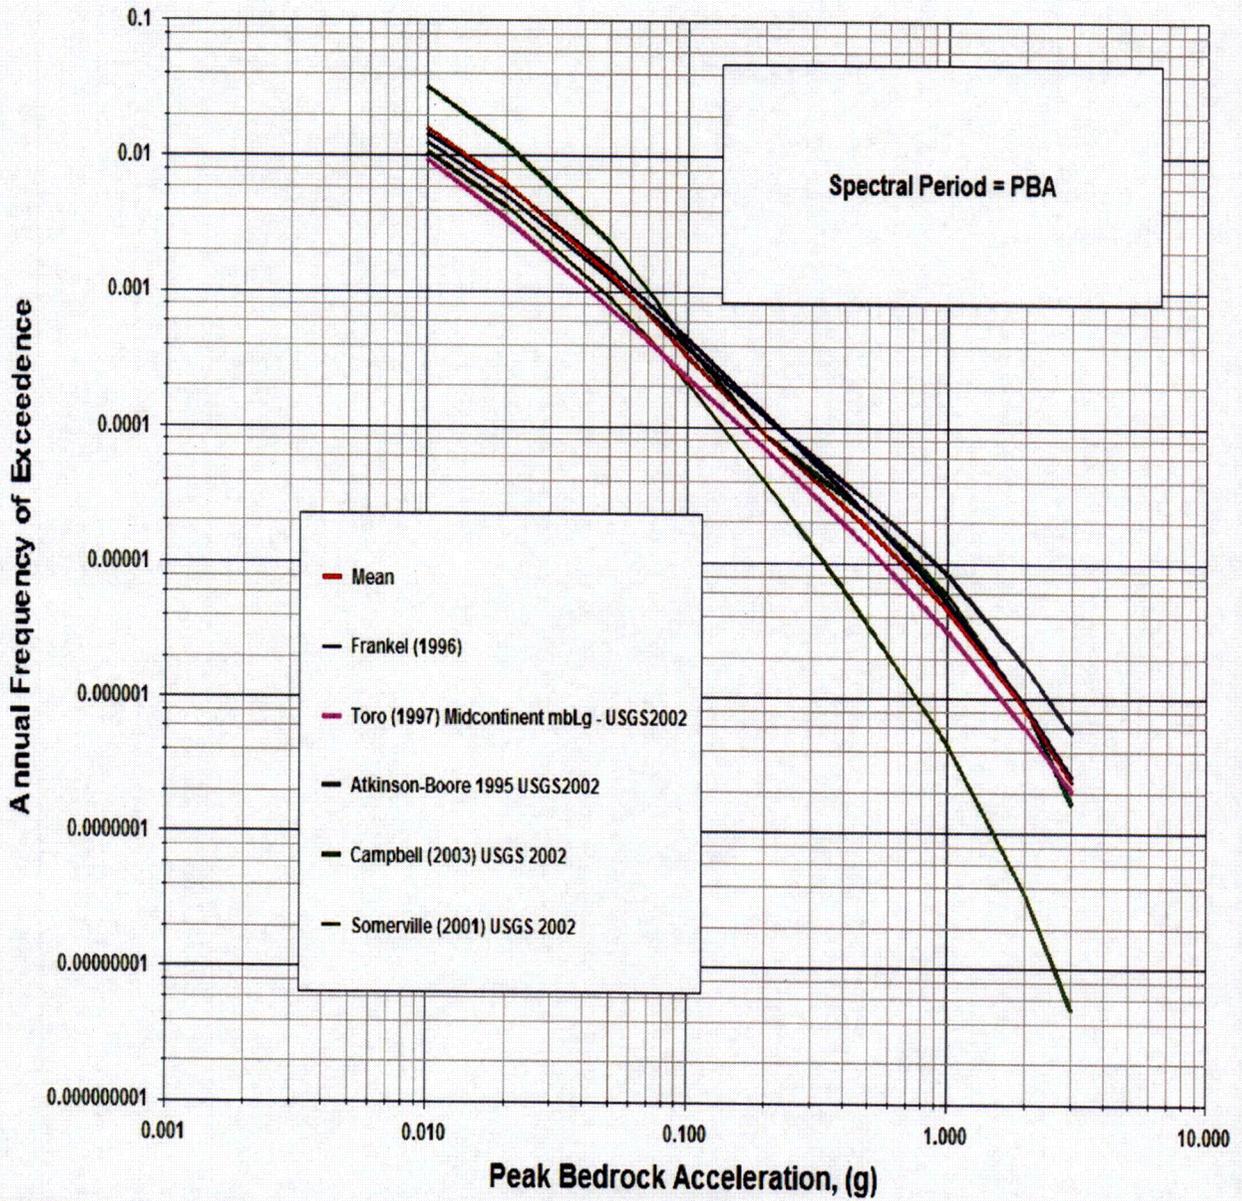


### TOTAL HAZARD – PROBABILISTIC ANALYSIS

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 3  
ECS Project No. 14-3046  
January 2006

### Hazard by Seismic Source

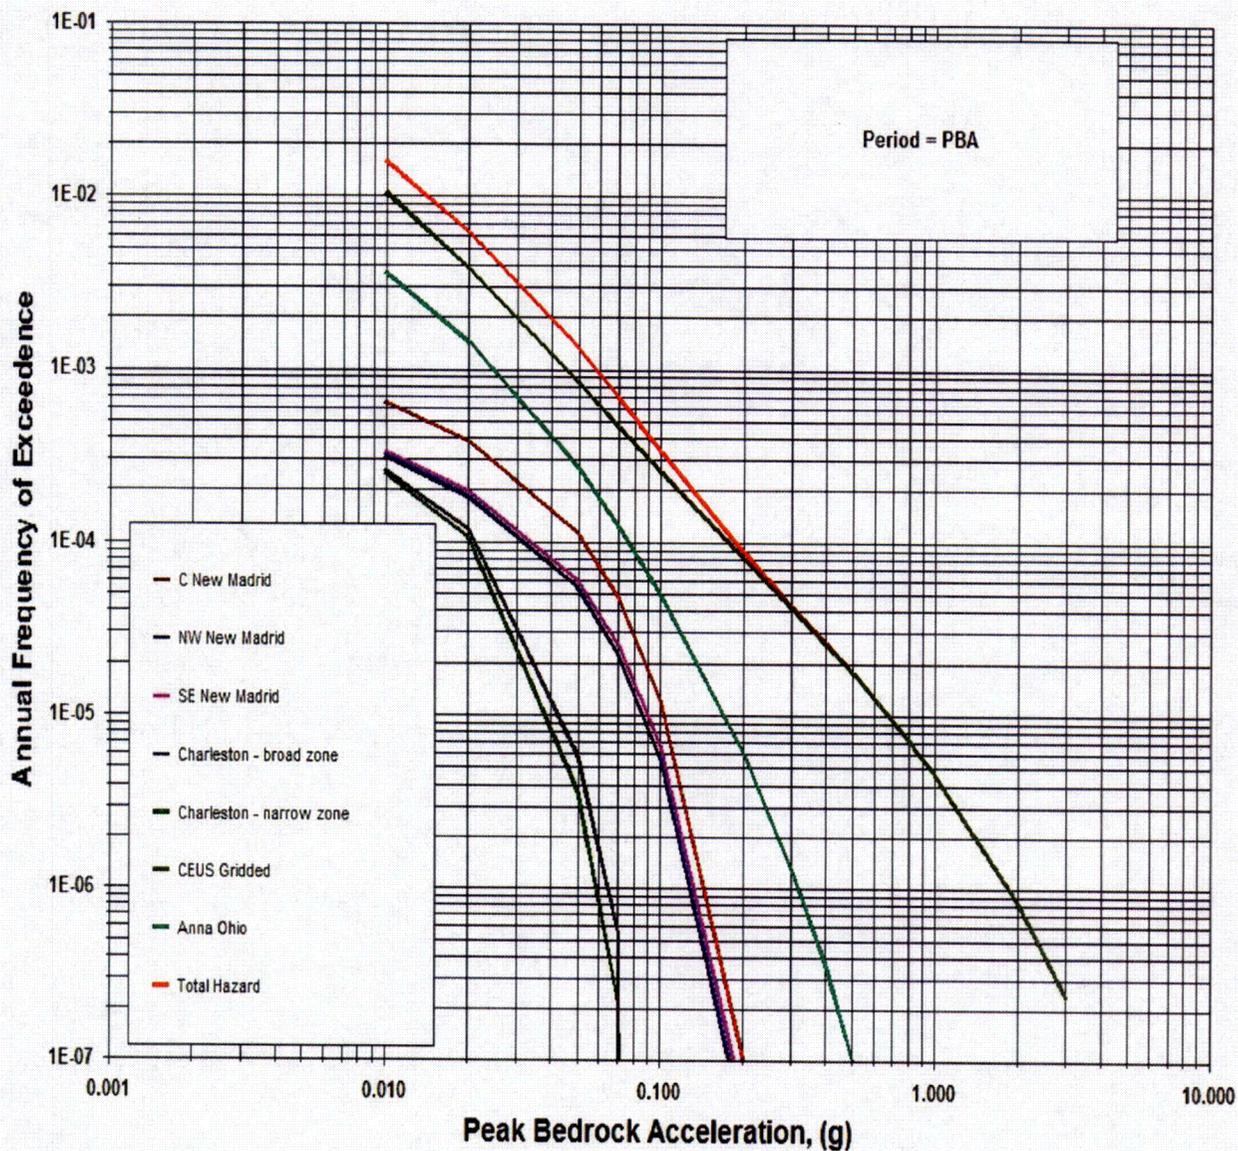

### HAZARD BY SEISMIC SOURCE


USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 4  
ECS Project No. 14-3046  
January 2006

COY

### Uniform Hazard Spectra

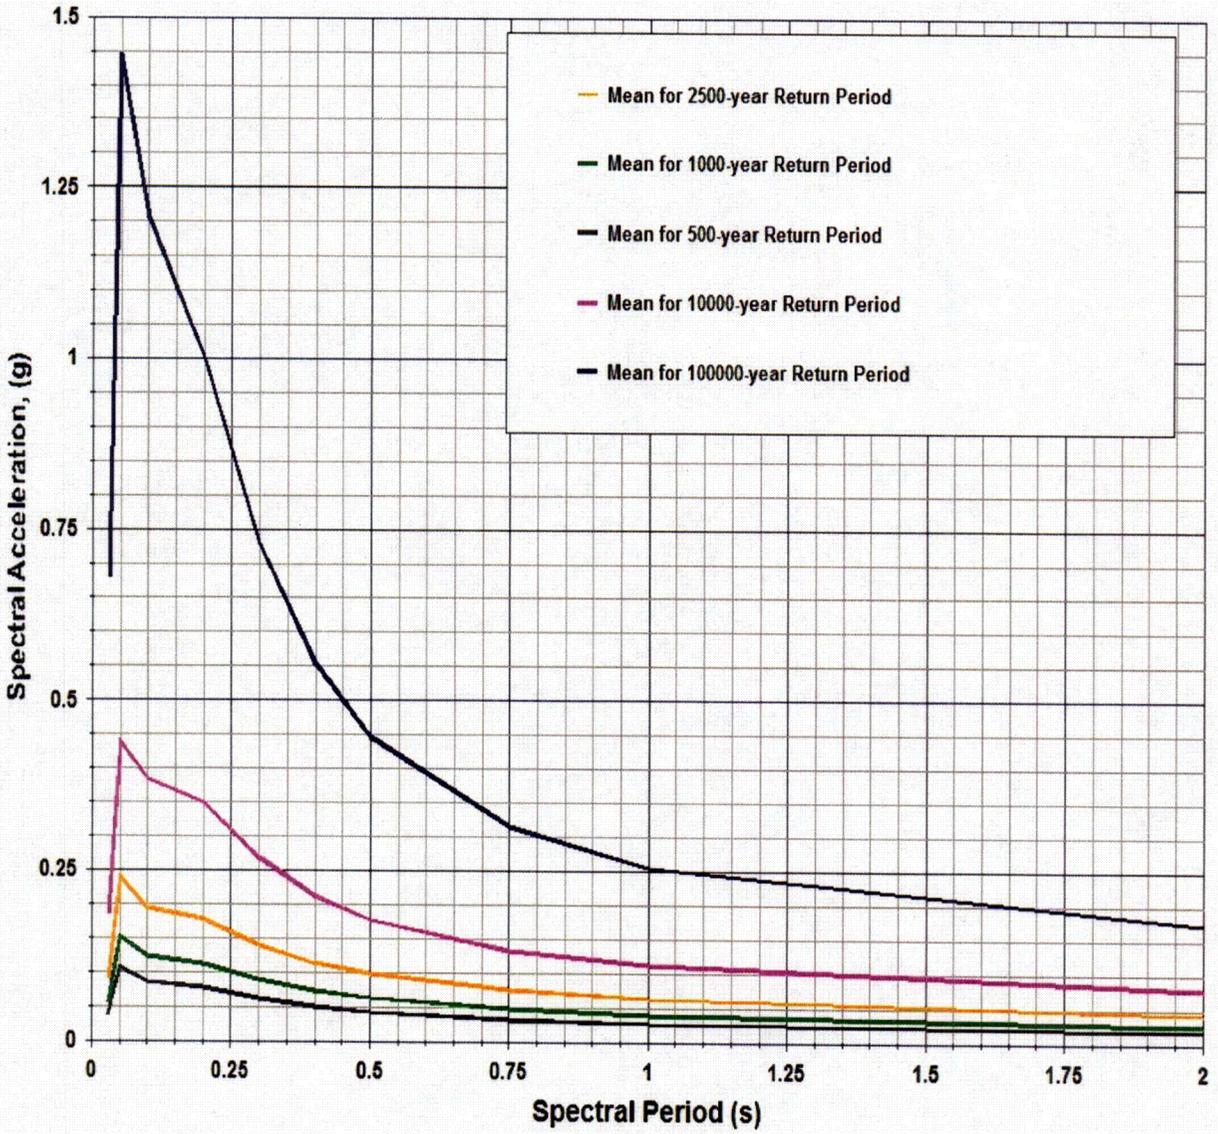

### UNIFORM HAZARD SPECTRA


USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 5  
ECS Project No. 14-3046  
January 2006

C05

# 1996 USGS, 2003 IBC, Site Class C

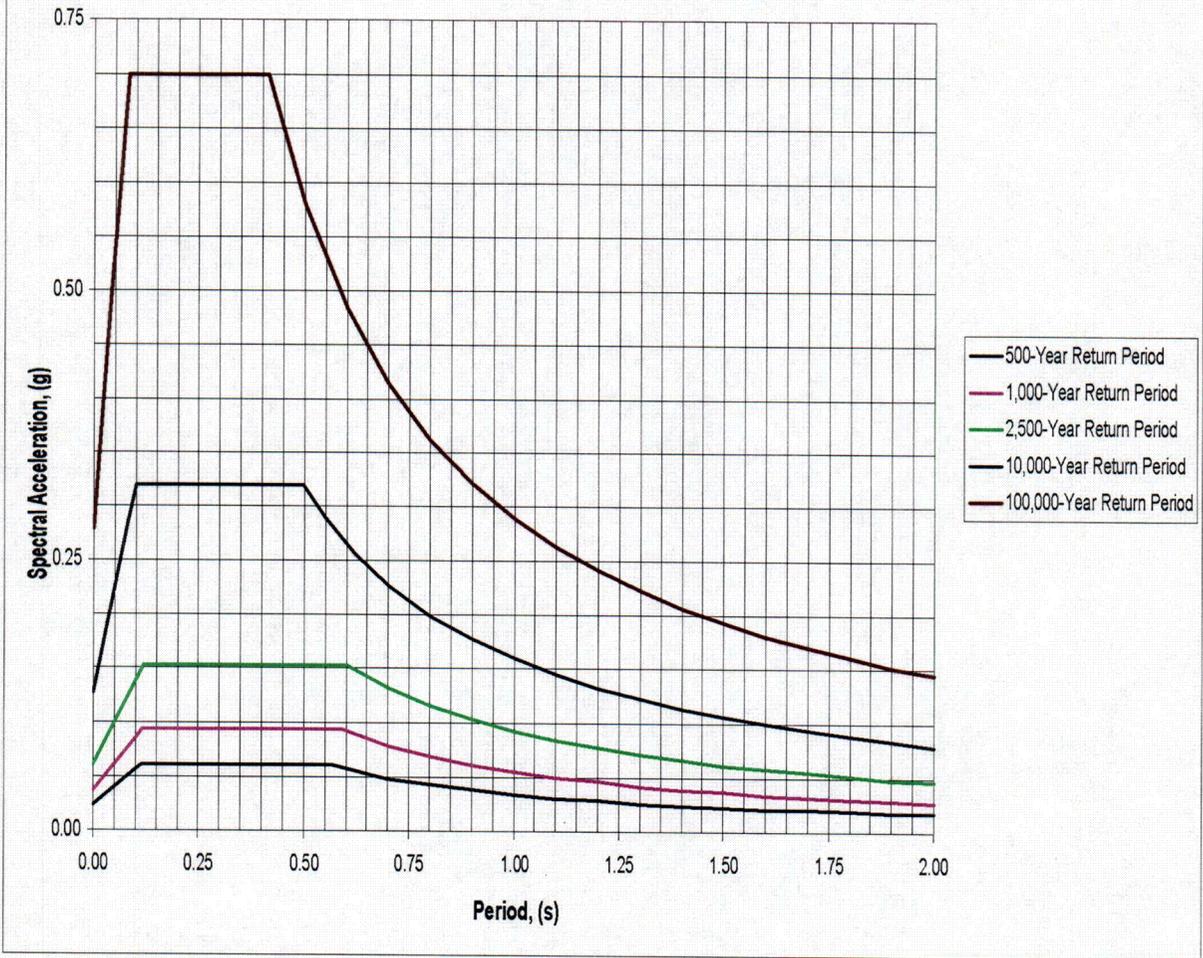

## CODE RESPONSE SPECTRA

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio





Figure 6  
ECS Project No. 14-3046  
January 2006

COG

## 2002 USGS, CODE SPECTRA

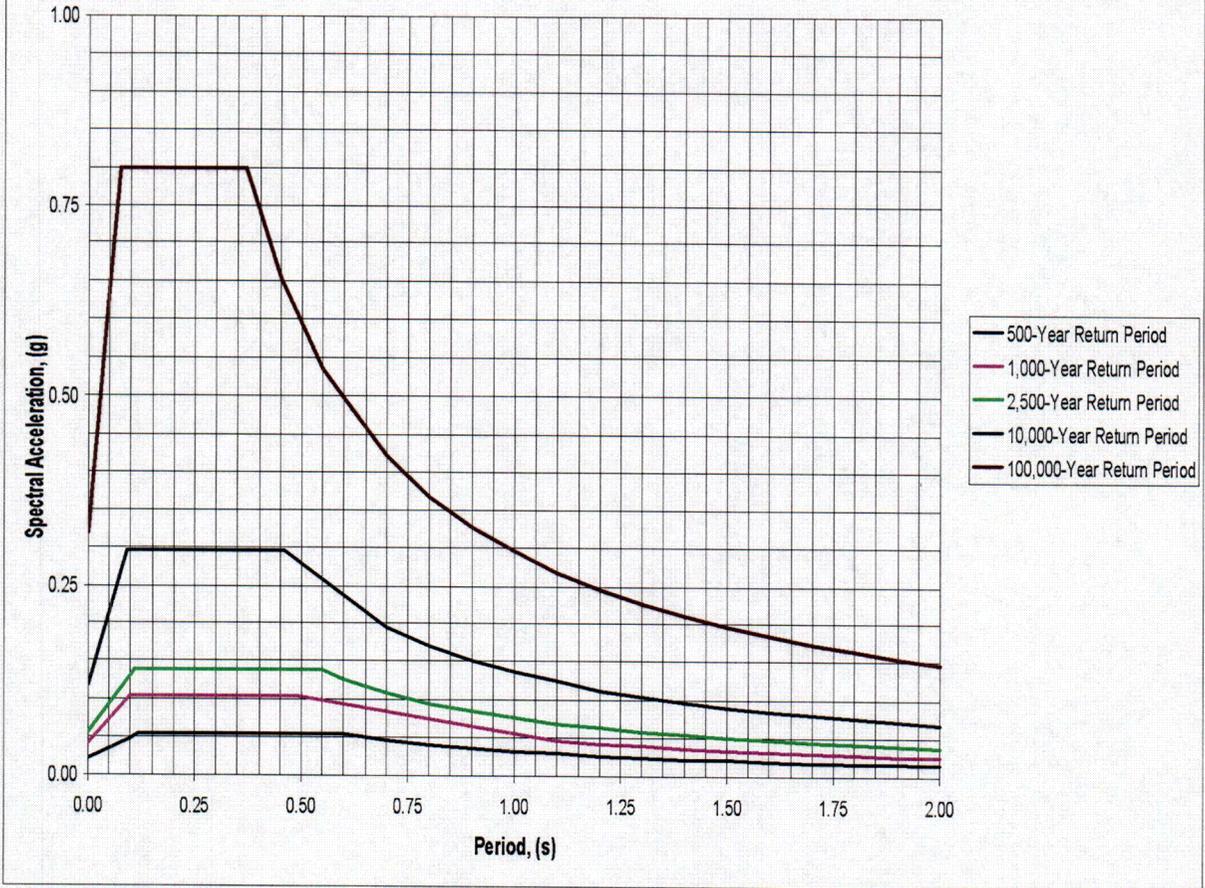

## CODE RESPONSE SPECTRA

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 7  
ECS Project No. 14-3046  
January 2006

Layer	Name	Thickness	Classification	P...	Modulus Reduction Curve	Damping Curve	Density	Max. Shear Wave Vel...	Max. Shear Modulus
1	Inorganic Clay with Low Plasticity	3.0 feet	USCS CL		Clay (Sun et al 1988) Plasticity Index 5-10	Clay (Sun et al 1988) Av...	120.0 ...	740.0 feet per second	2342.39 ksf
2	Inorganic Silts with Slight Plasticity	6.0 feet	USCS ML		Clay (Sun et al 1988) Plasticity Index 5-10	Clay (Sun et al 1988) Av...	120.0 ...	750.0 feet per second	2397.96 ksf
3	Inorganic Clay with Low Plasticity	13.0 feet	USCS CL		Clay (Sun et al 1988) Plasticity Index 10-20	Clay (Sun et al 1988) Av...	120.0 ...	350.0 feet per second	2594.72 ksf
4	Inorganic Silts with Slight Plasticity	5.0 feet	USCS ML		Clay (Sun et al 1988) Plasticity Index 5-10	Clay (Sun et al 1988) Av...	120.0 ...	500.0 feet per second	932.428 ksf
5	Silty Sand	5.0 feet	USCS SM		Sand (Seed & Idriss 1970) Average	Sand (Seed & Idriss 1970...	120.0 ...	1100.0 feet per second	4512.95 ksf
6	Silty Sand	5.0 feet	USCS SM		Sand (Seed & Idriss 1970) Average	Sand (Seed & Idriss 1970...	130.0 ...	1300.0 feet per second	13091.3 ksf

### SOIL PROFILE FOR SHAKE ANALYSIS- PROFILE 1

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 8  
ECS Project No. 14-3046  
January 2006

Layer	Name	Thickness	Classification	$\rho$	Modulus Reduction Curve	Damping Curve	Density	Max. Shear Wave Vel...	Max. Shear Modulus
1	Inorganic Clay with Low Plasticity	3.0 feet	USCS CL		Clay (Sun et al 1988) Plasticity Index: 5-10	Clay (Sun et al. 1968) Av...	120.0 ..	740.0 feet per second	2042.39 ksf
2	Inorganic Silts with Slight Plasticity	6.0 feet	USCS ML		Clay (Sun et al 1988) Plasticity Index: 5-10	Clay (Sun et al. 1968) Av...	120.0 ..	750.0 feet per second	2097.96 ksf
3	Inorganic Clay with Low Plasticity	13.0 feet	USCS CL		Clay (Sun et al 1988) Plasticity Index: 10-20	Clay (Sun et al. 1968) Av...	120.0 ..	850.0 feet per second	2694.72 ksf
4	Inorganic Silts with Slight Plasticity	5.0 feet	USCS ML		Clay (Sun et al 1988) Plasticity Index: 5-10	Clay (Sun et al. 1968) Av...	120.0 ..	1000.0 feet per second	3729.7 ksf
E	Silty Sand	5.0 feet	USCS SM		Sand (Seed & Idriss 1970) Average	Sand (Seed & Idriss 1970...	120.0 ..	1100.0 feet per second	4512.35 ksf
E	Silty Sand	5.0 feet	USCS SM		Sand (Seed & Idriss 1970) Average	Sand (Seed & Idriss 1970...	130.0 ..	1800.0 feet per second	13091.3 ksf


## SOIL PROFILE FOR SHAKE ANALYSIS- PROFILE 2

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 9  
ECS Project No. 14-3046  
January 2006

### 2500-YEAR RETURN PERIOD (5% Damping)

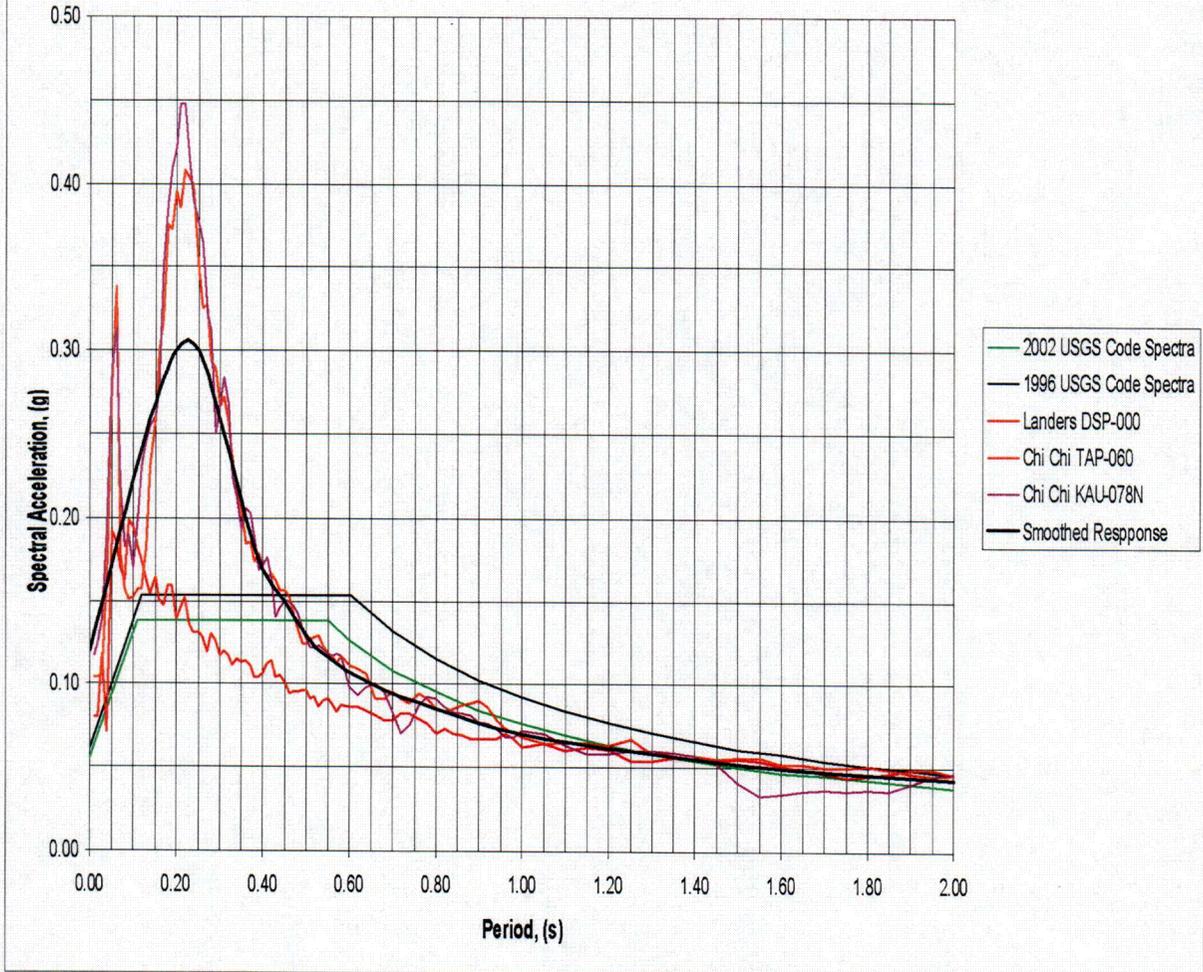


### 2,500 Yr RETURN PERIOD - SHAKE ANALYSIS

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 10  
ECS Project No. 14-3046  
January 2006

## 10000 YEAR RETURN PERIOD SPECTRA (5% DAMPING)

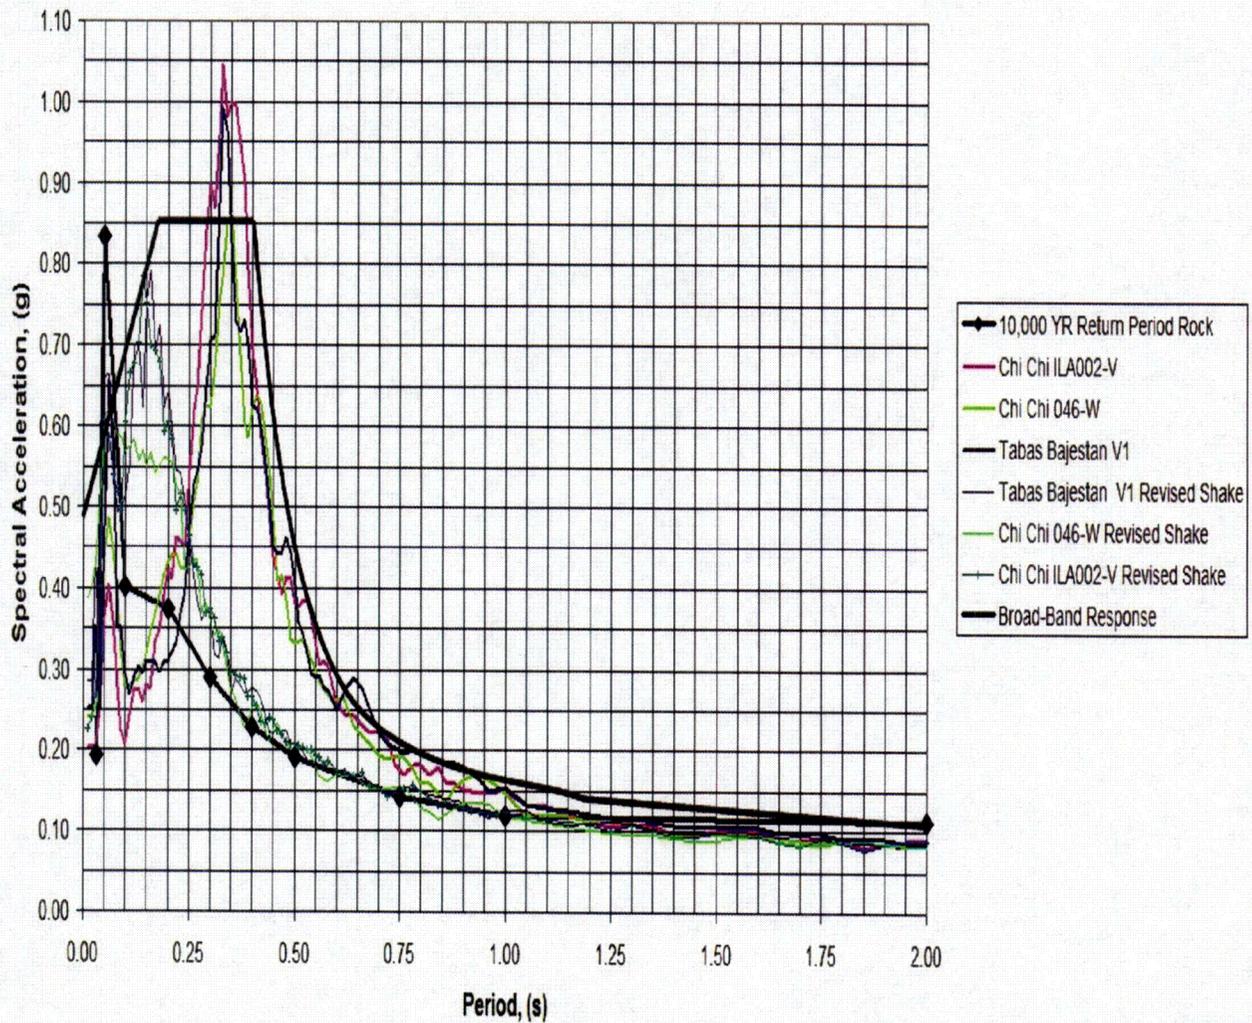


### 10,000 Yr RETURN PERIOD SPECTRA - SHAKE ANALYSIS

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 11  
ECS Project No. 14-3046  
January 2006

C11

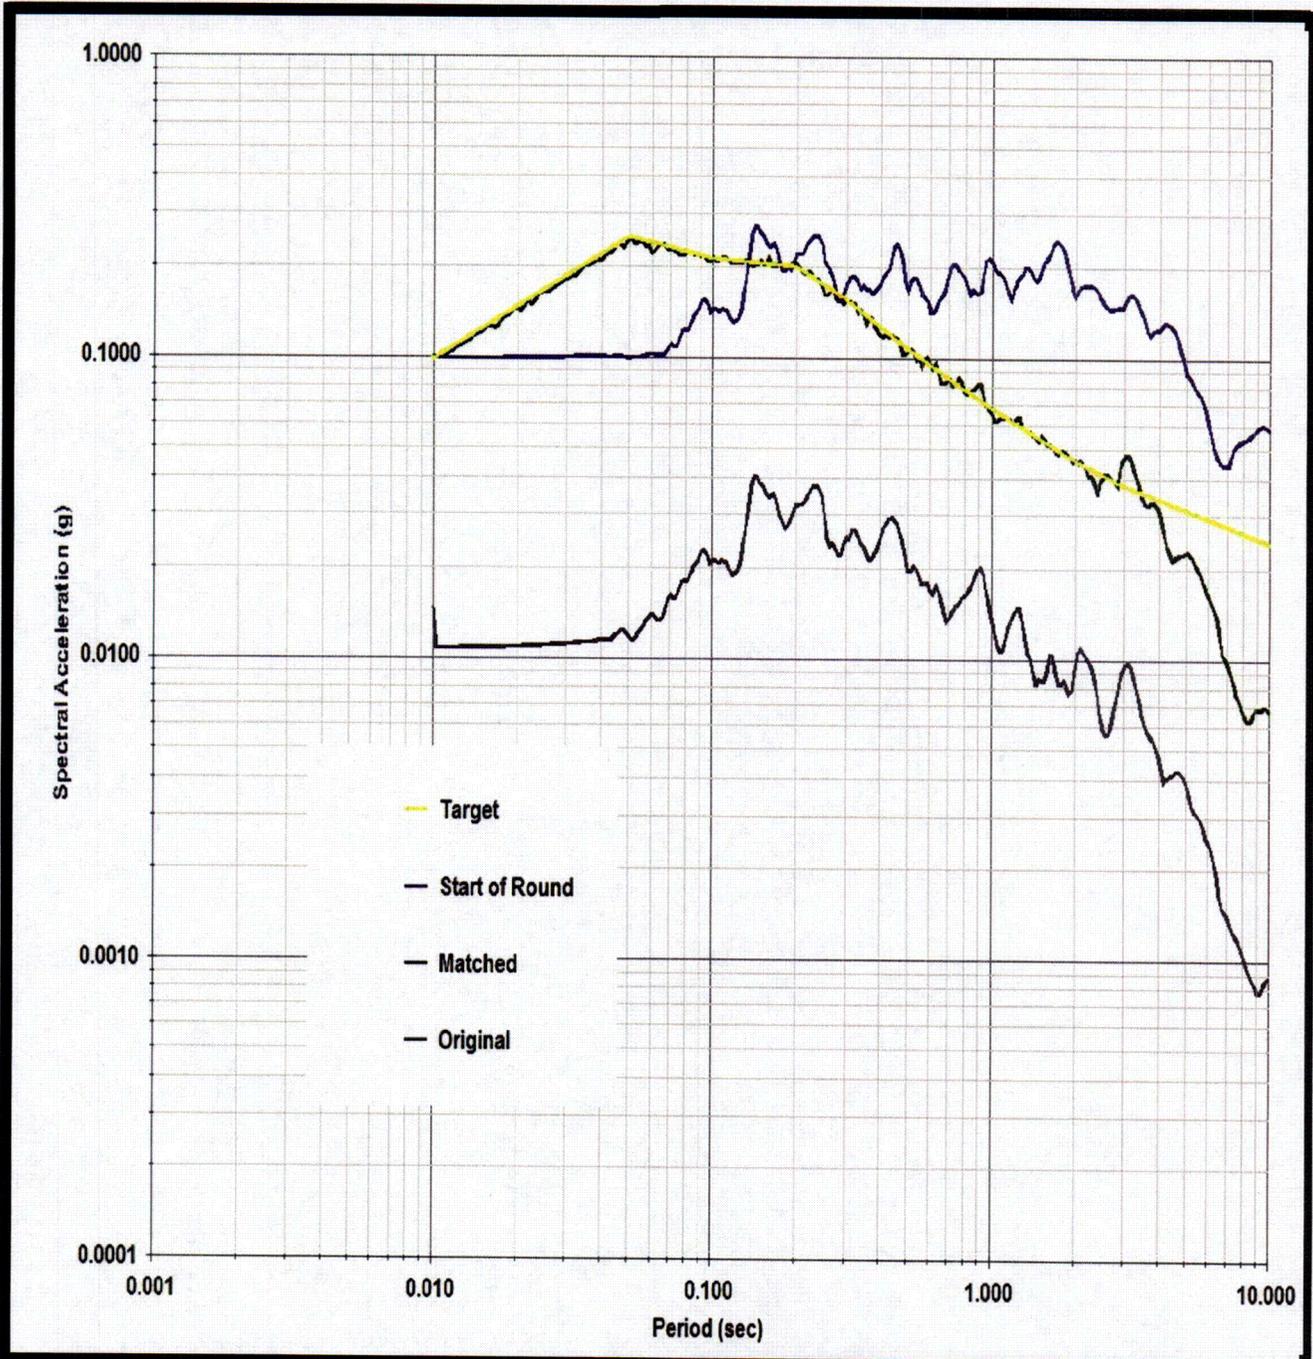


2,500 Yr TAP060 Spectral Match

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 12  
ECS Project No. 14-3046  
January 2006

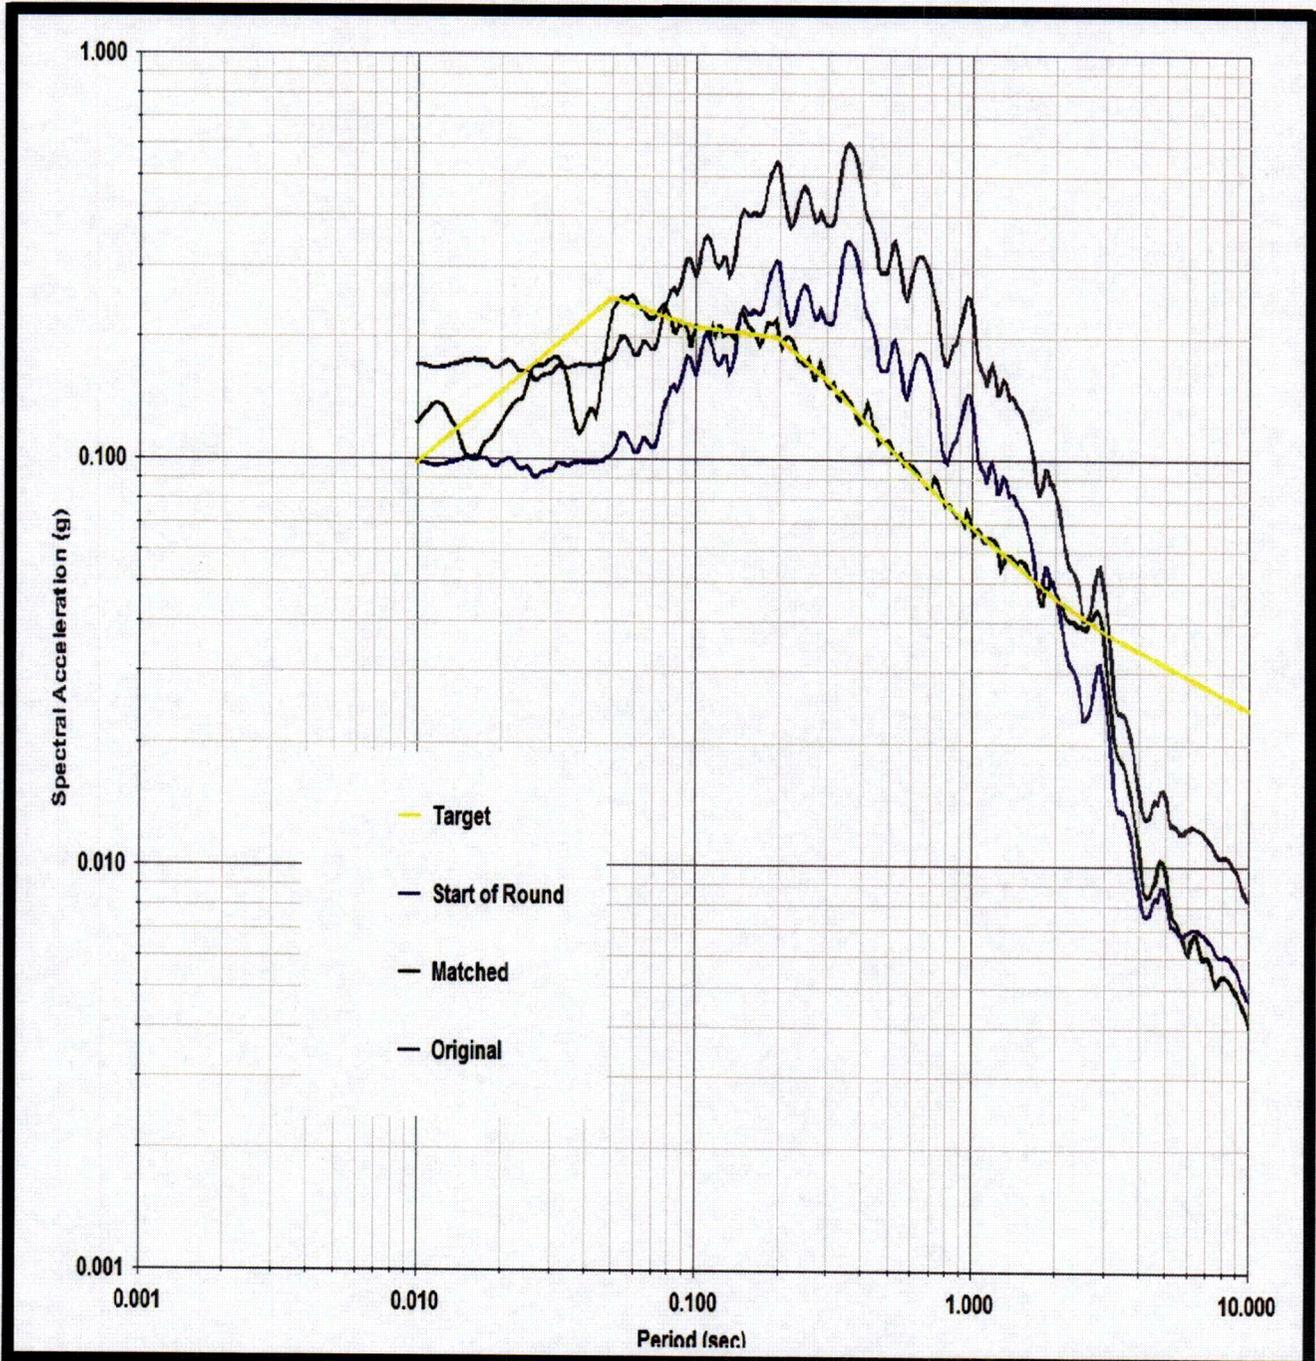


2,500 Yr Landers SIL Spectral Match

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 13  
ECS Project No. 14-3046  
January 2006






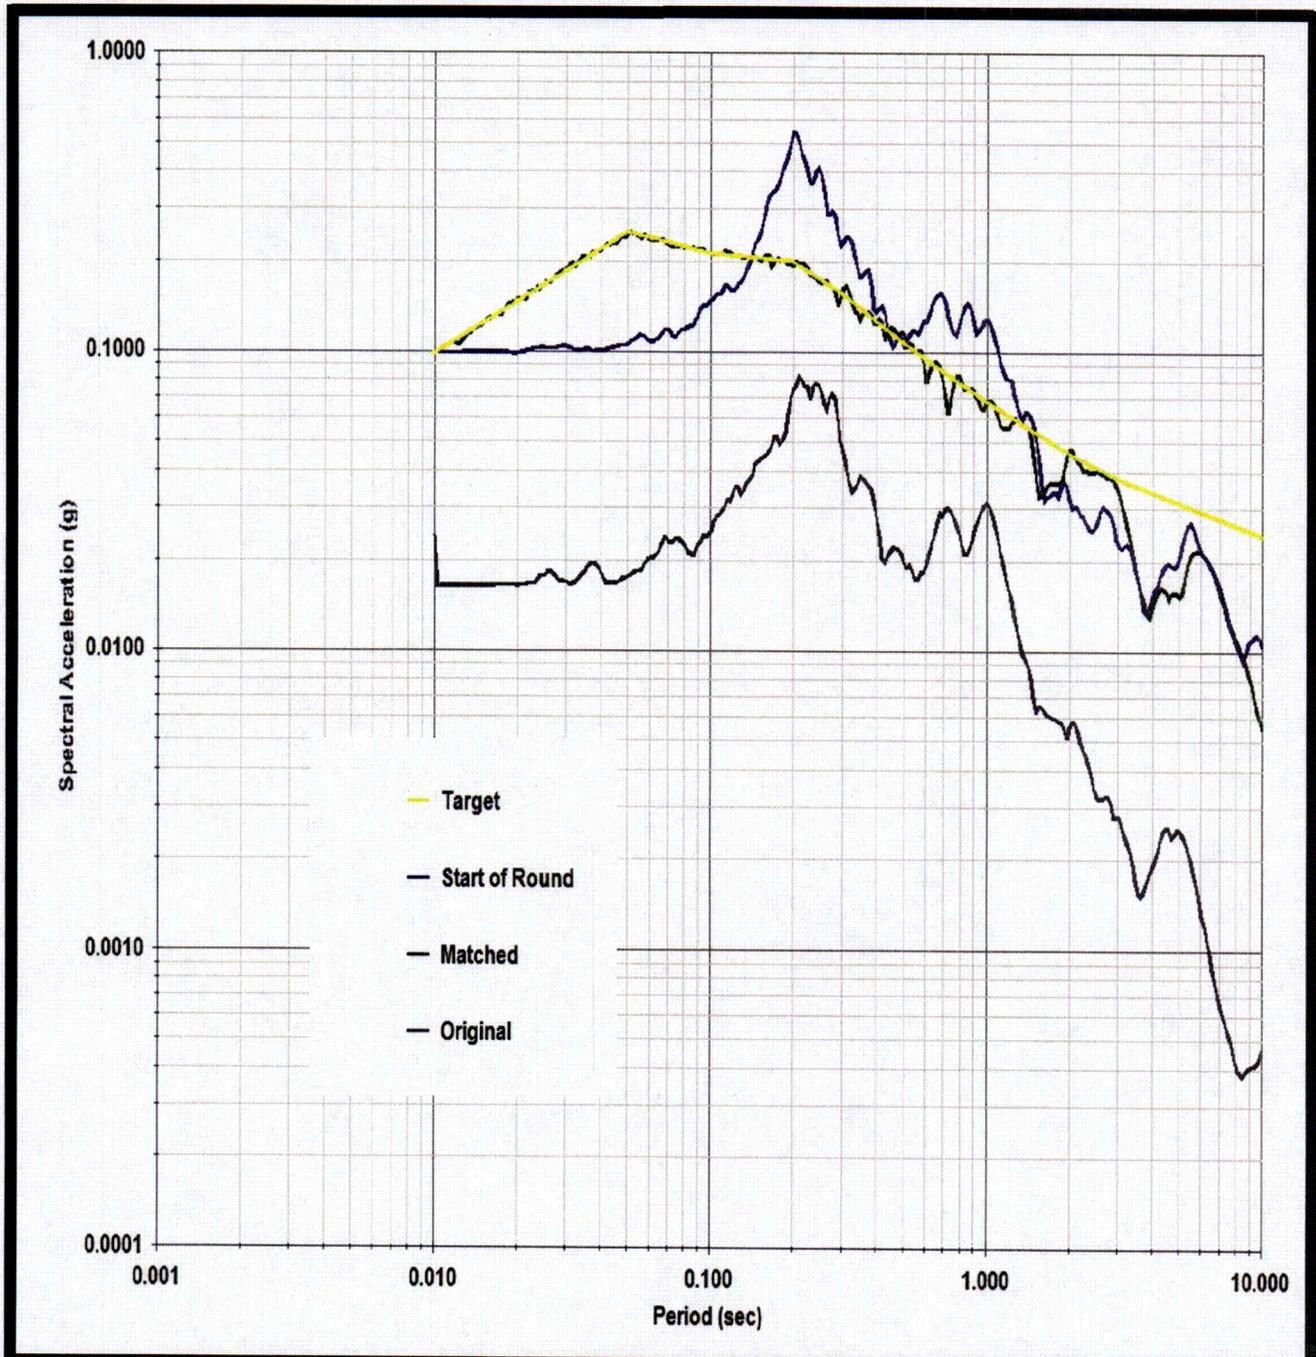


2,500 Yr Taiwan Chi Chi KAU-078N Spectral Match

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 14  
ECS Project No. 14-3046  
January 2006

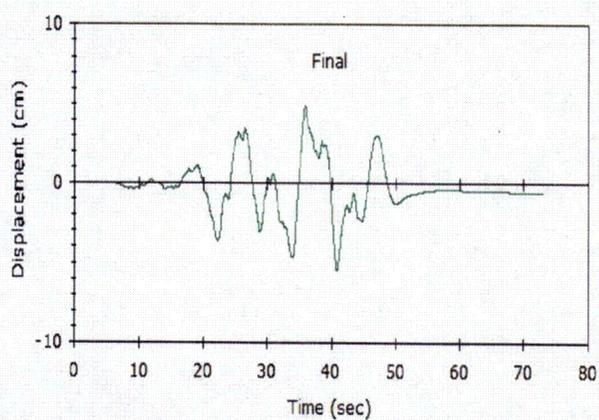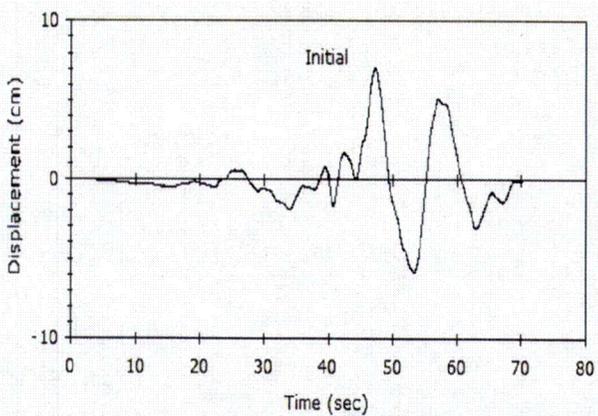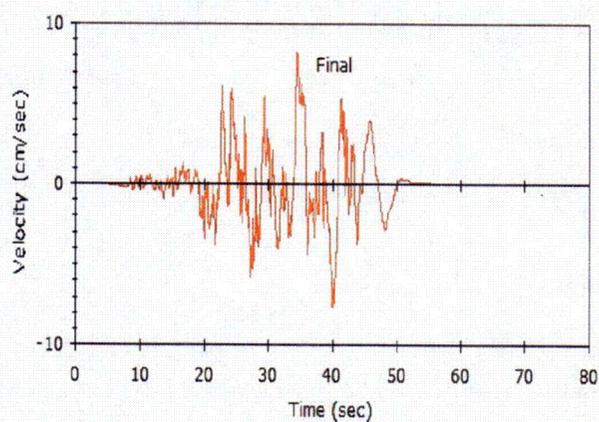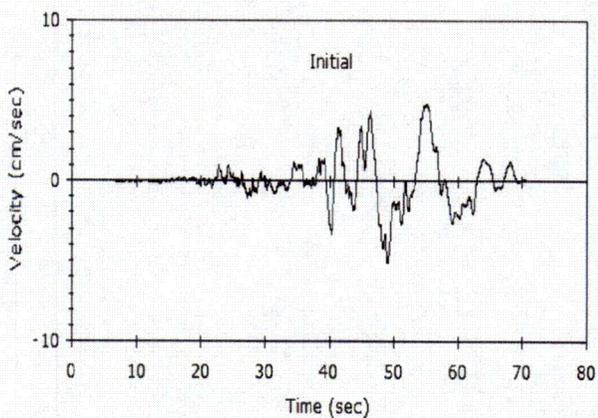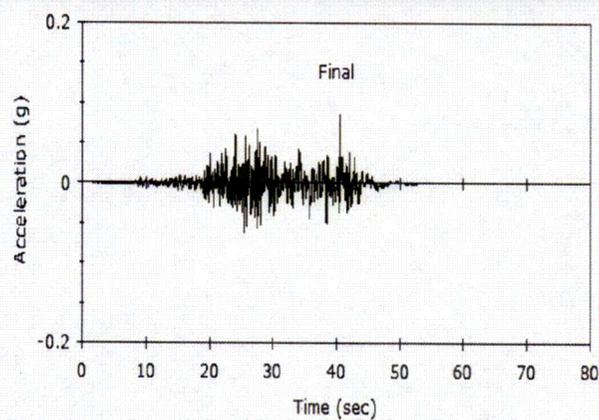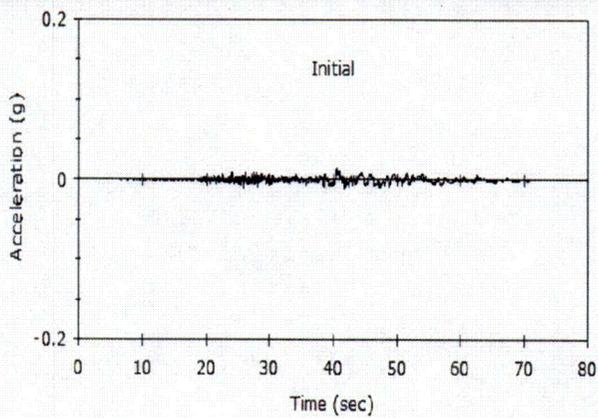

### 2,500 Yr TAP 060V Time History

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio










Figure 15  
ECS Project No. 14-3046  
January 2006

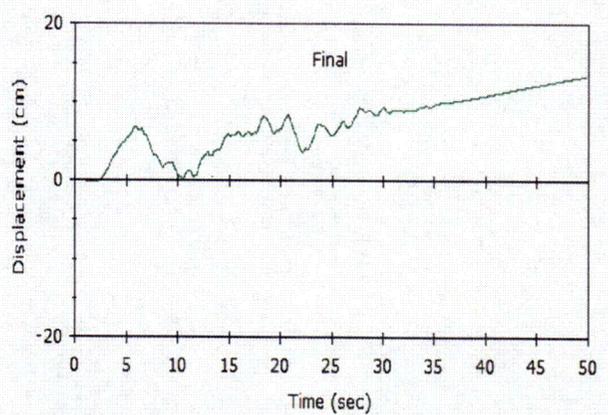
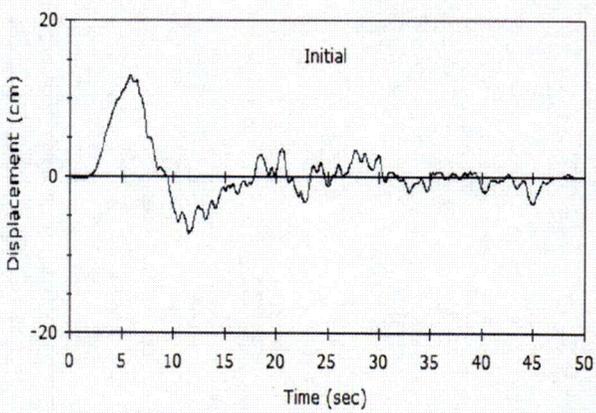
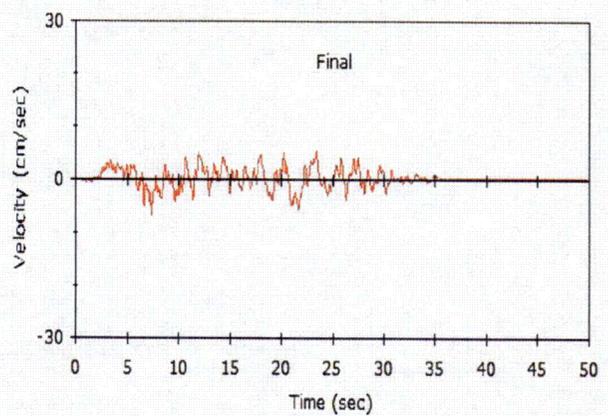
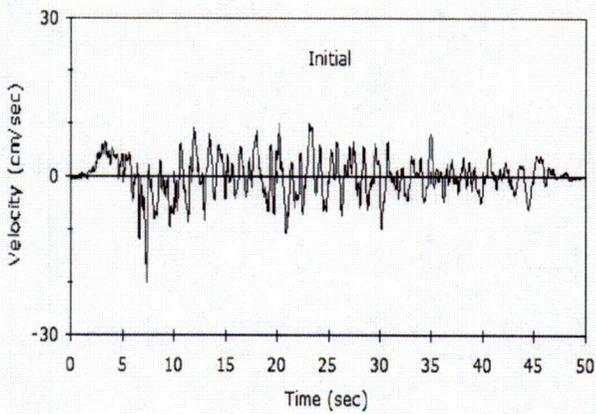
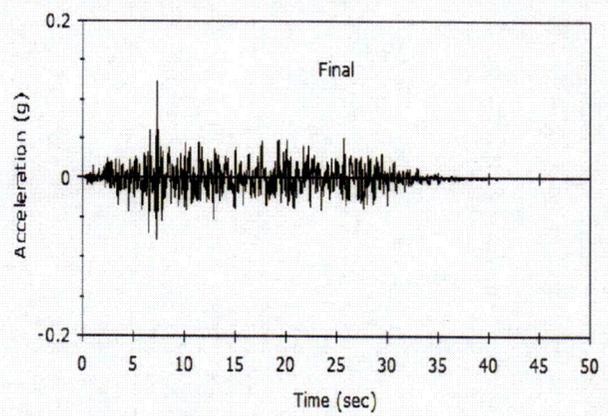
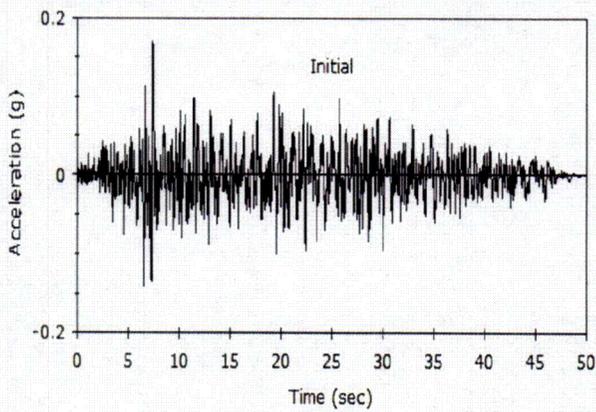


### 2,500 Yr Landers SIL Time History

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Pikeeton, Ohio



Figure 16  
ECS Project No. 14-3046  
January 2006

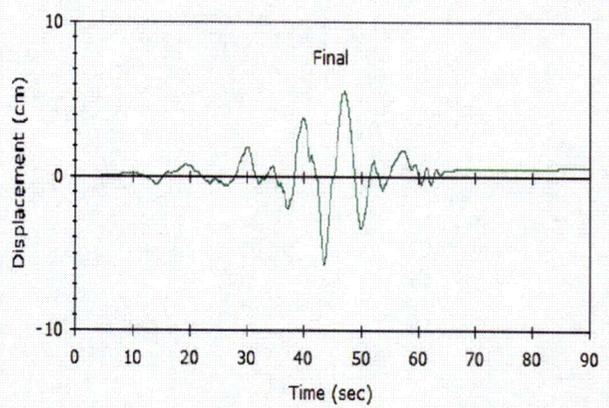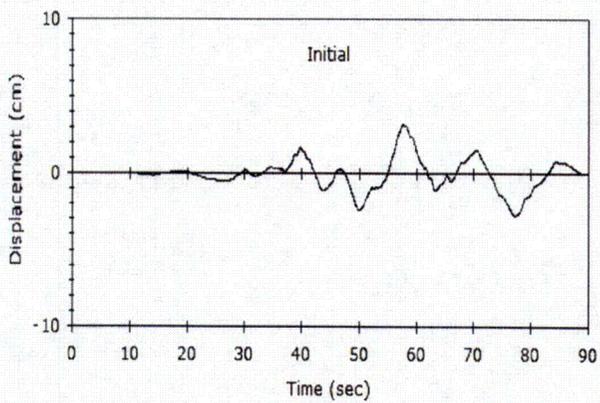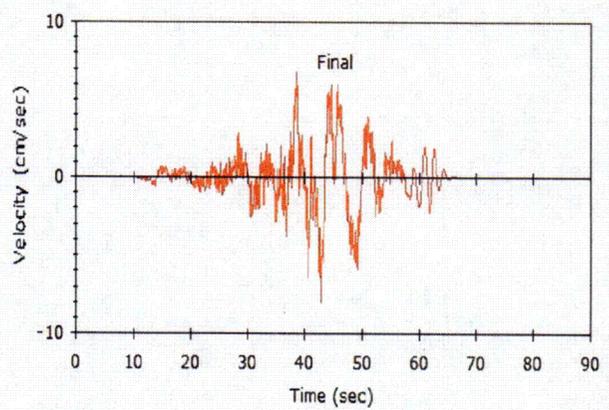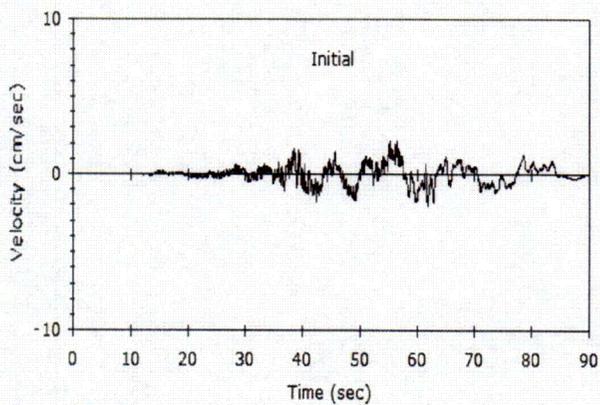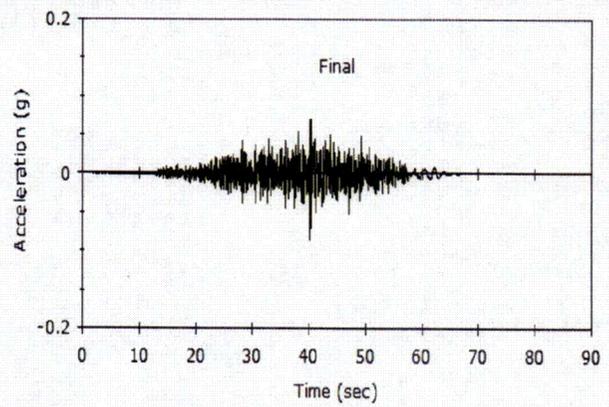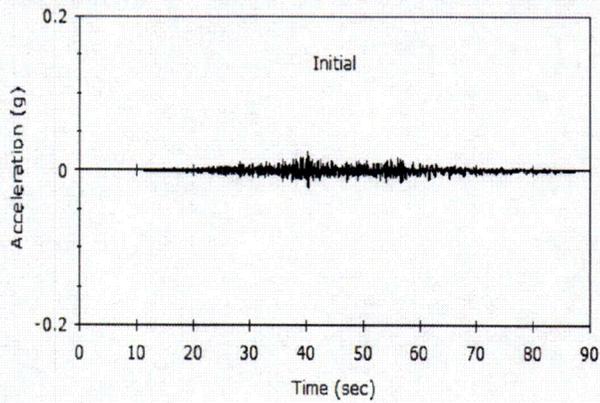


**2,500 Yr Taiwan Chi Chi KAU078N Time History**

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 17  
ECS Project No. 14-3046  
January 2006

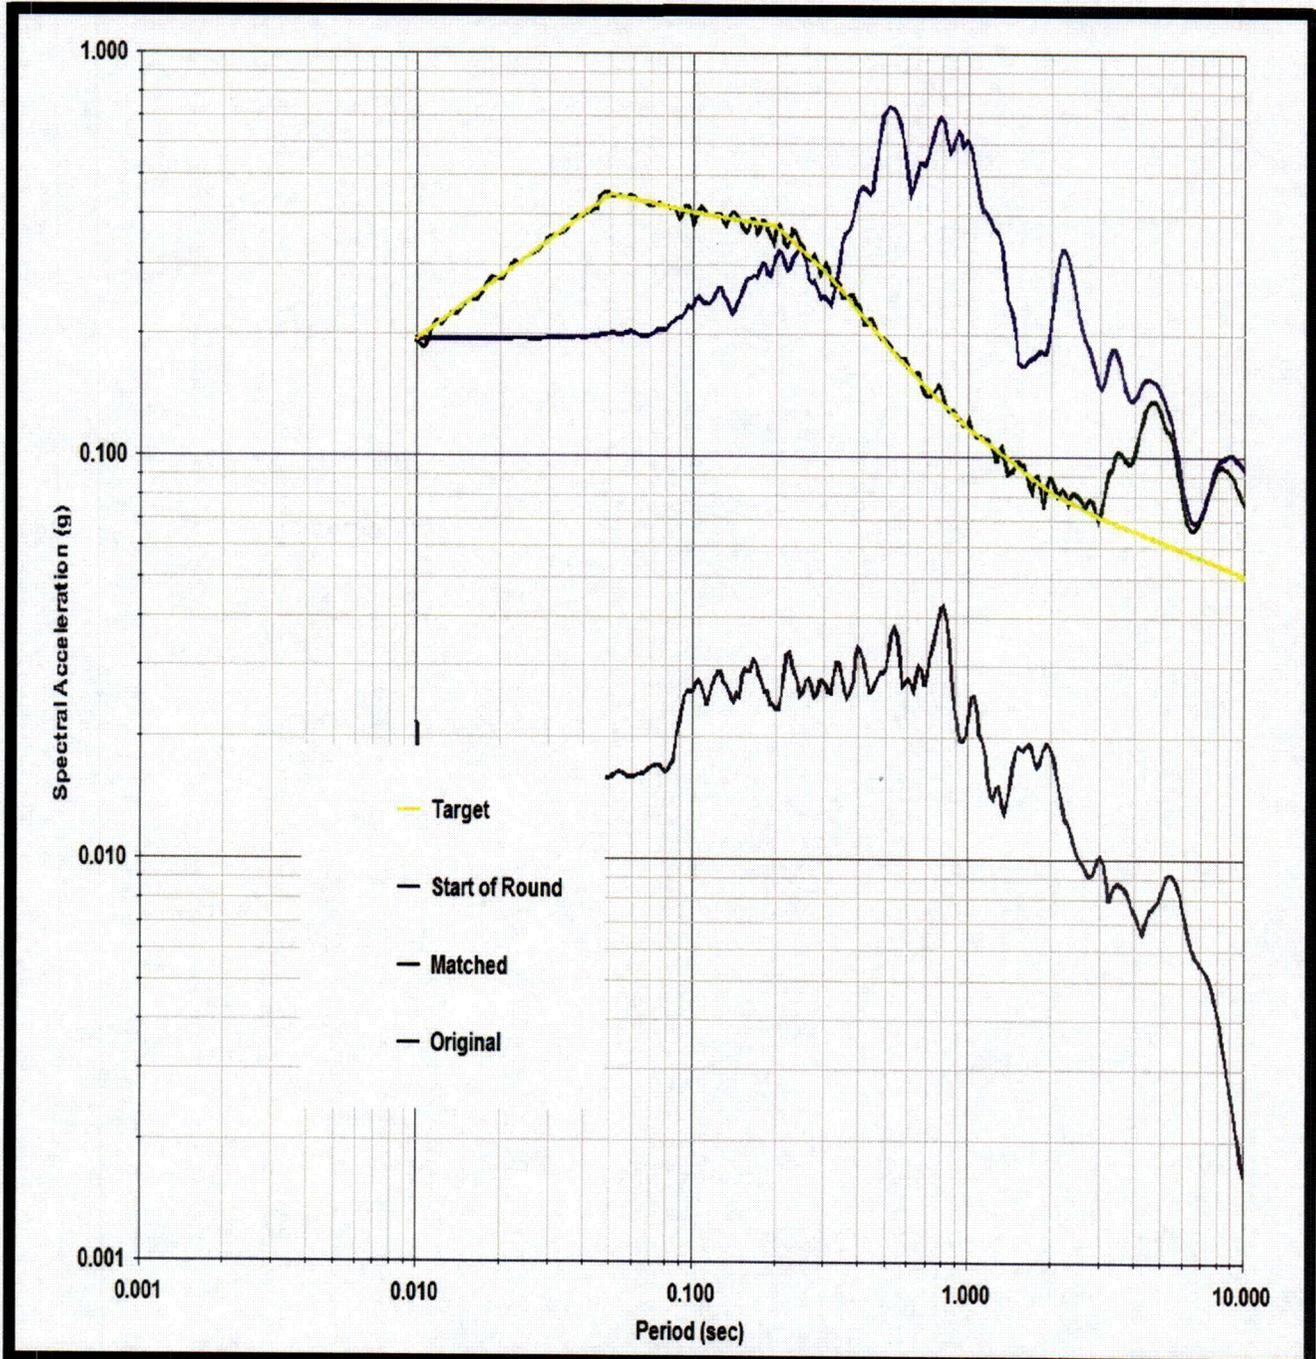


10,000 Yr Taiwan Chi Chi ILA002-V Spectral Match

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 18  
ECS Project No. 14-3046  
January 2006

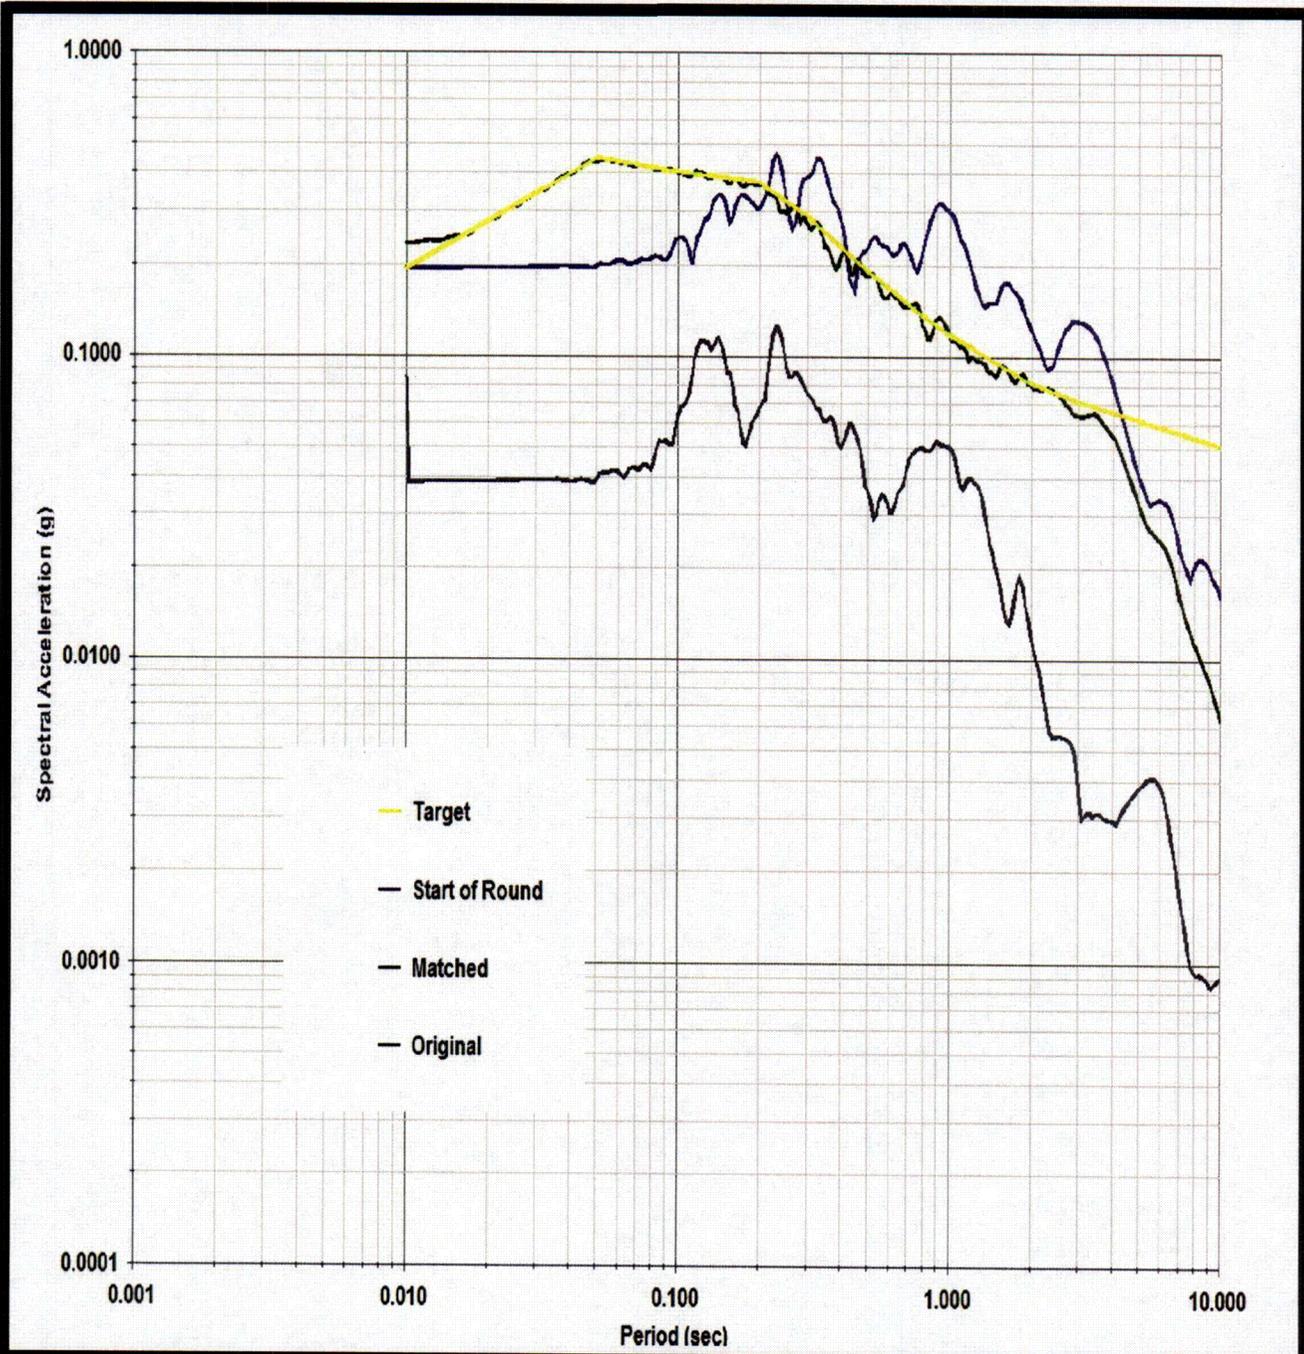


10,000 Yr Taiwan Chi Chi 046-W Spectral Match

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 19  
ECS Project No. 14-3046  
January 2006

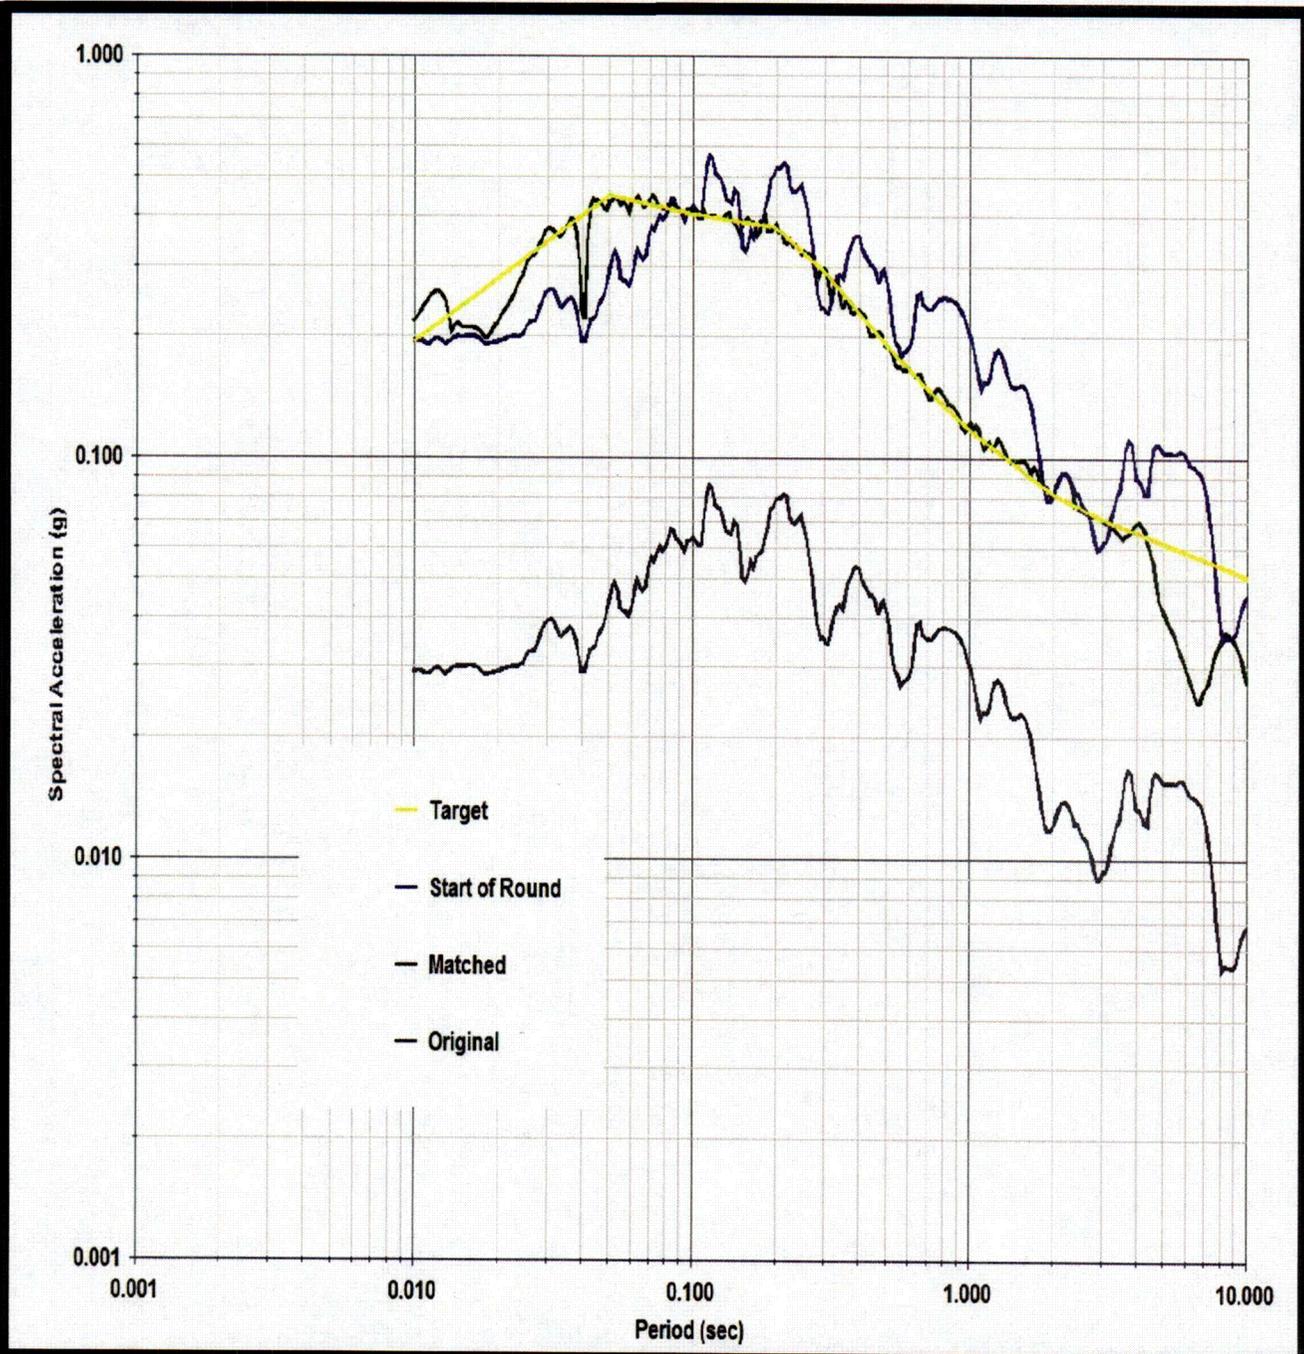

10,000 Yr Tabas Bajestan V1 Spectral Match

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio










Figure 20  
ECS Project No. 14-3046  
January 2006

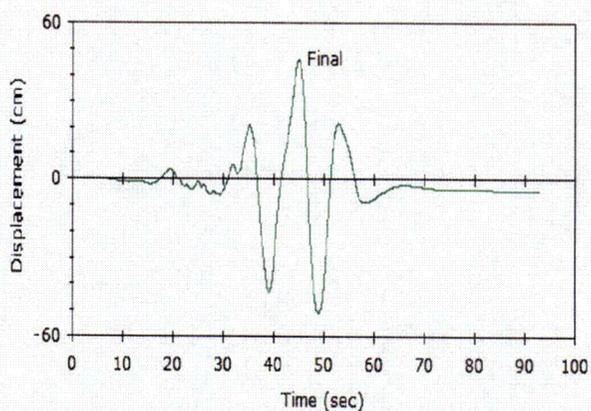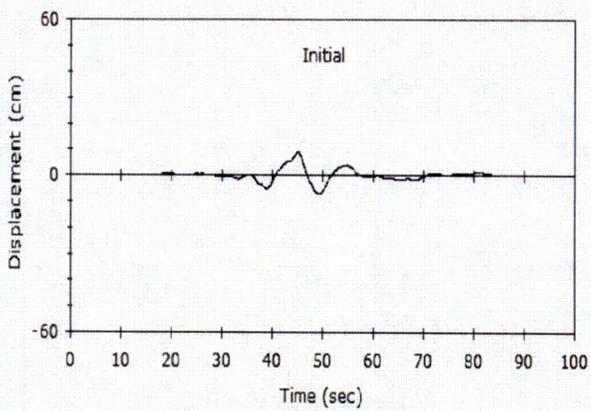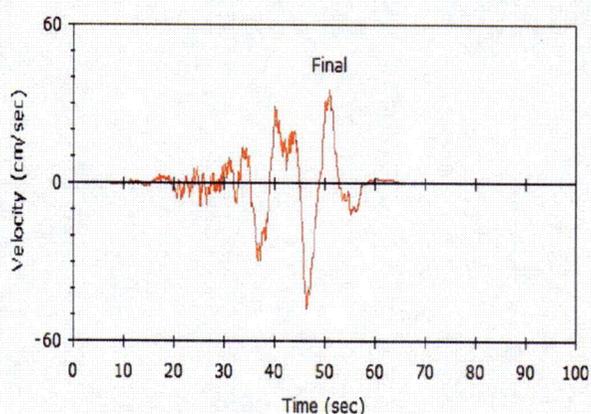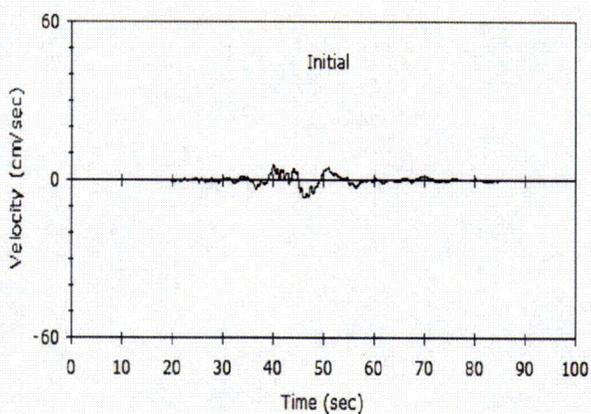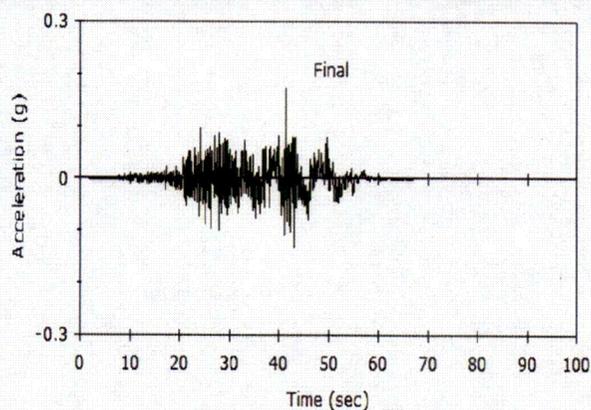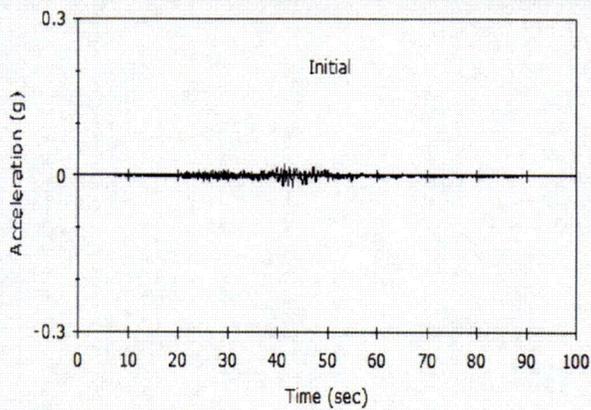

**10,000 Yr Taiwan Chi Chi ILA002-V Time History**

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio










Figure 21  
ECS Project No. 14-3046  
January 2006

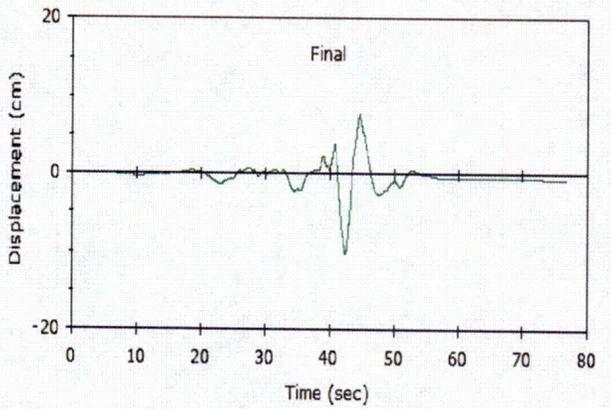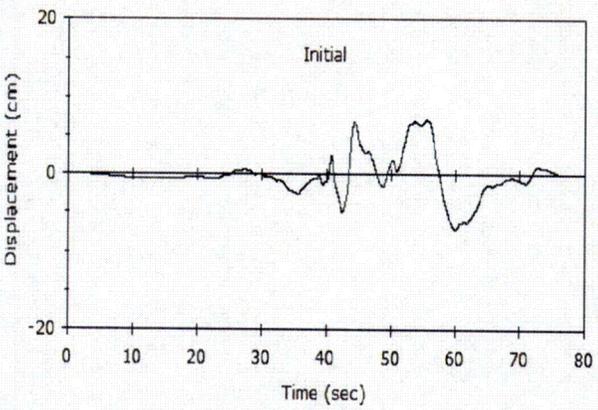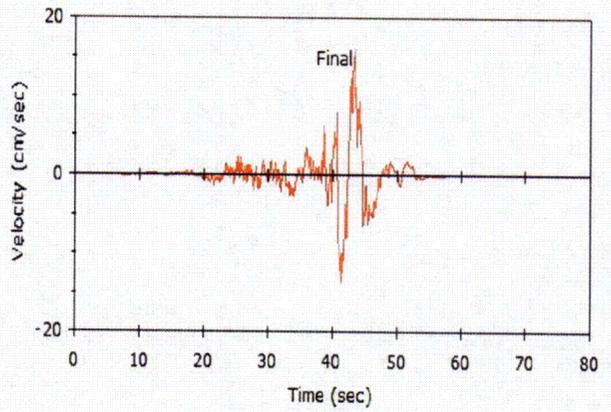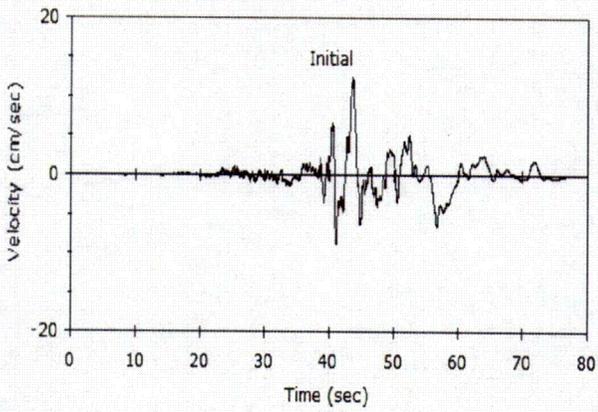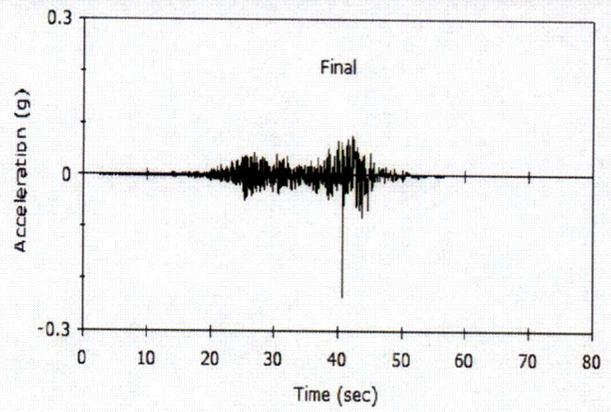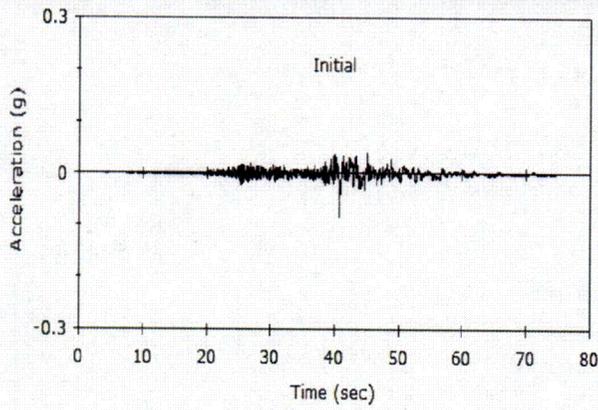







### 10,000 Yr Taiwan Chi Chi 046-W Time History

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 22  
ECS Project No. 14-3046  
January 2006

C22

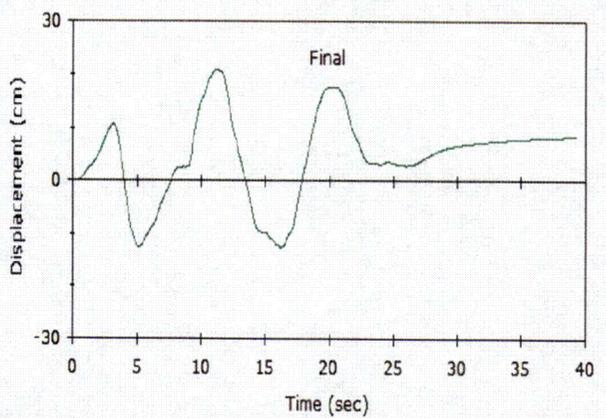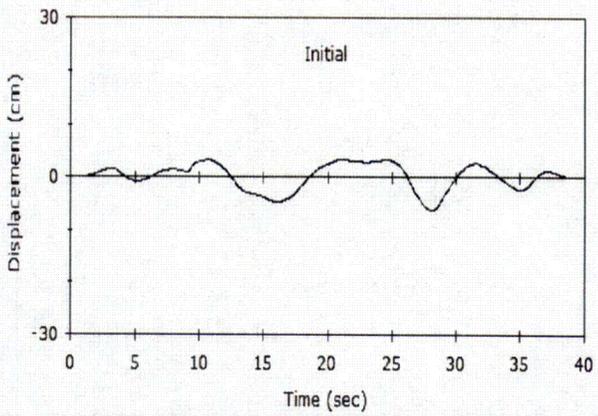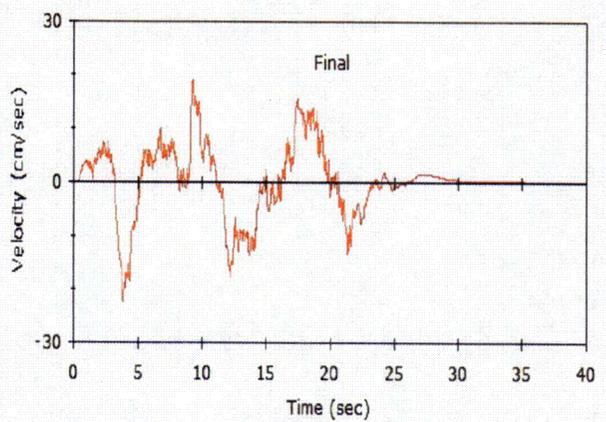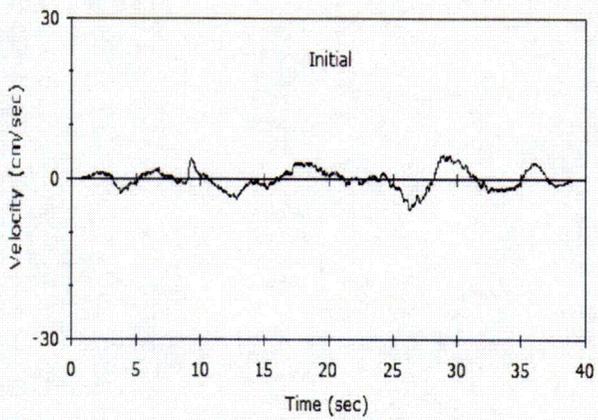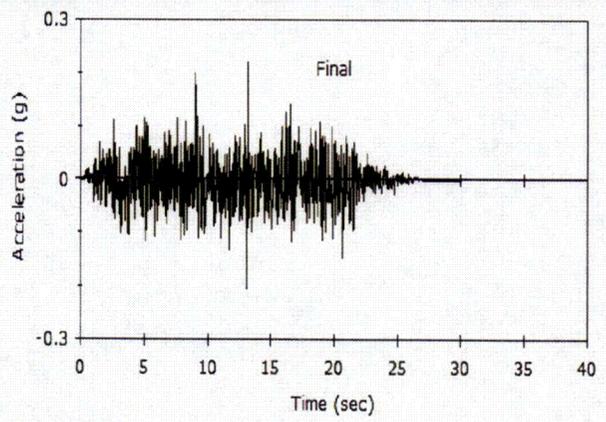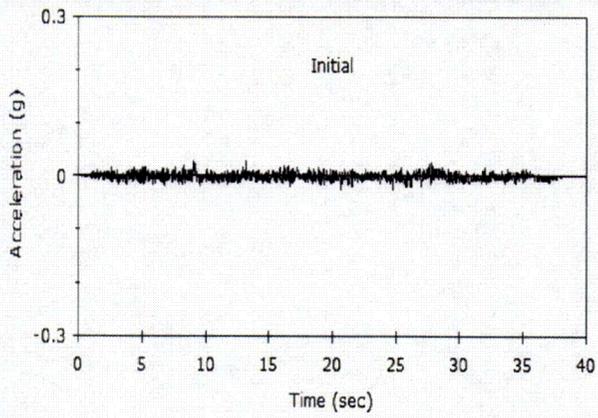


### 10,000 Yr Tabas Bajestan V1 Time History

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 23  
ECS Project No. 14-3046  
January 2006

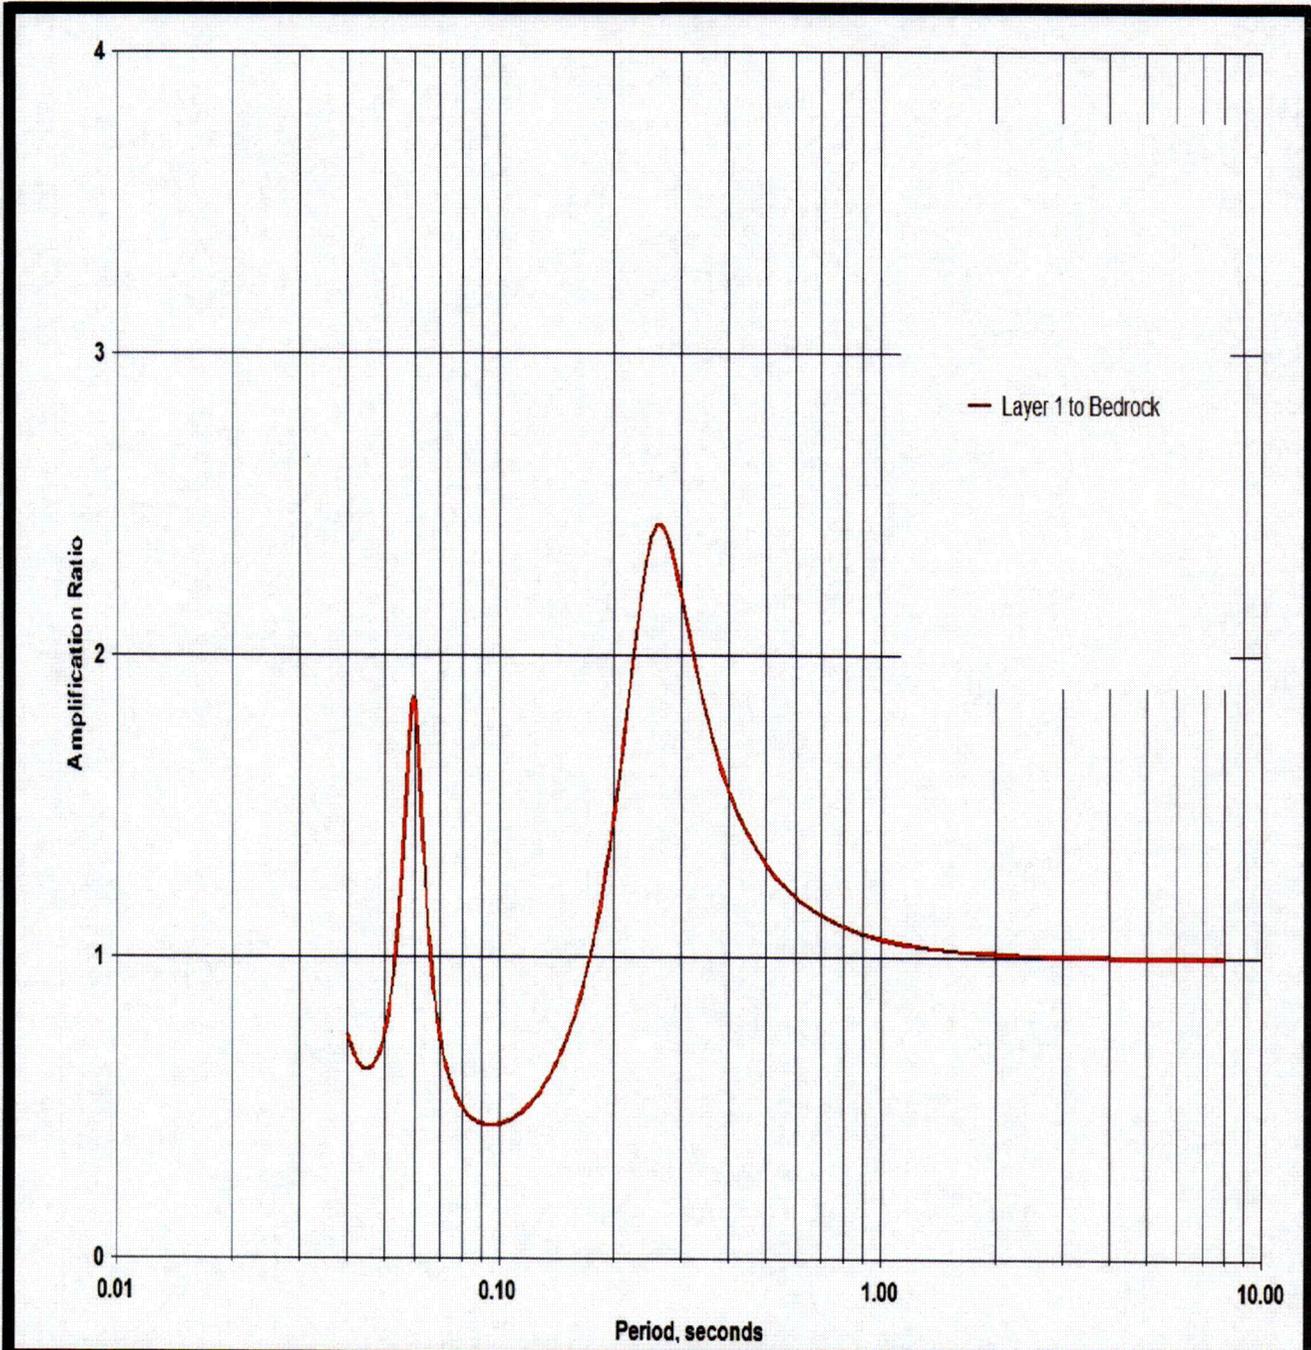

10,000 Yr Taiwan Chi Chi ILA002-V Amplification Ratio- Profile 1

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio





Figure 24  
ECS Project No. 14-3046  
January 2006

C24

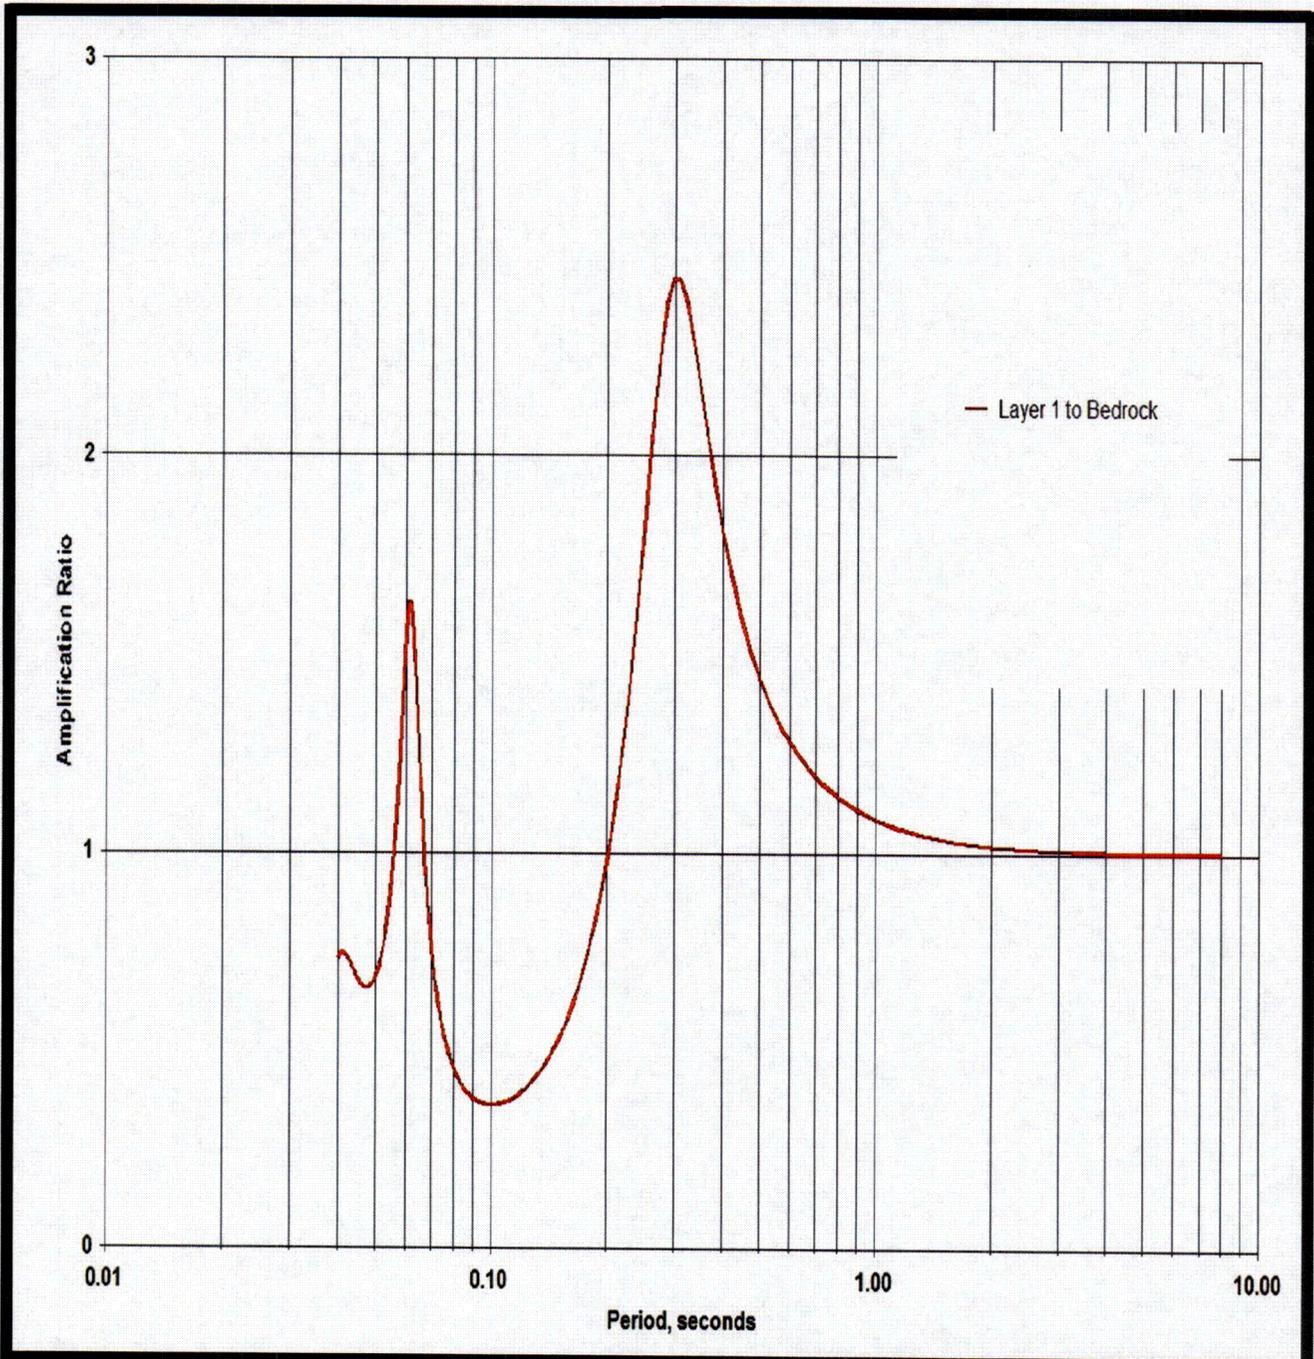

10,000 Yr Taiwan 046-W Amplification Ratio – Profile 1

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio





Figure 25  
ECS Project No. 14-3046  
January 2006

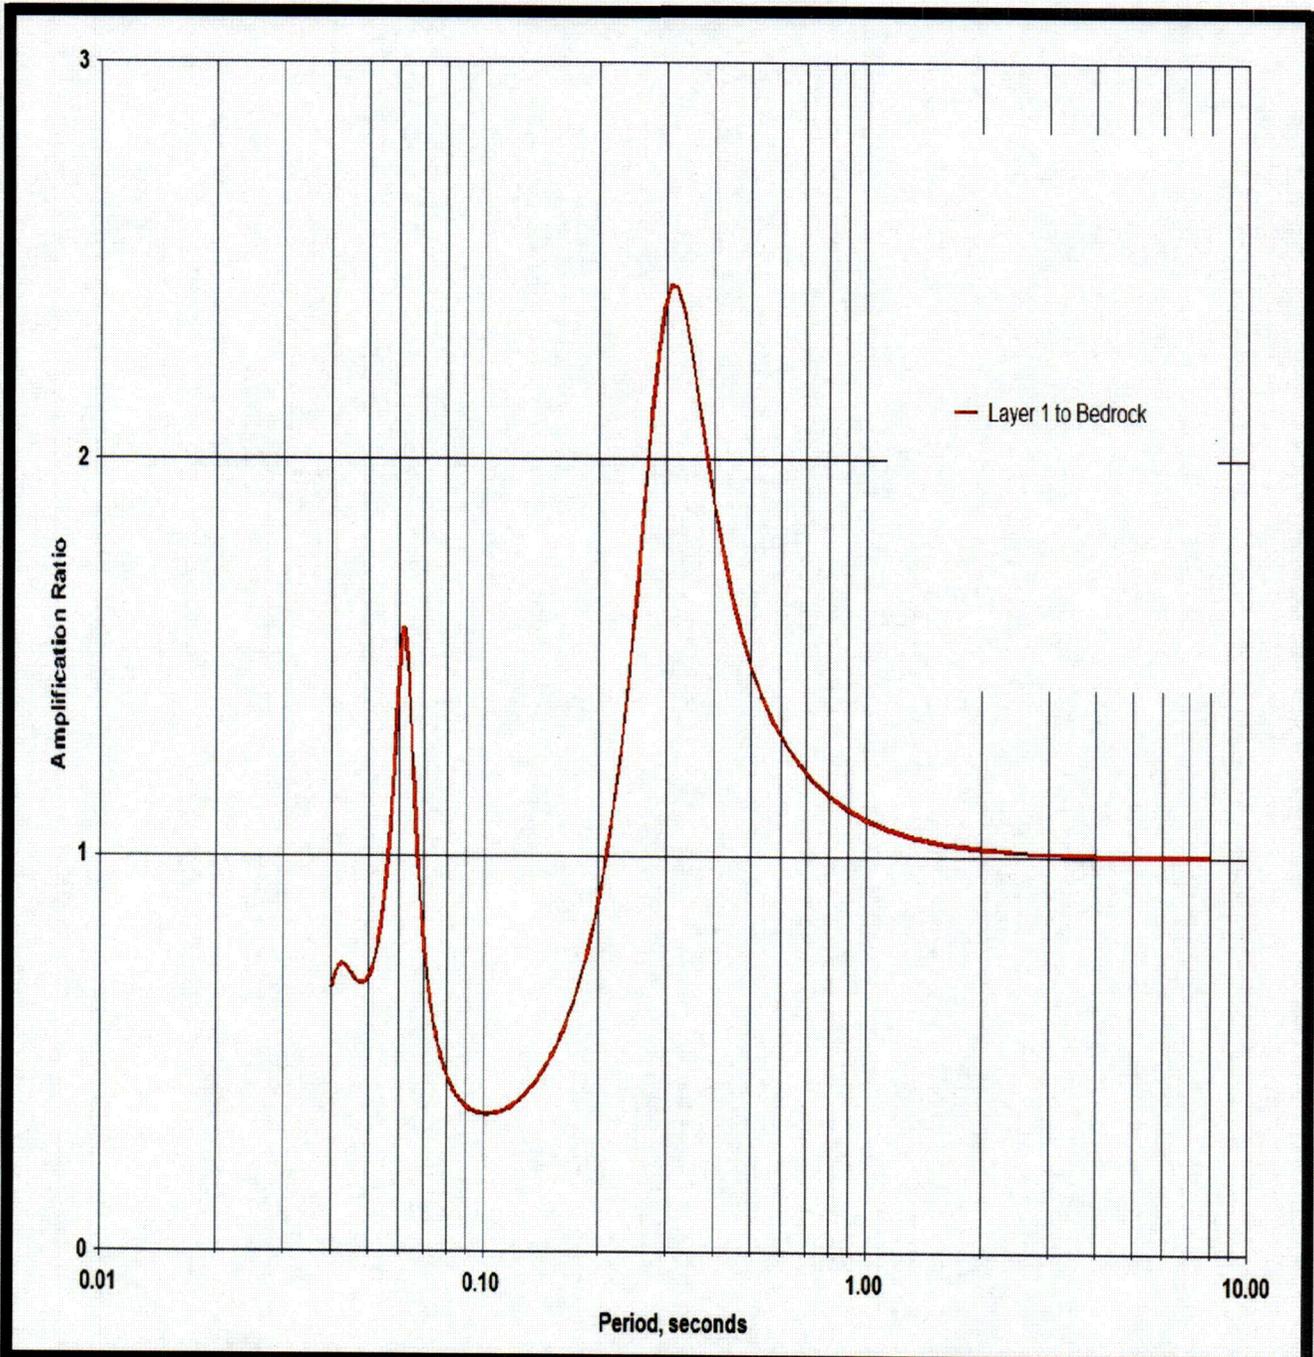


10,000 Yr Tabas Bajestan V1 Amplification Ratio – Profile 1

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 26  
ECS Project No. 14-3046  
January 2006

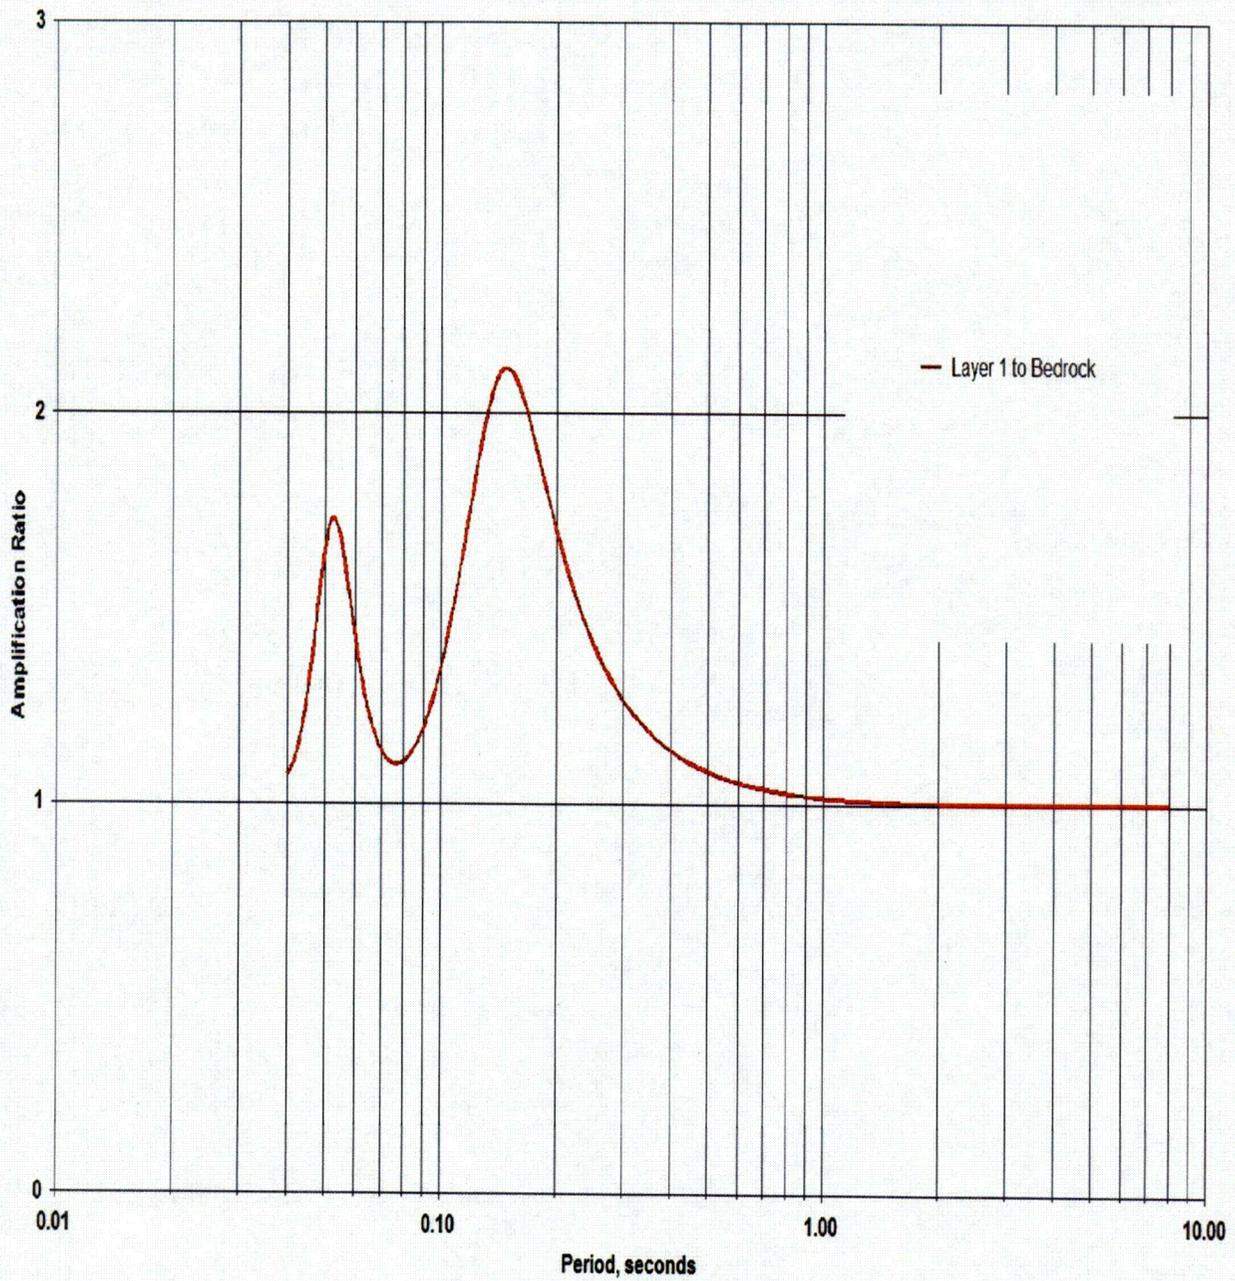


10,000 Yr Taiwan Chi Chi ILA002-V Amplification Ratio- Profile 2

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 27  
ECS Project No. 14-3046  
January 2006

C27

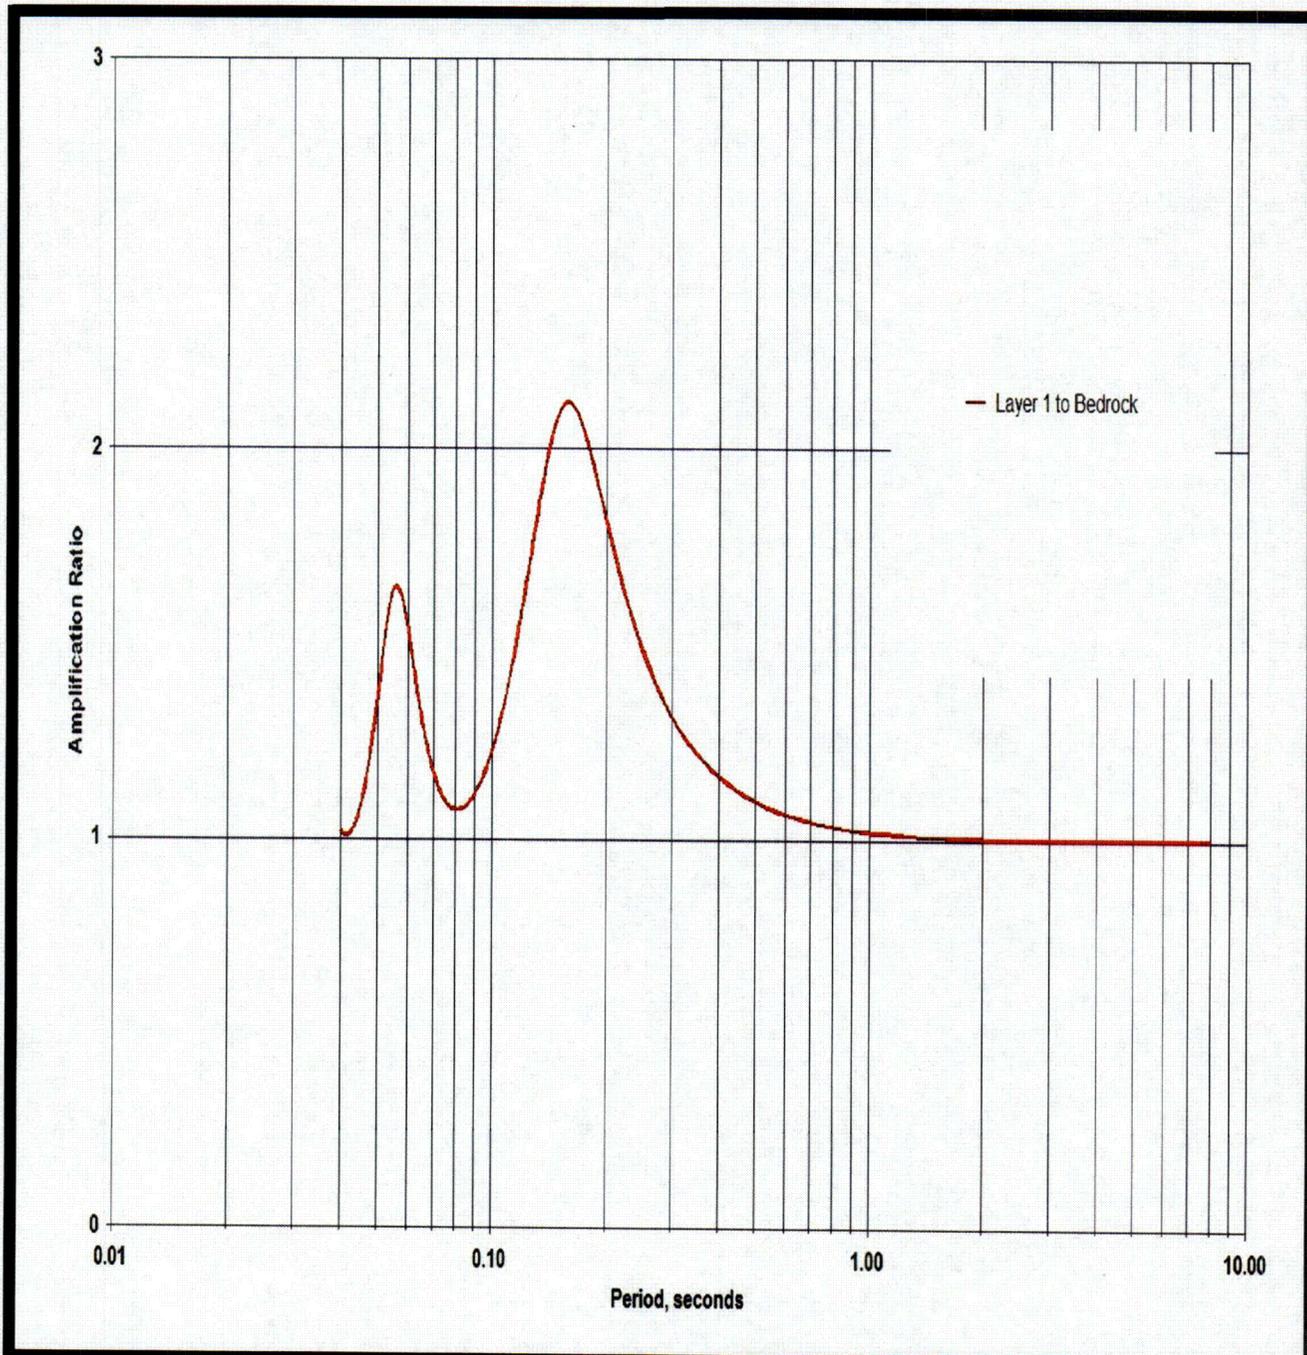

10,000 Yr Taiwan 046-W Amplification Ratio – Profile 2

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio





Figure 28  
ECS Project No. 14-3046  
January 2006

CZQ

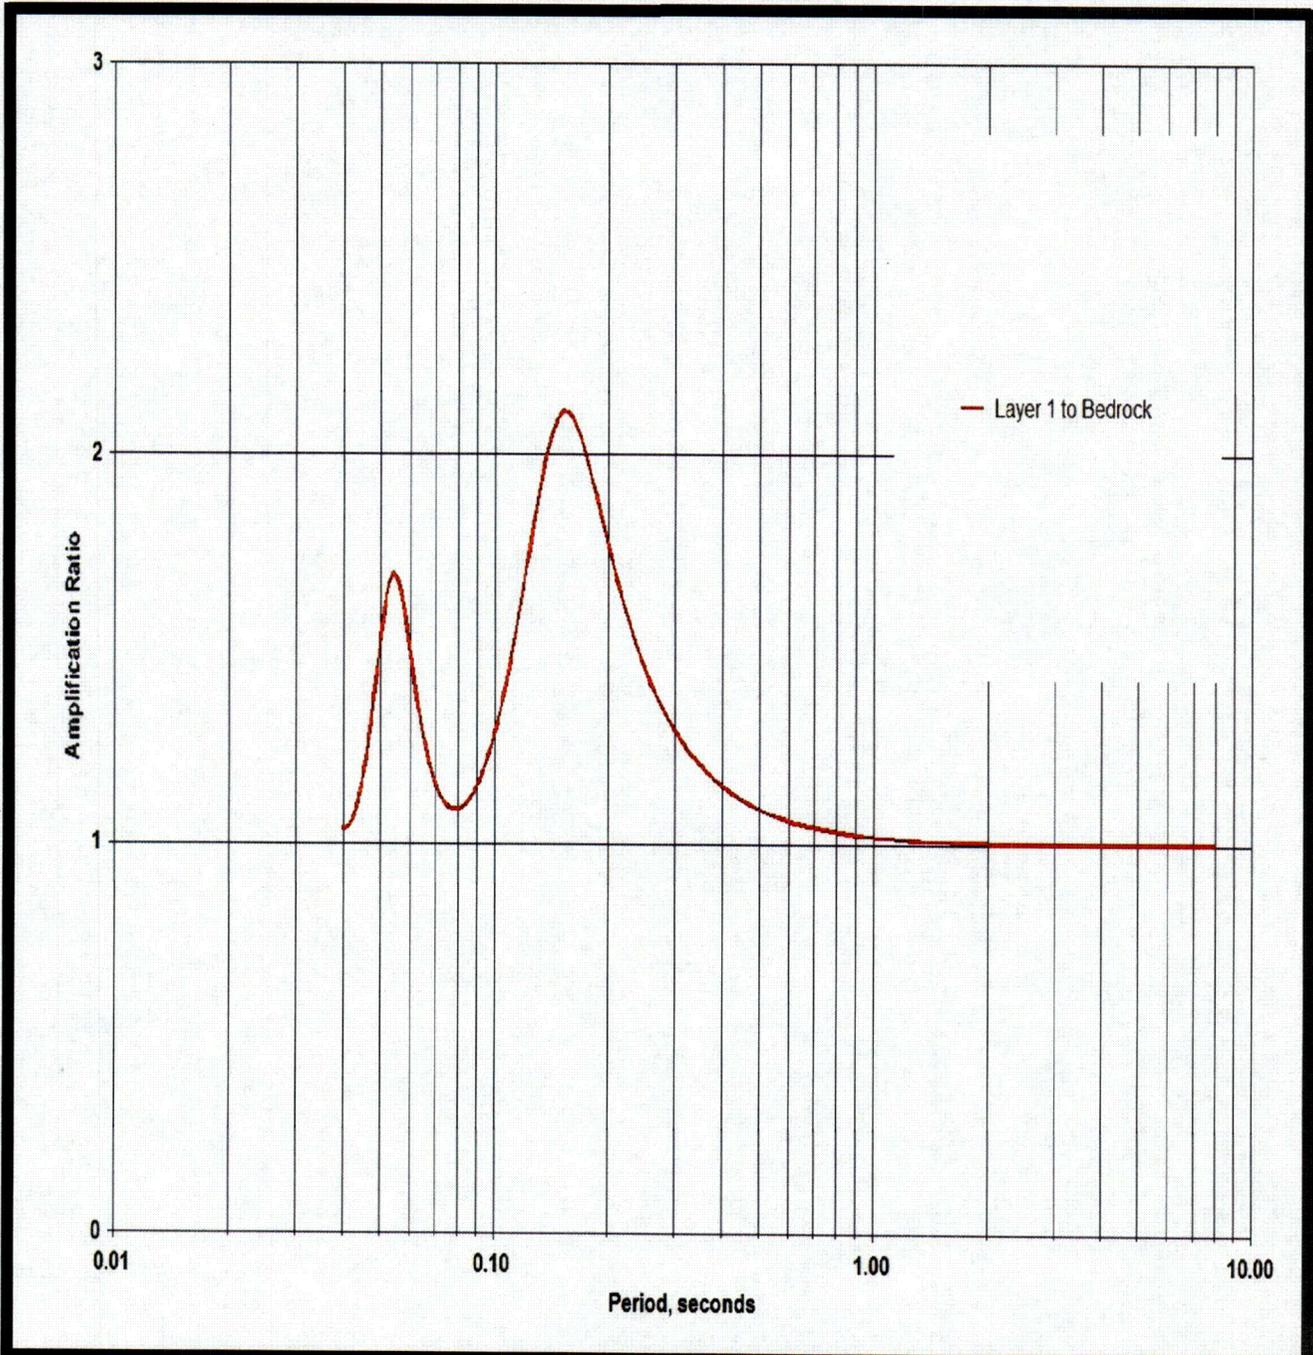


10,000 Yr Tabas Bajestan V1 Amplification Ratio – Profile 2

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 29  
ECS Project No. 14-3046  
January 2006

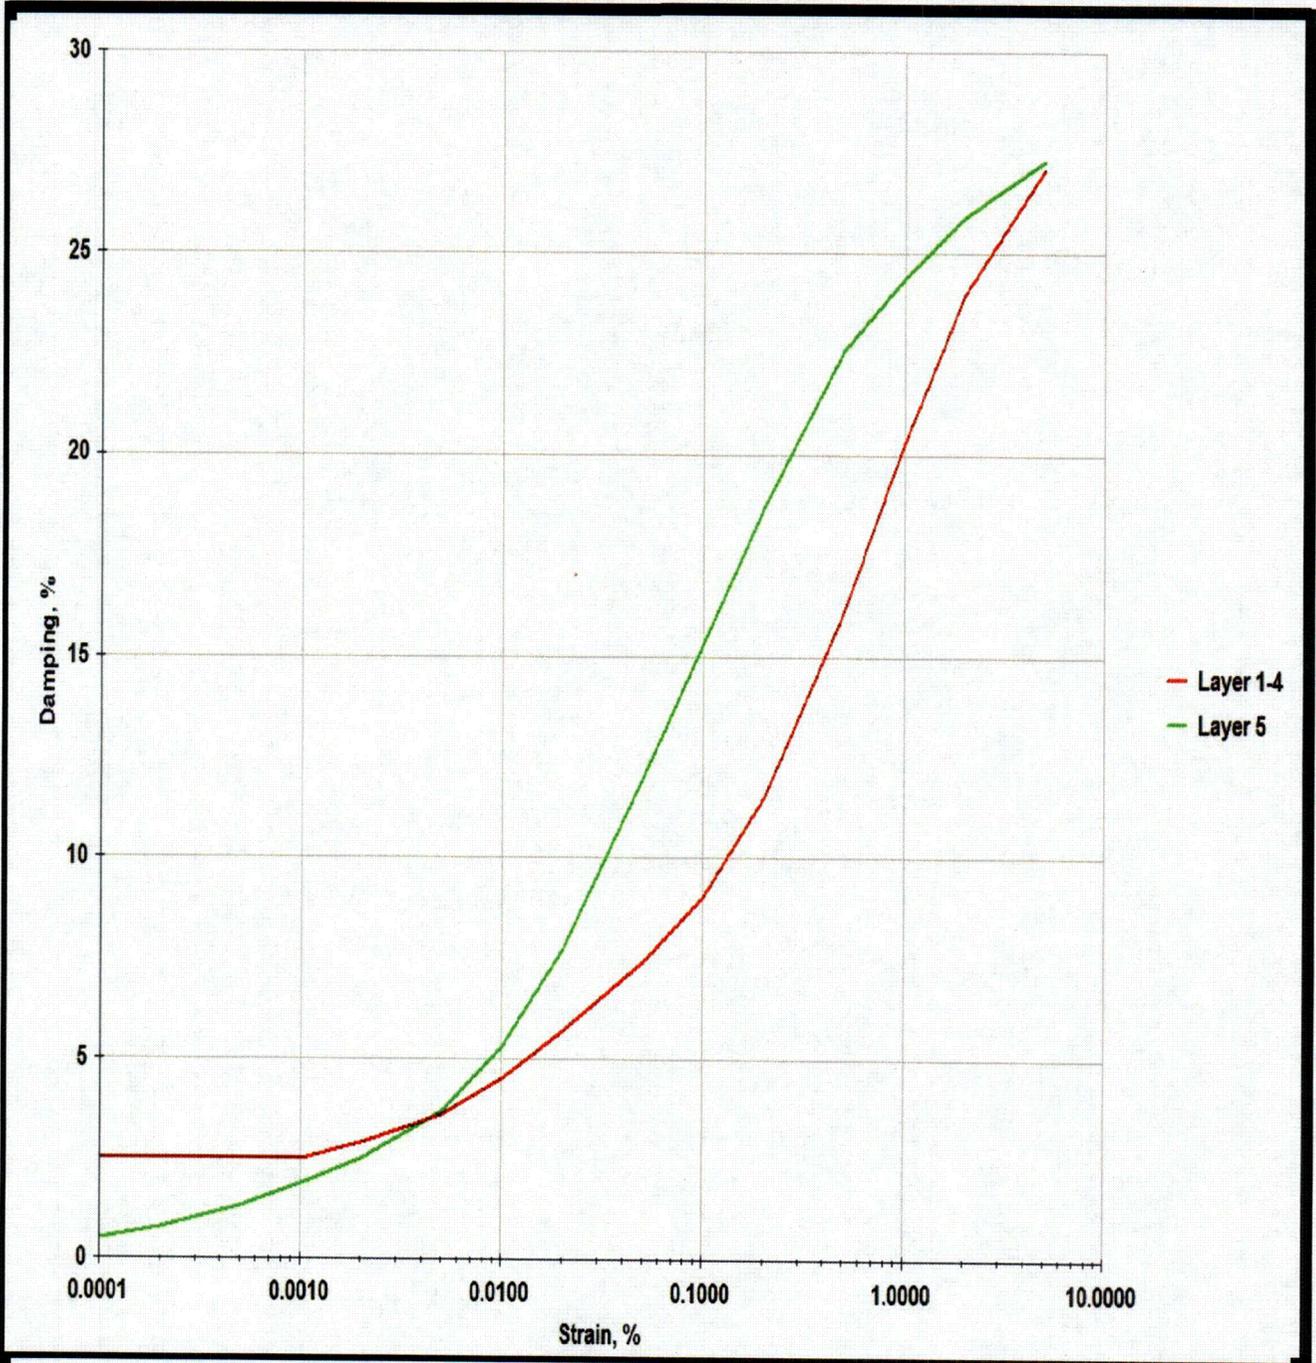


**SHAKE ANALYSIS SHEAR STRAIN VS DAMPING**

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 30  
ECS Project No. 14-3046  
January 2006

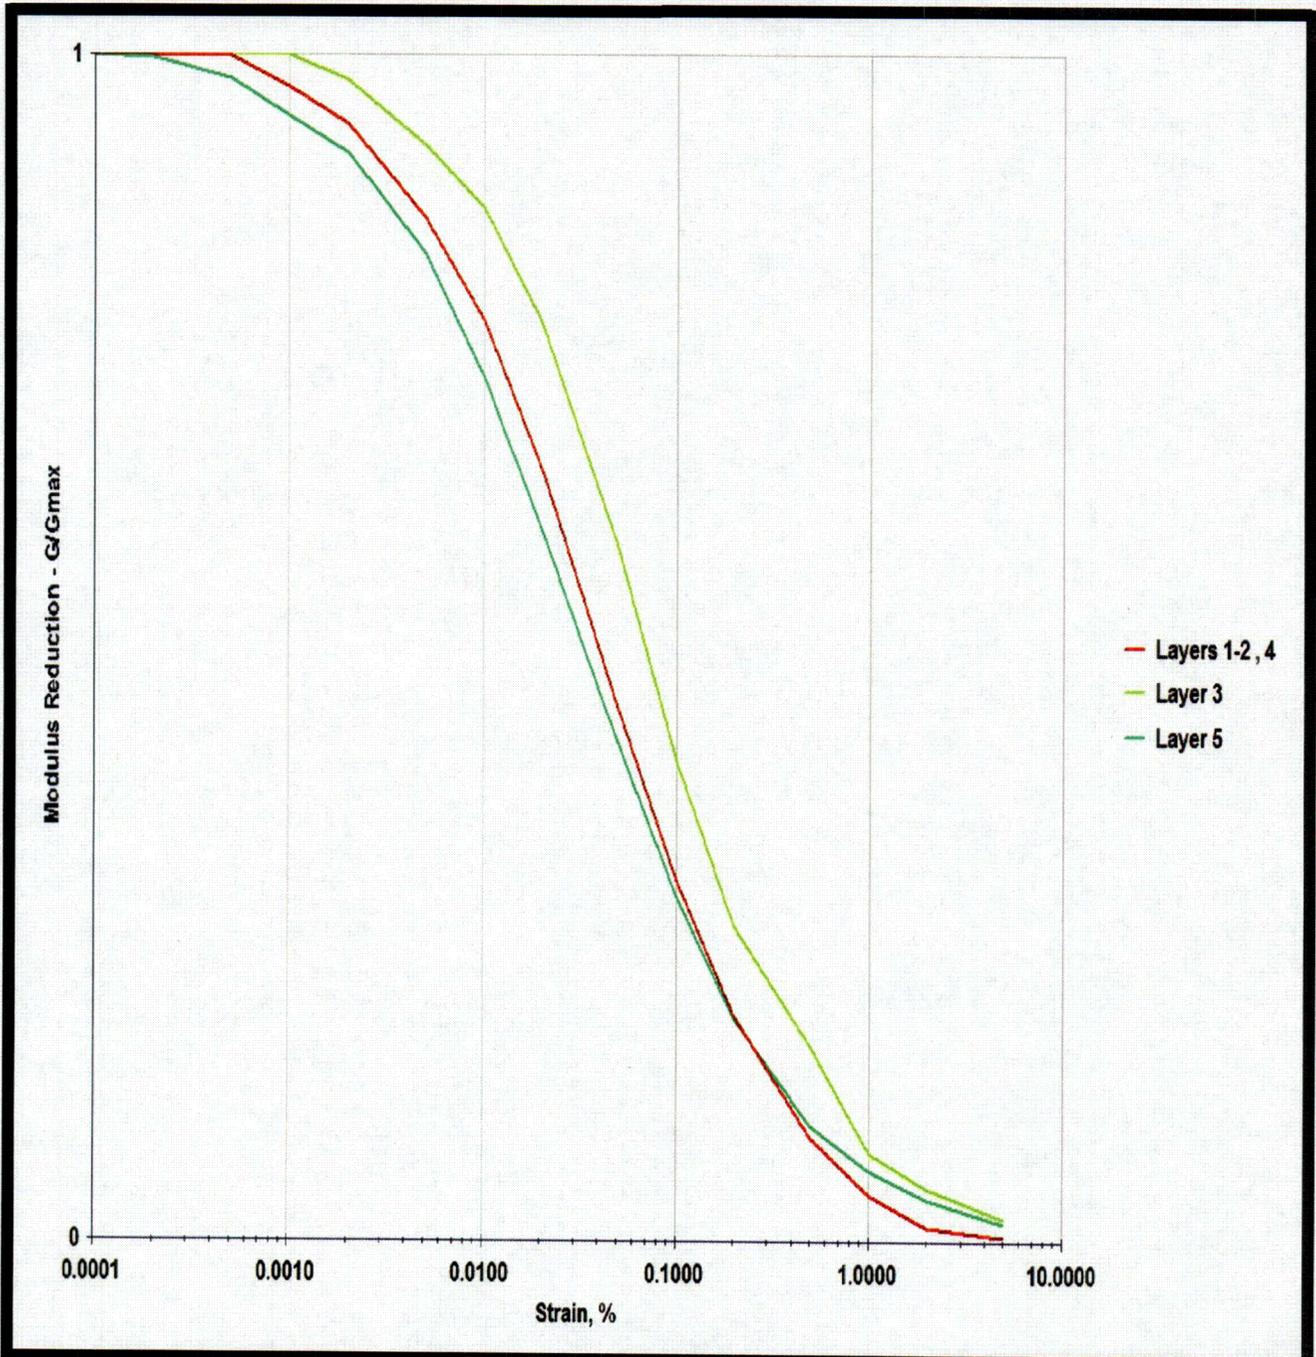


**SHAKE ANALYSIS MODULUS REDUCTION CURVES**

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 31  
ECS Project No. 14-3046  
January 2006

# 1000 YEAR RETURN PERIOD SPECTRA (5% DAMPING)

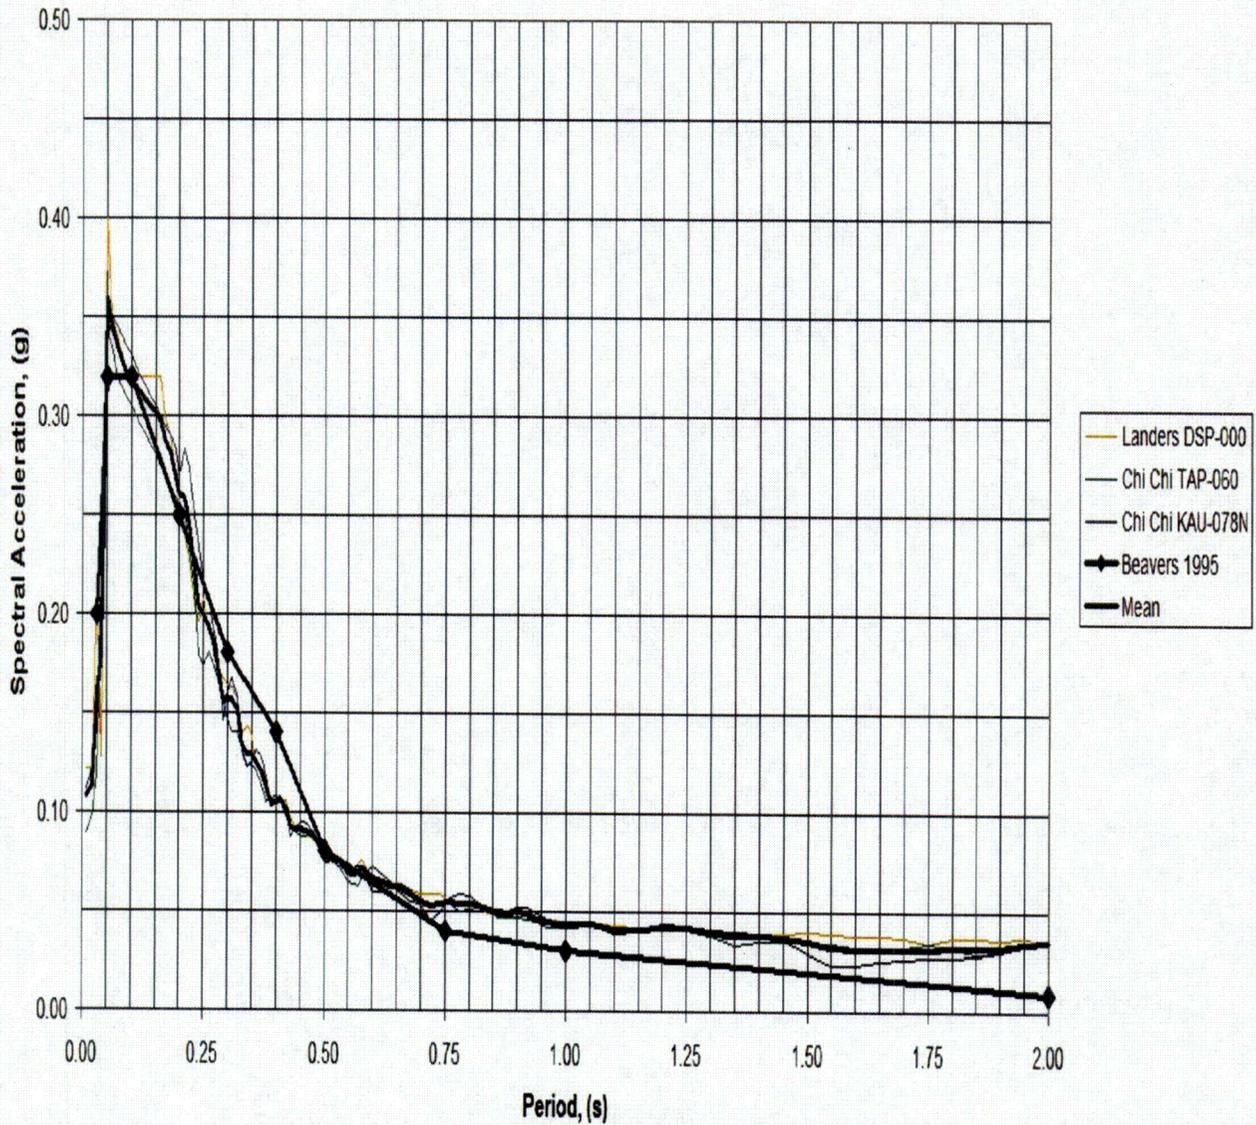


## 1000 yr Return Period Spectra Comparison

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio



Figure 32  
ECS Project No. 14-3046  
January 2006

## 100,000 Yr Return Period Spectrum (5% DAMPING)

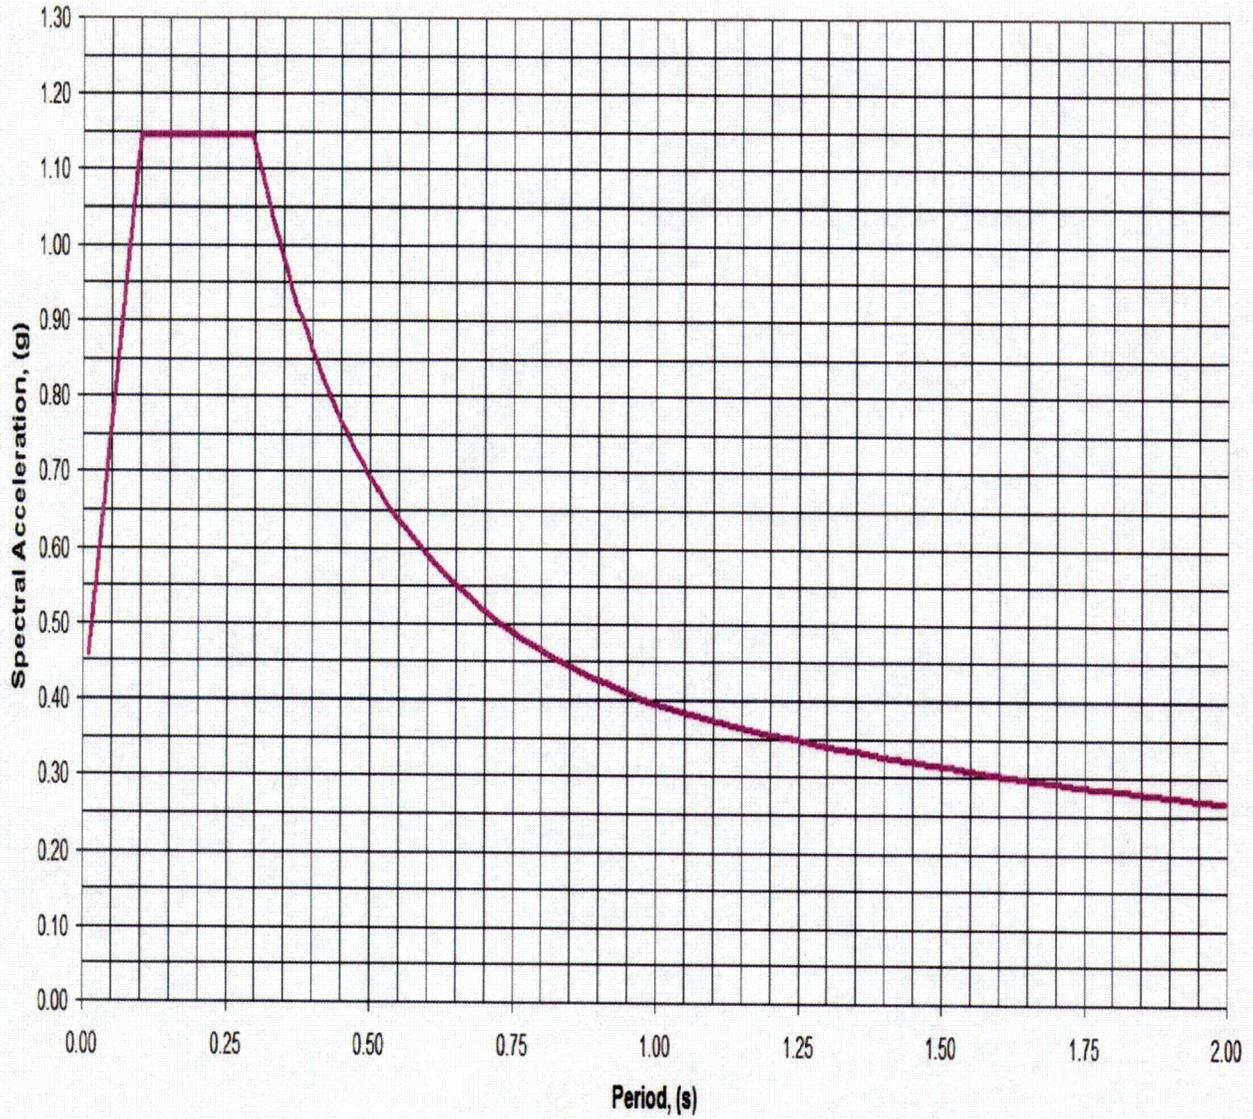

## 100,000 Yr Return Period Spectrum

USEC American Centrifuge  
Centrifuge Enrichment Plant  
Piketon, Ohio




Figure 33  
ECS Project No. 14-3046  
January 2006

**Supplemental Data**

Boring Location Diagram

Cone Penetration Test (CPT) Soundings Logs

Soil Test Borings Logs

Shear Wave Velocity Test Results

Summary of Shear Wave Velocity Testing from the 1977 LETCO Report


Laboratory Testing Summary



ECS Limited

Site: CPT-1  
Location: Am. Centrifuge

Cone: 20 Ton AD175  
Date: 10/04/05 13:11

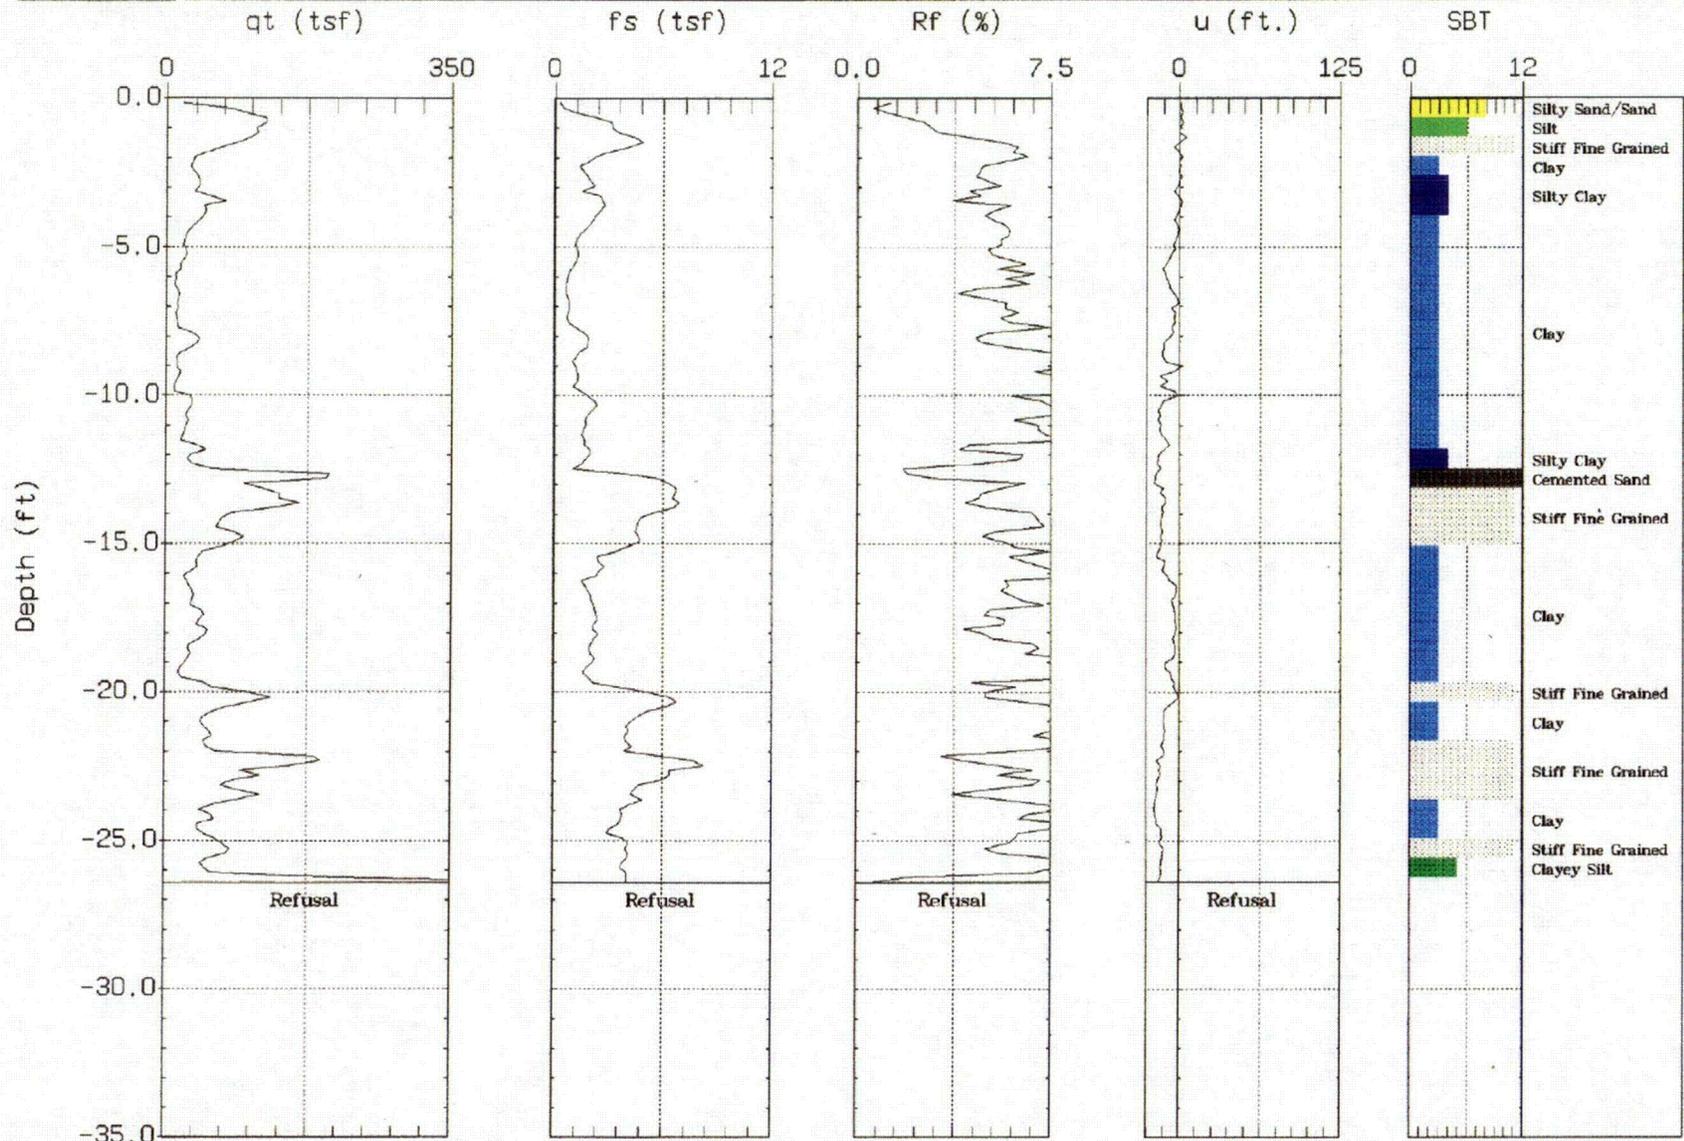

Max. Depth: 26.41 (ft)

Depth Inc: 0.164 (ft)

SBT: Soil Behavior Type (Robertson 1990)


C34



ECS Limited

Site: CPT-3  
Location: Am. Centrifuge

Cone: 20 Ton AD175  
Date: 10:04:05 13:38

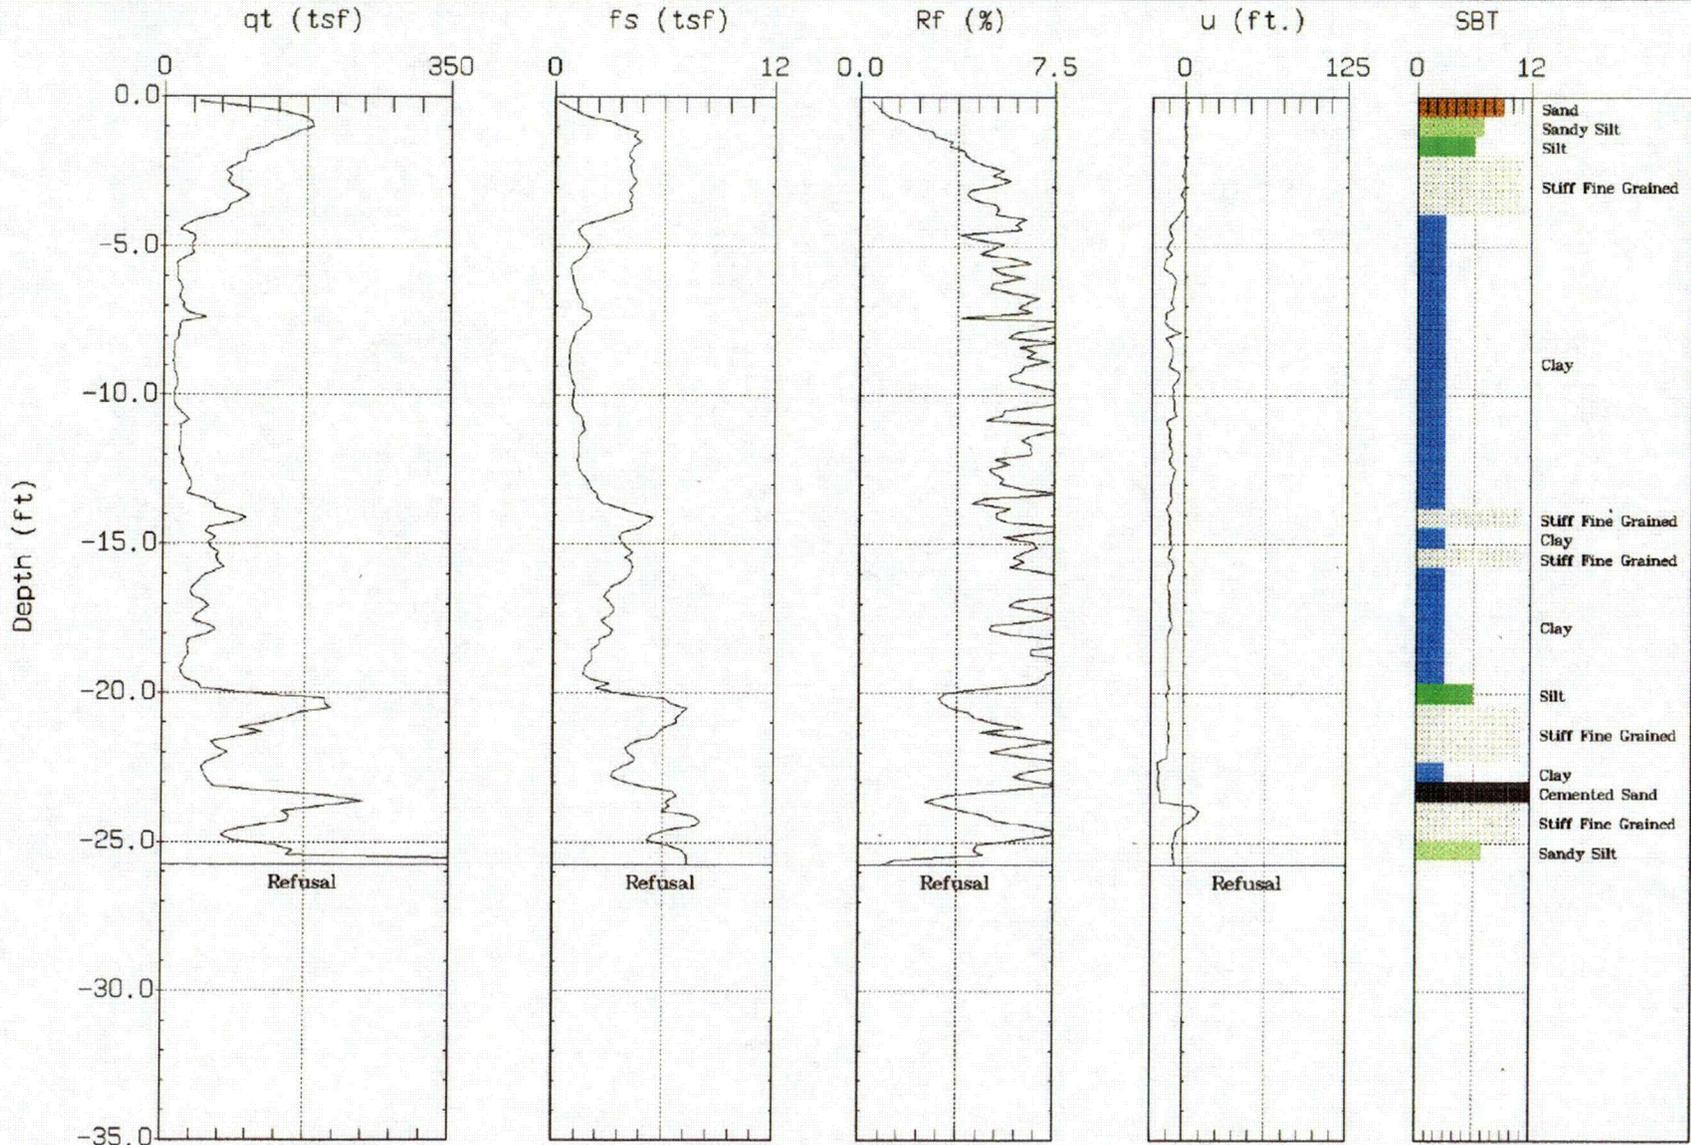

Max. Depth: 25.75 (ft)  
Depth Inc.: 0.164 (ft)


SBT: Soil Behavior Type (Robertson 1990)



ECS Limited

Site: CPT-4  
Location: Am. Centrifuge

Cone: 20 Ton AD175  
Date: 10:04:05 12:40

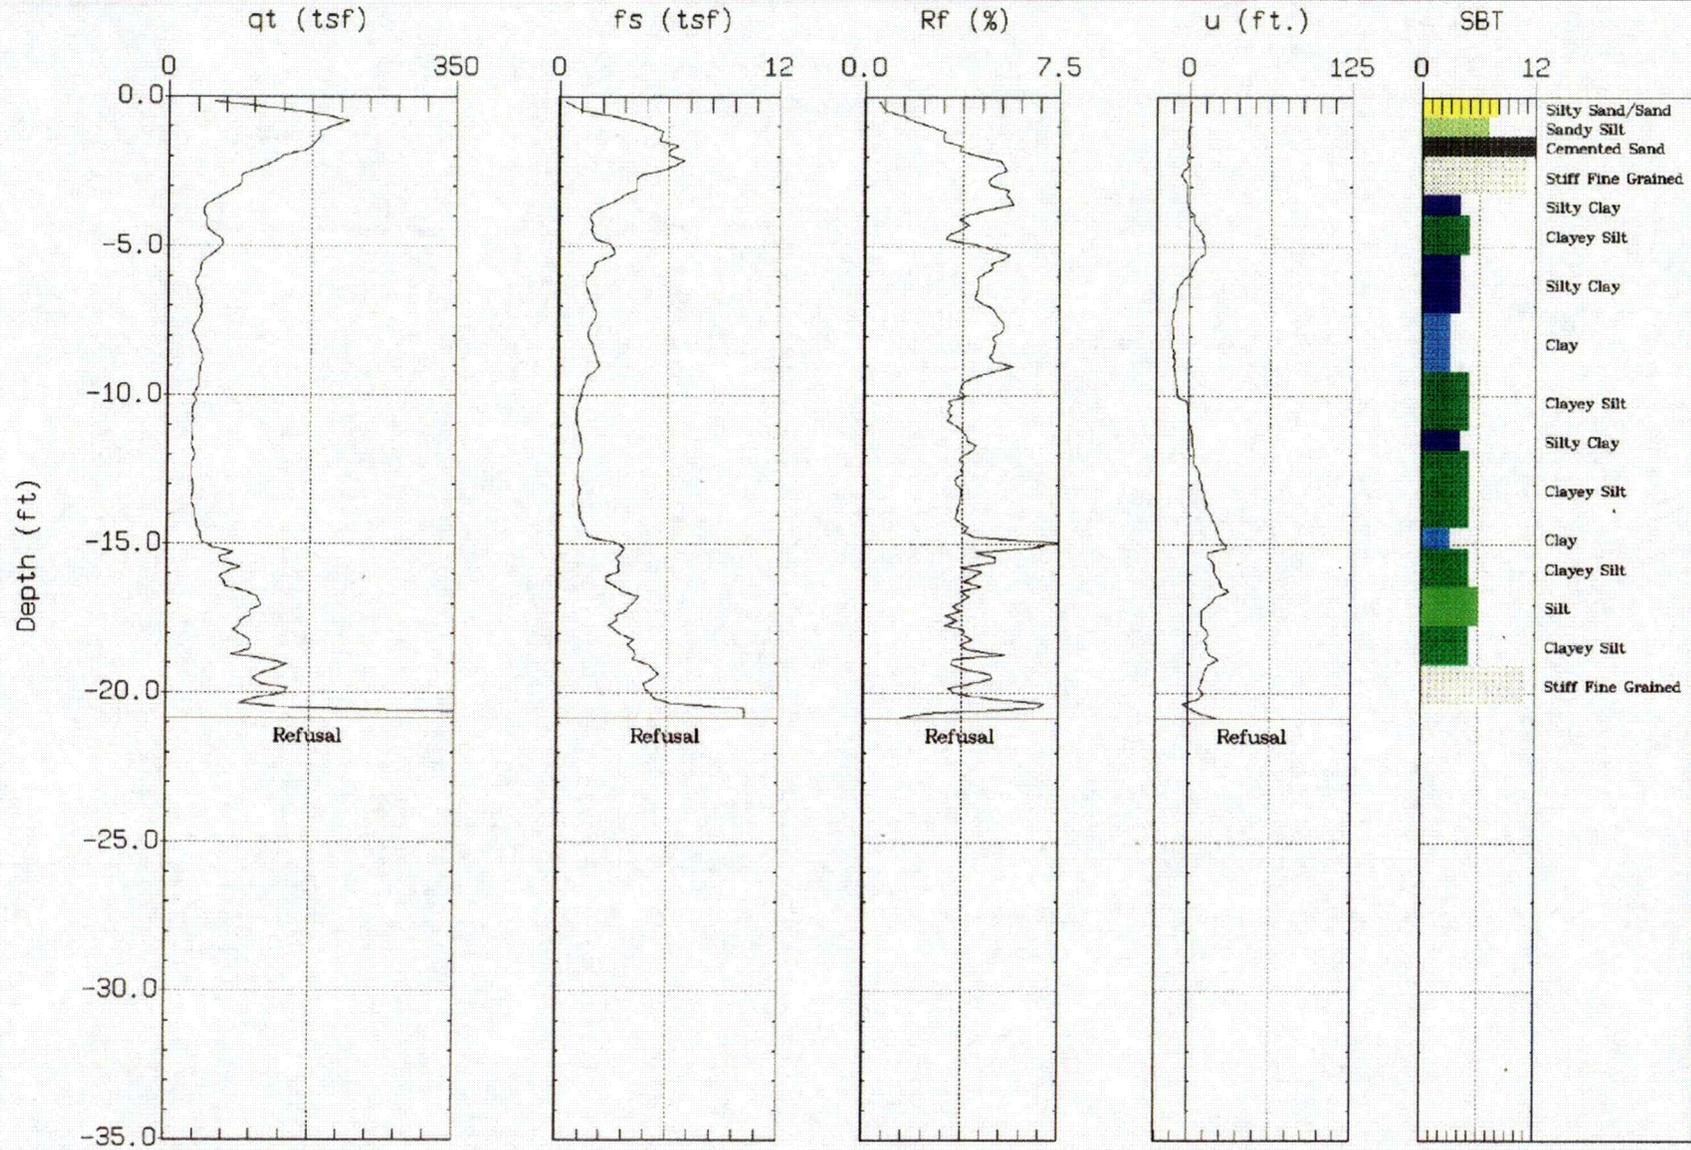




ECS Limited

Site: CPT-5  
Location: Am. Centrifuge

Cone: 20 Ton AD175  
Date: 10:04:05 12:11

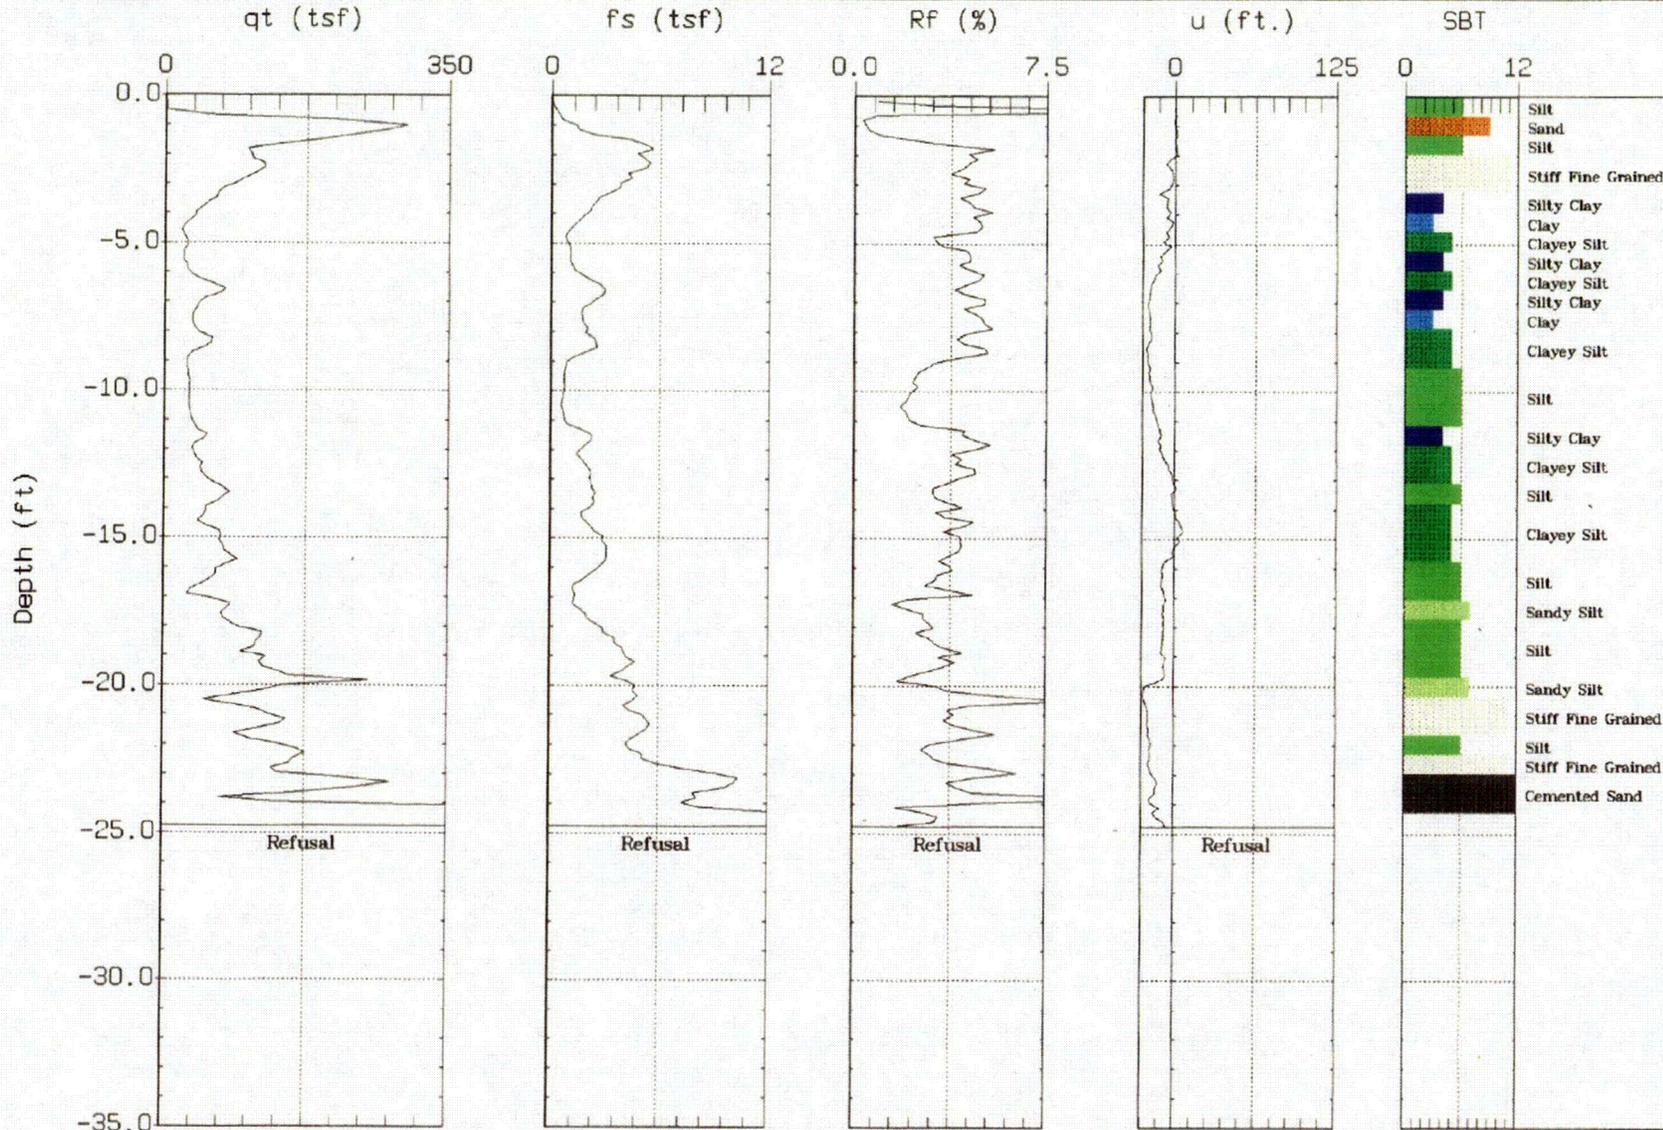

Max. Depth: 24.77 (ft)  
Depth Inc.: 0.164 (ft)


SBT: Soil Behavior Type (Robertson 1990)



ECS Limited

Site: CPT-7  
Location: Am. Centrifuge

Cone: 20 Ton AD175  
Date: 10/04/05 11:44

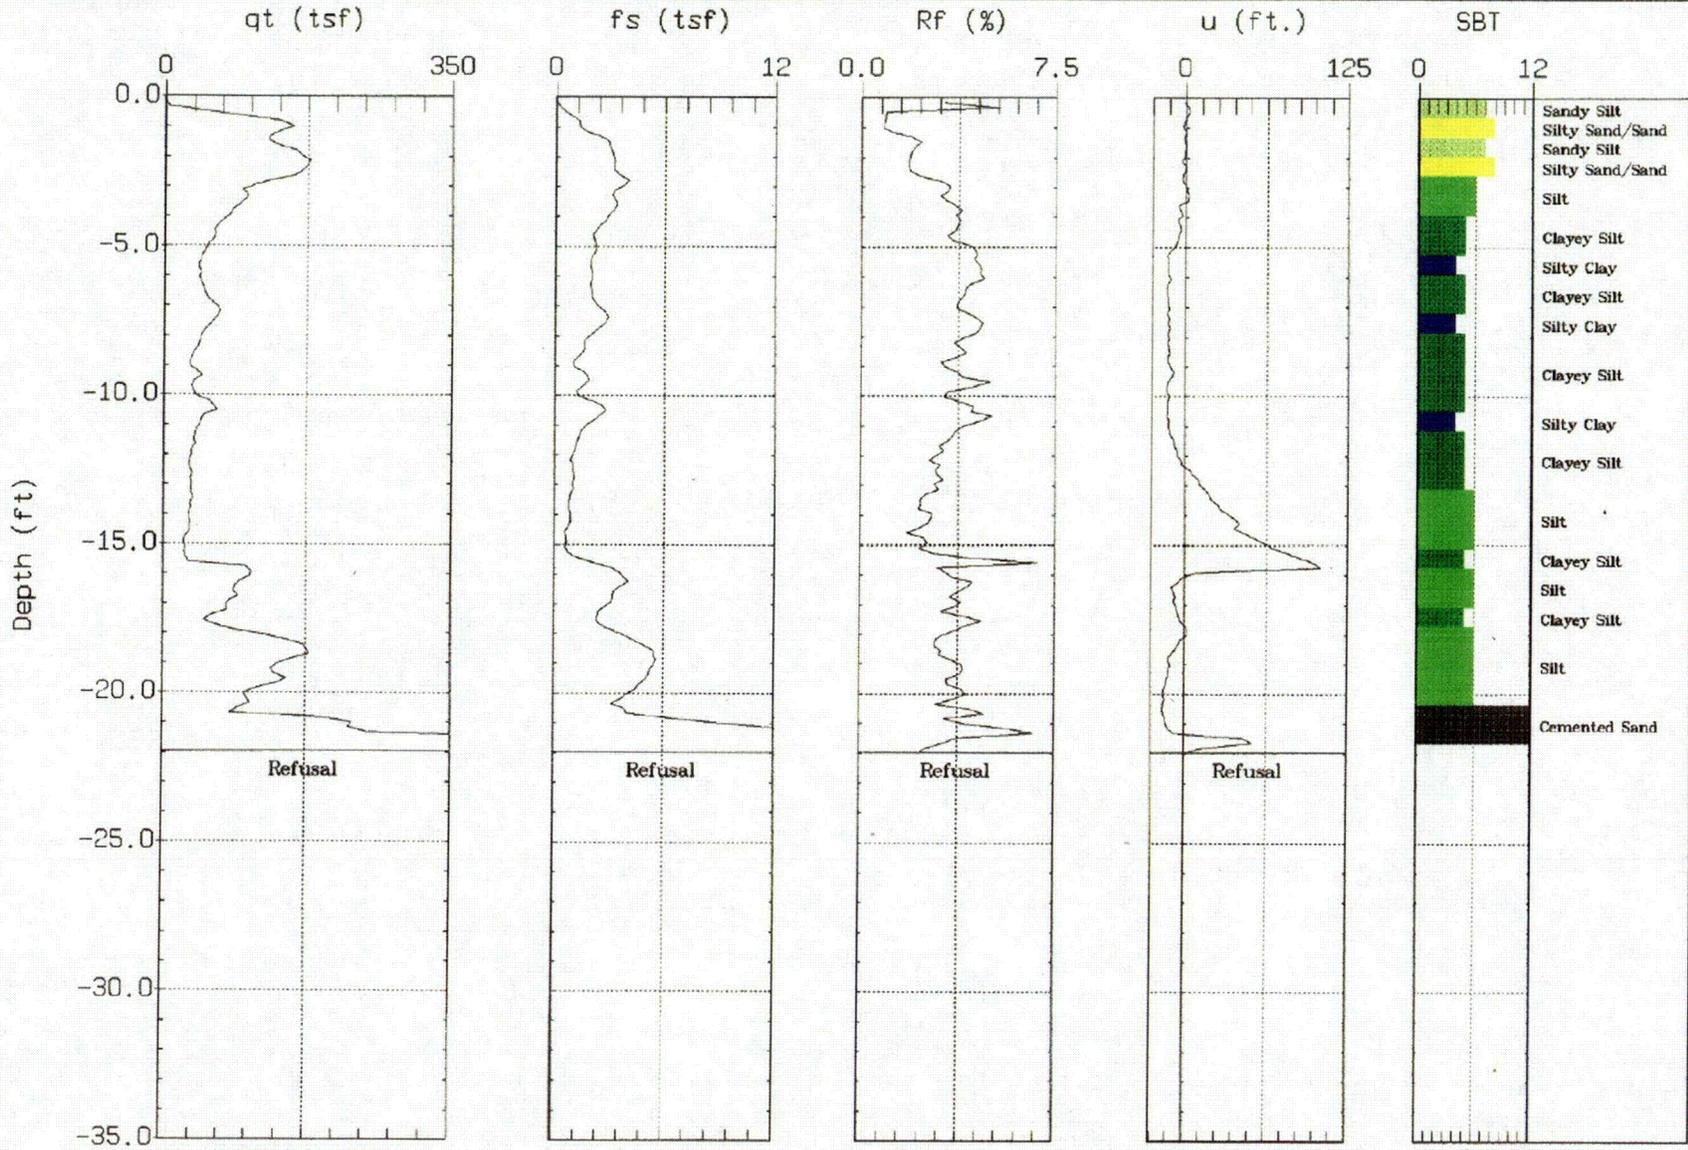

Max. Depth: 21.98 (ft)  
Depth Inc: 0.164 (ft)


SBT: Soil Behavior Type (Robertson 1990)



ECS Limited

Site: CPT-8  
Location: Am. Centrifuge

Cone: 20 Ton AD175  
Date: 10:04:05 10:59

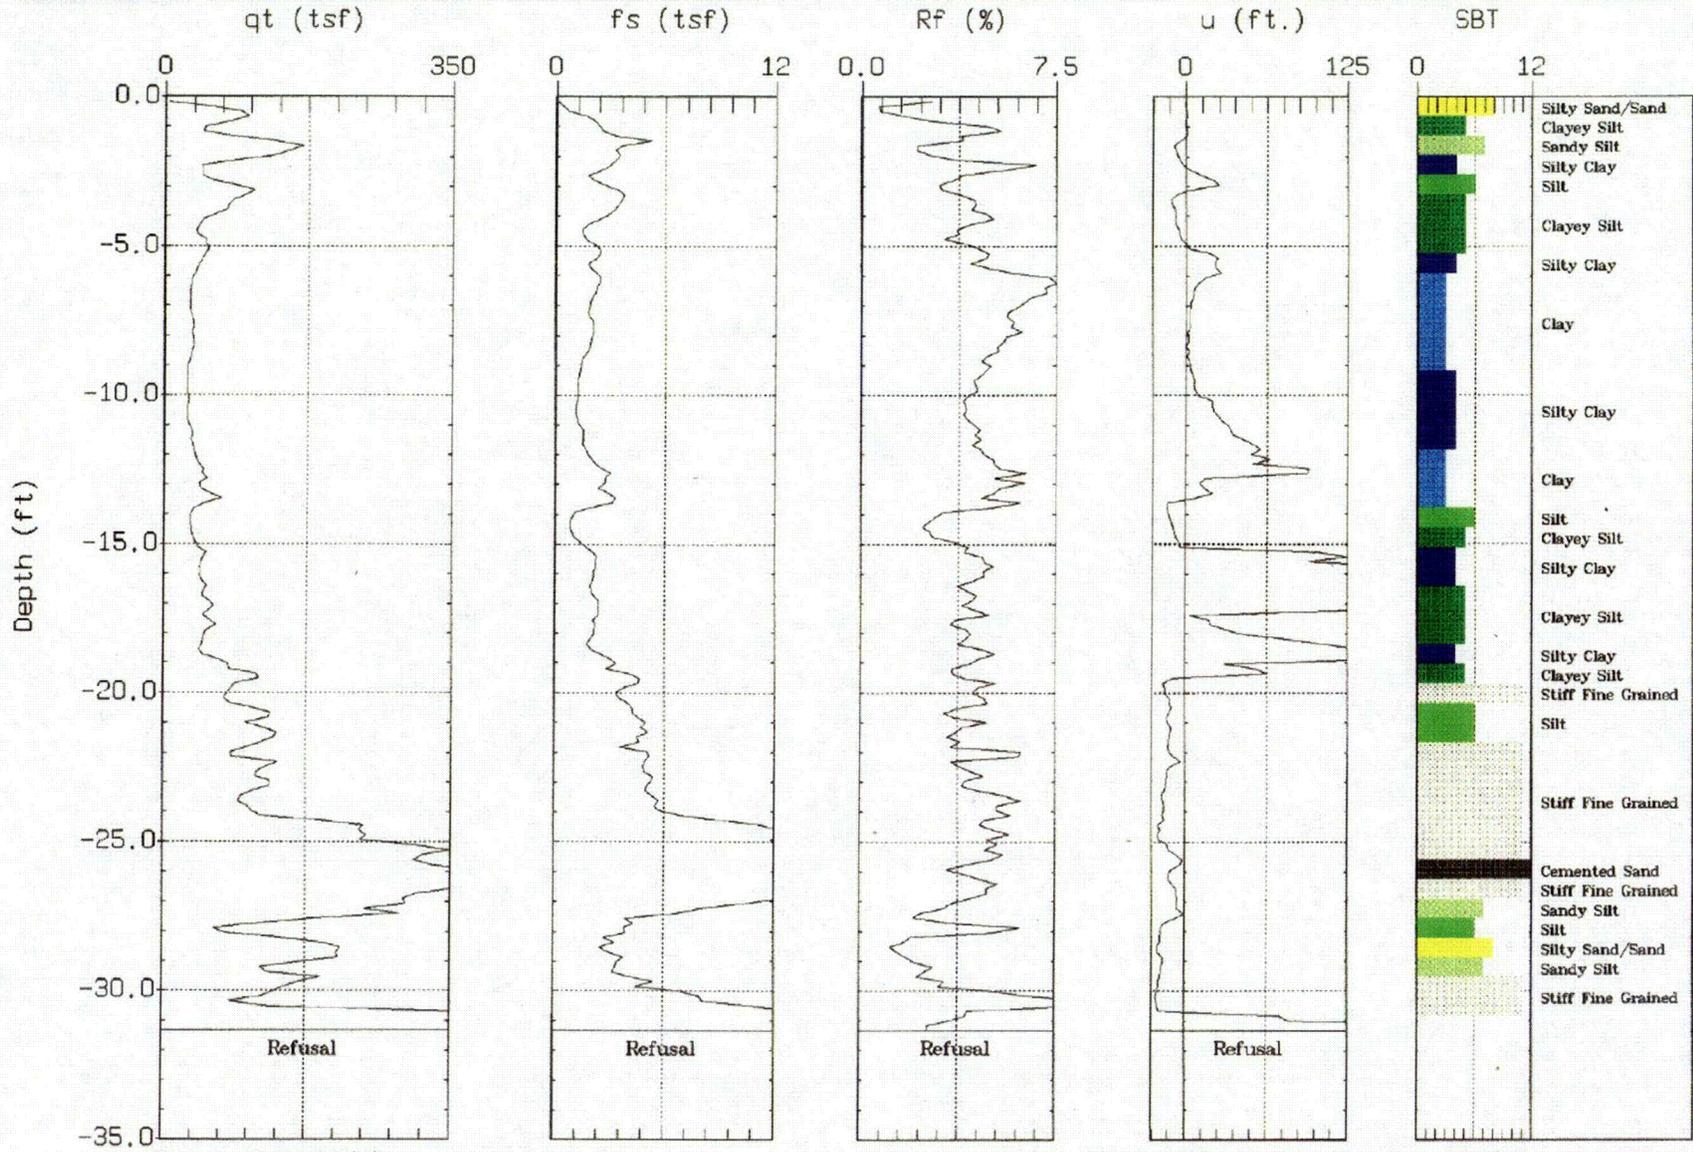

Max. Depth: 31.33 (ft)  
Depth Inc.: 0.164 (ft)


SBT: Soil Behavior Type (Robertson 1990)



ECS Limited

Site: CPT-11  
Location: Am. Centrifuge

Cone: 20 Ton AD175  
Date: 10:04:05 09:57

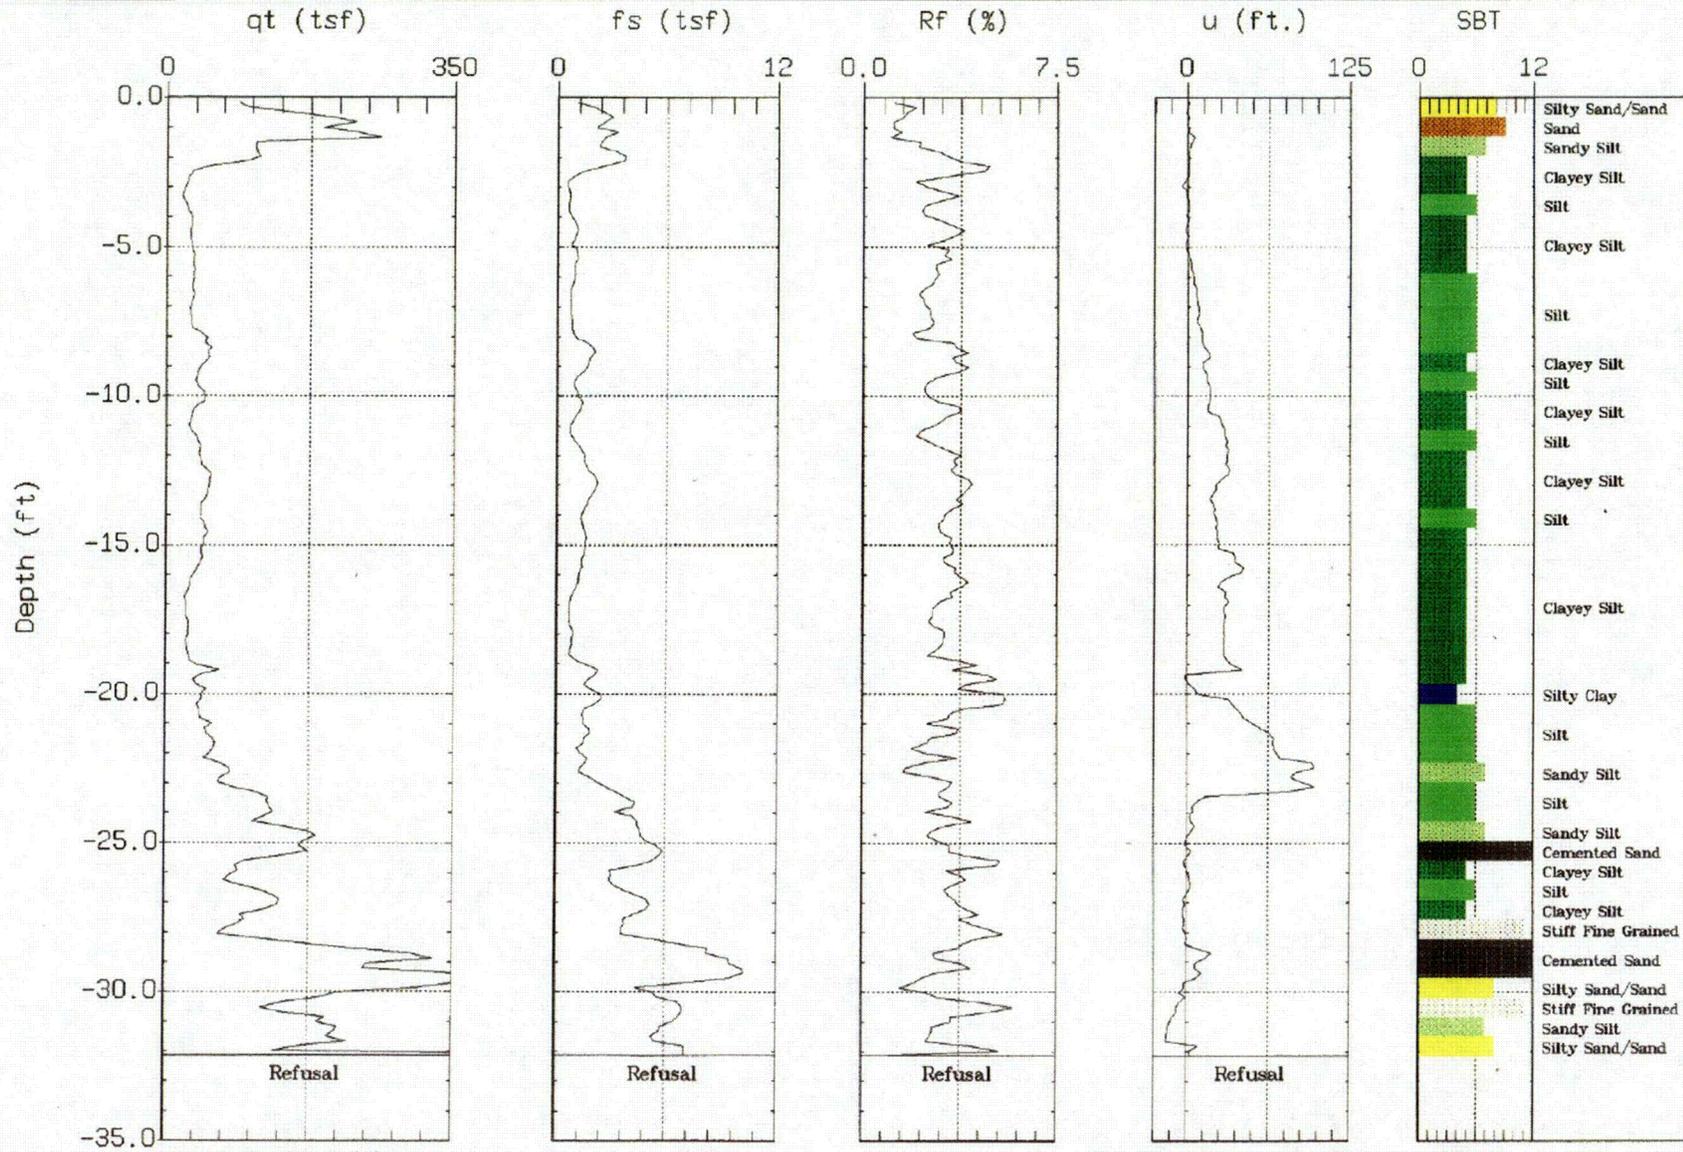

Max. Depth: 32.15 (ft)  
Depth Inc.: 0.164 (ft)

SBT: Soil Behavior Type (Robertson 1990)


C40



ECS Limited

Site: CPT-12  
Location: Am. Centrifuge

Cone: 20 Ton AD175  
Date: 10:04:05 14:20

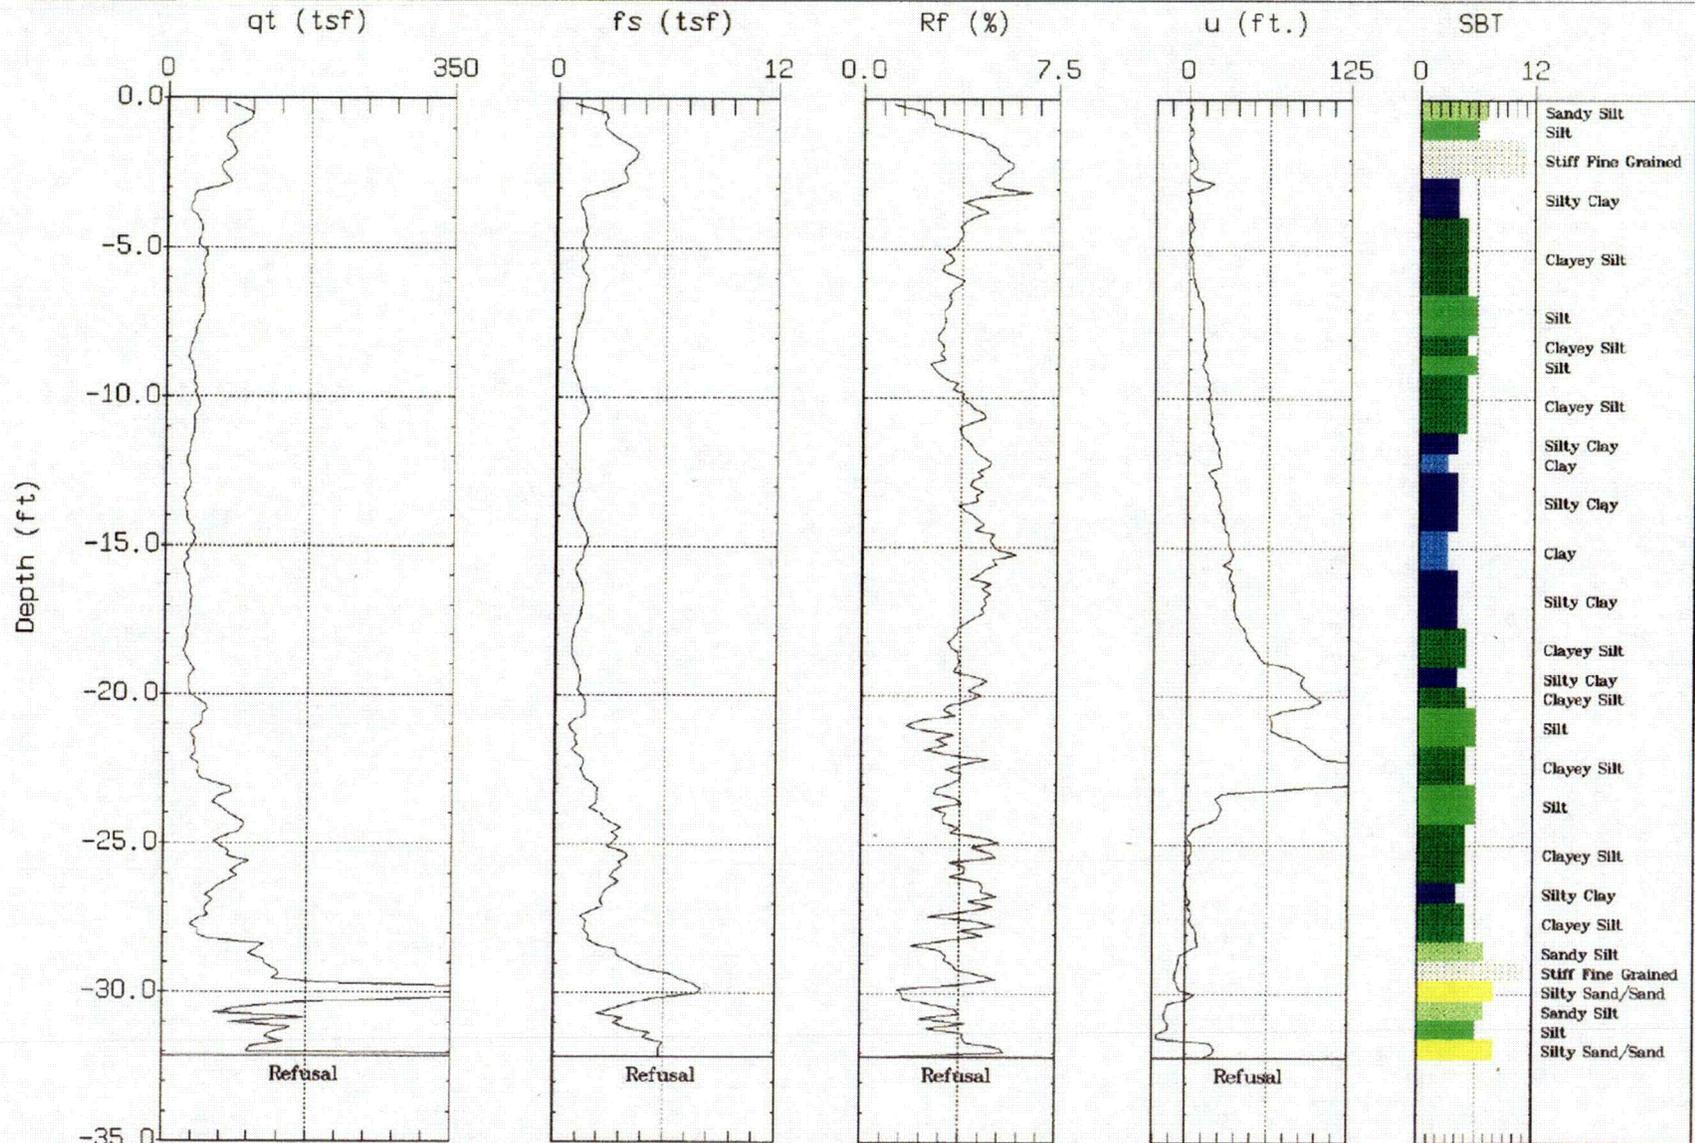


Max. Depth: 32.15 (ft)  
Depth Inc.: 0.164 (ft)

SBT: Soil Behavior Type (Robertson 1990)

CLIENT <b>FLUR DANIEL</b>	JOB # <b>14-3046</b>	BORING # <b>B-2</b>	SHEET <b>1 OF 1</b>	<b>ECS</b> LLP CAROLINAS
PROJECT NAME <b>USEC AMERICAN CENTRIFUGE</b>	ARCHITECT-ENGINEER <b>FLUR DANIEL</b>			


SITE LOCATION  
**PIKETON, OHIO**

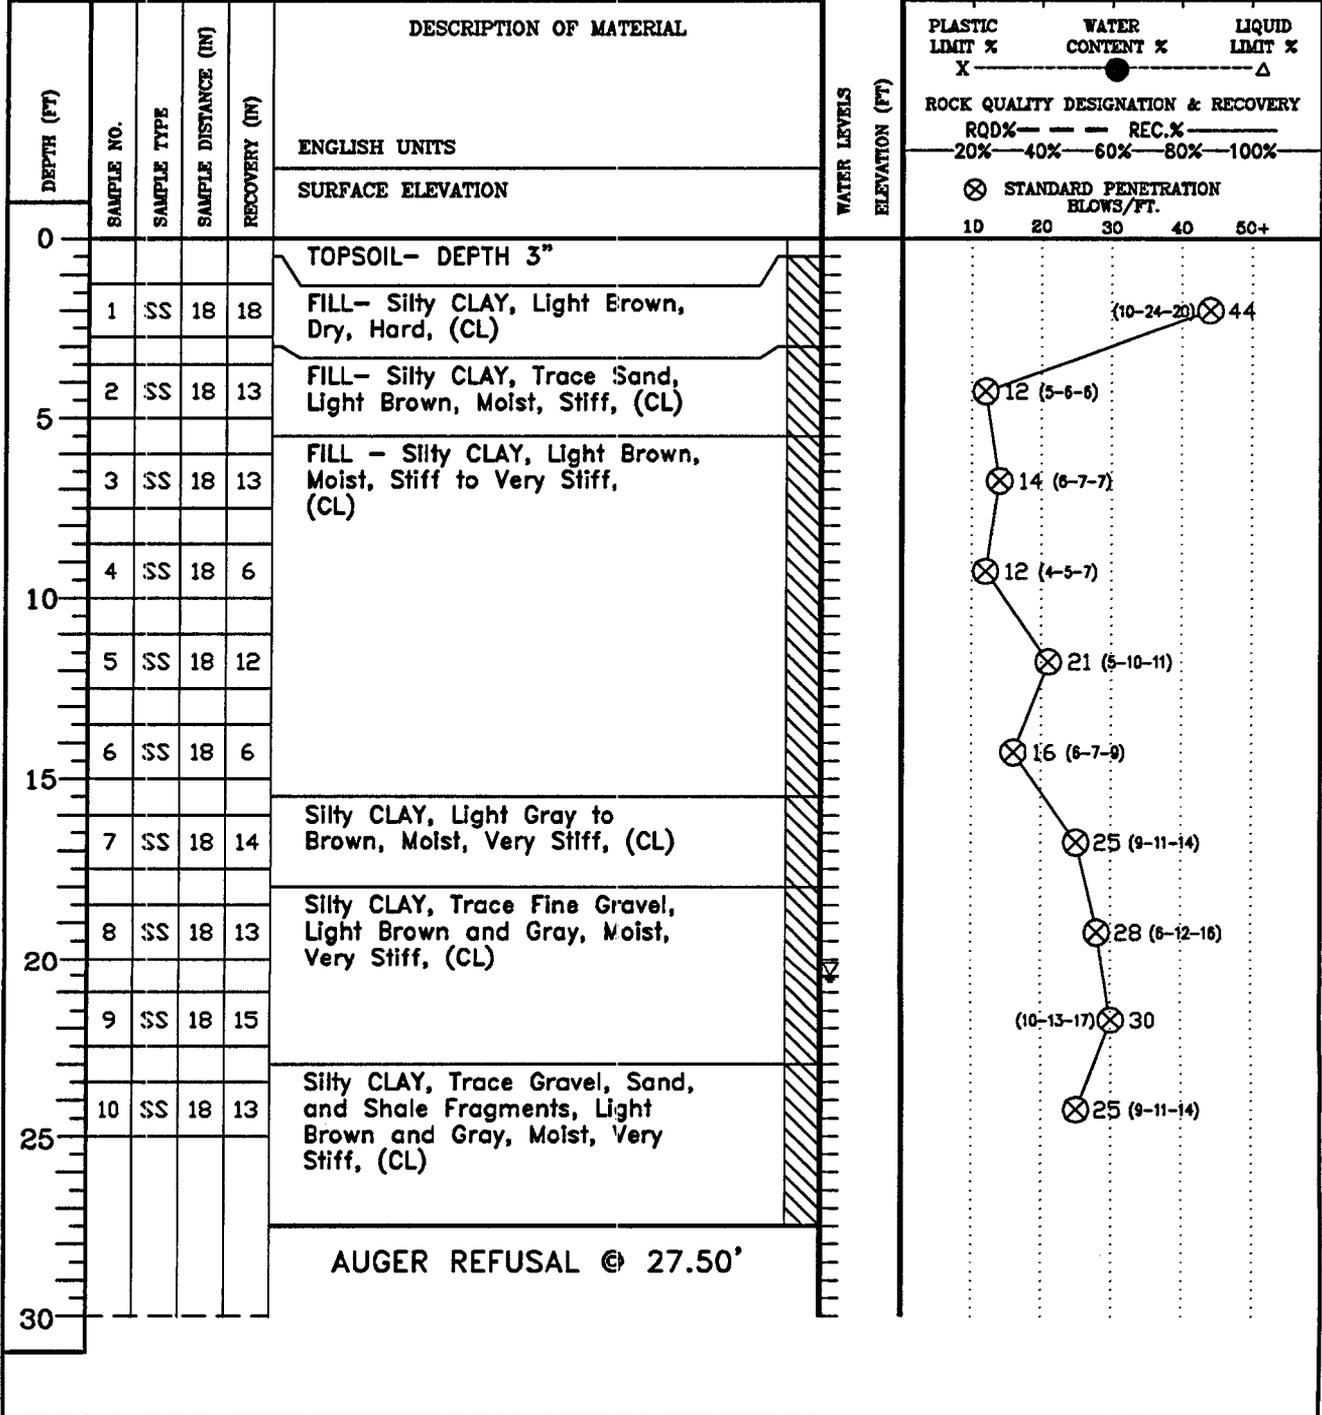

THE STRATIFICATION LINES REPRESENT THE APPROXIMATE BOUNDARY LINES BETWEEN SOIL TYPES IN-SITU THE TRANSITION MAY BE GRADUAL

▽WL 20.5	WS OR (D)	BORING STARTED	10/4/05	
▽WL(AB)	▽WL(AC)	BORING COMPLETED	10/4/05	CAVE IN DEPTH ●
▽WL		RIG	FOREMAN	DRILLING METHOD


CLIENT <b>FLUR DANIEL</b>	JOB # 14-3046	BORING # B-6	SHEET 1 OF 1	<b>ECS</b> LLP CAROLINAS
PROJECT NAME <b>USEC AMERICAN CENTRIFUGE</b>	ARCHITECT-ENGINEER <b>FLUR DANIEL</b>			

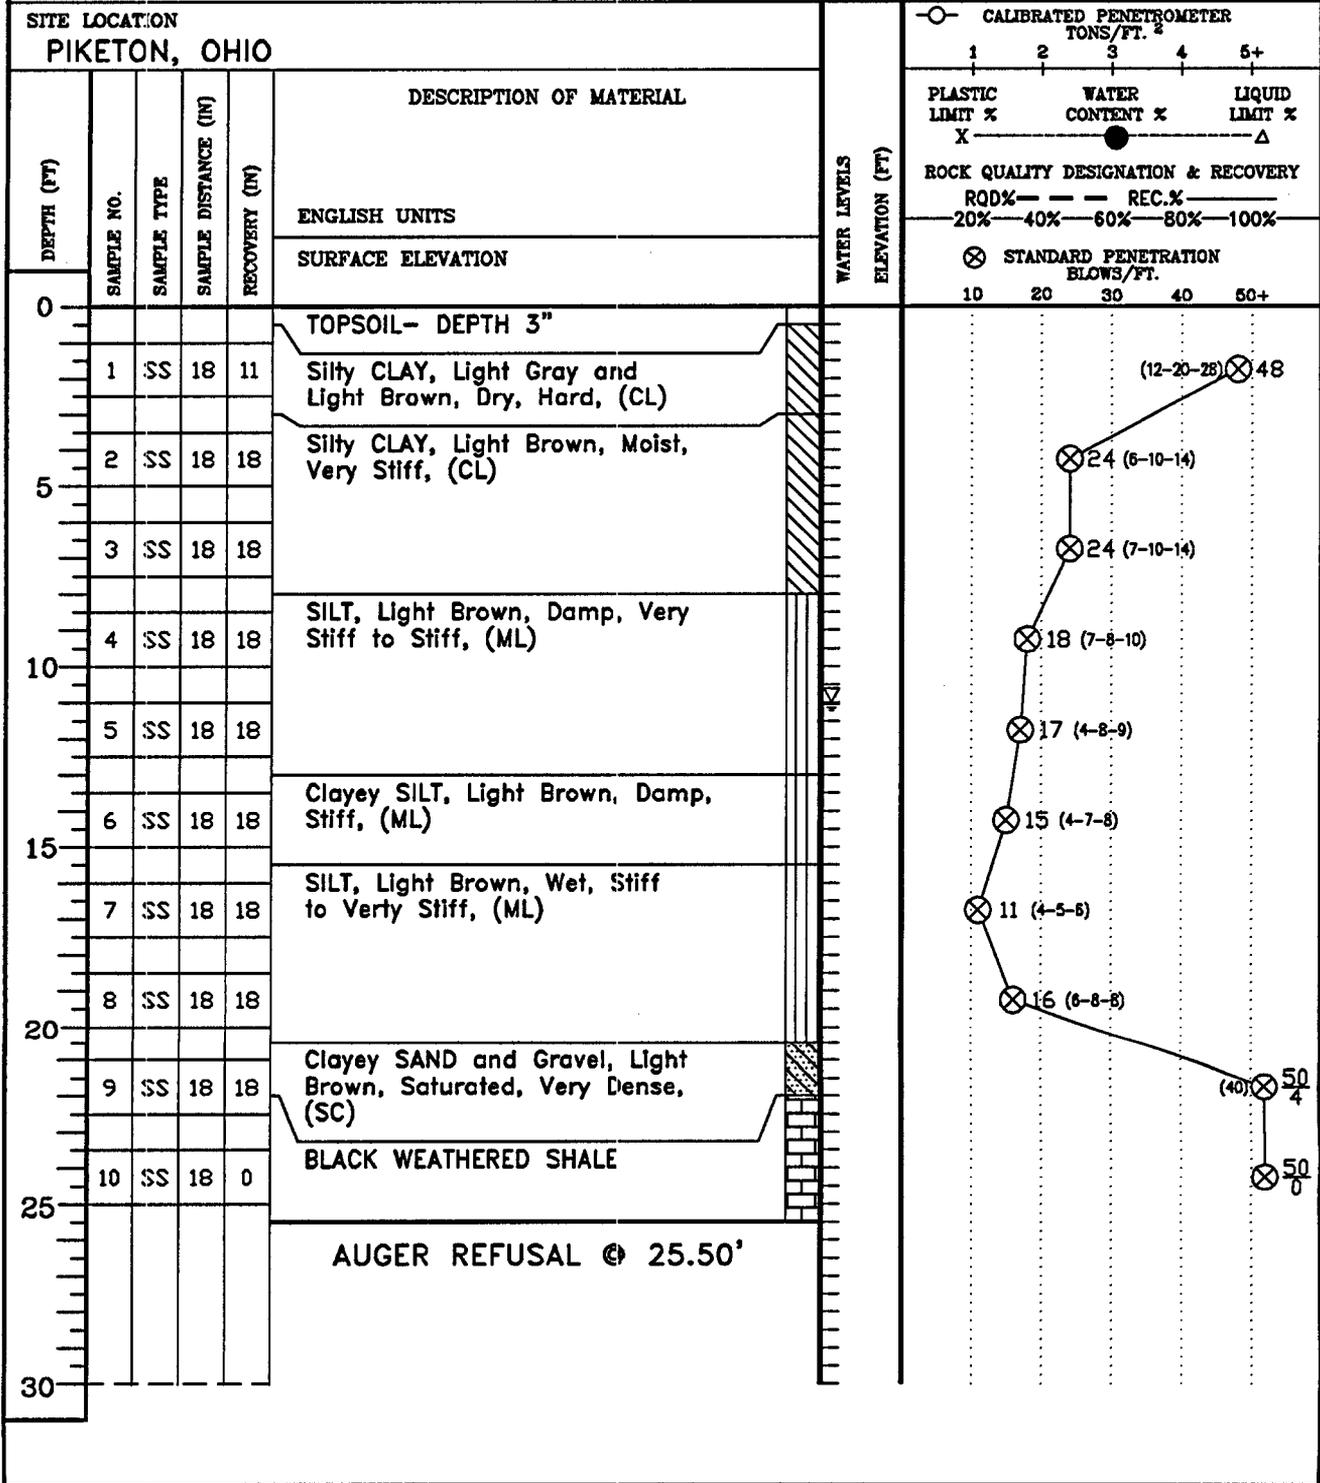

THE STRATIFICATION LINES REPRESENT THE APPROXIMATE BOUNDARY LINES BETWEEN SOIL TYPES IN-SITU THE TRANSITION MAY BE GRADUAL

▽WL 11	WS OR (M)	BORING STARTED	10/3/05	
▽WL(AB)	▽WL(AC)	BORING COMPLETED	10/3/05	CAVE IN DEPTH @
▽WL		RIG B-61	FOREMAN	DRILLING METHOD

CLIENT <b>FLUOR DANIEL</b>	JOB # 14-3046	BORING # B-9	SHEET 1 OF 2	<b>ECS</b> LLP CAROLINAS
PROJECT NAME <b>USEC AMERICAN CENTRIFUGE</b>	ARCHITECT-ENGINEER <b>FLUOR DANIEL</b>			

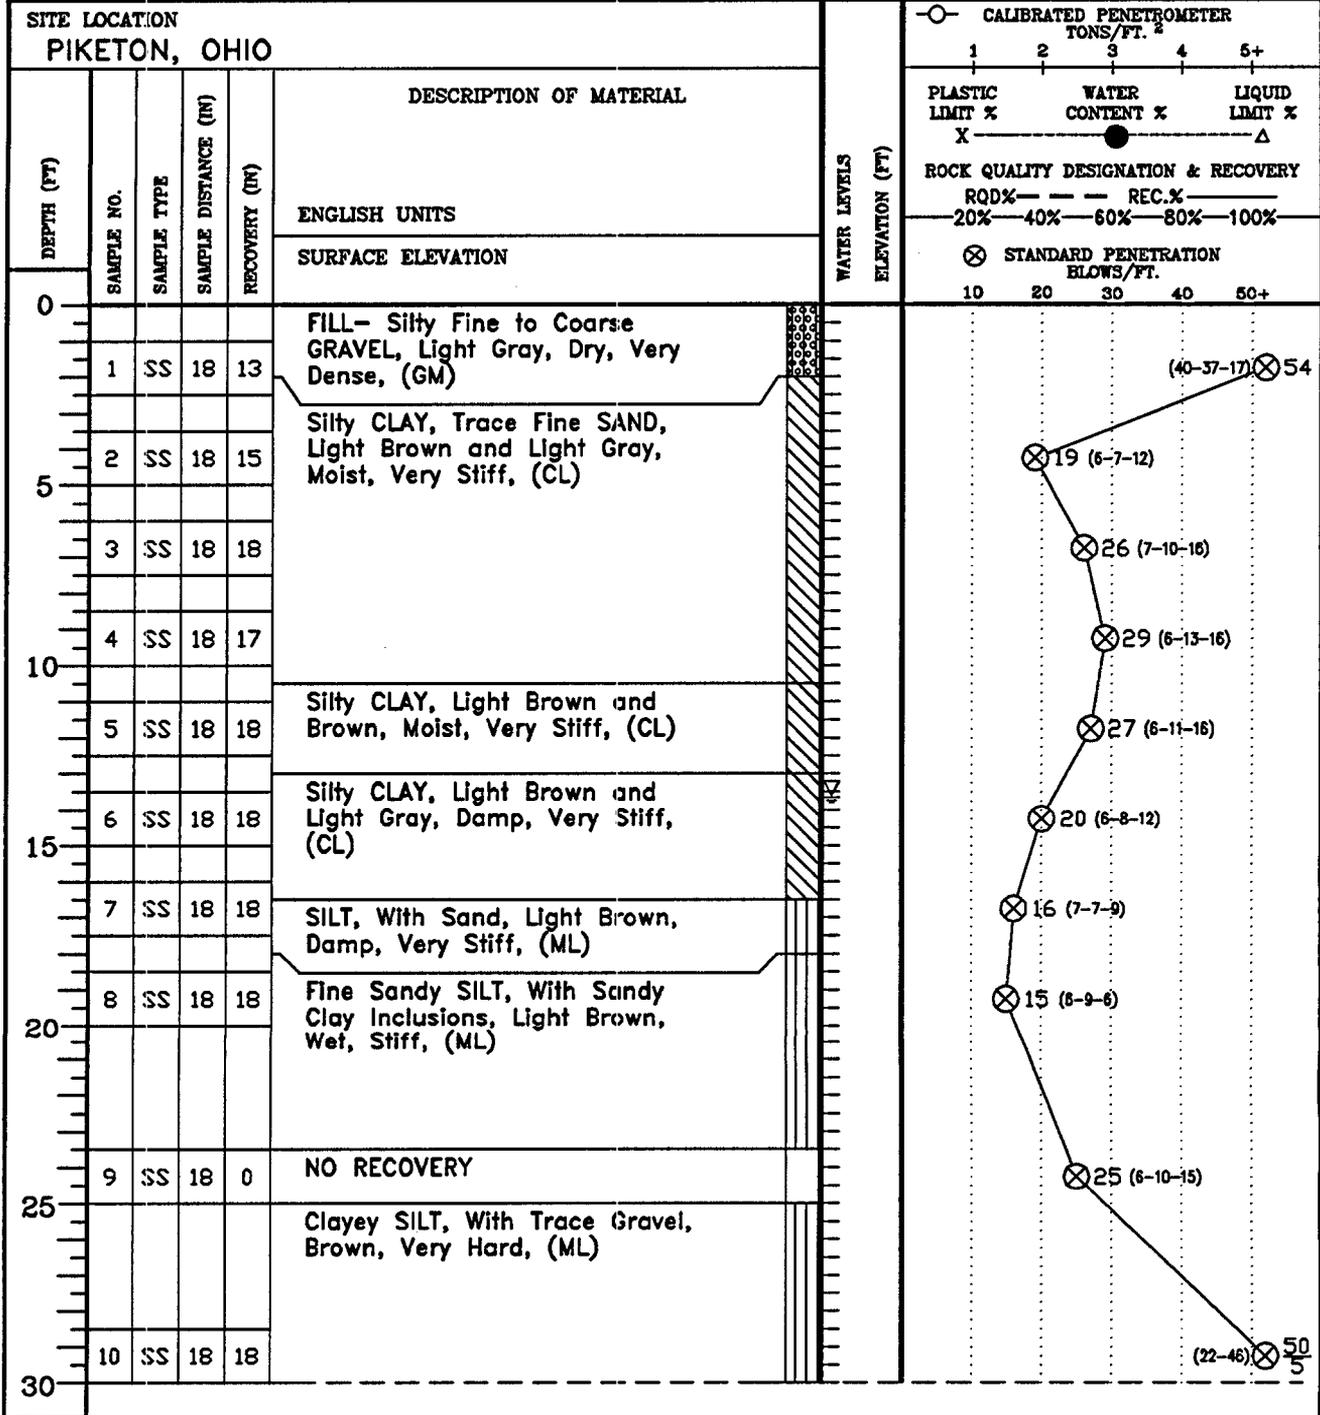

CONTINUED ON NEXT PAGE.

THE STRATIFICATION LINES REPRESENT THE APPROXIMATE BOUNDARY LINES BETWEEN SOIL TYPES IN-SITU THE TRANSITION MAY BE GRADUAL

▽WL 13.6	WS OR (W)	BORING STARTED	10/3/05	
▽WL(AB)	▽WL(AC)	BORING COMPLETED	10/3/05	CAVE IN DEPTH ●
▽WL		RIG B-61	FOREMAN	DRILLING METHOD

CLIENT <b>FLUOR DANIEL</b>	JOB # <b>14-3046</b>	BORING # <b>B-9</b>	SHEET <b>2 OF 2</b>	
PROJECT NAME <b>USEC AMERICAN CENTRIFUGE</b>	ARCHITECT-ENGINEER <b>FLUOR DANIEL</b>			

SITE LOCATION  
**PIKETON, OHIO**


DEPTH (FT)	SAMPLE NO.	SAMPLE TYPE	SAMPLE DISTANCE (IN)	RECOVERY (IN)	DESCRIPTION OF MATERIAL	WATER LEVELS ELEVATION (FT)	CALIBRATED PENETROMETER TONS/FT. <sup>2</sup>							
							1	2	3	4	5+			
					ENGLISH UNITS		PLASTIC LIMIT % X	WATER CONTENT % ●	LIQUID LIMIT % Δ					
					SURFACE ELEVATION		ROCK QUALITY DESIGNATION & RECOVERY							
							RQD% 20%—40%—60%—80%—100%	REC.%						
							⊗ STANDARD PENETRATION BLOWS/FT.							
							10	20	30	40	50+			
30					Clayey SILT, With Trace Gravel, Brown, Very Hard, (ML)									
					AUGER REFUSAL @ 31.00'									
35														
40														
45														
50														
55														
60														

THE STRATIFICATION LINES REPRESENT THE APPROXIMATE BOUNDARY LINES BETWEEN SOIL TYPES IN-SITU THE TRANSITION MAY BE GRADUAL

▽WL 13.6	WS OR (M)	BORING STARTED	10/3/05	
▽WL(AB)	▽WL(AC)	BORING COMPLETED	10/3/05	CAVE IN DEPTH ●
▽WL		RIG B-61	FOREMAN	DRILLING METHOD

CLIENT <b>FLUR DANIEL</b>	JOB # <b>14-3046</b>	BORING # <b>B-10</b>	SHEET <b>1 OF 2</b>	<b>ECS</b> LLP CAROLINAS
PROJECT NAME <b>USEC AMERICAN CENTRIFUGE</b>	ARCHITECT-ENGINEER <b>FLUR DANIEL</b>			

SITE LOCATION  
**PIKETON, OHIO**

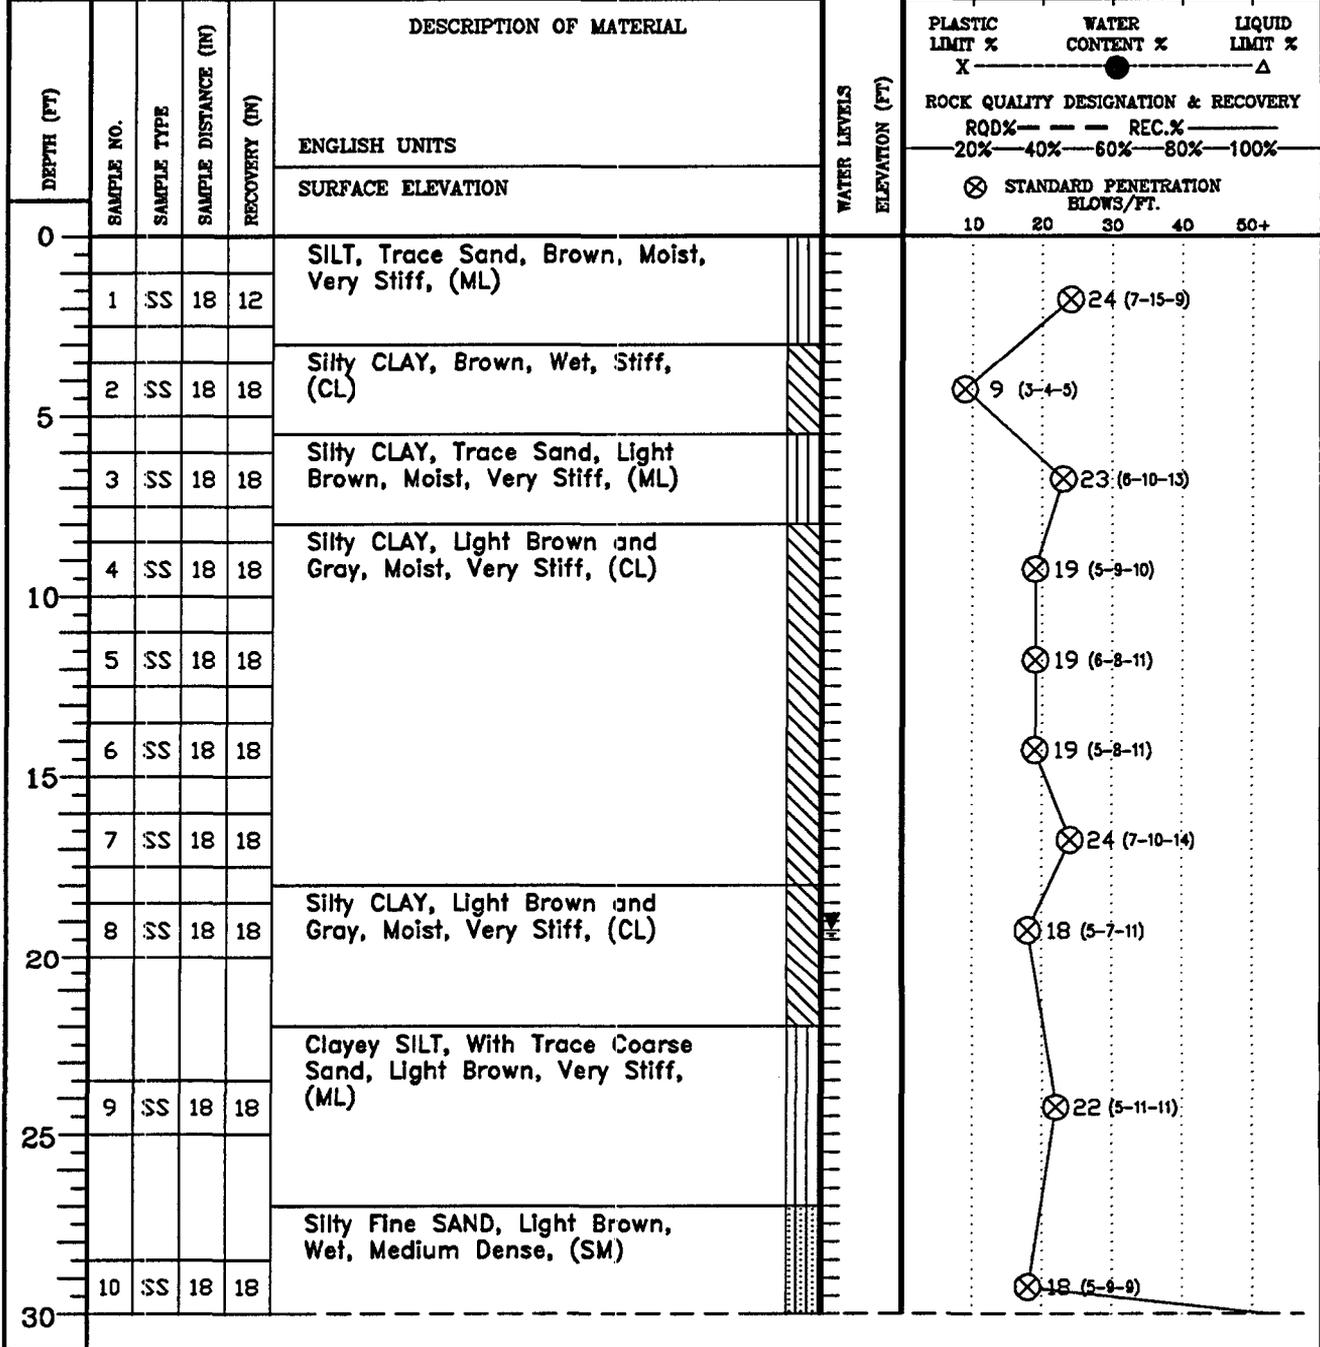


CONTINUED ON NEXT PAGE.

THE STRATIFICATION LINES REPRESENT THE APPROXIMATE BOUNDARY LINES BETWEEN SOIL TYPES IN-SITU THE TRANSITION MAY BE GRADUAL

▽WL	WS OR (M)	BORING STARTED	10/3/05	
▽WL(AB)	▽WL(AC) 19.2	BORING COMPLETED	10/3/05	CAVE IN DEPTH ● 28.2
▽WL		RIG B-61	FOREMAN	DRILLING METHOD

CLIENT <b>FLUOR DANIEL</b>	JOB # <b>14-3046</b>	BORING # <b>B-10</b>	SHEET <b>2 OF 2</b>	
PROJECT NAME <b>USEC AMERICAN CENTRIFUGE</b>	ARCHITECT-ENGINEER <b>FLUOR DANIEL</b>			

SITE LOCATION  
**PIKETON, OHIO**

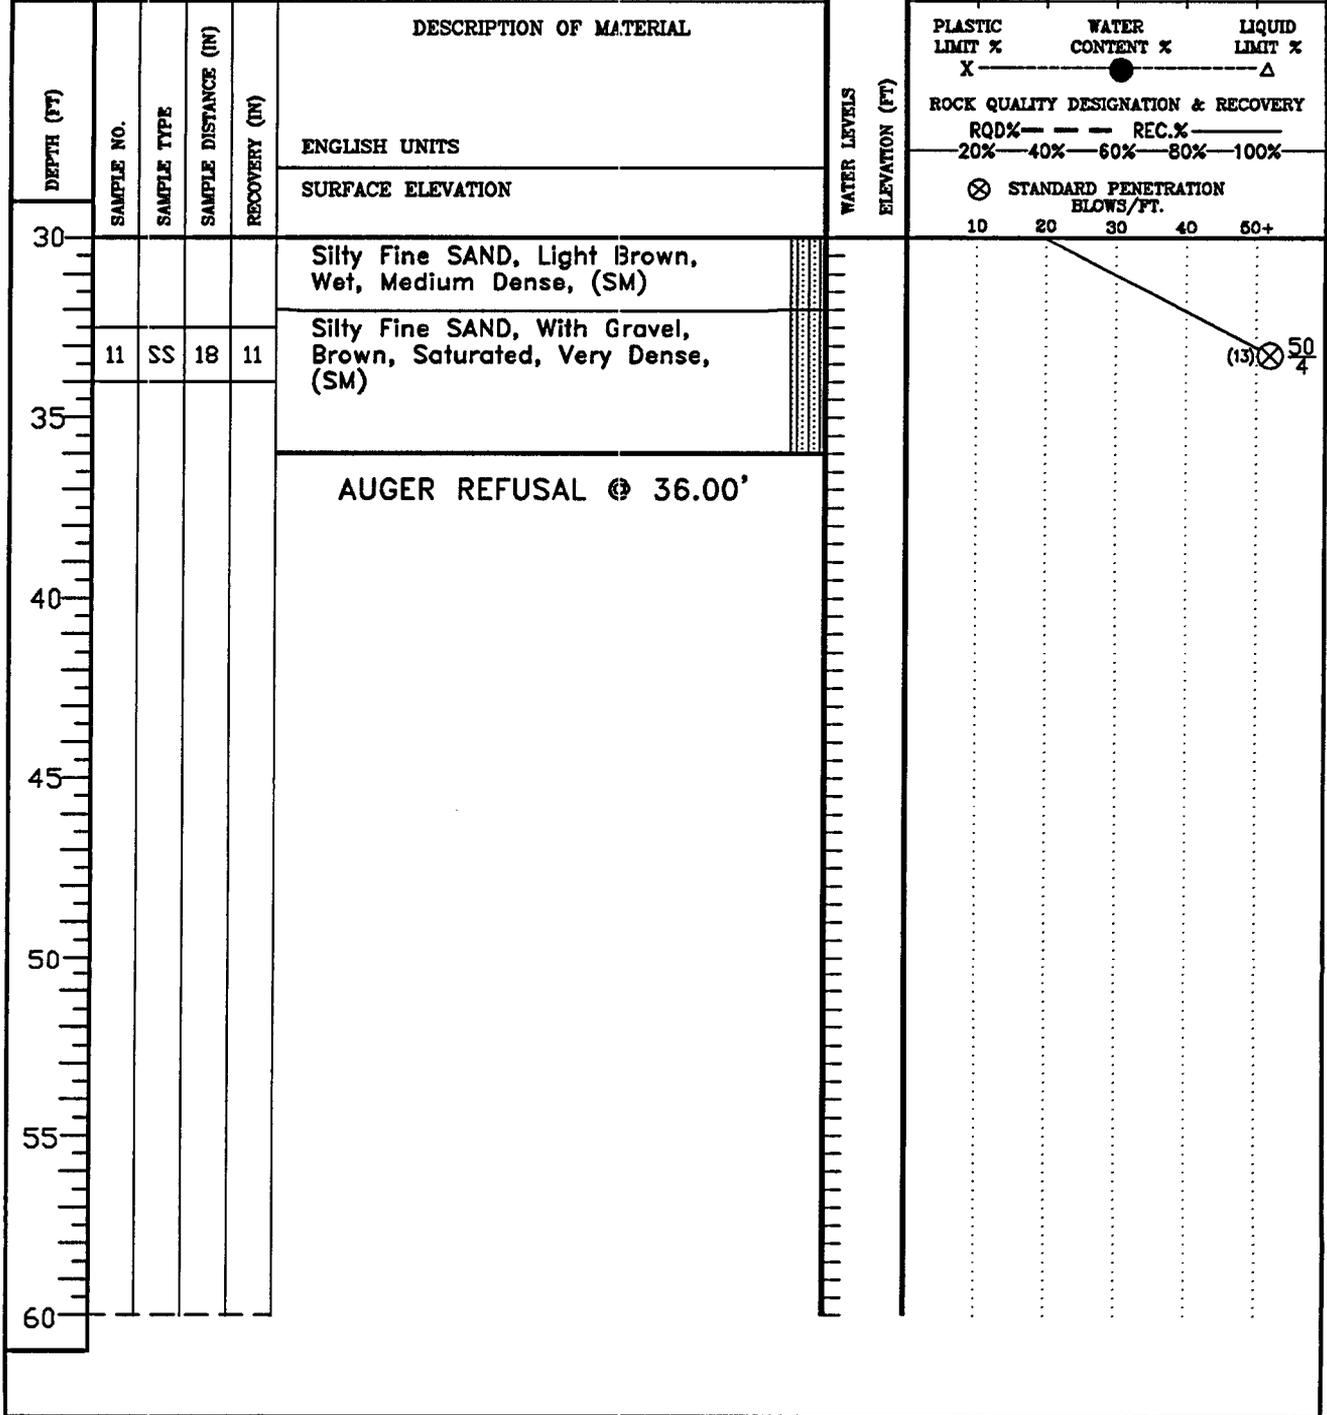


THE STRATIFICATION LINES REPRESENT THE APPROXIMATE BOUNDARY LINES BETWEEN SOIL TYPES IN-SITU THE TRANSITION MAY BE GRADUAL

▽WL	WS OR (D)	BORING STARTED	10/3/05	
▽WL(AB)	▽WL(AC) 19.2	BORING COMPLETED	10/3/05	CAVE IN DEPTH ⊙ 28.2
▽WL		RIG B-61	FOREMAN	DRILLING METHOD




Client: ECS Limited  
Location: American Centrifuge, Piketon, OH  
Sounding: CPT-4  
Sounding Date: October 4, 2005

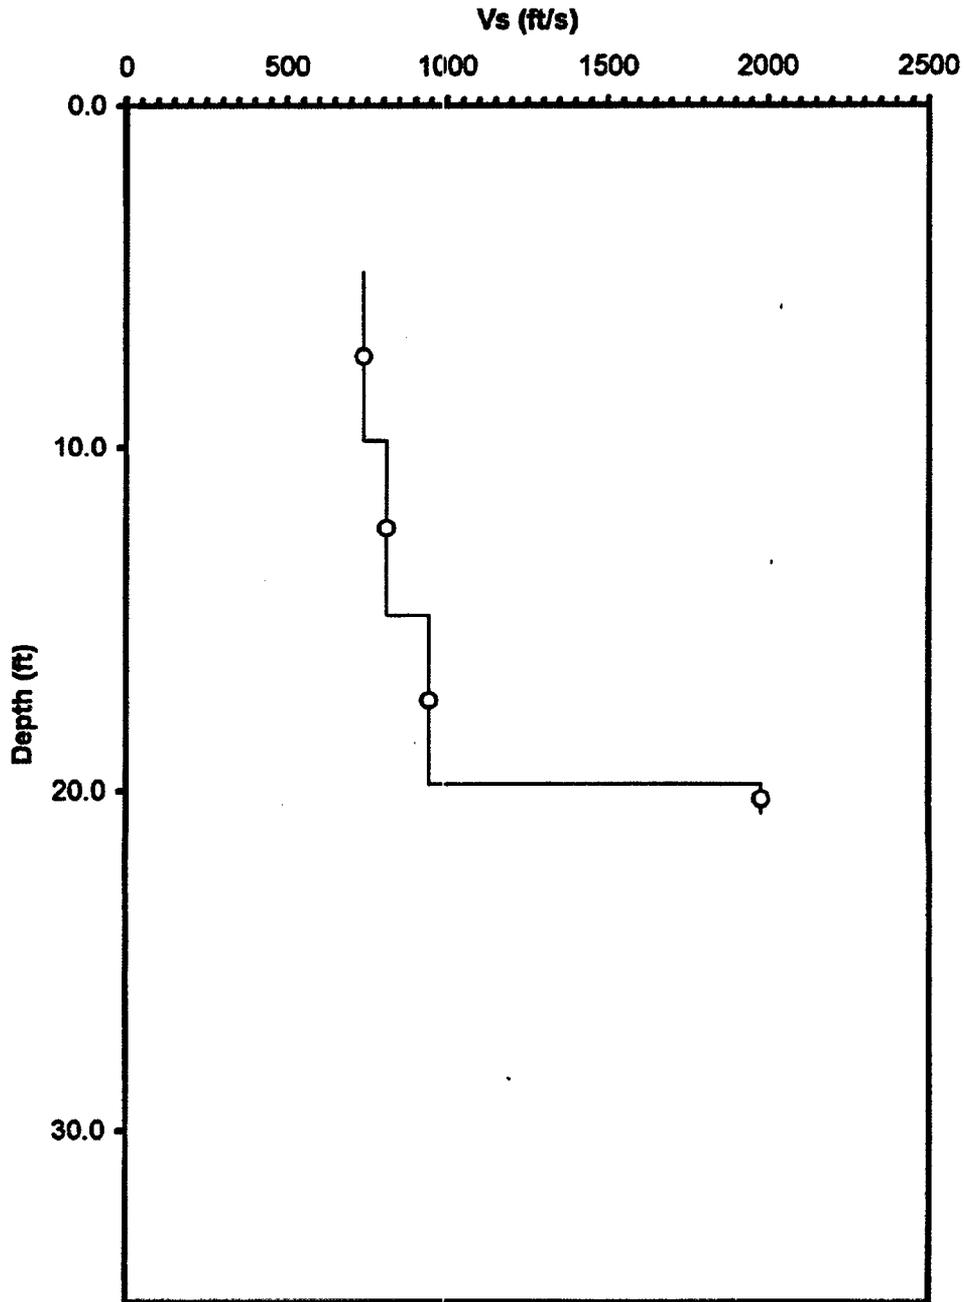





Client: ECS Limited  
Location: American Centrifuge, Piketon, OH  
Sounding: CPT-8  
Sounding Date: October 4, 2005

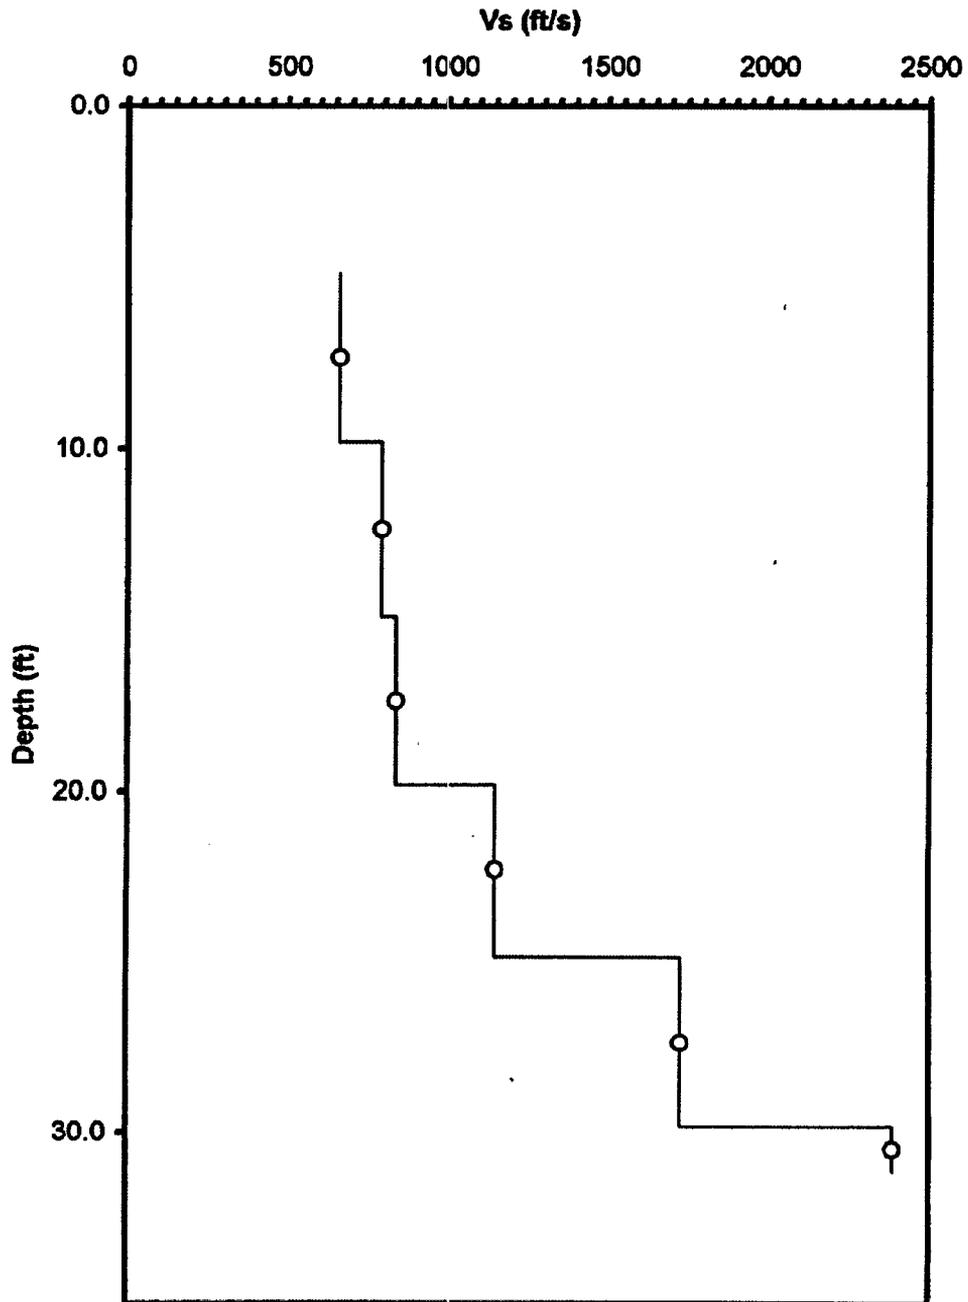



Client: ECS Limited  
Location: American Centrifuge, Piketon, OH  
Sounding: CPT-11  
Sounding Date: October 4, 2005

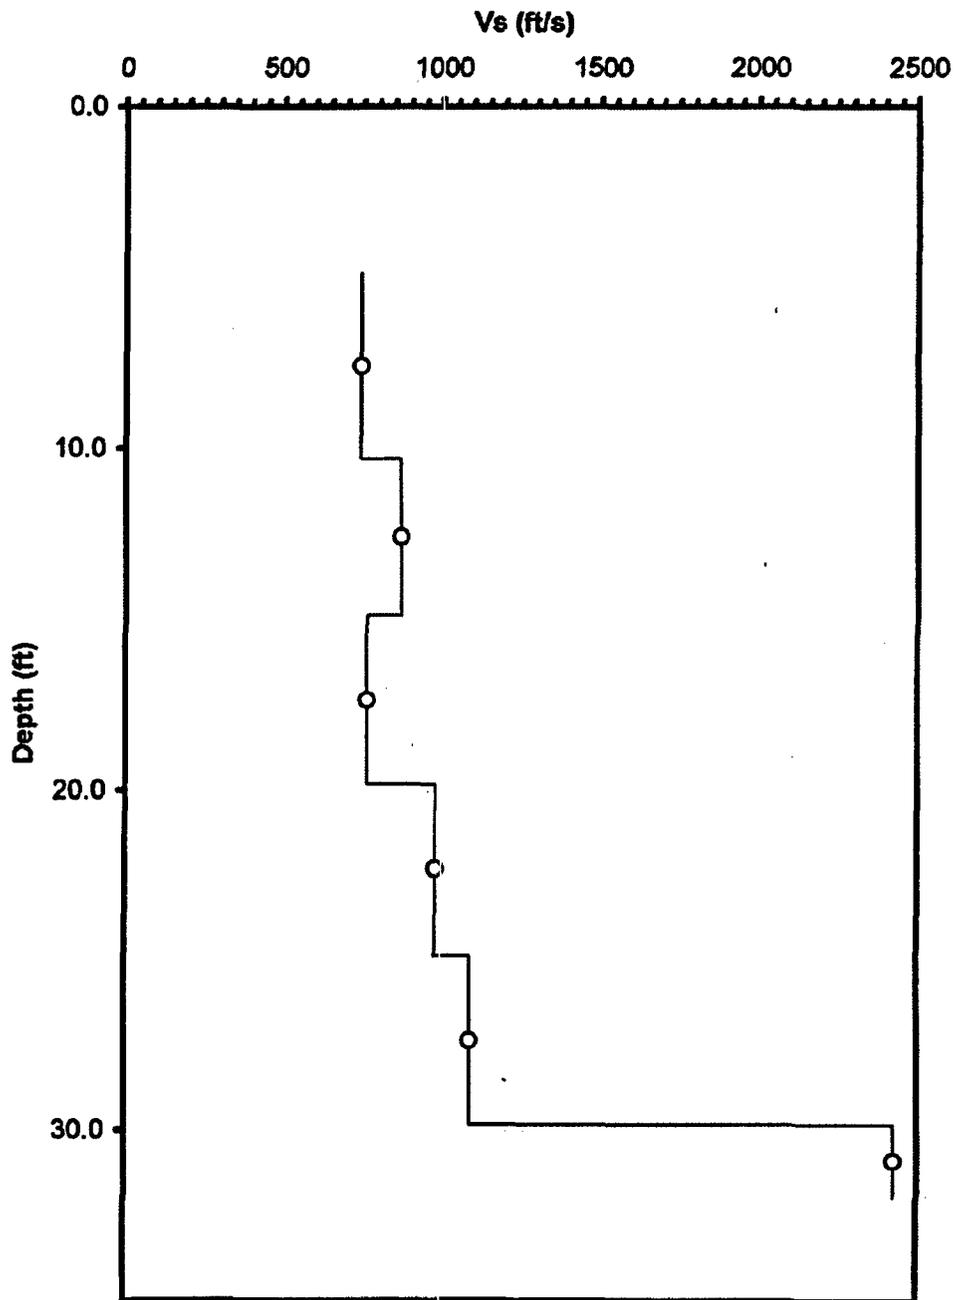

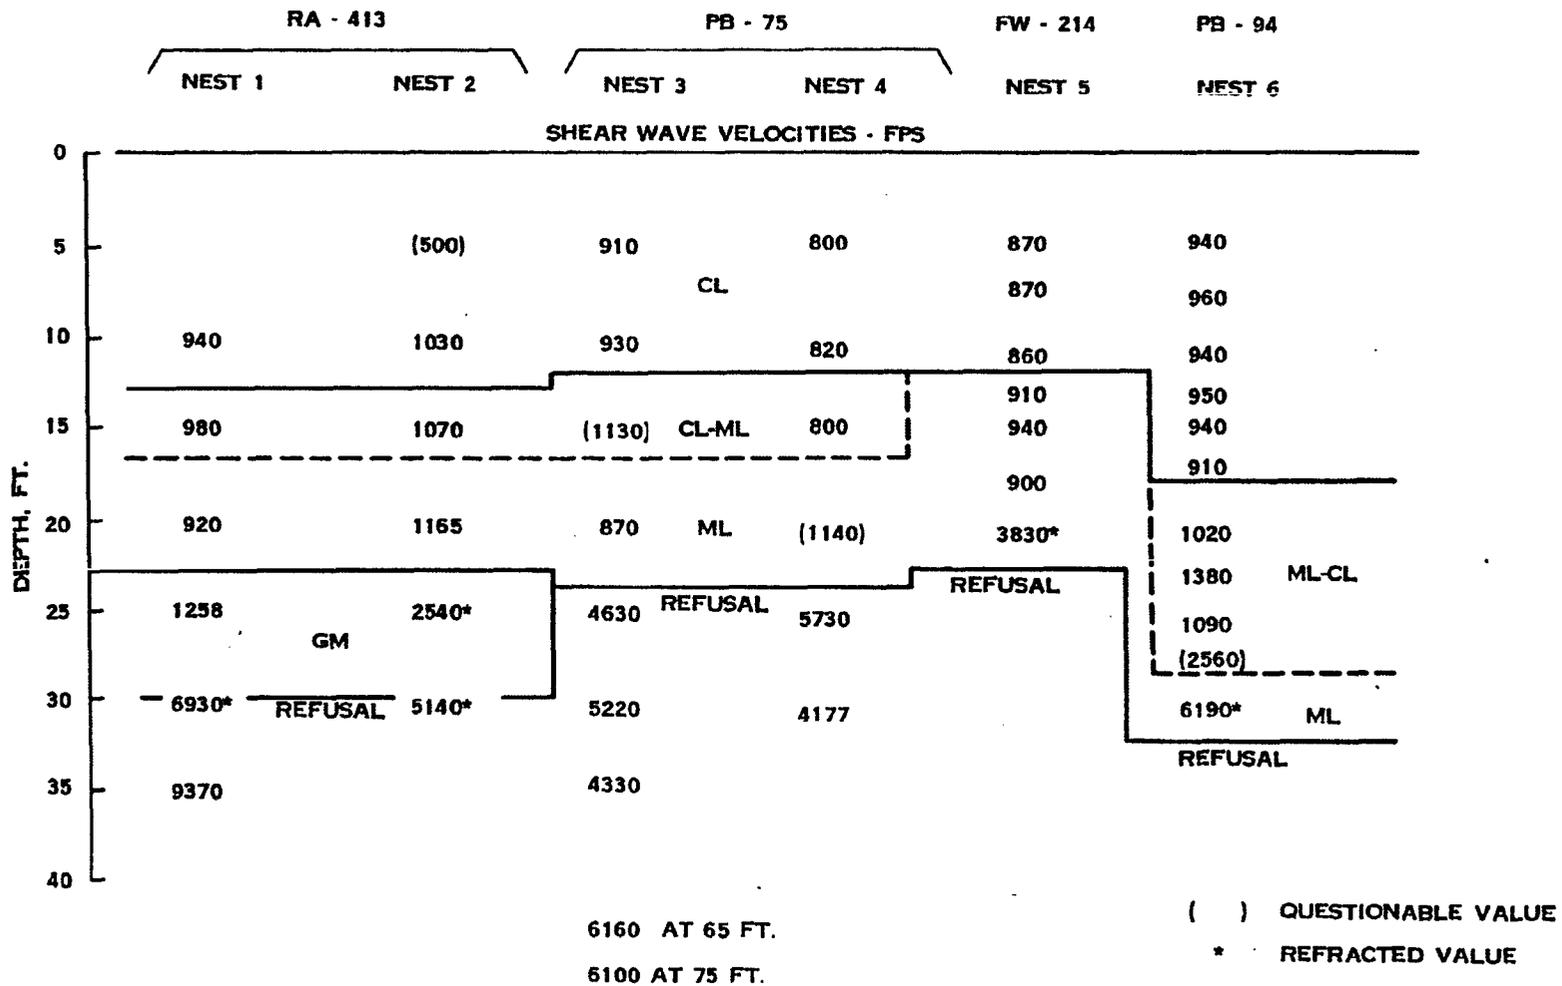

DEPARTMENT OF ENERGY  
GAS CENTRIFUGE  
ENRICHMENT PLANT

MK 7502



LAW ENGINEERING TESTING COMPANY

MARIETTA, GEORGIA

SUMMARY OF CROSSHOLE  
SHEAR WAVE VELOCITIES

FIGURE 9-3

DWN BY: TJ    CKD BY: SAC    APPRVD BY: M/M

**ECS**  
**Greenville, South Carolina**  
**Laboratory Testing Summary**

**Project Number:** 3046

**Project Engineer:** DLA

**Date:** 10/16/05

**Project Name:** USEC American Centrifuge

**Principal Engineer:** SG

**Summary By:** JAM

Boring Number	Sample Number	Depth (feet)	Moisture Content (%)	USCS	Liquid Limit	Plastic Limit	Plasticity Index	Percent Passing No. 200 Sieve	Compaction		CBR Value	Other
									Maximum Density (pcf)	Optimum Moisture (%)		
B-1	1	1-2.5	17.8									
B-2	Bulk	Bulk	17.3						111.0	15.5		
B-2	3	6-7.5	15.7	CL	35	23	12					
B-2	8	16-17.5	12.0	CL	29	19	10					
B-6	2	3.5-5	16.6	CL	33	22	11					
B-6	4	8.5-10	20.4	ML	29	27	2					
B-6	7	16-17.5	25.1	ML				92.9				
B-8	Bulk	Bulk	15.1						110.5	15.5		
B-9	2	3.5-5	20.3	CL	36	19	17					
B-9	7	13.5-15	19.4	CL	34	23	11					
B-9	9	18.5-20	26.3	ML				76.3				
B-10	2	3.5-5	25.4	CL	42	23	19					
B-10	3	6-7.5	19.8	CL	38	24	14					
B-10	5	11-12.5	20.2									
B-10	11	23.5-25	25.7									

**Summary Key:**

SA = See Attached  
S = Standard Proctor  
M = Modified Proctor  
OC = Organic Content

Hyd = Hydrometer  
Con = Consolidation  
DS = Direct Shear  
GS = Specific Gravity

UCS = Unconfined Compression Soil  
UCR = Unconfined Compression Rock  
LS = Lime Stabilization  
CS = Cement Staibilization