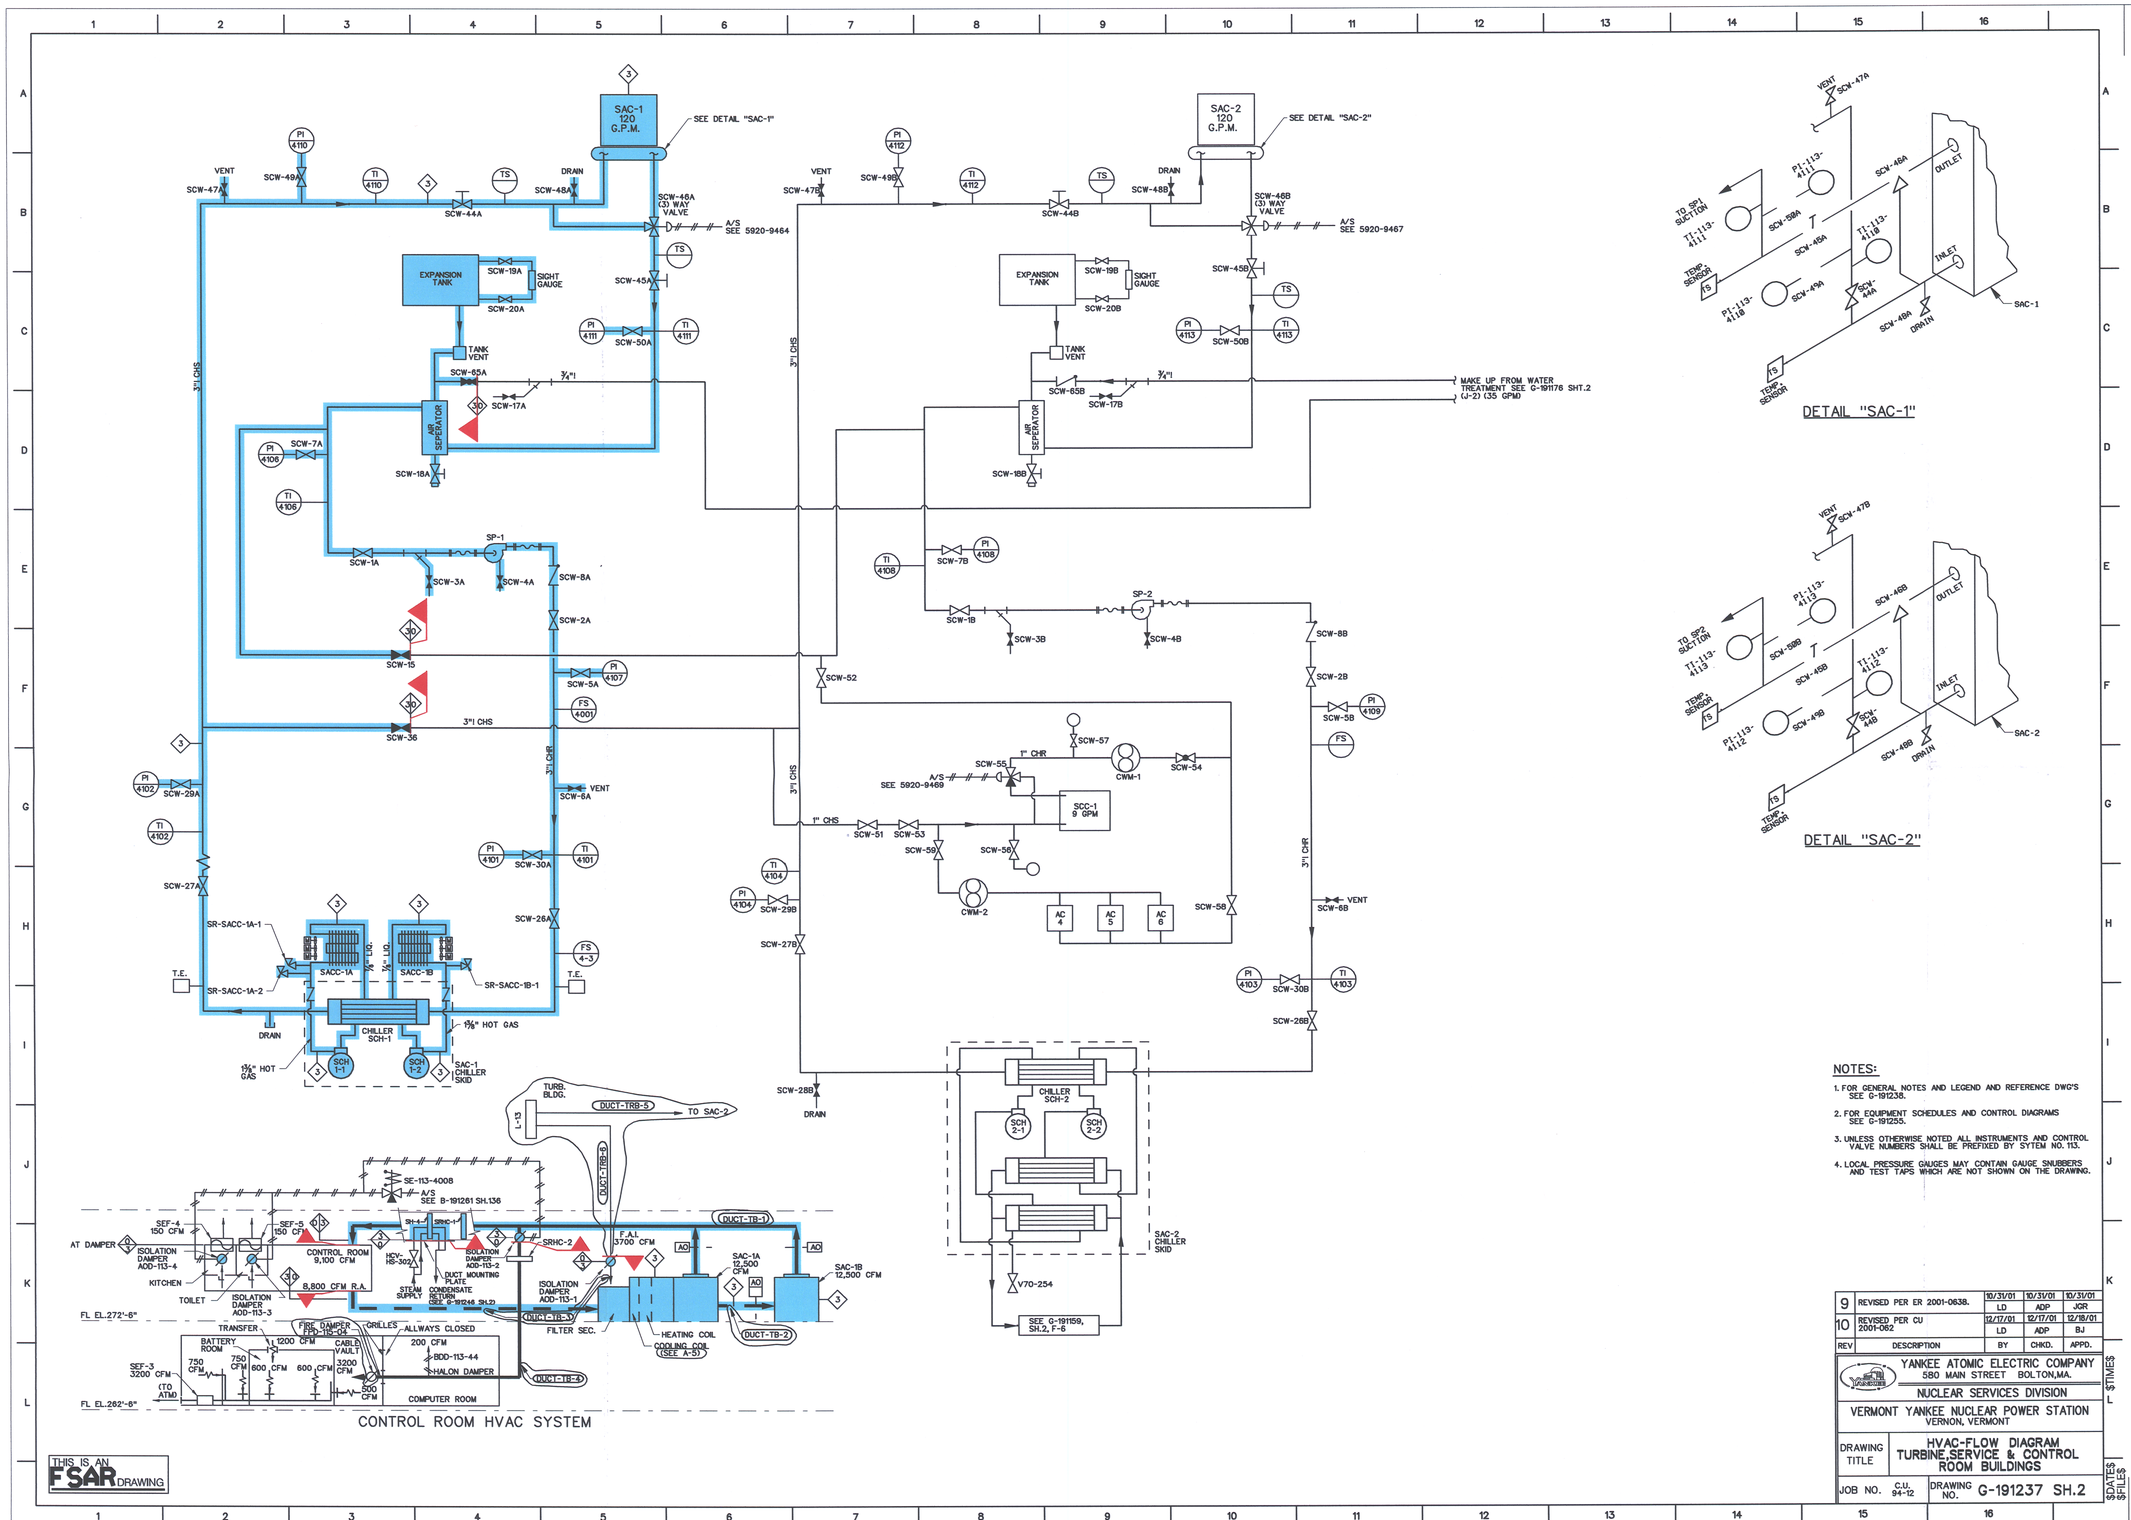

NOTES:

1. FOR GENERAL NOTES AND LEGEND AND REFERENCE DWG'S SEE G-191238.
2. FOR EQUIPMENT SCHEDULES AND CONTROL DIAGRAMS SEE G-191255.
3. UNLESS OTHERWISE NOTED ALL INSTRUMENTS AND CONTROL VALVE NUMBERS SHALL BE PREFIXED BY SYTEM NO. 113.
4. LOCAL PRESSURE GAUGES MAY CONTAIN GAUGE SNUBBERS AND TEST TAPS WHICH ARE NOT SHOWN ON THE DRAWING.

REV	DESCRIPTION	BY	CHKD.	APPD.
9	REVISED PER ER 2001-0638.	10/31/01 LD	10/31/01 ADP	10/31/01 JGR
10	REVISED PER CU 2001-062	12/17/01 LD	12/17/01 ADP	12/18/01 BJ

YANKEE ATOMIC ELECTRIC COMPANY
580 MAIN STREET BOLTON,MA.
NUCLEAR SERVICES DIVISION
VERMONT YANKEE NUCLEAR POWER STATION
VERNON, VERMONT

DRAWING TITLE: HVAC-FLOW DIAGRAM TURBINE,SERVICE & CONTROL ROOM BUILDINGS

JOB NO. C.U. 94-12 | DRAWING NO. G-191237 SH.2

$TIME$
$DATE$
$FILE$

NO.	DATE	DESCRIPTION	BY	ENG	CHK	APP
0	4-4-05	.		.	.	.

REVISIONS

LRA-G-191237-SH-02-0

CAD FILE
LRA-G-191237-SH-02_10.DGN
MASTER FILE
N/A

D-4