


EO-8

I certify that the image contained on this frame was made in the normal and regular course of business and that it is an accurate reproduction of the document submitted for microfilming.  
12/3/00  
16x  
Camera Operator

This drawing has been produced by Bechtel and is the property of the participants in the Arizona Nuclear Power Project. Use of the drawing and the specific design depicted thereon for any purpose other than that related to the Arizona Nuclear Power Project is not authorized by the Owners.

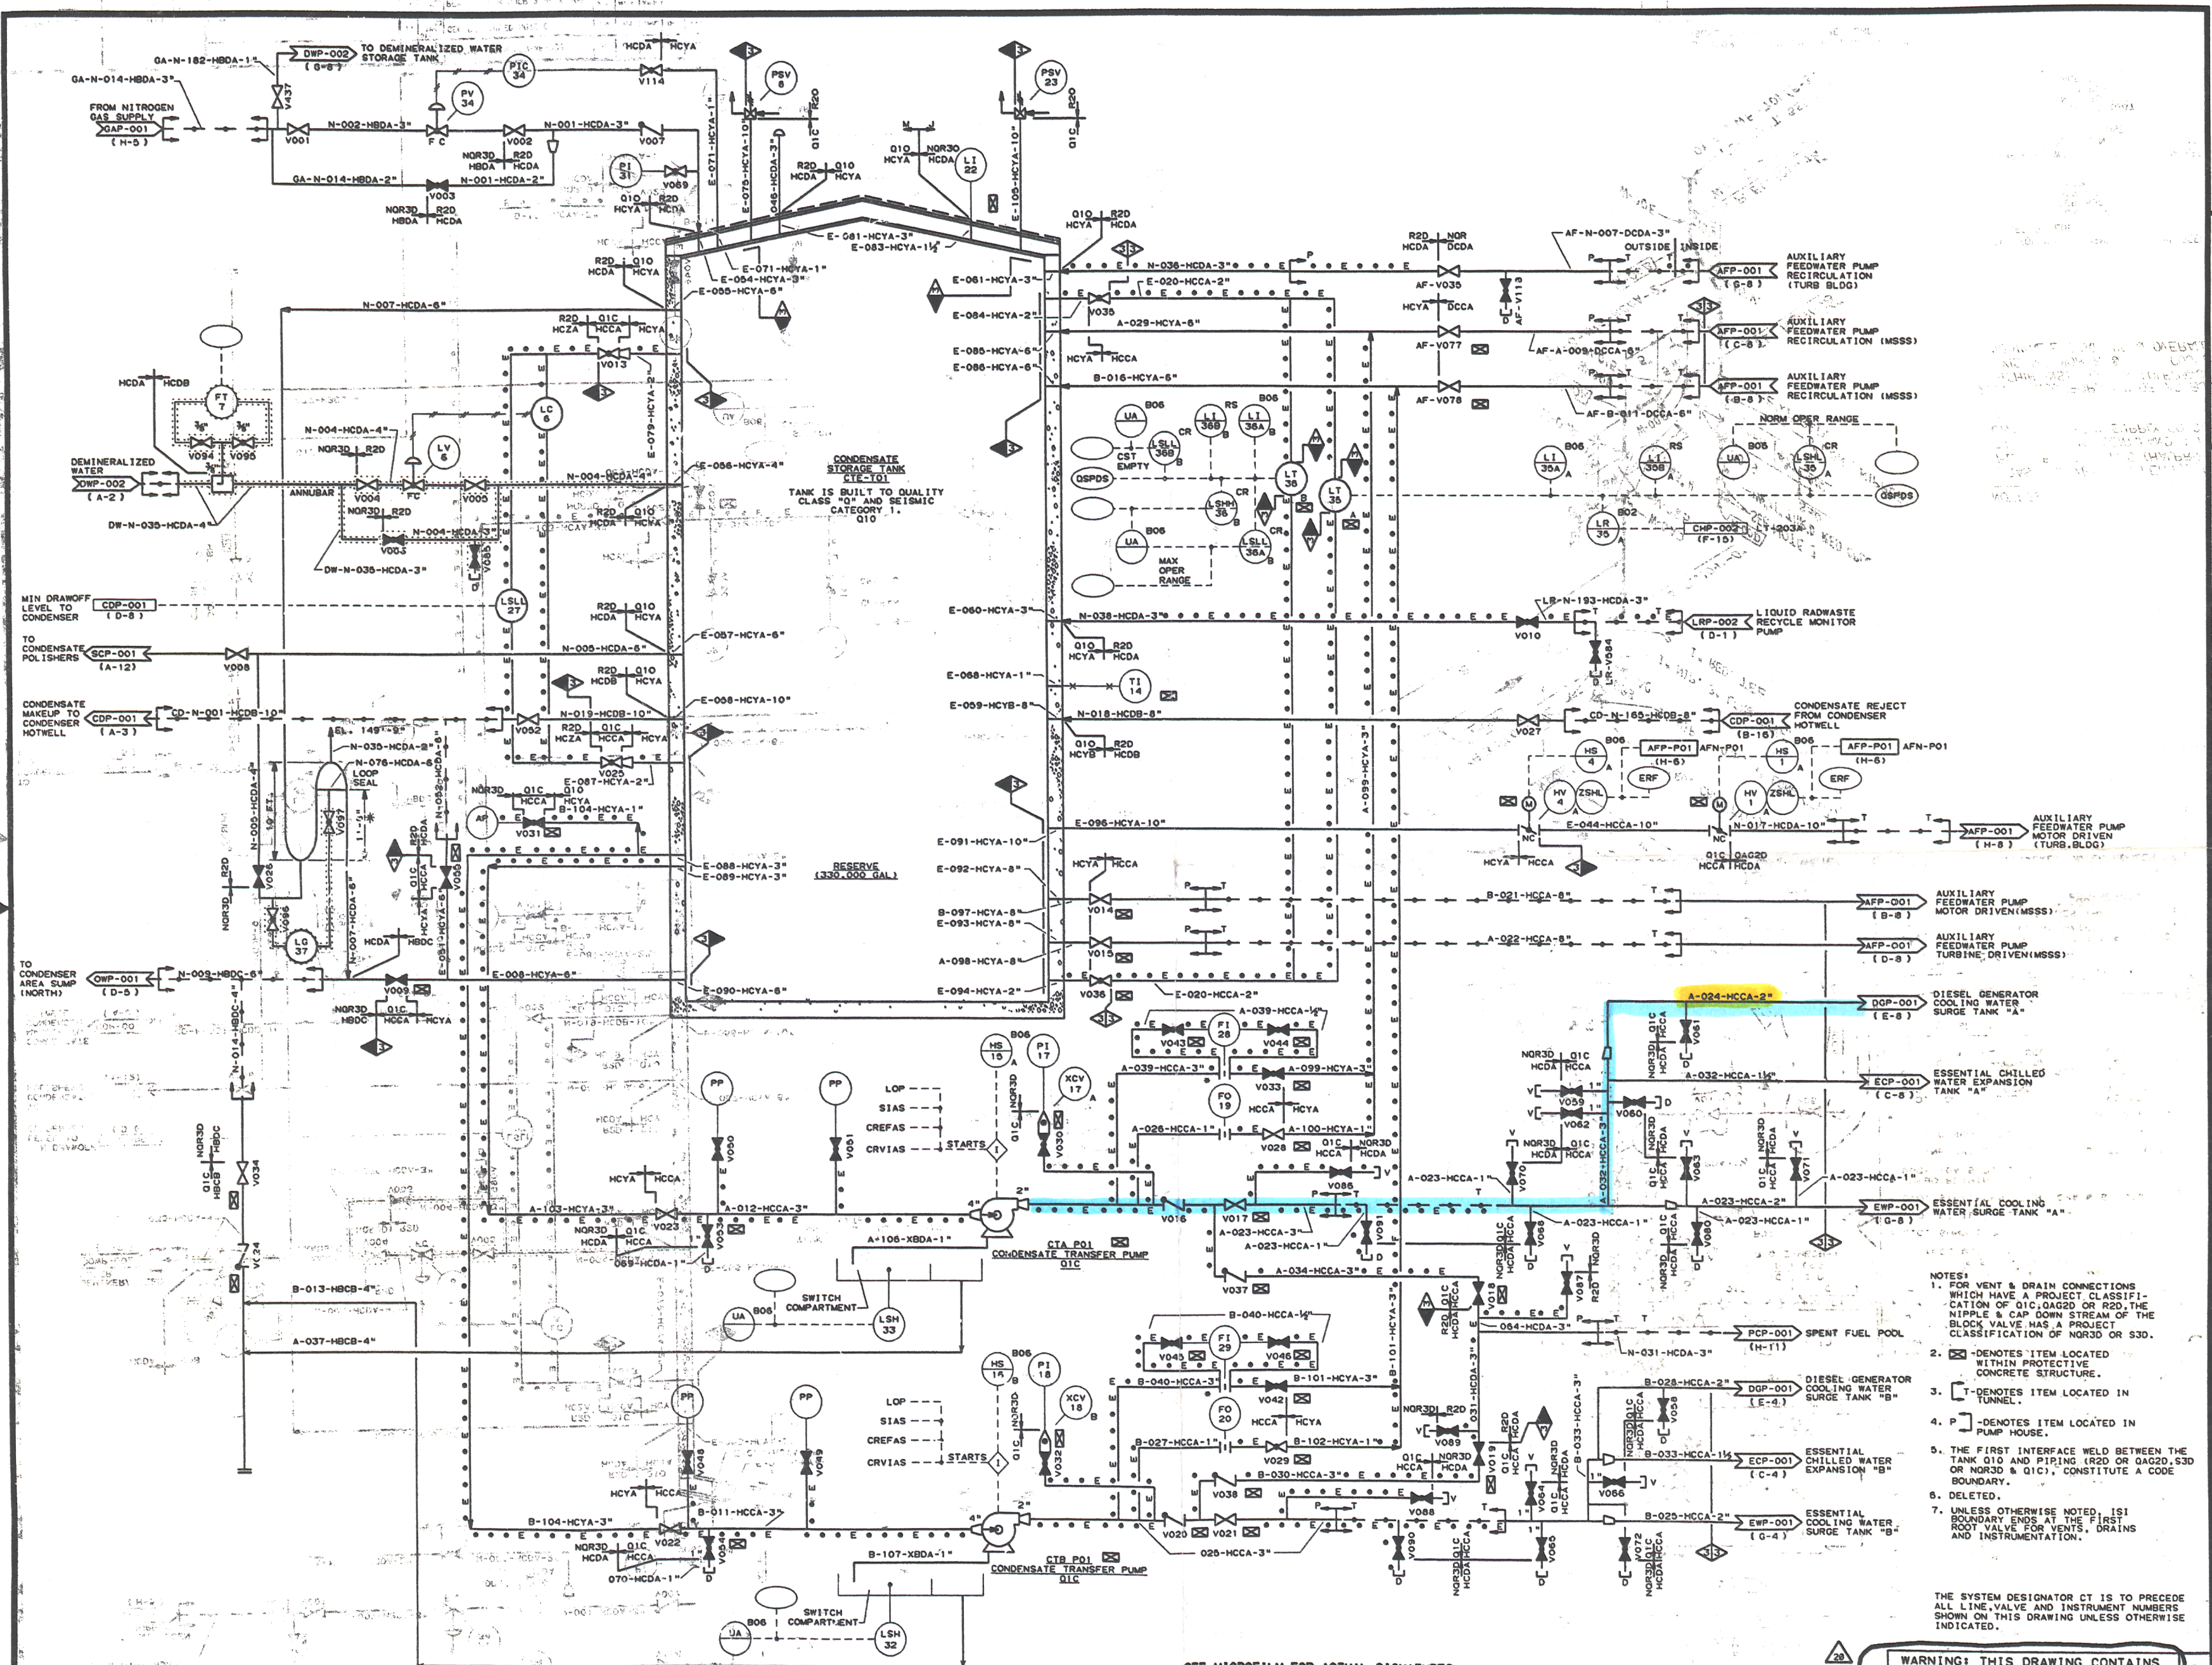

- NOTES:
- FOR VENT & DRAIN CONNECTIONS WHICH HAVE A PROJECT CLASSIFICATION OF QIC/DAG2D OR R2D, THE NIPPLE & CAP DOWN STREAM OF THE BLOCK VALVE HAS A PROJECT CLASSIFICATION OF NOR3D OR S3D.
  - ☒ DENOTES ITEM LOCATED WITHIN PROTECTIVE CONCRETE STRUCTURE.
  - T DENOTES ITEM LOCATED IN TUNNEL.
  - P DENOTES ITEM LOCATED IN PUMP HOUSE.
  - THE FIRST INTERFACE WELD BETWEEN THE TANK Q10 AND PIPING (R2D OR DAG2D, S3D OR NOR3D & QIC), CONSTITUTE A CODE BOUNDARY.
  - DELETED.
  - UNLESS OTHERWISE NOTED, ISI BOUNDARY ENDS AT THE FIRST BOUNDARY END FOR VENTS, DRAINS AND INSTRUMENTATION.

THE SYSTEM DESIGNATOR CT IS TO PRECEDE ALL LINE, VALVE AND INSTRUMENT NUMBERS SHOWN ON THIS DRAWING UNLESS OTHERWISE INDICATED.

WARNING: THIS DRAWING CONTAINS ISI COLOR BOUNDARY INFORMATION.

REV.	BY	DATE	DESCRIPTION	DR	CHK	ENG	IV	MAE	NO.	DATE	REVISIONS	DR	CHK	ENG	IV	MAE	NO.	DATE	REVISIONS	DR	CHK	ENG	IV	MAE	
11	INCORP.	00CR 92M-AF-025							19	14	INCORP. EDC 99-00276						14	14	INCORPORATED DCN 66						
12	GEN REV	ADDED NOTE 6							18	14	INCORP. EDC 99-00316						13	14	INCORPORATED OOCR 93M-CH-020.						
13	REVISED	PER OOCR 91M-CT-006							17	14	INCORP. EDC'S 99-00583 & 99-00146						0	14	REV 0 OF THIS DWD MADE FROM REV 9 OF 13M-CTP-001 WHICH INCLUDES DCN'S 1 THRU 42 AND 45.						
14	DIRECT	INCORPORATION OF EDC 0000-00196. ADDED ISI COLOR BOUNDARY INFORMATION AND WARNING NOTE.							15	14	INCORP. EDC'S 99-00595						15	14	INCORPORATED FCR'S 63.63M & 61.44M.						



P. AND I. DIAGRAM CONDENSATE STORAGE AND TRANSFER SYSTEM			
SCALE	JOB NO.	DRAWING NO.	REV.
NONE		01-M-CTP-001	20

MAY NOT BE SUITABLE FOR REPRODUCTION

EO-8