3 occupied homes, the licensee is inquiring about testing their drinking wells.

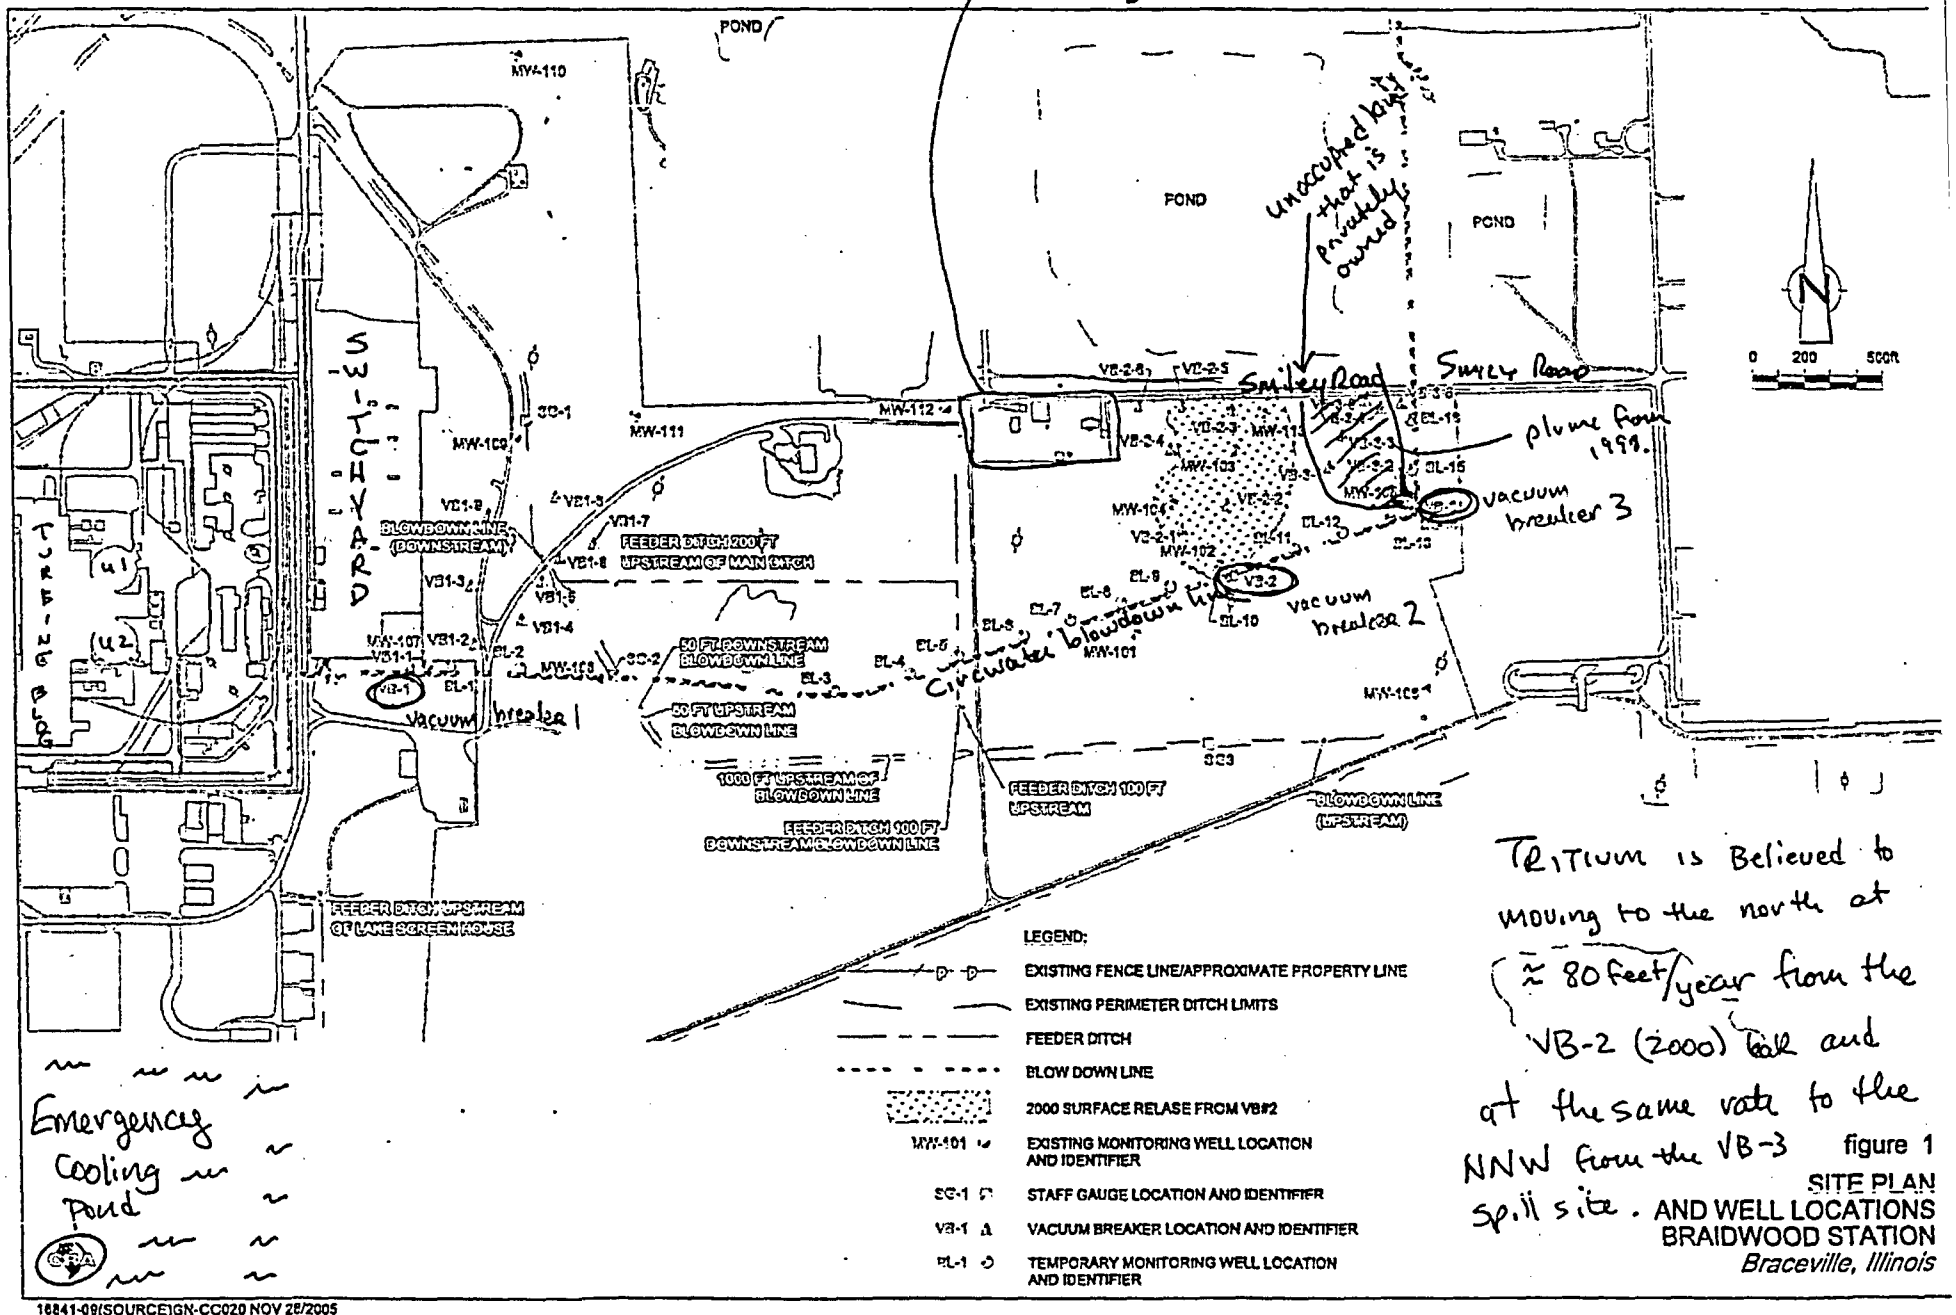

Tritium is Believed to moving to the north at ≈ 80 feet/year from the VB-2 (2000) leak and at the same rate to the NNW from the VB-3 spill site.

figure 1
SITE PLAN
AND WELL LOCATIONS
BRAIDWOOD STATION
Braceville, Illinois

16841-09(SOURCE)GN-CC020 NOV 28/2005

D-4