- Background well is 7-9 pCi/L
- LLD is 2000 pCi/L
- Monitoring well 4 is 397 pCi/L tritium. Wells 1-3 are < LLD.

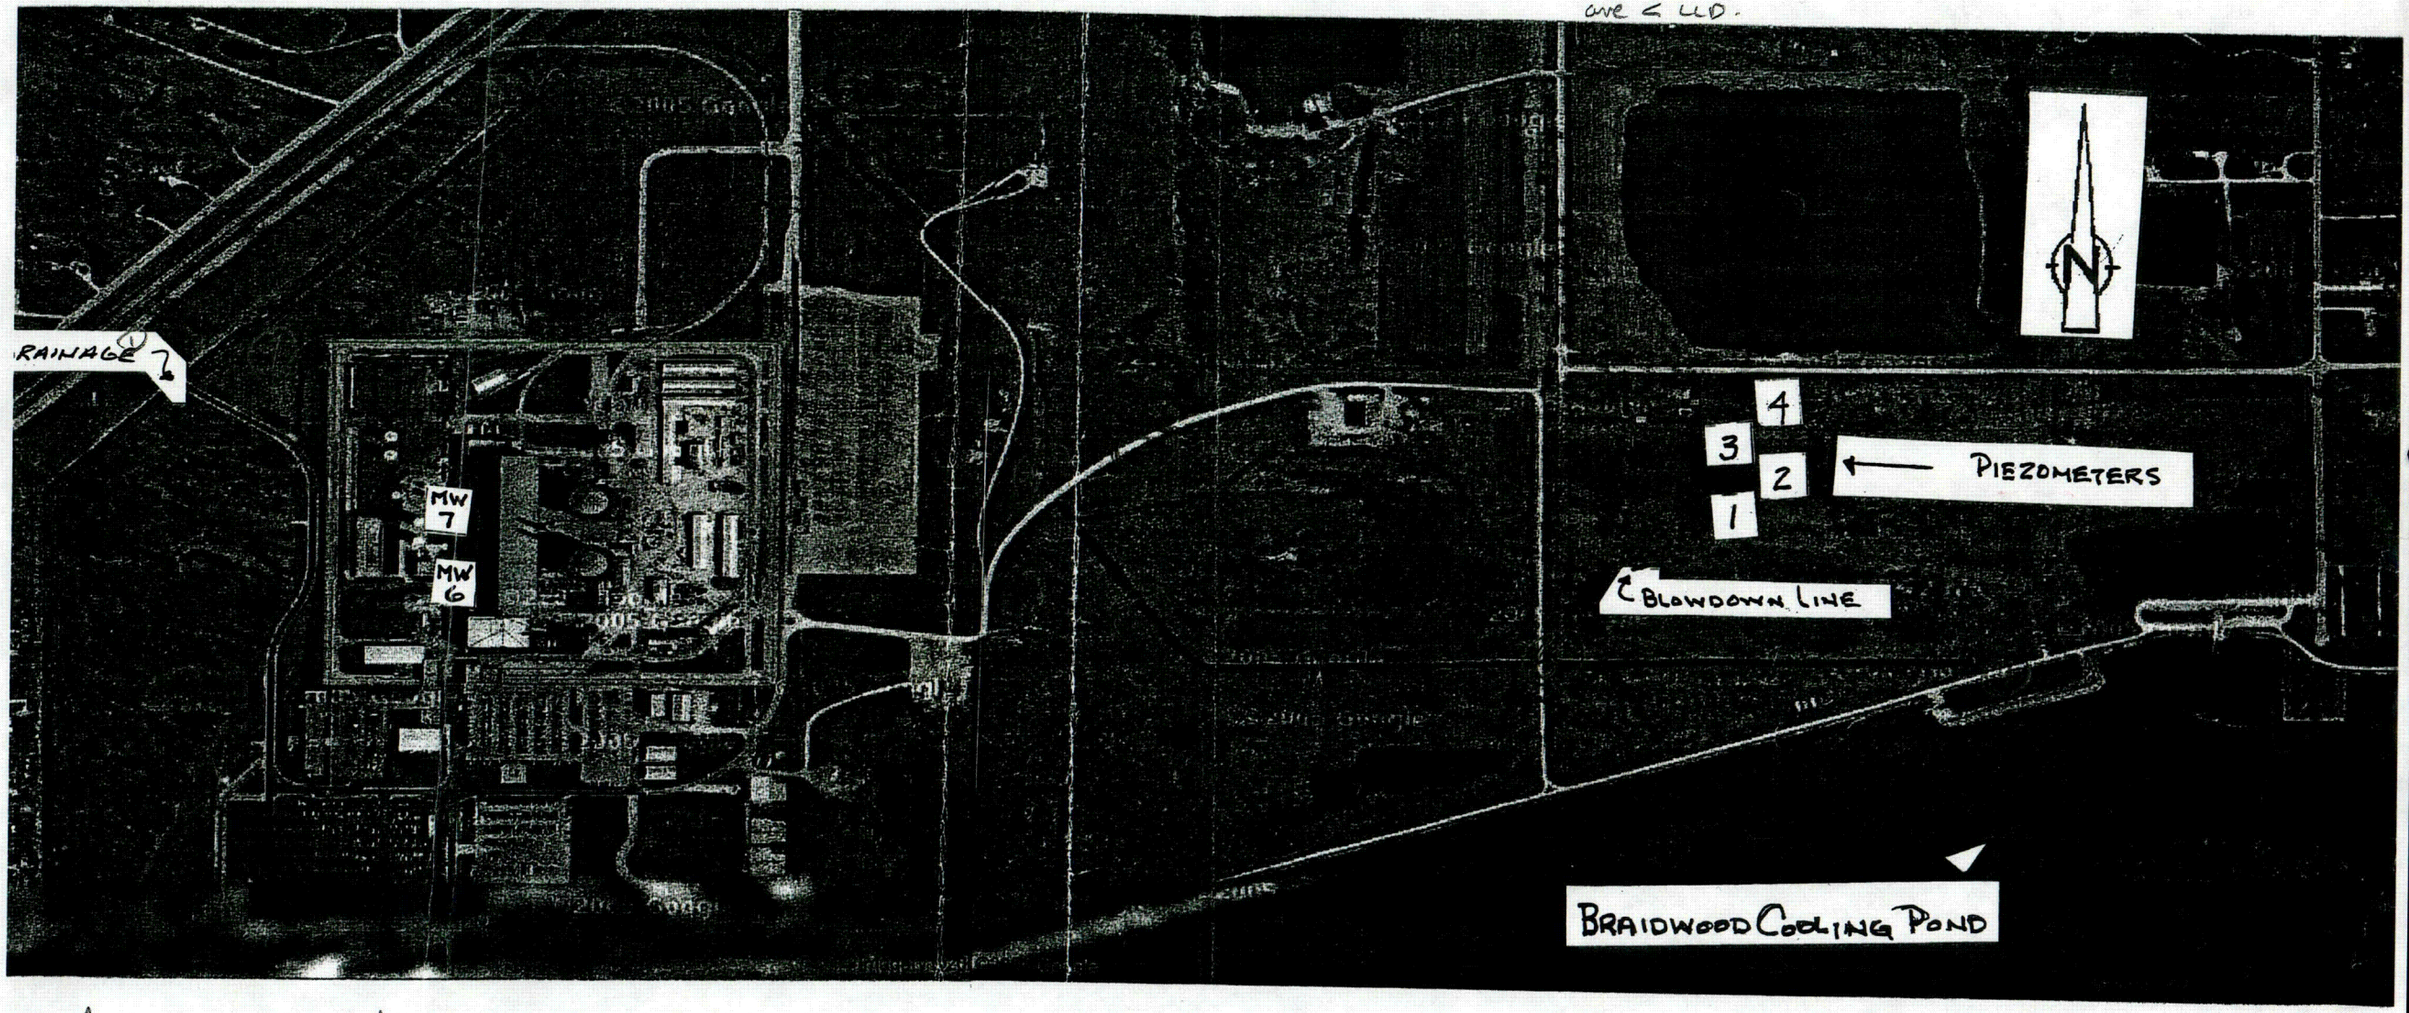

Braidwood, IL

(1) 3/24 sample 539 pCi/L of Tritium (over LLD of 200 pCi/L)
4/7 sample 583 pCi/L of Tritium
5/5 sample 548 pCi/L of Tritium

(2) Sample 3/5 on Emergency Spillway 350 pCi/L

(3) 5/5 200 ft upstream of road 438 pCi/L

(4) 5/5 28 pCi/L (< LLD)

(5) 50' upstream/downstream of Blowdown line

(6) @ road S. of Blowdown line

(7) Freezer truck from on site to storage truck

(8) Sampled 5 ground water wells

#5, 6, 7 and 8 dem 5/10, results due Friday

D-47

COL