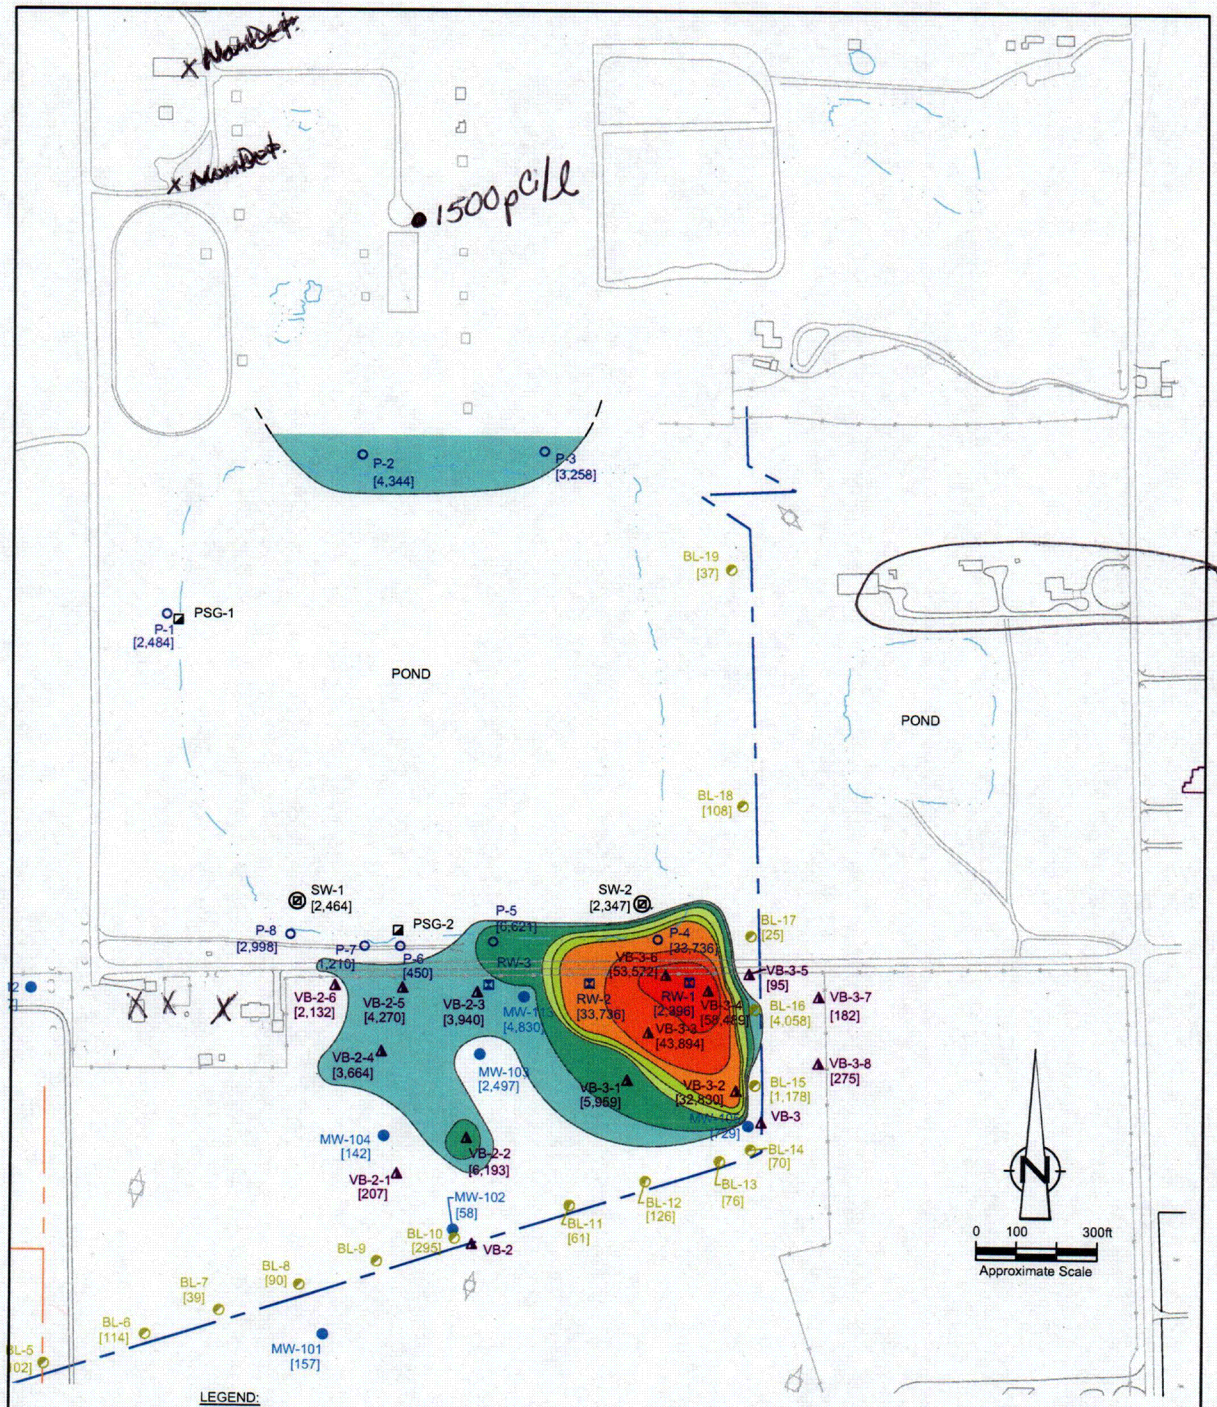

figure

ESTIMATED TRITIUM CONCENTRATIONS
DECEMBER 6, 2005
BRAIDWOOD STATION
Braceville, Illinois

16841-09(DEC 06-05)GN-CO001 DEC 06/2005

X = Nothing above LLD (200 pCi/l)

D-724
C07