



Entergy Nuclear South
Entergy Operations, Inc.
17265 River Road
Killona, LA 70057-3093
Tel 504-739-6780
Fax 504-739-6698
ttanker@entergy.com

Tom Tankersley
Licensing Manager
Waterford 3

W3F1-2006-0018

April 27, 2006

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555-0001

Subject: Annual Radioactive Effluent Release Report - 2005
Waterford Steam Electric Station, Unit 3 (Waterford 3)
Docket No. 50-382
License No. NPF-38

Dear Sir or Madam:

Attached is the Annual Radioactive Effluent Release report for the period January 1 through December 31, 2005. This report is being submitted pursuant to the requirements of Technical Specification Section 6.9.1.8.

If you have any questions, please contact Mark Louque at (504) 464-3267.

There are no new commitments contained in this submittal.

Sincerely,

A handwritten signature in cursive script, appearing to read "T.E. Tankersley".

T.E. Tankersley
Licensing Manager

TET/OPP/cbh

Attachment(s)

IE48

cc: (w/o Attachment)

Dr. Bruce S. Mallett
Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV
611 Ryan Plaza Drive, Suite 400
Arlington, TX 76011-8064

NRC Senior Resident Inspector
Waterford Steam Electric Station Unit 3
P.O. Box 822
Killona, LA 70066-0751


U. S. Nuclear Regulatory Commission
Attn: Mr. Mel B. Fields
Mail Stop O-07D1
Washington, DC 20555-0001

Wise, Carter, Child & Caraway
ATTN: J. Smith
P.O. Box 651
Jackson, MS 39205

Winston & Strawn
ATTN: N.S. Reynolds
1700 K Street, NW
Washington, DC 20006-3817

Morgan, Lewis & Bockius LLP
ATTN: T.C. Poindexter
1111 Pennsylvania Avenue, NW
Washington, DC 20004

Attachment to
W3F1-2006-0018
Annual Radioactive Effluent Release Report
January 1, 2005 – December 31, 2005



Entergy

**Annual
Radioactive Effluent Release
Report**

January 1, 2005 - December 31, 2005



**Waterford 3 SES
Entergy Operations, Inc.**

Docket Number 50-382

License Number NPF-38

Originator: Mark J Louque 4-17-06
Mark J Louque Environmental Specialist
Waterford 3 SES Date

Reviewed By: John Amato 4-19-06
John Amato Environmental Specialist
Waterford 3 SES Date

Reviewed By: Cbrey Zefiroue 4-19-06
Cbrey Zefiroue Chemistry Supervisor
Waterford 3 SES Date

Reviewed By: David Rieder 4/19/2006
David Rieder Sr. Engineer, QA
Waterford 3 SES Date

Approved By: John L. Hornsby 4/20/06
John L. Hornsby Chemistry Superintendent
Waterford 3 SES Date

Table of Contents

| | |
|---|-----------|
| 1.0 Introduction | 1 |
| 2.0 Supplemental Information | 2 |
| 2.1 Regulatory Limits | 2 |
| 2.1.1 Fission and Activation Gases (Noble Gases) | 2 |
| 2.1.2 Iodines, Particulates with Half Lives > Eight (8) Days, and Tritium..... | 3 |
| 2.1.3 Liquid Effluents | 3 |
| 2.1.4 Uranium Fuel Cycle Sources | 4 |
| 2.2 Maximum Permissible Concentrations | 4 |
| 2.2.1 Fission and Activation Gases, Iodines, and Particulates, With Half Lives > Eight (8) Days | 4 |
| 2.2.2 Liquid Effluents | 4 |
| 2.3 Average Energy (E-Bar) | 4 |
| 2.4 Measurements and Approximations of Total Radioactivity | 5 |
| 2.4.1 Fission and Activation Gases (Noble Gases) | 5 |
| 2.4.2 Iodines, Particulates, and Tritium..... | 5 |
| 2.4.3 Liquid Effluents | 6 |
| 2.5 Batch Releases | 6 |
| 2.6 Unplanned/Abnormal Releases | 6 |
| 2.6.1 Unplanned/Abnormal Gaseous Releases..... | 6 |
| 2.6.2 Unplanned/Abnormal Liquid Releases..... | 6 |
| 3.0 Gaseous Effluents | 7 |
| 4.0 Liquid Effluents | 7 |
| 5.0 Solid Wastes | 7 |
| 6.0 Meteorological Data | 8 |
| 7.0 Assessment of Doses | 9 |
| 7.1 Dose Due to Gaseous Effluents | 9 |
| 7.1.1 Air Doses at the Site Boundary..... | 9 |
| 7.1.2 Maximum Organ Dose to the Critical Receptor | 10 |
| 7.2 Doses Due to Liquid Effluents | 11 |
| 7.3 40 CFR Part 190 Dose Evaluation | 11 |

Table of Contents

| | |
|--|-----------|
| 7.4 Doses to Public Inside the Site Boundary | 12 |
| 8.0 Related Information | 14 |
| 8.1 Changes to the Process Control Program..... | 14 |
| 8.2 Changes to the Offsite Dose Calculation Manual | 14 |
| 8.3 Unavailability of REMP Milk Samples | 14 |
| 8.4 Report of Required Effluent Instrument Inoperability | 14 |
| 8.5 Activity Released Via Secondary Pathways | 15 |
| 8.6 Missed Effluent Samples..... | 15 |
| 8.7 Major Changes to Radioactive Waste Systems | 15 |
| 8.8 Biennial Land Use Census | 15 |
| 8.9 Gaseous Storage Tank Total Radioactivity Limit | 16 |
| 8.10 Unprotected Outside Tank Total Radioactivity Limit | 16 |
| 9.0 Additional Information | 16 |
| 9.1 Reactor Coolant System Average Energy (E-Bar) | 16 |
| 10.0 Tables..... | 17 |
| 11.0 Attachments | 18 |

1.0 Introduction

This Annual Radioactive Effluent Release Report is submitted as required by Waterford 3's Technical Specification 6.9.1.8. It covers the period from January 1, 2005 through December 31, 2005. Information in this report is presented in the format outlined in Appendix B of Regulatory Guide 1.21 and in Section 5.8.1 of the Offsite Dose Calculation Manual (UNT-005-014).

The information contained in this report includes:

- A summary of the quantities of radioactive liquid and gaseous effluents and solid wastes released from the plant during the reporting period.
- A summary of the meteorological data collected during 2005.
- Assessment of radiation doses due to liquid and gaseous radioactive effluents released during 2005.
- A discussion of Unplanned/Abnormal releases that occurred during the reporting period.
- A submittal of changes to the Offsite Dose Calculation Manual and Process Control Program during this reporting period.
- A discussion of why required radioactive effluent monitoring instrumentation was not returned to service within the time specified.
- A discussion of any instances in which effluent samples were not collected within the required frequency.

2.0 Supplemental Information

2.1 Regulatory Limits

The limits applicable to the release of radioactive material in liquid and gaseous effluents are described in the following sections. These limits are addressed by reference in UNT-005-014, Offsite Dose Calculation Manual, and directly in the Technical Requirements Manual (TRM).

2.1.1 Fission and Activation Gases (Noble Gases)

The dose rate due to radioactive noble gases released in gaseous effluents from the site to areas at and beyond the site boundary shall be limited to less than or equal to:

- 500 mrem/yr to the total body; and,
- 3000 mrem/yr to the skin.

The air dose due to noble gases released in gaseous effluents from the site to areas at or beyond the site boundary shall be limited to the following:

- ◆ During any calendar quarter, Less than or equal to:
 - 5 mrad for gamma radiation; and,
 - 10 mrad for beta radiation.
- ◆ During any calendar year, Less than or equal to:
 - 10 mrad for gamma radiation; and,
 - 20 mrad for beta radiation.

2.1.2 Iodines, Particulates with Half Lives > Eight (8) Days, and Tritium

The dose rate due to Iodine-131 and 133, Tritium, and all radionuclides in particulate form with half lives greater than eight (8) days, released in gaseous effluents from the site to areas at and beyond the site boundary, shall be limited to less than or equal to:

- 1500 mrem/yr to any organ.

The dose to a member of the public from Iodine-131 and 133, Tritium, and all radionuclides in particulate form with half lives greater than eight (8) days in gaseous effluents released to areas at and beyond the site boundary shall be limited to the following:

- ◆ During any calendar quarter, Less than or equal to:
 - 7.5 mrem to any organ.
- ◆ During any calendar year, Less than or equal to:
 - 15 mrem to any organ.

2.1.3 Liquid Effluents

The concentration of radioactive material released in liquid effluents to unrestricted areas shall be limited to ten times the concentrations specified in 10 CFR Part 20, Appendix B, Table 2, Column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to $2.0E-4$ $\mu\text{Ci/ml}$ (Total Activity).

The dose or dose commitment to a member of the public from radioactive materials in liquid effluents released to unrestricted areas shall be limited to the following:

During any calendar quarter, Less than or equal to:

- 1.5 mrem to the total body; and,
- 5 mrem to any organ, and

During any calendar year, Less than or equal to

- 3 mrem to the total body; and,
- 10 mrem to any organ.

2.1.4 Uranium Fuel Cycle Sources

The dose or dose commitment to any member of the public due to releases of radioactivity and radiation from uranium fuel cycle sources over 12 consecutive months shall be limited to less than or equal to:

- 25 mrem to the Total Body or any organ (except thyroid organ); and,
- 75 mrem to the Thyroid

2.2 Maximum Permissible Concentrations

2.2.1 Fission and Activation Gases, Iodines, and Particulates, With Half Lives > Eight (8) Days

For gaseous effluents, maximum permissible concentrations are not directly used in release rate calculations since the applicable limits are expressed in terms of dose rate at the site boundary.

2.2.2 Liquid Effluents

Ten times the effluent concentration (EC) values specified in 10 CFR Part 20, Appendix B, Table 2, Column 2 are used as the permissible concentrations of liquid radioactive effluents at the unrestricted area boundary. A value of $2.0E-4$ $\mu\text{Ci/ml}$ is used as the concentration limit for dissolved and entrained noble gases in liquid effluents.

2.3 Average Energy (E-Bar)

This is not applicable to Waterford 3's effluent specifications. E-Bar's are not required to be calculated from effluent release data. The average energy (E-Bar) for the Reactor Coolant System (RCS) is supplied as additional information in the report further below.

2.4 Measurements and Approximations of Total Radioactivity

The quantification of radioactivity in liquid and gaseous effluents was accomplished by performing the sampling and radiological analysis of effluents in accordance with the requirements of Tables 4.11-1 and 4.11-2 of the Technical Requirements Manual (TRM).

2.4.1 Fission and Activation Gases (Noble Gases)

For continuous releases, a gas grab sample was analyzed monthly for noble gases. Each week a Gas Ratio (GR) was calculated according to the following equation:

$$GR = \frac{\text{Average Weekly Noble Gas Monitor Reading}}{\text{Monitor Reading During Noble Gas Sampling}}$$

The monthly sample analysis and weekly Gas Ratio were then used to determine noble gases discharged continuously for the previous week. For gas decay tank and containment purge batch releases, a gas grab sample was analyzed prior to release to determine noble gas concentrations in the batch. In all cases, the total radioactivity in gaseous effluents was determined from measured concentrations of each radionuclide present and the total volume discharged.

2.4.2 Iodines, Particulates, and Tritium

Iodines and particulates discharged were sampled using a continuous sampler which contained a charcoal cartridge and a particulate filter. Each week the charcoal cartridge and particulate filter were analyzed for gamma emitters using gamma spectroscopy. The determined radionuclide concentrations and effluent volumes discharged were used to calculate the previous week's activity released. The particulate samples were composited and analyzed quarterly for Sr-89 and Sr-90 by a contract laboratory (Framatome ANP, Environmental). Particulate gross alpha activity was measured weekly using alpha scintillation or gas-flow proportional counting techniques. The determined activities were used to estimate effluent concentrations in subsequent releases until the next scheduled analysis was performed.

Grab samples of continuous releases were analyzed at least monthly for tritium. Containment Purge batch releases are analyzed prior to release. The determined concentrations were used to estimate tritium activity in subsequent releases until the next scheduled analysis was performed.

2.4.3 Liquid Effluents

For continuous releases, samples were collected weekly and analyzed using gamma spectroscopy. The measured concentrations were used to determine radionuclide concentrations in the following week's releases. For batch releases, gamma analysis was performed on the sample prior to release.

For both continuous and batch releases, composite samples were analyzed quarterly by a contract laboratory (Framatome ANP, Environmental) for Sr-89, Sr-90, and Fe-55. Samples were composited and analyzed monthly for tritium and gross alpha using liquid scintillation and gas flow proportional counting techniques, respectively. For radionuclides measured in the composite samples, the measured concentrations in the composite samples from the previous month or quarter were used to estimate released quantities of these isotopes in liquid effluents during the current month or quarter when the analysis results became available.

The total radioactivity in liquid effluent releases was determined from the measured and estimated concentrations of each radionuclide present and the total volume of the effluent discharged.

2.5 Batch Releases

A summary of information for gaseous and liquid batch releases is included in Table 1.

2.6 Unplanned/Abnormal Releases

2.6.1 Unplanned/Abnormal Gaseous Releases

There were no unplanned/abnormal gaseous releases during the reporting period.

2.6.2 Unplanned/Abnormal Liquid Releases

There were no unplanned/abnormal liquid releases during this reporting period.

3.0 Gaseous Effluents

The quantities of radioactive material released in gaseous effluents are summarized in Tables 1A, 1B, and 1C. Note that there were no elevated releases, since all Waterford 3 releases are considered to be at ground level. The estimated total error in % is based upon several statistical uncertainties due to sample counting, efficiency, volume, etc.

4.0 Liquid Effluents

The quantities of radioactive material released in liquid effluents are summarized in Tables 2A and 2B. The estimated total error in % is based upon several statistical uncertainties due to sample counting, efficiency, volume, etc.

5.0 Solid Wastes

The summary of radioactive solid wastes shipped offsite for disposal is listed in Table 3. For certain waste forms, Waterford 3 uses volume reduction services provided by a contractor. These waste forms are included in Table 3 and the volumes reported reflect the volume of waste shipped offsite, not final disposal volumes. Final disposal volumes for wastes compacted offsite are available upon request. The estimated total error in % is based upon several statistical uncertainties due to sample counting, efficiency, volume, etc.

6.0 Meteorological Data

In Table 4, the hourly meteorological data from January 1, 2005 through December 31, 2005, is presented in the form of a joint frequency distribution of wind speed, wind direction, and atmospheric stability (hourly data is also available upon request). The standard Pasquill classification scheme, as presented in Regulatory Guide 1.23, is used to determine stability class from differential temperature measurements. The Waterford-3 data recovery results by parameter are as follows:

| | |
|--------------------|----------------|
| Differential Temp. | 100.00% |
| Wind Speed | 100.00% |
| Wind Direction | 100.00% |
| Overall* | 100.00% |

* - Simultaneous occurrence of valid data for all three parameters.

Dispersion and deposition values were determined from the 2005 data and used in the assessment of doses due to gaseous effluents released from site during the 2005 period.

7.0 Assessment of Doses

7.1 Dose Due to Gaseous Effluents

7.1.1 Air Doses at the Site Boundary

Air doses from gaseous effluents were evaluated at the closest offsite location that could be occupied continuously during the term of plant operation and that would result in the highest dose. This location was determined by examining the atmospheric dispersion parameters (χ/Q 's) at the closest offsite locations that could be continuously occupied during plant operation in each of the meteorological sectors surrounding the plant. The location that would have the highest dose would be that location having the most restrictive (largest) χ/Q value.

Based on actual meteorological data collected during 2005, this location was determined to be in the NNE and NE sector ($\chi/Q = 2.0E-05 \text{ sec/m}^3$) at a distance of 869 meters (0.54 miles) from the plant. Doses were assessed at this location in accordance with the methodology described in the Waterford 3 Offsite Dose Calculation Manual considering only beta and gamma exposures in air due to noble gas. The results of these assessments for the year 2005 are summarized as follows:

Beta air dose: 0.266 mrad

Gamma air dose: 0.080 mrad

The above Beta and Gamma air doses represent the following percentage of the Annual Dose limits:

1.33% of the Beta air dose limit (20 mrad).

0.80% of the Gamma air dose limit (10 mrad).

Dose calculation results are summarized by quarters in Table 5A. The doses were calculated in accordance with the methodology described in the Waterford 3 Offsite Dose Calculation Manual.

7.1.2 Maximum Organ Dose to the Critical Receptor

The maximum organ dose to a MEMBER OF THE PUBLIC from I-131, I-133, tritium, and all radionuclides in particulate form with half-lives greater than eight (8) days in gaseous effluents released to areas at and beyond the site boundary was determined for 2005.

An assessment of the maximum organ dose was performed for the critical receptor. The critical receptor was assumed to be located at the nearest residence to the plant having the most restrictive atmospheric dispersion (χ/Q) and deposition (D/Q) parameters. Furthermore, it was assumed that the receptor living at this residence consumed food products that were either raised or produced at this residence.

Using land use census and meteorological data for 2005, the residence with the highest χ/Q value ($7.6E-06 \text{ sec/m}^3$) and the highest D/Q value ($1.7E-08 \text{ m}^{-2}$) was determined to be in the NE sector at a distance of 1432 meters (0.89 miles) from the plant. The dose calculation was performed in accordance with the methodology described in the Waterford 3 Offsite Dose Calculation Manual considering the inhalation, ground plane exposure, and ingestion pathways. The maximum organ dose to the critical receptor was determined to be:

0.193 mrem to the infant thyroid.

This represents 1.29% of the Annual Organ Dose limit (15 mrem).

Dose calculation results are summarized by quarters in Table 5A. The doses were calculated in accordance with the methodology described in the Waterford 3 Offsite Dose Calculation Manual.

7.2 Doses Due to Liquid Effluents

The annual doses to the maximum exposed individual, an adult, resulting from exposure to liquid effluents released during 2005 from Waterford 3 were:

8.71E-03 mrem to the Total Body.

1.15E-02 mrem to the maximum exposed organ (Liver).

The above doses represent the following percentage of the Annual Dose limits:

0.29% of the Total Body Dose Limit (3 mrem), and

0.12% of the Organ Dose Limit (10 mrem).

Dose calculation results are summarized by quarter in Table 5B. The doses were calculated in accordance with the methodology described in the Waterford 3 Offsite Dose Calculation Manual.

7.3 40 CFR Part 190 Dose Evaluation

In accordance with Technical Requirements Manual (TRM), Specification 3/4.11.4, Total Dose, dose evaluations to demonstrate compliance with Surveillance Requirements 4.11.4.1 and 4.11.4.2 of the Technical Requirements Manual (TRM), dealing with dose from the uranium fuel cycle, need to be performed only if quarterly doses exceed 3 mrem to the total body (liquid releases), 10 mrem to any organ (liquid releases), 10 mrad gamma air dose, 20 mrad beta air dose, or 15 mrem to any organ from radioiodines and particulates.

At no time during 2005 were any of these limits exceeded; therefore, the evaluation was not required.

7.4 Doses to Public Inside the Site Boundary

The Member of the Public inside the site boundary expected to have the maximum exposure due to gaseous effluents would be an employee at the Waterford 1 and 2 fossil fuel plants, located in the NW sector at a distance of approximately 670 meters (0.42 miles) from the plant.

The doses for such an individual were determined by scaling the full-time occupancy doses due to airborne effluents by the occupancy time due to a normal working year. Based on an assumed occupancy of 25% (40 hour work week) and the fact that all employees are adults, the calculated doses were determined to be less than:

1.44E-03 mrem to the maximum exposed organ (Thyroid)

6.55E-03 mrem to the Total body

1.46E-02 mrem to the skin

After Hurricane Katrina, Entergy provided temporary housing for employees and their families that were displaced by the hurricane. Temporary trailer parks were constructed at two sites within the site boundary.

The first site was located in the South sector at a distance of approximately 500 meters (0.31 miles) from the plant. Employees and their families were allowed to live at the new RV facility starting on September 5, 2005 and terminating on November 30, 2005. The doses for such individuals were determined by scaling the full-time occupancy doses due to airborne effluents by the time the families occupied the park during the year. Based on an assumed occupancy of 24% the calculated annual doses, the actual doses were determined to be less than:

5.90E-03 mrem to the maximum exposed organ (Teen Thyroid)

2.60E-02 mrem to the Total body

6.03E-02 mrem to the skin

The second site was located in the South-Southwest sector at a distance of approximately 1367 meters (0.85 miles) from the plant. Employees and their families were allowed to live at the new RV facility starting on November 1, 2005. Doses for such individuals were determined by scaling the full-time occupancy doses due to airborne effluents by the time the families occupied the park during the year. Based on an assumed occupancy of 17% the calculated annual doses, the actual doses were determined to be less than:

6.59E-04 mrem to the maximum exposed organ (Teen Thyroid)

2.91E-03 mrem to the Total body

6.46E-03 mrem to the skin

Additionally, Entergy set up a temporary staging and housing facility for the hurricane restoration teams working around the New Orleans area. The restoration teams consisted of both Entergy Transmission & Distribution personnel and contract employees. The staging facility was located in the South-Southwest sector at a distance of approximately 1367 meters (0.85 miles) from the plant. Assuming a 12 hour work day and all employees were adults, the doses for such individuals were determined by scaling the full-time occupancy doses due to airborne effluents by the time the workers actually stayed on site. The staging facility was operational for approximately 30 days. Based on an assumed occupancy of 5% the calculated annual doses, the actual doses were determined to be less than:

1.87E-04 mrem to the maximum exposed organ (Thyroid)

8.53E-04 mrem to the Total body

1.90E-03 mrem to the skin

All doses for receptors inside the site boundary were calculated according to the methodology described in the Waterford 3 Offsite Dose Calculation Manual considering only the inhalation and ground plane exposure pathways.

8.0 Related Information

8.1 Changes to the Process Control Program

No changes were made to the Process Control Program in 2005.

8.2 Changes to the Offsite Dose Calculation Manual

The following revision was made to the ODCM during 2005:

Revision 8

- Control Milk location MKR-40 was deleted from the program. Milking cows are no longer available at this location due to owner selling the milk cows.
- Milk location MKR-38 was added to the program as the new control location to replace MKR-40. This new location is acceptable due to its compass direction and distance from the plant .

Two minor changes to the ODCM were also process during 2005.

- Changes were editorial in nature.

A copy of UNT-005-514, "Offsite Dose Calculation Manual" is provided in Attachment 11.1.

8.3 Unavailability of REMP Milk Samples

Due to the unavailability of three milk sampling locations within five kilometers of the plant, Broad Leaf sampling is performed in accordance with Technical Requirements Manual (TRM) Table 3.12-1. Milk is collected, when available, from the control location and one identified sampling location as indicated in UNT-005-014, Offsite Dose Calculation Manual, Attachment 7.13.

8.4 Report of Required Effluent Instrument Inoperability

Technical Requirements Manual (TRM) Specifications 3.3.3.10 and 3.3.3.11 require reporting in the Annual Radioactive Effluent Release Report of why designated inoperable effluent monitoring instrumentation was not restored to operability within the time specified in the Action Statement.

During the reporting period, all instrumentation was restored to operability within the time specified.

8.5 Activity Released Via Secondary Pathways

The following secondary release paths were continuously monitored for radioactivity:

- The Hot Machine Shop Exhaust (AH-35),
- Decontamination Shop Exhaust (AH-34),
- The RAB H&V Equipment Room Ventilation system Exhaust (E-41A and E-41B); and,
- The Switchgear/Cable Vault Area Ventilation System (AH-25).

Continuous sampling for these areas is maintained in order to demonstrate the operability of installed treatment systems and to verify integrity of barriers separating primary and secondary ventilation systems. Sampling for these areas was limited to continuous particulate and iodine sampling and monthly noble gas grab sampling. The activity released via these secondary pathways resulted from routine operations and remained below significant levels.

8.6 Missed Effluent Samples

During the reporting period, no incident occurred for which effluent samples were not sampled and/or analyzed as required by the ODCM/TRM.

8.7 Major Changes to Radioactive Waste Systems

During the reporting period, no major changes were made to any Radioactive Waste Systems. All major changes to Radioactive Waste Systems are included in Waterford 3's FSAR updates.

8.8 Biennial Land Use Census

A land use census was last performed in 2004. The land use census performed in 2004 did not identify the need for any changes to locations being used for effluent dose calculations or radiological environmental sampling.

8.9 Gaseous Storage Tank Total Radioactivity Limit

Technical Specification 3/4.11.2.6 specifies that the quantity of radioactivity contained in each gas storage tank be maintained less than or equal to $8.5E+04$ Curies noble gas (considered as Xe-133 equivalent). At no time during the reporting period was this value exceeded.

8.10 Unprotected Outside Tank Total Radioactivity Limit

Technical Specification 3/4.11.1.4 specifies that the quantity of radioactive material contained in each unprotected outdoor tank be maintained less than or equal to $7.85E-04$ Curies (excluding tritium and dissolved and entrained noble gases). During this reporting period, there were no instances in which this limit was exceeded.

9.0 Additional Information

9.1 Reactor Coolant System Average Energy (E-Bar)

The most recent Reactor Coolant System E-Bar calculation was 0.1197 MeV/Disintegration from a sample obtained on July 22, 2005. Reactor Coolant System E-Bar is supplied for information only and is not used for effluent dose calculations.

10.0 Tables

| | |
|---|----|
| Table 1, Batch Release Summary | 19 |
| Table 1A, Annual Summation of All Releases by Quarter All Airborne Effluents | 20 |
| Table 1B, Annual Airborne Continuous Elevated and Ground Level Releases Totals for Each Nuclide Released | 21 |
| Table 1C, Annual Airborne Batch Elevated and Ground Level Releases Totals for Each Nuclide Released | 22 |
| Table 2A, Annual Summation of All Releases by Quarter All Liquid Effluents..... | 23 |
| Table 2B, Annual Liquid Continuous and Batch Releases Totals for Each Nuclide Released | 24 |
| Table 3, Solid Waste Shipped Offsite for Burial or Disposal..... | 25 |
| Table 4, Joint Frequency Distribution of Meteorological Data | 32 |
| Table 5A, Doses Due to Gaseous Radioactive Effluents..... | 36 |
| Table 5B, Doses Due to Liquid Radioactive Effluents | 37 |

11.0 Attachments

Attachment 11.1, Copy of UNT-005-514, "Offsite Dose Calculation Manual" Revision 8 Change 1 & 2.

Table 1
Batch Release Summary

Batch Release Summary information for 2005 Report Period.

| | | |
|-----------------------------|---|--------------------------|
| Report Category | : | Batch Release Summary |
| Release Point | : | All |
| Type of Release | : | Batch Liquid and Gaseous |
| Period Start Time | : | 01-jan-2005 00:00:00 |
| Period End Time | : | 31-dec-2005 23:59:59 |
| Liquid Releases | | |
| Number of Releases | : | 91 |
| Total Time for All Releases | : | 25711.1 Minutes |
| Maximum Time for a Release | : | 352.0 Minutes |
| Average Time for a Release | : | 282.5 Minutes |
| Minimum Time for a Release | : | 110.0 Minutes |
| Average Stream Flow | : | 739361.4 GPM |
| Gaseous Releases | | |
| Number of Releases | : | 6 |
| Total Time for All Releases | : | 2528.0 Minutes |
| Maximum Time for a Release | : | 600.0 Minutes |
| Average Time for a Release | : | 421.3 Minutes |
| Minimum Time for a Release | : | 8.0 Minutes |

Batch Release Summary information for 2005 by Quarter.

| | | | | | |
|-----------------------------|---|--------------------------|----------|----------|----------------|
| Report Category | : | Batch Release Summary | | | |
| Release Point | : | All | | | |
| Type of Release | : | Batch Liquid and Gaseous | | | |
| Period Start Time | : | 01-jan-2005 00:00:00 | | | |
| Period End Time | : | 31-dec-2005 23:59:59 | | | |
| Liquid Releases | | | | | |
| | | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 |
| Number of Releases | : | 17 | 35 | 21 | 18 |
| Total Time for All Releases | : | 4810.0 | 9975.0 | 5666.1 | 5260.0 Minutes |
| Maximum Time for a Release | : | 325.0 | 352.0 | 302.0 | 323.0 Minutes |
| Average Time for a Release | : | 282.9 | 285.0 | 269.8 | 292.2 Minutes |
| Minimum Time for a Release | : | 215.0 | 186.0 | 110.0 | 230.0 Minutes |
| Average Stream Flow | : | 763972.5 | 630804.2 | 899665.5 | 750042.5 GPM |
| Gaseous Releases | | | | | |
| | | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 |
| Number of Releases | : | 0 | 4 | 2 | 0 |
| Total Time for All Releases | : | 0.0 | 1489.0 | 1039.0 | 0.0 Minutes |
| Maximum Time for a Release | : | 0.0 | 600.0 | 600.0 | 0.0 Minutes |
| Average Time for a Release | : | 0.0 | 372.2 | 519.5 | 0.0 Minutes |
| Minimum Time for a Release | : | 0.0 | 8.0 | 439.0 | 0.0 Minutes |

Table 1A
Annual Summation of All Releases by Quarter
All Airborne Effluents

Report Category : Summation of All Releases
 Type of Activity : All Airborne Effluents
 Period Start Time : 01-jan-2005 00:00:00
 Period End Time : 31-dec-2005 23:59:59

| Type of Effluent | Units | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Est.Total Error % |
|--|---------|----------|----------|----------|----------|----------------------|
| A. Fission and Activation Gases | | | | | | |
| 1. Total Release | Curies | 1.29e+02 | 2.35e+02 | 3.35e-01 | 0.00e+00 | 1.50e+01 |
| 2. Average Release Rate for Period | uCi/sec | 1.66e+01 | 2.99e+01 | 4.21e-02 | 0.00e+00 | |
| 3. Percent of Applicable Limit | % | n/a | n/a | n/a | n/a | |
| B. Radioiodines | | | | | | |
| 1. Total Iodine-131 | Curies | 1.06e-07 | 3.10e-04 | 2.12e-06 | 0.00e+00 | 1.50e+01 |
| 2. Average Release Rate for Period | uCi/sec | 1.36e-08 | 3.94e-05 | 2.66e-07 | 0.00e+00 | |
| 3. Percent of Applicable Limit | % | n/a | n/a | n/a | n/a | |
| C. Particulates | | | | | | |
| 1. Particulates (Half-lives > 8 Days) | Curies | 0.00e+00 | 1.82e-05 | 0.00e+00 | 0.00e+00 | 1.50e+01 |
| 2. Average Release Rate for Period | uCi/sec | 0.00e+00 | 2.32e-06 | 0.00e+00 | 0.00e+00 | |
| 3. Percent of Applicable Limit | % | n/a | n/a | n/a | n/a | |
| 1. Gross Alpha Radioactivity | Curies | 3.24e-07 | 1.33e-06 | 6.01e-07 | 6.12e-07 | 1.50e+01 |
| D. Tritium | | | | | | |
| 1. Total Release | Curies | 5.49e+00 | 7.80e+00 | 1.03e+01 | 1.12e+01 | 1.50e+01 |
| 2. Average Release Rate for Period | uCi/sec | 7.06e-01 | 9.92e-01 | 1.29e+00 | 1.41e+00 | |
| 3. Percent of Applicable Limit | % | n/a | n/a | n/a | n/a | |

Table 1B
Annual Airborne Continuous Elevated and Ground Level Releases
Totals for Each Nuclide Released

Report Category : Airborne Continuous Elevated and Ground Level Releases.
: Totals for Each Nuclide Released.
Type of Activity : Fission Gases, Iodines, and Particulates
Period Start Time : 01-jan-2005 00:00:00
Period End Time : 31-dec-2005 23:59:59

| Nuclide | Units | Elevated Releases | | | | Ground Releases | | | |
|-------------------------------------|---------------|-------------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|
| | | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 |
| Fission and Activation Gases | | | | | | | | | |
| Xe-133 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.24e+02 | 1.13e+02 | 0.00e+00 | 0.00e+00 |
| Xe-133m | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.88e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Xe-135 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.40e+00 | 1.13e+00 | 0.00e+00 | 0.00e+00 |
| Total for Period | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.29e+02 | 1.14e+02 | 0.00e+00 | 0.00e+00 |
| Radioiodines | | | | | | | | | |
| I-131 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.40e-08 | 3.10e-04 | 2.12e-06 | 0.00e+00 |
| I-133 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.21e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Total for Period | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.06e-07 | 3.10e-04 | 2.12e-06 | 0.00e+00 |
| Particulates | | | | | | | | | |
| H-3 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.49e+00 | 7.79e+00 | 7.90e+00 | 1.12e+01 |
| Co-58 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.09e-06 | 0.00e+00 | 0.00e+00 |
| Co-60 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.63e-07 | 0.00e+00 | 0.00e+00 |
| Zr-95 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.13e-07 | 0.00e+00 | 0.00e+00 |
| Nb-95 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.50e-07 | 0.00e+00 | 0.00e+00 |
| Ru-103 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.67e-07 | 0.00e+00 | 0.00e+00 |
| Cs-137 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.17e-07 | 0.00e+00 | 0.00e+00 |
| Os-191 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.49e-05 | 0.00e+00 | 0.00e+00 |
| Gamma | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.24e-07 | 1.33e-06 | 6.01e-07 | 6.12e-07 |
| Total for Period | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.49e+00 | 7.79e+00 | 7.90e+00 | 1.12e+01 |

Table 1C
Annual Airborne Batch Elevated and Ground Level Releases
Totals for Each Nuclide Released

Report Category : Airborne Batch Elevated and Ground Level Releases.
: Totals for Each Nuclide Released.
Type of Activity : Fission Gases, Iodines, and Particulates
Period Start Time : 01-jan-2005 00:00:00
Period End Time : 31-dec-2005 23:59:59

| Nuclide | Units | Elevated Releases | | | | Ground Releases | | | |
|-------------------------------------|---------------|-------------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|
| | | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 |
| Fission and Activation Gases | | | | | | | | | |
| Ar-41 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.29e-01 | 0.00e+00 | 0.00e+00 |
| Kr-85 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.16e+01 | 0.00e+00 | 0.00e+00 |
| Xe-131m | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.71e-01 | 4.23e-02 | 0.00e+00 |
| Xe-133 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.79e+01 | 3.29e-01 | 0.00e+00 |
| Xe-133m | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.71e-01 | 5.52e-03 | 0.00e+00 |
| Xe-135 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.56e-02 | 0.00e_00 | 0.00e+00 |
| Total for Period | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.21e+02 | 3.35e-01 | 0.00e+00 |
| Radioiodines | | | | | | | | | |
| None | | | | | | | | | |
| Particulates | | | | | | | | | |
| H-3 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.80e-03 | 2.35e+00 | 0.00e+00 |
| Total for Period | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.80e-03 | 2.35e+00 | 0.00e+00 |

Table 2A
Annual Summation of All Releases by Quarter
All Liquid Effluents

| Report Category : Summation of All Releases | | | | | | |
|---|---------|----------|----------|----------|----------|-------------------|
| Type of Activity : All Liquid Effluents | | | | | | |
| Period Start Time : 01-jan-2005 00:00:00 | | | | | | |
| Period End Time : 31-dec-2005 23:59:59 | | | | | | |
| Type of Effluent | Units | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Est.Total Error % |
| A. Fission and Activation Products | | | | | | |
| 1. Total Release (Not Including Tritium, Gases, and Alpha | Curies | 1.68e-03 | 6.10e-02 | 5.38e-03 | 1.66e-02 | 1.50e+01 |
| 2. Average Diluted Concentration During Period | uCi/sec | 1.84e-12 | 1.23e-10 | 6.05e-12 | 2.35e-11 | |
| 3. Percent of Applicable Limit | % | n/a | n/a | n/a | n/a | |
| B. Tritium | | | | | | |
| 1. Total Release | Curies | 1.49e+02 | 2.65e+02 | 8.51e+01 | 2.01e+02 | 1.50e+01 |
| 2. Average Diluted Concentration During Period | uCi/sec | 1.64e-07 | 5.33e-07 | 9.57e-08 | 2.85e-07 | |
| 3. Percent of Applicable Limit | % | n/a | n/a | n/a | n/a | |
| C. Dissolved and Entrained Gases | | | | | | |
| 1. Total Release | Curies | 7.84e-01 | 1.17e+00 | 4.57e-04 | 9.91e-04 | 1.50e+01 |
| 2. Average Diluted Concentration During Period | uCi/sec | 8.62e-10 | 2.36e-09 | 5.13e-13 | 1.41e-12 | |
| 3. Percent of Applicable Limit | % | n/a | n/a | n/a | n/a | |
| D. Gross Alpha Radioactivity | | | | | | |
| 1. Total Release | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.50e+01 |
| E. Waste Volume Released (Pre-Dilution) | | | | | | |
| F. Volume of Dilution Water Used | Liters | 1.32e+07 | 2.46e+07 | 1.48e+07 | 1.07e+07 | 1.50e+01 |
| | Liters | 9.09e+11 | 4.97e+11 | 8.89e+11 | 7.04e+11 | 1.50e+01 |

Table 2B
Annual Liquid Continuous and Batch Releases
Totals for Each Nuclide Released

| Report Category : Liquid Continuous and Batch Releases. : Totals for Each Nuclide Released. | | | | | | | | | |
|--|---------------|---------------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|
| Type of Activity : All Radionuclides | | | | | | | | | |
| Period Start Time : 01-jan-2005 00:00:00 | | | | | | | | | |
| Period End Time : 31-dec-2005 23:59:59 | | | | | | | | | |
| Nuclide | Units | Continuous Releases | | | | Batch Releases | | | |
| | | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 |
| All Nuclides | | | | | | | | | |
| H-3 | Curies | 4.07e-01 | 3.21e-01 | 1.26e-01 | 1.59e-01 | 1.49e+02 | 2.65e+02 | 8.50e+01 | 2.00e+02 |
| Ar-41 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.83e-06 | 2.21e-06 | 0.00e+00 | 0.00e+00 |
| Cr-51 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.52e-04 | 8.84e-04 | 2.16e-03 |
| Mn-54 | Curies | 0.00e+00 | 0.00e+00 | 8.25e-05 | 0.00e+00 | 2.29e-05 | 4.81e-05 | 4.65e-05 | 6.44e-04 |
| Fe-55 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.09e-04 | 8.40e-04 | 1.29e-03 | 5.91e-04 |
| Fe-59 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.22e-05 | 2.76e-04 | 8.81e-04 |
| Co-57 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.66e-04 | 7.19e-07 | 1.01e-05 |
| Co-58 | Curies | 0.00e+00 | 0.00e+00 | 1.64e-04 | 0.00e+00 | 9.83e-05 | 5.54e-02 | 1.56e-03 | 3.13e-03 |
| Co-60 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.93e-04 | 1.08e-03 | 1.49e-04 | 1.33e-03 |
| Ni-56 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.70e-06 |
| Zn-65 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.48e-05 |
| Kr-85 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.05e-02 | 7.66e-02 | 3.13e-04 | 0.00e+00 |
| Kr-85m | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.36e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Kr-88 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.95e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-88 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.19e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zr-95 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.48e-06 | 2.18e-04 | 1.16e-04 | 2.34e-03 |
| Nb-95 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.08e-06 | 2.95e-04 | 1.77e-04 | 4.23e-03 |
| Ag-110m | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.62e-06 | 1.09e-04 | 2.99e-06 | 6.57e-06 |
| Sn-113 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.76e-04 |
| Sb-122 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.13e-05 | 0.00e+00 | 0.00e+00 |
| Sb-124 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.42e-04 | 0.00e+00 | 0.00e+00 |
| Sb-125 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.33e-04 | 1.79e-03 | 5.29e-04 | 1.06e-03 |
| Sb-126 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.07e-05 | 0.00e+00 | 0.00e+00 |
| Sb-127 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.57e-05 | 0.00e+00 | 0.00e+00 |
| I-131 | Curies | 0.00e+00 | 7.81e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.32e-04 | 0.00e+00 | 0.00e+00 |
| Xe-131m | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.89e-03 | 1.61e-02 | 0.00e+00 | 0.00e+00 |
| Xe-133 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.69e-01 | 1.07e+00 | 1.44e-04 | 9.51e-04 |
| Xe-133m | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.75e-03 | 5.97e-03 | 0.00e+00 | 0.00e+00 |
| Xe-135 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.89e-03 | 6.93e-04 | 0.00e+00 | 3.96e-05 |
| Cs-134 | Curies | 0.00e+00 | 0.00e+00 | 2.77e-05 | 0.00e+00 | 8.38e-05 | 9.71e-06 | 0.00e+00 | 0.00e+00 |
| Cs-137 | Curies | 0.00e+00 | 0.00e+00 | 5.30e-05 | 0.00e+00 | 9.23e-05 | 1.57e-05 | 3.45e-06 | 0.00e+00 |
| La-140 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.60e-05 | 0.00e+00 |
| Ce-141 | Curies | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.72e-06 |
| Total for Period | Curies | 4.07e-01 | 3.21e-01 | 1.27e-01 | 1.59e-01 | 1.50e+02 | 2.66e+02 | 8.50e+01 | 2.00e+02 |

Table 3
Solid Waste Shipped Offsite for Burial or Disposal

SUMMARY BY MAJOR WASTE TYPES

Waste Stream : Resins, Filters, and Evaporator Bottoms ♦

| Waste Class | Volume | | Curies Shipped | % Error (Ci) |
|-------------|-----------------|----------------|----------------|--------------|
| | Ft ³ | M ³ | | |
| A | 1.19E+03 | 3.37E+01 | 4.92E+00 | +/- 25% |
| B | 2.41E+02 | 6.81E+00 | 6.50E+02 | +/- 25% |
| C | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/- 25% |
| All | 1.43E+03 | 4.05E+01 | 6.55E+02 | +/- 25% |

Waste Stream : Dry Active Waste ♣

| Waste Class | Volume | | Curies Shipped | %Error (Ci) |
|-------------|-----------------|----------------|----------------|-------------|
| | Ft ³ | M ³ | | |
| A | 1.41E+04 | 3.99E+02 | 1.47E+00 | +/-25% |
| B | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/-25% |
| C | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/-25% |
| All | 1.41E+04 | 3.99E+02 | 1.47E+00 | +/-25% |

Waste Stream : Irradiated Components

| Waste Class | Volume | | Curies Shipped | % Error (Ci) |
|-------------|-----------------|----------------|----------------|--------------|
| | Ft ³ | M ³ | | |
| A | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/-25% |
| B | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/-25% |
| C | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/-25% |
| All | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/-25% |

Waste Stream : Other Waste (Combined Packages)

| Waste Class | Volume | | Curies Shipped | % Error (Ci) |
|-------------|-----------------|----------------|----------------|--------------|
| | Ft ³ | M ³ | | |
| A | 1.41E+03 | 3.99E+01 | 8.19E-04 | +/-25% |
| B | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/-25% |
| C | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/-25% |
| All | 1.41E+03 | 3.99E+01 | 8.19E-04 | +/-25% |

Waste Stream : Sum of All 4 Categories

| Waste Class | Volume | | Curies Shipped | % Error (Ci) |
|-------------|-----------------|----------------|----------------|--------------|
| | Ft ³ | M ³ | | |
| A | 1.67E+04 | 4.73E+02 | 6.40E+00 | +/-25% |
| B | 2.41E+02 | 6.81E+00 | 6.50E+02 | +/-25% |
| C | 0.00E+00 | 0.00E+00 | 0.00E+00 | +/-25% |
| All | 1.69E+04 | 4.80E+02 | 6.57E+02 | +/-25% |

♣ Activity determined by estimations

♦ Activity determined by measurements

Estimate of major nuclide composition (by waste type)

Waste Stream : Resins, Filters, and Evap Bottoms

| Nuclide Name | Percent Abundance | Curies |
|--------------|-------------------|----------|
| H-3 | 0.011% | 7.35E-02 |
| Mn-54 | 2.516% | 1.65E+01 |
| Fe-55 | 8.494% | 5.57E+01 |
| Fe-59 | 0.043% | 2.79E-01 |
| Co-57 | 0.228% | 1.50E+00 |
| Co-58 | 48.742% | 3.19E+02 |
| Co-60 | 1.568% | 1.03E+01 |
| Ni-63 | 6.906% | 4.52E+01 |
| Zn-65 | 0.061% | 3.98E-01 |
| Sr-90 | 0.058% | 3.77E-01 |
| Zr-95 | 0.021% | 1.36E-01 |
| Ag-110m | 0.011% | 7.12E-02 |
| Sn-113 | 0.019% | 1.22E-01 |
| Sb-124 | 0.047% | 3.06E-01 |
| Sb-125 | 0.533% | 3.50E+00 |
| Cs-134 | 14.515% | 9.51E+01 |
| Cs-137 | 15.621% | 1.02E+02 |
| Ce-144 | 0.601% | 3.94E+00 |
| Pu-238 | 0.000% | 8.84E-04 |
| Pu-239 | 0.000% | 3.30E-04 |
| Pu-241 | 0.005% | 3.33E-02 |
| Am-241 | 0.000% | 6.60E-04 |
| Cm-242 | 0.000% | 5.73E-04 |
| Cm-243 | 0.000% | 1.55E-03 |

Estimate of major nuclide composition (by waste type)

Waste Stream : Dry Active Waste

| Nuclide Name | Percent Abundance | Curies |
|--------------|-------------------|----------|
| H-3 | 1.012% | 1.49E-02 |
| Mn-54 | 2.805% | 4.13E-02 |
| Fe-55 | 37.381% | 5.51E-01 |
| Co-57 | 0.259% | 3.81E-03 |
| Co-58 | 7.296% | 1.08E-01 |
| Co-60 | 9.535% | 1.41E-01 |
| Ni-63 | 20.534% | 3.03E-01 |
| Sr-90 | 0.237% | 3.49E-03 |
| Zr-95 | 1.568% | 2.31E-02 |
| Ag-110m | 1.296% | 1.91E-02 |
| Sb-125 | 0.526% | 7.75E-03 |
| Cs-134 | 6.017% | 8.87E-02 |
| Cs-137 | 11.434% | 1.68E-01 |
| Ce-144 | 0.086% | 1.26E-03 |
| Pu-238 | 0.002% | 2.66E-05 |
| Pu-239 | 0.001% | 1.67E-05 |
| Am-241 | 0.001% | 2.00E-05 |
| Cm-242 | 0.003% | 4.77E-05 |
| Cm-243 | 0.007% | 1.06E-04 |

Estimate of major nuclide composition (by waste type)

Waste Stream : Irradiated Components

N/A - None Shipped in 2005.

Estimate of major nuclide composition (by waste type)**Waste Stream : Other Waste (Combined Packages)**

| Nuclide Name | Percent Abundance | Curies |
|--------------|-------------------|----------|
| H-3 | 0.677% | 5.55E-06 |
| Mn-54 | 2.235% | 1.83E-05 |
| Fe-55 | 27.473% | 2.25E-04 |
| Co-57 | 0.363% | 2.97E-06 |
| Co-58 | 9.261% | 7.59E-05 |
| Co-60 | 6.716% | 5.50E-05 |
| Ni-63 | 14.632% | 1.20E-04 |
| Sr-90 | 0.196% | 1.61E-06 |
| Zr-95 | 2.078% | 1.70E-05 |
| Ag-110m | 1.079% | 8.84E-06 |
| Sb-125 | 0.605% | 4.95E-06 |
| I-131 | 0.000% | 2.33E-09 |
| Cs-134 | 15.678% | 1.28E-04 |
| Cs-137 | 18.521% | 1.52E-04 |
| Ce-144 | 0.471% | 3.86E-06 |
| Pu-238 | 0.001% | 1.04E-08 |
| Pu-239 | 0.001% | 6.33E-09 |
| Pu-241 | 0.004% | 2.92E-08 |
| Am-241 | 0.001% | 7.83E-09 |
| Cm-242 | 0.003% | 2.49E-08 |
| Cm-243 | 0.005% | 3.99E-08 |

Estimate of major nuclide composition (by waste type)

Waste Stream : Sum of All 4 Categories

| Nuclide Name | Percent Abundance | Curies |
|--------------|-------------------|----------|
| H-3 | 0.013% | 8.84E-02 |
| Mn-54 | 2.517% | 1.65E+01 |
| Fe-55 | 8.559% | 5.62E+01 |
| Fe-59 | 0.042% | 2.79E-01 |
| Co-57 | 0.228% | 1.50E+00 |
| Co-58 | 48.649% | 3.19E+02 |
| Co-60 | 1.586% | 1.04E+01 |
| Ni-63 | 6.936% | 4.55E+01 |
| Zn-65 | 0.061% | 3.98E-01 |
| Sr-90 | 0.058% | 3.80E-01 |
| Zr-95 | 0.024% | 1.59E-01 |
| Ag-110m | 0.014% | 9.03E-02 |
| Sn-113 | 0.019% | 1.22E-01 |
| Sb-124 | 0.047% | 3.06E-01 |
| Sb-125 | 0.533% | 3.50E+00 |
| I-131 | 0.000% | 2.33E-09 |
| Cs-134 | 14.496% | 9.52E+01 |
| Cs-137 | 15.611% | 1.03E+02 |
| Ce-144 | 0.600% | 3.94E+00 |
| Pu-238 | 0.000% | 9.11E-04 |
| Pu-239 | 0.000% | 3.46E-04 |
| Pu-241 | 0.005% | 3.33E-02 |
| Am-241 | 0.000% | 6.80E-04 |
| Cm-242 | 0.000% | 6.21E-04 |
| Cm-243 | 0.000% | 1.66E-03 |

Solid Waste Disposition

| Number of Shipments | Mode of Transportation | Destination |
|---------------------|----------------------------|------------------------------|
| 5 | Hittman Transport Services | Duratek, Bear Creek |
| 3 | Race Logistic, LLC | RACE, LLC |
| 4 | Hittman Transport Services | Studsvik Processing Facility |

Irradiated Fuel Shipments (Disposition)

| Number of Shipments | Mode of Transportation | Destination |
|---------------------|------------------------|-------------|
| None | N/A | N/A |

Table 4
Joint Frequency Distribution of Meteorological Data

JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND DIRECTION IN HOURS 01/01/2005 00:00:00 TO 12/31/2005 23:59:59 PASQUILL CLASS A

| Wind Direction | Wind Speed (M/S) at 10-m Level | | | | | | | | | | | Total | |
|----------------|--------------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|-----------|-------|-------|
| | .22-.50 | .51-.75 | .76-1.0 | 1.1-1.5 | 1.6-2.0 | 2.1-3.0 | 3.1-5.0 | 5.1-7.0 | 7.1-10. | 10.1-13 | 13.1-18.0 | | >18.0 |
| N | 0 | 0 | 0 | 0 | 0 | 5 | 24 | 11 | 4 | 0 | 0 | 0 | 44 |
| NNE | 0 | 0 | 0 | 0 | 0 | 3 | 37 | 12 | 1 | 0 | 0 | 0 | 53 |
| NE | 0 | 0 | 0 | 1 | 0 | 16 | 122 | 24 | 0 | 0 | 0 | 0 | 163 |
| ENE | 0 | 0 | 0 | 0 | 0 | 1 | 6 | 5 | 1 | 0 | 0 | 0 | 13 |
| E | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 2 |
| ESE | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 1 | 0 | 0 | 0 | 0 | 3 |
| SE | 0 | 0 | 0 | 0 | 0 | 2 | 16 | 4 | 0 | 0 | 0 | 0 | 22 |
| SSE | 0 | 0 | 0 | 0 | 0 | 0 | 22 | 1 | 0 | 0 | 0 | 0 | 23 |
| S | 0 | 0 | 0 | 0 | 1 | 6 | 11 | 4 | 6 | 0 | 0 | 0 | 28 |
| SSW | 0 | 0 | 0 | 0 | 2 | 6 | 5 | 6 | 1 | 0 | 0 | 0 | 20 |
| SW | 0 | 0 | 0 | 0 | 0 | 5 | 13 | 13 | 0 | 0 | 0 | 0 | 31 |
| WSW | 0 | 0 | 0 | 0 | 1 | 0 | 11 | 1 | 0 | 0 | 0 | 0 | 13 |
| W | 0 | 0 | 0 | 0 | 1 | 3 | 17 | 1 | 0 | 0 | 0 | 0 | 22 |
| WNW | 0 | 0 | 0 | 0 | 0 | 4 | 12 | 3 | 0 | 0 | 0 | 0 | 19 |
| NW | 0 | 0 | 0 | 0 | 0 | 2 | 13 | 5 | 0 | 0 | 0 | 0 | 20 |
| NNW | 0 | 0 | 0 | 0 | 0 | 2 | 25 | 28 | 6 | 0 | 0 | 0 | 61 |
| Total | 0 | 0 | 0 | 1 | 5 | 57 | 336 | 119 | 19 | 0 | 0 | 0 | 537 |

Number of calms for A Stability: 0

JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND DIRECTION IN HOURS 01/01/2005 00:00:00 TO 12/31/2005 23:59:59 PASQUILL CLASS B

| Wind Direction | Wind Speed (M/S) at 10-m Level | | | | | | | | | | | Total | |
|----------------|--------------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|-----------|-------|-------|
| | .22-.50 | .51-.75 | .76-1.0 | 1.1-1.5 | 1.6-2.0 | 2.1-3.0 | 3.1-5.0 | 5.1-7.0 | 7.1-10. | 10.1-13 | 13.1-18.0 | | >18.0 |
| N | 0 | 0 | 0 | 1 | 5 | 17 | 10 | 1 | 1 | 0 | 0 | 0 | 35 |
| NNE | 0 | 0 | 0 | 0 | 1 | 14 | 16 | 9 | 1 | 0 | 0 | 0 | 41 |
| NE | 0 | 0 | 0 | 0 | 0 | 37 | 99 | 8 | 1 | 0 | 0 | 0 | 145 |
| ENE | 0 | 0 | 0 | 0 | 0 | 8 | 7 | 6 | 1 | 0 | 0 | 0 | 22 |
| E | 0 | 0 | 0 | 0 | 0 | 1 | 4 | 0 | 0 | 0 | 0 | 0 | 5 |
| ESE | 0 | 0 | 0 | 0 | 0 | 0 | 9 | 2 | 0 | 0 | 0 | 0 | 11 |
| SE | 0 | 0 | 0 | 0 | 0 | 3 | 19 | 7 | 1 | 0 | 0 | 0 | 30 |
| SSE | 0 | 0 | 0 | 0 | 1 | 9 | 29 | 3 | 0 | 0 | 0 | 0 | 42 |
| S | 0 | 0 | 0 | 0 | 1 | 5 | 9 | 7 | 0 | 0 | 0 | 0 | 22 |
| SSW | 0 | 0 | 0 | 0 | 1 | 7 | 8 | 4 | 2 | 0 | 0 | 0 | 22 |
| SW | 0 | 0 | 0 | 0 | 1 | 10 | 12 | 6 | 0 | 0 | 0 | 0 | 29 |
| WSW | 0 | 0 | 0 | 0 | 1 | 10 | 15 | 3 | 0 | 0 | 0 | 0 | 29 |
| W | 0 | 0 | 0 | 0 | 1 | 2 | 15 | 4 | 0 | 0 | 0 | 0 | 22 |
| WNW | 0 | 0 | 0 | 1 | 0 | 8 | 8 | 1 | 0 | 0 | 0 | 0 | 18 |
| NW | 0 | 0 | 0 | 0 | 0 | 4 | 6 | 1 | 0 | 0 | 0 | 0 | 11 |
| NNW | 0 | 0 | 0 | 0 | 1 | 12 | 23 | 11 | 0 | 0 | 0 | 0 | 47 |
| Total | 0 | 0 | 0 | 2 | 13 | 147 | 289 | 73 | 7 | 0 | 0 | 0 | 531 |

Number of calms for B Stability: 0

Table 4
Joint Frequency Distribution of Meteorological Data

JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND DIRECTION IN HOURS 01/01/2005 00:00:00 TO 12/31/2005 23:59:59 PASQUILL CLASS C

| Wind Direction | Wind Speed (M/S) at 10-m Level | | | | | | | | | | | | Total |
|----------------|--------------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|-----------|-------|-------|
| | .22-.50 | .51-.75 | .76-1.0 | 1.1-1.5 | 1.6-2.0 | 2.1-3.0 | 3.1-5.0 | 5.1-7.0 | 7.1-10. | 10.1-13 | 13.1-18.0 | >18.0 | |
| N | 0 | 0 | 0 | 1 | 10 | 16 | 13 | 8 | 1 | 0 | 0 | 0 | 49 |
| NNE | 0 | 0 | 0 | 0 | 4 | 15 | 16 | 5 | 0 | 0 | 1 | 0 | 41 |
| NE | 0 | 0 | 0 | 1 | 3 | 34 | 80 | 15 | 1 | 0 | 0 | 0 | 134 |
| ENE | 0 | 0 | 0 | 0 | 0 | 1 | 9 | 5 | 0 | 0 | 0 | 0 | 15 |
| E | 0 | 0 | 0 | 0 | 2 | 4 | 4 | 1 | 1 | 0 | 0 | 0 | 12 |
| ESE | 0 | 0 | 0 | 0 | 1 | 5 | 6 | 2 | 1 | 0 | 0 | 0 | 16 |
| SE | 0 | 0 | 0 | 0 | 2 | 9 | 15 | 6 | 1 | 0 | 0 | 0 | 33 |
| SSE | 0 | 0 | 0 | 1 | 1 | 8 | 26 | 5 | 0 | 0 | 0 | 0 | 41 |
| S | 0 | 0 | 0 | 3 | 1 | 8 | 20 | 9 | 5 | 0 | 0 | 0 | 46 |
| SSW | 0 | 0 | 0 | 0 | 2 | 6 | 6 | 9 | 2 | 0 | 0 | 0 | 25 |
| SW | 0 | 0 | 0 | 0 | 5 | 9 | 9 | 3 | 0 | 0 | 0 | 0 | 26 |
| WSW | 0 | 0 | 0 | 2 | 7 | 10 | 8 | 3 | 0 | 0 | 0 | 0 | 30 |
| W | 0 | 0 | 0 | 1 | 4 | 11 | 6 | 2 | 0 | 0 | 0 | 0 | 24 |
| WNW | 0 | 0 | 0 | 0 | 4 | 13 | 6 | 1 | 0 | 0 | 0 | 0 | 24 |
| NW | 0 | 0 | 0 | 0 | 3 | 16 | 5 | 1 | 0 | 0 | 0 | 0 | 25 |
| NNW | 0 | 0 | 0 | 0 | 3 | 19 | 12 | 11 | 0 | 0 | 0 | 0 | 45 |
| Total | 0 | 0 | 0 | 9 | 52 | 184 | 241 | 86 | 13 | 0 | 1 | 0 | 586 |

Number of calms for C Stability: 0

JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND DIRECTION IN HOURS 01/01/2005 00:00:00 TO 12/31/2005 23:59:59 PASQUILL CLASS D

| Wind Direction | Wind Speed (M/S) at 10-m Level | | | | | | | | | | | | Total |
|----------------|--------------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|-----------|-------|-------|
| | .22-.50 | .51-.75 | .76-1.0 | 1.1-1.5 | 1.6-2.0 | 2.1-3.0 | 3.1-5.0 | 5.1-7.0 | 7.1-10. | 10.1-13 | 13.1-18.0 | >18.0 | |
| N | 0 | 1 | 1 | 17 | 30 | 56 | 92 | 100 | 23 | 0 | 1 | 3 | 324 |
| NNE | 0 | 0 | 1 | 16 | 27 | 65 | 90 | 43 | 0 | 0 | 2 | 0 | 244 |
| NE | 0 | 0 | 2 | 9 | 24 | 89 | 219 | 75 | 8 | 2 | 1 | 0 | 429 |
| ENE | 0 | 0 | 0 | 10 | 12 | 22 | 50 | 58 | 11 | 2 | 0 | 0 | 165 |
| E | 0 | 0 | 0 | 3 | 2 | 11 | 22 | 17 | 7 | 0 | 0 | 0 | 62 |
| ESE | 0 | 0 | 1 | 1 | 3 | 8 | 55 | 40 | 3 | 2 | 0 | 0 | 113 |
| SE | 0 | 0 | 1 | 2 | 3 | 13 | 71 | 34 | 3 | 2 | 0 | 0 | 129 |
| SSE | 0 | 0 | 1 | 2 | 10 | 40 | 97 | 17 | 3 | 3 | 0 | 0 | 173 |
| S | 0 | 1 | 1 | 7 | 10 | 33 | 81 | 38 | 20 | 3 | 0 | 0 | 194 |
| SSW | 0 | 0 | 1 | 9 | 16 | 30 | 50 | 28 | 1 | 0 | 0 | 0 | 135 |
| SW | 0 | 0 | 1 | 17 | 19 | 26 | 40 | 9 | 1 | 0 | 0 | 0 | 113 |
| WSW | 0 | 0 | 4 | 14 | 19 | 39 | 21 | 1 | 2 | 0 | 0 | 0 | 100 |
| W | 0 | 0 | 2 | 15 | 21 | 31 | 21 | 1 | 0 | 0 | 0 | 0 | 91 |
| WNW | 0 | 1 | 1 | 8 | 12 | 33 | 37 | 1 | 0 | 1 | 1 | 0 | 95 |
| NW | 0 | 1 | 1 | 8 | 14 | 16 | 27 | 3 | 0 | 0 | 0 | 0 | 70 |
| NNW | 0 | 0 | 1 | 5 | 12 | 50 | 112 | 76 | 6 | 0 | 0 | 0 | 262 |
| Total | 0 | 4 | 19 | 143 | 234 | 562 | 1085 | 541 | 88 | 15 | 5 | 3 | 2699 |

Number of calms for D Stability: 0

Table 4
Joint Frequency Distribution of Meteorological Data

JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND DIRECTION IN HOURS 01/01/2005 00:00:00 TO 12/31/2005 23:59:59 PASQUILL CLASS E

| Wind Direction | Wind Speed (M/S) at 10-m Level | | | | | | | | | | | | Total |
|----------------|--------------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|-----------|-------|-------|
| | .22-.50 | .51-.75 | .76-1.0 | 1.1-1.5 | 1.6-2.0 | 2.1-3.0 | 3.1-5.0 | 5.1-7.0 | 7.1-10. | 10.1-13 | 13.1-18.0 | >18.0 | |
| N | 1 | 1 | 5 | 13 | 24 | 77 | 90 | 6 | 0 | 0 | 0 | 0 | 217 |
| NNE | 0 | 2 | 4 | 13 | 29 | 109 | 100 | 4 | 1 | 1 | 0 | 0 | 263 |
| NE | 0 | 1 | 2 | 6 | 29 | 145 | 171 | 12 | 0 | 3 | 0 | 0 | 369 |
| ENE | 0 | 2 | 3 | 11 | 16 | 21 | 58 | 12 | 0 | 0 | 0 | 0 | 123 |
| E | 0 | 0 | 1 | 7 | 5 | 17 | 23 | 2 | 0 | 0 | 0 | 0 | 55 |
| ESE | 0 | 1 | 1 | 11 | 5 | 6 | 47 | 17 | 0 | 6 | 0 | 0 | 94 |
| SE | 0 | 1 | 3 | 5 | 19 | 38 | 42 | 0 | 0 | 1 | 0 | 0 | 109 |
| SSE | 0 | 2 | 1 | 17 | 37 | 130 | 38 | 0 | 0 | 0 | 0 | 0 | 225 |
| S | 1 | 4 | 6 | 32 | 54 | 74 | 39 | 3 | 0 | 0 | 0 | 0 | 213 |
| SSW | 1 | 3 | 8 | 35 | 40 | 55 | 41 | 3 | 0 | 0 | 0 | 0 | 186 |
| SW | 2 | 6 | 8 | 27 | 36 | 59 | 14 | 1 | 0 | 0 | 0 | 0 | 153 |
| WSW | 1 | 5 | 8 | 42 | 44 | 36 | 11 | 0 | 2 | 0 | 0 | 0 | 149 |
| W | 1 | 6 | 7 | 51 | 23 | 16 | 3 | 1 | 0 | 1 | 0 | 0 | 109 |
| WNW | 0 | 5 | 7 | 36 | 27 | 14 | 4 | 0 | 0 | 0 | 0 | 0 | 93 |
| NW | 0 | 0 | 2 | 23 | 23 | 31 | 9 | 0 | 0 | 0 | 1 | 0 | 89 |
| NNW | 0 | 3 | 6 | 14 | 26 | 38 | 34 | 7 | 0 | 0 | 0 | 1 | 129 |
| Total | 7 | 42 | 72 | 343 | 437 | 866 | 724 | 68 | 3 | 12 | 1 | 1 | 2576 |

Number of calms for E Stability: 0

JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND DIRECTION IN HOURS 01/01/2005 00:00:00 TO 12/31/2005 23:59:59 PASQUILL CLASS F

| Wind Direction | Wind Speed (M/S) at 10-m Level | | | | | | | | | | | | Total |
|----------------|--------------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|-----------|-------|-------|
| | .22-.50 | .51-.75 | .76-1.0 | 1.1-1.5 | 1.6-2.0 | 2.1-3.0 | 3.1-5.0 | 5.1-7.0 | 7.1-10. | 10.1-13 | 13.1-18.0 | >18.0 | |
| N | 1 | 6 | 5 | 16 | 11 | 15 | 1 | 0 | 0 | 0 | 0 | 0 | 55 |
| NNE | 0 | 5 | 7 | 8 | 8 | 11 | 3 | 0 | 0 | 0 | 0 | 0 | 42 |
| NE | 0 | 0 | 1 | 12 | 7 | 14 | 9 | 0 | 0 | 0 | 0 | 0 | 43 |
| ENE | 0 | 2 | 4 | 4 | 4 | 3 | 0 | 0 | 0 | 0 | 0 | 0 | 17 |
| E | 1 | 1 | 6 | 4 | 2 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 15 |
| ESE | 0 | 2 | 3 | 2 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 8 |
| SE | 1 | 4 | 4 | 6 | 7 | 2 | 0 | 0 | 0 | 0 | 0 | 0 | 26 |
| SSE | 3 | 2 | 4 | 12 | 33 | 47 | 6 | 0 | 0 | 0 | 0 | 0 | 107 |
| S | 4 | 6 | 9 | 63 | 46 | 28 | 0 | 0 | 0 | 0 | 0 | 0 | 156 |
| SSW | 2 | 5 | 18 | 86 | 37 | 7 | 0 | 0 | 0 | 0 | 0 | 0 | 155 |
| SW | 5 | 8 | 32 | 69 | 15 | 7 | 2 | 0 | 0 | 0 | 0 | 0 | 138 |
| WSW | 2 | 14 | 26 | 48 | 15 | 2 | 0 | 0 | 0 | 0 | 0 | 0 | 107 |
| W | 2 | 13 | 35 | 62 | 15 | 4 | 1 | 0 | 0 | 0 | 0 | 0 | 132 |
| WNW | 0 | 10 | 17 | 40 | 16 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 84 |
| NW | 2 | 6 | 11 | 20 | 12 | 4 | 0 | 0 | 0 | 0 | 0 | 0 | 55 |
| NNW | 2 | 5 | 9 | 12 | 6 | 5 | 0 | 0 | 0 | 0 | 0 | 0 | 39 |
| Total | 25 | 89 | 191 | 464 | 234 | 152 | 24 | 0 | 0 | 0 | 0 | 0 | 1179 |

Number of calms for F Stability: 1

Table 4
Joint Frequency Distribution of Meteorological Data

JOINT FREQUENCY DISTRIBUTION OF WIND SPEED AND DIRECTION IN HOURS 01/01/2005 00:00:00 TO 12/31/2005 23:59:59 PASQUILL CLASS G

| Wind Direction | Wind Speed (M/S) at 10-m Level | | | | | | | | | | | Total | |
|----------------|--------------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|-----------|-------|-------|
| | .22-.50 | .51-.75 | .76-1.0 | 1.1-1.5 | 1.6-2.0 | 2.1-3.0 | 3.1-5.0 | 5.1-7.0 | 7.1-10. | 10.1-13 | 13.1-18.0 | | >18.0 |
| N | 1 | 10 | 3 | 7 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 22 |
| NNE | 0 | 2 | 4 | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 8 |
| NE | 2 | 6 | 1 | 3 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 13 |
| ENE | 0 | 1 | 0 | 0 | 2 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 3 |
| E | 0 | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 2 |
| ESE | 2 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 2 |
| SE | 0 | 1 | 0 | 0 | 2 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 3 |
| SSE | 0 | 1 | 1 | 8 | 8 | 8 | 1 | 0 | 0 | 0 | 0 | 0 | 27 |
| S | 3 | 7 | 5 | 26 | 24 | 4 | 0 | 0 | 0 | 0 | 0 | 0 | 69 |
| SSW | 4 | 9 | 21 | 56 | 19 | 2 | 0 | 0 | 0 | 0 | 0 | 0 | 111 |
| SW | 5 | 17 | 32 | 27 | 4 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 85 |
| WSW | 9 | 31 | 18 | 17 | 3 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 79 |
| W | 8 | 43 | 36 | 19 | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 108 |
| WNW | 4 | 13 | 20 | 14 | 4 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 56 |
| NW | 5 | 11 | 9 | 11 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 36 |
| NNW | 1 | 8 | 7 | 7 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 24 |
| Total | 44 | 161 | 158 | 196 | 69 | 19 | 1 | 0 | 0 | 0 | 0 | 0 | 648 |

Number of calms for G Stability: 3

Total valid hours for all stabilities = 8760
Total invalid hours for all stabilities = 0

Table 5A
Doses Due to Gaseous Radioactive Effluents

Doses due to Noble Gases (mRad or mrem)

Age Group : All

| Organ | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Year Total |
|------------|------------|------------|------------|------------|------------|
| Total-body | 2.7243e-02 | 4.0018e-02 | 6.2264e-05 | 0.0000e+00 | 6.7323e-02 |
| Skin | 6.4593e-02 | 1.2069e-01 | 1.4970e-04 | 0.0000e+00 | 1.8544e-01 |
| Air Beta | 8.9369e-02 | 1.7621e-01 | 2.2441e-04 | 0.0000e+00 | 2.6581e-01 |
| Air Gamma | 3.2195e-02 | 4.7748e-02 | 7.4849e-05 | 0.0000e+00 | 8.0018e-02 |

Doses due to Radioiodines/Particulates/Tritium (mrem)

Age Group : Adult

| Organ | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Year Total |
|------------|------------|------------|------------|------------|------------|
| Bone | 2.0614e-08 | 7.1496e-05 | 4.6219e-07 | 0.0000e+00 | 7.1979e-05 |
| Liver | 3.2309e-03 | 4.6897e-03 | 6.0361e-03 | 6.6083e-03 | 2.0565e-02 |
| Total-body | 3.2309e-03 | 4.6497e-03 | 6.0358e-03 | 6.6083e-03 | 2.0525e-02 |
| Thyroid | 3.2401e-03 | 3.4977e-02 | 6.2430e-03 | 6.6083e-03 | 5.1069e-02 |
| Kidney | 3.2309e-03 | 4.7550e-03 | 6.0365e-03 | 6.6083e-03 | 2.0631e-02 |
| Lung | 3.2309e-03 | 4.5968e-03 | 6.0355e-03 | 6.6083e-03 | 2.0471e-02 |
| Gi-lli | 3.2309e-03 | 4.6216e-03 | 6.0356e-03 | 6.6083e-03 | 2.0497e-02 |
| Skin | 1.0781e-09 | 6.9215e-06 | 2.3827e-08 | 0.0000e+00 | 6.9465e-06 |

Age Group : Teen

| Organ | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Year Total |
|------------|------------|------------|------------|------------|------------|
| Bone | 3.2898e-08 | 1.1251e-04 | 7.3800e-07 | 0.0000e+00 | 1.1328e-04 |
| Liver | 3.6576e-03 | 5.3512e-03 | 6.8335e-03 | 7.4810e-03 | 2.3323e-02 |
| Total-body | 3.6576e-03 | 5.2818e-03 | 6.8330e-03 | 7.4810e-03 | 2.3253e-02 |
| Thyroid | 3.6706e-03 | 4.8184e-02 | 7.1260e-03 | 7.4810e-03 | 6.6462e-02 |
| Kidney | 3.6576e-03 | 5.4560e-03 | 6.8342e-03 | 7.4810e-03 | 2.3429e-02 |
| Lung | 3.6576e-03 | 5.2035e-03 | 6.8325e-03 | 7.4810e-03 | 2.3174e-02 |
| Gi-lli | 3.6576e-03 | 5.2325e-03 | 6.8327e-03 | 7.4810e-03 | 2.3204e-02 |
| Skin | 1.0781e-09 | 6.9215e-06 | 2.3827e-08 | 0.0000e+00 | 6.9465e-06 |

Age Group : Child

| Organ | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Year Total |
|------------|------------|------------|------------|------------|------------|
| Bone | 7.5429e-08 | 2.5446e-04 | 1.6933e-06 | 0.0000e+00 | 2.5623e-04 |
| Liver | 5.0622e-03 | 7.4472e-03 | 9.4579e-03 | 1.0354e-02 | 3.2321e-02 |
| Total-body | 5.0621e-03 | 7.3380e-03 | 9.4571e-03 | 1.0354e-02 | 3.2211e-02 |
| Thyroid | 5.0869e-03 | 8.8707e-02 | 1.0013e-02 | 1.0354e-02 | 1.1416e-01 |
| Kidney | 5.0622e-03 | 7.6029e-03 | 9.4589e-03 | 1.0354e-02 | 3.2478e-02 |
| Lung | 5.0621e-03 | 7.1987e-03 | 9.4562e-03 | 1.0354e-02 | 3.2071e-02 |
| Gi-lli | 5.0621e-03 | 7.2202e-03 | 9.4563e-03 | 1.0354e-02 | 3.2092e-02 |
| Skin | 1.0781e-09 | 6.9215e-06 | 2.3827e-08 | 0.0000e+00 | 6.9465e-06 |

Age Group : Infant

| Organ | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Year Total |
|------------|------------|------------|------------|------------|------------|
| Bone | 1.3984e-07 | 4.6610e-04 | 3.1411e-06 | 0.0000e+00 | 4.6938e-04 |
| Liver | 2.2874e-03 | 3.7975e-03 | 4.2764e-03 | 4.6783e-03 | 1.5040e-02 |
| Total-body | 2.2873e-03 | 3.4923e-03 | 4.2743e-03 | 4.6783e-03 | 1.4732e-02 |
| Thyroid | 2.3410e-03 | 1.8022e-01 | 5.4814e-03 | 4.6783e-03 | 1.9272e-01 |
| Kidney | 2.2875e-03 | 3.8851e-03 | 4.2770e-03 | 4.6783e-03 | 1.5128e-02 |
| Lung | 2.2873e-03 | 3.2564e-03 | 4.2727e-03 | 4.6783e-03 | 1.4495e-02 |
| Gi-lli | 2.2873e-03 | 3.2745e-03 | 4.2728e-03 | 4.6783e-03 | 1.4513e-02 |
| Skin | 1.0781e-09 | 6.9215e-06 | 2.3827e-08 | 0.0000e+00 | 6.9465e-06 |

Table 5B
Doses Due to Liquid Radioactive Effluents

Age Group : Adult

| Organ | Qtr 1 | Qtr 2 | Qtr 3 | Qtr 4 | Year Total |
|------------|------------|------------|------------|------------|------------|
| Bone | 3.5040e-04 | 6.3206e-05 | 5.8732e-03 | 9.8286e-06 | 6.2967e-03 |
| Liver | 7.5558e-04 | 6.9855e-04 | 9.9545e-03 | 2.3968e-04 | 1.1648e-02 |
| Total-body | 5.9538e-04 | 7.1087e-04 | 7.1901e-03 | 2.1823e-04 | 8.7146e-03 |
| Thyroid | 1.2885e-04 | 6.4555e-04 | 1.2462e-04 | 1.9880e-04 | 1.0978e-03 |
| Kidney | 3.3563e-04 | 5.9248e-04 | 3.3909e-03 | 2.0806e-04 | 4.5271e-03 |
| Lung | 1.9780e-04 | 5.7114e-04 | 1.2049e-03 | 2.0325e-04 | 2.1771e-03 |
| Gi-ll. | 1.4994e-04 | 1.3132e-03 | 6.3899e-04 | 7.5046e-04 | 2.8526e-03 |

ATTACHMENT 11.1

Copy of of UNT-005-514, "Offsite Dose Calculation Manual" Revision 8 Change 1 & 2.

REQUEST/APPROVAL PAGE

SAFETY RELATED PROCEDURE

Required Review Level (check one)

- OSRC
 QUALIFIED REVIEW

PROCEDURE NUMBER: UNT-005-014 REVISION: 8 CHANGE: 2 DEVIATION: N/A

TITLE: Offsite Dose Calculation Manual

PROCEDURE OWNER (Position Title): Chemistry Superintendent

ACTIVITY (check one):

- Charge Revision Deviation Deletion New Procedure Temporary Procedure

DESCRIPTION AND JUSTIFICATION:

Changed "railroad sign" to "pole" for description of TLD location G-4. Railroad sign was removed.

Request/Approval Page Continuation Sheet(s) attached.

REVIEW PROCESS (check one):

- Normal Editorial Correction (May only be used with Changes, Revisions, and Deviations)

| | REVIEW AND APPROVAL ACTIONS | PRINT NAME OR SIGNATURE | DATE |
|--|--|-------------------------|----------|
| PREPARER | | Ann Dubois | 10-20-05 |
| EC SUPERVISOR | Administrative Review and Approval | (sign) | 10-20-05 |
| CROSS-DISCIPLINE REVIEWS (List Groups) | | n/a | n/a |
| | | | |
| | | | |
| | | | |
| 50.59 REVIEWER | <input type="checkbox"/> Programmatically Excluded: OSRC Mtg. No.: | n/a | n/a |
| 50.54 REVIEWER | Review <input type="checkbox"/> | n/a | n/a |
| TECHNICAL REVIEWER | Review | n/a | n/a |
| QUALIFIED REVIEWER | Review <input type="checkbox"/> | n/a | n/a |
| GROUP/DEPT. HEAD | Review <input type="checkbox"/> Approval <input type="checkbox"/> | (sign) n/a | n/a |
| GM, PLANT OPERATIONS | Review <input type="checkbox"/> Approval <input type="checkbox"/> | (sign) n/a | n/a |
| VICE PRESIDENT, OPERATIONS | Approval <input type="checkbox"/> | (sign) n/a | n/a |
| Effective Date / Milestone (if applicable): | | 10-24-05 | |
| Expiration Date / Milestone (if applicable): | | n/a | |

REQUEST/APPROVAL PAGE

| | | | |
|--|-------------|---|----------|
| <h1 style="margin: 0;">SAFETY RELATED PROCEDURE</h1> | | Required Review Level (check one): <input checked="" type="checkbox"/> OSRC <input type="checkbox"/> QUALIFIED REVIEW | |
| PROCEDURE NUMBER: | UNT-005-014 | REVISION: | 8 |
| | | CHANGE: | 1 |
| | | DEVIATION: | N/A |
| TITLE: Offsite Dose Calculation Manual | | | |
| PROCEDURE OWNER (Position Title): Chemistry Superintendent | | | |
| ACTIVITY (check one): <input checked="" type="checkbox"/> Change <input type="checkbox"/> Revision <input type="checkbox"/> Deviation <input type="checkbox"/> Deletion <input type="checkbox"/> New Procedure <input type="checkbox"/> Temporary Procedure | | | |
| DESCRIPTION AND JUSTIFICATION: 1. Updated reference number for corrective action process. Changed from LI-102 to EN-LI-102. 2. Removed the word "utility" from description of TLD location J-15 for simplification and clarification. | | | |
| <input type="checkbox"/> Request/Approval Page Continuation Sheet(s) attached. | | | |
| REVIEW PROCESS (check one): <input type="checkbox"/> Normal <input checked="" type="checkbox"/> Editorial Correction (May only be used with Changes, Revisions, and Deviations) | | | |
| REVIEW AND APPROVAL ACTIONS | | PRINT NAME OR SIGNATURE | DATE |
| PREP/REER | | Ann Dubois | 07-27-05 |
| EC SUPERVISOR Administrative Review and Approval | | (sign) | 7-27-05 |
| CROSS-DISCIPLINE REVIEWS (List Groups) | | n/a | n/a |
| | | | |
| | | | |
| | | | |
| 50.59 REVIEWER <input type="checkbox"/> Programmatically Excluded: OSRC Mtg. No.: | | n/a | n/a |
| 50.54 REVIEWER Review <input type="checkbox"/> | | n/a | n/a |
| TECHNICAL REVIEWER Review | | n/a | n/a |
| QUALIFIED REVIEWER Review <input type="checkbox"/> | | n/a | n/a |
| GROUP/DEPT. HEAD Review <input type="checkbox"/> Approval <input type="checkbox"/> | | (sign) n/a | n/a |
| GM, PLANT OPERATIONS Review <input type="checkbox"/> Approval <input type="checkbox"/> | | (sign) n/a | n/a |
| VICE PRESIDENT, OPERATIONS Approval <input type="checkbox"/> | | (sign) n/a | n/a |
| Effective Date / Milestone (if applicable): | | | |
| Expiration Date / Milestone (if applicable): | | | |
| | | n/a | |

REQUEST/APPROVAL PAGE

| | | | | | | | |
|---|-------------|---|---|-------------------------|---|------------|-----|
| <h1 style="margin: 0;">SAFETY RELATED PROCEDURE</h1> | | Required Review Level (check one): <input checked="" type="checkbox"/> OSRC <input type="checkbox"/> QUALIFIED REVIEW | | | | | |
| PROCEDURE NUMBER: | UNT-005-014 | REVISION: | 8 | CHANGE: | 0 | DEVIATION: | N/A |
| TITLE: Offsite Dose Calculation Manual | | | | | | | |
| PROCEDURE OWNER (Position Title): Chemistry Superintendent | | | | | | | |
| ACTIVITY (check one): <input type="checkbox"/> Change <input checked="" type="checkbox"/> Revision <input type="checkbox"/> Deviation <input type="checkbox"/> Deletion <input type="checkbox"/> New Procedure <input type="checkbox"/> Temporary Procedure | | | | | | | |
| DESCRIPTION AND JUSTIFICATION: Deleted control milk location MKR-40 because owner sold milk cows. Added milk location MKR-38 as control location to replace MKR-40. New location is acceptable due to its compass direction and distance from the plant. Changed the following attachments: 1. Changed MKR-40 to MKR-38 on attachment 7.13, 7.14 (page 10 of 12) and 7.18. 2. Incorporated changes 1 and 2 (attachment 7.14 page 4 of 12 and attachment 7.17). Changes were editorial in nature. | | | | | | | |
| <input type="checkbox"/> Request/Approval Page Continuation Sheet(s) attached. | | | | | | | |
| REVIEW PROCESS (check one): <input checked="" type="checkbox"/> Normal <input type="checkbox"/> Editorial Correction (May only be used with Changes, Revisions, and Deviations) | | | | | | | |
| REVIEW AND APPROVAL ACTIONS | | | | PRINT NAME OR SIGNATURE | | DATE | |
| PREPARER | | | | Ann Dubois | | 02-16-05 | |
| EC SUPERVISOR Administrative Review and Approval | | | | (sign) n/a | | n/a | |
| CRISIS-DISCIPLINE REVIEWS (List Groups) | | | | n/a | | n/a | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| 50.53 REVIEWER <input type="checkbox"/> Programmatically Excluded; OSRC Mtg. No.: | | | | Gary Dolosa | | 03-08-05 | |
| 50.51 REVIEWER Review <input type="checkbox"/> | | | | n/a | | n/a | |
| TECHNICAL REVIEWER Review | | | | Mark Louque | | 03-15-05 | |
| QUALIFIED REVIEWER Review <input type="checkbox"/> | | | | n/a | | n/a | |
| GROUP/DEPT. HEAD Review <input checked="" type="checkbox"/> Approval <input type="checkbox"/> (sign) | | | | <i>[Signature]</i> | | 3-16-05 | |
| GM, PLANT OPERATIONS Review <input type="checkbox"/> Approval <input checked="" type="checkbox"/> (sign) | | | | <i>[Signature]</i> | | 4/12/05 | |
| VICE PRESIDENT, OPERATIONS Approval <input type="checkbox"/> (sign) | | | | n/a | | n/a | |
| Effective Date / Milestone (if applicable): | | | | | | | |
| Expiration Date / Milestone (if applicable): n/a | | | | | | | |

TABLE OF CONTENTS

| | |
|--|-----------|
| 1.0 PURPOSE | 3 |
| 2.0 REFERENCES | 4 |
| 3.0 DEFINITIONS | 6 |
| 4.0 RESPONSIBILITIES | 8 |
| 5.0 PROCEDURE | 9 |
| 5.1 SITE CHARACTERISTICS | 9 |
| 5.2 SPECIFICATIONS AND SURVEILLANCE REQUIREMENTS | 10 |
| 5.3 LIQUID EFFLUENTS | 11 |
| 5.4 GASEOUS EFFLUENTS | 21 |
| 5.5 40 CFR190 DOSE EVALUATION | 37 |
| 5.6 LIQUID AND GASEOUS RADWASTE PROCESSES | 38 |
| 5.7 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM REQUIREMENTS | 39 |
| 5.8 ROUTINE EFFLUENT RELEASE REPORTS | 42 |
| 5.9 SPECIAL EFFLUENT REPORTS | 51 |
| 5.10 SECONDARY RELEASE PATHS | 55 |
| 6.0 RECORDS | 56 |
| 7.0 ATTACHMENTS | 56 |
| 7.1 BOUNDARIES FOR RADIOACTIVE GASEOUS AND LIQUID EFFLUENTS | 57 |
| 7.2 HISTORICAL AVERAGE DISPERSION AND DEPOSITION PARAMETERS FOR AREAS AT OR BEYOND THE UNRESTRICTED AREA BOUNDARY | 58 |
| 7.3 SITE RELATED LIQUID INGESTION DOSE COMMITMENT FACTORS (A_i) FOR INDIVIDUAL NUCLIDES | 59 |
| 7.4 DOSE FACTORS FOR EXPOSURE TO A SEMI-INFINITE CLOUD OF NOBLE GASES | 71 |
| 7.5 INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i | 72 |
| 7.6 GROUND - PLANE DEPOSITION PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i | 96 |
| 7.7 COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i | 102 |
| 7.8 MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i | 126 |

INFORMATIONAL USE

| | | |
|------|---|-----|
| 7.9 | LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_I | 150 |
| 7.10 | GOAT'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_I | 174 |
| 7.11 | LIQUID WASTE MANAGEMENT SYSTEM EFFLUENT SOURCES AND RELEASE PATHWAYS AND POINTS | 198 |
| 7.12 | GASEOUS EFFLUENT SOURCES, GASEOUS WASTE MANAGEMENT SYSTEM EFFLUENT SOURCES AND EXHAUST RELEASE POINTS | 200 |
| 7.13 | RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM | 201 |
| 7.14 | SAMPLE LOCATION TABLE | 204 |
| 7.15 | SECTOR AND ZONE DESIGNATORS FOR RADIOLOGICAL SAMPLING AND MONITORING POINTS | 216 |
| 7.16 | REMP SAMPLES WITHIN 2 MILES OF WATERFORD 3 | 217 |
| 7.17 | REMP SAMPLES 2 TO 10 MILES FROM WATERFORD 3 | 218 |
| 7.18 | REMP SAMPLES 10 TO 50 MILES FROM WATERFORD 3 | 219 |
| 7.19 | DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, P_i | 220 |
| 7.20 | DOSE CONVERSION FACTORS ALL AGE GROUPS BY NUCLIDE (GROUND PLANE) | 274 |
| 7.21 | DOSE CONVERSION FACTORS FOR ALL AGE GROUPS BY NUCLIDE (INHALATION AND INGESTION) | 280 |
| 7.22 | SPECIFIC FACTORS USED TO DETERMINE A_i , P_i AND R_i VALUES FOR THE OFFSITE DOSE CALCULATION MANUAL | 328 |
| 7.23 | ODCM SPECIFICATIONS CONTAINED IN THE WATERFORD III TECHNICAL REQUIREMENTS MANUAL | 346 |

LIST OF EFFECTIVE PAGES

| | |
|--------|------------|
| 1-346 | Revision 8 |
| 4, 210 | Change 1 |
| 208 | Change 2 |

INFORMATIONAL USE

1.0 PURPOSE

1.1 The Offsite Dose Calculation Manual (ODCM) is a supporting document of the Waterford 3 Technical Specifications. The ODCM provides:

- (1) The Radiological Effluent Specifications and Radiological Environmental Monitoring Program required by Technical Specification 6.8.4;
- (3) The detailed Radiological Environmental Monitoring Program (REMP);
- (4) The description of the Radiological Environmental Monitoring Interlaboratory Comparison Program;
- (5) The liquid and gaseous radwaste block flow diagram;
- (6) The Radioactive Liquid and Gaseous Waste Sampling and Analysis Programs;
- (7) The general methodology to be used to calculate dose to individuals due to releases of radioactive gaseous and liquid effluents from the Waterford 3 site;
- (8) The general methodology to be used to calculate effluent monitor setpoints and allowable release rates to ensure compliance with the Radiological Effluent Controls, 10CFR20, and 10CFR50 criteria;
- (9) The methodology to be used to ensure representative sampling of liquids;
and
- (10) The methodology to be used to comply with 40CFR190 criteria.

2.0 REFERENCES

- 2.1 EN-LI-102, Corrective Action Process
- 2.2 UNT-006-010, Event Notification and Reporting
- 2.3 Waterford 3 FSAR Chapter 2
- 2.4 Waterford 3 Technical Requirements Manual (TRM)
- 2.5 Waterford 3 Technical Specifications (T.S.)
 - 2.5.1 T.S. 3/4.11.1.4, Liquid Holdup Tanks
 - 2.5.2 T.S. 3/4.11.2.6, Gas Storage Tanks
 - 2.5.3 T.S. 5.1.3, Map Defining Unrestricted Areas for Radioactive Gaseous and Liquid Effluents
 - 2.5.4 T.S. 6.9.1.7, Annual Radiological Environmental Operating Report
 - 2.5.5 T.S. 6.9.1.8, Annual Radioactive Effluent Release Report
 - 2.5.6 T.S. 6.9.2, Special Reports
 - 2.5.7 T.S. 6.13, Process Control Program
 - 2.5.8 T.S. 6.14, Offsite Dose Calculation Manual
- 2.6 Code of Federal Regulations: Title 10, Parts 20, 40, 50 and 100; Title 40, Part 190 and 302
- 2.7 HASL-300, HASL Procedures Manual; Currie, L.A., "Limits for Qualitative Detection and Quantitative Determination Application to Radiochemistry", Anal Chem. 40, 586-93, (1968)

- 2.8 International Atomic Energy Agency (IAEA) Safety Series No.57, Generic Models and Parameters for Assessing the Environmental Transfer of Radionuclides from Routine Releases, Exposures of Critical Groups
- 2.9 NUREG/CR-1276, Users Manual for LADTAP II – A computer program for calculating radiation exposure to man from routine release of nuclear reactor liquid effluents
- 2.10 NUREG/CR-4007, Currie, L.A., "Lower Limit of Detection; Definition and Elaboration of a Proposed Position for Radiological Effluent and Environmental Measurements", (September 1984)
- 2.11 NUREG-0172, Age Specific Radiation Dose Commitment Factors for a One Year Chronic Intake
- 2.12 NUREG-1301, Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors, Generic Letter 89-01, Supplement No. 1. (November 1990)
- 2.13 Radiological Health Handbook, U.S. Department of Health, Education and Welfare, January 1970
- 2.14 USNRC Generic Letter 89-01, Implementation of Programmatic Controls for Radiological Effluent Technical Specifications in the Administrative Controls Section of the Technical Specifications and the Relocation of Procedural Details of RETS to the Offsite Dose Calculation Manual or to the Process Control Program
- 2.15 USNRC NUREG 0133, Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants, October 1978
- 2.16 USNRC Regulatory Guide 1.21, Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants, Revision 1, June, 1974

- 2.17 USNRC Regulatory Guide 1.109, Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR Part 50, Appendix I, Revision 1, October, 1977
- 2.18 USNRC Regulatory Guide 1.111, Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Gaseous-Effluents from Light-Water-Cooled Reactors, July 1977
- 2.19 USNRC Regulatory Guide 1.113, Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I, April 1977

3.0 DEFINITIONS

- **OFFSITE DOSE CALCULATION MANUAL (ODCM)** shall be comprised of the radiological effluent technical specifications and methodology contained within this procedure and applicable sections of the Technical Requirements Manual (TRM) as listed on Attachment 7.23 of this procedure.
- **UNRESTRICTED AREA (T.S. 1.36)** shall be any area to which access is neither limited nor controlled by the licensee. The definition of **UNRESTRICTED AREA** used in implementing these Technical Specifications has been expanded over that in 10 CFR 20.1003. The **UNRESTRICTED AREA** boundary may coincide with the **Exclusion (fenced) Area** boundary, as defined in 10 CFR 100.3(a), but the **UNRESTRICTED AREA** does not include areas over water bodies. For calculations performed pursuant to 10 CFR 50.36a, the concept of **UNRESTRICTED AREAS**, established at or beyond the **SITE BOUNDARY**, is utilized in the Controls to keep levels of radioactive materials in liquid and gaseous effluents as low as is reasonably achievable, see Attachment 7.1.
- **LIQUID RADWASTE TREATMENT SYSTEM** shall be any system designed and installed to reduce radioactive material in effluents by passing liquid waste through filters and/or absorption or exchange media (e.g. Ion Exchanger Resin, Charcoal etc) and/or other reduction processes (e.g. reverse osmosis, etc) for the purpose of removing radioactive materials from the liquid system prior to the release to the environment.

- A MAJOR CHANGE to a radioactive waste system shall be any alteration or modification to the system that causes waste characteristics (e.g. chemical composition, pH, etc.), waste form or waste activity (e.g. equipment decontamination factor change) in liquid, gaseous, or solid effluents to change, thereby requiring a re-evaluation of the effluent source terms.
- LOWER LIMITS OF DETECTION (LLD) is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66 S_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot e^{-\lambda \Delta t}}$$

Where:

LLD is the "a priori" lower limit of detection as defined above, as microcuries per unit mass or volume,

S_b is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate, as counts per minute,

E is the counting efficiency, as counts per disintegration,

V is the sample size in units of mass or volume,

2.22×10^6 is the number of disintegrations per minute per microcurie,

Y is the fraction radiochemical yield, when applicable,

λ is the radioactive decay constant for the particular radionuclide, and

Δt for plant effluents is the elapsed time between the midpoint of sample collection and the time of counting. For environmental samples it is the elapsed time between sample collection, or end of the sample collection period, and time of counting. Typical values of E, V, Y, and Δt should be used in the calculation.

- An **UNPLANNED/ABNORMAL RELEASE** is defined as any unplanned, uncontrolled or unmonitored release of radioactive material to the **UNRESTRICTED AREA** for liquids or to the **SITE BOUNDARY** for gases. This includes any unplanned, uncontrolled or unmonitored releases where the radiological consequences may be minimal but where the potential exists for more serious radiological consequences if allowed to recur. Incidents that are to be classified as **UNPLANNED/ABNORMAL RELEASES** do not include releases that fall within the guidelines of a **Secondary Release Pathway**. **Secondary Release Pathways** are usually known and have been previously evaluated or considered.

4.0 RESPONSIBILITIES

- General Manager, Plant Operations has lead responsibility for ensuring implementation of the **Radiological Effluent Specifications and Radiological Environmental Monitoring Program**.
- The Chemistry Superintendent is responsible for
 - a) ensuring **Radiological Effluent Specifications, the Radiological Effluent Monitoring Program and Radiological Environmental Monitoring Program (REMP)** is performed as required according to procedures and methodologies established by this document.
 - b) ensuring the **Annual Effluent Release Report and the Annual Radiological Environmental Operating Report** are performed and issued as required.
 - c) ensuring the **Land Use Census** is performed as required.

5.0 PROCEDURE

5.1 SITE CHARACTERISTICS

Waterford 3 SES Site Characteristics is provided in Chapter 2 of Waterford 3 FSAR (Sections 2.1.1, 2.1.2 and 2.1.3).

A map of the SITE BOUNDARIES for establishing effluent release limits along with radioactive effluent release points are given in Attachment 7.1. The release point elevations for gaseous effluents are also provided in Attachment 7.1. The nearest distances to the boundary line are shown in Attachment 7.2 of this procedure.

5.2 SPECIFICATIONS AND SURVEILLANCE REQUIREMENTS

- a. Compliance with the SPECIFICATIONS contained in this procedure and the TRM is required during the conditions specified therein; except that failure to meet the SPECIFICATIONS requires that the associated ACTION requirements shall be met.
- b. Noncompliance with this procedure and the TRM shall exist when the requirements of the SPECIFICATION and/or associated ACTION requirements are not met within the specified time intervals. If the SPECIFICATION is restored prior to expiration of the specified time intervals, completion of the ACTION requirements is not required.
- c. Surveillance Requirements shall be applicable during all conditions specified for individual systems unless otherwise stated in an individual Surveillance Requirement.
- d. Each Surveillance Requirement shall be performed within the specified time interval with a maximum allowable extension not to exceed 25% of the surveillance interval.
- e. Failure to perform a Surveillance Requirement within the specified time interval shall constitute a failure to meet the OPERABILITY requirements for a Specific System for Operation. Exceptions to these requirements are stated in the individual specifications. Surveillance Requirements do not have to be performed on inoperable equipment.
- f. Failure to comply with the compensatory ACTION requirements or failure to complete the surveillance requirements within the specified time shall be documented and evaluated in accordance with LI-102 the Corrective Action Process, Condition Report and UNT-006-010, Event Notification and Reporting procedures.

5.3 LIQUID EFFLUENTS

5.3.1 Liquid Effluent Dose Calculation

NOTE

The Offsite Dose Calculation Manual (ODCM) follows the general models suggested by NUREG 0133 and Regulatory Guide 1.109. However, alternate calculation methods from those presented may be used provided the overall methodology is acceptable and consistent with regulation or provided the alternate methodology is conservative. In addition, the most up-to-date dose conversion factors and bioaccumulation factors may be substituted in lieu of Regulatory Guide 1.109 values.

NOTE

Actual step-by-step dose calculations will be performed by in-plant procedures which are consistent with the methodology presented in this document.

- 5.3.1.1 The dose commitment to an individual from radioactive materials in liquid effluents released to unrestricted areas are calculated for the purpose of implementing Section 5.3.2 using the following expression:

$$D_{ie} = \Delta t_e F_e \sum_{i=1}^n A_{ie} C_{ie} \quad (1)$$

$$D_t = \sum_{e=1}^m D_{ie} \quad (2)$$

5.3 LIQUID EFFLUENTS (cont'd)

D_{ℓ} = the cumulative dose commitment to the total body or any organ (t) from the liquid effluents for each liquid release in mrem during time period (ℓ);

D_t = the cumulative dose commitment to the total body or any organ (t) from the liquid effluents for all (ℓ) time periods;

Δt_{ℓ} = the length of the ℓ th time period over which the release is made, in hours;

$C_{i\ell}$ = the concentration of radionuclide (i) in undiluted liquid effluent during time period Δt_{ℓ} from any liquid release, in $\mu\text{Ci/ml}$;

A_{it} = the site-related liquid ingestion dose commitment factor to the total body or any organ (t) for each identified nuclide (i) in mrem-ml/hr- μCi (Attachment 7.3), and;

5.3 LIQUID EFFLUENTS (cont'd)

F_c = the near field average dilution factor for C_i , during any liquid effluent release. Defined as the ratio of the undiluted liquid waste flow during release to the average flow from the site discharge structure to site boundary receiving waters.

$$= \frac{\text{liquid radioactive waste flow}}{\text{discharge structure exit flow}}$$

The liquid radioactive waste flow is the maximum flow from the effluent release. The discharge structure exit flow is the flow during disposal from the discharge structure release point into the receiving water body. For radionuclides not determined in each batch or weekly composite, the dose contribution to the current calendar quarter cumulative summation may be approximated by using a ratio of concentrations based on the previous monthly or quarterly composite analyses.

5.3 LIQUID EFFLUENTS (cont'd)

5.3.1.2 Equation (1) above for calculating the dose contributions requires the use of a dose factor, A_{it} , for each nuclide (i) which embodies the dose factors and dilution factors for the points of pathway origin. The adult total body dose factor and the adult organ dose factor for each radionuclide will be used from Table E-11 of Regulatory Guide 1.109; thus the list contains critical organ dose factors for various organs. The dose factor is written:

$$A_{it} = K_o \left(\frac{U_w}{D_w} + U_f B E_i \right) DCF_{it} \quad (3)$$

where:

A_{it} = Composite dose parameter for the total body or critical organ (t) of an adult for nuclide (i) for all appropriate pathways (mrem-ml/hr- μ Ci);

K_o = Unit conversion factor;

$$= 1.14e + 5 = 10^6 \frac{\mu Ci}{\mu Ci} \cdot 10^3 \frac{ml}{l} \div 8760 \frac{hr}{yr}$$

U_w = 730 l/yr adult water consumption (Reg. Guide 1.109, Table E-5);

5.3 LIQUID EFFLUENTS (cont'd)

- D_w = Dilution factor from near field area to potable water intake;
- = 220
for discharges from the circulating water discharge into the Mississippi River (based on the ratio of the average Mississippi River flow to the maximum discharge flow);
- = 1
for discharges into the 40 Arpent Canal (based on the assumption that dilution from the near field area to a potable water intake is negligible);
- U_f = 21 kg/yr, adult fish consumption (Reg. Guide 1.109, Table E-5);
- BF_i = Bioaccumulation factor for nuclide (i) in fish (pCi/kg per pCi/l) from Attachment 7.22 and;
- DCF_{it} = Ingestion Dose conversion factor for nuclide (i) and organ (t) for adults (mrem/pCi), from Attachment 7.21.

5.3 LIQUID EFFLUENTS (cont'd)

5.3.2 Liquid Effluent Monitor Setpoint Calculation Methodology

TRM specifications 3/4.11.1.1 and 3/4.3.3.10 require that the liquid effluent monitoring instrumentation alarm/trip setpoints be set so that the concentration of radioactive material released from the site is limited to 10 times the Effluent concentration values in 10CFR20, Appendix B, Table 2, Column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to $2E-4 \mu\text{Ci/ml}$ total activity. This section presents the method to be used for determining setpoints in accordance with TRM surveillance requirements 3/4.11.1.1 and 3/4.3.3.10.

5.3.2.1 The calculated setpoints for the liquid effluent monitors satisfy the following equation:

$$C = \frac{(SF) (RF) (F + f) \sum_{i=1}^n C_i}{(TEC)(E + F')} \quad (4)$$

5.3 LIQUID EFFLUENTS (cont'd)

where;

- c** = the setpoint, in $\mu\text{Ci/ml}$, of the liquid effluent monitor measuring the radioactivity concentration in the effluent line prior to complete dilution and subsequent release. This setpoint represents a value which, if exceeded would result in concentrations exceeding 10 times the Effluent concentration values of 10CFR20, Appendix B, Table 2. Column 2, to an UNRESTRICTED AREA;
- SF** = Safety Factor to ensure that the effluent limit is not exceeded. A value of 0.8 is normally used for SF;
- RF** = Release Fraction allocated to this release (to be used only in situations of simultaneous or concurrent release);
- f** = the undiluted liquid effluents flow as measured at the liquid effluent monitor location in gpm;
- F** = the dilution water flow as determined via pump curves or other appropriate measures that determine correct plant operating configuration in gpm;

NOTE

If F' is large compared to f then $F + f \approx F$. If there is no additional dilution, $F' = 0$.

- F' = additional dilution flow at the radiation monitor for liquid effluent radiation monitors that have additional dilution prior to actual withdrawal of the monitored fluid, in gpm.
- = 1000 (maximum) for Steam Generator Blowdown or Auxiliary Component Cooling Water releases to the circulating water system.
- = 0 for all other liquid release points.

5.3 LIQUID EFFLUENTS (cont'd)

C_i = the undiluted concentration in $\mu\text{Ci/ml}$ for all gamma emitting radionuclides (i). The value will be derived from radioanalysis of liquid effluent to be released. This value will be supplied for each liquid release;

$$TEC = \sum_{i=1}^n \frac{C_i}{10EC_i} + \sum_{j=1}^m \frac{C_j}{10EC_j}$$

C_j = the undiluted concentration, in $\mu\text{Ci/ml}$, for all non-gamma emitting radionuclides (j). This value will be derived from radioanalysis of composite liquid effluents released. This value will be supplied for each liquid release based upon the most recent analysis results.

$\frac{C_i}{MPC_i}$ = the undiluted gamma MPC fraction for all gamma emitting radionuclides

$\frac{C_j}{MPC_j}$ = the undiluted non-gamma MPC fraction for all non-gamma emitting radionuclides

$10EC_i$ = 10 times the Effluent Concentration for the applicable gamma-emitting isotopes (i) from 10CFR20, Appendix B, Table 2, Column 2; and

$10EC_j$ = 10 times the Effluent Concentration for the applicable non-gamma emitting isotopes (j) from 10CFR20, Appendix B, Table 2, Column 2

5.3.2.2 The values of C_i and C_j will be measured for each release as appropriate and the parameters for f , F' and F will be supplied based on current plant operating configurations. The setpoint will be calculated in terms of $\mu\text{Ci/ml}$ and the liquid effluent monitor will be adjusted as necessary to ensure that liquid releases are secured prior to exceeding 10 times the Effluent concentration values specified in 10CFR20, Appendix B, Table 2, Column 2 to an UNRESTRICTED AREA.

5.3 LIQUID EFFLUENTS (cont'd)

5.3.3 Representative Liquid Sampling

Prior to grab sampling liquid waste tanks, methods should be used to guarantee representative sampling. Large volumes of liquid waste should be mixed in as short a time as possible and uniformly distributed prior to sampling. To determine the minimum mixing time for tanks from which releases are made, the following tests were performed prior to initial use for release purposes.

- a. The tank was filled to a known volume.
- b. A specific quantity of a selected chemical and/or sediments was added to the tank.
- c. Recirculation was initiated through the normal path.
- d. Periodic samples were taken until equilibrium was reached.
- e. The time observed to completely mix the tank is used as a minimum recirculation time prior to effluent sampling. Records of the test will be maintained.

5.3.4 Dose Projection for Liquid Effluents

At least once every 31 days, the total dose from all liquid releases for the quarter-to-date will be divided by the number of days expired in the quarter and multiplied by 31.

5.4 GASEOUS EFFLUENTS

NOTE

The Offsite Dose Calculation Manual (ODCM) follows the general models suggested by NUREG 0133 and Regulatory Guide 1.109. However, alternate calculation methods from those presented may be used provided the overall methodology is acceptable and consistent with regulation or provided the alternate methodology is conservative. In addition, the most up-to-date dose conversion factors and bioaccumulation factors may be substituted in lieu of Regulatory Guide 1.109 values.

NOTE

Actual step-by-step dose calculations will be performed by in-plant procedures which are consistent with the methodology presented in this document.

5.4.1 Calculational Methodology for Gaseous Effluent Dose Rate

This section presents the calculational methods used for calculating gaseous effluent doses in fulfillment of Specification

- The dose rate due to the radioactive materials released in gaseous effluents from the site to areas at and beyond the SITE BOUNDARY shall be limited to the following values and expressions:

5.4 GASEOUS EFFLUENTS (cont'd)

Release rate limit for Noble Gases:

$$\overline{K(X/Q)_v} \sum_{i=1}^n K_i Q_{iv} \leq 500 \frac{\text{mrem}}{\text{yr}} \text{ total body} \quad (5)$$

$$\overline{(X/Q)_v} \sum_{i=1}^n (L_i + 1.1M_i) Q_{iv} \leq 3000 \frac{\text{mrem}}{\text{yr}} \text{ skin} \quad (6)$$

Release rate limit for Iodine-131, Iodine-133, Tritium and for all radionuclides in particulate form with half-lives greater than 8 days:

$$\overline{(X/Q)_v} \sum_{i=1}^n P_i Q_{iv} \leq 1500 \frac{\text{mrem}}{\text{yr}} \text{ any organ} \quad (7)$$

Where:

$\overline{(X/Q)_v} = 1.1\text{E-}5 \text{ sec/m}^3$ in the ESE sector at 0.6 mile for all vent releases (v) (the highest calculated annual average dispersion factor at the SITE BOUNDARY based on historical data Attachment 7.2). The actual X/Q for the time of release may be determined and used under certain circumstances;

$\sum_{i=1}^n$ = summation for all identified radionuclides;

5.4 GASEOUS EFFLUENTS (cont'd)

- K_i = the total body dose factor due to gamma emissions for each identified radionuclide (i) in units of mrem/yr per $\mu\text{Ci}/\text{m}^3$ (Attachment 7.4);
- L_i = the skin dose factor due to beta emissions for each identified radionuclide (i) in units of mrad/yr per $\mu\text{Ci}/\text{m}^3$ (Attachment 7.4);
- M_i = the air dose factor due to gamma emissions for each identified radionuclide (i) in units of mrad/yr per $\mu\text{Ci}/\text{m}^3$ (Attachment 7.4). The constant 1.1 converts air dose to skin dose;
- P_{it} = the thyroid dose parameter for Iodine-131, Iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days (i) for the inhalation pathway only, in mrem/yr per $\mu\text{Ci}/\text{m}^3$ (Attachment 7.19). The dose factor is based on the most restrictive age group (child) and most restrictive organ at the SITE BOUNDARY; and

5.4 GASEOUS EFFLUENTS (cont'd)

NOTE

All radioiodines are assumed to be released in elemental form.

Q_{iv} = the average release rate of radionuclides (i)
(either noble gas or Iodine-131, Iodine-133, tritium, and radionuclides in the particulate form with half-lives greater than 8 days, as appropriate) during the time of release from all vent releases (v). Value is averaged over one hour and is in units of $\mu\text{Ci}/\text{sec}$.

5.4 GASEOUS EFFLUENTS (cont'd)

5.4.2 Calculational Methodology for Noble Gas Doses

The air dose due to noble gases released in gaseous effluents to areas at or beyond the SITE BOUNDARY will be determined by the following expressions:

- a. During any calendar quarter,

for gamma radiation:

$$D_{\gamma} = (1.14e - 4)(\overline{X/Q})_v \sum_{i=1}^n M_i \sum_{j=1}^m \Delta t_j Q_{ijv} \quad (8)$$

for beta radiation:

$$D_{\beta} = (1.14e - 4)(\overline{X/Q})_v \sum_{i=1}^n N_i \sum_{j=1}^m \Delta t_j Q_{ijv} \quad (9)$$

- b. During any calendar year,

for gamma radiation:

$$D_{\gamma} = (1.14e - 4)(\overline{X/Q})_v \sum_{i=1}^n M_i \sum_{j=1}^m \Delta t_j Q_{ijv} \quad (10)$$

for beta radiation:

$$D_{\beta} = (1.14e - 4)(\overline{X/Q})_v \sum_{i=1}^n N_i \sum_{j=1}^m \Delta t_j Q_{ijv} \quad (11)$$

5.4 GASEOUS EFFLUENTS (cont'd)

Where:

D_γ = the total gamma (γ) air dose from gaseous effluents for the total time period and not to exceed 5 mrad quarterly and 10 mrad yearly;

D_β = the total beta (β) air dose from gaseous effluents for the total time period and not to exceed 10 mrad quarterly and 20 mrad yearly;

$1.14E-04$ = a constant of (1 yr/8760 hr);

$\overline{(X/Q)}_v = 1.1E-5 \text{ sec/m}^3$ in the ESE sector at 0.6 mile for all vent releases (v). The actual X/Q for the time of release may be determined and used under certain circumstances;

5.4 GASEOUS EFFLUENTS (cont'd)

M_i and N_i = the gamma and beta air dose factors
(respectively) for a uniform semi-infinite cloud of radionuclide (i) in
mrad/yr per $\mu\text{Ci}/\text{m}^3$ (Attachment 7.4);

Δt_j = the length of the jth time period over which Q_{ijv} are accumulated for all
gaseous releases in hours; and

Q_{ijv} = the average release rate of radionuclides (i) in gaseous effluent from all
vent releases (v) in $\mu\text{Ci}/\text{sec}$ during the time period Δt_j .

5.4 GASEOUS EFFLUENTS (cont'd)

5.4.3 Calculational Methodology for Doses Due to Radioiodines, Tritium, and Radioactive Materials in Particulate Form

The dose to an individual from iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released to areas at and beyond the SITE BOUNDARY will be determined by the following expressions:

During any calendar quarter:

$$D_{ita} = (1.14e - 4)\Delta t \sum_{i=1}^n R_{ita} W_v Q_{iv} \quad (12)$$

During any calendar year:

$$D_{ita} = (1.14e - 4)\Delta t \sum_{i=1}^n R_{ita} W_v Q_{iv} \quad (13)$$

5.4 GASEOUS EFFLUENTS (cont'd)

Where:

D_{ita} = the cumulative dose to an organ (t), age group (a),
due to radionuclides (i) in gaseous effluents; not to exceed 7.5 mrem
quarterly or 15 mrem yearly;

$1.14E-4$ = a constant of unit conversion

$$= 1 \text{ yr}/8760 \text{ hr};$$

Δt = the time required for the release in hours for all
releases per quarter or per year.

W_v = the dispersion parameter for estimating the dose to
an individual at the controlling location for long term vent releases (v);

= $\overline{(x/\rho)}_v$ for the inhalation pathway from vent releases (v) in sec/m^3 , from
historical data, at the location of the critical receptor (Attachment 7.2);

= $\overline{(y/\rho)}_v$ for the food and ground plane pathways
from vent releases (v) in $1/\text{m}^2$, from historical data at the location of the
critical receptor (Attachment 7.2), with the exception of tritium, which shall
use $W_v = \overline{(x/\rho)}_v$;

5.4 GASEOUS EFFLUENTS (cont'd)

R_{ita} = the dose factor from each identified radionuclide (i), for each applicable organ (t), and age group (a), in mrem/yr per $\mu\text{Ci}/\text{m}^3$ for the inhalation pathway (Attachment 7.5) and in mrem/yr per $\mu\text{Ci}/\text{m}^2\text{-sec}$ for the food and ground plane pathways (Attachments 7.6, 7.7, 7.8, 7.9, and 7.10). For sectors with real pathways within 5 miles of the plant, the values of R_i are used based on these real pathways. (R_i 's were calculated using the methodology found in NUREG 0133 (pages 31-36.); and

Q_{iv} = the average release rate of radionuclides (i) in gaseous effluent from all vent releases (v) in $\mu\text{Ci}/\text{sec}$.

5.4 GASEOUS EFFLUENTS (cont'd)

5.4.4 Gaseous Effluent Monitor Setpoint Calculational Methodology

- 5.4.4.1 The calculated high alarm/flow termination setpoint is the maximum value for that particular release. An administrative Safety Factor (SF) will be utilized in the setpoint calculation. To allow for simultaneous releases from common or different release points a Release Fraction (RF) may be used to allocate percentages of the total allowable release.
- 5.4.4.2 Since the noble gas dose rates are more limiting than the radioiodine dose rate, gaseous setpoints will be based on noble gas dose rates (less than or equal to 500 mrem/yr total body, and less than or equal to 3000 mrem/yr skin). Specifically, gaseous setpoints will be based on the most limiting of the following equations:

5.4 GASEOUS EFFLUENTS (cont'd)

a. Total body (Q_{tb}):

$$Q_{tb} = \frac{(500 \frac{mrem}{yr})(RF)(SF)}{\overline{(X/Q)}_v \frac{\left[\sum_{i=1}^n K_i Q_{iv} \right]}{\left[\sum_{i=1}^n Q_{iv} \right]}} \quad (14)$$

Where:

Q_{tb} = maximum release rate allowed to give a limiting total body dose rate of 500 mrem/yr in $\mu Ci/sec$;

$\sum_{i=1}^n$ = summation of all nuclides considered;

K_i = the total body dose factor due to gamma emissions for each identified radionuclide (i) in units of mrem/yr per $\mu Ci/m^3$ (Attachment 7.4);

5.4 GASEOUS EFFLUENTS (cont'd)

Q_{iv} = average release rate of isotope (i) from the release point (v) in $\mu\text{Ci}/\text{sec}$;

$\overline{(x/\sigma)}_v = 1.1\text{E-}5 \text{ sec}/\text{m}^3$ (in the ESE sector at 0.6 mile). The sector with highest value of annual average atmospheric dispersion factor at the site boundary for the release point (v) in question;

RF = release fraction allotted to release point in consideration; and

SF = administrative safety factor to account for uncontrollable variables (sampling, monitoring errors, etc.). A value of 0.8 is normally used for SF.

5.4 GASEOUS EFFLUENTS (cont'd)

b. For Skin (Q_{skin}):

$$Q_{skin} = \frac{(3000 \frac{mrem}{yr})(RF)(SF)}{(\%a)_v \left[\frac{\sum_{i=1}^n (L_i + 1.1M_i)Q_{iv}}{\sum_{i=1}^n Q_{iv}} \right]} \quad (15)$$

Where:

all terms are as defined in Step (a) for Q_{tb} ,
except:

Q_{skin} = maximum release rate allowed to give a limiting skin dose of
3000 mrem/yr in $\mu\text{Ci}/\text{sec}$;

L_i = skin dose factor due to beta emissions for each identified radionuclide
(i) in units of mrem/yr per $\mu\text{Ci}/\text{m}^3$ (Attachment 7.4);

1.1 = conversion factor to convert from air to skin dose; and

M_i = air dose factor due to gamma emissions for identified noble gas isotope
(i) in units of mrad/yr per $\mu\text{Ci}/\text{m}^3$ (Attachment 7.4).

5.4 GASEOUS EFFLUENTS (cont'd)

5.4.4.3 The monitor setpoint is calculated in the following manner:

$$SN = \frac{Q}{(F_{\max})(472)} \quad (16)$$

Where:

SN = maximum monitor setpoint in $\mu\text{Ci}/\text{cm}^3$;

Q = Minimum value of Q_{tb} or Q_{skin} ($\mu\text{Ci}/\text{sec}$).

F_{\max} = maximum effluent flow rate (cfm); and

472 = Unit conversion, CFM to cm^3/sec

5.4 GASEOUS EFFLUENTS (cont'd)

5.4.5 Dose Projection due to Gaseous Effluents

- 5.4.5.1 At least once every 31 days the gamma air dose, beta air dose and the maximum organ dose for the month-to-quarter will be divided by the number of days into the quarter and multiplied by 31.

5.5 40 CFR190 DOSE EVALUATION

For the evaluation of doses to real individuals from liquid releases, the same calculational methods as employed in Section 5.3.4 will be used. However, more encompassing and realistic assumptions will be made concerning the dilution and ingestion of radionuclides by individuals who live and fish in the Waterford 3 area.

The results of the Radiological Environmental Monitoring Program will be used in determining the realistic dose based on actual measured radionuclide concentrations. For the evaluation of doses to real individuals from gaseous releases, the same calculational methods as employed in sections 5.4.6 and 5.4.7 will be used. The total body dose factor should be substituted for the gamma air dose factor (M_i) to determine the total body dose. Otherwise, the same calculational sequence applies. More realistic assumptions will be made concerning the actual location of real individuals, the meteorological conditions, and the consumption of food. Data obtained from the latest land use census should be used to determine locations for evaluating doses. The results of the Radiological Environmental Monitoring Program will be included in determining more realistic doses based on actual measured radionuclide concentrations.

Cumulative dose contributions from direct radiation, from the reactor unit, and from Radwaste Storage Tanks shall be determined utilizing the results of routine plant perimeter surveys, TLD data, or a combination of both when necessary.

5.6 LIQUID AND GASEOUS RADWASTE PROCESSES

The block flow diagrams of the radwaste systems are shown in Attachments 7.11 and 7.12. In order to obtain a more detailed description, see the appropriate sections of the FSAR.

5.7 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM REQUIREMENTS

5.7.1 Description of the Radiological Environmental Monitoring Program

The Radiological Environmental Monitoring Program (REMP) is expounded on in Attachment 7.13, and the Sample Location Table, Attachment 7.14. Attachment 7.15 explains the sector and zone designations for the sample locations. Attachments 7.16, 7.17 and 7.18 show the sample locations within the 2,10, and 50 mile radius of Waterford 3.

Deviations are permitted from the required sampling schedule if specimens are unobtainable due to hazardous conditions, seasonal unavailability, malfunction of automatic sampling equipment and other legitimate reasons. If specimens are unobtainable due to sampling equipment malfunction, every effort shall be made to complete corrective action prior to the end of the next sampling period. All deviations from the sampling schedule shall be documented in the Annual Radiological Environmental Operating Report. It is recognized that, at times, it may not be possible or practical to continue to obtain samples of the media of choice at the most desired location or time. In these instances, suitable alternative media and locations may be chosen for the particular pathway in question and appropriate substitutions made within 30 days in the Radiological Environmental Monitoring Programs.

5.7 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM REQUIREMENTS (Cont'd)

5.7.2 Description of the Interlaboratory Comparison Program

Quality assurance in radiological environmental sampling will be maintained through participation in a selected Radiological Laboratory Quality Assurance Program. The summary of results will be presented in tabular form and will include the type of analysis, the preparation (collection) date, the date the results are returned, the mean of the analyses (usually triplicate), the standard deviation, the date the values are released for information, the known value, the three standard deviation limit, and a two standard deviation/three standard deviation warning/action flag. If the sample analysis indicates results outside the three standard deviation range, then the corrective actions taken to prevent a recurrence will be documented and submitted along with all results when the Annual Radiological Environmental Operating Report is submitted.

5.7 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM REQUIREMENTS (Cont'd)

5.7.3 Dispersion Parameters For Critical Locations

The dispersion parameters for the site boundary and where necessary, as identified by the Land Use Census, are listed in Attachment 7.2. This table will be subject to changes based on the Land Use Census and historical data.

5.3 ROUTINE EFFLUENT RELEASE REPORTS

5.8.1 Annual Radioactive Effluent Release Report

A routine Radioactive Effluent Release Report covering the operation of the unit during the previous Twelve months shall be submitted as specified in Waterford 3 SES, Technical Specification 6.9.1.8 prior to May 1 of each year. The radioactive effluent release report shall include:

- 5.8.1.1 A summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the units as outlined in Regulatory Guide 1.21, with data summarized on a quarterly basis following the format of Appendix B thereof.
- 5.8.1.2 An annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing of wind speed, wind direction, and atmospheric stability, and precipitation (if measured) on magnetic tape, or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability.

5.8 ROUTINE EFFLUENT RELEASE REPORTS (cont'd)

In lieu of submission with the Radioactive Effluent Release Report, the summary of required meteorological data may be filed on site and shall be provided to the NRC upon request. This same report shall include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit or station during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the SITE BOUNDARY (Attachment 7.1) during the reporting period. All assumptions used in making these assessments (i.e., specific activity, exposure time and location) shall be included in these reports. The meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents, as determined by sampling frequency and measurement, shall be used for determining the gaseous pathway doses. The assessment of radiation doses shall be performed in accordance with the methodology and parameters in this manual.

5.8 ROUTINE EFFLUENT RELEASE REPORTS (cont'd)

- 5.8.1.3 An assessment of radiation doses to the likely most exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources, including doses from primary effluent pathways and direct radiation, for the previous calendar year to show conformance with 40CFR190, "Environmental Radiation Standards for Nuclear Power Operation". Acceptable methods for calculating the dose contribution from liquid and gaseous effluents are given in Regulatory Guide 1.109, Rev. 1, October 1977, and NUREG-0133.
- 5.8.1.4 The following information for each class of solid waste (as defined by 10CFR 61) shipped off site during the report period:
- A. Container volume
 - B. Total curie quantity (specify whether determined by measurement or estimate),
 - C. Principal radionuclides (specify whether determined by measurement or estimate),
 - D. Source of waste and processing employed (e.g., dewatered spent resin, compacted dry waste, evaporator bottoms),
 - E. Type of container (e.g., LSA, Type A, Type B Large Quantity), and
 - F. Solidification agent or absorbent (e.g., cement, urea formaldehyde).

5.8 ROUTINE EFFLUENT RELEASE REPORTS (cont'd)

- 5.8.1.5 A list and description of unplanned releases from the site to UNRESTRICTED AREAS of radioactive materials in gaseous and liquid effluents made during the reporting period.**

- 5.8.1.6 Any changes to the Process Control Program (PCP) or the Offsite Dose Calculation Manual (ODCM), pursuant to Technical Specification 6.13 and 6.14, as well as a listing of new locations for dose calculations and/or environmental monitoring identified by the land use census. It shall also include information of any MAJOR CHANGES to Radioactive Waste Systems if the information is not submitted as part of the annual FSAR update. Any changes made to the sections of the Waterford III TRM listed on Attachment 7.23 shall be included as part of submittal of the changes made to the ODCM.**

5.8 ROUTINE EFFLUENT RELEASE REPORTS (cont'd)

A. The submittal providing information on ODCM changes shall contain:

- 1. Sufficiently detailed information to totally support the rationale for the change without benefit of additional or supplemental information. Information submitted should consist of a complete legible copy of the ODCM including the sections of the TRM listed on Attachment 7.23 together with appropriate analyses or evaluations justifying the change(s), if applicable.**
- 2. A determination that the change did not reduce the accuracy or reliability of dose calculations or setpoint determinations.**
- 3. Documentation of the fact that the change has been reviewed and found acceptable by the Onsite Safety Review Committee (OSRC).**

5.8 ROUTINE EFFLUENT RELEASE REPORTS (cont'd)

- B. The submittal providing information on PCP changes shall contain:
1. Information submitted should consist of a complete legible copy of the PCP, together with appropriate analyses or evaluations, justifying the changes(s), if applicable.
 2. Documentation of the fact that the change has been reviewed and found acceptable by the OSRC.

NOTE

Radioactive Waste System change information may be submitted as part of the annual FSAR update in lieu of the Annual Radioactive Effluent Release Report.

- C. The submittal providing information on licensee initiated MAJOR CHANGES to the radioactive waste systems (liquid, gaseous, and solid) shall contain:
1. A summary of the evaluation that led to the determination that the change could be made in accordance with 10CFR50.59
 2. Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information.
 3. A detailed description of the equipment, components and processes involved and the interfaces with other plant systems.
 4. An evaluation of the change which shows the predicted releases of radioactive materials in liquid and gaseous effluents and/or quantity of solid waste that differ from those previously predicted in the license application and amendments thereto.
 5. An evaluation of the change which shows the expected maximum exposures a member of the Public in the unrestricted area and to the general population that differ from those previously estimated in the license application and amendments thereto.

5.8 ROUTINE EFFLUENT RELEASE REPORTS (cont'd)

6. A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents and in solid waste, to the actual releases for the period before the changes are to be made.
 7. An estimate of the exposure to plant operating personnel as a result of the change.
 8. Documentation of the fact that the change was reviewed and found acceptable by the OSRC.
 9. Changes to Radioactive Waste Systems performed using the plant design change process will be reported as per design change procedures.
- 5.8.1.7** If applicable, a description of events which led to exceeding the following limiting condition for operation:
- A. The dose rate due to radioactive materials released in gaseous effluents from the site to areas at and beyond the site boundary shall be limited to TRM specification 3/4.11.2.1.
 - B. The quantity of radioactive material contained in each unprotected tank shall be limited to Technical Specification 3/4.11.1.4.

5.8 ROUTINE EFFLUENT RELEASE REPORTS (cont'd)

- 5.8.1.8 If applicable, identify the cause of the unavailability of milk or fresh leafy vegetable samples at locations required by TRM specification Table 3.12-1. The new location(s) for obtaining replacement samples shall be identified. Revised figure(s) and table for the ODCM reflecting the new locations shall be included in the report.
- 5.8.1.9 Identify the new location(s), if a land use census identifies an environmental sampling location that yields a calculated dose or dose commitment greater than the values currently being calculated pursuant to TRM Specification 3/4.11.2.3.
- 5.8.1.10 Identify the new location(s), and include a revised figure(s) and table for the ODCM reflecting the new location(s) if a land use census identifies an environmental sampling location(s) that yields a calculated dose or dose commitment (via the same exposure pathway) 20% greater than at a location from which samples are currently being obtained pursuant to TRM Specification 3/4.12.1.

5.8 ROUTINE EFFLUENT RELEASE REPORTS (cont'd)

- 5.8.1.11 With less than the minimum number of radioactive liquid or gaseous effluent monitoring instrumentation channels operable for 30 days or longer, as required by TRM Specification Table 3.3-12 or 3.3-13, explain in the next Annual Radioactive Effluent Release Report, pursuant to Technical Specification 6.9.1.8, why this inoperability was not corrected within the time specified.

NOTE

The Shift Manager shall be immediately notified and a Condition Report promptly initiated whenever an effluent sample is late or missing in accordance with applicable Specifications.

- 5.8.1.12 Identify any missing or late analysis results for radioactive effluent samples collected during the reporting period.

5.9 SPECIAL EFFLUENT REPORTS

5.9.1 The Shift Manager shall be immediately notified and a Condition Report promptly initiated whenever any of the following specifications have been exceeded. A Special Report shall be prepared for submittal to the NRC within 30 day period, as per the ACTION requirement of the specification that has been exceeded.

- TRM Radioactive Liquid Effluent Dose Specification 3/4.11.1.2
- TRM Radioactive Liquid Waste Treatment System Specification 3/4.11.1.3
- TRM Radioactive Gaseous Effluent Dose, Noble Gas Specification 3/4.11.2.2
- TRM Radioactive Gaseous Effluent Dose, Iodine 131, I-133, Tritium, and Radionuclides in Particulate Form Specification 3/4.11.2.3
- TRM Radioactive Gaseous Waste Treatment System Specification 3/4.11.2.4
- TRM Radioactive Effluent Total Dose Specification 3/4.11.4

5.9 SPECIAL EFFLUENT REPORTS (cont'd)

5.9.2 Environmental Protection Agency Reportable Quantities

If any of TRM specifications 3/4.11.1.1, 3/4.11.1.2, 3/4.11.2.1, 3/4.11.2.2, 3/4.11.2.3 have been exceeded, an evaluation of the Radioactivity released verses EPA Reportable Quantities (RQ's) shall be performed as soon as practical.

The Shift Manager shall be immediately notified and a Condition Report promptly initiated whenever any radionuclide released over a 24 hour period is greater than or equal to the EPA RQ. Notification requirements shall be performed as per UNT-006-010, Event Evaluation and Reporting. Recipients of notification are: The National Response Center, the State Emergency Response Commission, and the Local Emergency Planning Committee. Methods for determination of reportability and the Reportable Quantities values for radionuclides are contained within 40CFR302.

5.9 SPECIAL EFFLUENT REPORTS (cont'd)

5.9.3 Unplanned/Abnormal Effluent Releases

- 5.9.3.1 A Condition Report should be initiated, in accordance with LI-102, for an UNPLANNED/ABNORMAL RELEASE to ensure that reporting requirements are determined. The Condition Report shall also serve to document causes and corrective actions. Major liquid spills or gaseous releases can occur through improper valve line-up, pipe breakage, or leakage. Each incident should be treated on a case-by-case basis.

The Condition Report shall include:

- a description of the event and equipment involved,
- cause(s) for the release,
- consequences of the release (if known or available)
- actions taken to prevent recurrence.

It is recognized that all elements that are to be included in the Condition Report (listed above) may not be known when the Condition Report is initiated. These items should be included while using the normal Condition Reporting process.

All Condition Reports for UNPLANNED/ABNORMAL RELEASES shall be reviewed by:

- OSRC
- SRC
- The Vice President - Operations

The OSRC shall review evaluations, recommendations, and the disposition of corrective action(s) to prevent recurrence as documented in the Condition Report. These reports will be forwarded to the Safety Review Committee and the Vice President - Operations for additional review.

5.9 SPECIAL EFFLUENT REPORTS (cont'd)

5.9.3.2 Prepare an effluent assessment report for each occurrence of an UNPLANNED/ABNORMAL RELEASE of radioactive materials. The purpose of this report is to document offsite impacts due to radioactive effluent releases. This report should include a description of the event, remedial actions, results of sampling and analysis (if applicable). The assessment should include evaluations of the following:

- concentrations of radioactive materials in unrestricted areas
- doses to the most likely exposed member of the public
- any environmental impacts due to radioactivity in the environment.

All assumptions and calculations used should be described and provided when necessary to support the conclusions. Doses should be calculated in accordance with the methods and parameters contained within the ODCM. Each occurrence of an UNPLANNED/ABNORMAL RELEASE should also be included in the Annual Effluent Release Report covering the period for which the event occurred as per step 5.8.1.5.

Each effluent assessment report shall be reviewed by:

- OSRC
- SRC
- The Vice President - Operations

5.10 SECONDARY RELEASE PATHS

5.10.1 This section addresses potential release pathways which should not contribute more than 10% of the annual doses evaluated in this manual. The ODCM methodology for calculation of doses will be applied to an applicable release path if a likely potential arises for contributing more than 10% of the annual doses evaluated in this manual.

5.10.2 Secondary Release Paths are expected to release trivial quantities of radionuclides. Some examples of Secondary Release Paths are listed below:

- Unmonitored Secondary System Steam Vents/Reliefs
- Decon Shop/Hot Machine Shop Exhaust
- Turbine Building Ventilation Exhaust
- Unmonitored Tank Atmospheric Vents
- Radioactive Waste Compactor Building
- Radioactive Waste Solidification Building
- Cooling Tower Atmospheric Entrainment


6.0 RECORDS

None

7.0 ATTACHMENTS

Refer to Table of Contents

BOUNDARIES FOR
 RADIOACTIVE GASEOUS AND LIQUID EFFLUENTS

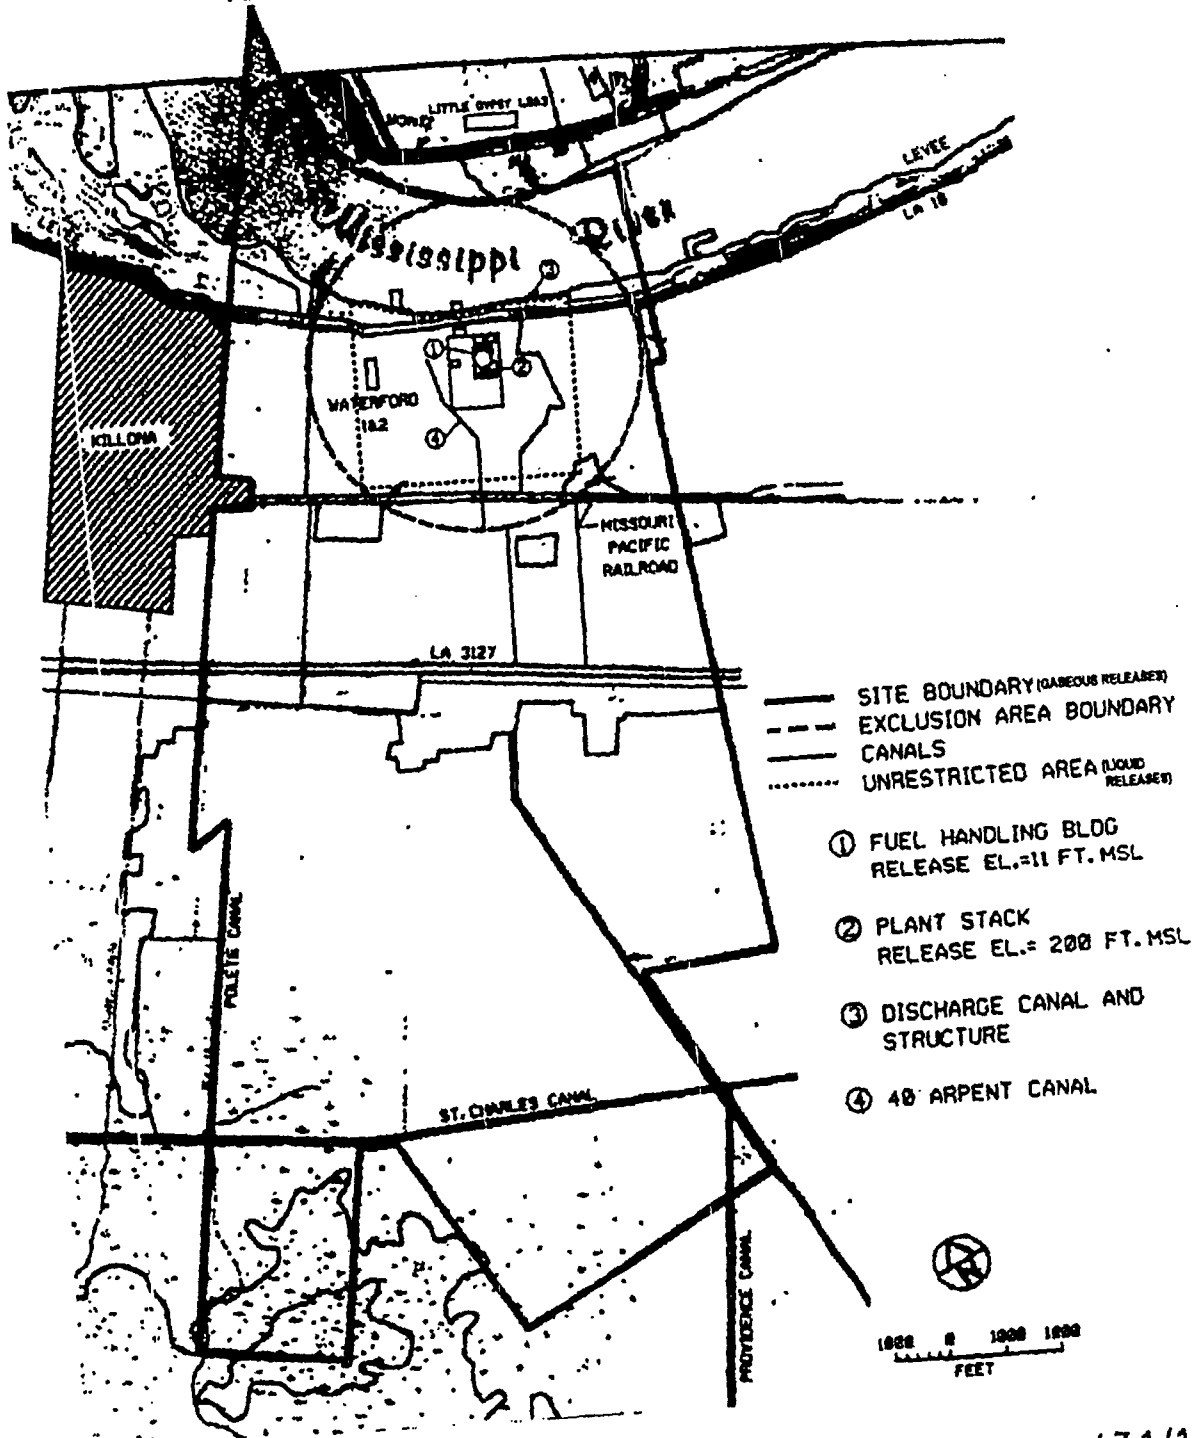

HISTORICAL AVERAGE DISPERSION AND DEPOSITION PARAMETERS FOR AREAS AT OR BEYOND THE UNRESTRICTED AREA BOUNDARY

ANNUAL AVERAGE ATMOSPHERIC DISPERSION AND DEPOSITION PARAMETERS
BASED ON HISTORICAL METEOROLOGICAL DATA AND CURRENT LAND USE CENSUS

| Receptor Type or Location | Direction from Site | Sector Location | Distance from Site | | X/Q No Decay Undepleted (sec/m3) | D/Q (1/m2) |
|---------------------------|---------------------|-----------------|--------------------|----------|---|---------------|
| | | | (miles) | (meters) | | |
| Site Boundary | N ^a | A | 0.8 | 1287 | 1.0e-05 | 2.4e-08 |
| | NNE ^a | B | 0.6 | 966 | 1.6e-05 | 3.4e-08 |
| | NE ^a | C | 0.6 | 966 | 1.5e-05 | 2.8e-08 |
| | ENE ^a | D | 0.6 | 966 | 1.6e-05 | 2.5e-08 |
| | E | E | 0.8 | 1287 | 6.9e-06 | 1.3e-08 |
| | ESE | F | 0.6 | 966 | 1.1e-05 | 2.3e-08 |
| | SE | G | 0.6 | 966 | 1.1e-05 | 3.1e-08 |
| | SSE | H | 0.8 | 1287 | 6.3e-06 | 2.4e-08 |
| | S | J | 1.6 | 2575 | 8.9e-07 | 2.7e-09 |
| | SSW | K | 3.1 | 4989 | 3.0e-07 | 7.9e-10 |
| | SW | L | 3.4 | 5472 | 3.3e-07 | 9.1e-10 |
| | WSW | M | 1.5 | 2414 | 1.7e-06 | 4.9e-09 |
| | W | N | 1.0 | 1609 | 2.3e-06 | 7.3e-09 |
| | WNW | P | 0.8 | 1287 | 7.5e-06 | 2.7e-08 |
| | NW | Q | 0.8 | 1287 | 1.0e-05 | 3.2e-08 |
| NNW | R | 0.9 | 1448 | 9.4e-06 | 2.4e-08 | |
| Residence | N | A | 0.9 | 1448 | 7.8e-06 | 1.8e-08 |
| | NNE | B | 1.3 | 2092 | 3.0e-06 | 5.8e-09 |
| | NE | C | 0.9 | 1448 | 6.3e-06 | 1.2e-08 |
| | ENE | D | 0.9 | 1448 | 6.8e-06 | 1.1e-08 |
| | E | E | 2.2 | 3541 | 7.4e-07 | 1.0e-09 |
| | ESE | F | 3.1 | 4989 | 3.7e-07 | 4.8e-10 |
| | SE | G | 4.0 | 6437 | 2.3e-07 | 3.6e-10 |
| | W | N | 1.0 | 1609 | 2.3e-06 | 7.3e-09 |
| | WNW | P | 0.9 | 1448 | 5.6e-06 | 2.0e-08 |
| | NW | Q | 0.9 | 1448 | 7.7e-06 | 2.3e-08 |
| | NNW | R | 3.0 | 4828 | 7.7e-07 | 1.3e-09 |
| | Milk Cow | NW ^b | Q | 0.9 | 1448 | 7.7e-06 |
| NW | | Q | 4.9 | 7886 | 2.6e-07 | 4.1e-10 |
| Vegetable Garden | N | A | 1.0 | 1609 | 6.1e-06 | 1.4e-08 |
| | NNE | B | 1.3 | 2092 | 3.0e-06 | 5.8e-09 |
| | NE | C | 0.9 | 1448 | 6.3e-06 | 1.2e-08 |
| | ENE | D | 0.9 | 1448 | 6.8e-06 | 1.1e-08 |
| | E | E | 2.2 | 3541 | 7.4e-07 | 1.0e-09 |
| | ESE | F | 2.2 | 3541 | 7.0e-07 | 1.1e-09 |
| | SE | G | 2.3 | 3701 | 6.2e-07 | 1.3e-09 |
| | WSW | M | 1.5 | 2414 | 1.7e-06 | 4.9e-09 |
| | W | N | 1.1 | 1770 | 1.9e-06 | 5.7e-09 |
| | WNW | P | 0.9 | 1448 | 5.6e-06 | 2.0e-08 |
| | NW | Q | 0.9 | 1448 | 7.7e-06 | 2.3e-08 |
| | NNW | R | 3.0 | 4828 | 7.7e-06 | 1.3e-09 |
| Beef Cow | E | E | 3.2 | 5150 | 3.7e-07 | 4.2e-10 |
| | ESE | F | 3.5 | 5633 | 3.0e-07 | 3.6e-10 |
| | SE | G | 4.5 | 7242 | 1.9e-07 | 2.8e-10 |
| | WSW | M | 1.2 | 1931 | 2.7e-06 | 8.6e-09 |
| | WNW | P | 0.9 | 1448 | 5.6e-06 | 2.0e-08 |
| | NW | Q | 0.9 | 1448 | 7.7e-06 | 2.3e-08 |
| NNW | R | 2.3 | 3701 | 1.3e-06 | 2.4e-09 | |

Notes: ^a The site boundary in this sector is located over water. The location cannot be occupied continuously for the life of the plant.

^b The animals at this location do not produce milk for human consumption.

SITE RELATED LIQUID INGESTION DOSE COMMITMENT FACTORS (A_i) FOR INDIVIDUAL NUCLIDES

A_i factors for Adult age group by nuclide.
 Waterford Steam Electric Station Unit III
 Discharge point : Circulating Water Discharge to Mississippi River
 Dilution Factor DW = 220.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 1.52e-01 | 1.52e-01 | 1.52e-01 | 1.52e-01 | 1.52e-01 | 1.52e-01 |
| Be-10 | 1.64e+01 | 2.54e+00 | 4.10e-01 | 0.00e+00 | 1.92e+00 | 0.00e+00 | 1.38e+02 |
| C-14 | 3.13e+04 | 6.26e+03 | 6.26e+03 | 6.26e+03 | 6.26e+03 | 6.26e+03 | 6.26e+03 |
| N-13 | 3.00e+03 | 3.00e+03 | 3.00e+03 | 3.00e+03 | 3.00e+03 | 3.00e+03 | 3.00e+03 |
| F-18 | 1.52e+01 | 0.00e+00 | 1.68e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.50e-01 |
| Na-22 | 4.17e+03 | 4.17e+03 | 4.17e+03 | 4.17e+03 | 4.17e+03 | 4.17e+03 | 4.17e+03 |
| Na-24 | 4.08e+02 | 4.08e+02 | 4.08e+02 | 4.08e+02 | 4.08e+02 | 4.08e+02 | 4.08e+02 |
| P-32 | 4.62e+07 | 2.87e+06 | 1.79e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.19e+06 |
| Ca-41 | 1.78e+04 | 0.00e+00 | 1.92e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.77e+01 |
| Sc-46 | 2.85e-02 | 5.53e-02 | 1.61e-02 | 0.00e+00 | 5.16e-02 | 0.00e+00 | 2.69e+02 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.27e+00 | 7.62e-01 | 2.81e-01 | 1.69e+00 | 3.21e+02 |
| Mn-54 | 0.00e+00 | 4.38e+03 | 8.35e+02 | 0.00e+00 | 1.30e+03 | 0.00e+00 | 1.34e+04 |
| Mn-56 | 0.00e+00 | 1.10e+02 | 1.95e+01 | 0.00e+00 | 1.40e+02 | 0.00e+00 | 3.52e+03 |
| Fe-55 | 6.59e+02 | 4.56e+02 | 1.06e+02 | 0.00e+00 | 0.00e+00 | 2.54e+02 | 2.61e+02 |
| Fe-59 | 1.04e+03 | 2.45e+03 | 9.38e+02 | 0.00e+00 | 0.00e+00 | 6.83e+02 | 8.15e+03 |
| Co-57 | 0.00e+00 | 2.10e+01 | 3.49e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.33e+02 |
| Co-58 | 0.00e+00 | 8.95e+01 | 2.01e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.81e+03 |
| Co-60 | 0.00e+00 | 2.57e+02 | 5.67e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.83e+03 |
| Ni-59 | 2.34e+03 | 8.03e+02 | 3.91e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.65e+02 |
| Ni-63 | 3.12e+04 | 2.16e+03 | 1.05e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.51e+02 |
| Ni-65 | 1.27e+02 | 1.64e+01 | 7.51e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.17e+02 |
| Cu-64 | 0.00e+00 | 1.00e+01 | 4.70e+00 | 0.00e+00 | 2.52e+01 | 0.00e+00 | 8.53e+02 |
| Zn-65 | 2.32e+04 | 7.37e+04 | 3.33e+04 | 0.00e+00 | 4.93e+04 | 0.00e+00 | 4.64e+04 |
| Zn-69 | 4.93e+01 | 9.43e+01 | 6.56e+00 | 0.00e+00 | 6.13e+01 | 0.00e+00 | 1.42e+01 |
| Zn-69m | 8.14e+02 | 1.95e+03 | 1.79e+02 | 0.00e+00 | 1.18e+03 | 0.00e+00 | 1.19e+05 |
| Se-79 | 0.00e+00 | 1.07e+03 | 1.79e+02 | 0.00e+00 | 1.85e+03 | 0.00e+00 | 2.19e+02 |
| Br-82 | 0.00e+00 | 0.00e+00 | 2.27e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.61e+03 |
| Br-83 | 0.00e+00 | 0.00e+00 | 4.04e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.82e+01 |
| Br-84 | 0.00e+00 | 0.00e+00 | 5.24e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.11e-04 |
| Br-85 | 0.00e+00 | 0.00e+00 | 2.15e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/hr per uCi/ml.

**SITE RELATED LIQUID INGESTION DOSE COMMITMENT
FACTORS (A_i) FOR INDIVIDUAL NUCLIDES**

Ai factors for Adult age group by nuclide.
Waterford Steam Electric Station Unit III
Discharge point : Circulating Water Discharge to Mississippi River
Dilution Factor DW = 220.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.01e+05 | 4.71e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.99e+04 |
| Rb-87 | 0.00e+00 | 5.89e+04 | 2.05e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.76e+03 |
| Rb-88 | 0.00e+00 | 2.90e+02 | 1.54e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.00e-09 |
| Rb-89 | 0.00e+00 | 1.92e+02 | 1.35e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.12e-11 |
| Sr-89 | 2.22e+04 | 0.00e+00 | 6.38e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.57e+03 |
| Sr-90 | 6.29e+05 | 0.00e+00 | 1.26e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.58e+04 |
| Sr-91 | 4.09e+02 | 0.00e+00 | 1.65e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.95e+03 |
| Sr-92 | 1.55e+02 | 0.00e+00 | 6.71e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.08e+03 |
| Y-90 | 5.79e-01 | 0.00e+00 | 1.55e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.14e+03 |
| Y-91 | 8.49e+00 | 0.00e+00 | 2.27e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.67e+03 |
| Y-91m | 5.47e-03 | 0.00e+00 | 2.12e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.61e-02 |
| Y-92 | 5.09e-02 | 0.00e+00 | 1.49e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.91e+02 |
| Y-93 | 1.61e-01 | 0.00e+00 | 4.46e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.12e+03 |
| Zr-93 | 3.46e-01 | 1.94e-02 | 9.02e-03 | 0.00e+00 | 7.34e-02 | 0.00e+00 | 2.01e+01 |
| Zr-95 | 2.52e-01 | 8.07e-02 | 5.46e-02 | 0.00e+00 | 1.27e-01 | 0.00e+00 | 2.56e+02 |
| Zr-97 | 1.39e-02 | 2.81e-03 | 1.28e-03 | 0.00e+00 | 4.24e-03 | 0.00e+00 | 8.69e+02 |
| Nb-93m | 1.83e+01 | 5.98e+00 | 1.47e+00 | 0.00e+00 | 6.88e+00 | 0.00e+00 | 2.76e+03 |
| Nb-95 | 4.47e+00 | 2.49e+00 | 1.34e+00 | 0.00e+00 | 2.46e+00 | 0.00e+00 | 1.51e+04 |
| Nb-97 | 3.75e-02 | 9.49e-03 | 3.46e-03 | 0.00e+00 | 1.11e-02 | 0.00e+00 | 3.50e+01 |
| Mo-93 | 0.00e+00 | 1.83e+02 | 4.94e+00 | 0.00e+00 | 5.18e+01 | 0.00e+00 | 2.97e+01 |
| Mo-99 | 0.00e+00 | 1.05e+02 | 1.99e+01 | 0.00e+00 | 2.37e+02 | 0.00e+00 | 2.43e+02 |
| Tc-101 | 9.22e-03 | 1.33e-02 | 1.30e-01 | 0.00e+00 | 2.39e-01 | 6.79e-03 | 3.99e-14 |
| Tc-99 | 4.54e+00 | 6.75e+00 | 1.82e+00 | 0.00e+00 | 8.49e+01 | 5.73e-01 | 2.21e+02 |
| Tc-99m | 8.96e-03 | 2.53e-02 | 3.23e-01 | 0.00e+00 | 3.85e-01 | 1.24e-02 | 1.50e+01 |
| Fu-103 | 4.50e+00 | 0.00e+00 | 1.94e+00 | 0.00e+00 | 1.72e+01 | 0.00e+00 | 5.25e+02 |
| Fu-105 | 3.75e-01 | 0.00e+00 | 1.48e-01 | 0.00e+00 | 4.84e+00 | 0.00e+00 | 2.29e+02 |
| Fu-106 | 6.69e+01 | 0.00e+00 | 8.46e+00 | 0.00e+00 | 1.29e+02 | 0.00e+00 | 4.33e+03 |
| Rh-105 | 2.94e+00 | 2.15e+00 | 1.42e+00 | 0.00e+00 | 9.14e+00 | 0.00e+00 | 3.43e+02 |
| Pd-107 | 0.00e+00 | 3.57e+00 | 2.29e-01 | 0.00e+00 | 3.21e+01 | 0.00e+00 | 2.22e+01 |
| Pd-109 | 0.00e+00 | 4.30e+00 | 9.70e-01 | 0.00e+00 | 2.46e+01 | 0.00e+00 | 4.77e+02 |

Conversion factors are in units of mrem/hr per uCi/ml.

**SITE RELATED LIQUID INGESTION DOSE COMMITMENT
FACTORS (A_i) FOR INDIVIDUAL NUCLIDES**

Ai factors for Adult age group by nuclide.
 Waterford Steam Electric Station Unit III
 Discharge point : Circulating Water Discharge to Mississippi River
 Dilution Factor DW = 220.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 9.42e-01 | 8.71e-01 | 5.17e-01 | 0.00e+00 | 1.71e+00 | 0.00e+00 | 3.55e+02 |
| Ag-111 | 3.42e-01 | 1.43e-01 | 7.12e-02 | 0.00e+00 | 4.61e-01 | 0.00e+00 | 2.62e+02 |
| Cd-113m | 0.00e+00 | 1.52e+03 | 4.89e+01 | 0.00e+00 | 1.68e+03 | 0.00e+00 | 1.23e+04 |
| Cd-115m | 0.00e+00 | 8.82e+02 | 2.81e+01 | 0.00e+00 | 7.00e+02 | 0.00e+00 | 3.71e+04 |
| Sn-123 | 2.23e+05 | 3.70e+03 | 5.45e+03 | 3.15e+03 | 0.00e+00 | 0.00e+00 | 4.55e+05 |
| Sn-125 | 5.98e+04 | 1.21e+03 | 2.71e+03 | 9.98e+02 | 0.00e+00 | 0.00e+00 | 7.47e+05 |
| Sn-126 | 6.07e+05 | 1.20e+04 | 1.72e+04 | 3.53e+03 | 0.00e+00 | 0.00e+00 | 1.75e+05 |
| Sb-124 | 7.76e+00 | 1.47e-01 | 3.08e+00 | 1.88e-02 | 0.00e+00 | 6.04e+00 | 2.20e+02 |
| Sb-125 | 4.96e+00 | 5.54e-02 | 1.18e+00 | 5.05e-03 | 0.00e+00 | 3.83e+00 | 5.46e+01 |
| Sb-126 | 3.19e+00 | 6.49e-02 | 1.15e+00 | 1.95e-02 | 0.00e+00 | 1.95e+00 | 2.61e+02 |
| Sb-127 | 7.15e-01 | 1.57e-02 | 2.74e-01 | 8.59e-03 | 0.00e+00 | 4.24e-01 | 1.64e+02 |
| Te-125m | 2.57e+03 | 9.30e+02 | 3.44e+02 | 7.72e+02 | 1.04e+04 | 0.00e+00 | 1.03e+04 |
| Te-127 | 1.05e+02 | 3.78e+01 | 2.28e+01 | 7.81e+01 | 4.29e+02 | 0.00e+00 | 8.32e+03 |
| Te-127m | 6.49e+03 | 2.32e+03 | 7.90e+02 | 1.66e+03 | 2.63e+04 | 0.00e+00 | 2.17e+04 |
| Te-129 | 3.01e+01 | 1.13e+01 | 7.33e+00 | 2.31e+01 | 1.26e+02 | 0.00e+00 | 2.27e+01 |
| Te-129m | 1.10e+04 | 4.11e+03 | 1.74e+03 | 3.78e+03 | 4.60e+04 | 0.00e+00 | 5.55e+04 |
| Te-131 | 1.89e+01 | 7.88e+00 | 5.96e+00 | 1.55e+01 | 8.27e+01 | 0.00e+00 | 2.67e+00 |
| Te-131m | 1.66e+03 | 8.10e+02 | 6.75e+02 | 1.28e+03 | 8.21e+03 | 0.00e+00 | 8.05e+04 |
| Te-132 | 2.41e+03 | 1.56e+03 | 1.47e+03 | 1.72e+03 | 1.50e+04 | 0.00e+00 | 7.39e+04 |
| Te-133m | 4.43e+01 | 2.59e+01 | 2.49e+01 | 3.75e+01 | 2.56e+02 | 0.00e+00 | 8.87e+00 |
| Te-134 | 3.10e+01 | 2.03e+01 | 1.25e+01 | 2.71e+01 | 1.96e+02 | 0.00e+00 | 3.44e-02 |
| I-129 | 1.19e+02 | 1.02e+02 | 3.34e+02 | 2.62e+05 | 2.19e+02 | 0.00e+00 | 1.61e+01 |
| I-130 | 2.74e+01 | 8.09e+01 | 3.19e+01 | 6.86e+03 | 1.26e+02 | 0.00e+00 | 6.97e+01 |
| I-131 | 1.51e+02 | 2.16e+02 | 1.24e+02 | 7.08e+04 | 3.70e+02 | 0.00e+00 | 5.70e+01 |
| I-132 | 7.37e+00 | 1.97e+01 | 6.89e+00 | 6.89e+02 | 3.14e+01 | 0.00e+00 | 3.70e+00 |
| I-133 | 5.15e+01 | 8.96e+01 | 2.73e+01 | 1.32e+04 | 1.56e+02 | 0.00e+00 | 8.06e+01 |
| I-134 | 3.85e+00 | 1.05e+01 | 3.74e+00 | 1.81e+02 | 1.66e+01 | 0.00e+00 | 9.11e-03 |
| I-135 | 1.61e+01 | 4.21e+01 | 1.55e+01 | 2.78e+03 | 6.75e+01 | 0.00e+00 | 4.75e+01 |
| Cs-134 | 2.98e+05 | 7.09e+05 | 5.79e+05 | 0.00e+00 | 2.29e+05 | 7.61e+04 | 1.24e+04 |
| Cs-134m | 1.02e+02 | 2.15e+02 | 1.10e+02 | 0.00e+00 | 1.16e+02 | 1.83e+01 | 7.57e+01 |

Conversion factors are in units of mrem/hr per uCi/ml.

SITE RELATED LIQUID INGESTION DOSE COMMITMENT FACTORS (A_i) FOR INDIVIDUAL NUCLIDES

A_i factors for Adult age group by nuclide.
 Waterford Steam Electric Station Unit III
 Discharge point : Circulating Water Discharge to Mississippi River
 Dilution Factor DW = 220.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 9.34e+04 | 8.62e+04 | 3.83e+04 | 0.00e+00 | 3.26e+04 | 9.77e+03 | 2.02e+03 |
| Cs-136 | 3.12e+04 | 1.23e+05 | 8.86e+04 | 0.00e+00 | 6.85e+04 | 9.39e+03 | 1.40e+04 |
| Cs-137 | 3.82e+05 | 5.22e+05 | 3.42e+05 | 0.00e+00 | 1.77e+05 | 5.89e+04 | 1.01e+04 |
| Cs-138 | 2.64e+02 | 5.22e+02 | 2.59e+02 | 0.00e+00 | 3.84e+02 | 3.79e+01 | 2.23e-03 |
| Cs-139 | 1.63e+02 | 2.43e+02 | 8.86e+01 | 0.00e+00 | 1.95e+02 | 1.77e+01 | 5.27e-21 |
| Ba-139 | 9.66e-01 | 6.88e-04 | 2.83e-02 | 0.00e+00 | 6.43e-04 | 3.90e-04 | 1.71e+00 |
| Ba-140 | 2.02e+02 | 2.54e-01 | 1.32e+01 | 0.00e+00 | 8.63e-02 | 1.45e-01 | 4.16e+02 |
| Ba-141 | 4.69e-01 | 3.54e-04 | 1.58e-02 | 0.00e+00 | 3.29e-04 | 2.01e-04 | 2.21e-10 |
| Ba-142 | 2.12e-01 | 2.18e-04 | 1.33e-02 | 0.00e+00 | 1.84e-04 | 1.23e-04 | 2.99e-19 |
| La-140 | 1.51e-01 | 7.59e-02 | 2.01e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.57e+03 |
| La-141 | 1.92e-02 | 5.96e-03 | 9.76e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.11e+02 |
| La-142 | 7.71e-03 | 3.51e-03 | 8.73e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.56e+01 |
| Ce-141 | 2.59e-02 | 1.75e-02 | 1.99e-03 | 0.00e+00 | 8.15e-03 | 0.00e+00 | 6.71e+01 |
| Ce-143 | 4.57e-03 | 3.38e+00 | 3.74e-04 | 0.00e+00 | 1.49e-03 | 0.00e+00 | 1.26e+02 |
| Ce-144 | 1.35e+00 | 5.66e-01 | 7.26e-02 | 0.00e+00 | 3.35e-01 | 0.00e+00 | 4.57e+02 |
| Pr-143 | 5.54e-01 | 2.22e-01 | 2.75e-02 | 0.00e+00 | 1.28e-01 | 0.00e+00 | 2.43e+03 |
| Pr-144 | 1.81e-03 | 7.53e-04 | 9.21e-05 | 0.00e+00 | 4.25e-04 | 0.00e+00 | 2.61e-10 |
| Nd-147 | 3.79e-01 | 4.38e-01 | 2.62e-02 | 0.00e+00 | 2.56e-01 | 0.00e+00 | 2.10e+03 |
| Pm-147 | 4.54e+00 | 4.27e-01 | 1.73e-01 | 0.00e+00 | 8.07e-01 | 0.00e+00 | 5.38e+02 |
| Pm-148 | 4.32e-01 | 7.17e-02 | 3.61e-02 | 0.00e+00 | 1.36e-01 | 0.00e+00 | 5.63e+03 |
| Pm-148m | 1.85e+00 | 4.79e-01 | 3.66e-01 | 0.00e+00 | 7.23e-01 | 0.00e+00 | 4.06e+03 |
| Pm-149 | 9.15e-02 | 1.29e-02 | 5.29e-03 | 0.00e+00 | 2.45e-02 | 0.00e+00 | 2.43e+03 |
| Pm-151 | 4.20e-02 | 7.05e-03 | 3.56e-03 | 0.00e+00 | 1.26e-02 | 0.00e+00 | 1.94e+03 |
| Sm-151 | 4.16e+00 | 7.17e-01 | 1.72e-01 | 0.00e+00 | 8.01e-01 | 0.00e+00 | 3.16e+02 |
| Sn-153 | 5.16e-02 | 4.31e-02 | 3.14e-03 | 0.00e+00 | 1.39e-02 | 0.00e+00 | 1.54e+03 |
| Eu-152 | 1.17e+01 | 2.67e+00 | 2.35e+00 | 0.00e+00 | 1.66e+01 | 0.00e+00 | 1.54e+03 |
| Eu-154 | 3.70e+01 | 4.55e+00 | 3.24e+00 | 0.00e+00 | 2.18e+01 | 0.00e+00 | 3.30e+03 |
| Eu-155 | 5.18e+00 | 7.35e-01 | 4.74e-01 | 0.00e+00 | 3.39e+00 | 0.00e+00 | 5.78e+02 |
| Eu-156 | 8.25e-01 | 6.38e-01 | 1.03e-01 | 0.00e+00 | 4.26e-01 | 0.00e+00 | 4.37e+03 |
| Tb-160 | 2.83e+00 | 0.00e+00 | 3.53e-01 | 0.00e+00 | 1.17e+00 | 0.00e+00 | 2.61e+03 |

Conversion factors are in units of mrem/hr per uCi/ml.

**SITE RELATED LIQUID INGESTION DOSE COMMITMENT
FACTORS (A_i) FOR INDIVIDUAL NUCLIDES**

A_i factors for Adult age group by nuclide.
Waterford Steam Electric Station Unit III
Discharge point : Circulating Water Discharge to Mississippi River
Dilution Factor DW = 220.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LII |
| Ho-166m | 1.63e+01 | 5.08e+00 | 3.85e+00 | 0.00e+00 | 7.59e+00 | 0.00e+00 | 1.54e+03 |
| W-181 | 2.85e+01 | 9.28e+00 | 9.94e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.06e+03 |
| W-185 | 1.16e+03 | 3.88e+02 | 4.08e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.48e+04 |
| W-187 | 2.96e+02 | 2.47e+02 | 8.65e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.10e+04 |
| Pb-210 | 3.67e+06 | 1.05e+06 | 1.30e+05 | 0.00e+00 | 2.95e+06 | 0.00e+00 | 5.37e+02 |
| Bi-210 | 1.67e+01 | 1.15e+02 | 9.58e+00 | 0.00e+00 | 1.39e+03 | 0.00e+00 | 1.72e+03 |
| Po-210 | 4.26e+05 | 9.05e+05 | 1.03e+05 | 0.00e+00 | 3.02e+06 | 0.00e+00 | 7.62e+04 |
| Ra-223 | 5.97e+05 | 9.19e+02 | 1.19e+05 | 0.00e+00 | 2.61e+04 | 0.00e+00 | 3.85e+04 |
| Ra-224 | 1.93e+05 | 4.68e+02 | 3.88e+04 | 0.00e+00 | 1.32e+04 | 0.00e+00 | 4.08e+04 |
| Ra-225 | 7.88e+05 | 9.34e+02 | 1.57e+05 | 0.00e+00 | 2.65e+04 | 0.00e+00 | 3.67e+04 |
| Ra-226 | 3.63e+07 | 6.89e+02 | 2.64e+07 | 0.00e+00 | 1.96e+04 | 0.00e+00 | 3.99e+04 |
| Ra-228 | 1.34e+07 | 3.75e+02 | 1.45e+07 | 0.00e+00 | 1.06e+04 | 0.00e+00 | 6.77e+03 |
| Ac-225 | 2.65e+02 | 3.65e+02 | 1.78e+01 | 0.00e+00 | 4.16e+01 | 0.00e+00 | 2.45e+04 |
| Ac-227 | 1.13e+05 | 1.49e+04 | 6.69e+03 | 0.00e+00 | 4.82e+03 | 0.00e+00 | 4.93e+03 |
| Th-227 | 9.89e+02 | 1.79e+01 | 2.85e+01 | 0.00e+00 | 1.02e+02 | 0.00e+00 | 3.90e+04 |
| Th-228 | 3.58e+04 | 6.06e+02 | 1.21e+03 | 0.00e+00 | 3.37e+03 | 0.00e+00 | 4.06e+04 |
| Th-229 | 9.82e+05 | 2.81e+04 | 1.62e+04 | 0.00e+00 | 1.36e+05 | 0.00e+00 | 5.64e+03 |
| Th-230 | 1.49e+05 | 8.45e+03 | 4.12e+03 | 0.00e+00 | 4.08e+04 | 0.00e+00 | 4.35e+03 |
| Th-232 | 1.66e+05 | 7.22e+03 | 1.08e+02 | 0.00e+00 | 3.48e+04 | 0.00e+00 | 3.70e+03 |
| Th-234 | 5.78e+00 | 3.40e-01 | 1.67e-01 | 0.00e+00 | 1.93e+00 | 0.00e+00 | 8.16e+03 |
| Pa-231 | 1.10e+05 | 4.11e+03 | 4.25e+03 | 0.00e+00 | 2.31e+04 | 0.00e+00 | 1.92e+03 |
| Pa-233 | 1.41e-01 | 2.83e-02 | 2.44e-02 | 0.00e+00 | 1.07e-01 | 0.00e+00 | 4.38e+02 |
| U-232 | 2.13e+04 | 0.00e+00 | 1.52e+03 | 0.00e+00 | 2.31e+03 | 0.00e+00 | 3.50e+02 |
| U-233 | 4.50e+03 | 0.00e+00 | 2.73e+02 | 0.00e+00 | 1.05e+03 | 0.00e+00 | 3.24e+02 |
| U-234 | 4.32e+03 | 0.00e+00 | 2.67e+02 | 0.00e+00 | 1.03e+03 | 0.00e+00 | 3.17e+02 |
| U-235 | 4.14e+03 | 0.00e+00 | 2.51e+02 | 0.00e+00 | 9.66e+02 | 0.00e+00 | 4.03e+02 |
| U-236 | 4.14e+03 | 0.00e+00 | 2.56e+02 | 0.00e+00 | 9.87e+02 | 0.00e+00 | 2.98e+02 |
| U-237 | 2.85e-01 | 0.00e+00 | 7.59e-02 | 0.00e+00 | 1.17e+00 | 0.00e+00 | 1.00e+02 |
| U-238 | 3.96e+03 | 0.00e+00 | 2.35e+02 | 0.00e+00 | 9.04e+02 | 0.00e+00 | 2.84e+02 |
| Np-237 | 3.06e+04 | 2.18e+03 | 1.35e+03 | 0.00e+00 | 1.00e+04 | 0.00e+00 | 1.93e+03 |

Conversion factors are in units of mrem/hr per uCi/ml.

**SITE RELATED LIQUID INGESTION DOSE COMMITMENT
FACTORS (A_i) FOR INDIVIDUAL NUCLIDES**

A_i factors for Adult age group by nuclide.
Waterford Steam Electric Station Unit III
Discharge point : Circulating Water Discharge to Mississippi River
Dilution Factor DW = 220.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Np-238 | 3.33e-01 | 8.97e-03 | 5.18e-03 | 0.00e+00 | 3.04e-02 | 0.00e+00 | 8.34e+02 |
| Np-239 | 2.89e-02 | 2.85e-03 | 1.57e-03 | 0.00e+00 | 8.88e-03 | 0.00e+00 | 5.84e+02 |
| Pu-238 | 5.52e+03 | 6.99e+02 | 1.50e+02 | 0.00e+00 | 6.41e+02 | 0.00e+00 | 6.39e+02 |
| Pu-239 | 6.35e+03 | 7.63e+02 | 1.67e+02 | 0.00e+00 | 7.10e+02 | 0.00e+00 | 5.83e+02 |
| Pu-240 | 6.34e+03 | 7.62e+02 | 1.67e+02 | 0.00e+00 | 7.09e+02 | 0.00e+00 | 5.94e+02 |
| Pu-241 | 1.37e+02 | 6.52e+00 | 2.91e+00 | 0.00e+00 | 1.34e+01 | 0.00e+00 | 1.23e+01 |
| Pu-242 | 5.88e+03 | 7.35e+02 | 1.61e+02 | 0.00e+00 | 6.84e+02 | 0.00e+00 | 5.72e+02 |
| Pu-244 | 6.87e+03 | 8.42e+02 | 1.85e+02 | 0.00e+00 | 7.84e+02 | 0.00e+00 | 8.52e+02 |
| Am-241 | 4.55e+04 | 4.25e+04 | 3.26e+03 | 0.00e+00 | 2.45e+04 | 0.00e+00 | 4.47e+03 |
| Am-242m | 4.58e+04 | 3.99e+04 | 3.27e+03 | 0.00e+00 | 2.44e+04 | 0.00e+00 | 5.63e+03 |
| Am-243 | 4.54e+04 | 4.16e+04 | 3.19e+03 | 0.00e+00 | 2.40e+04 | 0.00e+00 | 5.24e+03 |
| Cm-242 | 1.24e+03 | 1.32e+03 | 8.25e+01 | 0.00e+00 | 3.75e+02 | 0.00e+00 | 4.77e+03 |
| Cm-243 | 3.61e+04 | 3.31e+04 | 2.26e+03 | 0.00e+00 | 1.05e+04 | 0.00e+00 | 4.70e+03 |
| Cm-244 | 2.75e+04 | 2.57e+04 | 1.73e+03 | 0.00e+00 | 8.07e+03 | 0.00e+00 | 4.55e+03 |
| Cm-245 | 5.65e+04 | 4.92e+04 | 3.47e+03 | 0.00e+00 | 1.62e+04 | 0.00e+00 | 4.24e+03 |
| Cm-246 | 5.60e+04 | 4.91e+04 | 3.46e+03 | 0.00e+00 | 1.61e+04 | 0.00e+00 | 4.16e+03 |
| Cm-247 | 5.46e+04 | 4.84e+04 | 3.41e+03 | 0.00e+00 | 1.59e+04 | 0.00e+00 | 5.47e+03 |
| Cm-248 | 4.54e+05 | 3.99e+05 | 2.81e+04 | 0.00e+00 | 1.31e+05 | 0.00e+00 | 8.85e+04 |
| Cf-252 | 1.57e+04 | 0.00e+00 | 3.79e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.73e+04 |

Conversion factors are in units of mrem/hr per uCi/ml.

SITE RELATED LIQUID INGESTION DOSE COMMITMENT FACTORS (A_i) FOR INDIVIDUAL NUCLIDES

A_i factors for Adult age group by nuclide.
Waterford Steam Electric Station Unit III
Discharge point : 40 Arpent Canal
Dilution Factor DW = 1.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 1.29e-01 | 1.29e-01 | 1.29e-01 | 1.29e-01 | 1.29e-01 | 1.29e-01 |
| Be-10 | 1.52e+01 | 2.35e+00 | 3.80e-01 | 0.00e+00 | 1.78e+00 | 0.00e+00 | 1.28e+02 |
| C-14 | 3.13e+04 | 6.26e+03 | 6.26e+03 | 6.26e+03 | 6.26e+03 | 6.26e+03 | 6.26e+03 |
| N-13 | 3.00e+03 | 3.00e+03 | 3.00e+03 | 3.00e+03 | 3.00e+03 | 3.00e+03 | 3.00e+03 |
| F-18 | 1.49e+01 | 0.00e+00 | 1.66e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.43e-01 |
| Na-22 | 4.17e+03 | 4.17e+03 | 4.17e+03 | 4.17e+03 | 4.17e+03 | 4.17e+03 | 4.17e+03 |
| Na-24 | 4.07e+02 | 4.07e+02 | 4.07e+02 | 4.07e+02 | 4.07e+02 | 4.07e+02 | 4.07e+02 |
| P-32 | 4.62e+07 | 2.87e+06 | 1.79e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.19e+06 |
| Ca-41 | 1.77e+04 | 0.00e+00 | 1.92e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.76e+01 |
| Sc-46 | 2.64e-02 | 5.12e-02 | 1.49e-02 | 0.00e+00 | 4.78e-02 | 0.00e+00 | 2.49e+02 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.27e+00 | 7.61e-01 | 2.81e-01 | 1.69e+00 | 3.20e+02 |
| Mn-54 | 0.00e+00 | 4.38e+03 | 8.35e+02 | 0.00e+00 | 1.30e+03 | 0.00e+00 | 1.34e+04 |
| Mn-56 | 0.00e+00 | 1.10e+02 | 1.95e+01 | 0.00e+00 | 1.40e+02 | 0.00e+00 | 3.51e+03 |
| Fe-55 | 6.58e+02 | 4.55e+02 | 1.06e+02 | 0.00e+00 | 0.00e+00 | 2.54e+02 | 2.61e+02 |
| Fe-59 | 1.04e+03 | 2.44e+03 | 9.36e+02 | 0.00e+00 | 0.00e+00 | 6.82e+02 | 8.14e+03 |
| Co-57 | 0.00e+00 | 2.09e+01 | 3.48e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.31e+02 |
| Co-58 | 0.00e+00 | 8.92e+01 | 2.00e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.81e+03 |
| Co-60 | 0.00e+00 | 2.56e+02 | 5.65e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.81e+03 |
| Ni-59 | 2.34e+03 | 8.02e+02 | 3.90e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.65e+02 |
| Ni-63 | 3.11e+04 | 2.16e+03 | 1.04e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.50e+02 |
| Ni-65 | 1.26e+02 | 1.64e+01 | 7.49e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.17e+02 |
| Cu-64 | 0.00e+00 | 9.97e+00 | 4.68e+00 | 0.00e+00 | 2.51e+01 | 0.00e+00 | 8.50e+02 |
| Zn-65 | 2.32e+04 | 7.37e+04 | 3.33e+04 | 0.00e+00 | 4.93e+04 | 0.00e+00 | 4.64e+04 |
| Zn-69 | 4.93e+01 | 9.43e+01 | 6.56e+00 | 0.00e+00 | 6.13e+01 | 0.00e+00 | 1.42e+01 |
| Zn-69m | 8.14e+02 | 1.95e+03 | 1.79e+02 | 0.00e+00 | 1.18e+03 | 0.00e+00 | 1.19e+05 |
| Se-79 | 0.00e+00 | 1.07e+03 | 1.79e+02 | 0.00e+00 | 1.85e+03 | 0.00e+00 | 2.19e+02 |
| Br-82 | 0.00e+00 | 0.00e+00 | 2.27e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.60e+03 |
| Br-83 | 0.00e+00 | 0.00e+00 | 4.04e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.82e+01 |
| Br-84 | 0.00e+00 | 0.00e+00 | 5.24e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.11e-04 |
| Br-85 | 0.00e+00 | 0.00e+00 | 2.15e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/hr per uCi/ml.

**SITE RELATED LIQUID INGESTION DOSE COMMITMENT
FACTORS (A_i) FOR INDIVIDUAL NUCLIDES**

A_i factors for Adult age group by nuclide.
Waterford Steam Electric Station Unit III
Discharge point : 40 Arpent Canal
Dilution Factor DW = 1.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.01e+05 | 4.71e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.99e+04 |
| Rb-87 | 0.00e+00 | 5.89e+04 | 2.05e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.76e+03 |
| Rb-88 | 0.00e+00 | 2.90e+02 | 1.54e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.00e-09 |
| Rb-89 | 0.00e+00 | 1.92e+02 | 1.35e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.12e-11 |
| Sr-89 | 2.21e+04 | 0.00e+00 | 6.35e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.55e+03 |
| Sr-90 | 6.26e+05 | 0.00e+00 | 1.26e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.57e+04 |
| Sr-91 | 4.07e+02 | 0.00e+00 | 1.64e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.94e+03 |
| Sr-92 | 1.54e+02 | 0.00e+00 | 6.68e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.06e+03 |
| Y-90 | 5.76e-01 | 0.00e+00 | 1.54e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.10e+03 |
| Y-91 | 8.44e+00 | 0.00e+00 | 2.26e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.64e+03 |
| Y-91m | 5.44e-03 | 0.00e+00 | 2.11e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.60e-02 |
| Y-92 | 5.06e-02 | 0.00e+00 | 1.48e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.86e+02 |
| Y-93 | 1.60e-01 | 0.00e+00 | 4.43e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.09e+03 |
| Zr-93 | 3.30e-01 | 1.85e-02 | 8.61e-03 | 0.00e+00 | 7.01e-02 | 0.00e+00 | 1.92e+01 |
| Zr-95 | 2.40e-01 | 7.70e-02 | 5.21e-02 | 0.00e+00 | 1.21e-01 | 0.00e+00 | 2.44e+02 |
| Zr-97 | 1.33e-02 | 2.68e-03 | 1.22e-03 | 0.00e+00 | 4.04e-03 | 0.00e+00 | 8.30e+02 |
| Nb-93m | 1.83e+01 | 5.98e+00 | 1.47e+00 | 0.00e+00 | 6.87e+00 | 0.00e+00 | 2.76e+03 |
| Nb-95 | 4.47e+00 | 2.48e+00 | 1.34e+00 | 0.00e+00 | 2.46e+00 | 0.00e+00 | 1.51e+04 |
| Nb-97 | 3.75e-02 | 9.48e-03 | 3.46e-03 | 0.00e+00 | 1.11e-02 | 0.00e+00 | 3.50e+01 |
| Mo-93 | 0.00e+00 | 1.80e+02 | 4.86e+00 | 0.00e+00 | 5.10e+01 | 0.00e+00 | 2.92e+01 |
| Mo-99 | 0.00e+00 | 1.03e+02 | 1.96e+01 | 0.00e+00 | 2.34e+02 | 0.00e+00 | 2.39e+02 |
| Tc-101 | 9.12e-03 | 1.31e-02 | 1.29e-01 | 0.00e+00 | 2.37e-01 | 6.72e-03 | 3.95e-14 |
| Tc-99 | 4.49e+00 | 6.68e+00 | 1.80e+00 | 0.00e+00 | 8.40e+01 | 5.67e-01 | 2.18e+02 |
| Tc-99m | 8.87e-03 | 2.51e-02 | 3.19e-01 | 0.00e+00 | 3.81e-01 | 1.23e-02 | 1.48e+01 |
| Fu-103 | 4.43e+00 | 0.00e+00 | 1.91e+00 | 0.00e+00 | 1.69e+01 | 0.00e+00 | 5.17e+02 |
| Fu-105 | 3.69e-01 | 0.00e+00 | 1.46e-01 | 0.00e+00 | 4.76e+00 | 0.00e+00 | 2.26e+02 |
| Fu-106 | 6.58e+01 | 0.00e+00 | 8.33e+00 | 0.00e+00 | 1.27e+02 | 0.00e+00 | 4.26e+03 |
| Rh-105 | 2.90e+00 | 2.12e+00 | 1.40e+00 | 0.00e+00 | 9.00e+00 | 0.00e+00 | 3.38e+02 |
| Pd-107 | 0.00e+00 | 3.52e+00 | 2.25e-01 | 0.00e+00 | 3.16e+01 | 0.00e+00 | 2.18e+01 |
| Pd-109 | 0.00e+00 | 4.24e+00 | 9.55e-01 | 0.00e+00 | 2.42e+01 | 0.00e+00 | 4.63e+02 |

Conversion factors are in units of mrem/hr per uCi/ml.

SITE RELATED LIQUID INGESTION DOSE COMMITMENT FACTORS (A_i) FOR INDIVIDUAL NUCLIDES

A_i factors for Adult age group by nuclide.
 Waterford Steam Electric Station Unit III
 Discharge point : 40 Arpent Canal
 Dilution Factor DW = 1.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 8.81e-01 | 8.15e-01 | 4.84e-01 | 0.00e+00 | 1.60e+00 | 0.00e+00 | 3.33e+02 |
| Ag-111 | 3.20e-01 | 1.34e-01 | 6.66e-02 | 0.00e+00 | 4.32e-01 | 0.00e+00 | 2.46e+02 |
| Cd-113m | 0.00e+00 | 1.52e+03 | 4.88e+01 | 0.00e+00 | 1.68e+03 | 0.00e+00 | 1.23e+04 |
| Cd-115m | 0.00e+00 | 8.81e+02 | 2.81e+01 | 0.00e+00 | 6.99e+02 | 0.00e+00 | 3.71e+04 |
| Sn-123 | 2.23e+05 | 3.70e+03 | 5.45e+03 | 3.15e+03 | 0.00e+00 | 0.00e+00 | 4.55e+05 |
| Sn-125 | 5.98e+04 | 1.21e+03 | 2.71e+03 | 9.98e+02 | 0.00e+00 | 0.00e+00 | 7.47e+05 |
| Sn-126 | 6.07e+05 | 1.20e+04 | 1.72e+04 | 3.53e+03 | 0.00e+00 | 0.00e+00 | 1.75e+05 |
| Sb-124 | 6.70e+00 | 1.27e-01 | 2.66e+00 | 1.63e-02 | 0.00e+00 | 5.22e+00 | 1.90e+02 |
| Sb-125 | 4.29e+00 | 4.79e-02 | 1.02e+00 | 4.36e-03 | 0.00e+00 | 3.30e+00 | 4.72e+01 |
| Sb-126 | 2.75e+00 | 5.60e-02 | 9.94e-01 | 1.69e-02 | 0.00e+00 | 1.69e+00 | 2.25e+02 |
| Sb-127 | 6.18e-01 | 1.35e-02 | 2.37e-01 | 7.42e-03 | 0.00e+00 | 3.66e-01 | 1.41e+02 |
| Te-125m | 2.57e+03 | 9.30e+02 | 3.44e+02 | 7.72e+02 | 1.04e+04 | 0.00e+00 | 1.02e+04 |
| Te-127 | 1.05e+02 | 3.78e+01 | 2.28e+01 | 7.80e+01 | 4.29e+02 | 0.00e+00 | 8.31e+03 |
| Te-127m | 6.48e+03 | 2.32e+03 | 7.90e+02 | 1.66e+03 | 2.63e+04 | 0.00e+00 | 2.17e+04 |
| Te-129 | 3.01e+01 | 1.13e+01 | 7.33e+00 | 2.31e+01 | 1.26e+02 | 0.00e+00 | 2.27e+01 |
| Te-129m | 1.10e+04 | 4.11e+03 | 1.74e+03 | 3.78e+03 | 4.60e+04 | 0.00e+00 | 5.54e+04 |
| Te-131 | 1.89e+01 | 7.88e+00 | 5.96e+00 | 1.55e+01 | 8.26e+01 | 0.00e+00 | 2.67e+00 |
| Te-131m | 1.66e+03 | 8.10e+02 | 6.75e+02 | 1.28e+03 | 8.21e+03 | 0.00e+00 | 8.04e+04 |
| Te-132 | 2.41e+03 | 1.56e+03 | 1.47e+03 | 1.72e+03 | 1.50e+04 | 0.00e+00 | 7.38e+04 |
| Te-133m | 4.42e+01 | 2.59e+01 | 2.49e+01 | 3.74e+01 | 2.56e+02 | 0.00e+00 | 8.87e+00 |
| Te-134 | 3.10e+01 | 2.03e+01 | 1.24e+01 | 2.71e+01 | 1.96e+02 | 0.00e+00 | 3.44e-02 |
| I-129 | 1.17e+02 | 1.01e+02 | 3.31e+02 | 2.60e+05 | 2.17e+02 | 0.00e+00 | 1.59e+01 |
| I-130 | 2.71e+01 | 8.01e+01 | 3.16e+01 | 6.79e+03 | 1.25e+02 | 0.00e+00 | 6.89e+01 |
| I-131 | 1.49e+02 | 2.14e+02 | 1.22e+02 | 7.00e+04 | 3.66e+02 | 0.00e+00 | 5.64e+01 |
| I-132 | 7.29e+00 | 1.95e+01 | 6.82e+00 | 6.82e+02 | 3.11e+01 | 0.00e+00 | 3.66e+00 |
| I-133 | 5.10e+01 | 8.87e+01 | 2.70e+01 | 1.30e+04 | 1.55e+02 | 0.00e+00 | 7.97e+01 |
| I-134 | 3.81e+00 | 1.03e+01 | 3.70e+00 | 1.79e+02 | 1.64e+01 | 0.00e+00 | 9.01e-03 |
| I-135 | 1.59e+01 | 4.17e+01 | 1.54e+01 | 2.75e+03 | 6.68e+01 | 0.00e+00 | 4.70e+01 |
| Cs-134 | 2.98e+05 | 7.09e+05 | 5.79e+05 | 0.00e+00 | 2.29e+05 | 7.61e+04 | 1.24e+04 |
| Cs-134m | 1.02e+02 | 2.15e+02 | 1.10e+02 | 0.00e+00 | 1.16e+02 | 1.83e+01 | 7.57e+01 |

Conversion factors are in units of mrem/hr per uCi/ml.

**SITE RELATED LIQUID INGESTION DOSE COMMITMENT
FACTORS (A_i) FOR INDIVIDUAL NUCLIDES**

A_i factors for Adult age group by nuclide.
Waterford Steam Electric Station Unit III
Discharge point : 40 Arpent Canal
Dilution Factor DW = 1.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 9.34e+04 | 8.62e+04 | 3.83e+04 | 0.00e+00 | 3.26e+04 | 9.77e+03 | 2.02e+03 |
| Cs-136 | 3.12e+04 | 1.23e+05 | 8.86e+04 | 0.00e+00 | 6.85e+04 | 9.38e+03 | 1.40e+04 |
| Cs-137 | 3.82e+05 | 5.22e+05 | 3.42e+05 | 0.00e+00 | 1.77e+05 | 5.89e+04 | 1.01e+04 |
| Cs-138 | 2.64e+02 | 5.22e+02 | 2.59e+02 | 0.00e+00 | 3.84e+02 | 3.79e+01 | 2.23e-03 |
| Cs-139 | 1.63e+02 | 2.43e+02 | 8.86e+01 | 0.00e+00 | 1.95e+02 | 1.77e+01 | 5.27e-21 |
| Ba-139 | 9.29e-01 | 6.62e-04 | 2.72e-02 | 0.00e+00 | 6.19e-04 | 3.75e-04 | 1.65e+00 |
| Ba-140 | 1.94e+02 | 2.44e-01 | 1.27e+01 | 0.00e+00 | 8.30e-02 | 1.40e-01 | 4.00e+02 |
| Ba-141 | 4.51e-01 | 3.41e-04 | 1.52e-02 | 0.00e+00 | 3.17e-04 | 1.93e-04 | 2.13e-10 |
| Ba-142 | 2.04e-01 | 2.10e-04 | 1.28e-02 | 0.00e+00 | 1.77e-04 | 1.19e-04 | 2.87e-19 |
| La-140 | 1.50e-01 | 7.54e-02 | 1.99e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.54e+03 |
| La-141 | 1.91e-02 | 5.93e-03 | 9.70e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.06e+02 |
| La-142 | 7.66e-03 | 3.48e-03 | 8.68e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.54e+01 |
| Ce-141 | 2.24e-02 | 1.52e-02 | 1.72e-03 | 0.00e+00 | 7.04e-03 | 0.00e+00 | 5.79e+01 |
| Ce-143 | 3.95e-03 | 2.92e+00 | 3.23e-04 | 0.00e+00 | 1.29e-03 | 0.00e+00 | 1.09e+02 |
| Ce-144 | 1.17e+00 | 4.88e-01 | 6.27e-02 | 0.00e+00 | 2.90e-01 | 0.00e+00 | 3.95e+02 |
| Pr-143 | 5.51e-01 | 2.21e-01 | 2.73e-02 | 0.00e+00 | 1.27e-01 | 0.00e+00 | 2.41e+03 |
| Pr-144 | 1.80e-03 | 7.48e-04 | 9.16e-05 | 0.00e+00 | 4.22e-04 | 0.00e+00 | 2.59e-10 |
| Nd-147 | 3.76e-01 | 4.35e-01 | 2.60e-02 | 0.00e+00 | 2.54e-01 | 0.00e+00 | 2.09e+03 |
| Pm-147 | 4.51e+00 | 4.24e-01 | 1.72e-01 | 0.00e+00 | 8.02e-01 | 0.00e+00 | 5.34e+02 |
| Pm-148 | 4.29e-01 | 7.12e-02 | 3.59e-02 | 0.00e+00 | 1.35e-01 | 0.00e+00 | 5.60e+03 |
| Pm-148m | 1.84e+00 | 4.76e-01 | 3.64e-01 | 0.00e+00 | 7.18e-01 | 0.00e+00 | 4.03e+03 |
| Fm-149 | 9.10e-02 | 1.29e-02 | 5.25e-03 | 0.00e+00 | 2.43e-02 | 0.00e+00 | 2.41e+03 |
| Fm-151 | 4.17e-02 | 7.00e-03 | 3.54e-03 | 0.00e+00 | 1.25e-02 | 0.00e+00 | 1.93e+03 |
| Sm-151 | 4.13e+00 | 7.12e-01 | 1.71e-01 | 0.00e+00 | 7.96e-01 | 0.00e+00 | 3.14e+02 |
| Sm-153 | 5.13e-02 | 4.28e-02 | 3.12e-03 | 0.00e+00 | 1.38e-02 | 0.00e+00 | 1.53e+03 |
| Eu-152 | 1.17e+01 | 2.66e+00 | 2.33e+00 | 0.00e+00 | 1.65e+01 | 0.00e+00 | 1.53e+03 |
| Eu-154 | 3.68e+01 | 4.52e+00 | 3.22e+00 | 0.00e+00 | 2.17e+01 | 0.00e+00 | 3.28e+03 |
| Eu-155 | 5.15e+00 | 7.30e-01 | 4.71e-01 | 0.00e+00 | 3.37e+00 | 0.00e+00 | 5.75e+02 |
| Eu-156 | 8.20e-01 | 6.34e-01 | 1.02e-01 | 0.00e+00 | 4.24e-01 | 0.00e+00 | 4.35e+03 |
| Pb-160 | 2.81e+00 | 0.00e+00 | 3.51e-01 | 0.00e+00 | 1.16e+00 | 0.00e+00 | 2.59e+03 |

Conversion factors are in units of mrem/hr per uCi/ml.

**SITE RELATED LIQUID INGESTION DOSE COMMITMENT
FACTORS (A_i) FOR INDIVIDUAL NUCLIDES**

A_i factors for Adult age group by nuclide.
Waterford Steam Electric Station Unit III
Discharge point : 40 Arpent Canal
Dilution Factor DW = 1.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ho-166m | 1.62e+01 | 5.05e+00 | 3.83e+00 | 0.00e+00 | 7.54e+00 | 0.00e+00 | 1.53e+03 |
| W-181 | 2.85e+01 | 9.28e+00 | 9.94e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.06e+03 |
| W-185 | 1.16e+03 | 3.88e+02 | 4.08e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.48e+04 |
| W-187 | 2.96e+02 | 2.47e+02 | 8.65e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.10e+04 |
| Pb-210 | 3.66e+06 | 1.05e+06 | 1.30e+05 | 0.00e+00 | 2.94e+06 | 0.00e+00 | 5.36e+02 |
| Bi-210 | 1.66e+01 | 1.14e+02 | 9.48e+00 | 0.00e+00 | 1.38e+03 | 0.00e+00 | 1.71e+03 |
| Po-210 | 4.26e+05 | 9.05e+05 | 1.03e+05 | 0.00e+00 | 3.02e+06 | 0.00e+00 | 7.61e+04 |
| Ra-223 | 5.95e+05 | 9.16e+02 | 1.19e+05 | 0.00e+00 | 2.60e+04 | 0.00e+00 | 3.84e+04 |
| Ra-224 | 1.93e+05 | 4.67e+02 | 3.87e+04 | 0.00e+00 | 1.32e+04 | 0.00e+00 | 4.07e+04 |
| Ra-225 | 7.85e+05 | 9.31e+02 | 1.57e+05 | 0.00e+00 | 2.65e+04 | 0.00e+00 | 3.66e+04 |
| Ra-226 | 3.61e+07 | 6.87e+02 | 2.63e+07 | 0.00e+00 | 1.95e+04 | 0.00e+00 | 3.97e+04 |
| Ra-228 | 1.34e+07 | 3.73e+02 | 1.45e+07 | 0.00e+00 | 1.06e+04 | 0.00e+00 | 6.75e+03 |
| Ac-225 | 2.63e+02 | 3.63e+02 | 1.77e+01 | 0.00e+00 | 4.13e+01 | 0.00e+00 | 2.44e+04 |
| Ac-227 | 1.12e+05 | 1.48e+04 | 6.64e+03 | 0.00e+00 | 4.79e+03 | 0.00e+00 | 4.90e+03 |
| Th-227 | 9.84e+02 | 1.78e+01 | 2.84e+01 | 0.00e+00 | 1.01e+02 | 0.00e+00 | 3.88e+04 |
| Th-228 | 3.56e+04 | 6.03e+02 | 1.21e+03 | 0.00e+00 | 3.35e+03 | 0.00e+00 | 4.04e+04 |
| Th-229 | 9.77e+05 | 2.79e+04 | 1.62e+04 | 0.00e+00 | 1.35e+05 | 0.00e+00 | 5.61e+03 |
| Th-230 | 1.48e+05 | 8.40e+03 | 4.09e+03 | 0.00e+00 | 4.06e+04 | 0.00e+00 | 4.32e+03 |
| Th-232 | 1.65e+05 | 7.18e+03 | 1.08e+02 | 0.00e+00 | 3.46e+04 | 0.00e+00 | 3.68e+03 |
| Th-234 | 5.75e+00 | 3.38e-01 | 1.66e-01 | 0.00e+00 | 1.92e+00 | 0.00e+00 | 8.12e+03 |
| Pa-231 | 1.08e+05 | 4.06e+03 | 4.19e+03 | 0.00e+00 | 2.28e+04 | 0.00e+00 | 1.89e+03 |
| Pa-233 | 1.39e-01 | 2.79e-02 | 2.40e-02 | 0.00e+00 | 1.05e-01 | 0.00e+00 | 4.32e+02 |
| U-232 | 1.98e+04 | 0.00e+00 | 1.41e+03 | 0.00e+00 | 2.14e+03 | 0.00e+00 | 3.25e+02 |
| U-233 | 4.17e+03 | 0.00e+00 | 2.53e+02 | 0.00e+00 | 9.72e+02 | 0.00e+00 | 3.00e+02 |
| U-234 | 4.00e+03 | 0.00e+00 | 2.48e+02 | 0.00e+00 | 9.53e+02 | 0.00e+00 | 2.94e+02 |
| U-235 | 3.84e+03 | 0.00e+00 | 2.33e+02 | 0.00e+00 | 8.95e+02 | 0.00e+00 | 3.74e+02 |
| U-236 | 3.84e+03 | 0.00e+00 | 2.37e+02 | 0.00e+00 | 9.15e+02 | 0.00e+00 | 2.76e+02 |
| U-237 | 2.64e-01 | 0.00e+00 | 7.04e-02 | 0.00e+00 | 1.09e+00 | 0.00e+00 | 9.29e+01 |
| U-238 | 3.67e+03 | 0.00e+00 | 2.17e+02 | 0.00e+00 | 8.38e+02 | 0.00e+00 | 2.63e+02 |
| Np-237 | 3.02e+04 | 2.15e+03 | 1.33e+03 | 0.00e+00 | 9.86e+03 | 0.00e+00 | 1.90e+03 |

Conversion factors are in units of mrem/hr per uCi/ml.

SITE RELATED LIQUID INGESTION DOSE COMMITMENT FACTORS (A_i) FOR INDIVIDUAL NUCLIDES

A_i factors for Adult age group by nuclide.
 Waterford Steam Electric Station Unit III
 Discharge point : 40 Arpent Canal
 Dilution Factor DW = 1.0

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Np-238 | 3.28e-01 | 8.83e-03 | 5.10e-03 | 0.00e+00 | 2.99e-02 | 0.00e+00 | 8.21e+02 |
| Np-239 | 2.85e-02 | 2.80e-03 | 1.54e-03 | 0.00e+00 | 8.74e-03 | 0.00e+00 | 5.75e+02 |
| Pu-238 | 5.28e+03 | 6.69e+02 | 1.43e+02 | 0.00e+00 | 6.13e+02 | 0.00e+00 | 6.12e+02 |
| Pu-239 | 6.07e+03 | 7.30e+02 | 1.60e+02 | 0.00e+00 | 6.80e+02 | 0.00e+00 | 5.58e+02 |
| Pu-240 | 6.07e+03 | 7.29e+02 | 1.60e+02 | 0.00e+00 | 6.79e+02 | 0.00e+00 | 5.68e+02 |
| Pu-241 | 1.32e+02 | 6.24e+00 | 2.78e+00 | 0.00e+00 | 1.28e+01 | 0.00e+00 | 1.17e+01 |
| Pu-242 | 5.63e+03 | 7.03e+02 | 1.54e+02 | 0.00e+00 | 6.54e+02 | 0.00e+00 | 5.47e+02 |
| Pu-244 | 6.57e+03 | 8.05e+02 | 1.77e+02 | 0.00e+00 | 7.50e+02 | 0.00e+00 | 8.15e+02 |
| Am-241 | 4.52e+04 | 4.22e+04 | 3.24e+03 | 0.00e+00 | 2.44e+04 | 0.00e+00 | 4.44e+03 |
| Am-242m | 4.55e+04 | 3.97e+04 | 3.25e+03 | 0.00e+00 | 2.42e+04 | 0.00e+00 | 5.59e+03 |
| Am-243 | 4.51e+04 | 4.13e+04 | 3.17e+03 | 0.00e+00 | 2.39e+04 | 0.00e+00 | 5.21e+03 |
| Cm-242 | 1.23e+03 | 1.31e+03 | 8.20e+01 | 0.00e+00 | 3.72e+02 | 0.00e+00 | 4.74e+03 |
| Cm-243 | 3.59e+04 | 3.29e+04 | 2.24e+03 | 0.00e+00 | 1.05e+04 | 0.00e+00 | 4.67e+03 |
| Cm-244 | 2.73e+04 | 2.56e+04 | 1.72e+03 | 0.00e+00 | 8.02e+03 | 0.00e+00 | 4.52e+03 |
| Cm-245 | 5.61e+04 | 4.89e+04 | 3.45e+03 | 0.00e+00 | 1.61e+04 | 0.00e+00 | 4.21e+03 |
| Cm-246 | 5.57e+04 | 4.88e+04 | 3.44e+03 | 0.00e+00 | 1.60e+04 | 0.00e+00 | 4.14e+03 |
| Cm-247 | 5.43e+04 | 4.81e+04 | 3.39e+03 | 0.00e+00 | 1.58e+04 | 0.00e+00 | 5.44e+03 |
| Cm-248 | 4.51e+05 | 3.97e+05 | 2.79e+04 | 0.00e+00 | 1.30e+05 | 0.00e+00 | 8.80e+04 |
| Cf-252 | 1.56e+04 | 0.00e+00 | 3.76e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.72e+04 |

Conversion factors are in units of mrem/hr per uCi/ml.

DOSE FACTORS FOR EXPOSURE TO A SEMI-INFINITE CLOUD OF NOBLE GASES

| Nuclide | (N _i) | (L _i) | (M _i) | (K _i) |
|---------|-------------------|-------------------|-------------------|-------------------|
| | β-air* | β-Skin** | γ-air* | γ-Body** |
| Kr-83m | 2.88E+02 | -- | 1.93E+01 | 7.56E-02 |
| Kr-85m | 1.97E+03 | 1.46E+03 | 1.23E+03 | 1.17E+03 |
| Kr-85 | 1.95E+03 | 1.34E+03 | 1.72E+01 | 1.61E+01 |
| Kr-87 | 1.03E+04 | 9.73E+03 | 6.17E+03 | 5.92E+03 |
| Kr-88 | 2.93E+03 | 2.37E+03 | 1.52E+04 | 1.47E+04 |
| Kr-89 | 1.06E+04 | 1.01E+04 | 1.73E+04 | 1.66E+04 |
| Kr-90 | 7.83E+03 | 7.29E+03 | 1.63E+04 | 1.56E+04 |
| Xe-131m | 1.11E+03 | 4.76E+02 | 1.56E+02 | 9.15E+01 |
| Xe-133m | 1.48E+03 | 9.94E+02 | 3.27E+02 | 2.51E+02 |
| Xe-133 | 1.05E+03 | 3.06E+02 | 3.53E+02 | 2.94E+02 |
| Xe-135m | 7.39E+02 | 7.11E+02 | 3.36E+03 | 3.12E+03 |
| Xe-135 | 2.46E+03 | 1.86E+03 | 1.92E+03 | 1.81E+03 |
| Xe-137 | 1.27E+04 | 1.22E+04 | 1.51E+03 | 1.42E+03 |
| Xe-138 | 4.75E+03 | 4.13E+03 | 9.21E+03 | 8.83E+03 |
| Ar-41 | 3.28E+03 | 2.69E+03 | 9.30E+03 | 8.84E+03 |

$$* \frac{mrad - m^3}{\mu Ci - yr}$$

$$** \frac{mrem - m^3}{\mu Ci - yr}$$

Extracted from Table B-1 of Regulatory Guide 1.109, Revision 1, 1977
multiplied by 1E6 pCi/μCi.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 7.18e+02 | 7.18e+02 | 7.18e+02 | 7.18e+02 | 7.18e+02 | 7.18e+02 |
| Be-10 | 1.58e+06 | 2.45e+05 | 3.97e+04 | 0.00e+00 | 0.00e+00 | 1.78e+06 | 1.34e+05 |
| C-14 | 1.82e+04 | 3.41e+03 | 3.41e+03 | 3.41e+03 | 3.41e+03 | 3.41e+03 | 3.41e+03 |
| N-13 | 5.02e+01 | 5.02e+01 | 5.02e+01 | 5.02e+01 | 5.02e+01 | 5.02e+01 | 5.02e+01 |
| F-18 | 3.77e+03 | 0.00e+00 | 4.15e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.39e+01 |
| Na-22 | 1.04e+05 | 1.04e+05 | 1.04e+05 | 1.04e+05 | 1.04e+05 | 1.04e+05 | 1.04e+05 |
| Na-24 | 1.02e+04 | 1.02e+04 | 1.02e+04 | 1.02e+04 | 1.02e+04 | 1.02e+04 | 1.02e+04 |
| P-32 | 1.32e+06 | 7.71e+04 | 5.01e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.64e+04 |
| Ca-41 | 3.06e+05 | 0.00e+00 | 3.30e+04 | 0.00e+00 | 0.00e+00 | 3.06e+04 | 2.29e+03 |
| Sc-46 | 4.41e+05 | 8.56e+05 | 2.49e+05 | 0.00e+00 | 7.99e+05 | 0.00e+00 | 2.58e+05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.00e+02 | 5.95e+01 | 2.28e+01 | 1.44e+04 | 3.32e+03 |
| Mn-54 | 0.00e+00 | 3.96e+04 | 6.30e+03 | 0.00e+00 | 9.84e+03 | 1.40e+06 | 7.74e+04 |
| Mn-56 | 0.00e+00 | 1.24e+00 | 1.83e-01 | 0.00e+00 | 1.30e+00 | 9.44e+03 | 2.02e+04 |
| Fe-55 | 2.46e+04 | 1.70e+04 | 3.94e+03 | 0.00e+00 | 0.00e+00 | 7.21e+04 | 6.03e+03 |
| Fe-59 | 1.18e+04 | 2.78e+04 | 1.06e+04 | 0.00e+00 | 0.00e+00 | 1.02e+06 | 1.88e+05 |
| Cc-57 | 0.00e+00 | 6.92e+02 | 6.71e+02 | 0.00e+00 | 0.00e+00 | 3.70e+05 | 3.14e+04 |
| Cc-58 | 0.00e+00 | 1.58e+03 | 2.07e+03 | 0.00e+00 | 0.00e+00 | 9.28e+05 | 1.06e+05 |
| Cc-60 | 0.00e+00 | 1.15e+04 | 1.48e+04 | 0.00e+00 | 0.00e+00 | 5.97e+06 | 2.85e+05 |
| Ni-59 | 3.25e+04 | 1.17e+04 | 5.42e+03 | 0.00e+00 | 0.00e+00 | 6.56e+04 | 4.89e+03 |
| Ni-63 | 4.32e+05 | 3.14e+04 | 1.45e+04 | 0.00e+00 | 0.00e+00 | 1.78e+05 | 1.34e+04 |
| Ni-65 | 1.54e+00 | 2.10e-01 | 9.12e-02 | 0.00e+00 | 0.00e+00 | 5.60e+03 | 1.23e+04 |
| Cu-64 | 0.00e+00 | 1.46e+00 | 6.15e-01 | 0.00e+00 | 4.62e+00 | 6.78e+03 | 4.90e+04 |
| Zn-65 | 3.24e+04 | 1.03e+05 | 4.66e+04 | 0.00e+00 | 6.90e+04 | 8.64e+05 | 5.34e+04 |
| Zn-69 | 3.38e-02 | 6.51e-02 | 4.52e-03 | 0.00e+00 | 4.22e-02 | 9.20e+02 | 1.63e+01 |
| Zn-69m | 8.16e+00 | 1.96e+01 | 1.79e+00 | 0.00e+00 | 1.18e+01 | 1.90e+04 | 1.37e+05 |
| Se-79 | 0.00e+00 | 3.06e+03 | 4.87e+02 | 0.00e+00 | 4.55e+03 | 3.58e+05 | 2.66e+04 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.35e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.04e+04 |
| Br-83 | 0.00e+00 | 0.00e+00 | 2.41e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.32e+02 |
| Br-84 | 0.00e+00 | 0.00e+00 | 3.13e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.64e-03 |
| Br-85 | 0.00e+00 | 0.00e+00 | 1.28e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.35e+05 | 5.90e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.66e+04 |
| Rb-87 | 0.00e+00 | 7.89e+04 | 2.57e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.30e+03 |
| Rb-88 | 0.00e+00 | 3.87e+02 | 1.93e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.34e-09 |
| Rb-89 | 0.00e+00 | 2.56e+02 | 1.70e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.28e-12 |
| Sr-89 | 3.04e+05 | 0.00e+00 | 8.72e+03 | 0.00e+00 | 0.00e+00 | 1.40e+06 | 3.50e+05 |
| Sr-90 | 2.87e+07 | 0.00e+00 | 5.77e+05 | 0.00e+00 | 0.00e+00 | 9.60e+06 | 7.22e+05 |
| Sr-91 | 6.19e+01 | 0.00e+00 | 2.50e+00 | 0.00e+00 | 0.00e+00 | 3.65e+04 | 1.91e+05 |
| Sr-92 | 6.74e+00 | 0.00e+00 | 2.91e-01 | 0.00e+00 | 0.00e+00 | 1.65e+04 | 4.30e+04 |
| Y-90 | 2.09e+03 | 0.00e+00 | 5.61e+01 | 0.00e+00 | 0.00e+00 | 1.70e+05 | 5.06e+05 |
| Y-91 | 4.62e+05 | 0.00e+00 | 1.24e+04 | 0.00e+00 | 0.00e+00 | 1.70e+06 | 3.85e+05 |
| Y-91m | 2.61e-01 | 0.00e+00 | 1.02e-02 | 0.00e+00 | 0.00e+00 | 1.92e+03 | 1.33e+00 |
| Y-92 | 1.03e+01 | 0.00e+00 | 3.02e-01 | 0.00e+00 | 0.00e+00 | 1.57e+04 | 7.35e+04 |
| Y-93 | 9.44e+01 | 0.00e+00 | 2.61e+00 | 0.00e+00 | 0.00e+00 | 4.85e+04 | 4.22e+05 |
| Zr-93 | 4.18e+05 | 2.34e+04 | 1.10e+04 | 0.00e+00 | 8.88e+04 | 1.70e+05 | 1.21e+04 |
| Zr-95 | 1.07e+05 | 3.44e+04 | 2.33e+04 | 0.00e+00 | 5.42e+04 | 1.77e+06 | 1.50e+05 |
| Zr-97 | 9.68e+01 | 1.96e+01 | 9.04e+00 | 0.00e+00 | 2.97e+01 | 7.87e+04 | 5.23e+05 |
| Nb-93m | 2.48e+05 | 8.08e+04 | 1.99e+04 | 0.00e+00 | 9.28e+04 | 2.49e+05 | 1.90e+04 |
| Nb-95 | 1.41e+04 | 7.82e+03 | 4.21e+03 | 0.00e+00 | 7.74e+03 | 5.05e+05 | 1.04e+05 |
| Nb-97 | 2.22e-01 | 5.62e-02 | 2.05e-02 | 0.00e+00 | 6.54e-02 | 2.40e+03 | 2.42e+02 |
| Mo-93 | 0.00e+00 | 9.36e+03 | 2.54e+02 | 0.00e+00 | 2.84e+03 | 4.09e+05 | 3.03e+04 |
| Mo-99 | 0.00e+00 | 1.21e+02 | 2.30e+01 | 0.00e+00 | 2.91e+02 | 9.12e+04 | 2.48e+05 |
| Tc-101 | 4.18e-05 | 6.02e-05 | 5.90e-04 | 0.00e+00 | 1.08e-03 | 3.99e+02 | 1.09e-11 |
| Tc-99 | 2.50e+02 | 3.71e+02 | 1.00e+02 | 0.00e+00 | 4.68e+03 | 8.08e+05 | 6.03e+04 |
| Tc-99m | 1.03e-03 | 2.91e-03 | 3.70e-02 | 0.00e+00 | 4.42e-02 | 7.64e+02 | 4.16e+03 |
| Ru-103 | 1.53e+03 | 0.00e+00 | 6.58e+02 | 0.00e+00 | 5.83e+03 | 5.05e+05 | 1.10e+05 |
| Ru-105 | 7.90e-01 | 0.00e+00 | 3.11e-01 | 0.00e+00 | 1.02e+00 | 1.10e+04 | 4.82e+04 |
| Ru-106 | 6.91e+04 | 0.00e+00 | 8.72e+03 | 0.00e+00 | 1.34e+05 | 9.36e+06 | 9.12e+05 |
| Rh-105 | 7.39e+00 | 5.38e+00 | 3.54e+00 | 0.00e+00 | 2.29e+01 | 1.93e+04 | 8.72e+04 |
| Pd-107 | 0.00e+00 | 6.62e+02 | 4.70e+01 | 0.00e+00 | 5.26e+03 | 7.58e+04 | 5.65e+03 |
| Pd-109 | 0.00e+00 | 3.70e+00 | 9.28e-01 | 0.00e+00 | 1.88e+01 | 1.48e+04 | 1.22e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|----------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Aç-110m | 1.08e+04 | 1.00e+04 | 5.94e+03 | 0.00e+00 | 1.97e+04 | 4.63e+06 | 3.02e+05 |
| Aç-111 | 3.40e+02 | 1.42e+02 | 7.10e+01 | 0.00e+00 | 4.59e+02 | 1.86e+05 | 2.23e+05 |
| Ccl-113m | 0.00e+00 | 1.23e+06 | 3.98e+04 | 0.00e+00 | 1.37e+06 | 1.66e+06 | 1.27e+05 |
| Ccl-115m | 0.00e+00 | 1.97e+05 | 6.36e+03 | 0.00e+00 | 1.58e+05 | 1.41e+06 | 3.84e+05 |
| Sn-123 | 2.42e+05 | 5.34e+03 | 7.86e+03 | 4.54e+03 | 0.00e+00 | 2.30e+06 | 3.14e+05 |
| Sn-125 | 9.28e+03 | 2.50e+02 | 5.62e+02 | 2.07e+02 | 0.00e+00 | 5.90e+05 | 5.45e+05 |
| Sn-126 | 1.26e+06 | 3.34e+04 | 4.80e+04 | 9.84e+03 | 0.00e+00 | 9.36e+06 | 1.27e+05 |
| Sb-124 | 3.12e+04 | 5.89e+02 | 1.24e+04 | 7.55e+01 | 0.00e+00 | 2.48e+06 | 4.06e+05 |
| Sb-125 | 5.34e+04 | 5.95e+02 | 1.26e+04 | 5.40e+01 | 0.00e+00 | 1.74e+06 | 1.01e+05 |
| Sb-126 | 3.60e+03 | 7.30e+01 | 1.30e+03 | 2.20e+01 | 0.00e+00 | 7.66e+05 | 4.81e+05 |
| Sb-127 | 2.64e+02 | 5.78e+00 | 1.02e+02 | 3.18e+00 | 0.00e+00 | 1.64e+05 | 3.02e+05 |
| Te-125m | 3.42e+03 | 1.58e+03 | 4.67e+02 | 1.05e+03 | 1.24e+04 | 3.14e+05 | 7.06e+04 |
| Te-127 | 1.40e+00 | 6.42e-01 | 3.10e-01 | 1.06e+00 | 5.10e+00 | 6.51e+03 | 5.74e+04 |
| Te-127m | 1.26e+04 | 5.77e+03 | 1.57e+03 | 3.29e+03 | 4.58e+04 | 9.60e+05 | 1.50e+05 |
| Te-129 | 4.98e-02 | 2.39e-02 | 1.24e-02 | 3.90e-02 | 1.87e-01 | 1.94e+03 | 1.57e+02 |
| Te-129m | 9.76e+03 | 4.67e+03 | 1.58e+03 | 3.44e+03 | 3.66e+04 | 1.16e+06 | 3.83e+05 |
| Te-131 | 1.11e-02 | 5.95e-03 | 3.59e-03 | 9.36e-03 | 4.37e-02 | 1.39e+03 | 1.84e+01 |
| Te-131m | 6.99e+01 | 4.36e+01 | 2.90e+01 | 5.50e+01 | 3.09e+02 | 1.46e+05 | 5.56e+05 |
| Te-132 | 2.60e+02 | 2.15e+02 | 1.62e+02 | 1.90e+02 | 1.46e+03 | 2.88e+05 | 5.10e+05 |
| Te-133m | 5.79e-02 | 4.32e-02 | 3.34e-02 | 5.02e-02 | 2.99e-01 | 4.41e+03 | 6.12e+01 |
| Te-134 | 3.07e-02 | 2.58e-02 | 1.26e-02 | 2.75e-02 | 1.74e-01 | 3.47e+03 | 2.38e-01 |
| I-129 | 1.98e+04 | 1.69e+04 | 5.53e+04 | 4.43e+07 | 3.62e+04 | 0.00e+00 | 1.78e+03 |
| I-130 | 4.58e+03 | 1.34e+04 | 5.28e+03 | 1.14e+06 | 2.09e+04 | 0.00e+00 | 7.69e+03 |
| I-131 | 2.52e+04 | 3.58e+04 | 2.05e+04 | 1.19e+07 | 6.13e+04 | 0.00e+00 | 6.28e+03 |
| I-132 | 1.16e+03 | 3.26e+03 | 1.16e+03 | 1.14e+05 | 5.18e+03 | 0.00e+00 | 4.06e+02 |
| I-133 | 8.64e+03 | 1.48e+04 | 4.52e+03 | 2.15e+06 | 2.58e+04 | 0.00e+00 | 8.88e+03 |
| I-134 | 6.44e+02 | 1.73e+03 | 6.15e+02 | 2.98e+04 | 2.75e+03 | 0.00e+00 | 1.01e+00 |
| I-135 | 2.68e+03 | 6.98e+03 | 2.57e+03 | 4.48e+05 | 1.11e+04 | 0.00e+00 | 5.25e+03 |
| Cs-134 | 3.73e+05 | 8.48e+05 | 7.28e+05 | 0.00e+00 | 2.87e+05 | 9.76e+04 | 1.04e+04 |
| Cs-134m | 1.27e+02 | 2.56e+02 | 1.38e+02 | 0.00e+00 | 1.46e+02 | 2.34e+01 | 6.34e+01 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.17e+05 | 1.03e+05 | 4.79e+04 | 0.00e+00 | 4.09e+04 | 1.26e+04 | 1.69e+03 |
| Cs-136 | 3.90e+04 | 1.46e+05 | 1.10e+05 | 0.00e+00 | 8.56e+04 | 1.20e+04 | 1.17e+04 |
| Cs-137 | 4.78e+05 | 6.21e+05 | 4.28e+05 | 0.00e+00 | 2.22e+05 | 7.52e+04 | 8.40e+03 |
| Cs-138 | 3.31e+02 | 6.21e+02 | 3.24e+02 | 0.00e+00 | 4.80e+02 | 4.86e+01 | 1.86e-03 |
| Cs-139 | 2.05e+02 | 2.90e+02 | 1.11e+02 | 0.00e+00 | 2.44e+02 | 2.27e+01 | 4.39e-21 |
| Ba-139 | 9.36e-01 | 6.66e-04 | 2.74e-02 | 0.00e+00 | 6.22e-04 | 3.76e+03 | 8.96e+02 |
| Ba-140 | 3.90e+04 | 4.90e+01 | 2.57e+03 | 0.00e+00 | 1.67e+01 | 1.27e+06 | 2.18e+05 |
| Ba-141 | 1.00e-01 | 7.53e-05 | 3.36e-03 | 0.00e+00 | 7.00e-05 | 1.94e+03 | 1.16e-07 |
| Ba-142 | 2.63e-02 | 2.70e-05 | 1.66e-03 | 0.00e+00 | 2.29e-05 | 1.19e+03 | 1.57e-16 |
| La-140 | 3.44e+02 | 1.74e+02 | 4.58e+01 | 0.00e+00 | 0.00e+00 | 1.36e+05 | 4.58e+05 |
| La-141 | 4.27e+00 | 1.33e+00 | 2.17e-01 | 0.00e+00 | 0.00e+00 | 1.08e+04 | 5.85e+04 |
| La-142 | 6.83e-01 | 3.10e-01 | 7.72e-02 | 0.00e+00 | 0.00e+00 | 6.33e+03 | 2.11e+03 |
| Ce-141 | 1.99e+04 | 1.35e+04 | 1.53e+03 | 0.00e+00 | 6.26e+03 | 3.62e+05 | 1.20e+05 |
| Ce-143 | 1.86e+02 | 1.38e+02 | 1.53e+01 | 0.00e+00 | 6.08e+01 | 7.98e+04 | 2.26e+05 |
| Ce-144 | 3.43e+06 | 1.43e+06 | 1.84e+05 | 0.00e+00 | 8.48e+05 | 7.78e+06 | 8.16e+05 |
| Pr-143 | 9.36e+03 | 3.75e+03 | 4.64e+02 | 0.00e+00 | 2.16e+03 | 2.81e+05 | 2.00e+05 |
| Pr-144 | 3.01e-02 | 1.25e-02 | 1.53e-03 | 0.00e+00 | 7.05e-03 | 1.02e+03 | 2.15e-08 |
| Nd-147 | 5.27e+03 | 6.10e+03 | 3.65e+02 | 0.00e+00 | 3.56e+03 | 2.21e+05 | 1.73e+05 |
| Pm-147 | 6.70e+05 | 6.30e+04 | 2.55e+04 | 0.00e+00 | 1.19e+05 | 5.28e+05 | 4.43e+04 |
| Pm-148 | 3.07e+03 | 5.10e+02 | 2.56e+02 | 0.00e+00 | 9.60e+02 | 3.13e+05 | 4.64e+05 |
| Pm-148m | 7.86e+04 | 2.03e+04 | 1.55e+04 | 0.00e+00 | 3.08e+04 | 1.71e+06 | 3.34e+05 |
| Pm-149 | 2.75e+02 | 3.90e+01 | 1.59e+01 | 0.00e+00 | 7.35e+01 | 5.77e+04 | 2.00e+05 |
| Pm-151 | 6.80e+01 | 1.14e+01 | 5.77e+00 | 0.00e+00 | 2.04e+01 | 3.15e+04 | 1.60e+05 |
| Sm-151 | 6.87e+05 | 1.18e+05 | 2.84e+04 | 0.00e+00 | 1.33e+05 | 3.56e+05 | 2.60e+04 |
| Sm-153 | 1.36e+02 | 1.14e+02 | 8.32e+00 | 0.00e+00 | 3.67e+01 | 3.31e+04 | 1.26e+05 |
| Eu-152 | 1.90e+06 | 4.33e+05 | 3.81e+05 | 0.00e+00 | 2.68e+06 | 2.74e+06 | 1.27e+05 |
| Eu-154 | 5.92e+06 | 7.28e+05 | 5.18e+05 | 0.00e+00 | 3.49e+06 | 4.67e+06 | 2.72e+05 |
| Eu-155 | 8.08e+05 | 1.14e+05 | 7.37e+04 | 0.00e+00 | 5.27e+05 | 7.57e+05 | 4.76e+04 |
| Eu-156 | 1.54e+04 | 1.18e+04 | 1.92e+03 | 0.00e+00 | 7.96e+03 | 6.85e+05 | 3.60e+05 |
| Tb-160 | 1.77e+05 | 0.00e+00 | 2.20e+04 | 0.00e+00 | 7.28e+04 | 1.54e+06 | 2.14e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 2.70e+06 | 8.40e+05 | 6.40e+05 | 0.00e+00 | 1.26e+06 | 3.15e+06 | 1.27e+05 |
| W-181 | 4.98e+01 | 1.62e+01 | 1.74e+00 | 0.00e+00 | 0.00e+00 | 1.37e+04 | 2.02e+03 |
| W-185 | 1.56e+03 | 5.18e+02 | 5.45e+01 | 0.00e+00 | 0.00e+00 | 4.46e+05 | 8.56e+04 |
| W-187 | 8.48e+00 | 7.08e+00 | 2.48e+00 | 0.00e+00 | 0.00e+00 | 2.90e+04 | 1.55e+05 |
| Pb-210 | 2.11e+08 | 5.38e+07 | 6.70e+06 | 0.00e+00 | 1.70e+08 | 2.10e+08 | 1.21e+04 |
| Bi-210 | 1.85e+03 | 1.27e+04 | 1.06e+03 | 0.00e+00 | 1.54e+05 | 8.88e+06 | 2.36e+05 |
| Po-210 | 3.18e+06 | 6.88e+06 | 7.66e+05 | 0.00e+00 | 2.36e+07 | 2.51e+08 | 3.35e+05 |
| Ra-223 | 1.44e+06 | 2.22e+03 | 2.88e+05 | 0.00e+00 | 6.28e+04 | 2.04e+08 | 2.27e+06 |
| Ra-224 | 1.58e+05 | 3.82e+02 | 3.17e+04 | 0.00e+00 | 1.08e+04 | 7.02e+07 | 2.41e+06 |
| Ra-225 | 2.40e+06 | 2.85e+03 | 4.79e+05 | 0.00e+00 | 8.08e+04 | 2.34e+08 | 2.17e+06 |
| Ra-226 | 1.00e+09 | 1.91e+04 | 7.31e+08 | 0.00e+00 | 5.42e+05 | 9.36e+08 | 2.35e+06 |
| Ra-228 | 3.53e+08 | 9.84e+03 | 3.82e+08 | 0.00e+00 | 2.78e+05 | 1.29e+09 | 4.00e+05 |
| Ac-225 | 3.38e+06 | 4.66e+06 | 2.27e+05 | 0.00e+00 | 5.30e+05 | 1.77e+08 | 2.02e+06 |
| Ac-227 | 1.84e+10 | 2.44e+09 | 1.09e+09 | 0.00e+00 | 7.86e+08 | 1.93e+09 | 4.06e+05 |
| Tl-227 | 1.74e+06 | 3.14e+04 | 5.00e+04 | 0.00e+00 | 1.78e+05 | 3.02e+08 | 2.67e+06 |
| Th-228 | 1.60e+09 | 2.71e+07 | 5.42e+07 | 0.00e+00 | 1.51e+08 | 8.08e+09 | 2.79e+06 |
| Th-229 | 1.21e+11 | 3.47e+09 | 2.01e+09 | 0.00e+00 | 1.70e+10 | 2.90e+10 | 3.86e+05 |
| Th-230 | 1.83e+10 | 1.05e+09 | 5.09e+08 | 0.00e+00 | 5.12e+09 | 4.97e+09 | 2.98e+05 |
| Th-232 | 2.05e+10 | 8.96e+08 | 7.23e+06 | 0.00e+00 | 4.38e+09 | 4.77e+09 | 2.54e+05 |
| Th-234 | 1.30e+04 | 7.65e+02 | 3.76e+02 | 0.00e+00 | 4.33e+03 | 1.51e+06 | 5.62e+05 |
| Pa-231 | 4.06e+10 | 1.53e+09 | 1.58e+09 | 0.00e+00 | 8.56e+09 | 4.60e+08 | 3.55e+05 |
| Fa-233 | 9.68e+03 | 1.94e+03 | 1.67e+03 | 0.00e+00 | 7.32e+03 | 2.82e+05 | 8.16e+04 |
| U-232 | 4.11e+08 | 0.00e+00 | 2.93e+07 | 0.00e+00 | 4.45e+07 | 1.78e+09 | 3.37e+05 |
| U-233 | 8.72e+07 | 0.00e+00 | 5.28e+06 | 0.00e+00 | 2.03e+07 | 4.26e+08 | 3.11e+05 |
| U-234 | 8.32e+07 | 0.00e+00 | 5.17e+06 | 0.00e+00 | 1.99e+07 | 4.18e+08 | 3.05e+05 |
| U-235 | 8.00e+07 | 0.00e+00 | 4.86e+06 | 0.00e+00 | 1.87e+07 | 3.92e+08 | 3.87e+05 |
| U-236 | 8.00e+07 | 0.00e+00 | 4.96e+06 | 0.00e+00 | 1.91e+07 | 4.00e+08 | 2.86e+05 |
| U-237 | 2.94e+02 | 0.00e+00 | 7.82e+01 | 0.00e+00 | 1.21e+03 | 8.16e+04 | 9.60e+04 |
| U-238 | 7.66e+07 | 0.00e+00 | 4.54e+06 | 0.00e+00 | 1.74e+07 | 3.66e+08 | 2.73e+05 |
| Np-237 | 1.25e+10 | 8.00e+09 | 5.50e+08 | 0.00e+00 | 4.08e+09 | 4.18e+08 | 3.94e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**INHALATION PATHWAY DOSES DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 2.37e+03 | 5.76e+02 | 3.69e+01 | 0.00e+00 | 2.18e+02 | 8.16e+04 | 1.70e+05 |
| Np-239 | 2.30e+02 | 2.03e+02 | 1.24e+01 | 0.00e+00 | 7.00e+01 | 3.76e+04 | 1.19e+05 |
| Pu-238 | 1.14e+10 | 7.77e+09 | 5.52e+08 | 0.00e+00 | 2.37e+09 | 1.46e+09 | 3.62e+05 |
| Pu-239 | 1.33e+10 | 8.56e+09 | 6.20e+08 | 0.00e+00 | 2.64e+09 | 1.38e+09 | 3.30e+05 |
| Pu-240 | 1.32e+10 | 8.56e+09 | 6.18e+08 | 0.00e+00 | 2.63e+09 | 1.38e+09 | 3.37e+05 |
| Pu-241 | 2.74e+08 | 6.95e+07 | 1.03e+07 | 0.00e+00 | 4.74e+07 | 1.22e+06 | 6.92e+03 |
| Pu-242 | 1.22e+10 | 8.24e+09 | 5.97e+08 | 0.00e+00 | 2.54e+09 | 1.32e+09 | 3.24e+05 |
| Pu-244 | 1.43e+10 | 9.44e+09 | 6.83e+08 | 0.00e+00 | 2.91e+09 | 1.51e+09 | 4.82e+05 |
| Am-241 | 1.34e+10 | 9.04e+09 | 5.37e+08 | 0.00e+00 | 4.03e+09 | 4.85e+08 | 3.68e+05 |
| Am-242m | 1.36e+10 | 8.48e+09 | 5.38e+08 | 0.00e+00 | 4.01e+09 | 1.95e+08 | 4.63e+05 |
| Am-243 | 1.34e+10 | 8.80e+09 | 5.26e+08 | 0.00e+00 | 3.96e+09 | 4.60e+08 | 4.32e+05 |
| Cm-242 | 1.78e+08 | 1.42e+08 | 7.87e+06 | 0.00e+00 | 3.58e+07 | 3.14e+08 | 3.93e+05 |
| Cm-243 | 8.80e+09 | 6.09e+09 | 3.69e+08 | 0.00e+00 | 1.72e+09 | 5.05e+08 | 3.87e+05 |
| Cm-244 | 6.70e+09 | 4.70e+09 | 2.81e+08 | 0.00e+00 | 1.31e+09 | 4.85e+08 | 3.74e+05 |
| Cm-245 | 1.39e+10 | 9.12e+09 | 5.71e+08 | 0.00e+00 | 2.66e+09 | 4.68e+08 | 3.49e+05 |
| Cm-246 | 1.38e+10 | 9.12e+09 | 5.70e+08 | 0.00e+00 | 2.66e+09 | 4.77e+08 | 3.43e+05 |
| Cm-247 | 1.34e+10 | 8.96e+09 | 5.62e+08 | 0.00e+00 | 2.62e+09 | 4.68e+08 | 4.50e+05 |
| Cm-248 | 1.12e+11 | 7.41e+10 | 4.63e+09 | 0.00e+00 | 2.16e+10 | 3.86e+09 | 7.27e+06 |
| Cf-252 | 4.34e+09 | 0.00e+00 | 1.86e+08 | 0.00e+00 | 0.00e+00 | 1.59e+09 | 1.42e+06 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 7.25e+02 | 7.25e+02 | 7.25e+02 | 7.25e+02 | 7.25e+02 | 7.25e+02 |
| Be-10 | 2.22e+06 | 3.46e+05 | 5.67e+04 | 0.00e+00 | 0.00e+00 | 3.07e+06 | 1.42e+05 |
| C-14 | 2.60e+04 | 4.87e+03 | 4.87e+03 | 4.87e+03 | 4.87e+03 | 4.87e+03 | 4.87e+03 |
| N-13 | 6.92e+01 | 6.92e+01 | 6.92e+01 | 6.92e+01 | 6.92e+01 | 6.92e+01 | 6.92e+01 |
| F-18 | 5.22e+03 | 0.00e+00 | 5.68e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.11e+02 |
| Na-22 | 1.41e+05 | 1.41e+05 | 1.41e+05 | 1.41e+05 | 1.41e+05 | 1.41e+05 | 1.41e+05 |
| Na-24 | 1.38e+04 | 1.38e+04 | 1.38e+04 | 1.38e+04 | 1.38e+04 | 1.38e+04 | 1.38e+04 |
| P-32 | 1.89e+06 | 1.10e+05 | 7.16e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.28e+04 |
| Ca-41 | 3.24e+05 | 0.00e+00 | 3.50e+04 | 0.00e+00 | 0.00e+00 | 8.08e+08 | 2.42e+03 |
| Sc-46 | 5.79e+05 | 1.13e+06 | 3.34e+05 | 0.00e+00 | 1.08e+06 | 0.00e+00 | 2.38e+05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.35e+02 | 7.50e+01 | 3.07e+01 | 2.10e+04 | 3.00e+03 |
| Mn-54 | 0.00e+00 | 5.11e+04 | 8.40e+03 | 0.00e+00 | 1.27e+04 | 1.98e+06 | 6.68e+04 |
| Mn-56 | 0.00e+00 | 1.70e+00 | 2.52e-01 | 0.00e+00 | 1.79e+00 | 1.52e+04 | 5.74e+04 |
| Fe-55 | 3.34e+04 | 2.38e+04 | 5.54e+03 | 0.00e+00 | 0.00e+00 | 1.24e+05 | 6.39e+03 |
| Fe-59 | 1.59e+04 | 3.70e+04 | 1.43e+04 | 0.00e+00 | 0.00e+00 | 1.53e+06 | 1.78e+05 |
| Co-57 | 0.00e+00 | 9.44e+02 | 9.20e+02 | 0.00e+00 | 0.00e+00 | 5.86e+05 | 3.14e+04 |
| Co-58 | 0.00e+00 | 2.07e+03 | 2.78e+03 | 0.00e+00 | 0.00e+00 | 1.34e+06 | 9.52e+04 |
| Co-60 | 0.00e+00 | 1.51e+04 | 1.98e+04 | 0.00e+00 | 0.00e+00 | 8.72e+06 | 2.59e+05 |
| Ni-59 | 4.35e+04 | 1.62e+04 | 7.39e+03 | 0.00e+00 | 0.00e+00 | 1.13e+05 | 5.18e+03 |
| Ni-63 | 5.80e+05 | 4.34e+04 | 1.98e+04 | 0.00e+00 | 0.00e+00 | 3.07e+05 | 1.42e+04 |
| Ni-65 | 2.18e+00 | 2.93e-01 | 1.27e-01 | 0.00e+00 | 0.00e+00 | 9.36e+03 | 3.67e+04 |
| Cu-64 | 0.00e+00 | 2.03e+00 | 8.48e-01 | 0.00e+00 | 6.41e+00 | 1.11e+04 | 6.14e+04 |
| Zn-65 | 3.86e+04 | 1.34e+05 | 6.24e+04 | 0.00e+00 | 8.64e+04 | 1.24e+06 | 4.66e+04 |
| Zn-69 | 4.83e-02 | 9.20e-02 | 6.46e-03 | 0.00e+00 | 6.02e-02 | 1.58e+03 | 2.85e+02 |
| Zn-69m | 1.15e+01 | 2.71e+01 | 2.49e+00 | 0.00e+00 | 1.65e+01 | 3.14e+04 | 1.71e+05 |
| Se-79 | 0.00e+00 | 4.34e+03 | 6.97e+02 | 0.00e+00 | 6.50e+03 | 6.17e+05 | 2.82e+04 |
| Er-82 | 0.00e+00 | 0.00e+00 | 1.82e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 3.44e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 4.33e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 1.83e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.90e+05 | 8.40e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.77e+04 |
| Rb-87 | 0.00e+00 | 1.12e+05 | 3.66e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.44e+03 |
| Rb-88 | 0.00e+00 | 5.46e+02 | 2.72e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.92e-05 |
| Rb-89 | 0.00e+00 | 3.52e+02 | 2.33e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.38e-07 |
| Sr-89 | 4.34e+05 | 0.00e+00 | 1.25e+04 | 0.00e+00 | 0.00e+00 | 2.42e+06 | 3.71e+05 |
| Sr-90 | 3.31e+07 | 0.00e+00 | 6.66e+05 | 0.00e+00 | 0.00e+00 | 1.65e+07 | 7.65e+05 |
| Sr-91 | 8.80e+01 | 0.00e+00 | 3.51e+00 | 0.00e+00 | 0.00e+00 | 6.07e+04 | 2.59e+05 |
| Sr-92 | 9.52e+00 | 0.00e+00 | 4.06e-01 | 0.00e+00 | 0.00e+00 | 2.74e+04 | 1.19e+05 |
| Y-90 | 2.98e+03 | 0.00e+00 | 8.00e+01 | 0.00e+00 | 0.00e+00 | 2.93e+05 | 5.59e+05 |
| Y-91 | 6.61e+05 | 0.00e+00 | 1.77e+04 | 0.00e+00 | 0.00e+00 | 2.94e+06 | 4.09e+05 |
| Y-91m | 3.70e-01 | 0.00e+00 | 1.42e-02 | 0.00e+00 | 0.00e+00 | 3.20e+03 | 3.02e+01 |
| Y-92 | 1.47e+01 | 0.00e+00 | 4.29e-01 | 0.00e+00 | 0.00e+00 | 2.68e+04 | 1.65e+05 |
| Y-93 | 1.35e+02 | 0.00e+00 | 3.72e+00 | 0.00e+00 | 0.00e+00 | 8.32e+04 | 5.79e+05 |
| Zr-93 | 5.46e+05 | 2.70e+04 | 1.47e+04 | 0.00e+00 | 9.28e+04 | 2.94e+05 | 1.28e+04 |
| Zr-95 | 1.46e+05 | 4.58e+04 | 3.15e+04 | 0.00e+00 | 6.74e+04 | 2.69e+06 | 1.49e+05 |
| Zr-97 | 1.38e+02 | 2.72e+01 | 1.26e+01 | 0.00e+00 | 4.12e+01 | 1.30e+05 | 6.30e+05 |
| Nb-93m | 3.31e+05 | 1.09e+05 | 2.73e+04 | 0.00e+00 | 1.27e+05 | 4.29e+05 | 2.02e+04 |
| Nb-95 | 1.86e+04 | 1.03e+04 | 5.66e+03 | 0.00e+00 | 1.00e+04 | 7.51e+05 | 9.68e+04 |
| Nb-97 | 3.14e-01 | 7.78e-02 | 2.84e-02 | 0.00e+00 | 9.12e-02 | 3.93e+03 | 2.17e+03 |
| Mo-93 | 0.00e+00 | 1.33e+04 | 3.62e+02 | 0.00e+00 | 4.05e+03 | 7.05e+05 | 3.19e+04 |
| Mo-99 | 0.00e+00 | 1.69e+02 | 3.22e+01 | 0.00e+00 | 4.11e+02 | 1.54e+05 | 2.69e+05 |
| Tc-101 | 5.92e-05 | 8.40e-05 | 8.24e-04 | 0.00e+00 | 1.52e-03 | 6.67e+02 | 8.72e-07 |
| Tc-99 | 3.58e+02 | 5.26e+02 | 1.43e+02 | 0.00e+00 | 6.68e+03 | 1.39e+06 | 6.39e+04 |
| Tc-99m | 1.38e-03 | 3.86e-03 | 4.99e-02 | 0.00e+00 | 5.76e-02 | 1.15e+03 | 6.13e+03 |
| Ru-103 | 2.10e+03 | 0.00e+00 | 8.96e+02 | 0.00e+00 | 7.43e+03 | 7.83e+05 | 1.09e+05 |
| Ru-105 | 1.12e+00 | 0.00e+00 | 4.34e-01 | 0.00e+00 | 1.41e+00 | 1.82e+04 | 9.04e+04 |
| Ru-106 | 9.84e+04 | 0.00e+00 | 1.24e+04 | 0.00e+00 | 1.90e+05 | 1.61e+07 | 9.60e+05 |
| Rh-105 | 1.06e+01 | 7.58e+00 | 4.99e+00 | 0.00e+00 | 3.23e+01 | 3.27e+04 | 9.84e+04 |
| Pd-107 | 0.00e+00 | 9.36e+02 | 6.71e+01 | 0.00e+00 | 7.51e+03 | 1.30e+05 | 5.99e+03 |
| Pd-109 | 0.00e+00 | 5.25e+00 | 1.33e+00 | 0.00e+00 | 2.69e+01 | 2.55e+04 | 1.57e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Aç-110m | 1.38e+04 | 1.31e+04 | 7.99e+03 | 0.00e+00 | 2.50e+04 | 6.75e+06 | 2.73e+05 |
| Aç-111 | 4.86e+02 | 2.02e+02 | 1.01e+02 | 0.00e+00 | 6.54e+02 | 3.20e+05 | 2.40e+05 |
| Cd-113m | 0.00e+00 | 1.74e+06 | 5.68e+04 | 0.00e+00 | 1.94e+06 | 2.87e+06 | 1.34e+05 |
| Cd-115m | 0.00e+00 | 2.78e+05 | 9.12e+03 | 0.00e+00 | 2.26e+05 | 2.42e+06 | 4.08e+05 |
| Sn-123 | 3.45e+05 | 7.55e+03 | 1.12e+04 | 6.04e+03 | 0.00e+00 | 3.97e+06 | 3.33e+05 |
| Sn-125 | 1.33e+04 | 3.54e+02 | 7.99e+02 | 2.76e+02 | 0.00e+00 | 1.01e+06 | 5.83e+05 |
| Sn-126 | 1.74e+06 | 4.31e+04 | 6.59e+04 | 1.14e+04 | 0.00e+00 | 1.38e+07 | 1.34e+05 |
| Sb-124 | 4.30e+04 | 7.94e+02 | 1.68e+04 | 9.76e+01 | 0.00e+00 | 3.85e+06 | 3.98e+05 |
| Sb-125 | 7.38e+04 | 8.08e+02 | 1.72e+04 | 7.04e+01 | 0.00e+00 | 2.74e+06 | 9.92e+04 |
| Sb-126 | 4.95e+03 | 1.02e+02 | 1.78e+03 | 2.80e+01 | 0.00e+00 | 1.24e+06 | 4.81e+05 |
| Sb-127 | 3.71e+02 | 7.94e+00 | 1.40e+02 | 4.17e+00 | 0.00e+00 | 2.65e+05 | 3.15e+05 |
| Te-125m | 4.88e+03 | 2.24e+03 | 6.67e+02 | 1.40e+03 | 0.00e+00 | 5.36e+05 | 7.50e+04 |
| Te-127 | 2.01e+00 | 9.12e-01 | 4.42e-01 | 1.42e+00 | 7.28e+00 | 1.12e+04 | 8.08e+04 |
| Te-127m | 1.80e+04 | 8.16e+03 | 2.18e+03 | 4.38e+03 | 6.54e+04 | 1.66e+06 | 1.59e+05 |
| Te-129 | 7.10e-02 | 3.38e-02 | 1.76e-02 | 5.18e-02 | 2.66e-01 | 3.30e+03 | 1.62e+03 |
| Te-129m | 1.39e+04 | 6.58e+03 | 2.25e+03 | 4.58e+03 | 5.19e+04 | 1.98e+06 | 4.05e+05 |
| Te-131 | 1.58e-02 | 8.32e-03 | 5.04e-03 | 1.24e-02 | 6.18e-02 | 2.34e+03 | 1.51e+01 |
| Te-131m | 9.84e+01 | 6.01e+01 | 4.02e+01 | 7.25e+01 | 4.39e+02 | 2.38e+05 | 6.21e+05 |
| Te-132 | 3.60e+02 | 2.90e+02 | 2.19e+02 | 2.46e+02 | 1.95e+03 | 4.49e+05 | 4.63e+05 |
| Te-133m | 8.08e-02 | 5.86e-02 | 4.57e-02 | 6.54e-02 | 4.06e-01 | 6.97e+03 | 9.84e+02 |
| Te-134 | 4.25e-02 | 3.48e-02 | 2.91e-02 | 3.57e-02 | 2.33e-01 | 5.40e+03 | 1.10e+01 |
| I-129 | 2.82e+04 | 2.35e+04 | 3.92e+04 | 2.93e+07 | 4.21e+04 | 0.00e+00 | 1.83e+03 |
| I-130 | 6.24e+03 | 1.79e+04 | 7.17e+03 | 1.49e+06 | 2.75e+04 | 0.00e+00 | 9.12e+03 |
| I-131 | 3.54e+04 | 4.91e+04 | 2.64e+04 | 1.46e+07 | 8.40e+04 | 0.00e+00 | 6.49e+03 |
| I-132 | 1.59e+03 | 4.38e+03 | 1.58e+03 | 1.51e+05 | 6.92e+03 | 0.00e+00 | 1.27e+03 |
| I-133 | 1.22e+04 | 2.05e+04 | 6.22e+03 | 2.92e+06 | 3.59e+04 | 0.00e+00 | 1.03e+04 |
| I-134 | 8.88e+02 | 2.32e+03 | 8.40e+02 | 3.95e+04 | 3.66e+03 | 0.00e+00 | 2.04e+01 |
| I-135 | 3.70e+03 | 9.44e+03 | 3.49e+03 | 6.21e+05 | 1.49e+04 | 0.00e+00 | 6.95e+03 |
| Cs-134 | 5.02e+05 | 1.13e+06 | 5.49e+05 | 0.00e+00 | 3.75e+05 | 1.46e+05 | 9.76e+03 |
| Cs-134m | 1.76e+02 | 3.48e+02 | 1.88e+02 | 0.00e+00 | 2.03e+02 | 3.65e+01 | 1.62e+02 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.66e+05 | 1.46e+05 | 3.58e+04 | 0.00e+00 | 5.84e+04 | 2.16e+04 | 1.78e+03 |
| Cs-136 | 5.15e+04 | 1.94e+05 | 1.37e+05 | 0.00e+00 | 1.10e+05 | 1.78e+04 | 1.09e+04 |
| Cs-137 | 6.70e+05 | 8.48e+05 | 3.11e+05 | 0.00e+00 | 3.04e+05 | 1.21e+05 | 8.48e+03 |
| Cs-138 | 4.66e+02 | 8.56e+02 | 4.46e+02 | 0.00e+00 | 6.62e+02 | 7.87e+01 | 2.70e-01 |
| Cs-139 | 2.92e+02 | 4.10e+02 | 1.58e+02 | 0.00e+00 | 3.47e+02 | 3.89e+01 | 1.33e-13 |
| Ba-139 | 1.34e+00 | 9.44e-04 | 3.90e-02 | 0.00e+00 | 8.88e-04 | 6.46e+03 | 6.45e+03 |
| Ba-140 | 5.47e+04 | 6.70e+01 | 3.52e+03 | 0.00e+00 | 2.28e+01 | 2.03e+06 | 2.29e+05 |
| Ba-141 | 1.42e-01 | 1.06e-04 | 4.74e-03 | 0.00e+00 | 9.84e-05 | 3.29e+03 | 7.46e-04 |
| Ba-142 | 3.70e-02 | 3.70e-05 | 2.27e-03 | 0.00e+00 | 3.14e-05 | 1.91e+03 | 4.79e-10 |
| La-140 | 4.79e+02 | 2.36e+02 | 6.26e+01 | 0.00e+00 | 0.00e+00 | 2.14e+05 | 4.87e+05 |
| La-141 | 6.10e+00 | 1.88e+00 | 3.10e-01 | 0.00e+00 | 0.00e+00 | 1.85e+04 | 1.23e+05 |
| La-142 | 9.60e-01 | 4.25e-01 | 1.06e-01 | 0.00e+00 | 0.00e+00 | 1.02e+04 | 1.20e+04 |
| Ce-141 | 2.84e+04 | 1.90e+04 | 2.17e+03 | 0.00e+00 | 8.88e+03 | 6.14e+05 | 1.26e+05 |
| Ce-143 | 2.66e+02 | 1.94e+02 | 2.16e+01 | 0.00e+00 | 8.64e+01 | 1.30e+05 | 2.55e+05 |
| Ce-144 | 4.89e+06 | 2.02e+06 | 2.62e+05 | 0.00e+00 | 1.21e+06 | 1.34e+07 | 8.64e+05 |
| Pr-143 | 1.34e+04 | 5.31e+03 | 6.62e+02 | 0.00e+00 | 3.09e+03 | 4.83e+05 | 2.14e+05 |
| Pr-144 | 4.30e-02 | 1.76e-02 | 2.18e-03 | 0.00e+00 | 1.01e-02 | 1.75e+03 | 2.35e-04 |
| Nd-147 | 7.86e+03 | 8.56e+03 | 5.13e+02 | 0.00e+00 | 5.02e+03 | 3.72e+05 | 1.82e+05 |
| Pm-147 | 9.20e+05 | 8.80e+04 | 3.60e+04 | 0.00e+00 | 1.68e+05 | 9.12e+05 | 4.70e+04 |
| Pm-148 | 4.35e+03 | 7.10e+02 | 3.58e+02 | 0.00e+00 | 1.28e+03 | 5.22e+05 | 4.91e+05 |
| Pm-148m | 1.06e+05 | 2.68e+04 | 2.10e+04 | 0.00e+00 | 4.06e+04 | 2.56e+06 | 3.28e+05 |
| Pm-149 | 3.93e+02 | 5.51e+01 | 2.27e+01 | 0.00e+00 | 1.05e+02 | 9.92e+04 | 2.23e+05 |
| Pm-151 | 9.60e+01 | 1.59e+01 | 8.08e+00 | 0.00e+00 | 2.86e+01 | 5.25e+04 | 1.82e+05 |
| Sm-151 | 8.56e+05 | 1.68e+05 | 3.89e+04 | 0.00e+00 | 1.82e+05 | 6.14e+05 | 2.82e+04 |
| Sm-153 | 1.94e+02 | 1.61e+02 | 1.18e+01 | 0.00e+00 | 5.25e+01 | 5.69e+04 | 1.42e+05 |
| Eu-152 | 2.37e+06 | 5.75e+05 | 5.04e+05 | 0.00e+00 | 2.67e+06 | 4.01e+06 | 1.08e+05 |
| Eu-154 | 7.54e+06 | 9.84e+05 | 6.88e+05 | 0.00e+00 | 4.35e+06 | 7.30e+06 | 2.67e+05 |
| Eu-155 | 1.60e+06 | 1.57e+05 | 9.68e+04 | 0.00e+00 | 6.12e+05 | 1.21e+07 | 4.78e+05 |
| Eu-156 | 2.16e+04 | 1.62e+04 | 2.64e+03 | 0.00e+00 | 1.09e+04 | 1.10e+06 | 3.65e+05 |
| Tb-160 | 2.43e+05 | 0.00e+00 | 3.03e+04 | 0.00e+00 | 9.60e+04 | 2.38e+06 | 2.08e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Hc-166m | 3.52e+06 | 1.09e+06 | 7.90e+05 | 0.00e+00 | 1.60e+06 | 4.99e+06 | 1.34e+05 |
| W-181 | 7.12e+01 | 2.30e+01 | 2.41e+00 | 0.00e+00 | 0.00e+00 | 2.36e+04 | 2.15e+03 |
| W-185 | 2.22e+03 | 7.34e+02 | 7.78e+01 | 0.00e+00 | 0.00e+00 | 7.68e+05 | 9.12e+04 |
| W-187 | 1.20e+01 | 9.76e+00 | 3.43e+00 | 0.00e+00 | 0.00e+00 | 4.74e+04 | 1.77e+05 |
| Pb-210 | 2.47e+08 | 6.62e+07 | 8.56e+06 | 0.00e+00 | 2.36e+08 | 3.62e+08 | 1.28e+04 |
| Bi-210 | 2.64e+03 | 1.81e+04 | 1.51e+03 | 0.00e+00 | 2.19e+05 | 1.53e+07 | 2.55e+05 |
| Po-210 | 4.54e+06 | 9.76e+06 | 1.10e+06 | 0.00e+00 | 3.37e+07 | 4.33e+08 | 3.56e+05 |
| Ra-223 | 2.06e+06 | 3.14e+03 | 4.11e+05 | 0.00e+00 | 8.96e+04 | 3.51e+08 | 2.43e+06 |
| Ra-224 | 2.26e+05 | 5.42e+02 | 4.52e+04 | 0.00e+00 | 1.54e+04 | 1.21e+08 | 2.63e+06 |
| Ra-225 | 3.42e+06 | 4.03e+03 | 6.85e+05 | 0.00e+00 | 1.15e+05 | 4.03e+08 | 2.31e+06 |
| Ra-226 | 1.06e+09 | 2.70e+04 | 7.90e+08 | 0.00e+00 | 7.74e+05 | 1.62e+09 | 2.49e+06 |
| Ra-228 | 4.27e+08 | 1.39e+04 | 4.70e+08 | 0.00e+00 | 3.98e+05 | 2.22e+09 | 4.24e+05 |
| Ac-225 | 4.83e+06 | 6.60e+06 | 3.25e+05 | 0.00e+00 | 7.58e+05 | 3.05e+08 | 2.16e+06 |
| Ac-227 | 1.99e+10 | 2.95e+09 | 1.18e+09 | 0.00e+00 | 8.56e+08 | 3.33e+09 | 4.30e+05 |
| Th-227 | 2.47e+06 | 4.45e+04 | 7.14e+04 | 0.00e+00 | 2.54e+05 | 5.20e+08 | 2.86e+06 |
| Ta-228 | 2.08e+09 | 3.50e+07 | 7.02e+07 | 0.00e+00 | 1.96e+08 | 1.35e+10 | 2.96e+06 |
| Ta-229 | 1.23e+11 | 3.55e+09 | 2.05e+09 | 0.00e+00 | 1.74e+10 | 4.19e+10 | 4.10e+05 |
| Ta-230 | 1.87e+10 | 1.07e+09 | 5.19e+08 | 0.00e+00 | 5.24e+09 | 7.18e+09 | 3.16e+05 |
| Th-232 | 2.09e+10 | 9.12e+08 | 7.37e+06 | 0.00e+00 | 4.48e+09 | 6.88e+09 | 2.69e+05 |
| Th-234 | 1.86e+04 | 1.08e+03 | 5.37e+02 | 0.00e+00 | 6.18e+03 | 2.61e+06 | 5.99e+05 |
| Pa-231 | 4.26e+10 | 1.60e+09 | 1.66e+09 | 0.00e+00 | 8.96e+09 | 7.93e+08 | 3.77e+05 |
| Pa-233 | 1.34e+04 | 2.59e+03 | 2.31e+03 | 0.00e+00 | 9.76e+03 | 4.31e+05 | 8.00e+04 |
| U-232 | 5.85e+08 | 0.00e+00 | 4.18e+07 | 0.00e+00 | 6.35e+07 | 3.07e+09 | 3.57e+05 |
| U-233 | 1.24e+08 | 0.00e+00 | 7.54e+06 | 0.00e+00 | 2.90e+07 | 7.34e+08 | 3.30e+05 |
| U-234 | 1.18e+08 | 0.00e+00 | 7.38e+06 | 0.00e+00 | 2.84e+07 | 7.19e+08 | 3.23e+05 |
| U-235 | 1.14e+08 | 0.00e+00 | 6.94e+06 | 0.00e+00 | 2.67e+07 | 6.75e+08 | 4.10e+05 |
| U-236 | 1.14e+08 | 0.00e+00 | 7.09e+06 | 0.00e+00 | 2.73e+07 | 6.90e+08 | 3.03e+05 |
| U-237 | 4.20e+02 | 0.00e+00 | 1.12e+02 | 0.00e+00 | 1.73e+03 | 1.41e+05 | 1.03e+05 |
| U-238 | 1.09e+08 | 0.00e+00 | 6.48e+06 | 0.00e+00 | 2.50e+07 | 6.31e+08 | 2.90e+05 |
| Np-237 | 1.31e+10 | 8.48e+09 | 5.77e+08 | 0.00e+00 | 4.28e+09 | 7.19e+08 | 4.18e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

...
**INHALATION PATHWAY DOSES DUE TO
 RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
 Waterford Steam Electric Station
 Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 3.38e+03 | 8.16e+02 | 5.27e+01 | 0.00e+00 | 3.10e+02 | 1.40e+05 | 1.90e+05 |
| Np-239 | 3.38e+02 | 2.88e+02 | 1.77e+01 | 0.00e+00 | 1.00e+02 | 6.49e+04 | 1.32e+05 |
| Pu-238 | 1.20e+10 | 8.24e+09 | 5.78e+08 | 0.00e+00 | 2.48e+09 | 2.50e+09 | 3.83e+05 |
| Pu-239 | 1.38e+10 | 8.96e+09 | 6.44e+08 | 0.00e+00 | 2.75e+09 | 2.34e+09 | 3.50e+05 |
| Pu-240 | 1.38e+10 | 8.96e+09 | 6.43e+08 | 0.00e+00 | 2.74e+09 | 2.34e+09 | 3.57e+05 |
| Pu-241 | 2.99e+08 | 7.65e+07 | 1.12e+07 | 0.00e+00 | 5.18e+07 | 2.08e+06 | 7.34e+03 |
| Pu-242 | 1.28e+10 | 8.64e+09 | 6.20e+08 | 0.00e+00 | 2.65e+09 | 2.26e+09 | 3.43e+05 |
| Pu-244 | 1.50e+10 | 9.92e+09 | 7.10e+08 | 0.00e+00 | 3.03e+09 | 2.58e+09 | 5.11e+05 |
| Am-241 | 1.42e+10 | 9.60e+09 | 5.68e+08 | 0.00e+00 | 4.26e+09 | 8.40e+08 | 3.90e+05 |
| Am-242m | 1.43e+10 | 9.04e+09 | 5.72e+08 | 0.00e+00 | 4.24e+09 | 3.37e+08 | 4.91e+05 |
| Am-243 | 1.42e+10 | 9.36e+09 | 5.56e+08 | 0.00e+00 | 4.17e+09 | 7.93e+08 | 4.58e+05 |
| Cm-242 | 2.54e+08 | 2.01e+08 | 1.13e+07 | 0.00e+00 | 5.12e+07 | 5.41e+08 | 4.17e+05 |
| Cm-243 | 9.52e+09 | 6.64e+09 | 4.00e+08 | 0.00e+00 | 1.87e+09 | 8.72e+08 | 4.10e+05 |
| Cm-244 | 7.35e+09 | 5.22e+09 | 3.10e+08 | 0.00e+00 | 1.45e+09 | 8.40e+08 | 3.97e+05 |
| Cm-245 | 1.46e+10 | 9.76e+09 | 6.02e+08 | 0.00e+00 | 2.82e+09 | 8.08e+08 | 3.70e+05 |
| Cm-246 | 1.45e+10 | 9.76e+09 | 6.02e+08 | 0.00e+00 | 2.81e+09 | 8.24e+08 | 3.63e+05 |
| Cm-247 | 1.42e+10 | 9.52e+09 | 5.93e+08 | 0.00e+00 | 2.77e+09 | 8.08e+08 | 4.78e+05 |
| Cm-248 | 1.18e+11 | 7.86e+10 | 4.89e+09 | 0.00e+00 | 2.28e+10 | 6.66e+09 | 7.70e+06 |
| Cf-252 | 5.73e+09 | 0.00e+00 | 2.46e+08 | 0.00e+00 | 0.00e+00 | 2.74e+09 | 1.51e+06 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

Ri factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 6.40e+02 | 6.40e+02 | 6.40e+02 | 6.40e+02 | 6.40e+02 | 6.40e+02 |
| Be-10 | 3.12e+06 | 3.64e+05 | 7.84e+04 | 0.00e+00 | 0.00e+00 | 2.74e+06 | 6.36e+04 |
| C-14 | 3.59e+04 | 6.73e+03 | 6.73e+03 | 6.73e+03 | 6.73e+03 | 6.73e+03 | 6.73e+03 |
| N-13 | 8.62e+01 | 8.62e+01 | 8.62e+01 | 8.62e+01 | 8.62e+01 | 8.62e+01 | 8.62e+01 |
| F-18 | 6.96e+03 | 0.00e+00 | 6.84e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.25e+03 |
| Na-22 | 1.63e+05 | 1.63e+05 | 1.63e+05 | 1.63e+05 | 1.63e+05 | 1.63e+05 | 1.63e+05 |
| Na-24 | 1.61e+04 | 1.61e+04 | 1.61e+04 | 1.61e+04 | 1.61e+04 | 1.61e+04 | 1.61e+04 |
| P-32 | 2.60e+06 | 1.14e+05 | 9.88e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.22e+04 |
| Ca-41 | 2.61e+05 | 0.00e+00 | 2.85e+04 | 0.00e+00 | 0.00e+00 | 2.67e+08 | 1.09e+03 |
| Sc-46 | 7.29e+05 | 9.99e+05 | 3.85e+05 | 0.00e+00 | 8.84e+05 | 0.00e+00 | 9.06e+04 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.54e+02 | 8.55e+01 | 2.43e+01 | 1.70e+04 | 1.08e+03 |
| Mn-54 | 0.00e+00 | 4.29e+04 | 9.51e+03 | 0.00e+00 | 1.00e+04 | 1.58e+06 | 2.29e+04 |
| Mn-56 | 0.00e+00 | 1.66e+00 | 3.12e-01 | 0.00e+00 | 1.67e+00 | 1.31e+04 | 1.23e+05 |
| Fe-55 | 4.74e+04 | 2.52e+04 | 7.77e+03 | 0.00e+00 | 0.00e+00 | 1.11e+05 | 2.87e+03 |
| Fe-59 | 2.07e+04 | 3.34e+04 | 1.67e+04 | 0.00e+00 | 0.00e+00 | 1.27e+06 | 7.07e+04 |
| Co-57 | 0.00e+00 | 9.03e+02 | 1.07e+03 | 0.00e+00 | 0.00e+00 | 5.07e+05 | 1.32e+04 |
| Co-58 | 0.00e+00 | 1.77e+03 | 3.16e+03 | 0.00e+00 | 0.00e+00 | 1.11e+06 | 3.44e+04 |
| Co-60 | 0.00e+00 | 1.31e+04 | 2.26e+04 | 0.00e+00 | 0.00e+00 | 7.07e+06 | 9.62e+04 |
| Ni-59 | 6.14e+04 | 1.73e+04 | 1.05e+04 | 0.00e+00 | 0.00e+00 | 1.01e+05 | 2.33e+03 |
| Ni-63 | 8.21e+05 | 4.62e+04 | 2.80e+04 | 0.00e+00 | 0.00e+00 | 2.75e+05 | 6.33e+03 |
| Ni-65 | 2.99e+00 | 2.96e-01 | 1.64e-01 | 0.00e+00 | 0.00e+00 | 8.18e+03 | 8.40e+04 |
| Cu-64 | 0.00e+00 | 1.99e+00 | 1.07e+00 | 0.00e+00 | 6.03e+00 | 9.58e+03 | 3.67e+04 |
| Zn-65 | 4.26e+04 | 1.13e+05 | 7.03e+04 | 0.00e+00 | 7.14e+04 | 9.95e+05 | 1.63e+04 |
| Zn-69 | 6.70e-02 | 9.66e-02 | 8.92e-03 | 0.00e+00 | 5.85e-02 | 1.42e+03 | 1.02e+04 |
| Zn-69m | 1.58e+01 | 2.69e+01 | 3.18e+00 | 0.00e+00 | 1.56e+01 | 2.72e+04 | 1.00e+05 |
| Se-79 | 0.00e+00 | 4.55e+03 | 9.62e+02 | 0.00e+00 | 6.33e+03 | 5.51e+05 | 1.27e+04 |
| Br-82 | 0.00e+00 | 0.00e+00 | 2.09e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 4.74e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 5.48e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 2.53e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.98e+05 | 1.14e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.99e+03 |
| Rb-87 | 0.00e+00 | 1.17e+05 | 5.07e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.10e+03 |
| Rb-88 | 0.00e+00 | 5.62e+02 | 3.66e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.72e+01 |
| Rb-89 | 0.00e+00 | 3.45e+02 | 2.90e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.89e+00 |
| Sr-89 | 5.99e+05 | 0.00e+00 | 1.72e+04 | 0.00e+00 | 0.00e+00 | 2.16e+06 | 1.67e+05 |
| Sr-90 | 3.85e+07 | 0.00e+00 | 7.66e+05 | 0.00e+00 | 0.00e+00 | 1.48e+07 | 3.43e+05 |
| Sr-91 | 1.21e+02 | 0.00e+00 | 4.59e+00 | 0.00e+00 | 0.00e+00 | 5.33e+04 | 1.74e+05 |
| Sr-92 | 1.31e+01 | 0.00e+00 | 5.25e-01 | 0.00e+00 | 0.00e+00 | 2.40e+04 | 2.42e+05 |
| Y-90 | 4.11e+03 | 0.00e+00 | 1.11e+02 | 0.00e+00 | 0.00e+00 | 2.62e+05 | 2.68e+05 |
| Y-91 | 9.14e+05 | 0.00e+00 | 2.44e+04 | 0.00e+00 | 0.00e+00 | 2.63e+06 | 1.84e+05 |
| Y-91m | 5.07e-01 | 0.00e+00 | 1.84e-02 | 0.00e+00 | 0.00e+00 | 2.81e+03 | 1.72e+03 |
| Y-92 | 2.03e+01 | 0.00e+00 | 5.81e-01 | 0.00e+00 | 0.00e+00 | 2.39e+04 | 2.39e+05 |
| Y-93 | 1.86e+02 | 0.00e+00 | 5.11e+00 | 0.00e+00 | 0.00e+00 | 7.44e+04 | 3.88e+05 |
| Zr-93 | 7.66e+05 | 2.89e+04 | 2.05e+04 | 0.00e+00 | 1.11e+05 | 2.63e+05 | 5.44e+03 |
| Zr-95 | 1.90e+05 | 4.18e+04 | 3.70e+04 | 0.00e+00 | 5.96e+04 | 2.23e+06 | 6.11e+04 |
| Zr-97 | 1.88e+02 | 2.72e+01 | 1.60e+01 | 0.00e+00 | 3.88e+01 | 1.13e+05 | 3.51e+05 |
| Nb-93m | 4.70e+05 | 1.17e+05 | 3.85e+04 | 0.00e+00 | 1.27e+05 | 3.85e+05 | 9.06e+03 |
| Nb-95 | 2.35e+04 | 9.18e+03 | 6.55e+03 | 0.00e+00 | 8.62e+03 | 6.14e+05 | 3.70e+04 |
| Nb-97 | 4.29e-01 | 7.70e-02 | 3.60e-02 | 0.00e+00 | 8.55e-02 | 3.42e+03 | 2.78e+04 |
| Mo-93 | 0.00e+00 | 1.39e+04 | 5.00e+02 | 0.00e+00 | 3.92e+03 | 6.29e+05 | 1.40e+04 |
| Mo-99 | 0.00e+00 | 1.72e+02 | 4.26e+01 | 0.00e+00 | 3.92e+02 | 1.35e+05 | 1.27e+05 |
| Tc-101 | 8.10e-05 | 8.51e-05 | 1.08e-03 | 0.00e+00 | 1.45e-03 | 5.85e+02 | 1.63e+01 |
| Tc-99 | 4.96e+02 | 5.51e+02 | 1.98e+02 | 0.00e+00 | 6.48e+03 | 1.25e+06 | 2.87e+04 |
| Tc-99m | 1.78e-03 | 3.48e-03 | 5.77e-02 | 0.00e+00 | 5.07e-02 | 9.51e+02 | 4.81e+03 |
| Ru-103 | 2.79e+03 | 0.00e+00 | 1.07e+03 | 0.00e+00 | 7.03e+03 | 6.62e+05 | 4.48e+04 |
| Ru-105 | 1.53e+00 | 0.00e+00 | 5.55e-01 | 0.00e+00 | 1.34e+00 | 1.59e+04 | 9.95e+04 |
| Ru-106 | 1.36e+05 | 0.00e+00 | 1.69e+04 | 0.00e+00 | 1.84e+05 | 1.43e+07 | 4.29e+05 |
| Rh-105 | 1.45e+01 | 7.77e+00 | 6.62e+00 | 0.00e+00 | 3.10e+01 | 2.89e+04 | 4.92e+04 |
| Pd-107 | 0.00e+00 | 9.80e+02 | 9.29e+01 | 0.00e+00 | 7.29e+03 | 1.17e+05 | 2.69e+03 |
| Pd-109 | 0.00e+00 | 5.48e+00 | 1.83e+00 | 0.00e+00 | 2.61e+01 | 2.28e+04 | 9.58e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Child age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 1.69e+04 | 1.14e+04 | 9.14e+03 | 0.00e+00 | 2.12e+04 | 5.48e+06 | 1.00e+05 |
| Ag-111 | 6.70e+02 | 2.10e+02 | 1.39e+02 | 0.00e+00 | 6.33e+02 | 2.86e+05 | 1.10e+05 |
| Cd-113m | 0.00e+00 | 1.82e+06 | 7.84e+04 | 0.00e+00 | 1.90e+06 | 2.57e+06 | 6.03e+04 |
| Cd-115m | 0.00e+00 | 2.92e+05 | 1.25e+04 | 0.00e+00 | 2.19e+05 | 2.17e+06 | 1.84e+05 |
| Sn-123 | 4.77e+05 | 7.92e+03 | 1.55e+04 | 8.40e+03 | 0.00e+00 | 3.55e+06 | 1.50e+05 |
| Sn-125 | 1.83e+04 | 3.68e+02 | 1.09e+03 | 3.81e+02 | 0.00e+00 | 8.99e+05 | 2.65e+05 |
| Sr-126 | 2.31e+06 | 3.85e+04 | 8.73e+04 | 1.05e+04 | 0.00e+00 | 1.12e+07 | 6.03e+04 |
| Sk-124 | 5.74e+04 | 7.40e+02 | 2.00e+04 | 1.26e+02 | 0.00e+00 | 3.24e+06 | 1.64e+05 |
| Sk-125 | 9.84e+04 | 7.58e+02 | 2.07e+04 | 9.10e+01 | 0.00e+00 | 2.32e+06 | 4.03e+04 |
| Sk-126 | 6.36e+03 | 9.69e+01 | 2.28e+03 | 3.70e+01 | 0.00e+00 | 1.06e+06 | 2.10e+05 |
| Sb-127 | 5.03e+02 | 7.73e+00 | 1.74e+02 | 5.59e+00 | 0.00e+00 | 2.28e+05 | 1.41e+05 |
| Te-125m | 6.73e+03 | 2.33e+03 | 9.14e+02 | 1.92e+03 | 0.00e+00 | 4.77e+05 | 3.38e+04 |
| Te-127 | 2.77e+00 | 9.51e-01 | 6.10e-01 | 1.96e+00 | 7.07e+00 | 1.00e+04 | 5.62e+04 |
| Te-127m | 2.49e+04 | 8.55e+03 | 3.02e+03 | 6.07e+03 | 6.36e+04 | 1.48e+06 | 7.14e+04 |
| Te-129 | 9.77e-02 | 3.50e-02 | 2.38e-02 | 7.14e-02 | 2.57e-01 | 2.93e+03 | 2.55e+04 |
| Te-129m | 1.92e+04 | 6.84e+03 | 3.04e+03 | 6.33e+03 | 5.03e+04 | 1.76e+06 | 1.82e+05 |
| Te-131 | 2.17e-02 | 8.44e-03 | 6.59e-03 | 1.70e-02 | 5.88e-02 | 2.05e+03 | 1.33e+03 |
| Te-131m | 1.34e+02 | 5.92e+01 | 5.07e+01 | 9.77e+01 | 4.00e+02 | 2.06e+05 | 3.08e+05 |
| Te-132 | 4.81e+02 | 2.72e+02 | 2.63e+02 | 3.17e+02 | 1.77e+03 | 3.77e+05 | 1.38e+05 |
| Te-133m | 1.08e-01 | 5.59e-02 | 5.55e-02 | 8.58e-02 | 3.74e-01 | 5.92e+03 | 1.76e+04 |
| Te-134 | 5.66e-02 | 3.26e-02 | 3.48e-02 | 4.59e-02 | 2.11e-01 | 4.55e+03 | 1.80e+03 |
| I-129 | 3.88e+04 | 2.37e+04 | 2.11e+04 | 1.58e+07 | 4.00e+04 | 0.00e+00 | 7.96e+02 |
| I-130 | 8.18e+03 | 1.64e+04 | 8.44e+03 | 1.85e+06 | 2.45e+04 | 0.00e+00 | 5.11e+03 |
| I-131 | 4.81e+04 | 4.81e+04 | 2.73e+04 | 1.62e+07 | 7.88e+04 | 0.00e+00 | 2.84e+03 |
| I-132 | 2.12e+03 | 4.07e+03 | 1.88e+03 | 1.94e+05 | 6.25e+03 | 0.00e+00 | 3.20e+03 |
| I-133 | 1.66e+04 | 2.03e+04 | 7.70e+03 | 3.85e+06 | 3.38e+04 | 0.00e+00 | 5.48e+03 |
| I-134 | 1.17e+03 | 2.16e+03 | 9.95e+02 | 5.07e+04 | 3.30e+03 | 0.00e+00 | 9.55e+02 |
| I-135 | 4.92e+03 | 8.73e+03 | 4.14e+03 | 7.92e+05 | 1.34e+04 | 0.00e+00 | 4.44e+03 |
| Cs-134 | 6.51e+05 | 1.01e+06 | 2.25e+05 | 0.00e+00 | 3.30e+05 | 1.21e+05 | 3.85e+03 |
| Cs-134m | 2.34e+02 | 3.30e+02 | 2.26e+02 | 0.00e+00 | 1.83e+02 | 3.09e+01 | 2.93e+02 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 2.31e+05 | 1.53e+05 | 1.65e+04 | 0.00e+00 | 5.66e+04 | 1.93e+04 | 8.03e+02 |
| Cs-136 | 6.51e+04 | 1.71e+05 | 1.16e+05 | 0.00e+00 | 9.55e+04 | 1.45e+04 | 4.18e+03 |
| Cs-137 | 9.06e+05 | 8.25e+05 | 1.28e+05 | 0.00e+00 | 2.82e+05 | 1.04e+05 | 3.62e+03 |
| Cs-138 | 6.33e+02 | 8.40e+02 | 5.55e+02 | 0.00e+00 | 6.22e+02 | 6.81e+01 | 2.70e+02 |
| Cs-139 | 4.03e+02 | 4.26e+02 | 2.15e+02 | 0.00e+00 | 3.36e+02 | 3.46e+01 | 2.68e-02 |
| Ba-139 | 1.84e+00 | 9.84e-04 | 5.36e-02 | 0.00e+00 | 8.62e-04 | 5.77e+03 | 5.77e+04 |
| Ba-140 | 7.40e+04 | 6.48e+01 | 4.33e+03 | 0.00e+00 | 2.11e+01 | 1.74e+06 | 1.02e+05 |
| Ba-141 | 1.96e-01 | 1.09e-04 | 6.36e-03 | 0.00e+00 | 9.47e-05 | 2.92e+03 | 2.75e+02 |
| Ba-142 | 5.00e-02 | 3.60e-05 | 2.79e-03 | 0.00e+00 | 2.91e-05 | 1.64e+03 | 2.74e+00 |
| La-140 | 6.44e+02 | 2.25e+02 | 7.55e+01 | 0.00e+00 | 0.00e+00 | 1.83e+05 | 2.26e+05 |
| La-141 | 8.44e+00 | 1.96e+00 | 4.26e-01 | 0.00e+00 | 0.00e+00 | 1.66e+04 | 1.62e+05 |
| La-142 | 1.30e+00 | 4.11e-01 | 1.29e-01 | 0.00e+00 | 0.00e+00 | 8.70e+03 | 7.58e+04 |
| Ce-141 | 3.92e+04 | 1.95e+04 | 2.90e+03 | 0.00e+00 | 8.55e+03 | 5.44e+05 | 5.66e+04 |
| Ce-143 | 3.66e+02 | 1.99e+02 | 2.87e+01 | 0.00e+00 | 8.36e+01 | 1.15e+05 | 1.27e+05 |
| Ce-144 | 6.77e+06 | 2.12e+06 | 3.61e+05 | 0.00e+00 | 1.17e+06 | 1.20e+07 | 3.88e+05 |
| Pr-143 | 1.85e+04 | 5.55e+03 | 9.14e+02 | 0.00e+00 | 3.00e+03 | 4.33e+05 | 9.73e+04 |
| Pr-144 | 5.96e-02 | 1.85e-02 | 3.00e-03 | 0.00e+00 | 9.77e-03 | 1.57e+03 | 1.97e+02 |
| Nd-147 | 1.08e+04 | 8.73e+03 | 6.81e+02 | 0.00e+00 | 4.81e+03 | 3.28e+05 | 8.21e+04 |
| Pm-147 | 1.30e+06 | 9.32e+04 | 5.03e+04 | 0.00e+00 | 1.65e+05 | 8.14e+05 | 2.11e+04 |
| Pm-148 | 5.96e+03 | 7.18e+02 | 4.62e+02 | 0.00e+00 | 1.22e+03 | 4.59e+05 | 2.22e+05 |
| Pm-148m | 1.22e+05 | 2.42e+04 | 2.42e+04 | 0.00e+00 | 3.60e+04 | 2.12e+06 | 1.32e+05 |
| Pm-149 | 5.44e+02 | 5.77e+01 | 3.13e+01 | 0.00e+00 | 1.02e+02 | 8.88e+04 | 1.08e+05 |
| Pm-151 | 1.32e+02 | 1.60e+01 | 1.04e+01 | 0.00e+00 | 2.72e+01 | 4.59e+04 | 9.25e+04 |
| Sm-151 | 1.16e+06 | 1.76e+05 | 5.51e+04 | 0.00e+00 | 1.81e+05 | 5.48e+05 | 1.27e+04 |
| Sm-153 | 2.68e+02 | 1.67e+02 | 1.61e+01 | 0.00e+00 | 5.07e+01 | 5.07e+04 | 6.92e+04 |
| Eu-152 | 2.75e+06 | 5.07e+05 | 5.96e+05 | 0.00e+00 | 2.12e+06 | 3.33e+06 | 4.22e+04 |
| Eu-154 | 1.01e+07 | 9.21e+05 | 8.40e+05 | 0.00e+00 | 4.03e+06 | 6.14e+06 | 1.10e+05 |
| Eu-155 | 2.07e+06 | 1.50e+05 | 1.18e+05 | 0.00e+00 | 5.59e+05 | 1.03e+06 | 1.99e+05 |
| Eu-156 | 2.92e+04 | 1.57e+04 | 3.24e+03 | 0.00e+00 | 1.01e+04 | 9.40e+05 | 1.57e+05 |
| Tb-160 | 2.88e+05 | 0.00e+00 | 3.58e+04 | 0.00e+00 | 8.58e+04 | 1.98e+06 | 8.44e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

Ri factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Hc-166m | 4.96e+06 | 1.04e+06 | 8.77e+05 | 0.00e+00 | 1.48e+06 | 4.18e+06 | 6.03e+04 |
| W-181 | 9.84e+01 | 2.41e+01 | 3.33e+00 | 0.00e+00 | 0.00e+00 | 2.11e+04 | 9.66e+02 |
| W-185 | 3.07e+03 | 7.70e+02 | 1.08e+02 | 0.00e+00 | 0.00e+00 | 6.88e+05 | 4.11e+04 |
| W-187 | 1.63e+01 | 9.66e+00 | 4.33e+00 | 0.00e+00 | 0.00e+00 | 4.11e+04 | 9.10e+04 |
| Pb-210 | 2.97e+08 | 6.84e+07 | 1.18e+07 | 0.00e+00 | 2.33e+08 | 3.23e+08 | 5.74e+03 |
| Bi-210 | 3.64e+03 | 1.89e+04 | 2.09e+03 | 0.00e+00 | 2.13e+05 | 1.37e+07 | 1.19e+05 |
| Po-210 | 6.29e+06 | 1.02e+07 | 1.51e+06 | 0.00e+00 | 3.27e+07 | 3.88e+08 | 1.60e+05 |
| Ra-223 | 2.85e+06 | 3.29e+03 | 5.70e+05 | 0.00e+00 | 8.73e+04 | 3.14e+08 | 1.11e+06 |
| Ra-224 | 3.12e+05 | 5.66e+02 | 6.25e+04 | 0.00e+00 | 1.50e+04 | 1.08e+08 | 1.24e+06 |
| Ra-225 | 4.74e+06 | 4.22e+03 | 9.47e+05 | 0.00e+00 | 1.12e+05 | 3.60e+08 | 1.05e+06 |
| Ra-226 | 8.66e+08 | 2.83e+04 | 7.10e+08 | 0.00e+00 | 7.51e+05 | 1.44e+09 | 1.12e+06 |
| Ra-228 | 5.51e+08 | 1.46e+04 | 6.22e+08 | 0.00e+00 | 3.85e+05 | 1.99e+09 | 1.90e+05 |
| Ac-225 | 6.70e+06 | 6.92e+06 | 4.48e+05 | 0.00e+00 | 7.36e+05 | 2.73e+08 | 9.88e+05 |
| Ac-227 | 1.84e+10 | 2.98e+09 | 1.14e+09 | 0.00e+00 | 6.55e+08 | 2.97e+09 | 1.93e+05 |
| Ta-227 | 3.42e+06 | 4.66e+04 | 9.88e+04 | 0.00e+00 | 2.47e+05 | 4.66e+08 | 1.29e+06 |
| Th-228 | 2.98e+09 | 3.85e+07 | 1.01e+08 | 0.00e+00 | 2.00e+08 | 1.24e+10 | 1.33e+06 |
| Th-229 | 8.07e+10 | 2.12e+09 | 1.34e+09 | 0.00e+00 | 1.05e+10 | 4.00e+10 | 1.85e+05 |
| Th-230 | 1.22e+10 | 6.40e+08 | 3.40e+08 | 0.00e+00 | 3.15e+09 | 6.84e+09 | 1.42e+05 |
| Th-232 | 1.36e+10 | 5.44e+08 | 4.74e+06 | 0.00e+00 | 2.69e+09 | 6.55e+09 | 1.21e+05 |
| Th-234 | 2.57e+04 | 1.14e+03 | 7.40e+02 | 0.00e+00 | 5.99e+03 | 2.33e+06 | 2.71e+05 |
| Pa-231 | 3.19e+10 | 1.06e+09 | 1.27e+09 | 0.00e+00 | 5.77e+09 | 7.10e+08 | 1.69e+05 |
| Pa-233 | 1.53e+04 | 2.40e+03 | 2.68e+03 | 0.00e+00 | 8.81e+03 | 3.61e+05 | 3.31e+04 |
| U-232 | 8.10e+08 | 0.00e+00 | 5.77e+07 | 0.00e+00 | 6.18e+07 | 2.75e+09 | 1.60e+05 |
| U-233 | 1.72e+08 | 0.00e+00 | 1.04e+07 | 0.00e+00 | 2.82e+07 | 6.55e+08 | 1.48e+05 |
| U-234 | 1.65e+08 | 0.00e+00 | 1.02e+07 | 0.00e+00 | 2.76e+07 | 6.44e+08 | 1.45e+05 |
| U-235 | 1.58e+08 | 0.00e+00 | 9.58e+06 | 0.00e+00 | 2.59e+07 | 6.03e+08 | 1.84e+05 |
| U-236 | 1.58e+08 | 0.00e+00 | 9.80e+06 | 0.00e+00 | 2.65e+07 | 6.18e+08 | 1.36e+05 |
| U-237 | 5.81e+02 | 0.00e+00 | 1.54e+02 | 0.00e+00 | 1.68e+03 | 1.26e+05 | 4.77e+04 |
| U-238 | 1.51e+08 | 0.00e+00 | 8.95e+06 | 0.00e+00 | 2.42e+07 | 5.66e+08 | 1.30e+05 |
| Np-237 | 1.01e+10 | 5.99e+09 | 4.40e+08 | 0.00e+00 | 2.74e+09 | 6.44e+08 | 1.87e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 4.66e+03 | 8.51e+02 | 7.29e+01 | 0.00e+00 | 3.02e+02 | 1.25e+05 | 9.25e+04 |
| Np-239 | 4.66e+02 | 3.01e+02 | 2.35e+01 | 0.00e+00 | 9.73e+01 | 5.81e+04 | 6.40e+04 |
| Pu-238 | 9.44e+09 | 5.92e+09 | 4.48e+08 | 0.00e+00 | 1.65e+09 | 2.25e+09 | 1.72e+05 |
| Pu-239 | 1.03e+10 | 6.22e+09 | 4.74e+08 | 0.00e+00 | 1.77e+09 | 2.12e+09 | 1.57e+05 |
| Pu-240 | 1.03e+10 | 6.22e+09 | 4.70e+08 | 0.00e+00 | 1.76e+09 | 2.11e+09 | 1.60e+05 |
| Pu-241 | 2.94e+08 | 6.48e+07 | 1.08e+07 | 0.00e+00 | 4.07e+07 | 1.87e+06 | 3.29e+03 |
| Pu-242 | 9.58e+09 | 5.99e+09 | 4.55e+08 | 0.00e+00 | 1.70e+09 | 2.04e+09 | 1.54e+05 |
| Pu-244 | 1.12e+10 | 6.84e+09 | 5.22e+08 | 0.00e+00 | 1.95e+09 | 2.33e+09 | 2.29e+05 |
| Am-241 | 1.10e+10 | 6.81e+09 | 4.59e+08 | 0.00e+00 | 2.82e+09 | 7.47e+08 | 1.75e+05 |
| Am-242m | 1.14e+10 | 6.51e+09 | 4.70e+08 | 0.00e+00 | 2.85e+09 | 3.01e+08 | 2.21e+05 |
| Am-243 | 1.09e+10 | 6.59e+09 | 4.44e+08 | 0.00e+00 | 2.75e+09 | 7.10e+08 | 2.05e+05 |
| Cm-242 | 3.51e+08 | 2.10e+08 | 1.55e+07 | 0.00e+00 | 4.96e+07 | 4.85e+08 | 1.87e+05 |
| Cm-243 | 8.58e+09 | 5.25e+09 | 3.68e+08 | 0.00e+00 | 1.38e+09 | 7.77e+08 | 1.84e+05 |
| Cm-244 | 7.18e+09 | 4.37e+09 | 3.07e+08 | 0.00e+00 | 1.13e+09 | 7.47e+08 | 1.78e+05 |
| Cm-245 | 1.13e+10 | 6.81e+09 | 4.74e+08 | 0.00e+00 | 1.86e+09 | 7.22e+08 | 1.66e+05 |
| Cm-246 | 1.12e+10 | 6.81e+09 | 4.74e+08 | 0.00e+00 | 1.86e+09 | 7.36e+08 | 1.63e+05 |
| Cm-247 | 1.09e+10 | 6.73e+09 | 4.66e+08 | 0.00e+00 | 1.83e+09 | 7.22e+08 | 2.15e+05 |
| Cm-248 | 9.06e+10 | 5.55e+10 | 3.85e+09 | 0.00e+00 | 1.51e+10 | 5.96e+09 | 3.46e+06 |
| Cf-252 | 8.07e+09 | 0.00e+00 | 3.45e+08 | 0.00e+00 | 0.00e+00 | 2.45e+09 | 6.81e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 3.68e+02 | 3.68e+02 | 3.68e+02 | 3.68e+02 | 3.68e+02 | 3.68e+02 |
| Be-10 | 1.33e+06 | 1.75e+05 | 3.71e+04 | 0.00e+00 | 0.00e+00 | 2.09e+06 | 2.42e+04 |
| C-14 | 2.65e+04 | 5.31e+03 | 5.31e+03 | 5.31e+03 | 5.31e+03 | 5.31e+03 | 5.31e+03 |
| N-13 | 6.15e+01 | 6.15e+01 | 6.15e+01 | 6.15e+01 | 6.15e+01 | 6.15e+01 | 6.15e+01 |
| F-18 | 5.49e+03 | 0.00e+00 | 4.66e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.54e+02 |
| Na-22 | 1.03e+05 | 1.03e+05 | 1.03e+05 | 1.03e+05 | 1.03e+05 | 1.03e+05 | 1.03e+05 |
| Na-24 | 1.06e+04 | 1.06e+04 | 1.06e+04 | 1.06e+04 | 1.06e+04 | 1.06e+04 | 1.06e+04 |
| P-32 | 2.03e+06 | 1.12e+05 | 7.74e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.61e+04 |
| Ca-41 | 1.05e+05 | 0.00e+00 | 1.14e+04 | 0.00e+00 | 0.00e+00 | 9.72e+07 | 4.14e+02 |
| Sc-46 | 5.25e+05 | 7.57e+05 | 2.37e+05 | 0.00e+00 | 4.98e+05 | 0.00e+00 | 3.07e+04 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 8.95e+01 | 5.75e+01 | 1.32e+01 | 1.28e+04 | 3.57e+02 |
| Mn-54 | 0.00e+00 | 2.53e+04 | 4.98e+03 | 0.00e+00 | 4.98e+03 | 1.00e+06 | 7.06e+03 |
| Mn-56 | 0.00e+00 | 1.54e+00 | 2.21e-01 | 0.00e+00 | 1.10e+00 | 1.25e+04 | 7.17e+04 |
| Fe-55 | 1.97e+04 | 1.17e+04 | 3.33e+03 | 0.00e+00 | 0.00e+00 | 8.69e+04 | 1.09e+03 |
| Fe-59 | 1.36e+04 | 2.35e+04 | 9.48e+03 | 0.00e+00 | 0.00e+00 | 1.01e+06 | 2.48e+04 |
| Co-57 | 0.00e+00 | 6.51e+02 | 6.41e+02 | 0.00e+00 | 0.00e+00 | 3.79e+05 | 4.86e+03 |
| Co-58 | 0.00e+00 | 1.22e+03 | 1.82e+03 | 0.00e+00 | 0.00e+00 | 7.77e+05 | 1.11e+04 |
| Co-60 | 0.00e+00 | 8.02e+03 | 1.18e+04 | 0.00e+00 | 0.00e+00 | 4.51e+06 | 3.19e+04 |
| Ni-59 | 2.53e+04 | 7.62e+03 | 4.34e+03 | 0.00e+00 | 0.00e+00 | 7.67e+04 | 8.88e+02 |
| Ni-63 | 3.39e+05 | 2.04e+04 | 1.16e+04 | 0.00e+00 | 0.00e+00 | 2.09e+05 | 2.42e+03 |
| Ni-65 | 2.39e+00 | 2.84e-01 | 1.23e-01 | 0.00e+00 | 0.00e+00 | 8.12e+03 | 5.01e+04 |
| Cu-64 | 0.00e+00 | 1.88e+00 | 7.74e-01 | 0.00e+00 | 3.98e+00 | 9.30e+03 | 1.50e+04 |
| Zn-65 | 1.93e+04 | 6.26e+04 | 3.11e+04 | 0.00e+00 | 3.25e+04 | 6.47e+05 | 5.14e+04 |
| Zn-69 | 5.39e-02 | 9.67e-02 | 7.18e-03 | 0.00e+00 | 4.02e-02 | 1.47e+03 | 1.32e+04 |
| Zn-69m | 1.26e+01 | 2.58e+01 | 2.34e+00 | 0.00e+00 | 1.04e+01 | 2.67e+04 | 4.09e+04 |
| Se-79 | 0.00e+00 | 3.15e+03 | 5.88e+02 | 0.00e+00 | 3.46e+03 | 4.19e+05 | 4.84e+03 |
| Er-82 | 0.00e+00 | 0.00e+00 | 1.33e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-83 | 0.00e+00 | 0.00e+00 | 3.81e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-84 | 0.00e+00 | 0.00e+00 | 4.00e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-85 | 0.00e+00 | 0.00e+00 | 2.04e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.90e+05 | 8.82e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.04e+03 |
| Rb-87 | 0.00e+00 | 9.95e+04 | 3.70e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.19e+02 |
| Rb-88 | 0.00e+00 | 5.57e+02 | 2.87e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.39e+02 |
| Rb-89 | 0.00e+00 | 3.21e+02 | 2.06e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.82e+01 |
| Sr-89 | 3.98e+05 | 0.00e+00 | 1.14e+04 | 0.00e+00 | 0.00e+00 | 2.03e+06 | 6.40e+04 |
| Sr-90 | 1.55e+07 | 0.00e+00 | 3.12e+05 | 0.00e+00 | 0.00e+00 | 1.12e+07 | 1.31e+05 |
| Sr-91 | 9.56e+01 | 0.00e+00 | 3.46e+00 | 0.00e+00 | 0.00e+00 | 5.26e+04 | 7.34e+04 |
| Sr-92 | 1.05e+01 | 0.00e+00 | 3.91e-01 | 0.00e+00 | 0.00e+00 | 2.38e+04 | 1.40e+05 |
| Y-90 | 3.29e+03 | 0.00e+00 | 8.82e+01 | 0.00e+00 | 0.00e+00 | 2.69e+05 | 1.04e+05 |
| Y-91 | 5.88e+05 | 0.00e+00 | 1.57e+04 | 0.00e+00 | 0.00e+00 | 2.45e+06 | 7.03e+04 |
| Y-91m | 4.07e-01 | 0.00e+00 | 1.39e-02 | 0.00e+00 | 0.00e+00 | 2.79e+03 | 2.35e+03 |
| Y-92 | 1.64e+01 | 0.00e+00 | 4.61e-01 | 0.00e+00 | 0.00e+00 | 2.45e+04 | 1.27e+05 |
| Y-93 | 1.50e+02 | 0.00e+00 | 4.07e+00 | 0.00e+00 | 0.00e+00 | 7.64e+04 | 1.67e+05 |
| Zr-93 | 3.14e+05 | 1.33e+04 | 8.65e+03 | 0.00e+00 | 4.47e+04 | 1.92e+05 | 2.07e+03 |
| Zr-95 | 1.15e+05 | 2.79e+04 | 2.03e+04 | 0.00e+00 | 3.11e+04 | 1.75e+06 | 2.17e+04 |
| Zr-97 | 1.50e+02 | 2.56e+01 | 1.17e+01 | 0.00e+00 | 2.59e+01 | 1.10e+05 | 1.40e+05 |
| Nb-93m | 1.93e+05 | 5.03e+04 | 1.61e+04 | 0.00e+00 | 5.15e+04 | 2.93e+05 | 3.46e+03 |
| Nb-95 | 1.57e+04 | 6.43e+03 | 3.78e+03 | 0.00e+00 | 4.72e+03 | 4.79e+05 | 1.27e+04 |
| Nb-97 | 3.42e-01 | 7.29e-02 | 2.63e-02 | 0.00e+00 | 5.70e-02 | 3.32e+03 | 2.69e+04 |
| Mo-93 | 0.00e+00 | 9.04e+03 | 3.11e+02 | 0.00e+00 | 2.16e+03 | 4.76e+05 | 5.26e+03 |
| Mo-99 | 0.00e+00 | 1.65e+02 | 3.23e+01 | 0.00e+00 | 2.65e+02 | 1.35e+05 | 4.87e+04 |
| Tc-101 | 6.51e-05 | 8.23e-05 | 8.12e-04 | 0.00e+00 | 9.79e-04 | 5.84e+02 | 8.44e+02 |
| Tc-99 | 2.93e+02 | 3.75e+02 | 1.24e+02 | 0.00e+00 | 3.49e+03 | 9.48e+05 | 1.09e+04 |
| Tc-99m | 1.40e-03 | 2.88e-03 | 3.72e-02 | 0.00e+00 | 3.11e-02 | 8.11e+02 | 2.03e+03 |
| Ru-103 | 2.02e+03 | 0.00e+00 | 6.79e+02 | 0.00e+00 | 4.24e+03 | 5.52e+05 | 1.61e+04 |
| Ru-105 | 1.22e+00 | 0.00e+00 | 4.10e-01 | 0.00e+00 | 8.99e-01 | 1.57e+04 | 4.84e+04 |
| Ru-106 | 8.68e+04 | 0.00e+00 | 1.09e+04 | 0.00e+00 | 1.07e+05 | 1.16e+07 | 1.64e+05 |
| Rh-105 | 1.16e+01 | 7.57e+00 | 5.08e+00 | 0.00e+00 | 2.10e+01 | 2.91e+04 | 1.92e+04 |
| Pd-107 | 0.00e+00 | 6.89e+02 | 5.75e+01 | 0.00e+00 | 3.85e+03 | 8.88e+04 | 1.03e+03 |
| Pd-109 | 0.00e+00 | 5.49e+00 | 1.47e+00 | 0.00e+00 | 1.79e+01 | 2.35e+04 | 3.99e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 9.98e+03 | 7.22e+03 | 5.00e+03 | 0.00e+00 | 1.09e+04 | 3.67e+06 | 3.30e+04 |
| Ag-111 | 5.25e+02 | 2.03e+02 | 1.08e+02 | 0.00e+00 | 4.27e+02 | 2.88e+05 | 4.23e+04 |
| Cd-113m | 0.00e+00 | 9.34e+05 | 3.70e+04 | 0.00e+00 | 8.12e+05 | 1.96e+06 | 2.31e+04 |
| Cd-115m | 0.00e+00 | 2.42e+05 | 8.67e+03 | 0.00e+00 | 1.32e+05 | 2.06e+06 | 7.03e+04 |
| Sn-123 | 2.93e+05 | 5.89e+03 | 1.02e+04 | 5.98e+03 | 0.00e+00 | 3.11e+06 | 5.71e+04 |
| Sn-125 | 1.41e+04 | 3.51e+02 | 8.40e+02 | 3.46e+02 | 0.00e+00 | 9.00e+05 | 1.02e+05 |
| Sn-126 | 1.16e+06 | 2.02e+04 | 4.93e+04 | 5.38e+03 | 0.00e+00 | 6.90e+06 | 2.31e+04 |
| Sb-124 | 3.79e+04 | 5.56e+02 | 1.20e+04 | 1.01e+02 | 0.00e+00 | 2.65e+06 | 5.91e+04 |
| Sb-125 | 5.17e+04 | 4.77e+02 | 1.09e+04 | 6.23e+01 | 0.00e+00 | 1.64e+06 | 1.47e+04 |
| Sb-126 | 4.31e+03 | 8.41e+01 | 1.55e+03 | 3.29e+01 | 0.00e+00 | 9.63e+05 | 7.46e+04 |
| Sb-127 | 3.95e+02 | 7.06e+00 | 1.23e+02 | 5.04e+00 | 0.00e+00 | 2.16e+05 | 5.29e+04 |
| Te-125m | 4.76e+03 | 1.99e+03 | 6.58e+02 | 1.62e+03 | 0.00e+00 | 4.47e+05 | 1.29e+04 |
| Te-127 | 2.23e+00 | 9.53e-01 | 4.89e-01 | 1.85e+00 | 4.86e+00 | 1.03e+04 | 2.44e+04 |
| Te-127m | 1.67e+04 | 6.90e+03 | 2.07e+03 | 4.87e+03 | 3.75e+04 | 1.31e+06 | 2.73e+04 |
| Te-129 | 7.88e-02 | 3.47e-02 | 1.88e-02 | 6.75e-02 | 1.75e-01 | 3.00e+03 | 2.63e+04 |
| Te-129m | 1.41e+04 | 6.09e+03 | 2.23e+03 | 5.47e+03 | 3.18e+04 | 1.68e+06 | 6.90e+04 |
| Te-131 | 1.74e-02 | 8.22e-03 | 5.00e-03 | 1.58e-02 | 3.99e-02 | 2.06e+03 | 8.22e+03 |
| Te-131m | 1.07e+02 | 5.50e+01 | 3.63e+01 | 8.93e+01 | 2.65e+02 | 1.99e+05 | 1.19e+05 |
| Te-132 | 3.72e+02 | 2.37e+02 | 1.76e+02 | 2.79e+02 | 1.03e+03 | 3.40e+05 | 4.41e+04 |
| Te-133m | 8.58e-02 | 5.03e-02 | 3.84e-02 | 7.73e-02 | 2.41e-01 | 5.49e+03 | 2.23e+04 |
| Te-134 | 4.45e-02 | 2.86e-02 | 2.35e-02 | 4.07e-02 | 1.34e-01 | 4.10e+03 | 3.54e+03 |
| I-129 | 3.02e+04 | 2.23e+04 | 1.62e+04 | 1.46e+07 | 2.63e+04 | 0.00e+00 | 2.97e+02 |
| I-130 | 6.36e+03 | 1.39e+04 | 5.57e+03 | 1.60e+06 | 1.53e+04 | 0.00e+00 | 1.99e+03 |
| I-131 | 3.79e+04 | 4.44e+04 | 1.96e+04 | 1.48e+07 | 5.18e+04 | 0.00e+00 | 1.06e+03 |
| I-132 | 1.69e+03 | 3.54e+03 | 1.26e+03 | 1.69e+05 | 3.95e+03 | 0.00e+00 | 1.90e+03 |
| I-133 | 1.32e+04 | 1.92e+04 | 5.60e+03 | 3.56e+06 | 2.24e+04 | 0.00e+00 | 2.16e+03 |
| I-134 | 9.21e+02 | 1.88e+03 | 6.65e+02 | 4.45e+04 | 2.09e+03 | 0.00e+00 | 1.29e+03 |
| I-135 | 3.86e+03 | 7.60e+03 | 2.77e+03 | 6.96e+05 | 8.47e+03 | 0.00e+00 | 1.83e+03 |
| Cs-134 | 3.96e+05 | 7.03e+05 | 7.45e+04 | 0.00e+00 | 1.90e+05 | 7.97e+04 | 1.33e+03 |
| Cs-134m | 1.85e+02 | 2.94e+02 | 1.55e+02 | 0.00e+00 | 1.19e+02 | 2.80e+01 | 1.62e+02 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.40e+05 | 1.21e+05 | 6.62e+03 | 0.00e+00 | 3.61e+04 | 1.41e+04 | 3.05e+02 |
| Cs-136 | 4.83e+04 | 1.35e+05 | 5.29e+04 | 0.00e+00 | 5.64e+04 | 1.18e+04 | 1.43e+03 |
| Cs-137 | 5.49e+05 | 6.12e+05 | 4.55e+04 | 0.00e+00 | 1.72e+05 | 7.13e+04 | 1.33e+03 |
| Cs-138 | 5.05e+02 | 7.81e+02 | 3.98e+02 | 0.00e+00 | 4.10e+02 | 6.54e+01 | 8.76e+02 |
| Cs-139 | 3.25e+02 | 4.24e+02 | 1.71e+02 | 0.00e+00 | 2.31e+02 | 3.54e+01 | 1.86e+01 |
| Ba-139 | 1.48e+00 | 9.84e-04 | 4.30e-02 | 0.00e+00 | 5.92e-04 | 5.95e+03 | 5.10e+04 |
| Ba-140 | 5.60e+04 | 5.60e+01 | 2.90e+03 | 0.00e+00 | 1.34e+01 | 1.60e+06 | 3.84e+04 |
| Ba-141 | 1.57e-01 | 1.08e-04 | 4.97e-03 | 0.00e+00 | 6.50e-05 | 2.97e+03 | 4.75e+03 |
| Ba-142 | 3.98e-02 | 3.30e-05 | 1.96e-03 | 0.00e+00 | 1.90e-05 | 1.55e+03 | 6.93e+02 |
| La-140 | 5.05e+02 | 2.00e+02 | 5.15e+01 | 0.00e+00 | 0.00e+00 | 1.68e+05 | 8.48e+04 |
| La-141 | 6.79e+00 | 1.96e+00 | 3.43e-01 | 0.00e+00 | 0.00e+00 | 1.71e+04 | 8.34e+04 |
| La-142 | 1.03e+00 | 3.77e-01 | 9.04e-02 | 0.00e+00 | 0.00e+00 | 8.22e+03 | 5.95e+04 |
| Ce-141 | 2.77e+04 | 1.67e+04 | 1.99e+03 | 0.00e+00 | 5.25e+03 | 5.17e+05 | 2.16e+04 |
| Ce-143 | 2.93e+02 | 1.93e+02 | 2.21e+01 | 0.00e+00 | 5.64e+01 | 1.16e+05 | 4.97e+04 |
| Ce-144 | 3.19e+06 | 1.21e+06 | 1.76e+05 | 0.00e+00 | 5.38e+05 | 9.84e+06 | 1.48e+05 |
| Pr-143 | 1.40e+04 | 5.24e+03 | 6.99e+02 | 0.00e+00 | 1.97e+03 | 4.33e+05 | 3.72e+04 |
| Pr-144 | 4.79e-02 | 1.85e-02 | 2.41e-03 | 0.00e+00 | 6.72e-03 | 1.61e+03 | 4.28e+03 |
| Nd-147 | 7.94e+03 | 8.13e+03 | 5.00e+02 | 0.00e+00 | 3.15e+03 | 3.22e+05 | 3.12e+04 |
| Pm-147 | 5.47e+05 | 4.30e+04 | 2.18e+04 | 0.00e+00 | 6.90e+04 | 6.37e+05 | 8.05e+03 |
| Pm-148 | 4.68e+03 | 6.75e+02 | 3.42e+02 | 0.00e+00 | 8.06e+02 | 4.48e+05 | 8.46e+04 |
| Pm-148m | 7.00e+04 | 1.74e+04 | 1.39e+04 | 0.00e+00 | 2.03e+04 | 1.71e+06 | 4.72e+04 |
| Pm-149 | 4.34e+02 | 5.71e+01 | 2.49e+01 | 0.00e+00 | 6.94e+01 | 9.10e+04 | 4.21e+04 |
| Pm-151 | 1.05e+02 | 1.54e+01 | 7.77e+00 | 0.00e+00 | 1.82e+01 | 4.55e+04 | 3.61e+04 |
| Sm-151 | 4.73e+05 | 9.03e+04 | 2.28e+04 | 0.00e+00 | 7.34e+04 | 4.17e+05 | 4.84e+03 |
| Sm-153 | 2.14e+02 | 1.65e+02 | 1.27e+01 | 0.00e+00 | 3.46e+01 | 5.18e+04 | 2.70e+04 |
| Eu-152 | 1.10e+06 | 2.48e+05 | 2.41e+05 | 0.00e+00 | 8.32e+05 | 2.07e+06 | 1.38e+04 |
| Eu-154 | 4.14e+06 | 4.84e+05 | 3.43e+05 | 0.00e+00 | 1.60e+06 | 4.27e+06 | 3.98e+04 |
| Eu-155 | 8.36e+05 | 8.01e+04 | 4.84e+04 | 0.00e+00 | 2.21e+05 | 7.28e+05 | 7.27e+04 |
| Eu-156 | 2.18e+04 | 1.34e+04 | 2.16e+03 | 0.00e+00 | 6.27e+03 | 8.57e+05 | 5.80e+04 |
| Tb-160 | 1.57e+05 | 0.00e+00 | 1.96e+04 | 0.00e+00 | 4.48e+04 | 1.55e+06 | 3.00e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

INHALATION PATHWAY DOSES DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Hg-166m | 2.03e+06 | 4.30e+05 | 3.51e+05 | 0.00e+00 | 5.91e+05 | 2.87e+06 | 2.31e+04 |
| W-181 | 6.80e+01 | 2.04e+01 | 2.34e+00 | 0.00e+00 | 0.00e+00 | 1.86e+04 | 3.68e+02 |
| W-185 | 2.20e+03 | 6.76e+02 | 7.81e+01 | 0.00e+00 | 0.00e+00 | 6.27e+05 | 1.57e+04 |
| W-187 | 1.30e+01 | 9.02e+00 | 3.12e+00 | 0.00e+00 | 0.00e+00 | 3.96e+04 | 3.56e+04 |
| Pb-210 | 1.21e+08 | 2.83e+07 | 4.80e+06 | 0.00e+00 | 9.59e+07 | 2.46e+08 | 2.20e+03 |
| Bi-210 | 2.88e+03 | 1.86e+04 | 1.65e+03 | 0.00e+00 | 1.44e+05 | 1.39e+07 | 4.58e+04 |
| Po-210 | 4.17e+06 | 7.88e+06 | 9.97e+05 | 0.00e+00 | 1.82e+07 | 3.36e+08 | 6.10e+04 |
| Ra-223 | 2.18e+06 | 3.16e+03 | 4.37e+05 | 0.00e+00 | 5.82e+04 | 3.15e+08 | 4.26e+05 |
| Ra-224 | 2.48e+05 | 5.60e+02 | 4.96e+04 | 0.00e+00 | 1.02e+04 | 1.11e+08 | 4.79e+05 |
| Ra-225 | 3.60e+06 | 4.03e+03 | 7.18e+05 | 0.00e+00 | 7.43e+04 | 3.60e+08 | 4.02e+05 |
| Ra-226 | 3.47e+08 | 2.04e+04 | 2.87e+08 | 0.00e+00 | 4.12e+05 | 1.10e+09 | 4.27e+05 |
| Ra-228 | 2.24e+08 | 1.07e+04 | 2.52e+08 | 0.00e+00 | 2.14e+05 | 1.53e+09 | 7.27e+04 |
| Ac-225 | 5.17e+06 | 6.61e+06 | 3.47e+05 | 0.00e+00 | 4.89e+05 | 2.74e+08 | 3.79e+05 |
| Ac-227 | 7.41e+09 | 1.23e+09 | 4.59e+08 | 0.00e+00 | 2.60e+08 | 2.27e+09 | 7.38e+04 |
| Th-227 | 2.55e+06 | 4.24e+04 | 7.34e+04 | 0.00e+00 | 1.58e+05 | 4.58e+08 | 4.94e+05 |
| Th-228 | 1.18e+09 | 1.54e+07 | 4.00e+07 | 0.00e+00 | 7.85e+07 | 6.51e+09 | 5.07e+05 |
| Th-229 | 3.19e+10 | 8.32e+08 | 5.33e+08 | 0.00e+00 | 1.30e+09 | 1.78e+10 | 7.03e+04 |
| Th-230 | 4.84e+09 | 2.51e+08 | 1.35e+08 | 0.00e+00 | 1.23e+09 | 3.05e+09 | 5.42e+04 |
| Th-232 | 5.40e+09 | 2.14e+08 | 3.21e+06 | 0.00e+00 | 1.06e+09 | 2.93e+09 | 4.61e+04 |
| Th-234 | 1.86e+04 | 1.00e+03 | 5.38e+02 | 0.00e+00 | 3.78e+03 | 2.27e+06 | 1.04e+05 |
| Pa-231 | 1.27e+10 | 4.20e+08 | 5.07e+08 | 0.00e+00 | 2.27e+09 | 5.39e+08 | 6.45e+04 |
| Pa-233 | 9.58e+03 | 1.85e+03 | 1.67e+03 | 0.00e+00 | 5.15e+03 | 3.07e+05 | 1.27e+04 |
| U-232 | 3.60e+08 | 0.00e+00 | 2.98e+07 | 0.00e+00 | 3.36e+07 | 2.09e+09 | 6.10e+04 |
| U-233 | 7.62e+07 | 0.00e+00 | 5.36e+06 | 0.00e+00 | 1.53e+07 | 4.98e+08 | 5.64e+04 |
| U-234 | 7.31e+07 | 0.00e+00 | 5.25e+06 | 0.00e+00 | 1.50e+07 | 4.89e+08 | 5.53e+04 |
| U-235 | 7.01e+07 | 0.00e+00 | 4.93e+06 | 0.00e+00 | 1.41e+07 | 4.59e+08 | 7.03e+04 |
| U-236 | 7.01e+07 | 0.00e+00 | 5.04e+06 | 0.00e+00 | 1.44e+07 | 4.69e+08 | 5.15e+04 |
| U-237 | 4.55e+02 | 0.00e+00 | 1.21e+02 | 0.00e+00 | 1.13e+03 | 1.28e+05 | 1.83e+04 |
| U-238 | 6.71e+07 | 0.00e+00 | 4.61e+06 | 0.00e+00 | 1.32e+07 | 4.28e+08 | 4.96e+04 |
| Np-237 | 4.03e+09 | 2.39e+09 | 1.76e+08 | 0.00e+00 | 1.08e+09 | 4.89e+08 | 7.14e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

...
**INHALATION PATHWAY DOSES DUE TO
 RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
 Waterford Steam Electric Station
 Pathway : Gaseous Release Inhalation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 3.74e+03 | 8.47e+02 | 5.82e+01 | 0.00e+00 | 2.06e+02 | 1.29e+05 | 3.61e+04 |
| Np-239 | 3.71e+02 | 2.98e+02 | 1.88e+01 | 0.00e+00 | 6.62e+01 | 5.95e+04 | 2.49e+04 |
| Pu-238 | 3.77e+09 | 2.35e+09 | 1.78e+08 | 0.00e+00 | 6.50e+08 | 1.26e+09 | 6.57e+04 |
| Pu-239 | 4.10e+09 | 2.46e+09 | 1.88e+08 | 0.00e+00 | 6.93e+08 | 1.19e+09 | 5.99e+04 |
| Pu-240 | 4.10e+09 | 2.45e+09 | 1.88e+08 | 0.00e+00 | 6.92e+08 | 1.19e+09 | 6.10e+04 |
| Pu-241 | 1.18e+08 | 2.59e+07 | 4.35e+06 | 0.00e+00 | 1.61e+07 | 1.07e+06 | 1.26e+03 |
| Pu-242 | 3.81e+09 | 2.37e+09 | 1.81e+08 | 0.00e+00 | 6.68e+08 | 1.14e+09 | 5.88e+04 |
| Pu-244 | 4.44e+09 | 2.72e+09 | 2.07e+08 | 0.00e+00 | 7.64e+08 | 1.31e+09 | 8.76e+04 |
| Am-241 | 4.41e+09 | 2.73e+09 | 1.83e+08 | 0.00e+00 | 1.11e+09 | 5.68e+08 | 6.69e+04 |
| Am-242m | 4.55e+09 | 2.60e+09 | 1.89e+08 | 0.00e+00 | 1.12e+09 | 2.30e+08 | 8.41e+04 |
| Am-243 | 4.34e+09 | 2.63e+09 | 1.78e+08 | 0.00e+00 | 1.08e+09 | 5.39e+08 | 7.84e+04 |
| Cm-242 | 1.79e+08 | 1.21e+08 | 7.98e+06 | 0.00e+00 | 2.37e+07 | 4.16e+08 | 7.14e+04 |
| Cm-243 | 3.46e+09 | 2.13e+09 | 1.48e+08 | 0.00e+00 | 5.47e+08 | 5.94e+08 | 7.03e+04 |
| Cm-244 | 2.90e+09 | 1.78e+09 | 1.24e+08 | 0.00e+00 | 4.49e+08 | 5.71e+08 | 6.80e+04 |
| Cm-245 | 4.51e+09 | 2.74e+09 | 1.90e+08 | 0.00e+00 | 7.32e+08 | 5.49e+08 | 6.34e+04 |
| Cm-246 | 4.48e+09 | 2.74e+09 | 1.90e+08 | 0.00e+00 | 7.32e+08 | 5.59e+08 | 6.23e+04 |
| Cm-247 | 4.35e+09 | 2.70e+09 | 1.86e+08 | 0.00e+00 | 7.21e+08 | 5.49e+08 | 8.19e+04 |
| Cm-248 | 3.61e+10 | 2.23e+10 | 1.54e+09 | 0.00e+00 | 5.94e+09 | 4.52e+09 | 1.32e+06 |
| Cf-252 | 3.32e+09 | 0.00e+00 | 1.41e+08 | 0.00e+00 | 0.00e+00 | 1.92e+09 | 2.59e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**GROUND - PLANE DEPOSITION PATHWAY
DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for all age groups by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Ground Plane Exposure Pathway R_i

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| H-3 | 0.00e+00 | 0.00e+00 |
| Be-10 | 0.00e+00 | 0.00e+00 |
| C-14 | 0.00e+00 | 0.00e+00 |
| N-13 | 4.02e+04 | 4.66e+04 |
| F-18 | 3.96e+05 | 4.66e+05 |
| Na-22 | 1.14e+10 | 1.28e+10 |
| Na-24 | 1.19e+07 | 1.39e+07 |
| P-32 | 0.00e+00 | 0.00e+00 |
| Ca-41 | 9.89e+09 | 1.16e+10 |
| Sc-46 | 8.33e+08 | 9.61e+08 |
| Cr-51 | 4.66e+06 | 5.51e+06 |
| Mn-54 | 1.39e+09 | 1.63e+09 |
| Mn-56 | 9.02e+05 | 1.07e+06 |
| Fe-55 | 0.00e+00 | 0.00e+00 |
| Fe-59 | 2.73e+08 | 3.21e+08 |
| Co-57 | 1.88e+08 | 2.06e+08 |
| Co-58 | 3.79e+08 | 4.44e+08 |
| Co-60 | 2.15e+10 | 2.53e+10 |
| Ni-59 | 0.00e+00 | 0.00e+00 |
| Ni-63 | 0.00e+00 | 0.00e+00 |
| Ni-65 | 2.97e+05 | 3.45e+05 |
| Cu-64 | 6.07e+05 | 6.88e+05 |
| Zn-65 | 7.47e+08 | 8.59e+08 |
| Zn-69 | 0.00e+00 | 0.00e+00 |
| Zn-69m | 1.27e+06 | 1.49e+06 |
| Se-79 | 0.00e+00 | 0.00e+00 |
| Br-82 | 2.13e+07 | 2.47e+07 |
| Br-83 | 4.87e+03 | 7.08e+03 |
| Br-84 | 2.03e+05 | 2.36e+05 |
| Br-85 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**GROUND - PLANE DEPOSITION PATHWAY
DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for all age groups by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Ground Plane Exposure Pathway R_i

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Rb-86 | 8.99e+06 | 1.03e+07 |
| Rb-87 | 0.00e+00 | 0.00e+00 |
| Rb-88 | 3.31e+04 | 3.78e+04 |
| Rb-89 | 1.23e+05 | 1.48e+05 |
| Sr-89 | 2.16e+04 | 2.51e+04 |
| Sr-90 | 0.00e+00 | 0.00e+00 |
| Sr-91 | 2.15e+06 | 2.51e+06 |
| Sr-92 | 7.77e+05 | 8.63e+05 |
| Y-90 | 4.49e+03 | 5.31e+03 |
| Y-91 | 1.07e+06 | 1.21e+06 |
| Y-91m | 1.00e+05 | 1.16e+05 |
| Y-92 | 1.80e+05 | 2.14e+05 |
| Y-93 | 1.83e+05 | 2.51e+05 |
| Zr-93 | 0.00e+00 | 0.00e+00 |
| Zr-95 | 2.45e+08 | 2.84e+08 |
| Zr-97 | 2.96e+06 | 3.44e+06 |
| Nb-93m | 1.66e+06 | 2.03e+08 |
| Nb-95 | 1.37e+08 | 1.61e+08 |
| Nb-97 | 1.80e+05 | 2.12e+05 |
| Mo-93 | 6.63e+07 | 2.70e+09 |
| Mo-99 | 3.99e+06 | 4.63e+06 |
| Tc-101 | 2.04e+04 | 2.26e+04 |
| Tc-99 | 0.00e+00 | 0.00e+00 |
| Tc-99m | 1.84e+05 | 2.11e+05 |
| Ru-103 | 1.08e+08 | 1.26e+08 |
| Ru-105 | 6.36e+05 | 7.21e+05 |
| Ru-106 | 4.22e+08 | 5.07e+08 |
| Rh-105 | 7.42e+05 | 8.65e+05 |
| Pd-107 | 0.00e+00 | 0.00e+00 |
| Pd-109 | 1.50e+04 | 1.72e+04 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**GROUND - PLANE DEPOSITION PATHWAY
DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for all age groups by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Ground Plane Exposure Pathway R_i

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Ag-110m | 3.44e+09 | 4.01e+09 |
| Ag-111 | 1.02e+06 | 1.20e+06 |
| Cd-113m | 4.77e+06 | 5.39e+06 |
| Cd-115m | 0.00e+00 | 0.00e+00 |
| Sn-123 | 0.00e+00 | 6.37e+09 |
| Sn-125 | 4.19e+06 | 4.85e+06 |
| Sn-126 | 2.61e+10 | 2.90e+10 |
| Sb-124 | 5.98e+08 | 6.90e+08 |
| Sb-125 | 2.34e+09 | 2.64e+09 |
| Sb-126 | 8.50e+07 | 9.55e+07 |
| Sb-127 | 1.69e+07 | 1.95e+07 |
| Te-125m | 1.55e+06 | 2.13e+06 |
| Te-127 | 2.98e+03 | 3.28e+03 |
| Te-127m | 9.16e+04 | 1.08e+05 |
| Te-129 | 2.62e+04 | 3.10e+04 |
| Te-129m | 1.98e+07 | 2.31e+07 |
| Te-131 | 2.92e+04 | 3.45e+07 |
| Te-131m | 8.03e+06 | 9.46e+06 |
| Te-132 | 4.23e+06 | 4.98e+06 |
| Te-133m | 4.41e+05 | 5.00e+05 |
| Te-134 | 2.22e+04 | 2.66e+04 |
| I-129 | 1.31e+09 | 2.18e+09 |
| I-130 | 5.51e+06 | 6.69e+06 |
| I-131 | 1.72e+07 | 2.09e+07 |
| I-132 | 1.25e+06 | 1.46e+06 |
| I-133 | 2.45e+06 | 2.98e+06 |
| I-134 | 4.47e+05 | 5.30e+05 |
| I-135 | 2.53e+06 | 2.95e+06 |
| Cs-134 | 6.86e+09 | 8.00e+09 |
| Cs-134m | 5.73e+04 | 6.74e+04 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**GROUND - PLANE DEPOSITION PATHWAY
DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for all age groups by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Ground Plane Exposure Pathway R_i

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Cs-135 | 0.00e+00 | 0.00e+00 |
| Cs-136 | 1.51e+08 | 1.71e+08 |
| Cs-137 | 1.03e+10 | 1.20e+10 |
| Cs-138 | 3.59e+05 | 4.10e+05 |
| Cs-139 | 3.14e+04 | 3.59e+04 |
| Ba-139 | 1.06e+05 | 1.19e+05 |
| Ba-140 | 2.05e+07 | 2.35e+07 |
| Ba-141 | 4.17e+04 | 4.75e+04 |
| Ba-142 | 4.49e+04 | 5.11e+04 |
| La-140 | 1.92e+07 | 2.18e+07 |
| La-141 | 3.13e+04 | 3.50e+04 |
| La-142 | 7.60e+05 | 9.11e+05 |
| Ce-141 | 1.37e+07 | 1.54e+07 |
| Ce-143 | 2.31e+06 | 2.63e+06 |
| Ce-144 | 6.95e+07 | 8.04e+07 |
| Pr-143 | 0.00e+00 | 0.00e+00 |
| Pr-144 | 1.83e+03 | 2.11e+03 |
| Nd-147 | 8.39e+06 | 1.01e+07 |
| Pm-147 | 0.00e+00 | 0.00e+00 |
| Pm-148 | 1.89e+07 | 2.18e+07 |
| Pm-148m | 4.45e+08 | 2.58e+09 |
| Pm-149 | 4.22e+04 | 4.90e+04 |
| Pm-151 | 1.98e+06 | 2.07e+06 |
| Sm-151 | 1.32e+08 | 5.76e+08 |
| Sm-153 | 4.02e+05 | 4.47e+05 |
| Eu-152 | 1.46e+10 | 1.69e+10 |
| Eu-154 | 2.19e+10 | 2.53e+10 |
| Eu-155 | 1.91e+08 | 2.17e+08 |
| Eu-156 | 8.83e+07 | 1.01e+08 |
| Tb-160 | 4.74e+08 | 5.51e+08 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**GROUND - PLANE DEPOSITION PATHWAY
DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for all age groups by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Ground Plane Exposure Pathway R_i

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Ho-166m | 2.57e+10 | 2.89e+10 |
| W-181 | 1.94e+05 | 2.59e+05 |
| W-185 | 0.00e+00 | 0.00e+00 |
| W-187 | 2.35e+06 | 2.73e+06 |
| Pb-210 | 2.95e+07 | 3.86e+07 |
| Bi-210 | 0.00e+00 | 0.00e+00 |
| Po-210 | 5.70e+03 | 6.54e+03 |
| Ra-223 | 1.31e+07 | 1.57e+07 |
| Ra-224 | 2.49e+07 | 2.80e+07 |
| Ra-225 | 9.50e+05 | 1.36e+06 |
| Ra-226 | 1.85e+10 | 2.14e+10 |
| Ra-228 | 1.61e+10 | 1.88e+10 |
| Ac-225 | 1.22e+07 | 1.38e+07 |
| Ac-227 | 4.61e+09 | 5.54e+09 |
| Th-227 | 7.21e+06 | 8.91e+06 |
| Th-228 | 4.72e+09 | 5.31e+09 |
| Th-229 | 6.38e+09 | 7.83e+09 |
| Th-230 | 1.89e+10 | 2.18e+10 |
| Th-232 | 8.70e+09 | 1.16e+10 |
| Th-234 | 2.03e+06 | 2.39e+06 |
| Pa-231 | 6.38e+09 | 7.83e+09 |
| Pa-233 | 2.72e+07 | 3.14e+07 |
| U-232 | 7.00e+06 | 7.27e+07 |
| U-233 | 6.67e+09 | 8.12e+09 |
| U-234 | 1.83e+06 | 4.61e+08 |
| U-235 | 9.28e+09 | 1.16e+10 |
| U-236 | 6.09e+04 | 5.22e+07 |
| U-237 | 5.16e+06 | 6.71e+06 |
| U-238 | 3.19e+08 | 4.35e+08 |
| Np-237 | 4.06e+09 | 4.64e+09 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**GROUND - PLANE DEPOSITION PATHWAY
DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for all age groups by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Ground Plane Exposure Pathway R_i

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Np-238 | 4.54e+06 | 5.19e+06 |
| Np-239 | 1.71e+06 | 1.98e+06 |
| Pu-238 | 3.56e+06 | 4.92e+07 |
| Pu-239 | 2.29e+06 | 2.23e+07 |
| Pu-240 | 3.77e+06 | 5.22e+07 |
| Pu-241 | 9.66e+06 | 1.43e+07 |
| Pu-242 | 3.19e+06 | 4.64e+07 |
| Pu-244 | 2.60e+09 | 2.79e+09 |
| Am-241 | 1.98e+08 | 2.86e+08 |
| Am-242m | 7.29e+07 | 5.05e+08 |
| Am-243 | 3.77e+09 | 4.35e+09 |
| Cm-242 | 6.85e+05 | 2.87e+06 |
| Cm-243 | 5.59e+09 | 7.05e+09 |
| Cm-244 | 6.40e+06 | 3.97e+07 |
| Cm-245 | 2.75e+09 | 3.48e+09 |
| Cm-246 | 2.90e+06 | 4.35e+07 |
| Cm-247 | 6.38e+09 | 7.54e+09 |
| Cm-248 | 1.98e+10 | 1.52e+10 |
| Cf-252 | 4.46e+10 | 4.87e+10 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| H-3 | 0.00e+00 | 4.35e+02 | 4.35e+02 | 4.35e+02 | 4.35e+02 | 4.35e+02 | 4.35e+02 |
| Be-10 | 2.46e+06 | 3.79e+05 | 6.14e+04 | 0.00e+00 | 2.87e+05 | 0.00e+00 | 2.07e+07 |
| C-14 | 2.63e+08 | 5.27e+07 | 5.27e+07 | 5.27e+07 | 5.27e+07 | 5.27e+07 | 5.27e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 4.65e-03 | 0.00e+00 | 5.15e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.38e-04 |
| Na-22 | 5.29e+09 | 5.29e+09 | 5.29e+09 | 5.29e+09 | 5.29e+09 | 5.29e+09 | 5.29e+09 |
| Na-24 | 2.44e+06 | 2.44e+06 | 2.44e+06 | 2.44e+06 | 2.44e+06 | 2.44e+06 | 2.44e+06 |
| P-32 | 1.71e+10 | 1.06e+09 | 6.61e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.92e+09 |
| Ce-41 | 1.14e+10 | 0.00e+00 | 1.24e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.14e+07 |
| Sc-46 | 1.79e+02 | 3.48e+02 | 1.01e+02 | 0.00e+00 | 3.25e+02 | 0.00e+00 | 1.70e+06 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 2.86e+04 | 1.71e+04 | 6.30e+03 | 3.79e+04 | 7.19e+06 |
| Mn-54 | 0.00e+00 | 8.41e+06 | 1.61e+06 | 0.00e+00 | 2.50e+06 | 0.00e+00 | 2.58e+07 |
| Mn-56 | 0.00e+00 | 4.15e-03 | 7.37e-04 | 0.00e+00 | 5.27e-03 | 0.00e+00 | 1.33e-01 |
| Fe-55 | 2.51e+07 | 1.73e+07 | 4.05e+06 | 0.00e+00 | 0.00e+00 | 9.68e+06 | 9.95e+06 |
| Fe-59 | 2.97e+07 | 6.98e+07 | 2.68e+07 | 0.00e+00 | 0.00e+00 | 1.95e+07 | 2.33e+08 |
| Co-57 | 0.00e+00 | 1.28e+06 | 2.13e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.25e+07 |
| Co-58 | 0.00e+00 | 4.71e+06 | 1.06e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.55e+07 |
| Co-60 | 0.00e+00 | 1.64e+07 | 3.62e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.08e+08 |
| Ni-59 | 5.05e+08 | 1.73e+08 | 8.44e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.57e+07 |
| Ni-63 | 6.73e+09 | 4.66e+08 | 2.26e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.73e+07 |
| Ni-65 | 3.76e-01 | 4.88e-02 | 2.23e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.24e+00 |
| Cu-64 | 0.00e+00 | 2.39e+04 | 1.12e+04 | 0.00e+00 | 6.03e+04 | 0.00e+00 | 2.04e+06 |
| Zn-65 | 1.37e+09 | 4.37e+09 | 1.97e+09 | 0.00e+00 | 2.92e+09 | 0.00e+00 | 2.75e+09 |
| Zn-69 | 2.18e-12 | 4.17e-12 | 2.90e-13 | 0.00e+00 | 2.71e-12 | 0.00e+00 | 6.26e-13 |
| Zn-69m | 1.81e+05 | 4.35e+05 | 3.98e+04 | 0.00e+00 | 2.64e+05 | 0.00e+00 | 2.66e+07 |
| Se-79 | 0.00e+00 | 9.15e+08 | 1.53e+08 | 0.00e+00 | 1.58e+09 | 0.00e+00 | 1.87e+08 |
| Br-82 | 0.00e+00 | 0.00e+00 | 3.23e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.70e+07 |
| Br-83 | 0.00e+00 | 0.00e+00 | 9.87e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.42e-01 |
| Br-84 | 0.00e+00 | 0.00e+00 | 1.73e-23 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.36e-28 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.59e+09 | 1.21e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.12e+08 |
| Rb-87 | 0.00e+00 | 2.85e+09 | 9.92e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.34e+08 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 1.45e+09 | 0.00e+00 | 4.16e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.33e+08 |
| Sr-90 | 5.38e+10 | 0.00e+00 | 1.08e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.35e+09 |
| Sr-91 | 2.90e+04 | 0.00e+00 | 1.17e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.38e+05 |
| Sr-92 | 4.95e-01 | 0.00e+00 | 2.14e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.81e+00 |
| Y-90 | 7.09e+01 | 0.00e+00 | 1.90e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.52e+05 |
| Y-91 | 8.59e+03 | 0.00e+00 | 2.30e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.73e+06 |
| Y-91m | 6.27e-20 | 0.00e+00 | 2.43e-21 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.84e-19 |
| Y-92 | 5.64e-05 | 0.00e+00 | 1.65e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.88e-01 |
| Y-93 | 2.24e-01 | 0.00e+00 | 6.19e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.11e+03 |
| Zr-93 | 1.62e+03 | 9.04e+01 | 4.21e+01 | 0.00e+00 | 3.43e+02 | 0.00e+00 | 9.39e+04 |
| Zr-95 | 9.43e+02 | 3.03e+02 | 2.05e+02 | 0.00e+00 | 4.75e+02 | 0.00e+00 | 9.59e+05 |
| Zr-97 | 4.34e-01 | 8.76e-02 | 4.01e-02 | 0.00e+00 | 1.32e-01 | 0.00e+00 | 2.71e+04 |
| Nb-93m | 4.91e+05 | 1.60e+05 | 3.95e+04 | 0.00e+00 | 1.84e+05 | 0.00e+00 | 7.40e+07 |
| Nb-95 | 8.26e+04 | 4.59e+04 | 2.47e+04 | 0.00e+00 | 4.54e+04 | 0.00e+00 | 2.79e+08 |
| Nb-97 | 6.58e-12 | 1.66e-12 | 6.07e-13 | 0.00e+00 | 1.94e-12 | 0.00e+00 | 6.14e-09 |
| Mo-93 | 0.00e+00 | 4.35e+08 | 1.18e+07 | 0.00e+00 | 1.23e+08 | 0.00e+00 | 7.07e+07 |
| Mo-99 | 0.00e+00 | 2.48e+07 | 4.72e+06 | 0.00e+00 | 5.61e+07 | 0.00e+00 | 5.74e+07 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 2.42e+07 | 3.59e+07 | 9.70e+06 | 0.00e+00 | 4.52e+08 | 3.05e+06 | 1.17e+09 |
| Tc-99m | 3.34e+00 | 9.44e+00 | 1.20e+02 | 0.00e+00 | 1.43e+02 | 4.63e+00 | 5.59e+03 |
| Ru-103 | 1.02e+03 | 0.00e+00 | 4.39e+02 | 0.00e+00 | 3.89e+03 | 0.00e+00 | 1.19e+05 |
| Ru-105 | 8.64e-04 | 0.00e+00 | 3.41e-04 | 0.00e+00 | 1.12e-02 | 0.00e+00 | 5.29e-01 |
| Ru-106 | 2.04e+04 | 0.00e+00 | 2.58e+03 | 0.00e+00 | 3.94e+04 | 0.00e+00 | 1.32e+06 |
| Rh-105 | 3.46e+05 | 2.53e+05 | 1.67e+05 | 0.00e+00 | 1.08e+06 | 0.00e+00 | 4.03e+07 |
| Pd-107 | 0.00e+00 | 1.14e+07 | 7.26e+05 | 0.00e+00 | 1.02e+08 | 0.00e+00 | 7.04e+07 |
| Pd-109 | 0.00e+00 | 4.49e+04 | 1.01e+04 | 0.00e+00 | 2.56e+05 | 0.00e+00 | 4.98e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Ag-110m | 5.82e+07 | 5.39e+07 | 3.20e+07 | 0.00e+00 | 1.06e+08 | 0.00e+00 | 2.20e+10 |
| Ag-111 | 6.47e+06 | 2.71e+06 | 1.35e+06 | 0.00e+00 | 8.74e+06 | 0.00e+00 | 4.97e+09 |
| Cc-113m | 0.00e+00 | 2.94e+06 | 9.43e+04 | 0.00e+00 | 3.24e+06 | 0.00e+00 | 2.37e+07 |
| Cd-115m | 0.00e+00 | 1.26e+06 | 4.02e+04 | 0.00e+00 | 9.99e+05 | 0.00e+00 | 5.30e+07 |
| Sr-123 | 5.36e+08 | 8.88e+06 | 1.31e+07 | 7.55e+06 | 0.00e+00 | 0.00e+00 | 1.09e+09 |
| Sr-125 | 5.68e+07 | 1.14e+06 | 2.58e+06 | 9.47e+05 | 0.00e+00 | 0.00e+00 | 7.09e+08 |
| Sr-126 | 1.63e+09 | 3.23e+07 | 4.64e+07 | 9.51e+06 | 0.00e+00 | 0.00e+00 | 4.69e+08 |
| Sb-124 | 2.57e+07 | 4.86e+05 | 1.02e+07 | 6.24e+04 | 0.00e+00 | 2.00e+07 | 7.31e+08 |
| Sb-125 | 2.04e+07 | 2.28e+05 | 4.86e+06 | 2.08e+04 | 0.00e+00 | 1.58e+07 | 2.25e+08 |
| Sb-126 | 5.63e+06 | 1.15e+05 | 2.03e+06 | 3.45e+04 | 0.00e+00 | 3.45e+06 | 4.60e+08 |
| Sb-127 | 4.53e+05 | 9.93e+03 | 1.74e+05 | 5.45e+03 | 0.00e+00 | 2.69e+05 | 1.04e+08 |
| Te-125m | 1.63e+07 | 5.90e+06 | 2.18e+06 | 4.90e+06 | 6.63e+07 | 0.00e+00 | 6.50e+07 |
| Te-127 | 6.56e+02 | 2.35e+02 | 1.42e+02 | 4.86e+02 | 2.67e+03 | 0.00e+00 | 5.17e+04 |
| Te-127m | 4.58e+07 | 1.64e+07 | 5.58e+06 | 1.17e+07 | 1.86e+08 | 0.00e+00 | 1.53e+08 |
| Te-129 | 2.92e-10 | 1.10e-10 | 7.11e-11 | 2.24e-10 | 1.23e-09 | 0.00e+00 | 2.20e-10 |
| Te-129m | 6.02e+07 | 2.25e+07 | 9.53e+06 | 2.07e+07 | 2.51e+08 | 0.00e+00 | 3.03e+08 |
| Te-131 | 3.95e-33 | 1.65e-33 | 1.25e-33 | 3.25e-33 | 1.73e-32 | 0.00e+00 | 5.60e-34 |
| Te-131m | 3.62e+05 | 1.77e+05 | 1.47e+05 | 2.80e+05 | 1.79e+06 | 0.00e+00 | 1.76e+07 |
| Te-132 | 2.40e+06 | 1.55e+06 | 1.46e+06 | 1.72e+06 | 1.50e+07 | 0.00e+00 | 7.35e+07 |
| Te-133m | 2.19e-13 | 1.28e-13 | 1.24e-13 | 1.86e-13 | 1.27e-12 | 0.00e+00 | 4.40e-14 |
| Te-134 | 9.41e-19 | 6.16e-19 | 3.78e-19 | 8.22e-19 | 5.95e-18 | 0.00e+00 | 1.04e-21 |
| I-129 | 7.58e+08 | 6.51e+08 | 2.14e+09 | 1.68e+12 | 1.40e+09 | 0.00e+00 | 1.03e+08 |
| I-130 | 4.21e+05 | 1.24e+06 | 4.90e+05 | 1.05e+08 | 1.94e+06 | 0.00e+00 | 1.07e+06 |
| I-131 | 2.96e+08 | 4.24e+08 | 2.43e+08 | 1.39e+11 | 7.26e+08 | 0.00e+00 | 1.12e+08 |
| I-132 | 1.67e-01 | 4.47e-01 | 1.56e-01 | 1.56e+01 | 7.12e-01 | 0.00e+00 | 8.39e-02 |
| I-133 | 3.88e+06 | 6.74e+06 | 2.06e+06 | 9.91e+08 | 1.18e+07 | 0.00e+00 | 6.06e+06 |
| I-134 | 2.11e-12 | 5.72e-12 | 2.05e-12 | 9.92e-11 | 9.10e-12 | 0.00e+00 | 4.99e-15 |
| I-135 | 1.29e+04 | 3.38e+04 | 1.25e+04 | 2.23e+06 | 5.42e+04 | 0.00e+00 | 3.82e+04 |
| Cs-134 | 5.65e+09 | 1.34e+10 | 1.10e+10 | 0.00e+00 | 4.35e+09 | 1.44e+09 | 2.35e+08 |
| Cs-134m | 1.76e-01 | 3.70e-01 | 1.89e-01 | 0.00e+00 | 2.01e-01 | 3.16e-02 | 1.31e-01 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.81e+09 | 1.67e+09 | 7.41e+08 | 0.00e+00 | 6.32e+08 | 1.89e+08 | 3.90e+07 |
| Cs-136 | 2.63e+08 | 1.04e+09 | 7.48e+08 | 0.00e+00 | 5.78e+08 | 7.93e+07 | 1.18e+08 |
| Cs-137 | 7.38e+09 | 1.01e+10 | 6.61e+09 | 0.00e+00 | 3.43e+09 | 1.14e+09 | 1.95e+08 |
| Cs-138 | 9.72e-24 | 1.92e-23 | 9.50e-24 | 0.00e+00 | 1.41e-23 | 1.39e-24 | 8.18e-29 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 4.54e-08 | 3.24e-11 | 1.33e-09 | 0.00e+00 | 3.03e-11 | 1.84e-11 | 8.06e-08 |
| Ba-140 | 2.69e+07 | 3.38e+04 | 1.76e+06 | 0.00e+00 | 1.15e+04 | 1.93e+04 | 5.54e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 4.52e+00 | 2.28e+00 | 6.01e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.67e+05 |
| La-141 | 3.00e-05 | 9.31e-06 | 1.52e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.11e+00 |
| La-142 | 1.90e-11 | 8.66e-12 | 2.16e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.32e-08 |
| Ce-141 | 4.84e+03 | 3.28e+03 | 3.72e+02 | 0.00e+00 | 1.52e+03 | 0.00e+00 | 1.25e+07 |
| Ce-143 | 4.16e+01 | 3.08e+04 | 3.40e+00 | 0.00e+00 | 1.35e+01 | 0.00e+00 | 1.15e+06 |
| Ce-144 | 3.58e+05 | 1.50e+05 | 1.92e+04 | 0.00e+00 | 8.87e+04 | 0.00e+00 | 1.21e+08 |
| Pr-143 | 1.58e+02 | 6.33e+01 | 7.83e+00 | 0.00e+00 | 3.66e+01 | 0.00e+00 | 6.92e+05 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 9.42e+01 | 1.09e+02 | 6.51e+00 | 0.00e+00 | 6.36e+01 | 0.00e+00 | 5.22e+05 |
| Pm-147 | 2.87e+03 | 2.70e+02 | 1.09e+02 | 0.00e+00 | 5.10e+02 | 0.00e+00 | 3.40e+05 |
| Pm-148 | 5.93e+01 | 9.85e+00 | 4.96e+00 | 0.00e+00 | 1.86e+01 | 0.00e+00 | 7.74e+05 |
| Pm-148m | 8.57e+02 | 2.22e+02 | 1.70e+02 | 0.00e+00 | 3.35e+02 | 0.00e+00 | 1.88e+06 |
| Pm-149 | 4.28e+00 | 6.05e-01 | 2.47e-01 | 0.00e+00 | 1.14e+00 | 0.00e+00 | 1.13e+C5 |
| Pm-151 | 6.47e-01 | 1.09e-01 | 5.48e-02 | 0.00e+00 | 1.94e-01 | 0.00e+00 | 2.99e+C4 |
| Sm-151 | 2.67e+03 | 4.60e+02 | 1.10e+02 | 0.00e+00 | 5.14e+02 | 0.00e+00 | 2.03e+C5 |
| Sm-153 | 1.99e+00 | 1.66e+00 | 1.21e-01 | 0.00e+00 | 5.36e-01 | 0.00e+00 | 5.92e+C4 |
| Eu-152 | 7.51e+03 | 1.71e+03 | 1.50e+03 | 0.00e+00 | 1.06e+04 | 0.00e+00 | 9.86e+C5 |
| Eu-154 | 2.38e+04 | 2.92e+03 | 2.08e+03 | 0.00e+00 | 1.40e+04 | 0.00e+00 | 2.12e+06 |
| Eu-155 | 3.25e+03 | 4.61e+02 | 2.97e+02 | 0.00e+00 | 2.13e+03 | 0.00e+00 | 3.62e+05 |
| Eu-156 | 2.52e+02 | 1.95e+02 | 3.14e+01 | 0.00e+00 | 1.30e+02 | 0.00e+00 | 1.33e+06 |
| Tb-160 | 1.49e+03 | 0.00e+00 | 1.86e+02 | 0.00e+00 | 6.16e+02 | 0.00e+00 | 1.37e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 1.04e+04 | 3.26e+03 | 2.47e+03 | 0.00e+00 | 4.87e+03 | 0.00e+00 | 9.89e+05 |
| W-181 | 3.39e+04 | 1.11e+04 | 1.18e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.26e+06 |
| W-185 | 1.29e+06 | 4.32e+05 | 4.54e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.99e+07 |
| W-187 | 6.52e+03 | 5.45e+03 | 1.91e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.79e+06 |
| Pb-210 | 7.32e+10 | 2.09e+10 | 2.60e+09 | 0.00e+00 | 5.88e+10 | 0.00e+00 | 1.07e+07 |
| Bi-210 | 3.56e+05 | 2.46e+06 | 2.04e+05 | 0.00e+00 | 2.96e+07 | 0.00e+00 | 3.67e+07 |
| Pc-210 | 7.42e+08 | 1.58e+09 | 1.79e+08 | 0.00e+00 | 5.25e+09 | 0.00e+00 | 1.33e+08 |
| Ra-223 | 1.22e+11 | 1.88e+08 | 2.44e+10 | 0.00e+00 | 5.33e+09 | 0.00e+00 | 7.89e+09 |
| Ra-224 | 1.41e+10 | 3.42e+07 | 2.83e+09 | 0.00e+00 | 9.65e+08 | 0.00e+00 | 2.98e+09 |
| Ra-225 | 1.90e+11 | 2.25e+08 | 3.79e+10 | 0.00e+00 | 6.39e+09 | 0.00e+00 | 8.85e+09 |
| Ra-226 | 1.87e+13 | 3.55e+08 | 1.36e+13 | 0.00e+00 | 1.01e+10 | 0.00e+00 | 2.05e+10 |
| Ra-228 | 6.87e+12 | 1.91e+08 | 7.43e+12 | 0.00e+00 | 5.42e+09 | 0.00e+00 | 3.46e+09 |
| Ac-225 | 6.17e+04 | 8.49e+04 | 4.15e+03 | 0.00e+00 | 9.67e+03 | 0.00e+00 | 5.70e+06 |
| Ac-227 | 7.21e+07 | 9.56e+06 | 4.28e+06 | 0.00e+00 | 3.09e+06 | 0.00e+00 | 3.16e+06 |
| Th-227 | 2.80e+05 | 5.06e+03 | 8.06e+03 | 0.00e+00 | 2.88e+04 | 0.00e+00 | 1.10e+07 |
| Th-228 | 1.88e+07 | 3.18e+05 | 6.35e+05 | 0.00e+00 | 1.77e+06 | 0.00e+00 | 2.13e+07 |
| Th-229 | 5.26e+08 | 1.50e+07 | 8.69e+06 | 0.00e+00 | 7.26e+07 | 0.00e+00 | 3.02e+06 |
| Th-230 | 7.96e+07 | 4.52e+06 | 2.20e+06 | 0.00e+00 | 2.18e+07 | 0.00e+00 | 2.33e+06 |
| Th-232 | 8.89e+07 | 3.86e+06 | 5.80e+04 | 0.00e+00 | 1.86e+07 | 0.00e+00 | 1.98e+06 |
| Th-234 | 1.85e+03 | 1.09e+02 | 5.33e+01 | 0.00e+00 | 6.16e+02 | 0.00e+00 | 2.61e+06 |
| Pa-231 | 1.58e+08 | 5.95e+06 | 6.14e+06 | 0.00e+00 | 3.34e+07 | 0.00e+00 | 2.77e+06 |
| Pa-233 | 1.28e+02 | 2.58e+01 | 2.22e+01 | 0.00e+00 | 9.70e+01 | 0.00e+00 | 3.99e+05 |
| U-232 | 1.59e+10 | 0.00e+00 | 1.14e+09 | 0.00e+00 | 1.73e+09 | 0.00e+00 | 2.62e+08 |
| U-233 | 3.37e+09 | 0.00e+00 | 2.04e+08 | 0.00e+00 | 7.84e+08 | 0.00e+00 | 2.42e+08 |
| U-234 | 3.23e+09 | 0.00e+00 | 2.00e+08 | 0.00e+00 | 7.69e+08 | 0.00e+00 | 2.37e+08 |
| U-235 | 3.10e+09 | 0.00e+00 | 1.88e+08 | 0.00e+00 | 7.23e+08 | 0.00e+00 | 3.02e+08 |
| U-236 | 3.10e+09 | 0.00e+00 | 1.92e+08 | 0.00e+00 | 7.38e+08 | 0.00e+00 | 2.23e+08 |
| U-237 | 5.65e+04 | 0.00e+00 | 1.50e+04 | 0.00e+00 | 2.32e+05 | 0.00e+00 | 1.99e+07 |
| U-238 | 2.96e+09 | 0.00e+00 | 1.75e+08 | 0.00e+00 | 6.76e+08 | 0.00e+00 | 2.13e+08 |
| Np-237 | 4.87e+07 | 3.46e+06 | 2.14e+06 | 0.00e+00 | 1.59e+07 | 0.00e+00 | 3.07e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 3.62e+01 | 9.75e-01 | 5.63e-01 | 0.00e+00 | 3.30e+00 | 0.00e+00 | 9.06e+04 |
| Np-239 | 3.68e+00 | 3.61e-01 | 1.99e-01 | 0.00e+00 | 1.13e+00 | 0.00e+00 | 7.41e+04 |
| Pu-238 | 9.73e+06 | 1.23e+06 | 2.64e+05 | 0.00e+00 | 1.13e+06 | 0.00e+00 | 1.13e+06 |
| Pu-239 | 1.12e+07 | 1.35e+06 | 2.95e+05 | 0.00e+00 | 1.25e+06 | 0.00e+00 | 1.03e+06 |
| Pu-240 | 1.12e+07 | 1.34e+06 | 2.95e+05 | 0.00e+00 | 1.25e+06 | 0.00e+00 | 1.05e+06 |
| Pu-241 | 2.42e+05 | 1.15e+04 | 5.12e+03 | 0.00e+00 | 2.36e+04 | 0.00e+00 | 2.16e+04 |
| Pu-242 | 1.04e+07 | 1.30e+06 | 2.84e+05 | 0.00e+00 | 1.21e+06 | 0.00e+00 | 1.01e+06 |
| Pu-244 | 1.21e+07 | 1.49e+06 | 3.26e+05 | 0.00e+00 | 1.38e+06 | 0.00e+00 | 1.50e+06 |
| Am-241 | 2.89e+07 | 2.70e+07 | 2.07e+06 | 0.00e+00 | 1.56e+07 | 0.00e+00 | 2.84e+06 |
| Am-242m | 2.94e+07 | 2.56e+07 | 2.10e+06 | 0.00e+00 | 1.56e+07 | 0.00e+00 | 3.61e+06 |
| Am-243 | 2.91e+07 | 2.67e+07 | 2.05e+06 | 0.00e+00 | 1.54e+07 | 0.00e+00 | 3.36e+06 |
| Cm-242 | 7.27e+05 | 7.73e+05 | 4.83e+04 | 0.00e+00 | 2.19e+05 | 0.00e+00 | 2.79e+06 |
| Cm-243 | 2.31e+07 | 2.12e+07 | 1.45e+06 | 0.00e+00 | 6.75e+06 | 0.00e+00 | 3.01e+06 |
| Cm-244 | 1.76e+07 | 1.65e+07 | 1.11e+06 | 0.00e+00 | 5.17e+06 | 0.00e+00 | 2.91e+06 |
| Cm-245 | 3.62e+07 | 3.16e+07 | 2.23e+06 | 0.00e+00 | 1.04e+07 | 0.00e+00 | 2.72e+06 |
| Cm-246 | 3.59e+07 | 3.15e+07 | 2.22e+06 | 0.00e+00 | 1.04e+07 | 0.00e+00 | 2.67e+06 |
| Cm-247 | 3.50e+07 | 3.11e+07 | 2.19e+06 | 0.00e+00 | 1.02e+07 | 0.00e+00 | 3.51e+06 |
| Cm-248 | 2.91e+08 | 2.56e+08 | 1.80e+07 | 0.00e+00 | 8.42e+07 | 0.00e+00 | 5.68e+07 |
| Cf-252 | 9.92e+06 | 0.00e+00 | 2.39e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.09e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 5.66e+02 | 5.66e+02 | 5.66e+02 | 5.66e+02 | 5.66e+02 | 5.66e+02 |
| Be-10 | 4.47e+06 | 6.92e+05 | 1.13e+05 | 0.00e+00 | 5.29e+05 | 0.00e+00 | 2.83e+07 |
| C-14 | 4.86e+08 | 9.72e+07 | 9.72e+07 | 9.72e+07 | 9.72e+07 | 9.72e+07 | 9.72e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 8.30e-03 | 0.00e+00 | 9.10e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.48e-04 |
| Na-22 | 9.18e+09 | 9.18e+09 | 9.18e+09 | 9.18e+09 | 9.18e+09 | 9.18e+09 | 9.18e+09 |
| Na-24 | 4.27e+06 | 4.27e+06 | 4.27e+06 | 4.27e+06 | 4.27e+06 | 4.27e+06 | 4.27e+06 |
| P-32 | 3.15e+10 | 1.95e+09 | 1.22e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.65e+09 |
| Ce-41 | 1.57e+10 | 0.00e+00 | 1.70e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.56e+07 |
| Sc-46 | 3.04e+02 | 5.92e+02 | 1.76e+02 | 0.00e+00 | 5.67e+02 | 0.00e+00 | 2.02e+06 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 4.99e+04 | 2.77e+04 | 1.09e+04 | 7.13e+04 | 8.39e+06 |
| Mn-54 | 0.00e+00 | 1.40e+07 | 2.78e+06 | 0.00e+00 | 4.18e+06 | 0.00e+00 | 2.87e+07 |
| Mn-56 | 0.00e+00 | 7.36e-03 | 1.31e-03 | 0.00e+00 | 9.32e-03 | 0.00e+00 | 4.85e-01 |
| Fe-55 | 4.45e+07 | 3.16e+07 | 7.36e+06 | 0.00e+00 | 0.00e+00 | 2.00e+07 | 1.37e+07 |
| Fe-59 | 5.18e+07 | 1.21e+08 | 4.67e+07 | 0.00e+00 | 0.00e+00 | 3.81e+07 | 2.86e+08 |
| Co-57 | 0.00e+00 | 2.24e+06 | 3.76e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.19e+07 |
| Co-58 | 0.00e+00 | 7.94e+06 | 1.83e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.09e+08 |
| Co-60 | 0.00e+00 | 2.78e+07 | 6.26e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.62e+08 |
| Ni-59 | 8.82e+08 | 3.11e+08 | 1.50e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.88e+07 |
| Ni-63 | 1.18e+10 | 8.35e+08 | 4.01e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.33e+08 |
| Ni-65 | 6.87e-01 | 8.78e-02 | 4.00e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.76e+00 |
| Cu-64 | 0.00e+00 | 4.26e+04 | 2.00e+04 | 0.00e+00 | 1.08e+05 | 0.00e+00 | 3.30e+06 |
| Zn-65 | 2.11e+09 | 7.32e+09 | 3.41e+09 | 0.00e+00 | 4.68e+09 | 0.00e+00 | 3.10e+09 |
| Zn-69 | 4.01e-12 | 7.65e-12 | 5.35e-13 | 0.00e+00 | 5.00e-12 | 0.00e+00 | 1.41e-11 |
| Zn-69m | 3.30e+05 | 7.79e+05 | 7.15e+04 | 0.00e+00 | 4.74e+05 | 0.00e+00 | 4.28e+07 |
| Se-79 | 0.00e+00 | 1.67e+09 | 2.81e+08 | 0.00e+00 | 2.92e+09 | 0.00e+00 | 2.56e+08 |
| Br-82 | 0.00e+00 | 0.00e+00 | 5.61e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 1.82e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 3.09e-23 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 4.73e+09 | 2.22e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.00e+08 |
| Rb-87 | 0.00e+00 | 5.24e+09 | 1.83e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.83e+08 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 2.67e+09 | 0.00e+00 | 7.66e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.19e+08 |
| Sr-90 | 8.13e+10 | 0.00e+00 | 1.63e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.86e+09 |
| Sr-91 | 5.33e+04 | 0.00e+00 | 2.12e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.42e+05 |
| Sr-92 | 9.07e-01 | 0.00e+00 | 3.86e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.31e+01 |
| Y-90 | 1.30e+02 | 0.00e+00 | 3.51e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.07e+06 |
| Y-91 | 1.58e+04 | 0.00e+00 | 4.24e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.48e+06 |
| Y-91m | 1.15e-19 | 0.00e+00 | 4.39e-21 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.42e-18 |
| Y-92 | 1.04e-04 | 0.00e+00 | 3.01e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.86e+00 |
| Y-93 | 4.13e-01 | 0.00e+00 | 1.13e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.26e+04 |
| Zr-93 | 2.76e+03 | 1.36e+02 | 7.43e+01 | 0.00e+00 | 4.81e+02 | 0.00e+00 | 1.29e+05 |
| Zr-95 | 1.65e+03 | 5.20e+02 | 3.58e+02 | 0.00e+00 | 7.65e+02 | 0.00e+00 | 1.20e+06 |
| Zr-97 | 7.90e-01 | 1.56e-01 | 7.20e-02 | 0.00e+00 | 2.37e-01 | 0.00e+00 | 4.23e+04 |
| Nb-93m | 8.55e+05 | 2.81e+05 | 7.03e+04 | 0.00e+00 | 3.28e+05 | 0.00e+00 | 1.01e+08 |
| Nb-95 | 1.41e+05 | 7.81e+04 | 4.30e+04 | 0.00e+00 | 7.57e+04 | 0.00e+00 | 3.34e+08 |
| Nb-97 | 1.20e-11 | 2.98e-12 | 1.09e-12 | 0.00e+00 | 3.48e-12 | 0.00e+00 | 7.11e-08 |
| Mo-93 | 0.00e+00 | 7.93e+08 | 2.17e+07 | 0.00e+00 | 2.27e+08 | 0.00e+00 | 9.65e+07 |
| Mo-99 | 0.00e+00 | 4.47e+07 | 8.53e+06 | 0.00e+00 | 1.02e+08 | 0.00e+00 | 8.01e+07 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 4.46e+07 | 6.56e+07 | 1.79e+07 | 0.00e+00 | 8.33e+08 | 6.78e+06 | 1.61e+09 |
| Tc-99m | 5.80e+00 | 1.62e+01 | 2.10e+02 | 0.00e+00 | 2.41e+02 | 8.97e+00 | 1.06e+04 |
| Ru-103 | 1.81e+03 | 0.00e+00 | 7.74e+02 | 0.00e+00 | 6.38e+03 | 0.00e+00 | 1.51e+05 |
| Ru-105 | 1.58e-03 | 0.00e+00 | 6.13e-04 | 0.00e+00 | 1.99e-02 | 0.00e+00 | 1.27e+00 |
| Ru-106 | 3.75e+04 | 0.00e+00 | 4.73e+03 | 0.00e+00 | 7.24e+04 | 0.00e+00 | 1.80e+06 |
| Rh-105 | 6.38e+05 | 4.61e+05 | 3.03e+05 | 0.00e+00 | 1.96e+06 | 0.00e+00 | 5.87e+07 |
| Pd-107 | 0.00e+00 | 2.07e+07 | 1.34e+06 | 0.00e+00 | 1.87e+08 | 0.00e+00 | 9.63e+07 |
| Pd-109 | 0.00e+00 | 8.22e+04 | 1.87e+04 | 0.00e+00 | 4.75e+05 | 0.00e+00 | 8.29e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 9.63e+07 | 9.11e+07 | 5.54e+07 | 0.00e+00 | 1.74e+08 | 0.00e+00 | 2.56e+10 |
| Ag-111 | 1.19e+07 | 4.95e+06 | 2.49e+06 | 0.00e+00 | 1.61e+07 | 0.00e+00 | 6.90e+09 |
| Cd-113m | 0.00e+00 | 5.38e+06 | 1.73e+05 | 0.00e+00 | 5.95e+06 | 0.00e+00 | 3.23e+07 |
| Cd-115m | 0.00e+00 | 2.30e+06 | 7.41e+04 | 0.00e+00 | 1.84e+06 | 0.00e+00 | 7.27e+07 |
| Sn-123 | 9.88e+08 | 1.62e+07 | 2.40e+07 | 1.30e+07 | 0.00e+00 | 0.00e+00 | 1.49e+09 |
| Sn-125 | 1.05e+08 | 2.08e+06 | 4.72e+06 | 1.64e+06 | 0.00e+00 | 0.00e+00 | 9.85e+08 |
| Sr-126 | 2.89e+09 | 5.38e+07 | 8.23e+07 | 1.42e+07 | 0.00e+00 | 0.00e+00 | 6.43e+08 |
| Sr-124 | 4.59e+07 | 8.46e+05 | 1.79e+07 | 1.04e+05 | 0.00e+00 | 4.01e+07 | 9.25e+08 |
| Sr-125 | 3.65e+07 | 3.99e+05 | 8.55e+06 | 3.49e+04 | 0.00e+00 | 3.21e+07 | 2.84e+08 |
| Sb-126 | 1.00e+07 | 2.05e+05 | 3.61e+06 | 5.68e+04 | 0.00e+00 | 7.20e+06 | 5.94e+08 |
| Sb-127 | 8.23e+05 | 1.76e+04 | 3.11e+05 | 9.25e+03 | 0.00e+00 | 5.60e+05 | 1.40e+08 |
| Te-125m | 3.00e+07 | 1.08e+07 | 4.02e+06 | 8.39e+06 | 0.00e+00 | 0.00e+00 | 8.86e+07 |
| Te-127 | 1.22e+03 | 4.31e+02 | 2.61e+02 | 8.38e+02 | 4.92e+03 | 0.00e+00 | 9.38e+04 |
| Te-127m | 8.44e+07 | 2.99e+07 | 1.00e+07 | 2.01e+07 | 3.42e+08 | 0.00e+00 | 2.10e+08 |
| Te-129 | 5.37e-10 | 2.00e-10 | 1.31e-10 | 3.84e-10 | 2.25e-09 | 0.00e+00 | 2.94e-09 |
| Te-129m | 1.10e+08 | 4.09e+07 | 1.74e+07 | 3.55e+07 | 4.61e+08 | 0.00e+00 | 4.13e+08 |
| Te-131 | 7.22e-33 | 2.98e-33 | 2.26e-33 | 5.57e-33 | 3.16e-32 | 0.00e+00 | 5.93e-34 |
| Te-131m | 6.58e+05 | 3.15e+05 | 2.63e+05 | 4.75e+05 | 3.29e+06 | 0.00e+00 | 2.53e+07 |
| Te-132 | 4.29e+06 | 2.72e+06 | 2.56e+06 | 2.87e+06 | 2.61e+07 | 0.00e+00 | 8.61e+07 |
| Te-133m | 3.95e-13 | 2.24e-13 | 2.18e-13 | 3.13e-13 | 2.22e-12 | 0.00e+00 | 9.07e-13 |
| Te-134 | 1.68e-18 | 1.08e-18 | 1.12e-18 | 1.38e-18 | 1.03e-17 | 0.00e+00 | 6.22e-20 |
| I-129 | 1.39e+09 | 1.17e+09 | 1.96e+09 | 1.43e+12 | 2.10e+09 | 0.00e+00 | 1.37e+08 |
| I-130 | 7.41e+05 | 2.14e+06 | 8.56e+05 | 1.75e+08 | 3.30e+06 | 0.00e+00 | 1.65e+06 |
| I-131 | 5.37e+08 | 7.52e+08 | 4.04e+08 | 2.20e+11 | 1.30e+09 | 0.00e+00 | 1.49e+08 |
| I-132 | 2.96e-01 | 7.75e-01 | 2.78e-01 | 2.61e+01 | 1.22e+00 | 0.00e+00 | 3.38e-01 |
| I-133 | 7.08e+06 | 1.20e+07 | 3.66e+06 | 1.68e+09 | 2.11e+07 | 0.00e+00 | 9.09e+06 |
| I-134 | 3.74e-12 | 9.92e-12 | 3.56e-12 | 1.65e-10 | 1.56e-11 | 0.00e+00 | 1.31e-13 |
| I-135 | 2.29e+04 | 5.90e+04 | 2.19e+04 | 3.80e+06 | 9.33e+04 | 0.00e+00 | 6.54e+04 |
| Cs-134 | 9.81e+09 | 2.31e+10 | 1.07e+10 | 0.00e+00 | 7.34e+09 | 2.80e+09 | 2.87e+08 |
| Cs-134m | 3.13e-01 | 6.49e-01 | 3.34e-01 | 0.00e+00 | 3.61e-01 | 6.34e-02 | 4.32e-01 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 3.33e+09 | 3.05e+09 | 7.13e+08 | 0.00e+00 | 1.16e+09 | 4.21e+08 | 5.34e+07 |
| Cs-136 | 4.48e+08 | 1.76e+09 | 1.18e+09 | 0.00e+00 | 9.60e+08 | 1.51e+08 | 1.42e+08 |
| Cs-137 | 1.34e+10 | 1.78e+10 | 6.20e+09 | 0.00e+00 | 6.06e+09 | 2.35e+09 | 2.53e+08 |
| Cs-138 | 1.76e-23 | 3.38e-23 | 1.69e-23 | 0.00e+00 | 2.50e-23 | 2.91e-24 | 1.54e-26 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 8.40e-08 | 5.91e-11 | 2.45e-09 | 0.00e+00 | 5.57e-11 | 4.07e-11 | 7.50e-07 |
| Ba-140 | 4.85e+07 | 5.95e+04 | 3.13e+06 | 0.00e+00 | 2.02e+04 | 4.00e+04 | 7.48e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 8.11e+00 | 3.99e+00 | 1.06e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.29e+05 |
| La-141 | 5.52e-05 | 1.70e-05 | 2.80e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.01e+00 |
| La-142 | 3.43e-11 | 1.53e-11 | 3.80e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.64e-07 |
| Ce-141 | 8.88e+03 | 5.93e+03 | 6.81e+02 | 0.00e+00 | 2.79e+03 | 0.00e+00 | 1.70e+07 |
| Ce-143 | 7.65e+01 | 5.56e+04 | 6.21e+00 | 0.00e+00 | 2.50e+01 | 0.00e+00 | 1.67e+06 |
| Ce-144 | 6.58e+05 | 2.72e+05 | 3.54e+04 | 0.00e+00 | 1.63e+05 | 0.00e+00 | 1.66e+08 |
| Pr-143 | 2.90e+02 | 1.16e+02 | 1.44e+01 | 0.00e+00 | 6.73e+01 | 0.00e+00 | 9.55e+05 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 1.81e+02 | 1.97e+02 | 1.18e+01 | 0.00e+00 | 1.16e+02 | 0.00e+00 | 7.11e+05 |
| Pm-147 | 5.15e+03 | 4.89e+02 | 1.99e+02 | 0.00e+00 | 9.32e+02 | 0.00e+00 | 4.65e+05 |
| Pm-148 | 1.09e+02 | 1.77e+01 | 8.93e+00 | 0.00e+00 | 3.20e+01 | 0.00e+00 | 1.06e+06 |
| Pm-148m | 1.49e+03 | 3.78e+02 | 2.96e+02 | 0.00e+00 | 5.73e+02 | 0.00e+00 | 2.38e+06 |
| Pm-149 | 7.88e+00 | 1.11e+00 | 4.54e-01 | 0.00e+00 | 2.11e+00 | 0.00e+00 | 1.63e+05 |
| Pm-151 | 1.18e+00 | 1.95e-01 | 9.88e-02 | 0.00e+00 | 3.51e-01 | 0.00e+00 | 4.38e+04 |
| Sm-151 | 4.35e+03 | 8.37e+02 | 1.96e+02 | 0.00e+00 | 9.17e+02 | 0.00e+00 | 2.84e+05 |
| Sm-153 | 3.65e+00 | 3.02e+00 | 2.22e-01 | 0.00e+00 | 9.88e-01 | 0.00e+00 | 8.53e+04 |
| Eu-152 | 1.22e+04 | 2.93e+03 | 2.58e+03 | 0.00e+00 | 1.36e+04 | 0.00e+00 | 1.08e+06 |
| Eu-154 | 3.94e+04 | 5.08e+03 | 3.58e+03 | 0.00e+00 | 2.27e+04 | 0.00e+00 | 2.69e+06 |
| Eu-155 | 8.48e+03 | 8.18e+02 | 5.07e+02 | 0.00e+00 | 3.20e+03 | 0.00e+00 | 4.69e+06 |
| Eu-156 | 4.55e+02 | 3.41e+02 | 5.57e+01 | 0.00e+00 | 2.30e+02 | 0.00e+00 | 1.74e+06 |
| Tb-160 | 2.65e+03 | 0.00e+00 | 3.31e+02 | 0.00e+00 | 1.05e+03 | 0.00e+00 | 1.72e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Hc-166m | 1.78e+04 | 5.48e+03 | 3.97e+03 | 0.00e+00 | 8.03e+03 | 0.00e+00 | 1.35e+06 |
| W-181 | 6.27e+04 | 2.02e+04 | 2.12e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.72e+06 |
| W-185 | 2.39e+06 | 7.88e+05 | 8.33e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.81e+07 |
| W-187 | 1.19e+04 | 9.73e+03 | 3.41e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.63e+06 |
| Pb-210 | 1.12e+11 | 3.36e+10 | 4.33e+09 | 0.00e+00 | 1.06e+11 | 0.00e+00 | 1.46e+07 |
| Bi-210 | 6.57e+05 | 4.49e+06 | 3.76e+05 | 0.00e+00 | 5.46e+07 | 0.00e+00 | 5.13e+07 |
| Po-210 | 1.37e+09 | 2.88e+09 | 3.31e+08 | 0.00e+00 | 9.68e+09 | 0.00e+00 | 1.81e+08 |
| Ra-223 | 2.25e+11 | 3.42e+08 | 4.50e+10 | 0.00e+00 | 9.83e+09 | 0.00e+00 | 1.09e+10 |
| Ra-224 | 2.62e+10 | 6.25e+07 | 5.22e+09 | 0.00e+00 | 1.79e+09 | 0.00e+00 | 4.20e+09 |
| Ra-225 | 3.50e+11 | 4.11e+08 | 6.98e+10 | 0.00e+00 | 1.18e+10 | 0.00e+00 | 1.22e+10 |
| Ra-226 | 2.57e+13 | 6.49e+08 | 1.91e+13 | 0.00e+00 | 1.85e+10 | 0.00e+00 | 2.80e+10 |
| Ra-228 | 1.08e+13 | 3.49e+08 | 1.20e+13 | 0.00e+00 | 9.98e+09 | 0.00e+00 | 4.74e+09 |
| Ac-225 | 1.14e+05 | 1.55e+05 | 7.63e+03 | 0.00e+00 | 1.78e+04 | 0.00e+00 | 7.89e+06 |
| Ac-227 | 1.02e+08 | 1.51e+07 | 6.07e+06 | 0.00e+00 | 4.38e+06 | 0.00e+00 | 4.32e+06 |
| Th-227 | 5.16e+05 | 9.27e+03 | 1.49e+04 | 0.00e+00 | 5.29e+04 | 0.00e+00 | 1.51e+07 |
| Th-228 | 3.32e+07 | 5.56e+05 | 1.12e+06 | 0.00e+00 | 3.13e+06 | 0.00e+00 | 2.91e+07 |
| Th-229 | 7.13e+08 | 2.05e+07 | 1.18e+07 | 0.00e+00 | 9.92e+07 | 0.00e+00 | 4.13e+06 |
| Th-230 | 1.08e+08 | 6.13e+06 | 2.99e+06 | 0.00e+00 | 2.99e+07 | 0.00e+00 | 3.18e+06 |
| Th-232 | 1.21e+08 | 5.24e+06 | 8.13e+04 | 0.00e+00 | 2.55e+07 | 0.00e+00 | 2.71e+06 |
| Th-234 | 3.39e+03 | 1.99e+02 | 9.86e+01 | 0.00e+00 | 1.13e+03 | 0.00e+00 | 3.60e+06 |
| Pa-231 | 2.15e+08 | 8.08e+06 | 8.38e+06 | 0.00e+00 | 4.54e+07 | 0.00e+00 | 3.79e+06 |
| Pa-233 | 2.30e+02 | 4.42e+01 | 3.95e+01 | 0.00e+00 | 1.67e+02 | 0.00e+00 | 5.05e+05 |
| U-232 | 2.94e+10 | 0.00e+00 | 2.10e+09 | 0.00e+00 | 3.18e+09 | 0.00e+00 | 3.58e+08 |
| U-233 | 6.18e+09 | 0.00e+00 | 3.76e+08 | 0.00e+00 | 1.45e+09 | 0.00e+00 | 3.32e+08 |
| U-234 | 5.93e+09 | 0.00e+00 | 3.68e+08 | 0.00e+00 | 1.42e+09 | 0.00e+00 | 3.25e+08 |
| U-235 | 5.68e+09 | 0.00e+00 | 3.46e+08 | 0.00e+00 | 1.33e+09 | 0.00e+00 | 4.13e+08 |
| U-236 | 5.68e+09 | 0.00e+00 | 3.54e+08 | 0.00e+00 | 1.36e+09 | 0.00e+00 | 3.05e+08 |
| U-237 | 1.04e+05 | 0.00e+00 | 2.77e+04 | 0.00e+00 | 4.28e+05 | 0.00e+00 | 2.76e+07 |
| U-238 | 5.43e+09 | 0.00e+00 | 3.24e+08 | 0.00e+00 | 1.25e+09 | 0.00e+00 | 2.91e+08 |
| Np-237 | 6.63e+07 | 4.76e+06 | 2.92e+06 | 0.00e+00 | 2.16e+07 | 0.00e+00 | 4.19e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 6.65e+01 | 1.78e+00 | 1.04e+00 | 0.00e+00 | 6.10e+00 | 0.00e+00 | 1.31e+05 |
| Np-239 | 7.01e+00 | 6.62e-01 | 3.67e-01 | 0.00e+00 | 2.08e+00 | 0.00e+00 | 1.06e+05 |
| Pu-238 | 1.34e+07 | 1.71e+06 | 3.63e+05 | 0.00e+00 | 1.55e+06 | 0.00e+00 | 1.54e+06 |
| Pu-239 | 1.53e+07 | 1.85e+06 | 4.01e+05 | 0.00e+00 | 1.71e+06 | 0.00e+00 | 1.41e+06 |
| Pu-240 | 1.52e+07 | 1.85e+06 | 4.01e+05 | 0.00e+00 | 1.71e+06 | 0.00e+00 | 1.43e+06 |
| Pu-241 | 3.48e+05 | 1.67e+04 | 7.34e+03 | 0.00e+00 | 3.40e+04 | 0.00e+00 | 2.94e+04 |
| Pu-242 | 1.41e+07 | 1.78e+06 | 3.87e+05 | 0.00e+00 | 1.65e+06 | 0.00e+00 | 1.38e+06 |
| Pu-244 | 1.65e+07 | 2.03e+06 | 4.43e+05 | 0.00e+00 | 1.88e+06 | 0.00e+00 | 2.05e+06 |
| Am-241 | 3.94e+07 | 3.72e+07 | 2.84e+06 | 0.00e+00 | 2.13e+07 | 0.00e+00 | 3.89e+06 |
| Am-242m | 4.02e+07 | 3.54e+07 | 2.89e+06 | 0.00e+00 | 2.14e+07 | 0.00e+00 | 4.93e+06 |
| Am-243 | 3.97e+07 | 3.66e+07 | 2.80e+06 | 0.00e+00 | 2.10e+07 | 0.00e+00 | 4.60e+06 |
| Cm-242 | 1.34e+06 | 1.41e+06 | 8.88e+04 | 0.00e+00 | 4.05e+05 | 0.00e+00 | 3.82e+06 |
| Cm-243 | 3.24e+07 | 3.00e+07 | 2.04e+06 | 0.00e+00 | 9.51e+06 | 0.00e+00 | 4.12e+06 |
| Cm-244 | 2.51e+07 | 2.37e+07 | 1.59e+06 | 0.00e+00 | 7.41e+06 | 0.00e+00 | 3.98e+06 |
| Cm-245 | 4.94e+07 | 4.34e+07 | 3.04e+06 | 0.00e+00 | 1.42e+07 | 0.00e+00 | 3.72e+06 |
| Cm-246 | 4.90e+07 | 4.34e+07 | 3.04e+06 | 0.00e+00 | 1.42e+07 | 0.00e+00 | 3.65e+06 |
| Cm-247 | 4.77e+07 | 4.27e+07 | 2.99e+06 | 0.00e+00 | 1.40e+07 | 0.00e+00 | 4.80e+06 |
| Cm-248 | 3.96e+08 | 3.52e+08 | 2.47e+07 | 0.00e+00 | 1.15e+08 | 0.00e+00 | 7.73e+07 |
| Cf-252 | 1.70e+07 | 0.00e+00 | 4.10e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.50e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Child age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Cow's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 8.97e+02 | 8.97e+02 | 8.97e+02 | 8.97e+02 | 8.97e+02 | 8.97e+02 |
| Be-10 | 1.11e+07 | 1.29e+06 | 2.79e+05 | 0.00e+00 | 9.13e+05 | 0.00e+00 | 2.26e+07 |
| C-14 | 1.19e+09 | 2.39e+08 | 2.39e+08 | 2.39e+08 | 2.39e+08 | 2.39e+08 | 2.39e+08 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 1.97e-02 | 0.00e+00 | 1.96e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.34e-03 |
| Na-22 | 1.90e+10 | 1.90e+10 | 1.90e+10 | 1.90e+10 | 1.90e+10 | 1.90e+10 | 1.90e+10 |
| Na-24 | 8.88e+06 | 8.88e+06 | 8.88e+06 | 8.88e+06 | 8.88e+06 | 8.88e+06 | 8.88e+06 |
| P-32 | 7.78e+10 | 3.64e+09 | 3.00e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.15e+09 |
| Ca-41 | 2.28e+10 | 0.00e+00 | 2.49e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.25e+07 |
| Sc-46 | 6.83e+02 | 9.36e+02 | 3.61e+02 | 0.00e+00 | 8.29e+02 | 0.00e+00 | 1.37e+06 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.02e+05 | 5.65e+04 | 1.54e+04 | 1.03e+05 | 5.40e+06 |
| Mn-54 | 0.00e+00 | 2.10e+07 | 5.59e+06 | 0.00e+00 | 5.88e+06 | 0.00e+00 | 1.76e+07 |
| Mn-56 | 0.00e+00 | 1.28e-02 | 2.90e-03 | 0.00e+00 | 1.55e-02 | 0.00e+00 | 1.86e+00 |
| Fe-55 | 1.12e+08 | 5.93e+07 | 1.84e+07 | 0.00e+00 | 0.00e+00 | 3.35e+07 | 1.10e+07 |
| Fe-59 | 1.20e+08 | 1.95e+08 | 9.69e+07 | 0.00e+00 | 0.00e+00 | 5.64e+07 | 2.03e+08 |
| Co-57 | 0.00e+00 | 3.84e+06 | 7.77e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.14e+07 |
| Co-58 | 0.00e+00 | 1.21e+07 | 3.71e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.07e+07 |
| Co-60 | 0.00e+00 | 4.32e+07 | 1.27e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.39e+08 |
| Ni-59 | 2.22e+09 | 5.90e+08 | 3.76e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.91e+07 |
| Ni-63 | 2.96e+10 | 1.59e+09 | 1.01e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.07e+08 |
| Ni-65 | 1.68e+00 | 1.58e-01 | 9.24e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.94e+01 |
| Cu-64 | 0.00e+00 | 7.49e+04 | 4.52e+04 | 0.00e+00 | 1.81e+05 | 0.00e+00 | 3.51e+06 |
| Zn-65 | 4.13e+09 | 1.10e+10 | 6.85e+09 | 0.00e+00 | 6.94e+09 | 0.00e+00 | 1.93e+09 |
| Zn-69 | 9.87e-12 | 1.43e-11 | 1.32e-12 | 0.00e+00 | 8.65e-12 | 0.00e+00 | 8.99e-10 |
| Zn-69m | 8.06e+05 | 1.37e+06 | 1.62e+05 | 0.00e+00 | 7.98e+05 | 0.00e+00 | 4.47e+07 |
| Se-79 | 0.00e+00 | 3.12e+09 | 6.92e+08 | 0.00e+00 | 5.07e+09 | 0.00e+00 | 2.05e+08 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.15e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-83 | 0.00e+00 | 0.00e+00 | 4.47e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-84 | 0.00e+00 | 0.00e+00 | 7.00e-23 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 8.77e+09 | 5.39e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.64e+08 |
| Rb-87 | 0.00e+00 | 9.75e+09 | 4.52e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.46e+08 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 6.62e+09 | 0.00e+00 | 1.89e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.56e+08 |
| Sr-90 | 1.68e+11 | 0.00e+00 | 3.38e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.50e+09 |
| Sr-91 | 1.31e+05 | 0.00e+00 | 4.94e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.89e+05 |
| Sr-92 | 2.21e+00 | 0.00e+00 | 8.88e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.19e+01 |
| Y-90 | 3.22e+02 | 0.00e+00 | 8.63e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.18e+05 |
| Y-91 | 3.90e+04 | 0.00e+00 | 1.04e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.20e+06 |
| Y-91m | 2.80e-19 | 0.00e+00 | 1.02e-20 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.49e-16 |
| Y-92 | 2.56e-04 | 0.00e+00 | 7.32e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.39e+00 |
| Y-93 | 1.02e+00 | 0.00e+00 | 2.79e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.51e+04 |
| Zr-93 | 6.87e+03 | 2.57e+02 | 1.83e+02 | 0.00e+00 | 9.95e+02 | 0.00e+00 | 9.75e+04 |
| Zr-95 | 3.83e+03 | 8.42e+02 | 7.50e+02 | 0.00e+00 | 1.21e+03 | 0.00e+00 | 8.79e+05 |
| Zr-97 | 1.92e+00 | 2.78e-01 | 1.64e-01 | 0.00e+00 | 3.99e-01 | 0.00e+00 | 4.21e+04 |
| Nb-93m | 2.15e+06 | 5.37e+05 | 1.77e+05 | 0.00e+00 | 5.80e+05 | 0.00e+00 | 8.10e+07 |
| Nb-95 | 3.18e+05 | 1.24e+05 | 8.84e+04 | 0.00e+00 | 1.16e+05 | 0.00e+00 | 2.29e+08 |
| Nb-97 | 2.91e-11 | 5.26e-12 | 2.46e-12 | 0.00e+00 | 5.84e-12 | 0.00e+00 | 1.62e-06 |
| Mo-93 | 0.00e+00 | 1.49e+09 | 5.34e+07 | 0.00e+00 | 3.92e+08 | 0.00e+00 | 7.53e+07 |
| Mo-99 | 0.00e+00 | 8.14e+07 | 2.01e+07 | 0.00e+00 | 1.74e+08 | 0.00e+00 | 6.73e+07 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 1.10e+08 | 1.23e+08 | 4.40e+07 | 0.00e+00 | 1.44e+09 | 1.08e+07 | 1.29e+09 |
| Tc-99m | 1.33e+01 | 2.61e+01 | 4.32e+02 | 0.00e+00 | 3.79e+02 | 1.32e+01 | 1.48e+04 |
| Ru-103 | 4.28e+03 | 0.00e+00 | 1.65e+03 | 0.00e+00 | 1.08e+04 | 0.00e+00 | 1.11e+05 |
| Ru-105 | 3.85e-03 | 0.00e+00 | 1.40e-03 | 0.00e+00 | 3.39e-02 | 0.00e+00 | 2.51e+00 |
| Ru-106 | 9.24e+04 | 0.00e+00 | 1.15e+04 | 0.00e+00 | 1.25e+05 | 0.00e+00 | 1.44e+06 |
| Rh-105 | 1.56e+06 | 8.40e+05 | 7.18e+05 | 0.00e+00 | 3.35e+06 | 0.00e+00 | 5.21e+07 |
| Pd-107 | 0.00e+00 | 3.88e+07 | 3.30e+06 | 0.00e+00 | 3.25e+08 | 0.00e+00 | 7.71e+07 |
| Pd-109 | 0.00e+00 | 1.53e+05 | 4.59e+04 | 0.00e+00 | 8.22e+05 | 0.00e+00 | 9.05e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 2.09e+08 | 1.41e+08 | 1.13e+08 | 0.00e+00 | 2.63e+08 | 0.00e+00 | 1.68e+10 |
| Ag-111 | 2.94e+07 | 9.20e+06 | 6.07e+06 | 0.00e+00 | 2.78e+07 | 0.00e+00 | 5.63e+09 |
| Cc-113m | 0.00e+00 | 1.00e+07 | 4.27e+05 | 0.00e+00 | 1.03e+07 | 0.00e+00 | 2.59e+07 |
| Cc-115m | 0.00e+00 | 4.29e+06 | 1.83e+05 | 0.00e+00 | 3.19e+06 | 0.00e+00 | 5.83e+07 |
| Sr-123 | 2.44e+09 | 3.03e+07 | 5.95e+07 | 3.21e+07 | 0.00e+00 | 0.00e+00 | 1.20e+09 |
| Sr-125 | 2.57e+08 | 3.88e+06 | 1.15e+07 | 4.03e+06 | 0.00e+00 | 0.00e+00 | 7.98e+08 |
| Sr-126 | 6.85e+09 | 8.54e+07 | 1.95e+08 | 2.34e+07 | 0.00e+00 | 0.00e+00 | 5.14e+08 |
| Sb-124 | 1.09e+08 | 1.41e+06 | 3.81e+07 | 2.40e+05 | 0.00e+00 | 6.03e+07 | 6.79e+08 |
| Sb-125 | 8.70e+07 | 6.71e+05 | 1.82e+07 | 8.06e+04 | 0.00e+00 | 4.85e+07 | 2.08e+08 |
| Sb-126 | 2.29e+07 | 3.51e+05 | 8.23e+06 | 1.34e+05 | 0.00e+00 | 1.09e+07 | 4.62e+08 |
| Sb-127 | 1.98e+06 | 3.07e+04 | 6.88e+05 | 2.21e+04 | 0.00e+00 | 8.60e+05 | 1.12e+08 |
| Te-125m | 7.38e+07 | 2.00e+07 | 9.84e+06 | 2.07e+07 | 0.00e+00 | 0.00e+00 | 7.12e+07 |
| Te-127 | 2.99e+03 | 8.06e+02 | 6.41e+02 | 2.07e+03 | 8.50e+03 | 0.00e+00 | 1.17e+05 |
| Te-127m | 2.08e+08 | 5.60e+07 | 2.47e+07 | 4.97e+07 | 5.93e+08 | 0.00e+00 | 1.68e+08 |
| Te-129 | 1.33e-09 | 3.70e-10 | 3.15e-10 | 9.46e-10 | 3.88e-09 | 0.00e+00 | 8.25e-08 |
| Te-129m | 2.71e+08 | 7.58e+07 | 4.21e+07 | 8.75e+07 | 7.97e+08 | 0.00e+00 | 3.31e+08 |
| Te-131 | 1.77e-32 | 5.40e-33 | 5.27e-33 | 1.36e-32 | 5.36e-32 | 0.00e+00 | 9.31e-32 |
| Te-131m | 1.60e+06 | 5.54e+05 | 5.89e+05 | 1.14e+06 | 5.36e+06 | 0.00e+00 | 2.25e+07 |
| Te-132 | 1.03e+07 | 4.54e+06 | 5.48e+06 | 6.61e+06 | 4.21e+07 | 0.00e+00 | 4.57e+07 |
| Te-133m | 9.46e-13 | 3.82e-13 | 4.74e-13 | 7.33e-13 | 3.63e-12 | 0.00e+00 | 2.92e-11 |
| Te-134 | 3.99e-18 | 1.79e-18 | 2.39e-18 | 3.15e-18 | 1.66e-17 | 0.00e+00 | 1.82e-17 |
| I-129 | 3.43e+09 | 2.11e+09 | 1.88e+09 | 1.38e+12 | 3.55e+09 | 0.00e+00 | 1.06e+08 |
| I-130 | 1.73e+06 | 3.50e+06 | 1.80e+06 | 3.86e+08 | 5.23e+06 | 0.00e+00 | 1.64e+06 |
| I-131 | 1.30e+09 | 1.31e+09 | 7.45e+08 | 4.33e+11 | 2.15e+09 | 0.00e+00 | 1.17e+08 |
| I-132 | 7.01e-01 | 1.29e+00 | 5.92e-01 | 5.97e+01 | 1.97e+00 | 0.00e+00 | 1.52e+00 |
| I-133 | 1.72e+07 | 2.13e+07 | 8.05e+06 | 3.95e+09 | 3.55e+07 | 0.00e+00 | 8.57e+06 |
| I-134 | 8.87e-12 | 1.65e-11 | 7.57e-12 | 3.79e-10 | 2.52e-11 | 0.00e+00 | 1.09e-11 |
| I-135 | 5.43e+04 | 9.77e+04 | 4.62e+04 | 8.66e+06 | 1.50e+05 | 0.00e+00 | 7.45e+04 |
| Cs-134 | 2.26e+10 | 3.71e+10 | 7.84e+09 | 0.00e+00 | 1.15e+10 | 4.13e+09 | 2.00e+08 |
| Cs-134m | 7.42e-01 | 1.10e+00 | 7.18e-01 | 0.00e+00 | 5.80e-01 | 9.59e-02 | 1.39e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 8.19e+09 | 5.71e+09 | 5.85e+08 | 0.00e+00 | 2.01e+09 | 6.72e+08 | 4.27e+07 |
| Cs-136 | 1.01e+09 | 2.78e+09 | 1.80e+09 | 0.00e+00 | 1.48e+09 | 2.21e+08 | 9.77e+07 |
| Cs-137 | 3.22e+10 | 3.09e+10 | 4.55e+09 | 0.00e+00 | 1.01e+10 | 3.62e+09 | 1.93e+08 |
| Cs-138 | 4.27e-23 | 5.94e-23 | 3.77e-23 | 0.00e+00 | 4.18e-23 | 4.50e-24 | 2.74e-23 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 2.06e-07 | 1.10e-10 | 5.98e-09 | 0.00e+00 | 9.62e-11 | 6.48e-11 | 1.19e-05 |
| Ba-140 | 1.17e+08 | 1.03e+05 | 6.84e+06 | 0.00e+00 | 3.34e+04 | 6.12e+04 | 5.93e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 1.94e+01 | 6.79e+00 | 2.29e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.89e+05 |
| La-141 | 1.36e-04 | 3.17e-05 | 6.89e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.06e+00 |
| La-142 | 8.30e-11 | 2.64e-11 | 8.28e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.24e-06 |
| Ce-141 | 2.19e+04 | 1.09e+04 | 1.62e+03 | 0.00e+00 | 4.78e+03 | 0.00e+00 | 1.36e+07 |
| Ce-143 | 1.88e+02 | 1.02e+05 | 1.47e+01 | 0.00e+00 | 4.27e+01 | 0.00e+00 | 1.49e+06 |
| Ce-144 | 1.62e+06 | 5.09e+05 | 8.66e+04 | 0.00e+00 | 2.82e+05 | 0.00e+00 | 1.33e+08 |
| Pr-143 | 7.18e+02 | 2.16e+02 | 3.56e+01 | 0.00e+00 | 1.17e+02 | 0.00e+00 | 7.75e+05 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 4.45e+02 | 3.60e+02 | 2.79e+01 | 0.00e+00 | 1.98e+02 | 0.00e+00 | 5.71e+05 |
| Pm-147 | 1.29e+04 | 9.19e+02 | 4.94e+02 | 0.00e+00 | 1.62e+03 | 0.00e+00 | 3.72e+05 |
| Pm-148 | 2.66e+02 | 3.20e+01 | 2.07e+01 | 0.00e+00 | 5.44e+01 | 0.00e+00 | 8.54e+05 |
| Pm-148m | 3.06e+03 | 6.09e+02 | 6.09e+02 | 0.00e+00 | 9.03e+02 | 0.00e+00 | 1.72e+06 |
| Pm-149 | 1.94e+01 | 2.07e+00 | 1.12e+00 | 0.00e+00 | 3.65e+00 | 0.00e+00 | 1.41e+05 |
| Pm-151 | 2.88e+00 | 3.51e-01 | 2.28e-01 | 0.00e+00 | 5.95e-01 | 0.00e+00 | 3.98e+04 |
| Sm-151 | 1.05e+04 | 1.57e+03 | 4.93e+02 | 0.00e+00 | 1.62e+03 | 0.00e+00 | 2.27e+05 |
| Sm-153 | 9.02e+00 | 5.61e+00 | 5.41e-01 | 0.00e+00 | 1.71e+00 | 0.00e+00 | 7.46e+04 |
| Eu-152 | 2.52e+04 | 4.59e+03 | 5.45e+03 | 0.00e+00 | 1.94e+04 | 0.00e+00 | 7.54e+05 |
| Eu-154 | 9.46e+04 | 8.51e+03 | 7.77e+03 | 0.00e+00 | 3.74e+04 | 0.00e+00 | 1.98e+06 |
| Eu-155 | 1.94e+04 | 1.39e+03 | 1.09e+03 | 0.00e+00 | 5.22e+03 | 0.00e+00 | 3.49e+06 |
| Eu-156 | 1.10e+03 | 5.88e+02 | 1.22e+02 | 0.00e+00 | 3.79e+02 | 0.00e+00 | 1.33e+06 |
| Tb-160 | 5.61e+03 | 0.00e+00 | 6.96e+02 | 0.00e+00 | 1.67e+03 | 0.00e+00 | 1.24e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ho-166m | 4.44e+04 | 9.30e+03 | 7.86e+03 | 0.00e+00 | 1.32e+04 | 0.00e+00 | 1.08e+06 |
| W-181 | 1.54e+05 | 3.79e+04 | 5.21e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.38e+06 |
| W-185 | 5.89e+06 | 1.47e+06 | 2.06e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.48e+07 |
| W-187 | 2.89e+04 | 1.71e+04 | 7.69e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.41e+06 |
| Pb-210 | 2.42e+11 | 6.21e+10 | 1.06e+10 | 0.00e+00 | 1.87e+11 | 0.00e+00 | 1.17e+07 |
| Bi-210 | 1.62e+06 | 8.38e+06 | 9.29e+05 | 0.00e+00 | 9.45e+07 | 0.00e+00 | 4.25e+07 |
| Po-210 | 3.37e+09 | 5.39e+09 | 8.14e+08 | 0.00e+00 | 1.68e+10 | 0.00e+00 | 1.45e+08 |
| Ra-223 | 5.55e+11 | 6.41e+08 | 1.11e+11 | 0.00e+00 | 1.70e+10 | 0.00e+00 | 8.84e+09 |
| Ra-224 | 6.43e+10 | 1.17e+08 | 1.29e+10 | 0.00e+00 | 3.09e+09 | 0.00e+00 | 3.53e+09 |
| Ra-225 | 8.62e+11 | 7.70e+08 | 1.72e+11 | 0.00e+00 | 2.04e+10 | 0.00e+00 | 9.89e+09 |
| Ra-226 | 3.78e+13 | 1.21e+09 | 3.11e+13 | 0.00e+00 | 3.21e+10 | 0.00e+00 | 2.24e+10 |
| Ra-228 | 2.52e+13 | 6.53e+08 | 2.82e+13 | 0.00e+00 | 1.73e+10 | 0.00e+00 | 3.80e+09 |
| Ac-225 | 2.81e+05 | 2.89e+05 | 1.88e+04 | 0.00e+00 | 3.09e+04 | 0.00e+00 | 6.43e+06 |
| Ac-227 | 1.69e+08 | 2.72e+07 | 1.05e+07 | 0.00e+00 | 5.99e+06 | 0.00e+00 | 3.46e+06 |
| Th-227 | 1.27e+06 | 1.73e+04 | 3.67e+04 | 0.00e+00 | 9.17e+04 | 0.00e+00 | 1.22e+07 |
| Th-228 | 8.33e+07 | 1.07e+06 | 2.82e+06 | 0.00e+00 | 5.55e+06 | 0.00e+00 | 2.33e+07 |
| Th-229 | 9.67e+08 | 2.43e+07 | 1.61e+07 | 0.00e+00 | 1.19e+08 | 0.00e+00 | 3.31e+06 |
| Th-230 | 1.46e+08 | 7.32e+06 | 4.08e+06 | 0.00e+00 | 3.57e+07 | 0.00e+00 | 2.55e+06 |
| Th-232 | 1.63e+08 | 6.25e+06 | 1.24e+05 | 0.00e+00 | 3.05e+07 | 0.00e+00 | 2.17e+06 |
| Th-234 | 8.40e+03 | 3.71e+02 | 2.43e+02 | 0.00e+00 | 1.97e+03 | 0.00e+00 | 2.90e+06 |
| Pa-231 | 2.91e+08 | 9.63e+06 | 1.16e+07 | 0.00e+00 | 5.27e+07 | 0.00e+00 | 3.03e+06 |
| Pa-233 | 4.68e+02 | 7.30e+01 | 8.18e+01 | 0.00e+00 | 2.69e+02 | 0.00e+00 | 3.73e+05 |
| U-232 | 7.24e+10 | 0.00e+00 | 5.18e+09 | 0.00e+00 | 5.51e+09 | 0.00e+00 | 2.87e+08 |
| U-233 | 1.53e+10 | 0.00e+00 | 9.26e+08 | 0.00e+00 | 2.51e+09 | 0.00e+00 | 2.65e+08 |
| U-234 | 1.47e+10 | 0.00e+00 | 9.09e+08 | 0.00e+00 | 2.46e+09 | 0.00e+00 | 2.60e+08 |
| U-235 | 1.41e+10 | 0.00e+00 | 8.51e+08 | 0.00e+00 | 2.31e+09 | 0.00e+00 | 3.30e+08 |
| U-236 | 1.41e+10 | 0.00e+00 | 8.72e+08 | 0.00e+00 | 2.36e+09 | 0.00e+00 | 2.44e+08 |
| U-237 | 2.57e+05 | 0.00e+00 | 6.83e+04 | 0.00e+00 | 7.42e+05 | 0.00e+00 | 2.27e+07 |
| U-238 | 1.35e+10 | 0.00e+00 | 7.98e+08 | 0.00e+00 | 2.16e+09 | 0.00e+00 | 2.33e+08 |
| Np-237 | 9.17e+07 | 6.05e+06 | 4.03e+06 | 0.00e+00 | 2.49e+07 | 0.00e+00 | 3.36e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.64e+02 | 3.32e+00 | 2.55e+00 | 0.00e+00 | 1.06e+01 | 0.00e+00 | 1.14e+05 |
| Np-239 | 1.73e+01 | 1.24e+00 | 8.71e-01 | 0.00e+00 | 3.58e+00 | 0.00e+00 | 9.17e+04 |
| Pu-238 | 1.96e+07 | 2.27e+06 | 5.20e+05 | 0.00e+00 | 1.89e+06 | 0.00e+00 | 1.23e+06 |
| Pu-239 | 2.12e+07 | 2.27e+06 | 5.45e+05 | 0.00e+00 | 2.01e+06 | 0.00e+00 | 1.13e+06 |
| Pu-240 | 2.11e+07 | 2.35e+06 | 5.45e+05 | 0.00e+00 | 2.01e+06 | 0.00e+00 | 1.15e+06 |
| Pu-241 | 6.35e+05 | 2.59e+04 | 1.32e+04 | 0.00e+00 | 4.86e+04 | 0.00e+00 | 2.36e+04 |
| Pu-242 | 1.96e+07 | 2.27e+06 | 5.25e+05 | 0.00e+00 | 1.93e+06 | 0.00e+00 | 1.10e+06 |
| Pu-244 | 2.29e+07 | 2.60e+07 | 6.01e+05 | 0.00e+00 | 2.22e+06 | 0.00e+00 | 1.65e+06 |
| Am-241 | 5.54e+07 | 4.77e+07 | 4.16e+06 | 0.00e+00 | 2.54e+07 | 0.00e+00 | 3.11e+06 |
| Am-242m | 5.76e+07 | 4.61e+07 | 4.28e+06 | 0.00e+00 | 2.59e+07 | 0.00e+00 | 3.95e+06 |
| Am-243 | 5.51e+07 | 4.65e+07 | 4.04e+06 | 0.00e+00 | 2.49e+07 | 0.00e+00 | 3.68e+06 |
| Cm-242 | 3.30e+06 | 2.63e+06 | 2.19e+05 | 0.00e+00 | 7.02e+05 | 0.00e+00 | 3.06e+06 |
| Cm-243 | 5.26e+07 | 4.27e+07 | 3.38e+06 | 0.00e+00 | 1.27e+07 | 0.00e+00 | 3.30e+06 |
| Cm-244 | 4.43e+07 | 3.59e+07 | 2.84e+06 | 0.00e+00 | 1.04e+07 | 0.00e+00 | 3.19e+06 |
| Cm-245 | 6.87e+07 | 5.51e+07 | 4.32e+06 | 0.00e+00 | 1.69e+07 | 0.00e+00 | 2.98e+06 |
| Cm-246 | 6.79e+07 | 5.51e+07 | 4.32e+06 | 0.00e+00 | 1.69e+07 | 0.00e+00 | 2.92e+06 |
| Cm-247 | 6.62e+07 | 5.43e+07 | 4.24e+06 | 0.00e+00 | 1.66e+07 | 0.00e+00 | 3.85e+06 |
| Cm-248 | 5.51e+08 | 4.48e+08 | 3.50e+07 | 0.00e+00 | 1.37e+08 | 0.00e+00 | 6.21e+07 |
| Cf-252 | 4.25e+07 | 0.00e+00 | 1.03e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.20e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 1.36e+03 | 1.36e+03 | 1.36e+03 | 1.36e+03 | 1.36e+03 | 1.36e+03 |
| Be-10 | 1.41e+07 | 2.05e+06 | 4.25e+05 | 0.00e+00 | 1.35e+06 | 0.00e+00 | 2.29e+07 |
| C-14 | 2.34e+09 | 5.00e+08 | 5.00e+08 | 5.00e+08 | 5.00e+08 | 5.00e+08 | 5.00e+08 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 4.12e-02 | 0.00e+00 | 3.51e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.67e-03 |
| Na-22 | 3.18e+10 | 3.18e+10 | 3.18e+10 | 3.18e+10 | 3.18e+10 | 3.18e+10 | 3.18e+10 |
| Na-24 | 1.55e+07 | 1.55e+07 | 1.55e+07 | 1.55e+07 | 1.55e+07 | 1.55e+07 | 1.55e+07 |
| P-32 | 1.60e+11 | 9.43e+09 | 6.21e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.17e+09 |
| Ca-41 | 2.46e+10 | 0.00e+00 | 2.69e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.26e+07 |
| Sc-46 | 1.30e+03 | 1.88e+03 | 5.86e+02 | 0.00e+00 | 1.23e+03 | 0.00e+00 | 1.22e+06 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.61e+05 | 1.05e+05 | 2.30e+04 | 2.05e+05 | 4.70e+06 |
| Mn-54 | 0.00e+00 | 3.90e+07 | 8.84e+06 | 0.00e+00 | 8.64e+06 | 0.00e+00 | 1.43e+07 |
| Mn-56 | 0.00e+00 | 3.14e-02 | 5.42e-03 | 0.00e+00 | 2.70e-02 | 0.00e+00 | 2.86e+00 |
| Fe-55 | 1.35e+08 | 8.73e+07 | 2.33e+07 | 0.00e+00 | 0.00e+00 | 4.27e+07 | 1.11e+07 |
| Fe-59 | 2.24e+08 | 3.92e+08 | 1.54e+08 | 0.00e+00 | 0.00e+00 | 1.16e+08 | 1.87e+08 |
| Co-57 | 0.00e+00 | 8.95e+06 | 1.46e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.05e+07 |
| Co-58 | 0.00e+00 | 2.42e+07 | 6.05e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.04e+07 |
| Co-60 | 0.00e+00 | 8.81e+07 | 2.08e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.10e+08 |
| Ni-59 | 2.61e+09 | 7.99e+08 | 4.50e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.95e+07 |
| Ni-63 | 3.49e+10 | 2.16e+09 | 1.21e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.07e+08 |
| Ni-65 | 3.56e+00 | 4.03e-01 | 1.83e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.07e+01 |
| Cu-64 | 0.00e+00 | 1.86e+05 | 8.62e+04 | 0.00e+00 | 3.15e+05 | 0.00e+00 | 3.82e+06 |
| Zn-65 | 5.55e+09 | 1.90e+10 | 8.78e+09 | 0.00e+00 | 9.23e+09 | 0.00e+00 | 1.61e+10 |
| Zn-69 | 2.10e-11 | 3.79e-11 | 2.82e-12 | 0.00e+00 | 1.57e-11 | 0.00e+00 | 3.09e-09 |
| Zn-69m | 1.70e+06 | 3.48e+06 | 3.17e+05 | 0.00e+00 | 1.41e+06 | 0.00e+00 | 4.82e+07 |
| Se-79 | 0.00e+00 | 7.77e+09 | 1.44e+09 | 0.00e+00 | 9.00e+09 | 0.00e+00 | 2.07e+08 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.93e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 9.49e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 1.35e-22 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.23e+10 | 1.10e+10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.69e+08 |
| Rb-87 | 0.00e+00 | 2.19e+10 | 8.69e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.48e+08 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 1.26e+10 | 0.00e+00 | 3.61e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.59e+08 |
| Sr-90 | 1.86e+11 | 0.00e+00 | 3.77e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.52e+09 |
| Sr-91 | 2.73e+05 | 0.00e+00 | 9.87e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.23e+05 |
| Sr-92 | 4.71e+00 | 0.00e+00 | 1.75e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.08e+01 |
| Y-90 | 6.82e+02 | 0.00e+00 | 1.83e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.41e+05 |
| Y-91 | 7.33e+04 | 0.00e+00 | 1.95e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.25e+06 |
| Y-91m | 5.94e-19 | 0.00e+00 | 2.03e-20 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.98e-15 |
| Y-92 | 5.44e-04 | 0.00e+00 | 1.53e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.04e+01 |
| Y-93 | 2.16e+00 | 0.00e+00 | 5.90e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.71e+04 |
| Zr-93 | 7.94e+03 | 3.78e+02 | 2.28e+02 | 0.00e+00 | 1.11e+03 | 0.00e+00 | 9.83e+04 |
| Zr-95 | 6.80e+03 | 1.66e+03 | 1.18e+03 | 0.00e+00 | 1.79e+03 | 0.00e+00 | 8.26e+05 |
| Zr-97 | 4.07e+00 | 6.99e-01 | 3.19e-01 | 0.00e+00 | 7.04e-01 | 0.00e+00 | 4.46e+04 |
| Nb-93m | 2.52e+06 | 6.83e+05 | 2.13e+05 | 0.00e+00 | 6.66e+05 | 0.00e+00 | 8.16e+07 |
| Nb-95 | 5.93e+05 | 2.44e+05 | 1.41e+05 | 0.00e+00 | 1.75e+05 | 0.00e+00 | 2.06e+08 |
| Nb-97 | 6.16e-11 | 1.31e-11 | 4.74e-12 | 0.00e+00 | 1.03e-11 | 0.00e+00 | 4.15e-06 |
| Mo-93 | 0.00e+00 | 3.49e+09 | 1.12e+08 | 0.00e+00 | 6.97e+08 | 0.00e+00 | 7.47e+07 |
| Mo-99 | 0.00e+00 | 2.08e+08 | 4.06e+07 | 0.00e+00 | 3.11e+08 | 0.00e+00 | 6.86e+07 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 2.22e+08 | 3.00e+08 | 9.36e+07 | 0.00e+00 | 2.53e+09 | 2.92e+07 | 1.30e+09 |
| Tc-99m | 2.77e+01 | 5.70e+01 | 7.35e+02 | 0.00e+00 | 6.14e+02 | 2.98e+01 | 1.66e+04 |
| Ru-103 | 8.67e+03 | 0.00e+00 | 2.90e+03 | 0.00e+00 | 1.80e+04 | 0.00e+00 | 1.05e+05 |
| Ru-105 | 8.12e-03 | 0.00e+00 | 2.74e-03 | 0.00e+00 | 5.97e-02 | 0.00e+00 | 3.23e+00 |
| Ru-106 | 1.90e+05 | 0.00e+00 | 2.38e+04 | 0.00e+00 | 2.25e+05 | 0.00e+00 | 1.44e+06 |
| Rh-105 | 3.32e+06 | 2.17e+06 | 1.46e+06 | 0.00e+00 | 6.03e+06 | 0.00e+00 | 5.39e+07 |
| Pd-107 | 0.00e+00 | 9.79e+07 | 6.95e+06 | 0.00e+00 | 5.59e+08 | 0.00e+00 | 7.78e+07 |
| Pd-109 | 0.00e+00 | 4.05e+05 | 9.78e+04 | 0.00e+00 | 1.49e+06 | 0.00e+00 | 9.95e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 3.86e+08 | 2.82e+08 | 1.86e+08 | 0.00e+00 | 4.03e+08 | 0.00e+00 | 1.46e+10 |
| Ag-111 | 6.17e+07 | 2.40e+07 | 1.27e+07 | 0.00e+00 | 5.01e+07 | 0.00e+00 | 5.72e+09 |
| Cd-113m | 0.00e+00 | 1.74e+07 | 6.42e+05 | 0.00e+00 | 1.32e+07 | 0.00e+00 | 2.62e+07 |
| Cd-115m | 0.00e+00 | 1.03e+07 | 3.59e+05 | 0.00e+00 | 5.40e+06 | 0.00e+00 | 5.89e+07 |
| Sn-123 | 4.57e+09 | 7.14e+07 | 1.19e+08 | 7.18e+07 | 0.00e+00 | 0.00e+00 | 1.21e+09 |
| Sn-125 | 5.37e+08 | 1.00e+07 | 2.39e+07 | 9.86e+06 | 0.00e+00 | 0.00e+00 | 8.05e+08 |
| Sn-126 | 1.14e+10 | 1.49e+08 | 3.70e+08 | 3.93e+07 | 0.00e+00 | 0.00e+00 | 5.18e+08 |
| Sb-124 | 2.09e+08 | 3.08e+06 | 6.49e+07 | 5.56e+05 | 0.00e+00 | 1.31e+08 | 6.46e+08 |
| Sb-125 | 1.50e+08 | 1.45e+06 | 3.08e+07 | 1.87e+05 | 0.00e+00 | 8.65e+07 | 1.99e+08 |
| Sb-126 | 4.20e+07 | 8.23e+05 | 1.52e+07 | 3.22e+05 | 0.00e+00 | 2.64e+07 | 4.35e+08 |
| Sb-127 | 4.17e+06 | 7.44e+04 | 1.29e+06 | 5.31e+04 | 0.00e+00 | 2.15e+06 | 1.11e+08 |
| Te-125m | 1.51e+08 | 5.04e+07 | 2.04e+07 | 5.07e+07 | 0.00e+00 | 0.00e+00 | 7.18e+07 |
| Te-127 | 6.34e+03 | 2.13e+03 | 1.36e+03 | 5.16e+03 | 1.55e+04 | 0.00e+00 | 1.33e+05 |
| Te-127m | 4.21e+08 | 1.40e+08 | 5.10e+07 | 1.22e+08 | 1.04e+09 | 0.00e+00 | 1.70e+08 |
| Te-129 | 2.81e-09 | 9.69e-10 | 6.56e-10 | 2.36e-09 | 7.00e-09 | 0.00e+00 | 2.25e-07 |
| Te-129m | 5.57e+08 | 1.91e+08 | 8.58e+07 | 2.14e+08 | 1.39e+09 | 0.00e+00 | 3.33e+08 |
| Te-131 | 3.76e-32 | 1.39e-32 | 1.05e-32 | 3.35e-32 | 9.61e-32 | 0.00e+00 | 1.52e-30 |
| Te-131m | 3.38e+06 | 1.36e+06 | 1.12e+06 | 2.76e+06 | 9.36e+06 | 0.00e+00 | 2.29e+07 |
| Te-132 | 2.11e+07 | 1.05e+07 | 9.75e+06 | 1.54e+07 | 6.54e+07 | 0.00e+00 | 3.87e+07 |
| Te-133m | 1.98e-12 | 9.05e-13 | 8.65e-13 | 1.74e-12 | 6.17e-12 | 0.00e+00 | 9.76e-11 |
| Te-134 | 8.25e-18 | 4.14e-18 | 4.27e-18 | 7.39e-18 | 2.79e-17 | 0.00e+00 | 9.46e-17 |
| I-129 | 7.06e+09 | 5.23e+09 | 3.83e+09 | 3.36e+12 | 6.19e+09 | 0.00e+00 | 1.05e+08 |
| I-130 | 3.56e+06 | 7.83e+06 | 3.14e+06 | 8.78e+08 | 8.60e+06 | 0.00e+00 | 1.68e+06 |
| I-131 | 2.72e+09 | 3.21e+09 | 1.41e+09 | 1.05e+12 | 3.74e+09 | 0.00e+00 | 1.14e+08 |
| I-132 | 1.45e+00 | 2.95e+00 | 1.05e+00 | 1.38e+02 | 3.29e+00 | 0.00e+00 | 2.39e+00 |
| I-133 | 3.63e+07 | 5.29e+07 | 1.55e+07 | 9.62e+09 | 6.22e+07 | 0.00e+00 | 8.95e+06 |
| I-134 | 1.84e-11 | 3.77e-11 | 1.34e-11 | 8.78e-10 | 4.21e-11 | 0.00e+00 | 3.89e-11 |
| I-135 | 1.13e+05 | 2.25e+05 | 8.19e+04 | 2.01e+07 | 2.50e+05 | 0.00e+00 | 8.13e+04 |
| Cs-134 | 3.65e+10 | 6.80e+10 | 6.87e+09 | 0.00e+00 | 1.75e+10 | 7.18e+09 | 1.85e+08 |
| Cs-134m | 1.55e+00 | 2.58e+00 | 1.30e+00 | 0.00e+00 | 9.94e-01 | 2.29e-01 | 2.04e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LII |
| Cs-135 | 1.31e+10 | 1.19e+10 | 6.22e+08 | 0.00e+00 | 3.40e+09 | 1.29e+09 | 4.31e+07 |
| Cs-136 | 1.98e+09 | 5.81e+09 | 2.17e+09 | 0.00e+00 | 2.32e+09 | 4.74e+08 | 8.83e+07 |
| Cs-137 | 5.15e+10 | 6.02e+10 | 4.27e+09 | 0.00e+00 | 1.62e+10 | 6.55e+09 | 1.88e+08 |
| Cs-138 | 9.01e-23 | 1.47e-22 | 7.10e-23 | 0.00e+00 | 7.31e-23 | 1.14e-23 | 2.34e-22 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 4.39e-07 | 2.91e-10 | 1.27e-08 | 0.00e+00 | 1.75e-10 | 1.77e-10 | 2.78e-05 |
| Ba-140 | 2.41e+08 | 2.41e+05 | 1.24e+07 | 0.00e+00 | 5.72e+04 | 1.48e+05 | 5.92e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 4.06e+01 | 1.60e+01 | 4.11e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.88e+05 |
| La-141 | 2.89e-04 | 8.39e-05 | 1.46e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.62e+00 |
| La-142 | 1.74e-10 | 6.40e-11 | 1.53e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.09e-05 |
| Ce-141 | 4.34e+04 | 2.64e+04 | 3.11e+03 | 0.00e+00 | 8.15e+03 | 0.00e+00 | 1.37e+07 |
| Ce-143 | 3.97e+02 | 2.64e+05 | 3.01e+01 | 0.00e+00 | 7.68e+01 | 0.00e+00 | 1.54e+06 |
| Ce-144 | 2.33e+06 | 9.52e+05 | 1.30e+05 | 0.00e+00 | 3.85e+05 | 0.00e+00 | 1.33e+08 |
| Pr-143 | 1.49e+03 | 5.55e+02 | 7.36e+01 | 0.00e+00 | 2.06e+02 | 0.00e+00 | 7.84e+05 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 8.81e+02 | 9.05e+02 | 5.55e+01 | 0.00e+00 | 3.49e+02 | 0.00e+00 | 5.74e+05 |
| Pm-147 | 1.57e+04 | 1.32e+03 | 6.44e+02 | 0.00e+00 | 1.98e+03 | 0.00e+00 | 3.75e+05 |
| Pm-148 | 5.57e+02 | 8.04e+01 | 4.05e+01 | 0.00e+00 | 9.60e+01 | 0.00e+00 | 8.58e+05 |
| Pm-148m | 4.90e+03 | 1.24e+03 | 9.74e+02 | 0.00e+00 | 1.43e+03 | 0.00e+00 | 1.62e+06 |
| Pm-149 | 4.13e+01 | 5.42e+00 | 2.37e+00 | 0.00e+00 | 6.59e+00 | 0.00e+00 | 1.46e+05 |
| Pm-151 | 6.10e+00 | 8.90e-01 | 4.50e-01 | 0.00e+00 | 1.06e+00 | 0.00e+00 | 4.12e+04 |
| Sm-151 | 1.19e+04 | 2.74e+03 | 5.92e+02 | 0.00e+00 | 1.86e+03 | 0.00e+00 | 2.29e+05 |
| Sm-153 | 1.91e+01 | 1.47e+01 | 1.13e+00 | 0.00e+00 | 3.09e+00 | 0.00e+00 | 7.71e+04 |
| Eu-152 | 2.76e+04 | 7.34e+03 | 6.19e+03 | 0.00e+00 | 2.06e+04 | 0.00e+00 | 6.52e+05 |
| Eu-154 | 1.09e+05 | 1.51e+04 | 9.05e+03 | 0.00e+00 | 4.09e+04 | 0.00e+00 | 1.88e+06 |
| Eu-155 | 2.18e+04 | 2.51e+03 | 1.30e+03 | 0.00e+00 | 5.63e+03 | 0.00e+00 | 3.36e+05 |
| Eu-156 | 2.23e+03 | 1.38e+03 | 2.19e+02 | 0.00e+00 | 6.37e+02 | 0.00e+00 | 1.30e+05 |
| Tb-160 | 8.75e+03 | 0.00e+00 | 1.09e+03 | 0.00e+00 | 2.49e+03 | 0.00e+00 | 1.17e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Cow's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 5.14e+04 | 1.11e+04 | 8.76e+03 | 0.00e+00 | 1.47e+04 | 0.00e+00 | 1.09e+06 |
| W-181 | 3.23e+05 | 9.91e+04 | 1.11e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.39e+06 |
| W-185 | 1.23e+07 | 3.85e+06 | 4.39e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.51e+07 |
| W-187 | 6.09e+04 | 4.23e+04 | 1.46e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.49e+06 |
| Pb-210 | 2.69e+11 | 7.23e+10 | 1.21e+10 | 0.00e+00 | 2.20e+11 | 0.00e+00 | 1.18e+07 |
| Bi-210 | 3.42e+06 | 2.20e+07 | 1.96e+06 | 0.00e+00 | 1.71e+08 | 0.00e+00 | 4.33e+07 |
| Pc-210 | 6.88e+09 | 1.32e+10 | 1.64e+09 | 0.00e+00 | 2.80e+10 | 0.00e+00 | 1.47e+08 |
| Ra-223 | 1.15e+12 | 1.68e+09 | 2.31e+11 | 0.00e+00 | 3.06e+10 | 0.00e+00 | 8.97e+09 |
| Ra-224 | 1.36e+11 | 3.07e+08 | 2.72e+10 | 0.00e+00 | 5.60e+09 | 0.00e+00 | 3.60e+09 |
| Ra-225 | 1.78e+12 | 2.01e+09 | 3.54e+11 | 0.00e+00 | 3.66e+10 | 0.00e+00 | 9.98e+09 |
| Ra-226 | 4.08e+13 | 3.13e+09 | 3.38e+13 | 0.00e+00 | 5.73e+10 | 0.00e+00 | 2.26e+10 |
| Ra-228 | 2.82e+13 | 1.69e+09 | 3.18e+13 | 0.00e+00 | 3.09e+10 | 0.00e+00 | 3.83e+09 |
| Ac-225 | 5.85e+05 | 7.51e+05 | 3.92e+04 | 0.00e+00 | 5.51e+04 | 0.00e+00 | 6.51e+06 |
| Ac-227 | 1.84e+08 | 3.15e+07 | 1.15e+07 | 0.00e+00 | 6.40e+06 | 0.00e+00 | 3.49e+06 |
| Th-227 | 2.61e+06 | 4.37e+04 | 7.49e+04 | 0.00e+00 | 1.61e+05 | 0.00e+00 | 1.24e+07 |
| Th-228 | 9.94e+07 | 1.36e+06 | 3.36e+06 | 0.00e+00 | 6.36e+06 | 0.00e+00 | 2.35e+07 |
| Th-229 | 1.04e+09 | 2.60e+07 | 1.73e+07 | 0.00e+00 | 1.25e+08 | 0.00e+00 | 3.33e+06 |
| Th-230 | 1.56e+08 | 7.82e+06 | 4.36e+06 | 0.00e+00 | 3.75e+07 | 0.00e+00 | 2.57e+06 |
| Th-232 | 1.74e+08 | 6.70e+06 | 6.79e+04 | 0.00e+00 | 3.20e+07 | 0.00e+00 | 2.18e+06 |
| Th-234 | 1.70e+04 | 9.26e+02 | 4.91e+02 | 0.00e+00 | 3.41e+03 | 0.00e+00 | 2.92e+06 |
| Pa-231 | 3.11e+08 | 1.03e+07 | 1.24e+07 | 0.00e+00 | 5.51e+07 | 0.00e+00 | 3.06e+06 |
| Pa-233 | 8.05e+02 | 1.58e+02 | 1.41e+02 | 0.00e+00 | 4.32e+02 | 0.00e+00 | 3.78e+05 |
| U-232 | 9.95e+10 | 0.00e+00 | 8.88e+09 | 0.00e+00 | 9.74e+09 | 0.00e+00 | 2.89e+08 |
| U-233 | 2.09e+10 | 0.00e+00 | 1.59e+09 | 0.00e+00 | 4.44e+09 | 0.00e+00 | 2.68e+08 |
| U-234 | 2.01e+10 | 0.00e+00 | 1.56e+09 | 0.00e+00 | 4.36e+09 | 0.00e+00 | 2.62e+08 |
| U-235 | 1.92e+10 | 0.00e+00 | 1.46e+09 | 0.00e+00 | 4.08e+09 | 0.00e+00 | 3.33e+08 |
| U-236 | 1.92e+10 | 0.00e+00 | 1.50e+09 | 0.00e+00 | 4.15e+09 | 0.00e+00 | 2.46e+08 |
| U-237 | 5.39e+05 | 0.00e+00 | 1.44e+05 | 0.00e+00 | 1.34e+06 | 0.00e+00 | 2.30e+07 |
| U-238 | 1.84e+10 | 0.00e+00 | 1.37e+09 | 0.00e+00 | 3.82e+09 | 0.00e+00 | 2.35e+08 |
| Np-237 | 9.87e+07 | 6.54e+06 | 4.32e+06 | 0.00e+00 | 2.61e+07 | 0.00e+00 | 3.39e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**COW'S MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Cow's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 3.49e+02 | 8.78e+00 | 5.40e+00 | 0.00e+00 | 1.92e+01 | 0.00e+00 | 1.17e+05 |
| Np-239 | 3.65e+01 | 3.26e+00 | 1.84e+00 | 0.00e+00 | 6.51e+00 | 0.00e+00 | 9.44e+04 |
| Pu-238 | 2.11e+07 | 2.47e+06 | 5.59e+05 | 0.00e+00 | 1.99e+06 | 0.00e+00 | 1.24e+06 |
| Pu-239 | 2.27e+07 | 2.55e+06 | 5.82e+05 | 0.00e+00 | 2.11e+06 | 0.00e+00 | 1.14e+06 |
| Pu-240 | 2.27e+07 | 2.55e+06 | 5.82e+05 | 0.00e+00 | 2.11e+06 | 0.00e+00 | 1.16e+06 |
| Pu-241 | 6.97e+05 | 2.89e+04 | 1.45e+04 | 0.00e+00 | 5.20e+04 | 0.00e+00 | 2.38e+04 |
| Pu-242 | 2.11e+07 | 2.45e+06 | 5.61e+05 | 0.00e+00 | 2.02e+06 | 0.00e+00 | 1.11e+06 |
| Pu-244 | 2.45e+07 | 2.81e+06 | 6.43e+05 | 0.00e+00 | 2.32e+06 | 0.00e+00 | 1.66e+06 |
| Am-241 | 5.95e+07 | 5.17e+07 | 4.44e+06 | 0.00e+00 | 2.67e+07 | 0.00e+00 | 3.14e+06 |
| Am-242m | 6.21e+07 | 5.02e+07 | 4.65e+06 | 0.00e+00 | 2.73e+07 | 0.00e+00 | 3.98e+06 |
| Am-243 | 5.92e+07 | 5.06e+07 | 4.36e+06 | 0.00e+00 | 2.62e+07 | 0.00e+00 | 3.71e+06 |
| Cm-242 | 5.15e+06 | 4.77e+06 | 3.42e+05 | 0.00e+00 | 9.84e+05 | 0.00e+00 | 3.09e+06 |
| Cm-243 | 5.75e+07 | 4.72e+07 | 3.69e+06 | 0.00e+00 | 1.34e+07 | 0.00e+00 | 3.33e+06 |
| Cm-244 | 4.84e+07 | 3.98e+07 | 3.11e+06 | 0.00e+00 | 1.11e+07 | 0.00e+00 | 3.22e+06 |
| Cm-245 | 7.36e+07 | 5.96e+07 | 4.65e+06 | 0.00e+00 | 1.78e+07 | 0.00e+00 | 3.00e+06 |
| Cm-246 | 7.28e+07 | 5.96e+07 | 4.65e+06 | 0.00e+00 | 1.77e+07 | 0.00e+00 | 2.95e+06 |
| Cm-247 | 7.12e+07 | 5.88e+07 | 4.57e+06 | 0.00e+00 | 1.74e+07 | 0.00e+00 | 3.88e+06 |
| Cm-248 | 5.88e+08 | 4.85e+08 | 3.77e+07 | 0.00e+00 | 1.44e+08 | 0.00e+00 | 6.25e+07 |
| Cf-252 | 4.93e+07 | 0.00e+00 | 1.19e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.21e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 1.85e+02 | 1.85e+02 | 1.85e+02 | 1.85e+02 | 1.85e+02 | 1.85e+02 |
| Be-10 | 8.72e+06 | 1.35e+06 | 2.18e+05 | 0.00e+00 | 1.02e+06 | 0.00e+00 | 7.35e+07 |
| C-14 | 2.41e+08 | 4.83e+07 | 4.83e+07 | 4.83e+07 | 4.83e+07 | 4.83e+07 | 4.83e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Na-22 | 1.39e+09 | 1.39e+09 | 1.39e+09 | 1.39e+09 | 1.39e+09 | 1.39e+09 | 1.39e+09 |
| Na-24 | 1.39e-03 | 1.39e-03 | 1.39e-03 | 1.39e-03 | 1.39e-03 | 1.39e-03 | 1.39e-03 |
| P-32 | 4.66e+09 | 2.90e+08 | 1.80e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.24e+08 |
| Ca-41 | 2.03e+09 | 0.00e+00 | 2.19e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.02e+06 |
| Sc-46 | 1.76e+05 | 3.41e+05 | 9.91e+04 | 0.00e+00 | 3.18e+05 | 0.00e+00 | 1.66e+09 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 7.05e+03 | 4.21e+03 | 1.55e+03 | 9.36e+03 | 1.77e+06 |
| Mn-54 | 0.00e+00 | 9.18e+06 | 1.75e+06 | 0.00e+00 | 2.73e+06 | 0.00e+00 | 2.81e+07 |
| Mn-56 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Fe-55 | 2.93e+08 | 2.03e+08 | 4.72e+07 | 0.00e+00 | 0.00e+00 | 1.13e+08 | 1.16e+08 |
| Fe-59 | 2.66e+08 | 6.24e+08 | 2.39e+08 | 0.00e+00 | 0.00e+00 | 1.74e+08 | 2.08e+09 |
| Co-57 | 0.00e+00 | 5.63e+06 | 9.37e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.43e+08 |
| Co-58 | 0.00e+00 | 1.82e+07 | 4.09e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.70e+08 |
| Co-60 | 0.00e+00 | 7.52e+07 | 1.66e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.41e+09 |
| Ni-59 | 1.42e+08 | 4.87e+07 | 2.37e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.00e+07 |
| Ni-63 | 1.89e+09 | 1.31e+08 | 6.33e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.73e+07 |
| Ni-65 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cu-64 | 0.00e+00 | 2.80e-07 | 1.31e-07 | 0.00e+00 | 7.05e-07 | 0.00e+00 | 2.38e-05 |
| Zn-65 | 3.56e+08 | 1.13e+09 | 5.12e+08 | 0.00e+00 | 7.57e+08 | 0.00e+00 | 7.13e+08 |
| Zn-69 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zn-69m | 1.87e-05 | 4.48e-05 | 4.10e-06 | 0.00e+00 | 2.71e-05 | 0.00e+00 | 2.73e-03 |
| Se-79 | 0.00e+00 | 1.08e+08 | 1.81e+07 | 0.00e+00 | 1.87e+08 | 0.00e+00 | 2.21e+07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.23e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.41e+03 |
| Er-83 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-84 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 4.88e+08 | 2.27e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.61e+07 |
| Rb-87 | 0.00e+00 | 1.05e+09 | 3.64e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.90e+07 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 3.02e+08 | 0.00e+00 | 8.66e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.84e+07 |
| Sr-90 | 1.43e+10 | 0.00e+00 | 2.87e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.59e+08 |
| Sr-91 | 1.58e-10 | 0.00e+00 | 6.39e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.53e-10 |
| Sr-92 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-90 | 1.08e+02 | 0.00e+00 | 2.90e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.15e+06 |
| Y-91 | 1.13e+06 | 0.00e+00 | 3.03e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.23e+08 |
| Y-91m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-92 | 1.69e-39 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.96e-35 |
| Y-93 | 4.87e-12 | 0.00e+00 | 1.35e-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.55e-07 |
| Zr-93 | 3.90e+06 | 2.18e+05 | 1.02e+05 | 0.00e+00 | 8.27e+05 | 0.00e+00 | 2.27e+08 |
| Zr-95 | 1.87e+06 | 6.01e+05 | 4.07e+05 | 0.00e+00 | 9.43e+05 | 0.00e+00 | 1.90e+09 |
| Zr-97 | 2.11e-05 | 4.27e-06 | 1.95e-06 | 0.00e+00 | 6.44e-06 | 0.00e+00 | 1.32e+00 |
| Nb-93m | 1.95e+07 | 6.35e+06 | 1.57e+06 | 0.00e+00 | 7.31e+06 | 0.00e+00 | 2.93e+09 |
| Nb-95 | 2.30e+06 | 1.28e+06 | 6.87e+05 | 0.00e+00 | 1.26e+06 | 0.00e+00 | 7.76e+09 |
| Nb-97 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mo-93 | 0.00e+00 | 1.65e+08 | 4.45e+06 | 0.00e+00 | 4.67e+07 | 0.00e+00 | 2.68e+07 |
| Mo-99 | 0.00e+00 | 1.01e+05 | 1.91e+04 | 0.00e+00 | 2.28e+05 | 0.00e+00 | 2.33e+05 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 1.37e+08 | 2.04e+08 | 5.51e+07 | 0.00e+00 | 2.57e+09 | 1.73e+07 | 6.67e+09 |
| Tc-99m | 4.74e-21 | 1.34e-20 | 1.71e-19 | 0.00e+00 | 2.04e-19 | 6.57e-21 | 7.93e-18 |
| Ru-103 | 1.05e+08 | 0.00e+00 | 4.53e+07 | 0.00e+00 | 4.02e+08 | 0.00e+00 | 1.23e+10 |
| Ru-105 | 6.30e-28 | 0.00e+00 | 2.49e-28 | 0.00e+00 | 8.14e-27 | 0.00e+00 | 3.85e-25 |
| Ru-106 | 2.80e+09 | 0.00e+00 | 3.54e+08 | 0.00e+00 | 5.40e+09 | 0.00e+00 | 1.81e+11 |
| Rh-105 | 3.79e+00 | 2.78e+00 | 1.83e+00 | 0.00e+00 | 1.18e+01 | 0.00e+00 | 4.42e+02 |
| Pd-107 | 0.00e+00 | 1.61e+06 | 1.03e+05 | 0.00e+00 | 1.45e+07 | 0.00e+00 | 9.99e+05 |
| Pd-109 | 0.00e+00 | 1.49e-06 | 3.35e-07 | 0.00e+00 | 8.47e-06 | 0.00e+00 | 1.64e-04 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 6.68e+06 | 6.18e+06 | 3.67e+06 | 0.00e+00 | 1.22e+07 | 0.00e+00 | 2.52e+09 |
| Ag-111 | 1.46e+05 | 6.12e+04 | 3.05e+04 | 0.00e+00 | 1.97e+05 | 0.00e+00 | 1.12e+08 |
| Cd-113m | 0.00e+00 | 4.60e+06 | 1.47e+05 | 0.00e+00 | 5.06e+06 | 0.00e+00 | 3.70e+07 |
| Cd-115m | 0.00e+00 | 1.49e+06 | 4.76e+04 | 0.00e+00 | 1.18e+06 | 0.00e+00 | 6.27e+07 |
| Sr-123 | 5.53e+09 | 9.15e+07 | 1.35e+08 | 7.78e+07 | 0.00e+00 | 0.00e+00 | 1.13e+10 |
| Sr-125 | 1.76e+08 | 3.55e+06 | 7.99e+06 | 2.94e+06 | 0.00e+00 | 0.00e+00 | 2.20e+09 |
| Sr-126 | 1.85e+10 | 3.66e+08 | 5.27e+08 | 1.08e+08 | 0.00e+00 | 0.00e+00 | 5.33e+09 |
| Sb-124 | 1.98e+07 | 3.74e+05 | 7.85e+06 | 4.80e+04 | 0.00e+00 | 1.54e+07 | 5.62e+08 |
| Sb-125 | 1.91e+07 | 2.13e+05 | 4.55e+06 | 1.94e+04 | 0.00e+00 | 1.47e+07 | 2.10e+08 |
| Sb-126 | 1.96e+06 | 3.99e+04 | 7.08e+05 | 1.20e+04 | 0.00e+00 | 1.20e+06 | 1.60e+08 |
| Sb-127 | 1.71e+04 | 3.75e+02 | 6.58e+03 | 2.06e+02 | 0.00e+00 | 1.02e+04 | 3.92e+06 |
| Te-125m | 3.59e+08 | 1.30e+08 | 4.81e+07 | 1.08e+08 | 1.46e+09 | 0.00e+00 | 1.43e+09 |
| Te-127 | 2.21e-10 | 7.94e-11 | 4.78e-11 | 1.64e-10 | 9.01e-10 | 0.00e+00 | 1.74e-08 |
| Te-127m | 1.12e+09 | 3.99e+08 | 1.36e+08 | 2.85e+08 | 4.53e+09 | 0.00e+00 | 3.74e+09 |
| Te-129 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-129m | 1.13e+09 | 4.23e+08 | 1.80e+08 | 3.90e+08 | 4.74e+09 | 0.00e+00 | 5.71e+09 |
| Te-131 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-131m | 4.57e+02 | 2.23e+02 | 1.86e+02 | 3.54e+02 | 2.26e+03 | 0.00e+00 | 2.22e+04 |
| Te-132 | 1.43e+06 | 9.23e+05 | 8.66e+05 | 1.02e+06 | 8.89e+06 | 0.00e+00 | 4.36e+07 |
| Te-133m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-129 | 1.30e+08 | 1.12e+08 | 3.66e+08 | 2.87e+11 | 2.40e+08 | 0.00e+00 | 1.77e+07 |
| I-130 | 2.18e-06 | 6.42e-06 | 2.53e-06 | 5.44e-04 | 1.00e-05 | 0.00e+00 | 5.52e-06 |
| I-131 | 1.08e+07 | 1.54e+07 | 8.82e+06 | 5.04e+09 | 2.64e+07 | 0.00e+00 | 4.06e+06 |
| I-132 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-133 | 3.72e-01 | 6.47e-01 | 1.97e-01 | 9.51e+01 | 1.13e+00 | 0.00e+00 | 5.82e-01 |
| I-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-135 | 4.69e-17 | 1.23e-16 | 4.53e-17 | 8.10e-15 | 1.97e-16 | 0.00e+00 | 1.39e-16 |
| Cs-134 | 6.58e+08 | 1.56e+09 | 1.28e+09 | 0.00e+00 | 5.06e+08 | 1.68e+08 | 2.74e+07 |
| Cs-134m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 2.14e+08 | 1.97e+08 | 8.76e+07 | 0.00e+00 | 7.47e+07 | 2.24e+07 | 4.62e+06 |
| Cs-136 | 1.21e+07 | 4.76e+07 | 3.43e+07 | 0.00e+00 | 2.65e+07 | 3.63e+06 | 5.41e+06 |
| Cs-137 | 8.72e+08 | 1.19e+09 | 7.81e+08 | 0.00e+00 | 4.05e+08 | 1.35e+08 | 2.31e+07 |
| Cs-138 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-140 | 2.88e+07 | 3.61e+04 | 1.88e+06 | 0.00e+00 | 1.23e+04 | 2.07e+04 | 5.92e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 3.75e-02 | 1.89e-02 | 4.99e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.39e+03 |
| La-141 | 3.46e-37 | 1.07e-37 | 1.76e-38 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.28e-32 |
| La-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ce-141 | 1.41e+04 | 9.50e+03 | 1.08e+03 | 0.00e+00 | 4.41e+03 | 0.00e+00 | 3.63e+07 |
| Ce-143 | 2.03e-02 | 1.50e+01 | 1.66e-03 | 0.00e+00 | 6.61e-03 | 0.00e+00 | 5.61e+02 |
| Ce-144 | 1.46e+06 | 6.09e+05 | 7.83e+04 | 0.00e+00 | 3.61e+05 | 0.00e+00 | 4.93e+08 |
| Pr-143 | 2.10e+04 | 8.42e+03 | 1.04e+03 | 0.00e+00 | 4.86e+03 | 0.00e+00 | 9.19e+07 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 7.08e+03 | 8.18e+03 | 4.90e+02 | 0.00e+00 | 4.78e+03 | 0.00e+00 | 3.93e+07 |
| Pm-147 | 9.64e+05 | 9.07e+04 | 3.67e+04 | 0.00e+00 | 1.71e+05 | 0.00e+00 | 1.14e+08 |
| Pm-148 | 1.98e+03 | 3.29e+02 | 1.65e+02 | 0.00e+00 | 6.21e+02 | 0.00e+00 | 2.58e+07 |
| Pm-148m | 2.16e+05 | 5.59e+04 | 4.27e+04 | 0.00e+00 | 8.43e+04 | 0.00e+00 | 4.74e+08 |
| Pm-149 | 5.15e+00 | 7.28e-01 | 2.97e-01 | 0.00e+00 | 1.37e+00 | 0.00e+00 | 1.36e+05 |
| Pm-151 | 5.64e-03 | 9.46e-04 | 4.78e-04 | 0.00e+00 | 1.69e-03 | 0.00e+00 | 2.60e+02 |
| Sm-151 | 9.45e+05 | 1.63e+05 | 3.90e+04 | 0.00e+00 | 1.82e+05 | 0.00e+00 | 7.19e+07 |
| Sm-153 | 1.17e+00 | 9.80e-01 | 7.15e-02 | 0.00e+00 | 3.17e-01 | 0.00e+00 | 3.49e+04 |
| Eu-152 | 2.55e+06 | 5.81e+05 | 5.10e+05 | 0.00e+00 | 3.60e+06 | 0.00e+00 | 3.35e+08 |
| Eu-154 | 8.09e+06 | 9.95e+05 | 7.08e+05 | 0.00e+00 | 4.76e+06 | 0.00e+00 | 7.21e+08 |
| Eu-155 | 1.09e+06 | 1.54e+05 | 9.93e+04 | 0.00e+00 | 7.10e+05 | 0.00e+00 | 1.21e+08 |
| Eu-156 | 3.77e+04 | 2.92e+04 | 4.71e+03 | 0.00e+00 | 1.95e+04 | 0.00e+00 | 2.00e+08 |
| Tb-160 | 3.92e+05 | 0.00e+00 | 4.89e+04 | 0.00e+00 | 1.62e+05 | 0.00e+00 | 3.61e+08 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 3.26e+06 | 1.02e+06 | 7.72e+05 | 0.00e+00 | 1.52e+06 | 0.00e+00 | 3.09e+08 |
| W-181 | 3.02e+04 | 9.84e+03 | 1.05e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.12e+06 |
| W-185 | 1.08e+06 | 3.61e+05 | 3.79e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.17e+07 |
| W-187 | 2.25e-02 | 1.88e-02 | 6.56e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.15e+00 |
| Pb-210 | 1.21e+10 | 3.46e+09 | 4.31e+08 | 0.00e+00 | 9.75e+09 | 0.00e+00 | 1.77e+06 |
| Bi-210 | 2.72e+05 | 1.88e+06 | 1.56e+05 | 0.00e+00 | 2.26e+07 | 0.00e+00 | 2.80e+07 |
| Po-210 | 9.62e+09 | 2.04e+10 | 2.32e+09 | 0.00e+00 | 6.81e+10 | 0.00e+00 | 1.72e+09 |
| Ra-223 | 6.16e+10 | 9.49e+07 | 1.23e+10 | 0.00e+00 | 2.69e+09 | 0.00e+00 | 3.98e+09 |
| Ra-224 | 7.05e+08 | 1.71e+06 | 1.41e+08 | 0.00e+00 | 4.81e+07 | 0.00e+00 | 1.49e+08 |
| Ra-225 | 1.23e+11 | 1.46e+08 | 2.46e+10 | 0.00e+00 | 4.15e+09 | 0.00e+00 | 5.75e+09 |
| Ra-226 | 2.82e+13 | 5.35e+08 | 2.05e+13 | 0.00e+00 | 1.52e+10 | 0.00e+00 | 3.10e+10 |
| Ra-228 | 1.03e+13 | 2.87e+08 | 1.11e+13 | 0.00e+00 | 8.12e+09 | 0.00e+00 | 5.19e+09 |
| Ac-225 | 7.54e+07 | 1.04e+08 | 5.07e+06 | 0.00e+00 | 1.18e+07 | 0.00e+00 | 6.98e+09 |
| Ac-227 | 3.07e+11 | 4.07e+10 | 1.82e+10 | 0.00e+00 | 1.31e+10 | 0.00e+00 | 1.34e+10 |
| Th-227 | 2.02e+06 | 3.66e+04 | 5.83e+04 | 0.00e+00 | 2.08e+05 | 0.00e+00 | 7.97e+07 |
| Th-228 | 2.61e+08 | 4.43e+06 | 8.85e+06 | 0.00e+00 | 2.46e+07 | 0.00e+00 | 2.97e+08 |
| Th-229 | 7.46e+09 | 2.13e+08 | 1.23e+08 | 0.00e+00 | 1.03e+09 | 0.00e+00 | 4.28e+07 |
| Th-230 | 1.13e+09 | 6.42e+07 | 3.13e+07 | 0.00e+00 | 3.10e+08 | 0.00e+00 | 3.30e+07 |
| Th-232 | 1.26e+09 | 5.48e+07 | 8.23e+05 | 0.00e+00 | 2.64e+08 | 0.00e+00 | 2.81e+07 |
| Th-234 | 1.56e+04 | 9.19e+02 | 4.51e+02 | 0.00e+00 | 5.21e+03 | 0.00e+00 | 2.21e+07 |
| Pa-231 | 8.99e+15 | 3.38e+14 | 3.49e+14 | 0.00e+00 | 1.90e+15 | 0.00e+00 | 1.57e+14 |
| Pa-233 | 4.60e+09 | 9.28e+08 | 7.98e+08 | 0.00e+00 | 3.49e+09 | 0.00e+00 | 1.44e+13 |
| U-232 | 3.85e+09 | 0.00e+00 | 2.75e+08 | 0.00e+00 | 4.16e+08 | 0.00e+00 | 6.31e+07 |
| U-233 | 8.12e+08 | 0.00e+00 | 4.92e+07 | 0.00e+00 | 1.89e+08 | 0.00e+00 | 5.85e+07 |
| U-234 | 7.79e+08 | 0.00e+00 | 4.82e+07 | 0.00e+00 | 1.86e+08 | 0.00e+00 | 5.72e+07 |
| U-235 | 7.47e+08 | 0.00e+00 | 4.53e+07 | 0.00e+00 | 1.74e+08 | 0.00e+00 | 7.28e+07 |
| U-236 | 7.47e+08 | 0.00e+00 | 4.62e+07 | 0.00e+00 | 1.78e+08 | 0.00e+00 | 5.37e+07 |
| U-237 | 2.15e+03 | 0.00e+00 | 5.72e+02 | 0.00e+00 | 8.83e+03 | 0.00e+00 | 7.55e+05 |
| U-238 | 7.15e+08 | 0.00e+00 | 4.23e+07 | 0.00e+00 | 1.63e+08 | 0.00e+00 | 5.13e+07 |
| Np-237 | 6.91e+08 | 4.91e+07 | 3.04e+07 | 0.00e+00 | 2.26e+08 | 0.00e+00 | 4.35e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.43e+00 | 3.85e-02 | 2.22e-02 | 0.00e+00 | 1.30e-01 | 0.00e+00 | 3.58e+03 |
| Np-239 | 2.61e-01 | 2.57e-02 | 1.41e-02 | 0.00e+00 | 8.00e-02 | 0.00e+00 | 5.26e+03 |
| Pu-238 | 2.42e+07 | 3.06e+06 | 6.56e+05 | 0.00e+00 | 2.81e+06 | 0.00e+00 | 2.80e+06 |
| Pu-239 | 2.78e+07 | 3.34e+06 | 7.33e+05 | 0.00e+00 | 3.11e+06 | 0.00e+00 | 2.56e+06 |
| Pu-240 | 2.78e+07 | 3.34e+06 | 7.33e+05 | 0.00e+00 | 3.11e+06 | 0.00e+00 | 2.60e+06 |
| Pu-241 | 6.00e+05 | 2.85e+04 | 1.27e+04 | 0.00e+00 | 5.84e+04 | 0.00e+00 | 5.35e+04 |
| Pu-242 | 2.58e+07 | 3.22e+06 | 7.06e+05 | 0.00e+00 | 3.00e+06 | 0.00e+00 | 2.51e+06 |
| Pu-244 | 3.01e+07 | 3.69e+06 | 8.10e+05 | 0.00e+00 | 3.44e+06 | 0.00e+00 | 3.74e+06 |
| Am-241 | 4.07e+08 | 3.80e+08 | 2.92e+07 | 0.00e+00 | 2.19e+08 | 0.00e+00 | 4.00e+07 |
| Am-242m | 4.17e+08 | 3.63e+08 | 2.98e+07 | 0.00e+00 | 2.22e+08 | 0.00e+00 | 5.12e+07 |
| Am-243 | 4.14e+08 | 3.78e+08 | 2.91e+07 | 0.00e+00 | 2.19e+08 | 0.00e+00 | 4.77e+07 |
| Cm-242 | 9.56e+06 | 1.02e+07 | 6.36e+05 | 0.00e+00 | 2.89e+06 | 0.00e+00 | 3.67e+07 |
| Cm-243 | 3.28e+08 | 3.00e+08 | 2.05e+07 | 0.00e+00 | 9.57e+07 | 0.00e+00 | 4.27e+07 |
| Cm-244 | 2.49e+08 | 2.33e+08 | 1.57e+07 | 0.00e+00 | 7.32e+07 | 0.00e+00 | 4.12e+07 |
| Cm-245 | 5.14e+08 | 4.48e+08 | 3.16e+07 | 0.00e+00 | 1.48e+08 | 0.00e+00 | 3.86e+07 |
| Cm-246 | 5.10e+08 | 4.48e+08 | 3.15e+07 | 0.00e+00 | 1.47e+08 | 0.00e+00 | 3.79e+07 |
| Cm-247 | 4.97e+08 | 4.41e+08 | 3.11e+07 | 0.00e+00 | 1.45e+08 | 0.00e+00 | 4.99e+07 |
| Cm-248 | 4.14e+09 | 3.64e+09 | 2.56e+08 | 0.00e+00 | 1.20e+09 | 0.00e+00 | 8.06e+08 |
| Cf-252 | 1.39e+08 | 0.00e+00 | 3.34e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.53e+08 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 1.10e+02 | 1.10e+02 | 1.10e+02 | 1.10e+02 | 1.10e+02 | 1.10e+02 |
| Be-10 | 7.26e+06 | 1.12e+06 | 1.83e+05 | 0.00e+00 | 8.59e+05 | 0.00e+00 | 4.60e+07 |
| C-14 | 2.04e+08 | 4.08e+07 | 4.08e+07 | 4.08e+07 | 4.08e+07 | 4.08e+07 | 4.08e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Na-22 | 1.10e+09 | 1.10e+09 | 1.10e+09 | 1.10e+09 | 1.10e+09 | 1.10e+09 | 1.10e+09 |
| Na-24 | 1.11e-03 | 1.11e-03 | 1.11e-03 | 1.11e-03 | 1.11e-03 | 1.11e-03 | 1.11e-03 |
| P-32 | 3.94e+09 | 2.44e+08 | 1.53e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.31e+08 |
| Ca-41 | 1.28e+09 | 0.00e+00 | 1.38e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.26e+06 |
| Sc-46 | 1.36e+05 | 2.65e+05 | 7.87e+04 | 0.00e+00 | 2.54e+05 | 0.00e+00 | 9.04e+08 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 5.64e+03 | 3.13e+03 | 1.24e+03 | 8.05e+03 | 9.48e+05 |
| Mn-54 | 0.00e+00 | 7.00e+06 | 1.39e+06 | 0.00e+00 | 2.09e+06 | 0.00e+00 | 1.44e+07 |
| Mn-56 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Fe-55 | 2.38e+08 | 1.69e+08 | 3.94e+07 | 0.00e+00 | 0.00e+00 | 1.07e+08 | 7.31e+07 |
| Fe-59 | 2.12e+08 | 4.95e+08 | 1.91e+08 | 0.00e+00 | 0.00e+00 | 1.56e+08 | 1.17e+09 |
| Co-57 | 0.00e+00 | 4.53e+06 | 7.59e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.45e+07 |
| Co-58 | 0.00e+00 | 1.41e+07 | 3.24e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.94e+08 |
| Co-60 | 0.00e+00 | 5.83e+07 | 1.31e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.60e+08 |
| Ni-59 | 1.13e+08 | 4.00e+07 | 1.92e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.28e+06 |
| Ni-63 | 1.52e+09 | 1.07e+08 | 5.15e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.71e+07 |
| Ni-65 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cu-64 | 0.00e+00 | 2.28e-07 | 1.07e-07 | 0.00e+00 | 5.77e-07 | 0.00e+00 | 1.77e-05 |
| Zn-65 | 2.50e+08 | 8.69e+08 | 4.05e+08 | 0.00e+00 | 5.56e+08 | 0.00e+00 | 3.68e+08 |
| Zn-69 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zn-69m | 1.56e-05 | 3.67e-05 | 3.37e-06 | 0.00e+00 | 2.23e-05 | 0.00e+00 | 2.02e-03 |
| Se-79 | 0.00e+00 | 9.07e+07 | 1.52e+07 | 0.00e+00 | 1.58e+08 | 0.00e+00 | 1.39e+07 |
| Er-82 | 0.00e+00 | 0.00e+00 | 9.76e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-83 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-84 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 4.07e+08 | 1.91e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.02e+07 |
| Rb-87 | 0.00e+00 | 8.79e+08 | 3.07e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.07e+07 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 2.55e+08 | 0.00e+00 | 7.29e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.03e+07 |
| Sr-90 | 9.89e+09 | 0.00e+00 | 1.98e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.26e+08 |
| Sr-91 | 1.33e-10 | 0.00e+00 | 5.29e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.03e-10 |
| Sr-92 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-90 | 9.11e+01 | 0.00e+00 | 2.45e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.52e+05 |
| Y-91 | 9.54e+05 | 0.00e+00 | 2.56e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.91e+08 |
| Y-91m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-92 | 1.43e-39 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.93e-35 |
| Y-93 | 4.11e-12 | 0.00e+00 | 1.13e-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.26e-07 |
| Zr-93 | 3.05e+06 | 1.50e+05 | 8.21e+04 | 0.00e+00 | 5.32e+05 | 0.00e+00 | 1.42e+08 |
| Zr-95 | 1.50e+06 | 4.73e+05 | 3.25e+05 | 0.00e+00 | 6.95e+05 | 0.00e+00 | 1.09e+09 |
| Zr-97 | 1.76e-05 | 3.49e-06 | 1.61e-06 | 0.00e+00 | 5.29e-06 | 0.00e+00 | 9.44e-01 |
| Nb-93m | 1.55e+07 | 5.10e+06 | 1.28e+06 | 0.00e+00 | 5.96e+06 | 0.00e+00 | 1.84e+09 |
| Nb-95 | 1.79e+06 | 9.96e+05 | 5.48e+05 | 0.00e+00 | 9.65e+05 | 0.00e+00 | 4.26e+09 |
| Nb-97 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mo-93 | 0.00e+00 | 1.37e+08 | 3.76e+06 | 0.00e+00 | 3.94e+07 | 0.00e+00 | 1.67e+07 |
| Mo-99 | 0.00e+00 | 8.31e+04 | 1.59e+04 | 0.00e+00 | 1.90e+05 | 0.00e+00 | 1.49e+05 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 1.16e+08 | 1.70e+08 | 4.65e+07 | 0.00e+00 | 2.16e+09 | 1.76e+07 | 4.17e+09 |
| Tc-99m | 3.77e-21 | 1.05e-20 | 1.36e-19 | 0.00e+00 | 1.57e-19 | 5.83e-21 | 6.90e-18 |
| Ru-103 | 8.57e+07 | 0.00e+00 | 3.66e+07 | 0.00e+00 | 3.02e+08 | 0.00e+00 | 7.16e+09 |
| Ru-105 | 5.27e-28 | 0.00e+00 | 2.04e-28 | 0.00e+00 | 6.65e-27 | 0.00e+00 | 4.25e-25 |
| Ru-106 | 2.36e+09 | 0.00e+00 | 2.97e+08 | 0.00e+00 | 4.55e+09 | 0.00e+00 | 1.13e+11 |
| Rh-105 | 3.21e+00 | 2.32e+00 | 1.52e+00 | 0.00e+00 | 9.84e+00 | 0.00e+00 | 2.95e+02 |
| Pd-107 | 0.00e+00 | 1.35e+06 | 8.69e+04 | 0.00e+00 | 1.22e+07 | 0.00e+00 | 6.26e+06 |
| Pd-109 | 0.00e+00 | 1.24e-06 | 2.83e-07 | 0.00e+00 | 7.19e-06 | 0.00e+00 | 1.25e-04 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 5.06e+06 | 4.79e+06 | 2.91e+06 | 0.00e+00 | 9.13e+06 | 0.00e+00 | 1.34e+09 |
| Ag-111 | 1.23e+05 | 5.12e+04 | 2.57e+04 | 0.00e+00 | 1.67e+05 | 0.00e+00 | 7.14e+07 |
| Cd-113m | 0.00e+00 | 3.85e+06 | 1.24e+05 | 0.00e+00 | 4.26e+06 | 0.00e+00 | 2.32e+07 |
| Cd-115m | 0.00e+00 | 1.25e+06 | 4.02e+04 | 0.00e+00 | 9.96e+05 | 0.00e+00 | 3.94e+07 |
| Sn-123 | 4.66e+09 | 7.66e+07 | 1.13e+08 | 6.13e+07 | 0.00e+00 | 0.00e+00 | 7.05e+09 |
| Sn-125 | 1.49e+08 | 2.96e+06 | 6.71e+06 | 2.32e+06 | 0.00e+00 | 0.00e+00 | 1.40e+09 |
| Sr-126 | 1.50e+10 | 2.80e+08 | 4.28e+08 | 7.38e+07 | 0.00e+00 | 0.00e+00 | 3.34e+09 |
| Sb-124 | 1.62e+07 | 2.98e+05 | 6.31e+06 | 3.67e+04 | 0.00e+00 | 1.41e+07 | 3.26e+08 |
| Sb-125 | 1.56e+07 | 1.71e+05 | 3.66e+06 | 1.49e+04 | 0.00e+00 | 1.37e+07 | 1.22e+08 |
| Sb-126 | 1.60e+06 | 3.28e+04 | 5.76e+05 | 9.07e+03 | 0.00e+00 | 1.15e+06 | 9.49e+07 |
| Sb-127 | 1.43e+04 | 3.05e+02 | 5.38e+03 | 1.60e+02 | 0.00e+00 | 9.70e+03 | 2.42e+06 |
| Te-125m | 3.03e+08 | 1.09e+08 | 4.05e+07 | 8.47e+07 | 0.00e+00 | 0.00e+00 | 8.94e+08 |
| Te-127 | 1.88e-10 | 6.65e-11 | 4.04e-11 | 1.29e-10 | 7.60e-10 | 0.00e+00 | 1.45e-08 |
| Te-127m | 9.42e+08 | 3.34e+08 | 1.12e+08 | 2.24e+08 | 3.82e+09 | 0.00e+00 | 2.35e+09 |
| Te-129 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-129m | 9.50e+08 | 3.53e+08 | 1.50e+08 | 3.07e+08 | 3.98e+09 | 0.00e+00 | 3.57e+09 |
| Te-131 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-131m | 3.81e+02 | 1.83e+02 | 1.52e+02 | 2.75e+02 | 1.90e+03 | 0.00e+00 | 1.47e+04 |
| Te-132 | 1.17e+06 | 7.39e+05 | 6.96e+05 | 7.79e+05 | 7.09e+06 | 0.00e+00 | 2.34e+07 |
| Te-133m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-129 | 1.09e+08 | 9.21e+07 | 1.54e+08 | 1.12e+11 | 1.65e+08 | 0.00e+00 | 1.07e+07 |
| I-130 | 1.75e-06 | 5.07e-06 | 2.02e-06 | 4.13e-04 | 7.80e-06 | 0.00e+00 | 3.89e-06 |
| I-131 | 8.94e+06 | 1.25e+07 | 6.72e+06 | 3.65e+09 | 2.15e+07 | 0.00e+00 | 2.48e+06 |
| I-132 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-133 | 3.11e-01 | 5.28e-01 | 1.61e-01 | 7.37e+01 | 9.26e-01 | 0.00e+00 | 3.99e-01 |
| I-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-135 | 3.82e-17 | 9.82e-17 | 3.64e-17 | 6.32e-15 | 1.55e-16 | 0.00e+00 | 1.09e-16 |
| Cs-134 | 5.23e+08 | 1.23e+09 | 5.71e+08 | 0.00e+00 | 3.91e+08 | 1.49e+08 | 1.53e+07 |
| Cs-134m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.80e+08 | 1.65e+08 | 3.86e+07 | 0.00e+00 | 6.31e+07 | 2.28e+07 | 2.89e+06 |
| Cs-136 | 9.41e+06 | 3.70e+07 | 2.49e+07 | 0.00e+00 | 2.02e+07 | 3.18e+06 | 2.98e+06 |
| Cs-137 | 7.24e+08 | 9.63e+08 | 3.36e+08 | 0.00e+00 | 3.28e+08 | 1.27e+08 | 1.37e+07 |
| Cs-138 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-140 | 2.38e+07 | 2.91e+04 | 1.53e+06 | 0.00e+00 | 9.88e+03 | 1.96e+04 | 3.67e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 3.08e-02 | 1.51e-02 | 4.03e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.69e+02 |
| La-141 | 2.92e-37 | 8.97e-38 | 1.48e-38 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.59e-32 |
| La-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ce-141 | 1.18e+04 | 7.88e+03 | 9.05e+02 | 0.00e+00 | 3.71e+03 | 0.00e+00 | 2.25e+07 |
| Ce-143 | 1.71e-02 | 1.24e+01 | 1.39e-03 | 0.00e+00 | 5.58e-03 | 0.00e+00 | 3.74e+02 |
| Ce-144 | 1.23e+06 | 5.08e+05 | 6.60e+04 | 0.00e+00 | 3.04e+05 | 0.00e+00 | 3.09e+08 |
| Pr-143 | 1.77e+04 | 7.05e+03 | 8.79e+02 | 0.00e+00 | 4.10e+03 | 0.00e+00 | 5.81e+07 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 6.24e+03 | 6.78e+03 | 4.06e+02 | 0.00e+00 | 3.98e+03 | 0.00e+00 | 2.45e+07 |
| Pm-147 | 7.93e+05 | 7.53e+04 | 3.07e+04 | 0.00e+00 | 1.44e+05 | 0.00e+00 | 7.16e+07 |
| Pm-148 | 1.66e+03 | 2.71e+02 | 1.36e+02 | 0.00e+00 | 4.89e+02 | 0.00e+00 | 1.62e+07 |
| Pm-148m | 1.72e+05 | 4.36e+04 | 3.41e+04 | 0.00e+00 | 6.60e+04 | 0.00e+00 | 2.74e+08 |
| Pm-149 | 4.34e+00 | 6.10e-01 | 2.50e-01 | 0.00e+00 | 1.16e+00 | 0.00e+00 | 8.98e+04 |
| Pm-151 | 4.72e-03 | 7.79e-04 | 3.94e-04 | 0.00e+00 | 1.40e-03 | 0.00e+00 | 1.75e+02 |
| Sm-151 | 7.07e+05 | 1.36e+05 | 3.19e+04 | 0.00e+00 | 1.49e+05 | 0.00e+00 | 4.61e+07 |
| Sm-153 | 9.88e-01 | 8.18e-01 | 6.02e-02 | 0.00e+00 | 2.67e-01 | 0.00e+00 | 2.31e+04 |
| Eu-152 | 1.89e+06 | 4.56e+05 | 4.02e+05 | 0.00e+00 | 2.12e+06 | 0.00e+00 | 1.68e+08 |
| Eu-154 | 6.15e+06 | 7.93e+05 | 5.59e+05 | 0.00e+00 | 3.55e+06 | 0.00e+00 | 4.19e+08 |
| Eu-155 | 1.30e+06 | 1.25e+05 | 7.76e+04 | 0.00e+00 | 4.90e+05 | 0.00e+00 | 7.18e+08 |
| Eu-156 | 3.12e+04 | 2.34e+04 | 3.82e+03 | 0.00e+00 | 1.58e+04 | 0.00e+00 | 1.20e+08 |
| Tb-160 | 3.19e+05 | 0.00e+00 | 3.98e+04 | 0.00e+00 | 1.26e+05 | 0.00e+00 | 2.06e+08 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 2.55e+06 | 7.84e+05 | 5.68e+05 | 0.00e+00 | 1.15e+06 | 0.00e+00 | 1.93e+08 |
| W-181 | 2.56e+04 | 8.25e+03 | 8.62e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.02e+05 |
| W-185 | 9.14e+05 | 3.01e+05 | 3.19e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.60e+07 |
| W-187 | 1.88e-02 | 1.53e-02 | 5.37e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.15e+00 |
| Pb-210 | 8.47e+09 | 2.55e+09 | 3.28e+08 | 0.00e+00 | 8.05e+09 | 0.00e+00 | 1.11e+06 |
| Bi-210 | 2.30e+05 | 1.57e+06 | 1.32e+05 | 0.00e+00 | 1.91e+07 | 0.00e+00 | 1.80e+07 |
| Po-210 | 8.13e+09 | 1.71e+10 | 1.96e+09 | 0.00e+00 | 5.75e+10 | 0.00e+00 | 1.08e+09 |
| Ra-223 | 5.21e+10 | 7.92e+07 | 1.04e+10 | 0.00e+00 | 2.27e+09 | 0.00e+00 | 2.51e+09 |
| Ra-224 | 5.97e+08 | 1.43e+06 | 1.19e+08 | 0.00e+00 | 4.09e+07 | 0.00e+00 | 9.59e+07 |
| Ra-225 | 1.04e+11 | 1.22e+08 | 2.08e+10 | 0.00e+00 | 3.50e+09 | 0.00e+00 | 3.63e+09 |
| Ra-226 | 1.77e+13 | 4.48e+08 | 1.32e+13 | 0.00e+00 | 1.28e+10 | 0.00e+00 | 1.93e+10 |
| Ra-228 | 7.45e+12 | 2.40e+08 | 8.21e+12 | 0.00e+00 | 6.85e+09 | 0.00e+00 | 3.25e+09 |
| Ac-225 | 6.37e+07 | 8.70e+07 | 4.27e+06 | 0.00e+00 | 9.98e+06 | 0.00e+00 | 4.42e+09 |
| Ac-227 | 1.99e+11 | 2.94e+10 | 1.18e+10 | 0.00e+00 | 8.54e+09 | 0.00e+00 | 8.41e+09 |
| Th-227 | 1.71e+06 | 3.07e+04 | 4.93e+04 | 0.00e+00 | 1.75e+05 | 0.00e+00 | 5.01e+07 |
| Th-228 | 2.12e+08 | 3.55e+06 | 7.16e+06 | 0.00e+00 | 2.00e+07 | 0.00e+00 | 1.86e+08 |
| Th-229 | 4.63e+09 | 1.33e+08 | 7.68e+07 | 0.00e+00 | 6.45e+08 | 0.00e+00 | 2.68e+07 |
| Th-230 | 7.00e+08 | 3.99e+07 | 1.94e+07 | 0.00e+00 | 1.94e+08 | 0.00e+00 | 2.07e+07 |
| Th-232 | 7.84e+08 | 3.40e+07 | 5.28e+05 | 0.00e+00 | 1.66e+08 | 0.00e+00 | 1.76e+07 |
| Th-234 | 1.31e+04 | 7.70e+02 | 3.82e+02 | 0.00e+00 | 4.39e+03 | 0.00e+00 | 1.40e+07 |
| Pa-231 | 5.59e+15 | 2.10e+14 | 2.18e+14 | 0.00e+00 | 1.18e+15 | 0.00e+00 | 9.85e+13 |
| Pa-233 | 3.79e+09 | 7.29e+08 | 6.52e+08 | 0.00e+00 | 2.75e+09 | 0.00e+00 | 8.33e+12 |
| U-232 | 3.24e+09 | 0.00e+00 | 2.32e+08 | 0.00e+00 | 3.51e+08 | 0.00e+00 | 3.96e+07 |
| U-233 | 6.83e+08 | 0.00e+00 | 4.15e+07 | 0.00e+00 | 1.60e+08 | 0.00e+00 | 3.66e+07 |
| U-234 | 6.56e+08 | 0.00e+00 | 4.07e+07 | 0.00e+00 | 1.57e+08 | 0.00e+00 | 3.59e+07 |
| U-235 | 6.28e+08 | 0.00e+00 | 3.82e+07 | 0.00e+00 | 1.47e+08 | 0.00e+00 | 4.56e+07 |
| U-236 | 6.28e+08 | 0.00e+00 | 3.91e+07 | 0.00e+00 | 1.50e+08 | 0.00e+00 | 3.37e+07 |
| U-237 | 1.81e+03 | 0.00e+00 | 4.83e+02 | 0.00e+00 | 7.45e+03 | 0.00e+00 | 4.80e+05 |
| U-238 | 6.01e+08 | 0.00e+00 | 3.58e+07 | 0.00e+00 | 1.38e+08 | 0.00e+00 | 3.21e+07 |
| Np-237 | 4.31e+08 | 3.10e+07 | 1.90e+07 | 0.00e+00 | 1.40e+08 | 0.00e+00 | 2.73e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.20e+00 | 3.22e-02 | 1.87e-02 | 0.00e+00 | 1.10e-01 | 0.00e+00 | 2.36e+03 |
| Np-239 | 2.28e-01 | 2.15e-02 | 1.19e-02 | 0.00e+00 | 6.75e-02 | 0.00e+00 | 3.46e+03 |
| Pu-238 | 1.52e+07 | 1.94e+06 | 4.13e+05 | 0.00e+00 | 1.77e+06 | 0.00e+00 | 1.75e+06 |
| Pu-239 | 1.74e+07 | 2.11e+06 | 4.56e+05 | 0.00e+00 | 1.94e+06 | 0.00e+00 | 1.60e+06 |
| Pu-240 | 1.73e+07 | 2.10e+06 | 4.56e+05 | 0.00e+00 | 1.94e+06 | 0.00e+00 | 1.63e+06 |
| Pu-241 | 3.95e+05 | 1.90e+04 | 8.33e+03 | 0.00e+00 | 3.86e+04 | 0.00e+00 | 3.34e+04 |
| Pu-242 | 1.61e+07 | 2.03e+06 | 4.40e+05 | 0.00e+00 | 1.87e+06 | 0.00e+00 | 1.57e+06 |
| Pu-244 | 1.88e+07 | 2.31e+06 | 5.04e+05 | 0.00e+00 | 2.14e+06 | 0.00e+00 | 2.34e+06 |
| Am-241 | 2.54e+08 | 2.40e+08 | 1.83e+07 | 0.00e+00 | 1.37e+08 | 0.00e+00 | 2.51e+07 |
| Am-242m | 2.61e+08 | 2.30e+08 | 1.88e+07 | 0.00e+00 | 1.39e+08 | 0.00e+00 | 3.21e+07 |
| Am-243 | 2.58e+08 | 2.38e+08 | 1.82e+07 | 0.00e+00 | 1.37e+08 | 0.00e+00 | 2.99e+07 |
| Cm-242 | 8.06e+06 | 8.50e+06 | 5.35e+05 | 0.00e+00 | 2.44e+06 | 0.00e+00 | 2.30e+07 |
| Cm-243 | 2.10e+08 | 1.95e+08 | 1.32e+07 | 0.00e+00 | 6.17e+07 | 0.00e+00 | 2.68e+07 |
| Cm-244 | 1.63e+08 | 1.54e+08 | 1.03e+07 | 0.00e+00 | 4.81e+07 | 0.00e+00 | 2.58e+07 |
| Cm-245 | 3.21e+08 | 2.82e+08 | 1.98e+07 | 0.00e+00 | 9.24e+07 | 0.00e+00 | 2.42e+07 |
| Cm-246 | 3.18e+08 | 2.82e+08 | 1.97e+07 | 0.00e+00 | 9.20e+07 | 0.00e+00 | 2.38e+07 |
| Cm-247 | 3.10e+08 | 2.78e+08 | 1.94e+07 | 0.00e+00 | 9.07e+07 | 0.00e+00 | 3.12e+07 |
| Cm-248 | 2.58e+09 | 2.29e+09 | 1.60e+08 | 0.00e+00 | 7.49e+08 | 0.00e+00 | 5.02e+08 |
| Cf-252 | 1.09e+08 | 0.00e+00 | 2.63e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.58e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 1.34e+02 | 1.34e+02 | 1.34e+02 | 1.34e+02 | 1.34e+02 | 1.34e+02 |
| Be-10 | 1.38e+07 | 1.60e+06 | 3.46e+05 | 0.00e+00 | 1.13e+06 | 0.00e+00 | 2.81e+07 |
| C-14 | 3.83e+08 | 7.67e+07 | 7.67e+07 | 7.67e+07 | 7.67e+07 | 7.67e+07 | 7.67e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Na-22 | 1.75e+09 | 1.75e+09 | 1.75e+09 | 1.75e+09 | 1.75e+09 | 1.75e+09 | 1.75e+09 |
| Na-24 | 1.77e-03 | 1.77e-03 | 1.77e-03 | 1.77e-03 | 1.77e-03 | 1.77e-03 | 1.77e-03 |
| P-32 | 7.43e+09 | 3.47e+08 | 2.86e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.05e+08 |
| Ca-41 | 1.42e+09 | 0.00e+00 | 1.55e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.77e+05 |
| Sc-46 | 2.34e+05 | 3.21e+05 | 1.24e+05 | 0.00e+00 | 2.84e+05 | 0.00e+00 | 4.69e+08 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 8.79e+03 | 4.88e+03 | 1.33e+03 | 8.91e+03 | 4.66e+05 |
| Mn-54 | 0.00e+00 | 8.01e+06 | 2.13e+06 | 0.00e+00 | 2.25e+06 | 0.00e+00 | 6.72e+06 |
| Mn-56 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Fe-55 | 4.57e+08 | 2.42e+08 | 7.51e+07 | 0.00e+00 | 0.00e+00 | 1.37e+08 | 4.49e+07 |
| Fe-59 | 3.76e+08 | 6.09e+08 | 3.03e+08 | 0.00e+00 | 0.00e+00 | 1.77e+08 | 6.34e+08 |
| Co-57 | 0.00e+00 | 5.92e+06 | 1.20e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.85e+07 |
| Co-58 | 0.00e+00 | 1.64e+07 | 5.03e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.58e+07 |
| Co-60 | 0.00e+00 | 6.93e+07 | 2.04e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.84e+08 |
| Ni-59 | 2.18e+08 | 5.80e+07 | 3.69e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.85e+06 |
| Ni-63 | 2.91e+09 | 1.56e+08 | 9.91e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.05e+07 |
| Ni-65 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cu-64 | 0.00e+00 | 3.07e-07 | 1.85e-07 | 0.00e+00 | 7.41e-07 | 0.00e+00 | 1.44e-05 |
| Zn-65 | 3.75e+08 | 1.00e+09 | 6.22e+08 | 0.00e+00 | 6.30e+08 | 0.00e+00 | 1.76e+08 |
| Zn-69 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zn-69m | 2.91e-05 | 4.95e-05 | 5.85e-06 | 0.00e+00 | 2.88e-05 | 0.00e+00 | 1.61e-03 |
| Se-79 | 0.00e+00 | 1.29e+08 | 2.87e+07 | 0.00e+00 | 2.10e+08 | 0.00e+00 | 8.48e+06 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.53e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-83 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-84 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 5.77e+08 | 3.55e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.71e+07 |
| Rb-87 | 0.00e+00 | 1.25e+09 | 5.80e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.88e+07 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 4.82e+08 | 0.00e+00 | 1.38e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.87e+07 |
| Sr-90 | 1.57e+10 | 0.00e+00 | 3.15e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.40e+08 |
| Sr-91 | 2.50e-10 | 0.00e+00 | 9.42e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.51e-10 |
| Sr-92 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-90 | 1.72e+02 | 0.00e+00 | 4.61e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.91e+05 |
| Y-91 | 1.80e+06 | 0.00e+00 | 4.82e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.40e+08 |
| Y-91m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-92 | 2.69e-39 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.76e-35 |
| Y-93 | 7.73e-12 | 0.00e+00 | 2.12e-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.15e-07 |
| Zr-93 | 5.80e+06 | 2.17e+05 | 1.55e+05 | 0.00e+00 | 8.41e+05 | 0.00e+00 | 8.24e+07 |
| Zr-95 | 2.66e+06 | 5.86e+05 | 5.21e+05 | 0.00e+00 | 8.38e+05 | 0.00e+00 | 6.11e+08 |
| Zr-97 | 3.28e-05 | 4.74e-06 | 2.80e-06 | 0.00e+00 | 6.80e-06 | 0.00e+00 | 7.18e-01 |
| Nb-93m | 2.99e+07 | 7.46e+06 | 2.45e+06 | 0.00e+00 | 8.05e+06 | 0.00e+00 | 1.12e+09 |
| Nb-95 | 3.10e+06 | 1.21e+06 | 8.62e+05 | 0.00e+00 | 1.13e+06 | 0.00e+00 | 2.23e+09 |
| Nb-97 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mo-93 | 0.00e+00 | 1.97e+08 | 7.07e+06 | 0.00e+00 | 5.19e+07 | 0.00e+00 | 9.98e+06 |
| Mo-99 | 0.00e+00 | 1.16e+05 | 2.86e+04 | 0.00e+00 | 2.47e+05 | 0.00e+00 | 9.57e+04 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 2.19e+08 | 2.44e+08 | 8.75e+07 | 0.00e+00 | 2.87e+09 | 2.15e+07 | 2.56e+09 |
| Tc-99m | 6.61e-21 | 1.30e-20 | 2.15e-19 | 0.00e+00 | 1.88e-19 | 6.58e-21 | 7.37e-18 |
| Ru-103 | 1.55e+08 | 0.00e+00 | 5.96e+07 | 0.00e+00 | 3.90e+08 | 0.00e+00 | 4.01e+09 |
| Ru-105 | 9.83e-28 | 0.00e+00 | 3.57e-28 | 0.00e+00 | 8.64e-27 | 0.00e+00 | 6.42e-25 |
| Ru-106 | 4.44e+09 | 0.00e+00 | 5.54e+08 | 0.00e+00 | 5.99e+09 | 0.00e+00 | 6.90e+10 |
| Rh-105 | 6.01e+00 | 3.23e+00 | 2.76e+00 | 0.00e+00 | 1.29e+01 | 0.00e+00 | 2.00e+02 |
| Pd-107 | 0.00e+00 | 1.93e+06 | 1.64e+05 | 0.00e+00 | 1.61e+07 | 0.00e+00 | 3.83e+06 |
| Pd-109 | 0.00e+00 | 1.77e-06 | 5.32e-07 | 0.00e+00 | 9.51e-06 | 0.00e+00 | 1.05e-04 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 8.39e+06 | 5.67e+06 | 4.53e+06 | 0.00e+00 | 1.06e+07 | 0.00e+00 | 6.74e+08 |
| Ag-111 | 2.33e+05 | 7.28e+04 | 4.81e+04 | 0.00e+00 | 2.20e+05 | 0.00e+00 | 4.46e+07 |
| Cd-113m | 0.00e+00 | 5.50e+06 | 2.34e+05 | 0.00e+00 | 5.66e+06 | 0.00e+00 | 1.42e+07 |
| Cd-115m | 0.00e+00 | 1.78e+06 | 7.58e+04 | 0.00e+00 | 1.32e+06 | 0.00e+00 | 2.42e+07 |
| Sr-123 | 8.81e+09 | 1.09e+08 | 2.15e+08 | 1.16e+08 | 0.00e+00 | 0.00e+00 | 4.32e+09 |
| Sr-125 | 2.80e+08 | 4.22e+06 | 1.25e+07 | 4.37e+06 | 0.00e+00 | 0.00e+00 | 8.67e+08 |
| Sr-126 | 2.72e+10 | 3.39e+08 | 7.74e+08 | 9.32e+07 | 0.00e+00 | 0.00e+00 | 2.04e+09 |
| Sb-124 | 2.92e+07 | 3.79e+05 | 1.02e+07 | 6.46e+04 | 0.00e+00 | 1.62e+07 | 1.83e+08 |
| Sb-125 | 2.85e+07 | 2.20e+05 | 5.97e+06 | 2.64e+04 | 0.00e+00 | 1.59e+07 | 6.80e+07 |
| Sb-126 | 2.80e+06 | 4.28e+04 | 1.01e+06 | 1.64e+04 | 0.00e+00 | 1.34e+06 | 5.64e+07 |
| Sb-127 | 2.63e+04 | 4.06e+02 | 9.11e+03 | 2.92e+02 | 0.00e+00 | 1.14e+04 | 1.48e+06 |
| Te-125m | 5.69e+08 | 1.54e+08 | 7.59e+07 | 1.60e+08 | 0.00e+00 | 0.00e+00 | 5.49e+08 |
| Te-127 | 3.53e-10 | 9.51e-11 | 7.57e-11 | 2.44e-10 | 1.00e-09 | 0.00e+00 | 1.38e-08 |
| Te-127m | 1.77e+09 | 4.78e+08 | 2.11e+08 | 4.24e+08 | 5.06e+09 | 0.00e+00 | 1.44e+09 |
| Te-129 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-129m | 1.79e+09 | 5.00e+08 | 2.78e+08 | 5.77e+08 | 5.26e+09 | 0.00e+00 | 2.18e+09 |
| Te-131 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-131m | 7.09e+02 | 2.45e+02 | 2.61e+02 | 5.04e+02 | 2.37e+03 | 0.00e+00 | 9.94e+03 |
| Te-132 | 2.13e+06 | 9.43e+05 | 1.14e+06 | 1.37e+06 | 8.76e+06 | 0.00e+00 | 9.49e+06 |
| Te-133m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-129 | 2.06e+08 | 1.26e+08 | 1.13e+08 | 8.27e+10 | 2.13e+08 | 0.00e+00 | 6.36e+06 |
| I-130 | 3.13e-06 | 6.33e-06 | 3.26e-06 | 6.97e-04 | 9.46e-06 | 0.00e+00 | 2.96e-06 |
| I-131 | 1.66e+07 | 1.67e+07 | 9.48e+06 | 5.51e+09 | 2.74e+07 | 0.00e+00 | 1.48e+06 |
| I-132 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-133 | 5.78e-01 | 7.15e-01 | 2.70e-01 | 1.33e+02 | 1.19e+00 | 0.00e+00 | 2.88e-01 |
| I-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-135 | 6.91e-17 | 1.24e-16 | 5.88e-17 | 1.10e-14 | 1.91e-16 | 0.00e+00 | 9.47e-17 |
| Cs-134 | 9.22e+08 | 1.51e+09 | 3.19e+08 | 0.00e+00 | 4.69e+08 | 1.68e+08 | 8.16e+06 |
| Cs-134m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 3.39e+08 | 2.36e+08 | 2.42e+07 | 0.00e+00 | 8.34e+07 | 2.78e+07 | 1.77e+06 |
| Cs-136 | 1.62e+07 | 4.46e+07 | 2.89e+07 | 0.00e+00 | 2.38e+07 | 3.54e+06 | 1.57e+06 |
| Cs-137 | 1.33e+09 | 1.28e+09 | 1.88e+08 | 0.00e+00 | 4.16e+08 | 1.50e+08 | 7.99e+06 |
| Cs-138 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-140 | 4.39e+07 | 3.85e+04 | 2.56e+06 | 0.00e+00 | 1.25e+04 | 2.29e+04 | 2.22e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 5.64e-02 | 1.97e-02 | 6.64e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.49e+02 |
| La-141 | 5.50e-37 | 1.28e-37 | 2.78e-38 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.85e-32 |
| La-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ce-141 | 2.22e+04 | 1.11e+04 | 1.65e+03 | 0.00e+00 | 4.86e+03 | 0.00e+00 | 1.38e+07 |
| Ce-143 | 3.21e-02 | 1.74e+01 | 2.52e-03 | 0.00e+00 | 7.29e-03 | 0.00e+00 | 2.55e+02 |
| Ce-144 | 2.32e+06 | 7.26e+05 | 1.24e+05 | 0.00e+00 | 4.02e+05 | 0.00e+00 | 1.89e+08 |
| Pr-143 | 3.34e+04 | 1.00e+04 | 1.66e+03 | 0.00e+00 | 5.43e+03 | 0.00e+00 | 3.61e+07 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 1.17e+04 | 9.48e+03 | 7.34e+02 | 0.00e+00 | 5.20e+03 | 0.00e+00 | 1.50e+07 |
| Pm-147 | 1.52e+06 | 1.08e+05 | 5.81e+04 | 0.00e+00 | 1.91e+05 | 0.00e+00 | 4.38e+07 |
| Pm-148 | 3.11e+03 | 3.74e+02 | 2.42e+02 | 0.00e+00 | 6.35e+02 | 0.00e+00 | 9.98e+06 |
| Pm-148m | 2.70e+05 | 5.37e+04 | 5.37e+04 | 0.00e+00 | 7.96e+04 | 0.00e+00 | 1.51e+08 |
| Pm-149 | 8.19e+00 | 8.71e-01 | 4.72e-01 | 0.00e+00 | 1.54e+00 | 0.00e+00 | 5.94e+04 |
| Pm-151 | 8.80e-03 | 1.07e-03 | 6.96e-04 | 0.00e+00 | 1.81e-03 | 0.00e+00 | 1.21e+02 |
| Sm-151 | 1.31e+06 | 1.95e+05 | 6.13e+04 | 0.00e+00 | 2.01e+05 | 0.00e+00 | 2.82e+07 |
| Sm-153 | 1.86e+00 | 1.16e+00 | 1.12e-01 | 0.00e+00 | 3.53e-01 | 0.00e+00 | 1.54e+04 |
| Eu-152 | 3.00e+06 | 5.46e+05 | 6.49e+05 | 0.00e+00 | 2.31e+06 | 0.00e+00 | 8.97e+07 |
| Eu-154 | 1.13e+07 | 1.02e+06 | 9.27e+05 | 0.00e+00 | 4.46e+06 | 0.00e+00 | 2.36e+08 |
| Eu-155 | 2.27e+06 | 1.63e+05 | 1.28e+05 | 0.00e+00 | 6.11e+05 | 0.00e+00 | 4.09e+08 |
| Eu-156 | 5.77e+04 | 3.09e+04 | 6.39e+03 | 0.00e+00 | 1.99e+04 | 0.00e+00 | 7.01e+07 |
| Tb-160 | 5.16e+05 | 0.00e+00 | 6.40e+04 | 0.00e+00 | 1.54e+05 | 0.00e+00 | 1.14e+08 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Hc-166m | 4.86e+06 | 1.02e+06 | 8.59e+05 | 0.00e+00 | 1.45e+06 | 0.00e+00 | 1.18e+08 |
| W-181 | 4.80e+04 | 1.18e+04 | 1.62e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.30e+05 |
| W-185 | 1.72e+06 | 4.30e+05 | 6.02e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.60e+07 |
| W-187 | 3.49e-02 | 2.06e-02 | 9.27e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.90e+00 |
| Pb-210 | 1.40e+10 | 3.60e+09 | 6.17e+08 | 0.00e+00 | 1.08e+10 | 0.00e+00 | 6.79e+05 |
| Bi-210 | 4.34e+05 | 2.24e+06 | 2.49e+05 | 0.00e+00 | 2.53e+07 | 0.00e+00 | 1.14e+07 |
| Po-210 | 1.53e+10 | 2.45e+10 | 3.70e+09 | 0.00e+00 | 7.61e+10 | 0.00e+00 | 6.60e+08 |
| Ra-223 | 9.80e+10 | 1.13e+08 | 1.96e+10 | 0.00e+00 | 3.00e+09 | 0.00e+00 | 1.56e+09 |
| Ra-224 | 1.12e+09 | 2.04e+06 | 2.25e+08 | 0.00e+00 | 5.40e+07 | 0.00e+00 | 6.17e+07 |
| Ra-225 | 1.96e+11 | 1.75e+08 | 3.91e+10 | 0.00e+00 | 4.63e+09 | 0.00e+00 | 2.25e+09 |
| Ra-226 | 2.00e+13 | 6.39e+08 | 1.64e+13 | 0.00e+00 | 1.70e+10 | 0.00e+00 | 1.18e+10 |
| Ra-228 | 1.32e+13 | 3.43e+08 | 1.48e+13 | 0.00e+00 | 9.09e+09 | 0.00e+00 | 1.99e+09 |
| Ac-225 | 1.20e+08 | 1.24e+08 | 8.05e+06 | 0.00e+00 | 1.32e+07 | 0.00e+00 | 2.75e+09 |
| Ac-227 | 2.52e+11 | 4.05e+10 | 1.56e+10 | 0.00e+00 | 8.92e+09 | 0.00e+00 | 5.15e+09 |
| Th-227 | 3.22e+06 | 4.38e+04 | 9.30e+04 | 0.00e+00 | 2.32e+05 | 0.00e+00 | 3.10e+07 |
| Th-228 | 4.07e+08 | 5.21e+06 | 1.38e+07 | 0.00e+00 | 2.71e+07 | 0.00e+00 | 1.14e+08 |
| Th-229 | 4.80e+09 | 1.21e+08 | 8.01e+07 | 0.00e+00 | 5.91e+08 | 0.00e+00 | 1.64e+07 |
| Th-230 | 7.26e+08 | 3.64e+07 | 2.03e+07 | 0.00e+00 | 1.77e+08 | 0.00e+00 | 1.27e+07 |
| Th-232 | 8.10e+08 | 3.11e+07 | 6.15e+05 | 0.00e+00 | 1.51e+08 | 0.00e+00 | 1.08e+07 |
| Th-234 | 2.49e+04 | 1.10e+03 | 7.19e+02 | 0.00e+00 | 5.83e+03 | 0.00e+00 | 8.58e+06 |
| Pa-231 | 5.78e+15 | 1.91e+14 | 2.30e+14 | 0.00e+00 | 1.05e+15 | 0.00e+00 | 6.03e+13 |
| Pa-233 | 5.91e+09 | 9.20e+08 | 1.03e+09 | 0.00e+00 | 3.39e+09 | 0.00e+00 | 4.70e+12 |
| U-232 | 6.11e+09 | 0.00e+00 | 4.37e+08 | 0.00e+00 | 4.65e+08 | 0.00e+00 | 2.42e+07 |
| U-233 | 1.29e+09 | 0.00e+00 | 7.82e+07 | 0.00e+00 | 2.12e+08 | 0.00e+00 | 2.24e+07 |
| U-234 | 1.24e+09 | 0.00e+00 | 7.68e+07 | 0.00e+00 | 2.08e+08 | 0.00e+00 | 2.20e+07 |
| U-235 | 1.19e+09 | 0.00e+00 | 7.19e+07 | 0.00e+00 | 1.95e+08 | 0.00e+00 | 2.79e+07 |
| U-236 | 1.19e+09 | 0.00e+00 | 7.37e+07 | 0.00e+00 | 1.99e+08 | 0.00e+00 | 2.06e+07 |
| U-237 | 3.42e+03 | 0.00e+00 | 9.09e+02 | 0.00e+00 | 9.87e+03 | 0.00e+00 | 3.02e+05 |
| U-238 | 1.14e+09 | 0.00e+00 | 6.74e+07 | 0.00e+00 | 1.82e+08 | 0.00e+00 | 1.97e+07 |
| Np-237 | 4.56e+08 | 3.01e+07 | 2.00e+07 | 0.00e+00 | 1.24e+08 | 0.00e+00 | 1.67e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 2.27e+00 | 4.59e-02 | 3.53e-02 | 0.00e+00 | 1.46e-01 | 0.00e+00 | 1.57e+03 |
| Np-239 | 4.29e-01 | 3.08e-02 | 2.17e-02 | 0.00e+00 | 8.91e-02 | 0.00e+00 | 2.28e+03 |
| Pu-238 | 1.70e+07 | 1.97e+06 | 4.52e+05 | 0.00e+00 | 1.64e+06 | 0.00e+00 | 1.07e+06 |
| Pu-239 | 1.85e+07 | 1.97e+06 | 4.74e+05 | 0.00e+00 | 1.75e+06 | 0.00e+00 | 9.80e+05 |
| Pu-240 | 1.83e+07 | 2.05e+06 | 4.74e+05 | 0.00e+00 | 1.75e+06 | 0.00e+00 | 9.99e+05 |
| Pu-241 | 5.51e+05 | 2.25e+04 | 1.14e+04 | 0.00e+00 | 4.21e+04 | 0.00e+00 | 2.05e+04 |
| Pu-242 | 1.70e+07 | 1.97e+06 | 4.56e+05 | 0.00e+00 | 1.67e+06 | 0.00e+00 | 9.60e+05 |
| Pu-244 | 1.99e+07 | 2.26e+07 | 5.22e+05 | 0.00e+00 | 1.93e+06 | 0.00e+00 | 1.43e+06 |
| Am-241 | 2.73e+08 | 2.35e+08 | 2.05e+07 | 0.00e+00 | 1.25e+08 | 0.00e+00 | 1.53e+07 |
| Am-242m | 2.86e+08 | 2.29e+08 | 2.12e+07 | 0.00e+00 | 1.29e+08 | 0.00e+00 | 1.96e+07 |
| Am-243 | 2.74e+08 | 2.31e+08 | 2.01e+07 | 0.00e+00 | 1.24e+08 | 0.00e+00 | 1.83e+07 |
| Cm-242 | 1.52e+07 | 1.21e+07 | 1.01e+06 | 0.00e+00 | 3.23e+06 | 0.00e+00 | 1.41e+07 |
| Cm-243 | 2.61e+08 | 2.12e+08 | 1.68e+07 | 0.00e+00 | 6.28e+07 | 0.00e+00 | 1.64e+07 |
| Cm-244 | 2.20e+08 | 1.78e+08 | 1.41e+07 | 0.00e+00 | 5.17e+07 | 0.00e+00 | 1.58e+07 |
| Cm-245 | 3.41e+08 | 2.74e+08 | 2.15e+07 | 0.00e+00 | 8.40e+07 | 0.00e+00 | 1.48e+07 |
| Cm-246 | 3.37e+08 | 2.74e+08 | 2.15e+07 | 0.00e+00 | 8.38e+07 | 0.00e+00 | 1.45e+07 |
| Cm-247 | 3.29e+08 | 2.70e+08 | 2.11e+07 | 0.00e+00 | 8.26e+07 | 0.00e+00 | 1.91e+07 |
| Cm-248 | 2.74e+09 | 2.23e+09 | 1.74e+08 | 0.00e+00 | 6.81e+08 | 0.00e+00 | 3.09e+08 |
| Cf-252 | 2.08e+08 | 0.00e+00 | 5.03e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.87e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Be-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| C-14 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Na-22 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Na-24 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| P-32 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ca-41 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sc-46 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mn-54 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mn-56 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Fe-55 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Fe-59 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Co-57 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Co-58 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Co-60 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ni-59 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ni-63 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ni-65 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cu-64 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zn-65 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zn-69 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zn-69m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Se-79 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-82 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-87 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-90 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-91 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-92 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-90 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-91 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-91m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-92 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-93 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zr-93 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zr-95 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zr-97 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nb-93m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nb-95 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nb-97 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mo-93 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mo-99 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ru-103 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ru-105 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ru-106 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rh-105 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pd-107 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pd-109 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ag-111 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cd-113m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cd-115m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sn-123 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sn-125 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sn-126 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sb-124 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sb-125 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sb-126 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sb-127 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-125m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-127 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-127m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-129 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-129m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-131 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-131m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-132 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-133m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-129 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-130 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-131 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-132 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-133 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-135 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-134m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-136 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-137 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-138 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-140 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ce-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ce-143 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ce-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pr-143 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-147 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-148 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-148m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-149 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-151 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sm-151 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sm-153 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Eu-152 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Eu-154 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Eu-155 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Eu-156 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tb-160 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Hc-166m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| W-181 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| W-185 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| W-187 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pb-210 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Bi-210 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Po-210 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-223 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-224 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-225 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-226 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-228 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ac-225 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ac-227 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-227 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-228 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-229 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-230 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-232 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-234 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pa-231 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pa-233 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-232 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-233 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-234 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-235 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-236 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-237 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-238 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Np-237 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**MEAT PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES, R_i**

Ri factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Meat & Poultry Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Np-239 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-238 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-239 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-240 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-241 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-242 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-244 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Am-241 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Am-242m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Am-243 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-242 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-243 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-244 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-245 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-246 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-247 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-248 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cf-252 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Adult age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| H-3 | 0.00e+00 | 1.29e+03 | 1.29e+03 | 1.29e+03 | 1.29e+03 | 1.29e+03 | 1.29e+03 |
| Be-10 | 2.55e+08 | 3.93e+07 | 6.36e+06 | 0.00e+00 | 2.97e+07 | 0.00e+00 | 2.15e+09 |
| C-14 | 2.28e+08 | 4.55e+07 | 4.55e+07 | 4.55e+07 | 4.55e+07 | 4.55e+07 | 4.55e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 4.26e+00 | 0.00e+00 | 4.72e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.26e-01 |
| Na-22 | 1.32e+09 | 1.32e+09 | 1.32e+09 | 1.32e+09 | 1.32e+09 | 1.32e+09 | 1.32e+09 |
| Na-24 | 2.68e+05 | 2.68e+05 | 2.68e+05 | 2.68e+05 | 2.68e+05 | 2.68e+05 | 2.68e+05 |
| P-32 | 1.40e+09 | 8.73e+07 | 5.42e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.58e+08 |
| Ca-41 | 1.48e+10 | 0.00e+00 | 1.60e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.47e+07 |
| Sc-46 | 2.51e+05 | 4.86e+05 | 1.41e+05 | 0.00e+00 | 4.54e+05 | 0.00e+00 | 2.37e+09 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 4.64e+04 | 2.77e+04 | 1.02e+04 | 6.16e+04 | 1.17e+07 |
| Mn-54 | 0.00e+00 | 3.13e+08 | 5.97e+07 | 0.00e+00 | 9.31e+07 | 0.00e+00 | 9.58e+08 |
| Mn-56 | 0.00e+00 | 1.53e+01 | 2.72e+00 | 0.00e+00 | 1.94e+01 | 0.00e+00 | 4.89e+02 |
| Fe-55 | 2.10e+08 | 1.45e+08 | 3.38e+07 | 0.00e+00 | 0.00e+00 | 8.08e+07 | 8.31e+07 |
| Fe-59 | 1.26e+08 | 2.96e+08 | 1.14e+08 | 0.00e+00 | 0.00e+00 | 8.28e+07 | 9.88e+08 |
| Co-57 | 0.00e+00 | 1.17e+07 | 1.94e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.97e+08 |
| Co-58 | 0.00e+00 | 3.07e+07 | 6.89e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.23e+08 |
| Co-60 | 0.00e+00 | 1.67e+08 | 3.69e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.14e+09 |
| Ni-59 | 7.82e+08 | 2.68e+08 | 1.31e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.53e+07 |
| Ni-63 | 1.04e+10 | 7.21e+08 | 3.49e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.50e+08 |
| Ni-65 | 5.96e+01 | 7.75e+00 | 3.54e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.97e+02 |
| Cu-64 | 0.00e+00 | 9.15e+03 | 4.29e+03 | 0.00e+00 | 2.31e+04 | 0.00e+00 | 7.79e+05 |
| Zn-65 | 3.17e+08 | 1.01e+09 | 4.56e+08 | 0.00e+00 | 6.75e+08 | 0.00e+00 | 6.36e+08 |
| Zn-69 | 5.06e-06 | 9.67e-06 | 6.72e-07 | 0.00e+00 | 6.28e-06 | 0.00e+00 | 1.45e-06 |
| Zn-69m | 2.24e+04 | 5.38e+04 | 4.92e+03 | 0.00e+00 | 3.26e+04 | 0.00e+00 | 3.29e+06 |
| Se-79 | 0.00e+00 | 2.11e+08 | 3.52e+07 | 0.00e+00 | 3.65e+08 | 0.00e+00 | 4.31e+07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.50e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.72e+06 |
| Br-83 | 0.00e+00 | 0.00e+00 | 3.01e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.33e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 2.14e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.68e-16 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Adult age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.19e+08 | 1.02e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.32e+07 |
| Rb-87 | 0.00e+00 | 9.86e-08 | 3.43e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.62e+07 |
| Rb-88 | 0.00e+00 | 2.64e-22 | 1.40e-22 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.65e-33 |
| Rb-89 | 0.00e+00 | 2.88e-26 | 2.03e-26 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.67e-39 |
| Sr-89 | 9.96e+09 | 0.00e+00 | 2.86e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.60e+09 |
| Sr-90 | 6.95e+11 | 0.00e+00 | 1.40e+10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.75e+10 |
| Sr-91 | 3.02e+05 | 0.00e+00 | 1.22e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.44e+06 |
| Sr-92 | 4.15e+02 | 0.00e+00 | 1.79e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.21e+03 |
| Y-90 | 1.33e+04 | 0.00e+00 | 3.56e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.41e+08 |
| Y-91 | 5.11e+06 | 0.00e+00 | 1.37e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.81e+09 |
| Y-91m | 4.76e-09 | 0.00e+00 | 1.84e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.40e-08 |
| Y-92 | 8.96e-01 | 0.00e+00 | 2.62e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.57e+04 |
| Y-93 | 1.68e+02 | 0.00e+00 | 4.65e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.34e+06 |
| Zr-93 | 3.35e+06 | 1.88e+05 | 8.73e+04 | 0.00e+00 | 7.11e+05 | 0.00e+00 | 1.95e+08 |
| Zr-95 | 1.17e+06 | 3.77e+05 | 2.55e+05 | 0.00e+00 | 5.91e+05 | 0.00e+00 | 1.19e+09 |
| Zr-97 | 3.36e+02 | 6.78e+01 | 3.10e+01 | 0.00e+00 | 1.02e+02 | 0.00e+00 | 2.10e+07 |
| Nb-93m | 2.02e+06 | 6.60e+05 | 1.63e+05 | 0.00e+00 | 7.59e+05 | 0.00e+00 | 3.05e+08 |
| Nb-95 | 1.42e+05 | 7.91e+04 | 4.25e+04 | 0.00e+00 | 7.82e+04 | 0.00e+00 | 4.80e+08 |
| Nb-97 | 2.84e-06 | 7.19e-07 | 2.63e-07 | 0.00e+00 | 8.39e-07 | 0.00e+00 | 2.65e-03 |
| Mo-93 | 0.00e+00 | 6.02e+08 | 1.63e+07 | 0.00e+00 | 1.71e+08 | 0.00e+00 | 9.78e+07 |
| Mo-99 | 0.00e+00 | 6.14e+06 | 1.17e+06 | 0.00e+00 | 1.39e+07 | 0.00e+00 | 1.42e+07 |
| Tc-101 | 5.93e-31 | 8.55e-31 | 8.39e-30 | 0.00e+00 | 1.54e-29 | 4.37e-31 | 0.00e+00 |
| Tc-99 | 1.00e+07 | 1.49e+07 | 4.02e+06 | 0.00e+00 | 1.88e+08 | 1.27e+06 | 4.87e+08 |
| Tc-99m | 3.06e+00 | 8.66e+00 | 1.10e+02 | 0.00e+00 | 1.31e+02 | 4.24e+00 | 5.12e+03 |
| Ru-103 | 4.77e+06 | 0.00e+00 | 2.05e+06 | 0.00e+00 | 1.82e+07 | 0.00e+00 | 5.57e+08 |
| Ru-105 | 5.29e+01 | 0.00e+00 | 2.09e+01 | 0.00e+00 | 6.84e+02 | 0.00e+00 | 3.24e+04 |
| Ru-106 | 1.93e+08 | 0.00e+00 | 2.44e+07 | 0.00e+00 | 3.72e+08 | 0.00e+00 | 1.25e+10 |
| Rh-105 | 8.01e+04 | 5.86e+04 | 3.86e+04 | 0.00e+00 | 2.49e+05 | 0.00e+00 | 9.34e+06 |
| Pd-107 | 0.00e+00 | 1.18e+07 | 7.53e+05 | 0.00e+00 | 1.06e+08 | 0.00e+00 | 7.30e+07 |
| Pd-109 | 0.00e+00 | 2.23e+04 | 5.02e+03 | 0.00e+00 | 1.27e+05 | 0.00e+00 | 2.47e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Adult age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Aq-110m | 1.05e+07 | 9.74e+06 | 5.79e+06 | 0.00e+00 | 1.92e+07 | 0.00e+00 | 3.98e+09 |
| Aq-111 | 2.11e+05 | 8.81e+04 | 4.39e+04 | 0.00e+00 | 2.84e+05 | 0.00e+00 | 1.62e+08 |
| Cd-113m | 0.00e+00 | 2.52e+08 | 8.10e+06 | 0.00e+00 | 2.78e+08 | 0.00e+00 | 2.03e+09 |
| Cd-115m | 0.00e+00 | 5.34e+07 | 1.70e+06 | 0.00e+00 | 4.24e+07 | 0.00e+00 | 2.25e+09 |
| Sn-123 | 1.71e+09 | 2.84e+07 | 4.18e+07 | 2.41e+07 | 0.00e+00 | 0.00e+00 | 3.49e+09 |
| Sn-125 | 3.84e+07 | 7.74e+05 | 1.74e+06 | 6.40e+05 | 0.00e+00 | 0.00e+00 | 4.79e+08 |
| Sn-126 | 6.77e+09 | 1.34e+08 | 1.92e+08 | 3.94e+07 | 0.00e+00 | 0.00e+00 | 1.95e+09 |
| Sb-124 | 1.04e+08 | 1.96e+06 | 4.11e+07 | 2.51e+05 | 0.00e+00 | 8.07e+07 | 2.94e+09 |
| Sb-125 | 1.37e+08 | 1.53e+06 | 3.25e+07 | 1.39e+05 | 0.00e+00 | 1.05e+08 | 1.50e+09 |
| Sb-126 | 7.07e+06 | 1.44e+05 | 2.55e+06 | 4.33e+04 | 0.00e+00 | 4.34e+06 | 5.78e+08 |
| Sb-127 | 5.22e+05 | 1.14e+04 | 2.00e+05 | 6.28e+03 | 0.00e+00 | 3.10e+05 | 1.19e+08 |
| Te-125m | 9.65e+07 | 3.50e+07 | 1.29e+07 | 2.90e+07 | 3.93e+08 | 0.00e+00 | 3.85e+08 |
| Te-127 | 5.61e+03 | 2.02e+03 | 1.21e+03 | 4.16e+03 | 2.29e+04 | 0.00e+00 | 4.43e+05 |
| Te-127m | 3.49e+08 | 1.25e+08 | 4.25e+07 | 8.92e+07 | 1.42e+09 | 0.00e+00 | 1.17e+09 |
| Te-129 | 7.13e-04 | 2.68e-04 | 1.74e-04 | 5.48e-04 | 3.00e-03 | 0.00e+00 | 5.38e-04 |
| Te-129m | 2.51e+08 | 9.37e+07 | 3.98e+07 | 8.63e+07 | 1.05e+09 | 0.00e+00 | 1.26e+09 |
| Te-131 | 1.25e-15 | 5.21e-16 | 3.94e-16 | 1.03e-15 | 5.47e-15 | 0.00e+00 | 1.77e-16 |
| Te-131m | 9.10e+05 | 4.45e+05 | 3.71e+05 | 7.05e+05 | 4.51e+06 | 0.00e+00 | 4.42e+07 |
| Te-132 | 4.30e+06 | 2.78e+06 | 2.61e+06 | 3.07e+06 | 2.68e+07 | 0.00e+00 | 1.31e+08 |
| Te-133m | 2.12e-05 | 1.24e-05 | 1.19e-05 | 1.79e-05 | 1.22e-04 | 0.00e+00 | 4.24e-06 |
| Te-134 | 3.19e-08 | 2.09e-08 | 1.28e-08 | 2.79e-08 | 2.02e-07 | 0.00e+00 | 3.54e-11 |
| I-129 | 1.31e+09 | 1.13e+09 | 3.69e+09 | 2.90e+12 | 2.42e+09 | 0.00e+00 | 1.78e+08 |
| I-130 | 3.90e+05 | 1.15e+06 | 4.54e+05 | 9.75e+07 | 1.79e+06 | 0.00e+00 | 9.90e+05 |
| I-131 | 8.07e+07 | 1.15e+08 | 6.62e+07 | 3.78e+10 | 1.98e+08 | 0.00e+00 | 3.05e+07 |
| I-132 | 5.57e+01 | 1.49e+02 | 5.21e+01 | 5.21e+03 | 2.37e+02 | 0.00e+00 | 2.80e+01 |
| I-133 | 2.08e+06 | 3.61e+06 | 1.10e+06 | 5.31e+08 | 6.31e+06 | 0.00e+00 | 3.25e+06 |
| I-134 | 8.84e-05 | 2.40e-04 | 8.59e-05 | 4.16e-03 | 3.82e-04 | 0.00e+00 | 2.09e-07 |
| I-135 | 3.85e+04 | 1.01e+05 | 3.72e+04 | 6.65e+06 | 1.62e+05 | 0.00e+00 | 1.14e+05 |
| Cs-134 | 4.67e+09 | 1.11e+10 | 9.08e+09 | 0.00e+00 | 3.59e+09 | 1.19e+09 | 1.94e+08 |
| Cs-134m | 6.57e+00 | 1.38e+01 | 7.06e+00 | 0.00e+00 | 7.49e+00 | 1.18e+00 | 4.87e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Adult age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.56e+09 | 1.44e+09 | 6.40e+08 | 0.00e+00 | 5.46e+08 | 1.63e+08 | 3.37e+07 |
| Cs-136 | 4.26e+07 | 1.68e+08 | 1.21e+08 | 0.00e+00 | 9.37e+07 | 1.28e+07 | 1.91e+07 |
| Cs-137 | 6.36e+09 | 8.70e+09 | 5.70e+09 | 0.00e+00 | 2.95e+09 | 9.81e+08 | 1.68e+08 |
| Cs-138 | 3.39e-11 | 6.70e-11 | 3.32e-11 | 0.00e+00 | 4.92e-11 | 4.86e-12 | 2.86e-16 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 2.70e-02 | 1.92e-05 | 7.91e-04 | 0.00e+00 | 1.80e-05 | 1.09e-05 | 4.79e-02 |
| Ba-140 | 1.28e+08 | 1.61e+05 | 8.41e+06 | 0.00e+00 | 5.48e+04 | 9.23e+04 | 2.64e+08 |
| Ba-141 | 8.94e-22 | 6.76e-25 | 3.02e-23 | 0.00e+00 | 6.28e-25 | 3.83e-25 | 4.21e-31 |
| Ba-142 | 3.88e-39 | 0.00e+00 | 2.44e-40 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 1.97e+03 | 9.95e+02 | 2.63e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.30e+07 |
| La-141 | 5.98e-01 | 1.85e-01 | 3.04e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.21e+04 |
| La-142 | 1.92e-04 | 8.75e-05 | 2.18e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.39e-01 |
| Ce-141 | 1.97e+05 | 1.33e+05 | 1.51e+04 | 0.00e+00 | 6.19e+04 | 0.00e+00 | 5.09e+08 |
| Ce-143 | 9.95e+02 | 7.36e+05 | 8.14e+01 | 0.00e+00 | 3.24e+02 | 0.00e+00 | 2.75e+07 |
| Ce-144 | 3.29e+07 | 1.38e+07 | 1.77e+06 | 0.00e+00 | 8.16e+06 | 0.00e+00 | 1.11e+10 |
| Pr-143 | 6.26e+04 | 2.51e+04 | 3.10e+03 | 0.00e+00 | 1.45e+04 | 0.00e+00 | 2.74e+08 |
| Pr-144 | 2.36e-26 | 9.81e-27 | 1.20e-27 | 0.00e+00 | 5.53e-27 | 0.00e+00 | 3.40e-33 |
| Nd-147 | 3.33e+04 | 3.85e+04 | 2.30e+03 | 0.00e+00 | 2.25e+04 | 0.00e+00 | 1.85e+08 |
| Pm-147 | 5.74e+06 | 5.39e+05 | 2.18e+05 | 0.00e+00 | 1.02e+06 | 0.00e+00 | 6.79e+08 |
| Pm-148 | 1.96e+04 | 3.25e+03 | 1.64e+03 | 0.00e+00 | 6.14e+03 | 0.00e+00 | 2.55e+08 |
| Pm-148m | 8.29e+05 | 2.15e+05 | 1.64e+05 | 0.00e+00 | 3.24e+05 | 0.00e+00 | 1.82e+09 |
| Pm-149 | 1.69e+03 | 2.39e+02 | 9.77e+01 | 0.00e+00 | 4.52e+02 | 0.00e+00 | 4.48e+07 |
| Pm-151 | 3.36e+02 | 5.65e+01 | 2.85e+01 | 0.00e+00 | 1.01e+02 | 0.00e+00 | 1.55e+07 |
| Sm-151 | 5.52e+06 | 9.52e+05 | 2.28e+05 | 0.00e+00 | 1.06e+06 | 0.00e+00 | 4.20e+08 |
| Sm-153 | 8.20e+02 | 6.84e+02 | 5.00e+01 | 0.00e+00 | 2.21e+02 | 0.00e+00 | 2.44e+07 |
| Eu-152 | 1.55e+07 | 3.52e+06 | 3.09e+06 | 0.00e+00 | 2.18e+07 | 0.00e+00 | 2.03e+09 |
| Eu-154 | 4.92e+07 | 6.05e+06 | 4.31e+06 | 0.00e+00 | 2.90e+07 | 0.00e+00 | 4.39e+09 |
| Eu-155 | 6.39e+06 | 9.07e+05 | 5.85e+05 | 0.00e+00 | 4.18e+06 | 0.00e+00 | 7.13e+08 |
| Eu-156 | 1.08e+05 | 8.35e+04 | 1.35e+04 | 0.00e+00 | 5.58e+04 | 0.00e+00 | 5.72e+08 |
| Tb-160 | 1.96e+06 | 0.00e+00 | 2.44e+05 | 0.00e+00 | 8.09e+05 | 0.00e+00 | 1.81e+09 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Hc-166m | 2.16e+07 | 6.75e+06 | 5.13e+06 | 0.00e+00 | 1.01e+07 | 0.00e+00 | 2.05e+09 |
| W-181 | 5.33e+05 | 1.74e+05 | 1.86e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.98e+07 |
| W-185 | 1.73e+07 | 5.77e+06 | 6.07e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.67e+08 |
| W-187 | 3.79e+04 | 3.17e+04 | 1.11e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.04e+07 |
| Pk-210 | 1.22e+12 | 3.48e+11 | 4.33e+10 | 0.00e+00 | 9.79e+11 | 0.00e+00 | 1.78e+08 |
| Bi-210 | 1.18e+06 | 8.17e+06 | 6.78e+05 | 0.00e+00 | 9.83e+07 | 0.00e+00 | 1.22e+08 |
| Pc-210 | 2.01e+10 | 4.26e+10 | 4.85e+09 | 0.00e+00 | 1.42e+11 | 0.00e+00 | 3.59e+09 |
| Ra-223 | 2.74e+10 | 4.23e+07 | 5.49e+09 | 0.00e+00 | 1.20e+09 | 0.00e+00 | 1.77e+09 |
| Ra-224 | 3.08e+09 | 7.47e+06 | 6.19e+08 | 0.00e+00 | 2.11e+08 | 0.00e+00 | 6.51e+08 |
| Ra-225 | 4.99e+10 | 5.92e+07 | 9.97e+09 | 0.00e+00 | 1.68e+09 | 0.00e+00 | 2.33e+09 |
| Ra-226 | 2.42e+13 | 4.60e+08 | 1.76e+13 | 0.00e+00 | 1.31e+10 | 0.00e+00 | 2.66e+10 |
| Ra-228 | 8.76e+12 | 2.44e+08 | 9.47e+12 | 0.00e+00 | 6.91e+09 | 0.00e+00 | 4.41e+09 |
| Ac-225 | 2.11e+07 | 2.90e+07 | 1.42e+06 | 0.00e+00 | 3.31e+06 | 0.00e+00 | 1.95e+09 |
| Ac-227 | 1.49e+11 | 1.97e+10 | 8.84e+09 | 0.00e+00 | 6.37e+09 | 0.00e+00 | 6.52e+09 |
| Th-227 | 1.41e+08 | 2.55e+06 | 4.06e+06 | 0.00e+00 | 1.45e+07 | 0.00e+00 | 5.55e+09 |
| Th-228 | 3.70e+10 | 6.27e+08 | 1.25e+09 | 0.00e+00 | 3.49e+09 | 0.00e+00 | 4.20e+10 |
| Th-229 | 1.09e+12 | 3.12e+10 | 1.80e+10 | 0.00e+00 | 1.51e+11 | 0.00e+00 | 6.26e+09 |
| Th-230 | 1.65e+11 | 9.38e+09 | 4.57e+09 | 0.00e+00 | 4.53e+10 | 0.00e+00 | 4.82e+09 |
| Th-232 | 1.84e+11 | 8.01e+09 | 1.20e+08 | 0.00e+00 | 3.86e+10 | 0.00e+00 | 4.10e+09 |
| Th-234 | 1.17e+06 | 6.89e+04 | 3.38e+04 | 0.00e+00 | 3.91e+05 | 0.00e+00 | 1.65e+09 |
| Pa-231 | 3.29e+11 | 1.23e+10 | 1.27e+10 | 0.00e+00 | 6.92e+10 | 0.00e+00 | 5.75e+09 |
| Pa-233 | 9.05e+04 | 1.82e+04 | 1.57e+04 | 0.00e+00 | 6.87e+04 | 0.00e+00 | 2.82e+08 |
| U-232 | 3.30e+11 | 0.00e+00 | 2.36e+10 | 0.00e+00 | 3.58e+10 | 0.00e+00 | 5.42e+09 |
| U-233 | 6.98e+10 | 0.00e+00 | 4.23e+09 | 0.00e+00 | 1.63e+10 | 0.00e+00 | 5.02e+09 |
| U-234 | 6.70e+10 | 0.00e+00 | 4.14e+09 | 0.00e+00 | 1.59e+10 | 0.00e+00 | 4.92e+09 |
| U-235 | 6.42e+10 | 0.00e+00 | 3.89e+09 | 0.00e+00 | 1.50e+10 | 0.00e+00 | 6.26e+09 |
| U-236 | 6.42e+10 | 0.00e+00 | 3.97e+09 | 0.00e+00 | 1.53e+10 | 0.00e+00 | 4.62e+09 |
| U-237 | 1.84e+05 | 0.00e+00 | 4.89e+04 | 0.00e+00 | 7.55e+05 | 0.00e+00 | 6.45e+07 |
| U-238 | 6.15e+10 | 0.00e+00 | 3.64e+09 | 0.00e+00 | 1.40e+10 | 0.00e+00 | 4.41e+09 |
| Np-237 | 1.01e+11 | 7.18e+09 | 4.44e+09 | 0.00e+00 | 3.30e+10 | 0.00e+00 | 6.36e+09 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.45e+04 | 3.91e+02 | 2.26e+02 | 0.00e+00 | 1.32e+03 | 0.00e+00 | 3.63e+07 |
| Np-239 | 1.43e+03 | 1.40e+02 | 7.73e+01 | 0.00e+00 | 4.37e+02 | 0.00e+00 | 2.88e+07 |
| Pu-238 | 5.04e+10 | 6.38e+09 | 1.37e+09 | 0.00e+00 | 5.86e+09 | 0.00e+00 | 5.84e+09 |
| Pu-239 | 5.81e+10 | 6.98e+09 | 1.53e+09 | 0.00e+00 | 6.50e+09 | 0.00e+00 | 5.34e+09 |
| Pu-240 | 5.80e+10 | 6.97e+09 | 1.53e+09 | 0.00e+00 | 6.49e+09 | 0.00e+00 | 5.43e+09 |
| Pu-241 | 1.25e+09 | 5.92e+07 | 2.64e+07 | 0.00e+00 | 1.22e+08 | 0.00e+00 | 1.11e+08 |
| Pu-242 | 5.39e+10 | 6.72e+09 | 1.47e+09 | 0.00e+00 | 6.26e+09 | 0.00e+00 | 5.23e+09 |
| Pu-244 | 6.28e+10 | 7.70e+09 | 1.69e+09 | 0.00e+00 | 7.17e+09 | 0.00e+00 | 7.80e+09 |
| Am-241 | 5.86e+10 | 5.47e+10 | 4.20e+09 | 0.00e+00 | 3.16e+10 | 0.00e+00 | 5.76e+09 |
| Am-242m | 6.09e+10 | 5.31e+10 | 4.35e+09 | 0.00e+00 | 3.24e+10 | 0.00e+00 | 7.48e+09 |
| Am-243 | 6.04e+10 | 5.53e+10 | 4.25e+09 | 0.00e+00 | 3.20e+10 | 0.00e+00 | 6.97e+09 |
| Cm-242 | 1.22e+09 | 1.30e+09 | 8.14e+07 | 0.00e+00 | 3.70e+08 | 0.00e+00 | 4.71e+09 |
| Cm-243 | 4.78e+10 | 4.38e+10 | 2.99e+09 | 0.00e+00 | 1.40e+10 | 0.00e+00 | 6.23e+09 |
| Cm-244 | 3.63e+10 | 3.40e+10 | 2.28e+09 | 0.00e+00 | 1.07e+10 | 0.00e+00 | 6.00e+09 |
| Cm-245 | 7.52e+10 | 6.55e+10 | 4.62e+09 | 0.00e+00 | 2.16e+10 | 0.00e+00 | 5.64e+09 |
| Cm-246 | 7.45e+10 | 6.54e+10 | 4.61e+09 | 0.00e+00 | 2.15e+10 | 0.00e+00 | 5.54e+09 |
| Cm-247 | 7.27e+10 | 6.44e+10 | 4.54e+09 | 0.00e+00 | 2.12e+10 | 0.00e+00 | 7.28e+09 |
| Cm-248 | 6.04e+11 | 5.31e+11 | 3.74e+10 | 0.00e+00 | 1.75e+11 | 0.00e+00 | 1.18e+11 |
| Cf-252 | 1.98e+10 | 0.00e+00 | 4.77e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.18e+10 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 1.47e+03 | 1.47e+03 | 1.47e+03 | 1.47e+03 | 1.47e+03 | 1.47e+03 |
| Be-10 | 4.07e+08 | 6.31e+07 | 1.03e+07 | 0.00e+00 | 4.82e+07 | 0.00e+00 | 2.58e+09 |
| C-14 | 3.69e+08 | 7.38e+07 | 7.38e+07 | 7.38e+07 | 7.38e+07 | 7.38e+07 | 7.38e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 3.87e+00 | 0.00e+00 | 4.24e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.48e-01 |
| Na-22 | 2.01e+09 | 2.01e+09 | 2.01e+09 | 2.01e+09 | 2.01e+09 | 2.01e+09 | 2.01e+09 |
| Na-24 | 2.38e+05 | 2.38e+05 | 2.38e+05 | 2.38e+05 | 2.38e+05 | 2.38e+05 | 2.38e+05 |
| P-32 | 1.61e+09 | 9.96e+07 | 6.23e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.35e+08 |
| Ca-41 | 1.79e+10 | 0.00e+00 | 1.94e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.77e+07 |
| Sc-46 | 3.61e+05 | 7.02e+05 | 2.08e+05 | 0.00e+00 | 6.72e+05 | 0.00e+00 | 2.39e+09 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 6.16e+04 | 3.42e+04 | 1.35e+04 | 8.80e+04 | 1.04e+07 |
| Mn-54 | 0.00e+00 | 4.54e+08 | 9.01e+07 | 0.00e+00 | 1.36e+08 | 0.00e+00 | 9.32e+08 |
| Mn-56 | 0.00e+00 | 1.38e+01 | 2.46e+00 | 0.00e+00 | 1.75e+01 | 0.00e+00 | 9.09e+02 |
| Fe-55 | 3.26e+08 | 2.31e+08 | 5.39e+07 | 0.00e+00 | 0.00e+00 | 1.47e+08 | 1.00e+08 |
| Fe-59 | 1.79e+08 | 4.18e+08 | 1.62e+08 | 0.00e+00 | 0.00e+00 | 1.32e+08 | 9.90e+08 |
| Co-57 | 0.00e+00 | 1.79e+07 | 2.99e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.33e+08 |
| Co-58 | 0.00e+00 | 4.36e+07 | 1.00e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.01e+08 |
| Co-60 | 0.00e+00 | 2.49e+08 | 5.60e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.24e+09 |
| Ni-59 | 1.20e+09 | 4.24e+08 | 2.04e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.64e+07 |
| Ni-63 | 1.61e+10 | 1.13e+09 | 5.45e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.81e+08 |
| Ni-65 | 5.55e+01 | 7.09e+00 | 3.23e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.85e+02 |
| Cu-64 | 0.00e+00 | 8.29e+03 | 3.90e+03 | 0.00e+00 | 2.10e+04 | 0.00e+00 | 6.43e+05 |
| Zn-65 | 4.24e+08 | 1.47e+09 | 6.86e+08 | 0.00e+00 | 9.42e+08 | 0.00e+00 | 6.23e+08 |
| Zn-69 | 4.73e-06 | 9.02e-06 | 6.31e-07 | 0.00e+00 | 5.89e-06 | 0.00e+00 | 1.66e-05 |
| Zn-69m | 2.08e+04 | 4.90e+04 | 4.50e+03 | 0.00e+00 | 2.98e+04 | 0.00e+00 | 2.69e+06 |
| Se-79 | 0.00e+00 | 3.39e+08 | 5.70e+07 | 0.00e+00 | 5.91e+08 | 0.00e+00 | 5.18e+07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.32e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 2.82e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 1.95e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Teen age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.73e+08 | 1.28e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.05e+07 |
| Rb-87 | 0.00e+00 | 1.59e+09 | 5.55e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.55e+07 |
| Rb-88 | 0.00e+00 | 2.44e-22 | 1.30e-22 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.09e-29 |
| Rb-89 | 0.00e+00 | 2.59e-26 | 1.83e-26 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.98e-35 |
| Sr-89 | 1.51e+10 | 0.00e+00 | 4.33e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.80e+09 |
| Sr-90 | 9.22e+11 | 0.00e+00 | 1.84e+10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.11e+10 |
| Sr-91 | 2.82e+05 | 0.00e+00 | 1.12e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.28e+06 |
| Sr-92 | 3.86e+02 | 0.00e+00 | 1.65e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.83e+03 |
| Y-90 | 1.24e+04 | 0.00e+00 | 3.34e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.02e+08 |
| Y-91 | 7.83e+06 | 0.00e+00 | 2.10e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.21e+09 |
| Y-91m | 4.43e-09 | 0.00e+00 | 1.69e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.09e-07 |
| Y-92 | 8.42e-01 | 0.00e+00 | 2.43e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.31e+04 |
| Y-93 | 1.58e+02 | 0.00e+00 | 4.33e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.82e+06 |
| Zr-93 | 5.03e+06 | 2.48e+05 | 1.35e+05 | 0.00e+00 | 8.77e+05 | 0.00e+00 | 2.34e+08 |
| Zr-95 | 1.72e+06 | 5.43e+05 | 3.73e+05 | 0.00e+00 | 7.98e+05 | 0.00e+00 | 1.25e+09 |
| Zr-97 | 3.11e+02 | 6.15e+01 | 2.83e+01 | 0.00e+00 | 9.33e+01 | 0.00e+00 | 1.67e+07 |
| Nb-93m | 3.09e+06 | 1.02e+06 | 2.55e+05 | 0.00e+00 | 1.19e+06 | 0.00e+00 | 3.66e+08 |
| Nb-95 | 1.92e+05 | 1.07e+05 | 5.87e+04 | 0.00e+00 | 1.03e+05 | 0.00e+00 | 4.56e+08 |
| Nb-97 | 2.63e-06 | 6.54e-07 | 2.39e-07 | 0.00e+00 | 7.65e-07 | 0.00e+00 | 1.56e-02 |
| Mo-93 | 0.00e+00 | 9.63e+08 | 2.64e+07 | 0.00e+00 | 2.76e+08 | 0.00e+00 | 1.17e+08 |
| Mo-99 | 0.00e+00 | 5.64e+06 | 1.08e+06 | 0.00e+00 | 1.29e+07 | 0.00e+00 | 1.01e+07 |
| Tc-101 | 5.52e-31 | 7.85e-31 | 7.71e-30 | 0.00e+00 | 1.42e-29 | 4.78e-31 | 1.34e-37 |
| Tc-99 | 1.63e+07 | 2.39e+07 | 6.52e+06 | 0.00e+00 | 3.04e+08 | 2.47e+06 | 5.85e+08 |
| Tc-99m | 2.70e+00 | 7.54e+00 | 9.77e+01 | 0.00e+00 | 1.12e+02 | 4.18e+00 | 4.95e+03 |
| Ru-103 | 6.82e+06 | 0.00e+00 | 2.91e+06 | 0.00e+00 | 2.40e+07 | 0.00e+00 | 5.69e+08 |
| Ru-105 | 4.92e+01 | 0.00e+00 | 1.91e+01 | 0.00e+00 | 6.20e+02 | 0.00e+00 | 3.97e+04 |
| Ru-106 | 3.09e+08 | 0.00e+00 | 3.90e+07 | 0.00e+00 | 5.97e+08 | 0.00e+00 | 1.48e+10 |
| Rh-105 | 7.52e+04 | 5.43e+04 | 3.56e+04 | 0.00e+00 | 2.31e+05 | 0.00e+00 | 6.91e+06 |
| Pd-107 | 0.00e+00 | 1.89e+07 | 1.22e+06 | 0.00e+00 | 1.71e+08 | 0.00e+00 | 8.78e+07 |
| Pd-109 | 0.00e+00 | 2.07e+04 | 4.71e+03 | 0.00e+00 | 1.20e+05 | 0.00e+00 | 2.09e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Teen age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 1.52e+07 | 1.43e+07 | 8.72e+06 | 0.00e+00 | 2.73e+07 | 0.00e+00 | 4.03e+09 |
| Ag-111 | 2.01e+05 | 8.35e+04 | 4.20e+04 | 0.00e+00 | 2.72e+05 | 0.00e+00 | 1.17e+08 |
| Cd-113m | 0.00e+00 | 4.06e+08 | 1.30e+07 | 0.00e+00 | 4.49e+08 | 0.00e+00 | 2.44e+09 |
| Cd-115m | 0.00e+00 | 7.94e+07 | 2.56e+06 | 0.00e+00 | 6.35e+07 | 0.00e+00 | 2.51e+09 |
| Sr-123 | 2.72e+09 | 4.46e+07 | 6.61e+07 | 3.57e+07 | 0.00e+00 | 0.00e+00 | 4.11e+09 |
| Sr-125 | 3.84e+07 | 7.65e+05 | 1.73e+06 | 6.01e+05 | 0.00e+00 | 0.00e+00 | 3.62e+08 |
| Sr-126 | 1.05e+10 | 1.96e+08 | 3.00e+08 | 5.17e+07 | 0.00e+00 | 0.00e+00 | 2.34e+09 |
| Sb-124 | 1.54e+08 | 2.84e+06 | 6.02e+07 | 3.50e+05 | 0.00e+00 | 1.35e+08 | 3.11e+09 |
| Sb-125 | 2.14e+08 | 2.34e+06 | 5.01e+07 | 2.05e+05 | 0.00e+00 | 1.88e+08 | 1.67e+09 |
| Sb-126 | 7.45e+06 | 1.52e+05 | 2.68e+06 | 4.21e+04 | 0.00e+00 | 5.34e+06 | 4.41e+08 |
| Sb-127 | 4.82e+05 | 1.03e+04 | 1.82e+05 | 5.42e+03 | 0.00e+00 | 3.28e+05 | 8.19e+07 |
| Te-125m | 1.48e+08 | 5.34e+07 | 1.98e+07 | 4.14e+07 | 0.00e+00 | 0.00e+00 | 4.37e+06 |
| Te-127 | 5.29e+03 | 1.88e+03 | 1.14e+03 | 3.65e+03 | 2.14e+04 | 0.00e+00 | 4.09e+05 |
| Te-127m | 5.51e+08 | 1.96e+08 | 6.56e+07 | 1.31e+08 | 2.23e+09 | 0.00e+00 | 1.37e+09 |
| Te-129 | 6.68e-04 | 2.49e-04 | 1.63e-04 | 4.77e-04 | 2.80e-03 | 0.00e+00 | 3.65e-03 |
| Te-129m | 3.61e+08 | 1.34e+08 | 5.72e+07 | 1.17e+08 | 1.51e+09 | 0.00e+00 | 1.36e+09 |
| Te-131 | 1.16e-15 | 4.78e-16 | 3.62e-16 | 8.93e-16 | 5.07e-15 | 0.00e+00 | 9.52e-17 |
| Te-131m | 8.42e+05 | 4.04e+05 | 3.37e+05 | 6.07e+05 | 4.21e+06 | 0.00e+00 | 3.24e+07 |
| Te-132 | 3.90e+06 | 2.47e+06 | 2.33e+06 | 2.61e+06 | 2.37e+07 | 0.00e+00 | 7.83e+07 |
| Te-133m | 1.94e-05 | 1.10e-05 | 1.07e-05 | 1.54e-05 | 1.09e-04 | 0.00e+00 | 4.45e-05 |
| Te-134 | 2.89e-08 | 1.85e-08 | 1.94e-08 | 2.37e-08 | 1.77e-07 | 0.00e+00 | 1.07e-09 |
| I-129 | 2.12e+09 | 1.78e+09 | 2.97e+09 | 2.17e+12 | 3.19e+09 | 0.00e+00 | 2.08e+08 |
| I-130 | 3.49e+05 | 1.01e+06 | 4.03e+05 | 8.22e+07 | 1.55e+06 | 0.00e+00 | 7.75e+05 |
| I-131 | 7.68e+07 | 1.08e+08 | 5.78e+07 | 3.14e+10 | 1.85e+08 | 0.00e+00 | 2.13e+07 |
| I-132 | 5.02e+01 | 1.31e+02 | 4.72e+01 | 4.43e+03 | 2.07e+02 | 0.00e+00 | 5.72e+01 |
| I-133 | 1.93e+06 | 3.27e+06 | 9.99e+05 | 4.57e+08 | 5.74e+06 | 0.00e+00 | 2.48e+06 |
| I-134 | 7.99e-05 | 2.12e-04 | 7.61e-05 | 3.53e-03 | 3.34e-04 | 0.00e+00 | 2.79e-06 |
| I-135 | 3.48e+04 | 8.96e+04 | 3.32e+04 | 5.76e+06 | 1.42e+05 | 0.00e+00 | 9.93e+04 |
| Cs-134 | 7.10e+09 | 1.67e+10 | 7.75e+09 | 0.00e+00 | 5.31e+09 | 2.03e+09 | 2.08e+08 |
| Cs-134m | 5.95e+00 | 1.23e+01 | 6.33e+00 | 0.00e+00 | 6.86e+00 | 1.20e+00 | 8.20e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

Ri factors for Teen age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 2.53e+09 | 2.32e+09 | 5.42e+08 | 0.00e+00 | 8.84e+08 | 3.20e+08 | 4.05e+07 |
| Cs-136 | 4.37e+07 | 1.72e+08 | 1.15e+08 | 0.00e+00 | 9.36e+07 | 1.48e+07 | 1.38e+07 |
| Cs-137 | 1.01e+10 | 1.35e+10 | 4.69e+09 | 0.00e+00 | 4.59e+09 | 1.78e+09 | 1.92e+08 |
| Cs-138 | 3.13e-11 | 6.01e-11 | 3.00e-11 | 0.00e+00 | 4.44e-11 | 5.16e-12 | 2.73e-14 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 2.54e-02 | 1.79e-05 | 7.40e-04 | 0.00e+00 | 1.69e-05 | 1.23e-05 | 2.27e-01 |
| Ba-140 | 1.38e+08 | 1.69e+05 | 8.89e+06 | 0.00e+00 | 5.73e+04 | 1.14e+05 | 2.13e+08 |
| Ba-141 | 8.36e-22 | 6.24e-25 | 2.79e-23 | 0.00e+00 | 5.79e-25 | 4.27e-25 | 1.78e-27 |
| Ba-142 | 3.57e-39 | 0.00e+00 | 2.20e-40 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 1.80e+03 | 8.86e+02 | 2.36e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.09e+07 |
| La-141 | 5.59e-01 | 1.72e-01 | 2.84e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.05e+04 |
| La-142 | 1.77e-04 | 7.84e-05 | 1.95e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.39e+00 |
| Ce-141 | 2.83e+05 | 1.89e+05 | 2.17e+04 | 0.00e+00 | 8.89e+04 | 0.00e+00 | 5.40e+08 |
| Ce-143 | 9.30e+02 | 6.77e+05 | 7.56e+01 | 0.00e+00 | 3.04e+02 | 0.00e+00 | 2.04e+07 |
| Ce-144 | 5.27e+07 | 2.18e+07 | 2.83e+06 | 0.00e+00 | 1.30e+07 | 0.00e+00 | 1.33e+10 |
| Pr-143 | 7.00e+04 | 2.79e+04 | 3.48e+03 | 0.00e+00 | 1.62e+04 | 0.00e+00 | 2.30e+08 |
| Pr-144 | 2.22e-26 | 9.07e-27 | 1.12e-27 | 0.00e+00 | 5.20e-27 | 0.00e+00 | 2.44e-29 |
| Nd-147 | 3.62e+04 | 3.93e+04 | 2.36e+03 | 0.00e+00 | 2.31e+04 | 0.00e+00 | 1.42e+08 |
| Pm-147 | 9.04e+06 | 8.57e+05 | 3.49e+05 | 0.00e+00 | 1.64e+06 | 0.00e+00 | 8.15e+08 |
| Pm-148 | 1.83e+04 | 2.98e+03 | 1.50e+03 | 0.00e+00 | 5.39e+03 | 0.00e+00 | 1.78e+08 |
| Pm-148m | 1.17e+06 | 2.96e+05 | 2.31e+05 | 0.00e+00 | 4.48e+05 | 0.00e+00 | 1.86e+09 |
| Pm-149 | 1.58e+03 | 2.23e+02 | 9.13e+01 | 0.00e+00 | 4.24e+02 | 0.00e+00 | 3.28e+07 |
| Pm-151 | 3.13e+02 | 5.16e+01 | 2.61e+01 | 0.00e+00 | 9.28e+01 | 0.00e+00 | 1.16e+07 |
| Sm-151 | 7.92e+06 | 1.52e+06 | 3.58e+05 | 0.00e+00 | 1.67e+06 | 0.00e+00 | 5.17e+08 |
| Sm-153 | 7.66e+02 | 6.34e+02 | 4.67e+01 | 0.00e+00 | 2.07e+02 | 0.00e+00 | 1.79e+07 |
| Eu-152 | 2.20e+07 | 5.30e+06 | 4.67e+06 | 0.00e+00 | 2.46e+07 | 0.00e+00 | 1.95e+09 |
| Eu-154 | 7.18e+07 | 9.26e+06 | 6.53e+06 | 0.00e+00 | 4.14e+07 | 0.00e+00 | 4.89e+09 |
| Eu-155 | 1.46e+07 | 1.41e+06 | 8.73e+05 | 0.00e+00 | 5.52e+06 | 0.00e+00 | 8.09e+09 |
| Eu-156 | 1.24e+05 | 9.31e+04 | 1.52e+04 | 0.00e+00 | 6.26e+04 | 0.00e+00 | 4.76e+08 |
| Tb-160 | 2.94e+06 | 0.00e+00 | 3.66e+05 | 0.00e+00 | 1.16e+06 | 0.00e+00 | 1.90e+09 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Hc-166m | 3.24e+07 | 1.00e+07 | 7.23e+06 | 0.00e+00 | 1.46e+07 | 0.00e+00 | 2.46e+09 |
| W-181 | 8.47e+05 | 2.73e+05 | 2.86e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.33e+07 |
| W-185 | 2.70e+07 | 8.90e+06 | 9.41e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.69e+08 |
| W-187 | 3.53e+04 | 2.87e+04 | 1.01e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.78e+06 |
| Pb-210 | 1.63e+12 | 4.91e+11 | 6.33e+10 | 0.00e+00 | 1.55e+12 | 0.00e+00 | 2.14e+08 |
| Bi-210 | 1.11e+06 | 7.61e+06 | 6.36e+05 | 0.00e+00 | 9.25e+07 | 0.00e+00 | 8.69e+07 |
| Po-210 | 3.19e+10 | 6.71e+10 | 7.72e+09 | 0.00e+00 | 2.26e+11 | 0.00e+00 | 4.24e+09 |
| Ra-223 | 2.90e+10 | 4.40e+07 | 5.78e+09 | 0.00e+00 | 1.26e+09 | 0.00e+00 | 1.40e+09 |
| Ra-224 | 2.90e+09 | 6.94e+06 | 5.80e+08 | 0.00e+00 | 1.99e+08 | 0.00e+00 | 4.66e+08 |
| Ra-225 | 5.79e+10 | 6.80e+07 | 1.16e+10 | 0.00e+00 | 1.95e+09 | 0.00e+00 | 2.02e+09 |
| Ra-226 | 2.93e+13 | 7.39e+08 | 2.17e+13 | 0.00e+00 | 2.11e+10 | 0.00e+00 | 3.19e+10 |
| Ra-228 | 1.21e+13 | 3.91e+08 | 1.34e+13 | 0.00e+00 | 1.12e+10 | 0.00e+00 | 5.30e+09 |
| Ac-225 | 2.13e+07 | 2.91e+07 | 1.43e+06 | 0.00e+00 | 3.34e+06 | 0.00e+00 | 1.48e+09 |
| Ac-227 | 1.85e+11 | 2.74e+10 | 1.10e+10 | 0.00e+00 | 7.95e+09 | 0.00e+00 | 7.84e+09 |
| Th-227 | 1.77e+08 | 3.18e+06 | 5.11e+06 | 0.00e+00 | 1.82e+07 | 0.00e+00 | 5.20e+09 |
| Th-228 | 5.74e+10 | 9.62e+08 | 1.94e+09 | 0.00e+00 | 5.41e+09 | 0.00e+00 | 5.04e+10 |
| Th-229 | 1.30e+12 | 3.74e+10 | 2.15e+10 | 0.00e+00 | 1.81e+11 | 0.00e+00 | 7.53e+09 |
| Th-230 | 1.96e+11 | 1.12e+10 | 5.45e+09 | 0.00e+00 | 5.44e+10 | 0.00e+00 | 5.80e+09 |
| Th-232 | 2.20e+11 | 9.54e+09 | 1.48e+08 | 0.00e+00 | 4.64e+10 | 0.00e+00 | 4.93e+09 |
| Th-234 | 1.59e+06 | 9.30e+04 | 4.61e+04 | 0.00e+00 | 5.30e+05 | 0.00e+00 | 1.68e+09 |
| Pa-231 | 3.92e+11 | 1.47e+10 | 1.53e+10 | 0.00e+00 | 8.27e+10 | 0.00e+00 | 6.91e+09 |
| Pa-233 | 1.24e+05 | 2.38e+04 | 2.12e+04 | 0.00e+00 | 8.96e+04 | 0.00e+00 | 2.71e+08 |
| U-232 | 5.34e+11 | 0.00e+00 | 3.82e+10 | 0.00e+00 | 5.79e+10 | 0.00e+00 | 6.52e+09 |
| U-233 | 1.13e+11 | 0.00e+00 | 6.85e+09 | 0.00e+00 | 2.64e+10 | 0.00e+00 | 6.04e+09 |
| U-234 | 1.08e+11 | 0.00e+00 | 6.72e+09 | 0.00e+00 | 2.59e+10 | 0.00e+00 | 5.92e+09 |
| U-235 | 1.04e+11 | 0.00e+00 | 6.31e+09 | 0.00e+00 | 2.43e+10 | 0.00e+00 | 7.53e+09 |
| U-236 | 1.04e+11 | 0.00e+00 | 6.44e+09 | 0.00e+00 | 2.48e+10 | 0.00e+00 | 5.55e+09 |
| U-237 | 1.74e+05 | 0.00e+00 | 4.64e+04 | 0.00e+00 | 7.16e+05 | 0.00e+00 | 4.62e+07 |
| U-238 | 9.91e+10 | 0.00e+00 | 5.90e+09 | 0.00e+00 | 2.27e+10 | 0.00e+00 | 5.30e+09 |
| Np-237 | 1.21e+11 | 8.68e+09 | 5.32e+09 | 0.00e+00 | 3.94e+10 | 0.00e+00 | 7.64e+09 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.36e+04 | 3.63e+02 | 2.11e+02 | 0.00e+00 | 1.24e+03 | 0.00e+00 | 2.66e+07 |
| Np-239 | 1.38e+03 | 1.31e+02 | 7.25e+01 | 0.00e+00 | 4.10e+02 | 0.00e+00 | 2.10e+07 |
| Pu-238 | 6.08e+10 | 7.79e+09 | 1.65e+09 | 0.00e+00 | 7.08e+09 | 0.00e+00 | 7.01e+09 |
| Pu-239 | 6.95e+10 | 8.44e+09 | 1.83e+09 | 0.00e+00 | 7.79e+09 | 0.00e+00 | 6.42e+09 |
| Pu-240 | 6.94e+10 | 8.42e+09 | 1.83e+09 | 0.00e+00 | 7.78e+09 | 0.00e+00 | 6.53e+09 |
| Pu-241 | 1.58e+09 | 7.56e+07 | 3.32e+07 | 0.00e+00 | 1.54e+08 | 0.00e+00 | 1.33e+08 |
| Pu-242 | 6.44e+10 | 8.13e+09 | 1.76e+09 | 0.00e+00 | 7.50e+09 | 0.00e+00 | 6.29e+09 |
| Pu-244 | 7.53e+10 | 9.27e+09 | 2.02e+09 | 0.00e+00 | 8.59e+09 | 0.00e+00 | 9.36e+09 |
| Am-241 | 7.02e+10 | 6.62e+10 | 5.06e+09 | 0.00e+00 | 3.79e+10 | 0.00e+00 | 6.92e+09 |
| Am-242m | 7.33e+10 | 6.46e+10 | 5.27e+09 | 0.00e+00 | 3.90e+10 | 0.00e+00 | 8.99e+09 |
| Am-243 | 7.23e+10 | 6.68e+10 | 5.11e+09 | 0.00e+00 | 3.84e+10 | 0.00e+00 | 8.39e+09 |
| Cm-242 | 1.95e+09 | 2.06e+09 | 1.29e+08 | 0.00e+00 | 5.90e+08 | 0.00e+00 | 5.57e+09 |
| Cm-243 | 5.88e+10 | 5.45e+10 | 3.70e+09 | 0.00e+00 | 1.73e+10 | 0.00e+00 | 7.49e+09 |
| Cm-244 | 4.54e+10 | 4.30e+10 | 2.88e+09 | 0.00e+00 | 1.34e+10 | 0.00e+00 | 7.21e+09 |
| Cm-245 | 9.00e+10 | 7.92e+10 | 5.54e+09 | 0.00e+00 | 2.59e+10 | 0.00e+00 | 6.78e+09 |
| Cm-246 | 8.92e+10 | 7.91e+10 | 5.53e+09 | 0.00e+00 | 2.58e+10 | 0.00e+00 | 6.66e+09 |
| Cm-247 | 8.70e+10 | 7.79e+10 | 5.45e+09 | 0.00e+00 | 2.54e+10 | 0.00e+00 | 8.75e+09 |
| Cm-248 | 7.23e+11 | 6.42e+11 | 4.50e+10 | 0.00e+00 | 2.10e+11 | 0.00e+00 | 1.41e+11 |
| Cf-252 | 2.98e+10 | 0.00e+00 | 7.18e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.62e+10 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Child age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 2.29e+03 | 2.29e+03 | 2.29e+03 | 2.29e+03 | 2.29e+03 | 2.29e+03 |
| Be-10 | 9.92e+08 | 1.15e+08 | 2.49e+07 | 0.00e+00 | 8.16e+07 | 0.00e+00 | 2.02e+09 |
| C-14 | 8.89e+08 | 1.78e+08 | 1.78e+08 | 1.78e+08 | 1.78e+08 | 1.78e+08 | 1.78e+08 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 6.90e+00 | 0.00e+00 | 6.84e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.87e+00 |
| Na-22 | 4.09e+09 | 4.09e+09 | 4.09e+09 | 4.09e+09 | 4.09e+09 | 4.09e+09 | 4.09e+09 |
| Na-24 | 3.71e+05 | 3.71e+05 | 3.71e+05 | 3.71e+05 | 3.71e+05 | 3.71e+05 | 3.71e+05 |
| P-32 | 3.37e+09 | 1.58e+08 | 1.30e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.30e+07 |
| Ca-41 | 2.55e+10 | 0.00e+00 | 2.79e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.40e+07 |
| Sc-46 | 7.85e+05 | 1.08e+06 | 4.14e+05 | 0.00e+00 | 9.52e+05 | 0.00e+00 | 1.57e+09 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.17e+05 | 6.50e+04 | 1.78e+04 | 1.19e+05 | 6.21e+06 |
| Mn-54 | 0.00e+00 | 6.65e+08 | 1.77e+08 | 0.00e+00 | 1.86e+08 | 0.00e+00 | 5.58e+08 |
| Mn-56 | 0.00e+00 | 1.81e+01 | 4.08e+00 | 0.00e+00 | 2.19e+01 | 0.00e+00 | 2.62e+03 |
| Fe-55 | 8.01e+08 | 4.25e+08 | 1.32e+08 | 0.00e+00 | 0.00e+00 | 2.40e+08 | 7.87e+07 |
| Fe-59 | 3.97e+08 | 6.43e+08 | 3.20e+08 | 0.00e+00 | 0.00e+00 | 1.86e+08 | 6.69e+08 |
| Co-57 | 0.00e+00 | 2.98e+07 | 6.04e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.44e+08 |
| Co-58 | 0.00e+00 | 6.44e+07 | 1.97e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.75e+08 |
| Co-60 | 0.00e+00 | 3.78e+08 | 1.12e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.10e+09 |
| Ni-59 | 2.95e+09 | 7.86e+08 | 5.01e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.22e+07 |
| Ni-63 | 3.95e+10 | 2.11e+09 | 1.34e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.42e+08 |
| Ni-65 | 1.02e+02 | 9.59e+00 | 5.60e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.17e+03 |
| Cu-64 | 0.00e+00 | 1.09e+04 | 6.60e+03 | 0.00e+00 | 2.64e+04 | 0.00e+00 | 5.13e+05 |
| Zn-65 | 8.12e+08 | 2.16e+09 | 1.35e+09 | 0.00e+00 | 1.36e+09 | 0.00e+00 | 3.80e+08 |
| Zn-69 | 8.73e-06 | 1.26e-05 | 1.17e-06 | 0.00e+00 | 7.66e-06 | 0.00e+00 | 7.96e-04 |
| Zn-69m | 3.81e+04 | 6.49e+04 | 7.67e+03 | 0.00e+00 | 3.77e+04 | 0.00e+00 | 2.11e+06 |
| Se-79 | 0.00e+00 | 6.20e+08 | 1.37e+08 | 0.00e+00 | 1.01e+09 | 0.00e+00 | 4.06e+07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 2.03e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 5.20e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 3.30e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Child age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 4.52e+08 | 2.78e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.90e+07 |
| Rb-87 | 0.00e+00 | 2.90e+09 | 1.35e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.35e+07 |
| Rb-88 | 0.00e+00 | 3.37e-22 | 2.34e-22 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.65e-23 |
| Rb-89 | 0.00e+00 | 3.42e-26 | 3.04e-26 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.98e-28 |
| Sr-89 | 3.59e+10 | 0.00e+00 | 1.03e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.39e+09 |
| Sr-90 | 1.87e+12 | 0.00e+00 | 3.77e+10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.67e+10 |
| Sr-91 | 5.20e+05 | 0.00e+00 | 1.96e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.15e+06 |
| Sr-92 | 7.07e+02 | 0.00e+00 | 2.84e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.34e+04 |
| Y-90 | 2.30e+04 | 0.00e+00 | 6.17e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.56e+07 |
| Y-91 | 1.86e+07 | 0.00e+00 | 4.98e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.48e+09 |
| Y-91m | 8.12e-09 | 0.00e+00 | 2.95e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.59e-05 |
| Y-92 | 1.55e+00 | 0.00e+00 | 4.43e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.48e+04 |
| Y-93 | 2.91e+02 | 0.00e+00 | 7.98e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.34e+06 |
| Zr-93 | 1.23e+07 | 4.59e+05 | 3.27e+05 | 0.00e+00 | 1.78e+06 | 0.00e+00 | 1.74e+08 |
| Zr-95 | 3.86e+06 | 8.48e+05 | 7.54e+05 | 0.00e+00 | 1.21e+06 | 0.00e+00 | 8.84e+08 |
| Zr-97 | 5.68e+02 | 8.20e+01 | 4.84e+01 | 0.00e+00 | 1.18e+02 | 0.00e+00 | 1.24e+07 |
| Nb-93m | 7.64e+06 | 1.91e+06 | 6.26e+05 | 0.00e+00 | 2.06e+06 | 0.00e+00 | 2.87e+08 |
| Nb-95 | 4.10e+05 | 1.60e+05 | 1.14e+05 | 0.00e+00 | 1.50e+05 | 0.00e+00 | 2.95e+08 |
| Nb-97 | 4.80e-06 | 8.68e-07 | 4.05e-07 | 0.00e+00 | 9.63e-07 | 0.00e+00 | 2.68e-01 |
| Mo-93 | 0.00e+00 | 1.77e+09 | 6.36e+07 | 0.00e+00 | 4.67e+08 | 0.00e+00 | 8.97e+07 |
| Mo-99 | 0.00e+00 | 7.70e+06 | 1.91e+06 | 0.00e+00 | 1.64e+07 | 0.00e+00 | 6.37e+06 |
| Tc-101 | 1.02e-30 | 1.06e-30 | 1.35e-29 | 0.00e+00 | 1.81e-29 | 5.62e-31 | 3.38e-30 |
| Tc-99 | 3.93e+07 | 4.38e+07 | 1.57e+07 | 0.00e+00 | 5.16e+08 | 3.87e+06 | 4.59e+08 |
| Tc-99m | 4.65e+00 | 9.12e+00 | 1.51e+02 | 0.00e+00 | 1.32e+02 | 4.63e+00 | 5.19e+03 |
| Ru-103 | 1.53e+07 | 0.00e+00 | 5.89e+06 | 0.00e+00 | 3.86e+07 | 0.00e+00 | 3.96e+08 |
| Ru-105 | 9.01e+01 | 0.00e+00 | 3.27e+01 | 0.00e+00 | 7.92e+02 | 0.00e+00 | 5.88e+04 |
| Ru-106 | 7.45e+08 | 0.00e+00 | 9.30e+07 | 0.00e+00 | 1.01e+09 | 0.00e+00 | 1.16e+10 |
| Rh-105 | 1.38e+05 | 7.43e+04 | 6.35e+04 | 0.00e+00 | 2.96e+05 | 0.00e+00 | 4.60e+06 |
| Pd-107 | 0.00e+00 | 3.47e+07 | 2.95e+06 | 0.00e+00 | 2.90e+08 | 0.00e+00 | 6.89e+07 |
| Pd-109 | 0.00e+00 | 2.90e+04 | 8.69e+03 | 0.00e+00 | 1.55e+05 | 0.00e+00 | 1.71e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Child age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 3.21e+07 | 2.17e+07 | 1.73e+07 | 0.00e+00 | 4.04e+07 | 0.00e+00 | 2.58e+09 |
| Ag-111 | 3.78e+05 | 1.18e+05 | 7.81e+04 | 0.00e+00 | 3.57e+05 | 0.00e+00 | 7.25e+07 |
| Cd-113m | 0.00e+00 | 7.42e+08 | 3.16e+07 | 0.00e+00 | 7.64e+08 | 0.00e+00 | 1.91e+09 |
| Cd-115m | 0.00e+00 | 1.42e+08 | 6.04e+06 | 0.00e+00 | 1.05e+08 | 0.00e+00 | 1.93e+09 |
| Sn-123 | 6.54e+09 | 8.11e+07 | 1.59e+08 | 8.60e+07 | 0.00e+00 | 0.00e+00 | 3.20e+09 |
| Sr-125 | 7.43e+07 | 1.12e+06 | 3.33e+06 | 1.16e+06 | 0.00e+00 | 0.00e+00 | 2.30e+08 |
| Sr-126 | 2.45e+10 | 3.05e+08 | 6.95e+08 | 8.38e+07 | 0.00e+00 | 0.00e+00 | 1.84e+09 |
| St-124 | 3.52e+08 | 4.56e+06 | 1.23e+08 | 7.76e+05 | 0.00e+00 | 1.95e+08 | 2.20e+09 |
| St-125 | 4.99e+08 | 3.85e+06 | 1.05e+08 | 4.62e+05 | 0.00e+00 | 2.78e+08 | 1.19e+09 |
| St-126 | 1.40e+07 | 2.15e+05 | 5.04e+06 | 8.24e+04 | 0.00e+00 | 6.70e+06 | 2.83e+08 |
| St-127 | 8.72e+05 | 1.35e+04 | 3.03e+05 | 9.71e+03 | 0.00e+00 | 3.78e+05 | 4.91e+07 |
| Te-125m | 3.50e+08 | 9.50e+07 | 4.67e+07 | 9.83e+07 | 0.00e+00 | 0.00e+00 | 3.38e+08 |
| Te-127 | 9.76e+03 | 2.63e+03 | 2.09e+03 | 6.76e+03 | 2.78e+04 | 0.00e+00 | 3.81e+05 |
| Te-127m | 1.32e+09 | 3.56e+08 | 1.57e+08 | 3.16e+08 | 3.77e+09 | 0.00e+00 | 1.07e+09 |
| Te-129 | 1.24e-03 | 3.45e-04 | 2.94e-04 | 8.82e-04 | 3.62e-03 | 0.00e+00 | 7.70e-02 |
| Te-129m | 8.40e+08 | 2.35e+08 | 1.30e+08 | 2.71e+08 | 2.47e+09 | 0.00e+00 | 1.03e+09 |
| Te-131 | 2.14e-15 | 6.51e-16 | 6.35e-16 | 1.63e-15 | 6.46e-15 | 0.00e+00 | 1.12e-14 |
| Te-131m | 1.54e+06 | 5.32e+05 | 5.66e+05 | 1.09e+06 | 5.15e+06 | 0.00e+00 | 2.16e+07 |
| Te-132 | 6.99e+06 | 3.10e+06 | 3.74e+06 | 4.51e+06 | 2.87e+07 | 0.00e+00 | 3.12e+07 |
| Te-133m | 3.48e-05 | 1.41e-05 | 1.74e-05 | 2.70e-05 | 1.34e-04 | 0.00e+00 | 1.07e-03 |
| Te-134 | 5.16e-08 | 2.32e-08 | 3.10e-08 | 4.08e-08 | 2.15e-07 | 0.00e+00 | 2.36e-07 |
| I-129 | 5.11e+09 | 3.13e+09 | 2.80e+09 | 2.05e+12 | 5.29e+09 | 0.00e+00 | 1.58e+08 |
| I-130 | 6.12e+05 | 1.24e+06 | 6.37e+05 | 1.36e+08 | 1.85e+06 | 0.00e+00 | 5.78e+05 |
| I-131 | 1.43e+08 | 1.44e+08 | 8.16e+07 | 4.75e+10 | 2.36e+08 | 0.00e+00 | 1.28e+07 |
| I-132 | 8.91e+01 | 1.64e+02 | 7.53e+01 | 7.60e+03 | 2.51e+02 | 0.00e+00 | 1.93e+02 |
| I-133 | 3.52e+06 | 4.35e+06 | 1.65e+06 | 8.08e+08 | 7.25e+06 | 0.00e+00 | 1.75e+06 |
| I-134 | 1.42e-04 | 2.64e-04 | 1.21e-04 | 6.07e-03 | 4.03e-04 | 0.00e+00 | 1.75e-04 |
| I-135 | 6.18e+04 | 1.11e+05 | 5.26e+04 | 9.86e+06 | 1.71e+05 | 0.00e+00 | 8.48e+04 |
| Cs-134 | 1.60e+10 | 2.63e+10 | 5.55e+09 | 0.00e+00 | 8.15e+09 | 2.93e+09 | 1.42e+08 |
| Cs-134m | 1.06e+01 | 1.57e+01 | 1.02e+01 | 0.00e+00 | 8.26e+00 | 1.37e+00 | 1.98e+01 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 6.10e+09 | 4.25e+09 | 4.36e+08 | 0.00e+00 | 1.50e+09 | 5.01e+08 | 3.18e+07 |
| Cs-136 | 8.23e+07 | 2.26e+08 | 1.46e+08 | 0.00e+00 | 1.21e+08 | 1.80e+07 | 7.95e+06 |
| Cs-137 | 2.39e+10 | 2.29e+10 | 3.38e+09 | 0.00e+00 | 7.46e+09 | 2.68e+09 | 1.43e+08 |
| Cs-138 | 5.69e-11 | 7.91e-11 | 5.02e-11 | 0.00e+00 | 5.57e-11 | 5.99e-12 | 3.64e-11 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 4.69e-02 | 2.50e-05 | 1.36e-03 | 0.00e+00 | 2.18e-05 | 1.47e-05 | 2.70e+00 |
| Ba-140 | 2.76e+08 | 2.42e+05 | 1.61e+07 | 0.00e+00 | 7.88e+04 | 1.44e+05 | 1.40e+08 |
| Ba-141 | 1.54e-21 | 8.64e-25 | 5.02e-23 | 0.00e+00 | 7.47e-25 | 5.07e-24 | 8.79e-22 |
| Ba-142 | 6.46e-39 | 0.00e+00 | 3.61e-40 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 3.24e+03 | 1.13e+03 | 3.82e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.16e+07 |
| La-141 | 1.04e+00 | 2.41e-01 | 5.24e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.37e+04 |
| La-142 | 3.20e-04 | 1.02e-04 | 3.19e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.02e+01 |
| Ce-141 | 6.55e+05 | 3.27e+05 | 4.85e+04 | 0.00e+00 | 1.43e+05 | 0.00e+00 | 4.08e+08 |
| Ce-143 | 1.71e+03 | 9.29e+05 | 1.35e+02 | 0.00e+00 | 3.90e+02 | 0.00e+00 | 1.36e+07 |
| Ce-144 | 1.27e+08 | 3.98e+07 | 6.78e+06 | 0.00e+00 | 2.21e+07 | 0.00e+00 | 1.04e+10 |
| Pr-143 | 1.45e+05 | 4.37e+04 | 7.22e+03 | 0.00e+00 | 2.36e+04 | 0.00e+00 | 1.57e+08 |
| Pr-144 | 4.11e-26 | 1.27e-26 | 2.07e-27 | 0.00e+00 | 6.73e-27 | 0.00e+00 | 2.74e-23 |
| Nd-147 | 7.14e+04 | 5.78e+04 | 4.48e+03 | 0.00e+00 | 3.17e+04 | 0.00e+00 | 9.16e+07 |
| Pm-147 | 2.21e+07 | 1.58e+06 | 8.48e+05 | 0.00e+00 | 2.79e+06 | 0.00e+00 | 6.39e+08 |
| Pm-148 | 3.36e+04 | 4.04e+03 | 2.62e+03 | 0.00e+00 | 6.87e+03 | 0.00e+00 | 1.08e+08 |
| Pm-148m | 2.28e+06 | 4.54e+05 | 4.54e+05 | 0.00e+00 | 6.73e+05 | 0.00e+00 | 1.28e+09 |
| Pm-149 | 2.93e+03 | 3.12e+02 | 1.69e+02 | 0.00e+00 | 5.52e+02 | 0.00e+00 | 2.13e+07 |
| Pm-151 | 5.72e+02 | 6.96e+01 | 4.53e+01 | 0.00e+00 | 1.18e+02 | 0.00e+00 | 7.90e+06 |
| Sm-151 | 1.88e+07 | 2.80e+06 | 8.81e+05 | 0.00e+00 | 2.89e+06 | 0.00e+00 | 4.06e+08 |
| Sm-153 | 1.42e+03 | 8.83e+02 | 8.51e+01 | 0.00e+00 | 2.69e+02 | 0.00e+00 | 1.17e+07 |
| Eu-152 | 4.47e+07 | 8.14e+06 | 9.66e+06 | 0.00e+00 | 3.44e+07 | 0.00e+00 | 1.34e+09 |
| Eu-154 | 1.69e+08 | 1.52e+07 | 1.39e+07 | 0.00e+00 | 6.68e+07 | 0.00e+00 | 3.53e+09 |
| Eu-155 | 3.27e+07 | 2.35e+06 | 1.84e+06 | 0.00e+00 | 8.82e+06 | 0.00e+00 | 5.89e+09 |
| Eu-156 | 2.58e+05 | 1.38e+05 | 2.86e+04 | 0.00e+00 | 8.89e+04 | 0.00e+00 | 3.13e+08 |
| Tb-160 | 6.01e+06 | 0.00e+00 | 7.46e+05 | 0.00e+00 | 1.79e+06 | 0.00e+00 | 1.33e+09 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ho-166m | 7.94e+07 | 1.66e+07 | 1.40e+07 | 0.00e+00 | 2.37e+07 | 0.00e+00 | 1.93e+09 |
| W-181 | 2.03e+06 | 4.98e+05 | 6.85e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.81e+07 |
| W-185 | 6.44e+07 | 1.61e+07 | 2.25e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.99e+08 |
| W-187 | 6.41e+04 | 3.80e+04 | 1.70e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.34e+06 |
| Pb-210 | 3.47e+12 | 8.90e+11 | 1.53e+11 | 0.00e+00 | 2.68e+12 | 0.00e+00 | 1.68e+08 |
| Bi-210 | 2.06e+06 | 1.07e+07 | 1.18e+06 | 0.00e+00 | 1.20e+08 | 0.00e+00 | 5.41e+07 |
| Pc-210 | 7.66e+10 | 1.23e+11 | 1.85e+10 | 0.00e+00 | 3.81e+11 | 0.00e+00 | 3.30e+09 |
| Ra-223 | 5.77e+10 | 6.67e+07 | 1.15e+10 | 0.00e+00 | 1.77e+09 | 0.00e+00 | 9.20e+08 |
| Ra-224 | 5.36e+09 | 9.73e+06 | 1.07e+09 | 0.00e+00 | 2.58e+08 | 0.00e+00 | 2.94e+08 |
| Ra-225 | 1.22e+11 | 1.09e+09 | 2.44e+10 | 0.00e+00 | 2.89e+09 | 0.00e+00 | 1.40e+09 |
| Ra-226 | 4.23e+13 | 1.35e+09 | 3.47e+13 | 0.00e+00 | 3.59e+10 | 0.00e+00 | 2.51e+10 |
| Ra-228 | 2.76e+13 | 7.16e+08 | 3.10e+13 | 0.00e+00 | 1.90e+10 | 0.00e+00 | 4.16e+09 |
| Ac-225 | 4.16e+07 | 4.29e+07 | 2.79e+06 | 0.00e+00 | 4.58e+06 | 0.00e+00 | 9.54e+08 |
| Ac-227 | 3.01e+11 | 4.84e+10 | 1.86e+10 | 0.00e+00 | 1.07e+10 | 0.00e+00 | 6.16e+09 |
| Th-227 | 3.88e+08 | 5.28e+06 | 1.12e+07 | 0.00e+00 | 2.80e+07 | 0.00e+00 | 3.73e+09 |
| Th-228 | 1.41e+11 | 1.81e+09 | 4.77e+09 | 0.00e+00 | 9.40e+09 | 0.00e+00 | 3.95e+10 |
| Th-229 | 1.73e+12 | 4.34e+10 | 2.88e+10 | 0.00e+00 | 2.12e+11 | 0.00e+00 | 5.91e+09 |
| Th-230 | 2.61e+11 | 1.31e+10 | 7.28e+09 | 0.00e+00 | 6.37e+10 | 0.00e+00 | 4.55e+09 |
| Th-232 | 2.91e+11 | 1.12e+10 | 2.21e+08 | 0.00e+00 | 5.45e+10 | 0.00e+00 | 3.87e+09 |
| Th-234 | 3.61e+06 | 1.59e+05 | 1.04e+05 | 0.00e+00 | 8.46e+05 | 0.00e+00 | 1.25e+09 |
| Pa-231 | 5.20e+11 | 1.72e+10 | 2.07e+10 | 0.00e+00 | 9.41e+10 | 0.00e+00 | 5.42e+09 |
| Pa-233 | 2.34e+05 | 3.65e+04 | 4.09e+04 | 0.00e+00 | 1.34e+05 | 0.00e+00 | 1.86e+08 |
| U-232 | 1.29e+12 | 0.00e+00 | 9.24e+10 | 0.00e+00 | 9.83e+10 | 0.00e+00 | 5.12e+09 |
| U-233 | 2.73e+11 | 0.00e+00 | 1.65e+10 | 0.00e+00 | 4.48e+10 | 0.00e+00 | 4.74e+09 |
| U-234 | 2.62e+11 | 0.00e+00 | 1.62e+10 | 0.00e+00 | 4.40e+10 | 0.00e+00 | 4.65e+09 |
| U-235 | 2.51e+11 | 0.00e+00 | 1.52e+10 | 0.00e+00 | 4.12e+10 | 0.00e+00 | 5.90e+09 |
| U-236 | 2.51e+11 | 0.00e+00 | 1.56e+10 | 0.00e+00 | 4.21e+10 | 0.00e+00 | 4.35e+09 |
| U-237 | 3.26e+05 | 0.00e+00 | 8.65e+04 | 0.00e+00 | 9.39e+05 | 0.00e+00 | 2.87e+07 |
| U-238 | 2.40e+11 | 0.00e+00 | 1.43e+10 | 0.00e+00 | 3.85e+10 | 0.00e+00 | 4.16e+09 |
| Np-237 | 1.64e+11 | 1.08e+10 | 7.20e+09 | 0.00e+00 | 4.45e+10 | 0.00e+00 | 6.00e+09 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 2.51e+04 | 5.08e+02 | 3.91e+02 | 0.00e+00 | 1.62e+03 | 0.00e+00 | 1.74e+07 |
| Np-239 | 2.56e+03 | 1.84e+02 | 1.29e+02 | 0.00e+00 | 5.31e+02 | 0.00e+00 | 1.36e+07 |
| Pu-238 | 8.73e+10 | 1.01e+10 | 2.32e+09 | 0.00e+00 | 8.44e+09 | 0.00e+00 | 5.50e+09 |
| Pu-239 | 9.48e+10 | 1.01e+10 | 2.43e+09 | 0.00e+00 | 8.97e+09 | 0.00e+00 | 5.03e+09 |
| Pu-240 | 9.41e+10 | 1.05e+10 | 2.43e+09 | 0.00e+00 | 8.97e+09 | 0.00e+00 | 5.13e+09 |
| Pu-241 | 2.82e+09 | 1.15e+08 | 5.85e+07 | 0.00e+00 | 2.15e+08 | 0.00e+00 | 1.05e+08 |
| Pu-242 | 8.75e+10 | 1.01e+10 | 2.34e+09 | 0.00e+00 | 8.60e+09 | 0.00e+00 | 4.93e+09 |
| Pu-244 | 1.02e+11 | 1.16e+11 | 2.68e+09 | 0.00e+00 | 9.92e+09 | 0.00e+00 | 7.35e+09 |
| Am-241 | 9.67e+10 | 8.32e+10 | 7.25e+09 | 0.00e+00 | 4.43e+10 | 0.00e+00 | 5.43e+09 |
| Am-242m | 1.03e+11 | 8.22e+10 | 7.64e+09 | 0.00e+00 | 4.63e+10 | 0.00e+00 | 7.06e+09 |
| Am-243 | 9.85e+10 | 8.31e+10 | 7.23e+09 | 0.00e+00 | 4.45e+10 | 0.00e+00 | 6.58e+09 |
| Cm-242 | 4.69e+09 | 3.74e+09 | 3.12e+08 | 0.00e+00 | 9.98e+08 | 0.00e+00 | 4.35e+09 |
| Cm-243 | 9.36e+10 | 7.61e+10 | 6.03e+09 | 0.00e+00 | 2.25e+10 | 0.00e+00 | 5.87e+09 |
| Cm-244 | 7.87e+10 | 6.37e+10 | 5.05e+09 | 0.00e+00 | 1.85e+10 | 0.00e+00 | 5.67e+09 |
| Cm-245 | 1.23e+11 | 9.85e+10 | 7.72e+09 | 0.00e+00 | 3.02e+10 | 0.00e+00 | 5.32e+09 |
| Cm-246 | 1.21e+11 | 9.85e+10 | 7.72e+09 | 0.00e+00 | 3.01e+10 | 0.00e+00 | 5.23e+09 |
| Cm-247 | 1.18e+11 | 9.70e+10 | 7.57e+09 | 0.00e+00 | 2.97e+10 | 0.00e+00 | 6.87e+09 |
| Cm-248 | 9.85e+11 | 8.01e+11 | 6.26e+10 | 0.00e+00 | 2.45e+11 | 0.00e+00 | 1.11e+11 |
| Cf-252 | 7.28e+10 | 0.00e+00 | 1.76e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.05e+10 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Be-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| C-14 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Na-22 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Na-24 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| P-32 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ca-41 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sc-46 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mn-54 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mn-56 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Fe-55 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Fe-59 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Co-57 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Co-58 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Co-60 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ni-59 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ni-63 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ni-65 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cu-64 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zn-65 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zn-69 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zn-69m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Se-79 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-82 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Infant age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-87 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-90 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-91 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-92 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-90 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-91 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-91m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-92 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Y-93 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zr-93 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zr-95 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Zr-97 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nb-93m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nb-95 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nb-97 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mo-93 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Mo-99 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ru-103 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ru-105 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ru-106 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rh-105 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pd-107 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pd-109 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ag-111 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cd-113m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cd-115m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sn-123 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sn-125 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sn-126 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sb-124 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sb-125 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sb-126 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sb-127 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-125m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-127 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-127m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-129 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-129m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-131 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-131m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-132 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-133m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Te-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-129 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-130 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-131 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-132 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-133 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| I-135 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-134 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-134m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Infant age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-136 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-137 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-138 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-140 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ce-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ce-143 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ce-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pr-143 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-147 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-148 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-148m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-149 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pm-151 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sm-151 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sm-153 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Eu-152 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Eu-154 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Eu-155 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Eu-156 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tb-160 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Infant age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| W-181 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| W-185 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| W-187 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pb-210 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Bi-210 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Po-210 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-223 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-224 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-225 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-226 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ra-228 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ac-225 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ac-227 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-227 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-228 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-229 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-230 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-232 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Th-234 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pa-231 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pa-233 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-232 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-233 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-234 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-235 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-236 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-237 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| U-238 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Np-237 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**LEAFY VEGETABLE PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.

Waterford Steam Electric Station

Pathway : Gaseous Release Leafy/Produce Vegetation Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Np-239 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-238 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-239 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-240 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-241 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-242 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Pu-244 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Am-241 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Am-242m | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Am-243 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-242 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-243 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-244 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-245 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-246 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-247 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cm-248 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Cf-252 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 8.88e+02 | 8.88e+02 | 8.88e+02 | 8.88e+02 | 8.88e+02 | 8.88e+02 |
| Be-10 | 2.95e+05 | 4.55e+04 | 7.36e+03 | 0.00e+00 | 3.44e+04 | 0.00e+00 | 2.49e+06 |
| C-14 | 2.63e+08 | 5.27e+07 | 5.27e+07 | 5.27e+07 | 5.27e+07 | 5.27e+07 | 5.27e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 5.58e-04 | 0.00e+00 | 6.19e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.65e-05 |
| Na-22 | 6.35e+08 | 6.35e+08 | 6.35e+08 | 6.35e+08 | 6.35e+08 | 6.35e+08 | 6.35e+08 |
| Na-24 | 2.93e+05 | 2.93e+05 | 2.93e+05 | 2.93e+05 | 2.93e+05 | 2.93e+05 | 2.93e+05 |
| P-32 | 2.05e+10 | 1.28e+09 | 7.93e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.31e+09 |
| Ca-41 | 1.37e+09 | 0.00e+00 | 1.48e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.37e+06 |
| Sc-46 | 2.15e+01 | 4.18e+01 | 1.22e+01 | 0.00e+00 | 3.90e+01 | 0.00e+00 | 2.04e+05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 3.43e+03 | 2.05e+03 | 7.55e+02 | 4.55e+03 | 8.62e+05 |
| Mn-54 | 0.00e+00 | 1.01e+06 | 1.93e+05 | 0.00e+00 | 3.00e+05 | 0.00e+00 | 3.09e+06 |
| Mn-56 | 0.00e+00 | 4.98e-04 | 8.84e-05 | 0.00e+00 | 6.33e-04 | 0.00e+00 | 1.59e-02 |
| Fe-55 | 3.26e+05 | 2.26e+05 | 5.26e+04 | 0.00e+00 | 0.00e+00 | 1.26e+05 | 1.29e+05 |
| Fe-59 | 3.86e+05 | 9.07e+05 | 3.48e+05 | 0.00e+00 | 0.00e+00 | 2.54e+05 | 3.02e+06 |
| Co-57 | 0.00e+00 | 1.54e+05 | 2.55e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.89e+06 |
| Co-58 | 0.00e+00 | 5.66e+05 | 1.27e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.15e+07 |
| Co-60 | 0.00e+00 | 1.97e+06 | 4.34e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.70e+07 |
| Ni-59 | 6.06e+07 | 2.08e+07 | 1.01e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.29e+06 |
| Ni-63 | 8.07e+08 | 5.60e+07 | 2.71e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.17e+07 |
| Ni-65 | 4.51e-02 | 5.86e-03 | 2.67e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.49e-01 |
| Cu-64 | 0.00e+00 | 2.66e+03 | 1.25e+03 | 0.00e+00 | 6.72e+03 | 0.00e+00 | 2.27e+05 |
| Zn-65 | 1.65e+08 | 5.24e+08 | 2.37e+08 | 0.00e+00 | 3.50e+08 | 0.00e+00 | 3.30e+08 |
| Zn-69 | 2.62e-13 | 5.00e-13 | 3.48e-14 | 0.00e+00 | 3.25e-13 | 0.00e+00 | 7.52e-14 |
| Zn-69m | 2.18e+04 | 5.22e+04 | 4.78e+03 | 0.00e+00 | 3.16e+04 | 0.00e+00 | 3.19e+06 |
| Se-79 | 0.00e+00 | 1.10e+08 | 1.83e+07 | 0.00e+00 | 1.90e+08 | 0.00e+00 | 2.25e+07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 3.88e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.44e+06 |
| Br-83 | 0.00e+00 | 0.00e+00 | 1.18e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.71e-02 |
| Br-84 | 0.00e+00 | 0.00e+00 | 2.08e-24 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.63e-29 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

Ri factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 3.11e+08 | 1.45e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.14e+07 |
| Rb-87 | 0.00e+00 | 3.42e+08 | 1.19e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.60e+07 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 3.05e+09 | 0.00e+00 | 8.74e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.89e+08 |
| Sr-90 | 1.13e+11 | 0.00e+00 | 2.27e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.84e+09 |
| Sr-91 | 6.10e+04 | 0.00e+00 | 2.46e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.90e+05 |
| Sr-92 | 1.04e+00 | 0.00e+00 | 4.50e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.06e+01 |
| Y-90 | 8.51e+00 | 0.00e+00 | 2.28e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.02e+04 |
| Y-91 | 1.03e+03 | 0.00e+00 | 2.76e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.67e+05 |
| Y-91m | 7.52e-21 | 0.00e+00 | 2.91e-22 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.21e-20 |
| Y-92 | 6.77e-06 | 0.00e+00 | 1.98e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.19e-01 |
| Y-93 | 2.69e-02 | 0.00e+00 | 7.43e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.53e+02 |
| Zr-93 | 1.94e+02 | 1.09e+01 | 5.05e+00 | 0.00e+00 | 4.11e+01 | 0.00e+00 | 1.13e+04 |
| Zr-95 | 1.13e+02 | 3.63e+01 | 2.46e+01 | 0.00e+00 | 5.70e+01 | 0.00e+00 | 1.15e+05 |
| Zr-97 | 5.21e-02 | 1.05e-02 | 4.81e-03 | 0.00e+00 | 1.59e-02 | 0.00e+00 | 3.26e+03 |
| Nb-93m | 5.89e+04 | 1.92e+04 | 4.74e+03 | 0.00e+00 | 2.21e+04 | 0.00e+00 | 8.88e+06 |
| Nb-95 | 9.91e+03 | 5.51e+03 | 2.96e+03 | 0.00e+00 | 5.45e+03 | 0.00e+00 | 3.34e+07 |
| Nb-97 | 7.89e-13 | 2.00e-13 | 7.29e-14 | 0.00e+00 | 2.33e-13 | 0.00e+00 | 7.37e-10 |
| Mo-93 | 0.00e+00 | 5.22e+07 | 1.41e+06 | 0.00e+00 | 1.48e+07 | 0.00e+00 | 8.49e+06 |
| Mo-99 | 0.00e+00 | 2.97e+06 | 5.66e+05 | 0.00e+00 | 6.73e+06 | 0.00e+00 | 6.89e+06 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 2.90e+06 | 4.31e+06 | 1.16e+06 | 0.00e+00 | 5.43e+07 | 3.66e+05 | 1.41e+08 |
| Tc-99m | 4.01e-01 | 1.13e+00 | 1.44e+01 | 0.00e+00 | 1.72e+01 | 5.55e-01 | 6.71e+02 |
| Ru-103 | 1.22e+02 | 0.00e+00 | 5.26e+01 | 0.00e+00 | 4.66e+02 | 0.00e+00 | 1.43e+04 |
| Ru-105 | 1.04e-04 | 0.00e+00 | 4.09e-05 | 0.00e+00 | 1.34e-03 | 0.00e+00 | 6.34e-02 |
| Ru-106 | 2.45e+03 | 0.00e+00 | 3.10e+02 | 0.00e+00 | 4.73e+03 | 0.00e+00 | 1.58e+05 |
| Rh-105 | 4.15e+04 | 3.04e+04 | 2.00e+04 | 0.00e+00 | 1.29e+05 | 0.00e+00 | 4.84e+06 |
| Pd-107 | 0.00e+00 | 1.36e+06 | 8.72e+04 | 0.00e+00 | 1.22e+07 | 0.00e+00 | 8.45e+06 |
| Pd-109 | 0.00e+00 | 5.39e+03 | 1.22e+03 | 0.00e+00 | 3.08e+04 | 0.00e+00 | 5.97e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 6.99e+06 | 6.46e+06 | 3.84e+06 | 0.00e+00 | 1.27e+07 | 0.00e+00 | 2.64e+09 |
| Ag-111 | 7.77e+05 | 3.25e+05 | 1.62e+05 | 0.00e+00 | 1.05e+06 | 0.00e+00 | 5.96e+08 |
| Cd-113m | 0.00e+00 | 3.53e+05 | 1.13e+04 | 0.00e+00 | 3.88e+05 | 0.00e+00 | 2.84e+06 |
| Cd-115m | 0.00e+00 | 1.51e+05 | 4.82e+03 | 0.00e+00 | 1.20e+05 | 0.00e+00 | 6.36e+06 |
| Sr-123 | 6.43e+07 | 1.07e+06 | 1.57e+06 | 9.06e+05 | 0.00e+00 | 0.00e+00 | 1.31e+08 |
| Sr-125 | 6.81e+06 | 1.37e+05 | 3.09e+05 | 1.14e+05 | 0.00e+00 | 0.00e+00 | 8.50e+07 |
| Sr-126 | 1.96e+08 | 3.87e+06 | 5.56e+06 | 1.14e+06 | 0.00e+00 | 0.00e+00 | 5.63e+07 |
| Sb-124 | 3.09e+06 | 5.83e+04 | 1.22e+06 | 7.49e+03 | 0.00e+00 | 2.40e+06 | 8.77e+07 |
| Sb-125 | 2.45e+06 | 2.74e+04 | 5.84e+05 | 2.49e+03 | 0.00e+00 | 1.89e+06 | 2.70e+07 |
| Sb-126 | 6.75e+05 | 1.37e+04 | 2.44e+05 | 4.13e+03 | 0.00e+00 | 4.14e+05 | 5.52e+07 |
| Sb-127 | 5.44e+04 | 1.19e+03 | 2.09e+04 | 6.54e+02 | 0.00e+00 | 3.23e+04 | 1.24e+07 |
| Te-125m | 1.95e+06 | 7.08e+05 | 2.62e+05 | 5.88e+05 | 7.95e+06 | 0.00e+00 | 7.80e+06 |
| Te-127 | 7.87e+01 | 2.82e+01 | 1.70e+01 | 5.83e+01 | 3.20e+02 | 0.00e+00 | 6.21e+03 |
| Te-127m | 5.49e+06 | 1.96e+06 | 6.69e+05 | 1.40e+06 | 2.23e+07 | 0.00e+00 | 1.84e+07 |
| Te-129 | 3.50e-11 | 1.32e-11 | 8.53e-12 | 2.69e-11 | 1.47e-10 | 0.00e+00 | 2.64e-11 |
| Te-129m | 7.22e+06 | 2.69e+06 | 1.14e+06 | 2.48e+06 | 3.02e+07 | 0.00e+00 | 3.64e+07 |
| Te-131 | 4.74e-34 | 1.98e-34 | 1.50e-34 | 3.90e-34 | 2.08e-33 | 0.00e+00 | 6.72e-35 |
| Te-131m | 4.34e+04 | 2.12e+04 | 1.77e+04 | 3.36e+04 | 2.15e+05 | 0.00e+00 | 2.11e+06 |
| Te-132 | 2.88e+05 | 1.86e+05 | 1.75e+05 | 2.06e+05 | 1.80e+06 | 0.00e+00 | 8.82e+06 |
| Te-133m | 2.63e-14 | 1.54e-14 | 1.48e-14 | 2.23e-14 | 1.52e-13 | 0.00e+00 | 5.28e-15 |
| Te-134 | 1.13e-19 | 7.39e-20 | 4.53e-20 | 9.86e-20 | 7.14e-19 | 0.00e+00 | 1.25e-22 |
| I-129 | 9.10e+07 | 7.82e+07 | 2.56e+08 | 2.01e+11 | 1.68e+08 | 0.00e+00 | 1.24e+07 |
| I-130 | 5.06e+04 | 1.49e+05 | 5.89e+04 | 1.26e+07 | 2.33e+05 | 0.00e+00 | 1.28e+05 |
| I-131 | 3.55e+07 | 5.08e+07 | 2.91e+07 | 1.67e+10 | 8.71e+07 | 0.00e+00 | 1.34e+07 |
| I-132 | 2.00e-02 | 5.36e-02 | 1.88e-02 | 1.88e+00 | 8.54e-02 | 0.00e+00 | 1.01e-02 |
| I-133 | 4.65e+05 | 8.09e+05 | 2.47e+05 | 1.19e+08 | 1.41e+06 | 0.00e+00 | 7.27e+05 |
| I-134 | 2.53e-13 | 6.87e-13 | 2.46e-13 | 1.19e-11 | 1.09e-12 | 0.00e+00 | 5.99e-16 |
| I-135 | 1.55e+03 | 4.06e+03 | 1.50e+03 | 2.68e+05 | 6.51e+03 | 0.00e+00 | 4.58e+03 |
| Cs-134 | 1.70e+10 | 4.03e+10 | 3.30e+10 | 0.00e+00 | 1.31e+10 | 4.33e+09 | 7.06e+08 |
| Cs-134m | 5.28e-01 | 1.11e+00 | 5.68e-01 | 0.00e+00 | 6.02e-01 | 9.49e-02 | 3.92e-01 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT'S MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 5.43e+09 | 5.01e+09 | 2.22e+09 | 0.00e+00 | 1.89e+09 | 5.68e+08 | 1.17e+08 |
| Cs-136 | 7.90e+08 | 3.12e+09 | 2.24e+09 | 0.00e+00 | 1.73e+09 | 2.38e+08 | 3.54e+08 |
| Cs-137 | 2.21e+10 | 3.03e+10 | 1.98e+10 | 0.00e+00 | 1.03e+10 | 3.42e+09 | 5.86e+08 |
| Cs-138 | 2.91e-23 | 5.76e-23 | 2.85e-23 | 0.00e+00 | 4.23e-23 | 4.18e-24 | 2.46e-28 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 5.45e-09 | 3.88e-12 | 1.60e-10 | 0.00e+00 | 3.63e-12 | 2.20e-12 | 9.67e-09 |
| Ba-140 | 3.23e+06 | 4.05e+03 | 2.11e+05 | 0.00e+00 | 1.38e+03 | 2.32e+03 | 6.64e+06 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 5.42e-01 | 2.73e-01 | 7.22e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.00e+04 |
| La-141 | 3.60e-06 | 1.12e-06 | 1.83e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.33e-01 |
| La-142 | 2.28e-12 | 1.04e-12 | 2.59e-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.58e-09 |
| Ce-141 | 5.81e+02 | 3.93e+02 | 4.46e+01 | 0.00e+00 | 1.83e+02 | 0.00e+00 | 1.50e+06 |
| Ce-143 | 4.99e+00 | 3.69e+03 | 4.09e-01 | 0.00e+00 | 1.63e+00 | 0.00e+00 | 1.38e+05 |
| Ce-144 | 4.29e+04 | 1.79e+04 | 2.30e+03 | 0.00e+00 | 1.06e+04 | 0.00e+00 | 1.45e+07 |
| Pr-143 | 1.89e+01 | 7.60e+00 | 9.39e-01 | 0.00e+00 | 4.39e+00 | 0.00e+00 | 8.30e+04 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 1.13e+01 | 1.31e+01 | 7.81e-01 | 0.00e+00 | 7.63e+00 | 0.00e+00 | 6.27e+04 |
| Pm-147 | 3.44e+02 | 3.24e+01 | 1.31e+01 | 0.00e+00 | 6.11e+01 | 0.00e+00 | 4.08e+04 |
| Pm-148 | 7.12e+00 | 1.18e+00 | 5.95e-01 | 0.00e+00 | 2.23e+00 | 0.00e+00 | 9.28e+04 |
| Pm-148m | 1.03e+02 | 2.66e+01 | 2.04e+01 | 0.00e+00 | 4.02e+01 | 0.00e+00 | 2.26e+05 |
| Pm-149 | 5.13e-01 | 7.26e-02 | 2.96e-02 | 0.00e+00 | 1.37e-01 | 0.00e+00 | 1.36e+04 |
| Pm-151 | 7.76e-02 | 1.30e-02 | 6.58e-03 | 0.00e+00 | 2.33e-02 | 0.00e+00 | 3.58e+03 |
| Sm-151 | 3.20e+02 | 5.52e+01 | 1.32e+01 | 0.00e+00 | 6.16e+01 | 0.00e+00 | 2.43e+04 |
| Sm-153 | 2.39e-01 | 1.99e-01 | 1.45e-02 | 0.00e+00 | 6.43e-02 | 0.00e+00 | 7.10e+03 |
| Eu-152 | 9.01e+02 | 2.05e+02 | 1.80e+02 | 0.00e+00 | 1.27e+03 | 0.00e+00 | 1.18e+05 |
| Eu-154 | 2.85e+03 | 3.50e+02 | 2.49e+02 | 0.00e+00 | 1.68e+03 | 0.00e+00 | 2.54e+05 |
| Eu-155 | 3.90e+02 | 5.53e+01 | 3.57e+01 | 0.00e+00 | 2.55e+02 | 0.00e+00 | 4.35e+04 |
| Eu-156 | 3.02e+01 | 2.34e+01 | 3.77e+00 | 0.00e+00 | 1.56e+01 | 0.00e+00 | 1.60e+05 |
| Tb-160 | 1.79e+02 | 0.00e+00 | 2.23e+01 | 0.00e+00 | 7.39e+01 | 0.00e+00 | 1.65e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Hc-166m | 1.25e+03 | 3.91e+02 | 2.97e+02 | 0.00e+00 | 5.84e+02 | 0.00e+00 | 1.19e+05 |
| W-181 | 4.07e+03 | 1.33e+03 | 1.42e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.51e+05 |
| W-185 | 1.55e+05 | 5.18e+04 | 5.45e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.99e+06 |
| W-187 | 7.83e+02 | 6.54e+02 | 2.29e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.14e+05 |
| Pb-210 | 8.78e+09 | 2.51e+09 | 3.12e+08 | 0.00e+00 | 7.06e+09 | 0.00e+00 | 1.29e+06 |
| Bi-210 | 4.27e+04 | 2.95e+05 | 2.45e+04 | 0.00e+00 | 3.55e+06 | 0.00e+00 | 4.40e+06 |
| Po-210 | 8.90e+07 | 1.89e+08 | 2.15e+07 | 0.00e+00 | 6.30e+08 | 0.00e+00 | 1.59e+07 |
| Ra-223 | 1.47e+10 | 2.26e+07 | 2.93e+09 | 0.00e+00 | 6.40e+08 | 0.00e+00 | 9.46e+08 |
| Ra-224 | 1.70e+09 | 4.11e+06 | 3.40e+08 | 0.00e+00 | 1.16e+08 | 0.00e+00 | 3.58e+08 |
| Ra-225 | 2.28e+10 | 2.70e+07 | 4.55e+09 | 0.00e+00 | 7.67e+08 | 0.00e+00 | 1.06e+09 |
| Ra-226 | 2.24e+12 | 4.26e+07 | 1.63e+12 | 0.00e+00 | 1.21e+09 | 0.00e+00 | 2.46e+09 |
| Ra-228 | 8.25e+11 | 2.30e+07 | 8.91e+11 | 0.00e+00 | 6.50e+08 | 0.00e+00 | 4.15e+08 |
| Ac-225 | 7.40e+03 | 1.02e+04 | 4.98e+02 | 0.00e+00 | 1.16e+03 | 0.00e+00 | 6.85e+05 |
| Ac-227 | 8.65e+06 | 1.15e+06 | 5.14e+05 | 0.00e+00 | 3.70e+05 | 0.00e+00 | 3.79e+05 |
| Th-227 | 3.36e+04 | 6.07e+02 | 9.67e+02 | 0.00e+00 | 3.45e+03 | 0.00e+00 | 1.32e+06 |
| Th-228 | 2.25e+06 | 3.81e+04 | 7.62e+04 | 0.00e+00 | 2.12e+05 | 0.00e+00 | 2.55e+06 |
| Th-229 | 6.31e+07 | 1.80e+06 | 1.04e+06 | 0.00e+00 | 8.72e+06 | 0.00e+00 | 3.62e+05 |
| Th-230 | 9.55e+06 | 5.43e+05 | 2.64e+05 | 0.00e+00 | 2.62e+06 | 0.00e+00 | 2.79e+05 |
| Th-232 | 1.07e+07 | 4.64e+05 | 6.96e+03 | 0.00e+00 | 2.24e+06 | 0.00e+00 | 2.37e+05 |
| Th-234 | 2.22e+02 | 1.30e+01 | 6.40e+00 | 0.00e+00 | 7.39e+01 | 0.00e+00 | 3.13e+05 |
| Pa-231 | 1.90e+07 | 7.14e+05 | 7.37e+05 | 0.00e+00 | 4.01e+06 | 0.00e+00 | 3.32e+05 |
| Pa-233 | 1.53e+01 | 3.09e+00 | 2.66e+00 | 0.00e+00 | 1.16e+01 | 0.00e+00 | 4.78e+04 |
| U-232 | 1.91e+09 | 0.00e+00 | 1.37e+08 | 0.00e+00 | 2.07e+08 | 0.00e+00 | 3.14e+07 |
| U-233 | 4.04e+08 | 0.00e+00 | 2.45e+07 | 0.00e+00 | 9.41e+07 | 0.00e+00 | 2.91e+07 |
| U-234 | 3.88e+08 | 0.00e+00 | 2.40e+07 | 0.00e+00 | 9.23e+07 | 0.00e+00 | 2.85e+07 |
| U-235 | 3.71e+08 | 0.00e+00 | 2.25e+07 | 0.00e+00 | 8.67e+07 | 0.00e+00 | 3.62e+07 |
| U-236 | 3.71e+08 | 0.00e+00 | 2.30e+07 | 0.00e+00 | 8.86e+07 | 0.00e+00 | 2.67e+07 |
| U-237 | 6.78e+03 | 0.00e+00 | 1.81e+03 | 0.00e+00 | 2.79e+04 | 0.00e+00 | 2.38e+06 |
| U-238 | 3.56e+08 | 0.00e+00 | 2.11e+07 | 0.00e+00 | 8.11e+07 | 0.00e+00 | 2.55e+07 |
| Np-237 | 5.84e+06 | 4.15e+05 | 2.57e+05 | 0.00e+00 | 1.91e+06 | 0.00e+00 | 3.68e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 4.34e+00 | 1.17e-01 | 6.75e-02 | 0.00e+00 | 3.96e-01 | 0.00e+00 | 1.09e+04 |
| Np-239 | 4.41e-01 | 4.34e-02 | 2.39e-02 | 0.00e+00 | 1.35e-01 | 0.00e+00 | 8.89e+03 |
| Pu-238 | 1.17e+06 | 1.48e+05 | 3.17e+04 | 0.00e+00 | 1.36e+05 | 0.00e+00 | 1.35e+05 |
| Pu-239 | 1.34e+06 | 1.62e+05 | 3.54e+04 | 0.00e+00 | 1.50e+05 | 0.00e+00 | 1.24e+05 |
| Pu-240 | 1.34e+06 | 1.61e+05 | 3.54e+04 | 0.00e+00 | 1.50e+05 | 0.00e+00 | 1.26e+05 |
| Pu-241 | 2.90e+04 | 1.38e+03 | 6.14e+02 | 0.00e+00 | 2.83e+03 | 0.00e+00 | 2.59e+03 |
| Pu-242 | 1.25e+06 | 1.56e+05 | 3.41e+04 | 0.00e+00 | 1.45e+05 | 0.00e+00 | 1.21e+05 |
| Pu-244 | 1.45e+06 | 1.78e+05 | 3.91e+04 | 0.00e+00 | 1.66e+05 | 0.00e+00 | 1.80e+05 |
| Am-241 | 3.47e+06 | 3.24e+06 | 2.48e+05 | 0.00e+00 | 1.87e+06 | 0.00e+00 | 3.41e+05 |
| Am-242m | 3.53e+06 | 3.07e+06 | 2.52e+05 | 0.00e+00 | 1.88e+06 | 0.00e+00 | 4.33e+05 |
| Am-243 | 3.50e+06 | 3.20e+06 | 2.46e+05 | 0.00e+00 | 1.85e+06 | 0.00e+00 | 4.03e+05 |
| Cm-242 | 8.72e+04 | 9.27e+04 | 5.80e+03 | 0.00e+00 | 2.63e+04 | 0.00e+00 | 3.35e+05 |
| Cm-243 | 2.77e+06 | 2.54e+06 | 1.74e+05 | 0.00e+00 | 8.10e+05 | 0.00e+00 | 3.62e+05 |
| Cm-244 | 2.11e+06 | 1.98e+06 | 1.33e+05 | 0.00e+00 | 6.20e+05 | 0.00e+00 | 3.49e+05 |
| Cm-245 | 4.35e+06 | 3.79e+06 | 2.67e+05 | 0.00e+00 | 1.25e+06 | 0.00e+00 | 3.26e+05 |
| Cm-246 | 4.31e+06 | 3.78e+06 | 2.67e+05 | 0.00e+00 | 1.24e+06 | 0.00e+00 | 3.20e+05 |
| Cm-247 | 4.21e+06 | 3.73e+06 | 2.63e+05 | 0.00e+00 | 1.22e+06 | 0.00e+00 | 4.21e+05 |
| Cm-248 | 3.50e+07 | 3.07e+07 | 2.17e+06 | 0.00e+00 | 1.01e+07 | 0.00e+00 | 6.82e+06 |
| Cf-252 | 1.19e+06 | 0.00e+00 | 2.87e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.31e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 1.16e+03 | 1.16e+03 | 1.16e+03 | 1.16e+03 | 1.16e+03 | 1.16e+03 |
| Be-10 | 5.36e+05 | 8.30e+04 | 1.35e+04 | 0.00e+00 | 6.34e+04 | 0.00e+00 | 3.40e+06 |
| C-14 | 4.86e+08 | 9.72e+07 | 9.72e+07 | 9.72e+07 | 9.72e+07 | 9.72e+07 | 9.72e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 9.97e-04 | 0.00e+00 | 1.09e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.97e-05 |
| Na-22 | 1.10e+09 | 1.10e+09 | 1.10e+09 | 1.10e+09 | 1.10e+09 | 1.10e+09 | 1.10e+09 |
| Na-24 | 5.12e+05 | 5.12e+05 | 5.12e+05 | 5.12e+05 | 5.12e+05 | 5.12e+05 | 5.12e+05 |
| P-32 | 3.79e+10 | 2.35e+09 | 1.47e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.18e+09 |
| Ca-41 | 1.89e+09 | 0.00e+00 | 2.04e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.87e+06 |
| Sc-46 | 3.65e+01 | 7.11e+01 | 2.11e+01 | 0.00e+00 | 6.81e+01 | 0.00e+00 | 2.42e+05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 5.99e+03 | 3.33e+03 | 1.31e+03 | 8.55e+03 | 1.01e+06 |
| Mn-54 | 0.00e+00 | 1.68e+06 | 3.34e+05 | 0.00e+00 | 5.02e+05 | 0.00e+00 | 3.45e+06 |
| Mn-56 | 0.00e+00 | 8.83e-04 | 1.57e-04 | 0.00e+00 | 1.12e-03 | 0.00e+00 | 5.81e-02 |
| Fe-55 | 5.79e+05 | 4.10e+05 | 9.57e+04 | 0.00e+00 | 0.00e+00 | 2.60e+05 | 1.78e+05 |
| Fe-59 | 6.74e+05 | 1.57e+06 | 6.07e+05 | 0.00e+00 | 0.00e+00 | 4.96e+05 | 3.72e+06 |
| Cc-57 | 0.00e+00 | 2.69e+05 | 4.52e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.03e+06 |
| Cc-58 | 0.00e+00 | 9.52e+05 | 2.19e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.31e+07 |
| Cc-60 | 0.00e+00 | 3.34e+06 | 7.51e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.34e+07 |
| Ni-59 | 1.06e+08 | 3.74e+07 | 1.80e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.86e+06 |
| Ni-63 | 1.42e+09 | 1.00e+08 | 4.81e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.59e+07 |
| Ni-65 | 8.25e-02 | 1.05e-02 | 4.80e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.72e-01 |
| Cu-64 | 0.00e+00 | 4.75e+03 | 2.23e+03 | 0.00e+00 | 1.20e+04 | 0.00e+00 | 3.68e+05 |
| Zn-65 | 2.53e+08 | 8.78e+08 | 4.09e+08 | 0.00e+00 | 5.62e+08 | 0.00e+00 | 3.72e+08 |
| Zn-69 | 4.82e-13 | 9.18e-13 | 6.42e-14 | 0.00e+00 | 6.00e-13 | 0.00e+00 | 1.69e-12 |
| Zn-69m | 3.96e+04 | 9.35e+04 | 8.57e+03 | 0.00e+00 | 5.68e+04 | 0.00e+00 | 5.14e+06 |
| Se-79 | 0.00e+00 | 2.01e+08 | 3.38e+07 | 0.00e+00 | 3.50e+08 | 0.00e+00 | 3.07e+07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 6.73e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 2.18e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 3.71e-24 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 5.67e+08 | 2.67e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.40e+07 |
| Rb-87 | 0.00e+00 | 6.28e+08 | 2.19e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.19e+07 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 5.62e+09 | 0.00e+00 | 1.61e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.69e+08 |
| Sr-90 | 1.71e+11 | 0.00e+00 | 3.41e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.90e+09 |
| Sr-91 | 1.12e+05 | 0.00e+00 | 4.46e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.08e+05 |
| Sr-92 | 1.90e+00 | 0.00e+00 | 8.11e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.85e+01 |
| Y-90 | 1.56e+01 | 0.00e+00 | 4.21e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.29e+05 |
| Y-91 | 1.90e+03 | 0.00e+00 | 5.08e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.77e+05 |
| Y-91m | 1.38e-20 | 0.00e+00 | 5.26e-22 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.50e-19 |
| Y-92 | 1.25e-05 | 0.00e+00 | 3.62e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.43e-01 |
| Y-93 | 4.96e-02 | 0.00e+00 | 1.36e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.52e+03 |
| Zr-93 | 3.31e+02 | 1.63e+01 | 8.91e+00 | 0.00e+00 | 5.77e+01 | 0.00e+00 | 1.54e+04 |
| Zr-95 | 1.98e+02 | 6.25e+01 | 4.30e+01 | 0.00e+00 | 9.18e+01 | 0.00e+00 | 1.44e+05 |
| Zr-97 | 9.48e-02 | 1.88e-02 | 8.64e-03 | 0.00e+00 | 2.84e-02 | 0.00e+00 | 5.08e+03 |
| Nb-93m | 1.03e+05 | 3.37e+04 | 8.44e+03 | 0.00e+00 | 3.94e+04 | 0.00e+00 | 1.21e+07 |
| Nb-95 | 1.69e+04 | 9.37e+03 | 5.16e+03 | 0.00e+00 | 9.08e+03 | 0.00e+00 | 4.01e+07 |
| Nb-97 | 1.44e-12 | 3.57e-13 | 1.30e-13 | 0.00e+00 | 4.18e-13 | 0.00e+00 | 8.53e-09 |
| Mo-93 | 0.00e+00 | 9.51e+07 | 2.60e+06 | 0.00e+00 | 2.73e+07 | 0.00e+00 | 1.16e+07 |
| Mo-99 | 0.00e+00 | 5.37e+06 | 1.02e+06 | 0.00e+00 | 1.23e+07 | 0.00e+00 | 9.62e+06 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 5.35e+06 | 7.87e+06 | 2.14e+06 | 0.00e+00 | 9.99e+07 | 8.14e+05 | 1.93e+08 |
| Tc-99m | 6.96e-01 | 1.94e+00 | 2.51e+01 | 0.00e+00 | 2.89e+01 | 1.08e+00 | 1.27e+03 |
| Ru-103 | 2.17e+02 | 0.00e+00 | 9.29e+01 | 0.00e+00 | 7.66e+02 | 0.00e+00 | 1.81e+04 |
| Ru-105 | 1.89e-04 | 0.00e+00 | 7.35e-05 | 0.00e+00 | 2.39e-03 | 0.00e+00 | 1.53e-01 |
| Ru-106 | 4.50e+03 | 0.00e+00 | 5.67e+02 | 0.00e+00 | 8.68e+03 | 0.00e+00 | 2.16e+05 |
| Rh-105 | 7.66e+04 | 5.54e+04 | 3.63e+04 | 0.00e+00 | 2.35e+05 | 0.00e+00 | 7.04e+06 |
| Pd-107 | 0.00e+00 | 2.49e+06 | 1.60e+05 | 0.00e+00 | 2.25e+07 | 0.00e+00 | 1.16e+07 |
| Pd-109 | 0.00e+00 | 9.87e+03 | 2.24e+03 | 0.00e+00 | 5.70e+04 | 0.00e+00 | 9.95e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Ag-110m | 1.16e+07 | 1.09e+07 | 6.65e+06 | 0.00e+00 | 2.08e+07 | 0.00e+00 | 3.07e+09 |
| Ag-111 | 1.43e+06 | 5.93e+05 | 2.98e+05 | 0.00e+00 | 1.93e+06 | 0.00e+00 | 8.28e+08 |
| Cd-113m | 0.00e+00 | 6.46e+05 | 2.08e+04 | 0.00e+00 | 7.14e+05 | 0.00e+00 | 3.88e+06 |
| Cd-115m | 0.00e+00 | 2.75e+05 | 8.89e+03 | 0.00e+00 | 2.20e+05 | 0.00e+00 | 8.72e+06 |
| Sn-123 | 1.19e+08 | 1.95e+06 | 2.88e+06 | 1.56e+06 | 0.00e+00 | 0.00e+00 | 1.79e+08 |
| Sn-125 | 1.26e+07 | 2.50e+05 | 5.66e+05 | 1.96e+05 | 0.00e+00 | 0.00e+00 | 1.18e+08 |
| Sn-126 | 3.47e+08 | 6.46e+06 | 9.87e+06 | 1.70e+06 | 0.00e+00 | 0.00e+00 | 7.72e+07 |
| Sb-124 | 5.51e+06 | 1.01e+05 | 2.15e+06 | 1.25e+04 | 0.00e+00 | 4.81e+06 | 1.11e+08 |
| Sb-125 | 4.38e+06 | 4.79e+04 | 1.03e+06 | 4.19e+03 | 0.00e+00 | 3.85e+06 | 3.41e+07 |
| Sb-126 | 1.20e+06 | 2.46e+04 | 4.33e+05 | 6.81e+03 | 0.00e+00 | 8.64e+05 | 7.13e+07 |
| Sb-127 | 9.88e+04 | 2.11e+03 | 3.73e+04 | 1.11e+03 | 0.00e+00 | 6.72e+04 | 1.68e+07 |
| Te-125m | 3.60e+06 | 1.30e+06 | 4.82e+05 | 1.01e+06 | 0.00e+00 | 0.00e+00 | 1.06e+07 |
| Te-127 | 1.46e+02 | 5.17e+01 | 3.14e+01 | 1.01e+02 | 5.91e+02 | 0.00e+00 | 1.13e+04 |
| Te-127m | 1.01e+07 | 3.59e+06 | 1.20e+06 | 2.41e+06 | 4.10e+07 | 0.00e+00 | 2.52e+07 |
| Te-129 | 6.45e-11 | 2.40e-11 | 1.57e-11 | 4.61e-11 | 2.71e-10 | 0.00e+00 | 3.53e-10 |
| Te-129m | 1.32e+07 | 4.90e+06 | 2.09e+06 | 4.26e+06 | 5.53e+07 | 0.00e+00 | 4.96e+07 |
| Te-131 | 8.67e-34 | 3.57e-34 | 2.71e-34 | 6.68e-34 | 3.79e-33 | 0.00e+00 | 7.11e-35 |
| Te-131m | 7.89e+04 | 3.79e+04 | 3.16e+04 | 5.69e+04 | 3.95e+05 | 0.00e+00 | 3.04e+06 |
| Te-132 | 5.15e+05 | 3.26e+05 | 3.07e+05 | 3.44e+05 | 3.13e+06 | 0.00e+00 | 1.03e+07 |
| Te-133m | 4.74e-14 | 2.69e-14 | 2.62e-14 | 3.76e-14 | 2.66e-13 | 0.00e+00 | 1.09e-13 |
| Te-134 | 2.01e-19 | 1.29e-19 | 1.35e-19 | 1.65e-19 | 1.23e-18 | 0.00e+00 | 7.47e-21 |
| I-129 | 1.67e+08 | 1.41e+08 | 2.35e+08 | 1.71e+11 | 2.52e+08 | 0.00e+00 | 1.64e+07 |
| I-130 | 8.89e+04 | 2.57e+05 | 1.03e+05 | 2.10e+07 | 3.96e+05 | 0.00e+00 | 1.98e+05 |
| I-131 | 6.45e+07 | 9.03e+07 | 4.85e+07 | 2.63e+10 | 1.55e+08 | 0.00e+00 | 1.79e+07 |
| I-132 | 3.55e-02 | 9.30e-02 | 3.34e-02 | 3.13e+00 | 1.47e-01 | 0.00e+00 | 4.05e-02 |
| I-133 | 8.50e+05 | 1.44e+06 | 4.40e+05 | 2.01e+08 | 2.53e+06 | 0.00e+00 | 1.09e+06 |
| I-134 | 4.49e-13 | 1.19e-12 | 4.28e-13 | 1.98e-11 | 1.88e-12 | 0.00e+00 | 1.57e-14 |
| I-135 | 2.75e+03 | 7.09e+03 | 2.63e+03 | 4.56e+05 | 1.12e+04 | 0.00e+00 | 7.85e+03 |
| Cs-134 | 2.94e+10 | 6.93e+10 | 3.22e+10 | 0.00e+00 | 2.20e+10 | 8.41e+09 | 8.62e+08 |
| Cs-134m | 9.40e-01 | 1.95e+00 | 1.00e+00 | 0.00e+00 | 1.08e+00 | 1.90e-01 | 1.30e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 9.98e+09 | 9.15e+09 | 2.14e+09 | 0.00e+00 | 3.49e+09 | 1.26e+09 | 1.60e+08 |
| Cs-136 | 1.34e+09 | 5.29e+09 | 3.55e+09 | 0.00e+00 | 2.88e+09 | 4.54e+08 | 4.26e+08 |
| Cs-137 | 4.02e+10 | 5.34e+10 | 1.86e+10 | 0.00e+00 | 1.82e+10 | 7.06e+09 | 7.60e+08 |
| Cs-138 | 5.29e-23 | 1.02e-22 | 5.08e-23 | 0.00e+00 | 7.49e-23 | 8.72e-24 | 4.61e-26 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 1.01e-08 | 7.09e-12 | 2.94e-10 | 0.00e+00 | 6.69e-12 | 4.89e-12 | 8.99e-08 |
| Ba-140 | 5.82e+06 | 7.14e+03 | 3.75e+05 | 0.00e+00 | 2.42e+03 | 4.80e+03 | 8.98e+06 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 9.73e-01 | 4.78e-01 | 1.27e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.75e+04 |
| La-141 | 6.63e-06 | 2.04e-06 | 3.36e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.61e-01 |
| La-142 | 4.12e-12 | 1.83e-12 | 4.56e-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.57e-08 |
| Ce-141 | 1.07e+03 | 7.12e+02 | 8.17e+01 | 0.00e+00 | 3.35e+02 | 0.00e+00 | 2.04e+06 |
| Ce-143 | 9.18e+00 | 6.68e+03 | 7.46e-01 | 0.00e+00 | 2.99e+00 | 0.00e+00 | 2.01e+05 |
| Ce-144 | 7.90e+04 | 3.27e+04 | 4.24e+03 | 0.00e+00 | 1.95e+04 | 0.00e+00 | 1.99e+07 |
| Pr-143 | 3.48e+01 | 1.39e+01 | 1.73e+00 | 0.00e+00 | 8.08e+00 | 0.00e+00 | 1.15e+05 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 2.17e+01 | 2.36e+01 | 1.42e+00 | 0.00e+00 | 1.39e+01 | 0.00e+00 | 8.53e+04 |
| Pm-147 | 6.18e+02 | 5.86e+01 | 2.39e+01 | 0.00e+00 | 1.12e+02 | 0.00e+00 | 5.58e+04 |
| Pm-148 | 1.31e+01 | 2.13e+00 | 1.07e+00 | 0.00e+00 | 3.84e+00 | 0.00e+00 | 1.27e+05 |
| Pm-148m | 1.79e+02 | 4.54e+01 | 3.55e+01 | 0.00e+00 | 6.87e+01 | 0.00e+00 | 2.86e+05 |
| Pm-149 | 9.45e-01 | 1.33e-01 | 5.45e-02 | 0.00e+00 | 2.53e-01 | 0.00e+00 | 1.96e+04 |
| Pm-151 | 1.42e-01 | 2.34e-02 | 1.19e-02 | 0.00e+00 | 4.21e-02 | 0.00e+00 | 5.26e+03 |
| Sm-151 | 5.22e+02 | 1.00e+02 | 2.36e+01 | 0.00e+00 | 1.10e+02 | 0.00e+00 | 3.41e+04 |
| Sm-153 | 4.38e-01 | 3.63e-01 | 2.67e-02 | 0.00e+00 | 1.19e-01 | 0.00e+00 | 1.02e+04 |
| Eu-152 | 1.46e+03 | 3.52e+02 | 3.10e+02 | 0.00e+00 | 1.63e+03 | 0.00e+00 | 1.29e+05 |
| Eu-154 | 4.73e+03 | 6.10e+02 | 4.30e+02 | 0.00e+00 | 2.73e+03 | 0.00e+00 | 3.22e+05 |
| Eu-155 | 1.02e+03 | 9.82e+01 | 6.08e+01 | 0.00e+00 | 3.84e+02 | 0.00e+00 | 5.63e+05 |
| Eu-156 | 5.46e+01 | 4.09e+01 | 6.68e+00 | 0.00e+00 | 2.75e+01 | 0.00e+00 | 2.09e+05 |
| Tb-160 | 3.18e+02 | 0.00e+00 | 3.97e+01 | 0.00e+00 | 1.26e+02 | 0.00e+00 | 2.06e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Hc-166m | 2.14e+03 | 6.58e+02 | 4.76e+02 | 0.00e+00 | 9.63e+02 | 0.00e+00 | 1.62e+05 |
| W-181 | 7.53e+03 | 2.43e+03 | 2.54e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.07e+05 |
| W-185 | 2.87e+05 | 9.46e+04 | 1.00e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.17e+06 |
| W-187 | 1.43e+03 | 1.17e+03 | 4.09e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.16e+05 |
| Pb-210 | 1.34e+10 | 4.03e+09 | 5.19e+08 | 0.00e+00 | 1.27e+10 | 0.00e+00 | 1.75e+06 |
| Bi-210 | 7.88e+04 | 5.39e+05 | 4.51e+04 | 0.00e+00 | 6.55e+06 | 0.00e+00 | 6.16e+06 |
| Po-210 | 1.64e+08 | 3.45e+08 | 3.97e+07 | 0.00e+00 | 1.16e+09 | 0.00e+00 | 2.18e+07 |
| Ra-223 | 2.71e+10 | 4.11e+07 | 5.40e+09 | 0.00e+00 | 1.18e+09 | 0.00e+00 | 1.30e+09 |
| Ra-224 | 3.14e+09 | 7.50e+06 | 6.26e+08 | 0.00e+00 | 2.15e+08 | 0.00e+00 | 5.04e+08 |
| Ra-225 | 4.20e+10 | 4.93e+07 | 8.38e+09 | 0.00e+00 | 1.41e+09 | 0.00e+00 | 1.46e+09 |
| Ra-226 | 3.08e+12 | 7.78e+07 | 2.29e+12 | 0.00e+00 | 2.22e+09 | 0.00e+00 | 3.36e+09 |
| Ra-228 | 1.30e+12 | 4.19e+07 | 1.44e+12 | 0.00e+00 | 1.20e+09 | 0.00e+00 | 5.68e+08 |
| Ac-225 | 1.37e+04 | 1.86e+04 | 9.16e+02 | 0.00e+00 | 2.14e+03 | 0.00e+00 | 9.46e+05 |
| Ac-227 | 1.22e+07 | 1.81e+06 | 7.29e+05 | 0.00e+00 | 5.26e+05 | 0.00e+00 | 5.18e+05 |
| Th-227 | 6.19e+04 | 1.11e+03 | 1.79e+03 | 0.00e+00 | 6.35e+03 | 0.00e+00 | 1.82e+06 |
| Th-228 | 3.98e+06 | 6.67e+04 | 1.35e+05 | 0.00e+00 | 3.75e+05 | 0.00e+00 | 3.49e+06 |
| Th-229 | 8.56e+07 | 2.46e+06 | 1.42e+06 | 0.00e+00 | 1.19e+07 | 0.00e+00 | 4.95e+05 |
| Th-230 | 1.29e+07 | 7.36e+05 | 3.59e+05 | 0.00e+00 | 3.58e+06 | 0.00e+00 | 3.82e+05 |
| Th-232 | 1.45e+07 | 6.28e+05 | 9.75e+03 | 0.00e+00 | 3.06e+06 | 0.00e+00 | 3.25e+05 |
| Th-234 | 4.07e+02 | 2.39e+01 | 1.18e+01 | 0.00e+00 | 1.36e+02 | 0.00e+00 | 4.32e+05 |
| Pa-231 | 2.58e+07 | 9.69e+05 | 1.01e+06 | 0.00e+00 | 5.44e+06 | 0.00e+00 | 4.55e+05 |
| Pa-233 | 2.76e+01 | 5.31e+00 | 4.74e+00 | 0.00e+00 | 2.00e+01 | 0.00e+00 | 6.06e+04 |
| U-232 | 3.52e+09 | 0.00e+00 | 2.52e+08 | 0.00e+00 | 3.82e+08 | 0.00e+00 | 4.30e+07 |
| U-233 | 7.42e+08 | 0.00e+00 | 4.51e+07 | 0.00e+00 | 1.74e+08 | 0.00e+00 | 3.98e+07 |
| U-234 | 7.12e+08 | 0.00e+00 | 4.42e+07 | 0.00e+00 | 1.71e+08 | 0.00e+00 | 3.90e+07 |
| U-235 | 6.82e+08 | 0.00e+00 | 4.15e+07 | 0.00e+00 | 1.60e+08 | 0.00e+00 | 4.95e+07 |
| U-236 | 6.82e+08 | 0.00e+00 | 4.24e+07 | 0.00e+00 | 1.63e+08 | 0.00e+00 | 3.66e+07 |
| U-237 | 1.25e+04 | 0.00e+00 | 3.33e+03 | 0.00e+00 | 5.14e+04 | 0.00e+00 | 3.31e+06 |
| U-238 | 6.52e+08 | 0.00e+00 | 3.88e+07 | 0.00e+00 | 1.50e+08 | 0.00e+00 | 3.49e+07 |
| Np-237 | 7.96e+06 | 5.71e+05 | 3.50e+05 | 0.00e+00 | 2.59e+06 | 0.00e+00 | 5.03e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 7.98e+00 | 2.14e-01 | 1.24e-01 | 0.00e+00 | 7.32e-01 | 0.00e+00 | 1.57e+04 |
| Np-239 | 8.42e-01 | 7.94e-02 | 4.41e-02 | 0.00e+00 | 2.49e-01 | 0.00e+00 | 1.28e+04 |
| Pu-238 | 1.60e+06 | 2.05e+05 | 4.35e+04 | 0.00e+00 | 1.87e+05 | 0.00e+00 | 1.85e+05 |
| Pu-239 | 1.83e+06 | 2.22e+05 | 4.81e+04 | 0.00e+00 | 2.05e+05 | 0.00e+00 | 1.69e+05 |
| Pu-240 | 1.83e+06 | 2.22e+05 | 4.81e+04 | 0.00e+00 | 2.05e+05 | 0.00e+00 | 1.72e+05 |
| Pu-241 | 4.18e+04 | 2.00e+03 | 8.81e+02 | 0.00e+00 | 4.08e+03 | 0.00e+00 | 3.53e+03 |
| Pu-242 | 1.70e+06 | 2.14e+05 | 4.64e+04 | 0.00e+00 | 1.97e+05 | 0.00e+00 | 1.66e+05 |
| Pu-244 | 1.98e+06 | 2.44e+05 | 5.31e+04 | 0.00e+00 | 2.26e+05 | 0.00e+00 | 2.47e+05 |
| Am-241 | 4.73e+06 | 4.46e+06 | 3.41e+05 | 0.00e+00 | 2.55e+06 | 0.00e+00 | 4.66e+05 |
| Am-242m | 4.83e+06 | 4.25e+06 | 3.47e+05 | 0.00e+00 | 2.57e+06 | 0.00e+00 | 5.92e+05 |
| Am-243 | 4.76e+06 | 4.40e+06 | 3.36e+05 | 0.00e+00 | 2.52e+06 | 0.00e+00 | 5.52e+05 |
| Cm-242 | 1.61e+05 | 1.69e+05 | 1.07e+04 | 0.00e+00 | 4.86e+04 | 0.00e+00 | 4.59e+05 |
| Cm-243 | 3.88e+06 | 3.60e+06 | 2.44e+05 | 0.00e+00 | 1.14e+06 | 0.00e+00 | 4.95e+05 |
| Cm-244 | 3.01e+06 | 2.85e+06 | 1.90e+05 | 0.00e+00 | 8.89e+05 | 0.00e+00 | 4.78e+05 |
| Cm-245 | 5.92e+06 | 5.21e+06 | 3.65e+05 | 0.00e+00 | 1.71e+06 | 0.00e+00 | 4.46e+05 |
| Cm-246 | 5.88e+06 | 5.21e+06 | 3.64e+05 | 0.00e+00 | 1.70e+06 | 0.00e+00 | 4.39e+05 |
| Cm-247 | 5.73e+06 | 5.13e+06 | 3.59e+05 | 0.00e+00 | 1.68e+06 | 0.00e+00 | 5.76e+05 |
| Cm-248 | 4.76e+07 | 4.22e+07 | 2.96e+06 | 0.00e+00 | 1.38e+07 | 0.00e+00 | 9.27e+06 |
| Cf-252 | 2.04e+06 | 0.00e+00 | 4.92e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.79e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 1.83e+03 | 1.83e+03 | 1.83e+03 | 1.83e+03 | 1.83e+03 | 1.83e+03 |
| Be-10 | 1.33e+06 | 1.55e+05 | 3.35e+04 | 0.00e+00 | 1.10e+05 | 0.00e+00 | 2.71e+06 |
| C-14 | 1.19e+09 | 2.39e+08 | 2.39e+08 | 2.39e+08 | 2.39e+08 | 2.39e+08 | 2.39e+08 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 2.37e-03 | 0.00e+00 | 2.35e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.41e-04 |
| Na-22 | 2.28e+09 | 2.28e+09 | 2.28e+09 | 2.28e+09 | 2.28e+09 | 2.28e+09 | 2.28e+09 |
| Na-24 | 1.07e+06 | 1.07e+06 | 1.07e+06 | 1.07e+06 | 1.07e+06 | 1.07e+06 | 1.07e+06 |
| P-32 | 9.33e+10 | 4.37e+09 | 3.60e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.58e+09 |
| Ce-41 | 2.74e+09 | 0.00e+00 | 2.99e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.50e+06 |
| Sc-46 | 8.20e+01 | 1.12e+02 | 4.33e+01 | 0.00e+00 | 9.94e+01 | 0.00e+00 | 1.64e+05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.22e+04 | 6.78e+03 | 1.85e+03 | 1.24e+04 | 6.48e+05 |
| Mn-54 | 0.00e+00 | 2.52e+06 | 6.70e+05 | 0.00e+00 | 7.06e+05 | 0.00e+00 | 2.11e+06 |
| Mn-56 | 0.00e+00 | 1.54e-03 | 3.48e-04 | 0.00e+00 | 1.86e-03 | 0.00e+00 | 2.23e-01 |
| Fe-55 | 1.45e+06 | 7.71e+05 | 2.39e+05 | 0.00e+00 | 0.00e+00 | 4.36e+05 | 1.43e+05 |
| Fe-59 | 1.56e+06 | 2.53e+06 | 1.26e+06 | 0.00e+00 | 0.00e+00 | 7.33e+05 | 2.63e+06 |
| Co-57 | 0.00e+00 | 4.60e+05 | 9.32e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.77e+06 |
| Co-58 | 0.00e+00 | 1.45e+06 | 4.45e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.49e+06 |
| Co-60 | 0.00e+00 | 5.18e+06 | 1.53e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.87e+07 |
| Ni-59 | 2.66e+08 | 7.08e+07 | 4.51e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.70e+06 |
| Ni-63 | 3.56e+09 | 1.90e+08 | 1.21e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.28e+07 |
| Ni-65 | 2.02e-01 | 1.90e-02 | 1.11e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.33e+00 |
| Cu-64 | 0.00e+00 | 8.34e+03 | 5.04e+03 | 0.00e+00 | 2.02e+04 | 0.00e+00 | 3.92e+05 |
| Zn-65 | 4.96e+08 | 1.32e+09 | 8.22e+08 | 0.00e+00 | 8.33e+08 | 0.00e+00 | 2.32e+08 |
| Zn-69 | 1.18e-12 | 1.71e-12 | 1.58e-13 | 0.00e+00 | 1.04e-12 | 0.00e+00 | 1.08e-10 |
| Zn-69m | 9.68e+04 | 1.65e+05 | 1.95e+04 | 0.00e+00 | 9.58e+04 | 0.00e+00 | 5.37e+06 |
| Se-79 | 0.00e+00 | 3.75e+08 | 8.31e+07 | 0.00e+00 | 6.09e+08 | 0.00e+00 | 2.46e+07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.38e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 5.36e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 8.40e-24 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.05e+09 | 6.47e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.77e+07 |
| Rb-87 | 0.00e+00 | 1.17e+09 | 5.42e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.75e+07 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 1.39e+10 | 0.00e+00 | 3.97e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.38e+08 |
| Sr-90 | 3.53e+11 | 0.00e+00 | 7.11e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.16e+09 |
| Sr-91 | 2.75e+05 | 0.00e+00 | 1.04e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.07e+05 |
| Sr-92 | 4.65e+00 | 0.00e+00 | 1.86e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.81e+01 |
| Y-90 | 3.87e+01 | 0.00e+00 | 1.04e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.10e+05 |
| Y-91 | 4.68e+03 | 0.00e+00 | 1.25e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.24e+05 |
| Y-91m | 3.36e-20 | 0.00e+00 | 1.22e-21 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.59e-17 |
| Y-92 | 3.07e-05 | 0.00e+00 | 8.78e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.87e-01 |
| Y-93 | 1.22e-01 | 0.00e+00 | 3.35e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.82e+03 |
| Zr-93 | 8.24e+02 | 3.09e+01 | 2.20e+01 | 0.00e+00 | 1.19e+02 | 0.00e+00 | 1.17e+04 |
| Zr-95 | 4.60e+02 | 1.01e+02 | 9.00e+01 | 0.00e+00 | 1.45e+02 | 0.00e+00 | 1.05e+05 |
| Zr-97 | 2.31e-01 | 3.33e-02 | 1.97e-02 | 0.00e+00 | 4.79e-02 | 0.00e+00 | 5.05e+03 |
| Nb-93m | 2.58e+05 | 6.45e+04 | 2.12e+04 | 0.00e+00 | 6.96e+04 | 0.00e+00 | 9.72e+06 |
| Nb-95 | 3.81e+04 | 1.49e+04 | 1.06e+04 | 0.00e+00 | 1.40e+04 | 0.00e+00 | 2.75e+07 |
| Nb-97 | 3.49e-12 | 6.31e-13 | 2.95e-13 | 0.00e+00 | 7.00e-13 | 0.00e+00 | 1.95e-07 |
| Mo-93 | 0.00e+00 | 1.78e+08 | 6.40e+06 | 0.00e+00 | 4.70e+07 | 0.00e+00 | 9.03e+06 |
| Mo-99 | 0.00e+00 | 9.77e+06 | 2.42e+06 | 0.00e+00 | 2.09e+07 | 0.00e+00 | 8.08e+06 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 1.32e+07 | 1.47e+07 | 5.28e+06 | 0.00e+00 | 1.73e+08 | 1.30e+06 | 1.54e+08 |
| Tc-99m | 1.60e+00 | 3.13e+00 | 5.19e+01 | 0.00e+00 | 4.55e+01 | 1.59e+00 | 1.78e+03 |
| Ru-103 | 5.14e+02 | 0.00e+00 | 1.98e+02 | 0.00e+00 | 1.29e+03 | 0.00e+00 | 1.33e+04 |
| Ru-105 | 4.62e-04 | 0.00e+00 | 1.68e-04 | 0.00e+00 | 4.06e-03 | 0.00e+00 | 3.02e-01 |
| Ru-106 | 1.11e+04 | 0.00e+00 | 1.38e+03 | 0.00e+00 | 1.50e+04 | 0.00e+00 | 1.72e+05 |
| Rh-105 | 1.88e+05 | 1.01e+05 | 8.62e+04 | 0.00e+00 | 4.02e+05 | 0.00e+00 | 6.25e+06 |
| Pd-107 | 0.00e+00 | 4.66e+06 | 3.96e+05 | 0.00e+00 | 3.90e+07 | 0.00e+00 | 9.25e+06 |
| Pd-109 | 0.00e+00 | 1.84e+04 | 5.51e+03 | 0.00e+00 | 9.86e+04 | 0.00e+00 | 1.09e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Ag-110m | 2.51e+07 | 1.69e+07 | 1.35e+07 | 0.00e+00 | 3.15e+07 | 0.00e+00 | 2.01e+09 |
| Ag-111 | 3.53e+06 | 1.10e+06 | 7.29e+05 | 0.00e+00 | 3.33e+06 | 0.00e+00 | 6.76e+08 |
| Cd-113m | 0.00e+00 | 1.20e+06 | 5.13e+04 | 0.00e+00 | 1.24e+06 | 0.00e+00 | 3.11e+06 |
| Cd-115m | 0.00e+00 | 5.15e+05 | 2.19e+04 | 0.00e+00 | 3.83e+05 | 0.00e+00 | 7.00e+06 |
| Sr-123 | 2.93e+08 | 3.63e+06 | 7.14e+06 | 3.85e+06 | 0.00e+00 | 0.00e+00 | 1.44e+08 |
| Sr-125 | 3.09e+07 | 4.66e+05 | 1.38e+06 | 4.83e+05 | 0.00e+00 | 0.00e+00 | 9.57e+07 |
| Sr-126 | 8.22e+08 | 1.02e+07 | 2.33e+07 | 2.81e+06 | 0.00e+00 | 0.00e+00 | 6.17e+07 |
| Sb-124 | 1.30e+07 | 1.69e+05 | 4.57e+06 | 2.88e+04 | 0.00e+00 | 7.23e+06 | 8.15e+07 |
| Sb-125 | 1.04e+07 | 8.05e+04 | 2.19e+06 | 9.67e+03 | 0.00e+00 | 5.82e+06 | 2.49e+07 |
| Sb-126 | 2.75e+06 | 4.21e+04 | 9.88e+05 | 1.61e+04 | 0.00e+00 | 1.31e+06 | 5.55e+07 |
| Sb-127 | 2.38e+05 | 3.68e+03 | 8.26e+04 | 2.65e+03 | 0.00e+00 | 1.03e+05 | 1.34e+07 |
| Te-125m | 8.85e+06 | 2.40e+06 | 1.18e+06 | 2.48e+06 | 0.00e+00 | 0.00e+00 | 8.54e+06 |
| Te-127 | 3.59e+02 | 9.67e+01 | 7.69e+01 | 2.48e+02 | 1.02e+03 | 0.00e+00 | 1.40e+04 |
| Te-127m | 2.50e+07 | 6.72e+06 | 2.96e+06 | 5.97e+06 | 7.12e+07 | 0.00e+00 | 2.02e+07 |
| Te-129 | 1.59e-10 | 4.44e-11 | 3.78e-11 | 1.14e-10 | 4.65e-10 | 0.00e+00 | 9.90e-09 |
| Te-129m | 3.26e+07 | 9.09e+06 | 5.06e+06 | 1.05e+07 | 9.56e+07 | 0.00e+00 | 3.97e+07 |
| Te-131 | 2.13e-33 | 6.48e-34 | 6.33e-34 | 1.63e-33 | 6.43e-33 | 0.00e+00 | 1.12e-32 |
| Te-131m | 1.92e+05 | 6.65e+04 | 7.07e+04 | 1.37e+05 | 6.43e+05 | 0.00e+00 | 2.70e+06 |
| Te-132 | 1.23e+06 | 5.44e+05 | 6.58e+05 | 7.93e+05 | 5.05e+06 | 0.00e+00 | 5.48e+06 |
| Te-133m | 1.13e-13 | 4.59e-14 | 5.69e-14 | 8.80e-14 | 4.36e-13 | 0.00e+00 | 3.50e-12 |
| Te-134 | 4.79e-19 | 2.15e-19 | 2.87e-19 | 3.78e-19 | 1.99e-18 | 0.00e+00 | 2.19e-18 |
| I-129 | 4.12e+08 | 2.53e+08 | 2.26e+08 | 1.65e+11 | 4.26e+08 | 0.00e+00 | 1.27e+07 |
| I-130 | 2.08e+05 | 4.20e+05 | 2.16e+05 | 4.63e+07 | 6.28e+05 | 0.00e+00 | 1.97e+05 |
| I-131 | 1.56e+08 | 1.57e+08 | 8.94e+07 | 5.20e+10 | 2.58e+08 | 0.00e+00 | 1.40e+07 |
| I-132 | 8.41e-02 | 1.54e-01 | 7.10e-02 | 7.17e+00 | 2.36e-01 | 0.00e+00 | 1.82e-01 |
| I-133 | 2.06e+06 | 2.55e+06 | 9.66e+05 | 4.74e+08 | 4.25e+06 | 0.00e+00 | 1.03e+06 |
| I-134 | 1.06e-12 | 1.98e-12 | 9.09e-13 | 4.54e-11 | 3.02e-12 | 0.00e+00 | 1.31e-12 |
| I-135 | 6.52e+03 | 1.17e+04 | 5.55e+03 | 1.04e+06 | 1.80e+04 | 0.00e+00 | 8.94e+03 |
| Cs-134 | 6.79e+10 | 1.11e+11 | 2.35e+10 | 0.00e+00 | 3.45e+10 | 1.24e+10 | 6.01e+08 |
| Cs-134m | 2.23e+00 | 3.30e+00 | 2.15e+00 | 0.00e+00 | 1.74e+00 | 2.88e-01 | 4.17e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

GOAT's MILK PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES, R_i

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 2.46e+10 | 1.71e+10 | 1.76e+09 | 0.00e+00 | 6.04e+09 | 2.02e+09 | 1.28e+08 |
| Cs-136 | 3.04e+09 | 8.34e+09 | 5.40e+09 | 0.00e+00 | 4.44e+09 | 6.63e+08 | 2.93e+08 |
| Cs-137 | 9.67e+10 | 9.26e+10 | 1.37e+10 | 0.00e+00 | 3.02e+10 | 1.09e+10 | 5.80e+08 |
| Cs-138 | 1.28e-22 | 1.78e-22 | 1.13e-22 | 0.00e+00 | 1.25e-22 | 1.35e-23 | 8.21e-23 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 2.48e-08 | 1.32e-11 | 7.18e-10 | 0.00e+00 | 1.15e-11 | 7.78e-12 | 1.43e-06 |
| Ba-140 | 1.41e+07 | 1.23e+04 | 8.20e+05 | 0.00e+00 | 4.01e+03 | 7.34e+03 | 7.12e+06 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 2.33e+00 | 8.15e-01 | 2.75e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.27e+04 |
| La-141 | 1.63e-05 | 3.81e-06 | 8.27e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.47e-01 |
| La-142 | 9.95e-12 | 3.17e-12 | 9.94e-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.29e-07 |
| Ce-141 | 2.62e+03 | 1.31e+03 | 1.94e+02 | 0.00e+00 | 5.74e+02 | 0.00e+00 | 1.63e+06 |
| Ce-143 | 2.25e+01 | 1.22e+04 | 1.77e+00 | 0.00e+00 | 5.12e+00 | 0.00e+00 | 1.79e+05 |
| Ce-144 | 1.95e+05 | 6.10e+04 | 1.04e+04 | 0.00e+00 | 3.38e+04 | 0.00e+00 | 1.59e+07 |
| Pr-143 | 8.62e+01 | 2.59e+01 | 4.28e+00 | 0.00e+00 | 1.40e+01 | 0.00e+00 | 9.30e+04 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 5.34e+01 | 4.32e+01 | 3.35e+00 | 0.00e+00 | 2.37e+01 | 0.00e+00 | 6.85e+04 |
| Pm-147 | 1.54e+03 | 1.10e+02 | 5.93e+01 | 0.00e+00 | 1.95e+02 | 0.00e+00 | 4.46e+04 |
| Pm-148 | 3.19e+01 | 3.84e+00 | 2.48e+00 | 0.00e+00 | 6.52e+00 | 0.00e+00 | 1.03e+05 |
| Pm-148m | 3.67e+02 | 7.31e+01 | 7.31e+01 | 0.00e+00 | 1.08e+02 | 0.00e+00 | 2.06e+05 |
| Pm-149 | 2.33e+00 | 2.48e-01 | 1.34e-01 | 0.00e+00 | 4.38e-01 | 0.00e+00 | 1.69e+04 |
| Pm-151 | 3.46e-01 | 4.21e-02 | 2.74e-02 | 0.00e+00 | 7.13e-02 | 0.00e+00 | 4.78e+03 |
| Sm-151 | 1.26e+03 | 1.88e+02 | 5.92e+01 | 0.00e+00 | 1.94e+02 | 0.00e+00 | 2.73e+04 |
| Sm-153 | 1.08e+00 | 6.73e-01 | 6.49e-02 | 0.00e+00 | 2.05e-01 | 0.00e+00 | 8.95e+03 |
| Eu-152 | 3.03e+03 | 5.51e+02 | 6.54e+02 | 0.00e+00 | 2.33e+03 | 0.00e+00 | 9.05e+04 |
| Eu-154 | 1.14e+04 | 1.02e+03 | 9.33e+02 | 0.00e+00 | 4.49e+03 | 0.00e+00 | 2.37e+05 |
| Eu-155 | 2.32e+03 | 1.67e+02 | 1.31e+02 | 0.00e+00 | 6.27e+02 | 0.00e+00 | 4.19e+05 |
| Eu-156 | 1.32e+02 | 7.06e+01 | 1.46e+01 | 0.00e+00 | 4.55e+01 | 0.00e+00 | 1.60e+05 |
| Tb-160 | 6.73e+02 | 0.00e+00 | 8.35e+01 | 0.00e+00 | 2.00e+02 | 0.00e+00 | 1.49e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Hc-166m | 5.33e+03 | 1.12e+03 | 9.43e+02 | 0.00e+00 | 1.59e+03 | 0.00e+00 | 1.30e+05 |
| W-181 | 1.85e+04 | 4.55e+03 | 6.25e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.66e+05 |
| W-185 | 7.07e+05 | 1.76e+05 | 2.47e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.58e+06 |
| W-187 | 3.47e+03 | 2.06e+03 | 9.22e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.89e+05 |
| Pb-210 | 2.90e+10 | 7.45e+09 | 1.28e+09 | 0.00e+00 | 2.24e+10 | 0.00e+00 | 1.40e+06 |
| Bi-210 | 1.94e+05 | 1.01e+06 | 1.11e+05 | 0.00e+00 | 1.13e+07 | 0.00e+00 | 5.10e+06 |
| Po-210 | 4.05e+08 | 6.47e+08 | 9.77e+07 | 0.00e+00 | 2.01e+09 | 0.00e+00 | 1.74e+07 |
| Ra-223 | 6.65e+10 | 7.69e+07 | 1.33e+10 | 0.00e+00 | 2.04e+09 | 0.00e+00 | 1.06e+09 |
| Ra-224 | 7.72e+09 | 1.40e+07 | 1.55e+09 | 0.00e+00 | 3.71e+08 | 0.00e+00 | 4.24e+08 |
| Ra-225 | 1.03e+11 | 9.24e+07 | 2.07e+10 | 0.00e+00 | 2.45e+09 | 0.00e+00 | 1.19e+09 |
| Ra-226 | 4.54e+12 | 1.45e+08 | 3.73e+12 | 0.00e+00 | 3.85e+09 | 0.00e+00 | 2.69e+09 |
| Ra-228 | 3.02e+12 | 7.83e+07 | 3.39e+12 | 0.00e+00 | 2.08e+09 | 0.00e+00 | 4.56e+08 |
| Ac-225 | 3.37e+04 | 3.47e+04 | 2.26e+03 | 0.00e+00 | 3.71e+03 | 0.00e+00 | 7.72e+05 |
| Ac-227 | 2.03e+07 | 3.27e+06 | 1.26e+06 | 0.00e+00 | 7.19e+05 | 0.00e+00 | 4.15e+05 |
| Th-227 | 1.53e+05 | 2.08e+03 | 4.41e+03 | 0.00e+00 | 1.10e+04 | 0.00e+00 | 1.47e+06 |
| Th-228 | 1.00e+07 | 1.28e+05 | 3.38e+05 | 0.00e+00 | 6.66e+05 | 0.00e+00 | 2.80e+06 |
| Th-229 | 1.16e+08 | 2.92e+06 | 1.93e+06 | 0.00e+00 | 1.43e+07 | 0.00e+00 | 3.97e+05 |
| Th-230 | 1.75e+07 | 8.79e+05 | 4.89e+05 | 0.00e+00 | 4.28e+06 | 0.00e+00 | 3.06e+05 |
| Th-232 | 1.95e+07 | 7.50e+05 | 1.49e+04 | 0.00e+00 | 3.66e+06 | 0.00e+00 | 2.60e+05 |
| Th-234 | 1.01e+03 | 4.45e+01 | 2.91e+01 | 0.00e+00 | 2.36e+02 | 0.00e+00 | 3.48e+05 |
| Pa-231 | 3.49e+07 | 1.16e+06 | 1.39e+06 | 0.00e+00 | 6.32e+06 | 0.00e+00 | 3.64e+05 |
| Pa-233 | 5.62e+01 | 8.76e+00 | 9.81e+00 | 0.00e+00 | 3.23e+01 | 0.00e+00 | 4.47e+04 |
| U-232 | 8.68e+09 | 0.00e+00 | 6.22e+08 | 0.00e+00 | 6.61e+08 | 0.00e+00 | 3.44e+07 |
| U-233 | 1.84e+09 | 0.00e+00 | 1.11e+08 | 0.00e+00 | 3.01e+08 | 0.00e+00 | 3.18e+07 |
| U-234 | 1.76e+09 | 0.00e+00 | 1.09e+08 | 0.00e+00 | 2.95e+08 | 0.00e+00 | 3.12e+07 |
| U-235 | 1.69e+09 | 0.00e+00 | 1.02e+08 | 0.00e+00 | 2.77e+08 | 0.00e+00 | 3.96e+07 |
| U-236 | 1.69e+09 | 0.00e+00 | 1.05e+08 | 0.00e+00 | 2.83e+08 | 0.00e+00 | 2.92e+07 |
| U-237 | 3.09e+04 | 0.00e+00 | 8.20e+03 | 0.00e+00 | 8.90e+04 | 0.00e+00 | 2.72e+06 |
| U-238 | 1.61e+09 | 0.00e+00 | 9.58e+07 | 0.00e+00 | 2.59e+08 | 0.00e+00 | 2.79e+07 |
| Np-237 | 1.10e+07 | 7.26e+05 | 4.83e+05 | 0.00e+00 | 2.99e+06 | 0.00e+00 | 4.03e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|--------------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LI.I |
| Np-238 | 1.97e+01 | 3.98e-01 | 3.07e-01 | 0.00e+00 | 1.27e+00 | 0.00e+00 | 1.36e+04 |
| Np-239 | 2.07e+00 | 1.49e-01 | 1.05e-01 | 0.00e+00 | 4.30e-01 | 0.00e+00 | 1.10e+04 |
| Pu-238 | 2.35e+06 | 2.72e+05 | 6.24e+04 | 0.00e+00 | 2.27e+05 | 0.00e+00 | 1.48e+05 |
| Pu-239 | 2.55e+06 | 2.72e+05 | 6.54e+04 | 0.00e+00 | 2.41e+05 | 0.00e+00 | 1.35e+05 |
| Pu-240 | 2.53e+06 | 2.82e-05 | 6.54e+04 | 0.00e+00 | 2.41e+05 | 0.00e+00 | 1.38e+05 |
| Pu-241 | 7.62e+04 | 3.11e-03 | 1.58e+03 | 0.00e+00 | 5.83e+03 | 0.00e+00 | 2.84e+03 |
| -----77----- | | | | | | | |
| Pu-242 | 2.35e+06 | 2.72e+05 | 6.30e+04 | 0.00e+00 | 2.31e+05 | 0.00e+00 | 1.32e+05 |
| Pu-244 | 2.74e+06 | 3.12e+06 | 7.21e+04 | 0.00e+00 | 2.67e+05 | 0.00e+00 | 1.97e+05 |
| Am-241 | 6.65e+06 | 5.72e+06 | 4.99e+05 | 0.00e+00 | 3.05e+06 | 0.00e+00 | 3.73e+05 |
| Am-242m | 6.91e+06 | 5.53e+06 | 5.13e+05 | 0.00e+00 | 3.11e+06 | 0.00e+00 | 4.74e+05 |
| Am-243 | 6.61e+06 | 5.58e+06 | 4.85e+05 | 0.00e+00 | 2.99e+06 | 0.00e+00 | 4.42e+05 |
| Cm-242 | 3.96e+05 | 3.16e+05 | 2.63e+04 | 0.00e+00 | 8.43e+04 | 0.00e+00 | 3.68e+05 |
| Cm-243 | 6.31e+06 | 5.13e+06 | 4.06e+05 | 0.00e+00 | 1.52e+06 | 0.00e+00 | 3.96e+05 |
| Cm-244 | 5.32e+06 | 4.30e+06 | 3.41e+05 | 0.00e+00 | 1.25e+06 | 0.00e+00 | 3.83e+05 |
| Cm-245 | 8.24e+06 | 6.61e+06 | 5.18e+05 | 0.00e+00 | 2.03e+06 | 0.00e+00 | 3.57e+05 |
| Cm-246 | 8.14e+06 | 6.61e+06 | 5.18e+05 | 0.00e+00 | 2.02e+06 | 0.00e+00 | 3.51e+05 |
| Cm-247 | 7.95e+06 | 6.52e+06 | 5.08e+05 | 0.00e+00 | 1.99e+06 | 0.00e+00 | 4.62e+05 |
| Cm-248 | 6.61e+07 | 5.38e+07 | 4.21e+06 | 0.00e+00 | 1.64e+07 | 0.00e+00 | 7.45e+06 |
| Cf-252 | 5.10e+06 | 0.00e+00 | 1.23e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.44e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| H-3 | 0.00e+00 | 2.78e+03 | 2.78e+03 | 2.78e+03 | 2.78e+03 | 2.78e+03 | 2.78e+03 |
| Be-10 | 1.69e+06 | 2.46e+05 | 5.09e+04 | 0.00e+00 | 1.62e+05 | 0.00e+00 | 2.74e+06 |
| C-14 | 2.34e+09 | 5.00e+08 | 5.00e+08 | 5.00e+08 | 5.00e+08 | 5.00e+08 | 5.00e+08 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 4.94e-03 | 0.00e+00 | 4.22e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.16e-03 |
| Na-22 | 3.82e+09 | 3.82e+09 | 3.82e+09 | 3.82e+09 | 3.82e+09 | 3.82e+09 | 3.82e+09 |
| Na-24 | 1.85e+06 | 1.85e+06 | 1.85e+06 | 1.85e+06 | 1.85e+06 | 1.85e+06 | 1.85e+06 |
| P-32 | 1.92e+11 | 1.13e+10 | 7.46e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.60e+09 |
| Ce-41 | 2.95e+09 | 0.00e+00 | 3.22e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.51e+06 |
| Sc-46 | 1.56e+02 | 2.25e+02 | 7.03e+01 | 0.00e+00 | 1.48e+02 | 0.00e+00 | 1.47e+05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.94e+04 | 1.26e+04 | 2.76e+03 | 2.46e+04 | 5.64e+05 |
| Mn-54 | 0.00e+00 | 4.68e+06 | 1.06e+06 | 0.00e+00 | 1.04e+06 | 0.00e+00 | 1.72e+06 |
| Mn-56 | 0.00e+00 | 3.77e-03 | 6.50e-04 | 0.00e+00 | 3.24e-03 | 0.00e+00 | 3.43e-01 |
| Fe-55 | 1.76e+06 | 1.13e+06 | 3.03e+05 | 0.00e+00 | 0.00e+00 | 5.55e+05 | 1.44e+05 |
| Fe-59 | 2.92e+06 | 5.10e+06 | 2.01e+06 | 0.00e+00 | 0.00e+00 | 1.51e+06 | 2.43e+06 |
| Co-57 | 0.00e+00 | 1.07e+06 | 1.75e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.66e+06 |
| Co-58 | 0.00e+00 | 2.91e+06 | 7.26e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.25e+06 |
| Co-60 | 0.00e+00 | 1.06e+07 | 2.50e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.52e+07 |
| Ni-59 | 3.13e+08 | 9.59e+07 | 5.40e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.74e+06 |
| Ni-63 | 4.19e+09 | 2.59e+08 | 1.45e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.29e+07 |
| Ni-65 | 4.27e-01 | 4.83e-02 | 2.20e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.68e+00 |
| Cu-64 | 0.00e+00 | 2.07e+04 | 9.60e+03 | 0.00e+00 | 3.51e+04 | 0.00e+00 | 4.26e+05 |
| Zn-65 | 6.66e+08 | 2.28e+09 | 1.05e+09 | 0.00e+00 | 1.11e+09 | 0.00e+00 | 1.93e+09 |
| Zn-69 | 2.52e-12 | 4.54e-12 | 3.38e-13 | 0.00e+00 | 1.89e-12 | 0.00e+00 | 3.70e-10 |
| Zn-69m | 2.04e+05 | 4.17e+05 | 3.80e+04 | 0.00e+00 | 1.69e+05 | 0.00e+00 | 5.78e+06 |
| Se-79 | 0.00e+00 | 9.33e+08 | 1.73e+08 | 0.00e+00 | 1.08e+09 | 0.00e+00 | 2.48e+07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 2.32e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 1.14e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 1.62e-23 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.67e+09 | 1.32e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.83e+07 |
| Rb-87 | 0.00e+00 | 2.63e+09 | 1.04e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.77e+07 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 2.64e+10 | 0.00e+00 | 7.58e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.43e+08 |
| Sr-90 | 3.91e+11 | 0.00e+00 | 7.92e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.19e+09 |
| Sr-91 | 5.73e+05 | 0.00e+00 | 2.07e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.78e+05 |
| Sr-92 | 9.89e+00 | 0.00e+00 | 3.67e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.07e+02 |
| Y-90 | 8.18e+01 | 0.00e+00 | 2.19e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.13e+05 |
| Y-91 | 8.79e+03 | 0.00e+00 | 2.34e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.30e+05 |
| Y-91m | 7.13e-20 | 0.00e+00 | 2.43e-21 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.38e-16 |
| Y-92 | 6.52e-05 | 0.00e+00 | 1.83e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.24e+00 |
| Y-93 | 2.60e-01 | 0.00e+00 | 7.08e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.05e+03 |
| Zr-93 | 9.53e+02 | 4.54e+01 | 2.73e+01 | 0.00e+00 | 1.34e+02 | 0.00e+00 | 1.18e+04 |
| Zr-95 | 8.16e+02 | 1.99e+02 | 1.41e+02 | 0.00e+00 | 2.14e+02 | 0.00e+00 | 9.91e+04 |
| Zr-97 | 4.89e-01 | 8.38e-02 | 3.83e-02 | 0.00e+00 | 8.45e-02 | 0.00e+00 | 5.35e+03 |
| Nb-93m | 3.03e+05 | 8.19e+04 | 2.56e+04 | 0.00e+00 | 8.00e+04 | 0.00e+00 | 9.79e+06 |
| Nb-95 | 7.12e+04 | 2.93e+04 | 1.70e+04 | 0.00e+00 | 2.10e+04 | 0.00e+00 | 2.48e+07 |
| Nb-97 | 7.39e-12 | 1.58e-12 | 5.68e-13 | 0.00e+00 | 1.23e-12 | 0.00e+00 | 4.97e-07 |
| Mo-93 | 0.00e+00 | 4.18e+08 | 1.35e+07 | 0.00e+00 | 8.37e+07 | 0.00e+00 | 8.96e+06 |
| Mo-99 | 0.00e+00 | 2.50e+07 | 4.87e+06 | 0.00e+00 | 3.73e+07 | 0.00e+00 | 8.23e+06 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 2.67e+07 | 3.60e+07 | 1.12e+07 | 0.00e+00 | 3.04e+08 | 3.50e+06 | 1.56e+08 |
| Tc-99m | 3.32e+00 | 6.84e+00 | 8.82e+01 | 0.00e+00 | 7.36e+01 | 3.58e+00 | 1.99e+03 |
| Ru-103 | 1.04e+03 | 0.00e+00 | 3.48e+02 | 0.00e+00 | 2.17e+03 | 0.00e+00 | 1.27e+04 |
| Ru-105 | 9.75e-04 | 0.00e+00 | 3.28e-04 | 0.00e+00 | 7.17e-03 | 0.00e+00 | 3.88e-01 |
| Ru-106 | 2.28e+04 | 0.00e+00 | 2.85e+03 | 0.00e+00 | 2.70e+04 | 0.00e+00 | 1.73e+05 |
| Rh-105 | 3.98e+05 | 2.60e+05 | 1.75e+05 | 0.00e+00 | 7.23e+05 | 0.00e+00 | 6.47e+06 |
| Pd-107 | 0.00e+00 | 1.17e+07 | 8.34e+05 | 0.00e+00 | 6.70e+07 | 0.00e+00 | 9.34e+06 |
| Pd-109 | 0.00e+00 | 4.86e+04 | 1.17e+04 | 0.00e+00 | 1.79e+05 | 0.00e+00 | 1.19e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT'S MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ac-110m | 4.63e+07 | 3.38e+07 | 2.24e+07 | 0.00e+00 | 4.83e+07 | 0.00e+00 | 1.75e+09 |
| Ac-111 | 7.40e+06 | 2.88e+06 | 1.52e+06 | 0.00e+00 | 6.01e+06 | 0.00e+00 | 6.86e+08 |
| Cc-113m | 0.00e+00 | 2.09e+06 | 7.70e+04 | 0.00e+00 | 1.58e+06 | 0.00e+00 | 3.14e+06 |
| Cd-115m | 0.00e+00 | 1.24e+06 | 4.31e+04 | 0.00e+00 | 6.48e+05 | 0.00e+00 | 7.07e+06 |
| Sr-123 | 5.48e+08 | 8.57e+06 | 1.43e+07 | 8.61e+06 | 0.00e+00 | 0.00e+00 | 1.45e+08 |
| Sr-125 | 6.45e+07 | 1.20e+06 | 2.86e+06 | 1.18e+06 | 0.00e+00 | 0.00e+00 | 9.66e+07 |
| Sr-126 | 1.36e+09 | 1.79e+07 | 4.44e+07 | 4.71e+06 | 0.00e+00 | 0.00e+00 | 6.22e+07 |
| Sb-124 | 2.51e+07 | 3.70e+05 | 7.78e+06 | 6.67e+04 | 0.00e+00 | 1.57e+07 | 7.75e+07 |
| Sb-125 | 1.79e+07 | 1.74e+05 | 3.69e+06 | 2.25e+04 | 0.00e+00 | 1.04e+07 | 2.39e+07 |
| Sb-126 | 5.04e+06 | 9.88e+04 | 1.82e+06 | 3.87e+04 | 0.00e+00 | 3.17e+06 | 5.22e+07 |
| Sb-127 | 5.01e+05 | 8.93e+03 | 1.55e+05 | 6.37e+03 | 0.00e+00 | 2.58e+05 | 1.33e+07 |
| Te-125m | 1.81e+07 | 6.05e+06 | 2.45e+06 | 6.09e+06 | 0.00e+00 | 0.00e+00 | 8.62e+06 |
| Te-127 | 7.61e+02 | 2.55e+02 | 1.64e+02 | 6.20e+02 | 1.86e+03 | 0.00e+00 | 1.60e+04 |
| Te-127m | 5.05e+07 | 1.68e+07 | 6.12e+06 | 1.46e+07 | 1.24e+08 | 0.00e+00 | 2.04e+07 |
| Te-129 | 3.37e-10 | 1.16e-10 | 7.87e-11 | 2.83e-10 | 8.40e-10 | 0.00e+00 | 2.70e-08 |
| Te-129m | 6.69e+07 | 2.29e+07 | 1.03e+07 | 2.57e+07 | 1.67e+08 | 0.00e+00 | 3.99e+07 |
| Te-131 | 4.51e-33 | 1.67e-33 | 1.27e-33 | 4.02e-33 | 1.15e-32 | 0.00e+00 | 1.82e-31 |
| Te-131m | 4.06e+05 | 1.63e+05 | 1.35e+05 | 3.31e+05 | 1.12e+06 | 0.00e+00 | 2.75e+06 |
| Te-132 | 2.53e+06 | 1.25e+06 | 1.17e+06 | 1.85e+06 | 7.84e+06 | 0.00e+00 | 4.64e+06 |
| Te-133m | 2.37e-13 | 1.09e-13 | 1.04e-13 | 2.09e-13 | 7.40e-13 | 0.00e+00 | 1.17e-11 |
| Te-134 | 9.91e-19 | 4.97e-19 | 5.12e-19 | 8.87e-19 | 3.35e-18 | 0.00e+00 | 1.14e-17 |
| I-129 | 8.47e+08 | 6.28e+08 | 4.59e+08 | 4.03e+11 | 7.43e+08 | 0.00e+00 | 1.26e+07 |
| I-130 | 4.27e+05 | 9.40e+05 | 3.77e+05 | 1.05e+08 | 1.03e+06 | 0.00e+00 | 2.01e+05 |
| I-131 | 3.26e+08 | 3.85e+08 | 1.69e+08 | 1.26e+11 | 4.49e+08 | 0.00e+00 | 1.37e+07 |
| I-132 | 1.74e-01 | 3.54e-01 | 1.26e-01 | 1.66e+01 | 3.95e-01 | 0.00e+00 | 2.87e-01 |
| I-133 | 4.36e+06 | 6.35e+06 | 1.86e+06 | 1.15e+09 | 7.46e+06 | 0.00e+00 | 1.07e+06 |
| I-134 | 2.21e-12 | 4.52e-12 | 1.61e-12 | 1.05e-10 | 5.05e-12 | 0.00e+00 | 4.67e-12 |
| I-135 | 1.36e+04 | 2.70e+04 | 9.83e+03 | 2.42e+06 | 3.00e+04 | 0.00e+00 | 9.76e+03 |
| Cs-134 | 1.09e+11 | 2.04e+11 | 2.06e+10 | 0.00e+00 | 5.25e+10 | 2.15e+10 | 5.54e+08 |
| Cs-134m | 4.64e+00 | 7.73e+00 | 3.90e+00 | 0.00e+00 | 2.98e+00 | 6.86e-01 | 6.12e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

R_i factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway R_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 3.94e+10 | 3.58e+10 | 1.87e+09 | 0.00e+00 | 1.02e+10 | 3.88e+09 | 1.29e+08 |
| Cs-136 | 5.93e+09 | 1.74e+10 | 6.51e+09 | 0.00e+00 | 6.95e+09 | 1.42e+09 | 2.65e+08 |
| Cs-137 | 1.54e+11 | 1.81e+11 | 1.28e+10 | 0.00e+00 | 4.85e+10 | 1.96e+10 | 5.65e+08 |
| Cs-138 | 2.70e-22 | 4.40e-22 | 2.13e-22 | 0.00e+00 | 2.19e-22 | 3.42e-23 | 7.03e-22 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 5.27e-08 | 3.49e-11 | 1.53e-09 | 0.00e+00 | 2.10e-11 | 2.12e-11 | 3.34e-06 |
| Ba-140 | 2.89e+07 | 2.89e+04 | 1.49e+06 | 0.00e+00 | 6.87e+03 | 1.78e+04 | 7.10e+06 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 4.87e+00 | 1.92e+00 | 4.94e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.25e+04 |
| La-141 | 3.47e-05 | 1.01e-05 | 1.75e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.15e+00 |
| La-142 | 2.09e-11 | 7.67e-12 | 1.84e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.30e-06 |
| Ce-141 | 5.20e+03 | 3.17e+03 | 3.74e+02 | 0.00e+00 | 9.79e+02 | 0.00e+00 | 1.64e+06 |
| Ce-143 | 4.77e+01 | 3.16e+04 | 3.61e+00 | 0.00e+00 | 9.21e+00 | 0.00e+00 | 1.85e+05 |
| Ce-144 | 2.79e+05 | 1.14e+05 | 1.56e+04 | 0.00e+00 | 4.62e+04 | 0.00e+00 | 1.60e+07 |
| Pr-143 | 1.78e+02 | 6.67e+01 | 8.84e+00 | 0.00e+00 | 2.48e+01 | 0.00e+00 | 9.41e+04 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 1.06e+02 | 1.09e+02 | 6.65e+00 | 0.00e+00 | 4.19e+01 | 0.00e+00 | 6.88e+04 |
| Pm-147 | 1.88e+03 | 1.59e+02 | 7.72e+01 | 0.00e+00 | 2.37e+02 | 0.00e+00 | 4.50e+04 |
| Pm-148 | 6.68e+01 | 9.65e+00 | 4.86e+00 | 0.00e+00 | 1.15e+01 | 0.00e+00 | 1.03e+05 |
| Pm-148m | 5.88e+02 | 1.49e+02 | 1.17e+02 | 0.00e+00 | 1.71e+02 | 0.00e+00 | 1.94e+05 |
| Pm-149 | 4.96e+00 | 6.50e-01 | 2.84e-01 | 0.00e+00 | 7.91e-01 | 0.00e+00 | 1.75e+04 |
| Pm-151 | 7.32e-01 | 1.07e-01 | 5.40e-02 | 0.00e+00 | 1.27e-01 | 0.00e+00 | 4.94e+03 |
| Sm-151 | 1.43e+03 | 3.29e+02 | 7.10e+01 | 0.00e+00 | 2.24e+02 | 0.00e+00 | 2.75e+04 |
| Sm-153 | 2.29e+00 | 1.77e+00 | 1.36e-01 | 0.00e+00 | 3.71e-01 | 0.00e+00 | 9.25e+03 |
| Eu-152 | 3.32e+03 | 8.81e+02 | 7.43e+02 | 0.00e+00 | 2.47e+03 | 0.00e+00 | 7.82e+04 |
| Eu-154 | 1.30e+04 | 1.81e+03 | 1.09e+03 | 0.00e+00 | 4.91e+03 | 0.00e+00 | 2.26e+05 |
| Eu-155 | 2.61e+03 | 3.01e+02 | 1.56e+02 | 0.00e+00 | 6.75e+02 | 0.00e+00 | 4.04e+05 |
| Eu-156 | 2.67e+02 | 1.66e+02 | 2.63e+01 | 0.00e+00 | 7.65e+01 | 0.00e+00 | 1.56e+05 |
| Tb-160 | 1.05e+03 | 0.00e+00 | 1.31e+02 | 0.00e+00 | 2.99e+02 | 0.00e+00 | 1.40e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway Ri

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 6.17e+03 | 1.33e+03 | 1.05e+03 | 0.00e+00 | 1.76e+03 | 0.00e+00 | 1.31e+05 |
| W-181 | 3.87e+04 | 1.19e+04 | 1.33e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.67e+05 |
| W-185 | 1.48e+06 | 4.62e+05 | 5.27e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.62e+06 |
| W-187 | 7.31e+03 | 5.08e+03 | 1.76e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.99e+05 |
| Pb-210 | 3.23e+10 | 8.67e+09 | 1.45e+09 | 0.00e+00 | 2.64e+10 | 0.00e+00 | 1.42e+06 |
| Bi-210 | 4.10e+05 | 2.64e+06 | 2.36e+05 | 0.00e+00 | 2.05e+07 | 0.00e+00 | 5.20e+06 |
| Po-210 | 8.25e+08 | 1.58e+09 | 1.97e+08 | 0.00e+00 | 3.35e+09 | 0.00e+00 | 1.76e+07 |
| Ra-223 | 1.38e+11 | 2.02e+08 | 2.77e+10 | 0.00e+00 | 3.67e+09 | 0.00e+00 | 1.08e+09 |
| Ra-224 | 1.64e+10 | 3.69e+07 | 3.26e+09 | 0.00e+00 | 6.72e+08 | 0.00e+00 | 4.33e+08 |
| Ra-225 | 2.14e+11 | 2.41e+08 | 4.25e+10 | 0.00e+00 | 4.40e+09 | 0.00e+00 | 1.20e+09 |
| Ra-226 | 4.90e+12 | 3.76e+08 | 4.06e+12 | 0.00e+00 | 6.88e+09 | 0.00e+00 | 2.72e+09 |
| Ra-228 | 3.39e+12 | 2.02e+08 | 3.81e+12 | 0.00e+00 | 3.71e+09 | 0.00e+00 | 4.59e+08 |
| Ac-225 | 7.02e+04 | 9.01e+04 | 4.71e+03 | 0.00e+00 | 6.61e+03 | 0.00e+00 | 7.81e+05 |
| Ac-227 | 2.21e+07 | 3.78e+06 | 1.37e+06 | 0.00e+00 | 7.69e+05 | 0.00e+00 | 4.19e+05 |
| Th-227 | 3.13e+05 | 5.24e+03 | 8.99e+03 | 0.00e+00 | 1.93e+04 | 0.00e+00 | 1.49e+06 |
| Th-228 | 1.19e+07 | 1.63e+05 | 4.04e+05 | 0.00e+00 | 7.63e+05 | 0.00e+00 | 2.82e+06 |
| Th-229 | 1.24e+08 | 3.12e+06 | 2.07e+06 | 0.00e+00 | 1.50e+07 | 0.00e+00 | 4.00e+05 |
| Th-230 | 1.88e+07 | 9.38e+05 | 5.23e+05 | 0.00e+00 | 4.50e+06 | 0.00e+00 | 3.08e+05 |
| Th-232 | 2.09e+07 | 8.05e+05 | 8.14e+03 | 0.00e+00 | 3.85e+06 | 0.00e+00 | 2.62e+05 |
| Th-234 | 2.04e+03 | 1.11e+02 | 5.90e+01 | 0.00e+00 | 4.10e+02 | 0.00e+00 | 3.51e+05 |
| Pa-231 | 3.74e+07 | 1.23e+06 | 1.49e+06 | 0.00e+00 | 6.61e+06 | 0.00e+00 | 3.67e+05 |
| Pa-233 | 9.66e+01 | 1.89e+01 | 1.69e+01 | 0.00e+00 | 5.19e+01 | 0.00e+00 | 4.53e+04 |
| U-232 | 1.19e+10 | 0.00e+00 | 1.07e+09 | 0.00e+00 | 1.17e+09 | 0.00e+00 | 3.47e+07 |
| U-233 | 2.51e+09 | 0.00e+00 | 1.91e+08 | 0.00e+00 | 5.33e+08 | 0.00e+00 | 3.21e+07 |
| U-234 | 2.41e+09 | 0.00e+00 | 1.88e+08 | 0.00e+00 | 5.23e+08 | 0.00e+00 | 3.14e+07 |
| U-235 | 2.31e+09 | 0.00e+00 | 1.76e+08 | 0.00e+00 | 4.90e+08 | 0.00e+00 | 4.00e+07 |
| U-236 | 2.31e+09 | 0.00e+00 | 1.80e+08 | 0.00e+00 | 4.99e+08 | 0.00e+00 | 2.95e+07 |
| U-237 | 6.47e+04 | 0.00e+00 | 1.73e+04 | 0.00e+00 | 1.61e+05 | 0.00e+00 | 2.76e+06 |
| U-238 | 2.21e+09 | 0.00e+00 | 1.64e+08 | 0.00e+00 | 4.58e+08 | 0.00e+00 | 2.82e+07 |
| Np-237 | 1.18e+07 | 7.85e+05 | 5.18e+05 | 0.00e+00 | 3.13e+06 | 0.00e+00 | 4.06e+05 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.


**GOAT's MILK PATHWAY DOSE FACTORS DUE TO
RADIONUCLIDES OTHER THAN NOBLE GASES, R_i**

Ri factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Gaseous Release Goat's Milk Pathway Ri


| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 4.19e+01 | 1.05e+00 | 6.48e-01 | 0.00e+00 | 2.30e+00 | 0.00e+00 | 1.41e+04 |
| Np-239 | 4.38e+00 | 3.92e-01 | 2.21e-01 | 0.00e+00 | 7.81e-01 | 0.00e+00 | 1.13e+04 |
| Pu-238 | 2.53e+06 | 2.96e+05 | 6.71e+04 | 0.00e+00 | 2.39e+05 | 0.00e+00 | 1.49e+05 |
| Pu-239 | 2.72e+06 | 3.06e+05 | 6.99e+04 | 0.00e+00 | 2.53e+05 | 0.00e+00 | 1.36e+05 |
| Pu-240 | 2.72e+06 | 3.06e+05 | 6.99e+04 | 0.00e+00 | 2.53e+05 | 0.00e+00 | 1.39e+05 |
| Pu-241 | 8.37e+04 | 3.47e+03 | 1.74e+03 | 0.00e+00 | 6.24e+03 | 0.00e+00 | 2.86e+03 |
| Pu-242 | 2.53e+06 | 2.94e+05 | 6.73e+04 | 0.00e+00 | 2.43e+05 | 0.00e+00 | 1.34e+05 |
| Pu-244 | 2.94e+06 | 3.38e+05 | 7.72e+04 | 0.00e+00 | 2.78e+05 | 0.00e+00 | 1.99e+05 |
| Am-241 | 7.14e+06 | 6.21e+06 | 5.33e+05 | 0.00e+00 | 3.20e+06 | 0.00e+00 | 3.76e+05 |
| Am-242m | 7.45e+06 | 6.02e+06 | 5.58e+05 | 0.00e+00 | 3.28e+06 | 0.00e+00 | 4.78e+05 |
| Am-243 | 7.11e+06 | 6.07e+06 | 5.23e+05 | 0.00e+00 | 3.14e+06 | 0.00e+00 | 4.46e+05 |
| Cm-242 | 6.17e+05 | 5.72e+05 | 4.10e+04 | 0.00e+00 | 1.18e+05 | 0.00e+00 | 3.71e+05 |
| Cm-243 | 6.90e+06 | 5.67e+06 | 4.43e+05 | 0.00e+00 | 1.61e+06 | 0.00e+00 | 3.99e+05 |
| Cm-244 | 5.81e+06 | 4.78e+06 | 3.74e+05 | 0.00e+00 | 1.33e+06 | 0.00e+00 | 3.86e+05 |
| Cm-245 | 8.84e+06 | 7.16e+06 | 5.58e+05 | 0.00e+00 | 2.13e+06 | 0.00e+00 | 3.60e+05 |
| Cm-246 | 8.74e+06 | 7.16e+06 | 5.58e+05 | 0.00e+00 | 2.13e+06 | 0.00e+00 | 3.54e+05 |
| Cm-247 | 8.54e+06 | 7.06e+06 | 5.48e+05 | 0.00e+00 | 2.09e+06 | 0.00e+00 | 4.65e+05 |
| Cm-248 | 7.06e+07 | 5.82e+07 | 4.52e+06 | 0.00e+00 | 1.73e+07 | 0.00e+00 | 7.50e+06 |
| Cf-252 | 5.92e+06 | 0.00e+00 | 1.43e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.45e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.


LIQUID WASTE MANAGEMENT SYSTEM EFFLUENT SOURCES AND RELEASE PATHWAYS AND POINTS

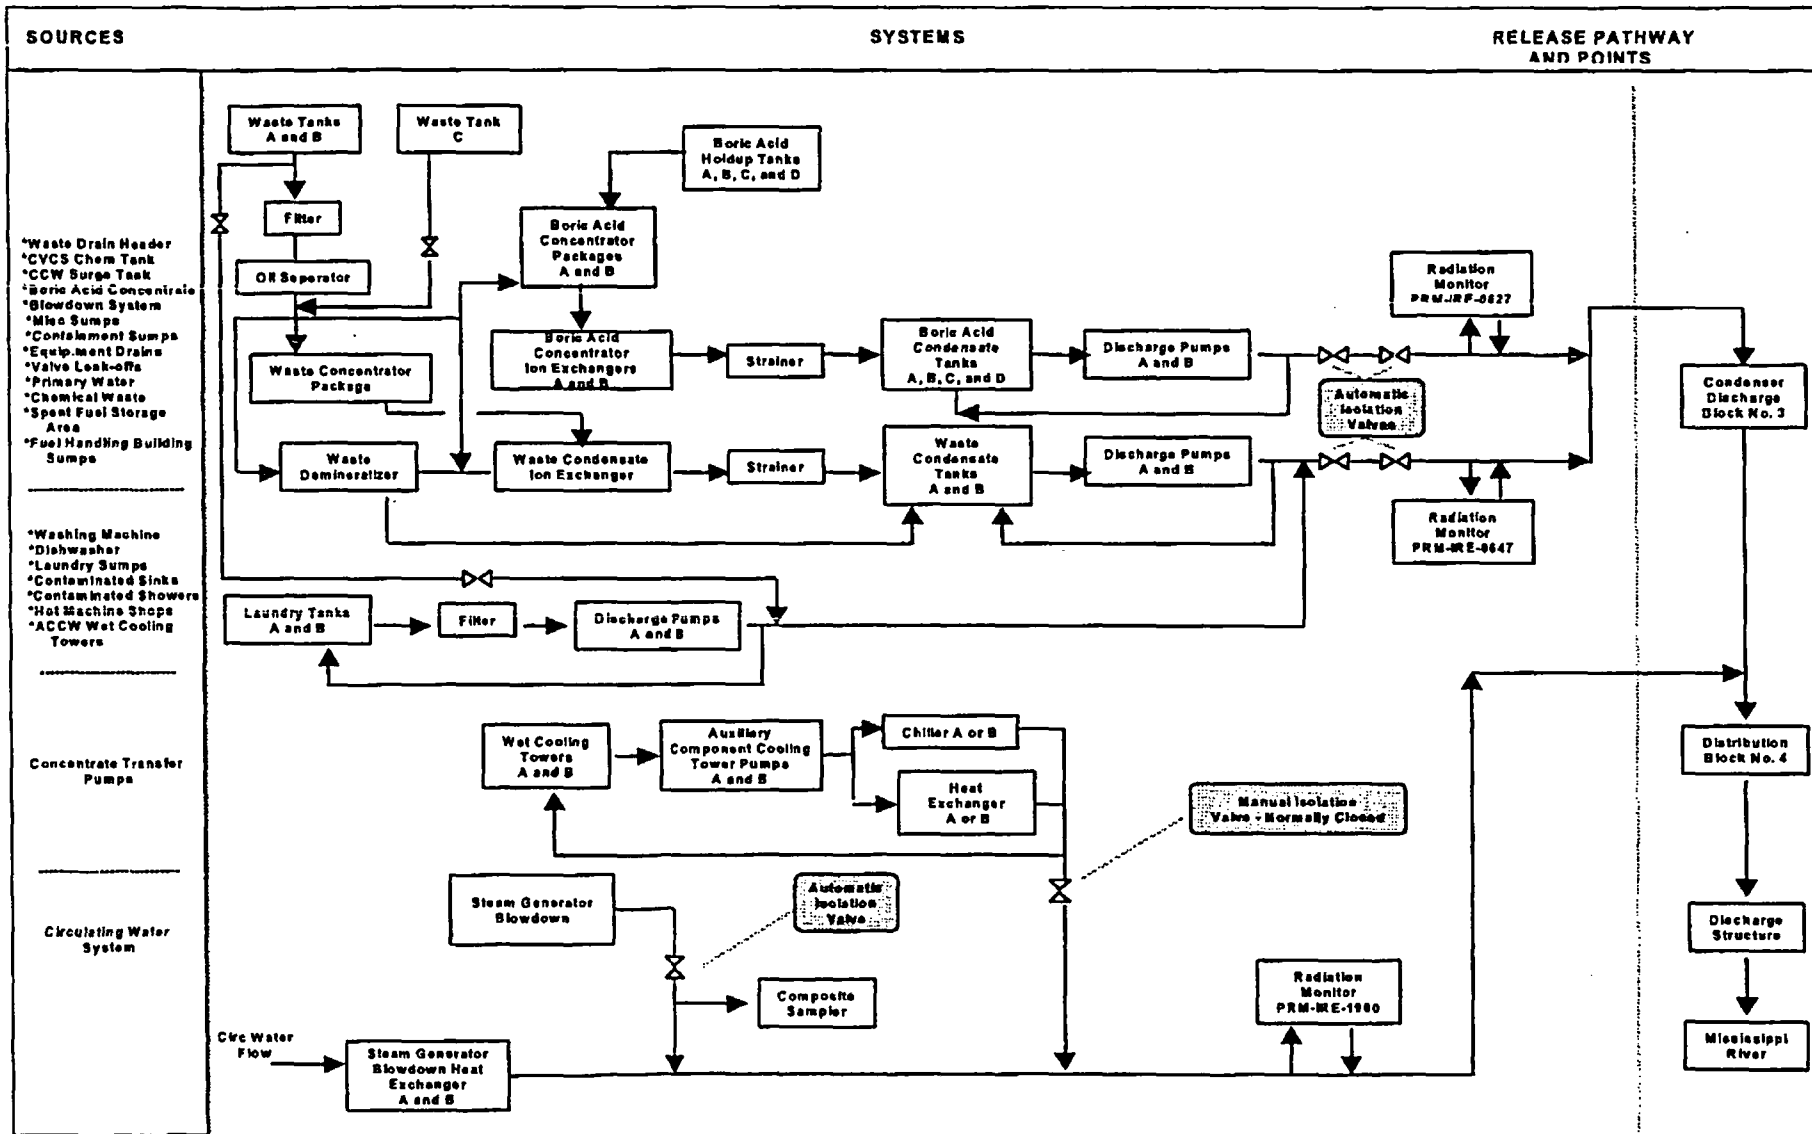

LIQUID WASTE MANAGEMENT SYSTEM EFFLUENT SOURCES AND RELEASE PATHWAYS AND POINTS

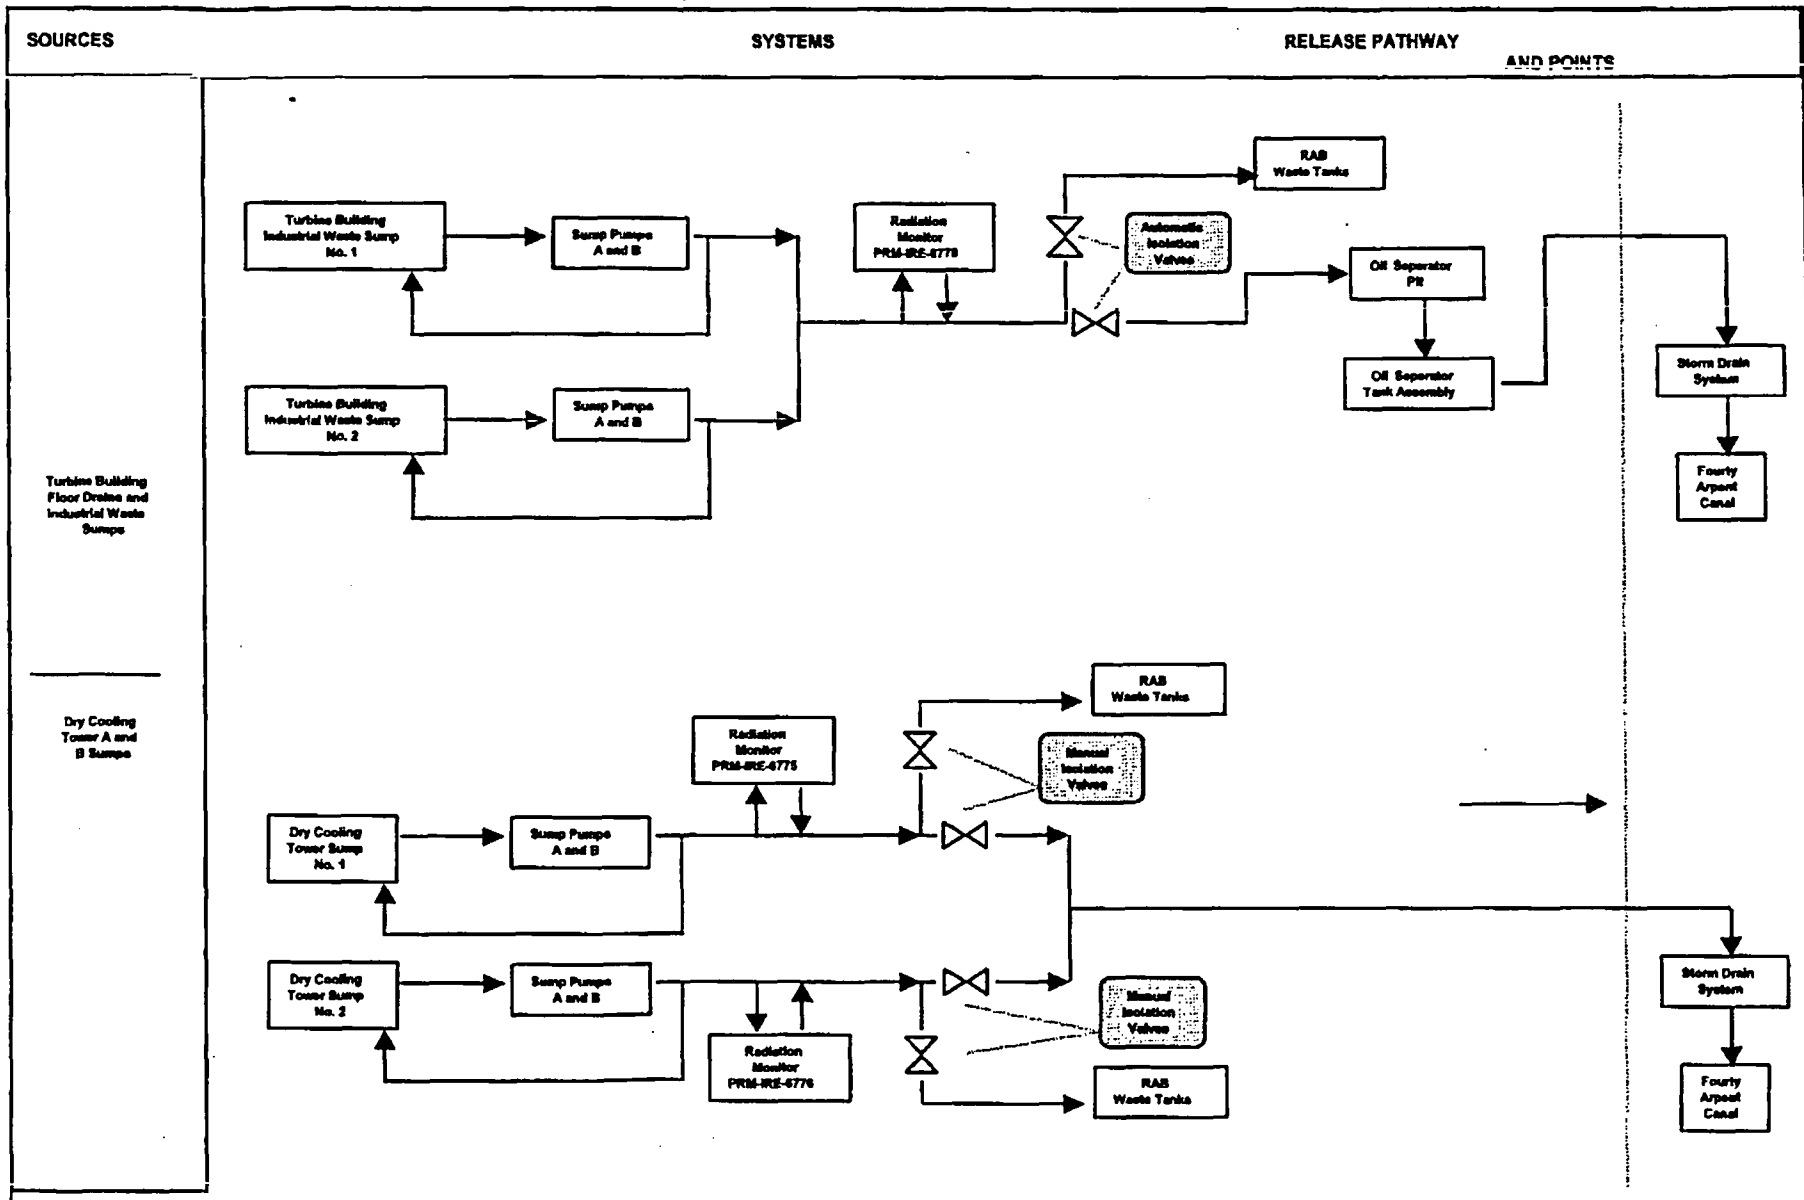

GASEOUS EFFLUENT SOURCES, GASEOUS WASTE MANAGEMENT SYSTEM EFFLUENT SOURCES AND EXHAUST RELEASE POINTS

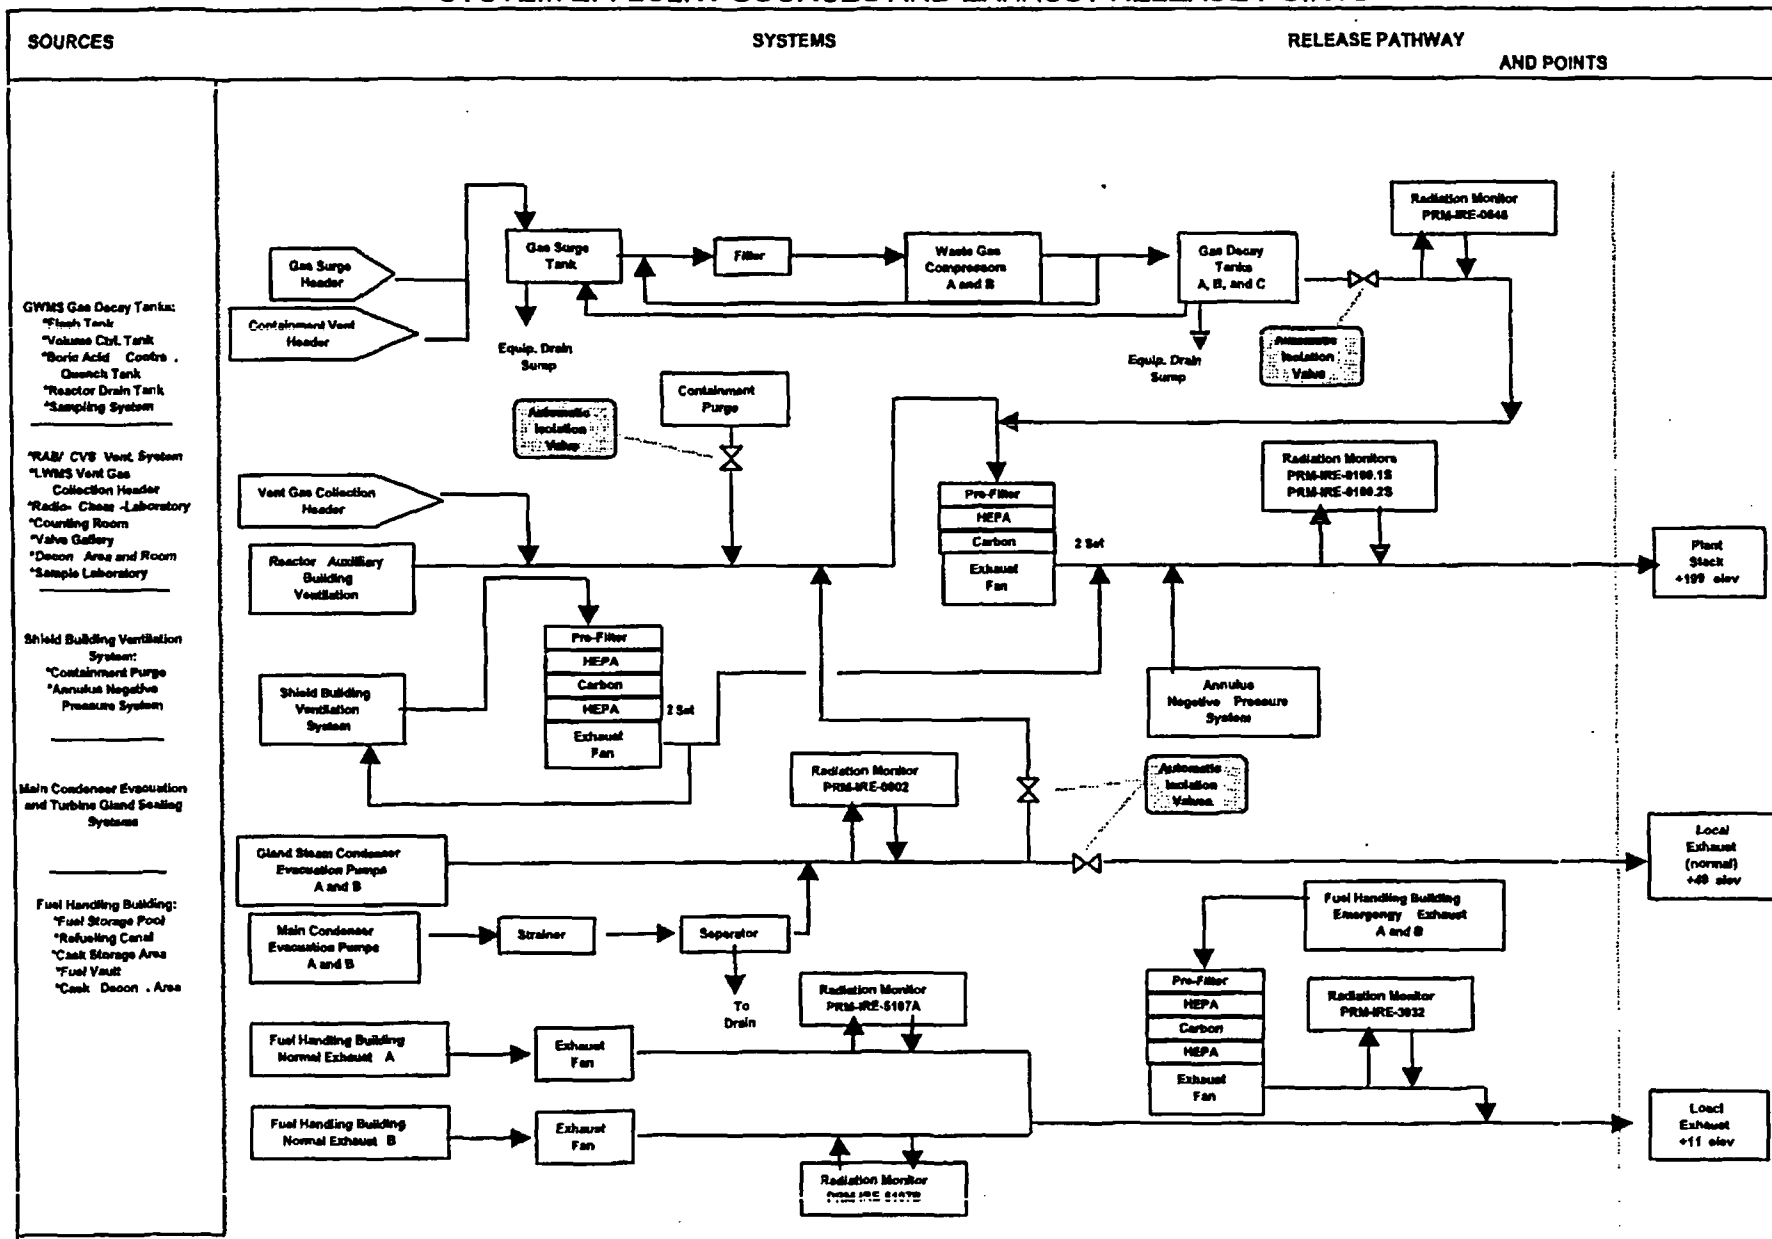

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

| SAMPLE | LOCATION | ANALYSIS | FREQUENCY* | VOLUME |
|---|---|-----------------------------------|---|-------------------------|
| TLD | A-2, B-1, C-1, D-2, E-1, F-2, G-2, H-2, J-2, K-1, L-1, M-1, N-1, P-1, Q-1, R-1, A-5, B-4, D-5, E-5 F-4, G-4, H-8, P-6, Q-5 R-6, F-9, G-8, E-15, J-15 E-30 | TLD ⁽¹⁾ | Quarterly | N/A |
| Radioiodine and Particulates | APP-1, APQ-1, APF-1, APC-1, APE-30 | Gross beta ⁽²⁾ , I-131 | Bi-Weekly | 285m ³ /wk |
| | | γ isotopic ⁽²⁾ | Quarterly composite | 3700m ³ /qtr |
| Ground Water | NONE | NONE | NONE | NONE |
| Drinking Water/ Surface Water ⁽³⁾ | DWF-2 ⁽⁴⁾ /SWF-2 ⁽⁴⁾ DWP-7/SWP-7 DWE-5 ⁽⁴⁾ /SWE-5 ⁽⁴⁾ SWK-1 | H-3 | Quarterly composite ⁽⁵⁾ | Homogeneous 8 liters |
| | | Gross beta, γ isotopic | Quarterly composite ⁽⁵⁾ | |
| | | I-131 ⁽⁷⁾ | Monthly composite ⁽¹⁰⁾ | |
| Shoreline Sediment | SHWE-3, SHWK-1, SHWQ-6 | γ isotopic | Annually | 2 Kilograms |
| Milk | MKE-3, MKR-38 | γ isotopic, I-131 | Quarterly | 8 liters |
| Fish | FH-1, FH-2, FH-3 | γ isotopic | In season or Annually ⁽⁹⁾ | 500 grams |
| Broad Leaf | BLQ-1, BLB-1, BLE-20 | γ isotopic, I-131 | Quarterly | 500 grams |
| Sanitary System ⁽¹¹⁾ | SWR-1 | γ isotopic | Monthly Composite ⁽¹⁰⁾ | Homogeneous 1 Liter |

*Sample collection at specific locations may be increased at any time in order to increase the effectiveness of the REMP program.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

1. One or more instrument, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. A TLD is considered one phosphor, two or more phosphors in a packet are considered two or more dosimeters. Geographical limitations affect siting of dosimeters.
2. Airborne particulate sample filters shall be analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air particulate samples is greater than ten times the yearly mean of control samples, gamma isotopic analysis shall be performed on the individual samples. Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.
3. Drinking Water and Surface Water samples are identical where designated.
4. The downstream sample is beyond the mixing zone.
5. A composite sample will contain aliquots of sample taken proportional to the quantity of flowing liquid that results in a specimen representative of the liquid flow.
6. DELETED
7. This analysis will be performed when the dose calculated for the consumption of water is greater than 1 mrem per year as calculated for maximum organ and age group.
8. DELETED
9. Striped mullet, gizzard shad, freshwater drum, and catfish will be collected. If they are not available, then substitute species will be collected and identified in reporting.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

10. An analysis frequency of every 4 weeks satisfies this requirement. The maximum frequency is monthly.
11. Sanitary System Sampling and analysis performed additionally for this location. This sampling requirement is not derived directly from REMP requirements, but it represents another possible environmental interface with the plant. Information from this sample location will not normally be included in the Annual Radiological Environmental Operating Report.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-------------------------------|---|----------------------------|-----------------------------------|
| DIRECT RADIATION (TLD) | | | |
| A-2 | (Eastbank) Located on a utility pole on LA 628 near the Zephirin L. Periloux Fire House. | 188° 1.27 | N 30.01381 W 90.45780 |
| B-1 | (Eastbank) On fence enclosing the transmission tower 0.3 miles west (up river) from Little Gypsy on LA 628. | 200° 0.75 | N 30.00576 W 90.45672 |
| C-1 | (Eastbank) On fence enclosing the Little Gypsy Cooling Water Intake on LA 628 near APC-1. | 219° 0.67 | N 30.00307 W 90.46401 |
| D-2 | (Eastbank) Located approximately 0.3 miles east of Little Gypsy Power Station on stop sign post located at the peak of the levee on the west entrance road through the Bonnet Carre Spillway. | 238° 1.24 | N 30.00471 W 90.45343 |

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|--|----------------------------|-----------------------------------|
| | <u>DIRECT RADIATION (TLD) (continued)</u> | | |
| E-1 | (Westbank) Located on utility pole along LA 18 approximately 0.3 miles east of Waterford 3 plant entrance. | 277° 0.41 | N 29.99468 W 90.46437 |
| F-2 | (Westbank) Located on southeast corner of fence enclosure surrounding the Entergy substation, 0.2 miles south of LA 18 on LA 3142. | 294° 1.15 | N 29.98842 W 90.45387 |
| G-2 | (Westbank) Located on fence east of LA 3142 approximately 0.3 miles north of railroad overpass. | 309° 1.26 | N 29.98371 W 90.45498 |
| H-2 | (Westbank) Located off LA 3142 on southwest edge of fence along shell road 0.4 miles north of LA 3127/3142 intersection. | 327° 1.54 | N 29.97659 W 90.45753 |

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|---|----------------------------|-----------------------------------|
| | <u>DIRECT RADIATION (TLD) (continued)</u> | | |
| J-2 | (Westbank) Located on fence enclosure for valve station south of LA 3127 approximately 0.6 miles west of LA 3127/3142 intersection. | 356° 1.38 | N 29.97546 W 90.47003 |
| K-1 | (Westbank) Located on stop sign at entrance to Entergy Education Center on LA 3127. | 23° 1.06 | N 29.98153 W 90.47843 |
| L-1 | (Westbank) Located on gated entrance off of LA 3127, approximately 1.6 miles west of LA 3127/3142 intersection. | 42° 1.06 | N 29.98427 W 90.48314 |
| M-1 | (Westbank) Located on south gate of the Waterford 1 and 2 fuel oil storage tank enclosure. | 67° 0.76 | N 29.99148 W 90.48286 |
| N-1 | (Westbank) Located on pole at corner of Railroad Ave. and School House Road. | 93° 0.98 | N 29.99649 W 90.48739 |

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|---|-------------------------------|-----------------------------------|
| P-1 | <u>DIRECT RADIATION (TLD) (continued)</u> (Westbank) Located on fence enclosing air sample station APP-1. | 119° 0.84 | N 30.00158 W 90.48323 |
| Q-1 | (Westbank) Located on fence enclosing air sample station APQ-1. | 132° 0.81 | N 30.00355 W 90.48091 |
| R-1 | (Westbank) Located at Waterford 1 and 2 Cooling Water Intake Structure on the catwalk. | 147° 0.51 | N 30.00181 W 90.47564 |
| A-5 | (Eastbank) Located on utility pole at intersection of Oswald Avenue and US 61. | 177° 4.59 | N 30.06212 W 90.47334 |
| B-4 | (Eastbank) Located on utility pole guidewire next to transmission tower south of weigh station on US 61 at St. John/ St. Charles Parish line. | 197° 3.75 | N 30.04717 W 90.45130 |

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|---|-------------------------------|-----------------------------------|
| | <u>DIRECT RADIATION (TLD) (continued)</u> | | |
| D-5 | (Eastbank) Located on gate on shell road approximately 0.1 miles north of US 61/LA 48 intersection. | 249° 4.09 | N 30.01628 W 90.40730 |
| E-5 | (Eastbank) Located on the Norco Substation fence enclosure at the end of Wesco St. off of LA 48. | 266° 4.08 | N 29.99840 W 90.40314 |
| F-4 | (Westbank) Located on utility pole behind house at 646 Aquarius St. in Hahnville. | 289° 3.53 | N 29.97818 W 90.41582 |
| G-4 | (Westbank) Located on pole on LA 3160 approximately 0.1 miles north of railroad track. | 309° 3.30 | N 29.96507 W 90.42867 |

2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|--|----------------------------|-----------------------------------|
| H-3 | <u>DIRECT RADIATION (TLD) (continued)</u> (Westbank) Located on a road sign on south side of HWY 90 directly in front of Hahnville High School approximately 0.1 miles east of Tiger Dr. | 331° 8.13 | N 29.89178 W 90.40725 |
| P-6 | (Westbank) Located on a fence surrounding the communications tower at the LA 640/railroad track intersection. | 107° 5.58 | N 30.02121 W 90.55941 |
| Q-5 | (Westbank) Located on utility pole along LA 18 across from Mississippi River marker 137. | 129° 5.01 | N 30.04274 W 90.53464 |
| R-6 | (Eastbank) Located on fence enclosure approximately 0.2 miles west of US 61 on LA 3223 near railroad crossing. | 160° 5.52 | N 30.07108 W 90.50183 |
| F-9 | (Eastbank) Located on entrance gate to Destrehan Substation just north of railroad tracks on Jonathan St.. Johnathan St. is approximately 1.5 miles east of Luling-Destrehan Bridge, off of LA 48. | 294° 8.18 | N 29.94563 W 90.34739 |

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|---|----------------------------|-----------------------------------|
| G-8 | <p style="text-align: center;"><u>DIRECT RADIATION (TLD) (continued)</u></p> <p>(Westbank) Located on southern most corner of the back fence of Entergy Office in Luling.</p> | 305° 7.74 | N 29.93055 W 90.36592 |
| E-15 | (Eastbank) Located on Kenner Substation fence enclosure on Alliance Ave. approximately 0.1 miles from LA 48. | 275° 11.7 | N 29.97695 W 90.27658 |
| J-15 | (Westbank) Located on pole near the LA 631/Hwy 90 intersection in Des Allemands. | 357° 11.7 | N 29.82575 W 90.46457 |
| E-30* | (Westbank) Located at entrance to the Entergy Office on Delaronde St. in Algiers. | 276° 25.2 | N 29.95233 W 90.05441 |

* DENOTES CONTROL LOCATIONS

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|--|----------------------------|-----------------------------------|
| AIRBORNE | | | |
| APP-1 | (Westbank) Located in soybean/sugarcane field at northwest corner of Short St. in Killona. | 119° 0.84 | N 30.00158 W 90.48323 |
| APQ-1 | (Westbank) Located in soybean/sugarcane field off LA 18 approximately 0.6 miles east of LA 18/3141 intersection. | 132° 0.81 | N 30.00356 W 90.48093 |
| APF-1 | (Westbank) Located on north side of Secondary Meteorological Tower. | 299° 0.35 | N 29.99302 W 90.46601 |
| APC-1 | (Eastbank) Located inside the Little Gypsy Cooling Water Intake Structure fence enclosure. | 219° 0.67 | N 30.00307 W 90.46401 |
| APE-30* | (Westbank) Located on the roof of the Energy Office building on Delaronde St. in Algiers. | 276° 25.2 | N 29.95289 W 90.05430 |

* DENOTES CONTROL LOCATIONS

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|--|----------------------------|-----------------------------------|
| | BROAD LEAF | | |
| BLQ-1 | (Westbank) Located near air sample station APQ-1. | 132° 0.83 | N 30.00367 W 90.48132 |
| BLB-1 | (Eastbank) Located near transmission tower west of Little Gypsy on LA 628. | 197° 0.81 | N 30.00665 W 90.46691 |
| BLE-20* | (Westbank) Located on property of Nine Mile Point in Westwego, LA. | 280° 19.7 | N 29.94142 W 90.14909 |

* DENOTES CONTROL LOCATION(S)

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|---|-------------------------------|-----------------------------------|
| | INGESTION | | |
| | MILK | | |
| MKE-3 | (Westbank) Located at the Zeringue's house on LA 18 in Taft. | 279° 2.35 | N 29.98926 W 90.43243 |
| MKR-38* | (Eastbank) Located at 30300 Cleveland Road, Albany, LA. | 169° 38.0 | N 30.32361 W 90.34793 |
| | FISH | | |
| FH-1* | Upstream of the plant intake structure. | N/A | N/A |
| FH-2 | Downstream of the plant discharge structure. | N/A | N/A |
| FH-3 | (Westbank) Waterways downstream of plant discharge directed to 40 Arpent Canal. | N/A | N/A |

* DENOTES CONTROL LOCATIONS

N/A - Not Applicable for this sampling location.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|------------------|--|----------------------------|-----------------------------------|
| | <u>WATERBORNE</u> | | |
| SWK-1 | (Westbank) Located at 40 Arpent Canal south of the plant. The canal is northwest of the shell access road/railroad track intersection. | 14° 0.49 | N 29.93866 W 90.47324 |
| SHWE-3 | (Westbank) Located at Foot Ferry Landing off LA 18 in Taft. | 276° 2.99 | N 29.93063 W 90.42151 |
| SHWK-1 | (Westbank) Located at 40 Arpent Canal south of plant. The canal is northwest of the shell access road/railroad track intersection. | 14° 0.49 | N 29.98866 W 90.47324 |
| SHWQ-6* | (Eastbank) Located off LA 628 approximately 0.1 miles east of Reserve ferry landing. | 129° 5.99 | N 30.05154 W 90.54748 |
| DWE-5 SWE-5 | (Eastbank) Located at St. Charles Parish Waterworks off LA 48 in New Sarpy. | 277° 4.59 | N 29.98622 W 90.39525 |
| DWP-7* SWP-7* | (Westbank) Located at St. John Parish Waterworks off LA 18 in Edgard. | 117° 7.37 | N 30.04629 W 90.57931 |
| DWF-2 SWF-2 | (Westbank) Located Dow Chemical Plant drinking water canal. | 302° 1.51 | N 29.98371 W 90.44989 |

* DENOTES CONTROL LOCATIONS

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SAMPLE LOCATION TABLE (Continued)

| LOCATION NUMBER | LOCATION DESCRIPTION | BEARING/ MILES TO PLANT | Position Latitude Longitude |
|-----------------|---|-------------------------------|-----------------------------------|
| | SANITARY SYSTEM | | |
| SWR-1** | Sewage lift station NW of MSB between Protected Area Fence and LA 18 0.1 miles from the plant. | 153° 0.10 | N 29.99384 W 90.47184 |

** Sampling requirements are not derived directly from REMP requirements therefore results will not appear in the annual report. However, it represents another possible environmental interface with the plant.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

SECTOR AND ZONE DESIGNATORS FOR RADIOLOGICAL SAMPLING AND MONITORING POINTS


| SECTOR NOMENCLATURE | | ZONE NOMENCLATURE | |
|--|-------------------|------------------------|------|
| CENTERLINE OF SECTOR IN DEGREES TRUE NORTH FROM FACILITY | 22 1/2° SECTOR | MILES FROM FACILITY | ZONE |
| 0 & 360 | *A N | 0-1 | 1 |
| 22 1/2 | B NNE | 1-2 | 2 |
| 45 | C NE | 2-3 | 3 |
| 67 1/2 | D ENE | 3-4 | 4 |
| 90 | E E | 4-5 | 5 |
| 112 1/2 | F ESE | 5-6 | 6 |
| 135 | G SE | 6-7 | 7 |
| 157 1/2 | H OR SSE | 7-8 | 8 |
| 180 | J S | 8-9 | 9 |
| 202 1/2 | K SSW | 9-10 | 10 |
| 225 | L SW | 10-15 | 15 |
| 247 1/2 | M WSW | 15-20 | 20 |
| 270 | N W | 20-25 | 25 |
| 292 1/2 | P WNW | 25-30 | 30 |
| 315 | Q NW | 30-35 | 35 |
| 337 1/2 | R NNW | 35-40 | 40 |
| | | 40-45 | 45 |
| | | 45-50 | 50 |

AREA SEGMENT - An area is identified by a Sector and Zone designator. Thus, area N-1 is that area which lies between 348 3/4 and 11 1/4 degrees true north from the facility out to a radius of 1 mile. Area G-4 would be that area between 123 3/4 to 146 1/4 degrees and the 3- and 4-mile arcs from the facility. For Airborne, Ingestion (milk), and Food Products pathways, the sector designator will be preceded by acronyms AP, MK, and FP, respectively.

* The letters I and O have been omitted from these sector designators so as to eliminate possible confusion between letters and numbers.


RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

REMP SAMPLING LOCATIONS WITHIN 2 MILES OF WATERFORD 3

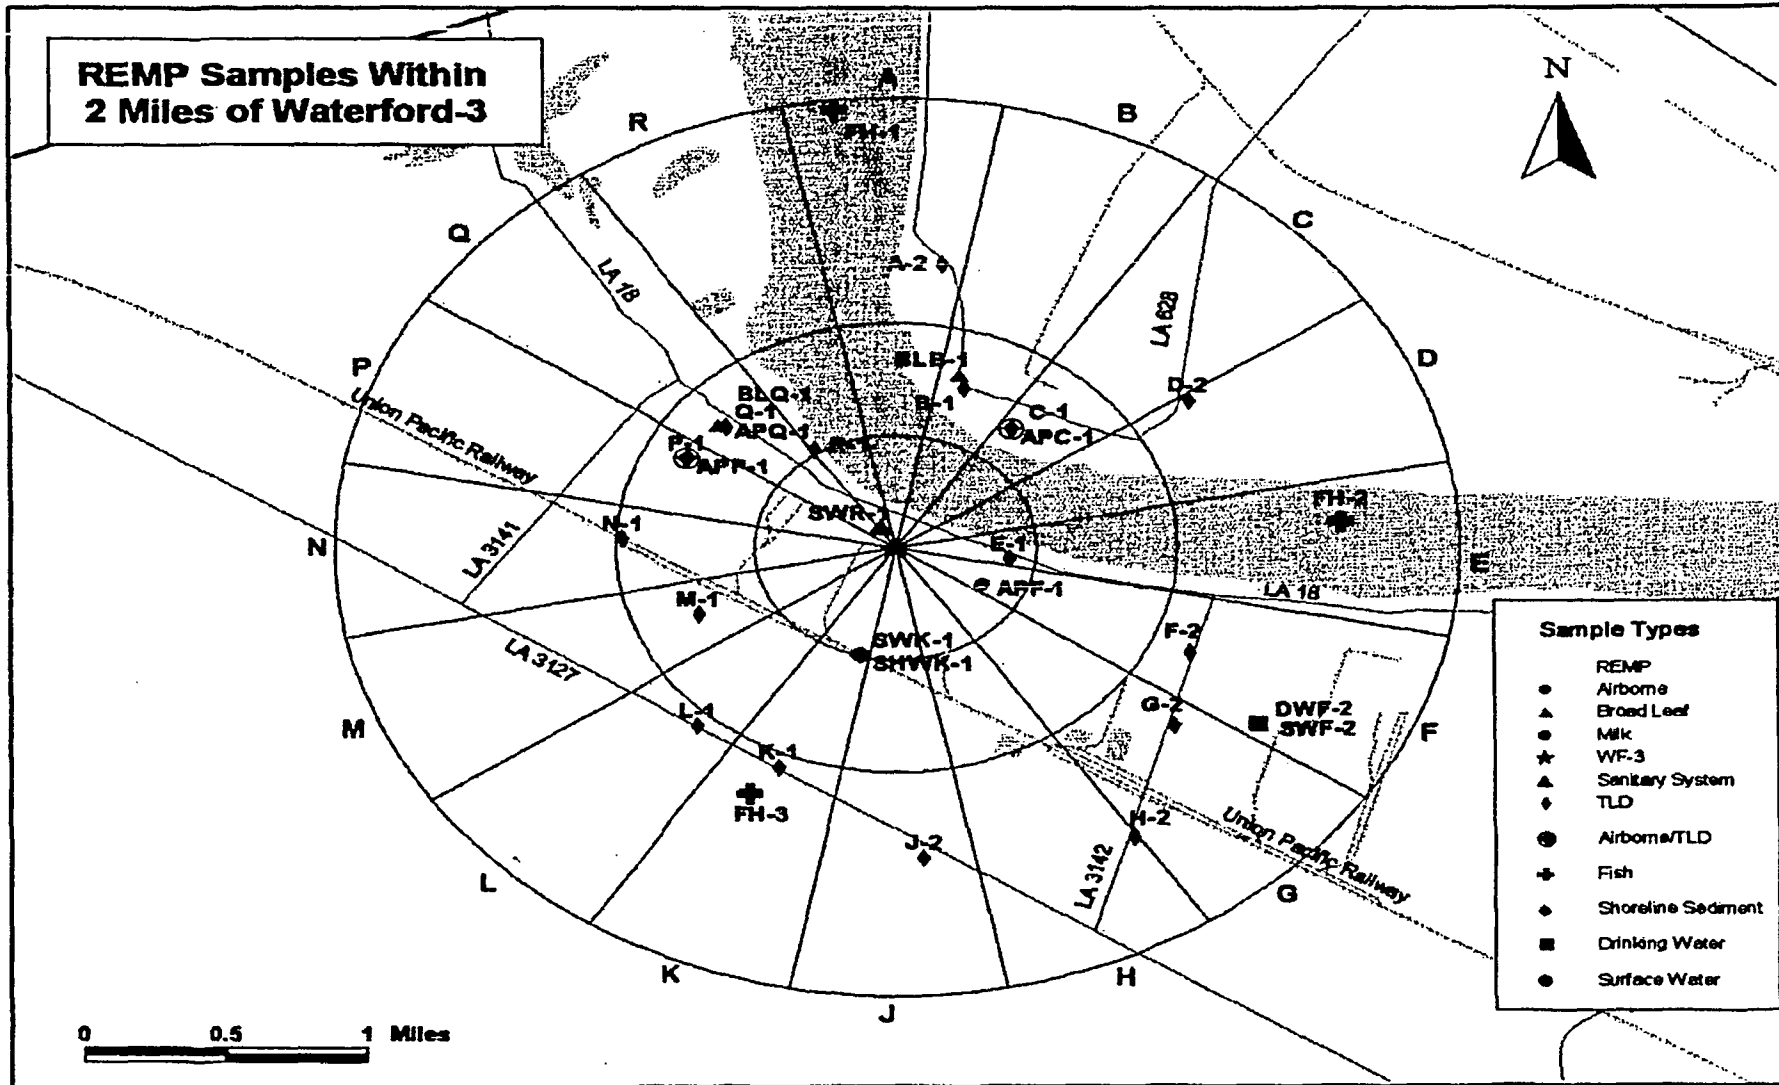


RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

REMP SAMPLES 2 TO 10 MILES
FROM WATERFORD 3

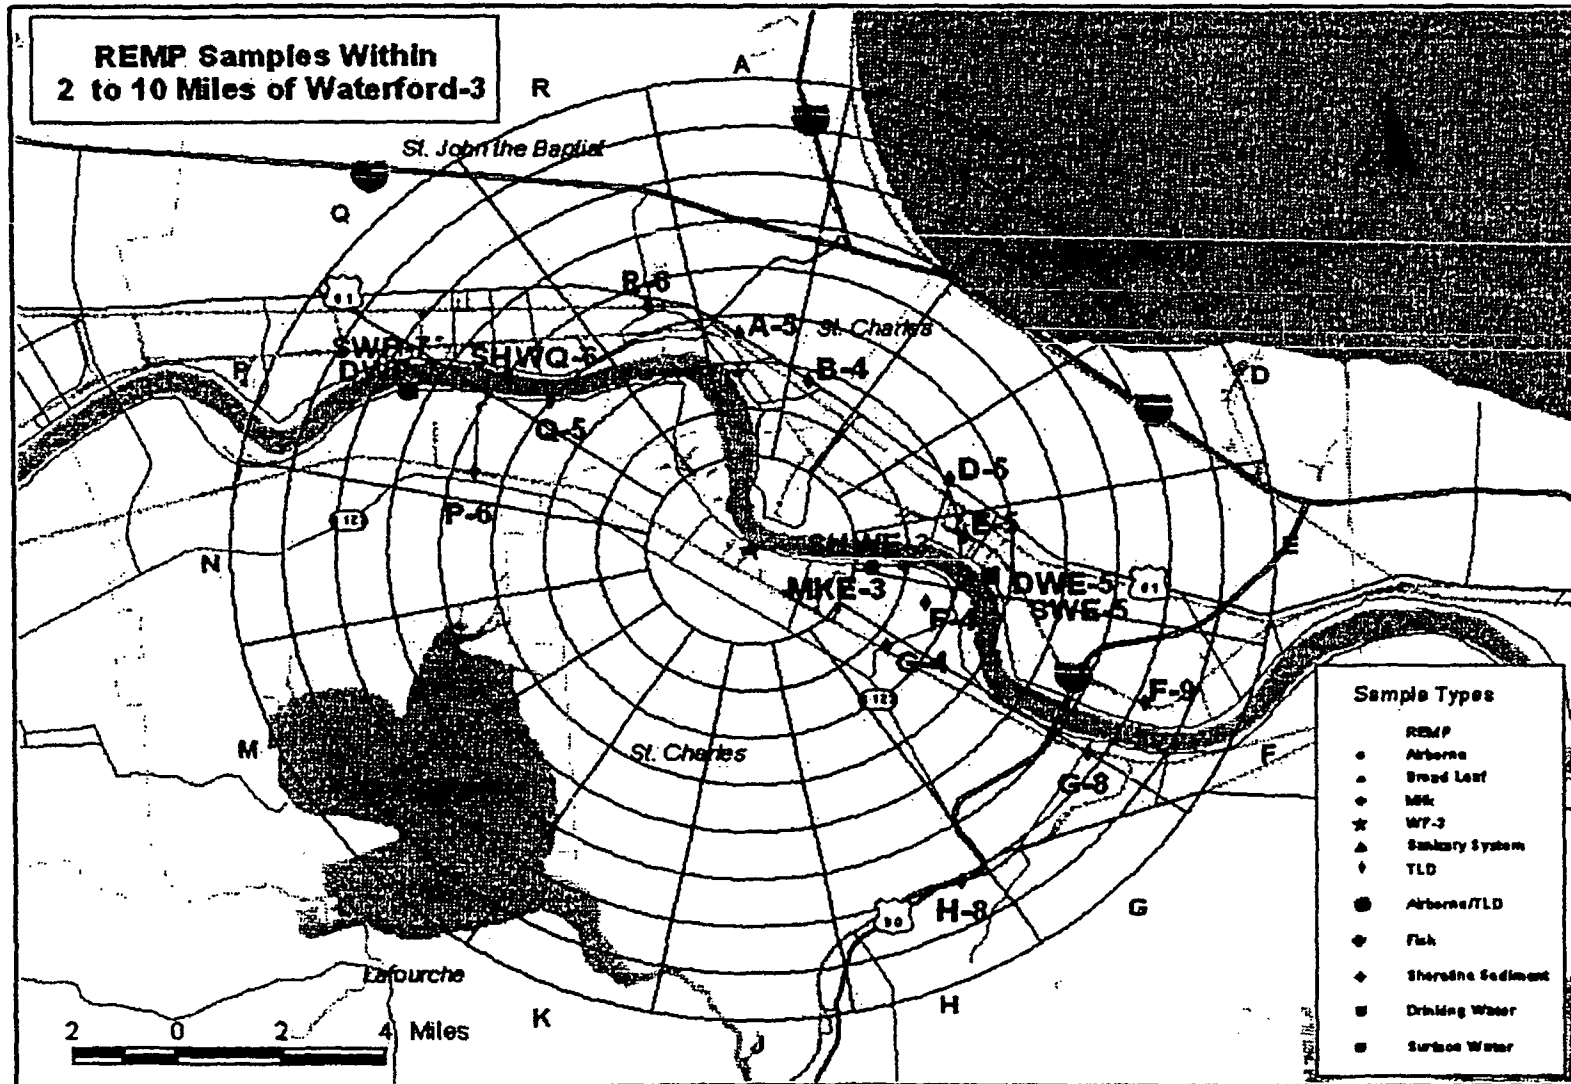

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

REMP SAMPLES 10 TO 50 MILES
FROM WATERFORD 3

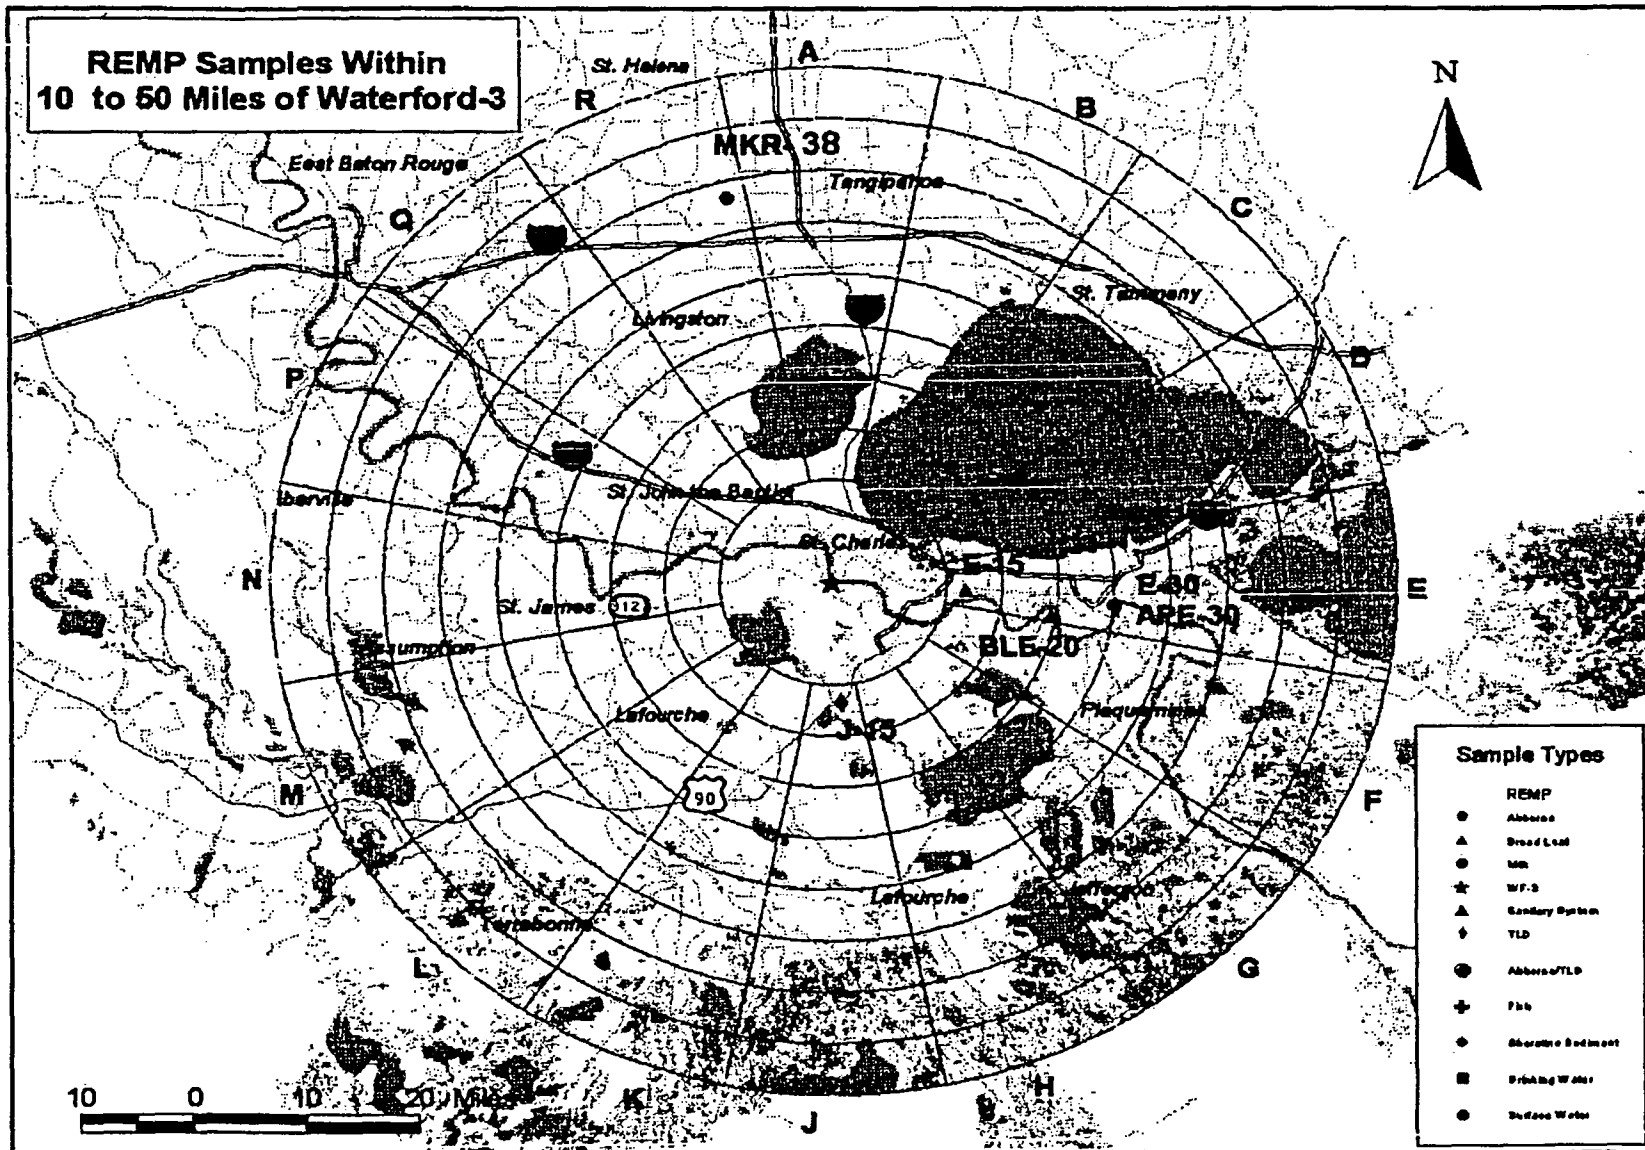

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 7.18e+02 | 7.18e+02 | 7.18e+02 | 7.18e+02 | 7.18e+02 | 7.18e+02 |
| Be-10 | 1.58e+06 | 2.45e+05 | 3.97e+04 | 0.00e+00 | 0.00e+00 | 1.78e+06 | 1.34e+05 |
| C-14 | 1.82e+04 | 3.41e+03 | 3.41e+03 | 3.41e+03 | 3.41e+03 | 3.41e+03 | 3.41e+03 |
| N-13 | 5.02e+01 | 5.02e+01 | 5.02e+01 | 5.02e+01 | 5.02e+01 | 5.02e+01 | 5.02e+01 |
| F-18 | 3.77e+03 | 0.00e+00 | 4.15e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.39e+01 |
| Ne-22 | 1.04e+05 | 1.04e+05 | 1.04e+05 | 1.04e+05 | 1.04e+05 | 1.04e+05 | 1.04e+05 |
| Na-24 | 1.02e+04 | 1.02e+04 | 1.02e+04 | 1.02e+04 | 1.02e+04 | 1.02e+04 | 1.02e+04 |
| P-32 | 1.32e+06 | 7.71e+04 | 5.01e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.64e+04 |
| Ca-41 | 3.06e+05 | 0.00e+00 | 3.30e+04 | 0.00e+00 | 0.00e+00 | 3.06e+04 | 2.29e+03 |
| Sc-46 | 4.41e+05 | 8.56e+05 | 2.49e+05 | 0.00e+00 | 7.99e+05 | 0.00e+00 | 2.58e+05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.00e+02 | 5.95e+01 | 2.28e+01 | 1.44e+04 | 3.32e+03 |
| Mn-54 | 0.00e+00 | 3.96e+04 | 6.30e+03 | 0.00e+00 | 9.84e+03 | 1.40e+06 | 7.74e+04 |
| Mn-56 | 0.00e+00 | 1.24e+00 | 1.83e-01 | 0.00e+00 | 1.30e+00 | 9.44e+03 | 2.02e+04 |
| Fe-55 | 2.46e+04 | 1.70e+04 | 3.94e+03 | 0.00e+00 | 0.00e+00 | 7.21e+04 | 6.03e+03 |
| Fe-59 | 1.18e+04 | 2.78e+04 | 1.06e+04 | 0.00e+00 | 0.00e+00 | 1.02e+06 | 1.88e+05 |
| Co-57 | 0.00e+00 | 6.92e+02 | 6.71e+02 | 0.00e+00 | 0.00e+00 | 3.70e+05 | 3.14e+04 |
| Co-58 | 0.00e+00 | 1.58e+03 | 2.07e+03 | 0.00e+00 | 0.00e+00 | 9.28e+05 | 1.06e+05 |
| Co-60 | 0.00e+00 | 1.15e+04 | 1.48e+04 | 0.00e+00 | 0.00e+00 | 5.97e+06 | 2.85e+05 |
| Ni-59 | 3.25e+04 | 1.17e+04 | 5.42e+03 | 0.00e+00 | 0.00e+00 | 6.56e+04 | 4.89e+03 |
| Ni-63 | 4.32e+05 | 3.14e+04 | 1.45e+04 | 0.00e+00 | 0.00e+00 | 1.78e+05 | 1.34e+04 |
| Ni-65 | 1.54e+00 | 2.10e-01 | 9.12e-02 | 0.00e+00 | 0.00e+00 | 5.60e+03 | 1.23e+04 |
| Cu-64 | 0.00e+00 | 1.46e+00 | 6.15e-01 | 0.00e+00 | 4.62e+00 | 6.78e+03 | 4.90e+04 |
| Zn-65 | 3.24e+04 | 1.03e+05 | 4.66e+04 | 0.00e+00 | 6.90e+04 | 8.64e+05 | 5.34e+04 |
| Zn-69 | 3.38e-02 | 6.51e-02 | 4.52e-03 | 0.00e+00 | 4.22e-02 | 9.20e+02 | 1.63e+01 |
| Zn-69m | 8.16e+00 | 1.96e+01 | 1.79e+00 | 0.00e+00 | 1.18e+01 | 1.90e+04 | 1.37e+05 |
| Se-79 | 0.00e+00 | 3.06e+03 | 4.87e+02 | 0.00e+00 | 4.55e+03 | 3.58e+05 | 2.66e+04 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.35e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.04e+04 |
| Br-83 | 0.00e+00 | 0.00e+00 | 2.41e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.32e+02 |
| Br-84 | 0.00e+00 | 0.00e+00 | 3.13e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.64e-03 |
| Br-85 | 0.00e+00 | 0.00e+00 | 1.28e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for P_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.35e+05 | 5.90e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.66e+04 |
| Rb-87 | 0.00e+00 | 7.89e+04 | 2.57e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.30e+03 |
| Rb-88 | 0.00e+00 | 3.87e+02 | 1.93e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.34e-09 |
| Rb-89 | 0.00e+00 | 2.56e+02 | 1.70e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.28e-12 |
| Sr-89 | 3.04e+05 | 0.00e+00 | 8.72e+03 | 0.00e+00 | 0.00e+00 | 1.40e+06 | 3.50e+05 |
| Sr-90 | 2.87e+07 | 0.00e+00 | 5.77e+05 | 0.00e+00 | 0.00e+00 | 9.60e+06 | 7.22e+05 |
| Sr-91 | 6.19e+01 | 0.00e+00 | 2.50e+00 | 0.00e+00 | 0.00e+00 | 3.65e+04 | 1.91e+05 |
| Sr-92 | 6.74e+00 | 0.00e+00 | 2.91e-01 | 0.00e+00 | 0.00e+00 | 1.65e+04 | 4.30e+04 |
| Y-90 | 2.09e+03 | 0.00e+00 | 5.61e+01 | 0.00e+00 | 0.00e+00 | 1.70e+05 | 5.06e+05 |
| Y-91 | 4.62e+05 | 0.00e+00 | 1.24e+04 | 0.00e+00 | 0.00e+00 | 1.70e+06 | 3.85e+05 |
| Y-91m | 2.61e-01 | 0.00e+00 | 1.02e-02 | 0.00e+00 | 0.00e+00 | 1.92e+03 | 1.33e+00 |
| Y-92 | 1.03e+01 | 0.00e+00 | 3.02e-01 | 0.00e+00 | 0.00e+00 | 1.57e+04 | 7.35e+04 |
| Y-93 | 9.44e+01 | 0.00e+00 | 2.61e+00 | 0.00e+00 | 0.00e+00 | 4.85e+04 | 4.22e+05 |
| Zr-93 | 4.18e+05 | 2.34e+04 | 1.10e+04 | 0.00e+00 | 8.88e+04 | 1.70e+05 | 1.21e+04 |
| Zr-95 | 1.07e+05 | 3.44e+04 | 2.33e+04 | 0.00e+00 | 5.42e+04 | 1.77e+06 | 1.50e+05 |
| Zr-97 | 9.68e+01 | 1.96e+01 | 9.04e+00 | 0.00e+00 | 2.97e+01 | 7.87e+04 | 5.23e+05 |
| Nb-93m | 2.48e+05 | 8.08e+04 | 1.99e+04 | 0.00e+00 | 9.28e+04 | 2.49e+05 | 1.90e+04 |
| Nb-95 | 1.41e+04 | 7.82e+03 | 4.21e+03 | 0.00e+00 | 7.74e+03 | 5.05e+05 | 1.04e+05 |
| Nb-97 | 2.22e-01 | 5.62e-02 | 2.05e-02 | 0.00e+00 | 6.54e-02 | 2.40e+03 | 2.42e+02 |
| Mo-93 | 0.00e+00 | 9.36e+03 | 2.54e+02 | 0.00e+00 | 2.84e+03 | 4.09e+05 | 3.03e+04 |
| Mo-99 | 0.00e+00 | 1.21e+02 | 2.30e+01 | 0.00e+00 | 2.91e+02 | 9.12e+04 | 2.48e+05 |
| Tc-101 | 4.18e-05 | 6.02e-05 | 5.90e-04 | 0.00e+00 | 1.08e-03 | 3.99e+02 | 1.09e-11 |
| Tc-99 | 2.50e+02 | 3.71e+02 | 1.00e+02 | 0.00e+00 | 4.68e+03 | 8.08e+05 | 6.03e+04 |
| Tc-99m | 1.03e-03 | 2.91e-03 | 3.70e-02 | 0.00e+00 | 4.42e-02 | 7.64e+02 | 4.16e+03 |
| Ru-103 | 1.53e+03 | 0.00e+00 | 6.58e+02 | 0.00e+00 | 5.83e+03 | 5.05e+05 | 1.10e+05 |
| Ru-105 | 7.90e-01 | 0.00e+00 | 3.11e-01 | 0.00e+00 | 1.02e+00 | 1.10e+04 | 4.82e+04 |
| Ru-106 | 6.91e+04 | 0.00e+00 | 8.72e+03 | 0.00e+00 | 1.34e+05 | 9.36e+06 | 9.12e+05 |
| Rh-105 | 7.39e+00 | 5.38e+00 | 3.54e+00 | 0.00e+00 | 2.29e+01 | 1.93e+04 | 8.72e+04 |
| Pd-107 | 0.00e+00 | 6.62e+02 | 4.70e+01 | 0.00e+00 | 5.26e+03 | 7.58e+04 | 5.65e+03 |
| Pd-109 | 0.00e+00 | 3.70e+00 | 9.28e-01 | 0.00e+00 | 1.88e+01 | 1.48e+04 | 1.22e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ag-110m | 1.08e+04 | 1.00e+04 | 5.94e+03 | 0.00e+00 | 1.97e+04 | 4.63e+06 | 3.02e+05 |
| Ag-111 | 3.40e+02 | 1.42e+02 | 7.10e+01 | 0.00e+00 | 4.59e+02 | 1.86e+05 | 2.23e+05 |
| Cd-113m | 0.00e+00 | 1.23e+06 | 3.98e+04 | 0.00e+00 | 1.37e+06 | 1.66e+06 | 1.27e+05 |
| Cd-115m | 0.00e+00 | 1.97e+05 | 6.36e+03 | 0.00e+00 | 1.58e+05 | 1.41e+06 | 3.84e+05 |
| Sn-123 | 2.42e+05 | 5.34e+03 | 7.86e+03 | 4.54e+03 | 0.00e+00 | 2.30e+06 | 3.14e+05 |
| Sn-125 | 9.28e+03 | 2.50e+02 | 5.62e+02 | 2.07e+02 | 0.00e+00 | 5.90e+05 | 5.45e+05 |
| Sn-126 | 1.26e+06 | 3.34e+04 | 4.80e+04 | 9.84e+03 | 0.00e+00 | 9.36e+06 | 1.27e+05 |
| Sb-124 | 3.12e+04 | 5.89e+02 | 1.24e+04 | 7.55e+01 | 0.00e+00 | 2.48e+06 | 4.06e+05 |
| Sb-125 | 5.34e+04 | 5.95e+02 | 1.26e+04 | 5.40e+01 | 0.00e+00 | 1.74e+06 | 1.01e+05 |
| Sb-126 | 3.60e+03 | 7.30e+01 | 1.30e+03 | 2.20e+01 | 0.00e+00 | 7.66e+05 | 4.81e+05 |
| Sb-127 | 2.64e+02 | 5.78e+00 | 1.02e+02 | 3.18e+00 | 0.00e+00 | 1.64e+05 | 3.02e+05 |
| Te-125m | 3.42e+03 | 1.58e+03 | 4.67e+02 | 1.05e+03 | 1.24e+04 | 3.14e+05 | 7.06e+04 |
| Te-127 | 1.40e+00 | 6.42e-01 | 3.10e-01 | 1.06e+00 | 5.10e+00 | 6.51e+03 | 5.74e+04 |
| Te-127m | 1.26e+04 | 5.77e+03 | 1.57e+03 | 3.29e+03 | 4.58e+04 | 9.60e+05 | 1.50e+05 |
| Te-129 | 4.98e-02 | 2.39e-02 | 1.24e-02 | 3.90e-02 | 1.87e-01 | 1.94e+03 | 1.57e+02 |
| Te-129m | 9.76e+03 | 4.67e+03 | 1.58e+03 | 3.44e+03 | 3.66e+04 | 1.16e+06 | 3.83e+05 |
| Te-131 | 1.11e-02 | 5.95e-03 | 3.59e-03 | 9.36e-03 | 4.37e-02 | 1.39e+03 | 1.84e+01 |
| Te-131m | 6.99e+01 | 4.36e+01 | 2.90e+01 | 5.50e+01 | 3.09e+02 | 1.46e+05 | 5.56e+05 |
| Te-132 | 2.60e+02 | 2.15e+02 | 1.62e+02 | 1.90e+02 | 1.46e+03 | 2.88e+05 | 5.10e+05 |
| Te-133m | 5.79e-02 | 4.32e-02 | 3.34e-02 | 5.02e-02 | 2.99e-01 | 4.41e+03 | 6.12e+01 |
| Te-134 | 3.07e-02 | 2.58e-02 | 1.26e-02 | 2.75e-02 | 1.74e-01 | 3.47e+03 | 2.38e-01 |
| I-129 | 1.98e+04 | 1.69e+04 | 5.53e+04 | 4.43e+07 | 3.62e+04 | 0.00e+00 | 1.78e+03 |
| I-130 | 4.58e+03 | 1.34e+04 | 5.28e+03 | 1.14e+06 | 2.09e+04 | 0.00e+00 | 7.69e+03 |
| I-131 | 2.52e+04 | 3.58e+04 | 2.05e+04 | 1.19e+07 | 6.13e+04 | 0.00e+00 | 6.28e+03 |
| I-132 | 1.16e+03 | 3.26e+03 | 1.16e+03 | 1.14e+05 | 5.18e+03 | 0.00e+00 | 4.06e+02 |
| I-133 | 8.64e+03 | 1.48e+04 | 4.52e+03 | 2.15e+06 | 2.58e+04 | 0.00e+00 | 8.88e+03 |
| I-134 | 6.44e+02 | 1.73e+03 | 6.15e+02 | 2.98e+04 | 2.75e+03 | 0.00e+00 | 1.01e+00 |
| I-135 | 2.68e+03 | 6.98e+03 | 2.57e+03 | 4.48e+05 | 1.11e+04 | 0.00e+00 | 5.25e+03 |
| Cs-134 | 3.73e+05 | 8.48e+05 | 7.28e+05 | 0.00e+00 | 2.87e+05 | 9.76e+04 | 1.04e+04 |
| Cs-134m | 1.27e+02 | 2.56e+02 | 1.38e+02 | 0.00e+00 | 1.46e+02 | 2.34e+01 | 6.34e+01 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.17e+05 | 1.03e+05 | 4.79e+04 | 0.00e+00 | 4.09e+04 | 1.26e+04 | 1.69e+03 |
| Cs-136 | 3.90e+04 | 1.46e+05 | 1.10e+05 | 0.00e+00 | 8.56e+04 | 1.20e+04 | 1.17e+04 |
| Cs-137 | 4.78e+05 | 6.21e+05 | 4.28e+05 | 0.00e+00 | 2.22e+05 | 7.52e+04 | 8.40e+03 |
| Cs-138 | 3.31e+02 | 6.21e+02 | 3.24e+02 | 0.00e+00 | 4.80e+02 | 4.86e+01 | 1.86e-03 |
| Cs-139 | 2.05e+02 | 2.90e+02 | 1.11e+02 | 0.00e+00 | 2.44e+02 | 2.27e+01 | 4.39e-21 |
| Ba-139 | 9.36e-01 | 6.66e-04 | 2.74e-02 | 0.00e+00 | 6.22e-04 | 3.76e+03 | 8.96e+02 |
| Ba-140 | 3.90e+04 | 4.90e+01 | 2.57e+03 | 0.00e+00 | 1.67e+01 | 1.27e+06 | 2.18e+05 |
| Ba-141 | 1.00e-01 | 7.53e-05 | 3.36e-03 | 0.00e+00 | 7.00e-05 | 1.94e+03 | 1.16e-07 |
| Ba-142 | 2.63e-02 | 2.70e-05 | 1.66e-03 | 0.00e+00 | 2.29e-05 | 1.19e+03 | 1.57e-16 |
| La-140 | 3.44e+02 | 1.74e+02 | 4.58e+01 | 0.00e+00 | 0.00e+00 | 1.36e+05 | 4.58e+05 |
| La-141 | 4.27e+00 | 1.33e+00 | 2.17e-01 | 0.00e+00 | 0.00e+00 | 1.08e+04 | 5.85e+04 |
| La-142 | 6.83e-01 | 3.10e-01 | 7.72e-02 | 0.00e+00 | 0.00e+00 | 6.33e+03 | 2.11e+03 |
| Ce-141 | 1.99e+04 | 1.35e+04 | 1.53e+03 | 0.00e+00 | 6.26e+03 | 3.62e+05 | 1.20e+05 |
| Ce-143 | 1.86e+02 | 1.38e+02 | 1.53e+01 | 0.00e+00 | 6.08e+01 | 7.98e+04 | 2.26e+05 |
| Ce-144 | 3.43e+06 | 1.43e+06 | 1.84e+05 | 0.00e+00 | 8.48e+05 | 7.78e+06 | 8.16e+05 |
| Pr-143 | 9.36e+03 | 3.75e+03 | 4.64e+02 | 0.00e+00 | 2.16e+03 | 2.81e+05 | 2.00e+05 |
| Pr-144 | 3.01e-02 | 1.25e-02 | 1.53e-03 | 0.00e+00 | 7.05e-03 | 1.02e+03 | 2.15e-08 |
| Nd-147 | 5.27e+03 | 6.10e+03 | 3.65e+02 | 0.00e+00 | 3.56e+03 | 2.21e+05 | 1.73e+05 |
| Pm-147 | 6.70e+05 | 6.30e+04 | 2.55e+04 | 0.00e+00 | 1.19e+05 | 5.28e+05 | 4.43e+04 |
| Pm-143 | 3.07e+03 | 5.10e+02 | 2.56e+02 | 0.00e+00 | 9.60e+02 | 3.13e+05 | 4.64e+05 |
| Pm-143m | 7.86e+04 | 2.03e+04 | 1.55e+04 | 0.00e+00 | 3.08e+04 | 1.71e+06 | 3.34e+05 |
| Pm-149 | 2.75e+02 | 3.90e+01 | 1.59e+01 | 0.00e+00 | 7.35e+01 | 5.77e+04 | 2.00e+05 |
| Pm-151 | 6.80e+01 | 1.14e+01 | 5.77e+00 | 0.00e+00 | 2.04e+01 | 3.15e+04 | 1.60e+05 |
| Sm-151 | 6.87e+05 | 1.18e+05 | 2.84e+04 | 0.00e+00 | 1.33e+05 | 3.56e+05 | 2.60e+04 |
| Sm-153 | 1.36e+02 | 1.14e+02 | 8.32e+00 | 0.00e+00 | 3.67e+01 | 3.31e+04 | 1.26e+05 |
| Eu-152 | 1.90e+06 | 4.33e+05 | 3.81e+05 | 0.00e+00 | 2.68e+06 | 2.74e+06 | 1.27e+05 |
| Eu-154 | 5.92e+06 | 7.28e+05 | 5.18e+05 | 0.00e+00 | 3.49e+06 | 4.67e+06 | 2.72e+05 |
| Eu-155 | 8.08e+05 | 1.14e+05 | 7.37e+04 | 0.00e+00 | 5.27e+05 | 7.57e+05 | 4.76e+04 |
| Eu-156 | 1.54e+04 | 1.18e+04 | 1.92e+03 | 0.00e+00 | 7.96e+03 | 6.85e+05 | 3.60e+05 |
| Tb-160 | 1.77e+05 | 0.00e+00 | 2.20e+04 | 0.00e+00 | 7.28e+04 | 1.54e+06 | 2.14e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 2.70e+06 | 8.40e+05 | 6.40e+05 | 0.00e+00 | 1.26e+06 | 3.15e+06 | 1.27e+05 |
| W-181 | 4.98e+01 | 1.62e+01 | 1.74e+00 | 0.00e+00 | 0.00e+00 | 1.37e+04 | 2.02e+03 |
| W-185 | 1.56e+03 | 5.18e+02 | 5.45e+01 | 0.00e+00 | 0.00e+00 | 4.46e+05 | 8.56e+04 |
| W-187 | 8.48e+00 | 7.08e+00 | 2.48e+00 | 0.00e+00 | 0.00e+00 | 2.90e+04 | 1.55e+05 |
| Pb-210 | 2.11e+08 | 5.38e+07 | 6.70e+06 | 0.00e+00 | 1.70e+08 | 2.10e+08 | 1.21e+04 |
| Bi-210 | 1.85e+03 | 1.27e+04 | 1.06e+03 | 0.00e+00 | 1.54e+05 | 8.88e+06 | 2.36e+05 |
| Po-210 | 3.18e+06 | 6.88e+06 | 7.66e+05 | 0.00e+00 | 2.36e+07 | 2.51e+08 | 3.35e+05 |
| Ra-223 | 1.44e+06 | 2.22e+03 | 2.88e+05 | 0.00e+00 | 6.28e+04 | 2.04e+08 | 2.27e+06 |
| Ra-224 | 1.58e+05 | 3.82e+02 | 3.17e+04 | 0.00e+00 | 1.08e+04 | 7.02e+07 | 2.41e+06 |
| Ra-225 | 2.40e+06 | 2.85e+03 | 4.79e+05 | 0.00e+00 | 8.08e+04 | 2.34e+08 | 2.17e+06 |
| Ra-226 | 1.00e+09 | 1.91e+04 | 7.31e+08 | 0.00e+00 | 5.42e+05 | 9.36e+08 | 2.35e+06 |
| Ra-228 | 3.53e+08 | 9.84e+03 | 3.82e+08 | 0.00e+00 | 2.78e+05 | 1.29e+09 | 4.00e+05 |
| Ac-225 | 3.38e+06 | 4.66e+06 | 2.27e+05 | 0.00e+00 | 5.30e+05 | 1.77e+08 | 2.02e+06 |
| Ac-227 | 1.84e+10 | 2.44e+09 | 1.09e+09 | 0.00e+00 | 7.86e+08 | 1.93e+09 | 4.06e+05 |
| Th-227 | 1.74e+06 | 3.14e+04 | 5.00e+04 | 0.00e+00 | 1.78e+05 | 3.02e+08 | 2.67e+06 |
| Th-228 | 1.60e+09 | 2.71e+07 | 5.42e+07 | 0.00e+00 | 1.51e+08 | 8.08e+09 | 2.79e+06 |
| Th-229 | 1.21e+11 | 3.47e+09 | 2.01e+09 | 0.00e+00 | 1.70e+10 | 2.90e+10 | 3.86e+05 |
| Th-230 | 1.83e+10 | 1.05e+09 | 5.09e+08 | 0.00e+00 | 5.12e+09 | 4.97e+09 | 2.98e+05 |
| Th-232 | 2.05e+10 | 8.96e+08 | 7.23e+06 | 0.00e+00 | 4.38e+09 | 4.77e+09 | 2.54e+05 |
| Th-234 | 1.30e+04 | 7.65e+02 | 3.76e+02 | 0.00e+00 | 4.33e+03 | 1.51e+06 | 5.62e+05 |
| Pa-231 | 4.06e+10 | 1.53e+09 | 1.58e+09 | 0.00e+00 | 8.56e+09 | 4.60e+08 | 3.55e+05 |
| Pa-233 | 9.68e+03 | 1.94e+03 | 1.67e+03 | 0.00e+00 | 7.32e+03 | 2.82e+05 | 8.16e+04 |
| U-232 | 4.11e+08 | 0.00e+00 | 2.93e+07 | 0.00e+00 | 4.45e+07 | 1.78e+09 | 3.37e+05 |
| U-233 | 8.72e+07 | 0.00e+00 | 5.28e+06 | 0.00e+00 | 2.03e+07 | 4.26e+08 | 3.11e+05 |
| U-234 | 8.32e+07 | 0.00e+00 | 5.17e+06 | 0.00e+00 | 1.99e+07 | 4.18e+08 | 3.05e+05 |
| U-235 | 8.00e+07 | 0.00e+00 | 4.86e+06 | 0.00e+00 | 1.87e+07 | 3.92e+08 | 3.87e+05 |
| U-236 | 8.00e+07 | 0.00e+00 | 4.96e+06 | 0.00e+00 | 1.91e+07 | 4.00e+08 | 2.86e+05 |
| U-237 | 2.94e+02 | 0.00e+00 | 7.82e+01 | 0.00e+00 | 1.21e+03 | 8.16e+04 | 9.60e+04 |
| U-238 | 7.66e+07 | 0.00e+00 | 4.54e+06 | 0.00e+00 | 1.74e+07 | 3.66e+08 | 2.73e+05 |
| Np-237 | 1.25e+10 | 8.00e+09 | 5.50e+08 | 0.00e+00 | 4.08e+09 | 4.18e+08 | 3.94e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 2.37e+03 | 5.76e+02 | 3.69e+01 | 0.00e+00 | 2.18e+02 | 8.16e+04 | 1.70e+05 |
| Np-239 | 2.30e+02 | 2.03e+02 | 1.24e+01 | 0.00e+00 | 7.00e+01 | 3.76e+04 | 1.19e+05 |
| Pu-238 | 1.14e+10 | 7.77e+09 | 5.52e+08 | 0.00e+00 | 2.37e+09 | 1.46e+09 | 3.62e+05 |
| Pu-239 | 1.33e+10 | 8.56e+09 | 6.20e+08 | 0.00e+00 | 2.64e+09 | 1.38e+09 | 3.30e+05 |
| Pu-240 | 1.32e+10 | 8.56e+09 | 6.18e+08 | 0.00e+00 | 2.63e+09 | 1.38e+09 | 3.37e+05 |
| Pu-241 | 2.74e+08 | 6.95e+07 | 1.03e+07 | 0.00e+00 | 4.74e+07 | 1.22e+06 | 6.92e+03 |
| Pu-242 | 1.22e+10 | 8.24e+09 | 5.97e+08 | 0.00e+00 | 2.54e+09 | 1.32e+09 | 3.24e+05 |
| Pu-244 | 1.43e+10 | 9.44e+09 | 6.83e+08 | 0.00e+00 | 2.91e+09 | 1.51e+09 | 4.82e+05 |
| Am-241 | 1.34e+10 | 9.04e+09 | 5.37e+08 | 0.00e+00 | 4.03e+09 | 4.85e+08 | 3.68e+05 |
| Am-242m | 1.36e+10 | 8.48e+09 | 5.38e+08 | 0.00e+00 | 4.01e+09 | 1.95e+08 | 4.63e+05 |
| Am-243 | 1.34e+10 | 8.80e+09 | 5.26e+08 | 0.00e+00 | 3.96e+09 | 4.60e+08 | 4.32e+05 |
| Cm-242 | 1.78e+08 | 1.42e+08 | 7.87e+06 | 0.00e+00 | 3.58e+07 | 3.14e+08 | 3.93e+05 |
| Cm-243 | 8.80e+09 | 6.09e+09 | 3.69e+08 | 0.00e+00 | 1.72e+09 | 5.05e+08 | 3.87e+05 |
| Cm-244 | 6.70e+09 | 4.70e+09 | 2.81e+08 | 0.00e+00 | 1.31e+09 | 4.85e+08 | 3.74e+05 |
| Cm-245 | 1.39e+10 | 9.12e+09 | 5.71e+08 | 0.00e+00 | 2.66e+09 | 4.68e+08 | 3.49e+05 |
| Cm-246 | 1.38e+10 | 9.12e+09 | 5.70e+08 | 0.00e+00 | 2.66e+09 | 4.77e+08 | 3.43e+05 |
| Cm-247 | 1.34e+10 | 8.96e+09 | 5.62e+08 | 0.00e+00 | 2.62e+09 | 4.68e+08 | 4.50e+05 |
| Cm-248 | 1.12e+11 | 7.41e+10 | 4.63e+09 | 0.00e+00 | 2.16e+10 | 3.86e+09 | 7.27e+06 |
| Cf-252 | 4.34e+09 | 0.00e+00 | 1.86e+08 | 0.00e+00 | 0.00e+00 | 1.59e+09 | 1.42e+06 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 7.25e+02 | 7.25e+02 | 7.25e+02 | 7.25e+02 | 7.25e+02 | 7.25e+02 |
| Be-10 | 2.22e+06 | 3.46e+05 | 5.67e+04 | 0.00e+00 | 0.00e+00 | 3.07e+06 | 1.42e+05 |
| C-14 | 2.60e+04 | 4.87e+03 | 4.87e+03 | 4.87e+03 | 4.87e+03 | 4.87e+03 | 4.87e+03 |
| N-13 | 6.92e+01 | 6.92e+01 | 6.92e+01 | 6.92e+01 | 6.92e+01 | 6.92e+01 | 6.92e+01 |
| F-18 | 5.22e+03 | 0.00e+00 | 5.68e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.11e+02 |
| Na-22 | 1.41e+05 | 1.41e+05 | 1.41e+05 | 1.41e+05 | 1.41e+05 | 1.41e+05 | 1.41e+05 |
| Na-24 | 1.38e+04 | 1.38e+04 | 1.38e+04 | 1.38e+04 | 1.38e+04 | 1.38e+04 | 1.38e+04 |
| P-32 | 1.89e+06 | 1.10e+05 | 7.16e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.28e+04 |
| Ce-41 | 3.24e+05 | 0.00e+00 | 3.50e+04 | 0.00e+00 | 0.00e+00 | 8.08e+08 | 2.42e+03 |
| Sc-46 | 5.79e+05 | 1.13e+06 | 3.34e+05 | 0.00e+00 | 1.08e+06 | 0.00e+00 | 2.38e+05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.35e+02 | 7.50e+01 | 3.07e+01 | 2.10e+04 | 3.00e+03 |
| Mn-54 | 0.00e+00 | 5.11e+04 | 8.40e+03 | 0.00e+00 | 1.27e+04 | 1.98e+06 | 6.68e+04 |
| Mn-56 | 0.00e+00 | 1.70e+00 | 2.52e-01 | 0.00e+00 | 1.79e+00 | 1.52e+04 | 5.74e+04 |
| Fe-55 | 3.34e+04 | 2.38e+04 | 5.54e+03 | 0.00e+00 | 0.00e+00 | 1.24e+05 | 6.39e+03 |
| Fe-59 | 1.59e+04 | 3.70e+04 | 1.43e+04 | 0.00e+00 | 0.00e+00 | 1.53e+06 | 1.78e+05 |
| Co-57 | 0.00e+00 | 9.44e+02 | 9.20e+02 | 0.00e+00 | 0.00e+00 | 5.86e+05 | 3.14e+04 |
| Co-58 | 0.00e+00 | 2.07e+03 | 2.78e+03 | 0.00e+00 | 0.00e+00 | 1.34e+06 | 9.52e+04 |
| Co-60 | 0.00e+00 | 1.51e+04 | 1.98e+04 | 0.00e+00 | 0.00e+00 | 8.72e+06 | 2.59e+05 |
| Ni-59 | 4.35e+04 | 1.62e+04 | 7.39e+03 | 0.00e+00 | 0.00e+00 | 1.13e+05 | 5.18e+03 |
| Ni-63 | 5.80e+05 | 4.34e+04 | 1.98e+04 | 0.00e+00 | 0.00e+00 | 3.07e+05 | 1.42e+04 |
| Ni-65 | 2.18e+00 | 2.93e-01 | 1.27e-01 | 0.00e+00 | 0.00e+00 | 9.36e+03 | 3.67e+04 |
| Cu-64 | 0.00e+00 | 2.03e+00 | 8.48e-01 | 0.00e+00 | 6.41e+00 | 1.11e+04 | 6.14e+04 |
| Zn-65 | 3.86e+04 | 1.34e+05 | 6.24e+04 | 0.00e+00 | 8.64e+04 | 1.24e+06 | 4.66e+04 |
| Zn-69 | 4.83e-02 | 9.20e-02 | 6.46e-03 | 0.00e+00 | 6.02e-02 | 1.58e+03 | 2.85e+02 |
| Zn-69m | 1.15e+01 | 2.71e+01 | 2.49e+00 | 0.00e+00 | 1.65e+01 | 3.14e+04 | 1.71e+05 |
| Se-79 | 0.00e+00 | 4.34e+03 | 6.97e+02 | 0.00e+00 | 6.50e+03 | 6.17e+05 | 2.82e+04 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.82e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 3.44e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 4.33e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 1.83e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LI.I |
| Rb-86 | 0.00e+00 | 1.90e+05 | 8.40e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.77e+04 |
| Rb-87 | 0.00e+00 | 1.12e+05 | 3.66e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.44e+03 |
| Rb-88 | 0.00e+00 | 5.46e+02 | 2.72e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.92e-05 |
| Rb-89 | 0.00e+00 | 3.52e-02 | 2.33e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.38e-07 |
| Sr-89 | 4.34e+05 | 0.00e+00 | 1.25e+04 | 0.00e+00 | 0.00e+00 | 2.42e+06 | 3.71e+05 |
| Sr-90 | 3.31e+07 | 0.00e+00 | 6.66e+05 | 0.00e+00 | 0.00e+00 | 1.65e+07 | 7.65e+05 |
| Sr-91 | 8.80e+01 | 0.00e+00 | 3.51e+00 | 0.00e+00 | 0.00e+00 | 6.07e+04 | 2.59e+05 |
| Sr-92 | 9.52e+00 | 0.00e+00 | 4.06e-01 | 0.00e+00 | 0.00e+00 | 2.74e+04 | 1.19e+05 |
| Y-90 | 2.98e+03 | 0.00e+00 | 8.00e+01 | 0.00e+00 | 0.00e+00 | 2.93e+05 | 5.59e+05 |
| Y-91 | 6.61e+05 | 0.00e+00 | 1.77e+04 | 0.00e+00 | 0.00e+00 | 2.94e+06 | 4.09e+05 |
| Y-91m | 3.70e-01 | 0.00e+00 | 1.42e-02 | 0.00e+00 | 0.00e+00 | 3.20e+03 | 3.02e+01 |
| Y-92 | 1.47e+01 | 0.00e+00 | 4.29e-01 | 0.00e+00 | 0.00e+00 | 2.68e+04 | 1.65e+05 |
| Y-93 | 1.35e+02 | 0.00e+00 | 3.72e+00 | 0.00e+00 | 0.00e+00 | 8.32e+04 | 5.79e+05 |
| Zr-93 | 5.46e+05 | 2.70e+04 | 1.47e+04 | 0.00e+00 | 9.28e+04 | 2.94e+05 | 1.28e+04 |
| Zr-95 | 1.46e+05 | 4.58e+04 | 3.15e+04 | 0.00e+00 | 6.74e+04 | 2.69e+06 | 1.49e+05 |
| Zr-97 | 1.38e+02 | 2.72e+01 | 1.26e+01 | 0.00e+00 | 4.12e+01 | 1.30e+05 | 6.30e+05 |
| Nb-93m | 3.31e+05 | 1.09e+05 | 2.73e+04 | 0.00e+00 | 1.27e+05 | 4.29e+05 | 2.02e+04 |
| Nb-95 | 1.86e+04 | 1.03e+04 | 5.66e+03 | 0.00e+00 | 1.00e+04 | 7.51e+05 | 9.68e+04 |
| Nb-97 | 3.14e-01 | 7.78e-02 | 2.84e-02 | 0.00e+00 | 9.12e-02 | 3.93e+03 | 2.17e+03 |
| Mo-93 | 0.00e+00 | 1.33e+04 | 3.62e+02 | 0.00e+00 | 4.05e+03 | 7.05e+05 | 3.19e+04 |
| Mo-99 | 0.00e+00 | 1.69e+02 | 3.22e+01 | 0.00e+00 | 4.11e+02 | 1.54e+05 | 2.69e+05 |
| Tc-101 | 5.92e-05 | 8.40e-05 | 8.24e-04 | 0.00e+00 | 1.52e-03 | 6.67e+02 | 8.72e-07 |
| Tc-99 | 3.58e+02 | 5.26e+02 | 1.43e+02 | 0.00e+00 | 6.68e+03 | 1.39e+06 | 6.39e+04 |
| Tc-99m | 1.38e-03 | 3.86e-03 | 4.99e-02 | 0.00e+00 | 5.76e-02 | 1.15e+03 | 6.13e+03 |
| Ru-103 | 2.10e+03 | 0.00e+00 | 8.96e+02 | 0.00e+00 | 7.43e+03 | 7.83e+05 | 1.09e+05 |
| Ru-105 | 1.12e+00 | 0.00e+00 | 4.34e-01 | 0.00e+00 | 1.41e+00 | 1.82e+04 | 9.04e+04 |
| Ru-106 | 9.84e+04 | 0.00e+00 | 1.24e+04 | 0.00e+00 | 1.90e+05 | 1.61e+07 | 9.60e+05 |
| Rh-105 | 1.06e+01 | 7.58e+00 | 4.99e+00 | 0.00e+00 | 3.23e+01 | 3.27e+04 | 9.84e+04 |
| Pd-107 | 0.00e+00 | 9.36e+02 | 6.71e+01 | 0.00e+00 | 7.51e+03 | 1.30e+05 | 5.99e+03 |
| Pd-109 | 0.00e+00 | 5.25e+00 | 1.33e+00 | 0.00e+00 | 2.69e+01 | 2.55e+04 | 1.57e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ag-110m | 1.38e+04 | 1.31e+04 | 7.99e+03 | 0.00e+00 | 2.50e+04 | 6.75e+06 | 2.73e+05 |
| Ag-111 | 4.86e+02 | 2.02e+02 | 1.01e+02 | 0.00e+00 | 6.54e+02 | 3.20e+05 | 2.40e+05 |
| Cd-113m | 0.00e+00 | 1.74e+06 | 5.68e+04 | 0.00e+00 | 1.94e+06 | 2.87e+06 | 1.34e+05 |
| Cd-115m | 0.00e+00 | 2.78e+05 | 9.12e+03 | 0.00e+00 | 2.26e+05 | 2.42e+06 | 4.08e+05 |
| Sn-123 | 3.45e+05 | 7.55e+03 | 1.12e+04 | 6.04e+03 | 0.00e+00 | 3.97e+06 | 3.33e+05 |
| Sn-125 | 1.33e+04 | 3.54e+02 | 7.99e+02 | 2.76e+02 | 0.00e+00 | 1.01e+06 | 5.83e+05 |
| Sr-126 | 1.74e+06 | 4.31e+04 | 6.59e+04 | 1.14e+04 | 0.00e+00 | 1.38e+07 | 1.34e+05 |
| Sr-124 | 4.30e+04 | 7.94e+02 | 1.68e+04 | 9.76e+01 | 0.00e+00 | 3.85e+06 | 3.98e+05 |
| Sr-125 | 7.38e+04 | 8.08e+02 | 1.72e+04 | 7.04e+01 | 0.00e+00 | 2.74e+06 | 9.92e+04 |
| Sr-126 | 4.95e+03 | 1.02e+02 | 1.78e+03 | 2.80e+01 | 0.00e+00 | 1.24e+06 | 4.81e+05 |
| Sr-127 | 3.71e+02 | 7.94e+00 | 1.40e+02 | 4.17e+00 | 0.00e+00 | 2.65e+05 | 3.15e+05 |
| Te-125m | 4.88e+03 | 2.24e+03 | 6.67e+02 | 1.40e+03 | 0.00e+00 | 5.36e+05 | 7.50e+04 |
| Te-127 | 2.01e+00 | 9.12e-01 | 4.42e-01 | 1.42e+00 | 7.28e+00 | 1.12e+04 | 8.08e+04 |
| Te-127m | 1.80e+04 | 8.16e+03 | 2.18e+03 | 4.38e+03 | 6.54e+04 | 1.66e+06 | 1.59e+05 |
| Te-129 | 7.10e-02 | 3.38e-02 | 1.76e-02 | 5.18e-02 | 2.66e-01 | 3.30e+03 | 1.62e+03 |
| Te-129m | 1.39e+04 | 6.58e+03 | 2.25e+03 | 4.58e+03 | 5.19e+04 | 1.98e+06 | 4.05e+05 |
| Te-131 | 1.58e-02 | 8.32e-03 | 5.04e-03 | 1.24e-02 | 6.18e-02 | 2.34e+03 | 1.51e+01 |
| Te-131m | 9.84e+01 | 6.01e+01 | 4.02e+01 | 7.25e+01 | 4.39e+02 | 2.38e+05 | 6.21e+05 |
| Te-132 | 3.60e+02 | 2.90e+02 | 2.19e+02 | 2.46e+02 | 1.95e+03 | 4.49e+05 | 4.63e+05 |
| Te-133m | 8.08e-02 | 5.86e-02 | 4.57e-02 | 6.54e-02 | 4.06e-01 | 6.97e+03 | 9.84e+02 |
| Te-134 | 4.25e-02 | 3.48e-02 | 2.91e-02 | 3.57e-02 | 2.33e-01 | 5.40e+03 | 1.10e+01 |
| I-129 | 2.82e+04 | 2.35e+04 | 3.92e+04 | 2.93e+07 | 4.21e+04 | 0.00e+00 | 1.83e+03 |
| I-130 | 6.24e+03 | 1.79e+04 | 7.17e+03 | 1.49e+06 | 2.75e+04 | 0.00e+00 | 9.12e+03 |
| I-131 | 3.54e+04 | 4.91e+04 | 2.64e+04 | 1.46e+07 | 8.40e+04 | 0.00e+00 | 6.49e+03 |
| I-132 | 1.59e+03 | 4.38e+03 | 1.58e+03 | 1.51e+05 | 6.92e+03 | 0.00e+00 | 1.27e+03 |
| I-133 | 1.22e+04 | 2.05e+04 | 6.22e+03 | 2.92e+06 | 3.59e+04 | 0.00e+00 | 1.03e+04 |
| I-134 | 8.88e+02 | 2.32e+03 | 8.40e+02 | 3.95e+04 | 3.66e+03 | 0.00e+00 | 2.04e+01 |
| I-135 | 3.70e+03 | 9.44e+03 | 3.49e+03 | 6.21e+05 | 1.49e+04 | 0.00e+00 | 6.95e+03 |
| Cs-134 | 5.02e+05 | 1.13e+06 | 5.49e+05 | 0.00e+00 | 3.75e+05 | 1.46e+05 | 9.76e+03 |
| Cs-134m | 1.76e+02 | 3.48e+02 | 1.88e+02 | 0.00e+00 | 2.03e+02 | 3.65e+01 | 1.62e+02 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.66e+05 | 1.46e+05 | 3.58e+04 | 0.00e+00 | 5.84e+04 | 2.16e+04 | 1.78e+03 |
| Cs-136 | 5.15e+04 | 1.94e+05 | 1.37e+05 | 0.00e+00 | 1.10e+05 | 1.78e+04 | 1.09e+04 |
| Cs-137 | 6.70e+05 | 8.48e+05 | 3.11e+05 | 0.00e+00 | 3.04e+05 | 1.21e+05 | 8.48e+03 |
| Cs-138 | 4.66e+02 | 8.56e+02 | 4.46e+02 | 0.00e+00 | 6.62e+02 | 7.87e+01 | 2.70e-01 |
| Cs-139 | 2.92e+02 | 4.10e+02 | 1.58e+02 | 0.00e+00 | 3.47e+02 | 3.89e+01 | 1.33e-13 |
| Ba-139 | 1.34e+00 | 9.44e-04 | 3.90e-02 | 0.00e+00 | 8.88e-04 | 6.46e+03 | 6.45e+03 |
| Ba-140 | 5.47e+04 | 6.70e+01 | 3.52e+03 | 0.00e+00 | 2.28e+01 | 2.03e+06 | 2.29e+05 |
| Ba-141 | 1.42e-01 | 1.06e-04 | 4.74e-03 | 0.00e+00 | 9.84e-05 | 3.29e+03 | 7.46e-04 |
| Ba-142 | 3.70e-02 | 3.70e-05 | 2.27e-03 | 0.00e+00 | 3.14e-05 | 1.91e+03 | 4.79e-10 |
| La-140 | 4.79e+02 | 2.36e+02 | 6.26e+01 | 0.00e+00 | 0.00e+00 | 2.14e+05 | 4.87e+05 |
| La-141 | 6.10e+00 | 1.88e+00 | 3.10e-01 | 0.00e+00 | 0.00e+00 | 1.85e+04 | 1.23e+05 |
| La-142 | 9.60e-01 | 4.25e-01 | 1.06e-01 | 0.00e+00 | 0.00e+00 | 1.02e+04 | 1.20e+04 |
| Ce-141 | 2.84e+04 | 1.90e+04 | 2.17e+03 | 0.00e+00 | 8.88e+03 | 6.14e+05 | 1.26e+05 |
| Ce-143 | 2.66e+02 | 1.94e+02 | 2.16e+01 | 0.00e+00 | 8.64e+01 | 1.30e+05 | 2.55e+05 |
| Ce-144 | 4.89e+06 | 2.02e+06 | 2.62e+05 | 0.00e+00 | 1.21e+06 | 1.34e+07 | 8.64e+05 |
| Pr-143 | 1.34e+04 | 5.31e+03 | 6.62e+02 | 0.00e+00 | 3.09e+03 | 4.83e+05 | 2.14e+05 |
| Pr-144 | 4.30e-02 | 1.76e-02 | 2.18e-03 | 0.00e+00 | 1.01e-02 | 1.75e+03 | 2.35e-04 |
| Nd-147 | 7.86e+03 | 8.56e+03 | 5.13e+02 | 0.00e+00 | 5.02e+03 | 3.72e+05 | 1.82e+05 |
| Pm-147 | 9.20e+05 | 8.80e+04 | 3.60e+04 | 0.00e+00 | 1.68e+05 | 9.12e+05 | 4.70e+04 |
| Pm-148 | 4.35e+03 | 7.10e+02 | 3.58e+02 | 0.00e+00 | 1.28e+03 | 5.22e+05 | 4.91e+05 |
| Pm-148m | 1.06e+05 | 2.68e+04 | 2.10e+04 | 0.00e+00 | 4.06e+04 | 2.56e+06 | 3.28e+05 |
| Pm-149 | 3.93e+02 | 5.51e+01 | 2.27e+01 | 0.00e+00 | 1.05e+02 | 9.92e+04 | 2.23e+05 |
| Pm-151 | 9.60e+01 | 1.59e+01 | 8.08e+00 | 0.00e+00 | 2.86e+01 | 5.25e+04 | 1.82e+05 |
| Sm-151 | 8.56e+05 | 1.68e+05 | 3.89e+04 | 0.00e+00 | 1.82e+05 | 6.14e+05 | 2.82e+04 |
| Sm-153 | 1.94e+02 | 1.61e+02 | 1.18e+01 | 0.00e+00 | 5.25e+01 | 5.69e+04 | 1.42e+05 |
| Eu-152 | 2.37e+06 | 5.75e+05 | 5.04e+05 | 0.00e+00 | 2.67e+06 | 4.01e+06 | 1.08e+05 |
| Eu-154 | 7.54e+06 | 9.84e+05 | 6.88e+05 | 0.00e+00 | 4.35e+06 | 7.30e+06 | 2.67e+05 |
| Eu-155 | 1.60e+06 | 1.57e+05 | 9.68e+04 | 0.00e+00 | 6.12e+05 | 1.21e+07 | 4.78e+05 |
| Eu-156 | 2.16e+04 | 1.62e+04 | 2.64e+03 | 0.00e+00 | 1.09e+04 | 1.10e+06 | 3.65e+05 |
| Tb-160 | 2.43e+05 | 0.00e+00 | 3.03e+04 | 0.00e+00 | 9.60e+04 | 2.38e+06 | 2.08e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 3.52e+06 | 1.09e+06 | 7.90e+05 | 0.00e+00 | 1.60e+06 | 4.99e+06 | 1.34e+05 |
| W-181 | 7.12e+01 | 2.30e+01 | 2.41e+00 | 0.00e+00 | 0.00e+00 | 2.36e+04 | 2.15e+03 |
| W-185 | 2.22e+03 | 7.34e+02 | 7.78e+01 | 0.00e+00 | 0.00e+00 | 7.68e+05 | 9.12e+04 |
| W-187 | 1.20e+01 | 9.76e+00 | 3.43e+00 | 0.00e+00 | 0.00e+00 | 4.74e+04 | 1.77e+05 |
| Pb-210 | 2.47e+08 | 6.62e+07 | 8.56e+06 | 0.00e+00 | 2.36e+08 | 3.62e+08 | 1.28e+04 |
| Bi-210 | 2.64e+03 | 1.81e+04 | 1.51e+03 | 0.00e+00 | 2.19e+05 | 1.53e+07 | 2.55e+05 |
| Po-210 | 4.54e+06 | 9.76e+06 | 1.10e+06 | 0.00e+00 | 3.37e+07 | 4.33e+08 | 3.56e+05 |
| Ra-223 | 2.06e+06 | 3.14e+03 | 4.11e+05 | 0.00e+00 | 8.96e+04 | 3.51e+08 | 2.43e+06 |
| Ra-224 | 2.26e+05 | 5.42e+02 | 4.52e+04 | 0.00e+00 | 1.54e+04 | 1.21e+08 | 2.63e+06 |
| Ra-225 | 3.42e+06 | 4.03e+03 | 6.85e+05 | 0.00e+00 | 1.15e+05 | 4.03e+08 | 2.31e+06 |
| Ra-226 | 1.06e+09 | 2.70e+04 | 7.90e+08 | 0.00e+00 | 7.74e+05 | 1.62e+09 | 2.49e+06 |
| Ra-228 | 4.27e+08 | 1.39e+04 | 4.70e+08 | 0.00e+00 | 3.98e+05 | 2.22e+09 | 4.24e+05 |
| Ac-225 | 4.83e+06 | 6.60e+06 | 3.25e+05 | 0.00e+00 | 7.58e+05 | 3.05e+08 | 2.16e+06 |
| Ac-227 | 1.99e+10 | 2.95e+09 | 1.18e+09 | 0.00e+00 | 8.56e+08 | 3.33e+09 | 4.30e+05 |
| Th-227 | 2.47e+06 | 4.45e+04 | 7.14e+04 | 0.00e+00 | 2.54e+05 | 5.20e+08 | 2.86e+06 |
| Th-228 | 2.08e+09 | 3.50e+07 | 7.02e+07 | 0.00e+00 | 1.96e+08 | 1.35e+10 | 2.96e+06 |
| Th-229 | 1.23e+11 | 3.55e+09 | 2.05e+09 | 0.00e+00 | 1.74e+10 | 4.19e+10 | 4.10e+05 |
| Th-230 | 1.87e+10 | 1.07e+09 | 5.19e+08 | 0.00e+00 | 5.24e+09 | 7.18e+09 | 3.16e+05 |
| Th-232 | 2.09e+10 | 9.12e+08 | 7.37e+06 | 0.00e+00 | 4.48e+09 | 6.88e+09 | 2.69e+05 |
| Th-234 | 1.86e+04 | 1.08e+03 | 5.37e+02 | 0.00e+00 | 6.18e+03 | 2.61e+06 | 5.99e+05 |
| Pa-231 | 4.26e+10 | 1.60e+09 | 1.66e+09 | 0.00e+00 | 8.96e+09 | 7.93e+08 | 3.77e+05 |
| Pa-233 | 1.34e+04 | 2.59e+03 | 2.31e+03 | 0.00e+00 | 9.76e+03 | 4.31e+05 | 8.00e+04 |
| U-232 | 5.85e+08 | 0.00e+00 | 4.18e+07 | 0.00e+00 | 6.35e+07 | 3.07e+09 | 3.57e+05 |
| U-233 | 1.24e+08 | 0.00e+00 | 7.54e+06 | 0.00e+00 | 2.90e+07 | 7.34e+08 | 3.30e+05 |
| U-234 | 1.18e+08 | 0.00e+00 | 7.38e+06 | 0.00e+00 | 2.84e+07 | 7.19e+08 | 3.23e+05 |
| U-235 | 1.14e+08 | 0.00e+00 | 6.94e+06 | 0.00e+00 | 2.67e+07 | 6.75e+08 | 4.10e+05 |
| U-236 | 1.14e+09 | 0.00e+00 | 7.09e+06 | 0.00e+00 | 2.73e+07 | 6.90e+08 | 3.03e+05 |
| U-237 | 4.20e+02 | 0.00e+00 | 1.12e+02 | 0.00e+00 | 1.73e+03 | 1.41e+05 | 1.03e+05 |
| U-238 | 1.09e+08 | 0.00e+00 | 6.48e+06 | 0.00e+00 | 2.50e+07 | 6.31e+08 | 2.90e+05 |
| Np-237 | 1.31e+10 | 8.48e+09 | 5.77e+08 | 0.00e+00 | 4.28e+09 | 7.19e+08 | 4.18e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|----------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LI.I |
| Np--238 | 3.38e+03 | 8.16e+02 | 5.27e+01 | 0.00e+00 | 3.10e+02 | 1.40e+05 | 1.90e+05 |
| Np--239 | 3.38e+02 | 2.88e+02 | 1.77e+01 | 0.00e+00 | 1.00e+02 | 6.49e+04 | 1.32e+05 |
| Pu--238 | 1.20e+10 | 8.24e+09 | 5.78e+08 | 0.00e+00 | 2.48e+09 | 2.50e+09 | 3.83e+05 |
| Pu--239 | 1.38e+10 | 8.96e+09 | 6.44e+08 | 0.00e+00 | 2.75e+09 | 2.34e+09 | 3.50e+05 |
| Pu--240 | 1.38e+10 | 8.96e+09 | 6.43e+08 | 0.00e+00 | 2.74e+09 | 2.34e+09 | 3.57e+05 |
| Pu--241 | 2.99e+08 | 7.65e+07 | 1.12e+07 | 0.00e+00 | 5.18e+07 | 2.08e+06 | 7.34e+03 |
| Pu--242 | 1.28e+10 | 8.64e+09 | 6.20e+08 | 0.00e+00 | 2.65e+09 | 2.26e+09 | 3.43e+05 |
| Pu--244 | 1.50e+10 | 9.92e+09 | 7.10e+08 | 0.00e+00 | 3.03e+09 | 2.58e+09 | 5.11e+05 |
| Am--241 | 1.42e+10 | 9.60e+09 | 5.68e+08 | 0.00e+00 | 4.26e+09 | 8.40e+08 | 3.90e+05 |
| Am--242m | 1.43e+10 | 9.04e+09 | 5.72e+08 | 0.00e+00 | 4.24e+09 | 3.37e+08 | 4.91e+05 |
| Am--243 | 1.42e+10 | 9.36e+09 | 5.56e+08 | 0.00e+00 | 4.17e+09 | 7.93e+08 | 4.58e+05 |
| Cm--242 | 2.54e+08 | 2.01e+08 | 1.13e+07 | 0.00e+00 | 5.12e+07 | 5.41e+08 | 4.17e+05 |
| Cm--243 | 9.52e+09 | 6.64e+09 | 4.00e+08 | 0.00e+00 | 1.87e+09 | 8.72e+08 | 4.10e+05 |
| Cm--244 | 7.35e+09 | 5.22e+09 | 3.10e+08 | 0.00e+00 | 1.45e+09 | 8.40e+08 | 3.97e+05 |
| Cm--245 | 1.46e+10 | 9.76e+09 | 6.02e+08 | 0.00e+00 | 2.82e+09 | 8.08e+08 | 3.70e+05 |
| Cm--246 | 1.45e+10 | 9.76e+09 | 6.02e+08 | 0.00e+00 | 2.81e+09 | 8.24e+08 | 3.63e+05 |
| Cm--247 | 1.42e+10 | 9.52e+09 | 5.93e+08 | 0.00e+00 | 2.77e+09 | 8.08e+08 | 4.78e+05 |
| Cm--248 | 1.18e+11 | 7.86e+10 | 4.89e+09 | 0.00e+00 | 2.28e+10 | 6.66e+09 | 7.70e+06 |
| Cf--252 | 5.73e+09 | 0.00e+00 | 2.46e+08 | 0.00e+00 | 0.00e+00 | 2.74e+09 | 1.51e+06 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 6.40e+02 | 6.40e+02 | 6.40e+02 | 6.40e+02 | 6.40e+02 | 6.40e+02 |
| Be-10 | 3.12e+06 | 3.64e+05 | 7.84e+04 | 0.00e+00 | 0.00e+00 | 2.74e+06 | 6.36e+04 |
| C-14 | 3.59e+04 | 6.73e+03 | 6.73e+03 | 6.73e+03 | 6.73e+03 | 6.73e+03 | 6.73e+03 |
| N-13 | 8.62e+01 | 8.62e+01 | 8.62e+01 | 8.62e+01 | 8.62e+01 | 8.62e+01 | 8.62e+01 |
| F-18 | 6.96e+03 | 0.00e+00 | 6.84e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.25e+03 |
| Na-22 | 1.63e+05 | 1.63e+05 | 1.63e+05 | 1.63e+05 | 1.63e+05 | 1.63e+05 | 1.63e+05 |
| Na-24 | 1.61e+04 | 1.61e+04 | 1.61e+04 | 1.61e+04 | 1.61e+04 | 1.61e+04 | 1.61e+04 |
| P-32 | 2.60e+06 | 1.14e+05 | 9.88e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.22e+04 |
| Ca-41 | 2.61e+05 | 0.00e+00 | 2.85e+04 | 0.00e+00 | 0.00e+00 | 2.67e+08 | 1.09e+03 |
| Sc-46 | 7.29e+05 | 9.99e+05 | 3.85e+05 | 0.00e+00 | 8.84e+05 | 0.00e+00 | 9.06e+04 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.54e+02 | 8.55e+01 | 2.43e+01 | 1.70e+04 | 1.08e+03 |
| Mn-54 | 0.00e+00 | 4.29e+04 | 9.51e+03 | 0.00e+00 | 1.00e+04 | 1.58e+06 | 2.29e+04 |
| Mn-56 | 0.00e+00 | 1.66e+00 | 3.12e-01 | 0.00e+00 | 1.67e+00 | 1.31e+04 | 1.23e+05 |
| Fe-55 | 4.74e+04 | 2.52e+04 | 7.77e+03 | 0.00e+00 | 0.00e+00 | 1.11e+05 | 2.87e+03 |
| Fe-59 | 2.07e+04 | 3.34e+04 | 1.67e+04 | 0.00e+00 | 0.00e+00 | 1.27e+06 | 7.07e+04 |
| Co-57 | 0.00e+00 | 9.03e+02 | 1.07e+03 | 0.00e+00 | 0.00e+00 | 5.07e+05 | 1.32e+04 |
| Co-58 | 0.00e+00 | 1.77e+03 | 3.16e+03 | 0.00e+00 | 0.00e+00 | 1.11e+06 | 3.44e+04 |
| Co-60 | 0.00e+00 | 1.31e+04 | 2.26e+04 | 0.00e+00 | 0.00e+00 | 7.07e+06 | 9.62e+04 |
| Ni-59 | 6.14e+04 | 1.73e+04 | 1.05e+04 | 0.00e+00 | 0.00e+00 | 1.01e+05 | 2.33e+03 |
| Ni-63 | 8.21e+05 | 4.62e+04 | 2.80e+04 | 0.00e+00 | 0.00e+00 | 2.75e+05 | 6.33e+03 |
| Ni-65 | 2.99e+00 | 2.96e-01 | 1.64e-01 | 0.00e+00 | 0.00e+00 | 8.18e+03 | 8.40e+04 |
| Cu-64 | 0.00e+00 | 1.99e+00 | 1.07e+00 | 0.00e+00 | 6.03e+00 | 9.58e+03 | 3.67e+04 |
| Zn-65 | 4.26e+04 | 1.13e+05 | 7.03e+04 | 0.00e+00 | 7.14e+04 | 9.95e+05 | 1.63e+04 |
| Zn-69 | 6.70e-02 | 9.66e-02 | 8.92e-03 | 0.00e+00 | 5.85e-02 | 1.42e+03 | 1.02e+04 |
| Zn-69m | 1.58e+01 | 2.69e+01 | 3.18e+00 | 0.00e+00 | 1.56e+01 | 2.72e+04 | 1.00e+05 |
| Se-79 | 0.00e+00 | 4.55e+03 | 9.62e+02 | 0.00e+00 | 6.33e+03 | 5.51e+05 | 1.27e+04 |
| Br-82 | 0.00e+00 | 0.00e+00 | 2.09e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 4.74e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 5.48e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 2.53e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb--86 | 0.00e+00 | 1.98e+05 | 1.14e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.99e+03 |
| Rb--87 | 0.00e+00 | 1.17e+05 | 5.07e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.10e+03 |
| Rb--88 | 0.00e+00 | 5.62e+02 | 3.66e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.72e+01 |
| Rb--89 | 0.00e+00 | 3.45e+02 | 2.90e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.89e+00 |
| Sr--89 | 5.99e+05 | 0.00e+00 | 1.72e+04 | 0.00e+00 | 0.00e+00 | 2.16e+06 | 1.67e+05 |
| Sr--90 | 3.85e+07 | 0.00e+00 | 7.66e+05 | 0.00e+00 | 0.00e+00 | 1.48e+07 | 3.43e+05 |
| Sr--91 | 1.21e+02 | 0.00e+00 | 4.59e+00 | 0.00e+00 | 0.00e+00 | 5.33e+04 | 1.74e+05 |
| Sr--92 | 1.31e+01 | 0.00e+00 | 5.25e-01 | 0.00e+00 | 0.00e+00 | 2.40e+04 | 2.42e+05 |
| Y-90 | 4.11e+03 | 0.00e+00 | 1.11e+02 | 0.00e+00 | 0.00e+00 | 2.62e+05 | 2.68e+05 |
| Y-91 | 9.14e+05 | 0.00e+00 | 2.44e+04 | 0.00e+00 | 0.00e+00 | 2.63e+06 | 1.84e+05 |
| Y-91m | 5.07e-01 | 0.00e+00 | 1.84e-02 | 0.00e+00 | 0.00e+00 | 2.81e+03 | 1.72e+03 |
| Y-92 | 2.03e+01 | 0.00e+00 | 5.81e-01 | 0.00e+00 | 0.00e+00 | 2.39e+04 | 2.39e+05 |
| Y-93 | 1.86e+02 | 0.00e+00 | 5.11e+00 | 0.00e+00 | 0.00e+00 | 7.44e+04 | 3.88e+05 |
| Zr--93 | 7.66e+05 | 2.89e+04 | 2.05e+04 | 0.00e+00 | 1.11e+05 | 2.63e+05 | 5.44e+03 |
| Zr--95 | 1.90e+05 | 4.18e+04 | 3.70e+04 | 0.00e+00 | 5.96e+04 | 2.23e+06 | 6.11e+04 |
| Zr--97 | 1.88e+02 | 2.72e+01 | 1.60e+01 | 0.00e+00 | 3.88e+01 | 1.13e+05 | 3.51e+05 |
| Nb-93m | 4.70e+05 | 1.17e+05 | 3.85e+04 | 0.00e+00 | 1.27e+05 | 3.85e+05 | 9.06e+03 |
| Nb-95 | 2.35e+04 | 9.18e+03 | 6.55e+03 | 0.00e+00 | 8.62e+03 | 6.14e+05 | 3.70e+04 |
| Nb-97 | 4.29e-01 | 7.70e-02 | 3.60e-02 | 0.00e+00 | 8.55e-02 | 3.42e+03 | 2.78e+04 |
| Mo-93 | 0.00e+00 | 1.39e+04 | 5.00e+02 | 0.00e+00 | 3.92e+03 | 6.29e+05 | 1.40e+04 |
| Mo-99 | 0.00e+00 | 1.72e+02 | 4.26e+01 | 0.00e+00 | 3.92e+02 | 1.35e+05 | 1.27e+05 |
| Tc-101 | 8.10e-05 | 8.51e-05 | 1.08e-03 | 0.00e+00 | 1.45e-03 | 5.85e+02 | 1.63e+01 |
| Tc-99 | 4.96e+02 | 5.51e+02 | 1.98e+02 | 0.00e+00 | 6.48e+03 | 1.25e+06 | 2.87e+04 |
| Tc-99m | 1.78e-03 | 3.48e-03 | 5.77e-02 | 0.00e+00 | 5.07e-02 | 9.51e+02 | 4.81e+03 |
| Ru-103 | 2.79e+03 | 0.00e+00 | 1.07e+03 | 0.00e+00 | 7.03e+03 | 6.62e+05 | 4.48e+04 |
| Ru-105 | 1.53e+00 | 0.00e+00 | 5.55e-01 | 0.00e+00 | 1.34e+00 | 1.59e+04 | 9.95e+04 |
| Ru-106 | 1.36e+05 | 0.00e+00 | 1.69e+04 | 0.00e+00 | 1.84e+05 | 1.43e+07 | 4.29e+05 |
| Rh-105 | 1.45e+01 | 7.77e+00 | 6.62e+00 | 0.00e+00 | 3.10e+01 | 2.89e+04 | 4.92e+04 |
| Pd-107 | 0.00e+00 | 9.80e+02 | 9.29e+01 | 0.00e+00 | 7.29e+03 | 1.17e+05 | 2.69e+03 |
| Pd-109 | 0.00e+00 | 5.48e+00 | 1.83e+00 | 0.00e+00 | 2.61e+01 | 2.28e+04 | 9.58e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ag-110m | 1.69e+04 | 1.14e+04 | 9.14e+03 | 0.00e+00 | 2.12e+04 | 5.48e+06 | 1.00e+05 |
| Ag-111 | 6.70e+02 | 2.10e+02 | 1.39e+02 | 0.00e+00 | 6.33e+02 | 2.86e+05 | 1.10e+05 |
| Cd-113m | 0.00e+00 | 1.82e+06 | 7.84e+04 | 0.00e+00 | 1.90e+06 | 2.57e+06 | 6.03e+04 |
| Cd-115m | 0.00e+00 | 2.92e+05 | 1.25e+04 | 0.00e+00 | 2.19e+05 | 2.17e+06 | 1.84e+05 |
| Sn-123 | 4.77e+05 | 7.92e+03 | 1.55e+04 | 8.40e+03 | 0.00e+00 | 3.55e+06 | 1.50e+05 |
| Sn-125 | 1.83e+04 | 3.68e+02 | 1.09e+03 | 3.81e+02 | 0.00e+00 | 8.99e+05 | 2.65e+05 |
| Sn-126 | 2.31e+06 | 3.85e+04 | 8.73e+04 | 1.05e+04 | 0.00e+00 | 1.12e+07 | 6.03e+04 |
| Sr-124 | 5.74e+04 | 7.40e+02 | 2.00e+04 | 1.26e+02 | 0.00e+00 | 3.24e+06 | 1.64e+05 |
| Sr-125 | 9.84e+04 | 7.58e+02 | 2.07e+04 | 9.10e+01 | 0.00e+00 | 2.32e+06 | 4.03e+04 |
| Sr-126 | 6.36e+03 | 9.69e+01 | 2.28e+03 | 3.70e+01 | 0.00e+00 | 1.06e+06 | 2.10e+05 |
| Sr-127 | 5.03e+02 | 7.73e+00 | 1.74e+02 | 5.59e+00 | 0.00e+00 | 2.28e+05 | 1.41e+05 |
| Te-125m | 6.73e+03 | 2.33e+03 | 9.14e+02 | 1.92e+03 | 0.00e+00 | 4.77e+05 | 3.38e+04 |
| Te-127 | 2.77e+00 | 9.51e-01 | 6.10e-01 | 1.96e+00 | 7.07e+00 | 1.00e+04 | 5.62e+04 |
| Te-127m | 2.49e+04 | 8.55e+03 | 3.02e+03 | 6.07e+03 | 6.36e+04 | 1.48e+06 | 7.14e+04 |
| Te-129 | 9.77e-02 | 3.50e-02 | 2.38e-02 | 7.14e-02 | 2.57e-01 | 2.93e+03 | 2.55e+04 |
| Te-129m | 1.92e+04 | 6.84e+03 | 3.04e+03 | 6.33e+03 | 5.03e+04 | 1.76e+06 | 1.82e+05 |
| Te-131 | 2.17e-02 | 8.44e-03 | 6.59e-03 | 1.70e-02 | 5.88e-02 | 2.05e+03 | 1.33e+03 |
| Te-131m | 1.34e+02 | 5.92e+01 | 5.07e+01 | 9.77e+01 | 4.00e+02 | 2.06e+05 | 3.08e+05 |
| Te-132 | 4.81e+02 | 2.72e+02 | 2.63e+02 | 3.17e+02 | 1.77e+03 | 3.77e+05 | 1.38e+05 |
| Te-133m | 1.08e-01 | 5.59e-02 | 5.55e-02 | 8.58e-02 | 3.74e-01 | 5.92e+03 | 1.76e+04 |
| Te-134 | 5.66e-02 | 3.26e-02 | 3.48e-02 | 4.59e-02 | 2.11e-01 | 4.55e+03 | 1.80e+03 |
| I-129 | 3.88e+04 | 2.37e+04 | 2.11e+04 | 1.58e+07 | 4.00e+04 | 0.00e+00 | 7.96e+02 |
| I-130 | 8.18e+03 | 1.64e+04 | 8.44e+03 | 1.85e+06 | 2.45e+04 | 0.00e+00 | 5.11e+03 |
| I-131 | 4.81e+04 | 4.81e+04 | 2.73e+04 | 1.62e+07 | 7.88e+04 | 0.00e+00 | 2.84e+03 |
| I-132 | 2.12e+03 | 4.07e+03 | 1.88e+03 | 1.94e+05 | 6.25e+03 | 0.00e+00 | 3.20e+03 |
| I-133 | 1.66e+04 | 2.03e+04 | 7.70e+03 | 3.85e+06 | 3.38e+04 | 0.00e+00 | 5.48e+03 |
| I-134 | 1.17e+03 | 2.16e+03 | 9.95e+02 | 5.07e+04 | 3.30e+03 | 0.00e+00 | 9.55e+02 |
| I-135 | 4.92e+03 | 8.73e+03 | 4.14e+03 | 7.92e+05 | 1.34e+04 | 0.00e+00 | 4.44e+03 |
| Cs-134 | 6.51e+05 | 1.01e+06 | 2.25e+05 | 0.00e+00 | 3.30e+05 | 1.21e+05 | 3.85e+03 |
| Cs-134m | 2.34e+02 | 3.30e+02 | 2.26e+02 | 0.00e+00 | 1.83e+02 | 3.09e+01 | 2.93e+02 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 2.31e+05 | 1.53e+05 | 1.65e+04 | 0.00e+00 | 5.66e+04 | 1.93e+04 | 8.03e+02 |
| Cs-136 | 6.51e+04 | 1.71e+05 | 1.16e+05 | 0.00e+00 | 9.55e+04 | 1.45e+04 | 4.18e+03 |
| Cs-137 | 9.06e+05 | 8.25e+05 | 1.28e+05 | 0.00e+00 | 2.82e+05 | 1.04e+05 | 3.62e+03 |
| Cs-138 | 6.33e+02 | 8.40e+02 | 5.55e+02 | 0.00e+00 | 6.22e+02 | 6.81e+01 | 2.70e+02 |
| Cs-139 | 4.03e+02 | 4.26e+02 | 2.15e+02 | 0.00e+00 | 3.36e+02 | 3.46e+01 | 2.68e-02 |
| Ba-139 | 1.84e+00 | 9.84e-04 | 5.36e-02 | 0.00e+00 | 8.62e-04 | 5.77e+03 | 5.77e+04 |
| Ba-140 | 7.40e+04 | 6.48e+01 | 4.33e+03 | 0.00e+00 | 2.11e+01 | 1.74e+06 | 1.02e+05 |
| Ba-141 | 1.96e-01 | 1.09e-04 | 6.36e-03 | 0.00e+00 | 9.47e-05 | 2.92e+03 | 2.75e+02 |
| Ba-142 | 5.00e-02 | 3.60e-05 | 2.79e-03 | 0.00e+00 | 2.91e-05 | 1.64e+03 | 2.74e+00 |
| La-140 | 6.44e+02 | 2.25e+02 | 7.55e+01 | 0.00e+00 | 0.00e+00 | 1.83e+05 | 2.26e+05 |
| La-141 | 8.44e+00 | 1.96e+00 | 4.26e-01 | 0.00e+00 | 0.00e+00 | 1.66e+04 | 1.62e+05 |
| La-142 | 1.30e+00 | 4.11e-01 | 1.29e-01 | 0.00e+00 | 0.00e+00 | 8.70e+03 | 7.58e+04 |
| Ce-141 | 3.92e+04 | 1.95e+04 | 2.90e+03 | 0.00e+00 | 8.55e+03 | 5.44e+05 | 5.66e+04 |
| Ce-143 | 3.66e+02 | 1.99e+02 | 2.87e+01 | 0.00e+00 | 8.36e+01 | 1.15e+05 | 1.27e+05 |
| Ce-144 | 6.77e+06 | 2.12e+06 | 3.61e+05 | 0.00e+00 | 1.17e+06 | 1.20e+07 | 3.88e+05 |
| Pr-143 | 1.85e+04 | 5.55e+03 | 9.14e+02 | 0.00e+00 | 3.00e+03 | 4.33e+05 | 9.73e+04 |
| Pr-144 | 5.96e-02 | 1.85e-02 | 3.00e-03 | 0.00e+00 | 9.77e-03 | 1.57e+03 | 1.97e+02 |
| Nd-147 | 1.08e+04 | 8.73e+03 | 6.81e+02 | 0.00e+00 | 4.81e+03 | 3.28e+05 | 8.21e+04 |
| Pm-147 | 1.30e+06 | 9.32e+04 | 5.03e+04 | 0.00e+00 | 1.65e+05 | 8.14e+05 | 2.11e+04 |
| Pm-148 | 5.96e+03 | 7.18e+02 | 4.62e+02 | 0.00e+00 | 1.22e+03 | 4.59e+05 | 2.22e+05 |
| Pm-148m | 1.22e+05 | 2.42e+04 | 2.42e+04 | 0.00e+00 | 3.60e+04 | 2.12e+06 | 1.32e+05 |
| Pm-149 | 5.44e+02 | 5.77e+01 | 3.13e+01 | 0.00e+00 | 1.02e+02 | 8.88e+04 | 1.08e+05 |
| Pm-151 | 1.32e+02 | 1.60e+01 | 1.04e+01 | 0.00e+00 | 2.72e+01 | 4.59e+04 | 9.25e+04 |
| Sm-151 | 1.16e+06 | 1.76e+05 | 5.51e+04 | 0.00e+00 | 1.81e+05 | 5.48e+05 | 1.27e+04 |
| Sm-153 | 2.68e+02 | 1.67e+02 | 1.61e+01 | 0.00e+00 | 5.07e+01 | 5.07e+04 | 6.92e+04 |
| Eu-152 | 2.75e+06 | 5.07e+05 | 5.96e+05 | 0.00e+00 | 2.12e+06 | 3.33e+06 | 4.22e+04 |
| Eu-154 | 1.01e+07 | 9.21e+05 | 8.40e+05 | 0.00e+00 | 4.03e+06 | 6.14e+06 | 1.10e+05 |
| Eu-155 | 2.07e+06 | 1.50e+05 | 1.18e+05 | 0.00e+00 | 5.59e+05 | 1.03e+06 | 1.99e+05 |
| Eu-156 | 2.92e+04 | 1.57e+04 | 3.24e+03 | 0.00e+00 | 1.01e+04 | 9.40e+05 | 1.57e+05 |
| Tb-160 | 2.88e+05 | 0.00e+00 | 3.58e+04 | 0.00e+00 | 8.58e+04 | 1.98e+06 | 8.44e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Hc-166m | 4.96e+06 | 1.04e+06 | 8.77e+05 | 0.00e+00 | 1.48e+06 | 4.18e+06 | 6.03e+04 |
| W-181 | 9.84e+01 | 2.41e+01 | 3.33e+00 | 0.00e+00 | 0.00e+00 | 2.11e+04 | 9.66e+02 |
| W-185 | 3.07e+03 | 7.70e+02 | 1.08e+02 | 0.00e+00 | 0.00e+00 | 6.88e+05 | 4.11e+04 |
| W-187 | 1.63e+01 | 9.66e+00 | 4.33e+00 | 0.00e+00 | 0.00e+00 | 4.11e+04 | 9.10e+04 |
| Pb-210 | 2.97e+08 | 6.84e+07 | 1.18e+07 | 0.00e+00 | 2.33e+08 | 3.23e+08 | 5.74e+03 |
| Bi-210 | 3.64e+03 | 1.89e+04 | 2.09e+03 | 0.00e+00 | 2.13e+05 | 1.37e+07 | 1.19e+05 |
| Pc-210 | 6.29e+06 | 1.02e+07 | 1.51e+06 | 0.00e+00 | 3.27e+07 | 3.88e+08 | 1.60e+05 |
| Ra-223 | 2.85e+06 | 3.29e+03 | 5.70e+05 | 0.00e+00 | 8.73e+04 | 3.14e+08 | 1.11e+06 |
| Ra-224 | 3.12e+05 | 5.66e+02 | 6.25e+04 | 0.00e+00 | 1.50e+04 | 1.08e+08 | 1.24e+06 |
| Ra-225 | 4.74e+06 | 4.22e+03 | 9.47e+05 | 0.00e+00 | 1.12e+05 | 3.60e+08 | 1.05e+06 |
| Ra-226 | 8.66e+08 | 2.83e+04 | 7.10e+08 | 0.00e+00 | 7.51e+05 | 1.44e+09 | 1.12e+06 |
| Ra-228 | 5.51e+08 | 1.46e+04 | 6.22e+08 | 0.00e+00 | 3.85e+05 | 1.99e+09 | 1.90e+05 |
| Ac-225 | 6.70e+06 | 6.92e+06 | 4.48e+05 | 0.00e+00 | 7.36e+05 | 2.73e+08 | 9.88e+05 |
| Ac-227 | 1.84e+10 | 2.98e+09 | 1.14e+09 | 0.00e+00 | 6.55e+08 | 2.97e+09 | 1.93e+05 |
| Th-227 | 3.42e+06 | 4.66e+04 | 9.88e+04 | 0.00e+00 | 2.47e+05 | 4.66e+08 | 1.29e+06 |
| Th-228 | 2.98e+09 | 3.85e+07 | 1.01e+08 | 0.00e+00 | 2.00e+08 | 1.24e+10 | 1.33e+06 |
| Th-229 | 8.07e+10 | 2.12e+09 | 1.34e+09 | 0.00e+00 | 1.05e+10 | 4.00e+10 | 1.85e+05 |
| Th-230 | 1.22e+10 | 6.40e+08 | 3.40e+08 | 0.00e+00 | 3.15e+09 | 6.84e+09 | 1.42e+05 |
| Th-232 | 1.36e+10 | 5.44e+08 | 4.74e+06 | 0.00e+00 | 2.69e+09 | 6.55e+09 | 1.21e+05 |
| Th-234 | 2.57e+04 | 1.14e+03 | 7.40e+02 | 0.00e+00 | 5.99e+03 | 2.33e+06 | 2.71e+05 |
| Pa-231 | 3.19e+10 | 1.06e+09 | 1.27e+09 | 0.00e+00 | 5.77e+09 | 7.10e+08 | 1.69e+05 |
| Pa-233 | 1.53e+04 | 2.40e+03 | 2.68e+03 | 0.00e+00 | 8.81e+03 | 3.61e+05 | 3.31e+04 |
| U-232 | 8.10e+08 | 0.00e+00 | 5.77e+07 | 0.00e+00 | 6.18e+07 | 2.75e+09 | 1.60e+05 |
| U-233 | 1.72e+08 | 0.00e+00 | 1.04e+07 | 0.00e+00 | 2.82e+07 | 6.55e+08 | 1.48e+05 |
| U-234 | 1.65e+08 | 0.00e+00 | 1.02e+07 | 0.00e+00 | 2.76e+07 | 6.44e+08 | 1.45e+05 |
| U-235 | 1.58e+08 | 0.00e+00 | 9.58e+06 | 0.00e+00 | 2.59e+07 | 6.03e+08 | 1.84e+05 |
| U-236 | 1.58e+08 | 0.00e+00 | 9.80e+06 | 0.00e+00 | 2.65e+07 | 6.18e+08 | 1.36e+05 |
| U-237 | 5.81e+02 | 0.00e+00 | 1.54e+02 | 0.00e+00 | 1.68e+03 | 1.26e+05 | 4.77e+04 |
| U-238 | 1.51e+08 | 0.00e+00 | 8.95e+06 | 0.00e+00 | 2.42e+07 | 5.66e+08 | 1.30e+05 |
| Np-237 | 1.01e+10 | 5.99e+09 | 4.40e+08 | 0.00e+00 | 2.74e+09 | 6.44e+08 | 1.87e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 4.66e+03 | 8.51e+02 | 7.29e+01 | 0.00e+00 | 3.02e+02 | 1.25e+05 | 9.25e+04 |
| Np-239 | 4.66e+02 | 3.01e+02 | 2.35e+01 | 0.00e+00 | 9.73e+01 | 5.81e+04 | 6.40e+04 |
| Pu-238 | 9.44e+09 | 5.92e+09 | 4.48e+08 | 0.00e+00 | 1.65e+09 | 2.25e+09 | 1.72e+05 |
| Pu-239 | 1.03e+10 | 6.22e+09 | 4.74e+08 | 0.00e+00 | 1.77e+09 | 2.12e+09 | 1.57e+05 |
| Pu-240 | 1.03e+10 | 6.22e+09 | 4.70e+08 | 0.00e+00 | 1.76e+09 | 2.11e+09 | 1.60e+05 |
| Pu-241 | 2.94e+08 | 6.48e+07 | 1.08e+07 | 0.00e+00 | 4.07e+07 | 1.87e+06 | 3.29e+03 |
| Pu-242 | 9.58e+09 | 5.99e+09 | 4.55e+08 | 0.00e+00 | 1.70e+09 | 2.04e+09 | 1.54e+05 |
| Pu-244 | 1.12e+10 | 6.84e+09 | 5.22e+08 | 0.00e+00 | 1.95e+09 | 2.33e+09 | 2.29e+05 |
| Am-241 | 1.10e+10 | 6.81e+09 | 4.59e+08 | 0.00e+00 | 2.82e+09 | 7.47e+08 | 1.75e+05 |
| Am-242m | 1.14e+10 | 6.51e+09 | 4.70e+08 | 0.00e+00 | 2.85e+09 | 3.01e+08 | 2.21e+05 |
| Am-243 | 1.09e+10 | 6.59e+09 | 4.44e+08 | 0.00e+00 | 2.75e+09 | 7.10e+08 | 2.05e+05 |
| Cm-242 | 3.51e+08 | 2.10e+08 | 1.55e+07 | 0.00e+00 | 4.96e+07 | 4.85e+08 | 1.87e+05 |
| Cm-243 | 8.58e+09 | 5.25e+09 | 3.68e+08 | 0.00e+00 | 1.38e+09 | 7.77e+08 | 1.84e+05 |
| Cm-244 | 7.18e+09 | 4.37e+09 | 3.07e+08 | 0.00e+00 | 1.13e+09 | 7.47e+08 | 1.78e+05 |
| Cm-245 | 1.13e+10 | 6.81e+09 | 4.74e+08 | 0.00e+00 | 1.86e+09 | 7.22e+08 | 1.66e+05 |
| Cm-246 | 1.12e+10 | 6.81e+09 | 4.74e+08 | 0.00e+00 | 1.86e+09 | 7.36e+08 | 1.63e+05 |
| Cm-247 | 1.09e+10 | 6.73e+09 | 4.66e+08 | 0.00e+00 | 1.83e+09 | 7.22e+08 | 2.15e+05 |
| Cm-248 | 9.06e+10 | 5.55e+10 | 3.85e+09 | 0.00e+00 | 1.51e+10 | 5.96e+09 | 3.46e+06 |
| Cf-252 | 8.07e+09 | 0.00e+00 | 3.45e+08 | 0.00e+00 | 0.00e+00 | 2.45e+09 | 6.81e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 3.68e+02 | 3.68e+02 | 3.68e+02 | 3.68e+02 | 3.68e+02 | 3.68e+02 |
| Be-10 | 1.33e+06 | 1.75e+05 | 3.71e+04 | 0.00e+00 | 0.00e+00 | 2.09e+06 | 2.42e+04 |
| C-14 | 2.65e+04 | 5.31e+03 | 5.31e+03 | 5.31e+03 | 5.31e+03 | 5.31e+03 | 5.31e+03 |
| N-13 | 6.15e+01 | 6.15e+01 | 6.15e+01 | 6.15e+01 | 6.15e+01 | 6.15e+01 | 6.15e+01 |
| F-18 | 5.49e+03 | 0.00e+00 | 4.66e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.54e+02 |
| Na-22 | 1.03e+05 | 1.03e+05 | 1.03e+05 | 1.03e+05 | 1.03e+05 | 1.03e+05 | 1.03e+05 |
| Na-24 | 1.06e+04 | 1.06e+04 | 1.06e+04 | 1.06e+04 | 1.06e+04 | 1.06e+04 | 1.06e+04 |
| P-32 | 2.03e+06 | 1.12e+05 | 7.74e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.61e+04 |
| Ca-41 | 1.05e+05 | 0.00e+00 | 1.14e+04 | 0.00e+00 | 0.00e+00 | 9.72e+07 | 4.14e+02 |
| Sc-46 | 5.25e+05 | 7.57e+05 | 2.37e+05 | 0.00e+00 | 4.98e+05 | 0.00e+00 | 3.07e+04 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 8.95e+01 | 5.75e+01 | 1.32e+01 | 1.28e+04 | 3.57e+02 |
| Mn-54 | 0.00e+00 | 2.53e+04 | 4.98e+03 | 0.00e+00 | 4.98e+03 | 1.00e+06 | 7.06e+03 |
| Mn-56 | 0.00e+00 | 1.54e+00 | 2.21e-01 | 0.00e+00 | 1.10e+00 | 1.25e+04 | 7.17e+04 |
| Fe-55 | 1.97e+04 | 1.17e+04 | 3.33e+03 | 0.00e+00 | 0.00e+00 | 8.69e+04 | 1.09e+03 |
| Fe-59 | 1.36e+04 | 2.35e+04 | 9.48e+03 | 0.00e+00 | 0.00e+00 | 1.01e+06 | 2.48e+04 |
| Co-57 | 0.00e+00 | 6.51e+02 | 6.41e+02 | 0.00e+00 | 0.00e+00 | 3.79e+05 | 4.86e+03 |
| Co-58 | 0.00e+00 | 1.22e+03 | 1.82e+03 | 0.00e+00 | 0.00e+00 | 7.77e+05 | 1.11e+04 |
| Co-60 | 0.00e+00 | 8.02e+03 | 1.18e+04 | 0.00e+00 | 0.00e+00 | 4.51e+06 | 3.19e+04 |
| Ni-59 | 2.53e+04 | 7.62e+03 | 4.34e+03 | 0.00e+00 | 0.00e+00 | 7.67e+04 | 8.88e+02 |
| Ni-63 | 3.39e+05 | 2.04e+04 | 1.16e+04 | 0.00e+00 | 0.00e+00 | 2.09e+05 | 2.42e+03 |
| Ni-65 | 2.39e+00 | 2.84e-01 | 1.23e-01 | 0.00e+00 | 0.00e+00 | 8.12e+03 | 5.01e+04 |
| Cu-64 | 0.00e+00 | 1.88e+00 | 7.74e-01 | 0.00e+00 | 3.98e+00 | 9.30e+03 | 1.50e+04 |
| Zn-65 | 1.93e+04 | 6.26e+04 | 3.11e+04 | 0.00e+00 | 3.25e+04 | 6.47e+05 | 5.14e+04 |
| Zn-69 | 5.39e-02 | 9.67e-02 | 7.18e-03 | 0.00e+00 | 4.02e-02 | 1.47e+03 | 1.32e+04 |
| Zn-69m | 1.26e+01 | 2.58e+01 | 2.34e+00 | 0.00e+00 | 1.04e+01 | 2.67e+04 | 4.09e+04 |
| Se-79 | 0.00e+00 | 3.15e+03 | 5.88e+02 | 0.00e+00 | 3.46e+03 | 4.19e+05 | 4.84e+03 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.33e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 3.81e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 4.00e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 2.04e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.90e+05 | 8.82e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.04e+03 |
| Rb-87 | 0.00e+00 | 9.95e+04 | 3.70e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.19e+02 |
| Rb-88 | 0.00e+00 | 5.57e+02 | 2.87e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.39e+02 |
| Rb-89 | 0.00e+00 | 3.21e+02 | 2.06e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.82e+01 |
| Sr-89 | 3.98e+05 | 0.00e+00 | 1.14e+04 | 0.00e+00 | 0.00e+00 | 2.03e+06 | 6.40e+04 |
| Sr-90 | 1.55e+07 | 0.00e+00 | 3.12e+05 | 0.00e+00 | 0.00e+00 | 1.12e+07 | 1.31e+05 |
| Sr-91 | 9.56e+01 | 0.00e+00 | 3.46e+00 | 0.00e+00 | 0.00e+00 | 5.26e+04 | 7.34e+04 |
| Sr-92 | 1.05e+01 | 0.00e+00 | 3.91e-01 | 0.00e+00 | 0.00e+00 | 2.38e+04 | 1.40e+05 |
| Y-90 | 3.29e+03 | 0.00e+00 | 8.82e+01 | 0.00e+00 | 0.00e+00 | 2.69e+05 | 1.04e+05 |
| Y-91 | 5.88e+05 | 0.00e+00 | 1.57e+04 | 0.00e+00 | 0.00e+00 | 2.45e+06 | 7.03e+04 |
| Y-91m | 4.07e-01 | 0.00e+00 | 1.39e-02 | 0.00e+00 | 0.00e+00 | 2.79e+03 | 2.35e+03 |
| Y-92 | 1.64e+01 | 0.00e+00 | 4.61e-01 | 0.00e+00 | 0.00e+00 | 2.45e+04 | 1.27e+05 |
| Y-93 | 1.50e+02 | 0.00e+00 | 4.07e+00 | 0.00e+00 | 0.00e+00 | 7.64e+04 | 1.67e+05 |
| Zr-93 | 3.14e+05 | 1.33e+04 | 8.65e+03 | 0.00e+00 | 4.47e+04 | 1.92e+05 | 2.07e+03 |
| Zr-95 | 1.15e+05 | 2.79e+04 | 2.03e+04 | 0.00e+00 | 3.11e+04 | 1.75e+06 | 2.17e+04 |
| Zr-97 | 1.50e+02 | 2.56e+01 | 1.17e+01 | 0.00e+00 | 2.59e+01 | 1.10e+05 | 1.40e+05 |
| Nb-93m | 1.93e+05 | 5.03e+04 | 1.61e+04 | 0.00e+00 | 5.15e+04 | 2.93e+05 | 3.46e+03 |
| Nb-95 | 1.57e+04 | 6.43e+03 | 3.78e+03 | 0.00e+00 | 4.72e+03 | 4.79e+05 | 1.27e+04 |
| Nb-97 | 3.42e-01 | 7.29e-02 | 2.63e-02 | 0.00e+00 | 5.70e-02 | 3.32e+03 | 2.69e+04 |
| Mo-93 | 0.00e+00 | 9.04e+03 | 3.11e+02 | 0.00e+00 | 2.16e+03 | 4.76e+05 | 5.26e+03 |
| Mo-99 | 0.00e+00 | 1.65e+02 | 3.23e+01 | 0.00e+00 | 2.65e+02 | 1.35e+05 | 4.87e+04 |
| Tc-101 | 6.51e-05 | 8.23e-05 | 8.12e-04 | 0.00e+00 | 9.79e-04 | 5.84e+02 | 8.44e+02 |
| Tc-99 | 2.93e+02 | 3.75e+02 | 1.24e+02 | 0.00e+00 | 3.49e+03 | 9.48e+05 | 1.09e+04 |
| Tc-99m | 1.40e-03 | 2.88e-03 | 3.72e-02 | 0.00e+00 | 3.11e-02 | 8.11e+02 | 2.03e+03 |
| Ru-103 | 2.02e+03 | 0.00e+00 | 6.79e+02 | 0.00e+00 | 4.24e+03 | 5.52e+05 | 1.61e+04 |
| Ru-105 | 1.22e+00 | 0.00e+00 | 4.10e-01 | 0.00e+00 | 8.99e-01 | 1.57e+04 | 4.84e+04 |
| Ru-106 | 8.68e+04 | 0.00e+00 | 1.09e+04 | 0.00e+00 | 1.07e+05 | 1.16e+07 | 1.64e+05 |
| Rh-105 | 1.16e+01 | 7.57e+00 | 5.08e+00 | 0.00e+00 | 2.10e+01 | 2.91e+04 | 1.92e+04 |
| Pd-107 | 0.00e+00 | 6.89e+02 | 5.75e+01 | 0.00e+00 | 3.85e+03 | 8.88e+04 | 1.03e+03 |
| Pd-109 | 0.00e+00 | 5.49e+00 | 1.47e+00 | 0.00e+00 | 1.79e+01 | 2.35e+04 | 3.99e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ag-110m | 9.98e+03 | 7.22e+03 | 5.00e+03 | 0.00e+00 | 1.09e+04 | 3.67e+06 | 3.30e+04 |
| Ag-111 | 5.25e+02 | 2.03e+02 | 1.08e+02 | 0.00e+00 | 4.27e+02 | 2.88e+05 | 4.23e+04 |
| Cd-113m | 0.00e+00 | 9.34e+05 | 3.70e+04 | 0.00e+00 | 8.12e+05 | 1.96e+06 | 2.31e+04 |
| Cd-115m | 0.00e+00 | 2.42e+05 | 8.67e+03 | 0.00e+00 | 1.32e+05 | 2.06e+06 | 7.03e+04 |
| Sr-123 | 2.93e+05 | 5.89e+03 | 1.02e+04 | 5.98e+03 | 0.00e+00 | 3.11e+06 | 5.71e+04 |
| Sr-125 | 1.41e+04 | 3.51e+02 | 8.40e+02 | 3.46e+02 | 0.00e+00 | 9.00e+05 | 1.02e+05 |
| Sr-126 | 1.16e+06 | 2.02e+04 | 4.93e+04 | 5.38e+03 | 0.00e+00 | 6.90e+06 | 2.31e+04 |
| Sb-124 | 3.79e+04 | 5.56e+02 | 1.20e+04 | 1.01e+02 | 0.00e+00 | 2.65e+06 | 5.91e+04 |
| Sb-125 | 5.17e+04 | 4.77e+02 | 1.09e+04 | 6.23e+01 | 0.00e+00 | 1.64e+06 | 1.47e+04 |
| Sb-126 | 4.31e+03 | 8.41e+01 | 1.55e+03 | 3.29e+01 | 0.00e+00 | 9.63e+05 | 7.46e+04 |
| Sb-127 | 3.95e+02 | 7.06e+00 | 1.23e+02 | 5.04e+00 | 0.00e+00 | 2.16e+05 | 5.29e+04 |
| Te-125m | 4.76e+03 | 1.99e+03 | 6.58e+02 | 1.62e+03 | 0.00e+00 | 4.47e+05 | 1.29e+04 |
| Te-127 | 2.23e+00 | 9.53e-01 | 4.89e-01 | 1.85e+00 | 4.86e+00 | 1.03e+04 | 2.44e+04 |
| Te-127m | 1.67e+04 | 6.90e+03 | 2.07e+03 | 4.87e+03 | 3.75e+04 | 1.31e+06 | 2.73e+04 |
| Te-129 | 7.88e-02 | 3.47e-02 | 1.88e-02 | 6.75e-02 | 1.75e-01 | 3.00e+03 | 2.63e+04 |
| Te-129m | 1.41e+04 | 6.09e+03 | 2.23e+03 | 5.47e+03 | 3.18e+04 | 1.68e+06 | 6.90e+04 |
| Te-131 | 1.74e-02 | 8.22e-03 | 5.00e-03 | 1.58e-02 | 3.99e-02 | 2.06e+03 | 8.22e+03 |
| Te-131m | 1.07e+02 | 5.50e+01 | 3.63e+01 | 8.93e+01 | 2.65e+02 | 1.99e+05 | 1.19e+05 |
| Te-132 | 3.72e+02 | 2.37e+02 | 1.76e+02 | 2.79e+02 | 1.03e+03 | 3.40e+05 | 4.41e+04 |
| Te-133m | 8.58e-02 | 5.03e-02 | 3.84e-02 | 7.73e-02 | 2.41e-01 | 5.49e+03 | 2.23e+04 |
| Te-134 | 4.45e-02 | 2.86e-02 | 2.35e-02 | 4.07e-02 | 1.34e-01 | 4.10e+03 | 3.54e+03 |
| I-129 | 3.02e+04 | 2.23e+04 | 1.62e+04 | 1.46e+07 | 2.63e+04 | 0.00e+00 | 2.97e+02 |
| I-130 | 6.36e+03 | 1.39e+04 | 5.57e+03 | 1.60e+06 | 1.53e+04 | 0.00e+00 | 1.99e+03 |
| I-131 | 3.79e+04 | 4.44e+04 | 1.96e+04 | 1.48e+07 | 5.18e+04 | 0.00e+00 | 1.06e+03 |
| I-132 | 1.69e+03 | 3.54e+03 | 1.26e+03 | 1.69e+05 | 3.95e+03 | 0.00e+00 | 1.90e+03 |
| I-133 | 1.32e+04 | 1.92e+04 | 5.60e+03 | 3.56e+06 | 2.24e+04 | 0.00e+00 | 2.16e+03 |
| I-134 | 9.21e+02 | 1.88e+03 | 6.65e+02 | 4.45e+04 | 2.09e+03 | 0.00e+00 | 1.29e+03 |
| I-135 | 3.86e+03 | 7.60e+03 | 2.77e+03 | 6.96e+05 | 8.47e+03 | 0.00e+00 | 1.83e+03 |
| Cs-134 | 3.96e+05 | 7.03e+05 | 7.45e+04 | 0.00e+00 | 1.90e+05 | 7.97e+04 | 1.33e+03 |
| Cs-134m | 1.85e+02 | 2.94e+02 | 1.55e+02 | 0.00e+00 | 1.19e+02 | 2.80e+01 | 1.62e+02 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.40e+05 | 1.21e+05 | 6.62e+03 | 0.00e+00 | 3.61e+04 | 1.41e+04 | 3.05e+02 |
| Cs-136 | 4.83e+04 | 1.35e+05 | 5.29e+04 | 0.00e+00 | 5.64e+04 | 1.18e+04 | 1.43e+03 |
| Cs-137 | 5.49e+05 | 6.12e+05 | 4.55e+04 | 0.00e+00 | 1.72e+05 | 7.13e+04 | 1.33e+03 |
| Cs-138 | 5.05e+02 | 7.81e+02 | 3.98e+02 | 0.00e+00 | 4.10e+02 | 6.54e+01 | 8.76e+02 |
| Cs-139 | 3.25e+02 | 4.24e+02 | 1.71e+02 | 0.00e+00 | 2.31e+02 | 3.54e+01 | 1.86e+01 |
| Ba-139 | 1.48e+00 | 9.84e-04 | 4.30e-02 | 0.00e+00 | 5.92e-04 | 5.95e+03 | 5.10e+04 |
| Ba-140 | 5.60e+04 | 5.60e+01 | 2.90e+03 | 0.00e+00 | 1.34e+01 | 1.60e+06 | 3.84e+04 |
| Ba-141 | 1.57e-01 | 1.08e-04 | 4.97e-03 | 0.00e+00 | 6.50e-05 | 2.97e+03 | 4.75e+03 |
| Ba-142 | 3.98e-02 | 3.30e-05 | 1.96e-03 | 0.00e+00 | 1.90e-05 | 1.55e+03 | 6.93e+02 |
| La-140 | 5.05e+02 | 2.00e+02 | 5.15e+01 | 0.00e+00 | 0.00e+00 | 1.68e+05 | 8.48e+04 |
| La-141 | 6.79e+00 | 1.96e+00 | 3.43e-01 | 0.00e+00 | 0.00e+00 | 1.71e+04 | 8.34e+04 |
| La-142 | 1.03e+00 | 3.77e-01 | 9.04e-02 | 0.00e+00 | 0.00e+00 | 8.22e+03 | 5.95e+04 |
| Ce-141 | 2.77e+04 | 1.67e+04 | 1.99e+03 | 0.00e+00 | 5.25e+03 | 5.17e+05 | 2.16e+04 |
| Ce-143 | 2.93e+02 | 1.93e+02 | 2.21e+01 | 0.00e+00 | 5.64e+01 | 1.16e+05 | 4.97e+04 |
| Ce-144 | 3.19e+06 | 1.21e+06 | 1.76e+05 | 0.00e+00 | 5.38e+05 | 9.84e+06 | 1.48e+05 |
| Pr-143 | 1.40e+04 | 5.24e+03 | 6.99e+02 | 0.00e+00 | 1.97e+03 | 4.33e+05 | 3.72e+04 |
| Pr-144 | 4.79e-02 | 1.85e-02 | 2.41e-03 | 0.00e+00 | 6.72e-03 | 1.61e+03 | 4.28e+03 |
| Nd-147 | 7.94e+03 | 8.13e+03 | 5.00e+02 | 0.00e+00 | 3.15e+03 | 3.22e+05 | 3.12e+04 |
| Pm-147 | 5.47e+05 | 4.30e+04 | 2.18e+04 | 0.00e+00 | 6.90e+04 | 6.37e+05 | 8.05e+03 |
| Pm-148 | 4.68e+03 | 6.75e+02 | 3.42e+02 | 0.00e+00 | 8.06e+02 | 4.48e+05 | 8.46e+04 |
| Pm-148m | 7.00e+04 | 1.74e+04 | 1.39e+04 | 0.00e+00 | 2.03e+04 | 1.71e+06 | 4.72e+04 |
| Pm-149 | 4.34e+02 | 5.71e+01 | 2.49e+01 | 0.00e+00 | 6.94e+01 | 9.10e+04 | 4.21e+04 |
| Pm-151 | 1.05e+02 | 1.54e+01 | 7.77e+00 | 0.00e+00 | 1.82e+01 | 4.55e+04 | 3.61e+04 |
| Sm-151 | 4.73e+05 | 9.03e+04 | 2.28e+04 | 0.00e+00 | 7.34e+04 | 4.17e+05 | 4.84e+03 |
| Sm-153 | 2.14e+02 | 1.65e+02 | 1.27e+01 | 0.00e+00 | 3.46e+01 | 5.18e+04 | 2.70e+04 |
| Eu-152 | 1.10e+06 | 2.48e+05 | 2.41e+05 | 0.00e+00 | 8.32e+05 | 2.07e+06 | 1.38e+04 |
| Eu-154 | 4.14e+06 | 4.84e+05 | 3.43e+05 | 0.00e+00 | 1.60e+06 | 4.27e+06 | 3.98e+04 |
| Eu-155 | 8.36e+05 | 8.01e+04 | 4.84e+04 | 0.00e+00 | 2.21e+05 | 7.28e+05 | 7.27e+04 |
| Eu-156 | 2.18e+04 | 1.34e+04 | 2.16e+03 | 0.00e+00 | 6.27e+03 | 8.57e+05 | 5.80e+04 |
| Tb-160 | 1.57e+05 | 0.00e+00 | 1.96e+04 | 0.00e+00 | 4.48e+04 | 1.55e+06 | 3.00e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 2.03e+06 | 4.30e+05 | 3.51e+05 | 0.00e+00 | 5.91e+05 | 2.87e+06 | 2.31e+04 |
| W-181 | 6.80e+01 | 2.04e+01 | 2.34e+00 | 0.00e+00 | 0.00e+00 | 1.86e+04 | 3.68e+02 |
| W-185 | 2.20e+03 | 6.76e+02 | 7.81e+01 | 0.00e+00 | 0.00e+00 | 6.27e+05 | 1.57e+04 |
| W-187 | 1.30e+01 | 9.02e+00 | 3.12e+00 | 0.00e+00 | 0.00e+00 | 3.96e+04 | 3.56e+04 |
| Pb-210 | 1.21e+08 | 2.83e+07 | 4.80e+06 | 0.00e+00 | 9.59e+07 | 2.46e+08 | 2.20e+03 |
| Bi-210 | 2.88e+03 | 1.86e+04 | 1.65e+03 | 0.00e+00 | 1.44e+05 | 1.39e+07 | 4.58e+04 |
| Po-210 | 4.17e+06 | 7.88e+06 | 9.97e+05 | 0.00e+00 | 1.82e+07 | 3.36e+08 | 6.10e+04 |
| Ra-223 | 2.18e+06 | 3.16e+03 | 4.37e+05 | 0.00e+00 | 5.82e+04 | 3.15e+08 | 4.26e+05 |
| Ra-224 | 2.48e+05 | 5.60e+02 | 4.96e+04 | 0.00e+00 | 1.02e+04 | 1.11e+08 | 4.79e+05 |
| Ra-225 | 3.60e+06 | 4.03e+03 | 7.18e+05 | 0.00e+00 | 7.43e+04 | 3.60e+08 | 4.02e+05 |
| Ra-226 | 3.47e+08 | 2.04e+04 | 2.87e+08 | 0.00e+00 | 4.12e+05 | 1.10e+09 | 4.27e+05 |
| Ra-228 | 2.24e+08 | 1.07e+04 | 2.52e+08 | 0.00e+00 | 2.14e+05 | 1.53e+09 | 7.27e+04 |
| Ac-225 | 5.17e+06 | 6.61e+06 | 3.47e+05 | 0.00e+00 | 4.89e+05 | 2.74e+08 | 3.79e+05 |
| Ac-227 | 7.41e+09 | 1.23e+09 | 4.59e+08 | 0.00e+00 | 2.60e+08 | 2.27e+09 | 7.38e+04 |
| Th-227 | 2.55e+06 | 4.24e+04 | 7.34e+04 | 0.00e+00 | 1.58e+05 | 4.58e+08 | 4.94e+05 |
| Th-228 | 1.18e+09 | 1.54e+07 | 4.00e+07 | 0.00e+00 | 7.85e+07 | 6.51e+09 | 5.07e+05 |
| Th-229 | 3.19e+10 | 8.32e+08 | 5.33e+08 | 0.00e+00 | 1.30e+09 | 1.78e+10 | 7.03e+04 |
| Th-230 | 4.84e+09 | 2.51e+08 | 1.35e+08 | 0.00e+00 | 1.23e+09 | 3.05e+09 | 5.42e+04 |
| Th-232 | 5.40e+09 | 2.14e+08 | 3.21e+06 | 0.00e+00 | 1.06e+09 | 2.93e+09 | 4.61e+04 |
| Th-234 | 1.86e+04 | 1.00e+03 | 5.38e+02 | 0.00e+00 | 3.78e+03 | 2.27e+06 | 1.04e+05 |
| Pa-231 | 1.27e+10 | 4.20e+08 | 5.07e+08 | 0.00e+00 | 2.27e+09 | 5.39e+08 | 6.45e+04 |
| Pa-233 | 9.58e+03 | 1.85e+03 | 1.67e+03 | 0.00e+00 | 5.15e+03 | 3.07e+05 | 1.27e+04 |
| U-232 | 3.60e+08 | 0.00e+00 | 2.98e+07 | 0.00e+00 | 3.36e+07 | 2.09e+09 | 6.10e+04 |
| U-233 | 7.62e+07 | 0.00e+00 | 5.36e+06 | 0.00e+00 | 1.53e+07 | 4.98e+08 | 5.64e+04 |
| U-234 | 7.31e+07 | 0.00e+00 | 5.25e+06 | 0.00e+00 | 1.50e+07 | 4.89e+08 | 5.53e+04 |
| U-235 | 7.01e+07 | 0.00e+00 | 4.93e+06 | 0.00e+00 | 1.41e+07 | 4.59e+08 | 7.03e+04 |
| U-236 | 7.01e+07 | 0.00e+00 | 5.04e+06 | 0.00e+00 | 1.44e+07 | 4.69e+08 | 5.19e+04 |
| U-237 | 4.55e+02 | 0.00e+00 | 1.21e+02 | 0.00e+00 | 1.13e+03 | 1.28e+05 | 1.83e+04 |
| U-238 | 6.71e+07 | 0.00e+00 | 4.61e+06 | 0.00e+00 | 1.32e+07 | 4.28e+08 | 4.96e+04 |
| Np-237 | 4.03e+09 | 2.39e+09 | 1.76e+08 | 0.00e+00 | 1.08e+09 | 4.89e+08 | 7.14e+04 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Inhalation Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 3.74e+03 | 8.47e+02 | 5.82e+01 | 0.00e+00 | 2.06e+02 | 1.29e+05 | 3.61e+04 |
| Np-239 | 3.71e+02 | 2.98e+02 | 1.88e+01 | 0.00e+00 | 6.62e+01 | 5.95e+04 | 2.49e+04 |
| Pu-238 | 3.77e+09 | 2.35e+09 | 1.78e+08 | 0.00e+00 | 6.50e+08 | 1.26e+09 | 6.57e+04 |
| Pu-239 | 4.10e+09 | 2.46e+09 | 1.88e+08 | 0.00e+00 | 6.93e+08 | 1.19e+09 | 5.99e+04 |
| Pu-240 | 4.10e+09 | 2.45e+09 | 1.88e+08 | 0.00e+00 | 6.92e+08 | 1.19e+09 | 6.10e+04 |
| Pu-241 | 1.18e+08 | 2.59e+07 | 4.35e+06 | 0.00e+00 | 1.61e+07 | 1.07e+06 | 1.26e+03 |
| Pu-242 | 3.81e+09 | 2.37e+09 | 1.81e+08 | 0.00e+00 | 6.68e+08 | 1.14e+09 | 5.88e+04 |
| Pu-244 | 4.44e+09 | 2.72e+09 | 2.07e+08 | 0.00e+00 | 7.64e+08 | 1.31e+09 | 8.76e+04 |
| Am-241 | 4.41e+09 | 2.73e+09 | 1.83e+08 | 0.00e+00 | 1.11e+09 | 5.68e+08 | 6.69e+04 |
| Am-242m | 4.55e+09 | 2.60e+09 | 1.89e+08 | 0.00e+00 | 1.12e+09 | 2.30e+08 | 8.41e+04 |
| Am-243 | 4.34e+09 | 2.63e+09 | 1.78e+08 | 0.00e+00 | 1.08e+09 | 5.39e+08 | 7.84e+04 |
| Cm-242 | 1.79e+08 | 1.21e+08 | 7.98e+06 | 0.00e+00 | 2.37e+07 | 4.16e+08 | 7.14e+04 |
| Cm-243 | 3.46e+09 | 2.13e+09 | 1.48e+08 | 0.00e+00 | 5.47e+08 | 5.94e+08 | 7.03e+04 |
| Cm-244 | 2.90e+09 | 1.78e+09 | 1.24e+08 | 0.00e+00 | 4.49e+08 | 5.71e+08 | 6.80e+04 |
| Cm-245 | 4.51e+09 | 2.74e+09 | 1.90e+08 | 0.00e+00 | 7.32e+08 | 5.49e+08 | 6.34e+04 |
| Cm-246 | 4.48e+09 | 2.74e+09 | 1.90e+08 | 0.00e+00 | 7.32e+08 | 5.59e+08 | 6.23e+04 |
| Cm-247 | 4.35e+09 | 2.70e+09 | 1.86e+08 | 0.00e+00 | 7.21e+08 | 5.49e+08 | 8.19e+04 |
| Cm-248 | 3.61e+10 | 2.23e+10 | 1.54e+09 | 0.00e+00 | 5.94e+09 | 4.52e+09 | 1.32e+06 |
| Cf-252 | 3.32e+09 | 0.00e+00 | 1.41e+08 | 0.00e+00 | 0.00e+00 | 1.92e+09 | 2.59e+05 |

Conversion factors are in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 4.35e+02 | 4.35e+02 | 4.35e+02 | 4.35e+02 | 4.35e+02 | 4.35e+02 |
| Be-10 | 2.46e+06 | 3.79e+05 | 6.14e+04 | 0.00e+00 | 2.87e+05 | 0.00e+00 | 2.07e+07 |
| C-14 | 2.63e+08 | 5.27e+07 | 5.27e+07 | 5.27e+07 | 5.27e+07 | 5.27e+07 | 5.27e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 4.65e-03 | 0.00e+00 | 5.15e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.38e-04 |
| Na-22 | 5.29e+09 | 5.29e+09 | 5.29e+09 | 5.29e+09 | 5.29e+09 | 5.29e+09 | 5.29e+09 |
| Na-24 | 2.44e+06 | 2.44e+06 | 2.44e+06 | 2.44e+06 | 2.44e+06 | 2.44e+06 | 2.44e+06 |
| P-32 | 1.71e+10 | 1.06e+09 | 6.61e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.92e+09 |
| Ca-41 | 1.14e+10 | 0.00e+00 | 1.24e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.14e+07 |
| Sc-46 | 1.79e+02 | 3.48e+02 | 1.01e+02 | 0.00e+00 | 3.25e+02 | 0.00e+00 | 1.70e+06 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 2.86e+04 | 1.71e+04 | 6.30e+03 | 3.79e+04 | 7.19e+06 |
| Mn-54 | 0.00e+00 | 8.41e+06 | 1.61e+06 | 0.00e+00 | 2.50e+06 | 0.00e+00 | 2.58e+07 |
| Mn-56 | 0.00e+00 | 4.15e-03 | 7.37e-04 | 0.00e+00 | 5.27e-03 | 0.00e+00 | 1.33e-01 |
| Fe-55 | 2.51e+07 | 1.73e+07 | 4.05e+06 | 0.00e+00 | 0.00e+00 | 9.68e+06 | 9.95e+06 |
| Fe-59 | 2.97e+07 | 6.98e+07 | 2.68e+07 | 0.00e+00 | 0.00e+00 | 1.95e+07 | 2.33e+08 |
| Cc-57 | 0.00e+00 | 1.28e+06 | 2.13e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.25e+07 |
| Cc-58 | 0.00e+00 | 4.71e+06 | 1.06e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.55e+07 |
| Cc-60 | 0.00e+00 | 1.64e+07 | 3.62e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.08e+08 |
| Ni-59 | 5.05e+08 | 1.73e+08 | 8.44e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.57e+07 |
| Ni-63 | 6.73e+09 | 4.66e+08 | 2.26e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.73e+07 |
| Ni-65 | 3.76e-01 | 4.88e-02 | 2.23e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.24e+00 |
| Cu-64 | 0.00e+00 | 2.39e+04 | 1.12e+04 | 0.00e+00 | 6.03e+04 | 0.00e+00 | 2.04e+06 |
| Zr-65 | 1.37e+09 | 4.37e+09 | 1.97e+09 | 0.00e+00 | 2.92e+09 | 0.00e+00 | 2.75e+09 |
| Zr-69 | 2.18e-12 | 4.17e-12 | 2.90e-13 | 0.00e+00 | 2.71e-12 | 0.00e+00 | 6.26e-13 |
| Zr-69m | 1.81e+05 | 4.35e+05 | 3.98e+04 | 0.00e+00 | 2.64e+05 | 0.00e+00 | 2.66e+07 |
| Se-79 | 0.00e+00 | 9.15e+08 | 1.53e+08 | 0.00e+00 | 1.58e+09 | 0.00e+00 | 1.87e+08 |
| Br-82 | 0.00e+00 | 0.00e+00 | 3.23e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.70e+07 |
| Br-83 | 0.00e+00 | 0.00e+00 | 9.87e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.42e-01 |
| Br-84 | 0.00e+00 | 0.00e+00 | 1.73e-23 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.36e-28 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.59e+09 | 1.21e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.12e+08 |
| Rb-87 | 0.00e+00 | 2.85e+09 | 9.92e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.34e+08 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 1.45e+09 | 0.00e+00 | 4.16e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.33e+08 |
| Sr-90 | 5.38e+10 | 0.00e+00 | 1.08e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.35e+09 |
| Sr-91 | 2.90e+04 | 0.00e+00 | 1.17e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.38e+05 |
| Sr-92 | 4.95e-01 | 0.00e+00 | 2.14e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.81e+00 |
| Y-90 | 7.09e+01 | 0.00e+00 | 1.90e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.52e+05 |
| Y-91 | 8.59e+03 | 0.00e+00 | 2.30e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.73e+06 |
| Y-91m | 6.27e-20 | 0.00e+00 | 2.43e-21 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.84e-19 |
| Y-92 | 5.64e-05 | 0.00e+00 | 1.65e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.88e-01 |
| Y-93 | 2.24e-01 | 0.00e+00 | 6.19e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.11e+03 |
| Zr-93 | 1.62e+03 | 9.04e+01 | 4.21e+01 | 0.00e+00 | 3.43e+02 | 0.00e+00 | 9.39e+04 |
| Zr-95 | 9.43e+02 | 3.03e+02 | 2.05e+02 | 0.00e+00 | 4.75e+02 | 0.00e+00 | 9.59e+05 |
| Zr-97 | 4.34e-01 | 8.76e-02 | 4.01e-02 | 0.00e+00 | 1.32e-01 | 0.00e+00 | 2.71e+04 |
| Nb-93m | 4.91e+05 | 1.60e+05 | 3.95e+04 | 0.00e+00 | 1.84e+05 | 0.00e+00 | 7.40e+07 |
| Nb-95 | 8.26e+04 | 4.59e+04 | 2.47e+04 | 0.00e+00 | 4.54e+04 | 0.00e+00 | 2.79e+08 |
| Nb-97 | 6.58e-12 | 1.66e-12 | 6.07e-13 | 0.00e+00 | 1.94e-12 | 0.00e+00 | 6.14e-09 |
| Mo-93 | 0.00e+00 | 4.35e+08 | 1.18e+07 | 0.00e+00 | 1.23e+08 | 0.00e+00 | 7.07e+07 |
| Mo-99 | 0.00e+00 | 2.48e+07 | 4.72e+06 | 0.00e+00 | 5.61e+07 | 0.00e+00 | 5.74e+07 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 2.42e+07 | 3.59e+07 | 9.70e+06 | 0.00e+00 | 4.52e+08 | 3.05e+06 | 1.17e+09 |
| Tc-99m | 3.34e+00 | 9.44e+00 | 1.20e+02 | 0.00e+00 | 1.43e+02 | 4.63e+00 | 5.59e+03 |
| Ru-103 | 1.02e+03 | 0.00e+00 | 4.39e+02 | 0.00e+00 | 3.89e+03 | 0.00e+00 | 1.19e+05 |
| Ru-105 | 8.64e-04 | 0.00e+00 | 3.41e-04 | 0.00e+00 | 1.12e-02 | 0.00e+00 | 5.29e-01 |
| Ru-106 | 2.04e+04 | 0.00e+00 | 2.58e+03 | 0.00e+00 | 3.94e+04 | 0.00e+00 | 1.32e+06 |
| Rh-105 | 3.46e+05 | 2.53e+05 | 1.67e+05 | 0.00e+00 | 1.08e+06 | 0.00e+00 | 4.03e+07 |
| Pd-107 | 0.00e+00 | 1.14e+07 | 7.26e+05 | 0.00e+00 | 1.02e+08 | 0.00e+00 | 7.04e+07 |
| Pd-109 | 0.00e+00 | 4.49e+04 | 1.01e+04 | 0.00e+00 | 2.56e+05 | 0.00e+00 | 4.98e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 5.82e+07 | 5.39e+07 | 3.20e+07 | 0.00e+00 | 1.06e+08 | 0.00e+00 | 2.20e+10 |
| Ag-111 | 6.47e+06 | 2.71e+06 | 1.35e+06 | 0.00e+00 | 8.74e+06 | 0.00e+00 | 4.97e+09 |
| Cc-113m | 0.00e+00 | 2.94e+06 | 9.43e+04 | 0.00e+00 | 3.24e+06 | 0.00e+00 | 2.37e+07 |
| Cc-115m | 0.00e+00 | 1.26e+06 | 4.02e+04 | 0.00e+00 | 9.99e+05 | 0.00e+00 | 5.30e+07 |
| Sr-123 | 5.36e+08 | 8.88e+06 | 1.31e+07 | 7.55e+06 | 0.00e+00 | 0.00e+00 | 1.09e+09 |
| Sr-125 | 5.68e+07 | 1.14e+06 | 2.58e+06 | 9.47e+05 | 0.00e+00 | 0.00e+00 | 7.09e+08 |
| Sr-126 | 1.63e+09 | 3.23e+07 | 4.64e+07 | 9.51e+06 | 0.00e+00 | 0.00e+00 | 4.69e+08 |
| Sb-124 | 2.57e+07 | 4.86e+05 | 1.02e+07 | 6.24e+04 | 0.00e+00 | 2.00e+07 | 7.31e+08 |
| Sb-125 | 2.04e+07 | 2.28e+05 | 4.86e+06 | 2.08e+04 | 0.00e+00 | 1.58e+07 | 2.25e+08 |
| Sb-126 | 5.63e+06 | 1.15e+05 | 2.03e+06 | 3.45e+04 | 0.00e+00 | 3.45e+06 | 4.60e+08 |
| Sb-127 | 4.53e+05 | 9.93e+03 | 1.74e+05 | 5.45e+03 | 0.00e+00 | 2.69e+05 | 1.04e+08 |
| Te-125m | 1.63e+07 | 5.90e+06 | 2.18e+06 | 4.90e+06 | 6.63e+07 | 0.00e+00 | 6.50e+07 |
| Te-127 | 6.56e+02 | 2.35e+02 | 1.42e+02 | 4.86e+02 | 2.67e+03 | 0.00e+00 | 5.17e+04 |
| Te-127m | 4.58e+07 | 1.64e+07 | 5.58e+06 | 1.17e+07 | 1.86e+08 | 0.00e+00 | 1.53e+08 |
| Te-129 | 2.92e-10 | 1.10e-10 | 7.11e-11 | 2.24e-10 | 1.23e-09 | 0.00e+00 | 2.20e-10 |
| Te-129m | 6.02e+07 | 2.25e+07 | 9.53e+06 | 2.07e+07 | 2.51e+08 | 0.00e+00 | 3.03e+08 |
| Te-131 | 3.95e-33 | 1.65e-33 | 1.25e-33 | 3.25e-33 | 1.73e-32 | 0.00e+00 | 5.60e-34 |
| Te-131m | 3.62e+05 | 1.77e+05 | 1.47e+05 | 2.80e+05 | 1.79e+06 | 0.00e+00 | 1.76e+07 |
| Te-132 | 2.40e+06 | 1.55e+06 | 1.46e+06 | 1.72e+06 | 1.50e+07 | 0.00e+00 | 7.35e+07 |
| Te-133m | 2.19e-13 | 1.28e-13 | 1.24e-13 | 1.86e-13 | 1.27e-12 | 0.00e+00 | 4.40e-14 |
| Te-134 | 9.41e-19 | 6.16e-19 | 3.78e-19 | 8.22e-19 | 5.95e-18 | 0.00e+00 | 1.04e-21 |
| I-129 | 7.58e+08 | 6.51e+08 | 2.14e+09 | 1.68e+12 | 1.40e+09 | 0.00e+00 | 1.03e+08 |
| I-130 | 4.21e+05 | 1.24e+06 | 4.90e+05 | 1.05e+08 | 1.94e+06 | 0.00e+00 | 1.07e+06 |
| I-131 | 2.96e+08 | 4.24e+08 | 2.43e+08 | 1.39e+11 | 7.26e+08 | 0.00e+00 | 1.12e+08 |
| I-132 | 1.67e-01 | 4.47e-01 | 1.56e-01 | 1.56e+01 | 7.12e-01 | 0.00e+00 | 8.39e-02 |
| I-133 | 3.88e+06 | 6.74e+06 | 2.06e+06 | 9.91e+08 | 1.18e+07 | 0.00e+00 | 6.06e+06 |
| I-134 | 2.11e-12 | 5.72e-12 | 2.05e-12 | 9.92e-11 | 9.10e-12 | 0.00e+00 | 4.99e-15 |
| I-135 | 1.29e+04 | 3.38e+04 | 1.25e+04 | 2.23e+06 | 5.42e+04 | 0.00e+00 | 3.82e+04 |
| Cs-134 | 5.65e+09 | 1.34e+10 | 1.10e+10 | 0.00e+00 | 4.35e+09 | 1.44e+09 | 2.35e+08 |
| Cs-134m | 1.76e-01 | 3.70e-01 | 1.89e-01 | 0.00e+00 | 2.01e-01 | 3.16e-02 | 1.31e-01 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.81e+09 | 1.67e+09 | 7.41e+08 | 0.00e+00 | 6.32e+08 | 1.89e+08 | 3.90e+07 |
| Cs-136 | 2.63e+08 | 1.04e+09 | 7.48e+08 | 0.00e+00 | 5.78e+08 | 7.93e+07 | 1.18e+08 |
| Cs-137 | 7.38e+09 | 1.01e+10 | 6.61e+09 | 0.00e+00 | 3.43e+09 | 1.14e+09 | 1.95e+08 |
| Cs-138 | 9.72e-24 | 1.92e-23 | 9.50e-24 | 0.00e+00 | 1.41e-23 | 1.39e-24 | 8.18e-29 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 4.54e-08 | 3.24e-11 | 1.33e-09 | 0.00e+00 | 3.03e-11 | 1.84e-11 | 8.06e-08 |
| Ba-140 | 2.69e+07 | 3.38e+04 | 1.76e+06 | 0.00e+00 | 1.15e+04 | 1.93e+04 | 5.54e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 4.52e+00 | 2.28e+00 | 6.01e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.67e+05 |
| La-141 | 3.00e-05 | 9.31e-06 | 1.52e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.11e+00 |
| La-142 | 1.90e-11 | 8.66e-12 | 2.16e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.32e-08 |
| Ce-141 | 4.84e+03 | 3.28e+03 | 3.72e+02 | 0.00e+00 | 1.52e+03 | 0.00e+00 | 1.25e+07 |
| Ce-143 | 4.16e+01 | 3.08e+04 | 3.40e+00 | 0.00e+00 | 1.35e+01 | 0.00e+00 | 1.15e+06 |
| Ce-144 | 3.58e+05 | 1.50e+05 | 1.92e+04 | 0.00e+00 | 8.87e+04 | 0.00e+00 | 1.21e+08 |
| Pr-143 | 1.58e+02 | 6.33e+01 | 7.83e+00 | 0.00e+00 | 3.66e+01 | 0.00e+00 | 6.92e+05 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 9.42e+01 | 1.09e+02 | 6.51e+00 | 0.00e+00 | 6.36e+01 | 0.00e+00 | 5.22e+05 |
| Pm-147 | 2.87e+03 | 2.70e+02 | 1.09e+02 | 0.00e+00 | 5.10e+02 | 0.00e+00 | 3.40e+05 |
| Pm-148 | 5.93e+01 | 9.85e+00 | 4.96e+00 | 0.00e+00 | 1.86e+01 | 0.00e+00 | 7.74e+05 |
| Pm-148m | 8.57e+02 | 2.22e+02 | 1.70e+02 | 0.00e+00 | 3.35e+02 | 0.00e+00 | 1.88e+06 |
| Pm-149 | 4.28e+00 | 6.05e-01 | 2.47e-01 | 0.00e+00 | 1.14e+00 | 0.00e+00 | 1.13e+05 |
| Pm-151 | 6.47e-01 | 1.09e-01 | 5.48e-02 | 0.00e+00 | 1.94e-01 | 0.00e+00 | 2.99e+04 |
| Sm-151 | 2.67e+03 | 4.60e+02 | 1.10e+02 | 0.00e+00 | 5.14e+02 | 0.00e+00 | 2.03e+05 |
| Sm-153 | 1.99e+00 | 1.66e+00 | 1.21e-01 | 0.00e+00 | 5.36e-01 | 0.00e+00 | 5.92e+04 |
| Eu-152 | 7.51e+03 | 1.71e+03 | 1.50e+03 | 0.00e+00 | 1.06e+04 | 0.00e+00 | 9.86e+05 |
| Eu-154 | 2.38e+04 | 2.92e+03 | 2.08e+03 | 0.00e+00 | 1.40e+04 | 0.00e+00 | 2.12e+06 |
| Eu-155 | 3.25e+03 | 4.61e+02 | 2.97e+02 | 0.00e+00 | 2.13e+03 | 0.00e+00 | 3.62e+05 |
| Eu-156 | 2.52e+02 | 1.95e+02 | 3.14e+01 | 0.00e+00 | 1.30e+02 | 0.00e+00 | 1.33e+06 |
| Tb-160 | 1.49e+03 | 0.00e+00 | 1.86e+02 | 0.00e+00 | 6.16e+02 | 0.00e+00 | 1.37e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Hc-166m | 1.04e+04 | 3.26e+03 | 2.47e+03 | 0.00e+00 | 4.87e+03 | 0.00e+00 | 9.89e+05 |
| W-181 | 3.39e+04 | 1.11e+04 | 1.18e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.26e+06 |
| W-185 | 1.29e+06 | 4.32e+05 | 4.54e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.99e+07 |
| W-187 | 6.52e+03 | 5.45e+03 | 1.91e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.79e+06 |
| Pb-210 | 7.32e+10 | 2.09e+10 | 2.60e+09 | 0.00e+00 | 5.88e+10 | 0.00e+00 | 1.07e+07 |
| Bi-210 | 3.56e+05 | 2.46e+06 | 2.04e+05 | 0.00e+00 | 2.96e+07 | 0.00e+00 | 3.67e+07 |
| Po-210 | 7.42e+08 | 1.58e+09 | 1.79e+08 | 0.00e+00 | 5.25e+09 | 0.00e+00 | 1.33e+08 |
| Ra-223 | 1.22e+11 | 1.88e+08 | 2.44e+10 | 0.00e+00 | 5.33e+09 | 0.00e+00 | 7.89e+09 |
| Ra-224 | 1.41e+10 | 3.42e+07 | 2.83e+09 | 0.00e+00 | 9.65e+08 | 0.00e+00 | 2.98e+09 |
| Ra-225 | 1.90e+11 | 2.25e+08 | 3.79e+10 | 0.00e+00 | 6.39e+09 | 0.00e+00 | 8.85e+09 |
| Ra-226 | 1.87e+13 | 3.55e+08 | 1.36e+13 | 0.00e+00 | 1.01e+10 | 0.00e+00 | 2.05e+10 |
| Ra-228 | 6.87e+12 | 1.91e+08 | 7.43e+12 | 0.00e+00 | 5.42e+09 | 0.00e+00 | 3.46e+09 |
| Ac-225 | 6.17e+04 | 8.49e+04 | 4.15e+03 | 0.00e+00 | 9.67e+03 | 0.00e+00 | 5.70e+06 |
| Ac-227 | 7.21e+07 | 9.56e+06 | 4.28e+06 | 0.00e+00 | 3.09e+06 | 0.00e+00 | 3.16e+06 |
| Th-227 | 2.80e+05 | 5.06e+03 | 8.06e+03 | 0.00e+00 | 2.88e+04 | 0.00e+00 | 1.10e+07 |
| Th-228 | 1.88e+07 | 3.18e+05 | 6.35e+05 | 0.00e+00 | 1.77e+06 | 0.00e+00 | 2.13e+07 |
| Th-229 | 5.26e+08 | 1.50e+07 | 8.69e+06 | 0.00e+00 | 7.26e+07 | 0.00e+00 | 3.02e+06 |
| Th-230 | 7.96e+07 | 4.52e+06 | 2.20e+06 | 0.00e+00 | 2.18e+07 | 0.00e+00 | 2.33e+06 |
| Th-232 | 8.89e+07 | 3.86e+06 | 5.80e+04 | 0.00e+00 | 1.86e+07 | 0.00e+00 | 1.98e+06 |
| Th-234 | 1.85e+03 | 1.09e+02 | 5.33e+01 | 0.00e+00 | 6.16e+02 | 0.00e+00 | 2.61e+06 |
| Pa-231 | 1.58e+08 | 5.95e+06 | 6.14e+06 | 0.00e+00 | 3.34e+07 | 0.00e+00 | 2.77e+06 |
| Pa-233 | 1.28e+02 | 2.58e+01 | 2.22e+01 | 0.00e+00 | 9.70e+01 | 0.00e+00 | 3.99e+05 |
| U-232 | 1.59e+10 | 0.00e+00 | 1.14e+09 | 0.00e+00 | 1.73e+09 | 0.00e+00 | 2.62e+08 |
| U-233 | 3.37e+09 | 0.00e+00 | 2.04e+08 | 0.00e+00 | 7.84e+08 | 0.00e+00 | 2.42e+08 |
| U-234 | 3.23e+09 | 0.00e+00 | 2.00e+08 | 0.00e+00 | 7.69e+08 | 0.00e+00 | 2.37e+08 |
| U-235 | 3.10e+09 | 0.00e+00 | 1.88e+08 | 0.00e+00 | 7.23e+08 | 0.00e+00 | 3.02e+08 |
| U-236 | 3.10e+09 | 0.00e+00 | 1.92e+08 | 0.00e+00 | 7.38e+08 | 0.00e+00 | 2.23e+08 |
| U-237 | 5.65e+04 | 0.00e+00 | 1.50e+04 | 0.00e+00 | 2.32e+05 | 0.00e+00 | 1.99e+07 |
| U-238 | 2.96e+09 | 0.00e+00 | 1.75e+08 | 0.00e+00 | 6.76e+08 | 0.00e+00 | 2.13e+08 |
| Np-237 | 4.87e+07 | 3.46e+06 | 2.14e+06 | 0.00e+00 | 1.59e+07 | 0.00e+00 | 3.07e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Adult age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 3.62e+01 | 9.75e-01 | 5.63e-01 | 0.00e+00 | 3.30e+00 | 0.00e+00 | 9.06e+04 |
| Np-239 | 3.68e+00 | 3.61e-01 | 1.99e-01 | 0.00e+00 | 1.13e+00 | 0.00e+00 | 7.41e+04 |
| Pu-238 | 9.73e+06 | 1.23e+06 | 2.64e+05 | 0.00e+00 | 1.13e+06 | 0.00e+00 | 1.13e+06 |
| Pu-239 | 1.12e+07 | 1.35e+06 | 2.95e+05 | 0.00e+00 | 1.25e+06 | 0.00e+00 | 1.03e+06 |
| Pu-240 | 1.12e+07 | 1.34e+06 | 2.95e+05 | 0.00e+00 | 1.25e+06 | 0.00e+00 | 1.05e+06 |
| Pu-241 | 2.42e+05 | 1.15e+04 | 5.12e+03 | 0.00e+00 | 2.36e+04 | 0.00e+00 | 2.16e+04 |
| Pu-242 | 1.04e+07 | 1.30e+06 | 2.84e+05 | 0.00e+00 | 1.21e+06 | 0.00e+00 | 1.01e+06 |
| Pu-244 | 1.21e+07 | 1.49e+06 | 3.26e+05 | 0.00e+00 | 1.38e+06 | 0.00e+00 | 1.50e+06 |
| Am-241 | 2.89e+07 | 2.70e+07 | 2.07e+06 | 0.00e+00 | 1.56e+07 | 0.00e+00 | 2.84e+06 |
| Am-242m | 2.94e+07 | 2.56e+07 | 2.10e+06 | 0.00e+00 | 1.56e+07 | 0.00e+00 | 3.61e+06 |
| Am-243 | 2.91e+07 | 2.67e+07 | 2.05e+06 | 0.00e+00 | 1.54e+07 | 0.00e+00 | 3.36e+06 |
| Cm-242 | 7.27e+05 | 7.73e+05 | 4.83e+04 | 0.00e+00 | 2.19e+05 | 0.00e+00 | 2.79e+06 |
| Cm-243 | 2.31e+07 | 2.12e+07 | 1.45e+06 | 0.00e+00 | 6.75e+06 | 0.00e+00 | 3.01e+06 |
| Cm-244 | 1.76e+07 | 1.65e+07 | 1.11e+06 | 0.00e+00 | 5.17e+06 | 0.00e+00 | 2.91e+06 |
| Cm-245 | 3.62e+07 | 3.16e+07 | 2.23e+06 | 0.00e+00 | 1.04e+07 | 0.00e+00 | 2.72e+06 |
| Cm-246 | 3.59e+07 | 3.15e+07 | 2.22e+06 | 0.00e+00 | 1.04e+07 | 0.00e+00 | 2.67e+06 |
| Cm-247 | 3.50e+07 | 3.11e+07 | 2.19e+06 | 0.00e+00 | 1.02e+07 | 0.00e+00 | 3.51e+06 |
| Cm-248 | 2.91e+08 | 2.56e+08 | 1.80e+07 | 0.00e+00 | 8.42e+07 | 0.00e+00 | 5.68e+07 |
| Cf-252 | 9.92e+06 | 0.00e+00 | 2.39e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.09e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 5.66e+02 | 5.66e+02 | 5.66e+02 | 5.66e+02 | 5.66e+02 | 5.66e+02 |
| Be-10 | 4.47e+06 | 6.92e+05 | 1.13e+05 | 0.00e+00 | 5.29e+05 | 0.00e+00 | 2.83e+07 |
| C-14 | 4.86e+08 | 9.72e+07 | 9.72e+07 | 9.72e+07 | 9.72e+07 | 9.72e+07 | 9.72e+07 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 8.30e-03 | 0.00e+00 | 9.10e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.48e-04 |
| Na-22 | 9.18e+09 | 9.18e+09 | 9.18e+09 | 9.18e+09 | 9.18e+09 | 9.18e+09 | 9.18e+09 |
| Na-24 | 4.27e+06 | 4.27e+06 | 4.27e+06 | 4.27e+06 | 4.27e+06 | 4.27e+06 | 4.27e+06 |
| P-32 | 3.15e+10 | 1.95e+09 | 1.22e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.65e+09 |
| Ca-41 | 1.57e+10 | 0.00e+00 | 1.70e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.56e+07 |
| Sc-46 | 3.04e+02 | 5.92e+02 | 1.76e+02 | 0.00e+00 | 5.67e+02 | 0.00e+00 | 2.02e+06 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 4.99e+04 | 2.77e+04 | 1.09e+04 | 7.13e+04 | 8.39e+06 |
| Mn-54 | 0.00e+00 | 1.40e+07 | 2.78e+06 | 0.00e+00 | 4.18e+06 | 0.00e+00 | 2.87e+07 |
| Mn-56 | 0.00e+00 | 7.36e-03 | 1.31e-03 | 0.00e+00 | 9.32e-03 | 0.00e+00 | 4.85e-01 |
| Fe-55 | 4.45e+07 | 3.16e+07 | 7.36e+06 | 0.00e+00 | 0.00e+00 | 2.00e+07 | 1.37e+07 |
| Fe-59 | 5.18e+07 | 1.21e+08 | 4.67e+07 | 0.00e+00 | 0.00e+00 | 3.81e+07 | 2.86e+08 |
| Co-57 | 0.00e+00 | 2.24e+06 | 3.76e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.19e+07 |
| Co-58 | 0.00e+00 | 7.94e+06 | 1.83e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.09e+08 |
| Co-60 | 0.00e+00 | 2.78e+07 | 6.26e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.62e+08 |
| Ni-59 | 8.82e+08 | 3.11e+08 | 1.50e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.88e+07 |
| Ni-63 | 1.18e+10 | 8.35e+08 | 4.01e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.33e+08 |
| Ni-65 | 6.87e-01 | 8.78e-02 | 4.00e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.76e+00 |
| Cu-64 | 0.00e+00 | 4.26e+04 | 2.00e+04 | 0.00e+00 | 1.08e+05 | 0.00e+00 | 3.30e+06 |
| Zn-65 | 2.11e+09 | 7.32e+09 | 3.41e+09 | 0.00e+00 | 4.68e+09 | 0.00e+00 | 3.10e+09 |
| Zn-69 | 4.01e-12 | 7.65e-12 | 5.35e-13 | 0.00e+00 | 5.00e-12 | 0.00e+00 | 1.41e-11 |
| Zn-69m | 3.30e+05 | 7.79e+05 | 7.15e+04 | 0.00e+00 | 4.74e+05 | 0.00e+00 | 4.28e+07 |
| Se-79 | 0.00e+00 | 1.67e+09 | 2.81e+08 | 0.00e+00 | 2.92e+09 | 0.00e+00 | 2.56e+08 |
| Br-82 | 0.00e+00 | 0.00e+00 | 5.61e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 1.82e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 3.09e-23 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 4.73e+09 | 2.22e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.00e+08 |
| Rb-87 | 0.00e+00 | 5.24e+09 | 1.83e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.83e+08 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 2.67e+09 | 0.00e+00 | 7.66e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.19e+08 |
| Sr-90 | 8.13e+10 | 0.00e+00 | 1.63e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.86e+09 |
| Sr-91 | 5.33e+04 | 0.00e+00 | 2.12e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.42e+05 |
| Sr-92 | 9.07e-01 | 0.00e+00 | 3.86e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.31e+01 |
| Y-90 | 1.30e+02 | 0.00e+00 | 3.51e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.07e+06 |
| Y-91 | 1.58e+04 | 0.00e+00 | 4.24e+02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.48e+06 |
| Y-91m | 1.15e-19 | 0.00e+00 | 4.39e-21 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.42e-18 |
| Y-92 | 1.04e-04 | 0.00e+00 | 3.01e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.86e+00 |
| Y-93 | 4.13e-01 | 0.00e+00 | 1.13e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.26e+04 |
| Zr-93 | 2.76e+03 | 1.36e+02 | 7.43e+01 | 0.00e+00 | 4.81e+02 | 0.00e+00 | 1.29e+05 |
| Zr-95 | 1.65e+03 | 5.20e+02 | 3.58e+02 | 0.00e+00 | 7.65e+02 | 0.00e+00 | 1.20e+06 |
| Zr-97 | 7.90e-01 | 1.56e-01 | 7.20e-02 | 0.00e+00 | 2.37e-01 | 0.00e+00 | 4.23e+04 |
| Nb-93m | 8.55e+05 | 2.81e+05 | 7.03e+04 | 0.00e+00 | 3.28e+05 | 0.00e+00 | 1.01e+08 |
| Nb-95 | 1.41e+05 | 7.81e+04 | 4.30e+04 | 0.00e+00 | 7.57e+04 | 0.00e+00 | 3.34e+08 |
| Nb-97 | 1.20e-11 | 2.98e-12 | 1.09e-12 | 0.00e+00 | 3.48e-12 | 0.00e+00 | 7.11e-08 |
| Mo-93 | 0.00e+00 | 7.93e+08 | 2.17e+07 | 0.00e+00 | 2.27e+08 | 0.00e+00 | 9.65e+07 |
| Mo-99 | 0.00e+00 | 4.47e+07 | 8.53e+06 | 0.00e+00 | 1.02e+08 | 0.00e+00 | 8.01e+07 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 4.46e+07 | 6.56e+07 | 1.79e+07 | 0.00e+00 | 8.33e+08 | 6.78e+06 | 1.61e+09 |
| Tc-99m | 5.80e+00 | 1.62e+01 | 2.10e+02 | 0.00e+00 | 2.41e+02 | 8.97e+00 | 1.06e+04 |
| Ru-103 | 1.81e+03 | 0.00e+00 | 7.74e+02 | 0.00e+00 | 6.38e+03 | 0.00e+00 | 1.51e+05 |
| Ru-105 | 1.58e-03 | 0.00e+00 | 6.13e-04 | 0.00e+00 | 1.99e-02 | 0.00e+00 | 1.27e+00 |
| Ru-106 | 3.75e+04 | 0.00e+00 | 4.73e+03 | 0.00e+00 | 7.24e+04 | 0.00e+00 | 1.80e+06 |
| Rh-105 | 6.38e+05 | 4.61e+05 | 3.03e+05 | 0.00e+00 | 1.96e+06 | 0.00e+00 | 5.87e+07 |
| Pd-107 | 0.00e+00 | 2.07e+07 | 1.34e+06 | 0.00e+00 | 1.87e+08 | 0.00e+00 | 9.63e+07 |
| Pd-109 | 0.00e+00 | 8.22e+04 | 1.87e+04 | 0.00e+00 | 4.75e+05 | 0.00e+00 | 8.29e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 9.63e+07 | 9.11e+07 | 5.54e+07 | 0.00e+00 | 1.74e+08 | 0.00e+00 | 2.56e+10 |
| Ag-111 | 1.19e+07 | 4.95e+06 | 2.49e+06 | 0.00e+00 | 1.61e+07 | 0.00e+00 | 6.90e+09 |
| Cd-113m | 0.00e+00 | 5.38e+06 | 1.73e+05 | 0.00e+00 | 5.95e+06 | 0.00e+00 | 3.23e+07 |
| Cd-115m | 0.00e+00 | 2.30e+06 | 7.41e+04 | 0.00e+00 | 1.84e+06 | 0.00e+00 | 7.27e+07 |
| Sn-123 | 9.88e+08 | 1.62e+07 | 2.40e+07 | 1.30e+07 | 0.00e+00 | 0.00e+00 | 1.49e+09 |
| Sn-125 | 1.05e+08 | 2.08e+06 | 4.72e+06 | 1.64e+06 | 0.00e+00 | 0.00e+00 | 9.85e+08 |
| Sn-126 | 2.89e+09 | 5.38e+07 | 8.23e+07 | 1.42e+07 | 0.00e+00 | 0.00e+00 | 6.43e+08 |
| Sb-124 | 4.59e+07 | 8.46e+05 | 1.79e+07 | 1.04e+05 | 0.00e+00 | 4.01e+07 | 9.25e+08 |
| Sb-125 | 3.65e+07 | 3.99e+05 | 8.55e+06 | 3.49e+04 | 0.00e+00 | 3.21e+07 | 2.84e+08 |
| Sb-126 | 1.00e+07 | 2.05e+05 | 3.61e+06 | 5.68e+04 | 0.00e+00 | 7.20e+06 | 5.94e+08 |
| Sb-127 | 8.23e+05 | 1.76e+04 | 3.11e+05 | 9.25e+03 | 0.00e+00 | 5.60e+05 | 1.40e+08 |
| Te-125m | 3.00e+07 | 1.08e+07 | 4.02e+06 | 8.39e+06 | 0.00e+00 | 0.00e+00 | 8.86e+07 |
| Te-127 | 1.22e+03 | 4.31e+02 | 2.61e+02 | 8.38e+02 | 4.92e+03 | 0.00e+00 | 9.38e+04 |
| Te-127m | 8.44e+07 | 2.99e+07 | 1.00e+07 | 2.01e+07 | 3.42e+08 | 0.00e+00 | 2.10e+08 |
| Te-129 | 5.37e-10 | 2.00e-10 | 1.31e-10 | 3.84e-10 | 2.25e-09 | 0.00e+00 | 2.94e-09 |
| Te-129m | 1.10e+08 | 4.09e+07 | 1.74e+07 | 3.55e+07 | 4.61e+08 | 0.00e+00 | 4.13e+08 |
| Te-131 | 7.22e-33 | 2.98e-33 | 2.26e-33 | 5.57e-33 | 3.16e-32 | 0.00e+00 | 5.93e-34 |
| Te-131m | 6.58e+05 | 3.15e+05 | 2.63e+05 | 4.75e+05 | 3.29e+06 | 0.00e+00 | 2.53e+07 |
| Te-132 | 4.29e+06 | 2.72e+06 | 2.56e+06 | 2.87e+06 | 2.61e+07 | 0.00e+00 | 8.61e+07 |
| Te-133m | 3.95e-13 | 2.24e-13 | 2.18e-13 | 3.13e-13 | 2.22e-12 | 0.00e+00 | 9.07e-13 |
| Te-134 | 1.68e-18 | 1.08e-18 | 1.12e-18 | 1.38e-18 | 1.03e-17 | 0.00e+00 | 6.22e-20 |
| I-129 | 1.39e+09 | 1.17e+09 | 1.96e+09 | 1.43e+12 | 2.10e+09 | 0.00e+00 | 1.37e+08 |
| I-130 | 7.41e+05 | 2.14e+06 | 8.56e+05 | 1.75e+08 | 3.30e+06 | 0.00e+00 | 1.65e+06 |
| I-131 | 5.37e+08 | 7.52e+08 | 4.04e+08 | 2.20e+11 | 1.30e+09 | 0.00e+00 | 1.49e+08 |
| I-132 | 2.96e-01 | 7.75e-01 | 2.78e-01 | 2.61e+01 | 1.22e+00 | 0.00e+00 | 3.38e-01 |
| I-133 | 7.08e+06 | 1.20e+07 | 3.66e+06 | 1.68e+09 | 2.11e+07 | 0.00e+00 | 9.09e+06 |
| I-134 | 3.74e-12 | 9.92e-12 | 3.56e-12 | 1.65e-10 | 1.56e-11 | 0.00e+00 | 1.31e-13 |
| I-135 | 2.29e+04 | 5.90e+04 | 2.19e+04 | 3.80e+06 | 9.33e+04 | 0.00e+00 | 6.54e+04 |
| Cs-134 | 9.81e+09 | 2.31e+10 | 1.07e+10 | 0.00e+00 | 7.34e+09 | 2.80e+09 | 2.87e+08 |
| Cs-134m | 3.13e-01 | 6.49e-01 | 3.34e-01 | 0.00e+00 | 3.61e-01 | 6.34e-02 | 4.32e-01 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 3.33e+09 | 3.05e+09 | 7.13e+08 | 0.00e+00 | 1.16e+09 | 4.21e+08 | 5.34e+07 |
| Cs-136 | 4.48e+08 | 1.76e+09 | 1.18e+09 | 0.00e+00 | 9.60e+08 | 1.51e+08 | 1.42e+08 |
| Cs-137 | 1.34e+10 | 1.78e+10 | 6.20e+09 | 0.00e+00 | 6.06e+09 | 2.35e+09 | 2.53e+08 |
| Cs-138 | 1.76e-23 | 3.38e-23 | 1.69e-23 | 0.00e+00 | 2.50e-23 | 2.91e-24 | 1.54e-26 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 8.40e-08 | 5.91e-11 | 2.45e-09 | 0.00e+00 | 5.57e-11 | 4.07e-11 | 7.50e-07 |
| Ba-140 | 4.85e+07 | 5.95e+04 | 3.13e+06 | 0.00e+00 | 2.02e+04 | 4.00e+04 | 7.48e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 8.11e+00 | 3.99e+00 | 1.06e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.29e+05 |
| La-141 | 5.52e-05 | 1.70e-05 | 2.80e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.01e+00 |
| La-142 | 3.43e-11 | 1.53e-11 | 3.80e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.64e-07 |
| Ce-141 | 8.88e+03 | 5.93e+03 | 6.81e+02 | 0.00e+00 | 2.79e+03 | 0.00e+00 | 1.70e+07 |
| Ce-143 | 7.65e+01 | 5.56e+04 | 6.21e+00 | 0.00e+00 | 2.50e+01 | 0.00e+00 | 1.67e+06 |
| Ce-144 | 6.58e+05 | 2.72e+05 | 3.54e+04 | 0.00e+00 | 1.63e+05 | 0.00e+00 | 1.66e+08 |
| Pr-143 | 2.90e+02 | 1.16e+02 | 1.44e+01 | 0.00e+00 | 6.73e+01 | 0.00e+00 | 9.55e+05 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 1.81e+02 | 1.97e+02 | 1.18e+01 | 0.00e+00 | 1.16e+02 | 0.00e+00 | 7.11e+05 |
| Pm-147 | 5.15e+03 | 4.89e+02 | 1.99e+02 | 0.00e+00 | 9.32e+02 | 0.00e+00 | 4.65e+05 |
| Pm-148 | 1.09e+02 | 1.77e+01 | 8.93e+00 | 0.00e+00 | 3.20e+01 | 0.00e+00 | 1.06e+06 |
| Pm-148m | 1.49e+03 | 3.78e+02 | 2.96e+02 | 0.00e+00 | 5.73e+02 | 0.00e+00 | 2.38e+06 |
| Pm-149 | 7.88e+00 | 1.11e+00 | 4.54e-01 | 0.00e+00 | 2.11e+00 | 0.00e+00 | 1.63e+05 |
| Pm-151 | 1.18e+00 | 1.95e-01 | 9.88e-02 | 0.00e+00 | 3.51e-01 | 0.00e+00 | 4.38e+04 |
| Sm-151 | 4.35e+03 | 8.37e+02 | 1.96e+02 | 0.00e+00 | 9.17e+02 | 0.00e+00 | 2.84e+05 |
| Sm-153 | 3.65e+00 | 3.02e+00 | 2.22e-01 | 0.00e+00 | 9.88e-01 | 0.00e+00 | 8.53e+04 |
| Eu-152 | 1.22e+04 | 2.93e+03 | 2.58e+03 | 0.00e+00 | 1.36e+04 | 0.00e+00 | 1.08e+06 |
| Eu-154 | 3.94e+04 | 5.08e+03 | 3.58e+03 | 0.00e+00 | 2.27e+04 | 0.00e+00 | 2.69e+06 |
| Eu-155 | 8.48e+03 | 8.18e+02 | 5.07e+02 | 0.00e+00 | 3.20e+03 | 0.00e+00 | 4.69e+06 |
| Eu-156 | 4.55e+02 | 3.41e+02 | 5.57e+01 | 0.00e+00 | 2.30e+02 | 0.00e+00 | 1.74e+06 |
| Tb-160 | 2.65e+03 | 0.00e+00 | 3.31e+02 | 0.00e+00 | 1.05e+03 | 0.00e+00 | 1.72e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Hc-166m | 1.78e+04 | 5.48e+03 | 3.97e+03 | 0.00e+00 | 8.03e+03 | 0.00e+00 | 1.35e+06 |
| W-181 | 6.27e+04 | 2.02e+04 | 2.12e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.72e+06 |
| W-185 | 2.39e+06 | 7.88e+05 | 8.33e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.81e+07 |
| W-187 | 1.19e+04 | 9.73e+03 | 3.41e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.63e+06 |
| Pb-210 | 1.12e+11 | 3.36e+10 | 4.33e+09 | 0.00e+00 | 1.06e+11 | 0.00e+00 | 1.46e+07 |
| Bi-210 | 6.57e+05 | 4.49e+06 | 3.76e+05 | 0.00e+00 | 5.46e+07 | 0.00e+00 | 5.13e+07 |
| Po-210 | 1.37e+09 | 2.88e+09 | 3.31e+08 | 0.00e+00 | 9.68e+09 | 0.00e+00 | 1.81e+08 |
| Ra-223 | 2.25e+11 | 3.42e+08 | 4.50e+10 | 0.00e+00 | 9.83e+09 | 0.00e+00 | 1.09e+10 |
| Ra-224 | 2.62e+10 | 6.25e+07 | 5.22e+09 | 0.00e+00 | 1.79e+09 | 0.00e+00 | 4.20e+09 |
| Ra-225 | 3.50e+11 | 4.11e+08 | 6.98e+10 | 0.00e+00 | 1.18e+10 | 0.00e+00 | 1.22e+10 |
| Ra-226 | 2.57e+13 | 6.49e+08 | 1.91e+13 | 0.00e+00 | 1.85e+10 | 0.00e+00 | 2.80e+10 |
| Ra-228 | 1.08e+13 | 3.49e+08 | 1.20e+13 | 0.00e+00 | 9.98e+09 | 0.00e+00 | 4.74e+09 |
| Ac-225 | 1.14e+05 | 1.55e+05 | 7.63e+03 | 0.00e+00 | 1.78e+04 | 0.00e+00 | 7.89e+06 |
| Ac-227 | 1.02e+08 | 1.51e+07 | 6.07e+06 | 0.00e+00 | 4.38e+06 | 0.00e+00 | 4.32e+06 |
| Th-227 | 5.16e+05 | 9.27e+03 | 1.49e+04 | 0.00e+00 | 5.29e+04 | 0.00e+00 | 1.51e+07 |
| Th-228 | 3.32e+07 | 5.56e+05 | 1.12e+06 | 0.00e+00 | 3.13e+06 | 0.00e+00 | 2.91e+07 |
| Th-229 | 7.13e+08 | 2.05e+07 | 1.18e+07 | 0.00e+00 | 9.92e+07 | 0.00e+00 | 4.13e+06 |
| Th-230 | 1.08e+08 | 6.13e+06 | 2.99e+06 | 0.00e+00 | 2.99e+07 | 0.00e+00 | 3.18e+06 |
| Th-232 | 1.21e+08 | 5.24e+06 | 8.13e+04 | 0.00e+00 | 2.55e+07 | 0.00e+00 | 2.71e+06 |
| Th-234 | 3.39e+03 | 1.99e+02 | 9.86e+01 | 0.00e+00 | 1.13e+03 | 0.00e+00 | 3.60e+06 |
| Pa-231 | 2.15e+08 | 8.08e+06 | 8.38e+06 | 0.00e+00 | 4.54e+07 | 0.00e+00 | 3.79e+06 |
| Pa-233 | 2.30e+02 | 4.42e+01 | 3.95e+01 | 0.00e+00 | 1.67e+02 | 0.00e+00 | 5.05e+05 |
| U-232 | 2.94e+10 | 0.00e+00 | 2.10e+09 | 0.00e+00 | 3.18e+09 | 0.00e+00 | 3.58e+08 |
| U-233 | 6.18e+09 | 0.00e+00 | 3.76e+08 | 0.00e+00 | 1.45e+09 | 0.00e+00 | 3.32e+08 |
| U-234 | 5.93e+09 | 0.00e+00 | 3.68e+08 | 0.00e+00 | 1.42e+09 | 0.00e+00 | 3.25e+08 |
| U-235 | 5.68e+09 | 0.00e+00 | 3.46e+08 | 0.00e+00 | 1.33e+09 | 0.00e+00 | 4.13e+08 |
| U-236 | 5.68e+09 | 0.00e+00 | 3.54e+08 | 0.00e+00 | 1.36e+09 | 0.00e+00 | 3.05e+08 |
| U-237 | 1.04e+05 | 0.00e+00 | 2.77e+04 | 0.00e+00 | 4.28e+05 | 0.00e+00 | 2.76e+07 |
| U-238 | 5.43e+09 | 0.00e+00 | 3.24e+08 | 0.00e+00 | 1.25e+09 | 0.00e+00 | 2.91e+08 |
| Np-237 | 6.63e+07 | 4.76e+06 | 2.92e+06 | 0.00e+00 | 2.16e+07 | 0.00e+00 | 4.19e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Teen age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 6.65e+01 | 1.78e+00 | 1.04e+00 | 0.00e+00 | 6.10e+00 | 0.00e+00 | 1.31e+05 |
| Np-239 | 7.01e+00 | 6.62e-01 | 3.67e-01 | 0.00e+00 | 2.08e+00 | 0.00e+00 | 1.06e+05 |
| Pu-238 | 1.34e+07 | 1.71e+06 | 3.63e+05 | 0.00e+00 | 1.55e+06 | 0.00e+00 | 1.54e+06 |
| Pu-239 | 1.53e+07 | 1.85e+06 | 4.01e+05 | 0.00e+00 | 1.71e+06 | 0.00e+00 | 1.41e+06 |
| Pu-240 | 1.52e+07 | 1.85e+06 | 4.01e+05 | 0.00e+00 | 1.71e+06 | 0.00e+00 | 1.43e+06 |
| Pu-241 | 3.48e+05 | 1.67e+04 | 7.34e+03 | 0.00e+00 | 3.40e+04 | 0.00e+00 | 2.94e+04 |
| Pu-242 | 1.41e+07 | 1.78e+06 | 3.87e+05 | 0.00e+00 | 1.65e+06 | 0.00e+00 | 1.38e+06 |
| Pu-244 | 1.65e+07 | 2.03e+06 | 4.43e+05 | 0.00e+00 | 1.88e+06 | 0.00e+00 | 2.05e+06 |
| Am-241 | 3.94e+07 | 3.72e+07 | 2.84e+06 | 0.00e+00 | 2.13e+07 | 0.00e+00 | 3.89e+06 |
| Am-242m | 4.02e+07 | 3.54e+07 | 2.89e+06 | 0.00e+00 | 2.14e+07 | 0.00e+00 | 4.93e+06 |
| Am-243 | 3.97e+07 | 3.66e+07 | 2.80e+06 | 0.00e+00 | 2.10e+07 | 0.00e+00 | 4.60e+06 |
| Cm-242 | 1.34e+06 | 1.41e+06 | 8.88e+04 | 0.00e+00 | 4.05e+05 | 0.00e+00 | 3.82e+06 |
| Cm-243 | 3.24e+07 | 3.00e+07 | 2.04e+06 | 0.00e+00 | 9.51e+06 | 0.00e+00 | 4.12e+06 |
| Cm-244 | 2.51e+07 | 2.37e+07 | 1.59e+06 | 0.00e+00 | 7.41e+06 | 0.00e+00 | 3.98e+06 |
| Cm-245 | 4.94e+07 | 4.34e+07 | 3.04e+06 | 0.00e+00 | 1.42e+07 | 0.00e+00 | 3.72e+06 |
| Cm-246 | 4.90e+07 | 4.34e+07 | 3.04e+06 | 0.00e+00 | 1.42e+07 | 0.00e+00 | 3.65e+06 |
| Cm-247 | 4.77e+07 | 4.27e+07 | 2.99e+06 | 0.00e+00 | 1.40e+07 | 0.00e+00 | 4.80e+06 |
| Cm-248 | 3.96e+08 | 3.52e+08 | 2.47e+07 | 0.00e+00 | 1.15e+08 | 0.00e+00 | 7.73e+07 |
| Cf-252 | 1.70e+07 | 0.00e+00 | 4.10e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.50e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

P_i factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for P_i

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 8.97e+02 | 8.97e+02 | 8.97e+02 | 8.97e+02 | 8.97e+02 | 8.97e+02 |
| Be-10 | 1.11e+07 | 1.29e+06 | 2.79e+05 | 0.00e+00 | 9.13e+05 | 0.00e+00 | 2.26e+07 |
| C-14 | 1.19e+09 | 2.39e+08 | 2.39e+08 | 2.39e+08 | 2.39e+08 | 2.39e+08 | 2.39e+08 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 1.97e-02 | 0.00e+00 | 1.96e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.34e-03 |
| Na-22 | 1.90e+10 | 1.90e+10 | 1.90e+10 | 1.90e+10 | 1.90e+10 | 1.90e+10 | 1.90e+10 |
| Na-24 | 8.88e+06 | 8.88e+06 | 8.88e+06 | 8.88e+06 | 8.88e+06 | 8.88e+06 | 8.88e+06 |
| P-32 | 7.78e+10 | 3.64e+09 | 3.00e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.15e+09 |
| Ca-41 | 2.28e+10 | 0.00e+00 | 2.49e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.25e+07 |
| Sc-46 | 6.83e+02 | 9.36e+02 | 3.61e+02 | 0.00e+00 | 8.29e+02 | 0.00e+00 | 1.37e+06 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.02e+05 | 5.65e+04 | 1.54e+04 | 1.03e+05 | 5.40e+06 |
| Mn-54 | 0.00e+00 | 2.10e+07 | 5.59e+06 | 0.00e+00 | 5.88e+06 | 0.00e+00 | 1.76e+07 |
| Mn-56 | 0.00e+00 | 1.28e-02 | 2.90e-03 | 0.00e+00 | 1.55e-02 | 0.00e+00 | 1.86e+00 |
| Fe-55 | 1.12e+08 | 5.93e+07 | 1.84e+07 | 0.00e+00 | 0.00e+00 | 3.35e+07 | 1.10e+07 |
| Fe-59 | 1.20e+08 | 1.95e+08 | 9.69e+07 | 0.00e+00 | 0.00e+00 | 5.64e+07 | 2.03e+08 |
| Cc-57 | 0.00e+00 | 3.84e+06 | 7.77e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.14e+07 |
| Cc-58 | 0.00e+00 | 1.21e+07 | 3.71e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.07e+07 |
| Cc-60 | 0.00e+00 | 4.32e+07 | 1.27e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.39e+08 |
| Ni-59 | 2.22e+09 | 5.90e+08 | 3.76e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.91e+07 |
| Ni-63 | 2.96e+10 | 1.59e+09 | 1.01e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.07e+08 |
| Ni-65 | 1.68e+00 | 1.58e-01 | 9.24e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.94e+01 |
| Cu-64 | 0.00e+00 | 7.49e+04 | 4.52e+04 | 0.00e+00 | 1.81e+05 | 0.00e+00 | 3.51e+06 |
| Zn-65 | 4.13e+09 | 1.10e+10 | 6.85e+09 | 0.00e+00 | 6.94e+09 | 0.00e+00 | 1.93e+09 |
| Zn-69 | 9.87e-12 | 1.43e-11 | 1.32e-12 | 0.00e+00 | 8.65e-12 | 0.00e+00 | 8.99e-10 |
| Zn-69m | 8.06e+05 | 1.37e+06 | 1.62e+05 | 0.00e+00 | 7.98e+05 | 0.00e+00 | 4.47e+07 |
| Se-79 | 0.00e+00 | 3.12e+09 | 6.92e+08 | 0.00e+00 | 5.07e+09 | 0.00e+00 | 2.05e+08 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.15e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 4.47e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 7.00e-23 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 8.77e+09 | 5.39e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.64e+08 |
| Rb-87 | 0.00e+00 | 9.75e+09 | 4.52e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.46e+08 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 6.62e+09 | 0.00e+00 | 1.89e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.56e+08 |
| Sr-90 | 1.68e+11 | 0.00e+00 | 3.38e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.50e+09 |
| Sr-91 | 1.31e+05 | 0.00e+00 | 4.94e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.89e+05 |
| Sr-92 | 2.21e+00 | 0.00e+00 | 8.88e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.19e+01 |
| Y-90 | 3.22e+02 | 0.00e+00 | 8.63e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.18e+05 |
| Y-91 | 3.90e+04 | 0.00e+00 | 1.04e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.20e+06 |
| Y-91m | 2.80e-19 | 0.00e+00 | 1.02e-20 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.49e-16 |
| Y-92 | 2.56e-04 | 0.00e+00 | 7.32e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.39e+00 |
| Y-93 | 1.02e+00 | 0.00e+00 | 2.79e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.51e+04 |
| Zr-93 | 6.87e+03 | 2.57e+02 | 1.83e+02 | 0.00e+00 | 9.95e+02 | 0.00e+00 | 9.75e+04 |
| Zr-95 | 3.83e+03 | 8.42e+02 | 7.50e+02 | 0.00e+00 | 1.21e+03 | 0.00e+00 | 8.79e+05 |
| Zr-97 | 1.92e+00 | 2.78e-01 | 1.64e-01 | 0.00e+00 | 3.99e-01 | 0.00e+00 | 4.21e+04 |
| Nb-93m | 2.15e+06 | 5.37e+05 | 1.77e+05 | 0.00e+00 | 5.80e+05 | 0.00e+00 | 8.10e+07 |
| Nb-95 | 3.18e+05 | 1.24e+05 | 8.84e+04 | 0.00e+00 | 1.16e+05 | 0.00e+00 | 2.29e+08 |
| Nb-97 | 2.91e-11 | 5.26e-12 | 2.46e-12 | 0.00e+00 | 5.84e-12 | 0.00e+00 | 1.62e-06 |
| Mo-93 | 0.00e+00 | 1.49e+09 | 5.34e+07 | 0.00e+00 | 3.92e+08 | 0.00e+00 | 7.53e+07 |
| Mo-99 | 0.00e+00 | 8.14e+07 | 2.01e+07 | 0.00e+00 | 1.74e+08 | 0.00e+00 | 6.73e+07 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 1.10e+08 | 1.23e+08 | 4.40e+07 | 0.00e+00 | 1.44e+09 | 1.08e+07 | 1.29e+09 |
| Tc-99m | 1.33e+01 | 2.61e+01 | 4.32e+02 | 0.00e+00 | 3.79e+02 | 1.32e+01 | 1.48e+04 |
| Ru-103 | 4.28e+03 | 0.00e+00 | 1.65e+03 | 0.00e+00 | 1.08e+04 | 0.00e+00 | 1.11e+05 |
| Ru-105 | 3.85e-03 | 0.00e+00 | 1.40e-03 | 0.00e+00 | 3.39e-02 | 0.00e+00 | 2.51e+00 |
| Ru-106 | 9.24e+04 | 0.00e+00 | 1.15e+04 | 0.00e+00 | 1.25e+05 | 0.00e+00 | 1.44e+06 |
| Rh-105 | 1.56e+06 | 8.40e+05 | 7.18e+05 | 0.00e+00 | 3.35e+06 | 0.00e+00 | 5.21e+07 |
| Pd-107 | 0.00e+00 | 3.88e+07 | 3.30e+06 | 0.00e+00 | 3.25e+08 | 0.00e+00 | 7.71e+07 |
| Pd-109 | 0.00e+00 | 1.53e+05 | 4.59e+04 | 0.00e+00 | 8.22e+05 | 0.00e+00 | 9.05e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ac-110m | 2.09e+08 | 1.41e+08 | 1.13e+08 | 0.00e+00 | 2.63e+08 | 0.00e+00 | 1.68e+10 |
| Ac-111 | 2.94e+07 | 9.20e+06 | 6.07e+06 | 0.00e+00 | 2.78e+07 | 0.00e+00 | 5.63e+09 |
| Cd-113m | 0.00e+00 | 1.00e+07 | 4.27e+05 | 0.00e+00 | 1.03e+07 | 0.00e+00 | 2.59e+07 |
| Cd-115m | 0.00e+00 | 4.29e+06 | 1.83e+05 | 0.00e+00 | 3.19e+06 | 0.00e+00 | 5.83e+07 |
| Sr-123 | 2.44e+09 | 3.03e+07 | 5.95e+07 | 3.21e+07 | 0.00e+00 | 0.00e+00 | 1.20e+09 |
| Sr-125 | 2.57e+08 | 3.88e+06 | 1.15e+07 | 4.03e+06 | 0.00e+00 | 0.00e+00 | 7.98e+08 |
| Sr-126 | 6.85e+09 | 8.54e+07 | 1.95e+08 | 2.34e+07 | 0.00e+00 | 0.00e+00 | 5.14e+08 |
| Sb-124 | 1.09e+08 | 1.41e+06 | 3.81e+07 | 2.40e+05 | 0.00e+00 | 6.03e+07 | 6.79e+08 |
| Sb-125 | 8.70e+07 | 6.71e+05 | 1.82e+07 | 8.06e+04 | 0.00e+00 | 4.85e+07 | 2.08e+08 |
| Sb-126 | 2.29e+07 | 3.51e+05 | 8.23e+06 | 1.34e+05 | 0.00e+00 | 1.09e+07 | 4.62e+08 |
| Sb-127 | 1.98e+06 | 3.07e+04 | 6.88e+05 | 2.21e+04 | 0.00e+00 | 8.60e+05 | 1.12e+08 |
| Te-125m | 7.38e+07 | 2.00e+07 | 9.84e+06 | 2.07e+07 | 0.00e+00 | 0.00e+00 | 7.12e+07 |
| Te-127 | 2.99e+03 | 8.06e+02 | 6.41e+02 | 2.07e+03 | 8.50e+03 | 0.00e+00 | 1.17e+05 |
| Te-127m | 2.08e+08 | 5.60e+07 | 2.47e+07 | 4.97e+07 | 5.93e+08 | 0.00e+00 | 1.68e+08 |
| Te-129 | 1.33e-09 | 3.70e-10 | 3.15e-10 | 9.46e-10 | 3.88e-09 | 0.00e+00 | 8.25e-08 |
| Te-129m | 2.71e+08 | 7.58e+07 | 4.21e+07 | 8.75e+07 | 7.97e+08 | 0.00e+00 | 3.31e+08 |
| Te-131 | 1.77e-32 | 5.40e-33 | 5.27e-33 | 1.36e-32 | 5.36e-32 | 0.00e+00 | 9.31e-32 |
| Te-131m | 1.60e+06 | 5.54e+05 | 5.89e+05 | 1.14e+06 | 5.36e+06 | 0.00e+00 | 2.25e+07 |
| Te-132 | 1.03e+07 | 4.54e+06 | 5.48e+06 | 6.61e+06 | 4.21e+07 | 0.00e+00 | 4.57e+07 |
| Te-133m | 9.46e-13 | 3.82e-13 | 4.74e-13 | 7.33e-13 | 3.63e-12 | 0.00e+00 | 2.92e-11 |
| Te-134 | 3.99e-18 | 1.79e-18 | 2.39e-18 | 3.15e-18 | 1.66e-17 | 0.00e+00 | 1.82e-17 |
| I-129 | 3.43e+09 | 2.11e+09 | 1.88e+09 | 1.38e+12 | 3.55e+09 | 0.00e+00 | 1.06e+08 |
| I-130 | 1.73e+06 | 3.50e+06 | 1.80e+06 | 3.86e+08 | 5.23e+06 | 0.00e+00 | 1.64e+06 |
| I-131 | 1.30e+09 | 1.31e+09 | 7.45e+08 | 4.33e+11 | 2.15e+09 | 0.00e+00 | 1.17e+08 |
| I-132 | 7.01e-01 | 1.29e+00 | 5.92e-01 | 5.97e+01 | 1.97e+00 | 0.00e+00 | 1.52e+00 |
| I-133 | 1.72e+07 | 2.13e+07 | 8.05e+06 | 3.95e+09 | 3.55e+07 | 0.00e+00 | 8.57e+06 |
| I-134 | 8.87e-12 | 1.65e-11 | 7.57e-12 | 3.79e-10 | 2.52e-11 | 0.00e+00 | 1.09e-11 |
| I-135 | 5.43e+04 | 9.77e+04 | 4.62e+04 | 8.66e+06 | 1.50e+05 | 0.00e+00 | 7.45e+04 |
| Cs-134 | 2.26e+10 | 3.71e+10 | 7.84e+09 | 0.00e+00 | 1.15e+10 | 4.13e+09 | 2.00e+09 |
| Cs-134m | 7.42e-01 | 1.10e+00 | 7.18e-01 | 0.00e+00 | 5.80e-01 | 9.59e-02 | 1.39e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 8.19e+09 | 5.71e+09 | 5.85e+08 | 0.00e+00 | 2.01e+09 | 6.72e+08 | 4.27e+07 |
| Cs-136 | 1.01e+09 | 2.78e+09 | 1.80e+09 | 0.00e+00 | 1.48e+09 | 2.21e+08 | 9.77e+07 |
| Cs-137 | 3.22e+10 | 3.09e+10 | 4.55e+09 | 0.00e+00 | 1.01e+10 | 3.62e+09 | 1.93e+08 |
| Cs-138 | 4.27e-23 | 5.94e-23 | 3.77e-23 | 0.00e+00 | 4.18e-23 | 4.50e-24 | 2.74e-23 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 2.06e-07 | 1.10e-10 | 5.98e-09 | 0.00e+00 | 9.62e-11 | 6.48e-11 | 1.19e-05 |
| Ba-140 | 1.17e+08 | 1.03e+05 | 6.84e+06 | 0.00e+00 | 3.34e+04 | 6.12e+04 | 5.93e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 1.94e+01 | 6.79e+00 | 2.29e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.89e+05 |
| La-141 | 1.36e-04 | 3.17e-05 | 6.89e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.06e+00 |
| La-142 | 8.30e-11 | 2.64e-11 | 8.28e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.24e-06 |
| Ce-141 | 2.19e+04 | 1.09e+04 | 1.62e+03 | 0.00e+00 | 4.78e+03 | 0.00e+00 | 1.36e+07 |
| Ce-143 | 1.88e+02 | 1.02e+05 | 1.47e+01 | 0.00e+00 | 4.27e+01 | 0.00e+00 | 1.49e+06 |
| Ce-144 | 1.62e+06 | 5.09e+05 | 8.66e+04 | 0.00e+00 | 2.82e+05 | 0.00e+00 | 1.33e+08 |
| Pr-143 | 7.18e+02 | 2.16e+02 | 3.56e+01 | 0.00e+00 | 1.17e+02 | 0.00e+00 | 7.75e+05 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 4.45e+02 | 3.60e+02 | 2.79e+01 | 0.00e+00 | 1.98e+02 | 0.00e+00 | 5.71e+05 |
| Pm-147 | 1.29e+04 | 9.19e+02 | 4.94e+02 | 0.00e+00 | 1.62e+03 | 0.00e+00 | 3.72e+05 |
| Pm-148 | 2.66e+02 | 3.20e+01 | 2.07e+01 | 0.00e+00 | 5.44e+01 | 0.00e+00 | 8.54e+05 |
| Pm-148m | 3.06e+03 | 6.09e+02 | 6.09e+02 | 0.00e+00 | 9.03e+02 | 0.00e+00 | 1.72e+06 |
| Pm-149 | 1.94e+01 | 2.07e+00 | 1.12e+00 | 0.00e+00 | 3.65e+00 | 0.00e+00 | 1.41e+05 |
| Pm-151 | 2.88e+00 | 3.51e-01 | 2.28e-01 | 0.00e+00 | 5.95e-01 | 0.00e+00 | 3.98e+04 |
| Sm-151 | 1.05e+04 | 1.57e+03 | 4.93e+02 | 0.00e+00 | 1.62e+03 | 0.00e+00 | 2.27e+05 |
| Sm-153 | 9.02e+00 | 5.61e+00 | 5.41e-01 | 0.00e+00 | 1.71e+00 | 0.00e+00 | 7.46e+04 |
| Eu-152 | 2.52e+04 | 4.59e+03 | 5.45e+03 | 0.00e+00 | 1.94e+04 | 0.00e+00 | 7.54e+05 |
| Eu-154 | 9.46e+04 | 8.51e+03 | 7.77e+03 | 0.00e+00 | 3.74e+04 | 0.00e+00 | 1.98e+06 |
| Eu-155 | 1.94e+04 | 1.39e+03 | 1.09e+03 | 0.00e+00 | 5.22e+03 | 0.00e+00 | 3.49e+06 |
| Eu-156 | 1.10e+03 | 5.88e+02 | 1.22e+02 | 0.00e+00 | 3.79e+02 | 0.00e+00 | 1.33e+06 |
| Tb-160 | 5.61e+03 | 0.00e+00 | 6.96e+02 | 0.00e+00 | 1.67e+03 | 0.00e+00 | 1.24e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Hc-166m | 4.44e+04 | 9.30e+03 | 7.86e+03 | 0.00e+00 | 1.32e+04 | 0.00e+00 | 1.08e+06 |
| W-181 | 1.54e+05 | 3.79e+04 | 5.21e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.38e+06 |
| W-185 | 5.89e+06 | 1.47e+06 | 2.06e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.48e+07 |
| W-187 | 2.89e+04 | 1.71e+04 | 7.69e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.41e+06 |
| Pb-210 | 2.42e+11 | 6.21e+10 | 1.06e+10 | 0.00e+00 | 1.87e+11 | 0.00e+00 | 1.17e+07 |
| Bi-210 | 1.62e+06 | 8.38e+06 | 9.29e+05 | 0.00e+00 | 9.45e+07 | 0.00e+00 | 4.25e+07 |
| Po-210 | 3.37e+09 | 5.39e+09 | 8.14e+08 | 0.00e+00 | 1.68e+10 | 0.00e+00 | 1.45e+08 |
| Ra-223 | 5.55e+11 | 6.41e+08 | 1.11e+11 | 0.00e+00 | 1.70e+10 | 0.00e+00 | 8.84e+09 |
| Ra-224 | 6.43e+10 | 1.17e+08 | 1.29e+10 | 0.00e+00 | 3.09e+09 | 0.00e+00 | 3.53e+09 |
| Ra-225 | 8.62e+11 | 7.70e+08 | 1.72e+11 | 0.00e+00 | 2.04e+10 | 0.00e+00 | 9.89e+09 |
| Ra-226 | 3.78e+13 | 1.21e+09 | 3.11e+13 | 0.00e+00 | 3.21e+10 | 0.00e+00 | 2.24e+10 |
| Ra-228 | 2.52e+13 | 6.53e+08 | 2.82e+13 | 0.00e+00 | 1.73e+10 | 0.00e+00 | 3.80e+09 |
| Ac-225 | 2.81e+05 | 2.89e+05 | 1.88e+04 | 0.00e+00 | 3.09e+04 | 0.00e+00 | 6.43e+06 |
| Ac-227 | 1.69e+08 | 2.72e+07 | 1.05e+07 | 0.00e+00 | 5.99e+06 | 0.00e+00 | 3.46e+06 |
| Th-227 | 1.27e+06 | 1.73e+04 | 3.67e+04 | 0.00e+00 | 9.17e+04 | 0.00e+00 | 1.22e+07 |
| Th-228 | 8.33e+07 | 1.07e+06 | 2.82e+06 | 0.00e+00 | 5.55e+06 | 0.00e+00 | 2.33e+07 |
| Th-229 | 9.67e+08 | 2.43e+07 | 1.61e+07 | 0.00e+00 | 1.19e+08 | 0.00e+00 | 3.31e+06 |
| Th-230 | 1.46e+08 | 7.32e+06 | 4.08e+06 | 0.00e+00 | 3.57e+07 | 0.00e+00 | 2.55e+06 |
| Th-232 | 1.63e+08 | 6.25e+06 | 1.24e+05 | 0.00e+00 | 3.05e+07 | 0.00e+00 | 2.17e+06 |
| Th-234 | 8.40e+03 | 3.71e+02 | 2.43e+02 | 0.00e+00 | 1.97e+03 | 0.00e+00 | 2.90e+06 |
| Pa-231 | 2.91e+08 | 9.63e+06 | 1.16e+07 | 0.00e+00 | 5.27e+07 | 0.00e+00 | 3.03e+06 |
| Pr-233 | 4.68e+02 | 7.30e+01 | 8.18e+01 | 0.00e+00 | 2.69e+02 | 0.00e+00 | 3.73e+05 |
| U-232 | 7.24e+10 | 0.00e+00 | 5.18e+09 | 0.00e+00 | 5.51e+09 | 0.00e+00 | 2.87e+08 |
| U-233 | 1.53e+10 | 0.00e+00 | 9.26e+08 | 0.00e+00 | 2.51e+09 | 0.00e+00 | 2.65e+08 |
| U-234 | 1.47e+10 | 0.00e+00 | 9.09e+08 | 0.00e+00 | 2.46e+09 | 0.00e+00 | 2.60e+08 |
| U-235 | 1.41e+10 | 0.00e+00 | 8.51e+08 | 0.00e+00 | 2.31e+09 | 0.00e+00 | 3.30e+08 |
| U-236 | 1.41e+10 | 0.00e+00 | 8.72e+08 | 0.00e+00 | 2.36e+09 | 0.00e+00 | 2.44e+08 |
| U-237 | 2.57e+05 | 0.00e+00 | 6.83e+04 | 0.00e+00 | 7.42e+05 | 0.00e+00 | 2.27e+07 |
| U-238 | 1.35e+10 | 0.00e+00 | 7.98e+08 | 0.00e+00 | 2.16e+09 | 0.00e+00 | 2.33e+08 |
| Np-237 | 9.17e+07 | 6.05e+06 | 4.03e+06 | 0.00e+00 | 2.49e+07 | 0.00e+00 | 3.36e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Child age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.64e+02 | 3.32e+00 | 2.55e+00 | 0.00e+00 | 1.06e+01 | 0.00e+00 | 1.14e+05 |
| Np-239 | 1.73e+01 | 1.24e+00 | 8.71e-01 | 0.00e+00 | 3.58e+00 | 0.00e+00 | 9.17e+04 |
| Pu-238 | 1.96e+07 | 2.27e+06 | 5.20e+05 | 0.00e+00 | 1.89e+06 | 0.00e+00 | 1.23e+06 |
| Pu-239 | 2.12e+07 | 2.27e+06 | 5.45e+05 | 0.00e+00 | 2.01e+06 | 0.00e+00 | 1.13e+06 |
| Pu-240 | 2.11e+07 | 2.35e+06 | 5.45e+05 | 0.00e+00 | 2.01e+06 | 0.00e+00 | 1.15e+06 |
| Pu-241 | 6.35e+05 | 2.59e+04 | 1.32e+04 | 0.00e+00 | 4.86e+04 | 0.00e+00 | 2.36e+04 |
| Pu-242 | 1.96e+07 | 2.27e+06 | 5.25e+05 | 0.00e+00 | 1.93e+06 | 0.00e+00 | 1.10e+06 |
| Pu-244 | 2.29e+07 | 2.60e+07 | 6.01e+05 | 0.00e+00 | 2.22e+06 | 0.00e+00 | 1.65e+06 |
| Am-241 | 5.54e+07 | 4.77e+07 | 4.16e+06 | 0.00e+00 | 2.54e+07 | 0.00e+00 | 3.11e+06 |
| Am-242m | 5.76e+07 | 4.61e+07 | 4.28e+06 | 0.00e+00 | 2.59e+07 | 0.00e+00 | 3.95e+06 |
| Am-243 | 5.51e+07 | 4.65e+07 | 4.04e+06 | 0.00e+00 | 2.49e+07 | 0.00e+00 | 3.68e+06 |
| Cm-242 | 3.30e+06 | 2.63e+06 | 2.19e+05 | 0.00e+00 | 7.02e+05 | 0.00e+00 | 3.06e+06 |
| Cm-243 | 5.26e+07 | 4.27e+07 | 3.38e+06 | 0.00e+00 | 1.27e+07 | 0.00e+00 | 3.30e+06 |
| Cm-244 | 4.43e+07 | 3.59e+07 | 2.84e+06 | 0.00e+00 | 1.04e+07 | 0.00e+00 | 3.19e+06 |
| Cm-245 | 6.87e+07 | 5.51e+07 | 4.32e+06 | 0.00e+00 | 1.69e+07 | 0.00e+00 | 2.98e+06 |
| Cm-246 | 6.79e+07 | 5.51e+07 | 4.32e+06 | 0.00e+00 | 1.69e+07 | 0.00e+00 | 2.92e+06 |
| Cm-247 | 6.62e+07 | 5.43e+07 | 4.24e+06 | 0.00e+00 | 1.66e+07 | 0.00e+00 | 3.85e+06 |
| Cm-248 | 5.51e+08 | 4.48e+08 | 3.50e+07 | 0.00e+00 | 1.37e+08 | 0.00e+00 | 6.21e+07 |
| Cf-252 | 4.25e+07 | 0.00e+00 | 1.03e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.20e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 1.36e+03 | 1.36e+03 | 1.36e+03 | 1.36e+03 | 1.36e+03 | 1.36e+03 |
| Be-10 | 1.41e+07 | 2.05e+06 | 4.25e+05 | 0.00e+00 | 1.35e+06 | 0.00e+00 | 2.29e+07 |
| C-14 | 2.34e+09 | 5.00e+08 | 5.00e+08 | 5.00e+08 | 5.00e+08 | 5.00e+08 | 5.00e+08 |
| N-13 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| F-18 | 4.12e-02 | 0.00e+00 | 3.51e-03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.67e-03 |
| Na-22 | 3.18e+10 | 3.18e+10 | 3.18e+10 | 3.18e+10 | 3.18e+10 | 3.18e+10 | 3.18e+10 |
| Na-24 | 1.55e+07 | 1.55e+07 | 1.55e+07 | 1.55e+07 | 1.55e+07 | 1.55e+07 | 1.55e+07 |
| P-32 | 1.60e+11 | 9.43e+09 | 6.21e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.17e+09 |
| Ca-41 | 2.46e+10 | 0.00e+00 | 2.69e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.26e+07 |
| Sc-46 | 1.30e+03 | 1.88e+03 | 5.86e+02 | 0.00e+00 | 1.23e+03 | 0.00e+00 | 1.22e+06 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.61e+05 | 1.05e+05 | 2.30e+04 | 2.05e+05 | 4.70e+06 |
| Mn-54 | 0.00e+00 | 3.90e+07 | 8.84e+06 | 0.00e+00 | 8.64e+06 | 0.00e+00 | 1.43e+07 |
| Mn-56 | 0.00e+00 | 3.14e-02 | 5.42e-03 | 0.00e+00 | 2.70e-02 | 0.00e+00 | 2.86e+00 |
| Fe-55 | 1.35e+08 | 8.73e+07 | 2.33e+07 | 0.00e+00 | 0.00e+00 | 4.27e+07 | 1.11e+07 |
| Fe-59 | 2.24e+08 | 3.92e+08 | 1.54e+08 | 0.00e+00 | 0.00e+00 | 1.16e+08 | 1.87e+08 |
| Cc-57 | 0.00e+00 | 8.95e+06 | 1.46e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.05e+07 |
| Cc-58 | 0.00e+00 | 2.42e+07 | 6.05e+07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.04e+07 |
| Cc-60 | 0.00e+00 | 8.81e+07 | 2.08e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.10e+08 |
| Ni-59 | 2.61e+09 | 7.99e+08 | 4.50e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.95e+07 |
| Ni-63 | 3.49e+10 | 2.16e+09 | 1.21e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.07e+08 |
| Ni-65 | 3.56e+00 | 4.03e-01 | 1.83e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.07e+01 |
| Cu-64 | 0.00e+00 | 1.86e+05 | 8.62e+04 | 0.00e+00 | 3.15e+05 | 0.00e+00 | 3.82e+06 |
| Zn-65 | 5.55e+09 | 1.90e+10 | 8.78e+09 | 0.00e+00 | 9.23e+09 | 0.00e+00 | 1.61e+10 |
| Zn-69 | 2.10e-11 | 3.79e-11 | 2.82e-12 | 0.00e+00 | 1.57e-11 | 0.00e+00 | 3.09e-09 |
| Zn-69m | 1.70e+06 | 3.48e+06 | 3.17e+05 | 0.00e+00 | 1.41e+06 | 0.00e+00 | 4.82e+07 |
| Se-79 | 0.00e+00 | 7.77e+09 | 1.44e+09 | 0.00e+00 | 9.00e+09 | 0.00e+00 | 2.07e+08 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.93e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 9.49e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 1.35e-22 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.23e+10 | 1.10e+10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.69e+08 |
| Rb-87 | 0.00e+00 | 2.19e+10 | 8.69e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.48e+08 |
| Rb-88 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Rb-89 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Sr-89 | 1.26e+10 | 0.00e+00 | 3.61e+08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.59e+08 |
| Sr-90 | 1.86e+11 | 0.00e+00 | 3.77e+09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.52e+09 |
| Sr-91 | 2.73e+05 | 0.00e+00 | 9.87e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.23e+05 |
| Sr-92 | 4.71e+00 | 0.00e+00 | 1.75e-01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.08e+01 |
| Y-90 | 6.82e+02 | 0.00e+00 | 1.83e+01 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.41e+05 |
| Y-91 | 7.33e+04 | 0.00e+00 | 1.95e+03 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.25e+06 |
| Y-91m | 5.94e-19 | 0.00e+00 | 2.03e-20 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.98e-15 |
| Y-92 | 5.44e-04 | 0.00e+00 | 1.53e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.04e+01 |
| Y-93 | 2.16e+00 | 0.00e+00 | 5.90e-02 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.71e+04 |
| Zr-93 | 7.94e+03 | 3.78e+02 | 2.28e+02 | 0.00e+00 | 1.11e+03 | 0.00e+00 | 9.83e+04 |
| Zr-95 | 6.80e+03 | 1.66e+03 | 1.18e+03 | 0.00e+00 | 1.79e+03 | 0.00e+00 | 8.26e+05 |
| Zr-97 | 4.07e+00 | 6.99e-01 | 3.19e-01 | 0.00e+00 | 7.04e-01 | 0.00e+00 | 4.46e+04 |
| Nb-93m | 2.52e+06 | 6.83e+05 | 2.13e+05 | 0.00e+00 | 6.66e+05 | 0.00e+00 | 8.16e+07 |
| Nb-95 | 5.93e+05 | 2.44e+05 | 1.41e+05 | 0.00e+00 | 1.75e+05 | 0.00e+00 | 2.06e+08 |
| Nb-97 | 6.16e-11 | 1.31e-11 | 4.74e-12 | 0.00e+00 | 1.03e-11 | 0.00e+00 | 4.15e-06 |
| Mo-93 | 0.00e+00 | 3.49e+09 | 1.12e+08 | 0.00e+00 | 6.97e+08 | 0.00e+00 | 7.47e+07 |
| Mo-99 | 0.00e+00 | 2.08e+08 | 4.06e+07 | 0.00e+00 | 3.11e+08 | 0.00e+00 | 6.86e+07 |
| Tc-101 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Tc-99 | 2.22e+08 | 3.00e+08 | 9.36e+07 | 0.00e+00 | 2.53e+09 | 2.92e+07 | 1.30e+09 |
| Tc-99m | 2.77e+01 | 5.70e+01 | 7.35e+02 | 0.00e+00 | 6.14e+02 | 2.98e+01 | 1.66e+04 |
| Ru-103 | 8.67e+03 | 0.00e+00 | 2.90e+03 | 0.00e+00 | 1.80e+04 | 0.00e+00 | 1.05e+05 |
| Ru-105 | 8.12e-03 | 0.00e+00 | 2.74e-03 | 0.00e+00 | 5.97e-02 | 0.00e+00 | 3.23e+00 |
| Ru-106 | 1.90e+05 | 0.00e+00 | 2.38e+04 | 0.00e+00 | 2.25e+05 | 0.00e+00 | 1.44e+06 |
| Rh-105 | 3.32e+06 | 2.17e+06 | 1.46e+06 | 0.00e+00 | 6.03e+06 | 0.00e+00 | 5.39e+07 |
| Pd-107 | 0.00e+00 | 9.79e+07 | 6.95e+06 | 0.00e+00 | 5.59e+08 | 0.00e+00 | 7.78e+07 |
| Pd-109 | 0.00e+00 | 4.05e+05 | 9.78e+04 | 0.00e+00 | 1.49e+06 | 0.00e+00 | 9.95e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 3.86e+08 | 2.82e+08 | 1.86e+08 | 0.00e+00 | 4.03e+08 | 0.00e+00 | 1.46e+10 |
| Ag-111 | 6.17e+07 | 2.40e+07 | 1.27e+07 | 0.00e+00 | 5.01e+07 | 0.00e+00 | 5.72e+09 |
| Cd-113m | 0.00e+00 | 1.74e+07 | 6.42e+05 | 0.00e+00 | 1.32e+07 | 0.00e+00 | 2.62e+07 |
| Cd-115m | 0.00e+00 | 1.03e+07 | 3.59e+05 | 0.00e+00 | 5.40e+06 | 0.00e+00 | 5.89e+07 |
| Sn-123 | 4.57e+09 | 7.14e+07 | 1.19e+08 | 7.18e+07 | 0.00e+00 | 0.00e+00 | 1.21e+09 |
| Sn-125 | 5.37e+08 | 1.00e+07 | 2.39e+07 | 9.86e+06 | 0.00e+00 | 0.00e+00 | 8.05e+08 |
| Sr-126 | 1.14e+10 | 1.49e+08 | 3.70e+08 | 3.93e+07 | 0.00e+00 | 0.00e+00 | 5.18e+08 |
| Sr-124 | 2.09e+08 | 3.08e+06 | 6.49e+07 | 5.56e+05 | 0.00e+00 | 1.31e+08 | 6.46e+08 |
| Sr-125 | 1.50e+08 | 1.45e+06 | 3.08e+07 | 1.87e+05 | 0.00e+00 | 8.65e+07 | 1.99e+08 |
| Sr-126 | 4.20e+07 | 8.23e+05 | 1.52e+07 | 3.22e+05 | 0.00e+00 | 2.64e+07 | 4.35e+08 |
| Sr-127 | 4.17e+06 | 7.44e+04 | 1.29e+06 | 5.31e+04 | 0.00e+00 | 2.15e+06 | 1.11e+08 |
| Te-125m | 1.51e+08 | 5.04e+07 | 2.04e+07 | 5.07e+07 | 0.00e+00 | 0.00e+00 | 7.18e+07 |
| Te-127 | 6.34e+03 | 2.13e+03 | 1.36e+03 | 5.16e+03 | 1.55e+04 | 0.00e+00 | 1.33e+05 |
| Te-127m | 4.21e+08 | 1.40e+08 | 5.10e+07 | 1.22e+08 | 1.04e+09 | 0.00e+00 | 1.70e+08 |
| Te-129 | 2.81e-09 | 9.69e-10 | 6.56e-10 | 2.36e-09 | 7.00e-09 | 0.00e+00 | 2.25e-07 |
| Te-129m | 5.57e+08 | 1.91e+08 | 8.58e+07 | 2.14e+08 | 1.39e+09 | 0.00e+00 | 3.33e+08 |
| Te-131 | 3.76e-32 | 1.39e-32 | 1.05e-32 | 3.35e-32 | 9.61e-32 | 0.00e+00 | 1.52e-30 |
| Te-131m | 3.38e+06 | 1.36e+06 | 1.12e+06 | 2.76e+06 | 9.36e+06 | 0.00e+00 | 2.29e+07 |
| Te-132 | 2.11e+07 | 1.05e+07 | 9.75e+06 | 1.54e+07 | 6.54e+07 | 0.00e+00 | 3.87e+07 |
| Te-133m | 1.98e-12 | 9.05e-13 | 8.65e-13 | 1.74e-12 | 6.17e-12 | 0.00e+00 | 9.76e-11 |
| Te-134 | 8.25e-18 | 4.14e-18 | 4.27e-18 | 7.39e-18 | 2.79e-17 | 0.00e+00 | 9.46e-17 |
| I-129 | 7.06e+09 | 5.23e+09 | 3.83e+09 | 3.36e+12 | 6.19e+09 | 0.00e+00 | 1.05e+08 |
| I-130 | 3.56e+06 | 7.83e+06 | 3.14e+06 | 8.78e+08 | 8.60e+06 | 0.00e+00 | 1.68e+06 |
| I-131 | 2.72e+09 | 3.21e+09 | 1.41e+09 | 1.05e+12 | 3.74e+09 | 0.00e+00 | 1.14e+08 |
| I-132 | 1.45e+00 | 2.95e+00 | 1.05e+00 | 1.38e+02 | 3.29e+00 | 0.00e+00 | 2.39e+00 |
| I-133 | 3.63e+07 | 5.29e+07 | 1.55e+07 | 9.62e+09 | 6.22e+07 | 0.00e+00 | 8.95e+06 |
| I-134 | 1.84e-11 | 3.77e-11 | 1.34e-11 | 8.78e-10 | 4.21e-11 | 0.00e+00 | 3.89e-11 |
| I-135 | 1.13e+05 | 2.25e+05 | 8.19e+04 | 2.01e+07 | 2.50e+05 | 0.00e+00 | 8.13e+04 |
| Cs-134 | 3.65e+10 | 6.80e+10 | 6.87e+09 | 0.00e+00 | 1.75e+10 | 7.18e+09 | 1.85e+08 |
| Cs-134m | 1.55e+00 | 2.58e+00 | 1.30e+00 | 0.00e+00 | 9.94e-01 | 2.29e-01 | 2.04e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.31e+10 | 1.19e+10 | 6.22e+08 | 0.00e+00 | 3.40e+09 | 1.29e+09 | 4.31e+07 |
| Cs-136 | 1.98e+09 | 5.81e+09 | 2.17e+09 | 0.00e+00 | 2.32e+09 | 4.74e+08 | 8.83e+07 |
| Cs-137 | 5.15e+10 | 6.02e+10 | 4.27e+09 | 0.00e+00 | 1.62e+10 | 6.55e+09 | 1.88e+08 |
| Cs-138 | 9.01e-23 | 1.47e-22 | 7.10e-23 | 0.00e+00 | 7.31e-23 | 1.14e-23 | 2.34e-22 |
| Cs-139 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-139 | 4.39e-07 | 2.91e-10 | 1.27e-08 | 0.00e+00 | 1.75e-10 | 1.77e-10 | 2.78e-05 |
| Ba-140 | 2.41e+08 | 2.41e+05 | 1.24e+07 | 0.00e+00 | 5.72e+04 | 1.48e+05 | 5.92e+07 |
| Ba-141 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Ba-142 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| La-140 | 4.06e+01 | 1.60e+01 | 4.11e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.88e+05 |
| La-141 | 2.89e-04 | 8.39e-05 | 1.46e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.62e+00 |
| La-142 | 1.74e-10 | 6.40e-11 | 1.53e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.09e-05 |
| Ce-141 | 4.34e+04 | 2.64e+04 | 3.11e+03 | 0.00e+00 | 8.15e+03 | 0.00e+00 | 1.37e+07 |
| Ce-143 | 3.97e+02 | 2.64e+05 | 3.01e+01 | 0.00e+00 | 7.68e+01 | 0.00e+00 | 1.54e+06 |
| Ce-144 | 2.33e+06 | 9.52e+05 | 1.30e+05 | 0.00e+00 | 3.85e+05 | 0.00e+00 | 1.33e+08 |
| Pr-143 | 1.49e+03 | 5.55e+02 | 7.36e+01 | 0.00e+00 | 2.06e+02 | 0.00e+00 | 7.84e+05 |
| Pr-144 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Nd-147 | 8.81e+02 | 9.05e+02 | 5.55e+01 | 0.00e+00 | 3.49e+02 | 0.00e+00 | 5.74e+05 |
| Pm-147 | 1.57e+04 | 1.32e+03 | 6.44e+02 | 0.00e+00 | 1.98e+03 | 0.00e+00 | 3.75e+05 |
| Pm-148 | 5.57e+02 | 8.04e+01 | 4.05e+01 | 0.00e+00 | 9.60e+01 | 0.00e+00 | 8.58e+05 |
| Pm-148m | 4.90e+03 | 1.24e+03 | 9.74e+02 | 0.00e+00 | 1.43e+03 | 0.00e+00 | 1.62e+06 |
| Pm-149 | 4.13e+01 | 5.42e+00 | 2.37e+00 | 0.00e+00 | 6.59e+00 | 0.00e+00 | 1.46e+05 |
| Pm-151 | 6.10e+00 | 8.90e-01 | 4.50e-01 | 0.00e+00 | 1.06e+00 | 0.00e+00 | 4.12e+04 |
| Sm-151 | 1.19e+04 | 2.74e+03 | 5.92e+02 | 0.00e+00 | 1.86e+03 | 0.00e+00 | 2.29e+05 |
| Sm-153 | 1.91e+01 | 1.47e+01 | 1.13e+00 | 0.00e+00 | 3.09e+00 | 0.00e+00 | 7.71e+04 |
| Eu-152 | 2.76e+04 | 7.34e+03 | 6.19e+03 | 0.00e+00 | 2.06e+04 | 0.00e+00 | 6.52e+05 |
| Eu-154 | 1.09e+05 | 1.51e+04 | 9.05e+03 | 0.00e+00 | 4.09e+04 | 0.00e+00 | 1.88e+06 |
| Eu-155 | 2.18e+04 | 2.51e+03 | 1.30e+03 | 0.00e+00 | 5.63e+03 | 0.00e+00 | 3.36e+06 |
| Eu-156 | 2.23e+03 | 1.38e+03 | 2.19e+02 | 0.00e+00 | 6.37e+02 | 0.00e+00 | 1.30e+06 |
| Tb-160 | 8.75e+03 | 0.00e+00 | 1.09e+03 | 0.00e+00 | 2.49e+03 | 0.00e+00 | 1.17e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 5.14e+04 | 1.11e+04 | 8.76e+03 | 0.00e+00 | 1.47e+04 | 0.00e+00 | 1.09e+06 |
| W-181 | 3.23e+05 | 9.91e+04 | 1.11e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.39e+06 |
| W-185 | 1.23e+07 | 3.85e+06 | 4.39e+05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.51e+07 |
| W-187 | 6.09e+04 | 4.23e+04 | 1.46e+04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.49e+06 |
| Pb-210 | 2.69e+11 | 7.23e+10 | 1.21e+10 | 0.00e+00 | 2.20e+11 | 0.00e+00 | 1.18e+07 |
| Bi-210 | 3.42e+06 | 2.20e+07 | 1.96e+06 | 0.00e+00 | 1.71e+08 | 0.00e+00 | 4.33e+07 |
| Po-210 | 6.88e+09 | 1.32e+10 | 1.64e+09 | 0.00e+00 | 2.80e+10 | 0.00e+00 | 1.47e+08 |
| Ra-223 | 1.15e+12 | 1.68e+09 | 2.31e+11 | 0.00e+00 | 3.06e+10 | 0.00e+00 | 8.97e+09 |
| Ra-224 | 1.36e+11 | 3.07e+08 | 2.72e+10 | 0.00e+00 | 5.60e+09 | 0.00e+00 | 3.60e+09 |
| Ra-225 | 1.78e+12 | 2.01e+09 | 3.54e+11 | 0.00e+00 | 3.66e+10 | 0.00e+00 | 9.98e+09 |
| Ra-226 | 4.08e+13 | 3.13e+09 | 3.38e+13 | 0.00e+00 | 5.73e+10 | 0.00e+00 | 2.26e+10 |
| Ra-228 | 2.82e+13 | 1.69e+09 | 3.18e+13 | 0.00e+00 | 3.09e+10 | 0.00e+00 | 3.83e+09 |
| Ac-225 | 5.85e+05 | 7.51e+05 | 3.92e+04 | 0.00e+00 | 5.51e+04 | 0.00e+00 | 6.51e+06 |
| Ac-227 | 1.84e+08 | 3.15e+07 | 1.15e+07 | 0.00e+00 | 6.40e+06 | 0.00e+00 | 3.49e+06 |
| Th-227 | 2.61e+06 | 4.37e+04 | 7.49e+04 | 0.00e+00 | 1.61e+05 | 0.00e+00 | 1.24e+07 |
| Th-228 | 9.94e+07 | 1.36e+06 | 3.36e+06 | 0.00e+00 | 6.36e+06 | 0.00e+00 | 2.35e+07 |
| Th-229 | 1.04e+09 | 2.60e+07 | 1.73e+07 | 0.00e+00 | 1.25e+08 | 0.00e+00 | 3.33e+06 |
| Th-230 | 1.56e+08 | 7.82e+06 | 4.36e+06 | 0.00e+00 | 3.75e+07 | 0.00e+00 | 2.57e+06 |
| Th-232 | 1.74e+08 | 6.70e+06 | 6.79e+04 | 0.00e+00 | 3.20e+07 | 0.00e+00 | 2.18e+06 |
| Th-234 | 1.70e+04 | 9.26e+02 | 4.91e+02 | 0.00e+00 | 3.41e+03 | 0.00e+00 | 2.92e+06 |
| Pa-231 | 3.11e+08 | 1.03e+07 | 1.24e+07 | 0.00e+00 | 5.51e+07 | 0.00e+00 | 3.06e+06 |
| Pa-233 | 8.05e+02 | 1.58e+02 | 1.41e+02 | 0.00e+00 | 4.32e+02 | 0.00e+00 | 3.78e+05 |
| U-232 | 9.95e+10 | 0.00e+00 | 8.88e+09 | 0.00e+00 | 9.74e+09 | 0.00e+00 | 2.89e+08 |
| U-233 | 2.09e+10 | 0.00e+00 | 1.59e+09 | 0.00e+00 | 4.44e+09 | 0.00e+00 | 2.68e+08 |
| U-234 | 2.01e+10 | 0.00e+00 | 1.56e+09 | 0.00e+00 | 4.36e+09 | 0.00e+00 | 2.62e+08 |
| U-235 | 1.92e+10 | 0.00e+00 | 1.46e+09 | 0.00e+00 | 4.08e+09 | 0.00e+00 | 3.33e+08 |
| U-236 | 1.92e+10 | 0.00e+00 | 1.50e+09 | 0.00e+00 | 4.15e+09 | 0.00e+00 | 2.46e+08 |
| U-237 | 5.39e+05 | 0.00e+00 | 1.44e+05 | 0.00e+00 | 1.34e+06 | 0.00e+00 | 2.30e+07 |
| U-238 | 1.84e+10 | 0.00e+00 | 1.37e+09 | 0.00e+00 | 3.82e+09 | 0.00e+00 | 2.35e+08 |
| Np-237 | 9.87e+07 | 6.54e+06 | 4.32e+06 | 0.00e+00 | 2.61e+07 | 0.00e+00 | 3.39e+06 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for Infant age group by nuclide.
Waterford Steam Electric Station
Pathway : Cow's Milk (food) Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 3.49e+02 | 8.78e+00 | 5.40e+00 | 0.00e+00 | 1.92e+01 | 0.00e+00 | 1.17e+05 |
| Np-239 | 3.65e+01 | 3.26e+00 | 1.84e+00 | 0.00e+00 | 6.51e+00 | 0.00e+00 | 9.44e+04 |
| Pu-238 | 2.11e+07 | 2.47e+06 | 5.59e+05 | 0.00e+00 | 1.99e+06 | 0.00e+00 | 1.24e+06 |
| Pu-239 | 2.27e+07 | 2.55e+06 | 5.82e+05 | 0.00e+00 | 2.11e+06 | 0.00e+00 | 1.14e+06 |
| Pu-240 | 2.27e+07 | 2.55e+06 | 5.82e+05 | 0.00e+00 | 2.11e+06 | 0.00e+00 | 1.16e+06 |
| Pu-241 | 6.97e+05 | 2.89e+04 | 1.45e+04 | 0.00e+00 | 5.20e+04 | 0.00e+00 | 2.38e+04 |
| Pu-242 | 2.11e+07 | 2.45e+06 | 5.61e+05 | 0.00e+00 | 2.02e+06 | 0.00e+00 | 1.11e+06 |
| Pu-244 | 2.45e+07 | 2.81e+06 | 6.43e+05 | 0.00e+00 | 2.32e+06 | 0.00e+00 | 1.66e+06 |
| Am-241 | 5.95e+07 | 5.17e+07 | 4.44e+06 | 0.00e+00 | 2.67e+07 | 0.00e+00 | 3.14e+06 |
| Am-242m | 6.21e+07 | 5.02e+07 | 4.65e+06 | 0.00e+00 | 2.73e+07 | 0.00e+00 | 3.98e+06 |
| Am-243 | 5.92e+07 | 5.06e+07 | 4.36e+06 | 0.00e+00 | 2.62e+07 | 0.00e+00 | 3.71e+06 |
| Cm-242 | 5.15e+06 | 4.77e+06 | 3.42e+05 | 0.00e+00 | 9.84e+05 | 0.00e+00 | 3.09e+06 |
| Cm-243 | 5.75e+07 | 4.72e+07 | 3.69e+06 | 0.00e+00 | 1.34e+07 | 0.00e+00 | 3.33e+06 |
| Cm-244 | 4.84e+07 | 3.98e+07 | 3.11e+06 | 0.00e+00 | 1.11e+07 | 0.00e+00 | 3.22e+06 |
| Cm-245 | 7.36e+07 | 5.96e+07 | 4.65e+06 | 0.00e+00 | 1.78e+07 | 0.00e+00 | 3.00e+06 |
| Cm-246 | 7.28e+07 | 5.96e+07 | 4.65e+06 | 0.00e+00 | 1.77e+07 | 0.00e+00 | 2.95e+06 |
| Cm-247 | 7.12e+07 | 5.88e+07 | 4.57e+06 | 0.00e+00 | 1.74e+07 | 0.00e+00 | 3.88e+06 |
| Cm-248 | 5.88e+08 | 4.85e+08 | 3.77e+07 | 0.00e+00 | 1.44e+08 | 0.00e+00 | 6.25e+07 |
| Cf-252 | 4.93e+07 | 0.00e+00 | 1.19e+06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.21e+07 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec for all nuclides except H-3, which is in units of mrem/yr per uCi/cubic meter.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for all age groups by nuclide.
Waterford Steam Electric Station
Pathway : Ground Plane Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| H-3 | 0.00e+00 | 0.00e+00 |
| Be-10 | 0.00e+00 | 0.00e+00 |
| C-14 | 0.00e+00 | 0.00e+00 |
| N-13 | 5.75e+04 | 6.65e+04 |
| F-18 | 5.66e+05 | 6.66e+05 |
| Na-22 | 3.88e+09 | 4.36e+09 |
| Na-24 | 1.71e+07 | 1.98e+07 |
| P-32 | 0.00e+00 | 0.00e+00 |
| Ca-41 | 9.42e+08 | 1.11e+09 |
| Sc-46 | 1.13e+09 | 1.31e+09 |
| Cr-51 | 6.65e+06 | 7.86e+06 |
| Mn-54 | 1.10e+09 | 1.29e+09 |
| Mn-56 | 1.29e+06 | 1.52e+06 |
| Fe-55 | 0.00e+00 | 0.00e+00 |
| Fe-59 | 3.89e+08 | 4.57e+08 |
| Co-57 | 1.63e+08 | 1.79e+08 |
| Co-58 | 5.26e+08 | 6.16e+08 |
| Co-60 | 4.40e+09 | 5.18e+09 |
| Ni-59 | 0.00e+00 | 0.00e+00 |
| Ni-63 | 0.00e+00 | 0.00e+00 |
| Ni-65 | 4.24e+05 | 4.93e+05 |
| Cu-64 | 8.67e+05 | 9.82e+05 |
| Zn-65 | 6.88e+08 | 7.92e+08 |
| Zn-69 | 0.00e+00 | 0.00e+00 |
| Zn-69m | 1.82e+06 | 2.13e+06 |
| Se-79 | 0.00e+00 | 0.00e+00 |
| Br-82 | 3.05e+07 | 3.53e+07 |
| Br-83 | 6.96e+03 | 1.01e+04 |
| Br-84 | 2.89e+05 | 3.38e+05 |
| Br-85 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for all age groups by nuclide.
Waterford Steam Electric Station
Pathway : Ground Plane Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Rb-86 | 1.28e+07 | 1.47e+07 |
| Rb-87 | 0.00e+00 | 0.00e+00 |
| Rb-88 | 4.72e+04 | 5.40e+04 |
| Rb-89 | 1.76e+05 | 2.11e+05 |
| Sr-89 | 3.07e+04 | 3.56e+04 |
| Sr-90 | 0.00e+00 | 0.00e+00 |
| Sr-91 | 3.07e+06 | 3.59e+06 |
| Sr-92 | 1.11e+06 | 1.23e+06 |
| Y-90 | 6.42e+03 | 7.58e+03 |
| Y-91 | 1.51e+06 | 1.70e+06 |
| Y-91m | 1.43e+05 | 1.66e+05 |
| Y-92 | 2.58e+05 | 3.06e+05 |
| Y-93 | 2.62e+05 | 3.58e+05 |
| Zr-93 | 0.00e+00 | 0.00e+00 |
| Zr-95 | 3.43e+08 | 3.98e+08 |
| Zr-97 | 4.23e+06 | 4.92e+06 |
| Nb-93m | 2.21e+05 | 2.69e+07 |
| Nb-95 | 1.95e+08 | 2.30e+08 |
| Nb-97 | 2.57e+05 | 3.02e+05 |
| Mo-93 | 6.33e+06 | 2.57e+08 |
| Mo-99 | 5.71e+06 | 6.61e+06 |
| Tc-101 | 2.91e+04 | 3.23e+04 |
| Tc-99 | 0.00e+00 | 0.00e+00 |
| Tc-99m | 2.63e+05 | 3.01e+05 |
| Ru-103 | 1.54e+08 | 1.80e+08 |
| Ru-105 | 9.09e+05 | 1.03e+06 |
| Ru-106 | 3.00e+08 | 3.60e+08 |
| Rh-105 | 1.06e+06 | 1.24e+06 |
| Pd-107 | 0.00e+00 | 0.00e+00 |
| Pd-109 | 2.15e+04 | 2.46e+04 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for all age groups by nuclide.
Waterford Steam Electric Station
Pathway : Ground Plane Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Ag-110m | 3.13e+09 | 3.65e+09 |
| Ag-111 | 1.46e+06 | 1.71e+06 |
| Cd-113m | 6.21e+05 | 7.01e+05 |
| Cd-115m | 0.00e+00 | 0.00e+00 |
| Sn-123 | 0.00e+00 | 7.82e+09 |
| Sn-125 | 5.99e+06 | 6.93e+06 |
| Sn-126 | 2.49e+09 | 2.76e+09 |
| Sb-124 | 8.42e+08 | 9.71e+08 |
| Sb-125 | 7.58e+08 | 8.55e+08 |
| Sb-126 | 1.21e+08 | 1.36e+08 |
| Sb-127 | 2.41e+07 | 2.79e+07 |
| Te-125m | 2.19e+06 | 3.00e+06 |
| Te-127 | 4.25e+03 | 4.68e+03 |
| Te-127m | 1.18e+05 | 1.40e+05 |
| Te-129 | 3.75e+04 | 4.43e+04 |
| Te-129m | 2.82e+07 | 3.30e+07 |
| Te-131 | 4.17e+04 | 4.93e+07 |
| Te-131m | 1.15e+07 | 1.35e+07 |
| Te-132 | 6.05e+06 | 7.12e+06 |
| Te-133m | 6.30e+05 | 7.14e+05 |
| Te-134 | 3.17e+04 | 3.80e+04 |
| I-129 | 1.24e+08 | 2.07e+08 |
| I-130 | 7.87e+06 | 9.56e+06 |
| I-131 | 2.46e+07 | 2.98e+07 |
| I-132 | 1.78e+06 | 2.09e+06 |
| I-133 | 3.50e+06 | 4.26e+06 |
| I-134 | 6.38e+05 | 7.58e+05 |
| I-135 | 3.61e+06 | 4.21e+06 |
| Cs-134 | 2.82e+09 | 3.28e+09 |
| Cs-134m | 8.18e+04 | 9.63e+04 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

P_i factors for all age groups by nuclide.
Waterford Steam Electric Station
Pathway : Ground Plane Pathway for P_i

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Cs-135 | 0.00e+00 | 0.00e+00 |
| Cs-136 | 2.16e+08 | 2.44e+08 |
| Cs-137 | 1.15e+09 | 1.34e+09 |
| Cs-138 | 5.13e+05 | 5.86e+05 |
| Cs-139 | 4.49e+04 | 5.13e+04 |
| Ba-139 | 1.51e+05 | 1.70e+05 |
| Ba-140 | 2.93e+07 | 3.35e+07 |
| Ba-141 | 5.96e+04 | 6.79e+04 |
| Ba-142 | 6.41e+04 | 7.30e+04 |
| La-140 | 2.74e+07 | 3.11e+07 |
| La-141 | 4.47e+04 | 5.01e+04 |
| La-142 | 1.09e+06 | 1.30e+06 |
| Ce-141 | 1.95e+07 | 2.20e+07 |
| Ce-143 | 3.30e+06 | 3.75e+06 |
| Ce-144 | 5.85e+07 | 6.77e+07 |
| Pr-143 | 0.00e+00 | 0.00e+00 |
| Pr-144 | 2.62e+03 | 3.01e+03 |
| Nd-147 | 1.20e+07 | 1.44e+07 |
| Pm-147 | 0.00e+00 | 0.00e+00 |
| Pm-148 | 2.70e+07 | 3.11e+07 |
| Pm-148m | 6.34e+08 | 3.67e+09 |
| Pm-149 | 6.03e+04 | 7.00e+04 |
| Pm-151 | 2.83e+06 | 2.96e+06 |
| Sm-151 | 1.32e+07 | 5.78e+07 |
| Sm-153 | 5.75e+05 | 6.39e+05 |
| Eu-152 | 1.98e+09 | 2.29e+09 |
| Eu-154 | 2.15e+09 | 2.48e+09 |
| Eu-155 | 8.74e+07 | 9.93e+07 |
| Eu-156 | 1.26e+08 | 1.44e+08 |
| Tb-160 | 6.57e+08 | 7.64e+08 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for all age groups by nuclide.
Waterford Steam Electric Station
Pathway : Ground Plane Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Ho-166m | 2.46e+09 | 2.76e+09 |
| W-181 | 2.43e+05 | 3.24e+05 |
| W-185 | 0.00e+00 | 0.00e+00 |
| W-187 | 3.36e+06 | 3.90e+06 |
| Pb-210 | 3.53e+06 | 4.62e+06 |
| Bi-210 | 0.00e+00 | 0.00e+00 |
| Po-210 | 6.84e+03 | 7.85e+03 |
| Ra-223 | 1.87e+07 | 2.24e+07 |
| Ra-224 | 3.56e+07 | 4.00e+07 |
| Ra-225 | 1.36e+06 | 1.94e+06 |
| Ra-226 | 1.77e+09 | 2.04e+09 |
| Ra-228 | 3.12e+09 | 3.64e+09 |
| Ac-225 | 1.75e+07 | 1.97e+07 |
| Ac-227 | 5.44e+08 | 6.53e+08 |
| Th-227 | 1.03e+07 | 1.27e+07 |
| Th-228 | 2.06e+09 | 2.32e+09 |
| Th-229 | 6.08e+08 | 7.46e+08 |
| Th-230 | 1.80e+09 | 2.07e+09 |
| Th-232 | 8.29e+08 | 1.11e+09 |
| Th-234 | 2.89e+06 | 3.42e+06 |
| Pa-231 | 6.08e+08 | 7.46e+08 |
| Pa-233 | 3.89e+07 | 4.49e+07 |
| U-232 | 7.12e+05 | 7.40e+06 |
| U-233 | 6.35e+08 | 7.74e+08 |
| U-234 | 1.75e+05 | 4.39e+07 |
| U-235 | 8.84e+08 | 1.11e+09 |
| U-236 | 5.80e+03 | 4.97e+06 |
| U-237 | 7.37e+06 | 9.58e+06 |
| U-238 | 3.04e+07 | 4.14e+07 |
| Np-237 | 3.87e+08 | 4.42e+08 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**DOSE FACTORS DUE TO RADIONUCLIDES
OTHER THAN NOBLE GASES; P_i**

Pi factors for all age groups by nuclide.
Waterford Steam Electric Station
Pathway : Ground Plane Pathway for Pi

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Np-238 | 6.48e+06 | 7.41e+06 |
| Np-239 | 2.44e+06 | 2.83e+06 |
| Pu-238 | 3.58e+05 | 4.95e+06 |
| Pu-239 | 2.18e+05 | 2.13e+06 |
| Pu-240 | 3.59e+05 | 4.97e+06 |
| Pu-241 | 1.24e+06 | 1.84e+06 |
| Pu-242 | 3.04e+05 | 4.42e+06 |
| Pu-244 | 2.47e+08 | 2.66e+08 |
| Am-241 | 4.60e+07 | 6.64e+07 |
| Am-242m | 7.17e+06 | 4.96e+07 |
| Am-243 | 3.59e+08 | 4.14e+08 |
| Cm-242 | 7.72e+05 | 3.23e+06 |
| Cm-243 | 6.28e+08 | 7.91e+08 |
| Cm-244 | 7.86e+05 | 4.88e+06 |
| Cm-245 | 2.62e+08 | 3.31e+08 |
| Cm-246 | 2.76e+05 | 4.14e+06 |
| Cm-247 | 6.08e+08 | 7.18e+08 |
| Cm-248 | 1.88e+09 | 1.44e+09 |
| Cf-252 | 1.59e+10 | 1.73e+10 |

Conversion factors are in units of square meter-mrem/yr per uCi/sec.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (GROUND PLANE)**

Ground Plane Dose Conversion factors for all age groups by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| H-3 | 0.00e+00 | 0.00e+00 |
| Be-10 | 0.00e+00 | 0.00e+00 |
| C-14 | 0.00e+00 | 0.00e+00 |
| N-13 | 7.60e-09 | 8.80e-09 |
| F-18 | 6.80e-09 | 8.00e-09 |
| Na-22 | 1.60e-08 | 1.80e-08 |
| Na-24 | 2.50e-08 | 2.90e-08 |
| P-32 | 0.00e+00 | 0.00e+00 |
| Ca-41 | 3.41e-09 | 4.01e-09 |
| Sc-46 | 1.30e-08 | 1.50e-08 |
| Cr-51 | 2.20e-10 | 2.60e-10 |
| Mn-54 | 5.80e-09 | 6.80e-09 |
| Mn-56 | 1.10e-08 | 1.30e-08 |
| Fe-55 | 0.00e+00 | 0.00e+00 |
| Fe-59 | 8.00e-09 | 9.40e-09 |
| Co-57 | 9.10e-10 | 1.00e-09 |
| Co-58 | 7.00e-09 | 8.20e-09 |
| Co-60 | 1.70e-08 | 2.00e-08 |
| Ni-59 | 0.00e+00 | 0.00e+00 |
| Ni-63 | 0.00e+00 | 0.00e+00 |
| Ni-65 | 3.70e-09 | 4.30e-09 |
| Cu-64 | 1.50e-09 | 1.70e-09 |
| Zn-65 | 4.00e-09 | 4.60e-09 |
| Zn-69 | 0.00e+00 | 0.00e+00 |
| Zn-69m | 2.90e-09 | 3.40e-09 |
| Se-79 | 0.00e+00 | 0.00e+00 |
| Br-82 | 1.90e-08 | 2.20e-08 |
| Br-83 | 6.40e-11 | 9.30e-11 |
| Br-84 | 1.20e-08 | 1.40e-08 |
| Br-85 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem/hr per pCi/square meter.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (GROUND PLANE)**

Ground Plane Dose Conversion factors for all age groups by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Rb-86 | 6.30e-10 | 7.20e-10 |
| Rb-87 | 0.00e+00 | 0.00e+00 |
| Rb-88 | 3.50e-09 | 4.00e-09 |
| Rb-89 | 1.50e-08 | 1.80e-08 |
| Sr-89 | 5.60e-13 | 6.50e-13 |
| Sr-90 | 0.00e+00 | 0.00e+00 |
| Sr-91 | 7.10e-09 | 8.30e-09 |
| Sr-92 | 9.00e-09 | 1.00e-08 |
| Y-90 | 2.20e-12 | 2.60e-12 |
| Y-91 | 2.40e-11 | 2.70e-11 |
| Y-91m | 3.80e-09 | 4.40e-09 |
| Y-92 | 1.60e-09 | 1.90e-09 |
| Y-93 | 5.70e-10 | 7.80e-10 |
| Zr-93 | 0.00e+00 | 0.00e+00 |
| Zr-95 | 5.00e-09 | 5.80e-09 |
| Zr-97 | 5.50e-09 | 6.40e-09 |
| Nb-93m | 8.20e-13 | 1.00e-10 |
| Nb-95 | 5.10e-09 | 6.00e-09 |
| Nb-97 | 4.60e-09 | 5.40e-09 |
| Mo-93 | 2.29e-11 | 9.32e-10 |
| Mo-99 | 1.90e-09 | 2.20e-09 |
| Tc-101 | 2.70e-09 | 3.00e-09 |
| Tc-99 | 0.00e+00 | 0.00e+00 |
| Tc-99m | 9.60e-10 | 1.10e-09 |
| Ru-103 | 3.60e-09 | 4.20e-09 |
| Ru-105 | 4.50e-09 | 5.10e-09 |
| Ru-106 | 1.50e-09 | 1.80e-09 |
| Rh-105 | 6.60e-10 | 7.70e-10 |
| Pd-107 | 0.00e+00 | 0.00e+00 |
| Pd-109 | 3.50e-11 | 4.00e-11 |

Conversion factors are in units of mrem/hr per pCi/square meter.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (GROUND PLANE)**

Ground Plane Dose Conversion factors for all age groups by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Ag-110m | 1.80e-08 | 2.10e-08 |
| Ag-111 | 1.80e-10 | 2.10e-10 |
| Cd-113m | 2.30e-12 | 2.60e-12 |
| Cd-115m | 0.00e+00 | 0.00e+00 |
| Sn-123 | 0.00e+00 | 6.46e-08 |
| Sn-125 | 5.70e-10 | 6.60e-10 |
| Sn-126 | 9.00e-09 | 1.00e-08 |
| Sb-124 | 1.30e-08 | 1.50e-08 |
| Sb-125 | 3.10e-09 | 3.50e-09 |
| Sb-126 | 8.90e-09 | 1.00e-08 |
| Sb-127 | 5.70e-09 | 6.60e-09 |
| Te-125m | 3.50e-11 | 4.80e-11 |
| Te-127 | 1.00e-11 | 1.10e-11 |
| Te-127m | 1.10e-12 | 1.30e-12 |
| Te-129 | 7.10e-10 | 8.40e-10 |
| Te-129m | 7.70e-10 | 9.00e-10 |
| Te-131 | 2.20e-09 | 2.60e-06 |
| Te-131m | 8.40e-09 | 9.90e-09 |
| Te-132 | 1.70e-09 | 2.00e-09 |
| Te-133m | 1.50e-08 | 1.70e-08 |
| Te-134 | 1.00e-09 | 1.20e-09 |
| I-129 | 4.50e-10 | 7.50e-10 |
| I-130 | 1.40e-08 | 1.70e-08 |
| I-131 | 2.80e-09 | 3.40e-09 |
| I-132 | 1.70e-08 | 2.00e-08 |
| I-133 | 3.70e-09 | 4.50e-09 |
| I-134 | 1.60e-08 | 1.90e-08 |
| I-135 | 1.20e-08 | 1.40e-08 |
| Cs-134 | 1.20e-08 | 1.40e-08 |
| Cs-134m | 6.20e-10 | 7.30e-10 |

Conversion factors are in units of mrem/hr per pCi/square meter.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (GROUND PLANE)**

Ground Plane Dose Conversion factors for all age groups by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Cs-135 | 0.00e+00 | 0.00e+00 |
| Cs-136 | 1.50e-08 | 1.70e-08 |
| Cs-137 | 4.20e-09 | 4.90e-09 |
| Cs-138 | 2.10e-08 | 2.40e-08 |
| Cs-139 | 6.30e-09 | 7.20e-09 |
| Ba-139 | 2.40e-09 | 2.70e-09 |
| Ba-140 | 2.10e-09 | 2.40e-09 |
| Ba-141 | 4.30e-09 | 4.90e-09 |
| Ba-142 | 7.90e-09 | 9.00e-09 |
| La-140 | 1.50e-08 | 1.70e-08 |
| La-141 | 2.50e-10 | 2.80e-10 |
| La-142 | 1.50e-08 | 1.80e-08 |
| Ce-141 | 5.50e-10 | 6.20e-10 |
| Ce-143 | 2.20e-09 | 2.50e-09 |
| Ce-144 | 3.20e-10 | 3.70e-10 |
| Pr-143 | 0.00e+00 | 0.00e+00 |
| Pr-144 | 2.00e-10 | 2.30e-10 |
| Nd-147 | 1.00e-09 | 1.20e-09 |
| Pm-147 | 0.00e+00 | 0.00e+00 |
| Pm-148 | 4.60e-09 | 5.30e-09 |
| Pm-148m | 1.41e-08 | 8.16e-08 |
| Pm-149 | 2.50e-11 | 2.90e-11 |
| Pm-151 | 2.20e-09 | 2.30e-09 |
| Sm-151 | 4.80e-11 | 2.10e-10 |
| Sm-153 | 2.70e-10 | 3.00e-10 |
| Eu-152 | 7.37e-09 | 8.53e-09 |
| Eu-154 | 7.80e-09 | 9.00e-09 |
| Eu-155 | 3.81e-10 | 4.33e-10 |
| Eu-156 | 7.60e-09 | 8.70e-09 |
| Tb-160 | 8.60e-09 | 1.00e-08 |

Conversion factors are in units of mrem/hr per pCi/square meter.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (GROUND PLANE)**

Ground Plane Dose Conversion factors for all age groups by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Ho-166m | 8.90e-09 | 1.00e-08 |
| W-181 | 2.10e-12 | 2.80e-12 |
| W-185 | 0.00e+00 | 0.00e+00 |
| W-187 | 3.10e-09 | 3.60e-09 |
| Pb-210 | 1.30e-11 | 1.70e-11 |
| Bi-210 | 0.00e+00 | 0.00e+00 |
| Po-210 | 5.40e-14 | 6.20e-14 |
| Ra-223 | 1.50e-09 | 1.80e-09 |
| Ra-224 | 8.90e-09 | 1.00e-08 |
| Ra-225 | 8.40e-11 | 1.20e-10 |
| Ra-226 | 6.40e-09 | 7.40e-09 |
| Ra-228 | 1.20e-08 | 1.40e-08 |
| Ac-225 | 1.60e-09 | 1.80e-09 |
| Ac-227 | 2.00e-09 | 2.40e-09 |
| Th-227 | 5.10e-10 | 6.30e-10 |
| Th-228 | 8.90e-09 | 1.00e-08 |
| Th-229 | 2.20e-09 | 2.70e-09 |
| Th-230 | 6.50e-09 | 7.50e-09 |
| Th-232 | 3.00e-09 | 4.00e-09 |
| Th-234 | 1.10e-10 | 1.30e-10 |
| Pa-231 | 2.20e-09 | 2.70e-09 |
| Pa-233 | 1.30e-09 | 1.50e-09 |
| U-232 | 2.59e-12 | 2.69e-11 |
| U-233 | 2.30e-09 | 2.80e-09 |
| U-234 | 6.32e-13 | 1.59e-10 |
| U-235 | 3.20e-09 | 4.00e-09 |
| U-236 | 2.10e-14 | 1.80e-11 |
| U-237 | 1.00e-09 | 1.30e-09 |
| U-238 | 1.10e-10 | 1.50e-10 |
| Np-237 | 1.40e-09 | 1.60e-09 |

Conversion factors are in units of mrem/hr per pCi/square meter.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (GROUND PLANE)**

Ground Plane Dose Conversion factors for all age groups by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | |
|---------|-------------------------------|----------|
| | T. Body | Skin |
| Np-238 | 2.80e-09 | 3.20e-09 |
| Np-239 | 9.50e-10 | 1.10e-09 |
| Pu-238 | 1.30e-12 | 1.80e-11 |
| Pu-239 | 7.90e-13 | 7.70e-12 |
| Pu-240 | 1.30e-12 | 1.80e-11 |
| Pu-241 | 4.60e-12 | 6.80e-12 |
| Pu-242 | 1.10e-12 | 1.60e-11 |
| Pu-244 | 8.95e-10 | 9.62e-10 |
| Am-241 | 1.80e-10 | 2.60e-10 |
| Am-242m | 2.60e-11 | 1.80e-10 |
| Am-243 | 1.30e-09 | 1.50e-09 |
| Cm-242 | 5.50e-12 | 2.30e-11 |
| Cm-243 | 2.30e-09 | 2.90e-09 |
| Cm-244 | 2.90e-12 | 1.80e-11 |
| Cm-245 | 9.50e-10 | 1.20e-09 |
| Cm-246 | 1.00e-12 | 1.50e-11 |
| Cm-247 | 2.20e-09 | 2.60e-09 |
| Cm-248 | 6.81e-09 | 5.23e-09 |
| Cf-252 | 6.60e-08 | 7.20e-08 |

Conversion factors are in units of mrem/hr per pCi/square meter.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 8.98e-08 | 8.98e-08 | 8.98e-08 | 8.98e-08 | 8.98e-08 | 8.98e-08 |
| Be-10 | 1.98e-04 | 3.06e-05 | 4.96e-06 | 0.00e+00 | 0.00e+00 | 2.22e-04 | 1.67e-05 |
| C-14 | 2.27e-06 | 4.26e-07 | 4.26e-07 | 4.26e-07 | 4.26e-07 | 4.26e-07 | 4.26e-07 |
| N-13 | 6.27e-09 | 6.27e-09 | 6.27e-09 | 6.27e-09 | 6.27e-09 | 6.27e-09 | 6.27e-09 |
| F-18 | 4.71e-07 | 0.00e+00 | 5.19e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.24e-09 |
| Na-22 | 1.30e-05 | 1.30e-05 | 1.30e-05 | 1.30e-05 | 1.30e-05 | 1.30e-05 | 1.30e-05 |
| Na-24 | 1.28e-06 | 1.28e-06 | 1.28e-06 | 1.28e-06 | 1.28e-06 | 1.28e-06 | 1.28e-06 |
| P-32 | 1.65e-04 | 9.64e-06 | 6.26e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.08e-05 |
| Ca-41 | 3.83e-05 | 0.00e+00 | 4.13e-06 | 0.00e+00 | 0.00e+00 | 3.83e-06 | 2.86e-07 |
| Sc-46 | 5.51e-05 | 1.07e-04 | 3.11e-05 | 0.00e+00 | 9.99e-05 | 0.00e+00 | 3.23e-05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.25e-08 | 7.44e-09 | 2.85e-09 | 1.80e-06 | 4.15e-07 |
| Mn-54 | 0.00e+00 | 4.95e-06 | 7.87e-07 | 0.00e+00 | 1.23e-06 | 1.75e-04 | 9.67e-06 |
| Mn-56 | 0.00e+00 | 1.55e-10 | 2.29e-11 | 0.00e+00 | 1.63e-10 | 1.18e-06 | 2.53e-06 |
| Fe-55 | 3.07e-06 | 2.12e-06 | 4.93e-07 | 0.00e+00 | 0.00e+00 | 9.01e-06 | 7.54e-07 |
| Fe-59 | 1.47e-06 | 3.47e-06 | 1.32e-06 | 0.00e+00 | 0.00e+00 | 1.27e-04 | 2.35e-05 |
| Cc-57 | 0.00e+00 | 8.65e-08 | 8.39e-08 | 0.00e+00 | 0.00e+00 | 4.62e-05 | 3.93e-06 |
| Cc-58 | 0.00e+00 | 1.98e-07 | 2.59e-07 | 0.00e+00 | 0.00e+00 | 1.16e-04 | 1.33e-05 |
| Cc-60 | 0.00e+00 | 1.44e-06 | 1.85e-06 | 0.00e+00 | 0.00e+00 | 7.46e-04 | 3.56e-05 |
| Ni-59 | 4.06e-06 | 1.46e-06 | 6.77e-07 | 0.00e+00 | 0.00e+00 | 8.20e-06 | 6.11e-07 |
| Ni-63 | 5.40e-05 | 3.93e-06 | 1.81e-06 | 0.00e+00 | 0.00e+00 | 2.23e-05 | 1.67e-06 |
| Ni-65 | 1.92e-10 | 2.62e-11 | 1.14e-11 | 0.00e+00 | 0.00e+00 | 7.00e-07 | 1.54e-06 |
| Cu-64 | 0.00e+00 | 1.83e-10 | 7.69e-11 | 0.00e+00 | 5.78e-10 | 8.48e-07 | 6.12e-06 |
| Zr-65 | 4.05e-06 | 1.29e-05 | 5.82e-06 | 0.00e+00 | 8.62e-06 | 1.08e-04 | 6.68e-06 |
| Zr-69 | 4.23e-12 | 8.14e-12 | 5.65e-13 | 0.00e+00 | 5.27e-12 | 1.15e-07 | 2.04e-09 |
| Zr-69m | 1.02e-09 | 2.45e-09 | 2.24e-10 | 0.00e+00 | 1.48e-09 | 2.38e-06 | 1.71e-05 |
| Se-79 | 0.00e+00 | 3.83e-07 | 6.09e-08 | 0.00e+00 | 5.69e-07 | 4.47e-05 | 3.33e-06 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.69e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.30e-06 |
| Br-83 | 0.00e+00 | 0.00e+00 | 3.01e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.90e-08 |
| Br-84 | 0.00e+00 | 0.00e+00 | 3.91e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.05e-13 |
| Br-85 | 0.00e+00 | 0.00e+00 | 1.60e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.69e-05 | 7.37e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.08e-06 |
| Rb-87 | 0.00e+00 | 9.86e-06 | 3.21e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.88e-07 |
| Rb-88 | 0.00e+00 | 4.84e-08 | 2.41e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.18e-19 |
| Rb-89 | 0.00e+00 | 3.20e-08 | 2.12e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.16e-21 |
| Sr-89 | 3.80e-05 | 0.00e+00 | 1.09e-06 | 0.00e+00 | 0.00e+00 | 1.75e-04 | 4.37e-05 |
| Sr-90 | 3.59e-03 | 0.00e+00 | 7.21e-05 | 0.00e+00 | 0.00e+00 | 1.20e-03 | 9.02e-05 |
| Sr-91 | 7.74e-09 | 0.00e+00 | 3.13e-10 | 0.00e+00 | 0.00e+00 | 4.56e-06 | 2.39e-05 |
| Sr-92 | 8.43e-10 | 0.00e+00 | 3.64e-11 | 0.00e+00 | 0.00e+00 | 2.06e-06 | 5.38e-06 |
| Y-90 | 2.61e-07 | 0.00e+00 | 7.01e-09 | 0.00e+00 | 0.00e+00 | 2.12e-05 | 6.32e-05 |
| Y-91 | 5.78e-05 | 0.00e+00 | 1.55e-06 | 0.00e+00 | 0.00e+00 | 2.13e-04 | 4.81e-05 |
| Y-91m | 3.26e-11 | 0.00e+00 | 1.27e-12 | 0.00e+00 | 0.00e+00 | 2.40e-07 | 1.66e-10 |
| Y-92 | 1.29e-09 | 0.00e+00 | 3.77e-11 | 0.00e+00 | 0.00e+00 | 1.96e-06 | 9.19e-06 |
| Y-93 | 1.18e-08 | 0.00e+00 | 3.26e-10 | 0.00e+00 | 0.00e+00 | 6.06e-06 | 5.27e-05 |
| Zr-93 | 5.22e-05 | 2.92e-06 | 1.37e-06 | 0.00e+00 | 1.11e-05 | 2.13e-05 | 1.51e-06 |
| Zr-95 | 1.34e-05 | 4.30e-06 | 2.91e-06 | 0.00e+00 | 6.77e-06 | 2.21e-04 | 1.88e-05 |
| Zr-97 | 1.21e-08 | 2.45e-09 | 1.13e-09 | 0.00e+00 | 3.71e-09 | 9.84e-06 | 6.54e-05 |
| Nb-93m | 3.10e-05 | 1.01e-05 | 2.49e-06 | 0.00e+00 | 1.16e-05 | 3.11e-05 | 2.38e-06 |
| Nb-95 | 1.76e-06 | 9.77e-07 | 5.26e-07 | 0.00e+00 | 9.67e-07 | 6.31e-05 | 1.30e-05 |
| Nb-97 | 2.78e-11 | 7.03e-12 | 2.56e-12 | 0.00e+00 | 8.18e-12 | 3.00e-07 | 3.02e-08 |
| Mo-93 | 0.00e+00 | 1.17e-06 | 3.17e-08 | 0.00e+00 | 3.55e-07 | 5.11e-05 | 3.79e-06 |
| Mo-99 | 0.00e+00 | 1.51e-08 | 2.87e-09 | 0.00e+00 | 3.64e-08 | 1.14e-05 | 3.10e-05 |
| Tc-101 | 5.22e-15 | 7.52e-15 | 7.38e-14 | 0.00e+00 | 1.35e-13 | 4.99e-08 | 1.36e-21 |
| Tc-99 | 3.13e-08 | 4.64e-08 | 1.25e-08 | 0.00e+00 | 5.85e-07 | 1.01e-04 | 7.54e-06 |
| Tc-99m | 1.29e-13 | 3.64e-13 | 4.63e-12 | 0.00e+00 | 5.52e-12 | 9.55e-08 | 5.20e-07 |
| Ru-103 | 1.91e-07 | 0.00e+00 | 8.23e-08 | 0.00e+00 | 7.29e-07 | 6.31e-05 | 1.38e-05 |
| Ru-105 | 9.88e-11 | 0.00e+00 | 3.89e-11 | 0.00e+00 | 1.27e-10 | 1.37e-06 | 6.02e-06 |
| Ru-106 | 8.64e-06 | 0.00e+00 | 1.09e-06 | 0.00e+00 | 1.67e-05 | 1.17e-03 | 1.14e-04 |
| Rh-105 | 9.24e-10 | 6.73e-10 | 4.43e-10 | 0.00e+00 | 2.86e-09 | 2.41e-06 | 1.09e-05 |
| Pd-107 | 0.00e+00 | 8.27e-08 | 5.87e-09 | 0.00e+00 | 6.57e-07 | 9.47e-06 | 7.06e-07 |
| Pd-109 | 0.00e+00 | 4.63e-10 | 1.16e-10 | 0.00e+00 | 2.35e-09 | 1.85e-06 | 1.52e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ag-110m | 1.35e-06 | 1.25e-06 | 7.43e-07 | 0.00e+00 | 2.46e-06 | 5.79e-04 | 3.78e-05 |
| Ag-111 | 4.25e-08 | 1.78e-08 | 8.87e-09 | 0.00e+00 | 5.74e-08 | 2.33e-05 | 2.79e-05 |
| Cd-113m | 0.00e+00 | 1.54e-04 | 4.97e-06 | 0.00e+00 | 1.71e-04 | 2.08e-04 | 1.59e-05 |
| Cd-115m | 0.00e+00 | 2.46e-05 | 7.95e-07 | 0.00e+00 | 1.98e-05 | 1.76e-04 | 4.80e-05 |
| Sn-123 | 3.02e-05 | 6.67e-07 | 9.82e-07 | 5.67e-07 | 0.00e+00 | 2.88e-04 | 3.92e-05 |
| Sn-125 | 1.16e-06 | 3.12e-08 | 7.03e-08 | 2.59e-08 | 0.00e+00 | 7.37e-05 | 6.81e-05 |
| Sn-126 | 1.58e-04 | 4.18e-06 | 6.00e-06 | 1.23e-06 | 0.00e+00 | 1.17e-03 | 1.59e-05 |
| St-124 | 3.90e-06 | 7.36e-08 | 1.55e-06 | 9.44e-09 | 0.00e+00 | 3.10e-04 | 5.08e-05 |
| St-125 | 6.67e-06 | 7.44e-08 | 1.58e-06 | 6.75e-09 | 0.00e+00 | 2.18e-04 | 1.26e-05 |
| St-126 | 4.50e-07 | 9.13e-09 | 1.62e-07 | 2.75e-09 | 0.00e+00 | 9.57e-05 | 6.01e-05 |
| St-127 | 3.30e-08 | 7.22e-10 | 1.27e-08 | 3.97e-10 | 0.00e+00 | 2.05e-05 | 3.77e-05 |
| Tc-125m | 4.27e-07 | 1.98e-07 | 5.84e-08 | 1.31e-07 | 1.55e-06 | 3.92e-05 | 8.83e-06 |
| Tc-127 | 1.75e-10 | 8.03e-11 | 3.87e-11 | 1.32e-10 | 6.37e-10 | 8.14e-07 | 7.17e-06 |
| Tc-127m | 1.58e-06 | 7.21e-07 | 1.96e-07 | 4.11e-07 | 5.72e-06 | 1.20e-04 | 1.87e-05 |
| Tc-129 | 6.22e-12 | 2.99e-12 | 1.55e-12 | 4.87e-12 | 2.34e-11 | 2.42e-07 | 1.96e-08 |
| Tc-129m | 1.22e-06 | 5.84e-07 | 1.98e-07 | 4.30e-07 | 4.57e-06 | 1.45e-04 | 4.79e-05 |
| Tc-131 | 1.39e-12 | 7.44e-13 | 4.49e-13 | 1.17e-12 | 5.46e-12 | 1.74e-07 | 2.30e-09 |
| Tc-131m | 8.74e-09 | 5.45e-09 | 3.63e-09 | 6.88e-09 | 3.86e-08 | 1.82e-05 | 6.95e-05 |
| Tc-132 | 3.25e-08 | 2.69e-08 | 2.02e-08 | 2.37e-08 | 1.82e-07 | 3.60e-05 | 6.37e-05 |
| Tc-133m | 7.24e-12 | 5.40e-12 | 4.17e-12 | 6.27e-12 | 3.74e-11 | 5.51e-07 | 7.65e-09 |
| Tc-134 | 3.84e-12 | 3.22e-12 | 1.57e-12 | 3.44e-12 | 2.18e-11 | 4.34e-07 | 2.97e-11 |
| I-129 | 2.48e-06 | 2.11e-06 | 6.91e-06 | 5.54e-03 | 4.53e-06 | 0.00e+00 | 2.22e-07 |
| I-130 | 5.72e-07 | 1.68e-06 | 6.60e-07 | 1.42e-04 | 2.61e-06 | 0.00e+00 | 9.61e-07 |
| I-131 | 3.15e-06 | 4.47e-06 | 2.56e-06 | 1.49e-03 | 7.66e-06 | 0.00e+00 | 7.85e-07 |
| I-132 | 1.45e-07 | 4.07e-07 | 1.45e-07 | 1.43e-05 | 6.48e-07 | 0.00e+00 | 5.08e-08 |
| I-133 | 1.08e-06 | 1.85e-06 | 5.65e-07 | 2.69e-04 | 3.23e-06 | 0.00e+00 | 1.11e-06 |
| I-134 | 8.05e-08 | 2.16e-07 | 7.69e-08 | 3.73e-06 | 3.44e-07 | 0.00e+00 | 1.26e-10 |
| I-135 | 3.35e-07 | 8.73e-07 | 3.21e-07 | 5.60e-05 | 1.39e-06 | 0.00e+00 | 6.56e-07 |
| Cs-134 | 4.66e-05 | 1.06e-04 | 9.10e-05 | 0.00e+00 | 3.59e-05 | 1.22e-05 | 1.30e-06 |
| Cs-134m | 1.59e-08 | 3.20e-08 | 1.72e-08 | 0.00e+00 | 1.83e-08 | 2.93e-09 | 7.92e-09 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.46e-05 | 1.29e-05 | 5.99e-06 | 0.00e+00 | 5.11e-06 | 1.57e-06 | 2.11e-07 |
| Cs-136 | 4.88e-06 | 1.83e-05 | 1.38e-05 | 0.00e+00 | 1.07e-05 | 1.50e-06 | 1.46e-06 |
| Cs-137 | 5.98e-05 | 7.76e-05 | 5.35e-05 | 0.00e+00 | 2.78e-05 | 9.40e-06 | 1.05e-06 |
| Cs-138 | 4.14e-08 | 7.76e-08 | 4.05e-08 | 0.00e+00 | 6.00e-08 | 6.07e-09 | 2.33e-13 |
| Cs-139 | 2.56e-08 | 3.63e-08 | 1.39e-08 | 0.00e+00 | 3.05e-08 | 2.84e-09 | 5.49e-31 |
| Ba-139 | 1.17e-10 | 8.32e-14 | 3.42e-12 | 0.00e+00 | 7.78e-14 | 4.70e-07 | 1.12e-07 |
| Ba-140 | 4.88e-06 | 6.13e-09 | 3.21e-07 | 0.00e+00 | 2.09e-09 | 1.59e-04 | 2.73e-05 |
| Ba-141 | 1.25e-11 | 9.41e-15 | 4.20e-13 | 0.00e+00 | 8.75e-15 | 2.42e-07 | 1.45e-17 |
| Ba-142 | 3.29e-12 | 3.38e-15 | 2.07e-13 | 0.00e+00 | 2.86e-15 | 1.49e-07 | 1.96e-26 |
| La-140 | 4.30e-08 | 2.17e-08 | 5.73e-09 | 0.00e+00 | 0.00e+00 | 1.70e-05 | 5.73e-05 |
| La-141 | 5.34e-10 | 1.66e-10 | 2.71e-11 | 0.00e+00 | 0.00e+00 | 1.35e-06 | 7.31e-06 |
| La-142 | 8.54e-11 | 3.88e-11 | 9.65e-12 | 0.00e+00 | 0.00e+00 | 7.91e-07 | 2.64e-07 |
| Ce-141 | 2.49e-06 | 1.69e-06 | 1.91e-07 | 0.00e+00 | 7.83e-07 | 4.52e-05 | 1.50e-05 |
| Ce-143 | 2.33e-08 | 1.72e-08 | 1.91e-09 | 0.00e+00 | 7.60e-09 | 9.97e-06 | 2.83e-05 |
| Ce-144 | 4.29e-04 | 1.79e-04 | 2.30e-05 | 0.00e+00 | 1.06e-04 | 9.72e-04 | 1.02e-04 |
| Pr-143 | 1.17e-06 | 4.69e-07 | 5.80e-08 | 0.00e+00 | 2.70e-07 | 3.51e-05 | 2.50e-05 |
| Pr-144 | 3.76e-12 | 1.56e-12 | 1.91e-13 | 0.00e+00 | 8.81e-13 | 1.27e-07 | 2.69e-18 |
| Nd-147 | 6.59e-07 | 7.62e-07 | 4.56e-08 | 0.00e+00 | 4.45e-07 | 2.76e-05 | 2.16e-05 |
| Pm-147 | 8.37e-05 | 7.87e-06 | 3.19e-06 | 0.00e+00 | 1.49e-05 | 6.60e-05 | 5.54e-06 |
| Pm-148 | 3.84e-07 | 6.37e-08 | 3.20e-08 | 0.00e+00 | 1.20e-07 | 3.91e-05 | 5.80e-05 |
| Pm-148m | 9.82e-06 | 2.54e-06 | 1.94e-06 | 0.00e+00 | 3.85e-06 | 2.14e-04 | 4.18e-05 |
| Pm-149 | 3.44e-08 | 4.87e-09 | 1.99e-09 | 0.00e+00 | 9.19e-09 | 7.21e-06 | 2.50e-05 |
| Pm-151 | 8.50e-09 | 1.42e-09 | 7.21e-10 | 0.00e+00 | 2.55e-09 | 3.94e-06 | 2.00e-05 |
| Sm-151 | 8.59e-05 | 1.48e-05 | 3.55e-06 | 0.00e+00 | 1.66e-05 | 4.45e-05 | 3.25e-06 |
| Sm-153 | 1.70e-08 | 1.42e-08 | 1.04e-09 | 0.00e+00 | 4.59e-09 | 4.14e-06 | 1.58e-05 |
| Eu-152 | 2.38e-04 | 5.41e-05 | 4.76e-05 | 0.00e+00 | 3.35e-04 | 3.43e-04 | 1.59e-05 |
| Eu-154 | 7.40e-04 | 9.10e-05 | 6.48e-05 | 0.00e+00 | 4.36e-04 | 5.84e-04 | 3.40e-05 |
| Eu-155 | 1.01e-04 | 1.43e-05 | 9.21e-06 | 0.00e+00 | 6.59e-05 | 9.46e-05 | 5.95e-06 |
| Eu-156 | 1.93e-06 | 1.48e-06 | 2.40e-07 | 0.00e+00 | 9.95e-07 | 8.56e-05 | 4.50e-05 |
| Tb-160 | 2.21e-05 | 0.00e+00 | 2.75e-06 | 0.00e+00 | 9.10e-06 | 1.92e-04 | 2.68e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ho-166m | 3.37e-04 | 1.05e-04 | 8.00e-05 | 0.00e+00 | 1.57e-04 | 3.94e-04 | 1.59e-05 |
| W-181 | 6.23e-09 | 2.03e-09 | 2.17e-10 | 0.00e+00 | 0.00e+00 | 1.71e-06 | 2.53e-07 |
| W-185 | 1.95e-07 | 6.47e-08 | 6.81e-09 | 0.00e+00 | 0.00e+00 | 5.57e-05 | 1.07e-05 |
| W-187 | 1.06e-09 | 8.85e-10 | 3.10e-10 | 0.00e+00 | 0.00e+00 | 3.63e-06 | 1.94e-05 |
| Pb-210 | 2.64e-02 | 6.73e-03 | 8.37e-04 | 0.00e+00 | 2.12e-02 | 2.62e-02 | 1.51e-06 |
| Bi-210 | 2.31e-07 | 1.59e-06 | 1.32e-07 | 0.00e+00 | 1.92e-05 | 1.11e-03 | 2.95e-05 |
| Po-210 | 3.97e-04 | 8.60e-04 | 9.58e-05 | 0.00e+00 | 2.95e-03 | 3.14e-02 | 4.19e-05 |
| Ra-223 | 1.80e-04 | 2.77e-07 | 3.60e-05 | 0.00e+00 | 7.85e-06 | 2.55e-02 | 2.84e-04 |
| Ra-224 | 1.98e-05 | 4.78e-08 | 3.96e-06 | 0.00e+00 | 1.35e-06 | 8.77e-03 | 3.01e-04 |
| Ra-225 | 3.00e-04 | 3.56e-07 | 5.99e-05 | 0.00e+00 | 1.01e-05 | 2.92e-02 | 2.71e-04 |
| Ra-226 | 1.25e-01 | 2.39e-06 | 9.14e-02 | 0.00e+00 | 6.77e-05 | 1.17e-01 | 2.94e-04 |
| Ra-228 | 4.41e-02 | 1.23e-06 | 4.78e-02 | 0.00e+00 | 3.48e-05 | 1.61e-01 | 5.00e-05 |
| Ac-225 | 4.23e-04 | 5.82e-04 | 2.84e-05 | 0.00e+00 | 6.63e-05 | 2.21e-02 | 2.52e-04 |
| Ac-227 | 2.30e+00 | 3.05e-01 | 1.36e-01 | 0.00e+00 | 9.82e-02 | 2.41e-01 | 5.08e-05 |
| Th-227 | 2.17e-04 | 3.92e-06 | 6.25e-06 | 0.00e+00 | 2.22e-05 | 3.77e-02 | 3.34e-04 |
| Th-228 | 2.00e-01 | 3.39e-03 | 6.77e-03 | 0.00e+00 | 1.89e-02 | 1.01e+00 | 3.49e-04 |
| Th-229 | 1.51e+01 | 4.34e-01 | 2.51e-01 | 0.00e+00 | 2.13e+00 | 3.62e+00 | 4.83e-05 |
| Th-230 | 2.29e+00 | 1.31e-01 | 6.36e-02 | 0.00e+00 | 6.40e-01 | 6.21e-01 | 3.73e-05 |
| Th-232 | 2.56e+00 | 1.12e-01 | 9.04e-04 | 0.00e+00 | 5.47e-01 | 5.96e-01 | 3.17e-05 |
| Th-234 | 1.63e-06 | 9.56e-08 | 4.70e-08 | 0.00e+00 | 5.41e-07 | 1.89e-04 | 7.03e-05 |
| Pa-231 | 5.08e+00 | 1.91e-01 | 1.98e-01 | 0.00e+00 | 1.07e+00 | 5.75e-02 | 4.44e-05 |
| Pa-233 | 1.21e-06 | 2.42e-07 | 2.09e-07 | 0.00e+00 | 9.15e-07 | 3.52e-05 | 1.02e-05 |
| U-232 | 5.14e-02 | 0.00e+00 | 3.66e-03 | 0.00e+00 | 5.56e-03 | 2.22e-01 | 4.21e-05 |
| U-233 | 1.09e-02 | 0.00e+00 | 6.60e-04 | 0.00e+00 | 2.54e-03 | 5.32e-02 | 3.89e-05 |
| U-234 | 1.04e-02 | 0.00e+00 | 6.46e-04 | 0.00e+00 | 2.49e-03 | 5.22e-02 | 3.81e-05 |
| U-235 | 1.00e-02 | 0.00e+00 | 6.07e-04 | 0.00e+00 | 2.34e-03 | 4.90e-02 | 4.84e-05 |
| U-236 | 1.00e-02 | 0.00e+00 | 6.20e-04 | 0.00e+00 | 2.39e-03 | 5.00e-02 | 3.57e-05 |
| U-237 | 3.67e-08 | 0.00e+00 | 9.77e-09 | 0.00e+00 | 1.51e-07 | 1.02e-05 | 1.20e-05 |
| U-238 | 9.58e-03 | 0.00e+00 | 5.67e-04 | 0.00e+00 | 2.18e-03 | 4.58e-02 | 3.41e-05 |
| Np-237 | 1.56e+00 | 1.00e+00 | 6.87e-02 | 0.00e+00 | 5.10e-01 | 5.22e-02 | 4.92e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 2.96e-07 | 7.20e-08 | 4.61e-09 | 0.00e+00 | 2.72e-08 | 1.02e-05 | 2.13e-05 |
| Np-239 | 2.87e-08 | 2.54e-08 | 1.55e-09 | 0.00e+00 | 8.75e-09 | 4.70e-06 | 1.49e-05 |
| Pu-238 | 1.43e+00 | 9.71e-01 | 6.90e-02 | 0.00e+00 | 2.96e-01 | 1.82e-01 | 4.52e-05 |
| Pu-239 | 1.66e+00 | 1.07e+00 | 7.75e-02 | 0.00e+00 | 3.30e-01 | 1.72e-01 | 4.13e-05 |
| Pu-240 | 1.65e+00 | 1.07e+00 | 7.73e-02 | 0.00e+00 | 3.29e-01 | 1.72e-01 | 4.21e-05 |
| Pu-241 | 3.42e-02 | 8.69e-03 | 1.29e-03 | 0.00e+00 | 5.93e-03 | 1.52e-04 | 8.65e-07 |
| Pu-242 | 1.53e+00 | 1.03e+00 | 7.46e-02 | 0.00e+00 | 3.17e-01 | 1.65e-01 | 4.05e-05 |
| Pu-244 | 1.79e+00 | 1.18e+00 | 8.54e-02 | 0.00e+00 | 3.64e-01 | 1.89e-01 | 6.03e-05 |
| Am-241 | 1.68e+00 | 1.13e+00 | 6.71e-02 | 0.00e+00 | 5.04e-01 | 6.06e-02 | 4.60e-05 |
| Am-242m | 1.70e+00 | 1.06e+00 | 6.73e-02 | 0.00e+00 | 5.01e-01 | 2.44e-02 | 5.79e-05 |
| Am-243 | 1.68e+00 | 1.10e+00 | 6.57e-02 | 0.00e+00 | 4.95e-01 | 5.75e-02 | 5.40e-05 |
| Cm-242 | 2.22e-02 | 1.77e-02 | 9.84e-04 | 0.00e+00 | 4.48e-03 | 3.92e-02 | 4.91e-05 |
| Cm-243 | 1.10e+00 | 7.61e-01 | 4.61e-02 | 0.00e+00 | 2.15e-01 | 6.31e-02 | 4.84e-05 |
| Cm-244 | 8.37e-01 | 5.88e-01 | 3.51e-02 | 0.00e+00 | 1.64e-01 | 6.06e-02 | 4.68e-05 |
| Cm-245 | 1.74e+00 | 1.14e+00 | 7.14e-02 | 0.00e+00 | 3.33e-01 | 5.85e-02 | 4.36e-05 |
| Cm-246 | 1.73e+00 | 1.14e+00 | 7.13e-02 | 0.00e+00 | 3.33e-01 | 5.96e-02 | 4.29e-05 |
| Cm-247 | 1.68e+00 | 1.12e+00 | 7.03e-02 | 0.00e+00 | 3.28e-01 | 5.85e-02 | 5.63e-05 |
| Cm-248 | 1.40e+01 | 9.26e+00 | 5.79e-01 | 0.00e+00 | 2.70e+00 | 4.82e-01 | 9.09e-04 |
| Cf-252 | 5.43e-01 | 0.00e+00 | 2.33e-02 | 0.00e+00 | 0.00e+00 | 1.99e-01 | 1.78e-04 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| H-3 | 0.00e+00 | 9.06e-08 | 9.06e-08 | 9.06e-08 | 9.06e-08 | 9.06e-08 | 9.06e-08 |
| Be-10 | 2.78e-04 | 4.33e-05 | 7.09e-06 | 0.00e+00 | 0.00e+00 | 3.84e-04 | 1.77e-05 |
| C-14 | 3.25e-06 | 6.09e-07 | 6.09e-07 | 6.09e-07 | 6.09e-07 | 6.09e-07 | 6.09e-07 |
| N-13 | 8.65e-09 | 8.65e-09 | 8.65e-09 | 8.65e-09 | 8.65e-09 | 8.65e-09 | 8.65e-09 |
| F-18 | 6.52e-07 | 0.00e+00 | 7.10e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.89e-08 |
| Na-22 | 1.76e-05 | 1.76e-05 | 1.76e-05 | 1.76e-05 | 1.76e-05 | 1.76e-05 | 1.76e-05 |
| Na-24 | 1.72e-06 | 1.72e-06 | 1.72e-06 | 1.72e-06 | 1.72e-06 | 1.72e-06 | 1.72e-06 |
| P-32 | 2.36e-04 | 1.37e-05 | 8.95e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.16e-05 |
| Ca-41 | 4.05e-05 | 0.00e+00 | 4.38e-06 | 0.00e+00 | 0.00e+00 | 1.01e-01 | 3.03e-07 |
| Sc-46 | 7.24e-05 | 1.41e-04 | 4.18e-05 | 0.00e+00 | 1.35e-04 | 0.00e+00 | 2.98e-05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.69e-08 | 9.37e-09 | 3.84e-09 | 2.62e-06 | 3.75e-07 |
| Mn-54 | 0.00e+00 | 6.39e-06 | 1.05e-06 | 0.00e+00 | 1.59e-06 | 2.48e-04 | 8.35e-06 |
| Mn-56 | 0.00e+00 | 2.12e-10 | 3.15e-11 | 0.00e+00 | 2.24e-10 | 1.90e-06 | 7.18e-06 |
| Fe-55 | 4.18e-06 | 2.98e-06 | 6.93e-07 | 0.00e+00 | 0.00e+00 | 1.55e-05 | 7.99e-07 |
| Fe-59 | 1.99e-06 | 4.62e-06 | 1.79e-06 | 0.00e+00 | 0.00e+00 | 1.91e-04 | 2.23e-05 |
| Co-57 | 0.00e+00 | 1.18e-07 | 1.15e-07 | 0.00e+00 | 0.00e+00 | 7.33e-05 | 3.93e-06 |
| Co-58 | 0.00e+00 | 2.59e-07 | 3.47e-07 | 0.00e+00 | 0.00e+00 | 1.68e-04 | 1.19e-05 |
| Co-60 | 0.00e+00 | 1.89e-06 | 2.48e-06 | 0.00e+00 | 0.00e+00 | 1.09e-03 | 3.24e-05 |
| Ni-59 | 5.44e-06 | 2.02e-06 | 9.24e-07 | 0.00e+00 | 0.00e+00 | 1.41e-05 | 6.48e-07 |
| Ni-63 | 7.25e-05 | 5.43e-06 | 2.47e-06 | 0.00e+00 | 0.00e+00 | 3.84e-05 | 1.77e-06 |
| Ni-65 | 2.73e-10 | 3.66e-11 | 1.59e-11 | 0.00e+00 | 0.00e+00 | 1.17e-06 | 4.59e-06 |
| Cu-64 | 0.00e+00 | 2.54e-10 | 1.06e-10 | 0.00e+00 | 8.01e-10 | 1.39e-06 | 7.68e-06 |
| Zn-65 | 4.82e-06 | 1.67e-05 | 7.80e-06 | 0.00e+00 | 1.08e-05 | 1.55e-04 | 5.83e-06 |
| Zn-69 | 6.04e-12 | 1.15e-11 | 8.07e-13 | 0.00e+00 | 7.53e-12 | 1.98e-07 | 3.56e-08 |
| Zn-69m | 1.44e-09 | 3.39e-09 | 3.11e-10 | 0.00e+00 | 2.06e-09 | 3.92e-06 | 2.14e-05 |
| Se-79 | 0.00e+00 | 5.43e-07 | 8.71e-08 | 0.00e+00 | 8.13e-07 | 7.71e-05 | 3.53e-06 |
| Br-82 | 0.00e+00 | 0.00e+00 | 2.28e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 4.30e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 5.41e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 2.29e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.38e-05 | 1.05e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.21e-06 |
| Rb-87 | 0.00e+00 | 1.40e-05 | 4.58e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.05e-07 |
| Rb-88 | 0.00e+00 | 6.82e-08 | 3.40e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.65e-15 |
| Rb-89 | 0.00e+00 | 4.40e-08 | 2.91e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.22e-17 |
| Sr-89 | 5.43e-05 | 0.00e+00 | 1.56e-06 | 0.00e+00 | 0.00e+00 | 3.02e-04 | 4.64e-05 |
| Sr-90 | 4.14e-03 | 0.00e+00 | 8.33e-05 | 0.00e+00 | 0.00e+00 | 2.06e-03 | 9.56e-05 |
| Sr-91 | 1.10e-08 | 0.00e+00 | 4.39e-10 | 0.00e+00 | 0.00e+00 | 7.59e-06 | 3.24e-05 |
| Sr-92 | 1.19e-09 | 0.00e+00 | 5.08e-11 | 0.00e+00 | 0.00e+00 | 3.43e-06 | 1.49e-05 |
| Y-90 | 3.73e-07 | 0.00e+00 | 1.00e-08 | 0.00e+00 | 0.00e+00 | 3.66e-05 | 6.99e-05 |
| Y-91 | 8.26e-05 | 0.00e+00 | 2.21e-06 | 0.00e+00 | 0.00e+00 | 3.67e-04 | 5.11e-05 |
| Y-91m | 4.63e-11 | 0.00e+00 | 1.77e-12 | 0.00e+00 | 0.00e+00 | 4.00e-07 | 3.77e-09 |
| Y-92 | 1.84e-09 | 0.00e+00 | 5.36e-11 | 0.00e+00 | 0.00e+00 | 3.35e-06 | 2.06e-05 |
| Y-93 | 1.69e-08 | 0.00e+00 | 4.65e-10 | 0.00e+00 | 0.00e+00 | 1.04e-05 | 7.24e-05 |
| Zr-93 | 6.83e-05 | 3.38e-06 | 1.84e-06 | 0.00e+00 | 1.16e-05 | 3.67e-05 | 1.60e-06 |
| Zr-95 | 1.82e-05 | 5.73e-06 | 3.94e-06 | 0.00e+00 | 8.42e-06 | 3.36e-04 | 1.86e-05 |
| Zr-97 | 1.72e-08 | 3.40e-09 | 1.57e-09 | 0.00e+00 | 5.15e-09 | 1.62e-05 | 7.88e-05 |
| Nb-93m | 4.14e-05 | 1.36e-05 | 3.41e-06 | 0.00e+00 | 1.59e-05 | 5.36e-05 | 2.52e-06 |
| Nb-95 | 2.32e-06 | 1.29e-06 | 7.08e-07 | 0.00e+00 | 1.25e-06 | 9.39e-05 | 1.21e-05 |
| Nb-97 | 3.92e-11 | 9.72e-12 | 3.55e-12 | 0.00e+00 | 1.14e-11 | 4.91e-07 | 2.71e-07 |
| Mo-93 | 0.00e+00 | 1.66e-06 | 4.52e-08 | 0.00e+00 | 5.06e-07 | 8.81e-05 | 3.99e-06 |
| Mo-99 | 0.00e+00 | 2.11e-08 | 4.03e-09 | 0.00e+00 | 5.14e-08 | 1.92e-05 | 3.36e-05 |
| Tc-101 | 7.40e-15 | 1.05e-14 | 1.03e-13 | 0.00e+00 | 1.90e-13 | 8.34e-08 | 1.09e-16 |
| Tc-99 | 4.48e-08 | 6.58e-08 | 1.79e-08 | 0.00e+00 | 8.35e-07 | 1.74e-04 | 7.99e-06 |
| Tc-99m | 1.73e-13 | 4.83e-13 | 6.24e-12 | 0.00e+00 | 7.20e-12 | 1.44e-07 | 7.66e-07 |
| Ru-103 | 2.63e-07 | 0.00e+00 | 1.12e-07 | 0.00e+00 | 9.29e-07 | 9.79e-05 | 1.36e-05 |
| Ru-105 | 1.40e-10 | 0.00e+00 | 5.42e-11 | 0.00e+00 | 1.76e-10 | 2.27e-06 | 1.13e-05 |
| Ru-106 | 1.23e-05 | 0.00e+00 | 1.55e-06 | 0.00e+00 | 2.38e-05 | 2.01e-03 | 1.20e-04 |
| Rh-105 | 1.32e-09 | 9.48e-10 | 6.24e-10 | 0.00e+00 | 4.04e-09 | 4.09e-06 | 1.23e-05 |
| Pd-107 | 0.00e+00 | 1.17e-07 | 8.39e-09 | 0.00e+00 | 9.39e-07 | 1.63e-05 | 7.49e-07 |
| Pd-109 | 0.00e+00 | 6.56e-10 | 1.66e-10 | 0.00e+00 | 3.36e-09 | 3.19e-06 | 1.96e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ag-110m | 1.73e-06 | 1.64e-06 | 9.99e-07 | 0.00e+00 | 3.13e-06 | 8.44e-04 | 3.41e-05 |
| Ag-111 | 6.07e-08 | 2.52e-08 | 1.26e-08 | 0.00e+00 | 8.17e-08 | 4.00e-05 | 3.00e-05 |
| Cd-113m | 0.00e+00 | 2.17e-04 | 7.10e-06 | 0.00e+00 | 2.43e-04 | 3.59e-04 | 1.68e-05 |
| Cd-115m | 0.00e+00 | 3.48e-05 | 1.14e-06 | 0.00e+00 | 2.82e-05 | 3.03e-04 | 5.10e-05 |
| Sn-123 | 4.31e-05 | 9.44e-07 | 1.40e-06 | 7.55e-07 | 0.00e+00 | 4.96e-04 | 4.16e-05 |
| Sn-125 | 1.66e-06 | 4.42e-08 | 9.99e-08 | 3.45e-08 | 0.00e+00 | 1.26e-04 | 7.29e-05 |
| Sn-126 | 2.18e-04 | 5.39e-06 | 8.24e-06 | 1.42e-06 | 0.00e+00 | 1.72e-03 | 1.68e-05 |
| St-124 | 5.38e-06 | 9.92e-08 | 2.10e-06 | 1.22e-08 | 0.00e+00 | 4.81e-04 | 4.98e-05 |
| St-125 | 9.23e-06 | 1.01e-07 | 2.15e-06 | 8.80e-09 | 0.00e+00 | 3.42e-04 | 1.24e-05 |
| St-126 | 6.19e-07 | 1.27e-08 | 2.23e-07 | 3.50e-09 | 0.00e+00 | 1.55e-04 | 6.01e-05 |
| St-127 | 4.64e-08 | 9.92e-10 | 1.75e-08 | 5.21e-10 | 0.00e+00 | 3.31e-05 | 3.94e-05 |
| Te-125m | 6.10e-07 | 2.80e-07 | 8.34e-08 | 1.75e-07 | 0.00e+00 | 6.70e-05 | 9.38e-06 |
| Te-127 | 2.51e-10 | 1.14e-10 | 5.52e-11 | 1.77e-10 | 9.10e-10 | 1.40e-06 | 1.01e-05 |
| Te-127m | 2.25e-06 | 1.02e-06 | 2.73e-07 | 5.48e-07 | 8.17e-06 | 2.07e-04 | 1.99e-05 |
| Te-129 | 8.87e-12 | 4.22e-12 | 2.20e-12 | 6.48e-12 | 3.32e-11 | 4.12e-07 | 2.02e-07 |
| Te-129m | 1.74e-06 | 8.23e-07 | 2.81e-07 | 5.72e-07 | 6.49e-06 | 2.47e-04 | 5.06e-05 |
| Te-131 | 1.97e-12 | 1.04e-12 | 6.30e-13 | 1.55e-12 | 7.72e-12 | 2.92e-07 | 1.89e-09 |
| Te-131m | 1.23e-08 | 7.51e-09 | 5.03e-09 | 9.06e-09 | 5.49e-08 | 2.97e-05 | 7.76e-05 |
| Te-132 | 4.50e-08 | 3.63e-08 | 2.74e-08 | 3.07e-08 | 2.44e-07 | 5.61e-05 | 5.79e-05 |
| Te-133m | 1.01e-11 | 7.33e-12 | 5.71e-12 | 8.18e-12 | 5.07e-11 | 8.71e-07 | 1.23e-07 |
| Te-134 | 5.31e-12 | 4.35e-12 | 3.64e-12 | 4.46e-12 | 2.91e-11 | 6.75e-07 | 1.37e-09 |
| I-129 | 3.53e-06 | 2.94e-06 | 4.90e-06 | 3.66e-03 | 5.26e-06 | 0.00e+00 | 2.29e-07 |
| I-130 | 7.80e-07 | 2.24e-06 | 8.96e-07 | 1.86e-04 | 3.44e-06 | 0.00e+00 | 1.14e-06 |
| I-131 | 4.43e-06 | 6.14e-06 | 3.30e-06 | 1.83e-03 | 1.05e-05 | 0.00e+00 | 8.11e-07 |
| I-132 | 1.99e-07 | 5.47e-07 | 1.97e-07 | 1.89e-05 | 8.65e-07 | 0.00e+00 | 1.59e-07 |
| I-133 | 1.52e-06 | 2.56e-06 | 7.78e-07 | 3.65e-04 | 4.49e-06 | 0.00e+00 | 1.29e-06 |
| I-134 | 1.11e-07 | 2.90e-07 | 1.05e-07 | 4.94e-06 | 4.58e-07 | 0.00e+00 | 2.55e-09 |
| I-135 | 4.62e-07 | 1.18e-06 | 4.36e-07 | 7.76e-05 | 1.86e-06 | 0.00e+00 | 8.69e-07 |
| Cs-134 | 6.28e-05 | 1.41e-04 | 6.86e-05 | 0.00e+00 | 4.69e-05 | 1.83e-05 | 1.22e-06 |
| Cs-134m | 2.20e-08 | 4.35e-08 | 2.35e-08 | 0.00e+00 | 2.54e-08 | 4.56e-09 | 2.02e-08 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Cs-135 | 2.08e-05 | 1.82e-05 | 4.47e-06 | 0.00e+00 | 7.30e-06 | 2.70e-06 | 2.23e-07 |
| Cs-136 | 6.44e-06 | 2.42e-05 | 1.71e-05 | 0.00e+00 | 1.38e-05 | 2.22e-06 | 1.36e-06 |
| Cs-137 | 8.38e-05 | 1.06e-04 | 3.89e-05 | 0.00e+00 | 3.80e-05 | 1.51e-05 | 1.06e-06 |
| Cs-138 | 5.82e-08 | 1.07e-07 | 5.58e-08 | 0.00e+00 | 8.28e-08 | 9.84e-09 | 3.38e-11 |
| Cs-139 | 3.65e-08 | 5.12e-08 | 1.97e-08 | 0.00e+00 | 4.34e-08 | 4.86e-09 | 1.66e-23 |
| Ba-139 | 1.67e-10 | 1.18e-13 | 4.87e-12 | 0.00e+00 | 1.11e-13 | 8.08e-07 | 8.06e-07 |
| Ba-140 | 6.84e-06 | 8.38e-09 | 4.40e-07 | 0.00e+00 | 2.85e-09 | 2.54e-04 | 2.86e-05 |
| Ba-141 | 1.78e-11 | 1.32e-14 | 5.93e-13 | 0.00e+00 | 1.23e-14 | 4.11e-07 | 9.33e-14 |
| Ba-142 | 4.62e-12 | 4.63e-15 | 2.84e-13 | 0.00e+00 | 3.92e-15 | 2.39e-07 | 5.99e-20 |
| La-140 | 5.99e-08 | 2.95e-08 | 7.82e-09 | 0.00e+00 | 0.00e+00 | 2.68e-05 | 6.09e-05 |
| La-141 | 7.63e-10 | 2.35e-10 | 3.87e-11 | 0.00e+00 | 0.00e+00 | 2.31e-06 | 1.54e-05 |
| La-142 | 1.20e-10 | 5.31e-11 | 1.32e-11 | 0.00e+00 | 0.00e+00 | 1.27e-06 | 1.50e-06 |
| Ce-141 | 3.55e-06 | 2.37e-06 | 2.71e-07 | 0.00e+00 | 1.11e-06 | 7.67e-05 | 1.58e-05 |
| Ce-143 | 3.32e-08 | 2.42e-08 | 2.70e-09 | 0.00e+00 | 1.08e-08 | 1.63e-05 | 3.19e-05 |
| Ce-144 | 6.11e-04 | 2.53e-04 | 3.28e-05 | 0.00e+00 | 1.51e-04 | 1.67e-03 | 1.08e-04 |
| Pr-143 | 1.67e-06 | 6.64e-07 | 8.28e-08 | 0.00e+00 | 3.86e-07 | 6.04e-05 | 2.67e-05 |
| Pr-144 | 5.37e-12 | 2.20e-12 | 2.72e-13 | 0.00e+00 | 1.26e-12 | 2.19e-07 | 2.94e-14 |
| Nd-147 | 9.83e-07 | 1.07e-06 | 6.41e-08 | 0.00e+00 | 6.28e-07 | 4.65e-05 | 2.28e-05 |
| Pm-147 | 1.15e-04 | 1.10e-05 | 4.50e-06 | 0.00e+00 | 2.10e-05 | 1.14e-04 | 5.87e-06 |
| Pm-148 | 5.44e-07 | 8.88e-08 | 4.48e-08 | 0.00e+00 | 1.60e-07 | 6.52e-05 | 6.14e-05 |
| Pm-148m | 1.32e-05 | 3.35e-06 | 2.62e-06 | 0.00e+00 | 5.07e-06 | 3.20e-04 | 4.10e-05 |
| Pm-149 | 4.91e-08 | 6.89e-09 | 2.84e-09 | 0.00e+00 | 1.31e-08 | 1.24e-05 | 2.79e-05 |
| Pm-151 | 1.20e-08 | 1.99e-09 | 1.01e-09 | 0.00e+00 | 3.57e-09 | 6.56e-06 | 2.27e-05 |
| Sm-151 | 1.07e-04 | 2.10e-05 | 4.86e-06 | 0.00e+00 | 2.27e-05 | 7.68e-05 | 3.53e-06 |
| Sm-153 | 2.43e-08 | 2.01e-08 | 1.47e-09 | 0.00e+00 | 6.56e-09 | 7.11e-06 | 1.77e-05 |
| Eu-152 | 2.96e-04 | 7.19e-05 | 6.30e-05 | 0.00e+00 | 3.34e-04 | 5.01e-04 | 1.35e-05 |
| Eu-154 | 9.43e-04 | 1.23e-04 | 8.60e-05 | 0.00e+00 | 5.44e-04 | 9.12e-04 | 3.34e-05 |
| Eu-155 | 2.00e-04 | 1.96e-05 | 1.21e-05 | 0.00e+00 | 7.65e-05 | 1.51e-03 | 5.97e-05 |
| Eu-156 | 2.70e-06 | 2.03e-06 | 3.30e-07 | 0.00e+00 | 1.36e-06 | 1.37e-04 | 4.56e-05 |
| Tb-160 | 3.04e-05 | 0.00e+00 | 3.79e-06 | 0.00e+00 | 1.20e-05 | 2.97e-04 | 2.60e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Hc-166m | 4.40e-04 | 1.36e-04 | 9.87e-05 | 0.00e+00 | 2.00e-04 | 6.24e-04 | 1.68e-05 |
| W-181 | 8.90e-09 | 2.88e-09 | 3.01e-10 | 0.00e+00 | 0.00e+00 | 2.95e-06 | 2.69e-07 |
| W-185 | 2.78e-07 | 9.17e-08 | 9.73e-09 | 0.00e+00 | 0.00e+00 | 9.60e-05 | 1.14e-05 |
| W-187 | 1.50e-09 | 1.22e-09 | 4.29e-10 | 0.00e+00 | 0.00e+00 | 5.92e-06 | 2.21e-05 |
| Pb-210 | 3.09e-02 | 8.28e-03 | 1.07e-03 | 0.00e+00 | 2.95e-02 | 4.52e-02 | 1.60e-06 |
| Bi-210 | 3.30e-07 | 2.26e-06 | 1.89e-07 | 0.00e+00 | 2.74e-05 | 1.91e-03 | 3.19e-05 |
| Po-210 | 5.68e-04 | 1.22e-03 | 1.37e-04 | 0.00e+00 | 4.21e-03 | 5.41e-02 | 4.45e-05 |
| Ra-223 | 2.57e-04 | 3.93e-07 | 5.14e-05 | 0.00e+00 | 1.12e-05 | 4.39e-02 | 3.04e-04 |
| Ra-224 | 2.83e-05 | 6.77e-08 | 5.65e-06 | 0.00e+00 | 1.93e-06 | 1.51e-02 | 3.29e-04 |
| Ra-225 | 4.28e-04 | 5.04e-07 | 8.56e-05 | 0.00e+00 | 1.44e-05 | 5.04e-02 | 2.89e-04 |
| Ra-226 | 1.33e-01 | 3.38e-06 | 9.87e-02 | 0.00e+00 | 9.67e-05 | 2.02e-01 | 3.11e-04 |
| Ra-228 | 5.34e-02 | 1.74e-06 | 5.88e-02 | 0.00e+00 | 4.97e-05 | 2.78e-01 | 5.30e-05 |
| Ac-225 | 6.04e-04 | 8.25e-04 | 4.06e-05 | 0.00e+00 | 9.47e-05 | 3.81e-02 | 2.70e-04 |
| Ac-227 | 2.49e+00 | 3.69e-01 | 1.48e-01 | 0.00e+00 | 1.07e-01 | 4.16e-01 | 5.38e-05 |
| Th-227 | 3.09e-04 | 5.56e-06 | 8.93e-06 | 0.00e+00 | 3.18e-05 | 6.50e-02 | 3.57e-04 |
| Th-228 | 2.60e-01 | 4.37e-03 | 8.78e-03 | 0.00e+00 | 2.45e-02 | 1.69e+00 | 3.70e-04 |
| Th-229 | 1.54e+01 | 4.44e-01 | 2.56e-01 | 0.00e+00 | 2.18e+00 | 5.24e+00 | 5.12e-05 |
| Th-230 | 2.34e+00 | 1.34e-01 | 6.49e-02 | 0.00e+00 | 6.55e-01 | 8.98e-01 | 3.95e-05 |
| Th-232 | 2.61e+00 | 1.14e-01 | 9.21e-04 | 0.00e+00 | 5.60e-01 | 8.60e-01 | 3.36e-05 |
| Th-234 | 2.32e-06 | 1.35e-07 | 6.71e-08 | 0.00e+00 | 7.73e-07 | 3.26e-04 | 7.49e-05 |
| Pa-231 | 5.32e+00 | 2.00e-01 | 2.07e-01 | 0.00e+00 | 1.12e+00 | 9.91e-02 | 4.71e-05 |
| Pa-233 | 1.68e-06 | 3.24e-07 | 2.89e-07 | 0.00e+00 | 1.22e-06 | 5.39e-05 | 1.00e-05 |
| U-232 | 7.31e-02 | 0.00e+00 | 5.23e-03 | 0.00e+00 | 7.94e-03 | 3.84e-01 | 4.46e-05 |
| U-233 | 1.55e-02 | 0.00e+00 | 9.42e-04 | 0.00e+00 | 3.63e-03 | 9.18e-02 | 4.12e-05 |
| U-234 | 1.48e-02 | 0.00e+00 | 9.23e-04 | 0.00e+00 | 3.55e-03 | 8.99e-02 | 4.04e-05 |
| U-235 | 1.42e-02 | 0.00e+00 | 8.67e-04 | 0.00e+00 | 3.34e-03 | 8.44e-02 | 5.13e-05 |
| U-236 | 1.42e-02 | 0.00e+00 | 8.86e-04 | 0.00e+00 | 3.41e-03 | 8.62e-02 | 3.79e-05 |
| U-237 | 5.25e-08 | 0.00e+00 | 1.40e-08 | 0.00e+00 | 2.16e-07 | 1.76e-05 | 1.29e-05 |
| U-238 | 1.36e-02 | 0.00e+00 | 8.10e-04 | 0.00e+00 | 3.12e-03 | 7.89e-02 | 3.62e-05 |
| Np-237 | 1.64e+00 | 1.06e+00 | 7.21e-02 | 0.00e+00 | 5.35e-01 | 8.99e-02 | 5.22e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 4.23e-07 | 1.02e-07 | 6.59e-09 | 0.00e+00 | 3.88e-08 | 1.75e-05 | 2.38e-05 |
| Np-239 | 4.23e-08 | 3.60e-08 | 2.21e-09 | 0.00e+00 | 1.25e-08 | 8.11e-06 | 1.65e-05 |
| Pu-238 | 1.50e+00 | 1.03e+00 | 7.22e-02 | 0.00e+00 | 3.10e-01 | 3.12e-01 | 4.79e-05 |
| Pu-239 | 1.73e+00 | 1.12e+00 | 8.05e-02 | 0.00e+00 | 3.44e-01 | 2.93e-01 | 4.37e-05 |
| Pu-240 | 1.72e+00 | 1.12e+00 | 8.04e-02 | 0.00e+00 | 3.43e-01 | 2.93e-01 | 4.46e-05 |
| Pu-241 | 3.74e-02 | 9.56e-03 | 1.40e-03 | 0.00e+00 | 6.47e-03 | 2.60e-04 | 9.17e-07 |
| Pu-242 | 1.60e+00 | 1.08e+00 | 7.75e-02 | 0.00e+00 | 3.31e-01 | 2.82e-01 | 4.29e-05 |
| Pu-244 | 1.87e+00 | 1.24e+00 | 8.88e-02 | 0.00e+00 | 3.79e-01 | 3.23e-01 | 6.39e-05 |
| Am-241 | 1.77e+00 | 1.20e+00 | 7.10e-02 | 0.00e+00 | 5.32e-01 | 1.05e-01 | 4.88e-05 |
| Am-242m | 1.79e+00 | 1.13e+00 | 7.15e-02 | 0.00e+00 | 5.30e-01 | 4.21e-02 | 6.14e-05 |
| Am-243 | 1.77e+00 | 1.17e+00 | 6.95e-02 | 0.00e+00 | 5.21e-01 | 9.91e-02 | 5.72e-05 |
| Cm-242 | 3.17e-02 | 2.51e-02 | 1.41e-03 | 0.00e+00 | 6.40e-03 | 6.76e-02 | 5.21e-05 |
| Cm-243 | 1.19e+00 | 8.30e-01 | 5.00e-02 | 0.00e+00 | 2.34e-01 | 1.09e-01 | 5.13e-05 |
| Cm-244 | 9.19e-01 | 6.53e-01 | 3.88e-02 | 0.00e+00 | 1.81e-01 | 1.05e-01 | 4.96e-05 |
| Cm-245 | 1.83e+00 | 1.22e+00 | 7.53e-02 | 0.00e+00 | 3.52e-01 | 1.01e-01 | 4.63e-05 |
| Cm-246 | 1.81e+00 | 1.22e+00 | 7.52e-02 | 0.00e+00 | 3.51e-01 | 1.03e-01 | 4.54e-05 |
| Cm-247 | 1.77e+00 | 1.19e+00 | 7.41e-02 | 0.00e+00 | 3.46e-01 | 1.01e-01 | 5.97e-05 |
| Cm-248 | 1.47e+01 | 9.83e+00 | 6.11e-01 | 0.00e+00 | 2.85e+00 | 8.32e-01 | 9.63e-04 |
| Cf-252 | 7.16e-01 | 0.00e+00 | 3.07e-02 | 0.00e+00 | 0.00e+00 | 3.43e-01 | 1.89e-04 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| H-3 | 0.00e+00 | 1.73e-07 | 1.73e-07 | 1.73e-07 | 1.73e-07 | 1.73e-07 | 1.73e-07 |
| Be-10 | 8.43e-04 | 9.83e-05 | 2.12e-05 | 0.00e+00 | 0.00e+00 | 7.41e-04 | 1.72e-05 |
| C-14 | 9.70e-06 | 1.82e-06 | 1.82e-06 | 1.82e-06 | 1.82e-06 | 1.82e-06 | 1.82e-06 |
| N-13 | 2.33e-08 | 2.33e-08 | 2.33e-08 | 2.33e-08 | 2.33e-08 | 2.33e-08 | 2.33e-08 |
| F-18 | 1.88e-06 | 0.00e+00 | 1.85e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.37e-07 |
| Na-22 | 4.41e-05 | 4.41e-05 | 4.41e-05 | 4.41e-05 | 4.41e-05 | 4.41e-05 | 4.41e-05 |
| Na-24 | 4.35e-06 | 4.35e-06 | 4.35e-06 | 4.35e-06 | 4.35e-06 | 4.35e-06 | 4.35e-06 |
| P-32 | 7.04e-04 | 3.09e-05 | 2.67e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.14e-05 |
| Ca-41 | 7.06e-05 | 0.00e+00 | 7.70e-06 | 0.00e+00 | 0.00e+00 | 7.21e-02 | 2.94e-07 |
| Sc-46 | 1.97e-04 | 2.70e-04 | 1.04e-04 | 0.00e+00 | 2.39e-04 | 0.00e+00 | 2.45e-05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 4.17e-08 | 2.31e-08 | 6.57e-09 | 4.59e-06 | 2.93e-07 |
| Mn-54 | 0.00e+00 | 1.16e-05 | 2.57e-06 | 0.00e+00 | 2.71e-06 | 4.26e-04 | 6.19e-06 |
| Mn-56 | 0.00e+00 | 4.48e-10 | 8.43e-11 | 0.00e+00 | 4.52e-10 | 3.55e-06 | 3.33e-05 |
| Fe-55 | 1.28e-05 | 6.80e-06 | 2.10e-06 | 0.00e+00 | 0.00e+00 | 3.00e-05 | 7.75e-07 |
| Fe-59 | 5.59e-06 | 9.04e-06 | 4.51e-06 | 0.00e+00 | 0.00e+00 | 3.43e-04 | 1.91e-05 |
| Co-57 | 0.00e+00 | 2.44e-07 | 2.88e-07 | 0.00e+00 | 0.00e+00 | 1.37e-04 | 3.58e-06 |
| Co-58 | 0.00e+00 | 4.79e-07 | 8.55e-07 | 0.00e+00 | 0.00e+00 | 2.99e-04 | 9.29e-06 |
| Co-60 | 0.00e+00 | 3.55e-06 | 6.12e-06 | 0.00e+00 | 0.00e+00 | 1.91e-03 | 2.60e-05 |
| Ni-59 | 1.66e-05 | 4.67e-06 | 2.83e-06 | 0.00e+00 | 0.00e+00 | 2.73e-05 | 6.29e-07 |
| Ni-63 | 2.22e-04 | 1.25e-05 | 7.56e-06 | 0.00e+00 | 0.00e+00 | 7.43e-05 | 1.71e-06 |
| Ni-65 | 8.08e-10 | 7.99e-11 | 4.44e-11 | 0.00e+00 | 0.00e+00 | 2.21e-06 | 2.27e-05 |
| Cu-64 | 0.00e+00 | 5.39e-10 | 2.90e-10 | 0.00e+00 | 1.63e-09 | 2.59e-06 | 9.92e-06 |
| Zn-65 | 1.15e-05 | 3.06e-05 | 1.90e-05 | 0.00e+00 | 1.93e-05 | 2.69e-04 | 4.41e-06 |
| Zn-69 | 1.81e-11 | 2.61e-11 | 2.41e-12 | 0.00e+00 | 1.58e-11 | 3.84e-07 | 2.75e-06 |
| Zn-69m | 4.26e-09 | 7.28e-09 | 8.59e-10 | 0.00e+00 | 4.22e-09 | 7.36e-06 | 2.71e-05 |
| Se-79 | 0.00e+00 | 1.23e-06 | 2.60e-07 | 0.00e+00 | 1.71e-06 | 1.49e-04 | 3.43e-06 |
| Br-82 | 0.00e+00 | 0.00e+00 | 5.66e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 1.28e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 1.48e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 6.84e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Rb-86 | 0.00e+00 | 5.36e-05 | 3.09e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.16e-06 |
| Rb-87 | 0.00e+00 | 3.16e-05 | 1.37e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.96e-07 |
| Rb-88 | 0.00e+00 | 1.52e-07 | 9.90e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.66e-09 |
| Rb-89 | 0.00e+00 | 9.33e-08 | 7.83e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.11e-10 |
| Sr-89 | 1.62e-04 | 0.00e+00 | 4.66e-06 | 0.00e+00 | 0.00e+00 | 5.83e-04 | 4.52e-05 |
| Sr-90 | 1.04e-02 | 0.00e+00 | 2.07e-04 | 0.00e+00 | 0.00e+00 | 3.99e-03 | 9.28e-05 |
| Sr-91 | 3.28e-08 | 0.00e+00 | 1.24e-09 | 0.00e+00 | 0.00e+00 | 1.44e-05 | 4.70e-05 |
| Sr-92 | 3.54e-09 | 0.00e+00 | 1.42e-10 | 0.00e+00 | 0.00e+00 | 6.49e-06 | 6.55e-05 |
| Y-90 | 1.11e-06 | 0.00e+00 | 2.99e-08 | 0.00e+00 | 0.00e+00 | 7.07e-05 | 7.24e-05 |
| Y-91 | 2.47e-04 | 0.00e+00 | 6.59e-06 | 0.00e+00 | 0.00e+00 | 7.10e-04 | 4.97e-05 |
| Y-91m | 1.37e-10 | 0.00e+00 | 4.98e-12 | 0.00e+00 | 0.00e+00 | 7.60e-07 | 4.64e-07 |
| Y-92 | 5.50e-09 | 0.00e+00 | 1.57e-10 | 0.00e+00 | 0.00e+00 | 6.46e-06 | 6.46e-05 |
| Y-93 | 5.04e-08 | 0.00e+00 | 1.38e-09 | 0.00e+00 | 0.00e+00 | 2.01e-05 | 1.05e-04 |
| Zr-93 | 2.07e-04 | 7.80e-06 | 5.55e-06 | 0.00e+00 | 3.00e-05 | 7.10e-05 | 1.47e-06 |
| Zr-95 | 5.13e-05 | 1.13e-05 | 1.00e-05 | 0.00e+00 | 1.61e-05 | 6.03e-04 | 1.65e-05 |
| Zr-97 | 5.07e-08 | 7.34e-09 | 4.32e-09 | 0.00e+00 | 1.05e-08 | 3.06e-05 | 9.49e-05 |
| Nb-93m | 1.27e-04 | 3.17e-05 | 1.04e-05 | 0.00e+00 | 3.44e-05 | 1.04e-04 | 2.45e-06 |
| Nb-95 | 6.35e-06 | 2.48e-06 | 1.77e-06 | 0.00e+00 | 2.33e-06 | 1.66e-04 | 1.00e-05 |
| Nb-97 | 1.16e-10 | 2.08e-11 | 9.74e-12 | 0.00e+00 | 2.31e-11 | 9.23e-07 | 7.52e-06 |
| Mo-93 | 0.00e+00 | 3.76e-06 | 1.35e-07 | 0.00e+00 | 1.06e-06 | 1.70e-04 | 3.78e-06 |
| Mo-99 | 0.00e+00 | 4.66e-08 | 1.15e-08 | 0.00e+00 | 1.06e-07 | 3.66e-05 | 3.42e-05 |
| Tc-101 | 2.19e-14 | 2.30e-14 | 2.91e-13 | 0.00e+00 | 3.92e-13 | 1.58e-07 | 4.41e-09 |
| Tc-99 | 1.34e-07 | 1.49e-07 | 5.35e-08 | 0.00e+00 | 1.75e-06 | 3.37e-04 | 7.75e-06 |
| Tc-99m | 4.81e-13 | 9.41e-13 | 1.56e-11 | 0.00e+00 | 1.37e-11 | 2.57e-07 | 1.30e-06 |
| Ru-103 | 7.55e-07 | 0.00e+00 | 2.90e-07 | 0.00e+00 | 1.90e-06 | 1.79e-04 | 1.21e-05 |
| Ru-105 | 4.13e-10 | 0.00e+00 | 1.50e-10 | 0.00e+00 | 3.63e-10 | 4.30e-06 | 2.69e-05 |
| Ru-106 | 3.68e-05 | 0.00e+00 | 4.57e-06 | 0.00e+00 | 4.97e-05 | 3.87e-03 | 1.16e-04 |
| Rh-105 | 3.91e-09 | 2.10e-09 | 1.79e-09 | 0.00e+00 | 8.39e-09 | 7.82e-06 | 1.33e-05 |
| Pd-107 | 0.00e+00 | 2.65e-07 | 2.51e-08 | 0.00e+00 | 1.97e-06 | 3.16e-05 | 7.26e-07 |
| Pd-109 | 0.00e+00 | 1.48e-09 | 4.95e-10 | 0.00e+00 | 7.06e-09 | 6.16e-06 | 2.59e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 4.56e-06 | 3.08e-06 | 2.47e-06 | 0.00e+00 | 5.74e-06 | 1.48e-03 | 2.71e-05 |
| Ag-111 | 1.81e-07 | 5.68e-08 | 3.75e-08 | 0.00e+00 | 1.71e-07 | 7.73e-05 | 2.98e-05 |
| Cd-113m | 0.00e+00 | 4.93e-04 | 2.12e-05 | 0.00e+00 | 5.13e-04 | 6.94e-04 | 1.63e-05 |
| Cd-115m | 0.00e+00 | 7.88e-05 | 3.39e-06 | 0.00e+00 | 5.93e-05 | 5.86e-04 | 4.97e-05 |
| Sn-123 | 1.29e-04 | 2.14e-06 | 4.19e-06 | 2.27e-06 | 0.00e+00 | 9.59e-04 | 4.05e-05 |
| Sn-125 | 4.95e-06 | 9.94e-08 | 2.95e-07 | 1.03e-07 | 0.00e+00 | 2.43e-04 | 7.17e-05 |
| Sn-126 | 6.23e-04 | 1.04e-05 | 2.36e-05 | 2.84e-06 | 0.00e+00 | 3.02e-03 | 1.63e-05 |
| Sb-124 | 1.55e-05 | 2.00e-07 | 5.41e-06 | 3.41e-08 | 0.00e+00 | 8.76e-04 | 4.43e-05 |
| Sb-125 | 2.66e-05 | 2.05e-07 | 5.59e-06 | 2.46e-08 | 0.00e+00 | 6.27e-04 | 1.09e-05 |
| Sb-126 | 1.72e-06 | 2.62e-08 | 6.16e-07 | 1.00e-08 | 0.00e+00 | 2.86e-04 | 5.67e-05 |
| Sb-127 | 1.36e-07 | 2.09e-09 | 4.70e-08 | 1.51e-09 | 0.00e+00 | 6.17e-05 | 3.82e-05 |
| Te-125m | 1.82e-06 | 6.29e-07 | 2.47e-07 | 5.20e-07 | 0.00e+00 | 1.29e-04 | 9.13e-06 |
| Te-127 | 7.49e-10 | 2.57e-10 | 1.65e-10 | 5.30e-10 | 1.91e-09 | 2.71e-06 | 1.52e-05 |
| Te-127m | 6.72e-06 | 2.31e-06 | 8.16e-07 | 1.64e-06 | 1.72e-05 | 4.00e-04 | 1.93e-05 |
| Te-129 | 2.64e-11 | 9.45e-12 | 6.44e-12 | 1.93e-11 | 6.94e-11 | 7.93e-07 | 6.89e-06 |
| Te-129m | 5.19e-06 | 1.85e-06 | 8.22e-07 | 1.71e-06 | 1.36e-05 | 4.76e-04 | 4.91e-05 |
| Te-131 | 5.87e-12 | 2.28e-12 | 1.78e-12 | 4.59e-12 | 1.59e-11 | 5.55e-07 | 3.60e-07 |
| Te-131m | 3.63e-08 | 1.60e-08 | 1.37e-08 | 2.64e-08 | 1.08e-07 | 5.56e-05 | 8.32e-05 |
| Te-132 | 1.30e-07 | 7.36e-08 | 7.12e-08 | 8.58e-08 | 4.79e-07 | 1.02e-04 | 3.72e-05 |
| Te-133m | 2.93e-11 | 1.51e-11 | 1.50e-11 | 2.32e-11 | 1.01e-10 | 1.60e-06 | 4.77e-06 |
| Te-134 | 1.53e-11 | 8.81e-12 | 9.40e-12 | 1.24e-11 | 5.71e-11 | 1.23e-06 | 4.87e-07 |
| I-129 | 1.05e-05 | 6.40e-06 | 5.71e-06 | 4.28e-03 | 1.08e-05 | 0.00e+00 | 2.15e-07 |
| I-130 | 2.21e-06 | 4.43e-06 | 2.28e-06 | 4.99e-04 | 6.61e-06 | 0.00e+00 | 1.38e-06 |
| I-131 | 1.30e-05 | 1.30e-05 | 7.37e-06 | 4.39e-03 | 2.13e-05 | 0.00e+00 | 7.68e-07 |
| I-132 | 5.72e-07 | 1.10e-06 | 5.07e-07 | 5.23e-05 | 1.69e-06 | 0.00e+00 | 8.65e-07 |
| I-133 | 4.48e-06 | 5.49e-06 | 2.08e-06 | 1.04e-03 | 9.13e-06 | 0.00e+00 | 1.48e-06 |
| I-134 | 3.17e-07 | 5.84e-07 | 2.69e-07 | 1.37e-05 | 8.92e-07 | 0.00e+00 | 2.58e-07 |
| I-135 | 1.33e-06 | 2.36e-06 | 1.12e-06 | 2.14e-04 | 3.62e-06 | 0.00e+00 | 1.20e-06 |
| Cs-134 | 1.76e-04 | 2.74e-04 | 6.07e-05 | 0.00e+00 | 8.93e-05 | 3.27e-05 | 1.04e-06 |
| Cs-134m | 6.33e-08 | 8.92e-08 | 6.12e-08 | 0.00e+00 | 4.94e-08 | 8.35e-09 | 7.92e-08 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 6.23e-05 | 4.13e-05 | 4.45e-06 | 0.00e+00 | 1.53e-05 | 5.22e-06 | 2.17e-07 |
| Cs-136 | 1.76e-05 | 4.62e-05 | 3.14e-05 | 0.00e+00 | 2.58e-05 | 3.93e-06 | 1.13e-06 |
| Cs-137 | 2.45e-04 | 2.23e-04 | 3.47e-05 | 0.00e+00 | 7.63e-05 | 2.81e-05 | 9.78e-07 |
| Cs-138 | 1.71e-07 | 2.27e-07 | 1.50e-07 | 0.00e+00 | 1.68e-07 | 1.84e-08 | 7.29e-08 |
| Cs-139 | 1.09e-07 | 1.15e-07 | 5.80e-08 | 0.00e+00 | 9.08e-08 | 9.36e-09 | 7.23e-12 |
| Ba-139 | 4.98e-10 | 2.66e-13 | 1.45e-11 | 0.00e+00 | 2.33e-13 | 1.56e-06 | 1.56e-05 |
| Ba-140 | 2.00e-05 | 1.75e-08 | 1.17e-06 | 0.00e+00 | 5.71e-09 | 4.71e-04 | 2.75e-05 |
| Ba-141 | 5.29e-11 | 2.95e-14 | 1.72e-12 | 0.00e+00 | 2.56e-14 | 7.89e-07 | 7.44e-08 |
| Ba-142 | 1.35e-11 | 9.73e-15 | 7.54e-13 | 0.00e+00 | 7.87e-15 | 4.44e-07 | 7.41e-10 |
| La-140 | 1.74e-07 | 6.08e-08 | 2.04e-08 | 0.00e+00 | 0.00e+00 | 4.94e-05 | 6.10e-05 |
| La-141 | 2.28e-09 | 5.31e-10 | 1.15e-10 | 0.00e+00 | 0.00e+00 | 4.48e-06 | 4.37e-05 |
| La-142 | 3.50e-10 | 1.11e-10 | 3.49e-11 | 0.00e+00 | 0.00e+00 | 2.35e-06 | 2.05e-05 |
| Ce-141 | 1.06e-05 | 5.28e-06 | 7.83e-07 | 0.00e+00 | 2.31e-06 | 1.47e-04 | 1.53e-05 |
| Ce-143 | 9.89e-08 | 5.37e-08 | 7.77e-09 | 0.00e+00 | 2.26e-08 | 3.12e-05 | 3.44e-05 |
| Ce-144 | 1.83e-03 | 5.72e-04 | 9.77e-05 | 0.00e+00 | 3.17e-04 | 3.23e-03 | 1.05e-04 |
| Pr-143 | 4.99e-06 | 1.50e-06 | 2.47e-07 | 0.00e+00 | 8.11e-07 | 1.17e-04 | 2.63e-05 |
| Pr-144 | 1.61e-11 | 4.99e-12 | 8.10e-13 | 0.00e+00 | 2.64e-12 | 4.23e-07 | 5.32e-08 |
| Nd-147 | 2.92e-06 | 2.36e-06 | 1.84e-07 | 0.00e+00 | 1.30e-06 | 8.87e-05 | 2.22e-05 |
| Pm-147 | 3.52e-04 | 2.52e-05 | 1.36e-05 | 0.00e+00 | 4.45e-05 | 2.20e-04 | 5.70e-06 |
| Pm-148 | 1.61e-06 | 1.94e-07 | 1.25e-07 | 0.00e+00 | 3.30e-07 | 1.24e-04 | 6.01e-05 |
| Pm-148m | 3.31e-05 | 6.55e-06 | 6.55e-06 | 0.00e+00 | 9.74e-06 | 5.72e-04 | 3.58e-05 |
| Pm-149 | 1.47e-07 | 1.56e-08 | 8.45e-09 | 0.00e+00 | 2.75e-08 | 2.40e-05 | 2.92e-05 |
| Pm-151 | 3.57e-08 | 4.33e-09 | 2.82e-09 | 0.00e+00 | 7.35e-09 | 1.24e-05 | 2.50e-05 |
| Sm-151 | 3.14e-04 | 4.75e-05 | 1.49e-05 | 0.00e+00 | 4.89e-05 | 1.48e-04 | 3.43e-06 |
| Sm-153 | 7.24e-08 | 4.51e-08 | 4.35e-09 | 0.00e+00 | 1.37e-08 | 1.37e-05 | 1.87e-05 |
| Eu-152 | 7.42e-04 | 1.37e-04 | 1.61e-04 | 0.00e+00 | 5.73e-04 | 9.00e-04 | 1.14e-05 |
| Eu-154 | 2.74e-03 | 2.49e-04 | 2.27e-04 | 0.00e+00 | 1.09e-03 | 1.66e-03 | 2.98e-05 |
| Eu-155 | 5.60e-04 | 4.05e-05 | 3.18e-05 | 0.00e+00 | 1.51e-04 | 2.79e-04 | 5.39e-05 |
| Eu-156 | 7.89e-06 | 4.23e-06 | 8.75e-07 | 0.00e+00 | 2.72e-06 | 2.54e-04 | 4.24e-05 |
| Tb-160 | 7.79e-05 | 0.00e+00 | 9.67e-06 | 0.00e+00 | 2.32e-05 | 5.34e-04 | 2.28e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Hc-166m | 1.34e-03 | 2.81e-04 | 2.37e-04 | 0.00e+00 | 4.01e-04 | 1.13e-03 | 1.63e-05 |
| W-181 | 2.66e-08 | 6.52e-09 | 8.99e-10 | 0.00e+00 | 0.00e+00 | 5.71e-06 | 2.61e-07 |
| W-185 | 8.31e-07 | 2.08e-07 | 2.91e-08 | 0.00e+00 | 0.00e+00 | 1.86e-04 | 1.11e-05 |
| W-187 | 4.41e-09 | 2.61e-09 | 1.17e-09 | 0.00e+00 | 0.00e+00 | 1.11e-05 | 2.46e-05 |
| Pt-210 | 8.03e-02 | 1.85e-02 | 3.18e-03 | 0.00e+00 | 6.31e-02 | 8.74e-02 | 1.55e-06 |
| Bi-210 | 9.85e-07 | 5.11e-06 | 5.65e-07 | 0.00e+00 | 5.76e-05 | 3.70e-03 | 3.21e-05 |
| Pc-210 | 1.70e-03 | 2.76e-03 | 4.09e-04 | 0.00e+00 | 8.85e-03 | 1.05e-01 | 4.32e-05 |
| Ra-223 | 7.69e-04 | 8.89e-07 | 1.54e-04 | 0.00e+00 | 2.36e-05 | 8.48e-02 | 3.00e-04 |
| Ra-224 | 8.44e-05 | 1.53e-07 | 1.69e-05 | 0.00e+00 | 4.06e-06 | 2.92e-02 | 3.34e-04 |
| Ra-225 | 1.28e-03 | 1.14e-06 | 2.56e-04 | 0.00e+00 | 3.02e-05 | 9.74e-02 | 2.84e-04 |
| Ra-226 | 2.34e-01 | 7.66e-06 | 1.92e-01 | 0.00e+00 | 2.03e-04 | 3.90e-01 | 3.02e-04 |
| Ra-228 | 1.49e-01 | 3.94e-06 | 1.68e-01 | 0.00e+00 | 1.04e-04 | 5.37e-01 | 5.14e-05 |
| Ac-225 | 1.81e-03 | 1.87e-03 | 1.21e-04 | 0.00e+00 | 1.99e-04 | 7.37e-02 | 2.67e-04 |
| Ac-227 | 4.96e+00 | 8.05e-01 | 3.07e-01 | 0.00e+00 | 1.77e-01 | 8.04e-01 | 5.22e-05 |
| Th-227 | 9.24e-04 | 1.26e-05 | 2.67e-05 | 0.00e+00 | 6.67e-05 | 1.26e-01 | 3.49e-04 |
| Th-228 | 8.06e-01 | 1.04e-02 | 2.72e-02 | 0.00e+00 | 5.41e-02 | 3.34e+00 | 3.59e-04 |
| Th-229 | 2.18e+01 | 5.74e-01 | 3.63e-01 | 0.00e+00 | 2.83e+00 | 1.08e+01 | 4.99e-05 |
| Th-230 | 3.30e+00 | 1.73e-01 | 9.20e-02 | 0.00e+00 | 8.52e-01 | 1.85e+00 | 3.84e-05 |
| Th-232 | 3.68e+00 | 1.47e-01 | 1.28e-03 | 0.00e+00 | 7.28e-01 | 1.77e+00 | 3.27e-05 |
| Th-234 | 6.94e-06 | 3.07e-07 | 2.00e-07 | 0.00e+00 | 1.62e-06 | 6.31e-04 | 7.32e-05 |
| Pa-231 | 8.62e+00 | 2.86e-01 | 3.43e-01 | 0.00e+00 | 1.56e+00 | 1.92e-01 | 4.57e-05 |
| Pa-233 | 4.14e-06 | 6.48e-07 | 7.25e-07 | 0.00e+00 | 2.38e-06 | 9.77e-05 | 8.95e-06 |
| U-232 | 2.19e-01 | 0.00e+00 | 1.56e-02 | 0.00e+00 | 1.67e-02 | 7.42e-01 | 4.33e-05 |
| U-233 | 4.64e-02 | 0.00e+00 | 2.82e-03 | 0.00e+00 | 7.62e-03 | 1.77e-01 | 4.00e-05 |
| U-234 | 4.46e-02 | 0.00e+00 | 2.76e-03 | 0.00e+00 | 7.47e-03 | 1.74e-01 | 3.92e-05 |
| U-235 | 4.27e-02 | 0.00e+00 | 2.59e-03 | 0.00e+00 | 7.01e-03 | 1.63e-01 | 4.98e-05 |
| U-236 | 4.27e-02 | 0.00e+00 | 2.65e-03 | 0.00e+00 | 7.16e-03 | 1.67e-01 | 3.67e-05 |
| U-237 | 1.57e-07 | 0.00e+00 | 4.17e-08 | 0.00e+00 | 4.53e-07 | 3.40e-05 | 1.29e-05 |
| U-238 | 4.09e-02 | 0.00e+00 | 2.42e-03 | 0.00e+00 | 6.55e-03 | 1.53e-01 | 3.51e-05 |
| Np-237 | 2.72e+00 | 1.62e+00 | 1.19e-01 | 0.00e+00 | 7.41e-01 | 1.74e-01 | 5.06e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.26e-06 | 2.30e-07 | 1.97e-08 | 0.00e+00 | 8.16e-08 | 3.39e-05 | 2.50e-05 |
| Np-239 | 1.26e-07 | 8.14e-08 | 6.35e-09 | 0.00e+00 | 2.63e-08 | 1.57e-05 | 1.73e-05 |
| Pu-238 | 2.55e+00 | 1.60e+00 | 1.21e-01 | 0.00e+00 | 4.47e-01 | 6.08e-01 | 4.65e-05 |
| Pu-239 | 2.79e+00 | 1.68e+00 | 1.28e-01 | 0.00e+00 | 4.78e-01 | 5.72e-01 | 4.24e-05 |
| Pu-240 | 2.79e+00 | 1.68e+00 | 1.27e-01 | 0.00e+00 | 4.77e-01 | 5.71e-01 | 4.33e-05 |
| Pu-241 | 7.94e-02 | 1.75e-02 | 2.93e-03 | 0.00e+00 | 1.10e-02 | 5.06e-04 | 8.90e-07 |
| Pu-242 | 2.59e+00 | 1.62e+00 | 1.23e-01 | 0.00e+00 | 4.60e-01 | 5.50e-01 | 4.16e-05 |
| Pu-244 | 3.02e+00 | 1.85e+00 | 1.41e-01 | 0.00e+00 | 5.27e-01 | 6.30e-01 | 6.20e-05 |
| Am-241 | 2.97e+00 | 1.84e+00 | 1.24e-01 | 0.00e+00 | 7.63e-01 | 2.02e-01 | 4.73e-05 |
| Am-242m | 3.07e+00 | 1.76e+00 | 1.27e-01 | 0.00e+00 | 7.71e-01 | 8.14e-02 | 5.96e-05 |
| Am-243 | 2.94e+00 | 1.78e+00 | 1.20e-01 | 0.00e+00 | 7.42e-01 | 1.92e-01 | 5.55e-05 |
| Cm-242 | 9.48e-02 | 5.68e-02 | 4.20e-03 | 0.00e+00 | 1.34e-02 | 1.31e-01 | 5.06e-05 |
| Cm-243 | 2.32e+00 | 1.42e+00 | 9.95e-02 | 0.00e+00 | 3.74e-01 | 2.10e-01 | 4.98e-05 |
| Cm-244 | 1.94e+00 | 1.18e+00 | 8.31e-02 | 0.00e+00 | 3.06e-01 | 2.02e-01 | 4.82e-05 |
| Cm-245 | 3.05e+00 | 1.84e+00 | 1.28e-01 | 0.00e+00 | 5.03e-01 | 1.95e-01 | 4.49e-05 |
| Cm-246 | 3.02e+00 | 1.84e+00 | 1.28e-01 | 0.00e+00 | 5.03e-01 | 1.99e-01 | 4.41e-05 |
| Cm-247 | 2.94e+00 | 1.82e+00 | 1.26e-01 | 0.00e+00 | 4.95e-01 | 1.95e-01 | 5.80e-05 |
| Cm-248 | 2.45e+01 | 1.50e+01 | 1.04e+00 | 0.00e+00 | 4.08e+00 | 1.61e+00 | 9.35e-04 |
| Cf-252 | 2.18e+00 | 0.00e+00 | 9.33e-02 | 0.00e+00 | 0.00e+00 | 6.62e-01 | 1.84e-04 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 2.63e-07 | 2.63e-07 | 2.63e-07 | 2.63e-07 | 2.63e-07 | 2.63e-07 |
| Be-10 | 9.49e-04 | 1.25e-04 | 2.65e-05 | 0.00e+00 | 0.00e+00 | 1.49e-03 | 1.73e-05 |
| C-14 | 1.89e-05 | 3.79e-06 | 3.79e-06 | 3.79e-06 | 3.79e-06 | 3.79e-06 | 3.79e-06 |
| N-13 | 4.39e-08 | 4.39e-08 | 4.39e-08 | 4.39e-08 | 4.39e-08 | 4.39e-08 | 4.39e-08 |
| F-18 | 3.92e-06 | 0.00e+00 | 3.33e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.10e-07 |
| Na-22 | 7.37e-05 | 7.37e-05 | 7.37e-05 | 7.37e-05 | 7.37e-05 | 7.37e-05 | 7.37e-05 |
| Na-24 | 7.54e-06 | 7.54e-06 | 7.54e-06 | 7.54e-06 | 7.54e-06 | 7.54e-06 | 7.54e-06 |
| P-32 | 1.45e-03 | 8.03e-05 | 5.53e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.15e-05 |
| Ca-41 | 7.48e-05 | 0.00e+00 | 8.16e-06 | 0.00e+00 | 0.00e+00 | 6.94e-02 | 2.96e-07 |
| Sc-46 | 3.75e-04 | 5.41e-04 | 1.69e-04 | 0.00e+00 | 3.56e-04 | 0.00e+00 | 2.19e-05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 6.39e-08 | 4.11e-08 | 9.45e-09 | 9.17e-06 | 2.55e-07 |
| Mn-54 | 0.00e+00 | 1.81e-05 | 3.56e-06 | 0.00e+00 | 3.56e-06 | 7.14e-04 | 5.04e-06 |
| Mn-56 | 0.00e+00 | 1.10e-09 | 1.58e-10 | 0.00e+00 | 7.86e-10 | 8.95e-06 | 5.12e-05 |
| Fe-55 | 1.41e-05 | 8.39e-06 | 2.38e-06 | 0.00e+00 | 0.00e+00 | 6.21e-05 | 7.82e-07 |
| Fe-59 | 9.69e-06 | 1.68e-05 | 6.77e-06 | 0.00e+00 | 0.00e+00 | 7.25e-04 | 1.77e-05 |
| Co-57 | 0.00e+00 | 4.65e-07 | 4.58e-07 | 0.00e+00 | 0.00e+00 | 2.71e-04 | 3.47e-06 |
| Co-58 | 0.00e+00 | 8.71e-07 | 1.30e-06 | 0.00e+00 | 0.00e+00 | 5.55e-04 | 7.95e-06 |
| Co-60 | 0.00e+00 | 5.73e-06 | 8.41e-06 | 0.00e+00 | 0.00e+00 | 3.22e-03 | 2.28e-05 |
| Ni-59 | 1.81e-05 | 5.44e-06 | 3.10e-06 | 0.00e+00 | 0.00e+00 | 5.48e-05 | 6.34e-07 |
| Ni-63 | 2.42e-04 | 1.46e-05 | 8.29e-06 | 0.00e+00 | 0.00e+00 | 1.49e-04 | 1.73e-06 |
| Ni-65 | 1.71e-09 | 2.03e-10 | 8.79e-11 | 0.00e+00 | 0.00e+00 | 5.80e-06 | 3.58e-05 |
| Cu-64 | 0.00e+00 | 1.34e-09 | 5.53e-10 | 0.00e+00 | 2.84e-09 | 6.64e-06 | 1.07e-05 |
| Zn-65 | 1.38e-05 | 4.47e-05 | 2.22e-05 | 0.00e+00 | 2.32e-05 | 4.62e-04 | 3.67e-05 |
| Zn-69 | 3.85e-11 | 6.91e-11 | 5.13e-12 | 0.00e+00 | 2.87e-11 | 1.05e-06 | 9.44e-06 |
| Zn-69m | 8.98e-09 | 1.84e-08 | 1.67e-09 | 0.00e+00 | 7.45e-09 | 1.91e-05 | 2.92e-05 |
| Se-79 | 0.00e+00 | 2.25e-06 | 4.20e-07 | 0.00e+00 | 2.47e-06 | 2.99e-04 | 3.46e-06 |
| Br-82 | 0.00e+00 | 0.00e+00 | 9.49e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 2.72e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 2.86e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 1.46e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.36e-04 | 6.30e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.17e-06 |
| Rb-87 | 0.00e+00 | 7.11e-05 | 2.64e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.99e-07 |
| Rb-88 | 0.00e+00 | 3.98e-07 | 2.05e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.42e-07 |
| Rb-89 | 0.00e+00 | 2.29e-07 | 1.47e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.87e-08 |
| Sr-89 | 2.84e-04 | 0.00e+00 | 8.15e-06 | 0.00e+00 | 0.00e+00 | 1.45e-03 | 4.57e-05 |
| Sr-90 | 1.11e-02 | 0.00e+00 | 2.23e-04 | 0.00e+00 | 0.00e+00 | 8.03e-03 | 9.36e-05 |
| Sr-91 | 6.83e-08 | 0.00e+00 | 2.47e-09 | 0.00e+00 | 0.00e+00 | 3.76e-05 | 5.24e-05 |
| Sr-92 | 7.50e-09 | 0.00e+00 | 2.79e-10 | 0.00e+00 | 0.00e+00 | 1.70e-05 | 1.00e-04 |
| Y-90 | 2.35e-06 | 0.00e+00 | 6.30e-08 | 0.00e+00 | 0.00e+00 | 1.92e-04 | 7.43e-05 |
| Y-91 | 4.20e-04 | 0.00e+00 | 1.12e-05 | 0.00e+00 | 0.00e+00 | 1.75e-03 | 5.02e-05 |
| Y-91m | 2.91e-10 | 0.00e+00 | 9.90e-12 | 0.00e+00 | 0.00e+00 | 1.99e-06 | 1.68e-06 |
| Y-92 | 1.17e-08 | 0.00e+00 | 3.29e-10 | 0.00e+00 | 0.00e+00 | 1.75e-05 | 9.04e-05 |
| Y-93 | 1.07e-07 | 0.00e+00 | 2.91e-09 | 0.00e+00 | 0.00e+00 | 5.46e-05 | 1.19e-04 |
| Zr-93 | 2.24e-04 | 9.51e-06 | 6.18e-06 | 0.00e+00 | 3.19e-05 | 1.37e-04 | 1.48e-06 |
| Zr-95 | 8.24e-05 | 1.99e-05 | 1.45e-05 | 0.00e+00 | 2.22e-05 | 1.25e-03 | 1.55e-05 |
| Zr-97 | 1.07e-07 | 1.83e-08 | 8.36e-09 | 0.00e+00 | 1.85e-08 | 7.88e-05 | 1.00e-04 |
| Nb-93m | 1.38e-04 | 3.59e-05 | 1.15e-05 | 0.00e+00 | 3.68e-05 | 2.09e-04 | 2.47e-06 |
| Nb-95 | 1.12e-05 | 4.59e-06 | 2.70e-06 | 0.00e+00 | 3.37e-06 | 3.42e-04 | 9.05e-06 |
| Nb-97 | 2.44e-10 | 5.21e-11 | 1.88e-11 | 0.00e+00 | 4.07e-11 | 2.37e-06 | 1.92e-05 |
| Mo-93 | 0.00e+00 | 6.46e-06 | 2.22e-07 | 0.00e+00 | 1.54e-06 | 3.40e-04 | 3.76e-06 |
| Mo-99 | 0.00e+00 | 1.18e-07 | 2.31e-08 | 0.00e+00 | 1.89e-07 | 9.63e-05 | 3.48e-05 |
| Tc-101 | 4.65e-14 | 5.88e-14 | 5.80e-13 | 0.00e+00 | 6.99e-13 | 4.17e-07 | 6.03e-07 |
| Tc-99 | 2.09e-07 | 2.68e-07 | 8.85e-08 | 0.00e+00 | 2.49e-06 | 6.77e-04 | 7.82e-06 |
| Tc-99m | 9.98e-13 | 2.06e-12 | 2.66e-11 | 0.00e+00 | 2.22e-11 | 5.79e-07 | 1.45e-06 |
| Ru-103 | 1.44e-06 | 0.00e+00 | 4.85e-07 | 0.00e+00 | 3.03e-06 | 3.94e-04 | 1.15e-05 |
| Ru-105 | 8.74e-10 | 0.00e+00 | 2.93e-10 | 0.00e+00 | 6.42e-10 | 1.12e-05 | 3.46e-05 |
| Ru-106 | 6.20e-05 | 0.00e+00 | 7.77e-06 | 0.00e+00 | 7.61e-05 | 8.26e-03 | 1.17e-04 |
| Rh-105 | 8.26e-09 | 5.41e-09 | 3.63e-09 | 0.00e+00 | 1.50e-08 | 2.08e-05 | 1.37e-05 |
| Pd-107 | 0.00e+00 | 4.92e-07 | 4.11e-08 | 0.00e+00 | 2.75e-06 | 6.34e-05 | 7.33e-07 |
| Pd-109 | 0.00e+00 | 3.92e-09 | 1.05e-09 | 0.00e+00 | 1.28e-08 | 1.68e-05 | 2.85e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 7.13e-06 | 5.16e-06 | 3.57e-06 | 0.00e+00 | 7.80e-06 | 2.62e-03 | 2.36e-05 |
| Ag-111 | 3.75e-07 | 1.45e-07 | 7.75e-08 | 0.00e+00 | 3.05e-07 | 2.06e-04 | 3.02e-05 |
| Cc-113m | 0.00e+00 | 6.67e-04 | 2.64e-05 | 0.00e+00 | 5.80e-04 | 1.40e-03 | 1.65e-05 |
| Cc-115m | 0.00e+00 | 1.73e-04 | 6.19e-06 | 0.00e+00 | 9.41e-05 | 1.47e-03 | 5.02e-05 |
| Sr-123 | 2.09e-04 | 4.21e-06 | 7.28e-06 | 4.27e-06 | 0.00e+00 | 2.22e-03 | 4.08e-05 |
| Sr-125 | 1.01e-05 | 2.51e-07 | 6.00e-07 | 2.47e-07 | 0.00e+00 | 6.43e-04 | 7.26e-05 |
| Sr-126 | 8.30e-04 | 1.44e-05 | 3.52e-05 | 3.84e-06 | 0.00e+00 | 4.93e-03 | 1.65e-05 |
| Sk-124 | 2.71e-05 | 3.97e-07 | 8.56e-06 | 7.18e-08 | 0.00e+00 | 1.89e-03 | 4.22e-05 |
| Sk-125 | 3.69e-05 | 3.41e-07 | 7.78e-06 | 4.45e-08 | 0.00e+00 | 1.17e-03 | 1.05e-05 |
| Sk-126 | 3.08e-06 | 6.01e-08 | 1.11e-06 | 2.35e-08 | 0.00e+00 | 6.88e-04 | 5.33e-05 |
| Sk-127 | 2.82e-07 | 5.04e-09 | 8.76e-08 | 3.60e-09 | 0.00e+00 | 1.54e-04 | 3.78e-05 |
| Te-125m | 3.40e-06 | 1.42e-06 | 4.70e-07 | 1.16e-06 | 0.00e+00 | 3.19e-04 | 9.22e-06 |
| Te-127 | 1.59e-09 | 6.81e-10 | 3.49e-10 | 1.32e-09 | 3.47e-09 | 7.39e-06 | 1.74e-05 |
| Te-127m | 1.19e-05 | 4.93e-06 | 1.48e-06 | 3.48e-06 | 2.68e-05 | 9.37e-04 | 1.95e-05 |
| Te-129 | 5.63e-11 | 2.48e-11 | 1.34e-11 | 4.82e-11 | 1.25e-10 | 2.14e-06 | 1.88e-05 |
| Te-129m | 1.01e-05 | 4.35e-06 | 1.59e-06 | 3.91e-06 | 2.27e-05 | 1.20e-03 | 4.93e-05 |
| Te-131 | 1.24e-11 | 5.87e-12 | 3.57e-12 | 1.13e-11 | 2.85e-11 | 1.47e-06 | 5.87e-06 |
| Te-131m | 7.62e-08 | 3.93e-08 | 2.59e-08 | 6.38e-08 | 1.89e-07 | 1.42e-04 | 8.51e-05 |
| Te-132 | 2.66e-07 | 1.69e-07 | 1.26e-07 | 1.99e-07 | 7.39e-07 | 2.43e-04 | 3.15e-05 |
| Te-133m | 6.13e-11 | 3.59e-11 | 2.74e-11 | 5.52e-11 | 1.72e-10 | 3.92e-06 | 1.59e-05 |
| Te-134 | 3.18e-11 | 2.04e-11 | 1.68e-11 | 2.91e-11 | 9.59e-11 | 2.93e-06 | 2.53e-06 |
| I-129 | 2.16e-05 | 1.59e-05 | 1.16e-05 | 1.04e-02 | 1.88e-05 | 0.00e+00 | 2.12e-07 |
| I-130 | 4.54e-06 | 9.91e-06 | 3.98e-06 | 1.14e-03 | 1.09e-05 | 0.00e+00 | 1.42e-06 |
| I-131 | 2.71e-05 | 3.17e-05 | 1.40e-05 | 1.06e-02 | 3.70e-05 | 0.00e+00 | 7.56e-07 |
| I-132 | 1.21e-06 | 2.53e-06 | 8.99e-07 | 1.21e-04 | 2.82e-06 | 0.00e+00 | 1.36e-06 |
| I-133 | 9.46e-06 | 1.37e-05 | 4.00e-06 | 2.54e-03 | 1.60e-05 | 0.00e+00 | 1.54e-06 |
| I-134 | 6.58e-07 | 1.34e-06 | 4.75e-07 | 3.18e-05 | 1.49e-06 | 0.00e+00 | 9.21e-07 |
| I-135 | 2.76e-06 | 5.43e-06 | 1.98e-06 | 4.97e-04 | 6.05e-06 | 0.00e+00 | 1.31e-06 |
| Cs-134 | 2.83e-04 | 5.02e-04 | 5.32e-05 | 0.00e+00 | 1.36e-04 | 5.69e-05 | 9.53e-07 |
| Cs-134m | 1.32e-07 | 2.10e-07 | 1.11e-07 | 0.00e+00 | 8.50e-08 | 2.00e-08 | 1.16e-07 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.00e-04 | 8.66e-05 | 4.73e-06 | 0.00e+00 | 2.58e-05 | 1.01e-05 | 2.18e-07 |
| Cs-136 | 3.45e-05 | 9.61e-05 | 3.78e-05 | 0.00e+00 | 4.03e-05 | 8.40e-06 | 1.02e-06 |
| Cs-137 | 3.92e-04 | 4.37e-04 | 3.25e-05 | 0.00e+00 | 1.23e-04 | 5.09e-05 | 9.53e-07 |
| Cs-138 | 3.61e-07 | 5.58e-07 | 2.84e-07 | 0.00e+00 | 2.93e-07 | 4.67e-08 | 6.26e-07 |
| Cs-139 | 2.32e-07 | 3.03e-07 | 1.22e-07 | 0.00e+00 | 1.65e-07 | 2.53e-08 | 1.33e-08 |
| Ba-139 | 1.06e-09 | 7.03e-13 | 3.07e-11 | 0.00e+00 | 4.23e-13 | 4.25e-06 | 3.64e-05 |
| Ba-140 | 4.00e-05 | 4.00e-08 | 2.07e-06 | 0.00e+00 | 9.59e-09 | 1.14e-03 | 2.74e-05 |
| Ba-141 | 1.12e-10 | 7.70e-14 | 3.55e-12 | 0.00e+00 | 4.64e-14 | 2.12e-06 | 3.39e-06 |
| Ba-142 | 2.84e-11 | 2.36e-14 | 1.40e-12 | 0.00e+00 | 1.36e-14 | 1.11e-06 | 4.95e-07 |
| La-140 | 3.61e-07 | 1.43e-07 | 3.68e-08 | 0.00e+00 | 0.00e+00 | 1.20e-04 | 6.06e-05 |
| La-141 | 4.85e-09 | 1.40e-09 | 2.45e-10 | 0.00e+00 | 0.00e+00 | 1.22e-05 | 5.96e-05 |
| La-142 | 7.36e-10 | 2.69e-10 | 6.46e-11 | 0.00e+00 | 0.00e+00 | 5.87e-06 | 4.25e-05 |
| Ce-141 | 1.98e-05 | 1.19e-05 | 1.42e-06 | 0.00e+00 | 3.75e-06 | 3.69e-04 | 1.54e-05 |
| Ce-143 | 2.09e-07 | 1.38e-07 | 1.58e-08 | 0.00e+00 | 4.03e-08 | 8.30e-05 | 3.55e-05 |
| Ce-144 | 2.28e-03 | 8.65e-04 | 1.26e-04 | 0.00e+00 | 3.84e-04 | 7.03e-03 | 1.06e-04 |
| Pr-143 | 1.00e-05 | 3.74e-06 | 4.99e-07 | 0.00e+00 | 1.41e-06 | 3.09e-04 | 2.66e-05 |
| Pr-144 | 3.42e-11 | 1.32e-11 | 1.72e-12 | 0.00e+00 | 4.80e-12 | 1.15e-06 | 3.06e-06 |
| Nd-147 | 5.67e-06 | 5.81e-06 | 3.57e-07 | 0.00e+00 | 2.25e-06 | 2.30e-04 | 2.23e-05 |
| Pm-147 | 3.91e-04 | 3.07e-05 | 1.56e-05 | 0.00e+00 | 4.93e-05 | 4.55e-04 | 5.75e-06 |
| Pm-148 | 3.34e-06 | 4.82e-07 | 2.44e-07 | 0.00e+00 | 5.76e-07 | 3.20e-04 | 6.04e-05 |
| Pm-148m | 5.00e-05 | 1.24e-05 | 9.94e-06 | 0.00e+00 | 1.45e-05 | 1.22e-03 | 3.37e-05 |
| Pm-149 | 3.10e-07 | 4.08e-08 | 1.78e-08 | 0.00e+00 | 4.96e-08 | 6.50e-05 | 3.01e-05 |
| Pm-151 | 7.52e-08 | 1.10e-08 | 5.55e-09 | 0.00e+00 | 1.30e-08 | 3.25e-05 | 2.58e-05 |
| Sm-151 | 3.38e-04 | 6.45e-05 | 1.63e-05 | 0.00e+00 | 5.24e-05 | 2.98e-04 | 3.46e-06 |
| Sm-153 | 1.53e-07 | 1.18e-07 | 9.06e-09 | 0.00e+00 | 2.47e-08 | 3.70e-05 | 1.93e-05 |
| Eu-152 | 7.83e-04 | 1.77e-04 | 1.72e-04 | 0.00e+00 | 5.94e-04 | 1.48e-03 | 9.88e-06 |
| Eu-154 | 2.96e-03 | 3.46e-04 | 2.45e-04 | 0.00e+00 | 1.14e-03 | 3.05e-03 | 2.84e-05 |
| Eu-155 | 5.97e-04 | 5.72e-05 | 3.46e-05 | 0.00e+00 | 1.58e-04 | 5.20e-04 | 5.19e-05 |
| Eu-156 | 1.56e-05 | 9.59e-06 | 1.54e-06 | 0.00e+00 | 4.48e-06 | 6.12e-04 | 4.14e-05 |
| Tb-160 | 1.12e-04 | 0.00e+00 | 1.40e-05 | 0.00e+00 | 3.20e-05 | 1.11e-03 | 2.14e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Hc-166m | 1.45e-03 | 3.07e-04 | 2.51e-04 | 0.00e+00 | 4.22e-04 | 2.05e-03 | 1.65e-05 |
| W-181 | 4.86e-08 | 1.46e-08 | 1.67e-09 | 0.00e+00 | 0.00e+00 | 1.33e-05 | 2.63e-07 |
| W-185 | 1.57e-06 | 4.83e-07 | 5.58e-08 | 0.00e+00 | 0.00e+00 | 4.48e-04 | 1.12e-05 |
| W-187 | 9.26e-09 | 6.44e-09 | 2.23e-09 | 0.00e+00 | 0.00e+00 | 2.83e-05 | 2.54e-05 |
| Pb-210 | 8.62e-02 | 2.02e-02 | 3.43e-03 | 0.00e+00 | 6.85e-02 | 1.76e-01 | 1.57e-06 |
| Bi-210 | 2.06e-06 | 1.33e-05 | 1.18e-06 | 0.00e+00 | 1.03e-04 | 9.96e-03 | 3.27e-05 |
| Po-210 | 2.98e-03 | 5.63e-03 | 7.12e-04 | 0.00e+00 | 1.30e-02 | 2.40e-01 | 4.36e-05 |
| Ra-223 | 1.56e-03 | 2.26e-06 | 3.12e-04 | 0.00e+00 | 4.16e-05 | 2.25e-01 | 3.04e-04 |
| Ra-224 | 1.77e-04 | 4.00e-07 | 3.54e-05 | 0.00e+00 | 7.30e-06 | 7.91e-02 | 3.42e-04 |
| Ra-225 | 2.57e-03 | 2.88e-06 | 5.13e-04 | 0.00e+00 | 5.31e-05 | 2.57e-01 | 2.87e-04 |
| Ra-226 | 2.48e-01 | 1.46e-05 | 2.05e-01 | 0.00e+00 | 2.94e-04 | 7.83e-01 | 3.05e-04 |
| Ra-228 | 1.60e-01 | 7.61e-06 | 1.80e-01 | 0.00e+00 | 1.53e-04 | 1.09e+00 | 5.19e-05 |
| Ac-225 | 3.69e-03 | 4.72e-03 | 2.48e-04 | 0.00e+00 | 3.49e-04 | 1.96e-01 | 2.71e-04 |
| Ac-227 | 5.29e+00 | 8.76e-01 | 3.28e-01 | 0.00e+00 | 1.86e-01 | 1.62e+00 | 5.27e-05 |
| Th-227 | 1.82e-03 | 3.03e-05 | 5.24e-05 | 0.00e+00 | 1.13e-04 | 3.27e-01 | 3.53e-04 |
| Th-228 | 8.46e-01 | 1.10e-02 | 2.86e-02 | 0.00e+00 | 5.61e-02 | 4.65e+00 | 3.62e-04 |
| Th-229 | 2.28e+01 | 5.94e-01 | 3.81e-01 | 0.00e+00 | 9.32e-01 | 1.27e+01 | 5.02e-05 |
| Th-230 | 3.46e+00 | 1.79e-01 | 9.65e-02 | 0.00e+00 | 8.82e-01 | 2.18e+00 | 3.87e-05 |
| Th-232 | 3.86e+00 | 1.53e-01 | 2.29e-03 | 0.00e+00 | 7.54e-01 | 2.09e+00 | 3.29e-05 |
| Th-234 | 1.33e-05 | 7.17e-07 | 3.84e-07 | 0.00e+00 | 2.70e-06 | 1.62e-03 | 7.40e-05 |
| Pa-231 | 9.10e+00 | 3.00e-01 | 3.62e-01 | 0.00e+00 | 1.62e+00 | 3.85e-01 | 4.61e-05 |
| Pa-233 | 6.84e-06 | 1.32e-06 | 1.19e-06 | 0.00e+00 | 3.68e-06 | 2.19e-04 | 9.04e-06 |
| U-232 | 2.57e-01 | 0.00e+00 | 2.13e-02 | 0.00e+00 | 2.40e-02 | 1.49e+00 | 4.36e-05 |
| U-233 | 5.44e-02 | 0.00e+00 | 3.83e-03 | 0.00e+00 | 1.09e-02 | 3.56e-01 | 4.03e-05 |
| U-234 | 5.22e-02 | 0.00e+00 | 3.75e-03 | 0.00e+00 | 1.07e-02 | 3.49e-01 | 3.95e-05 |
| U-235 | 5.01e-02 | 0.00e+00 | 3.52e-03 | 0.00e+00 | 1.01e-02 | 3.28e-01 | 5.02e-05 |
| U-236 | 5.01e-02 | 0.00e+00 | 3.60e-03 | 0.00e+00 | 1.03e-02 | 3.35e-01 | 3.71e-05 |
| U-237 | 3.25e-07 | 0.00e+00 | 8.65e-08 | 0.00e+00 | 8.08e-07 | 9.13e-05 | 1.31e-05 |
| U-238 | 4.79e-02 | 0.00e+00 | 3.29e-03 | 0.00e+00 | 9.40e-03 | 3.06e-01 | 3.54e-05 |
| Np-237 | 2.88e+00 | 1.71e+00 | 1.26e-01 | 0.00e+00 | 7.69e-01 | 3.49e-01 | 5.10e-05 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Inhalation Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 2.67e-06 | 6.05e-07 | 4.16e-08 | 0.00e+00 | 1.47e-07 | 9.19e-05 | 2.58e-05 |
| Np-239 | 2.65e-07 | 2.13e-07 | 1.34e-08 | 0.00e+00 | 4.73e-08 | 4.25e-05 | 1.78e-05 |
| Pu-238 | 2.69e+00 | 1.68e+00 | 1.27e-01 | 0.00e+00 | 4.64e-01 | 9.03e-01 | 4.69e-05 |
| Pu-239 | 2.93e+00 | 1.76e+00 | 1.34e-01 | 0.00e+00 | 4.95e-01 | 8.47e-01 | 4.28e-05 |
| Pu-240 | 2.93e+00 | 1.75e+00 | 1.34e-01 | 0.00e+00 | 4.94e-01 | 8.47e-01 | 4.36e-05 |
| Pu-241 | 8.43e-02 | 1.85e-02 | 3.11e-03 | 0.00e+00 | 1.15e-02 | 7.62e-04 | 8.97e-07 |
| Pu-242 | 2.72e+00 | 1.69e+00 | 1.29e-01 | 0.00e+00 | 4.77e-01 | 8.15e-01 | 4.20e-05 |
| Pu-244 | 3.17e+00 | 1.94e+00 | 1.48e-01 | 0.00e+00 | 5.46e-01 | 9.33e-01 | 6.26e-05 |
| Am-241 | 3.15e+00 | 1.95e+00 | 1.31e-01 | 0.00e+00 | 7.94e-01 | 4.06e-01 | 4.78e-05 |
| Am-242m | 3.25e+00 | 1.86e+00 | 1.35e-01 | 0.00e+00 | 8.03e-01 | 1.64e-01 | 6.01e-05 |
| Am-243 | 3.10e+00 | 1.88e+00 | 1.27e-01 | 0.00e+00 | 7.72e-01 | 3.85e-01 | 5.60e-05 |
| Cm-242 | 1.28e-01 | 8.65e-02 | 5.70e-03 | 0.00e+00 | 1.69e-02 | 2.97e-01 | 5.10e-05 |
| Cm-243 | 2.47e+00 | 1.52e+00 | 1.06e-01 | 0.00e+00 | 3.91e-01 | 4.24e-01 | 5.02e-05 |
| Cm-244 | 2.07e+00 | 1.27e+00 | 8.89e-02 | 0.00e+00 | 3.21e-01 | 4.08e-01 | 4.86e-05 |
| Cm-245 | 3.22e+00 | 1.96e+00 | 1.36e-01 | 0.00e+00 | 5.23e-01 | 3.92e-01 | 4.53e-05 |
| Cm-246 | 3.20e+00 | 1.96e+00 | 1.36e-01 | 0.00e+00 | 5.23e-01 | 3.99e-01 | 4.45e-05 |
| Cm-247 | 3.11e+00 | 1.93e+00 | 1.33e-01 | 0.00e+00 | 5.15e-01 | 3.92e-01 | 5.85e-05 |
| Cm-248 | 2.58e+01 | 1.59e+01 | 1.10e+00 | 0.00e+00 | 4.24e+00 | 3.23e+00 | 9.43e-04 |
| Cf-252 | 2.37e+00 | 0.00e+00 | 1.01e-01 | 0.00e+00 | 0.00e+00 | 1.37e+00 | 1.85e-04 |

Conversion factors are in units of mrem per pCi inhaled.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| H-3 | 0.00e+00 | 5.99e-08 | 5.99e-08 | 5.99e-08 | 5.99e-08 | 5.99e-08 | 5.99e-08 |
| Be-10 | 3.18e-06 | 4.91e-07 | 7.94e-08 | 0.00e+00 | 3.71e-07 | 0.00e+00 | 2.68e-05 |
| C-14 | 2.84e-06 | 5.68e-07 | 5.68e-07 | 5.68e-07 | 5.68e-07 | 5.68e-07 | 5.68e-07 |
| N-13 | 8.36e-09 | 8.36e-09 | 8.36e-09 | 8.36e-09 | 8.36e-09 | 8.36e-09 | 8.36e-09 |
| F-18 | 6.24e-07 | 0.00e+00 | 6.92e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.85e-08 |
| Na-22 | 1.74e-05 | 1.74e-05 | 1.74e-05 | 1.74e-05 | 1.74e-05 | 1.74e-05 | 1.74e-05 |
| Na-24 | 1.70e-06 | 1.70e-06 | 1.70e-06 | 1.70e-06 | 1.70e-06 | 1.70e-06 | 1.70e-06 |
| P-32 | 1.93e-04 | 1.20e-05 | 7.46e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.17e-05 |
| Ca-41 | 1.85e-04 | 0.00e+00 | 2.00e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.84e-07 |
| Sc-46 | 5.51e-09 | 1.07e-08 | 3.11e-09 | 0.00e+00 | 9.99e-09 | 0.00e+00 | 5.21e-05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 2.66e-09 | 1.59e-09 | 5.86e-10 | 3.53e-09 | 6.69e-07 |
| Mn-54 | 0.00e+00 | 4.57e-06 | 8.72e-07 | 0.00e+00 | 1.36e-06 | 0.00e+00 | 1.40e-05 |
| Mn-56 | 0.00e+00 | 1.15e-07 | 2.04e-08 | 0.00e+00 | 1.46e-07 | 0.00e+00 | 3.67e-06 |
| Fe-55 | 2.75e-06 | 1.90e-06 | 4.43e-07 | 0.00e+00 | 0.00e+00 | 1.06e-06 | 1.09e-06 |
| Fe-59 | 4.34e-06 | 1.02e-05 | 3.91e-06 | 0.00e+00 | 0.00e+00 | 2.85e-06 | 3.40e-05 |
| Co-57 | 0.00e+00 | 1.75e-07 | 2.91e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.44e-06 |
| Co-58 | 0.00e+00 | 7.45e-07 | 1.67e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.51e-05 |
| Co-60 | 0.00e+00 | 2.14e-06 | 4.72e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.02e-05 |
| Ni-59 | 9.76e-06 | 3.35e-06 | 1.63e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.90e-07 |
| Ni-63 | 1.30e-04 | 9.01e-06 | 4.36e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.88e-06 |
| Ni-65 | 5.28e-07 | 6.86e-08 | 3.13e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.74e-06 |
| Cr-64 | 0.00e+00 | 8.33e-08 | 3.91e-08 | 0.00e+00 | 2.10e-07 | 0.00e+00 | 7.10e-06 |
| Zn-65 | 4.84e-06 | 1.54e-05 | 6.96e-06 | 0.00e+00 | 1.03e-05 | 0.00e+00 | 9.70e-06 |
| Zn-69 | 1.03e-08 | 1.97e-08 | 1.37e-09 | 0.00e+00 | 1.28e-08 | 0.00e+00 | 2.96e-09 |
| Zn-69m | 1.70e-07 | 4.08e-07 | 3.73e-08 | 0.00e+00 | 2.47e-07 | 0.00e+00 | 2.49e-05 |
| Sa-79 | 0.00e+00 | 2.63e-06 | 4.39e-07 | 0.00e+00 | 4.55e-06 | 0.00e+00 | 5.38e-07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 2.26e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.59e-06 |
| Br-83 | 0.00e+00 | 0.00e+00 | 4.02e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.79e-08 |
| Br-84 | 0.00e+00 | 0.00e+00 | 5.21e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.09e-13 |
| Br-85 | 0.00e+00 | 0.00e+00 | 2.14e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.11e-05 | 9.83e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.16e-06 |
| Rb-87 | 0.00e+00 | 1.23e-05 | 4.28e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.76e-07 |
| Rb-88 | 0.00e+00 | 6.05e-08 | 3.21e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.36e-19 |
| Rb-89 | 0.00e+00 | 4.01e-08 | 2.82e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.33e-21 |
| Sr-89 | 3.08e-04 | 0.00e+00 | 8.84e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.94e-05 |
| Sr-90 | 8.71e-03 | 0.00e+00 | 1.75e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.19e-04 |
| Sr-91 | 5.67e-06 | 0.00e+00 | 2.29e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.70e-05 |
| Sr-92 | 2.15e-06 | 0.00e+00 | 9.30e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.26e-05 |
| Y-90 | 9.62e-09 | 0.00e+00 | 2.58e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.02e-04 |
| Y-91 | 1.41e-07 | 0.00e+00 | 3.77e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.76e-05 |
| Y-91m | 9.09e-11 | 0.00e+00 | 3.52e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.67e-10 |
| Y-92 | 8.45e-10 | 0.00e+00 | 2.47e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.48e-05 |
| Y-93 | 2.68e-09 | 0.00e+00 | 7.40e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.50e-05 |
| Zr-93 | 4.18e-08 | 2.34e-09 | 1.09e-09 | 0.00e+00 | 8.87e-09 | 0.00e+00 | 2.43e-06 |
| Zr-95 | 3.04e-08 | 9.75e-09 | 6.60e-09 | 0.00e+00 | 1.53e-08 | 0.00e+00 | 3.09e-05 |
| Zr-97 | 1.68e-09 | 3.39e-10 | 1.55e-10 | 0.00e+00 | 5.12e-10 | 0.00e+00 | 1.05e-04 |
| Nb-93m | 2.55e-08 | 8.32e-09 | 2.05e-09 | 0.00e+00 | 9.57e-09 | 0.00e+00 | 3.84e-06 |
| Nb-95 | 6.22e-09 | 3.46e-09 | 1.86e-09 | 0.00e+00 | 3.42e-09 | 0.00e+00 | 2.10e-05 |
| Nb-97 | 5.22e-11 | 1.32e-11 | 4.82e-12 | 0.00e+00 | 1.54e-11 | 0.00e+00 | 4.87e-08 |
| Mo-93 | 0.00e+00 | 7.51e-06 | 2.03e-07 | 0.00e+00 | 2.13e-06 | 0.00e+00 | 1.22e-06 |
| Mo-99 | 0.00e+00 | 4.31e-06 | 8.20e-07 | 0.00e+00 | 9.76e-06 | 0.00e+00 | 9.99e-06 |
| Tc-101 | 2.54e-10 | 3.66e-10 | 3.59e-09 | 0.00e+00 | 6.59e-09 | 1.87e-10 | 1.10e-21 |
| Tc-99 | 1.25e-07 | 1.86e-07 | 5.02e-08 | 0.00e+00 | 2.34e-06 | 1.58e-08 | 6.08e-06 |
| Tc-99m | 2.47e-10 | 6.98e-10 | 8.89e-09 | 0.00e+00 | 1.06e-08 | 3.42e-10 | 4.13e-07 |
| Ru-103 | 1.85e-07 | 0.00e+00 | 7.97e-08 | 0.00e+00 | 7.06e-07 | 0.00e+00 | 2.16e-05 |
| Ru-105 | 1.54e-08 | 0.00e+00 | 6.08e-09 | 0.00e+00 | 1.99e-07 | 0.00e+00 | 9.42e-06 |
| Ru-106 | 2.75e-06 | 0.00e+00 | 3.48e-07 | 0.00e+00 | 5.31e-06 | 0.00e+00 | 1.78e-04 |
| Rh-105 | 1.21e-07 | 8.85e-08 | 5.83e-08 | 0.00e+00 | 3.76e-07 | 0.00e+00 | 1.41e-05 |
| Pd-107 | 0.00e+00 | 1.47e-07 | 9.40e-09 | 0.00e+00 | 1.32e-06 | 0.00e+00 | 9.11e-07 |
| Pd-109 | 0.00e+00 | 1.77e-07 | 3.99e-08 | 0.00e+00 | 1.01e-06 | 0.00e+00 | 1.96e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Ag-110m | 1.60e-07 | 1.48e-07 | 8.79e-08 | 0.00e+00 | 2.91e-07 | 0.00e+00 | 6.04e-05 |
| Ag-111 | 5.81e-08 | 2.43e-08 | 1.21e-08 | 0.00e+00 | 7.84e-08 | 0.00e+00 | 4.46e-05 |
| Cd-113m | 0.00e+00 | 3.18e-06 | 1.02e-07 | 0.00e+00 | 3.50e-06 | 0.00e+00 | 2.56e-05 |
| Cd-115m | 0.00e+00 | 1.84e-06 | 5.87e-08 | 0.00e+00 | 1.46e-06 | 0.00e+00 | 7.74e-05 |
| Sr-123 | 3.11e-05 | 5.15e-07 | 7.59e-07 | 4.38e-07 | 0.00e+00 | 0.00e+00 | 6.33e-05 |
| Sr-125 | 8.33e-06 | 1.68e-07 | 3.78e-07 | 1.39e-07 | 0.00e+00 | 0.00e+00 | 1.04e-04 |
| Sr-126 | 8.45e-05 | 1.67e-06 | 2.40e-06 | 4.92e-07 | 0.00e+00 | 0.00e+00 | 2.43e-05 |
| Sb-124 | 2.80e-06 | 5.29e-08 | 1.11e-06 | 6.79e-09 | 0.00e+00 | 2.18e-06 | 7.95e-05 |
| Sb-125 | 1.79e-06 | 2.00e-08 | 4.26e-07 | 1.82e-09 | 0.00e+00 | 1.38e-06 | 1.97e-05 |
| Sb-126 | 1.15e-06 | 2.34e-08 | 4.15e-07 | 7.04e-09 | 0.00e+00 | 7.05e-07 | 9.40e-05 |
| Sb-127 | 2.58e-07 | 5.65e-09 | 9.90e-08 | 3.10e-09 | 0.00e+00 | 1.53e-07 | 5.90e-05 |
| Te-125m | 2.68e-06 | 9.71e-07 | 3.59e-07 | 8.06e-07 | 1.09e-05 | 0.00e+00 | 1.07e-05 |
| Te-127 | 1.10e-07 | 3.95e-08 | 2.38e-08 | 8.15e-08 | 4.48e-07 | 0.00e+00 | 8.68e-06 |
| Te-127m | 6.77e-06 | 2.42e-06 | 8.25e-07 | 1.73e-06 | 2.75e-05 | 0.00e+00 | 2.27e-05 |
| Te-129 | 3.14e-08 | 1.18e-08 | 7.65e-09 | 2.41e-08 | 1.32e-07 | 0.00e+00 | 2.37e-08 |
| Te-129m | 1.15e-05 | 4.29e-06 | 1.82e-06 | 3.95e-06 | 4.80e-05 | 0.00e+00 | 5.79e-05 |
| Te-131 | 1.97e-08 | 8.23e-09 | 6.22e-09 | 1.62e-08 | 8.63e-08 | 0.00e+00 | 2.79e-09 |
| Te-131m | 1.73e-06 | 8.46e-07 | 7.05e-07 | 1.34e-06 | 8.57e-06 | 0.00e+00 | 8.40e-05 |
| Te-132 | 2.52e-06 | 1.63e-06 | 1.53e-06 | 1.80e-06 | 1.57e-05 | 0.00e+00 | 7.71e-05 |
| Te-133m | 4.62e-08 | 2.70e-08 | 2.60e-08 | 3.91e-08 | 2.67e-07 | 0.00e+00 | 9.26e-09 |
| Te-134 | 3.24e-08 | 2.12e-08 | 1.30e-08 | 2.83e-08 | 2.05e-07 | 0.00e+00 | 3.59e-11 |
| I-129 | 3.27e-06 | 2.81e-06 | 9.21e-06 | 7.23e-03 | 6.04e-06 | 0.00e+00 | 4.44e-07 |
| I-130 | 7.56e-07 | 2.23e-06 | 8.80e-07 | 1.89e-04 | 3.48e-06 | 0.00e+00 | 1.92e-06 |
| I-131 | 4.16e-06 | 5.95e-06 | 3.41e-06 | 1.95e-03 | 1.02e-05 | 0.00e+00 | 1.57e-06 |
| I-132 | 2.03e-07 | 5.43e-07 | 1.90e-07 | 1.90e-05 | 8.65e-07 | 0.00e+00 | 1.02e-07 |
| I-133 | 1.42e-06 | 2.47e-06 | 7.53e-07 | 3.63e-04 | 4.31e-06 | 0.00e+00 | 2.22e-06 |
| I-134 | 1.06e-07 | 2.88e-07 | 1.03e-07 | 4.99e-06 | 4.58e-07 | 0.00e+00 | 2.51e-10 |
| I-135 | 4.43e-07 | 1.16e-06 | 4.28e-07 | 7.65e-05 | 1.86e-06 | 0.00e+00 | 1.31e-06 |
| Cs-134 | 6.22e-05 | 1.48e-04 | 1.21e-04 | 0.00e+00 | 4.79e-05 | 1.59e-05 | 2.59e-06 |
| Cs-134m | 2.13e-08 | 4.48e-08 | 2.29e-08 | 0.00e+00 | 2.43e-08 | 3.83e-09 | 1.58e-08 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.95e-05 | 1.80e-05 | 7.99e-06 | 0.00e+00 | 6.81e-06 | 2.04e-06 | 4.21e-07 |
| Cs-136 | 6.51e-06 | 2.57e-05 | 1.85e-05 | 0.00e+00 | 1.43e-05 | 1.96e-06 | 2.92e-06 |
| Cs-137 | 7.97e-05 | 1.09e-04 | 7.14e-05 | 0.00e+00 | 3.70e-05 | 1.23e-05 | 2.11e-06 |
| Cs-138 | 5.52e-08 | 1.09e-07 | 5.40e-08 | 0.00e+00 | 8.01e-08 | 7.91e-09 | 4.65e-13 |
| Cs-139 | 3.41e-08 | 5.08e-08 | 1.85e-08 | 0.00e+00 | 4.07e-08 | 3.70e-09 | 1.10e-30 |
| Ba-139 | 9.70e-08 | 6.91e-11 | 2.84e-09 | 0.00e+00 | 6.46e-11 | 3.92e-11 | 1.72e-07 |
| Ba-140 | 2.03e-05 | 2.55e-08 | 1.33e-06 | 0.00e+00 | 8.67e-09 | 1.46e-08 | 4.18e-05 |
| Ba-141 | 4.71e-08 | 3.56e-11 | 1.59e-09 | 0.00e+00 | 3.31e-11 | 2.02e-11 | 2.22e-17 |
| Ba-142 | 2.13e-08 | 2.19e-11 | 1.34e-09 | 0.00e+00 | 1.85e-11 | 1.24e-11 | 3.00e-26 |
| La-140 | 2.50e-09 | 1.26e-09 | 3.33e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.25e-05 |
| La-141 | 3.19e-10 | 9.90e-11 | 1.62e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.18e-05 |
| La-142 | 1.28e-10 | 5.82e-11 | 1.45e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.25e-07 |
| Ce-141 | 9.36e-09 | 6.33e-09 | 7.18e-10 | 0.00e+00 | 2.94e-09 | 0.00e+00 | 2.42e-05 |
| Ce-143 | 1.65e-09 | 1.22e-06 | 1.35e-10 | 0.00e+00 | 5.37e-10 | 0.00e+00 | 4.56e-05 |
| Ce-144 | 4.88e-07 | 2.04e-07 | 2.62e-08 | 0.00e+00 | 1.21e-07 | 0.00e+00 | 1.65e-04 |
| Pr-143 | 9.20e-09 | 3.69e-09 | 4.56e-10 | 0.00e+00 | 2.13e-09 | 0.00e+00 | 4.03e-05 |
| Pr-144 | 3.01e-11 | 1.25e-11 | 1.53e-12 | 0.00e+00 | 7.05e-12 | 0.00e+00 | 4.33e-18 |
| Nd-147 | 6.29e-09 | 7.27e-09 | 4.35e-10 | 0.00e+00 | 4.25e-09 | 0.00e+00 | 3.49e-05 |
| Pm-147 | 7.54e-08 | 7.09e-09 | 2.87e-09 | 0.00e+00 | 1.34e-08 | 0.00e+00 | 8.93e-06 |
| Pm-148 | 7.17e-09 | 1.19e-09 | 5.99e-10 | 0.00e+00 | 2.25e-09 | 0.00e+00 | 9.35e-05 |
| Pm-148m | 3.07e-08 | 7.95e-09 | 6.08e-09 | 0.00e+00 | 1.20e-08 | 0.00e+00 | 6.74e-05 |
| Pm-149 | 1.52e-09 | 2.15e-10 | 8.78e-11 | 0.00e+00 | 4.06e-10 | 0.00e+00 | 4.03e-05 |
| Pm-151 | 6.97e-10 | 1.17e-10 | 5.91e-11 | 0.00e+00 | 2.09e-10 | 0.00e+00 | 3.22e-05 |
| Sm-151 | 6.90e-08 | 1.19e-08 | 2.85e-09 | 0.00e+00 | 1.33e-08 | 0.00e+00 | 5.25e-06 |
| Sm-153 | 8.57e-10 | 7.15e-10 | 5.22e-11 | 0.00e+00 | 2.31e-10 | 0.00e+00 | 2.55e-05 |
| Eu-152 | 1.95e-07 | 4.44e-08 | 3.90e-08 | 0.00e+00 | 2.75e-07 | 0.00e+00 | 2.56e-05 |
| Eu-154 | 6.15e-07 | 7.56e-08 | 5.38e-08 | 0.00e+00 | 3.62e-07 | 0.00e+00 | 5.48e-05 |
| Eu-155 | 8.60e-08 | 1.22e-08 | 7.87e-09 | 0.00e+00 | 5.63e-08 | 0.00e+00 | 9.60e-06 |
| Eu-156 | 1.37e-08 | 1.06e-08 | 1.71e-09 | 0.00e+00 | 7.08e-09 | 0.00e+00 | 7.26e-05 |
| Tb-150 | 4.70e-08 | 0.00e+00 | 5.86e-09 | 0.00e+00 | 1.94e-08 | 0.00e+00 | 4.33e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| Hc-166m | 2.70e-07 | 8.43e-08 | 6.40e-08 | 0.00e+00 | 1.26e-07 | 0.00e+00 | 2.56e-05 |
| W-181 | 9.91e-09 | 3.23e-09 | 3.46e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.68e-07 |
| W-185 | 4.05e-07 | 1.35e-07 | 1.42e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.56e-05 |
| W-187 | 1.03e-07 | 8.61e-08 | 3.01e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.82e-05 |
| Pb-210 | 1.53e-02 | 4.37e-03 | 5.44e-04 | 0.00e+00 | 1.23e-02 | 0.00e+00 | 2.24e-06 |
| Bi-210 | 4.61e-07 | 3.18e-06 | 2.64e-07 | 0.00e+00 | 3.83e-05 | 0.00e+00 | 4.75e-05 |
| Po-210 | 3.56e-04 | 7.56e-04 | 8.59e-05 | 0.00e+00 | 2.52e-03 | 0.00e+00 | 6.36e-05 |
| Ra-223 | 4.97e-03 | 7.65e-06 | 9.94e-04 | 0.00e+00 | 2.17e-04 | 0.00e+00 | 3.21e-04 |
| Ra-224 | 1.61e-03 | 3.90e-06 | 3.23e-04 | 0.00e+00 | 1.10e-04 | 0.00e+00 | 3.40e-04 |
| Ra-225 | 6.56e-03 | 7.78e-06 | 1.31e-03 | 0.00e+00 | 2.21e-04 | 0.00e+00 | 3.06e-04 |
| Ra-226 | 3.02e-01 | 5.74e-06 | 2.20e-01 | 0.00e+00 | 1.63e-04 | 0.00e+00 | 3.32e-04 |
| Ra-228 | 1.12e-01 | 3.12e-06 | 1.21e-01 | 0.00e+00 | 8.83e-05 | 0.00e+00 | 5.64e-05 |
| Ac-225 | 4.40e-06 | 6.06e-06 | 2.96e-07 | 0.00e+00 | 6.90e-07 | 0.00e+00 | 4.07e-04 |
| Ac-227 | 1.87e-03 | 2.48e-04 | 1.11e-04 | 0.00e+00 | 8.00e-05 | 0.00e+00 | 8.19e-05 |
| Ta-227 | 1.37e-05 | 2.48e-07 | 3.95e-07 | 0.00e+00 | 1.41e-06 | 0.00e+00 | 5.40e-04 |
| Th-228 | 4.96e-04 | 8.40e-06 | 1.68e-05 | 0.00e+00 | 4.67e-05 | 0.00e+00 | 5.63e-04 |
| Th-229 | 1.36e-02 | 3.89e-04 | 2.25e-04 | 0.00e+00 | 1.88e-03 | 0.00e+00 | 7.81e-05 |
| Th-230 | 2.06e-03 | 1.17e-04 | 5.70e-05 | 0.00e+00 | 5.65e-04 | 0.00e+00 | 6.02e-05 |
| Th-232 | 2.30e-03 | 1.00e-04 | 1.50e-06 | 0.00e+00 | 4.82e-04 | 0.00e+00 | 5.12e-05 |
| Th-234 | 8.01e-08 | 4.71e-09 | 2.31e-09 | 0.00e+00 | 2.67e-08 | 0.00e+00 | 1.13e-04 |
| Pa-231 | 4.10e-03 | 1.54e-04 | 1.59e-04 | 0.00e+00 | 8.64e-04 | 0.00e+00 | 7.17e-05 |
| Fa-233 | 5.26e-09 | 1.06e-09 | 9.12e-10 | 0.00e+00 | 3.99e-09 | 0.00e+00 | 1.64e-05 |
| U-232 | 4.13e-03 | 0.00e+00 | 2.95e-04 | 0.00e+00 | 4.47e-04 | 0.00e+00 | 6.78e-05 |
| U-233 | 8.71e-04 | 0.00e+00 | 5.28e-05 | 0.00e+00 | 2.03e-04 | 0.00e+00 | 6.27e-05 |
| U-234 | 8.36e-04 | 0.00e+00 | 5.17e-05 | 0.00e+00 | 1.99e-04 | 0.00e+00 | 6.14e-05 |
| U-235 | 8.01e-04 | 0.00e+00 | 4.86e-05 | 0.00e+00 | 1.87e-04 | 0.00e+00 | 7.81e-05 |
| U-236 | 8.01e-04 | 0.00e+00 | 4.96e-05 | 0.00e+00 | 1.91e-04 | 0.00e+00 | 5.76e-05 |
| U-237 | 5.52e-08 | 0.00e+00 | 1.47e-08 | 0.00e+00 | 2.27e-07 | 0.00e+00 | 1.94e-05 |
| U-238 | 7.67e-04 | 0.00e+00 | 4.54e-05 | 0.00e+00 | 1.75e-04 | 0.00e+00 | 5.50e-05 |
| Np-237 | 1.26e-03 | 8.96e-05 | 5.54e-05 | 0.00e+00 | 4.12e-04 | 0.00e+00 | 7.94e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Adult age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.37e-08 | 3.69e-10 | 2.13e-10 | 0.00e+00 | 1.25e-09 | 0.00e+00 | 3.43e-05 |
| Np-239 | 1.19e-09 | 1.17e-10 | 6.45e-11 | 0.00e+00 | 3.65e-10 | 0.00e+00 | 2.40e-05 |
| Pu-238 | 6.30e-04 | 7.98e-05 | 1.71e-05 | 0.00e+00 | 7.32e-05 | 0.00e+00 | 7.30e-05 |
| Pu-239 | 7.25e-04 | 8.71e-05 | 1.91e-05 | 0.00e+00 | 8.11e-05 | 0.00e+00 | 6.66e-05 |
| Pu-240 | 7.24e-04 | 8.70e-05 | 1.91e-05 | 0.00e+00 | 8.10e-05 | 0.00e+00 | 6.78e-05 |
| Pu-241 | 1.57e-05 | 7.45e-07 | 3.32e-07 | 0.00e+00 | 1.53e-06 | 0.00e+00 | 1.40e-06 |
| Pu-242 | 6.72e-04 | 8.39e-05 | 1.84e-05 | 0.00e+00 | 7.81e-05 | 0.00e+00 | 6.53e-05 |
| Pu-244 | 7.84e-04 | 9.61e-05 | 2.11e-05 | 0.00e+00 | 8.95e-05 | 0.00e+00 | 9.73e-05 |
| Am-241 | 7.55e-04 | 7.05e-04 | 5.41e-05 | 0.00e+00 | 4.07e-04 | 0.00e+00 | 7.42e-05 |
| Am-242m | 7.61e-04 | 6.63e-04 | 5.43e-05 | 0.00e+00 | 4.05e-04 | 0.00e+00 | 9.34e-05 |
| Am-243 | 7.54e-04 | 6.90e-04 | 5.30e-05 | 0.00e+00 | 3.99e-04 | 0.00e+00 | 8.70e-05 |
| Cm-242 | 2.06e-05 | 2.19e-05 | 1.37e-06 | 0.00e+00 | 6.22e-06 | 0.00e+00 | 7.92e-05 |
| Cm-243 | 5.99e-04 | 5.49e-04 | 3.75e-05 | 0.00e+00 | 1.75e-04 | 0.00e+00 | 7.81e-05 |
| Cm-244 | 4.56e-04 | 4.27e-04 | 2.87e-05 | 0.00e+00 | 1.34e-04 | 0.00e+00 | 7.55e-05 |
| Cm-245 | 9.38e-04 | 8.17e-04 | 5.76e-05 | 0.00e+00 | 2.69e-04 | 0.00e+00 | 7.04e-05 |
| Cm-246 | 9.30e-04 | 8.16e-04 | 5.75e-05 | 0.00e+00 | 2.68e-04 | 0.00e+00 | 6.91e-05 |
| Cm-247 | 9.07e-04 | 8.04e-04 | 5.67e-05 | 0.00e+00 | 2.64e-04 | 0.00e+00 | 9.09e-05 |
| Cm-248 | 7.54e-03 | 6.63e-03 | 4.67e-04 | 0.00e+00 | 2.18e-03 | 0.00e+00 | 1.47e-03 |
| Cf-252 | 2.61e-04 | 0.00e+00 | 6.29e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.88e-04 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILLI |
| H-3 | 0.00e+00 | 6.04e-08 | 6.04e-08 | 6.04e-08 | 6.04e-08 | 6.04e-08 | 6.04e-08 |
| Be-10 | 4.48e-06 | 6.94e-07 | 1.13e-07 | 0.00e+00 | 5.30e-07 | 0.00e+00 | 2.84e-05 |
| C-14 | 4.06e-06 | 8.12e-07 | 8.12e-07 | 8.12e-07 | 8.12e-07 | 8.12e-07 | 8.12e-07 |
| N-13 | 1.15e-08 | 1.15e-08 | 1.15e-08 | 1.15e-08 | 1.15e-08 | 1.15e-08 | 1.15e-08 |
| F-18 | 8.64e-07 | 0.00e+00 | 9.47e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.78e-08 |
| Na-22 | 2.34e-05 | 2.34e-05 | 2.34e-05 | 2.34e-05 | 2.34e-05 | 2.34e-05 | 2.34e-05 |
| Na-24 | 2.30e-06 | 2.30e-06 | 2.30e-06 | 2.30e-06 | 2.30e-06 | 2.30e-06 | 2.30e-06 |
| P-32 | 2.76e-04 | 1.71e-05 | 1.07e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.32e-05 |
| Ca-41 | 1.97e-04 | 0.00e+00 | 2.13e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.95e-07 |
| Sc-46 | 7.24e-09 | 1.41e-08 | 4.18e-09 | 0.00e+00 | 1.35e-08 | 0.00e+00 | 4.80e-05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 3.60e-09 | 2.00e-09 | 7.89e-10 | 5.14e-09 | 6.05e-07 |
| Mn-54 | 0.00e+00 | 5.90e-06 | 1.17e-06 | 0.00e+00 | 1.76e-06 | 0.00e+00 | 1.21e-05 |
| Mn-56 | 0.00e+00 | 1.58e-07 | 2.81e-08 | 0.00e+00 | 2.00e-07 | 0.00e+00 | 1.04e-05 |
| Fe-55 | 3.78e-06 | 2.68e-06 | 6.25e-07 | 0.00e+00 | 0.00e+00 | 1.70e-06 | 1.16e-06 |
| Fe-59 | 5.87e-06 | 1.37e-05 | 5.29e-06 | 0.00e+00 | 0.00e+00 | 4.32e-06 | 3.24e-05 |
| Co-57 | 0.00e+00 | 2.38e-07 | 3.99e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.44e-06 |
| Co-58 | 0.00e+00 | 9.72e-07 | 2.24e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.34e-05 |
| Co-60 | 0.00e+00 | 2.81e-06 | 6.33e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.66e-05 |
| Ni-59 | 1.32e-05 | 4.66e-06 | 2.24e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.31e-07 |
| Ni-63 | 1.77e-04 | 1.25e-05 | 6.00e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.99e-06 |
| Ni-65 | 7.49e-07 | 9.57e-08 | 4.36e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.19e-06 |
| Cu-64 | 0.00e+00 | 1.15e-07 | 5.41e-08 | 0.00e+00 | 2.91e-07 | 0.00e+00 | 8.92e-06 |
| Zn-65 | 5.76e-06 | 2.00e-05 | 9.33e-06 | 0.00e+00 | 1.28e-05 | 0.00e+00 | 8.47e-06 |
| Zn-69 | 1.47e-08 | 2.80e-08 | 1.96e-09 | 0.00e+00 | 1.83e-08 | 0.00e+00 | 5.16e-08 |
| Zn-69m | 2.40e-07 | 5.66e-07 | 5.19e-08 | 0.00e+00 | 3.44e-07 | 0.00e+00 | 3.11e-05 |
| Se-79 | 0.00e+00 | 3.73e-06 | 6.27e-07 | 0.00e+00 | 6.50e-06 | 0.00e+00 | 5.70e-07 |
| Er-82 | 0.00e+00 | 0.00e+00 | 3.04e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-83 | 0.00e+00 | 0.00e+00 | 5.74e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-84 | 0.00e+00 | 0.00e+00 | 7.22e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Er-85 | 0.00e+00 | 0.00e+00 | 3.05e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 2.98e-05 | 1.40e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.41e-06 |
| Rb-87 | 0.00e+00 | 1.75e-05 | 6.11e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.11e-07 |
| Rb-88 | 0.00e+00 | 8.52e-08 | 4.54e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.30e-15 |
| Rb-89 | 0.00e+00 | 5.50e-08 | 3.89e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.43e-17 |
| Sr-89 | 4.40e-04 | 0.00e+00 | 1.26e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.24e-05 |
| Sr-90 | 1.02e-02 | 0.00e+00 | 2.04e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.33e-04 |
| Sr-91 | 8.07e-06 | 0.00e+00 | 3.21e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.66e-05 |
| Sr-92 | 3.05e-06 | 0.00e+00 | 1.30e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.77e-05 |
| Y-90 | 1.37e-08 | 0.00e+00 | 3.69e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.13e-04 |
| Y-91 | 2.01e-07 | 0.00e+00 | 5.39e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.24e-05 |
| Y-91m | 1.29e-10 | 0.00e+00 | 4.93e-12 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.09e-09 |
| Y-92 | 1.21e-09 | 0.00e+00 | 3.50e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.32e-05 |
| Y-93 | 3.83e-09 | 0.00e+00 | 1.05e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.17e-04 |
| Zr-93 | 5.53e-08 | 2.73e-09 | 1.49e-09 | 0.00e+00 | 9.65e-09 | 0.00e+00 | 2.58e-06 |
| Zr-95 | 4.12e-08 | 1.30e-08 | 8.94e-09 | 0.00e+00 | 1.91e-08 | 0.00e+00 | 3.00e-05 |
| Zr-97 | 2.37e-09 | 4.69e-10 | 2.16e-10 | 0.00e+00 | 7.11e-10 | 0.00e+00 | 1.27e-04 |
| Nb-93m | 3.44e-08 | 1.13e-08 | 2.83e-09 | 0.00e+00 | 1.32e-08 | 0.00e+00 | 4.07e-06 |
| Nb-95 | 8.22e-09 | 4.56e-09 | 2.51e-09 | 0.00e+00 | 4.42e-09 | 0.00e+00 | 1.95e-05 |
| Nb-97 | 7.37e-11 | 1.83e-11 | 6.68e-12 | 0.00e+00 | 2.14e-11 | 0.00e+00 | 4.37e-07 |
| Mo-93 | 0.00e+00 | 1.06e-05 | 2.90e-07 | 0.00e+00 | 3.04e-06 | 0.00e+00 | 1.29e-06 |
| Mo-99 | 0.00e+00 | 6.03e-06 | 1.15e-06 | 0.00e+00 | 1.38e-05 | 0.00e+00 | 1.08e-05 |
| Tc-101 | 3.60e-10 | 5.12e-10 | 5.03e-09 | 0.00e+00 | 9.26e-09 | 3.12e-10 | 8.75e-17 |
| Tc-99 | 1.79e-07 | 2.63e-07 | 7.17e-08 | 0.00e+00 | 3.34e-06 | 2.72e-08 | 6.44e-06 |
| Tc-99m | 3.32e-10 | 9.26e-10 | 1.20e-08 | 0.00e+00 | 1.38e-08 | 5.14e-10 | 6.08e-07 |
| Ru-103 | 2.55e-07 | 0.00e+00 | 1.09e-07 | 0.00e+00 | 8.99e-07 | 0.00e+00 | 2.13e-05 |
| Ru-105 | 2.18e-08 | 0.00e+00 | 8.46e-09 | 0.00e+00 | 2.75e-07 | 0.00e+00 | 1.76e-05 |
| Ru-106 | 3.92e-06 | 0.00e+00 | 4.94e-07 | 0.00e+00 | 7.56e-06 | 0.00e+00 | 1.88e-04 |
| Rh-105 | 1.73e-07 | 1.25e-07 | 8.20e-08 | 0.00e+00 | 5.31e-07 | 0.00e+00 | 1.59e-05 |
| Pd-107 | 0.00e+00 | 2.08e-07 | 1.34e-08 | 0.00e+00 | 1.88e-06 | 0.00e+00 | 9.66e-07 |
| Pd-109 | 0.00e+00 | 2.51e-07 | 5.70e-08 | 0.00e+00 | 1.45e-06 | 0.00e+00 | 2.53e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 2.05e-07 | 1.94e-07 | 1.18e-07 | 0.00e+00 | 3.70e-07 | 0.00e+00 | 5.45e-05 |
| Ag-111 | 8.29e-08 | 3.44e-08 | 1.73e-08 | 0.00e+00 | 1.12e-07 | 0.00e+00 | 4.80e-05 |
| Cd-113m | 0.00e+00 | 4.51e-06 | 1.45e-07 | 0.00e+00 | 4.99e-06 | 0.00e+00 | 2.71e-05 |
| Cd-115m | 0.00e+00 | 2.60e-06 | 8.39e-08 | 0.00e+00 | 2.08e-06 | 0.00e+00 | 8.23e-05 |
| Sn-123 | 4.44e-05 | 7.29e-07 | 1.08e-06 | 5.84e-07 | 0.00e+00 | 0.00e+00 | 6.71e-05 |
| Sn-125 | 1.19e-05 | 2.37e-07 | 5.37e-07 | 1.86e-07 | 0.00e+00 | 0.00e+00 | 1.12e-04 |
| Sn-126 | 1.16e-04 | 2.16e-06 | 3.30e-06 | 5.69e-07 | 0.00e+00 | 0.00e+00 | 2.58e-05 |
| Sb-124 | 3.87e-06 | 7.13e-08 | 1.51e-06 | 8.78e-09 | 0.00e+00 | 3.38e-06 | 7.80e-05 |
| Sb-125 | 2.48e-06 | 2.71e-08 | 5.80e-07 | 2.37e-09 | 0.00e+00 | 2.18e-06 | 1.93e-05 |
| Sb-126 | 1.59e-06 | 3.25e-08 | 5.71e-07 | 8.99e-09 | 0.00e+00 | 1.14e-06 | 9.41e-05 |
| Sb-127 | 3.63e-07 | 7.76e-09 | 1.37e-07 | 4.08e-09 | 0.00e+00 | 2.47e-07 | 6.16e-05 |
| Te-125m | 3.83e-06 | 1.38e-06 | 5.12e-07 | 1.07e-06 | 0.00e+00 | 0.00e+00 | 1.13e-05 |
| Te-127 | 1.58e-07 | 5.60e-08 | 3.40e-08 | 1.09e-07 | 6.40e-07 | 0.00e+00 | 1.22e-05 |
| Te-127m | 9.67e-06 | 3.43e-06 | 1.15e-06 | 2.30e-06 | 3.92e-05 | 0.00e+00 | 2.41e-05 |
| Te-129 | 4.48e-08 | 1.67e-08 | 1.09e-08 | 3.20e-08 | 1.88e-07 | 0.00e+00 | 2.45e-07 |
| Te-129m | 1.63e-05 | 6.05e-06 | 2.58e-06 | 5.26e-06 | 6.82e-05 | 0.00e+00 | 6.12e-05 |
| Te-131 | 2.79e-08 | 1.15e-08 | 8.72e-09 | 2.15e-08 | 1.22e-07 | 0.00e+00 | 2.29e-09 |
| Te-131m | 2.44e-06 | 1.17e-06 | 9.76e-07 | 1.76e-06 | 1.22e-05 | 0.00e+00 | 9.39e-05 |
| Te-132 | 3.49e-06 | 2.21e-06 | 2.08e-06 | 2.33e-06 | 2.12e-05 | 0.00e+00 | 7.00e-05 |
| Te-133m | 6.44e-08 | 3.66e-08 | 3.56e-08 | 5.11e-08 | 3.62e-07 | 0.00e+00 | 1.48e-07 |
| Te-134 | 4.47e-08 | 2.87e-08 | 3.00e-08 | 3.67e-08 | 2.74e-07 | 0.00e+00 | 1.66e-09 |
| I-129 | 4.66e-06 | 3.92e-06 | 6.54e-06 | 4.77e-03 | 7.01e-06 | 0.00e+00 | 4.57e-07 |
| I-130 | 1.03e-06 | 2.98e-06 | 1.19e-06 | 2.43e-04 | 4.59e-06 | 0.00e+00 | 2.29e-06 |
| I-131 | 5.85e-06 | 8.19e-06 | 4.40e-06 | 2.39e-03 | 1.41e-05 | 0.00e+00 | 1.62e-06 |
| I-132 | 2.79e-07 | 7.30e-07 | 2.62e-07 | 2.46e-05 | 1.15e-06 | 0.00e+00 | 3.18e-07 |
| I-133 | 2.01e-06 | 3.41e-06 | 1.04e-06 | 4.76e-04 | 5.98e-06 | 0.00e+00 | 2.58e-06 |
| I-134 | 1.46e-07 | 3.87e-07 | 1.39e-07 | 6.45e-06 | 6.10e-07 | 0.00e+00 | 5.10e-09 |
| I-135 | 6.10e-07 | 1.57e-06 | 5.82e-07 | 1.01e-04 | 2.48e-06 | 0.00e+00 | 1.74e-06 |
| Cs-134 | 8.37e-05 | 1.97e-04 | 9.14e-05 | 0.00e+00 | 6.26e-05 | 2.39e-05 | 2.45e-06 |
| Cs-134m | 2.94e-08 | 6.09e-08 | 3.13e-08 | 0.00e+00 | 3.39e-08 | 5.95e-09 | 4.05e-08 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 2.78e-05 | 2.55e-05 | 5.96e-06 | 0.00e+00 | 9.73e-06 | 3.52e-06 | 4.46e-07 |
| Cs-136 | 8.59e-06 | 3.38e-05 | 2.27e-05 | 0.00e+00 | 1.84e-05 | 2.90e-06 | 2.72e-06 |
| Cs-137 | 1.12e-04 | 1.49e-04 | 5.19e-05 | 0.00e+00 | 5.07e-05 | 1.97e-05 | 2.12e-06 |
| Cs-138 | 7.76e-08 | 1.49e-07 | 7.45e-08 | 0.00e+00 | 1.10e-07 | 1.28e-08 | 6.76e-11 |
| Cs-139 | 4.87e-08 | 7.17e-08 | 2.63e-08 | 0.00e+00 | 5.79e-08 | 6.34e-09 | 3.33e-23 |
| Ba-139 | 1.39e-07 | 9.78e-11 | 4.05e-09 | 0.00e+00 | 9.22e-11 | 6.74e-11 | 1.24e-06 |
| Ba-140 | 2.84e-05 | 3.48e-08 | 1.83e-06 | 0.00e+00 | 1.18e-08 | 2.34e-08 | 4.38e-05 |
| Ba-141 | 6.71e-08 | 5.01e-11 | 2.24e-09 | 0.00e+00 | 4.65e-11 | 3.43e-11 | 1.43e-13 |
| Ba-142 | 2.99e-08 | 2.99e-11 | 1.84e-09 | 0.00e+00 | 2.53e-11 | 1.99e-11 | 9.18e-20 |
| La-140 | 3.48e-09 | 1.71e-09 | 4.55e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.82e-05 |
| La-141 | 4.55e-10 | 1.40e-10 | 2.31e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.48e-05 |
| La-142 | 1.79e-10 | 7.95e-11 | 1.98e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.42e-06 |
| Ce-141 | 1.33e-08 | 8.88e-09 | 1.02e-09 | 0.00e+00 | 4.18e-09 | 0.00e+00 | 2.54e-05 |
| Ce-143 | 2.35e-09 | 1.71e-06 | 1.91e-10 | 0.00e+00 | 7.67e-10 | 0.00e+00 | 5.14e-05 |
| Ce-144 | 6.96e-07 | 2.88e-07 | 3.74e-08 | 0.00e+00 | 1.72e-07 | 0.00e+00 | 1.75e-04 |
| Pr-143 | 1.31e-08 | 5.23e-09 | 6.52e-10 | 0.00e+00 | 3.04e-09 | 0.00e+00 | 4.31e-05 |
| Pr-144 | 4.30e-11 | 1.76e-11 | 2.18e-12 | 0.00e+00 | 1.01e-11 | 0.00e+00 | 4.74e-14 |
| Nd-147 | 9.38e-09 | 1.02e-08 | 6.11e-10 | 0.00e+00 | 5.99e-09 | 0.00e+00 | 3.68e-05 |
| Pm-147 | 1.05e-07 | 9.96e-09 | 4.06e-09 | 0.00e+00 | 1.90e-08 | 0.00e+00 | 9.47e-06 |
| Pm-148 | 1.02e-08 | 1.66e-09 | 8.36e-10 | 0.00e+00 | 3.00e-09 | 0.00e+00 | 9.90e-05 |
| Pm-148m | 4.14e-08 | 1.05e-08 | 8.21e-09 | 0.00e+00 | 1.59e-08 | 0.00e+00 | 6.61e-05 |
| Pm-149 | 2.17e-09 | 3.05e-10 | 1.25e-10 | 0.00e+00 | 5.81e-10 | 0.00e+00 | 4.49e-05 |
| Pm-151 | 9.87e-10 | 1.63e-10 | 8.25e-11 | 0.00e+00 | 2.93e-10 | 0.00e+00 | 3.66e-05 |
| Sm-151 | 8.73e-08 | 1.68e-08 | 3.94e-09 | 0.00e+00 | 1.84e-08 | 0.00e+00 | 5.70e-06 |
| Sm-153 | 1.22e-09 | 1.01e-09 | 7.43e-11 | 0.00e+00 | 3.30e-10 | 0.00e+00 | 2.85e-05 |
| Eu-152 | 2.45e-07 | 5.90e-08 | 5.20e-08 | 0.00e+00 | 2.74e-07 | 0.00e+00 | 2.17e-05 |
| Eu-154 | 7.91e-07 | 1.02e-07 | 7.19e-08 | 0.00e+00 | 4.56e-07 | 0.00e+00 | 5.39e-05 |
| Eu-155 | 1.74e-07 | 1.68e-08 | 1.04e-08 | 0.00e+00 | 6.57e-08 | 0.00e+00 | 9.63e-05 |
| Eu-156 | 1.92e-08 | 1.44e-08 | 2.35e-09 | 0.00e+00 | 9.69e-09 | 0.00e+00 | 7.36e-05 |
| Tb-160 | 6.47e-08 | 0.00e+00 | 8.07e-09 | 0.00e+00 | 2.56e-08 | 0.00e+00 | 4.19e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ho-166m | 3.57e-07 | 1.10e-07 | 7.96e-08 | 0.00e+00 | 1.61e-07 | 0.00e+00 | 2.71e-05 |
| W-181 | 1.42e-08 | 4.58e-09 | 4.79e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.90e-07 |
| W-185 | 5.79e-07 | 1.91e-07 | 2.02e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.65e-05 |
| W-187 | 1.46e-07 | 1.19e-07 | 4.17e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.22e-05 |
| Pb-210 | 1.81e-02 | 5.44e-03 | 7.01e-04 | 0.00e+00 | 1.72e-02 | 0.00e+00 | 2.37e-06 |
| Bi-210 | 6.59e-07 | 4.51e-06 | 3.77e-07 | 0.00e+00 | 5.48e-05 | 0.00e+00 | 5.15e-05 |
| Po-210 | 5.09e-04 | 1.07e-03 | 1.23e-04 | 0.00e+00 | 3.60e-03 | 0.00e+00 | 6.75e-05 |
| Ra-223 | 7.11e-03 | 1.08e-05 | 1.42e-03 | 0.00e+00 | 3.10e-04 | 0.00e+00 | 3.43e-04 |
| Ra-224 | 2.31e-03 | 5.52e-06 | 4.61e-04 | 0.00e+00 | 1.58e-04 | 0.00e+00 | 3.71e-04 |
| Ra-225 | 9.37e-03 | 1.10e-05 | 1.87e-03 | 0.00e+00 | 3.15e-04 | 0.00e+00 | 3.27e-04 |
| Ra-226 | 3.22e-01 | 8.13e-06 | 2.39e-01 | 0.00e+00 | 2.32e-04 | 0.00e+00 | 3.51e-04 |
| Ra-228 | 1.37e-01 | 4.41e-06 | 1.51e-01 | 0.00e+00 | 1.26e-04 | 0.00e+00 | 5.98e-05 |
| Ac-225 | 6.29e-06 | 8.59e-06 | 4.22e-07 | 0.00e+00 | 9.85e-07 | 0.00e+00 | 4.36e-04 |
| Ac-227 | 2.05e-03 | 3.03e-04 | 1.22e-04 | 0.00e+00 | 8.81e-05 | 0.00e+00 | 8.68e-05 |
| Th-227 | 1.96e-05 | 3.52e-07 | 5.65e-07 | 0.00e+00 | 2.01e-06 | 0.00e+00 | 5.75e-04 |
| Th-228 | 6.80e-04 | 1.14e-05 | 2.30e-05 | 0.00e+00 | 6.41e-05 | 0.00e+00 | 5.97e-04 |
| Th-229 | 1.43e-02 | 4.11e-04 | 2.37e-04 | 0.00e+00 | 1.99e-03 | 0.00e+00 | 8.28e-05 |
| Th-230 | 2.16e-03 | 1.23e-04 | 6.00e-05 | 0.00e+00 | 5.99e-04 | 0.00e+00 | 6.38e-05 |
| Th-232 | 2.42e-03 | 1.05e-04 | 1.63e-06 | 0.00e+00 | 5.11e-04 | 0.00e+00 | 5.43e-05 |
| Th-234 | 1.14e-07 | 6.68e-09 | 3.31e-09 | 0.00e+00 | 3.81e-08 | 0.00e+00 | 1.21e-04 |
| Pa-231 | 4.31e-03 | 1.62e-04 | 1.68e-04 | 0.00e+00 | 9.10e-04 | 0.00e+00 | 7.60e-05 |
| Pa-233 | 7.33e-09 | 1.41e-09 | 1.26e-09 | 0.00e+00 | 5.32e-09 | 0.00e+00 | 1.61e-05 |
| U-232 | 5.89e-03 | 0.00e+00 | 4.21e-04 | 0.00e+00 | 6.38e-04 | 0.00e+00 | 7.19e-05 |
| U-233 | 1.24e-03 | 0.00e+00 | 7.54e-05 | 0.00e+00 | 2.90e-04 | 0.00e+00 | 6.65e-05 |
| U-234 | 1.19e-03 | 0.00e+00 | 7.39e-05 | 0.00e+00 | 2.85e-04 | 0.00e+00 | 6.51e-05 |
| U-235 | 1.14e-03 | 0.00e+00 | 6.94e-05 | 0.00e+00 | 2.67e-04 | 0.00e+00 | 8.28e-05 |
| U-236 | 1.14e-03 | 0.00e+00 | 7.09e-05 | 0.00e+00 | 2.73e-04 | 0.00e+00 | 6.11e-05 |
| U-237 | 7.89e-08 | 0.00e+00 | 2.10e-08 | 0.00e+00 | 3.24e-07 | 0.00e+00 | 2.09e-05 |
| U-238 | 1.09e-03 | 0.00e+00 | 6.49e-05 | 0.00e+00 | 2.50e-04 | 0.00e+00 | 5.83e-05 |
| Np-237 | 1.33e-03 | 9.55e-05 | 5.85e-05 | 0.00e+00 | 4.33e-04 | 0.00e+00 | 8.41e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Teen age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.95e-08 | 5.22e-10 | 3.04e-10 | 0.00e+00 | 1.79e-09 | 0.00e+00 | 3.83e-05 |
| Np-239 | 1.76e-09 | 1.66e-10 | 9.22e-11 | 0.00e+00 | 5.21e-10 | 0.00e+00 | 2.67e-05 |
| Pu-238 | 6.70e-04 | 8.58e-05 | 1.82e-05 | 0.00e+00 | 7.80e-05 | 0.00e+00 | 7.73e-05 |
| Pu-239 | 7.65e-04 | 9.29e-05 | 2.01e-05 | 0.00e+00 | 8.57e-05 | 0.00e+00 | 7.06e-05 |
| Pu-240 | 7.64e-04 | 9.27e-05 | 2.01e-05 | 0.00e+00 | 8.56e-05 | 0.00e+00 | 7.19e-05 |
| Pu-241 | 1.75e-05 | 8.40e-07 | 3.69e-07 | 0.00e+00 | 1.71e-06 | 0.00e+00 | 1.48e-06 |
| Pu-242 | 7.09e-04 | 8.94e-05 | 1.94e-05 | 0.00e+00 | 8.25e-05 | 0.00e+00 | 6.92e-05 |
| Pu-244 | 8.28e-04 | 1.02e-04 | 2.22e-05 | 0.00e+00 | 9.45e-05 | 0.00e+00 | 1.03e-04 |
| Am-241 | 7.98e-04 | 7.53e-04 | 5.75e-05 | 0.00e+00 | 4.31e-04 | 0.00e+00 | 7.87e-05 |
| Am-242m | 8.07e-04 | 7.11e-04 | 5.80e-05 | 0.00e+00 | 4.30e-04 | 0.00e+00 | 9.90e-05 |
| Am-243 | 7.96e-04 | 7.35e-04 | 5.62e-05 | 0.00e+00 | 4.22e-04 | 0.00e+00 | 9.23e-05 |
| Cm-242 | 2.94e-05 | 3.10e-05 | 1.95e-06 | 0.00e+00 | 8.89e-06 | 0.00e+00 | 8.40e-05 |
| Cm-243 | 6.50e-04 | 6.03e-04 | 4.09e-05 | 0.00e+00 | 1.91e-04 | 0.00e+00 | 8.28e-05 |
| Cm-244 | 5.04e-04 | 4.77e-04 | 3.19e-05 | 0.00e+00 | 1.49e-04 | 0.00e+00 | 8.00e-05 |
| Cm-245 | 9.90e-04 | 8.71e-04 | 6.10e-05 | 0.00e+00 | 2.85e-04 | 0.00e+00 | 7.46e-05 |
| Cm-246 | 9.82e-04 | 8.70e-04 | 6.09e-05 | 0.00e+00 | 2.84e-04 | 0.00e+00 | 7.33e-05 |
| Cm-247 | 9.57e-04 | 8.57e-04 | 6.00e-05 | 0.00e+00 | 2.80e-04 | 0.00e+00 | 9.63e-05 |
| Cm-248 | 7.95e-03 | 7.06e-03 | 4.95e-04 | 0.00e+00 | 2.31e-03 | 0.00e+00 | 1.55e-03 |
| Cf-252 | 3.47e-04 | 0.00e+00 | 8.37e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.05e-04 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 1.16e-07 | 1.16e-07 | 1.16e-07 | 1.16e-07 | 1.16e-07 | 1.16e-07 |
| Be-10 | 1.35e-05 | 1.57e-06 | 3.39e-07 | 0.00e+00 | 1.11e-06 | 0.00e+00 | 2.75e-05 |
| C-14 | 1.21e-05 | 2.42e-06 | 2.42e-06 | 2.42e-06 | 2.42e-06 | 2.42e-06 | 2.42e-06 |
| N-13 | 3.10e-08 | 3.10e-08 | 3.10e-08 | 3.10e-08 | 3.10e-08 | 3.10e-08 | 3.10e-08 |
| F-18 | 2.49e-06 | 0.00e+00 | 2.47e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.74e-07 |
| Na-22 | 5.88e-05 | 5.88e-05 | 5.88e-05 | 5.88e-05 | 5.88e-05 | 5.88e-05 | 5.88e-05 |
| Na-24 | 5.80e-06 | 5.80e-06 | 5.80e-06 | 5.80e-06 | 5.80e-06 | 5.80e-06 | 5.80e-06 |
| P-32 | 8.25e-04 | 3.86e-05 | 3.18e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.28e-05 |
| Ca-41 | 3.47e-04 | 0.00e+00 | 3.79e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.90e-07 |
| Sc-46 | 1.97e-08 | 2.70e-08 | 1.04e-08 | 0.00e+00 | 2.39e-08 | 0.00e+00 | 3.95e-05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 8.90e-09 | 4.94e-09 | 1.35e-09 | 9.02e-09 | 4.72e-07 |
| Mn-54 | 0.00e+00 | 1.07e-05 | 2.85e-06 | 0.00e+00 | 3.00e-06 | 0.00e+00 | 8.98e-06 |
| Mn-56 | 0.00e+00 | 3.34e-07 | 7.54e-08 | 0.00e+00 | 4.04e-07 | 0.00e+00 | 4.84e-05 |
| Fe-55 | 1.15e-05 | 6.10e-06 | 1.89e-06 | 0.00e+00 | 0.00e+00 | 3.45e-06 | 1.13e-06 |
| Fe-59 | 1.65e-05 | 2.67e-05 | 1.33e-05 | 0.00e+00 | 0.00e+00 | 7.74e-06 | 2.78e-05 |
| Cc-57 | 0.00e+00 | 4.93e-07 | 9.98e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.04e-06 |
| Cc-58 | 0.00e+00 | 1.80e-06 | 5.51e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.05e-05 |
| Cc-60 | 0.00e+00 | 5.29e-06 | 1.56e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.93e-05 |
| Ni-59 | 4.02e-05 | 1.07e-05 | 6.82e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.10e-07 |
| Ni-63 | 5.38e-04 | 2.88e-05 | 1.83e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.94e-06 |
| Ni-65 | 2.22e-06 | 2.09e-07 | 1.22e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.56e-05 |
| Cu-64 | 0.00e+00 | 2.45e-07 | 1.48e-07 | 0.00e+00 | 5.92e-07 | 0.00e+00 | 1.15e-05 |
| Zn-65 | 1.37e-05 | 3.65e-05 | 2.27e-05 | 0.00e+00 | 2.30e-05 | 0.00e+00 | 6.41e-06 |
| Zn-69 | 4.38e-08 | 6.33e-08 | 5.85e-09 | 0.00e+00 | 3.84e-08 | 0.00e+00 | 3.99e-06 |
| Zn-69m | 7.10e-07 | 1.21e-06 | 1.43e-07 | 0.00e+00 | 7.03e-07 | 0.00e+00 | 3.94e-05 |
| Se-79 | 0.00e+00 | 8.43e-06 | 1.87e-06 | 0.00e+00 | 1.37e-05 | 0.00e+00 | 5.53e-07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 7.55e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 1.71e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 1.98e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 9.12e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 6.70e-05 | 4.12e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.31e-06 |
| Rb-87 | 0.00e+00 | 3.95e-05 | 1.83e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.92e-07 |
| Rb-88 | 0.00e+00 | 1.90e-07 | 1.32e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.32e-09 |
| Rb-89 | 0.00e+00 | 1.17e-07 | 1.04e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.02e-09 |
| Sr-89 | 1.32e-03 | 0.00e+00 | 3.77e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.11e-05 |
| Sr-90 | 2.56e-02 | 0.00e+00 | 5.15e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.29e-04 |
| Sr-91 | 2.40e-05 | 0.00e+00 | 9.06e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.30e-05 |
| Sr-92 | 9.03e-06 | 0.00e+00 | 3.62e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.71e-04 |
| Y-90 | 4.11e-08 | 0.00e+00 | 1.10e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.17e-04 |
| Y-91 | 6.02e-07 | 0.00e+00 | 1.61e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.02e-05 |
| Y-91m | 3.82e-10 | 0.00e+00 | 1.39e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.48e-07 |
| Y-92 | 3.60e-09 | 0.00e+00 | 1.03e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.04e-04 |
| Y-93 | 1.14e-08 | 0.00e+00 | 3.13e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.70e-04 |
| Zr-93 | 1.67e-07 | 6.25e-09 | 4.45e-09 | 0.00e+00 | 2.42e-08 | 0.00e+00 | 2.37e-06 |
| Zr-95 | 1.16e-07 | 2.55e-08 | 2.27e-08 | 0.00e+00 | 3.65e-08 | 0.00e+00 | 2.66e-05 |
| Zr-97 | 6.99e-09 | 1.01e-09 | 5.96e-10 | 0.00e+00 | 1.45e-09 | 0.00e+00 | 1.53e-04 |
| Nb-93m | 1.05e-07 | 2.62e-08 | 8.61e-09 | 0.00e+00 | 2.83e-08 | 0.00e+00 | 3.95e-06 |
| Nb-95 | 2.25e-08 | 8.76e-09 | 6.26e-09 | 0.00e+00 | 8.23e-09 | 0.00e+00 | 1.62e-05 |
| Nb-97 | 2.17e-10 | 3.92e-11 | 1.83e-11 | 0.00e+00 | 4.35e-11 | 0.00e+00 | 1.21e-05 |
| Mo-93 | 0.00e+00 | 2.41e-05 | 8.65e-07 | 0.00e+00 | 6.35e-06 | 0.00e+00 | 1.22e-06 |
| Mo-99 | 0.00e+00 | 1.33e-05 | 3.29e-06 | 0.00e+00 | 2.84e-05 | 0.00e+00 | 1.10e-05 |
| Tc-101 | 1.07e-09 | 1.12e-09 | 1.42e-08 | 0.00e+00 | 1.91e-08 | 5.92e-10 | 3.56e-09 |
| Tc-99 | 5.35e-07 | 5.96e-07 | 2.14e-07 | 0.00e+00 | 7.02e-06 | 5.27e-08 | 6.25e-06 |
| Tc-99m | 9.23e-10 | 1.81e-09 | 3.00e-08 | 0.00e+00 | 2.63e-08 | 9.19e-10 | 1.03e-06 |
| Ru-103 | 7.31e-07 | 0.00e+00 | 2.81e-07 | 0.00e+00 | 1.84e-06 | 0.00e+00 | 1.89e-05 |
| Ru-105 | 6.45e-08 | 0.00e+00 | 2.34e-08 | 0.00e+00 | 5.67e-07 | 0.00e+00 | 4.21e-05 |
| Ru-106 | 1.17e-05 | 0.00e+00 | 1.46e-06 | 0.00e+00 | 1.58e-05 | 0.00e+00 | 1.82e-04 |
| Rh-105 | 5.14e-07 | 2.76e-07 | 2.36e-07 | 0.00e+00 | 1.10e-06 | 0.00e+00 | 1.71e-05 |
| Pd-107 | 0.00e+00 | 4.72e-07 | 4.01e-08 | 0.00e+00 | 3.95e-06 | 0.00e+00 | 9.37e-07 |
| Pd-109 | 0.00e+00 | 5.67e-07 | 1.70e-07 | 0.00e+00 | 3.04e-06 | 0.00e+00 | 3.35e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Ag-110m | 5.39e-07 | 3.64e-07 | 2.91e-07 | 0.00e+00 | 6.78e-07 | 0.00e+00 | 4.33e-05 |
| Ag-111 | 2.48e-07 | 7.76e-08 | 5.12e-08 | 0.00e+00 | 2.34e-07 | 0.00e+00 | 4.75e-05 |
| Cd-113m | 0.00e+00 | 1.02e-05 | 4.34e-07 | 0.00e+00 | 1.05e-05 | 0.00e+00 | 2.63e-05 |
| Cd-115m | 0.00e+00 | 5.89e-06 | 2.51e-07 | 0.00e+00 | 4.38e-06 | 0.00e+00 | 8.01e-05 |
| Sn-123 | 1.33e-04 | 1.65e-06 | 3.24e-06 | 1.75e-06 | 0.00e+00 | 0.00e+00 | 6.52e-05 |
| Sn-125 | 3.55e-05 | 5.35e-07 | 1.59e-06 | 5.55e-07 | 0.00e+00 | 0.00e+00 | 1.10e-04 |
| Sn-126 | 3.33e-04 | 4.15e-06 | 9.46e-06 | 1.14e-06 | 0.00e+00 | 0.00e+00 | 2.50e-05 |
| Sb-124 | 1.11e-05 | 1.44e-07 | 3.89e-06 | 2.45e-08 | 0.00e+00 | 6.16e-06 | 6.94e-05 |
| Sb-125 | 7.16e-06 | 5.52e-08 | 1.50e-06 | 6.63e-09 | 0.00e+00 | 3.99e-06 | 1.71e-05 |
| Sb-126 | 4.40e-06 | 6.73e-08 | 1.58e-06 | 2.58e-08 | 0.00e+00 | 2.10e-06 | 8.87e-05 |
| Sb-127 | 1.06e-06 | 1.64e-08 | 3.68e-07 | 1.18e-08 | 0.00e+00 | 4.60e-07 | 5.97e-05 |
| Te-125m | 1.14e-05 | 3.09e-06 | 1.52e-06 | 3.20e-06 | 0.00e+00 | 0.00e+00 | 1.10e-05 |
| Te-127 | 4.71e-07 | 1.27e-07 | 1.01e-07 | 3.26e-07 | 1.34e-06 | 0.00e+00 | 1.84e-05 |
| Te-127m | 2.89e-05 | 7.78e-06 | 3.43e-06 | 6.91e-06 | 8.24e-05 | 0.00e+00 | 2.34e-05 |
| Te-129 | 1.34e-07 | 3.74e-08 | 3.18e-08 | 9.56e-08 | 3.92e-07 | 0.00e+00 | 8.34e-06 |
| Te-129m | 4.87e-05 | 1.36e-05 | 7.56e-06 | 1.57e-05 | 1.43e-04 | 0.00e+00 | 5.94e-05 |
| Te-131 | 8.30e-08 | 2.53e-08 | 2.47e-08 | 6.35e-08 | 2.51e-07 | 0.00e+00 | 4.36e-07 |
| Te-131m | 7.20e-06 | 2.49e-06 | 2.65e-06 | 5.12e-06 | 2.41e-05 | 0.00e+00 | 1.01e-04 |
| Te-132 | 1.01e-05 | 4.47e-06 | 5.40e-06 | 6.51e-06 | 4.15e-05 | 0.00e+00 | 4.50e-05 |
| Te-133m | 1.87e-07 | 7.56e-08 | 9.37e-08 | 1.45e-07 | 7.18e-07 | 0.00e+00 | 5.77e-06 |
| Te-134 | 1.29e-07 | 5.80e-08 | 7.74e-08 | 1.02e-07 | 5.37e-07 | 0.00e+00 | 5.89e-07 |
| I-129 | 1.39e-05 | 8.53e-06 | 7.62e-06 | 5.58e-03 | 1.44e-05 | 0.00e+00 | 4.29e-07 |
| I-130 | 2.92e-06 | 5.90e-06 | 3.04e-06 | 6.50e-04 | 8.82e-06 | 0.00e+00 | 2.76e-06 |
| I-131 | 1.72e-05 | 1.73e-05 | 9.83e-06 | 5.72e-03 | 2.84e-05 | 0.00e+00 | 1.54e-06 |
| I-132 | 8.00e-07 | 1.47e-06 | 6.76e-07 | 6.82e-05 | 2.25e-06 | 0.00e+00 | 1.73e-06 |
| I-133 | 5.92e-06 | 7.32e-06 | 2.77e-06 | 1.36e-03 | 1.22e-05 | 0.00e+00 | 2.95e-06 |
| I-134 | 4.19e-07 | 7.78e-07 | 3.58e-07 | 1.79e-05 | 1.19e-06 | 0.00e+00 | 5.16e-07 |
| I-135 | 1.75e-06 | 3.15e-06 | 1.49e-06 | 2.79e-04 | 4.83e-06 | 0.00e+00 | 2.40e-06 |
| Cs-134 | 2.34e-04 | 3.84e-04 | 8.10e-05 | 0.00e+00 | 1.19e-04 | 4.27e-05 | 2.07e-06 |
| Cs-134m | 8.44e-08 | 1.25e-07 | 8.16e-08 | 0.00e+00 | 6.59e-08 | 1.09e-08 | 1.58e-07 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 8.30e-05 | 5.78e-05 | 5.93e-06 | 0.00e+00 | 2.04e-05 | 6.81e-06 | 4.33e-07 |
| Cs-136 | 2.35e-05 | 6.46e-05 | 4.18e-05 | 0.00e+00 | 3.44e-05 | 5.13e-06 | 2.27e-06 |
| Cs-137 | 3.27e-04 | 3.13e-04 | 4.62e-05 | 0.00e+00 | 1.02e-04 | 3.67e-05 | 1.96e-06 |
| Cs-138 | 2.28e-07 | 3.17e-07 | 2.01e-07 | 0.00e+00 | 2.23e-07 | 2.40e-08 | 1.46e-07 |
| Cs-139 | 1.45e-07 | 1.61e-07 | 7.74e-08 | 0.00e+00 | 1.21e-07 | 1.22e-08 | 1.45e-11 |
| Ba-139 | 4.14e-07 | 2.21e-10 | 1.20e-08 | 0.00e+00 | 1.93e-10 | 1.30e-10 | 2.39e-05 |
| Ba-140 | 8.31e-05 | 7.28e-08 | 4.85e-06 | 0.00e+00 | 2.37e-08 | 4.34e-08 | 4.21e-05 |
| Ba-141 | 2.00e-07 | 1.12e-10 | 6.51e-09 | 0.00e+00 | 9.69e-11 | 6.58e-10 | 1.14e-07 |
| Ba-142 | 8.74e-08 | 6.29e-11 | 4.88e-09 | 0.00e+00 | 5.09e-11 | 3.70e-11 | 1.14e-09 |
| La-140 | 1.01e-08 | 3.53e-09 | 1.19e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.84e-05 |
| La-141 | 1.36e-09 | 3.17e-10 | 6.88e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.05e-05 |
| La-142 | 5.24e-10 | 1.67e-10 | 5.23e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.31e-05 |
| Ce-141 | 3.97e-08 | 1.98e-08 | 2.94e-09 | 0.00e+00 | 8.68e-09 | 0.00e+00 | 2.47e-05 |
| Ce-143 | 6.99e-09 | 3.79e-06 | 5.49e-10 | 0.00e+00 | 1.59e-09 | 0.00e+00 | 5.55e-05 |
| Ce-144 | 2.08e-06 | 6.52e-07 | 1.11e-07 | 0.00e+00 | 3.61e-07 | 0.00e+00 | 1.70e-04 |
| Pr-143 | 3.93e-08 | 1.18e-08 | 1.95e-09 | 0.00e+00 | 6.39e-09 | 0.00e+00 | 4.24e-05 |
| Pr-144 | 1.29e-10 | 3.99e-11 | 6.49e-12 | 0.00e+00 | 2.11e-11 | 0.00e+00 | 8.59e-08 |
| Nd-147 | 2.79e-08 | 2.26e-08 | 1.75e-09 | 0.00e+00 | 1.24e-08 | 0.00e+00 | 3.58e-05 |
| Pm-147 | 3.18e-07 | 2.27e-08 | 1.22e-08 | 0.00e+00 | 4.01e-08 | 0.00e+00 | 9.19e-06 |
| Pm-148 | 3.02e-08 | 3.63e-09 | 2.35e-09 | 0.00e+00 | 6.17e-09 | 0.00e+00 | 9.70e-05 |
| Pm-148m | 1.03e-07 | 2.05e-08 | 2.05e-08 | 0.00e+00 | 3.04e-08 | 0.00e+00 | 5.78e-05 |
| Pm-149 | 6.49e-09 | 6.90e-10 | 3.74e-10 | 0.00e+00 | 1.22e-09 | 0.00e+00 | 4.71e-05 |
| Pm-151 | 2.92e-09 | 3.55e-10 | 2.31e-10 | 0.00e+00 | 6.02e-10 | 0.00e+00 | 4.03e-05 |
| Sm-151 | 2.56e-07 | 3.81e-08 | 1.20e-08 | 0.00e+00 | 3.94e-08 | 0.00e+00 | 5.53e-06 |
| Sm-153 | 3.65e-09 | 2.27e-09 | 2.19e-10 | 0.00e+00 | 6.91e-10 | 0.00e+00 | 3.02e-05 |
| Eu-152 | 6.15e-07 | 1.12e-07 | 1.33e-07 | 0.00e+00 | 4.73e-07 | 0.00e+00 | 1.84e-05 |
| Eu-154 | 2.30e-06 | 2.07e-07 | 1.89e-07 | 0.00e+00 | 9.09e-07 | 0.00e+00 | 4.81e-05 |
| Eu-155 | 4.82e-07 | 3.47e-08 | 2.72e-08 | 0.00e+00 | 1.30e-07 | 0.00e+00 | 8.69e-05 |
| Eu-156 | 5.62e-08 | 3.01e-08 | 6.23e-09 | 0.00e+00 | 1.94e-08 | 0.00e+00 | 6.83e-05 |
| Tb-160 | 1.66e-07 | 0.00e+00 | 2.06e-08 | 0.00e+00 | 4.94e-08 | 0.00e+00 | 3.68e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Hc-166m | 1.08e-06 | 2.26e-07 | 1.91e-07 | 0.00e+00 | 3.22e-07 | 0.00e+00 | 2.63e-05 |
| W-181 | 4.23e-08 | 1.04e-08 | 1.43e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.79e-07 |
| W-185 | 1.73e-06 | 4.32e-07 | 6.05e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.61e-05 |
| W-187 | 4.29e-07 | 2.54e-07 | 1.14e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.57e-05 |
| Pb-210 | 4.75e-02 | 1.22e-02 | 2.09e-03 | 0.00e+00 | 3.67e-02 | 0.00e+00 | 2.30e-06 |
| Bi-210 | 1.97e-06 | 1.02e-05 | 1.13e-06 | 0.00e+00 | 1.15e-04 | 0.00e+00 | 5.17e-05 |
| Pc-210 | 1.52e-03 | 2.43e-03 | 3.67e-04 | 0.00e+00 | 7.56e-03 | 0.00e+00 | 6.55e-05 |
| Ra-223 | 2.12e-02 | 2.45e-05 | 4.24e-03 | 0.00e+00 | 6.50e-04 | 0.00e+00 | 3.38e-04 |
| Ra-224 | 6.89e-03 | 1.25e-05 | 1.38e-03 | 0.00e+00 | 3.31e-04 | 0.00e+00 | 3.78e-04 |
| Ra-225 | 2.80e-02 | 2.50e-05 | 5.59e-03 | 0.00e+00 | 6.62e-04 | 0.00e+00 | 3.21e-04 |
| Ra-226 | 5.75e-01 | 1.84e-05 | 4.72e-01 | 0.00e+00 | 4.88e-04 | 0.00e+00 | 3.41e-04 |
| Ra-228 | 3.85e-01 | 9.99e-06 | 4.32e-01 | 0.00e+00 | 2.65e-04 | 0.00e+00 | 5.81e-05 |
| Ac-225 | 1.88e-05 | 1.94e-05 | 1.26e-06 | 0.00e+00 | 2.07e-06 | 0.00e+00 | 4.31e-04 |
| Ac-227 | 4.12e-03 | 6.63e-04 | 2.55e-04 | 0.00e+00 | 1.46e-04 | 0.00e+00 | 8.43e-05 |
| Th-227 | 5.85e-05 | 7.96e-07 | 1.69e-06 | 0.00e+00 | 4.22e-06 | 0.00e+00 | 5.63e-04 |
| Th-228 | 2.07e-03 | 2.65e-05 | 7.00e-05 | 0.00e+00 | 1.38e-04 | 0.00e+00 | 5.79e-04 |
| Th-229 | 2.35e-02 | 5.91e-04 | 3.92e-04 | 0.00e+00 | 2.89e-03 | 0.00e+00 | 8.04e-05 |
| Th-230 | 3.55e-03 | 1.78e-04 | 9.91e-05 | 0.00e+00 | 8.67e-04 | 0.00e+00 | 6.19e-05 |
| Th-232 | 3.96e-03 | 1.52e-04 | 3.01e-06 | 0.00e+00 | 7.41e-04 | 0.00e+00 | 5.27e-05 |
| Th-234 | 3.42e-07 | 1.51e-08 | 9.88e-09 | 0.00e+00 | 8.01e-08 | 0.00e+00 | 1.18e-04 |
| Pa-231 | 7.07e-03 | 2.34e-04 | 2.81e-04 | 0.00e+00 | 1.28e-03 | 0.00e+00 | 7.37e-05 |
| Pa-233 | 1.81e-08 | 2.82e-09 | 3.16e-09 | 0.00e+00 | 1.04e-08 | 0.00e+00 | 1.44e-05 |
| U-232 | 1.76e-02 | 0.00e+00 | 1.26e-03 | 0.00e+00 | 1.34e-03 | 0.00e+00 | 6.98e-05 |
| U-233 | 3.72e-03 | 0.00e+00 | 2.25e-04 | 0.00e+00 | 6.10e-04 | 0.00e+00 | 6.45e-05 |
| U-234 | 3.57e-03 | 0.00e+00 | 2.21e-04 | 0.00e+00 | 5.98e-04 | 0.00e+00 | 6.32e-05 |
| U-235 | 3.42e-03 | 0.00e+00 | 2.07e-04 | 0.00e+00 | 5.61e-04 | 0.00e+00 | 8.03e-05 |
| U-236 | 3.42e-03 | 0.00e+00 | 2.12e-04 | 0.00e+00 | 5.73e-04 | 0.00e+00 | 5.92e-05 |
| U-237 | 2.36e-07 | 0.00e+00 | 6.27e-08 | 0.00e+00 | 6.81e-07 | 0.00e+00 | 2.08e-05 |
| U-238 | 3.27e-03 | 0.00e+00 | 1.94e-04 | 0.00e+00 | 5.24e-04 | 0.00e+00 | 5.66e-05 |
| Np-237 | 2.23e-03 | 1.47e-04 | 9.79e-05 | 0.00e+00 | 6.05e-04 | 0.00e+00 | 8.16e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Child age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 5.83e-08 | 1.18e-09 | 9.08e-10 | 0.00e+00 | 3.76e-09 | 0.00e+00 | 4.04e-05 |
| Np-239 | 5.25e-09 | 3.77e-10 | 2.65e-10 | 0.00e+00 | 1.09e-09 | 0.00e+00 | 2.79e-05 |
| Pu-238 | 1.19e-03 | 1.38e-04 | 3.16e-05 | 0.00e+00 | 1.15e-04 | 0.00e+00 | 7.50e-05 |
| Pu-239 | 1.29e-03 | 1.38e-04 | 3.31e-05 | 0.00e+00 | 1.22e-04 | 0.00e+00 | 6.85e-05 |
| Pu-240 | 1.28e-03 | 1.43e-04 | 3.31e-05 | 0.00e+00 | 1.22e-04 | 0.00e+00 | 6.98e-05 |
| Pu-241 | 3.87e-05 | 1.58e-06 | 8.04e-07 | 0.00e+00 | 2.96e-06 | 0.00e+00 | 1.44e-06 |
| Pu-242 | 1.19e-03 | 1.38e-04 | 3.19e-05 | 0.00e+00 | 1.17e-04 | 0.00e+00 | 6.71e-05 |
| Pu-244 | 1.39e-03 | 1.58e-03 | 3.65e-05 | 0.00e+00 | 1.35e-04 | 0.00e+00 | 1.00e-04 |
| Am-241 | 1.36e-03 | 1.17e-03 | 1.02e-04 | 0.00e+00 | 6.23e-04 | 0.00e+00 | 7.64e-05 |
| Am-242m | 1.40e-03 | 1.12e-03 | 1.04e-04 | 0.00e+00 | 6.30e-04 | 0.00e+00 | 9.61e-05 |
| Am-243 | 1.34e-03 | 1.13e-03 | 9.83e-05 | 0.00e+00 | 6.06e-04 | 0.00e+00 | 8.95e-05 |
| Cm-242 | 8.78e-05 | 7.01e-05 | 5.84e-06 | 0.00e+00 | 1.87e-05 | 0.00e+00 | 8.16e-05 |
| Cm-243 | 1.28e-03 | 1.04e-03 | 8.24e-05 | 0.00e+00 | 3.08e-04 | 0.00e+00 | 8.03e-05 |
| Cm-244 | 1.08e-03 | 8.74e-04 | 6.93e-05 | 0.00e+00 | 2.54e-04 | 0.00e+00 | 7.77e-05 |
| Cm-245 | 1.67e-03 | 1.34e-03 | 1.05e-04 | 0.00e+00 | 4.11e-04 | 0.00e+00 | 7.24e-05 |
| Cm-246 | 1.65e-03 | 1.34e-03 | 1.05e-04 | 0.00e+00 | 4.10e-04 | 0.00e+00 | 7.11e-05 |
| Cm-247 | 1.61e-03 | 1.32e-03 | 1.03e-04 | 0.00e+00 | 4.04e-04 | 0.00e+00 | 9.35e-05 |
| Cm-248 | 1.34e-02 | 1.09e-02 | 8.52e-04 | 0.00e+00 | 3.33e-03 | 0.00e+00 | 1.51e-03 |
| Cf-252 | 1.05e-03 | 0.00e+00 | 2.54e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.96e-04 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| H-3 | 0.00e+00 | 1.76e-07 | 1.76e-07 | 1.76e-07 | 1.76e-07 | 1.76e-07 | 1.76e-07 |
| Be-10 | 1.71e-05 | 2.49e-06 | 5.16e-07 | 0.00e+00 | 1.64e-06 | 0.00e+00 | 2.78e-05 |
| C-14 | 2.37e-05 | 5.06e-06 | 5.06e-06 | 5.06e-06 | 5.06e-06 | 5.06e-06 | 5.06e-06 |
| N-13 | 5.85e-08 | 5.85e-08 | 5.85e-08 | 5.85e-08 | 5.85e-08 | 5.85e-08 | 5.85e-08 |
| F-18 | 5.19e-06 | 0.00e+00 | 4.43e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.22e-06 |
| Na-22 | 9.83e-05 | 9.83e-05 | 9.83e-05 | 9.83e-05 | 9.83e-05 | 9.83e-05 | 9.83e-05 |
| Na-24 | 1.01e-05 | 1.01e-05 | 1.01e-05 | 1.01e-05 | 1.01e-05 | 1.01e-05 | 1.01e-05 |
| P-32 | 1.70e-03 | 1.00e-04 | 6.59e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.30e-05 |
| Ca-41 | 3.74e-04 | 0.00e+00 | 4.08e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.91e-07 |
| Sc-46 | 3.75e-08 | 5.41e-08 | 1.69e-08 | 0.00e+00 | 3.56e-08 | 0.00e+00 | 3.53e-05 |
| Cr-51 | 0.00e+00 | 0.00e+00 | 1.41e-08 | 9.20e-09 | 2.01e-09 | 1.79e-08 | 4.11e-07 |
| Mn-54 | 0.00e+00 | 1.99e-05 | 4.51e-06 | 0.00e+00 | 4.41e-06 | 0.00e+00 | 7.31e-06 |
| Mn-56 | 0.00e+00 | 8.18e-07 | 1.41e-07 | 0.00e+00 | 7.03e-07 | 0.00e+00 | 7.43e-05 |
| Fe-55 | 1.39e-05 | 8.98e-06 | 2.40e-06 | 0.00e+00 | 0.00e+00 | 4.39e-06 | 1.14e-06 |
| Fe-59 | 3.08e-05 | 5.38e-05 | 2.12e-05 | 0.00e+00 | 0.00e+00 | 1.59e-05 | 2.57e-05 |
| Cc-57 | 0.00e+00 | 1.15e-06 | 1.87e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.92e-06 |
| Cc-58 | 0.00e+00 | 3.60e-06 | 8.98e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.97e-06 |
| Cc-60 | 0.00e+00 | 1.08e-05 | 2.55e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.57e-05 |
| Ni-59 | 4.73e-05 | 1.45e-05 | 8.17e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 7.16e-07 |
| Ni-63 | 6.34e-04 | 3.92e-05 | 2.20e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.95e-06 |
| Ni-65 | 4.70e-06 | 5.32e-07 | 2.42e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.05e-05 |
| Cu-64 | 0.00e+00 | 6.09e-07 | 2.82e-07 | 0.00e+00 | 1.03e-06 | 0.00e+00 | 1.25e-05 |
| Zr-65 | 1.84e-05 | 6.31e-05 | 2.91e-05 | 0.00e+00 | 3.06e-05 | 0.00e+00 | 5.33e-05 |
| Zr-69 | 9.33e-08 | 1.68e-07 | 1.25e-08 | 0.00e+00 | 6.98e-08 | 0.00e+00 | 1.37e-05 |
| Zr-69m | 1.50e-06 | 3.06e-06 | 2.79e-07 | 0.00e+00 | 1.24e-06 | 0.00e+00 | 4.24e-05 |
| Se-79 | 0.00e+00 | 2.10e-05 | 3.90e-06 | 0.00e+00 | 2.43e-05 | 0.00e+00 | 5.58e-07 |
| Br-82 | 0.00e+00 | 0.00e+00 | 1.27e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-83 | 0.00e+00 | 0.00e+00 | 3.63e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-84 | 0.00e+00 | 0.00e+00 | 3.82e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |
| Br-85 | 0.00e+00 | 0.00e+00 | 1.94e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 0.00e+00 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Rb-86 | 0.00e+00 | 1.70e-04 | 8.40e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.35e-06 |
| Rb-87 | 0.00e+00 | 8.88e-05 | 3.52e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.98e-07 |
| Rb-88 | 0.00e+00 | 4.98e-07 | 2.73e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 4.85e-07 |
| Rb-89 | 0.00e+00 | 2.86e-07 | 1.97e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.74e-08 |
| Sr-89 | 2.51e-03 | 0.00e+00 | 7.20e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.16e-05 |
| Sr-90 | 2.83e-02 | 0.00e+00 | 5.74e-04 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.31e-04 |
| Sr-91 | 5.00e-05 | 0.00e+00 | 1.81e-06 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 5.92e-05 |
| Sr-92 | 1.92e-05 | 0.00e+00 | 7.13e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.07e-04 |
| Y-90 | 8.69e-08 | 0.00e+00 | 2.33e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.20e-04 |
| Y-91 | 1.13e-06 | 0.00e+00 | 3.01e-08 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 8.10e-05 |
| Y-91m | 8.10e-10 | 0.00e+00 | 2.76e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.70e-06 |
| Y-92 | 7.65e-09 | 0.00e+00 | 2.15e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.46e-04 |
| Y-93 | 2.43e-08 | 0.00e+00 | 6.62e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.92e-04 |
| Zr-93 | 1.93e-07 | 9.19e-09 | 5.54e-09 | 0.00e+00 | 2.71e-08 | 0.00e+00 | 2.39e-06 |
| Zr-95 | 2.06e-07 | 5.02e-08 | 3.56e-08 | 0.00e+00 | 5.41e-08 | 0.00e+00 | 2.50e-05 |
| Zr-97 | 1.48e-08 | 2.54e-09 | 1.16e-09 | 0.00e+00 | 2.56e-09 | 0.00e+00 | 1.62e-04 |
| Nb-93m | 1.23e-07 | 3.33e-08 | 1.04e-08 | 0.00e+00 | 3.25e-08 | 0.00e+00 | 3.98e-06 |
| Nb-95 | 4.20e-08 | 1.73e-08 | 1.00e-08 | 0.00e+00 | 1.24e-08 | 0.00e+00 | 1.46e-05 |
| Nb-97 | 4.59e-10 | 9.79e-11 | 3.53e-11 | 0.00e+00 | 7.65e-11 | 0.00e+00 | 3.09e-05 |
| Mo-93 | 0.00e+00 | 5.65e-05 | 1.82e-06 | 0.00e+00 | 1.13e-05 | 0.00e+00 | 1.21e-06 |
| Mo-99 | 0.00e+00 | 3.40e-05 | 6.63e-06 | 0.00e+00 | 5.08e-05 | 0.00e+00 | 1.12e-05 |
| Tc-101 | 2.27e-09 | 2.86e-09 | 2.83e-08 | 0.00e+00 | 3.40e-08 | 1.56e-09 | 4.86e-07 |
| Tc-99 | 1.08e-06 | 1.46e-06 | 4.55e-07 | 0.00e+00 | 1.23e-05 | 1.42e-07 | 6.31e-06 |
| Tc-99m | 1.92e-09 | 3.96e-09 | 5.10e-08 | 0.00e+00 | 4.26e-08 | 2.07e-09 | 1.15e-06 |
| Ru-103 | 1.48e-06 | 0.00e+00 | 4.95e-07 | 0.00e+00 | 3.08e-06 | 0.00e+00 | 1.80e-05 |
| Ru-105 | 1.36e-07 | 0.00e+00 | 4.58e-08 | 0.00e+00 | 1.00e-06 | 0.00e+00 | 5.41e-05 |
| Ru-106 | 2.41e-05 | 0.00e+00 | 3.01e-06 | 0.00e+00 | 2.85e-05 | 0.00e+00 | 1.83e-04 |
| Rh-105 | 1.09e-06 | 7.13e-07 | 4.79e-07 | 0.00e+00 | 1.98e-06 | 0.00e+00 | 1.77e-05 |
| Pd-107 | 0.00e+00 | 1.19e-06 | 8.45e-08 | 0.00e+00 | 6.79e-06 | 0.00e+00 | 9.46e-07 |
| Pd-109 | 0.00e+00 | 1.50e-06 | 3.62e-07 | 0.00e+00 | 5.51e-06 | 0.00e+00 | 3.68e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Ag-110m | 9.96e-07 | 7.27e-07 | 4.81e-07 | 0.00e+00 | 1.04e-06 | 0.00e+00 | 3.77e-05 |
| Ag-111 | 5.20e-07 | 2.02e-07 | 1.07e-07 | 0.00e+00 | 4.22e-07 | 0.00e+00 | 4.82e-05 |
| Cd-113m | 0.00e+00 | 1.77e-05 | 6.52e-07 | 0.00e+00 | 1.34e-05 | 0.00e+00 | 2.66e-05 |
| Cd-115m | 0.00e+00 | 1.42e-05 | 4.93e-07 | 0.00e+00 | 7.41e-06 | 0.00e+00 | 8.09e-05 |
| Sn-123 | 2.49e-04 | 3.89e-06 | 6.50e-06 | 3.91e-06 | 0.00e+00 | 0.00e+00 | 6.58e-05 |
| Sn-125 | 7.41e-05 | 1.38e-06 | 3.29e-06 | 1.36e-06 | 0.00e+00 | 0.00e+00 | 1.11e-04 |
| Sn-126 | 5.53e-04 | 7.26e-06 | 1.80e-05 | 1.91e-06 | 0.00e+00 | 0.00e+00 | 2.52e-05 |
| Sb-124 | 2.14e-05 | 3.15e-07 | 6.63e-06 | 5.68e-08 | 0.00e+00 | 1.34e-05 | 6.60e-05 |
| Sb-125 | 1.23e-05 | 1.19e-07 | 2.53e-06 | 1.54e-08 | 0.00e+00 | 7.12e-06 | 1.64e-05 |
| Sb-126 | 8.06e-06 | 1.58e-07 | 2.91e-06 | 6.19e-08 | 0.00e+00 | 5.07e-06 | 8.35e-05 |
| Sb-127 | 2.23e-06 | 3.98e-08 | 6.90e-07 | 2.84e-08 | 0.00e+00 | 1.15e-06 | 5.91e-05 |
| Te-125m | 2.33e-05 | 7.79e-06 | 3.15e-06 | 7.84e-06 | 0.00e+00 | 0.00e+00 | 1.11e-05 |
| Te-127 | 1.00e-06 | 3.35e-07 | 2.15e-07 | 8.14e-07 | 2.44e-06 | 0.00e+00 | 2.10e-05 |
| Te-127m | 5.85e-05 | 1.94e-05 | 7.08e-06 | 1.69e-05 | 1.44e-04 | 0.00e+00 | 2.36e-05 |
| Te-129 | 2.84e-07 | 9.79e-08 | 6.63e-08 | 2.38e-07 | 7.07e-07 | 0.00e+00 | 2.27e-05 |
| Te-129m | 1.00e-04 | 3.43e-05 | 1.54e-05 | 3.84e-05 | 2.50e-04 | 0.00e+00 | 5.97e-05 |
| Te-131 | 1.76e-07 | 6.50e-08 | 4.94e-08 | 1.57e-07 | 4.50e-07 | 0.00e+00 | 7.11e-06 |
| Te-131m | 1.52e-05 | 6.12e-06 | 5.05e-06 | 1.24e-05 | 4.21e-05 | 0.00e+00 | 1.03e-04 |
| Te-132 | 2.08e-05 | 1.03e-05 | 9.61e-06 | 1.52e-05 | 6.44e-05 | 0.00e+00 | 3.81e-05 |
| Te-133m | 3.91e-07 | 1.79e-07 | 1.71e-07 | 3.45e-07 | 1.22e-06 | 0.00e+00 | 1.93e-05 |
| Te-134 | 2.67e-07 | 1.34e-07 | 1.38e-07 | 2.39e-07 | 9.03e-07 | 0.00e+00 | 3.06e-06 |
| I-129 | 2.86e-05 | 2.12e-05 | 1.55e-05 | 1.36e-02 | 2.51e-05 | 0.00e+00 | 4.24e-07 |
| I-130 | 6.00e-06 | 1.32e-05 | 5.30e-06 | 1.48e-03 | 1.45e-05 | 0.00e+00 | 2.83e-06 |
| I-131 | 3.59e-05 | 4.23e-05 | 1.86e-05 | 1.39e-02 | 4.94e-05 | 0.00e+00 | 1.51e-06 |
| I-132 | 1.66e-06 | 3.37e-06 | 1.20e-06 | 1.58e-04 | 3.76e-06 | 0.00e+00 | 2.73e-06 |
| I-133 | 1.25e-05 | 1.82e-05 | 5.33e-06 | 3.31e-03 | 2.14e-05 | 0.00e+00 | 3.08e-06 |
| I-134 | 8.69e-07 | 1.78e-06 | 6.33e-07 | 4.15e-05 | 1.99e-06 | 0.00e+00 | 1.84e-06 |
| I-135 | 3.64e-06 | 7.24e-06 | 2.64e-06 | 6.49e-04 | 8.07e-06 | 0.00e+00 | 2.62e-06 |
| Cs-134 | 3.77e-04 | 7.03e-04 | 7.10e-05 | 0.00e+00 | 1.81e-04 | 7.42e-05 | 1.91e-06 |
| Cs-134m | 1.76e-07 | 2.93e-07 | 1.48e-07 | 0.00e+00 | 1.13e-07 | 2.60e-08 | 2.32e-07 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Cs-135 | 1.33e-04 | 1.21e-04 | 6.30e-06 | 0.00e+00 | 3.44e-05 | 1.31e-05 | 4.37e-07 |
| Cs-136 | 4.59e-05 | 1.35e-04 | 5.04e-05 | 0.00e+00 | 5.38e-05 | 1.10e-05 | 2.05e-06 |
| Cs-137 | 5.22e-04 | 6.11e-04 | 4.33e-05 | 0.00e+00 | 1.64e-04 | 6.64e-05 | 1.91e-06 |
| Cs-138 | 4.81e-07 | 7.82e-07 | 3.79e-07 | 0.00e+00 | 3.90e-07 | 6.09e-08 | 1.25e-06 |
| Cs-139 | 3.10e-07 | 4.24e-07 | 1.62e-07 | 0.00e+00 | 2.19e-07 | 3.30e-08 | 2.66e-08 |
| Ba-139 | 8.81e-07 | 5.84e-10 | 2.55e-08 | 0.00e+00 | 3.51e-10 | 3.54e-10 | 5.58e-05 |
| Ba-140 | 1.71e-04 | 1.71e-07 | 8.81e-06 | 0.00e+00 | 4.06e-08 | 1.05e-07 | 4.20e-05 |
| Ba-141 | 4.25e-07 | 2.91e-10 | 1.34e-08 | 0.00e+00 | 1.75e-10 | 1.77e-10 | 5.19e-06 |
| Ba-142 | 1.84e-07 | 1.53e-10 | 9.06e-09 | 0.00e+00 | 8.81e-11 | 9.26e-11 | 7.59e-07 |
| La-140 | 2.11e-08 | 8.32e-09 | 2.14e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.77e-05 |
| La-141 | 2.89e-09 | 8.38e-10 | 1.46e-10 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 9.61e-05 |
| La-142 | 1.10e-09 | 4.04e-10 | 9.67e-11 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 6.86e-05 |
| Ce-141 | 7.87e-08 | 4.80e-08 | 5.65e-09 | 0.00e+00 | 1.48e-08 | 0.00e+00 | 2.48e-05 |
| Ce-143 | 1.48e-08 | 9.82e-06 | 1.12e-09 | 0.00e+00 | 2.86e-09 | 0.00e+00 | 5.73e-05 |
| Ce-144 | 2.98e-06 | 1.22e-06 | 1.67e-07 | 0.00e+00 | 4.93e-07 | 0.00e+00 | 1.71e-04 |
| Pr-143 | 8.13e-08 | 3.04e-08 | 4.03e-09 | 0.00e+00 | 1.13e-08 | 0.00e+00 | 4.29e-05 |
| Pr-144 | 2.74e-10 | 1.06e-10 | 1.38e-11 | 0.00e+00 | 3.84e-11 | 0.00e+00 | 4.93e-06 |
| Nd-147 | 5.53e-08 | 5.68e-08 | 3.48e-09 | 0.00e+00 | 2.19e-08 | 0.00e+00 | 3.60e-05 |
| Pm-147 | 3.88e-07 | 3.27e-08 | 1.59e-08 | 0.00e+00 | 4.88e-08 | 0.00e+00 | 9.27e-06 |
| Pm-148 | 6.32e-08 | 9.13e-09 | 4.60e-09 | 0.00e+00 | 1.09e-08 | 0.00e+00 | 9.74e-05 |
| Pm-148m | 1.65e-07 | 4.18e-08 | 3.28e-08 | 0.00e+00 | 4.80e-08 | 0.00e+00 | 5.44e-05 |
| Pm-149 | 1.38e-08 | 1.81e-09 | 7.90e-10 | 0.00e+00 | 2.20e-09 | 0.00e+00 | 4.86e-05 |
| Pm-151 | 6.18e-09 | 9.01e-10 | 4.56e-10 | 0.00e+00 | 1.07e-09 | 0.00e+00 | 4.17e-05 |
| Sm-151 | 2.90e-07 | 6.67e-08 | 1.44e-08 | 0.00e+00 | 4.53e-08 | 0.00e+00 | 5.58e-06 |
| Sm-153 | 7.72e-09 | 5.97e-09 | 4.58e-10 | 0.00e+00 | 1.25e-09 | 0.00e+00 | 3.12e-05 |
| Eu-152 | 6.74e-07 | 1.79e-07 | 1.51e-07 | 0.00e+00 | 5.02e-07 | 0.00e+00 | 1.59e-05 |
| Eu-154 | 2.64e-06 | 3.67e-07 | 2.20e-07 | 0.00e+00 | 9.95e-07 | 0.00e+00 | 4.58e-05 |
| Eu-155 | 5.42e-07 | 6.25e-08 | 3.23e-08 | 0.00e+00 | 1.40e-07 | 0.00e+00 | 8.37e-05 |
| Eu-156 | 1.14e-07 | 7.06e-08 | 1.12e-08 | 0.00e+00 | 3.26e-08 | 0.00e+00 | 6.67e-05 |
| Tb-160 | 2.59e-07 | 0.00e+00 | 3.24e-08 | 0.00e+00 | 7.37e-08 | 0.00e+00 | 3.45e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-ILI |
| Hc-166m | 1.25e-06 | 2.69e-07 | 2.13e-07 | 0.00e+00 | 3.57e-07 | 0.00e+00 | 2.66e-05 |
| W-181 | 8.85e-08 | 2.72e-08 | 3.04e-09 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.82e-07 |
| W-185 | 3.62e-06 | 1.13e-06 | 1.29e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 1.62e-05 |
| W-187 | 9.03e-07 | 6.28e-07 | 2.17e-07 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 3.69e-05 |
| Pb-210 | 5.28e-02 | 1.42e-02 | 2.38e-03 | 0.00e+00 | 4.33e-02 | 0.00e+00 | 2.32e-06 |
| Bi-210 | 4.16e-06 | 2.68e-05 | 2.39e-06 | 0.00e+00 | 2.08e-04 | 0.00e+00 | 5.27e-05 |
| Po-210 | 3.10e-03 | 5.93e-03 | 7.41e-04 | 0.00e+00 | 1.26e-02 | 0.00e+00 | 6.61e-05 |
| Ra-223 | 4.41e-02 | 6.42e-05 | 8.82e-03 | 0.00e+00 | 1.17e-03 | 0.00e+00 | 3.43e-04 |
| Ra-224 | 1.46e-02 | 3.29e-05 | 2.91e-03 | 0.00e+00 | 6.00e-04 | 0.00e+00 | 3.86e-04 |
| Ra-225 | 5.78e-02 | 6.52e-05 | 1.15e-02 | 0.00e+00 | 1.19e-03 | 0.00e+00 | 3.24e-04 |
| Ra-226 | 6.20e-01 | 4.76e-05 | 5.14e-01 | 0.00e+00 | 8.71e-04 | 0.00e+00 | 3.44e-04 |
| Ra-228 | 4.32e-01 | 2.58e-05 | 4.86e-01 | 0.00e+00 | 4.73e-04 | 0.00e+00 | 5.86e-05 |
| Ac-225 | 3.92e-05 | 5.03e-05 | 2.63e-06 | 0.00e+00 | 3.69e-06 | 0.00e+00 | 4.36e-04 |
| Ac-227 | 4.49e-03 | 7.67e-04 | 2.79e-04 | 0.00e+00 | 1.56e-04 | 0.00e+00 | 8.50e-05 |
| Th-227 | 1.20e-04 | 2.01e-06 | 3.45e-06 | 0.00e+00 | 7.41e-06 | 0.00e+00 | 5.70e-04 |
| Th-228 | 2.47e-03 | 3.38e-05 | 8.36e-05 | 0.00e+00 | 1.58e-04 | 0.00e+00 | 5.84e-04 |
| Th-229 | 2.52e-02 | 6.33e-04 | 4.20e-04 | 0.00e+00 | 3.03e-03 | 0.00e+00 | 8.10e-05 |
| Th-230 | 3.80e-03 | 1.90e-04 | 1.06e-04 | 0.00e+00 | 9.12e-04 | 0.00e+00 | 6.24e-05 |
| Th-232 | 4.24e-03 | 1.63e-04 | 1.65e-06 | 0.00e+00 | 7.79e-04 | 0.00e+00 | 5.31e-05 |
| Th-234 | 6.92e-07 | 3.77e-08 | 2.00e-08 | 0.00e+00 | 1.39e-07 | 0.00e+00 | 1.19e-04 |
| Pa-231 | 7.57e-03 | 2.50e-04 | 3.02e-04 | 0.00e+00 | 1.34e-03 | 0.00e+00 | 7.44e-05 |
| Pa-233 | 3.11e-08 | 6.09e-09 | 5.43e-09 | 0.00e+00 | 1.67e-08 | 0.00e+00 | 1.46e-05 |
| U-232 | 2.42e-02 | 0.00e+00 | 2.16e-03 | 0.00e+00 | 2.37e-03 | 0.00e+00 | 7.04e-05 |
| U-233 | 5.08e-03 | 0.00e+00 | 3.87e-04 | 0.00e+00 | 1.08e-03 | 0.00e+00 | 6.51e-05 |
| U-234 | 4.88e-03 | 0.00e+00 | 3.80e-04 | 0.00e+00 | 1.06e-03 | 0.00e+00 | 6.37e-05 |
| U-235 | 4.67e-03 | 0.00e+00 | 3.56e-04 | 0.00e+00 | 9.93e-04 | 0.00e+00 | 8.10e-05 |
| U-236 | 4.67e-03 | 0.00e+00 | 3.64e-04 | 0.00e+00 | 1.01e-03 | 0.00e+00 | 5.98e-05 |
| U-237 | 4.95e-07 | 0.00e+00 | 1.32e-07 | 0.00e+00 | 1.23e-06 | 0.00e+00 | 2.11e-05 |
| U-238 | 4.47e-03 | 0.00e+00 | 3.33e-04 | 0.00e+00 | 9.28e-04 | 0.00e+00 | 5.71e-05 |
| Np-237 | 2.40e-03 | 1.59e-04 | 1.05e-04 | 0.00e+00 | 6.34e-04 | 0.00e+00 | 8.23e-05 |

Conversion factors are in units of mrem per pCi ingested.

**DOSE CONVERSION FACTORS ALL AGE GROUPS
BY NUCLIDE (INHALATION AND INGESTION)**

Ingestion Dose Conversion factors for Infant age group by nuclide.
Waterford Steam Electric Station

| Nuclide | Organ Dose Conversion Factors | | | | | | |
|---------|-------------------------------|----------|----------|----------|----------|----------|----------|
| | Bone | Liver | T. Body | Thyroid | Kidney | Lung | GI-LLI |
| Np-238 | 1.24e-07 | 3.12e-09 | 1.92e-09 | 0.00e+00 | 6.81e-09 | 0.00e+00 | 4.17e-05 |
| Np-239 | 1.11e-08 | 9.93e-10 | 5.61e-10 | 0.00e+00 | 1.98e-09 | 0.00e+00 | 2.87e-05 |
| Pu-238 | 1.28e-03 | 1.50e-04 | 3.40e-05 | 0.00e+00 | 1.21e-04 | 0.00e+00 | 7.57e-05 |
| Pu-239 | 1.38e-03 | 1.55e-04 | 3.54e-05 | 0.00e+00 | 1.28e-04 | 0.00e+00 | 6.91e-05 |
| Pu-240 | 1.38e-03 | 1.55e-04 | 3.54e-05 | 0.00e+00 | 1.28e-04 | 0.00e+00 | 7.04e-05 |
| Pu-241 | 4.25e-05 | 1.76e-06 | 8.82e-07 | 0.00e+00 | 3.17e-06 | 0.00e+00 | 1.45e-06 |
| Pu-242 | 1.28e-03 | 1.49e-04 | 3.41e-05 | 0.00e+00 | 1.23e-04 | 0.00e+00 | 6.77e-05 |
| Pu-244 | 1.49e-03 | 1.71e-04 | 3.91e-05 | 0.00e+00 | 1.41e-04 | 0.00e+00 | 1.01e-04 |
| Am-241 | 1.46e-03 | 1.27e-03 | 1.09e-04 | 0.00e+00 | 6.55e-04 | 0.00e+00 | 7.70e-05 |
| Am-242m | 1.51e-03 | 1.22e-03 | 1.13e-04 | 0.00e+00 | 6.64e-04 | 0.00e+00 | 9.69e-05 |
| Am-243 | 1.44e-03 | 1.23e-03 | 1.06e-04 | 0.00e+00 | 6.36e-04 | 0.00e+00 | 9.03e-05 |
| Cm-242 | 1.37e-04 | 1.27e-04 | 9.10e-06 | 0.00e+00 | 2.62e-05 | 0.00e+00 | 8.23e-05 |
| Cm-243 | 1.40e-03 | 1.15e-03 | 8.98e-05 | 0.00e+00 | 3.27e-04 | 0.00e+00 | 8.10e-05 |
| Cm-244 | 1.18e-03 | 9.70e-04 | 7.59e-05 | 0.00e+00 | 2.71e-04 | 0.00e+00 | 7.84e-05 |
| Cm-245 | 1.79e-03 | 1.45e-03 | 1.13e-04 | 0.00e+00 | 4.32e-04 | 0.00e+00 | 7.30e-05 |
| Cm-246 | 1.77e-03 | 1.45e-03 | 1.13e-04 | 0.00e+00 | 4.31e-04 | 0.00e+00 | 7.17e-05 |
| Cm-247 | 1.73e-03 | 1.43e-03 | 1.11e-04 | 0.00e+00 | 4.24e-04 | 0.00e+00 | 9.43e-05 |
| Cm-248 | 1.43e-02 | 1.18e-02 | 9.16e-04 | 0.00e+00 | 3.50e-03 | 0.00e+00 | 1.52e-03 |
| Cf-252 | 1.22e-03 | 0.00e+00 | 2.95e-05 | 0.00e+00 | 0.00e+00 | 0.00e+00 | 2.99e-04 |

Conversion factors are in units of mrem per pCi ingested.

SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i VALUES FOR THE OFFSITE DOSE CALCULATION MANUAL

Values for A_i , P_i , and R_i were calculated as per NUREG-0133. Recommended values for various factors in the calculations were as specified in NUREG-0133. The location of most of the recommended factors are contained in USNRC Regulatory Guide 1.109, NUREG 0172, and NUREG/CR 1276. All factors used in Waterford-3 SES's calculations are for the maximum individual and are not site specific. The various factors are discussed below.

- Stable element transfer coefficients for vegetation, cow's milk, goat's milk and meat (Attachment 7.22, pages 10 - 12) were obtained from NUREG/CR 1276.
- Animal consumption rates (Attachment 7.22, page 2) were obtained from USNRC Regulatory Guide 1.109.
- Usage or consumption rates for adult, teen, child, and infant age groups (Attachment 7.22, page 3) were obtained from USNRC Regulatory Guide 1.109. These values are for the maximum exposed individual.
- External dose factors for standing on contaminated ground (Attachment 7.20) were obtained from NUREG/CR 1276.
- Bioaccumulation factors for freshwater and saltwater vertebrates and invertebrates (Attachment 7.22, page 13 - 15) were obtained from NUREG/CR 1276.
- Inhalation and ingestion dose factors for adult, teen, child, and infant age groups (Attachment 7.21) were obtained from NUREG/CR 1276.
- Radionuclide half-lives and decay constants are included Attachment 7.22, pages 4 - 9.
- Other factors (Attachment 7.22, page 16 - 18) used were obtained from USNRC Regulatory Guide 1.109 for various parameters,.

SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL

Animal Consumption rates.
Waterford Steam Electric Station

| | | |
|------------------------------|---|--------------|
| Milk cow's feed intake rate | : | 50.00 kg/day |
| Milk cow's water intake rate | : | 60.00 l/day |
| Beef cow's feed intake rate | : | 50.00 kg/day |
| Beef cow's water intake rate | : | 50.00 l/day |
| Goat's feed intake rate | : | 6.00 kg/day |
| Goat's water intake rate | : | 8.00 l/day |

**SPECIFIC FACTORS USED TO DETERMINE A_i, P_i, R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Consumption rates for MAXIMAL individuals.
Waterford Steam Electric Station

| | | | | |
|--------------|---------------------------|---|--------|-------|
| produce veg | usage rate for the Adult | : | 520.0 | kg/yr |
| produce veg | usage rate for the Teen | : | 630.0 | kg/yr |
| produce veg | usage rate for the Child | : | 520.0 | kg/yr |
| produce veg | usage rate for the Infant | : | 0.0 | kg/yr |
| ----- | | | | |
| leafy veg | usage rate for the Adult | : | 64.0 | kg/yr |
| leafy veg | usage rate for the Teen | : | 42.0 | kg/yr |
| leafy veg | usage rate for the Child | : | 26.0 | kg/yr |
| leafy veg | usage rate for the Infant | : | 0.0 | kg/yr |
| ----- | | | | |
| milk | usage rate for the Adult | : | 310.0 | l/yr |
| milk | usage rate for the Teen | : | 400.0 | l/yr |
| milk | usage rate for the Child | : | 330.0 | l/yr |
| milk | usage rate for the Infant | : | 330.0 | l/yr |
| ----- | | | | |
| meat/poultry | usage rate for the Adult | : | 110.0 | kg/yr |
| meat/poultry | usage rate for the Teen | : | 65.0 | kg/yr |
| meat/poultry | usage rate for the Child | : | 41.0 | kg/yr |
| meat/poultry | usage rate for the Infant | : | 0.0 | kg/yr |
| ----- | | | | |
| fish | usage rate for the Adult | : | 21.0 | kg/yr |
| fish | usage rate for the Teen | : | 16.0 | kg/yr |
| fish | usage rate for the Child | : | 6.9 | kg/yr |
| fish | usage rate for the Infant | : | 0.0 | kg/yr |
| ----- | | | | |
| seafood | usage rate for the Adult | : | 5.0 | kg/yr |
| seafood | usage rate for the Teen | : | 3.8 | kg/yr |
| seafood | usage rate for the Child | : | 1.7 | kg/yr |
| seafood | usage rate for the Infant | : | 0.0 | kg/yr |
| ----- | | | | |
| drink h2o | usage rate for the Adult | : | 730.0 | l/yr |
| drink h2o | usage rate for the Teen | : | 510.0 | l/yr |
| drink h2o | usage rate for the Child | : | 510.0 | l/yr |
| drink h2o | usage rate for the Infant | : | 330.0 | l/yr |
| ----- | | | | |
| shore rec | usage rate for the Adult | : | 12.0 | hr/yr |
| shore rec | usage rate for the Teen | : | 67.0 | hr/yr |
| shore rec | usage rate for the Child | : | 14.0 | hr/yr |
| shore rec | usage rate for the Infant | : | 0.0 | hr/yr |
| ----- | | | | |
| inhalation | usage rate for the Adult | : | 8000.0 | m3/yr |
| inhalation | usage rate for the Teen | : | 8000.0 | m3/yr |
| inhalation | usage rate for the Child | : | 3700.0 | m3/yr |
| inhalation | usage rate for the Infant | : | 1400.0 | m3/yr |

**SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Radionuclide Parameters used.
Waterford Steam Electric Station

| Nuclide | Parameters | |
|---------|--------------------|----------------------|
| | Half-life | Decay constant |
| H-3 | 1.2280e+01 years | 1.7899e-09 1/seconds |
| Be-10 | 1.6000e+06 years | 1.3737e-14 1/seconds |
| C-14 | 5.7300e+03 years | 3.8359e-12 1/seconds |
| N-13 | 9.9700e+00 minutes | 1.1587e-03 1/seconds |
| F-18 | 1.8300e+00 hours | 1.0521e-04 1/seconds |
| Na-22 | 2.6000e+00 years | 8.4537e-09 1/seconds |
| Na-24 | 1.5000e+01 hours | 1.2836e-05 1/seconds |
| P-32 | 1.4290e+01 days | 5.6141e-07 1/seconds |
| Ca-41 | 1.3000e+05 years | 1.6907e-13 1/seconds |
| Sc-46 | 8.3800e+01 days | 9.5734e-08 1/seconds |
| Cr-51 | 2.7704e+01 days | 2.8958e-07 1/seconds |
| Mn-54 | 3.1270e+02 days | 2.5656e-08 1/seconds |
| Mn-56 | 2.5758e+00 hours | 7.4750e-05 1/seconds |
| Fe-55 | 2.7000e+00 years | 8.1406e-09 1/seconds |
| Fe-59 | 4.4630e+01 days | 1.7976e-07 1/seconds |
| Co-57 | 2.7000e+02 days | 2.9713e-08 1/seconds |
| Co-58 | 7.0800e+01 days | 1.1331e-07 1/seconds |
| Co-60 | 5.2710e+00 years | 4.1699e-09 1/seconds |
| Ni-59 | 7.5000e+04 years | 2.9306e-13 1/seconds |
| Ni-63 | 1.0010e+02 years | 2.1958e-10 1/seconds |
| Ni-65 | 2.5200e+00 hours | 7.6405e-05 1/seconds |
| Cu-64 | 1.2701e+01 hours | 1.5160e-05 1/seconds |
| Zn-65 | 2.4440e+02 days | 3.2825e-08 1/seconds |
| Zn-69 | 5.5600e+01 minutes | 2.0778e-04 1/seconds |
| Zn-69m | 1.3800e+01 hours | 1.3952e-05 1/seconds |
| Se-79 | 6.5000e+04 years | 3.3815e-13 1/seconds |
| Br-82 | 1.4700e+00 days | 5.4575e-06 1/seconds |
| Br-83 | 2.3900e+00 hours | 8.0561e-05 1/seconds |
| Br-84 | 3.1800e+01 minutes | 3.6328e-04 1/seconds |
| Br-85 | 1.7200e+02 seconds | 4.0299e-03 1/seconds |

**SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i , VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Radionuclide Parameters used.
Waterford Steam Electric Station

| Nuclide | Parameters | |
|---------|--------------------|----------------------|
| | Half-life | Decay constant |
| Rb-86 | 1.8660e+01 days | 4.2993e-07 1/seconds |
| Rb-87 | 4.6000e+10 years | 4.7782e-19 1/seconds |
| Rb-88 | 1.7800e+01 minutes | 6.4901e-04 1/seconds |
| Rb-89 | 1.5440e+01 minutes | 7.4822e-04 1/seconds |
| Sr-89 | 5.0550e+01 days | 1.5870e-07 1/seconds |
| Sr-90 | 2.8600e+01 years | 7.6852e-10 1/seconds |
| Sr-91 | 9.5000e+00 hours | 2.0267e-05 1/seconds |
| Sr-92 | 2.7100e+00 hours | 7.1048e-05 1/seconds |
| Y-90 | 6.4100e+01 hours | 3.0038e-06 1/seconds |
| Y-91 | 5.8510e-01 days | 1.3711e-07 1/seconds |
| Y-91m | 4.9710e-01 minutes | 2.3240e-04 1/seconds |
| Y-92 | 3.5400e+00 hours | 5.4390e-05 1/seconds |
| Y-93 | 1.0100e+01 hours | 1.9063e-05 1/seconds |
| Zr-93 | 1.5000e+06 years | 1.4653e-14 1/seconds |
| Zr-95 | 6.4020e+01 days | 1.2531e-07 1/seconds |
| Zr-97 | 1.6900e+01 hours | 1.1393e-05 1/seconds |
| Nb-93m | 1.3600e+01 years | 1.6161e-09 1/seconds |
| Nb-95 | 3.5060e+01 days | 2.2882e-07 1/seconds |
| Nb-97 | 1.2300e+00 hours | 1.5654e-04 1/seconds |
| Mo-93 | 3.5000e+03 years | 6.2799e-12 1/seconds |
| Mo-99 | 6.6020e+01 hours | 2.9164e-06 1/seconds |
| Tc-101 | 1.4200e+01 minutes | 8.1355e-04 1/seconds |
| Tc-99 | 2.1400e+05 years | 1.0271e-13 1/seconds |
| Tc-99m | 6.0200e+00 hours | 3.1984e-05 1/seconds |
| Ru-103 | 3.9350e+01 days | 2.0388e-07 1/seconds |
| Ru-105 | 4.4400e+00 hours | 4.3365e-05 1/seconds |
| Ru-106 | 3.6820e+02 days | 2.1789e-08 1/seconds |
| Rh-105 | 1.4700e+00 days | 5.4575e-06 1/seconds |
| Pd-107 | 6.5000e+06 years | 3.3815e-15 1/seconds |
| Pd-109 | 1.3500e+01 hours | 1.4262e-05 1/seconds |

**SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Radionuclide Parameters used.
Waterford Steam Electric Station

| Nuclide | Parameters | |
|---------|--------------------|----------------------|
| | Half-life | Decay constant |
| Ag-110m | 2.4985e+02 days | 3.2109e-08 1/seconds |
| Ag-111 | 7.4500e+00 days | 1.0769e-06 1/seconds |
| Cd-113m | 1.4600e+01 years | 1.5054e-09 1/seconds |
| Cd-115m | 4.4600e+01 days | 1.7988e-07 1/seconds |
| Sn-123 | 1.2900e+02 days | 6.2190e-08 1/seconds |
| Sn-125 | 9.6200e+00 days | 8.3394e-07 1/seconds |
| Sn-126 | 1.0000e+05 years | 2.1980e-13 1/seconds |
| Sb-124 | 6.0200e+01 days | 1.3326e-07 1/seconds |
| Sb-125 | 2.7700e+00 years | 7.9349e-09 1/seconds |
| Sb-126 | 1.2500e+01 days | 6.4180e-07 1/seconds |
| Sb-127 | 9.3000e+01 hours | 2.0703e-06 1/seconds |
| Te-125m | 5.8000e+01 days | 1.3832e-07 1/seconds |
| Te-127 | 9.3500e+00 hours | 2.0593e-05 1/seconds |
| Te-127m | 1.0900e+02 days | 7.3601e-08 1/seconds |
| Te-129 | 6.9600e+01 minutes | 1.6598e-04 1/seconds |
| Te-129m | 3.3600e+01 days | 2.3877e-07 1/seconds |
| Te-131 | 2.5000e+01 minutes | 4.6210e-04 1/seconds |
| Te-131m | 3.0000e+01 hours | 6.4180e-06 1/seconds |
| Te-132 | 7.8200e+01 hours | 2.4622e-06 1/seconds |
| Te-133m | 5.5400e+01 minutes | 2.0853e-04 1/seconds |
| Te-134 | 4.1800e+01 minutes | 2.7637e-04 1/seconds |
| I-129 | 1.5700e+07 years | 1.4000e-15 1/seconds |
| I-130 | 1.2360e+01 hours | 1.5578e-05 1/seconds |
| I-131 | 8.0400e+00 days | 9.9783e-07 1/seconds |
| I-132 | 2.3000e+00 hours | 8.3713e-05 1/seconds |
| I-133 | 2.0800e+01 hours | 9.2568e-06 1/seconds |
| I-134 | 5.2600e+01 minutes | 2.1963e-04 1/seconds |
| I-135 | 6.6100e+00 hours | 2.9129e-05 1/seconds |
| Cs-134 | 2.0620e+00 years | 1.0659e-08 1/seconds |
| Cs-134m | 2.9000e+00 hours | 6.6393e-05 1/seconds |

**SPECIFIC FACTORS USED TO DETERMINE A_i, P_i, R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Radionuclide Parameters used.
Waterford Steam Electric Station

| Nuclide | Parameters | |
|---------|--------------------|----------------------|
| | Half-life | Decay constant |
| Cs-135 | 2.0000e+06 years | 1.0990e-14 1/seconds |
| Cs-136 | 1.3160e+01 days | 6.0962e-07 1/seconds |
| Cs-137 | 3.0170e+01 years | 7.2852e-10 1/seconds |
| Cs-138 | 3.2200e+01 minutes | 3.5877e-04 1/seconds |
| Cs-139 | 9.4000e+00 minutes | 1.2290e-03 1/seconds |
| Ba-139 | 8.3100e+01 minutes | 1.3902e-04 1/seconds |
| Ba-140 | 1.2789e+01 days | 6.2730e-07 1/seconds |
| Ba-141 | 1.8270e+01 minutes | 6.3232e-04 1/seconds |
| Ba-142 | 1.0700e+01 minutes | 1.0797e-03 1/seconds |
| La-140 | 4.0220e+01 hours | 4.7872e-06 1/seconds |
| La-141 | 3.9300e+00 hours | 4.8993e-05 1/seconds |
| La-142 | 9.5400e+01 minutes | 1.2109e-04 1/seconds |
| Ce-141 | 3.2500e+01 days | 2.4685e-07 1/seconds |
| Ce-143 | 3.3000e+01 hours | 5.8346e-06 1/seconds |
| Ce-144 | 2.8430e+02 days | 2.8219e-08 1/seconds |
| Pr-143 | 1.3560e+01 days | 5.9163e-07 1/seconds |
| Pr-144 | 1.7280e+01 minutes | 6.6854e-04 1/seconds |
| Nd-147 | 1.0980e+01 days | 7.3065e-07 1/seconds |
| Pm-147 | 2.6200e+00 years | 8.3891e-09 1/seconds |
| Pm-148 | 5.3700e+00 days | 1.4940e-06 1/seconds |
| Pm-148m | 4.1300e+01 days | 1.9425e-07 1/seconds |
| Pm-149 | 2.2100e+00 days | 3.6301e-06 1/seconds |
| Pm-151 | 1.1800e+00 days | 6.7988e-06 1/seconds |
| Sm-151 | 9.3000e-01 years | 2.3634e-10 1/seconds |
| Sm-153 | 1.9500e+00 days | 4.1141e-06 1/seconds |
| Eu-152 | 1.2700e+01 years | 1.7307e-09 1/seconds |
| Eu-154 | 1.6000e+02 years | 1.3737e-10 1/seconds |
| Eu-155 | 1.8000e+00 years | 1.2211e-08 1/seconds |
| Eu-156 | 1.5200e+01 days | 5.2780e-07 1/seconds |
| Th-160 | 7.2100e+01 days | 1.1127e-07 1/seconds |

**SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Radionuclide Parameters used.
Waterford Steam Electric Station

| Nuclide | Parameters | |
|---------|------------------|----------------------|
| | Half-life | Decay constant |
| Ho-166m | 1.2000e+C3 years | 1.8316e-11 1/seconds |
| W-181 | 1.2100e+C2 days | 6.6302e-08 1/seconds |
| W-185 | 7.5100e+C1 days | 1.0682e-07 1/seconds |
| W-187 | 2.3830e+01 hours | 8.0798e-06 1/seconds |
| Pb-210 | 2.0400e+C1 years | 1.0774e-09 1/seconds |
| Bi-210 | 5.0100e+C0 days | 1.6013e-06 1/seconds |
| Po-210 | 1.3800e+C2 days | 5.8134e-08 1/seconds |
| Ra-223 | 1.1400e+C1 days | 7.0373e-07 1/seconds |
| Ra-224 | 3.6600e+00 days | 2.1919e-06 1/seconds |
| Ra-225 | 1.4800e+01 days | 5.4206e-07 1/seconds |
| Ra-226 | 1.6000e+C3 years | 1.3737e-11 1/seconds |
| Ra-228 | 5.7500e+00 years | 3.8225e-09 1/seconds |
| Ac-225 | 1.0000e+01 days | 8.0225e-07 1/seconds |
| Ac-227 | 2.1800e+01 years | 1.0082e-09 1/seconds |
| Th-227 | 1.8500e+01 days | 4.3365e-07 1/seconds |
| Th-228 | 1.9100e+00 years | 1.1508e-08 1/seconds |
| Th-229 | 7.3400e+03 years | 2.9945e-12 1/seconds |
| Th-230 | 7.7000e+04 years | 2.8545e-13 1/seconds |
| Th-232 | 1.4100e+10 years | 1.5588e-18 1/seconds |
| Th-234 | 2.4100e+01 days | 3.3289e-07 1/seconds |
| Pa-231 | 3.2800e+04 years | 6.7011e-13 1/seconds |
| Pa-233 | 2.7400e+01 days | 2.9279e-07 1/seconds |
| U-232 | 7.2000e+01 years | 3.0527e-10 1/seconds |
| U-233 | 1.5800e+05 years | 1.3911e-13 1/seconds |
| U-234 | 2.4800e+05 years | 8.8627e-14 1/seconds |
| U-235 | 7.0400e+08 years | 3.1221e-17 1/seconds |
| U-236 | 3.3400e+07 years | 6.5807e-16 1/seconds |
| U-237 | 6.7500e+00 days | 1.1885e-06 1/seconds |
| U-238 | 4.7000e+09 years | 4.6765e-18 1/seconds |
| Np-237 | 2.1400e+06 years | 1.0271e-14 1/seconds |

**SPECIFIC FACTORS USED TO DETERMINE A_i, P_i, R_i, VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Radionuclide Parameters used.
Waterford Steam Electric Station

| Nuclide | Parameters | |
|---------|------------------|----------------------|
| | Half-life | Decay constant |
| Np-238 | 2.1200e+00 days | 3.7842e-06 1/seconds |
| Np-239 | 2.3550e+00 days | 3.4066e-06 1/seconds |
| Pu-238 | 8.7800e+01 years | 2.5034e-10 1/seconds |
| Pu-239 | 2.4100e+04 years | 9.1201e-13 1/seconds |
| Pu-240 | 6.5400e+03 years | 3.3608e-12 1/seconds |
| Pu-241 | 1.5200e+01 years | 1.4460e-09 1/seconds |
| Pu-242 | 3.8700e+05 years | 5.6795e-14 1/seconds |
| Pu-244 | 8.2600e+07 years | 2.6610e-16 1/seconds |
| Am-241 | 4.3300e+00 years | 5.0761e-09 1/seconds |
| Am-242m | 1.5200e+02 years | 1.4460e-10 1/seconds |
| Am-243 | 7.3800e+03 years | 2.9783e-12 1/seconds |
| Cm-242 | 1.6300e+02 days | 4.9218e-08 1/seconds |
| Cm-243 | 2.8500e+01 years | 7.7121e-10 1/seconds |
| Cm-244 | 1.8100e+01 years | 1.2143e-09 1/seconds |
| Cm-245 | 8.5000e+03 years | 2.5858e-12 1/seconds |
| Cm-246 | 4.8200e+03 years | 4.5601e-12 1/seconds |
| Cm-247 | 1.5600e+07 years | 1.4089e-15 1/seconds |
| Cm-248 | 3.6100e+05 years | 6.0885e-14 1/seconds |
| Cf-252 | 2.4600e+00 years | 8.9348e-09 1/seconds |

**SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Stable Element Transfer Coefficients by nuclide.
Waterford Steam Electric Station

| Element | Stable Element Transfer Data | | | |
|---------|------------------------------|----------------|------------|-----------------|
| | Biv Veg/Soil | Fm Cow Milk | Ff Meat | Fm Goat Milk |
| H | 4.80e+00 | 1.00e-02 | 1.20e-02 | 1.70e-01 |
| He | 5.00e-02 | 2.00e-02 | 2.00e-02 | 2.00e-02 |
| Li | 8.30e-04 | 5.00e-02 | 1.00e-02 | 5.00e-02 |
| Be | 4.20e-04 | 1.00e-04 | 1.00e-03 | 1.00e-04 |
| B | 1.20e-01 | 2.70e-03 | 8.00e-04 | 2.70e-03 |
| C | 5.50e+00 | 1.20e-02 | 3.10e-02 | 1.00e-01 |
| N | 7.50e+00 | 2.20e-02 | 7.70e-02 | 2.20e-02 |
| O | 1.60e+00 | 2.00e-02 | 1.60e-02 | 2.00e-02 |
| F | 6.50e-04 | 1.40e-02 | 1.50e-01 | 1.40e-02 |
| Ne | 1.40e-01 | 2.00e-02 | 2.00e-02 | 2.00e-02 |
| Na | 5.20e-02 | 4.00e-02 | 3.00e-02 | 4.00e-02 |
| Mg | 1.30e-01 | 1.00e-02 | 5.00e-03 | 1.00e-02 |
| Al | 1.80e-04 | 5.00e-04 | 1.50e-03 | 5.00e-04 |
| Si | 1.50e-04 | 1.00e-04 | 4.00e-05 | 1.00e-04 |
| P | 1.10e+00 | 2.50e-02 | 4.60e-02 | 2.50e-01 |
| S | 5.90e-01 | 1.80e-02 | 1.00e-01 | 1.80e-02 |
| Cl | 5.00e+00 | 5.00e-02 | 8.00e-02 | 5.00e-02 |
| Ar | 6.00e-01 | 2.00e-02 | 2.00e-02 | 2.00e-02 |
| K | 3.70e-01 | 1.00e-02 | 1.20e-02 | 1.00e-02 |
| Ca | 3.60e-02 | 8.00e-03 | 4.00e-03 | 8.00e-03 |
| Sc | 1.10e-03 | 5.00e-06 | 1.60e-02 | 5.00e-06 |
| Ti | 5.40e-05 | 5.00e-06 | 3.10e-02 | 5.00e-06 |
| V | 1.30e-03 | 1.00e-03 | 2.30e-03 | 1.00e-03 |
| Cr | 2.50e-04 | 2.20e-03 | 2.40e-03 | 2.20e-03 |
| Mn | 2.90e-02 | 2.50e-04 | 8.00e-04 | 2.50e-04 |
| Fe | 6.60e-04 | 1.20e-03 | 4.00e-02 | 1.30e-04 |
| Co | 9.40e-03 | 1.00e-03 | 1.30e-02 | 1.00e-03 |
| Ni | 1.90e-02 | 6.70e-03 | 5.30e-03 | 6.70e-03 |
| Cu | 1.20e-01 | 1.40e-02 | 8.00e-03 | 1.30e-02 |
| Zn | 4.00e-01 | 3.90e-02 | 3.00e-02 | 3.90e-02 |
| Ga | 2.50e-04 | 5.00e-05 | 1.30e+00 | 5.00e-05 |
| Ge | 1.00e-01 | 5.00e-04 | 2.00e+01 | 5.00e-04 |
| As | 1.00e-02 | 6.00e-03 | 2.00e-03 | 6.00e-03 |
| Se | 1.30e+00 | 4.50e-02 | 1.50e-02 | 4.50e-02 |
| Br | 7.60e-01 | 5.00e-02 | 2.60e-02 | 5.00e-02 |

Units for transfer data are derived as follows:

Biv -> pCi/kg in vegetation per pCi/kg in soil (no units),

Fm -> pCi/liter in milk per pCi/day ingested by animal (days/liter),

Ff -> pCi/kg in meat per pCi/day ingested by animal (days/kg).

**SPECIFIC FACTORS USED TO DETERMINE A_i, P_i, R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Stable Element Transfer Coefficients by nuclide.
Waterford Steam Electric Station

| Element | Stable Element Transfer Data | | | |
|---------|------------------------------|----------------|------------|-----------------|
| | Biv Veg/Soil | Fm Cow Milk | Ff Meat | Fm Goat Milk |
| Kr | 3.00e+00 | 2.00e-02 | 2.00e-02 | 2.00e-02 |
| Rb | 1.30e-01 | 3.00e-02 | 3.10e-02 | 3.00e-02 |
| Sr | 1.70e-02 | 8.00e-04 | 6.00e-04 | 1.40e-02 |
| Y | 2.60e-03 | 1.00e-05 | 4.60e-03 | 1.00e-05 |
| Zr | 1.70e-04 | 5.00e-06 | 3.40e-02 | 5.00e-06 |
| Nb | 9.40e-03 | 2.50e-03 | 2.80e-01 | 2.50e-03 |
| Mo | 1.20e-01 | 7.50e-03 | 8.00e-03 | 7.50e-03 |
| Tc | 2.50e-01 | 2.50e-02 | 4.00e-01 | 2.50e-02 |
| Ru | 5.00e-02 | 1.00e-06 | 4.00e-01 | 1.00e-06 |
| Rh | 1.30e+01 | 1.00e-02 | 1.50e-03 | 1.00e-02 |
| Pd | 5.00e+00 | 1.00e-02 | 4.00e-03 | 1.00e-02 |
| Ag | 1.50e-01 | 5.00e-02 | 1.70e-02 | 5.00e-02 |
| Cd | 3.00e-01 | 1.20e-04 | 5.30e-04 | 1.20e-04 |
| Ir | 2.50e-01 | 1.00e-04 | 8.00e-03 | 1.00e-04 |
| Sr | 2.50e-03 | 2.50e-03 | 8.00e-02 | 2.50e-03 |
| Sb | 1.10e-02 | 1.50e-03 | 4.00e-03 | 1.50e-03 |
| Te | 1.30e+00 | 1.00e-03 | 7.70e-02 | 1.00e-03 |
| I | 2.00e-02 | 6.00e-03 | 2.90e-03 | 6.00e-03 |
| Xe | 1.00e+01 | 2.00e-02 | 2.00e-02 | 2.00e-02 |
| Cs | 1.00e-02 | 1.20e-02 | 4.00e-03 | 3.00e-01 |
| Ba | 5.00e-03 | 4.00e-04 | 3.20e-03 | 4.00e-04 |
| La | 2.50e-03 | 5.00e-06 | 2.00e-04 | 5.00e-06 |
| Ce | 2.50e-03 | 1.00e-04 | 1.20e-03 | 1.00e-04 |
| Pr | 2.50e-03 | 5.00e-06 | 4.70e-03 | 5.00e-06 |
| Nd | 2.40e-03 | 5.00e-06 | 3.30e-03 | 5.00e-06 |
| Pm | 2.50e-03 | 5.00e-06 | 4.80e-03 | 5.00e-06 |
| Sm | 2.50e-03 | 5.00e-06 | 5.00e-03 | 5.00e-06 |
| Eu | 2.50e-03 | 5.00e-06 | 4.80e-03 | 5.00e-06 |
| Gd | 2.60e-03 | 5.00e-06 | 3.60e-03 | 5.00e-06 |
| Tb | 2.60e-03 | 5.00e-06 | 4.40e-03 | 5.00e-06 |
| Dy | 2.50e-03 | 5.00e-06 | 5.30e-03 | 5.00e-06 |
| Ho | 2.60e-03 | 5.00e-06 | 4.40e-03 | 5.00e-06 |
| Er | 2.50e-03 | 5.00e-06 | 4.00e-03 | 5.00e-06 |
| Tm | 2.60e-03 | 5.00e-06 | 4.40e-03 | 5.00e-06 |
| Yb | 2.50e-03 | 5.00e-06 | 4.00e-03 | 5.00e-06 |

Units for transfer data are derived as follows:
 Biv -> pCi/kg in vegetation per pCi/kg in soil (no units),
 Fm -> pCi/liter in milk per pCi/day ingested by animal (days/liter),
 Ff -> pCi/kg in meat per pCi/day ingested by animal (days/kg).

**SPECIFIC FACTORS USED TO DETERMINE A_i, P_i, R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Stable Element Transfer Coefficients by nuclide.
Waterford Steam Electric Station

| Element | Stable Element Transfer Data | | | |
|---------|------------------------------|----------------|------------|-----------------|
| | Biv Veg/Soil | Fm Cow Milk | Ff Meat | Fm Goat Milk |
| Lu | 2.60e-03 | 5.00e-06 | 4.40e-03 | 5.00e-06 |
| Hf | 1.70e-04 | 5.00e-06 | 4.00e-01 | 5.00e-06 |
| Ta | 6.30e-03 | 2.50e-02 | 1.60e+00 | 2.50e-02 |
| W | 1.80e-02 | 5.00e-04 | 1.39e-03 | 5.00e-04 |
| Re | 2.50e-01 | 2.50e-02 | 8.00e-03 | 2.50e-02 |
| Os | 5.00e-02 | 5.00e-03 | 4.00e-01 | 5.00e-03 |
| Ir | 1.30e+01 | 5.00e-03 | 1.50e-03 | 5.00e-03 |
| Pt | 5.00e-01 | 5.00e-03 | 4.00e-03 | 5.00e-03 |
| Au | 2.50e-03 | 5.00e-03 | 8.00e-03 | 5.00e-03 |
| Hg | 3.80e-01 | 3.80e-02 | 2.60e-01 | 3.80e-02 |
| Tl | 2.50e-01 | 2.20e-02 | 4.00e-02 | 2.20e-02 |
| Pb | 6.80e-02 | 6.20e-04 | 2.90e-04 | 6.20e-04 |
| Bi | 1.50e-01 | 5.00e-04 | 1.30e-02 | 5.00e-04 |
| Po | 1.50e-01 | 3.00e-04 | 1.20e-02 | 3.00e-04 |
| At | 2.50e-01 | 5.00e-02 | 8.00e+00 | 5.00e-02 |
| Rn | 3.50e+00 | 2.00e-02 | 2.00e-02 | 2.00e-02 |
| Fr | 1.00e-02 | 5.00e-02 | 2.00e-02 | 5.00e-02 |
| Ra | 3.10e-04 | 8.00e-03 | 3.40e-02 | 8.00e-03 |
| Ac | 2.50e-03 | 5.00e-06 | 6.00e-02 | 5.00e-06 |
| Th | 4.20e-03 | 5.00e-06 | 2.00e-04 | 5.00e-06 |
| Pa | 2.50e-03 | 5.00e-06 | 8.00e+02 | 5.00e-06 |
| U | 2.50e-03 | 5.00e-04 | 3.40e-04 | 5.00e-04 |
| Np | 2.50e-03 | 5.00e-06 | 2.00e-04 | 5.00e-06 |
| Pu | 2.50e-04 | 2.00e-06 | 1.40e-05 | 2.00e-06 |
| Am | 2.50e-04 | 5.00e-06 | 2.00e-04 | 5.00e-06 |
| Cm | 2.50e-03 | 5.00e-06 | 2.00e-04 | 5.00e-06 |
| Bk | 2.50e-03 | 5.00e-06 | 2.00e-04 | 5.00e-06 |
| Cf | 2.50e-03 | 5.00e-06 | 2.00e-04 | 5.00e-06 |
| Es | 2.50e-03 | 5.00e-06 | 2.00e-04 | 5.00e-06 |
| Fm | 2.50e-03 | 5.00e-06 | 2.00e-04 | 5.00e-06 |

Units for transfer data are derived as follows:
 Biv -> pCi/kg in vegetation per pCi/kg in soil (no units),
 Fm -> pCi/liter in milk per pCi/day ingested by animal (days/liter),
 Ff -> pCi/kg in meat per pCi/day ingested by animal (days/kg).

**SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Bioaccumulation Factors for Aquatic Organisms by element.
Waterford Steam Electric Station

| Element | Bioaccumulation Factors | | | |
|---------|-------------------------|---------------------------|-----------------------|--------------------------|
| | Fresh Water Fish | Fresh Water Invert. | Salt Water Fish | Salt Water Invert. |
| H | 9.00e-01 | 9.00e-01 | 9.00e-01 | 9.30e-01 |
| He | 1.00e+00 | 1.00e+00 | 1.00e+00 | 1.00e+00 |
| Li | 5.00e-01 | 4.00e+01 | 5.00e-01 | 5.00e-01 |
| Be | 2.00e+00 | 1.00e+01 | 2.00e+02 | 2.00e+02 |
| B | 2.20e-01 | 5.00e+01 | 2.20e-01 | 4.40e-01 |
| C | 4.60e+03 | 9.10e+03 | 1.80e+03 | 1.40e+03 |
| N | 1.50e+05 | 1.50e+05 | 6.00e+04 | 1.70e+04 |
| O | 9.20e-01 | 9.20e-01 | 9.60e-01 | 9.60e-01 |
| F | 1.00e+01 | 1.00e+02 | 3.60e+00 | 3.60e+00 |
| Ne | 1.00e+00 | 1.00e+00 | 1.00e+00 | 1.00e+00 |
| Na | 1.00e+02 | 2.00e+02 | 6.70e-02 | 1.90e-01 |
| Mg | 5.00e+01 | 1.00e+02 | 7.70e-01 | 7.70e-01 |
| Al | 1.00e+01 | 6.30e+01 | 1.00e+01 | 6.00e+01 |
| Si | 2.50e+00 | 2.50e+01 | 1.00e+01 | 3.30e+01 |
| P | 1.00e+05 | 2.00e+04 | 2.90e+04 | 3.00e+04 |
| S | 7.50e+02 | 1.00e+02 | 1.70e+00 | 4.40e-01 |
| Cl | 5.00e+01 | 1.00e+02 | 1.30e-02 | 1.90e-02 |
| Ar | 1.00e+00 | 1.00e+00 | 1.00e+00 | 1.00e+00 |
| K | 1.00e+03 | 8.30e+02 | 1.10e+01 | 6.60e+00 |
| Ca | 4.00e+01 | 3.30e+02 | 5.00e-01 | 1.30e+01 |
| Sc | 2.00e+00 | 1.00e+03 | 2.00e+00 | 1.00e+04 |
| Ti | 1.00e+03 | 3.00e+03 | 1.00e+03 | 1.00e+03 |
| V | 1.00e+01 | 3.00e+03 | 1.00e+01 | 5.00e+01 |
| Cr | 2.00e+02 | 2.00e+03 | 4.00e+02 | 2.00e+03 |
| Mn | 4.00e+02 | 9.00e+04 | 5.50e+02 | 4.00e+02 |
| Fe | 1.00e+02 | 3.20e+03 | 3.00e+03 | 2.00e+04 |
| Co | 5.00e+01 | 2.00e+02 | 1.00e+02 | 1.00e+03 |
| Ni | 1.00e+02 | 1.00e+02 | 1.00e+02 | 2.50e+02 |
| Cu | 5.00e+01 | 4.00e+02 | 6.70e+02 | 1.70e+03 |
| Zn | 2.00e+03 | 1.00e+04 | 2.00e+03 | 5.00e+04 |
| Ga | 3.30e+02 | 6.70e+02 | 3.30e+02 | 6.70e+02 |
| Ge | 3.30e+03 | 3.30e+01 | 3.30e+03 | 1.70e+04 |
| As | 1.00e+02 | 4.00e+01 | 3.30e+02 | 3.30e+02 |
| Se | 1.70e+02 | 1.70e+02 | 4.00e+03 | 1.00e+03 |
| Br | 4.20e+02 | 3.30e+02 | 1.50e-02 | 3.10e+00 |
| Kr | 1.00e+00 | 1.00e+00 | 1.00e+00 | 1.00e+00 |
| Rb | 2.00e+03 | 1.00e+03 | 8.30e+00 | 1.70e+01 |

Bioaccumulation factors in units of pCi/kg per pCi/liter.

**SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Bioaccumulation Factors for Aquatic Organisms by element.
Waterford Steam Electric Station

| Element | Bioaccumulation Factors | | | |
|---------|-------------------------|---------------------------|-----------------------|--------------------------|
| | Fresh Water Fish | Fresh Water Invert. | Salt Water Fish | Salt Water Invert. |
| Sr | 3.00e+01 | 1.00e+02 | 2.00e+00 | 2.00e+01 |
| Y | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Zr | 3.30e+00 | 6.70e+00 | 2.00e+02 | 8.00e+01 |
| Nb | 3.00e+02 | 1.00e+02 | 3.00e+04 | 1.00e+02 |
| Mo | 1.00e+01 | 1.00e+01 | 1.00e+01 | 1.00e+01 |
| Tc | 1.50e+01 | 5.00e+00 | 1.00e+01 | 5.00e+01 |
| Ru | 1.00e+01 | 3.00e+02 | 3.00e+00 | 1.00e+03 |
| Rh | 1.00e+01 | 3.00e+02 | 1.00e+01 | 2.00e+03 |
| Pd | 1.00e+01 | 3.00e+02 | 1.00e+01 | 2.00e+03 |
| Ag | 2.30e+00 | 7.70e+02 | 3.30e+03 | 3.30e+03 |
| Cd | 2.00e+02 | 2.00e+03 | 3.00e+03 | 2.50e+05 |
| In | 1.00e+05 | 1.00e+05 | 1.00e+05 | 1.00e+05 |
| Sn | 3.00e+03 | 1.00e+03 | 3.00e+03 | 1.00e+03 |
| Sb | 1.00e+00 | 1.00e+01 | 4.00e+01 | 5.00e+00 |
| Te | 4.00e+02 | 6.10e+03 | 1.00e+01 | 1.00e+02 |
| I | 1.50e+01 | 5.00e+00 | 1.00e+01 | 5.00e+01 |
| Xe | 1.00e+00 | 1.00e+00 | 1.00e+00 | 1.00e+00 |
| Cs | 2.00e+03 | 1.00e+03 | 4.00e+01 | 2.50e+01 |
| Ba | 4.00e+00 | 2.00e+02 | 1.00e+01 | 1.00e+02 |
| La | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Ce | 1.00e+00 | 1.00e+03 | 1.00e+01 | 6.00e+02 |
| Pr | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Nd | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Pm | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Sm | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Eu | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Gd | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Tb | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Dy | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Ho | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Er | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Tm | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Yb | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Lu | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Hf | 3.30e+00 | 6.70e+00 | 2.00e+02 | 2.00e+01 |
| Ta | 3.00e+04 | 6.70e+02 | 3.00e+04 | 1.70e+04 |
| W | 1.20e+03 | 1.00e+01 | 3.00e+01 | 3.00e+01 |

Bioaccumulation factors in units of pCi/kg per pCi/liter.

**SPECIFIC FACTORS USED TO DETERMINE A_i, P_i, R_i VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Bioaccumulation Factors for Aquatic Organisms by element.
Waterford Steam Electric Station

| Element | Bioaccumulation Factors | | | |
|---------|-------------------------|---------------------------|-----------------------|--------------------------|
| | Fresh Water Fish | Fresh Water Invert. | Salt Water Fish | Salt Water Invert. |
| Re | 1.20e+02 | 6.00e+01 | 4.80e+00 | 6.00e+01 |
| Os | 1.00e+01 | 3.00e+02 | 1.00e+01 | 2.00e+03 |
| Ir | 1.00e+01 | 3.00e+02 | 1.00e+01 | 2.00e+03 |
| Pt | 1.00e+02 | 3.00e+02 | 1.00e+02 | 2.00e+03 |
| Au | 3.30e+01 | 5.00e+01 | 3.30e+01 | 3.30e+01 |
| Hg | 1.00e+03 | 1.00e+05 | 1.70e+03 | 3.30e+04 |
| Tl | 1.00e+04 | 1.50e+04 | 1.00e+04 | 1.50e+04 |
| Pb | 1.00e+02 | 1.00e+02 | 3.00e+02 | 1.00e+03 |
| Bi | 1.50e+01 | 2.40e+01 | 1.50e+01 | 2.40e+01 |
| Pc | 5.00e+02 | 2.00e+04 | 3.00e+02 | 5.00e+03 |
| At | 1.50e+01 | 5.00e+00 | 1.00e+01 | 5.00e+01 |
| Rn | 1.00e+00 | 1.00e+00 | 1.00e+00 | 1.00e+00 |
| Fr | 4.00e+02 | 1.00e+02 | 3.00e+01 | 2.00e+01 |
| Ra | 5.00e+01 | 2.50e+02 | 5.00e+01 | 1.00e+02 |
| Ac | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Th | 3.00e+02 | 5.00e+02 | 1.00e+04 | 2.00e+03 |
| Pa | 1.10e+02 | 1.10e+02 | 1.00e+01 | 1.00e+01 |
| U | 2.00e+00 | 6.00e+01 | 1.00e+01 | 1.00e+01 |
| Np | 1.00e+01 | 4.00e+02 | 1.00e+01 | 1.00e+01 |
| Pu | 3.50e+00 | 1.00e+02 | 3.00e+00 | 2.00e+02 |
| Am | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Cm | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Bk | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Cf | 2.50e+01 | 1.00e+03 | 2.50e+01 | 1.00e+03 |
| Es | 1.00e+01 | 1.00e+02 | 1.00e+01 | 1.00e+01 |
| Fm | 1.00e+01 | 1.00e+02 | 1.00e+01 | 1.00e+01 |

Bioaccumulation factors in units of pCi/kg per pCi/liter.

**SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i , VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Site Specific Parameters used.

Parameter No. : 1
Description : fraction of ingested produce grown in region
Formula Symbol : fg
Value : 0.760
Units : none

Parameter No. : 2
Description : fraction of leafy vegetables grown in region
Formula Symbol : fL
Value : 1.000
Units : none

Parameter No. : 4
Description : fraction of activity retained on crops for airborne
 particulates
Formula Symbol : r
Value : 0.200
Units : none

Parameter No. : 5
Description : fraction of activity retained on crops for airborne
 radiiodines
Formula Symbol : r
Value : 1.000
Units : none

Parameter No. : 6
Description : building shielding factor for maximum individuals
Formula Symbol : SF
Value : 0.700
Units : none

Parameter No. : 11
Description : period of long term buildup of activity in soil or sediment
Formula Symbol : t
Value : 131400.000
Units : hr

Parameter No. : 12
Description : transport time from animal feed-milk-man max individuals
Formula Symbol : tf
Value : 2.000
Units : days

Parameter No. : 15
Description : time delay for harvest of veg/crops and ingestion by
 animals - stored feed
Formula Symbol : th
Value : 2160.000
Units : hr

**SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i , VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL**

Paramater No. : 16
 Description : time delay for harvest of veg/crops and ingestion by
 man - leafy veg max indivd
 Formula Symbol : tL
 Value : 24.000
 Units : hr

Paramater No. : 17
 Description : time delay for harvest of veg/crops and ingestion by
 man - produce veg max ind
 Formula Symbol : th
 Value : 1440.000
 Units : hr

Paramater No. : 37
 Description : agricultural productivity by unit area stored feed
 feed-animal-man
 Formula Symbol : Ys
 Value : 2.000
 Units : kg/m2

Paramater No. : 38
 Description : agricultural productivity by unit area pasture grass
 feed-animal-man
 Formula Symbol : Yp
 Value : 0.700
 Units : kg/m2

Paramater No. : 41
 Description : time from slaughter of meat animal to consumption
 Formula Symbol : tf
 Value : 20.000
 Units : days

Paramater No. : 43
 Description : agricultural productivity by unit area crops/veg-man
 Formula Symbol : Yv
 Value : 2.000
 Units : kg/m2

Paramater No. : 44
 Description : rate constant for removal of activity on plants by weathering
 Formula Symbol : lambda-w
 Value : 2.062938e-3
 Units : hr-1

Paramater No. : 69
 Description : fraction of year that milk cows are on pasture
 Formula Symbol : fp
 Value : 1.000
 Units : none

SPECIFIC FACTORS USED TO DETERMINE A_i , P_i , R_i , VALUES FOR THE
OFFSITE DOSE CALCULATION MANUAL

Parameter No. : 70
Description : fraction of year that milk goats are on pasture
Formula Symbol : fp
Value : 1.000
Units : none

Parameter No. : 71
Description : fraction of year that beef cows are on pasture
Formula Symbol : fp
Value : 1.000
Units : none

Parameter No. : 73
Description : fraction of milk cow's intake from pasture
Formula Symbol : fs
Value : 1.000
Units : none

Parameter No. : 74
Description : fraction of milk goat's intake from pasture
Formula Symbol : fs
Value : 1.000
Units : none

Parameter No. : 75
Description : fraction of beef cow's intake from pasture
Formula Symbol : fs
Value : 1.000
Units : none

Parameter No. : 88
Description : absolute relative humidity in the atmosphere
Formula Symbol : H
Value : 8.000
Units : g/m³

**ODCM SPECIFICATIONS CONTAINED IN THE
WATERFORD III TECHNICAL REQUIREMENTS MANUAL**

| TRM SPECIFICATION | TRM TABLE OR SECTION | DESCRIPTION |
|--------------------------|-----------------------------|---|
| 3.11.1.1 | Section 3/4.11.1 | Liquid Effluents - Concentration |
| 4.11.1.1.1 | Table 4.11-1 | Radioactive Liquid Waste Sampling and Analysis Program |
| 3.11.1.2 | Section 3/4.11.1 | Liquid Effluents - Dose |
| 3.11.1.3 | Section 3/4.11.1 | Liquid Radwaste Treatment System |
| 3.11.2.1 | Section 3/4.11.2 | Gaseous Effluents - Dose Rate |
| 4.11.2.1.2 | Table 4.11-2 | Radioactive Gaseous Waste Sampling and Analysis Program |
| 3.11.2.2 | Section 3/4.11.2 | Gaseous Effluents - Dose Rate (Noble Gases) |
| 3.11.2.3 | Section 3/4.11.2 | Gaseous Effluents - Dose Rate (I-131, I-133, Tritium and Particulates) |
| 3.11.2.4 | Section 3/4.11.2 | Gaseous Radwaste Treatment |
| 3.11.4 | Section 3/4.11.4 | Total Dose |
| 3.3.3.10 | Section 3/4.3.3 | Radioactive Liquid Effluent Monitoring Instrumentation |
| 4.3.3.10 | Table 3.3-12 | Radioactive Liquid Effluent Monitoring Instrumentation |
| 3.3.3.11 | Section 3/4.3.3 | Radioactive Gaseous Effluent Monitoring Instrumentation |
| 4.3.3.11 | Table 3.3-12 | Radioactive Gaseous Effluent Monitoring Instrumentation |
| 3.12.1 | Section 3/4.12.1 | Radiological Environmental Monitoring Program |
| 3.12.1 | Table 3.12-1 | Radiological Environmental Monitoring Program |
| 3.12.2 | Table 3.12-2 | Reporting Levels For Radioactivity Concentrations in Environmental Samples |
| 3.12.2 | Table 4.12-1 | Detection Capabilities For Environmental Sample Analysis Lower Limits of Detection |
| 3.12.2 | Section 3/4.12.2 | Land Use Census |
| 3.12.3 | Section 3/4.12.3 | Interlaboratory Comparison Program |
| 3/4.3.3.10 | Section 3/4.3 | Radioactive Liquid Effluent Monitoring Instrumentation Basis |
| 3/4.3.3.11 | Section 3/4.3 | Radioactive Gaseous Effluent Monitoring Instrumentation Basis |
| 3/4.11.1.1 | Section 3/4.11 | Liquid Effluents Concentration Basis |
| 3/4.11.1.2 | Section 3/4.11 | Liquid Effluents Dose Basis |
| 3/4.11.1.3 | Section 3/4.11 | Liquid Radwaste Treatment System Basis |
| 3/4.11.2.1 | Section 3/4.11 | Gaseous Effluents Dose Rate Basis |
| 3/4.11.2.2 | Section 3/4.11 | Gaseous Effluents Dose - Noble Gases Basis |
| 3/4.11.2.3 | Section 3/4.11 | Gaseous Effluents Dose - I-131, I-133, Tritium and Particulates Basis |
| 3/4.11.2.4 | Section 3/4.11 | Gaseous Radwaste Treatment System Basis |
| 3/4.11.4 | Section 3/4.11 | Total Dose Basis |
| 3/4.12.1 | Section 3/4.12 | Radiological Environmental Monitoring Program Basis |
| 3/4.12.2 | Section 3/4.12 | Land Use Census Basis |
| 3/4.12.3 | Section 3/4.12 | Interlaboratory Comparison Program Basis |