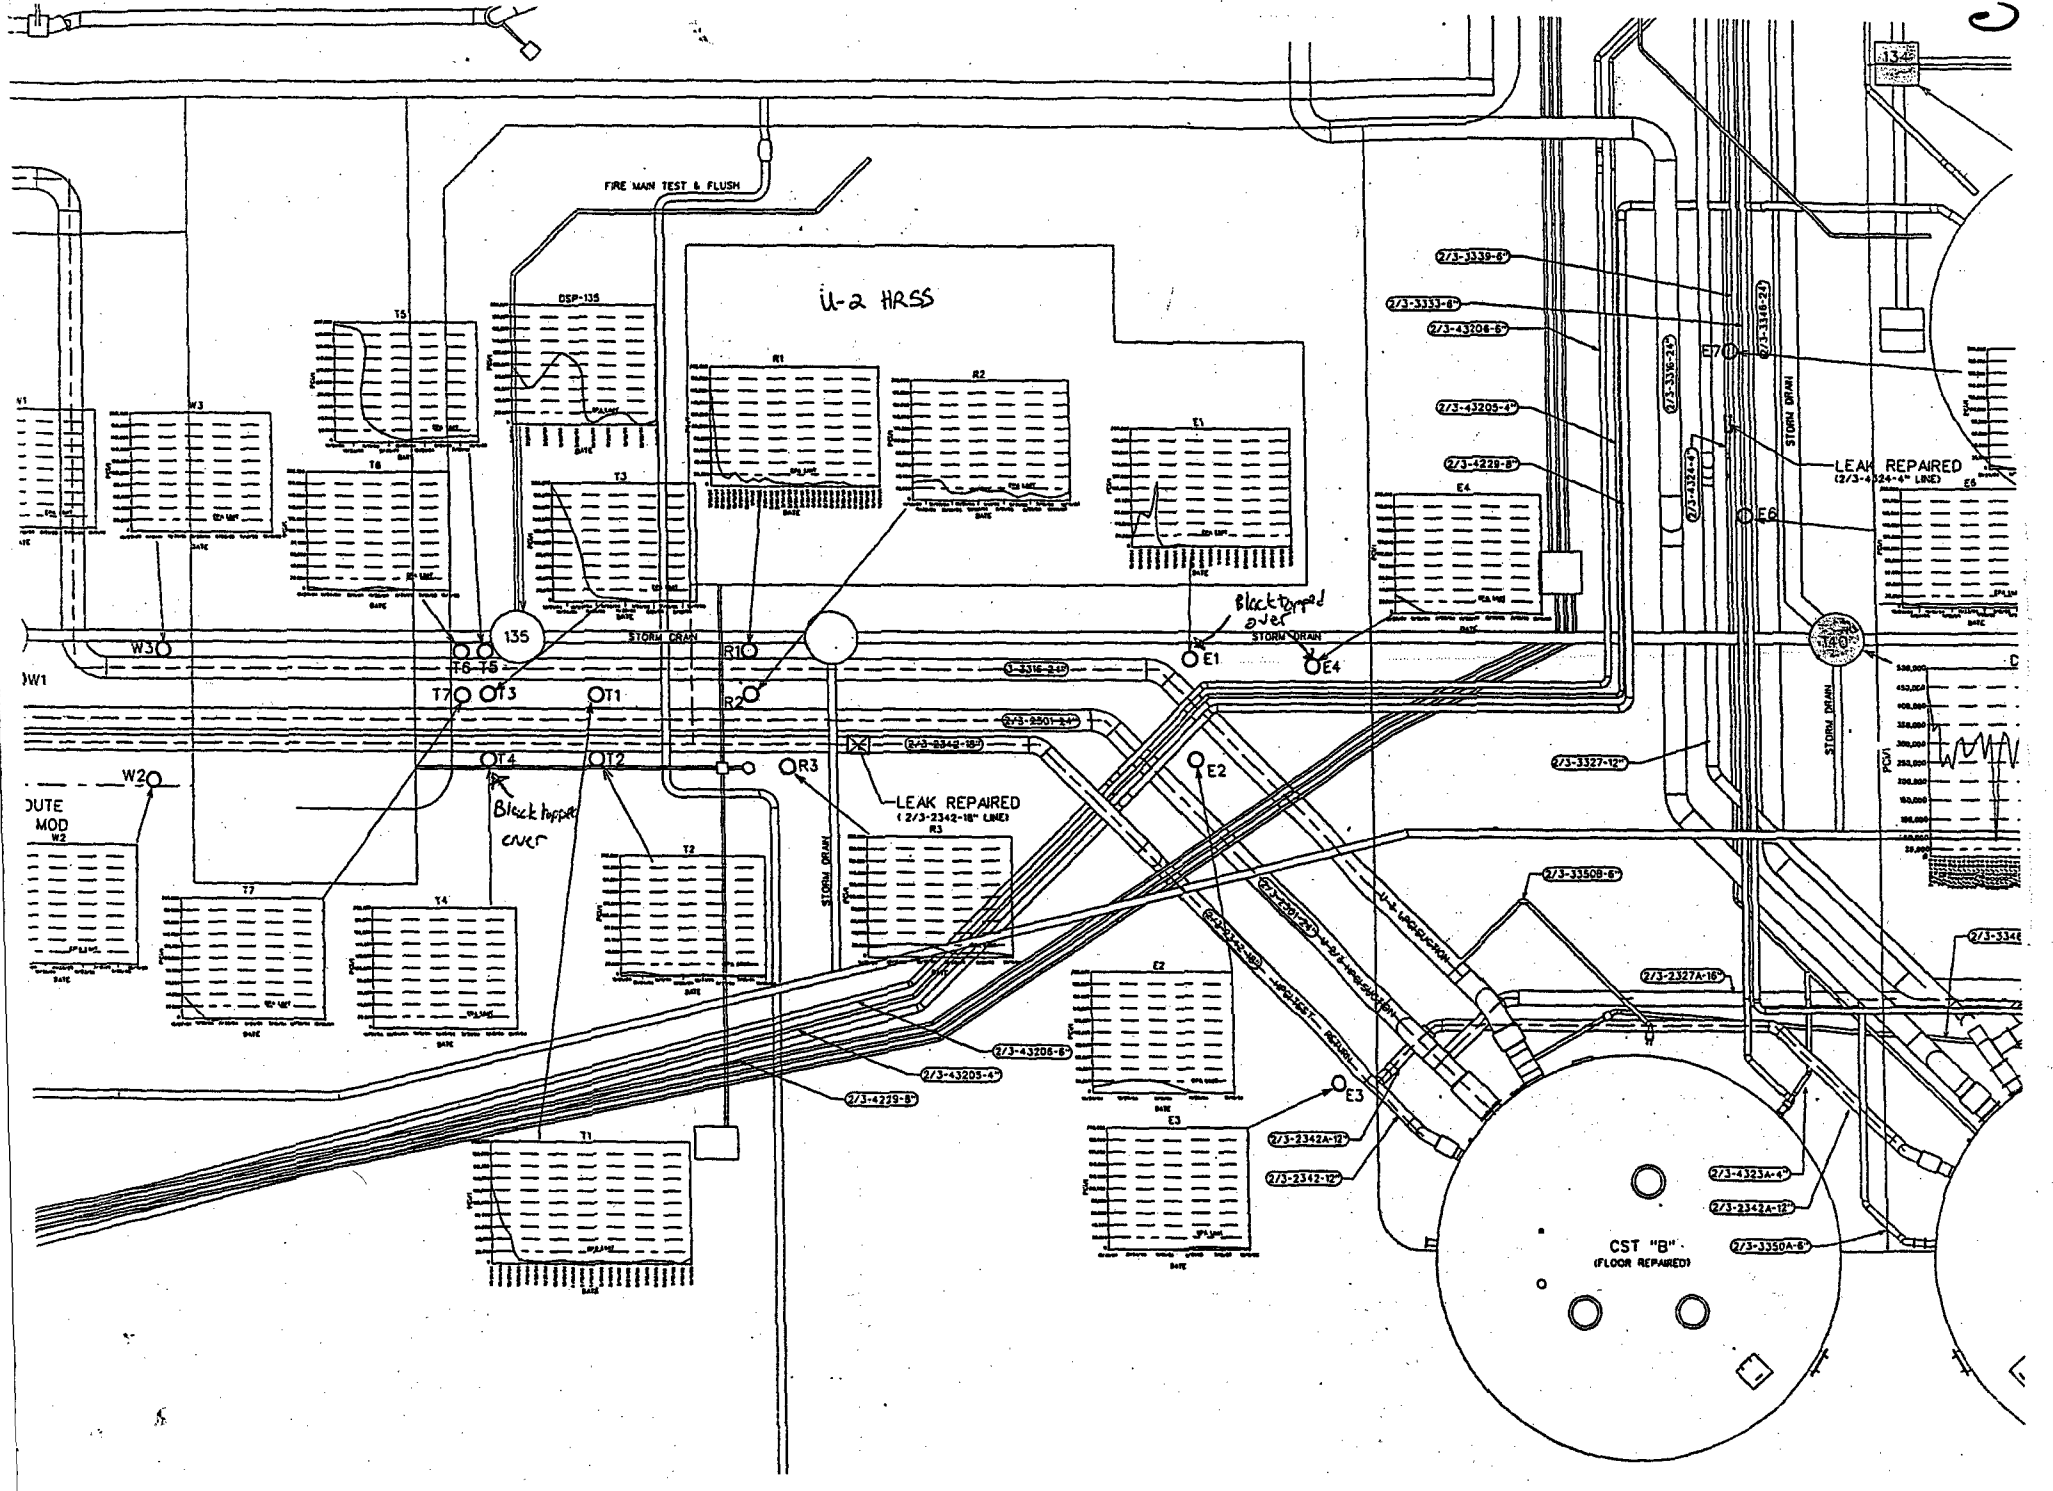

FIRE MAIN TEST & FLUSH
U-2 HRSS
DSP-135
T5
T6
T3
T7
T4
T2
T1
W1
W2
W3
R1
R2
R3
E1
E2
E3
E4
E6
E7
135
140
134
STORM DRAIN
Black topped over
Black topped over
LEAK REPAIRED
(2/3-2342-18" LINE)
LEAK REPAIRED
(2/3-4324-4" LINE)
2/3-3339-6"
2/3-3333-6"
2/3-43206-6"
2/3-43205-4"
2/3-4229-8"
2/3-3316-24"
2/3-3346-24"
2/3-4324-4"
2/3-3327-12"
2/3-3350B-6"
2/3-2327A-16"
2/3-2342A-12"
2/3-2342-12"
2/3-4323A-4"
2/3-3350A-6"
CST "B"
(FLOOR REPAIRED)

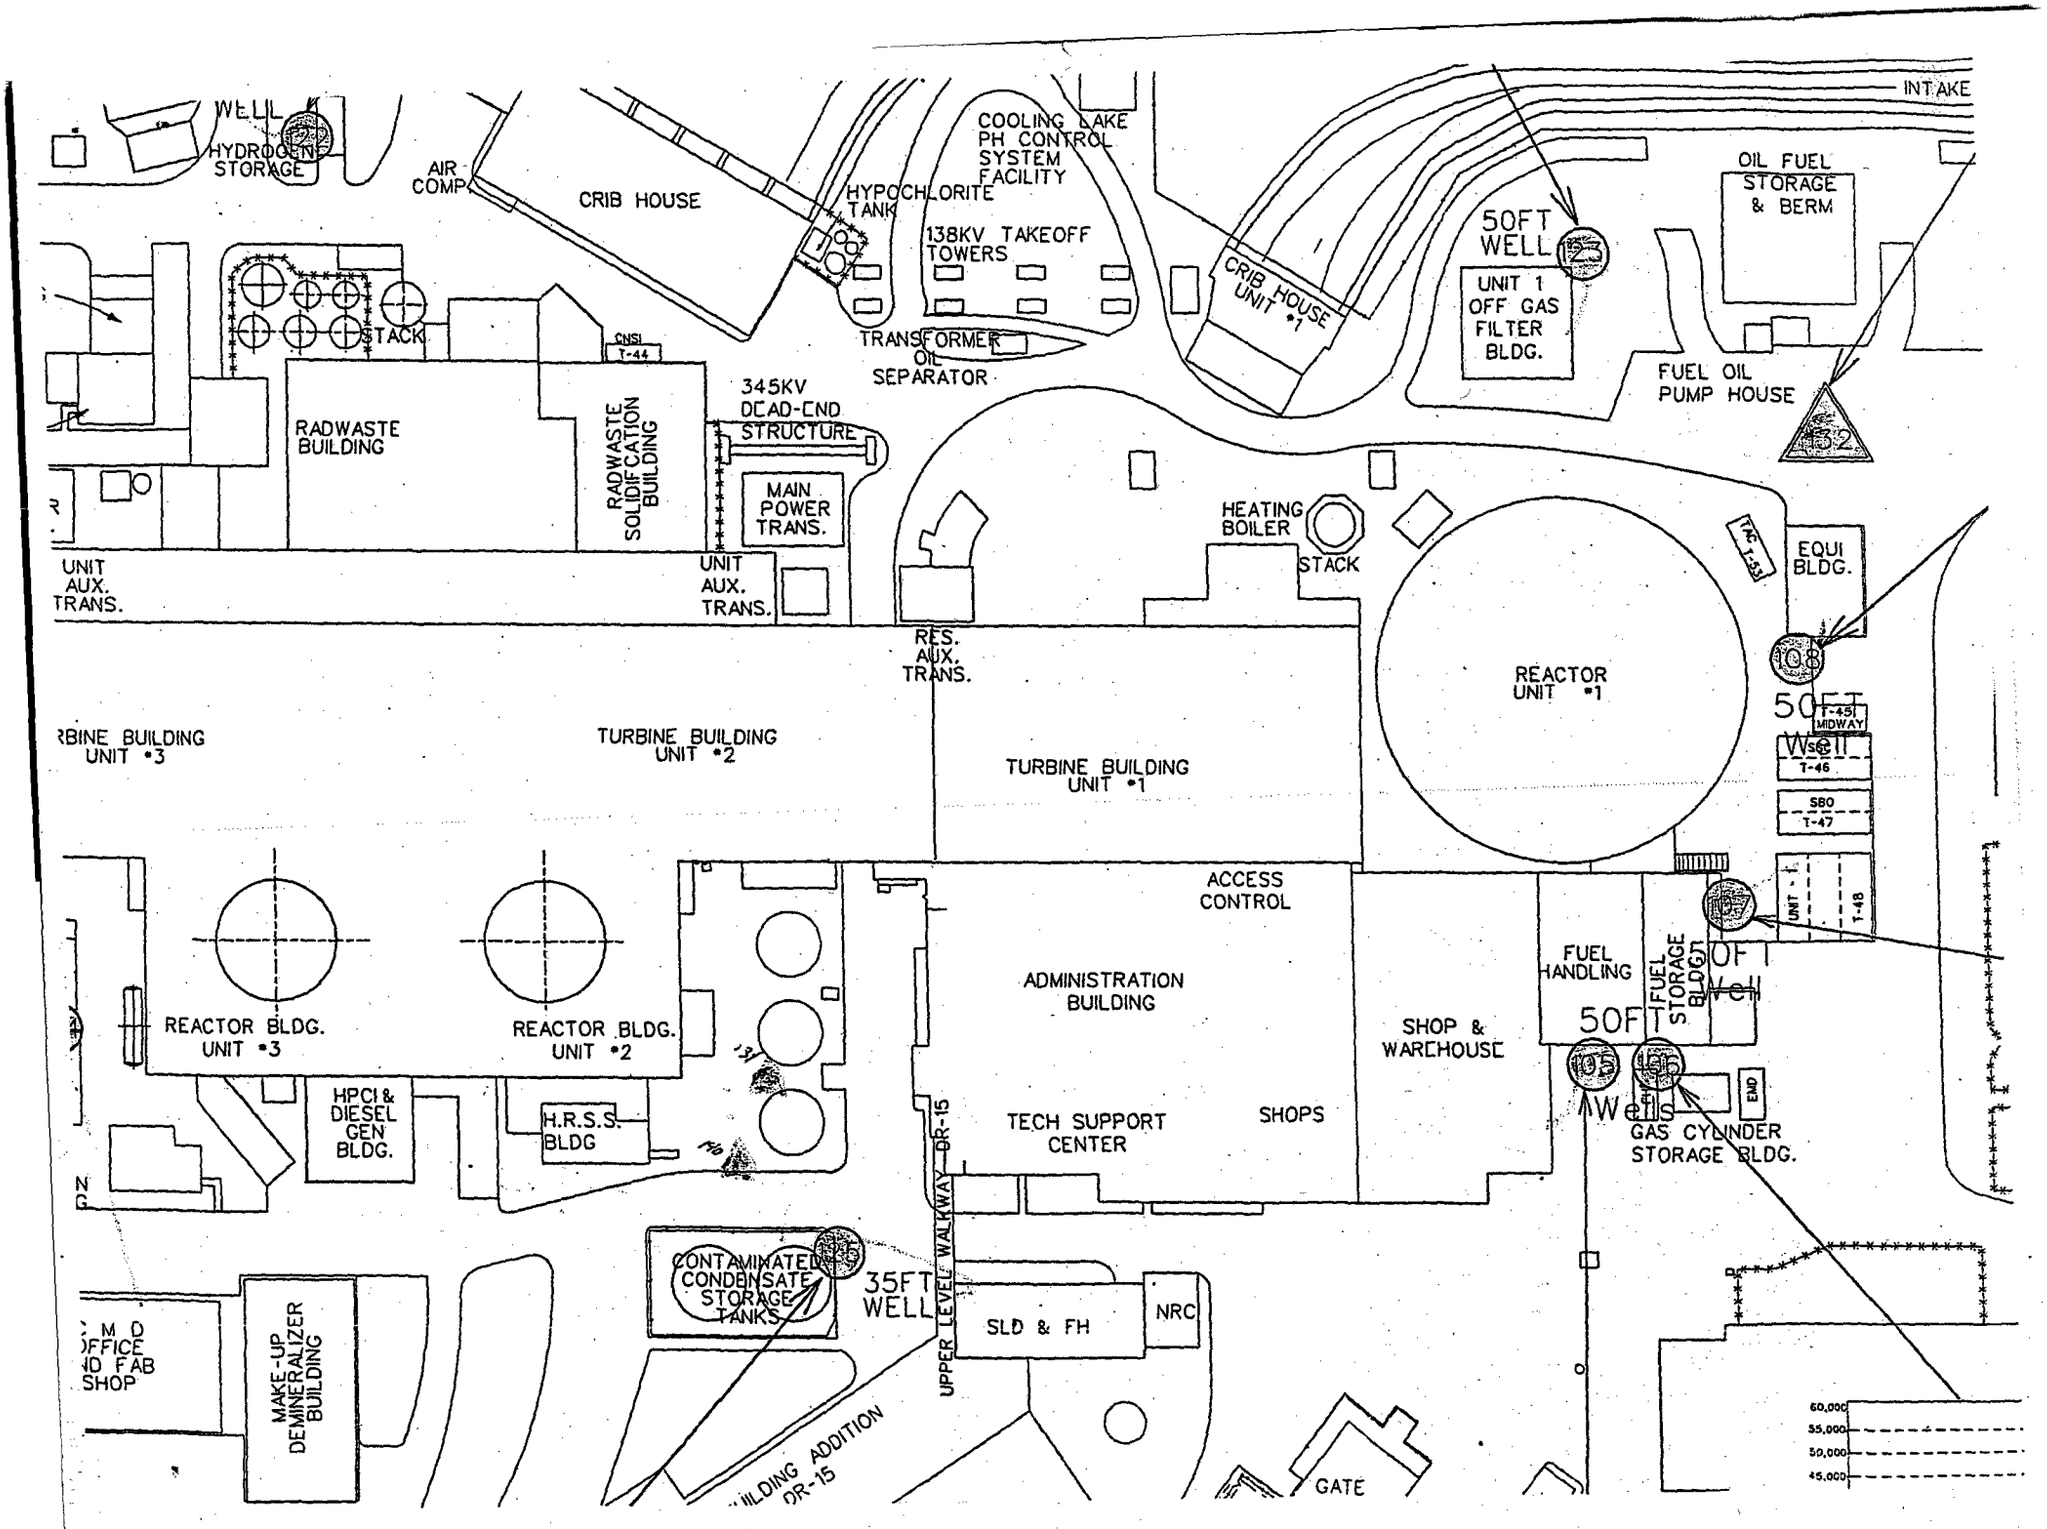
WELL
HYDROGEN STORAGE
AIR COMP.
CRIB HOUSE
HYPOCHLORITE TANK
COOLING LAKE PH CONTROL SYSTEM FACILITY
138KV TAKEOFF TOWERS
INTAKE
CRIB HOUSE UNIT #1
50FT WELL
UNIT 1 OFF GAS FILTER BLDG.
OIL FUEL STORAGE & BERM
FUEL OIL PUMP HOUSE
STACK
CNSL T-44
TRANSFORMER OIL SEPARATOR
RADWASTE BUILDING
RADWASTE SOLIDIFICATION BUILDING
345KV DEAD-END STRUCTURE
MAIN POWER TRANS.
UNIT AUX. TRANS.
UNIT AUX. TRANS.
HEATING BOILER
STACK
EQUI BLDG.
RES. AUX. TRANS.
REACTOR UNIT #1
TURBINE BUILDING UNIT #3
TURBINE BUILDING UNIT #2
TURBINE BUILDING UNIT #1
50FT Well
T-45 MIDWAY
T-46
SBO T-47
UNIT 1 T-48
ACCESS CONTROL
ADMINISTRATION BUILDING
SHOP & WAREHOUSE
FUEL HANDLING
FUEL STORAGE BLDG.
50FT Well
REACTOR BLDG. UNIT #3
REACTOR BLDG. UNIT #2
HPCI & DIESEL GEN BLDG.
H.R.S.S. BLDG
TECH SUPPORT CENTER
SHOPS
UPPER LEVEL WALKWAY
DR-15
GAS CYLINDER STORAGE BLDG.
CONTAMINATED CONDENSATE STORAGE TANKS
35FT WELL
SLD & FH
NRC
MAKE-UP DEMINERALIZER BUILDING
BUILDING ADDITION DR-15
GATE
60,000
55,000
50,000
45,000