

X1884  
MO

DIRS  
7017

(NER)


**From:** Staci Sakai  
**To:** Brian Sheron; Bruce Boger; Gary Holahan; Jim Dyer; Michael Weber; Richard Borchardt  
**Date:** 3/8/06 1:32PM  
**Subject:** Daily Status of Ground-Water Contamination

attached.

**CC:** Belkys Sosa; Catherine Haney; Cornelius Holden; Darrell Roberts; Edwin Hackett; Jean-Claude Dehmel; Jennifer Dixon-Herrity; John Boska; John White; Mahesh Chawla; Michael Case; Mike Shannon; Mindy Landau; Peter Habighorst; Robert Haag; Ronald Schmitt; Stephen Klementowicz; Steven Orth; Stuart Richards; Timothy Frye; Undine Shoop

Information in this record was deleted  
in accordance with the Freedom of Information  
Act, exemptions outside scope  
FOIA 2006-130

F-7

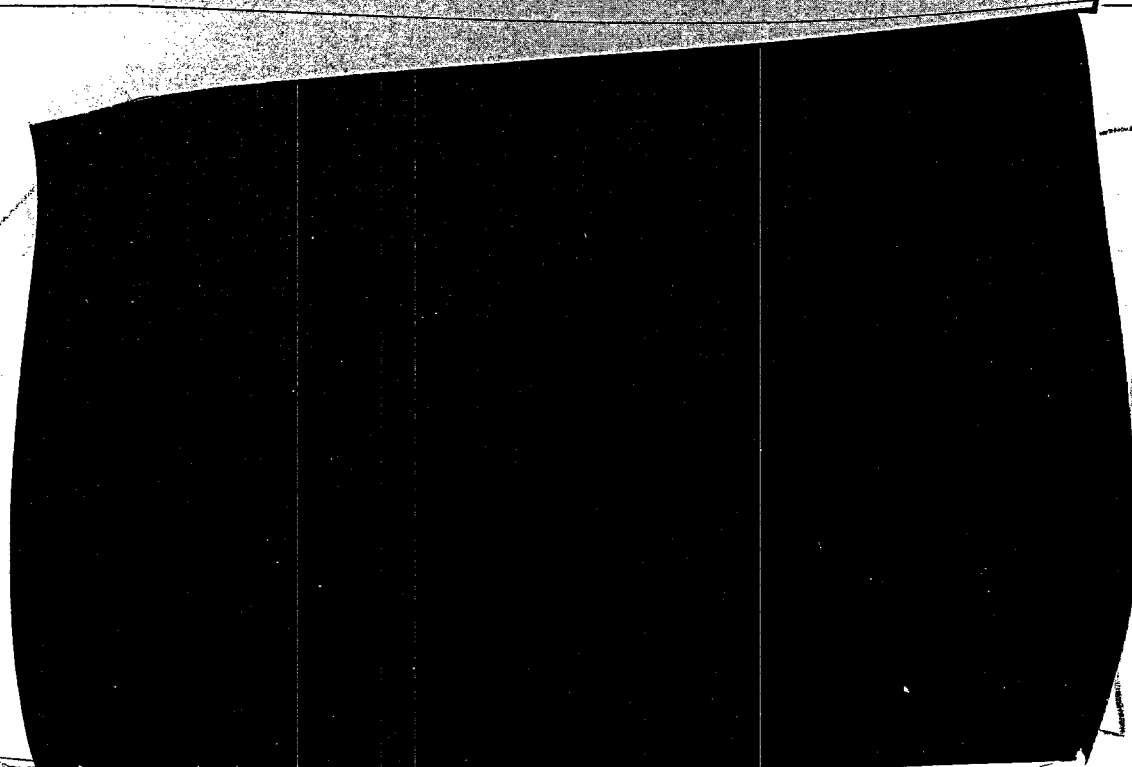

**Dresden:** A leak was identified in an underground pipe which carries tritiated water. (Line from the Condensate Storage Tank to the High Pressure Core Injection System). The pipe is located onsite at the plant very near the reactor buildings themselves. (Approximate 1/4 mile to nearest site boundary). The suspected pipe has been isolated and drained. The leak appears to be associated with a pipe that similarly leaked in 2004 - the licensee only replaced the portion of the pipe with the leak. Excavation has been put on hold to brace areas underneath the CST tank to ensure the ground does not collapse. Replacement of the pipe will then proceed.

OUT OF SCOPE

Release

The leak was identified as a result of an existing onsite ground water monitoring system program. (On site levels have been up to approx. 600,000 pCi/l - as of February 24, 2006 levels in the two closest wells have stabilized between 20-50,000 pCi/l)

The leak is believed to be less than 1000 gallons and localized to an approximate 30 foot area.

Routine environmental wells were sampled in January and have indicated no change in tritium concentration due to the leak.

The NRC, through the Resident Inspectors, are following up on the licensee's actions - we have also initiated observation of the licensee's sampling process and intend to split samples with them for NRC independent analysis.

OUT OF SCOPE

