


~~NON-SENSITIVE - NOT FOR PUBLIC DISCLOSURE~~

EDO Daily Notes for February 3, 2006

ds

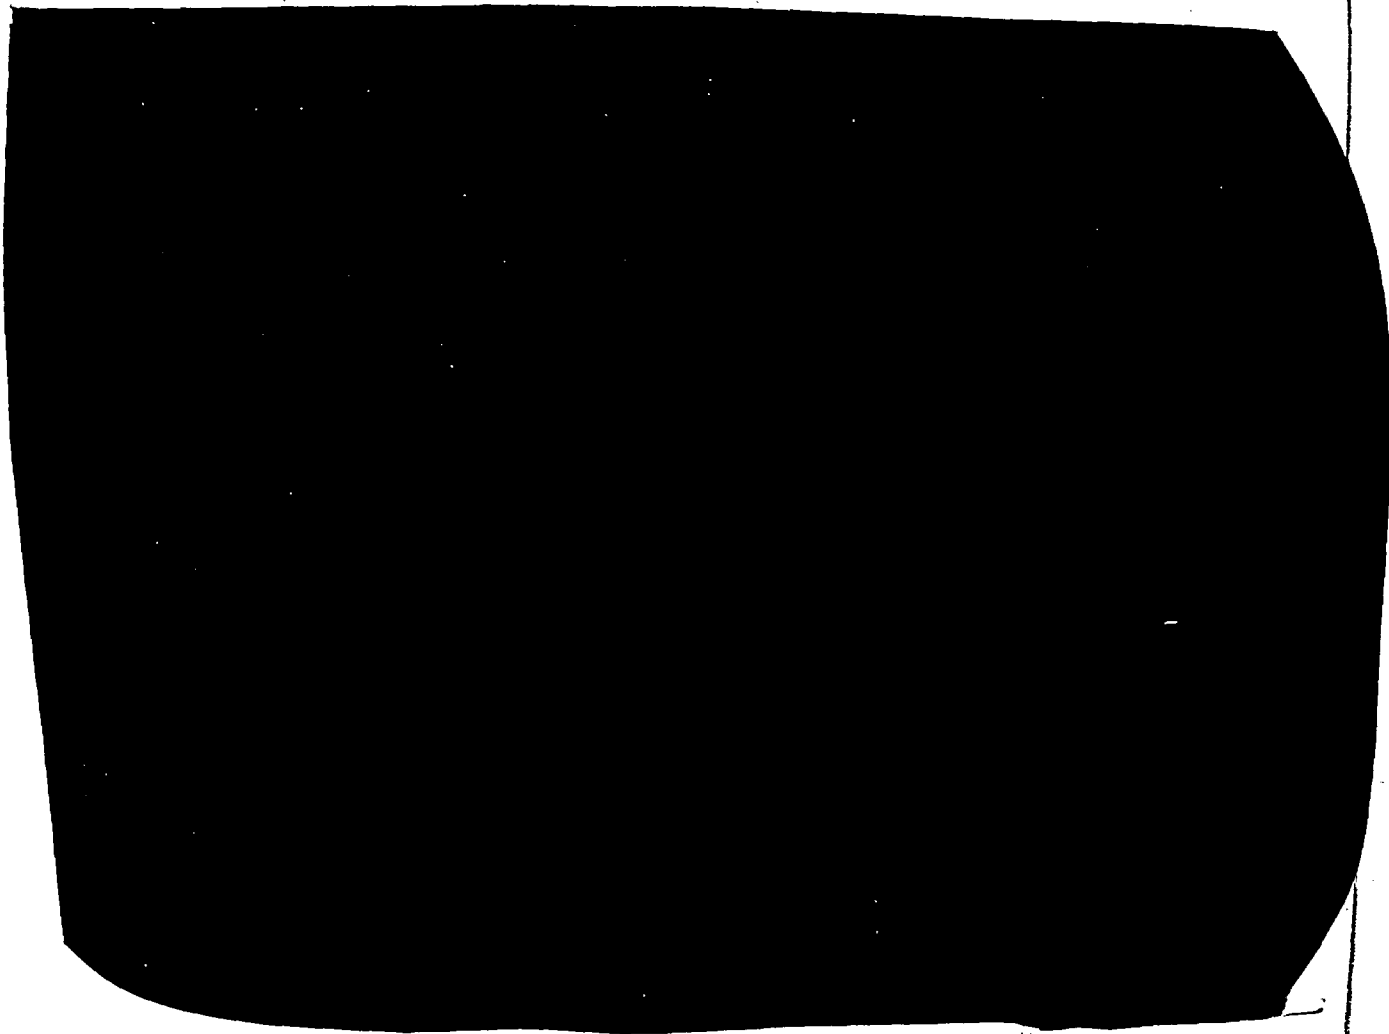


Information in this record was deleted
in accordance with the Freedom of Information
Act, exemptions outside scope
FOIA- 2006-15

~~NON-SENSITIVE - NOT FOR PUBLIC DISCLOSURE~~

m-56

OK

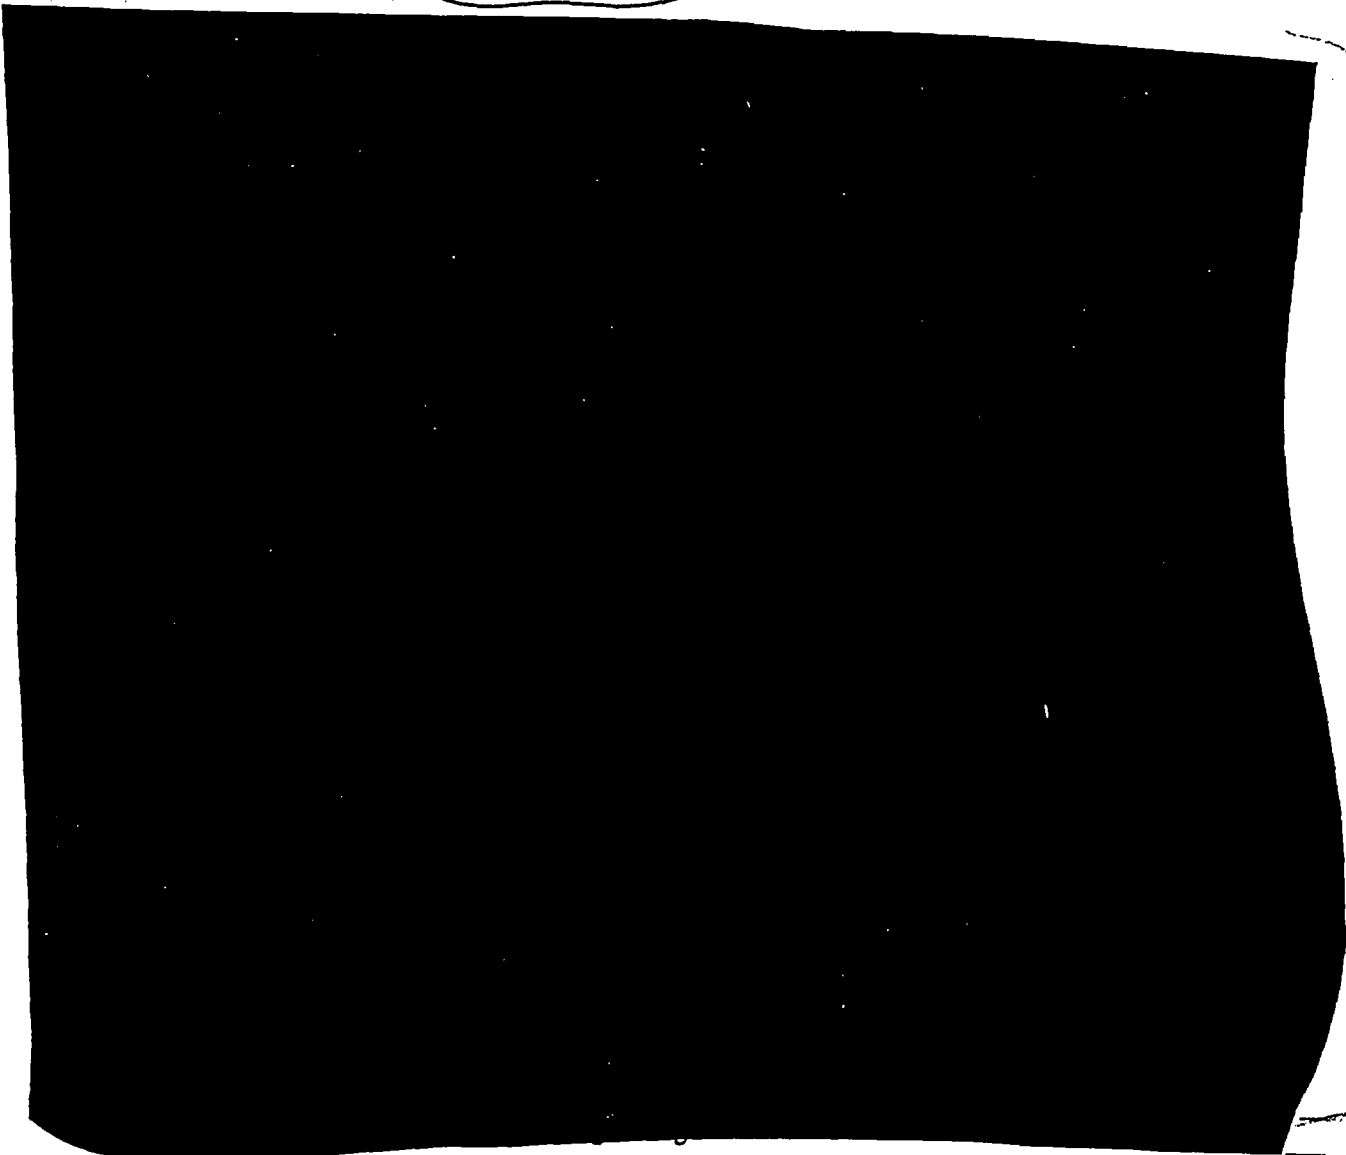

- (Update) This update is being provided regarding the tritium migration issue at the Braidwood plant. Licensee monitoring and characterization efforts are ongoing. The extent of migration of the tritium is being evaluated through installation of new wells onsite, offsite, and along the discharge pipe. Most recent sample results have indicated tritium levels above background at two offsite locations along the discharge pipe. Specifically, tritium levels of approximately 25,000-30,000 picocuries per liter and 7,800 picocuries per liter have been identified at vacuum breaker No. 4 (located just offsite) and No. 7 (located about 2 miles west of the Kankakee River), respectively. The staff plans to issue an inspection report in the near term which details our actions to date, and an additional onsite inspection is planned for the week of February 13, 2006. Media interest has increased and there has been extensive media coverage in the Chicago area. Also, there has been interest expressed by local officials and legislators since

NON-SENSITIVE - NOT FOR PUBLIC DISCLOSURE

both the nearby Village of Godley and Will County are planning public meetings on the issue.

NON-SENSITIVE - NOT FOR PUBLIC DISCLOSURE