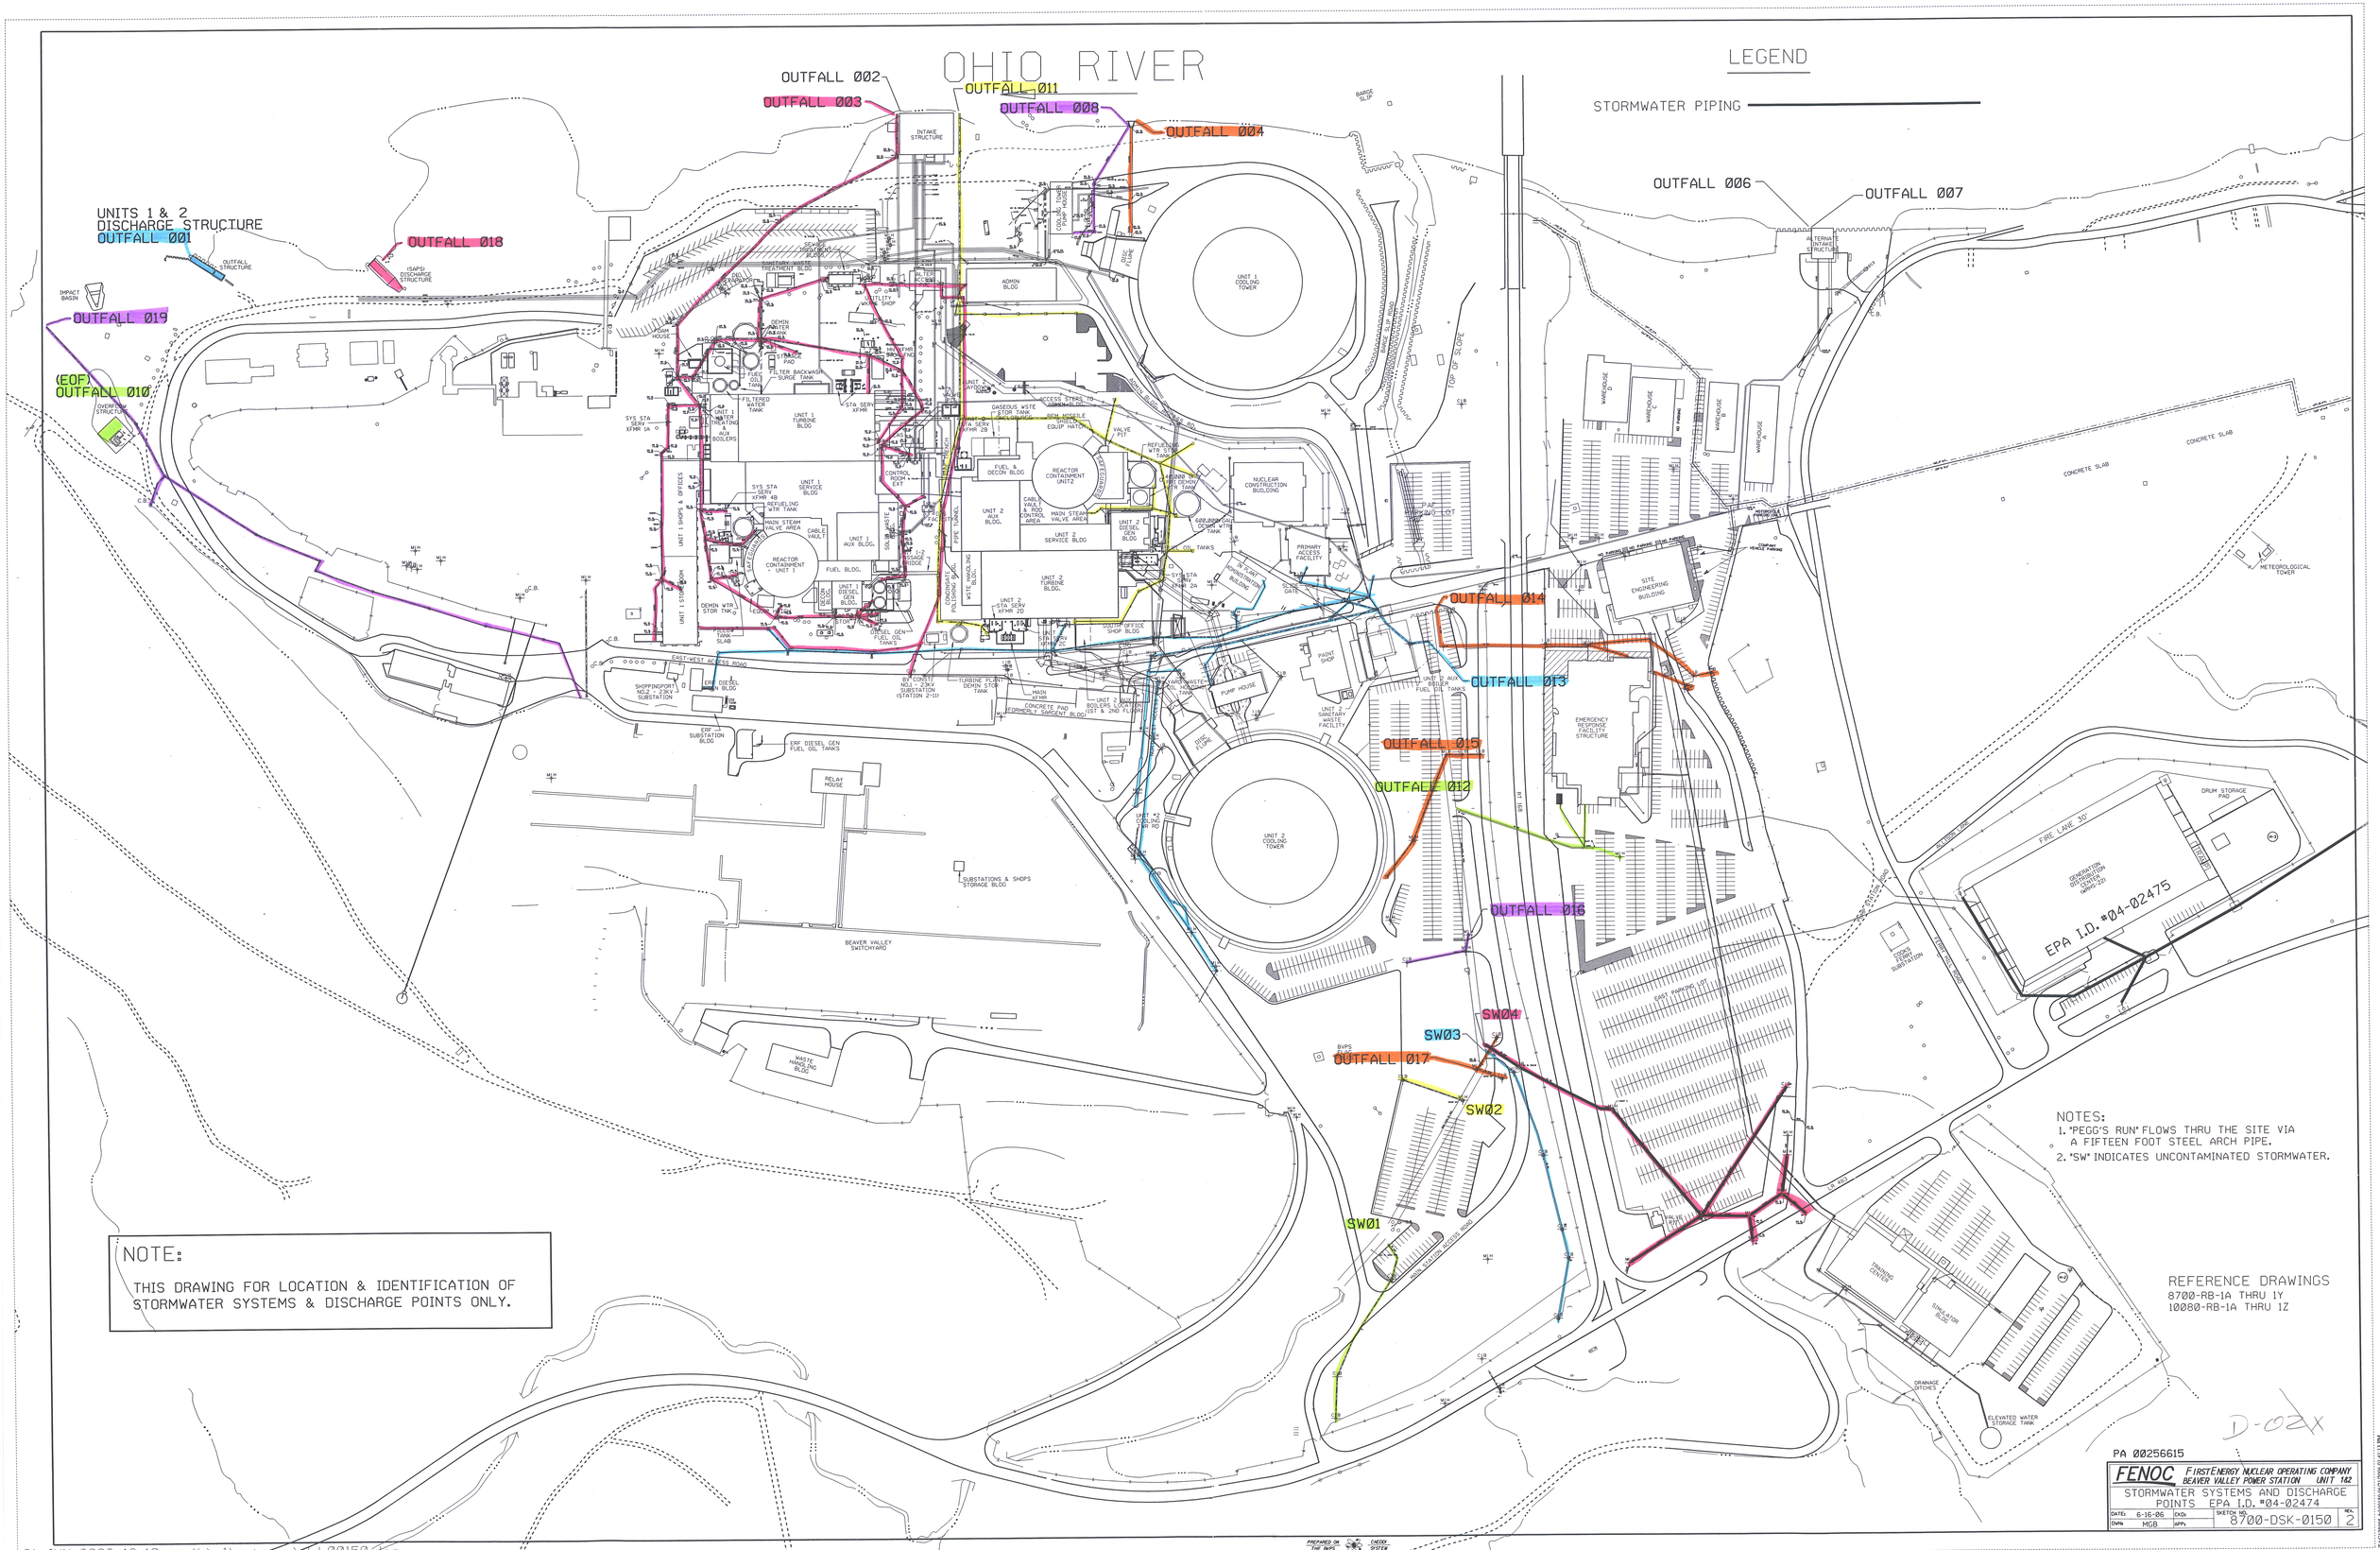
OHIO RIVER
LEGEND
STORMWATER PIPING
OUTFALL 002
OUTFALL 003
OUTFALL 011
OUTFALL 008
OUTFALL 004
OUTFALL 006
OUTFALL 007
UNITS 1 & 2
DISCHARGE STRUCTURE
OUTFALL 001
OUTFALL 018
OUTFALL 019
(EOF)
OUTFALL 010
OUTFALL 014
OUTFALL 013
OUTFALL 015
OUTFALL 012
OUTFALL 016
SW04
SW03
OUTFALL 017
SW02
SW01
EPA I.D. #04-02475
NOTES:
1. 'PEGG'S RUN' FLOWS THRU THE SITE VIA A FIFTEEN FOOT STEEL ARCH PIPE.
2. 'SW' INDICATES UNCONTAMINATED STORMWATER.
REFERENCE DRAWINGS
8700-RB-1A THRU 1Y
10080-RB-1A THRU 1Z
NOTE:
THIS DRAWING FOR LOCATION & IDENTIFICATION OF STORMWATER SYSTEMS & DISCHARGE POINTS ONLY.
D-02X
PA 00256615
FENOC
FIRSTENERGY NUCLEAR OPERATING COMPANY
BEAVER VALLEY POWER STATION UNIT 1&2
STORMWATER SYSTEMS AND DISCHARGE POINTS EPA I.D. #04-02474
DATE: 6-16-06
DWN: MGB
SKETCH NO. 8700-DSK-0150
REV. 2
21-JUN-2006 13:40 K:\ul\sitesav\dsk00150.dgn