



444 South 16th Street Mall  
Omaha NE 68102-2247

July 7, 2006  
LIC-06-0075

U. S. Nuclear Regulatory Commission  
ATTN: Document Control Desk,  
Director, Spent Fuel Project Office, Office of Nuclear Material Safety and Safeguards,  
Washington, D.C. 20555

- References:
1. Docket Nos. 50-285 and 72-054
  2. Letter from OPPD (S.K. Gambhir) to NRC (Document Control Desk & Director, Spent Fuel Project Office) dated June 9, 2006, "Fort Calhoun Station-Request for Exemption from NUHOMS<sup>®</sup> Certificate of Compliance No. 1004, Amendment No. 8" (TAC No. L23984) (LIC-06-0056)
  3. Letter from NRC (J. M. Sebrosky) to OPPD (R. T. Ridenoure) dated June 27, 2006, "Request for Additional Information Regarding the Fort Calhoun Independent Spent Fuel Storage Installation (ISFSI) (TAC. No. L23984)" (NRC-006-078)
  4. Letter from OPPD (J. A. Reinhart) to NRC (Document Control Desk & Director, Spent Fuel Project Office) dated July 3, 2006, "Response to Request for Additional Information Regarding the Fort Calhoun Independent Spent Fuel Storage Installation" (TAC No. L23984) (LIC-06-0073)

**SUBJECT: Corrected Response to Request for Additional Information Regarding the Fort Calhoun Independent Spent Fuel Storage Installation (TAC. No. L23984)**

Reference 2 provided the Omaha Public Power District (OPPD) request for exemption to support use of the standardized NUHOMS<sup>®</sup>-32PT storage system and the OS197L Transfer Cask. Reference 4 provided the OPPD Response to the Nuclear Regulatory Commission (NRC) Request for Additional Information (RAI) contained in Reference 3. The response to RAI-4 included two erroneous page number references to figures contained in TN FCN 721004-321, Revision 1. The corrected text for items 1 and 2 of the last paragraph on Page 3 of the Attachment to Reference 4 should read:


1. As proposed for use of the OS197L TC at FCS, the lift of the inner top shielding will be performed inside the Auxiliary Building using the single-failure-proof crane. (Reference the figure on Page 86 of TN FCN 721004-321, Revision 1, included as Attachment 2 of the exemption request.)

2. The lift of the 3-inch thick outer top shielding onto the inner top shielding will be performed outside of the Auxiliary Building using a non-single-failure-proof crane. The trailer jacks will be engaged prior to this evolution. (Reference the figure on the top of Page 88 of TN FCN 721004-321, Revision 1.)

No commitments are made in this letter.

If you require additional information, please contact Thomas C. Matthews at (402) 533-6938.

Sincerely,

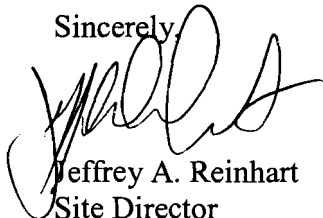

Jeffrey A. Reinhart  
Site Director  
Fort Calhoun Station

JAR/rj

cc: Director of Consumer Health Services, Department of Regulation and Licensure,  
Nebraska Health and Human Services, State of Nebraska