NOTES

1. ALL MANUAL VALVES PREFIXED CAD UNLESS OTHERWISE NOTED.
2. ALL COMPONENT MARK NUMBERS PREFIXED 27 UNLESS OTHERWISE NOTED.
3. WELDED PIPE CAP/PLUG.

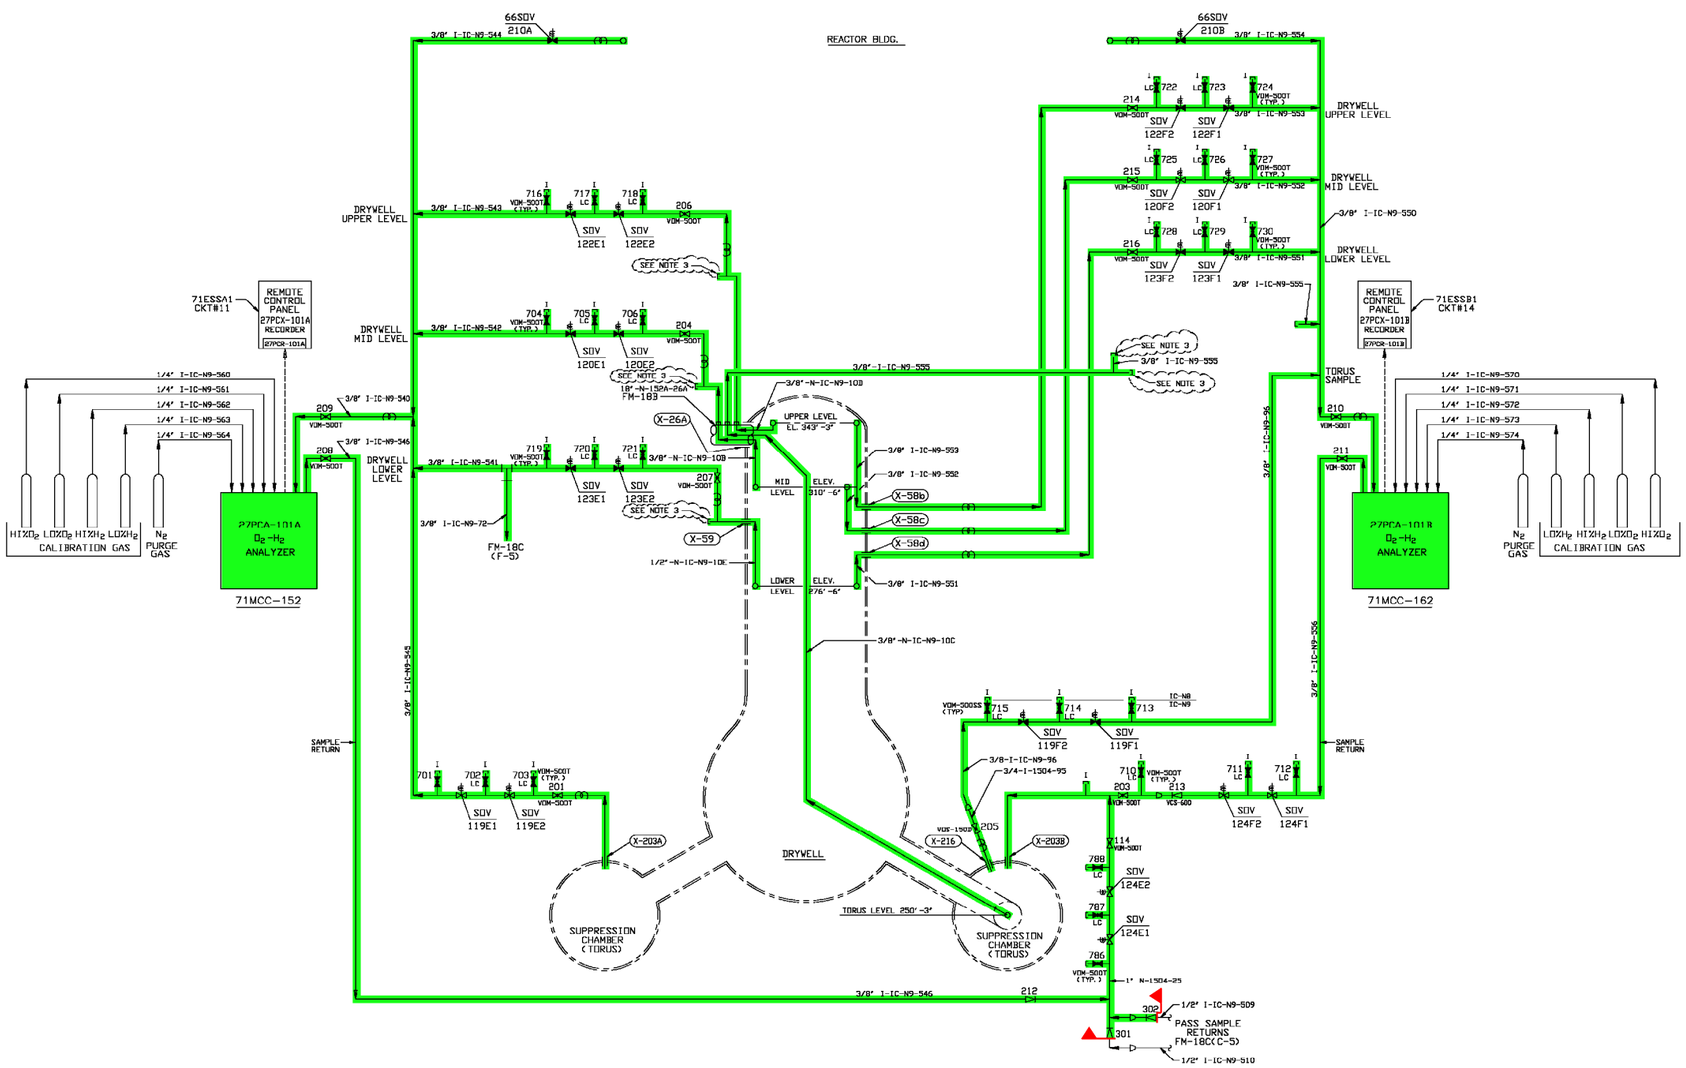

REFERENCES:

1. FLOW DIAGRAM SYMBOLS FM-14A.

INSTRUMENT PIPING DRAWINGS

REACTOR BLDG. SHT. 1-FK-1A
REACTOR BLDG. SHT. 2-FK-1B
REACTOR BLDG. SHT. 3-FK-1C
REACTOR BLDG. SHT. 4-FK-1D
REACTOR BLDG. SHT. 5-FK-1E
REACTOR BLDG. SHT. 6-FK-1F
REACTOR BLDG. SHT. 7-FK-1G
REACTOR BLDG. SHT. 8-FK-1H

SYSTEM INTENDED FUNCTION BOUNDARY

COMPONENTS SUBJECT TO AMR

PRIMARY CONTAINMENT ATMOSPHERE CONTROL AND DILUTION SYSTEM AMM-08

QA CAT. I

NUCLEAR SAFETY RELATED

REV NO	DATE	DESCRIPTION					
14	10/23/08	AS-BUILT PER DCR-02-241	PJD	KMB	--	MM	JA
13	3/1/00	AS-BUILT PER DCR-00-079	PJD	KMB	--	KM	SKK
12	9/8/99	AS-BUILT PER DCR-99-277	KMB	PJD	--	KM	SKK
11	3/8/99	AS-BUILT PER DCR-98-464	RVB	KMB	-	KM	SKK
REV NO	DATE	DESCRIPTION	DWN	CHK	RE	VFY	APP

REVISIONS

DWN | CHK'D
DES SUPV
DISCIPLINE ENG
DISCIPLINE MGR.
PROJ APPROVAL
DATE

JAMES A. FITZPATRICK
NUCLEAR POWER PLANT

FLOW DIAGRAM
CONTAINMENT HYDROGEN
& OXYGEN SAMPLING
SYSTEM NO. 27

Entergy
Nuclear Northeast

SCALE NONE
DWG NO FM-18D
REV 14
SHEET OF

REF: ISI-FM-18D
REF. DPD-37D

NO.	DATE	DESCRIPTION	BY	ENG	CHK	APP
0	8-16-05		.	.	.	.

REVISIONS

LRA-FM-18D-0

CAD FILE LRA-FM-18D_14.DGN
PLOTTER FILE FM-18D_14.CAL