

NAI Report Release

Calculation Number: NAI-1149-016

Revision Number: 1

Title: Palisades Design Basis Fuel Handling Accident AST Radiological Analysis


Description:

Revision 0

This calculation reanalyzes the radiological consequences of the Fuel Handling Accident presented in Section 14.19 of the Palisades FSAR using the AST methodology described in USNRC Reg. Guide 1.183.


Revision 1

This revision corrects the values and header for the table in Section 7.1.10. No models or results are impacted by the typographical correction.



Author
Steven G. Thomasson

6/17/05
Date



Reviewer
Jim Harrell

6/17/05
Date



NAI Management
Tim Guidotti

6/17/05
Date

NAI Calculation Approval

Calculation Number: NAI-1149-016

Revision Number: 1

Title: Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Description:

Revision 0

This calculation reanalyzes the radiological consequences of the Fuel Handling Accident presented in Section 14.19 of the Palisades FSAR using the AST methodology described in USNRC Reg. Guide 1.183.

Revision 1

This revision corrects the values and header for the table in Section 7.1.10. No models or results are impacted by the typographical correction.

Steven G. Thomasson
Author
Steven G. Thomasson


6/17/05
Date

Scope of Review:

Review included:

- A review of calculation methods was completed for consistency with plant-specific and generic regulatory requirements and guidance.
- Computer codes (RADTRAD-NAI) were checked for appropriate qualification.
- Calculation and code inputs and assumptions were verified against IAM document(s) and/or checked for reasonableness and conservatism.
- Computations were checked for correctness.
- References were verified as appropriate.
- Outputs from spreadsheets and utility programs were checked.
- Reported Results were verified against computer outputs.
- Results and conclusions were reviewed for reasonableness.
- Cases run were checked against procurement documents.

Design Verification – See Attachment 1 for Rev. 0 comments. There are no Rev. 1 comments.



Reviewer
Jim Harrell

6/17/05
Date

Check items in the following lists to verify that project documentation and engineering calculations are complete. Mark any items that are not applicable with N/A notation.

Project Documentation Checklist:

N/A

- Project QA Plan.
- Project Organization.
- Project Work Scope and Design Plan.
- Project Calculation and Document Index.
- Project QA Requirements.
- Project Engineer Training and Qualification Forms.
- Project QA Training Certification Forms.
- Project Correspondence.

Engineering Calculations Checklist:

- Identification by subject, originator, reviewer, date and Project so that the calculation is retrievable.
- Table of contents.
- Statement of the objective of the analysis.
- Analysis inputs and their sources.
- Assumptions and how they were developed or determined.
- Hand calculations.
- Identification of computer calculations, including computer type, computer program name and version, code input and output.
- Conclusions.
- Review summary.
- Responses to review comments.
- References.
- Each page of the calculation shall be numbered and the first page shall indicate the total number of pages. The calculation pages may be numbered by sections with the first page of the section indicating the total number of pages in the section.
- The Calculation Approval Sheet shall be signed and dated by the originator.

Table of Contents

1.0 INTRODUCTION 7

2.0 SUMMARY OF RESULTS 7

3.0 DESIGN INPUT 9

 3.1 SOURCE TERM INPUT 9

 3.2 OTHER INPUT 9

4.0 ASSUMPTIONS 9

5.0 ACCEPTANCE CRITERIA..... 10

6.0 COMPUTER CODES 11

7.0 CALCULATIONS..... 12

 7.1 FUEL HANDLING ACCIDENT BASE CASE RADTRAD-NAI MODEL 12

 7.1.1 Fuel Pool Release-Unfiltered (Compartment 1)..... 14

 7.1.2 Environment (Compartment 2)..... 14

 7.1.3 Control Room (Compartment 3)..... 14

 7.1.4 Fuel Pool Release-Filtered (Compartment 4) 14

 7.1.5 Fuel Pool Unfiltered Release to Environment (Pathway 1)..... 14

 7.1.6 Control Room Unfiltered Makeup (Pathway 2)..... 15

 7.1.7 Control Room Filtered Makeup (Pathway 3) 15

 7.1.8 Control Room Unfiltered Inleakage (Pathway 4)..... 15

 7.1.9 Control Room Exhaust (Pathway 5)..... 15

 7.1.10 Fuel Pool Filtered Release to Environment (Pathway 6) 16

 7.1.11 Plant Power and Release Information..... 16

 7.1.12 Overlying Pool..... 16

 7.1.13 Dose Location Information..... 18

 7.1.14 Source Term..... 21

 7.1.15 Release Fraction Timing File 21

 7.2 FUEL HANDLING ACCIDENT CASE 1 RADTRAD-NAI MODEL..... 21

 7.3 FUEL HANDLING ACCIDENT CASE 2 RADTRAD-NAI MODEL..... 21

 7.4 FUEL HANDLING ACCIDENT CASE 3 RADTRAD-NAI MODEL..... 22

8.0 REFERENCES 24

9.0 FHA RADTRAD-NAI ANALYSIS FILES..... 25

Tables

Table 2-1 Radiological Doses for Fuel Handling Accident – Base Case 7
Table 2-2 Radiological Doses for Fuel Handling Accident – Case 1 – 10% Filtered 8
Table 2-3 Radiological Doses for Fuel Handling Accident – Case 2 – 34% Filtered 8
Table 2-4 Radiological Doses for Fuel Handling Accident – Case 3 – 50% Filtered 8
Table 7-1 FHA Release Fraction Timing File 23

Figures

Figure 1 FHA RADTRAD-NAI Model..... 13

Attachments

Attachment 1 Verification Comments for Calculation NAI-1149-016 Rev. 0 26
Attachment 2 RADTRAD-NAI FHA Output – Base Case 28
Attachment 3 RADTRAD-NAI FHA Output – Case 1 – 10% Filtered 72
Attachment 4 RADTRAD-NAI FHA Output – Case 2 – 34% Filtered 121
Attachment 5 RADTRAD-NAI FHA Output – Case 3 – 50% Filtered 170
Attachment 6 FHA Nuclide Inventory File 219
Attachment 7 RADTRAD-NAI Dose Conversion Factor File 233

1.0 Introduction

The purpose of this calculation is to reanalyze the radiological consequences of the Fuel Handling Accident (FHA) presented in Section 14.19 of the Palisades FSAR (Reference 2). This reanalysis will use the AST methodology described in Regulatory Guide 1.183 (Reference 1). Appendix B of the Reg. Guide outlines the requirements for performing a radiological analysis of a FHA.

There are two possible release paths for the activity that escapes the fuel pool in containment; an unfiltered release via the containment equipment hatch, and a filtered release via the FHB ventilation system which exhausts via the plant stack. A series of cases were run:

- Base Case with 100% of the release via the plant equipment hatch
- Case 1 with 10% of the release via the FHB filtration system
- Case 2 with 34% of the release via the FHB filtration system
- Case 3 with 50% of the release via the FHB filtration system

The results presented in this document are bounding values that cover a FHA accident in either the fuel handling building or containment.

2.0 Summary of Results

The following table presents the results of the Fuel Handling Accident case analyzed. The direct shine dose contribution is the sum of the cloud and filter shine doses documented in Table 1 of Reference 12.

Table 2-1 Radiological Doses for Fuel Handling Accident – Base Case

Dose Contribution	Dose (rem TEDE)		
	EAB 2-hr	LPZ 30 days	CR 30 days
Fuel Damage Dose	2.2004E+00	2.7622E-01	3.7755E+00
Shine Dose			0.268
Total	2.20	0.28	4.04
Acceptance Criteria	6.3	6.3	5
Control Room Unfiltered Inleakage = 100 cfm			

The analysis demonstrates that a FHA within the containment while the maintenance hatch is open or within the Fuel Handling Building (FHB) will not produce doses in excess of the prescribed limits. The results presented in this document are bounding values that cover a FHA accident in either the fuel handling building or containment.

Table 2-2 Radiological Doses for Fuel Handling Accident – Case 1 – 10% Filtered

Dose Contribution	Dose (rem TEDE)		
	EAB 2-hr	LPZ 30 days	CR 30 days
Fuel Damage Dose	2.0224E+00	2.5413E-01	3.4115E+00
Shine Dose			0.268
Total	2.02	0.25	3.68
Acceptance Criteria	6.3	6.3	5
Control Room Unfiltered Inleakage = 100 cfm			

Table 2-3 Radiological Doses for Fuel Handling Accident – Case 2 – 34% Filtered

Dose Contribution	Dose (rem TEDE)		
	EAB 2-hr	LPZ 30 days	CR 30 days
Fuel Damage Dose	1.5953E+00	2.0111E-01	2.5381E+00
Shine Dose			0.268
Total	1.60	0.20	2.81
Acceptance Criteria	6.3	6.3	5
Control Room Unfiltered Inleakage = 100 cfm			

Table 2-4 Radiological Doses for Fuel Handling Accident – Case 3 – 50% Filtered

Dose Contribution	Dose (rem TEDE)		
	EAB 2-hr	LPZ 30 days	CR 30 days
Fuel Damage Dose	1.3106E+00	1.6576E-01	1.9558E+00
Shine Dose			0.268
Total	1.31	0.17	2.22
Acceptance Criteria	6.3	6.3	5
Control Room Unfiltered Inleakage = 100 cfm			

3.0 Design Input

3.1 Source Term Input

Reference 5 defines the event as damage to all of the fuel pins in 1 fuel assembly. As described in Section 6.3 of Reference 8, the design basis source term for a limiting fuel assembly for a FHA was defined in Table 6-8 of that calculation and incorporated into the "nif" file included as Attachment 25 to that calculation. Note that per the discussion given in Section 7.1.15, the activities for I-131 and Kr-85 will be adjusted to account for different gap release fractions for these isotopes as specified by Table 3 of Reg. Guide 1.183.

3.2 Other Input

Reference 5 lists other input, provided by Palisades, used in the development of the Palisades FHA RADTRAD-NAI models.

4.0 Assumptions

- Mixing of the release from the fuel pool with the containment (or fuel handling building) atmosphere is ignored.
- At all times, a minimum of 22.5 feet of water is maintained above the damaged fuel. Thus, per Section 2.0 of Appendix B to Reg. Guide 1.183, the decontamination factor for elemental iodine will be adjusted to account for less than 23 feet of water coverage.
- The analysis will assume a decay time of 48 hours before fuel movement as identified in Reference 5. This decay time is included in the FHA source term presented in Reference 8.
- Per Reg. Guide 1.183, the release is assumed to occur over a 2 hour period.

5.0 Acceptance Criteria

Per Section 4.4 and Table 6 of Reg. Guide 1.183, the acceptable dose limits for the Exclusion Area Boundary (EAB), Low Population Zone (LPZ), and Control Room (CR) for a FHA are:

Fuel Handling Accident Dose Limits

Area	Dose Criteria	
EAB	6.3 rem (TEDE)	(worst 2 hours)
LPZ	6.3 rem (TEDE)	(for 30 days)
Control Room*	5 rem (TEDE)	(for 30 days)

*Control room dose limit is specified in 10CFR50.67

6.0 Computer Codes

The following computer code was used for performing the analyses presented in this calculation:

Computer Code	Version	Reference	Purpose
RADTRAD-NAI	1.1a(QA)	3	Radiological Dose Calculations

RADTRAD-NAI (Reference 3) is qualified and maintained under the Numerical Applications Inc. QA program (Reference 4). This QA program meets the requirements of 10CFR50 Appendix B with code error reporting per 10CFR21. RADTRAD-NAI is accessed via a controlled access web-based interface that provides a front-end for developing and submitting input models. The input developed via the interface is submitted to the RADTRAD-NAI solver that runs on an AMD-ATHLON based personal computer running LINUX.

7.0 Calculations

Appendix B to Reg. Guide 1.183 sets the requirements for the transport, reduction, and release of radionuclides for the FHA. Per Reg. Guide 1.183, a FHA within the fuel building and a FHA within the containment must be considered. Since all of the release within the FHB would be filtered, the most limiting FHA will be a release inside the containment (with the assumption that the containment equipment hatch is open).

The analysis will assume a decay time of 48 hours before fuel movement as identified in Reference 5. The 48 hour delay is included in the FHA source term provided by Reference 8.


7.1 Fuel Handling Accident Base Case RADTRAD-NAI Model

The RADTRAD-NAI model developed for the FHA calculation consists of three compartments and five pathways (see Figure 1):

Compartment Description	Compartment Number	RADTRAD-NAI Compartment Type
Fuel Pool - Unfiltered	1	(3) Normal
Environment	2	(2) Environment
Control Room	3	(1) Control Room

Pathway Description	Compartment Connections	Pathway Number	RADTRAD-NAI Pathway Type
Fuel Pool Release-Unfiltered	1 to 2	1	Filtered
Control Room Unfiltered Makeup	2 to 3	2	Filtered
Control Room Filtered Makeup	2 to 3	3	Filtered
Control Room Unfiltered Inleakage	2 to 3	4	Filtered
Control Room Exhaust	3 to 2	5	Filtered

Figure 1 FHA RADTRAD-NAI Model

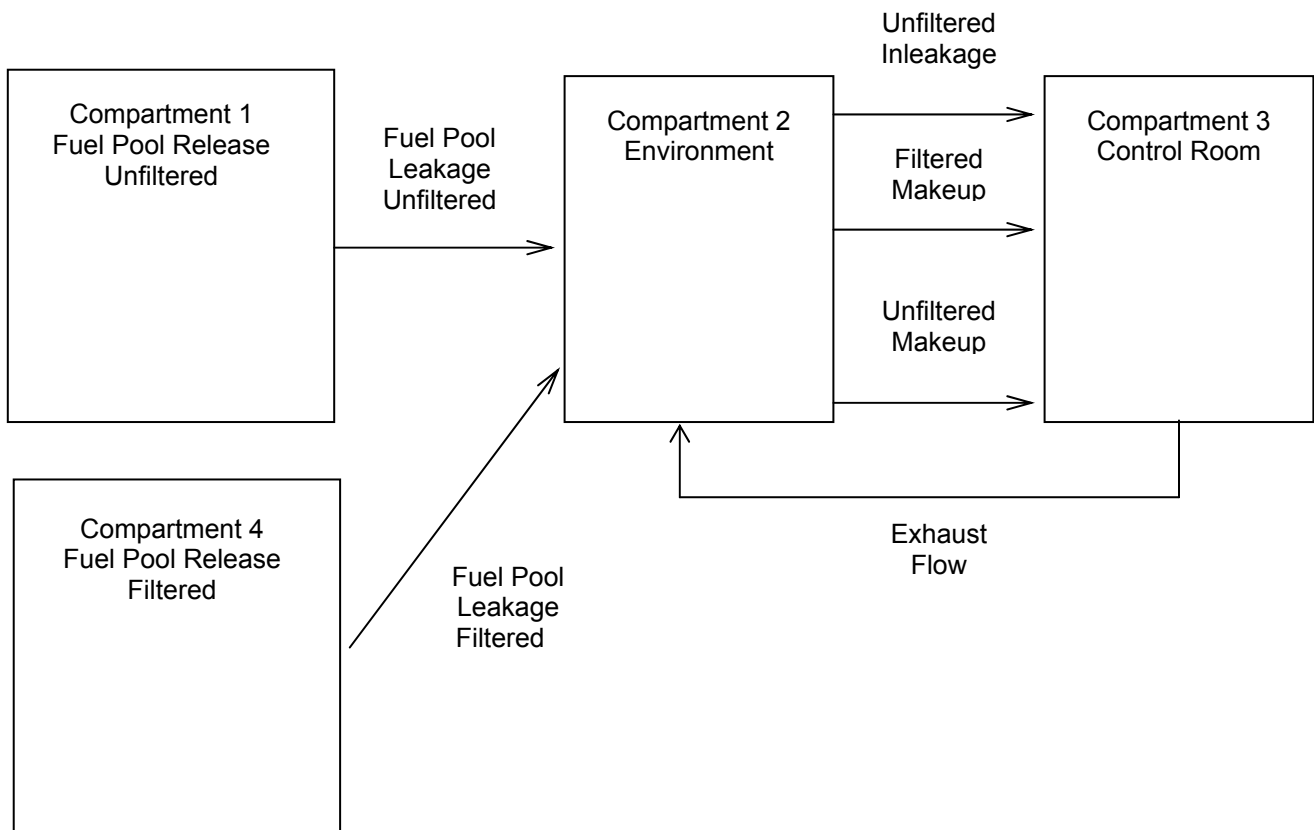

The subsections that follow describe the RADTRAD-NAI input for the FHA.

7.1.1 Fuel Pool Release-Unfiltered (Compartment 1)

The following input was specified for the Fuel Pool Source Volume:

Volume	10,000 ft ³	Dummy value assumed, a convective flow path is used to release the fuel pool activity to the environment
Source Fraction	1.00	100% of source term applied to Fuel Pool volume
Recirculation Filters	no	
Natural Deposition	no	
Overlying Pool	yes	Model 22.5 feet of water above damaged fuel assembly

7.1.2 Environment (Compartment 2)

The only required input for the environment compartment is volume. This value is a “dummy” value; however, an input is required for this field. An arbitrary value of 2.0E20 ft³ was specified.

7.1.3 Control Room (Compartment 3)

The control room volume was set to 35,923 ft³. The control room HVAC system is assumed to be operating in normal mode at the beginning of the event. The control room enters emergency mode at 20 minutes (manual operator action).

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	0.0	99	99	99
0.3333	1413.6	99	99	99
720.0	1413.6	99	99	99

7.1.4 Fuel Pool Release-Filtered (Compartment 4)

The following input was specified for the Fuel Pool Source Volume:

Volume	10,000 ft ³	Dummy value assumed, a convective flow path is used to release the fuel pool activity to the environment
Source Fraction	0.0	No unfiltered release
Recirculation Filters	no	
Natural Deposition	no	
Overlying Pool	yes	Model 22.5 feet of water above damaged fuel assembly

7.1.5 Fuel Pool Unfiltered Release to Environment (Pathway 1)

This pathway connects the Fuel Pool-Unfiltered (Compartment 1) with the Environment Compartment (Compartment 2) and represents the unfiltered release that exits via the equipment hatch. Reg. Guide 1.183 specifies that the release from the spent fuel pool be leaked to the environment over a two hour period. The two hour release period is handled via the release fraction timing file; therefore, a high flow rate is used to extract the release from the fuel pool

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

compartment. A 100% filter efficiency is specified for the aerosol release fraction (no aerosol release per page B-2 of Reg. Guide 1.183).

Equipment Hatch Release

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	1e6	100	0	0
720.0	1e6	100	0	0

7.1.6 Control Room Unfiltered Makeup (Pathway 2)

The initial unfiltered makeup flow rate is 660 cfm. After control room isolation at 20 minutes, the flow is 0 cfm.

Unfiltered Makeup Flow

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	660.0	0	0	0
0.3333	0.0	0	0	0
720.0	0.0	0	0	0

7.1.7 Control Room Filtered Makeup (Pathway 3)

The control room filtered makeup flow of 1413.6 cfm starts at 20 minutes (time of control room isolation).

Filtered Makeup Flow

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	0.0	99	99	99
0.3333	1413.6	99	99	99
720.0	1413.6	99	99	99

7.1.8 Control Room Unfiltered Inleakage (Pathway 4)

The unfiltered inleakage was set to 100 cfm.

Unfiltered Inleakage

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	0.0	0	0	0
0.3333	100.0	0	0	0
720.0	100.0	0	0	0

7.1.9 Control Room Exhaust (Pathway 5)

The control room exhaust is equal to the sum of the control room intake and inleakage flows.

Exhaust Flow

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	660.0	0	0	0
0.3333	1513.6	0	0	0
720.0	1513.6	0	0	0

7.1.10 Fuel Pool Filtered Release to Environment (Pathway 6)

This pathway connects the Fuel Pool-Filtered Compartment (Compartment 4) with the Environment Compartment (Compartment 2) and represents the filtered release that exits via the FHB filtration system exhausting via the plant stack. Reg. Guide 1.183 specifies that the release from the spent fuel pool be leaked to the environment over a two hour period. The two hour release period is handled via the release fraction timing file; therefore, a high flow rate is used to extract the release from the fuel pool compartment. A 100% filter efficiency is specified for the aerosol release fraction, and a 94% elemental and organic efficiency was specified (Reference14).

Fuel Pool Filtered Release

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	1e6	100	94	94
720.0	1e6	100	94	94

7.1.11 Plant Power and Release Information

The design basis power in the FHA nuclide inventory file is 2703 MW_{th}. The nuclide inventory file contains the total number of curies for one damaged fuel assembly; therefore, the “plant power” entry in the RADTRAD-NAI input file was also set to 2703 MW_{th}. Item 1.3 of Appendix B to Reg. Guide 1.183 specifies that the makeup of the iodine species is 99.85% elemental and 0.15% organic:

Start of first release time (hours)	0.0
Calculate decay	yes
Calculate daughters	yes
Iodine Fraction – aerosol	0.0
Iodine Fraction – elemental	0.9985
Iodine Fraction – organic	0.0015

7.1.12 Overlying Pool

Item 2 of Appendix B to Reg. Guide 1.183 states:

“If the depth of water above the damaged fuel is 23 feet or greater, the decontamination factors for the elemental and organic species are 500 and 1, respectively, giving an overall effective decontamination factor of 200 (i.e., 99.5% of the total iodine released from the damaged rods is retained by the water). This difference in decontamination factors for elemental (99.85%) and organic iodine (0.15%) species results in the iodine above the water being

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

composed of 57% elemental and 43% organic species. If the depth of water is not 23 feet, the decontamination factor will have to be determined on a case-by-case method (Ref. B-1)."

The guidance quoted above sets out an inconsistent set of conditions for the elemental iodine decontamination factor. Recent clarification from the NRC indicates that the appropriate criteria is on overall decontamination factor of 200. Based on the release fractions of 99.85% elemental and 0.15% organic, an elemental iodine decontamination factor of approximately 285 is required to produce an overall decontamination factor of 200.

In addition, Section 3.0 of Appendix B to Reg. Guide 1.183 states:

"The retention of noble gases in the water in the fuel pool or reactor cavity is negligible (i.e., decontamination factor of 1). Particulate radionuclides are assumed to be retained by the water in the fuel pool or reactor cavity (i.e., infinite decontamination factor)."

Per the inputs listed in Reference 5, 22.5 feet of water will be maintained above the damaged fuel; therefore, the decontamination factor for elemental iodine must be adjusted. The decontamination factor for organic iodine was set to 1.0.

Page 26 of Reference 6 gives an equation for the DF for elemental iodine as a function of pool depth:

$$DF_F = e^{(6/d_b)(k_{eff})(H)/(v_b)}$$

where: H = bubble rise height (cm)
 v_b = rise velocity
 k_{eff} = effective mass transfer coefficient
 d_b = bubble diameter
 D_F = I_2 decontamination factor

Since there is only a 6" difference between 23' and 22.5' it is assumed that all of the parameters listed above are the same at both 23' and 22.5', the equation above can be rewritten as follows:

$$DF_F = e^{(constant)(H)}$$

Thus for a DF of 285 for elemental iodine with a pool depth of 23' (701.04 cm):

$$285 = e^{(constant)(701.04)}$$

constant = 0.008063

The DF for elemental iodine for a pool depth of 22.5' (685.8 cm) is:

$$DF = e^{(0.008063)(685.8)} = 252$$

Therefore, with a pool depth of 22.5', the DF for organic iodine is 1 and the DF for elemental iodine is 252.

The effective DF for iodine (page 26 of Reference 6) for a pool depth of 22.5' is:

$$DF_{eff} = [(elemental\ fraction / DF_{elemental}) + (organic\ fraction / DF_{organic})]^{-1}$$

$$DF_{eff} = [(0.9985 / 252) + (0.0015 / 1)]^{-1} = 183.07$$

7.1.13 Dose Location Information

Three dose locations were specified; the Exclusion Boundary (EAB), the Low Population Zone (LPZ), and the Control Room (CR). The X/Qs for the EAB and LPZ are from Table 5 of Reference 10. The breathing rates are from Section 4.1.3 of Reg. Guide 1.183:

Exclusion Boundary Data:

EAB X/Q

X/Q Table 1

Time (hours)	X/Q (sec/m ³)
0.0	5.39E-4
720.0	5.39E-4

EAB & LPZ Breathing Rate

Time (hours)	Breathing Rate (m ³ /sec)
0.0	3.5E-4
8.0	1.8E-4
24.0	2.3E-4
720.0	2.3E-4

Low Population Zone Data:

LPZ X/Q

X/Q Table 2

Time (hours)	X/Q (sec/m ³)
0.0	6.66E-5
2.0	3.03E-5
8.0	2.04E-5
24.0	8.67E-6
96.0	2.54E-6
720.0	2.54E-6

Control Room Data:

The breathing rates and occupancy factor for the control room are from Section 4.2.6 of Reg. Guide 1.183. The X/Qs are from Table 4 of Reference 10. The X/Qs for unfiltered release correspond to the containment equipment hatch. The X/Qs for the filtered release correspond to the plant stack.

**Control Room X/Q for Equipment Hatch to Normal Intake
Table 3**

Time (hours)	X/Q (sec/m ³)
0.0	1.25E-2
2.0	9.83E-3
8.0	3.62E-3
24.0	2.86E-3
96.0	2.28E-3
720.0	2.28E-3

**Control Room X/Q for Equipment Hatch to Emergency Intake
Table 4**

Time (hours)	X/Q (sec/m ³)
0.0	7.32E-4
2.0	6.13E-4
8.0	2.45E-4
24.0	1.75E-4
96.0	1.29E-4
720.0	1.29E-4

**Control Room X/Q for Plant Stack to Normal Intake
Table 5**

Time (hours)	X/Q (sec/m ³)
0.0	6.10E-3
2.0	4.32E-3
8.0	1.73E-3
24.0	1.27E-3
96.0	9.79E-4
720.0	9.79E-4

**Control Room X/Q for Plant Stack to Emergency Intake
Table 6**

Time (hours)	X/Q (sec/m ³)
0.0	8.32E-4
2.0	7.69E-4
8.0	2.83E-4
24.0	2.15E-4
96.0	1.57E-4
720.0	1.57E-4

Control Room Breathing Rate

Time (hours)	Breathing Rate (m ³ /sec)
0.0	3.5E-4
720.0	3.5E-4

Control Room Occupancy Factor

Time (hours)	Factor
0.0	1.0
24.0	0.6
96.0	0.4
720.0	0.4

Dose Location Pathway Combinations

Control Room Intake Path	Release Path	X/Q Table
2	1	3
3	1	4
4	1	3
2	6	5
3	6	6
4	6	5

7.1.14 Source Term

Item 1.2 of Appendix B to Reg. Guide 1.183 specifies the radionuclide groups that should be considered for an radiological analysis of a FHA. Reference 9 provides a listing of the individual nuclides and dose conversion factors used for the analyses presented in this calculation. The data provided in Reference 9 are consistent with Reg. Guide 1.183. The dose conversion factors provided in Reference 9 were obtained from Table 2.1 of Federal Guidance Report 11 and Table III.1 of Federal Guidance Report 12.

7.1.15 Release Fraction Timing File

Table 7-1 presents the release fraction timing file used for the FHA. The minimum allowable decay time before movement of fuel is 48 hours. As discussed in a previous section, the 48 hour decay time is accounted for in the FHA source term.

Table 3 of Reg. Guide 1.183 specifies the following composition for the non-LOCA fraction of fission product inventory in the fuel rod gap:

Group	Fraction
I-131	0.08
Kr-85	0.10
Other Noble Gases	0.05
Other Halogens	0.05
Alkali Metals	0.12

The release fractions for iodine and noble gases, were set to 5% in the release fraction timing file. The release fraction for I-131 is 0.08 versus 0.05 for the remaining iodine isotopes. To account for this difference, the source term for I-131 in the RADTRAD-NAI nuclide inventory ("nif") file was increased by a factor of 1.6 (0.08 / 0.05) to 0.1028E7. Similarly, the Kr-85 source was increased by a factor of 2.0 to 0.2104E5 to adjust the Kr-85 release to the specified 10% while retaining other noble gas releases at 5% as prescribed in the release fraction timing file *pal_fha_ast.rft* (Table 7-1). The adjusted FHA nif file, *pal_FHA_db_ast_adj.nif*, is provided in Attachment 6.

7.2 Fuel Handling Accident Case 1 RADTRAD-NAI Model

This model is similar to that documented in Section 7.1. The only difference is that the source term fraction for Volume 1 was set to 0.90 and the source term fraction for Volume 4 was set to 0.10.

7.3 Fuel Handling Accident Case 2 RADTRAD-NAI Model

This model is similar to that documented in Section 7.1. The only difference is that the source term fraction for Volume 1 was set to 0.66 and the source term fraction for Volume 4 was set to 0.34.

7.4 Fuel Handling Accident Case 3 RADTRAD-NAI Model

This model is similar to that documented in Section 7.1. The only difference is that the source term fraction for Volume 1 was set to 0.50 and the source term fraction for Volume 4 was set to 0.50.

Table 7-1 FHA Release Fraction Timing File

Release Fraction and Timing Name:

PWR, NUREG 1.183, Palisades FHA Release AST

Duration (h): Design Basis Accident

0.1000E-02 0.1000E-02 0.2000E+01 0.0000E+00

Noble Gases:

0.0000E+00 0.0000E+00 0.0500E+00 0.0000E+00

Iodine:

0.0000E+00 0.0000E+00 0.0500E+00 0.0000E+00

Cesium:

0.0000E+00 0.0000E+00 0.1200E+00 0.0000E+00

Tellurium:

0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00

Strontium:

0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00

Barium:

0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00

Ruthenium:

0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00

Cerium:

0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00

Lanthanum:

0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00

Non-Radioactive Aerosols (kg):

0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00

End of Release File

8.0 References

1. USNRC, Regulatory Guide 1.183, "Alternative Radiological Source Terms for Evaluating Design Basis Accidents at Nuclear Power Plants", July 2000.
2. Palisades Nuclear Plant FSAR, Revision 24.
3. Numerical Applications Inc., NAI-9912-04, Revision 4, "RADTRAD-NAI Version 1.1a(QA) Documentation", October 2004.
4. Numerical Applications Inc., "Dose Methodology Quality Assurance Procedures", Revision 1, June 4, 2001.
5. Email Jeffery Voskuil (NMC) to Jim Harrell (NAI), dated June 28 2004, Subject: FHA Inputs.
6. G. Burley, "Evaluation of Fission Product Release and Transport for a Fuel Handling Accident", October 5 1971.
7. Palisades Plant Technical Specifications through Amendment 213.
8. NAI Calculation Number NAI-1149-001 Rev. 1, "Source Terms for Palisades Dose Calculations".
9. NAI Calculation Number NAI-1101-001 Rev. 1, "Generation of .nif and .inp Files for RADTRAD-NAI".
10. NAI Calculation Number NAI-1149-002 Rev. 0, "Determination of Atmospheric Dispersion Factors for Palisades".
11. Reference deleted.
12. NAI Calculation Number NAI-1149-003 Rev. 1, "Determination of Direct Shine Doses for a LOCA for Palisades".
13. NAI-E03-211 Project Memo 2004-09, "Additional Inputs", October 20 2004.
14. Email Jeffery Voskuil (NMC) to Jim Harrell and Steve Thomasson (NAI), dated October 8 2004, "Subject: Response to Input Questions from NAI".

9.0 FHA RADTRAD-NAI Analysis Files

RADTRAD-NAI FHA Cases

File Name	Attachment	Description
pal_fha_db_ast_nofilter.out	Attachment 2	FHA Base Case RADTRAD-NAI Model output
pal_fha_db_ast_10filter.out	Attachment 3	FHA Case 1 RADTRAD-NAI Model output
pal_fha_db_ast_34filter.out	Attachment 4	FHA Case 2 RADTRAD-NAI Model output
pal_fha_db_ast_50filter.out	Attachment 5	FHA Case 3 RADTRAD-NAI Model output
pal_FHA_db_ast_adj.nif	Attachment 6	FHA Nuclide Inventory File
pal_fha_ast.rft	Table 7-1	FHA Release Fraction Timing File
NAI-1101-001rev0.dcf	Attachment 7	Dose Conversion Factor File

Attachment 1 Verification Comments for Calculation NAI-1149-016 Rev. 0**Comment 1**

Page 6, Tables - Table 2-1 Radiological Doses for Fuel Handling Accident – Case 3 – 50% Filtered should be “Table 2-4.”

Response: TOC has been updated.

Comment 2

Page 9 – This page is blank, but it may be associated with the version of Word or printer selected.

Response: Blank page has been removed.

Comment 3

Page 10, Section 3.1 – Check Section, Table and Attachment numbers from Reference 8 (NAI-1149-001, R1) for correct selection of the design basis FHA source term. It appears that the section should be 6.3 versus 6.4, that the Table should be 6-8 versus 6-5 and that the Attachment should be 25 versus 19. The table numbers in the pdf for NAI-1149-001, R1 (page 19) appear to be corrupted and/or incorrect in many cases. Please re-convert the file with corrected table numbers and provide a copy of the re-converted file to the appropriate distribution.

Response: References have been changed to point to design basis data (Section 6.3, Table 6-8, and Attachment 25)

Comment 4

Page 13, Section 7.0 – Suggest rewording “containment equipment door” to “containment equipment hatch” for consistency.

Response: Fixed.

Comment 5

Page 15, Section 7.1.5 – Suggest adding the basis for no aerosol release (e.g., item 3 on page B-2 of RG 1.183) in section 3.0 or 4.0. This basis appears to be after this section in section 7.1.12.

Response: Basis has been added.

Comment 6

Page 17, Section 7.1.10 – Suggest adding the word “Compartment” after “Fuel Pool-Filtered”.

Response: Fixed

Comment 7

Page 17, Section 7.1.11 – 2703 MWt is the design basis value for plant power, not best-estimate.

Response: “Best-estimate” changed to “Design basis”.

Comment 8

Page 18, Section 7.1.12 – Since the bubble diameter (and to some extent, the shape factor) is the key parameter that impacts the rise velocity and the effective mass transfer coefficient and since the bubble diameter is predominantly based on the fuel configuration, the “constant” assumption is reasonable. **No response required.**

Attachment 2 RADTRAD-NAI FHA Output – Base Case

```
#####
RADTRAD-NAI Version 1.1a(QA) run on May 20, 2005 at 07:09:52
#####
#####
File information
#####
```

```
Plant file name           = pal/FHA/db/pal_fha_db_ast_nofilter.psf
Inventory file name       = pal/FHA/db/palisades_fha_db_ast_adj.nif
Scenario file name       = pal/FHA/db/pal_fha_db_ast_nofilter.psf
Release file name        = pal/FHA/db/pal_fha_ast.rft
Dose conversion file name = pal/FHA/db/nai-1101-001rev0.dcf
```

```
#####      #####      #####      # #      # #####      # #      #####
# # #      #      # ##      # # #      # #      # #      #
# # #      #      # # #      # # #      # #      # #      #
#####      #####      #####      # # #      # #####      # #      #
#          # #      # #      # # #      # #      # #      #
#          # #      # #      # #      # #      # #      #
#          #####      # #      # #      # #      #####      #
```

```
*RADTRAD-NAI 1.1a(QA)
*20 May 2005 07:09:48
** Palisades FHA Design Basis
** No release filtration
**
*Nuclide inventory file
pal/FHA/db/palisades_fha_db_ast_adj.nif
*Plant power
2703
*Compartments
4
*Compartment 1:
Fuel Pool-Unfiltered
3
10000
0
0
0
1
*Compartment 2:
Environment
2
2e+20
0
0
0
0
*Compartment 3:
Control Room
1
35923
0
1
0
0
*Compartment 4:
Fuel Pool-Filtered
3
10000
0
0
0
1
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
*Pathways
6
*Pathway 1:
Fuel Pool Release-Unfiltered
1
2
2
*Pathway 2:
Control Room Unfiltered Makeup
2
3
2
*Pathway 3:
Control Room Filtered Makeup
2
3
2
*Pathway 4:
Control Room Unfiltered Inleakage
2
3
2
*Pathway 5:
Control Room Exhaust
3
2
2
*Pathway 6:
Fuel Pool Release-Filtered
4
2
2
*Sources
4
1 1
2 0
3 0
4 0
*dose conversion factors filename
pal/FHA/db/nai-1101-001rev0.dcf
*release fraction and timing filename
pal/FHA/db/pal_fha_ast.rft
0
1
1
*Iodine
0 0.9985 0.0015
*Overlying pool
*aerosol model
0
*elemental model
1
2
0 252
720 252
*organic model
1
2
0 1
720 1
*pH tracking
0
*Compartment detail
*Compartment 1:
1
*spray model
0
0
0
*filter model
0
*deposition model
0
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
0
*Compartment 2:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Compartment 4:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Pathways:
*Pathway 1
*filter efficiency model
  1
  2
0 1000000 100 0 0
720 1000000 100 0 0
*Pathway 2
*filter efficiency model
  1
  3
0 660 0 0 0
0.3333 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
  1
  3
0 0 0 0 0
0.3333 100 0 0 0
720 100 0 0 0
*Pathway 5
*filter efficiency model
  1
  3
0 660 0 0 0
0.3333 1513.6 0 0 0
720 1513.6 0 0 0
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
*Pathway 6
*filter efficiency model
  1
  2
0 1000000 100 94 94
720 1000000 100 94 94
*x/q tables
  6
EAB
  2
0 0.000539
720 0.000539
LPZ
  6
0 6.66e-05
  2 3.03e-05
  8 2.04e-05
 24 8.67e-06
 96 2.54e-06
720 2.54e-06
Equip Hatch-Normal
  6
0 0.0125
  2 0.00983
  8 0.00362
 24 0.00286
 96 0.00228
720 0.00228
Equip Hatch-Emergency
  6
0 0.000732
  2 0.000613
  8 0.000245
 24 0.000175
 96 0.000129
720 0.000129
Stack-Normal
  6
0 0.0061
  2 0.00432
  8 0.00173
 24 0.00127
 96 0.000979
720 0.000979
Stack-Emergency
  6
0 0.000832
  2 0.000769
  8 0.000283
 24 0.000215
 96 0.000157
720 0.000157
*dose locations
  3
*location name, compartment number and x/q table
EAB
  2
  1
*br model
  1
  4
0 0.00035
  8 0.00018
 24 0.00023
720 0.00023
*of model
  0
*location x/q input to be included
  0
*location name, compartment number and x/q table
LPZ
  2
  2
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```

*br model
  1
  4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
  0
*location x/q input to be included
  0
*location name, compartment number and x/q table
Control Room
  3
  0
*br model
  1
  2
0 0.00035
720 0.00035
*of model
  1
  4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
  1
*number of intake combinations
  6
*intake combinations
2 1 3
3 1 4
4 1 3
2 6 5
3 6 6
4 6 5
*time step count
  3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
  1
  1
  1
  0
  1

#####
RADTRAD-NAI Version 1.1a(QA) run on May 20, 2005 at 07:09:52
#####

#####
Plant Description
#####

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth
Plant Power Level = 2.7030E+03 MWth

Number of compartments = 4

Compartment information

Compartment number 1 (Source term fraction = 1.0000E+00)
Name: Fuel Pool-Unfiltered
Compartment volume = 1.0000E+04 (Cubic feet)
Removal devices within compartment:
  Suppression pool
Pathways into and out of compartment 1

```


Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Pathway to compartment number 2: Fuel Pool Release-Unfiltered

Compartment number 2
Name: Environment

Pathways into and out of compartment 2

- Pathway to compartment number 3: Control Room Unfiltered Makeup
Pathway to compartment number 3: Control Room Filtered Makeup
Pathway to compartment number 3: Control Room Unfiltered Inleakage
Pathway from compartment number 1: Fuel Pool Release-Unfiltered
Pathway from compartment number 3: Control Room Exhaust
Pathway from compartment number 4: Fuel Pool Release-Filtered

Compartment number 3
Name: Control Room

Compartment volume = 3.5923E+04 (Cubic feet)

Removal devices within compartment:

Filter(s)

Pathways into and out of compartment 3

- Pathway to compartment number 2: Control Room Exhaust
Pathway from compartment number 2: Control Room Unfiltered Makeup
Pathway from compartment number 2: Control Room Filtered Makeup
Pathway from compartment number 2: Control Room Unfiltered Inleakage

Compartment number 4
Name: Fuel Pool-Filtered

Compartment volume = 1.0000E+04 (Cubic feet)

Removal devices within compartment:

Suppression pool

Pathways into and out of compartment 4

- Pathway to compartment number 2: Fuel Pool Release-Filtered

Total number of pathways = 6

#####
RADTRAD-NAI Version 1.1a(QA) run on May 20, 2005 at 07:09:52
#####
#####
Scenario Description
#####

Radioactive Decay is enabled
Calculation of Daughters is enabled

Iodine fractions
Aerosol = 0.0000E+00
Elemental = 9.9850E-01
Organic = 1.5000E-03

Overlying pool characteristics

Table with 2 columns: Time (hr), DF. Rows: 0.0000E+00, 7.2000E+02. Values: 2.5200E+02, 2.5200E+02.

Table with 2 columns: Time (hr), DF. Rows: 0.0000E+00, 7.2000E+02. Values: 1.0000E+00, 1.0000E+00.

COMPARTMENT DATA

Compartment number 1: Fuel Pool-Unfiltered

Compartment number 2: Environment

Compartment number 3: Control Room

Compartment Filter Data

Time (hr) Flow Rate Filter Efficiencies (%)

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	(cfm)	Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Compartment number 4: Fuel Pool-Filtered

PATHWAY DATA

Pathway number 1: Fuel Pool Release-Unfiltered

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	1.0000E+06	1.0000E+02	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+06	1.0000E+02	0.0000E+00	0.0000E+00

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.0000E+02	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+02	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.5136E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.5136E+03	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 6: Fuel Pool Release-Filtered

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	1.0000E+06	1.0000E+02	9.4000E+01	9.4000E+01
7.2000E+02	1.0000E+06	1.0000E+02	9.4000E+01	9.4000E+01

X/Q DATA

X/Q table 1: EAB

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	5.3900E-04
7.2000E+02	5.3900E-04

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

X/Q table 2: LPZ

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

X/Q table 3: Equip Hatch-Normal

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	1.2500E-02
2.0000E+00	9.8300E-03
8.0000E+00	3.6200E-03
2.4000E+01	2.8600E-03
9.6000E+01	2.2800E-03
7.2000E+02	2.2800E-03

X/Q table 4: Equip Hatch-Emergency

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	7.3200E-04
2.0000E+00	6.1300E-04
8.0000E+00	2.4500E-04
2.4000E+01	1.7500E-04
9.6000E+01	1.2900E-04
7.2000E+02	1.2900E-04

X/Q table 5: Stack-Normal

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	6.1000E-03
2.0000E+00	4.3200E-03
8.0000E+00	1.7300E-03
2.4000E+01	1.2700E-03
9.6000E+01	9.7900E-04
7.2000E+02	9.7900E-04

X/Q table 6: Stack-Emergency

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	8.3200E-04
2.0000E+00	7.6900E-04
8.0000E+00	2.8300E-04
2.4000E+01	2.1500E-04
9.6000E+01	1.5700E-04
7.2000E+02	1.5700E-04

LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location Control Room is in compartment 3

Inleakage X/Q Table Assignments

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Inleakage Path	Source Path	X/Q Table
2	1	3
3	1	4
4	1	3
2	6	5
3	6	6
4	6	5

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
7.2000E+02	3.5000E-04

Location Occupancy Factor Data

Time (hr)	Occupancy Factor
0.0000E+00	1.0000E+00
2.4000E+01	6.0000E-01
9.6000E+01	4.0000E-01
7.2000E+02	4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time	Time step
0.0000E+00	1.0000E-06
1.0000E-03	2.0000E-02
7.2000E+02	2.0000E-02

 RADTRAD-NAI Version 1.1a(QA) run on May 20, 2005 at 07:09:52
 #####

```

#####
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
#####

```


 Dose, Detailed Model and Detailed Inventory Output
 #####

Detailed model information at time (H) = 0.0010

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.0010	0.0000E+00	0.0000E+00	0.0000E+00
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

		Deposition Recirculating	
		Surfaces	Filter
Time (h) =	0.0010		
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Fuel Pool Release-Unfiltered Transport Group Inventory:

		Pathway
		Filter
Time (h) =	0.0010	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Environment Transport Group Inventory:

		Present	Release	Integral
		Release	Rate/s	Release
Time (h) =	0.0010			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

		Pathway
		Filter
Time (h) =	0.0010	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Makeup Transport Group Inventory:

		Pathway
		Filter
Time (h) =	0.0010	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Filtered Makeup Transport Group Inventory:

		Pathway
		Filter
Time (h) =	0.0010	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Inleakage Transport Group Inventory:

		Pathway
		Filter
Time (h) =	0.0010	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Exhaust Transport Group Inventory:

		Pathway
		Filter
Time (h) =	0.0010	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0010			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0010		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0010			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0010		
Noble gases (atoms)	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.0020

EAB Doses:

Time (h) = 0.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

LPZ Doses:

Time (h) = 0.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Control Room Doses:

Time (h) = 0.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 0.0020	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 0.0020	Deposition Recirculating	
	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

Time (h) = 0.0020	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

			Overlying
Time (h) = 0.0020	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

		Deposition	Recirculating
Time (h) = 0.0020	Surfaces	Filter	
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Transport Group Inventory:

			Overlying
Time (h) = 0.0020	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

		Deposition	Recirculating
Time (h) = 0.0020	Surfaces	Filter	
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3333

EAB Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	6.0452E-02	9.9401E+00	1.7438E-01	3.6519E-01
Accumulated dose (rem)	6.0452E-02	9.9401E+00	1.7438E-01	3.6519E-01

LPZ Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.4696E-03	1.2282E+00	2.1547E-02	4.5124E-02
Accumulated dose (rem)	7.4696E-03	1.2282E+00	2.1547E-02	4.5124E-02

Control Room Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	6.6813E-03	3.7491E+01	6.5477E-01	1.1559E+00
Accumulated dose (rem)	6.6813E-03	3.7491E+01	6.5477E-01	1.1559E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	8.7666E-02	2.2345E-07	1.5831E+18	3.2437E+09
Kr-85m	4.6458E-04	5.6453E-14	3.9996E+11	1.7189E+07
Kr-88	1.6525E-05	1.3178E-15	9.0184E+09	6.1141E+05
Rb-86	1.8181E-02	2.2344E-10	1.5646E+15	6.7268E+08
I-131	2.3370E-02	1.8850E-10	8.6657E+14	8.6468E+08
I-132	1.5963E-02	1.5465E-12	7.0553E+12	5.9063E+08
I-133	6.7952E-03	5.9986E-12	2.7161E+13	2.5142E+08
I-135	1.9668E-04	5.6005E-14	2.4983E+11	7.2772E+06
Xe-133	5.5757E+00	2.9788E-08	1.3488E+17	2.0630E+11
Xe-135	3.9514E-01	1.5473E-10	6.9024E+14	1.4620E+10
Cs-134	2.0340E+00	1.5721E-06	7.0650E+18	7.5257E+10
Cs-136	5.2801E-01	7.2043E-09	3.1901E+16	1.9536E+10
Cs-137	1.1000E+00	1.2646E-05	5.5590E+19	4.0700E+10
I-130	5.6873E-05	2.9161E-14	1.3508E+11	2.1043E+06
Kr-83m	4.7428E-06	2.2988E-16	1.6679E+09	1.7549E+05
Xe-131m	3.7523E-02	4.4797E-10	2.0594E+15	1.3883E+09
Xe-133m	1.5385E-01	3.4287E-10	1.5525E+15	5.6923E+09
Xe-135m	4.0250E-01	4.4186E-12	1.9711E+13	1.4893E+10
Cs-134m	4.7298E-06	5.8651E-16	2.6358E+09	1.7500E+05
Rb-88	4.4076E-05	3.6718E-16	2.5128E+09	1.6308E+06
Ba-137m	2.2554E-01	4.1938E-13	1.8435E+12	8.3451E+09
Br-82	4.6579E-05	4.3024E-14	3.1597E+11	1.7234E+06
Br-83	1.8251E-09	1.1553E-19	8.3824E+05	6.7530E+01

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	1.7223E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	6.5393E+14	0.0000E+00	3.2614E+20
Organic I (atoms)	2.4756E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	1.4226E-05	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	3.5158E+01	4.3209E-07	3.0257E+18	1.3008E+12
Cs-134	3.9333E+03	3.0400E-03	1.3662E+22	1.4553E+14
Cs-136	1.0211E+03	1.3932E-05	6.1690E+19	3.7780E+13
Cs-137	2.1272E+03	2.4455E-02	1.0750E+23	7.8706E+13
Cs-134m	9.1465E-03	1.1342E-12	5.0972E+12	3.3842E+08
Rb-88	6.0711E-02	5.0576E-13	3.4611E+12	2.2463E+09
Ba-137m	2.0057E+03	3.7294E-09	1.6393E+16	7.4210E+13

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	2.7510E-02

Environment Integral Nuclide Release:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	1.7361E+02	4.4250E-04	3.1350E+21	6.4235E+12
Kr-85m	9.2002E-01	1.1179E-10	7.9205E+14	3.4041E+10
Kr-87	1.1332E-08	4.0007E-19	2.7693E+06	4.1930E+02
Kr-88	3.2724E-02	2.6097E-12	1.7859E+13	1.2108E+09
I-131	4.6279E+01	3.7329E-07	1.7160E+18	1.7123E+12
I-132	3.0154E+01	2.9213E-09	1.3328E+16	1.1157E+12
I-133	1.3457E+01	1.1879E-08	5.3787E+16	4.9790E+11
I-135	3.8949E-01	1.1091E-10	4.9474E+14	1.4411E+10

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Xe-133	1.0695E+04	5.7139E-05	2.5872E+20	3.9573E+14
Xe-135	6.6148E+02	2.5902E-07	1.1555E+18	2.4475E+13
I-130	1.1263E-01	5.7747E-11	2.6751E+14	4.1672E+09
Kr-83m	2.7898E-03	1.3522E-13	9.8108E+11	1.0322E+08
Xe-131m	6.8306E+01	8.1548E-07	3.7488E+18	2.5273E+12
Xe-133m	2.7986E+02	6.2371E-07	2.8241E+18	1.0355E+13
Xe-135m	1.1204E+01	1.2299E-10	5.4866E+14	4.1454E+11
Rb-88	1.0961E-02	9.1312E-14	6.2488E+11	4.0556E+08
Br-82	9.2241E-02	8.5200E-11	6.2572E+14	3.4129E+09
Br-83	3.6143E-06	2.2879E-16	1.6600E+09	1.3373E+05

Environment Transport Group Inventory:

Time (h) = 0.3333	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	1.3670E+20	1.8986E+18	3.4015E+21
Elemental I (atoms)	5.2041E+16	7.2280E+14	1.2945E+18
Organic I (atoms)	1.9701E+16	2.7363E+14	4.9005E+17
Aerosols (kg)	3.4477E-16	4.7885E-18	9.1312E-14

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Rb-86	3.5158E+01	4.3209E-07	3.0257E+18	1.3008E+12
Cs-134	3.9333E+03	3.0400E-03	1.3662E+22	1.4553E+14
Cs-136	1.0211E+03	1.3932E-05	6.1690E+19	3.7780E+13
Cs-137	2.1272E+03	2.4455E-02	1.0750E+23	7.8706E+13
Cs-134m	9.1465E-03	1.1342E-12	5.0972E+12	3.3842E+08
Rb-88	6.0711E-02	5.0576E-13	3.4611E+12	2.2463E+09
Ba-137m	2.0057E+03	3.7294E-09	1.6393E+16	7.4210E+13

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	2.7510E-02

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Kr-85	5.6817E-01	1.4482E-06	1.0260E+19	2.1022E+10
Kr-85m	3.0110E-03	3.6587E-13	2.5922E+12	1.1141E+08
Kr-88	1.0710E-04	8.5409E-15	5.8448E+10	3.9626E+06
I-131	1.5146E-01	1.2217E-09	5.6161E+15	5.6039E+09
I-132	9.8977E-02	9.5888E-12	4.3746E+13	3.6622E+09
I-133	4.4040E-02	3.8877E-11	1.7603E+14	1.6295E+09
I-135	1.2747E-03	3.6297E-13	1.6191E+12	4.7164E+07
Xe-133	3.5004E+01	1.8700E-07	8.4674E+17	1.2951E+12
Xe-135	2.1651E+00	8.4784E-10	3.7821E+15	8.0110E+10
I-130	3.6860E-04	1.8899E-13	8.7548E+11	1.3638E+07
Kr-83m	9.1462E-06	4.4330E-16	3.2164E+09	3.3841E+05
Xe-131m	2.2356E-01	2.6690E-09	1.2270E+16	8.2718E+09
Xe-133m	9.1598E-01	2.0414E-09	9.2432E+15	3.3891E+10
Xe-135m	3.8219E-02	4.1956E-13	1.8716E+12	1.4141E+09
Rb-88	3.4056E-05	2.8371E-16	1.9415E+09	1.2601E+06
Br-82	3.0188E-04	2.7884E-13	2.0478E+12	1.1170E+07
Br-83	1.1829E-08	7.4876E-19	5.4327E+06	4.3766E+02

Control Room Transport Group Inventory:

Time (h) = 0.3333	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.1132E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.2366E+15	0.0000E+00	0.0000E+00
Organic I (atoms)	1.6038E+15	0.0000E+00	0.0000E+00
Aerosols (kg)	2.8371E-16	0.0000E+00	0.0000E+00

Time (h) = 0.3333	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Transport Group Inventory:

			Overlying
Time (h) = 0.3333	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Recirculating	
Time (h) = 0.3333	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 2.0000

EAB Doses:

Time (h) = 2.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.0468E-01	4.9928E+01	8.7324E-01	1.8352E+00
Accumulated dose (rem)	3.6513E-01	5.9868E+01	1.0476E+00	2.2004E+00

LPZ Doses:

Time (h) = 2.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.7647E-02	6.1693E+00	1.0790E-01	2.2676E-01
Accumulated dose (rem)	4.5116E-02	7.3975E+00	1.2945E-01	2.7189E-01

Control Room Doses:

Time (h) = 2.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.0321E-02	7.8949E+01	3.1244E+00	2.4499E+00
Accumulated dose (rem)	3.7002E-02	1.1644E+02	3.7792E+00	3.6058E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	8.7665E-02	2.2345E-07	1.5831E+18	3.2436E+09
Kr-85m	3.5898E-04	4.3621E-14	3.0905E+11	1.3282E+07
Kr-88	1.1002E-05	8.7740E-16	6.0043E+09	4.0707E+05
Rb-86	1.8134E-02	2.2286E-10	1.5606E+15	6.7095E+08
I-131	2.3235E-02	1.8742E-10	8.6157E+14	8.5970E+08
I-132	1.5714E-02	1.5224E-12	6.9454E+12	5.8143E+08
I-133	6.4281E-03	5.6745E-12	2.5694E+13	2.3784E+08
I-135	1.6514E-04	4.7024E-14	2.0977E+11	6.1102E+06
Xe-133	6.8643E+00	3.6672E-08	1.6605E+17	2.5398E+11
Xe-135	7.6366E-01	2.9904E-10	1.3340E+15	2.8255E+10
Cs-134	2.0338E+00	1.5720E-06	7.0646E+18	7.5252E+10
Cs-136	5.2608E-01	7.1779E-09	3.1784E+16	1.9465E+10
Cs-137	1.1000E+00	1.2646E-05	5.5589E+19	4.0700E+10

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-130	5.1798E-05	2.6558E-14	1.2303E+11	1.9165E+06
Kr-83m	1.9535E-05	9.4682E-16	6.8697E+09	7.2279E+05
Xe-131m	6.1866E-02	7.3860E-10	3.3954E+15	2.2890E+09
Xe-133m	2.4646E-01	5.4927E-10	2.4870E+15	9.1190E+09
Xe-135m	3.0276E+00	3.3237E-11	1.4826E+14	1.1202E+11
Cs-134m	3.1757E-06	3.9379E-16	1.7697E+09	1.1750E+05
Rb-88	2.9447E-05	2.4531E-16	1.6787E+09	1.0895E+06
Ba-137m	3.3916E-01	6.3065E-13	2.7721E+12	1.2549E+10
Br-82	4.5079E-05	4.1638E-14	3.0579E+11	1.6679E+06
Br-83	1.1255E-09	7.1247E-20	5.1694E+05	4.1645E+01

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 2.0000	Overlying		
	Atmosphere	Sump	Pool
Noble gases (atoms)	1.7565E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	6.4912E+14	0.0000E+00	1.9493E+21
Organic I (atoms)	2.4573E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	1.4226E-05	0.0000E+00	0.0000E+00

Time (h) = 2.0000	Deposition		Recirculating
	Surfaces	Filter	
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	2.1641E+02	2.6596E-06	1.8624E+19	8.0071E+12
Cs-134	2.4272E+04	1.8760E-02	8.4309E+22	8.9806E+14
Cs-136	6.2782E+03	8.5661E-05	3.7931E+20	2.3229E+14
Cs-137	1.3127E+04	1.5092E-01	6.6340E+23	4.8571E+14
Cs-134m	3.7898E-02	4.6995E-12	2.1120E+13	1.4022E+09
Rb-88	8.2296E-02	6.8558E-13	4.6916E+12	3.0449E+09
Ba-137m	1.4225E+04	2.6450E-08	1.1627E+17	5.2633E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 2.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.6977E-01

Environment Integral Nuclide Release:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	1.0506E+03	2.6779E-03	1.8972E+22	3.8873E+13
Kr-85m	4.3021E+00	5.2277E-10	3.7037E+15	1.5918E+11
Kr-88	1.3185E-01	1.0515E-11	7.1958E+13	4.8785E+09
I-131	2.7823E+02	2.2442E-06	1.0317E+19	1.0294E+13
I-132	1.4286E+02	1.3840E-08	6.3140E+16	5.2857E+12
I-133	7.6982E+01	6.7956E-08	3.0770E+17	2.8483E+12
I-135	1.9777E+00	5.6315E-10	2.5121E+15	7.3175E+10
Xe-133	6.4278E+04	3.4340E-04	1.5549E+21	2.3783E+15
Xe-135	3.5727E+03	1.3990E-06	6.2407E+18	1.3219E+14
I-130	6.2032E-01	3.1806E-10	1.4734E+15	2.2952E+10
Kr-83m	1.0427E-02	5.0537E-13	3.6667E+12	3.8579E+08
Xe-131m	4.1398E+02	4.9424E-06	2.2721E+19	1.5317E+13
Xe-133m	1.6659E+03	3.7127E-06	1.6811E+19	6.1639E+13
Xe-135m	5.6577E+01	6.2109E-10	2.7706E+15	2.0933E+12
Rb-88	1.1594E-01	9.6586E-13	6.6097E+12	4.2898E+09
Br-82	5.3986E-01	4.9865E-10	3.6621E+15	1.9975E+10
Br-83	1.3479E-05	8.5325E-16	6.1908E+09	4.9874E+05

Environment Transport Group Inventory:

Time (h) = 2.0000	Present	Release	Integral
	Release	Rate/s	Release
Noble gases (atoms)	2.0604E+20	2.8617E+18	2.0573E+22

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms)	7.7834E+16	1.0810E+15	7.7582E+18
Organic I (atoms)	2.9465E+16	4.0924E+14	2.9370E+18
Aerosols (kg)	5.1926E-16	7.2120E-18	9.6586E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Rb-86		2.1641E+02	2.6596E-06	1.8624E+19	8.0071E+12
Cs-134		2.4272E+04	1.8760E-02	8.4309E+22	8.9806E+14
Cs-136		6.2782E+03	8.5661E-05	3.7931E+20	2.3229E+14
Cs-137		1.3127E+04	1.5092E-01	6.6340E+23	4.8571E+14
Cs-134m		3.7898E-02	4.6995E-12	2.1120E+13	1.4022E+09
Rb-88		8.2296E-02	6.8558E-13	4.6916E+12	3.0449E+09
Ba-137m		1.4225E+04	2.6450E-08	1.1627E+17	5.2633E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		1.6977E-01

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	2.0000	Ci	kg	Atoms	Bq
I-131		1.1232E-01	9.0603E-10	4.1651E+15	4.1560E+09
I-132		6.0106E-02	5.8230E-12	2.6566E+13	2.2239E+09
I-133		3.1078E-02	2.7435E-11	1.2422E+14	1.1499E+09
I-135		7.9842E-04	2.2735E-13	1.0142E+12	2.9542E+07
I-130		2.5043E-04	1.2840E-13	5.9482E+11	9.2659E+06
Br-82		2.1795E-04	2.0131E-13	1.4784E+12	8.0640E+06
Br-83		5.4418E-09	3.4446E-19	2.4993E+06	2.0135E+02

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		3.1329E+15
Organic I (atoms)		1.1860E+15
Aerosols (kg)		0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	2.2943E-01	5.8479E-07	4.1432E+18	8.4891E+09
Kr-85m	9.3951E-04	1.1416E-13	8.0883E+11	3.4762E+07
Kr-88	2.8794E-05	2.2963E-15	1.5714E+10	1.0654E+06
I-131	1.7083E-02	1.3779E-10	6.3345E+14	6.3207E+08
I-132	1.0919E-02	1.0578E-12	4.8259E+12	4.0399E+08
I-133	4.7262E-03	4.1721E-12	1.8891E+13	1.7487E+08
I-135	1.2142E-04	3.4574E-14	1.5423E+11	4.4925E+06
Xe-133	1.4055E+01	7.5090E-08	3.4000E+17	5.2005E+11
Xe-135	7.8640E-01	3.0794E-10	1.3737E+15	2.9097E+10
I-130	3.8084E-05	1.9527E-14	9.0456E+10	1.4091E+06
Kr-83m	2.4994E-06	1.2114E-16	8.7896E+08	9.2479E+04
Xe-131m	9.0739E-02	1.0833E-09	4.9800E+15	3.3574E+09
Xe-133m	3.6512E-01	8.1373E-10	3.6845E+15	1.3510E+10
Xe-135m	3.3258E-02	3.6511E-13	1.6287E+12	1.2306E+09
Rb-88	1.0505E-05	8.7513E-17	5.9888E+08	3.8868E+05
Br-82	3.3144E-05	3.0614E-14	2.2483E+11	1.2263E+06
Br-83	8.2755E-10	5.2384E-20	3.8008E+05	3.0619E+01

Control Room Transport Group Inventory:

Time (h) = 2.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	4.4932E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.7704E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	1.8059E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	8.7513E-17	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 2.0000	Ci	kg	Atoms	Bq
I-131	1.3056E-01	1.0531E-09	4.8412E+15	4.8307E+09
I-132	5.9175E-02	5.7328E-12	2.6154E+13	2.1895E+09
I-133	3.6126E-02	3.1891E-11	1.4440E+14	1.3367E+09
I-135	9.2811E-04	2.6428E-13	1.1789E+12	3.4340E+07
I-130	2.9111E-04	1.4926E-13	6.9144E+11	1.0771E+07
Rb-88	1.2034E-05	1.0025E-16	6.8608E+08	4.4527E+05
Br-82	2.5335E-04	2.3401E-13	1.7186E+12	9.3739E+06
Br-83	6.3257E-09	4.0042E-19	2.9053E+06	2.3405E+02

Deposition Recirculating

Time (h) = 2.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	3.6381E+15
Organic I (atoms)	0.0000E+00	1.3773E+15
Aerosols (kg)	0.0000E+00	1.0025E-16

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 2.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
I-131	1.1232E-01	9.0603E-10	4.1651E+15	4.1560E+09
I-132	6.0106E-02	5.8230E-12	2.6566E+13	2.2239E+09
I-133	3.1078E-02	2.7435E-11	1.2422E+14	1.1499E+09
I-135	7.9842E-04	2.2735E-13	1.0142E+12	2.9542E+07
I-130	2.5043E-04	1.2840E-13	5.9482E+11	9.2659E+06

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Br-82	2.1795E-04	2.0131E-13	1.4784E+12	8.0640E+06
Br-83	5.4418E-09	3.4446E-19	2.4993E+06	2.0135E+02

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.1329E+15
Organic I (atoms)	1.1860E+15
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
I-131	2.4289E-01	1.9592E-09	9.0063E+15	8.9868E+09
I-132	1.1928E-01	1.1556E-11	5.2720E+13	4.4134E+09
I-133	6.7205E-02	5.9326E-11	2.6862E+14	2.4866E+09
I-135	1.7265E-03	4.9163E-13	2.1931E+12	6.3881E+07
I-130	5.4154E-04	2.7766E-13	1.2863E+12	2.0037E+07
Rb-88	1.2034E-05	1.0025E-16	6.8608E+08	4.4527E+05
Br-82	4.7130E-04	4.3532E-13	3.1970E+12	1.7438E+07
Br-83	1.1767E-08	7.4488E-19	5.4045E+06	4.3540E+02

Fuel Pool-Filtered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 2.0020

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.8929E-04	5.9663E-02	1.2420E-03	2.3181E-03

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Accumulated dose (rem) 3.6562E-01 5.9928E+01 1.0489E+00 2.2027E+00

LPZ Doses:

Time (h) =	2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.7506E-05	3.3540E-03	6.9819E-05	1.3031E-04	
Accumulated dose (rem)	4.5144E-02	7.4008E+00	1.2952E-01	2.7202E-01	

Control Room Doses:

Time (h) =	2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.6486E-05	4.7969E-02	2.7549E-03	1.4965E-03	
Accumulated dose (rem)	3.7029E-02	1.1649E+02	3.7819E+00	3.6073E+00	

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	2.0020	Ci	kg	Atoms	Bq
Kr-85		8.7665E-02	2.2345E-07	1.5831E+18	3.2436E+09
Kr-85m		3.5887E-04	4.3607E-14	3.0895E+11	1.3278E+07
Kr-88		1.0996E-05	8.7697E-16	6.0014E+09	4.0687E+05
Rb-86		1.8134E-02	2.2286E-10	1.5606E+15	6.7095E+08
I-131		2.3235E-02	1.8742E-10	8.6157E+14	8.5970E+08
I-132		1.5797E-02	1.5304E-12	6.9820E+12	5.8449E+08
I-133		6.4277E-03	5.6741E-12	2.5692E+13	2.3782E+08
I-135		1.6511E-04	4.7014E-14	2.0972E+11	6.1089E+06
Xe-133		5.5137E+00	2.9456E-08	1.3338E+17	2.0401E+11
Xe-135		3.4466E-01	1.3496E-10	6.0204E+14	1.2752E+10
Cs-134		2.0338E+00	1.5720E-06	7.0646E+18	7.5252E+08
Cs-136		5.2607E-01	7.1779E-09	3.1784E+16	1.9465E+10
Cs-137		1.1000E+00	1.2646E-05	5.5589E+19	4.0700E+10
I-130		5.1792E-05	2.6555E-14	1.2302E+11	1.9163E+06
Kr-83m		2.7334E-06	1.3249E-16	9.6126E+08	1.0114E+05
Xe-131m		3.7281E-02	4.4508E-10	2.0461E+15	1.3794E+09
Xe-133m		1.4977E-01	3.3377E-10	1.5113E+15	5.5413E+09
Xe-135m		3.0721E-01	3.3725E-12	1.5044E+13	1.1367E+10
Cs-134m		3.1741E-06	3.9360E-16	1.7689E+09	1.1744E+05
Rb-88		3.0079E-05	2.5058E-16	1.7148E+09	1.1129E+06
Ba-137m		3.3918E-02	6.3068E-14	2.7723E+11	1.2550E+09
Br-82		4.5077E-05	4.1637E-14	3.0578E+11	1.6679E+06
Br-83		1.1249E-09	7.1206E-20	5.1664E+05	4.1621E+01

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	2.0020	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		1.7206E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)		6.4914E+14	0.0000E+00	1.9512E+21
Organic I (atoms)		2.4574E+14	0.0000E+00	0.0000E+00
Aerosols (kg)		1.4226E-05	0.0000E+00	0.0000E+00

Time (h) =	2.0020	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	2.0020	Ci	kg	Atoms	Bq
Rb-86		2.1663E+02	2.6623E-06	1.8643E+19	8.0151E+12
Cs-134		2.4296E+04	1.8779E-02	8.4394E+22	8.9896E+14
Cs-136		6.2845E+03	8.5747E-05	3.7969E+20	2.3253E+14
Cs-137		1.3141E+04	1.5107E-01	6.6407E+23	4.8620E+14
Cs-134m		3.7918E-02	4.7020E-12	2.1131E+13	1.4030E+09
Rb-88		8.2268E-02	6.8535E-13	4.6901E+12	3.0439E+09
Ba-137m		1.4176E+04	2.6359E-08	1.1587E+17	5.2451E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =	2.0020	Pathway
Noble gases (atoms)		Filter
		0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.6994E-01

Environment Integral Nuclide Release:

Time (h) =		Ci	kg	Atoms	Bq
2.0020					
Kr-85		1.0517E+03	2.6805E-03	1.8991E+22	3.8912E+13
Kr-85m		4.3051E+00	5.2313E-10	3.7063E+15	1.5929E+11
Kr-88		1.3192E-01	1.0520E-11	7.1995E+13	4.8810E+09
I-131		2.7850E+02	2.2464E-06	1.0327E+19	1.0305E+13
I-132		1.4296E+02	1.3850E-08	6.3186E+16	5.2895E+12
I-133		7.7054E+01	6.8020E-08	3.0799E+17	2.8510E+12
I-135		1.9793E+00	5.6360E-10	2.5141E+15	7.3233E+10
Xe-133		6.4343E+04	3.4375E-04	1.5565E+21	2.3807E+15
Xe-135		3.5762E+03	1.4004E-06	6.2469E+18	1.3232E+14
I-130		6.2087E-01	3.1834E-10	1.4747E+15	2.2972E+10
Kr-83m		1.0448E-02	5.0639E-13	3.6742E+12	3.8657E+08
Xe-131m		4.1442E+02	4.9477E-06	2.2745E+19	1.5334E+13
Xe-133m		1.6677E+03	3.7166E-06	1.6828E+19	6.1703E+13
Xe-135m		5.9335E+01	6.5137E-10	2.9056E+15	2.1954E+12
Rb-88		1.1602E-01	9.6649E-13	6.6140E+12	4.2926E+09
Br-82		5.4038E-01	4.9913E-10	3.6657E+15	1.9994E+10
Br-83		1.3485E-05	8.5360E-16	6.1934E+09	4.9895E+05

Environment Transport Group Inventory:

Time (h) =		Present Release	Release Rate/s	Integral Release
2.0020				
Noble gases (atoms)		2.0644E+19	2.8673E+17	2.0594E+22
Elemental I (atoms)		7.7852E+15	1.0813E+14	7.7659E+18
Organic I (atoms)		2.9472E+15	4.0934E+13	2.9399E+18
Aerosols (kg)		5.5776E-18	7.7467E-20	9.6649E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =		Ci	kg	Atoms	Bq
2.0020					
Rb-86		2.1663E+02	2.6623E-06	1.8643E+19	8.0151E+12
Cs-134		2.4296E+04	1.8779E-02	8.4394E+22	8.9896E+14
Cs-136		6.2845E+03	8.5747E-05	3.7969E+20	2.3253E+14
Cs-137		1.3141E+04	1.5107E-01	6.6407E+23	4.8620E+14
Cs-134m		3.7918E-02	4.7020E-12	2.1131E+13	1.4030E+09
Rb-88		8.2268E-02	6.8535E-13	4.6901E+12	3.0439E+09
Ba-137m		1.4176E+04	2.6359E-08	1.1587E+17	5.2451E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =		Pathway Filter
2.0020		
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		1.6994E-01

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =		Pathway Filter
2.0020		
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =		Ci	kg	Atoms	Bq
2.0020					
I-131		1.1244E-01	9.0693E-10	4.1692E+15	4.1602E+09
I-132		6.0147E-02	5.8269E-12	2.6584E+13	2.2254E+09
I-133		3.1107E-02	2.7460E-11	1.2434E+14	1.1510E+09
I-135		7.9905E-04	2.2753E-13	1.0150E+12	2.9565E+07
I-130		2.5065E-04	1.2852E-13	5.9535E+11	9.2742E+06
Br-82		2.1816E-04	2.0151E-13	1.4799E+12	8.0718E+06
Br-83		5.4441E-09	3.4461E-19	2.5003E+06	2.0143E+02

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.1360E+15
Organic I (atoms)	1.1872E+15
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Kr-85	2.2919E-01	5.8418E-07	4.1388E+18	8.4802E+09
Kr-85m	9.3823E-04	1.1401E-13	8.0773E+11	3.4714E+07
Kr-88	2.8749E-05	2.2928E-15	1.5690E+10	1.0637E+06
I-131	1.7047E-02	1.3751E-10	6.3212E+14	6.3075E+08
I-132	1.0895E-02	1.0555E-12	4.8153E+12	4.0310E+08
I-133	4.7160E-03	4.1631E-12	1.8850E+13	1.7449E+08
I-135	1.2114E-04	3.4495E-14	1.5388E+11	4.4822E+06
Xe-133	1.4042E+01	7.5017E-08	3.3967E+17	5.1955E+11
Xe-135	7.8584E-01	3.0772E-10	1.3727E+15	2.9076E+10
I-130	3.8000E-05	1.9484E-14	9.0258E+10	1.4060E+06
Kr-83m	2.5102E-06	1.2167E-16	8.8277E+08	9.2879E+04
Xe-131m	9.0666E-02	1.0824E-09	4.9760E+15	3.3546E+09
Xe-133m	3.6482E-01	8.1305E-10	3.6814E+15	1.3498E+10
Xe-135m	3.5576E-02	3.9055E-13	1.7422E+12	1.3163E+09
Rb-88	1.0489E-05	8.7381E-17	5.9798E+08	3.8810E+05
Br-82	3.3074E-05	3.0549E-14	2.2436E+11	1.2237E+06
Br-83	8.2535E-10	5.2244E-20	3.7906E+05	3.0538E+01

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0020			
Noble gases (atoms)	4.4885E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.7604E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	1.8021E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	8.7381E-17	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	1.3064E-01	1.0538E-09	4.8442E+15	4.8337E+09
I-132	5.9190E-02	5.7343E-12	2.6161E+13	2.1900E+09
I-133	3.6146E-02	3.1908E-11	1.4448E+14	1.3374E+09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-135	9.2848E-04	2.6438E-13	1.1794E+12	3.4354E+07
I-130	2.9125E-04	1.4933E-13	6.9178E+11	1.0776E+07
Rb-88	1.2027E-05	1.0019E-16	6.8565E+08	4.4500E+05
Br-82	2.5349E-04	2.3414E-13	1.7196E+12	9.3793E+06
Br-83	6.3259E-09	4.0043E-19	2.9053E+06	2.3406E+02

	Deposition Recirculating	
	Surfaces	Filter
Time (h) =	2.0020	
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	3.6403E+15
Organic I (atoms)	0.0000E+00	1.3781E+15
Aerosols (kg)	0.0000E+00	1.0019E-16

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
	Filter
Time (h) =	2.0020
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
2.0020				
I-131	1.1244E-01	9.0693E-10	4.1692E+15	4.1602E+09
I-132	6.0147E-02	5.8269E-12	2.6584E+13	2.2254E+09
I-133	3.1107E-02	2.7460E-11	1.2434E+14	1.1510E+09
I-135	7.9905E-04	2.2753E-13	1.0150E+12	2.9565E+07
I-130	2.5065E-04	1.2852E-13	5.9535E+11	9.2742E+06
Br-82	2.1816E-04	2.0151E-13	1.4799E+12	8.0718E+06
Br-83	5.4441E-09	3.4461E-19	2.5003E+06	2.0143E+02

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
	Filter
Time (h) =	2.0020
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.1360E+15
Organic I (atoms)	1.1872E+15
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
	Filter
Time (h) =	2.0020
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
	Filter
Time (h) =	2.0020
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0020				
I-131	2.4308E-01	1.9607E-09	9.0134E+15	8.9938E+09
I-132	1.1934E-01	1.1561E-11	5.2745E+13	4.4155E+09
I-133	6.7254E-02	5.9369E-11	2.6882E+14	2.4884E+09
I-135	1.7275E-03	4.9191E-13	2.1944E+12	6.3919E+07
I-130	5.4191E-04	2.7785E-13	1.2871E+12	2.0051E+07
Rb-88	1.2027E-05	1.0019E-16	6.8565E+08	4.4500E+05
Br-82	4.7165E-04	4.3565E-13	3.1994E+12	1.7451E+07
Br-83	1.1770E-08	7.4504E-19	5.4057E+06	4.3549E+02

Fuel Pool-Filtered Transport Group Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0020			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 2.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 8.0000

EAB Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.4638E-02	5.4379E-01	6.0799E-02	5.1306E-02
Accumulated dose (rem)	4.0026E-01	6.0472E+01	1.1097E+00	2.2540E+00

LPZ Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.9472E-03	3.0569E-02	3.4178E-03	2.8842E-03
Accumulated dose (rem)	4.7091E-02	7.4314E+00	1.3293E-01	2.7490E-01

Control Room Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	6.2923E-03	5.2643E+00	6.1707E-01	1.6759E-01
Accumulated dose (rem)	4.3321E-02	1.2175E+02	4.3990E+00	3.7749E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Xe-133	1.2412E+00	6.6308E-09	3.0024E+16	4.5923E+10
Xe-135	2.5063E-01	9.8145E-11	4.3781E+14	9.2735E+09
Kr-83m	3.3084E-06	1.6035E-16	1.1635E+09	1.2241E+05
Xe-131m	2.7008E-02	3.2244E-10	1.4823E+15	9.9928E+08
Xe-133m	8.8860E-02	1.9804E-10	8.9669E+14	3.2878E+09
Xe-135m	1.6274E+00	1.7866E-11	7.9696E+13	6.0215E+10

Fuel Pool-Unfiltered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 8.0000			
Noble gases (atoms)	3.2920E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.9080E+21
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 8.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 8.0000	Ci	kg	Atoms	Bq
-------------------	----	----	-------	----

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Rb-86	2.1764E+02	2.6748E-06	1.8730E+19	8.0528E+12
Cs-134	2.4632E+04	1.9038E-02	8.5561E+22	9.1140E+14
Cs-136	6.2891E+03	8.5810E-05	3.7997E+20	2.3270E+14
Cs-137	1.3325E+04	1.5319E-01	6.7340E+23	4.9303E+14
Cs-134m	9.1685E-03	1.1369E-12	5.1095E+12	3.3924E+08
Rb-88	7.1629E-08	5.9672E-19	4.0835E+06	2.6503E+03
Ba-137m	1.4771E+04	2.7466E-08	1.2073E+17	5.4654E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7232E-01

Environment Integral Nuclide Release:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Kr-85	1.0614E+03	2.7054E-03	1.9167E+22	3.9272E+13
Xe-133	6.3291E+04	3.3812E-04	1.5310E+21	2.3418E+15
Xe-135	2.3824E+03	9.3292E-07	4.1616E+18	8.8149E+13
Kr-83m	1.8585E-03	9.0080E-14	6.5359E+11	6.8766E+07
Xe-131m	4.2038E+02	5.0188E-06	2.3072E+19	1.5554E+13
Xe-133m	1.5834E+03	3.5289E-06	1.5979E+19	5.8587E+13
Xe-135m	3.0471E+01	3.3451E-10	1.4922E+15	1.1274E+12

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 8.0000	Release	Rate/s	Release
Noble gases (atoms)	3.2938E+16	4.5748E+14	2.0741E+22
Elemental I (atoms)	5.5581E+00	7.7196E-02	7.5947E+18
Organic I (atoms)	2.1041E+00	2.9224E-02	2.8751E+18
Aerosols (kg)	4.3715E-25	6.0716E-27	2.9327E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	2.1764E+02	2.6748E-06	1.8730E+19	8.0528E+12
Cs-134	2.4632E+04	1.9038E-02	8.5561E+22	9.1140E+14
Cs-136	6.2891E+03	8.5810E-05	3.7997E+20	2.3270E+14
Cs-137	1.3325E+04	1.5319E-01	6.7340E+23	4.9303E+14
Cs-134m	9.1685E-03	1.1369E-12	5.1095E+12	3.3924E+08
Rb-88	7.1629E-08	5.9672E-19	4.0835E+06	2.6503E+03
Ba-137m	1.4771E+04	2.7466E-08	1.2073E+17	5.4654E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7232E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 8.0000	Ci	kg	Atoms	Bq
I-131	1.1159E-01	9.0008E-10	4.1377E+15	4.1287E+09
I-132	1.0043E-02	9.7297E-13	4.4389E+12	3.7160E+08
I-133	2.5830E-02	2.2801E-11	1.0324E+14	9.5570E+08
I-135	4.3199E-04	1.2301E-13	5.4873E+11	1.5984E+07

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-130	1.8157E-04	9.3099E-14	4.3127E+11	6.7182E+06
Br-82	1.9664E-04	1.8163E-13	1.3339E+12	7.2759E+06
Br-83	9.6942E-10	6.1365E-20	4.4524E+05	3.5869E+01

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.0812E+15
Organic I (atoms)	1.1665E+15
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Kr-85	6.1757E-08	1.5741E-13	1.1152E+12	2.2850E+03
Xe-133	2.1270E-02	1.1363E-10	5.1453E+14	7.8700E+08
Xe-135	4.7194E-03	1.8480E-12	8.2438E+12	1.7462E+08
Kr-83m	5.4092E-08	2.6217E-18	1.9022E+07	2.0014E+03
Xe-131m	4.5771E-04	5.4645E-12	2.5120E+13	1.6935E+07
Xe-133m	1.5176E-03	3.3822E-12	1.5314E+13	5.6152E+07
Xe-135m	1.3200E-02	1.4491E-13	6.4640E+11	4.8839E+08

Control Room Transport Group Inventory:

			Overlying
Time (h) = 8.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	5.6497E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.0467E+02	0.0000E+00	0.0000E+00
Organic I (atoms)	3.9623E+01	0.0000E+00	0.0000E+00
Aerosols (kg)	8.2485E-24	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 8.0000	Ci	kg	Atoms	Bq
I-131	1.3643E-01	1.1005E-09	5.0590E+15	5.0480E+09
I-132	1.0633E-02	1.0301E-12	4.6995E+12	3.9341E+08
I-133	3.1583E-02	2.7880E-11	1.2624E+14	1.1686E+09
I-135	5.2822E-04	1.5041E-13	6.7095E+11	1.9544E+07
I-130	2.2202E-04	1.1384E-13	5.2733E+11	8.2147E+06
Br-82	2.4045E-04	2.2209E-13	1.6311E+12	8.8965E+06
Br-83	1.1854E-09	7.5033E-20	5.4441E+05	4.3858E+01

	Deposition Surfaces	Recirculating Filter
Time (h) = 8.0000		

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	3.7668E+15
Organic I (atoms)	0.0000E+00	1.4260E+15
Aerosols (kg)	0.0000E+00	5.9838E-22

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 8.0000	Ci	kg	Atoms	Bq
I-131	1.1159E-01	9.0008E-10	4.1377E+15	4.1287E+09
I-132	1.0043E-02	9.7297E-13	4.4389E+12	3.7160E+08
I-133	2.5830E-02	2.2801E-11	1.0324E+14	9.5570E+08
I-135	4.3199E-04	1.2301E-13	5.4873E+11	1.5984E+07
I-130	1.8157E-04	9.3099E-14	4.3127E+11	6.7182E+06
Br-82	1.9664E-04	1.8163E-13	1.3339E+12	7.2759E+06
Br-83	9.6942E-10	6.1365E-20	4.4524E+05	3.5869E+01

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.0812E+15
Organic I (atoms)	1.1665E+15
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
I-131	2.4802E-01	2.0006E-09	9.1967E+15	9.1767E+09
I-132	2.0676E-02	2.0031E-12	9.1384E+12	7.6501E+08
I-133	5.7413E-02	5.0682E-11	2.2948E+14	2.1243E+09
I-135	9.6021E-04	2.7342E-13	1.2197E+12	3.5528E+07
I-130	4.0359E-04	2.0693E-13	9.5861E+11	1.4933E+07
Br-82	4.3709E-04	4.0373E-13	2.9650E+12	1.6172E+07
Br-83	2.1548E-09	1.3640E-19	9.8964E+05	7.9727E+01

Fuel Pool-Filtered Transport Group Inventory:

			Overlying
Time (h) = 8.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Deposition Recirculating

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	8.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	8.0000	Pathway
Noble gases (atoms)	0.0000E+00	Filter
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Detailed model information at time (H) = 24.0000

EAB Doses:

Time (h) =	24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		3.0567E-02	2.1476E-16	5.2440E-02	3.0567E-02
Accumulated dose (rem)		4.3082E-01	6.0472E+01	1.1621E+00	2.2846E+00

LPZ Doses:

Time (h) =	24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.1569E-03	8.1283E-18	1.9847E-03	1.1569E-03
Accumulated dose (rem)		4.8248E-02	7.4314E+00	1.3492E-01	2.7606E-01

Control Room Doses:

Time (h) =	24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		4.7285E-04	1.0854E-12	3.0866E-02	4.7285E-04
Accumulated dose (rem)		4.3794E-02	1.2175E+02	4.4299E+00	3.7754E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	24.0000	Ci	kg	Atoms	Bq
Xe-133		7.2823E-01	3.8905E-09	1.7616E+16	2.6944E+10
Xe-135		4.6814E-02	1.8332E-11	8.1775E+13	1.7321E+09
Kr-83m		3.1942E-08	1.5482E-18	1.1233E+07	1.1818E+03
Xe-131m		2.5499E-02	3.0443E-10	1.3995E+15	9.4347E+08
Xe-133m		5.2137E-02	1.1619E-10	5.2611E+14	1.9291E+09
Xe-135m		3.0397E-01	3.3370E-12	1.4886E+13	1.1247E+10

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		1.9638E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	1.7826E+21
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	24.0000	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	24.0000	Ci	kg	Atoms	Bq
Rb-86		2.1232E+02	2.6094E-06	1.8272E+19	7.8558E+12
Cs-134		2.4617E+04	1.9027E-02	8.5508E+22	9.1084E+14
Cs-136		6.0712E+03	8.2836E-05	3.6680E+20	2.2463E+14
Cs-137		1.3325E+04	1.5319E-01	6.7337E+23	4.9301E+14
Cs-134m		2.0019E-04	2.4824E-14	1.1156E+11	7.4071E+06
Ba-137m		1.4771E+04	2.7465E-08	1.2073E+17	5.4651E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7230E-01

Environment Integral Nuclide Release:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	5.8814E+04	3.1421E-04	1.4227E+21	2.1761E+15
Xe-135	7.6014E+02	2.9766E-07	1.3278E+18	2.8125E+13
Kr-83m	1.8046E-05	8.7465E-16	6.3461E+09	6.6770E+05
Xe-131m	4.2507E+02	5.0748E-06	2.3329E+19	1.5728E+13
Xe-133m	1.3315E+03	2.9674E-06	1.3436E+19	4.9264E+13
Xe-135m	5.6929E+00	6.2496E-11	2.7879E+14	2.1064E+11

Environment Transport Group Inventory:

Time (h) = 24.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	1.9648E+16	2.7289E+14	2.0626E+22
Elemental I (atoms)	8.0586E-34	1.1193E-35	7.0957E+18
Organic I (atoms)	3.0507E-34	4.2371E-36	2.6862E+18
Aerosols (kg)	2.3822E-44	3.3086E-46	5.9065E-15

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	2.1232E+02	2.6094E-06	1.8272E+19	7.8558E+12
Cs-134	2.4617E+04	1.9027E-02	8.5508E+22	9.1084E+14
Cs-136	6.0712E+03	8.2836E-05	3.6680E+20	2.2463E+14
Cs-137	1.3325E+04	1.5319E-01	6.7337E+23	4.9301E+14
Cs-134m	2.0019E-04	2.4824E-14	1.1156E+11	7.4071E+06
Ba-137m	1.4771E+04	2.7465E-08	1.2073E+17	5.4651E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7230E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	1.0535E-01	8.4981E-10	3.9066E+15	3.8981E+09
I-132	8.0863E-05	7.8339E-15	3.5740E+10	2.9919E+06
I-133	1.5155E-02	1.3378E-11	6.0576E+13	5.6074E+08
I-135	8.0689E-05	2.2976E-14	1.0249E+11	2.9855E+06
I-130	7.4024E-05	3.7954E-14	1.7582E+11	2.7389E+06
Br-82	1.4363E-04	1.3266E-13	9.7430E+11	5.3142E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.8787E+15
Organic I (atoms)	1.0898E+15
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	4.8243E-03	2.5773E-11	1.1670E+14	1.7850E+08
Xe-135	3.4079E-04	1.3345E-13	5.9529E+11	1.2609E+07
Xe-131m	1.6707E-04	1.9946E-12	9.1694E+12	6.1817E+06
Xe-133m	3.4425E-04	7.6721E-13	3.4739E+12	1.2737E+07
Xe-135m	9.5372E-04	1.0470E-14	4.6704E+10	3.5287E+07

Control Room Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.2998E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.5175E-32	0.0000E+00	0.0000E+00
Organic I (atoms)	5.7449E-33	0.0000E+00	0.0000E+00
Aerosols (kg)	4.4982E-43	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	1.2881E-01	1.0390E-09	4.7764E+15	4.7661E+09
I-132	8.5610E-05	8.2938E-15	3.7838E+10	3.1676E+06
I-133	1.8531E-02	1.6358E-11	7.4069E+13	6.8564E+08
I-135	9.8661E-05	2.8094E-14	1.2532E+11	3.6505E+06
I-130	9.0512E-05	4.6408E-14	2.1498E+11	3.3489E+06
Br-82	1.7562E-04	1.6221E-13	1.1913E+12	6.4979E+06

Deposition Recirculating

Time (h) = 24.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	3.5197E+15
Organic I (atoms)	0.0000E+00	1.3324E+15
Aerosols (kg)	0.0000E+00	3.7269E-38

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	1.0535E-01	8.4981E-10	3.9066E+15	3.8981E+09
I-132	8.0863E-05	7.8339E-15	3.5740E+10	2.9919E+06
I-133	1.5155E-02	1.3378E-11	6.0576E+13	5.6074E+08
I-135	8.0689E-05	2.2976E-14	1.0249E+11	2.9855E+06
I-130	7.4024E-05	3.7954E-14	1.7582E+11	2.7389E+06
Br-82	1.4363E-04	1.3266E-13	9.7430E+11	5.3142E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.8787E+15
Organic I (atoms)	1.0898E+15
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	2.3417E-01	1.8888E-09	8.6830E+15	8.6642E+09
I-132	1.6647E-04	1.6128E-14	7.3578E+10	6.1595E+06
I-133	3.3686E-02	2.9736E-11	1.3464E+14	1.2464E+09
I-135	1.7935E-04	5.1070E-14	2.2781E+11	6.6360E+06
I-130	1.6454E-04	8.4363E-14	3.9080E+11	6.0878E+06
Br-82	3.1925E-04	2.9488E-13	2.1656E+12	1.1812E+07

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 24.0000	Deposition Recirculating	
	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 96.0000

EAB Doses:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	9.7779E-03	3.0348E-38	2.2081E-02	9.7779E-03
Accumulated dose (rem)	4.4060E-01	6.0472E+01	1.1842E+00	2.2944E+00

LPZ Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.5728E-04	4.8816E-40	3.5518E-04	1.5728E-04
Accumulated dose (rem)	4.8405E-02	7.4314E+00	1.3527E-01	2.7621E-01

Control Room Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.9745E-05	7.2023E-35	7.0624E-03	7.9745E-05
Accumulated dose (rem)	4.3874E-02	1.2175E+02	4.4369E+00	3.7755E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	6.6106E-02	3.5316E-10	1.5991E+15	2.4459E+09
Xe-135	2.4625E-05	9.6429E-15	4.3015E+10	9.1113E+05
Xe-131m	1.9688E-02	2.3505E-10	1.0805E+15	7.2845E+08
Xe-133m	4.7328E-03	1.0548E-11	4.7759E+13	1.7511E+08
Xe-135m	1.5990E-04	1.7553E-15	7.8302E+09	5.9162E+06

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	2.7274E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.3575E+21
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.8993E+02	2.3342E-06	1.6345E+19	7.0274E+12
Cs-134	2.4549E+04	1.8974E-02	8.5272E+22	9.0833E+14
Cs-136	5.1800E+03	7.0678E-05	3.1296E+20	1.9166E+14
Cs-137	1.3322E+04	1.5316E-01	6.7324E+23	4.9292E+14
Ba-137m	1.4768E+04	2.7460E-08	1.2070E+17	5.4641E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7221E-01

Environment Integral Nuclide Release:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	4.0614E+04	2.1698E-04	9.8246E+20	1.5027E+15
Xe-135	3.4893E+00	1.3663E-09	6.0951E+15	1.2910E+11
Xe-131m	4.3126E+02	5.1487E-06	2.3669E+19	1.5957E+13
Xe-133m	5.5327E+02	1.2330E-06	5.5831E+18	2.0471E+13
Xe-135m	2.9947E-03	3.2876E-14	1.4665E+11	1.1081E+08

Environment Transport Group Inventory:

Time (h) = 96.0000	Present Release	Release Rate/s	Integral Release

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Noble gases (atoms)	2.7284E+15	3.7894E+13	2.0166E+22
Elemental I (atoms)	0.0000E+00	0.0000E+00	5.4035E+18
Organic I (atoms)	0.0000E+00	0.0000E+00	2.0456E+18
Aerosols (kg)	0.0000E+00	0.0000E+00	1.3791E-22

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.8993E+02	2.3342E-06	1.6345E+19	7.0274E+12
Cs-134	2.4549E+04	1.8974E-02	8.5272E+22	9.0833E+14
Cs-136	5.1800E+03	7.0678E-05	3.1296E+20	1.9166E+14
Cs-137	1.3322E+04	1.5316E-01	6.7324E+23	4.9292E+14
Ba-137m	1.4768E+04	2.7460E-08	1.2070E+17	5.4641E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7221E-01

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	8.1344E-02	6.5614E-10	3.0163E+15	3.0097E+09
I-133	1.3757E-03	1.2144E-12	5.4989E+12	5.0902E+07
I-135	4.2444E-08	1.2086E-17	5.3914E+07	1.5704E+03
I-130	1.3056E-06	6.6940E-16	3.1010E+09	4.8306E+04
Br-82	3.4933E-05	3.2267E-14	2.3697E+11	1.2925E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.1922E+15
Organic I (atoms)	8.2988E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	3.3142E-04	1.7706E-12	8.0171E+12	1.2263E+07
Xe-135	1.3566E-07	5.3123E-17	2.3697E+08	5.0195E+03
Xe-131m	9.7624E-05	1.1655E-12	5.3579E+12	3.6121E+06
Xe-133m	2.3650E-05	5.2706E-14	2.3865E+11	8.7504E+05
Xe-135m	3.7977E-07	4.1690E-18	1.8597E+07	1.4051E+04

Control Room Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.3614E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	9.9457E-02	8.0223E-10	3.6879E+15	3.6799E+09
I-133	1.6822E-03	1.4849E-12	6.7237E+12	6.2240E+07
I-135	5.1898E-08	1.4778E-17	6.5922E+07	1.9202E+03
I-130	1.5964E-06	8.1851E-16	3.7917E+09	5.9066E+04
Br-82	4.2714E-05	3.9454E-14	2.8975E+11	1.5804E+06

Deposition Recirculating

Time (h) = 96.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.6803E+15
Organic I (atoms)	0.0000E+00	1.0147E+15
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	8.1344E-02	6.5614E-10	3.0163E+15	3.0097E+09
I-133	1.3757E-03	1.2144E-12	5.4989E+12	5.0902E+07
I-135	4.2444E-08	1.2086E-17	5.3914E+07	1.5704E+03
I-130	1.3056E-06	6.6940E-16	3.1010E+09	4.8306E+04
Br-82	3.4933E-05	3.2267E-14	2.3697E+11	1.2925E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.1922E+15
Organic I (atoms)	8.2988E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	1.8080E-01	1.4584E-09	6.7042E+15	6.6896E+09
I-133	3.0579E-03	2.6994E-12	1.2223E+13	1.1314E+08
I-135	9.4342E-08	2.6864E-17	1.1984E+08	3.4907E+03
I-130	2.9019E-06	1.4879E-15	6.8926E+09	1.0737E+05
Br-82	7.7648E-05	7.1721E-14	5.2672E+11	2.8730E+06

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 720.0000

EAB Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.2148E-04	6.3027-125	3.4903E-03	5.2148E-04
Accumulated dose (rem)	4.4112E-01	6.0472E+01	1.1877E+00	2.2949E+00

LPZ Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.4574E-06	2.9701-127	1.6448E-05	2.4574E-06
Accumulated dose (rem)	4.8407E-02	7.4314E+00	1.3529E-01	2.7622E-01

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.1231E-06	9.9719-122	7.0622E-04	3.1231E-06
Accumulated dose (rem)	4.3877E-02	1.2175E+02	4.4376E+00	3.7755E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	6.1566E-11	3.2891E-19	1.4893E+06	2.2779E+00
Xe-131m	2.0928E-03	2.4985E-11	1.1486E+14	7.7432E+07

Fuel Pool-Unfiltered Transport Group Inventory:

Overlying

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 720.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	1.1486E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.4402E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition Recirculating	
	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	7.2302E+01	8.8858E-07	6.2223E+18	2.6752E+12
Cs-134	2.3969E+04	1.8526E-02	8.3256E+22	8.8685E+14
Cs-136	1.3088E+03	1.7857E-05	7.9073E+19	4.8425E+13
Cs-137	1.3300E+04	1.5291E-01	6.7214E+23	4.9211E+14
Ba-137m	1.4744E+04	2.7414E-08	1.2051E+17	5.4551E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7145E-01

Environment Integral Nuclide Release:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	1.3242E+03	7.0744E-06	3.2032E+19	4.8995E+13
Xe-131m	1.9138E+02	2.2848E-06	1.0503E+19	7.0811E+12

Environment Transport Group Inventory:

Time (h) = 720.0000	Present	Release	Integral
	Release	Rate/s	Release
Noble gases (atoms)	1.1486E+14	1.5953E+12	1.9109E+22
Elemental I (atoms)	0.0000E+00	0.0000E+00	5.7328E+17
Organic I (atoms)	0.0000E+00	0.0000E+00	2.1703E+17
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	7.2302E+01	8.8858E-07	6.2223E+18	2.6752E+12
Cs-134	2.3969E+04	1.8526E-02	8.3256E+22	8.8685E+14
Cs-136	1.3088E+03	1.7857E-05	7.9073E+19	4.8425E+13
Cs-137	1.3300E+04	1.5291E-01	6.7214E+23	4.9211E+14
Ba-137m	1.4744E+04	2.7414E-08	1.2051E+17	5.4551E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7145E-01

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	8.6467E-03	6.9745E-11	3.2062E+14	3.1993E+08
Br-82	1.6669E-10	1.5397E-19	1.1308E+06	6.1676E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.3258E+14
Organic I (atoms)	8.8046E+13
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-131m	8.0321E-06	9.5893E-14	4.4082E+11	2.9719E+05

Control Room Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	4.4082E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	1.0572E-02	8.5275E-11	3.9201E+14	3.9116E+08
Br-82	2.0382E-10	1.8826E-19	1.3826E+06	7.5414E+00

Time (h) = 720.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.8436E+14
Organic I (atoms)	0.0000E+00	1.0765E+14
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	8.6467E-03	6.9745E-11	3.2062E+14	3.1993E+08
Br-82	1.6669E-10	1.5397E-19	1.1308E+06	6.1676E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.3258E+14
Organic I (atoms)	8.8046E+13
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	1.9219E-02	1.5502E-10	7.1264E+14	7.1109E+08
Br-82	3.7051E-10	3.4223E-19	2.5134E+06	1.3709E+01

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Transport Group Totals in Model:

Noble Gases (atoms)	1.9109E+22
---------------------	------------

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms) 1.4460E+20
 Organic I (atoms) 2.1722E+17
 Aerosols (kg) 1.7145E-01

37004

 I-131 Summary
 #####

Time (hr)	Fuel Pool-Unfiltered	Environment	Control Room
	I-131 (Curies)	I-131 (Curies)	I-131 (Curies)
0.000	0.0000E+00	0.0000E+00	0.0000E+00
0.001	0.0000E+00	0.0000E+00	0.0000E+00
0.002	0.0000E+00	0.0000E+00	0.0000E+00
0.280	2.3374E-02	3.8833E+01	1.3068E-01
0.333	2.3370E-02	4.6279E+01	1.5146E-01
0.600	2.3348E-02	8.3618E+01	5.3783E-02
0.860	2.3327E-02	1.1992E+02	2.7446E-02
1.120	2.3306E-02	1.5614E+02	2.0009E-02
1.380	2.3285E-02	1.9229E+02	1.7901E-02
1.640	2.3264E-02	2.2837E+02	1.7296E-02
1.900	2.3243E-02	2.6439E+02	1.7114E-02
2.000	2.3235E-02	2.7823E+02	1.7083E-02
2.002	2.3235E-02	2.7850E+02	1.7047E-02
2.280	0.0000E+00	2.8076E+02	4.7235E-03
2.540	0.0000E+00	2.8050E+02	1.3319E-03
2.800	0.0000E+00	2.8024E+02	3.7554E-04
3.060	0.0000E+00	2.7998E+02	1.0589E-04
3.320	0.0000E+00	2.7971E+02	2.9858E-05
3.580	0.0000E+00	2.7945E+02	8.4189E-06
3.840	0.0000E+00	2.7919E+02	2.3738E-06
4.100	0.0000E+00	2.7893E+02	6.6934E-07
4.360	0.0000E+00	2.7867E+02	1.8873E-07
4.620	0.0000E+00	2.7841E+02	5.3216E-08
4.880	0.0000E+00	2.7815E+02	1.5005E-08
5.140	0.0000E+00	2.7789E+02	4.2309E-09
5.400	0.0000E+00	2.7763E+02	1.1930E-09
5.660	0.0000E+00	2.7737E+02	3.3638E-10
5.920	0.0000E+00	2.7711E+02	9.4848E-11
6.180	0.0000E+00	2.7686E+02	2.6744E-11
6.440	0.0000E+00	2.7660E+02	7.5409E-12
6.700	0.0000E+00	2.7634E+02	2.1263E-12
6.960	0.0000E+00	2.7608E+02	5.9954E-13
7.220	0.0000E+00	2.7582E+02	1.6905E-13
7.480	0.0000E+00	2.7557E+02	4.7666E-14
7.740	0.0000E+00	2.7531E+02	1.3440E-14
8.000	0.0000E+00	2.7505E+02	3.7897E-15
8.260	0.0000E+00	2.7479E+02	1.0686E-15
8.520	0.0000E+00	2.7454E+02	3.0130E-16
8.780	0.0000E+00	2.7428E+02	8.4957E-17
9.040	0.0000E+00	2.7403E+02	2.3955E-17
9.300	0.0000E+00	2.7377E+02	6.7545E-18
9.560	0.0000E+00	2.7351E+02	1.9045E-18
9.820	0.0000E+00	2.7326E+02	5.3702E-19
10.080	0.0000E+00	2.7300E+02	1.5142E-19
24.000	0.0000E+00	2.5969E+02	5.5539E-49
96.000	0.0000E+00	2.0051E+02	3.1013-201
720.000	0.0000E+00	2.1313E+01	0.0000E+00

Time (hr)	Fuel Pool-Filtered
	I-131 (Curies)
0.000	0.0000E+00
0.001	0.0000E+00
0.002	0.0000E+00
0.280	0.0000E+00
0.333	0.0000E+00
0.600	0.0000E+00
0.860	0.0000E+00
1.120	0.0000E+00
1.380	0.0000E+00
1.640	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

1.900	0.0000E+00
2.000	0.0000E+00
2.002	0.0000E+00
2.280	0.0000E+00
2.540	0.0000E+00
2.800	0.0000E+00
3.060	0.0000E+00
3.320	0.0000E+00
3.580	0.0000E+00
3.840	0.0000E+00
4.100	0.0000E+00
4.360	0.0000E+00
4.620	0.0000E+00
4.880	0.0000E+00
5.140	0.0000E+00
5.400	0.0000E+00
5.660	0.0000E+00
5.920	0.0000E+00
6.180	0.0000E+00
6.440	0.0000E+00
6.700	0.0000E+00
6.960	0.0000E+00
7.220	0.0000E+00
7.480	0.0000E+00
7.740	0.0000E+00
8.000	0.0000E+00
8.260	0.0000E+00
8.520	0.0000E+00
8.780	0.0000E+00
9.040	0.0000E+00
9.300	0.0000E+00
9.560	0.0000E+00
9.820	0.0000E+00
10.080	0.0000E+00
24.000	0.0000E+00
96.000	0.0000E+00
720.000	0.0000E+00

 Cumulative Dose Summary
 #####

Time (hr)	EAB		LPZ		Control Room	
	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)
0.000	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.001	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.002	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.280	8.3404E+00	3.0641E-01	1.0306E+00	3.7861E-02	2.6890E+01	8.2912E-01
0.333	9.9401E+00	3.6519E-01	1.2282E+00	4.5124E-02	3.7491E+01	1.1559E+00
0.600	1.7965E+01	6.6009E-01	2.2198E+00	8.1563E-02	7.2199E+01	2.2277E+00
0.860	2.5771E+01	9.4700E-01	3.1843E+00	1.1701E-01	8.6080E+01	2.6586E+00
1.120	3.3565E+01	1.2335E+00	4.1473E+00	1.5241E-01	9.4485E+01	2.9206E+00
1.380	4.1348E+01	1.5196E+00	5.1091E+00	1.8776E-01	1.0134E+02	3.1346E+00
1.640	4.9121E+01	1.8053E+00	6.0696E+00	2.2307E-01	1.0775E+02	3.3348E+00
1.900	5.6885E+01	2.0907E+00	7.0288E+00	2.5834E-01	1.1404E+02	3.5308E+00
2.000	5.9868E+01	2.2004E+00	7.3975E+00	2.7189E-01	1.1644E+02	3.6058E+00
2.002	5.9928E+01	2.2027E+00	7.4008E+00	2.7202E-01	1.1649E+02	3.6073E+00
2.280	6.0471E+01	2.2244E+00	7.4314E+00	2.7323E-01	1.2039E+02	3.7296E+00
2.540	6.0472E+01	2.2262E+00	7.4314E+00	2.7333E-01	1.2137E+02	3.7608E+00
2.800	6.0472E+01	2.2279E+00	7.4314E+00	2.7343E-01	1.2164E+02	3.7700E+00
3.060	6.0472E+01	2.2295E+00	7.4314E+00	2.7352E-01	1.2172E+02	3.7727E+00
3.320	6.0472E+01	2.2312E+00	7.4314E+00	2.7362E-01	1.2174E+02	3.7736E+00
3.580	6.0472E+01	2.2327E+00	7.4314E+00	2.7370E-01	1.2175E+02	3.7740E+00
3.840	6.0472E+01	2.2343E+00	7.4314E+00	2.7379E-01	1.2175E+02	3.7741E+00
4.100	6.0472E+01	2.2358E+00	7.4314E+00	2.7387E-01	1.2175E+02	3.7742E+00
4.360	6.0472E+01	2.2372E+00	7.4314E+00	2.7396E-01	1.2175E+02	3.7743E+00
4.620	6.0472E+01	2.2386E+00	7.4314E+00	2.7404E-01	1.2175E+02	3.7743E+00
4.880	6.0472E+01	2.2400E+00	7.4314E+00	2.7411E-01	1.2175E+02	3.7744E+00
5.140	6.0472E+01	2.2414E+00	7.4314E+00	2.7419E-01	1.2175E+02	3.7744E+00
5.400	6.0472E+01	2.2427E+00	7.4314E+00	2.7426E-01	1.2175E+02	3.7745E+00
5.660	6.0472E+01	2.2439E+00	7.4314E+00	2.7433E-01	1.2175E+02	3.7745E+00
5.920	6.0472E+01	2.2452E+00	7.4314E+00	2.7440E-01	1.2175E+02	3.7746E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

6.180	6.0472E+01	2.2464E+00	7.4314E+00	2.7447E-01	1.2175E+02	3.7746E+00
6.440	6.0472E+01	2.2476E+00	7.4314E+00	2.7454E-01	1.2175E+02	3.7747E+00
6.700	6.0472E+01	2.2487E+00	7.4314E+00	2.7460E-01	1.2175E+02	3.7747E+00
6.960	6.0472E+01	2.2498E+00	7.4314E+00	2.7467E-01	1.2175E+02	3.7748E+00
7.220	6.0472E+01	2.2509E+00	7.4314E+00	2.7473E-01	1.2175E+02	3.7748E+00
7.480	6.0472E+01	2.2520E+00	7.4314E+00	2.7479E-01	1.2175E+02	3.7748E+00
7.740	6.0472E+01	2.2530E+00	7.4314E+00	2.7484E-01	1.2175E+02	3.7749E+00
8.000	6.0472E+01	2.2540E+00	7.4314E+00	2.7490E-01	1.2175E+02	3.7749E+00
8.260	6.0472E+01	2.2550E+00	7.4314E+00	2.7494E-01	1.2175E+02	3.7749E+00
8.520	6.0472E+01	2.2560E+00	7.4314E+00	2.7497E-01	1.2175E+02	3.7750E+00
8.780	6.0472E+01	2.2569E+00	7.4314E+00	2.7501E-01	1.2175E+02	3.7750E+00
9.040	6.0472E+01	2.2578E+00	7.4314E+00	2.7504E-01	1.2175E+02	3.7750E+00
9.300	6.0472E+01	2.2587E+00	7.4314E+00	2.7508E-01	1.2175E+02	3.7750E+00
9.560	6.0472E+01	2.2595E+00	7.4314E+00	2.7511E-01	1.2175E+02	3.7750E+00
9.820	6.0472E+01	2.2604E+00	7.4314E+00	2.7514E-01	1.2175E+02	3.7750E+00
10.080	6.0472E+01	2.2612E+00	7.4314E+00	2.7517E-01	1.2175E+02	3.7750E+00
24.000	6.0472E+01	2.2846E+00	7.4314E+00	2.7606E-01	1.2175E+02	3.7754E+00
96.000	6.0472E+01	2.2944E+00	7.4314E+00	2.7621E-01	1.2175E+02	3.7755E+00
720.000	6.0472E+01	2.2949E+00	7.4314E+00	2.7622E-01	1.2175E+02	3.7755E+00

Worst Two-Hour Dose
(Provided for Dose Location 1)
#####

EAB

Time (hr)	Whole Body (rem)	Thyroid (rem)	Skin (rem)	TEDE (rem)
0.0	3.6513E-01	5.9868E+01	1.0476E+00	2.2004E+00

30 Day Control Room Skin Dose
#####

Control Room

Time (hr)	Skin (rem)
720.0	4.4376E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Attachment 3 RADTRAD-NAI FHA Output – Case 1 – 10% Filtered

```

#####
RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:46:46
#####

#####
File information
#####

Plant file name           = pal/FHA/db/pal_fha_db_ast_10filter.psf
Inventory file name       = pal/FHA/db/palisades_fha_db_ast_adj.nif
Scenario file name        = pal/FHA/db/pal_fha_db_ast_10filter.psf
Release file name         = pal/FHA/db/pal_fha_ast.rft
Dose conversion file name = pal/FHA/db/nai-1101-001rev0.dcf

```

```

#####  #####  #####  # # # ##### # # #####
# # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # #
#####  #####  #####  # # # # # ##### # # # #
# # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # #

```

```

*RADTRAD-NAI 1.1a(QA)
*09 May 2005 06:41:56
** Palisades FHA Design Basis
** 10% release filtration
*Nuclide inventory file
pal/FHA/db/palisades_fha_db_ast_adj.nif
*Plant power
2703
*Compartments
4
*Compartment 1:
Fuel Pool-Unfiltered
3
10000
0
0
0
0
1
*Compartment 2:
Environment
2
2e+20
0
0
0
0
0
*Compartment 3:
Control Room
1
35923
0
1
0
0
0
*Compartment 4:
Fuel Pool-Filtered
3
10000
0
0
0
0
1

```


Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
*Pathways
6
*Pathway 1:
Fuel Pool Release-Unfiltered
1
2
2
*Pathway 2:
Control Room Unfiltered Makeup
2
3
2
*Pathway 3:
Control Room Filtered Makeup
2
3
2
*Pathway 4:
Control Room Unfiltered Inleakage
2
3
2
*Pathway 5:
Control Room Exhaust
3
2
2
*Pathway 6:
Fuel Pool Release-Filtered
4
2
2
*Sources
4
1 0.9
2 0
3 0
4 0.1
*dose conversion factors filename
pal/FHA/db/nai-1101-001rev0.dcf
*release fraction and timing filename
pal/FHA/db/pal_fha_ast.rft
0
1
1
*Iodine
0 0.9985 0.0015
*Overlying pool
*aerosol model
0
*elemental model
1
2
0 252
720 252
*organic model
1
2
0 1
720 1
*pH tracking
0
*Compartment detail
*Compartment 1:
1
*spray model
0
0
0
*filter model
0
*deposition model
0
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
0
*Compartment 2:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Compartment 4:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Pathways:
*Pathway 1
*filter efficiency model
  1
  2
0 1000000 100 0 0
720 1000000 100 0 0
*Pathway 2
*filter efficiency model
  1
  3
0 660 0 0 0
0.3333 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
  1
  3
0 0 0 0 0
0.3333 100 0 0 0
720 100 0 0 0
*Pathway 5
*filter efficiency model
  1
  3
0 660 0 0 0
0.3333 1513.6 0 0 0
720 1513.6 0 0 0
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
*Pathway 6
*filter efficiency model
  1
  2
0 1000000 100 94 94
720 1000000 100 94 94
*x/q tables
  6
EAB
  2
0 0.000539
720 0.000539
LPZ
  6
0 6.66e-05
  2 3.03e-05
  8 2.04e-05
 24 8.67e-06
 96 2.54e-06
720 2.54e-06
Equip Hatch-Normal
  6
0 0.0125
  2 0.00983
  8 0.00362
 24 0.00286
 96 0.00228
720 0.00228
Equip Hatch-Emergency
  6
0 0.000732
  2 0.000613
  8 0.000245
 24 0.000175
 96 0.000129
720 0.000129
Stack-Normal
  6
0 0.0061
  2 0.00432
  8 0.00173
 24 0.00127
 96 0.000979
720 0.000979
Stack-Emergency
  6
0 0.000832
  2 0.000769
  8 0.000283
 24 0.000215
 96 0.000157
720 0.000157
*dose locations
  3
*location name, compartment number and x/q table
EAB
  2
  1
*br model
  1
  4
0 0.00035
  8 0.00018
 24 0.00023
720 0.00023
*of model
  0
*location x/q input to be included
  0
*location name, compartment number and x/q table
LPZ
  2
  2
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```

*br model
  1
  4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
  0
*location x/q input to be included
  0
*location name, compartment number and x/q table
Control Room
  3
  0
*br model
  1
  2
0 0.00035
720 0.00035
*of model
  1
  4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
  1
*number of intake combinations
  6
*intake combinations
2 1 3
3 1 4
4 1 3
2 6 5
3 6 6
4 6 5
*time step count
  3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
  1
  1
  1
  0
  1

#####
RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:46:46
#####

#####
Plant Description
#####

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth
Plant Power Level = 2.7030E+03 MWth

Number of compartments = 4

Compartment information

Compartment number 1 (Source term fraction = 9.0000E-01)
Name: Fuel Pool-Unfiltered
Compartment volume = 1.0000E+04 (Cubic feet)
Removal devices within compartment:
  Suppression pool
Pathways into and out of compartment 1

```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Pathway to compartment number 2: Fuel Pool Release-Unfiltered

Compartment number 2
Name: Environment

- Pathways into and out of compartment 2
Pathway to compartment number 3: Control Room Unfiltered Makeup
Pathway to compartment number 3: Control Room Filtered Makeup
Pathway to compartment number 3: Control Room Unfiltered Inleakage
Pathway from compartment number 1: Fuel Pool Release-Unfiltered
Pathway from compartment number 3: Control Room Exhaust
Pathway from compartment number 4: Fuel Pool Release-Filtered

Compartment number 3
Name: Control Room
Compartment volume = 3.5923E+04 (Cubic feet)
Removal devices within compartment:
Filter(s)

- Pathways into and out of compartment 3
Pathway to compartment number 2: Control Room Exhaust
Pathway from compartment number 2: Control Room Unfiltered Makeup
Pathway from compartment number 2: Control Room Filtered Makeup
Pathway from compartment number 2: Control Room Unfiltered Inleakage

Compartment number 4 (Source term fraction = 1.0000E-01)
Name: Fuel Pool-Filtered
Compartment volume = 1.0000E+04 (Cubic feet)
Removal devices within compartment:
Suppression pool

- Pathways into and out of compartment 4
Pathway to compartment number 2: Fuel Pool Release-Filtered

Total number of pathways = 6

#####
RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:46:46
#####
#####
Scenario Description
#####

Radioactive Decay is enabled
Calculation of Daughters is enabled

Iodine fractions
Aerosol = 0.0000E+00
Elemental = 9.9850E-01
Organic = 1.5000E-03

Overlying pool characteristics

Elemental Removal Data:
Time (hr) DF
0.0000E+00 2.5200E+02
7.2000E+02 2.5200E+02

Organic Removal Data:
Time (hr) DF
0.0000E+00 1.0000E+00
7.2000E+02 1.0000E+00

COMPARTMENT DATA

- Compartment number 1: Fuel Pool-Unfiltered
Compartment number 2: Environment
Compartment number 3: Control Room

Compartment Filter Data

Time (hr) Flow Rate Filter Efficiencies (%)

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	(cfm)	Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Compartment number 4: Fuel Pool-Filtered

PATHWAY DATA

Pathway number 1: Fuel Pool Release-Unfiltered

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	1.0000E+06	1.0000E+02	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+06	1.0000E+02	0.0000E+00	0.0000E+00

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.0000E+02	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+02	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.5136E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.5136E+03	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 6: Fuel Pool Release-Filtered

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	1.0000E+06	1.0000E+02	9.4000E+01	9.4000E+01
7.2000E+02	1.0000E+06	1.0000E+02	9.4000E+01	9.4000E+01

X/Q DATA

X/Q table 1: EAB

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	5.3900E-04
7.2000E+02	5.3900E-04

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

X/Q table 2: LPZ

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

X/Q table 3: Equip Hatch-Normal

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	1.2500E-02
2.0000E+00	9.8300E-03
8.0000E+00	3.6200E-03
2.4000E+01	2.8600E-03
9.6000E+01	2.2800E-03
7.2000E+02	2.2800E-03

X/Q table 4: Equip Hatch-Emergency

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	7.3200E-04
2.0000E+00	6.1300E-04
8.0000E+00	2.4500E-04
2.4000E+01	1.7500E-04
9.6000E+01	1.2900E-04
7.2000E+02	1.2900E-04

X/Q table 5: Stack-Normal

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	6.1000E-03
2.0000E+00	4.3200E-03
8.0000E+00	1.7300E-03
2.4000E+01	1.2700E-03
9.6000E+01	9.7900E-04
7.2000E+02	9.7900E-04

X/Q table 6: Stack-Emergency

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	8.3200E-04
2.0000E+00	7.6900E-04
8.0000E+00	2.8300E-04
2.4000E+01	2.1500E-04
9.6000E+01	1.5700E-04
7.2000E+02	1.5700E-04

LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location Control Room is in compartment 3

Inleakage X/Q Table Assignments

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Inleakage Path	Source Path	X/Q Table
2	1	3
3	1	4
4	1	3
2	6	5
3	6	6
4	6	5

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
7.2000E+02	3.5000E-04

Location Occupancy Factor Data

Time (hr)	Occupancy Factor
0.0000E+00	1.0000E+00
2.4000E+01	6.0000E-01
9.6000E+01	4.0000E-01
7.2000E+02	4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time	Time step
0.0000E+00	1.0000E-06
1.0000E-03	2.0000E-02
7.2000E+02	2.0000E-02

 RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:46:46
 #####

```

#####
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
#####

```


 Dose, Detailed Model and Detailed Inventory Output
 #####

Detailed model information at time (H) = 0.0010

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.0010	0.0000E+00	0.0000E+00	0.0000E+00
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Recirculating	
Time (h) = 0.0010	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 0.0010	Release	Rate/s	Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) =	0.0010		
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) =	0.0010	
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) =	0.0010		
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) =	0.0010	
Noble gases (atoms)	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.0020

EAB Doses:

Time (h) = 0.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

LPZ Doses:

Time (h) = 0.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Control Room Doses:

Time (h) = 0.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 0.0020	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 0.0020	Deposition Recirculating	
	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

Time (h) = 0.0020	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

			Overlying
Time (h) = 0.0020	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition	Recirculating
Time (h) = 0.0020	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Transport Group Inventory:

			Overlying
Time (h) = 0.0020	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

		Deposition	Recirculating
Time (h) = 0.0020	Surfaces	Filter	
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3333

EAB Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.9551E-02	9.0058E+00	1.7304E-01	3.3565E-01
Accumulated dose (rem)	5.9551E-02	9.0058E+00	1.7304E-01	3.3565E-01

LPZ Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.3582E-03	1.1128E+00	2.1382E-02	4.1473E-02
Accumulated dose (rem)	7.3582E-03	1.1128E+00	2.1382E-02	4.1473E-02

Control Room Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	6.2908E-03	3.3851E+01	6.1879E-01	1.0440E+00
Accumulated dose (rem)	6.2908E-03	3.3851E+01	6.1879E-01	1.0440E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	7.8900E-02	2.0110E-07	1.4248E+18	2.9193E+09
Kr-85m	4.1812E-04	5.0808E-14	3.5997E+11	1.5471E+07
Kr-88	1.4872E-05	1.1860E-15	8.1165E+09	5.5027E+05
Rb-86	1.6363E-02	2.0109E-10	1.4082E+15	6.0541E+08
I-131	2.1033E-02	1.6965E-10	7.7991E+14	7.7822E+08
I-132	1.4367E-02	1.3918E-12	6.3498E+12	5.3156E+08
I-133	6.1157E-03	5.3987E-12	2.4445E+13	2.2628E+08
I-135	1.7701E-04	5.0404E-14	2.2484E+11	6.5494E+06
Xe-133	5.0182E+00	2.6809E-08	1.2139E+17	1.8567E+11
Xe-135	3.5563E-01	1.3926E-10	6.2121E+14	1.3158E+10
Cs-134	1.8306E+00	1.4149E-06	6.3585E+18	6.7731E+10
Cs-136	4.7521E-01	6.4839E-09	2.8711E+16	1.7583E+10
Cs-137	9.9000E-01	1.1382E-05	5.0031E+19	3.6630E+10
I-130	5.1186E-05	2.6244E-14	1.2158E+11	1.8939E+06
Kr-83m	4.2686E-06	2.0689E-16	1.5011E+09	1.5794E+05
Xe-131m	3.3771E-02	4.0318E-10	1.8534E+15	1.2495E+09
Xe-133m	1.3846E-01	3.0858E-10	1.3972E+15	5.1231E+09
Xe-135m	3.6225E-01	3.9768E-12	1.7740E+13	1.3403E+10
Cs-134m	4.2568E-06	5.2786E-16	2.3723E+09	1.5750E+05
Rb-88	3.9668E-05	3.3046E-16	2.2615E+09	1.4677E+06
Ba-137m	2.0299E-01	3.7744E-13	1.6591E+12	7.5106E+09
Br-82	4.1921E-05	3.8721E-14	2.8437E+11	1.5511E+06
Br-83	1.6426E-09	1.0398E-19	7.5442E+05	6.0777E+01

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	1.5501E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.8853E+14	0.0000E+00	2.9353E+20
Organic I (atoms)	2.2280E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	1.2803E-05	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Recirculating Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	3.1642E+01	3.8888E-07	2.7231E+18	1.1708E+12
Cs-134	3.5400E+03	2.7360E-03	1.2296E+22	1.3098E+14
Cs-136	9.1896E+02	1.2539E-05	5.5521E+19	3.4002E+13
Cs-137	1.9145E+03	2.2010E-02	9.6749E+22	7.0835E+13
Cs-134m	8.2318E-03	1.0208E-12	4.5875E+12	3.0458E+08
Rb-88	5.4640E-02	4.5519E-13	3.1150E+12	2.0217E+09
Ba-137m	1.8051E+03	3.3565E-09	1.4754E+16	6.6789E+13

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	2.4759E-02

Environment Integral Nuclide Release:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	1.7364E+02	4.4257E-04	3.1356E+21	6.4246E+12
Kr-85m	9.2017E-01	1.1181E-10	7.9218E+14	3.4046E+10
Kr-87	1.1334E-08	4.0014E-19	2.7698E+06	4.1937E+02
Kr-88	3.2729E-02	2.6102E-12	1.7862E+13	1.2110E+09
I-131	4.1929E+01	3.3821E-07	1.5548E+18	1.5514E+12
I-132	2.7320E+01	2.6467E-09	1.2075E+16	1.0108E+12
I-133	1.2192E+01	1.0763E-08	4.8732E+16	4.5110E+11
I-135	3.5288E-01	1.0048E-10	4.4824E+14	1.3057E+10

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Xe-133	1.0697E+04	5.7148E-05	2.5876E+20	3.9579E+14
Xe-135	6.6159E+02	2.5907E-07	1.1557E+18	2.4479E+13
I-130	1.0204E-01	5.2319E-11	2.4237E+14	3.7755E+09
Kr-83m	2.7903E-03	1.3524E-13	9.8125E+11	1.0324E+08
Xe-131m	6.8317E+01	8.1562E-07	3.7494E+18	2.5277E+12
Xe-133m	2.7991E+02	6.2382E-07	2.8246E+18	1.0357E+13
Xe-135m	1.1206E+01	1.2301E-10	5.4875E+14	4.1461E+11
Rb-88	1.0963E-02	9.1327E-14	6.2498E+11	4.0562E+08
Br-82	8.3571E-02	7.7192E-11	5.6691E+14	3.0921E+09
Br-83	3.2746E-06	2.0728E-16	1.5040E+09	1.2116E+05

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 0.3333	Release	Rate/s	Release
Noble gases (atoms)	1.3672E+20	1.8989E+18	3.4021E+21
Elemental I (atoms)	4.7150E+16	6.5486E+14	1.1728E+18
Organic I (atoms)	1.7849E+16	2.4791E+14	4.4399E+17
Aerosols (kg)	3.4462E-16	4.7865E-18	9.1327E-14

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Rb-86	3.1642E+01	3.8888E-07	2.7231E+18	1.1708E+12
Cs-134	3.5400E+03	2.7360E-03	1.2296E+22	1.3098E+14
Cs-136	9.1896E+02	1.2539E-05	5.5521E+19	3.4002E+13
Cs-137	1.9145E+03	2.2010E-02	9.6749E+22	7.0835E+13
Cs-134m	8.2318E-03	1.0208E-12	4.5875E+12	3.0458E+08
Rb-88	5.4640E-02	4.5519E-13	3.1150E+12	2.0217E+09
Ba-137m	1.8051E+03	3.3565E-09	1.4754E+16	6.6789E+13

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	2.4759E-02

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	3.5158E+00	4.3209E-08	3.0257E+17	1.3008E+11
I-131	4.2480E+00	3.4265E-08	1.5752E+17	1.5718E+11
I-132	2.7636E+00	2.6774E-10	1.2215E+15	1.0225E+11
I-133	1.2352E+00	1.0904E-09	4.9373E+15	4.5703E+10
I-135	3.5752E-02	1.0180E-11	4.5413E+13	1.3228E+09
Cs-134	3.9333E+02	3.0400E-04	1.3662E+21	1.4553E+13
Cs-136	1.0211E+02	1.3932E-06	6.1690E+18	3.7780E+12
Cs-137	2.1272E+02	2.4455E-03	1.0750E+22	7.8706E+12
I-130	1.0338E-02	5.3007E-12	2.4555E+13	3.8251E+08
Cs-134m	9.1465E-04	1.1342E-13	5.0972E+11	3.3842E+07
Rb-88	6.0711E-03	5.0576E-14	3.4611E+11	2.2463E+08
Ba-137m	2.0057E+02	3.7294E-10	1.6393E+15	7.4210E+12
Br-82	8.4670E-03	7.8207E-12	5.7436E+13	3.1328E+08
Br-83	3.3177E-07	2.1001E-17	1.5237E+08	1.2275E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.1882E+17
Organic I (atoms)	4.4982E+16
Aerosols (kg)	2.7510E-03

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	5.3908E-01	1.3740E-06	9.7348E+18	1.9946E+10
Kr-85m	2.8568E-03	3.4714E-13	2.4594E+12	1.0570E+08
Kr-88	1.0161E-04	8.1036E-15	5.5456E+10	3.7597E+06
I-131	1.3676E-01	1.1031E-09	5.0710E+15	5.0600E+09
I-132	8.9369E-02	8.6580E-12	3.9500E+13	3.3067E+09
I-133	3.9765E-02	3.5103E-11	1.5894E+14	1.4713E+09
I-135	1.1510E-03	3.2773E-13	1.4620E+12	4.2585E+07
Xe-133	3.3212E+01	1.7743E-07	8.0339E+17	1.2288E+12
Xe-135	2.0543E+00	8.0443E-10	3.5884E+15	7.6009E+10
I-130	3.3282E-04	1.7065E-13	7.9050E+11	1.2314E+07
Kr-83m	8.6779E-06	4.2060E-16	3.0517E+09	3.2108E+05
Xe-131m	2.1211E-01	2.5324E-09	1.1641E+16	7.8482E+09
Xe-133m	8.6908E-01	1.9369E-09	8.7699E+15	3.2156E+10
Xe-135m	3.6262E-02	3.9808E-13	1.7758E+12	1.3417E+09
Rb-88	3.2312E-05	2.6918E-16	1.8421E+09	1.1956E+06
Br-82	2.7258E-04	2.5177E-13	1.8490E+12	1.0085E+07
Br-83	1.0680E-08	6.7608E-19	4.9053E+06	3.9518E+02

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	1.0562E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.8254E+15	0.0000E+00	0.0000E+00
Organic I (atoms)	1.4482E+15	0.0000E+00	0.0000E+00
Aerosols (kg)	2.6918E-16	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Kr-85	8.7666E-03	2.2345E-08	1.5831E+17	3.2437E+08
Kr-85m	4.6458E-05	5.6453E-15	3.9996E+10	1.7189E+06
Kr-88	1.6525E-06	1.3178E-16	9.0184E+08	6.1141E+04
Rb-86	1.8181E-03	2.2344E-11	1.5646E+14	6.7268E+07
I-131	2.3370E-03	1.8850E-11	8.6657E+13	8.6468E+07
I-132	1.5963E-03	1.5465E-13	7.0553E+11	5.9063E+07
I-133	6.7952E-04	5.9986E-13	2.7161E+12	2.5142E+07
I-135	1.9668E-05	5.6005E-15	2.4983E+10	7.2772E+05
Xe-133	5.5757E-01	2.9788E-09	1.3488E+16	2.0630E+10
Xe-135	3.9514E-02	1.5473E-11	6.9024E+13	1.4620E+09
Cs-134	2.0340E-01	1.5721E-07	7.0650E+17	7.5257E+09
Cs-136	5.2801E-02	7.2043E-10	3.1901E+15	1.9536E+09
Cs-137	1.1000E-01	1.2646E-06	5.5590E+18	4.0700E+09
I-130	5.6873E-06	2.9161E-15	1.3508E+10	2.1043E+05
Kr-83m	4.7428E-07	2.2988E-17	1.6679E+08	1.7549E+04
Xe-131m	3.7523E-03	4.4797E-11	2.0594E+14	1.3883E+08
Xe-133m	1.5385E-02	3.4287E-11	1.5525E+14	5.6923E+08
Xe-135m	4.0250E-02	4.4186E-13	1.9711E+12	1.4893E+09
Cs-134m	4.7298E-07	5.8651E-17	2.6358E+08	1.7500E+04
Rb-88	4.4076E-06	3.6718E-17	2.5128E+08	1.6308E+05
Ba-137m	2.2554E-02	4.1938E-14	1.8435E+11	8.3451E+08
Br-82	4.6579E-06	4.3024E-15	3.1597E+10	1.7234E+05

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 0.3333	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.7223E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	6.5393E+13	0.0000E+00	3.2614E+19
Organic I (atoms)	2.4756E+13	0.0000E+00	0.0000E+00
Aerosols (kg)	1.4226E-06	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	3.5158E+00	4.3209E-08	3.0257E+17	1.3008E+11
I-131	4.2480E+00	3.4265E-08	1.5752E+17	1.5718E+11
I-132	2.7636E+00	2.6774E-10	1.2215E+15	1.0225E+11
I-133	1.2352E+00	1.0904E-09	4.9373E+15	4.5703E+10
I-135	3.5752E-02	1.0180E-11	4.5413E+13	1.3228E+09
Cs-134	3.9333E+02	3.0400E-04	1.3662E+21	1.4553E+13
Cs-136	1.0211E+02	1.3932E-06	6.1690E+18	3.7780E+12
Cs-137	2.1272E+02	2.4455E-03	1.0750E+22	7.8706E+12
I-130	1.0338E-02	5.3007E-12	2.4555E+13	3.8251E+08
Cs-134m	9.1465E-04	1.1342E-13	5.0972E+11	3.3842E+07
Rb-88	6.0711E-03	5.0576E-14	3.4611E+11	2.2463E+08
Ba-137m	2.0057E+02	3.7294E-10	1.6393E+15	7.4210E+12
Br-82	8.4670E-03	7.8207E-12	5.7436E+13	3.1328E+08
Br-83	3.3177E-07	2.1001E-17	1.5237E+08	1.2275E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.1882E+17
Organic I (atoms)	4.4982E+16
Aerosols (kg)	2.7510E-03

Detailed model information at time (H) = 2.0000

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
2.0000				
Delta dose (rem)	3.0012E-01	4.5235E+01	8.6642E-01	1.6868E+00
Accumulated dose (rem)	3.5967E-01	5.4241E+01	1.0395E+00	2.0224E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
2.0000				
Delta dose (rem)	3.7084E-02	5.5893E+00	1.0706E-01	2.0842E-01
Accumulated dose (rem)	4.4442E-02	6.7021E+00	1.2844E-01	2.4990E-01

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
2.0000				
Delta dose (rem)	2.9138E-02	7.1287E+01	3.0093E+00	2.2139E+00
Accumulated dose (rem)	3.5429E-02	1.0514E+02	3.6281E+00	3.2579E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Kr-85	7.8899E-02	2.0110E-07	1.4248E+18	2.9193E+09
Kr-85m	3.2308E-04	3.9259E-14	2.7814E+11	1.1954E+07
Kr-88	9.9017E-06	7.8966E-16	5.4039E+09	3.6636E+05
Rb-86	1.6320E-02	2.0058E-10	1.4045E+15	6.0385E+08
I-131	2.0912E-02	1.6868E-10	7.7542E+14	7.7373E+08
I-132	1.4143E-02	1.3701E-12	6.2509E+12	5.2328E+08
I-133	5.7853E-03	5.1070E-12	2.3124E+13	2.1406E+08
I-135	1.4863E-04	4.2322E-14	1.8879E+11	5.4992E+06
Xe-133	6.1779E+00	3.3005E-08	1.4944E+17	2.2858E+11
Xe-135	6.8729E-01	2.6913E-10	1.2006E+15	2.5430E+10
Cs-134	1.8305E+00	1.4148E-06	6.3581E+18	6.7727E+10
Cs-136	4.7347E-01	6.4601E-09	2.8606E+16	1.7518E+10
Cs-137	9.8999E-01	1.1382E-05	5.0030E+19	3.6630E+10
I-130	4.6618E-05	2.3903E-14	1.1073E+11	1.7249E+06
Kr-83m	1.7581E-05	8.5213E-16	6.1827E+09	6.5051E+05
Xe-131m	5.5679E-02	6.6474E-10	3.0558E+15	2.0601E+09
Xe-133m	2.2181E-01	4.9434E-10	2.2383E+15	8.2071E+09
Xe-135m	2.7249E+00	2.9913E-11	1.3344E+14	1.0082E+11
Cs-134m	2.8581E-06	3.5441E-16	1.5928E+09	1.0575E+05
Rb-88	2.6502E-05	2.2078E-16	1.5109E+09	9.8057E+05
Ba-137m	3.0525E-01	5.6758E-13	2.4949E+12	1.1294E+10
Br-82	4.0571E-05	3.7474E-14	2.7522E+11	1.5011E+06
Br-83	1.0130E-09	6.4123E-20	4.6525E+05	3.7481E+01

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 2.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.5808E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.8421E+14	0.0000E+00	1.7544E+21
Organic I (atoms)	2.2116E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	1.2803E-05	0.0000E+00	0.0000E+00

Time (h) = 2.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	1.9477E+02	2.3937E-06	1.6762E+19	7.2064E+12
Cs-134	2.1845E+04	1.6884E-02	7.5878E+22	8.0825E+14
Cs-136	5.6504E+03	7.7095E-05	3.4138E+20	2.0906E+14
Cs-137	1.1815E+04	1.3583E-01	5.9706E+23	4.3714E+14
Cs-134m	3.4108E-02	4.2295E-12	1.9008E+13	1.2620E+09
Rb-88	7.4066E-02	6.1702E-13	4.2225E+12	2.7405E+09
Ba-137m	1.2803E+04	2.3805E-08	1.0464E+17	4.7369E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 2.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5279E-01

Environment Integral Nuclide Release:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	1.0506E+03	2.6779E-03	1.8972E+22	3.8873E+13
Kr-85m	4.3022E+00	5.2277E-10	3.7038E+15	1.5918E+11
Kr-88	1.3185E-01	1.0515E-11	7.1958E+13	4.8785E+09
I-131	2.5207E+02	2.0333E-06	9.3470E+18	9.3267E+12
I-132	1.2943E+02	1.2539E-08	5.7205E+16	4.7888E+12
I-133	6.9745E+01	6.1569E-08	2.7878E+17	2.5806E+12
I-135	1.7918E+00	5.1021E-10	2.2760E+15	6.6297E+10
Xe-133	6.4278E+04	3.4340E-04	1.5549E+21	2.3783E+15
Xe-135	3.5727E+03	1.3990E-06	6.2408E+18	1.3219E+14
I-130	5.6201E-01	2.8816E-10	1.3349E+15	2.0794E+10
Kr-83m	1.0427E-02	5.0537E-13	3.6668E+12	3.8579E+08
Xe-131m	4.1398E+02	4.9424E-06	2.2721E+19	1.5317E+13
Xe-133m	1.6659E+03	3.7127E-06	1.6811E+19	6.1639E+13
Xe-135m	5.6577E+01	6.2110E-10	2.7706E+15	2.0934E+12
Rb-88	1.1594E-01	9.6586E-13	6.6097E+12	4.2898E+09
Br-82	4.8911E-01	4.5178E-10	3.3179E+15	1.8097E+10
Br-83	1.2212E-05	7.7304E-16	5.6089E+09	4.5186E+05

Environment Transport Group Inventory:

Time (h) = 2.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.0604E+20	2.8617E+18	2.0573E+22
Elemental I (atoms)	7.0518E+16	9.7941E+14	7.0290E+18
Organic I (atoms)	2.6696E+16	3.7077E+14	2.6609E+18
Aerosols (kg)	5.1917E-16	7.2106E-18	9.6586E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	1.9477E+02	2.3937E-06	1.6762E+19	7.2064E+12
Cs-134	2.1845E+04	1.6884E-02	7.5878E+22	8.0825E+14
Cs-136	5.6504E+03	7.7095E-05	3.4138E+20	2.0906E+14
Cs-137	1.1815E+04	1.3583E-01	5.9706E+23	4.3714E+14

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Cs-134m	3.4108E-02	4.2295E-12	1.9008E+13	1.2620E+09
Rb-88	7.4066E-02	6.1702E-13	4.2225E+12	2.7405E+09
Ba-137m	1.2803E+04	2.3805E-08	1.0464E+17	4.7369E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5279E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
I-131	1.0186E-01	8.2161E-10	3.7770E+15	3.7688E+09
I-132	5.4505E-02	5.2804E-12	2.4091E+13	2.0167E+09
I-133	2.8182E-02	2.4878E-11	1.1265E+14	1.0427E+09
I-135	7.2402E-04	2.0617E-13	9.1967E+11	2.6789E+07
I-130	2.2710E-04	1.1644E-13	5.3939E+11	8.4025E+06
Br-82	1.9764E-04	1.8255E-13	1.3407E+12	7.3126E+06
Br-83	4.9347E-09	3.1237E-19	2.2664E+06	1.8258E+02

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.8410E+15
Organic I (atoms)	1.0755E+15
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
Rb-86	2.1641E+01	2.6596E-07	1.8624E+18	8.0071E+11
I-131	2.6062E+01	2.1022E-07	9.6639E+17	9.6429E+11
I-132	1.3359E+01	1.2942E-09	5.9044E+15	4.9427E+11
I-133	7.2110E+00	6.3656E-09	2.8823E+16	2.6681E+11
I-135	1.8525E-01	5.2751E-11	2.3532E+14	6.8544E+09
Cs-134	2.4272E+03	1.8760E-03	8.4309E+21	8.9806E+13
Cs-136	6.2782E+02	8.5661E-06	3.7931E+19	2.3229E+13
Cs-137	1.3127E+03	1.5092E-02	6.6340E+22	4.8571E+13
I-130	5.8107E-02	2.9793E-11	1.3801E+14	2.1499E+09
Cs-134m	3.7898E-03	4.6995E-13	2.1120E+12	1.4022E+08

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Rb-88	8.2296E-03	6.8558E-14	4.6916E+11	3.0449E+08
Ba-137m	1.4225E+03	2.6450E-09	1.1627E+16	5.2633E+13
Br-82	5.0570E-02	4.6710E-11	3.4304E+14	1.8711E+09
Br-83	1.2626E-06	7.9925E-17	5.7990E+08	4.6718E+04

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	7.2672E+17
Organic I (atoms)	2.7511E+17
Aerosols (kg)	1.6977E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	2.2418E-01	5.7140E-07	4.0483E+18	8.2947E+09
Kr-85m	9.1799E-04	1.1155E-13	7.9031E+11	3.3966E+07
Kr-88	2.8134E-05	2.2437E-15	1.5354E+10	1.0410E+06
I-131	1.5425E-02	1.2442E-10	5.7198E+14	5.7073E+08
I-132	9.8591E-03	9.5514E-13	4.3576E+12	3.6479E+08
I-133	4.2676E-03	3.7672E-12	1.7058E+13	1.5790E+08
I-135	1.0964E-04	3.1219E-14	1.3926E+11	4.0565E+06
Xe-133	1.3734E+01	7.3371E-08	3.3222E+17	5.0815E+11
Xe-135	7.6841E-01	3.0090E-10	1.3423E+15	2.8431E+10
I-130	3.4388E-05	1.7632E-14	8.1678E+10	1.2724E+06
Kr-83m	2.4428E-06	1.1840E-16	8.5904E+08	9.0382E+04
Xe-131m	8.8662E-02	1.0585E-09	4.8660E+15	3.2805E+09
Xe-133m	3.5677E-01	7.9510E-10	3.6002E+15	1.3200E+10
Xe-135m	3.2534E-02	3.5715E-13	1.5932E+12	1.2037E+09
Rb-88	1.0259E-05	8.5461E-17	5.8484E+08	3.7957E+05
Br-82	2.9928E-05	2.7643E-14	2.0301E+11	1.1073E+06
Br-83	7.4724E-10	4.7301E-20	3.4319E+05	2.7648E+01

Control Room Transport Group Inventory:

			Overlying
Time (h) = 2.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	4.3903E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.3075E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	1.6307E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	8.5461E-17	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 2.0000	Ci	kg	Atoms	Bq
I-131	1.1789E-01	9.5091E-10	4.3714E+15	4.3619E+09
I-132	5.3432E-02	5.1764E-12	2.3616E+13	1.9770E+09
I-133	3.2620E-02	2.8796E-11	1.3038E+14	1.2069E+09
I-135	8.3803E-04	2.3863E-13	1.0645E+12	3.1007E+07
I-130	2.6285E-04	1.3477E-13	6.2433E+11	9.7256E+06
Rb-88	1.1685E-05	9.7345E-17	6.6616E+08	4.3235E+05
Br-82	2.2876E-04	2.1130E-13	1.5518E+12	8.4641E+06
Br-83	5.7117E-09	3.6155E-19	2.6233E+06	2.1133E+02

Deposition Recirculating

	Surfaces	Filter
Time (h) = 2.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	3.2850E+15
Organic I (atoms)	0.0000E+00	1.2436E+15
Aerosols (kg)	0.0000E+00	9.7345E-17

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	2.0000	Ci	kg	Atoms	Bq
I-131		1.0186E-01	8.2161E-10	3.7770E+15	3.7688E+09
I-132		5.4505E-02	5.2804E-12	2.4091E+13	2.0167E+09
I-133		2.8182E-02	2.4878E-11	1.1265E+14	1.0427E+09
I-135		7.2402E-04	2.0617E-13	9.1967E+11	2.6789E+07
I-130		2.2710E-04	1.1644E-13	5.3939E+11	8.4025E+06
Br-82		1.9764E-04	1.8255E-13	1.3407E+12	7.3126E+06
Br-83		4.9347E-09	3.1237E-19	2.2664E+06	1.8258E+02

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		2.8410E+15
Organic I (atoms)		1.0755E+15
Aerosols (kg)		0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
I-131		2.1975E-01	1.7725E-09	8.1483E+15	8.1306E+09
I-132		1.0794E-01	1.0457E-11	4.7706E+13	3.9937E+09
I-133		6.0802E-02	5.3674E-11	2.4303E+14	2.2497E+09
I-135		1.5620E-03	4.4479E-13	1.9842E+12	5.7796E+07
I-130		4.8995E-04	2.5121E-13	1.1637E+12	1.8128E+07
Rb-88		1.1685E-05	9.7345E-17	6.6616E+08	4.3235E+05
Br-82		4.2640E-04	3.9385E-13	2.8925E+12	1.5777E+07
Br-83		1.0646E-08	6.7392E-19	4.8897E+06	3.9392E+02

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Kr-85		8.7665E-03	2.2345E-08	1.5831E+17	3.2436E+08
Kr-85m		3.5898E-05	4.3621E-15	3.0905E+10	1.3282E+06
Kr-88		1.1002E-06	8.7740E-17	6.0043E+08	4.0707E+04
Rb-86		1.8134E-03	2.2286E-11	1.5606E+14	6.7095E+07
I-131		2.3235E-03	1.8742E-11	8.6157E+13	8.5970E+07
I-132		1.5714E-03	1.5224E-13	6.9454E+11	5.8143E+07
I-133		6.4281E-04	5.6745E-13	2.5694E+12	2.3784E+07
I-135		1.6514E-05	4.7024E-15	2.0977E+10	6.1102E+05
Xe-133		6.8643E-01	3.6672E-09	1.6605E+16	2.5398E+10
Xe-135		7.6366E-02	2.9904E-11	1.3340E+14	2.8255E+09
Cs-134		2.0338E-01	1.5720E-07	7.0646E+17	7.5252E+09
Cs-136		5.2608E-02	7.1779E-10	3.1784E+15	1.9465E+09
Cs-137		1.1000E-01	1.2646E-06	5.5589E+18	4.0700E+09
I-130		5.1798E-06	2.6558E-15	1.2303E+10	1.9165E+05
Kr-83m		1.9535E-06	9.4682E-17	6.8697E+08	7.2279E+04
Xe-131m		6.1866E-03	7.3860E-11	3.3954E+14	2.2890E+08
Xe-133m		2.4646E-02	5.4927E-11	2.4870E+14	9.1190E+08
Xe-135m		3.0276E-01	3.3237E-12	1.4826E+13	1.1202E+10
Cs-134m		3.1757E-07	3.9379E-17	1.7697E+08	1.1750E+04
Rb-88		2.9447E-06	2.4531E-17	1.6787E+08	1.0895E+05
Ba-137m		3.3916E-02	6.3065E-14	2.7721E+11	1.2549E+09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Br-82 4.5079E-06 4.1638E-15 3.0579E+10 1.6679E+05

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0000			
Noble gases (atoms)	1.7565E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	6.4912E+13	0.0000E+00	1.9493E+20
Organic I (atoms)	2.4573E+13	0.0000E+00	0.0000E+00
Aerosols (kg)	1.4226E-06	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 2.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	2.1641E+01	2.6596E-07	1.8624E+18	8.0071E+11
I-131	2.6062E+01	2.1022E-07	9.6639E+17	9.6429E+11
I-132	1.3359E+01	1.2942E-09	5.9044E+15	4.9427E+11
I-133	7.2110E+00	6.3656E-09	2.8823E+16	2.6681E+11
I-135	1.8525E-01	5.2751E-11	2.3532E+14	6.8544E+09
Cs-134	2.4272E+03	1.8760E-03	8.4309E+21	8.9806E+13
Cs-136	6.2782E+02	8.5661E-06	3.7931E+19	2.3229E+12
Cs-137	1.3127E+03	1.5092E-02	6.6340E+22	4.8571E+13
I-130	5.8107E-02	2.9793E-11	1.3801E+14	2.1499E+09
Cs-134m	3.7898E-03	4.6995E-13	2.1120E+12	1.4022E+08
Rb-88	8.2296E-03	6.8558E-14	4.6916E+11	3.0449E+08
Ba-137m	1.4225E+03	2.6450E-09	1.1627E+16	5.2633E+13
Br-82	5.0570E-02	4.6710E-11	3.4304E+14	1.8711E+09
Br-83	1.2626E-06	7.9925E-17	5.7990E+08	4.6718E+04

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	7.2672E+17
Organic I (atoms)	2.7511E+17
Aerosols (kg)	1.6977E-02

Detailed model information at time (H) = 2.0020

EAB Doses:

Time (h) = 2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.8388E-04	5.4054E-02	1.2339E-03	2.1407E-03
Accumulated dose (rem)	3.6016E-01	5.4295E+01	1.0407E+00	2.0246E+00

LPZ Doses:

Time (h) = 2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.7202E-05	3.0387E-03	6.9364E-05	1.2034E-04
Accumulated dose (rem)	4.4469E-02	6.7052E+00	1.2851E-01	2.5002E-01

Control Room Doses:

Time (h) = 2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.5784E-05	4.3314E-02	2.6870E-03	1.3531E-03
Accumulated dose (rem)	3.5454E-02	1.0518E+02	3.6308E+00	3.2592E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Kr-85	7.8899E-02	2.0110E-07	1.4248E+18	2.9193E+09
Kr-85m	3.2298E-04	3.9247E-14	2.7806E+11	1.1950E+07
Kr-88	9.8968E-06	7.8927E-16	5.4012E+09	3.6618E+05
Rb-86	1.6320E-02	2.0058E-10	1.4045E+15	6.0385E+08
I-131	2.0912E-02	1.6868E-10	7.7541E+14	7.7373E+08

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-132	1.4217E-02	1.3774E-12	6.2838E+12	5.2604E+08
I-133	5.7849E-03	5.1067E-12	2.3123E+13	2.1404E+08
I-135	1.4860E-04	4.2313E-14	1.8875E+11	5.4981E+06
Xe-133	4.9623E+00	2.6511E-08	1.2004E+17	1.8361E+11
Xe-135	3.1019E-01	1.2147E-10	5.4184E+14	1.1477E+10
Cs-134	1.8305E+00	1.4148E-06	6.3581E+18	6.7727E+10
Cs-136	4.7347E-01	6.4601E-09	2.8606E+16	1.7518E+10
Cs-137	9.8999E-01	1.1382E-05	5.0030E+19	3.6630E+10
I-130	4.6613E-05	2.3900E-14	1.1071E+11	1.7247E+06
Kr-83m	2.4601E-06	1.1924E-16	8.6513E+08	9.1024E+04
Xe-131m	3.3553E-02	4.0058E-10	1.8415E+15	1.2414E+09
Xe-133m	1.3479E-01	3.0040E-10	1.3602E+15	4.9872E+09
Xe-135m	2.7649E-01	3.0353E-12	1.3540E+13	1.0230E+10
Cs-134m	2.8567E-06	3.5424E-16	1.5920E+09	1.0570E+05
Rb-88	2.7071E-05	2.2552E-16	1.5433E+09	1.0016E+06
Ba-137m	3.0526E-02	5.6762E-14	2.4951E+11	1.1295E+09
Br-82	4.0570E-05	3.7473E-14	2.7520E+11	1.5011E+06
Br-83	1.0124E-09	6.4085E-20	4.6498E+05	3.7459E+01

Fuel Pool-Unfiltered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0020			
Noble gases (atoms)	1.5486E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.8423E+14	0.0000E+00	1.7561E+21
Organic I (atoms)	2.2117E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	1.2803E-05	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 2.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

	Ci	kg	Atoms	Bq
Time (h) = 2.0020				
Rb-86	1.9496E+02	2.3961E-06	1.6779E+19	7.2136E+12
Cs-134	2.1867E+04	1.6901E-02	7.5954E+22	8.0907E+14
Cs-136	5.6560E+03	7.7172E-05	3.4172E+20	2.0927E+14
Cs-137	1.1826E+04	1.3596E-01	5.9766E+23	4.3758E+14
Cs-134m	3.4126E-02	4.2318E-12	1.9018E+13	1.2627E+09
Rb-88	7.4041E-02	6.1681E-13	4.2211E+12	2.7395E+09
Ba-137m	1.2758E+04	2.3723E-08	1.0428E+17	4.7206E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5295E-01

Environment Integral Nuclide Release:

	Ci	kg	Atoms	Bq
Time (h) = 2.0020				
Kr-85	1.0517E+03	2.6806E-03	1.8991E+22	3.8912E+13
Kr-85m	4.3051E+00	5.2313E-10	3.7063E+15	1.5929E+11
Kr-88	1.3192E-01	1.0520E-11	7.1995E+13	4.8810E+09
I-131	2.5232E+02	2.0353E-06	9.3563E+18	9.3360E+12
I-132	1.2952E+02	1.2548E-08	5.7246E+16	4.7923E+12
I-133	6.9811E+01	6.1626E-08	2.7904E+17	2.5830E+12
I-135	1.7932E+00	5.1062E-10	2.2778E+15	6.6349E+10
Xe-133	6.4343E+04	3.4375E-04	1.5565E+21	2.3807E+15
Xe-135	3.5762E+03	1.4004E-06	6.2469E+18	1.3232E+14
I-130	5.6251E-01	2.8842E-10	1.3361E+15	2.0813E+10
Kr-83m	1.0448E-02	5.0640E-13	3.6742E+12	3.8658E+08
Xe-131m	4.1442E+02	4.9477E-06	2.2745E+19	1.5334E+13
Xe-133m	1.6677E+03	3.7166E-06	1.6829E+19	6.1704E+13
Xe-135m	5.9335E+01	6.5137E-10	2.9057E+15	2.1954E+12
Rb-88	1.1602E-01	9.6650E-13	6.6141E+12	4.2926E+09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Br-82	4.8958E-01	4.5221E-10	3.3211E+15	1.8115E+10
Br-83	1.2217E-05	7.7337E-16	5.6112E+09	4.5205E+05

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 2.0020	Release	Rate/s	Release
Noble gases (atoms)	2.0644E+19	2.8672E+17	2.0594E+22
Elemental I (atoms)	7.0534E+15	9.7964E+13	7.0359E+18
Organic I (atoms)	2.6702E+15	3.7086E+13	2.6636E+18
Aerosols (kg)	5.5673E-18	7.7323E-20	9.6650E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Rb-86	1.9496E+02	2.3961E-06	1.6779E+19	7.2136E+12
Cs-134	2.1867E+04	1.6901E-02	7.5954E+22	8.0907E+14
Cs-136	5.6560E+03	7.7172E-05	3.4172E+20	2.0927E+14
Cs-137	1.1826E+04	1.3596E-01	5.9766E+23	4.3758E+14
Cs-134m	3.4126E-02	4.2318E-12	1.9018E+13	1.2627E+09
Rb-88	7.4041E-02	6.1681E-13	4.2211E+12	2.7395E+09
Ba-137m	1.2758E+04	2.3723E-08	1.0428E+17	4.7206E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5295E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	1.0196E-01	8.2243E-10	3.7807E+15	3.7725E+09
I-132	5.4542E-02	5.2840E-12	2.4107E+13	2.0181E+09
I-133	2.8209E-02	2.4902E-11	1.1275E+14	1.0437E+09
I-135	7.2460E-04	2.0633E-13	9.2040E+11	2.6810E+07
I-130	2.2730E-04	1.1654E-13	5.3988E+11	8.4100E+06
Br-82	1.9783E-04	1.8273E-13	1.3420E+12	7.3197E+06
Br-83	4.9368E-09	3.1250E-19	2.2674E+06	1.8266E+02

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.8438E+15
Organic I (atoms)	1.0766E+15
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Pathway

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	2.0020	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
Rb-86	2.1663E+01	2.6623E-07	1.8643E+18	8.0151E+11
I-131	2.6088E+01	2.1043E-07	9.6735E+17	9.6525E+11
I-132	1.3369E+01	1.2951E-09	5.9087E+15	4.9463E+11
I-133	7.2178E+00	6.3716E-09	2.8850E+16	2.6706E+11
I-135	1.8540E-01	5.2793E-11	2.3550E+14	6.8599E+09
Cs-134	2.4296E+03	1.8779E-03	8.4394E+21	8.9896E+13
Cs-136	6.2845E+02	8.5747E-06	3.7969E+19	2.3253E+13
Cs-137	1.3141E+03	1.5107E-02	6.6407E+22	4.8620E+13
I-130	5.8159E-02	2.9820E-11	1.3814E+14	2.1519E+09
Cs-134m	3.7918E-03	4.7020E-13	2.1131E+12	1.4030E+08
Rb-88	8.2268E-03	6.8535E-14	4.6901E+11	3.0439E+08
Ba-137m	1.4176E+03	2.6359E-09	1.1587E+16	5.2451E+13
Br-82	5.0619E-02	4.6755E-11	3.4337E+14	1.8729E+09
Br-83	1.2632E-06	7.9959E-17	5.8015E+08	4.6737E+04

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) =	2.0020
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	7.2744E+17
Organic I (atoms)	2.7539E+17
Aerosols (kg)	1.6994E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
Kr-85	2.2395E-01	5.7081E-07	4.0441E+18	8.2861E+09
Kr-85m	9.1676E-04	1.1140E-13	7.8925E+11	3.3920E+07
Kr-88	2.8092E-05	2.2403E-15	1.5331E+10	1.0394E+06
I-131	1.5393E-02	1.2416E-10	5.7078E+14	5.6954E+08
I-132	9.8374E-03	9.5304E-13	4.3480E+12	3.6398E+08
I-133	4.2584E-03	3.7591E-12	1.7021E+13	1.5756E+08
I-135	1.0938E-04	3.1147E-14	1.3894E+11	4.0472E+06
Xe-133	1.3721E+01	7.3301E-08	3.3190E+17	5.0766E+11
Xe-135	7.6788E-01	3.0069E-10	1.3413E+15	2.8411E+10
I-130	3.4313E-05	1.7593E-14	8.1499E+10	1.2696E+06
Kr-83m	2.4535E-06	1.1892E-16	8.6280E+08	9.0778E+04
Xe-131m	8.8593E-02	1.0577E-09	4.8622E+15	3.2779E+09
Xe-133m	3.5648E-01	7.9445E-10	3.5972E+15	1.3190E+10
Xe-135m	3.4812E-02	3.8216E-13	1.7047E+12	1.2880E+09
Rb-88	1.0243E-05	8.5332E-17	5.8396E+08	3.7900E+05
Br-82	2.9864E-05	2.7585E-14	2.0258E+11	1.1050E+06
Br-83	7.4525E-10	4.7175E-20	3.4228E+05	2.7574E+01

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
Time (h) =	2.0020		
Noble gases (atoms)	4.3858E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.2985E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	1.6273E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	8.5332E-17	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) =	Ci	kg	Atoms	Bq
I-131	1.1796E-01	9.5148E-10	4.3740E+15	4.3645E+09
I-132	5.3445E-02	5.1777E-12	2.3622E+13	1.9775E+09
I-133	3.2638E-02	2.8811E-11	1.3046E+14	1.2076E+09
I-135	8.3836E-04	2.3872E-13	1.0649E+12	3.1019E+07
I-130	2.6299E-04	1.3484E-13	6.2464E+11	9.7305E+06
Rb-88	1.1678E-05	9.7286E-17	6.6576E+08	4.3209E+05
Br-82	2.2889E-04	2.1142E-13	1.5527E+12	8.4689E+06

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Br-83 5.7119E-09 3.6156E-19 2.6234E+06 2.1134E+02

Deposition Recirculating
 Surfaces Filter
 Time (h) = 2.0020
 Noble gases (atoms) 0.0000E+00 0.0000E+00
 Elemental I (atoms) 0.0000E+00 3.2870E+15
 Organic I (atoms) 0.0000E+00 1.2443E+15
 Aerosols (kg) 0.0000E+00 9.7286E-17

Control Room Unfiltered Makeup Transport Group Inventory:

Pathway
 Filter
 Time (h) = 2.0020
 Noble gases (atoms) 0.0000E+00
 Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
2.0020				
I-131	1.0196E-01	8.2243E-10	3.7807E+15	3.7725E+09
I-132	5.4542E-02	5.2840E-12	2.4107E+13	2.0181E+09
I-133	2.8209E-02	2.4902E-11	1.1275E+14	1.0437E+09
I-135	7.2460E-04	2.0633E-13	9.2040E+11	2.6810E+07
I-130	2.2730E-04	1.1654E-13	5.3988E+11	8.4100E+06
Br-82	1.9783E-04	1.8273E-13	1.3420E+12	7.3197E+06
Br-83	4.9368E-09	3.1250E-19	2.2674E+06	1.8266E+02

Control Room Filtered Makeup Transport Group Inventory:

Pathway
 Filter
 Time (h) = 2.0020
 Noble gases (atoms) 0.0000E+00
 Elemental I (atoms) 2.8438E+15
 Organic I (atoms) 1.0766E+15
 Aerosols (kg) 0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Pathway
 Filter
 Time (h) = 2.0020
 Noble gases (atoms) 0.0000E+00
 Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Pathway
 Filter
 Time (h) = 2.0020
 Noble gases (atoms) 0.0000E+00
 Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0020				
I-131	2.1992E-01	1.7739E-09	8.1547E+15	8.1370E+09
I-132	1.0799E-01	1.0462E-11	4.7729E+13	3.9955E+09
I-133	6.0847E-02	5.3713E-11	2.4321E+14	2.2513E+09
I-135	1.5630E-03	4.4505E-13	1.9853E+12	5.7830E+07
I-130	4.9028E-04	2.5138E-13	1.1645E+12	1.8140E+07
Rb-88	1.1678E-05	9.7286E-17	6.6576E+08	4.3209E+05
Br-82	4.2672E-04	3.9415E-13	2.8947E+12	1.5789E+07
Br-83	1.0649E-08	6.7406E-19	4.8907E+06	3.9400E+02

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0020				
Kr-85	8.7665E-03	2.2345E-08	1.5831E+17	3.2436E+08
Kr-85m	3.5887E-05	4.3607E-15	3.0895E+10	1.3278E+06

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Kr-88	1.0996E-06	8.7697E-17	6.0014E+08	4.0687E+04
Rb-86	1.8134E-03	2.2286E-11	1.5606E+14	6.7095E+07
I-131	2.3235E-03	1.8742E-11	8.6157E+13	8.5970E+07
I-132	1.5797E-03	1.5304E-13	6.9820E+11	5.8449E+07
I-133	6.4277E-04	5.6741E-13	2.5692E+12	2.3782E+07
I-135	1.6511E-05	4.7014E-15	2.0972E+10	6.1089E+05
Xe-133	5.5137E-01	2.9456E-09	1.3338E+16	2.0401E+10
Xe-135	3.4466E-02	1.3496E-11	6.0204E+13	1.2752E+09
Cs-134	2.0338E-01	1.5720E-07	7.0646E+17	7.5252E+09
Cs-136	5.2607E-02	7.1779E-10	3.1784E+15	1.9465E+09
Cs-137	1.1000E-01	1.2646E-06	5.5589E+18	4.0700E+09
I-130	5.1792E-06	2.6555E-15	1.2302E+10	1.9163E+05
Kr-83m	2.7334E-07	1.3249E-17	9.6126E+07	1.0114E+04
Xe-131m	3.7281E-03	4.4508E-11	2.0461E+14	1.3794E+08
Xe-133m	1.4977E-02	3.3377E-11	1.5113E+14	5.5413E+08
Xe-135m	3.0721E-02	3.3725E-13	1.5044E+12	1.1367E+09
Cs-134m	3.1741E-07	3.9360E-17	1.7689E+08	1.1744E+04
Rb-88	3.0079E-06	2.5058E-17	1.7148E+08	1.1129E+05
Ba-137m	3.3918E-03	6.3068E-15	2.7723E+10	1.2550E+08
Br-82	4.5077E-06	4.1637E-15	3.0578E+10	1.6679E+05

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0020			
Noble gases (atoms)	1.7206E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	6.4914E+13	0.0000E+00	1.9512E+20
Organic I (atoms)	2.4574E+13	0.0000E+00	0.0000E+00
Aerosols (kg)	1.4226E-06	0.0000E+00	0.0000E+00

	Surfaces	Filter
Time (h) = 2.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

	Ci	kg	Atoms	Bq
Time (h) = 2.0020				
Rb-86	2.1663E+01	2.6623E-07	1.8643E+18	8.0151E+11
I-131	2.6088E+01	2.1043E-07	9.6735E+17	9.6525E+11
I-132	1.3369E+01	1.2951E-09	5.9087E+15	4.9463E+11
I-133	7.2178E+00	6.3716E-09	2.8850E+16	2.6706E+11
I-135	1.8540E-01	5.2793E-11	2.3550E+14	6.8599E+09
Cs-134	2.4296E+03	1.8779E-03	8.4394E+21	8.9896E+13
Cs-136	6.2845E+02	8.5747E-06	3.7969E+19	2.3253E+13
Cs-137	1.3141E+03	1.5107E-02	6.6407E+22	4.8620E+13
I-130	5.8159E-02	2.9820E-11	1.3814E+14	2.1519E+09
Cs-134m	3.7918E-03	4.7020E-13	2.1131E+12	1.4030E+08
Rb-88	8.2268E-03	6.8535E-14	4.6901E+11	3.0439E+08
Ba-137m	1.4176E+03	2.6359E-09	1.1587E+16	5.2451E+13
Br-82	5.0619E-02	4.6755E-11	3.4337E+14	1.8729E+09
Br-83	1.2632E-06	7.9959E-17	5.8015E+08	4.6737E+04

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	7.2744E+17
Organic I (atoms)	2.7539E+17
Aerosols (kg)	1.6994E-02

Detailed model information at time (H) = 8.0000

EAB Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 8.0000				
Delta dose (rem)	3.4587E-02	4.9267E-01	6.0721E-02	4.9688E-02
Accumulated dose (rem)	3.9474E-01	5.4788E+01	1.1014E+00	2.0743E+00

LPZ Doses:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.9443E-03	2.7695E-02	3.4134E-03	2.7932E-03
Accumulated dose (rem)		4.6414E-02	6.7329E+00	1.3192E-01	2.5281E-01

Control Room Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		6.1446E-03	4.7534E+00	6.0286E-01	1.5178E-01
Accumulated dose (rem)		4.1599E-02	1.0993E+02	4.2337E+00	3.4110E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Xe-133		1.1170E+00	5.9677E-09	2.7021E+16	4.1331E+10
Xe-135		2.2557E-01	8.8330E-11	3.9403E+14	8.3461E+09
Kr-83m		2.9776E-06	1.4432E-16	1.0471E+09	1.1017E+05
Xe-131m		2.4307E-02	2.9019E-10	1.3340E+15	8.9935E+08
Xe-133m		7.9974E-02	1.7823E-10	8.0702E+14	2.9590E+09
Xe-135m		1.4647E+00	1.6079E-11	7.1726E+13	5.4193E+10

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		2.9628E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	1.7172E+21
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	8.0000	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		1.9588E+02	2.4073E-06	1.6857E+19	7.2475E+12
Cs-134		2.2169E+04	1.7134E-02	7.7005E+22	8.2026E+14
Cs-136		5.6602E+03	7.7229E-05	3.4198E+20	2.0943E+14
Cs-137		1.1993E+04	1.3787E-01	6.0606E+23	4.4373E+14
Cs-134m		8.2517E-03	1.0232E-12	4.5985E+12	3.0531E+08
Rb-88		6.4466E-08	5.3704E-19	3.6752E+06	2.3852E+03
Ba-137m		1.3294E+04	2.4719E-08	1.0866E+17	4.9188E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =	8.0000	Pathway
Noble gases (atoms)		Filter 0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		1.5509E-01

Environment Integral Nuclide Release:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Kr-85		1.0614E+03	2.7054E-03	1.9167E+22	3.9272E+13
Xe-133		6.3291E+04	3.3812E-04	1.5310E+21	2.3418E+15
Xe-135		2.3824E+03	9.3292E-07	4.1616E+18	8.8149E+13
Kr-83m		1.8585E-03	9.0080E-14	6.5359E+11	6.8766E+07
Xe-131m		4.2038E+02	5.0188E-06	2.3072E+19	1.5554E+13
Xe-133m		1.5834E+03	3.5289E-06	1.5979E+19	5.8587E+13
Xe-135m		3.0471E+01	3.3451E-10	1.4922E+15	1.1274E+12

Environment Transport Group Inventory:

Time (h) =	8.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)		3.2938E+16	4.5748E+14	2.0741E+22

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms)	5.0187E+00	6.9704E-02	6.8808E+18
Organic I (atoms)	1.8999E+00	2.6388E-02	2.6048E+18
Aerosols (kg)	4.2723E-25	5.9337E-27	2.9327E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		1.9588E+02	2.4073E-06	1.6857E+19	7.2475E+12
Cs-134		2.2169E+04	1.7134E-02	7.7005E+22	8.2026E+14
Cs-136		5.6602E+03	7.7229E-05	3.4198E+20	2.0943E+14
Cs-137		1.1993E+04	1.3787E-01	6.0606E+23	4.4373E+14
Cs-134m		8.2517E-03	1.0232E-12	4.5985E+12	3.0531E+08
Rb-88		6.4466E-08	5.3704E-19	3.6752E+06	2.3852E+03
Ba-137m		1.3294E+04	2.4719E-08	1.0866E+17	4.9188E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) =	8.0000
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5509E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	8.0000
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	8.0000	Ci	kg	Atoms	Bq
I-131		1.0119E-01	8.1622E-10	3.7522E+15	3.7440E+09
I-132		9.1074E-03	8.8232E-13	4.0253E+12	3.3698E+08
I-133		2.3423E-02	2.0677E-11	9.3624E+13	8.6666E+08
I-135		3.9175E-04	1.1155E-13	4.9761E+11	1.4495E+07
I-130		1.6466E-04	8.4425E-14	3.9109E+11	6.0923E+06
Br-82		1.7832E-04	1.6471E-13	1.2097E+12	6.5980E+06
Br-83		8.7910E-10	5.5647E-20	4.0375E+05	3.2527E+01

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	8.0000
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.7942E+15
Organic I (atoms)	1.0578E+15
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	8.0000
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	8.0000
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		2.1764E+01	2.6748E-07	1.8730E+18	8.0528E+11
I-131		2.5891E+01	2.0884E-07	9.6005E+17	9.5796E+11
I-132		2.2340E+00	2.1643E-10	9.8739E+14	8.2658E+10
I-133		5.9932E+00	5.2906E-09	2.3955E+16	2.2175E+11
I-135		1.0024E-01	2.8542E-11	1.2732E+14	3.7087E+09
Cs-134		2.4632E+03	1.9038E-03	8.5561E+21	9.1140E+13
Cs-136		6.2891E+02	8.5810E-06	3.7997E+19	2.3270E+13
Cs-137		1.3325E+03	1.5319E-02	6.7340E+22	4.9303E+13
I-130		4.2131E-02	2.1602E-11	1.0007E+14	1.5588E+09
Cs-134m		9.1685E-04	1.1369E-13	5.1095E+11	3.3924E+07
Rb-88		7.1629E-09	5.9672E-20	4.0835E+05	2.6503E+02
Ba-137m		1.4771E+03	2.7466E-09	1.2073E+16	5.4654E+13
Br-82		4.5627E-02	4.2145E-11	3.0951E+14	1.6882E+09
Br-83		2.2493E-07	1.4238E-17	1.0331E+08	8.3226E+03

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		7.1489E+17
Organic I (atoms)		2.7064E+17
Aerosols (kg)		1.7232E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Kr-85		6.0355E-08	1.5384E-13	1.0899E+12	2.2331E+03
Xe-133		2.0890E-02	1.1160E-10	5.0533E+14	7.7292E+08
Xe-135		4.6350E-03	1.8150E-12	8.0963E+12	1.7149E+08
Kr-83m		5.3124E-08	2.5748E-18	1.8682E+07	1.9656E+03
Xe-131m		4.4952E-04	5.3667E-12	2.4671E+13	1.6632E+07
Xe-133m		1.4905E-03	3.3217E-12	1.5041E+13	5.5148E+07
Xe-135m		1.2964E-02	1.4231E-13	6.3484E+11	4.7966E+08

Control Room Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		5.5486E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)		9.4507E+01	0.0000E+00	0.0000E+00
Organic I (atoms)		3.5777E+01	0.0000E+00	0.0000E+00
Aerosols (kg)		8.0612E-24	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) =	8.0000	Ci	kg	Atoms	Bq
I-131		1.2319E-01	9.9368E-10	4.5680E+15	4.5581E+09
I-132		9.6007E-03	9.3011E-13	4.2434E+12	3.5523E+08
I-133		2.8518E-02	2.5174E-11	1.1399E+14	1.0552E+09
I-135		4.7695E-04	1.3581E-13	6.0583E+11	1.7647E+07
I-130		2.0047E-04	1.0279E-13	4.7615E+11	7.4174E+06
Br-82		2.1711E-04	2.0054E-13	1.4728E+12	8.0330E+06
Br-83		1.0703E-09	6.7750E-20	4.9157E+05	3.9601E+01

Deposition Recirculating

Time (h) =	8.0000	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	3.4012E+15
Organic I (atoms)		0.0000E+00	1.2876E+15
Aerosols (kg)		0.0000E+00	5.8426E-22

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	8.0000	Ci	kg	Atoms	Bq
I-131		1.0119E-01	8.1622E-10	3.7522E+15	3.7440E+09
I-132		9.1074E-03	8.8232E-13	4.0253E+12	3.3698E+08
I-133		2.3423E-02	2.0677E-11	9.3624E+13	8.6666E+08
I-135		3.9175E-04	1.1155E-13	4.9761E+11	1.4495E+07
I-130		1.6466E-04	8.4425E-14	3.9109E+11	6.0923E+06
Br-82		1.7832E-04	1.6471E-13	1.2097E+12	6.5980E+06
Br-83		8.7910E-10	5.5647E-20	4.0375E+05	3.2527E+01

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	2.7942E+15	
Organic I (atoms)	1.0578E+15	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Exhaust Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Total Filter Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
I-131		2.2438E-01	1.8099E-09	8.3202E+15	8.3021E+09
I-132		1.8708E-02	1.8124E-12	8.2687E+12	6.9220E+08
I-133		5.1941E-02	4.5851E-11	2.0761E+14	1.9218E+09
I-135		8.6870E-04	2.4736E-13	1.1034E+12	3.2142E+07
I-130		3.6513E-04	1.8721E-13	8.6724E+11	1.3510E+07
Br-82		3.9543E-04	3.6525E-13	2.6824E+12	1.4631E+07
Br-83		1.9494E-09	1.2340E-19	8.9532E+05	7.2128E+01

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Xe-133		1.2412E-01	6.6308E-10	3.0024E+15	4.5923E+09
Xe-135		2.5063E-02	9.8145E-12	4.3781E+13	9.2735E+08
Kr-83m		3.3084E-07	1.6035E-17	1.1635E+08	1.2241E+04
Xe-131m		2.7008E-03	3.2244E-11	1.4823E+14	9.9928E+07
Xe-133m		8.8860E-03	1.9804E-11	8.9669E+13	3.2878E+08
Xe-135m		1.6274E-01	1.7866E-12	7.9696E+12	6.0215E+09

Fuel Pool-Filtered Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	3.2920E+15	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.9080E+20	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	8.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	2.1764E+01	2.6748E-07	1.8730E+18	8.0528E+11
I-131	2.5891E+01	2.0884E-07	9.6005E+17	9.5796E+11
I-132	2.2340E+00	2.1643E-10	9.8739E+14	8.2658E+10
I-133	5.9932E+00	5.2906E-09	2.3955E+16	2.2175E+11
I-135	1.0024E-01	2.8542E-11	1.2732E+14	3.7087E+09
Cs-134	2.4632E+03	1.9038E-03	8.5561E+21	9.1140E+13
Cs-136	6.2891E+02	8.5810E-06	3.7997E+19	2.3270E+13
Cs-137	1.3325E+03	1.5319E-02	6.7340E+22	4.9303E+13
I-130	4.2131E-02	2.1602E-11	1.0007E+14	1.5588E+09
Cs-134m	9.1685E-04	1.1369E-13	5.1095E+11	3.3924E+07
Rb-88	7.1629E-09	5.9672E-20	4.0835E+05	2.6503E+02
Ba-137m	1.4771E+03	2.7466E-09	1.2073E+16	5.4654E+13
Br-82	4.5627E-02	4.2145E-11	3.0951E+14	1.6882E+09
Br-83	2.2493E-07	1.4238E-17	1.0331E+08	8.3226E+03

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	7.1489E+17
Organic I (atoms)	2.7064E+17
Aerosols (kg)	1.7232E-02

Detailed model information at time (H) = 24.0000

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	3.0567E-02	1.9395E-16	5.2440E-02	3.0567E-02
Accumulated dose (rem)	4.2531E-01	5.4788E+01	1.1539E+00	2.1048E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	1.1569E-03	7.3406E-18	1.9847E-03	1.1569E-03
Accumulated dose (rem)	4.7570E-02	6.7329E+00	1.3391E-01	2.5397E-01

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	4.6355E-04	9.8024E-13	3.0259E-02	4.6355E-04
Accumulated dose (rem)	4.2063E-02	1.0993E+02	4.2639E+00	3.4115E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
24.0000				
Xe-133	6.5540E-01	3.5014E-09	1.5854E+16	2.4250E+10
Xe-135	4.2133E-02	1.6498E-11	7.3597E+13	1.5589E+09
Kr-83m	2.8748E-08	1.3933E-18	1.0110E+07	1.0637E+03
Xe-131m	2.2949E-02	2.7398E-10	1.2595E+15	8.4912E+08
Xe-133m	4.6923E-02	1.0457E-10	4.7350E+14	1.7361E+09
Xe-135m	2.7357E-01	3.0033E-12	1.3397E+13	1.0122E+10

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
24.0000			
Noble gases (atoms)	1.7674E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.6044E+21
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Recirculating Filter
24.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.9109E+02	2.3484E-06	1.6445E+19	7.0702E+12
Cs-134	2.2155E+04	1.7124E-02	7.6957E+22	8.1975E+14
Cs-136	5.4640E+03	7.4553E-05	3.3012E+20	2.0217E+14
Cs-137	1.1992E+04	1.3787E-01	6.0603E+23	4.4371E+14
Cs-134m	1.8017E-04	2.2342E-14	1.0041E+11	6.6664E+06
Ba-137m	1.3294E+04	2.4718E-08	1.0865E+17	4.9186E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5507E-01

Environment Integral Nuclide Release:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	5.8814E+04	3.1421E-04	1.4227E+21	2.1761E+15
Xe-135	7.6014E+02	2.9766E-07	1.3278E+18	2.8125E+13
Kr-83m	1.8046E-05	8.7465E-16	6.3461E+09	6.6770E+05
Xe-131m	4.2507E+02	5.0748E-06	2.3329E+19	1.5728E+13
Xe-133m	1.3315E+03	2.9674E-06	1.3436E+19	4.9264E+13
Xe-135m	5.6929E+00	6.2496E-11	2.7879E+14	2.1064E+11

Environment Transport Group Inventory:

Time (h) = 24.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	1.9648E+16	2.7289E+14	2.0626E+22
Elemental I (atoms)	7.2764E-34	1.0106E-35	6.4287E+18
Organic I (atoms)	2.7546E-34	3.8259E-36	2.4337E+18
Aerosols (kg)	2.3822E-44	3.3086E-46	5.9065E-15

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.9109E+02	2.3484E-06	1.6445E+19	7.0702E+12
Cs-134	2.2155E+04	1.7124E-02	7.6957E+22	8.1975E+14
Cs-136	5.4640E+03	7.4553E-05	3.3012E+20	2.0217E+14
Cs-137	1.1992E+04	1.3787E-01	6.0603E+23	4.4371E+14
Cs-134m	1.8017E-04	2.2342E-14	1.0041E+11	6.6664E+06
Ba-137m	1.3294E+04	2.4718E-08	1.0865E+17	4.9186E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5507E-01

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	9.5539E-02	7.7063E-10	3.5426E+15	3.5349E+09
I-132	7.3329E-05	7.1040E-15	3.2410E+10	2.7132E+06
I-133	1.3743E-02	1.2132E-11	5.4932E+13	5.0849E+08

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-135	7.3171E-05	2.0835E-14	9.2944E+10	2.7073E+06
I-130	6.7127E-05	3.4418E-14	1.5944E+11	2.4837E+06
Br-82	1.3025E-04	1.2030E-13	8.8352E+11	4.8191E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.6105E+15
Organic I (atoms)	9.8824E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	2.1232E+01	2.6094E-07	1.8272E+18	7.8558E+11
I-131	2.4445E+01	1.9718E-07	9.0643E+17	9.0446E+11
I-132	1.7987E-02	1.7426E-12	7.9500E+12	6.6552E+08
I-133	3.5164E+00	3.1042E-09	1.4055E+16	1.3011E+11
I-135	1.8722E-02	5.3311E-12	2.3781E+13	6.9272E+08
Cs-134	2.4617E+03	1.9027E-03	8.5508E+21	9.1084E+13
Cs-136	6.0712E+02	8.2836E-06	3.6680E+19	2.2463E+13
Cs-137	1.3325E+03	1.5319E-02	6.7337E+22	4.9301E+13
I-130	1.7176E-02	8.8065E-12	4.0795E+13	6.3550E+08
Cs-134m	2.0019E-05	2.4824E-15	1.1156E+10	7.4071E+05
Ba-137m	1.4771E+03	2.7465E-09	1.2073E+16	5.4651E+13
Br-82	3.3326E-02	3.0782E-11	2.2607E+14	1.2331E+09
Br-83	2.1717E-09	1.3747E-19	9.9740E+05	8.0352E+01

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	6.6793E+17
Organic I (atoms)	2.5286E+17
Aerosols (kg)	1.7230E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	4.7286E-03	2.5262E-11	1.1439E+14	1.7496E+08
Xe-135	3.3403E-04	1.3080E-13	5.8348E+11	1.2359E+07
Xe-131m	1.6376E-04	1.9551E-12	8.9876E+12	6.0591E+06
Xe-133m	3.3742E-04	7.5199E-13	3.4050E+12	1.2485E+07
Xe-135m	9.3476E-04	1.0262E-14	4.5776E+10	3.4586E+07

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 24.0000			
Noble gases (atoms)	1.2741E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.3702E-32	0.0000E+00	0.0000E+00
Organic I (atoms)	5.1873E-33	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Aerosols (kg) 4.4001E-43 0.0000E+00 0.0000E+00

Recirculating Filter Inventory

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	1.1631E-01	9.3818E-10	4.3129E+15	4.3035E+09
I-132	7.7301E-05	7.4888E-15	3.4166E+10	2.8601E+06
I-133	1.6732E-02	1.4770E-11	6.6880E+13	6.1909E+08
I-135	8.9086E-05	2.5367E-14	1.1316E+11	3.2962E+06
I-130	8.1727E-05	4.1904E-14	1.9412E+11	3.0239E+06
Br-82	1.5857E-04	1.4647E-13	1.0757E+12	5.8672E+06

Time (h) = 24.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	3.1780E+15
Organic I (atoms)	0.0000E+00	1.2031E+15
Aerosols (kg)	0.0000E+00	3.6391E-38

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	9.5539E-02	7.7063E-10	3.5426E+15	3.5349E+09
I-132	7.3329E-05	7.1040E-15	3.2410E+10	2.7132E+06
I-133	1.3743E-02	1.2132E-11	5.4932E+13	5.0849E+08
I-135	7.3171E-05	2.0835E-14	9.2944E+10	2.7073E+06
I-130	6.7127E-05	3.4418E-14	1.5944E+11	2.4837E+06
Br-82	1.3025E-04	1.2030E-13	8.8352E+11	4.8191E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.6105E+15
Organic I (atoms)	9.8824E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	2.1185E-01	1.7088E-09	7.8555E+15	7.8384E+09
I-132	1.5063E-04	1.4593E-14	6.6576E+10	5.5733E+06
I-133	3.0475E-02	2.6902E-11	1.2181E+14	1.1276E+09
I-135	1.6226E-04	4.6203E-14	2.0610E+11	6.0035E+06
I-130	1.4885E-04	7.6322E-14	3.5356E+11	5.5076E+06

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Br-82 2.8882E-04 2.6677E-13 1.9592E+12 1.0686E+07

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	7.2823E-02	3.8905E-10	1.7616E+15	2.6944E+09
Xe-135	4.6814E-03	1.8332E-12	8.1775E+12	1.7321E+08
Kr-83m	3.1942E-09	1.5482E-19	1.1233E+06	1.1818E+02
Xe-131m	2.5499E-03	3.0443E-11	1.3995E+14	9.4347E+07
Xe-133m	5.2137E-03	1.1619E-11	5.2611E+13	1.9291E+08
Xe-135m	3.0397E-02	3.3370E-13	1.4886E+12	1.1247E+09

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.9638E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.7826E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 24.0000	Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	2.1232E+01	2.6094E-07	1.8272E+18	7.8558E+11
I-131	2.4445E+01	1.9718E-07	9.0643E+17	9.0446E+11
I-132	1.7987E-02	1.7426E-12	7.9500E+12	6.6552E+08
I-133	3.5164E+00	3.1042E-09	1.4055E+16	1.3011E+11
I-135	1.8722E-02	5.3311E-12	2.3781E+13	6.9272E+08
Cs-134	2.4617E+03	1.9027E-03	8.5508E+21	9.1084E+13
Cs-136	6.0712E+02	8.2836E-06	3.6680E+19	2.2463E+13
Cs-137	1.3325E+03	1.5319E-02	6.7337E+22	4.9301E+13
I-130	1.7176E-02	8.8065E-12	4.0795E+13	6.3550E+08
Cs-134m	2.0019E-05	2.4824E-15	1.1156E+10	7.4071E+05
Ba-137m	1.4771E+03	2.7465E-09	1.2073E+16	5.4651E+13
Br-82	3.3326E-02	3.0782E-11	2.2607E+14	1.2331E+09
Br-83	2.1717E-09	1.3747E-19	9.9740E+05	8.0352E+01

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	6.6793E+17
Organic I (atoms)	2.5286E+17
Aerosols (kg)	1.7230E-02

Detailed model information at time (H) = 96.0000

EAB Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	9.7779E-03	2.9659E-38	2.2081E-02	9.7779E-03
Accumulated dose (rem)	4.3509E-01	5.4788E+01	1.1759E+00	2.1146E+00

LPZ Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.5728E-04	4.7708E-40	3.5518E-04	1.5728E-04
Accumulated dose (rem)	4.7728E-02	6.7329E+00	1.3426E-01	2.5412E-01

Control Room Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.8127E-05	7.0388E-35	6.9191E-03	7.8127E-05
Accumulated dose (rem)	4.2141E-02	1.0993E+02	4.2709E+00	3.4115E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	5.9495E-02	3.1785E-10	1.4392E+15	2.2013E+09
Xe-135	2.2163E-05	8.6786E-15	3.8714E+10	8.2002E+05
Xe-131m	1.7719E-02	2.1154E-10	9.7248E+14	6.5561E+08
Xe-133m	4.2595E-03	9.4929E-12	4.2983E+13	1.5760E+08
Xe-135m	1.4391E-04	1.5798E-15	7.0472E+09	5.3245E+06

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	2.4547E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.2217E+21
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.7094E+02	2.1008E-06	1.4711E+19	6.3246E+12
Cs-134	2.2094E+04	1.7077E-02	7.6745E+22	8.1749E+14
Cs-136	4.6620E+03	6.3610E-05	2.8167E+20	1.7250E+14
Cs-137	1.1990E+04	1.3784E-01	6.0592E+23	4.4362E+14
Ba-137m	1.3291E+04	2.4714E-08	1.0863E+17	4.9177E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5499E-01

Environment Integral Nuclide Release:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	4.0614E+04	2.1698E-04	9.8246E+20	1.5027E+15
Xe-135	3.4893E+00	1.3663E-09	6.0951E+15	1.2910E+11
Xe-131m	4.3126E+02	5.1487E-06	2.3669E+19	1.5957E+13
Xe-133m	5.5327E+02	1.2330E-06	5.5831E+18	2.0471E+13
Xe-135m	2.9947E-03	3.2876E-14	1.4665E+11	1.1081E+08

Environment Transport Group Inventory:

Time (h) = 96.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.7284E+15	3.7894E+13	2.0166E+22
Elemental I (atoms)	0.0000E+00	0.0000E+00	4.8955E+18
Organic I (atoms)	0.0000E+00	0.0000E+00	1.8533E+18
Aerosols (kg)	0.0000E+00	0.0000E+00	1.3791E-22

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.7094E+02	2.1008E-06	1.4711E+19	6.3246E+12
Cs-134	2.2094E+04	1.7077E-02	7.6745E+22	8.1749E+14
Cs-136	4.6620E+03	6.3610E-05	2.8167E+20	1.7250E+14
Cs-137	1.1990E+04	1.3784E-01	6.0592E+23	4.4362E+14
Ba-137m	1.3291E+04	2.4714E-08	1.0863E+17	4.9177E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5499E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	7.3766E-02	5.9501E-10	2.7353E+15	2.7293E+09
I-133	1.2475E-03	1.1013E-12	4.9865E+12	4.6159E+07
I-135	3.8490E-08	1.0960E-17	4.8890E+07	1.4241E+03
I-130	1.1839E-06	6.0704E-16	2.8120E+09	4.3805E+04
Br-82	3.1679E-05	2.9261E-14	2.1489E+11	1.1721E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.9879E+15
Organic I (atoms)	7.5256E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.8993E+01	2.3342E-07	1.6345E+18	7.0274E+11
I-131	1.8874E+01	1.5224E-07	6.9986E+17	6.9834E+11
I-133	3.1921E-01	2.8178E-10	1.2759E+15	1.1811E+10
I-135	9.8483E-06	2.8043E-15	1.2510E+10	3.6439E+05
Cs-134	2.4549E+03	1.8974E-03	8.5272E+21	9.0833E+13
Cs-136	5.1800E+02	7.0678E-06	3.1296E+19	1.9166E+13
Cs-137	1.3322E+03	1.5316E-02	6.7324E+22	4.9292E+13
I-130	3.0293E-04	1.5532E-13	7.1951E+11	1.1208E+07
Ba-137m	1.4768E+03	2.7460E-09	1.2070E+16	5.4641E+13
Br-82	8.1055E-03	7.4868E-12	5.4984E+13	2.9990E+08

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.0863E+17
Organic I (atoms)	1.9255E+17

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Aerosols (kg) 1.7221E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	3.2469E-04	1.7346E-12	7.8542E+12	1.2014E+07
Xe-135	1.3291E-07	5.2044E-17	2.3216E+08	4.9175E+03
Xe-131m	9.5641E-05	1.1418E-12	5.2490E+12	3.5387E+06
Xe-133m	2.3169E-05	5.1635E-14	2.3380E+11	8.5726E+05
Xe-135m	3.7203E-07	4.0841E-18	1.8218E+07	1.3765E+04

Control Room Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.3337E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	8.9804E-02	7.2437E-10	3.3300E+15	3.3227E+09
I-133	1.5189E-03	1.3408E-12	6.0711E+12	5.6199E+07
I-135	4.6861E-08	1.3344E-17	5.9524E+07	1.7339E+03
I-130	1.4414E-06	7.3906E-16	3.4237E+09	5.3333E+04
Br-82	3.8569E-05	3.5625E-14	2.6163E+11	1.4270E+06

Deposition Recirculating

Time (h) = 96.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.4201E+15
Organic I (atoms)	0.0000E+00	9.1618E+14
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	7.3766E-02	5.9501E-10	2.7353E+15	2.7293E+09
I-133	1.2475E-03	1.1013E-12	4.9865E+12	4.6159E+07
I-135	3.8490E-08	1.0960E-17	4.8890E+07	1.4241E+03
I-130	1.1839E-06	6.0704E-16	2.8120E+09	4.3805E+04
Br-82	3.1679E-05	2.9261E-14	2.1489E+11	1.1721E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.9879E+15
Organic I (atoms)	7.5256E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	1.6357E-01	1.3194E-09	6.0652E+15	6.0521E+09
I-133	2.7664E-03	2.4421E-12	1.1058E+13	1.0236E+08
I-135	8.5351E-08	2.4304E-17	1.0841E+08	3.1580E+03
I-130	2.6254E-06	1.3461E-15	6.2357E+09	9.7138E+04
Br-82	7.0247E-05	6.4885E-14	4.7652E+11	2.5991E+06

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	6.6106E-03	3.5316E-11	1.5991E+14	2.4459E+08
Xe-135	2.4625E-06	9.6429E-16	4.3015E+09	9.1113E+04
Xe-131m	1.9688E-03	2.3505E-11	1.0805E+14	7.2845E+07
Xe-133m	4.7328E-04	1.0548E-12	4.7759E+12	1.7511E+07
Xe-135m	1.5990E-05	1.7553E-16	7.8302E+08	5.9162E+05

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	2.7274E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.3575E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.8993E+01	2.3342E-07	1.6345E+18	7.0274E+11
I-131	1.8874E+01	1.5224E-07	6.9986E+17	6.9834E+11
I-133	3.1921E-01	2.8178E-10	1.2759E+15	1.1811E+10
I-135	9.8483E-06	2.8043E-15	1.2510E+10	3.6439E+05
Cs-134	2.4549E+03	1.8974E-03	8.5272E+21	9.0833E+13
Cs-136	5.1800E+02	7.0678E-06	3.1296E+19	1.9166E+13
Cs-137	1.3322E+03	1.5316E-02	6.7324E+22	4.9292E+13
I-130	3.0293E-04	1.5532E-13	7.1951E+11	1.1208E+07
Ba-137m	1.4768E+03	2.7460E-09	1.2070E+16	5.4641E+13
Br-82	8.1055E-03	7.4868E-12	5.4984E+13	2.9990E+08

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.0863E+17
Organic I (atoms)	1.9255E+17
Aerosols (kg)	1.7221E-02

Detailed model information at time (H) = 720.0000

EAB Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.2148E-04	6.1596E-125	3.4903E-03	5.2148E-04
Accumulated dose (rem)	4.3561E-01	5.4788E+01	1.1794E+00	2.1151E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

LPZ Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.4574E-06	2.9027-127	1.6448E-05	2.4574E-06
Accumulated dose (rem)	4.7730E-02	6.7329E+00	1.3428E-01	2.5413E-01

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.0498E-06	9.7455-122	6.8962E-04	3.0498E-06
Accumulated dose (rem)	4.2144E-02	1.0993E+02	4.2715E+00	3.4115E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	5.5409E-11	2.9602E-19	1.3403E+06	2.0501E+00
Xe-131m	1.8835E-03	2.2486E-11	1.0337E+14	6.9689E+07

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 720.0000	Overlying		
	Atmosphere	Sump	Pool
Noble gases (atoms)	1.0337E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.2962E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition	
	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	6.5072E+01	7.9973E-07	5.6001E+18	2.4077E+12
Cs-134	2.1572E+04	1.6673E-02	7.4931E+22	7.9816E+14
Cs-136	1.1779E+03	1.6072E-05	7.1166E+19	4.3583E+13
Cs-137	1.1970E+04	1.3762E-01	6.0492E+23	4.4289E+14
Ba-137m	1.3269E+04	2.4673E-08	1.0846E+17	4.9096E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5431E-01

Environment Integral Nuclide Release:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	1.3242E+03	7.0744E-06	3.2032E+19	4.8995E+13
Xe-131m	1.9138E+02	2.2848E-06	1.0503E+19	7.0811E+12

Environment Transport Group Inventory:

Time (h) = 720.0000	Present	Release	Integral
	Release	Rate/s	Release
Noble gases (atoms)	1.1486E+14	1.5953E+12	1.9109E+22
Elemental I (atoms)	0.0000E+00	0.0000E+00	5.1939E+17
Organic I (atoms)	0.0000E+00	0.0000E+00	1.9663E+17
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	6.5072E+01	7.9973E-07	5.6001E+18	2.4077E+12
Cs-134	2.1572E+04	1.6673E-02	7.4931E+22	7.9816E+14
Cs-136	1.1779E+03	1.6072E-05	7.1166E+19	4.3583E+13

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Cs-137	1.1970E+04	1.3762E-01	6.0492E+23	4.4289E+14
Ba-137m	1.3269E+04	2.4673E-08	1.0846E+17	4.9096E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.5431E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	7.8410E-03	6.3247E-11	2.9075E+14	2.9012E+08
Br-82	1.5116E-10	1.3962E-19	1.0254E+06	5.5930E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.1091E+14
Organic I (atoms)	7.9843E+13
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	7.2302E+00	8.8858E-08	6.2223E+17	2.6752E+11
I-131	2.0062E+00	1.6183E-08	7.4392E+16	7.4231E+10
I-133	2.9729E-10	2.6243E-19	1.1883E+06	1.1000E+01
Cs-134	2.3969E+03	1.8526E-03	8.3256E+21	8.8685E+13
Cs-136	1.3088E+02	1.7857E-06	7.9073E+18	4.8425E+12
Cs-137	1.3300E+03	1.5291E-02	6.7214E+22	4.9211E+13
Ba-137m	1.4744E+03	2.7414E-09	1.2051E+16	5.4551E+13
Br-82	3.8678E-08	3.5725E-17	2.6237E+08	1.4311E+03

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.3963E+16
Organic I (atoms)	2.0429E+16

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Aerosols (kg) 1.7145E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-131m	7.8428E-06	9.3633E-14	4.3044E+11	2.9018E+05

Control Room Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	4.3044E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	9.5458E-03	7.6998E-11	3.5396E+14	3.5320E+08
Br-82	1.8404E-10	1.6999E-19	1.2484E+06	6.8094E+00

Deposition Recirculating

Time (h) = 720.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.5676E+14
Organic I (atoms)	0.0000E+00	9.7202E+13
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	7.8410E-03	6.3247E-11	2.9075E+14	2.9012E+08
Br-82	1.5116E-10	1.3962E-19	1.0254E+06	5.5930E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.1091E+14
Organic I (atoms)	7.9843E+13
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	1.7387E-02	1.4025E-10	6.4471E+14	6.4331E+08
Br-82	3.3520E-10	3.0961E-19	2.2738E+06	1.2402E+01

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	6.1566E-12	3.2891E-20	1.4893E+05	2.2779E-01
Xe-131m	2.0928E-04	2.4985E-12	1.1486E+13	7.7432E+06

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 720.0000	Atmosphere		Sump	Overlying Pool
	Noble gases (atoms)	1.1486E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	1.4402E+19
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition Surfaces		Recirculating Filter
	Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	7.2302E+00	8.8858E-08	6.2223E+17	2.6752E+11
I-131	2.0062E+00	1.6183E-08	7.4392E+16	7.4231E+10
I-133	2.9729E-10	2.6243E-19	1.1883E+06	1.1000E+01
Cs-134	2.3969E+03	1.8526E-03	8.3256E+21	8.8685E+13
Cs-136	1.3088E+02	1.7857E-06	7.9073E+18	4.8425E+12
Cs-137	1.3300E+03	1.5291E-02	6.7214E+22	4.9211E+13
Ba-137m	1.4744E+03	2.7414E-09	1.2051E+16	5.4551E+13
Br-82	3.8678E-08	3.5725E-17	2.6237E+08	1.4311E+03

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.3963E+16
Organic I (atoms)	2.0429E+16
Aerosols (kg)	1.7145E-02

Transport Group Totals in Model:

Noble Gases (atoms)	1.9109E+22
Elemental I (atoms)	1.4460E+20
Organic I (atoms)	2.1723E+17
Aerosols (kg)	1.7145E-01

37004

I-131 Summary
#####

Time (hr)	Fuel Pool-Unfiltered I-131 (Curies)	Environment I-131 (Curies)	Control Room I-131 (Curies)
0.000	0.0000E+00	0.0000E+00	0.0000E+00
0.001	0.0000E+00	0.0000E+00	0.0000E+00
0.002	0.0000E+00	0.0000E+00	0.0000E+00
0.280	2.1037E-02	3.5183E+01	1.1799E-01
0.333	2.1033E-02	4.1929E+01	1.3676E-01
0.600	2.1013E-02	7.5758E+01	4.8562E-02
0.860	2.0994E-02	1.0864E+02	2.4783E-02
1.120	2.0976E-02	1.4146E+02	1.8068E-02
1.380	2.0957E-02	1.7421E+02	1.6164E-02

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

1.640	2.0938E-02	2.0691E+02	1.5617E-02
1.900	2.0919E-02	2.3954E+02	1.5453E-02
2.000	2.0912E-02	2.5207E+02	1.5425E-02
2.002	2.0912E-02	2.5232E+02	1.5393E-02
2.280	0.0000E+00	2.5437E+02	4.2651E-03
2.540	0.0000E+00	2.5413E+02	1.2026E-03
2.800	0.0000E+00	2.5390E+02	3.3909E-04
3.060	0.0000E+00	2.5366E+02	9.5613E-05
3.320	0.0000E+00	2.5342E+02	2.6960E-05
3.580	0.0000E+00	2.5319E+02	7.6017E-06
3.840	0.0000E+00	2.5295E+02	2.1434E-06
4.100	0.0000E+00	2.5271E+02	6.0437E-07
4.360	0.0000E+00	2.5248E+02	1.7041E-07
4.620	0.0000E+00	2.5224E+02	4.8051E-08
4.880	0.0000E+00	2.5201E+02	1.3549E-08
5.140	0.0000E+00	2.5177E+02	3.8203E-09
5.400	0.0000E+00	2.5154E+02	1.0772E-09
5.660	0.0000E+00	2.5130E+02	3.0373E-10
5.920	0.0000E+00	2.5107E+02	8.5642E-11
6.180	0.0000E+00	2.5083E+02	2.4148E-11
6.440	0.0000E+00	2.5060E+02	6.8090E-12
6.700	0.0000E+00	2.5036E+02	1.9199E-12
6.960	0.0000E+00	2.5013E+02	5.4135E-13
7.220	0.0000E+00	2.4990E+02	1.5264E-13
7.480	0.0000E+00	2.4966E+02	4.3040E-14
7.740	0.0000E+00	2.4943E+02	1.2136E-14
8.000	0.0000E+00	2.4920E+02	3.4219E-15
8.260	0.0000E+00	2.4896E+02	9.6486E-16
8.520	0.0000E+00	2.4873E+02	2.7206E-16
8.780	0.0000E+00	2.4850E+02	7.6711E-17
9.040	0.0000E+00	2.4827E+02	2.1630E-17
9.300	0.0000E+00	2.4804E+02	6.0989E-18
9.560	0.0000E+00	2.4780E+02	1.7197E-18
9.820	0.0000E+00	2.4757E+02	4.8489E-19
10.080	0.0000E+00	2.4734E+02	1.3672E-19
24.000	0.0000E+00	2.3528E+02	5.0148E-49
96.000	0.0000E+00	1.8166E+02	2.8003-201
720.000	0.0000E+00	1.9310E+01	0.0000E+00

Time (hr)	Fuel Pool-Filtered I-131 (Curies)
0.000	0.0000E+00
0.001	0.0000E+00
0.002	0.0000E+00
0.280	2.3374E-03
0.333	2.3370E-03
0.600	2.3348E-03
0.860	2.3327E-03
1.120	2.3306E-03
1.380	2.3285E-03
1.640	2.3264E-03
1.900	2.3243E-03
2.000	2.3235E-03
2.002	2.3235E-03
2.280	0.0000E+00
2.540	0.0000E+00
2.800	0.0000E+00
3.060	0.0000E+00
3.320	0.0000E+00
3.580	0.0000E+00
3.840	0.0000E+00
4.100	0.0000E+00
4.360	0.0000E+00
4.620	0.0000E+00
4.880	0.0000E+00
5.140	0.0000E+00
5.400	0.0000E+00
5.660	0.0000E+00
5.920	0.0000E+00
6.180	0.0000E+00
6.440	0.0000E+00
6.700	0.0000E+00
6.960	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

7.220	0.0000E+00
7.480	0.0000E+00
7.740	0.0000E+00
8.000	0.0000E+00
8.260	0.0000E+00
8.520	0.0000E+00
8.780	0.0000E+00
9.040	0.0000E+00
9.300	0.0000E+00
9.560	0.0000E+00
9.820	0.0000E+00
10.080	0.0000E+00
24.000	0.0000E+00
96.000	0.0000E+00
720.000	0.0000E+00

 Cumulative Dose Summary
 #####

Time (hr)	EAB		LPZ		Control Room	
	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)
0.000	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.001	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.002	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.280	7.5565E+00	2.8162E-01	9.3370E-01	3.4798E-02	2.4280E+01	7.4882E-01
0.333	9.0058E+00	3.3565E-01	1.1128E+00	4.1473E-02	3.3851E+01	1.0440E+00
0.600	1.6276E+01	6.0669E-01	2.0112E+00	7.4963E-02	6.5190E+01	2.0121E+00
0.860	2.3348E+01	8.7038E-01	2.8850E+00	1.0755E-01	7.7725E+01	2.4014E+00
1.120	3.0410E+01	1.1337E+00	3.7575E+00	1.4008E-01	8.5313E+01	2.6383E+00
1.380	3.7461E+01	1.3967E+00	4.6288E+00	1.7258E-01	9.1504E+01	2.8318E+00
1.640	4.4504E+01	1.6593E+00	5.4990E+00	2.0503E-01	9.7295E+01	3.0128E+00
1.900	5.1538E+01	1.9216E+00	6.3681E+00	2.3744E-01	1.0297E+02	3.1901E+00
2.000	5.4241E+01	2.0224E+00	6.7021E+00	2.4990E-01	1.0514E+02	3.2579E+00
2.002	5.4295E+01	2.0246E+00	6.7052E+00	2.5002E-01	1.0518E+02	3.2592E+00
2.280	5.4787E+01	2.0446E+00	6.7328E+00	2.5114E-01	1.0870E+02	3.3698E+00
2.540	5.4787E+01	2.0464E+00	6.7328E+00	2.5124E-01	1.0959E+02	3.3981E+00
2.800	5.4788E+01	2.0481E+00	6.7329E+00	2.5134E-01	1.0984E+02	3.4064E+00
3.060	5.4788E+01	2.0498E+00	6.7329E+00	2.5143E-01	1.0991E+02	3.4089E+00
3.320	5.4788E+01	2.0514E+00	6.7329E+00	2.5152E-01	1.0993E+02	3.4098E+00
3.580	5.4788E+01	2.0530E+00	6.7329E+00	2.5161E-01	1.0993E+02	3.4101E+00
3.840	5.4788E+01	2.0545E+00	6.7329E+00	2.5170E-01	1.0993E+02	3.4102E+00
4.100	5.4788E+01	2.0560E+00	6.7329E+00	2.5178E-01	1.0993E+02	3.4103E+00
4.360	5.4788E+01	2.0575E+00	6.7329E+00	2.5187E-01	1.0993E+02	3.4104E+00
4.620	5.4788E+01	2.0589E+00	6.7329E+00	2.5194E-01	1.0993E+02	3.4104E+00
4.880	5.4788E+01	2.0603E+00	6.7329E+00	2.5202E-01	1.0993E+02	3.4105E+00
5.140	5.4788E+01	2.0616E+00	6.7329E+00	2.5210E-01	1.0993E+02	3.4105E+00
5.400	5.4788E+01	2.0629E+00	6.7329E+00	2.5217E-01	1.0993E+02	3.4106E+00
5.660	5.4788E+01	2.0642E+00	6.7329E+00	2.5224E-01	1.0993E+02	3.4106E+00
5.920	5.4788E+01	2.0654E+00	6.7329E+00	2.5231E-01	1.0993E+02	3.4107E+00
6.180	5.4788E+01	2.0666E+00	6.7329E+00	2.5238E-01	1.0993E+02	3.4107E+00
6.440	5.4788E+01	2.0678E+00	6.7329E+00	2.5245E-01	1.0993E+02	3.4108E+00
6.700	5.4788E+01	2.0690E+00	6.7329E+00	2.5251E-01	1.0993E+02	3.4108E+00
6.960	5.4788E+01	2.0701E+00	6.7329E+00	2.5257E-01	1.0993E+02	3.4108E+00
7.220	5.4788E+01	2.0712E+00	6.7329E+00	2.5264E-01	1.0993E+02	3.4109E+00
7.480	5.4788E+01	2.0722E+00	6.7329E+00	2.5269E-01	1.0993E+02	3.4109E+00
7.740	5.4788E+01	2.0733E+00	6.7329E+00	2.5275E-01	1.0993E+02	3.4110E+00
8.000	5.4788E+01	2.0743E+00	6.7329E+00	2.5281E-01	1.0993E+02	3.4110E+00
8.260	5.4788E+01	2.0752E+00	6.7329E+00	2.5285E-01	1.0993E+02	3.4110E+00
8.520	5.4788E+01	2.0762E+00	6.7329E+00	2.5288E-01	1.0993E+02	3.4110E+00
8.780	5.4788E+01	2.0771E+00	6.7329E+00	2.5292E-01	1.0993E+02	3.4111E+00
9.040	5.4788E+01	2.0780E+00	6.7329E+00	2.5295E-01	1.0993E+02	3.4111E+00
9.300	5.4788E+01	2.0789E+00	6.7329E+00	2.5299E-01	1.0993E+02	3.4111E+00
9.560	5.4788E+01	2.0798E+00	6.7329E+00	2.5302E-01	1.0993E+02	3.4111E+00
9.820	5.4788E+01	2.0806E+00	6.7329E+00	2.5305E-01	1.0993E+02	3.4111E+00
10.080	5.4788E+01	2.0814E+00	6.7329E+00	2.5308E-01	1.0993E+02	3.4111E+00
24.000	5.4788E+01	2.1048E+00	6.7329E+00	2.5397E-01	1.0993E+02	3.4115E+00
96.000	5.4788E+01	2.1146E+00	6.7329E+00	2.5412E-01	1.0993E+02	3.4115E+00
720.000	5.4788E+01	2.1151E+00	6.7329E+00	2.5413E-01	1.0993E+02	3.4115E+00

 Worst Two-Hour Dose
 #####

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

(Provided for Dose Location 1)

#####

EAB

Time (hr)	Whole Body (rem)	Thyroid (rem)	Skin (rem)	TEDE (rem)
0.0	3.5967E-01	5.4241E+01	1.0395E+00	2.0224E+00

#####

30 Day Control Room Skin Dose

#####

Control Room

Time (hr)	Skin (rem)
720.0	4.2715E+00

Attachment 4 RADTRAD-NAI FHA Output – Case 2 – 34% Filtered

```
#####
RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:51:53
#####

#####
File information
#####

Plant file name           = pal/FHA/db/pal_fha_db_ast_34filter.psf
Inventory file name       = pal/FHA/db/palisades_fha_db_ast_adj.nif
Scenario file name       = pal/FHA/db/pal_fha_db_ast_34filter.psf
Release file name        = pal/FHA/db/pal_fha_ast.rft
Dose conversion file name = pal/FHA/db/nai-1101-001rev0.dcf
```

```
#####  #####  #####  # # # ##### # # #####
# # # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # # #
#####  #####  #####  # # # # # ##### # # # #
# # # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # # #
```

```
*RADTRAD-NAI 1.1a(QA)
*09 May 2005 06:51:48
** Palisades FHA Design Basis
** 34% release filtration
*Nuclide inventory file
pal/FHA/db/palisades_fha_db_ast_adj.nif
*Plant power
2703
*Compartments
4
*Compartment 1:
Fuel Pool-Unfiltered
3
10000
0
0
0
0
1
*Compartment 2:
Environment
2
2e+20
0
0
0
0
*Compartment 3:
Control Room
1
35923
0
1
0
0
*Compartment 4:
Fuel Pool-Filtered
3
10000
0
0
0
0
1
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
*Pathways
6
*Pathway 1:
Fuel Pool Release-Unfiltered
1
2
2
*Pathway 2:
Control Room Unfiltered Makeup
2
3
2
*Pathway 3:
Control Room Filtered Makeup
2
3
2
*Pathway 4:
Control Room Unfiltered Inleakage
2
3
2
*Pathway 5:
Control Room Exhaust
3
2
2
*Pathway 6:
Fuel Pool Release-Filtered
4
2
2
*Sources
4
1 0.66
2 0
3 0
4 0.34
*dose conversion factors filename
pal/FHA/db/nai-1101-001rev0.dcf
*release fraction and timing filename
pal/FHA/db/pal_fha_ast.rft
0
1
1
*Iodine
0 0.9985 0.0015
*Overlying pool
*aerosol model
0
*elemental model
1
2
0 252
720 252
*organic model
1
2
0 1
720 1
*pH tracking
0
*Compartment detail
*Compartment 1:
1
*spray model
0
0
0
*filter model
0
*deposition model
0
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
0
*Compartment 2:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Compartment 4:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Pathways:
*Pathway 1
*filter efficiency model
  1
  2
0 1000000 100 0 0
720 1000000 100 0 0
*Pathway 2
*filter efficiency model
  1
  3
0 660 0 0 0
0.3333 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
  1
  3
0 0 0 0 0
0.3333 100 0 0 0
720 100 0 0 0
*Pathway 5
*filter efficiency model
  1
  3
0 660 0 0 0
0.3333 1513.6 0 0 0
720 1513.6 0 0 0
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
*Pathway 6
*filter efficiency model
  1
  2
0 1000000 100 94 94
720 1000000 100 94 94
*x/q tables
  6
EAB
  2
0 0.000539
720 0.000539
LPZ
  6
0 6.66e-05
  2 3.03e-05
  8 2.04e-05
 24 8.67e-06
 96 2.54e-06
720 2.54e-06
Equip Hatch-Normal
  6
0 0.0125
  2 0.00983
  8 0.00362
 24 0.00286
 96 0.00228
720 0.00228
Equip Hatch-Emergency
  6
0 0.000732
  2 0.000613
  8 0.000245
 24 0.000175
 96 0.000129
720 0.000129
Stack-Normal
  6
0 0.0061
  2 0.00432
  8 0.00173
 24 0.00127
 96 0.000979
720 0.000979
Stack-Emergency
  6
0 0.000832
  2 0.000769
  8 0.000283
 24 0.000215
 96 0.000157
720 0.000157
*dose locations
  3
*location name, compartment number and x/q table
EAB
  2
  1
*br model
  1
  4
0 0.00035
  8 0.00018
 24 0.00023
720 0.00023
*of model
  0
*location x/q input to be included
  0
*location name, compartment number and x/q table
LPZ
  2
  2
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```

*br model
  1
  4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
  0
*location x/q input to be included
  0
*location name, compartment number and x/q table
Control Room
  3
  0
*br model
  1
  2
0 0.00035
720 0.00035
*of model
  1
  4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
  1
*number of intake combinations
  6
*intake combinations
2 1 3
3 1 4
4 1 3
2 6 5
3 6 6
4 6 5
*time step count
  3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
  1
  1
  1
  0
  1

#####
RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:51:53
#####

#####
Plant Description
#####

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth
Plant Power Level = 2.7030E+03 MWth

Number of compartments = 4

Compartment information

Compartment number 1 (Source term fraction = 6.6000E-01)
Name: Fuel Pool-Unfiltered
Compartment volume = 1.0000E+04 (Cubic feet)
Removal devices within compartment:
  Suppression pool
Pathways into and out of compartment 1

```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Pathway to compartment number 2: Fuel Pool Release-Unfiltered

Compartment number 2
Name: Environment

Pathways into and out of compartment 2
Pathway to compartment number 3: Control Room Unfiltered Makeup
Pathway to compartment number 3: Control Room Filtered Makeup
Pathway to compartment number 3: Control Room Unfiltered Inleakage
Pathway from compartment number 1: Fuel Pool Release-Unfiltered
Pathway from compartment number 3: Control Room Exhaust
Pathway from compartment number 4: Fuel Pool Release-Filtered

Compartment number 3
Name: Control Room
Compartment volume = 3.5923E+04 (Cubic feet)
Removal devices within compartment:
Filter(s)

Pathways into and out of compartment 3
Pathway to compartment number 2: Control Room Exhaust
Pathway from compartment number 2: Control Room Unfiltered Makeup
Pathway from compartment number 2: Control Room Filtered Makeup
Pathway from compartment number 2: Control Room Unfiltered Inleakage

Compartment number 4 (Source term fraction = 3.4000E-01)
Name: Fuel Pool-Filtered
Compartment volume = 1.0000E+04 (Cubic feet)
Removal devices within compartment:
Suppression pool

Pathways into and out of compartment 4
Pathway to compartment number 2: Fuel Pool Release-Filtered

Total number of pathways = 6

#####
RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:51:53
#####
#####
Scenario Description
#####

Radioactive Decay is enabled
Calculation of Daughters is enabled

Iodine fractions
Aerosol = 0.0000E+00
Elemental = 9.9850E-01
Organic = 1.5000E-03

Overlying pool characteristics

Elemental Removal Data:
Time (hr) DF
0.0000E+00 2.5200E+02
7.2000E+02 2.5200E+02

Organic Removal Data:
Time (hr) DF
0.0000E+00 1.0000E+00
7.2000E+02 1.0000E+00

COMPARTMENT DATA

Compartment number 1: Fuel Pool-Unfiltered
Compartment number 2: Environment
Compartment number 3: Control Room

Compartment Filter Data

Time (hr) Flow Rate Filter Efficiencies (%)

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	(cfm)	Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Compartment number 4: Fuel Pool-Filtered

PATHWAY DATA

Pathway number 1: Fuel Pool Release-Unfiltered

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	1.0000E+06	1.0000E+02	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+06	1.0000E+02	0.0000E+00	0.0000E+00

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.0000E+02	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+02	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.5136E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.5136E+03	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 6: Fuel Pool Release-Filtered

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	1.0000E+06	1.0000E+02	9.4000E+01	9.4000E+01
7.2000E+02	1.0000E+06	1.0000E+02	9.4000E+01	9.4000E+01

X/Q DATA

X/Q table 1: EAB

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	5.3900E-04
7.2000E+02	5.3900E-04

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

X/Q table 2: LPZ

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

X/Q table 3: Equip Hatch-Normal

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	1.2500E-02
2.0000E+00	9.8300E-03
8.0000E+00	3.6200E-03
2.4000E+01	2.8600E-03
9.6000E+01	2.2800E-03
7.2000E+02	2.2800E-03

X/Q table 4: Equip Hatch-Emergency

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	7.3200E-04
2.0000E+00	6.1300E-04
8.0000E+00	2.4500E-04
2.4000E+01	1.7500E-04
9.6000E+01	1.2900E-04
7.2000E+02	1.2900E-04

X/Q table 5: Stack-Normal

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	6.1000E-03
2.0000E+00	4.3200E-03
8.0000E+00	1.7300E-03
2.4000E+01	1.2700E-03
9.6000E+01	9.7900E-04
7.2000E+02	9.7900E-04

X/Q table 6: Stack-Emergency

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	8.3200E-04
2.0000E+00	7.6900E-04
8.0000E+00	2.8300E-04
2.4000E+01	2.1500E-04
9.6000E+01	1.5700E-04
7.2000E+02	1.5700E-04

LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location Control Room is in compartment 3

Inleakage X/Q Table Assignments

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Inleakage Path	Source Path	X/Q Table
2	1	3
3	1	4
4	1	3
2	6	5
3	6	6
4	6	5

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
7.2000E+02	3.5000E-04

Location Occupancy Factor Data

Time (hr)	Occupancy Factor
0.0000E+00	1.0000E+00
2.4000E+01	6.0000E-01
9.6000E+01	4.0000E-01
7.2000E+02	4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time	Time step
0.0000E+00	1.0000E-06
1.0000E-03	2.0000E-02
7.2000E+02	2.0000E-02

 RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:51:53
 #####

```

#####
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
#####

```


 Dose, Detailed Model and Detailed Inventory Output
 #####

Detailed model information at time (H) = 0.0010

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.0010	0.0000E+00	0.0000E+00	0.0000E+00
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

		Deposition Recirculating	
Time (h) =	0.0010	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Fuel Pool Release-Unfiltered Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Environment Transport Group Inventory:

		Present	Release	Integral
Time (h) =	0.0010	Release	Rate/s	Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Makeup Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Filtered Makeup Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Inleakage Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Exhaust Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0010			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0010		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0010			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0010		
Noble gases (atoms)	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway	
Time (h) =	Filter	
0.0010		
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Detailed model information at time (H) = 0.0020

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0020				
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0020				
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0020				
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.0020			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	Deposition Recirculating	
0.0020	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway	
Time (h) =	Filter	
0.0020		
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Environment Transport Group Inventory:

Time (h) =	Present Release	Release Rate/s	Integral Release
0.0020			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway	
Time (h) =	Filter	
0.0020		
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

			Overlying
Time (h) = 0.0020	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

		Deposition	Recirculating
Time (h) = 0.0020	Surfaces	Filter	
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0020			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3333

EAB Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.7387E-02	6.7636E+00	1.6984E-01	2.6474E-01
Accumulated dose (rem)	5.7387E-02	6.7636E+00	1.6984E-01	2.6474E-01

LPZ Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.0908E-03	8.3572E-01	2.0986E-02	3.2712E-02
Accumulated dose (rem)	7.0908E-03	8.3572E-01	2.0986E-02	3.2712E-02

Control Room Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.3536E-03	2.5117E+01	5.3245E-01	7.7530E-01
Accumulated dose (rem)	5.3536E-03	2.5117E+01	5.3245E-01	7.7530E-01

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	5.7860E-02	1.4748E-07	1.0448E+18	2.1408E+09
Kr-85m	3.0662E-04	3.7259E-14	2.6397E+11	1.1345E+07
Kr-88	1.0906E-05	8.6977E-16	5.9521E+09	4.0353E+05
Rb-86	1.1999E-02	1.4747E-10	1.0327E+15	4.4397E+08
I-131	1.5424E-02	1.2441E-10	5.7193E+14	5.7069E+08
I-132	1.0535E-02	1.0207E-12	4.6565E+12	3.8981E+08
I-133	4.4848E-03	3.9590E-12	1.7926E+13	1.6594E+08
I-135	1.2981E-04	3.6963E-14	1.6489E+11	4.8029E+06
Xe-133	3.6800E+00	1.9660E-08	8.9019E+16	1.3616E+11
Xe-135	2.6079E-01	1.0212E-10	4.5556E+14	9.6494E+09
Cs-134	1.3424E+00	1.0376E-06	4.6629E+18	4.9670E+10
Cs-136	3.4849E-01	4.7549E-09	2.1055E+16	1.2894E+10
Cs-137	7.2600E-01	8.3466E-06	3.6689E+19	2.6862E+10
I-130	3.7536E-05	1.9246E-14	8.9155E+10	1.3888E+06
Kr-83m	3.1303E-06	1.5172E-16	1.1008E+09	1.1582E+05
Xe-131m	2.4765E-02	2.9566E-10	1.3592E+15	9.1631E+08
Xe-133m	1.0154E-01	2.2629E-10	1.0246E+15	3.7569E+09
Xe-135m	2.6565E-01	2.9163E-12	1.3009E+13	9.8292E+09
Cs-134m	3.1217E-06	3.8709E-16	1.7397E+09	1.1550E+05
Rb-88	2.9090E-05	2.4234E-16	1.6584E+09	1.0763E+06
Ba-137m	1.4886E-01	2.7679E-13	1.2167E+12	5.5078E+09
Br-82	3.0742E-05	2.8396E-14	2.0854E+11	1.1375E+06
Br-83	1.2046E-09	7.6250E-20	5.5324E+05	4.4570E+01

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	1.1367E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.3159E+14	0.0000E+00	2.1526E+20
Organic I (atoms)	1.6339E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	9.3890E-06	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Recirculating Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	2.3204E+01	2.8518E-07	1.9969E+18	8.5855E+11
Cs-134	2.5960E+03	2.0064E-03	9.0172E+21	9.6051E+13
Cs-136	6.7391E+02	9.1949E-06	4.0716E+19	2.4935E+13
Cs-137	1.4039E+03	1.6141E-02	7.0949E+22	5.1946E+13
Cs-134m	6.0367E-03	7.4856E-13	3.3641E+12	2.2336E+08
Rb-88	4.0069E-02	3.3380E-13	2.2843E+12	1.4826E+09
Ba-137m	1.3238E+03	2.4614E-09	1.0820E+16	4.8979E+13

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.8156E-02

Environment Integral Nuclide Release:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	1.7371E+02	4.4275E-04	3.1368E+21	6.4271E+12
Kr-85m	9.2054E-01	1.1186E-10	7.9250E+14	3.4060E+10
Kr-87	1.1339E-08	4.0030E-19	2.7709E+06	4.1953E+02
Kr-88	3.2743E-02	2.6112E-12	1.7869E+13	1.2115E+09
I-131	3.1490E+01	2.5400E-07	1.1677E+18	1.1651E+12
I-132	2.0518E+01	1.9877E-09	9.0685E+15	7.5916E+11
I-133	9.1564E+00	8.0829E-09	3.6599E+16	3.3879E+11
I-135	2.6502E-01	7.5465E-11	3.3664E+14	9.8058E+09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Xe-133	1.0701E+04	5.7171E-05	2.5887E+20	3.9595E+14
Xe-135	6.6185E+02	2.5917E-07	1.1561E+18	2.4489E+13
I-130	7.6635E-02	3.9293E-11	1.8202E+14	2.8355E+09
Kr-83m	2.7914E-03	1.3529E-13	9.8164E+11	1.0328E+08
Xe-131m	6.8345E+01	8.1595E-07	3.7510E+18	2.5288E+12
Xe-133m	2.8002E+02	6.2407E-07	2.8257E+18	1.0361E+13
Xe-135m	1.1210E+01	1.2306E-10	5.4897E+14	4.1478E+11
Rb-88	1.0967E-02	9.1361E-14	6.2522E+11	4.0577E+08
Br-82	6.2764E-02	5.7973E-11	4.2576E+14	2.3223E+09
Br-83	2.4593E-06	1.5567E-16	1.1295E+09	9.0995E+04

Environment Transport Group Inventory:

Time (h) = 0.3333	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	1.3677E+20	1.8995E+18	3.4034E+21
Elemental I (atoms)	3.5410E+16	4.9181E+14	8.8082E+17
Organic I (atoms)	1.3405E+16	1.8618E+14	3.3345E+17
Aerosols (kg)	3.4427E-16	4.7816E-18	9.1361E-14

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Rb-86	2.3204E+01	2.8518E-07	1.9969E+18	8.5855E+11
Cs-134	2.5960E+03	2.0064E-03	9.0172E+21	9.6051E+13
Cs-136	6.7391E+02	9.1949E-06	4.0716E+19	2.4935E+13
Cs-137	1.4039E+03	1.6141E-02	7.0949E+22	5.1946E+13
Cs-134m	6.0367E-03	7.4856E-13	3.3641E+12	2.2336E+08
Rb-88	4.0069E-02	3.3380E-13	2.2843E+12	1.4826E+09
Ba-137m	1.3238E+03	2.4614E-09	1.0820E+16	4.8979E+13

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.8156E-02

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	1.1954E+01	1.4691E-07	1.0287E+18	4.4228E+11
I-131	1.4443E+01	1.1650E-07	5.3556E+17	5.3440E+11
I-132	9.3963E+00	9.1031E-10	4.1530E+15	3.4766E+11
I-133	4.1997E+00	3.7074E-09	1.6787E+16	1.5539E+11
I-135	1.2156E-01	3.4613E-11	1.5440E+14	4.4976E+09
Cs-134	1.3373E+03	1.0336E-03	4.6452E+21	4.9481E+13
Cs-136	3.4716E+02	4.7368E-06	2.0975E+19	1.2845E+13
Cs-137	7.2324E+02	8.3148E-03	3.6550E+22	2.6760E+13
I-130	3.5150E-02	1.8022E-11	8.3487E+13	1.3005E+09
Cs-134m	3.1098E-03	3.8562E-13	1.7330E+12	1.1506E+08
Rb-88	2.0642E-02	1.7196E-13	1.1768E+12	7.6374E+08
Ba-137m	6.8193E+02	1.2680E-09	5.5738E+15	2.5232E+13
Br-82	2.8788E-02	2.6590E-11	1.9528E+14	1.0651E+09
Br-83	1.1280E-06	7.1403E-17	5.1807E+08	4.1736E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.0400E+17
Organic I (atoms)	1.5294E+17
Aerosols (kg)	9.3533E-03

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	4.6926E-01	1.1961E-06	8.4741E+18	1.7363E+10
Kr-85m	2.4868E-03	3.0218E-13	2.1409E+12	9.2012E+07
Kr-88	8.8453E-05	7.0541E-15	4.8274E+10	3.2728E+06
I-131	1.0147E-01	8.1847E-10	3.7626E+15	3.7544E+09
I-132	6.6310E-02	6.4241E-12	2.9308E+13	2.4535E+09
I-133	2.9505E-02	2.6046E-11	1.1793E+14	1.0917E+09
I-135	8.5399E-04	2.4317E-13	1.0848E+12	3.1598E+07
Xe-133	2.8910E+01	1.5445E-07	6.9934E+17	1.0697E+12
Xe-135	1.7882E+00	7.0025E-10	3.1237E+15	6.6165E+10
I-130	2.4694E-04	1.2662E-13	5.8653E+11	9.1369E+06
Kr-83m	7.5540E-06	3.6613E-16	2.6565E+09	2.7950E+05
Xe-131m	1.8464E-01	2.2044E-09	1.0134E+16	6.8318E+09
Xe-133m	7.5652E-01	1.6860E-09	7.6341E+15	2.7991E+10
Xe-135m	3.1567E-02	3.4654E-13	1.5458E+12	1.1680E+09
Rb-88	2.8128E-05	2.3432E-16	1.6035E+09	1.0407E+06
Br-82	2.0225E-04	1.8681E-13	1.3719E+12	7.4831E+06
Br-83	7.9247E-09	5.0163E-19	3.6397E+06	2.9321E+02

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	9.1943E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.8383E+15	0.0000E+00	0.0000E+00
Organic I (atoms)	1.0745E+15	0.0000E+00	0.0000E+00
Aerosols (kg)	2.3432E-16	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Kr-85	2.9807E-02	7.5972E-08	5.3825E+17	1.1028E+09
Kr-85m	1.5796E-04	1.9194E-14	1.3599E+11	5.8444E+06
Kr-88	5.6184E-06	4.4806E-16	3.0662E+09	2.0788E+05
Rb-86	6.1814E-03	7.5969E-11	5.3197E+14	2.2871E+08
I-131	7.9457E-03	6.4092E-11	2.9463E+14	2.9399E+08
I-132	5.4274E-03	5.2580E-13	2.3988E+12	2.0081E+08
I-133	2.3104E-03	2.0395E-12	9.2347E+12	8.5484E+07
I-135	6.6871E-05	1.9042E-14	8.4941E+10	2.4742E+06
Xe-133	1.8958E+00	1.0128E-08	4.5858E+16	7.0143E+10
Xe-135	1.3435E-01	5.2609E-11	2.3468E+14	4.9709E+09
Cs-134	6.9155E-01	5.3450E-07	2.4021E+18	2.5587E+10
Cs-136	1.7952E-01	2.4495E-09	1.0846E+16	6.6424E+09
Cs-137	3.7400E-01	4.2997E-06	1.8900E+19	1.3838E+10
I-130	1.9337E-05	9.9146E-15	4.5928E+10	7.1546E+05
Kr-83m	1.6126E-06	7.8158E-17	5.6708E+08	5.9665E+04
Xe-131m	1.2758E-02	1.5231E-10	7.0018E+14	4.7204E+08
Xe-133m	5.2308E-02	1.1657E-10	5.2784E+14	1.9354E+09
Xe-135m	1.3685E-01	1.5023E-12	6.7017E+12	5.0635E+09
Cs-134m	1.6081E-06	1.9941E-16	8.9618E+08	5.9501E+04
Rb-88	1.4986E-05	1.2484E-16	8.5434E+08	5.5448E+05
Ba-137m	7.6685E-02	1.4259E-13	6.2678E+11	2.8373E+09
Br-82	1.5837E-05	1.4628E-14	1.0743E+11	5.8596E+05
Br-83	6.2054E-10	3.9280E-20	2.8500E+05	2.2960E+01

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 0.3333	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	5.8558E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.2234E+14	0.0000E+00	1.1089E+20
Organic I (atoms)	8.4169E+13	0.0000E+00	0.0000E+00
Aerosols (kg)	4.8368E-06	0.0000E+00	0.0000E+00

	Deposition Recirculating	
Time (h) = 0.3333	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	1.1954E+01	1.4691E-07	1.0287E+18	4.4228E+11
I-131	1.4443E+01	1.1650E-07	5.3556E+17	5.3440E+11
I-132	9.3963E+00	9.1031E-10	4.1530E+15	3.4766E+11
I-133	4.1997E+00	3.7074E-09	1.6787E+16	1.5539E+11
I-135	1.2156E-01	3.4613E-11	1.5440E+14	4.4976E+09
Cs-134	1.3373E+03	1.0336E-03	4.6452E+21	4.9481E+13
Cs-136	3.4716E+02	4.7368E-06	2.0975E+19	1.2845E+13
Cs-137	7.2324E+02	8.3148E-03	3.6550E+22	2.6760E+13
I-130	3.5150E-02	1.8022E-11	8.3487E+13	1.3005E+09
Cs-134m	3.1098E-03	3.8562E-13	1.7330E+12	1.1506E+08
Rb-88	2.0642E-02	1.7196E-13	1.1768E+12	7.6374E+08
Ba-137m	6.8193E+02	1.2680E-09	5.5738E+15	2.5232E+13
Br-82	2.8788E-02	2.6590E-11	1.9528E+14	1.0651E+09
Br-83	1.1280E-06	7.1403E-17	5.1807E+08	4.1736E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.0400E+17
Organic I (atoms)	1.5294E+17
Aerosols (kg)	9.3533E-03

Detailed model information at time (H) = 2.0000

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
2.0000				
Delta dose (rem)	2.8919E-01	3.3971E+01	8.5005E-01	1.3306E+00
Accumulated dose (rem)	3.4658E-01	4.0735E+01	1.0199E+00	1.5953E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
2.0000				
Delta dose (rem)	3.5733E-02	4.1976E+00	1.0503E-01	1.6441E-01
Accumulated dose (rem)	4.2824E-02	5.0333E+00	1.2602E-01	1.9712E-01

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
2.0000				
Delta dose (rem)	2.6298E-02	5.2896E+01	2.7332E+00	1.6474E+00
Accumulated dose (rem)	3.1652E-02	7.8013E+01	3.2656E+00	2.4227E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Kr-85	5.7859E-02	1.4747E-07	1.0448E+18	2.1408E+09
Kr-85m	2.3693E-04	2.8790E-14	2.0397E+11	8.7663E+06
Kr-88	7.2612E-06	5.7908E-16	3.9628E+09	2.6867E+05
Rb-86	1.1968E-02	1.4709E-10	1.0300E+15	4.4283E+08
I-131	1.5335E-02	1.2370E-10	5.6864E+14	5.6740E+08
I-132	1.0371E-02	1.0048E-12	4.5840E+12	3.8374E+08
I-133	4.2425E-03	3.7452E-12	1.6958E+13	1.5697E+08
I-135	1.0899E-04	3.1036E-14	1.3845E+11	4.0328E+06
Xe-133	4.5304E+00	2.4203E-08	1.0959E+17	1.6763E+11
Xe-135	5.0402E-01	1.9736E-10	8.8041E+14	1.8649E+10
Cs-134	1.3423E+00	1.0375E-06	4.6626E+18	4.9666E+10
Cs-136	3.4721E-01	4.7374E-09	2.0977E+16	1.2847E+10
Cs-137	7.2600E-01	8.3465E-06	3.6689E+19	2.6862E+10
I-130	3.4187E-05	1.7529E-14	8.1200E+10	1.2649E+06
Kr-83m	1.2893E-05	6.2490E-16	4.5340E+09	4.7704E+05
Xe-131m	4.0832E-02	4.8748E-10	2.2410E+15	1.5108E+09
Xe-133m	1.6266E-01	3.6252E-10	1.6414E+15	6.0185E+09
Xe-135m	1.9982E+00	2.1936E-11	9.7854E+13	7.3934E+10
Cs-134m	2.0959E-06	2.5990E-16	1.1680E+09	7.7549E+04
Rb-88	1.9435E-05	1.6190E-16	1.1080E+09	7.1909E+05
Ba-137m	2.2385E-01	4.1623E-13	1.8296E+12	8.2823E+09
Br-82	2.9752E-05	2.7481E-14	2.0182E+11	1.1008E+06
Br-83	7.4286E-10	4.7023E-20	3.4118E+05	2.7486E+01

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 2.0000	Atmosphere		Sump	Overlying Pool
	Noble gases (atoms)	1.1593E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.2842E+14	0.0000E+00	1.2865E+21	
Organic I (atoms)	1.6218E+14	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	9.3889E-06	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 2.0000	Deposition Surfaces		Recirculating Filter
	Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	1.4283E+02	1.7554E-06	1.2292E+19	5.2847E+12
Cs-134	1.6019E+04	1.2381E-02	5.5644E+22	5.9272E+14
Cs-136	4.1436E+03	5.6536E-05	2.5035E+20	1.5331E+14
Cs-137	8.6640E+03	9.9607E-02	4.3785E+23	3.2057E+14
Cs-134m	2.5013E-02	3.1017E-12	1.3939E+13	9.2547E+08
Rb-88	5.4315E-02	4.5248E-13	3.0965E+12	2.0097E+09
Ba-137m	9.3885E+03	1.7457E-08	7.6737E+16	3.4738E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 2.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1205E-01

Environment Integral Nuclide Release:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	1.0506E+03	2.6779E-03	1.8973E+22	3.8873E+13
Kr-85m	4.3022E+00	5.2278E-10	3.7038E+15	1.5918E+11
Kr-88	1.3185E-01	1.0515E-11	7.1959E+13	4.8786E+09
I-131	1.8931E+02	1.5270E-06	7.0196E+18	7.0043E+12
I-132	9.7200E+01	9.4166E-09	4.2961E+16	3.5964E+12
I-133	5.2379E+01	4.6238E-08	2.0936E+17	1.9380E+12
I-135	1.3456E+00	3.8317E-10	1.7093E+15	4.9789E+10
Xe-133	6.4279E+04	3.4340E-04	1.5549E+21	2.3783E+15
Xe-135	3.5727E+03	1.3990E-06	6.2408E+18	1.3219E+14
I-130	4.2207E-01	2.1641E-10	1.0025E+15	1.5617E+10
Kr-83m	1.0427E-02	5.0538E-13	3.6668E+12	3.8580E+08
Xe-131m	4.1399E+02	4.9425E-06	2.2721E+19	1.5318E+13
Xe-133m	1.6660E+03	3.7128E-06	1.6811E+19	6.1640E+13
Xe-135m	5.6579E+01	6.2111E-10	2.7707E+15	2.0934E+12
Rb-88	1.1594E-01	9.6588E-13	6.6098E+12	4.2899E+09
Br-82	3.6732E-01	3.3929E-10	2.4917E+15	1.3591E+10
Br-83	9.1714E-06	5.8055E-16	4.2122E+09	3.3934E+05

Environment Transport Group Inventory:

Time (h) = 2.0000	Present	Release	Integral
	Release	Rate/s	Release
Noble gases (atoms)	2.0604E+20	2.8617E+18	2.0573E+22
Elemental I (atoms)	5.2958E+16	7.3553E+14	5.2787E+18
Organic I (atoms)	2.0048E+16	2.7845E+14	1.9984E+18
Aerosols (kg)	5.1893E-16	7.2074E-18	9.6588E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	1.4283E+02	1.7554E-06	1.2292E+19	5.2847E+12
Cs-134	1.6019E+04	1.2381E-02	5.5644E+22	5.9272E+14
Cs-136	4.1436E+03	5.6536E-05	2.5035E+20	1.5331E+14

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Cs-137	8.6640E+03	9.9607E-02	4.3785E+23	3.2057E+14
Cs-134m	2.5013E-02	3.1017E-12	1.3939E+13	9.2547E+08
Rb-88	5.4315E-02	4.5248E-13	3.0965E+12	2.0097E+09
Ba-137m	9.3885E+03	1.7457E-08	7.6737E+16	3.4738E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1205E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
I-131	7.6739E-02	6.1899E-10	2.8455E+15	2.8393E+09
I-132	4.1064E-02	3.9782E-12	1.8150E+13	1.5194E+09
I-133	2.1232E-02	1.8743E-11	8.4867E+13	7.8560E+08
I-135	5.4547E-04	1.5532E-13	6.9287E+11	2.0182E+07
I-130	1.7109E-04	8.7724E-14	4.0637E+11	6.3304E+06
Br-82	1.4890E-04	1.3753E-13	1.0101E+12	5.5093E+06
Br-83	3.7177E-09	2.3533E-19	1.7075E+06	1.3756E+02

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.1404E+15
Organic I (atoms)	8.1028E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	7.3579E+01	9.0428E-07	6.3322E+18	2.7224E+12
I-131	8.8610E+01	7.1475E-07	3.2857E+18	3.2786E+12
I-132	4.5420E+01	4.4002E-09	2.0075E+16	1.6805E+12
I-133	2.4517E+01	2.1643E-08	9.7998E+16	9.0715E+11
I-135	6.2987E-01	1.7935E-10	8.0007E+14	2.3305E+10
Cs-134	8.2524E+03	6.3783E-03	2.8665E+22	3.0534E+14
Cs-136	2.1346E+03	2.9125E-05	1.2897E+20	7.8980E+13
Cs-137	4.4633E+03	5.1313E-02	2.2556E+23	1.6514E+14
I-130	1.9756E-01	1.0130E-10	4.6925E+14	7.3098E+09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Cs-134m	1.2885E-02	1.5978E-12	7.1808E+12	4.7676E+08
Rb-88	2.7981E-02	2.3310E-13	1.5952E+12	1.0353E+09
Ba-137m	4.8365E+03	8.9931E-09	3.9531E+16	1.7895E+14
Br-82	1.7194E-01	1.5881E-10	1.1663E+15	6.3617E+09
Br-83	4.2930E-06	2.7175E-16	1.9717E+09	1.5884E+05

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.4708E+18
Organic I (atoms)	9.3538E+17
Aerosols (kg)	5.7721E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	2.1157E-01	5.3926E-07	3.8206E+18	7.8281E+09
Kr-85m	8.6635E-04	1.0527E-13	7.4585E+11	3.2055E+07
Kr-88	2.6552E-05	2.1175E-15	1.4491E+10	9.8241E+05
I-131	1.1447E-02	9.2331E-11	4.2445E+14	4.2353E+08
I-132	7.3162E-03	7.0879E-13	3.2336E+12	2.7070E+08
I-133	3.1668E-03	2.7956E-12	1.2658E+13	1.1717E+08
I-135	8.1358E-05	2.3167E-14	1.0334E+11	3.0102E+06
Xe-133	1.2961E+01	6.9244E-08	3.1353E+17	4.7957E+11
Xe-135	7.2523E-01	2.8399E-10	1.2668E+15	2.6833E+10
I-130	2.5519E-05	1.3084E-14	6.0611E+10	9.4419E+05
Kr-83m	2.3068E-06	1.1181E-16	8.1122E+08	8.5352E+04
Xe-131m	8.3677E-02	9.9900E-10	4.5925E+15	3.0961E+09
Xe-133m	3.3671E-01	7.5040E-10	3.3977E+15	1.2458E+10
Xe-135m	3.0794E-02	3.3806E-13	1.5080E+12	1.1394E+09
Rb-88	9.6672E-06	8.0535E-17	5.5112E+08	3.5769E+05
Br-82	2.2209E-05	2.0513E-14	1.5065E+11	8.2172E+05
Br-83	5.5451E-10	3.5101E-20	2.5467E+05	2.0517E+01

Control Room Transport Group Inventory:

Time (h) = 2.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	4.1434E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.1965E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	1.2101E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	8.0535E-17	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 2.0000	Ci	kg	Atoms	Bq
I-131	8.7476E-02	7.0559E-10	3.2437E+15	3.2366E+09
I-132	3.9648E-02	3.8410E-12	1.7524E+13	1.4670E+09
I-133	2.4205E-02	2.1367E-11	9.6748E+13	8.9558E+08
I-135	6.2184E-04	1.7707E-13	7.8987E+11	2.3008E+07
I-130	1.9504E-04	1.0001E-13	4.6326E+11	7.2166E+06
Rb-88	1.0847E-05	9.0361E-17	6.1837E+08	4.0133E+05
Br-82	1.6974E-04	1.5679E-13	1.1515E+12	6.2805E+06
Br-83	4.2382E-09	2.6828E-19	1.9465E+06	1.5681E+02

Time (h) = 2.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.4376E+15
Organic I (atoms)	0.0000E+00	9.2278E+14
Aerosols (kg)	0.0000E+00	9.0361E-17

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 2.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	2.0000	Ci	kg	Atoms	Bq
I-131		7.6739E-02	6.1899E-10	2.8455E+15	2.8393E+09
I-132		4.1064E-02	3.9782E-12	1.8150E+13	1.5194E+09
I-133		2.1232E-02	1.8743E-11	8.4867E+13	7.8560E+08
I-135		5.4547E-04	1.5532E-13	6.9287E+11	2.0182E+07
I-130		1.7109E-04	8.7724E-14	4.0637E+11	6.3304E+06
Br-82		1.4890E-04	1.3753E-13	1.0101E+12	5.5093E+06
Br-83		3.7177E-09	2.3533E-19	1.7075E+06	1.3756E+02

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		2.1404E+15
Organic I (atoms)		8.1028E+14
Aerosols (kg)		0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
I-131		1.6421E-01	1.3246E-09	6.0892E+15	6.0759E+09
I-132		8.0712E-02	7.8193E-12	3.5673E+13	2.9863E+09
I-133		4.5437E-02	4.0110E-11	1.8162E+14	1.6812E+09
I-135		1.1673E-03	3.3239E-13	1.4827E+12	4.3190E+07
I-130		3.6613E-04	1.8773E-13	8.6964E+11	1.3547E+07
Rb-88		1.0847E-05	9.0361E-17	6.1837E+08	4.0133E+05
Br-82		3.1864E-04	2.9432E-13	2.1615E+12	1.1790E+07
Br-83		7.9560E-09	5.0361E-19	3.6540E+06	2.9437E+02

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Kr-85		2.9806E-02	7.5971E-08	5.3825E+17	1.1028E+09
Kr-85m		1.2205E-04	1.4831E-14	1.0508E+11	4.5159E+06
Kr-88		3.7406E-06	2.9831E-16	2.0415E+09	1.3840E+05
Rb-86		6.1655E-03	7.5773E-11	5.3060E+14	2.2812E+08
I-131		7.9000E-03	6.3722E-11	2.9294E+14	2.9230E+08
I-132		5.3428E-03	5.1761E-13	2.3614E+12	1.9768E+08
I-133		2.1856E-03	1.9293E-12	8.7358E+12	8.0865E+07
I-135		5.6148E-05	1.5988E-14	7.1321E+10	2.0775E+06
Xe-133		2.3339E+00	1.2468E-08	5.6456E+16	8.6353E+10
Xe-135		2.5964E-01	1.0167E-10	4.5355E+14	9.6068E+09
Cs-134		6.9151E-01	5.3447E-07	2.4020E+18	2.5586E+10
Cs-136		1.7887E-01	2.4405E-09	1.0807E+16	6.6180E+09
Cs-137		3.7400E-01	4.2997E-06	1.8900E+19	1.3838E+10
I-130		1.7611E-05	9.0299E-15	4.1830E+10	6.5162E+05
Kr-83m		6.6418E-06	3.2192E-16	2.3357E+09	2.4575E+05
Xe-131m		2.1034E-02	2.5112E-10	1.1544E+15	7.7827E+08
Xe-133m		8.3796E-02	1.8675E-10	8.4559E+14	3.1005E+09
Xe-135m		1.0294E+00	1.1301E-11	5.0410E+13	3.8087E+10
Cs-134m		1.0797E-06	1.3389E-16	6.0171E+08	3.9950E+04
Rb-88		1.0012E-05	8.3406E-17	5.7077E+08	3.7044E+05

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Ba-137m	1.1532E-01	2.1442E-13	9.4253E+11	4.2667E+09
Br-82	1.5327E-05	1.4157E-14	1.0397E+11	5.6710E+05
Br-83	3.8269E-10	2.4224E-20	1.7576E+05	1.4159E+01

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool	
Time (h) = 2.0000				
Noble gases (atoms)	5.9721E+17	0.0000E+00	0.0000E+00	
Elemental I (atoms)	2.2070E+14	0.0000E+00	6.6276E+20	
Organic I (atoms)	8.3550E+13	0.0000E+00	0.0000E+00	
Aerosols (kg)	4.8367E-06	0.0000E+00	0.0000E+00	

	Deposition Recirculating	
	Surfaces	Filter
Time (h) = 2.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	7.3579E+01	9.0428E-07	6.3322E+18	2.7224E+12
I-131	8.8610E+01	7.1475E-07	3.2857E+18	3.2786E+12
I-132	4.5420E+01	4.4002E-09	2.0075E+16	1.6805E+12
I-133	2.4517E+01	2.1643E-08	9.7998E+16	9.0715E+11
I-135	6.2987E-01	1.7935E-10	8.0007E+14	2.3305E+10
Cs-134	8.2524E+03	6.3783E-03	2.8665E+22	3.0534E+14
Cs-136	2.1346E+03	2.9125E-05	1.2897E+20	7.8980E+13
Cs-137	4.4633E+03	5.1313E-02	2.2556E+23	1.6514E+14
I-130	1.9756E-01	1.0130E-10	4.6925E+14	7.3098E+09
Cs-134m	1.2885E-02	1.5978E-12	7.1808E+12	4.7676E+08
Rb-88	2.7981E-02	2.3310E-13	1.5952E+12	1.0353E+09
Ba-137m	4.8365E+03	8.9931E-09	3.9531E+16	1.7895E+14
Br-82	1.7194E-01	1.5881E-10	1.1663E+15	6.3617E+09
Br-83	4.2930E-06	2.7175E-16	1.9717E+09	1.5884E+05

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.4708E+18
Organic I (atoms)	9.3538E+17
Aerosols (kg)	5.7721E-02

Detailed model information at time (H) = 2.0020

EAB Doses:

Time (h) = 2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.7090E-04	4.0595E-02	1.2145E-03	1.7152E-03
Accumulated dose (rem)	3.4705E-01	4.0775E+01	1.0211E+00	1.5970E+00

LPZ Doses:

Time (h) = 2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.6472E-05	2.2820E-03	6.8273E-05	9.6420E-05
Accumulated dose (rem)	4.2850E-02	5.0356E+00	1.2609E-01	1.9722E-01

Control Room Doses:

Time (h) = 2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.4099E-05	3.2142E-02	2.5240E-03	1.0091E-03
Accumulated dose (rem)	3.1676E-02	7.8046E+01	3.2682E+00	2.4237E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Kr-85	5.7859E-02	1.4747E-07	1.0448E+18	2.1408E+09
Kr-85m	2.3685E-04	2.8781E-14	2.0391E+11	8.7635E+06
Kr-88	7.2577E-06	5.7880E-16	3.9609E+09	2.6853E+05

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Rb-86	1.1968E-02	1.4709E-10	1.0300E+15	4.4283E+08
I-131	1.5335E-02	1.2370E-10	5.6864E+14	5.6740E+08
I-132	1.0426E-02	1.0101E-12	4.6081E+12	3.8576E+08
I-133	4.2423E-03	3.7449E-12	1.6957E+13	1.5696E+08
I-135	1.0897E-04	3.1029E-14	1.3842E+11	4.0319E+06
Xe-133	3.6390E+00	1.9441E-08	8.8029E+16	1.3464E+11
Xe-135	2.2747E-01	8.9075E-11	3.9735E+14	8.4165E+09
Cs-134	1.3423E+00	1.0375E-06	4.6626E+18	4.9666E+10
Cs-136	3.4721E-01	4.7374E-09	2.0977E+16	1.2847E+10
Cs-137	7.2600E-01	8.3465E-06	3.6689E+19	2.6862E+10
I-130	3.4183E-05	1.7527E-14	8.1190E+10	1.2648E+06
Kr-83m	1.8041E-06	8.7440E-17	6.3443E+08	6.6751E+04
Xe-131m	2.4605E-02	2.9376E-10	1.3504E+15	9.1039E+08
Xe-133m	9.8845E-02	2.2029E-10	9.9746E+14	3.6573E+09
Xe-135m	2.0276E-01	2.2259E-12	9.9292E+12	7.5021E+09
Cs-134m	2.0949E-06	2.5978E-16	1.1675E+09	7.7512E+04
Rb-88	1.9852E-05	1.6538E-16	1.1318E+09	7.3453E+05
Ba-137m	2.2386E-02	4.1625E-14	1.8297E+11	8.2828E+08
Br-82	2.9751E-05	2.7480E-14	2.0182E+11	1.1008E+06
Br-83	7.4243E-10	4.6996E-20	3.4098E+05	2.7470E+01

Fuel Pool-Unfiltered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0020			
Noble gases (atoms)	1.1356E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.2843E+14	0.0000E+00	1.2878E+21
Organic I (atoms)	1.6219E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	9.3889E-06	0.0000E+00	0.0000E+00

	Surfaces	Filter
Time (h) = 2.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

	Ci	kg	Atoms	Bq
Time (h) = 2.0020				
Rb-86	1.4297E+02	1.7571E-06	1.2304E+19	5.2900E+12
Cs-134	1.6036E+04	1.2394E-02	5.5700E+22	5.9332E+14
Cs-136	4.1477E+03	5.6593E-05	2.5060E+20	1.5347E+14
Cs-137	8.6728E+03	9.9708E-02	4.3829E+23	3.2089E+14
Cs-134m	2.5026E-02	3.1033E-12	1.3947E+13	9.2596E+08
Rb-88	5.4297E-02	4.5233E-13	3.0954E+12	2.0090E+09
Ba-137m	9.3562E+03	1.7397E-08	7.6473E+16	3.4618E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1216E-01

Environment Integral Nuclide Release:

	Ci	kg	Atoms	Bq
Time (h) = 2.0020				
Kr-85	1.0517E+03	2.6806E-03	1.8992E+22	3.8912E+13
Kr-85m	4.3052E+00	5.2314E-10	3.7064E+15	1.5929E+11
Kr-88	1.3192E-01	1.0521E-11	7.1996E+13	4.8811E+09
I-131	1.8949E+02	1.5285E-06	7.0265E+18	7.0113E+12
I-132	9.7270E+01	9.4234E-09	4.2992E+16	3.5990E+12
I-133	5.2428E+01	4.6281E-08	2.0956E+17	1.9398E+12
I-135	1.3467E+00	3.8347E-10	1.7106E+15	4.9828E+10
Xe-133	6.4344E+04	3.4375E-04	1.5565E+21	2.3807E+15
Xe-135	3.5762E+03	1.4004E-06	6.2470E+18	1.3232E+14
I-130	4.2245E-01	2.1660E-10	1.0034E+15	1.5630E+10
Kr-83m	1.0448E-02	5.0640E-13	3.6743E+12	3.8658E+08
Xe-131m	4.1443E+02	4.9478E-06	2.2745E+19	1.5334E+13
Xe-133m	1.6677E+03	3.7167E-06	1.6829E+19	6.1704E+13

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Xe-135m	5.9337E+01	6.5139E-10	2.9058E+15	2.1955E+12
Rb-88	1.1602E-01	9.6651E-13	6.6142E+12	4.2927E+09
Br-82	3.6768E-01	3.3961E-10	2.4941E+15	1.3604E+10
Br-83	9.1753E-06	5.8080E-16	4.2140E+09	3.3949E+05

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 2.0020	Release	Rate/s	Release
Noble gases (atoms)	2.0644E+19	2.8672E+17	2.0594E+22
Elemental I (atoms)	5.2971E+15	7.3571E+13	5.2840E+18
Organic I (atoms)	2.0053E+15	2.7851E+13	2.0003E+18
Aerosols (kg)	5.5425E-18	7.6979E-20	9.6651E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Rb-86	1.4297E+02	1.7571E-06	1.2304E+19	5.2900E+12
Cs-134	1.6036E+04	1.2394E-02	5.5700E+22	5.9332E+14
Cs-136	4.1477E+03	5.6593E-05	2.5060E+20	1.5347E+14
Cs-137	8.6728E+03	9.9708E-02	4.3829E+23	3.2089E+14
Cs-134m	2.5026E-02	3.1033E-12	1.3947E+13	9.2596E+08
Rb-88	5.4297E-02	4.5233E-13	3.0954E+12	2.0090E+09
Ba-137m	9.3562E+03	1.7397E-08	7.6473E+16	3.4618E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 2.0020	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1216E-01

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 2.0020	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	7.6816E-02	6.1961E-10	2.8484E+15	2.8422E+09
I-132	4.1091E-02	3.9809E-12	1.8162E+13	1.5204E+09
I-133	2.1252E-02	1.8761E-11	8.4947E+13	7.8633E+08
I-135	5.4590E-04	1.5545E-13	6.9342E+11	2.0198E+07
I-130	1.7124E-04	8.7802E-14	4.0674E+11	6.3360E+06
Br-82	1.4904E-04	1.3767E-13	1.0110E+12	5.5146E+06
Br-83	3.7193E-09	2.3543E-19	1.7082E+06	1.3762E+02

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 2.0020	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.1425E+15
Organic I (atoms)	8.1108E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 2.0020	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Rb-86	7.3653E+01	9.0519E-07	6.3386E+18	2.7251E+12
I-131	8.8699E+01	7.1546E-07	3.2890E+18	3.2819E+12
I-132	4.5453E+01	4.4034E-09	2.0089E+16	1.6818E+12
I-133	2.4540E+01	2.1663E-08	9.8090E+16	9.0800E+11
I-135	6.3037E-01	1.7950E-10	8.0071E+14	2.3324E+10
Cs-134	8.2607E+03	6.3847E-03	2.8694E+22	3.0565E+14
Cs-136	2.1367E+03	2.9154E-05	1.2909E+20	7.9059E+13
Cs-137	4.4678E+03	5.1365E-02	2.2578E+23	1.6531E+14
I-130	1.9774E-01	1.0139E-10	4.6967E+14	7.3164E+09
Cs-134m	1.2892E-02	1.5987E-12	7.1846E+12	4.7701E+08
Rb-88	2.7971E-02	2.3302E-13	1.5946E+12	1.0349E+09
Ba-137m	4.8198E+03	8.9621E-09	3.9395E+16	1.7833E+14
Br-82	1.7210E-01	1.5897E-10	1.1675E+15	6.3678E+09
Br-83	4.2948E-06	2.7186E-16	1.9725E+09	1.5891E+05

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.4733E+18
Organic I (atoms)	9.3631E+17
Aerosols (kg)	5.7779E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Kr-85	2.1136E-01	5.3873E-07	3.8169E+18	7.8205E+09
Kr-85m	8.6524E-04	1.0514E-13	7.4489E+11	3.2014E+07
Kr-88	2.6513E-05	2.1144E-15	1.4469E+10	9.8098E+05
I-131	1.1423E-02	9.2137E-11	4.2356E+14	4.2264E+08
I-132	7.3000E-03	7.0722E-13	3.2265E+12	2.7010E+08
I-133	3.1600E-03	2.7895E-12	1.2631E+13	1.1692E+08
I-135	8.1171E-05	2.3113E-14	1.0310E+11	3.0033E+06
Xe-133	1.2950E+01	6.9182E-08	3.1325E+17	4.7914E+11
Xe-135	7.2477E-01	2.8381E-10	1.2660E+15	2.6816E+10
I-130	2.5462E-05	1.3055E-14	6.0478E+10	9.4211E+05
Kr-83m	2.3172E-06	1.1231E-16	8.1488E+08	8.5737E+04
Xe-131m	8.3616E-02	9.9827E-10	4.5891E+15	3.0938E+09
Xe-133m	3.3645E-01	7.4983E-10	3.3952E+15	1.2449E+10
Xe-135m	3.2976E-02	3.6201E-13	1.6149E+12	1.2201E+09
Rb-88	9.6529E-06	8.0415E-17	5.5031E+08	3.5716E+05
Br-82	2.2161E-05	2.0470E-14	1.5033E+11	8.1997E+05
Br-83	5.5303E-10	3.5007E-20	2.5399E+05	2.0462E+01

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0020			
Noble gases (atoms)	4.1394E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.1898E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	1.2075E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	8.0415E-17	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	8.7529E-02	7.0602E-10	3.2456E+15	3.2386E+09
I-132	3.9658E-02	3.8420E-12	1.7528E+13	1.4673E+09
I-133	2.4218E-02	2.1379E-11	9.6801E+13	8.9607E+08
I-135	6.2208E-04	1.7714E-13	7.9019E+11	2.3017E+07
I-130	1.9514E-04	1.0005E-13	4.6350E+11	7.2202E+06

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Rb-88	1.0841E-05	9.0312E-17	6.1804E+08	4.0112E+05
Br-82	1.6984E-04	1.5688E-13	1.1521E+12	6.2841E+06
Br-83	4.2384E-09	2.6829E-19	1.9466E+06	1.5682E+02

	Deposition Recirculating	
	Surfaces	Filter
Time (h) = 2.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.4390E+15
Organic I (atoms)	0.0000E+00	9.2333E+14
Aerosols (kg)	0.0000E+00	9.0312E-17

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
	Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	7.6816E-02	6.1961E-10	2.8484E+15	2.8422E+09
I-132	4.1091E-02	3.9809E-12	1.8162E+13	1.5204E+09
I-133	2.1252E-02	1.8761E-11	8.4947E+13	7.8633E+08
I-135	5.4590E-04	1.5545E-13	6.9342E+11	2.0198E+07
I-130	1.7124E-04	8.7802E-14	4.0674E+11	6.3360E+06
Br-82	1.4904E-04	1.3767E-13	1.0110E+12	5.5146E+06
Br-83	3.7193E-09	2.3543E-19	1.7082E+06	1.3762E+02

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
	Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.1425E+15
Organic I (atoms)	8.1108E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
	Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
	Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	1.6434E-01	1.3256E-09	6.0940E+15	6.0807E+09
I-132	8.0750E-02	7.8229E-12	3.5690E+13	2.9877E+09
I-133	4.5470E-02	4.0139E-11	1.8175E+14	1.6824E+09
I-135	1.1680E-03	3.3258E-13	1.4836E+12	4.3216E+07
I-130	3.6639E-04	1.8786E-13	8.7023E+11	1.3556E+07
Rb-88	1.0841E-05	9.0312E-17	6.1804E+08	4.0112E+05
Br-82	3.1888E-04	2.9454E-13	2.1632E+12	1.1799E+07
Br-83	7.9577E-09	5.0372E-19	3.6548E+06	2.9443E+02

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0020	Ci	kg	Atoms	Bq
-------------------	----	----	-------	----

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Kr-85	2.9806E-02	7.5971E-08	5.3825E+17	1.1028E+09
Kr-85m	1.2201E-04	1.4826E-14	1.0504E+11	4.5146E+06
Kr-88	3.7388E-06	2.9817E-16	2.0405E+09	1.3834E+05
Rb-86	6.1655E-03	7.5773E-11	5.3060E+14	2.2812E+08
I-131	7.8999E-03	6.3722E-11	2.9293E+14	2.9230E+08
I-132	5.3710E-03	5.2034E-13	2.3739E+12	1.9873E+08
I-133	2.1854E-03	1.9292E-12	8.7352E+12	8.0860E+07
I-135	5.6136E-05	1.5985E-14	7.1306E+10	2.0770E+06
Xe-133	1.8747E+00	1.0015E-08	4.5348E+16	6.9362E+10
Xe-135	1.1718E-01	4.5887E-11	2.0469E+14	4.3358E+09
Cs-134	6.9151E-01	5.3447E-07	2.4020E+18	2.5586E+10
Cs-136	1.7886E-01	2.4405E-09	1.0807E+16	6.6180E+09
Cs-137	3.7400E-01	4.2997E-06	1.8900E+19	1.3838E+10
I-130	1.7609E-05	9.0289E-15	4.1825E+10	6.5154E+05
Kr-83m	9.2937E-07	4.5045E-17	3.2683E+08	3.4387E+04
Xe-131m	1.2675E-02	1.5133E-10	6.9566E+14	4.6899E+08
Xe-133m	5.0920E-02	1.1348E-10	5.1384E+14	1.8841E+09
Xe-135m	1.0445E-01	1.1467E-12	5.1150E+12	3.8647E+09
Cs-134m	1.0792E-06	1.3382E-16	6.0142E+08	3.9931E+04
Rb-88	1.0227E-05	8.5196E-17	5.8303E+08	3.7839E+05
Ba-137m	1.1532E-02	2.1443E-14	9.4258E+10	4.2669E+08
Br-82	1.5326E-05	1.4156E-14	1.0397E+11	5.6707E+05
Br-83	3.8247E-10	2.4210E-20	1.7566E+05	1.4151E+01

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0020			
Noble gases (atoms)	5.8501E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.2071E+14	0.0000E+00	6.6342E+20
Organic I (atoms)	8.3553E+13	0.0000E+00	0.0000E+00
Aerosols (kg)	4.8367E-06	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 2.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Rb-86	7.3653E+01	9.0519E-07	6.3386E+18	2.7251E+12
I-131	8.8699E+01	7.1546E-07	3.2890E+18	3.2819E+12
I-132	4.5453E+01	4.4034E-09	2.0089E+16	1.6818E+12
I-133	2.4540E+01	2.1663E-08	9.8090E+16	9.0800E+11
I-135	6.3037E-01	1.7950E-10	8.0071E+14	2.3324E+10
Cs-134	8.2607E+03	6.3847E-03	2.8694E+22	3.0565E+14
Cs-136	2.1367E+03	2.9154E-05	1.2909E+20	7.9059E+13
Cs-137	4.4678E+03	5.1365E-02	2.2578E+23	1.6531E+14
I-130	1.9774E-01	1.0139E-10	4.6967E+14	7.3164E+09
Cs-134m	1.2892E-02	1.5987E-12	7.1846E+12	4.7701E+08
Rb-88	2.7971E-02	2.3302E-13	1.5946E+12	1.0349E+09
Ba-137m	4.8198E+03	8.9621E-09	3.9395E+16	1.7833E+14
Br-82	1.7210E-01	1.5897E-10	1.1675E+15	6.3678E+09
Br-83	4.2948E-06	2.7186E-16	1.9725E+09	1.5891E+05

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.4733E+18
Organic I (atoms)	9.3631E+17
Aerosols (kg)	5.7779E-02

Detailed model information at time (H) = 8.0000

EAB Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.4466E-02	3.6998E-01	6.0534E-02	4.5806E-02

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Accumulated dose (rem) 3.8151E-01 4.1145E+01 1.0816E+00 1.6428E+00

LPZ Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.9375E-03	2.0798E-02	3.4029E-03	2.5750E-03
Accumulated dose (rem)		4.4788E-02	5.0564E+00	1.2949E-01	1.9979E-01

Control Room Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		5.7901E-03	3.5271E+00	5.6878E-01	1.1386E-01
Accumulated dose (rem)		3.7466E-02	8.1573E+01	3.8369E+00	2.5376E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Xe-133		8.1916E-01	4.3763E-09	1.9816E+16	3.0309E+10
Xe-135		1.6542E-01	6.4776E-11	2.8895E+14	6.1205E+09
Kr-83m		2.1836E-06	1.0583E-16	7.6789E+08	8.0792E+04
Xe-131m		1.7825E-02	2.1281E-10	9.7829E+14	6.5953E+08
Xe-133m		5.8647E-02	1.3070E-10	5.9181E+14	2.1700E+09
Xe-135m		1.0741E+00	1.1791E-11	5.2599E+13	3.9742E+10

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		2.1727E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	1.2593E+21
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	8.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		1.4364E+02	1.7654E-06	1.2362E+19	5.3148E+12
Cs-134		1.6257E+04	1.2565E-02	5.6470E+22	6.0152E+14
Cs-136		4.1508E+03	5.6635E-05	2.5078E+20	1.5358E+14
Cs-137		8.7946E+03	1.0111E-01	4.4444E+23	3.2540E+14
Cs-134m		6.0512E-03	7.5037E-13	3.3723E+12	2.2390E+08
Rb-88		4.7275E-08	3.9383E-19	2.6951E+06	1.7492E+03
Ba-137m		9.7490E+03	1.8128E-08	7.9684E+16	3.6071E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =	8.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		1.1373E-01

Environment Integral Nuclide Release:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Kr-85		1.0614E+03	2.7054E-03	1.9167E+22	3.9272E+13
Xe-133		6.3291E+04	3.3812E-04	1.5310E+21	2.3418E+15
Xe-135		2.3824E+03	9.3292E-07	4.1616E+18	8.8149E+13
Kr-83m		1.8585E-03	9.0080E-14	6.5359E+11	6.8766E+07
Xe-131m		4.2038E+02	5.0188E-06	2.3072E+19	1.5554E+13
Xe-133m		1.5834E+03	3.5289E-06	1.5979E+19	5.8587E+13
Xe-135m		3.0472E+01	3.3452E-10	1.4922E+15	1.1275E+12

Environment Transport Group Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	Present	Release	Integral
	Release	Rate/s	Release
Time (h) =	8.0000		
Noble gases (atoms)	3.2938E+16	4.5748E+14	2.0741E+22
Elemental I (atoms)	3.7239E+00	5.1721E-02	5.1674E+18
Organic I (atoms)	1.4098E+00	1.9580E-02	1.9562E+18
Aerosols (kg)	4.0341E-25	5.6029E-27	2.9327E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	1.4364E+02	1.7654E-06	1.2362E+19	5.3148E+12
Cs-134	1.6257E+04	1.2565E-02	5.6470E+22	6.0152E+14
Cs-136	4.1508E+03	5.6635E-05	2.5078E+20	1.5358E+14
Cs-137	8.7946E+03	1.0111E-01	4.4444E+23	3.2540E+14
Cs-134m	6.0512E-03	7.5037E-13	3.3723E+12	2.2390E+08
Rb-88	4.7275E-08	3.9383E-19	2.6951E+06	1.7492E+03
Ba-137m	9.7490E+03	1.8128E-08	7.9684E+16	3.6071E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
	Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1373E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
	Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
I-131	7.6239E-02	6.1495E-10	2.8270E+15	2.8208E+09
I-132	6.8618E-03	6.6476E-13	3.0328E+12	2.5389E+08
I-133	1.7647E-02	1.5578E-11	7.0538E+13	6.5296E+08
I-135	2.9515E-04	8.4044E-14	3.7490E+11	1.0921E+07
I-130	1.2406E-04	6.3607E-14	2.9465E+11	4.5901E+06
Br-82	1.3435E-04	1.2410E-13	9.1138E+11	4.9710E+06
Br-83	6.6233E-10	4.1926E-20	3.0420E+05	2.4506E+01

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
	Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.1052E+15
Organic I (atoms)	7.9695E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
	Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
	Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	7.3998E+01	9.0943E-07	6.3683E+18	2.7379E+12
I-131	8.8029E+01	7.1006E-07	3.2642E+18	3.2571E+12
I-132	7.5956E+00	7.3585E-10	3.3571E+15	2.8104E+11
I-133	2.0377E+01	1.7988E-08	8.1449E+16	7.5395E+11
I-135	3.4080E-01	9.7043E-11	4.3289E+14	1.2610E+10
Cs-134	8.3750E+03	6.4730E-03	2.9091E+22	3.0987E+14
Cs-136	2.1383E+03	2.9176E-05	1.2919E+20	7.9117E+13
Cs-137	4.5305E+03	5.2086E-02	2.2896E+23	1.6763E+14
I-130	1.4324E-01	7.3446E-11	3.4023E+14	5.3000E+09
Cs-134m	3.1173E-03	3.8655E-13	1.7372E+12	1.1534E+08
Rb-88	2.4354E-08	2.0288E-19	1.3884E+06	9.0109E+02
Ba-137m	5.0222E+03	9.3384E-09	4.1049E+16	1.8582E+14
Br-82	1.5513E-01	1.4329E-10	1.0523E+15	5.7399E+09
Br-83	7.6478E-07	4.8410E-17	3.5125E+08	2.8297E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.4306E+18
Organic I (atoms)	9.2016E+17
Aerosols (kg)	5.8589E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Kr-85	5.6991E-08	1.4526E-13	1.0291E+12	2.1087E+03
Xe-133	1.9977E-02	1.0672E-10	4.8324E+14	7.3914E+08
Xe-135	4.4324E-03	1.7357E-12	7.7425E+12	1.6400E+08
Kr-83m	5.0803E-08	2.4623E-18	1.7866E+07	1.8797E+03
Xe-131m	4.2988E-04	5.1322E-12	2.3593E+13	1.5905E+07
Xe-133m	1.4253E-03	3.1766E-12	1.4383E+13	5.2738E+07
Xe-135m	1.2397E-02	1.3609E-13	6.0709E+11	4.5869E+08

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
8.0000			
Noble gases (atoms)	5.3060E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	7.0126E+01	0.0000E+00	0.0000E+00
Organic I (atoms)	2.6547E+01	0.0000E+00	0.0000E+00
Aerosols (kg)	7.6118E-24	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
I-131	9.1411E-02	7.3733E-10	3.3896E+15	3.3822E+09
I-132	7.1240E-03	6.9017E-13	3.1487E+12	2.6359E+08
I-133	2.1161E-02	1.8680E-11	8.4581E+13	7.8295E+08
I-135	3.5391E-04	1.0078E-13	4.4954E+11	1.3095E+07
I-130	1.4875E-04	7.6270E-14	3.5332E+11	5.5039E+06
Br-82	1.6110E-04	1.4880E-13	1.0928E+12	5.9607E+06
Br-83	7.9419E-10	5.0272E-20	3.6475E+05	2.9385E+01

Deposition Recirculating

Time (h) =	Surfaces	Filter
8.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.5238E+15
Organic I (atoms)	0.0000E+00	9.5542E+14
Aerosols (kg)	0.0000E+00	5.5035E-22

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway
8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	8.0000	Ci	kg	Atoms	Bq
I-131		7.6239E-02	6.1495E-10	2.8270E+15	2.8208E+09
I-132		6.8618E-03	6.6476E-13	3.0328E+12	2.5389E+08
I-133		1.7647E-02	1.5578E-11	7.0538E+13	6.5296E+08
I-135		2.9515E-04	8.4044E-14	3.7490E+11	1.0921E+07
I-130		1.2406E-04	6.3607E-14	2.9465E+11	4.5901E+06
Br-82		1.3435E-04	1.2410E-13	9.1138E+11	4.9710E+06
Br-83		6.6233E-10	4.1926E-20	3.0420E+05	2.4506E+01

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	2.1052E+15	
Organic I (atoms)	7.9695E+14	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Exhaust Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Total Filter Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
I-131		1.6765E-01	1.3523E-09	6.2165E+15	6.2030E+09
I-132		1.3986E-02	1.3549E-12	6.1815E+12	5.1747E+08
I-133		3.8808E-02	3.4258E-11	1.5512E+14	1.4359E+09
I-135		6.4906E-04	1.8482E-13	8.2445E+11	2.4015E+07
I-130		2.7281E-04	1.3988E-13	6.4797E+11	1.0094E+07
Br-82		2.9545E-04	2.7290E-13	2.0042E+12	1.0932E+07
Br-83		1.4565E-09	9.2198E-20	6.6895E+05	5.3891E+01

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Xe-133		4.2199E-01	2.2545E-09	1.0208E+16	1.5614E+10
Xe-135		8.5216E-02	3.3369E-11	1.4885E+14	3.1530E+09
Kr-83m		1.1249E-06	5.4520E-17	3.9558E+08	4.1620E+04
Xe-131m		9.1826E-03	1.0963E-10	5.0397E+14	3.3976E+08
Xe-133m		3.0212E-02	6.7332E-11	3.0487E+14	1.1179E+09
Xe-135m		5.5332E-01	6.0743E-12	2.7097E+13	2.0473E+10

Fuel Pool-Filtered Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.1193E+16	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	6.4871E+20	
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00	

Time (h) =	8.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	7.3998E+01	9.0943E-07	6.3683E+18	2.7379E+12
I-131	8.8029E+01	7.1006E-07	3.2642E+18	3.2571E+12
I-132	7.5956E+00	7.3585E-10	3.3571E+15	2.8104E+11
I-133	2.0377E+01	1.7988E-08	8.1449E+16	7.5395E+11
I-135	3.4080E-01	9.7043E-11	4.3289E+14	1.2610E+10
Cs-134	8.3750E+03	6.4730E-03	2.9091E+22	3.0987E+14
Cs-136	2.1383E+03	2.9176E-05	1.2919E+20	7.9117E+13
Cs-137	4.5305E+03	5.2086E-02	2.2896E+23	1.6763E+14
I-130	1.4324E-01	7.3446E-11	3.4023E+14	5.3000E+09
Cs-134m	3.1173E-03	3.8655E-13	1.7372E+12	1.1534E+08
Rb-88	2.4354E-08	2.0288E-19	1.3884E+06	9.0109E+02
Ba-137m	5.0222E+03	9.3384E-09	4.1049E+16	1.8582E+14
Br-82	1.5513E-01	1.4329E-10	1.0523E+15	5.7399E+09
Br-83	7.6478E-07	4.8410E-17	3.5125E+08	2.8297E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.4306E+18
Organic I (atoms)	9.2016E+17
Aerosols (kg)	5.8589E-02

Detailed model information at time (H) = 24.0000

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	3.0567E-02	1.4400E-16	5.2440E-02	3.0567E-02
Accumulated dose (rem)	4.1208E-01	4.1145E+01	1.1341E+00	1.6734E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	1.1569E-03	5.4501E-18	1.9847E-03	1.1569E-03
Accumulated dose (rem)	4.5945E-02	5.0564E+00	1.3148E-01	2.0095E-01

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	4.4120E-04	7.2779E-13	2.8802E-02	4.4120E-04
Accumulated dose (rem)	3.7907E-02	8.1573E+01	3.8657E+00	2.5380E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
24.0000				
Xe-133	4.8063E-01	2.5677E-09	1.1626E+16	1.7783E+10
Xe-135	3.0897E-02	1.2099E-11	5.3971E+13	1.1432E+09
Kr-83m	2.1082E-08	1.0218E-18	7.4137E+06	7.8002E+02
Xe-131m	1.6829E-02	2.0092E-10	9.2365E+14	6.2269E+08
Xe-133m	3.4410E-02	7.6688E-11	3.4724E+14	1.2732E+09
Xe-135m	2.0062E-01	2.2024E-12	9.8246E+12	7.4230E+09

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
24.0000			
Noble gases (atoms)	1.2961E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.1765E+21
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
24.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.4013E+02	1.7222E-06	1.2060E+19	5.1848E+12
Cs-134	1.6247E+04	1.2558E-02	5.6435E+22	6.0115E+14
Cs-136	4.0070E+03	5.4672E-05	2.4209E+20	1.4826E+14
Cs-137	8.7942E+03	1.0110E-01	4.4442E+23	3.2539E+14
Cs-134m	1.3213E-04	1.6384E-14	7.3632E+10	4.8887E+06
Ba-137m	9.7486E+03	1.8127E-08	7.9680E+16	3.6070E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1372E-01

Environment Integral Nuclide Release:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	5.8814E+04	3.1421E-04	1.4227E+21	2.1761E+15
Xe-135	7.6014E+02	2.9766E-07	1.3278E+18	2.8125E+13
Kr-83m	1.8046E-05	8.7465E-16	6.3461E+09	6.6770E+05
Xe-131m	4.2507E+02	5.0748E-06	2.3329E+19	1.5728E+13
Xe-133m	1.3315E+03	2.9674E-06	1.3436E+19	4.9264E+13
Xe-135m	5.6930E+00	6.2497E-11	2.7879E+14	2.1064E+11

Environment Transport Group Inventory:

Time (h) = 24.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	1.9648E+16	2.7289E+14	2.0626E+22
Elemental I (atoms)	5.3992E-34	7.4989E-36	4.8279E+18
Organic I (atoms)	2.0440E-34	2.8388E-36	1.8277E+18
Aerosols (kg)	2.2421E-44	3.1140E-46	5.9065E-15

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.4013E+02	1.7222E-06	1.2060E+19	5.1848E+12
Cs-134	1.6247E+04	1.2558E-02	5.6435E+22	6.0115E+14
Cs-136	4.0070E+03	5.4672E-05	2.4209E+20	1.4826E+14
Cs-137	8.7942E+03	1.0110E-01	4.4442E+23	3.2539E+14
Cs-134m	1.3213E-04	1.6384E-14	7.3632E+10	4.8887E+06
Ba-137m	9.7486E+03	1.8127E-08	7.9680E+16	3.6070E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1372E-01

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
--------------------	----	----	-------	----

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-131	7.1981E-02	5.8061E-10	2.6691E+15	2.6633E+09
I-132	5.5248E-05	5.3524E-15	2.4419E+10	2.0442E+06
I-133	1.0354E-02	9.1404E-12	4.1387E+13	3.8311E+08
I-135	5.5128E-05	1.5698E-14	7.0025E+10	2.0398E+06
I-130	5.0575E-05	2.5931E-14	1.2012E+11	1.8713E+06
Br-82	9.8130E-05	9.0639E-14	6.6566E+11	3.6308E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.9668E+15
Organic I (atoms)	7.4456E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	7.2188E+01	8.8719E-07	6.2125E+18	2.6710E+12
I-131	8.3112E+01	6.7040E-07	3.0819E+18	3.0752E+12
I-132	6.1156E-02	5.9247E-12	2.7030E+13	2.2628E+09
I-133	1.1956E+01	1.0554E-08	4.7788E+16	4.4237E+11
I-135	6.3655E-02	1.8126E-11	8.0857E+13	2.3552E+09
Cs-134	8.3699E+03	6.4691E-03	2.9073E+22	3.0968E+14
Cs-136	2.0642E+03	2.8164E-05	1.2471E+20	7.6375E+13
Cs-137	4.5303E+03	5.2084E-02	2.2895E+23	1.6762E+14
I-130	5.8397E-02	2.9942E-11	1.3870E+14	2.1607E+09
Cs-134m	6.8065E-05	8.4402E-15	3.7932E+10	2.5184E+06
Ba-137m	5.0220E+03	9.3380E-09	4.1047E+16	1.8581E+14
Br-82	1.1331E-01	1.0466E-10	7.6862E+14	4.1924E+09
Br-83	7.3837E-09	4.6739E-19	3.3912E+06	2.7320E+02

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.2709E+18
Organic I (atoms)	8.5971E+17
Aerosols (kg)	5.8582E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	4.4990E-03	2.4035E-11	1.0883E+14	1.6646E+08
Xe-135	3.1781E-04	1.2445E-13	5.5515E+11	1.1759E+07
Xe-131m	1.5581E-04	1.8601E-12	8.5511E+12	5.7648E+06
Xe-133m	3.2104E-04	7.1547E-13	3.2396E+12	1.1878E+07
Xe-135m	8.8927E-04	9.7623E-15	4.3548E+10	3.2903E+07

Control Room Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
--------------------	------------	------	----------------

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Noble gases (atoms)	1.2122E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.0167E-32	0.0000E+00	0.0000E+00
Organic I (atoms)	3.8490E-33	0.0000E+00	0.0000E+00
Aerosols (kg)	4.1619E-43	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	8.6305E-02	6.9615E-10	3.2002E+15	3.1933E+09
I-132	5.7359E-05	5.5569E-15	2.5352E+10	2.1223E+06
I-133	1.2416E-02	1.0960E-11	4.9626E+13	4.5938E+08
I-135	6.6103E-05	1.8823E-14	8.3966E+10	2.4458E+06
I-130	6.0643E-05	3.1094E-14	1.4404E+11	2.2438E+06
Br-82	1.1767E-04	1.0868E-13	7.9818E+11	4.3536E+06

Deposition Recirculating

Time (h) = 24.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.3582E+15
Organic I (atoms)	0.0000E+00	8.9273E+14
Aerosols (kg)	0.0000E+00	3.4285E-38

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	7.1981E-02	5.8061E-10	2.6691E+15	2.6633E+09
I-132	5.5248E-05	5.3524E-15	2.4419E+10	2.0442E+06
I-133	1.0354E-02	9.1404E-12	4.1387E+13	3.8311E+08
I-135	5.5128E-05	1.5698E-14	7.0025E+10	2.0398E+06
I-130	5.0575E-05	2.5931E-14	1.2012E+11	1.8713E+06
Br-82	9.8130E-05	9.0639E-14	6.6566E+11	3.6308E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.9668E+15
Organic I (atoms)	7.4456E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	1.5829E-01	1.2768E-09	5.8693E+15	5.8566E+09
I-132	1.1261E-04	1.0909E-14	4.9771E+10	4.1665E+06

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-133	2.2770E-02	2.0100E-11	9.1013E+13	8.4249E+08
I-135	1.2123E-04	3.4521E-14	1.5399E+11	4.4856E+06
I-130	1.1122E-04	5.7025E-14	2.6416E+11	4.1151E+06
Br-82	2.1580E-04	1.9932E-13	1.4638E+12	7.9844E+06

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	2.4760E-01	1.3228E-09	5.9894E+15	9.1611E+09
Xe-135	1.5917E-02	6.2328E-12	2.7803E+13	5.8892E+08
Kr-83m	1.0860E-08	5.2638E-19	3.8192E+06	4.0183E+02
Xe-131m	8.6697E-03	1.0351E-10	4.7582E+14	3.2078E+08
Xe-133m	1.7726E-02	3.9506E-11	1.7888E+14	6.5588E+08
Xe-135m	1.0335E-01	1.1346E-12	5.0611E+12	3.8240E+09

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	6.6769E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	6.0609E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 24.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	7.2188E+01	8.8719E-07	6.2125E+18	2.6710E+12
I-131	8.3112E+01	6.7040E-07	3.0819E+18	3.0752E+12
I-132	6.1156E-02	5.9247E-12	2.7030E+13	2.2628E+09
I-133	1.1956E+01	1.0554E-08	4.7788E+16	4.4237E+11
I-135	6.3655E-02	1.8126E-11	8.0857E+13	2.3552E+09
Cs-134	8.3699E+03	6.4691E-03	2.9073E+22	3.0968E+14
Cs-136	2.0642E+03	2.8164E-05	1.2471E+20	7.6375E+13
Cs-137	4.5303E+03	5.2084E-02	2.2895E+23	1.6762E+14
I-130	5.8397E-02	2.9942E-11	1.3870E+14	2.1607E+09
Cs-134m	6.8065E-05	8.4402E-15	3.7932E+10	2.5184E+06
Ba-137m	5.0220E+03	9.3380E-09	4.1047E+16	1.8581E+14
Br-82	1.1331E-01	1.0466E-10	7.6862E+14	4.1924E+09
Br-83	7.3837E-09	4.6739E-19	3.3912E+06	2.7320E+02

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.2709E+18
Organic I (atoms)	8.5971E+17
Aerosols (kg)	5.8582E-02

Detailed model information at time (H) = 96.0000

EAB Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	9.7779E-03	2.8006E-38	2.2081E-02	9.7779E-03
Accumulated dose (rem)	4.2186E-01	4.1145E+01	1.1562E+00	1.6832E+00

LPZ Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.5728E-04	4.5048E-40	3.5518E-04	1.5728E-04
Accumulated dose (rem)	4.6102E-02	5.0564E+00	1.3183E-01	2.0110E-01

Control Room Doses:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.4244E-05	6.6464E-35	6.5753E-03	7.4244E-05
Accumulated dose (rem)	3.7982E-02	8.1573E+01	3.8723E+00	2.5381E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	4.3630E-02	2.3309E-10	1.0554E+15	1.6143E+09
Xe-135	1.6253E-05	6.3643E-15	2.8390E+10	6.0135E+05
Xe-131m	1.2994E-02	1.5513E-10	7.1315E+14	4.8078E+08
Xe-133m	3.1236E-03	6.9614E-12	3.1521E+13	1.1557E+08
Xe-135m	1.0553E-04	1.1585E-15	5.1679E+09	3.9047E+06

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.8001E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	8.9594E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.2535E+02	1.5406E-06	1.0788E+19	4.6381E+12
Cs-134	1.6203E+04	1.2523E-02	5.6280E+22	5.9949E+14
Cs-136	3.4188E+03	4.6647E-05	2.0656E+20	1.2650E+14
Cs-137	8.7925E+03	1.0108E-01	4.4434E+23	3.2532E+14
Ba-137m	9.7468E+03	1.8123E-08	7.9665E+16	3.6063E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1366E-01

Environment Integral Nuclide Release:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	4.0614E+04	2.1698E-04	9.8246E+20	1.5027E+15
Xe-135	3.4893E+00	1.3663E-09	6.0951E+15	1.2910E+11
Xe-131m	4.3126E+02	5.1487E-06	2.3669E+19	1.5957E+13
Xe-133m	5.5327E+02	1.2330E-06	5.5831E+18	2.0471E+13
Xe-135m	2.9948E-03	3.2876E-14	1.4666E+11	1.1081E+08

Environment Transport Group Inventory:

Time (h) = 96.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.7284E+15	3.7894E+13	2.0166E+22
Elemental I (atoms)	0.0000E+00	0.0000E+00	3.6765E+18
Organic I (atoms)	0.0000E+00	0.0000E+00	1.3918E+18
Aerosols (kg)	0.0000E+00	0.0000E+00	1.3791E-22

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.2535E+02	1.5406E-06	1.0788E+19	4.6381E+12
Cs-134	1.6203E+04	1.2523E-02	5.6280E+22	5.9949E+14
Cs-136	3.4188E+03	4.6647E-05	2.0656E+20	1.2650E+14
Cs-137	8.7925E+03	1.0108E-01	4.4434E+23	3.2532E+14
Ba-137m	9.7468E+03	1.8123E-08	7.9665E+16	3.6063E+14

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1366E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	5.5576E-02	4.4829E-10	2.0608E+15	2.0563E+09
I-133	9.3992E-04	8.2973E-13	3.7569E+12	3.4777E+07
I-135	2.8999E-08	8.2574E-18	3.6835E+07	1.0730E+03
I-130	8.9199E-07	4.5735E-16	2.1186E+09	3.3004E+04
Br-82	2.3867E-05	2.2045E-14	1.6190E+11	8.8309E+05

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.4977E+15
Organic I (atoms)	5.6699E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	6.4576E+01	7.9363E-07	5.5574E+18	2.3893E+12
I-131	6.4171E+01	5.1762E-07	2.3795E+18	2.3743E+12
I-133	1.0853E+00	9.5807E-10	4.3381E+15	4.0156E+10
I-135	3.3484E-05	9.5346E-15	4.2532E+10	1.2389E+06
Cs-134	8.3468E+03	6.4512E-03	2.8993E+22	3.0883E+14
Cs-136	1.7612E+03	2.4030E-05	1.0641E+20	6.5165E+13
Cs-137	4.5295E+03	5.2074E-02	2.2890E+23	1.6759E+14
I-130	1.0300E-03	5.2809E-13	2.4463E+12	3.8108E+07
Ba-137m	5.0211E+03	9.3363E-09	4.1040E+16	1.8578E+14
Br-82	2.7559E-02	2.5455E-11	1.8695E+14	1.0197E+09

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.7294E+18
Organic I (atoms)	6.5468E+17
Aerosols (kg)	5.8550E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	3.0853E-04	1.6483E-12	7.4633E+12	1.1416E+07
Xe-135	1.2629E-07	4.9454E-17	2.2061E+08	4.6728E+03
Xe-131m	9.0880E-05	1.0850E-12	4.9877E+12	3.3625E+06
Xe-133m	2.2016E-05	4.9065E-14	2.2216E+11	8.1458E+05
Xe-135m	3.5345E-07	3.8802E-18	1.7309E+07	1.3078E+04

Control Room Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.2673E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	6.6636E-02	5.3750E-10	2.4709E+15	2.4655E+09
I-133	1.1270E-03	9.9491E-13	4.5049E+12	4.1701E+07
I-135	3.4772E-08	9.9013E-18	4.4168E+07	1.2866E+03
I-130	1.0696E-06	5.4840E-16	2.5404E+09	3.9574E+04
Br-82	2.8619E-05	2.6434E-14	1.9413E+11	1.0589E+06

Deposition Recirculating

Time (h) = 96.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.7958E+15
Organic I (atoms)	0.0000E+00	6.7983E+14
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	5.5576E-02	4.4829E-10	2.0608E+15	2.0563E+09
I-133	9.3992E-04	8.2973E-13	3.7569E+12	3.4777E+07
I-135	2.8999E-08	8.2574E-18	3.6835E+07	1.0730E+03
I-130	8.9199E-07	4.5735E-16	2.1186E+09	3.3004E+04
Br-82	2.3867E-05	2.2045E-14	1.6190E+11	8.8309E+05

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.4977E+15
Organic I (atoms)	5.6699E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	1.2221E-01	9.8579E-10	4.5317E+15	4.5219E+09
I-133	2.0670E-03	1.8246E-12	8.2618E+12	7.6478E+07
I-135	6.3771E-08	1.8159E-17	8.1003E+07	2.3595E+03
I-130	1.9616E-06	1.0058E-15	4.6591E+09	7.2578E+04
Br-82	5.2486E-05	4.8480E-14	3.5604E+11	1.9420E+06

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	2.2476E-02	1.2008E-10	5.4369E+14	8.3161E+08
Xe-135	8.3726E-06	3.2786E-15	1.4625E+10	3.0979E+05
Xe-131m	6.6939E-03	7.9917E-11	3.6738E+14	2.4767E+08
Xe-133m	1.6091E-03	3.5862E-12	1.6238E+13	5.9538E+07
Xe-135m	5.4365E-05	5.9681E-16	2.6623E+09	2.0115E+06

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	9.2733E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	4.6155E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	6.4576E+01	7.9363E-07	5.5574E+18	2.3893E+12
I-131	6.4171E+01	5.1762E-07	2.3795E+18	2.3743E+12
I-133	1.0853E+00	9.5807E-10	4.3381E+15	4.0156E+10
I-135	3.3484E-05	9.5346E-15	4.2532E+10	1.2389E+06
Cs-134	8.3468E+03	6.4512E-03	2.8993E+22	3.0883E+14
Cs-136	1.7612E+03	2.4030E-05	1.0641E+20	6.5165E+13
Cs-137	4.5295E+03	5.2074E-02	2.2890E+23	1.6759E+14
I-130	1.0300E-03	5.2809E-13	2.4463E+12	3.8108E+07
Ba-137m	5.0211E+03	9.3363E-09	4.1040E+16	1.8578E+14
Br-82	2.7559E-02	2.5455E-11	1.8695E+14	1.0197E+09

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.7294E+18
Organic I (atoms)	6.5468E+17
Aerosols (kg)	5.8550E-02

Detailed model information at time (H) = 720.0000

EAB Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
---------------------	------------	---------	------	------

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Delta dose (rem)	5.2148E-04	5.8163-125	3.4903E-03	5.2148E-04
Accumulated dose (rem)	4.2238E-01	4.1145E+01	1.1597E+00	1.6837E+00

LPZ Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.4574E-06	2.7409-127	1.6448E-05	2.4574E-06
Accumulated dose (rem)	4.6105E-02	5.0564E+00	1.3185E-01	2.0111E-01

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.8737E-06	9.2022-122	6.4978E-04	2.8737E-06
Accumulated dose (rem)	3.7985E-02	8.1573E+01	3.8730E+00	2.5381E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	4.0633E-11	2.1708E-19	9.8292E+05	1.5034E+00
Xe-131m	1.3812E-03	1.6490E-11	7.5806E+13	5.1105E+07

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	7.5806E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	9.5055E+19
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	4.7719E+01	5.8647E-07	4.1067E+18	1.7656E+12
Cs-134	1.5819E+04	1.2227E-02	5.4949E+22	5.8532E+14
Cs-136	8.6380E+02	1.1786E-05	5.2188E+19	3.1961E+13
Cs-137	8.7781E+03	1.0092E-01	4.4361E+23	3.2479E+14
Ba-137m	9.7307E+03	1.8094E-08	7.9534E+16	3.6004E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1316E-01

Environment Integral Nuclide Release:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	1.3242E+03	7.0744E-06	3.2032E+19	4.8995E+13
Xe-131m	1.9138E+02	2.2848E-06	1.0503E+19	7.0811E+12

Environment Transport Group Inventory:

Time (h) = 720.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	1.1486E+14	1.5953E+12	1.9109E+22
Elemental I (atoms)	0.0000E+00	0.0000E+00	3.9006E+17
Organic I (atoms)	0.0000E+00	0.0000E+00	1.4766E+17
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
---------------------	----	----	-------	----

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Rb-86	4.7719E+01	5.8647E-07	4.1067E+18	1.7656E+12
Cs-134	1.5819E+04	1.2227E-02	5.4949E+22	5.8532E+14
Cs-136	8.6380E+02	1.1786E-05	5.2188E+19	3.1961E+13
Cs-137	8.7781E+03	1.0092E-01	4.4361E+23	3.2479E+14
Ba-137m	9.7307E+03	1.8094E-08	7.9534E+16	3.6004E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.1316E-01

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	5.9076E-03	4.7652E-11	2.1906E+14	2.1858E+08
Br-82	1.1389E-10	1.0519E-19	7.7256E+05	4.2139E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.5890E+14
Organic I (atoms)	6.0155E+13
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	2.4583E+01	3.0212E-07	2.1156E+18	9.0956E+11
I-131	6.8212E+00	5.5021E-08	2.5293E+17	2.5238E+11
I-133	1.0108E-09	8.9227E-19	4.0401E+06	3.7399E+01
Cs-134	8.1494E+03	6.2987E-03	2.8307E+22	3.0153E+14
Cs-136	4.4499E+02	6.0715E-06	2.6885E+19	1.6465E+13
Cs-137	4.5220E+03	5.1988E-02	2.2853E+23	1.6732E+14
Ba-137m	5.0128E+03	9.3209E-09	4.0972E+16	1.8547E+14
Br-82	1.3150E-07	1.2147E-16	8.9205E+08	4.8656E+03

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.8348E+17
Organic I (atoms)	6.9458E+16
Aerosols (kg)	5.8293E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-131m	7.3886E-06	8.8211E-14	4.0551E+11	2.7338E+05

Control Room Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	4.0551E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	7.0832E-03	5.7134E-11	2.6265E+14	2.6208E+08
Br-82	1.3656E-10	1.2614E-19	9.2636E+05	5.0528E+00

Deposition Recirculating

Time (h) = 720.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.9052E+14
Organic I (atoms)	0.0000E+00	7.2126E+13
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	5.9076E-03	4.7652E-11	2.1906E+14	2.1858E+08
Br-82	1.1389E-10	1.0519E-19	7.7256E+05	4.2139E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.5890E+14
Organic I (atoms)	6.0155E+13
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Control Room Total Filter Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	1.2991E-02	1.0479E-10	4.8171E+14	4.8066E+08
Br-82	2.5045E-10	2.3133E-19	1.6989E+06	9.2666E+00

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	2.0932E-11	1.1183E-19	5.0635E+05	7.7450E-01
Xe-131m	7.1154E-04	8.4949E-12	3.9051E+13	2.6327E+07

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	3.9051E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	4.8968E+19
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	2.4583E+01	3.0212E-07	2.1156E+18	9.0956E+11
I-131	6.8212E+00	5.5021E-08	2.5293E+17	2.5238E+11
I-133	1.0108E-09	8.9227E-19	4.0401E+06	3.7399E+01
Cs-134	8.1494E+03	6.2987E-03	2.8307E+22	3.0153E+14
Cs-136	4.4499E+02	6.0715E-06	2.6885E+19	1.6465E+13
Cs-137	4.5220E+03	5.1988E-02	2.2853E+23	1.6732E+14
Ba-137m	5.0128E+03	9.3209E-09	4.0972E+16	1.8547E+14
Br-82	1.3150E-07	1.2147E-16	8.9205E+08	4.8656E+03

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.8348E+17
Organic I (atoms)	6.9458E+16
Aerosols (kg)	5.8293E-02

Transport Group Totals in Model:

Noble Gases (atoms)	1.9109E+22
Elemental I (atoms)	1.4460E+20
Organic I (atoms)	2.1726E+17
Aerosols (kg)	1.7145E-01

37004

I-131 Summary
#####

Time (hr)	Fuel Pool-Unfiltered I-131 (Curies)	Environment I-131 (Curies)	Control Room I-131 (Curies)
0.000	0.0000E+00	0.0000E+00	0.0000E+00
0.001	0.0000E+00	0.0000E+00	0.0000E+00
0.002	0.0000E+00	0.0000E+00	0.0000E+00
0.280	1.5427E-02	2.6424E+01	8.7548E-02
0.333	1.5424E-02	3.1490E+01	1.0147E-01
0.600	1.5410E-02	5.6895E+01	3.6033E-02

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

0.860	1.5396E-02	8.1591E+01	1.8390E-02
1.120	1.5382E-02	1.0624E+02	1.3407E-02
1.380	1.5368E-02	1.3083E+02	1.1995E-02
1.640	1.5354E-02	1.5539E+02	1.1589E-02
1.900	1.5341E-02	1.7989E+02	1.1468E-02
2.000	1.5335E-02	1.8931E+02	1.1447E-02
2.002	1.5335E-02	1.8949E+02	1.1423E-02
2.280	0.0000E+00	1.9103E+02	3.1647E-03
2.540	0.0000E+00	1.9085E+02	8.9235E-04
2.800	0.0000E+00	1.9067E+02	2.5161E-04
3.060	0.0000E+00	1.9050E+02	7.0946E-05
3.320	0.0000E+00	1.9032E+02	2.0004E-05
3.580	0.0000E+00	1.9014E+02	5.6406E-06
3.840	0.0000E+00	1.8996E+02	1.5905E-06
4.100	0.0000E+00	1.8979E+02	4.4845E-07
4.360	0.0000E+00	1.8961E+02	1.2645E-07
4.620	0.0000E+00	1.8943E+02	3.5654E-08
4.880	0.0000E+00	1.8926E+02	1.0053E-08
5.140	0.0000E+00	1.8908E+02	2.8347E-09
5.400	0.0000E+00	1.8890E+02	7.9929E-10
5.660	0.0000E+00	1.8873E+02	2.2537E-10
5.920	0.0000E+00	1.8855E+02	6.3548E-11
6.180	0.0000E+00	1.8837E+02	1.7918E-11
6.440	0.0000E+00	1.8820E+02	5.0523E-12
6.700	0.0000E+00	1.8802E+02	1.4246E-12
6.960	0.0000E+00	1.8785E+02	4.0169E-13
7.220	0.0000E+00	1.8767E+02	1.1326E-13
7.480	0.0000E+00	1.8750E+02	3.1936E-14
7.740	0.0000E+00	1.8732E+02	9.0049E-15
8.000	0.0000E+00	1.8715E+02	2.5391E-15
8.260	0.0000E+00	1.8697E+02	7.1594E-16
8.520	0.0000E+00	1.8680E+02	2.0187E-16
8.780	0.0000E+00	1.8662E+02	5.6921E-17
9.040	0.0000E+00	1.8645E+02	1.6050E-17
9.300	0.0000E+00	1.8627E+02	4.5255E-18
9.560	0.0000E+00	1.8610E+02	1.2760E-18
9.820	0.0000E+00	1.8593E+02	3.5980E-19
10.080	0.0000E+00	1.8575E+02	1.0145E-19
24.000	0.0000E+00	1.7669E+02	3.7211E-49
96.000	0.0000E+00	1.3643E+02	2.0779-201
720.000	0.0000E+00	1.4502E+01	0.0000E+00

Fuel Pool-Filtered

Time (hr)	I-131 (Curies)
0.000	0.0000E+00
0.001	0.0000E+00
0.002	0.0000E+00
0.280	7.9472E-03
0.333	7.9457E-03
0.600	7.9384E-03
0.860	7.9312E-03
1.120	7.9241E-03
1.380	7.9170E-03
1.640	7.9098E-03
1.900	7.9027E-03
2.000	7.9000E-03
2.002	7.8999E-03
2.280	0.0000E+00
2.540	0.0000E+00
2.800	0.0000E+00
3.060	0.0000E+00
3.320	0.0000E+00
3.580	0.0000E+00
3.840	0.0000E+00
4.100	0.0000E+00
4.360	0.0000E+00
4.620	0.0000E+00
4.880	0.0000E+00
5.140	0.0000E+00
5.400	0.0000E+00
5.660	0.0000E+00
5.920	0.0000E+00
6.180	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

6.440	0.0000E+00
6.700	0.0000E+00
6.960	0.0000E+00
7.220	0.0000E+00
7.480	0.0000E+00
7.740	0.0000E+00
8.000	0.0000E+00
8.260	0.0000E+00
8.520	0.0000E+00
8.780	0.0000E+00
9.040	0.0000E+00
9.300	0.0000E+00
9.560	0.0000E+00
9.820	0.0000E+00
10.080	0.0000E+00
24.000	0.0000E+00
96.000	0.0000E+00
720.000	0.0000E+00

 Cumulative Dose Summary
 #####

Time (hr)	EAB		LPZ		Control Room	
	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)
0.000	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.001	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.002	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.280	5.6751E+00	2.2212E-01	7.0123E-01	2.7446E-02	1.8015E+01	5.5610E-01
0.333	6.7636E+00	2.6474E-01	8.3572E-01	3.2712E-02	2.5117E+01	7.7530E-01
0.600	1.2224E+01	4.7851E-01	1.5104E+00	5.9125E-02	4.8370E+01	1.4946E+00
0.860	1.7535E+01	6.8650E-01	2.1666E+00	8.4826E-02	5.7671E+01	1.7843E+00
1.120	2.2838E+01	8.9421E-01	2.8219E+00	1.1049E-01	6.3302E+01	1.9607E+00
1.380	2.8133E+01	1.1017E+00	3.4762E+00	1.3612E-01	6.7896E+01	2.1050E+00
1.640	3.3422E+01	1.3089E+00	4.1298E+00	1.6172E-01	7.2193E+01	2.2400E+00
1.900	3.8705E+01	1.5158E+00	4.7825E+00	1.8729E-01	7.6403E+01	2.3722E+00
2.000	4.0735E+01	1.5953E+00	5.0333E+00	1.9712E-01	7.8013E+01	2.4227E+00
2.002	4.0775E+01	1.5970E+00	5.0356E+00	1.9722E-01	7.8046E+01	2.4237E+00
2.280	4.1145E+01	1.6132E+00	5.0563E+00	1.9812E-01	8.0659E+01	2.5063E+00
2.540	4.1145E+01	1.6150E+00	5.0563E+00	1.9822E-01	8.1315E+01	2.5276E+00
2.800	4.1145E+01	1.6167E+00	5.0564E+00	1.9832E-01	8.1500E+01	2.5339E+00
3.060	4.1145E+01	1.6183E+00	5.0564E+00	1.9841E-01	8.1552E+01	2.5358E+00
3.320	4.1145E+01	1.6200E+00	5.0564E+00	1.9851E-01	8.1567E+01	2.5365E+00
3.580	4.1145E+01	1.6215E+00	5.0564E+00	1.9859E-01	8.1571E+01	2.5367E+00
3.840	4.1145E+01	1.6231E+00	5.0564E+00	1.9868E-01	8.1572E+01	2.5368E+00
4.100	4.1145E+01	1.6246E+00	5.0564E+00	1.9876E-01	8.1573E+01	2.5369E+00
4.360	4.1145E+01	1.6260E+00	5.0564E+00	1.9885E-01	8.1573E+01	2.5370E+00
4.620	4.1145E+01	1.6274E+00	5.0564E+00	1.9893E-01	8.1573E+01	2.5370E+00
4.880	4.1145E+01	1.6288E+00	5.0564E+00	1.9900E-01	8.1573E+01	2.5371E+00
5.140	4.1145E+01	1.6302E+00	5.0564E+00	1.9908E-01	8.1573E+01	2.5371E+00
5.400	4.1145E+01	1.6315E+00	5.0564E+00	1.9915E-01	8.1573E+01	2.5372E+00
5.660	4.1145E+01	1.6327E+00	5.0564E+00	1.9922E-01	8.1573E+01	2.5372E+00
5.920	4.1145E+01	1.6340E+00	5.0564E+00	1.9929E-01	8.1573E+01	2.5373E+00
6.180	4.1145E+01	1.6352E+00	5.0564E+00	1.9936E-01	8.1573E+01	2.5373E+00
6.440	4.1145E+01	1.6364E+00	5.0564E+00	1.9943E-01	8.1573E+01	2.5374E+00
6.700	4.1145E+01	1.6375E+00	5.0564E+00	1.9949E-01	8.1573E+01	2.5374E+00
6.960	4.1145E+01	1.6386E+00	5.0564E+00	1.9956E-01	8.1573E+01	2.5374E+00
7.220	4.1145E+01	1.6397E+00	5.0564E+00	1.9962E-01	8.1573E+01	2.5375E+00
7.480	4.1145E+01	1.6408E+00	5.0564E+00	1.9968E-01	8.1573E+01	2.5375E+00
7.740	4.1145E+01	1.6418E+00	5.0564E+00	1.9973E-01	8.1573E+01	2.5376E+00
8.000	4.1145E+01	1.6428E+00	5.0564E+00	1.9979E-01	8.1573E+01	2.5376E+00
8.260	4.1145E+01	1.6438E+00	5.0564E+00	1.9983E-01	8.1573E+01	2.5376E+00
8.520	4.1145E+01	1.6448E+00	5.0564E+00	1.9986E-01	8.1573E+01	2.5376E+00
8.780	4.1145E+01	1.6457E+00	5.0564E+00	1.9990E-01	8.1573E+01	2.5376E+00
9.040	4.1145E+01	1.6466E+00	5.0564E+00	1.9993E-01	8.1573E+01	2.5377E+00
9.300	4.1145E+01	1.6475E+00	5.0564E+00	1.9997E-01	8.1573E+01	2.5377E+00
9.560	4.1145E+01	1.6483E+00	5.0564E+00	2.0000E-01	8.1573E+01	2.5377E+00
9.820	4.1145E+01	1.6492E+00	5.0564E+00	2.0003E-01	8.1573E+01	2.5377E+00
10.080	4.1145E+01	1.6500E+00	5.0564E+00	2.0006E-01	8.1573E+01	2.5377E+00
24.000	4.1145E+01	1.6734E+00	5.0564E+00	2.0095E-01	8.1573E+01	2.5380E+00
96.000	4.1145E+01	1.6832E+00	5.0564E+00	2.0110E-01	8.1573E+01	2.5381E+00
720.000	4.1145E+01	1.6837E+00	5.0564E+00	2.0111E-01	8.1573E+01	2.5381E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Worst Two-Hour Dose
(Provided for Dose Location 1)
#####

EAB

Time (hr)	Whole Body (rem)	Thyroid (rem)	Skin (rem)	TEDE (rem)
0.0	3.4658E-01	4.0735E+01	1.0199E+00	1.5953E+00

30 Day Control Room Skin Dose
#####

Control Room

Time (hr)	Skin (rem)
720.0	3.8730E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Attachment 5 RADTRAD-NAI FHA Output – Case 3 – 50% Filtered

```
#####
RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:56:50
#####

#####
File information
#####

Plant file name      = pal/FHA/db/pal_fha_db_ast_50filter.psf
Inventory file name  = pal/FHA/db/palisades_fha_db_ast_adj.nif
Scenario file name   = pal/FHA/db/pal_fha_db_ast_50filter.psf
Release file name    = pal/FHA/db/pal_fha_ast.rft
Dose conversion file = pal/FHA/db/nai-1101-001rev0.dcf
```

```
#####  #####  #####  # # # #####  # # #####
# # # # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # # # #
#####  #####  #####  # # # # # #####  # # # # #
# # # # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # # # #
```

```
*RADTRAD-NAI 1.1a(QA)
*09 May 2005 06:56:45
** Palisades FHA Design Basis
** 50% release filtration
*Nuclide inventory file
pal/FHA/db/palisades_fha_db_ast_adj.nif
*Plant power
2703
*Compartments
4
*Compartment 1:
Fuel Pool-Unfiltered
3
10000
0
0
0
1
*Compartment 2:
Environment
2
2e+20
0
0
0
0
*Compartment 3:
Control Room
1
35923
0
1
0
0
*Compartment 4:
Fuel Pool-Filtered
3
10000
0
0
0
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
1
*Pathways
6
*Pathway 1:
Fuel Pool Release-Unfiltered
1
2
2
*Pathway 2:
Control Room Unfiltered Makeup
2
3
2
*Pathway 3:
Control Room Filtered Makeup
2
3
2
*Pathway 4:
Control Room Unfiltered Inleakage
2
3
2
*Pathway 5:
Control Room Exhaust
3
2
2
*Pathway 6:
Fuel Pool Release-Filtered
4
2
2
*Sources
4
1 0.5
2 0
3 0
4 0.5
*dose conversion factors filename
pal/FHA/db/nai-1101-001rev0.dcf
*release fraction and timing filename
pal/FHA/db/pal_fha_ast.rft
0
1
1
*Iodine
0 0.9985 0.0015
*Overlying pool
*aerosol model
0
*elemental model
1
2
0 252
720 252
*organic model
1
2
0 1
720 1
*pH tracking
0
*Compartment detail
*Compartment 1:
1
*spray model
0
0
0
*filter model
0
*deposition model
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
0
0
*Compartment 2:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Compartment 4:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Pathways:
*Pathway 1
*filter efficiency model
  1
  2
0 1000000 100 0 0
720 1000000 100 0 0
*Pathway 2
*filter efficiency model
  1
  3
0 660 0 0 0
0.3333 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
  1
  3
0 0 0 0 0
0.3333 100 0 0 0
720 100 0 0 0
*Pathway 5
*filter efficiency model
  1
  3
0 660 0 0 0
0.3333 1513.6 0 0 0
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
720 1513.6 0 0 0
*Pathway 6
*filter efficiency model
  1
  2
0 1000000 100 94 94
720 1000000 100 94 94
*x/q tables
  6
EAB
  2
0 0.000539
720 0.000539
LPZ
  6
0 6.66e-05
  2 3.03e-05
  8 2.04e-05
 24 8.67e-06
 96 2.54e-06
720 2.54e-06
Equip Hatch-Normal
  6
0 0.0125
  2 0.00983
  8 0.00362
 24 0.00286
 96 0.00228
720 0.00228
Equip Hatch-Emergency
  6
0 0.000732
  2 0.000613
  8 0.000245
 24 0.000175
 96 0.000129
720 0.000129
Stack-Normal
  6
0 0.0061
  2 0.00432
  8 0.00173
 24 0.00127
 96 0.000979
720 0.000979
Stack-Emergency
  6
0 0.000832
  2 0.000769
  8 0.000283
 24 0.000215
 96 0.000157
720 0.000157
*dose locations
  3
*location name, compartment number and x/q table
EAB
  2
  1
*br model
  1
  4
0 0.00035
  8 0.00018
 24 0.00023
720 0.00023
*of model
  0
*location x/q input to be included
  0
*location name, compartment number and x/q table
LPZ
  2
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```

2
*br model
  1
  4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
  0
*location x/q input to be included
  0
*location name, compartment number and x/q table
Control Room
  3
  0
*br model
  1
  2
0 0.00035
720 0.00035
*of model
  1
  4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
  1
*number of intake combinations
  6
*intake combinations
2 1 3
3 1 4
4 1 3
2 6 5
3 6 6
4 6 5
*time step count
  3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
  1
  1
  1
  0
  1

```

```

#####
RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:56:50
#####

#####
Plant Description
#####

```

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth
Plant Power Level = 2.7030E+03 MWth

Number of compartments = 4

Compartment information

Compartment number 1 (Source term fraction = 5.0000E-01)
Name: Fuel Pool-Unfiltered
Compartment volume = 1.0000E+04 (Cubic feet)
Removal devices within compartment:
Suppression pool

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Pathways into and out of compartment 1
Pathway to compartment number 2: Fuel Pool Release-Unfiltered

Compartment number 2
Name: Environment
Pathways into and out of compartment 2
Pathway to compartment number 3: Control Room Unfiltered Makeup
Pathway to compartment number 3: Control Room Filtered Makeup
Pathway to compartment number 3: Control Room Unfiltered Inleakage
Pathway from compartment number 1: Fuel Pool Release-Unfiltered
Pathway from compartment number 3: Control Room Exhaust
Pathway from compartment number 4: Fuel Pool Release-Filtered

Compartment number 3
Name: Control Room
Compartment volume = 3.5923E+04 (Cubic feet)
Removal devices within compartment:
Filter(s)
Pathways into and out of compartment 3
Pathway to compartment number 2: Control Room Exhaust
Pathway from compartment number 2: Control Room Unfiltered Makeup
Pathway from compartment number 2: Control Room Filtered Makeup
Pathway from compartment number 2: Control Room Unfiltered Inleakage

Compartment number 4 (Source term fraction = 5.0000E-01)
Name: Fuel Pool-Filtered
Compartment volume = 1.0000E+04 (Cubic feet)
Removal devices within compartment:
Suppression pool
Pathways into and out of compartment 4
Pathway to compartment number 2: Fuel Pool Release-Filtered

Total number of pathways = 6

#####
RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:56:50
#####

#####
Scenario Description
#####

Radioactive Decay is enabled
Calculation of Daughters is enabled

Iodine fractions
Aerosol = 0.0000E+00
Elemental = 9.9850E-01
Organic = 1.5000E-03

Overlying pool characteristics
Elemental Removal Data:
Time (hr) DF
0.0000E+00 2.5200E+02
7.2000E+02 2.5200E+02
Organic Removal Data:
Time (hr) DF
0.0000E+00 1.0000E+00
7.2000E+02 1.0000E+00

COMPARTMENT DATA
Compartment number 1: Fuel Pool-Unfiltered
Compartment number 2: Environment
Compartment number 3: Control Room

Compartment Filter Data

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Compartment number 4: Fuel Pool-Filtered

PATHWAY DATA

Pathway number 1: Fuel Pool Release-Unfiltered

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	1.0000E+06	1.0000E+02	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+06	1.0000E+02	0.0000E+00	0.0000E+00

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.0000E+02	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+02	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.5136E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.5136E+03	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 6: Fuel Pool Release-Filtered

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	1.0000E+06	1.0000E+02	9.4000E+01	9.4000E+01
7.2000E+02	1.0000E+06	1.0000E+02	9.4000E+01	9.4000E+01

X/Q DATA

X/Q table 1: EAB

Time (hr)	X/Q (s * m^-3)
0.0000E+00	5.3900E-04

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

7.2000E+02 5.3900E-04

X/Q table 2: LPZ

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

X/Q table 3: Equip Hatch-Normal

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	1.2500E-02
2.0000E+00	9.8300E-03
8.0000E+00	3.6200E-03
2.4000E+01	2.8600E-03
9.6000E+01	2.2800E-03
7.2000E+02	2.2800E-03

X/Q table 4: Equip Hatch-Emergency

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	7.3200E-04
2.0000E+00	6.1300E-04
8.0000E+00	2.4500E-04
2.4000E+01	1.7500E-04
9.6000E+01	1.2900E-04
7.2000E+02	1.2900E-04

X/Q table 5: Stack-Normal

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	6.1000E-03
2.0000E+00	4.3200E-03
8.0000E+00	1.7300E-03
2.4000E+01	1.2700E-03
9.6000E+01	9.7900E-04
7.2000E+02	9.7900E-04

X/Q table 6: Stack-Emergency

Time (hr)	X/Q (s * m ⁻³)
0.0000E+00	8.3200E-04
2.0000E+00	7.6900E-04
8.0000E+00	2.8300E-04
2.4000E+01	2.1500E-04
9.6000E+01	1.5700E-04
7.2000E+02	1.5700E-04

LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location Control Room is in compartment 3

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Inleakage X/Q Table Assignments

Inleakage Path	Source Path	X/Q Table
2	1	3
3	1	4
4	1	3
2	6	5
3	6	6
4	6	5

Location Breathing Rate Data

Time (hr)	Breathing Rate (m ³ * sec ⁻¹)
0.0000E+00	3.5000E-04
7.2000E+02	3.5000E-04

Location Occupancy Factor Data

Time (hr)	Occupancy Factor
0.0000E+00	1.0000E+00
2.4000E+01	6.0000E-01
9.6000E+01	4.0000E-01
7.2000E+02	4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time	Time step
0.0000E+00	1.0000E-06
1.0000E-03	2.0000E-02
7.2000E+02	2.0000E-02

 RADTRAD-NAI Version 1.1a(QA) run on May 9, 2005 at 06:56:50
 #####

```

##### # # ##### ##### # # #####
# # # # # # # # # # # #
# # # # # # ##### # # #
# # # # # # # # # # # #
# # # # # # # # # # # #
##### ##### # # ##### #

```


 Dose, Detailed Model and Detailed Inventory Output
 #####

Detailed model information at time (H) = 0.0010

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0010	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.0010	0.0000E+00	0.0000E+00	0.0000E+00
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

		Deposition Recirculating	
Time (h) =	0.0010	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Fuel Pool Release-Unfiltered Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Environment Transport Group Inventory:

		Present	Release	Integral
Time (h) =	0.0010	Release	Rate/s	Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Makeup Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Filtered Makeup Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Inleakage Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Exhaust Transport Group Inventory:

		Pathway
Time (h) =	0.0010	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) =	0.0010		
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) =	0.0010	
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	0.0010 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) =	0.0010		
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) =	0.0010	

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0010	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.0020

EAB Doses:

Time (h) = 0.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

LPZ Doses:

Time (h) = 0.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Control Room Doses:

Time (h) = 0.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Accumulated dose (rem)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool-Unfiltered Transport Group Inventory:

			Overlying
Time (h) = 0.0020	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Recirculating	
Time (h) = 0.0020	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 0.0020	Release	Rate/s	Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

			Overlying
Time (h) = 0.0020	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Recirculating	
Time (h) = 0.0020	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0020			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Recirculating	
	Surfaces	Filter
Time (h) = 0.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 0.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3333

EAB Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.5944E-02	5.2687E+00	1.6770E-01	2.1747E-01
Accumulated dose (rem)	5.5944E-02	5.2687E+00	1.6770E-01	2.1747E-01

LPZ Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	6.9126E-03	6.5102E-01	2.0722E-02	2.6871E-02
Accumulated dose (rem)	6.9126E-03	6.5102E-01	2.0722E-02	2.6871E-02

Control Room Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.7289E-03	1.9294E+01	4.7488E-01	5.9618E-01
Accumulated dose (rem)	4.7289E-03	1.9294E+01	4.7488E-01	5.9618E-01

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	4.3833E-02	1.1172E-07	7.9155E+17	1.6218E+09
Kr-85m	2.3229E-04	2.8226E-14	1.9998E+11	8.5947E+06
Kr-88	8.2623E-06	6.5892E-16	4.5092E+09	3.0570E+05
Rb-86	9.0903E-03	1.1172E-10	7.8231E+14	3.3634E+08
I-131	1.1685E-02	9.4252E-11	4.3328E+14	4.3234E+08
I-132	7.9814E-03	7.7323E-13	3.5277E+12	2.9531E+08
I-133	3.3976E-03	2.9993E-12	1.3581E+13	1.2571E+08
I-135	9.8340E-05	2.8002E-14	1.2491E+11	3.6386E+06
Xe-133	2.7879E+00	1.4894E-08	6.7439E+16	1.0315E+11
Xe-135	1.9757E-01	7.7366E-11	3.4512E+14	7.3101E+09
Cs-134	1.0170E+00	7.8603E-07	3.5325E+18	3.7629E+10
Cs-136	2.6401E-01	3.6022E-09	1.5951E+16	9.7682E+09
Cs-137	5.5000E-01	6.3232E-06	2.7795E+19	2.0350E+10
I-130	2.8436E-05	1.4580E-14	6.7542E+10	1.0521E+06
Kr-83m	2.3714E-06	1.1494E-16	8.3395E+08	8.7743E+04
Xe-131m	1.8761E-02	2.2399E-10	1.0297E+15	6.9417E+08
Xe-133m	7.6923E-02	1.7143E-10	7.7624E+14	2.8462E+09
Xe-135m	2.0125E-01	2.2093E-12	9.8554E+12	7.4463E+09
Cs-134m	2.3649E-06	2.9325E-16	1.3179E+09	8.7501E+04
Rb-88	2.2038E-05	1.8359E-16	1.2564E+09	8.1541E+05
Ba-137m	1.1277E-01	2.0969E-13	9.2174E+11	4.1726E+09
Br-82	2.3289E-05	2.1512E-14	1.5798E+11	8.6171E+05
Br-83	9.1256E-10	5.7765E-20	4.1912E+05	3.3765E+01

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	8.6115E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.2696E+14	0.0000E+00	1.6307E+20
Organic I (atoms)	1.2378E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	7.1129E-06	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	1.7579E+01	2.1604E-07	1.5128E+18	6.5042E+11
Cs-134	1.9666E+03	1.5200E-03	6.8312E+21	7.2766E+13
Cs-136	5.1053E+02	6.9659E-06	3.0845E+19	1.8890E+13
Cs-137	1.0636E+03	1.2228E-02	5.3750E+22	3.9353E+13
Cs-134m	4.5732E-03	5.6709E-13	2.5486E+12	1.6921E+08
Rb-88	3.0355E-02	2.5288E-13	1.7305E+12	1.1232E+09
Ba-137m	1.0028E+03	1.8647E-09	8.1967E+15	3.7105E+13

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.3755E-02

Environment Integral Nuclide Release:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	1.7375E+02	4.4287E-04	3.1377E+21	6.4289E+12
Kr-85m	9.2079E-01	1.1189E-10	7.9271E+14	3.4069E+10
Kr-87	1.1342E-08	4.0041E-19	2.7716E+06	4.1965E+02
Kr-88	3.2751E-02	2.6119E-12	1.7874E+13	1.2118E+09
I-131	2.4530E+01	1.9786E-07	9.0959E+17	9.0761E+11
I-132	1.5983E+01	1.5484E-09	7.0643E+15	5.9138E+11
I-133	7.1327E+00	6.2965E-09	2.8510E+16	2.6391E+11

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-135	2.0645E-01	5.8786E-11	2.6224E+14	7.6386E+09
Xe-133	1.0704E+04	5.7187E-05	2.5894E+20	3.9606E+14
Xe-135	6.6203E+02	2.5924E-07	1.1564E+18	2.4495E+13
I-130	5.9698E-02	3.0609E-11	1.4179E+14	2.2088E+09
Kr-83m	2.7922E-03	1.3533E-13	9.8191E+11	1.0331E+08
Xe-131m	6.8363E+01	8.1617E-07	3.7520E+18	2.5294E+12
Xe-133m	2.8010E+02	6.2423E-07	2.8265E+18	1.0364E+13
Xe-135m	1.1213E+01	1.2310E-10	5.4911E+14	4.1489E+11
Rb-88	1.0970E-02	9.1385E-14	6.2538E+11	4.0588E+08
Br-82	4.8892E-02	4.5160E-11	3.3166E+14	1.8090E+09
Br-83	1.9158E-06	1.2127E-16	8.7988E+08	7.0884E+04

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 0.3333	Release	Rate/s	Release
Noble gases (atoms)	1.3680E+20	1.9000E+18	3.4043E+21
Elemental I (atoms)	2.7584E+16	3.8311E+14	6.8615E+17
Organic I (atoms)	1.0442E+16	1.4503E+14	2.5975E+17
Aerosols (kg)	3.4404E-16	4.7784E-18	9.1385E-14

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Rb-86	1.7579E+01	2.1604E-07	1.5128E+18	6.5042E+11
Cs-134	1.9666E+03	1.5200E-03	6.8312E+21	7.2766E+13
Cs-136	5.1053E+02	6.9659E-06	3.0845E+19	1.8890E+13
Cs-137	1.0636E+03	1.2228E-02	5.3750E+22	3.9353E+13
Cs-134m	4.5732E-03	5.6709E-13	2.5486E+12	1.6921E+08
Rb-88	3.0355E-02	2.5288E-13	1.7305E+12	1.1232E+09
Ba-137m	1.0028E+03	1.8647E-09	8.1967E+15	3.7105E+13

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.3755E-02

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	1.7579E+01	2.1604E-07	1.5128E+18	6.5042E+11
I-131	2.1240E+01	1.7133E-07	7.8759E+17	7.8588E+11
I-132	1.3818E+01	1.3387E-09	6.1074E+15	5.1127E+11
I-133	6.1761E+00	5.4520E-09	2.4686E+16	2.2852E+11
I-135	1.7876E-01	5.0902E-11	2.2706E+14	6.6141E+09
Cs-134	1.9666E+03	1.5200E-03	6.8312E+21	7.2766E+13
Cs-136	5.1053E+02	6.9659E-06	3.0845E+19	1.8890E+13
Cs-137	1.0636E+03	1.2228E-02	5.3750E+22	3.9353E+13
I-130	5.1691E-02	2.6504E-11	1.2278E+14	1.9126E+09
Cs-134m	4.5732E-03	5.6709E-13	2.5486E+12	1.6921E+08
Rb-88	3.0355E-02	2.5288E-13	1.7305E+12	1.1232E+09
Ba-137m	1.0028E+03	1.8647E-09	8.1967E+15	3.7105E+13
Br-82	4.2335E-02	3.9103E-11	2.8718E+14	1.5664E+09
Br-83	1.6588E-06	1.0500E-16	7.6187E+08	6.1377E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.9411E+17
Organic I (atoms)	2.2491E+17
Aerosols (kg)	1.3755E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Kr-85	4.2272E-01	1.0774E-06	7.6336E+18	1.5641E+10
Kr-85m	2.2402E-03	2.7221E-13	1.9286E+12	8.2886E+07
Kr-88	7.9680E-05	6.3545E-15	4.3486E+10	2.9482E+06
I-131	7.7946E-02	6.2873E-10	2.8903E+15	2.8840E+09
I-132	5.0938E-02	4.9348E-12	2.2514E+13	1.8847E+09
I-133	2.2665E-02	2.0008E-11	9.0593E+13	8.3860E+08
I-135	6.5601E-04	1.8680E-13	8.3328E+11	2.4272E+07
Xe-133	2.6043E+01	1.3913E-07	6.2998E+17	9.6358E+11
Xe-135	1.6109E+00	6.3079E-10	2.8139E+15	5.9602E+10
I-130	1.8969E-04	9.7262E-14	4.5056E+11	7.0187E+06
Kr-83m	6.8048E-06	3.2982E-16	2.3930E+09	2.5178E+05
Xe-131m	1.6633E-01	1.9858E-09	9.1286E+15	6.1542E+09
Xe-133m	6.8149E-01	1.5188E-09	6.8769E+15	2.5215E+10
Xe-135m	2.8436E-02	3.1217E-13	1.3925E+12	1.0521E+09
Rb-88	2.5338E-05	2.1108E-16	1.4445E+09	9.3749E+05
Br-82	1.5536E-04	1.4350E-13	1.0539E+12	5.7483E+06
Br-83	6.0875E-09	3.8534E-19	2.7959E+06	2.2524E+02

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	8.2824E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.1803E+15	0.0000E+00	0.0000E+00
Organic I (atoms)	8.2540E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	2.1108E-16	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Kr-85	4.3833E-02	1.1172E-07	7.9155E+17	1.6218E+09
Kr-85m	2.3229E-04	2.8226E-14	1.9998E+11	8.5947E+06
Kr-88	8.2623E-06	6.5892E-16	4.5092E+09	3.0570E+05
Rb-86	9.0903E-03	1.1172E-10	7.8231E+14	3.3634E+08
I-131	1.1685E-02	9.4252E-11	4.3328E+14	4.3234E+08
I-132	7.9814E-03	7.7323E-13	3.5277E+12	2.9531E+08
I-133	3.3976E-03	2.9993E-12	1.3581E+13	1.2571E+08
I-135	9.8340E-05	2.8002E-14	1.2491E+11	3.6386E+06
Xe-133	2.7879E+00	1.4894E-08	6.7439E+16	1.0315E+11
Xe-135	1.9757E-01	7.7366E-11	3.4512E+14	7.3101E+09
Cs-134	1.0170E+00	7.8603E-07	3.5325E+18	3.7629E+10
Cs-136	2.6401E-01	3.6022E-09	1.5951E+16	9.7682E+09
Cs-137	5.5000E-01	6.3232E-06	2.7795E+19	2.0350E+10
I-130	2.8436E-05	1.4580E-14	6.7542E+10	1.0521E+06
Kr-83m	2.3714E-06	1.1494E-16	8.3395E+08	8.7743E+04
Xe-131m	1.8761E-02	2.2399E-10	1.0297E+15	6.9417E+08
Xe-133m	7.6923E-02	1.7143E-10	7.7624E+14	2.8462E+09
Xe-135m	2.0125E-01	2.2093E-12	9.8554E+12	7.4463E+09
Cs-134m	2.3649E-06	2.9325E-16	1.3179E+09	8.7501E+04
Rb-88	2.2038E-05	1.8359E-16	1.2564E+09	8.1541E+05
Ba-137m	1.1277E-01	2.0969E-13	9.2174E+11	4.1726E+09
Br-82	2.3289E-05	2.1512E-14	1.5798E+11	8.6171E+05
Br-83	9.1256E-10	5.7765E-20	4.1912E+05	3.3765E+01

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 0.3333	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	8.6115E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.2696E+14	0.0000E+00	1.6307E+20
Organic I (atoms)	1.2378E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	7.1129E-06	0.0000E+00	0.0000E+00

Time (h) = 0.3333	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	1.7579E+01	2.1604E-07	1.5128E+18	6.5042E+11
I-131	2.1240E+01	1.7133E-07	7.8759E+17	7.8588E+11
I-132	1.3818E+01	1.3387E-09	6.1074E+15	5.1127E+11
I-133	6.1761E+00	5.4520E-09	2.4686E+16	2.2852E+11
I-135	1.7876E-01	5.0902E-11	2.2706E+14	6.6141E+09
Cs-134	1.9666E+03	1.5200E-03	6.8312E+21	7.2766E+13
Cs-136	5.1053E+02	6.9659E-06	3.0845E+19	1.8890E+13
Cs-137	1.0636E+03	1.2228E-02	5.3750E+22	3.9353E+13
I-130	5.1691E-02	2.6504E-11	1.2278E+14	1.9126E+09
Cs-134m	4.5732E-03	5.6709E-13	2.5486E+12	1.6921E+08
Rb-88	3.0355E-02	2.5288E-13	1.7305E+12	1.1232E+09
Ba-137m	1.0028E+03	1.8647E-09	8.1967E+15	3.7105E+13
Br-82	4.2335E-02	3.9103E-11	2.8718E+14	1.5664E+09
Br-83	1.6588E-06	1.0500E-16	7.6187E+08	6.1377E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.9411E+17
Organic I (atoms)	2.2491E+17
Aerosols (kg)	1.3755E-02

Detailed model information at time (H) = 2.0000

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
2.0000				
Delta dose (rem)	2.8190E-01	2.6462E+01	8.3914E-01	1.0931E+00
Accumulated dose (rem)	3.3785E-01	3.1731E+01	1.0068E+00	1.3106E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
2.0000				
Delta dose (rem)	3.4833E-02	3.2697E+00	1.0369E-01	1.3506E-01
Accumulated dose (rem)	4.1745E-02	3.9207E+00	1.2441E-01	1.6193E-01

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
2.0000				
Delta dose (rem)	2.4405E-02	4.0636E+01	2.5491E+00	1.2698E+00
Accumulated dose (rem)	2.9134E-02	5.9930E+01	3.0240E+00	1.8660E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Kr-85	4.3833E-02	1.1172E-07	7.9154E+17	1.6218E+09
Kr-85m	1.7949E-04	2.1810E-14	1.5452E+11	6.6411E+06
Kr-88	5.5009E-06	4.3870E-16	3.0022E+09	2.0353E+05
Rb-86	9.0669E-03	1.1143E-10	7.8030E+14	3.3547E+08
I-131	1.1618E-02	9.3709E-11	4.3079E+14	4.2985E+08
I-132	7.8571E-03	7.6119E-13	3.4727E+12	2.9071E+08
I-133	3.2140E-03	2.8372E-12	1.2847E+13	1.1892E+08
I-135	8.2571E-05	2.3512E-14	1.0488E+11	3.0551E+06
Xe-133	3.4322E+00	1.8336E-08	8.3024E+16	1.2699E+11
Xe-135	3.8183E-01	1.4952E-10	6.6698E+14	1.4128E+10
Cs-134	1.0169E+00	7.8598E-07	3.5323E+18	3.7626E+10
Cs-136	2.6304E-01	3.5890E-09	1.5892E+16	9.7324E+09
Cs-137	5.5000E-01	6.3231E-06	2.7795E+19	2.0350E+10
I-130	2.5899E-05	1.3279E-14	6.1515E+10	9.5826E+05
Kr-83m	9.7674E-06	4.7341E-16	3.4349E+09	3.6139E+05
Xe-131m	3.0933E-02	3.6930E-10	1.6977E+15	1.1445E+09
Xe-133m	1.2323E-01	2.7463E-10	1.2435E+15	4.5595E+09
Xe-135m	1.5138E+00	1.6618E-11	7.4132E+13	5.6011E+10
Cs-134m	1.5878E-06	1.9689E-16	8.8487E+08	5.8750E+04
Rb-88	1.4723E-05	1.2266E-16	8.3937E+08	5.4476E+05
Ba-137m	1.6958E-01	3.1532E-13	1.3861E+12	6.2745E+09
Br-82	2.2540E-05	2.0819E-14	1.5290E+11	8.3397E+05

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Br-83 5.6277E-10 3.5624E-20 2.5847E+05 2.0823E+01

Fuel Pool-Unfiltered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0000			
Noble gases (atoms)	8.7825E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.2456E+14	0.0000E+00	9.7465E+20
Organic I (atoms)	1.2287E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	7.1128E-06	0.0000E+00	0.0000E+00

	Surfaces	Recirculating Filter
Time (h) = 2.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	1.0820E+02	1.3298E-06	9.3121E+18	4.0036E+12
Cs-134	1.2136E+04	9.3799E-03	4.2154E+22	4.4903E+14
Cs-136	3.1391E+03	4.2831E-05	1.8966E+20	1.1615E+14
Cs-137	6.5637E+03	7.5460E-02	3.3170E+23	2.4286E+14
Cs-134m	1.8949E-02	2.3497E-12	1.0560E+13	7.0112E+08
Rb-88	4.1148E-02	3.4279E-13	2.3458E+12	1.5225E+09
Ba-137m	7.1125E+03	1.3225E-08	5.8134E+16	2.6316E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 2.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.4884E-02

Environment Integral Nuclide Release:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	1.0506E+03	2.6779E-03	1.8973E+22	3.8874E+13
Kr-85m	4.3022E+00	5.2278E-10	3.7038E+15	1.5918E+11
Kr-88	1.3185E-01	1.0515E-11	7.1960E+13	4.8786E+09
I-131	1.4746E+02	1.1894E-06	5.4679E+18	5.4561E+12
I-132	7.5715E+01	7.3352E-09	3.3465E+16	2.8014E+12
I-133	4.0801E+01	3.6017E-08	1.6308E+17	1.5096E+12
I-135	1.0482E+00	2.9847E-10	1.3314E+15	3.8783E+10
Xe-133	6.4279E+04	3.4341E-04	1.5549E+21	2.3783E+15
Xe-135	3.5728E+03	1.3990E-06	6.2409E+18	1.3219E+14
I-130	3.2877E-01	1.6857E-10	7.8090E+14	1.2165E+10
Kr-83m	1.0427E-02	5.0538E-13	3.6668E+12	3.8580E+08
Xe-131m	4.1399E+02	4.9425E-06	2.2721E+19	1.5318E+13
Xe-133m	1.6660E+03	3.7128E-06	1.6811E+19	6.1641E+13
Xe-135m	5.6580E+01	6.2112E-10	2.7707E+15	2.0934E+12
Rb-88	1.1594E-01	9.6588E-13	6.6099E+12	4.2899E+09
Br-82	2.8613E-01	2.6429E-10	1.9410E+15	1.0587E+10
Br-83	7.1442E-06	4.5223E-16	3.2812E+09	2.6433E+05

Environment Transport Group Inventory:

Time (h) = 2.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.0604E+20	2.8617E+18	2.0573E+22
Elemental I (atoms)	4.1252E+16	5.7295E+14	4.1119E+18
Organic I (atoms)	1.5617E+16	2.1690E+14	1.5566E+18
Aerosols (kg)	5.1878E-16	7.2053E-18	9.6588E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	1.0820E+02	1.3298E-06	9.3121E+18	4.0036E+12
Cs-134	1.2136E+04	9.3799E-03	4.2154E+22	4.4903E+14

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Cs-136	3.1391E+03	4.2831E-05	1.8966E+20	1.1615E+14
Cs-137	6.5637E+03	7.5460E-02	3.3170E+23	2.4286E+14
Cs-134m	1.8949E-02	2.3497E-12	1.0560E+13	7.0112E+08
Rb-88	4.1148E-02	3.4279E-13	2.3458E+12	1.5225E+09
Ba-137m	7.1125E+03	1.3225E-08	5.8134E+16	2.6316E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.4884E-02

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
I-131	5.9993E-02	4.8391E-10	2.2246E+15	2.2197E+09
I-132	3.2103E-02	3.1101E-12	1.4189E+13	1.1878E+09
I-133	1.6599E-02	1.4653E-11	6.6347E+13	6.1416E+08
I-135	4.2643E-04	1.2143E-13	5.4167E+11	1.5778E+07
I-130	1.3375E-04	6.8580E-14	3.1769E+11	4.9489E+06
Br-82	1.1641E-04	1.0752E-13	7.8963E+11	4.3070E+06
Br-83	2.9064E-09	1.8398E-19	1.3349E+06	1.0754E+02

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.6733E+15
Organic I (atoms)	6.3345E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	1.0820E+02	1.3298E-06	9.3121E+18	4.0036E+12
I-131	1.3031E+02	1.0511E-06	4.8319E+18	4.8214E+12
I-132	6.6794E+01	6.4709E-09	2.9522E+16	2.4714E+12
I-133	3.6055E+01	3.1828E-08	1.4411E+17	1.3340E+12
I-135	9.2627E-01	2.6376E-10	1.1766E+15	3.4272E+10
Cs-134	1.2136E+04	9.3799E-03	4.2154E+22	4.4903E+14
Cs-136	3.1391E+03	4.2831E-05	1.8966E+20	1.1615E+14
Cs-137	6.5637E+03	7.5460E-02	3.3170E+23	2.4286E+14

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-130	2.9053E-01	1.4897E-10	6.9007E+14	1.0750E+10
Cs-134m	1.8949E-02	2.3497E-12	1.0560E+13	7.0112E+08
Rb-88	4.1148E-02	3.4279E-13	2.3458E+12	1.5225E+09
Ba-137m	7.1125E+03	1.3225E-08	5.8134E+16	2.6316E+14
Br-82	2.5285E-01	2.3355E-10	1.7152E+15	9.3554E+09
Br-83	6.3132E-06	3.9963E-16	2.8995E+09	2.3359E+05

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.6336E+18
Organic I (atoms)	1.3756E+18
Aerosols (kg)	8.4884E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	2.0316E-01	5.1783E-07	3.6688E+18	7.5170E+09
Kr-85m	8.3193E-04	1.0109E-13	7.1621E+11	3.0781E+07
Kr-88	2.5497E-05	2.0334E-15	1.3915E+10	9.4338E+05
I-131	8.7943E-03	7.0936E-11	3.2610E+14	3.2539E+08
I-132	5.6209E-03	5.4455E-13	2.4844E+12	2.0797E+08
I-133	2.4330E-03	2.1478E-12	9.7250E+12	9.0022E+07
I-135	6.2506E-05	1.7799E-14	7.9397E+10	2.3127E+06
Xe-133	1.2446E+01	6.6493E-08	3.0108E+17	4.6051E+11
Xe-135	6.9644E-01	2.7272E-10	1.2165E+15	2.5768E+10
I-130	1.9606E-05	1.0052E-14	4.6567E+10	7.2541E+05
Kr-83m	2.2162E-06	1.0741E-16	7.7935E+08	8.1998E+04
Xe-131m	8.0354E-02	9.5932E-10	4.4101E+15	2.9731E+09
Xe-133m	3.2333E-01	7.2059E-10	3.2628E+15	1.1963E+10
Xe-135m	2.9635E-02	3.2533E-13	1.4512E+12	1.0965E+09
Rb-88	9.2730E-06	7.7250E-17	5.2865E+08	3.4310E+05
Br-82	1.7063E-05	1.5760E-14	1.1574E+11	6.3131E+05
Br-83	4.2602E-10	2.6967E-20	1.9566E+05	1.5763E+01

Control Room Transport Group Inventory:

Time (h) = 2.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	3.9787E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.4558E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	9.2969E+13	0.0000E+00	0.0000E+00
Aerosols (kg)	7.7250E-17	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 2.0000	Ci	kg	Atoms	Bq
I-131	6.7201E-02	5.4205E-10	2.4918E+15	2.4864E+09
I-132	3.0459E-02	2.9508E-12	1.3462E+13	1.1270E+09
I-133	1.8595E-02	1.6415E-11	7.4324E+13	6.8800E+08
I-135	4.7771E-04	1.3603E-13	6.0679E+11	1.7675E+07
I-130	1.4984E-04	7.6826E-14	3.5589E+11	5.5440E+06
Rb-88	1.0288E-05	8.5705E-17	5.8651E+08	3.8065E+05
Br-82	1.3040E-04	1.2045E-13	8.8458E+11	4.8249E+06
Br-83	3.2559E-09	2.0610E-19	1.4954E+06	1.2047E+02

Deposition Recirculating

Time (h) = 2.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.8726E+15
Organic I (atoms)	0.0000E+00	7.0890E+14
Aerosols (kg)	0.0000E+00	8.5705E-17

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	2.0000	Ci	kg	Atoms	Bq
I-131		5.9993E-02	4.8391E-10	2.2246E+15	2.2197E+09
I-132		3.2103E-02	3.1101E-12	1.4189E+13	1.1878E+09
I-133		1.6599E-02	1.4653E-11	6.6347E+13	6.1416E+08
I-135		4.2643E-04	1.2143E-13	5.4167E+11	1.5778E+07
I-130		1.3375E-04	6.8580E-14	3.1769E+11	4.9489E+06
Br-82		1.1641E-04	1.0752E-13	7.8963E+11	4.3070E+06
Br-83		2.9064E-09	1.8398E-19	1.3349E+06	1.0754E+02

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		1.6733E+15
Organic I (atoms)		6.3345E+14
Aerosols (kg)		0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) =	2.0000	Pathway
		Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
I-131		1.2719E-01	1.0260E-09	4.7164E+15	4.7062E+09
I-132		6.2561E-02	6.0609E-12	2.7651E+13	2.3148E+09
I-133		3.5194E-02	3.1067E-11	1.4067E+14	1.3022E+09
I-135		9.0414E-04	2.5745E-13	1.1485E+12	3.3453E+07
I-130		2.8359E-04	1.4541E-13	6.7358E+11	1.0493E+07
Rb-88		1.0288E-05	8.5705E-17	5.8651E+08	3.8065E+05
Br-82		2.4681E-04	2.2797E-13	1.6742E+12	9.1318E+06
Br-83		6.1623E-09	3.9008E-19	2.8302E+06	2.2801E+02

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Kr-85		4.3833E-02	1.1172E-07	7.9154E+17	1.6218E+09
Kr-85m		1.7949E-04	2.1810E-14	1.5452E+11	6.6411E+06
Kr-88		5.5009E-06	4.3870E-16	3.0022E+09	2.0353E+05
Rb-86		9.0669E-03	1.1143E-10	7.8030E+14	3.3547E+08
I-131		1.1618E-02	9.3709E-11	4.3079E+14	4.2985E+08
I-132		7.8571E-03	7.6119E-13	3.4727E+12	2.9071E+08
I-133		3.2140E-03	2.8372E-12	1.2847E+13	1.1892E+08
I-135		8.2571E-05	2.3512E-14	1.0488E+11	3.0551E+06
Xe-133		3.4322E+00	1.8336E-08	8.3024E+16	1.2699E+11
Xe-135		3.8183E-01	1.4952E-10	6.6698E+14	1.4128E+10
Cs-134		1.0169E+00	7.8598E-07	3.5323E+18	3.7626E+10
Cs-136		2.6304E-01	3.5890E-09	1.5892E+16	9.7324E+09
Cs-137		5.5000E-01	6.3231E-06	2.7795E+19	2.0350E+10
I-130		2.5899E-05	1.3279E-14	6.1515E+10	9.5826E+05
Kr-83m		9.7674E-06	4.7341E-16	3.4349E+09	3.6139E+05
Xe-131m		3.0933E-02	3.6930E-10	1.6977E+15	1.1445E+09
Xe-133m		1.2323E-01	2.7463E-10	1.2435E+15	4.5595E+09
Xe-135m		1.5138E+00	1.6618E-11	7.4132E+13	5.6011E+10
Cs-134m		1.5878E-06	1.9689E-16	8.8487E+08	5.8750E+04

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Rb-88	1.4723E-05	1.2266E-16	8.3937E+08	5.4476E+05
Ba-137m	1.6958E-01	3.1532E-13	1.3861E+12	6.2745E+09
Br-82	2.2540E-05	2.0819E-14	1.5290E+11	8.3397E+05
Br-83	5.6277E-10	3.5624E-20	2.5847E+05	2.0823E+01

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 2.0000	Atmosphere		Sump	Overlying Pool
	Noble gases (atoms)	8.7825E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.2456E+14	0.0000E+00	9.7465E+20	
Organic I (atoms)	1.2287E+14	0.0000E+00	0.0000E+00	
Aerosols (kg)	7.1128E-06	0.0000E+00	0.0000E+00	

Time (h) = 2.0000	Deposition Surfaces		Recirculating Filter
	Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	1.0820E+02	1.3298E-06	9.3121E+18	4.0036E+12
I-131	1.3031E+02	1.0511E-06	4.8319E+18	4.8214E+12
I-132	6.6794E+01	6.4709E-09	2.9522E+16	2.4714E+12
I-133	3.6055E+01	3.1828E-08	1.4411E+17	1.3340E+12
I-135	9.2627E-01	2.6376E-10	1.1766E+15	3.4272E+10
Cs-134	1.2136E+04	9.3799E-03	4.2154E+22	4.4903E+14
Cs-136	3.1391E+03	4.2831E-05	1.8966E+20	1.1615E+14
Cs-137	6.5637E+03	7.5460E-02	3.3170E+23	2.4286E+14
I-130	2.9053E-01	1.4897E-10	6.9007E+14	1.0750E+10
Cs-134m	1.8949E-02	2.3497E-12	1.0560E+13	7.0112E+08
Rb-88	4.1148E-02	3.4279E-13	2.3458E+12	1.5225E+09
Ba-137m	7.1125E+03	1.3225E-08	5.8134E+16	2.6316E+14
Br-82	2.5285E-01	2.3355E-10	1.7152E+15	9.3554E+09
Br-83	6.3132E-06	3.9963E-16	2.8995E+09	2.3359E+05

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 2.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.6336E+18
Organic I (atoms)	1.3756E+18
Aerosols (kg)	8.4884E-02

Detailed model information at time (H) = 2.0020

EAB Doses:

Time (h) = 2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.6224E-04	3.1621E-02	1.2015E-03	1.4315E-03
Accumulated dose (rem)	3.3831E-01	3.1762E+01	1.0080E+00	1.3120E+00

LPZ Doses:

Time (h) = 2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.5985E-05	1.7776E-03	6.7545E-05	8.0472E-05
Accumulated dose (rem)	4.1771E-02	3.9225E+00	1.2447E-01	1.6202E-01

Control Room Doses:

Time (h) = 2.0020	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.2975E-05	2.4694E-02	2.4153E-03	7.7973E-04
Accumulated dose (rem)	2.9157E-02	5.9955E+01	3.0264E+00	1.8667E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Kr-85	4.3833E-02	1.1172E-07	7.9154E+17	1.6218E+09
Kr-85m	1.7943E-04	2.1804E-14	1.5448E+11	6.6390E+06

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Kr-88	5.4982E-06	4.3848E-16	3.0007E+09	2.0344E+05
Rb-86	9.0669E-03	1.1143E-10	7.8029E+14	3.3547E+08
I-131	1.1618E-02	9.3709E-11	4.3078E+14	4.2985E+08
I-132	7.8985E-03	7.6520E-13	3.4910E+12	2.9225E+08
I-133	3.2138E-03	2.8370E-12	1.2846E+13	1.1891E+08
I-135	8.2553E-05	2.3507E-14	1.0486E+11	3.0545E+06
Xe-133	2.7569E+00	1.4728E-08	6.6688E+16	1.0200E+11
Xe-135	1.7233E-01	6.7481E-11	3.0102E+14	6.3761E+09
Cs-134	1.0169E+00	7.8598E-07	3.5323E+18	3.7626E+10
Cs-136	2.6304E-01	3.5889E-09	1.5892E+16	9.7323E+09
Cs-137	5.5000E-01	6.3231E-06	2.7795E+19	2.0350E+10
I-130	2.5896E-05	1.3278E-14	6.1508E+10	9.5815E+05
Kr-83m	1.3667E-06	6.6243E-17	4.8063E+08	5.0569E+04
Xe-131m	1.8640E-02	2.2254E-10	1.0230E+15	6.8969E+08
Xe-133m	7.4883E-02	1.6689E-10	7.5565E+14	2.7707E+09
Xe-135m	1.5360E-01	1.6863E-12	7.5221E+12	5.6834E+09
Cs-134m	1.5871E-06	1.9680E-16	8.8445E+08	5.8721E+04
Rb-88	1.5039E-05	1.2529E-16	8.5739E+08	5.5646E+05
Ba-137m	1.6959E-02	3.1534E-14	1.3862E+11	6.2749E+08
Br-82	2.2539E-05	2.0818E-14	1.5289E+11	8.3393E+05
Br-83	5.6245E-10	3.5603E-20	2.5832E+05	2.0811E+01

Fuel Pool-Unfiltered Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0020			
Noble gases (atoms)	8.6032E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.2457E+14	0.0000E+00	9.7561E+20
Organic I (atoms)	1.2287E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	7.1128E-06	0.0000E+00	0.0000E+00

	Surfaces	Recirculating Filter
Time (h) = 2.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

	Ci	kg	Atoms	Bq
Time (h) = 2.0020				
Rb-86	1.0831E+02	1.3312E-06	9.3214E+18	4.0076E+12
Cs-134	1.2148E+04	9.3893E-03	4.2197E+22	4.4948E+14
Cs-136	3.1422E+03	4.2873E-05	1.8985E+20	1.1626E+14
Cs-137	6.5703E+03	7.5536E-02	3.3204E+23	2.4310E+14
Cs-134m	1.8959E-02	2.3510E-12	1.0566E+13	7.0149E+08
Rb-88	4.1134E-02	3.4267E-13	2.3450E+12	1.5220E+09
Ba-137m	7.0880E+03	1.3180E-08	5.7934E+16	2.6226E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.4970E-02

Environment Integral Nuclide Release:

	Ci	kg	Atoms	Bq
Time (h) = 2.0020				
Kr-85	1.0517E+03	2.6806E-03	1.8992E+22	3.8913E+13
Kr-85m	4.3052E+00	5.2314E-10	3.7064E+15	1.5929E+11
Kr-88	1.3192E-01	1.0521E-11	7.1997E+13	4.8811E+09
I-131	1.4761E+02	1.1906E-06	5.4734E+18	5.4615E+12
I-132	7.5769E+01	7.3405E-09	3.3489E+16	2.8035E+12
I-133	4.0839E+01	3.6051E-08	1.6324E+17	1.5110E+12
I-135	1.0490E+00	2.9871E-10	1.3325E+15	3.8814E+10
Xe-133	6.4344E+04	3.4375E-04	1.5565E+21	2.3807E+15
Xe-135	3.5763E+03	1.4004E-06	6.2470E+18	1.3232E+14
I-130	3.2907E-01	1.6872E-10	7.8160E+14	1.2175E+10
Kr-83m	1.0448E-02	5.0641E-13	3.6743E+12	3.8658E+08
Xe-131m	4.1443E+02	4.9478E-06	2.2745E+19	1.5334E+13

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Xe-133m	1.6677E+03	3.7167E-06	1.6829E+19	6.1705E+13
Xe-135m	5.9338E+01	6.5140E-10	2.9058E+15	2.1955E+12
Rb-88	1.1602E-01	9.6652E-13	6.6142E+12	4.2927E+09
Br-82	2.8640E-01	2.6454E-10	1.9428E+15	1.0597E+10
Br-83	7.1472E-06	4.5242E-16	3.2825E+09	2.6444E+05

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 2.0020	Release	Rate/s	Release
Noble gases (atoms)	2.0643E+19	2.8671E+17	2.0594E+22
Elemental I (atoms)	4.1262E+15	5.7308E+13	4.1160E+18
Organic I (atoms)	1.5620E+15	2.1695E+13	1.5582E+18
Aerosols (kg)	5.5260E-18	7.6750E-20	9.6652E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Rb-86	1.0831E+02	1.3312E-06	9.3214E+18	4.0076E+12
Cs-134	1.2148E+04	9.3893E-03	4.2197E+22	4.4948E+14
Cs-136	3.1422E+03	4.2873E-05	1.8985E+20	1.1626E+14
Cs-137	6.5703E+03	7.5536E-02	3.3204E+23	2.4310E+14
Cs-134m	1.8959E-02	2.3510E-12	1.0566E+13	7.0149E+08
Rb-88	4.1134E-02	3.4267E-13	2.3450E+12	1.5220E+09
Ba-137m	7.0880E+03	1.3180E-08	5.7934E+16	2.6226E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 2.0020	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.4970E-02

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 2.0020	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	6.0053E-02	4.8440E-10	2.2268E+15	2.2220E+09
I-132	3.2124E-02	3.1122E-12	1.4198E+13	1.1886E+09
I-133	1.6615E-02	1.4667E-11	6.6410E+13	6.1474E+08
I-135	4.2678E-04	1.2152E-13	5.4210E+11	1.5791E+07
I-130	1.3387E-04	6.8642E-14	3.1798E+11	4.9534E+06
Br-82	1.1652E-04	1.0762E-13	7.9040E+11	4.3112E+06
Br-83	2.9077E-09	1.8406E-19	1.3354E+06	1.0758E+02

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 2.0020	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.6750E+15
Organic I (atoms)	6.3409E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 2.0020	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Rb-86	1.0831E+02	1.3312E-06	9.3214E+18	4.0076E+12
I-131	1.3044E+02	1.0521E-06	4.8368E+18	4.8263E+12
I-132	6.6843E+01	6.4756E-09	2.9543E+16	2.4732E+12
I-133	3.6089E+01	3.1858E-08	1.4425E+17	1.3353E+12
I-135	9.2701E-01	2.6397E-10	1.1775E+15	3.4299E+10
Cs-134	1.2148E+04	9.3893E-03	4.2197E+22	4.4948E+14
Cs-136	3.1422E+03	4.2873E-05	1.8985E+20	1.1626E+14
Cs-137	6.5703E+03	7.5536E-02	3.3204E+23	2.4310E+14
I-130	2.9079E-01	1.4910E-10	6.9069E+14	1.0759E+10
Cs-134m	1.8959E-02	2.3510E-12	1.0566E+13	7.0149E+08
Rb-88	4.1134E-02	3.4267E-13	2.3450E+12	1.5220E+09
Ba-137m	7.0880E+03	1.3180E-08	5.7934E+16	2.6226E+14
Br-82	2.5309E-01	2.3377E-10	1.7169E+15	9.3644E+09
Br-83	6.3159E-06	3.9979E-16	2.9007E+09	2.3369E+05

Fuel Pool Release-Filtered Transport Group Inventory:

	Pathway
Time (h) = 2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.6372E+18
Organic I (atoms)	1.3769E+18
Aerosols (kg)	8.4970E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0020	Ci	kg	Atoms	Bq
Kr-85	2.0297E-01	5.1735E-07	3.6653E+18	7.5100E+09
Kr-85m	8.3089E-04	1.0096E-13	7.1532E+11	3.0743E+07
Kr-88	2.5460E-05	2.0305E-15	1.3895E+10	9.4203E+05
I-131	8.7758E-03	7.0787E-11	3.2541E+14	3.2470E+08
I-132	5.6084E-03	5.4334E-13	2.4788E+12	2.0751E+08
I-133	2.4278E-03	2.1431E-12	9.7039E+12	8.9827E+07
I-135	6.2362E-05	1.7757E-14	7.9213E+10	2.3074E+06
Xe-133	1.2436E+01	6.6436E-08	3.0082E+17	4.6012E+11
Xe-135	6.9603E-01	2.7256E-10	1.2158E+15	2.5753E+10
I-130	1.9562E-05	1.0030E-14	4.6464E+10	7.2380E+05
Kr-83m	2.2264E-06	1.0791E-16	7.8294E+08	8.2376E+04
Xe-131m	8.0299E-02	9.5866E-10	4.4070E+15	2.9710E+09
Xe-133m	3.2310E-01	7.2008E-10	3.2605E+15	1.1955E+10
Xe-135m	3.1753E-02	3.4858E-13	1.5549E+12	1.1748E+09
Rb-88	9.2594E-06	7.7137E-17	5.2788E+08	3.4260E+05
Br-82	1.7026E-05	1.5726E-14	1.1550E+11	6.2996E+05
Br-83	4.2488E-10	2.6895E-20	1.9514E+05	1.5721E+01

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0020			
Noble gases (atoms)	3.9750E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.4506E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	9.2772E+13	0.0000E+00	0.0000E+00
Aerosols (kg)	7.7137E-17	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	6.7241E-02	5.4238E-10	2.4934E+15	2.4879E+09
I-132	3.0466E-02	2.9516E-12	1.3466E+13	1.1273E+09
I-133	1.8605E-02	1.6424E-11	7.4365E+13	6.8838E+08
I-135	4.7790E-04	1.3608E-13	6.0704E+11	1.7682E+07

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-130	1.4991E-04	7.6864E-14	3.5607E+11	5.5467E+06
Rb-88	1.0283E-05	8.5663E-17	5.8622E+08	3.8047E+05
Br-82	1.3048E-04	1.2052E-13	8.8508E+11	4.8276E+06
Br-83	3.2560E-09	2.0610E-19	1.4954E+06	1.2047E+02

Deposition Recirculating

	Surfaces	Filter
Time (h) = 2.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.8737E+15
Organic I (atoms)	0.0000E+00	7.0932E+14
Aerosols (kg)	0.0000E+00	8.5663E-17

Control Room Unfiltered Makeup Transport Group Inventory:

Pathway

	Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	6.0053E-02	4.8440E-10	2.2268E+15	2.2220E+09
I-132	3.2124E-02	3.1122E-12	1.4198E+13	1.1886E+09
I-133	1.6615E-02	1.4667E-11	6.6410E+13	6.1474E+08
I-135	4.2678E-04	1.2152E-13	5.4210E+11	1.5791E+07
I-130	1.3387E-04	6.8642E-14	3.1798E+11	4.9534E+06
Br-82	1.1652E-04	1.0762E-13	7.9040E+11	4.3112E+06
Br-83	2.9077E-09	1.8406E-19	1.3354E+06	1.0758E+02

Control Room Filtered Makeup Transport Group Inventory:

Pathway

	Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.6750E+15
Organic I (atoms)	6.3409E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Pathway

	Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Pathway

	Filter
Time (h) = 2.0020	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 2.0020	Ci	kg	Atoms	Bq
I-131	1.2729E-01	1.0268E-09	4.7201E+15	4.7099E+09
I-132	6.2591E-02	6.0637E-12	2.7664E+13	2.3159E+09
I-133	3.5219E-02	3.1090E-11	1.4077E+14	1.3031E+09
I-135	9.0467E-04	2.5761E-13	1.1491E+12	3.3473E+07
I-130	2.8379E-04	1.4551E-13	6.7405E+11	1.0500E+07
Rb-88	1.0283E-05	8.5663E-17	5.8622E+08	3.8047E+05
Br-82	2.4699E-04	2.2814E-13	1.6755E+12	9.1388E+06
Br-83	6.1637E-09	3.9016E-19	2.8309E+06	2.2806E+02

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) =	Ci	kg	Atoms	Bq
2.0020				
Kr-85	4.3833E-02	1.1172E-07	7.9154E+17	1.6218E+09
Kr-85m	1.7943E-04	2.1804E-14	1.5448E+11	6.6390E+06
Kr-88	5.4982E-06	4.3848E-16	3.0007E+09	2.0344E+05
Rb-86	9.0669E-03	1.1143E-10	7.8029E+14	3.3547E+08
I-131	1.1618E-02	9.3709E-11	4.3078E+14	4.2985E+08
I-132	7.8985E-03	7.6520E-13	3.4910E+12	2.9225E+08
I-133	3.2138E-03	2.8370E-12	1.2846E+13	1.1891E+08
I-135	8.2553E-05	2.3507E-14	1.0486E+11	3.0545E+06
Xe-133	2.7569E+00	1.4728E-08	6.6688E+16	1.0200E+11
Xe-135	1.7233E-01	6.7481E-11	3.0102E+14	6.3761E+09
Cs-134	1.0169E+00	7.8598E-07	3.5323E+18	3.7626E+10
Cs-136	2.6304E-01	3.5889E-09	1.5892E+16	9.7323E+09
Cs-137	5.5000E-01	6.3231E-06	2.7795E+19	2.0350E+10
I-130	2.5896E-05	1.3278E-14	6.1508E+10	9.5815E+05
Kr-83m	1.3667E-06	6.6243E-17	4.8063E+08	5.0569E+04
Xe-131m	1.8640E-02	2.2254E-10	1.0230E+15	6.8969E+08
Xe-133m	7.4883E-02	1.6689E-10	7.5565E+14	2.7707E+09
Xe-135m	1.5360E-01	1.6863E-12	7.5221E+12	5.6834E+09
Cs-134m	1.5871E-06	1.9680E-16	8.8445E+08	5.8721E+04
Rb-88	1.5039E-05	1.2529E-16	8.5739E+08	5.5646E+05
Ba-137m	1.6959E-02	3.1534E-14	1.3862E+11	6.2749E+08
Br-82	2.2539E-05	2.0818E-14	1.5289E+11	8.3393E+05
Br-83	5.6245E-10	3.5603E-20	2.5832E+05	2.0811E+01

Fuel Pool-Filtered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
2.0020			
Noble gases (atoms)	8.6032E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.2457E+14	0.0000E+00	9.7561E+20
Organic I (atoms)	1.2287E+14	0.0000E+00	0.0000E+00
Aerosols (kg)	7.1128E-06	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Filter
2.0020		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
2.0020				
Rb-86	1.0831E+02	1.3312E-06	9.3214E+18	4.0076E+12
I-131	1.3044E+02	1.0521E-06	4.8368E+18	4.8263E+12
I-132	6.6843E+01	6.4756E-09	2.9543E+16	2.4732E+12
I-133	3.6089E+01	3.1858E-08	1.4425E+17	1.3353E+12
I-135	9.2701E-01	2.6397E-10	1.1775E+15	3.4299E+10
Cs-134	1.2148E+04	9.3893E-03	4.2197E+22	4.4948E+14
Cs-136	3.1422E+03	4.2873E-05	1.8985E+20	1.1626E+14
Cs-137	6.5703E+03	7.5536E-02	3.3204E+23	2.4310E+14
I-130	2.9079E-01	1.4910E-10	6.9069E+14	1.0759E+10
Cs-134m	1.8959E-02	2.3510E-12	1.0566E+13	7.0149E+08
Rb-88	4.1134E-02	3.4267E-13	2.3450E+12	1.5220E+09
Ba-137m	7.0880E+03	1.3180E-08	5.7934E+16	2.6226E+14
Br-82	2.5309E-01	2.3377E-10	1.7169E+15	9.3644E+09
Br-83	6.3159E-06	3.9979E-16	2.9007E+09	2.3369E+05

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
2.0020	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.6372E+18
Organic I (atoms)	1.3769E+18
Aerosols (kg)	8.4970E-02

Detailed model information at time (H) = 8.0000

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
8.0000				

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Delta dose (rem)	3.4385E-02	2.8818E-01	6.0409E-02	4.3218E-02
Accumulated dose (rem)	3.7270E-01	3.2050E+01	1.0685E+00	1.3552E+00

LPZ Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.9330E-03	1.6200E-02	3.3959E-03	2.4295E-03
Accumulated dose (rem)		4.3704E-02	3.9387E+00	1.2787E-01	1.6444E-01

Control Room Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		5.5538E-03	2.7095E+00	5.4605E-01	8.8572E-02
Accumulated dose (rem)		3.4711E-02	6.2665E+01	3.5725E+00	1.9553E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Xe-133		6.2058E-01	3.3154E-09	1.5012E+16	2.2961E+10
Xe-135		1.2532E-01	4.9072E-11	2.1890E+14	4.6367E+09
Kr-83m		1.6542E-06	8.0177E-17	5.8173E+08	6.1206E+04
Xe-131m		1.3504E-02	1.6122E-10	7.4113E+14	4.9964E+08
Xe-133m		4.4430E-02	9.9018E-11	4.4834E+14	1.6439E+09
Xe-135m		8.1371E-01	8.9328E-12	3.9848E+13	3.0107E+10

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		1.6460E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	9.5399E+20
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	8.0000	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		1.0882E+02	1.3374E-06	9.3651E+18	4.0264E+12
Cs-134		1.2316E+04	9.5192E-03	4.2780E+22	4.5570E+14
Cs-136		3.1446E+03	4.2905E-05	1.8999E+20	1.1635E+14
Cs-137		6.6626E+03	7.6597E-02	3.3670E+23	2.4651E+14
Cs-134m		4.5843E-03	5.6846E-13	2.5547E+12	1.6962E+08
Rb-88		3.5814E-08	2.9836E-19	2.0418E+06	1.3251E+03
Ba-137m		7.3856E+03	1.3733E-08	6.0366E+16	2.7327E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) =	8.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		8.6161E-02

Environment Integral Nuclide Release:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Kr-85		1.0614E+03	2.7054E-03	1.9167E+22	3.9272E+13
Xe-133		6.3291E+04	3.3812E-04	1.5310E+21	2.3418E+15
Xe-135		2.3824E+03	9.3292E-07	4.1616E+18	8.8149E+13
Kr-83m		1.8585E-03	9.0080E-14	6.5359E+11	6.8766E+07
Xe-131m		4.2038E+02	5.0188E-06	2.3072E+19	1.5554E+13
Xe-133m		1.5834E+03	3.5289E-06	1.5979E+19	5.8587E+13
Xe-135m		3.0472E+01	3.3452E-10	1.4922E+15	1.1275E+12

Environment Transport Group Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

	Present	Release	Integral
Time (h) = 8.0000	Release	Rate/s	Release
Noble gases (atoms)	3.2938E+16	4.5748E+14	2.0741E+22
Elemental I (atoms)	2.8607E+00	3.9733E-02	4.0252E+18
Organic I (atoms)	1.0830E+00	1.5041E-02	1.5238E+18
Aerosols (kg)	3.8753E-25	5.3824E-27	2.9327E-13

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	1.0882E+02	1.3374E-06	9.3651E+18	4.0264E+12
Cs-134	1.2316E+04	9.5192E-03	4.2780E+22	4.5570E+14
Cs-136	3.1446E+03	4.2905E-05	1.8999E+20	1.1635E+14
Cs-137	6.6626E+03	7.6597E-02	3.3670E+23	2.4651E+14
Cs-134m	4.5843E-03	5.6846E-13	2.5547E+12	1.6962E+08
Rb-88	3.5814E-08	2.9836E-19	2.0418E+06	1.3251E+03
Ba-137m	7.3856E+03	1.3733E-08	6.0366E+16	2.7327E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 8.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.6161E-02

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 8.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 8.0000	Ci	kg	Atoms	Bq
I-131	5.9604E-02	4.8078E-10	2.2102E+15	2.2054E+09
I-132	5.3647E-03	5.1973E-13	2.3711E+12	1.9849E+08
I-133	1.3797E-02	1.2179E-11	5.5147E+13	5.1049E+08
I-135	2.3075E-04	6.5706E-14	2.9310E+11	8.5378E+06
I-130	9.6988E-05	4.9729E-14	2.3036E+11	3.5886E+06
Br-82	1.0504E-04	9.7020E-14	7.1252E+11	3.8864E+06
Br-83	5.1782E-10	3.2778E-20	2.3782E+05	1.9159E+01

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 8.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.6458E+15
Organic I (atoms)	6.2307E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 8.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 8.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		1.0882E+02	1.3374E-06	9.3651E+18	4.0264E+12
I-131		1.2945E+02	1.0442E-06	4.8003E+18	4.7898E+12
I-132		1.1170E+01	1.0821E-09	4.9369E+15	4.1329E+11
I-133		2.9966E+01	2.6453E-08	1.1978E+17	1.1088E+12
I-135		5.0118E-01	1.4271E-10	6.3661E+14	1.8544E+10
Cs-134		1.2316E+04	9.5192E-03	4.2780E+22	4.5570E+14
Cs-136		3.1446E+03	4.2905E-05	1.8999E+20	1.1635E+14
Cs-137		6.6626E+03	7.6597E-02	3.3670E+23	2.4651E+14
I-130		2.1065E-01	1.0801E-10	5.0034E+14	7.7941E+09
Cs-134m		4.5843E-03	5.6846E-13	2.5547E+12	1.6962E+08
Rb-88		3.5814E-08	2.9836E-19	2.0418E+06	1.3251E+03
Ba-137m		7.3856E+03	1.3733E-08	6.0366E+16	2.7327E+14
Br-82		2.2814E-01	2.1072E-10	1.5476E+15	8.4411E+09
Br-83		1.1247E-06	7.1192E-17	5.1654E+08	4.1613E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	3.5745E+18	
Organic I (atoms)	1.3532E+18	
Aerosols (kg)	8.6161E-02	

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Kr-85		5.4747E-08	1.3954E-13	9.8864E+11	2.0257E+03
Xe-133		1.9368E-02	1.0347E-10	4.6852E+14	7.1662E+08
Xe-135		4.2974E-03	1.6828E-12	7.5066E+12	1.5900E+08
Kr-83m		4.9255E-08	2.3873E-18	1.7321E+07	1.8224E+03
Xe-131m		4.1678E-04	4.9758E-12	2.2874E+13	1.5421E+07
Xe-133m		1.3819E-03	3.0798E-12	1.3945E+13	5.1131E+07
Xe-135m		1.2019E-02	1.3195E-13	5.8860E+11	4.4472E+08

Control Room Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		5.1442E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)		5.3871E+01	0.0000E+00	0.0000E+00
Organic I (atoms)		2.0394E+01	0.0000E+00	0.0000E+00
Aerosols (kg)		7.3122E-24	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) =	8.0000	Ci	kg	Atoms	Bq
I-131		7.0224E-02	5.6643E-10	2.6039E+15	2.5983E+09
I-132		5.4729E-03	5.3021E-13	2.4189E+12	2.0250E+08
I-133		1.6256E-02	1.4350E-11	6.4977E+13	6.0148E+08
I-135		2.7188E-04	7.7418E-14	3.4535E+11	1.0060E+07
I-130		1.1427E-04	5.8592E-14	2.7142E+11	4.2282E+06
Br-82		1.2376E-04	1.1431E-13	8.3952E+11	4.5791E+06
Br-83		6.1011E-10	3.8620E-20	2.8021E+05	2.2574E+01

Deposition Recirculating

Time (h) =	8.0000	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	1.9388E+15
Organic I (atoms)		0.0000E+00	7.3397E+14
Aerosols (kg)		0.0000E+00	5.2775E-22

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	8.0000	Pathway
		Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
I-131	5.9604E-02	4.8078E-10	2.2102E+15	2.2054E+09
I-132	5.3647E-03	5.1973E-13	2.3711E+12	1.9849E+08
I-133	1.3797E-02	1.2179E-11	5.5147E+13	5.1049E+08
I-135	2.3075E-04	6.5706E-14	2.9310E+11	8.5378E+06
I-130	9.6988E-05	4.9729E-14	2.3036E+11	3.5886E+06
Br-82	1.0504E-04	9.7020E-14	7.1252E+11	3.8864E+06
Br-83	5.1782E-10	3.2778E-20	2.3782E+05	1.9159E+01

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	Pathway
8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.6458E+15
Organic I (atoms)	6.2307E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	Pathway
8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) =	Pathway
8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
I-131	1.2983E-01	1.0472E-09	4.8141E+15	4.8036E+09
I-132	1.0838E-02	1.0499E-12	4.7900E+12	4.0099E+08
I-133	3.0053E-02	2.6530E-11	1.2012E+14	1.1120E+09
I-135	5.0263E-04	1.4312E-13	6.3845E+11	1.8597E+07
I-130	2.1126E-04	1.0832E-13	5.0179E+11	7.8167E+06
Br-82	2.2880E-04	2.1133E-13	1.5520E+12	8.4655E+06
Br-83	1.1279E-09	7.1398E-20	5.1804E+05	4.1733E+01

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Xe-133	6.2058E-01	3.3154E-09	1.5012E+16	2.2961E+10
Xe-135	1.2532E-01	4.9072E-11	2.1890E+14	4.6367E+09
Kr-83m	1.6542E-06	8.0177E-17	5.8173E+08	6.1206E+04
Xe-131m	1.3504E-02	1.6122E-10	7.4113E+14	4.9964E+08
Xe-133m	4.4430E-02	9.9018E-11	4.4834E+14	1.6439E+09
Xe-135m	8.1371E-01	8.9328E-12	3.9848E+13	3.0107E+10

Fuel Pool-Filtered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
8.0000			
Noble gases (atoms)	1.6460E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	9.5399E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
8.0000		

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	1.0882E+02	1.3374E-06	9.3651E+18	4.0264E+12
I-131	1.2945E+02	1.0442E-06	4.8003E+18	4.7898E+12
I-132	1.1170E+01	1.0821E-09	4.9369E+15	4.1329E+11
I-133	2.9966E+01	2.6453E-08	1.1978E+17	1.1088E+12
I-135	5.0118E-01	1.4271E-10	6.3661E+14	1.8544E+10
Cs-134	1.2316E+04	9.5192E-03	4.2780E+22	4.5570E+14
Cs-136	3.1446E+03	4.2905E-05	1.8999E+20	1.1635E+14
Cs-137	6.6626E+03	7.6597E-02	3.3670E+23	2.4651E+14
I-130	2.1065E-01	1.0801E-10	5.0034E+14	7.7941E+09
Cs-134m	4.5843E-03	5.6846E-13	2.5547E+12	1.6962E+08
Rb-88	3.5814E-08	2.9836E-19	2.0418E+06	1.3251E+03
Ba-137m	7.3856E+03	1.3733E-08	6.0366E+16	2.7327E+14
Br-82	2.2814E-01	2.1072E-10	1.5476E+15	8.4411E+09
Br-83	1.1247E-06	7.1192E-17	5.1654E+08	4.1613E+04

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) =	Pathway
8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.5745E+18
Organic I (atoms)	1.3532E+18
Aerosols (kg)	8.6161E-02

Detailed model information at time (H) = 24.0000

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	3.0567E-02	1.1070E-16	5.2440E-02	3.0567E-02
Accumulated dose (rem)	4.0326E-01	3.2050E+01	1.1209E+00	1.3858E+00

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	1.1569E-03	4.1897E-18	1.9847E-03	1.1569E-03
Accumulated dose (rem)	4.4861E-02	3.9387E+00	1.2986E-01	1.6560E-01

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	4.2631E-04	5.5948E-13	2.7830E-02	4.2631E-04
Accumulated dose (rem)	3.5137E-02	6.2665E+01	3.6003E+00	1.9557E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
24.0000				
Xe-133	3.6411E-01	1.9452E-09	8.8079E+15	1.3472E+10
Xe-135	2.3407E-02	9.1658E-12	4.0887E+13	8.6606E+08
Kr-83m	1.5971E-08	7.7408E-19	5.6164E+06	5.9092E+02
Xe-131m	1.2750E-02	1.5221E-10	6.9973E+14	4.7173E+08
Xe-133m	2.6068E-02	5.8097E-11	2.6306E+14	9.6453E+08
Xe-135m	1.5199E-01	1.6685E-12	7.4428E+12	5.6235E+09

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
24.0000			
Noble gases (atoms)	9.8190E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	8.9131E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
24.0000		

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.0616E+02	1.3047E-06	9.1361E+18	3.9279E+12
Cs-134	1.2309E+04	9.5133E-03	4.2754E+22	4.5542E+14
Cs-136	3.0356E+03	4.1418E-05	1.8340E+20	1.1232E+14
Cs-137	6.6623E+03	7.6594E-02	3.3669E+23	2.4650E+14
Cs-134m	1.0010E-04	1.2412E-14	5.5782E+10	3.7035E+06
Ba-137m	7.3853E+03	1.3732E-08	6.0364E+16	2.7326E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.6150E-02

Environment Integral Nuclide Release:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	5.8814E+04	3.1421E-04	1.4227E+21	2.1761E+15
Xe-135	7.6014E+02	2.9766E-07	1.3278E+18	2.8125E+13
Kr-83m	1.8046E-05	8.7465E-16	6.3461E+09	6.6770E+05
Xe-131m	4.2507E+02	5.0748E-06	2.3329E+19	1.5728E+13
Xe-133m	1.3315E+03	2.9674E-06	1.3436E+19	4.9264E+13
Xe-135m	5.6930E+00	6.2497E-11	2.7879E+14	2.1064E+11

Environment Transport Group Inventory:

Time (h) = 24.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	1.9648E+16	2.7289E+14	2.0626E+22
Elemental I (atoms)	4.1477E-34	5.7607E-36	3.7608E+18
Organic I (atoms)	1.5702E-34	2.1808E-36	1.4237E+18
Aerosols (kg)	2.1019E-44	2.9194E-46	5.9065E-15

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.0616E+02	1.3047E-06	9.1361E+18	3.9279E+12
Cs-134	1.2309E+04	9.5133E-03	4.2754E+22	4.5542E+14
Cs-136	3.0356E+03	4.1418E-05	1.8340E+20	1.1232E+14
Cs-137	6.6623E+03	7.6594E-02	3.3669E+23	2.4650E+14
Cs-134m	1.0010E-04	1.2412E-14	5.5782E+10	3.7035E+06
Ba-137m	7.3853E+03	1.3732E-08	6.0364E+16	2.7326E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.6150E-02

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	5.6275E-02	4.5392E-10	2.0867E+15	2.0822E+09
I-132	4.3194E-05	4.1846E-15	1.9091E+10	1.5982E+06
I-133	8.0951E-03	7.1460E-12	3.2357E+13	2.9952E+08
I-135	4.3100E-05	1.2273E-14	5.4747E+10	1.5947E+06
I-130	3.9540E-05	2.0273E-14	9.3914E+10	1.4630E+06
Br-82	7.6719E-05	7.0863E-14	5.2042E+11	2.8386E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.5377E+15
Organic I (atoms)	5.8211E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.0616E+02	1.3047E-06	9.1361E+18	3.9279E+12
I-131	1.2222E+02	9.8588E-07	4.5321E+18	4.5223E+12
I-132	8.9935E-02	8.7128E-12	3.9750E+13	3.3276E+09
I-133	1.7582E+01	1.5521E-08	7.0277E+16	6.5054E+11
I-135	9.3611E-02	2.6656E-11	1.1891E+14	3.4636E+09
Cs-134	1.2309E+04	9.5133E-03	4.2754E+22	4.5542E+14
Cs-136	3.0356E+03	4.1418E-05	1.8340E+20	1.1232E+14
Cs-137	6.6623E+03	7.6594E-02	3.3669E+23	2.4650E+14
I-130	8.5878E-02	4.4033E-11	2.0398E+14	3.1775E+09
Cs-134m	1.0010E-04	1.2412E-14	5.5782E+10	3.7035E+06
Ba-137m	7.3853E+03	1.3732E-08	6.0364E+16	2.7326E+14
Br-82	1.6663E-01	1.5391E-10	1.1303E+15	6.1653E+09
Br-83	1.0858E-08	6.8733E-19	4.9870E+06	4.0176E+02

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 24.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.3396E+18
Organic I (atoms)	1.2643E+18
Aerosols (kg)	8.6150E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	4.3459E-03	2.3217E-11	1.0513E+14	1.6080E+08
Xe-135	3.0700E-04	1.2022E-13	5.3626E+11	1.1359E+07
Xe-131m	1.5050E-04	1.7968E-12	8.2601E+12	5.5686E+06
Xe-133m	3.1011E-04	6.9112E-13	3.1294E+12	1.1474E+07
Xe-135m	8.5895E-04	9.4294E-15	4.2063E+10	3.1781E+07

Control Room Transport Group Inventory:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 24.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	1.1709E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	7.8107E-33	0.0000E+00	0.0000E+00
Organic I (atoms)	2.9569E-33	0.0000E+00	0.0000E+00
Aerosols (kg)	3.9937E-43	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	6.6301E-02	5.3480E-10	2.4585E+15	2.4531E+09
I-132	4.4065E-05	4.2690E-15	1.9476E+10	1.6304E+06
I-133	9.5379E-03	8.4197E-12	3.8124E+13	3.5290E+08
I-135	5.0782E-05	1.4460E-14	6.4505E+10	1.8789E+06
I-130	4.6587E-05	2.3887E-14	1.1065E+11	1.7237E+06
Br-82	9.0393E-05	8.3493E-14	6.1318E+11	3.3445E+06

Time (h) = 24.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.8116E+15
Organic I (atoms)	0.0000E+00	6.8581E+14
Aerosols (kg)	0.0000E+00	3.2881E-38

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	5.6275E-02	4.5392E-10	2.0867E+15	2.0822E+09
I-132	4.3194E-05	4.1846E-15	1.9091E+10	1.5982E+06
I-133	8.0951E-03	7.1460E-12	3.2357E+13	2.9952E+08
I-135	4.3100E-05	1.2273E-14	5.4747E+10	1.5947E+06
I-130	3.9540E-05	2.0273E-14	9.3914E+10	1.4630E+06
Br-82	7.6719E-05	7.0863E-14	5.2042E+11	2.8386E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.5377E+15
Organic I (atoms)	5.8211E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
I-131	1.2258E-01	9.8872E-10	4.5452E+15	4.5353E+09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

I-132	8.7259E-05	8.4536E-15	3.8567E+10	3.2286E+06
I-133	1.7633E-02	1.5566E-11	7.0481E+13	6.5242E+08
I-135	9.3882E-05	2.6733E-14	1.1925E+11	3.4736E+06
I-130	8.6127E-05	4.4160E-14	2.0457E+11	3.1867E+06
Br-82	1.6711E-04	1.5436E-13	1.1336E+12	6.1831E+06

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	3.6411E-01	1.9452E-09	8.8079E+15	1.3472E+10
Xe-135	2.3407E-02	9.1658E-12	4.0887E+13	8.6606E+08
Kr-83m	1.5971E-08	7.7408E-19	5.6164E+06	5.9092E+02
Xe-131m	1.2750E-02	1.5221E-10	6.9973E+14	4.7173E+08
Xe-133m	2.6068E-02	5.8097E-11	2.6306E+14	9.6453E+08
Xe-135m	1.5199E-01	1.6685E-12	7.4428E+12	5.6235E+09

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	9.8190E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	8.9131E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 24.0000	Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.0616E+02	1.3047E-06	9.1361E+18	3.9279E+12
I-131	1.2222E+02	9.8588E-07	4.5321E+18	4.5223E+12
I-132	8.9935E-02	8.7128E-12	3.9750E+13	3.3276E+09
I-133	1.7582E+01	1.5521E-08	7.0277E+16	6.5054E+11
I-135	9.3611E-02	2.6656E-11	1.1891E+14	3.4636E+09
Cs-134	1.2309E+04	9.5133E-03	4.2754E+22	4.5542E+14
Cs-136	3.0356E+03	4.1418E-05	1.8340E+20	1.1232E+14
Cs-137	6.6623E+03	7.6594E-02	3.3669E+23	2.4650E+14
I-130	8.5878E-02	4.4033E-11	2.0398E+14	3.1775E+09
Cs-134m	1.0010E-04	1.2412E-14	5.5782E+10	3.7035E+06
Ba-137m	7.3853E+03	1.3732E-08	6.0364E+16	2.7326E+14
Br-82	1.6663E-01	1.5391E-10	1.1303E+15	6.1653E+09
Br-83	1.0858E-08	6.8733E-19	4.9870E+06	4.0176E+02

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.3396E+18
Organic I (atoms)	1.2643E+18
Aerosols (kg)	8.6150E-02

Detailed model information at time (H) = 96.0000

EAB Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	9.7780E-03	2.6903E-38	2.2081E-02	9.7780E-03
Accumulated dose (rem)	4.1304E-01	3.2050E+01	1.1430E+00	1.3955E+00

LPZ Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.5728E-04	4.3275E-40	3.5518E-04	1.5728E-04
Accumulated dose (rem)	4.5018E-02	3.9387E+00	1.3021E-01	1.6576E-01

Control Room Doses:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.1654E-05	6.3848E-35	6.3460E-03	7.1654E-05
Accumulated dose (rem)	3.5209E-02	6.2665E+01	3.6066E+00	1.9558E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	3.3053E-02	1.7658E-10	7.9955E+14	1.2230E+09
Xe-135	1.2313E-05	4.8214E-15	2.1508E+10	4.5557E+05
Xe-131m	9.8440E-03	1.1752E-10	5.4027E+14	3.6423E+08
Xe-133m	2.3664E-03	5.2738E-12	2.3879E+13	8.7556E+07
Xe-135m	7.9948E-05	8.7766E-16	3.9151E+09	2.9581E+06

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.3637E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	6.7874E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	9.4964E+01	1.1671E-06	8.1726E+18	3.5137E+12
Cs-134	1.2275E+04	9.4871E-03	4.2636E+22	4.5416E+14
Cs-136	2.5900E+03	3.5339E-05	1.5648E+20	9.5831E+13
Cs-137	6.6610E+03	7.6579E-02	3.3662E+23	2.4646E+14
Ba-137m	7.3839E+03	1.3730E-08	6.0352E+16	2.7320E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.6103E-02

Environment Integral Nuclide Release:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	4.0614E+04	2.1698E-04	9.8246E+20	1.5027E+15
Xe-135	3.4893E+00	1.3663E-09	6.0951E+15	1.2910E+11
Xe-131m	4.3126E+02	5.1488E-06	2.3669E+19	1.5957E+13
Xe-133m	5.5327E+02	1.2330E-06	5.5831E+18	2.0471E+13
Xe-135m	2.9948E-03	3.2876E-14	1.4666E+11	1.1081E+08

Environment Transport Group Inventory:

Time (h) = 96.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.7284E+15	3.7894E+13	2.0166E+22
Elemental I (atoms)	0.0000E+00	0.0000E+00	2.8639E+18
Organic I (atoms)	0.0000E+00	0.0000E+00	1.0842E+18
Aerosols (kg)	0.0000E+00	0.0000E+00	1.3791E-22

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	9.4964E+01	1.1671E-06	8.1726E+18	3.5137E+12
Cs-134	1.2275E+04	9.4871E-03	4.2636E+22	4.5416E+14
Cs-136	2.5900E+03	3.5339E-05	1.5648E+20	9.5831E+13
Cs-137	6.6610E+03	7.6579E-02	3.3662E+23	2.4646E+14

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Ba-137m 7.3839E+03 1.3730E-08 6.0352E+16 2.7320E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.6103E-02

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	4.3450E-02	3.5048E-10	1.6112E+15	1.6077E+09
I-133	7.3484E-04	6.4869E-13	2.9372E+12	2.7189E+07
I-135	2.2672E-08	6.4557E-18	2.8798E+07	8.3885E+02
I-130	6.9737E-07	3.5756E-16	1.6564E+09	2.5803E+04
Br-82	1.8660E-05	1.7235E-14	1.2658E+11	6.9041E+05

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.1709E+15
Organic I (atoms)	4.4328E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	9.4964E+01	1.1671E-06	8.1726E+18	3.5137E+12
I-131	9.4370E+01	7.6120E-07	3.4993E+18	3.4917E+12
I-133	1.5960E+00	1.4089E-09	6.3795E+15	5.9053E+10
I-135	4.9241E-05	1.4021E-14	6.2548E+10	1.8219E+06
Cs-134	1.2275E+04	9.4871E-03	4.2636E+22	4.5416E+14
Cs-136	2.5900E+03	3.5339E-05	1.5648E+20	9.5831E+13
Cs-137	6.6610E+03	7.6579E-02	3.3662E+23	2.4646E+14
I-130	1.5146E-03	7.7661E-13	3.5976E+12	5.6042E+07
Ba-137m	7.3839E+03	1.3730E-08	6.0352E+16	2.7320E+14
Br-82	4.0528E-02	3.7434E-11	2.7492E+14	1.4995E+09

Fuel Pool Release-Filtered Transport Group Inventory:

Pathway

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.5432E+18
Organic I (atoms)	9.6276E+17
Aerosols (kg)	8.6103E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	2.9775E-04	1.5907E-12	7.2026E+12	1.1017E+07
Xe-135	1.2188E-07	4.7727E-17	2.1290E+08	4.5096E+03
Xe-131m	8.7706E-05	1.0471E-12	4.8135E+12	3.2451E+06
Xe-133m	2.1247E-05	4.7351E-14	2.1440E+11	7.8613E+05
Xe-135m	3.4107E-07	3.7442E-18	1.6702E+07	1.2620E+04

Control Room Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.2231E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	5.1191E-02	4.1292E-10	1.8982E+15	1.8941E+09
I-133	8.6582E-04	7.6431E-13	3.4607E+12	3.2035E+07
I-135	2.6713E-08	7.6064E-18	3.3931E+07	9.8836E+02
I-130	8.2167E-07	4.2129E-16	1.9516E+09	3.0402E+04
Br-82	2.1985E-05	2.0307E-14	1.4914E+11	8.1346E+05

Time (h) = 96.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.3796E+15
Organic I (atoms)	0.0000E+00	5.2226E+14
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	4.3450E-02	3.5048E-10	1.6112E+15	1.6077E+09
I-133	7.3484E-04	6.4869E-13	2.9372E+12	2.7189E+07
I-135	2.2672E-08	6.4557E-18	2.8798E+07	8.3885E+02
I-130	6.9737E-07	3.5756E-16	1.6564E+09	2.5803E+04
Br-82	1.8660E-05	1.7235E-14	1.2658E+11	6.9041E+05

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.1709E+15
Organic I (atoms)	4.4328E+14
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Organic I (atoms) 0.0000E+00
Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
I-131	9.4642E-02	7.6339E-10	3.5094E+15	3.5017E+09
I-133	1.6007E-03	1.4130E-12	6.3980E+12	5.9225E+07
I-135	4.9384E-08	1.4062E-17	6.2729E+07	1.8272E+03
I-130	1.5190E-06	7.7886E-16	3.6080E+09	5.6204E+04
Br-82	4.0645E-05	3.7543E-14	2.7572E+11	1.5039E+06

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	3.3053E-02	1.7658E-10	7.9955E+14	1.2230E+09
Xe-135	1.2313E-05	4.8214E-15	2.1508E+10	4.5557E+05
Xe-131m	9.8440E-03	1.1752E-10	5.4027E+14	3.6423E+08
Xe-133m	2.3664E-03	5.2738E-12	2.3879E+13	8.7556E+07
Xe-135m	7.9948E-05	8.7766E-16	3.9151E+09	2.9581E+06

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.3637E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	6.7874E+20
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	9.4964E+01	1.1671E-06	8.1726E+18	3.5137E+12
I-131	9.4370E+01	7.6120E-07	3.4993E+18	3.4917E+12
I-133	1.5960E+00	1.4089E-09	6.3795E+15	5.9053E+10
I-135	4.9241E-05	1.4021E-14	6.2548E+10	1.8219E+06
Cs-134	1.2275E+04	9.4871E-03	4.2636E+22	4.5416E+14
Cs-136	2.5900E+03	3.5339E-05	1.5648E+20	9.5831E+13
Cs-137	6.6610E+03	7.6579E-02	3.3662E+23	2.4646E+14
I-130	1.5146E-03	7.7661E-13	3.5976E+12	5.6042E+07
Ba-137m	7.3839E+03	1.3730E-08	6.0352E+16	2.7320E+14
Br-82	4.0528E-02	3.7434E-11	2.7492E+14	1.4995E+09

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.5432E+18
Organic I (atoms)	9.6276E+17
Aerosols (kg)	8.6103E-02

Detailed model information at time (H) = 720.0000

EAB Doses:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.2148E-04	5.5873-125	3.4903E-03	5.2148E-04
Accumulated dose (rem)	4.1356E-01	3.2050E+01	1.1465E+00	1.3961E+00

LPZ Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.4574E-06	2.6330-127	1.6448E-05	2.4574E-06
Accumulated dose (rem)	4.5021E-02	3.9387E+00	1.3023E-01	1.6576E-01

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.7563E-06	8.8400-122	6.2322E-04	2.7563E-06
Accumulated dose (rem)	3.5212E-02	6.2665E+01	3.6073E+00	1.9558E+00

Fuel Pool-Unfiltered Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	3.0783E-11	1.6445E-19	7.4464E+05	1.1390E+00
Xe-131m	1.0464E-03	1.2492E-11	5.7429E+13	3.8716E+07

Fuel Pool-Unfiltered Transport Group Inventory:

Time (h) = 720.0000	Overlying		
	Atmosphere	Sump	Pool
Noble gases (atoms)	5.7429E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	7.2011E+19
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition	
	Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	3.6151E+01	4.4429E-07	3.1111E+18	1.3376E+12
Cs-134	1.1984E+04	9.2628E-03	4.1628E+22	4.4342E+14
Cs-136	6.5439E+02	8.9287E-06	3.9537E+19	2.4213E+13
Cs-137	6.6501E+03	7.6454E-02	3.3607E+23	2.4605E+14
Ba-137m	7.3718E+03	1.3707E-08	6.0253E+16	2.7276E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.5726E-02

Environment Integral Nuclide Release:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	1.3242E+03	7.0744E-06	3.2032E+19	4.8995E+13
Xe-131m	1.9138E+02	2.2848E-06	1.0503E+19	7.0811E+12

Environment Transport Group Inventory:

Time (h) = 720.0000	Present	Release	Integral
	Release	Rate/s	Release
Noble gases (atoms)	1.1486E+14	1.5953E+12	1.9109E+22
Elemental I (atoms)	0.0000E+00	0.0000E+00	3.0384E+17
Organic I (atoms)	0.0000E+00	0.0000E+00	1.1502E+17
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Unfiltered

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	3.6151E+01	4.4429E-07	3.1111E+18	1.3376E+12
Cs-134	1.1984E+04	9.2628E-03	4.1628E+22	4.4342E+14
Cs-136	6.5439E+02	8.9287E-06	3.9537E+19	2.4213E+13
Cs-137	6.6501E+03	7.6454E-02	3.3607E+23	2.4605E+14
Ba-137m	7.3718E+03	1.3707E-08	6.0253E+16	2.7276E+14

Fuel Pool Release-Unfiltered Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	8.5726E-02

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	4.6186E-03	3.7255E-11	1.7126E+14	1.7089E+08
Br-82	8.9039E-11	8.2243E-20	6.0399E+05	3.2944E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.2423E+14
Organic I (atoms)	4.7030E+13
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	3.6151E+01	4.4429E-07	3.1111E+18	1.3376E+12
I-131	1.0031E+01	8.0913E-08	3.7196E+17	3.7115E+11
I-133	1.4864E-09	1.3122E-18	5.9414E+06	5.4998E+01
Cs-134	1.1984E+04	9.2628E-03	4.1628E+22	4.4342E+14
Cs-136	6.5439E+02	8.9287E-06	3.9537E+19	2.4213E+13
Cs-137	6.6501E+03	7.6454E-02	3.3607E+23	2.4605E+14
Ba-137m	7.3718E+03	1.3707E-08	6.0253E+16	2.7276E+14
Br-82	1.9339E-07	1.7863E-16	1.3118E+09	7.1553E+03

Fuel Pool Release-Filtered Transport Group Inventory:

Pathway

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Time (h) = 720.0000 Filter
 Noble gases (atoms) 0.0000E+00
 Elemental I (atoms) 2.6982E+17
 Organic I (atoms) 1.0214E+17
 Aerosols (kg) 8.5726E-02

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000 Ci kg Atoms Bq
 Xe-131m 7.0858E-06 8.4595E-14 3.8889E+11 2.6217E+05

Control Room Transport Group Inventory:

Time (h) = 720.0000 Atmosphere Sump Overlying Pool
 Noble gases (atoms) 3.8889E+11 0.0000E+00 0.0000E+00
 Elemental I (atoms) 0.0000E+00 0.0000E+00 0.0000E+00
 Organic I (atoms) 0.0000E+00 0.0000E+00 0.0000E+00
 Aerosols (kg) 0.0000E+00 0.0000E+00 0.0000E+00

Recirculating Filter Inventory

Time (h) = 720.0000 Ci kg Atoms Bq
 I-131 5.4415E-03 4.3892E-11 2.0177E+14 2.0133E+08
 Br-82 1.0491E-10 9.6901E-20 7.1165E+05 3.8816E+00

Deposition Recirculating

Time (h) = 720.0000 Surfaces Filter
 Noble gases (atoms) 0.0000E+00 0.0000E+00
 Elemental I (atoms) 0.0000E+00 1.4636E+14
 Organic I (atoms) 0.0000E+00 5.5409E+13
 Aerosols (kg) 0.0000E+00 0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000 Pathway Filter
 Noble gases (atoms) 0.0000E+00
 Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000 Ci kg Atoms Bq
 I-131 4.6186E-03 3.7255E-11 1.7126E+14 1.7089E+08
 Br-82 8.9039E-11 8.2243E-20 6.0399E+05 3.2944E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000 Pathway Filter
 Noble gases (atoms) 0.0000E+00
 Elemental I (atoms) 1.2423E+14
 Organic I (atoms) 4.7030E+13
 Aerosols (kg) 0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000 Pathway Filter
 Noble gases (atoms) 0.0000E+00
 Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000 Pathway Filter
 Noble gases (atoms) 0.0000E+00
 Elemental I (atoms) 0.0000E+00
 Organic I (atoms) 0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Aerosols (kg) 0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
I-131	1.0060E-02	8.1146E-11	3.7303E+14	3.7222E+08
Br-82	1.9395E-10	1.7914E-19	1.3156E+06	7.1761E+00

Fuel Pool-Filtered Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-133	3.0783E-11	1.6445E-19	7.4464E+05	1.1390E+00
Xe-131m	1.0464E-03	1.2492E-11	5.7429E+13	3.8716E+07

Fuel Pool-Filtered Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	5.7429E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	7.2011E+19
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Filter Pathway Nuclide Inventory for Fuel Pool Release-Filtered

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	3.6151E+01	4.4429E-07	3.1111E+18	1.3376E+12
I-131	1.0031E+01	8.0913E-08	3.7196E+17	3.7115E+11
I-133	1.4864E-09	1.3122E-18	5.9414E+06	5.4998E+01
Cs-134	1.1984E+04	9.2628E-03	4.1628E+22	4.4342E+14
Cs-136	6.5439E+02	8.9287E-06	3.9537E+19	2.4213E+13
Cs-137	6.6501E+03	7.6454E-02	3.3607E+23	2.4605E+14
Ba-137m	7.3718E+03	1.3707E-08	6.0253E+16	2.7276E+14
Br-82	1.9339E-07	1.7863E-16	1.3118E+09	7.1553E+03

Fuel Pool Release-Filtered Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.6982E+17
Organic I (atoms)	1.0214E+17
Aerosols (kg)	8.5726E-02

Transport Group Totals in Model:

Noble Gases (atoms)	1.9109E+22
Elemental I (atoms)	1.4460E+20
Organic I (atoms)	2.1727E+17
Aerosols (kg)	1.7145E-01

37004

I-131 Summary
#####

Time (hr)	Fuel Pool-Unfiltered I-131 (Curies)	Environment I-131 (Curies)	Control Room I-131 (Curies)
0.000	0.0000E+00	0.0000E+00	0.0000E+00
0.001	0.0000E+00	0.0000E+00	0.0000E+00
0.002	0.0000E+00	0.0000E+00	0.0000E+00
0.280	1.1687E-02	2.0584E+01	6.7252E-02
0.333	1.1685E-02	2.4530E+01	7.7946E-02

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

0.600	1.1674E-02	4.4319E+01	2.7681E-02
0.860	1.1664E-02	6.3556E+01	1.4128E-02
1.120	1.1653E-02	8.2754E+01	1.0300E-02
1.380	1.1643E-02	1.0191E+02	9.2154E-03
1.640	1.1632E-02	1.2104E+02	8.9039E-03
1.900	1.1622E-02	1.4013E+02	8.8103E-03
2.000	1.1618E-02	1.4746E+02	8.7943E-03
2.002	1.1618E-02	1.4761E+02	8.7758E-03
2.280	0.0000E+00	1.4880E+02	2.4312E-03
2.540	0.0000E+00	1.4867E+02	6.8551E-04
2.800	0.0000E+00	1.4853E+02	1.9329E-04
3.060	0.0000E+00	1.4839E+02	5.4501E-05
3.320	0.0000E+00	1.4825E+02	1.5368E-05
3.580	0.0000E+00	1.4811E+02	4.3331E-06
3.840	0.0000E+00	1.4797E+02	1.2218E-06
4.100	0.0000E+00	1.4784E+02	3.4451E-07
4.360	0.0000E+00	1.4770E+02	9.7139E-08
4.620	0.0000E+00	1.4756E+02	2.7390E-08
4.880	0.0000E+00	1.4742E+02	7.7231E-09
5.140	0.0000E+00	1.4728E+02	2.1776E-09
5.400	0.0000E+00	1.4715E+02	6.1402E-10
5.660	0.0000E+00	1.4701E+02	1.7313E-10
5.920	0.0000E+00	1.4687E+02	4.8818E-11
6.180	0.0000E+00	1.4674E+02	1.3765E-11
6.440	0.0000E+00	1.4660E+02	3.8813E-12
6.700	0.0000E+00	1.4646E+02	1.0944E-12
6.960	0.0000E+00	1.4632E+02	3.0858E-13
7.220	0.0000E+00	1.4619E+02	8.7009E-14
7.480	0.0000E+00	1.4605E+02	2.4534E-14
7.740	0.0000E+00	1.4592E+02	6.9177E-15
8.000	0.0000E+00	1.4578E+02	1.9505E-15
8.260	0.0000E+00	1.4564E+02	5.4999E-16
8.520	0.0000E+00	1.4551E+02	1.5508E-16
8.780	0.0000E+00	1.4537E+02	4.3727E-17
9.040	0.0000E+00	1.4524E+02	1.2330E-17
9.300	0.0000E+00	1.4510E+02	3.4765E-18
9.560	0.0000E+00	1.4496E+02	9.8026E-19
9.820	0.0000E+00	1.4483E+02	2.7640E-19
10.080	0.0000E+00	1.4469E+02	7.7936E-20
24.000	0.0000E+00	1.3764E+02	2.8585E-49
96.000	0.0000E+00	1.0627E+02	1.5962-201
720.000	0.0000E+00	1.1296E+01	0.0000E+00

Time (hr)	Fuel Pool-Filtered I-131 (Curies)
0.000	0.0000E+00
0.001	0.0000E+00
0.002	0.0000E+00
0.280	1.1687E-02
0.333	1.1685E-02
0.600	1.1674E-02
0.860	1.1664E-02
1.120	1.1653E-02
1.380	1.1643E-02
1.640	1.1632E-02
1.900	1.1622E-02
2.000	1.1618E-02
2.002	1.1618E-02
2.280	0.0000E+00
2.540	0.0000E+00
2.800	0.0000E+00
3.060	0.0000E+00
3.320	0.0000E+00
3.580	0.0000E+00
3.840	0.0000E+00
4.100	0.0000E+00
4.360	0.0000E+00
4.620	0.0000E+00
4.880	0.0000E+00
5.140	0.0000E+00
5.400	0.0000E+00
5.660	0.0000E+00
5.920	0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

6.180	0.0000E+00
6.440	0.0000E+00
6.700	0.0000E+00
6.960	0.0000E+00
7.220	0.0000E+00
7.480	0.0000E+00
7.740	0.0000E+00
8.000	0.0000E+00
8.260	0.0000E+00
8.520	0.0000E+00
8.780	0.0000E+00
9.040	0.0000E+00
9.300	0.0000E+00
9.560	0.0000E+00
9.820	0.0000E+00
10.080	0.0000E+00
24.000	0.0000E+00
96.000	0.0000E+00
720.000	0.0000E+00

 Cumulative Dose Summary
 #####

Time (hr)	EAB		LPZ		Control Room	
	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)
0.000	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.001	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.002	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
0.280	4.4208E+00	1.8246E-01	5.4625E-01	2.2545E-02	1.3839E+01	4.2762E-01
0.333	5.2687E+00	2.1747E-01	6.5102E-01	2.6871E-02	1.9294E+01	5.9618E-01
0.600	9.5219E+00	3.9305E-01	1.1765E+00	4.8566E-02	3.7157E+01	1.1495E+00
0.860	1.3659E+01	5.6392E-01	1.6877E+00	6.9679E-02	4.4302E+01	1.3728E+00
1.120	1.7790E+01	7.3455E-01	2.1981E+00	9.0763E-02	4.8628E+01	1.5090E+00
1.380	2.1915E+01	9.0498E-01	2.7078E+00	1.1182E-01	5.2157E+01	1.6204E+00
1.640	2.6035E+01	1.0752E+00	3.2169E+00	1.3286E-01	5.5459E+01	1.7247E+00
1.900	3.0149E+01	1.2452E+00	3.7253E+00	1.5386E-01	5.8693E+01	1.8269E+00
2.000	3.1731E+01	1.3106E+00	3.9207E+00	1.6193E-01	5.9930E+01	1.8660E+00
2.002	3.1762E+01	1.3120E+00	3.9225E+00	1.6202E-01	5.9955E+01	1.8667E+00
2.280	3.2050E+01	1.3256E+00	3.9387E+00	1.6278E-01	6.1963E+01	1.9306E+00
2.540	3.2050E+01	1.3273E+00	3.9387E+00	1.6288E-01	6.2467E+01	1.9472E+00
2.800	3.2050E+01	1.3291E+00	3.9387E+00	1.6298E-01	6.2609E+01	1.9522E+00
3.060	3.2050E+01	1.3307E+00	3.9387E+00	1.6307E-01	6.2649E+01	1.9537E+00
3.320	3.2050E+01	1.3323E+00	3.9387E+00	1.6316E-01	6.2660E+01	1.9543E+00
3.580	3.2050E+01	1.3339E+00	3.9387E+00	1.6325E-01	6.2663E+01	1.9545E+00
3.840	3.2050E+01	1.3355E+00	3.9387E+00	1.6333E-01	6.2664E+01	1.9546E+00
4.100	3.2050E+01	1.3369E+00	3.9387E+00	1.6342E-01	6.2664E+01	1.9547E+00
4.360	3.2050E+01	1.3384E+00	3.9387E+00	1.6350E-01	6.2665E+01	1.9547E+00
4.620	3.2050E+01	1.3398E+00	3.9387E+00	1.6358E-01	6.2665E+01	1.9548E+00
4.880	3.2050E+01	1.3412E+00	3.9387E+00	1.6366E-01	6.2665E+01	1.9548E+00
5.140	3.2050E+01	1.3425E+00	3.9387E+00	1.6373E-01	6.2665E+01	1.9549E+00
5.400	3.2050E+01	1.3439E+00	3.9387E+00	1.6381E-01	6.2665E+01	1.9549E+00
5.660	3.2050E+01	1.3451E+00	3.9387E+00	1.6388E-01	6.2665E+01	1.9550E+00
5.920	3.2050E+01	1.3464E+00	3.9387E+00	1.6395E-01	6.2665E+01	1.9550E+00
6.180	3.2050E+01	1.3476E+00	3.9387E+00	1.6402E-01	6.2665E+01	1.9551E+00
6.440	3.2050E+01	1.3488E+00	3.9387E+00	1.6408E-01	6.2665E+01	1.9551E+00
6.700	3.2050E+01	1.3499E+00	3.9387E+00	1.6415E-01	6.2665E+01	1.9551E+00
6.960	3.2050E+01	1.3510E+00	3.9387E+00	1.6421E-01	6.2665E+01	1.9552E+00
7.220	3.2050E+01	1.3521E+00	3.9387E+00	1.6427E-01	6.2665E+01	1.9552E+00
7.480	3.2050E+01	1.3532E+00	3.9387E+00	1.6433E-01	6.2665E+01	1.9552E+00
7.740	3.2050E+01	1.3542E+00	3.9387E+00	1.6439E-01	6.2665E+01	1.9553E+00
8.000	3.2050E+01	1.3552E+00	3.9387E+00	1.6444E-01	6.2665E+01	1.9553E+00
8.260	3.2050E+01	1.3562E+00	3.9387E+00	1.6448E-01	6.2665E+01	1.9553E+00
8.520	3.2050E+01	1.3571E+00	3.9387E+00	1.6452E-01	6.2665E+01	1.9554E+00
8.780	3.2050E+01	1.3581E+00	3.9387E+00	1.6455E-01	6.2665E+01	1.9554E+00
9.040	3.2050E+01	1.3590E+00	3.9387E+00	1.6459E-01	6.2665E+01	1.9554E+00
9.300	3.2050E+01	1.3599E+00	3.9387E+00	1.6462E-01	6.2665E+01	1.9554E+00
9.560	3.2050E+01	1.3607E+00	3.9387E+00	1.6465E-01	6.2665E+01	1.9554E+00
9.820	3.2050E+01	1.3616E+00	3.9387E+00	1.6469E-01	6.2665E+01	1.9554E+00
10.080	3.2050E+01	1.3624E+00	3.9387E+00	1.6472E-01	6.2665E+01	1.9554E+00
24.000	3.2050E+01	1.3858E+00	3.9387E+00	1.6560E-01	6.2665E+01	1.9557E+00
96.000	3.2050E+01	1.3955E+00	3.9387E+00	1.6576E-01	6.2665E+01	1.9558E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

720.000 3.2050E+01 1.3961E+00 3.9387E+00 1.6576E-01 6.2665E+01 1.9558E+00

```
#####
                Worst Two-Hour Dose
            (Provided for Dose Location 1)
#####
```

EAB

Time (hr)	Whole Body (rem)	Thyroid (rem)	Skin (rem)	TEDE (rem)
0.0	3.3785E-01	3.1731E+01	1.0068E+00	1.3106E+00

```
#####
                30 Day Control Room Skin Dose
#####
```

Control Room

Time (hr)	Skin (rem)
720.0	3.6073E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Attachment 6 FHA Nuclide Inventory File

Nuclide Inventory Name:

Palisades AST Design Basis FHA source term Adjusted

Power Level:

0.2703E+04

Nuclides:

107

Nuclide 001:

Co-58

7

0.6117120000E+07

0.5800E+02

0.0000E+00

none 0.0000E+00

none 0.0000E+00

none 0.0000E+00

Nuclide 002:

Co-60

7

0.1663401096E+09

0.6000E+02

0.0000E+00

none 0.0000E+00

none 0.0000E+00

none 0.0000E+00

Nuclide 003:

Kr-85

1

0.3382974720E+09

0.8500E+02

0.2104E+05

none 0.0000E+00

none 0.0000E+00

none 0.0000E+00

Nuclide 004:

Kr-85m

1

0.1612800000E+05

0.8500E+02

0.1174E+03

Kr-85 0.2110E+00

none 0.0000E+00

none 0.0000E+00

Nuclide 005:

Kr-87

1

0.4578000000E+04

0.8700E+02

0.1647E-05

Rb-87 0.1000E+01

none 0.0000E+00

none 0.0000E+00

Nuclide 006:

Kr-88

1

0.1022400000E+05

0.8800E+02

0.4302E+01

Rb-88 0.1000E+01

none 0.0000E+00

none 0.0000E+00

Nuclide 007:

Rb-86

3

0.1612224000E+07

0.8600E+02

0.1819E+04

none 0.0000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
none      0.0000E+00
none      0.0000E+00
Nuclide 008:
Sr-89
5
0.4363200000E+07
0.8900E+02
0.7020E+06
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 009:
Sr-90
5
0.9189573120E+09
0.9000E+02
0.8456E+05
Y-90     0.1000E+01
none     0.0000E+00
none     0.0000E+00
Nuclide 010:
Sr-91
5
0.3420000000E+05
0.9100E+02
0.2679E+05
Y-91m   0.5780E+00
Y-91    0.4220E+00
none    0.0000E+00
Nuclide 011:
Sr-92
5
0.9756000000E+04
0.9200E+02
0.4453E+01
Y-92    0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 012:
Y-90
9
0.2304000000E+06
0.9000E+02
0.8623E+05
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 013:
Y-91
9
0.5055264000E+07
0.9100E+02
0.9107E+06
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 014:
Y-92
9
0.1274400000E+05
0.9200E+02
0.3229E+03
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 015:
Y-93
9
0.3636000000E+05
0.9300E+02
0.4137E+05
Zr-93   0.1000E+01
none    0.0000E+00
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
none 0.0000E+00
Nuclide 016:
Zr-95
 9
0.5527872000E+07
0.9500E+02
0.1210E+07
Nb-95m 0.7000E-02
Nb-95 0.9930E+00
none 0.0000E+00
Nuclide 017:
Zr-97
 9
0.6084000000E+05
0.9700E+02
0.1684E+06
Nb-97m 0.9470E+00
Nb-97 0.5300E-01
none 0.0000E+00
Nuclide 018:
Nb-95
 9
0.3036960000E+07
0.9500E+02
0.1248E+07
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 019:
Mo-99
 7
0.2376000000E+06
0.9900E+02
0.8264E+06
Tc-99m 0.8760E+00
Tc-99 0.1240E+00
none 0.0000E+00
Nuclide 020:
Tc-99m
 7
0.2167200000E+05
0.9900E+02
0.7956E+06
Tc-99 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 021:
Ru-103
 7
0.3393792000E+07
0.1030E+03
0.1216E+07
Rh-103m 0.9970E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 022:
Ru-105
 7
0.1598400000E+05
0.1050E+03
0.5426E+03
Rh-105 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 023:
Ru-106
 7
0.3181248000E+08
0.1060E+03
0.5771E+06
Rh-106 0.1000E+01
none 0.0000E+00
none 0.0000E+00
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Nuclide 024:
Rh-105
7
0.1272960000E+06
0.1050E+03
0.3958E+06
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 025:
Sb-127
4
0.3326400000E+06
0.1270E+03
0.6450E+05
Te-127m 0.1760E+00
Te-127 0.8240E+00
none 0.0000E+00
Nuclide 026:
Sb-129
4
0.1555200000E+05
0.1290E+03
0.1176E+03
Te-129m 0.2250E+00
Te-129 0.7750E+00
none 0.0000E+00
Nuclide 027:
Te-127
4
0.3366000000E+05
0.1270E+03
0.7344E+05
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 028:
Te-127m
4
0.9417600000E+07
0.1270E+03
0.1222E+05
Te-127 0.9760E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 029:
Te-129
4
0.4176000000E+04
0.1290E+03
0.2383E+05
I-129 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 030:
Te-129m
4
0.2903040000E+07
0.1290E+03
0.3637E+05
Te-129 0.6500E+00
I-129 0.3500E+00
none 0.0000E+00
Nuclide 031:
Te-131m
4
0.1080000000E+06
0.1310E+03
0.3690E+05
Te-131 0.2220E+00
I-131 0.7780E+00
none 0.0000E+00
Nuclide 032:

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
Te-132
  4
  0.2815200000E+06
  0.1320E+03
  0.6852E+06
I-132  0.1000E+01
none   0.0000E+00
none   0.0000E+00
Nuclide 033:
I-131
  2
  0.6946560000E+06
  0.1310E+03
  0.1028E+07
Xe-131m 0.1110E-01
none    0.0000E+00
none    0.0000E+00
Nuclide 034:
I-132
  2
  0.8280000000E+04
  0.1320E+03
  0.7060E+06
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 035:
I-133
  2
  0.7488000000E+05
  0.1330E+03
  0.3019E+06
Xe-133m 0.2900E-01
Xe-133  0.9710E+00
none    0.0000E+00
Nuclide 036:
I-134
  2
  0.3156000000E+04
  0.1340E+03
  0.2087E-09
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 037:
I-135
  2
  0.2379600000E+05
  0.1350E+03
  0.8949E+04
Xe-135m 0.1540E+00
Xe-135  0.8460E+00
none    0.0000E+00
Nuclide 038:
Xe-133
  1
  0.4531680000E+06
  0.1330E+03
  0.1298E+07
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 039:
Xe-135
  1
  0.3272400000E+05
  0.1350E+03
  0.8201E+05
Cs-135  0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 040:
Cs-134
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
3
0.6507177120E+08
0.1340E+03
0.2034E+06
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 041:
Cs-136
3
0.1131840000E+07
0.1360E+03
0.5284E+05
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 042:
Cs-137
3
0.9467280000E+09
0.1370E+03
0.1100E+06
Ba-137m  0.9460E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 043:
Ba-139
6
0.4962000000E+04
0.1390E+03
0.4861E-04
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 044:
Ba-140
6
0.1100736000E+07
0.1400E+03
0.1130E+07
La-140   0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 045:
La-140
9
0.1449792000E+06
0.1400E+03
0.1235E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 046:
La-141
9
0.1414800000E+05
0.1410E+03
0.2730E+03
Ce-141   0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 047:
La-142
9
0.5550000000E+04
0.1420E+03
0.5794E-03
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 048:
Ce-141
8
```


Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
0.2808086400E+07
0.1410E+03
0.1168E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 049:
Ce-143
  8
0.1188000000E+06
0.1430E+03
0.4100E+06
Pr-143    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 050:
Ce-144
  8
0.2456352000E+08
0.1440E+03
0.1014E+07
Pr-144m   0.1780E-01
Pr-144    0.9822E+00
none      0.0000E+00
Nuclide 051:
Pr-143
  9
0.1171584000E+07
0.1430E+03
0.1071E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 052:
Nd-147
  9
0.9486720000E+06
0.1470E+03
0.4211E+06
Pm-147    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 053:
Np-239
  8
0.2034720000E+06
0.2390E+03
0.1023E+08
Pu-239    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 054:
Pu-238
  8
0.2768863824E+10
0.2380E+03
0.4494E+04
U-234     0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 055:
Pu-239
  8
0.7594336440E+12
0.2390E+03
0.3578E+03
U-235     0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 056:
Pu-240
  8
0.2062920312E+12
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
0.2400E+03
0.5406E+03
U-236 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 057:
Pu-241
8
0.4544294400E+09
0.2410E+03
0.1522E+06
U-237 0.2450E-04
Am-241 0.1000E+01
none 0.0000E+00
Nuclide 058:
Am-241
9
0.1363919472E+11
0.2410E+03
0.1897E+03
Np-237 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 059:
Cm-242
9
0.1406592000E+08
0.2420E+03
0.5649E+05
Pu-238 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 060:
Cm-244
9
0.5715081360E+09
0.2440E+03
0.1339E+05
Pu-240 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 061:
I-130
2
0.4449600000E+05
0.1300E+03
0.2546E+04
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 062:
Kr-83m
1
0.6588000000E+04
0.8300E+02
0.3727E+00
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 063:
Xe-138
1
0.8502000000E+03
0.1380E+03
0.0000E+00
Cs-138 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 064:
Xe-131m
1
0.1028160000E+07
0.1310E+03
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
0.8276E+04
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 065:
Xe-133m
  1
    0.1890432000E+06
    0.1330E+03
    0.3403E+05
Xe-133    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 066:
Xe-135m
  1
    0.9174000000E+03
    0.1350E+03
    0.1434E+04
Xe-135    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 067:
Cs-138
  3
    0.1932000000E+04
    0.1380E+03
    0.0000E+00
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 068:
Cs-134m
  3
    0.1044000000E+05
    0.1340E+03
    0.5122E+00
Cs-134    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 069:
Rb-88
  3
    0.1068000000E+04
    0.8800E+02
    0.4804E+01
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 070:
Rb-89
  3
    0.9120000000E+03
    0.8900E+02
    0.0000E+00
Sr-89     0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 071:
Sb-124
  4
    0.5201280000E+07
    0.1240E+03
    0.1663E+04
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 072:
Sb-125
  4
    0.8741455200E+08
    0.1250E+03
    0.1566E+05
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
Te-125m  0.2280E+00
none     0.0000E+00
none     0.0000E+00
Nuclide 073:
Sb-126
  4
  0.1071360000E+07
  0.1260E+03
  0.9900E+03
none     0.0000E+00
none     0.0000E+00
none     0.0000E+00
Nuclide 074:
Te-131
  4
  0.1500000000E+04
  0.1310E+03
  0.8307E+04
I-131    0.1000E+01
none     0.0000E+00
none     0.0000E+00
Nuclide 075:
Te-133
  4
  0.7470000000E+03
  0.1330E+03
  0.2034E-10
I-133    0.1000E+01
none     0.0000E+00
none     0.0000E+00
Nuclide 076:
Te-134
  4
  0.2508000000E+04
  0.1340E+03
  0.2217E-14
I-134    0.1000E+01
none     0.0000E+00
none     0.0000E+00
Nuclide 077:
Te-125m
  4
  0.5011200000E+07
  0.1250E+03
  0.3417E+04
none     0.0000E+00
none     0.0000E+00
none     0.0000E+00
Nuclide 078:
Te-133m
  4
  0.3324000000E+04
  0.1330E+03
  0.1213E-09
I-133    0.8700E+00
Te-133   0.1300E+00
none     0.0000E+00
Nuclide 079:
Ba-141
  6
  0.1096200000E+04
  0.1410E+03
  0.0000E+00
La-141   0.1000E+01
none     0.0000E+00
none     0.0000E+00
Nuclide 080:
Ba-137m
  6
  0.1531200000E+03
  0.1370E+03
  0.1041E+06
none     0.0000E+00
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
none      0.0000E+00
none      0.0000E+00
Nuclide 081:
Pd-109
  7
  0.4833720000E+05
  0.1090E+03
  0.2825E+05
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 082:
Rh-106
  7
  0.2990000000E+02
  0.1060E+03
  0.5771E+06
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 083:
Rh-103m
  7
  0.3367200000E+04
  0.1030E+03
  0.1097E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 084:
Tc-101
  7
  0.8520000000E+03
  0.1010E+03
  0.0000E+00
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 085:
Eu-154
  9
  0.2777068800E+09
  0.1540E+03
  0.1246E+05
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 086:
Eu-155
  9
  0.1565256960E+09
  0.1550E+03
  0.8442E+04
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 087:
Eu-156
  9
  0.1312416000E+07
  0.1560E+03
  0.1935E+06
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 088:
La-143
  9
  0.8538000000E+03
  0.1430E+03
  0.0000E+00
Ce-143   0.1000E+01
none      0.0000E+00
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
none      0.0000E+00
Nuclide 089:
Nb-97
  9
  0.4326000000E+04
  0.9700E+02
  0.1692E+06
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 090:
Nb-95m
  9
  0.3117600000E+06
  0.9500E+02
  0.8748E+04
Nb-95     0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 091:
Pm-147
  9
  0.8278820780E+08
  0.1470E+03
  0.1296E+06
Sm-147    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 092:
Pm-148
  9
  0.4639680000E+06
  0.1480E+03
  0.1659E+06
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 093:
Pm-149
  9
  0.1910880000E+06
  0.1490E+03
  0.2481E+06
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 094:
Pm-151
  9
  0.1022400000E+06
  0.1510E+03
  0.5012E+05
Sm-151    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 095:
Pm-148m
  9
  0.3568320000E+07
  0.1480E+03
  0.2899E+05
Pm-148    0.4600E-01
none      0.0000E+00
none      0.0000E+00
Nuclide 096:
Pr-144
  9
  0.1036800000E+04
  0.1440E+03
  0.1015E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
Nuclide 097:
Pr-144m
  9
  0.4320000000E+03
  0.1440E+03
  0.1217E+05
Pr-144  0.9990E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 098:
Sm-153
  9
  0.1681200000E+06
  0.1530E+03
  0.2171E+06
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 099:
Y-94
  9
  0.1146000000E+04
  0.9400E+02
  0.0000E+00
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 100:
Y-95
  9
  0.6420000000E+03
  0.9500E+02
  0.0000E+00
Zr-95  0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 101:
Y-91m
  9
  0.2982600000E+04
  0.9100E+02
  0.1702E+05
Y-91   0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 102:
Br-82
  2
  0.1270800000E+06
  0.8200E+02
  0.2060E+04
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 103:
Br-83
  2
  0.8604000000E+04
  0.8300E+02
  0.8833E-01
Kr-83m 0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 104:
Br-84
  2
  0.1908000000E+04
  0.8400E+02
  0.0000E+00
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 105:
```

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

```
Am-242
  9
  0.5767200000E+05
  0.2420E+03
  0.1138E+05
Cm-242  0.8270E+00
Pu-242  0.1730E+00
none    0.0000E+00
Nuclide 106:
Np-238
  8
  0.1829088000E+06
  0.2380E+03
  0.2238E+06
Pu-238  0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 107:
Pu-243
  8
  0.1784160000E+05
  0.2430E+03
  0.5681E+03
Am-243  0.1000E+01
none    0.0000E+00
none    0.0000E+00
End of Nuclear Inventory File
```


Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Attachment 7 RADTRAD-NAI Dose Conversion Factor File

NAI-1101-001rev0.DCF

Includes 107 isotopes

9 ORGANS DEFINED IN THIS FILE:

GONADS
BREAST
LUNGS
RED MARR
BONE SUR
THYROID
REMAINDER
EFFECTIVE
SKIN(FGR)

107 NUCLIDES DEFINED IN THIS FILE:

Co-58	Y
Co-60	Y
Kr-85	
Kr-85m	
Kr-87	
Kr-88	
Rb-86	D
Sr-89	Y
Sr-90	Y
Sr-91	Y
Sr-92	Y
Y-90	Y
Y-91	Y
Y-92	Y
Y-93	Y
Zr-95	D
Zr-97	Y
Nb-95	Y
Mo-99	Y
Tc-99m	D
Ru-103	Y
Ru-105	Y
Ru-106	Y
Rh-105	Y
Sb-127	W
Sb-129	W
Te-127	W
Te-127m	W
Te-129	D
Te-129m	W
Te-131m	W
Te-132	W
I-131	D
I-132	D
I-133	D
I-134	D
I-135	D
Xe-133	
Xe-135	
Cs-134	D
Cs-136	D
Cs-137	D
Ba-139	D
Ba-140	D
La-140	W
La-141	D
La-142	D
Ce-141	Y
Ce-143	Y
Ce-144	Y
Pr-143	Y
Nd-147	Y
Np-239	W
Pu-238	W
Pu-239	W
Pu-240	W
Pu-241	W
Am-241	W

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

Cm-242 W
 Cm-244 W
 I-130 D
 Kr-83m
 Xe-138
 Xe-131m
 Xe-133m
 Xe-135m
 Cs-138 D
 Cs-134m D
 Rb-88 D
 Rb-89 D
 Sb-124 W
 Sb-125 W
 Sb-126 W
 Te-131 D
 Te-133 D
 Te-134 D
 Te-125m W
 Te-133m D
 Ba-141 D
 Ba-137m
 Pd-109 Y
 Rh-106
 Rh-103m D
 Tc-101 D
 Eu-154 W
 Eu-155 W
 Eu-156 W
 La-143 W
 Nb-97 Y
 Nb-95m Y
 Pm-147 Y
 Pm-148 Y
 Pm-149 Y
 Pm-151 Y
 Pm-148m Y
 Pr-144 Y
 Pr-144m
 Sm-153 W
 Y-94 Y
 Y-95 Y
 Y-91m Y
 Br-82 W
 Br-83 W
 Br-84 D
 Am-242 W
 Np-238 W
 Pu-243 Y

CLOUDSHINE GROUND GROUND GROUND INHALED INHALED INGESTION
 SHINE 8HR SHINE 7DAY SHINE RATE ACUTE CHRONIC

Co-58							
GONADS	4.660E-14	2.867E-11	5.828E-10	9.970E-16-1.000E+00	6.170E-10	1.040E-09	
BREAST	5.300E-14	2.737E-11	5.565E-10	9.520E-16-1.000E+00	9.370E-10	1.790E-10	
LUNGS	4.640E-14	2.617E-11	5.319E-10	9.100E-16-1.000E+00	1.600E-08	8.530E-11	
RED MARR	4.530E-14	2.671E-11	5.430E-10	9.290E-16-1.000E+00	9.230E-10	2.600E-10	
BONE SUR	7.410E-14	3.795E-11	7.716E-10	1.320E-15-1.000E+00	6.930E-10	1.250E-10	
THYROID	4.770E-14	2.720E-11	5.530E-10	9.460E-16-1.000E+00	8.720E-10	6.310E-11	
REMAINDER	4.440E-14	2.585E-11	5.255E-10	8.990E-16-1.000E+00	1.890E-09	1.580E-09	
EFFECTIVE	4.760E-14	2.732E-11	5.553E-10	9.500E-16-1.000E+00	2.940E-09	8.090E-10	
SKIN (FGR)	5.580E-14	3.278E-11	6.664E-10	1.140E-15-1.000E+00	0.000E+00	0.000E+00	
Co-60							
GONADS	1.230E-13	7.056E-11	1.480E-09	2.450E-15-1.000E+00	4.760E-09	3.190E-09	
BREAST	1.390E-13	6.739E-11	1.413E-09	2.340E-15-1.000E+00	1.840E-08	1.100E-09	
LUNGS	1.240E-13	6.537E-11	1.371E-09	2.270E-15-1.000E+00	3.450E-07	8.770E-10	
RED MARR	1.230E-13	6.710E-11	1.407E-09	2.330E-15-1.000E+00	1.720E-08	1.320E-09	
BONE SUR	1.780E-13	8.956E-11	1.879E-09	3.110E-15-1.000E+00	1.350E-08	9.390E-10	
THYROID	1.270E-13	6.480E-11	1.359E-09	2.250E-15-1.000E+00	1.620E-08	7.880E-10	
REMAINDER	1.200E-13	6.508E-11	1.365E-09	2.260E-15-1.000E+00	3.600E-08	4.970E-09	
EFFECTIVE	1.260E-13	6.768E-11	1.419E-09	2.350E-15-1.000E+00	5.910E-08	2.770E-09	
SKIN (FGR)	1.450E-13	7.948E-11	1.667E-09	2.760E-15-1.000E+00	0.000E+00	0.000E+00	
Kr-85							
GONADS	1.170E-16	8.121E-14	1.704E-12	2.820E-18-1.000E+00	0.000E+00	0.000E+00	

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

BREAST	1.340E-16	7.891E-14	1.656E-12	2.740E-18	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.140E-16	7.056E-14	1.481E-12	2.450E-18	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.090E-16	6.998E-14	1.469E-12	2.430E-18	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	2.200E-16	1.287E-13	2.702E-12	4.470E-18	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.180E-16	7.459E-14	1.565E-12	2.590E-18	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	1.090E-16	6.941E-14	1.457E-12	2.410E-18	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.190E-16	7.603E-14	1.596E-12	2.640E-18	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.320E-14	2.304E-11	4.835E-10	8.000E-16	-1.000E+00	0.000E+00	0.000E+00
Kr-85m							
GONADS	7.310E-15	2.594E-12	3.653E-12	1.570E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	8.410E-15	2.527E-12	3.560E-12	1.530E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	7.040E-15	2.379E-12	3.351E-12	1.440E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	6.430E-15	2.346E-12	3.304E-12	1.420E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	1.880E-14	5.286E-12	7.446E-12	3.200E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	7.330E-15	2.395E-12	3.374E-12	1.450E-16	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	6.640E-15	2.313E-12	3.257E-12	1.400E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	7.480E-15	2.511E-12	3.537E-12	1.520E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	2.240E-14	2.247E-11	3.164E-11	1.360E-15	-1.000E+00	0.000E+00	0.000E+00
Kr-87							
GONADS	4.000E-14	4.962E-12	5.026E-12	7.610E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	4.500E-14	4.740E-12	4.802E-12	7.270E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	4.040E-14	4.603E-12	4.663E-12	7.060E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	4.000E-14	4.708E-12	4.769E-12	7.220E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	6.020E-14	6.514E-12	6.598E-12	9.990E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	4.130E-14	4.473E-12	4.531E-12	6.860E-16	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	3.910E-14	4.590E-12	4.650E-12	7.040E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	4.120E-14	4.773E-12	4.835E-12	7.320E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.370E-13	8.802E-11	8.916E-11	1.350E-14	-1.000E+00	0.000E+00	0.000E+00
Kr-88							
GONADS	9.900E-14	2.278E-11	2.655E-11	1.800E-15	-1.000E+00	0.000E+00	0.000E+00
BREAST	1.110E-13	2.177E-11	2.537E-11	1.720E-15	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.010E-13	2.139E-11	2.493E-11	1.690E-15	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.000E-13	2.190E-11	2.552E-11	1.730E-15	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	1.390E-13	2.886E-11	3.363E-11	2.280E-15	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.030E-13	2.012E-11	2.345E-11	1.590E-15	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	9.790E-14	2.139E-11	2.493E-11	1.690E-15	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.020E-13	2.202E-11	2.567E-11	1.740E-15	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.350E-13	5.607E-11	6.534E-11	4.430E-15	-1.000E+00	0.000E+00	0.000E+00
Rb-86							
GONADS	4.710E-15	2.788E-12	5.187E-11	9.740E-17	-1.000E+00	1.340E-09	2.150E-09
BREAST	5.340E-15	2.662E-12	4.953E-11	9.300E-17	-1.000E+00	1.330E-09	2.140E-09
LUNGS	4.710E-15	2.553E-12	4.750E-11	8.920E-17	-1.000E+00	3.300E-09	2.140E-09
RED MARR	4.640E-15	2.619E-12	4.873E-11	9.150E-17	-1.000E+00	2.320E-09	3.720E-09
BONE SUR	7.050E-15	3.635E-12	6.764E-11	1.270E-16	-1.000E+00	4.270E-09	6.860E-09
THYROID	4.840E-15	2.599E-12	4.836E-11	9.080E-17	-1.000E+00	1.330E-09	2.140E-09
REMAINDER	4.520E-15	2.542E-12	4.729E-11	8.880E-17	-1.000E+00	1.380E-09	2.330E-09
EFFECTIVE	4.810E-15	2.665E-12	4.958E-11	9.310E-17	-1.000E+00	1.790E-09	2.530E-09
SKIN (FGR)	4.850E-14	2.210E-10	4.111E-09	7.720E-15	-1.000E+00	0.000E+00	0.000E+00
Sr-89							
GONADS	7.730E-17	7.155E-14	1.436E-12	2.490E-18	-1.000E+00	7.950E-12	8.050E-12
BREAST	9.080E-17	7.212E-14	1.447E-12	2.510E-18	-1.000E+00	7.960E-12	7.980E-12
LUNGS	7.080E-17	5.689E-14	1.142E-12	1.980E-18	-1.000E+00	8.350E-08	7.970E-12
RED MARR	6.390E-17	5.345E-14	1.073E-12	1.860E-18	-1.000E+00	1.070E-10	1.080E-10
BONE SUR	1.940E-16	1.560E-13	3.131E-12	5.430E-18	-1.000E+00	1.590E-10	1.610E-10
THYROID	7.600E-17	6.063E-14	1.217E-12	2.110E-18	-1.000E+00	7.960E-12	7.970E-12
REMAINDER	6.710E-17	5.603E-14	1.124E-12	1.950E-18	-1.000E+00	3.970E-09	8.250E-09
EFFECTIVE	7.730E-17	6.523E-14	1.309E-12	2.270E-18	-1.000E+00	1.120E-08	2.500E-09
SKIN (FGR)	3.690E-14	1.914E-10	3.841E-09	6.660E-15	-1.000E+00	0.000E+00	0.000E+00
Sr-90							
GONADS	7.780E-18	9.590E-15	2.014E-13	3.330E-19	-1.000E+00	2.690E-10	5.040E-11
BREAST	9.490E-18	1.008E-14	2.116E-13	3.500E-19	-1.000E+00	2.690E-10	5.040E-11
LUNGS	6.440E-18	6.307E-15	1.324E-13	2.190E-19	-1.000E+00	2.860E-06	5.040E-11
RED MARR	5.440E-18	5.558E-15	1.167E-13	1.930E-19	-1.000E+00	3.280E-08	6.450E-09
BONE SUR	2.280E-17	2.393E-14	5.025E-13	8.310E-19	-1.000E+00	7.090E-08	1.390E-08
THYROID	7.330E-18	7.171E-15	1.506E-13	2.490E-19	-1.000E+00	2.690E-10	5.040E-11
REMAINDER	6.110E-18	6.422E-15	1.348E-13	2.230E-19	-1.000E+00	5.730E-09	6.700E-09
EFFECTIVE	7.530E-18	8.179E-15	1.717E-13	2.840E-19	-1.000E+00	3.510E-07	3.230E-09
SKIN (FGR)	9.200E-15	4.032E-12	8.465E-11	1.400E-16	-1.000E+00	0.000E+00	0.000E+00
Sr-91							
GONADS	3.380E-14	2.155E-11	5.062E-11	1.026E-15	-1.000E+00	5.650E-11	2.520E-10
BREAST	3.830E-14	2.059E-11	4.838E-11	9.806E-16	-1.000E+00	1.740E-11	3.676E-11
LUNGS	3.370E-14	1.970E-11	4.626E-11	9.376E-16	-1.000E+00	2.130E-09	1.055E-11
RED MARR	3.310E-14	2.011E-11	4.722E-11	9.570E-16	-1.000E+00	2.230E-11	5.659E-11

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

BONE SUR	5.200E-14	2.852E-11	6.709E-11	1.360E-15-1.000E+00	1.270E-11	2.070E-11
THYROID	3.470E-14	2.035E-11	4.782E-11	9.693E-16-1.000E+00	9.640E-12	1.968E-12
REMAINDER	3.240E-14	1.948E-11	4.573E-11	9.268E-16-1.000E+00	5.780E-10	2.557E-09
EFFECTIVE	3.450E-14	2.057E-11	4.832E-11	9.793E-16-1.000E+00	4.490E-10	8.455E-10
SKIN (FGR)	8.140E-14	1.748E-10	3.987E-10	8.080E-15-1.000E+00	0.000E+00	0.000E+00
Sr-92						
GONADS	6.610E-14	1.593E-11	1.830E-11	1.300E-15-1.000E+00	1.020E-11	8.180E-11
BREAST	7.480E-14	1.520E-11	1.745E-11	1.240E-15-1.000E+00	6.490E-12	1.700E-11
LUNGS	6.670E-14	1.483E-11	1.703E-11	1.210E-15-1.000E+00	1.050E-09	7.220E-12
RED MARR	6.620E-14	1.520E-11	1.745E-11	1.240E-15-1.000E+00	6.980E-12	2.290E-11
BONE SUR	9.490E-14	2.010E-11	2.308E-11	1.640E-15-1.000E+00	4.360E-12	8.490E-12
THYROID	6.820E-14	1.446E-11	1.661E-11	1.180E-15-1.000E+00	3.920E-12	1.300E-12
REMAINDER	6.450E-14	1.471E-11	1.689E-11	1.200E-15-1.000E+00	2.900E-10	1.720E-09
EFFECTIVE	6.790E-14	1.532E-11	1.759E-11	1.250E-15-1.000E+00	2.180E-10	5.430E-10
SKIN (FGR)	8.560E-14	2.280E-11	2.618E-11	1.860E-15-1.000E+00	0.000E+00	0.000E+00
Y-90						
GONADS	1.890E-16	1.586E-13	1.601E-12	5.750E-18-1.000E+00	5.170E-13	1.430E-14
BREAST	2.200E-16	1.578E-13	1.593E-12	5.720E-18-1.000E+00	5.170E-13	1.270E-14
LUNGS	1.770E-16	1.313E-13	1.326E-12	4.760E-18-1.000E+00	9.310E-09	1.260E-14
RED MARR	1.620E-16	1.261E-13	1.273E-12	4.570E-18-1.000E+00	1.520E-11	3.700E-13
BONE SUR	4.440E-16	3.228E-13	3.259E-12	1.170E-17-1.000E+00	1.510E-11	3.670E-13
THYROID	1.870E-16	1.385E-13	1.398E-12	5.020E-18-1.000E+00	5.170E-13	1.260E-14
REMAINDER	1.680E-16	1.291E-13	1.303E-12	4.680E-18-1.000E+00	3.870E-09	9.680E-09
EFFECTIVE	1.900E-16	1.468E-13	1.482E-12	5.320E-18-1.000E+00	2.280E-09	2.910E-09
SKIN (FGR)	6.240E-14	2.897E-10	2.924E-09	1.050E-14-1.000E+00	0.000E+00	0.000E+00
Y-91						
GONADS	2.560E-16	1.756E-13	3.546E-12	6.110E-18-1.000E+00	8.200E-12	3.540E-12
BREAST	2.930E-16	1.713E-13	3.459E-12	5.960E-18-1.000E+00	8.920E-12	5.540E-13
LUNGS	2.500E-16	1.526E-13	3.082E-12	5.310E-18-1.000E+00	9.870E-08	2.020E-13
RED MARR	2.410E-16	1.521E-13	3.070E-12	5.290E-18-1.000E+00	3.190E-10	6.590E-12
BONE SUR	4.560E-16	2.903E-13	5.862E-12	1.010E-17-1.000E+00	3.180E-10	6.130E-12
THYROID	2.600E-16	1.564E-13	3.157E-12	5.440E-18-1.000E+00	8.500E-12	1.290E-13
REMAINDER	2.390E-16	1.509E-13	3.047E-12	5.250E-18-1.000E+00	4.200E-09	8.570E-09
EFFECTIVE	2.600E-16	1.650E-13	3.332E-12	5.740E-18-1.000E+00	1.320E-08	2.570E-09
SKIN (FGR)	3.850E-14	1.989E-10	4.016E-09	6.920E-15-1.000E+00	0.000E+00	0.000E+00
Y-92						
GONADS	1.270E-14	3.855E-12	4.872E-12	2.650E-16-1.000E+00	2.610E-12	1.960E-11
BREAST	1.440E-14	3.680E-12	4.652E-12	2.530E-16-1.000E+00	1.500E-12	3.550E-12
LUNGS	1.270E-14	3.535E-12	4.468E-12	2.430E-16-1.000E+00	1.240E-09	1.390E-12
RED MARR	1.250E-14	3.608E-12	4.560E-12	2.480E-16-1.000E+00	2.070E-12	4.910E-12
BONE SUR	1.950E-14	5.091E-12	6.435E-12	3.500E-16-1.000E+00	1.510E-12	1.750E-12
THYROID	1.300E-14	3.579E-12	4.523E-12	2.460E-16-1.000E+00	1.050E-12	1.770E-13
REMAINDER	1.220E-14	3.506E-12	4.431E-12	2.410E-16-1.000E+00	2.030E-10	1.700E-09
EFFECTIVE	1.300E-14	3.680E-12	4.652E-12	2.530E-16-1.000E+00	2.110E-10	5.150E-10
SKIN (FGR)	1.140E-13	2.022E-10	2.556E-10	1.390E-14-1.000E+00	0.000E+00	0.000E+00
Y-93						
GONADS	4.670E-15	2.108E-12	4.989E-12	9.510E-17-1.000E+00	5.310E-12	2.200E-11
BREAST	5.300E-15	2.026E-12	4.794E-12	9.140E-17-1.000E+00	1.740E-12	3.130E-12
LUNGS	4.680E-15	1.937E-12	4.585E-12	8.740E-17-1.000E+00	2.520E-09	8.670E-13
RED MARR	4.580E-15	1.972E-12	4.669E-12	8.900E-17-1.000E+00	4.040E-12	4.930E-12
BONE SUR	7.580E-15	2.948E-12	6.977E-12	1.330E-16-1.000E+00	3.140E-12	1.730E-12
THYROID	4.790E-15	1.908E-12	4.516E-12	8.610E-17-1.000E+00	9.260E-13	1.260E-13
REMAINDER	4.510E-15	1.919E-12	4.543E-12	8.660E-17-1.000E+00	9.250E-10	4.090E-09
EFFECTIVE	4.800E-15	2.021E-12	4.784E-12	9.120E-17-1.000E+00	5.820E-10	1.230E-09
SKIN (FGR)	8.500E-14	2.726E-10	6.452E-10	1.230E-14-1.000E+00	0.000E+00	0.000E+00
Zr-95						
GONADS	3.530E-14	2.182E-11	4.421E-10	7.590E-16-1.000E+00	1.880E-09	8.160E-10
BREAST	4.010E-14	2.084E-11	4.223E-10	7.250E-16-1.000E+00	1.910E-09	1.050E-10
LUNGS	3.510E-14	1.989E-11	4.030E-10	6.920E-16-1.000E+00	2.170E-09	2.340E-11
RED MARR	3.430E-14	2.030E-11	4.112E-10	7.060E-16-1.000E+00	1.300E-08	2.140E-10
BONE SUR	5.620E-14	2.875E-11	5.824E-10	1.000E-15-1.000E+00	1.030E-07	4.860E-10
THYROID	3.610E-14	2.076E-11	4.205E-10	7.220E-16-1.000E+00	1.440E-09	8.270E-12
REMAINDER	3.360E-14	1.963E-11	3.978E-10	6.830E-16-1.000E+00	2.280E-09	2.530E-09
EFFECTIVE	3.600E-14	2.078E-11	4.211E-10	7.230E-16-1.000E+00	6.390E-09	1.020E-09
SKIN (FGR)	4.500E-14	2.561E-11	5.190E-10	8.910E-16-1.000E+00	0.000E+00	0.000E+00
Zr-97						
GONADS	8.800E-15	2.179E-11	7.799E-11	9.253E-16-1.000E+00	1.840E-10	6.228E-10
BREAST	9.990E-15	2.083E-11	7.455E-11	8.846E-16-1.000E+00	4.700E-11	8.137E-11
LUNGS	8.810E-15	1.992E-11	7.127E-11	8.456E-16-1.000E+00	4.100E-09	1.770E-11
RED MARR	8.640E-15	2.034E-11	7.279E-11	8.634E-16-1.000E+00	6.370E-11	1.302E-10
BONE SUR	1.380E-14	2.881E-11	1.031E-10	1.224E-15-1.000E+00	3.500E-11	4.558E-11
THYROID	9.030E-15	2.061E-11	7.377E-11	8.755E-16-1.000E+00	2.310E-11	2.671E-12
REMAINDER	8.480E-15	1.966E-11	7.035E-11	8.345E-16-1.000E+00	2.040E-09	6.990E-09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

EFFECTIVE	9.020E-15	2.078E-11	7.438E-11	8.824E-16	-1.000E+00	1.170E-09	2.283E-09
SKIN (FGR)	5.550E-14	2.281E-10	8.148E-10	9.587E-15	-1.000E+00	0.000E+00	0.000E+00
Nb-95							
GONADS	3.660E-14	2.253E-11	4.435E-10	7.850E-16	-1.000E+00	4.320E-10	8.050E-10
BREAST	4.160E-14	2.150E-11	4.231E-10	7.490E-16	-1.000E+00	4.070E-10	1.070E-10
LUNGS	3.650E-14	2.055E-11	4.045E-10	7.160E-16	-1.000E+00	8.320E-09	2.740E-11
RED MARR	3.560E-14	2.101E-11	4.135E-10	7.320E-16	-1.000E+00	4.420E-10	1.990E-10
BONE SUR	5.790E-14	2.957E-11	5.819E-10	1.030E-15	-1.000E+00	5.130E-10	2.940E-10
THYROID	3.750E-14	2.144E-11	4.220E-10	7.470E-16	-1.000E+00	3.580E-10	1.180E-11
REMAINDER	3.490E-14	2.032E-11	4.000E-10	7.080E-16	-1.000E+00	1.070E-09	1.470E-09
EFFECTIVE	3.740E-14	2.147E-11	4.226E-10	7.480E-16	-1.000E+00	1.570E-09	6.950E-10
SKIN (FGR)	4.300E-14	2.598E-11	5.112E-10	9.050E-16	-1.000E+00	0.000E+00	0.000E+00
Mo-99							
GONADS	7.130E-15	4.282E-12	4.403E-11	1.550E-16	-1.000E+00	9.510E-11	2.180E-10
BREAST	8.130E-15	4.116E-12	4.233E-11	1.490E-16	-1.000E+00	2.750E-11	3.430E-11
LUNGS	7.060E-15	3.867E-12	3.977E-11	1.400E-16	-1.000E+00	4.290E-09	1.510E-11
RED MARR	6.820E-15	3.923E-12	4.034E-11	1.420E-16	-1.000E+00	5.240E-11	8.320E-11
BONE SUR	1.240E-14	6.105E-12	6.278E-11	2.210E-16	-1.000E+00	4.130E-11	6.320E-11
THYROID	7.270E-15	4.033E-12	4.147E-11	1.460E-16	-1.000E+00	1.520E-11	1.030E-11
REMAINDER	6.740E-15	3.812E-12	3.920E-11	1.380E-16	-1.000E+00	1.740E-09	4.280E-09
EFFECTIVE	7.280E-15	4.061E-12	4.176E-11	1.470E-16	-1.000E+00	1.070E-09	1.360E-09
SKIN (FGR)	3.140E-14	1.039E-10	1.068E-09	3.760E-15	-1.000E+00	0.000E+00	0.000E+00
Tc-99m							
GONADS	5.750E-15	2.334E-12	3.877E-12	1.240E-16	-1.000E+00	2.770E-12	9.750E-12
BREAST	6.650E-15	2.258E-12	3.752E-12	1.200E-16	-1.000E+00	2.150E-12	3.570E-12
LUNGS	5.490E-15	2.127E-12	3.533E-12	1.130E-16	-1.000E+00	2.280E-11	3.140E-12
RED MARR	4.910E-15	2.070E-12	3.439E-12	1.100E-16	-1.000E+00	3.360E-12	6.290E-12
BONE SUR	1.630E-14	5.383E-12	8.942E-12	2.860E-16	-1.000E+00	2.620E-12	4.060E-12
THYROID	5.750E-15	2.145E-12	3.564E-12	1.140E-16	-1.000E+00	5.010E-11	8.460E-11
REMAINDER	5.150E-15	2.070E-12	3.439E-12	1.100E-16	-1.000E+00	1.020E-11	3.340E-11
EFFECTIVE	5.890E-15	2.277E-12	3.783E-12	1.210E-16	-1.000E+00	8.800E-12	1.680E-11
SKIN (FGR)	7.140E-15	2.710E-12	4.502E-12	1.440E-16	-1.000E+00	0.000E+00	0.000E+00
Ru-103							
GONADS	2.190E-14	1.404E-11	2.783E-10	4.892E-16	-1.000E+00	3.070E-10	5.720E-10
BREAST	2.510E-14	1.350E-11	2.677E-10	4.705E-16	-1.000E+00	3.110E-10	1.200E-10
LUNGS	2.180E-14	1.273E-11	2.522E-10	4.432E-16	-1.000E+00	1.560E-08	7.310E-11
RED MARR	2.100E-14	1.287E-11	2.551E-10	4.483E-16	-1.000E+00	3.190E-10	1.660E-10
BONE SUR	3.890E-14	1.958E-11	3.882E-10	6.823E-16	-1.000E+00	2.370E-10	9.631E-11
THYROID	2.240E-14	1.331E-11	2.639E-10	4.638E-16	-1.000E+00	2.570E-10	6.250E-11
REMAINDER	2.080E-14	1.248E-11	2.472E-10	4.346E-16	-1.000E+00	1.250E-09	2.110E-09
EFFECTIVE	2.250E-14	1.332E-11	2.641E-10	4.642E-16	-1.000E+00	2.420E-09	8.271E-10
SKIN (FGR)	2.770E-14	1.785E-11	3.543E-10	6.229E-16	-1.000E+00	0.000E+00	0.000E+00
Ru-105							
GONADS	3.720E-14	1.327E-11	1.861E-11	8.070E-16	-1.000E+00	1.590E-11	9.670E-11
BREAST	4.240E-14	1.271E-11	1.783E-11	7.730E-16	-1.000E+00	6.610E-12	1.590E-11
LUNGS	3.700E-14	1.210E-11	1.697E-11	7.360E-16	-1.000E+00	5.730E-10	6.210E-12
RED MARR	3.590E-14	1.230E-11	1.725E-11	7.480E-16	-1.000E+00	7.700E-12	2.350E-11
BONE SUR	6.280E-14	1.809E-11	2.537E-11	1.100E-15	-1.000E+00	4.620E-12	8.890E-12
THYROID	3.800E-14	1.260E-11	1.766E-11	7.660E-16	-1.000E+00	4.150E-12	1.820E-12
REMAINDER	3.540E-14	1.189E-11	1.667E-11	7.230E-16	-1.000E+00	1.610E-10	8.540E-10
EFFECTIVE	3.810E-14	1.265E-11	1.773E-11	7.690E-16	-1.000E+00	1.230E-10	2.870E-10
SKIN (FGR)	6.730E-14	7.368E-11	1.033E-10	4.480E-15	-1.000E+00	0.000E+00	0.000E+00
Ru-106							
GONADS	0.000E+00	6.411E-12	1.340E-10	2.230E-16	-1.000E+00	1.300E-09	1.640E-09
BREAST	0.000E+00	6.152E-12	1.286E-10	2.140E-16	-1.000E+00	1.780E-09	1.440E-09
LUNGS	0.000E+00	5.836E-12	1.220E-10	2.030E-16	-1.000E+00	1.040E-06	1.420E-09
RED MARR	0.000E+00	5.893E-12	1.232E-10	2.050E-16	-1.000E+00	1.760E-09	1.460E-09
BONE SUR	0.000E+00	8.883E-12	1.856E-10	3.090E-16	-1.000E+00	1.610E-09	1.430E-09
THYROID	0.000E+00	6.066E-12	1.268E-10	2.110E-16	-1.000E+00	1.720E-09	1.410E-09
REMAINDER	0.000E+00	5.721E-12	1.196E-10	1.990E-16	-1.000E+00	1.200E-08	2.110E-08
EFFECTIVE	0.000E+00	6.095E-12	1.274E-10	2.120E-16	-1.000E+00	1.290E-07	7.400E-09
SKIN (FGR)	0.000E+00	4.082E-10	8.531E-09	1.420E-14	-1.000E+00	0.000E+00	0.000E+00
Rh-105							
GONADS	3.640E-15	2.127E-12	1.411E-11	7.980E-17	-1.000E+00	2.110E-11	5.800E-11
BREAST	4.160E-15	2.063E-12	1.369E-11	7.740E-17	-1.000E+00	5.610E-12	8.970E-12
LUNGS	3.570E-15	1.935E-12	1.284E-11	7.260E-17	-1.000E+00	9.580E-10	3.860E-12
RED MARR	3.380E-15	1.946E-12	1.291E-11	7.300E-17	-1.000E+00	7.770E-12	1.470E-11
BONE SUR	7.530E-15	3.332E-12	2.210E-11	1.250E-16	-1.000E+00	4.460E-12	6.750E-12
THYROID	3.680E-15	1.983E-12	1.316E-11	7.440E-17	-1.000E+00	2.880E-12	2.910E-12
REMAINDER	3.390E-15	1.885E-12	1.250E-11	7.070E-17	-1.000E+00	4.530E-10	1.270E-09
EFFECTIVE	3.720E-15	2.031E-12	1.347E-11	7.620E-17	-1.000E+00	2.580E-10	3.990E-10
SKIN (FGR)	1.070E-14	4.691E-12	3.112E-11	1.760E-16	-1.000E+00	0.000E+00	0.000E+00
Sb-127							

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

GONADS	3.260E-14	1.985E-11	2.441E-10	7.100E-16	-1.000E+00	2.520E-10	6.140E-10
BREAST	3.720E-14	1.904E-11	2.341E-10	6.810E-16	-1.000E+00	9.120E-11	7.600E-11
LUNGS	3.240E-14	1.809E-11	2.224E-10	6.470E-16	-1.000E+00	6.940E-09	1.570E-11
RED MARR	3.140E-14	1.834E-11	2.255E-10	6.560E-16	-1.000E+00	1.610E-10	1.330E-10
BONE SUR	5.520E-14	2.720E-11	3.345E-10	9.730E-16	-1.000E+00	1.340E-10	5.240E-11
THYROID	3.330E-14	1.884E-11	2.317E-10	6.740E-16	-1.000E+00	6.150E-11	4.640E-12
REMAINDER	3.090E-14	1.775E-11	2.183E-10	6.350E-16	-1.000E+00	2.330E-09	5.870E-09
EFFECTIVE	3.330E-14	1.890E-11	2.324E-10	6.760E-16	-1.000E+00	1.630E-09	1.950E-09
SKIN (FGR)	5.580E-14	7.967E-11	9.799E-10	2.850E-15	-1.000E+00	0.000E+00	0.000E+00
Sb-129							
GONADS	6.970E-14	2.336E-11	3.231E-11	1.440E-15	-1.000E+00	2.150E-11	1.510E-10
BREAST	7.910E-14	2.222E-11	3.074E-11	1.370E-15	-1.000E+00	1.280E-11	2.560E-11
LUNGS	6.980E-14	2.141E-11	2.962E-11	1.320E-15	-1.000E+00	8.980E-10	9.390E-12
RED MARR	6.860E-14	2.190E-11	3.029E-11	1.350E-15	-1.000E+00	1.700E-11	3.670E-11
BONE SUR	1.070E-13	3.033E-11	4.196E-11	1.870E-15	-1.000E+00	1.460E-11	1.340E-11
THYROID	7.160E-14	2.174E-11	3.007E-11	1.340E-15	-1.000E+00	9.720E-12	1.470E-12
REMAINDER	6.710E-14	2.125E-11	2.939E-11	1.310E-15	-1.000E+00	1.870E-10	1.450E-09
EFFECTIVE	7.140E-14	2.238E-11	3.096E-11	1.380E-15	-1.000E+00	1.740E-10	4.840E-10
SKIN (FGR)	1.050E-13	8.273E-11	1.144E-10	5.100E-15	-1.000E+00	0.000E+00	0.000E+00
Te-127							
GONADS	2.370E-16	1.191E-13	2.661E-13	5.480E-18	-1.000E+00	2.020E-12	4.020E-12
BREAST	2.730E-16	1.158E-13	2.588E-13	5.330E-18	-1.000E+00	1.880E-12	3.000E-12
LUNGS	2.320E-16	1.060E-13	2.370E-13	4.880E-18	-1.000E+00	4.270E-10	2.890E-12
RED MARR	2.210E-16	1.058E-13	2.365E-13	4.870E-18	-1.000E+00	4.090E-12	6.570E-12
BONE SUR	4.650E-16	1.862E-13	4.162E-13	8.570E-18	-1.000E+00	4.090E-12	6.460E-12
THYROID	2.400E-16	1.106E-13	2.472E-13	5.090E-18	-1.000E+00	1.840E-12	2.860E-12
REMAINDER	2.210E-16	1.036E-13	2.316E-13	4.770E-18	-1.000E+00	1.110E-10	6.130E-10
EFFECTIVE	2.420E-16	1.125E-13	2.515E-13	5.180E-18	-1.000E+00	8.600E-11	1.870E-10
SKIN (FGR)	1.140E-14	1.173E-11	2.622E-11	5.400E-16	-1.000E+00	0.000E+00	0.000E+00
Te-127m							
GONADS	1.900E-16	4.689E-13	9.642E-12	1.630E-17	-1.000E+00	1.100E-10	1.250E-10
BREAST	2.690E-16	5.150E-13	1.059E-11	1.790E-17	-1.000E+00	1.100E-10	9.740E-11
LUNGS	7.620E-17	1.602E-13	3.295E-12	5.570E-18	-1.000E+00	3.340E-08	9.620E-11
RED MARR	6.430E-17	1.249E-13	2.567E-12	4.340E-18	-1.000E+00	5.360E-09	5.430E-09
BONE SUR	3.940E-16	9.005E-13	1.852E-11	3.130E-17	-1.000E+00	2.040E-08	2.070E-08
THYROID	1.500E-16	2.779E-13	5.714E-12	9.660E-18	-1.000E+00	9.660E-11	9.430E-11
REMAINDER	8.640E-17	1.999E-13	4.111E-12	6.950E-18	-1.000E+00	1.660E-09	2.980E-09
EFFECTIVE	1.470E-16	3.251E-13	6.684E-12	1.130E-17	-1.000E+00	5.810E-09	2.230E-09
SKIN (FGR)	8.490E-16	1.496E-12	3.076E-11	5.200E-17	-1.000E+00	0.000E+00	0.000E+00
Te-129							
GONADS	2.710E-15	3.889E-13	3.922E-13	6.510E-17	-1.000E+00	1.750E-12	1.590E-12
BREAST	3.120E-15	3.800E-13	3.832E-13	6.360E-17	-1.000E+00	1.680E-12	6.050E-13
LUNGS	2.640E-15	3.298E-13	3.326E-13	5.520E-17	-1.000E+00	1.330E-10	4.910E-13
RED MARR	2.540E-15	3.298E-13	3.326E-13	5.520E-17	-1.000E+00	1.970E-12	7.640E-13
BONE SUR	4.880E-15	5.753E-13	5.802E-13	9.630E-17	-1.000E+00	2.030E-12	5.400E-13
THYROID	2.740E-15	3.525E-13	3.555E-13	5.900E-17	-1.000E+00	1.630E-12	3.360E-13
REMAINDER	2.520E-15	3.262E-13	3.289E-13	5.460E-17	-1.000E+00	2.400E-11	1.790E-10
EFFECTIVE	2.750E-15	3.590E-13	3.621E-13	6.010E-17	-1.000E+00	2.420E-11	5.450E-11
SKIN (FGR)	3.570E-14	3.429E-11	3.458E-11	5.740E-15	-1.000E+00	0.000E+00	0.000E+00
Te-129m							
GONADS	1.560E-15	2.206E-12	4.799E-11	8.561E-17	-1.000E+00	1.780E-10	2.420E-10
BREAST	1.810E-15	2.181E-12	4.739E-11	8.454E-17	-1.000E+00	1.690E-10	1.664E-10
LUNGS	1.460E-15	1.741E-12	3.815E-11	6.808E-17	-1.000E+00	4.030E-08	1.593E-10
RED MARR	1.420E-15	1.729E-12	3.793E-11	6.768E-17	-1.000E+00	3.100E-09	3.500E-09
BONE SUR	2.600E-15	3.287E-12	7.147E-11	1.275E-16	-1.000E+00	7.050E-09	7.990E-09
THYROID	1.560E-15	1.923E-12	4.201E-11	7.495E-17	-1.000E+00	1.560E-10	1.572E-10
REMAINDER	1.410E-15	1.746E-12	3.822E-11	6.819E-17	-1.000E+00	3.270E-09	7.196E-09
EFFECTIVE	1.550E-15	1.974E-12	4.308E-11	7.686E-17	-1.000E+00	6.470E-09	2.925E-09
SKIN (FGR)	1.490E-14	1.501E-10	3.360E-09	6.001E-15	-1.000E+00	0.000E+00	0.000E+00
Te-131m							
GONADS	6.850E-14	4.020E-11	2.343E-10	1.535E-15	-1.000E+00	2.340E-10	7.415E-10
BREAST	7.780E-14	3.853E-11	2.246E-10	1.472E-15	-1.000E+00	9.250E-11	1.361E-10
LUNGS	6.830E-14	3.657E-11	2.131E-10	1.397E-15	-1.000E+00	2.230E-09	6.335E-11
RED MARR	6.680E-14	3.736E-11	2.178E-10	1.427E-15	-1.000E+00	1.410E-10	2.435E-10
BONE SUR	1.090E-13	5.467E-11	3.189E-10	2.090E-15	-1.000E+00	2.270E-10	3.248E-10
THYROID	7.020E-14	3.741E-11	2.181E-10	1.429E-15	-1.000E+00	3.610E-08	4.383E-08
REMAINDER	6.550E-14	3.626E-11	2.113E-10	1.385E-15	-1.000E+00	9.460E-10	3.153E-09
EFFECTIVE	7.010E-14	3.825E-11	2.229E-10	1.461E-15	-1.000E+00	1.730E-09	2.514E-09
SKIN (FGR)	8.850E-14	1.033E-10	6.188E-10	4.056E-15	-1.000E+00	0.000E+00	0.000E+00
Te-132							
GONADS	1.020E-14	6.812E-12	7.706E-11	2.450E-16	-1.000E+00	4.150E-10	5.410E-10
BREAST	1.180E-14	6.756E-12	7.643E-11	2.430E-16	-1.000E+00	3.630E-10	3.500E-10
LUNGS	9.650E-15	5.727E-12	6.479E-11	2.060E-16	-1.000E+00	1.670E-09	3.300E-10

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

RED MARR	8.950E-15	5.588E-12	6.322E-11	2.010E-16	-1.000E+00	4.270E-10	4.440E-10
BONE SUR	2.420E-14	1.273E-11	1.441E-10	4.580E-16	-1.000E+00	7.120E-10	8.300E-10
THYROID	1.020E-14	5.978E-12	6.762E-11	2.150E-16	-1.000E+00	6.280E-08	5.950E-08
REMAINDER	9.160E-15	5.644E-12	6.385E-11	2.030E-16	-1.000E+00	7.890E-10	1.490E-09
EFFECTIVE	1.030E-14	6.339E-12	7.171E-11	2.280E-16	-1.000E+00	2.550E-09	2.540E-09
SKIN (FGR)	1.390E-14	8.313E-12	9.405E-11	2.990E-16	-1.000E+00	0.000E+00	0.000E+00
I-131							
GONADS	1.780E-14	1.119E-11	1.789E-10	3.940E-16	-1.000E+00	2.530E-11	4.070E-11
BREAST	2.040E-14	1.082E-11	1.730E-10	3.810E-16	-1.000E+00	7.880E-11	1.210E-10
LUNGS	1.760E-14	1.016E-11	1.626E-10	3.580E-16	-1.000E+00	6.570E-10	1.020E-10
RED MARR	1.680E-14	1.022E-11	1.635E-10	3.600E-16	-1.000E+00	6.260E-11	9.440E-11
BONE SUR	3.450E-14	1.675E-11	2.679E-10	5.900E-16	-1.000E+00	5.730E-11	8.720E-11
THYROID	1.810E-14	1.053E-11	1.685E-10	3.710E-16	-1.000E+00	2.920E-07	4.760E-07
REMAINDER	1.670E-14	9.908E-12	1.585E-10	3.490E-16	-1.000E+00	8.030E-11	1.570E-10
EFFECTIVE	1.820E-14	1.067E-11	1.707E-10	3.760E-16	-1.000E+00	8.890E-09	1.440E-08
SKIN (FGR)	2.980E-14	1.825E-11	2.920E-10	6.430E-16	-1.000E+00	0.000E+00	0.000E+00
I-132							
GONADS	1.090E-13	2.523E-11	2.771E-11	2.320E-15	-1.000E+00	9.950E-12	2.330E-11
BREAST	1.240E-13	2.414E-11	2.652E-11	2.220E-15	-1.000E+00	1.410E-11	2.520E-11
LUNGS	1.090E-13	2.305E-11	2.532E-11	2.120E-15	-1.000E+00	2.710E-10	2.640E-11
RED MARR	1.070E-13	2.360E-11	2.592E-11	2.170E-15	-1.000E+00	1.400E-11	2.460E-11
BONE SUR	1.730E-13	3.327E-11	3.655E-11	3.060E-15	-1.000E+00	1.240E-11	2.190E-11
THYROID	1.120E-13	2.381E-11	2.616E-11	2.190E-15	-1.000E+00	1.740E-09	3.870E-09
REMAINDER	1.050E-13	2.283E-11	2.509E-11	2.100E-15	-1.000E+00	3.780E-11	1.650E-10
EFFECTIVE	1.120E-13	2.403E-11	2.640E-11	2.210E-15	-1.000E+00	1.030E-10	1.820E-10
SKIN (FGR)	1.580E-13	8.199E-11	9.007E-11	7.540E-15	-1.000E+00	0.000E+00	0.000E+00
I-133							
GONADS	2.870E-14	1.585E-11	6.748E-11	6.270E-16	-1.000E+00	1.950E-11	3.630E-11
BREAST	3.280E-14	1.519E-11	6.468E-11	6.010E-16	-1.000E+00	2.940E-11	4.680E-11
LUNGS	2.860E-14	1.446E-11	6.156E-11	5.720E-16	-1.000E+00	8.200E-10	4.530E-11
RED MARR	2.770E-14	1.466E-11	6.242E-11	5.800E-16	-1.000E+00	2.720E-11	4.300E-11
BONE SUR	4.870E-14	2.161E-11	9.202E-11	8.550E-16	-1.000E+00	2.520E-11	4.070E-11
THYROID	2.930E-14	1.502E-11	6.393E-11	5.940E-16	-1.000E+00	4.860E-08	9.100E-08
REMAINDER	2.730E-14	1.418E-11	6.038E-11	5.610E-16	-1.000E+00	5.000E-11	1.550E-10
EFFECTIVE	2.940E-14	1.509E-11	6.425E-11	5.970E-16	-1.000E+00	1.580E-09	2.800E-09
SKIN (FGR)	5.830E-14	1.150E-10	4.897E-10	4.550E-15	-1.000E+00	0.000E+00	0.000E+00
I-134							
GONADS	1.270E-13	1.200E-11	1.202E-11	2.640E-15	-1.000E+00	4.250E-12	1.100E-11
BREAST	1.440E-13	1.145E-11	1.147E-11	2.520E-15	-1.000E+00	6.170E-12	1.170E-11
LUNGS	1.270E-13	1.100E-11	1.102E-11	2.420E-15	-1.000E+00	1.430E-10	1.260E-11
RED MARR	1.250E-13	1.127E-11	1.129E-11	2.480E-15	-1.000E+00	6.080E-12	1.090E-11
BONE SUR	1.960E-13	1.568E-11	1.571E-11	3.450E-15	-1.000E+00	5.310E-12	9.320E-12
THYROID	1.300E-13	1.127E-11	1.129E-11	2.480E-15	-1.000E+00	2.880E-10	6.210E-10
REMAINDER	1.220E-13	1.091E-11	1.093E-11	2.400E-15	-1.000E+00	2.270E-11	1.340E-10
EFFECTIVE	1.300E-13	1.150E-11	1.152E-11	2.530E-15	-1.000E+00	3.550E-11	6.660E-11
SKIN (FGR)	1.870E-13	4.477E-11	4.485E-11	9.850E-15	-1.000E+00	0.000E+00	0.000E+00
I-135							
GONADS	7.770E-14	3.113E-11	5.489E-11	1.599E-15	-1.000E+00	1.700E-11	3.610E-11
BREAST	8.790E-14	2.971E-11	5.240E-11	1.526E-15	-1.000E+00	2.340E-11	3.850E-11
LUNGS	7.840E-14	2.886E-11	5.089E-11	1.482E-15	-1.000E+00	4.410E-10	3.750E-11
RED MARR	7.760E-14	2.965E-11	5.228E-11	1.523E-15	-1.000E+00	2.240E-11	3.650E-11
BONE SUR	1.130E-13	3.983E-11	7.024E-11	2.046E-15	-1.000E+00	2.010E-11	3.360E-11
THYROID	8.010E-14	2.852E-11	5.030E-11	1.465E-15	-1.000E+00	8.460E-09	1.790E-08
REMAINDER	7.570E-14	2.883E-11	5.084E-11	1.481E-15	-1.000E+00	4.700E-11	1.540E-10
EFFECTIVE	7.980E-14	2.989E-11	5.271E-11	1.535E-15	-1.000E+00	3.320E-10	6.080E-10
SKIN (FGR)	1.110E-13	9.826E-11	1.733E-10	5.047E-15	-1.000E+00	0.000E+00	0.000E+00
Xe-133							
GONADS	1.610E-15	1.465E-12	2.052E-11	5.200E-17	-1.000E+00	0.000E+00	0.000E+00
BREAST	1.960E-15	1.505E-12	2.107E-11	5.340E-17	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.320E-15	1.045E-12	1.464E-11	3.710E-17	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.070E-15	8.791E-13	1.231E-11	3.120E-17	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	5.130E-15	4.254E-12	5.958E-11	1.510E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.510E-15	1.181E-12	1.653E-11	4.190E-17	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	1.240E-15	1.042E-12	1.460E-11	3.700E-17	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.560E-15	1.299E-12	1.819E-11	4.610E-17	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	4.970E-15	1.953E-12	2.734E-11	6.930E-17	-1.000E+00	0.000E+00	0.000E+00
Xe-135							
GONADS	1.170E-14	5.455E-12	1.194E-11	2.530E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	1.330E-14	5.325E-12	1.166E-11	2.470E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.130E-14	4.959E-12	1.086E-11	2.300E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.070E-14	4.959E-12	1.086E-11	2.300E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	2.570E-14	9.120E-12	1.997E-11	4.230E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.180E-14	5.023E-12	1.100E-11	2.330E-16	-1.000E+00	0.000E+00	0.000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

REMAINDER	1.080E-14	4.829E-12	1.058E-11	2.240E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.190E-14	5.217E-12	1.142E-11	2.420E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	3.120E-14	4.506E-11	9.867E-11	2.090E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-134							
GONADS	7.400E-14	4.607E-11	9.646E-10	1.600E-15	-1.000E+00	1.300E-08	2.060E-08
BREAST	8.430E-14	4.406E-11	9.224E-10	1.530E-15	-1.000E+00	1.080E-08	1.720E-08
LUNGS	7.370E-14	4.204E-11	8.802E-10	1.460E-15	-1.000E+00	1.180E-08	1.760E-08
RED MARR	7.190E-14	4.262E-11	8.922E-10	1.480E-15	-1.000E+00	1.180E-08	1.870E-08
BONE SUR	1.200E-13	6.105E-11	1.278E-09	2.120E-15	-1.000E+00	1.100E-08	1.740E-08
THYROID	7.570E-14	4.377E-11	9.163E-10	1.520E-15	-1.000E+00	1.110E-08	1.760E-08
REMAINDER	7.060E-14	4.147E-11	8.681E-10	1.440E-15	-1.000E+00	1.390E-08	2.210E-08
EFFECTIVE	7.570E-14	4.377E-11	9.163E-10	1.520E-15	-1.000E+00	1.250E-08	1.980E-08
SKIN (FGR)	9.450E-14	6.249E-11	1.308E-09	2.170E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-136							
GONADS	1.040E-13	6.223E-11	1.102E-09	2.180E-15	-1.000E+00	1.880E-09	3.040E-09
BREAST	1.180E-13	5.966E-11	1.056E-09	2.090E-15	-1.000E+00	1.670E-09	2.650E-09
LUNGS	1.040E-13	5.710E-11	1.011E-09	2.000E-15	-1.000E+00	2.320E-09	2.620E-09
RED MARR	1.010E-13	5.824E-11	1.031E-09	2.040E-15	-1.000E+00	1.860E-09	2.950E-09
BONE SUR	1.660E-13	8.422E-11	1.491E-09	2.950E-15	-1.000E+00	1.700E-09	2.710E-09
THYROID	1.070E-13	5.852E-11	1.036E-09	2.050E-15	-1.000E+00	1.730E-09	2.740E-09
REMAINDER	9.950E-14	5.652E-11	1.001E-09	1.980E-15	-1.000E+00	2.190E-09	3.520E-09
EFFECTIVE	1.060E-13	5.966E-11	1.056E-09	2.090E-15	-1.000E+00	1.980E-09	3.040E-09
SKIN (FGR)	1.250E-13	7.251E-11	1.284E-09	2.540E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-137							
GONADS	7.960E-18	1.669E-11	3.530E-10	5.840E-16	-1.000E+00	8.760E-09	1.390E-08
BREAST	9.670E-18	1.596E-11	3.376E-10	5.585E-16	-1.000E+00	7.840E-09	1.240E-08
LUNGS	6.680E-18	1.517E-11	3.209E-10	5.309E-16	-1.000E+00	8.820E-09	1.270E-08
RED MARR	5.700E-18	1.542E-11	3.260E-10	5.394E-16	-1.000E+00	8.300E-09	1.320E-08
BONE SUR	2.290E-17	2.238E-11	4.734E-10	7.832E-16	-1.000E+00	7.940E-09	1.260E-08
THYROID	7.550E-18	1.588E-11	3.358E-10	5.556E-16	-1.000E+00	7.930E-09	1.260E-08
REMAINDER	6.340E-18	1.490E-11	3.152E-10	5.215E-16	-1.000E+00	9.120E-09	1.450E-08
EFFECTIVE	7.740E-18	1.585E-11	3.353E-10	5.546E-16	-1.000E+00	8.630E-09	1.350E-08
SKIN (FGR)	8.630E-15	5.253E-11	1.110E-09	1.836E-15	-1.000E+00	0.000E+00	0.000E+00
Ba-139							
GONADS	2.130E-15	3.368E-13	3.429E-13	4.790E-17	-1.000E+00	2.560E-12	1.560E-12
BREAST	2.450E-15	3.297E-13	3.357E-13	4.690E-17	-1.000E+00	2.460E-12	5.170E-13
LUNGS	2.030E-15	3.002E-13	3.057E-13	4.270E-17	-1.000E+00	2.530E-10	3.890E-13
RED MARR	1.870E-15	2.932E-13	2.985E-13	4.170E-17	-1.000E+00	3.410E-12	8.590E-13
BONE SUR	5.290E-15	6.841E-13	6.965E-13	9.730E-17	-1.000E+00	2.490E-12	4.380E-13
THYROID	2.130E-15	3.044E-13	3.100E-13	4.330E-17	-1.000E+00	2.400E-12	2.660E-13
REMAINDER	1.920E-15	2.932E-13	2.985E-13	4.170E-17	-1.000E+00	4.820E-11	3.570E-10
EFFECTIVE	2.170E-15	3.227E-13	3.286E-13	4.590E-17	-1.000E+00	4.640E-11	1.080E-10
SKIN (FGR)	6.160E-14	7.241E-11	7.373E-11	1.030E-14	-1.000E+00	0.000E+00	0.000E+00
Ba-140							
GONADS	8.410E-15	5.451E-12	9.607E-11	1.910E-16	-1.000E+00	4.300E-10	9.960E-10
BREAST	9.640E-15	5.280E-12	9.305E-11	1.850E-16	-1.000E+00	2.870E-10	1.590E-10
LUNGS	8.270E-15	4.852E-12	8.550E-11	1.700E-16	-1.000E+00	1.660E-09	6.630E-11
RED MARR	7.930E-15	4.880E-12	8.601E-11	1.710E-16	-1.000E+00	1.290E-09	4.390E-10
BONE SUR	1.550E-14	8.020E-12	1.413E-10	2.810E-16	-1.000E+00	2.410E-09	5.530E-10
THYROID	8.530E-15	5.109E-12	9.003E-11	1.790E-16	-1.000E+00	2.560E-10	5.250E-11
REMAINDER	7.890E-15	4.766E-12	8.399E-11	1.670E-16	-1.000E+00	1.410E-09	7.370E-09
EFFECTIVE	8.580E-15	5.137E-12	9.053E-11	1.800E-16	-1.000E+00	1.010E-09	2.560E-09
SKIN (FGR)	2.520E-14	5.565E-11	9.808E-10	1.950E-15	-1.000E+00	0.000E+00	0.000E+00
La-140							
GONADS	1.140E-13	6.027E-11	4.425E-10	2.240E-15	-1.000E+00	4.540E-10	1.340E-09
BREAST	1.290E-13	5.758E-11	4.228E-10	2.140E-15	-1.000E+00	1.450E-10	1.800E-10
LUNGS	1.150E-13	5.596E-11	4.109E-10	2.080E-15	-1.000E+00	4.210E-09	4.010E-11
RED MARR	1.140E-13	5.731E-11	4.208E-10	2.130E-15	-1.000E+00	2.140E-10	2.810E-10
BONE SUR	1.690E-13	7.776E-11	5.709E-10	2.890E-15	-1.000E+00	1.410E-10	9.770E-11
THYROID	1.180E-13	5.462E-11	4.010E-10	2.030E-15	-1.000E+00	6.870E-11	6.400E-12
REMAINDER	1.110E-13	5.569E-11	4.089E-10	2.070E-15	-1.000E+00	2.120E-09	6.260E-09
EFFECTIVE	1.170E-13	5.812E-11	4.267E-10	2.160E-15	-1.000E+00	1.310E-09	2.280E-09
SKIN (FGR)	1.660E-13	2.217E-10	1.628E-09	8.240E-15	-1.000E+00	0.000E+00	0.000E+00
La-141							
GONADS	2.330E-15	7.315E-13	9.675E-13	4.740E-17	-1.000E+00	1.010E-11	3.770E-12
BREAST	2.640E-15	7.007E-13	9.267E-13	4.540E-17	-1.000E+00	9.840E-12	7.070E-13
LUNGS	2.340E-15	6.713E-13	8.879E-13	4.350E-17	-1.000E+00	6.460E-10	2.720E-13
RED MARR	2.310E-15	6.852E-13	9.063E-13	4.440E-17	-1.000E+00	2.930E-11	1.070E-12
BONE SUR	3.490E-15	9.923E-13	1.312E-12	6.430E-17	-1.000E+00	1.200E-10	6.060E-13
THYROID	2.390E-15	6.590E-13	8.716E-13	4.270E-17	-1.000E+00	9.400E-12	5.290E-14
REMAINDER	2.260E-15	6.682E-13	8.838E-13	4.330E-17	-1.000E+00	2.280E-10	1.240E-09
EFFECTIVE	2.390E-15	7.007E-13	9.267E-13	4.540E-17	-1.000E+00	1.570E-10	3.740E-10
SKIN (FGR)	6.580E-14	1.667E-10	2.204E-10	1.080E-14	-1.000E+00	0.000E+00	0.000E+00

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

La-142

GONADS	1.400E-13	1.978E-11	2.034E-11	2.540E-15-1.000E+00	1.660E-11	6.990E-11
BREAST	1.570E-13	1.885E-11	1.938E-11	2.420E-15-1.000E+00	1.130E-11	1.540E-11
LUNGS	1.420E-13	1.846E-11	1.898E-11	2.370E-15-1.000E+00	3.010E-10	8.400E-12
RED MARR	1.420E-13	1.900E-11	1.954E-11	2.440E-15-1.000E+00	1.360E-11	1.930E-11
BONE SUR	1.950E-13	2.484E-11	2.554E-11	3.190E-15-1.000E+00	1.110E-11	7.400E-12
THYROID	1.450E-13	1.768E-11	1.818E-11	2.270E-15-1.000E+00	8.740E-12	1.160E-12
REMAINDER	1.380E-13	1.853E-11	1.906E-11	2.380E-15-1.000E+00	8.070E-11	5.200E-10
EFFECTIVE	1.440E-13	1.916E-11	1.970E-11	2.460E-15-1.000E+00	6.840E-11	1.790E-10
SKIN (FGR)	2.160E-13	9.111E-11	9.368E-11	1.170E-14-1.000E+00	0.000E+00	0.000E+00

Ce-141

GONADS	3.380E-15	2.213E-12	4.332E-11	7.710E-17-1.000E+00	5.540E-11	1.080E-10
BREAST	3.930E-15	2.170E-12	4.247E-11	7.560E-17-1.000E+00	4.460E-11	1.110E-11
LUNGS	3.170E-15	1.951E-12	3.820E-11	6.800E-17-1.000E+00	1.670E-08	1.430E-12
RED MARR	2.830E-15	1.860E-12	3.641E-11	6.480E-17-1.000E+00	8.960E-11	3.390E-11
BONE SUR	9.410E-15	5.166E-12	1.011E-10	1.800E-16-1.000E+00	2.540E-10	2.300E-11
THYROID	3.350E-15	2.003E-12	3.922E-11	6.980E-17-1.000E+00	2.550E-11	1.800E-13
REMAINDER	2.980E-15	1.894E-12	3.708E-11	6.600E-17-1.000E+00	1.260E-09	2.500E-09
EFFECTIVE	3.430E-15	2.118E-12	4.146E-11	7.380E-17-1.000E+00	2.420E-09	7.830E-10
SKIN (FGR)	1.020E-14	3.788E-12	7.416E-11	1.320E-16-1.000E+00	0.000E+00	0.000E+00

Ce-143

GONADS	1.280E-14	7.900E-12	4.958E-11	2.980E-16-1.000E+00	7.530E-11	2.120E-10
BREAST	1.470E-14	7.688E-12	4.825E-11	2.900E-16-1.000E+00	1.660E-11	2.320E-11
LUNGS	1.230E-14	6.893E-12	4.325E-11	2.600E-16-1.000E+00	3.880E-09	3.820E-12
RED MARR	1.170E-14	6.787E-12	4.259E-11	2.560E-16-1.000E+00	2.960E-11	5.070E-11
BONE SUR	2.520E-14	1.323E-11	8.302E-11	4.990E-16-1.000E+00	1.640E-11	1.610E-11
THYROID	1.280E-14	7.211E-12	4.525E-11	2.720E-16-1.000E+00	6.230E-12	4.350E-13
REMAINDER	1.170E-14	6.734E-12	4.226E-11	2.540E-16-1.000E+00	1.420E-09	3.890E-09
EFFECTIVE	1.290E-14	7.396E-12	4.642E-11	2.790E-16-1.000E+00	9.160E-10	1.230E-09
SKIN (FGR)	3.960E-14	1.058E-10	6.638E-10	3.990E-15-1.000E+00	0.000E+00	0.000E+00

Ce-144

GONADS	8.530E-16	6.328E-13	1.319E-11	6.088E-17-1.000E+00	2.390E-10	6.987E-11
BREAST	1.010E-15	6.274E-13	1.307E-11	5.922E-17-1.000E+00	3.480E-10	1.223E-11
LUNGS	7.690E-16	5.228E-13	1.089E-11	5.362E-17-1.000E+00	7.910E-07	6.551E-12
RED MARR	6.680E-16	4.755E-13	9.907E-12	5.247E-17-1.000E+00	2.880E-09	8.923E-11
BONE SUR	2.490E-15	1.646E-12	3.429E-11	1.127E-16-1.000E+00	4.720E-09	1.280E-10
THYROID	8.330E-16	5.529E-13	1.152E-11	5.418E-17-1.000E+00	2.920E-10	5.154E-12
REMAINDER	7.230E-16	5.086E-13	1.060E-11	5.283E-17-1.000E+00	1.910E-08	1.890E-08
EFFECTIVE	8.530E-16	5.909E-13	1.231E-11	5.766E-17-1.000E+00	1.010E-07	5.711E-09
SKIN (FGR)	2.930E-15	7.648E-13	1.594E-11	1.250E-14-1.000E+00	0.000E+00	0.000E+00

Pr-143

GONADS	2.130E-17	2.264E-14	4.032E-13	7.930E-19-1.000E+00	4.370E-18	8.990E-18
BREAST	2.550E-17	2.330E-14	4.149E-13	8.160E-19-1.000E+00	2.220E-18	1.090E-18
LUNGS	1.860E-17	1.642E-14	2.923E-13	5.750E-19-1.000E+00	1.330E-08	1.910E-19
RED MARR	1.620E-17	1.493E-14	2.659E-13	5.230E-19-1.000E+00	1.480E-11	1.030E-12
BONE SUR	5.930E-17	5.454E-14	9.711E-13	1.910E-18-1.000E+00	1.490E-11	1.030E-12
THYROID	2.050E-17	1.802E-14	3.208E-13	6.310E-19-1.000E+00	1.680E-18	2.660E-20
REMAINDER	1.760E-17	1.642E-14	2.923E-13	5.750E-19-1.000E+00	1.970E-09	4.220E-09
EFFECTIVE	2.100E-17	2.002E-14	3.564E-13	7.010E-19-1.000E+00	2.190E-09	1.270E-09
SKIN (FGR)	1.760E-14	5.711E-11	1.017E-09	2.000E-15-1.000E+00	0.000E+00	0.000E+00

Nd-147

GONADS	6.130E-15	4.218E-12	7.235E-11	1.480E-16-1.000E+00	8.410E-11	1.790E-10
BREAST	7.120E-15	4.132E-12	7.088E-11	1.450E-16-1.000E+00	3.450E-11	1.870E-11
LUNGS	5.820E-15	3.648E-12	6.257E-11	1.280E-16-1.000E+00	1.060E-08	2.440E-12
RED MARR	5.400E-15	3.505E-12	6.013E-11	1.230E-16-1.000E+00	9.190E-11	5.050E-11
BONE SUR	1.320E-14	8.265E-12	1.418E-10	2.900E-16-1.000E+00	3.260E-10	2.220E-11
THYROID	6.120E-15	3.876E-12	6.648E-11	1.360E-16-1.000E+00	1.820E-11	2.640E-13
REMAINDER	5.530E-15	3.562E-12	6.111E-11	1.250E-16-1.000E+00	1.760E-09	3.760E-09
EFFECTIVE	6.190E-15	3.961E-12	6.795E-11	1.390E-16-1.000E+00	1.850E-09	1.180E-09
SKIN (FGR)	1.950E-14	3.135E-11	5.377E-10	1.100E-15-1.000E+00	0.000E+00	0.000E+00

Np-239

GONADS	7.530E-15	4.691E-12	4.380E-11	1.710E-16-1.000E+00	7.450E-11	1.620E-10
BREAST	8.730E-15	4.636E-12	4.329E-11	1.690E-16-1.000E+00	1.630E-11	1.720E-11
LUNGS	7.180E-15	4.115E-12	3.842E-11	1.500E-16-1.000E+00	2.360E-09	2.400E-12
RED MARR	6.500E-15	4.005E-12	3.740E-11	1.460E-16-1.000E+00	2.080E-10	4.660E-11
BONE SUR	2.000E-14	1.001E-11	9.349E-11	3.650E-16-1.000E+00	2.030E-09	3.590E-11
THYROID	7.520E-15	4.197E-12	3.919E-11	1.530E-16-1.000E+00	7.620E-12	2.070E-13
REMAINDER	6.760E-15	4.005E-12	3.740E-11	1.460E-16-1.000E+00	9.590E-10	2.770E-09
EFFECTIVE	7.690E-15	4.471E-12	4.175E-11	1.630E-16-1.000E+00	6.780E-10	8.820E-10
SKIN (FGR)	1.600E-14	7.215E-12	6.737E-11	2.630E-16-1.000E+00	0.000E+00	0.000E+00

Pu-238

GONADS	6.560E-18	4.291E-14	9.011E-13	1.490E-18-1.000E+00	2.800E-05	2.330E-09
BREAST	1.270E-17	5.558E-14	1.167E-12	1.930E-18-1.000E+00	1.000E-09	1.800E-13

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

LUNGS	1.060E-18	2.267E-15	4.759E-14	7.870E-20	-1.000E+00	1.840E-05	8.640E-14
RED MARR	1.680E-18	5.587E-15	1.173E-13	1.940E-19	-1.000E+00	1.520E-04	1.270E-08
BONE SUR	9.300E-18	3.514E-14	7.378E-13	1.220E-18	-1.000E+00	1.900E-03	1.580E-07
THYROID	4.010E-18	9.792E-15	2.056E-13	3.400E-19	-1.000E+00	9.620E-10	7.990E-14
REMAINDER	1.990E-18	9.216E-15	1.935E-13	3.200E-19	-1.000E+00	7.020E-05	2.180E-08
EFFECTIVE	4.880E-18	2.413E-14	5.068E-13	8.380E-19	-1.000E+00	1.060E-04	1.340E-08
SKIN (FGR)	4.090E-17	2.776E-13	5.830E-12	9.640E-18	-1.000E+00	0.000E+00	0.000E+00
Pu-239							
GONADS	4.840E-18	1.768E-14	3.713E-13	6.140E-19	-1.000E+00	3.180E-05	2.640E-09
BREAST	7.550E-18	2.238E-14	4.699E-13	7.770E-19	-1.000E+00	9.220E-10	1.210E-13
LUNGS	2.650E-18	2.267E-15	4.760E-14	7.870E-20	-1.000E+00	1.730E-05	7.890E-14
RED MARR	2.670E-18	3.456E-15	7.258E-14	1.200E-19	-1.000E+00	1.690E-04	1.410E-08
BONE SUR	9.470E-18	1.673E-14	3.514E-13	5.810E-19	-1.000E+00	2.110E-03	1.760E-07
THYROID	3.880E-18	5.126E-15	1.077E-13	1.780E-19	-1.000E+00	9.030E-10	7.500E-14
REMAINDER	2.860E-18	4.838E-15	1.016E-13	1.680E-19	-1.000E+00	7.560E-05	2.120E-08
EFFECTIVE	4.240E-18	1.057E-14	2.220E-13	3.670E-19	-1.000E+00	1.160E-05	1.400E-08
SKIN (FGR)	1.860E-17	1.057E-13	2.220E-12	3.670E-18	-1.000E+00	0.000E+00	0.000E+00
Pu-240							
GONADS	6.360E-18	4.118E-14	8.649E-13	1.430E-18	-1.000E+00	3.180E-05	2.640E-09
BREAST	1.230E-17	5.328E-14	1.119E-12	1.850E-18	-1.000E+00	9.510E-10	1.730E-13
LUNGS	1.090E-18	2.249E-15	4.723E-14	7.810E-20	-1.000E+00	1.730E-05	8.220E-14
RED MARR	1.650E-18	5.386E-15	1.131E-13	1.870E-19	-1.000E+00	1.690E-04	1.410E-08
BONE SUR	9.260E-18	3.398E-14	7.137E-13	1.180E-18	-1.000E+00	2.110E-03	1.760E-07
THYROID	3.920E-18	9.446E-15	1.984E-13	3.280E-19	-1.000E+00	9.050E-10	7.510E-14
REMAINDER	1.960E-18	8.870E-15	1.863E-13	3.080E-19	-1.000E+00	7.560E-05	2.130E-08
EFFECTIVE	4.750E-18	2.313E-14	4.857E-13	8.030E-19	-1.000E+00	1.160E-04	1.400E-08
SKIN (FGR)	3.920E-17	2.644E-13	5.552E-12	9.180E-18	-1.000E+00	0.000E+00	0.000E+00
Pu-241							
GONADS	7.190E-20	6.653E-17	1.396E-15	2.310E-21	-1.000E+00	6.820E-07	5.660E-11
BREAST	8.670E-20	7.229E-17	1.517E-15	2.510E-21	-1.000E+00	3.060E-11	2.790E-15
LUNGS	6.480E-20	4.090E-17	8.584E-16	1.420E-21	-1.000E+00	7.420E-09	4.480E-15
RED MARR	5.630E-20	4.003E-17	8.403E-16	1.390E-21	-1.000E+00	3.360E-06	2.780E-10
BONE SUR	2.190E-19	1.385E-16	2.908E-15	4.810E-21	-1.000E+00	4.200E-05	3.480E-09
THYROID	6.980E-20	4.522E-17	9.491E-16	1.570E-21	-1.000E+00	1.240E-11	1.010E-15
REMAINDER	6.090E-20	4.291E-17	9.007E-16	1.490E-21	-1.000E+00	1.310E-06	1.850E-10
EFFECTIVE	7.250E-20	5.558E-17	1.167E-15	1.930E-21	-1.000E+00	2.230E-06	2.070E-10
SKIN (FGR)	1.170E-19	2.033E-16	4.268E-15	7.060E-21	-1.000E+00	0.000E+00	0.000E+00
Am-241							
GONADS	8.580E-16	9.360E-13	1.966E-11	3.250E-17	-1.000E+00	3.250E-05	2.700E-07
BREAST	1.070E-15	1.014E-12	2.129E-11	3.520E-17	-1.000E+00	2.670E-09	2.620E-11
LUNGS	6.740E-16	5.789E-13	1.216E-11	2.010E-17	-1.000E+00	1.840E-05	3.360E-11
RED MARR	5.210E-16	4.838E-13	1.016E-11	1.680E-17	-1.000E+00	1.740E-04	1.450E-06
BONE SUR	2.870E-15	2.678E-12	5.625E-11	9.300E-17	-1.000E+00	2.170E-03	1.810E-05
THYROID	7.830E-16	6.365E-13	1.337E-11	2.210E-17	-1.000E+00	1.600E-09	1.320E-11
REMAINDER	6.340E-16	5.933E-13	1.246E-11	2.060E-17	-1.000E+00	7.820E-05	6.660E-07
EFFECTIVE	8.180E-16	7.920E-13	1.663E-11	2.750E-17	-1.000E+00	1.200E-04	9.840E-07
SKIN (FGR)	1.280E-15	2.396E-12	5.032E-11	8.320E-17	-1.000E+00	0.000E+00	0.000E+00
Cm-242							
GONADS	7.830E-18	4.893E-14	1.013E-12	1.700E-18	-1.000E+00	5.700E-07	5.200E-09
BREAST	1.480E-17	6.159E-14	1.275E-12	2.140E-18	-1.000E+00	9.440E-10	8.950E-12
LUNGS	1.130E-18	3.022E-15	6.257E-14	1.050E-19	-1.000E+00	1.550E-05	8.840E-12
RED MARR	1.890E-18	6.562E-15	1.359E-13	2.280E-19	-1.000E+00	3.900E-06	3.570E-08
BONE SUR	1.060E-17	4.231E-14	8.759E-13	1.470E-18	-1.000E+00	4.870E-05	4.460E-07
THYROID	4.910E-18	1.261E-14	2.610E-13	4.380E-19	-1.000E+00	9.410E-10	8.820E-12
REMAINDER	2.270E-18	1.079E-14	2.235E-13	3.750E-19	-1.000E+00	2.450E-06	4.020E-08
EFFECTIVE	5.690E-18	2.751E-14	5.697E-13	9.560E-19	-1.000E+00	4.670E-06	3.100E-08
SKIN (FGR)	4.290E-17	2.700E-13	5.589E-12	9.380E-18	-1.000E+00	0.000E+00	0.000E+00
Cm-244							
GONADS	6.900E-18	4.522E-14	9.492E-13	1.570E-18	-1.000E+00	1.590E-05	1.330E-07
BREAST	1.330E-17	5.702E-14	1.197E-12	1.980E-18	-1.000E+00	1.040E-09	8.820E-12
LUNGS	7.080E-19	2.592E-15	5.441E-14	9.000E-20	-1.000E+00	1.930E-05	8.810E-12
RED MARR	1.460E-18	5.875E-15	1.233E-13	2.040E-19	-1.000E+00	9.380E-05	7.820E-07
BONE SUR	8.820E-18	3.859E-14	8.101E-13	1.340E-18	-1.000E+00	1.170E-03	9.770E-06
THYROID	4.190E-18	1.146E-14	2.406E-13	3.980E-19	-1.000E+00	1.010E-09	8.440E-12
REMAINDER	1.810E-18	9.821E-15	2.062E-13	3.410E-19	-1.000E+00	4.780E-05	4.150E-07
EFFECTIVE	4.910E-18	2.529E-14	5.308E-13	8.780E-19	-1.000E+00	6.700E-05	5.450E-07
SKIN (FGR)	3.910E-17	2.506E-13	5.260E-12	8.700E-18	-1.000E+00	0.000E+00	0.000E+00
I-130							
GONADS	1.010E-13	2.867E-11	5.828E-10	9.970E-16	-1.000E+00	2.810E-11	1.040E-09
BREAST	1.160E-13	2.737E-11	5.565E-10	9.520E-16	-1.000E+00	4.870E-11	1.790E-10
LUNGS	1.010E-13	2.617E-11	5.319E-10	9.100E-16	-1.000E+00	6.030E-10	8.530E-11
RED MARR	9.820E-14	2.671E-11	5.430E-10	9.290E-16	-1.000E+00	4.550E-11	2.600E-10
BONE SUR	1.680E-13	3.795E-11	7.716E-10	1.320E-15	-1.000E+00	4.030E-11	1.250E-10

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

THYROID	1.040E-13	2.720E-11	5.530E-10	9.460E-16	-1.000E+00	1.990E-08	6.310E-11
REMAINDER	9.660E-14	2.585E-11	5.255E-10	8.990E-16	-1.000E+00	8.020E-11	1.580E-09
EFFECTIVE	1.040E-13	2.732E-11	5.553E-10	9.500E-16	-1.000E+00	7.140E-10	8.090E-10
SKIN (FGR)	1.360E-13	3.278E-11	6.664E-10	1.140E-15	-1.000E+00	0.000E+00	0.000E+00
Kr-83m							
GONADS	1.710E-18	7.056E-11	1.480E-09	2.450E-15	-1.000E+00	0.000E+00	3.190E-09
BREAST	5.050E-18	6.739E-11	1.413E-09	2.340E-15	-1.000E+00	0.000E+00	1.100E-09
LUNGS	1.640E-19	6.537E-11	1.371E-09	2.270E-15	-1.000E+00	0.000E+00	8.770E-10
RED MARR	3.830E-19	6.710E-11	1.407E-09	2.330E-15	-1.000E+00	0.000E+00	1.320E-09
BONE SUR	2.250E-18	8.956E-11	1.879E-09	3.110E-15	-1.000E+00	0.000E+00	9.390E-10
THYROID	6.430E-19	6.480E-11	1.359E-09	2.250E-15	-1.000E+00	0.000E+00	7.880E-10
REMAINDER	5.300E-19	6.508E-11	1.365E-09	2.260E-15	-1.000E+00	0.000E+00	4.970E-09
EFFECTIVE	1.500E-18	6.768E-11	1.419E-09	2.350E-15	-1.000E+00	0.000E+00	2.770E-09
SKIN (FGR)	3.560E-17	7.948E-11	1.667E-09	2.760E-15	-1.000E+00	0.000E+00	0.000E+00
Xe-138							
GONADS	5.590E-14	8.121E-14	1.704E-12	2.820E-18	-1.000E+00	0.000E+00	0.000E+00
BREAST	6.320E-14	7.891E-14	1.656E-12	2.740E-18	-1.000E+00	0.000E+00	0.000E+00
LUNGS	5.660E-14	7.056E-14	1.481E-12	2.450E-18	-1.000E+00	0.000E+00	0.000E+00
RED MARR	5.600E-14	6.998E-14	1.469E-12	2.430E-18	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	8.460E-14	1.287E-13	2.702E-12	4.470E-18	-1.000E+00	0.000E+00	0.000E+00
THYROID	5.770E-14	7.459E-14	1.565E-12	2.590E-18	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	5.490E-14	6.941E-14	1.457E-12	2.410E-18	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	5.770E-14	7.603E-14	1.596E-12	2.640E-18	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.070E-13	2.304E-11	4.835E-10	8.000E-16	-1.000E+00	0.000E+00	0.000E+00
Xe-131m							
GONADS	4.570E-16	2.594E-12	3.653E-12	1.570E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	6.020E-16	2.527E-12	3.560E-12	1.530E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	2.670E-16	2.379E-12	3.351E-12	1.440E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	2.270E-16	2.346E-12	3.304E-12	1.420E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	1.060E-15	5.286E-12	7.446E-12	3.200E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	3.910E-16	2.395E-12	3.374E-12	1.450E-16	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	2.710E-16	2.313E-12	3.257E-12	1.400E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	3.890E-16	2.511E-12	3.537E-12	1.520E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	4.820E-15	2.247E-11	3.164E-11	1.360E-15	-1.000E+00	0.000E+00	0.000E+00
Xe-133m							
GONADS	1.420E-15	4.962E-12	5.026E-12	7.610E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	1.700E-15	4.740E-12	4.802E-12	7.270E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.190E-15	4.603E-12	4.663E-12	7.060E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.100E-15	4.708E-12	4.769E-12	7.220E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	3.230E-15	6.514E-12	6.598E-12	9.990E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.360E-15	4.473E-12	4.531E-12	6.860E-16	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	1.150E-15	4.590E-12	4.650E-12	7.040E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.370E-15	4.773E-12	4.835E-12	7.320E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.040E-14	8.802E-11	8.916E-11	1.350E-14	-1.000E+00	0.000E+00	0.000E+00
Xe-135m							
GONADS	2.000E-14	2.278E-11	2.655E-11	1.800E-15	-1.000E+00	0.000E+00	0.000E+00
BREAST	2.290E-14	2.177E-11	2.537E-11	1.720E-15	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.980E-14	2.139E-11	2.493E-11	1.690E-15	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.910E-14	2.190E-11	2.552E-11	1.730E-15	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	3.500E-14	2.886E-11	3.363E-11	2.280E-15	-1.000E+00	0.000E+00	0.000E+00
THYROID	2.040E-14	2.012E-11	2.345E-11	1.590E-15	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	1.890E-14	2.139E-11	2.493E-11	1.690E-15	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	2.040E-14	2.202E-11	2.567E-11	1.740E-15	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	2.970E-14	5.607E-11	6.534E-11	4.430E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-138							
GONADS	1.170E-13	2.788E-12	5.187E-11	9.740E-17	-1.000E+00	3.280E-12	2.150E-09
BREAST	1.330E-13	2.662E-12	4.953E-11	9.300E-17	-1.000E+00	4.020E-12	2.140E-09
LUNGS	1.190E-13	2.553E-12	4.750E-11	8.920E-17	-1.000E+00	1.590E-10	2.140E-09
RED MARR	1.180E-13	2.619E-12	4.873E-11	9.150E-17	-1.000E+00	3.950E-12	3.720E-09
BONE SUR	1.700E-13	3.635E-12	6.764E-11	1.270E-16	-1.000E+00	3.550E-12	6.860E-09
THYROID	1.210E-13	2.599E-12	4.836E-11	9.080E-17	-1.000E+00	3.570E-12	2.140E-09
REMAINDER	1.150E-13	2.542E-12	4.729E-11	8.880E-17	-1.000E+00	2.060E-11	2.330E-09
EFFECTIVE	1.210E-13	2.665E-12	4.958E-11	9.310E-17	-1.000E+00	2.740E-11	2.530E-09
SKIN (FGR)	2.170E-13	2.210E-10	4.111E-09	7.720E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-134m							
GONADS	9.300E-16	7.155E-14	1.436E-12	2.490E-18	-1.000E+00	3.610E-12	8.050E-12
BREAST	1.120E-15	7.212E-14	1.447E-12	2.510E-18	-1.000E+00	3.390E-12	7.980E-12
LUNGS	7.840E-16	5.689E-14	1.142E-12	1.980E-18	-1.000E+00	6.400E-11	7.970E-12
RED MARR	6.810E-16	5.345E-14	1.073E-12	1.860E-18	-1.000E+00	3.760E-12	1.080E-10
BONE SUR	2.610E-15	1.560E-13	3.131E-12	5.430E-18	-1.000E+00	3.550E-12	1.610E-10
THYROID	8.880E-16	6.063E-14	1.217E-12	2.110E-18	-1.000E+00	3.340E-12	7.970E-12
REMAINDER	7.450E-16	5.603E-14	1.124E-12	1.950E-18	-1.000E+00	6.900E-12	8.250E-09
EFFECTIVE	9.050E-16	6.523E-14	1.309E-12	2.270E-18	-1.000E+00	1.180E-11	2.500E-09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

SKIN (FGR)	2.880E-15	1.914E-10	3.841E-09	6.660E-15	-1.000E+00	0.000E+00	0.000E+00
Rb-88							
GONADS	3.260E-14	9.590E-15	2.014E-13	3.330E-19	-1.000E+00	1.310E-12	5.040E-11
BREAST	3.670E-14	1.008E-14	2.116E-13	3.500E-19	-1.000E+00	1.430E-12	5.040E-11
LUNGS	3.310E-14	6.307E-15	1.324E-13	2.190E-19	-1.000E+00	1.470E-10	5.040E-11
RED MARR	3.300E-14	5.558E-15	1.167E-13	1.930E-19	-1.000E+00	1.450E-12	6.450E-09
BONE SUR	4.620E-14	2.393E-14	5.025E-13	8.310E-19	-1.000E+00	1.470E-12	1.390E-08
THYROID	3.370E-14	7.171E-15	1.506E-13	2.490E-19	-1.000E+00	1.370E-12	5.040E-11
REMAINDER	3.210E-14	6.422E-15	1.348E-13	2.230E-19	-1.000E+00	1.380E-11	6.700E-09
EFFECTIVE	3.360E-14	8.179E-15	1.717E-13	2.840E-19	-1.000E+00	2.260E-11	3.230E-09
SKIN (FGR)	1.830E-13	4.032E-12	8.465E-11	1.400E-16	-1.000E+00	0.000E+00	0.000E+00
Rb-89							
GONADS	1.030E-13	2.155E-11	5.062E-11	1.026E-15	-1.000E+00	1.340E-12	2.520E-10
BREAST	1.170E-13	2.059E-11	4.838E-11	9.806E-16	-1.000E+00	1.730E-12	3.676E-11
LUNGS	1.040E-13	1.970E-11	4.626E-11	9.376E-16	-1.000E+00	6.800E-11	1.055E-11
RED MARR	1.040E-13	2.011E-11	4.722E-11	9.570E-16	-1.000E+00	2.020E-12	5.659E-11
BONE SUR	1.480E-13	2.852E-11	6.709E-11	1.360E-15	-1.000E+00	2.540E-12	2.070E-11
THYROID	1.070E-13	2.035E-11	4.782E-11	9.693E-16	-1.000E+00	1.610E-12	1.968E-12
REMAINDER	1.010E-13	1.948E-11	4.573E-11	9.268E-16	-1.000E+00	8.140E-12	2.557E-09
EFFECTIVE	1.060E-13	2.057E-11	4.832E-11	9.793E-16	-1.000E+00	1.160E-11	8.455E-10
SKIN (FGR)	1.870E-13	1.748E-10	3.987E-10	8.080E-15	-1.000E+00	0.000E+00	0.000E+00
Sb-124							
GONADS	8.890E-14	1.593E-11	1.830E-11	1.300E-15	-1.000E+00	1.040E-09	8.180E-11
BREAST	1.010E-13	1.520E-11	1.745E-11	1.240E-15	-1.000E+00	8.940E-10	1.700E-11
LUNGS	8.970E-14	1.483E-11	1.703E-11	1.210E-15	-1.000E+00	4.140E-08	7.220E-12
RED MARR	8.850E-14	1.520E-11	1.745E-11	1.240E-15	-1.000E+00	1.090E-09	2.290E-11
BONE SUR	1.340E-13	2.010E-11	2.308E-11	1.640E-15	-1.000E+00	1.240E-09	8.490E-12
THYROID	9.150E-14	1.446E-11	1.661E-11	1.180E-15	-1.000E+00	6.740E-10	1.300E-12
REMAINDER	8.660E-14	1.471E-11	1.689E-11	1.200E-15	-1.000E+00	4.180E-09	1.720E-09
EFFECTIVE	9.150E-14	1.532E-11	1.759E-11	1.250E-15	-1.000E+00	6.800E-09	5.430E-10
SKIN (FGR)	1.260E-13	2.280E-11	2.618E-11	1.860E-15	-1.000E+00	0.000E+00	0.000E+00
Sb-125							
GONADS	1.980E-14	1.586E-13	1.601E-12	5.750E-18	-1.000E+00	3.600E-10	1.430E-14
BREAST	2.270E-14	1.578E-13	1.593E-12	5.720E-18	-1.000E+00	4.160E-10	1.270E-14
LUNGS	1.950E-14	1.313E-13	1.326E-12	4.760E-18	-1.000E+00	2.170E-08	1.260E-14
RED MARR	1.870E-14	1.261E-13	1.273E-12	4.570E-18	-1.000E+00	5.350E-10	3.700E-13
BONE SUR	3.530E-14	3.228E-13	3.259E-12	1.170E-17	-1.000E+00	9.780E-10	3.670E-13
THYROID	2.010E-14	1.385E-13	1.398E-12	5.020E-18	-1.000E+00	3.240E-10	1.260E-14
REMAINDER	1.860E-14	1.291E-13	1.303E-12	4.680E-18	-1.000E+00	1.450E-09	9.680E-09
EFFECTIVE	2.020E-14	1.468E-13	1.482E-12	5.320E-18	-1.000E+00	3.300E-09	2.910E-09
SKIN (FGR)	2.650E-14	2.897E-10	2.924E-09	1.050E-14	-1.000E+00	0.000E+00	0.000E+00
Sb-126							
GONADS	1.350E-13	1.756E-13	3.546E-12	6.110E-18	-1.000E+00	1.320E-09	3.540E-12
BREAST	1.530E-13	1.713E-13	3.459E-12	5.960E-18	-1.000E+00	6.440E-10	5.540E-13
LUNGS	1.340E-13	1.526E-13	3.082E-12	5.310E-18	-1.000E+00	1.380E-08	2.020E-13
RED MARR	1.300E-13	1.521E-13	3.070E-12	5.290E-18	-1.000E+00	7.970E-10	6.590E-12
BONE SUR	2.220E-13	2.903E-13	5.862E-12	1.010E-17	-1.000E+00	6.750E-10	6.130E-12
THYROID	1.370E-13	1.564E-13	3.157E-12	5.440E-18	-1.000E+00	4.800E-10	1.290E-13
REMAINDER	1.280E-13	1.509E-13	3.047E-12	5.250E-18	-1.000E+00	3.190E-09	8.570E-09
EFFECTIVE	1.370E-13	1.650E-13	3.332E-12	5.740E-18	-1.000E+00	3.170E-09	2.570E-09
SKIN (FGR)	1.730E-13	1.989E-10	4.016E-09	6.920E-15	-1.000E+00	0.000E+00	0.000E+00
Te-131							
GONADS	1.990E-14	3.855E-12	4.872E-12	2.650E-16	-1.000E+00	6.140E-12	1.960E-11
BREAST	2.280E-14	3.680E-12	4.652E-12	2.530E-16	-1.000E+00	5.530E-12	3.550E-12
LUNGS	1.960E-14	3.535E-12	4.468E-12	2.430E-16	-1.000E+00	2.540E-10	1.390E-12
RED MARR	1.880E-14	3.608E-12	4.560E-12	2.480E-16	-1.000E+00	6.640E-12	4.910E-12
BONE SUR	3.800E-14	5.091E-12	6.435E-12	3.500E-16	-1.000E+00	6.210E-12	1.750E-12
THYROID	2.030E-14	3.579E-12	4.523E-12	2.460E-16	-1.000E+00	2.630E-09	1.770E-13
REMAINDER	1.870E-14	3.506E-12	4.431E-12	2.410E-16	-1.000E+00	5.420E-11	1.700E-09
EFFECTIVE	2.040E-14	3.680E-12	4.652E-12	2.530E-16	-1.000E+00	1.290E-10	5.150E-10
SKIN (FGR)	6.890E-14	2.022E-10	2.556E-10	1.390E-14	-1.000E+00	0.000E+00	0.000E+00
Te-133							
GONADS	4.490E-14	2.108E-12	4.989E-12	9.510E-17	-1.000E+00	6.700E-13	2.200E-11
BREAST	5.100E-14	2.026E-12	4.794E-12	9.140E-17	-1.000E+00	8.480E-13	3.130E-12
LUNGS	4.470E-14	1.937E-12	4.585E-12	8.740E-17	-1.000E+00	4.390E-11	8.670E-13
RED MARR	4.360E-14	1.972E-12	4.669E-12	8.900E-17	-1.000E+00	8.390E-13	4.930E-12
BONE SUR	7.500E-14	2.948E-12	6.977E-12	1.330E-16	-1.000E+00	7.490E-13	1.730E-12
THYROID	4.590E-14	1.908E-12	4.516E-12	8.610E-17	-1.000E+00	5.910E-10	1.260E-13
REMAINDER	4.290E-14	1.919E-12	4.543E-12	8.660E-17	-1.000E+00	5.020E-12	4.090E-09
EFFECTIVE	4.600E-14	2.021E-12	4.784E-12	9.120E-17	-1.000E+00	2.490E-11	1.230E-09
SKIN (FGR)	1.060E-13	2.726E-10	6.452E-10	1.230E-14	-1.000E+00	0.000E+00	0.000E+00
Te-134							
GONADS	4.160E-14	2.182E-11	4.421E-10	7.590E-16	-1.000E+00	9.000E-12	8.160E-10

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

BREAST	4.750E-14	2.084E-11	4.223E-10	7.250E-16	-1.000E+00	8.720E-12	1.050E-10
LUNGS	4.100E-14	1.989E-11	4.030E-10	6.920E-16	-1.000E+00	6.020E-11	2.340E-11
RED MARR	3.940E-14	2.030E-11	4.112E-10	7.060E-16	-1.000E+00	9.300E-12	2.140E-10
BONE SUR	7.560E-14	2.875E-11	5.824E-10	1.000E-15	-1.000E+00	8.580E-12	4.860E-10
THYROID	4.230E-14	2.076E-11	4.205E-10	7.220E-16	-1.000E+00	5.540E-10	8.270E-12
REMAINDER	3.910E-14	1.963E-11	3.978E-10	6.830E-16	-1.000E+00	1.880E-11	2.530E-09
EFFECTIVE	4.240E-14	2.078E-11	4.211E-10	7.230E-16	-1.000E+00	3.440E-11	1.020E-09
SKIN (FGR)	6.350E-14	2.561E-11	5.190E-10	8.910E-16	-1.000E+00	0.000E+00	0.000E+00
Te-125m							
GONADS	5.960E-16	2.179E-11	7.799E-11	9.253E-16	-1.000E+00	7.930E-11	6.228E-10
BREAST	8.480E-16	2.083E-11	7.455E-11	8.846E-16	-1.000E+00	7.080E-11	8.137E-11
LUNGS	2.230E-16	1.992E-11	7.127E-11	8.456E-16	-1.000E+00	1.040E-08	1.770E-11
RED MARR	1.860E-16	2.034E-11	7.279E-11	8.634E-16	-1.000E+00	1.150E-09	1.302E-10
BONE SUR	1.220E-15	2.881E-11	1.031E-10	1.224E-15	-1.000E+00	1.180E-08	4.558E-11
THYROID	4.640E-16	2.061E-11	7.377E-11	8.755E-16	-1.000E+00	3.870E-11	2.671E-12
REMAINDER	2.590E-16	1.966E-11	7.035E-11	8.345E-16	-1.000E+00	6.750E-10	6.990E-09
EFFECTIVE	4.530E-16	2.078E-11	7.438E-11	8.824E-16	-1.000E+00	1.970E-09	2.283E-09
SKIN (FGR)	1.940E-15	2.281E-10	8.148E-10	9.587E-15	-1.000E+00	0.000E+00	0.000E+00
Te-133m							
GONADS	1.120E-13	2.253E-11	4.435E-10	7.850E-16	-1.000E+00	8.970E-12	8.050E-10
BREAST	1.270E-13	2.150E-11	4.231E-10	7.490E-16	-1.000E+00	7.820E-12	1.070E-10
LUNGS	1.120E-13	2.055E-11	4.045E-10	7.160E-16	-1.000E+00	1.820E-10	2.740E-11
RED MARR	1.090E-13	2.101E-11	4.135E-10	7.320E-16	-1.000E+00	8.320E-12	1.990E-10
BONE SUR	1.750E-13	2.957E-11	5.819E-10	1.030E-15	-1.000E+00	6.940E-12	2.940E-10
THYROID	1.150E-13	2.144E-11	4.220E-10	7.470E-16	-1.000E+00	2.610E-09	1.180E-11
REMAINDER	1.070E-13	2.032E-11	4.000E-10	7.080E-16	-1.000E+00	4.140E-11	1.470E-09
EFFECTIVE	1.140E-13	2.147E-11	4.226E-10	7.480E-16	-1.000E+00	1.170E-10	6.950E-10
SKIN (FGR)	1.740E-13	2.598E-11	5.112E-10	9.050E-16	-1.000E+00	0.000E+00	0.000E+00
Ba-141							
GONADS	4.060E-14	4.282E-12	4.403E-11	1.550E-16	-1.000E+00	1.410E-12	2.180E-10
BREAST	4.630E-14	4.116E-12	4.233E-11	1.490E-16	-1.000E+00	1.470E-12	3.430E-11
LUNGS	4.030E-14	3.867E-12	3.977E-11	1.400E-16	-1.000E+00	1.160E-10	1.510E-11
RED MARR	3.910E-14	3.923E-12	4.034E-11	1.420E-16	-1.000E+00	2.490E-12	8.320E-11
BONE SUR	7.170E-14	6.105E-12	6.278E-11	2.210E-16	-1.000E+00	4.730E-12	6.320E-11
THYROID	4.150E-14	4.033E-12	4.147E-11	1.460E-16	-1.000E+00	1.330E-12	1.030E-11
REMAINDER	3.870E-14	3.812E-12	3.920E-11	1.380E-16	-1.000E+00	2.270E-11	4.280E-09
EFFECTIVE	4.160E-14	4.061E-12	4.176E-11	1.470E-16	-1.000E+00	2.180E-11	1.360E-09
SKIN (FGR)	1.070E-13	1.039E-10	1.068E-09	3.760E-15	-1.000E+00	0.000E+00	0.000E+00
Ba-137m							
GONADS	2.820E-14	2.334E-12	3.877E-12	1.240E-16	-1.000E+00	0.000E+00	9.750E-12
BREAST	3.220E-14	2.258E-12	3.752E-12	1.200E-16	-1.000E+00	0.000E+00	3.570E-12
LUNGS	2.800E-14	2.127E-12	3.533E-12	1.130E-16	-1.000E+00	0.000E+00	3.140E-12
RED MARR	2.730E-14	2.070E-12	3.439E-12	1.100E-16	-1.000E+00	0.000E+00	6.290E-12
BONE SUR	4.630E-14	5.383E-12	8.942E-12	2.860E-16	-1.000E+00	0.000E+00	4.060E-12
THYROID	2.880E-14	2.145E-12	3.564E-12	1.140E-16	-1.000E+00	0.000E+00	8.460E-11
REMAINDER	2.680E-14	2.070E-12	3.439E-12	1.100E-16	-1.000E+00	0.000E+00	3.340E-11
EFFECTIVE	2.880E-14	2.277E-12	3.783E-12	1.210E-16	-1.000E+00	0.000E+00	1.680E-11
SKIN (FGR)	3.730E-14	2.710E-12	4.502E-12	1.440E-16	-1.000E+00	0.000E+00	0.000E+00
Pd-109							
GONADS	2.710E-16	1.404E-11	2.783E-10	4.892E-16	-1.000E+00	2.130E-12	5.720E-10
BREAST	3.520E-16	1.350E-11	2.677E-10	4.705E-16	-1.000E+00	5.110E-13	1.200E-10
LUNGS	1.940E-16	1.273E-11	2.522E-10	4.432E-16	-1.000E+00	1.200E-09	7.310E-11
RED MARR	1.740E-16	1.287E-11	2.551E-10	4.483E-16	-1.000E+00	9.820E-13	1.660E-10
BONE SUR	7.020E-16	1.958E-11	3.882E-10	6.823E-16	-1.000E+00	9.580E-13	9.631E-11
THYROID	2.460E-16	1.331E-11	2.639E-10	4.638E-16	-1.000E+00	1.550E-13	6.250E-11
REMAINDER	1.920E-16	1.248E-11	2.472E-10	4.346E-16	-1.000E+00	5.040E-10	2.110E-09
EFFECTIVE	2.510E-16	1.332E-11	2.641E-10	4.642E-16	-1.000E+00	2.960E-10	8.271E-10
SKIN (FGR)	2.150E-14	1.785E-11	3.543E-10	6.229E-16	-1.000E+00	0.000E+00	0.000E+00
Rh-106							
GONADS	1.010E-14	1.327E-11	1.861E-11	8.070E-16	-1.000E+00	0.000E+00	9.670E-11
BREAST	1.160E-14	1.271E-11	1.783E-11	7.730E-16	-1.000E+00	0.000E+00	1.590E-11
LUNGS	1.010E-14	1.210E-11	1.697E-11	7.360E-16	-1.000E+00	0.000E+00	6.210E-12
RED MARR	9.750E-15	1.230E-11	1.725E-11	7.480E-16	-1.000E+00	0.000E+00	2.350E-11
BONE SUR	1.720E-14	1.809E-11	2.537E-11	1.100E-15	-1.000E+00	0.000E+00	8.890E-12
THYROID	1.030E-14	1.260E-11	1.766E-11	7.660E-16	-1.000E+00	0.000E+00	1.820E-12
REMAINDER	9.630E-15	1.189E-11	1.667E-11	7.230E-16	-1.000E+00	0.000E+00	8.540E-10
EFFECTIVE	1.040E-14	1.265E-11	1.773E-11	7.690E-16	-1.000E+00	0.000E+00	2.870E-10
SKIN (FGR)	1.090E-13	7.368E-11	1.033E-10	4.480E-15	-1.000E+00	0.000E+00	0.000E+00
Rh-103m							
GONADS	1.250E-17	6.411E-12	1.340E-10	2.230E-16	-1.000E+00	8.910E-14	1.640E-09
BREAST	2.150E-17	6.152E-12	1.286E-10	2.140E-16	-1.000E+00	8.800E-14	1.440E-09
LUNGS	1.870E-18	5.836E-12	1.220E-10	2.030E-16	-1.000E+00	7.750E-12	1.420E-09
RED MARR	2.820E-18	5.893E-12	1.232E-10	2.050E-16	-1.000E+00	8.840E-14	1.460E-09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

BONE SUR	1.760E-17	8.883E-12	1.856E-10	3.090E-16	-1.000E+00	8.730E-14	1.430E-09
THYROID	8.550E-18	6.066E-12	1.268E-10	2.110E-16	-1.000E+00	8.490E-14	1.410E-09
REMAINDER	3.680E-18	5.721E-12	1.196E-10	1.990E-16	-1.000E+00	1.340E-12	2.110E-08
EFFECTIVE	8.800E-18	6.095E-12	1.274E-10	2.120E-16	-1.000E+00	1.380E-12	7.400E-09
SKIN (FGR)	4.490E-17	4.082E-10	8.531E-09	1.420E-14	-1.000E+00	0.000E+00	0.000E+00
Tc-101							
GONADS	1.570E-14	2.127E-12	1.411E-11	7.980E-17	-1.000E+00	2.500E-13	5.800E-11
BREAST	1.800E-14	2.063E-12	1.369E-11	7.740E-17	-1.000E+00	3.030E-13	8.970E-12
LUNGS	1.540E-14	1.935E-12	1.284E-11	7.260E-17	-1.000E+00	2.830E-11	3.860E-12
RED MARR	1.460E-14	1.946E-12	1.291E-11	7.300E-17	-1.000E+00	3.190E-13	1.470E-11
BONE SUR	3.210E-14	3.332E-12	2.210E-11	1.250E-16	-1.000E+00	2.800E-13	6.750E-12
THYROID	1.590E-14	1.983E-12	1.316E-11	7.440E-17	-1.000E+00	7.720E-12	2.910E-12
REMAINDER	1.470E-14	1.885E-12	1.250E-11	7.070E-17	-1.000E+00	3.520E-12	1.270E-09
EFFECTIVE	1.610E-14	2.031E-12	1.347E-11	7.620E-17	-1.000E+00	4.840E-12	3.990E-10
SKIN (FGR)	4.770E-14	4.691E-12	3.112E-11	1.760E-16	-1.000E+00	0.000E+00	0.000E+00
Eu-154							
GONADS	6.000E-14	1.985E-11	2.441E-10	7.100E-16	-1.000E+00	1.170E-08	6.140E-10
BREAST	6.810E-14	1.904E-11	2.341E-10	6.810E-16	-1.000E+00	1.550E-08	7.600E-11
LUNGS	5.990E-14	1.809E-11	2.224E-10	6.470E-16	-1.000E+00	7.920E-08	1.570E-11
RED MARR	5.870E-14	1.834E-11	2.255E-10	6.560E-16	-1.000E+00	1.060E-07	1.330E-10
BONE SUR	9.430E-14	2.720E-11	3.345E-10	9.730E-16	-1.000E+00	5.230E-07	5.240E-11
THYROID	6.150E-14	1.884E-11	2.317E-10	6.740E-16	-1.000E+00	7.140E-09	4.640E-12
REMAINDER	5.750E-14	1.775E-11	2.183E-10	6.350E-16	-1.000E+00	1.130E-07	5.870E-09
EFFECTIVE	6.140E-14	1.890E-11	2.324E-10	6.760E-16	-1.000E+00	7.730E-08	1.950E-09
SKIN (FGR)	8.290E-14	7.967E-11	9.799E-10	2.850E-15	-1.000E+00	0.000E+00	0.000E+00
Eu-155							
GONADS	2.490E-15	2.336E-11	3.231E-11	1.440E-15	-1.000E+00	3.560E-10	1.510E-10
BREAST	2.950E-15	2.222E-11	3.074E-11	1.370E-15	-1.000E+00	6.140E-10	2.560E-11
LUNGS	2.220E-15	2.141E-11	2.962E-11	1.320E-15	-1.000E+00	1.190E-08	9.390E-12
RED MARR	1.850E-15	2.190E-11	3.029E-11	1.350E-15	-1.000E+00	1.430E-08	3.670E-11
BONE SUR	8.090E-15	3.033E-11	4.196E-11	1.870E-15	-1.000E+00	1.520E-07	1.340E-11
THYROID	2.410E-15	2.174E-11	3.007E-11	1.340E-15	-1.000E+00	2.400E-10	1.470E-12
REMAINDER	2.070E-15	2.125E-11	2.939E-11	1.310E-15	-1.000E+00	1.110E-08	1.450E-09
EFFECTIVE	2.490E-15	2.238E-11	3.096E-11	1.380E-15	-1.000E+00	1.120E-08	4.840E-10
SKIN (FGR)	3.390E-15	8.273E-11	1.144E-10	5.100E-15	-1.000E+00	0.000E+00	0.000E+00
Eu-156							
GONADS	6.570E-14	1.191E-13	2.661E-13	5.480E-18	-1.000E+00	6.120E-10	4.020E-12
BREAST	7.420E-14	1.158E-13	2.588E-13	5.330E-18	-1.000E+00	3.640E-10	3.000E-12
LUNGS	6.630E-14	1.060E-13	2.370E-13	4.880E-18	-1.000E+00	1.840E-08	2.890E-12
RED MARR	6.560E-14	1.058E-13	2.365E-13	4.870E-18	-1.000E+00	1.140E-09	6.570E-12
BONE SUR	9.580E-14	1.862E-13	4.162E-13	8.570E-18	-1.000E+00	2.760E-09	6.460E-12
THYROID	6.780E-14	1.106E-13	2.472E-13	5.090E-18	-1.000E+00	2.160E-10	2.860E-12
REMAINDER	6.410E-14	1.036E-13	2.316E-13	4.770E-18	-1.000E+00	3.910E-09	6.130E-10
EFFECTIVE	6.750E-14	1.125E-13	2.515E-13	5.180E-18	-1.000E+00	3.820E-09	1.870E-10
SKIN (FGR)	9.980E-14	1.173E-11	2.622E-11	5.400E-16	-1.000E+00	0.000E+00	0.000E+00
La-143							
GONADS	5.040E-15	4.689E-13	9.642E-12	1.630E-17	-1.000E+00	6.530E-13	1.250E-10
BREAST	5.700E-15	5.150E-13	1.059E-11	1.790E-17	-1.000E+00	3.200E-13	9.740E-11
LUNGS	5.070E-15	1.602E-13	3.295E-12	5.570E-18	-1.000E+00	1.060E-10	9.620E-11
RED MARR	5.010E-15	1.249E-13	2.567E-12	4.340E-18	-1.000E+00	7.300E-13	5.430E-09
BONE SUR	7.590E-15	9.005E-13	1.852E-11	3.130E-17	-1.000E+00	7.290E-13	2.070E-08
THYROID	5.190E-15	2.779E-13	5.714E-12	9.660E-18	-1.000E+00	2.440E-13	9.430E-11
REMAINDER	4.900E-15	1.999E-13	4.111E-12	6.950E-18	-1.000E+00	1.050E-11	2.980E-09
EFFECTIVE	5.180E-15	3.251E-13	6.684E-12	1.130E-17	-1.000E+00	1.620E-11	2.230E-09
SKIN (FGR)	9.640E-14	1.496E-12	3.076E-11	5.200E-17	-1.000E+00	0.000E+00	0.000E+00
Nb-97							
GONADS	3.110E-14	3.889E-13	3.922E-13	6.510E-17	-1.000E+00	8.650E-13	1.590E-12
BREAST	3.550E-14	3.800E-13	3.832E-13	6.360E-17	-1.000E+00	1.120E-12	6.050E-13
LUNGS	3.100E-14	3.298E-13	3.326E-13	5.520E-17	-1.000E+00	1.560E-10	4.910E-13
RED MARR	3.010E-14	3.298E-13	3.326E-13	5.520E-17	-1.000E+00	1.140E-12	7.640E-13
BONE SUR	5.110E-14	5.753E-13	5.802E-13	9.630E-17	-1.000E+00	8.260E-13	5.400E-13
THYROID	3.180E-14	3.525E-13	3.555E-13	5.900E-17	-1.000E+00	9.200E-13	3.360E-13
REMAINDER	2.960E-14	3.262E-13	3.289E-13	5.460E-17	-1.000E+00	1.050E-11	1.790E-10
EFFECTIVE	3.180E-14	3.590E-13	3.621E-13	6.010E-17	-1.000E+00	2.240E-11	5.450E-11
SKIN (FGR)	6.510E-14	3.429E-11	3.458E-11	5.740E-15	-1.000E+00	0.000E+00	0.000E+00
Nb-95m							
GONADS	2.880E-15	2.206E-12	4.799E-11	8.561E-17	-1.000E+00	4.960E-11	2.420E-10
BREAST	3.310E-15	2.181E-12	4.739E-11	8.454E-17	-1.000E+00	4.530E-11	1.664E-10
LUNGS	2.770E-15	1.741E-12	3.815E-11	6.808E-17	-1.000E+00	3.070E-09	1.593E-10
RED MARR	2.590E-15	1.729E-12	3.793E-11	6.768E-17	-1.000E+00	5.870E-11	3.500E-09
BONE SUR	6.600E-15	3.287E-12	7.147E-11	1.275E-16	-1.000E+00	6.610E-11	7.990E-09
THYROID	2.890E-15	1.923E-12	4.201E-11	7.495E-17	-1.000E+00	3.860E-11	1.572E-10
REMAINDER	2.630E-15	1.746E-12	3.822E-11	6.819E-17	-1.000E+00	8.690E-10	7.196E-09

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

EFFECTIVE	2.930E-15	1.974E-12	4.308E-11	7.686E-17	-1.000E+00	6.590E-10	2.925E-09
SKIN (FGR)	1.120E-14	1.501E-10	3.360E-09	6.001E-15	-1.000E+00	0.000E+00	0.000E+00
Pm-147							
GONADS	7.480E-19	4.020E-11	2.343E-10	1.535E-15	-1.000E+00	8.250E-15	7.415E-10
BREAST	9.560E-19	3.853E-11	2.246E-10	1.472E-15	-1.000E+00	3.600E-14	1.361E-10
LUNGS	5.450E-19	3.657E-11	2.131E-10	1.397E-15	-1.000E+00	7.740E-08	6.335E-11
RED MARR	4.460E-19	3.736E-11	2.178E-10	1.427E-15	-1.000E+00	1.610E-09	2.435E-10
BONE SUR	2.180E-18	5.467E-11	3.189E-10	2.090E-15	-1.000E+00	2.010E-08	3.248E-10
THYROID	6.750E-19	3.741E-11	2.181E-10	1.429E-15	-1.000E+00	1.980E-14	4.383E-08
REMAINDER	5.260E-19	3.626E-11	2.113E-10	1.385E-15	-1.000E+00	1.560E-09	3.153E-09
EFFECTIVE	6.930E-19	3.825E-11	2.229E-10	1.461E-15	-1.000E+00	1.060E-08	2.514E-09
SKIN (FGR)	8.110E-16	1.033E-10	6.188E-10	4.056E-15	-1.000E+00	0.000E+00	0.000E+00
Pm-148							
GONADS	2.810E-14	6.812E-12	7.706E-11	2.450E-16	-1.000E+00	2.120E-10	5.410E-10
BREAST	3.190E-14	6.756E-12	7.643E-11	2.430E-16	-1.000E+00	7.190E-11	3.500E-10
LUNGS	2.830E-14	5.727E-12	6.479E-11	2.060E-16	-1.000E+00	1.370E-08	3.300E-10
RED MARR	2.790E-14	5.588E-12	6.322E-11	2.010E-16	-1.000E+00	1.070E-10	4.440E-10
BONE SUR	4.240E-14	1.273E-11	1.441E-10	4.580E-16	-1.000E+00	7.080E-11	8.300E-10
THYROID	2.890E-14	5.978E-12	6.762E-11	2.150E-16	-1.000E+00	3.820E-11	5.950E-08
REMAINDER	2.730E-14	5.644E-12	6.385E-11	2.030E-16	-1.000E+00	4.100E-09	1.490E-09
EFFECTIVE	2.890E-14	6.339E-12	7.171E-11	2.280E-16	-1.000E+00	2.950E-09	2.540E-09
SKIN (FGR)	7.970E-14	8.313E-12	9.405E-11	2.990E-16	-1.000E+00	0.000E+00	0.000E+00
Pm-149							
GONADS	5.300E-16	1.119E-11	1.789E-10	3.940E-16	-1.000E+00	3.610E-12	4.070E-11
BREAST	6.070E-16	1.082E-11	1.730E-10	3.810E-16	-1.000E+00	8.200E-13	1.210E-10
LUNGS	5.170E-16	1.016E-11	1.626E-10	3.580E-16	-1.000E+00	3.120E-09	1.020E-10
RED MARR	4.890E-16	1.022E-11	1.635E-10	3.600E-16	-1.000E+00	5.530E-12	9.440E-11
BONE SUR	1.100E-15	1.675E-11	2.679E-10	5.900E-16	-1.000E+00	5.010E-12	8.720E-11
THYROID	5.360E-16	1.053E-11	1.685E-10	3.710E-16	-1.000E+00	3.310E-13	4.760E-07
REMAINDER	4.910E-16	9.908E-12	1.585E-10	3.490E-16	-1.000E+00	1.390E-09	1.570E-10
EFFECTIVE	5.410E-16	1.067E-11	1.707E-10	3.760E-16	-1.000E+00	7.930E-10	1.440E-08
SKIN (FGR)	2.190E-14	1.825E-11	2.920E-10	6.430E-16	-1.000E+00	0.000E+00	0.000E+00
Pm-151							
GONADS	1.480E-14	2.523E-11	2.771E-11	2.320E-15	-1.000E+00	7.170E-11	2.330E-11
BREAST	1.700E-14	2.414E-11	2.652E-11	2.220E-15	-1.000E+00	1.590E-11	2.520E-11
LUNGS	1.440E-14	2.305E-11	2.532E-11	2.120E-15	-1.000E+00	1.640E-09	2.640E-11
RED MARR	1.370E-14	2.360E-11	2.592E-11	2.170E-15	-1.000E+00	2.720E-11	2.460E-11
BONE SUR	2.990E-14	3.327E-11	3.655E-11	3.060E-15	-1.000E+00	1.860E-11	2.190E-11
THYROID	1.500E-14	2.381E-11	2.616E-11	2.190E-15	-1.000E+00	6.180E-12	3.870E-09
REMAINDER	1.370E-14	2.283E-11	2.509E-11	2.100E-15	-1.000E+00	8.390E-10	1.650E-10
EFFECTIVE	1.510E-14	2.403E-11	2.640E-11	2.210E-15	-1.000E+00	4.730E-10	1.820E-10
SKIN (FGR)	3.320E-14	8.199E-11	9.007E-11	7.540E-15	-1.000E+00	0.000E+00	0.000E+00
Pm-148m							
GONADS	9.470E-14	1.585E-11	6.748E-11	6.270E-16	-1.000E+00	1.190E-09	3.630E-11
BREAST	1.080E-13	1.519E-11	6.468E-11	6.010E-16	-1.000E+00	1.240E-09	4.680E-11
LUNGS	9.420E-14	1.446E-11	6.156E-11	5.720E-16	-1.000E+00	3.590E-08	4.530E-11
RED MARR	9.140E-14	1.466E-11	6.242E-11	5.800E-16	-1.000E+00	1.360E-09	4.300E-11
BONE SUR	1.580E-13	2.161E-11	9.202E-11	8.550E-16	-1.000E+00	1.360E-09	4.070E-11
THYROID	9.680E-14	1.502E-11	6.393E-11	5.940E-16	-1.000E+00	1.050E-09	9.100E-08
REMAINDER	9.010E-14	1.418E-11	6.038E-11	5.610E-16	-1.000E+00	3.580E-09	1.550E-10
EFFECTIVE	9.680E-14	1.509E-11	6.425E-11	5.970E-16	-1.000E+00	6.100E-09	2.800E-09
SKIN (FGR)	1.180E-13	1.150E-10	4.897E-10	4.550E-15	-1.000E+00	0.000E+00	0.000E+00
Pr-144							
GONADS	1.900E-15	1.200E-11	1.202E-11	2.640E-15	-1.000E+00	2.410E-15	1.100E-11
BREAST	2.150E-15	1.145E-11	1.147E-11	2.520E-15	-1.000E+00	1.050E-14	1.170E-11
LUNGS	1.900E-15	1.100E-11	1.102E-11	2.420E-15	-1.000E+00	9.400E-11	1.260E-11
RED MARR	1.870E-15	1.127E-11	1.129E-11	2.480E-15	-1.000E+00	1.380E-14	1.090E-11
BONE SUR	2.990E-15	1.568E-11	1.571E-11	3.450E-15	-1.000E+00	1.470E-14	9.320E-12
THYROID	1.950E-15	1.127E-11	1.129E-11	2.480E-15	-1.000E+00	8.470E-15	6.210E-10
REMAINDER	1.840E-15	1.091E-11	1.093E-11	2.400E-15	-1.000E+00	1.400E-12	1.340E-10
EFFECTIVE	1.950E-15	1.150E-11	1.152E-11	2.530E-15	-1.000E+00	1.170E-11	6.660E-11
SKIN (FGR)	8.430E-14	4.477E-11	4.485E-11	9.850E-15	-1.000E+00	0.000E+00	0.000E+00
Pr-144m							
GONADS	3.250E-16	3.113E-11	5.489E-11	1.599E-15	-1.000E+00	0.000E+00	3.610E-11
BREAST	4.200E-16	2.971E-11	5.240E-11	1.526E-15	-1.000E+00	0.000E+00	3.850E-11
LUNGS	2.000E-16	2.886E-11	5.089E-11	1.482E-15	-1.000E+00	0.000E+00	3.750E-11
RED MARR	1.560E-16	2.965E-11	5.228E-11	1.523E-15	-1.000E+00	0.000E+00	3.650E-11
BONE SUR	8.160E-16	3.983E-11	7.024E-11	2.046E-15	-1.000E+00	0.000E+00	3.360E-11
THYROID	2.810E-16	2.852E-11	5.030E-11	1.465E-15	-1.000E+00	0.000E+00	1.790E-08
REMAINDER	1.980E-16	2.883E-11	5.084E-11	1.481E-15	-1.000E+00	0.000E+00	1.540E-10
EFFECTIVE	2.790E-16	2.989E-11	5.271E-11	1.535E-15	-1.000E+00	0.000E+00	6.080E-10
SKIN (FGR)	5.080E-16	9.826E-11	1.733E-10	5.047E-15	-1.000E+00	0.000E+00	0.000E+00
Sm-153							

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

GONADS	2.330E-15	1.465E-12	2.052E-11	5.200E-17	-1.000E+00	2.360E-11	0.000E+00
BREAST	2.820E-15	1.505E-12	2.107E-11	5.340E-17	-1.000E+00	5.670E-12	0.000E+00
LUNGS	1.970E-15	1.045E-12	1.464E-11	3.710E-17	-1.000E+00	2.050E-09	0.000E+00
RED MARR	1.620E-15	8.791E-13	1.231E-11	3.120E-17	-1.000E+00	6.660E-11	0.000E+00
BONE SUR	7.290E-15	4.254E-12	5.958E-11	1.510E-16	-1.000E+00	1.570E-10	0.000E+00
THYROID	2.220E-15	1.181E-12	1.653E-11	4.190E-17	-1.000E+00	1.510E-12	0.000E+00
REMAINDER	1.850E-15	1.042E-12	1.460E-11	3.700E-17	-1.000E+00	8.840E-10	0.000E+00
EFFECTIVE	2.280E-15	1.299E-12	1.819E-11	4.610E-17	-1.000E+00	5.310E-10	0.000E+00
SKIN (FGR)	1.450E-14	1.953E-12	2.734E-11	6.930E-17	-1.000E+00	0.000E+00	0.000E+00
Y-94							
GONADS	5.490E-14	5.455E-12	1.194E-11	2.530E-16	-1.000E+00	1.230E-13	0.000E+00
BREAST	6.210E-14	5.325E-12	1.166E-11	2.470E-16	-1.000E+00	4.400E-13	0.000E+00
LUNGS	5.500E-14	4.959E-12	1.086E-11	2.300E-16	-1.000E+00	1.480E-10	0.000E+00
RED MARR	5.420E-14	4.959E-12	1.086E-11	2.300E-16	-1.000E+00	4.180E-13	0.000E+00
BONE SUR	8.220E-14	9.120E-12	1.997E-11	4.230E-16	-1.000E+00	3.280E-13	0.000E+00
THYROID	5.650E-14	5.023E-12	1.100E-11	2.330E-16	-1.000E+00	4.120E-13	0.000E+00
REMAINDER	5.300E-14	4.829E-12	1.058E-11	2.240E-16	-1.000E+00	3.080E-12	0.000E+00
EFFECTIVE	5.620E-14	5.217E-12	1.142E-11	2.420E-16	-1.000E+00	1.890E-11	0.000E+00
SKIN (FGR)	1.800E-13	4.506E-11	9.867E-11	2.090E-15	-1.000E+00	0.000E+00	0.000E+00
Y-95							
GONADS	4.650E-14	4.607E-11	9.646E-10	1.600E-15	-1.000E+00	1.070E-13	2.060E-08
BREAST	5.190E-14	4.406E-11	9.224E-10	1.530E-15	-1.000E+00	3.170E-13	1.720E-08
LUNGS	4.720E-14	4.204E-11	8.802E-10	1.460E-15	-1.000E+00	8.040E-11	1.760E-08
RED MARR	4.730E-14	4.262E-11	8.922E-10	1.480E-15	-1.000E+00	3.200E-13	1.870E-08
BONE SUR	6.410E-14	6.105E-11	1.278E-09	2.120E-15	-1.000E+00	3.790E-13	1.740E-08
THYROID	4.840E-14	4.377E-11	9.163E-10	1.520E-15	-1.000E+00	2.790E-13	1.760E-08
REMAINDER	4.590E-14	4.147E-11	8.681E-10	1.440E-15	-1.000E+00	1.250E-12	2.210E-08
EFFECTIVE	4.790E-14	4.377E-11	9.163E-10	1.520E-15	-1.000E+00	1.020E-11	1.980E-08
SKIN (FGR)	1.590E-13	6.249E-11	1.308E-09	2.170E-15	-1.000E+00	0.000E+00	0.000E+00
Y-91m							
GONADS	2.490E-14	6.223E-11	1.102E-09	2.180E-15	-1.000E+00	3.210E-13	3.040E-09
BREAST	2.850E-14	5.966E-11	1.056E-09	2.090E-15	-1.000E+00	6.080E-13	2.650E-09
LUNGS	2.480E-14	5.710E-11	1.011E-09	2.000E-15	-1.000E+00	7.000E-11	2.620E-09
RED MARR	2.390E-14	5.824E-11	1.031E-09	2.040E-15	-1.000E+00	7.740E-13	2.950E-09
BONE SUR	4.280E-14	8.422E-11	1.491E-09	2.950E-15	-1.000E+00	6.210E-13	2.710E-09
THYROID	2.540E-14	5.852E-11	1.036E-09	2.050E-15	-1.000E+00	5.020E-13	2.740E-09
REMAINDER	2.370E-14	5.652E-11	1.001E-09	1.980E-15	-1.000E+00	3.740E-12	3.520E-09
EFFECTIVE	2.550E-14	5.966E-11	1.056E-09	2.090E-15	-1.000E+00	9.820E-12	3.040E-09
SKIN (FGR)	3.110E-14	7.251E-11	1.284E-09	2.540E-15	-1.000E+00	0.000E+00	0.000E+00
Br-82							
GONADS	1.270E-13	1.669E-11	3.530E-10	5.840E-16	-1.000E+00	1.690E-10	1.390E-08
BREAST	1.440E-13	1.596E-11	3.376E-10	5.585E-16	-1.000E+00	2.100E-10	1.240E-08
LUNGS	1.270E-13	1.517E-11	3.209E-10	5.309E-16	-1.000E+00	1.680E-09	1.270E-08
RED MARR	1.240E-13	1.542E-11	3.260E-10	5.394E-16	-1.000E+00	2.180E-10	1.320E-08
BONE SUR	1.990E-13	2.238E-11	4.734E-10	7.832E-16	-1.000E+00	1.920E-10	1.260E-08
THYROID	1.300E-13	1.588E-11	3.358E-10	5.556E-16	-1.000E+00	2.060E-10	1.260E-08
REMAINDER	1.220E-13	1.490E-11	3.152E-10	5.215E-16	-1.000E+00	3.310E-10	1.450E-08
EFFECTIVE	1.300E-13	1.585E-11	3.353E-10	5.546E-16	-1.000E+00	4.130E-10	1.350E-08
SKIN (FGR)	1.540E-13	5.253E-11	1.110E-09	1.836E-15	-1.000E+00	0.000E+00	0.000E+00
Br-83							
GONADS	3.740E-16	3.368E-13	3.429E-13	4.790E-17	-1.000E+00	1.130E-12	1.560E-12
BREAST	4.290E-16	3.297E-13	3.357E-13	4.690E-17	-1.000E+00	1.140E-12	5.170E-13
LUNGS	3.690E-16	3.002E-13	3.057E-13	4.270E-17	-1.000E+00	1.820E-10	3.890E-13
RED MARR	3.540E-16	2.932E-13	2.985E-13	4.170E-17	-1.000E+00	1.140E-12	8.590E-13
BONE SUR	6.750E-16	6.841E-13	6.965E-13	9.730E-17	-1.000E+00	1.140E-12	4.380E-13
THYROID	3.800E-16	3.044E-13	3.100E-13	4.330E-17	-1.000E+00	1.140E-12	2.660E-13
REMAINDER	3.520E-16	2.932E-13	2.985E-13	4.170E-17	-1.000E+00	5.310E-12	3.570E-10
EFFECTIVE	3.820E-16	3.227E-13	3.286E-13	4.590E-17	-1.000E+00	2.410E-11	1.080E-10
SKIN (FGR)	1.850E-14	7.241E-11	7.373E-11	1.030E-14	-1.000E+00	0.000E+00	0.000E+00
Br-84							
GONADS	9.160E-14	5.451E-12	9.607E-11	1.910E-16	-1.000E+00	2.840E-12	9.960E-10
BREAST	1.020E-13	5.280E-12	9.305E-11	1.850E-16	-1.000E+00	3.310E-12	1.590E-10
LUNGS	9.270E-14	4.852E-12	8.550E-11	1.700E-16	-1.000E+00	1.560E-10	6.630E-11
RED MARR	9.260E-14	4.880E-12	8.601E-11	1.710E-16	-1.000E+00	3.270E-12	4.390E-10
BONE SUR	1.280E-13	8.020E-12	1.413E-10	2.810E-16	-1.000E+00	2.990E-12	5.530E-10
THYROID	9.500E-14	5.109E-12	9.003E-11	1.790E-16	-1.000E+00	3.120E-12	5.250E-11
REMAINDER	8.990E-14	4.766E-12	8.399E-11	1.670E-16	-1.000E+00	1.870E-11	7.370E-09
EFFECTIVE	9.410E-14	5.137E-12	9.053E-11	1.800E-16	-1.000E+00	2.610E-11	2.560E-09
SKIN (FGR)	1.880E-13	5.565E-11	9.808E-10	1.950E-15	-1.000E+00	0.000E+00	0.000E+00
Am-242							
GONADS	6.090E-16	6.027E-11	4.425E-10	2.240E-15	-1.000E+00	1.940E-09	1.340E-09
BREAST	7.300E-16	5.758E-11	4.228E-10	2.140E-15	-1.000E+00	2.940E-12	1.800E-10
LUNGS	5.510E-16	5.596E-11	4.109E-10	2.080E-15	-1.000E+00	5.200E-08	4.010E-11

Palisades Design Basis Fuel Handling Accident AST Radiological Analysis

Calculation Number: NAI-1149-016 Rev. 1

RED MARR	4.770E-16	5.731E-11	4.208E-10	2.130E-15	-1.000E+00	1.320E-08	2.810E-10
BONE SUR	1.880E-15	7.776E-11	5.709E-10	2.890E-15	-1.000E+00	1.650E-07	9.770E-11
THYROID	5.940E-16	5.462E-11	4.010E-10	2.030E-15	-1.000E+00	2.520E-12	6.400E-12
REMAINDER	5.180E-16	5.569E-11	4.089E-10	2.070E-15	-1.000E+00	8.540E-09	6.260E-09
EFFECTIVE	6.150E-16	5.812E-11	4.267E-10	2.160E-15	-1.000E+00	1.580E-08	2.280E-09
SKIN (FGR)	8.200E-15	2.217E-10	1.628E-09	8.240E-15	-1.000E+00	0.000E+00	0.000E+00
Np-238							
GONADS	2.660E-14	7.315E-13	9.675E-13	4.740E-17	-1.000E+00	1.990E-09	3.770E-12
BREAST	3.020E-14	7.007E-13	9.267E-13	4.540E-17	-1.000E+00	4.180E-11	7.070E-13
LUNGS	2.650E-14	6.713E-13	8.879E-13	4.350E-17	-1.000E+00	3.470E-09	2.720E-13
RED MARR	2.610E-14	6.852E-13	9.063E-13	4.440E-17	-1.000E+00	1.690E-08	1.070E-12
BONE SUR	3.990E-14	9.923E-13	1.312E-12	6.430E-17	-1.000E+00	2.100E-07	6.060E-13
THYROID	2.730E-14	6.590E-13	8.716E-13	4.270E-17	-1.000E+00	2.450E-11	5.290E-14
REMAINDER	2.550E-14	6.682E-13	8.838E-13	4.330E-17	-1.000E+00	2.550E-09	1.240E-09
EFFECTIVE	2.720E-14	7.007E-13	9.267E-13	4.540E-17	-1.000E+00	1.000E-08	3.740E-10
SKIN (FGR)	4.310E-14	1.667E-10	2.204E-10	1.080E-14	-1.000E+00	0.000E+00	0.000E+00
Pu-243							
GONADS	1.020E-15	1.978E-11	2.034E-11	2.540E-15	-1.000E+00	1.670E-12	6.990E-11
BREAST	1.210E-15	1.885E-11	1.938E-11	2.420E-15	-1.000E+00	2.750E-13	1.540E-11
LUNGS	9.280E-16	1.846E-11	1.898E-11	2.370E-15	-1.000E+00	2.270E-10	8.400E-12
RED MARR	7.840E-16	1.900E-11	1.954E-11	2.440E-15	-1.000E+00	5.770E-12	1.930E-11
BONE SUR	3.230E-15	2.484E-11	2.554E-11	3.190E-15	-1.000E+00	6.530E-11	7.400E-12
THYROID	9.910E-16	1.768E-11	1.818E-11	2.270E-15	-1.000E+00	1.130E-13	1.160E-12
REMAINDER	8.660E-16	1.853E-11	1.906E-11	2.380E-15	-1.000E+00	4.690E-11	5.200E-10
EFFECTIVE	1.030E-15	1.916E-11	1.970E-11	2.460E-15	-1.000E+00	4.440E-11	1.790E-10
SKIN (FGR)	8.150E-15	9.111E-11	9.368E-11	1.170E-14	-1.000E+00	0.000E+00	0.000E+00