

## NAI Report Release

Calculation Number: NAI-1149-015

Revision Number: 2


Title: Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Description:

This calculation analyzes the radiological consequences of the Control Rod Ejection event presented in Section 14.16 of the Palisades FSAR using the AST dose calculation methodology described in USNRC Reg. Guide 1.183.

Revision 1 is issued to correct a numbering error with the calculation sections. No other items (including results) have been changed.

Revision 2 is issued to credit the reduction in control room unfiltered inleakage afforded by the installation of bubble-tight dampers.

  
Revision Author  
Jeff Voskuil

06-08-2006  
Date

  
Revision Reviewer  
Jim Harrell

6-08-06  
Date

  
NAI Management  
Tom George

Jun 8, 2006  
Date

## NAI Calculation Approval

Calculation Number: NAI-1149-015

Revision Number: 2


Title: Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Description:

This calculation analyzes the radiological consequences of the Control Rod Ejection event presented in Section 14.16 of the Palisades FSAR using the AST dose calculation methodology described in USNRC Reg. Guide 1.183.

Revision 1 is issued to correct a numbering error with the calculation sections. No other items (including results) have been changed.

Revision 2 is issued to credit the reduction in control room unfiltered inleakage afforded by the installation of bubble-tight dampers.

  
Revision Author  
Jeff Voskuil


06-07-2006  
Date

## Scope of Review:

## Review included:

- A review of calculation methods was completed for consistency with plant-specific and generic regulatory requirements and guidance.
- Computer codes (RADTRAD-NAI) were checked for appropriate qualification.
- Calculation and code inputs and assumptions were verified against IAM document(s) and/or checked for reasonableness and conservatism.
- Computations were checked for correctness.
- References were verified as appropriate.
- Outputs from spreadsheets and utility programs were checked.
- Reported Results were verified against computer outputs.
- Results and conclusions were reviewed for reasonableness.
- Cases run were checked against procurement documents.

**Design Verification** – See Attachment 1 for Rev. 0 comments and responses. There are no Rev. 1 comments. There are no Rev. 2 comments.

  
\_\_\_\_\_  
Revision Reviewer  
Jim Harrell

6-8-06  
\_\_\_\_\_  
Date

Check items in the following lists to verify that project documentation and engineering calculations are complete. Mark any items that are not applicable with N/A notation.

Project Documentation Checklist:

- N/A
- Project QA Plan.
  - Project Organization.
  - Project Work Scope and Design Plan.
  - Project Calculation and Document Index.
  - Project QA Requirements.
  - Project Engineer Training and Qualification Forms.
  - Project QA Training Certification Forms.
  - Project Correspondence.

Engineering Calculations Checklist:

- Identification by subject, originator, reviewer, date and Project so that the calculation is retrievable.
- Table of contents.
- Statement of the objective of the analysis.
- Analysis inputs and their sources.
- Assumptions and how they were developed or determined.
- Hand calculations.
- Identification of computer calculations, including computer type, computer program name and version, code input and output.
- Conclusions.
- Review summary.
- Responses to review comments.
- References.
- Each page of the calculation shall be numbered and the first page shall indicate the total number of pages. The calculation pages may be numbered by sections with the first page of the section indicating the total number of pages in the section.
- The Calculation Approval Sheet shall be signed and dated by the originator.

**Table of Contents**

**1.0 INTRODUCTION ..... 7**

**2.0 SUMMARY OF RESULTS ..... 8**

**3.0 DESIGN INPUT ..... 9**

    3.1 SOURCE TERM INPUT ..... 9

    3.2 OTHER INPUT ..... 9

**4.0 ASSUMPTIONS ..... 9**

**5.0 ACCEPTANCE CRITERIA..... 10**

**6.0 COMPUTER CODES ..... 10**

**7.0 CALCULATIONS..... 11**

    7.1 SOURCE TERM CALCULATIONS ..... 11

    7.2 CRE SECONDARY SIDE RELEASE NOBLE GAS DOSE FOR DNB..... 12

        7.2.1 PCS Compartment ..... 14

        7.2.2 Environment Compartment..... 14

        7.2.3 Control Room Compartment..... 14

        7.2.4 Steam Generator Leakage to Environment..... 15

        7.2.5 Control Room Unfiltered Makeup ..... 15

        7.2.6 Control Room Filtered Makeup..... 16

        7.2.7 Control Room Unfiltered Inleakage ..... 16

        7.2.8 Control Room Exhaust..... 16

        7.2.9 Plant Power and Release Information..... 17

        7.2.10 Dose Location Information..... 17

        7.2.11 Source Term..... 19

        7.2.12 CRE DNB Noble Gas Release Fraction Timing File..... 19

    7.3 CRE SECONDARY SIDE RELEASE NOBLE GAS DOSE FOR FCM..... 21

    7.4 CRE SECONDARY SIDE RELEASE IODINE DOSE FOR DNB ..... 22

        7.4.1 PCS Compartment ..... 24

        7.4.2 Environment and Control Room Compartments..... 24

        7.4.3 Steam Generators Compartment ..... 24

        7.4.4 Control Room Pathways..... 24

        7.4.5 Leakage to Steam Generators – Pathway 1..... 24

        7.4.6 Steam Release From Steam Generators – Pathway 6..... 25

        7.4.7 Plant Power and Release Information..... 26

        7.4.8 Dose Location Information..... 26

        7.4.9 Source Term..... 26

        7.4.10 CRE DNB Secondary Leakage Iodine Release Fraction Timing File ..... 27

    7.5 CRE SECONDARY SIDE RELEASE IODINE DOSE FOR FCM ..... 28

    7.6 CRE DNB CONTAINMENT LEAKAGE MODEL ..... 29

        7.6.1 Containment Compartment..... 31

        7.6.2 Environment and Control Room Compartments..... 31

        7.6.3 Containment Leakage..... 31

        7.6.4 Control Room Unfiltered Makeup ..... 31

        7.6.5 Control Room Filtered Makeup..... 32

        7.6.6 Control Room Unfiltered Inleakage ..... 32

        7.6.7 Control Room Exhaust..... 32

        7.6.8 Plant Power and Release Information..... 33

7.6.9	<i>Dose Location Information</i> .....	33
7.6.10	<i>Source Term</i> .....	34
7.6.11	<i>DNB Containment Leakage Release Fraction Timing File</i> .....	34
7.7	CRE FCM CONTAINMENT LEAKAGE MODEL .....	36
<b>8.0</b>	<b>REFERENCES</b> .....	<b>37</b>
<b>9.0</b>	<b>CRE RADTRAD-NAI ANALYSIS FILES</b> .....	<b>38</b>

**Tables**

Table 2-1	CRE Secondary Side Release Radiological Dose Results.....	8
Table 2-2	CRE Containment Release Radiological Dose Results.....	8
Table 7-1	DNB Noble Gas Release Fraction Timing File.....	20
Table 7-2	CRE Secondary FCM Noble Gas Release Fraction Timing File.....	21
Table 7-3	CRE DNB Secondary Leakage Iodine Release Fraction Timing File.....	27
Table 7-4	CRE FCM Secondary Leakage Iodine Release Fraction Timing File.....	28
Table 7-5	CRE Containment DNB Release Fraction Timing File.....	35
Table 7-6	CRE Containment FCM Release Fraction Timing File .....	36

**Figures**

Figure 1	Noble Gas RADTRAD-NAI Model.....	13
Figure 2	Secondary Side Leakage RADTRAD-NAI Model .....	23
Figure 3	Containment Leakage RADTRAD-NAI Model.....	30

**Attachments**

Attachment 1	Verification Comments for Calculation NAI-1149-015 Rev. 0.....	40
Attachment 2	LOCA Design Basis AST Nuclide Inventory File.....	41
Attachment 3	RADTRAD-NAI Dose Conversion Factor File .....	55
Attachment 4	Secondary Side Release DNB Noble Gas Dose .....	72
Attachment 5	Secondary Side Release FCM Noble Gas Dose .....	106
Attachment 6	Secondary Side Release DNB Iodine Release Dose .....	140
Attachment 7	Secondary Side Release FCM Iodine Release Dose .....	196
Attachment 8	Containment Release DNB Dose.....	252
Attachment 9	Containment Release FCM Dose .....	288

## 1.0 Introduction

The purpose of this calculation is to analyze the radiological consequences of the Control Rod Ejection (CRE) event presented in Section 14.16 of the Palisades FSAR (Reference 2). This analysis will use the AST dose calculation methodology described in Regulatory Guide 1.183 (Reference 1). Appendix H of Reg. Guide 1.183 provides the requirements for performing a dose analysis of a CRE event. Best-estimate inputs are used.

Appendix H of Reg. Guide 1.183 specifies that two cases must be analyzed for the CRE:

- 100% of the activity released from the damaged fuel is assumed to be instantaneously released to the containment atmosphere.
- 100% of the activity released from the damaged fuel is assumed to dissolve in the primary coolant and be available for release via steam generator tube leakage.

The activity released from the damaged fuel varies according to the type of fuel damage. Appendix H of Reg. Guide 1.183 states:

*“Assumptions acceptable to the NRC staff regarding core inventory are in Regulatory Position 3 of this guide. For the rod ejection accident, the release from the breached fuel is based on the estimate of the number of fuel rods breached and the assumption that 10% of the core inventory of the noble gases and iodines is in the fuel gap. The release attributed to fuel melting is based on the fraction of the fuel that reaches or exceeds the initiation temperature for fuel melting and the assumption that 100% of the noble gases and 25% of the iodines contained in that fraction are available for release from containment. For the secondary system release pathway, 100% of the noble gases and 50% of the iodines in that fraction are released to the reactor coolant.”*

“Breached” fuel is interpreted to mean fuel that experiences DNB.

The previous Palisades CRE dose calculation (Reference 14) analyzed two different containment release scenarios. The two scenarios are the CHP (containment high pressure) case and CHR (containment high radiation) case. The CHR case results in no actuation of the containment sprays; therefore, the CHR case bounds the CHP case. Thus, the CHP case will not be analyzed. It should also be noted that Appendix H of Reg. Guide 1.183 does not require consideration of dose from SIRWT and ECCS leakage for the CRE dose evaluation.

## 2.0 Summary of Results

The results of the CRE secondary side release and containment release cases are provided below. The analysis assumes fuel failure of 14.7% DNB (Departure from Nucleate Boiling) and 0.5% FCM (Fuel Centerline Melt). A bounding value of 0.268 rem for the control room shine dose (cloud plus filter dose) is also included for the secondary side release (Table 1 of Reference 13) and a value of 0.296 rem is included for the containment release (cloud plus filter plus containment shine doses). The steam release for this event is the same as that used for the SGTR, in addition the secondary side initial activity is the same as the SGTR, also the control room unfiltered inleakage used for the SGTR was 100 cfm, which bounds the 10 cfm in this analysis; therefore the secondary side initial activity dose from the SGTR event (Reference 17) was used for the CRE secondary side release case.

**Table 2-1 CRE Secondary Side Release Radiological Dose Results**

Dose Contribution	TEDE Dose (rem)		
	EAB	LPZ	CR
DNB Fuel Noble Gas Dose	9.4158E-01	1.6591E-01	2.7379E-01
FCM Fuel Noble Gas Dose	3.2027E-01	5.6431E-02	9.3126E-02
DNB Fuel Iodine Dose	1.2780E+00	1.8440E-01	4.3813E-01
FCM Fuel Iodine Dose	1.5972E-01	2.3258E-02	5.5187E-02
Secondary Initial Activity	1.0675E-03	2.6467E-04	7.3129E-03
Control Room Shine Dose			0.268
<b>Total</b>	<b>2.70</b>	<b>0.43</b>	<b>1.14</b>
<b>Acceptance Criteria</b>	<b>6.3</b>	<b>6.3</b>	<b>5</b>
<b>Control Room Unfiltered Inleakage = 10 cfm</b>			

**Table 2-2 CRE Containment Release Radiological Dose Results**

Dose Contribution	TEDE Dose (rem)		
	EAB	LPZ	CR
DNB Fuel Dose	2.4328E+00	6.3208E-01	7.8420E-01
FCM Fuel Dose	1.8265E-01	4.6236E-02	5.4958E-02
Control Room Shine Dose			0.296
<b>Total</b>	<b>2.62</b>	<b>0.68</b>	<b>1.14</b>
<b>Acceptance Criteria</b>	<b>6.3</b>	<b>6.3</b>	<b>5</b>
<b>Control Room Unfiltered Inleakage = 10 cfm</b>			



### 3.0 Design Input

#### 3.1 Source Term Input

Attachment 24 of Reference 7 presents the design basis AST source term for the Palisades LOCA. The “Curies” entry of this file provides the source term for the entire core with an average assembly burnup of 39,300 MWD/MTU and a core power level of 2703 MW<sub>th</sub> (including uncertainty). The corresponding RADTRAD-NAI nuclide inventory file (*palisades\_loca\_db\_ast.nif*) is listed in Attachment 2.

Section 3.4 of Reg. Guide 1.183 specifies the radionuclide groups that should be considered for radiological analyses. Reference 8 provides a listing of the individual nuclides and dose conversion factors used for the analyses presented in this calculation. The data provided in Reference 8 are consistent with Section 3.4 of Reg. Guide 1.183. The dose conversion factors provided in Reference 8 were obtained from Table 2.1 of Federal Guidance Report 11 and Table III.1 of Federal Guidance Report 12. The RADTRAD-NAI dose conversion factor file, *nai-1101-001rev0.dcf*, is provided in Attachment 3.

#### 3.2 Other Input

References 5, 15, and 16 list other input, approved by Palisades, used in the development of the Palisades CRE RADTRAD-NAI models.

Control room unfiltered inleakage is taken as 10 cfm based on the modification to install bubble tight dampers and subsequent post-modification testing, as indicated in the assumption section below.

### 4.0 Assumptions

- Operator action and makeup flow from the auxiliary feedwater system are assumed to maintain a constant mass on the secondary side of the steam generators.
- The steam generator masses are assumed to be equal to the minimum (HFP) value. This is a conservative assumption that maximizes the nuclide concentration available for release from the steam generators.
- For the secondary side CRE release case, all noble gases are assumed to leak directly to the environment.
- A PCS liquid volume equal to the primary side liquid volume minus the pressurizer liquid volume was used. A smaller PCS volume produces a higher PCS activity concentration.
- The thermal-hydraulic analysis that provides the steam release data for the plant cooldown includes an error in the decay heat determination. To account for this error, the steam release is increased by 20% over the first 30 minutes of the event.
- The control room unfiltered inleakage is assumed to be 10 cfm. Control room HVAC dampers D-1, D-2, D-8, D-9, D-15, and D-16 are scheduled to be replaced prior to the end of Palisades refueling outage 19. Post-modification tracer gas testing to confirm control room envelope inleakage is also scheduled.

## 5.0 Acceptance Criteria

Per Section 4.4 and Table 6 of Reg. Guide 1.183, the acceptable dose limits for the Exclusion Area Boundary (EAB), Low Population Zone (LPZ), and Control Room (CR) for the CRE are:

### CRE Dose Limits

Area	Dose Criteria	
EAB	6.3 rem TEDE	(for the worst two hour period)
LPZ	6.3 rem TEDE	(for 30 days)
Control Room *	5 rem TEDE	(for 30 days)

\*Control room dose limit is specified in 10CFR50.67

## 6.0 Computer Codes

The following computer code was used for performing the analyses presented in this calculation:

Computer Code	Version	Reference	Purpose
RADTRAD-NAI	1.1a(QA)	3	Radiological Dose Calculations

RADTRAD-NAI (Reference 3) is qualified and maintained under the Numerical Applications Inc. QA program (Reference 4). This QA program meets the requirements of 10CFR50 Appendix B with code error reporting per 10CFR21. RADTRAD-NAI is accessed via a controlled access web-based interface that provides a front-end for developing and submitting input models. The input developed via the interface is submitted to the RADTRAD-NAI solver that runs on an AMD-ATHLON based personal computer running LINUX.

## 7.0 Calculations

Two release Scenarios were evaluated for the CRE:

Scenario 1 - 100% of the activity released from the damaged fuel was assumed to be instantaneously released to the containment atmosphere. The dose for this release location consists of two cases:

- Dose from DNB fuel (Section 7.6)
- Dose from FCM fuel (Section 7.7)

Scenario 2 - 100% of the activity released from the damaged fuel was assumed to dissolve in the primary coolant and be available for release via steam generator tube leakage and MSSV/ADV steam release. This release path required modeling of four cases:

- Noble gas dose from DNB Fuel (Section 7.2)
- Noble gas dose from FCM Fuel (Section 7.3)
- Iodine dose from DNB fuel (Section 7.4)
- Iodine dose from FCM fuel (Section 7.5)
- The steam release for this event is the same as that used for the SGTR, in addition the secondary side initial activity is the same as the SGTR; therefore, the secondary side initial activity dose from the SGTR event (Reference 17) was used for the CRE secondary side release case.

The RADTRAD-NAI models for the containment release are similar to a LOCA without containment spray.

Section 7 of Appendix H and Section 5 of Appendix E to Reg. Guide 1.183 set the requirements for the transport, reduction, and release of radionuclides for the secondary side release path for the CRE.

The transport model specified by Reg. Guide 1.183 for a noble gas release from the secondary side is different than that specified for the non-noble gas nuclides; therefore, two separate RADTRAD-NAI models were required for determining the secondary side release dose.

### 7.1 Source Term Calculations

Section 1 of Appendix H to Reg. Guide 1.183 specifies different nuclide group release fractions for fuel that experiences DNB and for fuel that experiences fuel centerline melt (FCM). In addition, the percent of fuel damaged is different for DNB and FCM and the release fraction for FCM damage differs for the two release locations. Therefore, The the LOCA source term file will be adjusted to account for:

- fraction of fuel damaged
- the radial peaking factor of 2.04
- the release location (containment or secondary release)

These adjustments are accomplished via a multiplier applied through the "plant power" entry in the RADTRAD input file as will be discussed in subsequent sections of the calculation.

## 7.2 CRE Secondary Side Release Noble Gas Dose for DNB

Section 7.3 of Appendix H to Reg. Guide 1.183 specifies the method for handling the noble gas release for the secondary side:


*“All noble gas radionuclides released to the secondary system are assumed to be released to the environment without reduction or mitigation.”*

The RADTRAD-NAI model developed for the noble gas dose calculation for the noble gas released from the damaged fuel consists of three compartments and 5 pathways (see Figure 1):

Compartment Description	Compartment Number	RADTRAD-NAI Compartment Type
PCS	1	(3) Normal
Environment	2	(2) Environment
Control Room	3	(1) Control Room

Pathway Description	Compartment Connections	Pathway Number	RADTRAD-NAI Pathway Type
SG Tube Leakage	1 to 2	1	Filtered
Control Room Unfiltered Makeup	2 to 3	2	Filtered
Control Room Filtered Makeup	2 to 3	3	Filtered
Control Room Unfiltered Inleakage	2 to 3	4	Filtered
Control Room Exhaust	3 to 2	5	Filtered

Figure 1 Noble Gas RADTRAD-NAI Model

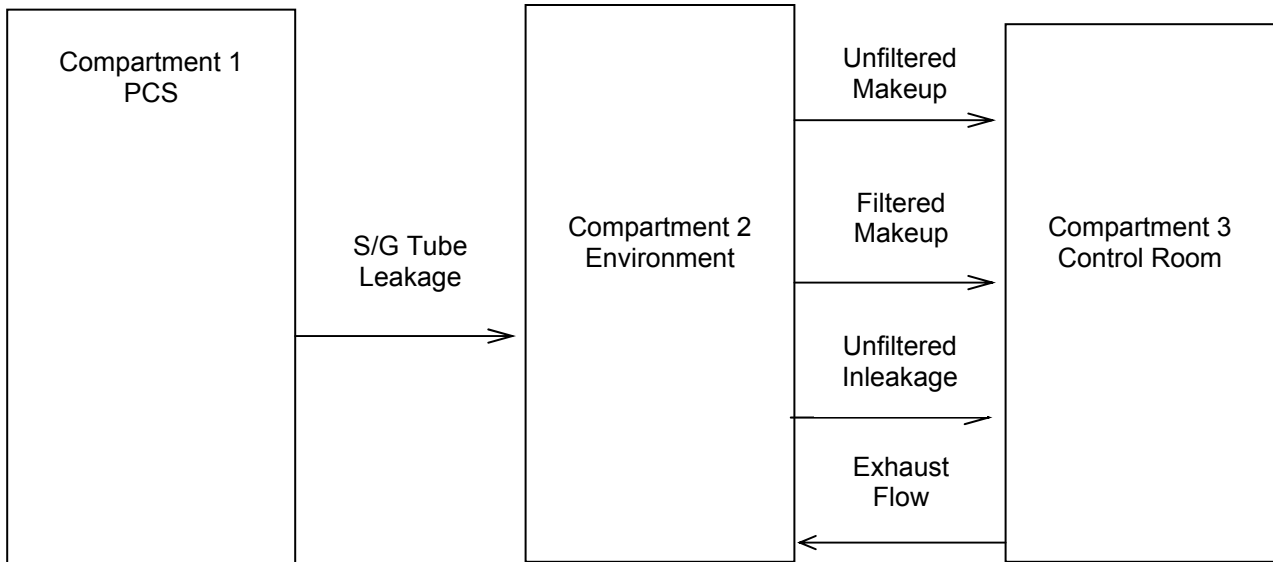

The subsections that follow describe the RADTRAD-NAI input for the noble gas model. The noble gas RADTRAD-NAI model was set up on a mass flow basis rather than the typical volumetric flow basis; therefore, the PCS volume was specified as lb<sub>m</sub> and the steam generator tube leakage was specified as lb<sub>m</sub>/min. The file name for this model is *pal\_CRE\_DNB\_sec\_ng\_db\_ast.psf*. The output for this case is provided in Attachment 4.

### 7.2.1 PCS Compartment

To conservatively maximize the PCS nuclide concentration from the damaged fuel, the minimum PCS volume minus the pressurizer volume was used. From Reference 15, this volume is 9400 ft<sup>3</sup>. At system conditions of 2060 psia and 560°F (Reference 15), the PCS mass is:

$$(9400 \text{ ft}^3) / (2.171017\text{E-}2 \text{ ft}^3/\text{lb}_m) = 432,976.8 \text{ lb}_m$$

The following input was specified for the PCS Compartment:

Volume	432,976.8 lb <sub>m</sub>	
Source Fraction	1.0	100% of source term applied to PCS volume
Recirculation Filters	no	
Natural Deposition	no	

### 7.2.2 Environment Compartment

The only required input for the environment compartment is volume. This value is a “dummy” value; however, an input is required for this field. An arbitrary value of 2.0E20 ft<sup>3</sup> was specified.

### 7.2.3 Control Room Compartment

The control room volume was set to 35,923 ft<sup>3</sup> (Reference 15). The control room HVAC system is assumed to be operating in normal mode at the beginning of the event. The operators are assumed to place the control room into emergency filtration mode at 20 minutes (Reference 5).

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	0.0	99	99	99
0.3333	1413.6	99	99	99
720.0	1413.6	99	99	99

**7.2.4 Steam Generator Leakage to Environment**

This pathway, which models the total steam generator tube leakage, connects the PCS (Compartment 1) with the Environment Compartment (Compartment 2). The limit for steam generator tube leakage is 432 gallons per day (0.3 gpm) to any single SG (Reference 16). Item 7.2 of Appendix H to Reg. Guide 1.183 states:

*“The density used in converting volumetric leak rates (e.g., gpm) to mass leak rates (e.g., lbm/hr) should be consistent with the basis of surveillance tests used to show compliance with leak rate technical specifications. These tests typically are based on cooled liquid. The facility’s instrumentation used to determine leakage typically is located on lines containing cool liquids. In most cases, the density should be assumed to be 1.0 gm/cc (62.4 lbm/ft3).”*

The total leak mass flow rate is:

$$\text{SG Tube Leak rate} = (0.3 \text{ gpm/SG})(2 \text{ SG})(0.13368 \text{ ft}^3/\text{gal})(62.4 \text{ lb}_m/\text{ft}^3) = 5.005 \text{ lb}_m/\text{min}$$

The tube leakage ceases at 8 hours (time that secondary side steam release ends):

Time (hours)	Flow Rate (lb/min)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	5.005	0	0	0
8.0	0.0	0	0	0
720.0	0.0	0	0	0

**7.2.5 Control Room Unfiltered Makeup**

The unfiltered makeup flow covers three time periods. A loss of offsite power is assumed to occur coincident with the CRE; therefore, from 0 to 1.5 minutes, the unfiltered flow rate consists of the base infiltration rate of 384.2 cfm (Reference 15). The control room normal makeup flow rate of 660 cfm is restored at 1.5 minutes. At 20 minutes, the control room enters recirculation mode.

**Unfiltered Makeup Flow**

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	384.2	0	0	0
0.025	660.0	0	0	0
0.3333	0.0	0	0	0
720.0	0.0	0	0	0

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**7.2.6 Control Room Filtered Makeup**

The control room filtered makeup flow of 1413.6 cfm starts at 20 minutes (time of control room isolation).

**Filtered Makeup Flow**

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	0.0	99	99	99
0.3333	1413.6	99	99	99
720.0	1413.6	99	99	99

**7.2.7 Control Room Unfiltered Inleakage**

The unfiltered inleakage was set to 10 cfm.

**Unfiltered Inleakage**

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	0.0	0	0	0
0.3333	10.0	0	0	0
720.0	10.0	0	0	0

**7.2.8 Control Room Exhaust**

The control room exhaust is equal to the sum of the control room intake and inleakage flows.

**Exhaust Flow**

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	384.2	0	0	0
0.025	660.0	0	0	0
0.3333	1423.6	0	0	0
720.0	1423.6	0	0	0



**7.2.9 Plant Power and Release Information**

The “plant power” entry is used to account for the fraction of fuel experiencing DNB and to account for the radial peaking factor:

Power = 2703 x 0.147 x 2.04 = 810.576

The start of the release was specified as 0.0 hours. “Dummy” values were specified for the iodine fractions (no iodine release for the Noble Gas case).

Start of first release time (hours)	0.0
Calculate decay	yes
Calculate daughters	yes
Iodine Fraction – aerosol	0.0
Iodine Fraction – elemental	0.97
Iodine Fraction – organic	0.03

**7.2.10 Dose Location Information**

Three dose locations were specified; the Exclusion Boundary (EAB), the Low Population Zone (LPZ), and the Control Room (CR). The X/Qs for the EAB and LPZ are from Table 5 of Reference 10. The breathing rates are from Section 4.1.3 of Reg. Guide 1.183:

Exclusion Boundary Data:

**EAB X/Q**

**X/Q Table 1**

Time (hours)	X/Q (sec/m <sup>3</sup> )
0.0	5.39E-4
720.0	5.39E-4

**EAB & LPZ Breathing Rate**

Time (hours)	Breathing Rate (m <sup>3</sup> /sec)
0.0	3.5E-4
8.0	1.8E-4
24.0	2.3E-4
720.0	2.3E-4

Low Population Zone Data:

**LPZ X/Q**

**X/Q Table 2**

Time (hours)	X/Q (sec/m <sup>3</sup> )
0.0	6.66E-5
2.0	3.03E-5
8.0	2.04E-5
24.0	8.67E-6
96.0	2.54E-6
720.0	2.54E-6

Control Room Data:

The breathing rates and occupancy factor for the control room are from Section 4.2.6 of Reg. Guide 1.183. For the first 1100 seconds (0.305556 hours) the release is via the most limiting SRV (see Section 7.4.6). After 0.305556 hours, the release is via the most limiting ADV. The X/Qs are from Table 4 of Reference 10.

**Control Room X/Q for Unfiltered Makeup Flow and Inleakage**

**X/Q Table 3**

Time (hours)	X/Q (sec/m <sup>3</sup> )
0.0	2.11E-2
0.305556	1.65E-2
2.0	1.34E-2
8.0	5.40E-3
24.0	4.03E-3
96.0	2.98E-3
720.0	2.98E-3

**Control Room X/Q for Filtered Makeup Flow**

**X/Q Table 4**

Time (hours)	X/Q (sec/m <sup>3</sup> )
0.0	7.96E-4
0.305556	7.36E-4
2.0	6.42E-4
8.0	2.43E-4
24.0	1.75E-4
96.0	1.28E-4
720.0	1.28E-4

**Control Room Breathing Rate**

Time (hours)	Breathing Rate (m <sup>3</sup> /sec)
0.0	3.5E-4
720.0	3.5E-4

**Control Room Occupancy Factor**

Time (hours)	Factor
0.0	1.0
24.0	0.6
96.0	0.4
720.0	0.4

**Dose Location Pathway Combinations**

Control Room Intake Path	Release Path	X/Q Table
2	1	3
3	1	4
4	1	3

**7.2.11 Source Term**

The LOCA source term is used for the CRE DNB fuel release. The corresponding nuclide inventory file is *palisades\_loca\_db\_ast.nif*. The LOCA source term data are modified via the RADTRAD-NAI power input value and via the release fraction timing file to produce the appropriate source term for the CRE DNB secondary release source term.

**7.2.12 CRE DNB Noble Gas Release Fraction Timing File**

According to Footnote 11 to Table 3 and per Section 1.0 of Appendix H to Reg. Guide 1.183, the noble gas release fraction for breached fuel (DNB) is 0.10. The release fraction timing file, *pal\_cre\_dnb\_sec\_ng.rft*, is listed below:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**Table 7-1 DNB Noble Gas Release Fraction Timing File**

```
Release Fraction and Timing Name:
Palisades CRE DNB Secondary NG Fuel Release
Duration (h): Design Basis Accident
  0.1000E-03  0.0000E+00  0.0000E+00  0.0000E+00
Noble Gases:
  0.1000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Iodine:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cesium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Tellurium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Strontium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Barium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Ruthenium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cerium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Lanthanum:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Non-Radioactive Aerosols (kg):
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
End of Release File
```

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

### 7.3 CRE Secondary Side Release Noble Gas Dose for FCM

The RADTRAD-NAI model used for this case is similar to that described in Section 7.2. The only items that were changed were the release fraction timing file along with corresponding "plant power".

The "plant power" entry was used to account for the fraction of fuel experiencing FCM and to account for the radial peaking factor:

$$\text{Plant Power} = 2703 \times 0.005 \times 2.04 = 27.5706$$

According Section 1.0 of Appendix H to Reg. Guide 1.183 the secondary side noble gas release fraction for FCM is 1.0. The release fraction timing file, *pal\_cre\_fcm\_sec\_ng.rft*, is listed below:

**Table 7-2 CRE Secondary FCM Noble Gas Release Fraction Timing File**

```

Release Fraction and Timing Name:
Palisades CRE FCM Secondary NG Fuel Release
Duration (h): Design Basis Accident
  0.1000E-03  0.0000E+00  0.0000E+00  0.0000E+00
Noble Gases:
  0.1000E+01  0.0000E+00  0.0000E+00  0.0000E+00
Iodine:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cesium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Tellurium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Strontium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Barium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Ruthenium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cerium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Lanthanum:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Non-Radioactive Aerosols (kg):
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
End of Release File

```

The file name for this model is *pal\_CRE\_FCM\_sec\_ng\_db\_ast.psf*. The output for this case is provided in Attachment 5.


**7.4 CRE Secondary Side Release Iodine Dose for DNB**

The CRE secondary side leakage RADTRAD-NAI model was used to determine the doses due to iodine released from the damaged (DNB) fuel. This model consists of four compartments and six pathways (see Figure 2):

Compartment Description	Compartment Number	RADTRAD-NAI Compartment Type
PCS	1	(3) Normal
Environment	2	(2) Environment
Control Room	3	(1) Control Room
Steam Generators	4	(3) Normal

Pathway Description	Compartment Connections	Pathway Number	RADTRAD-NAI Pathway Type
SG Tube Leakage	1 to 4	1	Filtered
Control Room Unfiltered Makeup	2 to 3	2	Filtered
Control Room Filtered Makeup	2 to 3	3	Filtered
Control Room Unfiltered Inleakage	2 to 3	4	Filtered
Control Room Exhaust	3 to 2	5	Filtered
Steam Release from ADV's	4 to 2	6	Filtered

Figure 2 Secondary Side Leakage RADTRAD-NAI Model

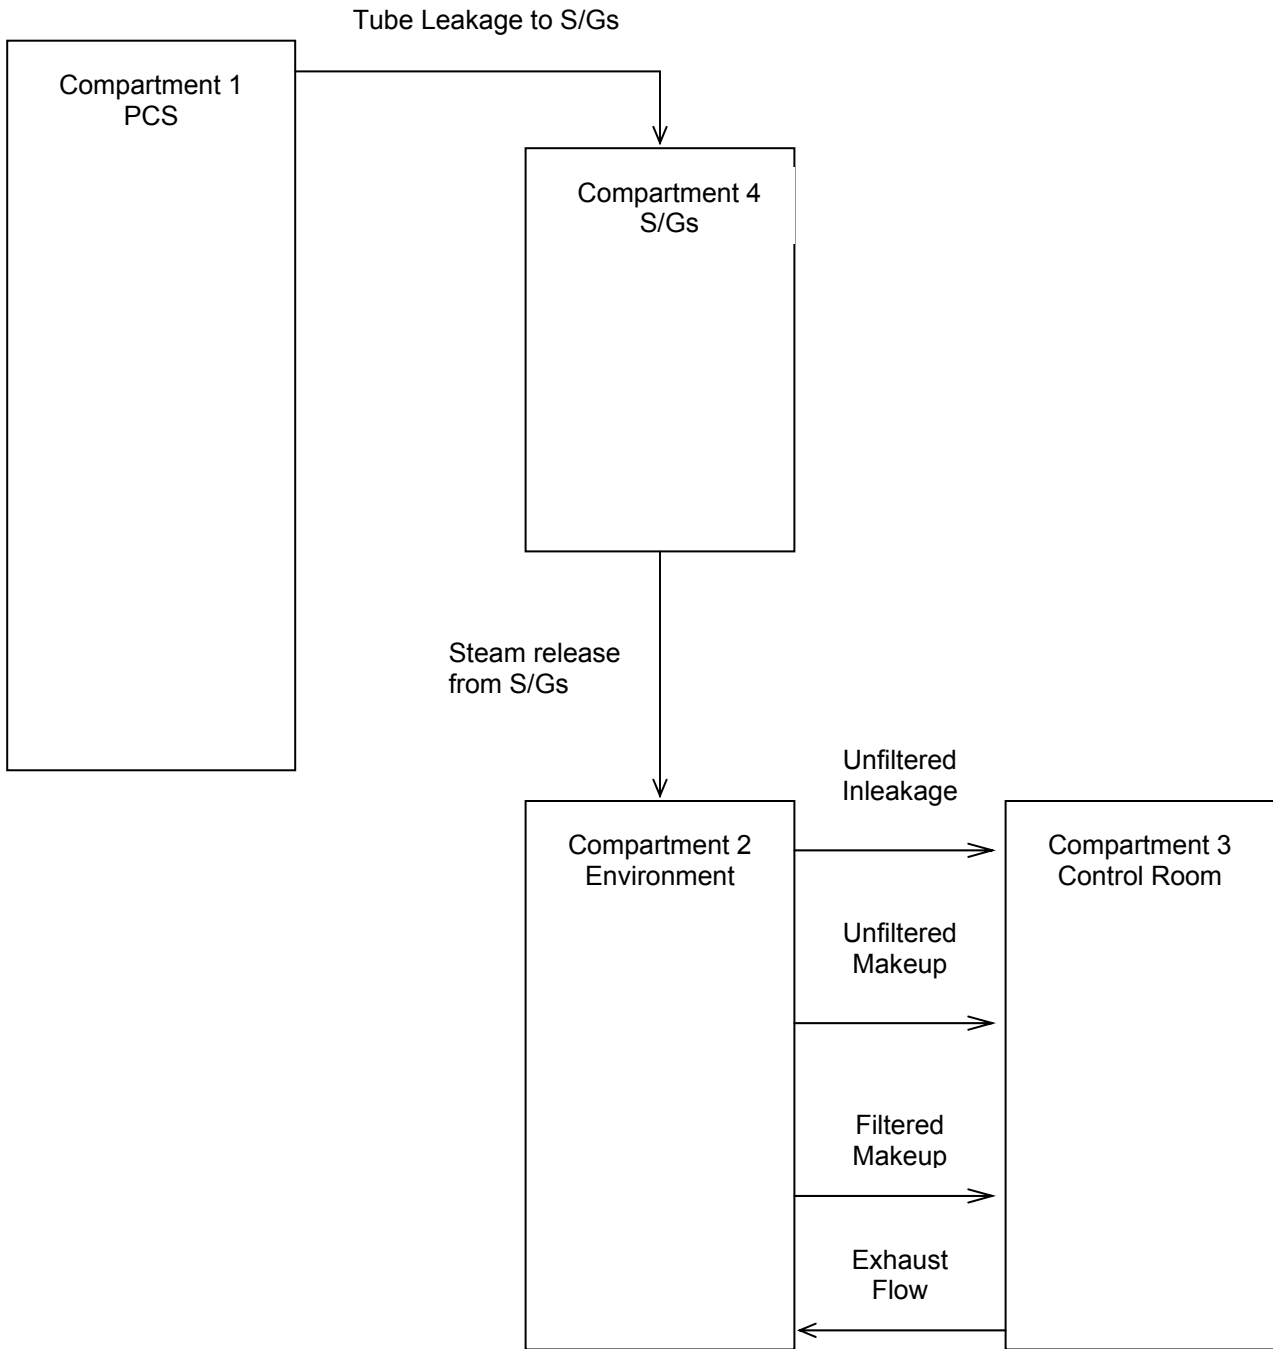

The subsections that follow describe the input for the secondary side leakage model. The model was set up on a mass flow basis rather than the typical volumetric flow basis; therefore, the PCS volume was specified as  $lb_m$  and the steam generator tube leakage and steam release rates were specified as  $lb_m/min$ . The file name for this model is *pal\_CRE\_DNB\_sec\_iodine\_db\_ast.psf*. The output for this case is provided in Attachment 6.

#### 7.4.1 PCS Compartment

The input for this compartment is the same as that used for the noble gas model (see Section 7.2.1).

#### 7.4.2 Environment and Control Room Compartments

The input for these compartments is the same as that used for the noble gas model (see Sections 7.2.2 and 7.2.3).

#### 7.4.3 Steam Generators Compartment

The minimum steam generator mass (141,065  $lb_m$  per Reference 16) was used in order to maximize the nuclide concentration available for the steam release:

Volume	282,130 $lb_m$	Calculation performed on a $lb_m$ basis; therefore, minimum S/G water mass is input (2 x 141,065 $lb_m$ ). Minimum S/G mass corresponding to HFP was used to maximize concentration.
Source Fraction	0	Dose due to PCS leakage only.
Recirculation Filters	no	
Natural Deposition	no	

#### 7.4.4 Control Room Pathways

The input for the control room pathways is the same as that used for the noble gas model (see Sections 7.2.5, 7.2.6, 7.2.7, and 7.2.8).

#### 7.4.5 Leakage to Steam Generators – Pathway 1

The input for this pathway is similar to that used for the noble gas model (see Section 7.2.4). The only difference is that the pathway runs from the PCS compartment to the Steam Generator compartment. The steam generator tubes remain covered throughout the event (Reference 5); therefore, per Section 5.5.1 of Appendix E to Reg. Guide 1.183, the tube leakage was assumed to mix with the bulk water without flashing.



**7.4.6 Steam Release From Steam Generators – Pathway 6**

This pathway connects the Steam Generators (Compartment 4) with the Environment (Compartment 2). Makeup flow from the auxiliary feedwater system is assumed to maintain a constant mass on the secondary side of the intact steam generators. Section 5.5.4 of Appendix E to Reg. Guide 1.183 states:

*“The radioactivity in the bulk water is assumed to become vapor at a rate that is the function of the steaming rate and the partition coefficient. A partition coefficient for iodine of 100 may be assumed. The retention of particulate radionuclides in the steam generators is limited by the moisture carryover from the steam generators.”*

The carryover fraction for Palisades is less than 1%; therefore, a partition coefficient of 100 was used for both the particulate and iodine released via the SRVs/ADVs. The partition coefficient was modeled by adjusting the steam mass release rates from the steam generators by a factor of 0.01.

Per References 5 and 16, the secondary side steam release consists of an initial release via the SRVs followed by a controlled release from the ADVs (for plant cooldown). The data provided in References 5 and 16 include approximately a 700 second delay before a reactor trip. However, for the CRE analysis, a LOOP is assumed coincident with the beginning of the event. Therefore, the SRV/ADV release data from Reference 5 were adjusted to coincide with the beginning of the event. In addition, in order to account for an error in the decay heat calculation in the thermal-hydraulic analysis, the steam release during the first 30 minutes is increased by 20%.

The SRV release for the two S/Gs is 44,654 + 44,645 = 89,299 lb<sub>m</sub> over the first 1100 seconds (700 seconds to 1800 seconds in References 5 and 16):

$$\text{SRV Release Rate} = (89,299)(1.2)(60)(0.01)/(1100) = 58.45 \text{ lb}_m/\text{min}$$

An 8 hour cooldown period is specified in Reference 5, thus, the ADV release starts at 1100 seconds (18.3333 minutes or 0.305556 hours) and is assumed to continue to 8 hours (480 minutes).

The total ADV release is:

$$313,736 \text{ lb}_m + 719,448 \text{ lb}_m = 1,033,184 \text{ lb}_m$$

The release rate from 1100 seconds (18.3333 minutes or 0.305555 hours) to 8 hours (480 minutes) is:

$$(1,033,184)(0.01) / (480 - 18.3333) = 22.38 \text{ lb}_m/\text{min}$$

From 18.3333 to 30 minutes the release is increased by 20% to account for the decay heat error:

$$(22.38)(1.2) = 26.86$$

Time (hours)	Flow Rate (lb <sub>m</sub> /min)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	58.45	0	0	0
0.305556	26.86	0	0	0
0.5	22.38	0	0	0
8.0	0.0	0	0	0
720.0	0.0	0	0	0

**7.4.7 Plant Power and Release Information**

The “plant power” entry is used to account for the fraction of fuel experiencing DNB and to account for the radial peaking factor:

$$\text{Power} = 2703 \times 0.147 \times 2.04 = 810.576$$

The composition of the iodine released from the steam generators during a CRE event is specified in Section 5 of Appendix H to Reg. Guide 1.183 (97% elemental and 0.03% organic).

Start of first release time (hours)	0.0
Calculate decay	yes
Calculate daughters	yes
Iodine Fraction – aerosol	0.0
Iodine Fraction – elemental	0.97
Iodine Fraction – organic	0.03

**7.4.8 Dose Location Information**

The dose location input is similar to that used for the noble gas model (see Section 7.2.10). However, it was necessary to revise the pathway numbers to reflect the addition of the path for the SG steam release:

**Intake Pathway Combinations**

Control Room Intake Path	Release Path	X/Q Table
2	6	3
3	6	4
4	6	3

**7.4.9 Source Term**

The source term for the DNB secondary leakage model is discussed in Section 7.2.11. The corresponding nuclide inventory file is *palisades\_loca\_db\_ast.nif*.

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**7.4.10 CRE DNB Secondary Leakage Iodine Release Fraction Timing File**

According Section 1.0 of Appendix H to Reg. Guide 1.183 the secondary side iodine release fraction for DNB is 0.1. Per Table 3 of Reg. Guide 1.183, the release fraction for alkali metals (cesium) is 0.12. The release fraction timing file, *pal\_cre\_dnb\_sec\_iodine\_ast.rft*, is listed below:

**Table 7-3 CRE DNB Secondary Leakage Iodine Release Fraction Timing File**

```

Release Fraction and Timing Name:
Palisades CRE DNB Secondary Iodine&Cesium Fuel Release AST
Duration (h): Design Basis Accident
  0.1000E-03  0.0000E+00  0.0000E+00  0.0000E+00
Noble Gases:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Iodine:
  0.1000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cesium:
  0.1200E+00  0.0000E+00  0.0000E+00  0.0000E+00
Tellurium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Strontium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Barium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Ruthenium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cerium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Lanthanum:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Non-Radioactive Aerosols (kg):
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
End of Release File

```

## 7.5 CRE Secondary Side Release Iodine Dose for FCM

This model is similar to the one described in the previous section:

- As discussed in Section 7.3 the plant power to model a 0.5% FCM fuel failure is 27.5706
- The release fraction timing file was set up to release an iodine fraction of 0.5 per Section 1.0 of Appendix H to Reg. Guide 1.183. The cesium release fraction was set to 0.12. The corresponding release fraction timing file, *pal\_cre\_fcm\_sec\_iodine\_ast.rft*, is listed below:

**Table 7-4 CRE FCM Secondary Leakage Iodine Release Fraction Timing File**

```

Release Fraction and Timing Name:
Palisades CRE FCM Secondary Iodine&Cesium Fuel Release AST
Duration (h): Design Basis Accident
  0.1000E-03  0.0000E+00  0.0000E+00  0.0000E+00
Noble Gases:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Iodine:
  0.5000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cesium:
  0.1200E+00  0.0000E+00  0.0000E+00  0.0000E+00
Tellurium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Strontium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Barium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Ruthenium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cerium:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Lanthanum:
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Non-Radioactive Aerosols (kg):
  0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
End of Release File

```

The file name for this model is *pal\_CRE\_FCM\_sec\_iodine\_db\_ast.psf*. The output for this case is provided Attachment 7.

## 7.6 CRE DNB Containment Leakage Model


Section 6 of Appendix H to Reg. Guide 1.183 lists the assumptions for the CRE containment release evaluation. Credit for containment nuclide removal processes is allowed (sprays, filters, natural deposition, etc.). As discussed in Section 1.0, the CHR (containment isolation due to high radiation) case results in no containment spray. This case will bound the CHP case (containment isolation due to high pressure) which has containment sprays. The file name for this model is *pal\_CRE\_DNB\_cont\_db\_ast.psf*. The output for this case is provided in Attachment 8.

The RADTRAD-NAI model developed for the CRE DNB containment leakage calculation consists of three compartments and 5 pathways (see Figure 3):

Compartment Description	Compartment Number	RADTRAD-NAI Compartment Type
Containment	1	(3) Normal
Environment	2	(2) Environment
Control Room	3	(1) Control Room

Pathway Description	Compartment Connections	Pathway Number	RADTRAD-NAI Pathway Type
Containment Leakage	1 to 2	1	Convective
Control Room Unfiltered Makeup	2 to 3	2	Filtered
Control Room Filtered Makeup	2 to 3	3	Filtered
Control Room Unfiltered Inleakage	2 to 3	4	Filtered
Control Room Exhaust	3 to 2	5	Filtered

Figure 3 Containment Leakage RADTRAD-NAI Model

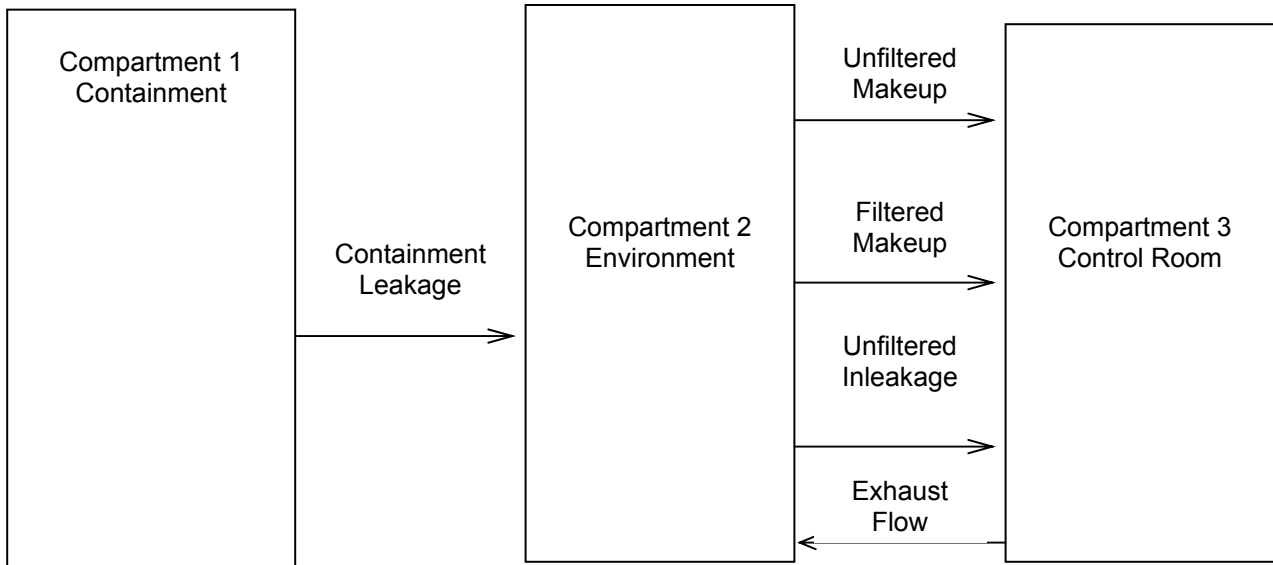

**7.6.1 Containment Compartment**

The following input was specified for the Containment Compartment:

Volume	1.64E6 ft <sup>3</sup>	
Source Fraction	1.0	100% of source term applied to the containment
Sprays	no	
Recirculation Filters	no	
Natural Deposition	yes	aerosol = 0.1 hr <sup>-1</sup> (Reference 12) elemental iodine = 1.3 hr <sup>-1</sup> (Reference 15)

**7.6.2 Environment and Control Room Compartments**

With one exception, the input for these compartments is the same as that used for the noble gas model (see Sections 7.2.2 and 7.2.3). The control room recirculation flow starts at 1.5 minutes (0.025 hours).

**7.6.3 Containment Leakage**

The containment leakage is 0.10% of volume per day, decreasing to 0.05% of volume per day at 24 hours.

Time (hours)	Flow Rate (%/day)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	0.10	0	0	0
24.0	0.05	0	0	0
720.0	0.05	0	0	0

**7.6.4 Control Room Unfiltered Makeup**

The unfiltered makeup flow covers two time periods. A loss of offsite power is assumed to occur coincident with the CRE; therefore, from 0 to 1.5 minutes, the unfiltered flow rate consists of the base infiltration rate of 384.2 cfm. (It should be noted that in the event of no loss of offsite power, the flow rate would be 660 cfm. However, in this event, there would be no time delay required for diesel startup and sequencing time, thus the control room would be isolated much sooner.) After control room isolation at 1.5 minutes, the flow is 0 cfm.

**Unfiltered Makeup Flow**

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	384.2	0	0	0
0.025	0.0	0	0	0
720.0	0.0	0	0	0

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**7.6.5 Control Room Filtered Makeup**

The control room filtered makeup flow of 1413.6 cfm starts at 1.5 minutes (time of control room isolation).

**Filtered Makeup Flow**

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	0.0	99	99	99
0.025	1413.6	99	99	99
720.0	1413.6	99	99	99

**7.6.6 Control Room Unfiltered Inleakage**

The unfiltered inleakage was set to 10 cfm.

**Unfiltered Inleakage**

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	0.0	0	0	0
0.025	10.0	0	0	0
720.0	10.0	0	0	0

**7.6.7 Control Room Exhaust**

The control room exhaust is equal to the sum of the control room intake and inleakage flows.

**Exhaust Flow**

Time (hours)	Flow Rate (cfm)	Filter Efficiency		
		Aerosol	Elemental	Organic
0.0	384.2	0	0	0
0.025	1423.6	0	0	0
720.0	1423.6	0	0	0



### 7.6.8 Plant Power and Release Information

The "plant power" entry is used to account for the fraction of fuel experiencing DNB and to account for the radial peaking factor:

$$\text{Power} = 2703 \times 0.147 \times 2.04 = 810.576$$

Section 4 of Appendix H to Reg. Guide 1.183 specifies the fractions for the three forms of iodine released from the PCS to containment. The start of the release was specified as 0.0 hours.

Start of first release time (hours)	0.0
Calculate decay	yes
Calculate daughters	yes
Iodine Fraction – aerosol	0.95
Iodine Fraction – elemental	0.0485
Iodine Fraction – organic	0.0015

### 7.6.9 Dose Location Information

Three dose locations were specified; the Exclusion Boundary (EAB), the Low Population Zone (LPZ), and the Control Room (CR). The X/Qs for the EAB and LPZ are the same as Section 7.2.10. The X/Qs for the containment release are from Table 4 of Reference 10.

**Control Room X/Q for Unfiltered Flow**  
**Table 3**

Time (hours)	X/Q (sec/m <sup>3</sup> )
0.0	1.43E-2
2.0	1.11E-2
8.0	4.13E-3
24.0	3.23E-3
96.0	2.49E-3
720.0	2.49E-3

**Control Room X/Q for Filtered Makeup Flow  
Table 4**

Time (hours)	X/Q (sec/m <sup>3</sup> )
0.0	7.26E-4
2.0	6.18E-4
8.0	2.47E-4
24.0	1.77E-4
96.0	1.30E-4
720.0	1.30E-4

**Dose Location Pathway Combinations**

Control Room Intake Path	Release Path	X/Q Table
2	1	3
3	1	4
4	1	3

### 7.6.10 Source Term

The LOCA source term is used for the CRE DNB fuel release. The corresponding nuclide inventory file is *palisades\_loca\_db\_ast.nif*. The LOCA source term data are modified via the RADTRAD-NAI power input value and via the release fraction timing file to produce the appropriate source term for the CRE DNB containment release source term.

### 7.6.11 DNB Containment Leakage Release Fraction Timing File

According to Footnote 11 to Table 3 and per Section 1.0 of Appendix H to Reg. Guide 1.183 the release fractions for breached fuel (DNB) are 0.10 for noble gas, 0.10 for iodine, and 0.12 for alkali metals (cesium). The release fraction timing file, *pal\_cre\_dnb\_cont\_ast.rft*, is listed below:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**Table 7-5 CRE Containment DNB Release Fraction Timing File**

Release Fraction and Timing Name:  
Palisades CRE DNB Containment Fuel Release AST  
Duration (h): Design Basis Accident  
0.1000E-03 0.0000E+00 0.0000E+00 0.0000E+00  
Noble Gases:  
0.1000E+00 0.0000E+00 0.0000E+00 0.0000E+00  
Iodine:  
0.1000E+00 0.0000E+00 0.0000E+00 0.0000E+00  
Cesium:  
0.1200E+00 0.0000E+00 0.0000E+00 0.0000E+00  
Tellurium:  
0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00  
Strontium:  
0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00  
Barium:  
0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00  
Ruthenium:  
0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00  
Cerium:  
0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00  
Lanthanum:  
0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00  
Non-Radioactive Aerosols (kg):  
0.0000E+00 0.0000E+00 0.0000E+00 0.0000E+00  
End of Release File

### 7.7 CRE FCM Containment Leakage Model

The RADTRAD-NAI model used for this case is similar to that described in Section 7.6. The only items that were changed were the release fraction timing file along with corresponding "plant power".

The "plant power" entry was used to account for the fraction of fuel experiencing FCM and to account for the radial peaking factor:

$$\text{Plant Power} = 2703 \times 0.005 \times 2.04 = 27.5706$$

Accordinging Section 1.0 of Appendix H to Reg. Guide 1.183 the containment release fractions for FCM are 1.0 for noble gas and 0.25 for iodine. In addition, per Table 3 of Reg. Guide 1.183, the release fraction for alkali metals (cesium) is 0.12. The release fraction timing file, *pal\_cre\_fcm\_cont\_ast.rft*, is listed below:

**Table 7-6 CRE Containment FCM Release Fraction Timing File**

```

Release Fraction and Timing Name:
Palisades CRE FCM Containment Fuel Release AST
Duration (h): Design Basis Accident
 0.1000E-03  0.0000E+00  0.0000E+00  0.0000E+00
Noble Gases:
 0.1000E+01  0.0000E+00  0.0000E+00  0.0000E+00
Iodine:
 0.2500E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cesium:
 0.1200E+00  0.0000E+00  0.0000E+00  0.0000E+00
Tellurium:
 0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Strontium:
 0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Barium:
 0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Ruthenium:
 0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Cerium:
 0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Lanthanum:
 0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
Non-Radioactive Aerosols (kg):
 0.0000E+00  0.0000E+00  0.0000E+00  0.0000E+00
End of Release File

```

The file name for this model is *pal\_CRE\_FCM\_cont\_db\_ast.psf*. The output for this case is provided in Attachment 9.

## 8.0 References

1. USNRC, Regulatory Guide 1.183, "Alternative Radiological Source Terms for Evaluating Design Basis Accidents at Nuclear Power Plants", July 2000.
2. Palisades Nuclear Plant FSAR, Revision 24.
3. Numerical Applications Inc., NAI-9912-04, Revision 4, "RADTRAD-NAI Version 1.1a(QA) Documentation", October 2004.
4. Numerical Applications Inc., "Dose Methodology Quality Assurance Procedures", Revision 1, June 4, 2001.
5. NAI-E03-211 Project Memo 2004-04, "CRE Inputs", June 23 2004.
6. Palisades Plant Technical Specifications through Amendment 213.
7. NAI Calculation Number NAI-1149-001 Rev. 1, "Source Terms for Palisades Dose Calculations".
8. NAI Calculation Number NAI-1101-001 Rev. 1, "Generation of .nif and .inp Files for RADTRAD-NAI".
9. NAI Calculation Number NAI-1149-004 Rev. 0, "Palisades Best Estimate AST MHA/LOCA Radiological Analysis".
10. NAI Calculation Number NAI-1149-002 Rev. 0, "Determination of Atmospheric Dispersion Factors for Palisades".
11. USNRC, "Safety Evaluation by the Office of Nuclear Reactor Regulation Related to Amendment No. 201 to Facility Operating License No. DPR-40, Omaha Public Power District, Fort Calhoun Station, Unit No. 1, Docket No. 50-285".
12. IDCOR Program Technical Report 11.3, "Fission Product Transport in Degraded Core Accidents", December 1983.
13. NAI Calculation Number NAI-1149-024 Rev. 1, "Determination of Direct Shine Doses for a Design Basis LOCA for Palisades".
14. Palisades Calculation EA-TAM-96-02, Revision 3.
15. NAI-E03-211 Project Memo 2004-03, "MHA/LOCA Inputs", June 11 2004.
16. NAI-E03-211 Project Memo 2004-06, "MSLB and SGTR Inputs", July 6 2004.
17. NAI Calculation Number NAI-1149-019 Rev. 0, "Palisades Design Basis Steam Generator Tube Rupture AST Radiological Analysis".

**9.0 CRE RADTRAD-NAI Analysis Files**

**RADTRAD-NAI CRECase Files**

<b>File Name</b>	<b>Attachment #</b>	<b>Case</b>
pal_CRE_DNB_sec_ng_db_ast.out	Attachment 4	CRE DNB fuel dose due to secondary side release of noble gas
pal_CRE_FCM_sec_ng_db_ast.out	Attachment 5	CRE FCM fuel dose due to secondary side release of noble gas
pal_CRE_DNB_sec_iodine_db_ast.out	Attachment 6	CRE DNB fuel dose due to secondary side release of non-noble gas nuclides
pal_CRE_FCM_sec_iodine_db_ast.out	Attachment 7	CRE FCM fuel dose due to secondary side release of non-noble gas nuclides
pal_CRE_DNB_cont_db_ast.out	Attachment 8	CRE DNB fuel dose for containment release
pal_CRE_FCM_cont_db_ast.out	Attachment 9	CRE FCM fuel dose for containment release

**RADTRAD-NAI CRE Nuclide Inventory Files**

<b>File Name</b>	<b>Attachment #</b>	<b>Case</b>
palisades_loca_db_ast.nif	Attachment 2	Source term file
nai-1101-001rev0.dcf	Attachment 3	FP&L AST dose conversion factor file

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**RADTRAD-NAI CRE Release Fraction Timing Files**

<b>File Name</b>	<b>Table</b>	<b>Case</b>
pal_cre_dnb_sec_ng.rft	Table 7-1	Release fraction timing file for secondary side release of noble gas for DNB fuel
pal_cre_fcm_sec_ng.rft	Table 7-2	Release fraction timing file for secondary side release of noble gas for FCM fuel
pal_cre_dnb_sec_iodine_ast.rft	Table 7-3	Release fraction timing file for secondary side release for DNB fuel
pal_cre_fcm_sec_iodine_ast.rft	Table 7-4	Release fraction timing file for secondary side release for FCM fuel
pal_cre_dnb_cont_ast.rft	Table 7-5	Release fraction timing file for containment release for DNB fuel
pal_cre_fcm_cont_ast.rft	Table 7-6	Release fraction timing file for containment release for FCM fuel

**Attachment 1 Verification Comments for Calculation NAI-1149-015 Rev. 0****Comment 1**

Section 2.0, 1<sup>st</sup> paragraph, 3<sup>rd</sup> sentence – There is an extra space in front of this sentence and the shine dose needs to be corrected in this sentence.

*Response: Corrections made.*

**Comment 2**

Page 11, Section 7.0 – “ASDV” should be “ADV.”

*Response: Corrected.*

**Comment 3**

Page 11, Section 6.0 – Please provide further basis for ignoring the PCS and SG initial (i.e., Tech. Spec.) activity. This assumption should be reasonable based on prior PWR AST analyses such as Seabrook, St. Lucie and Turkey Point where the initial activity doses neglected were on the order of  $10^{-2}$  rem TEDE or less.

*Response: The steam release for this event is the same as that used for the SGTR; therefore, the secondary side initial activity dose from the SGTR event has been added to the results and Reference 17 has been added. Sections 6.0 and 2.0 have been revised to note this.*

**Comment 4**

Page 15, Section 7.2.4, 1<sup>st</sup> paragraph, 2<sup>nd</sup> sentence – “gallon per day” should be “gallons per day.”

*Response: Corrected.*

**Comment 5**

Page 15, Section 7.2.5, 1<sup>st</sup> paragraph, 2<sup>nd</sup> sentence and Page 31, Section 7.6.4, 1<sup>st</sup> paragraph, 2<sup>nd</sup> sentence – “offisite” should be “offsite.”

*Response: Corrected.*

**Comment 6**

Page 26, Section 7.4.9, 1<sup>st</sup> sentence – Delete “the” in front of “discussed.”

*Response: Corrected.*



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**Attachment 2 LOCA Design Basis AST Nuclide Inventory File**

Nuclide Inventory Name:

Palisades AST Design Basis LOCA source term

Power Level:

0.2703E+04

Nuclides:

107

Nuclide 001:

Co-58

7

0.6117120000E+07

0.5800E+02

0.0000E+00

none 0.0000E+00

none 0.0000E+00

none 0.0000E+00

Nuclide 002:

Co-60

7

0.1663401096E+09

0.6000E+02

0.0000E+00

none 0.0000E+00

none 0.0000E+00

none 0.0000E+00

Nuclide 003:

Kr-85

1

0.3382974720E+09

0.8500E+02

0.1052E+07

none 0.0000E+00

none 0.0000E+00

none 0.0000E+00

Nuclide 004:

Kr-85m

1

0.1612800000E+05

0.8500E+02

0.1948E+08

Kr-85 0.2110E+00

none 0.0000E+00

none 0.0000E+00

Nuclide 005:

Kr-87

1

0.4578000000E+04

0.8700E+02

0.3756E+08

Rb-87 0.1000E+01

none 0.0000E+00

none 0.0000E+00

Nuclide 006:

Kr-88

1

0.1022400000E+05

0.8800E+02

0.5286E+08

Rb-88 0.1000E+01

none 0.0000E+00

none 0.0000E+00

Nuclide 007:

Rb-86

3

0.1612224000E+07

0.8600E+02

0.1959E+06

none 0.0000E+00

none 0.0000E+00

none 0.0000E+00

Nuclide 008:

Sr-89

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
5
0.4363200000E+07
0.8900E+02
0.7213E+08
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 009:
Sr-90
5
0.9189573120E+09
0.9000E+02
0.8458E+07
Y-90      0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 010:
Sr-91
5
0.3420000000E+05
0.9100E+02
0.8874E+08
Y-91m     0.5780E+00
Y-91      0.4220E+00
none      0.0000E+00
Nuclide 011:
Sr-92
5
0.9756000000E+04
0.9200E+02
0.9557E+08
Y-92      0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 012:
Y-90
9
0.2304000000E+06
0.9000E+02
0.8737E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 013:
Y-91
9
0.5055264000E+07
0.9100E+02
0.9264E+08
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 014:
Y-92
9
0.1274400000E+05
0.9200E+02
0.9596E+08
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 015:
Y-93
9
0.3636000000E+05
0.9300E+02
0.1101E+09
Zr-93     0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 016:
Zr-95
9
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
0.5527872000E+07
0.9500E+02
0.1236E+09
Nb-95m 0.7000E-02
Nb-95 0.9930E+00
none 0.0000E+00
Nuclide 017:
Zr-97
9
0.6084000000E+05
0.9700E+02
0.1206E+09
Nb-97m 0.9470E+00
Nb-97 0.5300E-01
none 0.0000E+00
Nuclide 018:
Nb-95
9
0.3036960000E+07
0.9500E+02
0.1249E+09
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 019:
Mo-99
7
0.2376000000E+06
0.9900E+02
0.1368E+09
Tc-99m 0.8760E+00
Tc-99 0.1240E+00
none 0.0000E+00
Nuclide 020:
Tc-99m
7
0.2167200000E+05
0.9900E+02
0.1198E+09
Tc-99 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 021:
Ru-103
7
0.3393792000E+07
0.1030E+03
0.1260E+09
Rh-103m 0.9970E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 022:
Ru-105
7
0.1598400000E+05
0.1050E+03
0.9451E+08
Rh-105 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 023:
Ru-106
7
0.3181248000E+08
0.1060E+03
0.5794E+08
Rh-106 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 024:
Rh-105
7
0.1272960000E+06
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
0.1050E+03
0.8741E+08
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 025:
Sb-127
4
0.3326400000E+06
0.1270E+03
0.9111E+07
Te-127m  0.1760E+00
Te-127   0.8240E+00
none     0.0000E+00
Nuclide 026:
Sb-129
4
0.1555200000E+05
0.1290E+03
0.2568E+08
Te-129m  0.2250E+00
Te-129   0.7750E+00
none     0.0000E+00
Nuclide 027:
Te-127
4
0.3366000000E+05
0.1270E+03
0.9047E+07
none     0.0000E+00
none     0.0000E+00
none     0.0000E+00
Nuclide 028:
Te-127m
4
0.9417600000E+07
0.1270E+03
0.1223E+07
Te-127   0.9760E+00
none     0.0000E+00
none     0.0000E+00
Nuclide 029:
Te-129
4
0.4176000000E+04
0.1290E+03
0.2528E+08
I-129    0.1000E+01
none     0.0000E+00
none     0.0000E+00
Nuclide 030:
Te-129m
4
0.2903040000E+07
0.1290E+03
0.3772E+07
Te-129   0.6500E+00
I-129    0.3500E+00
none     0.0000E+00
Nuclide 031:
Te-131m
4
0.1080000000E+06
0.1310E+03
0.1113E+08
Te-131   0.2220E+00
I-131    0.7780E+00
none     0.0000E+00
Nuclide 032:
Te-132
4
0.2815200000E+06
0.1320E+03
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
0.1048E+09
I-132 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 033:
I-131
2
0.6946560000E+06
0.1310E+03
0.7483E+08
Xe-131m 0.1110E-01
none 0.0000E+00
none 0.0000E+00
Nuclide 034:
I-132
2
0.8280000000E+04
0.1320E+03
0.1068E+09
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 035:
I-133
2
0.7488000000E+05
0.1330E+03
0.1462E+09
Xe-133m 0.2900E-01
Xe-133 0.9710E+00
none 0.0000E+00
Nuclide 036:
I-134
2
0.3156000000E+04
0.1340E+03
0.1602E+09
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 037:
I-135
2
0.2379600000E+05
0.1350E+03
0.1372E+09
Xe-135m 0.1540E+00
Xe-135 0.8460E+00
none 0.0000E+00
Nuclide 038:
Xe-133
1
0.4531680000E+06
0.1330E+03
0.1466E+09
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 039:
Xe-135
1
0.3272400000E+05
0.1350E+03
0.4692E+08
Cs-135 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 040:
Cs-134
3
0.6507177120E+08
0.1340E+03
0.2037E+08
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 041:
Cs-136
  3
  0.1131840000E+07
  0.1360E+03
  0.5873E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 042:
Cs-137
  3
  0.9467280000E+09
  0.1370E+03
  0.1100E+08
Ba-137m  0.9460E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 043:
Ba-139
  6
  0.4962000000E+04
  0.1390E+03
  0.1307E+09
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 044:
Ba-140
  6
  0.1100736000E+07
  0.1400E+03
  0.1260E+09
La-140   0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 045:
La-140
  9
  0.1449792000E+06
  0.1400E+03
  0.1299E+09
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 046:
La-141
  9
  0.1414800000E+05
  0.1410E+03
  0.1193E+09
Ce-141   0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 047:
La-142
  9
  0.5550000000E+04
  0.1420E+03
  0.1156E+09
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 048:
Ce-141
  8
  0.2808086400E+07
  0.1410E+03
  0.1212E+09
none      0.0000E+00
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
none      0.0000E+00
none      0.0000E+00
Nuclide 049:
Ce-143
  8
  0.1188000000E+06
  0.1430E+03
  0.1115E+09
Pr-143    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 050:
Ce-144
  8
  0.2456352000E+08
  0.1440E+03
  0.1020E+09
Pr-144m   0.1780E-01
Pr-144    0.9822E+00
none      0.0000E+00
Nuclide 051:
Pr-143
  9
  0.1171584000E+07
  0.1430E+03
  0.1111E+09
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 052:
Nd-147
  9
  0.9486720000E+06
  0.1470E+03
  0.4770E+08
Pm-147    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 053:
Np-239
  8
  0.2034720000E+06
  0.2390E+03
  0.1830E+10
Pu-239    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 054:
Pu-238
  8
  0.2768863824E+10
  0.2380E+03
  0.3927E+06
U-234     0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 055:
Pu-239
  8
  0.7594336440E+12
  0.2390E+03
  0.3558E+05
U-235     0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 056:
Pu-240
  8
  0.2062920312E+12
  0.2400E+03
  0.5406E+05
U-236     0.1000E+01
none      0.0000E+00
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
none      0.0000E+00
Nuclide 057:
Pu-241
  8
  0.4544294400E+09
  0.2410E+03
  0.1522E+08
U-237     0.2450E-04
Am-241    0.1000E+01
none      0.0000E+00
Nuclide 058:
Am-241
  9
  0.1363919472E+11
  0.2410E+03
  0.1884E+05
Np-237    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 059:
Cm-242
  9
  0.1406592000E+08
  0.2420E+03
  0.5669E+07
Pu-238    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 060:
Cm-244
  9
  0.5715081360E+09
  0.2440E+03
  0.5943E+06
Pu-240    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 061:
I-130
  2
  0.4449600000E+05
  0.1300E+03
  0.3743E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 062:
Kr-83m
  1
  0.6588000000E+04
  0.8300E+02
  0.9119E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 063:
Xe-138
  1
  0.8502000000E+03
  0.1380E+03
  0.1211E+09
Cs-138    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 064:
Xe-131m
  1
  0.1028160000E+07
  0.1310E+03
  0.8346E+06
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
```



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
Nuclide 065:
Xe-133m
  1
  0.1890432000E+06
  0.1330E+03
  0.4659E+07
Xe-133  0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 066:
Xe-135m
  1
  0.9174000000E+03
  0.1350E+03
  0.2999E+08
Xe-135  0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 067:
Cs-138
  3
  0.1932000000E+04
  0.1380E+03
  0.1340E+09
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 068:
Cs-134m
  3
  0.1044000000E+05
  0.1340E+03
  0.4920E+07
Cs-134  0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 069:
Rb-88
  3
  0.1068000000E+04
  0.8800E+02
  0.5369E+08
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 070:
Rb-89
  3
  0.9120000000E+03
  0.8900E+02
  0.6895E+08
Sr-89   0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 071:
Sb-124
  4
  0.5201280000E+07
  0.1240E+03
  0.1702E+06
none    0.0000E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 072:
Sb-125
  4
  0.8741455200E+08
  0.1250E+03
  0.1567E+07
Te-125m 0.2280E+00
none    0.0000E+00
none    0.0000E+00
Nuclide 073:
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
Sb-126
  4
  0.1071360000E+07
  0.1260E+03
  0.1107E+06
  none      0.0000E+00
  none      0.0000E+00
  none      0.0000E+00
  Nuclide 074:
  Te-131
    4
    0.1500000000E+04
    0.1310E+03
    0.6601E+08
  I-131     0.1000E+01
  none      0.0000E+00
  none      0.0000E+00
  Nuclide 075:
  Te-133
    4
    0.7470000000E+03
    0.1330E+03
    0.8639E+08
  I-133     0.1000E+01
  none      0.0000E+00
  none      0.0000E+00
  Nuclide 076:
  Te-134
    4
    0.2508000000E+04
    0.1340E+03
    0.1220E+09
  I-134     0.1000E+01
  none      0.0000E+00
  none      0.0000E+00
  Nuclide 077:
  Te-125m
    4
    0.5011200000E+07
    0.1250E+03
    0.3413E+06
  none      0.0000E+00
  none      0.0000E+00
  none      0.0000E+00
  Nuclide 078:
  Te-133m
    4
    0.3324000000E+04
    0.1330E+03
    0.5406E+08
  I-133     0.8700E+00
  Te-133    0.1300E+00
  none      0.0000E+00
  Nuclide 079:
  Ba-141
    6
    0.1096200000E+04
    0.1410E+03
    0.1188E+09
  La-141    0.1000E+01
  none      0.0000E+00
  none      0.0000E+00
  Nuclide 080:
  Ba-137m
    6
    0.1531200000E+03
    0.1370E+03
    0.1043E+08
  none      0.0000E+00
  none      0.0000E+00
  none      0.0000E+00
  Nuclide 081:
  Pd-109
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
7
0.4833720000E+05
0.1090E+03
0.3327E+08
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 082:
Rh-106
7
0.2990000000E+02
0.1060E+03
0.6285E+08
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 083:
Rh-103m
7
0.3367200000E+04
0.1030E+03
0.1135E+09
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 084:
Tc-101
7
0.8520000000E+03
0.1010E+03
0.1261E+09
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 085:
Eu-154
9
0.2777068800E+09
0.1540E+03
0.1247E+07
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 086:
Eu-155
9
0.1565256960E+09
0.1550E+03
0.8448E+06
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 087:
Eu-156
9
0.1312416000E+07
0.1560E+03
0.2023E+08
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 088:
La-143
9
0.8538000000E+03
0.1430E+03
0.1108E+09
Ce-143   0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 089:
Nb-97
9
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
0.4326000000E+04
0.9700E+02
0.1216E+09
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 090:
Nb-95m
  9
0.3117600000E+06
0.9500E+02
0.8835E+06
Nb-95     0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 091:
Pm-147
  9
0.8278820780E+08
0.1470E+03
0.1292E+08
Sm-147    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 092:
Pm-148
  9
0.4639680000E+06
0.1480E+03
0.2144E+08
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 093:
Pm-149
  9
0.1910880000E+06
0.1490E+03
0.4541E+08
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 094:
Pm-151
  9
0.1022400000E+06
0.1510E+03
0.1606E+08
Sm-151    0.1000E+01
none      0.0000E+00
none      0.0000E+00
Nuclide 095:
Pm-148m
  9
0.3568320000E+07
0.1480E+03
0.2999E+07
Pm-148    0.4600E-01
none      0.0000E+00
none      0.0000E+00
Nuclide 096:
Pr-144
  9
0.1036800000E+04
0.1440E+03
0.1025E+09
none      0.0000E+00
none      0.0000E+00
none      0.0000E+00
Nuclide 097:
Pr-144m
  9
0.4320000000E+03
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
0.1440E+03
0.1224E+07
Pr-144 0.9990E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 098:
Sm-153
9
0.1681200000E+06
0.1530E+03
0.4423E+08
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 099:
Y-94
9
0.1146000000E+04
0.9400E+02
0.1105E+09
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 100:
Y-95
9
0.6420000000E+03
0.9500E+02
0.1183E+09
Zr-95 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 101:
Y-91m
9
0.2982600000E+04
0.9100E+02
0.5151E+08
Y-91 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 102:
Br-82
2
0.1270800000E+06
0.8200E+02
0.5282E+06
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 103:
Br-83
2
0.8604000000E+04
0.8300E+02
0.9102E+07
Kr-83m 0.1000E+01
none 0.0000E+00
none 0.0000E+00
Nuclide 104:
Br-84
2
0.1908000000E+04
0.8400E+02
0.1591E+08
none 0.0000E+00
none 0.0000E+00
none 0.0000E+00
Nuclide 105:
Am-242
9
0.5767200000E+05
0.2420E+03
```

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
0.9062E+07
Cm-242  0.8270E+00
Pu-242  0.1730E+00
none    0.0000E+00
Nuclide 106:
Np-238
  8
  0.1829088000E+06
  0.2380E+03
  0.4306E+08
Pu-238  0.1000E+01
none    0.0000E+00
none    0.0000E+00
Nuclide 107:
Pu-243
  8
  0.1784160000E+05
  0.2430E+03
  0.4690E+08
Am-243  0.1000E+01
none    0.0000E+00
none    0.0000E+00
End of Nuclear Inventory File
```

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**Attachment 3 RADTRAD-NAI Dose Conversion Factor File**

NAI-1101-001rev0.DCF

Includes 107 isotopes

9 ORGANS DEFINED IN THIS FILE:

GONADS  
BREAST  
LUNGS  
RED MARR  
BONE SUR  
THYROID  
REMAINDER  
EFFECTIVE  
SKIN(FGR)

107 NUCLIDES DEFINED IN THIS FILE:

Co-58 Y  
Co-60 Y  
Kr-85  
Kr-85m  
Kr-87  
Kr-88  
Rb-86 D  
Sr-89 Y  
Sr-90 Y  
Sr-91 Y  
Sr-92 Y  
Y-90 Y  
Y-91 Y  
Y-92 Y  
Y-93 Y  
Zr-95 D  
Zr-97 Y  
Nb-95 Y  
Mo-99 Y  
Tc-99m D  
Ru-103 Y  
Ru-105 Y  
Ru-106 Y  
Rh-105 Y  
Sb-127 W  
Sb-129 W  
Te-127 W  
Te-127m W  
Te-129 D  
Te-129m W  
Te-131m W  
Te-132 W  
I-131 D  
I-132 D  
I-133 D  
I-134 D  
I-135 D  
Xe-133  
Xe-135  
Cs-134 D  
Cs-136 D  
Cs-137 D  
Ba-139 D  
Ba-140 D  
La-140 W  
La-141 D  
La-142 D  
Ce-141 Y  
Ce-143 Y  
Ce-144 Y  
Pr-143 Y  
Nd-147 Y  
Np-239 W  
Pu-238 W  
Pu-239 W  
Pu-240 W  
Pu-241 W  
Am-241 W

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cm-242 W  
 Cm-244 W  
 I-130 D  
 Kr-83m  
 Xe-138  
 Xe-131m  
 Xe-133m  
 Xe-135m  
 Cs-138 D  
 Cs-134m D  
 Rb-88 D  
 Rb-89 D  
 Sb-124 W  
 Sb-125 W  
 Sb-126 W  
 Te-131 D  
 Te-133 D  
 Te-134 D  
 Te-125m W  
 Te-133m D  
 Ba-141 D  
 Ba-137m  
 Pd-109 Y  
 Rh-106  
 Rh-103m D  
 Tc-101 D  
 Eu-154 W  
 Eu-155 W  
 Eu-156 W  
 La-143 W  
 Nb-97 Y  
 Nb-95m Y  
 Pm-147 Y  
 Pm-148 Y  
 Pm-149 Y  
 Pm-151 Y  
 Pm-148m Y  
 Pr-144 Y  
 Pr-144m  
 Sm-153 W  
 Y-94 Y  
 Y-95 Y  
 Y-91m Y  
 Br-82 W  
 Br-83 W  
 Br-84 D  
 Am-242 W  
 Np-238 W  
 Pu-243 Y

CLOUDSHINE GROUND GROUND GROUND INHALED INHALED INGESTION  
 SHINE 8HR SHINE 7DAY SHINE RATE ACUTE CHRONIC

Co-58							
GONADS	4.660E-14	2.867E-11	5.828E-10	9.970E-16-1.000E+00	6.170E-10	1.040E-09	
BREAST	5.300E-14	2.737E-11	5.565E-10	9.520E-16-1.000E+00	9.370E-10	1.790E-10	
LUNGS	4.640E-14	2.617E-11	5.319E-10	9.100E-16-1.000E+00	1.600E-08	8.530E-11	
RED MARR	4.530E-14	2.671E-11	5.430E-10	9.290E-16-1.000E+00	9.230E-10	2.600E-10	
BONE SUR	7.410E-14	3.795E-11	7.716E-10	1.320E-15-1.000E+00	6.930E-10	1.250E-10	
THYROID	4.770E-14	2.720E-11	5.530E-10	9.460E-16-1.000E+00	8.720E-10	6.310E-11	
REMAINDER	4.440E-14	2.585E-11	5.255E-10	8.990E-16-1.000E+00	1.890E-09	1.580E-09	
EFFECTIVE	4.760E-14	2.732E-11	5.553E-10	9.500E-16-1.000E+00	2.940E-09	8.090E-10	
SKIN (FGR)	5.580E-14	3.278E-11	6.664E-10	1.140E-15-1.000E+00	0.000E+00	0.000E+00	
Co-60							
GONADS	1.230E-13	7.056E-11	1.480E-09	2.450E-15-1.000E+00	4.760E-09	3.190E-09	
BREAST	1.390E-13	6.739E-11	1.413E-09	2.340E-15-1.000E+00	1.840E-08	1.100E-09	
LUNGS	1.240E-13	6.537E-11	1.371E-09	2.270E-15-1.000E+00	3.450E-07	8.770E-10	
RED MARR	1.230E-13	6.710E-11	1.407E-09	2.330E-15-1.000E+00	1.720E-08	1.320E-09	
BONE SUR	1.780E-13	8.956E-11	1.879E-09	3.110E-15-1.000E+00	1.350E-08	9.390E-10	
THYROID	1.270E-13	6.480E-11	1.359E-09	2.250E-15-1.000E+00	1.620E-08	7.880E-10	
REMAINDER	1.200E-13	6.508E-11	1.365E-09	2.260E-15-1.000E+00	3.600E-08	4.970E-09	
EFFECTIVE	1.260E-13	6.768E-11	1.419E-09	2.350E-15-1.000E+00	5.910E-08	2.770E-09	
SKIN (FGR)	1.450E-13	7.948E-11	1.667E-09	2.760E-15-1.000E+00	0.000E+00	0.000E+00	
Kr-85							
GONADS	1.170E-16	8.121E-14	1.704E-12	2.820E-18-1.000E+00	0.000E+00	0.000E+00	



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

BREAST	1.340E-16	7.891E-14	1.656E-12	2.740E-18	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.140E-16	7.056E-14	1.481E-12	2.450E-18	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.090E-16	6.998E-14	1.469E-12	2.430E-18	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	2.200E-16	1.287E-13	2.702E-12	4.470E-18	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.180E-16	7.459E-14	1.565E-12	2.590E-18	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	1.090E-16	6.941E-14	1.457E-12	2.410E-18	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.190E-16	7.603E-14	1.596E-12	2.640E-18	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.320E-14	2.304E-11	4.835E-10	8.000E-16	-1.000E+00	0.000E+00	0.000E+00
Kr-85m							
GONADS	7.310E-15	2.594E-12	3.653E-12	1.570E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	8.410E-15	2.527E-12	3.560E-12	1.530E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	7.040E-15	2.379E-12	3.351E-12	1.440E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	6.430E-15	2.346E-12	3.304E-12	1.420E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	1.880E-14	5.286E-12	7.446E-12	3.200E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	7.330E-15	2.395E-12	3.374E-12	1.450E-16	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	6.640E-15	2.313E-12	3.257E-12	1.400E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	7.480E-15	2.511E-12	3.537E-12	1.520E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	2.240E-14	2.247E-11	3.164E-11	1.360E-15	-1.000E+00	0.000E+00	0.000E+00
Kr-87							
GONADS	4.000E-14	4.962E-12	5.026E-12	7.610E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	4.500E-14	4.740E-12	4.802E-12	7.270E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	4.040E-14	4.603E-12	4.663E-12	7.060E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	4.000E-14	4.708E-12	4.769E-12	7.220E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	6.020E-14	6.514E-12	6.598E-12	9.990E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	4.130E-14	4.473E-12	4.531E-12	6.860E-16	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	3.910E-14	4.590E-12	4.650E-12	7.040E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	4.120E-14	4.773E-12	4.835E-12	7.320E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.370E-13	8.802E-11	8.916E-11	1.350E-14	-1.000E+00	0.000E+00	0.000E+00
Kr-88							
GONADS	9.900E-14	2.278E-11	2.655E-11	1.800E-15	-1.000E+00	0.000E+00	0.000E+00
BREAST	1.110E-13	2.177E-11	2.537E-11	1.720E-15	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.010E-13	2.139E-11	2.493E-11	1.690E-15	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.000E-13	2.190E-11	2.552E-11	1.730E-15	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	1.390E-13	2.886E-11	3.363E-11	2.280E-15	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.030E-13	2.012E-11	2.345E-11	1.590E-15	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	9.790E-14	2.139E-11	2.493E-11	1.690E-15	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.020E-13	2.202E-11	2.567E-11	1.740E-15	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.350E-13	5.607E-11	6.534E-11	4.430E-15	-1.000E+00	0.000E+00	0.000E+00
Rb-86							
GONADS	4.710E-15	2.788E-12	5.187E-11	9.740E-17	-1.000E+00	1.340E-09	2.150E-09
BREAST	5.340E-15	2.662E-12	4.953E-11	9.300E-17	-1.000E+00	1.330E-09	2.140E-09
LUNGS	4.710E-15	2.553E-12	4.750E-11	8.920E-17	-1.000E+00	3.300E-09	2.140E-09
RED MARR	4.640E-15	2.619E-12	4.873E-11	9.150E-17	-1.000E+00	2.320E-09	3.720E-09
BONE SUR	7.050E-15	3.635E-12	6.764E-11	1.270E-16	-1.000E+00	4.270E-09	6.860E-09
THYROID	4.840E-15	2.599E-12	4.836E-11	9.080E-17	-1.000E+00	1.330E-09	2.140E-09
REMAINDER	4.520E-15	2.542E-12	4.729E-11	8.880E-17	-1.000E+00	1.380E-09	2.330E-09
EFFECTIVE	4.810E-15	2.665E-12	4.958E-11	9.310E-17	-1.000E+00	1.790E-09	2.530E-09
SKIN (FGR)	4.850E-14	2.210E-10	4.111E-09	7.720E-15	-1.000E+00	0.000E+00	0.000E+00
Sr-89							
GONADS	7.730E-17	7.155E-14	1.436E-12	2.490E-18	-1.000E+00	7.950E-12	8.050E-12
BREAST	9.080E-17	7.212E-14	1.447E-12	2.510E-18	-1.000E+00	7.960E-12	7.980E-12
LUNGS	7.080E-17	5.689E-14	1.142E-12	1.980E-18	-1.000E+00	8.350E-08	7.970E-12
RED MARR	6.390E-17	5.345E-14	1.073E-12	1.860E-18	-1.000E+00	1.070E-10	1.080E-10
BONE SUR	1.940E-16	1.560E-13	3.131E-12	5.430E-18	-1.000E+00	1.590E-10	1.610E-10
THYROID	7.600E-17	6.063E-14	1.217E-12	2.110E-18	-1.000E+00	7.960E-12	7.970E-12
REMAINDER	6.710E-17	5.603E-14	1.124E-12	1.950E-18	-1.000E+00	3.970E-09	8.250E-09
EFFECTIVE	7.730E-17	6.523E-14	1.309E-12	2.270E-18	-1.000E+00	1.120E-08	2.500E-09
SKIN (FGR)	3.690E-14	1.914E-10	3.841E-09	6.660E-15	-1.000E+00	0.000E+00	0.000E+00
Sr-90							
GONADS	7.780E-18	9.590E-15	2.014E-13	3.330E-19	-1.000E+00	2.690E-10	5.040E-11
BREAST	9.490E-18	1.008E-14	2.116E-13	3.500E-19	-1.000E+00	2.690E-10	5.040E-11
LUNGS	6.440E-18	6.307E-15	1.324E-13	2.190E-19	-1.000E+00	2.860E-06	5.040E-11
RED MARR	5.440E-18	5.558E-15	1.167E-13	1.930E-19	-1.000E+00	3.280E-08	6.450E-09
BONE SUR	2.280E-17	2.393E-14	5.025E-13	8.310E-19	-1.000E+00	7.090E-08	1.390E-08
THYROID	7.330E-18	7.171E-15	1.506E-13	2.490E-19	-1.000E+00	2.690E-10	5.040E-11
REMAINDER	6.110E-18	6.422E-15	1.348E-13	2.230E-19	-1.000E+00	5.730E-09	6.700E-09
EFFECTIVE	7.530E-18	8.179E-15	1.717E-13	2.840E-19	-1.000E+00	3.510E-07	3.230E-09
SKIN (FGR)	9.200E-15	4.032E-12	8.465E-11	1.400E-16	-1.000E+00	0.000E+00	0.000E+00
Sr-91							
GONADS	3.380E-14	2.155E-11	5.062E-11	1.026E-15	-1.000E+00	5.650E-11	2.520E-10
BREAST	3.830E-14	2.059E-11	4.838E-11	9.806E-16	-1.000E+00	1.740E-11	3.676E-11
LUNGS	3.370E-14	1.970E-11	4.626E-11	9.376E-16	-1.000E+00	2.130E-09	1.055E-11
RED MARR	3.310E-14	2.011E-11	4.722E-11	9.570E-16	-1.000E+00	2.230E-11	5.659E-11

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

BONE SUR	5.200E-14	2.852E-11	6.709E-11	1.360E-15-1.000E+00	1.270E-11	2.070E-11
THYROID	3.470E-14	2.035E-11	4.782E-11	9.693E-16-1.000E+00	9.640E-12	1.968E-12
REMAINDER	3.240E-14	1.948E-11	4.573E-11	9.268E-16-1.000E+00	5.780E-10	2.557E-09
EFFECTIVE	3.450E-14	2.057E-11	4.832E-11	9.793E-16-1.000E+00	4.490E-10	8.455E-10
SKIN (FGR)	8.140E-14	1.748E-10	3.987E-10	8.080E-15-1.000E+00	0.000E+00	0.000E+00
Sr-92						
GONADS	6.610E-14	1.593E-11	1.830E-11	1.300E-15-1.000E+00	1.020E-11	8.180E-11
BREAST	7.480E-14	1.520E-11	1.745E-11	1.240E-15-1.000E+00	6.490E-12	1.700E-11
LUNGS	6.670E-14	1.483E-11	1.703E-11	1.210E-15-1.000E+00	1.050E-09	7.220E-12
RED MARR	6.620E-14	1.520E-11	1.745E-11	1.240E-15-1.000E+00	6.980E-12	2.290E-11
BONE SUR	9.490E-14	2.010E-11	2.308E-11	1.640E-15-1.000E+00	4.360E-12	8.490E-12
THYROID	6.820E-14	1.446E-11	1.661E-11	1.180E-15-1.000E+00	3.920E-12	1.300E-12
REMAINDER	6.450E-14	1.471E-11	1.689E-11	1.200E-15-1.000E+00	2.900E-10	1.720E-09
EFFECTIVE	6.790E-14	1.532E-11	1.759E-11	1.250E-15-1.000E+00	2.180E-10	5.430E-10
SKIN (FGR)	8.560E-14	2.280E-11	2.618E-11	1.860E-15-1.000E+00	0.000E+00	0.000E+00
Y-90						
GONADS	1.890E-16	1.586E-13	1.601E-12	5.750E-18-1.000E+00	5.170E-13	1.430E-14
BREAST	2.200E-16	1.578E-13	1.593E-12	5.720E-18-1.000E+00	5.170E-13	1.270E-14
LUNGS	1.770E-16	1.313E-13	1.326E-12	4.760E-18-1.000E+00	9.310E-09	1.260E-14
RED MARR	1.620E-16	1.261E-13	1.273E-12	4.570E-18-1.000E+00	1.520E-11	3.700E-13
BONE SUR	4.440E-16	3.228E-13	3.259E-12	1.170E-17-1.000E+00	1.510E-11	3.670E-13
THYROID	1.870E-16	1.385E-13	1.398E-12	5.020E-18-1.000E+00	5.170E-13	1.260E-14
REMAINDER	1.680E-16	1.291E-13	1.303E-12	4.680E-18-1.000E+00	3.870E-09	9.680E-09
EFFECTIVE	1.900E-16	1.468E-13	1.482E-12	5.320E-18-1.000E+00	2.280E-09	2.910E-09
SKIN (FGR)	6.240E-14	2.897E-10	2.924E-09	1.050E-14-1.000E+00	0.000E+00	0.000E+00
Y-91						
GONADS	2.560E-16	1.756E-13	3.546E-12	6.110E-18-1.000E+00	8.200E-12	3.540E-12
BREAST	2.930E-16	1.713E-13	3.459E-12	5.960E-18-1.000E+00	8.920E-12	5.540E-13
LUNGS	2.500E-16	1.526E-13	3.082E-12	5.310E-18-1.000E+00	9.870E-08	2.020E-13
RED MARR	2.410E-16	1.521E-13	3.070E-12	5.290E-18-1.000E+00	3.190E-10	6.590E-12
BONE SUR	4.560E-16	2.903E-13	5.862E-12	1.010E-17-1.000E+00	3.180E-10	6.130E-12
THYROID	2.600E-16	1.564E-13	3.157E-12	5.440E-18-1.000E+00	8.500E-12	1.290E-13
REMAINDER	2.390E-16	1.509E-13	3.047E-12	5.250E-18-1.000E+00	4.200E-09	8.570E-09
EFFECTIVE	2.600E-16	1.650E-13	3.332E-12	5.740E-18-1.000E+00	1.320E-08	2.570E-09
SKIN (FGR)	3.850E-14	1.989E-10	4.016E-09	6.920E-15-1.000E+00	0.000E+00	0.000E+00
Y-92						
GONADS	1.270E-14	3.855E-12	4.872E-12	2.650E-16-1.000E+00	2.610E-12	1.960E-11
BREAST	1.440E-14	3.680E-12	4.652E-12	2.530E-16-1.000E+00	1.500E-12	3.550E-12
LUNGS	1.270E-14	3.535E-12	4.468E-12	2.430E-16-1.000E+00	1.240E-09	1.390E-12
RED MARR	1.250E-14	3.608E-12	4.560E-12	2.480E-16-1.000E+00	2.070E-12	4.910E-12
BONE SUR	1.950E-14	5.091E-12	6.435E-12	3.500E-16-1.000E+00	1.510E-12	1.750E-12
THYROID	1.300E-14	3.579E-12	4.523E-12	2.460E-16-1.000E+00	1.050E-12	1.770E-13
REMAINDER	1.220E-14	3.506E-12	4.431E-12	2.410E-16-1.000E+00	2.030E-10	1.700E-09
EFFECTIVE	1.300E-14	3.680E-12	4.652E-12	2.530E-16-1.000E+00	2.110E-10	5.150E-10
SKIN (FGR)	1.140E-13	2.022E-10	2.556E-10	1.390E-14-1.000E+00	0.000E+00	0.000E+00
Y-93						
GONADS	4.670E-15	2.108E-12	4.989E-12	9.510E-17-1.000E+00	5.310E-12	2.200E-11
BREAST	5.300E-15	2.026E-12	4.794E-12	9.140E-17-1.000E+00	1.740E-12	3.130E-12
LUNGS	4.680E-15	1.937E-12	4.585E-12	8.740E-17-1.000E+00	2.520E-09	8.670E-13
RED MARR	4.580E-15	1.972E-12	4.669E-12	8.900E-17-1.000E+00	4.040E-12	4.930E-12
BONE SUR	7.580E-15	2.948E-12	6.977E-12	1.330E-16-1.000E+00	3.140E-12	1.730E-12
THYROID	4.790E-15	1.908E-12	4.516E-12	8.610E-17-1.000E+00	9.260E-13	1.260E-13
REMAINDER	4.510E-15	1.919E-12	4.543E-12	8.660E-17-1.000E+00	9.250E-10	4.090E-09
EFFECTIVE	4.800E-15	2.021E-12	4.784E-12	9.120E-17-1.000E+00	5.820E-10	1.230E-09
SKIN (FGR)	8.500E-14	2.726E-10	6.452E-10	1.230E-14-1.000E+00	0.000E+00	0.000E+00
Zr-95						
GONADS	3.530E-14	2.182E-11	4.421E-10	7.590E-16-1.000E+00	1.880E-09	8.160E-10
BREAST	4.010E-14	2.084E-11	4.223E-10	7.250E-16-1.000E+00	1.910E-09	1.050E-10
LUNGS	3.510E-14	1.989E-11	4.030E-10	6.920E-16-1.000E+00	2.170E-09	2.340E-11
RED MARR	3.430E-14	2.030E-11	4.112E-10	7.060E-16-1.000E+00	1.300E-08	2.140E-10
BONE SUR	5.620E-14	2.875E-11	5.824E-10	1.000E-15-1.000E+00	1.030E-07	4.860E-10
THYROID	3.610E-14	2.076E-11	4.205E-10	7.220E-16-1.000E+00	1.440E-09	8.270E-12
REMAINDER	3.360E-14	1.963E-11	3.978E-10	6.830E-16-1.000E+00	2.280E-09	2.530E-09
EFFECTIVE	3.600E-14	2.078E-11	4.211E-10	7.230E-16-1.000E+00	6.390E-09	1.020E-09
SKIN (FGR)	4.500E-14	2.561E-11	5.190E-10	8.910E-16-1.000E+00	0.000E+00	0.000E+00
Zr-97						
GONADS	8.800E-15	2.179E-11	7.799E-11	9.253E-16-1.000E+00	1.840E-10	6.228E-10
BREAST	9.990E-15	2.083E-11	7.455E-11	8.846E-16-1.000E+00	4.700E-11	8.137E-11
LUNGS	8.810E-15	1.992E-11	7.127E-11	8.456E-16-1.000E+00	4.100E-09	1.770E-11
RED MARR	8.640E-15	2.034E-11	7.279E-11	8.634E-16-1.000E+00	6.370E-11	1.302E-10
BONE SUR	1.380E-14	2.881E-11	1.031E-10	1.224E-15-1.000E+00	3.500E-11	4.558E-11
THYROID	9.030E-15	2.061E-11	7.377E-11	8.755E-16-1.000E+00	2.310E-11	2.671E-12
REMAINDER	8.480E-15	1.966E-11	7.035E-11	8.345E-16-1.000E+00	2.040E-09	6.990E-09

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

EFFECTIVE	9.020E-15	2.078E-11	7.438E-11	8.824E-16	-1.000E+00	1.170E-09	2.283E-09
SKIN (FGR)	5.550E-14	2.281E-10	8.148E-10	9.587E-15	-1.000E+00	0.000E+00	0.000E+00
Nb-95							
GONADS	3.660E-14	2.253E-11	4.435E-10	7.850E-16	-1.000E+00	4.320E-10	8.050E-10
BREAST	4.160E-14	2.150E-11	4.231E-10	7.490E-16	-1.000E+00	4.070E-10	1.070E-10
LUNGS	3.650E-14	2.055E-11	4.045E-10	7.160E-16	-1.000E+00	8.320E-09	2.740E-11
RED MARR	3.560E-14	2.101E-11	4.135E-10	7.320E-16	-1.000E+00	4.420E-10	1.990E-10
BONE SUR	5.790E-14	2.957E-11	5.819E-10	1.030E-15	-1.000E+00	5.130E-10	2.940E-10
THYROID	3.750E-14	2.144E-11	4.220E-10	7.470E-16	-1.000E+00	3.580E-10	1.180E-11
REMAINDER	3.490E-14	2.032E-11	4.000E-10	7.080E-16	-1.000E+00	1.070E-09	1.470E-09
EFFECTIVE	3.740E-14	2.147E-11	4.226E-10	7.480E-16	-1.000E+00	1.570E-09	6.950E-10
SKIN (FGR)	4.300E-14	2.598E-11	5.112E-10	9.050E-16	-1.000E+00	0.000E+00	0.000E+00
Mo-99							
GONADS	7.130E-15	4.282E-12	4.403E-11	1.550E-16	-1.000E+00	9.510E-11	2.180E-10
BREAST	8.130E-15	4.116E-12	4.233E-11	1.490E-16	-1.000E+00	2.750E-11	3.430E-11
LUNGS	7.060E-15	3.867E-12	3.977E-11	1.400E-16	-1.000E+00	4.290E-09	1.510E-11
RED MARR	6.820E-15	3.923E-12	4.034E-11	1.420E-16	-1.000E+00	5.240E-11	8.320E-11
BONE SUR	1.240E-14	6.105E-12	6.278E-11	2.210E-16	-1.000E+00	4.130E-11	6.320E-11
THYROID	7.270E-15	4.033E-12	4.147E-11	1.460E-16	-1.000E+00	1.520E-11	1.030E-11
REMAINDER	6.740E-15	3.812E-12	3.920E-11	1.380E-16	-1.000E+00	1.740E-09	4.280E-09
EFFECTIVE	7.280E-15	4.061E-12	4.176E-11	1.470E-16	-1.000E+00	1.070E-09	1.360E-09
SKIN (FGR)	3.140E-14	1.039E-10	1.068E-09	3.760E-15	-1.000E+00	0.000E+00	0.000E+00
Tc-99m							
GONADS	5.750E-15	2.334E-12	3.877E-12	1.240E-16	-1.000E+00	2.770E-12	9.750E-12
BREAST	6.650E-15	2.258E-12	3.752E-12	1.200E-16	-1.000E+00	2.150E-12	3.570E-12
LUNGS	5.490E-15	2.127E-12	3.533E-12	1.130E-16	-1.000E+00	2.280E-11	3.140E-12
RED MARR	4.910E-15	2.070E-12	3.439E-12	1.100E-16	-1.000E+00	3.360E-12	6.290E-12
BONE SUR	1.630E-14	5.383E-12	8.942E-12	2.860E-16	-1.000E+00	2.620E-12	4.060E-12
THYROID	5.750E-15	2.145E-12	3.564E-12	1.140E-16	-1.000E+00	5.010E-11	8.460E-11
REMAINDER	5.150E-15	2.070E-12	3.439E-12	1.100E-16	-1.000E+00	1.020E-11	3.340E-11
EFFECTIVE	5.890E-15	2.277E-12	3.783E-12	1.210E-16	-1.000E+00	8.800E-12	1.680E-11
SKIN (FGR)	7.140E-15	2.710E-12	4.502E-12	1.440E-16	-1.000E+00	0.000E+00	0.000E+00
Ru-103							
GONADS	2.190E-14	1.404E-11	2.783E-10	4.892E-16	-1.000E+00	3.070E-10	5.720E-10
BREAST	2.510E-14	1.350E-11	2.677E-10	4.705E-16	-1.000E+00	3.110E-10	1.200E-10
LUNGS	2.180E-14	1.273E-11	2.522E-10	4.432E-16	-1.000E+00	1.560E-08	7.310E-11
RED MARR	2.100E-14	1.287E-11	2.551E-10	4.483E-16	-1.000E+00	3.190E-10	1.660E-10
BONE SUR	3.890E-14	1.958E-11	3.882E-10	6.823E-16	-1.000E+00	2.370E-10	9.631E-11
THYROID	2.240E-14	1.331E-11	2.639E-10	4.638E-16	-1.000E+00	2.570E-10	6.250E-11
REMAINDER	2.080E-14	1.248E-11	2.472E-10	4.346E-16	-1.000E+00	1.250E-09	2.110E-09
EFFECTIVE	2.250E-14	1.332E-11	2.641E-10	4.642E-16	-1.000E+00	2.420E-09	8.271E-10
SKIN (FGR)	2.770E-14	1.785E-11	3.543E-10	6.229E-16	-1.000E+00	0.000E+00	0.000E+00
Ru-105							
GONADS	3.720E-14	1.327E-11	1.861E-11	8.070E-16	-1.000E+00	1.590E-11	9.670E-11
BREAST	4.240E-14	1.271E-11	1.783E-11	7.730E-16	-1.000E+00	6.610E-12	1.590E-11
LUNGS	3.700E-14	1.210E-11	1.697E-11	7.360E-16	-1.000E+00	5.730E-10	6.210E-12
RED MARR	3.590E-14	1.230E-11	1.725E-11	7.480E-16	-1.000E+00	7.700E-12	2.350E-11
BONE SUR	6.280E-14	1.809E-11	2.537E-11	1.100E-15	-1.000E+00	4.620E-12	8.890E-12
THYROID	3.800E-14	1.260E-11	1.766E-11	7.660E-16	-1.000E+00	4.150E-12	1.820E-12
REMAINDER	3.540E-14	1.189E-11	1.667E-11	7.230E-16	-1.000E+00	1.610E-10	8.540E-10
EFFECTIVE	3.810E-14	1.265E-11	1.773E-11	7.690E-16	-1.000E+00	1.230E-10	2.870E-10
SKIN (FGR)	6.730E-14	7.368E-11	1.033E-10	4.480E-15	-1.000E+00	0.000E+00	0.000E+00
Ru-106							
GONADS	0.000E+00	6.411E-12	1.340E-10	2.230E-16	-1.000E+00	1.300E-09	1.640E-09
BREAST	0.000E+00	6.152E-12	1.286E-10	2.140E-16	-1.000E+00	1.780E-09	1.440E-09
LUNGS	0.000E+00	5.836E-12	1.220E-10	2.030E-16	-1.000E+00	1.040E-06	1.420E-09
RED MARR	0.000E+00	5.893E-12	1.232E-10	2.050E-16	-1.000E+00	1.760E-09	1.460E-09
BONE SUR	0.000E+00	8.883E-12	1.856E-10	3.090E-16	-1.000E+00	1.610E-09	1.430E-09
THYROID	0.000E+00	6.066E-12	1.268E-10	2.110E-16	-1.000E+00	1.720E-09	1.410E-09
REMAINDER	0.000E+00	5.721E-12	1.196E-10	1.990E-16	-1.000E+00	1.200E-08	2.110E-08
EFFECTIVE	0.000E+00	6.095E-12	1.274E-10	2.120E-16	-1.000E+00	1.290E-07	7.400E-09
SKIN (FGR)	0.000E+00	4.082E-10	8.531E-09	1.420E-14	-1.000E+00	0.000E+00	0.000E+00
Rh-105							
GONADS	3.640E-15	2.127E-12	1.411E-11	7.980E-17	-1.000E+00	2.110E-11	5.800E-11
BREAST	4.160E-15	2.063E-12	1.369E-11	7.740E-17	-1.000E+00	5.610E-12	8.970E-12
LUNGS	3.570E-15	1.935E-12	1.284E-11	7.260E-17	-1.000E+00	9.580E-10	3.860E-12
RED MARR	3.380E-15	1.946E-12	1.291E-11	7.300E-17	-1.000E+00	7.770E-12	1.470E-11
BONE SUR	7.530E-15	3.332E-12	2.210E-11	1.250E-16	-1.000E+00	4.460E-12	6.750E-12
THYROID	3.680E-15	1.983E-12	1.316E-11	7.440E-17	-1.000E+00	2.880E-12	2.910E-12
REMAINDER	3.390E-15	1.885E-12	1.250E-11	7.070E-17	-1.000E+00	4.530E-10	1.270E-09
EFFECTIVE	3.720E-15	2.031E-12	1.347E-11	7.620E-17	-1.000E+00	2.580E-10	3.990E-10
SKIN (FGR)	1.070E-14	4.691E-12	3.112E-11	1.760E-16	-1.000E+00	0.000E+00	0.000E+00
Sb-127							

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

GONADS	3.260E-14	1.985E-11	2.441E-10	7.100E-16	-1.000E+00	2.520E-10	6.140E-10
BREAST	3.720E-14	1.904E-11	2.341E-10	6.810E-16	-1.000E+00	9.120E-11	7.600E-11
LUNGS	3.240E-14	1.809E-11	2.224E-10	6.470E-16	-1.000E+00	6.940E-09	1.570E-11
RED MARR	3.140E-14	1.834E-11	2.255E-10	6.560E-16	-1.000E+00	1.610E-10	1.330E-10
BONE SUR	5.520E-14	2.720E-11	3.345E-10	9.730E-16	-1.000E+00	1.340E-10	5.240E-11
THYROID	3.330E-14	1.884E-11	2.317E-10	6.740E-16	-1.000E+00	6.150E-11	4.640E-12
REMAINDER	3.090E-14	1.775E-11	2.183E-10	6.350E-16	-1.000E+00	2.330E-09	5.870E-09
EFFECTIVE	3.330E-14	1.890E-11	2.324E-10	6.760E-16	-1.000E+00	1.630E-09	1.950E-09
SKIN (FGR)	5.580E-14	7.967E-11	9.799E-10	2.850E-15	-1.000E+00	0.000E+00	0.000E+00
Sb-129							
GONADS	6.970E-14	2.336E-11	3.231E-11	1.440E-15	-1.000E+00	2.150E-11	1.510E-10
BREAST	7.910E-14	2.222E-11	3.074E-11	1.370E-15	-1.000E+00	1.280E-11	2.560E-11
LUNGS	6.980E-14	2.141E-11	2.962E-11	1.320E-15	-1.000E+00	8.980E-10	9.390E-12
RED MARR	6.860E-14	2.190E-11	3.029E-11	1.350E-15	-1.000E+00	1.700E-11	3.670E-11
BONE SUR	1.070E-13	3.033E-11	4.196E-11	1.870E-15	-1.000E+00	1.460E-11	1.340E-11
THYROID	7.160E-14	2.174E-11	3.007E-11	1.340E-15	-1.000E+00	9.720E-12	1.470E-12
REMAINDER	6.710E-14	2.125E-11	2.939E-11	1.310E-15	-1.000E+00	1.870E-10	1.450E-09
EFFECTIVE	7.140E-14	2.238E-11	3.096E-11	1.380E-15	-1.000E+00	1.740E-10	4.840E-10
SKIN (FGR)	1.050E-13	8.273E-11	1.144E-10	5.100E-15	-1.000E+00	0.000E+00	0.000E+00
Te-127							
GONADS	2.370E-16	1.191E-13	2.661E-13	5.480E-18	-1.000E+00	2.020E-12	4.020E-12
BREAST	2.730E-16	1.158E-13	2.588E-13	5.330E-18	-1.000E+00	1.880E-12	3.000E-12
LUNGS	2.320E-16	1.060E-13	2.370E-13	4.880E-18	-1.000E+00	4.270E-10	2.890E-12
RED MARR	2.210E-16	1.058E-13	2.365E-13	4.870E-18	-1.000E+00	4.090E-12	6.570E-12
BONE SUR	4.650E-16	1.862E-13	4.162E-13	8.570E-18	-1.000E+00	4.090E-12	6.460E-12
THYROID	2.400E-16	1.106E-13	2.472E-13	5.090E-18	-1.000E+00	1.840E-12	2.860E-12
REMAINDER	2.210E-16	1.036E-13	2.316E-13	4.770E-18	-1.000E+00	1.110E-10	6.130E-10
EFFECTIVE	2.420E-16	1.125E-13	2.515E-13	5.180E-18	-1.000E+00	8.600E-11	1.870E-10
SKIN (FGR)	1.140E-14	1.173E-11	2.622E-11	5.400E-16	-1.000E+00	0.000E+00	0.000E+00
Te-127m							
GONADS	1.900E-16	4.689E-13	9.642E-12	1.630E-17	-1.000E+00	1.100E-10	1.250E-10
BREAST	2.690E-16	5.150E-13	1.059E-11	1.790E-17	-1.000E+00	1.100E-10	9.740E-11
LUNGS	7.620E-17	1.602E-13	3.295E-12	5.570E-18	-1.000E+00	3.340E-08	9.620E-11
RED MARR	6.430E-17	1.249E-13	2.567E-12	4.340E-18	-1.000E+00	5.360E-09	5.430E-09
BONE SUR	3.940E-16	9.005E-13	1.852E-11	3.130E-17	-1.000E+00	2.040E-08	2.070E-08
THYROID	1.500E-16	2.779E-13	5.714E-12	9.660E-18	-1.000E+00	9.660E-11	9.430E-11
REMAINDER	8.640E-17	1.999E-13	4.111E-12	6.950E-18	-1.000E+00	1.660E-09	2.980E-09
EFFECTIVE	1.470E-16	3.251E-13	6.684E-12	1.130E-17	-1.000E+00	5.810E-09	2.230E-09
SKIN (FGR)	8.490E-16	1.496E-12	3.076E-11	5.200E-17	-1.000E+00	0.000E+00	0.000E+00
Te-129							
GONADS	2.710E-15	3.889E-13	3.922E-13	6.510E-17	-1.000E+00	1.750E-12	1.590E-12
BREAST	3.120E-15	3.800E-13	3.832E-13	6.360E-17	-1.000E+00	1.680E-12	6.050E-13
LUNGS	2.640E-15	3.298E-13	3.326E-13	5.520E-17	-1.000E+00	1.330E-10	4.910E-13
RED MARR	2.540E-15	3.298E-13	3.326E-13	5.520E-17	-1.000E+00	1.970E-12	7.640E-13
BONE SUR	4.880E-15	5.753E-13	5.802E-13	9.630E-17	-1.000E+00	2.030E-12	5.400E-13
THYROID	2.740E-15	3.525E-13	3.555E-13	5.900E-17	-1.000E+00	1.630E-12	3.360E-13
REMAINDER	2.520E-15	3.262E-13	3.289E-13	5.460E-17	-1.000E+00	2.400E-11	1.790E-10
EFFECTIVE	2.750E-15	3.590E-13	3.621E-13	6.010E-17	-1.000E+00	2.420E-11	5.450E-11
SKIN (FGR)	3.570E-14	3.429E-11	3.458E-11	5.740E-15	-1.000E+00	0.000E+00	0.000E+00
Te-129m							
GONADS	1.560E-15	2.206E-12	4.799E-11	8.561E-17	-1.000E+00	1.780E-10	2.420E-10
BREAST	1.810E-15	2.181E-12	4.739E-11	8.454E-17	-1.000E+00	1.690E-10	1.664E-10
LUNGS	1.460E-15	1.741E-12	3.815E-11	6.808E-17	-1.000E+00	4.030E-08	1.593E-10
RED MARR	1.420E-15	1.729E-12	3.793E-11	6.768E-17	-1.000E+00	3.100E-09	3.500E-09
BONE SUR	2.600E-15	3.287E-12	7.147E-11	1.275E-16	-1.000E+00	7.050E-09	7.990E-09
THYROID	1.560E-15	1.923E-12	4.201E-11	7.495E-17	-1.000E+00	1.560E-10	1.572E-10
REMAINDER	1.410E-15	1.746E-12	3.822E-11	6.819E-17	-1.000E+00	3.270E-09	7.196E-09
EFFECTIVE	1.550E-15	1.974E-12	4.308E-11	7.686E-17	-1.000E+00	6.470E-09	2.925E-09
SKIN (FGR)	1.490E-14	1.501E-10	3.360E-09	6.001E-15	-1.000E+00	0.000E+00	0.000E+00
Te-131m							
GONADS	6.850E-14	4.020E-11	2.343E-10	1.535E-15	-1.000E+00	2.340E-10	7.415E-10
BREAST	7.780E-14	3.853E-11	2.246E-10	1.472E-15	-1.000E+00	9.250E-11	1.361E-10
LUNGS	6.830E-14	3.657E-11	2.131E-10	1.397E-15	-1.000E+00	2.230E-09	6.335E-11
RED MARR	6.680E-14	3.736E-11	2.178E-10	1.427E-15	-1.000E+00	1.410E-10	2.435E-10
BONE SUR	1.090E-13	5.467E-11	3.189E-10	2.090E-15	-1.000E+00	2.270E-10	3.248E-10
THYROID	7.020E-14	3.741E-11	2.181E-10	1.429E-15	-1.000E+00	3.610E-08	4.383E-08
REMAINDER	6.550E-14	3.626E-11	2.113E-10	1.385E-15	-1.000E+00	9.460E-10	3.153E-09
EFFECTIVE	7.010E-14	3.825E-11	2.229E-10	1.461E-15	-1.000E+00	1.730E-09	2.514E-09
SKIN (FGR)	8.850E-14	1.033E-10	6.188E-10	4.056E-15	-1.000E+00	0.000E+00	0.000E+00
Te-132							
GONADS	1.020E-14	6.812E-12	7.706E-11	2.450E-16	-1.000E+00	4.150E-10	5.410E-10
BREAST	1.180E-14	6.756E-12	7.643E-11	2.430E-16	-1.000E+00	3.630E-10	3.500E-10
LUNGS	9.650E-15	5.727E-12	6.479E-11	2.060E-16	-1.000E+00	1.670E-09	3.300E-10

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

RED MARR	8.950E-15	5.588E-12	6.322E-11	2.010E-16	-1.000E+00	4.270E-10	4.440E-10
BONE SUR	2.420E-14	1.273E-11	1.441E-10	4.580E-16	-1.000E+00	7.120E-10	8.300E-10
THYROID	1.020E-14	5.978E-12	6.762E-11	2.150E-16	-1.000E+00	6.280E-08	5.950E-08
REMAINDER	9.160E-15	5.644E-12	6.385E-11	2.030E-16	-1.000E+00	7.890E-10	1.490E-09
EFFECTIVE	1.030E-14	6.339E-12	7.171E-11	2.280E-16	-1.000E+00	2.550E-09	2.540E-09
SKIN (FGR)	1.390E-14	8.313E-12	9.405E-11	2.990E-16	-1.000E+00	0.000E+00	0.000E+00
I-131							
GONADS	1.780E-14	1.119E-11	1.789E-10	3.940E-16	-1.000E+00	2.530E-11	4.070E-11
BREAST	2.040E-14	1.082E-11	1.730E-10	3.810E-16	-1.000E+00	7.880E-11	1.210E-10
LUNGS	1.760E-14	1.016E-11	1.626E-10	3.580E-16	-1.000E+00	6.570E-10	1.020E-10
RED MARR	1.680E-14	1.022E-11	1.635E-10	3.600E-16	-1.000E+00	6.260E-11	9.440E-11
BONE SUR	3.450E-14	1.675E-11	2.679E-10	5.900E-16	-1.000E+00	5.730E-11	8.720E-11
THYROID	1.810E-14	1.053E-11	1.685E-10	3.710E-16	-1.000E+00	2.920E-07	4.760E-07
REMAINDER	1.670E-14	9.908E-12	1.585E-10	3.490E-16	-1.000E+00	8.030E-11	1.570E-10
EFFECTIVE	1.820E-14	1.067E-11	1.707E-10	3.760E-16	-1.000E+00	8.890E-09	1.440E-08
SKIN (FGR)	2.980E-14	1.825E-11	2.920E-10	6.430E-16	-1.000E+00	0.000E+00	0.000E+00
I-132							
GONADS	1.090E-13	2.523E-11	2.771E-11	2.320E-15	-1.000E+00	9.950E-12	2.330E-11
BREAST	1.240E-13	2.414E-11	2.652E-11	2.220E-15	-1.000E+00	1.410E-11	2.520E-11
LUNGS	1.090E-13	2.305E-11	2.532E-11	2.120E-15	-1.000E+00	2.710E-10	2.640E-11
RED MARR	1.070E-13	2.360E-11	2.592E-11	2.170E-15	-1.000E+00	1.400E-11	2.460E-11
BONE SUR	1.730E-13	3.327E-11	3.655E-11	3.060E-15	-1.000E+00	1.240E-11	2.190E-11
THYROID	1.120E-13	2.381E-11	2.616E-11	2.190E-15	-1.000E+00	1.740E-09	3.870E-09
REMAINDER	1.050E-13	2.283E-11	2.509E-11	2.100E-15	-1.000E+00	3.780E-11	1.650E-10
EFFECTIVE	1.120E-13	2.403E-11	2.640E-11	2.210E-15	-1.000E+00	1.030E-10	1.820E-10
SKIN (FGR)	1.580E-13	8.199E-11	9.007E-11	7.540E-15	-1.000E+00	0.000E+00	0.000E+00
I-133							
GONADS	2.870E-14	1.585E-11	6.748E-11	6.270E-16	-1.000E+00	1.950E-11	3.630E-11
BREAST	3.280E-14	1.519E-11	6.468E-11	6.010E-16	-1.000E+00	2.940E-11	4.680E-11
LUNGS	2.860E-14	1.446E-11	6.156E-11	5.720E-16	-1.000E+00	8.200E-10	4.530E-11
RED MARR	2.770E-14	1.466E-11	6.242E-11	5.800E-16	-1.000E+00	2.720E-11	4.300E-11
BONE SUR	4.870E-14	2.161E-11	9.202E-11	8.550E-16	-1.000E+00	2.520E-11	4.070E-11
THYROID	2.930E-14	1.502E-11	6.393E-11	5.940E-16	-1.000E+00	4.860E-08	9.100E-08
REMAINDER	2.730E-14	1.418E-11	6.038E-11	5.610E-16	-1.000E+00	5.000E-11	1.550E-10
EFFECTIVE	2.940E-14	1.509E-11	6.425E-11	5.970E-16	-1.000E+00	1.580E-09	2.800E-09
SKIN (FGR)	5.830E-14	1.150E-10	4.897E-10	4.550E-15	-1.000E+00	0.000E+00	0.000E+00
I-134							
GONADS	1.270E-13	1.200E-11	1.202E-11	2.640E-15	-1.000E+00	4.250E-12	1.100E-11
BREAST	1.440E-13	1.145E-11	1.147E-11	2.520E-15	-1.000E+00	6.170E-12	1.170E-11
LUNGS	1.270E-13	1.100E-11	1.102E-11	2.420E-15	-1.000E+00	1.430E-10	1.260E-11
RED MARR	1.250E-13	1.127E-11	1.129E-11	2.480E-15	-1.000E+00	6.080E-12	1.090E-11
BONE SUR	1.960E-13	1.568E-11	1.571E-11	3.450E-15	-1.000E+00	5.310E-12	9.320E-12
THYROID	1.300E-13	1.127E-11	1.129E-11	2.480E-15	-1.000E+00	2.880E-10	6.210E-10
REMAINDER	1.220E-13	1.091E-11	1.093E-11	2.400E-15	-1.000E+00	2.270E-11	1.340E-10
EFFECTIVE	1.300E-13	1.150E-11	1.152E-11	2.530E-15	-1.000E+00	3.550E-11	6.660E-11
SKIN (FGR)	1.870E-13	4.477E-11	4.485E-11	9.850E-15	-1.000E+00	0.000E+00	0.000E+00
I-135							
GONADS	7.770E-14	3.113E-11	5.489E-11	1.599E-15	-1.000E+00	1.700E-11	3.610E-11
BREAST	8.790E-14	2.971E-11	5.240E-11	1.526E-15	-1.000E+00	2.340E-11	3.850E-11
LUNGS	7.840E-14	2.886E-11	5.089E-11	1.482E-15	-1.000E+00	4.410E-10	3.750E-11
RED MARR	7.760E-14	2.965E-11	5.228E-11	1.523E-15	-1.000E+00	2.240E-11	3.650E-11
BONE SUR	1.130E-13	3.983E-11	7.024E-11	2.046E-15	-1.000E+00	2.010E-11	3.360E-11
THYROID	8.010E-14	2.852E-11	5.030E-11	1.465E-15	-1.000E+00	8.460E-09	1.790E-08
REMAINDER	7.570E-14	2.883E-11	5.084E-11	1.481E-15	-1.000E+00	4.700E-11	1.540E-10
EFFECTIVE	7.980E-14	2.989E-11	5.271E-11	1.535E-15	-1.000E+00	3.320E-10	6.080E-10
SKIN (FGR)	1.110E-13	9.826E-11	1.733E-10	5.047E-15	-1.000E+00	0.000E+00	0.000E+00
Xe-133							
GONADS	1.610E-15	1.465E-12	2.052E-11	5.200E-17	-1.000E+00	0.000E+00	0.000E+00
BREAST	1.960E-15	1.505E-12	2.107E-11	5.340E-17	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.320E-15	1.045E-12	1.464E-11	3.710E-17	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.070E-15	8.791E-13	1.231E-11	3.120E-17	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	5.130E-15	4.254E-12	5.958E-11	1.510E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.510E-15	1.181E-12	1.653E-11	4.190E-17	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	1.240E-15	1.042E-12	1.460E-11	3.700E-17	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.560E-15	1.299E-12	1.819E-11	4.610E-17	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	4.970E-15	1.953E-12	2.734E-11	6.930E-17	-1.000E+00	0.000E+00	0.000E+00
Xe-135							
GONADS	1.170E-14	5.455E-12	1.194E-11	2.530E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	1.330E-14	5.325E-12	1.166E-11	2.470E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.130E-14	4.959E-12	1.086E-11	2.300E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.070E-14	4.959E-12	1.086E-11	2.300E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	2.570E-14	9.120E-12	1.997E-11	4.230E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.180E-14	5.023E-12	1.100E-11	2.330E-16	-1.000E+00	0.000E+00	0.000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

REMAINDER	1.080E-14	4.829E-12	1.058E-11	2.240E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.190E-14	5.217E-12	1.142E-11	2.420E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	3.120E-14	4.506E-11	9.867E-11	2.090E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-134							
GONADS	7.400E-14	4.607E-11	9.646E-10	1.600E-15	-1.000E+00	1.300E-08	2.060E-08
BREAST	8.430E-14	4.406E-11	9.224E-10	1.530E-15	-1.000E+00	1.080E-08	1.720E-08
LUNGS	7.370E-14	4.204E-11	8.802E-10	1.460E-15	-1.000E+00	1.180E-08	1.760E-08
RED MARR	7.190E-14	4.262E-11	8.922E-10	1.480E-15	-1.000E+00	1.180E-08	1.870E-08
BONE SUR	1.200E-13	6.105E-11	1.278E-09	2.120E-15	-1.000E+00	1.100E-08	1.740E-08
THYROID	7.570E-14	4.377E-11	9.163E-10	1.520E-15	-1.000E+00	1.110E-08	1.760E-08
REMAINDER	7.060E-14	4.147E-11	8.681E-10	1.440E-15	-1.000E+00	1.390E-08	2.210E-08
EFFECTIVE	7.570E-14	4.377E-11	9.163E-10	1.520E-15	-1.000E+00	1.250E-08	1.980E-08
SKIN (FGR)	9.450E-14	6.249E-11	1.308E-09	2.170E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-136							
GONADS	1.040E-13	6.223E-11	1.102E-09	2.180E-15	-1.000E+00	1.880E-09	3.040E-09
BREAST	1.180E-13	5.966E-11	1.056E-09	2.090E-15	-1.000E+00	1.670E-09	2.650E-09
LUNGS	1.040E-13	5.710E-11	1.011E-09	2.000E-15	-1.000E+00	2.320E-09	2.620E-09
RED MARR	1.010E-13	5.824E-11	1.031E-09	2.040E-15	-1.000E+00	1.860E-09	2.950E-09
BONE SUR	1.660E-13	8.422E-11	1.491E-09	2.950E-15	-1.000E+00	1.700E-09	2.710E-09
THYROID	1.070E-13	5.852E-11	1.036E-09	2.050E-15	-1.000E+00	1.730E-09	2.740E-09
REMAINDER	9.950E-14	5.652E-11	1.001E-09	1.980E-15	-1.000E+00	2.190E-09	3.520E-09
EFFECTIVE	1.060E-13	5.966E-11	1.056E-09	2.090E-15	-1.000E+00	1.980E-09	3.040E-09
SKIN (FGR)	1.250E-13	7.251E-11	1.284E-09	2.540E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-137							
GONADS	7.960E-18	1.669E-11	3.530E-10	5.840E-16	-1.000E+00	8.760E-09	1.390E-08
BREAST	9.670E-18	1.596E-11	3.376E-10	5.585E-16	-1.000E+00	7.840E-09	1.240E-08
LUNGS	6.680E-18	1.517E-11	3.209E-10	5.309E-16	-1.000E+00	8.820E-09	1.270E-08
RED MARR	5.700E-18	1.542E-11	3.260E-10	5.394E-16	-1.000E+00	8.300E-09	1.320E-08
BONE SUR	2.290E-17	2.238E-11	4.734E-10	7.832E-16	-1.000E+00	7.940E-09	1.260E-08
THYROID	7.550E-18	1.588E-11	3.358E-10	5.556E-16	-1.000E+00	7.930E-09	1.260E-08
REMAINDER	6.340E-18	1.490E-11	3.152E-10	5.215E-16	-1.000E+00	9.120E-09	1.450E-08
EFFECTIVE	7.740E-18	1.585E-11	3.353E-10	5.546E-16	-1.000E+00	8.630E-09	1.350E-08
SKIN (FGR)	8.630E-15	5.253E-11	1.110E-09	1.836E-15	-1.000E+00	0.000E+00	0.000E+00
Ba-139							
GONADS	2.130E-15	3.368E-13	3.429E-13	4.790E-17	-1.000E+00	2.560E-12	1.560E-12
BREAST	2.450E-15	3.297E-13	3.357E-13	4.690E-17	-1.000E+00	2.460E-12	5.170E-13
LUNGS	2.030E-15	3.002E-13	3.057E-13	4.270E-17	-1.000E+00	2.530E-10	3.890E-13
RED MARR	1.870E-15	2.932E-13	2.985E-13	4.170E-17	-1.000E+00	3.410E-12	8.590E-13
BONE SUR	5.290E-15	6.841E-13	6.965E-13	9.730E-17	-1.000E+00	2.490E-12	4.380E-13
THYROID	2.130E-15	3.044E-13	3.100E-13	4.330E-17	-1.000E+00	2.400E-12	2.660E-13
REMAINDER	1.920E-15	2.932E-13	2.985E-13	4.170E-17	-1.000E+00	4.820E-11	3.570E-10
EFFECTIVE	2.170E-15	3.227E-13	3.286E-13	4.590E-17	-1.000E+00	4.640E-11	1.080E-10
SKIN (FGR)	6.160E-14	7.241E-11	7.373E-11	1.030E-14	-1.000E+00	0.000E+00	0.000E+00
Ba-140							
GONADS	8.410E-15	5.451E-12	9.607E-11	1.910E-16	-1.000E+00	4.300E-10	9.960E-10
BREAST	9.640E-15	5.280E-12	9.305E-11	1.850E-16	-1.000E+00	2.870E-10	1.590E-10
LUNGS	8.270E-15	4.852E-12	8.550E-11	1.700E-16	-1.000E+00	1.660E-09	6.630E-11
RED MARR	7.930E-15	4.880E-12	8.601E-11	1.710E-16	-1.000E+00	1.290E-09	4.390E-10
BONE SUR	1.550E-14	8.020E-12	1.413E-10	2.810E-16	-1.000E+00	2.410E-09	5.530E-10
THYROID	8.530E-15	5.109E-12	9.003E-11	1.790E-16	-1.000E+00	2.560E-10	5.250E-11
REMAINDER	7.890E-15	4.766E-12	8.399E-11	1.670E-16	-1.000E+00	1.410E-09	7.370E-09
EFFECTIVE	8.580E-15	5.137E-12	9.053E-11	1.800E-16	-1.000E+00	1.010E-09	2.560E-09
SKIN (FGR)	2.520E-14	5.565E-11	9.808E-10	1.950E-15	-1.000E+00	0.000E+00	0.000E+00
La-140							
GONADS	1.140E-13	6.027E-11	4.425E-10	2.240E-15	-1.000E+00	4.540E-10	1.340E-09
BREAST	1.290E-13	5.758E-11	4.228E-10	2.140E-15	-1.000E+00	1.450E-10	1.800E-10
LUNGS	1.150E-13	5.596E-11	4.109E-10	2.080E-15	-1.000E+00	4.210E-09	4.010E-11
RED MARR	1.140E-13	5.731E-11	4.208E-10	2.130E-15	-1.000E+00	2.140E-10	2.810E-10
BONE SUR	1.690E-13	7.776E-11	5.709E-10	2.890E-15	-1.000E+00	1.410E-10	9.770E-11
THYROID	1.180E-13	5.462E-11	4.010E-10	2.030E-15	-1.000E+00	6.870E-11	6.400E-12
REMAINDER	1.110E-13	5.569E-11	4.089E-10	2.070E-15	-1.000E+00	2.120E-09	6.260E-09
EFFECTIVE	1.170E-13	5.812E-11	4.267E-10	2.160E-15	-1.000E+00	1.310E-09	2.280E-09
SKIN (FGR)	1.660E-13	2.217E-10	1.628E-09	8.240E-15	-1.000E+00	0.000E+00	0.000E+00
La-141							
GONADS	2.330E-15	7.315E-13	9.675E-13	4.740E-17	-1.000E+00	1.010E-11	3.770E-12
BREAST	2.640E-15	7.007E-13	9.267E-13	4.540E-17	-1.000E+00	9.840E-12	7.070E-13
LUNGS	2.340E-15	6.713E-13	8.879E-13	4.350E-17	-1.000E+00	6.460E-10	2.720E-13
RED MARR	2.310E-15	6.852E-13	9.063E-13	4.440E-17	-1.000E+00	2.930E-11	1.070E-12
BONE SUR	3.490E-15	9.923E-13	1.312E-12	6.430E-17	-1.000E+00	1.200E-10	6.060E-13
THYROID	2.390E-15	6.590E-13	8.716E-13	4.270E-17	-1.000E+00	9.400E-12	5.290E-14
REMAINDER	2.260E-15	6.682E-13	8.838E-13	4.330E-17	-1.000E+00	2.280E-10	1.240E-09
EFFECTIVE	2.390E-15	7.007E-13	9.267E-13	4.540E-17	-1.000E+00	1.570E-10	3.740E-10
SKIN (FGR)	6.580E-14	1.667E-10	2.204E-10	1.080E-14	-1.000E+00	0.000E+00	0.000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## La-142

GONADS	1.400E-13	1.978E-11	2.034E-11	2.540E-15-1.000E+00	1.660E-11	6.990E-11
BREAST	1.570E-13	1.885E-11	1.938E-11	2.420E-15-1.000E+00	1.130E-11	1.540E-11
LUNGS	1.420E-13	1.846E-11	1.898E-11	2.370E-15-1.000E+00	3.010E-10	8.400E-12
RED MARR	1.420E-13	1.900E-11	1.954E-11	2.440E-15-1.000E+00	1.360E-11	1.930E-11
BONE SUR	1.950E-13	2.484E-11	2.554E-11	3.190E-15-1.000E+00	1.110E-11	7.400E-12
THYROID	1.450E-13	1.768E-11	1.818E-11	2.270E-15-1.000E+00	8.740E-12	1.160E-12
REMAINDER	1.380E-13	1.853E-11	1.906E-11	2.380E-15-1.000E+00	8.070E-11	5.200E-10
EFFECTIVE	1.440E-13	1.916E-11	1.970E-11	2.460E-15-1.000E+00	6.840E-11	1.790E-10
SKIN (FGR)	2.160E-13	9.111E-11	9.368E-11	1.170E-14-1.000E+00	0.000E+00	0.000E+00

## Ce-141

GONADS	3.380E-15	2.213E-12	4.332E-11	7.710E-17-1.000E+00	5.540E-11	1.080E-10
BREAST	3.930E-15	2.170E-12	4.247E-11	7.560E-17-1.000E+00	4.460E-11	1.110E-11
LUNGS	3.170E-15	1.951E-12	3.820E-11	6.800E-17-1.000E+00	1.670E-08	1.430E-12
RED MARR	2.830E-15	1.860E-12	3.641E-11	6.480E-17-1.000E+00	8.960E-11	3.390E-11
BONE SUR	9.410E-15	5.166E-12	1.011E-10	1.800E-16-1.000E+00	2.540E-10	2.300E-11
THYROID	3.350E-15	2.003E-12	3.922E-11	6.980E-17-1.000E+00	2.550E-11	1.800E-13
REMAINDER	2.980E-15	1.894E-12	3.708E-11	6.600E-17-1.000E+00	1.260E-09	2.500E-09
EFFECTIVE	3.430E-15	2.118E-12	4.146E-11	7.380E-17-1.000E+00	2.420E-09	7.830E-10
SKIN (FGR)	1.020E-14	3.788E-12	7.416E-11	1.320E-16-1.000E+00	0.000E+00	0.000E+00

## Ce-143

GONADS	1.280E-14	7.900E-12	4.958E-11	2.980E-16-1.000E+00	7.530E-11	2.120E-10
BREAST	1.470E-14	7.688E-12	4.825E-11	2.900E-16-1.000E+00	1.660E-11	2.320E-11
LUNGS	1.230E-14	6.893E-12	4.325E-11	2.600E-16-1.000E+00	3.880E-09	3.820E-12
RED MARR	1.170E-14	6.787E-12	4.259E-11	2.560E-16-1.000E+00	2.960E-11	5.070E-11
BONE SUR	2.520E-14	1.323E-11	8.302E-11	4.990E-16-1.000E+00	1.640E-11	1.610E-11
THYROID	1.280E-14	7.211E-12	4.525E-11	2.720E-16-1.000E+00	6.230E-12	4.350E-13
REMAINDER	1.170E-14	6.734E-12	4.226E-11	2.540E-16-1.000E+00	1.420E-09	3.890E-09
EFFECTIVE	1.290E-14	7.396E-12	4.642E-11	2.790E-16-1.000E+00	9.160E-10	1.230E-09
SKIN (FGR)	3.960E-14	1.058E-10	6.638E-10	3.990E-15-1.000E+00	0.000E+00	0.000E+00

## Ce-144

GONADS	8.530E-16	6.328E-13	1.319E-11	6.088E-17-1.000E+00	2.390E-10	6.987E-11
BREAST	1.010E-15	6.274E-13	1.307E-11	5.922E-17-1.000E+00	3.480E-10	1.223E-11
LUNGS	7.690E-16	5.228E-13	1.089E-11	5.362E-17-1.000E+00	7.910E-07	6.551E-12
RED MARR	6.680E-16	4.755E-13	9.907E-12	5.247E-17-1.000E+00	2.880E-09	8.923E-11
BONE SUR	2.490E-15	1.646E-12	3.429E-11	1.127E-16-1.000E+00	4.720E-09	1.280E-10
THYROID	8.330E-16	5.529E-13	1.152E-11	5.418E-17-1.000E+00	2.920E-10	5.154E-12
REMAINDER	7.230E-16	5.086E-13	1.060E-11	5.283E-17-1.000E+00	1.910E-08	1.890E-08
EFFECTIVE	8.530E-16	5.909E-13	1.231E-11	5.766E-17-1.000E+00	1.010E-07	5.711E-09
SKIN (FGR)	2.930E-15	7.648E-13	1.594E-11	1.250E-14-1.000E+00	0.000E+00	0.000E+00

## Pr-143

GONADS	2.130E-17	2.264E-14	4.032E-13	7.930E-19-1.000E+00	4.370E-18	8.990E-18
BREAST	2.550E-17	2.330E-14	4.149E-13	8.160E-19-1.000E+00	2.220E-18	1.090E-18
LUNGS	1.860E-17	1.642E-14	2.923E-13	5.750E-19-1.000E+00	1.330E-08	1.910E-19
RED MARR	1.620E-17	1.493E-14	2.659E-13	5.230E-19-1.000E+00	1.480E-11	1.030E-12
BONE SUR	5.930E-17	5.454E-14	9.711E-13	1.910E-18-1.000E+00	1.490E-11	1.030E-12
THYROID	2.050E-17	1.802E-14	3.208E-13	6.310E-19-1.000E+00	1.680E-18	2.660E-20
REMAINDER	1.760E-17	1.642E-14	2.923E-13	5.750E-19-1.000E+00	1.970E-09	4.220E-09
EFFECTIVE	2.100E-17	2.002E-14	3.564E-13	7.010E-19-1.000E+00	2.190E-09	1.270E-09
SKIN (FGR)	1.760E-14	5.711E-11	1.017E-09	2.000E-15-1.000E+00	0.000E+00	0.000E+00

## Nd-147

GONADS	6.130E-15	4.218E-12	7.235E-11	1.480E-16-1.000E+00	8.410E-11	1.790E-10
BREAST	7.120E-15	4.132E-12	7.088E-11	1.450E-16-1.000E+00	3.450E-11	1.870E-11
LUNGS	5.820E-15	3.648E-12	6.257E-11	1.280E-16-1.000E+00	1.060E-08	2.440E-12
RED MARR	5.400E-15	3.505E-12	6.013E-11	1.230E-16-1.000E+00	9.190E-11	5.050E-11
BONE SUR	1.320E-14	8.265E-12	1.418E-10	2.900E-16-1.000E+00	3.260E-10	2.220E-11
THYROID	6.120E-15	3.876E-12	6.648E-11	1.360E-16-1.000E+00	1.820E-11	2.640E-13
REMAINDER	5.530E-15	3.562E-12	6.111E-11	1.250E-16-1.000E+00	1.760E-09	3.760E-09
EFFECTIVE	6.190E-15	3.961E-12	6.795E-11	1.390E-16-1.000E+00	1.850E-09	1.180E-09
SKIN (FGR)	1.950E-14	3.135E-11	5.377E-10	1.100E-15-1.000E+00	0.000E+00	0.000E+00

## Np-239

GONADS	7.530E-15	4.691E-12	4.380E-11	1.710E-16-1.000E+00	7.450E-11	1.620E-10
BREAST	8.730E-15	4.636E-12	4.329E-11	1.690E-16-1.000E+00	1.630E-11	1.720E-11
LUNGS	7.180E-15	4.115E-12	3.842E-11	1.500E-16-1.000E+00	2.360E-09	2.400E-12
RED MARR	6.500E-15	4.005E-12	3.740E-11	1.460E-16-1.000E+00	2.080E-10	4.660E-11
BONE SUR	2.000E-14	1.001E-11	9.349E-11	3.650E-16-1.000E+00	2.030E-09	3.590E-11
THYROID	7.520E-15	4.197E-12	3.919E-11	1.530E-16-1.000E+00	7.620E-12	2.070E-13
REMAINDER	6.760E-15	4.005E-12	3.740E-11	1.460E-16-1.000E+00	9.590E-10	2.770E-09
EFFECTIVE	7.690E-15	4.471E-12	4.175E-11	1.630E-16-1.000E+00	6.780E-10	8.820E-10
SKIN (FGR)	1.600E-14	7.215E-12	6.737E-11	2.630E-16-1.000E+00	0.000E+00	0.000E+00

## Pu-238

GONADS	6.560E-18	4.291E-14	9.011E-13	1.490E-18-1.000E+00	2.800E-05	2.330E-09
BREAST	1.270E-17	5.558E-14	1.167E-12	1.930E-18-1.000E+00	1.000E-09	1.800E-13

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

LUNGS	1.060E-18	2.267E-15	4.759E-14	7.870E-20	-1.000E+00	1.840E-05	8.640E-14
RED MARR	1.680E-18	5.587E-15	1.173E-13	1.940E-19	-1.000E+00	1.520E-04	1.270E-08
BONE SUR	9.300E-18	3.514E-14	7.378E-13	1.220E-18	-1.000E+00	1.900E-03	1.580E-07
THYROID	4.010E-18	9.792E-15	2.056E-13	3.400E-19	-1.000E+00	9.620E-10	7.990E-14
REMAINDER	1.990E-18	9.216E-15	1.935E-13	3.200E-19	-1.000E+00	7.020E-05	2.180E-08
EFFECTIVE	4.880E-18	2.413E-14	5.068E-13	8.380E-19	-1.000E+00	1.060E-04	1.340E-08
SKIN (FGR)	4.090E-17	2.776E-13	5.830E-12	9.640E-18	-1.000E+00	0.000E+00	0.000E+00
Pu-239							
GONADS	4.840E-18	1.768E-14	3.713E-13	6.140E-19	-1.000E+00	3.180E-05	2.640E-09
BREAST	7.550E-18	2.238E-14	4.699E-13	7.770E-19	-1.000E+00	9.220E-10	1.210E-13
LUNGS	2.650E-18	2.267E-15	4.760E-14	7.870E-20	-1.000E+00	1.730E-05	7.890E-14
RED MARR	2.670E-18	3.456E-15	7.258E-14	1.200E-19	-1.000E+00	1.690E-04	1.410E-08
BONE SUR	9.470E-18	1.673E-14	3.514E-13	5.810E-19	-1.000E+00	2.110E-03	1.760E-07
THYROID	3.880E-18	5.126E-15	1.077E-13	1.780E-19	-1.000E+00	9.030E-10	7.500E-14
REMAINDER	2.860E-18	4.838E-15	1.016E-13	1.680E-19	-1.000E+00	7.560E-05	2.120E-08
EFFECTIVE	4.240E-18	1.057E-14	2.220E-13	3.670E-19	-1.000E+00	1.160E-05	1.400E-08
SKIN (FGR)	1.860E-17	1.057E-13	2.220E-12	3.670E-18	-1.000E+00	0.000E+00	0.000E+00
Pu-240							
GONADS	6.360E-18	4.118E-14	8.649E-13	1.430E-18	-1.000E+00	3.180E-05	2.640E-09
BREAST	1.230E-17	5.328E-14	1.119E-12	1.850E-18	-1.000E+00	9.510E-10	1.730E-13
LUNGS	1.090E-18	2.249E-15	4.723E-14	7.810E-20	-1.000E+00	1.730E-05	8.220E-14
RED MARR	1.650E-18	5.386E-15	1.131E-13	1.870E-19	-1.000E+00	1.690E-04	1.410E-08
BONE SUR	9.260E-18	3.398E-14	7.137E-13	1.180E-18	-1.000E+00	2.110E-03	1.760E-07
THYROID	3.920E-18	9.446E-15	1.984E-13	3.280E-19	-1.000E+00	9.050E-10	7.510E-14
REMAINDER	1.960E-18	8.870E-15	1.863E-13	3.080E-19	-1.000E+00	7.560E-05	2.130E-08
EFFECTIVE	4.750E-18	2.313E-14	4.857E-13	8.030E-19	-1.000E+00	1.160E-04	1.400E-08
SKIN (FGR)	3.920E-17	2.644E-13	5.552E-12	9.180E-18	-1.000E+00	0.000E+00	0.000E+00
Pu-241							
GONADS	7.190E-20	6.653E-17	1.396E-15	2.310E-21	-1.000E+00	6.820E-07	5.660E-11
BREAST	8.670E-20	7.229E-17	1.517E-15	2.510E-21	-1.000E+00	3.060E-11	2.790E-15
LUNGS	6.480E-20	4.090E-17	8.584E-16	1.420E-21	-1.000E+00	7.420E-09	4.480E-15
RED MARR	5.630E-20	4.003E-17	8.403E-16	1.390E-21	-1.000E+00	3.360E-06	2.780E-10
BONE SUR	2.190E-19	1.385E-16	2.908E-15	4.810E-21	-1.000E+00	4.200E-05	3.480E-09
THYROID	6.980E-20	4.522E-17	9.491E-16	1.570E-21	-1.000E+00	1.240E-11	1.010E-15
REMAINDER	6.090E-20	4.291E-17	9.007E-16	1.490E-21	-1.000E+00	1.310E-06	1.850E-10
EFFECTIVE	7.250E-20	5.558E-17	1.167E-15	1.930E-21	-1.000E+00	2.230E-06	2.070E-10
SKIN (FGR)	1.170E-19	2.033E-16	4.268E-15	7.060E-21	-1.000E+00	0.000E+00	0.000E+00
Am-241							
GONADS	8.580E-16	9.360E-13	1.966E-11	3.250E-17	-1.000E+00	3.250E-05	2.700E-07
BREAST	1.070E-15	1.014E-12	2.129E-11	3.520E-17	-1.000E+00	2.670E-09	2.620E-11
LUNGS	6.740E-16	5.789E-13	1.216E-11	2.010E-17	-1.000E+00	1.840E-05	3.360E-11
RED MARR	5.210E-16	4.838E-13	1.016E-11	1.680E-17	-1.000E+00	1.740E-04	1.450E-06
BONE SUR	2.870E-15	2.678E-12	5.625E-11	9.300E-17	-1.000E+00	2.170E-03	1.810E-05
THYROID	7.830E-16	6.365E-13	1.337E-11	2.210E-17	-1.000E+00	1.600E-09	1.320E-11
REMAINDER	6.340E-16	5.933E-13	1.246E-11	2.060E-17	-1.000E+00	7.820E-05	6.660E-07
EFFECTIVE	8.180E-16	7.920E-13	1.663E-11	2.750E-17	-1.000E+00	1.200E-04	9.840E-07
SKIN (FGR)	1.280E-15	2.396E-12	5.032E-11	8.320E-17	-1.000E+00	0.000E+00	0.000E+00
Cm-242							
GONADS	7.830E-18	4.893E-14	1.013E-12	1.700E-18	-1.000E+00	5.700E-07	5.200E-09
BREAST	1.480E-17	6.159E-14	1.275E-12	2.140E-18	-1.000E+00	9.440E-10	8.950E-12
LUNGS	1.130E-18	3.022E-15	6.257E-14	1.050E-19	-1.000E+00	1.550E-05	8.840E-12
RED MARR	1.890E-18	6.562E-15	1.359E-13	2.280E-19	-1.000E+00	3.900E-06	3.570E-08
BONE SUR	1.060E-17	4.231E-14	8.759E-13	1.470E-18	-1.000E+00	4.870E-05	4.460E-07
THYROID	4.910E-18	1.261E-14	2.610E-13	4.380E-19	-1.000E+00	9.410E-10	8.820E-12
REMAINDER	2.270E-18	1.079E-14	2.235E-13	3.750E-19	-1.000E+00	2.450E-06	4.020E-08
EFFECTIVE	5.690E-18	2.751E-14	5.697E-13	9.560E-19	-1.000E+00	4.670E-06	3.100E-08
SKIN (FGR)	4.290E-17	2.700E-13	5.589E-12	9.380E-18	-1.000E+00	0.000E+00	0.000E+00
Cm-244							
GONADS	6.900E-18	4.522E-14	9.492E-13	1.570E-18	-1.000E+00	1.590E-05	1.330E-07
BREAST	1.330E-17	5.702E-14	1.197E-12	1.980E-18	-1.000E+00	1.040E-09	8.820E-12
LUNGS	7.080E-19	2.592E-15	5.441E-14	9.000E-20	-1.000E+00	1.930E-05	8.810E-12
RED MARR	1.460E-18	5.875E-15	1.233E-13	2.040E-19	-1.000E+00	9.380E-05	7.820E-07
BONE SUR	8.820E-18	3.859E-14	8.101E-13	1.340E-18	-1.000E+00	1.170E-03	9.770E-06
THYROID	4.190E-18	1.146E-14	2.406E-13	3.980E-19	-1.000E+00	1.010E-09	8.440E-12
REMAINDER	1.810E-18	9.821E-15	2.062E-13	3.410E-19	-1.000E+00	4.780E-05	4.150E-07
EFFECTIVE	4.910E-18	2.529E-14	5.308E-13	8.780E-19	-1.000E+00	6.700E-05	5.450E-07
SKIN (FGR)	3.910E-17	2.506E-13	5.260E-12	8.700E-18	-1.000E+00	0.000E+00	0.000E+00
I-130							
GONADS	1.010E-13	2.867E-11	5.828E-10	9.970E-16	-1.000E+00	2.810E-11	1.040E-09
BREAST	1.160E-13	2.737E-11	5.565E-10	9.520E-16	-1.000E+00	4.870E-11	1.790E-10
LUNGS	1.010E-13	2.617E-11	5.319E-10	9.100E-16	-1.000E+00	6.030E-10	8.530E-11
RED MARR	9.820E-14	2.671E-11	5.430E-10	9.290E-16	-1.000E+00	4.550E-11	2.600E-10
BONE SUR	1.680E-13	3.795E-11	7.716E-10	1.320E-15	-1.000E+00	4.030E-11	1.250E-10



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

THYROID	1.040E-13	2.720E-11	5.530E-10	9.460E-16	-1.000E+00	1.990E-08	6.310E-11
REMAINDER	9.660E-14	2.585E-11	5.255E-10	8.990E-16	-1.000E+00	8.020E-11	1.580E-09
EFFECTIVE	1.040E-13	2.732E-11	5.553E-10	9.500E-16	-1.000E+00	7.140E-10	8.090E-10
SKIN (FGR)	1.360E-13	3.278E-11	6.664E-10	1.140E-15	-1.000E+00	0.000E+00	0.000E+00
Kr-83m							
GONADS	1.710E-18	7.056E-11	1.480E-09	2.450E-15	-1.000E+00	0.000E+00	3.190E-09
BREAST	5.050E-18	6.739E-11	1.413E-09	2.340E-15	-1.000E+00	0.000E+00	1.100E-09
LUNGS	1.640E-19	6.537E-11	1.371E-09	2.270E-15	-1.000E+00	0.000E+00	8.770E-10
RED MARR	3.830E-19	6.710E-11	1.407E-09	2.330E-15	-1.000E+00	0.000E+00	1.320E-09
BONE SUR	2.250E-18	8.956E-11	1.879E-09	3.110E-15	-1.000E+00	0.000E+00	9.390E-10
THYROID	6.430E-19	6.480E-11	1.359E-09	2.250E-15	-1.000E+00	0.000E+00	7.880E-10
REMAINDER	5.300E-19	6.508E-11	1.365E-09	2.260E-15	-1.000E+00	0.000E+00	4.970E-09
EFFECTIVE	1.500E-18	6.768E-11	1.419E-09	2.350E-15	-1.000E+00	0.000E+00	2.770E-09
SKIN (FGR)	3.560E-17	7.948E-11	1.667E-09	2.760E-15	-1.000E+00	0.000E+00	0.000E+00
Xe-138							
GONADS	5.590E-14	8.121E-14	1.704E-12	2.820E-18	-1.000E+00	0.000E+00	0.000E+00
BREAST	6.320E-14	7.891E-14	1.656E-12	2.740E-18	-1.000E+00	0.000E+00	0.000E+00
LUNGS	5.660E-14	7.056E-14	1.481E-12	2.450E-18	-1.000E+00	0.000E+00	0.000E+00
RED MARR	5.600E-14	6.998E-14	1.469E-12	2.430E-18	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	8.460E-14	1.287E-13	2.702E-12	4.470E-18	-1.000E+00	0.000E+00	0.000E+00
THYROID	5.770E-14	7.459E-14	1.565E-12	2.590E-18	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	5.490E-14	6.941E-14	1.457E-12	2.410E-18	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	5.770E-14	7.603E-14	1.596E-12	2.640E-18	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.070E-13	2.304E-11	4.835E-10	8.000E-16	-1.000E+00	0.000E+00	0.000E+00
Xe-131m							
GONADS	4.570E-16	2.594E-12	3.653E-12	1.570E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	6.020E-16	2.527E-12	3.560E-12	1.530E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	2.670E-16	2.379E-12	3.351E-12	1.440E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	2.270E-16	2.346E-12	3.304E-12	1.420E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	1.060E-15	5.286E-12	7.446E-12	3.200E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	3.910E-16	2.395E-12	3.374E-12	1.450E-16	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	2.710E-16	2.313E-12	3.257E-12	1.400E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	3.890E-16	2.511E-12	3.537E-12	1.520E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	4.820E-15	2.247E-11	3.164E-11	1.360E-15	-1.000E+00	0.000E+00	0.000E+00
Xe-133m							
GONADS	1.420E-15	4.962E-12	5.026E-12	7.610E-16	-1.000E+00	0.000E+00	0.000E+00
BREAST	1.700E-15	4.740E-12	4.802E-12	7.270E-16	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.190E-15	4.603E-12	4.663E-12	7.060E-16	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.100E-15	4.708E-12	4.769E-12	7.220E-16	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	3.230E-15	6.514E-12	6.598E-12	9.990E-16	-1.000E+00	0.000E+00	0.000E+00
THYROID	1.360E-15	4.473E-12	4.531E-12	6.860E-16	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	1.150E-15	4.590E-12	4.650E-12	7.040E-16	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	1.370E-15	4.773E-12	4.835E-12	7.320E-16	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	1.040E-14	8.802E-11	8.916E-11	1.350E-14	-1.000E+00	0.000E+00	0.000E+00
Xe-135m							
GONADS	2.000E-14	2.278E-11	2.655E-11	1.800E-15	-1.000E+00	0.000E+00	0.000E+00
BREAST	2.290E-14	2.177E-11	2.537E-11	1.720E-15	-1.000E+00	0.000E+00	0.000E+00
LUNGS	1.980E-14	2.139E-11	2.493E-11	1.690E-15	-1.000E+00	0.000E+00	0.000E+00
RED MARR	1.910E-14	2.190E-11	2.552E-11	1.730E-15	-1.000E+00	0.000E+00	0.000E+00
BONE SUR	3.500E-14	2.886E-11	3.363E-11	2.280E-15	-1.000E+00	0.000E+00	0.000E+00
THYROID	2.040E-14	2.012E-11	2.345E-11	1.590E-15	-1.000E+00	0.000E+00	0.000E+00
REMAINDER	1.890E-14	2.139E-11	2.493E-11	1.690E-15	-1.000E+00	0.000E+00	0.000E+00
EFFECTIVE	2.040E-14	2.202E-11	2.567E-11	1.740E-15	-1.000E+00	0.000E+00	0.000E+00
SKIN (FGR)	2.970E-14	5.607E-11	6.534E-11	4.430E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-138							
GONADS	1.170E-13	2.788E-12	5.187E-11	9.740E-17	-1.000E+00	3.280E-12	2.150E-09
BREAST	1.330E-13	2.662E-12	4.953E-11	9.300E-17	-1.000E+00	4.020E-12	2.140E-09
LUNGS	1.190E-13	2.553E-12	4.750E-11	8.920E-17	-1.000E+00	1.590E-10	2.140E-09
RED MARR	1.180E-13	2.619E-12	4.873E-11	9.150E-17	-1.000E+00	3.950E-12	3.720E-09
BONE SUR	1.700E-13	3.635E-12	6.764E-11	1.270E-16	-1.000E+00	3.550E-12	6.860E-09
THYROID	1.210E-13	2.599E-12	4.836E-11	9.080E-17	-1.000E+00	3.570E-12	2.140E-09
REMAINDER	1.150E-13	2.542E-12	4.729E-11	8.880E-17	-1.000E+00	2.060E-11	2.330E-09
EFFECTIVE	1.210E-13	2.665E-12	4.958E-11	9.310E-17	-1.000E+00	2.740E-11	2.530E-09
SKIN (FGR)	2.170E-13	2.210E-10	4.111E-09	7.720E-15	-1.000E+00	0.000E+00	0.000E+00
Cs-134m							
GONADS	9.300E-16	7.155E-14	1.436E-12	2.490E-18	-1.000E+00	3.610E-12	8.050E-12
BREAST	1.120E-15	7.212E-14	1.447E-12	2.510E-18	-1.000E+00	3.390E-12	7.980E-12
LUNGS	7.840E-16	5.689E-14	1.142E-12	1.980E-18	-1.000E+00	6.400E-11	7.970E-12
RED MARR	6.810E-16	5.345E-14	1.073E-12	1.860E-18	-1.000E+00	3.760E-12	1.080E-10
BONE SUR	2.610E-15	1.560E-13	3.131E-12	5.430E-18	-1.000E+00	3.550E-12	1.610E-10
THYROID	8.880E-16	6.063E-14	1.217E-12	2.110E-18	-1.000E+00	3.340E-12	7.970E-12
REMAINDER	7.450E-16	5.603E-14	1.124E-12	1.950E-18	-1.000E+00	6.900E-12	8.250E-09
EFFECTIVE	9.050E-16	6.523E-14	1.309E-12	2.270E-18	-1.000E+00	1.180E-11	2.500E-09

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

SKIN (FGR)	2.880E-15	1.914E-10	3.841E-09	6.660E-15	-1.000E+00	0.000E+00	0.000E+00
Rb-88							
GONADS	3.260E-14	9.590E-15	2.014E-13	3.330E-19	-1.000E+00	1.310E-12	5.040E-11
BREAST	3.670E-14	1.008E-14	2.116E-13	3.500E-19	-1.000E+00	1.430E-12	5.040E-11
LUNGS	3.310E-14	6.307E-15	1.324E-13	2.190E-19	-1.000E+00	1.470E-10	5.040E-11
RED MARR	3.300E-14	5.558E-15	1.167E-13	1.930E-19	-1.000E+00	1.450E-12	6.450E-09
BONE SUR	4.620E-14	2.393E-14	5.025E-13	8.310E-19	-1.000E+00	1.470E-12	1.390E-08
THYROID	3.370E-14	7.171E-15	1.506E-13	2.490E-19	-1.000E+00	1.370E-12	5.040E-11
REMAINDER	3.210E-14	6.422E-15	1.348E-13	2.230E-19	-1.000E+00	1.380E-11	6.700E-09
EFFECTIVE	3.360E-14	8.179E-15	1.717E-13	2.840E-19	-1.000E+00	2.260E-11	3.230E-09
SKIN (FGR)	1.830E-13	4.032E-12	8.465E-11	1.400E-16	-1.000E+00	0.000E+00	0.000E+00
Rb-89							
GONADS	1.030E-13	2.155E-11	5.062E-11	1.026E-15	-1.000E+00	1.340E-12	2.520E-10
BREAST	1.170E-13	2.059E-11	4.838E-11	9.806E-16	-1.000E+00	1.730E-12	3.676E-11
LUNGS	1.040E-13	1.970E-11	4.626E-11	9.376E-16	-1.000E+00	6.800E-11	1.055E-11
RED MARR	1.040E-13	2.011E-11	4.722E-11	9.570E-16	-1.000E+00	2.020E-12	5.659E-11
BONE SUR	1.480E-13	2.852E-11	6.709E-11	1.360E-15	-1.000E+00	2.540E-12	2.070E-11
THYROID	1.070E-13	2.035E-11	4.782E-11	9.693E-16	-1.000E+00	1.610E-12	1.968E-12
REMAINDER	1.010E-13	1.948E-11	4.573E-11	9.268E-16	-1.000E+00	8.140E-12	2.557E-09
EFFECTIVE	1.060E-13	2.057E-11	4.832E-11	9.793E-16	-1.000E+00	1.160E-11	8.455E-10
SKIN (FGR)	1.870E-13	1.748E-10	3.987E-10	8.080E-15	-1.000E+00	0.000E+00	0.000E+00
Sb-124							
GONADS	8.890E-14	1.593E-11	1.830E-11	1.300E-15	-1.000E+00	1.040E-09	8.180E-11
BREAST	1.010E-13	1.520E-11	1.745E-11	1.240E-15	-1.000E+00	8.940E-10	1.700E-11
LUNGS	8.970E-14	1.483E-11	1.703E-11	1.210E-15	-1.000E+00	4.140E-08	7.220E-12
RED MARR	8.850E-14	1.520E-11	1.745E-11	1.240E-15	-1.000E+00	1.090E-09	2.290E-11
BONE SUR	1.340E-13	2.010E-11	2.308E-11	1.640E-15	-1.000E+00	1.240E-09	8.490E-12
THYROID	9.150E-14	1.446E-11	1.661E-11	1.180E-15	-1.000E+00	6.740E-10	1.300E-12
REMAINDER	8.660E-14	1.471E-11	1.689E-11	1.200E-15	-1.000E+00	4.180E-09	1.720E-09
EFFECTIVE	9.150E-14	1.532E-11	1.759E-11	1.250E-15	-1.000E+00	6.800E-09	5.430E-10
SKIN (FGR)	1.260E-13	2.280E-11	2.618E-11	1.860E-15	-1.000E+00	0.000E+00	0.000E+00
Sb-125							
GONADS	1.980E-14	1.586E-13	1.601E-12	5.750E-18	-1.000E+00	3.600E-10	1.430E-14
BREAST	2.270E-14	1.578E-13	1.593E-12	5.720E-18	-1.000E+00	4.160E-10	1.270E-14
LUNGS	1.950E-14	1.313E-13	1.326E-12	4.760E-18	-1.000E+00	2.170E-08	1.260E-14
RED MARR	1.870E-14	1.261E-13	1.273E-12	4.570E-18	-1.000E+00	5.350E-10	3.700E-13
BONE SUR	3.530E-14	3.228E-13	3.259E-12	1.170E-17	-1.000E+00	9.780E-10	3.670E-13
THYROID	2.010E-14	1.385E-13	1.398E-12	5.020E-18	-1.000E+00	3.240E-10	1.260E-14
REMAINDER	1.860E-14	1.291E-13	1.303E-12	4.680E-18	-1.000E+00	1.450E-09	9.680E-09
EFFECTIVE	2.020E-14	1.468E-13	1.482E-12	5.320E-18	-1.000E+00	3.300E-09	2.910E-09
SKIN (FGR)	2.650E-14	2.897E-10	2.924E-09	1.050E-14	-1.000E+00	0.000E+00	0.000E+00
Sb-126							
GONADS	1.350E-13	1.756E-13	3.546E-12	6.110E-18	-1.000E+00	1.320E-09	3.540E-12
BREAST	1.530E-13	1.713E-13	3.459E-12	5.960E-18	-1.000E+00	6.440E-10	5.540E-13
LUNGS	1.340E-13	1.526E-13	3.082E-12	5.310E-18	-1.000E+00	1.380E-08	2.020E-13
RED MARR	1.300E-13	1.521E-13	3.070E-12	5.290E-18	-1.000E+00	7.970E-10	6.590E-12
BONE SUR	2.220E-13	2.903E-13	5.862E-12	1.010E-17	-1.000E+00	6.750E-10	6.130E-12
THYROID	1.370E-13	1.564E-13	3.157E-12	5.440E-18	-1.000E+00	4.800E-10	1.290E-13
REMAINDER	1.280E-13	1.509E-13	3.047E-12	5.250E-18	-1.000E+00	3.190E-09	8.570E-09
EFFECTIVE	1.370E-13	1.650E-13	3.332E-12	5.740E-18	-1.000E+00	3.170E-09	2.570E-09
SKIN (FGR)	1.730E-13	1.989E-10	4.016E-09	6.920E-15	-1.000E+00	0.000E+00	0.000E+00
Te-131							
GONADS	1.990E-14	3.855E-12	4.872E-12	2.650E-16	-1.000E+00	6.140E-12	1.960E-11
BREAST	2.280E-14	3.680E-12	4.652E-12	2.530E-16	-1.000E+00	5.530E-12	3.550E-12
LUNGS	1.960E-14	3.535E-12	4.468E-12	2.430E-16	-1.000E+00	2.540E-10	1.390E-12
RED MARR	1.880E-14	3.608E-12	4.560E-12	2.480E-16	-1.000E+00	6.640E-12	4.910E-12
BONE SUR	3.800E-14	5.091E-12	6.435E-12	3.500E-16	-1.000E+00	6.210E-12	1.750E-12
THYROID	2.030E-14	3.579E-12	4.523E-12	2.460E-16	-1.000E+00	2.630E-09	1.770E-13
REMAINDER	1.870E-14	3.506E-12	4.431E-12	2.410E-16	-1.000E+00	5.420E-11	1.700E-09
EFFECTIVE	2.040E-14	3.680E-12	4.652E-12	2.530E-16	-1.000E+00	1.290E-10	5.150E-10
SKIN (FGR)	6.890E-14	2.022E-10	2.556E-10	1.390E-14	-1.000E+00	0.000E+00	0.000E+00
Te-133							
GONADS	4.490E-14	2.108E-12	4.989E-12	9.510E-17	-1.000E+00	6.700E-13	2.200E-11
BREAST	5.100E-14	2.026E-12	4.794E-12	9.140E-17	-1.000E+00	8.480E-13	3.130E-12
LUNGS	4.470E-14	1.937E-12	4.585E-12	8.740E-17	-1.000E+00	4.390E-11	8.670E-13
RED MARR	4.360E-14	1.972E-12	4.669E-12	8.900E-17	-1.000E+00	8.390E-13	4.930E-12
BONE SUR	7.500E-14	2.948E-12	6.977E-12	1.330E-16	-1.000E+00	7.490E-13	1.730E-12
THYROID	4.590E-14	1.908E-12	4.516E-12	8.610E-17	-1.000E+00	5.910E-10	1.260E-13
REMAINDER	4.290E-14	1.919E-12	4.543E-12	8.660E-17	-1.000E+00	5.020E-12	4.090E-09
EFFECTIVE	4.600E-14	2.021E-12	4.784E-12	9.120E-17	-1.000E+00	2.490E-11	1.230E-09
SKIN (FGR)	1.060E-13	2.726E-10	6.452E-10	1.230E-14	-1.000E+00	0.000E+00	0.000E+00
Te-134							
GONADS	4.160E-14	2.182E-11	4.421E-10	7.590E-16	-1.000E+00	9.000E-12	8.160E-10

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

BREAST	4.750E-14	2.084E-11	4.223E-10	7.250E-16	-1.000E+00	8.720E-12	1.050E-10
LUNGS	4.100E-14	1.989E-11	4.030E-10	6.920E-16	-1.000E+00	6.020E-11	2.340E-11
RED MARR	3.940E-14	2.030E-11	4.112E-10	7.060E-16	-1.000E+00	9.300E-12	2.140E-10
BONE SUR	7.560E-14	2.875E-11	5.824E-10	1.000E-15	-1.000E+00	8.580E-12	4.860E-10
THYROID	4.230E-14	2.076E-11	4.205E-10	7.220E-16	-1.000E+00	5.540E-10	8.270E-12
REMAINDER	3.910E-14	1.963E-11	3.978E-10	6.830E-16	-1.000E+00	1.880E-11	2.530E-09
EFFECTIVE	4.240E-14	2.078E-11	4.211E-10	7.230E-16	-1.000E+00	3.440E-11	1.020E-09
SKIN (FGR)	6.350E-14	2.561E-11	5.190E-10	8.910E-16	-1.000E+00	0.000E+00	0.000E+00
Te-125m							
GONADS	5.960E-16	2.179E-11	7.799E-11	9.253E-16	-1.000E+00	7.930E-11	6.228E-10
BREAST	8.480E-16	2.083E-11	7.455E-11	8.846E-16	-1.000E+00	7.080E-11	8.137E-11
LUNGS	2.230E-16	1.992E-11	7.127E-11	8.456E-16	-1.000E+00	1.040E-08	1.770E-11
RED MARR	1.860E-16	2.034E-11	7.279E-11	8.634E-16	-1.000E+00	1.150E-09	1.302E-10
BONE SUR	1.220E-15	2.881E-11	1.031E-10	1.224E-15	-1.000E+00	1.180E-08	4.558E-11
THYROID	4.640E-16	2.061E-11	7.377E-11	8.755E-16	-1.000E+00	3.870E-11	2.671E-12
REMAINDER	2.590E-16	1.966E-11	7.035E-11	8.345E-16	-1.000E+00	6.750E-10	6.990E-09
EFFECTIVE	4.530E-16	2.078E-11	7.438E-11	8.824E-16	-1.000E+00	1.970E-09	2.283E-09
SKIN (FGR)	1.940E-15	2.281E-10	8.148E-10	9.587E-15	-1.000E+00	0.000E+00	0.000E+00
Te-133m							
GONADS	1.120E-13	2.253E-11	4.435E-10	7.850E-16	-1.000E+00	8.970E-12	8.050E-10
BREAST	1.270E-13	2.150E-11	4.231E-10	7.490E-16	-1.000E+00	7.820E-12	1.070E-10
LUNGS	1.120E-13	2.055E-11	4.045E-10	7.160E-16	-1.000E+00	1.820E-10	2.740E-11
RED MARR	1.090E-13	2.101E-11	4.135E-10	7.320E-16	-1.000E+00	8.320E-12	1.990E-10
BONE SUR	1.750E-13	2.957E-11	5.819E-10	1.030E-15	-1.000E+00	6.940E-12	2.940E-10
THYROID	1.150E-13	2.144E-11	4.220E-10	7.470E-16	-1.000E+00	2.610E-09	1.180E-11
REMAINDER	1.070E-13	2.032E-11	4.000E-10	7.080E-16	-1.000E+00	4.140E-11	1.470E-09
EFFECTIVE	1.140E-13	2.147E-11	4.226E-10	7.480E-16	-1.000E+00	1.170E-10	6.950E-10
SKIN (FGR)	1.740E-13	2.598E-11	5.112E-10	9.050E-16	-1.000E+00	0.000E+00	0.000E+00
Ba-141							
GONADS	4.060E-14	4.282E-12	4.403E-11	1.550E-16	-1.000E+00	1.410E-12	2.180E-10
BREAST	4.630E-14	4.116E-12	4.233E-11	1.490E-16	-1.000E+00	1.470E-12	3.430E-11
LUNGS	4.030E-14	3.867E-12	3.977E-11	1.400E-16	-1.000E+00	1.160E-10	1.510E-11
RED MARR	3.910E-14	3.923E-12	4.034E-11	1.420E-16	-1.000E+00	2.490E-12	8.320E-11
BONE SUR	7.170E-14	6.105E-12	6.278E-11	2.210E-16	-1.000E+00	4.730E-12	6.320E-11
THYROID	4.150E-14	4.033E-12	4.147E-11	1.460E-16	-1.000E+00	1.330E-12	1.030E-11
REMAINDER	3.870E-14	3.812E-12	3.920E-11	1.380E-16	-1.000E+00	2.270E-11	4.280E-09
EFFECTIVE	4.160E-14	4.061E-12	4.176E-11	1.470E-16	-1.000E+00	2.180E-11	1.360E-09
SKIN (FGR)	1.070E-13	1.039E-10	1.068E-09	3.760E-15	-1.000E+00	0.000E+00	0.000E+00
Ba-137m							
GONADS	2.820E-14	2.334E-12	3.877E-12	1.240E-16	-1.000E+00	0.000E+00	9.750E-12
BREAST	3.220E-14	2.258E-12	3.752E-12	1.200E-16	-1.000E+00	0.000E+00	3.570E-12
LUNGS	2.800E-14	2.127E-12	3.533E-12	1.130E-16	-1.000E+00	0.000E+00	3.140E-12
RED MARR	2.730E-14	2.070E-12	3.439E-12	1.100E-16	-1.000E+00	0.000E+00	6.290E-12
BONE SUR	4.630E-14	5.383E-12	8.942E-12	2.860E-16	-1.000E+00	0.000E+00	4.060E-12
THYROID	2.880E-14	2.145E-12	3.564E-12	1.140E-16	-1.000E+00	0.000E+00	8.460E-11
REMAINDER	2.680E-14	2.070E-12	3.439E-12	1.100E-16	-1.000E+00	0.000E+00	3.340E-11
EFFECTIVE	2.880E-14	2.277E-12	3.783E-12	1.210E-16	-1.000E+00	0.000E+00	1.680E-11
SKIN (FGR)	3.730E-14	2.710E-12	4.502E-12	1.440E-16	-1.000E+00	0.000E+00	0.000E+00
Pd-109							
GONADS	2.710E-16	1.404E-11	2.783E-10	4.892E-16	-1.000E+00	2.130E-12	5.720E-10
BREAST	3.520E-16	1.350E-11	2.677E-10	4.705E-16	-1.000E+00	5.110E-13	1.200E-10
LUNGS	1.940E-16	1.273E-11	2.522E-10	4.432E-16	-1.000E+00	1.200E-09	7.310E-11
RED MARR	1.740E-16	1.287E-11	2.551E-10	4.483E-16	-1.000E+00	9.820E-13	1.660E-10
BONE SUR	7.020E-16	1.958E-11	3.882E-10	6.823E-16	-1.000E+00	9.580E-13	9.631E-11
THYROID	2.460E-16	1.331E-11	2.639E-10	4.638E-16	-1.000E+00	1.550E-13	6.250E-11
REMAINDER	1.920E-16	1.248E-11	2.472E-10	4.346E-16	-1.000E+00	5.040E-10	2.110E-09
EFFECTIVE	2.510E-16	1.332E-11	2.641E-10	4.642E-16	-1.000E+00	2.960E-10	8.271E-10
SKIN (FGR)	2.150E-14	1.785E-11	3.543E-10	6.229E-16	-1.000E+00	0.000E+00	0.000E+00
Rh-106							
GONADS	1.010E-14	1.327E-11	1.861E-11	8.070E-16	-1.000E+00	0.000E+00	9.670E-11
BREAST	1.160E-14	1.271E-11	1.783E-11	7.730E-16	-1.000E+00	0.000E+00	1.590E-11
LUNGS	1.010E-14	1.210E-11	1.697E-11	7.360E-16	-1.000E+00	0.000E+00	6.210E-12
RED MARR	9.750E-15	1.230E-11	1.725E-11	7.480E-16	-1.000E+00	0.000E+00	2.350E-11
BONE SUR	1.720E-14	1.809E-11	2.537E-11	1.100E-15	-1.000E+00	0.000E+00	8.890E-12
THYROID	1.030E-14	1.260E-11	1.766E-11	7.660E-16	-1.000E+00	0.000E+00	1.820E-12
REMAINDER	9.630E-15	1.189E-11	1.667E-11	7.230E-16	-1.000E+00	0.000E+00	8.540E-10
EFFECTIVE	1.040E-14	1.265E-11	1.773E-11	7.690E-16	-1.000E+00	0.000E+00	2.870E-10
SKIN (FGR)	1.090E-13	7.368E-11	1.033E-10	4.480E-15	-1.000E+00	0.000E+00	0.000E+00
Rh-103m							
GONADS	1.250E-17	6.411E-12	1.340E-10	2.230E-16	-1.000E+00	8.910E-14	1.640E-09
BREAST	2.150E-17	6.152E-12	1.286E-10	2.140E-16	-1.000E+00	8.800E-14	1.440E-09
LUNGS	1.870E-18	5.836E-12	1.220E-10	2.030E-16	-1.000E+00	7.750E-12	1.420E-09
RED MARR	2.820E-18	5.893E-12	1.232E-10	2.050E-16	-1.000E+00	8.840E-14	1.460E-09

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

BONE SUR	1.760E-17	8.883E-12	1.856E-10	3.090E-16	-1.000E+00	8.730E-14	1.430E-09
THYROID	8.550E-18	6.066E-12	1.268E-10	2.110E-16	-1.000E+00	8.490E-14	1.410E-09
REMAINDER	3.680E-18	5.721E-12	1.196E-10	1.990E-16	-1.000E+00	1.340E-12	2.110E-08
EFFECTIVE	8.800E-18	6.095E-12	1.274E-10	2.120E-16	-1.000E+00	1.380E-12	7.400E-09
SKIN (FGR)	4.490E-17	4.082E-10	8.531E-09	1.420E-14	-1.000E+00	0.000E+00	0.000E+00
Tc-101							
GONADS	1.570E-14	2.127E-12	1.411E-11	7.980E-17	-1.000E+00	2.500E-13	5.800E-11
BREAST	1.800E-14	2.063E-12	1.369E-11	7.740E-17	-1.000E+00	3.030E-13	8.970E-12
LUNGS	1.540E-14	1.935E-12	1.284E-11	7.260E-17	-1.000E+00	2.830E-11	3.860E-12
RED MARR	1.460E-14	1.946E-12	1.291E-11	7.300E-17	-1.000E+00	3.190E-13	1.470E-11
BONE SUR	3.210E-14	3.332E-12	2.210E-11	1.250E-16	-1.000E+00	2.800E-13	6.750E-12
THYROID	1.590E-14	1.983E-12	1.316E-11	7.440E-17	-1.000E+00	7.720E-12	2.910E-12
REMAINDER	1.470E-14	1.885E-12	1.250E-11	7.070E-17	-1.000E+00	3.520E-12	1.270E-09
EFFECTIVE	1.610E-14	2.031E-12	1.347E-11	7.620E-17	-1.000E+00	4.840E-12	3.990E-10
SKIN (FGR)	4.770E-14	4.691E-12	3.112E-11	1.760E-16	-1.000E+00	0.000E+00	0.000E+00
Eu-154							
GONADS	6.000E-14	1.985E-11	2.441E-10	7.100E-16	-1.000E+00	1.170E-08	6.140E-10
BREAST	6.810E-14	1.904E-11	2.341E-10	6.810E-16	-1.000E+00	1.550E-08	7.600E-11
LUNGS	5.990E-14	1.809E-11	2.224E-10	6.470E-16	-1.000E+00	7.920E-08	1.570E-11
RED MARR	5.870E-14	1.834E-11	2.255E-10	6.560E-16	-1.000E+00	1.060E-07	1.330E-10
BONE SUR	9.430E-14	2.720E-11	3.345E-10	9.730E-16	-1.000E+00	5.230E-07	5.240E-11
THYROID	6.150E-14	1.884E-11	2.317E-10	6.740E-16	-1.000E+00	7.140E-09	4.640E-12
REMAINDER	5.750E-14	1.775E-11	2.183E-10	6.350E-16	-1.000E+00	1.130E-07	5.870E-09
EFFECTIVE	6.140E-14	1.890E-11	2.324E-10	6.760E-16	-1.000E+00	7.730E-08	1.950E-09
SKIN (FGR)	8.290E-14	7.967E-11	9.799E-10	2.850E-15	-1.000E+00	0.000E+00	0.000E+00
Eu-155							
GONADS	2.490E-15	2.336E-11	3.231E-11	1.440E-15	-1.000E+00	3.560E-10	1.510E-10
BREAST	2.950E-15	2.222E-11	3.074E-11	1.370E-15	-1.000E+00	6.140E-10	2.560E-11
LUNGS	2.220E-15	2.141E-11	2.962E-11	1.320E-15	-1.000E+00	1.190E-08	9.390E-12
RED MARR	1.850E-15	2.190E-11	3.029E-11	1.350E-15	-1.000E+00	1.430E-08	3.670E-11
BONE SUR	8.090E-15	3.033E-11	4.196E-11	1.870E-15	-1.000E+00	1.520E-07	1.340E-11
THYROID	2.410E-15	2.174E-11	3.007E-11	1.340E-15	-1.000E+00	2.400E-10	1.470E-12
REMAINDER	2.070E-15	2.125E-11	2.939E-11	1.310E-15	-1.000E+00	1.110E-08	1.450E-09
EFFECTIVE	2.490E-15	2.238E-11	3.096E-11	1.380E-15	-1.000E+00	1.120E-08	4.840E-10
SKIN (FGR)	3.390E-15	8.273E-11	1.144E-10	5.100E-15	-1.000E+00	0.000E+00	0.000E+00
Eu-156							
GONADS	6.570E-14	1.191E-13	2.661E-13	5.480E-18	-1.000E+00	6.120E-10	4.020E-12
BREAST	7.420E-14	1.158E-13	2.588E-13	5.330E-18	-1.000E+00	3.640E-10	3.000E-12
LUNGS	6.630E-14	1.060E-13	2.370E-13	4.880E-18	-1.000E+00	1.840E-08	2.890E-12
RED MARR	6.560E-14	1.058E-13	2.365E-13	4.870E-18	-1.000E+00	1.140E-09	6.570E-12
BONE SUR	9.580E-14	1.862E-13	4.162E-13	8.570E-18	-1.000E+00	2.760E-09	6.460E-12
THYROID	6.780E-14	1.106E-13	2.472E-13	5.090E-18	-1.000E+00	2.160E-10	2.860E-12
REMAINDER	6.410E-14	1.036E-13	2.316E-13	4.770E-18	-1.000E+00	3.910E-09	6.130E-10
EFFECTIVE	6.750E-14	1.125E-13	2.515E-13	5.180E-18	-1.000E+00	3.820E-09	1.870E-10
SKIN (FGR)	9.980E-14	1.173E-11	2.622E-11	5.400E-16	-1.000E+00	0.000E+00	0.000E+00
La-143							
GONADS	5.040E-15	4.689E-13	9.642E-12	1.630E-17	-1.000E+00	6.530E-13	1.250E-10
BREAST	5.700E-15	5.150E-13	1.059E-11	1.790E-17	-1.000E+00	3.200E-13	9.740E-11
LUNGS	5.070E-15	1.602E-13	3.295E-12	5.570E-18	-1.000E+00	1.060E-10	9.620E-11
RED MARR	5.010E-15	1.249E-13	2.567E-12	4.340E-18	-1.000E+00	7.300E-13	5.430E-09
BONE SUR	7.590E-15	9.005E-13	1.852E-11	3.130E-17	-1.000E+00	7.290E-13	2.070E-08
THYROID	5.190E-15	2.779E-13	5.714E-12	9.660E-18	-1.000E+00	2.440E-13	9.430E-11
REMAINDER	4.900E-15	1.999E-13	4.111E-12	6.950E-18	-1.000E+00	1.050E-11	2.980E-09
EFFECTIVE	5.180E-15	3.251E-13	6.684E-12	1.130E-17	-1.000E+00	1.620E-11	2.230E-09
SKIN (FGR)	9.640E-14	1.496E-12	3.076E-11	5.200E-17	-1.000E+00	0.000E+00	0.000E+00
Nb-97							
GONADS	3.110E-14	3.889E-13	3.922E-13	6.510E-17	-1.000E+00	8.650E-13	1.590E-12
BREAST	3.550E-14	3.800E-13	3.832E-13	6.360E-17	-1.000E+00	1.120E-12	6.050E-13
LUNGS	3.100E-14	3.298E-13	3.326E-13	5.520E-17	-1.000E+00	1.560E-10	4.910E-13
RED MARR	3.010E-14	3.298E-13	3.326E-13	5.520E-17	-1.000E+00	1.140E-12	7.640E-13
BONE SUR	5.110E-14	5.753E-13	5.802E-13	9.630E-17	-1.000E+00	8.260E-13	5.400E-13
THYROID	3.180E-14	3.525E-13	3.555E-13	5.900E-17	-1.000E+00	9.200E-13	3.360E-13
REMAINDER	2.960E-14	3.262E-13	3.289E-13	5.460E-17	-1.000E+00	1.050E-11	1.790E-10
EFFECTIVE	3.180E-14	3.590E-13	3.621E-13	6.010E-17	-1.000E+00	2.240E-11	5.450E-11
SKIN (FGR)	6.510E-14	3.429E-11	3.458E-11	5.740E-15	-1.000E+00	0.000E+00	0.000E+00
Nb-95m							
GONADS	2.880E-15	2.206E-12	4.799E-11	8.561E-17	-1.000E+00	4.960E-11	2.420E-10
BREAST	3.310E-15	2.181E-12	4.739E-11	8.454E-17	-1.000E+00	4.530E-11	1.664E-10
LUNGS	2.770E-15	1.741E-12	3.815E-11	6.808E-17	-1.000E+00	3.070E-09	1.593E-10
RED MARR	2.590E-15	1.729E-12	3.793E-11	6.768E-17	-1.000E+00	5.870E-11	3.500E-09
BONE SUR	6.600E-15	3.287E-12	7.147E-11	1.275E-16	-1.000E+00	6.610E-11	7.990E-09
THYROID	2.890E-15	1.923E-12	4.201E-11	7.495E-17	-1.000E+00	3.860E-11	1.572E-10
REMAINDER	2.630E-15	1.746E-12	3.822E-11	6.819E-17	-1.000E+00	8.690E-10	7.196E-09

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

EFFECTIVE	2.930E-15	1.974E-12	4.308E-11	7.686E-17	-1.000E+00	6.590E-10	2.925E-09
SKIN (FGR)	1.120E-14	1.501E-10	3.360E-09	6.001E-15	-1.000E+00	0.000E+00	0.000E+00
Pm-147							
GONADS	7.480E-19	4.020E-11	2.343E-10	1.535E-15	-1.000E+00	8.250E-15	7.415E-10
BREAST	9.560E-19	3.853E-11	2.246E-10	1.472E-15	-1.000E+00	3.600E-14	1.361E-10
LUNGS	5.450E-19	3.657E-11	2.131E-10	1.397E-15	-1.000E+00	7.740E-08	6.335E-11
RED MARR	4.460E-19	3.736E-11	2.178E-10	1.427E-15	-1.000E+00	1.610E-09	2.435E-10
BONE SUR	2.180E-18	5.467E-11	3.189E-10	2.090E-15	-1.000E+00	2.010E-08	3.248E-10
THYROID	6.750E-19	3.741E-11	2.181E-10	1.429E-15	-1.000E+00	1.980E-14	4.383E-08
REMAINDER	5.260E-19	3.626E-11	2.113E-10	1.385E-15	-1.000E+00	1.560E-09	3.153E-09
EFFECTIVE	6.930E-19	3.825E-11	2.229E-10	1.461E-15	-1.000E+00	1.060E-08	2.514E-09
SKIN (FGR)	8.110E-16	1.033E-10	6.188E-10	4.056E-15	-1.000E+00	0.000E+00	0.000E+00
Pm-148							
GONADS	2.810E-14	6.812E-12	7.706E-11	2.450E-16	-1.000E+00	2.120E-10	5.410E-10
BREAST	3.190E-14	6.756E-12	7.643E-11	2.430E-16	-1.000E+00	7.190E-11	3.500E-10
LUNGS	2.830E-14	5.727E-12	6.479E-11	2.060E-16	-1.000E+00	1.370E-08	3.300E-10
RED MARR	2.790E-14	5.588E-12	6.322E-11	2.010E-16	-1.000E+00	1.070E-10	4.440E-10
BONE SUR	4.240E-14	1.273E-11	1.441E-10	4.580E-16	-1.000E+00	7.080E-11	8.300E-10
THYROID	2.890E-14	5.978E-12	6.762E-11	2.150E-16	-1.000E+00	3.820E-11	5.950E-08
REMAINDER	2.730E-14	5.644E-12	6.385E-11	2.030E-16	-1.000E+00	4.100E-09	1.490E-09
EFFECTIVE	2.890E-14	6.339E-12	7.171E-11	2.280E-16	-1.000E+00	2.950E-09	2.540E-09
SKIN (FGR)	7.970E-14	8.313E-12	9.405E-11	2.990E-16	-1.000E+00	0.000E+00	0.000E+00
Pm-149							
GONADS	5.300E-16	1.119E-11	1.789E-10	3.940E-16	-1.000E+00	3.610E-12	4.070E-11
BREAST	6.070E-16	1.082E-11	1.730E-10	3.810E-16	-1.000E+00	8.200E-13	1.210E-10
LUNGS	5.170E-16	1.016E-11	1.626E-10	3.580E-16	-1.000E+00	3.120E-09	1.020E-10
RED MARR	4.890E-16	1.022E-11	1.635E-10	3.600E-16	-1.000E+00	5.530E-12	9.440E-11
BONE SUR	1.100E-15	1.675E-11	2.679E-10	5.900E-16	-1.000E+00	5.010E-12	8.720E-11
THYROID	5.360E-16	1.053E-11	1.685E-10	3.710E-16	-1.000E+00	3.310E-13	4.760E-07
REMAINDER	4.910E-16	9.908E-12	1.585E-10	3.490E-16	-1.000E+00	1.390E-09	1.570E-10
EFFECTIVE	5.410E-16	1.067E-11	1.707E-10	3.760E-16	-1.000E+00	7.930E-10	1.440E-08
SKIN (FGR)	2.190E-14	1.825E-11	2.920E-10	6.430E-16	-1.000E+00	0.000E+00	0.000E+00
Pm-151							
GONADS	1.480E-14	2.523E-11	2.771E-11	2.320E-15	-1.000E+00	7.170E-11	2.330E-11
BREAST	1.700E-14	2.414E-11	2.652E-11	2.220E-15	-1.000E+00	1.590E-11	2.520E-11
LUNGS	1.440E-14	2.305E-11	2.532E-11	2.120E-15	-1.000E+00	1.640E-09	2.640E-11
RED MARR	1.370E-14	2.360E-11	2.592E-11	2.170E-15	-1.000E+00	2.720E-11	2.460E-11
BONE SUR	2.990E-14	3.327E-11	3.655E-11	3.060E-15	-1.000E+00	1.860E-11	2.190E-11
THYROID	1.500E-14	2.381E-11	2.616E-11	2.190E-15	-1.000E+00	6.180E-12	3.870E-09
REMAINDER	1.370E-14	2.283E-11	2.509E-11	2.100E-15	-1.000E+00	8.390E-10	1.650E-10
EFFECTIVE	1.510E-14	2.403E-11	2.640E-11	2.210E-15	-1.000E+00	4.730E-10	1.820E-10
SKIN (FGR)	3.320E-14	8.199E-11	9.007E-11	7.540E-15	-1.000E+00	0.000E+00	0.000E+00
Pm-148m							
GONADS	9.470E-14	1.585E-11	6.748E-11	6.270E-16	-1.000E+00	1.190E-09	3.630E-11
BREAST	1.080E-13	1.519E-11	6.468E-11	6.010E-16	-1.000E+00	1.240E-09	4.680E-11
LUNGS	9.420E-14	1.446E-11	6.156E-11	5.720E-16	-1.000E+00	3.590E-08	4.530E-11
RED MARR	9.140E-14	1.466E-11	6.242E-11	5.800E-16	-1.000E+00	1.360E-09	4.300E-11
BONE SUR	1.580E-13	2.161E-11	9.202E-11	8.550E-16	-1.000E+00	1.360E-09	4.070E-11
THYROID	9.680E-14	1.502E-11	6.393E-11	5.940E-16	-1.000E+00	1.050E-09	9.100E-08
REMAINDER	9.010E-14	1.418E-11	6.038E-11	5.610E-16	-1.000E+00	3.580E-09	1.550E-10
EFFECTIVE	9.680E-14	1.509E-11	6.425E-11	5.970E-16	-1.000E+00	6.100E-09	2.800E-09
SKIN (FGR)	1.180E-13	1.150E-10	4.897E-10	4.550E-15	-1.000E+00	0.000E+00	0.000E+00
Pr-144							
GONADS	1.900E-15	1.200E-11	1.202E-11	2.640E-15	-1.000E+00	2.410E-15	1.100E-11
BREAST	2.150E-15	1.145E-11	1.147E-11	2.520E-15	-1.000E+00	1.050E-14	1.170E-11
LUNGS	1.900E-15	1.100E-11	1.102E-11	2.420E-15	-1.000E+00	9.400E-11	1.260E-11
RED MARR	1.870E-15	1.127E-11	1.129E-11	2.480E-15	-1.000E+00	1.380E-14	1.090E-11
BONE SUR	2.990E-15	1.568E-11	1.571E-11	3.450E-15	-1.000E+00	1.470E-14	9.320E-12
THYROID	1.950E-15	1.127E-11	1.129E-11	2.480E-15	-1.000E+00	8.470E-15	6.210E-10
REMAINDER	1.840E-15	1.091E-11	1.093E-11	2.400E-15	-1.000E+00	1.400E-12	1.340E-10
EFFECTIVE	1.950E-15	1.150E-11	1.152E-11	2.530E-15	-1.000E+00	1.170E-11	6.660E-11
SKIN (FGR)	8.430E-14	4.477E-11	4.485E-11	9.850E-15	-1.000E+00	0.000E+00	0.000E+00
Pr-144m							
GONADS	3.250E-16	3.113E-11	5.489E-11	1.599E-15	-1.000E+00	0.000E+00	3.610E-11
BREAST	4.200E-16	2.971E-11	5.240E-11	1.526E-15	-1.000E+00	0.000E+00	3.850E-11
LUNGS	2.000E-16	2.886E-11	5.089E-11	1.482E-15	-1.000E+00	0.000E+00	3.750E-11
RED MARR	1.560E-16	2.965E-11	5.228E-11	1.523E-15	-1.000E+00	0.000E+00	3.650E-11
BONE SUR	8.160E-16	3.983E-11	7.024E-11	2.046E-15	-1.000E+00	0.000E+00	3.360E-11
THYROID	2.810E-16	2.852E-11	5.030E-11	1.465E-15	-1.000E+00	0.000E+00	1.790E-08
REMAINDER	1.980E-16	2.883E-11	5.084E-11	1.481E-15	-1.000E+00	0.000E+00	1.540E-10
EFFECTIVE	2.790E-16	2.989E-11	5.271E-11	1.535E-15	-1.000E+00	0.000E+00	6.080E-10
SKIN (FGR)	5.080E-16	9.826E-11	1.733E-10	5.047E-15	-1.000E+00	0.000E+00	0.000E+00
Sm-153							

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

GONADS	2.330E-15	1.465E-12	2.052E-11	5.200E-17	-1.000E+00	2.360E-11	0.000E+00
BREAST	2.820E-15	1.505E-12	2.107E-11	5.340E-17	-1.000E+00	5.670E-12	0.000E+00
LUNGS	1.970E-15	1.045E-12	1.464E-11	3.710E-17	-1.000E+00	2.050E-09	0.000E+00
RED MARR	1.620E-15	8.791E-13	1.231E-11	3.120E-17	-1.000E+00	6.660E-11	0.000E+00
BONE SUR	7.290E-15	4.254E-12	5.958E-11	1.510E-16	-1.000E+00	1.570E-10	0.000E+00
THYROID	2.220E-15	1.181E-12	1.653E-11	4.190E-17	-1.000E+00	1.510E-12	0.000E+00
REMAINDER	1.850E-15	1.042E-12	1.460E-11	3.700E-17	-1.000E+00	8.840E-10	0.000E+00
EFFECTIVE	2.280E-15	1.299E-12	1.819E-11	4.610E-17	-1.000E+00	5.310E-10	0.000E+00
SKIN (FGR)	1.450E-14	1.953E-12	2.734E-11	6.930E-17	-1.000E+00	0.000E+00	0.000E+00
Y-94							
GONADS	5.490E-14	5.455E-12	1.194E-11	2.530E-16	-1.000E+00	1.230E-13	0.000E+00
BREAST	6.210E-14	5.325E-12	1.166E-11	2.470E-16	-1.000E+00	4.400E-13	0.000E+00
LUNGS	5.500E-14	4.959E-12	1.086E-11	2.300E-16	-1.000E+00	1.480E-10	0.000E+00
RED MARR	5.420E-14	4.959E-12	1.086E-11	2.300E-16	-1.000E+00	4.180E-13	0.000E+00
BONE SUR	8.220E-14	9.120E-12	1.997E-11	4.230E-16	-1.000E+00	3.280E-13	0.000E+00
THYROID	5.650E-14	5.023E-12	1.100E-11	2.330E-16	-1.000E+00	4.120E-13	0.000E+00
REMAINDER	5.300E-14	4.829E-12	1.058E-11	2.240E-16	-1.000E+00	3.080E-12	0.000E+00
EFFECTIVE	5.620E-14	5.217E-12	1.142E-11	2.420E-16	-1.000E+00	1.890E-11	0.000E+00
SKIN (FGR)	1.800E-13	4.506E-11	9.867E-11	2.090E-15	-1.000E+00	0.000E+00	0.000E+00
Y-95							
GONADS	4.650E-14	4.607E-11	9.646E-10	1.600E-15	-1.000E+00	1.070E-13	2.060E-08
BREAST	5.190E-14	4.406E-11	9.224E-10	1.530E-15	-1.000E+00	3.170E-13	1.720E-08
LUNGS	4.720E-14	4.204E-11	8.802E-10	1.460E-15	-1.000E+00	8.040E-11	1.760E-08
RED MARR	4.730E-14	4.262E-11	8.922E-10	1.480E-15	-1.000E+00	3.200E-13	1.870E-08
BONE SUR	6.410E-14	6.105E-11	1.278E-09	2.120E-15	-1.000E+00	3.790E-13	1.740E-08
THYROID	4.840E-14	4.377E-11	9.163E-10	1.520E-15	-1.000E+00	2.790E-13	1.760E-08
REMAINDER	4.590E-14	4.147E-11	8.681E-10	1.440E-15	-1.000E+00	1.250E-12	2.210E-08
EFFECTIVE	4.790E-14	4.377E-11	9.163E-10	1.520E-15	-1.000E+00	1.020E-11	1.980E-08
SKIN (FGR)	1.590E-13	6.249E-11	1.308E-09	2.170E-15	-1.000E+00	0.000E+00	0.000E+00
Y-91m							
GONADS	2.490E-14	6.223E-11	1.102E-09	2.180E-15	-1.000E+00	3.210E-13	3.040E-09
BREAST	2.850E-14	5.966E-11	1.056E-09	2.090E-15	-1.000E+00	6.080E-13	2.650E-09
LUNGS	2.480E-14	5.710E-11	1.011E-09	2.000E-15	-1.000E+00	7.000E-11	2.620E-09
RED MARR	2.390E-14	5.824E-11	1.031E-09	2.040E-15	-1.000E+00	7.740E-13	2.950E-09
BONE SUR	4.280E-14	8.422E-11	1.491E-09	2.950E-15	-1.000E+00	6.210E-13	2.710E-09
THYROID	2.540E-14	5.852E-11	1.036E-09	2.050E-15	-1.000E+00	5.020E-13	2.740E-09
REMAINDER	2.370E-14	5.652E-11	1.001E-09	1.980E-15	-1.000E+00	3.740E-12	3.520E-09
EFFECTIVE	2.550E-14	5.966E-11	1.056E-09	2.090E-15	-1.000E+00	9.820E-12	3.040E-09
SKIN (FGR)	3.110E-14	7.251E-11	1.284E-09	2.540E-15	-1.000E+00	0.000E+00	0.000E+00
Br-82							
GONADS	1.270E-13	1.669E-11	3.530E-10	5.840E-16	-1.000E+00	1.690E-10	1.390E-08
BREAST	1.440E-13	1.596E-11	3.376E-10	5.585E-16	-1.000E+00	2.100E-10	1.240E-08
LUNGS	1.270E-13	1.517E-11	3.209E-10	5.309E-16	-1.000E+00	1.680E-09	1.270E-08
RED MARR	1.240E-13	1.542E-11	3.260E-10	5.394E-16	-1.000E+00	2.180E-10	1.320E-08
BONE SUR	1.990E-13	2.238E-11	4.734E-10	7.832E-16	-1.000E+00	1.920E-10	1.260E-08
THYROID	1.300E-13	1.588E-11	3.358E-10	5.556E-16	-1.000E+00	2.060E-10	1.260E-08
REMAINDER	1.220E-13	1.490E-11	3.152E-10	5.215E-16	-1.000E+00	3.310E-10	1.450E-08
EFFECTIVE	1.300E-13	1.585E-11	3.353E-10	5.546E-16	-1.000E+00	4.130E-10	1.350E-08
SKIN (FGR)	1.540E-13	5.253E-11	1.110E-09	1.836E-15	-1.000E+00	0.000E+00	0.000E+00
Br-83							
GONADS	3.740E-16	3.368E-13	3.429E-13	4.790E-17	-1.000E+00	1.130E-12	1.560E-12
BREAST	4.290E-16	3.297E-13	3.357E-13	4.690E-17	-1.000E+00	1.140E-12	5.170E-13
LUNGS	3.690E-16	3.002E-13	3.057E-13	4.270E-17	-1.000E+00	1.820E-10	3.890E-13
RED MARR	3.540E-16	2.932E-13	2.985E-13	4.170E-17	-1.000E+00	1.140E-12	8.590E-13
BONE SUR	6.750E-16	6.841E-13	6.965E-13	9.730E-17	-1.000E+00	1.140E-12	4.380E-13
THYROID	3.800E-16	3.044E-13	3.100E-13	4.330E-17	-1.000E+00	1.140E-12	2.660E-13
REMAINDER	3.520E-16	2.932E-13	2.985E-13	4.170E-17	-1.000E+00	5.310E-12	3.570E-10
EFFECTIVE	3.820E-16	3.227E-13	3.286E-13	4.590E-17	-1.000E+00	2.410E-11	1.080E-10
SKIN (FGR)	1.850E-14	7.241E-11	7.373E-11	1.030E-14	-1.000E+00	0.000E+00	0.000E+00
Br-84							
GONADS	9.160E-14	5.451E-12	9.607E-11	1.910E-16	-1.000E+00	2.840E-12	9.960E-10
BREAST	1.020E-13	5.280E-12	9.305E-11	1.850E-16	-1.000E+00	3.310E-12	1.590E-10
LUNGS	9.270E-14	4.852E-12	8.550E-11	1.700E-16	-1.000E+00	1.560E-10	6.630E-11
RED MARR	9.260E-14	4.880E-12	8.601E-11	1.710E-16	-1.000E+00	3.270E-12	4.390E-10
BONE SUR	1.280E-13	8.020E-12	1.413E-10	2.810E-16	-1.000E+00	2.990E-12	5.530E-10
THYROID	9.500E-14	5.109E-12	9.003E-11	1.790E-16	-1.000E+00	3.120E-12	5.250E-11
REMAINDER	8.990E-14	4.766E-12	8.399E-11	1.670E-16	-1.000E+00	1.870E-11	7.370E-09
EFFECTIVE	9.410E-14	5.137E-12	9.053E-11	1.800E-16	-1.000E+00	2.610E-11	2.560E-09
SKIN (FGR)	1.880E-13	5.565E-11	9.808E-10	1.950E-15	-1.000E+00	0.000E+00	0.000E+00
Am-242							
GONADS	6.090E-16	6.027E-11	4.425E-10	2.240E-15	-1.000E+00	1.940E-09	1.340E-09
BREAST	7.300E-16	5.758E-11	4.228E-10	2.140E-15	-1.000E+00	2.940E-12	1.800E-10
LUNGS	5.510E-16	5.596E-11	4.109E-10	2.080E-15	-1.000E+00	5.200E-08	4.010E-11

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

RED MARR	4.770E-16	5.731E-11	4.208E-10	2.130E-15	-1.000E+00	1.320E-08	2.810E-10
BONE SUR	1.880E-15	7.776E-11	5.709E-10	2.890E-15	-1.000E+00	1.650E-07	9.770E-11
THYROID	5.940E-16	5.462E-11	4.010E-10	2.030E-15	-1.000E+00	2.520E-12	6.400E-12
REMAINDER	5.180E-16	5.569E-11	4.089E-10	2.070E-15	-1.000E+00	8.540E-09	6.260E-09
EFFECTIVE	6.150E-16	5.812E-11	4.267E-10	2.160E-15	-1.000E+00	1.580E-08	2.280E-09
SKIN (FGR)	8.200E-15	2.217E-10	1.628E-09	8.240E-15	-1.000E+00	0.000E+00	0.000E+00
Np-238							
GONADS	2.660E-14	7.315E-13	9.675E-13	4.740E-17	-1.000E+00	1.990E-09	3.770E-12
BREAST	3.020E-14	7.007E-13	9.267E-13	4.540E-17	-1.000E+00	4.180E-11	7.070E-13
LUNGS	2.650E-14	6.713E-13	8.879E-13	4.350E-17	-1.000E+00	3.470E-09	2.720E-13
RED MARR	2.610E-14	6.852E-13	9.063E-13	4.440E-17	-1.000E+00	1.690E-08	1.070E-12
BONE SUR	3.990E-14	9.923E-13	1.312E-12	6.430E-17	-1.000E+00	2.100E-07	6.060E-13
THYROID	2.730E-14	6.590E-13	8.716E-13	4.270E-17	-1.000E+00	2.450E-11	5.290E-14
REMAINDER	2.550E-14	6.682E-13	8.838E-13	4.330E-17	-1.000E+00	2.550E-09	1.240E-09
EFFECTIVE	2.720E-14	7.007E-13	9.267E-13	4.540E-17	-1.000E+00	1.000E-08	3.740E-10
SKIN (FGR)	4.310E-14	1.667E-10	2.204E-10	1.080E-14	-1.000E+00	0.000E+00	0.000E+00
Pu-243							
GONADS	1.020E-15	1.978E-11	2.034E-11	2.540E-15	-1.000E+00	1.670E-12	6.990E-11
BREAST	1.210E-15	1.885E-11	1.938E-11	2.420E-15	-1.000E+00	2.750E-13	1.540E-11
LUNGS	9.280E-16	1.846E-11	1.898E-11	2.370E-15	-1.000E+00	2.270E-10	8.400E-12
RED MARR	7.840E-16	1.900E-11	1.954E-11	2.440E-15	-1.000E+00	5.770E-12	1.930E-11
BONE SUR	3.230E-15	2.484E-11	2.554E-11	3.190E-15	-1.000E+00	6.530E-11	7.400E-12
THYROID	9.910E-16	1.768E-11	1.818E-11	2.270E-15	-1.000E+00	1.130E-13	1.160E-12
REMAINDER	8.660E-16	1.853E-11	1.906E-11	2.380E-15	-1.000E+00	4.690E-11	5.200E-10
EFFECTIVE	1.030E-15	1.916E-11	1.970E-11	2.460E-15	-1.000E+00	4.440E-11	1.790E-10
SKIN (FGR)	8.150E-15	9.111E-11	9.368E-11	1.170E-14	-1.000E+00	0.000E+00	0.000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**Attachment 4 Secondary Side Release DNB Noble Gas Dose**

```
#####
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:12:44
#####
```

```
#####
File information
#####
```

```
Plant file name           = AST/CRE/pal_CRE_DNB_sec_ng_db_ast.psf
Inventory file name       = AST/CRE/palisades_loca_db_ast.nif
Scenario file name       = AST/CRE/pal_CRE_DNB_sec_ng_db_ast.psf
Release file name        = AST/CRE/pal_cre_dnb_sec_ng.rft
Dose conversion file name = AST/CRE/nai-1101-001rev0.dcf
```

```
#####  #####  #####  # # #  #####  # # #####
# # #  # # #  # # #  # # #  # # #  # # #
# # #  # # #  # # #  # # #  # # #  # # #
#####  #####  #####  # # #  # # #####  # # #
# # #  # # #  # # #  # # #  # # #  # # #
# # #  # # #  # # #  # # #  # # #  # # #
# # #  # # #  # # #  # # #  # # #  # # #
```

```
*RADTRAD-NAI 1.1a(QA)
*18 May 2006 13:12:38
** Palisades CRE Design Basis AST
** DNB Secondary Release Noble Gas Activity Dose
**
*Nuclide inventory file
AST/CRE/palisades_loca_db_ast.nif
*Plant power
810.576
*Compartments
3
*Compartment 1:
PCS
3
432976.8
0
0
0
0
*Compartment 2:
Environment
2
2e+20
0
0
0
0
*Compartment 3:
Control Room
1
35923
0
1
0
0
*Pathways
5
*Pathway 1:
SG Tube Leakage
1
2
2
*Pathway 2:
```



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
Control Room Unfiltered Makeup
  2
  3
  2
*Pathway 3:
Control Room Filtered Makeup
  2
  3
  2
*Pathway 4:
Control Room Unfiltered Inleakage
  2
  3
  2
*Pathway 5:
Control Room Exhaust
  3
  2
  2
*Sources
  3
  1 1
  2 0
  3 0
*dose conversion factors filename
AST/CRE/nai-1101-001rev0.dcf
*release fraction and timing filename
AST/CRE/pal_cre_dnb_sec_ng.rft
0
  1
  1
*Iodine
0 0.97 0.03
*Overlying pool
*aerosol model
  0
*elemental model
  0
*organic model
  0
*pH tracking
  0
*Compartment detail
*Compartment 1:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 2:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Pathways:
*Pathway 1
*filter efficiency model
1
3
0 5.005 0 0 0
8 0 0 0 0
720 0 0 0 0
*Pathway 2
*filter efficiency model
1
4
0 384.2 0 0 0
0.025 660 0 0 0
0.3333 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
1
3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
1
3
0 0 0 0 0
0.3333 10 0 0 0
720 10 0 0 0
*Pathway 5
*filter efficiency model
1
4
0 384.2 0 0 0
0.025 660 0 0 0
0.3333 1423.6 0 0 0
720 1423.6 0 0 0
*x/q tables
4
EAB
2
0 0.000539
720 0.000539
LPZ
6
0 6.66e-05
2 3.03e-05
8 2.04e-05
24 8.67e-06
96 2.54e-06
720 2.54e-06
Control Room Unfiltered
7
0 0.0211
0.305556 0.0165
2 0.0134
8 0.0054
24 0.00403
96 0.00298
720 0.00298
Control Room Filtered
7
0 0.000796
0.305556 0.000736
2 0.000642
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
8 0.000243
24 0.000175
96 0.000128
720 0.000128
*dose locations
3
*location name, compartment number and x/q table
EAB
2
1
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
LPZ
2
2
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
Control Room
3
0
*br model
1
2
0 0.00035
720 0.00035
*of model
1
4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
1
*number of intake combinations
3
*intake combinations
2 1 3
3 1 4
4 1 3
*time step count
3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
1
1
1
0
1
```

#####

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:12:44

#####

#####

Plant Description

#####

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth
Plant Power Level = 8.1058E+02 MWth

Number of compartments = 3

Compartment information

Compartment number 1 (Source term fraction = 1.0000E+00)

Name: PCS

Compartment volume = 4.3298E+05 (Cubic feet)

Pathways into and out of compartment 1

Pathway to compartment number 2: SG Tube Leakage

Compartment number 2

Name: Environment

Pathways into and out of compartment 2

Pathway to compartment number 3: Control Room Unfiltered Makeup

Pathway to compartment number 3: Control Room Filtered Makeup

Pathway to compartment number 3: Control Room Unfiltered Inleakage

Pathway from compartment number 1: SG Tube Leakage

Pathway from compartment number 3: Control Room Exhaust

Compartment number 3

Name: Control Room

Compartment volume = 3.5923E+04 (Cubic feet)

Removal devices within compartment:

Filter(s)

Pathways into and out of compartment 3

Pathway to compartment number 2: Control Room Exhaust

Pathway from compartment number 2: Control Room Unfiltered Makeup

Pathway from compartment number 2: Control Room Filtered Makeup

Pathway from compartment number 2: Control Room Unfiltered Inleakage

Total number of pathways = 5

#####

RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:12:44

#####

#####

Scenario Description

#####

Radioactive Decay is enabled

Calculation of Daughters is enabled

Iodine fractions

Aerosol = 0.0000E+00

Elemental = 9.7000E-01

Organic = 3.0000E-02

COMPARTMENT DATA

Compartment number 1: PCS

Compartment number 2: Environment

Compartment number 3: Control Room

Compartment Filter Data

Table with 5 columns: Time (hr), Flow Rate (cfm), Filter Efficiencies (%), Aerosol, Elemental, Organic

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

PATHWAY DATA

Pathway number 1: SG Tube Leakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	5.0050E+00	0.0000E+00	0.0000E+00	0.0000E+00
8.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00

X/Q DATA

X/Q table 1: EAB

Time (hr)	X/Q (s * m^-3)
0.0000E+00	5.3900E-04
7.2000E+02	5.3900E-04

X/Q table 2: LPZ

Time (hr)	X/Q (s * m^-3)
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

X/Q table 3: Control Room Unfiltered

Time (hr)	X/Q (s * m^-3)
0.0000E+00	2.1100E-02
3.0556E-01	1.6500E-02
2.0000E+00	1.3400E-02
8.0000E+00	5.4000E-03
2.4000E+01	4.0300E-03
9.6000E+01	2.9800E-03
7.2000E+02	2.9800E-03

X/Q table 4: Control Room Filtered

Time (hr)	X/Q (s * m^-3)
0.0000E+00	7.9600E-04
3.0556E-01	7.3600E-04
2.0000E+00	6.4200E-04
8.0000E+00	2.4300E-04
2.4000E+01	1.7500E-04
9.6000E+01	1.2800E-04
7.2000E+02	1.2800E-04

LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

Location Breathing Rate Data

Time (hr)	Breathing Rate (m^3 * sec^-1)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

Location Breathing Rate Data

Time (hr)	Breathing Rate (m^3 * sec^-1)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location Control Room is in compartment 3

Inleakage X/Q Table Assignments

Inleakage Path	Source Path	X/Q Table
2	1	3
3	1	4
4	1	3

Location Breathing Rate Data

Time (hr)	Breathing Rate (m^3 * sec^-1)
0.0000E+00	3.5000E-04
7.2000E+02	3.5000E-04

Location Occupancy Factor Data

Time (hr)	Occupancy Factor
0.0000E+00	1.0000E+00
2.4000E+01	6.0000E-01
9.6000E+01	4.0000E-01
7.2000E+02	4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time	Time step
0.0000E+00	1.0000E-06
1.0000E-03	2.0000E-02
7.2000E+02	2.0000E-02

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

#####

```

#####
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
#####

```

```

#####
Dose, Detailed Model and Detailed Inventory Output
#####

```

Detailed model information at time (H) = 0.0001

EAB Doses:

Time (h) =	0.0001	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		3.1976E-05	1.7533E-11	5.9552E-05	3.1976E-05
Accumulated dose (rem)		3.1976E-05	1.7533E-11	5.9552E-05	3.1976E-05

LPZ Doses:

Time (h) =	0.0001	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		3.9511E-06	2.1664E-12	7.3584E-06	3.9511E-06
Accumulated dose (rem)		3.9511E-06	2.1664E-12	7.3584E-06	3.9511E-06

Control Room Doses:

Time (h) =	0.0001	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		7.9400E-10	2.2106E-14	5.0061E-08	7.9421E-10
Accumulated dose (rem)		7.9400E-10	2.2106E-14	5.0061E-08	7.9421E-10

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0001	Ci	kg	Atoms	Bq
Kr-85		3.1547E+04	8.0409E-02	5.6969E+23	1.1673E+15
Kr-85m		5.8416E+05	7.0983E-05	5.0291E+20	2.1614E+16
Kr-87		1.1263E+06	3.9762E-05	2.7523E+20	4.1673E+16
Kr-88		1.5851E+06	1.2641E-04	8.6509E+20	5.8650E+16
Xe-133		4.3962E+06	2.3486E-02	1.0634E+23	1.6266E+17
Xe-135		1.4070E+06	5.5098E-04	2.4578E+21	5.2061E+16
Kr-83m		2.7346E+05	1.3254E-05	9.6165E+19	1.0118E+16
Xe-138		3.6305E+06	3.7756E-05	1.6476E+20	1.3433E+17
Xe-131m		2.5028E+04	2.9880E-04	1.3736E+21	9.2604E+14
Xe-133m		1.3971E+05	3.1137E-04	1.4099E+21	5.1694E+15
Xe-135m		8.9918E+05	9.8711E-06	4.4033E+19	3.3270E+16
Cs-138		2.3681E+02	5.5964E-09	2.4422E+16	8.7620E+12
Rb-88		1.8702E+02	1.5580E-09	1.0662E+16	6.9196E+12

PCS Transport Group Inventory:

Time (h) =	0.0001	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		6.8322E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		7.1544E-09	0.0000E+00	0.0000E+00

Time (h) =	0.0001	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 0.0001	Ci	kg	Atoms	Bq
Kr-85	1.0897E-03	2.7775E-09	1.9678E+16	4.0320E+07
Kr-85m	2.0178E-02	2.4519E-12	1.7372E+13	7.4659E+08
Kr-87	3.8905E-02	1.3735E-12	9.5072E+12	1.4395E+09
Kr-88	5.4754E-02	4.3666E-12	2.9882E+13	2.0259E+09
Xe-133	1.5186E-01	8.1128E-10	3.6734E+15	5.6187E+09
Xe-135	4.8603E-02	1.9032E-11	8.4899E+13	1.7983E+09
Kr-83m	9.4457E-03	4.5782E-13	3.3217E+12	3.4949E+08
Xe-138	1.2541E-01	1.3042E-12	5.6913E+12	4.6400E+09
Xe-131m	8.6453E-04	1.0321E-11	4.7448E+13	3.1987E+07
Xe-133m	4.8261E-03	1.0756E-11	4.8700E+13	1.7856E+08
Xe-135m	3.1059E-02	3.4096E-13	1.5210E+12	1.1492E+09
Cs-138	1.0879E-05	2.5710E-16	1.1219E+09	4.0252E+05
Rb-88	8.5914E-06	7.1572E-17	4.8979E+08	3.1788E+05

Environment Transport Group Inventory:

Time (h) = 0.0001	Present	Release	Integral
	Release	Rate/s	Release
Noble gases (atoms)	4.6969E+14	1.3047E+17	2.3600E+16
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	4.9426E-18	1.3730E-15	3.2867E-16

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Pathway



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 0.0001 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.0001				
Kr-85	4.1855E-06	1.0668E-11	7.5583E+13	1.5486E+05
Kr-85m	7.7502E-05	9.4176E-15	6.6722E+10	2.8676E+06
Kr-87	1.4943E-04	5.2754E-15	3.6516E+10	5.5289E+06
Kr-88	2.1030E-04	1.6772E-14	1.1477E+11	7.7813E+06
Xe-133	5.8327E-04	3.1160E-12	1.4109E+13	2.1581E+07
Xe-135	1.8668E-04	7.3100E-14	3.2609E+11	6.9071E+06
Kr-83m	3.6280E-05	1.7584E-15	1.2758E+10	1.3424E+06
Xe-138	4.8167E-04	5.0093E-15	2.1860E+10	1.7822E+07
Xe-131m	3.3206E-06	3.9643E-14	1.8224E+11	1.2286E+05
Xe-133m	1.8536E-05	4.1311E-14	1.8705E+11	6.8585E+05
Xe-135m	1.1929E-04	1.3096E-15	5.8419E+09	4.4139E+06
Cs-138	4.1787E-08	9.8753E-19	4.3095E+06	1.5461E+03
Rb-88	3.3000E-08	2.7491E-19	1.8813E+06	1.2210E+03

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.0001			
Noble gases (atoms)	9.0646E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.2624E-18	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Recirculating Filter
0.0001		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway Filter
0.0001	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	Pathway Filter
0.0001	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	Pathway Filter
0.0001	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) =	Pathway Filter
0.0001	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Aerosols (kg) 0.0000E+00

Detailed model information at time (H) = 0.0250

## EAB Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.6077E-02	1.2308E-06	3.0010E-02	1.6089E-02
Accumulated dose (rem)		1.6109E-02	1.2308E-06	3.0069E-02	1.6121E-02

## LPZ Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.9865E-03	1.5208E-07	3.7081E-03	1.9880E-03
Accumulated dose (rem)		1.9905E-03	1.5209E-07	3.7154E-03	1.9920E-03

## Control Room Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.4868E-04	6.3164E-07	9.4087E-03	1.5484E-04
Accumulated dose (rem)		1.4868E-04	6.3164E-07	9.4087E-03	1.5485E-04

## PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Kr-85		3.1862E+04	8.1212E-02	5.7538E+23	1.1789E+15
Kr-85m		5.8772E+05	7.1416E-05	5.0597E+20	2.1746E+16
Kr-87		1.1222E+06	3.9618E-05	2.7423E+20	4.1521E+16
Kr-88		1.5913E+06	1.2690E-04	8.6843E+20	5.8876E+16
Xe-133		4.4395E+06	2.3718E-02	1.0739E+23	1.6426E+17
Xe-135		1.4201E+06	5.5608E-04	2.4806E+21	5.2542E+16
Kr-83m		2.7359E+05	1.3261E-05	9.6213E+19	1.0123E+16
Xe-138		3.4083E+06	3.5446E-05	1.5468E+20	1.2611E+17
Xe-131m		2.5276E+04	3.0177E-04	1.3872E+21	9.3522E+14
Xe-133m		1.4106E+05	3.1438E-04	1.4235E+21	5.2193E+15
Xe-135m		8.4869E+05	9.3168E-06	4.1561E+19	3.1401E+16
Cs-138		1.1325E+05	2.6764E-06	1.1680E+19	4.1903E+15
Rb-88		9.2023E+04	7.6662E-07	5.2462E+18	3.4049E+15

## PCS Transport Group Inventory:

Time (h) =	0.0250	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		6.9000E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		3.4431E-06	0.0000E+00	0.0000E+00

## Deposition Recirculating

Time (h) =	0.0250	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

## SG Tube Leakage Transport Group Inventory:

Time (h) =	0.0250	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Environment Integral Nuclide Release:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Kr-85		5.4927E-01	1.4000E-06	9.9188E+18	2.0323E+10
Kr-85m		1.0132E+01	1.2311E-09	8.7223E+15	3.7487E+11
Kr-87		1.9345E+01	6.8296E-10	4.7274E+15	7.1577E+11
Kr-88		2.7431E+01	2.1876E-09	1.4971E+16	1.0150E+12
Xe-133		7.6532E+01	4.0886E-07	1.8513E+18	2.8317E+12
Xe-135		2.4480E+01	9.5860E-09	4.2762E+16	9.0576E+11

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Kr-83m	4.7164E+00	2.2859E-10	1.6586E+15	1.7451E+11
Xe-138	5.8755E+01	6.1104E-10	2.6665E+15	2.1739E+12
Xe-131m	4.3573E-01	5.2021E-09	2.3914E+16	1.6122E+10
Xe-133m	2.4317E+00	5.4194E-09	2.4539E+16	8.9974E+10
Xe-135m	1.4630E+01	1.6061E-10	7.1645E+14	5.4132E+11
Cs-138	1.9523E+00	4.6139E-11	2.0134E+14	7.2236E+10
Rb-88	1.5864E+00	1.3215E-11	9.0438E+13	5.8696E+10

## Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) =	Release	Rate/s	Release
0.0250			
Noble gases (atoms)	2.3838E+18	3.4851E+16	1.1895E+19
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.1895E-11	1.7390E-13	5.9354E-11

## SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.0250				
Kr-85	2.0926E-03	5.3338E-09	3.7789E+16	7.7428E+07
Kr-85m	3.8600E-02	4.6904E-12	3.3231E+13	1.4282E+09
Kr-87	7.3703E-02	2.6020E-12	1.8011E+13	2.7270E+09
Kr-88	1.0451E-01	8.3346E-12	5.7037E+13	3.8669E+09
Xe-133	2.9158E-01	1.5577E-09	7.0533E+15	1.0788E+10
Xe-135	9.3266E-02	3.6522E-11	1.6292E+14	3.4509E+09
Kr-83m	1.7969E-02	8.7092E-13	6.3191E+12	6.6485E+08
Xe-138	2.2385E-01	2.3280E-12	1.0159E+13	8.2825E+09

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-131m	1.6601E-03	1.9819E-11	9.1110E+13	6.1423E+07
Xe-133m	9.2647E-03	2.0647E-11	9.3490E+13	3.4279E+08
Xe-135m	5.5740E-02	6.1190E-13	2.7296E+12	2.0624E+09
Cs-138	7.4382E-03	1.7578E-13	7.6709E+11	2.7521E+08
Rb-88	6.0439E-03	5.0350E-14	3.4456E+11	2.2362E+08

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool	
Time (h) = 0.0250				
Noble gases (atoms)	4.5318E+16	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	2.2613E-13	0.0000E+00	0.0000E+00	0.0000E+00

	Surfaces	Filter
Time (h) = 0.0250		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3056

EAB Doses:

Time (h) = 0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.7553E-01	3.2683E-04	3.4721E-01	1.7880E-01
Accumulated dose (rem)	1.9164E-01	3.2806E-04	3.7728E-01	1.9492E-01

LPZ Doses:

Time (h) = 0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.1689E-02	4.0384E-05	4.2901E-02	2.2093E-02
Accumulated dose (rem)	2.3680E-02	4.0536E-05	4.6617E-02	2.4085E-02

Control Room Doses:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) =	0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		3.1012E-02	2.3702E-03	2.1049E+00	5.4810E-02
Accumulated dose (rem)		3.1161E-02	2.3708E-03	2.1143E+00	5.4965E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.3056	Ci	kg	Atoms	Bq
Kr-85		3.1856E+04	8.1197E-02	5.7527E+23	1.1787E+15
Kr-85m		5.6264E+05	6.8369E-05	4.8439E+20	2.0818E+16
Kr-87		9.6288E+05	3.3993E-05	2.3530E+20	3.5626E+16
Kr-88		1.4856E+06	1.1848E-04	8.1080E+20	5.4969E+16
Xe-133		4.4320E+06	2.3678E-02	1.0721E+23	1.6399E+17
Xe-135		1.4023E+06	5.4912E-04	2.4495E+21	5.1885E+16
Kr-83m		2.4596E+05	1.1921E-05	8.6497E+19	9.1006E+15
Xe-138		1.4957E+06	1.5555E-05	6.7880E+19	5.5341E+16
Xe-131m		2.5254E+04	3.0150E-04	1.3860E+21	9.3440E+14
Xe-133m		1.4051E+05	3.1315E-04	1.4179E+21	5.1990E+15
Xe-135m		3.9559E+05	4.3428E-06	1.9372E+19	1.4637E+16
Cs-138		7.7614E+05	1.8342E-05	8.0043E+19	2.8717E+16
Rb-88		8.0124E+05	6.6748E-06	4.5678E+19	2.9646E+16

PCS Transport Group Inventory:

Time (h) =	0.3056	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		6.8944E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		2.5017E-05	0.0000E+00	0.0000E+00

Time (h) =	0.3056	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	0.3056	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	0.3056	Ci	kg	Atoms	Bq
Kr-85		6.7142E+00	1.7113E-05	1.2125E+20	2.4842E+11
Kr-85m		1.1859E+02	1.4410E-08	1.0209E+17	4.3877E+12
Kr-87		2.0294E+02	7.1645E-09	4.9593E+16	7.5088E+12
Kr-88		3.1312E+02	2.4971E-08	1.7089E+17	1.1585E+13
Xe-133		9.3411E+02	4.9904E-06	2.2596E+19	3.4562E+13
Xe-135		2.9555E+02	1.1573E-07	5.1627E+17	1.0935E+13
Kr-83m		5.1840E+01	2.5126E-09	1.8230E+16	1.9181E+12
Xe-138		3.1524E+02	3.2784E-09	1.4307E+16	1.1664E+13
Xe-131m		5.3227E+00	6.3546E-08	2.9212E+17	1.9694E+11
Xe-133m		2.9615E+01	6.6001E-08	2.9885E+17	1.0958E+12
Xe-135m		8.3376E+01	9.1530E-10	4.0830E+15	3.0849E+12
Cs-138		1.6358E+02	3.8659E-09	1.6870E+16	6.0526E+12
Rb-88		1.6887E+02	1.4068E-09	9.6273E+15	6.2482E+12

Environment Transport Group Inventory:

Time (h) =	0.3056	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)		2.6441E+18	3.6723E+16	1.4531E+20
Elemental I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		9.5944E-11	1.3326E-12	5.2727E-09

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3056	Ci	kg	Atoms	Bq
Kr-85	3.6582E-02	9.3242E-08	6.6060E+17	1.3535E+09
Kr-85m	6.4611E-01	7.8511E-11	5.5624E+14	2.3906E+10
Kr-87	1.1057E+00	3.9036E-11	2.7021E+14	4.0911E+10
Kr-88	1.7060E+00	1.3606E-10	9.3107E+14	6.3123E+10
Xe-133	5.0895E+00	2.7190E-08	1.2311E+17	1.8831E+11
Xe-135	1.6103E+00	6.3057E-10	2.8129E+15	5.9581E+10
Kr-83m	2.8245E-01	1.3690E-11	9.9328E+13	1.0451E+10
Xe-138	1.7176E+00	1.7862E-11	7.7949E+13	6.3550E+10
Xe-131m	2.9000E-02	3.4623E-10	1.5916E+15	1.0730E+09
Xe-133m	1.6136E-01	3.5961E-10	1.6283E+15	5.9702E+09
Xe-135m	4.5427E-01	4.9870E-12	2.2246E+13	1.6808E+10
Cs-138	8.9128E-01	2.1063E-11	9.1917E+13	3.2977E+10
Rb-88	9.2009E-01	7.6650E-12	5.2454E+13	3.4043E+10

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.3056			
Noble gases (atoms)	7.9171E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	2.8728E-11	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.3056		

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3333

EAB Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.6573E-02	5.2293E-05	3.4381E-02	1.7105E-02
Accumulated dose (rem)	2.0822E-01	3.8036E-04	4.1166E-01	2.1203E-01

LPZ Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.0478E-03	6.4614E-06	4.2481E-03	2.1136E-03
Accumulated dose (rem)	2.5728E-02	4.6998E-05	5.0865E-02	2.6199E-02

Control Room Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.4858E-03	5.8609E-04	3.8527E-01	1.1457E-02
Accumulated dose (rem)	3.6647E-02	2.9569E-03	2.4995E+00	6.6423E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Kr-85	3.1856E+04	8.1195E-02	5.7526E+23	1.1787E+15
Kr-85m	5.6022E+05	6.8075E-05	4.8230E+20	2.0728E+16
Kr-87	9.4841E+05	3.3482E-05	2.3176E+20	3.5091E+16
Kr-88	1.4756E+06	1.1768E-04	8.0531E+20	5.4597E+16
Xe-133	4.4313E+06	2.3674E-02	1.0719E+23	1.6396E+17
Xe-135	1.4001E+06	5.4826E-04	2.4457E+21	5.1804E+16
Kr-83m	2.4339E+05	1.1797E-05	8.5591E+19	9.0053E+15
Xe-138	1.3787E+06	1.4338E-05	6.2570E+19	5.1012E+16
Xe-131m	2.5252E+04	3.0148E-04	1.3859E+21	9.3432E+14

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-133m	1.4046E+05	3.1303E-04	1.4174E+21	5.1970E+15
Xe-135m	3.6683E+05	4.0270E-06	1.7964E+19	1.3573E+16
Cs-138	7.9981E+05	1.8902E-05	8.2485E+19	2.9593E+16
Rb-88	8.4538E+05	7.0425E-06	4.8195E+19	3.1279E+16

PCS Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.3333			
Noble gases (atoms)	6.8939E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	2.5944E-05	0.0000E+00	0.0000E+00

	Surfaces	Recirculating Filter
Time (h) = 0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Kr-85	7.3251E+00	1.8671E-05	1.3228E+20	2.7103E+11
Kr-85m	1.2882E+02	1.5654E-08	1.1090E+17	4.7664E+12
Kr-87	2.1808E+02	7.6992E-09	5.3294E+16	8.0691E+12
Kr-88	3.3931E+02	2.7060E-08	1.8518E+17	1.2554E+13
Xe-133	1.0190E+03	5.4437E-06	2.4649E+19	3.7702E+13
Xe-135	3.2195E+02	1.2607E-07	5.6238E+17	1.1912E+13
Kr-83m	5.5966E+01	2.7126E-09	1.9681E+16	2.0708E+12
Xe-138	3.1703E+02	3.2971E-09	1.4388E+16	1.1730E+13
Xe-131m	5.8066E+00	6.9324E-08	3.1869E+17	2.1485E+11
Xe-133m	3.2298E+01	7.1981E-08	3.2592E+17	1.1950E+12
Xe-135m	8.4352E+01	9.2600E-10	4.1308E+15	3.1210E+12
Cs-138	1.8392E+02	4.3464E-09	1.8967E+16	6.8049E+12
Rb-88	1.9439E+02	1.6194E-09	1.1082E+16	7.1925E+12

Environment Transport Group Inventory:

	Present Release	Release Rate/s	Integral Release
Time (h) = 0.3333			
Noble gases (atoms)	6.3387E+18	1.2190E+17	1.5852E+20
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	2.3855E-10	4.5876E-12	5.9658E-09

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Kr-85	3.8583E-02	9.8342E-08	6.9674E+17	1.4276E+09
Kr-85m	6.7853E-01	8.2450E-11	5.8415E+14	2.5106E+10
Kr-87	1.1487E+00	4.0553E-11	2.8071E+14	4.2501E+10
Kr-88	1.7872E+00	1.4253E-10	9.7537E+14	6.6126E+10
Xe-133	5.3671E+00	2.8673E-08	1.2983E+17	1.9858E+11
Xe-135	1.6958E+00	6.6404E-10	2.9622E+15	6.2744E+10
Kr-83m	2.9478E-01	1.4288E-11	1.0367E+14	1.0907E+10
Xe-138	1.6699E+00	1.7366E-11	7.5784E+13	6.1785E+10
Xe-131m	3.0585E-02	3.6514E-10	1.6786E+15	1.1316E+09
Xe-133m	1.7012E-01	3.7914E-10	1.7167E+15	6.2945E+09
Xe-135m	4.4430E-01	4.8774E-12	2.1757E+13	1.6439E+10
Cs-138	9.6871E-01	2.2893E-11	9.9903E+13	3.5842E+10
Rb-88	1.0239E+00	8.5297E-12	5.8372E+13	3.7884E+10

Control Room Transport Group Inventory:

			Overlying
Time (h) = 0.3333	Atmosphere	Sump	Pool
Noble gases (atoms)	8.3497E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	3.1423E-11	0.0000E+00	0.0000E+00

	Deposition Recirculating	
	Surfaces	Filter
Time (h) = 0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Pathway

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 0.3333 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 0.3333 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 0.3333 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Detailed model information at time (H) = 2.0000

EAB Doses:

Time (h) = 2.0000 Whole Body Thyroid Skin TEDE  
 Delta dose (rem) 6.9580E-01 2.9080E-03 1.6036E+00 7.2955E-01  
 Accumulated dose (rem) 9.0402E-01 3.2884E-03 2.0152E+00 9.4158E-01

LPZ Doses:

Time (h) = 2.0000 Whole Body Thyroid Skin TEDE  
 Delta dose (rem) 8.5975E-02 3.5932E-04 1.9814E-01 9.0145E-02  
 Accumulated dose (rem) 1.1170E-01 4.0632E-04 2.4901E-01 1.1634E-01

Control Room Doses:

Time (h) = 2.0000 Whole Body Thyroid Skin TEDE  
 Delta dose (rem) 7.8066E-02 6.9119E-03 5.6017E+00 1.5654E-01  
 Accumulated dose (rem) 1.1471E-01 9.8688E-03 8.1013E+00 2.2296E-01

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0000	3.1820E+04	8.1104E-02	5.7461E+23	1.1773E+15
Kr-85	4.3238E+05	5.2540E-05	3.7224E+20	1.5998E+16
Kr-85m	3.8190E+05	1.3483E-05	9.3326E+19	1.4130E+16
Kr-87	9.8130E+05	7.8258E-05	5.3555E+20	3.6308E+16
Kr-88	4.3870E+06	2.3437E-02	1.0612E+23	1.6232E+17
Xe-133	1.2408E+06	4.8587E-04	2.1674E+21	4.5909E+16
Xe-135	1.2931E+05	6.2674E-06	4.5473E+19	4.7844E+15
Kr-83m	1.0340E+04	1.0753E-07	4.6925E+17	3.8257E+14
Xe-138	2.5121E+04	2.9991E-04	1.3787E+21	9.2948E+14
Xe-131m	1.3724E+05	3.0587E-04	1.3849E+21	5.0780E+15
Xe-133m	3.9366E+03	4.3215E-08	1.9278E+17	1.4565E+14
Xe-135m	2.1195E+05	5.0088E-06	2.1858E+19	7.8420E+15
Cs-138	1.1045E+06	9.2010E-06	6.2965E+19	4.0865E+16
Rb-88				

PCS Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
2.0000	6.8671E+23	0.0000E+00	0.0000E+00
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.4210E-05	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
2.0000	0.0000E+00	0.0000E+00
Noble gases (atoms)		

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	4.4162E+01	1.1256E-04	7.9749E+20	1.6340E+12
Kr-85m	6.0010E+02	7.2920E-08	5.1663E+17	2.2204E+13
Kr-87	5.3003E+02	1.8712E-08	1.2953E+17	1.9611E+13
Kr-88	1.3619E+03	1.0861E-07	7.4328E+17	5.0391E+13
Xe-133	6.0887E+03	3.2528E-05	1.4728E+20	2.2528E+14
Xe-135	1.7221E+03	6.7433E-07	3.0081E+18	6.3716E+13
Kr-83m	1.7947E+02	8.6984E-09	6.3112E+16	6.6402E+12
Xe-138	1.4350E+01	1.4924E-10	6.5127E+14	5.3096E+11
Xe-131m	3.4865E+01	4.1624E-07	1.9135E+18	1.2900E+12
Xe-133m	1.9048E+02	4.2451E-07	1.9221E+18	7.0477E+12
Xe-135m	5.4635E+00	5.9978E-11	2.6755E+14	2.0215E+11
Cs-138	2.9399E+02	6.9478E-09	3.0319E+16	1.0878E+13
Rb-88	1.5327E+03	1.2769E-08	8.7379E+16	5.6710E+13

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 2.0000	Release	Rate/s	Release
Noble gases (atoms)	9.5264E+18	1.3231E+17	9.5307E+20
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.9704E-10	2.7366E-12	1.9716E-08

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Cs-138	9.8931E-02	2.3380E-12	1.0203E+13	3.6605E+09
Rb-88	1.6199E-01	1.3494E-12	9.2347E+12	5.9935E+09

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	3.6875E-12

Control Room Unfiltered Inleakage Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	5.9146E-03	1.5075E-08	1.0681E+17	2.1884E+08
Kr-85m	8.0370E-02	9.7660E-12	6.9191E+13	2.9737E+09
Kr-87	7.0986E-02	2.5061E-12	1.7347E+13	2.6265E+09
Kr-88	1.8240E-01	1.4546E-11	9.9546E+13	6.7488E+09
Xe-133	8.1544E-01	4.3564E-09	1.9726E+16	3.0171E+10
Xe-135	2.3063E-01	9.0312E-11	4.0287E+14	8.5334E+09
Kr-83m	2.4035E-02	1.1650E-12	8.4524E+12	8.8931E+08
Xe-138	1.9219E-03	1.9988E-14	8.7223E+10	7.1111E+07
Xe-131m	4.6694E-03	5.5747E-11	2.5627E+14	1.7277E+08
Xe-133m	2.5511E-02	5.6854E-11	2.5743E+14	9.4389E+08
Xe-135m	7.3172E-04	8.0327E-15	3.5833E+10	2.7074E+07
Cs-138	3.6022E-03	8.5130E-14	3.7149E+11	1.3328E+08
Rb-88	7.9783E-02	6.6465E-13	4.5484E+12	2.9520E+09

Control Room Transport Group Inventory:

			Overlying
Time (h) = 2.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	1.2764E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	7.4978E-13	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Cs-138	9.8567E-02	2.3294E-12	1.0165E+13	3.6470E+09
Rb-88	1.2225E-01	1.0184E-12	6.9695E+12	4.5233E+09

	Deposition Surfaces	Recirculating Filter
Time (h) = 2.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	3.3478E-12

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Cs-138	9.8931E-02	2.3380E-12	1.0203E+13	3.6605E+09
Rb-88	1.6199E-01	1.3494E-12	9.2347E+12	5.9935E+09

Control Room Filtered Makeup Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	3.6875E-12

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Cs-138	1.9750E-01	4.6674E-12	2.0368E+13	7.3075E+09
Rb-88	2.8424E-01	2.3679E-12	1.6204E+13	1.0517E+10

Detailed model information at time (H) = 8.0000

EAB Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	8.4080E-01	2.6325E-03	2.1538E+00	8.8164E-01
Accumulated dose (rem)	1.7448E+00	5.9208E-03	4.1690E+00	1.8232E+00

LPZ Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.7266E-02	1.4799E-04	1.2108E-01	4.9562E-02
Accumulated dose (rem)	1.5897E-01	5.5430E-04	3.7008E-01	1.6591E-01

Control Room Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.9442E-02	1.2169E-03	2.1551E+00	4.9220E-02
Accumulated dose (rem)	1.4416E-01	1.1086E-02	1.0256E+01	2.7218E-01

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Kr-85	3.1689E+04	8.0770E-02	5.7224E+23	1.1725E+15
Kr-85m	1.7017E+05	2.0679E-05	1.4650E+20	6.2965E+15
Kr-87	1.4448E+04	5.1008E-07	3.5308E+18	5.3459E+14
Kr-88	2.2595E+05	1.8020E-05	1.2331E+20	8.3602E+15
Xe-133	4.2311E+06	2.2604E-02	1.0235E+23	1.5655E+17
Xe-135	7.8204E+05	3.0623E-04	1.3661E+21	2.8935E+16
Kr-83m	1.3269E+04	6.4312E-07	4.6662E+18	4.9095E+14
Xe-138	2.3163E-04	2.4089E-15	1.0512E+10	8.5704E+06
Xe-131m	2.4655E+04	2.9435E-04	1.3531E+21	9.1224E+14
Xe-133m	1.2627E+05	2.8140E-04	1.2742E+21	4.6719E+15
Xe-135m	3.2035E-04	3.5167E-15	1.5688E+10	1.1853E+07
Cs-138	9.4496E+01	2.2332E-09	9.7453E+15	3.4963E+12
Rb-88	2.5825E+05	2.1514E-06	1.4723E+19	9.5554E+15

PCS Transport Group Inventory:

			Overlying
Time (h) = 8.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	6.7887E+23	0.0000E+00	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	2.1537E-06	0.0000E+00	0.0000E+00

		Deposition	Recirculating
Time (h) =	8.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

		Pathway
Time (h) =	8.0000	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Environment Integral Nuclide Release:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Kr-85		1.7631E+02	4.4939E-04	3.1839E+21	6.5235E+12
Kr-85m		9.4682E+02	1.1505E-07	8.1512E+17	3.5032E+13
Kr-87		8.0388E+01	2.8380E-09	1.9645E+16	2.9744E+12
Kr-88		1.2571E+03	1.0026E-07	6.8609E+17	4.6515E+13
Xe-133		2.3541E+04	1.2577E-04	5.6945E+20	8.7101E+14
Xe-135		4.3511E+03	1.7038E-06	7.6005E+18	1.6099E+14
Kr-83m		7.3826E+01	3.5782E-09	2.5962E+16	2.7316E+12
Xe-138		1.2888E-06	1.3403E-17	5.8488E+07	4.7684E+04
Xe-131m		1.3718E+02	1.6377E-06	7.5286E+18	5.0755E+12
Xe-133m		7.0253E+02	1.5657E-06	7.0893E+18	2.5994E+13
Xe-135m		1.7824E-06	1.9566E-17	8.7283E+07	6.5947E+04
Cs-138		5.2550E-01	1.2419E-11	5.4195E+13	1.9444E+10
Rb-88		1.4368E+03	1.1970E-08	8.1914E+16	5.3163E+13

Environment Transport Group Inventory:

		Present	Release	Integral
Time (h) =	8.0000	Release	Rate/s	Release
Noble gases (atoms)	9.4169E+18	1.3079E+17	3.7771E+21	
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	
Aerosols (kg)	2.9865E-11	4.1480E-13	1.1982E-08	

SG Tube Leakage Transport Group Inventory:

		Pathway
Time (h) =	8.0000	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Makeup Transport Group Inventory:

		Pathway
Time (h) =	8.0000	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Cs-138		2.0908E-04	4.9411E-15	2.1562E+10	7.7360E+06
Rb-88		3.5556E-02	2.9620E-13	2.0270E+12	1.3156E+09

Control Room Filtered Makeup Transport Group Inventory:

Pathway

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 8.0000 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 3.0114E-13

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 8.0000 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 8.0000 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =		Ci	kg	Atoms	Bq
8.0000	Kr-85	4.5449E-03	1.1584E-08	8.2073E+16	1.6816E+08
	Kr-85m	2.4407E-02	2.9658E-12	2.1012E+13	9.0305E+08
	Kr-87	2.0722E-03	7.3157E-14	5.0639E+11	7.6672E+07
	Kr-88	3.2406E-02	2.5844E-12	1.7686E+13	1.1990E+09
	Xe-133	6.0683E-01	3.2419E-09	1.4679E+16	2.2453E+10
	Xe-135	1.1216E-01	4.3921E-11	1.9592E+14	4.1500E+09
	Kr-83m	1.9031E-03	9.2238E-14	6.6924E+11	7.0413E+07
	Xe-131m	3.5361E-03	4.2216E-11	1.9407E+14	1.3084E+08
	Xe-133m	1.8110E-02	4.0360E-11	1.8275E+14	6.7005E+08
	Cs-138	9.3871E-07	2.2184E-17	9.6809E+07	3.4732E+04
	Rb-88	1.3666E-02	1.1385E-13	7.7911E+11	5.0565E+08

Control Room Transport Group Inventory:

Time (h) =		Atmosphere	Sump	Overlying Pool
8.0000	Noble gases (atoms)	9.7365E+16	0.0000E+00	0.0000E+00
	Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
	Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
	Aerosols (kg)	1.1387E-13	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) =		Ci	kg	Atoms	Bq
8.0000	Cs-138	5.6206E-05	1.3283E-15	5.7965E+09	2.0796E+06
	Rb-88	1.4408E-02	1.2003E-13	8.2140E+11	5.3310E+08

Deposition Recirculating

Time (h) =		Surfaces	Filter
8.0000	Noble gases (atoms)	0.0000E+00	0.0000E+00
	Elemental I (atoms)	0.0000E+00	0.0000E+00
	Organic I (atoms)	0.0000E+00	0.0000E+00
	Aerosols (kg)	0.0000E+00	1.2136E-13

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 8.0000 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =		Ci	kg	Atoms	Bq
------------	--	----	----	-------	----

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-138	2.0908E-04	4.9411E-15	2.1562E+10	7.7360E+06
Rb-88	3.5556E-02	2.9620E-13	2.0270E+12	1.3156E+09

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	3.0114E-13

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Cs-138	2.6529E-04	6.2694E-15	2.7359E+10	9.8156E+06
Rb-88	4.9964E-02	4.1623E-13	2.8484E+12	1.8487E+09

Detailed model information at time (H) = 24.0000

EAB Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.1960E-05	7.1035E-09	2.7987E-05	1.2078E-05
Accumulated dose (rem)	1.7448E+00	5.9208E-03	4.1690E+00	1.8232E+00

LPZ Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.5267E-07	2.6885E-10	1.0593E-06	4.5711E-07
Accumulated dose (rem)	1.5897E-01	5.5430E-04	3.7008E-01	1.6591E-01

Control Room Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	9.7583E-04	3.8170E-05	7.7307E-02	1.6055E-03
Accumulated dose (rem)	1.4513E-01	1.1124E-02	1.0334E+01	2.7379E-01

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Kr-85	3.1687E+04	8.0764E-02	5.7221E+23	1.1724E+15
Kr-85m	1.4315E+04	1.7395E-06	1.2324E+19	5.2965E+14
Kr-87	2.3566E+00	8.3197E-11	5.7589E+14	8.7194E+10
Kr-88	4.5506E+03	3.6291E-07	2.4835E+18	1.6837E+14
Xe-133	3.8838E+06	2.0749E-02	9.3950E+22	1.4370E+17
Xe-135	2.3087E+05	9.0404E-05	4.0328E+20	8.5421E+15
Kr-83m	3.0966E+01	1.5009E-09	1.0890E+16	1.1457E+12
Xe-131m	2.3716E+04	2.8314E-04	1.3016E+21	8.7749E+14
Xe-133m	1.0223E+05	2.2783E-04	1.0316E+21	3.7824E+15
Cs-138	1.0014E-07	2.3666E-18	1.0327E+07	3.7052E+03
Rb-88	5.2012E+03	4.3329E-08	2.9652E+17	1.9244E+14

PCS Transport Group Inventory:



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Atmosphere	Sump	Overlying Pool
Time (h) = 24.0000			
Noble gases (atoms)	6.6891E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	4.3329E-08	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 24.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

	Present Release	Release Rate/s	Integral Release
Time (h) = 24.0000			
Noble gases (atoms)	1.4036E-01	1.9494E-03	3.7218E+21
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	4.4911E-33	6.2376E-35	2.4108E-10

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	5.2363E-24

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 24.0000			
Noble gases (atoms)	2.8818E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	9.0236E-32	0.0000E+00	0.0000E+00

	Surfaces	Filter
Time (h) = 24.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	1.4194E-24

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
	Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
	Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	5.2363E-24

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
	Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
	Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 96.0000

EAB Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	8.1276E-23	6.0467E-27	2.5006E-22	8.1375E-23
Accumulated dose (rem)	1.7448E+00	5.9208E-03	4.1690E+00	1.8232E+00

LPZ Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.3073E-24	9.7264E-29	4.0223E-24	1.3090E-24
Accumulated dose (rem)	1.5897E-01	5.5430E-04	3.7008E-01	1.6591E-01

Control Room Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
--------------------	------------	---------	------	------

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Delta dose (rem)	3.9785E-21	1.5257E-23	4.1439E-19	4.2302E-21
Accumulated dose (rem)	1.4513E-01	1.1124E-02	1.0334E+01	2.7379E-01

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Kr-85	3.1670E+04	8.0722E-02	5.7190E+23	1.1718E+15
Kr-85m	2.0788E-01	2.5260E-11	1.7896E+14	7.6914E+09
Kr-88	1.0625E-04	8.4733E-15	5.7986E+10	3.9312E+06
Xe-133	2.6336E+06	1.4070E-02	6.3706E+22	9.7443E+16
Xe-135	9.5272E+02	3.7307E-07	1.6642E+18	3.5251E+13
Xe-131m	1.9914E+04	2.3774E-04	1.0929E+21	7.3681E+14
Xe-133m	3.9521E+04	8.8077E-05	3.9881E+20	1.4623E+15
Rb-88	1.2144E-04	1.0117E-15	6.9231E+09	4.4932E+06

PCS Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	6.3710E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.0117E-15	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

Time (h) = 96.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	3.5448E+21
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	5.6288E-18

SG Tube Leakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

			Overlying
Time (h) = 96.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition	Recirculating
Time (h) = 96.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Detailed model information at time (H) = 720.0000

EAB Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.6010E-97	6.3002-109	5.3722E-97	1.6010E-97
Accumulated dose (rem)	1.7448E+00	5.9208E-03	4.1690E+00	1.8232E+00

LPZ Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.5446-100	2.9689-111	2.5316E-99	7.5446-100
Accumulated dose (rem)	1.5897E-01	5.5430E-04	3.7008E-01	1.6591E-01

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.2247E-96	1.0598-105	5.9350E-94	5.2247E-96
Accumulated dose (rem)	1.4513E-01	1.1124E-02	1.0334E+01	2.7379E-01

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Kr-85	3.1525E+04	8.0351E-02	5.6928E+23	1.1664E+15
Xe-133	8.5687E+04	4.5777E-04	2.0728E+21	3.1704E+15
Xe-131m	4.3796E+03	5.2287E-05	2.4037E+20	1.6205E+14
Xe-133m	1.0464E+01	2.3320E-08	1.0559E+17	3.8716E+11

PCS Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	5.7159E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

Time (h) = 720.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	3.1803E+21
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

			Overlying
Time (h) = 720.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition	Recirculating
Time (h) = 720.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms) 0.0000E+00
Organic I (atoms) 0.0000E+00
Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000 Pathway Filter
Noble gases (atoms) 0.0000E+00
Elemental I (atoms) 0.0000E+00
Organic I (atoms) 0.0000E+00
Aerosols (kg) 0.0000E+00

Transport Group Totals in Model:

Noble Gases (atoms) 5.7477E+23
Elemental I (atoms) 0.0000E+00
Organic I (atoms) 0.0000E+00
Aerosols (kg) 0.0000E+00

37004

I-131 Summary

Table with 4 columns: Time (hr), PCS I-131 (Curies), Environment I-131 (Curies), Control Room I-131 (Curies). Rows show data from 0.000 to 9.560 hours.

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

9.820	0.0000E+00	0.0000E+00	0.0000E+00
10.080	0.0000E+00	0.0000E+00	0.0000E+00
24.000	0.0000E+00	0.0000E+00	0.0000E+00
96.000	0.0000E+00	0.0000E+00	0.0000E+00
720.000	0.0000E+00	0.0000E+00	0.0000E+00

#####  
 Cumulative Dose Summary  
 #####

Time (hr)	EAB		LPZ		Control Room	
	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)
0.000	0.0000E+00	3.1978E-09	0.0000E+00	3.9513E-10	0.0000E+00	1.1910E-15
0.000	1.7533E-11	3.1976E-05	2.1664E-12	3.9511E-06	2.2106E-14	7.9421E-10
0.025	1.2308E-06	1.6121E-02	1.5209E-07	1.9920E-03	6.3164E-07	1.5485E-04
0.300	3.1779E-04	1.9149E-01	3.9267E-05	2.3661E-02	2.2595E-03	5.2768E-02
0.306	3.2806E-04	1.9492E-01	4.0536E-05	2.4085E-02	2.3708E-03	5.4965E-02
0.333	3.8036E-04	2.1203E-01	4.6998E-05	2.6199E-02	2.9569E-03	6.6423E-02
0.600	9.4578E-04	3.6879E-01	1.1686E-04	4.5568E-02	6.8053E-03	1.4344E-01
0.860	1.5083E-03	5.0484E-01	1.8637E-04	6.2380E-02	8.3380E-03	1.7792E-01
1.120	2.0198E-03	6.2509E-01	2.4957E-04	7.7237E-02	9.0336E-03	1.9606E-01
1.380	2.4651E-03	7.3149E-01	3.0459E-04	9.0384E-02	9.4045E-03	2.0712E-01
1.640	2.8471E-03	8.2620E-01	3.5180E-04	1.0209E-01	9.6399E-03	2.1487E-01
1.900	3.1748E-03	9.1115E-01	3.9228E-04	1.1258E-01	9.8123E-03	2.2092E-01
2.000	3.2884E-03	9.4158E-01	4.0632E-04	1.1634E-01	9.8688E-03	2.2296E-01
2.260	3.5563E-03	1.0156E+00	4.2138E-04	1.2051E-01	9.9957E-03	2.2765E-01
2.520	3.7909E-03	1.0833E+00	4.3456E-04	1.2431E-01	1.0101E-02	2.3162E-01
2.780	3.9984E-03	1.1455E+00	4.4623E-04	1.2781E-01	1.0192E-02	2.3513E-01
3.040	4.1840E-03	1.2029E+00	4.5666E-04	1.3104E-01	1.0273E-02	2.3831E-01
3.300	4.3514E-03	1.2563E+00	4.6608E-04	1.3404E-01	1.0348E-02	2.4124E-01
3.560	4.5037E-03	1.3060E+00	4.7464E-04	1.3683E-01	1.0416E-02	2.4397E-01
3.820	4.6431E-03	1.3525E+00	4.8248E-04	1.3944E-01	1.0479E-02	2.4652E-01
4.080	4.7715E-03	1.3960E+00	4.8969E-04	1.4189E-01	1.0538E-02	2.4890E-01
4.340	4.8901E-03	1.4369E+00	4.9636E-04	1.4419E-01	1.0593E-02	2.5115E-01
4.600	5.0001E-03	1.4754E+00	5.0254E-04	1.4635E-01	1.0645E-02	2.5326E-01
4.860	5.1024E-03	1.5117E+00	5.0830E-04	1.4839E-01	1.0693E-02	2.5526E-01
5.120	5.1978E-03	1.5459E+00	5.1366E-04	1.5031E-01	1.0739E-02	2.5713E-01
5.380	5.2868E-03	1.5782E+00	5.1866E-04	1.5213E-01	1.0781E-02	2.5891E-01
5.640	5.3700E-03	1.6087E+00	5.2334E-04	1.5385E-01	1.0821E-02	2.6058E-01
5.900	5.4478E-03	1.6377E+00	5.2771E-04	1.5547E-01	1.0858E-02	2.6216E-01
6.160	5.5206E-03	1.6651E+00	5.3181E-04	1.5701E-01	1.0893E-02	2.6365E-01
6.420	5.5889E-03	1.6910E+00	5.3564E-04	1.5847E-01	1.0926E-02	2.6507E-01
6.680	5.6528E-03	1.7157E+00	5.3923E-04	1.5986E-01	1.0957E-02	2.6640E-01
6.940	5.7127E-03	1.7391E+00	5.4260E-04	1.6118E-01	1.0985E-02	2.6767E-01
7.200	5.7689E-03	1.7613E+00	5.4576E-04	1.6243E-01	1.1012E-02	2.6887E-01
7.460	5.8216E-03	1.7825E+00	5.4872E-04	1.6362E-01	1.1038E-02	2.7001E-01
7.720	5.8710E-03	1.8026E+00	5.5150E-04	1.6475E-01	1.1062E-02	2.7108E-01
7.980	5.9174E-03	1.8218E+00	5.5411E-04	1.6582E-01	1.1084E-02	2.7211E-01
8.000	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1086E-02	2.7218E-01
8.260	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1103E-02	2.7294E-01
8.520	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1113E-02	2.7335E-01
8.780	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1118E-02	2.7356E-01
9.040	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1121E-02	2.7367E-01
9.300	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1122E-02	2.7373E-01
9.560	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1123E-02	2.7376E-01
9.820	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1124E-02	2.7377E-01
10.080	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1124E-02	2.7378E-01
24.000	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1124E-02	2.7379E-01
96.000	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1124E-02	2.7379E-01
720.000	5.9208E-03	1.8232E+00	5.5430E-04	1.6591E-01	1.1124E-02	2.7379E-01

#####  
 Worst Two-Hour Dose  
 (Provided for Dose Location 1)  
 #####

EAB

Time (hr)	Whole Body (rem)	Thyroid (rem)	Skin (rem)	TEDE (rem)
0.0	9.0402E-01	3.2884E-03	2.0152E+00	9.4158E-01

#####



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

30 Day Control Room Skin Dose

#####

Control Room

Time (hr)	Skin (rem)
720.0	1.0334E+01

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

**Attachment 5 Secondary Side Release FCM Noble Gas Dose**

```
#####
      RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:33:49
#####
#####
                          File information
#####
```

```
Plant file name           = AST/CRE/pal_CRE_FCM_sec_ng_db_ast.psf
Inventory file name       = AST/CRE/palisades_loca_db_ast.nif
Scenario file name       = AST/CRE/pal_CRE_FCM_sec_ng_db_ast.psf
Release file name        = AST/CRE/pal_cre_fcm_sec_ng.rft
Dose conversion file name = AST/CRE/nai-1101-001rev0.dcf
```

```
#####  #####  #####  #  #  #  #####  #  #  #####
#  #  #  #  #  #  #  #  #  #  #  #  #  #  #  #  #
#  #  #  #  #  #  #  #  #  #  #  #  #  #  #  #
#####  #####  #####  #  #  #  #  #####  #  #  #
#  #  #  #  #  #  #  #  #  #  #  #  #  #  #  #
#  #  #  #  #  #  #  #  #  #  #  #  #  #  #  #
#  #  #  #  #  #  #  #  #  #  #  #  #  #  #  #
```

```
*RADTRAD-NAI 1.1a(QA)
*18 May 2006 13:33:35
** Palisades CRE Design Basis AST
** FCM Secondary Release Noble Gas Activity Dose
**
*Nuclide inventory file
AST/CRE/palisades_loca_db_ast.nif
*Plant power
27.5706
*Compartments
3
*Compartment 1:
PCS
  3
432976.8
  0
  0
  0
  0
*Compartment 2:
Environment
  2
2e+20
  0
  0
  0
  0
*Compartment 3:
Control Room
  1
35923
  0
  1
  0
  0
*Pathways
  5
*Pathway 1:
SG Tube Leakage
  1
  2
  2
*Pathway 2:
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
Control Room Unfiltered Makeup
  2
  3
  2
*Pathway 3:
Control Room Filtered Makeup
  2
  3
  2
*Pathway 4:
Control Room Unfiltered Inleakage
  2
  3
  2
*Pathway 5:
Control Room Exhaust
  3
  2
  2
*Sources
  3
  1 1
  2 0
  3 0
*dose conversion factors filename
AST/CRE/nai-1101-001rev0.dcf
*release fraction and timing filename
AST/CRE/pal_cre_fcm_sec_ng.rft
0
  1
  1
*Iodine
0 0.97 0.03
*Overlying pool
*aerosol model
  0
*elemental model
  0
*organic model
  0
*pH tracking
  0
*Compartment detail
*Compartment 1:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 2:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Pathways:
*Pathway 1
*filter efficiency model
1
3
0 5.005 0 0 0
8 0 0 0 0
720 0 0 0 0
*Pathway 2
*filter efficiency model
1
4
0 384.2 0 0 0
0.025 660 0 0 0
0.3333 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
1
3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
1
3
0 0 0 0 0
0.3333 10 0 0 0
720 10 0 0 0
*Pathway 5
*filter efficiency model
1
4
0 384.2 0 0 0
0.025 660 0 0 0
0.3333 1423.6 0 0 0
720 1423.6 0 0 0
*x/q tables
4
EAB
2
0 0.000539
720 0.000539
LPZ
6
0 6.66e-05
2 3.03e-05
8 2.04e-05
24 8.67e-06
96 2.54e-06
720 2.54e-06
Control Room Unfiltered
7
0 0.0211
0.305556 0.0165
2 0.0134
8 0.0054
24 0.00403
96 0.00298
720 0.00298
Control Room Filtered
7
0 0.000796
0.305556 0.000736
2 0.000642
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
8 0.000243
24 0.000175
96 0.000128
720 0.000128
*dose locations
3
*location name, compartment number and x/q table
EAB
2
1
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
LPZ
2
2
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
Control Room
3
0
*br model
1
2
0 0.00035
720 0.00035
*of model
1
4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
1
*number of intake combinations
3
*intake combinations
2 1 3
3 1 4
4 1 3
*time step count
3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
1
1
1
0
1
```

#####

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:33:49

#####

#####

Plant Description

#####

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth
Plant Power Level = 2.7571E+01 MWth

Number of compartments = 3

Compartment information

Compartment number 1 (Source term fraction = 1.0000E+00)

Name: PCS

Compartment volume = 4.3298E+05 (Cubic feet)

Pathways into and out of compartment 1

Pathway to compartment number 2: SG Tube Leakage

Compartment number 2

Name: Environment

Pathways into and out of compartment 2

Pathway to compartment number 3: Control Room Unfiltered Makeup

Pathway to compartment number 3: Control Room Filtered Makeup

Pathway to compartment number 3: Control Room Unfiltered Inleakage

Pathway from compartment number 1: SG Tube Leakage

Pathway from compartment number 3: Control Room Exhaust

Compartment number 3

Name: Control Room

Compartment volume = 3.5923E+04 (Cubic feet)

Removal devices within compartment:

Filter(s)

Pathways into and out of compartment 3

Pathway to compartment number 2: Control Room Exhaust

Pathway from compartment number 2: Control Room Unfiltered Makeup

Pathway from compartment number 2: Control Room Filtered Makeup

Pathway from compartment number 2: Control Room Unfiltered Inleakage

Total number of pathways = 5

#####

RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:33:49

#####

#####

Scenario Description

#####

Radioactive Decay is enabled

Calculation of Daughters is enabled

Iodine fractions

Aerosol = 0.0000E+00

Elemental = 9.7000E-01

Organic = 3.0000E-02

COMPARTMENT DATA

Compartment number 1: PCS

Compartment number 2: Environment

Compartment number 3: Control Room

Compartment Filter Data

Time (hr) Flow Rate Filter Efficiencies (%)
(cfm) Aerosol Elemental Organic

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

## PATHWAY DATA

Pathway number 1: SG Tube Leakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	5.0050E+00	0.0000E+00	0.0000E+00	0.0000E+00
8.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00

## X/Q DATA

X/Q table 1: EAB

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	5.3900E-04
7.2000E+02	5.3900E-04

X/Q table 2: LPZ

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

X/Q table 3: Control Room Unfiltered

Time (hr)	X/Q (s * m^-3)
0.0000E+00	2.1100E-02
3.0556E-01	1.6500E-02
2.0000E+00	1.3400E-02
8.0000E+00	5.4000E-03
2.4000E+01	4.0300E-03
9.6000E+01	2.9800E-03
7.2000E+02	2.9800E-03

X/Q table 4: Control Room Filtered

Time (hr)	X/Q (s * m^-3)
0.0000E+00	7.9600E-04
3.0556E-01	7.3600E-04
2.0000E+00	6.4200E-04
8.0000E+00	2.4300E-04
2.4000E+01	1.7500E-04
9.6000E+01	1.2800E-04
7.2000E+02	1.2800E-04

LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

Location Breathing Rate Data

Time (hr)	Breathing Rate (m^3 * sec^-1)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

Location Breathing Rate Data

Time (hr)	Breathing Rate (m^3 * sec^-1)
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location Control Room is in compartment 3

Inleakage X/Q Table Assignments

Inleakage Path	Source Path	X/Q Table
2	1	3
3	1	4
4	1	3

Location Breathing Rate Data

Time (hr)	Breathing Rate (m^3 * sec^-1)
0.0000E+00	3.5000E-04
7.2000E+02	3.5000E-04

Location Occupancy Factor Data

Time (hr)	Occupancy Factor
0.0000E+00	1.0000E+00
2.4000E+01	6.0000E-01
9.6000E+01	4.0000E-01
7.2000E+02	4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time	Time step
0.0000E+00	1.0000E-06
1.0000E-03	2.0000E-02
7.2000E+02	2.0000E-02



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

#####

```

#####
# # # # # # # # # #
# # # # # # # # # #
# # # # # ##### # # #
# # # # # # # # # #
# # # # # # # # # #
##### ##### # # ##### #

```

#####  
Dose, Detailed Model and Detailed Inventory Output  
#####

Detailed model information at time (H) = 0.0001

EAB Doses:

Time (h) =	0.0001	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.0876E-05	5.9636E-12	2.0256E-05	1.0876E-05
Accumulated dose (rem)		1.0876E-05	5.9636E-12	2.0256E-05	1.0876E-05

LPZ Doses:

Time (h) =	0.0001	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.3439E-06	7.3687E-13	2.5029E-06	1.3439E-06
Accumulated dose (rem)		1.3439E-06	7.3687E-13	2.5029E-06	1.3439E-06

Control Room Doses:

Time (h) =	0.0001	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.7007E-10	7.5190E-15	1.7027E-08	2.7014E-10
Accumulated dose (rem)		2.7007E-10	7.5190E-15	1.7027E-08	2.7014E-10

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0001	Ci	kg	Atoms	Bq
Kr-85		1.0730E+04	2.7350E-02	1.9377E+23	3.9702E+14
Kr-85m		1.9869E+05	2.4144E-05	1.7106E+20	7.3516E+15
Kr-87		3.8309E+05	1.3525E-05	9.3617E+19	1.4174E+16
Kr-88		5.3916E+05	4.2998E-05	2.9425E+20	1.9949E+16
Xe-133		1.4953E+06	7.9886E-03	3.6172E+22	5.5327E+16
Xe-135		4.7859E+05	1.8741E-04	8.3599E+20	1.7708E+16
Kr-83m		9.3012E+04	4.5081E-06	3.2709E+19	3.4414E+15
Xe-138		1.2349E+06	1.2842E-05	5.6042E+19	4.5690E+16
Xe-131m		8.5129E+03	1.0163E-04	4.6721E+20	3.1498E+14
Xe-133m		4.7522E+04	1.0591E-04	4.7955E+20	1.7583E+15
Xe-135m		3.0584E+05	3.3575E-06	1.4977E+19	1.1316E+16
Cs-138		8.0548E+01	1.9036E-09	8.3069E+15	2.9803E+12
Rb-88		6.3611E+01	5.2993E-10	3.6265E+15	2.3536E+12

PCS Transport Group Inventory:

Time (h) =	0.0001	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		2.3239E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		2.4335E-09	0.0000E+00	0.0000E+00

Time (h) =	0.0001	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 0.0001	Ci	kg	Atoms	Bq
Kr-85	3.7065E-04	9.4474E-10	6.6933E+15	1.3714E+07
Kr-85m	6.8633E-03	8.3399E-13	5.9087E+12	2.5394E+08
Kr-87	1.3233E-02	4.6717E-13	3.2338E+12	4.8962E+08
Kr-88	1.8624E-02	1.4852E-12	1.0164E+13	6.8908E+08
Xe-133	5.1652E-02	2.7595E-10	1.2495E+15	1.9111E+09
Xe-135	1.6531E-02	6.4735E-12	2.8877E+13	6.1167E+08
Kr-83m	3.2128E-03	1.5572E-13	1.1298E+12	1.1888E+08
Xe-138	4.2655E-02	4.4360E-13	1.9358E+12	1.5782E+09
Xe-131m	2.9406E-04	3.5107E-12	1.6139E+13	1.0880E+07
Xe-133m	1.6415E-03	3.6583E-12	1.6565E+13	6.0736E+07
Xe-135m	1.0564E-02	1.1597E-13	5.1734E+11	3.9088E+08
Cs-138	3.7003E-06	8.7448E-17	3.8161E+08	1.3691E+05
Rb-88	2.9222E-06	2.4344E-17	1.6659E+08	1.0812E+05

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 0.0001	Release	Rate/s	Release
Noble gases (atoms)	1.5976E+14	4.4377E+16	8.0273E+15
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.6812E-18	4.6699E-16	1.1179E-16

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Pathway

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) =	0.0001	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0001	Ci	kg	Atoms	Bq
Kr-85		1.4236E-06	3.6286E-12	2.5708E+13	5.2675E+04
Kr-85m		2.6361E-05	3.2033E-15	2.2695E+10	9.7537E+05
Kr-87		5.0826E-05	1.7944E-15	1.2420E+10	1.8806E+06
Kr-88		7.1532E-05	5.7047E-15	3.9039E+10	2.6467E+06
Xe-133		1.9839E-04	1.0599E-12	4.7990E+12	7.3404E+06
Xe-135		6.3496E-05	2.4864E-14	1.1091E+11	2.3493E+06
Kr-83m		1.2340E-05	5.9811E-16	4.3396E+09	4.5659E+05
Xe-138		1.6383E-04	1.7038E-15	7.4353E+09	6.0618E+06
Xe-131m		1.1294E-06	1.3484E-14	6.1987E+10	4.1789E+04
Xe-133m		6.3049E-06	1.4051E-14	6.3623E+10	2.3328E+05
Xe-135m		4.0576E-05	4.4544E-16	1.9870E+09	1.5013E+06
Cs-138		1.4213E-08	3.3589E-19	1.4658E+06	5.2589E+02
Rb-88		1.1224E-08	9.3507E-20	6.3990E+05	4.1531E+02

## Control Room Transport Group Inventory:

Time (h) =	0.0001	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		3.0832E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		4.2940E-19	0.0000E+00	0.0000E+00

Time (h) =	0.0001	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Aerosols (kg) 0.0000E+00

Detailed model information at time (H) = 0.0250

## EAB Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		5.4685E-03	4.1865E-07	1.0207E-02	5.4725E-03
Accumulated dose (rem)		5.4793E-03	4.1865E-07	1.0228E-02	5.4834E-03

## LPZ Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		6.7569E-04	5.1729E-08	1.2612E-03	6.7620E-04
Accumulated dose (rem)		6.7704E-04	5.1730E-08	1.2638E-03	6.7754E-04

## Control Room Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		5.0570E-05	2.1484E-07	3.2002E-03	5.2668E-05
Accumulated dose (rem)		5.0571E-05	2.1484E-07	3.2002E-03	5.2668E-05

## PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Kr-85		1.0838E+04	2.7623E-02	1.9571E+23	4.0099E+14
Kr-85m		1.9990E+05	2.4291E-05	1.7210E+20	7.3965E+15
Kr-87		3.8170E+05	1.3475E-05	9.3277E+19	1.4123E+16
Kr-88		5.4124E+05	4.3164E-05	2.9538E+20	2.0026E+16
Xe-133		1.5100E+06	8.0673E-03	3.6528E+22	5.5872E+16
Xe-135		4.8301E+05	1.8914E-04	8.4373E+20	1.7872E+16
Kr-83m		9.3059E+04	4.5104E-06	3.2726E+19	3.4432E+15
Xe-138		1.1593E+06	1.2056E-05	5.2613E+19	4.2894E+16
Xe-131m		8.5974E+03	1.0264E-04	4.7185E+20	3.1810E+14
Xe-133m		4.7980E+04	1.0693E-04	4.8417E+20	1.7753E+15
Xe-135m		2.8867E+05	3.1690E-06	1.4136E+19	1.0681E+16
Cs-138		3.8521E+04	9.1036E-07	3.9727E+18	1.4253E+15
Rb-88		3.1300E+04	2.6075E-07	1.7844E+18	1.1581E+15

## PCS Transport Group Inventory:

Time (h) =	0.0250	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		2.3469E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		1.1711E-06	0.0000E+00	0.0000E+00

## Deposition Recirculating

Time (h) =	0.0250	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

## SG Tube Leakage Transport Group Inventory:

Time (h) =	0.0250	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Environment Integral Nuclide Release:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Kr-85		1.8682E-01	4.7619E-07	3.3737E+18	6.9125E+09
Kr-85m		3.4461E+00	4.1875E-10	2.9668E+15	1.2751E+11
Kr-87		6.5800E+00	2.3230E-10	1.6080E+15	2.4346E+11
Kr-88		9.3303E+00	7.4409E-10	5.0921E+15	3.4522E+11
Xe-133		2.6031E+01	1.3907E-07	6.2970E+17	9.6316E+11
Xe-135		8.3265E+00	3.2606E-09	1.4545E+16	3.0808E+11

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Kr-83m	1.6042E+00	7.7753E-11	5.6415E+14	5.9356E+10
Xe-138	1.9985E+01	2.0784E-10	9.0697E+14	7.3943E+11
Xe-131m	1.4821E-01	1.7694E-09	8.1341E+15	5.4837E+09
Xe-133m	8.2712E-01	1.8433E-09	8.3465E+15	3.0603E+10
Xe-135m	4.9763E+00	5.4629E-11	2.4369E+14	1.8412E+11
Cs-138	6.6406E-01	1.5693E-11	6.8484E+13	2.4570E+10
Rb-88	5.3958E-01	4.4951E-12	3.0761E+13	1.9964E+10

## Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) =	Release	Rate/s	Release
Noble gases (atoms)	8.1082E+17	1.1854E+16	4.0458E+18
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	4.0459E-12	5.9151E-14	2.0188E-11

## SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.0250				
Kr-85	7.1178E-04	1.8142E-09	1.2854E+16	2.6336E+07
Kr-85m	1.3129E-02	1.5954E-12	1.1303E+13	4.8578E+08
Kr-87	2.5069E-02	8.8503E-13	6.1262E+12	9.2756E+08
Kr-88	3.5548E-02	2.8349E-12	1.9400E+13	1.3153E+09
Xe-133	9.9176E-02	5.2984E-10	2.3991E+15	3.6695E+09
Xe-135	3.1723E-02	1.2422E-11	5.5414E+13	1.1738E+09
Kr-83m	6.1119E-03	2.9623E-13	2.1493E+12	2.2614E+08
Xe-138	7.6139E-02	7.9184E-13	3.4555E+12	2.8172E+09

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-131m	5.6466E-04	6.7413E-12	3.0990E+13	2.0892E+07
Xe-133m	3.1512E-03	7.0230E-12	3.1799E+13	1.1660E+08
Xe-135m	1.8959E-02	2.0813E-13	9.2844E+11	7.0149E+08
Cs-138	2.5300E-03	5.9790E-14	2.6092E+11	9.3609E+07
Rb-88	2.0557E-03	1.7126E-14	1.1720E+11	7.6062E+07

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool	
Time (h) = 0.0250				
Noble gases (atoms)	1.5414E+16	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	7.6916E-14	0.0000E+00	0.0000E+00	0.0000E+00

	Surfaces	Filter
Time (h) = 0.0250		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3056

EAB Doses:

Time (h) = 0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.9705E-02	1.1117E-04	1.1810E-01	6.0817E-02
Accumulated dose (rem)	6.5185E-02	1.1159E-04	1.2832E-01	6.6301E-02

LPZ Doses:

Time (h) = 0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.3773E-03	1.3736E-05	1.4592E-02	7.5147E-03
Accumulated dose (rem)	8.0544E-03	1.3788E-05	1.5856E-02	8.1923E-03

Control Room Doses:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) =	0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.0548E-02	8.0618E-04	7.1594E-01	1.8643E-02
Accumulated dose (rem)		1.0599E-02	8.0639E-04	7.1914E-01	1.8696E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.3056	Ci	kg	Atoms	Bq
Kr-85		1.0835E+04	2.7618E-02	1.9567E+23	4.0091E+14
Kr-85m		1.9138E+05	2.3255E-05	1.6476E+20	7.0809E+15
Kr-87		3.2751E+05	1.1562E-05	8.0034E+19	1.2118E+16
Kr-88		5.0532E+05	4.0299E-05	2.7578E+20	1.8697E+16
Xe-133		1.5075E+06	8.0536E-03	3.6466E+22	5.5777E+16
Xe-135		4.7697E+05	1.8677E-04	8.3317E+20	1.7648E+16
Kr-83m		8.3661E+04	4.0549E-06	2.9421E+19	3.0954E+15
Xe-138		5.0874E+05	5.2908E-06	2.3088E+19	1.8823E+16
Xe-131m		8.5899E+03	1.0255E-04	4.7144E+20	3.1782E+14
Xe-133m		4.7794E+04	1.0651E-04	4.8229E+20	1.7684E+15
Xe-135m		1.3456E+05	1.4771E-06	6.5892E+18	4.9785E+15
Cs-138		2.6399E+05	6.2389E-06	2.7226E+19	9.7678E+15
Rb-88		2.7253E+05	2.2703E-06	1.5537E+19	1.0084E+16

PCS Transport Group Inventory:

			Overlying
Time (h) =	0.3056	Atmosphere	Sump Pool
Noble gases (atoms)		2.3450E+23	0.0000E+00 0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00 0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00 0.0000E+00
Aerosols (kg)		8.5092E-06	0.0000E+00 0.0000E+00

		Deposition	Recirculating
Time (h) =	0.3056	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

		Pathway
Time (h) =	0.3056	Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	0.3056	Ci	kg	Atoms	Bq
Kr-85		2.2837E+00	5.8209E-06	4.1240E+19	8.4498E+10
Kr-85m		4.0335E+01	4.9013E-09	3.4725E+16	1.4924E+12
Kr-87		6.9027E+01	2.4369E-09	1.6868E+16	2.5540E+12
Kr-88		1.0650E+02	8.4936E-09	5.8125E+16	3.9406E+12
Xe-133		3.1773E+02	1.6974E-06	7.6858E+18	1.1756E+13
Xe-135		1.0053E+02	3.9365E-08	1.7560E+17	3.7195E+12
Kr-83m		1.7633E+01	8.5462E-10	6.2008E+15	6.5241E+11
Xe-138		1.0722E+02	1.1151E-09	4.8662E+15	3.9673E+12
Xe-131m		1.8104E+00	2.1614E-08	9.9362E+16	6.6986E+10
Xe-133m		1.0073E+01	2.2449E-08	1.0165E+17	3.7271E+11
Xe-135m		2.8359E+01	3.1132E-10	1.3888E+15	1.0493E+12
Cs-138		5.5640E+01	1.3149E-09	5.7382E+15	2.0587E+12
Rb-88		5.7439E+01	4.7851E-10	3.2746E+15	2.1253E+12

Environment Transport Group Inventory:

		Present	Release	Integral
Time (h) =	0.3056	Release	Rate/s	Release
Noble gases (atoms)		8.9935E+17	1.2491E+16	4.9425E+19
Elemental I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)		3.2634E-11	4.5325E-13	1.7934E-09

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3056	Ci	kg	Atoms	Bq
Kr-85	1.2443E-02	3.1715E-08	2.2470E+17	4.6038E+08
Kr-85m	2.1976E-01	2.6704E-11	1.8920E+14	8.1313E+09
Kr-87	3.7609E-01	1.3277E-11	9.1907E+13	1.3915E+10
Kr-88	5.8028E-01	4.6277E-11	3.1669E+14	2.1470E+10
Xe-133	1.7311E+00	9.2483E-09	4.1876E+16	6.4051E+10
Xe-135	5.4772E-01	2.1448E-10	9.5676E+14	2.0266E+10
Kr-83m	9.6071E-02	4.6564E-12	3.3785E+13	3.5546E+09
Xe-138	5.8421E-01	6.0757E-12	2.6513E+13	2.1616E+10
Xe-131m	9.8641E-03	1.1776E-10	5.4137E+14	3.6497E+08
Xe-133m	5.4883E-02	1.2232E-10	5.5383E+14	2.0307E+09
Xe-135m	1.5451E-01	1.6962E-12	7.5667E+12	5.7171E+09
Cs-138	3.0316E-01	7.1644E-12	3.1264E+13	1.1217E+10
Rb-88	3.1296E-01	2.6071E-12	1.7841E+13	1.1579E+10

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.3056			
Noble gases (atoms)	2.6929E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	9.7715E-12	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.3056		



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3056	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3333

EAB Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.6370E-03	1.7787E-05	1.1694E-02	5.8182E-03
Accumulated dose (rem)	7.0822E-02	1.2937E-04	1.4002E-01	7.2119E-02

LPZ Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	6.9652E-04	2.1978E-06	1.4449E-03	7.1891E-04
Accumulated dose (rem)	8.7509E-03	1.5986E-05	1.7301E-02	8.9112E-03

Control Room Doses:

Time (h) = 0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.8659E-03	1.9935E-04	1.3105E-01	3.8971E-03
Accumulated dose (rem)	1.2465E-02	1.0057E-03	8.5019E-01	2.2593E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Kr-85	1.0835E+04	2.7617E-02	1.9567E+23	4.0091E+14
Kr-85m	1.9055E+05	2.3155E-05	1.6405E+20	7.0504E+15
Kr-87	3.2259E+05	1.1389E-05	7.8831E+19	1.1936E+16
Kr-88	5.0190E+05	4.0027E-05	2.7392E+20	1.8570E+16
Xe-133	1.5072E+06	8.0523E-03	3.6460E+22	5.5768E+16
Xe-135	4.7623E+05	1.8648E-04	8.3187E+20	1.7620E+16
Kr-83m	8.2785E+04	4.0124E-06	2.9112E+19	3.0630E+15
Xe-138	4.6895E+05	4.8770E-06	2.1282E+19	1.7351E+16
Xe-131m	8.5891E+03	1.0254E-04	4.7140E+20	3.1780E+14

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-133m	4.7775E+04	1.0647E-04	4.8210E+20	1.7677E+15
Xe-135m	1.2477E+05	1.3697E-06	6.1102E+18	4.6166E+15
Cs-138	2.7205E+05	6.4292E-06	2.8056E+19	1.0066E+16
Rb-88	2.8754E+05	2.3954E-06	1.6393E+19	1.0639E+16

PCS Transport Group Inventory:

Time (h) =	0.3333	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	2.3448E+23	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	8.8246E-06	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	0.3333	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Environment Integral Nuclide Release:

Time (h) =	0.3333	Ci	kg	Atoms	Bq
Kr-85	2.4915E+00	6.3506E-06	4.4993E+19	9.2187E+10	
Kr-85m	4.3817E+01	5.3244E-09	3.7722E+16	1.6212E+12	
Kr-87	7.4178E+01	2.6188E-09	1.8127E+16	2.7446E+12	
Kr-88	1.1541E+02	9.2040E-09	6.2986E+16	4.2702E+12	
Xe-133	3.4659E+02	1.8516E-06	8.3839E+18	1.2824E+13	
Xe-135	1.0951E+02	4.2881E-08	1.9129E+17	4.0518E+12	
Kr-83m	1.9036E+01	9.2265E-10	6.6943E+15	7.0434E+11	
Xe-138	1.0783E+02	1.1214E-09	4.8938E+15	3.9898E+12	
Xe-131m	1.9750E+00	2.3580E-08	1.0840E+17	7.3077E+10	
Xe-133m	1.0986E+01	2.4483E-08	1.1086E+17	4.0648E+11	
Xe-135m	2.8691E+01	3.1497E-10	1.4050E+15	1.0616E+12	
Cs-138	6.2556E+01	1.4784E-09	6.4514E+15	2.3146E+12	
Rb-88	6.6120E+01	5.5082E-10	3.7695E+15	2.4464E+12	

Environment Transport Group Inventory:

Time (h) =	0.3333	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.1560E+18	4.1463E+16	5.3919E+19	
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	
Aerosols (kg)	8.1139E-11	1.5604E-12	2.0292E-09	

SG Tube Leakage Transport Group Inventory:

Time (h) =	0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	0.3333	Pathway Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Kr-85	1.3123E-02	3.3449E-08	2.3699E+17	4.8557E+08
Kr-85m	2.3079E-01	2.8044E-11	1.9869E+14	8.5393E+09
Kr-87	3.9071E-01	1.3794E-11	9.5479E+13	1.4456E+10
Kr-88	6.0789E-01	4.8479E-11	3.3176E+14	2.2492E+10
Xe-133	1.8255E+00	9.7527E-09	4.4160E+16	6.7545E+10
Xe-135	5.7679E-01	2.2586E-10	1.0075E+15	2.1341E+10
Kr-83m	1.0027E-01	4.8597E-12	3.5260E+13	3.7099E+09
Xe-138	5.6798E-01	5.9069E-12	2.5777E+13	2.1015E+10
Xe-131m	1.0403E-02	1.2420E-10	5.7094E+14	3.8491E+08
Xe-133m	5.7864E-02	1.2896E-10	5.8391E+14	2.1410E+09
Xe-135m	1.5112E-01	1.6590E-12	7.4005E+12	5.5915E+09
Cs-138	3.2949E-01	7.7868E-12	3.3981E+13	1.2191E+10
Rb-88	3.4826E-01	2.9013E-12	1.9854E+13	1.2886E+10

Control Room Transport Group Inventory:

			Overlying
Time (h) = 0.3333	Atmosphere	Sump	Pool
Noble gases (atoms)	2.8400E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.0688E-11	0.0000E+00	0.0000E+00

	Deposition Recirculating	
Time (h) = 0.3333	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Pathway

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 0.3333 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 0.3333 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 0.3333 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Detailed model information at time (H) = 2.0000

EAB Doses:

Time (h) = 2.0000 Whole Body Thyroid Skin TEDE  
 Delta dose (rem) 2.3667E-01 9.8912E-04 5.4543E-01 2.4815E-01  
 Accumulated dose (rem) 3.0749E-01 1.1185E-03 6.8545E-01 3.2027E-01

LPZ Doses:

Time (h) = 2.0000 Whole Body Thyroid Skin TEDE  
 Delta dose (rem) 2.9243E-02 1.2222E-04 6.7395E-02 3.0662E-02  
 Accumulated dose (rem) 3.7994E-02 1.3820E-04 8.4696E-02 3.9573E-02

Control Room Doses:

Time (h) = 2.0000 Whole Body Thyroid Skin TEDE  
 Delta dose (rem) 2.6553E-02 2.3510E-03 1.9054E+00 5.3245E-02  
 Accumulated dose (rem) 3.9018E-02 3.3567E-03 2.7555E+00 7.5838E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
Kr-85	1.0823E+04	2.7586E-02	1.9545E+23	4.0045E+14
Kr-85m	1.4707E+05	1.7871E-05	1.2661E+20	5.4415E+15
Kr-87	1.2990E+05	4.5859E-06	3.1744E+19	4.8062E+15
Kr-88	3.3377E+05	2.6618E-05	1.8216E+20	1.2350E+16
Xe-133	1.4922E+06	7.9718E-03	3.6096E+22	5.5211E+16
Xe-135	4.2203E+05	1.6526E-04	7.3721E+20	1.5615E+16
Kr-83m	4.3983E+04	2.1318E-06	1.5467E+19	1.6274E+15
Xe-138	3.5169E+03	3.6575E-08	1.5961E+17	1.3013E+14
Xe-131m	8.5446E+03	1.0201E-04	4.6895E+20	3.1615E+14
Xe-133m	4.6682E+04	1.0404E-04	4.7107E+20	1.7272E+15
Xe-135m	1.3390E+03	1.4699E-08	6.5570E+16	4.9542E+13
Cs-138	7.2090E+04	1.7037E-06	7.4346E+18	2.6673E+15
Rb-88	3.7567E+05	3.1296E-06	2.1417E+19	1.3900E+16

PCS Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	2.3357E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	4.8333E-06	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	1.5021E+01	3.8287E-05	2.7126E+20	5.5578E+11
Kr-85m	2.0411E+02	2.4803E-08	1.7572E+17	7.5522E+12
Kr-87	1.8028E+02	6.3647E-09	4.4056E+16	6.6705E+12
Kr-88	4.6324E+02	3.6943E-08	2.5282E+17	1.7140E+13
Xe-133	2.0710E+03	1.1064E-05	5.0097E+19	7.6626E+13
Xe-135	5.8573E+02	2.2936E-07	1.0232E+18	2.1672E+13
Kr-83m	6.1043E+01	2.9586E-09	2.1467E+16	2.2586E+12
Xe-138	4.8811E+00	5.0762E-11	2.2152E+14	1.8060E+11
Xe-131m	1.1859E+01	1.4158E-07	6.5085E+17	4.3878E+11
Xe-133m	6.4789E+01	1.4439E-07	6.5379E+17	2.3972E+12
Xe-135m	1.8583E+00	2.0401E-11	9.1004E+13	6.8759E+10
Cs-138	9.9998E+01	2.3632E-09	1.0313E+16	3.6999E+12
Rb-88	5.2133E+02	4.3430E-09	2.9721E+16	1.9289E+13

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 2.0000	Release	Rate/s	Release
Noble gases (atoms)	3.2403E+18	4.5004E+16	3.2417E+20
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	6.7019E-11	9.3082E-13	6.7062E-09

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Cs-138	3.3650E-02	7.9524E-13	3.4703E+12	1.2451E+09
Rb-88	5.5097E-02	4.5900E-13	3.1411E+12	2.0386E+09

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.2542E-12

Control Room Unfiltered Inleakage Transport Group Inventory:

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) =	2.0000
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	2.0000
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Kr-85	2.0118E-03	5.1276E-09	3.6329E+16	7.4435E+07
Kr-85m	2.7337E-02	3.3218E-12	2.3534E+13	1.0115E+09
Kr-87	2.4145E-02	8.5241E-13	5.9004E+12	8.9337E+08
Kr-88	6.2041E-02	4.9477E-12	3.3859E+13	2.2955E+09
Xe-133	2.7736E-01	1.4818E-09	6.7094E+15	1.0262E+10
Xe-135	7.8446E-02	3.0718E-11	1.3703E+14	2.9025E+09
Kr-83m	8.1753E-03	3.9624E-13	2.8750E+12	3.0249E+08
Xe-138	6.5371E-04	6.7985E-15	2.9668E+10	2.4187E+07
Xe-131m	1.5882E-03	1.8961E-11	8.7167E+13	5.8765E+07
Xe-133m	8.6770E-03	1.9338E-11	8.7561E+13	3.2105E+08
Xe-135m	2.4888E-04	2.7322E-15	1.2188E+10	9.2087E+06
Cs-138	1.2252E-03	2.8956E-14	1.2636E+11	4.5334E+07
Rb-88	2.7137E-02	2.2607E-13	1.5471E+12	1.0041E+09

## Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
2.0000			
Noble gases (atoms)	4.3416E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	2.5503E-13	0.0000E+00	0.0000E+00

## Recirculating Filter Inventory

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Cs-138	3.3526E-02	7.9231E-13	3.4576E+12	1.2405E+09
Rb-88	4.1582E-02	3.4641E-13	2.3706E+12	1.5385E+09

Time (h) =	Deposition Surfaces	Recirculating Filter
2.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	1.1387E-12

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	2.0000
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Cs-138	3.3650E-02	7.9524E-13	3.4703E+12	1.2451E+09
Rb-88	5.5097E-02	4.5900E-13	3.1411E+12	2.0386E+09

## Control Room Filtered Makeup Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.2542E-12

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Cs-138	6.7176E-02	1.5876E-12	6.9279E+12	2.4855E+09
Rb-88	9.6679E-02	8.0540E-13	5.5116E+12	3.5771E+09

Detailed model information at time (H) = 8.0000

EAB Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.8599E-01	8.9540E-04	7.3258E-01	2.9988E-01
Accumulated dose (rem)	5.9348E-01	2.0139E-03	1.4180E+00	6.2014E-01

LPZ Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.6077E-02	5.0335E-05	4.1182E-02	1.6858E-02
Accumulated dose (rem)	5.4071E-02	1.8854E-04	1.2588E-01	5.6430E-02

Control Room Doses:

Time (h) = 8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.0014E-02	4.1392E-04	7.3303E-01	1.6742E-02
Accumulated dose (rem)	4.9032E-02	3.7706E-03	3.4886E+00	9.2579E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Kr-85	1.0779E+04	2.7473E-02	1.9464E+23	3.9881E+14
Kr-85m	5.7882E+04	7.0335E-06	4.9832E+19	2.1417E+15
Kr-87	4.9144E+03	1.7350E-07	1.2009E+18	1.8183E+14
Kr-88	7.6854E+04	6.1291E-06	4.1943E+19	2.8436E+15
Xe-133	1.4391E+06	7.6885E-03	3.4813E+22	5.3248E+16
Xe-135	2.6600E+05	1.0416E-04	4.6465E+20	9.8420E+15
Kr-83m	4.5132E+03	2.1875E-07	1.5872E+18	1.6699E+14
Xe-138	7.8786E-05	8.1936E-16	3.5756E+09	2.9151E+06
Xe-131m	8.3861E+03	1.0012E-04	4.6025E+20	3.1028E+14
Xe-133m	4.2948E+04	9.5716E-05	4.3339E+20	1.5891E+15
Xe-135m	1.0896E-04	1.1962E-15	5.3359E+09	4.0316E+06
Cs-138	3.2141E+01	7.5959E-10	3.3147E+15	1.1892E+12
Rb-88	8.7841E+04	7.3178E-07	5.0078E+18	3.2501E+15

PCS Transport Group Inventory:

			Overlying
Time (h) = 8.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	2.3091E+23	0.0000E+00	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	7.3253E-07	0.0000E+00	0.0000E+00

		Deposition	Recirculating
		Surfaces	Filter
Time (h) =	8.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

		Pathway
		Filter
Time (h) =	8.0000	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Environment Integral Nuclide Release:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Kr-85		5.9970E+01	1.5285E-04	1.0829E+21	2.2189E+12
Kr-85m		3.2205E+02	3.9133E-08	2.7725E+17	1.1916E+13
Kr-87		2.7343E+01	9.6530E-10	6.6818E+15	1.0117E+12
Kr-88		4.2760E+02	3.4101E-08	2.3337E+17	1.5821E+13
Xe-133		8.0071E+03	4.2777E-05	1.9369E+20	2.9626E+14
Xe-135		1.4800E+03	5.7953E-07	2.5852E+18	5.4759E+13
Kr-83m		2.5111E+01	1.2171E-09	8.8306E+15	9.2910E+11
Xe-131m		4.6658E+01	5.5704E-07	2.5608E+18	1.7264E+12
Xe-133m		2.3896E+02	5.3254E-07	2.4113E+18	8.8413E+12
Cs-138		1.7874E-01	4.2242E-12	1.8434E+13	6.6135E+09
Rb-88		4.8872E+02	4.0714E-09	2.7862E+16	1.8083E+13

Environment Transport Group Inventory:

		Present	Release	Integral
		Release	Rate/s	Release
Time (h) =	8.0000			
Noble gases (atoms)	3.2030E+18	4.4486E+16	1.2847E+21	
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00	
Aerosols (kg)	1.0158E-11	1.4109E-13	4.0756E-09	

SG Tube Leakage Transport Group Inventory:

		Pathway
		Filter
Time (h) =	8.0000	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Makeup Transport Group Inventory:

		Pathway
		Filter
Time (h) =	8.0000	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Cs-138		7.1116E-05	1.6807E-15	7.3342E+09	2.6313E+06
Rb-88		1.2094E-02	1.0075E-13	6.8946E+11	4.4747E+08

Control Room Filtered Makeup Transport Group Inventory:

		Pathway
		Filter
Time (h) =	8.0000	
Noble gases (atoms)	0.0000E+00	



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.0243E-13

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Kr-85	1.5459E-03	3.9402E-09	2.7916E+16	5.7198E+07
Kr-85m	8.3016E-03	1.0088E-12	7.1470E+12	3.0716E+08
Kr-87	7.0484E-04	2.4883E-14	1.7224E+11	2.6079E+07
Kr-88	1.1023E-02	8.7905E-13	6.0156E+12	4.0784E+08
Xe-133	2.0641E-01	1.1027E-09	4.9929E+15	7.6370E+09
Xe-135	3.8150E-02	1.4939E-11	6.6641E+13	1.4116E+09
Kr-83m	6.4730E-04	3.1374E-14	2.2763E+11	2.3950E+07
Xe-131m	1.2027E-03	1.4359E-11	6.6010E+13	4.4502E+07
Xe-133m	6.1597E-03	1.3728E-11	6.2158E+13	2.2791E+08
Cs-138	3.1929E-07	7.5456E-18	3.2928E+07	1.1814E+04
Rb-88	4.6484E-03	3.8724E-14	2.6500E+11	1.7199E+08

Control Room Transport Group Inventory:

			Overlying
Time (h) = 8.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	3.3117E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	3.8732E-14	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Cs-138	1.9118E-05	4.5180E-16	1.9716E+09	7.0735E+05
Rb-88	4.9007E-03	4.0826E-14	2.7939E+11	1.8133E+08

Deposition Recirculating

	Surfaces	Filter
Time (h) = 8.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	4.1278E-14

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Cs-138	7.1116E-05	1.6807E-15	7.3342E+09	2.6313E+06
Rb-88	1.2094E-02	1.0075E-13	6.8946E+11	4.4747E+08

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.0243E-13

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Cs-138	9.0234E-05	2.1325E-15	9.3057E+09	3.3386E+06
Rb-88	1.6995E-02	1.4158E-13	9.6885E+11	6.2880E+08

Detailed model information at time (H) = 24.0000

EAB Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.0681E-06	2.4162E-09	9.5195E-06	4.1080E-06
Accumulated dose (rem)	5.9348E-01	2.0139E-03	1.4180E+00	6.2015E-01

LPZ Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.5397E-07	9.1447E-11	3.6029E-07	1.5548E-07
Accumulated dose (rem)	5.4071E-02	1.8854E-04	1.2588E-01	5.6431E-02

Control Room Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.3191E-04	1.2983E-05	2.6295E-02	5.4608E-04
Accumulated dose (rem)	4.9364E-02	3.7836E-03	3.5149E+00	9.3126E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Kr-85	1.0778E+04	2.7471E-02	1.9463E+23	3.9878E+14
Kr-85m	4.8690E+03	5.9165E-07	4.1918E+18	1.8015E+14
Kr-87	8.0156E-01	2.8298E-11	1.9588E+14	2.9658E+10
Kr-88	1.5478E+03	1.2344E-07	8.4474E+17	5.7270E+13
Xe-133	1.3210E+06	7.0575E-03	3.1956E+22	4.8878E+16
Xe-135	7.8526E+04	3.0750E-05	1.3717E+20	2.9055E+15
Kr-83m	1.0533E+01	5.1049E-10	3.7039E+15	3.8970E+11
Xe-131m	8.0667E+03	9.6306E-05	4.4272E+20	2.9847E+14
Xe-133m	3.4771E+04	7.7493E-05	3.5088E+20	1.2865E+15
Cs-138	3.4061E-08	8.0495E-19	3.5127E+06	1.2603E+03
Rb-88	1.7691E+03	1.4738E-08	1.0086E+17	6.5457E+13

PCS Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
--------------------	------------	------	----------------

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	2.2752E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.4738E-08	0.0000E+00	0.0000E+00

	Deposition Recirculating	
Time (h) = 24.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 24.0000	Release	Rate/s	Release
Noble gases (atoms)	4.7740E-02	6.6306E-04	1.2659E+21
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.5276E-33	2.1216E-35	8.2001E-11

SG Tube Leakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7810E-24

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Aerosols (kg) 0.0000E+00

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 24.0000			
Noble gases (atoms)	9.8021E-01	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	3.0692E-32	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 24.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	4.8277E-25

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	1.7810E-24

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 96.0000

EAB Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 96.0000				
Delta dose (rem)	2.7645E-23	2.0567E-27	8.5054E-23	2.7679E-23
Accumulated dose (rem)	5.9348E-01	2.0139E-03	1.4180E+00	6.2015E-01

LPZ Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 96.0000				
Delta dose (rem)	4.4468E-25	3.3083E-29	1.3681E-24	4.4522E-25
Accumulated dose (rem)	5.4071E-02	1.8854E-04	1.2588E-01	5.6431E-02

Control Room Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 96.0000				
Delta dose (rem)	1.3532E-21	5.1894E-24	1.4095E-19	1.4389E-21
Accumulated dose (rem)	4.9364E-02	3.7836E-03	3.5149E+00	9.3126E-02

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Kr-85	1.0772E+04	2.7456E-02	1.9453E+23	3.9857E+14
Kr-85m	7.0706E-02	8.5918E-12	6.0872E+13	2.6161E+09
Kr-88	3.6139E-05	2.8821E-15	1.9723E+10	1.3371E+06
Xe-133	8.9578E+05	4.7856E-03	2.1669E+22	3.3144E+16
Xe-135	3.2406E+02	1.2690E-07	5.6606E+17	1.1990E+13
Xe-131m	6.7734E+03	8.0865E-05	3.7174E+20	2.5061E+14
Xe-133m	1.3442E+04	2.9958E-05	1.3565E+20	4.9737E+14
Rb-88	4.1306E-05	3.4410E-16	2.3548E+09	1.5283E+06

PCS Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	2.1670E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	3.4410E-16	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

Time (h) = 96.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	1.2057E+21
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	1.9146E-18

SG Tube Leakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 96.0000			
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 96.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 720.0000

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

EAB Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.4456E-98	2.1429-109	1.8273E-97	5.4456E-98
Accumulated dose (rem)	5.9348E-01	2.0139E-03	1.4180E+00	6.2015E-01

LPZ Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.5662-100	1.0098-111	8.6109-100	2.5662-100
Accumulated dose (rem)	5.4071E-02	1.8854E-04	1.2588E-01	5.6431E-02

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.7771E-96	3.6046-106	2.0187E-94	1.7771E-96
Accumulated dose (rem)	4.9364E-02	3.7836E-03	3.5149E+00	9.3126E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Kr-85	1.0723E+04	2.7330E-02	1.9363E+23	3.9674E+14
Xe-133	2.9145E+04	1.5570E-04	7.0502E+20	1.0784E+15
Xe-131m	1.4897E+03	1.7785E-05	8.1758E+19	5.5118E+13
Xe-133m	3.5591E+00	7.9319E-09	3.5915E+16	1.3169E+11

PCS Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.9442E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Transport Group Inventory:

Time (h) = 720.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	0.0000E+00	0.0000E+00	1.0817E+21
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Transport Group Inventory:

			Overlying
Time (h) = 720.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 720.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

-----  
Transport Group Totals in Model:  
-----

Noble Gases (atoms)	1.9550E+23
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

37004

#####  
I-131 Summary  
#####

	PCS	Environment	Control Room
Time (hr)	I-131 (Curies)	I-131 (Curies)	I-131 (Curies)
0.000	0.0000E+00	0.0000E+00	0.0000E+00
0.000	0.0000E+00	0.0000E+00	0.0000E+00
0.025	0.0000E+00	0.0000E+00	0.0000E+00
0.300	0.0000E+00	0.0000E+00	0.0000E+00
0.306	0.0000E+00	0.0000E+00	0.0000E+00
0.333	0.0000E+00	0.0000E+00	0.0000E+00
0.600	0.0000E+00	0.0000E+00	0.0000E+00
0.860	0.0000E+00	0.0000E+00	0.0000E+00
1.120	0.0000E+00	0.0000E+00	0.0000E+00
1.380	0.0000E+00	0.0000E+00	0.0000E+00
1.640	0.0000E+00	0.0000E+00	0.0000E+00
1.900	0.0000E+00	0.0000E+00	0.0000E+00
2.000	0.0000E+00	0.0000E+00	0.0000E+00
2.260	0.0000E+00	0.0000E+00	0.0000E+00
2.520	0.0000E+00	0.0000E+00	0.0000E+00
2.780	0.0000E+00	0.0000E+00	0.0000E+00
3.040	0.0000E+00	0.0000E+00	0.0000E+00
3.300	0.0000E+00	0.0000E+00	0.0000E+00
3.560	0.0000E+00	0.0000E+00	0.0000E+00
3.820	0.0000E+00	0.0000E+00	0.0000E+00
4.080	0.0000E+00	0.0000E+00	0.0000E+00
4.340	0.0000E+00	0.0000E+00	0.0000E+00
4.600	0.0000E+00	0.0000E+00	0.0000E+00
4.860	0.0000E+00	0.0000E+00	0.0000E+00
5.120	0.0000E+00	0.0000E+00	0.0000E+00
5.380	0.0000E+00	0.0000E+00	0.0000E+00
5.640	0.0000E+00	0.0000E+00	0.0000E+00
5.900	0.0000E+00	0.0000E+00	0.0000E+00
6.160	0.0000E+00	0.0000E+00	0.0000E+00
6.420	0.0000E+00	0.0000E+00	0.0000E+00
6.680	0.0000E+00	0.0000E+00	0.0000E+00
6.940	0.0000E+00	0.0000E+00	0.0000E+00
7.200	0.0000E+00	0.0000E+00	0.0000E+00
7.460	0.0000E+00	0.0000E+00	0.0000E+00
7.720	0.0000E+00	0.0000E+00	0.0000E+00
7.980	0.0000E+00	0.0000E+00	0.0000E+00
8.000	0.0000E+00	0.0000E+00	0.0000E+00
8.260	0.0000E+00	0.0000E+00	0.0000E+00
8.520	0.0000E+00	0.0000E+00	0.0000E+00
8.780	0.0000E+00	0.0000E+00	0.0000E+00
9.040	0.0000E+00	0.0000E+00	0.0000E+00
9.300	0.0000E+00	0.0000E+00	0.0000E+00
9.560	0.0000E+00	0.0000E+00	0.0000E+00
9.820	0.0000E+00	0.0000E+00	0.0000E+00
10.080	0.0000E+00	0.0000E+00	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

24.000	0.0000E+00	0.0000E+00	0.0000E+00
96.000	0.0000E+00	0.0000E+00	0.0000E+00
720.000	0.0000E+00	0.0000E+00	0.0000E+00

#####  
 Cumulative Dose Summary  
 #####

Time (hr)	EAB		LPZ		Control Room	
	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)
0.000	0.0000E+00	1.0877E-09	0.0000E+00	1.3440E-10	0.0000E+00	4.0510E-16
0.000	5.9636E-12	1.0876E-05	7.3687E-13	1.3439E-06	7.5190E-15	2.7014E-10
0.025	4.1865E-07	5.4834E-03	5.1730E-08	6.7754E-04	2.1484E-07	5.2668E-05
0.300	1.0809E-04	6.5133E-02	1.3356E-05	8.0479E-03	7.6853E-04	1.7948E-02
0.306	1.1159E-04	6.6301E-02	1.3788E-05	8.1923E-03	8.0639E-04	1.8696E-02
0.333	1.2937E-04	7.2119E-02	1.5986E-05	8.9112E-03	1.0057E-03	2.2593E-02
0.600	3.2169E-04	1.2544E-01	3.9749E-05	1.5499E-02	2.3147E-03	4.8789E-02
0.860	5.1302E-04	1.7172E-01	6.3390E-05	2.1218E-02	2.8361E-03	6.0518E-02
1.120	6.8699E-04	2.1261E-01	8.4886E-05	2.6271E-02	3.0727E-03	6.6686E-02
1.380	8.3846E-04	2.4880E-01	1.0360E-04	3.0743E-02	3.1988E-03	7.0449E-02
1.640	9.6841E-04	2.8102E-01	1.1966E-04	3.4723E-02	3.2789E-03	7.3085E-02
1.900	1.0799E-03	3.0991E-01	1.3343E-04	3.8294E-02	3.3375E-03	7.5143E-02
2.000	1.1159E-03	3.2027E-01	1.3820E-04	3.9573E-02	3.3567E-03	7.5838E-02
2.260	1.2096E-03	3.4545E-01	1.4333E-04	4.0989E-02	3.3999E-03	7.7430E-02
2.520	1.2894E-03	3.6846E-01	1.4781E-04	4.2282E-02	3.4356E-03	7.8782E-02
2.780	1.3600E-03	3.8961E-01	1.5178E-04	4.3471E-02	3.4666E-03	7.9976E-02
3.040	1.4231E-03	4.0916E-01	1.5533E-04	4.4570E-02	3.4943E-03	8.1058E-02
3.300	1.4801E-03	4.2731E-01	1.5853E-04	4.5590E-02	3.5196E-03	8.2055E-02
3.560	1.5319E-03	4.4422E-01	1.6144E-04	4.6541E-02	3.5428E-03	8.2982E-02
3.820	1.5793E-03	4.6003E-01	1.6411E-04	4.7429E-02	3.5644E-03	8.3849E-02
4.080	1.6229E-03	4.7484E-01	1.6656E-04	4.8262E-02	3.5845E-03	8.4661E-02
4.340	1.6633E-03	4.8875E-01	1.6883E-04	4.9044E-02	3.6032E-03	8.5425E-02
4.600	1.7007E-03	5.0184E-01	1.7093E-04	4.9780E-02	3.6208E-03	8.6144E-02
4.860	1.7355E-03	5.1417E-01	1.7289E-04	5.0473E-02	3.6372E-03	8.6822E-02
5.120	1.7680E-03	5.2581E-01	1.7471E-04	5.1127E-02	3.6526E-03	8.7460E-02
5.380	1.7982E-03	5.3680E-01	1.7641E-04	5.1745E-02	3.6670E-03	8.8063E-02
5.640	1.8265E-03	5.4719E-01	1.7801E-04	5.2329E-02	3.6805E-03	8.8632E-02
5.900	1.8530E-03	5.5703E-01	1.7949E-04	5.2882E-02	3.6932E-03	8.9170E-02
6.160	1.8778E-03	5.6635E-01	1.8089E-04	5.3406E-02	3.7051E-03	8.9678E-02
6.420	1.9010E-03	5.7518E-01	1.8219E-04	5.3903E-02	3.7162E-03	9.0159E-02
6.680	1.9227E-03	5.8357E-01	1.8341E-04	5.4374E-02	3.7267E-03	9.0614E-02
6.940	1.9431E-03	5.9153E-01	1.8456E-04	5.4822E-02	3.7365E-03	9.1044E-02
7.200	1.9622E-03	5.9909E-01	1.8563E-04	5.5247E-02	3.7457E-03	9.1452E-02
7.460	1.9801E-03	6.0629E-01	1.8664E-04	5.5651E-02	3.7544E-03	9.1839E-02
7.720	1.9970E-03	6.1313E-01	1.8759E-04	5.6036E-02	3.7625E-03	9.2206E-02
7.980	2.0127E-03	6.1965E-01	1.8847E-04	5.6403E-02	3.7701E-03	9.2553E-02
8.000	2.0139E-03	6.2014E-01	1.8854E-04	5.6430E-02	3.7706E-03	9.2579E-02
8.260	2.0139E-03	6.2014E-01	1.8854E-04	5.6430E-02	3.7766E-03	9.2838E-02
8.520	2.0139E-03	6.2015E-01	1.8854E-04	5.6430E-02	3.7800E-03	9.2977E-02
8.780	2.0139E-03	6.2015E-01	1.8854E-04	5.6430E-02	3.7818E-03	9.3049E-02
9.040	2.0139E-03	6.2015E-01	1.8854E-04	5.6431E-02	3.7827E-03	9.3086E-02
9.300	2.0139E-03	6.2015E-01	1.8854E-04	5.6431E-02	3.7832E-03	9.3105E-02
9.560	2.0139E-03	6.2015E-01	1.8854E-04	5.6431E-02	3.7834E-03	9.3115E-02
9.820	2.0139E-03	6.2015E-01	1.8854E-04	5.6431E-02	3.7835E-03	9.3120E-02
10.080	2.0139E-03	6.2015E-01	1.8854E-04	5.6431E-02	3.7836E-03	9.3123E-02
24.000	2.0139E-03	6.2015E-01	1.8854E-04	5.6431E-02	3.7836E-03	9.3126E-02
96.000	2.0139E-03	6.2015E-01	1.8854E-04	5.6431E-02	3.7836E-03	9.3126E-02
720.000	2.0139E-03	6.2015E-01	1.8854E-04	5.6431E-02	3.7836E-03	9.3126E-02

#####  
 Worst Two-Hour Dose  
 (Provided for Dose Location 1)  
 #####

EAB

Time (hr)	Whole Body (rem)	Thyroid (rem)	Skin (rem)	TEDE (rem)
0.0	3.0749E-01	1.1185E-03	6.8545E-01	3.2027E-01

#####  
 30 Day Control Room Skin Dose  
 #####

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room

Time (hr)	Skin (rem)
720.0	3.5149E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Attachment 6 Secondary Side Release DNB Iodine Release Dose

```
#####
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:04:44
#####
#####
File information
#####
```

```
Plant file name      = AST/CRE/pal_CRE_DNB_sec_iodine_db_ast.psf
Inventory file name  = AST/CRE/palisades_loca_db_ast.nif
Scenario file name   = AST/CRE/pal_CRE_DNB_sec_iodine_db_ast.psf
Release file name    = AST/CRE/pal_cre_dnb_sec_iodine_ast.rft
Dose conversion file name = AST/CRE/nai-1101-001rev0.dcf
```

```
#####      #####      #####      # # #      # #####      # # #####
# # #      # # #      # # #      # # #      # # #      # # #      # # #
# # #      # # #      # # #      # # #      # # #      # # #      # # #
#####      #####      #####      # # #      # # #      # # #      # # #
# # #      # # #      # # #      # # #      # # #      # # #      # # #
# # #      # # #      # # #      # # #      # # #      # # #      # # #
# # #      # # #      # # #      # # #      # # #      # # #      # # #
```

```
*RADTRAD-NAI 1.1a(QA)
*18 May 2006 13:04:36
** Palisades CRE Design Basis
** DNB Secondary Release Iodine Dose
**
*Nuclide inventory file
AST/CRE/palisades_loca_db_ast.nif
*Plant power
810.576
*Compartments
4
*Compartment 1:
PCS
3
432976.8
0
0
0
0
*Compartment 2:
Environment
2
2e+20
0
0
0
0
*Compartment 3:
Control Room
1
35923
0
1
0
0
*Compartment 4:
SGs
3
282130
0
0
0
0
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
*Pathways
6
*Pathway 1:
SG Tube Leakage
1
4
2
*Pathway 2:
Control Room Unfiltered Makeup
2
3
2
*Pathway 3:
Control Room Filtered Makeup
2
3
2
*Pathway 4:
Control Room Unfiltered Inleakage
2
3
2
*Pathway 5:
Control Room Exhaust
3
2
2
*Pathway 6:
SRV/ADV Steam Release
4
2
2
*Sources
4
1 1
2 0
3 0
4 0
*dose conversion factors filename
AST/CRE/nai-1101-001rev0.dcf
*release fraction and timing filename
AST/CRE/pal_cre_dnb_sec_iodine_ast.rft
0
1
1
*Iodine
0 0.97 0.03
*Overlying pool
*aerosol model
0
*elemental model
0
*organic model
0
*pH tracking
0
*Compartment detail
*Compartment 1:
1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 2:
1
*spray model
0
0
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
0
*filter model
0
*deposition model
0
0
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Compartment 4:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Pathways:
*Pathway 1
*filter efficiency model
  1
  3
0 5.005 0 0 0
8 0 0 0 0
720 0 0 0 0
*Pathway 2
*filter efficiency model
  1
  4
0 384.2 0 0 0
0.025 660 0 0 0
0.3333 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
  1
  3
0 0 0 0 0
0.3333 10 0 0 0
720 10 0 0 0
*Pathway 5
*filter efficiency model
  1
  4
0 384.2 0 0 0
0.025 660 0 0 0
0.3333 1423.6 0 0 0
720 1423.6 0 0 0
*Pathway 6
*filter efficiency model
  1
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
5
0 58.45 0 0 0
0.305556 26.86 0 0 0
0.5 22.38 0 0 0
8 0 0 0 0
720 0 0 0 0
*x/q tables
4
EAB
2
0 0.000539
720 0.000539
LPZ
6
0 6.66e-05
2 3.03e-05
8 2.04e-05
24 8.67e-06
96 2.54e-06
720 2.54e-06
Control Room Unfiltered
7
0 0.0211
0.305556 0.0165
2 0.0134
8 0.0054
24 0.00403
96 0.00298
720 0.00298
Control Room Filtered
7
0 0.000796
0.305556 0.000736
2 0.000642
8 0.000243
24 0.000175
96 0.000128
720 0.000128
*dose locations
3
*location name, compartment number and x/q table
EAB
2
1
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
LPZ
2
2
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
Control Room
3
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```

0
*br model
  1
  2
0 0.00035
720 0.00035
*of model
  1
  4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
  1
*number of intake combinations
  3
*intake combinations
2 6 3
3 6 4
4 6 3
*time step count
  3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
  1
  1
  1
  0
  1

#####
      RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:04:44
#####

#####
      Plant Description
#####

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth
Plant Power Level = 8.1058E+02 MWth

Number of compartments = 4

Compartment information

Compartment number 1 (Source term fraction = 1.0000E+00)
Name: PCS
Compartment volume = 4.3298E+05 (Cubic feet)
Pathways into and out of compartment 1
  Pathway to compartment number 4: SG Tube Leakage

Compartment number 2
Name: Environment
Pathways into and out of compartment 2
  Pathway to compartment number 3: Control Room Unfiltered Makeup
  Pathway to compartment number 3: Control Room Filtered Makeup
  Pathway to compartment number 3: Control Room Unfiltered Inleakage
  Pathway from compartment number 3: Control Room Exhaust
  Pathway from compartment number 4: SRV/ADV Steam Release

Compartment number 3
Name: Control Room
Compartment volume = 3.5923E+04 (Cubic feet)
Removal devices within compartment:
  Filter(s)
Pathways into and out of compartment 3
  Pathway to compartment number 2: Control Room Exhaust
  Pathway from compartment number 2: Control Room Unfiltered Makeup

```



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Pathway from compartment number 2: Control Room Filtered Makeup  
 Pathway from compartment number 2: Control Room Unfiltered Inleakage

Compartment number 4  
 Name: SGs  
 Compartment volume = 2.8213E+05 (Cubic feet)  
 Pathways into and out of compartment 4  
 Pathway to compartment number 2: SRV/ADV Steam Release  
 Pathway from compartment number 1: SG Tube Leakage

Total number of pathways = 6

#####  
 RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:04:44  
 #####  
 #####  
 Scenario Description  
 #####

Radioactive Decay is enabled  
 Calculation of Daughters is enabled

Iodine fractions  
 Aerosol = 0.0000E+00  
 Elemental = 9.7000E-01  
 Organic = 3.0000E-02

COMPARTMENT DATA

Compartment number 1: PCS  
 Compartment number 2: Environment  
 Compartment number 3: Control Room

Compartment Filter Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Compartment number 4: SGs

PATHWAY DATA

Pathway number 1: SG Tube Leakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	5.0050E+00	0.0000E+00	0.0000E+00	0.0000E+00
8.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 6: SRV/ADV Steam Release

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	5.8450E+01	0.0000E+00	0.0000E+00	0.0000E+00
3.0556E-01	2.6860E+01	0.0000E+00	0.0000E+00	0.0000E+00
5.0000E-01	2.2380E+01	0.0000E+00	0.0000E+00	0.0000E+00
8.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

X/Q DATA

X/Q table 1: EAB

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	5.3900E-04
7.2000E+02	5.3900E-04

X/Q table 2: LPZ

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

X/Q table 3: Control Room Unfiltered

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	2.1100E-02
3.0556E-01	1.6500E-02
2.0000E+00	1.3400E-02
8.0000E+00	5.4000E-03
2.4000E+01	4.0300E-03
9.6000E+01	2.9800E-03
7.2000E+02	2.9800E-03

X/Q table 4: Control Room Filtered

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	7.9600E-04
3.0556E-01	7.3600E-04
2.0000E+00	6.4200E-04
8.0000E+00	2.4300E-04
2.4000E+01	1.7500E-04

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

9.6000E+01 1.2800E-04
7.2000E+02 1.2800E-04

LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

Location Breathing Rate Data

Time (hr) Breathing Rate (m^3 \* sec^-1)
0.0000E+00 3.5000E-04
8.0000E+00 1.8000E-04
2.4000E+01 2.3000E-04
7.2000E+02 2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

Location Breathing Rate Data

Time (hr) Breathing Rate (m^3 \* sec^-1)
0.0000E+00 3.5000E-04
8.0000E+00 1.8000E-04
2.4000E+01 2.3000E-04
7.2000E+02 2.3000E-04

Location Control Room is in compartment 3

Inleakage X/Q Table Assignments

Inleakage Path Source Path X/Q Table
2 6 3
3 6 4
4 6 3

Location Breathing Rate Data

Time (hr) Breathing Rate (m^3 \* sec^-1)
0.0000E+00 3.5000E-04
7.2000E+02 3.5000E-04

Location Occupancy Factor Data

Time (hr) Occupancy Factor
0.0000E+00 1.0000E+00
2.4000E+01 6.0000E-01
9.6000E+01 4.0000E-01
7.2000E+02 4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time Time step
0.0000E+00 1.0000E-06
1.0000E-03 2.0000E-02
7.2000E+02 2.0000E-02

#####
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:04:44
#####

#### # # ##### ##### # # #####
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
#### ##### # # ##### #

#####
Dose, Detailed Model and Detailed Inventory Output
#####

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Detailed model information at time (H) = 0.0001

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0001	7.2205E-11	9.2319E-09	1.2160E-10	4.9249E-10
Delta dose (rem)	7.2205E-11	9.2319E-09	1.2160E-10	4.9249E-10
Accumulated dose (rem)	7.2205E-11	9.2319E-09	1.2160E-10	4.9249E-10

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0001	8.9218E-12	1.1407E-09	1.5025E-11	6.0853E-11
Delta dose (rem)	8.9218E-12	1.1407E-09	1.5025E-11	6.0853E-11
Accumulated dose (rem)	8.9218E-12	1.1407E-09	1.5025E-11	6.0853E-11

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0001	1.3447E-15	5.8205E-12	7.6665E-14	2.6632E-13
Delta dose (rem)	1.3447E-15	5.8205E-12	7.6665E-14	2.6632E-13
Accumulated dose (rem)	1.3447E-15	5.8205E-12	7.6665E-14	2.6632E-13

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.0001				
Rb-86	7.0496E+03	8.6639E-05	6.0669E+20	2.6083E+14
Sr-89	7.1647E-02	2.4661E-09	1.6687E+16	2.6509E+09
I-131	2.2440E+06	1.8100E-02	8.3209E+22	8.3028E+16
I-132	3.2027E+06	3.1027E-04	1.4155E+21	1.1850E+17
I-133	4.3842E+06	3.8702E-03	1.7524E+22	1.6222E+17
I-134	4.8038E+06	1.8008E-04	8.0929E+20	1.7774E+17
I-135	4.1143E+06	1.1715E-03	5.2261E+21	1.5223E+17
Xe-133	1.1838E+00	6.3243E-09	2.8636E+16	4.3800E+10
Xe-135	1.3404E+01	5.2487E-09	2.3414E+16	4.9594E+11
Cs-134	7.3303E+05	5.6656E-01	2.5462E+24	2.7122E+16
Cs-136	2.1134E+05	2.8836E-03	1.2769E+22	7.8197E+15
Cs-137	3.9584E+05	4.5509E+00	2.0004E+25	1.4646E+16
I-130	1.1224E+05	5.7551E-05	2.6660E+20	4.1530E+15
Kr-83m	5.2208E+00	2.5304E-10	1.8360E+15	1.9317E+11
Xe-131m	3.0528E-03	3.6447E-11	1.6755E+14	1.1296E+08
Xe-133m	8.4752E-02	1.8888E-10	8.5524E+14	3.1358E+09
Xe-135m	8.7024E+01	9.5534E-10	4.2616E+15	3.2199E+12
Cs-138	4.8217E+06	1.1395E-04	4.9726E+20	1.7840E+17
Cs-134m	1.7704E+05	2.1954E-05	9.8664E+19	6.5507E+15
Rb-88	1.9318E+06	1.6093E-05	1.1013E+20	7.1478E+16
Rb-89	2.4805E+06	1.7847E-05	1.2076E+20	9.1780E+16
Ba-137m	3.0802E+02	5.7273E-10	2.5176E+15	1.1397E+13
Br-82	1.5840E+04	1.4631E-05	1.0745E+20	5.8607E+14
Br-83	2.7294E+05	1.7277E-05	1.2536E+20	1.0099E+16
Br-84	4.7705E+05	6.7771E-06	4.8587E+19	1.7651E+16

PCS Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.0001			
Noble gases (atoms)	5.9170E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.0547E+23	0.0000E+00	0.0000E+00
Organic I (atoms)	3.2620E+21	0.0000E+00	0.0000E+00
Aerosols (kg)	5.1206E+00	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Recirculating Filter
0.0001		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	Pathway Filter
0.0001	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Aerosols (kg) 0.0000E+00

## Environment Integral Nuclide Release:

Time (h) =		Ci	kg	Atoms	Bq
Rb-86	0.0001	1.0091E-10	1.2401E-18	8.6841E+06	3.7336E+00
I-131		3.2121E-08	2.5909E-16	1.1911E+09	1.1885E+03
I-132		4.5843E-08	4.4412E-18	2.0262E+07	1.6962E+03
I-133		6.2756E-08	5.5398E-17	2.5084E+08	2.3220E+03
I-134		6.8761E-08	2.5776E-18	1.1584E+07	2.5442E+03
I-135		5.8892E-08	1.6770E-17	7.4806E+07	2.1790E+03
Cs-134		1.0493E-08	8.1097E-15	3.6446E+10	3.8822E+02
Cs-136		3.0252E-09	4.1276E-17	1.8277E+08	1.1193E+02
Cs-137		5.6661E-09	6.5141E-14	2.8634E+11	2.0964E+02
I-130		1.6067E-09	8.2379E-19	3.8161E+06	5.9447E+01
Cs-138		6.9016E-08	1.6310E-18	7.1176E+06	2.5536E+03

## Environment Transport Group Inventory:

Time (h) =		Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	0.0001	3.3540E+01	9.3165E+03	1.2662E+03
Elemental I (atoms)		4.4839E+07	1.2455E+10	1.5097E+09
Organic I (atoms)		1.3868E+06	3.8522E+08	4.6692E+07
Aerosols (kg)		2.1770E-15	6.0471E-13	7.3296E-14

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =		Pathway Filter
Noble gases (atoms)	0.0001	0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) =		Pathway Filter
Noble gases (atoms)	0.0001	0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =		Pathway Filter
Noble gases (atoms)	0.0001	0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) =		Pathway Filter
Noble gases (atoms)	0.0001	0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

Time (h) =		Pathway Filter
Noble gases (atoms)	0.0001	0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) =	0.0001	Ci	kg	Atoms	Bq
I-131		1.2336E-10	9.9504E-19	4.5743E+06	4.5643E+00
I-133		2.4102E-10	2.1276E-19	9.6336E+05	8.9176E+00
I-135		2.2618E-10	6.4404E-20	2.8730E+05	8.3686E+00
Cs-134		4.0297E-11	3.1146E-17	1.3997E+08	1.4910E+00
Cs-136		1.1618E-11	1.5852E-19	7.0194E+05	4.2988E-01
Cs-137		2.1761E-11	2.5018E-16	1.0997E+09	8.0515E-01

## Control Room Transport Group Inventory:

Time (h) =	0.0001	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		4.8629E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)		5.7980E+06	0.0000E+00	0.0000E+00
Organic I (atoms)		1.7932E+05	0.0000E+00	0.0000E+00
Aerosols (kg)		2.8149E-16	0.0000E+00	0.0000E+00

Time (h) =	0.0001	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## SGs Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0001	Ci	kg	Atoms	Bq
Rb-86		2.4447E-04	3.0045E-12	2.1039E+13	9.0454E+06
Sr-89		3.3046E-09	1.1375E-16	7.6966E+08	1.2227E+02
I-131		7.7819E-02	6.2770E-10	2.8856E+15	2.8793E+09
I-132		1.1106E-01	1.0760E-11	4.9088E+13	4.1093E+09
I-133		1.5204E-01	1.3421E-10	6.0771E+14	5.6254E+09
I-134		1.6659E-01	6.2447E-12	2.8065E+13	6.1638E+09
I-135		1.4268E-01	4.0628E-11	1.8123E+14	5.2791E+09
Xe-133		5.4599E-08	2.9169E-16	1.3208E+09	2.0202E+03
Xe-135		6.1822E-07	2.4208E-16	1.0799E+09	2.2874E+04
Cs-134		2.5420E-02	1.9647E-08	8.8298E+16	9.4055E+08

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-136	7.3291E-03	1.0000E-10	4.4280E+14	2.7118E+08
Cs-137	1.3727E-02	1.5782E-07	6.9372E+17	5.0791E+08
I-130	3.8925E-03	1.9958E-12	9.2453E+12	1.4402E+08
Kr-83m	2.4080E-07	1.1671E-17	8.4680E+07	8.9094E+03
Xe-131m	1.4080E-10	1.6810E-18	7.7278E+06	5.2098E+00
Xe-133m	3.9090E-09	8.7117E-18	3.9446E+07	1.4463E+02
Xe-135m	4.0137E-06	4.4062E-17	1.9655E+08	1.4851E+05
Cs-138	1.6721E-01	3.9515E-12	1.7244E+13	6.1867E+09
Cs-134m	6.1397E-03	7.6133E-13	3.4215E+12	2.2717E+08
Rb-88	6.6991E-02	5.5808E-13	3.8191E+12	2.4787E+09
Rb-89	8.6021E-02	6.1889E-13	4.1877E+12	3.1828E+09
Ba-137m	1.4205E-05	2.6414E-17	1.1611E+08	5.2560E+05
Br-82	5.4930E-04	5.0737E-13	3.7261E+12	2.0324E+07
Br-83	9.4653E-03	5.9915E-13	4.3472E+12	3.5021E+08
Br-84	1.6543E-02	2.3502E-13	1.6849E+12	6.1210E+08

SGs Transport Group Inventory:

Time (h) =	0.0001	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		2.7291E+09	0.0000E+00	0.0000E+00
Elemental I (atoms)		3.6575E+15	0.0000E+00	0.0000E+00
Organic I (atoms)		1.1312E+14	0.0000E+00	0.0000E+00
Aerosols (kg)		1.7757E-07	0.0000E+00	0.0000E+00

Time (h) =	0.0001	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Detailed model information at time (H) = 0.0250

EAB Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.3530E-05	1.7408E-03	2.2760E-05	9.2778E-05
Accumulated dose (rem)		1.3531E-05	1.7409E-03	2.2760E-05	9.2778E-05

LPZ Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.6719E-06	2.1510E-04	2.8123E-06	1.1464E-05
Accumulated dose (rem)		1.6719E-06	2.1510E-04	2.8123E-06	1.1464E-05

Control Room Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.0214E-07	4.4515E-04	5.8156E-06	2.0366E-05
Accumulated dose (rem)		1.0214E-07	4.4515E-04	5.8156E-06	2.0366E-05

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
------------	--------	----	----	-------	----

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Rb-86	7.1197E+03	8.7500E-05	6.1272E+20	2.6343E+14
Sr-89	3.4560E+01	1.1896E-06	8.0492E+18	1.2787E+12
I-131	2.2662E+06	1.8280E-02	8.4032E+22	8.3849E+16
I-132	3.2105E+06	3.1103E-04	1.4190E+21	1.1879E+17
I-133	4.4243E+06	3.9056E-03	1.7684E+22	1.6370E+17
I-134	4.7572E+06	1.7833E-04	8.0143E+20	1.7602E+17
I-135	4.1445E+06	1.1802E-03	5.2645E+21	1.5335E+17
Xe-133	5.9044E+02	3.1544E-06	1.4283E+19	2.1846E+13
Xe-135	6.6926E+03	2.6207E-06	1.1691E+19	2.4763E+14
Cs-134	7.4034E+05	5.7221E-01	2.5716E+24	2.7393E+16
Cs-136	2.1344E+05	2.9122E-03	1.2896E+22	7.8973E+15
Cs-137	3.9979E+05	4.5963E+00	2.0204E+25	1.4792E+16
I-130	1.1321E+05	5.8045E-05	2.6889E+20	4.1887E+15
Kr-83m	2.5911E+03	1.2559E-07	9.1121E+17	9.5871E+13
Xe-131m	1.5233E+00	1.8186E-08	8.3601E+16	5.6361E+10
Xe-133m	4.2270E+01	9.4205E-08	4.2655E+17	1.5640E+12
Xe-135m	4.2819E+04	4.7006E-07	2.0969E+18	1.5843E+15
Cs-138	4.7157E+06	1.1145E-04	4.8633E+20	1.7448E+17
Cs-134m	1.7775E+05	2.2042E-05	9.9058E+19	6.5768E+15
Rb-88	1.8409E+06	1.5336E-05	1.0495E+20	6.8111E+16
Rb-89	2.3403E+06	1.6838E-05	1.1393E+20	8.6591E+16
Ba-137m	1.4269E+05	2.6532E-07	1.1663E+18	5.2795E+15
Br-82	1.5990E+04	1.4769E-05	1.0847E+20	5.9163E+14
Br-83	2.7368E+05	1.7324E-05	1.2570E+20	1.0126E+16
Br-84	4.6637E+05	6.6255E-06	4.7499E+19	1.7256E+16

PCS Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0250			
Noble gases (atoms)	2.9492E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.0646E+23	0.0000E+00	0.0000E+00
Organic I (atoms)	3.2926E+21	0.0000E+00	0.0000E+00
Aerosols (kg)	5.1717E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0250		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 0.0250	Ci	kg	Atoms	Bq
Rb-86	1.9030E-05	2.3388E-13	1.6377E+12	7.0411E+05
Sr-89	9.2374E-08	3.1796E-15	2.1514E+10	3.4178E+03
I-131	6.0572E-03	4.8859E-11	2.2461E+14	2.2412E+08
I-132	8.5811E-03	8.3133E-13	3.7927E+12	3.1750E+08
I-133	1.1826E-02	1.0439E-11	4.7268E+13	4.3755E+08
I-134	1.2715E-02	4.7665E-13	2.1421E+12	4.7047E+08
I-135	1.1078E-02	3.1544E-12	1.4071E+13	4.0988E+08
Xe-133	1.5782E-06	8.4312E-15	3.8176E+10	5.8392E+04
Xe-135	1.7889E-05	7.0049E-15	3.1248E+10	6.6188E+05
Cs-134	1.9788E-03	1.5294E-09	6.8735E+15	7.3217E+07
Cs-136	5.7050E-04	7.7840E-12	3.4468E+13	2.1108E+07
Cs-137	1.0686E-03	1.2285E-08	5.4002E+16	3.9538E+07
I-130	3.0259E-04	1.5515E-13	7.1870E+11	1.1196E+07
Kr-83m	6.9257E-06	3.3568E-16	2.4355E+09	2.5625E+05
Xe-131m	4.0715E-09	4.8608E-17	2.2345E+08	1.5064E+02
Xe-133m	1.1298E-07	2.5180E-16	1.1401E+09	4.1804E+03
Xe-135m	1.1445E-04	1.2564E-15	5.6046E+09	4.2346E+06
Cs-138	1.2604E-02	2.9788E-13	1.2999E+12	4.6637E+08
Cs-134m	4.7510E-04	5.8914E-14	2.6477E+11	1.7579E+07



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Rb-88	4.9203E-03	4.0990E-14	2.8051E+11	1.8205E+08
Rb-89	6.2553E-03	4.5005E-14	3.0452E+11	2.3144E+08
Ba-137m	3.8139E-04	7.0916E-16	3.1173E+09	1.4111E+07
Br-82	4.2739E-05	3.9477E-14	2.8992E+11	1.5813E+06
Br-83	7.3152E-04	4.6305E-14	3.3597E+11	2.7066E+07
Br-84	1.2465E-03	1.7709E-14	1.2696E+11	4.6122E+07

## Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) =	0.0250	Release	Rate/s
Noble gases (atoms)	2.8428E+10	4.1561E+08	7.8827E+10
Elemental I (atoms)	1.0262E+14	1.5003E+12	2.8455E+14
Organic I (atoms)	3.1738E+12	4.6400E+10	8.8005E+12
Aerosols (kg)	4.9851E-09	7.2882E-11	1.3823E-08

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.0250
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.0250
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	0.0250
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	0.0250
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) =	0.0250
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Rb-86		7.2696E-08	8.9343E-16	6.2562E+09	2.6898E+03
Sr-89		3.5288E-10	1.2146E-17	8.2187E+07	1.3056E+01
I-131		2.3139E-05	1.8664E-13	8.5801E+11	8.5615E+05
I-132		3.2781E-05	3.1758E-15	1.4489E+10	1.2129E+06
I-133		4.5175E-05	3.9879E-14	1.8057E+11	1.6715E+06
I-134		4.8574E-05	1.8208E-15	8.1831E+09	1.7972E+06
I-135		4.2318E-05	1.2050E-14	5.3754E+10	1.5658E+06
Xe-133		6.0288E-09	3.2208E-17	1.4584E+08	2.2306E+02
Xe-135		6.8336E-08	2.6759E-17	1.1937E+08	2.5284E+03

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-134	7.5593E-06	5.8426E-12	2.6257E+13	2.7970E+05
Cs-136	2.1794E-06	2.9736E-14	1.3167E+11	8.0636E+04
Cs-137	4.0821E-06	4.6931E-11	2.0629E+14	1.5104E+05
I-130	1.1559E-06	5.9267E-16	2.7455E+09	4.2769E+04
Kr-83m	2.6457E-08	1.2823E-18	9.3040E+06	9.7890E+02
Xe-131m	1.5553E-11	1.8569E-19	8.5362E+05	5.7548E-01
Xe-133m	4.3161E-10	9.6189E-19	4.3554E+06	1.5969E+01
Xe-135m	4.3721E-07	4.7996E-18	2.1410E+07	1.6177E+04
Cs-138	4.8150E-05	1.1379E-15	4.9657E+09	1.7816E+06
Cs-134m	1.8149E-06	2.2506E-16	1.0114E+09	6.7153E+04
Rb-88	1.8796E-05	1.5658E-16	1.0716E+09	6.9546E+05
Rb-89	2.3896E-05	1.7192E-16	1.1633E+09	8.8414E+05
Ba-137m	1.4569E-06	2.7091E-18	1.1908E+07	5.3906E+04
Br-82	1.6327E-07	1.5080E-16	1.1075E+09	6.0409E+03
Br-83	2.7945E-06	1.7689E-16	1.2834E+09	1.0340E+05
Br-84	4.7619E-06	6.7650E-17	4.8499E+08	1.7619E+05

Control Room Transport Group Inventory:

Time (h) =	0.0250	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		3.0113E+08	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.0870E+12	0.0000E+00	0.0000E+00
Organic I (atoms)		3.3619E+10	0.0000E+00	0.0000E+00
Aerosols (kg)		5.2806E-11	0.0000E+00	0.0000E+00

Time (h) =	0.0250	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	0.0250	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	0.0250	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	0.0250	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) =	0.0250	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Rb-86		1.2318E-01	1.5139E-09	1.0601E+16	4.5578E+09

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Sr-89	5.9794E-04	2.0582E-11	1.3926E+14	2.2124E+07
I-131	3.9209E+01	3.1627E-07	1.4539E+18	1.4507E+12
I-132	5.5546E+01	5.3813E-09	2.4551E+16	2.0552E+12
I-133	7.6549E+01	6.7574E-08	3.0597E+17	2.8323E+12
I-134	8.2308E+01	3.0854E-09	1.3866E+16	3.0454E+12
I-135	7.1708E+01	2.0419E-08	9.1085E+16	2.6532E+12
Xe-133	1.0216E-02	5.4576E-11	2.4712E+14	3.7798E+08
Xe-135	1.1579E-01	4.5343E-11	2.0227E+14	4.2844E+09
Cs-134	1.2809E+01	9.9002E-06	4.4493E+19	4.7394E+11
Cs-136	3.6929E+00	5.0387E-08	2.2312E+17	1.3664E+11
Cs-137	6.9171E+00	7.9524E-05	3.4956E+20	2.5593E+11
I-130	1.9587E+00	1.0043E-09	4.6522E+15	7.2471E+10
Kr-83m	4.4831E-02	2.1729E-12	1.5765E+13	1.6587E+09
Xe-131m	2.6355E-05	3.1465E-13	1.4464E+12	9.7514E+05
Xe-133m	7.3135E-04	1.6299E-12	7.3801E+12	2.7060E+07
Xe-135m	7.4084E-01	8.1329E-12	3.6279E+13	2.7411E+10
Cs-138	8.1590E+01	1.9282E-09	8.4144E+15	3.0188E+12
Cs-134m	3.0754E+00	3.8136E-10	1.7139E+15	1.1379E+11
Rb-88	3.1850E+01	2.6533E-10	1.8157E+15	1.1784E+12
Rb-89	4.0491E+01	2.9132E-10	1.9712E+15	1.4982E+12
Ba-137m	2.4688E+00	4.5905E-12	2.0178E+13	9.1344E+10
Br-82	2.7665E-01	2.5554E-10	1.8767E+15	1.0236E+10
Br-83	4.7352E+00	2.9974E-10	2.1748E+15	1.7520E+11
Br-84	8.0690E+00	1.1463E-10	8.2182E+14	2.9855E+11

SGs Transport Group Inventory:

Time (h) =	0.0250	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		5.1026E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.8419E+18	0.0000E+00	0.0000E+00
Organic I (atoms)		5.6967E+16	0.0000E+00	0.0000E+00
Aerosols (kg)		8.9479E-05	0.0000E+00	0.0000E+00

		Deposition Recirculating	
Time (h) =	0.0250	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

		Pathway
Time (h) =	0.0250	Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

		Pathway
Time (h) =	0.0250	Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Detailed model information at time (H) = 0.3056

EAB Doses:

Time (h) =	0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.7291E-03	2.5759E-01	2.8407E-03	1.3443E-02
Accumulated dose (rem)		1.7426E-03	2.5933E-01	2.8635E-03	1.3535E-02

LPZ Doses:

Time (h) =	0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.1365E-04	3.1828E-02	3.5101E-04	1.6610E-03
Accumulated dose (rem)		2.1532E-04	3.2043E-02	3.5382E-04	1.6725E-03

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Control Room Doses:

Time (h) =	0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.0431E-04	1.0496E+00	1.1330E-02	4.7929E-02
Accumulated dose (rem)		2.0441E-04	1.0501E+00	1.1335E-02	4.7949E-02

## PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.3056	Ci	kg	Atoms	Bq
Rb-86		7.1152E+03	8.7445E-05	6.1233E+20	2.6326E+14
Sr-89		2.9662E+02	1.0210E-05	6.9084E+19	1.0975E+13
I-131		2.2635E+06	1.8258E-02	8.3931E+22	8.3749E+16
I-132		2.9496E+06	2.8575E-04	1.3037E+21	1.0914E+17
I-133		4.3823E+06	3.8685E-03	1.7516E+22	1.6215E+17
I-134		3.8101E+06	1.4282E-04	6.4187E+20	1.4097E+17
I-135		4.0236E+06	1.1457E-03	5.1109E+21	1.4887E+17
Xe-133		7.1896E+03	3.8410E-05	1.7392E+20	2.6602E+14
Xe-135		8.4138E+04	3.2947E-05	1.4697E+20	3.1131E+15
Cs-134		7.4019E+05	5.7210E-01	2.5711E+24	2.7387E+16
Cs-136		2.1327E+05	2.9099E-03	1.2885E+22	7.8909E+15
Cs-137		3.9972E+05	4.5954E+00	2.0200E+25	1.4789E+16
I-130		1.1142E+05	5.7127E-05	2.6464E+20	4.1225E+15
Kr-83m		2.8902E+04	1.4008E-06	1.0164E+19	1.0694E+15
Xe-131m		1.8633E+01	2.2245E-07	1.0226E+18	6.8941E+11
Xe-133m		5.1414E+02	1.1458E-06	5.1882E+18	1.9023E+13
Xe-135m		3.6393E+05	3.9952E-06	1.7822E+19	1.3466E+16
Cs-138		3.2817E+06	7.7554E-05	3.3844E+20	1.2142E+17
Cs-134m		1.6619E+05	2.0608E-05	9.2615E+19	6.1490E+15
Rb-88		9.5555E+05	7.9603E-06	5.4475E+19	3.5355E+16
Rb-89		1.0859E+06	7.8130E-06	5.2866E+19	4.0180E+16
Ba-137m		4.3582E+05	8.1038E-07	3.5622E+18	1.6125E+16
Br-82		1.5899E+04	1.4685E-05	1.0785E+20	5.8826E+14
Br-83		2.5225E+05	1.5967E-05	1.1585E+20	9.3332E+15
Br-84		3.2307E+05	4.5897E-06	3.2904E+19	1.1954E+16

## PCS Transport Group Inventory:

Time (h) =	0.3056	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		3.5509E+20	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.0575E+23	0.0000E+00	0.0000E+00
Organic I (atoms)		3.2708E+21	0.0000E+00	0.0000E+00
Aerosols (kg)		5.1706E+00	0.0000E+00	0.0000E+00

Time (h) =	0.3056	Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

## SG Tube Leakage Transport Group Inventory:

Time (h) =	0.3056	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Environment Integral Nuclide Release:

Time (h) =	0.3056	Ci	kg	Atoms	Bq
Rb-86		2.8427E-03	3.4936E-11	2.4464E+14	1.0518E+08
Sr-89		1.1850E-04	4.0790E-12	2.7600E+13	4.3846E+06
I-131		9.0430E-01	7.2942E-09	3.3532E+16	3.3459E+10
I-132		1.1784E+00	1.1416E-10	5.2084E+14	4.3601E+10
I-133		1.7508E+00	1.5455E-09	6.9981E+15	6.4780E+10
I-134		1.5222E+00	5.7060E-11	2.5644E+14	5.6321E+10
I-135		1.6075E+00	4.5774E-10	2.0419E+15	5.9478E+10
Xe-133		2.8724E-03	1.5345E-11	6.9483E+13	1.0628E+08
Xe-135		3.3615E-02	1.3163E-11	5.8718E+13	1.2437E+09
Cs-134		2.9572E-01	2.2856E-07	1.0272E+18	1.0942E+10

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-136	8.5204E-02	1.1625E-09	5.1478E+15	3.1526E+09
Cs-137	1.5969E-01	1.8359E-06	8.0703E+18	5.9087E+09
I-130	4.4513E-02	2.2823E-11	1.0573E+14	1.6470E+09
Kr-83m	1.1547E-02	5.5965E-13	4.0606E+12	4.2723E+08
Xe-131m	7.4441E-06	8.8873E-14	4.0855E+11	2.7543E+05
Xe-133m	2.0541E-04	4.5778E-13	2.0728E+12	7.6000E+06
Xe-135m	1.4540E-01	1.5962E-12	7.1202E+12	5.3797E+09
Cs-138	1.3111E+00	3.0984E-11	1.3521E+14	4.8510E+10
Cs-134m	6.6396E-02	8.2333E-12	3.7001E+13	2.4567E+09
Rb-88	3.8176E-01	3.1803E-12	2.1764E+13	1.4125E+10
Rb-89	4.3385E-01	3.1214E-12	2.1121E+13	1.6053E+10
Ba-137m	1.7412E-01	3.2376E-13	1.4232E+12	6.4424E+09
Br-82	6.3519E-03	5.8671E-12	4.3088E+13	2.3502E+08
Br-83	1.0078E-01	6.3792E-12	4.6285E+13	3.7288E+09
Br-84	1.2907E-01	1.8337E-12	1.3146E+13	4.7757E+09

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) =	0.3056	Release	Rate/s
Noble gases (atoms)	5.1112E+12	7.0988E+10	1.4186E+14
Elemental I (atoms)	1.5222E+15	2.1142E+13	4.2251E+16
Organic I (atoms)	4.7080E+13	6.5389E+11	1.3067E+15
Aerosols (kg)	7.4427E-08	1.0337E-09	2.0657E-06

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.3056
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.3056
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	0.3056
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	0.3056
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) =	0.3056
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.3056	Ci	kg	Atoms	Bq
------------	--------	----	----	-------	----

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Rb-86	1.6811E-05	2.0661E-13	1.4468E+12	6.2202E+05
Sr-89	7.0082E-07	2.4123E-14	1.6323E+11	2.5931E+04
I-131	5.3480E-03	4.3138E-11	1.9831E+14	1.9788E+08
I-132	6.9691E-03	6.7516E-13	3.0802E+12	2.5786E+08
I-133	1.0354E-02	9.1403E-12	4.1387E+13	3.8311E+08
I-134	9.0022E-03	3.3745E-13	1.5166E+12	3.3308E+08
I-135	9.5067E-03	2.7070E-12	1.2076E+13	3.5175E+08
Xe-133	1.6987E-05	9.0752E-14	4.1092E+11	6.2853E+05
Xe-135	1.9880E-04	7.7846E-14	3.4726E+11	7.3555E+06
Cs-134	1.7489E-03	1.3517E-09	6.0748E+15	6.4709E+07
Cs-136	5.0390E-04	6.8753E-12	3.0444E+13	1.8644E+07
Cs-137	9.4442E-04	1.0858E-08	4.7727E+16	3.4944E+07
I-130	2.6325E-04	1.3498E-13	6.2527E+11	9.7403E+06
Kr-83m	6.8287E-05	3.3097E-15	2.4014E+10	2.5266E+06
Xe-131m	4.4024E-08	5.2559E-16	2.4162E+09	1.6289E+03
Xe-133m	1.2148E-06	2.7073E-15	1.2258E+10	4.4947E+04
Xe-135m	8.5988E-04	9.4396E-15	4.2109E+10	3.1816E+07
Cs-138	7.7537E-03	1.8324E-13	7.9964E+11	2.8689E+08
Cs-134m	3.9266E-04	4.8691E-14	2.1883E+11	1.4529E+07
Rb-88	2.2577E-03	1.8808E-14	1.2871E+11	8.3535E+07
Rb-89	2.5658E-03	1.8460E-14	1.2491E+11	9.4935E+07
Ba-137m	1.0297E-03	1.9147E-15	8.4165E+09	3.8100E+07
Br-82	3.7565E-05	3.4698E-14	2.5482E+11	1.3899E+06
Br-83	5.9600E-04	3.7727E-14	2.7373E+11	2.2052E+07
Br-84	7.6333E-04	1.0844E-14	7.7744E+10	2.8243E+07

Control Room Transport Group Inventory:

Time (h) =	0.3056	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		8.3897E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)		2.4987E+14	0.0000E+00	0.0000E+00
Organic I (atoms)		7.7279E+12	0.0000E+00	0.0000E+00
Aerosols (kg)		1.2217E-08	0.0000E+00	0.0000E+00

Time (h) =	0.3056	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	0.3056	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	0.3056	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	0.3056	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) =	0.3056	Pathway Filter
------------	--------	----------------

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3056				
Rb-86	1.5049E+00	1.8496E-08	1.2952E+17	5.5683E+10
Sr-89	6.2737E-02	2.1595E-09	1.4612E+16	2.3213E+09
I-131	4.7875E+02	3.8617E-06	1.7752E+19	1.7714E+13
I-132	6.2387E+02	6.0440E-08	2.7574E+17	2.3083E+13
I-133	9.2690E+02	8.1823E-07	3.7049E+18	3.4295E+13
I-134	8.0586E+02	3.0209E-08	1.3576E+17	2.9817E+13
I-135	8.5103E+02	2.4233E-07	1.0810E+18	3.1488E+13
Xe-133	1.5207E+00	8.1241E-09	3.6785E+16	5.6265E+10
Xe-135	1.7796E+01	6.9687E-09	3.1086E+16	6.5846E+11
Cs-134	1.5656E+02	1.2100E-04	5.4381E+20	5.7927E+12
Cs-136	4.5108E+01	6.1547E-07	2.7253E+18	1.6690E+12
Cs-137	8.4544E+01	9.7197E-04	4.2725E+21	3.1281E+12
I-130	2.3566E+01	1.2083E-08	5.5974E+16	8.7194E+11
Kr-83m	6.1130E+00	2.9629E-10	2.1497E+15	2.2618E+11
Xe-131m	3.9410E-03	4.7050E-11	2.1629E+14	1.4582E+08
Xe-133m	1.0875E-01	2.4235E-10	1.0974E+15	4.0236E+09
Xe-135m	7.6976E+01	8.4503E-10	3.7695E+15	2.8481E+12
Cs-138	6.9411E+02	1.6404E-08	7.1583E+16	2.5682E+13
Cs-134m	3.5151E+01	4.3588E-09	1.9589E+16	1.3006E+12
Rb-88	2.0211E+02	1.6837E-09	1.1522E+16	7.4780E+12
Rb-89	2.2969E+02	1.6525E-09	1.1182E+16	8.4985E+12
Ba-137m	9.2181E+01	1.7140E-10	7.5344E+14	3.4107E+12
Br-82	3.3628E+00	3.1061E-09	2.2812E+16	1.2442E+11
Br-83	5.3353E+01	3.3773E-09	2.4504E+16	1.9741E+12
Br-84	6.8333E+01	9.7076E-10	6.9596E+15	2.5283E+12

SGs Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3056			
Noble gases (atoms)	7.5104E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.2368E+19	0.0000E+00	0.0000E+00
Organic I (atoms)	6.9180E+17	0.0000E+00	0.0000E+00
Aerosols (kg)	1.0936E-03	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Recirculating Filter
0.3056		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	Pathway Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) =	Pathway Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3333

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.3333				

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Delta dose (rem)	1.3899E-04	2.2632E-02	2.2524E-04	1.1676E-03
Accumulated dose (rem)	1.8816E-03	2.8196E-01	3.0887E-03	1.4703E-02

LPZ Doses:

Time (h) =	0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.7173E-05	2.7964E-03	2.7831E-05	1.4427E-04
Accumulated dose (rem)		2.3249E-04	3.4840E-02	3.8165E-04	1.8167E-03

Control Room Doses:

Time (h) =	0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		5.1703E-05	2.8500E-01	2.8366E-03	1.3005E-02
Accumulated dose (rem)		2.5611E-04	1.3351E+00	1.4172E-02	6.0955E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.3333	Ci	kg	Atoms	Bq
Rb-86		7.1148E+03	8.7440E-05	6.1230E+20	2.6325E+14
Sr-89		3.1320E+02	1.0780E-05	7.2946E+19	1.1588E+13
I-131		2.2632E+06	1.8255E-02	8.3921E+22	8.3739E+16
I-132		2.9250E+06	2.8337E-04	1.2928E+21	1.0822E+17
I-133		4.3782E+06	3.8649E-03	1.7500E+22	1.6199E+17
I-134		3.7273E+06	1.3972E-04	6.2793E+20	1.3791E+17
I-135		4.0118E+06	1.1424E-03	5.0959E+21	1.4844E+17
Xe-133		7.8382E+03	4.1875E-05	1.8961E+20	2.9001E+14
Xe-135		9.1911E+04	3.5991E-05	1.6055E+20	3.4007E+15
Cs-134		7.4018E+05	5.7208E-01	2.5710E+24	2.7387E+16
Cs-136		2.1325E+05	2.9096E-03	1.2884E+22	7.8903E+15
Cs-137		3.9971E+05	4.5953E+00	2.0200E+25	1.4789E+16
I-130		1.1124E+05	5.7038E-05	2.6422E+20	4.1160E+15
Kr-83m		3.1232E+04	1.5138E-06	1.0983E+19	1.1556E+15
Xe-131m		2.0323E+01	2.4263E-07	1.1154E+18	7.5194E+11
Xe-133m		5.6045E+02	1.2490E-06	5.6556E+18	2.0737E+13
Xe-135m		3.8330E+05	4.2078E-06	1.8770E+19	1.4182E+16
Cs-138		3.1661E+06	7.4823E-05	3.2652E+20	1.1715E+17
Cs-134m		1.6509E+05	2.0471E-05	9.2001E+19	6.1083E+15
Rb-88		8.9555E+05	7.4605E-06	5.1055E+19	3.3135E+16
Rb-89		1.0065E+06	7.2417E-06	4.9001E+19	3.7242E+16
Ba-137m		4.3091E+05	8.0125E-07	3.5221E+18	1.5944E+16
Br-82		1.5890E+04	1.4677E-05	1.0779E+20	5.8793E+14
Br-83		2.5022E+05	1.5839E-05	1.1492E+20	9.2582E+15
Br-84		3.1155E+05	4.4260E-06	3.1731E+19	1.1527E+16

PCS Transport Group Inventory:

Time (h) =	0.3333	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		3.8668E+20	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.0569E+23	0.0000E+00	0.0000E+00
Organic I (atoms)		3.2687E+21	0.0000E+00	0.0000E+00
Aerosols (kg)		5.1705E+00	0.0000E+00	0.0000E+00

Time (h) =	0.3333	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	0.3333	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	0.3333	Ci	kg	Atoms	Bq
Rb-86		3.0911E-03	3.7989E-11	2.6602E+14	1.1437E+08



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Sr-89	1.3607E-04	4.6837E-12	3.1692E+13	5.0347E+06
I-131	9.8328E-01	7.9313E-09	3.6461E+16	3.6381E+10
I-132	1.2708E+00	1.2311E-10	5.6167E+14	4.7019E+10
I-133	1.9022E+00	1.6791E-09	7.6030E+15	7.0380E+10
I-134	1.6194E+00	6.0704E-11	2.7281E+14	5.9917E+10
I-135	1.7430E+00	4.9632E-10	2.2140E+15	6.4491E+10
Xe-133	3.4054E-03	1.8193E-11	8.2376E+13	1.2600E+08
Xe-135	3.9932E-02	1.5637E-11	6.9753E+13	1.4775E+09
Cs-134	3.2158E-01	2.4855E-07	1.1170E+18	1.1898E+10
Cs-136	9.2649E-02	1.2641E-09	5.5976E+15	3.4280E+09
Cs-137	1.7366E-01	1.9965E-06	8.7760E+18	6.4253E+09
I-130	4.8331E-02	2.4781E-11	1.1479E+14	1.7882E+09
Kr-83m	1.3569E-02	6.5767E-13	4.7718E+12	5.0206E+08
Xe-131m	8.8294E-06	1.0541E-13	4.8458E+11	3.2669E+05
Xe-133m	2.4350E-04	5.4266E-13	2.4571E+12	9.0093E+06
Xe-135m	1.6653E-01	1.8281E-12	8.1550E+12	6.1616E+09
Cs-138	1.3755E+00	3.2508E-11	1.4186E+14	5.0895E+10
Cs-134m	7.1725E-02	8.8941E-12	3.9971E+13	2.6538E+09
Rb-88	3.8908E-01	3.2413E-12	2.2181E+13	1.4396E+10
Rb-89	4.3730E-01	3.1463E-12	2.1289E+13	1.6180E+10
Ba-137m	1.8722E-01	3.4811E-13	1.5302E+12	6.9270E+09
Br-82	6.9036E-03	6.3767E-12	4.6831E+13	2.5543E+08
Br-83	1.0871E-01	6.8815E-12	4.9929E+13	4.0223E+09
Br-84	1.3536E-01	1.9229E-12	1.3786E+13	5.0082E+09

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 0.3333	Release	Rate/s	Release
Noble gases (atoms)	6.6224E+12	1.2736E+11	1.6800E+14
Elemental I (atoms)	1.8100E+15	3.4810E+13	4.5917E+16
Organic I (atoms)	5.5981E+13	1.0766E+12	1.4201E+15
Aerosols (kg)	8.8552E-08	1.7030E-09	2.2464E-06

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Pathway

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 0.3333 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	1.7567E-05	2.1589E-13	1.5118E+12	6.4996E+05
Sr-89	7.7329E-07	2.6617E-14	1.8011E+11	2.8612E+04
I-131	5.5879E-03	4.5073E-11	2.0720E+14	2.0675E+08
I-132	7.2219E-03	6.9965E-13	3.1920E+12	2.6721E+08
I-133	1.0810E-02	9.5425E-12	4.3208E+13	3.9996E+08
I-134	9.2029E-03	3.4498E-13	1.5504E+12	3.4051E+08
I-135	9.9054E-03	2.8206E-12	1.2582E+13	3.6650E+08
Xe-133	1.9353E-05	1.0339E-13	4.6814E+11	7.1605E+05
Xe-135	2.2693E-04	8.8863E-14	3.9640E+11	8.3965E+06
Cs-134	1.8275E-03	1.4125E-09	6.3479E+15	6.7619E+07
Cs-136	5.2652E-04	7.1840E-12	3.1811E+13	1.9481E+07
Cs-137	9.8689E-04	1.1346E-08	4.9874E+16	3.6515E+07
I-130	2.7466E-04	1.4083E-13	6.5237E+11	1.0162E+07
Kr-83m	7.7113E-05	3.7375E-15	2.7118E+10	2.8532E+06
Xe-131m	5.0177E-08	5.9905E-16	2.7539E+09	1.8566E+03
Xe-133m	1.3838E-06	3.0839E-15	1.3964E+10	5.1200E+04
Xe-135m	9.4638E-04	1.0389E-14	4.6345E+10	3.5016E+07
Cs-138	7.8172E-03	1.8474E-13	8.0618E+11	2.8924E+08
Cs-134m	4.0761E-04	5.0545E-14	2.2715E+11	1.5082E+07
Rb-88	2.2112E-03	1.8420E-14	1.2606E+11	8.1813E+07
Rb-89	2.4852E-03	1.7880E-14	1.2098E+11	9.1952E+07
Ba-137m	1.0639E-03	1.9783E-15	8.6961E+09	3.9366E+07
Br-82	3.9233E-05	3.6238E-14	2.6614E+11	1.4516E+06
Br-83	6.1781E-04	3.9107E-14	2.8375E+11	2.2859E+07
Br-84	7.6923E-04	1.0928E-14	7.8345E+10	2.8462E+07

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	9.5473E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.6095E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	8.0705E+12	0.0000E+00	0.0000E+00
Aerosols (kg)	1.2766E-08	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 0.3333 Pathway  
 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	1.6415E+00	2.0174E-08	1.4127E+17	6.0737E+10
Sr-89	7.2261E-02	2.4873E-09	1.6830E+16	2.6737E+09
I-131	5.2217E+02	4.2119E-06	1.9362E+19	1.9320E+13
I-132	6.7486E+02	6.5380E-08	2.9828E+17	2.4970E+13
I-133	1.0101E+03	8.9171E-07	4.0376E+18	3.7375E+13
I-134	8.5997E+02	3.2237E-08	1.4488E+17	3.1819E+13
I-135	9.2562E+02	2.6357E-07	1.1757E+18	3.4248E+13
Xe-133	1.8084E+00	9.6614E-09	4.3746E+16	6.6912E+10
Xe-135	2.1206E+01	8.3039E-09	3.7042E+16	7.8462E+11
Cs-134	1.7078E+02	1.3199E-04	5.9319E+20	6.3187E+12
Cs-136	4.9202E+01	6.7132E-07	2.9726E+18	1.8205E+12
Cs-137	9.2221E+01	1.0602E-03	4.6605E+21	3.4122E+12
I-130	2.5666E+01	1.3160E-08	6.0962E+16	9.4965E+11
Kr-83m	7.2059E+00	3.4926E-10	2.5341E+15	2.6662E+11
Xe-131m	4.6889E-03	5.5979E-11	2.5734E+14	1.7349E+08
Xe-133m	1.2931E-01	2.8818E-10	1.3049E+15	4.7844E+09
Xe-135m	8.8436E+01	9.7084E-10	4.3307E+15	3.2721E+12
Cs-138	7.3049E+02	1.7263E-08	7.5335E+16	2.7028E+13
Cs-134m	3.8090E+01	4.7232E-09	2.1227E+16	1.4093E+12
Rb-88	2.0662E+02	1.7213E-09	1.1780E+16	7.6451E+12
Rb-89	2.3223E+02	1.6708E-09	1.1306E+16	8.5926E+12
Ba-137m	9.9421E+01	1.8487E-10	8.1262E+14	3.6786E+12
Br-82	3.6662E+00	3.3863E-09	2.4869E+16	1.3565E+11
Br-83	5.7732E+01	3.6544E-09	2.6515E+16	2.1361E+12
Br-84	7.1882E+01	1.0212E-09	7.3211E+15	2.6596E+12

SGs Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	8.9216E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.4384E+19	0.0000E+00	0.0000E+00
Organic I (atoms)	7.5416E+17	0.0000E+00	0.0000E+00
Aerosols (kg)	1.1929E-03	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Recirculating Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 0.3333 Pathway  
 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) = 0.3333 Pathway  
 Filter  
 Noble gases (atoms) 0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Detailed model information at time (H) = 0.5000

EAB Doses:

Time (h) =	0.5000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.0221E-03	1.7794E-01	1.6408E-03	9.1075E-03
Accumulated dose (rem)		2.9037E-03	4.5990E-01	4.7296E-03	2.3811E-02

LPZ Doses:

Time (h) =	0.5000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.2629E-04	2.1987E-02	2.0275E-04	1.1253E-03
Accumulated dose (rem)		3.5879E-04	5.6827E-02	5.8440E-04	2.9421E-03

Control Room Doses:

Time (h) =	0.5000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.0898E-04	1.2174E+00	1.1374E-02	5.5530E-02
Accumulated dose (rem)		4.6509E-04	2.5525E+00	2.5546E-02	1.1648E-01

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.5000	Ci	kg	Atoms	Bq
Rb-86		7.1121E+03	8.7407E-05	6.1207E+20	2.6315E+14
Sr-89		3.9017E+02	1.3430E-05	9.0874E+19	1.4436E+13
I-131		2.2616E+06	1.8242E-02	8.3861E+22	8.3679E+16
I-132		2.7813E+06	2.6945E-04	1.2293E+21	1.0291E+17
I-133		4.3534E+06	3.8430E-03	1.7401E+22	1.6108E+17
I-134		3.2667E+06	1.2245E-04	5.5032E+20	1.2087E+17
I-135		3.9419E+06	1.1224E-03	5.0071E+21	1.4585E+17
Xe-133		1.1720E+04	6.2614E-05	2.8351E+20	4.3364E+14
Xe-135		1.3851E+05	5.4240E-05	2.4196E+20	5.1250E+15
Cs-134		7.4009E+05	5.7201E-01	2.5707E+24	2.7383E+16
Cs-136		2.1315E+05	2.9082E-03	1.2878E+22	7.8865E+15
Cs-137		3.9966E+05	4.5948E+00	2.0197E+25	1.4787E+16
I-130		1.1019E+05	5.6500E-05	2.6173E+20	4.0772E+15
Kr-83m		4.4314E+04	2.1478E-06	1.5584E+19	1.6396E+15
Xe-131m		3.0470E+01	3.6377E-07	1.6723E+18	1.1274E+12
Xe-133m		8.3746E+02	1.8664E-06	8.4508E+18	3.0986E+13
Xe-135m		4.7263E+05	5.1885E-06	2.3145E+19	1.7487E+16
Cs-138		2.5525E+06	6.0322E-05	2.6324E+20	9.4443E+16
Cs-134m		1.5862E+05	1.9670E-05	8.8397E+19	5.8690E+15
Rb-88		6.0658E+05	5.0532E-06	3.4581E+19	2.2444E+16
Rb-89		6.3782E+05	4.5889E-06	3.1050E+19	2.3599E+16
Ba-137m		4.4189E+05	8.2167E-07	3.6118E+18	1.6350E+16
Br-82		1.5836E+04	1.4627E-05	1.0743E+20	5.8594E+14
Br-83		2.3838E+05	1.5090E-05	1.0949E+20	8.8202E+15
Br-84		2.5049E+05	3.5586E-06	2.5512E+19	9.2683E+15

PCS Transport Group Inventory:

Time (h) =	0.5000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		5.7432E+20	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.0530E+23	0.0000E+00	0.0000E+00
Organic I (atoms)		3.2566E+21	0.0000E+00	0.0000E+00
Aerosols (kg)		5.1699E+00	0.0000E+00	0.0000E+00

Time (h) =	0.5000	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	0.5000	Pathway
		Filter

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	0.5000	Ci	kg	Atoms	Bq
Rb-86		5.0474E-03	6.2032E-11	4.3438E+14	1.8675E+08
Sr-89		2.7690E-04	9.5313E-12	6.4493E+13	1.0245E+07
I-131		1.6050E+00	1.2946E-08	5.9516E+16	5.9386E+10
I-132		1.9739E+00	1.9123E-10	8.7243E+14	7.3034E+10
I-133		3.0896E+00	2.7274E-09	1.2349E+16	1.1431E+11
I-134		2.3183E+00	8.6905E-11	3.9056E+14	8.5778E+10
I-135		2.7975E+00	7.9659E-10	3.5535E+15	1.0351E+11
Xe-133		8.3193E-03	4.4445E-11	2.0124E+14	3.0781E+08
Xe-135		9.8321E-02	3.8501E-11	1.7175E+14	3.6379E+09
Cs-134		5.2524E-01	4.0596E-07	1.8244E+18	1.9434E+10
Cs-136		1.5127E-01	2.0640E-09	9.1393E+15	5.5970E+09
Cs-137		2.8364E-01	3.2609E-06	1.4334E+19	1.0495E+10
I-130		7.8205E-02	4.0098E-11	1.8575E+14	2.8936E+09
Kr-83m		3.1455E-02	1.5246E-12	1.1062E+13	1.1638E+09
Xe-131m		2.1628E-05	2.5821E-13	1.1870E+12	8.0024E+05
Xe-133m		5.9445E-04	1.3248E-12	5.9986E+12	2.1995E+07
Xe-135m		3.3548E-01	3.6829E-12	1.6429E+13	1.2413E+10
Cs-138		1.8115E+00	4.2810E-11	1.8682E+14	6.7025E+10
Cs-134m		1.1257E-01	1.3959E-11	6.2735E+13	4.1652E+09
Rb-88		4.3049E-01	3.5862E-12	2.4542E+13	1.5928E+10
Rb-89		4.5265E-01	3.2567E-12	2.2036E+13	1.6748E+10
Ba-137m		3.1361E-01	5.8313E-13	2.5633E+12	1.1604E+10
Br-82		1.1239E-02	1.0381E-11	7.6239E+13	4.1584E+08
Br-83		1.6918E-01	1.0709E-11	7.7701E+13	6.2597E+09
Br-84		1.7777E-01	2.5255E-12	1.8106E+13	6.5777E+09

Environment Transport Group Inventory:

Time (h) =	0.5000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)		2.2292E+13	3.0961E+11	4.0767E+14
Elemental I (atoms)		4.0839E+15	5.6721E+13	7.4728E+16
Organic I (atoms)		1.2631E+14	1.7542E+12	2.3112E+15
Aerosols (kg)		2.0051E-07	2.7849E-09	3.6690E-06

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	0.5000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	0.5000	Ci	kg	Atoms	Bq
Rb-86		9.4956E-07	1.1670E-14	8.1719E+10	3.5134E+04
Sr-89		5.2093E-08	1.7931E-15	1.2133E+10	1.9275E+03
I-131		3.0195E-04	2.4356E-12	1.1197E+13	1.1172E+07
I-132		3.7135E-04	3.5976E-14	1.6413E+11	1.3740E+07
I-133		5.8124E-04	5.1309E-13	2.3232E+12	2.1506E+07
I-134		4.3614E-04	1.6349E-14	7.3475E+10	1.6137E+07
I-135		5.2629E-04	1.4986E-13	6.6851E+11	1.9473E+07
Cs-134		9.8811E-05	7.6371E-11	3.4322E+14	3.6560E+06
Cs-136		2.8458E-05	3.8829E-13	1.7194E+12	1.0529E+06
Cs-137		5.3360E-05	6.1346E-10	2.6966E+15	1.9743E+06
I-130		1.4712E-05	7.5435E-15	3.4945E+10	5.4436E+05
Cs-138		3.4079E-04	8.0538E-15	3.5146E+10	1.2609E+07
Cs-134m		2.1178E-05	2.6261E-15	1.1802E+10	7.8359E+05
Rb-88		8.0986E-05	6.7467E-16	4.6170E+09	2.9965E+06
Rb-89		8.5157E-05	6.1267E-16	4.1456E+09	3.1508E+06
Ba-137m		5.8999E-05	1.0970E-16	4.8223E+08	2.1829E+06
Br-82		2.1143E-06	1.9530E-15	1.4343E+10	7.8231E+04
Br-83		3.1827E-05	2.0147E-15	1.4618E+10	1.1776E+06

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Br-84 3.3444E-05 4.7512E-16 3.4062E+09 1.2374E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.4058E+13
Organic I (atoms)	4.3480E+11
Aerosols (kg)	6.9025E-10

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.5000	Ci	kg	Atoms	Bq
Rb-86	8.1171E-06	9.9759E-14	6.9856E+11	3.0033E+05
Sr-89	4.4531E-07	1.5328E-14	1.0372E+11	1.6476E+04
I-131	2.5812E-03	2.0820E-11	9.5711E+13	9.5503E+07
I-132	3.1744E-03	3.0753E-13	1.4030E+12	1.1745E+08
I-133	4.9686E-03	4.3861E-12	1.9860E+13	1.8384E+08
I-134	3.7283E-03	1.3976E-13	6.2809E+11	1.3795E+08
I-135	4.4989E-03	1.2811E-12	5.7146E+12	1.6646E+08
Xe-133	2.1233E-05	1.1344E-13	5.1364E+11	7.8564E+05
Xe-135	2.5078E-04	9.8202E-14	4.3806E+11	9.2789E+06
Cs-134	8.4467E-04	6.5285E-10	2.9340E+15	3.1253E+07
Cs-136	2.4327E-04	3.3192E-12	1.4698E+13	9.0009E+06
Cs-137	4.5614E-04	5.2440E-09	2.3051E+16	1.6877E+07
I-130	1.2577E-04	6.4484E-14	2.9872E+11	4.6533E+06
Kr-83m	8.0305E-05	3.8922E-15	2.8240E+10	2.9713E+06
Xe-131m	5.5205E-08	6.5908E-16	3.0298E+09	2.0426E+03
Xe-133m	1.5173E-06	3.3814E-15	1.5311E+10	5.6138E+04
Xe-135m	8.6201E-04	9.4630E-15	4.2213E+10	3.1894E+07
Cs-138	2.9132E-03	6.8847E-14	3.0044E+11	1.0779E+08
Cs-134m	1.8104E-04	2.2449E-14	1.0089E+11	6.6984E+06
Rb-88	6.9230E-04	5.7673E-15	3.9468E+10	2.5615E+07
Rb-89	7.2795E-04	5.2373E-15	3.5438E+10	2.6934E+07
Ba-137m	5.0434E-04	9.3778E-16	4.1222E+09	1.8661E+07
Br-82	1.8074E-05	1.6694E-14	1.2261E+11	6.6874E+05
Br-83	2.7207E-04	1.7222E-14	1.2496E+11	1.0067E+07
Br-84	2.8589E-04	4.0615E-15	2.9118E+10	1.0578E+07

Control Room Transport Group Inventory:

			Overlying
Time (h) = 0.5000	Atmosphere	Sump	Pool
Noble gases (atoms)	1.0405E+12	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.2018E+14	0.0000E+00	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Organic I (atoms)	3.7168E+12	0.0000E+00	0.0000E+00
Aerosols (kg)	5.9004E-09	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) =	Ci	kg	Atoms	Bq
0.5000				
Rb-86	4.7656E-06	5.8569E-14	4.1013E+11	1.7633E+05
Sr-89	2.6144E-07	8.9991E-15	6.0892E+10	9.6734E+03
I-131	1.5154E-03	1.2224E-11	5.6193E+13	5.6070E+07
I-132	1.8637E-03	1.8055E-13	8.2372E+11	6.8956E+07
I-133	2.9171E-03	2.5751E-12	1.1660E+13	1.0793E+08
I-134	2.1889E-03	8.2052E-14	3.6875E+11	8.0989E+07
I-135	2.6413E-03	7.5211E-13	3.3551E+12	9.7729E+07
Cs-134	4.9591E-04	3.8329E-10	1.7225E+15	1.8349E+07
Cs-136	1.4282E-04	1.9487E-12	8.6290E+12	5.2845E+06
Cs-137	2.6780E-04	3.0788E-09	1.3534E+16	9.9086E+06
I-130	7.3838E-05	3.7859E-14	1.7538E+11	2.7320E+06
Cs-138	1.7104E-03	4.0420E-14	1.7639E+11	6.3283E+07
Cs-134m	1.0629E-04	1.3180E-14	5.9232E+10	3.9326E+06
Rb-88	4.0645E-04	3.3860E-15	2.3172E+10	1.5039E+07
Rb-89	4.2738E-04	3.0749E-15	2.0806E+10	1.5813E+07
Ba-137m	2.9610E-04	5.5057E-16	2.4202E+09	1.0956E+07
Br-82	1.0611E-05	9.8014E-15	7.1982E+10	3.9262E+05
Br-83	1.5973E-04	1.0111E-14	7.3362E+10	5.9101E+06
Br-84	1.6785E-04	2.3845E-15	1.7095E+10	6.2104E+06

Deposition Recirculating

Time (h) =	Surfaces	Filter
0.5000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	7.0556E+13
Organic I (atoms)	0.0000E+00	2.1821E+12
Aerosols (kg)	0.0000E+00	3.4642E-09

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway
	Filter
0.5000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
0.5000				
Rb-86	9.4956E-07	1.1670E-14	8.1719E+10	3.5134E+04
Sr-89	5.2093E-08	1.7931E-15	1.2133E+10	1.9275E+03
I-131	3.0195E-04	2.4356E-12	1.1197E+13	1.1172E+07
I-132	3.7135E-04	3.5976E-14	1.6413E+11	1.3740E+07
I-133	5.8124E-04	5.1309E-13	2.3232E+12	2.1506E+07
I-134	4.3614E-04	1.6349E-14	7.3475E+10	1.6137E+07
I-135	5.2629E-04	1.4986E-13	6.6851E+11	1.9473E+07
Cs-134	9.8811E-05	7.6371E-11	3.4322E+14	3.6560E+06
Cs-136	2.8458E-05	3.8829E-13	1.7194E+12	1.0529E+06
Cs-137	5.3360E-05	6.1346E-10	2.6966E+15	1.9743E+06
I-130	1.4712E-05	7.5435E-15	3.4945E+10	5.4436E+05
Cs-138	3.4079E-04	8.0538E-15	3.5146E+10	1.2609E+07
Cs-134m	2.1178E-05	2.6261E-15	1.1802E+10	7.8359E+05
Rb-88	8.0986E-05	6.7467E-16	4.6170E+09	2.9965E+06
Rb-89	8.5157E-05	6.1267E-16	4.1456E+09	3.1508E+06
Ba-137m	5.8999E-05	1.0970E-16	4.8223E+08	2.1829E+06
Br-82	2.1143E-06	1.9530E-15	1.4343E+10	7.8231E+04
Br-83	3.1827E-05	2.0147E-15	1.4618E+10	1.1776E+06
Br-84	3.3444E-05	4.7512E-16	3.4062E+09	1.2374E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	Pathway
	Filter
0.5000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	1.4058E+13
Organic I (atoms)	4.3480E+11
Aerosols (kg)	6.9025E-10

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 0.5000	Ci	kg	Atoms	Bq
Rb-86	5.7151E-06	7.0239E-14	4.9185E+11	2.1146E+05
Sr-89	3.1354E-07	1.0792E-14	7.3025E+10	1.1601E+04
I-131	1.8174E-03	1.4659E-11	6.7389E+13	6.7243E+07
I-132	2.2350E-03	2.1653E-13	9.8785E+11	8.2696E+07
I-133	3.4983E-03	3.0882E-12	1.3983E+13	1.2944E+08
I-134	2.6250E-03	9.8401E-14	4.4223E+11	9.7126E+07
I-135	3.1676E-03	9.0197E-13	4.0236E+12	1.1720E+08
Cs-134	5.9472E-04	4.5966E-10	2.0658E+15	2.2005E+07
Cs-136	1.7128E-04	2.3370E-12	1.0348E+13	6.3374E+06
Cs-137	3.2116E-04	3.6923E-09	1.6230E+16	1.1883E+07
I-130	8.8550E-05	4.5402E-14	2.1032E+11	3.2764E+06
Cs-138	2.0511E-03	4.8474E-14	2.1153E+11	7.5892E+07
Cs-134m	1.2747E-04	1.5806E-14	7.1034E+10	4.7162E+06
Rb-88	4.8744E-04	4.0607E-15	2.7789E+10	1.8035E+07
Rb-89	5.1254E-04	3.6875E-15	2.4951E+10	1.8964E+07
Ba-137m	3.5510E-04	6.6028E-16	2.9024E+09	1.3139E+07
Br-82	1.2726E-05	1.1754E-14	8.6325E+10	4.7085E+05
Br-83	1.9156E-04	1.2126E-14	8.7980E+10	7.0878E+06
Br-84	2.0129E-04	2.8596E-15	2.0501E+10	7.4478E+06

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.5000	Ci	kg	Atoms	Bq
Rb-86	2.4615E+00	3.0252E-08	2.1184E+17	9.1075E+10
Sr-89	1.3504E-01	4.6481E-09	3.1451E+16	4.9964E+09
I-131	7.8273E+02	6.3137E-06	2.9024E+19	2.8961E+13
I-132	9.6262E+02	9.3258E-08	4.2546E+17	3.5617E+13
I-133	1.5067E+03	1.3301E-06	6.0224E+18	5.5748E+13
I-134	1.1306E+03	4.2381E-08	1.9047E+17	4.1832E+13
I-135	1.3643E+03	3.8848E-07	1.7329E+18	5.0478E+13
Xe-133	4.0563E+00	2.1670E-08	9.8122E+16	1.5008E+11
Xe-135	4.7939E+01	1.8772E-08	8.3740E+16	1.7738E+12
Cs-134	2.5614E+02	1.9797E-04	8.8972E+20	9.4773E+12
Cs-136	7.3770E+01	1.0065E-06	4.4570E+18	2.7295E+12
Cs-137	1.3832E+02	1.5902E-03	6.9903E+21	5.1179E+12
I-130	3.8138E+01	1.9555E-08	9.0585E+16	1.4111E+12
Kr-83m	1.5337E+01	7.4336E-10	5.3935E+15	5.6747E+11
Xe-131m	1.0546E-02	1.2590E-10	5.7877E+14	3.9018E+08
Xe-133m	2.8984E-01	6.4595E-10	2.9248E+15	1.0724E+10
Xe-135m	1.6358E+02	1.7957E-09	8.0105E+15	6.0524E+12
Cs-138	8.8342E+02	2.0878E-08	9.1107E+16	3.2687E+13
Cs-134m	5.4899E+01	6.8076E-09	3.0594E+16	2.0313E+12
Rb-88	2.0994E+02	1.7489E-09	1.1968E+16	7.7677E+12
Rb-89	2.2075E+02	1.5882E-09	1.0746E+16	8.1677E+12
Ba-137m	1.5294E+02	2.8438E-10	1.2500E+15	5.6588E+12
Br-82	5.4809E+00	5.0626E-09	3.7180E+16	2.0279E+11
Br-83	8.2505E+01	5.2225E-09	3.7893E+16	3.0527E+12
Br-84	8.6696E+01	1.2316E-09	8.8298E+15	3.2077E+12

SGs Transport Group Inventory:



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.5000			
Noble gases (atoms)	1.9877E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.6443E+19	0.0000E+00	0.0000E+00
Organic I (atoms)	1.1271E+18	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7893E-03	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.5000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 0.5000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway Filter
Time (h) = 0.5000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 2.0000

EAB Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 2.0000				
Delta dose (rem)	1.4395E-02	3.9240E+00	2.2095E-02	1.9271E-01
Accumulated dose (rem)	1.7298E-02	4.3839E+00	2.6825E-02	2.1653E-01

LPZ Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 2.0000				
Delta dose (rem)	1.7786E-03	4.8485E-01	2.7301E-03	2.3812E-02
Accumulated dose (rem)	2.1374E-03	5.4168E-01	3.3145E-03	2.6754E-02

Control Room Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 2.0000				
Delta dose (rem)	1.9916E-04	1.3835E+00	1.0616E-02	6.3050E-02
Accumulated dose (rem)	6.6425E-04	3.9360E+00	3.6163E-02	1.7953E-01

PCS Compartment Atmosphere Nuclide Inventory:

	Ci	kg	Atoms	Bq
Time (h) = 2.0000				
Rb-86	7.0882E+03	8.7114E-05	6.1001E+20	2.6226E+14
Sr-89	5.2033E+02	1.7910E-05	1.2119E+20	1.9252E+13
I-131	2.2471E+06	1.8125E-02	8.3324E+22	8.3143E+16
I-132	1.7680E+06	1.7128E-04	7.8142E+20	6.5416E+16
I-133	4.1368E+06	3.6518E-03	1.6535E+22	1.5306E+17
I-134	9.9674E+05	3.7364E-05	1.6792E+20	3.6879E+16
I-135	3.3646E+06	9.5808E-04	4.2738E+21	1.2449E+17
Xe-133	4.5510E+04	2.4313E-04	1.1009E+21	1.6839E+15
Xe-135	5.1499E+05	2.0166E-04	8.9959E+20	1.9055E+16
Cs-134	7.3929E+05	5.7139E-01	2.5679E+24	2.7354E+16
Cs-136	2.1222E+05	2.8956E-03	1.2822E+22	7.8523E+15
Cs-137	3.9924E+05	4.5900E+00	2.0176E+25	1.4772E+16
I-130	1.0120E+05	5.1888E-05	2.4037E+20	3.7444E+15
Kr-83m	1.0738E+05	5.2047E-06	3.7763E+19	3.9732E+15
Xe-131m	1.2121E+02	1.4471E-06	6.6525E+18	4.4849E+12
Xe-133m	3.2321E+03	7.2031E-06	3.2615E+19	1.1959E+14
Xe-135m	5.5075E+05	6.0461E-06	2.6971E+19	2.0378E+16
Cs-138	3.6739E+05	8.6824E-06	3.7889E+19	1.3593E+16

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-134m	1.1071E+05	1.3729E-05	6.1700E+19	4.0965E+15
Rb-88	1.8213E+04	1.5172E-07	1.0383E+18	6.7387E+14
Rb-89	1.0515E+04	7.5655E-08	5.1192E+17	3.8907E+14
Ba-137m	4.4257E+05	8.2293E-07	3.6174E+18	1.6375E+16
Br-82	1.5361E+04	1.4188E-05	1.0420E+20	5.6834E+14
Br-83	1.5413E+05	9.7566E-06	7.0790E+19	5.7029E+15
Br-84	3.5186E+04	4.9987E-07	3.5837E+18	1.3019E+15

PCS Transport Group Inventory:

Time (h) =	2.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	2.1045E+21	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.0234E+23	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	3.1650E+21	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	5.1644E+00	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) =	2.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	2.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Rb-86	4.8766E-02	5.9933E-10	4.1968E+15	1.8043E+09	
Sr-89	3.5798E-03	1.2322E-10	8.3375E+14	1.3245E+08	
I-131	1.5460E+01	1.2470E-07	5.7325E+17	5.7200E+11	
I-132	1.2163E+01	1.1784E-09	5.3760E+15	4.5005E+11	
I-133	2.8461E+01	2.5124E-08	1.1376E+17	1.0530E+12	
I-134	6.8574E+00	2.5705E-10	1.1552E+15	2.5372E+11	
I-135	2.3148E+01	6.5914E-09	2.9403E+16	8.5647E+11	
Xe-133	3.1323E-01	1.6734E-09	7.5770E+15	1.1590E+10	
Xe-135	3.5446E+00	1.3880E-09	6.1916E+15	1.3115E+11	
Cs-134	5.0861E+00	3.9311E-06	1.7667E+19	1.8819E+11	
Cs-136	1.4601E+00	1.9921E-08	8.8212E+16	5.4022E+10	
Cs-137	2.7467E+00	3.1578E-05	1.3881E+20	1.0163E+11	
I-130	6.9623E-01	3.5698E-10	1.6537E+15	2.5760E+10	
Kr-83m	7.3909E-01	3.5822E-11	2.5991E+14	2.7346E+10	
Xe-131m	8.3427E-04	9.9601E-12	4.5787E+13	3.0868E+07	
Xe-133m	2.2245E-02	4.9576E-11	2.2448E+14	8.2307E+08	
Xe-135m	3.7901E+00	4.1607E-11	1.8560E+14	1.4023E+11	
Cs-138	2.5276E+00	5.9733E-11	2.6067E+14	9.3520E+10	
Cs-134m	7.6170E-01	9.4452E-11	4.2448E+14	2.8183E+10	
Rb-88	1.2530E-01	1.0438E-12	7.1433E+12	4.6361E+09	
Rb-89	7.2344E-02	5.2049E-13	3.5219E+12	2.6767E+09	
Ba-137m	3.0448E+00	5.6616E-12	2.4887E+13	1.1266E+11	
Br-82	1.0568E-01	9.7612E-11	7.1687E+14	3.9101E+09	
Br-83	1.0604E+00	6.7124E-11	4.8702E+14	3.9235E+10	
Br-84	2.4207E-01	3.4390E-12	2.4655E+13	8.9568E+09	

Environment Transport Group Inventory:

Time (h) =	2.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.7533E+14	3.8240E+12	1.4484E+16	
Elemental I (atoms)	1.3381E+16	1.8584E+14	7.0405E+17	
Organic I (atoms)	4.1383E+14	5.7477E+12	2.1775E+16	
Aerosols (kg)	6.7525E-07	9.3785E-09	3.5530E-05	

Control Room Unfiltered Makeup Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	2.2214E-05	2.7301E-13	1.9118E+12	8.2193E+05
Sr-89	1.6307E-06	5.6130E-14	3.7980E+11	6.0335E+04
I-131	7.0423E-03	5.6804E-11	2.6113E+14	2.6057E+08
I-132	5.5408E-03	5.3679E-13	2.4489E+12	2.0501E+08
I-133	1.2965E-02	1.1445E-11	5.1821E+13	4.7969E+08
I-134	3.1237E-03	1.1710E-13	5.2624E+11	1.1558E+08
I-135	1.0545E-02	3.0026E-12	1.3394E+13	3.9015E+08
Cs-134	2.3169E-03	1.7907E-09	8.0477E+15	8.5725E+07
Cs-136	6.6510E-04	9.0748E-12	4.0183E+13	2.4609E+07
Cs-137	1.2512E-03	1.4385E-08	6.3231E+16	4.6295E+07
I-130	3.1715E-04	1.6261E-13	7.5330E+11	1.1735E+07
Cs-138	1.1514E-03	2.7210E-14	1.1874E+11	4.2601E+07
Cs-134m	3.4698E-04	4.3026E-14	1.9336E+11	1.2838E+07
Rb-88	5.7078E-05	4.7550E-16	3.2540E+09	2.1119E+06
Rb-89	3.2955E-05	2.3710E-16	1.6043E+09	1.2193E+06
Ba-137m	1.3870E-03	2.5790E-15	1.1337E+10	5.1319E+07
Br-82	4.8140E-05	4.4465E-14	3.2655E+11	1.7812E+06
Br-83	4.8305E-04	3.0577E-14	2.2185E+11	1.7873E+07
Br-84	1.1027E-04	1.5666E-15	1.1231E+10	4.0801E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.2072E+14
Organic I (atoms)	9.9191E+12
Aerosols (kg)	1.6185E-08

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	7.3843E-07	9.0753E-15	6.3549E+10	2.7322E+04
Sr-89	5.4206E-08	1.8658E-15	1.2625E+10	2.0056E+03
I-131	2.3410E-04	1.8883E-12	8.6804E+12	8.6616E+06
I-132	1.8418E-04	1.7844E-14	8.1406E+10	6.8148E+06

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-133	4.3096E-04	3.8044E-13	1.7226E+12	1.5946E+07
I-134	1.0384E-04	3.8924E-15	1.7493E+10	3.8420E+06
I-135	3.5052E-04	9.9810E-14	4.4524E+11	1.2969E+07
Xe-133	8.2040E-05	4.3829E-13	1.9846E+12	3.0355E+06
Xe-135	9.1159E-04	3.5697E-13	1.5924E+12	3.3729E+07
Cs-134	7.7017E-05	5.9526E-11	2.6752E+14	2.8496E+06
Cs-136	2.2109E-05	3.0166E-13	1.3358E+12	8.1803E+05
Cs-137	4.1592E-05	4.7817E-10	2.1019E+15	1.5389E+06
I-130	1.0543E-05	5.4055E-15	2.5041E+10	3.9008E+05
Kr-83m	1.9835E-04	9.6138E-15	6.9753E+10	7.3390E+06
Xe-131m	2.1973E-07	2.6233E-15	1.2060E+10	8.1302E+03
Xe-133m	5.8361E-06	1.3007E-14	5.8893E+10	2.1594E+05
Xe-135m	1.5715E-03	1.7252E-14	7.6958E+10	5.8146E+07
Cs-138	3.8274E-05	9.0451E-16	3.9471E+09	1.4161E+06
Cs-134m	1.1534E-05	1.4302E-15	6.4277E+09	4.2676E+05
Rb-88	1.8974E-06	1.5806E-17	1.0817E+08	7.0202E+04
Rb-89	1.0955E-06	7.8816E-18	5.3330E+07	4.0533E+04
Ba-137m	4.6106E-05	8.5730E-17	3.7685E+08	1.7059E+06
Br-82	1.6002E-06	1.4781E-15	1.0855E+10	5.9208E+04
Br-83	1.6057E-05	1.0164E-15	7.3747E+09	5.9411E+05
Br-84	3.6656E-06	5.2075E-17	3.7334E+08	1.3563E+05

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0000			
Noble gases (atoms)	3.7946E+12	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.0661E+13	0.0000E+00	0.0000E+00
Organic I (atoms)	3.2972E+11	0.0000E+00	0.0000E+00
Aerosols (kg)	5.3801E-10	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

	Ci	kg	Atoms	Bq
Time (h) = 2.0000				
Rb-86	1.0201E-05	1.2537E-13	8.7792E+11	3.7745E+05
Sr-89	7.4885E-07	2.5776E-14	1.7441E+11	2.7707E+04
I-131	3.2340E-03	2.6086E-11	1.1992E+14	1.1966E+08
I-132	2.5445E-03	2.4650E-13	1.1246E+12	9.4145E+07
I-133	5.9537E-03	5.2557E-12	2.3797E+13	2.2029E+08
I-134	1.4345E-03	5.3773E-14	2.4166E+11	5.3076E+07
I-135	4.8423E-03	1.3788E-12	6.1508E+12	1.7917E+08
Cs-134	1.0640E-03	8.2234E-10	3.6957E+15	3.9367E+07
Cs-136	3.0543E-04	4.1673E-12	1.8453E+13	1.1301E+07
Cs-137	5.7458E-04	6.6058E-09	2.9037E+16	2.1260E+07
I-130	1.4564E-04	7.4676E-14	3.4593E+11	5.3888E+06
Cs-138	5.2874E-04	1.2496E-14	5.4529E+10	1.9563E+07
Cs-134m	1.5934E-04	1.9758E-14	8.8797E+10	5.8955E+06
Rb-88	2.6211E-05	2.1836E-16	1.4943E+09	9.6982E+05
Rb-89	1.5134E-05	1.0888E-16	7.3674E+08	5.5995E+05
Ba-137m	6.3694E-04	1.1843E-15	5.2060E+09	2.3567E+07
Br-82	2.2107E-05	2.0419E-14	1.4996E+11	8.1795E+05
Br-83	2.2183E-04	1.4042E-14	1.0188E+11	8.2075E+06
Br-84	5.0640E-05	7.1941E-16	5.1576E+09	1.8737E+06

Deposition Recirculating

	Surfaces	Filter
Time (h) = 2.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.4728E+14
Organic I (atoms)	0.0000E+00	4.5551E+12
Aerosols (kg)	0.0000E+00	7.4325E-09

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

	Ci	kg	Atoms	Bq
Time (h) = 2.0000				

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Rb-86	2.2214E-05	2.7301E-13	1.9118E+12	8.2193E+05
Sr-89	1.6307E-06	5.6130E-14	3.7980E+11	6.0335E+04
I-131	7.0423E-03	5.6804E-11	2.6113E+14	2.6057E+08
I-132	5.5408E-03	5.3679E-13	2.4489E+12	2.0501E+08
I-133	1.2965E-02	1.1445E-11	5.1821E+13	4.7969E+08
I-134	3.1237E-03	1.1710E-13	5.2624E+11	1.1558E+08
I-135	1.0545E-02	3.0026E-12	1.3394E+13	3.9015E+08
Cs-134	2.3169E-03	1.7907E-09	8.0477E+15	8.5725E+07
Cs-136	6.6510E-04	9.0748E-12	4.0183E+13	2.4609E+07
Cs-137	1.2512E-03	1.4385E-08	6.3231E+16	4.6295E+07
I-130	3.1715E-04	1.6261E-13	7.5330E+11	1.1735E+07
Cs-138	1.1514E-03	2.7210E-14	1.1874E+11	4.2601E+07
Cs-134m	3.4698E-04	4.3026E-14	1.9336E+11	1.2838E+07
Rb-88	5.7078E-05	4.7550E-16	3.2540E+09	2.1119E+06
Rb-89	3.2955E-05	2.3710E-16	1.6043E+09	1.2193E+06
Ba-137m	1.3870E-03	2.5790E-15	1.1337E+10	5.1319E+07
Br-82	4.8140E-05	4.4465E-14	3.2655E+11	1.7812E+06
Br-83	4.8305E-04	3.0577E-14	2.2185E+11	1.7873E+07
Br-84	1.1027E-04	1.5666E-15	1.1231E+10	4.0801E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.2072E+14
Organic I (atoms)	9.9191E+12
Aerosols (kg)	1.6185E-08

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	3.2415E-05	3.9838E-13	2.7897E+12	1.1994E+06
Sr-89	2.3795E-06	8.1905E-14	5.5421E+11	8.8043E+04
I-131	1.0276E-02	8.2890E-11	3.8105E+14	3.8022E+08
I-132	8.0852E-03	7.8329E-13	3.5736E+12	2.9915E+08
I-133	1.8918E-02	1.6700E-11	7.5618E+13	6.9998E+08
I-134	4.5582E-03	1.7087E-13	7.6791E+11	1.6865E+08
I-135	1.5387E-02	4.3814E-12	1.9545E+13	5.6932E+08
Cs-134	3.3809E-03	2.6131E-09	1.1743E+16	1.2509E+08
Cs-136	9.7053E-04	1.3242E-11	5.8637E+13	3.5909E+07
Cs-137	1.8258E-03	2.0991E-08	9.2269E+16	6.7555E+07
I-130	4.6280E-04	2.3729E-13	1.0992E+12	1.7123E+07
Cs-138	1.6801E-03	3.9706E-14	1.7327E+11	6.2165E+07
Cs-134m	5.0631E-04	6.2784E-14	2.8216E+11	1.8734E+07
Rb-88	8.3289E-05	6.9386E-16	4.7483E+09	3.0817E+06
Rb-89	4.8089E-05	3.4598E-16	2.3411E+09	1.7793E+06
Ba-137m	2.0239E-03	3.7634E-15	1.6543E+10	7.4886E+07
Br-82	7.0246E-05	6.4884E-14	4.7652E+11	2.5991E+06
Br-83	7.0487E-04	4.4618E-14	3.2373E+11	2.6080E+07
Br-84	1.6091E-04	2.2860E-15	1.6389E+10	5.9538E+06

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
-------------------	----	----	-------	----

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Rb-86	9.7902E+00	1.2032E-07	8.4254E+17	3.6224E+11
Sr-89	7.1867E-01	2.4737E-08	1.6738E+17	2.6591E+10
I-131	3.1037E+03	2.5035E-05	1.1509E+20	1.1484E+14
I-132	2.4419E+03	2.3657E-07	1.0793E+18	9.0351E+13
I-133	5.7137E+03	5.0439E-06	2.2838E+19	2.1141E+14
I-134	1.3767E+03	5.1606E-08	2.3192E+17	5.0937E+13
I-135	4.6472E+03	1.3233E-06	5.9030E+18	1.7195E+14
Xe-133	6.2858E+01	3.3581E-07	1.5205E+18	2.3257E+12
Xe-135	7.1130E+02	2.7854E-07	1.2425E+18	2.6318E+13
Cs-134	1.0211E+03	7.8920E-04	3.5468E+21	3.7780E+13
Cs-136	2.9312E+02	3.9994E-06	1.7709E+19	1.0845E+13
Cs-137	5.5143E+02	6.3396E-03	2.7867E+22	2.0403E+13
I-130	1.3977E+02	7.1667E-08	3.3199E+17	5.1717E+12
Kr-83m	1.4832E+02	7.1887E-09	5.2158E+16	5.4878E+12
Xe-131m	1.6742E-01	1.9987E-09	9.1883E+15	6.1944E+09
Xe-133m	4.4641E+00	9.9488E-09	4.5047E+16	1.6517E+11
Xe-135m	7.6069E+02	8.3508E-09	3.7252E+16	2.8146E+13
Cs-138	5.0743E+02	1.1992E-08	5.2331E+16	1.8775E+13
Cs-134m	1.5292E+02	1.8962E-08	8.5219E+16	5.6580E+12
Rb-88	2.5155E+01	2.0956E-10	1.4341E+15	9.3074E+11
Rb-89	1.4524E+01	1.0449E-10	7.0705E+14	5.3738E+11
Ba-137m	6.1127E+02	1.1366E-09	4.9962E+15	2.2617E+13
Br-82	2.1216E+01	1.9596E-08	1.4392E+17	7.8499E+11
Br-83	2.1289E+02	1.3476E-08	9.7774E+16	7.8768E+12
Br-84	4.8599E+01	6.9041E-10	4.9497E+15	1.7982E+12

SGs Transport Group Inventory:

Time (h) =	2.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		2.9067E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.4134E+20	0.0000E+00	0.0000E+00
Organic I (atoms)		4.3715E+18	0.0000E+00	0.0000E+00
Aerosols (kg)		7.1330E-03	0.0000E+00	0.0000E+00

Time (h) =	2.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	2.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) =	2.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Detailed model information at time (H) = 8.0000

EAB Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.0804E-01	5.8660E+01	1.6657E-01	2.8044E+00
Accumulated dose (rem)		1.2533E-01	6.3044E+01	1.9339E-01	3.0209E+00

LPZ Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		6.0733E-03	3.2976E+00	9.3636E-03	1.5765E-01
Accumulated dose (rem)		8.2107E-03	3.8393E+00	1.2678E-02	1.8440E-01

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Control Room Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		6.2062E-04	5.3023E+00	3.6005E-02	2.4436E-01
Accumulated dose (rem)		1.2849E-03	9.2384E+00	7.2167E-02	4.2389E-01

## PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		6.9935E+03	8.5950E-05	6.0187E+20	2.5876E+14
Sr-89		5.1857E+02	1.7850E-05	1.2078E+20	1.9187E+13
I-131		2.1901E+06	1.7665E-02	8.1208E+22	8.1032E+16
I-132		2.8865E+05	2.7964E-05	1.2758E+20	1.0680E+16
I-133		3.3731E+06	2.9776E-03	1.3482E+22	1.2480E+17
I-134		8.6396E+03	3.2386E-07	1.4555E+18	3.1966E+14
I-135		1.7860E+06	5.0856E-04	2.2686E+21	6.6082E+16
Xe-133		1.6186E+05	8.6472E-04	3.9154E+21	5.9888E+15
Xe-135		1.2223E+06	4.7864E-04	2.1351E+21	4.5225E+16
Cs-134		7.3606E+05	5.6890E-01	2.5567E+24	2.7234E+16
Cs-136		2.0856E+05	2.8457E-03	1.2601E+22	7.7169E+15
Cs-137		3.9758E+05	4.5708E+00	2.0092E+25	1.4710E+16
I-130		7.1984E+04	3.6909E-05	1.7098E+20	2.6634E+15
Kr-83m		5.8665E+04	2.8434E-06	2.0630E+19	2.1706E+15
Xe-131m		4.7421E+02	5.6614E-06	2.6026E+19	1.7546E+13
Xe-133m		1.1209E+04	2.4981E-05	1.1311E+20	4.1473E+14
Xe-135m		2.9393E+05	3.2267E-06	1.4394E+19	1.0875E+16
Cs-138		1.5768E+02	3.7263E-09	1.6261E+16	5.8340E+12
Cs-134m		2.6277E+04	3.2584E-06	1.4644E+19	9.7225E+14
Rb-88		1.4802E-02	1.2331E-13	8.4386E+11	5.4767E+08
Rb-89		7.7690E-04	5.5895E-15	3.7821E+10	2.8745E+07
Ba-137m		4.4073E+05	8.1950E-07	3.6023E+18	1.6307E+16
Br-82		1.3597E+04	1.2559E-05	9.2234E+19	5.0308E+14
Br-83		2.6938E+04	1.7052E-06	1.2372E+19	9.9670E+14
Br-84		1.3699E+01	1.9461E-10	1.3952E+15	5.0685E+11

## PCS Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		6.2247E+21	0.0000E+00	0.0000E+00
Elemental I (atoms)		9.4443E+22	0.0000E+00	0.0000E+00
Organic I (atoms)		2.9209E+21	0.0000E+00	0.0000E+00
Aerosols (kg)		5.1427E+00	0.0000E+00	0.0000E+00

Time (h) =	8.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

## SG Tube Leakage Transport Group Inventory:

Time (h) =	8.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Environment Integral Nuclide Release:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		7.3384E-01	9.0189E-09	6.3154E+16	2.7152E+10
Sr-89		5.4415E-02	1.8730E-09	1.2674E+16	2.0133E+09
I-131		2.2980E+02	1.8536E-06	8.5213E+18	8.5028E+12
I-132		3.0289E+01	2.9343E-09	1.3387E+16	1.1207E+12
I-133		3.5394E+02	3.1245E-07	1.4147E+18	1.3096E+13
I-134		9.0656E-01	3.3983E-11	1.5273E+14	3.3543E+10
I-135		1.8741E+02	5.3364E-08	2.3805E+17	6.9340E+12
Xe-133		1.6991E+01	9.0773E-08	4.1101E+17	6.2867E+11
Xe-135		1.2831E+02	5.0244E-08	2.2413E+17	4.7475E+12

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-134	7.7235E+01	5.9695E-05	2.6828E+20	2.8577E+12
Cs-136	2.1885E+01	2.9860E-07	1.3222E+18	8.0974E+11
Cs-137	4.1718E+01	4.7962E-04	2.1083E+21	1.5436E+12
I-130	7.5534E+00	3.8729E-09	1.7941E+16	2.7948E+11
Kr-83m	6.1582E+00	2.9848E-10	2.1656E+15	2.2785E+11
Xe-131m	4.9779E-02	5.9430E-10	2.7320E+15	1.8418E+09
Xe-133m	1.1766E+00	2.6223E-09	1.1874E+16	4.3536E+10
Xe-135m	3.0848E+01	3.3865E-10	1.5107E+15	1.1414E+12
Cs-138	1.6545E-02	3.9101E-13	1.7063E+12	6.1217E+08
Cs-134m	2.7573E+00	3.4191E-10	1.5366E+15	1.0202E+11
Rb-88	1.5532E-06	1.2939E-17	8.8547E+07	5.7468E+04
Ba-137m	4.6246E+01	8.5991E-11	3.7799E+14	1.7111E+12
Br-82	1.4267E+00	1.3178E-09	9.6782E+15	5.2789E+10
Br-83	2.8266E+00	1.7893E-10	1.2982E+15	1.0459E+11
Br-84	1.4374E-03	2.0421E-14	1.4640E+11	5.3185E+07

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 8.0000	Release	Rate/s	Release
Noble gases (atoms)	3.2311E+15	4.4877E+13	6.5343E+17
Elemental I (atoms)	4.8994E+16	6.8047E+14	9.9100E+18
Organic I (atoms)	1.5153E+15	2.1046E+13	3.0650E+17
Aerosols (kg)	2.6679E-06	3.7054E-08	5.3963E-04

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	3.1282E-04	3.8446E-12	2.6921E+13	1.1574E+07
Sr-89	2.3196E-05	7.9842E-13	5.4025E+12	8.5825E+05
I-131	9.7961E-02	7.9017E-10	3.6325E+15	3.6246E+09
I-132	1.2911E-02	1.2509E-12	5.7067E+12	4.7772E+08
I-133	1.5088E-01	1.3319E-10	6.0307E+14	5.5825E+09
I-134	3.8645E-04	1.4486E-14	6.5104E+10	1.4299E+07
I-135	7.9888E-02	2.2748E-11	1.0148E+14	2.9558E+09
Cs-134	3.2924E-02	2.5447E-08	1.1436E+17	1.2182E+09
Cs-136	9.3291E-03	1.2729E-10	5.6364E+14	3.4518E+08
Cs-137	1.7784E-02	2.0445E-07	8.9872E+17	6.5800E+08
I-130	3.2199E-03	1.6509E-12	7.6478E+12	1.1913E+08
Cs-138	7.0529E-06	1.6668E-16	7.2736E+08	2.6096E+05
Cs-134m	1.1754E-03	1.4575E-13	6.5502E+11	4.3489E+07
Ba-137m	1.9714E-02	3.6656E-14	1.6113E+11	7.2941E+08
Br-82	6.0818E-04	5.6176E-13	4.1256E+12	2.2503E+07
Br-83	1.2049E-03	7.6272E-14	5.5340E+11	4.4583E+07
Br-84	6.1274E-07	8.7049E-18	6.2407E+07	2.2672E+04

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.2244E+15
Organic I (atoms)	1.3065E+14
Aerosols (kg)	2.3003E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	2.5346E-06	3.1150E-14	2.1812E+11	9.3779E+04
Sr-89	1.8794E-07	6.4690E-15	4.3772E+10	6.9538E+03
I-131	7.9371E-04	6.4022E-12	2.9431E+13	2.9367E+07
I-132	1.0461E-04	1.0135E-14	4.6237E+10	3.8706E+06
I-133	1.2225E-03	1.0791E-12	4.8862E+12	4.5231E+07
I-134	3.1311E-06	1.1737E-16	5.2749E+08	1.1585E+05
I-135	6.4727E-04	1.8431E-13	8.2218E+11	2.3949E+07
Xe-133	1.1404E-03	6.0924E-12	2.7586E+13	4.2194E+07
Xe-135	8.4313E-03	3.3016E-12	1.4728E+13	3.1196E+08
Cs-134	2.6676E-04	2.0618E-10	9.2659E+14	9.8701E+06
Cs-136	7.5587E-05	1.0313E-12	4.5668E+12	2.7967E+06
Cs-137	1.4409E-04	1.6565E-09	7.2817E+15	5.3313E+06
I-130	2.6088E-05	1.3376E-14	6.1964E+10	9.6526E+05
Kr-83m	4.7056E-04	2.2807E-14	1.6548E+11	1.7411E+07
Xe-131m	3.4384E-06	4.1050E-14	1.8871E+11	1.2722E+05
Xe-133m	7.9646E-05	1.7750E-13	8.0371E+11	2.9469E+06
Xe-135m	8.1974E-03	8.9990E-14	4.0143E+11	3.0330E+08
Cs-138	5.7144E-08	1.3505E-18	5.8933E+06	2.1143E+03
Cs-134m	9.5232E-06	1.1809E-15	5.3071E+09	3.5236E+05
Ba-137m	1.5973E-04	2.9700E-16	1.3055E+09	5.9099E+06
Br-82	4.9277E-06	4.5515E-15	3.3427E+10	1.8232E+05
Br-83	9.7627E-06	6.1798E-16	4.4838E+09	3.6122E+05
Br-84	4.9646E-09	7.0529E-20	5.0564E+05	1.8369E+02

Control Room Transport Group Inventory:

Time (h) = 8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	4.3873E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.4228E+13	0.0000E+00	0.0000E+00
Organic I (atoms)	1.0586E+12	0.0000E+00	0.0000E+00
Aerosols (kg)	1.8638E-09	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	3.2171E-05	3.9537E-13	2.7686E+12	1.1903E+06
Sr-89	2.3855E-06	8.2110E-14	5.5559E+11	8.8262E+04
I-131	1.0074E-02	8.1261E-11	3.7356E+14	3.7275E+08
I-132	1.3278E-03	1.2864E-13	5.8687E+11	4.9129E+07
I-133	1.5516E-02	1.3697E-11	6.2020E+13	5.7410E+08
I-134	3.9742E-05	1.4898E-15	6.6953E+09	1.4705E+06
I-135	8.2157E-03	2.3394E-12	1.0436E+13	3.0398E+08
Cs-134	3.3859E-03	2.6170E-09	1.1761E+16	1.2528E+08
Cs-136	9.5941E-04	1.3090E-11	5.7965E+13	3.5498E+07
Cs-137	1.8289E-03	2.1026E-08	9.2425E+16	6.7669E+07
I-130	3.3113E-04	1.6978E-13	7.8650E+11	1.2252E+07
Cs-138	7.2532E-07	1.7141E-17	7.4802E+07	2.6837E+04
Cs-134m	1.2088E-04	1.4989E-14	6.7362E+10	4.4724E+06
Ba-137m	2.0274E-03	3.7697E-15	1.6571E+10	7.5012E+07
Br-82	6.2546E-05	5.7772E-14	4.2428E+11	2.3142E+06
Br-83	1.2392E-04	7.8439E-15	5.6912E+10	4.5849E+06

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Br-84	6.3015E-08	8.9521E-19	6.4180E+06	2.3315E+03
-------	------------	------------	------------	------------

	Deposition Surfaces	Recirculating Filter
Time (h) =	8.0000	
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	4.3444E+14
Organic I (atoms)	0.0000E+00	1.3436E+13
Aerosols (kg)	0.0000E+00	2.3657E-08

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	3.1282E-04	3.8446E-12	2.6921E+13	1.1574E+07
Sr-89	2.3196E-05	7.9842E-13	5.4025E+12	8.5825E+05
I-131	9.7961E-02	7.9017E-10	3.6325E+15	3.6246E+09
I-132	1.2911E-02	1.2509E-12	5.7067E+12	4.7772E+08
I-133	1.5088E-01	1.3319E-10	6.0307E+14	5.5825E+09
I-134	3.8645E-04	1.4486E-14	6.5104E+10	1.4299E+07
I-135	7.9888E-02	2.2748E-11	1.0148E+14	2.9558E+09
Cs-134	3.2924E-02	2.5447E-08	1.1436E+17	1.2182E+09
Cs-136	9.3291E-03	1.2729E-10	5.6364E+14	3.4518E+08
Cs-137	1.7784E-02	2.0445E-07	8.9872E+17	6.5800E+08
I-130	3.2199E-03	1.6509E-12	7.6478E+12	1.1913E+08
Cs-138	7.0529E-06	1.6668E-16	7.2736E+08	2.6096E+05
Cs-134m	1.1754E-03	1.4575E-13	6.5502E+11	4.3489E+07
Ba-137m	1.9714E-02	3.6656E-14	1.6113E+11	7.2941E+08
Br-82	6.0818E-04	5.6176E-13	4.1256E+12	2.2503E+07
Br-83	1.2049E-03	7.6272E-14	5.5340E+11	4.4583E+07
Br-84	6.1274E-07	8.7049E-18	6.2407E+07	2.2672E+04

Control Room Filtered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.2244E+15
Organic I (atoms)	1.3065E+14
Aerosols (kg)	2.3003E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	3.4499E-04	4.2399E-12	2.9690E+13	1.2765E+07
Sr-89	2.5581E-05	8.8053E-13	5.9581E+12	9.4651E+05
I-131	1.0804E-01	8.7143E-10	4.0060E+15	3.9973E+09
I-132	1.4239E-02	1.3795E-12	6.2935E+12	5.2685E+08

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-133	1.6639E-01	1.4689E-10	6.6509E+14	6.1566E+09
I-134	4.2619E-04	1.5976E-14	7.1799E+10	1.5769E+07
I-135	8.8103E-02	2.5087E-11	1.1191E+14	3.2598E+09
Cs-134	3.6310E-02	2.8064E-08	1.2612E+17	1.3435E+09
Cs-136	1.0289E-02	1.4038E-10	6.2160E+14	3.8067E+08
Cs-137	1.9613E-02	2.2548E-07	9.9115E+17	7.2567E+08
I-130	3.5510E-03	1.8207E-12	8.4343E+12	1.3139E+08
Cs-138	7.7782E-06	1.8382E-16	8.0216E+08	2.8779E+05
Cs-134m	1.2963E-03	1.6074E-13	7.2238E+11	4.7961E+07
Ba-137m	2.1741E-02	4.0426E-14	1.7770E+11	8.0442E+08
Br-82	6.7073E-04	6.1953E-13	4.5499E+12	2.4817E+07
Br-83	1.3289E-03	8.4116E-14	6.1031E+11	4.9167E+07
Br-84	6.7576E-07	9.6001E-18	6.8825E+07	2.5003E+04

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		3.8178E+01	4.6920E-07	3.2856E+18	1.4126E+12
Sr-89		2.8309E+00	9.7441E-08	6.5933E+17	1.0474E+11
I-131		1.1955E+04	9.6434E-05	4.4331E+20	4.4235E+14
I-132		1.5757E+03	1.5266E-07	6.9646E+17	5.8303E+13
I-133		1.8414E+04	1.6255E-05	7.3600E+19	6.8130E+14
I-134		4.7163E+01	1.7680E-09	7.9454E+15	1.7450E+12
I-135		9.7497E+03	2.7762E-06	1.2384E+19	3.6074E+14
Xe-133		8.8359E+02	4.7205E-06	2.1374E+19	3.2693E+13
Xe-135		6.6725E+03	2.6129E-06	1.1656E+19	2.4688E+14
Cs-134		4.0181E+03	3.1056E-03	1.3957E+22	1.4867E+14
Cs-136		1.1385E+03	1.5535E-05	6.8788E+19	4.2126E+13
Cs-137		2.1704E+03	2.4952E-02	1.0968E+23	8.0304E+13
I-130		3.9296E+02	2.0148E-07	9.3335E+17	1.4540E+13
Kr-83m		3.2025E+02	1.5522E-08	1.1262E+17	1.1849E+13
Xe-131m		2.5887E+00	3.0906E-08	1.4207E+17	9.5781E+10
Xe-133m		6.1189E+01	1.3637E-07	6.1747E+17	2.2640E+12
Xe-135m		1.6045E+03	1.7614E-08	7.8575E+16	5.9368E+13
Cs-138		8.6075E-01	2.0342E-11	8.8769E+13	3.1848E+10
Cs-134m		1.4345E+02	1.7788E-08	7.9940E+16	5.3075E+12
Rb-88		8.0804E-05	6.7315E-16	4.6066E+09	2.9897E+06
Rb-89		4.2411E-06	3.0513E-17	2.0646E+08	1.5692E+05
Ba-137m		2.4059E+03	4.4736E-09	1.9665E+16	8.9019E+13
Br-82		7.4224E+01	6.8559E-08	5.0350E+17	2.7463E+12
Br-83		1.4705E+02	9.3085E-09	6.7539E+16	5.4410E+12
Br-84		7.4781E-02	1.0624E-12	7.6163E+12	2.7669E+09

SGs Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		3.3980E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)		5.1556E+20	0.0000E+00	0.0000E+00
Organic I (atoms)		1.5945E+19	0.0000E+00	0.0000E+00
Aerosols (kg)		2.8074E-02	0.0000E+00	0.0000E+00

Time (h) =	8.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	8.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) =	8.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Detailed model information at time (H) = 24.0000

EAB Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.2189E-06	5.4468E-05	1.2115E-05	9.7433E-06
Accumulated dose (rem)	1.2534E-01	6.3044E+01	1.9340E-01	3.0209E+00

LPZ Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.7322E-07	2.0615E-06	4.5854E-07	3.6876E-07
Accumulated dose (rem)	8.2110E-03	3.8393E+00	1.2679E-02	1.8440E-01

Control Room Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.8896E-04	2.9268E-01	3.3462E-02	1.4153E-02
Accumulated dose (rem)	1.8738E-03	9.5310E+00	1.0563E-01	4.3805E-01

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	6.8225E+03	8.3848E-05	5.8714E+20	2.5243E+14
Sr-89	5.1385E+02	1.7687E-05	1.1968E+20	1.9012E+13
I-131	2.0677E+06	1.6679E-02	7.6673E+22	7.6506E+16
I-132	2.3241E+03	2.2516E-07	1.0272E+18	8.5992E+13
I-133	1.9791E+06	1.7471E-03	7.9106E+21	7.3226E+16
I-134	2.7696E-02	1.0382E-12	4.6658E+12	1.0247E+09
I-135	3.3359E+05	9.4990E-05	4.2374E+20	1.2343E+16
Xe-133	3.6302E+05	1.9394E-03	8.7815E+21	1.3432E+16
Xe-135	8.8067E+05	3.4486E-04	1.5383E+21	3.2585E+16
Cs-134	7.3561E+05	5.6855E-01	2.5552E+24	2.7218E+16
Cs-136	2.0134E+05	2.7471E-03	1.2164E+22	7.4494E+15
Cs-137	3.9756E+05	4.5706E+00	2.0091E+25	1.4710E+16
I-130	2.9346E+04	1.5047E-05	6.9703E+19	1.0858E+15
Kr-83m	9.8177E+02	4.7585E-08	3.4526E+17	3.6326E+13
Xe-131m	1.3558E+03	1.6186E-05	7.4409E+19	5.0164E+13
Xe-133m	2.3377E+04	5.2099E-05	2.3590E+20	8.6495E+14
Xe-135m	5.4900E+04	6.0269E-07	2.6885E+18	2.0313E+15
Cs-138	1.6709E-07	3.9489E-18	1.7232E+07	6.1825E+03
Cs-134m	5.7375E+02	7.1147E-08	3.1974E+17	2.1229E+13
Ba-137m	4.4071E+05	8.1946E-07	3.6021E+18	1.6306E+16
Br-82	9.9310E+03	9.1729E-06	6.7367E+19	3.6745E+14
Br-83	2.6008E+02	1.6463E-08	1.1945E+17	9.6228E+12
Br-84	1.1194E-08	1.5903E-19	1.1401E+06	4.1418E+02

PCS Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.0633E+22	0.0000E+00	0.0000E+00
Elemental I (atoms)	8.2591E+22	0.0000E+00	0.0000E+00
Organic I (atoms)	2.5544E+21	0.0000E+00	0.0000E+00
Aerosols (kg)	5.1420E+00	0.0000E+00	0.0000E+00

Time (h) = 24.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

## Environment Integral Nuclide Release:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	3.8110E+01	2.0360E-07	9.2188E+17	1.4101E+12
Xe-135	9.2453E+01	3.6203E-08	1.6150E+17	3.4207E+12
Kr-83m	1.0307E-01	4.9954E-12	3.6244E+13	3.8134E+09
Xe-131m	1.4233E-01	1.6992E-09	7.8115E+15	5.2662E+09
Xe-133m	2.4541E+00	5.4694E-09	2.4765E+16	9.0803E+10
Xe-135m	5.7620E+00	6.3255E-11	2.8217E+14	2.1319E+11

## Environment Transport Group Inventory:

Time (h) = 24.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	3.1207E+11	4.3343E+09	1.1163E+18
Elemental I (atoms)	2.5672E-21	3.5656E-23	8.6663E+18
Organic I (atoms)	7.9399E-23	1.1028E-24	2.6803E+17
Aerosols (kg)	1.5975E-43	2.2187E-45	5.3956E-04

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	3.0517E-04	3.7505E-12	2.6263E+13	1.1291E+07
Sr-89	2.2985E-05	7.9115E-13	5.3533E+12	8.5043E+05
I-131	9.2490E-02	7.4604E-10	3.4296E+15	3.4221E+09
I-132	1.0396E-04	1.0071E-14	4.5947E+10	3.8464E+06
I-133	8.8525E-02	7.8146E-11	3.5384E+14	3.2754E+09
I-134	1.2388E-09	4.6438E-20	2.0870E+05	4.5836E+01
I-135	1.4922E-02	4.2489E-12	1.8954E+13	5.5210E+08
Cs-134	3.2904E-02	2.5431E-08	1.1429E+17	1.2174E+09
Cs-136	9.0058E-03	1.2288E-10	5.4410E+14	3.3321E+08
Cs-137	1.7783E-02	2.0444E-07	8.9868E+17	6.5797E+08
I-130	1.3127E-03	6.7305E-13	3.1178E+12	4.8569E+07
Cs-134m	2.5664E-05	3.1824E-15	1.4302E+10	9.4956E+05
Ba-137m	1.9713E-02	3.6655E-14	1.6112E+11	7.2938E+08
Br-82	4.4421E-04	4.1031E-13	3.0133E+12	1.6436E+07
Br-83	1.1633E-05	7.3638E-16	5.3429E+09	4.3043E+05

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.6943E+15
Organic I (atoms)	1.1426E+14
Aerosols (kg)	2.3000E-07

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) = 24.0000 Pathway  
 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	2.2833E-04	1.2199E-12	5.5234E+12	8.4484E+06
Xe-135	5.0982E-04	1.9964E-13	8.9056E+11	1.8863E+07
Kr-83m	2.0324E-06	9.8508E-17	7.1473E+08	7.5200E+04
Xe-131m	1.1883E-06	1.4187E-14	6.5216E+10	4.3966E+04
Xe-133m	1.6293E-05	3.6310E-14	1.6441E+11	6.0283E+05
Xe-135m	1.4575E-03	1.6000E-14	7.1374E+10	5.3927E+07

Control Room Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	6.7157E+12	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.1479E-20	0.0000E+00	0.0000E+00
Organic I (atoms)	1.5921E-21	0.0000E+00	0.0000E+00
Aerosols (kg)	3.2048E-42	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	3.2610E-05	4.0078E-13	2.8064E+12	1.2066E+06
Sr-89	2.4561E-06	8.4542E-14	5.7205E+11	9.0877E+04
I-131	9.8834E-03	7.9721E-11	3.6648E+14	3.6569E+08
I-132	1.1109E-05	1.0762E-15	4.9099E+09	4.1103E+05
I-133	9.4597E-03	8.3507E-12	3.7811E+13	3.5001E+08
I-135	1.5945E-03	4.5404E-13	2.0254E+12	5.8997E+07
Cs-134	3.5161E-03	2.7176E-09	1.2213E+16	1.3010E+08
Cs-136	9.6235E-04	1.3131E-11	5.8143E+13	3.5607E+07
Cs-137	1.9003E-03	2.1847E-08	9.6033E+16	7.0311E+07
I-130	1.4027E-04	7.1921E-14	3.3317E+11	5.1900E+06
Cs-134m	2.7424E-06	3.4007E-16	1.5283E+09	1.0147E+05
Ba-137m	2.1065E-03	3.9169E-15	1.7218E+10	7.7941E+07
Br-82	4.7468E-05	4.3845E-14	3.2200E+11	1.7563E+06
Br-83	1.2431E-06	7.8690E-17	5.7094E+08	4.5996E+04

Deposition Recirculating

Time (h) = 24.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	3.9477E+14
Organic I (atoms)	0.0000E+00	1.2209E+13
Aerosols (kg)	0.0000E+00	2.4578E-08

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000 Pathway  
 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	3.0517E-04	3.7505E-12	2.6263E+13	1.1291E+07
Sr-89	2.2985E-05	7.9115E-13	5.3533E+12	8.5043E+05
I-131	9.2490E-02	7.4604E-10	3.4296E+15	3.4221E+09
I-132	1.0396E-04	1.0071E-14	4.5947E+10	3.8464E+06

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-133	8.8525E-02	7.8146E-11	3.5384E+14	3.2754E+09
I-134	1.2388E-09	4.6438E-20	2.0870E+05	4.5836E+01
I-135	1.4922E-02	4.2489E-12	1.8954E+13	5.5210E+08
Cs-134	3.2904E-02	2.5431E-08	1.1429E+17	1.2174E+09
Cs-136	9.0058E-03	1.2288E-10	5.4410E+14	3.3321E+08
Cs-137	1.7783E-02	2.0444E-07	8.9868E+17	6.5797E+08
I-130	1.3127E-03	6.7305E-13	3.1178E+12	4.8569E+07
Cs-134m	2.5664E-05	3.1824E-15	1.4302E+10	9.4956E+05
Ba-137m	1.9713E-02	3.6655E-14	1.6112E+11	7.2938E+08
Br-82	4.4421E-04	4.1031E-13	3.0133E+12	1.6436E+07
Br-83	1.1633E-05	7.3638E-16	5.3429E+09	4.3043E+05

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.6943E+15
Organic I (atoms)	1.1426E+14
Aerosols (kg)	2.3000E-07

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Total Filter Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	3.3778E-04	4.1513E-12	2.9069E+13	1.2498E+07
Sr-89	2.5441E-05	8.7569E-13	5.9253E+12	9.4131E+05
I-131	1.0237E-01	8.2576E-10	3.7960E+15	3.7878E+09
I-132	1.1507E-04	1.1147E-14	5.0857E+10	4.2574E+06
I-133	9.7984E-02	8.6497E-11	3.9165E+14	3.6254E+09
I-134	1.3712E-09	5.1401E-20	2.3100E+05	5.0734E+01
I-135	1.6516E-02	4.7029E-12	2.0979E+13	6.1109E+08
Cs-134	3.6420E-02	2.8149E-08	1.2651E+17	1.3475E+09
Cs-136	9.9681E-03	1.3601E-10	6.0225E+14	3.6882E+08
Cs-137	1.9683E-02	2.2629E-07	9.9472E+17	7.2828E+08
I-130	1.4529E-03	7.4497E-13	3.4510E+12	5.3759E+07
Cs-134m	2.8406E-05	3.5225E-15	1.5830E+10	1.0510E+06
Ba-137m	2.1819E-02	4.0572E-14	1.7834E+11	8.0732E+08
Br-82	4.9168E-04	4.5415E-13	3.3353E+12	1.8192E+07
Br-83	1.2876E-05	8.1507E-16	5.9138E+09	4.7642E+05

## SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	3.7244E+01	4.5772E-07	3.2052E+18	1.3780E+12
Sr-89	2.8051E+00	9.6554E-08	6.5333E+17	1.0379E+11
I-131	1.1288E+04	9.1048E-05	4.1855E+20	4.1764E+14
I-132	1.2687E+01	1.2291E-09	5.6075E+15	4.6943E+11
I-133	1.0804E+04	9.5372E-06	4.3184E+19	3.9974E+14
I-134	1.5119E-04	5.6675E-15	2.5470E+10	5.5940E+06
I-135	1.8211E+03	5.1855E-07	2.3132E+18	6.7379E+13
Xe-133	1.9817E+03	1.0587E-05	4.7938E+19	7.3324E+13
Xe-135	4.8075E+03	1.8826E-06	8.3978E+18	1.7788E+14
Cs-134	4.0157E+03	3.1037E-03	1.3949E+22	1.4858E+14
Cs-136	1.0991E+03	1.4996E-05	6.6404E+19	4.0666E+13
Cs-137	2.1703E+03	2.4951E-02	1.0968E+23	8.0301E+13

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-130	1.6020E+02	8.2140E-08	3.8051E+17	5.9274E+12
Kr-83m	5.3595E+00	2.5976E-10	1.8847E+15	1.9830E+11
Xe-131m	7.4012E+00	8.8361E-08	4.0620E+17	2.7384E+11
Xe-133m	1.2761E+02	2.8441E-07	1.2878E+18	4.7218E+12
Xe-135m	2.9970E+02	3.2901E-09	1.4676E+16	1.1089E+13
Cs-134m	3.1321E+00	3.8839E-10	1.7455E+15	1.1589E+11
Ba-137m	2.4058E+03	4.4734E-09	1.9664E+16	8.9015E+13
Br-82	5.4213E+01	5.0075E-08	3.6775E+17	2.0059E+12
Br-83	1.4197E+00	8.9870E-11	6.5206E+14	5.2531E+10

SGs Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 24.0000			
Noble gases (atoms)	5.8046E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.5086E+20	0.0000E+00	0.0000E+00
Organic I (atoms)	1.3944E+19	0.0000E+00	0.0000E+00
Aerosols (kg)	2.8070E-02	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 24.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 96.0000

EAB Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 96.0000				
Delta dose (rem)	1.6298E-06	1.0292E-37	2.7820E-06	1.6298E-06
Accumulated dose (rem)	1.2534E-01	6.3044E+01	1.9341E-01	3.0209E+00

LPZ Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 96.0000				
Delta dose (rem)	2.6216E-08	1.6556E-39	4.4749E-08	2.6216E-08
Accumulated dose (rem)	8.2110E-03	3.8393E+00	1.2679E-02	1.8440E-01

Control Room Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 96.0000				
Delta dose (rem)	7.9779E-05	2.5969E-34	4.6102E-03	7.9779E-05
Accumulated dose (rem)	1.9536E-03	9.5310E+00	1.1024E-01	4.3813E-01

PCS Compartment Atmosphere Nuclide Inventory:

	Ci	kg	Atoms	Bq
Time (h) = 96.0000				
Rb-86	6.1030E+03	7.5006E-05	5.2523E+20	2.2581E+14
Sr-89	4.9312E+02	1.6974E-05	1.1485E+20	1.8246E+13
I-131	1.5965E+06	1.2878E-02	5.9199E+22	5.9071E+16
I-132	8.7641E-07	8.4906E-17	3.8736E+08	3.2427E+04
I-133	1.7965E+05	1.5859E-04	7.1809E+20	6.6472E+15
I-135	1.7548E+02	4.9967E-08	2.2289E+17	6.4926E+12



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-133	4.7373E+05	2.5309E-03	1.1460E+22	1.7528E+16
Xe-135	6.8585E+03	2.6857E-06	1.1980E+19	2.5376E+14
Cs-134	7.3358E+05	5.6699E-01	2.5481E+24	2.7143E+16
Cs-136	1.7178E+05	2.3439E-03	1.0379E+22	6.3560E+15
Cs-137	3.9749E+05	4.5698E+00	2.0087E+25	1.4707E+16
I-130	5.1759E+02	2.6538E-07	1.2294E+18	1.9151E+13
Kr-83m	9.5101E-07	4.6094E-17	3.3444E+08	3.5187E+04
Xe-131m	4.3687E+03	5.2157E-05	2.3977E+20	1.6164E+14
Xe-133m	2.0175E+04	4.4962E-05	2.0358E+20	7.4647E+14
Xe-135m	2.8879E+01	3.1703E-10	1.4142E+15	1.0685E+12
Cs-134m	1.9270E-05	2.3895E-15	1.0739E+10	7.1298E+05
Ba-137m	4.4062E+05	8.1931E-07	3.6014E+18	1.6303E+16
Br-82	2.4154E+03	2.2311E-06	1.6385E+19	8.9371E+13
Br-83	2.2203E-07	1.4055E-17	1.0197E+08	8.2152E+03

PCS Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 96.0000			
Noble gases (atoms)	1.1915E+22	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.8137E+22	0.0000E+00	0.0000E+00
Organic I (atoms)	1.7981E+21	0.0000E+00	0.0000E+00
Aerosols (kg)	5.1392E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 96.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 96.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	4.9732E+01	2.6569E-07	1.2030E+18	1.8401E+12
Xe-135	7.2001E-01	2.8195E-10	1.2577E+15	2.6640E+10
Xe-131m	4.5863E-01	5.4755E-09	2.5171E+16	1.6969E+10
Xe-133m	2.1180E+00	4.7202E-09	2.1372E+16	7.8364E+10
Xe-135m	3.0309E-03	3.3273E-14	1.4843E+11	1.1214E+08

Environment Transport Group Inventory:

Time (h) = 96.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.6354E+10	3.6603E+08	1.2508E+18
Elemental I (atoms)	0.0000E+00	0.0000E+00	6.1004E+18
Organic I (atoms)	0.0000E+00	0.0000E+00	1.8867E+17
Aerosols (kg)	0.0000E+00	0.0000E+00	5.3926E-04

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 96.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	2.7299E-04	3.3550E-12	2.3493E+13	1.0101E+07
Sr-89	2.2057E-05	7.5923E-13	5.1373E+12	8.1612E+05
I-131	7.1412E-02	5.7602E-10	2.6480E+15	2.6422E+09

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-133	8.0360E-03	7.0938E-12	3.2120E+13	2.9733E+08
I-135	7.8491E-06	2.2350E-15	9.9701E+09	2.9042E+05
Cs-134	3.2813E-02	2.5361E-08	1.1398E+17	1.2141E+09
Cs-136	7.6839E-03	1.0484E-10	4.6424E+14	2.8430E+08
Cs-137	1.7780E-02	2.0441E-07	8.9851E+17	6.5785E+08
I-130	2.3152E-05	1.1871E-14	5.4989E+10	8.5661E+05
Ba-137m	1.9709E-02	3.6648E-14	1.6109E+11	7.2924E+08
Br-82	1.0804E-04	9.9795E-14	7.3290E+11	3.9975E+06

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.6005E+15
Organic I (atoms)	8.0427E+13
Aerosols (kg)	2.2988E-07

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	2.0727E-05	1.1073E-13	5.0139E+11	7.6691E+05
Xe-135	2.6818E-07	1.0501E-16	4.6845E+08	9.9226E+03
Xe-131m	9.1747E-07	1.0953E-14	5.0354E+10	3.3947E+04
Xe-133m	1.4790E-06	3.2961E-15	1.4925E+10	5.4722E+04
Xe-135m	7.6667E-07	8.4164E-18	3.7544E+07	2.8367E+04

## Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 96.0000			
Noble gases (atoms)	5.6718E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

## Recirculating Filter Inventory

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	2.9171E-05	3.5852E-13	2.5105E+12	1.0793E+06
Sr-89	2.3570E-06	8.1131E-14	5.4897E+11	8.7211E+04
I-131	7.6310E-03	6.1553E-11	2.8296E+14	2.8235E+08
I-133	8.5872E-04	7.5804E-13	3.4324E+12	3.1773E+07
I-135	8.3875E-07	2.3883E-16	1.0654E+09	3.1034E+04
Cs-134	3.5064E-03	2.7101E-09	1.2180E+16	1.2974E+08
Cs-136	8.2110E-04	1.1203E-11	4.9609E+13	3.0381E+07

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-137	1.8999E-03	2.1843E-08	9.6015E+16	7.0297E+07
I-130	2.4740E-06	1.2685E-15	5.8761E+09	9.1537E+04
Ba-137m	2.1061E-03	3.9162E-15	1.7214E+10	7.7926E+07
Br-82	1.1545E-05	1.0664E-14	7.8318E+10	4.2718E+05

	Deposition Recirculating	
Time (h) = 96.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.7789E+14
Organic I (atoms)	0.0000E+00	8.5944E+12
Aerosols (kg)	0.0000E+00	2.4565E-08

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	2.7299E-04	3.3550E-12	2.3493E+13	1.0101E+07
Sr-89	2.2057E-05	7.5923E-13	5.1373E+12	8.1612E+05
I-131	7.1412E-02	5.7602E-10	2.6480E+15	2.6422E+09
I-133	8.0360E-03	7.0938E-12	3.2120E+13	2.9733E+08
I-135	7.8491E-06	2.2350E-15	9.9701E+09	2.9042E+05
Cs-134	3.2813E-02	2.5361E-08	1.1398E+17	1.2141E+09
Cs-136	7.6839E-03	1.0484E-10	4.6424E+14	2.8430E+08
Cs-137	1.7780E-02	2.0441E-07	8.9851E+17	6.5785E+08
I-130	2.3152E-05	1.1871E-14	5.4989E+10	8.5661E+05
Ba-137m	1.9709E-02	3.6648E-14	1.6109E+11	7.2924E+08
Br-82	1.0804E-04	9.9795E-14	7.3290E+11	3.9975E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.6005E+15
Organic I (atoms)	8.0427E+13
Aerosols (kg)	2.2988E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	3.0216E-04	3.7135E-12	2.6004E+13	1.1180E+07
Sr-89	2.4414E-05	8.4036E-13	5.6863E+12	9.0333E+05
I-131	7.9043E-02	6.3757E-10	2.9309E+15	2.9246E+09
I-133	8.8947E-03	7.8519E-12	3.5553E+13	3.2910E+08
I-135	8.6878E-06	2.4739E-15	1.1035E+10	3.2145E+05
Cs-134	3.6320E-02	2.8071E-08	1.2616E+17	1.3438E+09
Cs-136	8.5050E-03	1.1604E-10	5.1385E+14	3.1469E+08

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-137	1.9680E-02	2.2625E-07	9.9453E+17	7.2814E+08
I-130	2.5626E-05	1.3139E-14	6.0865E+10	9.4815E+05
Ba-137m	2.1815E-02	4.0564E-14	1.7831E+11	8.0717E+08
Br-82	1.1959E-04	1.1046E-13	8.1122E+11	4.4247E+06

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	3.3316E+01	4.0945E-07	2.8672E+18	1.2327E+12
Sr-89	2.6919E+00	9.2659E-08	6.2697E+17	9.9602E+10
I-131	8.7152E+03	7.0299E-05	3.2317E+20	3.2246E+14
I-132	4.7843E-09	4.6350E-19	2.1146E+06	1.7702E+02
I-133	9.8073E+02	8.6575E-07	3.9200E+18	3.6287E+13
I-135	9.5792E-01	2.7277E-10	1.2168E+15	3.5443E+10
Xe-133	2.5861E+03	1.3816E-05	6.2557E+19	9.5685E+13
Xe-135	3.7440E+01	1.4661E-08	6.5401E+16	1.3853E+12
Cs-134	4.0046E+03	3.0952E-03	1.3910E+22	1.4817E+14
Cs-136	9.3776E+02	1.2795E-05	5.6657E+19	3.4697E+13
Cs-137	2.1699E+03	2.4946E-02	1.0966E+23	8.0285E+13
I-130	2.8255E+00	1.4487E-09	6.7110E+15	1.0454E+11
Kr-83m	5.1915E-09	2.5162E-19	1.8257E+06	1.9209E+02
Xe-131m	2.3849E+01	2.8472E-07	1.3089E+18	8.8241E+11
Xe-133m	1.1013E+02	2.4545E-07	1.1114E+18	4.0749E+12
Xe-135m	1.5765E-01	1.7306E-12	7.7201E+12	5.8330E+09
Cs-134m	1.0519E-07	1.3044E-17	5.8622E+07	3.8921E+03
Ba-137m	2.4054E+03	4.4726E-09	1.9660E+16	8.8998E+13
Br-82	1.3186E+01	1.2179E-08	8.9445E+16	4.8787E+11
Br-83	1.2121E-09	7.6724E-20	5.5668E+05	4.4846E+01

SGs Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	6.5043E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.1737E+20	0.0000E+00	0.0000E+00
Organic I (atoms)	9.8155E+18	0.0000E+00	0.0000E+00
Aerosols (kg)	2.8055E-02	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Deposition Recirculating	
	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 720.0000

EAB Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	6.0203E-09	2.5429E-185	2.2930E-08	6.0203E-09
Accumulated dose (rem)	1.2534E-01	6.3044E+01	1.9341E-01	3.0209E+00

LPZ Doses:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.8370E-11	1.1983E-187	1.0806E-10	2.8370E-11
Accumulated dose (rem)	8.2110E-03	3.8393E+00	1.2679E-02	1.8440E-01

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.9647E-07	4.2775E-182	2.5333E-05	1.9647E-07
Accumulated dose (rem)	1.9538E-03	9.5310E+00	1.1026E-01	4.3813E-01

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	2.3233E+03	2.8553E-05	1.9994E+20	8.5962E+13
Sr-89	3.4512E+02	1.1879E-05	8.0380E+19	1.2769E+13
I-131	1.6970E+05	1.3688E-03	6.2927E+21	6.2790E+15
I-133	1.6732E-04	1.4770E-13	6.6878E+11	6.1907E+06
Xe-133	1.6880E+04	9.0179E-05	4.0833E+20	6.2456E+14
Cs-134	7.1624E+05	5.5358E-01	2.4879E+24	2.6501E+16
Cs-136	4.3403E+04	5.9220E-04	2.6223E+21	1.6059E+15
Cs-137	3.9683E+05	4.5623E+00	2.0054E+25	1.4683E+16
Xe-131m	5.1553E+03	6.1548E-05	2.8294E+20	1.9075E+14
Xe-133m	6.2465E+00	1.3921E-08	6.3033E+16	2.3112E+11
Ba-137m	4.3990E+05	8.1796E-07	3.5955E+18	1.6276E+16
Br-82	1.1526E-02	1.0646E-11	7.8185E+13	4.2645E+08

PCS Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	6.9133E+20	0.0000E+00	0.0000E+00
Elemental I (atoms)	6.1039E+21	0.0000E+00	0.0000E+00
Organic I (atoms)	1.8878E+20	0.0000E+00	0.0000E+00
Aerosols (kg)	5.1165E+00	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-131m	5.4121E-01	6.4614E-09	2.9703E+16	2.0025E+10

Environment Transport Group Inventory:

Time (h) = 720.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.4858E+08	3.4525E+06	7.2576E+16
Elemental I (atoms)	0.0000E+00	0.0000E+00	6.4049E+17
Organic I (atoms)	0.0000E+00	0.0000E+00	1.9809E+16
Aerosols (kg)	0.0000E+00	0.0000E+00	5.3688E-04

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	1.0392E-04	1.2772E-12	8.9434E+12	3.8451E+06
Sr-89	1.5437E-05	5.3136E-13	3.5954E+12	5.7118E+05
I-131	7.5908E-03	6.1229E-11	2.8147E+14	2.8086E+08
Cs-134	3.2037E-02	2.4762E-08	1.1128E+17	1.1854E+09
Cs-136	1.9414E-03	2.6489E-11	1.1729E+14	7.1832E+07
Cs-137	1.7750E-02	2.0407E-07	8.9704E+17	6.5677E+08
Ba-137m	1.9677E-02	3.6587E-14	1.6083E+11	7.2804E+08
Br-82	5.1555E-10	4.7620E-19	3.4972E+06	1.9075E+01

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.7303E+14
Organic I (atoms)	8.4441E+12
Aerosols (kg)	2.2886E-07

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-131m	9.7524E-08	1.1643E-15	5.3524E+09	3.6084E+03

## Control Room Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	5.3524E+09	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

## Recirculating Filter Inventory

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	1.1105E-05	1.3648E-13	9.5569E+11	4.1088E+05
Sr-89	1.6496E-06	5.6781E-14	3.8420E+11	6.1036E+04
I-131	8.1115E-04	6.5429E-12	3.0078E+13	3.0013E+07
Cs-134	3.4235E-03	2.6460E-09	1.1892E+16	1.2667E+08
Cs-136	2.0746E-04	2.8306E-12	1.2534E+13	7.6760E+06
Cs-137	1.8968E-03	2.1807E-08	9.5857E+16	7.0182E+07
Ba-137m	2.1027E-03	3.9097E-15	1.7186E+10	7.7798E+07

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Br-82 5.5091E-11 5.0886E-20 3.7371E+05 2.0384E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 720.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.9176E+13
Organic I (atoms)	0.0000E+00	9.0234E+11
Aerosols (kg)	0.0000E+00	2.4456E-08

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 720.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	1.0392E-04	1.2772E-12	8.9434E+12	3.8451E+06
Sr-89	1.5437E-05	5.3136E-13	3.5954E+12	5.7118E+05
I-131	7.5908E-03	6.1229E-11	2.8147E+14	2.8086E+08
Cs-134	3.2037E-02	2.4762E-08	1.1128E+17	1.1854E+09
Cs-136	1.9414E-03	2.6489E-11	1.1729E+14	7.1832E+07
Cs-137	1.7750E-02	2.0407E-07	8.9704E+17	6.5677E+08
Ba-137m	1.9677E-02	3.6587E-14	1.6083E+11	7.2804E+08
Br-82	5.1555E-10	4.7620E-19	3.4972E+06	1.9075E+01

Control Room Filtered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 720.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.7303E+14
Organic I (atoms)	8.4441E+12
Aerosols (kg)	2.2886E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway Filter
Time (h) = 720.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway Filter
Time (h) = 720.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	1.1503E-04	1.4137E-12	9.8991E+12	4.2560E+06
Sr-89	1.7087E-05	5.8814E-13	3.9796E+12	6.3221E+05
I-131	8.4020E-03	6.7772E-11	3.1155E+14	3.1087E+08
Cs-134	3.5461E-02	2.7408E-08	1.2317E+17	1.3121E+09
Cs-136	2.1489E-03	2.9320E-11	1.2983E+14	7.9508E+07
Cs-137	1.9647E-02	2.2588E-07	9.9289E+17	7.2695E+08
Ba-137m	2.1779E-02	4.0497E-14	1.7801E+11	8.0584E+08
Br-82	5.7064E-10	5.2708E-19	3.8709E+06	2.1114E+01

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	1.2683E+01	1.5587E-07	1.0915E+18	4.6926E+11

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Sr-89	1.8840E+00	6.4849E-08	4.3879E+17	6.9708E+10
I-131	9.2640E+02	7.4725E-06	3.4352E+19	3.4277E+13
I-133	9.1338E-07	8.0629E-16	3.6508E+09	3.3795E+04
Xe-133	9.2147E+01	4.9229E-07	2.2290E+18	3.4094E+12
Cs-134	3.9099E+03	3.0220E-03	1.3581E+22	1.4467E+14
Cs-136	2.3694E+02	3.2328E-06	1.4315E+19	8.7666E+12
Cs-137	2.1663E+03	2.4905E-02	1.0948E+23	8.0153E+13
Xe-131m	2.8143E+01	3.3599E-07	1.5446E+18	1.0413E+12
Xe-133m	3.4099E-02	7.5995E-11	3.4410E+14	1.2617E+09
Ba-137m	2.4014E+03	4.4652E-09	1.9628E+16	8.8852E+13
Br-82	6.2919E-05	5.8116E-14	4.2681E+11	2.3280E+06

SGs Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 720.0000			
Noble gases (atoms)	3.7739E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.3321E+19	0.0000E+00	0.0000E+00
Organic I (atoms)	1.0305E+18	0.0000E+00	0.0000E+00
Aerosols (kg)	2.7931E-02	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 720.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 720.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway Filter
Time (h) = 720.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

-----  
Transport Group Totals in Model:  
-----

Noble Gases (atoms)	6.9518E+20
Elemental I (atoms)	6.1379E+21
Organic I (atoms)	1.8983E+20
Aerosols (kg)	5.1449E+00

-----

37004

#####  
I-131 Summary  
#####

Time (hr)	PCS I-131 (Curies)	Environment I-131 (Curies)	Control Room I-131 (Curies)
0.000	2.2440E+04	3.2121E-14	1.2336E-16
0.000	2.2440E+06	3.2121E-08	1.2336E-10
0.025	2.2662E+06	6.0572E-03	2.3139E-05
0.300	2.2635E+06	8.7174E-01	5.1650E-03
0.306	2.2635E+06	9.0430E-01	5.3480E-03
0.333	2.2632E+06	9.8328E-01	5.5879E-03
0.500	2.2616E+06	1.6050E+00	2.5812E-03
0.760	2.2591E+06	2.8229E+00	8.1736E-04
1.020	2.2566E+06	4.5394E+00	3.2409E-04
1.280	2.2540E+06	6.7528E+00	2.0326E-04



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

1.540	2.2515E+06	9.4613E+00	1.9155E-04
1.800	2.2490E+06	1.2663E+01	2.1177E-04
2.000	2.2471E+06	1.5460E+01	2.3410E-04
2.260	2.2446E+06	1.9528E+01	2.2953E-04
2.520	2.2421E+06	2.4084E+01	2.4730E-04
2.780	2.2396E+06	2.9126E+01	2.7157E-04
3.040	2.2371E+06	3.4650E+01	2.9766E-04
3.300	2.2346E+06	4.0655E+01	3.2424E-04
3.560	2.2321E+06	4.7139E+01	3.5089E-04
3.820	2.2296E+06	5.4100E+01	3.7751E-04
4.080	2.2272E+06	6.1536E+01	4.0404E-04
4.340	2.2247E+06	6.9445E+01	4.3050E-04
4.600	2.2222E+06	7.7825E+01	4.5687E-04
4.860	2.2197E+06	8.6673E+01	4.8315E-04
5.120	2.2173E+06	9.5988E+01	5.0934E-04
5.380	2.2148E+06	1.0577E+02	5.3545E-04
5.640	2.2123E+06	1.1601E+02	5.6147E-04
5.900	2.2099E+06	1.2671E+02	5.8740E-04
6.160	2.2074E+06	1.3788E+02	6.1325E-04
6.420	2.2049E+06	1.4949E+02	6.3901E-04
6.680	2.2025E+06	1.6157E+02	6.6468E-04
6.940	2.2000E+06	1.7409E+02	6.9027E-04
7.200	2.1976E+06	1.8707E+02	7.1577E-04
7.460	2.1951E+06	2.0050E+02	7.4119E-04
7.720	2.1927E+06	2.1437E+02	7.6652E-04
7.980	2.1902E+06	2.2868E+02	7.9177E-04
8.000	2.1901E+06	2.2980E+02	7.9371E-04
8.260	2.1880E+06	2.2959E+02	2.3272E-04
8.520	2.1860E+06	2.2938E+02	6.8234E-05
8.780	2.1839E+06	2.2916E+02	2.0007E-05
9.040	2.1819E+06	2.2895E+02	5.8660E-06
9.300	2.1798E+06	2.2873E+02	1.7200E-06
9.560	2.1778E+06	2.2852E+02	5.0430E-07
9.820	2.1758E+06	2.2831E+02	1.4786E-07
10.080	2.1738E+06	2.2809E+02	4.3354E-08
24.000	2.0677E+06	2.1697E+02	1.2888E-36
96.000	1.5965E+06	1.6752E+02	3.6105-184
720.000	1.6970E+05	1.7807E+01	0.0000E+00

SGs	
Time (hr)	I-131 (Curies)
0.000	7.7819E-06
0.000	7.7819E-02
0.025	3.9209E+01
0.300	4.7007E+02
0.306	4.7875E+02
0.333	5.2217E+02
0.500	7.8273E+02
0.760	1.1882E+03
1.020	1.5923E+03
1.280	1.9951E+03
1.540	2.3966E+03
1.800	2.7967E+03
2.000	3.1037E+03
2.260	3.5015E+03
2.520	3.8980E+03
2.780	4.2932E+03
3.040	4.6871E+03
3.300	5.0797E+03
3.560	5.4709E+03
3.820	5.8609E+03
4.080	6.2496E+03
4.340	6.6370E+03
4.600	7.0231E+03
4.860	7.4080E+03
5.120	7.7915E+03
5.380	8.1738E+03
5.640	8.5548E+03
5.900	8.9345E+03
6.160	9.3130E+03
6.420	9.6902E+03
6.680	1.0066E+04
6.940	1.0441E+04

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

7.200	1.0814E+04
7.460	1.1186E+04
7.720	1.1557E+04
7.980	1.1927E+04
8.000	1.1955E+04
8.260	1.1944E+04
8.520	1.1933E+04
8.780	1.1922E+04
9.040	1.1911E+04
9.300	1.1900E+04
9.560	1.1889E+04
9.820	1.1878E+04
10.080	1.1866E+04
24.000	1.1288E+04
96.000	8.7152E+03
720.000	9.2640E+02

#####  
 Cumulative Dose Summary  
 #####

Time (hr)	EAB		LPZ		Control Room	
	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)
0.000	9.2319E-15	4.9249E-16	1.1407E-15	6.0853E-17	1.1640E-19	5.3260E-21
0.000	9.2319E-09	4.9249E-10	1.1407E-09	6.0853E-11	5.8205E-12	2.6632E-13
0.025	1.7409E-03	9.2778E-05	2.1510E-04	1.1464E-05	4.4515E-04	2.0366E-05
0.300	2.5000E-01	1.3054E-02	3.0891E-02	1.6129E-03	9.9517E-01	4.5444E-02
0.306	2.5933E-01	1.3535E-02	3.2043E-02	1.6725E-03	1.0501E+00	4.7949E-02
0.333	2.8196E-01	1.4703E-02	3.4840E-02	1.8167E-03	1.3351E+00	6.0955E-02
0.500	4.5990E-01	2.3811E-02	5.6827E-02	2.9421E-03	2.5525E+00	1.1648E-01
0.760	8.0762E-01	4.1356E-02	9.9792E-02	5.1100E-03	3.2930E+00	1.5023E-01
1.020	1.2963E+00	6.5698E-02	1.6017E-01	8.1177E-03	3.5445E+00	1.6169E-01
1.280	1.9247E+00	9.6701E-02	2.3782E-01	1.1949E-02	3.6646E+00	1.6716E-01
1.540	2.6916E+00	1.3426E-01	3.3258E-01	1.6590E-02	3.7576E+00	1.7140E-01
1.800	3.5958E+00	1.7829E-01	4.4430E-01	2.2030E-02	3.8539E+00	1.7579E-01
2.000	4.3839E+00	2.1653E-01	5.4168E-01	2.6754E-02	3.9360E+00	1.7953E-01
2.260	5.5280E+00	2.7185E-01	6.0600E-01	2.9864E-02	4.0454E+00	1.8452E-01
2.520	6.8060E+00	3.3347E-01	6.7784E-01	3.3328E-02	4.1586E+00	1.8969E-01
2.780	8.2168E+00	4.0133E-01	7.5715E-01	3.7143E-02	4.2818E+00	1.9532E-01
3.040	9.7593E+00	4.7540E-01	8.4386E-01	4.1307E-02	4.4167E+00	2.0149E-01
3.300	1.1432E+01	5.5561E-01	9.3792E-01	4.5816E-02	4.5637E+00	2.0822E-01
3.560	1.3235E+01	6.4194E-01	1.0393E+00	5.0669E-02	4.7229E+00	2.1550E-01
3.820	1.5166E+01	7.3433E-01	1.1478E+00	5.5863E-02	4.8943E+00	2.2335E-01
4.080	1.7225E+01	8.3274E-01	1.2635E+00	6.1395E-02	5.0776E+00	2.3176E-01
4.340	1.9410E+01	9.3715E-01	1.3864E+00	6.7264E-02	5.2729E+00	2.4072E-01
4.600	2.1720E+01	1.0475E+00	1.5162E+00	7.3467E-02	5.4800E+00	2.5023E-01
4.860	2.4155E+01	1.1637E+00	1.6531E+00	8.0003E-02	5.6989E+00	2.6029E-01
5.120	2.6713E+01	1.2859E+00	1.7969E+00	8.6868E-02	5.9295E+00	2.7090E-01
5.380	2.9394E+01	1.4138E+00	1.9476E+00	9.4061E-02	6.1716E+00	2.8204E-01
5.640	3.2196E+01	1.5476E+00	2.1051E+00	1.0158E-01	6.4252E+00	2.9373E-01
5.900	3.5119E+01	1.6871E+00	2.2695E+00	1.0942E-01	6.6902E+00	3.0595E-01
6.160	3.8162E+01	1.8323E+00	2.4405E+00	1.1759E-01	6.9666E+00	3.1870E-01
6.420	4.1324E+01	1.9833E+00	2.6183E+00	1.2607E-01	7.2541E+00	3.3198E-01
6.680	4.4603E+01	2.1399E+00	2.8026E+00	1.3488E-01	7.5528E+00	3.4579E-01
6.940	4.8000E+01	2.3021E+00	2.9936E+00	1.4399E-01	7.8626E+00	3.6012E-01
7.200	5.1514E+01	2.4699E+00	3.1911E+00	1.5343E-01	8.1833E+00	3.7497E-01
7.460	5.5142E+01	2.6432E+00	3.3951E+00	1.6317E-01	8.5150E+00	3.9034E-01
7.720	5.8886E+01	2.8221E+00	3.6055E+00	1.7323E-01	8.8575E+00	4.0622E-01
7.980	6.2743E+01	3.0065E+00	3.8223E+00	1.8359E-01	9.2107E+00	4.2261E-01
8.000	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.2384E+00	4.2389E-01
8.260	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.4454E+00	4.3352E-01
8.520	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5060E+00	4.3635E-01
8.780	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5237E+00	4.3719E-01
9.040	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5289E+00	4.3745E-01
9.300	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5304E+00	4.3754E-01
9.560	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5309E+00	4.3758E-01
9.820	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5310E+00	4.3760E-01
10.080	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5310E+00	4.3762E-01
24.000	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5310E+00	4.3805E-01
96.000	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5310E+00	4.3813E-01
720.000	6.3044E+01	3.0209E+00	3.8393E+00	1.8440E-01	9.5310E+00	4.3813E-01

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

#####  
Worst Two-Hour Dose  
(Provided for Dose Location 1)  
#####

EAB

Time (hr)	Whole Body (rem)	Thyroid (rem)	Skin (rem)	TEDE (rem)
6.0	4.2531E-02	2.6755E+01	6.6347E-02	1.2780E+00

#####  
30 Day Control Room Skin Dose  
#####

Control Room

Time (hr)	Skin (rem)
720.0	1.1026E-01

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Attachment 7 Secondary Side Release FCM Iodine Release Dose

```
#####
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:29:01
#####
#####
File information
#####
```

```
Plant file name      = AST/CRE/pal_CRE_FCM_sec_iodine_db_ast.psf
Inventory file name  = AST/CRE/palisades_loca_db_ast.nif
Scenario file name   = AST/CRE/pal_CRE_FCM_sec_iodine_db_ast.psf
Release file name    = AST/CRE/pal_cre_fcm_sec_iodine_ast.rft
Dose conversion file name = AST/CRE/nai-1101-001rev0.dcf
```

```
#####      #####      #####      # # #      #####      # # #      #####
# # #      # # #      # # #      # # #      # # #      # # #      # # #
# # #      # # #      # # #      # # #      # # #      # # #      # # #
#####      #####      #####      # # #      #####      # # #      # # #
# # #      # # #      # # #      # # #      # # #      # # #      # # #
# # #      # # #      # # #      # # #      # # #      # # #      # # #
# # #      # # #      # # #      # # #      # # #      # # #      # # #
```

```
*RADTRAD-NAI 1.1a(QA)
*18 May 2006 13:28:47
** Palisades CRE Design Basis
** FCM Secondary Release Iodine Dose
**
*Nuclide inventory file
AST/CRE/palisades_loca_db_ast.nif
*Plant power
27.5706
*Compartments
4
*Compartment 1:
PCS
3
432976.8
0
0
0
0
*Compartment 2:
Environment
2
2e+20
0
0
0
0
*Compartment 3:
Control Room
1
35923
0
1
0
0
*Compartment 4:
SGs
3
282130
0
0
0
0
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
*Pathways
6
*Pathway 1:
SG Tube Leakage
1
4
2
*Pathway 2:
Control Room Unfiltered Makeup
2
3
2
*Pathway 3:
Control Room Filtered Makeup
2
3
2
*Pathway 4:
Control Room Unfiltered Inleakage
2
3
2
*Pathway 5:
Control Room Exhaust
3
2
2
*Pathway 6:
SRV/ADV Steam Release
4
2
2
*Sources
4
1 1
2 0
3 0
4 0
*dose conversion factors filename
AST/CRE/nai-1101-001rev0.dcf
*release fraction and timing filename
AST/CRE/pal_cre_fcm_sec_iodine_ast.rft
0
1
1
*Iodine
0 0.97 0.03
*Overlying pool
*aerosol model
0
*elemental model
0
*organic model
0
*pH tracking
0
*Compartment detail
*Compartment 1:
1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Compartment 2:
1
*spray model
0
0
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
0
*filter model
0
*deposition model
0
0
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Compartment 4:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
*Pathways:
*Pathway 1
*filter efficiency model
  1
  3
0 5.005 0 0 0
8 0 0 0 0
720 0 0 0 0
*Pathway 2
*filter efficiency model
  1
  4
0 384.2 0 0 0
0.025 660 0 0 0
0.3333 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
  1
  3
0 0 99 99 99
0.3333 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
  1
  3
0 0 0 0 0
0.3333 10 0 0 0
720 10 0 0 0
*Pathway 5
*filter efficiency model
  1
  4
0 384.2 0 0 0
0.025 660 0 0 0
0.3333 1423.6 0 0 0
720 1423.6 0 0 0
*Pathway 6
*filter efficiency model
  1
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
5
0 58.45 0 0 0
0.305556 26.86 0 0 0
0.5 22.38 0 0 0
8 0 0 0 0
720 0 0 0 0
*x/q tables
4
EAB
2
0 0.000539
720 0.000539
LPZ
6
0 6.66e-05
2 3.03e-05
8 2.04e-05
24 8.67e-06
96 2.54e-06
720 2.54e-06
Control Room Unfiltered
7
0 0.0211
0.305556 0.0165
2 0.0134
8 0.0054
24 0.00403
96 0.00298
720 0.00298
Control Room Filtered
7
0 0.000796
0.305556 0.000736
2 0.000642
8 0.000243
24 0.000175
96 0.000128
720 0.000128
*dose locations
3
*location name, compartment number and x/q table
EAB
2
1
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
LPZ
2
2
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
Control Room
3
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```

0
*br model
  1
  2
0 0.00035
720 0.00035
*of model
  1
  4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
  1
*number of intake combinations
  3
*intake combinations
2 6 3
3 6 4
4 6 3
*time step count
  3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
  1
  1
  1
  0
  1

#####
      RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:29:01
#####

#####
      Plant Description
#####

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth
Plant Power Level = 2.7571E+01 MWth

Number of compartments = 4

Compartment information

Compartment number 1 (Source term fraction = 1.0000E+00)
Name: PCS
Compartment volume = 4.3298E+05 (Cubic feet)
Pathways into and out of compartment 1
  Pathway to compartment number 4: SG Tube Leakage

Compartment number 2
Name: Environment
Pathways into and out of compartment 2
  Pathway to compartment number 3: Control Room Unfiltered Makeup
  Pathway to compartment number 3: Control Room Filtered Makeup
  Pathway to compartment number 3: Control Room Unfiltered Inleakage
  Pathway from compartment number 3: Control Room Exhaust
  Pathway from compartment number 4: SRV/ADV Steam Release

Compartment number 3
Name: Control Room
Compartment volume = 3.5923E+04 (Cubic feet)
Removal devices within compartment:
  Filter(s)
Pathways into and out of compartment 3
  Pathway to compartment number 2: Control Room Exhaust
  Pathway from compartment number 2: Control Room Unfiltered Makeup

```



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Pathway from compartment number 2: Control Room Filtered Makeup  
 Pathway from compartment number 2: Control Room Unfiltered Inleakage

Compartment number 4  
 Name: SGs  
 Compartment volume = 2.8213E+05 (Cubic feet)  
 Pathways into and out of compartment 4  
     Pathway to compartment number 2: SRV/ADV Steam Release  
     Pathway from compartment number 1: SG Tube Leakage

Total number of pathways = 6

```
#####
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:29:01
#####
#####
Scenario Description
#####
```

Radioactive Decay is enabled  
 Calculation of Daughters is enabled

Iodine fractions  
     Aerosol = 0.0000E+00  
     Elemental = 9.7000E-01  
     Organic = 3.0000E-02

COMPARTMENT DATA

Compartment number 1: PCS  
 Compartment number 2: Environment  
 Compartment number 3: Control Room

Compartment Filter Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Compartment number 4: SGs

PATHWAY DATA

Pathway number 1: SG Tube Leakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	5.0050E+00	0.0000E+00	0.0000E+00	0.0000E+00
8.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
3.3330E-01	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	6.6000E+02	0.0000E+00	0.0000E+00	0.0000E+00
3.3330E-01	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 6: SRV/ADV Steam Release

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	5.8450E+01	0.0000E+00	0.0000E+00	0.0000E+00
3.0556E-01	2.6860E+01	0.0000E+00	0.0000E+00	0.0000E+00
5.0000E-01	2.2380E+01	0.0000E+00	0.0000E+00	0.0000E+00
8.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

X/Q DATA

X/Q table 1: EAB

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	5.3900E-04
7.2000E+02	5.3900E-04

X/Q table 2: LPZ

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

X/Q table 3: Control Room Unfiltered

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	2.1100E-02
3.0556E-01	1.6500E-02
2.0000E+00	1.3400E-02
8.0000E+00	5.4000E-03
2.4000E+01	4.0300E-03
9.6000E+01	2.9800E-03
7.2000E+02	2.9800E-03

X/Q table 4: Control Room Filtered

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	7.9600E-04
3.0556E-01	7.3600E-04
2.0000E+00	6.4200E-04
8.0000E+00	2.4300E-04
2.4000E+01	1.7500E-04

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

9.6000E+01 1.2800E-04
7.2000E+02 1.2800E-04

LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

Location Breathing Rate Data

Time (hr) Breathing Rate (m^3 \* sec^-1)
0.0000E+00 3.5000E-04
8.0000E+00 1.8000E-04
2.4000E+01 2.3000E-04
7.2000E+02 2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

Location Breathing Rate Data

Time (hr) Breathing Rate (m^3 \* sec^-1)
0.0000E+00 3.5000E-04
8.0000E+00 1.8000E-04
2.4000E+01 2.3000E-04
7.2000E+02 2.3000E-04

Location Control Room is in compartment 3

Inleakage X/Q Table Assignments

Inleakage Path Source Path X/Q Table
2 6 3
3 6 4
4 6 3

Location Breathing Rate Data

Time (hr) Breathing Rate (m^3 \* sec^-1)
0.0000E+00 3.5000E-04
7.2000E+02 3.5000E-04

Location Occupancy Factor Data

Time (hr) Occupancy Factor
0.0000E+00 1.0000E+00
2.4000E+01 6.0000E-01
9.6000E+01 4.0000E-01
7.2000E+02 4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time Time step
0.0000E+00 1.0000E-06
1.0000E-03 2.0000E-02
7.2000E+02 2.0000E-02

#####
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:29:01
#####

#### # # ##### ##### # # #####
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
#### ##### # # ##### #

#####
Dose, Detailed Model and Detailed Inventory Output
#####

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Detailed model information at time (H) = 0.0001

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0001	8.4371E-12	1.5542E-09	1.3053E-11	6.1947E-11
Delta dose (rem)	8.4371E-12	1.5542E-09	1.3053E-11	6.1947E-11
Accumulated dose (rem)	8.4371E-12	1.5542E-09	1.3053E-11	6.1947E-11

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0001	1.0425E-12	1.9204E-10	1.6129E-12	7.6544E-12
Delta dose (rem)	1.0425E-12	1.9204E-10	1.6129E-12	7.6544E-12
Accumulated dose (rem)	1.0425E-12	1.9204E-10	1.6129E-12	7.6544E-12

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0001	1.5713E-16	9.7988E-13	8.2297E-15	3.3894E-14
Delta dose (rem)	1.5713E-16	9.7988E-13	8.2297E-15	3.3894E-14
Accumulated dose (rem)	1.5713E-16	9.7988E-13	8.2297E-15	3.3894E-14

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.0001				
Rb-86	2.3978E+02	2.9469E-06	2.0636E+19	8.8719E+12
Sr-89	2.4370E-03	8.3883E-11	5.6759E+14	9.0168E+07
I-131	3.8163E+05	3.0783E-03	1.4151E+22	1.4120E+16
I-132	5.4467E+05	5.2767E-05	2.4074E+20	2.0153E+16
I-133	7.4562E+05	6.5820E-04	2.9803E+21	2.7588E+16
I-134	8.1698E+05	3.0625E-05	1.3763E+20	3.0228E+16
I-135	6.9971E+05	1.9924E-04	8.8879E+20	2.5889E+16
Xe-133	2.0132E-01	1.0756E-09	4.8700E+15	7.4490E+09
Xe-135	2.2796E+00	8.9264E-10	3.9819E+15	8.4344E+10
Cs-134	2.4933E+04	1.9271E-02	8.6605E+22	9.2252E+14
Cs-136	7.1886E+03	9.8082E-05	4.3431E+20	2.6598E+14
Cs-137	1.3464E+04	1.5479E-01	6.8042E+23	4.9817E+14
I-130	1.9089E+04	9.7876E-06	4.5340E+19	7.0630E+14
Kr-83m	8.8789E-01	4.3034E-11	3.1224E+14	3.2852E+10
Xe-131m	5.1919E-04	6.1985E-12	2.8495E+13	1.9210E+07
Xe-133m	1.4414E-02	3.2123E-11	1.4545E+14	5.3330E+08
Xe-135m	1.4800E+01	1.6247E-10	7.2477E+14	5.4760E+11
Cs-138	1.6400E+05	3.8759E-06	1.6914E+19	6.0682E+15
Cs-134m	6.0219E+03	7.4674E-07	3.3559E+18	2.2281E+14
Rb-88	6.5709E+04	5.4740E-07	3.7460E+18	2.4312E+15
Rb-89	8.4372E+04	6.0703E-07	4.1074E+18	3.1218E+15
Ba-137m	1.0477E+01	1.9481E-11	8.5632E+13	3.8764E+11
Br-82	2.6938E+03	2.4882E-06	1.8273E+19	9.9671E+13
Br-83	4.6419E+04	2.9383E-06	2.1319E+19	1.7175E+15
Br-84	8.1130E+04	1.1526E-06	8.2630E+18	3.0018E+15

PCS Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.0001			
Noble gases (atoms)	1.0063E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.7937E+22	0.0000E+00	0.0000E+00
Organic I (atoms)	5.5475E+20	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7417E-01	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
0.0001		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	Pathway Filter
0.0001	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Aerosols (kg) 0.0000E+00

## Environment Integral Nuclide Release:

Time (h) =	Ci	kg	Atoms	Bq
0.0001				
I-131	5.4627E-09	4.4063E-17	2.0256E+08	2.0212E+02
I-132	7.7964E-09	7.5530E-19	3.4459E+06	2.8847E+02
I-133	1.0673E-08	9.4215E-18	4.2660E+07	3.9489E+02
I-135	1.0016E-08	2.8520E-18	1.2722E+07	3.7058E+02
Cs-134	3.5689E-10	2.7584E-16	1.2397E+09	1.3205E+01
Cs-136	1.0290E-10	1.4039E-18	6.2167E+06	3.8072E+00
Cs-137	1.9272E-10	2.2157E-15	9.7395E+09	7.1308E+00

## Environment Transport Group Inventory:

Time (h) =	Present Release	Release Rate/s	Integral Release
0.0001			
Noble gases (atoms)	5.7040E+00	1.5844E+03	2.1534E+02
Elemental I (atoms)	7.6258E+06	2.1183E+09	2.5675E+08
Organic I (atoms)	2.3585E+05	6.5513E+07	7.9407E+06
Aerosols (kg)	7.4046E-17	2.0568E-14	2.4930E-15

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway
0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	Pathway
0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	Pathway
0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) =	Pathway
0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

Time (h) =	Pathway
0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.0001				
I-131	2.0980E-11	1.6923E-19	7.7794E+05	7.7625E-01
I-133	4.0989E-11	3.6184E-20	1.6384E+05	1.5166E+00
Cs-134	1.3706E-12	1.0594E-18	4.7610E+06	5.0714E-02

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-137 7.4016E-13 8.5094E-18 3.7405E+07 2.7386E-02

Control Room Transport Group Inventory:

			Overlying
Time (h) =	0.0001	Atmosphere	Sump Pool
Noble gases (atoms)	8.2702E-01	0.0000E+00	0.0000E+00
Elemental I (atoms)	9.8606E+05	0.0000E+00	0.0000E+00
Organic I (atoms)	3.0497E+04	0.0000E+00	0.0000E+00
Aerosols (kg)	9.5746E-18	0.0000E+00	0.0000E+00

		Deposition	Recirculating
Time (h) =	0.0001	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	0.0000E+00	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	0.0000E+00	0.0000E+00	

Control Room Unfiltered Makeup Transport Group Inventory:

		Pathway
Time (h) =	0.0001	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Filtered Makeup Transport Group Inventory:

		Pathway
Time (h) =	0.0001	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Unfiltered Inleakage Transport Group Inventory:

		Pathway
Time (h) =	0.0001	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Control Room Exhaust Transport Group Inventory:

		Pathway
Time (h) =	0.0001	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0001	Ci	kg	Atoms	Bq
Rb-86		8.3153E-06	1.0219E-13	7.1561E+11	3.0766E+05
Sr-89		1.1240E-10	3.8689E-18	2.6179E+07	4.1588E+00
I-131		1.3234E-02	1.0675E-10	4.9074E+14	4.8968E+08
I-132		1.8888E-02	1.8299E-12	8.3483E+12	6.9887E+08
I-133		2.5857E-02	2.2825E-11	1.0335E+14	9.5671E+08
I-134		2.8331E-02	1.0620E-12	4.7729E+12	1.0483E+09
I-135		2.4265E-02	6.9095E-12	3.0822E+13	8.9780E+08
Xe-133		9.2856E-09	4.9607E-17	2.2462E+08	3.4357E+02
Xe-135		1.0514E-07	4.1171E-17	1.8366E+08	3.8901E+03
Cs-134		8.6464E-04	6.6828E-10	3.0033E+15	3.1992E+07
Cs-136		2.4929E-04	3.4014E-12	1.5061E+13	9.2237E+06
Cs-137		4.6691E-04	5.3679E-09	2.3596E+16	1.7276E+07
I-130		6.6198E-04	3.3942E-13	1.5723E+12	2.4493E+07
Kr-83m		4.0952E-08	1.9849E-18	1.4401E+07	1.5152E+03
Xe-131m		2.3946E-11	2.8589E-19	1.3142E+06	8.8602E-01
Xe-133m		6.6479E-10	1.4816E-18	6.7085E+06	2.4597E+01

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-135m	6.8261E-07	7.4936E-18	3.3428E+07	2.5256E+04
Cs-138	5.6873E-03	1.3441E-13	5.8653E+11	2.1043E+08
Cs-134m	2.0883E-04	2.5896E-14	1.1638E+11	7.7268E+06
Rb-88	2.2786E-03	1.8982E-14	1.2990E+11	8.4308E+07
Rb-89	2.9259E-03	2.1051E-14	1.4244E+11	1.0826E+08
Ba-137m	4.8318E-07	8.9843E-19	3.9493E+06	1.7878E+04
Br-82	9.3418E-05	8.6287E-14	6.3370E+11	3.4564E+06
Br-83	1.6097E-03	1.0190E-13	7.3932E+11	5.9560E+07
Br-84	2.8135E-03	3.9969E-14	2.8655E+11	1.0410E+08

SGs Transport Group Inventory:

			Overlying
Time (h) =	0.0001	Atmosphere	Sump Pool
Noble gases (atoms)	4.6413E+08	0.0000E+00	0.0000E+00
Elemental I (atoms)	6.2203E+14	0.0000E+00	0.0000E+00
Organic I (atoms)	1.9238E+13	0.0000E+00	0.0000E+00
Aerosols (kg)	6.0399E-09	0.0000E+00	0.0000E+00

		Deposition	Recirculating
Time (h) =	0.0001	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

		Pathway
Time (h) =	0.0001	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

SRV/ADV Steam Release Transport Group Inventory:

		Pathway
Time (h) =	0.0001	Filter
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

Detailed model information at time (H) = 0.0250

EAB Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.5845E-06	2.9307E-04	2.4503E-06	1.1674E-05	
Accumulated dose (rem)	1.5845E-06	2.9307E-04	2.4504E-06	1.1674E-05	

LPZ Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.9578E-07	3.6212E-05	3.0277E-07	1.4425E-06	
Accumulated dose (rem)	1.9578E-07	3.6212E-05	3.0277E-07	1.4425E-06	

Control Room Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.1963E-08	7.4941E-05	6.2629E-07	2.5920E-06	
Accumulated dose (rem)	1.1963E-08	7.4941E-05	6.2629E-07	2.5920E-06	

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Rb-86	2.4217E+02	2.9762E-06	2.0841E+19	8.9601E+12	
Sr-89	1.1755E+00	4.0462E-08	2.7378E+17	4.3494E+10	
I-131	3.8541E+05	3.1088E-03	1.4291E+22	1.4260E+16	
I-132	5.4600E+05	5.2896E-05	2.4132E+20	2.0202E+16	
I-133	7.5244E+05	6.6422E-04	3.0075E+21	2.7840E+16	
I-134	8.0905E+05	3.0328E-05	1.3630E+20	2.9935E+16	

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-135	7.0485E+05	2.0071E-04	8.9532E+20	2.6080E+16
Xe-133	1.0042E+02	5.3646E-07	2.4290E+18	3.7154E+12
Xe-135	1.1382E+03	4.4570E-07	1.9882E+18	4.2114E+13
Cs-134	2.5182E+04	1.9463E-02	8.7469E+22	9.3172E+14
Cs-136	7.2599E+03	9.9056E-05	4.3862E+20	2.6862E+14
Cs-137	1.3598E+04	1.5634E-01	6.8721E+23	5.0314E+14
I-130	1.9253E+04	9.8715E-06	4.5729E+19	7.1236E+14
Kr-83m	4.4067E+02	2.1358E-08	1.5497E+17	1.6305E+13
Xe-131m	2.5906E-01	3.0928E-09	1.4218E+16	9.5851E+09
Xe-133m	7.1888E+00	1.6021E-08	7.2543E+16	2.6599E+11
Xe-135m	7.2821E+03	7.9942E-08	3.5661E+17	2.6944E+14
Cs-138	1.6040E+05	3.7907E-06	1.6542E+19	5.9348E+15
Cs-134m	6.0460E+03	7.4972E-07	3.3693E+18	2.2370E+14
Rb-88	6.2614E+04	5.2162E-07	3.5696E+18	2.3167E+15
Rb-89	7.9602E+04	5.7271E-07	3.8752E+18	2.9453E+15
Ba-137m	4.8533E+03	9.0244E-09	3.9669E+16	1.7957E+14
Br-82	2.7194E+03	2.5118E-06	1.8447E+19	1.0062E+14
Br-83	4.6545E+04	2.9463E-06	2.1377E+19	1.7222E+15
Br-84	7.9315E+04	1.1268E-06	8.0781E+18	2.9347E+15

PCS Transport Group Inventory:

Time (h) =	0.0250	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		5.0156E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.8105E+22	0.0000E+00	0.0000E+00
Organic I (atoms)		5.5996E+20	0.0000E+00	0.0000E+00
Aerosols (kg)		1.7591E-01	0.0000E+00	0.0000E+00

Time (h) =	0.0250	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	0.0250	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Rb-86		6.4727E-07	7.9550E-15	5.5705E+10	2.3949E+04
Sr-89		3.1420E-09	1.0815E-16	7.3178E+08	1.1625E+02
I-131		1.0301E-03	8.3093E-12	3.8198E+13	3.8115E+07
I-132		1.4594E-03	1.4138E-13	6.4502E+11	5.3997E+07
I-133		2.0112E-03	1.7754E-12	8.0387E+12	7.4413E+07
I-134		2.1625E-03	8.1062E-14	3.6430E+11	8.0012E+07
I-135		1.8840E-03	5.3646E-13	2.3931E+12	6.9707E+07
Xe-133		2.6840E-07	1.4339E-15	6.4925E+09	9.9306E+03
Xe-135		3.0423E-06	1.1913E-15	5.3142E+09	1.1256E+05
Cs-134		6.7307E-05	5.2022E-11	2.3379E+14	2.4904E+06
Cs-136		1.9405E-05	2.6476E-13	1.1724E+12	7.1797E+05
Cs-137		3.6347E-05	4.1786E-10	1.8368E+15	1.3448E+06
I-130		5.1460E-05	2.6385E-14	1.2223E+11	1.9040E+06
Kr-83m		1.1778E-06	5.7088E-17	4.1421E+08	4.3580E+04
Xe-131m		6.9243E-10	8.2667E-18	3.8002E+07	2.5620E+01
Xe-133m		1.9215E-08	4.2823E-17	1.9390E+08	7.1095E+02
Xe-135m		1.9464E-05	2.1367E-16	9.5317E+08	7.2017E+05
Cs-138		4.2872E-04	1.0132E-14	4.4214E+10	1.5863E+07
Cs-134m		1.6160E-05	2.0039E-15	9.0057E+09	5.9792E+05
Rb-88		1.6736E-04	1.3942E-15	9.5410E+09	6.1922E+06
Rb-89		2.1276E-04	1.5308E-15	1.0358E+10	7.8723E+06
Ba-137m		1.2972E-05	2.4121E-17	1.0603E+08	4.7998E+05
Br-82		7.2685E-06	6.7137E-15	4.9306E+10	2.6893E+05
Br-83		1.2441E-04	7.8750E-15	5.7138E+10	4.6031E+06
Br-84		2.1200E-04	3.0117E-15	2.1592E+10	7.8439E+06



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 0.0250	Release	Rate/s	Release
Noble gases (atoms)	4.8347E+09	7.0682E+07	1.3406E+10
Elemental I (atoms)	1.7452E+13	2.5515E+11	4.8393E+13
Organic I (atoms)	5.3976E+11	7.8912E+09	1.4967E+12
Aerosols (kg)	1.6956E-10	2.4790E-12	4.7017E-10

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.0250	Ci	kg	Atoms	Bq
Rb-86	2.4727E-09	3.0389E-17	2.1280E+08	9.1488E+01
Sr-89	1.2003E-11	4.1314E-19	2.7955E+06	4.4410E-01
I-131	3.9352E-06	3.1742E-14	1.4592E+11	1.4560E+05
I-132	5.5749E-06	5.4009E-16	2.4640E+09	2.0627E+05
I-133	7.6828E-06	6.7821E-15	3.0709E+10	2.8426E+05
I-134	8.2609E-06	3.0967E-16	1.3917E+09	3.0565E+05
I-135	7.1970E-06	2.0493E-15	9.1418E+09	2.6629E+05
Xe-133	1.0253E-09	5.4776E-18	2.4802E+07	3.7936E+01
Xe-135	1.1622E-08	4.5509E-18	2.0301E+07	4.3000E+02
Cs-134	2.5712E-07	1.9873E-13	8.9311E+11	9.5135E+03
Cs-136	7.4128E-08	1.0114E-15	4.4786E+09	2.7427E+03
Cs-137	1.3885E-07	1.5963E-12	7.0168E+12	5.1374E+03
I-130	1.9658E-07	1.0079E-16	4.6692E+08	7.2736E+03
Kr-83m	4.4995E-09	2.1808E-19	1.5823E+06	1.6648E+02
Xe-131m	2.6451E-12	3.1580E-20	1.4517E+05	9.7870E-02

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-133m	7.3402E-11	1.6359E-19	7.4071E+05	2.7159E+00
Xe-135m	7.4355E-08	8.1626E-19	3.6412E+06	2.7511E+03
Cs-138	1.6378E-06	3.8705E-17	1.6890E+08	6.0597E+04
Cs-134m	6.1733E-08	7.6550E-18	3.4403E+07	2.2841E+03
Rb-88	6.3932E-07	5.3260E-18	3.6448E+07	2.3655E+04
Rb-89	8.1278E-07	5.8477E-18	3.9568E+07	3.0073E+04
Ba-137m	4.9555E-08	9.2145E-20	4.0504E+05	1.8336E+03
Br-82	2.7766E-08	2.5647E-17	1.8835E+08	1.0274E+03
Br-83	4.7525E-07	3.0083E-17	2.1827E+08	1.7584E+04
Br-84	8.0985E-07	1.1505E-17	8.2482E+07	2.9964E+04

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0250			
Noble gases (atoms)	5.1212E+07	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.8487E+11	0.0000E+00	0.0000E+00
Organic I (atoms)	5.7175E+09	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7961E-12	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0250		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.0250	Ci	kg	Atoms	Bq
Rb-86	4.1899E-03	5.1493E-11	3.6058E+14	1.5503E+08
Sr-89	2.0338E-05	7.0006E-13	4.7369E+12	7.5251E+05
I-131	6.6682E+00	5.3787E-08	2.4726E+17	2.4672E+11
I-132	9.4467E+00	9.1518E-10	4.1753E+15	3.4953E+11
I-133	1.3018E+01	1.1492E-08	5.2036E+16	4.8168E+11
I-134	1.3998E+01	5.2472E-10	2.3582E+15	5.1792E+11
I-135	1.2195E+01	3.4726E-09	1.5491E+16	4.5122E+11

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-133	1.7374E-03	9.2816E-12	4.2027E+13	6.4282E+07
Xe-135	1.9693E-02	7.7114E-12	3.4400E+13	7.2864E+08
Cs-134	4.3569E-01	3.3674E-07	1.5134E+18	1.6120E+10
Cs-136	1.2561E-01	1.7138E-09	7.5889E+15	4.6475E+09
Cs-137	2.3528E-01	2.7049E-06	1.1890E+19	8.7052E+09
I-130	3.3311E-01	1.7079E-10	7.9119E+14	1.2325E+10
Kr-83m	7.6243E-03	3.6954E-13	2.6812E+12	2.8210E+08
Xe-131m	4.4821E-06	5.3511E-14	2.4599E+11	1.6584E+05
Xe-133m	1.2438E-04	2.7720E-13	1.2551E+12	4.6020E+06
Xe-135m	1.2599E-01	1.3831E-12	6.1700E+12	4.6618E+09
Cs-138	2.7752E+00	6.5585E-11	2.8620E+14	1.0268E+11
Cs-134m	1.0461E-01	1.2971E-11	5.8295E+13	3.8704E+09
Rb-88	1.0833E+00	9.0248E-12	6.1760E+13	4.0083E+10
Rb-89	1.3772E+00	9.9088E-12	6.7048E+13	5.0958E+10
Ba-137m	8.3971E-02	1.5614E-13	6.8634E+11	3.1069E+09
Br-82	4.7050E-02	4.3459E-11	3.1916E+14	1.7408E+09
Br-83	8.0531E-01	5.0976E-11	3.6986E+14	2.9796E+10
Br-84	1.3723E+00	1.9495E-11	1.3976E+14	5.0774E+10

SGs Transport Group Inventory:

Time (h) =	0.0250	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		8.6778E+13	0.0000E+00	0.0000E+00
Elemental I (atoms)		3.1325E+17	0.0000E+00	0.0000E+00
Organic I (atoms)		9.6882E+15	0.0000E+00	0.0000E+00
Aerosols (kg)		3.0435E-06	0.0000E+00	0.0000E+00

Time (h) =	0.0250	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	0.0250	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) =	0.0250	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Detailed model information at time (H) = 0.3056

EAB Doses:

Time (h) =	0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.1316E-04	4.3364E-02	3.2693E-04	1.7044E-03
Accumulated dose (rem)		2.1474E-04	4.3657E-02	3.2938E-04	1.7160E-03

LPZ Doses:

Time (h) =	0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.6338E-05	5.3581E-03	4.0396E-05	2.1059E-04
Accumulated dose (rem)		2.6534E-05	5.3943E-03	4.0699E-05	2.1204E-04

Control Room Doses:

Time (h) =	0.3056	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.5353E-05	1.7670E-01	1.3151E-03	6.1008E-03
Accumulated dose (rem)		2.5364E-05	1.7677E-01	1.3157E-03	6.1034E-03

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3056				
Rb-86	2.4201E+02	2.9743E-06	2.0828E+19	8.9545E+12
Sr-89	1.0089E+01	3.4727E-07	2.3498E+18	3.7329E+11
I-131	3.8494E+05	3.1050E-03	1.4274E+22	1.4243E+16
I-132	5.0163E+05	4.8598E-05	2.2171E+20	1.8560E+16
I-133	7.4529E+05	6.5791E-04	2.9790E+21	2.7576E+16
I-134	6.4797E+05	2.4290E-05	1.0916E+20	2.3975E+16
I-135	6.8429E+05	1.9485E-04	8.6920E+20	2.5319E+16
Xe-133	1.2227E+03	6.5323E-06	2.9578E+19	4.5241E+13
Xe-135	1.4309E+04	5.6033E-06	2.4995E+19	5.2944E+14
Cs-134	2.5177E+04	1.9459E-02	8.7451E+22	9.3154E+14
Cs-136	7.2540E+03	9.8976E-05	4.3827E+20	2.6840E+14
Cs-137	1.3596E+04	1.5631E-01	6.8708E+23	5.0304E+14
I-130	1.8949E+04	9.7156E-06	4.5006E+19	7.0110E+14
Kr-83m	4.9152E+03	2.3823E-07	1.7285E+18	1.8186E+14
Xe-131m	3.1688E+00	3.7832E-08	1.7391E+17	1.1725E+11
Xe-133m	8.7438E+01	1.9487E-07	8.8234E+17	3.2352E+12
Xe-135m	6.1893E+04	6.7946E-07	3.0309E+18	2.2901E+15
Cs-138	1.1162E+05	2.6379E-06	1.1511E+19	4.1300E+15
Cs-134m	5.6527E+03	7.0095E-07	3.1502E+18	2.0915E+14
Rb-88	3.2502E+04	2.7076E-07	1.8529E+18	1.2026E+15
Rb-89	3.6937E+04	2.6575E-07	1.7982E+18	1.3667E+15
Ba-137m	1.4824E+04	2.7564E-08	1.2116E+17	5.4848E+14
Br-82	2.7039E+03	2.4975E-06	1.8342E+19	1.0004E+14
Br-83	4.2899E+04	2.7155E-06	1.9703E+19	1.5873E+15
Br-84	5.4944E+04	7.8055E-07	5.5960E+18	2.0329E+15

PCS Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3056			
Noble gases (atoms)	6.0389E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.7985E+22	0.0000E+00	0.0000E+00
Organic I (atoms)	5.5625E+20	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7587E-01	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Filter
0.3056		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	Pathway Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	Ci	kg	Atoms	Bq
0.3056				
Rb-86	9.6689E-05	1.1883E-12	8.3210E+12	3.5775E+06
Sr-89	4.0307E-06	1.3874E-13	9.3878E+11	1.4914E+05
I-131	1.5379E-01	1.2405E-09	5.7027E+15	5.6903E+09
I-132	2.0041E-01	1.9416E-11	8.8578E+13	7.4152E+09
I-133	2.9776E-01	2.6285E-10	1.1902E+15	1.1017E+10
I-134	2.5887E-01	9.7041E-12	4.3612E+13	9.5784E+09
I-135	2.7338E-01	7.7846E-11	3.4726E+14	1.0115E+10
Xe-133	4.8850E-04	2.6098E-12	1.1817E+13	1.8074E+07
Xe-135	5.7168E-03	2.2386E-12	9.9861E+12	2.1152E+08
Cs-134	1.0059E-02	7.7742E-09	3.4938E+16	3.7217E+08
Cs-136	2.8981E-03	3.9542E-11	1.7510E+14	1.0723E+08
Cs-137	5.4317E-03	6.2447E-08	2.7450E+17	2.0097E+08
I-130	7.5703E-03	3.8815E-12	1.7981E+13	2.8010E+08
Kr-83m	1.9637E-03	9.5178E-14	6.9057E+11	7.2658E+07
Xe-131m	1.2660E-06	1.5114E-14	6.9482E+10	4.6842E+04
Xe-133m	3.4933E-05	7.7853E-14	3.5251E+11	1.2925E+06

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-135m	2.4727E-02	2.7146E-13	1.2109E+12	9.1492E+08
Cs-138	4.4595E-02	1.0539E-12	4.5990E+12	1.6500E+09
Cs-134m	2.2584E-03	2.8004E-13	1.2586E+12	8.3560E+07
Rb-88	1.2985E-02	1.0817E-13	7.4027E+11	4.8044E+08
Rb-89	1.4757E-02	1.0617E-13	7.1840E+11	5.4601E+08
Ba-137m	5.9224E-03	1.1012E-14	4.8407E+10	2.1913E+08
Br-82	1.0803E-03	9.9780E-13	7.3279E+12	3.9970E+07
Br-83	1.7139E-02	1.0849E-12	7.8716E+12	6.3414E+08
Br-84	2.1951E-02	3.1185E-13	2.2357E+12	8.1219E+08

## Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) =	Release	Rate/s	Release
0.3056			
Noble gases (atoms)	8.6924E+11	1.2073E+10	2.4126E+13
Elemental I (atoms)	2.5889E+14	3.5956E+12	7.1855E+15
Organic I (atoms)	8.0068E+12	1.1120E+11	2.2223E+14
Aerosols (kg)	2.5315E-09	3.5160E-11	7.0264E-08

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) =	Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3056				
Rb-86	5.7182E-07	7.0276E-15	4.9210E+10	2.1157E+04
Sr-89	2.3838E-08	8.2051E-16	5.5519E+09	8.8199E+02
I-131	9.0953E-04	7.3364E-12	3.3726E+13	3.3652E+07
I-132	1.1852E-03	1.1482E-13	5.2385E+11	4.3853E+07
I-133	1.7609E-03	1.5545E-12	7.0386E+12	6.5154E+07
I-134	1.5310E-03	5.7390E-14	2.5792E+11	5.6646E+07

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-135	1.6168E-03	4.6038E-13	2.0537E+12	5.9821E+07
Xe-133	2.8890E-06	1.5434E-14	6.9884E+10	1.0689E+05
Xe-135	3.3809E-05	1.3239E-14	5.9058E+10	1.2509E+06
Cs-134	5.9486E-05	4.5977E-11	2.0663E+14	2.2010E+06
Cs-136	1.7139E-05	2.3385E-13	1.0355E+12	6.3416E+05
Cs-137	3.2123E-05	3.6931E-10	1.6234E+15	1.1886E+06
I-130	4.4771E-05	2.2955E-14	1.0634E+11	1.6565E+06
Kr-83m	1.1613E-05	5.6288E-16	4.0840E+09	4.2970E+05
Xe-131m	7.4871E-09	8.9386E-17	4.1091E+08	2.7702E+02
Xe-133m	2.0659E-07	4.6042E-16	2.0848E+09	7.6440E+03
Xe-135m	1.4624E-04	1.6054E-15	7.1613E+09	5.4108E+06
Cs-138	2.6373E-04	6.2327E-15	2.7199E+10	9.7581E+06
Cs-134m	1.3356E-05	1.6562E-15	7.4431E+09	4.9417E+05
Rb-88	7.6793E-05	6.3973E-16	4.3779E+09	2.8413E+06
Rb-89	8.7272E-05	6.2789E-16	4.2486E+09	3.2291E+06
Ba-137m	3.5025E-05	6.5126E-17	2.8628E+08	1.2959E+06
Br-82	6.3886E-06	5.9010E-15	4.3337E+10	2.3638E+05
Br-83	1.0136E-04	6.4161E-15	4.6553E+10	3.7503E+06
Br-84	1.2982E-04	1.8442E-15	1.3222E+10	4.8033E+06

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.3056			
Noble gases (atoms)	1.4268E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.2495E+13	0.0000E+00	0.0000E+00
Organic I (atoms)	1.3143E+12	0.0000E+00	0.0000E+00
Aerosols (kg)	4.1554E-10	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.3056		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway Filter
Time (h) = 0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway Filter
Time (h) = 0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SGs Compartment Atmosphere Nuclide Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) =	Ci	kg	Atoms	Bq
0.3056				
Rb-86	5.1188E-02	6.2910E-10	4.4053E+15	1.8940E+09
Sr-89	2.1339E-03	7.3451E-11	4.9700E+14	7.8955E+07
I-131	8.1420E+01	6.5674E-07	3.0191E+18	3.0125E+12
I-132	1.0610E+02	1.0279E-08	4.6895E+16	3.9257E+12
I-133	1.5764E+02	1.3916E-07	6.3008E+17	5.8325E+12
I-134	1.3705E+02	5.1375E-09	2.3089E+16	5.0709E+12
I-135	1.4473E+02	4.1213E-08	1.8384E+17	5.3551E+12
Xe-133	2.5862E-01	1.3816E-09	6.2560E+15	9.5689E+09
Xe-135	3.0265E+00	1.1852E-09	5.2868E+15	1.1198E+11
Cs-134	5.3251E+00	4.1158E-06	1.8497E+19	1.9703E+11
Cs-136	1.5343E+00	2.0934E-08	9.2698E+16	5.6769E+10
Cs-137	2.8756E+00	3.3060E-05	1.4532E+20	1.0640E+11
I-130	4.0078E+00	2.0549E-09	9.5193E+15	1.4829E+11
Kr-83m	1.0396E+00	5.0389E-11	3.6560E+14	3.8466E+10
Xe-131m	6.7024E-04	8.0018E-12	3.6784E+13	2.4799E+07
Xe-133m	1.8494E-02	4.1216E-11	1.8662E+14	6.8428E+08
Xe-135m	1.3091E+01	1.4371E-10	6.4108E+14	4.8437E+11
Cs-138	2.3609E+01	5.5794E-10	2.4348E+15	8.7353E+11
Cs-134m	1.1956E+00	1.4826E-10	6.6629E+14	4.4238E+10
Rb-88	6.8744E+00	5.7268E-11	3.9191E+14	2.5435E+11
Rb-89	7.8125E+00	5.6208E-11	3.8033E+14	2.8906E+11
Ba-137m	3.1354E+00	5.8300E-12	2.5627E+13	1.1601E+11
Br-82	5.7190E-01	5.2825E-10	3.8795E+15	2.1160E+10
Br-83	9.0736E+00	5.7436E-10	4.1673E+15	3.3572E+11
Br-84	1.1621E+01	1.6510E-10	1.1836E+15	4.2998E+11

SGs Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3056			
Noble gases (atoms)	1.2773E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.8041E+18	0.0000E+00	0.0000E+00
Organic I (atoms)	1.1765E+17	0.0000E+00	0.0000E+00
Aerosols (kg)	3.7198E-05	0.0000E+00	0.0000E+00

Time (h) =	Deposition Surfaces	Recirculating Filter
0.3056		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	Pathway Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) =	Pathway Filter
0.3056	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.3333

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.3333				
Delta dose (rem)	1.7671E-05	3.8098E-03	2.6988E-05	1.4860E-04
Accumulated dose (rem)	2.3241E-04	4.7467E-02	3.5637E-04	1.8646E-03

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.3333				

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Delta dose (rem)	2.1835E-06	4.7075E-04	3.3347E-06	1.8361E-05
Accumulated dose (rem)	2.8718E-05	5.8651E-03	4.4033E-05	2.3040E-04

Control Room Doses:

Time (h) =	0.3333	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		6.5736E-06	4.7977E-02	3.3987E-04	1.6553E-03
Accumulated dose (rem)		3.1938E-05	2.2475E-01	1.6556E-03	7.7587E-03

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.3333	Ci	kg	Atoms	Bq
Rb-86		2.4200E+02	2.9741E-06	2.0826E+19	8.9539E+12
Sr-89		1.0653E+01	3.6668E-07	2.4811E+18	3.9416E+11
I-131		3.8490E+05	3.1047E-03	1.4272E+22	1.4241E+16
I-132		4.9745E+05	4.8192E-05	2.1986E+20	1.8405E+16
I-133		7.4459E+05	6.5729E-04	2.9762E+21	2.7550E+16
I-134		6.3390E+05	2.3762E-05	1.0679E+20	2.3454E+16
I-135		6.8229E+05	1.9428E-04	8.6666E+20	2.5245E+16
Xe-133		1.3330E+03	7.1215E-06	3.2246E+19	4.9322E+13
Xe-135		1.5631E+04	6.1209E-06	2.7304E+19	5.7835E+14
Cs-134		2.5176E+04	1.9459E-02	8.7450E+22	9.3152E+14
Cs-136		7.2534E+03	9.8968E-05	4.3823E+20	2.6838E+14
Cs-137		1.3595E+04	1.5630E-01	6.8706E+23	5.0303E+14
I-130		1.8919E+04	9.7003E-06	4.4936E+19	7.0000E+14
Kr-83m		5.3116E+03	2.5744E-07	1.8679E+18	1.9653E+14
Xe-131m		3.4562E+00	4.1263E-08	1.8969E+17	1.2788E+11
Xe-133m		9.5315E+01	2.1242E-07	9.6183E+17	3.5267E+12
Xe-135m		6.5187E+04	7.1562E-07	3.1922E+18	2.4119E+15
Cs-138		1.0769E+05	2.5450E-06	1.1106E+19	3.9845E+15
Cs-134m		5.6153E+03	6.9631E-07	3.1293E+18	2.0776E+14
Rb-88		3.0461E+04	2.5376E-07	1.7366E+18	1.1271E+15
Rb-89		3.4236E+04	2.4632E-07	1.6667E+18	1.2667E+15
Ba-137m		1.4657E+04	2.7253E-08	1.1980E+17	5.4230E+14
Br-82		2.7024E+03	2.4961E-06	1.8332E+19	9.9988E+13
Br-83		4.2555E+04	2.6937E-06	1.9544E+19	1.5745E+15
Br-84		5.2985E+04	7.5273E-07	5.3964E+18	1.9604E+15

PCS Transport Group Inventory:

Time (h) =	0.3333	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		6.5762E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.7974E+22	0.0000E+00	0.0000E+00
Organic I (atoms)		5.5590E+20	0.0000E+00	0.0000E+00
Aerosols (kg)		1.7587E-01	0.0000E+00	0.0000E+00

Time (h) =	0.3333	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	0.3333	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	0.3333	Ci	kg	Atoms	Bq
Rb-86		1.0514E-04	1.2922E-12	9.0483E+12	3.8902E+06
Sr-89		4.6283E-06	1.5931E-13	1.0780E+12	1.7125E+05
I-131		1.6722E-01	1.3489E-09	6.2008E+15	6.1873E+09
I-132		2.1612E-01	2.0938E-11	9.5522E+13	7.9965E+09
I-133		3.2350E-01	2.8557E-10	1.2930E+15	1.1969E+10
I-134		2.7540E-01	1.0324E-11	4.6396E+13	1.0190E+10
I-135		2.9643E-01	8.4408E-11	3.7653E+14	1.0968E+10



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-133	5.7915E-04	3.0940E-12	1.4010E+13	2.1428E+07
Xe-135	6.7912E-03	2.6593E-12	1.1863E+13	2.5127E+08
Cs-134	1.0938E-02	8.4540E-09	3.7994E+16	4.0471E+08
Cs-136	3.1513E-03	4.2998E-11	1.9040E+14	1.1660E+08
Cs-137	5.9067E-03	6.7908E-08	2.9850E+17	2.1855E+08
I-130	8.2195E-03	4.2144E-12	1.9523E+13	3.0412E+08
Kr-83m	2.3077E-03	1.1185E-13	8.1153E+11	8.5384E+07
Xe-131m	1.5016E-06	1.7927E-14	8.2412E+10	5.5559E+04
Xe-133m	4.1411E-05	9.2289E-14	4.1788E+11	1.5322E+06
Xe-135m	2.8321E-02	3.1091E-13	1.3869E+12	1.0479E+09
Cs-138	4.6787E-02	1.1057E-12	4.8252E+12	1.7311E+09
Cs-134m	2.4396E-03	3.0252E-13	1.3596E+12	9.0266E+07
Rb-88	1.3234E-02	1.1025E-13	7.5447E+11	4.8966E+08
Rb-89	1.4874E-02	1.0702E-13	7.2411E+11	5.5035E+08
Ba-137m	6.3679E-03	1.1841E-14	5.2048E+10	2.3561E+08
Br-82	1.1741E-03	1.0845E-12	7.9644E+12	4.3441E+07
Br-83	1.8488E-02	1.1703E-12	8.4913E+12	6.8407E+08
Br-84	2.3020E-02	3.2703E-13	2.3446E+12	8.5174E+08

## Environment Transport Group Inventory:

Time (h) =	Present	Release	Integral
0.3333	Release	Rate/s	Release
Noble gases (atoms)	1.1263E+12	2.1660E+10	2.8571E+13
Elemental I (atoms)	3.0783E+14	5.9200E+12	7.8091E+15
Organic I (atoms)	9.5206E+12	1.8309E+11	2.4152E+14
Aerosols (kg)	3.0120E-09	5.7924E-11	7.6408E-08

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

Time (h) =	Pathway
0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.3333				
Rb-86	5.9750E-07	7.3433E-15	5.1421E+10	2.2108E+04
Sr-89	2.6303E-08	9.0535E-16	6.1260E+09	9.7319E+02
I-131	9.5033E-04	7.6655E-12	3.5239E+13	3.5162E+07
I-132	1.2282E-03	1.1899E-13	5.4285E+11	4.5444E+07
I-133	1.8384E-03	1.6229E-12	7.3483E+12	6.8021E+07
I-134	1.5651E-03	5.8670E-14	2.6367E+11	5.7909E+07
I-135	1.6846E-03	4.7969E-13	2.1398E+12	6.2330E+07
Xe-133	3.2913E-06	1.7583E-14	7.9616E+10	1.2178E+05
Xe-135	3.8594E-05	1.5113E-14	6.7416E+10	1.4280E+06
Cs-134	6.2161E-05	4.8044E-11	2.1592E+14	2.2999E+06
Cs-136	1.7909E-05	2.4435E-13	1.0820E+12	6.6263E+05
Cs-137	3.3568E-05	3.8592E-10	1.6964E+15	1.2420E+06
I-130	4.6711E-05	2.3950E-14	1.1095E+11	1.7283E+06
Kr-83m	1.3114E-05	6.3563E-16	4.6119E+09	4.8523E+05
Xe-131m	8.5335E-09	1.0188E-16	4.6834E+08	3.1574E+02
Xe-133m	2.3534E-07	5.2448E-16	2.3748E+09	8.7074E+03
Xe-135m	1.6095E-04	1.7669E-15	7.8818E+09	5.9551E+06
Cs-138	2.6589E-04	6.2837E-15	2.7421E+10	9.8380E+06
Cs-134m	1.3864E-05	1.7192E-15	7.7263E+09	5.1298E+05
Rb-88	7.5209E-05	6.2654E-16	4.2876E+09	2.7827E+06
Rb-89	8.4530E-05	6.0817E-16	4.1151E+09	3.1276E+06
Ba-137m	3.6188E-05	6.7289E-17	2.9579E+08	1.3390E+06
Br-82	6.6723E-06	6.1630E-15	4.5261E+10	2.4687E+05
Br-83	1.0507E-04	6.6509E-15	4.8256E+10	3.8876E+06
Br-84	1.3082E-04	1.8585E-15	1.3324E+10	4.8404E+06

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.3333			
Noble gases (atoms)	1.6237E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.4379E+13	0.0000E+00	0.0000E+00
Organic I (atoms)	1.3725E+12	0.0000E+00	0.0000E+00
Aerosols (kg)	4.3422E-10	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Filter
0.3333		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	Pathway Filter
0.3333	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 0.3333	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.3333	Ci	kg	Atoms	Bq
Rb-86	5.5834E-02	6.8620E-10	4.8051E+15	2.0659E+09
Sr-89	2.4579E-03	8.4602E-11	5.7245E+14	9.0941E+07
I-131	8.8805E+01	7.1631E-07	3.2929E+18	3.2858E+12
I-132	1.1477E+02	1.1119E-08	5.0727E+16	4.2465E+12
I-133	1.7179E+02	1.5165E-07	6.8667E+17	6.3563E+12
I-134	1.4625E+02	5.4824E-09	2.4639E+16	5.4114E+12
I-135	1.5742E+02	4.4825E-08	1.9996E+17	5.8245E+12
Xe-133	3.0756E-01	1.6431E-09	7.4398E+15	1.1380E+10
Xe-135	3.6065E+00	1.4122E-09	6.2997E+15	1.3344E+11
Cs-134	5.8087E+00	4.4895E-06	2.0177E+19	2.1492E+11
Cs-136	1.6735E+00	2.2834E-08	1.0111E+17	6.1920E+10
Cs-137	3.1368E+00	3.6062E-05	1.5852E+20	1.1606E+11
I-130	4.3650E+00	2.2381E-09	1.0368E+16	1.6150E+11
Kr-83m	1.2255E+00	5.9398E-11	4.3096E+14	4.5343E+10
Xe-131m	7.9743E-04	9.5202E-12	4.3765E+13	2.9505E+07
Xe-133m	2.1991E-02	4.9010E-11	2.2192E+14	8.1368E+08
Xe-135m	1.5040E+01	1.6511E-10	7.3652E+14	5.5648E+11
Cs-138	2.4846E+01	5.8719E-10	2.5624E+15	9.1932E+11
Cs-134m	1.2956E+00	1.6065E-10	7.2200E+14	4.7936E+10
Rb-88	7.0280E+00	5.8548E-11	4.0066E+14	2.6004E+11
Rb-89	7.8990E+00	5.6831E-11	3.8454E+14	2.9226E+11
Ba-137m	3.3817E+00	6.2879E-12	2.7640E+13	1.2512E+11
Br-82	6.2350E-01	5.7591E-10	4.2295E+15	2.3069E+10
Br-83	9.8183E+00	6.2150E-10	4.5093E+15	3.6328E+11
Br-84	1.2225E+01	1.7367E-10	1.2451E+15	4.5232E+11

SGs Transport Group Inventory:

Time (h) = 0.3333	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.5173E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.1470E+18	0.0000E+00	0.0000E+00
Organic I (atoms)	1.2826E+17	0.0000E+00	0.0000E+00
Aerosols (kg)	4.0576E-05	0.0000E+00	0.0000E+00

Time (h) = 0.3333	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) = 0.3333	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.5000

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## EAB Doses:

Time (h) =	0.5000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.3278E-04	2.9955E-02	2.0225E-04	1.1617E-03
Accumulated dose (rem)		3.6519E-04	7.7421E-02	5.5862E-04	3.0263E-03

## LPZ Doses:

Time (h) =	0.5000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.6406E-05	3.7013E-03	2.4991E-05	1.4354E-04
Accumulated dose (rem)		4.5124E-05	9.5663E-03	6.9024E-05	3.7394E-04

## Control Room Doses:

Time (h) =	0.5000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.7070E-05	2.0494E-01	1.3966E-03	7.0672E-03
Accumulated dose (rem)		5.9008E-05	4.2969E-01	3.0522E-03	1.4826E-02

## PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.5000	Ci	kg	Atoms	Bq
Rb-86		2.4191E+02	2.9730E-06	2.0819E+19	8.9506E+12
Sr-89		1.3271E+01	4.5681E-07	3.0910E+18	4.9104E+11
I-131		3.8462E+05	3.1024E-03	1.4262E+22	1.4231E+16
I-132		4.7302E+05	4.5826E-05	2.0907E+20	1.7502E+16
I-133		7.4038E+05	6.5358E-04	2.9593E+21	2.7394E+16
I-134		5.5555E+05	2.0825E-05	9.3592E+19	2.0556E+16
I-135		6.7038E+05	1.9089E-04	8.5154E+20	2.4804E+16
Xe-133		1.9932E+03	1.0649E-05	4.8216E+19	7.3749E+13
Xe-135		2.3557E+04	9.2245E-06	4.1149E+19	8.7160E+14
Cs-134		2.5173E+04	1.9456E-02	8.7439E+22	9.3140E+14
Cs-136		7.2499E+03	9.8920E-05	4.3802E+20	2.6825E+14
Cs-137		1.3594E+04	1.5628E-01	6.8698E+23	5.0297E+14
I-130		1.8741E+04	9.6089E-06	4.4512E+19	6.9340E+14
Kr-83m		7.5364E+03	3.6527E-07	2.6503E+18	2.7885E+14
Xe-131m		5.1819E+00	6.1865E-08	2.8440E+17	1.9173E+11
Xe-133m		1.4242E+02	3.1741E-07	1.4372E+18	5.2697E+12
Xe-135m		8.0379E+04	8.8240E-07	3.9362E+18	2.9740E+15
Cs-138		8.6820E+04	2.0518E-06	8.9537E+18	3.2123E+15
Cs-134m		5.3953E+03	6.6903E-07	3.0067E+18	1.9963E+14
Rb-88		2.0632E+04	1.7188E-07	1.1762E+18	7.6338E+14
Rb-89		2.1694E+04	1.5608E-07	1.0561E+18	8.0269E+14
Ba-137m		1.5030E+04	2.7948E-08	1.2285E+17	5.5613E+14
Br-82		2.6932E+03	2.4877E-06	1.8270E+19	9.9650E+13
Br-83		4.0542E+04	2.5663E-06	1.8620E+19	1.5000E+15
Br-84		4.2601E+04	6.0521E-07	4.3389E+18	1.5762E+15

## PCS Transport Group Inventory:

Time (h) =	0.5000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		9.7673E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.7908E+22	0.0000E+00	0.0000E+00
Organic I (atoms)		5.5384E+20	0.0000E+00	0.0000E+00
Aerosols (kg)		1.7585E-01	0.0000E+00	0.0000E+00

Time (h) =	0.5000	Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

## SG Tube Leakage Transport Group Inventory:

Time (h) =	0.5000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

## Environment Integral Nuclide Release:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) =	Ci	kg	Atoms	Bq
0.5000				
Rb-86	1.7168E-04	2.1099E-12	1.4775E+13	6.3522E+06
Sr-89	9.4185E-06	3.2419E-13	2.1936E+12	3.4849E+05
I-131	2.7297E-01	2.2018E-09	1.0122E+16	1.0100E+10
I-132	3.3570E-01	3.2522E-11	1.4837E+14	1.2421E+10
I-133	5.2544E-01	4.6384E-10	2.1002E+15	1.9441E+10
I-134	3.9427E-01	1.4780E-11	6.6422E+13	1.4588E+10
I-135	4.7577E-01	1.3547E-10	6.0433E+14	1.7603E+10
Xe-133	1.4148E-03	7.5586E-12	3.4225E+13	5.2349E+07
Xe-135	1.6721E-02	6.5478E-12	2.9209E+13	6.1869E+08
Cs-134	1.7865E-02	1.3808E-08	6.2055E+16	6.6101E+08
Cs-136	5.1452E-03	7.0203E-11	3.1086E+14	1.9037E+08
Cs-137	9.6475E-03	1.1091E-07	4.8755E+17	3.5696E+08
I-130	1.3300E-02	6.8194E-12	3.1590E+13	4.9210E+08
Kr-83m	5.3495E-03	2.5928E-13	1.8812E+12	1.9793E+08
Xe-131m	3.6783E-06	4.3914E-14	2.0187E+11	1.3610E+05
Xe-133m	1.0110E-04	2.2531E-13	1.0202E+12	3.7406E+06
Xe-135m	5.7055E-02	6.2634E-13	2.7940E+12	2.1110E+09
Cs-138	6.1616E-02	1.4561E-12	6.3544E+12	2.2798E+09
Cs-134m	3.8290E-03	4.7481E-13	2.1338E+12	1.4167E+08
Rb-88	1.4642E-02	1.2198E-13	8.3476E+11	5.4177E+08
Rb-89	1.5396E-02	1.1077E-13	7.4953E+11	5.6967E+08
Ba-137m	1.0667E-02	1.9834E-14	8.7187E+10	3.9468E+08
Br-82	1.9114E-03	1.7655E-12	1.2966E+13	7.0721E+07
Br-83	2.8772E-02	1.8213E-12	1.3214E+13	1.0646E+09
Br-84	3.0234E-02	4.2951E-13	3.0793E+12	1.1186E+09

Environment Transport Group Inventory:

Time (h) =	Present Release	Release Rate/s	Integral Release
0.5000			
Noble gases (atoms)	3.7911E+12	5.2654E+10	6.9331E+13
Elemental I (atoms)	6.9454E+14	9.6464E+12	1.2709E+16
Organic I (atoms)	2.1481E+13	2.9834E+11	3.9306E+14
Aerosols (kg)	6.8202E-09	9.4724E-11	1.2480E-07

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	Pathway Filter
0.5000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
0.5000				
Rb-86	3.2298E-08	3.9694E-16	2.7796E+09	1.1950E+03
Sr-89	1.7719E-09	6.0989E-17	4.1268E+08	6.5560E+01
I-131	5.1352E-05	4.1422E-13	1.9042E+12	1.9000E+06
I-132	6.3154E-05	6.1183E-15	2.7913E+10	2.3367E+06
I-133	9.8850E-05	8.7261E-14	3.9511E+11	3.6574E+06
I-134	7.4174E-05	2.7805E-15	1.2496E+10	2.7444E+06
I-135	8.9505E-05	2.5487E-14	1.1369E+11	3.3117E+06
Cs-134	3.3609E-06	2.5977E-12	1.1674E+13	1.2435E+05
Cs-136	9.6796E-07	1.3207E-14	5.8481E+10	3.5814E+04
Cs-137	1.8150E-06	2.0866E-11	9.1721E+13	6.7154E+04
I-130	2.5021E-06	1.2829E-15	5.9430E+09	9.2578E+04
Cs-138	1.1592E-05	2.7394E-16	1.1954E+09	4.2889E+05
Cs-134m	7.2034E-07	8.9324E-17	4.0144E+08	2.6653E+04
Rb-88	2.7546E-06	2.2948E-17	1.5704E+08	1.0192E+05
Rb-89	2.8965E-06	2.0839E-17	1.4101E+08	1.0717E+05
Ba-137m	2.0068E-06	3.7314E-18	1.6402E+07	7.4250E+04
Br-82	3.5958E-07	3.3214E-16	2.4392E+09	1.3305E+04
Br-83	5.4128E-06	3.4263E-16	2.4860E+09	2.0027E+05
Br-84	5.6878E-06	8.0803E-17	5.7929E+08	2.1045E+05

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	Pathway Filter
0.5000	

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.3909E+12
Organic I (atoms)	7.3945E+10
Aerosols (kg)	2.3478E-11

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.5000	Ci	kg	Atoms	Bq
Rb-86	2.7609E-07	3.3932E-15	2.3760E+10	1.0215E+04
Sr-89	1.5147E-08	5.2136E-16	3.5277E+09	5.6042E+02
I-131	4.3898E-04	3.5408E-12	1.6277E+13	1.6242E+07
I-132	5.3986E-04	5.2301E-14	2.3861E+11	1.9975E+07
I-133	8.4500E-04	7.4593E-13	3.3775E+12	3.1265E+07
I-134	6.3406E-04	2.3768E-14	1.0682E+11	2.3460E+07
I-135	7.6512E-04	2.1787E-13	9.7187E+11	2.8309E+07
Xe-133	3.6111E-06	1.9292E-14	8.7353E+10	1.3361E+05
Xe-135	4.2650E-05	1.6701E-14	7.4500E+10	1.5780E+06
Cs-134	2.8730E-05	2.2206E-11	9.9795E+13	1.0630E+06
Cs-136	8.2744E-06	1.1290E-13	4.9992E+11	3.0615E+05
Cs-137	1.5515E-05	1.7837E-10	7.8406E+14	5.7405E+05
I-130	2.1389E-05	1.0967E-14	5.0802E+10	7.9139E+05
Kr-83m	1.3657E-05	6.6195E-16	4.8028E+09	5.0532E+05
Xe-131m	9.3887E-09	1.1209E-16	5.1528E+08	3.4738E+02
Xe-133m	2.5804E-07	5.7507E-16	2.6039E+09	9.5473E+03
Xe-135m	1.4660E-04	1.6094E-15	7.1791E+09	5.4242E+06
Cs-138	9.9088E-05	2.3417E-15	1.0219E+10	3.6663E+06
Cs-134m	6.1577E-06	7.6357E-16	3.4316E+09	2.2783E+05
Rb-88	2.3547E-05	1.9617E-16	1.3424E+09	8.7126E+05
Rb-89	2.4760E-05	1.7814E-16	1.2054E+09	9.1612E+05
Ba-137m	1.7154E-05	3.1897E-17	1.4021E+08	6.3471E+05
Br-82	3.0738E-06	2.8392E-15	2.0851E+10	1.1373E+05
Br-83	4.6270E-05	2.9289E-15	2.1251E+10	1.7120E+06
Br-84	4.8621E-05	6.9073E-16	4.9520E+09	1.7990E+06

Control Room Transport Group Inventory:

			Overlying
Time (h) = 0.5000	Atmosphere	Sump	Pool
Noble gases (atoms)	1.7695E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.0438E+13	0.0000E+00	0.0000E+00
Organic I (atoms)	6.3210E+11	0.0000E+00	0.0000E+00
Aerosols (kg)	2.0069E-10	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 0.5000	Ci	kg	Atoms	Bq
-------------------	----	----	-------	----

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Rb-86	1.6209E-07	1.9921E-15	1.3950E+10	5.9975E+03
Sr-89	8.8926E-09	3.0609E-16	2.0711E+09	3.2903E+02
I-131	2.5772E-04	2.0788E-12	9.5565E+12	9.5358E+06
I-132	3.1695E-04	3.0706E-14	1.4009E+11	1.1727E+07
I-133	4.9610E-04	4.3794E-13	1.9830E+12	1.8356E+07
I-134	3.7226E-04	1.3954E-14	6.2713E+10	1.3774E+07
I-135	4.4920E-04	1.2791E-13	5.7059E+11	1.6621E+07
Cs-134	1.6868E-05	1.3037E-11	5.8590E+13	6.2410E+05
Cs-136	4.8579E-06	6.6283E-14	2.9350E+11	1.7974E+05
Cs-137	9.1088E-06	1.0472E-10	4.6032E+14	3.3703E+05
I-130	1.2557E-05	6.4386E-15	2.9826E+10	4.6463E+05
Cs-138	5.8175E-05	1.3748E-15	5.9996E+09	2.1525E+06
Cs-134m	3.6152E-06	4.4830E-16	2.0147E+09	1.3376E+05
Rb-88	1.3825E-05	1.1517E-16	7.8815E+08	5.1152E+05
Rb-89	1.4537E-05	1.0459E-16	7.0768E+08	5.3786E+05
Ba-137m	1.0071E-05	1.8727E-17	8.2319E+07	3.7264E+05
Br-82	1.8047E-06	1.6669E-15	1.2242E+10	6.6772E+04
Br-83	2.7166E-05	1.7196E-15	1.2477E+10	1.0051E+06
Br-84	2.8546E-05	4.0553E-16	2.9073E+09	1.0562E+06

	Deposition	Recirculating
Time (h) = 0.5000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.1999E+13
Organic I (atoms)	0.0000E+00	3.7111E+11
Aerosols (kg)	0.0000E+00	1.1783E-10

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 0.5000	Ci	kg	Atoms	Bq
Rb-86	3.2298E-08	3.9694E-16	2.7796E+09	1.1950E+03
Sr-89	1.7719E-09	6.0989E-17	4.1268E+08	6.5560E+01
I-131	5.1352E-05	4.1422E-13	1.9042E+12	1.9000E+06
I-132	6.3154E-05	6.1183E-15	2.7913E+10	2.3367E+06
I-133	9.8850E-05	8.7261E-14	3.9511E+11	3.6574E+06
I-134	7.4174E-05	2.7805E-15	1.2496E+10	2.7444E+06
I-135	8.9505E-05	2.5487E-14	1.1369E+11	3.3117E+06
Cs-134	3.3609E-06	2.5977E-12	1.1674E+13	1.2435E+05
Cs-136	9.6796E-07	1.3207E-14	5.8481E+10	3.5814E+04
Cs-137	1.8150E-06	2.0866E-11	9.1721E+13	6.7154E+04
I-130	2.5021E-06	1.2829E-15	5.9430E+09	9.2578E+04
Cs-138	1.1592E-05	2.7394E-16	1.1954E+09	4.2889E+05
Cs-134m	7.2034E-07	8.9324E-17	4.0144E+08	2.6653E+04
Rb-88	2.7546E-06	2.2948E-17	1.5704E+08	1.0192E+05
Rb-89	2.8965E-06	2.0839E-17	1.4101E+08	1.0717E+05
Ba-137m	2.0068E-06	3.7314E-18	1.6402E+07	7.4250E+04
Br-82	3.5958E-07	3.3214E-16	2.4392E+09	1.3305E+04
Br-83	5.4128E-06	3.4263E-16	2.4860E+09	2.0027E+05
Br-84	5.6878E-06	8.0803E-17	5.7929E+08	2.1045E+05

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	2.3909E+12
Organic I (atoms)	7.3945E+10
Aerosols (kg)	2.3478E-11

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.5000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 0.5000	Ci	kg	Atoms	Bq
Rb-86	1.9439E-07	2.3891E-15	1.6729E+10	7.1925E+03
Sr-89	1.0664E-08	3.6708E-16	2.4838E+09	3.9459E+02
I-131	3.0908E-04	2.4931E-12	1.1461E+13	1.1436E+07
I-132	3.8011E-04	3.6824E-14	1.6800E+11	1.4064E+07
I-133	5.9495E-04	5.2520E-13	2.3781E+12	2.2013E+07
I-134	4.4643E-04	1.6735E-14	7.5209E+10	1.6518E+07
I-135	5.3871E-04	1.5340E-13	6.8428E+11	1.9932E+07
Cs-134	2.0229E-05	1.5635E-11	7.0264E+13	7.4846E+05
Cs-136	5.8259E-06	7.9490E-14	3.5198E+11	2.1556E+05
Cs-137	1.0924E-05	1.2559E-10	5.5205E+14	4.0418E+05
I-130	1.5060E-05	7.7215E-15	3.5769E+10	5.5720E+05
Cs-138	6.9767E-05	1.6488E-15	7.1950E+09	2.5814E+06
Cs-134m	4.3356E-06	5.3762E-16	2.4161E+09	1.6042E+05
Rb-88	1.6579E-05	1.3812E-16	9.4519E+08	6.1344E+05
Rb-89	1.7433E-05	1.2543E-16	8.4869E+08	6.4503E+05
Ba-137m	1.2078E-05	2.2458E-17	9.8721E+07	4.4689E+05
Br-82	2.1642E-06	1.9990E-15	1.4681E+10	8.0077E+04
Br-83	3.2578E-05	2.0622E-15	1.4963E+10	1.2054E+06
Br-84	3.4233E-05	4.8633E-16	3.4866E+09	1.2666E+06

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.5000	Ci	kg	Atoms	Bq
Rb-86	8.3724E-02	1.0290E-09	7.2053E+15	3.0978E+09
Sr-89	4.5932E-03	1.5810E-10	1.0698E+15	1.6995E+08
I-131	1.3312E+02	1.0738E-06	4.9361E+18	4.9254E+12
I-132	1.6371E+02	1.5860E-08	7.2358E+16	6.0573E+12
I-133	2.5624E+02	2.2620E-07	1.0242E+18	9.4810E+12
I-134	1.9228E+02	7.2077E-09	3.2392E+16	7.1142E+12
I-135	2.3202E+02	6.6067E-08	2.9472E+17	8.5847E+12
Xe-133	6.8985E-01	3.6855E-09	1.6687E+16	2.5524E+10
Xe-135	8.1530E+00	3.1926E-09	1.4242E+16	3.0166E+11
Cs-134	8.7124E+00	6.7338E-06	3.0263E+19	3.2236E+11
Cs-136	2.5092E+00	3.4236E-08	1.5160E+17	9.2840E+10
Cs-137	4.7048E+00	5.4090E-05	2.3776E+20	1.7408E+11
I-130	6.4861E+00	3.3256E-09	1.5406E+16	2.3999E+11
Kr-83m	2.6083E+00	1.2642E-10	9.1726E+14	9.6508E+10
Xe-131m	1.7935E-03	2.1412E-11	9.8430E+13	6.6358E+07
Xe-133m	4.9293E-02	1.0986E-10	4.9742E+14	1.8238E+09
Xe-135m	2.7819E+01	3.0540E-10	1.3623E+15	1.0293E+12
Cs-138	3.0048E+01	7.1012E-10	3.0989E+15	1.1118E+12
Cs-134m	1.8673E+00	2.3155E-10	1.0406E+15	6.9090E+10
Rb-88	7.1407E+00	5.9487E-11	4.0709E+14	2.6421E+11
Rb-89	7.5084E+00	5.4021E-11	3.6553E+14	2.7781E+11
Ba-137m	5.2020E+00	9.6727E-12	4.2519E+13	1.9247E+11
Br-82	9.3213E-01	8.6098E-10	6.3231E+15	3.4489E+10
Br-83	1.4031E+01	8.8819E-10	6.4443E+15	5.1916E+11
Br-84	1.4744E+01	2.0946E-10	1.5017E+15	5.4553E+11

SGs Transport Group Inventory:

Time (h) = 0.5000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	3.3804E+16	0.0000E+00	0.0000E+00
Elemental I (atoms)	6.1978E+18	0.0000E+00	0.0000E+00
Organic I (atoms)	1.9168E+17	0.0000E+00	0.0000E+00
Aerosols (kg)	6.0860E-05	0.0000E+00	0.0000E+00



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Deposition Recirculating	
	Surfaces	Filter
Time (h) =	0.5000	
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

## SG Tube Leakage Transport Group Inventory:

	Pathway
	Filter
Time (h) =	0.5000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

	Pathway
	Filter
Time (h) =	0.5000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 2.0000

## EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.0805E-03	6.6046E-01	3.1524E-03	2.4699E-02
Accumulated dose (rem)	2.4457E-03	7.3788E-01	3.7110E-03	2.7725E-02

## LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.5707E-04	8.1607E-02	3.8951E-04	3.0518E-03
Accumulated dose (rem)	3.0219E-04	9.1174E-02	4.5854E-04	3.4258E-03

## Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.7901E-05	2.3288E-01	1.4473E-03	8.0139E-03
Accumulated dose (rem)	8.6909E-05	6.6257E-01	4.4995E-03	2.2840E-02

## PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
Rb-86	2.4110E+02	2.9631E-06	2.0749E+19	8.9206E+12
Sr-89	1.7698E+01	6.0919E-07	4.1220E+18	6.5484E+11
I-131	3.8216E+05	3.0826E-03	1.4171E+22	1.4140E+16
I-132	3.0068E+05	2.9129E-05	1.3289E+20	1.1125E+16
I-133	7.0355E+05	6.2106E-04	2.8121E+21	2.6031E+16
I-134	1.6951E+05	6.3544E-06	2.8557E+19	6.2720E+15
I-135	5.7222E+05	1.6294E-04	7.2684E+20	2.1172E+16
Xe-133	7.7398E+03	4.1349E-05	1.8723E+20	2.8637E+14
Xe-135	8.7584E+04	3.4297E-05	1.5299E+20	3.2406E+15
Cs-134	2.5146E+04	1.9435E-02	8.7344E+22	9.3039E+14
Cs-136	7.2185E+03	9.8491E-05	4.3612E+20	2.6708E+14
Cs-137	1.3580E+04	1.5612E-01	6.8627E+23	5.0245E+14
I-130	1.7211E+04	8.8245E-06	4.0879E+19	6.3680E+14
Kr-83m	1.8263E+04	8.8516E-07	6.4224E+18	6.7572E+14
Xe-131m	2.0614E+01	2.4611E-07	1.1314E+18	7.6273E+11
Xe-133m	5.4967E+02	1.2250E-06	5.5468E+18	2.0338E+13
Xe-135m	9.3666E+04	1.0282E-06	4.5869E+18	3.4656E+15
Cs-138	1.2496E+04	2.9532E-07	1.2887E+18	4.6236E+14
Cs-134m	3.7658E+03	4.6697E-07	2.0986E+18	1.3934E+14
Rb-88	6.1948E+02	5.1607E-09	3.5316E+16	2.2921E+13
Rb-89	3.5767E+02	2.5733E-09	1.7412E+16	1.3234E+13
Ba-137m	1.5053E+04	2.7991E-08	1.2304E+17	5.5698E+14
Br-82	2.6124E+03	2.4130E-06	1.7721E+19	9.6657E+13
Br-83	2.6213E+04	1.6593E-06	1.2039E+19	9.6988E+14

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Br-84 5.9841E+03 8.5012E-08 6.0947E+17 2.2141E+14

## PCS Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0000			
Noble gases (atoms)	3.5790E+20	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.7404E+22	0.0000E+00	0.0000E+00
Organic I (atoms)	5.3827E+20	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7566E-01	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 2.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

## SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Environment Integral Nuclide Release:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	1.6587E-03	2.0385E-11	1.4275E+14	6.1372E+07
Sr-89	1.2176E-04	4.1911E-12	2.8359E+13	4.5051E+06
I-131	2.6292E+00	2.1207E-08	9.7491E+16	9.7280E+10
I-132	2.0686E+00	2.0040E-10	9.1429E+14	7.6538E+10
I-133	4.8402E+00	4.2728E-09	1.9347E+16	1.7909E+11
I-134	1.1662E+00	4.3717E-11	1.9647E+14	4.3150E+10
I-135	3.9367E+00	1.1210E-09	5.0005E+15	1.4566E+11
Xe-133	5.3270E-02	2.8459E-10	1.2886E+15	1.9710E+09
Xe-135	6.0281E-01	2.3605E-10	1.0530E+15	2.2304E+10
Cs-134	1.7300E-01	1.3371E-07	6.0091E+17	6.4009E+09
Cs-136	4.9662E-02	6.7760E-10	3.0004E+15	1.8375E+09
Cs-137	9.3426E-02	1.0741E-06	4.7214E+18	3.4567E+09
I-130	1.1841E-01	6.0711E-11	2.8124E+14	4.3810E+09
Kr-83m	1.2570E-01	6.0922E-12	4.4203E+13	4.6507E+09
Xe-131m	1.4188E-04	1.6939E-12	7.7869E+12	5.2496E+06
Xe-133m	3.7832E-03	8.4313E-12	3.8176E+13	1.3998E+08
Xe-135m	6.4457E-01	7.0760E-12	3.1565E+13	2.3849E+10
Cs-138	8.5972E-02	2.0317E-12	8.8662E+12	3.1809E+09
Cs-134m	2.5908E-02	3.2127E-12	1.4438E+13	9.5860E+08
Rb-88	4.2619E-03	3.5504E-14	2.4297E+11	1.5769E+08
Rb-89	2.4607E-03	1.7704E-14	1.1979E+11	9.1046E+07
Ba-137m	1.0356E-01	1.9257E-13	8.4649E+11	3.8319E+09
Br-82	1.7972E-02	1.6601E-11	1.2192E+14	6.6498E+08
Br-83	1.8034E-01	1.1416E-11	8.2827E+13	6.6726E+09
Br-84	4.1169E-02	5.8487E-13	4.1930E+12	1.5233E+09

## Environment Transport Group Inventory:

	Present Release	Release Rate/s	Integral Release
Time (h) = 2.0000			
Noble gases (atoms)	4.6825E+13	6.5035E+11	2.4633E+15
Elemental I (atoms)	2.2756E+15	3.1606E+13	1.1974E+17
Organic I (atoms)	7.0380E+13	9.7750E+11	3.7032E+15
Aerosols (kg)	2.2968E-08	3.1900E-10	1.2085E-06

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Rb-86	7.5559E-07	9.2861E-15	6.5026E+10	2.7957E+04
Sr-89	5.5466E-08	1.9092E-15	1.2918E+10	2.0522E+03
I-131	1.1977E-03	9.6606E-12	4.4410E+13	4.4314E+07
I-132	9.4231E-04	9.1290E-14	4.1649E+11	3.4866E+07
I-133	2.2049E-03	1.9464E-12	8.8131E+12	8.1581E+07
I-134	5.3125E-04	1.9914E-14	8.9497E+10	1.9656E+07
I-135	1.7933E-03	5.1064E-13	2.2779E+12	6.6352E+07
Cs-134	7.8806E-05	6.0909E-11	2.7373E+14	2.9158E+06
Cs-136	2.2622E-05	3.0867E-13	1.3668E+12	8.3703E+05
Cs-137	4.2558E-05	4.8928E-10	2.1507E+15	1.5747E+06
I-130	5.3938E-05	2.7655E-14	1.2811E+11	1.9957E+06
Cs-138	3.9163E-05	9.2552E-16	4.0388E+09	1.4490E+06
Cs-134m	1.1802E-05	1.4635E-15	6.5770E+09	4.3667E+05
Rb-88	1.9414E-06	1.6173E-17	1.1068E+08	7.1833E+04
Rb-89	1.1209E-06	8.0646E-18	5.4569E+07	4.1474E+04
Ba-137m	4.7177E-05	8.7722E-17	3.8560E+08	1.7455E+06
Br-82	8.1870E-06	7.5621E-15	5.5536E+10	3.0292E+05
Br-83	8.2151E-05	5.2001E-15	3.7730E+10	3.0396E+06
Br-84	1.8754E-05	2.6642E-16	1.9100E+09	6.9389E+05

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.4544E+13
Organic I (atoms)	1.6869E+12
Aerosols (kg)	5.5051E-10

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	Filter
2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) =	Filter
2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Rb-86	2.5117E-08	3.0868E-16	2.1615E+09	9.2932E+02
Sr-89	1.8438E-09	6.3463E-17	4.2942E+08	6.8219E+01
I-131	3.9812E-05	3.2113E-13	1.4763E+12	1.4731E+06
I-132	3.1324E-05	3.0346E-15	1.3845E+10	1.1590E+06
I-133	7.3293E-05	6.4700E-14	2.9296E+11	2.7119E+06
I-134	1.7659E-05	6.6198E-16	2.9750E+09	6.5340E+05
I-135	5.9612E-05	1.6974E-14	7.5720E+10	2.2056E+06
Xe-133	1.3952E-05	7.4540E-14	3.3751E+11	5.1624E+05
Xe-135	1.5503E-04	6.0709E-14	2.7081E+11	5.7362E+06
Cs-134	2.6196E-06	2.0247E-12	9.0992E+12	9.6926E+04

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-136	7.5200E-07	1.0260E-14	4.5434E+10	2.7824E+04
Cs-137	1.4147E-06	1.6264E-11	7.1493E+13	5.2344E+04
I-130	1.7930E-06	9.1931E-16	4.2586E+09	6.6340E+04
Kr-83m	3.3733E-05	1.6350E-15	1.1863E+10	1.2481E+06
Xe-131m	3.7370E-08	4.4615E-16	2.0510E+09	1.3827E+03
Xe-133m	9.9254E-07	2.2120E-15	1.0016E+10	3.6724E+04
Xe-135m	2.6726E-04	2.9340E-15	1.3088E+10	9.8888E+06
Cs-138	1.3018E-06	3.0765E-17	1.3426E+08	4.8167E+04
Cs-134m	3.9231E-07	4.8648E-17	2.1863E+08	1.4516E+04
Rb-88	6.4536E-08	5.3763E-19	3.6792E+06	2.3878E+03
Rb-89	3.7261E-08	2.6808E-19	1.8139E+06	1.3787E+03
Ba-137m	1.5682E-06	2.9160E-18	1.2818E+07	5.8024E+04
Br-82	2.7215E-07	2.5137E-16	1.8461E+09	1.0069E+04
Br-83	2.7308E-06	1.7286E-16	1.2542E+09	1.0104E+05
Br-84	6.2340E-07	8.8563E-18	6.3493E+07	2.3066E+04

## Control Room Transport Group Inventory:

Time (h) = 2.0000		Overlying	
		Atmosphere	Sump Pool
Noble gases (atoms)	6.4534E+11	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.8131E+12	0.0000E+00	0.0000E+00
Organic I (atoms)	5.6075E+10	0.0000E+00	0.0000E+00
Aerosols (kg)	1.8300E-11	0.0000E+00	0.0000E+00

## Recirculating Filter Inventory

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	3.4698E-07	4.2644E-15	2.9861E+10	1.2838E+04
Sr-89	2.5471E-08	8.7673E-16	5.9324E+09	9.4243E+02
I-131	5.5000E-04	4.4364E-12	2.0394E+13	2.0350E+07
I-132	4.3273E-04	4.1923E-14	1.9126E+11	1.6011E+07
I-133	1.0125E-03	8.9382E-13	4.0472E+12	3.7464E+07
I-134	2.4396E-04	9.1451E-15	4.1099E+10	9.0265E+06
I-135	8.2352E-04	2.3450E-13	1.0461E+12	3.0470E+07
Cs-134	3.6189E-05	2.7971E-11	1.2570E+14	1.3390E+06
Cs-136	1.0389E-05	1.4175E-13	6.2766E+11	3.8438E+05
Cs-137	1.9544E-05	2.2469E-10	9.8766E+14	7.2312E+05
I-130	2.4769E-05	1.2700E-14	5.8832E+10	9.1647E+05
Cs-138	1.7984E-05	4.2502E-16	1.8547E+09	6.6542E+05
Cs-134m	5.4197E-06	6.7206E-16	3.0203E+09	2.0053E+05
Rb-88	8.9155E-07	7.4272E-18	5.0827E+07	3.2987E+04
Rb-89	5.1475E-07	3.7035E-18	2.5059E+07	1.9046E+04
Ba-137m	2.1665E-05	4.0284E-17	1.7708E+08	8.0159E+05
Br-82	3.7597E-06	3.4727E-15	2.5504E+10	1.3911E+05
Br-83	3.7725E-05	2.3880E-15	1.7326E+10	1.3958E+06
Br-84	8.6122E-06	1.2235E-16	8.7714E+08	3.1865E+05

## Deposition Recirculating

Time (h) = 2.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	2.5048E+13
Organic I (atoms)	0.0000E+00	7.7467E+11
Aerosols (kg)	0.0000E+00	2.5281E-10

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 2.0000	Pathway	
	Filter	
Noble gases (atoms)	0.0000E+00	
Elemental I (atoms)	0.0000E+00	
Organic I (atoms)	0.0000E+00	
Aerosols (kg)	0.0000E+00	

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	7.5559E-07	9.2861E-15	6.5026E+10	2.7957E+04
Sr-89	5.5466E-08	1.9092E-15	1.2918E+10	2.0522E+03
I-131	1.1977E-03	9.6606E-12	4.4410E+13	4.4314E+07
I-132	9.4231E-04	9.1290E-14	4.1649E+11	3.4866E+07
I-133	2.2049E-03	1.9464E-12	8.8131E+12	8.1581E+07
I-134	5.3125E-04	1.9914E-14	8.9497E+10	1.9656E+07

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-135	1.7933E-03	5.1064E-13	2.2779E+12	6.6352E+07
Cs-134	7.8806E-05	6.0909E-11	2.7373E+14	2.9158E+06
Cs-136	2.2622E-05	3.0867E-13	1.3668E+12	8.3703E+05
Cs-137	4.2558E-05	4.8928E-10	2.1507E+15	1.5747E+06
I-130	5.3938E-05	2.7655E-14	1.2811E+11	1.9957E+06
Cs-138	3.9163E-05	9.2552E-16	4.0388E+09	1.4490E+06
Cs-134m	1.1802E-05	1.4635E-15	6.5770E+09	4.3667E+05
Rb-88	1.9414E-06	1.6173E-17	1.1068E+08	7.1833E+04
Rb-89	1.1209E-06	8.0646E-18	5.4569E+07	4.1474E+04
Ba-137m	4.7177E-05	8.7722E-17	3.8560E+08	1.7455E+06
Br-82	8.1870E-06	7.5621E-15	5.5536E+10	3.0292E+05
Br-83	8.2151E-05	5.2001E-15	3.7730E+10	3.0396E+06
Br-84	1.8754E-05	2.6642E-16	1.9100E+09	6.9389E+05

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	2.0000 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.4544E+13
Organic I (atoms)	1.6869E+12
Aerosols (kg)	5.5051E-10

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	2.0000 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	2.0000 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Total Filter Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
Rb-86	1.1026E-06	1.3550E-14	9.4887E+10	4.0795E+04
Sr-89	8.0937E-08	2.7859E-15	1.8851E+10	2.9947E+03
I-131	1.7477E-03	1.4097E-11	6.4805E+13	6.4664E+07
I-132	1.3750E-03	1.3321E-13	6.0775E+11	5.0877E+07
I-133	3.2174E-03	2.8402E-12	1.2860E+13	1.1904E+08
I-134	7.7521E-04	2.9059E-14	1.3060E+11	2.8683E+07
I-135	2.6168E-03	7.4514E-13	3.3240E+12	9.6822E+07
Cs-134	1.1499E-04	8.8880E-11	3.9944E+14	4.2548E+06
Cs-136	3.3011E-05	4.5041E-13	1.9944E+12	1.2214E+06
Cs-137	6.2102E-05	7.1396E-10	3.1384E+15	2.2978E+06
I-130	7.8707E-05	4.0356E-14	1.8694E+11	2.9122E+06
Cs-138	5.7147E-05	1.3505E-15	5.8936E+09	2.1144E+06
Cs-134m	1.7222E-05	2.1355E-15	9.5973E+09	6.3720E+05
Rb-88	2.8330E-06	2.3601E-17	1.6151E+08	1.0482E+05
Rb-89	1.6357E-06	1.1768E-17	7.9628E+07	6.0520E+04
Ba-137m	6.8842E-05	1.2801E-16	5.6268E+08	2.5471E+06
Br-82	1.1947E-05	1.1035E-14	8.1040E+10	4.4203E+05
Br-83	1.1988E-04	7.5882E-15	5.5057E+10	4.4354E+06
Br-84	2.7366E-05	3.8877E-16	2.7872E+09	1.0125E+06

## SGs Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
Rb-86	3.3300E-01	4.0925E-09	2.8658E+16	1.2321E+10
Sr-89	2.4445E-02	8.4140E-10	5.6933E+15	9.0445E+08
I-131	5.2783E+02	4.2576E-06	1.9572E+19	1.9530E+13
I-132	4.1529E+02	4.0233E-08	1.8355E+17	1.5366E+13
I-133	9.7173E+02	8.5780E-07	3.8841E+18	3.5954E+13
I-134	2.3413E+02	8.7765E-09	3.9443E+16	8.6628E+12

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-135	7.9034E+02	2.2505E-07	1.0039E+18	2.9242E+13
Xe-133	1.0690E+01	5.7111E-08	2.5859E+17	3.9553E+11
Xe-135	1.2097E+02	4.7370E-08	2.1131E+17	4.4759E+12
Cs-134	3.4731E+01	2.6844E-05	1.2064E+20	1.2850E+12
Cs-136	9.9700E+00	1.3603E-07	6.0236E+17	3.6889E+11
Cs-137	1.8756E+01	2.1563E-04	9.4786E+20	6.9398E+11
I-130	2.3771E+01	1.2188E-08	5.6461E+16	8.7953E+11
Kr-83m	2.5224E+01	1.2226E-09	8.8705E+15	9.3329E+11
Xe-131m	2.8472E-02	3.3992E-10	1.5626E+15	1.0535E+09
Xe-133m	7.5919E-01	1.6920E-09	7.6611E+15	2.8090E+10
Xe-135m	1.2937E+02	1.4202E-09	6.3353E+15	4.7867E+12
Cs-138	1.7260E+01	4.0789E-10	1.7800E+15	6.3861E+11
Cs-134m	5.2013E+00	6.4497E-10	2.8986E+15	1.9245E+11
Rb-88	8.5562E-01	7.1279E-12	4.8778E+13	3.1658E+10
Rb-89	4.9401E-01	3.5542E-12	2.4049E+13	1.8278E+10
Ba-137m	2.0792E+01	3.8660E-11	1.6994E+14	7.6929E+11
Br-82	3.6081E+00	3.3327E-09	2.4476E+16	1.3350E+11
Br-83	3.6205E+01	2.2918E-09	1.6628E+16	1.3396E+12
Br-84	8.2651E+00	1.1742E-10	8.4179E+14	3.0581E+11

SGs Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 2.0000			
Noble gases (atoms)	4.9433E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.4038E+19	0.0000E+00	0.0000E+00
Organic I (atoms)	7.4345E+17	0.0000E+00	0.0000E+00
Aerosols (kg)	2.4262E-04	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 2.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway Filter
Time (h) = 2.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 8.0000

EAB Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 8.0000				
Delta dose (rem)	1.5873E-02	9.8674E+00	2.5080E-02	3.5279E-01
Accumulated dose (rem)	1.8319E-02	1.0605E+01	2.8791E-02	3.8052E-01

LPZ Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 8.0000				
Delta dose (rem)	8.9231E-04	5.5470E-01	1.4099E-03	1.9832E-02
Accumulated dose (rem)	1.1945E-03	6.4587E-01	1.8684E-03	2.3258E-02

Control Room Doses:

	Whole Body	Thyroid	Skin	TEDE
Time (h) = 8.0000				
Delta dose (rem)	9.8870E-05	8.9191E-01	5.8297E-03	3.0553E-02
Accumulated dose (rem)	1.8578E-04	1.5545E+00	1.0329E-02	5.3393E-02

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## PCS Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	2.3788E+02	2.9235E-06	2.0472E+19	8.8014E+12
Sr-89	1.7639E+01	6.0713E-07	4.1081E+18	6.5263E+11
I-131	3.7246E+05	3.0043E-03	1.3811E+22	1.3781E+16
I-132	4.9091E+04	4.7559E-06	2.1697E+19	1.8164E+15
I-133	5.7365E+05	5.0640E-04	2.2929E+21	2.1225E+16
I-134	1.4693E+03	5.5079E-08	2.4753E+17	5.4365E+13
I-135	3.0374E+05	8.6490E-05	3.8582E+20	1.1238E+16
Xe-133	2.7527E+04	1.4706E-04	6.6588E+20	1.0185E+15
Xe-135	2.0788E+05	8.1401E-05	3.6312E+20	7.6914E+15
Cs-134	2.5036E+04	1.9350E-02	8.6963E+22	9.2633E+14
Cs-136	7.0940E+03	9.6793E-05	4.2860E+20	2.6248E+14
Cs-137	1.3523E+04	1.5547E-01	6.8340E+23	5.0036E+14
I-130	1.2242E+04	6.2770E-06	2.9078E+19	4.5296E+14
Kr-83m	9.9770E+03	4.8357E-07	3.5086E+18	3.6915E+14
Xe-131m	8.0647E+01	9.6283E-07	4.4262E+18	2.9840E+12
Xe-133m	1.9063E+03	4.2484E-06	1.9236E+19	7.0532E+13
Xe-135m	4.9988E+04	5.4876E-07	2.4479E+18	1.8495E+15
Cs-138	5.3631E+00	1.2675E-10	5.5310E+14	1.9844E+11
Cs-134m	8.9378E+02	1.1083E-07	4.9809E+17	3.3070E+13
Rb-88	5.0347E-04	4.1942E-15	2.8703E+10	1.8628E+07
Rb-89	2.6425E-05	1.9012E-16	1.2864E+09	9.7773E+05
Ba-137m	1.4991E+04	2.7874E-08	1.2253E+17	5.5466E+14
Br-82	2.3124E+03	2.1359E-06	1.5686E+19	8.5558E+13
Br-83	4.5813E+03	2.9000E-07	2.1041E+18	1.6951E+14
Br-84	2.3297E+00	3.3097E-11	2.3728E+14	8.6200E+10

## PCS Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
8.0000			
Noble gases (atoms)	1.0586E+21	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.6062E+22	0.0000E+00	0.0000E+00
Organic I (atoms)	4.9676E+20	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7492E-01	0.0000E+00	0.0000E+00

Time (h) =	Surfaces	Recirculating Filter
8.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

## SG Tube Leakage Transport Group Inventory:

Time (h) =	Pathway Filter
8.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Environment Integral Nuclide Release:

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	2.4961E-02	3.0676E-10	2.1481E+15	9.2354E+08
Sr-89	1.8508E-03	6.3707E-11	4.3107E+14	6.8481E+07
I-131	3.9082E+01	3.1524E-07	1.4492E+18	1.4460E+12
I-132	5.1511E+00	4.9904E-10	2.2767E+15	1.9059E+11
I-133	6.0194E+01	5.3137E-08	2.4060E+17	2.2272E+12
I-134	1.5418E-01	5.7795E-12	2.5974E+13	5.7046E+09
I-135	3.1872E+01	9.0755E-09	4.0484E+16	1.1793E+12
Xe-133	2.8896E+00	1.5438E-08	6.9900E+16	1.0692E+11
Xe-135	2.1821E+01	8.5449E-09	3.8118E+16	8.0739E+11
Cs-134	2.6271E+00	2.0305E-06	9.1251E+18	9.7201E+10
Cs-136	7.4438E-01	1.0157E-08	4.4974E+16	2.7542E+10
Cs-137	1.4190E+00	1.6314E-05	7.1710E+19	5.2503E+10
I-130	1.2846E+00	6.5865E-10	3.0511E+15	4.7530E+10
Kr-83m	1.0473E+00	5.0762E-11	3.6831E+14	3.8751E+10
Xe-131m	8.4659E-03	1.0107E-10	4.6463E+14	3.1324E+08

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-133m	2.0011E-01	4.4597E-10	2.0193E+15	7.4040E+09
Xe-135m	5.2463E+00	5.7594E-11	2.5692E+14	1.9411E+11
Cs-138	5.6276E-04	1.3300E-14	5.8037E+10	2.0822E+07
Cs-134m	9.3785E-02	1.1630E-11	5.2265E+13	3.4701E+09
Ba-137m	1.5730E+00	2.9249E-12	1.2857E+13	5.8201E+10
Br-82	2.4264E-01	2.2412E-10	1.6459E+15	8.9777E+09
Br-83	4.8072E-01	3.0430E-11	2.2078E+14	1.7787E+10
Br-84	2.4446E-04	3.4729E-15	2.4898E+10	9.0450E+06

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 8.0000	Release	Rate/s	Release
Noble gases (atoms)	5.4951E+14	7.6321E+12	1.1113E+17
Elemental I (atoms)	8.3323E+15	1.1573E+14	1.6854E+18
Organic I (atoms)	2.5770E+14	3.5792E+12	5.2125E+16
Aerosols (kg)	9.0743E-08	1.2603E-09	1.8355E-05

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	1.0640E-05	1.3077E-13	9.1570E+11	3.9369E+05
Sr-89	7.8897E-07	2.7157E-14	1.8376E+11	2.9192E+04
I-131	1.6660E-02	1.3438E-10	6.1776E+14	6.1642E+08
I-132	2.1958E-03	2.1273E-13	9.7052E+11	8.1246E+07
I-133	2.5660E-02	2.2651E-11	1.0256E+14	9.4940E+08
I-134	6.5723E-05	2.4637E-15	1.1072E+10	2.4317E+06
I-135	1.3586E-02	3.8687E-12	1.7258E+13	5.0269E+08
Cs-134	1.1199E-03	8.6554E-10	3.8899E+15	4.1435E+07
Cs-136	3.1732E-04	4.3295E-12	1.9171E+13	1.1741E+07
Cs-137	6.0489E-04	6.9542E-09	3.0569E+16	2.2381E+07
I-130	5.4759E-04	2.8077E-13	1.3006E+12	2.0261E+07
Cs-138	2.3989E-07	5.6693E-18	2.4740E+07	8.8761E+03
Cs-134m	3.9979E-05	4.9575E-15	2.2280E+10	1.4792E+06
Ba-137m	6.7054E-04	1.2468E-15	5.4806E+09	2.4810E+07
Br-82	1.0343E-04	9.5538E-14	7.0163E+11	3.8270E+06
Br-83	2.0492E-04	1.2972E-14	9.4116E+10	7.5821E+06
Br-84	1.0421E-07	1.4804E-18	1.0613E+07	3.8557E+03

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	7.1844E+14
Organic I (atoms)	2.2220E+13
Aerosols (kg)	7.8242E-09

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Aerosols (kg) 0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	8.6210E-08	1.0595E-15	7.4192E+09	3.1898E+03
Sr-89	6.3925E-09	2.2003E-16	1.4889E+09	2.3652E+02
I-131	1.3498E-04	1.0888E-12	5.0053E+12	4.9944E+06
I-132	1.7791E-05	1.7236E-15	7.8634E+09	6.5827E+05
I-133	2.0790E-04	1.8353E-13	8.3099E+11	7.6923E+06
I-134	5.3250E-07	1.9961E-17	8.9709E+07	1.9703E+04
I-135	1.1008E-04	3.1345E-14	1.3983E+11	4.0730E+06
Xe-133	1.9394E-04	1.0361E-12	4.6915E+12	7.1759E+06
Xe-135	1.4339E-03	5.6149E-13	2.5047E+12	5.3054E+07
Cs-134	9.0734E-06	7.0128E-12	3.1517E+13	3.3572E+05
Cs-136	2.5710E-06	3.5079E-14	1.5533E+11	9.5126E+04
Cs-137	4.9010E-06	5.6345E-11	2.4768E+14	1.8134E+05
I-130	4.4368E-06	2.2749E-15	1.0538E+10	1.6416E+05
Kr-83m	8.0027E-05	3.8788E-15	2.8143E+10	2.9610E+06
Xe-131m	5.8476E-07	6.9813E-15	3.2093E+10	2.1636E+04
Xe-133m	1.3545E-05	3.0187E-14	1.3669E+11	5.0117E+05
Xe-135m	1.3941E-03	1.5304E-14	6.8271E+10	5.1582E+07
Cs-138	1.9437E-09	4.5934E-20	2.0045E+05	7.1916E+01
Cs-134m	3.2392E-07	4.0167E-17	1.8052E+08	1.1985E+04
Ba-137m	5.4329E-06	1.0102E-17	4.4405E+07	2.0102E+05
Br-82	8.3804E-07	7.7407E-16	5.6848E+09	3.1007E+04
Br-83	1.6603E-06	1.0510E-16	7.6255E+08	6.1432E+04

## Control Room Transport Group Inventory:

Time (h) = 8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	7.4614E+12	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.8210E+12	0.0000E+00	0.0000E+00
Organic I (atoms)	1.8003E+11	0.0000E+00	0.0000E+00
Aerosols (kg)	6.3394E-11	0.0000E+00	0.0000E+00

## Recirculating Filter Inventory

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	1.0942E-06	1.3448E-14	9.4170E+10	4.0487E+04
Sr-89	8.1138E-08	2.7928E-15	1.8898E+10	3.0021E+03
I-131	1.7133E-03	1.3820E-11	6.3531E+13	6.3393E+07
I-132	2.2582E-04	2.1877E-14	9.9808E+10	8.3553E+06
I-133	2.6388E-03	2.3295E-12	1.0548E+13	9.7637E+07
I-134	6.7589E-06	2.5336E-16	1.1387E+09	2.5008E+05
I-135	1.3972E-03	3.9786E-13	1.7748E+12	5.1697E+07
Cs-134	1.1517E-04	8.9012E-11	4.0003E+14	4.2612E+06
Cs-136	3.2633E-05	4.4525E-13	1.9716E+12	1.2074E+06
Cs-137	6.2207E-05	7.1517E-10	3.1437E+15	2.3017E+06
I-130	5.6315E-05	2.8874E-14	1.3376E+11	2.0836E+06
Cs-138	2.4671E-08	5.8303E-19	2.5443E+06	9.1282E+02
Cs-134m	4.1114E-06	5.0983E-16	2.2912E+09	1.5212E+05
Ba-137m	6.8958E-05	1.2822E-16	5.6363E+08	2.5514E+06
Br-82	1.0637E-05	9.8251E-15	7.2156E+10	3.9357E+05
Br-83	2.1074E-05	1.3340E-15	9.6789E+09	7.7974E+05
Br-84	1.0717E-08	1.5225E-19	1.0915E+06	3.9652E+02

Time (h) = 8.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	7.3885E+13
Organic I (atoms)	0.0000E+00	2.2851E+12
Aerosols (kg)	0.0000E+00	8.0465E-10

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	1.0640E-05	1.3077E-13	9.1570E+11	3.9369E+05
Sr-89	7.8897E-07	2.7157E-14	1.8376E+11	2.9192E+04
I-131	1.6660E-02	1.3438E-10	6.1776E+14	6.1642E+08
I-132	2.1958E-03	2.1273E-13	9.7052E+11	8.1246E+07
I-133	2.5660E-02	2.2651E-11	1.0256E+14	9.4940E+08
I-134	6.5723E-05	2.4637E-15	1.1072E+10	2.4317E+06
I-135	1.3586E-02	3.8687E-12	1.7258E+13	5.0269E+08
Cs-134	1.1199E-03	8.6554E-10	3.8899E+15	4.1435E+07
Cs-136	3.1732E-04	4.3295E-12	1.9171E+13	1.1741E+07
Cs-137	6.0489E-04	6.9542E-09	3.0569E+16	2.2381E+07
I-130	5.4759E-04	2.8077E-13	1.3006E+12	2.0261E+07
Cs-138	2.3989E-07	5.6693E-18	2.4740E+07	8.8761E+03
Cs-134m	3.9979E-05	4.9575E-15	2.2280E+10	1.4792E+06
Ba-137m	6.7054E-04	1.2468E-15	5.4806E+09	2.4810E+07
Br-82	1.0343E-04	9.5538E-14	7.0163E+11	3.8270E+06
Br-83	2.0492E-04	1.2972E-14	9.4116E+10	7.5821E+06
Br-84	1.0421E-07	1.4804E-18	1.0613E+07	3.8557E+03

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	7.1844E+14
Organic I (atoms)	2.2220E+13
Aerosols (kg)	7.8242E-09

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Total Filter Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	1.1734E-05	1.4422E-13	1.0099E+12	4.3417E+05
Sr-89	8.7011E-07	2.9950E-14	2.0265E+11	3.2194E+04
I-131	1.8373E-02	1.4820E-10	6.8129E+14	6.7981E+08
I-132	2.4216E-03	2.3461E-13	1.0703E+12	8.9601E+07
I-133	2.8298E-02	2.4981E-11	1.1311E+14	1.0470E+09
I-134	7.2482E-05	2.7170E-15	1.2211E+10	2.6818E+06
I-135	1.4984E-02	4.2666E-12	1.9032E+13	5.5439E+08
Cs-134	1.2350E-03	9.5455E-10	4.2899E+15	4.5696E+07
Cs-136	3.4995E-04	4.7748E-12	2.1143E+13	1.2948E+07
Cs-137	6.6710E-04	7.6694E-09	3.3712E+16	2.4683E+07
I-130	6.0391E-04	3.0964E-13	1.4344E+12	2.2345E+07
Cs-138	2.6456E-07	6.2523E-18	2.7284E+07	9.7889E+03

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-134m	4.4090E-05	5.4673E-15	2.4571E+10	1.6313E+06
Ba-137m	7.3949E-04	1.3750E-15	6.0442E+09	2.7361E+07
Br-82	1.1407E-04	1.0536E-13	7.7379E+11	4.2206E+06
Br-83	2.2599E-04	1.4305E-14	1.0379E+11	8.3618E+06
Br-84	1.1493E-07	1.6327E-18	1.1705E+07	4.2522E+03

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		1.2986E+00	1.5959E-08	1.1175E+17	4.8047E+10
Sr-89		9.6289E-02	3.3143E-09	2.2426E+16	3.5627E+09
I-131		2.0332E+03	1.6400E-05	7.5394E+19	7.5230E+13
I-132		2.6798E+02	2.5962E-08	1.1844E+17	9.9154E+12
I-133		3.1316E+03	2.7644E-06	1.2517E+19	1.1587E+14
I-134		8.0210E+00	3.0067E-10	1.3513E+15	2.9678E+11
I-135		1.6581E+03	4.7215E-07	2.1062E+18	6.1350E+13
Xe-133		1.5027E+02	8.0280E-07	3.6350E+18	5.5600E+12
Xe-135		1.1348E+03	4.4436E-07	1.9822E+18	4.1987E+13
Cs-134		1.3667E+02	1.0563E-04	4.7473E+20	5.0568E+12
Cs-136		3.8726E+01	5.2839E-07	2.3397E+18	1.4329E+12
Cs-137		7.3822E+01	8.4871E-04	3.7307E+21	2.7314E+12
I-130		6.6830E+01	3.4266E-08	1.5873E+17	2.4727E+12
Kr-83m		5.4464E+01	2.6398E-09	1.9153E+16	2.0152E+12
Xe-131m		4.4025E-01	5.2560E-09	2.4162E+16	1.6289E+10
Xe-133m		1.0406E+01	2.3192E-08	1.0501E+17	3.8503E+11
Xe-135m		2.7288E+02	2.9956E-09	1.3363E+16	1.0097E+13
Cs-138		2.9277E-02	6.9190E-13	3.0194E+12	1.0833E+09
Cs-134m		4.8791E+00	6.0502E-10	2.7191E+15	1.8053E+11
Rb-88		2.7484E-06	2.2896E-17	1.5669E+08	1.0169E+05
Rb-89		1.4425E-07	1.0379E-18	7.0226E+06	5.3374E+03
Ba-137m		8.1834E+01	1.5216E-10	6.6887E+14	3.0279E+12
Br-82		1.2623E+01	1.1660E-08	8.5629E+16	4.6706E+11
Br-83		2.5009E+01	1.5831E-09	1.1486E+16	9.2534E+11
Br-84		1.2718E-02	1.8067E-13	1.2953E+12	4.7056E+08

SGs Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		5.7790E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)		8.7681E+19	0.0000E+00	0.0000E+00
Organic I (atoms)		2.7118E+18	0.0000E+00	0.0000E+00
Aerosols (kg)		9.5489E-04	0.0000E+00	0.0000E+00

Time (h) =	8.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) =	8.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) =	8.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Detailed model information at time (H) = 24.0000

EAB Doses:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.2232E-06	9.1590E-06	2.0547E-06	1.5359E-06
Accumulated dose (rem)	1.8320E-02	1.0605E+01	2.8793E-02	3.8052E-01

LPZ Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.6296E-08	3.4665E-07	7.7765E-08	5.8131E-08
Accumulated dose (rem)	1.1946E-03	6.4587E-01	1.8685E-03	2.3258E-02

Control Room Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	9.9796E-05	4.9215E-02	5.6749E-03	1.7801E-03
Accumulated dose (rem)	2.8558E-04	1.6037E+00	1.6004E-02	5.5173E-02

PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	2.3206E+02	2.8520E-06	1.9971E+19	8.5861E+12
Sr-89	1.7478E+01	6.0160E-07	4.0707E+18	6.4668E+11
I-131	3.5165E+05	2.8365E-03	1.3040E+22	1.3011E+16
I-132	3.9525E+02	3.8292E-08	1.7470E+17	1.4624E+13
I-133	3.3658E+05	2.9712E-04	1.3453E+21	1.2453E+16
I-134	4.7101E-03	1.7656E-13	7.9350E+11	1.7427E+08
I-135	5.6733E+04	1.6155E-05	7.2064E+19	2.0991E+15
Xe-133	6.1738E+04	3.2983E-04	1.4934E+21	2.2843E+15
Xe-135	1.4977E+05	5.8649E-05	2.6162E+20	5.5416E+15
Cs-134	2.5021E+04	1.9339E-02	8.6910E+22	9.2577E+14
Cs-136	6.8482E+03	9.3438E-05	4.1375E+20	2.5338E+14
Cs-137	1.3523E+04	1.5546E-01	6.8338E+23	5.0033E+14
I-130	4.9909E+03	2.5590E-06	1.1854E+19	1.8466E+14
Kr-83m	1.6697E+02	8.0926E-09	5.8717E+16	6.1778E+12
Xe-131m	2.3058E+02	2.7528E-06	1.2655E+19	8.5313E+12
Xe-133m	3.9757E+03	8.8604E-06	4.0119E+19	1.4710E+14
Xe-135m	9.3368E+03	1.0250E-07	4.5723E+17	3.4546E+14
Cs-138	5.6835E-09	1.3431E-19	5.8613E+05	2.1029E+02
Cs-134m	1.9515E+01	2.4200E-09	1.0876E+16	7.2207E+11
Ba-137m	1.4990E+04	2.7873E-08	1.2252E+17	5.5463E+14
Br-82	1.6889E+03	1.5600E-06	1.1457E+19	6.2491E+13
Br-83	4.4231E+01	2.7998E-09	2.0314E+16	1.6365E+12
Br-84	1.9037E-09	2.7045E-20	1.9389E+05	7.0438E+01

PCS Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.8084E+21	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.4046E+22	0.0000E+00	0.0000E+00
Organic I (atoms)	4.3441E+20	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7490E-01	0.0000E+00	0.0000E+00

Time (h) = 24.0000	Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	6.4813E+00	3.4626E-08	1.5678E+17	2.3981E+11
Xe-135	1.5723E+01	6.1570E-09	2.7465E+16	5.8176E+11

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Kr-83m	1.7528E-02	8.4955E-13	6.1640E+12	6.4854E+08
Xe-131m	2.4206E-02	2.8899E-10	1.3285E+15	8.9562E+08
Xe-133m	4.1737E-01	9.3016E-10	4.2117E+15	1.5443E+10
Xe-135m	9.7993E-01	1.0758E-11	4.7988E+13	3.6257E+10

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 24.0000	Release	Rate/s	Release
Noble gases (atoms)	5.3073E+10	7.3712E+08	1.8984E+17
Elemental I (atoms)	4.3660E-22	6.0639E-24	1.4739E+18
Organic I (atoms)	1.3503E-23	1.8754E-25	4.5584E+16
Aerosols (kg)	4.2039E-45	5.8387E-47	1.8352E-05

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.0380E-05	1.2757E-13	8.9330E+11	3.8406E+05
Sr-89	7.8179E-07	2.6910E-14	1.8208E+11	2.8926E+04
I-131	1.5730E-02	1.2688E-10	5.8326E+14	5.8199E+08
I-132	1.7680E-05	1.7128E-15	7.8142E+09	6.5415E+05
I-133	1.5055E-02	1.3290E-11	6.0177E+13	5.5704E+08
I-135	2.5377E-03	7.2260E-13	3.2234E+12	9.3894E+07
Cs-134	1.1192E-03	8.6501E-10	3.8875E+15	4.1410E+07
Cs-136	3.0632E-04	4.1795E-12	1.8507E+13	1.1334E+07
Cs-137	6.0486E-04	6.9539E-09	3.0567E+16	2.2380E+07
I-130	2.2324E-04	1.1446E-13	5.3024E+11	8.2600E+06
Cs-134m	8.7292E-07	1.0824E-16	4.8646E+08	3.2298E+04
Ba-137m	6.7051E-04	1.2468E-15	5.4804E+09	2.4809E+07
Br-82	7.5546E-05	6.9780E-14	5.1247E+11	2.7952E+06
Br-83	1.9784E-06	1.2524E-16	9.0866E+08	7.3202E+04

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	6.2828E+14
Organic I (atoms)	1.9431E+13
Aerosols (kg)	7.8233E-09

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Xe-133	3.8832E-05	2.0746E-13	9.3935E+11	1.4368E+06
Xe-135	8.6704E-05	3.3952E-14	1.5145E+11	3.2081E+06
Kr-83m	3.4565E-07	1.6753E-17	1.2155E+08	1.2789E+04
Xe-131m	2.0209E-07	2.4127E-15	1.1091E+10	7.4773E+03
Xe-133m	2.7708E-06	6.1752E-15	2.7961E+10	1.0252E+05
Xe-135m	2.4787E-04	2.7211E-15	1.2138E+10	9.1712E+06

## Control Room Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.1421E+12	0.0000E+00	0.0000E+00
Elemental I (atoms)	8.7549E-21	0.0000E+00	0.0000E+00
Organic I (atoms)	2.7077E-22	0.0000E+00	0.0000E+00
Aerosols (kg)	1.0930E-43	0.0000E+00	0.0000E+00

## Recirculating Filter Inventory

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.1092E-06	1.3632E-14	9.5457E+10	4.1040E+04
Sr-89	8.3542E-08	2.8756E-15	1.9457E+10	3.0910E+03
I-131	1.6809E-03	1.3558E-11	6.2327E+13	6.2191E+07
I-132	1.8893E-06	1.8303E-16	8.3502E+08	6.9902E+04
I-133	1.6088E-03	1.4202E-12	6.4305E+12	5.9525E+07
I-135	2.7118E-04	7.7217E-14	3.4445E+11	1.0033E+07
Cs-134	1.1960E-04	9.2435E-11	4.1542E+14	4.4250E+06
Cs-136	3.2733E-05	4.4662E-13	1.9776E+12	1.2111E+06
Cs-137	6.4636E-05	7.4309E-10	3.2664E+15	2.3915E+06
I-130	2.3856E-05	1.2232E-14	5.6661E+10	8.8266E+05
Cs-134m	9.3280E-08	1.1567E-17	5.1983E+07	3.4514E+03
Ba-137m	7.1650E-05	1.3323E-16	5.8563E+08	2.6511E+06
Br-82	8.0728E-06	7.4566E-15	5.4762E+10	2.9870E+05
Br-83	2.1142E-07	1.3383E-17	9.7099E+07	7.8224E+03

Time (h) = 24.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	6.7138E+13
Organic I (atoms)	0.0000E+00	2.0764E+12
Aerosols (kg)	0.0000E+00	8.3599E-10

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.0380E-05	1.2757E-13	8.9330E+11	3.8406E+05
Sr-89	7.8179E-07	2.6910E-14	1.8208E+11	2.8926E+04
I-131	1.5730E-02	1.2688E-10	5.8326E+14	5.8199E+08
I-132	1.7680E-05	1.7128E-15	7.8142E+09	6.5415E+05
I-133	1.5055E-02	1.3290E-11	6.0177E+13	5.5704E+08
I-135	2.5377E-03	7.2260E-13	3.2234E+12	9.3894E+07
Cs-134	1.1192E-03	8.6501E-10	3.8875E+15	4.1410E+07
Cs-136	3.0632E-04	4.1795E-12	1.8507E+13	1.1334E+07
Cs-137	6.0486E-04	6.9539E-09	3.0567E+16	2.2380E+07
I-130	2.2324E-04	1.1446E-13	5.3024E+11	8.2600E+06
Cs-134m	8.7292E-07	1.0824E-16	4.8646E+08	3.2298E+04
Ba-137m	6.7051E-04	1.2468E-15	5.4804E+09	2.4809E+07
Br-82	7.5546E-05	6.9780E-14	5.1247E+11	2.7952E+06

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Br-83 1.9784E-06 1.2524E-16 9.0866E+08 7.3202E+04

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	6.2828E+14
Organic I (atoms)	1.9431E+13
Aerosols (kg)	7.8233E-09

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.1489E-05	1.4120E-13	9.8875E+11	4.2510E+05
Sr-89	8.6533E-07	2.9785E-14	2.0154E+11	3.2017E+04
I-131	1.7410E-02	1.4043E-10	6.4559E+14	6.4418E+08
I-132	1.9569E-05	1.8958E-15	8.6492E+09	7.2405E+05
I-133	1.6664E-02	1.4710E-11	6.6607E+13	6.1657E+08
I-135	2.8089E-03	7.9982E-13	3.5679E+12	1.0393E+08
Cs-134	1.2388E-03	9.5745E-10	4.3029E+15	4.5835E+07
Cs-136	3.3905E-04	4.6261E-12	2.0485E+13	1.2545E+07
Cs-137	6.6950E-04	7.6970E-09	3.3834E+16	2.4771E+07
I-130	2.4710E-04	1.2669E-13	5.8690E+11	9.1426E+06
Cs-134m	9.6620E-07	1.1981E-16	5.3845E+08	3.5749E+04
Ba-137m	7.4216E-04	1.3800E-15	6.0660E+09	2.7460E+07
Br-82	8.3619E-05	7.7236E-14	5.6723E+11	3.0939E+06
Br-83	2.1899E-06	1.3862E-16	1.0058E+09	8.1025E+04

SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	1.2668E+00	1.5569E-08	1.0902E+17	4.6871E+10
Sr-89	9.5411E-02	3.2841E-09	2.2222E+16	3.5302E+09
I-131	1.9197E+03	1.5484E-05	7.1182E+19	7.1028E+13
I-132	2.1577E+00	2.0903E-10	9.5366E+14	7.9834E+10
I-133	1.8374E+03	1.6220E-06	7.3441E+18	6.7983E+13
I-134	2.5712E-05	9.6385E-16	4.3317E+09	9.5136E+05
I-135	3.0971E+02	8.8188E-08	3.9339E+17	1.1459E+13
Xe-133	3.3703E+02	1.8005E-06	8.1527E+18	1.2470E+13
Xe-135	8.1761E+02	3.2016E-07	1.4282E+18	3.0252E+13
Cs-134	1.3659E+02	1.0557E-04	4.7444E+20	5.0537E+12
Cs-136	3.7384E+01	5.1008E-07	2.2586E+18	1.3832E+12
Cs-137	7.3819E+01	8.4867E-04	3.7305E+21	2.7313E+12
I-130	2.7245E+01	1.3969E-08	6.4712E+16	1.0081E+12
Kr-83m	9.1147E-01	4.4177E-11	3.2053E+14	3.3724E+10
Xe-131m	1.2587E+00	1.5027E-08	6.9081E+16	4.6572E+10
Xe-133m	2.1703E+01	4.8368E-08	2.1901E+17	8.0302E+11
Xe-135m	5.0969E+01	5.5953E-10	2.4960E+15	1.8859E+12
Cs-134m	1.0653E-01	1.3210E-11	5.9369E+13	3.9417E+09
Ba-137m	8.1830E+01	1.5216E-10	6.6884E+14	3.0277E+12
Br-82	9.2199E+00	8.5161E-09	6.2543E+16	3.4114E+11
Br-83	2.4145E-01	1.5284E-11	1.1089E+14	8.9338E+09

SGs Transport Group Inventory:

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Atmosphere	Sump	Overlying Pool
Time (h) = 24.0000			
Noble gases (atoms)	9.8718E+18	0.0000E+00	0.0000E+00
Elemental I (atoms)	7.6677E+19	0.0000E+00	0.0000E+00
Organic I (atoms)	2.3714E+18	0.0000E+00	0.0000E+00
Aerosols (kg)	9.5477E-04	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 24.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

## SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## SRV/ADV Steam Release Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 96.0000

## EAB Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.7717E-07	1.7275E-38	4.7313E-07	2.7717E-07
Accumulated dose (rem)	1.8320E-02	1.0605E+01	2.8793E-02	3.8052E-01

## LPZ Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.4584E-09	2.7788E-40	7.6105E-09	4.4584E-09
Accumulated dose (rem)	1.1946E-03	6.4587E-01	1.8685E-03	2.3258E-02

## Control Room Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.3568E-05	4.3588E-35	7.8405E-04	1.3568E-05
Accumulated dose (rem)	2.9914E-04	1.6037E+00	1.6788E-02	5.5187E-02

## PCS Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	2.0759E+02	2.5512E-06	1.7865E+19	7.6807E+12
Sr-89	1.6773E+01	5.7733E-07	3.9065E+18	6.2060E+11
I-131	2.7151E+05	2.1901E-03	1.0068E+22	1.0046E+16
I-132	1.4905E-07	1.4440E-17	6.5877E+07	5.5148E+03
I-133	3.0553E+04	2.6971E-05	1.2212E+20	1.1305E+15
I-135	2.9843E+01	8.4978E-09	3.7907E+16	1.1042E+12
Xe-133	8.0566E+04	4.3042E-04	1.9489E+21	2.9810E+15
Xe-135	1.1664E+03	4.5675E-07	2.0375E+18	4.3157E+13
Cs-134	2.4952E+04	1.9285E-02	8.6670E+22	9.2322E+14
Cs-136	5.8430E+03	7.9723E-05	3.5302E+20	2.1619E+14
Cs-137	1.3520E+04	1.5543E-01	6.8325E+23	5.0024E+14
I-130	8.8025E+01	4.5133E-08	2.0907E+17	3.2569E+12
Kr-83m	1.6174E-07	7.8390E-18	5.6877E+07	5.9842E+03
Xe-131m	7.4298E+02	8.8703E-06	4.0777E+19	2.7490E+13
Xe-133m	3.4311E+03	7.6466E-06	3.4623E+19	1.2695E+14
Xe-135m	4.9113E+00	5.3916E-11	2.4051E+14	1.8172E+11
Cs-134m	6.5543E-07	8.1275E-17	3.6526E+08	2.4251E+04



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Ba-137m	1.4987E+04	2.7868E-08	1.2250E+17	5.5453E+14
Br-82	4.1079E+02	3.7943E-07	2.7866E+18	1.5199E+13
Br-83	3.7760E-08	2.3902E-18	1.7343E+07	1.3971E+03

PCS Transport Group Inventory:

Time (h) = 96.0000	Atmosphere		Overlying	
	Sump	Pool	Sump	Pool
Noble gases (atoms)	2.0263E+21	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	9.8872E+21	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	3.0579E+20	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7480E-01	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Deposition Recirculating	
	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	8.4579E+00	4.5186E-08	2.0460E+17	3.1294E+11
Xe-135	1.2245E-01	4.7950E-11	2.1390E+14	4.5307E+09
Xe-131m	7.7999E-02	9.3121E-10	4.2808E+15	2.8860E+09
Xe-133m	3.6020E-01	8.0275E-10	3.6348E+15	1.3327E+10
Xe-135m	5.1547E-04	5.6587E-15	2.5243E+10	1.9072E+07

Environment Transport Group Inventory:

Time (h) = 96.0000	Present	Release	Integral
	Release	Rate/s	Release
Noble gases (atoms)	4.4820E+09	6.2250E+07	2.1273E+17
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.0375E+18
Organic I (atoms)	0.0000E+00	0.0000E+00	3.2087E+16
Aerosols (kg)	0.0000E+00	0.0000E+00	1.8342E-05

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	9.2853E-06	1.1412E-13	7.9910E+11	3.4356E+05
Sr-89	7.5025E-07	2.5824E-14	1.7474E+11	2.7759E+04
I-131	1.2145E-02	9.7962E-11	4.5034E+14	4.4936E+08
I-133	1.3667E-03	1.2064E-12	5.4626E+12	5.0566E+07
I-135	1.3349E-06	3.8011E-16	1.6956E+09	4.9390E+04
Cs-134	1.1161E-03	8.6263E-10	3.8768E+15	4.1296E+07
Cs-136	2.6136E-04	3.5660E-12	1.5791E+13	9.6702E+06
Cs-137	6.0475E-04	6.9526E-09	3.0562E+16	2.2376E+07
I-130	3.9373E-06	2.0188E-15	9.3519E+09	1.4568E+05
Ba-137m	6.7038E-04	1.2465E-15	5.4793E+09	2.4804E+07
Br-82	1.8374E-05	1.6972E-14	1.2464E+11	6.7985E+05

Control Room Filtered Makeup Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.4226E+14
Organic I (atoms)	1.3678E+13
Aerosols (kg)	7.8189E-09

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Xe-133	3.5251E-06	1.8832E-14	8.5271E+10	1.3043E+05
Xe-135	4.5608E-08	1.7860E-17	7.9669E+07	1.6875E+03
Xe-131m	1.5603E-07	1.8628E-15	8.5635E+09	5.7732E+03
Xe-133m	2.5153E-07	5.6056E-16	2.5382E+09	9.3065E+03
Xe-135m	1.3039E-07	1.4314E-18	6.3851E+06	4.8243E+03

Control Room Transport Group Inventory:

			Overlying
Time (h) = 96.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	9.6459E+10	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	9.9223E-07	1.2194E-14	8.5391E+10	3.6712E+04
Sr-89	8.0171E-08	2.7596E-15	1.8672E+10	2.9663E+03
I-131	1.2978E-03	1.0468E-11	4.8123E+13	4.8018E+07
I-133	1.4604E-04	1.2892E-13	5.8373E+11	5.4035E+06
I-135	1.4264E-07	4.0618E-17	1.8119E+08	5.2778E+03
Cs-134	1.1927E-04	9.2180E-11	4.1427E+14	4.4128E+06
Cs-136	2.7929E-05	3.8106E-13	1.6874E+12	1.0334E+06
Cs-137	6.4623E-05	7.4295E-10	3.2658E+15	2.3911E+06
I-130	4.2074E-07	2.1573E-16	9.9934E+08	1.5568E+04
Ba-137m	7.1637E-05	1.3320E-16	5.8552E+08	2.6506E+06
Br-82	1.9635E-06	1.8136E-15	1.3319E+10	7.2649E+04

	Deposition	Recirculating
Time (h) = 96.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	4.7259E+13
Organic I (atoms)	0.0000E+00	1.4616E+12
Aerosols (kg)	0.0000E+00	8.3553E-10

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	9.2853E-06	1.1412E-13	7.9910E+11	3.4356E+05
Sr-89	7.5025E-07	2.5824E-14	1.7474E+11	2.7759E+04
I-131	1.2145E-02	9.7962E-11	4.5034E+14	4.4936E+08
I-133	1.3667E-03	1.2064E-12	5.4626E+12	5.0566E+07
I-135	1.3349E-06	3.8011E-16	1.6956E+09	4.9390E+04
Cs-134	1.1161E-03	8.6263E-10	3.8768E+15	4.1296E+07
Cs-136	2.6136E-04	3.5660E-12	1.5791E+13	9.6702E+06
Cs-137	6.0475E-04	6.9526E-09	3.0562E+16	2.2376E+07
I-130	3.9373E-06	2.0188E-15	9.3519E+09	1.4568E+05
Ba-137m	6.7038E-04	1.2465E-15	5.4793E+09	2.4804E+07
Br-82	1.8374E-05	1.6972E-14	1.2464E+11	6.7985E+05

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.4226E+14
Organic I (atoms)	1.3678E+13
Aerosols (kg)	7.8189E-09

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Total Filter Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.0278E-05	1.2631E-13	8.8449E+11	3.8027E+05
Sr-89	8.3042E-07	2.8584E-14	1.9341E+11	3.0726E+04
I-131	1.3443E-02	1.0843E-10	4.9846E+14	4.9738E+08
I-133	1.5127E-03	1.3354E-12	6.0464E+12	5.5970E+07
I-135	1.4775E-06	4.2072E-16	1.8768E+09	5.4668E+04
Cs-134	1.2354E-03	9.5481E-10	4.2910E+15	4.5708E+07
Cs-136	2.8929E-04	3.9471E-12	1.7478E+13	1.0704E+07
Cs-137	6.6937E-04	7.6955E-09	3.3827E+16	2.4767E+07
I-130	4.3581E-06	2.2345E-15	1.0351E+10	1.6125E+05
Ba-137m	7.4202E-04	1.3797E-15	6.0649E+09	2.7455E+07
Br-82	2.0338E-05	1.8786E-14	1.3796E+11	7.5250E+05

## SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	1.1332E+00	1.3927E-08	9.7524E+16	4.1929E+10
Sr-89	9.1563E-02	3.1517E-09	2.1325E+16	3.3878E+09
I-131	1.4822E+03	1.1956E-05	5.4960E+19	5.4841E+13

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-132	8.1365E-10	7.8826E-20	3.5962E+05	3.0105E+01
I-133	1.6679E+02	1.4724E-07	6.6667E+17	6.1713E+12
I-135	1.6291E-01	4.6389E-11	2.0693E+14	6.0277E+09
Xe-133	4.3981E+02	2.3496E-06	1.0639E+19	1.6273E+13
Xe-135	6.3674E+00	2.4934E-09	1.1123E+16	2.3559E+11
Cs-134	1.3621E+02	1.0528E-04	4.7313E+20	5.0398E+12
Cs-136	3.1897E+01	4.3521E-07	1.9271E+18	1.1802E+12
Cs-137	7.3805E+01	8.4851E-04	3.7298E+21	2.7308E+12
I-130	4.8052E-01	2.4638E-10	1.1413E+15	1.7779E+10
Kr-83m	8.8291E-10	4.2793E-20	3.1049E+05	3.2668E+01
Xe-131m	4.0559E+00	4.8423E-08	2.2260E+17	1.5007E+11
Xe-133m	1.8730E+01	4.1743E-08	1.8901E+17	6.9302E+11
Xe-135m	2.6811E-02	2.9433E-13	1.3129E+12	9.9200E+08
Cs-134m	3.5780E-09	4.4368E-19	1.9940E+06	1.3239E+02
Ba-137m	8.1815E+01	1.5213E-10	6.6871E+14	3.0272E+12
Br-82	2.2425E+00	2.0713E-09	1.5212E+16	8.2971E+10

SGs Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.1062E+19	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.3974E+19	0.0000E+00	0.0000E+00
Organic I (atoms)	1.6693E+18	0.0000E+00	0.0000E+00
Aerosols (kg)	9.5424E-04	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 720.0000

EAB Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.0239E-09	4.2422-186	3.8997E-09	1.0239E-09
Accumulated dose (rem)	1.8320E-02	1.0605E+01	2.8793E-02	3.8052E-01

LPZ Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.8249E-12	1.9991-188	1.8377E-11	4.8249E-12
Accumulated dose (rem)	1.1946E-03	6.4587E-01	1.8685E-03	2.3258E-02

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.3413E-08	7.1358-183	4.3083E-06	3.3413E-08
Accumulated dose (rem)	2.9918E-04	1.6037E+00	1.6792E-02	5.5187E-02

PCS Compartment Atmosphere Nuclide Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	7.9024E+01	9.7119E-07	6.8008E+18	2.9239E+12
Sr-89	1.1739E+01	4.0406E-07	2.7340E+18	4.3433E+11
I-131	2.8861E+04	2.3280E-04	1.0702E+21	1.0679E+15
I-133	2.8455E-05	2.5119E-14	1.1374E+11	1.0528E+06
Xe-133	2.8707E+03	1.5337E-05	6.9443E+19	1.0622E+14
Cs-134	2.4362E+04	1.8829E-02	8.4621E+22	9.0139E+14
Cs-136	1.4763E+03	2.0143E-05	8.9193E+19	5.4623E+13
Cs-137	1.3498E+04	1.5518E-01	6.8212E+23	4.9942E+14
Xe-131m	8.7676E+02	1.0467E-05	4.8119E+19	3.2440E+13
Xe-133m	1.0623E+00	2.3675E-09	1.0720E+16	3.9306E+10
Ba-137m	1.4963E+04	2.7822E-08	1.2230E+17	5.5362E+14
Br-82	1.9602E-03	1.8105E-12	1.3297E+13	7.2526E+07

PCS Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.1757E+20	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.0381E+21	0.0000E+00	0.0000E+00
Organic I (atoms)	3.2105E+19	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7403E-01	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-131m	9.2043E-02	1.0989E-09	5.0516E+15	3.4056E+09

Environment Transport Group Inventory:

Time (h) = 720.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	4.2276E+07	5.8717E+05	1.2343E+16
Elemental I (atoms)	0.0000E+00	0.0000E+00	1.0893E+17
Organic I (atoms)	0.0000E+00	0.0000E+00	3.3689E+15
Aerosols (kg)	0.0000E+00	0.0000E+00	1.8261E-05

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	3.5347E-06	4.3442E-14	3.0420E+11	1.3078E+05
Sr-89	5.2507E-07	1.8073E-14	1.2229E+11	1.9428E+04
I-131	1.2910E-03	1.0413E-11	4.7869E+13	4.7765E+07
Cs-134	1.0897E-03	8.4223E-10	3.7851E+15	4.0319E+07
Cs-136	6.6034E-05	9.0099E-13	3.9896E+12	2.4433E+06
Cs-137	6.0376E-04	6.9412E-09	3.0511E+16	2.2339E+07
Ba-137m	6.6928E-04	1.2445E-15	5.4703E+09	2.4763E+07
Br-82	8.7678E-11	8.0986E-20	5.9476E+05	3.2441E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.6433E+13
Organic I (atoms)	1.4361E+12
Aerosols (kg)	7.7844E-09

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Xe-131m	1.6586E-08	1.9801E-16	9.1028E+08	6.1367E+02

Control Room Transport Group Inventory:

			Overlying
Time (h) = 720.0000	Atmosphere	Sump	Pool
Noble gases (atoms)	9.1028E+08	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	3.7772E-07	4.6421E-15	3.2507E+10	1.3976E+04
Sr-89	5.6109E-08	1.9313E-15	1.3068E+10	2.0760E+03
I-131	1.3795E-04	1.1127E-12	5.1153E+12	5.1042E+06
Cs-134	1.1645E-04	9.0001E-11	4.0448E+14	4.3085E+06
Cs-136	7.0564E-06	9.6280E-14	4.2633E+11	2.6109E+05
Cs-137	6.4517E-05	7.4173E-10	3.2604E+15	2.3871E+06
Ba-137m	7.1519E-05	1.3298E-16	5.8456E+08	2.6462E+06

Deposition Recirculating

Time (h) = 720.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	4.9618E+12
Organic I (atoms)	0.0000E+00	1.5346E+11
Aerosols (kg)	0.0000E+00	8.3183E-10

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	3.5347E-06	4.3442E-14	3.0420E+11	1.3078E+05
Sr-89	5.2507E-07	1.8073E-14	1.2229E+11	1.9428E+04
I-131	1.2910E-03	1.0413E-11	4.7869E+13	4.7765E+07
Cs-134	1.0897E-03	8.4223E-10	3.7851E+15	4.0319E+07
Cs-136	6.6034E-05	9.0099E-13	3.9896E+12	2.4433E+06
Cs-137	6.0376E-04	6.9412E-09	3.0511E+16	2.2339E+07
Ba-137m	6.6928E-04	1.2445E-15	5.4703E+09	2.4763E+07
Br-82	8.7678E-11	8.0986E-20	5.9476E+05	3.2441E+00

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.6433E+13
Organic I (atoms)	1.4361E+12
Aerosols (kg)	7.7844E-09

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Total Filter Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	3.9124E-06	4.8084E-14	3.3671E+11	1.4476E+05
Sr-89	5.8118E-07	2.0005E-14	1.3536E+11	2.1504E+04
I-131	1.4289E-03	1.1526E-11	5.2985E+13	5.2869E+07
Cs-134	1.2062E-03	9.3223E-10	4.1896E+15	4.4628E+07
Cs-136	7.3091E-05	9.9727E-13	4.4160E+12	2.7044E+06
Cs-137	6.6827E-04	7.6829E-09	3.3772E+16	2.4726E+07
Ba-137m	7.4080E-04	1.3775E-15	6.0549E+09	2.7409E+07
Br-82	9.7047E-11	8.9640E-20	6.5832E+05	3.5907E+00

## SGs Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	4.3139E-01	5.3017E-09	3.7125E+16	1.5961E+10
Sr-89	6.4081E-02	2.2057E-09	1.4925E+16	2.3710E+09
I-131	1.5755E+02	1.2708E-06	5.8421E+18	5.8294E+12
I-133	1.5534E-07	1.3712E-16	6.2089E+08	5.7474E+03
Xe-133	1.5671E+01	8.3722E-08	3.7909E+17	5.7984E+11
Cs-134	1.3299E+02	1.0279E-04	4.6194E+20	4.9207E+12
Cs-136	8.0590E+00	1.0996E-07	4.8690E+17	2.9818E+11
Cs-137	7.3684E+01	8.4712E-04	3.7237E+21	2.7263E+12
Xe-131m	4.7862E+00	5.7141E-08	2.6268E+17	1.7709E+11
Xe-133m	5.7992E-03	1.2924E-11	5.8520E+13	2.1457E+08
Ba-137m	8.1680E+01	1.5188E-10	6.6762E+14	3.0222E+12
Br-82	1.0700E-05	9.8837E-15	7.2587E+10	3.9592E+05

## SGs Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Atmosphere	Sump	Overlying Pool
Time (h) = 720.0000			
Noble gases (atoms)	6.4183E+17	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.6668E+18	0.0000E+00	0.0000E+00
Organic I (atoms)	1.7526E+17	0.0000E+00	0.0000E+00
Aerosols (kg)	9.5002E-04	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 720.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

SG Tube Leakage Transport Group Inventory:

	Pathway Filter
Time (h) = 720.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

SRV/ADV Steam Release Transport Group Inventory:

	Pathway Filter
Time (h) = 720.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

-----  
Transport Group Totals in Model:  
-----

Noble Gases (atoms)	1.1823E+20
Elemental I (atoms)	1.0439E+21
Organic I (atoms)	3.2284E+19
Aerosols (kg)	1.7500E-01

-----

37004

#####  
I-131 Summary  
#####

Time (hr)	PCS I-131 (Curies)	Environment I-131 (Curies)	Control Room I-131 (Curies)
0.000	3.8163E+03	5.4627E-15	2.0980E-17
0.000	3.8163E+05	5.4627E-09	2.0980E-11
0.025	3.8541E+05	1.0301E-03	3.9352E-06
0.300	3.8495E+05	1.4825E-01	8.7840E-04
0.306	3.8494E+05	1.5379E-01	9.0953E-04
0.333	3.8490E+05	1.6722E-01	9.5033E-04
0.500	3.8462E+05	2.7297E-01	4.3898E-04
0.760	3.8420E+05	4.8008E-01	1.3901E-04
1.020	3.8377E+05	7.7200E-01	5.5117E-05
1.280	3.8334E+05	1.1484E+00	3.4568E-05
1.540	3.8291E+05	1.6091E+00	3.2577E-05
1.800	3.8249E+05	2.1535E+00	3.6015E-05
2.000	3.8216E+05	2.6292E+00	3.9812E-05
2.260	3.8173E+05	3.3212E+00	3.9036E-05
2.520	3.8131E+05	4.0960E+00	4.2059E-05
2.780	3.8088E+05	4.9533E+00	4.6185E-05
3.040	3.8046E+05	5.8928E+00	5.0623E-05
3.300	3.8004E+05	6.9141E+00	5.5143E-05
3.560	3.7961E+05	8.0169E+00	5.9676E-05
3.820	3.7919E+05	9.2007E+00	6.4202E-05
4.080	3.7877E+05	1.0465E+01	6.8715E-05
4.340	3.7835E+05	1.1810E+01	7.3214E-05
4.600	3.7792E+05	1.3235E+01	7.7698E-05



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

4.860	3.7750E+05	1.4740E+01	8.2168E-05
5.120	3.7708E+05	1.6324E+01	8.6623E-05
5.380	3.7666E+05	1.7988E+01	9.1063E-05
5.640	3.7624E+05	1.9730E+01	9.5488E-05
5.900	3.7583E+05	2.1550E+01	9.9898E-05
6.160	3.7541E+05	2.3448E+01	1.0429E-04
6.420	3.7499E+05	2.5424E+01	1.0867E-04
6.680	3.7457E+05	2.7477E+01	1.1304E-04
6.940	3.7415E+05	2.9608E+01	1.1739E-04
7.200	3.7374E+05	3.1815E+01	1.2173E-04
7.460	3.7332E+05	3.4098E+01	1.2605E-04
7.720	3.7291E+05	3.6457E+01	1.3036E-04
7.980	3.7249E+05	3.8892E+01	1.3465E-04
8.000	3.7246E+05	3.9082E+01	1.3498E-04
8.260	3.7211E+05	3.9046E+01	3.9578E-05
8.520	3.7176E+05	3.9010E+01	1.1604E-05
8.780	3.7142E+05	3.8973E+01	3.4025E-06
9.040	3.7107E+05	3.8937E+01	9.9763E-07
9.300	3.7072E+05	3.8900E+01	2.9251E-07
9.560	3.7038E+05	3.8864E+01	8.5765E-08
9.820	3.7003E+05	3.8828E+01	2.5147E-08
10.080	3.6969E+05	3.8792E+01	7.3731E-09
24.000	3.5165E+05	3.6900E+01	2.1919E-37
96.000	2.7151E+05	2.8490E+01	6.1404-185
720.000	2.8861E+04	3.0284E+00	0.0000E+00

## SGs

Time (hr)	I-131 (Curies)
0.000	1.3234E-06
0.000	1.3234E-02
0.025	6.6682E+00
0.300	7.9944E+01
0.306	8.1420E+01
0.333	8.8805E+01
0.500	1.3312E+02
0.760	2.0207E+02
1.020	2.7080E+02
1.280	3.3931E+02
1.540	4.0758E+02
1.800	4.7564E+02
2.000	5.2783E+02
2.260	5.9549E+02
2.520	6.6292E+02
2.780	7.3013E+02
3.040	7.9712E+02
3.300	8.6389E+02
3.560	9.3043E+02
3.820	9.9676E+02
4.080	1.0629E+03
4.340	1.1287E+03
4.600	1.1944E+03
4.860	1.2599E+03
5.120	1.3251E+03
5.380	1.3901E+03
5.640	1.4549E+03
5.900	1.5195E+03
6.160	1.5838E+03
6.420	1.6480E+03
6.680	1.7119E+03
6.940	1.7757E+03
7.200	1.8392E+03
7.460	1.9025E+03
7.720	1.9655E+03
7.980	2.0284E+03
8.000	2.0332E+03
8.260	2.0313E+03
8.520	2.0294E+03
8.780	2.0275E+03
9.040	2.0257E+03
9.300	2.0238E+03
9.560	2.0219E+03
9.820	2.0200E+03
10.080	2.0181E+03

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

24.000 1.9197E+03
96.000 1.4822E+03
720.000 1.5755E+02

Cumulative Dose Summary

Table with 8 columns: Time (hr), Thyroid (rem), TEDE (rem), Thyroid (rem), TEDE (rem), Thyroid (rem), TEDE (rem). Rows show cumulative dose data for EAB, LPZ, and Control Room at various time intervals from 0.000 to 720.000 hours.

Worst Two-Hour Dose (Provided for Dose Location 1)

Table with 5 columns: Time (hr), Whole Body (rem), Thyroid (rem), Skin (rem), TEDE (rem). Row shows data for 6.0 hours: Whole Body 6.1122E-03, Thyroid 4.4996E+00, Skin 9.8480E-03, TEDE 1.5972E-01.

30 Day Control Room Skin Dose

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room

Time (hr)	Skin (rem)
720.0	1.6792E-02

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Attachment 8 Containment Release DNB Dose

```
#####
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 12:53:47
#####
#####
File information
#####
```

```
Plant file name      = AST/CRE/pal_CRE_DNB_cont_db_ast.psf
Inventory file name  = AST/CRE/palisades_loca_db_ast.nif
Scenario file name   = AST/CRE/pal_CRE_DNB_cont_db_ast.psf
Release file name    = AST/CRE/pal_cre_dnb_cont_ast.rft
Dose conversion file name = AST/CRE/nai-1101-001rev0.dcf
```

```
#####  #####  #####  # # # ##### # # #####
# # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # #
#####  #####  #####  # # # # # ##### # # # #
# # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # #
```

```
*RADTRAD-NAI 1.1a(QA)
*18 May 2006 12:53:41
** Palisades CRE Design Basis
** DNB Containment Release Dose
**
*Nuclide inventory file
AST/CRE/palisades_loca_db_ast.nif
*Plant power
810.576
*Compartments
3
*Compartment 1:
Containment
3
1640000
0
0
1
0
*Compartment 2:
Environment
2
2e+20
0
0
0
0
*Compartment 3:
Control Room
1
35923
0
1
0
0
*Pathways
5
*Pathway 1:
Containment Leakage
1
2
4
*Pathway 2:
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
Control Room Unfiltered Makeup
  2
  3
  2
*Pathway 3:
Control Room Filtered Makeup
  2
  3
  2
*Pathway 4:
Control Room Unfiltered Inleakage
  2
  3
  2
*Pathway 5:
Control Room Exhaust
  3
  2
  2
*Sources
  3
  1 1
  2 0
  3 0
*dose conversion factors filename
AST/CRE/nai-1101-001rev0.dcf
*release fraction and timing filename
AST/CRE/pal_cre_dnb_cont_ast.rft
0
  1
  1
*Iodine
0.95 0.0485 0.0015
*Overlying pool
*aerosol model
  0
*elemental model
  0
*organic model
  0
*pH tracking
  0
*Compartment detail
*Compartment 1:
  1
*spray model
0
0
0
*filter model
0
*deposition model
*deposition aerosol model
  1
  2
0 0.1
720 0.1
*deposition elemental model
  1
  2
0 1.3
720 1.3
*Compartment 2:
  1
*spray model
0
0
0
*filter model
0
*deposition model
0
0
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
  3
0 0 99 99 99
0.025 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Pathways:
*Pathway 1
*convection model
  1
  3
0 0.1
24 0.05
720 0.05
*Pathway 2
*filter efficiency model
  1
  3
0 384.2 0 0 0
0.025 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
  1
  3
0 0 99 99 99
0.025 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
  1
  3
0 0 0 0 0
0.025 10 0 0 0
720 10 0 0 0
*Pathway 5
*filter efficiency model
  1
  3
0 384.2 0 0 0
0.025 1423.6 0 0 0
720 1423.6 0 0 0
*x/q tables
  4
EAB
  2
0 0.000539
720 0.000539
LPZ
  6
0 6.66e-05
2 3.03e-05
8 2.04e-05
24 8.67e-06
96 2.54e-06
720 2.54e-06
Control Room Unfiltered
  6
0 0.0143
2 0.0111
8 0.00413
24 0.00323
96 0.00249
720 0.00249
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Emergency

```
6
0 0.000726
2 0.000618
8 0.000247
24 0.000177
96 0.00013
720 0.00013
*dose locations
3
*location name, compartment number and x/q table
EAB
2
1
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
LPZ
2
2
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
Control Room
3
0
*br model
1
2
0 0.00035
720 0.00035
*of model
1
4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
1
*number of intake combinations
3
*intake combinations
2 1 3
3 1 4
4 1 3
*time step count
3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
1
1
1
```

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

0  
1

#####  
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 12:53:47  
#####  
#####  
Plant Description  
#####

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth  
Plant Power Level = 8.1058E+02 MWth

Number of compartments = 3

Compartment information

Compartment number 1 (Source term fraction = 1.0000E+00)  
Name: Containment  
Compartment volume = 1.6400E+06 (Cubic feet)  
Removal devices within compartment:  
Deposition  
Pathways into and out of compartment 1  
Pathway to compartment number 2: Containment Leakage

Compartment number 2  
Name: Environment  
Pathways into and out of compartment 2  
Pathway to compartment number 3: Control Room Unfiltered Makeup  
Pathway to compartment number 3: Control Room Filtered Makeup  
Pathway to compartment number 3: Control Room Unfiltered Inleakage  
Pathway from compartment number 1: Containment Leakage  
Pathway from compartment number 3: Control Room Exhaust

Compartment number 3  
Name: Control Room  
Compartment volume = 3.5923E+04 (Cubic feet)  
Removal devices within compartment:  
Filter(s)  
Pathways into and out of compartment 3  
Pathway to compartment number 2: Control Room Exhaust  
Pathway from compartment number 2: Control Room Unfiltered Makeup  
Pathway from compartment number 2: Control Room Filtered Makeup  
Pathway from compartment number 2: Control Room Unfiltered Inleakage

Total number of pathways = 5

#####  
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 12:53:47  
#####  
#####  
Scenario Description  
#####

Radioactive Decay is enabled  
Calculation of Daughters is enabled

Iodine fractions  
Aerosol = 9.5000E-01  
Elemental = 4.8500E-02  
Organic = 1.5000E-03

COMPARTMENT DATA

Compartment number 1: Containment  
  
Natural Deposition: Aerosol data  
Time (hr) Removal Coef. (hr^-1)



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

0.0000E+00 1.0000E-01  
 7.2000E+02 1.0000E-01

Natural Deposition: Elemental Removal Data

Time (hr) Removal Coef. (hr<sup>-1</sup>)  
 0.0000E+00 1.3000E+00  
 7.2000E+02 1.3000E+00

Compartment number 2: Environment

Compartment number 3: Control Room

Compartment Filter Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
2.5000E-02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

PATHWAY DATA

Pathway number 1: Containment Leakage

Convection Data

Time (hr)	Flow Rate (% / day)
0.0000E+00	1.0000E-01
2.4000E+01	5.0000E-02
7.2000E+02	5.0000E-02

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
2.5000E-02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00

X/Q DATA

X/Q table 1: EAB

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	5.3900E-04
7.2000E+02	5.3900E-04

## X/Q table 2: LPZ

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

## X/Q table 3: Control Room Unfiltered

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	1.4300E-02
2.0000E+00	1.1100E-02
8.0000E+00	4.1300E-03
2.4000E+01	3.2300E-03
9.6000E+01	2.4900E-03
7.2000E+02	2.4900E-03

## X/Q table 4: Control Room Emergency

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	7.2600E-04
2.0000E+00	6.1800E-04
8.0000E+00	2.4700E-04
2.4000E+01	1.7700E-04
9.6000E+01	1.3000E-04
7.2000E+02	1.3000E-04

## LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

## Location Breathing Rate Data

Time (hr)	Breathing Rate (m <sup>3</sup> * sec <sup>-1</sup> )
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

## Location Breathing Rate Data

Time (hr)	Breathing Rate (m <sup>3</sup> * sec <sup>-1</sup> )
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location Control Room is in compartment 3

## Inleakage X/Q Table Assignments

Inleakage Path	Source Path	X/Q Table
2	1	3
3	1	4
4	1	3

## Location Breathing Rate Data

Time (hr)	Breathing Rate (m <sup>3</sup> * sec <sup>-1</sup> )
0.0000E+00	3.5000E-04
7.2000E+02	3.5000E-04

## Location Occupancy Factor Data

Time (hr)	Occupancy Factor
0.0000E+00	1.0000E+00
2.4000E+01	6.0000E-01
9.6000E+01	4.0000E-01

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

7.2000E+02

4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time	Time step
0.0000E+00	1.0000E-06
1.0000E-03	2.0000E-02
7.2000E+02	2.0000E-02

#####  
 RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 12:53:47  
 #####

```

##### # # ##### ##### # # #####
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
##### ##### # # ##### #

```

#####  
 Dose, Detailed Model and Detailed Inventory Output  
 #####

Detailed model information at time (H) = 0.0001

EAB Doses:

Time (h) =	0.0001	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.2405E-05	1.3402E-03	2.1234E-05	7.3416E-05
Accumulated dose (rem)		1.2405E-05	1.3402E-03	2.1234E-05	7.3416E-05

LPZ Doses:

Time (h) =	0.0001	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.5328E-06	1.6559E-04	2.6238E-06	9.0715E-06
Accumulated dose (rem)		1.5328E-06	1.6559E-04	2.6238E-06	9.0715E-06

Control Room Doses:

Time (h) =	0.0001	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.0850E-10	7.6254E-07	1.2082E-08	3.4923E-08
Accumulated dose (rem)		2.0850E-10	7.6254E-07	1.2082E-08	3.4923E-08

Containment Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0001	Ci	kg	Atoms	Bq
Kr-85		3.1547E+04	8.0409E-02	5.6969E+23	1.1673E+15
Kr-85m		5.8416E+05	7.0983E-05	5.0291E+20	2.1614E+16
Kr-87		1.1263E+06	3.9762E-05	2.7523E+20	4.1673E+16
Kr-88		1.5851E+06	1.2641E-04	8.6509E+20	5.8650E+16
Rb-86		7.0495E+03	8.6638E-05	6.0668E+20	2.6083E+14
Sr-89		7.1647E-02	2.4661E-09	1.6687E+16	2.6509E+09
I-131		2.2440E+06	1.8100E-02	8.3208E+22	8.3027E+16
I-132		3.2026E+06	3.1027E-04	1.4155E+21	1.1850E+17
I-133		4.3842E+06	3.8702E-03	1.7524E+22	1.6222E+17
I-134		4.8038E+06	1.8007E-04	8.0928E+20	1.7774E+17
I-135		4.1143E+06	1.1715E-03	5.2261E+21	1.5223E+17
Xe-133		4.3962E+06	2.3486E-02	1.0635E+23	1.6266E+17
Xe-135		1.4071E+06	5.5098E-04	2.4578E+21	5.2061E+16
Cs-134		7.3302E+05	5.6655E-01	2.5462E+24	2.7122E+16
Cs-136		2.1134E+05	2.8836E-03	1.2769E+22	7.8197E+15
Cs-137		3.9584E+05	4.5508E+00	2.0004E+25	1.4646E+16
I-130		1.1224E+05	5.7551E-05	2.6660E+20	4.1530E+15
Kr-83m		2.7346E+05	1.3254E-05	9.6167E+19	1.0118E+16
Xe-138		3.6305E+06	3.7756E-05	1.6476E+20	1.3433E+17
Xe-131m		2.5028E+04	2.9880E-04	1.3736E+21	9.2604E+14
Xe-133m		1.3971E+05	3.1137E-04	1.4099E+21	5.1694E+15

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-135m	8.9927E+05	9.8721E-06	4.4038E+19	3.3273E+16
Cs-138	4.8219E+06	1.1396E-04	4.9728E+20	1.7841E+17
Cs-134m	1.7704E+05	2.1954E-05	9.8664E+19	6.5506E+15
Rb-88	1.9320E+06	1.6095E-05	1.1014E+20	7.1485E+16
Rb-89	2.4805E+06	1.7846E-05	1.2076E+20	9.1779E+16
Ba-137m	3.0801E+02	5.7273E-10	2.5176E+15	1.1397E+13
Br-82	1.5840E+04	1.4630E-05	1.0745E+20	5.8606E+14
Br-83	2.7294E+05	1.7277E-05	1.2536E+20	1.0099E+16
Br-84	4.7704E+05	6.7771E-06	4.8586E+19	1.7651E+16

Containment Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0001			
Noble gases (atoms)	6.8322E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.2732E+21	0.0000E+00	0.0000E+00
Organic I (atoms)	1.6310E+20	0.0000E+00	0.0000E+00
Aerosols (kg)	5.1431E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0001		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.4273E+17	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	2.5713E-05	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 0.0001	Ci	kg	Atoms	Bq
Kr-85	6.5547E-05	1.6707E-10	1.1837E+15	2.4252E+06
Kr-85m	1.2137E-03	1.4748E-13	1.0449E+12	4.4908E+07
Kr-87	2.3401E-03	8.2615E-14	5.7186E+11	8.6584E+07
Kr-88	3.2935E-03	2.6265E-13	1.7974E+12	1.2186E+08
Rb-86	1.4647E-05	1.8001E-13	1.2605E+12	5.4194E+05
Sr-89	1.9798E-10	6.8146E-18	4.6111E+07	7.3252E+00
I-131	4.6624E-03	3.7608E-11	1.7288E+14	1.7251E+08
I-132	6.6542E-03	6.4465E-13	2.9410E+12	2.4621E+08
I-133	9.1092E-03	8.0412E-12	3.6410E+13	3.3704E+08
I-134	9.9809E-03	3.7414E-13	1.6814E+12	3.6929E+08
I-135	8.5484E-03	2.4341E-12	1.0858E+13	3.1629E+08
Xe-133	9.1342E-03	4.8798E-11	2.2096E+14	3.3796E+08
Xe-135	2.9235E-03	1.1448E-12	5.1067E+12	1.0817E+08
Cs-134	1.5230E-03	1.1771E-09	5.2902E+15	5.6352E+07
Cs-136	4.3911E-04	5.9914E-12	2.6530E+13	1.6247E+07
Cs-137	8.2245E-04	9.4554E-09	4.1563E+16	3.0431E+07
I-130	2.3321E-04	1.1958E-13	5.5392E+11	8.6288E+06
Kr-83m	5.6818E-04	2.7538E-14	1.9981E+11	2.1023E+07
Xe-138	7.5431E-03	7.8447E-14	3.4233E+11	2.7910E+08
Xe-131m	5.2001E-05	6.2083E-13	2.8540E+12	1.9240E+06
Xe-133m	2.9029E-04	6.4694E-13	2.9293E+12	1.0741E+07
Xe-135m	1.8684E-03	2.0511E-14	9.1498E+10	6.9132E+07
Cs-138	1.0019E-02	2.3677E-13	1.0332E+12	3.7069E+08
Cs-134m	3.6785E-04	4.5614E-14	2.0500E+11	1.3610E+07
Rb-88	4.0142E-03	3.3441E-14	2.2885E+11	1.4852E+08
Rb-89	5.1538E-03	3.7080E-14	2.5090E+11	1.9069E+08
Ba-137m	8.5106E-07	1.5825E-18	6.9561E+06	3.1489E+04
Br-82	3.2910E-05	3.0398E-14	2.2325E+11	1.2177E+06
Br-83	5.6710E-04	3.5897E-14	2.6046E+11	2.0983E+07
Br-84	9.9117E-04	1.4081E-14	1.0095E+11	3.6673E+07

Environment Transport Group Inventory:

	Present Release	Release Rate/s	Integral Release
Time (h) = 0.0001			
Noble gases (atoms)	2.8252E+13	7.8477E+15	1.4196E+15
Elemental I (atoms)	2.1805E+11	6.0569E+13	1.0956E+13
Organic I (atoms)	6.7442E+09	1.8734E+12	3.3887E+11
Aerosols (kg)	2.1267E-10	5.9075E-08	1.0686E-08

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0001	

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 0.0001 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 0.0001 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 0.0001 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.0001				
Kr-85	1.7041E-07	4.3435E-13	3.0773E+12	6.3052E+03
Kr-85m	3.1555E-06	3.8343E-16	2.7166E+09	1.1675E+05
Kr-87	6.0840E-06	2.1479E-16	1.4868E+09	2.2511E+05
Kr-88	8.5625E-06	6.8286E-16	4.6730E+09	3.1681E+05
Rb-86	3.8080E-08	4.6800E-16	3.2772E+09	1.4090E+03
Sr-89	5.1474E-13	1.7718E-20	1.1989E+05	1.9045E-02
I-131	1.2122E-05	9.7774E-14	4.4947E+11	4.4850E+05
I-132	1.7300E-05	1.6760E-15	7.6463E+09	6.4010E+05
I-133	2.3683E-05	2.0906E-14	9.4661E+10	8.7625E+05
I-134	2.5949E-05	9.7272E-16	4.3715E+09	9.6011E+05
I-135	2.2224E-05	6.3284E-15	2.8230E+10	8.2231E+05
Xe-133	2.3748E-05	1.2687E-13	5.7445E+11	8.7866E+05
Xe-135	7.6006E-06	2.9763E-15	1.3277E+10	2.8122E+05
Cs-134	3.9596E-06	3.0604E-12	1.3754E+13	1.4651E+05
Cs-136	1.1416E-06	1.5577E-14	6.8974E+10	4.2240E+04
Cs-137	2.1382E-06	2.4583E-11	1.0806E+14	7.9115E+04
I-130	6.0632E-07	3.1088E-16	1.4401E+09	2.2434E+04
Kr-83m	1.4772E-06	7.1596E-17	5.1947E+08	5.4655E+04
Xe-138	1.9611E-05	2.0395E-16	8.9002E+08	7.2561E+05
Xe-131m	1.3520E-07	1.6141E-15	7.4199E+09	5.0022E+03
Xe-133m	7.5470E-07	1.6820E-15	7.6158E+09	2.7924E+04
Xe-135m	4.8576E-06	5.3327E-17	2.3788E+08	1.7973E+05
Cs-138	2.6047E-05	6.1556E-16	2.6862E+09	9.6374E+05
Cs-134m	9.5635E-07	1.1859E-16	5.3296E+08	3.5385E+04
Rb-88	1.0436E-05	8.6941E-17	5.9497E+08	3.8614E+05
Rb-89	1.3399E-05	9.6403E-17	6.5230E+08	4.9577E+05
Br-82	8.5562E-08	7.9031E-17	5.8041E+08	3.1658E+03
Br-83	1.4744E-06	9.3328E-17	6.7715E+08	5.4552E+04
Br-84	2.5769E-06	3.6608E-17	2.6245E+08	9.5345E+04

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
0.0001			
Noble gases (atoms)	3.6906E+12	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.8485E+10	0.0000E+00	0.0000E+00
Organic I (atoms)	8.8102E+08	0.0000E+00	0.0000E+00
Aerosols (kg)	2.7782E-11	0.0000E+00	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Deposition Recirculating	
Time (h) =	0.0001	Surfaces Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.0001 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	0.0001 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	0.0001 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	0.0001 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.0250

EAB Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		6.2100E-03	6.7272E-01	1.0629E-02	3.6842E-02
Accumulated dose (rem)		6.2224E-03	6.7406E-01	1.0650E-02	3.6915E-02

LPZ Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		7.6732E-04	8.3123E-02	1.3133E-03	4.5523E-03
Accumulated dose (rem)		7.6886E-04	8.3288E-02	1.3160E-03	4.5613E-03

Control Room Doses:

Time (h) =	0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		3.8808E-05	1.4264E-01	2.2484E-03	6.5333E-03
Accumulated dose (rem)		3.8809E-05	1.4264E-01	2.2484E-03	6.5333E-03

Containment Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Kr-85		3.1863E+04	8.1213E-02	5.7539E+23	1.1789E+15
Kr-85m		5.8773E+05	7.1417E-05	5.0598E+20	2.1746E+16
Kr-87		1.1222E+06	3.9618E-05	2.7424E+20	4.1522E+16
Kr-88		1.5913E+06	1.2690E-04	8.6845E+20	5.8877E+16
Rb-86		7.1021E+03	8.7284E-05	6.1120E+20	2.6278E+14
Sr-89		3.4474E+01	1.1866E-06	8.0293E+18	1.2755E+12

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-131	2.2574E+06	1.8208E-02	8.3704E+22	8.3523E+16
I-132	3.1979E+06	3.0981E-04	1.4134E+21	1.1832E+17
I-133	4.4071E+06	3.8904E-03	1.7615E+22	1.6306E+17
I-134	4.7387E+06	1.7763E-04	7.9831E+20	1.7533E+17
I-135	4.1284E+06	1.1756E-03	5.2440E+21	1.5275E+17
Xe-133	4.4402E+06	2.3721E-02	1.0741E+23	1.6429E+17
Xe-135	1.4268E+06	5.5871E-04	2.4923E+21	5.2791E+16
Cs-134	7.3851E+05	5.7079E-01	2.5652E+24	2.7325E+16
Cs-136	2.1291E+05	2.9050E-03	1.2864E+22	7.8778E+15
Cs-137	3.9880E+05	4.5849E+00	2.0154E+25	1.4756E+16
I-130	1.1277E+05	5.7818E-05	2.6784E+20	4.1723E+15
Kr-83m	2.7619E+05	1.3386E-05	9.7126E+19	1.0219E+16
Xe-138	3.4084E+06	3.5446E-05	1.5468E+20	1.2611E+17
Xe-131m	2.5278E+04	3.0179E-04	1.3873E+21	9.3529E+14
Xe-133m	1.4111E+05	3.1448E-04	1.4239E+21	5.2210E+15
Xe-135m	8.9152E+05	9.7870E-06	4.3658E+19	3.2986E+16
Cs-138	4.8173E+06	1.1384E-04	4.9680E+20	1.7824E+17
Cs-134m	1.7731E+05	2.1987E-05	9.8813E+19	6.5605E+15
Rb-88	1.9283E+06	1.6064E-05	1.0993E+20	7.1346E+16
Rb-89	2.3345E+06	1.6796E-05	1.1365E+20	8.6376E+16
Ba-137m	1.4233E+05	2.6466E-07	1.1634E+18	5.2664E+15
Br-82	1.5928E+04	1.4712E-05	1.0804E+20	5.8932E+14
Br-83	2.7262E+05	1.7257E-05	1.2521E+20	1.0087E+16
Br-84	4.6455E+05	6.5996E-06	4.7314E+19	1.7188E+16

Containment Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0250			
Noble gases (atoms)	6.9004E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	5.1532E+21	0.0000E+00	0.0000E+00
Organic I (atoms)	1.6463E+20	0.0000E+00	0.0000E+00
Aerosols (kg)	5.1816E+00	0.0000E+00	0.0000E+00

	Surfaces	Filter
Time (h) = 0.0250		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.6989E+20	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	1.2944E-02	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 0.0250	Ci	kg	Atoms	Bq
Kr-85	3.3038E-02	8.4209E-08	5.9661E+17	1.2224E+09
Kr-85m	6.0941E-01	7.4052E-11	5.2465E+14	2.2548E+10
Kr-87	1.1636E+00	4.1080E-11	2.8435E+14	4.3054E+10
Kr-88	1.6500E+00	1.3159E-10	9.0048E+14	6.1049E+10
Rb-86	7.3732E-03	9.0617E-11	6.3454E+14	2.7281E+08
Sr-89	3.5791E-05	1.2319E-12	8.3359E+12	1.3243E+06
I-131	2.3452E+00	1.8917E-08	8.6962E+16	8.6773E+10
I-132	3.3224E+00	3.2187E-10	1.4685E+15	1.2293E+11
I-133	4.5786E+00	4.0418E-09	1.8301E+16	1.6941E+11
I-134	4.9231E+00	1.8455E-10	8.2938E+14	1.8215E+11
I-135	4.2891E+00	1.2213E-09	5.4481E+15	1.5870E+11
Xe-133	4.6040E+00	2.4596E-08	1.1137E+17	1.7035E+11
Xe-135	1.4794E+00	5.7931E-10	2.5842E+15	5.4738E+10
Cs-134	7.6671E-01	5.9259E-07	2.6632E+18	2.8368E+10
Cs-136	2.2104E-01	3.0160E-09	1.3355E+16	8.1786E+09
Cs-137	4.1403E-01	4.7600E-06	2.0924E+19	1.5319E+10
I-130	1.1715E-01	6.0069E-11	2.7826E+14	4.3347E+09
Kr-83m	2.8637E-01	1.3880E-11	1.0071E+14	1.0596E+10
Xe-138	3.5341E+00	3.6754E-11	1.6039E+14	1.3076E+11
Xe-131m	2.6211E-02	3.1292E-10	1.4385E+15	9.6980E+08
Xe-133m	1.4631E-01	3.2608E-10	1.4764E+15	5.4135E+09
Xe-135m	9.2435E-01	1.0147E-11	4.5266E+13	3.4201E+10
Cs-138	5.0011E+00	1.1819E-10	5.1576E+14	1.8504E+11
Cs-134m	1.8408E-01	2.2827E-11	1.0259E+14	6.8110E+09
Rb-88	2.0018E+00	1.6676E-11	1.1412E+14	7.4067E+10
Rb-89	2.4236E+00	1.7437E-11	1.1799E+14	8.9675E+10
Ba-137m	1.4777E-01	2.7477E-13	1.2078E+12	5.4675E+09
Br-82	1.6548E-02	1.5284E-11	1.1225E+14	6.1226E+08
Br-83	2.8323E-01	1.7928E-11	1.3008E+14	1.0479E+10

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Br-84	4.8263E-01	6.8565E-12	4.9156E+13	1.7857E+10
-------	------------	------------	------------	------------

## Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 0.0250	Release	Rate/s	Release
Noble gases (atoms)	1.4339E+17	2.0964E+15	7.1550E+17
Elemental I (atoms)	1.0743E+15	1.5706E+13	5.4309E+15
Organic I (atoms)	3.4210E+13	5.0015E+11	1.7070E+14
Aerosols (kg)	1.0770E-06	1.5746E-08	5.3794E-06

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0250	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.0250	Ci	kg	Atoms	Bq
Kr-85	8.5202E-05	2.1717E-10	1.5386E+15	3.1525E+06
Kr-85m	1.5716E-03	1.9097E-13	1.3530E+12	5.8149E+07
Kr-87	3.0008E-03	1.0594E-13	7.3332E+11	1.1103E+08
Kr-88	4.2551E-03	3.3934E-13	2.3222E+12	1.5744E+08
Rb-86	1.9015E-05	2.3369E-13	1.6364E+12	7.0355E+05
Sr-89	9.2300E-08	3.1770E-15	2.1497E+10	3.4151E+03
I-131	6.0481E-03	4.8785E-11	2.2427E+14	2.2378E+08
I-132	8.5681E-03	8.3007E-13	3.7870E+12	3.1702E+08
I-133	1.1808E-02	1.0423E-11	4.7196E+13	4.3689E+08
I-134	1.2696E-02	4.7592E-13	2.1389E+12	4.6976E+08
I-135	1.1061E-02	3.1496E-12	1.4050E+13	4.0926E+08
Xe-133	1.1873E-02	6.3431E-11	2.8721E+14	4.3931E+08
Xe-135	3.8152E-03	1.4940E-12	6.6644E+12	1.4116E+08
Cs-134	1.9773E-03	1.5282E-09	6.8680E+15	7.3159E+07
Cs-136	5.7004E-04	7.7778E-12	3.4441E+13	2.1092E+07
Cs-137	1.0677E-03	1.2275E-08	5.3959E+16	3.9506E+07
I-130	3.0213E-04	1.5491E-13	7.1761E+11	1.1179E+07
Kr-83m	7.3853E-04	3.5795E-14	2.5971E+11	2.7325E+07
Xe-138	9.1141E-03	9.4785E-14	4.1363E+11	3.3722E+08
Xe-131m	6.7595E-05	8.0699E-13	3.7098E+12	2.5010E+06
Xe-133m	3.7732E-04	8.4092E-13	3.8076E+12	1.3961E+07
Xe-135m	2.3838E-03	2.6169E-14	1.1674E+11	8.8200E+07
Cs-138	1.2897E-02	3.0480E-13	1.3301E+12	4.7720E+08



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-134m	4.7473E-04	5.8867E-14	2.6456E+11	1.7565E+07
Rb-88	5.1625E-03	4.3007E-14	2.9431E+11	1.9101E+08
Rb-89	6.2503E-03	4.4969E-14	3.0428E+11	2.3126E+08
Ba-137m	3.8108E-04	7.0859E-16	3.1148E+09	1.4100E+07
Br-82	4.2674E-05	3.9417E-14	2.8948E+11	1.5789E+06
Br-83	7.3041E-04	4.6235E-14	3.3546E+11	2.7025E+07
Br-84	1.2447E-03	1.7682E-14	1.2677E+11	4.6052E+07

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0250			
Noble gases (atoms)	1.8452E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.4005E+13	0.0000E+00	0.0000E+00
Organic I (atoms)	4.4023E+11	0.0000E+00	0.0000E+00
Aerosols (kg)	1.3873E-08	0.0000E+00	0.0000E+00

	Surfaces	Filter
Time (h) = 0.0250		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 2.0000

EAB Doses:

Time (h) = 2.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.6822E-01	4.6342E+01	4.5789E-01	2.3959E+00
Accumulated dose (rem)	2.7444E-01	4.7016E+01	4.6854E-01	2.4328E+00

LPZ Doses:

Time (h) = 2.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.3141E-02	5.7261E+00	5.6578E-02	2.9604E-01
Accumulated dose (rem)	3.3910E-02	5.8094E+00	5.7894E-02	3.0060E-01

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Control Room Doses:

Time (h) =	2.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.6330E-03	6.6184E+00	1.6668E-01	3.0616E-01
Accumulated dose (rem)		2.6718E-03	6.7610E+00	1.6893E-01	3.1269E-01

## Containment Compartment Atmosphere Nuclide Inventory:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Kr-85		3.1861E+04	8.1210E-02	5.7536E+23	1.1789E+15
Kr-85m		4.3295E+05	5.2609E-05	3.7273E+20	1.6019E+16
Kr-87		3.8240E+05	1.3500E-05	9.3448E+19	1.4149E+16
Kr-88		9.8258E+05	7.8360E-05	5.3625E+20	3.6355E+16
Rb-86		5.8110E+03	7.1416E-05	5.0009E+20	2.1501E+14
Sr-89		4.2657E+02	1.4683E-05	9.9350E+19	1.5783E+13
I-131		1.7616E+06	1.4209E-02	6.5319E+22	6.5177E+16
I-132		1.3860E+06	1.3427E-04	6.1257E+20	5.1281E+16
I-133		3.2430E+06	2.8628E-03	1.2962E+22	1.1999E+17
I-134		7.8137E+05	2.9290E-05	1.3163E+20	2.8911E+16
I-135		2.6376E+06	7.5106E-04	3.3504E+21	9.7592E+16
Xe-133		4.4383E+06	2.3711E-02	1.0736E+23	1.6422E+17
Xe-135		1.7581E+06	6.8844E-04	3.0710E+21	6.5049E+16
Cs-134		6.0607E+05	4.6843E-01	2.1052E+24	2.2425E+16
Cs-136		1.7398E+05	2.3738E-03	1.0511E+22	6.4373E+15
Cs-137		3.2730E+05	3.7629E+00	1.6541E+25	1.2110E+16
I-130		7.9332E+04	4.0676E-05	1.8843E+20	2.9353E+15
Kr-83m		2.3701E+05	1.1487E-05	8.3347E+19	8.7692E+15
Xe-138		1.0353E+04	1.0767E-07	4.6986E+17	3.8307E+14
Xe-131m		2.5275E+04	3.0175E-04	1.3872E+21	9.3518E+14
Xe-133m		1.4066E+05	3.1348E-04	1.4194E+21	5.2044E+15
Xe-135m		5.5543E+05	6.0974E-06	2.7200E+19	2.0551E+16
Cs-138		4.8483E+05	1.1458E-05	5.0001E+19	1.7939E+16
Cs-134m		9.0764E+04	1.1255E-05	5.0582E+19	3.3583E+15
Rb-88		1.0744E+06	8.9508E-06	6.1253E+19	3.9754E+16
Rb-89		8.6206E+03	6.2023E-08	4.1967E+17	3.1896E+14
Ba-137m		3.6282E+05	6.7464E-07	2.9655E+18	1.3424E+16
Br-82		1.2042E+04	1.1122E-05	8.1684E+19	4.4554E+14
Br-83		1.2083E+05	7.6484E-06	5.5494E+19	4.4706E+15
Br-84		2.7583E+04	3.9186E-07	2.8093E+18	1.0206E+15

## Containment Transport Group Inventory:

Time (h) =	2.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		6.8971E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		3.8056E+20	0.0000E+00	0.0000E+00
Organic I (atoms)		1.5846E+20	0.0000E+00	0.0000E+00
Aerosols (kg)		4.2517E+00	0.0000E+00	0.0000E+00

Time (h) =	2.0000	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		4.7435E+21	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		9.4136E-01	0.0000E+00

## Environment Integral Nuclide Release:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Kr-85		2.6548E+00	6.7668E-06	4.7942E+19	9.8229E+10
Kr-85m		3.6075E+01	4.3836E-09	3.1057E+16	1.3348E+12
Kr-87		3.1863E+01	1.1249E-09	7.7865E+15	1.1789E+12
Kr-88		8.1873E+01	6.5294E-09	4.4683E+16	3.0293E+12
Rb-86		5.3579E-01	6.5848E-09	4.6110E+16	1.9824E+10
Sr-89		3.9331E-02	1.3538E-09	9.1605E+15	1.4552E+09
I-131		1.6488E+02	1.3300E-06	6.1139E+18	6.1006E+12
I-132		1.2973E+02	1.2568E-08	5.7337E+16	4.7998E+12
I-133		3.0354E+02	2.6795E-07	1.2133E+18	1.1231E+13
I-134		7.3136E+01	2.7415E-09	1.2321E+16	2.7060E+12
I-135		2.4688E+02	7.0299E-08	3.1359E+17	9.1345E+12
Xe-133		3.6966E+02	1.9749E-06	8.9421E+18	1.3677E+13
Xe-135		1.4473E+02	5.6672E-08	2.5281E+17	5.3549E+12

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-134	5.5882E+01	4.3191E-05	1.9411E+20	2.0676E+12
Cs-136	1.6042E+01	2.1888E-07	9.6920E+17	5.9354E+11
Cs-137	3.0178E+01	3.4695E-04	1.5251E+21	1.1166E+12
I-130	7.4254E+00	3.8073E-09	1.7637E+16	2.7474E+11
Kr-83m	1.9346E+01	9.3768E-10	6.8034E+15	7.1581E+11
Xe-138	8.6268E-01	8.9718E-12	3.9152E+13	3.1919E+10
Xe-131m	2.1056E+00	2.5138E-08	1.1556E+17	7.7908E+10
Xe-133m	1.1709E+01	2.6095E-08	1.1816E+17	4.3323E+11
Xe-135m	4.2294E+01	4.6430E-10	2.0712E+15	1.5649E+12
Cs-138	4.4474E+01	1.0510E-09	4.5866E+15	1.6456E+12
Cs-134m	8.3688E+00	1.0378E-09	4.6638E+15	3.0965E+11
Rb-88	9.2730E+01	7.7250E-10	5.2865E+15	3.4310E+12
Rb-89	7.9485E-01	5.7187E-12	3.8695E+13	2.9410E+10
Ba-137m	3.3454E+01	6.2204E-11	2.7343E+14	1.2378E+12
Br-82	1.1271E+00	1.0411E-09	7.6456E+15	4.1702E+10
Br-83	1.1309E+01	7.1589E-10	5.1942E+15	4.1845E+11
Br-84	2.5818E+00	3.6678E-11	2.6295E+14	9.5526E+10

Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) =	Release	Rate/s	Release
Noble gases (atoms)	5.7476E+17	7.9827E+15	5.7463E+19
Elemental I (atoms)	3.2113E+14	4.4602E+12	1.5194E+17
Organic I (atoms)	1.3198E+14	1.8331E+12	1.3198E+16
Aerosols (kg)	3.5448E-06	4.9234E-08	3.9202E-04

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
Rb-86	2.5352E-04	3.1157E-12	2.1818E+13	9.3801E+06
Sr-89	1.8610E-05	6.4057E-13	4.3344E+12	6.8857E+05
I-131	7.7983E-02	6.2903E-10	2.8917E+15	2.8854E+09
I-132	6.1356E-02	5.9441E-12	2.7118E+13	2.2702E+09
I-133	1.4357E-01	1.2673E-10	5.7384E+14	5.3119E+09
I-134	3.4591E-02	1.2967E-12	5.8274E+12	1.2799E+09
I-135	1.1677E-01	3.3249E-11	1.4832E+14	4.3203E+09
Cs-134	2.6441E-02	2.0436E-08	9.1844E+16	9.7832E+08
Cs-136	7.5903E-03	1.0356E-10	4.5859E+14	2.8084E+08
Cs-137	1.4279E-02	1.6416E-07	7.2162E+17	5.2833E+08
I-130	3.5120E-03	1.8007E-12	8.3417E+12	1.2994E+08
Cs-138	1.8858E-02	4.4567E-13	1.9448E+12	6.9775E+08
Cs-134m	3.9598E-03	4.9103E-13	2.2067E+12	1.4651E+08
Rb-88	9.9286E-03	8.2712E-14	5.6603E+11	3.6736E+08
Rb-89	3.7610E-04	2.7059E-15	1.8309E+10	1.3916E+07
Ba-137m	1.5829E-02	2.9433E-14	1.2938E+11	5.8567E+08
Br-82	5.3308E-04	4.9239E-13	3.6161E+12	1.9724E+07
Br-83	5.3490E-03	3.3859E-13	2.4567E+12	1.9791E+08
Br-84	1.2211E-03	1.7348E-14	1.2437E+11	4.5181E+07

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	7.0387E+13
Organic I (atoms)	6.2529E+12
Aerosols (kg)	1.8549E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 2.0000 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Kr-85	3.0607E-04	7.8013E-10	5.5271E+15	1.1325E+07
Kr-85m	4.1591E-03	5.0538E-13	3.5806E+12	1.5388E+08
Kr-87	3.6735E-03	1.2969E-13	8.9770E+11	1.3592E+08
Kr-88	9.4390E-03	7.5276E-13	5.1514E+12	3.4924E+08
Rb-86	3.7960E-06	4.6653E-14	3.2669E+11	1.4045E+05
Sr-89	2.7866E-07	9.5916E-15	6.4901E+10	1.0310E+04
I-131	1.1526E-03	9.2968E-12	4.2738E+13	4.2645E+07
I-132	9.0682E-04	8.7852E-14	4.0080E+11	3.3552E+07
I-133	2.1218E-03	1.8731E-12	8.4812E+12	7.8508E+07
I-134	5.1124E-04	1.9164E-14	8.6127E+10	1.8916E+07
I-135	1.7258E-03	4.9141E-13	2.1921E+12	6.3853E+07
Xe-133	4.2852E-02	2.2893E-10	1.0366E+15	1.5855E+09
Xe-135	1.9178E-02	7.5097E-12	3.3500E+13	7.0957E+08
Cs-134	3.9592E-04	3.0600E-10	1.3752E+15	1.4649E+07
Cs-136	1.1365E-04	1.5507E-12	6.8667E+12	4.2052E+06
Cs-137	2.1381E-04	2.4581E-09	1.0805E+16	7.9110E+06
I-130	5.1906E-05	2.6614E-14	1.2329E+11	1.9205E+06
Kr-83m	2.8281E-03	1.3707E-13	9.9453E+11	1.0464E+08
Xe-138	9.9457E-05	1.0343E-15	4.5137E+09	3.6799E+06
Xe-131m	2.4339E-04	2.9057E-12	1.3358E+13	9.0054E+06
Xe-133m	1.3666E-03	3.0457E-12	1.3791E+13	5.0565E+07
Xe-135m	1.3070E-02	1.4348E-13	6.4005E+11	4.8359E+08
Cs-138	3.5731E-04	8.4443E-15	3.6850E+10	1.3221E+07
Cs-134m	5.9292E-05	7.3524E-15	3.3043E+10	2.1938E+06
Rb-88	3.9276E-03	3.2719E-14	2.2391E+11	1.4532E+08
Rb-89	5.6315E-06	4.0516E-17	2.7415E+08	2.0836E+05
Ba-137m	2.3701E-04	4.4071E-16	1.9372E+09	8.7695E+06
Br-82	7.8787E-06	7.2773E-15	5.3445E+10	2.9151E+05
Br-83	7.9057E-05	5.0043E-15	3.6309E+10	2.9251E+06
Br-84	1.8048E-05	2.5639E-16	1.8381E+09	6.6776E+05

Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
2.0000			
Noble gases (atoms)	6.6356E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.3667E+11	0.0000E+00	0.0000E+00
Organic I (atoms)	1.0131E+11	0.0000E+00	0.0000E+00
Aerosols (kg)	2.7775E-09	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) =	Ci	kg	Atoms	Bq
2.0000				
Rb-86	2.6478E-05	3.2542E-13	2.2787E+12	9.7970E+05
Sr-89	1.9437E-06	6.6904E-14	4.5270E+11	7.1917E+04
I-131	8.2387E-03	6.6455E-11	3.0550E+14	3.0483E+08
I-132	6.4821E-03	6.2798E-13	2.8650E+12	2.3984E+08
I-133	1.5167E-02	1.3389E-11	6.0625E+13	5.6119E+08
I-134	3.6544E-03	1.3699E-13	6.1565E+11	1.3521E+08
I-135	1.2336E-02	3.5127E-12	1.5670E+13	4.5643E+08
Cs-134	2.7616E-03	2.1345E-09	9.5925E+15	1.0218E+08
Cs-136	7.9277E-04	1.0817E-11	4.7897E+13	2.9332E+07
Cs-137	1.4914E-03	1.7146E-08	7.5369E+16	5.5181E+07
I-130	3.7103E-04	1.9024E-13	8.8128E+11	1.3728E+07
Cs-138	2.4149E-03	5.7071E-14	2.4905E+11	8.9352E+07
Cs-134m	4.1358E-04	5.1285E-14	2.3048E+11	1.5302E+07
Rb-88	3.9277E-03	3.2721E-14	2.2392E+11	1.4533E+08

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Rb-89	3.9281E-05	2.8261E-16	1.9123E+09	1.4534E+06
Ba-137m	1.6532E-03	3.0741E-15	1.3513E+10	6.1170E+07
Br-82	5.6318E-05	5.2019E-14	3.8203E+11	2.0838E+06
Br-83	5.6511E-04	3.5772E-14	2.5954E+11	2.0909E+07
Br-84	1.2901E-04	1.8327E-15	1.3139E+10	4.7733E+06

	Deposition	Recirculating
Time (h) = 2.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.1783E+13
Organic I (atoms)	0.0000E+00	6.2754E+11
Aerosols (kg)	0.0000E+00	1.9373E-08

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	2.5352E-04	3.1157E-12	2.1818E+13	9.3801E+06
Sr-89	1.8610E-05	6.4057E-13	4.3344E+12	6.8857E+05
I-131	7.7983E-02	6.2903E-10	2.8917E+15	2.8854E+09
I-132	6.1356E-02	5.9441E-12	2.7118E+13	2.2702E+09
I-133	1.4357E-01	1.2673E-10	5.7384E+14	5.3119E+09
I-134	3.4591E-02	1.2967E-12	5.8274E+12	1.2799E+09
I-135	1.1677E-01	3.3249E-11	1.4832E+14	4.3203E+09
Cs-134	2.6441E-02	2.0436E-08	9.1844E+16	9.7832E+08
Cs-136	7.5903E-03	1.0356E-10	4.5859E+14	2.8084E+08
Cs-137	1.4279E-02	1.6416E-07	7.2162E+17	5.2833E+08
I-130	3.5120E-03	1.8007E-12	8.3417E+12	1.2994E+08
Cs-138	1.8858E-02	4.4567E-13	1.9448E+12	6.9775E+08
Cs-134m	3.9598E-03	4.9103E-13	2.2067E+12	1.4651E+08
Rb-88	9.9286E-03	8.2712E-14	5.6603E+11	3.6736E+08
Rb-89	3.7610E-04	2.7059E-15	1.8309E+10	1.3916E+07
Ba-137m	1.5829E-02	2.9433E-14	1.2938E+11	5.8567E+08
Br-82	5.3308E-04	4.9239E-13	3.6161E+12	1.9724E+07
Br-83	5.3490E-03	3.3859E-13	2.4567E+12	1.9791E+08
Br-84	1.2211E-03	1.7348E-14	1.2437E+11	4.5181E+07

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	7.0387E+13
Organic I (atoms)	6.2529E+12
Aerosols (kg)	1.8549E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Rb-86		2.7999E-04	3.4411E-12	2.4096E+13	1.0360E+07
Sr-89		2.0554E-05	7.0747E-13	4.7871E+12	7.6049E+05
I-131		8.6222E-02	6.9548E-10	3.1972E+15	3.1902E+09
I-132		6.7838E-02	6.5721E-12	2.9983E+13	2.5100E+09
I-133		1.5873E-01	1.4012E-10	6.3446E+14	5.8731E+09
I-134		3.8245E-02	1.4337E-12	6.4430E+12	1.4151E+09
I-135		1.2910E-01	3.6762E-11	1.6399E+14	4.7768E+09
Cs-134		2.9203E-02	2.2571E-08	1.0144E+17	1.0805E+09
Cs-136		8.3831E-03	1.1438E-10	5.0648E+14	3.1017E+08
Cs-137		1.5771E-02	1.8131E-07	7.9699E+17	5.8351E+08
I-130		3.8830E-03	1.9910E-12	9.2229E+12	1.4367E+08
Cs-138		2.1273E-02	5.0274E-13	2.1939E+12	7.8711E+08
Cs-134m		4.3734E-03	5.4231E-13	2.4372E+12	1.6182E+08
Rb-88		1.3856E-02	1.1543E-13	7.8995E+11	5.1269E+08
Rb-89		4.1538E-04	2.9885E-15	2.0221E+10	1.5369E+07
Ba-137m		1.7482E-02	3.2507E-14	1.4289E+11	6.4684E+08
Br-82		5.8939E-04	5.4440E-13	3.9981E+12	2.1808E+07
Br-83		5.9141E-03	3.7437E-13	2.7162E+12	2.1882E+08
Br-84		1.3501E-03	1.9180E-14	1.3751E+11	4.9954E+07

Detailed model information at time (H) = 8.0000

## EAB Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		2.3690E-01	8.9311E+01	4.1563E-01	4.3966E+00
Accumulated dose (rem)		5.1134E-01	1.3633E+02	8.8418E-01	6.8294E+00

## LPZ Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.3318E-02	5.0206E+00	2.3365E-02	2.4716E-01
Accumulated dose (rem)		4.7228E-02	1.0830E+01	8.1259E-02	5.4776E-01

## Control Room Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		3.1937E-03	7.2834E+00	2.1093E-01	3.4324E-01
Accumulated dose (rem)		5.8655E-03	1.4044E+01	3.7986E-01	6.5593E-01

## Containment Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Kr-85		3.1855E+04	8.1192E-02	5.7524E+23	1.1786E+15
Kr-85m		1.7106E+05	2.0787E-05	1.4727E+20	6.3294E+15
Kr-87		1.4524E+04	5.1275E-07	3.5492E+18	5.3738E+14
Kr-88		2.2713E+05	1.8114E-05	1.2396E+20	8.4039E+15
Rb-86		3.1589E+03	3.8822E-05	2.7185E+20	1.1688E+14
Sr-89		2.3423E+02	8.0624E-06	5.4554E+19	8.6665E+12
I-131		9.4305E+05	7.6068E-03	3.4969E+22	3.4893E+16
I-132		1.2430E+05	1.2042E-05	5.4937E+19	4.5989E+15
I-133		1.4525E+06	1.2822E-03	5.8056E+21	5.3741E+16
I-134		3.7203E+03	1.3946E-07	6.2674E+17	1.3765E+14
I-135		7.6906E+05	2.1899E-04	9.7688E+20	2.8455E+16
Xe-133		4.4159E+06	2.3592E-02	1.0682E+23	1.6339E+17
Xe-135		2.0149E+06	7.8900E-04	3.5196E+21	7.4551E+16
Cs-134		3.3246E+05	2.5696E-01	1.1548E+24	1.2301E+16
Cs-136		9.4205E+04	1.2854E-03	5.6916E+21	3.4856E+15
Cs-137		1.7958E+05	2.0646E+00	9.0752E+24	6.6444E+15
I-130		3.0997E+04	1.5893E-05	7.3623E+19	1.1469E+15
Kr-83m		7.2313E+04	3.5049E-06	2.5430E+19	2.6756E+15
Xe-138		2.3284E-04	2.4215E-15	1.0567E+10	8.6152E+06
Xe-131m		2.5261E+04	3.0158E-04	1.3864E+21	9.3464E+14
Xe-133m		1.3820E+05	3.0799E-04	1.3945E+21	5.1132E+15
Xe-135m		2.9550E+05	3.2439E-06	1.4471E+19	1.0933E+16
Cs-138		1.1672E+02	2.7584E-09	1.2037E+16	4.3187E+12
Cs-134m		1.1869E+04	1.4718E-06	6.6143E+18	4.3915E+14
Rb-88		2.4801E+05	2.0661E-06	1.4139E+19	9.1763E+15
Rb-89		3.5091E-04	2.5247E-15	1.7083E+10	1.2984E+07
Ba-137m		1.9907E+05	3.7015E-07	1.6271E+18	7.3655E+15
Br-82		5.8548E+03	5.4079E-06	3.9716E+19	2.1663E+14

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Br-83	1.1600E+04	7.3426E-07	5.3275E+18	4.2919E+14
Br-84	5.8988E+00	8.3800E-11	6.0078E+14	2.1825E+11

Containment Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 8.0000			
Noble gases (atoms)	6.8867E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.4447E+17	0.0000E+00	0.0000E+00
Organic I (atoms)	1.4681E+20	0.0000E+00	0.0000E+00
Aerosols (kg)	2.3320E+00	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 8.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.7484E+21	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	2.8584E+00	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Kr-85	1.0620E+01	2.7068E-05	1.9177E+20	3.9293E+11
Kr-85m	5.7029E+01	6.9298E-09	4.9097E+16	2.1101E+12
Kr-87	4.8420E+00	1.7094E-10	1.1832E+15	1.7915E+11
Kr-88	7.5721E+01	6.0387E-09	4.1325E+16	2.8017E+12
Rb-86	1.6126E+00	1.9818E-08	1.3878E+17	5.9665E+10
Sr-89	1.1957E-01	4.1158E-09	2.7849E+16	4.4242E+09
I-131	4.8426E+02	3.9061E-06	1.7957E+19	1.7918E+13
I-132	6.3826E+01	6.1834E-09	2.8210E+16	2.3616E+12
I-133	7.4584E+02	6.5840E-07	2.9812E+18	2.7596E+13
I-134	1.9104E+00	7.1611E-11	3.2183E+14	7.0683E+10
I-135	3.9491E+02	1.1245E-07	5.0163E+17	1.4612E+13
Xe-133	1.4657E+03	7.8305E-06	3.5456E+19	5.4232E+13
Xe-135	6.2362E+02	2.4420E-07	1.0893E+18	2.3074E+13
Cs-134	1.6972E+02	1.3118E-04	5.8953E+20	6.2797E+12
Cs-136	4.8091E+01	6.5617E-07	2.9055E+18	1.7794E+12
Cs-137	9.1674E+01	1.0539E-03	4.6329E+21	3.3919E+12
I-130	1.5917E+01	8.1611E-09	3.7806E+16	5.8893E+11
Kr-83m	2.1231E+01	1.0290E-09	7.4662E+15	7.8555E+11
Xe-131m	8.4015E+00	1.0030E-07	4.6110E+17	3.1085E+11
Xe-133m	4.5618E+01	1.0167E-07	4.6033E+17	1.6879E+12
Xe-135m	6.7549E+01	7.4155E-10	3.3079E+15	2.4993E+12
Cs-138	5.9428E-02	1.4045E-12	6.1288E+12	2.1989E+09
Cs-134m	6.0590E+00	7.5133E-10	3.3766E+15	2.2418E+11
Rb-88	8.6314E+01	7.1905E-10	4.9207E+15	3.1936E+12
Ba-137m	1.0162E+02	1.8896E-10	8.3062E+14	3.7601E+12
Br-82	3.0065E+00	2.7770E-09	2.0394E+16	1.1124E+11
Br-83	5.9564E+00	3.7704E-10	2.7357E+15	2.2039E+11
Br-84	3.0290E-03	4.3031E-14	3.0850E+11	1.1207E+08

Environment Transport Group Inventory:

	Present Release	Release Rate/s	Integral Release
Time (h) = 8.0000			
Noble gases (atoms)	5.7389E+17	7.9707E+15	2.2934E+20
Elemental I (atoms)	1.2192E+11	1.6933E+09	1.5210E+17
Organic I (atoms)	1.2229E+14	1.6984E+12	4.8922E+16
Aerosols (kg)	1.9444E-06	2.7006E-08	1.1905E-03

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 8.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	6.9290E-04	8.5157E-12	5.9631E+13	2.5637E+07

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Sr-89	5.1379E-05	1.7685E-12	1.1967E+13	1.9010E+06
I-131	2.0817E-01	1.6792E-09	7.7192E+15	7.7024E+09
I-132	2.7438E-02	2.6581E-12	1.2127E+13	1.0152E+09
I-133	3.2063E-01	2.8304E-10	1.2816E+15	1.1863E+10
I-134	8.2123E-04	3.0784E-14	1.3835E+11	3.0385E+07
I-135	1.6977E-01	4.8341E-11	2.1564E+14	6.2814E+09
Cs-134	7.2927E-02	5.6365E-08	2.5331E+17	2.6983E+09
Cs-136	2.0664E-02	2.8195E-10	1.2485E+15	7.6457E+08
Cs-137	3.9391E-02	4.5287E-07	1.9907E+18	1.4575E+09
I-130	6.8424E-03	3.5083E-12	1.6252E+13	2.5317E+08
Cs-138	2.4410E-05	5.7687E-16	2.5174E+09	9.0316E+05
Cs-134m	2.6035E-03	3.2284E-13	1.4509E+12	9.6328E+07
Rb-88	1.9720E-03	1.6428E-14	1.1242E+11	7.2965E+07
Ba-137m	4.3666E-02	8.1194E-14	3.5690E+11	1.6156E+09
Br-82	1.2924E-03	1.1938E-12	8.7672E+12	4.7820E+07
Br-83	2.5606E-03	1.6208E-13	1.1760E+12	9.4741E+07
Br-84	1.3021E-06	1.8498E-17	1.3262E+08	4.8179E+04

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	8.0000 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	6.9842E+13
Organic I (atoms)	2.0777E+13
Aerosols (kg)	5.1152E-07

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	8.0000 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	8.0000 Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Kr-85	2.5939E-04	6.6115E-10	4.6842E+15	9.5975E+06
Kr-85m	1.3930E-03	1.6927E-13	1.1992E+12	5.1540E+07
Kr-87	1.1827E-04	4.1753E-15	2.8902E+10	4.3759E+06
Kr-88	1.8495E-03	1.4750E-13	1.0094E+12	6.8433E+07
Rb-86	1.6116E-06	1.9806E-14	1.3869E+11	5.9628E+04
Sr-89	1.1950E-07	4.1133E-15	2.7832E+10	4.4215E+03
I-131	4.8109E-04	3.8805E-12	1.7839E+13	1.7800E+07
I-132	6.3408E-05	6.1429E-15	2.8025E+10	2.3461E+06
I-133	7.4096E-04	6.5409E-13	2.9617E+12	2.7416E+07
I-134	1.8979E-06	7.1143E-17	3.1972E+08	7.0221E+04
I-135	3.9233E-04	1.1172E-13	4.9835E+11	1.4516E+07
Xe-133	3.6679E-02	1.9596E-10	8.8727E+14	1.3571E+09
Xe-135	2.1452E-02	8.4001E-12	3.7472E+13	7.9371E+08
Cs-134	1.6962E-04	1.3110E-10	5.8916E+14	6.2758E+06
Cs-136	4.8061E-05	6.5576E-13	2.9037E+12	1.7783E+06
Cs-137	9.1617E-05	1.0533E-09	4.6300E+15	3.3898E+06
I-130	1.5813E-05	8.1077E-15	3.7558E+10	5.8507E+05
Kr-83m	9.7929E-04	4.7464E-14	3.4438E+11	3.6234E+07
Xe-131m	2.0803E-04	2.4836E-12	1.1417E+13	7.6971E+06
Xe-133m	1.1767E-03	2.6225E-12	1.1875E+13	4.3540E+07
Xe-135m	1.7147E-02	1.8824E-13	8.3970E+11	6.3444E+08
Cs-138	5.9550E-08	1.4073E-18	6.1413E+06	2.2033E+03
Cs-134m	6.0552E-06	7.5087E-16	3.3745E+09	2.2404E+05
Rb-88	7.6453E-04	6.3690E-15	4.3586E+10	2.8288E+07
Ba-137m	1.0156E-04	1.8884E-16	8.3010E+08	3.7577E+06



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Br-82	2.9868E-06	2.7588E-15	2.0261E+10	1.1051E+05
Br-83	5.9174E-06	3.7457E-16	2.7178E+09	2.1895E+05
Br-84	3.0092E-09	4.2750E-20	3.0648E+05	1.1134E+02

Control Room Transport Group Inventory:

Time (h) = 8.0000	Atmosphere		Sump	Overlying Pool
	Noble gases (atoms)	5.6356E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	9.9602E+07	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	7.3311E+10	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	1.1897E-09	0.0000E+00	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	5.7615E-05	7.0809E-13	4.9584E+12	2.1318E+06
Sr-89	4.2722E-06	1.4705E-13	9.9502E+11	1.5807E+05
I-131	1.7433E-02	1.4062E-10	6.4642E+14	6.4502E+08
I-132	2.2977E-03	2.2260E-13	1.0155E+12	8.5015E+07
I-133	2.6850E-02	2.3702E-11	1.0732E+14	9.9345E+08
I-134	6.8772E-05	2.5780E-15	1.1586E+10	2.5446E+06
I-135	1.4217E-02	4.0482E-12	1.8058E+13	5.2602E+08
Cs-134	6.0639E-03	4.6868E-09	2.1063E+16	2.2437E+08
Cs-136	1.7182E-03	2.3444E-11	1.0381E+14	6.3575E+07
Cs-137	3.2754E-03	3.7656E-08	1.6553E+17	1.2119E+08
I-130	5.7300E-04	2.9380E-13	1.3610E+12	2.1201E+07
Cs-138	2.2204E-06	5.2475E-17	2.2899E+08	8.2157E+04
Cs-134m	2.1648E-04	2.6844E-14	1.2064E+11	8.0098E+06
Rb-88	8.0480E-04	6.7045E-15	4.5881E+10	2.9778E+07
Ba-137m	3.6309E-03	6.7513E-15	2.9677E+10	1.3434E+08
Br-82	1.0823E-04	9.9970E-14	7.3419E+11	4.0046E+06
Br-83	2.1443E-04	1.3573E-14	9.8482E+10	7.9338E+06
Br-84	1.0904E-07	1.5491E-18	1.1106E+07	4.0346E+03

Time (h) = 8.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.1391E+13
Organic I (atoms)	0.0000E+00	1.6200E+12
Aerosols (kg)	0.0000E+00	4.2533E-08

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 8.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	6.9290E-04	8.5157E-12	5.9631E+13	2.5637E+07
Sr-89	5.1379E-05	1.7685E-12	1.1967E+13	1.9010E+06
I-131	2.0817E-01	1.6792E-09	7.7192E+15	7.7024E+09
I-132	2.7438E-02	2.6581E-12	1.2127E+13	1.0152E+09
I-133	3.2063E-01	2.8304E-10	1.2816E+15	1.1863E+10
I-134	8.2123E-04	3.0784E-14	1.3835E+11	3.0385E+07
I-135	1.6977E-01	4.8341E-11	2.1564E+14	6.2814E+09
Cs-134	7.2927E-02	5.6365E-08	2.5331E+17	2.6983E+09
Cs-136	2.0664E-02	2.8195E-10	1.2485E+15	7.6457E+08
Cs-137	3.9391E-02	4.5287E-07	1.9907E+18	1.4575E+09
I-130	6.8424E-03	3.5083E-12	1.6252E+13	2.5317E+08
Cs-138	2.4410E-05	5.7687E-16	2.5174E+09	9.0316E+05
Cs-134m	2.6035E-03	3.2284E-13	1.4509E+12	9.6328E+07
Rb-88	1.9720E-03	1.6428E-14	1.1242E+11	7.2965E+07
Ba-137m	4.3666E-02	8.1194E-14	3.5690E+11	1.6156E+09
Br-82	1.2924E-03	1.1938E-12	8.7672E+12	4.7820E+07
Br-83	2.5606E-03	1.6208E-13	1.1760E+12	9.4741E+07
Br-84	1.3021E-06	1.8498E-17	1.3262E+08	4.8179E+04

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	6.9842E+13
Organic I (atoms)	2.0777E+13
Aerosols (kg)	5.1152E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Rb-86	7.5052E-04	9.2238E-12	6.4590E+13	2.7769E+07
Sr-89	5.5651E-05	1.9156E-12	1.2962E+13	2.0591E+06
I-131	2.2561E-01	1.8198E-09	8.3656E+15	8.3474E+09
I-132	2.9735E-02	2.8807E-12	1.3143E+13	1.1002E+09
I-133	3.4748E-01	3.0674E-10	1.3889E+15	1.2857E+10
I-134	8.9000E-04	3.3362E-14	1.4994E+11	3.2930E+07
I-135	1.8398E-01	5.2389E-11	2.3370E+14	6.8074E+09
Cs-134	7.8991E-02	6.1052E-08	2.7438E+17	2.9227E+09
Cs-136	2.2382E-02	3.0539E-10	1.3523E+15	8.2814E+08
Cs-137	4.2667E-02	4.9052E-07	2.1562E+18	1.5787E+09
I-130	7.4154E-03	3.8021E-12	1.7613E+13	2.7437E+08
Cs-138	2.6630E-05	6.2934E-16	2.7464E+09	9.8532E+05
Cs-134m	2.8200E-03	3.4968E-13	1.5715E+12	1.0434E+08
Rb-88	2.7768E-03	2.3133E-14	1.5831E+11	1.0274E+08
Ba-137m	4.7297E-02	8.7945E-14	3.8658E+11	1.7500E+09
Br-82	1.4007E-03	1.2937E-12	9.5014E+12	5.1824E+07
Br-83	2.7750E-03	1.7566E-13	1.2745E+12	1.0267E+08
Br-84	1.4112E-06	2.0048E-17	1.4373E+08	5.2213E+04

Detailed model information at time (H) = 24.0000

EAB Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.4068E-01	4.0433E+01	2.7123E-01	2.0758E+00
Accumulated dose (rem)	6.5202E-01	1.7676E+02	1.1554E+00	8.9052E+00

LPZ Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.3243E-03	1.5303E+00	1.0266E-02	7.8563E-02
Accumulated dose (rem)	5.2552E-02	1.2360E+01	9.1525E-02	6.2632E-01

Control Room Doses:

Time (h) = 24.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	2.1301E-03	2.4756E+00	1.4188E-01	1.2065E-01
Accumulated dose (rem)	7.9956E-03	1.6520E+01	5.2175E-01	7.7659E-01

Containment Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Kr-85	3.1831E+04	8.1133E-02	5.7481E+23	1.1778E+15

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Kr-85m	1.4380E+04	1.7474E-06	1.2380E+19	5.3207E+14
Kr-87	2.3673E+00	8.3576E-11	5.7851E+14	8.7592E+10
Kr-88	4.5714E+03	3.6457E-07	2.4948E+18	1.6914E+14
Rb-86	6.2175E+02	7.6412E-06	5.3508E+19	2.3005E+13
Sr-89	4.6828E+01	1.6119E-06	1.0907E+19	1.7326E+12
I-131	1.8213E+05	1.4691E-03	6.7535E+21	6.7388E+15
I-132	2.0471E+02	1.9832E-08	9.0479E+16	7.5743E+12
I-133	1.7432E+05	1.5389E-04	6.9678E+20	6.4499E+15
I-134	2.4395E-03	9.1446E-14	4.1097E+11	9.0261E+07
I-135	2.9383E+04	8.3669E-06	3.7324E+19	1.0872E+15
Xe-133	4.2663E+06	2.2792E-02	1.0320E+23	1.5785E+17
Xe-135	1.1168E+06	4.3732E-04	1.9508E+21	4.1321E+16
Cs-134	6.7038E+04	5.1813E-02	2.3286E+23	2.4804E+15
Cs-136	1.8348E+04	2.5035E-04	1.1085E+21	6.7888E+14
Cs-137	3.6231E+04	4.1653E-01	1.8310E+24	1.3405E+15
I-130	2.5849E+03	1.3254E-06	6.1396E+18	9.5641E+13
Kr-83m	1.0177E+03	4.9327E-08	3.5790E+17	3.7656E+13
Xe-131m	2.5186E+04	3.0069E-04	1.3823E+21	9.3190E+14
Xe-133m	1.2618E+05	2.8122E-04	1.2733E+21	4.6688E+15
Xe-135m	5.5185E+04	6.0581E-07	2.7024E+18	2.0418E+15
Cs-138	2.4957E-08	5.8979E-19	2.5738E+06	9.2339E+02
Cs-134m	5.2287E+01	6.4837E-09	2.9139E+16	1.9346E+12
Rb-88	4.9915E+03	4.1583E-08	2.8456E+17	1.8469E+14
Ba-137m	4.0163E+04	7.4679E-08	3.2827E+17	1.4860E+15
Br-82	8.7474E+02	8.0797E-07	5.9338E+18	3.2365E+13
Br-83	2.2908E+01	1.4501E-09	1.0521E+16	8.4760E+11
Br-84	9.8599E-10	1.4007E-20	1.0042E+05	3.6481E+01

Containment Transport Group Inventory:

Time (h) = 24.0000	Atmosphere		Sump	Overlying Pool
	Noble gases (atoms)	6.8264E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.1693E+08	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	1.2830E+20	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	4.7021E-01	0.0000E+00	0.0000E+00	0.0000E+00

Time (h) = 24.0000	Deposition Surfaces		Recirculating Filter
	Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.1526E+21	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	4.7162E+00	0.0000E+00	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Kr-85	3.1847E+01	8.1173E-05	5.7510E+20	1.1783E+12
Kr-85m	1.4387E+01	1.7482E-09	1.2386E+16	5.3233E+11
Kr-87	2.3685E-03	8.3617E-14	5.7880E+11	8.7635E+07
Kr-88	4.5736E+00	3.6475E-10	2.4961E+15	1.6922E+11
Rb-86	2.5975E+00	3.1923E-08	2.2354E+17	9.6106E+10
Sr-89	1.9563E-01	6.7339E-09	4.5564E+16	7.2385E+09
I-131	7.5421E+02	6.0836E-06	2.7967E+19	2.7906E+13
I-132	8.4773E-01	8.2127E-11	3.7468E+14	3.1366E+10
I-133	7.2188E+02	6.3725E-07	2.8854E+18	2.6710E+13
I-134	1.0102E-05	3.7868E-16	1.7019E+09	3.7378E+05
I-135	1.2168E+02	3.4648E-08	1.5456E+17	4.5021E+12
Xe-133	4.1898E+03	2.2384E-05	1.0135E+20	1.5502E+14
Xe-135	9.2785E+02	3.6333E-07	1.6208E+18	3.4330E+13
Cs-134	2.8006E+02	2.1646E-04	9.7280E+20	1.0362E+13
Cs-136	7.6653E+01	1.0459E-06	4.6312E+18	2.8362E+12
Cs-137	1.5136E+02	1.7401E-03	7.6492E+21	5.6003E+12
I-130	1.0704E+01	5.4884E-09	2.5425E+16	3.9606E+11
Kr-83m	6.5581E-01	3.1786E-11	2.3063E+14	2.4265E+10
Xe-131m	2.4857E+01	2.9676E-07	1.3642E+18	9.1971E+11
Xe-133m	1.2094E+02	2.6953E-07	1.2204E+18	4.4748E+12
Xe-135m	2.0807E+01	2.2841E-10	1.0189E+15	7.6985E+11
Cs-134m	2.1844E-01	2.7087E-11	1.2173E+14	8.0822E+09
Rb-88	5.2228E+00	4.3510E-11	2.9775E+14	1.9324E+11
Ba-137m	1.6779E+02	3.1199E-10	1.3714E+15	6.2081E+12
Br-82	3.6224E+00	3.3459E-09	2.4572E+16	1.3403E+11
Br-83	9.4864E-02	6.0049E-12	4.3569E+13	3.5100E+09

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Environment Transport Group Inventory:

	Present	Release	Integral
Time (h) = 24.0000	Release	Rate/s	Release
Noble gases (atoms)	5.6886E+17	7.9009E+15	6.8067E+20
Elemental I (atoms)	9.8701E+01	1.3708E+00	1.3302E+17
Organic I (atoms)	1.0690E+14	1.4847E+12	1.2833E+17
Aerosols (kg)	3.9217E-07	5.4468E-09	1.9644E-03

## Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	8.4309E-04	1.0362E-11	7.2556E+13	3.1194E+07
Sr-89	6.3499E-05	2.1857E-12	1.4789E+13	2.3495E+06
I-131	2.4501E-01	1.9763E-09	9.0850E+15	9.0653E+09
I-132	2.7538E-04	2.6679E-14	1.2172E+11	1.0189E+07
I-133	2.3450E-01	2.0701E-10	9.3733E+14	8.6766E+09
I-134	3.2817E-09	1.2302E-19	5.5285E+05	1.2142E+02
I-135	3.9528E-02	1.1255E-11	5.0209E+13	1.4625E+09
Cs-134	9.0903E-02	7.0259E-08	3.1575E+17	3.3634E+09
Cs-136	2.4880E-02	3.3947E-10	1.5032E+15	9.2056E+08
Cs-137	4.9129E-02	5.6482E-07	2.4828E+18	1.8178E+09
I-130	3.4773E-03	1.7829E-12	8.2592E+12	1.2866E+08
Cs-134m	7.0901E-05	8.7919E-15	3.9512E+10	2.6233E+06
Rb-88	1.5863E-05	1.3215E-16	9.0435E+08	5.8694E+05
Ba-137m	5.4461E-02	1.0127E-13	4.4513E+11	2.0150E+09
Br-82	1.1767E-03	1.0869E-12	7.9823E+12	4.3539E+07
Br-83	3.0817E-05	1.9507E-15	1.4153E+10	1.1402E+06

## Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	6.1077E+13
Organic I (atoms)	3.2128E+13
Aerosols (kg)	6.3761E-07

## Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Kr-85	1.0279E-04	2.6200E-10	1.8562E+15	3.8032E+06
Kr-85m	4.6437E-05	5.6427E-15	3.9978E+10	1.7182E+06
Kr-87	7.6447E-09	2.6989E-19	1.8681E+06	2.8285E+02
Kr-88	1.4762E-05	1.1773E-15	8.0564E+09	5.4619E+05

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Rb-86	1.1866E-07	1.4583E-15	1.0212E+10	4.3904E+03
Sr-89	8.9372E-09	3.0763E-16	2.0815E+09	3.3068E+02
I-131	3.4747E-05	2.8027E-13	1.2884E+12	1.2856E+06
I-132	3.9055E-08	3.7836E-18	1.7262E+07	1.4450E+03
I-133	3.3257E-05	2.9358E-14	1.3293E+11	1.2305E+06
I-135	5.6058E-06	1.5963E-15	7.1206E+09	2.0742E+05
Xe-133	1.4351E-02	7.6670E-11	3.4716E+14	5.3100E+08
Xe-135	4.8888E-03	1.9144E-12	8.5398E+12	1.8089E+08
Cs-134	1.2794E-05	9.8886E-12	4.4441E+13	4.7338E+05
Cs-136	3.5017E-06	4.7779E-14	2.1157E+11	1.2956E+05
Cs-137	6.9146E-06	7.9495E-11	3.4944E+14	2.5584E+05
I-130	4.9315E-07	2.5285E-16	1.1713E+09	1.8247E+04
Kr-83m	8.4000E-06	4.0713E-16	2.9540E+09	3.1080E+05
Xe-131m	8.4322E-05	1.0067E-12	4.6278E+12	3.1199E+06
Xe-133m	4.4846E-04	9.9946E-13	4.5255E+12	1.6593E+07
Xe-135m	3.8493E-03	4.2257E-14	1.8850E+11	1.4242E+08
Cs-134m	9.9790E-09	1.2374E-18	5.5611E+06	3.6922E+02
Rb-88	6.0641E-06	5.0518E-17	3.4571E+08	2.2437E+05
Ba-137m	7.6651E-06	1.4253E-17	6.2650E+07	2.8361E+05
Br-82	1.6688E-07	1.5415E-16	1.1321E+09	6.1747E+03
Br-83	4.3704E-09	2.7665E-19	2.0072E+06	1.6171E+02

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 24.0000			
Noble gases (atoms)	2.2213E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.0157E-02	0.0000E+00	0.0000E+00
Organic I (atoms)	2.3967E+10	0.0000E+00	0.0000E+00
Aerosols (kg)	8.9740E-11	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

	Ci	kg	Atoms	Bq
Time (h) = 24.0000				
Rb-86	6.7663E-05	8.3157E-13	5.8231E+12	2.5035E+06
Sr-89	5.0962E-06	1.7542E-13	1.1869E+12	1.8856E+05
I-131	1.9780E-02	1.5955E-10	7.3346E+14	7.3187E+08
I-132	2.2233E-05	2.1539E-15	9.8265E+09	8.2261E+05
I-133	1.8932E-02	1.6713E-11	7.5674E+13	7.0049E+08
I-135	3.1912E-03	9.0869E-13	4.0535E+12	1.1807E+08
Cs-134	7.2955E-03	5.6387E-09	2.5341E+16	2.6994E+08
Cs-136	1.9968E-03	2.7245E-11	1.2064E+14	7.3881E+07
Cs-137	3.9429E-03	4.5330E-08	1.9926E+17	1.4589E+08
I-130	2.8073E-04	1.4394E-13	6.6679E+11	1.0387E+07
Cs-134m	5.6903E-06	7.0561E-16	3.1711E+09	2.1054E+05
Rb-88	6.3810E-06	5.3158E-17	3.6378E+08	2.3610E+05
Ba-137m	4.3708E-03	8.1272E-15	3.5725E+10	1.6172E+08
Br-82	9.5001E-05	8.7750E-14	6.4444E+11	3.5150E+06
Br-83	2.4879E-06	1.5749E-16	1.1427E+09	9.2054E+04

Deposition Recirculating

	Surfaces	Filter
Time (h) = 24.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	9.9612E+12
Organic I (atoms)	0.0000E+00	2.3333E+12
Aerosols (kg)	0.0000E+00	5.1172E-08

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 24.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

	Ci	kg	Atoms	Bq
Time (h) = 24.0000				
Rb-86	8.4309E-04	1.0362E-11	7.2556E+13	3.1194E+07
Sr-89	6.3499E-05	2.1857E-12	1.4789E+13	2.3495E+06
I-131	2.4501E-01	1.9763E-09	9.0850E+15	9.0653E+09
I-132	2.7538E-04	2.6679E-14	1.2172E+11	1.0189E+07

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-133	2.3450E-01	2.0701E-10	9.3733E+14	8.6766E+09
I-134	3.2817E-09	1.2302E-19	5.5285E+05	1.2142E+02
I-135	3.9528E-02	1.1255E-11	5.0209E+13	1.4625E+09
Cs-134	9.0903E-02	7.0259E-08	3.1575E+17	3.3634E+09
Cs-136	2.4880E-02	3.3947E-10	1.5032E+15	9.2056E+08
Cs-137	4.9129E-02	5.6482E-07	2.4828E+18	1.8178E+09
I-130	3.4773E-03	1.7829E-12	8.2592E+12	1.2866E+08
Cs-134m	7.0901E-05	8.7919E-15	3.9512E+10	2.6233E+06
Rb-88	1.5863E-05	1.3215E-16	9.0435E+08	5.8694E+05
Ba-137m	5.4461E-02	1.0127E-13	4.4513E+11	2.0150E+09
Br-82	1.1767E-03	1.0869E-12	7.9823E+12	4.3539E+07
Br-83	3.0817E-05	1.9507E-15	1.4153E+10	1.1402E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	6.1077E+13
Organic I (atoms)	3.2128E+13
Aerosols (kg)	6.3761E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	9.1075E-04	1.1193E-11	7.8379E+13	3.3698E+07
Sr-89	6.8595E-05	2.3611E-12	1.5976E+13	2.5380E+06
I-131	2.6479E-01	2.1358E-09	9.8185E+15	9.7971E+09
I-132	2.9762E-04	2.8833E-14	1.3154E+11	1.1012E+07
I-133	2.5344E-01	2.2372E-10	1.0130E+15	9.3771E+09
I-134	3.5466E-09	1.3295E-19	5.9748E+05	1.3122E+02
I-135	4.2719E-02	1.2164E-11	5.4262E+13	1.5806E+09
Cs-134	9.8199E-02	7.5898E-08	3.4109E+17	3.6334E+09
Cs-136	2.6877E-02	3.6671E-10	1.6238E+15	9.9444E+08
Cs-137	5.3072E-02	6.1015E-07	2.6820E+18	1.9637E+09
I-130	3.7580E-03	1.9269E-12	8.9260E+12	1.3905E+08
Cs-134m	7.6591E-05	9.4975E-15	4.2683E+10	2.8339E+06
Rb-88	2.2244E-05	1.8531E-16	1.2681E+09	8.2303E+05
Ba-137m	5.8831E-02	1.0939E-13	4.8086E+11	2.1768E+09
Br-82	1.2717E-03	1.1747E-12	8.6268E+12	4.7054E+07
Br-83	3.3305E-05	2.1082E-15	1.5296E+10	1.2323E+06

Detailed model information at time (H) = 96.0000

EAB Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.4195E-02	6.1200E+00	9.4469E-02	3.3225E-01
Accumulated dose (rem)	6.8621E-01	1.8288E+02	1.2499E+00	9.2374E+00

LPZ Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.5004E-04	9.8443E-02	1.5196E-03	5.3444E-03
Accumulated dose (rem)	5.3102E-02	1.2459E+01	9.3044E-02	6.3166E-01

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Control Room Doses:

Time (h) =	96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		3.9009E-04	1.3461E-01	3.0926E-02	6.9530E-03
Accumulated dose (rem)		8.3857E-03	1.6655E+01	5.5267E-01	7.8354E-01

## Containment Compartment Atmosphere Nuclide Inventory:

Time (h) =	96.0000	Ci	kg	Atoms	Bq
Kr-85		3.1767E+04	8.0968E-02	5.7365E+23	1.1754E+15
Kr-85m		2.0851E-01	2.5337E-11	1.7951E+14	7.7149E+09
Kr-88		1.0657E-04	8.4992E-15	5.8163E+10	3.9432E+06
Rb-86		4.1461E-01	5.0956E-09	3.5682E+16	1.5341E+10
Sr-89		3.3501E-02	1.1531E-09	7.8025E+15	1.2395E+09
I-131		2.5051E+03	2.0207E-05	9.2890E+19	9.2689E+13
I-132		1.3752E-09	1.3323E-19	6.0781E+05	5.0882E+01
I-133		2.8190E+02	2.4885E-07	1.1268E+18	1.0430E+13
I-135		2.7534E-01	7.8404E-11	3.4975E+14	1.0188E+10
Xe-133		3.1171E+06	1.6653E-02	7.5403E+22	1.1533E+17
Xe-135		7.8395E+03	3.0698E-06	1.3694E+19	2.9006E+14
Cs-134		4.9837E+01	3.8519E-05	1.7311E+20	1.8440E+12
Cs-136		1.1670E+01	1.5923E-07	7.0509E+17	4.3180E+11
Cs-137		2.7004E+01	3.1045E-04	1.3647E+21	9.9913E+11
I-130		8.1215E-01	4.1642E-10	1.9290E+15	3.0050E+10
Kr-83m		9.5576E-07	4.6324E-17	3.3611E+08	3.5363E+04
Xe-131m		2.4361E+04	2.9084E-04	1.3370E+21	9.0137E+14
Xe-133m		5.9893E+04	1.3348E-04	6.0439E+20	2.2160E+15
Xe-135m		2.9028E+01	3.1867E-10	1.4215E+15	1.0740E+12
Cs-134m		1.3091E-09	1.6233E-19	7.2954E+05	4.8437E+01
Rb-88		1.1637E-04	9.6943E-16	6.6341E+09	4.3056E+06
Ba-137m		2.9934E+01	5.5660E-11	2.4467E+14	1.1076E+12
Br-82		3.7901E+00	3.5008E-09	2.5710E+16	1.4023E+11
Br-83		3.4839E-10	2.2053E-20	1.6001E+05	1.2891E+01

## Containment Transport Group Inventory:

Time (h) =	96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		6.5101E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.8400E-33	0.0000E+00	0.0000E+00
Organic I (atoms)		9.0177E+19	0.0000E+00	0.0000E+00
Aerosols (kg)		3.4998E-04	0.0000E+00	0.0000E+00

Time (h) =	96.0000	Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		2.9231E+21	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		5.1778E+00	0.0000E+00

## Environment Integral Nuclide Release:

Time (h) =	96.0000	Ci	kg	Atoms	Bq
Kr-85		7.9516E+01	2.0267E-04	1.4359E+21	2.9421E+12
Kr-85m		5.2193E-04	6.3422E-14	4.4933E+11	1.9311E+07
Rb-86		2.4393E+00	2.9979E-08	2.0993E+17	9.0254E+10
Sr-89		1.9709E-01	6.7841E-09	4.5905E+16	7.2925E+09
I-131		6.1470E+02	4.9583E-06	2.2793E+19	2.2744E+13
I-133		6.9172E+01	6.1063E-08	2.7649E+17	2.5594E+12
I-135		6.7564E-02	1.9239E-11	8.5821E+13	2.4999E+09
Xe-133		7.4917E+03	4.0024E-05	1.8122E+20	2.7719E+14
Xe-135		1.5172E+01	5.9413E-09	2.6503E+16	5.6138E+11
Cs-134		2.9320E+02	2.2662E-04	1.0184E+21	1.0849E+13
Cs-136		6.8660E+01	9.3681E-07	4.1482E+18	2.5404E+12
Cs-137		1.5887E+02	1.8265E-03	8.0287E+21	5.8782E+12
I-130		1.9929E-01	1.0218E-10	4.7334E+14	7.3736E+09
Xe-131m		5.6270E+01	6.7180E-07	3.0883E+18	2.0820E+12
Xe-133m		1.3445E+02	2.9964E-07	1.3568E+18	4.9747E+12
Xe-135m		1.1346E-02	1.2455E-13	5.5561E+11	4.1980E+08
Ba-137m		1.7611E+02	3.2747E-10	1.4395E+15	6.5161E+12
Br-82		9.3001E-01	8.5902E-10	6.3087E+15	3.4410E+10

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Environment Transport Group Inventory:

	Present Release	Release Rate/s	Integral Release
Time (h) = 96.0000			
Noble gases (atoms)	2.7125E+17	3.7674E+15	1.6216E+21
Elemental I (atoms)	7.7663E-40	1.0786E-41	9.3634E+16
Organic I (atoms)	3.7569E+13	5.2179E+11	2.2568E+17
Aerosols (kg)	1.4595E-10	2.0271E-12	2.0590E-03

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 96.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	7.6771E-04	9.4352E-12	6.6070E+13	2.8405E+07
Sr-89	6.2031E-05	2.1352E-12	1.4447E+13	2.2951E+06
I-131	1.9296E-01	1.5564E-09	7.1549E+15	7.1393E+09
I-133	2.1713E-02	1.9168E-11	8.6790E+13	8.0339E+08
I-135	2.1208E-05	6.0391E-15	2.6939E+10	7.8471E+05
Cs-134	9.2279E-02	7.1323E-08	3.2053E+17	3.4143E+09
Cs-136	2.1609E-02	2.9484E-10	1.3056E+15	7.9954E+08
Cs-137	5.0001E-02	5.7484E-07	2.5268E+18	1.8500E+09
I-130	6.2556E-05	3.2075E-14	1.4858E+11	2.3146E+06
Ba-137m	5.5427E-02	1.0306E-13	4.5303E+11	2.0508E+09
Br-82	2.9193E-04	2.6965E-13	1.9803E+12	1.0801E+07

Control Room Filtered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 96.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.2993E+13
Organic I (atoms)	3.8441E+13
Aerosols (kg)	6.4803E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway Filter
Time (h) = 96.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway Filter
Time (h) = 96.0000	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Kr-85	3.7110E-05	9.4588E-11	6.7014E+14	1.3731E+06
Kr-85m	2.4358E-10	2.9599E-20	2.0970E+05	9.0126E+00
Rb-86	3.0741E-11	3.7780E-19	2.6455E+06	1.1374E+00
Sr-89	2.4838E-12	8.5496E-20	5.7850E+05	9.1902E-02
I-131	1.8196E-07	1.4677E-15	6.7471E+09	6.7325E+03
I-133	2.0476E-08	1.8075E-17	8.1843E+07	7.5760E+02
Xe-133	3.6956E-03	1.9743E-11	8.9397E+13	1.3674E+08
Xe-135	9.8592E-06	3.8607E-15	1.7222E+10	3.6479E+05
Cs-134	3.6950E-09	2.8559E-15	1.2835E+10	1.3672E+02
Cs-136	8.6527E-10	1.1806E-17	5.2277E+07	3.2015E+01



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-137	2.0021E-09	2.3018E-14	1.0118E+11	7.4079E+01
I-130	5.8991E-11	3.0246E-20	1.4011E+05	2.1827E+00
Xe-131m	3.0857E-05	3.6840E-13	1.6935E+12	1.1417E+06
Xe-133m	7.3834E-05	1.6455E-13	7.4506E+11	2.7318E+06
Xe-135m	2.0381E-06	2.2374E-17	9.9807E+07	7.5410E+04
Br-82	2.7529E-10	2.5428E-19	1.8674E+06	1.0186E+01

## Control Room Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	7.6199E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.8497E-43	0.0000E+00	0.0000E+00
Organic I (atoms)	6.5442E+09	0.0000E+00	0.0000E+00
Aerosols (kg)	2.5948E-14	0.0000E+00	0.0000E+00

## Recirculating Filter Inventory

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	6.1523E-05	7.5611E-13	5.2947E+12	2.2763E+06
Sr-89	4.9710E-06	1.7111E-13	1.1578E+12	1.8393E+05
I-131	1.5549E-02	1.2542E-10	5.7657E+14	5.7532E+08
I-133	1.7498E-03	1.5446E-12	6.9939E+12	6.4741E+07
I-135	1.7091E-06	4.8666E-16	2.1709E+09	6.3235E+04
Cs-134	7.3950E-03	5.7156E-09	2.5687E+16	2.7362E+08
Cs-136	1.7317E-03	2.3628E-11	1.0463E+14	6.4073E+07
Cs-137	4.0070E-03	4.6067E-08	2.0250E+17	1.4826E+08
I-130	5.0411E-06	2.5847E-15	1.1973E+10	1.8652E+05
Ba-137m	4.4418E-03	8.2592E-15	3.6305E+10	1.6435E+08
Br-82	2.3525E-05	2.1729E-14	1.5958E+11	8.7043E+05

Time (h) = 96.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	7.0118E+12
Organic I (atoms)	0.0000E+00	2.7497E+12
Aerosols (kg)	0.0000E+00	5.1932E-08

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	7.6771E-04	9.4352E-12	6.6070E+13	2.8405E+07
Sr-89	6.2031E-05	2.1352E-12	1.4447E+13	2.2951E+06
I-131	1.9296E-01	1.5564E-09	7.1549E+15	7.1393E+09
I-133	2.1713E-02	1.9168E-11	8.6790E+13	8.0339E+08
I-135	2.1208E-05	6.0391E-15	2.6939E+10	7.8471E+05
Cs-134	9.2279E-02	7.1323E-08	3.2053E+17	3.4143E+09
Cs-136	2.1609E-02	2.9484E-10	1.3056E+15	7.9954E+08
Cs-137	5.0001E-02	5.7484E-07	2.5268E+18	1.8500E+09
I-130	6.2556E-05	3.2075E-14	1.4858E+11	2.3146E+06
Ba-137m	5.5427E-02	1.0306E-13	4.5303E+11	2.0508E+09
Br-82	2.9193E-04	2.6965E-13	1.9803E+12	1.0801E+07

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.2993E+13
Organic I (atoms)	3.8441E+13
Aerosols (kg)	6.4803E-07

## Control Room Unfiltered Inleakage Transport Group Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	8.2924E-04	1.0191E-11	7.1364E+13	3.0682E+07
Sr-89	6.7002E-05	2.3063E-12	1.5605E+13	2.4791E+06
I-131	2.0850E-01	1.6818E-09	7.7315E+15	7.7147E+09
I-133	2.3463E-02	2.0712E-11	9.3784E+13	8.6813E+08
I-135	2.2917E-05	6.5257E-15	2.9110E+10	8.4795E+05
Cs-134	9.9674E-02	7.7038E-08	3.4622E+17	3.6879E+09
Cs-136	2.3341E-02	3.1847E-10	1.4102E+15	8.6361E+08
Cs-137	5.4008E-02	6.2091E-07	2.7293E+18	1.9983E+09
I-130	6.7597E-05	3.4659E-14	1.6056E+11	2.5011E+06
Ba-137m	5.9869E-02	1.1132E-13	4.8934E+11	2.2152E+09
Br-82	3.1546E-04	2.9138E-13	2.1399E+12	1.1672E+07

Detailed model information at time (H) = 720.0000

EAB Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.7055E-02	1.6670E+00	1.3051E-01	8.7899E-02
Accumulated dose (rem)	7.2327E-01	1.8455E+02	1.3804E+00	9.3253E+00

LPZ Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.7462E-04	7.8559E-03	6.1501E-04	4.1422E-04
Accumulated dose (rem)	5.3277E-02	1.2467E+01	9.3659E-02	6.3208E-01

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.1829E-04	1.7838E-02	1.4197E-02	6.6235E-04
Accumulated dose (rem)	8.5040E-03	1.6672E+01	5.6687E-01	7.8420E-01

Containment Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Kr-85	3.1212E+04	7.9556E-02	5.6364E+23	1.1549E+15
I-131	2.5203E+02	2.0329E-06	9.3455E+18	9.3252E+12
I-133	2.4849E-07	2.1936E-16	9.9323E+08	9.1941E+03
Xe-133	1.0156E+05	5.4260E-04	2.4568E+21	3.7579E+15
Xe-131m	9.4743E+03	1.1311E-04	5.1998E+20	3.5055E+14
Xe-133m	1.6552E+01	3.6887E-08	1.6702E+17	6.1241E+11
Br-82	1.7117E-05	1.5811E-14	1.1612E+11	6.3334E+05

Containment Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 720.0000			
Noble gases (atoms)	5.6662E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	9.3455E+18	0.0000E+00	0.0000E+00
Aerosols (kg)	2.7262E-31	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 720.0000		

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.0690E+20	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	5.1442E+00	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Kr-85	4.8756E+02	1.2427E-03	8.8045E+21	1.8040E+13
I-131	6.8640E+01	5.5366E-07	2.5452E+18	2.5397E+12
Xe-133	1.5728E+03	8.4024E-06	3.8046E+19	5.8193E+13
Xe-131m	1.1378E+02	1.3584E-06	6.2448E+18	4.2100E+12
Xe-133m	2.5158E-01	5.6068E-10	2.5387E+15	9.3085E+09

Environment Transport Group Inventory:

Time (h) = 720.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	2.3609E+17	3.2790E+15	8.8488E+21
Elemental I (atoms)	0.0000E+00	0.0000E+00	9.8307E+15
Organic I (atoms)	3.8936E+12	5.4078E+10	1.4597E+17
Aerosols (kg)	1.1369E-37	1.5791E-39	2.0456E-03

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	2.9226E-04	3.5918E-12	2.5152E+13	1.0813E+07
Sr-89	4.3414E-05	1.4943E-12	1.0111E+13	1.6063E+06
I-131	2.0794E-02	1.6773E-10	7.7105E+14	7.6937E+08
Cs-134	9.0098E-02	6.9637E-08	3.1296E+17	3.3336E+09
Cs-136	5.4598E-03	7.4495E-11	3.2987E+14	2.0201E+08
Cs-137	4.9919E-02	5.7390E-07	2.5227E+18	1.8470E+09
Ba-137m	5.5337E-02	1.0289E-13	4.5229E+11	2.0475E+09
Br-82	1.4123E-09	1.3045E-18	9.5801E+06	5.2254E+01

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.5139E+12
Organic I (atoms)	1.4536E+13
Aerosols (kg)	6.4378E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Kr-85	2.6932E-05	6.8646E-11	4.8635E+14	9.9649E+05
I-131	1.4052E-08	1.1335E-16	5.2105E+08	5.1992E+02
Xe-133	8.7637E-05	4.6819E-13	2.1199E+12	3.2426E+06
Xe-131m	8.4341E-06	1.0069E-13	4.6289E+11	3.1206E+05
Xe-133m	1.4282E-08	3.1829E-17	1.4412E+08	5.2843E+02

Control Room Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	4.8893E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	5.2105E+08	0.0000E+00	0.0000E+00
Aerosols (kg)	1.5529E-41	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	2.3421E-05	2.8784E-13	2.0156E+12	8.6656E+05
Sr-89	3.4791E-06	1.1975E-13	8.1030E+11	1.2873E+05
I-131	1.6735E-03	1.3499E-11	6.2053E+13	6.1919E+07
Cs-134	7.2203E-03	5.5805E-09	2.5080E+16	2.6715E+08
Cs-136	4.3754E-04	5.9699E-12	2.6435E+13	1.6189E+07
Cs-137	4.0004E-03	4.5991E-08	2.0216E+17	1.4802E+08
Ba-137m	4.4346E-03	8.2457E-15	3.6246E+10	1.6408E+08
Br-82	1.1366E-10	1.0498E-19	7.7100E+05	4.2053E+00

Deposition Recirculating

Time (h) = 720.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	7.3618E+11
Organic I (atoms)	0.0000E+00	1.0537E+12
Aerosols (kg)	0.0000E+00	5.1591E-08

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	2.9226E-04	3.5918E-12	2.5152E+13	1.0813E+07
Sr-89	4.3414E-05	1.4943E-12	1.0111E+13	1.6063E+06
I-131	2.0794E-02	1.6773E-10	7.7105E+14	7.6937E+08
Cs-134	9.0098E-02	6.9637E-08	3.1296E+17	3.3336E+09
Cs-136	5.4598E-03	7.4495E-11	3.2987E+14	2.0201E+08
Cs-137	4.9919E-02	5.7390E-07	2.5227E+18	1.8470E+09
Ba-137m	5.5337E-02	1.0289E-13	4.5229E+11	2.0475E+09
Br-82	1.4123E-09	1.3045E-18	9.5801E+06	5.2254E+01

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	4.5139E+12
Organic I (atoms)	1.4536E+13
Aerosols (kg)	6.4378E-07

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	3.1568E-04	3.8796E-12	2.7167E+13	1.1680E+07
Sr-89	4.6893E-05	1.6141E-12	1.0922E+13	1.7350E+06
I-131	2.2467E-02	1.8123E-10	8.3310E+14	8.3129E+08
Cs-134	9.7318E-02	7.5217E-08	3.3804E+17	3.6008E+09
Cs-136	5.8973E-03	8.0465E-11	3.5630E+14	2.1820E+08
Cs-137	5.3920E-02	6.1990E-07	2.7249E+18	1.9950E+09
Ba-137m	5.9771E-02	1.1114E-13	4.8854E+11	2.2115E+09
Br-82	1.5259E-09	1.4094E-18	1.0351E+07	5.6459E+01

-----  
 Transport Group Totals in Model:  
 -----

Noble Gases (atoms)	5.7547E+23
Elemental I (atoms)	3.0691E+20
Organic I (atoms)	9.4915E+18
Aerosols (kg)	5.1463E+00

-----

37002

#####  
 I-131 Summary  
 #####

Time (hr)	Containment	Environment	Control Room
	I-131 (Curies)	I-131 (Curies)	I-131 (Curies)
0.000	2.2440E+04	4.6629E-07	1.2122E-09
0.000	2.2440E+06	4.6624E-03	1.2122E-05
0.025	2.2574E+06	2.3452E+00	6.0481E-03
0.300	2.1650E+06	2.7643E+01	2.6736E-03
0.560	2.0881E+06	5.0624E+01	1.7401E-03
0.820	2.0189E+06	7.2795E+01	1.4338E-03
1.080	1.9554E+06	9.4229E+01	1.3144E-03
1.340	1.8965E+06	1.1498E+02	1.2520E-03
1.600	1.8412E+06	1.3510E+02	1.2081E-03
1.860	1.7888E+06	1.5461E+02	1.1711E-03
2.000	1.7616E+06	1.6488E+02	1.1526E-03
2.260	1.7127E+06	1.8353E+02	9.4879E-04
2.520	1.6657E+06	2.0164E+02	8.7223E-04
2.780	1.6205E+06	2.1923E+02	8.3358E-04
3.040	1.5767E+06	2.3633E+02	8.0661E-04
3.300	1.5343E+06	2.5294E+02	7.8356E-04
3.560	1.4932E+06	2.6909E+02	7.6213E-04
3.820	1.4534E+06	2.8478E+02	7.4161E-04
4.080	1.4146E+06	3.0004E+02	7.2177E-04
4.340	1.3769E+06	3.1486E+02	7.0252E-04
4.600	1.3403E+06	3.2927E+02	6.8382E-04
4.860	1.3047E+06	3.4328E+02	6.6563E-04
5.120	1.2701E+06	3.5689E+02	6.4794E-04
5.380	1.2363E+06	3.7012E+02	6.3073E-04
5.640	1.2035E+06	3.8298E+02	6.1399E-04
5.900	1.1716E+06	3.9548E+02	5.9770E-04
6.160	1.1405E+06	4.0762E+02	5.8184E-04
6.420	1.1103E+06	4.1942E+02	5.6641E-04
6.680	1.0808E+06	4.3088E+02	5.5139E-04
6.940	1.0522E+06	4.4202E+02	5.3677E-04
7.200	1.0243E+06	4.5285E+02	5.2254E-04
7.460	9.9715E+05	4.6336E+02	5.0869E-04
7.720	9.7072E+05	4.7358E+02	4.9521E-04
7.980	9.4500E+05	4.8351E+02	4.8208E-04

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

8.000	9.4305E+05	4.8426E+02	4.8109E-04
8.260	9.1806E+05	4.9388E+02	2.6349E-04
8.520	8.9374E+05	5.0323E+02	1.9644E-04
8.780	8.7006E+05	5.1230E+02	1.7363E-04
9.040	8.4702E+05	5.2112E+02	1.6387E-04
9.300	8.2458E+05	5.2968E+02	1.5801E-04
9.560	8.0275E+05	5.3799E+02	1.5338E-04
9.820	7.8149E+05	5.4607E+02	1.4919E-04
10.080	7.6080E+05	5.5391E+02	1.4520E-04
24.000	1.8213E+05	7.5421E+02	3.4747E-05
96.000	2.5051E+03	6.1470E+02	1.8196E-07
720.000	2.5203E+02	6.8640E+01	1.4052E-08

#####  
 Cumulative Dose Summary  
 #####

Time (hr)	EAB		LPZ		Control Room	
	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)
0.000	1.3402E-07	7.3417E-09	1.6560E-08	9.0716E-10	1.1438E-12	5.2383E-14
0.000	1.3402E-03	7.3416E-05	1.6559E-04	9.0715E-06	7.6254E-07	3.4923E-08
0.025	6.7406E-01	3.6915E-02	8.3288E-02	4.5613E-03	1.4264E-01	6.5333E-03
0.300	7.9352E+00	4.2916E-01	9.8050E-01	5.3028E-02	2.2220E+00	1.0189E-01
0.560	1.4516E+01	7.7709E-01	1.7936E+00	9.6018E-02	3.2562E+00	1.4956E-01
0.820	2.0850E+01	1.1067E+00	2.5763E+00	1.3674E-01	4.0155E+00	1.8475E-01
1.080	2.6961E+01	1.4207E+00	3.3314E+00	1.7554E-01	4.6780E+00	2.1555E-01
1.340	3.2866E+01	1.7212E+00	4.0610E+00	2.1267E-01	5.2972E+00	2.4438E-01
1.600	3.8578E+01	2.0097E+00	4.7668E+00	2.4832E-01	5.8896E+00	2.7201E-01
1.860	4.4109E+01	2.2874E+00	5.4502E+00	2.8264E-01	6.4611E+00	2.9868E-01
2.000	4.7016E+01	2.4328E+00	5.8094E+00	3.0060E-01	6.7610E+00	3.1269E-01
2.260	5.2287E+01	2.6956E+00	6.1057E+00	3.1537E-01	7.2552E+00	3.3581E-01
2.520	5.7398E+01	2.9496E+00	6.3930E+00	3.2965E-01	7.6871E+00	3.5603E-01
2.780	6.2356E+01	3.1953E+00	6.6717E+00	3.4346E-01	8.0921E+00	3.7502E-01
3.040	6.7167E+01	3.4332E+00	6.9422E+00	3.5684E-01	8.4809E+00	3.9326E-01
3.300	7.1835E+01	3.6636E+00	7.2046E+00	3.6979E-01	8.8570E+00	4.1091E-01
3.560	7.6366E+01	3.8869E+00	7.4593E+00	3.8234E-01	9.2217E+00	4.2804E-01
3.820	8.0765E+01	4.1034E+00	7.7066E+00	3.9452E-01	9.5756E+00	4.4467E-01
4.080	8.5035E+01	4.3134E+00	7.9466E+00	4.0632E-01	9.9191E+00	4.6083E-01
4.340	8.9181E+01	4.5171E+00	8.1797E+00	4.1777E-01	1.0253E+01	4.7652E-01
4.600	9.3207E+01	4.7148E+00	8.4060E+00	4.2888E-01	1.0576E+01	4.9177E-01
4.860	9.7116E+01	4.9067E+00	8.6258E+00	4.3967E-01	1.0891E+01	5.0659E-01
5.120	1.0091E+02	5.0929E+00	8.8392E+00	4.5014E-01	1.1196E+01	5.2100E-01
5.380	1.0460E+02	5.2737E+00	9.0464E+00	4.6030E-01	1.1493E+01	5.3499E-01
5.640	1.0818E+02	5.4493E+00	9.2477E+00	4.7017E-01	1.1781E+01	5.4860E-01
5.900	1.1166E+02	5.6198E+00	9.4432E+00	4.7976E-01	1.2060E+01	5.6182E-01
6.160	1.1503E+02	5.7853E+00	9.6331E+00	4.8906E-01	1.2332E+01	5.7467E-01
6.420	1.1832E+02	5.9461E+00	9.8175E+00	4.9810E-01	1.2596E+01	5.8716E-01
6.680	1.2150E+02	6.1024E+00	9.9966E+00	5.0689E-01	1.2852E+01	5.9931E-01
6.940	1.2460E+02	6.2541E+00	1.0171E+01	5.1542E-01	1.3101E+01	6.1111E-01
7.200	1.2760E+02	6.4015E+00	1.0340E+01	5.2370E-01	1.3343E+01	6.2259E-01
7.460	1.3052E+02	6.5447E+00	1.0504E+01	5.3175E-01	1.3578E+01	6.3374E-01
7.720	1.3336E+02	6.6839E+00	1.0663E+01	5.3958E-01	1.3806E+01	6.4459E-01
7.980	1.3612E+02	6.8191E+00	1.0818E+01	5.4718E-01	1.4028E+01	6.5514E-01
8.000	1.3633E+02	6.8294E+00	1.0830E+01	5.4776E-01	1.4044E+01	6.5593E-01
8.260	1.3770E+02	6.8994E+00	1.0882E+01	5.5041E-01	1.4203E+01	6.6352E-01
8.520	1.3904E+02	6.9675E+00	1.0933E+01	5.5298E-01	1.4304E+01	6.6837E-01
8.780	1.4033E+02	7.0335E+00	1.0982E+01	5.5548E-01	1.4387E+01	6.7234E-01
9.040	1.4159E+02	7.0978E+00	1.1029E+01	5.5791E-01	1.4463E+01	6.7598E-01
9.300	1.4282E+02	7.1601E+00	1.1076E+01	5.6027E-01	1.4535E+01	6.7945E-01
9.560	1.4401E+02	7.2208E+00	1.1121E+01	5.6257E-01	1.4605E+01	6.8281E-01
9.820	1.4516E+02	7.2797E+00	1.1165E+01	5.6480E-01	1.4672E+01	6.8607E-01
10.080	1.4629E+02	7.3369E+00	1.1207E+01	5.6696E-01	1.4738E+01	6.8924E-01
24.000	1.7676E+02	8.9052E+00	1.2360E+01	6.2632E-01	1.6520E+01	7.7659E-01
96.000	1.8288E+02	9.2374E+00	1.2459E+01	6.3166E-01	1.6655E+01	7.8354E-01
720.000	1.8455E+02	9.3253E+00	1.2467E+01	6.3208E-01	1.6672E+01	7.8420E-01

#####  
 Worst Two-Hour Dose  
 (Provided for Dose Location 1)  
 #####

EAB

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (hr)	Whole Body (rem)	Thyroid (rem)	Skin (rem)	TEDE (rem)
0.0	2.7444E-01	4.7016E+01	4.6854E-01	2.4328E+00

#####  
30 Day Control Room Skin Dose  
#####

Control Room

Time (hr)	Skin (rem)
720.0	5.6687E-01

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Attachment 9 Containment Release FCM Dose

```
#####
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:23:21
#####
#####
File information
#####
```

```
Plant file name      = AST/CRE/pal_CRE_FCM_cont_db_ast.psf
Inventory file name  = AST/CRE/palisades_loca_db_ast.nif
Scenario file name   = AST/CRE/pal_CRE_FCM_cont_db_ast.psf
Release file name    = AST/CRE/pal_cre_fcm_cont_ast.rft
Dose conversion file name = AST/CRE/nai-1101-001rev0.dcf
```

```
#####  #####  #####  # # # ##### # # #####
# # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # #
#####  #####  #####  # # # # # ##### # # # #
# # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # #
# # # # # # # # # # # # # # # # # # # # # #
```

```
*RADTRAD-NAI 1.1a(QA)
*18 May 2006 13:23:15
** Palisades CRE Design Basis
** FCM Containment Release Dose
**
*Nuclide inventory file
AST/CRE/palisades_loca_db_ast.nif
*Plant power
27.5706
*Compartments
3
*Compartment 1:
Containment
3
1640000
0
0
1
0
*Compartment 2:
Environment
2
2e+20
0
0
0
0
*Compartment 3:
Control Room
1
35923
0
1
0
0
*Pathways
5
*Pathway 1:
Containment Leakage
1
2
4
*Pathway 2:
```



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Unfiltered Makeup

2

3

2

\*Pathway 3:

Control Room Filtered Makeup

2

3

2

\*Pathway 4:

Control Room Unfiltered Inleakage

2

3

2

\*Pathway 5:

Control Room Exhaust

3

2

2

\*Sources

3

1 1

2 0

3 0

\*dose conversion factors filename

AST/CRE/nai-1101-001rev0.dcf

\*release fraction and timing filename

AST/CRE/pal\_cre\_fcm\_cont\_ast.rft

0

1

1

\*Iodine

0.95 0.0485 0.0015

\*Overlying pool

\*aerosol model

0

\*elemental model

0

\*organic model

0

\*pH tracking

0

\*Compartment detail

\*Compartment 1:

1

\*spray model

0

0

0

\*filter model

0

\*deposition model

\*deposition aerosol model

1

2

0 0.1

720 0.1

\*deposition elemental model

1

2

0 1.3

720 1.3

\*Compartment 2:

1

\*spray model

0

0

0

\*filter model

0

\*deposition model

0

0

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

```
*Compartment 3:
  1
*spray model
0
0
0
*filter model
  1
  3
0 0 99 99 99
0.025 1413.6 99 99 99
720 1413.6 99 99 99
*deposition model
0
0
*Pathways:
*Pathway 1
*convection model
  1
  3
0 0.1
24 0.05
720 0.05
*Pathway 2
*filter efficiency model
  1
  3
0 384.2 0 0 0
0.025 0 0 0 0
720 0 0 0 0
*Pathway 3
*filter efficiency model
  1
  3
0 0 99 99 99
0.025 1413.6 99 99 99
720 1413.6 99 99 99
*Pathway 4
*filter efficiency model
  1
  3
0 0 0 0 0
0.025 10 0 0 0
720 10 0 0 0
*Pathway 5
*filter efficiency model
  1
  3
0 384.2 0 0 0
0.025 1423.6 0 0 0
720 1423.6 0 0 0
*x/q tables
  4
EAB
  2
0 0.000539
720 0.000539
LPZ
  6
0 6.66e-05
2 3.03e-05
8 2.04e-05
24 8.67e-06
96 2.54e-06
720 2.54e-06
Control Room Unfiltered
  6
0 0.0143
2 0.0111
8 0.00413
24 0.00323
96 0.00249
720 0.00249
```

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Emergency

```
6
0 0.000726
2 0.000618
8 0.000247
24 0.000177
96 0.00013
720 0.00013
*dose locations
3
*location name, compartment number and x/q table
EAB
2
1
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
LPZ
2
2
*br model
1
4
0 0.00035
8 0.00018
24 0.00023
720 0.00023
*of model
0
*location x/q input to be included
0
*location name, compartment number and x/q table
Control Room
3
0
*br model
1
2
0 0.00035
720 0.00035
*of model
1
4
0 1
24 0.6
96 0.4
720 0.4
*location x/q input to be included
1
*number of intake combinations
3
*intake combinations
2 1 3
3 1 4
4 1 3
*time step count
3
0 1e-06
0.001 0.02
720 0.02
*show plant, scenario, event, step, model
1
1
1
```

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

0  
1

#####  
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:23:21  
#####

#####  
Plant Description  
#####

Number of Nuclides = 107

Inventory Power = 2.7030E+03 MWth  
Plant Power Level = 2.7571E+01 MWth

Number of compartments = 3

Compartment information

Compartment number 1 (Source term fraction = 1.0000E+00)

Name: Containment

Compartment volume = 1.6400E+06 (Cubic feet)

Removal devices within compartment:

Deposition

Pathways into and out of compartment 1

Pathway to compartment number 2: Containment Leakage

Compartment number 2

Name: Environment

Pathways into and out of compartment 2

Pathway to compartment number 3: Control Room Unfiltered Makeup

Pathway to compartment number 3: Control Room Filtered Makeup

Pathway to compartment number 3: Control Room Unfiltered Inleakage

Pathway from compartment number 1: Containment Leakage

Pathway from compartment number 3: Control Room Exhaust

Compartment number 3

Name: Control Room

Compartment volume = 3.5923E+04 (Cubic feet)

Removal devices within compartment:

Filter(s)

Pathways into and out of compartment 3

Pathway to compartment number 2: Control Room Exhaust

Pathway from compartment number 2: Control Room Unfiltered Makeup

Pathway from compartment number 2: Control Room Filtered Makeup

Pathway from compartment number 2: Control Room Unfiltered Inleakage

Total number of pathways = 5

#####  
RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:23:21  
#####

#####  
Scenario Description  
#####

Radioactive Decay is enabled

Calculation of Daughters is enabled

Iodine fractions

Aerosol = 9.5000E-01

Elemental = 4.8500E-02

Organic = 1.5000E-03

COMPARTMENT DATA

Compartment number 1: Containment

Natural Deposition: Aerosol data

Time (hr) Removal Coef. (hr^-1)

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

0.0000E+00 1.0000E-01  
 7.2000E+02 1.0000E-01

Natural Deposition: Elemental Removal Data

Time (hr) Removal Coef. (hr<sup>-1</sup>)  
 0.0000E+00 1.3000E+00  
 7.2000E+02 1.3000E+00

Compartment number 2: Environment

Compartment number 3: Control Room

Compartment Filter Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
2.5000E-02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

PATHWAY DATA

Pathway number 1: Containment Leakage

Convection Data

Time (hr)	Flow Rate (% / day)
0.0000E+00	1.0000E-01
2.4000E+01	5.0000E-02
7.2000E+02	5.0000E-02

Pathway number 2: Control Room Unfiltered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 3: Control Room Filtered Makeup

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	9.9000E+01	9.9000E+01	9.9000E+01
2.5000E-02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01
7.2000E+02	1.4136E+03	9.9000E+01	9.9000E+01	9.9000E+01

Pathway number 4: Control Room Unfiltered Inleakage

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.0000E+01	0.0000E+00	0.0000E+00	0.0000E+00

Pathway number 5: Control Room Exhaust

Pathway Filter: Removal Data

Time (hr)	Flow Rate (cfm)	Filter Efficiencies (%)		
		Aerosol	Elemental	Organic
0.0000E+00	3.8420E+02	0.0000E+00	0.0000E+00	0.0000E+00
2.5000E-02	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00
7.2000E+02	1.4236E+03	0.0000E+00	0.0000E+00	0.0000E+00

X/Q DATA

X/Q table 1: EAB

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	5.3900E-04
7.2000E+02	5.3900E-04

X/Q table 2: LPZ

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	6.6600E-05
2.0000E+00	3.0300E-05
8.0000E+00	2.0400E-05
2.4000E+01	8.6700E-06
9.6000E+01	2.5400E-06
7.2000E+02	2.5400E-06

X/Q table 3: Control Room Unfiltered

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	1.4300E-02
2.0000E+00	1.1100E-02
8.0000E+00	4.1300E-03
2.4000E+01	3.2300E-03
9.6000E+01	2.4900E-03
7.2000E+02	2.4900E-03

X/Q table 4: Control Room Emergency

Time (hr)	X/Q (s * m <sup>-3</sup> )
0.0000E+00	7.2600E-04
2.0000E+00	6.1800E-04
8.0000E+00	2.4700E-04
2.4000E+01	1.7700E-04
9.6000E+01	1.3000E-04
7.2000E+02	1.3000E-04

LOCATION DATA

Location EAB is in compartment 2

Using X/Q Table 1

Location Breathing Rate Data

Time (hr)	Breathing Rate (m <sup>3</sup> * sec <sup>-1</sup> )
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location LPZ is in compartment 2

Using X/Q Table 2

Location Breathing Rate Data

Time (hr)	Breathing Rate (m <sup>3</sup> * sec <sup>-1</sup> )
0.0000E+00	3.5000E-04
8.0000E+00	1.8000E-04
2.4000E+01	2.3000E-04
7.2000E+02	2.3000E-04

Location Control Room is in compartment 3

Inleakage X/Q Table Assignments

Inleakage Path	Source Path	X/Q Table
2	1	3
3	1	4
4	1	3

Location Breathing Rate Data

Time (hr)	Breathing Rate (m <sup>3</sup> * sec <sup>-1</sup> )
0.0000E+00	3.5000E-04
7.2000E+02	3.5000E-04

Location Occupancy Factor Data

Time (hr)	Occupancy Factor
0.0000E+00	1.0000E+00
2.4000E+01	6.0000E-01
9.6000E+01	4.0000E-01

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

7.2000E+02

4.0000E-01

USER SPECIFIED TIME STEP DATA - SUPPLEMENTAL TIME STEPS

Time	Time step
0.0000E+00	1.0000E-06
1.0000E-03	2.0000E-02
7.2000E+02	2.0000E-02

#####  
 RADTRAD-NAI Version 1.1a(QA) run on May 18, 2006 at 13:23:21  
 #####

```

#####
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
# # # # # # # # # #
#####
    
```

#####  
 Dose, Detailed Model and Detailed Inventory Output  
 #####

Detailed model information at time (H) = 0.0001

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0001				
Delta dose (rem)	1.3363E-06	1.1310E-04	2.3042E-06	5.5463E-06
Accumulated dose (rem)	1.3363E-06	1.1310E-04	2.3042E-06	5.5463E-06

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0001				
Delta dose (rem)	1.6512E-07	1.3974E-05	2.8472E-07	6.8532E-07
Accumulated dose (rem)	1.6512E-07	1.3974E-05	2.8472E-07	6.8532E-07

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
0.0001				
Delta dose (rem)	2.2460E-11	6.4350E-08	1.3111E-09	2.4179E-09
Accumulated dose (rem)	2.2460E-11	6.4350E-08	1.3111E-09	2.4179E-09

Containment Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
0.0001				
Kr-85	1.0730E+04	2.7350E-02	1.9377E+23	3.9702E+14
Kr-85m	1.9869E+05	2.4144E-05	1.7106E+20	7.3516E+15
Kr-87	3.8309E+05	1.3525E-05	9.3617E+19	1.4174E+16
Kr-88	5.3916E+05	4.2998E-05	2.9425E+20	1.9949E+16
Rb-86	2.3978E+02	2.9469E-06	2.0636E+19	8.8719E+12
Sr-89	2.4370E-03	8.3882E-11	5.6758E+14	9.0167E+07
I-131	1.9081E+05	1.5391E-03	7.0755E+21	7.0602E+15
I-132	2.7233E+05	2.6383E-05	1.2037E+20	1.0076E+16
I-133	3.7281E+05	3.2910E-04	1.4901E+21	1.3794E+16
I-134	4.0849E+05	1.5312E-05	6.8816E+19	1.5114E+16
I-135	3.4985E+05	9.9621E-05	4.4439E+20	1.2945E+16
Xe-133	1.4953E+06	7.9886E-03	3.6172E+22	5.5327E+16
Xe-135	4.7859E+05	1.8741E-04	8.3600E+20	1.7708E+16
Cs-134	2.4933E+04	1.9271E-02	8.6604E+22	9.2251E+14
Cs-136	7.1885E+03	9.8082E-05	4.3431E+20	2.6598E+14
Cs-137	1.3464E+04	1.5479E-01	6.8041E+23	4.9817E+14
I-130	9.5445E+03	4.8938E-06	2.2670E+19	3.5315E+14
Kr-83m	9.3012E+04	4.5082E-06	3.2709E+19	3.4415E+15
Xe-138	1.2349E+06	1.2842E-05	5.6042E+19	4.5690E+16
Xe-131m	8.5129E+03	1.0163E-04	4.6721E+20	3.1498E+14
Xe-133m	4.7522E+04	1.0591E-04	4.7955E+20	1.7583E+15

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-135m	3.0585E+05	3.3576E-06	1.4978E+19	1.1316E+16
Cs-138	1.6408E+05	3.8777E-06	1.6922E+19	6.0711E+15
Cs-134m	6.0219E+03	7.4673E-07	3.3559E+18	2.2281E+14
Rb-88	6.5772E+04	5.4792E-07	3.7496E+18	2.4336E+15
Rb-89	8.4371E+04	6.0702E-07	4.1074E+18	3.1217E+15
Ba-137m	1.0477E+01	1.9481E-11	8.5631E+13	3.8764E+11
Br-82	1.3469E+03	1.2441E-06	9.1367E+18	4.9835E+13
Br-83	2.3209E+04	1.4691E-06	1.0660E+19	8.5874E+14
Br-84	4.0565E+04	5.7628E-07	4.1315E+18	1.5009E+15

Containment Transport Group Inventory:

Time (h) =	0.0001	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		2.3239E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		4.4840E+20	0.0000E+00	0.0000E+00
Organic I (atoms)		1.3869E+19	0.0000E+00	0.0000E+00
Aerosols (kg)		1.7608E-01	0.0000E+00	0.0000E+00

Time (h) =	0.0001	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		2.9144E+16	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		8.8034E-07	0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	0.0001	Ci	kg	Atoms	Bq
Kr-85		2.2295E-05	5.6826E-11	4.0260E+14	8.2491E+05
Kr-85m		4.1283E-04	5.0164E-14	3.5541E+11	1.5275E+07
Kr-87		7.9596E-04	2.8100E-14	1.9451E+11	2.9450E+07
Kr-88		1.1202E-03	8.9337E-14	6.1137E+11	4.1448E+07
Rb-86		4.9820E-07	6.1228E-15	4.2875E+10	1.8433E+04
I-131		3.9646E-04	3.1979E-12	1.4701E+13	1.4669E+07
I-132		5.6583E-04	5.4817E-14	2.5009E+11	2.0936E+07
I-133		7.7459E-04	6.8378E-13	3.0961E+12	2.8660E+07
I-134		8.4872E-04	3.1815E-14	1.4298E+11	3.1402E+07
I-135		7.2690E-04	2.0698E-13	9.2333E+11	2.6895E+07
Xe-133		3.1069E-03	1.6598E-11	7.5155E+13	1.1495E+08
Xe-135		9.9437E-04	3.8938E-13	1.7370E+12	3.6792E+07
Cs-134		5.1803E-05	4.0039E-11	1.7994E+14	1.9167E+06
Cs-136		1.4936E-05	2.0379E-13	9.0238E+11	5.5262E+05
Cs-137		2.7974E-05	3.2161E-10	1.4137E+15	1.0351E+06
I-130		1.9831E-05	1.0168E-14	4.7102E+10	7.3374E+05
Kr-83m		1.9325E-04	9.3666E-15	6.7961E+10	7.1504E+06
Xe-138		2.5657E-03	2.6683E-14	1.1644E+11	9.4931E+07
Xe-131m		1.7687E-05	2.1117E-13	9.7074E+11	6.5444E+05
Xe-133m		9.8737E-05	2.2005E-13	9.9636E+11	3.6533E+06
Xe-135m		6.3546E-04	6.9760E-15	3.1119E+10	2.3512E+07
Cs-138		3.4097E-04	8.0580E-15	3.5164E+10	1.2616E+07
Cs-134m		1.2512E-05	1.5515E-15	6.9727E+09	4.6294E+05
Rb-88		1.3669E-04	1.1388E-15	7.7929E+09	5.0577E+06
Rb-89		1.7530E-04	1.2612E-15	8.5340E+09	6.4861E+06
Br-82		2.7985E-06	2.5849E-15	1.8984E+10	1.0354E+05
Br-83		4.8223E-05	3.0525E-15	2.2148E+10	1.7842E+06
Br-84		8.4283E-05	1.1974E-15	8.5841E+09	3.1185E+06

Environment Transport Group Inventory:

Time (h) =	0.0001	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)		9.6095E+12	2.6693E+15	4.8284E+14
Elemental I (atoms)		1.8542E+10	5.1504E+12	9.3167E+11
Organic I (atoms)		5.7349E+08	1.5930E+11	2.8816E+10
Aerosols (kg)		7.2812E-12	2.0226E-09	3.6586E-10

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	0.0001	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.0001	Ci	kg	Atoms	Bq
Kr-85	5.7963E-08	1.4774E-13	1.0467E+12	2.1446E+03
Kr-85m	1.0733E-06	1.3042E-16	9.2401E+08	3.9712E+04
Kr-87	2.0694E-06	7.3057E-17	5.0570E+08	7.6567E+04
Kr-88	2.9124E-06	2.3226E-16	1.5895E+09	1.0776E+05
Rb-86	1.2952E-09	1.5918E-17	1.1147E+08	4.7924E+01
I-131	1.0307E-06	8.3141E-15	3.8220E+10	3.8137E+04
I-132	1.4711E-06	1.4252E-16	6.5019E+08	5.4430E+04
I-133	2.0138E-06	1.7777E-15	8.0494E+09	7.4511E+04
I-134	2.2065E-06	8.2714E-17	3.7173E+08	8.1642E+04
I-135	1.8898E-06	5.3813E-16	2.4005E+09	6.9924E+04
Xe-133	8.0774E-06	4.3153E-14	1.9539E+11	2.9886E+05
Xe-135	2.5852E-06	1.0123E-15	4.5159E+09	9.5653E+04
Cs-134	1.3468E-07	1.0410E-13	4.6782E+11	4.9832E+03
Cs-136	3.8831E-08	5.2982E-16	2.3461E+09	1.4367E+03
Cs-137	7.2729E-08	8.3614E-13	3.6755E+12	2.6910E+03
I-130	5.1557E-08	2.6435E-17	1.2246E+08	1.9076E+03
Kr-83m	5.0243E-07	2.4352E-17	1.7669E+08	1.8590E+04
Xe-138	6.6704E-06	6.9371E-17	3.0273E+08	2.4681E+05
Xe-131m	4.5985E-08	5.4900E-16	2.5238E+09	1.7014E+03
Xe-133m	2.5670E-07	5.7209E-16	2.5904E+09	9.4980E+03
Xe-135m	1.6521E-06	1.8137E-17	8.0904E+07	6.1128E+04
Cs-138	8.8647E-07	2.0950E-17	9.1422E+07	3.2799E+04
Cs-134m	3.2529E-08	4.0337E-18	1.8128E+07	1.2036E+03
Rb-88	3.5539E-07	2.9606E-18	2.0260E+07	1.3149E+04
Rb-89	4.5576E-07	3.2790E-18	2.2187E+07	1.6863E+04
Br-82	7.2757E-09	6.7203E-18	4.9354E+07	2.6920E+02
Br-83	1.2537E-07	7.9360E-18	5.7580E+07	4.6387E+03
Br-84	2.1912E-07	3.1129E-18	2.2317E+07	8.1075E+03

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0001			
Noble gases (atoms)	1.2553E+12	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.4222E+09	0.0000E+00	0.0000E+00
Organic I (atoms)	7.4916E+07	0.0000E+00	0.0000E+00
Aerosols (kg)	9.5117E-13	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0001		

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 0.0001	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 0.0250

EAB Doses:

Time (h) = 0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	6.7038E-04	5.6770E-02	1.1573E-03	2.7840E-03
Accumulated dose (rem)	6.7172E-04	5.6883E-02	1.1596E-03	2.7896E-03

LPZ Doses:

Time (h) = 0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	8.2834E-05	7.0146E-03	1.4300E-04	3.4400E-04
Accumulated dose (rem)	8.2999E-05	7.0286E-03	1.4328E-04	3.4469E-04

Control Room Doses:

Time (h) = 0.0250	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.1935E-06	1.2037E-02	2.4525E-04	4.5236E-04
Accumulated dose (rem)	4.1935E-06	1.2037E-02	2.4525E-04	4.5237E-04

Containment Compartment Atmosphere Nuclide Inventory:

Time (h) = 0.0250	Ci	kg	Atoms	Bq
Kr-85	1.0838E+04	2.7624E-02	1.9571E+23	4.0099E+14
Kr-85m	1.9991E+05	2.4292E-05	1.7210E+20	7.3966E+15
Kr-87	3.8171E+05	1.3476E-05	9.3278E+19	1.4123E+16
Kr-88	5.4125E+05	4.3165E-05	2.9539E+20	2.0026E+16
Rb-86	2.4157E+02	2.9688E-06	2.0789E+19	8.9380E+12
Sr-89	1.1726E+00	4.0361E-08	2.7310E+17	4.3386E+10
I-131	1.9195E+05	1.5483E-03	7.1177E+21	7.1023E+15
I-132	2.7193E+05	2.6345E-05	1.2019E+20	1.0062E+16
I-133	3.7475E+05	3.3082E-04	1.4979E+21	1.3866E+16

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-134	4.0295E+05	1.5105E-05	6.7883E+19	1.4909E+16
I-135	3.5105E+05	9.9962E-05	4.4592E+20	1.2989E+16
Xe-133	1.5101E+06	8.0677E-03	3.6530E+22	5.5874E+16
Xe-135	4.8359E+05	1.8937E-04	8.4474E+20	1.7893E+16
Cs-134	2.5119E+04	1.9415E-02	8.7253E+22	9.2942E+14
Cs-136	7.2419E+03	9.8811E-05	4.3754E+20	2.6795E+14
Cs-137	1.3565E+04	1.5595E-01	6.8551E+23	5.0190E+14
I-130	9.5889E+03	4.9165E-06	2.2775E+19	3.5479E+14
Kr-83m	9.3281E+04	4.5211E-06	3.2804E+19	3.4514E+15
Xe-138	1.1593E+06	1.2057E-05	5.2613E+19	4.2894E+16
Xe-131m	8.5976E+03	1.0264E-04	4.7186E+20	3.1811E+14
Xe-133m	4.7985E+04	1.0694E-04	4.8422E+20	1.7754E+15
Xe-135m	2.9231E+05	3.2090E-06	1.4315E+19	1.0816E+16
Cs-138	1.9851E+05	4.6912E-06	2.0472E+19	7.3447E+15
Cs-134m	6.0310E+03	7.4786E-07	3.3610E+18	2.2315E+14
Rb-88	9.3745E+04	7.8096E-07	5.3444E+18	3.4686E+15
Rb-89	7.9405E+04	5.7129E-07	3.8656E+18	2.9380E+15
Ba-137m	4.8413E+03	9.0021E-09	3.9571E+16	1.7913E+14
Br-82	1.3544E+03	1.2510E-06	9.1875E+18	5.0112E+13
Br-83	2.3182E+04	1.4674E-06	1.0647E+19	8.5772E+14
Br-84	3.9503E+04	5.6119E-07	4.0233E+18	1.4616E+15

Containment Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 0.0250			
Noble gases (atoms)	2.3470E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	4.3819E+20	0.0000E+00	0.0000E+00
Organic I (atoms)	1.3999E+19	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7740E-01	0.0000E+00	0.0000E+00

	Deposition Surfaces	Recirculating Filter
Time (h) = 0.0250		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.4446E+19	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	4.4316E-04	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 0.0250	Ci	kg	Atoms	Bq
Kr-85	1.1237E-02	2.8643E-08	2.0293E+17	4.1579E+08
Kr-85m	2.0728E-01	2.5188E-11	1.7845E+14	7.6694E+09
Kr-87	3.9579E-01	1.3973E-11	9.6719E+13	1.4644E+10
Kr-88	5.6122E-01	4.4757E-11	3.0629E+14	2.0765E+10
Rb-86	2.5079E-04	3.0822E-12	2.1583E+13	9.2792E+06
Sr-89	1.2174E-06	4.1903E-14	2.8353E+11	4.5043E+04
I-131	1.9942E-01	1.6086E-09	7.3947E+15	7.3787E+09
I-132	2.8252E-01	2.7370E-11	1.2487E+14	1.0453E+10
I-133	3.8934E-01	3.4369E-10	1.5562E+15	1.4405E+10
I-134	4.1863E-01	1.5693E-11	7.0525E+13	1.5489E+10
I-135	3.6472E-01	1.0385E-10	4.6327E+14	1.3495E+10
Xe-133	1.5658E+00	8.3653E-09	3.7877E+16	5.7936E+10
Xe-135	5.0143E-01	1.9635E-10	8.7590E+14	1.8553E+10
Cs-134	2.6079E-02	2.0156E-08	9.0584E+16	9.6491E+08
Cs-136	7.5185E-03	1.0258E-10	4.5425E+14	2.7818E+08
Cs-137	1.4083E-02	1.6190E-07	7.1168E+17	5.2106E+08
I-130	9.9621E-03	5.1079E-12	2.3662E+13	3.6860E+08
Kr-83m	9.6721E-02	4.6879E-12	3.4014E+13	3.5787E+09
Xe-138	1.2021E+00	1.2501E-11	5.4554E+13	4.4477E+10
Xe-131m	8.9148E-03	1.0643E-10	4.8927E+14	3.2985E+08
Xe-133m	4.9755E-02	1.1089E-10	5.0208E+14	1.8409E+09
Xe-135m	3.0309E-01	3.3273E-12	1.4843E+13	1.1214E+10
Cs-138	2.0605E-01	4.8695E-12	2.1250E+13	7.6239E+09
Cs-134m	6.2613E-03	7.7641E-13	3.4893E+12	2.3167E+08
Rb-88	9.7297E-02	8.1055E-13	5.5468E+12	3.6000E+09
Rb-89	8.2437E-02	5.9310E-13	4.0132E+12	3.0502E+09
Ba-137m	5.0262E-03	9.3458E-15	4.1082E+10	1.8597E+08
Br-82	1.4071E-03	1.2997E-12	9.5451E+12	5.2063E+07
Br-83	2.4084E-02	1.5245E-12	1.1061E+13	8.9111E+08
Br-84	4.1040E-02	5.8303E-13	4.1799E+12	1.5185E+09

Environment Transport Group Inventory:

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Present	Release	Integral
Time (h) =	0.0250	Release	Rate/s
Noble gases (atoms)	4.8771E+16	7.1303E+14	2.4336E+17
Elemental I (atoms)	9.1354E+13	1.3356E+12	4.6181E+14
Organic I (atoms)	2.9090E+12	4.2530E+10	1.4516E+13
Aerosols (kg)	3.6874E-08	5.3909E-10	1.8418E-07

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) =	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	0.0250	Ci	kg	Atoms	Bq
Kr-85		2.8980E-05	7.3866E-11	5.2333E+14	1.0723E+06
Kr-85m		5.3456E-04	6.4956E-14	4.6021E+11	1.9779E+07
Kr-87		1.0207E-03	3.6034E-14	2.4943E+11	3.7766E+07
Kr-88		1.4473E-03	1.1542E-13	7.8988E+11	5.3551E+07
Rb-86		6.4676E-07	7.9486E-15	5.5660E+10	2.3930E+04
Sr-89		3.1394E-09	1.0806E-16	7.3120E+08	1.1616E+02
I-131		5.1429E-04	4.1483E-12	1.9070E+13	1.9029E+07
I-132		7.2858E-04	7.0584E-14	3.2202E+11	2.6957E+07
I-133		1.0041E-03	8.8634E-13	4.0133E+12	3.7150E+07
I-134		1.0796E-03	4.0470E-14	1.8188E+11	3.9945E+07
I-135		9.4056E-04	2.6782E-13	1.1947E+12	3.4801E+07
Xe-133		4.0381E-03	2.1573E-11	9.7682E+13	1.4941E+08
Xe-135		1.2931E-03	5.0637E-13	2.2588E+12	4.7846E+07
Cs-134		6.7254E-05	5.1980E-11	2.3361E+14	2.4884E+06
Cs-136		1.9389E-05	2.6455E-13	1.1714E+12	7.1740E+05
Cs-137		3.6318E-05	4.1753E-10	1.8354E+15	1.3438E+06
I-130		2.5691E-05	1.3173E-14	6.1021E+10	9.5057E+05
Kr-83m		2.4943E-04	1.2090E-14	8.7717E+10	9.2291E+06
Xe-138		3.1000E-03	3.2240E-14	1.4069E+11	1.1470E+08
Xe-131m		2.2990E-05	2.7448E-13	1.2618E+12	8.5064E+05
Xe-133m		1.2831E-04	2.8596E-13	1.2948E+12	4.7476E+06
Xe-135m		7.8164E-04	8.5808E-15	3.8278E+10	2.8921E+07
Cs-138		5.3138E-04	1.2558E-14	5.4801E+10	1.9661E+07
Cs-134m		1.6147E-05	2.0023E-15	8.9985E+09	5.9744E+05
Rb-88		2.5092E-04	2.0903E-15	1.4305E+10	9.2840E+06
Rb-89		2.1259E-04	1.5295E-15	1.0350E+10	7.8660E+06

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Ba-137m	1.2962E-05	2.4102E-17	1.0594E+08	4.7959E+05
Br-82	3.6287E-06	3.3518E-15	2.4616E+10	1.3426E+05
Br-83	6.2110E-05	3.9316E-15	2.8526E+10	2.2981E+06
Br-84	1.0584E-04	1.5036E-15	1.0779E+10	3.9160E+06

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool	
Time (h) = 0.0250				
Noble gases (atoms)	6.2760E+14	0.0000E+00	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.1909E+12	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	3.7434E+10	0.0000E+00	0.0000E+00	0.0000E+00
Aerosols (kg)	4.7497E-10	0.0000E+00	0.0000E+00	0.0000E+00

	Surfaces	Recirculating Filter
Time (h) = 0.0250		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	0.0000E+00	0.0000E+00

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway Filter
Time (h) = 0.0250	
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Detailed model information at time (H) = 2.0000

EAB Doses:

Time (h) = 2.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.3411E-02	3.9095E+00	6.3770E-02	1.7986E-01
Accumulated dose (rem)	3.4083E-02	3.9663E+00	6.4929E-02	1.8265E-01

LPZ Doses:

Time (h) = 2.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	4.1284E-03	4.8306E-01	7.8795E-03	2.2224E-02
Accumulated dose (rem)	4.2114E-03	4.9009E-01	8.0228E-03	2.2569E-02

Control Room Doses:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) =	2.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		5.8583E-04	5.5841E-01	3.9651E-02	2.1711E-02
Accumulated dose (rem)		5.9003E-04	5.7045E-01	3.9896E-02	2.2164E-02

Containment Compartment Atmosphere Nuclide Inventory:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Kr-85		1.0837E+04	2.7622E-02	1.9570E+23	4.0098E+14
Kr-85m		1.4726E+05	1.7894E-05	1.2678E+20	5.4486E+15
Kr-87		1.3007E+05	4.5919E-06	3.1785E+19	4.8125E+15
Kr-88		3.3421E+05	2.6653E-05	1.8240E+20	1.2366E+16
Rb-86		1.9765E+02	2.4291E-06	1.7010E+19	7.3131E+12
Sr-89		1.4509E+01	4.9941E-07	3.3793E+18	5.3684E+11
I-131		1.4979E+05	1.2082E-03	5.5544E+21	5.5423E+15
I-132		1.1785E+05	1.1418E-05	5.2090E+19	4.3606E+15
I-133		2.7576E+05	2.4343E-04	1.1022E+21	1.0203E+16
I-134		6.6443E+04	2.4907E-06	1.1193E+19	2.4584E+15
I-135		2.2429E+05	6.3865E-05	2.8489E+20	8.2986E+15
Xe-133		1.4980E+06	8.0029E-03	3.6237E+22	5.5426E+16
Xe-135		4.6644E+05	1.8265E-04	8.1477E+20	1.7258E+16
Cs-134		2.0615E+04	1.5933E-02	7.1605E+22	7.6274E+14
Cs-136		5.9177E+03	8.0743E-05	3.5753E+20	2.1896E+14
Cs-137		1.1133E+04	1.2799E-01	5.6260E+23	4.1191E+14
I-130		6.7459E+03	3.4588E-06	1.6023E+19	2.4960E+14
Kr-83m		5.3183E+04	2.5777E-06	1.8703E+19	1.9678E+15
Xe-138		3.5215E+03	3.6623E-08	1.5982E+17	1.3030E+14
Xe-131m		8.5660E+03	1.0227E-04	4.7013E+20	3.1694E+14
Xe-133m		4.7018E+04	1.0479E-04	4.7446E+20	1.7397E+15
Xe-135m		4.8236E+04	5.2953E-07	2.3621E+18	1.7847E+15
Cs-138		7.2709E+04	1.7183E-06	7.4984E+18	2.6902E+15
Cs-134m		3.0872E+03	3.8282E-07	1.7205E+18	1.1423E+14
Rb-88		3.6088E+05	3.0064E-06	2.0574E+19	1.3353E+16
Rb-89		2.9322E+02	2.1096E-09	1.4275E+16	1.0849E+13
Ba-137m		1.2341E+04	2.2947E-08	1.0087E+17	4.5661E+14
Br-82		1.0239E+03	9.4578E-07	6.9459E+18	3.7886E+13
Br-83		1.0275E+04	6.5038E-07	4.7189E+18	3.8016E+14
Br-84		2.3455E+03	3.3321E-08	2.3889E+17	8.6784E+13

Containment Transport Group Inventory:

Time (h) =	2.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		2.3406E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		3.2361E+19	0.0000E+00	0.0000E+00
Organic I (atoms)		1.3474E+19	0.0000E+00	0.0000E+00
Aerosols (kg)		1.4554E-01	0.0000E+00	0.0000E+00

Time (h) =	2.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		4.0335E+20	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		3.2222E-02	0.0000E+00

Environment Integral Nuclide Release:

Time (h) =	2.0000	Ci	kg	Atoms	Bq
Kr-85		9.0301E-01	2.3016E-06	1.6307E+19	3.3411E+10
Kr-85m		1.2270E+01	1.4910E-09	1.0564E+16	4.5401E+11
Kr-87		1.0838E+01	3.8262E-10	2.6485E+15	4.0100E+11
Kr-88		2.7848E+01	2.2209E-09	1.5198E+16	1.0304E+12
Rb-86		1.8224E-02	2.2397E-10	1.5684E+15	6.7430E+08
Sr-89		1.3378E-03	4.6048E-11	3.1158E+14	4.9498E+07
I-131		1.4020E+01	1.1309E-07	5.1989E+17	5.1876E+11
I-132		1.1031E+01	1.0687E-09	4.8756E+15	4.0815E+11
I-133		2.5811E+01	2.2785E-08	1.0317E+17	9.5502E+11
I-134		6.2190E+00	2.3312E-10	1.0477E+15	2.3010E+11
I-135		2.0993E+01	5.9778E-09	2.6666E+16	7.7674E+11
Xe-133		1.2481E+02	6.6677E-07	3.0191E+18	4.6179E+12
Xe-135		3.8716E+01	1.5160E-08	6.7628E+16	1.4325E+12
Cs-134		1.9007E+00	1.4691E-06	6.6022E+18	7.0327E+10
Cs-136		5.4564E-01	7.4448E-09	3.2966E+16	2.0189E+10
Cs-137		1.0265E+00	1.1801E-05	5.1874E+19	3.7980E+10

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-130	6.3142E-01	3.2375E-10	1.4997E+15	2.3362E+10
Kr-83m	4.3973E+00	2.1313E-10	1.5464E+15	1.6270E+11
Xe-138	2.9343E-01	3.0516E-12	1.3317E+13	1.0857E+10
Xe-131m	7.1373E-01	8.5210E-09	3.9171E+16	2.6408E+10
Xe-133m	3.9168E+00	8.7291E-09	3.9525E+16	1.4492E+11
Xe-135m	3.6802E+00	4.0401E-11	1.8022E+14	1.3617E+11
Cs-138	6.6261E+00	1.5659E-10	6.8335E+14	2.4517E+11
Cs-134m	2.8465E-01	3.5298E-11	1.5863E+14	1.0532E+10
Rb-88	3.1119E+01	2.5924E-10	1.7741E+15	1.1514E+12
Rb-89	2.7036E-02	1.9451E-13	1.3162E+12	1.0003E+09
Ba-137m	1.1379E+00	2.1158E-12	9.3004E+12	4.2101E+10
Br-82	9.5840E-02	8.8525E-11	6.5013E+14	3.5461E+09
Br-83	9.6169E-01	6.0875E-11	4.4168E+14	3.5582E+10
Br-84	2.1954E-01	3.1189E-12	2.2360E+13	8.1230E+09

Environment Transport Group Inventory:

Time (h) = 2.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	1.9505E+17	2.7090E+15	1.9502E+19
Elemental I (atoms)	2.7307E+13	3.7927E+11	1.2920E+16
Organic I (atoms)	1.1223E+13	1.5587E+11	1.1223E+15
Aerosols (kg)	1.2134E-07	1.6853E-09	1.3419E-05

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 2.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	8.6230E-06	1.0598E-13	7.4210E+11	3.1905E+05
Sr-89	6.3299E-07	2.1788E-14	1.4743E+11	2.3421E+04
I-131	6.6312E-03	5.3489E-11	2.4589E+14	2.4536E+08
I-132	5.2174E-03	5.0545E-13	2.3060E+12	1.9304E+08
I-133	1.2208E-02	1.0777E-11	4.8796E+13	4.5169E+08
I-134	2.9414E-03	1.1026E-13	4.9553E+11	1.0883E+08
I-135	9.9291E-03	2.8273E-12	1.2612E+13	3.6738E+08
Cs-134	8.9936E-04	6.9511E-10	3.1239E+15	3.3276E+07
Cs-136	2.5817E-04	3.5226E-12	1.5598E+13	9.5525E+06
Cs-137	4.8569E-04	5.5838E-09	2.4545E+16	1.7971E+07
I-130	2.9864E-04	1.5312E-13	7.0932E+11	1.1050E+07
Cs-138	2.3919E-03	5.6527E-14	2.4668E+11	8.8500E+07
Cs-134m	1.3469E-04	1.6702E-14	7.5059E+10	4.9834E+06
Rb-88	3.1777E-03	2.6472E-14	1.8116E+11	1.1757E+08
Rb-89	1.2792E-05	9.2037E-17	6.2276E+08	4.7332E+05
Ba-137m	5.3840E-04	1.0011E-15	4.4006E+09	1.9921E+07
Br-82	4.5330E-05	4.1870E-14	3.0749E+11	1.6772E+06
Br-83	4.5485E-04	2.8792E-14	2.0890E+11	1.6829E+07
Br-84	1.0384E-04	1.4751E-15	1.0575E+10	3.8419E+06

Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 2.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.9853E+12
Organic I (atoms)	5.3171E+11
Aerosols (kg)	6.3492E-09

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 2.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Kr-85	1.0411E-04	2.6535E-10	1.8800E+15	3.8519E+06
Kr-85m	1.4146E-03	1.7190E-13	1.2179E+12	5.2342E+07
Kr-87	1.2495E-03	4.4111E-14	3.0534E+11	4.6231E+07
Kr-88	3.2106E-03	2.5604E-13	1.7522E+12	1.1879E+08
Rb-86	1.2912E-07	1.5868E-15	1.1112E+10	4.7773E+03
Sr-89	9.4781E-09	3.2624E-16	2.2075E+09	3.5069E+02
I-131	9.8007E-05	7.9054E-13	3.6342E+12	3.6263E+06
I-132	7.7111E-05	7.4704E-15	3.4082E+10	2.8531E+06
I-133	1.8043E-04	1.5928E-13	7.2119E+11	6.6759E+06
I-134	4.3473E-05	1.6296E-15	7.3237E+09	1.6085E+06
I-135	1.4675E-04	4.1787E-14	1.8640E+11	5.4297E+06
Xe-133	1.4409E-02	7.6977E-11	3.4855E+14	5.3312E+08
Xe-135	4.6754E-03	1.8308E-12	8.1670E+12	1.7299E+08
Cs-134	1.3467E-05	1.0408E-11	4.6776E+13	4.9826E+05
Cs-136	3.8658E-06	5.2746E-14	2.3356E+11	1.4303E+05
Cs-137	7.2725E-06	8.3609E-11	3.6752E+14	2.6908E+05
I-130	4.4138E-06	2.2631E-15	1.0484E+10	1.6331E+05
Kr-83m	5.5778E-04	2.7035E-14	1.9615E+11	2.0638E+07
Xe-138	3.3829E-05	3.5182E-16	1.5353E+09	1.2517E+06
Xe-131m	8.2338E-05	9.8301E-13	4.5190E+12	3.0465E+06
Xe-133m	4.5298E-04	1.0095E-12	4.5711E+12	1.6760E+07
Xe-135m	1.1211E-03	1.2307E-14	5.4899E+10	4.1479E+07
Cs-138	6.1305E-05	1.4488E-15	6.3224E+09	2.2683E+06
Cs-134m	2.0167E-06	2.5008E-16	1.1239E+09	7.4619E+04
Rb-88	1.3329E-03	1.1104E-14	7.5989E+10	4.9318E+07
Rb-89	1.9155E-07	1.3781E-18	9.3249E+06	7.0872E+03
Ba-137m	8.0617E-06	1.4990E-17	6.5892E+07	2.9828E+05
Br-82	6.6996E-07	6.1882E-16	4.5446E+09	2.4788E+04
Br-83	6.7225E-06	4.2554E-16	3.0875E+09	2.4873E+05
Br-84	1.5347E-06	2.1802E-17	1.5630E+08	5.6782E+04

## Control Room Transport Group Inventory:

Time (h) = 2.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	2.2493E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.8628E+10	0.0000E+00	0.0000E+00
Organic I (atoms)	8.6150E+09	0.0000E+00	0.0000E+00
Aerosols (kg)	9.5081E-11	0.0000E+00	0.0000E+00

## Recirculating Filter Inventory

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	9.0062E-07	1.1069E-14	7.7508E+10	3.3323E+04
Sr-89	6.6112E-08	2.2756E-15	1.5398E+10	2.4462E+03
I-131	7.0057E-04	5.6509E-12	2.5978E+13	2.5921E+07
I-132	5.5120E-04	5.3400E-14	2.4362E+11	2.0394E+07
I-133	1.2897E-03	1.1385E-12	5.1552E+12	4.7720E+07
I-134	3.1075E-04	1.1649E-14	5.2351E+10	1.1498E+07
I-135	1.0490E-03	2.9870E-13	1.3324E+12	3.8812E+07
Cs-134	9.3933E-05	7.2601E-11	3.2628E+14	3.4755E+06
Cs-136	2.6965E-05	3.6792E-13	1.6291E+12	9.9770E+05
Cs-137	5.0727E-05	5.8320E-10	2.5636E+15	1.8769E+06
I-130	3.1551E-05	1.6177E-14	7.4938E+10	1.1674E+06
Cs-138	4.0128E-04	9.4834E-15	4.1384E+10	1.4847E+07
Cs-134m	1.4067E-05	1.7444E-15	7.8395E+09	5.2049E+05
Rb-88	1.3151E-03	1.0956E-14	7.4976E+10	4.8660E+07
Rb-89	1.3361E-06	9.6127E-18	6.5044E+07	4.9435E+04
Ba-137m	5.6233E-05	1.0456E-16	4.5962E+08	2.0806E+06
Br-82	4.7890E-06	4.4234E-15	3.2486E+10	1.7719E+05



## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Br-83	4.8054E-05	3.0418E-15	2.2070E+10	1.7780E+06
Br-84	1.0970E-05	1.5584E-16	1.1173E+09	4.0589E+05

	Deposition Recirculating	
Time (h) = 2.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	1.0019E+12
Organic I (atoms)	0.0000E+00	5.3362E+10
Aerosols (kg)	0.0000E+00	6.6315E-10

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	8.6230E-06	1.0598E-13	7.4210E+11	3.1905E+05
Sr-89	6.3299E-07	2.1788E-14	1.4743E+11	2.3421E+04
I-131	6.6312E-03	5.3489E-11	2.4589E+14	2.4536E+08
I-132	5.2174E-03	5.0545E-13	2.3060E+12	1.9304E+08
I-133	1.2208E-02	1.0777E-11	4.8796E+13	4.5169E+08
I-134	2.9414E-03	1.1026E-13	4.9553E+11	1.0883E+08
I-135	9.9291E-03	2.8273E-12	1.2612E+13	3.6738E+08
Cs-134	8.9936E-04	6.9511E-10	3.1239E+15	3.3276E+07
Cs-136	2.5817E-04	3.5226E-12	1.5598E+13	9.5525E+06
Cs-137	4.8569E-04	5.5838E-09	2.4545E+16	1.7971E+07
I-130	2.9864E-04	1.5312E-13	7.0932E+11	1.1050E+07
Cs-138	2.3919E-03	5.6527E-14	2.4668E+11	8.8500E+07
Cs-134m	1.3469E-04	1.6702E-14	7.5059E+10	4.9834E+06
Rb-88	3.1777E-03	2.6472E-14	1.8116E+11	1.1757E+08
Rb-89	1.2792E-05	9.2037E-17	6.2276E+08	4.7332E+05
Ba-137m	5.3840E-04	1.0011E-15	4.4006E+09	1.9921E+07
Br-82	4.5330E-05	4.1870E-14	3.0749E+11	1.6772E+06
Br-83	4.5485E-04	2.8792E-14	2.0890E+11	1.6829E+07
Br-84	1.0384E-04	1.4751E-15	1.0575E+10	3.8419E+06

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.9853E+12
Organic I (atoms)	5.3171E+11
Aerosols (kg)	6.3492E-09

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 2.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 2.0000	Ci	kg	Atoms	Bq
Rb-86	9.5236E-06	1.1704E-13	8.1960E+11	3.5237E+05

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Sr-89	6.9910E-07	2.4064E-14	1.6283E+11	2.5867E+04
I-131	7.3318E-03	5.9139E-11	2.7187E+14	2.7128E+08
I-132	5.7686E-03	5.5885E-13	2.5496E+12	2.1344E+08
I-133	1.3498E-02	1.1915E-11	5.3951E+13	4.9941E+08
I-134	3.2521E-03	1.2191E-13	5.4788E+11	1.2033E+08
I-135	1.0978E-02	3.1260E-12	1.3945E+13	4.0619E+08
Cs-134	9.9329E-04	7.6771E-10	3.4502E+15	3.6752E+07
Cs-136	2.8514E-04	3.8905E-12	1.7227E+13	1.0550E+07
Cs-137	5.3642E-04	6.1670E-09	2.7108E+16	1.9847E+07
I-130	3.3019E-04	1.6930E-13	7.8426E+11	1.2217E+07
Cs-138	2.7932E-03	6.6010E-14	2.8806E+11	1.0335E+08
Cs-134m	1.4875E-04	1.8446E-14	8.2899E+10	5.5039E+06
Rb-88	4.4928E-03	3.7428E-14	2.5613E+11	1.6623E+08
Rb-89	1.4128E-05	1.0165E-16	6.8780E+08	5.2275E+05
Ba-137m	5.9463E-04	1.1057E-15	4.8602E+09	2.2001E+07
Br-82	5.0118E-05	4.6293E-14	3.3998E+11	1.8544E+06
Br-83	5.0290E-04	3.1834E-14	2.3097E+11	1.8607E+07
Br-84	1.1481E-04	1.6310E-15	1.1693E+10	4.2478E+06

Detailed model information at time (H) = 8.0000

## EAB Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		3.1325E-02	7.5300E+00	6.5634E-02	3.1364E-01
Accumulated dose (rem)		6.5408E-02	1.1496E+01	1.3056E-01	4.9630E-01

## LPZ Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		1.7609E-03	4.2330E-01	3.6896E-03	1.7631E-02
Accumulated dose (rem)		5.9723E-03	9.1339E-01	1.1712E-02	4.0201E-02

## Control Room Doses:

Time (h) =	8.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)		6.8870E-04	6.1410E-01	4.8486E-02	2.4013E-02
Accumulated dose (rem)		1.2787E-03	1.1845E+00	8.8383E-02	4.6176E-02

## Containment Compartment Atmosphere Nuclide Inventory:

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Kr-85		1.0835E+04	2.7616E-02	1.9566E+23	4.0089E+14
Kr-85m		5.8185E+04	7.0703E-06	5.0092E+19	2.1529E+15
Kr-87		4.9401E+03	1.7440E-07	1.2072E+18	1.8278E+14
Kr-88		7.7256E+04	6.1611E-06	4.2163E+19	2.8585E+15
Rb-86		1.0744E+02	1.3205E-06	9.2466E+18	3.9754E+12
Sr-89		7.9670E+00	2.7423E-07	1.8556E+18	2.9478E+11
I-131		8.0191E+04	6.4684E-04	2.9735E+21	2.9671E+15
I-132		1.0569E+04	1.0239E-06	4.6715E+18	3.9107E+14
I-133		1.2351E+05	1.0903E-04	4.9368E+20	4.5698E+15
I-134		3.1635E+02	1.1859E-08	5.3294E+16	1.1705E+13
I-135		6.5396E+04	1.8622E-05	8.3068E+19	2.4197E+15
Xe-133		1.4605E+06	7.8026E-03	3.5330E+22	5.4039E+16
Xe-135		3.7188E+05	1.4562E-04	6.4959E+20	1.3759E+16
Cs-134		1.1308E+04	8.7402E-03	3.9279E+22	4.1841E+14
Cs-136		3.2042E+03	4.3719E-05	1.9359E+20	1.1856E+14
Cs-137		6.1081E+03	7.0223E-02	3.0868E+23	2.2600E+14
I-130		2.6358E+03	1.3515E-06	6.2605E+18	9.7524E+13
Kr-83m		9.5517E+03	4.6296E-07	3.3590E+18	3.5341E+14
Xe-138		7.9198E-05	8.2365E-16	3.5943E+09	2.9303E+06
Xe-131m		8.4704E+03	1.0113E-04	4.6488E+20	3.1341E+14
Xe-133m		4.4131E+04	9.8351E-05	4.4533E+20	1.6328E+15
Xe-135m		2.5127E+04	2.7584E-07	1.2305E+18	9.2970E+14
Cs-138		1.7899E+01	4.2301E-10	1.8460E+15	6.6228E+11
Cs-134m		4.0370E+02	5.0060E-08	2.2498E+17	1.4937E+13
Rb-88		8.4357E+04	7.0275E-07	4.8091E+18	3.1212E+15
Rb-89		1.1936E-05	8.5873E-17	5.8106E+08	4.4162E+05
Ba-137m		6.7710E+03	1.2590E-08	5.5343E+16	2.5053E+14
Br-82		4.9786E+02	4.5986E-07	3.3772E+18	1.8421E+13
Br-83		9.8636E+02	6.2437E-08	4.5302E+17	3.6495E+13
Br-84		5.0159E-01	7.1258E-12	5.1087E+13	1.8559E+10

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Containment Transport Group Inventory:

		Atmosphere	Sump	Overlying Pool
Time (h) =	8.0000			
Noble gases (atoms)		2.3265E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)		1.2285E+16	0.0000E+00	0.0000E+00
Organic I (atoms)		1.2484E+19	0.0000E+00	0.0000E+00
Aerosols (kg)		7.9784E-02	0.0000E+00	0.0000E+00

		Surfaces	Recirculating Filter
Time (h) =	8.0000		
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		4.0377E+20	0.0000E+00
Organic I (atoms)		0.0000E+00	0.0000E+00
Aerosols (kg)		9.7795E-02	0.0000E+00

Environment Integral Nuclide Release:

Time (h) =		Ci	kg	Atoms	Bq
8.0000	Kr-85	3.6121E+00	9.2067E-06	6.5228E+19	1.3365E+11
	Kr-85m	1.9398E+01	2.3571E-09	1.6700E+16	7.1771E+11
	Kr-87	1.6469E+00	5.8143E-11	4.0246E+14	6.0936E+10
	Kr-88	2.5755E+01	2.0540E-09	1.4056E+16	9.5295E+11
	Rb-86	5.4850E-02	6.7410E-10	4.7204E+15	2.0294E+09
	Sr-89	4.0671E-03	1.3999E-10	9.4726E+14	1.5048E+08
	I-131	4.1178E+01	3.3215E-07	1.5269E+18	1.5236E+12
	I-132	5.4274E+00	5.2580E-10	2.3988E+15	2.0081E+11
	I-133	6.3422E+01	5.5987E-08	2.5350E+17	2.3466E+12
	I-134	1.6245E-01	6.0894E-12	2.7367E+13	6.0105E+09
	I-135	3.3581E+01	9.5622E-09	4.2655E+16	1.2425E+12
	Xe-133	4.8635E+02	2.5983E-06	1.1765E+19	1.7995E+13
	Xe-135	1.1989E+02	4.6945E-08	2.0942E+17	4.4358E+12
	Cs-134	5.7728E+00	4.4618E-06	2.0052E+19	2.1359E+11
	Cs-136	1.6357E+00	2.2319E-08	9.8828E+16	6.0523E+10
	Cs-137	3.1182E+00	3.5849E-05	1.5758E+20	1.1537E+11
	I-130	1.3535E+00	6.9397E-10	3.2148E+15	5.0079E+10
	Kr-83m	2.9397E+00	1.4248E-10	1.0338E+15	1.0877E+11
	Xe-131m	2.8222E+00	3.3693E-08	1.5489E+17	1.0442E+11
	Xe-133m	1.4674E+01	3.2702E-08	1.4807E+17	5.4293E+11
	Xe-135m	5.7440E+00	6.3057E-11	2.8129E+14	2.1253E+11
	Cs-138	9.0840E-03	2.1468E-13	9.3683E+11	3.3611E+08
	Cs-134m	2.0609E-01	2.5556E-11	1.1485E+14	7.6253E+09
	Rb-88	2.9358E+01	2.4458E-10	1.6737E+15	1.0863E+12
	Ba-137m	3.4566E+00	6.4272E-12	2.8252E+13	1.2789E+11
	Br-82	2.5565E-01	2.3614E-10	1.7342E+15	9.4591E+09
	Br-83	5.0650E-01	3.2061E-11	2.3262E+14	1.8740E+10
	Br-84	2.5757E-04	3.6591E-15	2.6233E+10	9.5301E+06

Environment Transport Group Inventory:

		Present Release	Release Rate/s	Integral Release
Time (h) =	8.0000			
Noble gases (atoms)		1.9387E+17	2.6927E+15	7.7538E+19
Elemental I (atoms)		1.0367E+10	1.4399E+08	1.2934E+16
Organic I (atoms)		1.0399E+13	1.4443E+11	4.1600E+15
Aerosols (kg)		6.6524E-08	9.2395E-10	4.0729E-05

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway Filter
Time (h) =	8.0000
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =		Ci	kg	Atoms	Bq
8.0000	Rb-86	2.3568E-05	2.8965E-13	2.0283E+12	8.7202E+05
	Sr-89	1.7476E-06	6.0153E-14	4.0702E+11	6.4661E+04
	I-131	1.7702E-02	1.4279E-10	6.5639E+14	6.5497E+08
	I-132	2.3331E-03	2.2603E-13	1.0312E+12	8.6326E+07

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

I-133	2.7264E-02	2.4068E-11	1.0898E+14	1.0088E+09
I-134	6.9832E-05	2.6177E-15	1.1764E+10	2.5838E+06
I-135	1.4436E-02	4.1106E-12	1.8337E+13	5.3413E+08
Cs-134	2.4805E-03	1.9172E-09	8.6161E+15	9.1779E+07
Cs-136	7.0286E-04	9.5900E-12	4.2465E+13	2.6006E+07
Cs-137	1.3398E-03	1.5404E-08	6.7710E+16	4.9574E+07
I-130	5.8184E-04	2.9833E-13	1.3820E+12	2.1528E+07
Cs-138	3.5204E-06	8.3195E-17	3.6305E+08	1.3025E+05
Cs-134m	8.8553E-05	1.0981E-14	4.9349E+10	3.2765E+06
Rb-88	6.7076E-04	5.5879E-15	3.8240E+10	2.4818E+07
Ba-137m	1.4852E-03	2.7617E-15	1.2140E+10	5.4954E+07
Br-82	1.0990E-04	1.0151E-13	7.4551E+11	4.0663E+06
Br-83	2.1774E-04	1.3783E-14	1.0000E+11	8.0562E+06
Br-84	1.1072E-07	1.5730E-18	1.1277E+07	4.0968E+03

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.9389E+12
Organic I (atoms)	1.7668E+12
Aerosols (kg)	1.7501E-08

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 8.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 8.0000	Ci	kg	Atoms	Bq
Kr-85	8.8229E-05	2.2488E-10	1.5933E+15	3.2645E+06
Kr-85m	4.7380E-04	5.7574E-14	4.0790E+11	1.7531E+07
Kr-87	4.0227E-05	1.4202E-15	9.8304E+09	1.4884E+06
Kr-88	6.2910E-04	5.0170E-14	3.4333E+11	2.3277E+07
Rb-86	5.4815E-08	6.7368E-16	4.7174E+09	2.0282E+03
Sr-89	4.0646E-09	1.3991E-16	9.4667E+08	1.5039E+02
I-131	4.0909E-05	3.2998E-13	1.5169E+12	1.5136E+06
I-132	5.3919E-06	5.2236E-16	2.3831E+09	1.9950E+05
I-133	6.3007E-05	5.5620E-14	2.5184E+11	2.3313E+06
I-134	1.6138E-07	6.0495E-18	2.7187E+07	5.9711E+03
I-135	3.3361E-05	9.4996E-15	4.2376E+10	1.2344E+06
Xe-133	1.1954E-02	6.3864E-11	2.8917E+14	4.4230E+08
Xe-135	3.4571E-03	1.3538E-12	6.0389E+12	1.2791E+08
Cs-134	5.7692E-06	4.4590E-12	2.0040E+13	2.1346E+05
Cs-136	1.6347E-06	2.2305E-14	9.8766E+10	6.0485E+04
Cs-137	3.1162E-06	3.5826E-11	1.5748E+14	1.1530E+05
I-130	1.3446E-06	6.8943E-16	3.1937E+09	4.9751E+04
Kr-83m	1.1098E-04	5.3790E-15	3.9028E+10	4.1063E+06
Xe-131m	6.9173E-05	8.2584E-13	3.7964E+12	2.5594E+06
Xe-133m	3.6373E-04	8.1062E-13	3.6704E+12	1.3458E+07
Xe-135m	1.4581E-03	1.6007E-14	7.1403E+10	5.3949E+07
Cs-138	9.1322E-09	2.1582E-19	9.4180E+05	3.3789E+02
Cs-134m	2.0596E-07	2.5540E-17	1.1478E+08	7.6205E+03
Rb-88	2.6004E-04	2.1663E-15	1.4825E+10	9.6216E+06
Ba-137m	3.4544E-06	6.4232E-18	2.8235E+07	1.2781E+05
Br-82	2.5398E-07	2.3459E-16	1.7229E+09	9.3972E+03
Br-83	5.0318E-07	3.1852E-17	2.3110E+08	1.8618E+04

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Transport Group Inventory:

Time (h) =	8.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)		1.8968E+15	0.0000E+00	0.0000E+00
Elemental I (atoms)		8.4696E+06	0.0000E+00	0.0000E+00
Organic I (atoms)		6.2339E+09	0.0000E+00	0.0000E+00
Aerosols (kg)		4.0706E-11	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		1.9597E-06	2.4085E-14	1.6865E+11	7.2509E+04
Sr-89		1.4531E-07	5.0018E-15	3.3844E+10	5.3766E+03
I-131		1.4824E-03	1.1957E-11	5.4968E+13	5.4849E+07
I-132		1.9538E-04	1.8928E-14	8.6356E+10	7.2292E+06
I-133		2.2832E-03	2.0155E-12	9.1259E+12	8.4477E+07
I-134		5.8479E-06	2.1921E-16	9.8518E+08	2.1637E+05
I-135		1.2089E-03	3.4423E-13	1.5356E+12	4.4729E+07
Cs-134		2.0626E-04	1.5941E-10	7.1643E+14	7.6315E+06
Cs-136		5.8443E-05	7.9741E-13	3.5310E+12	2.1624E+06
Cs-137		1.1141E-04	1.2808E-09	5.6301E+15	4.1221E+06
I-130		4.8724E-05	2.4983E-14	1.1573E+11	1.8028E+06
Cs-138		3.5760E-07	8.4511E-18	3.6879E+07	1.3231E+04
Cs-134m		7.3633E-06	9.1307E-16	4.1034E+09	2.7244E+05
Rb-88		2.7374E-04	2.2805E-15	1.5606E+10	1.0128E+07
Ba-137m		1.2350E-04	2.2964E-16	1.0094E+09	4.5695E+06
Br-82		9.2033E-06	8.5008E-15	6.2431E+10	3.4052E+05
Br-83		1.8234E-05	1.1542E-15	8.3743E+09	6.7465E+05
Br-84		9.2724E-09	1.3173E-19	9.4438E+05	3.4308E+02

Deposition Recirculating

Time (h) =	8.0000	Surfaces	Filter
Noble gases (atoms)		0.0000E+00	0.0000E+00
Elemental I (atoms)		0.0000E+00	9.6859E+11
Organic I (atoms)		0.0000E+00	1.3776E+11
Aerosols (kg)		0.0000E+00	1.4552E-09

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) =	8.0000	Pathway Filter
Noble gases (atoms)		0.0000E+00
Elemental I (atoms)		0.0000E+00
Organic I (atoms)		0.0000E+00
Aerosols (kg)		0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	8.0000	Ci	kg	Atoms	Bq
Rb-86		2.3568E-05	2.8965E-13	2.0283E+12	8.7202E+05
Sr-89		1.7476E-06	6.0153E-14	4.0702E+11	6.4661E+04
I-131		1.7702E-02	1.4279E-10	6.5639E+14	6.5497E+08
I-132		2.3331E-03	2.2603E-13	1.0312E+12	8.6326E+07
I-133		2.7264E-02	2.4068E-11	1.0898E+14	1.0088E+09
I-134		6.9832E-05	2.6177E-15	1.1764E+10	2.5838E+06
I-135		1.4436E-02	4.1106E-12	1.8337E+13	5.3413E+08
Cs-134		2.4805E-03	1.9172E-09	8.6161E+15	9.1779E+07
Cs-136		7.0286E-04	9.5900E-12	4.2465E+13	2.6006E+07
Cs-137		1.3398E-03	1.5404E-08	6.7710E+16	4.9574E+07
I-130		5.8184E-04	2.9833E-13	1.3820E+12	2.1528E+07
Cs-138		3.5204E-06	8.3195E-17	3.6305E+08	1.3025E+05
Cs-134m		8.8553E-05	1.0981E-14	4.9349E+10	3.2765E+06
Rb-88		6.7076E-04	5.5879E-15	3.8240E+10	2.4818E+07
Ba-137m		1.4852E-03	2.7617E-15	1.2140E+10	5.4954E+07
Br-82		1.0990E-04	1.0151E-13	7.4551E+11	4.0663E+06
Br-83		2.1774E-04	1.3783E-14	1.0000E+11	8.0562E+06
Br-84		1.1072E-07	1.5730E-18	1.1277E+07	4.0968E+03

Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	8.0000	Pathway Filter
------------	--------	----------------

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 5.9389E+12  
 Organic I (atoms) 1.7668E+12  
 Aerosols (kg) 1.7501E-08

Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 8.0000 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Exhaust Transport Group Inventory:

Time (h) = 8.0000 Pathway Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
8.0000				
Rb-86	2.5528E-05	3.1373E-13	2.1969E+12	9.4453E+05
Sr-89	1.8929E-06	6.5155E-14	4.4087E+11	7.0037E+04
I-131	1.9184E-02	1.5474E-10	7.1136E+14	7.0982E+08
I-132	2.5285E-03	2.4496E-13	1.1176E+12	9.3555E+07
I-133	2.9547E-02	2.6083E-11	1.1810E+14	1.0932E+09
I-134	7.5680E-05	2.8369E-15	1.2750E+10	2.8002E+06
I-135	1.5645E-02	4.4549E-12	1.9872E+13	5.7886E+08
Cs-134	2.6868E-03	2.0766E-09	9.3325E+15	9.9410E+07
Cs-136	7.6130E-04	1.0387E-11	4.5996E+13	2.8168E+07
Cs-137	1.4512E-03	1.6684E-08	7.3340E+16	5.3696E+07
I-130	6.3056E-04	3.2331E-13	1.4977E+12	2.3331E+07
Cs-138	3.8780E-06	9.1646E-17	3.9993E+08	1.4348E+05
Cs-134m	9.5917E-05	1.1894E-14	5.3453E+10	3.5489E+06
Rb-88	9.4450E-04	7.8683E-15	5.3846E+10	3.4947E+07
Ba-137m	1.6087E-03	2.9913E-15	1.3149E+10	5.9523E+07
Br-82	1.1910E-04	1.1001E-13	8.0794E+11	4.4068E+06
Br-83	2.3597E-04	1.4937E-14	1.0838E+11	8.7308E+06
Br-84	1.2000E-07	1.7047E-18	1.2222E+07	4.4399E+03

Detailed model information at time (H) = 24.0000

EAB Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	1.7501E-02	3.4060E+00	4.0604E-02	1.4623E-01
Accumulated dose (rem)	8.2909E-02	1.4902E+01	1.7117E-01	6.4253E-01

LPZ Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	6.6239E-04	1.2891E-01	1.5368E-03	5.5347E-03
Accumulated dose (rem)	6.6347E-03	1.0423E+00	1.3249E-02	4.5735E-02

Control Room Doses:

Time (h) =	Whole Body	Thyroid	Skin	TEDE
24.0000				
Delta dose (rem)	2.8560E-04	2.0855E-01	2.1257E-02	8.2072E-03
Accumulated dose (rem)	1.5643E-03	1.3931E+00	1.0964E-01	5.4384E-02

Containment Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
24.0000				
Kr-85	1.0827E+04	2.7596E-02	1.9551E+23	4.0060E+14
Kr-85m	4.8912E+03	5.9435E-07	4.2109E+18	1.8097E+14
Kr-87	8.0522E-01	2.8427E-11	1.9677E+14	2.9793E+10
Kr-88	1.5549E+03	1.2400E-07	8.4859E+17	5.7531E+13
Rb-86	2.1148E+01	2.5991E-07	1.8200E+18	7.8247E+11

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Sr-89	1.5928E+00	5.4825E-08	3.7097E+17	5.8934E+10
I-131	1.5487E+04	1.2492E-04	5.7428E+20	5.7303E+14
I-132	1.7407E+01	1.6864E-09	7.6938E+15	6.4408E+11
I-133	1.4823E+04	1.3085E-05	5.9250E+19	5.4846E+14
I-134	2.0744E-04	7.7760E-15	3.4946E+10	7.6752E+06
I-135	2.4986E+03	7.1147E-07	3.1738E+18	9.2448E+13
Xe-133	1.3581E+06	7.2554E-03	3.2852E+22	5.0249E+16
Xe-135	1.5413E+05	6.0354E-05	2.6923E+20	5.7028E+15
Cs-134	2.2802E+03	1.7624E-03	7.9203E+21	8.4367E+13
Cs-136	6.2409E+02	8.5152E-06	3.7706E+19	2.3091E+13
Cs-137	1.2323E+03	1.4168E-02	6.2277E+22	4.5596E+13
I-130	2.1980E+02	1.1270E-07	5.2207E+17	8.1327E+12
Kr-83m	9.4476E+01	4.5791E-09	3.3224E+16	3.4956E+12
Xe-131m	8.2193E+03	9.8128E-05	4.5110E+20	3.0411E+14
Xe-133m	3.6927E+04	8.2297E-05	3.7264E+20	1.3663E+15
Xe-135m	4.6926E+03	5.1515E-08	2.2980E+17	1.7363E+14
Cs-138	3.8271E-09	9.0445E-20	3.9469E+05	1.4160E+02
Cs-134m	1.7785E+00	2.2053E-10	9.9111E+14	6.5803E+10
Rb-88	1.6978E+03	1.4144E-08	9.6791E+16	6.2818E+13
Ba-137m	1.3661E+03	2.5401E-09	1.1166E+16	5.0545E+13
Br-82	7.4383E+01	6.8705E-08	5.0457E+17	2.7522E+12
Br-83	1.9480E+00	1.2331E-10	8.9466E+14	7.2075E+10

Containment Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 24.0000			
Noble gases (atoms)	2.2947E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	9.9428E+06	0.0000E+00	0.0000E+00
Organic I (atoms)	1.0910E+19	0.0000E+00	0.0000E+00
Aerosols (kg)	1.6075E-02	0.0000E+00	0.0000E+00

	Surfaces	Recirculating Filter
Time (h) = 24.0000		
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	3.5311E+20	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	1.6124E-01	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Kr-85	1.0832E+01	2.7610E-05	1.9561E+20	4.0079E+11
Kr-85m	4.8936E+00	5.9464E-10	4.2130E+15	1.8106E+11
Kr-87	8.0562E-04	2.8441E-14	1.9687E+11	2.9808E+07
Kr-88	1.5557E+00	1.2406E-10	8.4901E+14	5.7559E+10
Rb-86	8.8349E-02	1.0858E-09	7.6033E+15	3.2689E+09
Sr-89	6.6542E-03	2.2904E-10	1.5498E+15	2.4621E+08
I-131	6.4134E+01	5.1731E-07	2.3781E+18	2.3729E+12
I-132	7.2085E-02	6.9836E-12	3.1861E+13	2.6672E+09
I-133	6.1384E+01	5.4188E-08	2.4536E+17	2.2712E+12
I-135	1.0347E+01	2.9463E-09	1.3143E+16	3.8283E+11
Xe-133	1.3521E+03	7.2233E-06	3.2706E+19	5.0026E+13
Xe-135	1.3809E+02	5.4074E-08	2.4122E+17	5.1094E+12
Cs-134	9.5259E+00	7.3626E-06	3.3088E+19	3.5246E+11
Cs-136	2.6072E+00	3.5574E-08	1.5752E+17	9.6468E+10
Cs-137	5.1483E+00	5.9188E-05	2.6018E+20	1.9049E+11
I-130	9.1022E-01	4.6670E-10	2.1619E+15	3.3678E+10
Kr-83m	6.3706E-02	3.0877E-12	2.2403E+13	2.3571E+09
Xe-131m	8.1943E+00	9.7829E-08	4.4973E+17	3.0319E+11
Xe-133m	3.6495E+01	8.1333E-08	3.6827E+17	1.3503E+12
Xe-135m	1.7693E+00	1.9423E-11	8.6643E+13	6.5463E+10
Cs-134m	7.4299E-03	9.2133E-13	4.1406E+12	2.7491E+08
Rb-88	1.7765E+00	1.4799E-11	1.0128E+14	6.5729E+10
Ba-137m	5.7070E+00	1.0612E-11	4.6647E+13	2.1116E+11
Br-82	3.0802E-01	2.8451E-10	2.0895E+15	1.1397E+10
Br-83	8.0667E-03	5.1062E-13	3.7048E+12	2.9847E+08

Environment Transport Group Inventory:

Time (h) = 24.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	1.9122E+17	2.6558E+15	2.2938E+20

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Elemental I (atoms)	8.3929E+00	1.1657E-01	1.1311E+16
Organic I (atoms)	9.0900E+12	1.2625E+11	1.0912E+16
Aerosols (kg)	1.3407E-08	1.8621E-10	6.7158E-05

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	2.8676E-05	3.5243E-13	2.4679E+12	1.0610E+06
Sr-89	2.1598E-06	7.4343E-14	5.0304E+11	7.9914E+04
I-131	2.0834E-02	1.6805E-10	7.7253E+14	7.7086E+08
I-132	2.3417E-05	2.2686E-15	1.0350E+10	8.6643E+05
I-133	1.9941E-02	1.7603E-11	7.9705E+13	7.3781E+08
I-135	3.3612E-03	9.5710E-13	4.2695E+12	1.2436E+08
Cs-134	3.0919E-03	2.3898E-09	1.0740E+16	1.1440E+08
Cs-136	8.4626E-04	1.1547E-11	5.1129E+13	3.1312E+07
Cs-137	1.6710E-03	1.9211E-08	8.4448E+16	6.1829E+07
I-130	2.9569E-04	1.5161E-13	7.0231E+11	1.0940E+07
Cs-134m	2.4116E-06	2.9905E-16	1.3439E+09	8.9229E+04
Rb-88	5.3956E-06	4.4949E-17	3.0760E+08	1.9964E+05
Ba-137m	1.8524E-03	3.4444E-15	1.5141E+10	6.8539E+07
Br-82	1.0006E-04	9.2424E-14	6.7877E+11	3.7023E+06
Br-83	2.6205E-06	1.6588E-16	1.2035E+09	9.6957E+04

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.1936E+12
Organic I (atoms)	2.7320E+12
Aerosols (kg)	2.1798E-08

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Kr-85	3.4963E-05	8.9114E-11	6.3136E+14	1.2936E+06
Kr-85m	1.5795E-05	1.9193E-15	1.3598E+10	5.8441E+05
Kr-87	2.6002E-09	9.1798E-20	6.3542E+05	9.6209E+01
Kr-88	5.0211E-06	4.0043E-16	2.7403E+09	1.8578E+05
Rb-86	4.0361E-09	4.9603E-17	3.4734E+08	1.4933E+02
Sr-89	3.0399E-10	1.0463E-17	7.0800E+07	1.1247E+01
I-131	2.9547E-06	2.3833E-14	1.0956E+11	1.0932E+05
I-132	3.3210E-09	3.2174E-19	1.4678E+06	1.2288E+02
I-133	2.8280E-06	2.4965E-15	1.1304E+10	1.0464E+05
I-135	4.7668E-07	1.3574E-16	6.0550E+08	1.7637E+04
Xe-133	4.4344E-03	2.3690E-11	1.0727E+14	1.6407E+08



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Xe-135	6.0677E-04	2.3760E-13	1.0599E+12	2.2450E+07
Cs-134	4.3518E-07	3.3635E-13	1.5116E+12	1.6102E+04
Cs-136	1.1911E-07	1.6251E-15	7.1961E+09	4.4070E+03
Cs-137	2.3519E-07	2.7039E-12	1.1886E+13	8.7021E+03
I-130	4.1934E-08	2.1501E-17	9.9602E+07	1.5516E+03
Kr-83m	7.3991E-07	3.5862E-17	2.6020E+08	2.7377E+04
Xe-131m	2.6796E-05	3.1991E-13	1.4706E+12	9.9146E+05
Xe-133m	1.2273E-04	2.7352E-13	1.2385E+12	4.5411E+06
Xe-135m	3.2732E-04	3.5933E-15	1.6029E+10	1.2111E+07
Cs-134m	3.3942E-10	4.2089E-20	1.8915E+05	1.2559E+01
Rb-88	2.0626E-06	1.7183E-17	1.1759E+08	7.6317E+04
Ba-137m	2.6072E-07	4.8478E-19	2.1310E+06	9.6465E+03
Br-82	1.4191E-08	1.3108E-17	9.6263E+07	5.2506E+02
Br-83	3.7164E-10	2.3525E-20	1.7068E+05	1.3751E+01

Control Room Transport Group Inventory:

Time (h) = 24.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	7.4243E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.5644E-03	0.0000E+00	0.0000E+00
Organic I (atoms)	2.0380E+09	0.0000E+00	0.0000E+00
Aerosols (kg)	3.0680E-12	0.0000E+00	0.0000E+00

Recirculating Filter Inventory

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	2.3015E-06	2.8285E-14	1.9806E+11	8.5154E+04
Sr-89	1.7334E-07	5.9665E-15	4.0372E+10	6.4136E+03
I-131	1.6820E-03	1.3567E-11	6.2369E+13	6.2234E+07
I-132	1.8905E-06	1.8315E-16	8.3559E+08	6.9950E+04
I-133	1.6099E-03	1.4211E-12	6.4348E+12	5.9566E+07
I-135	2.7136E-04	7.7270E-14	3.4469E+11	1.0040E+07
Cs-134	2.4815E-04	1.9179E-10	8.6194E+14	9.1815E+06
Cs-136	6.7918E-05	9.2669E-13	4.1034E+12	2.5130E+06
Cs-137	1.3411E-04	1.5418E-09	6.7775E+15	4.9621E+06
I-130	2.3872E-05	1.2240E-14	5.6700E+10	8.8326E+05
Cs-134m	1.9355E-07	2.4000E-17	1.0786E+08	7.1612E+03
Rb-88	2.1704E-06	1.8081E-17	1.2373E+08	8.0306E+04
Ba-137m	1.4867E-04	2.7643E-16	1.2151E+09	5.5007E+06
Br-82	8.0783E-06	7.4617E-15	5.4799E+10	2.9890E+05
Br-83	2.1156E-07	1.3392E-17	9.7165E+07	7.8277E+03

Time (h) = 24.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	8.4704E+11
Organic I (atoms)	0.0000E+00	1.9841E+11
Aerosols (kg)	0.0000E+00	1.7495E-09

Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 24.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	2.8676E-05	3.5243E-13	2.4679E+12	1.0610E+06
Sr-89	2.1598E-06	7.4343E-14	5.0304E+11	7.9914E+04
I-131	2.0834E-02	1.6805E-10	7.7253E+14	7.7086E+08
I-132	2.3417E-05	2.2686E-15	1.0350E+10	8.6643E+05
I-133	1.9941E-02	1.7603E-11	7.9705E+13	7.3781E+08
I-135	3.3612E-03	9.5710E-13	4.2695E+12	1.2436E+08
Cs-134	3.0919E-03	2.3898E-09	1.0740E+16	1.1440E+08
Cs-136	8.4626E-04	1.1547E-11	5.1129E+13	3.1312E+07
Cs-137	1.6710E-03	1.9211E-08	8.4448E+16	6.1829E+07
I-130	2.9569E-04	1.5161E-13	7.0231E+11	1.0940E+07
Cs-134m	2.4116E-06	2.9905E-16	1.3439E+09	8.9229E+04

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Rb-88	5.3956E-06	4.4949E-17	3.0760E+08	1.9964E+05
Ba-137m	1.8524E-03	3.4444E-15	1.5141E+10	6.8539E+07
Br-82	1.0006E-04	9.2424E-14	6.7877E+11	3.7023E+06
Br-83	2.6205E-06	1.6588E-16	1.2035E+09	9.6957E+04

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	5.1936E+12
Organic I (atoms)	2.7320E+12
Aerosols (kg)	2.1798E-08

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 24.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Total Filter Nuclide Inventory:

Time (h) = 24.0000	Ci	kg	Atoms	Bq
Rb-86	3.0978E-05	3.8072E-13	2.6660E+12	1.1462E+06
Sr-89	2.3332E-06	8.0310E-14	5.4341E+11	8.6327E+04
I-131	2.2516E-02	1.8162E-10	8.3490E+14	8.3309E+08
I-132	2.5308E-05	2.4518E-15	1.1186E+10	9.3638E+05
I-133	2.1551E-02	1.9024E-11	8.6140E+13	7.9738E+08
I-135	3.6325E-03	1.0344E-12	4.6141E+12	1.3440E+08
Cs-134	3.3401E-03	2.5816E-09	1.1602E+16	1.2358E+08
Cs-136	9.1418E-04	1.2473E-11	5.5232E+13	3.3825E+07
Cs-137	1.8052E-03	2.0753E-08	9.1226E+16	6.6791E+07
I-130	3.1956E-04	1.6385E-13	7.5901E+11	1.1824E+07
Cs-134m	2.6052E-06	3.2305E-16	1.4518E+09	9.6391E+04
Rb-88	7.5660E-06	6.3030E-17	4.3134E+08	2.7994E+05
Ba-137m	2.0011E-03	3.7208E-15	1.6356E+10	7.4039E+07
Br-82	1.0814E-04	9.9886E-14	7.3357E+11	4.0012E+06
Br-83	2.8320E-06	1.7927E-16	1.3007E+09	1.0478E+05

Detailed model information at time (H) = 96.0000

EAB Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	7.0791E-03	5.1523E-01	2.2088E-02	2.6642E-02
Accumulated dose (rem)	8.9988E-02	1.5418E+01	1.9326E-01	6.6917E-01

LPZ Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.1387E-04	8.2877E-03	3.5530E-04	4.2854E-04
Accumulated dose (rem)	6.7486E-03	1.0506E+00	1.3605E-02	4.6164E-02

Control Room Doses:

Time (h) = 96.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	6.1898E-05	1.1332E-02	5.8253E-03	4.9260E-04
Accumulated dose (rem)	1.6262E-03	1.4044E+00	1.1546E-01	5.4876E-02

Containment Compartment Atmosphere Nuclide Inventory:

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Kr-85	1.0805E+04	2.7540E-02	1.9512E+23	3.9979E+14
Kr-85m	7.0922E-02	8.6180E-12	6.1057E+13	2.6241E+09
Kr-88	3.6249E-05	2.8909E-15	1.9783E+10	1.3412E+06
Rb-86	1.4103E-02	1.7332E-10	1.2137E+15	5.2179E+08
Sr-89	1.1395E-03	3.9222E-11	2.6539E+14	4.2161E+07
I-131	2.1302E+02	1.7182E-06	7.8988E+18	7.8817E+12
I-133	2.3971E+01	2.1161E-08	9.5814E+16	8.8693E+11
I-135	2.3414E-02	6.6670E-12	2.9740E+13	8.6630E+08
Xe-133	9.3894E+05	5.0162E-03	2.2713E+22	3.4741E+16
Xe-135	9.1041E+02	3.5650E-07	1.5903E+18	3.3685E+13
Cs-134	1.6951E+00	1.3102E-06	5.8880E+18	6.2720E+10
Cs-136	3.9695E-01	5.4161E-09	2.3983E+16	1.4687E+10
Cs-137	9.1849E-01	1.0560E-05	4.6417E+19	3.3984E+10
I-130	6.9061E-02	3.5410E-11	1.6403E+14	2.5552E+09
Kr-83m	8.1283E-08	3.9396E-18	2.8584E+07	3.0075E+03
Xe-131m	7.1671E+03	8.5566E-05	3.9335E+20	2.6518E+14
Xe-133m	1.5206E+04	3.3887E-05	1.5344E+20	5.6260E+14
Xe-135m	2.4684E+00	2.7098E-11	1.2088E+14	9.1330E+10
Rb-88	3.9581E-05	3.2974E-16	2.2565E+09	1.4645E+06
Ba-137m	1.0182E+00	1.8932E-12	8.3220E+12	3.7672E+10
Br-82	3.2229E-01	2.9769E-10	2.1862E+15	1.1925E+10

Containment Transport Group Inventory:

Time (h) = 96.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	2.1838E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.5646E-34	0.0000E+00	0.0000E+00
Organic I (atoms)	7.6681E+18	0.0000E+00	0.0000E+00
Aerosols (kg)	1.1947E-05	0.0000E+00	0.0000E+00

Time (h) = 96.0000	Surfaces	Filter	Deposition Recirculating
Noble gases (atoms)	0.0000E+00	0.0000E+00	
Elemental I (atoms)	2.4856E+20	0.0000E+00	
Organic I (atoms)	0.0000E+00	0.0000E+00	
Aerosols (kg)	1.7675E-01	0.0000E+00	

Environment Integral Nuclide Release:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Kr-85	2.7046E+01	6.8937E-05	4.8841E+20	1.0007E+12
Kr-85m	1.7753E-04	2.1572E-14	1.5283E+11	6.5685E+06
Rb-86	8.2969E-02	1.0197E-09	7.1403E+15	3.0699E+09
Sr-89	6.7039E-03	2.3075E-10	1.5614E+15	2.4804E+08
I-131	5.2270E+01	4.2162E-07	1.9382E+18	1.9340E+12
I-133	5.8820E+00	5.1924E-09	2.3511E+16	2.1763E+11
I-135	5.7452E-03	1.6359E-12	7.2977E+12	2.1257E+08
Xe-133	2.3239E+03	1.2415E-05	5.6214E+19	8.5983E+13
Xe-135	1.9004E+00	7.4416E-10	3.3196E+15	7.0314E+10
Cs-134	9.9729E+00	7.7081E-06	3.4641E+19	3.6900E+11
Cs-136	2.3354E+00	3.1864E-08	1.4110E+17	8.6409E+10
Cs-137	5.4038E+00	6.2125E-05	2.7308E+20	1.9994E+11
I-130	1.6946E-02	8.6888E-12	4.0250E+13	6.2700E+08
Xe-131m	1.7540E+01	2.0940E-07	9.6263E+17	6.4897E+11
Xe-133m	3.6746E+01	8.1893E-08	3.7081E+17	1.3596E+12
Xe-135m	9.6478E-04	1.0591E-14	4.7246E+10	3.5697E+07
Ba-137m	5.9902E+00	1.1138E-11	4.8961E+13	2.2164E+11
Br-82	7.9082E-02	7.3046E-11	5.3645E+14	2.9260E+09

Environment Transport Group Inventory:

Time (h) = 96.0000	Present Release	Release Rate/s	Integral Release
Noble gases (atoms)	9.0992E+16	1.2638E+15	5.4596E+20
Elemental I (atoms)	6.6040E-41	9.1723E-43	7.9620E+15
Organic I (atoms)	3.1946E+12	4.4370E+10	1.9191E+16
Aerosols (kg)	4.9822E-12	6.9198E-14	7.0287E-05

Control Room Unfiltered Makeup Transport Group Inventory:

Pathway

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (h) = 96.0000 Filter  
 Noble gases (atoms) 0.0000E+00  
 Elemental I (atoms) 0.0000E+00  
 Organic I (atoms) 0.0000E+00  
 Aerosols (kg) 0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) =	Ci	kg	Atoms	Bq
Rb-86	2.6113E-05	3.2092E-13	2.2473E+12	9.6617E+05
Sr-89	2.1099E-06	7.2624E-14	4.9141E+11	7.8066E+04
I-131	1.6408E-02	1.3235E-10	6.0841E+14	6.0709E+08
I-133	1.8464E-03	1.6299E-12	7.3801E+12	6.8316E+07
I-135	1.8034E-06	5.1353E-16	2.2908E+09	6.6727E+04
Cs-134	3.1387E-03	2.4259E-09	1.0902E+16	1.1613E+08
Cs-136	7.3500E-04	1.0029E-11	4.4407E+13	2.7195E+07
Cs-137	1.7007E-03	1.9552E-08	8.5947E+16	6.2926E+07
I-130	5.3194E-06	2.7274E-15	1.2635E+10	1.9682E+05
Ba-137m	1.8853E-03	3.5055E-15	1.5409E+10	6.9755E+07
Br-82	2.4824E-05	2.2929E-14	1.6839E+11	9.1849E+05

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) =	Pathway
96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.6559E+12
Organic I (atoms)	3.2687E+12
Aerosols (kg)	2.2121E-08

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) =	Pathway
96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) =	Pathway
96.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) =	Ci	kg	Atoms	Bq
Kr-85	1.2622E-05	3.2173E-11	2.2794E+14	4.6703E+05
I-131	1.5473E-08	1.2480E-16	5.7373E+08	5.7249E+02
I-133	1.7411E-09	1.5370E-18	6.9595E+06	6.4422E+01
Xe-133	1.1015E-03	5.8846E-12	2.6645E+13	4.0755E+07
Xe-135	1.1232E-06	4.3981E-16	1.9619E+09	4.1557E+04
Cs-134	1.2568E-10	9.7139E-17	4.3656E+08	4.6502E+00
Cs-136	2.9431E-11	4.0156E-19	1.7781E+06	1.0889E+00
Cs-137	6.8100E-11	7.8292E-16	3.4415E+09	2.5197E+00
Xe-131m	8.5765E-06	1.0239E-13	4.7071E+11	3.1733E+05
Xe-133m	1.8092E-05	4.0320E-14	1.8257E+11	6.6940E+05
Xe-135m	1.7331E-07	1.9025E-18	8.4870E+06	6.4124E+03
Br-82	2.3409E-11	2.1622E-20	1.5880E+05	8.6614E-01

## Control Room Transport Group Inventory:

Time (h) =	Atmosphere	Sump	Overlying Pool
96.0000			
Noble gases (atoms)	2.5524E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	1.5414E+44	0.0000E+00	0.0000E+00
Organic I (atoms)	5.5648E+08	0.0000E+00	0.0000E+00
Aerosols (kg)	8.8578E-16	0.0000E+00	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Recirculating Filter Inventory

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	2.0926E-06	2.5718E-14	1.8009E+11	7.7427E+04
Sr-89	1.6908E-07	5.8199E-15	3.9380E+10	6.2560E+03
I-131	1.3222E-03	1.0665E-11	4.9028E+13	4.8922E+07
I-133	1.4879E-04	1.3134E-13	5.9472E+11	5.5052E+06
I-135	1.4533E-07	4.1382E-17	1.8460E+08	5.3772E+03
Cs-134	2.5153E-04	1.9441E-10	8.7370E+14	9.3067E+06
Cs-136	5.8902E-05	8.0367E-13	3.5587E+12	2.1794E+06
Cs-137	1.3629E-04	1.5669E-09	6.8876E+15	5.0428E+06
I-130	4.2866E-07	2.1979E-16	1.0181E+09	1.5860E+04
Ba-137m	1.5108E-04	2.8093E-16	1.2349E+09	5.5900E+06
Br-82	2.0004E-06	1.8477E-15	1.3570E+10	7.4016E+04

Time (h) = 96.0000	Deposition Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	5.9625E+11
Organic I (atoms)	0.0000E+00	2.3382E+11
Aerosols (kg)	0.0000E+00	1.7728E-09

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	2.6113E-05	3.2092E-13	2.2473E+12	9.6617E+05
Sr-89	2.1099E-06	7.2624E-14	4.9141E+11	7.8066E+04
I-131	1.6408E-02	1.3235E-10	6.0841E+14	6.0709E+08
I-133	1.8464E-03	1.6299E-12	7.3801E+12	6.8316E+07
I-135	1.8034E-06	5.1353E-16	2.2908E+09	6.6727E+04
Cs-134	3.1387E-03	2.4259E-09	1.0902E+16	1.1613E+08
Cs-136	7.3500E-04	1.0029E-11	4.4407E+13	2.7195E+07
Cs-137	1.7007E-03	1.9552E-08	8.5947E+16	6.2926E+07
I-130	5.3194E-06	2.7274E-15	1.2635E+10	1.9682E+05
Ba-137m	1.8853E-03	3.5055E-15	1.5409E+10	6.9755E+07
Br-82	2.4824E-05	2.2929E-14	1.6839E+11	9.1849E+05

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.6559E+12
Organic I (atoms)	3.2687E+12
Aerosols (kg)	2.2121E-08

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) = 96.0000	Pathway Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Control Room Total Filter Nuclide Inventory:

Time (h) = 96.0000	Ci	kg	Atoms	Bq
Rb-86	2.8205E-05	3.4664E-13	2.4274E+12	1.0436E+06
Sr-89	2.2790E-06	7.8444E-14	5.3079E+11	8.4322E+04
I-131	1.7730E-02	1.4301E-10	6.5744E+14	6.5601E+08
I-133	1.9952E-03	1.7612E-12	7.9748E+12	7.3821E+07
I-135	1.9488E-06	5.5491E-16	2.4754E+09	7.2104E+04
Cs-134	3.3903E-03	2.6203E-09	1.1776E+16	1.2544E+08
Cs-136	7.9391E-04	1.0832E-11	4.7966E+13	2.9375E+07
Cs-137	1.8370E-03	2.1119E-08	9.2835E+16	6.7969E+07
I-130	5.7481E-06	2.9472E-15	1.3653E+10	2.1268E+05
Ba-137m	2.0364E-03	3.7865E-15	1.6644E+10	7.5345E+07
Br-82	2.6825E-05	2.4777E-14	1.8196E+11	9.9251E+05

Detailed model information at time (H) = 720.0000

EAB Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	1.0945E-02	1.4175E-01	3.9033E-02	1.5264E-02
Accumulated dose (rem)	1.0093E-01	1.5559E+01	2.3229E-01	6.8444E-01

LPZ Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	5.1579E-05	6.6800E-04	1.8394E-04	7.1933E-05
Accumulated dose (rem)	6.8002E-03	1.0513E+00	1.3788E-02	4.6236E-02

Control Room Doses:

Time (h) = 720.0000	Whole Body	Thyroid	Skin	TEDE
Delta dose (rem)	3.5125E-05	1.5168E-03	4.2484E-03	8.1342E-05
Accumulated dose (rem)	1.6614E-03	1.4060E+00	1.1971E-01	5.4958E-02

Containment Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Kr-85	1.0616E+04	2.7060E-02	1.9171E+23	3.9281E+14
I-131	2.1431E+01	1.7287E-07	7.9469E+17	7.9296E+11
I-133	2.1130E-08	1.8653E-17	8.4458E+07	7.8181E+02
Xe-133	3.0279E+04	1.6176E-04	7.3244E+20	1.1203E+15
Xe-131m	1.9118E+03	2.2825E-05	1.0493E+20	7.0738E+13
Xe-133m	4.0503E+00	9.0267E-09	4.0872E+16	1.4986E+11
Br-82	1.4556E-06	1.3445E-15	9.8738E+09	5.3856E+04

Containment Transport Group Inventory:

Time (h) = 720.0000	Atmosphere	Sump	Overlying Pool
Noble gases (atoms)	1.9255E+23	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	7.9469E+17	0.0000E+00	0.0000E+00
Aerosols (kg)	9.2763E-33	0.0000E+00	0.0000E+00

Time (h) = 720.0000	Surfaces	Recirculating Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	2.6097E+19	0.0000E+00
Organic I (atoms)	0.0000E+00	0.0000E+00
Aerosols (kg)	1.7504E-01	0.0000E+00

Environment Integral Nuclide Release:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Kr-85	1.6584E+02	4.2269E-04	2.9947E+21	6.1360E+12
I-131	5.8368E+00	4.7080E-08	2.1643E+17	2.1596E+11
Xe-133	4.7181E+02	2.5206E-06	1.1413E+19	1.7457E+13
Xe-131m	2.6955E+01	3.2181E-07	1.4794E+18	9.9734E+11
Xe-133m	6.2676E-02	1.3968E-10	6.3247E+14	2.3190E+09

Environment Transport Group Inventory:

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

	Present	Release	Integral
Time (h) = 720.0000	Release	Rate/s	Release
Noble gases (atoms)	8.0230E+16	1.1143E+15	3.0076E+21
Elemental I (atoms)	0.0000E+00	0.0000E+00	8.3595E+14
Organic I (atoms)	3.3109E+11	4.5985E+09	1.2412E+16
Aerosols (kg)	3.8686E-39	5.3731E-41	6.9604E-05

Control Room Unfiltered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	9.9407E-06	1.2217E-13	8.5549E+11	3.6780E+05
Sr-89	1.4767E-06	5.0828E-14	3.4392E+11	5.4636E+04
I-131	1.7682E-03	1.4262E-11	6.5565E+13	6.5423E+07
Cs-134	3.0646E-03	2.3686E-09	1.0645E+16	1.1339E+08
Cs-136	1.8571E-04	2.5338E-12	1.1220E+13	6.8712E+06
Cs-137	1.6979E-03	1.9521E-08	8.5807E+16	6.2823E+07
Ba-137m	1.8822E-03	3.4998E-15	1.5384E+10	6.9641E+07
Br-82	1.2009E-10	1.1092E-19	8.1463E+05	4.4433E+00

Control Room Filtered Makeup Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.8384E+11
Organic I (atoms)	1.2360E+12
Aerosols (kg)	2.1906E-08

Control Room Unfiltered Inleakage Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Exhaust Transport Group Inventory:

	Pathway
Time (h) = 720.0000	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

Control Room Compartment Atmosphere Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Kr-85	9.1606E-06	2.3349E-11	1.6542E+14	3.3894E+05
I-131	1.1949E-09	9.6382E-18	4.4307E+07	4.4211E+01
Xe-133	2.6127E-05	1.3958E-13	6.3200E+11	9.6669E+05
Xe-131m	1.6717E-06	1.9958E-14	9.1747E+10	6.1852E+04
Xe-133m	3.4949E-09	7.7888E-18	3.5267E+07	1.2931E+02

Control Room Transport Group Inventory:

	Atmosphere	Sump	Overlying Pool
Time (h) = 720.0000			
Noble gases (atoms)	1.6615E+14	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	0.0000E+00	0.0000E+00
Organic I (atoms)	4.4307E+07	0.0000E+00	0.0000E+00
Aerosols (kg)	5.2829E-43	0.0000E+00	0.0000E+00

## Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

## Recirculating Filter Inventory

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	7.9662E-07	9.7904E-15	6.8557E+10	2.9475E+04
Sr-89	1.1834E-07	4.0732E-15	2.7561E+10	4.3784E+03
I-131	1.4230E-04	1.1478E-12	5.2766E+12	5.2652E+06
Cs-134	2.4559E-04	1.8981E-10	8.5305E+14	9.0867E+06
Cs-136	1.4882E-05	2.0306E-13	8.9914E+11	5.5064E+05
Cs-137	1.3607E-04	1.5643E-09	6.8764E+15	5.0345E+06
Ba-137m	1.5084E-04	2.8047E-16	1.2329E+09	5.5809E+06

## Deposition Recirculating

Time (h) = 720.0000	Surfaces	Filter
Noble gases (atoms)	0.0000E+00	0.0000E+00
Elemental I (atoms)	0.0000E+00	6.2601E+10
Organic I (atoms)	0.0000E+00	8.9603E+10
Aerosols (kg)	0.0000E+00	1.7555E-09

## Control Room Unfiltered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Filter Pathway Nuclide Inventory for Control Room Filtered Makeup

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	9.9407E-06	1.2217E-13	8.5549E+11	3.6780E+05
Sr-89	1.4767E-06	5.0828E-14	3.4392E+11	5.4636E+04
I-131	1.7682E-03	1.4262E-11	6.5565E+13	6.5423E+07
Cs-134	3.0646E-03	2.3686E-09	1.0645E+16	1.1339E+08
Cs-136	1.8571E-04	2.5338E-12	1.1220E+13	6.8712E+06
Cs-137	1.6979E-03	1.9521E-08	8.5807E+16	6.2823E+07
Ba-137m	1.8822E-03	3.4998E-15	1.5384E+10	6.9641E+07
Br-82	1.2009E-10	1.1092E-19	8.1463E+05	4.4433E+00

## Control Room Filtered Makeup Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	3.8384E+11
Organic I (atoms)	1.2360E+12
Aerosols (kg)	2.1906E-08

## Control Room Unfiltered Inleakage Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Exhaust Transport Group Inventory:

Time (h) = 720.0000	Pathway
	Filter
Noble gases (atoms)	0.0000E+00
Elemental I (atoms)	0.0000E+00
Organic I (atoms)	0.0000E+00
Aerosols (kg)	0.0000E+00

## Control Room Total Filter Nuclide Inventory:

Time (h) = 720.0000	Ci	kg	Atoms	Bq
Rb-86	1.0737E-05	1.3196E-13	9.2405E+11	3.9728E+05
Sr-89	1.5950E-06	5.4901E-14	3.7148E+11	5.9015E+04
I-131	1.9105E-03	1.5410E-11	7.0842E+13	7.0688E+07
Cs-134	3.3102E-03	2.5584E-09	1.1498E+16	1.2248E+08



Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Cs-136	2.0059E-04	2.7369E-12	1.2119E+13	7.4218E+06
Cs-137	1.8340E-03	2.1085E-08	9.2683E+16	6.7858E+07
Ba-137m	2.0330E-03	3.7803E-15	1.6617E+10	7.5222E+07
Br-82	1.2976E-10	1.1985E-19	8.8019E+05	4.8009E+00

-----  
Transport Group Totals in Model:  
-----

Noble Gases (atoms)	1.9556E+23
Elemental I (atoms)	2.6098E+19
Organic I (atoms)	8.0710E+17
Aerosols (kg)	1.7511E-01

37002

#####  
I-131 Summary  
#####

Time (hr)	Containment I-131 (Curies)	Environment I-131 (Curies)	Control Room I-131 (Curies)
0.000	1.9082E+03	3.9650E-08	1.0308E-10
0.000	1.9081E+05	3.9646E-04	1.0307E-06
0.025	1.9195E+05	1.9942E-01	5.1429E-04
0.300	1.8410E+05	2.3506E+00	2.2735E-04
0.560	1.7756E+05	4.3048E+00	1.4797E-04
0.820	1.7167E+05	6.1901E+00	1.2192E-04
1.080	1.6628E+05	8.0127E+00	1.1177E-04
1.340	1.6127E+05	9.7773E+00	1.0646E-04
1.600	1.5656E+05	1.1488E+01	1.0273E-04
1.860	1.5210E+05	1.3147E+01	9.9582E-05
2.000	1.4979E+05	1.4020E+01	9.8007E-05
2.260	1.4564E+05	1.5606E+01	8.0680E-05
2.520	1.4164E+05	1.7146E+01	7.4169E-05
2.780	1.3779E+05	1.8642E+01	7.0883E-05
3.040	1.3407E+05	2.0096E+01	6.8589E-05
3.300	1.3047E+05	2.1509E+01	6.6629E-05
3.560	1.2698E+05	2.2882E+01	6.4807E-05
3.820	1.2358E+05	2.4216E+01	6.3062E-05
4.080	1.2029E+05	2.5513E+01	6.1375E-05
4.340	1.1709E+05	2.6774E+01	5.9738E-05
4.600	1.1397E+05	2.7999E+01	5.8148E-05
4.860	1.1094E+05	2.9190E+01	5.6601E-05
5.120	1.0800E+05	3.0348E+01	5.5097E-05
5.380	1.0513E+05	3.1473E+01	5.3634E-05
5.640	1.0234E+05	3.2566E+01	5.2210E-05
5.900	9.9626E+04	3.3629E+01	5.0825E-05
6.160	9.6983E+04	3.4661E+01	4.9476E-05
6.420	9.4412E+04	3.5665E+01	4.8164E-05
6.680	9.1908E+04	3.6640E+01	4.6887E-05
6.940	8.9472E+04	3.7587E+01	4.5644E-05
7.200	8.7100E+04	3.8507E+01	4.4434E-05
7.460	8.4792E+04	3.9402E+01	4.3256E-05
7.720	8.2544E+04	4.0270E+01	4.2109E-05
7.980	8.0357E+04	4.1114E+01	4.0993E-05
8.000	8.0191E+04	4.1178E+01	4.0909E-05
8.260	7.8067E+04	4.1997E+01	2.2406E-05
8.520	7.5998E+04	4.2791E+01	1.6704E-05
8.780	7.3985E+04	4.3563E+01	1.4764E-05
9.040	7.2025E+04	4.4313E+01	1.3934E-05
9.300	7.0118E+04	4.5041E+01	1.3436E-05
9.560	6.8261E+04	4.5748E+01	1.3043E-05
9.820	6.6453E+04	4.6434E+01	1.2686E-05
10.080	6.4694E+04	4.7101E+01	1.2347E-05
24.000	1.5487E+04	6.4134E+01	2.9547E-06
96.000	2.1302E+02	5.2270E+01	1.5473E-08
720.000	2.1431E+01	5.8368E+00	1.1949E-09

#####  
Cumulative Dose Summary  
#####

Palisades Design Basis Control Rod Ejection AST Radiological Analysis

Calculation Number: NAI-1149-015 Rev. 2

Time (hr)	EAB		LPZ		Control Room	
	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)	Thyroid (rem)	TEDE (rem)
0.000	1.1310E-08	5.5464E-10	1.3974E-09	6.8533E-11	9.6523E-14	3.6267E-15
0.000	1.1310E-04	5.5463E-06	1.3974E-05	6.8532E-07	6.4350E-08	2.4179E-09
0.025	5.6883E-02	2.7896E-03	7.0286E-03	3.4469E-04	1.2037E-02	4.5237E-04
0.300	6.6961E-01	3.2582E-02	8.2738E-02	4.0259E-03	1.8751E-01	7.1071E-03
0.560	1.2248E+00	5.9048E-01	1.5134E-01	7.2961E-03	2.7478E-01	1.0497E-02
0.820	1.7593E+00	8.4005E-02	2.1738E-01	1.0380E-02	3.3885E-01	1.3021E-02
1.080	2.2748E+00	1.0763E-01	2.8107E-01	1.3298E-02	3.9474E-01	1.5232E-02
1.340	2.7728E+00	1.3007E-01	3.4262E-01	1.6072E-02	4.4697E-01	1.7297E-02
1.600	3.2547E+00	1.5148E-01	4.0215E-01	1.8718E-02	4.9695E-01	1.9269E-02
1.860	3.7212E+00	1.7197E-01	4.5980E-01	2.1249E-02	5.4515E-01	2.1168E-02
2.000	3.9663E+00	1.8265E-01	4.9009E-01	2.2569E-02	5.7045E-01	2.2164E-02
2.260	4.4109E+00	2.0189E-01	5.1508E-01	2.3651E-02	6.1213E-01	2.3806E-02
2.520	4.8420E+00	2.2041E-01	5.3931E-01	2.4691E-02	6.4855E-01	2.5243E-02
2.780	5.2601E+00	2.3825E-01	5.6282E-01	2.5694E-02	6.8271E-01	2.6589E-02
3.040	5.6657E+00	2.5546E-01	5.8562E-01	2.6662E-02	7.1550E-01	2.7879E-02
3.300	6.0594E+00	2.7208E-01	6.0775E-01	2.7596E-02	7.4722E-01	2.9124E-02
3.560	6.4415E+00	2.8815E-01	6.2923E-01	2.8500E-02	7.7797E-01	3.0330E-02
3.820	6.8124E+00	3.0368E-01	6.5008E-01	2.9373E-02	8.0781E-01	3.1498E-02
4.080	7.1725E+00	3.1872E-01	6.7032E-01	3.0218E-02	8.3678E-01	3.2632E-02
4.340	7.5221E+00	3.3326E-01	6.8997E-01	3.1036E-02	8.6490E-01	3.3731E-02
4.600	7.8615E+00	3.4735E-01	7.0906E-01	3.1828E-02	8.9220E-01	3.4798E-02
4.860	8.1911E+00	3.6099E-01	7.2758E-01	3.2594E-02	9.1871E-01	3.5832E-02
5.120	8.5111E+00	3.7421E-01	7.4558E-01	3.3338E-02	9.4445E-01	3.6836E-02
5.380	8.8219E+00	3.8702E-01	7.6305E-01	3.4058E-02	9.6945E-01	3.7811E-02
5.640	9.1238E+00	3.9943E-01	7.8002E-01	3.4755E-02	9.9373E-01	3.8757E-02
5.900	9.4169E+00	4.1147E-01	7.9650E-01	3.5432E-02	1.0173E+00	3.9675E-02
6.160	9.7017E+00	4.2314E-01	8.1250E-01	3.6088E-02	1.0402E+00	4.0566E-02
6.420	9.9782E+00	4.3445E-01	8.2805E-01	3.6724E-02	1.0624E+00	4.1431E-02
6.680	1.0247E+01	4.4543E-01	8.4315E-01	3.7341E-02	1.0841E+00	4.2272E-02
6.940	1.0508E+01	4.5607E-01	8.5781E-01	3.7939E-02	1.1050E+00	4.3087E-02
7.200	1.0761E+01	4.6640E-01	8.7206E-01	3.8520E-02	1.1254E+00	4.3880E-02
7.460	1.1007E+01	4.7642E-01	8.8590E-01	3.9083E-02	1.1452E+00	4.4649E-02
7.720	1.1246E+01	4.8615E-01	8.9934E-01	3.9630E-02	1.1644E+00	4.5396E-02
7.980	1.1479E+01	4.9558E-01	9.1240E-01	4.0160E-02	1.1831E+00	4.6121E-02
8.000	1.1496E+01	4.9630E-01	9.1339E-01	4.0201E-02	1.1845E+00	4.6176E-02
8.260	1.1612E+01	5.0132E-01	9.1778E-01	4.0391E-02	1.1979E+00	4.6700E-02
8.520	1.1725E+01	5.0620E-01	9.2204E-01	4.0575E-02	1.2065E+00	4.7036E-02
8.780	1.1834E+01	5.1093E-01	9.2617E-01	4.0754E-02	1.2134E+00	4.7310E-02
9.040	1.1940E+01	5.1552E-01	9.3019E-01	4.0928E-02	1.2198E+00	4.7561E-02
9.300	1.2044E+01	5.1997E-01	9.3410E-01	4.1096E-02	1.2259E+00	4.7800E-02
9.560	1.2144E+01	5.2429E-01	9.3790E-01	4.1260E-02	1.2318E+00	4.8031E-02
9.820	1.2241E+01	5.2848E-01	9.4158E-01	4.1418E-02	1.2375E+00	4.8255E-02
10.080	1.2336E+01	5.3254E-01	9.4517E-01	4.1572E-02	1.2430E+00	4.8472E-02
24.000	1.4902E+01	6.4253E-01	1.0423E+00	4.5735E-02	1.3931E+00	5.4384E-02
96.000	1.5418E+01	6.6917E-01	1.0506E+00	4.6164E-02	1.4044E+00	5.4876E-02
720.000	1.5559E+01	6.8444E-01	1.0513E+00	4.6236E-02	1.4060E+00	5.4958E-02

#####  
Worst Two-Hour Dose  
(Provided for Dose Location 1)  
#####

EAB

Time (hr)	Whole Body (rem)	Thyroid (rem)	Skin (rem)	TEDE (rem)
0.0	3.4083E-02	3.9663E+00	6.4929E-02	1.8265E-01

#####  
30 Day Control Room Skin Dose  
#####

Control Room

Time (hr)	Skin (rem)
720.0	1.1971E-01