

RAS 12742

U.S. NUCLEAR REGULATORY COMMISSION

In the Matter of System Energy Resources  
Docket No. 52-0095P Official Exhibit No. STAFF 22


NRC STAFF EXHIBIT 22

OFFERED by: Applicant/Licensee/Intervenor \_\_\_\_\_

IDENTIFIED on NRC Staff Other \_\_\_\_\_  
1/23/77 Witness/Panel \_\_\_\_\_

Action Taken: ADMITTED REJECTED WITHDRAWN

Reporter/Clerk \_\_\_\_\_

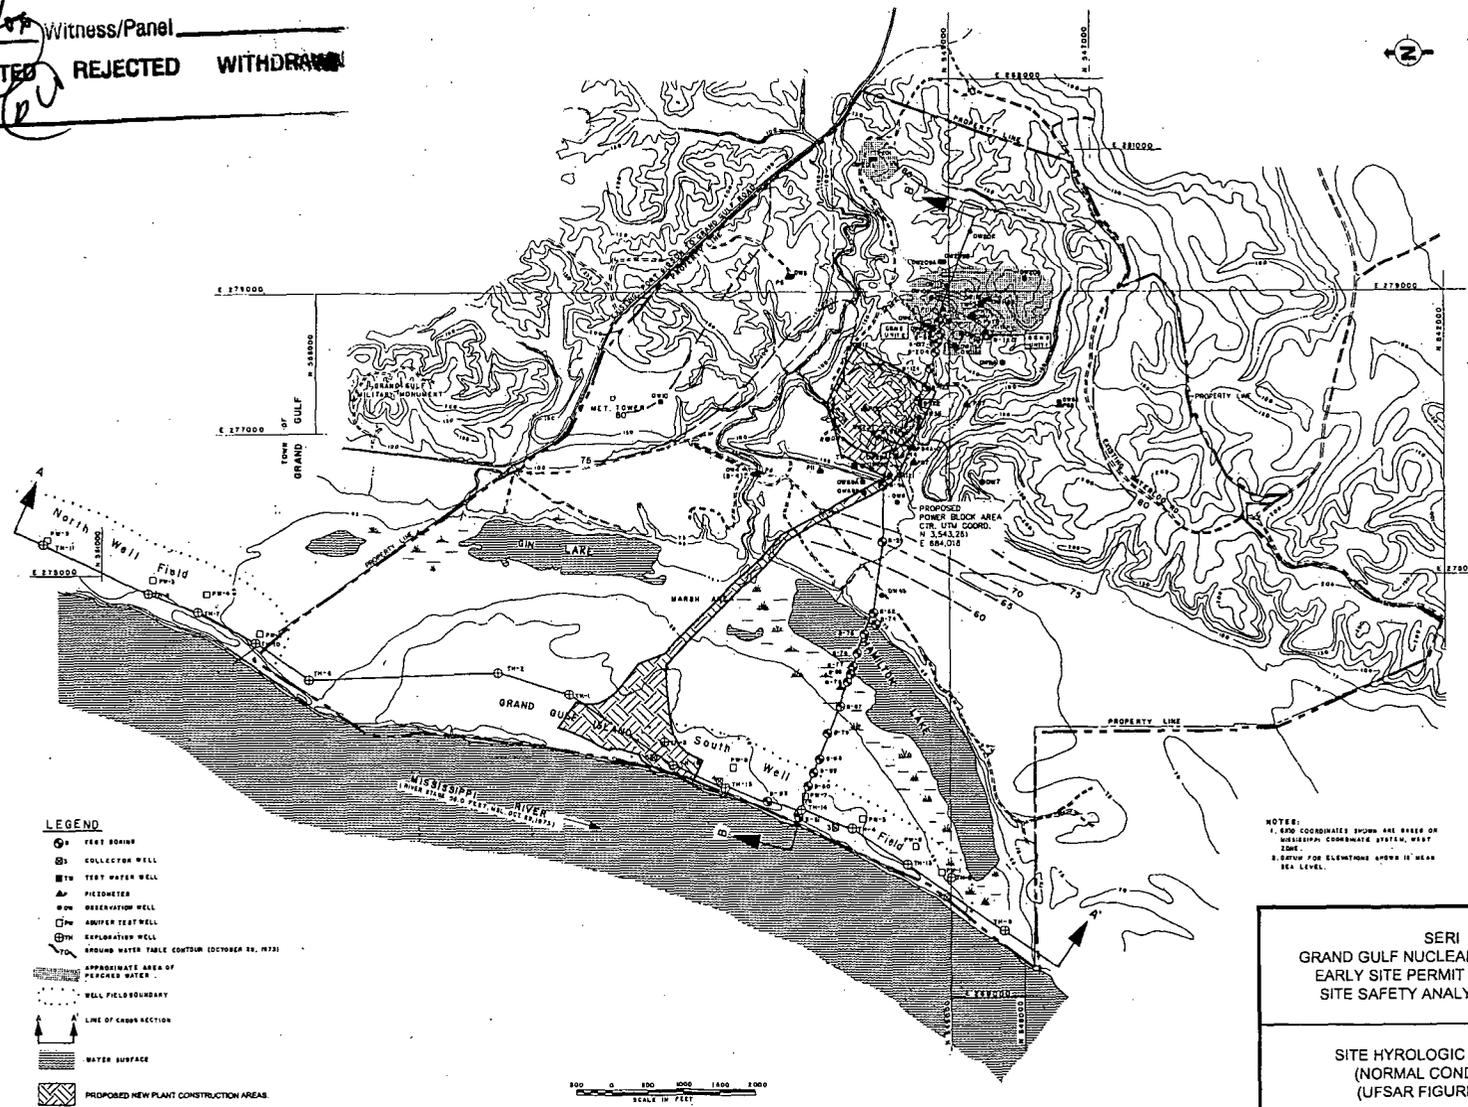

- LEGEND**
- TEST BORING
  - ⊙ COLLECTION WELL
  - ⊖ TEST WATER WELL
  - △ PICO-METER
  - ⊙ OBSERVATION WELL
  - ⊖ AMBIER TEST WELL
  - ⊙ EXPLORATION WELL
  - ⊖ GROUND WATER TABLE CONTOUR (OCTOBER 22, 1973)
  - ⊖ APPROXIMATE AREA OF PLUGHED WATER
  - ⊖ WELL FIELD BOUNDARY
  - ⊖ LINE OF CROSS SECTION
  - ⊖ WATER SURFACE
  - ⊖ PROPOSED NEW PLANT CONSTRUCTION AREAS

NOTE:  
1. GRID COORDINATES SHOWN ARE BASED ON MISSISSIPPI COORDINATE SYSTEM, WEST ZONE.  
2. DATUM FOR ELEVATIONS GIVEN IS MEAN SEA LEVEL.

SERI  
GRAND GULF NUCLEAR STATION SITE  
EARLY SITE PERMIT APPLICATION  
SITE SAFETY ANALYSIS REPORT

SITE HYDROLOGIC FEATURES  
(NORMAL CONDITIONS)  
(UFSAR FIGURE 2.4-27)

FIGURE 2.4-33 REV. 1

Template=SECY-027

SECY-02

DOCKETED  
USNRC

2006 DEC 15 PM 3: 20

OFFICE OF THE SECRETARY  
OF HEARINGS AND  
ADJUDICATIONS STAFF