U.S. NUCLEAR REGULATORY COMMISSION RAS 12769

In the Matter of: System Energy Resources

Docket No. 52-009-ESP Official Exhibit No. Staff-38

OFFERED by: Applicant/Licensee Intervenor

NRC Staff Other

IDENTIFIED on 1/29/04 Witness/Panel

Action Taken: ADMITTED REJECTED WITHDRAWN

Reporter/Clerk

NRC STAFF EXHIBIT 38

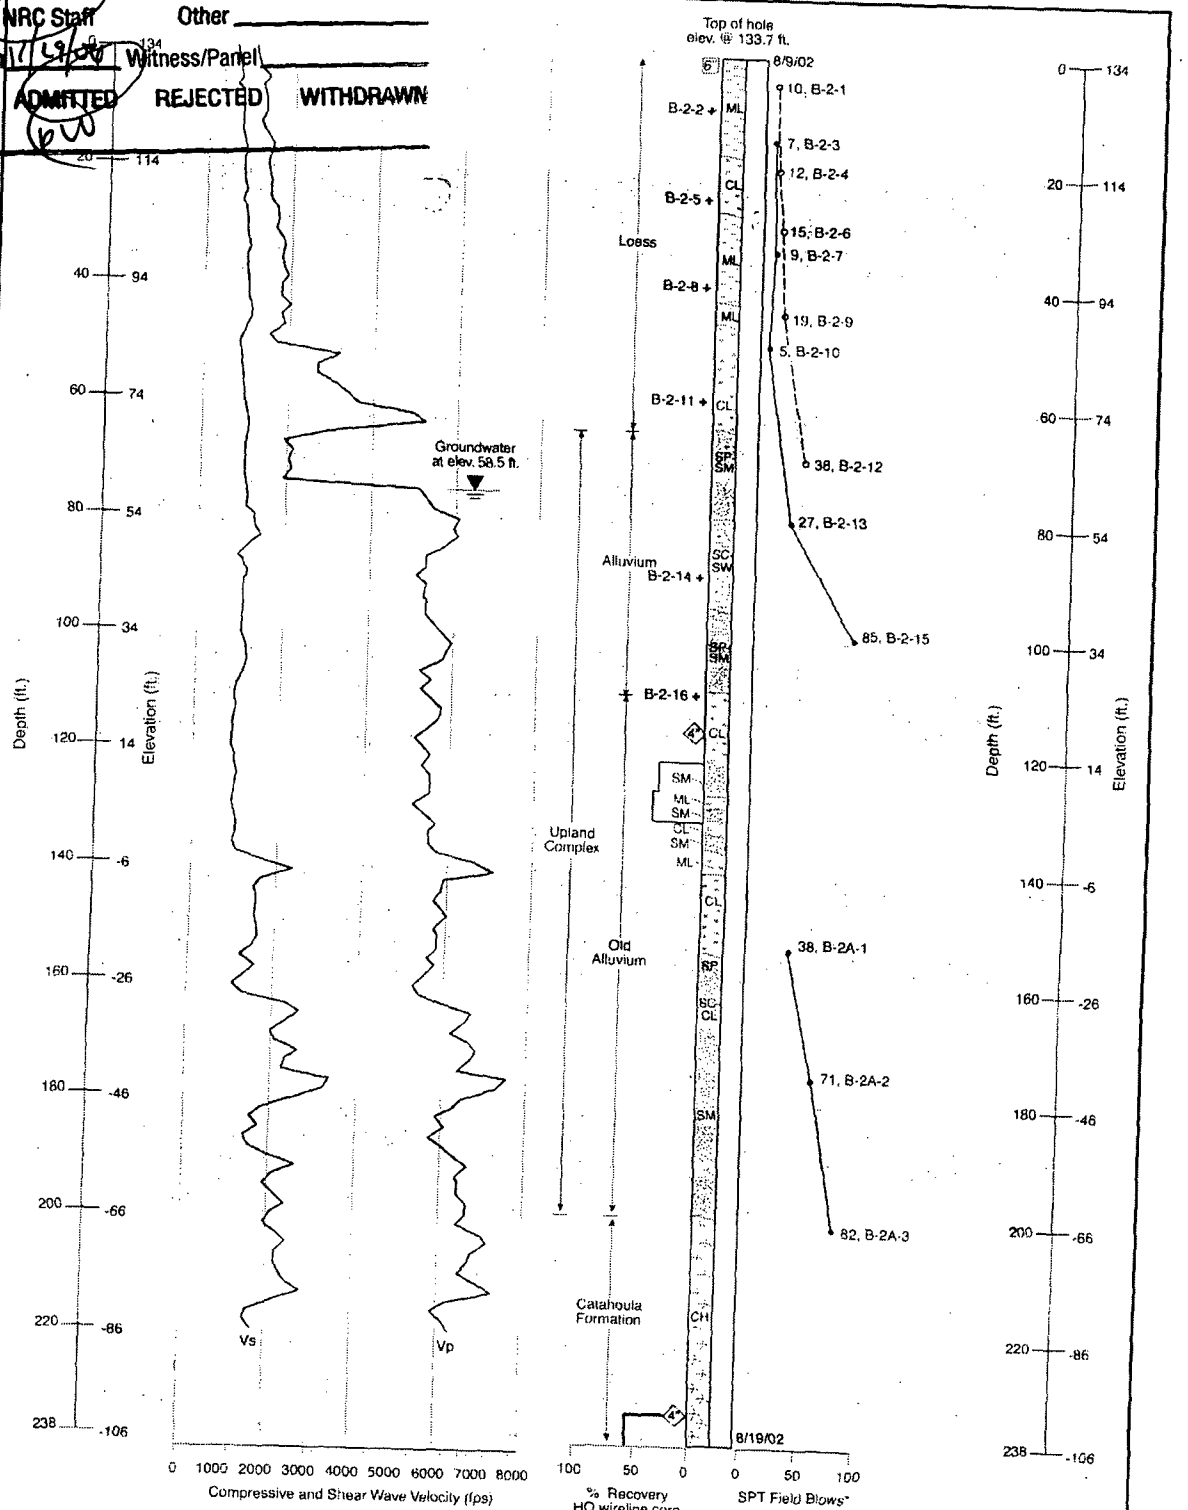

Notes: 1. Downhole geophysics in bald hole preformed by T. Martin of Geovision.

2. Groundwater level interpreted from geophysical log.

3. Vs = Shear Wave Velocity
Vp = Compressional Wave Velocity

*Blows determined with a 140 lb. hammer, 30" drop.

Explanation

- • SPT sampler
- ○ 3.0" O.D. "ModCal" sampler
- + 3.0" O.D. thin wall Shelby Sampler (pushed)
- 6" Mud rotary hole diameter
- 4" Wireline corehole diameter

SERI
GRAND GULF NUCLEAR STATION SITE
EARLY SITE PERMIT APPLICATION
SITE SAFETY ANALYSIS REPORT

BORING SUMMARY SHEET, BORING 2A

FIGURE 2.5-36 REV. 1

Template=SECY-027

SECY-02

DOCKETED
USNRC

2006 DEC 15 PM 3:21

OFFICE OF THE SECRETARY
RULEMAKINGS AND
ADJUDICATIONS STAFF