

DEC 28 2006

L-PI-07-003
TS 5.6.5.d

U S Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, DC 20555-0001

Prairie Island Nuclear Generating Plant Unit 2
Docket 50-306
License No. DPR-60

Core Operating Limits Report (COLR) for Prairie Island Unit 2 Cycle 24, Revision 1

Pursuant to the requirements of Technical Specification 5.6.5.d, the COLR for Prairie Island Nuclear Generating Plant Unit 2, Cycle 24, Revision 1 is attached. The limits specified in the attached COLR have been established using Nuclear Regulatory Commission (NRC) approved methodologies.

The Unit 2 COLR has been revised for Cycle 24, Modes 1 - 6, to incorporate the following changes:

- Revised Section 3.2.1 to state the $W(Z)$ values and $F^W_Q(Z)$ Penalty Factors are provided in Tables 2 and 3.
- Revised the Reference section to correct a minor typographical error in reference #24, WCAP-16009-P-A, "Realistic Large-Break LOCA Evaluation Methodology Using the Automated Statistical Treatment of Uncertainty Method (ASTRUM)," March 2005. The reference previously stated "Marck 2005" versus "March 2005".
- Deleted reference #26 since this was only applicable for Cycle 24 COLR, Revision 0.
- Revised Table 1 to include values for Modes 1 through 6.
- Added Table 2, $W(Z)$ Values, and Table 3, $F^W_Q(Z)$ Penalty Factor.

Summary of Commitments

This letter contains no new commitments and no revisions to existing commitments.

A handwritten signature in black ink, appearing to read 'TJP', with a stylized flourish at the end.

Thomas J. Palmisano
Site Vice President, Prairie Island Nuclear Generating Plant
Nuclear Management Company, LLC

Enclosure (1)

cc: Administrator, Region III, USNRC
Project Manager, Prairie Island, USNRC
Resident Inspector, Prairie Island, USNRC

ENCLOSURE 1


**PRAIRIE ISLAND NUCLEAR GENERATING PLANT
CORE OPERATING LIMITS REPORT
UNIT 2 – CYCLE 24
REVISION 1**


PRAIRIE ISLAND NUCLEAR GENERATING PLANT


CORE OPERATING LIMITS REPORT

UNIT 2 – CYCLE 24

REVISION 1

Reviewed By:  Date: 12/15/06
Lynn Johnson
Supervisor, NSSS

Reviewed By:  Date: 12/4/06
Ed Mercier
Supervisor, PWR Analyses

Approved By:  Date: 12/6/06
Mike Carlson
Director, Site Engineering

Note: This report is not part of the Technical Specifications
This report is referenced in the Technical Specifications

PRAIRIE ISLAND NUCLEAR GENERATING PLANT
CORE OPERATING LIMITS REPORT
UNIT 2 - CYCLE 24
REVISION 1

This report provides the values of the limits for Unit 2 Cycle 24 as required by Technical Specification Section 5.6.5. These values have been established using NRC approved methodology and are established such that all applicable limits of the plant safety analysis are met. The Technical Specifications affected by this report are listed below:

1. 2.1.1 Reactor Core SLs
2. 3.1.1 Shutdown Margin (SDM)
3. 3.1.3 Isothermal Temperature Coefficient (ITC)
4. 3.1.5 Shutdown Bank Insertion Limits
5. 3.1.6 Control Bank Insertion Limits
6. 3.1.8 Physics Tests Exceptions - MODE 2
7. 3.2.1 Heat Flux Hot Channel Factor ($F_Q(z)$)
8. 3.2.2 Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)
9. 3.2.3 Axial Flux Difference (AFD)
10. 3.3.1 Reactor Trip System (RTS) Instrumentation
Overtemperature ΔT and Overpower ΔT Parameter Values for Table 3.3.1-1
11. 3.4.1 RCS Pressure, Temperature, and Flow - Departure from Nucleate
Boiling (DNB) Limits
12. 3.9.1 Boron Concentration

1. 2.1.1 Reactor Core Safety Limits

Reactor Core Safety Limits are shown in Figure 1.

Reference Technical Specification section 2.1.1.

2. 3.1.1 Shutdown Margin Requirements

Minimum Shutdown Margin requirements are shown in Table 1.

Reference Technical Specification section 3.1.1.

3. 3.1.3 Isothermal Temperature Coefficient (ITC)

ITC Upper limit:

- a. $< 5 \text{ pcm}/^{\circ}\text{F}$ for power levels $< 70\%$ RTP; and
- b. less than a line which slopes linearly from
 - i) $0 \text{ pcm}/^{\circ}\text{F}$ at power level = 70% RTP to
 - ii) $-1.5 \text{ pcm}/^{\circ}\text{F}$ at power level = 100% RTP

ITC Lower limit:

- a. $-32.7 \text{ pcm}/^{\circ}\text{F}$

Reference Technical Specification section 3.1.3.

4. 3.1.5 Shutdown Bank Insertion Limits

The shutdown rods shall be fully withdrawn.

Reference Technical Specification section 3.1.5.

5. 3.1.6 Control Bank Insertion Limits

The control rod banks shall be limited in physical insertion as shown in Figures 2, 3, and 4.

The control rod banks withdrawal sequence shall be Bank A, Bank B, Bank C, and finally Bank D.

The control rod banks shall be withdrawn maintaining 128 step tip-to-tip distance.

Reference Technical Specification section 3.1.6.

6. 3.1.8 Physics Tests Exceptions - MODE 2

Minimum Shutdown Margin requirements during physics testing are shown in Table 1.

Reference Technical Specification section 3.1.8.

7. 3.2.1 Heat Flux Hot Channel Factor ($F_Q(Z)$)

The Heat Flux Hot Channel Factor shall be within the following limits:

$$CFQ = 2.50$$

$K(Z)$ is a constant value = 1.0 at all elevations.

$W(Z)$ values are provided in Table 2.

$F_Q^W(Z)$ Penalty Factors are provided in Table 3.

Applicability: MODE 1.

Reference Technical Specification section 3.2.1

8. 3.2.2 Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)

The Nuclear Enthalpy Rise Hot Channel Factor shall be within the following limit:

$$F_{\Delta H} \leq 1.77 \times [1 + 0.3(1 - P)]$$

where: P is the fraction of RATED THERMAL POWER at which
the core is operating.

Applicability: MODE 1.

Reference Technical Specification section 3.2.2

9. 3.2.3 Axial Flux Difference (AFD)

The indicated axial flux difference, in % flux difference units, shall be maintained within the allowed operational space defined by Figure 5.

Applicability: MODE 1 with RATED THERMAL POWER $\geq 50\%$ RTP.

Reference Technical Specification sections 3.2.3.

10. 3.3.1 Reactor Trip System (RTS) Instrumentation

Overtemperature ΔT and Overpower ΔT Parameter Values for Table 3.3.1-1;

Overtemperature ΔT Setpoint

Overtemperature ΔT setpoint parameter values:

ΔT_0	=	Indicated ΔT at RATED THERMAL POWER, %
T	=	Average temperature, °F
T'	=	560.0 °F
P	=	Pressurizer Pressure, psig
P'	=	2235 psig
K ₁	≤	1.17
K ₂	=	0.014 /°F
K ₃	=	0.00100 /psi
τ_1	=	30 seconds
τ_2	=	4 seconds
f(ΔI)	=	A function of the indicated difference between top and bottom detectors of the power range nuclear ion chambers. Selected gains are based on measured instrument response during plant startup tests, where q_t and q_b are the percent power in the top and bottom halves of the core respectively, and $q_t + q_b$ is total core power in percent of RATED THERMAL POWER, such that
(a)		For $q_t - q_b$ within -13, +8 % f(ΔI) = 0
(b)		For each percent that the magnitude of $q_t - q_b$ exceeds +8% the ΔT trip setpoint shall be automatically reduced by an equivalent of 1.73 % of RATED THERMAL POWER.
(c)		For each percent that the magnitude of $q_t - q_b$ exceeds -13 % the ΔT trip setpoint shall be automatically reduced by an equivalent of 3.846 % of RATED THERMAL POWER.

Overpower ΔT Setpoint

Overpower ΔT setpoint parameter values:

ΔT_0	=	Indicated ΔT at RATED THERMAL POWER, %
T	=	Average temperature, °F
T'	=	560.0 °F
K ₄	≤	1.11
K ₅	=	0.0275/°F for increasing T; 0 for decreasing T
K ₆	=	0.002/°F for T > T' ; 0 for T ≤ T'
τ_3	=	10 seconds

11. 3.4.1 RCS Pressure, Temperature, and Flow - Departure from Nucleate Boiling (DNB) Limits

Pressurizer pressure limit = 2205 psia
RCS average temperature limit = 564°F
RCS total flow rate limit = 178,000 gpm

Reference Technical Specification section 3.4.1.

12. 3.9.1 Refueling Boron Concentration.

The boron concentration of the reactor coolant system and the refueling cavity shall be sufficient to ensure that the more restrictive of the following conditions is met:

- a) $K_{\text{eff}} \leq 0.95$
- b) 2000 ppm
- c) The Shutdown Margin specified in Table 1

Reference Technical Specification section 3.9.1.

REFERENCES

1. NSPNAD-8101-A, "Qualification of Reactor Physics Methods for Application to Prairie Island," Revision 2, October 2000.
2. NSPNAD-8102-PA, "Prairie Island Nuclear Power Plant Reload Safety Evaluation Methods for Application to PI Units," Revision 7, July 1999.
3. NSPNAD-97002-PA, "Northern States Power Company's "Steam Line Break Methodology," Revision 1, October 2000.
4. WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July, 1985.
- 5.a WCAP-10054-P-A, "Westinghouse Small Break ECCS Evaluation Model using the NOTRUMP Code," August, 1985.
- 5.b WCAP-10054-P-A, "Westinghouse Small Break ECCS Evaluation Model using the NOTRUMP Code," Addendum 2 Revision 1, July 1997.
- 6.a WCAP-10924-P-A, "Westinghouse Large Break LOCA Best Estimate Methodology," Revision 1, Volume 1 Addendum 1,2,3, December 1988.
- 6.b WCAP-10924-P-A, "Westinghouse Large Break LOCA Best Estimate Methodology," Revision 2, Volume 2 Addendum 1, December 1988.
- 6.c WCAP-10924-P-A, "Westinghouse Large Break LOCA Best Estimate Methodology," Revision 1, Volume 1 Addendum 4, March 1991.
7. XN-NF-77-57-(A), XN-NF-77-57, Supplement 1 (A), "Exxon Nuclear Power Distribution Control for Pressurized Water Reactors Phase II," May 1981.
8. WCAP-13677-P-A, "10 CFR 50.46 Evaluation Model Report: W-COBRA/TRAC 2-Loop Upper Plenum Injection Model Update to Support ZIRLO™ Cladding Options," February 1994.
9. NSPNAD-93003-A, "Prairie Island Units 1 and 2 Transient Power Distribution Methodology," Revision 0, April 1993.
10. WCAP-10216-P-A, Revision 1A, "Relaxation of Constant Axial Offset Control/ FQ Surveillance Technical Specification," February 1994.
11. WCAP-8745-P-A, "Design Bases for the Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," September 1986.
12. WCAP-11397-P-A, "Revised Thermal Design Procedure," April 1989.

13. WCAP-14483-A, "Generic Methodology for Expanded Core Operating Limits Report," January 1999.
14. WCAP-7588 Rev. 1-A, "An Evaluation of the Rod Ejection Accident in Westinghouse Pressurized Water Reactors Using Spatial Kinetics Methods," January 1975.
15. WCAP-7908-A, "FACTRAN – A FORTRAN IV Code for Thermal Transients in a UO₂ Fuel Rod," December 1989.
16. WCAP-7907-P-A, "LOFTRAN Code Description," April 1984.
17. WCAP-7979-P-A, "TWINKLE – A Multidimensional Neutron Kinetics Computer Code," January 1975.
18. WCAP-10965-P-A, "ANC: A Westinghouse Advanced Nodal Computer Code," December 1985.
19. WCAP-11394-P-A, "Methodology for the Analysis of the Dropped Rod Event," January 1990.
20. WCAP-11596-P-A, "Qualification of the PHOENIX-P/ANC Nuclear Design System for Pressurized Water Reactor Cores," June 1988.
21. WCAP-12910 Rev. 1-A, "Pressurizer Safety Valve Set Pressure Shift," May 1993.
22. WCAP-14565-P-A, "VIPRE-01 Modeling and Qualification for Pressurized Water Reactor Non-LOCA Thermal-Hydraulic Safety Analysis," October 1999.
23. WCAP-14882-P-A, "RETRAN-02 Modeling and Qualification for Westinghouse Pressurized Water Reactor Non-LOCA Safety Analyses," April 1999.
24. WCAP-16009-P-A, "Realistic Large-Break LOCA Evaluation Methodology Using the Automated Statistical Treatment of Uncertainty Method (ASTRUM)," March 2005.
25. 50.59 Evaluation 1055, "Unit 2 Cycle 24 Core Reload."

Table 1

Minimum Required Shutdown Margin

Plant Conditions	Number of Charging Pumps Running**		
	0-1 Pump	2 Pumps	3 Pumps
Mode 1*	-	-	-
Mode 2*	2.0%	2.0%	2.0%
Mode 3, $T_{ave} \geq 520^{\circ}\text{F}$	2.0%	2.0%	2.0%
Mode 3, $350^{\circ}\text{F} \leq T_{ave} < 520^{\circ}\text{F}$	2.0%	2.0%	2.5%
Mode 4	2.0%	4.5%	6.5%
Mode 5***, $T_{ave} \leq 200^{\circ}\text{F}$	2.5%	5.5%	8.0%
Mode 6, ARI***, $T_{ave} \geq 68^{\circ}\text{F}$	5.129%	5.129%	8.0%
Mode 6, ARO***, $T_{ave} \geq 68^{\circ}\text{F}$	5.129%	6.5%	10.0%
Physics Testing in Mode 2	0.5%	0.5%	0.5%

Operational Mode Definitions, as per TS Table 1.1-1.

- * For Mode 1 and Mode 2 with $K_{eff} \geq 1.0$, the minimum shutdown margin requirements are provided by the Rod Insertion Limits.
- ** Charging pump(s) in service only pertains to steady state operations. It does not include transitory operations. For example, operations such as starting a second charging pump in order to secure the operating pump would fall under the one pump in service column.
- *** These values are also applicable for the Unit 2 Cycle 23 end of cycle.

Table 2 - W(z) Values(Top 10% and Bottom 8% excluded)

	Height		BU [MWd/MTU]				
	[ft]		150	4000	12000	18000	22000
			AO = 1.84	AO = -0.60	AO = -2.76	AO = -0.56	AO = -1.71
[BOTTOM] 1	0.00		1.0000	1.0000	1.0000	1.0000	1.0000
2	0.20		1.0000	1.0000	1.0000	1.0000	1.0000
3	0.40		1.0000	1.0000	1.0000	1.0000	1.0000
4	0.60		1.0000	1.0000	1.0000	1.0000	1.0000
5	0.80		1.0000	1.0000	1.0000	1.0000	1.0000
6	1.00		1.3164	1.2648	1.2415	1.2135	1.1767
7	1.20		1.3052	1.2536	1.2299	1.2054	1.1671
8	1.40		1.2932	1.2409	1.2169	1.1966	1.1570
9	1.60		1.2798	1.2269	1.2029	1.1877	1.1471
10	1.80		1.2653	1.2121	1.1883	1.1787	1.1373
11	2.00		1.2501	1.1966	1.1733	1.1697	1.1275
12	2.20		1.2342	1.1807	1.1580	1.1607	1.1182
13	2.40		1.2180	1.1645	1.1428	1.1516	1.1087
14	2.60		1.2016	1.1490	1.1277	1.1423	1.0988
15	2.80		1.1846	1.1385	1.1129	1.1335	1.0988
16	3.00		1.1699	1.1280	1.0991	1.1219	1.1042
17	3.20		1.1613	1.1223	1.0928	1.1164	1.1149
18	3.40		1.1594	1.1242	1.0934	1.1256	1.1243
19	3.60		1.1597	1.1260	1.0946	1.1357	1.1340
20	3.80		1.1594	1.1271	1.0956	1.1451	1.1440
21	4.00		1.1582	1.1278	1.0971	1.1538	1.1529
22	4.20		1.1562	1.1278	1.0984	1.1613	1.1607
23	4.40		1.1534	1.1272	1.0991	1.1676	1.1690
24	4.60		1.1498	1.1259	1.0999	1.1727	1.1785
25	4.80		1.1455	1.1239	1.1022	1.1760	1.1866
26	5.00		1.1404	1.1215	1.1044	1.1793	1.1930
27	5.20		1.1348	1.1181	1.1066	1.1832	1.1979
28	5.40		1.1285	1.1153	1.1109	1.1860	1.2014
29	5.60		1.1218	1.1197	1.1155	1.1871	1.2036
30	5.80		1.1151	1.1269	1.1221	1.1893	1.2044
31	6.00		1.1170	1.1353	1.1311	1.1956	1.2103
32	6.20		1.1271	1.1451	1.1408	1.2051	1.2219
33	6.40		1.1348	1.1540	1.1496	1.2138	1.2317
34	6.60		1.1419	1.1621	1.1574	1.2211	1.2402
35	6.80		1.1482	1.1692	1.1670	1.2266	1.2471
36	7.00		1.1535	1.1752	1.1772	1.2303	1.2521
37	7.20		1.1577	1.1798	1.1857	1.2321	1.2557
38	7.40		1.1607	1.1832	1.1935	1.2318	1.2585
39	7.60		1.1622	1.1863	1.2006	1.2293	1.2590
40	7.80		1.1622	1.1880	1.2064	1.2245	1.2568
41	8.00		1.1605	1.1879	1.2102	1.2173	1.2521
42	8.20		1.1571	1.1859	1.2121	1.2079	1.2446
43	8.40		1.1517	1.1819	1.2120	1.1963	1.2343
44	8.60		1.1448	1.1764	1.2095	1.1810	1.2217
45	8.80		1.1340	1.1667	1.2057	1.1714	1.2055
46	9.00		1.1301	1.1628	1.1973	1.1656	1.1903
47	9.20		1.1352	1.1697	1.1905	1.1590	1.1816
48	9.40		1.1451	1.1747	1.2009	1.1570	1.1773
49	9.60		1.1536	1.1846	1.2132	1.1526	1.1701
50	9.80		1.1624	1.1949	1.2285	1.1558	1.1682
51	10.00		1.1706	1.2047	1.2443	1.1683	1.1721
52	10.20		1.1777	1.2153	1.2561	1.1816	1.1743
53	10.40		1.1887	1.2220	1.2690	1.1935	1.1758
54	10.60		1.1988	1.2306	1.2752	1.2026	1.1791
55	10.80		1.2082	1.2378	1.2801	1.2109	1.1835
56	11.00		1.0000	1.0000	1.0000	1.0000	1.0000
57	11.20		1.0000	1.0000	1.0000	1.0000	1.0000
58	11.40		1.0000	1.0000	1.0000	1.0000	1.0000
59	11.60		1.0000	1.0000	1.0000	1.0000	1.0000
60	11.80		1.0000	1.0000	1.0000	1.0000	1.0000
[TOP] 61	12.00		1.0000	1.0000	1.0000	1.0000	1.0000

Table 3

$F^W_Q(Z)$ Penalty Factor

Cycle Burnup (MWD/MTU)	$F^W_Q(Z)$ Penalty Factor
0	1.020
12983	1.020
13134	1.021
13285	1.028
13436	1.031
13587	1.029
13738	1.029
13889	1.028
14040	1.027
14191	1.025
14342	1.024
14493	1.022
14644	1.021
14795	1.021
14946	1.020

$F^W_Q(Z) = 1.020$ for all burnups except those listed above. Linear interpolation is adequate for intermediate cycle burnups.

Figure 1

Reactor Core Safety Limits


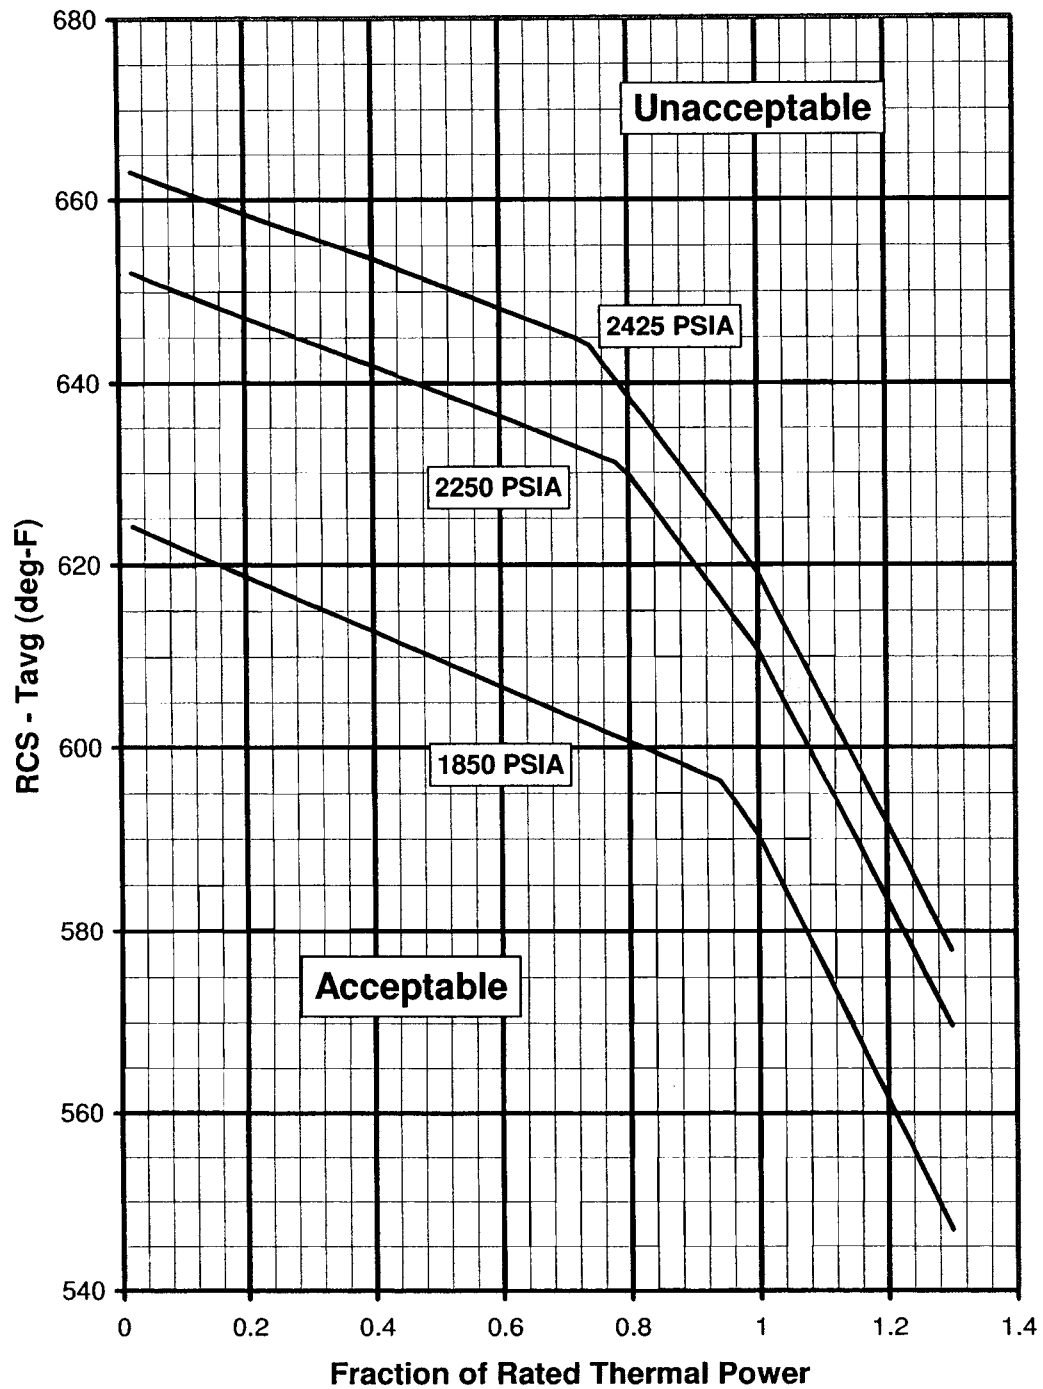


Figure 2
Rod Insertion Limit, 128 Step Tip-to-Tip

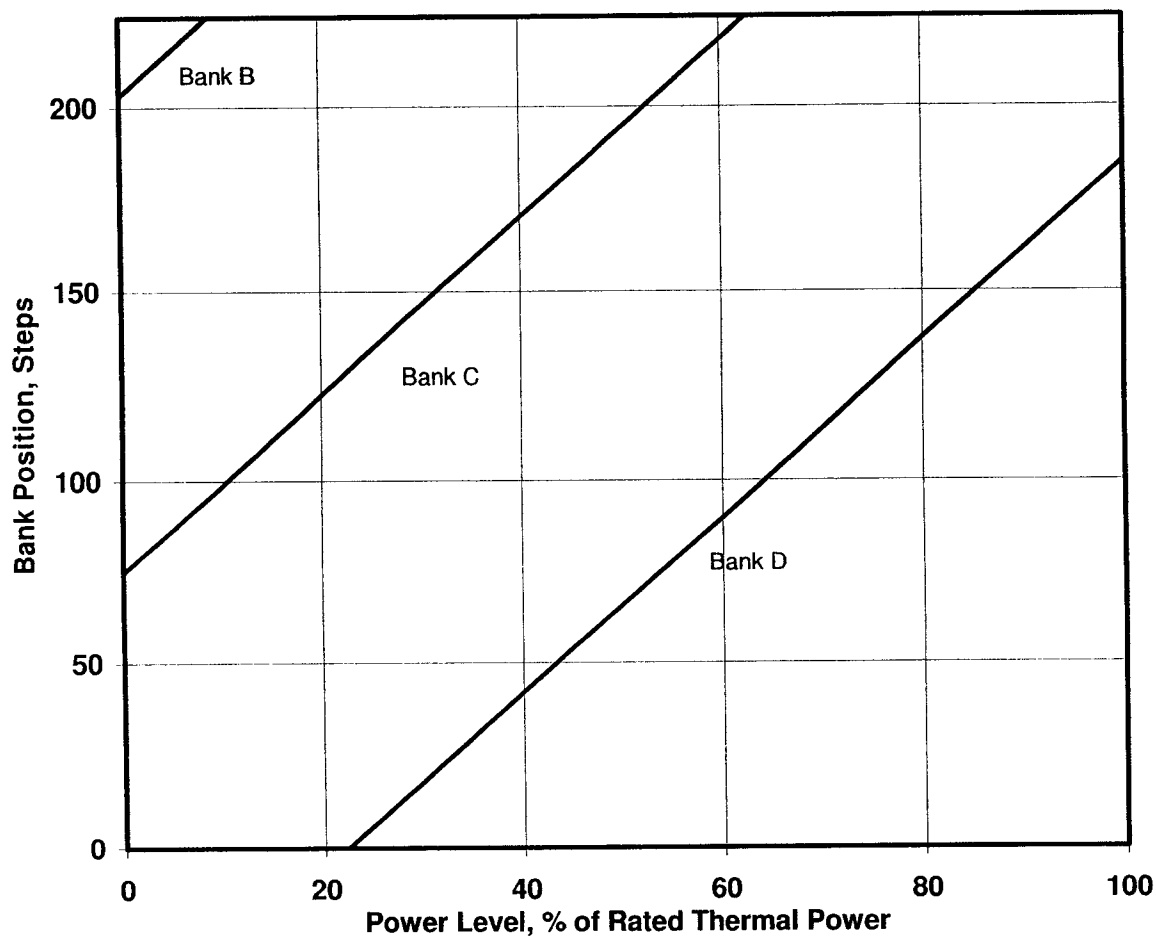


Bank Positions Given By:

- Bank D = $(150 / 63) * (P - 100) + 185$
- Bank C = $(150 / 63) * (P - 100) + 185 + 128$
- Bank B = $(150 / 63) * (P - 100) + 185 + 128 + 128$

NOTE: The top of the active fuel height corresponds to 224 steps. The ARO parking position may be any position above 224 steps.

Figure 3
Rod Insertion Limit, 128 Step Tip-to-Tip, One Bottomed Rod
(Technical Specification 3.1.4 Condition B)

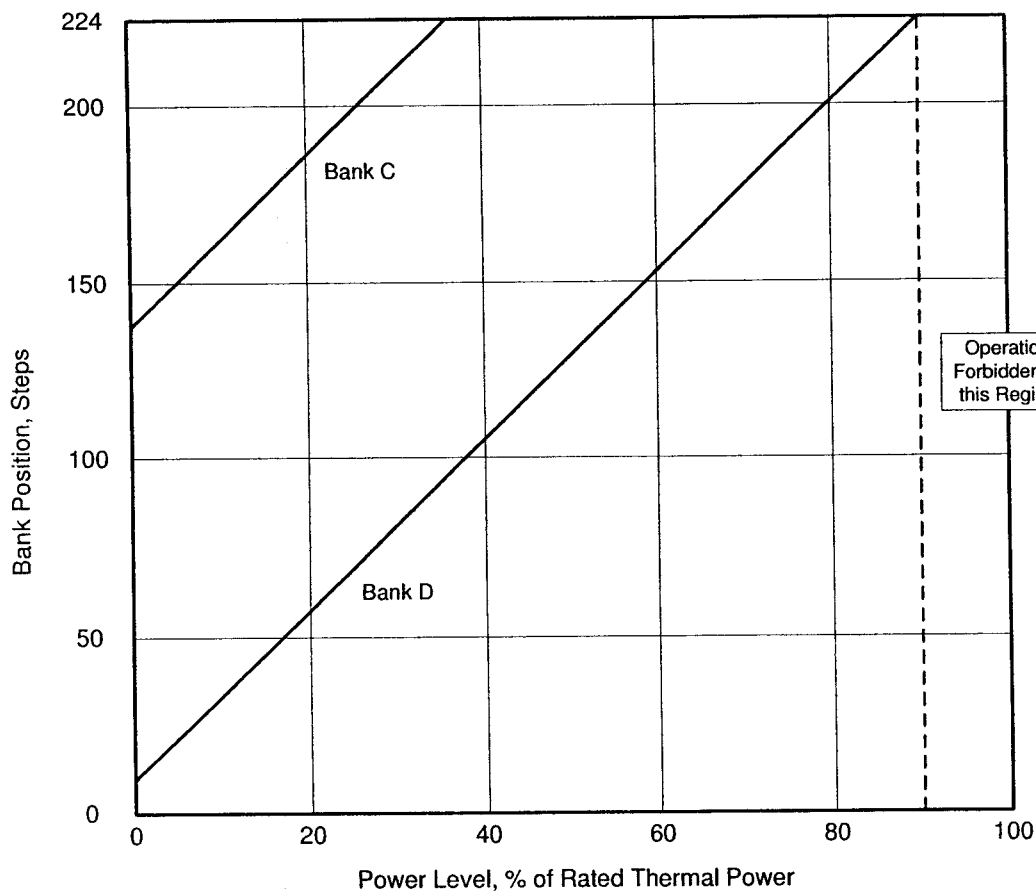


Bank Positions Given By:

- Bank D = $(150 / 63) * (P - 90) + 224$
- Bank C = $(150 / 63) * (P - 90) + 224 + 128$

NOTE: The top of the active fuel height corresponds to 224 steps. The ARO parking position may be any position above 224 steps.

Figure 4
Rod Insertion Limit, 128 Step Tip-to-Tip, One Inoperable Rod
(Technical Specification 3.1.4 Condition A)

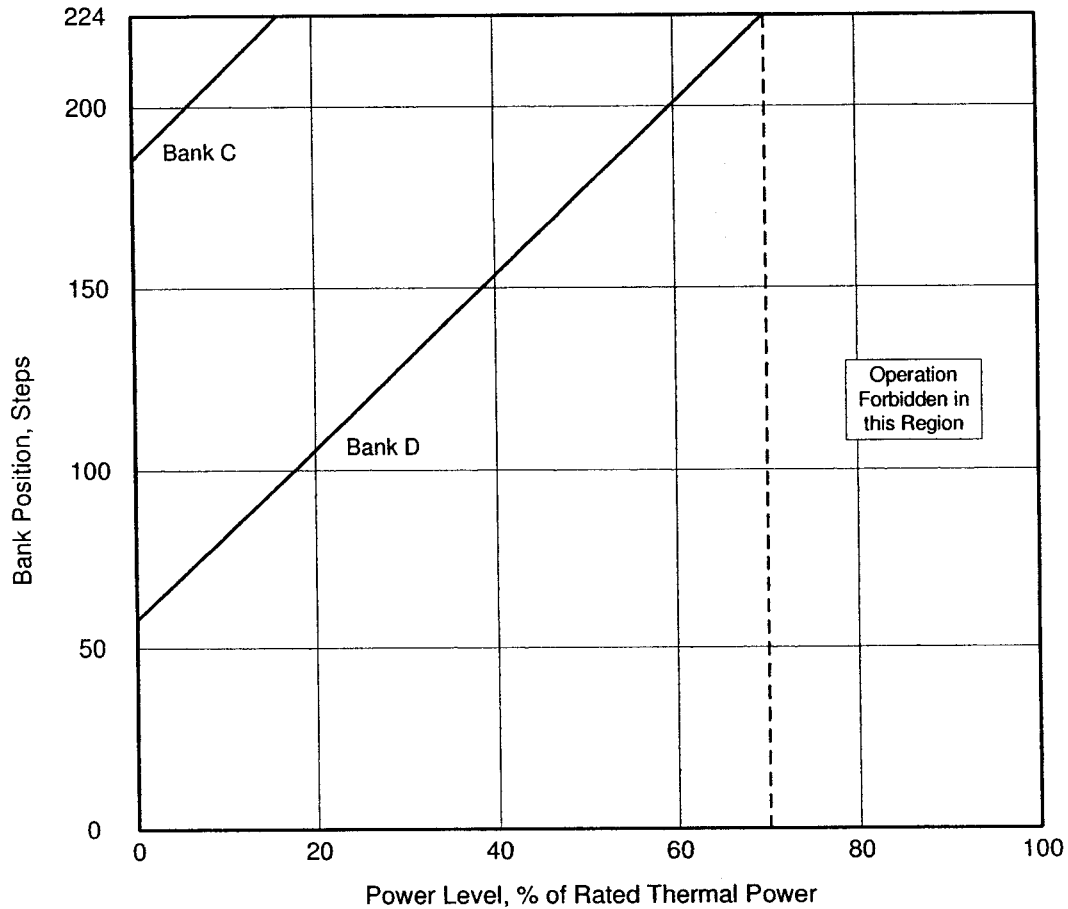

Bank Positions Given By:

- Bank D = $(150 / 63) * (P - 70) + 224$
- Bank C = $(150 / 63) * (P - 70) + 224 + 128$

NOTE: The top of the active fuel height corresponds to 224 steps. The ARO parking position may be any position above 224 steps.

Figure 5
Flux Difference Operating Envelope

