


LOCATION OF MICROGRAPH SAMPLES

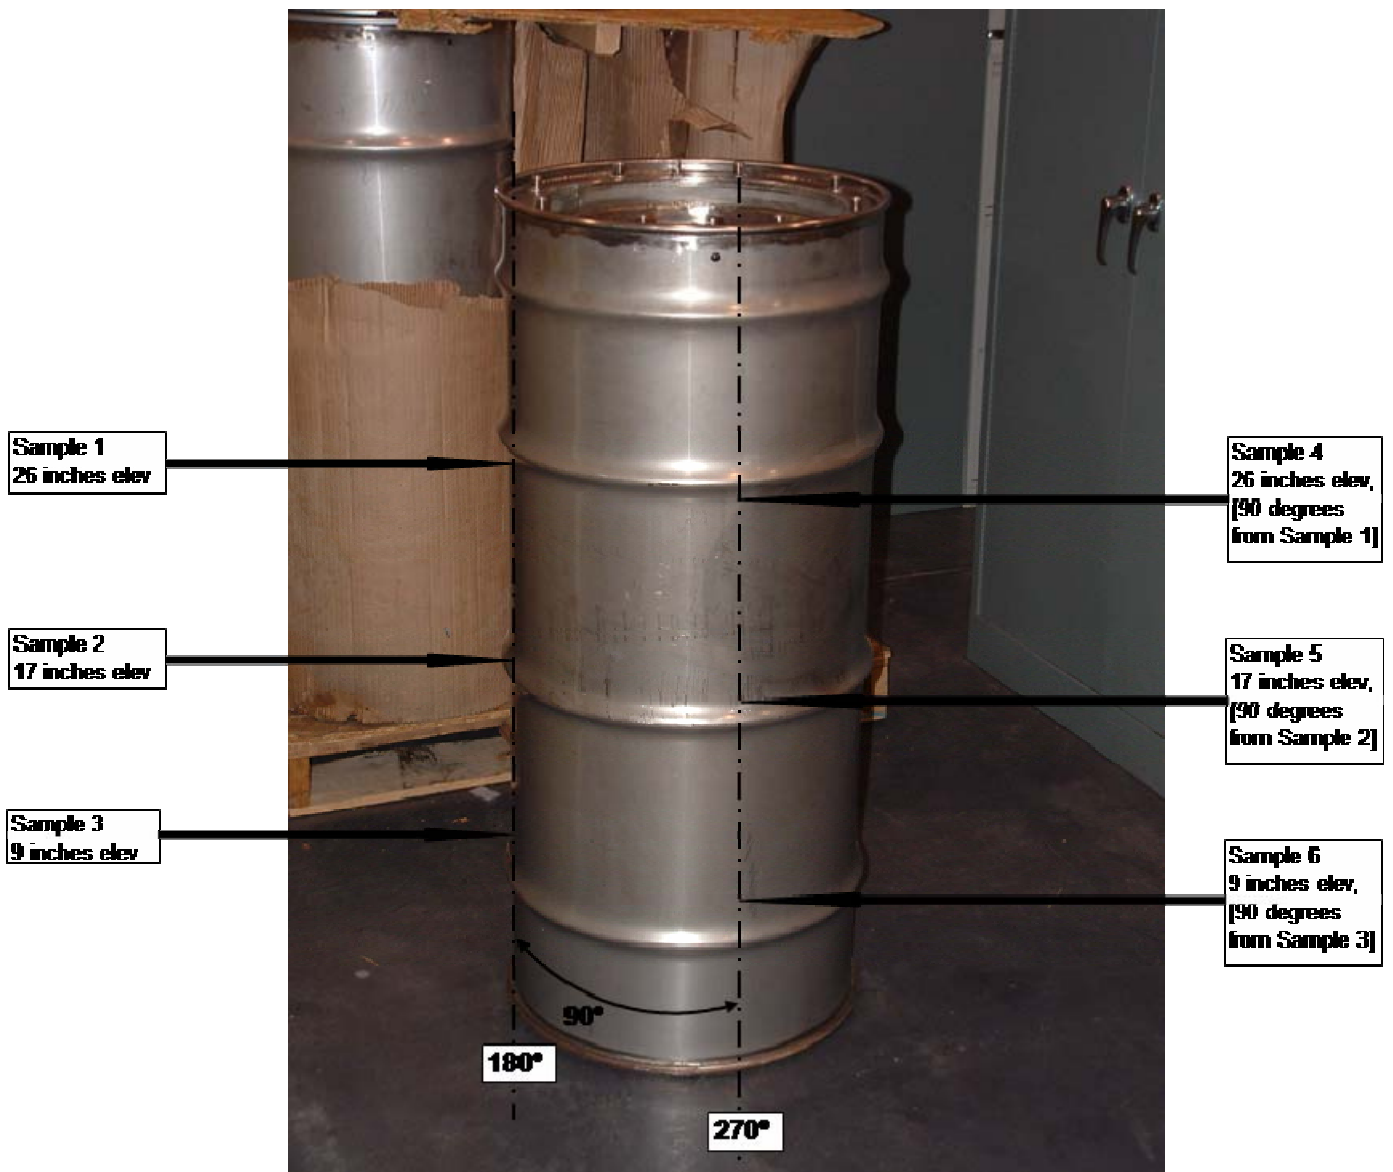

Sample No.	Micrograph No.
1	Cast VC 180 Deg 26 Edge @ 2,3.tif
2	Cast VC 180 Deg 17 Edge @ 2,1.tif
3	Cast VC 180 Deg 9 Edge @ 3,1.tif
4	Cast VC 270 Deg 26 Edge @ 3,2.tif
5	Cast VC 270 Deg 17 Edge @ 3,2.tif
6	Cast VC 270 Deg 9 Edge @ 1,1.tif