



UNITED STATES
NUCLEAR REGULATORY COMMISSION
REGION IV
611 RYAN PLAZA DRIVE, SUITE 400
ARLINGTON, TEXAS 76011-4005

February 22, 2007

Randall K. Edington
Senior Vice President, Nuclear
Mail Station 7602
Arizona Public Service Company
P.O. Box 52034
Phoenix, AZ 85072-2034

SUBJECT: MEETING SUMMARY - DISCUSSION OF PALO VERDE PROGRESS ON
COMPONENT DESIGN BASIS REVIEW

Dear Mr. Eddington:

This refers to the management meeting conducted at the U.S. Nuclear Regulatory Commission (NRC) Region IV Office, Arlington, Texas, on February 20, 2007. The meeting attendance list and a copy of the presentations are included as Enclosures 1 and 2. No commitments were made by the licensee during the conference.

In accordance with 10 CFR 2.390 of the NRC's "Rules of Practice," a copy of this letter and its enclosure will be available electronically for public inspection in the NRC Public Document Room or from the Publicly Available Records (PARS) component of NRC's document system (ADAMS). ADAMS is accessible from the NRC Web site at <http://www.nrc.gov/reading-rm/adams.html> (the Public Electronic Reading Room).

Sincerely,

/RA/

William B. Jones, Chief
Engineering Branch 1
Division of Reactor Safety

Dockets: 50-528; 50-529; 50-530
Licenses: NPF-41; NPF-51; NPF -74

Enclosures:
1. Attendance Lists
2. Presentation

cc w/enclosures:

Steve Olea
Arizona Corporation Commission
1200 W. Washington Street
Phoenix, AZ 85007

Douglas K. Porter, Senior Counsel
Southern California Edison Company
Law Department, Generation Resources
P.O. Box 800
Rosemead, CA 91770

Chairman
Maricopa County Board of Supervisors
301 W. Jefferson, 10th Floor
Phoenix, AZ 85003

Aubrey V. Godwin, Director
Arizona Radiation Regulatory Agency
4814 South 40 Street
Phoenix, AZ 85040

Scott Bauer, Acting General Manager
Regulatory Affairs and
Performance Improvement
Palo Verde Nuclear Generating Station
Mail Station 7636
P.O. Box 52034
Phoenix, AZ 85072-2034

Jeffrey T. Weikert
Assistant General Counsel
El Paso Electric Company
Mail Location 167
123 W. Mills
El Paso, TX 79901

John W. Schumann
Los Angeles Department of Water & Power
Southern California Public Power Authority
P.O. Box 51111, Room 1255-C
Los Angeles, CA 90051-0100

John Taylor
Public Service Company of New Mexico
2401 Aztec NE, MS Z110
Albuquerque, NM 87107-4224

Geoffrey M. Cook
Southern California Edison Company
5000 Pacific Coast Hwy, Bldg. N50
San Clemente, CA 92672

Robert Henry
Salt River Project
6504 East Thomas Road
Scottsdale, AZ 85251

Brian Almon
Public Utility Commission
William B. Travis Building
P.O. Box 13326
1701 North Congress Avenue
Austin, TX 78701-3326

Karen O'Regan
Environmental Program Manager
City of Phoenix
Office of Environmental Programs
200 West Washington Street
Phoenix, AZ 85003

Matthew Benac
Assistant Vice President
Nuclear & Generation Services
El Paso Electric Company
340 East Palm Lane, Suite 310
Phoenix, AZ 85004

Electronic distribution by RIV:
 Regional Administrator (**BSM1**)
 DRP Director (**ATH**)
 DRS Director (**DDC**)
 DRS Deputy Director (**RJC1**)
 Senior Resident Inspector (**GXW2**)
 Branch Chief, DRP/D (**RLN1**)
 Senior Project Engineer, DRP/D (**GEW**)
 Team Leader, DRP/TSS (**FLB2**)
 RITS Coordinator (**MSH3**)

SUNSI Review Completed: Y ADAMS: Yes No Initials: CJP
 Publicly Available Non-Publicly Available Sensitive Non-Sensitive

SRI:EB1	C:EB1			
CJPaulk/lmb	WBJones			
/RA/	/RA/			
2/22/07	2/22/07			

OFFICIAL RECORD COPY

T=Telephone

E=E-mail

F=Fax

Enclosure 1

LIST OF ATTENDEES

Arizona Public Service

S. Bauer, Acting General Manager, Regulatory Affairs
G. D'Aunoy, Senior Engineer, Probabilistic Risk Assessment Section
M. Karbassian, Department Leader, Mechanical
D. Mauldin, Vice President, Engineering
R. Randels, Director, Design Engineering
B. Thiele, Site Manager, Component Design Basis Review Project

Sargent and Lundy


M. Navarro, Senior Engineer

NRC

D. Chamberlain, Director, Division of Reactor Safety
W. Jones, Chief, Engineering Branch 1, Division of Reactor Safety
J. Nadel, Reactor Inspector, Engineering Branch 1, Division of Reactor Safety
R. Nease, Chief, Projects Branch D, Division of Reactor Projects
C. Paulk, Senior Reactor Inspector, Engineering Branch 1, Division of Reactor Safety
J. Reynoso, Reactor Inspector, Engineering Branch 1, Division of Reactor Safety

Enclosure 2

Presentation

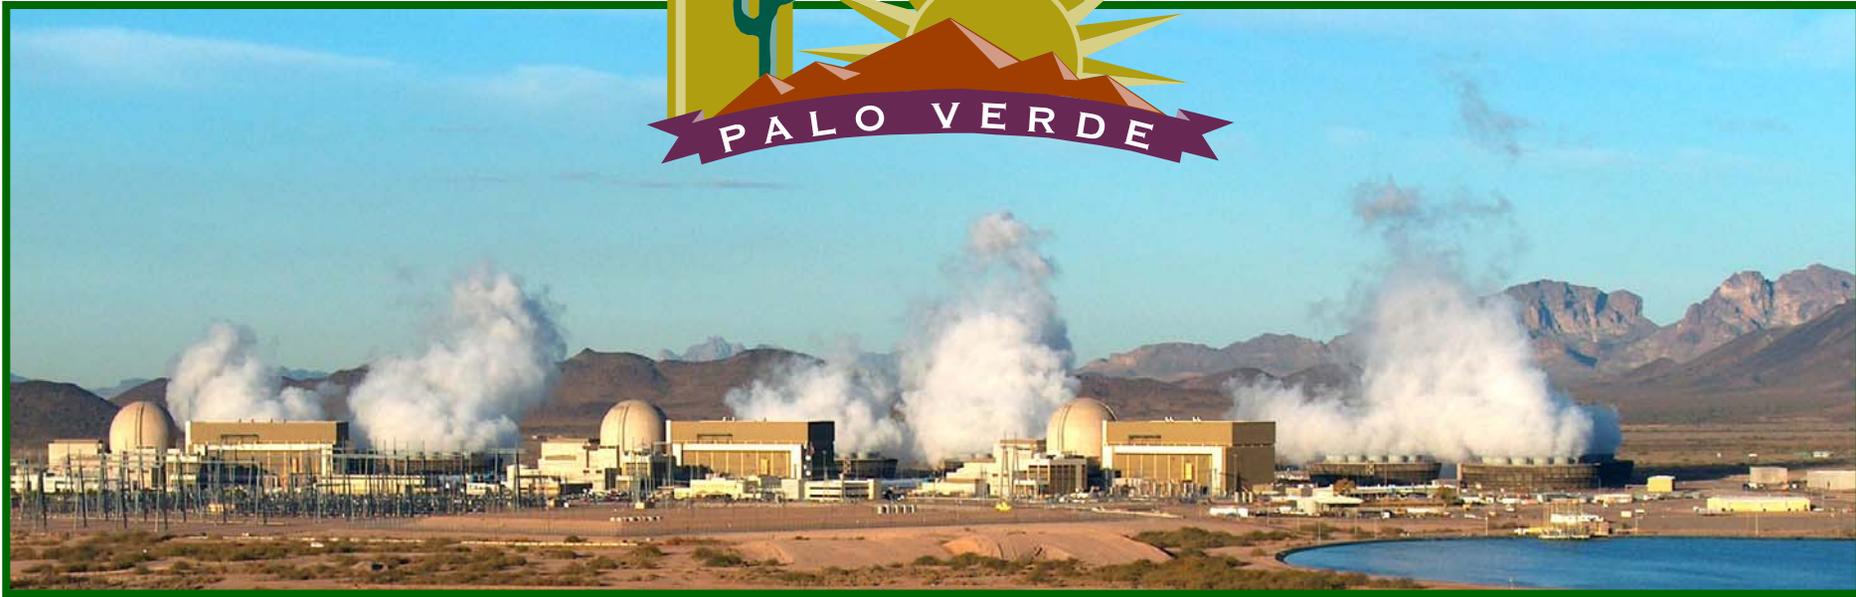

Palo Verde / NRC Meeting
Component Design Basis Review
(CDBR) Project

February 20, 2007

Agenda

- ◆ **Introductions and opening remarks**
- ◆ **Purpose of CDBR**
- ◆ **CDBR project scope**
- ◆ **CDBR organization chart**
- ◆ **Milestones completed**
- ◆ **Issues identified to date**
 - **Corrective Action status**


Purpose of CDBR

- ◆ **Verify the Design Bases have been correctly implemented for high risk-significant components and operator actions.**
- ◆ **Verify the capability of these components to perform their intended safety function.**
- ◆ **Verify interface requirements between NSSS vendor and Architect-Engineer are correct, complete and appropriately incorporated into Design Bases.**

CDBR Project Scope

- 1. High-risk component Design Basis review**
- 2. NSSS to BOP interface verification**
- 3. Design Basis calculation re-verification**
- 4. Industry Operating Experience reviews**
- 5. Margin management program development**
- 6. Design Basis Manual completion**
- 7. Design / licensing document update**

CDBR Organization

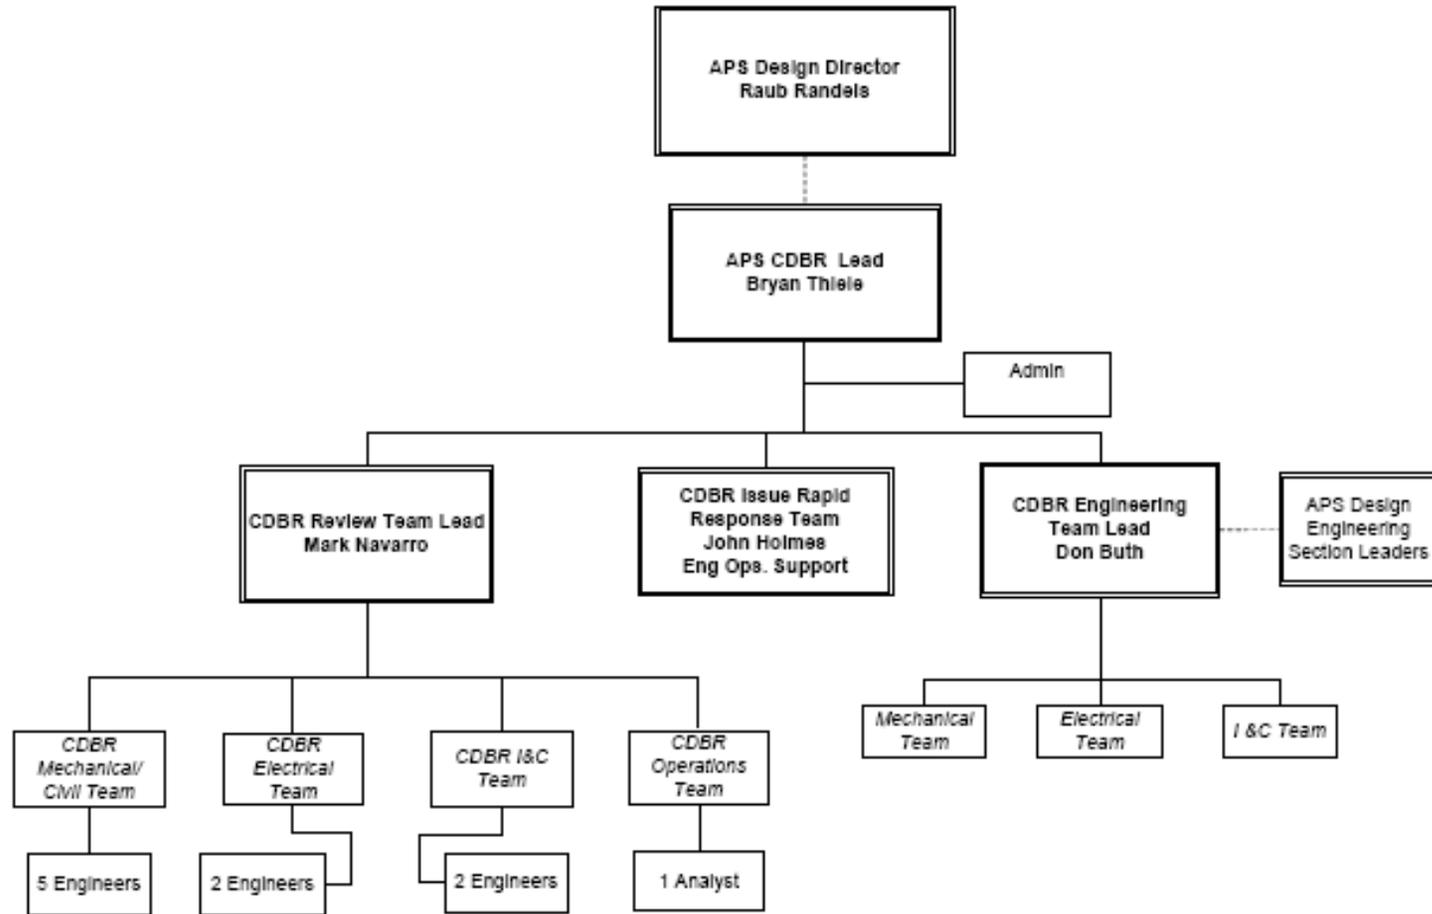

CDBR Project Deliverables

- ◆ **Component summary reports**
- ◆ **Updated Design Basis Manuals**
- ◆ **CRDRs, CRDR evaluations and corrective actions**
- ◆ **Trending of issues identified**
- ◆ **Updated/new calculations**
- ◆ **UFSAR licensing document change requests**
- ◆ **Margin management procedure**
- ◆ **Margin management metrics**

Phase 1 Milestones

- ◆ **Evaluate 3 PILOT components**
 - Status: completed 11/03/06
- ◆ **PRA to identify high-risk components/operator actions**
 - Status: completed 11/15/06
- ◆ **Identification of 20 low-margin components/6 low-margin operator actions**
 - Status: completed 12/01/06
- ◆ **Safety analysis provides list of credited operator actions**
 - Status: completed 1/5/07
- ◆ **Evaluation of 20 low-margin, high-risk components, 6 operator actions and 4 to 6 Significant Operating Experiences**
 - Status: Due 02/28/07 (on schedule)

20 High-Risk, Low-Margin Components

AFW PUMP B	HPSI PUMP A
CONDENSATE STORAGE TANK	CONTAINMENT SPRAY PUMP A
BATTERY A	ATMOSPHERIC DUMP VALVE 179
GAS TURBINE GENERATOR NO. 1	S/G #2 STEAM SUPPLY TO AFA-P01 BYPASS VALVE
SPRAY POND PUMP MOTOR A	S/G #2 STEAM SUPPLY TO AFA-P01
SPRAY POND PUMP SLAVE RELAY	CLASS 1E 4KV BUS 1E-PBB-S04
CKTBRK AUX FDW ISO VLVPUMP B TO SG-1	DG B OUTPUT BREAKER
EMERGENCY DIESEL GENERATOR B	CONTROL ELEMENT DRIVE MECHANISM
K204 RELAY (LOAD SHED 2)	REFUELING WATER TANK
LOP/LS CONTROL LOGIC	LPSI PUMP A

Phase 2

- ◆ **Evaluate high-risk components system-by-system**
 - **Begin with Auxiliary Feedwater (AF), then Safety Injection (SI)**
- ◆ **Perform interface requirement verification and calculation reverification in parallel with component evaluations for AF and SI**
- ◆ **Revise calculations and Design Basis Manual**

Phase 2


- ◆ **Develop screening criteria for evaluating similar components**
- ◆ **Develop detailed schedule for evaluating high-risk/shutdown/external event components**
- ◆ **Complete project in 3 to 4 years**

Identification and Resolution of Project Issues

- ◆ **Identify issues per CDBR procedure**
- ◆ **Use Palo Verde Action Request (PVAR) process**
- ◆ **Review potential degraded/nonconforming conditions with Rapid Response Team, including Operations**
 - **Use Operability Determination process as necessary**

113 CRDRs/PVARs as of 2/16/07

Yellow = ODs/Functional Assessments/Personnel Safety

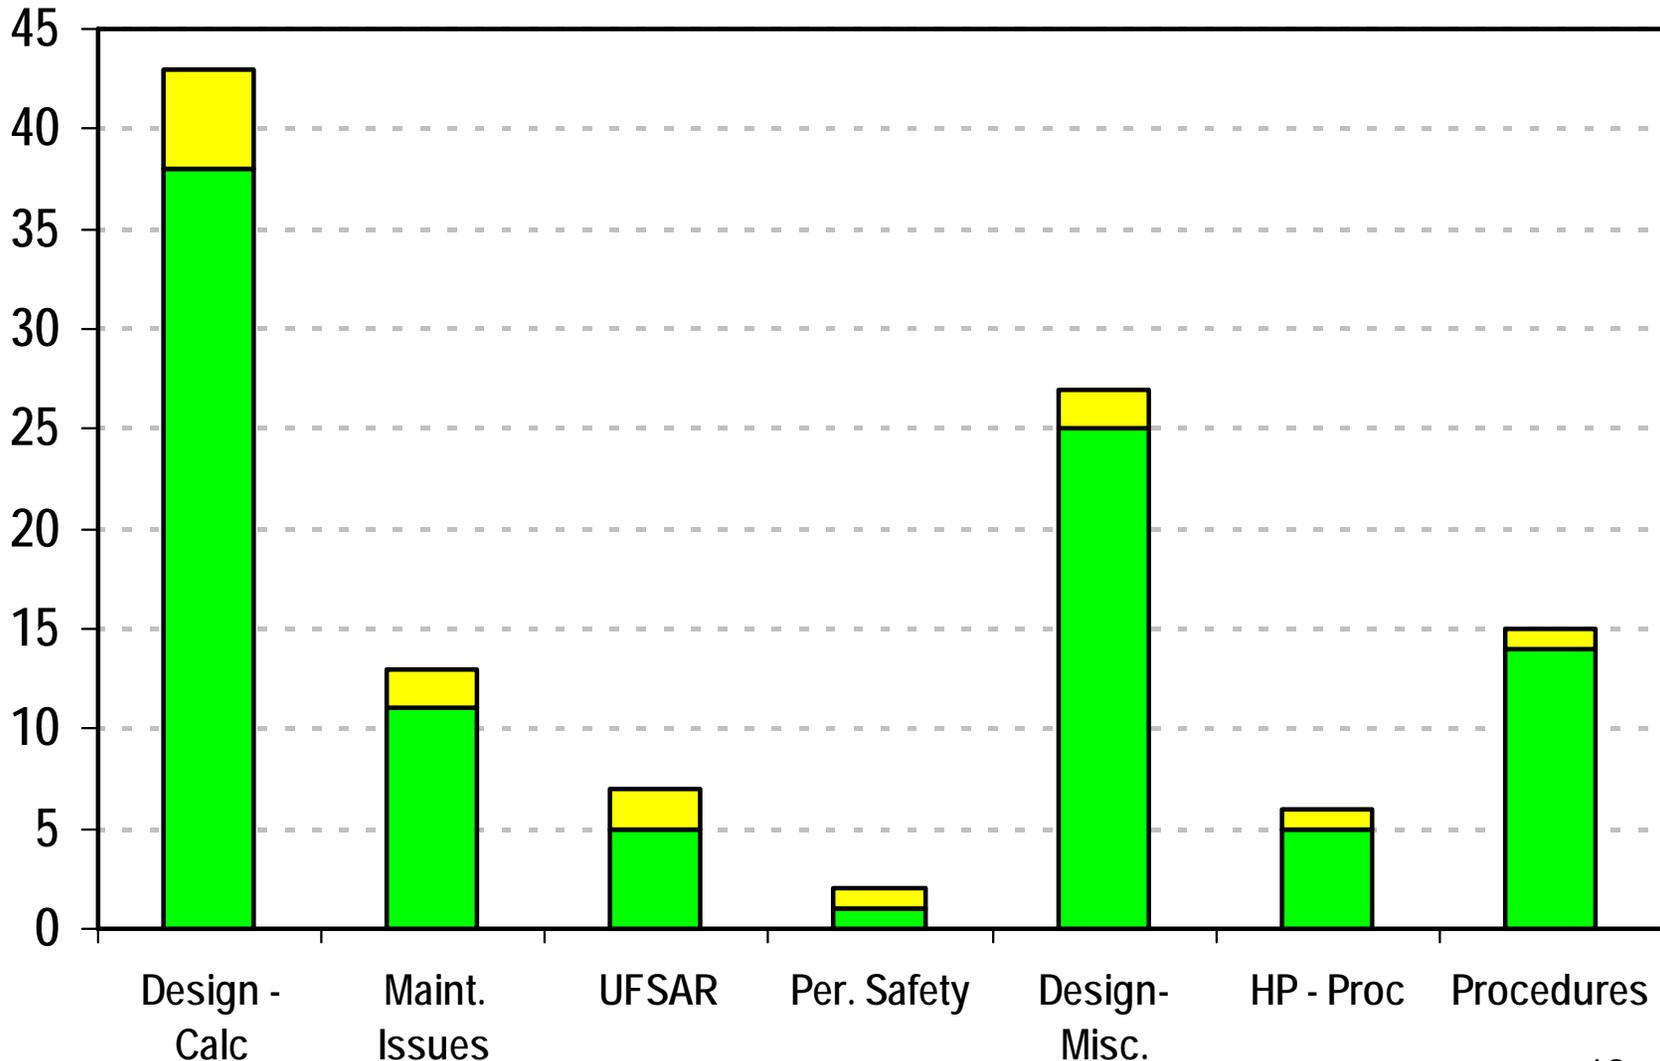

Noteworthy CRDRs/PVARs

◆ 7 Operability Determinations

- Class battery voltage > 140 Vdc
- ADV nitrogen line had extra fitting installed
- ADV nitrogen accumulator capacity
- LPSI and Containment Spray (CS) room heat loads
- CS motor oil leakage
- CS calculation discrepancies (2)

◆ 4 Functional Assessments

- AF room drain line check valve debris
- DG fuel oil cross-connect line
- GTG starting diesel fuel oil requirements
- GTG aligned to class bus in >1 hour (simulation)

CRDR/CRAIs Status

February 16, 2007

- ◆ **113 PVARs generated**
 - 125 CRDR Action Items (CRAIs)
 - 39 PVARs being dispositioned (identify action items)
 - 11 Corrective Maintenance Work Orders (CMWOs)
- ◆ **56 CRAIs completed**
- ◆ **5 CMWOs completed**