Big Rock Point Restoration Project – RSRC Update

July 13, 2005

Turbine Building Preparations

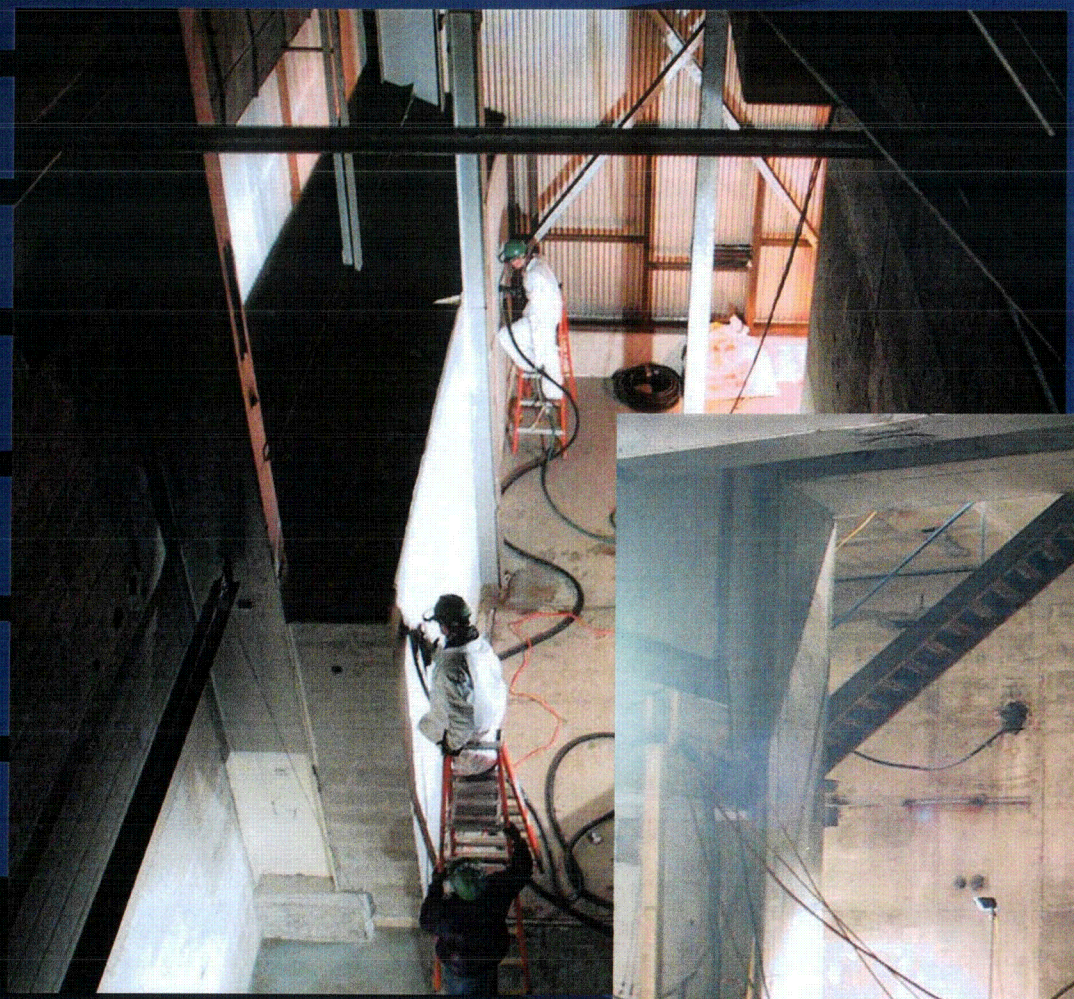

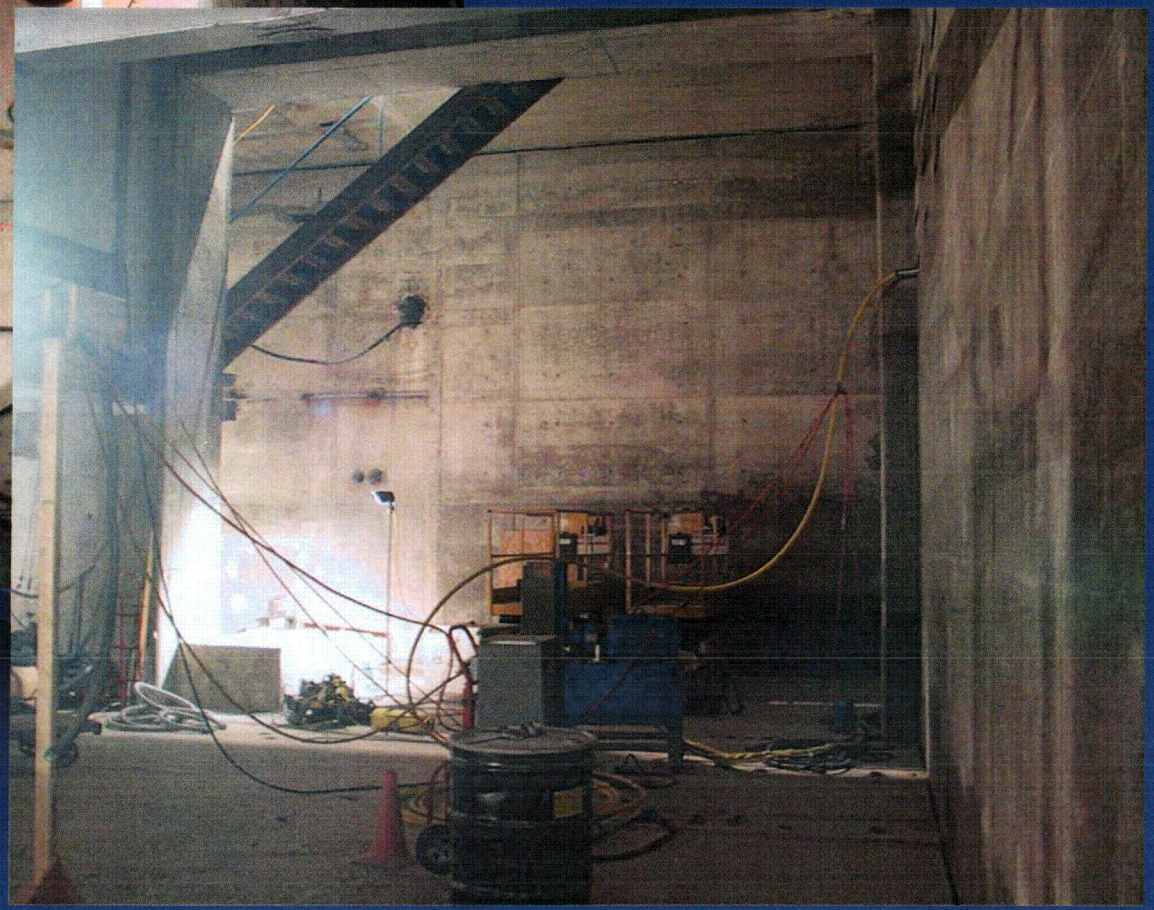

CAUTION

Building Surveys

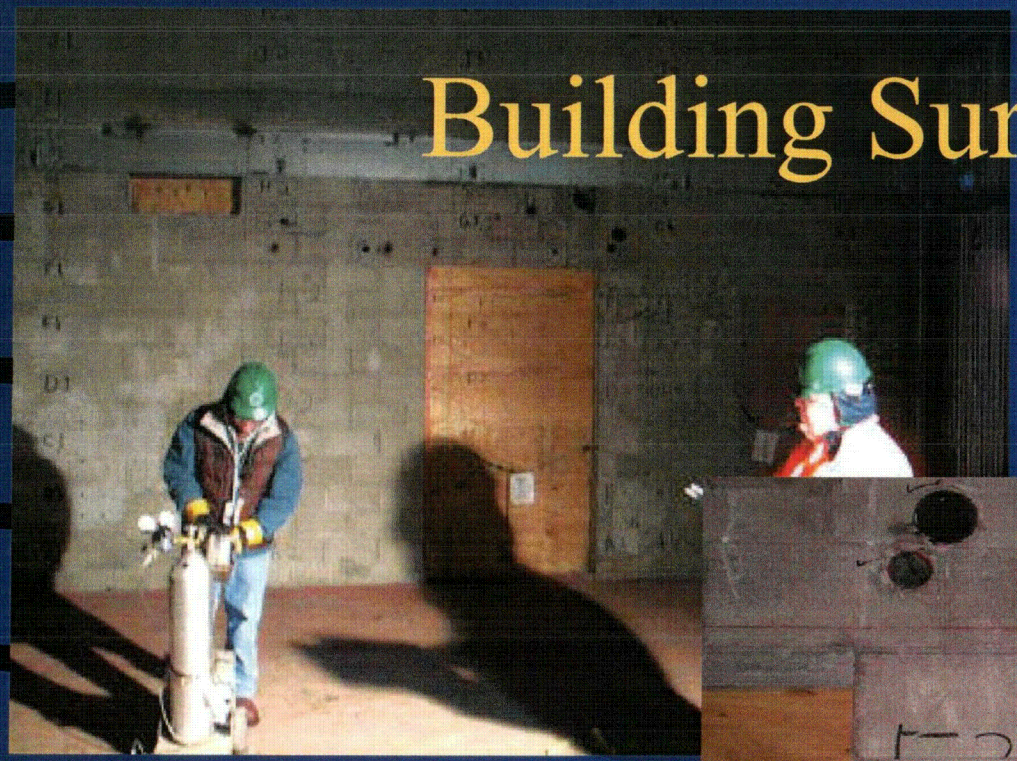

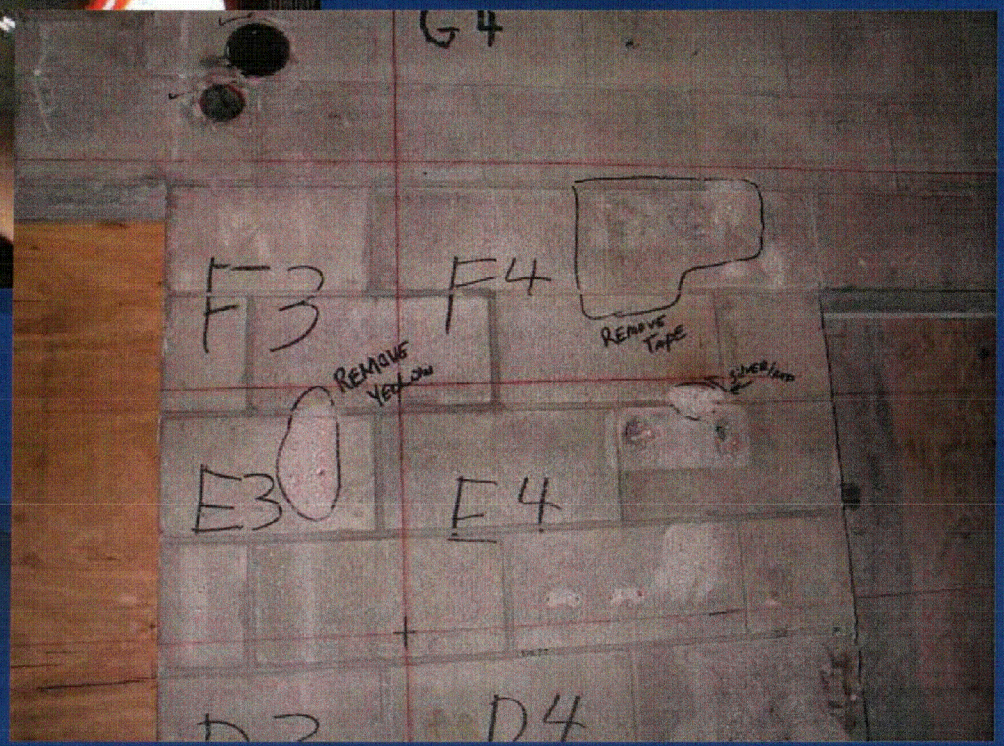

Screenhouse Demolition

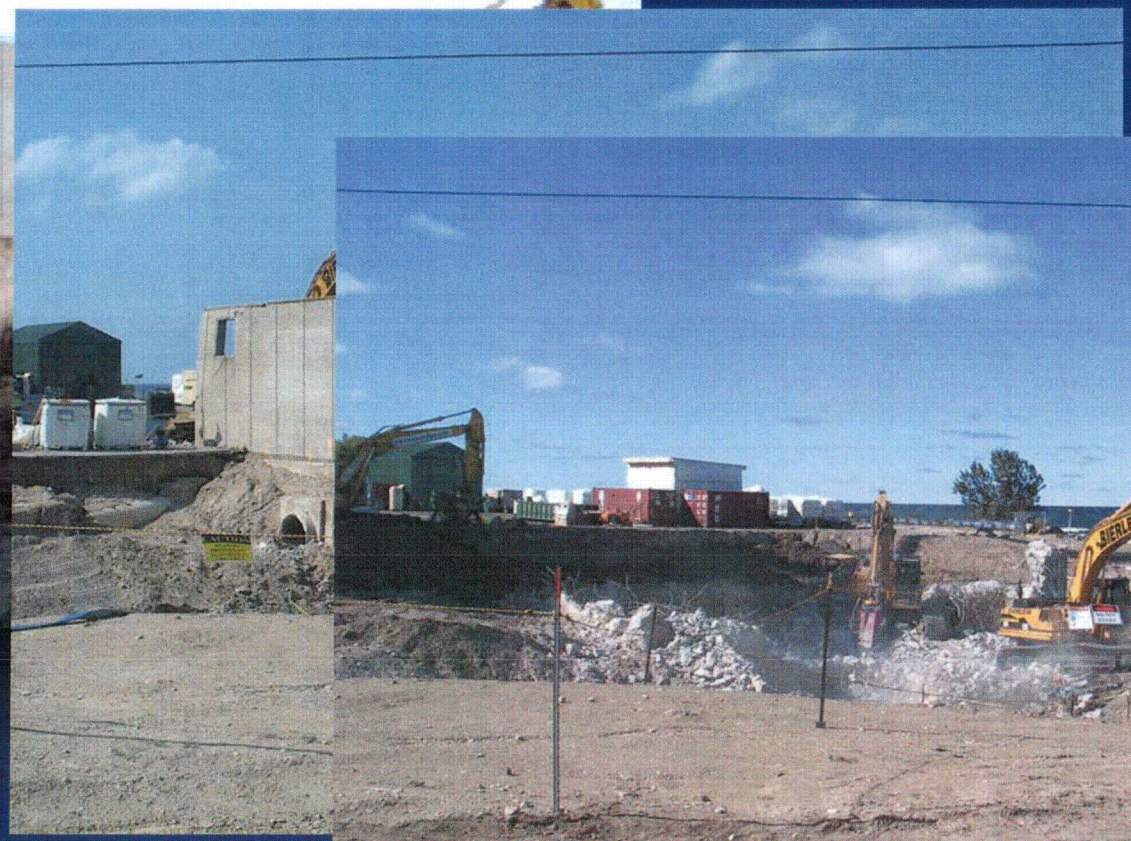

Discharge Canal Remediation

Activated Concrete Removal

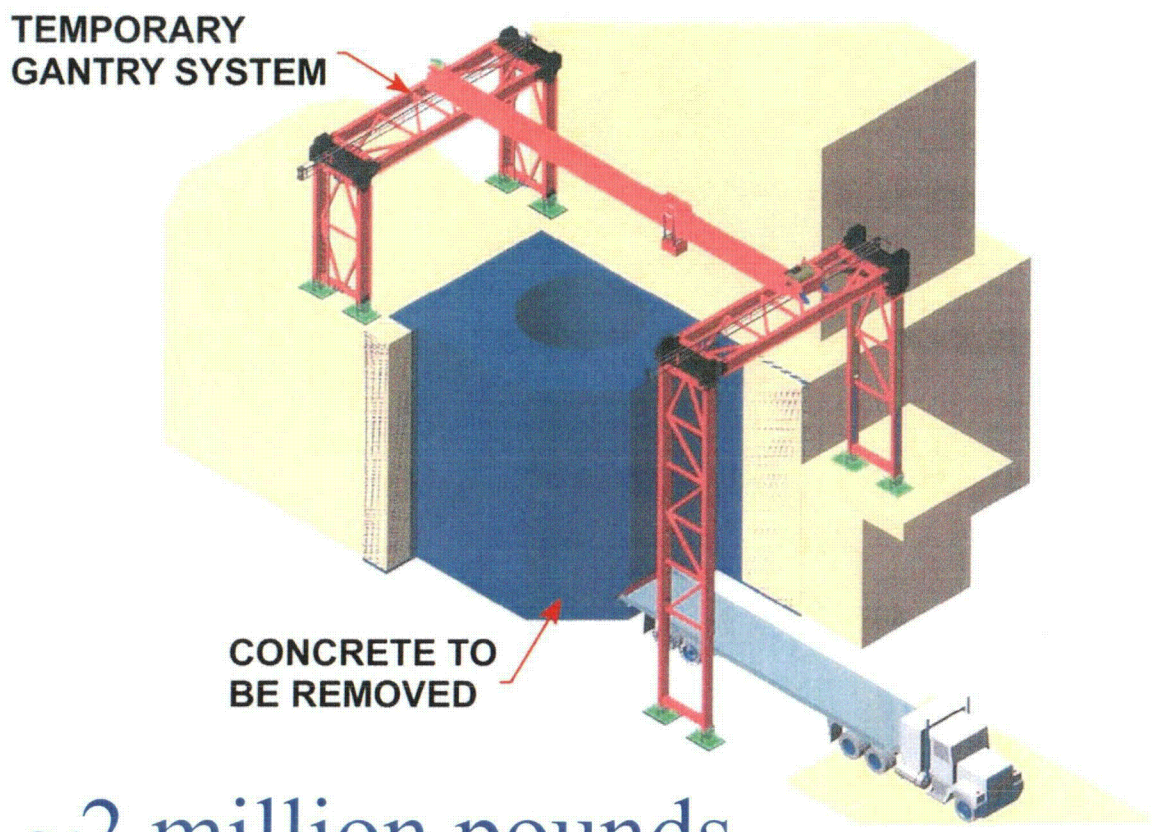

~2 million pounds

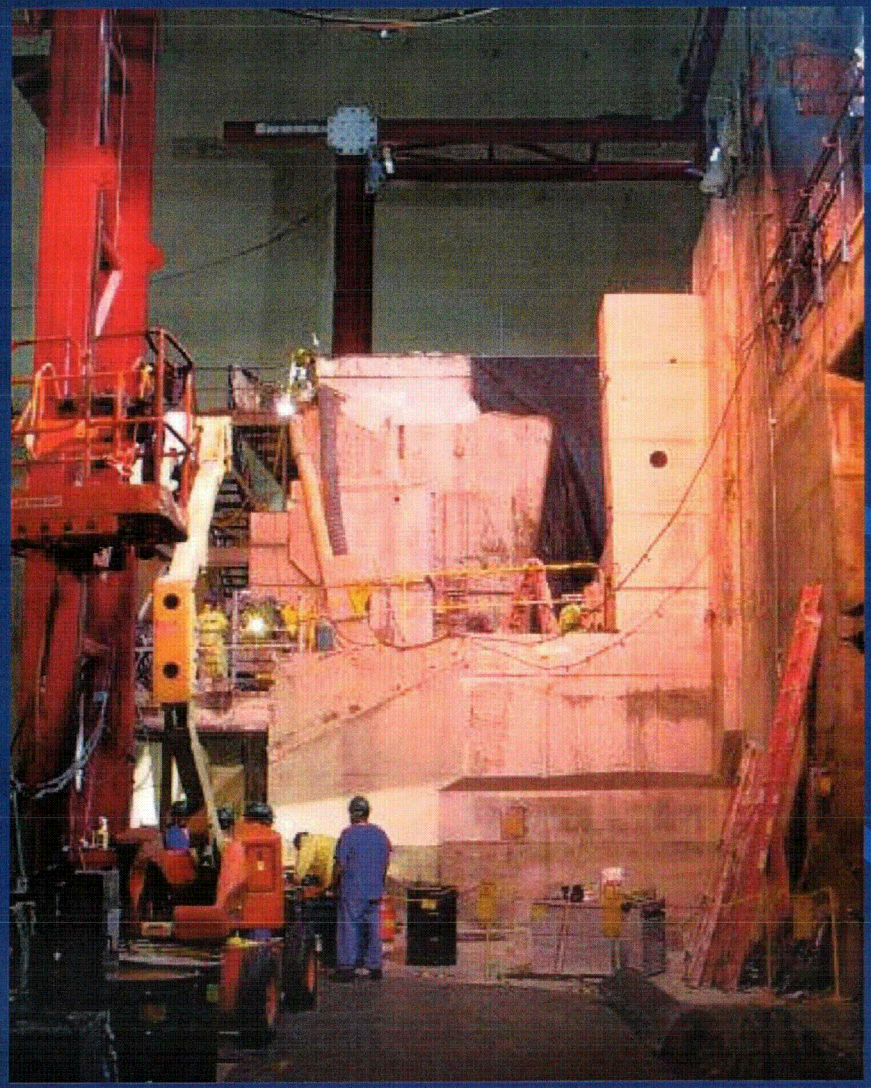

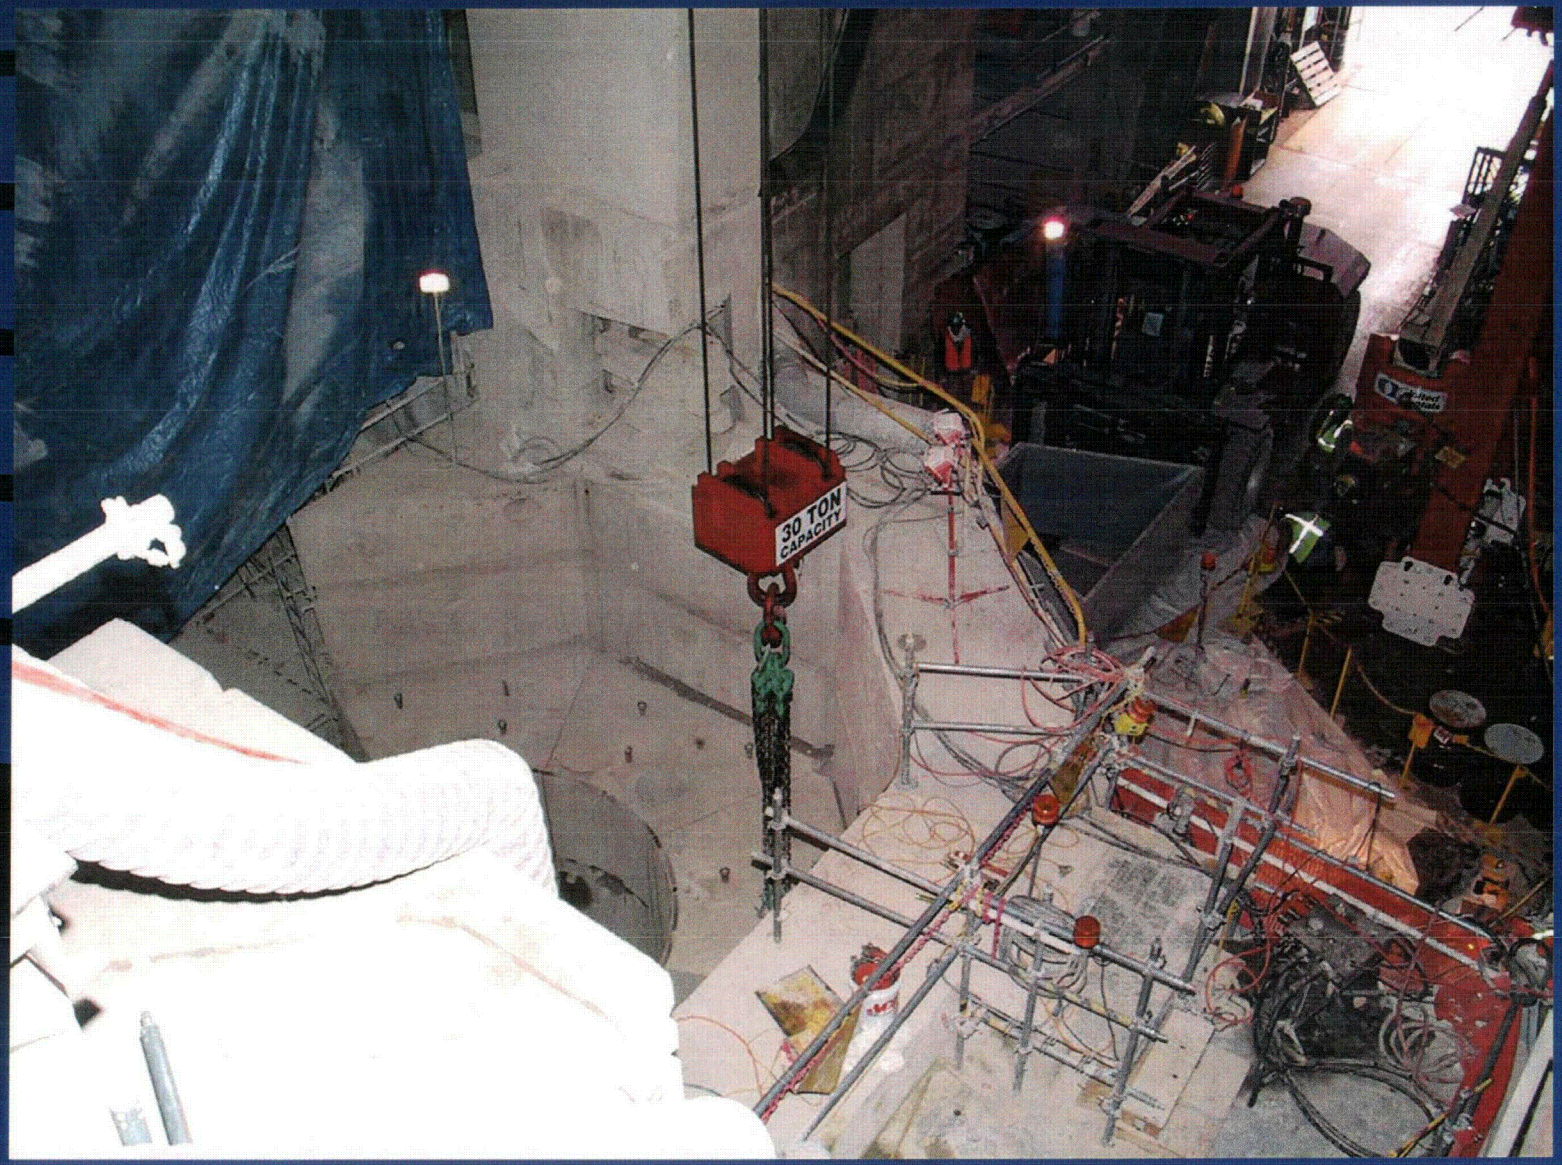
30 TON
CAPACITY

C

Ventilation Stack

October 11, 2004

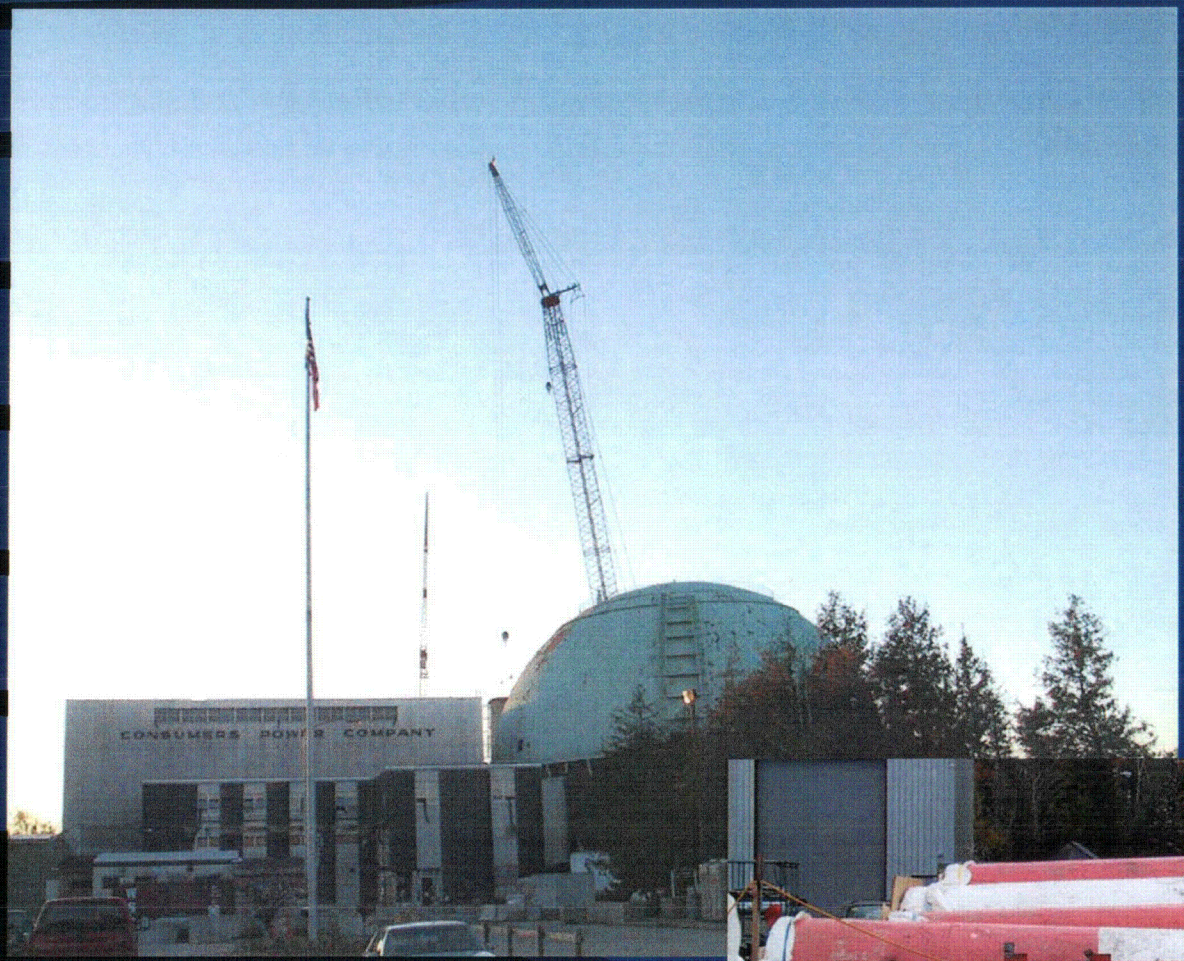
CONSUMERS POWER COMPANY

300

BERLIN

Administration Building

CONSUMERS POWER COMPANY
BIERLEIN
BIERLEIN
BIERLEIN
67
TW6830

Turbine & Service Building Demolition

BIERLEIN
BIERLEIN
CAT

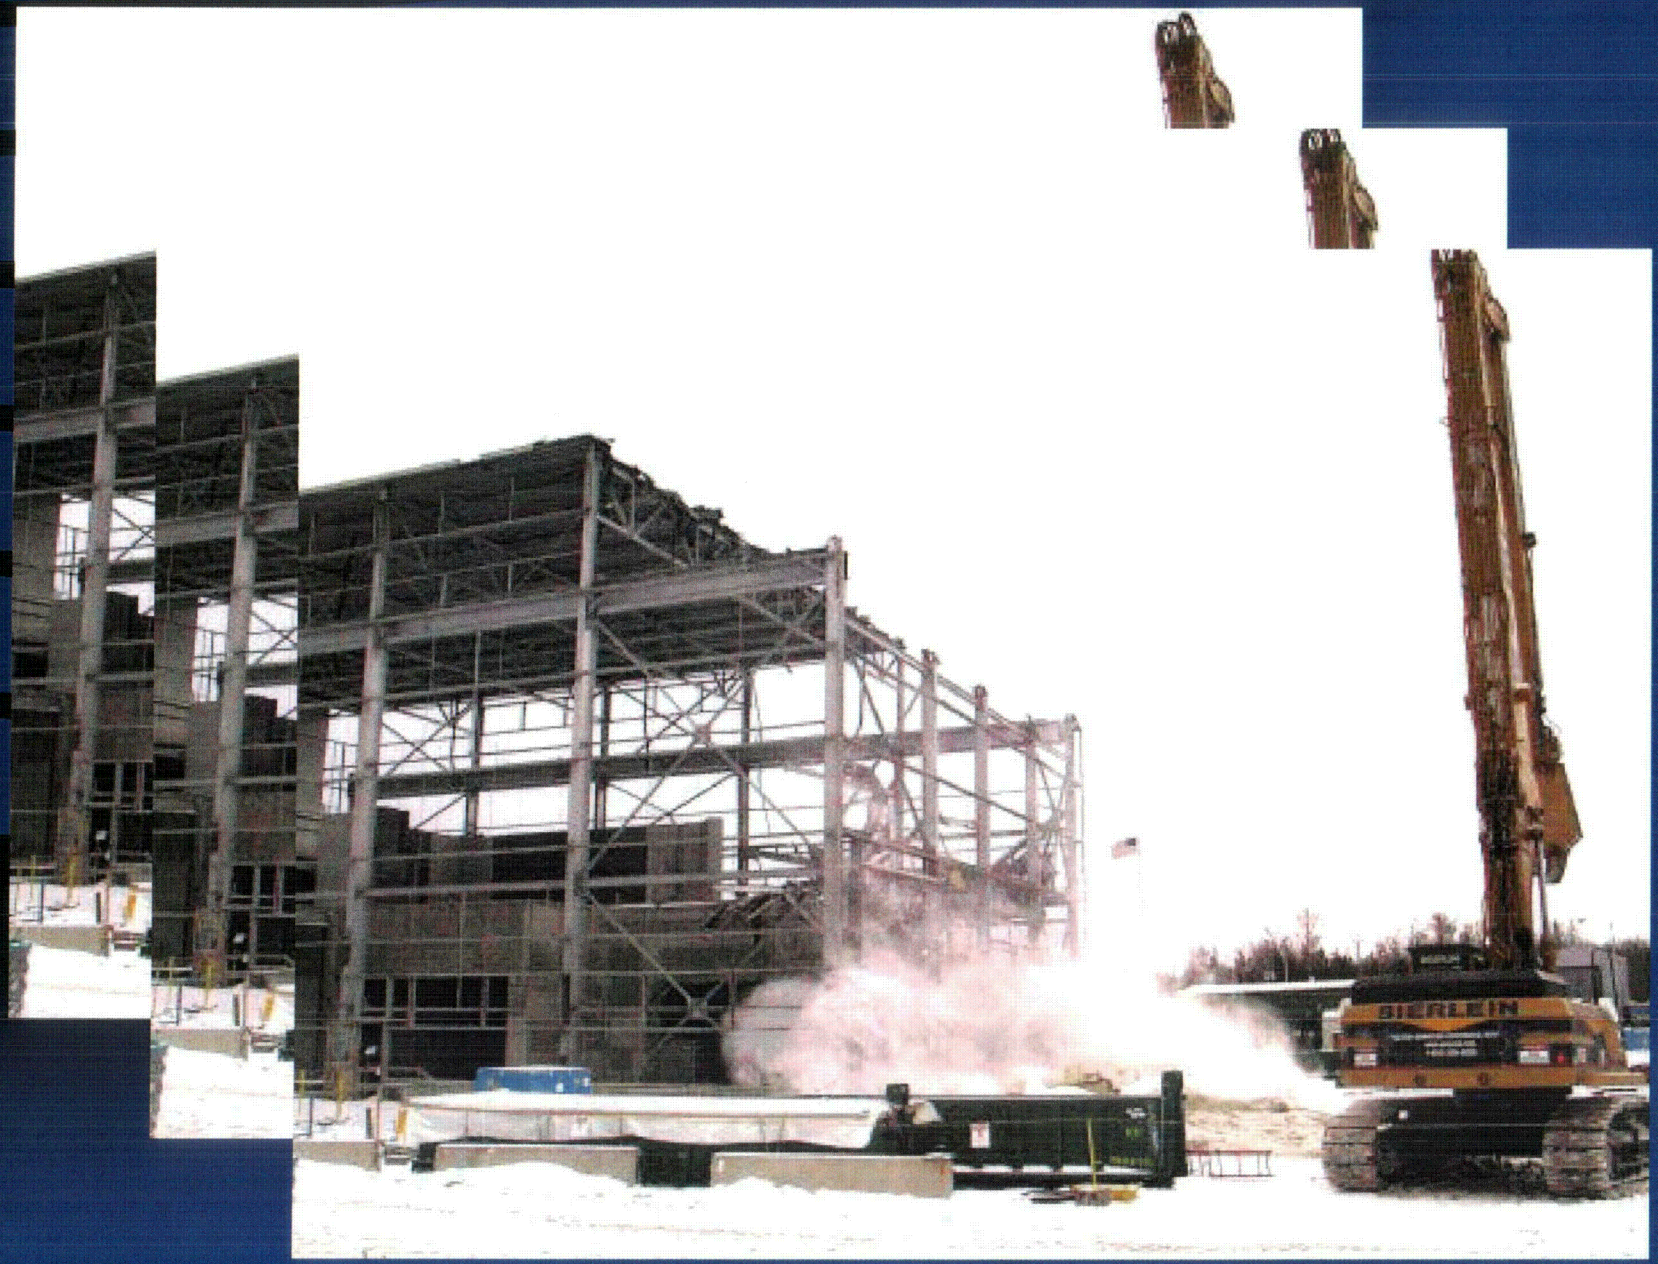
BIERLEIN

BIERLEIN

GIERLEIN
GIERLEIN
GIERLEIN

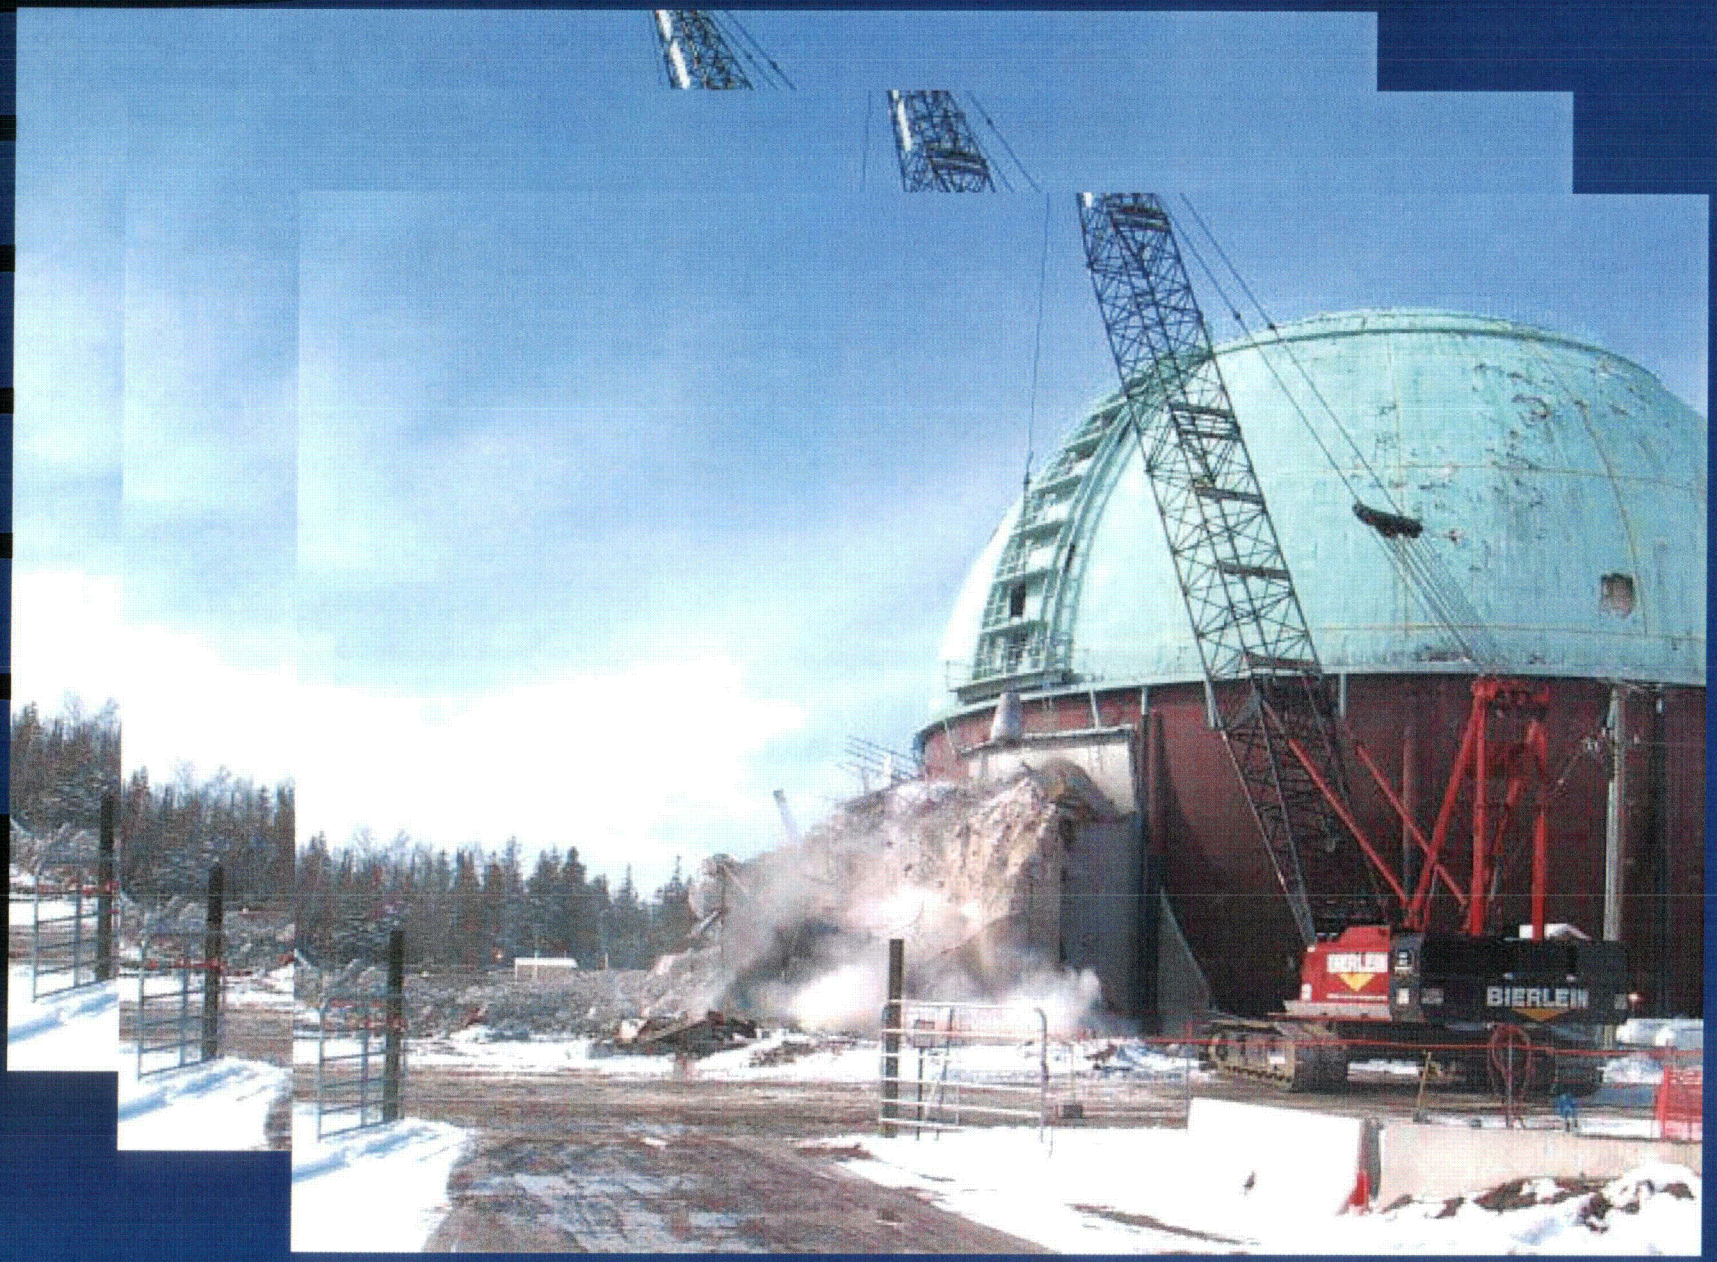
BIERLEIN