



U.S. NUCLEAR REGULATORY COMMISSION
STANDARD REVIEW PLAN

BRANCH TECHNICAL POSITION 6-2

MINIMUM CONTAINMENT PRESSURE MODEL FOR PWR ECCS PERFORMANCE EVALUATION

REVIEW RESPONSIBILITIES

Primary - Organization responsible for the review of component integrity issues related to engineered safety features

Secondary - None

A. BACKGROUND

10 CFR Part 50, Appendix K, Paragraph I.D.2, requires that the containment pressure used to evaluate the performance capability of a pressurized-water reactor emergency core cooling system ECCS not exceed a pressure calculated conservatively for that purpose. It further requires the calculation to include the effects of operation of all installed pressure-reducing systems and processes. Therefore, the following branch technical position has been developed as guidance in a minimum containment pressure analysis. The approach described applies only to the ECCS-related containment pressure evaluation pursuant to 10 CFR 50.46(a)(1)(ii) and not to the containment functional capability evaluation for postulated design-basis accidents.

Revision 3 - March 2007

USNRC STANDARD REVIEW PLAN

This Standard Review Plan, NUREG-0800, has been prepared to establish criteria that the U.S. Nuclear Regulatory Commission staff responsible for the review of applications to construct and operate nuclear power plants intends to use in evaluating whether an applicant/licensee meets the NRC's regulations. The Standard Review Plan is not a substitute for the NRC's regulations, and compliance with it is not required. However, an applicant is required to identify differences between the design features, analytical techniques, and procedural measures proposed for its facility and the SRP acceptance criteria and evaluate how the proposed alternatives to the SRP acceptance criteria provide an acceptable method of complying with the NRC regulations.

The standard review plan sections are numbered in accordance with corresponding sections in Regulatory Guide 1.70, "Standard Format and Content of Safety Analysis Reports for Nuclear Power Plants (LWR Edition)." Not all sections of Regulatory Guide 1.70 have a corresponding review plan section. The SRP sections applicable to a combined license application for a new light-water reactor (LWR) are based on Regulatory Guide 1.206, "Combined License Applications for Nuclear Power Plants (LWR Edition)."

These documents are made available to the public as part of the NRC's policy to inform the nuclear industry and the general public of regulatory procedures and policies. Individual sections of NUREG-0800 will be revised periodically, as appropriate, to accommodate comments and to reflect new information and experience. Comments may be submitted electronically by email to NRR_SRP@nrc.gov.

Requests for single copies of SRP sections (which may be reproduced) should be made to the U.S. Nuclear Regulatory Commission, Washington, DC 20555, Attention: Reproduction and Distribution Services Section, or by fax to (301) 415-2289; or by email to DISTRIBUTION@nrc.gov. Electronic copies of this section are available through the NRC's public Web site at <http://www.nrc.gov/reading-rm/doc-collections/nuregs/staff/sr0800/>, or in the NRC's Agencywide Documents Access and Management System (ADAMS), at <http://www.nrc.gov/reading-rm/adams.html>, under Accession # ML070740442.

B. BRANCH TECHNICAL POSITION

1. Input Information for Model

- A. Initial Containment Internal Conditions. The minimum containment gas temperature, minimum containment pressure, and maximum humidity encountered under limiting normal operating conditions should be used. Ice condenser plants should use the maximum containment gas temperature.
- B. Initial Outside Containment Ambient Conditions. A reasonably low ambient temperature external to the containment should be used.
- C. Containment Volume. The maximum net free containment volume should be used. This maximum free volume should be determined from the gross containment volume minus the volumes of such internal structures as walls and floors, structural steel, major equipment, and piping. The individual volume calculations should reflect the uncertainty in the component volumes.
- D. Purge Supply and Exhaust Systems. If purge system operation is proposed during the reactor operating modes of startup, power operation, hot standby, and hot shutdown, the system lines should be assumed to be initially open.

2. Active Heat Sinks

- A. Spray and Fan Cooling Systems. The operation of all engineered safety feature containment heat removal systems operating at maximum heat removal capacity (i.e., with all containment spray trains operating at maximum flow conditions and all emergency fan cooler units operating) should be assumed. In addition, the minimum temperature of the stored water for the spray cooling system and the cooling water supplied to the fan coolers, based on technical specification limits, should be assumed.

Deviations from the foregoing are accepted if the worst conditions for a single active failure, stored water temperature, and cooling water temperature can be shown to have been selected from the standpoint of the overall ECCS model.

- B. Containment Steam Mixing With Spilled ECCS Water. The spillage of subcooled ECCS water into the containment provides an additional heat sink as the subcooled ECCS water mixes with the steam in the containment. The effect of the steam-water mixing should be considered in the containment pressure calculations.
- C. Containment Steam Mixing With Water from Ice Melt. The water from ice melting in an ice condenser containment provides an additional heat sink as the subcooled water mixes with the steam while draining from the ice condenser into the lower containment volume. The effect of the steam-water mixing should be considered in the containment pressure calculations.

3. Passive Heat Sinks

A. Identification. The passive heat sinks that should be included in the containment evaluation model should be established by identifying structures and components within the containment that could influence the pressure response. Structures and components that should be included are listed in Table 1. Data on passive heat sinks have been compiled from previous reviews and used as a basis for the simplified model outlined below. This model is acceptable for minimum containment pressure analyses for construction permit applications until a complete identification of available heat sinks can be made (i.e., at the operating license review). Where no detailed listing of heat sinks within the containment is provided, the following procedure may model the passive heat sinks within the containment:

- (i) Use the surface area and thickness of the primary containment steel shell or steel liner, anchors, and concrete, as appropriate.
- (ii) Estimate the exposed surface area of other steel heat sinks in accordance with Figure 1 and assume an average thickness of 9.53 mm (3/8 inch).
- (iii) Model the internal concrete structures as a slab with a thickness of 30.5 cm (one foot) and exposed surface of 15,000 m² (160,000 ft²).

Acceptable heat sink thermo-physical properties are shown in Table 2.

Applicants should provide a detailed list of passive heat sinks with appropriate dimensions and properties.

B. Heat Transfer Coefficients. The following conservative condensing heat transfer coefficients for heat transfer to the exposed passive heat sinks during the blowdown and post-blowdown phases of the loss-of-coolant accident should be used:

- (i) During the blowdown phase, assume a linear increase in the condensing transfer coefficient from $h_{\text{initial}} = 8 \text{ Btu/hr-ft}^2\text{-}^\circ\text{F}$, at $t = 0$, to a peak value four times greater than the maximum calculated condensing heat transfer coefficient at the end of blowdown, using the Tagami correlation,
$$h_{\text{max}} = 7.25(Q/Vt_p)^{0.62}$$

where h_{max} = maximum heat transfer coefficient, Btu/hr-ft²-°F
 Q = primary coolant energy, Btu
 V = net free containment volume, ft³
 t_p = time interval to end of blowdown, sec.

- (ii) During the long-term post-blowdown phase of the accident characterized by low turbulence in the containment atmosphere, assume condensing heat transfer coefficients 1.2 times greater than those predicted by the Uchida data and given in Table 3.

- (iii) During the transition phase of the accident between the end of blowdown and the long-term post-blowdown phase, a reasonably conservative exponential transition in the condensing heat transfer coefficient should be assumed (See Figure 2).

The calculated condensing heat transfer coefficients based on this method should be applied to all exposed passive heat sinks, both metal and concrete, and for both painted and unpainted surfaces.

Heat transfer between adjoining materials in passive heat sinks should be based on the assumption of no resistance to heat flow at the material interfaces. An example is the containment liner to concrete interface.

- (iv) Variations from these guidelines may be acceptable if the overall ECCS performance evaluation model produces an acceptable peak calculated fuel cladding temperature.

C. REFERENCES

1. 10 CFR Part 50.46, "Acceptance Criteria for Emergency Core Cooling Systems for Light Water Nuclear Power Reactors," and 10 CFR Part 50, Appendix K, "ECCS Evaluation Models."
2. T. Tagami, "Interim Report on Safety Assessment and Facilities Establishment Project in Japan for Period Ending June 1965 (No. 1)," prepared for the National Reactor Testing Station, February 28, 1966 (unpublished work).
3. H. Uchida, A. Oyama, and Y. Toga, "Evaluation of Post-Incident Cooling Systems of Light-Water Power Reactors," Proc. Third International Conference on the Peaceful Uses of Atomic Energy, Volume 13, Session 3.9, United Nations, Geneva (1964).

TABLE 1 IDENTIFICATION OF CONTAINMENT HEAT SINKS

1. Containment Building (e.g., liner plate and external concrete walls, floor, sump, and linear anchors).
2. Containment Internal Structures (e.g., internal separation walls and floors, refueling pool and fuel transfer pit walls, and shielding walls).
3. Supports (e.g., reactor vessel, steam generator, pumps, tanks, major components, pipe supports, and storage racks).
4. Uninsulated Systems and Components (e.g., cold water systems, heating, ventilation and air conditioning systems, pumps, motors, fan coolers, recombiners, and tanks).
5. Miscellaneous Equipment (e.g., ladders, gratings, electrical cables, trays, and cranes).

TABLE 2 HEAT SINK THERMOPHYSICAL PROPERTIES

Material	Density kg/m ³ (lb/ft ³)	Specific Heat kJ/kg-°K(Btu/lb- °F)	Thermal Conductivity W/m-°K(Btu/hr-ft- °F)
Concrete	2330 (145)	0.654 (0.156)	1.6 (0.92)
Steel	7850 (490)	0.503 (0.12)	47 (27.0)

TABLE 3 UCHIDA HEAT TRANSFER COEFFICIENTS

Mass Ratio $\frac{\text{kg (lb) air}}{\text{kg (lb) steam}}$	Heat Transfer Coefficient W/m ² -°K (Btu/hr-ft ² - °F)	Mass Ratio $\frac{\text{kg(lb) air}}{\text{kg(lb) steam}}$	Heat Transfer Coefficient W/m ² -°K (Btu/hr-ft ² - °F)
50	12 (2)	3	165 (29)
20	46 (8)	2.3	211 (37)
18	52 (9)	1.8	262 (46)
14	57 (10)	1.3	358 (63)
10	80 (14)	0.8	557 (98)
7	97 (17)	0.5	795 (140)
5	120 (21)	0.1	1590 (280)
4	137 (24)		

Figure 1
Area of Steel Heat Sinks Inside Containment


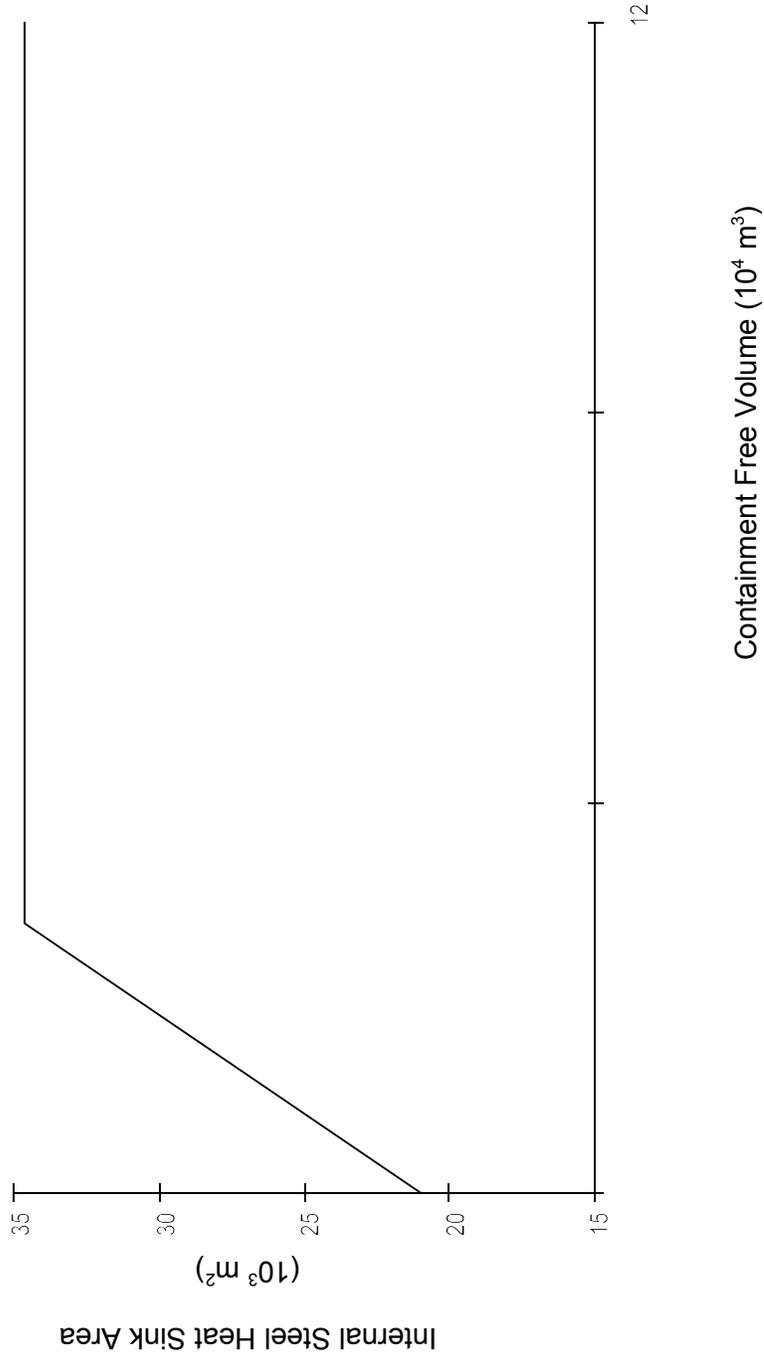


Figure 2
 Condensing Heat Transfer Coefficients for Static Heat Sinks

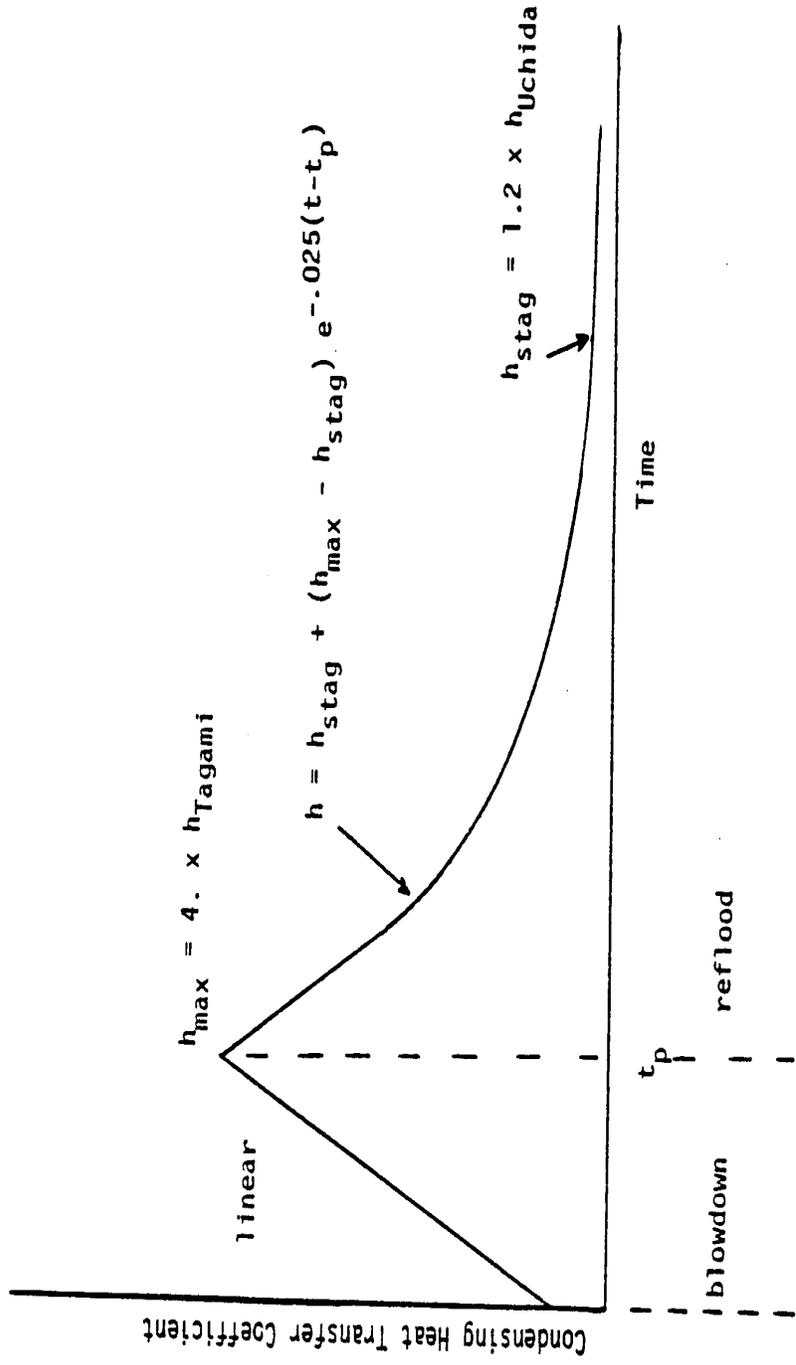

PAPERWORK REDUCTION ACT STATEMENT

The information collections contained in the Standard Review Plan are covered by the requirements of 10 CFR Part 50 and 10 CFR Part 52, and were approved by the Office of Management and Budget, approval number 3150-0011 and 3150-0151.

PUBLIC PROTECTION NOTIFICATION

The NRC may not conduct or sponsor, and a person is not required to respond to, a request for information or an information collection requirement unless the requesting document displays a currently valid OMB control number.
