



BRUCE H HAMILTON
Vice President
Oconee Nuclear Station

Duke Energy Corporation
ON01VP / 7800 Rochester Highway
Seneca, SC 29672

864 885 3487
864 885 4208 fax
bhamilton@duke-energy.com

April 2, 2007

U. S. Nuclear Regulatory Commission
Document Control Desk
Washington, D. C. 20555

Subject: Duke Power Company LLC d/b/a Duke Energy Carolinas, LLC
Oconee Nuclear Site Docket No. 50-289 ~~289~~ 270
Core Operating Limits Report (COLR)

Gentlemen:

Attached, pursuant to Oconee Technical Specifications 5.6.5, is an information copy of a revision to the Core Operating Limits Report for Oconee Unit 2, Cycle 23, Rev. 26.

Very truly yours,

Bruce H. Hamilton Site, Vice President
Oconee Nuclear Site

Attachment

A001

NRC Document Control Desk

April 2, 2007

Page 2

xc w/att: Mr. W. D. Travers, Regional Administrator
U. S. Nuclear Regulatory Commission, Region II

Mr. L. N. Olshan, Project Manager
Office of Nuclear Reactor Regulation

Mr. Dan Rich
Senior Resident Inspector
Oconee Nuclear Site

NRC Document Control Desk

April 2, 2007

Page 3

bxc wo/att: NSRB - EC05P

bxc w/att: ELL
ONS Document Management

PRIORITY SuperRush

DISPOSITION OF THE ORIGINAL DOCUMENT WILL BE TO THE TRANSMITTAL SIGNATURE UNLESS RECIPIENT IS OTHERWISE IDENTIFIED BELOW

- 1) 00620 DOC MGMT MICROFILM EC04T
- 2) 00813 DOC MGMT EC04T ORIGINAL
- ③ 06358 ONS REGUL COMPLIANCE ON03RC
- 4) 06700 ONS MANUAL MASTER FILE ON03DM
- 5) 06937 R R ST CLAIR EC08G

FOR INFORMATION ONLY

**Duke Energy
DOCUMENT TRANSMITTAL FORM**

REFERENCE

NUCLEAR GENERAL OFFICE
 OCONEE NUCLEAR STATION
 WORK ITEM: EXEMPTION M-5
 RESP GROUP: NE
 RECORD RETENTION: 003587

OCONEE 2 CYCLE 23
 CORE OPERATING LIMITS REPORT
 Page 1 of 1

Date: 03/27/07

Document Transmittal #: DUK070860020

QA CONDITION Yes No

OTHER ACKNOWLEDGEMENT REQUIRED Yes

IF QA OR OTHER ACKNOWLEDGEMENT REQUIRED, PLEASE ACKNOWLEDGE RECEIPT BY RETURNING THIS FORM TO:

Duke Energy
 P.O. Box 1006
 Energy Center
 EC04T
 Charlotte, N.C. 28201-1006

Rec'd By *Paul Payne*
 Date 4/2/07

DOCUMENT NO	QA COND	REV #/ DATE	DISTR CODE	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	TOTAL
ONEI-0400-051	1	026 03/27/07	NOMD-27	V1	X	V1	V1	V1											4

REMARKS: DUKE
 DOCUMENT RELEASE EXEMPT FROM NUCLEAR MODIFICATION PROGRAM

THOMAS C GEER
 NUCLEAR STATION ENGR MANAGER
 GS-SVP NUCLEAR SUPPORT

BY:
 J W SIMMONS JWS/JAK EC08H

Duke Energy


Oconee 2 Cycle 23

Core Operating Limits Report


QA Condition 1

Prepared By : D.S. Orr 

Date : 3-22-07

Checked By : G.M. Presnell 

Date : March 22, 2007

CDR By : A.W. Strange 

Date : 3-26-07

Approved By : R.R. St.Clair 

Date : 3-26-2007

INSPECTION OF ENGINEERING INSTRUCTIONS

Inspection Waived By: P. R. St. Clair
 (Sponsor)

Date: 3/26/2007

<u>CATAWBA</u>		
	Inspection Waived	
MCE (Mechanical & Civil)	<input type="checkbox"/>	Inspected By/Date: _____
RES (Electrical Only)	<input type="checkbox"/>	Inspected By/Date: _____
RES (Reactor)	<input type="checkbox"/>	Inspected By/Date: _____
MOD	<input type="checkbox"/>	Inspected By/Date: _____
Other (_____)	<input type="checkbox"/>	Inspected By/Date: _____

<u>OCONEE</u>		
	Inspection Waived	
MCE (Mechanical & Civil)	<input checked="" type="checkbox"/>	Inspected By/Date: _____
RES (Electrical Only)	<input checked="" type="checkbox"/>	Inspected By/Date: _____
RES (Reactor)	<input checked="" type="checkbox"/>	Inspected By/Date: _____
MOD	<input checked="" type="checkbox"/>	Inspected By/Date: _____
Other (_____)	<input type="checkbox"/>	Inspected By/Date: _____

<u>MCGUIRE</u>		
	Inspection Waived	
MCE (Mechanical & Civil)	<input type="checkbox"/>	Inspected By/Date: _____
RES (Electrical Only)	<input type="checkbox"/>	Inspected By/Date: _____
RES (Reactor)	<input type="checkbox"/>	Inspected By/Date: _____
MOD	<input type="checkbox"/>	Inspected By/Date: _____
Other (_____)	<input type="checkbox"/>	Inspected By/Date: _____

Oconee 2 Cycle 23
Core Operating Limits Report

Insertion Sheet for Revision 26

This revision is not valid until the end of operation for Oconee 2 Cycle 22.

Remove these Revision 25 pages

Insert these Revision 26 pages

1 - 33

1 - 33

Revision Log

Revision	Effective Date	Pages Revised	Pages Added	Pages Deleted	Total Effective Pages
Oconee 2 Cycle 23 revisions below					
26	Mar 2007	1 - 33		-	33
Oconee 2 Cycle 22 revisions below					
25	Oct 2005	1 - 33		-	33
Oconee 2 Cycle 21 revisions below					
24	Aug 2005	1 - 4, 6		-	33
23	Mar 2005	1 - 5		-	33
22	Dec 2004	1 - 3, 30		-	33
21	Apr 2004	1 - 33		-	33
Oconee 2 Cycle 20 revisions below					
20	Feb 2004	1 - 3, 5		-	33
19	Nov 2003	1-4,8-10,12-13,29	1a	-	33
18	Oct 2002	1-3,14,16,24,30		-	32
17	Oct 2002	1 - 31	32	-	32
Oconee 2 Cycle 19 revisions below					
16	May 2001	1 - 31		-	31

Oconee 2 Cycle 23

1.0 Error Adjusted Core Operating Limits

The Core Operating Limits Report for O2C23 has been prepared in accordance with the requirements of TS 5.6.5. The core operating limits within this report have been developed using NRC approved methodology identified in references 1 through 11. The RPS protective limits and maximum allowable setpoints are documented in references 12 through 14. These limits are validated for use in O2C23 by references 15 through 17. The O2C23 analyses assume a design flow of 107.5% of 88,000 gpm per RCS pump, radial local peaking ($F_{\Delta h}$) of 1.714, and axial peaking factor (F_z) of 1.5.

The error adjusted core operating limits included in section 1 of the report incorporate all necessary uncertainties and margins required for operation of the O2C23 reload core.

1.1 References

1. Nuclear Design Methodology Using CASMO-3 / SIMULATE-3P, DPC-NE-1004-A, Revision 0, SER dated November 23, 1992.
2. Oconee Nuclear Station Reload Design Methodology II, DPC-NE-1002-A, Revision 2, SER dated October 1, 1985.
3. Oconee Nuclear Station Reload Design Methodology, NFS-1001A, Revision 5, SER dated December 8, 2000.
4. ONS Core Thermal Hydraulic Methodology Using VIPRE-01, DPC-NE-2003-PA, Revision 1, SER dated June 23, 2000.
5. Thermal Hydraulic Statistical Core Design Methodology, DPC-NE-2005-PA, Revision 3, SER dated September 1, 2002.
6. Fuel Mechanical Reload Analysis Methodology Using TACO3, DPC-NE-2008-PA, Revision 0, SER dated April 3, 1995.
7. UFSAR Chapter 15 Transient Analysis Methodology, DPC-NE-3005-PA, Revision 2, SER dated September 24, 2003.
8. Thermal Hydraulic Transient Analysis Methodology, DPC-NE-3000-PA, Rev. 3, SER dated September 24, 2003.
9. BAW-10192-PA, BWNT LOCA - BWNT Loss of Coolant Accident Evaluation Model for Once-Through Steam Generator Plants, Rev. 0, SER dated February 18, 1997.
10. BAW-10164P-A, Rev. 4, RELAP5/MOD2-B&W - An Advanced Computer Program for Light Water Reactor LOCA and Non-LOCA Transient Analysis, SER dated April 9, 2002.
11. BAW-10227-PA, Evaluation of Advanced Cladding and Structural Material (M5) in PWR Reactor Fuel, Rev. 1, June 2003 (SER to BAW-10186P-A dated June 18, 2003).
12. RPS RCS Pressure & Temperature Trip Function Uncertainty Analyses and Variable Low Pressure Safety Limit, OSC-4048, Revision 4, January 2001.
13. Power Imbalance Safety Limits and Tech Spec Setpoints Using Error Adjusted Flux-Flow Ratio of 1.094, OSC-5604, Revision 2, October 2001.
14. ΔT_c and EOC Reduced Tavg Operation, OSC-7265, Rev. 1, Duke Power Co., June 2002.
15. O2C23 Maneuvering Analysis, OSC-8974, Revision 1, March 2007.
16. O2C23 Specific DNB Analysis, OSC-9001, Revision 0, October 2006.
17. O2C23 Reload Safety Evaluation, OSC-9057, Revision 0, March 2007.

Oconee 2 Cycle 23

Miscellaneous Setpoints

BWST boron concentration shall be greater than 2220 ppm and less than 3000 ppm.

Referred to by TS 3.5.4.

Spent fuel pool boron concentration shall be greater than 2220 ppm.

Referred to by TS 3.7.12.

The equivalent of at least 1100 cubic feet of 11,000 ppm boron shall be maintained in the CBAST.

Referred to by TS SLC 16.5.13.

CFT boron concentration shall be greater than 1874 ppm. The average boron concentration in the CFT's shall be less than 4000 ppm. Referred to by TS 3.5.1.

RCS and Refueling canal boron concentration shall be greater than 2220 ppm.

Referred to by TS 3.9.1.

Shutdown Margin (SDM) shall be greater than 1% $\Delta k/k$.

Referred to by TS 3.1.1.

Moderator Temperature Coefficient (MTC) shall be less than:

Linear interpolation is valid within the table provided.

Referred to by TS 3.1.3.

MTC x 10-4	$\Delta\rho$ / °F	% FP
	+0.70	0
	+0.525	20
	0.00	80
	0.00	100
	0.00	120

Departure from Nucleate Boiling (DNB) parameter for RCS loop pressure shall be

Referred to by TS 3.4.1.

4 RCP: measured hot leg pressure \geq 2125 psig

3 RCP: measured hot leg pressure \geq 2125 psig

DNB parameter for RCS loop average temperature shall be:

Referred to by TS 3.4.1.

The measured T_{avg} must be less than COLR limits minus instrument uncertainty. ΔT_c is the setpoint value selected by the operators. Values are expanded by linear interpolation on page 33 of this document **without** instrument uncertainty.

ΔT_c , °F	Max Loop T_{avg} (Incl 2°F unc)	
	4 RCP Op	3 RCP Op
0	581.0	581.0
1	581.4	581.2
2	581.8	581.4
3	582.1	581.7
4	582.5	581.9
5	582.9	582.1

* This limit is applied to the loop with the lowest loop average temperature consistent with the NOTE in SR 3.4.1.2. All other temperature limits apply to the maximum loop T_{avg} .

DNB parameter for RCS loop total flow shall be:

Referred to by TS 3.4.1.

4 RCP: Measured \geq 107.5 %df

3 RCP: Measured \geq 74.7 % of 4 RCP min flow

Regulating rod groups shall be withdrawn in sequence starting with group 5, group 6, and finally group 7.

Referred to by TS 3.2.1.

Regulating rod group overlap shall be 25% \pm 5% between two sequential groups.

Referred to by TS 3.2.1.

Misaligned, dropped, or inoperable rods may be excluded from control rod group average calculations when determining if overlap requirements are met as these situations are explicitly addressed by TS 3.1.4 (Control Rod Group Alignment Limits), TS 3.1.5 (Safety Rod Position Limits), and TS 3.2.3 (Quadrant Power Tilt).

Oconee 2 Cycle 23

Steady State Operating Band

EFPD	Rod Index		APSR %WD	
	Min	Max	Min	Max
0 to EOC	292 ± 5	300	30	40

Quadrant Power Tilt Setpoints

Core Power Level, %FP	Steady State		Transient		Maximum 0 - 100
	30 - 100	0 - 30	30 - 100	0 - 30	
Full Incore	3.50	7.61	7.11	9.40	16.55
Out of Core	2.35	6.09	5.63	7.72	14.22
Backup Incore	2.25	3.87	3.63	4.81	10.07

Referred to by TS 3.2.3


Correlation Slope (CS)

1.15

Referred to by TS 3.3.1 (SR 3.3.1.3).

Oconee 2 Cycle 23 Variable Low RCS Pressure RPS Setpoints

Referred to by TS 3.3.1

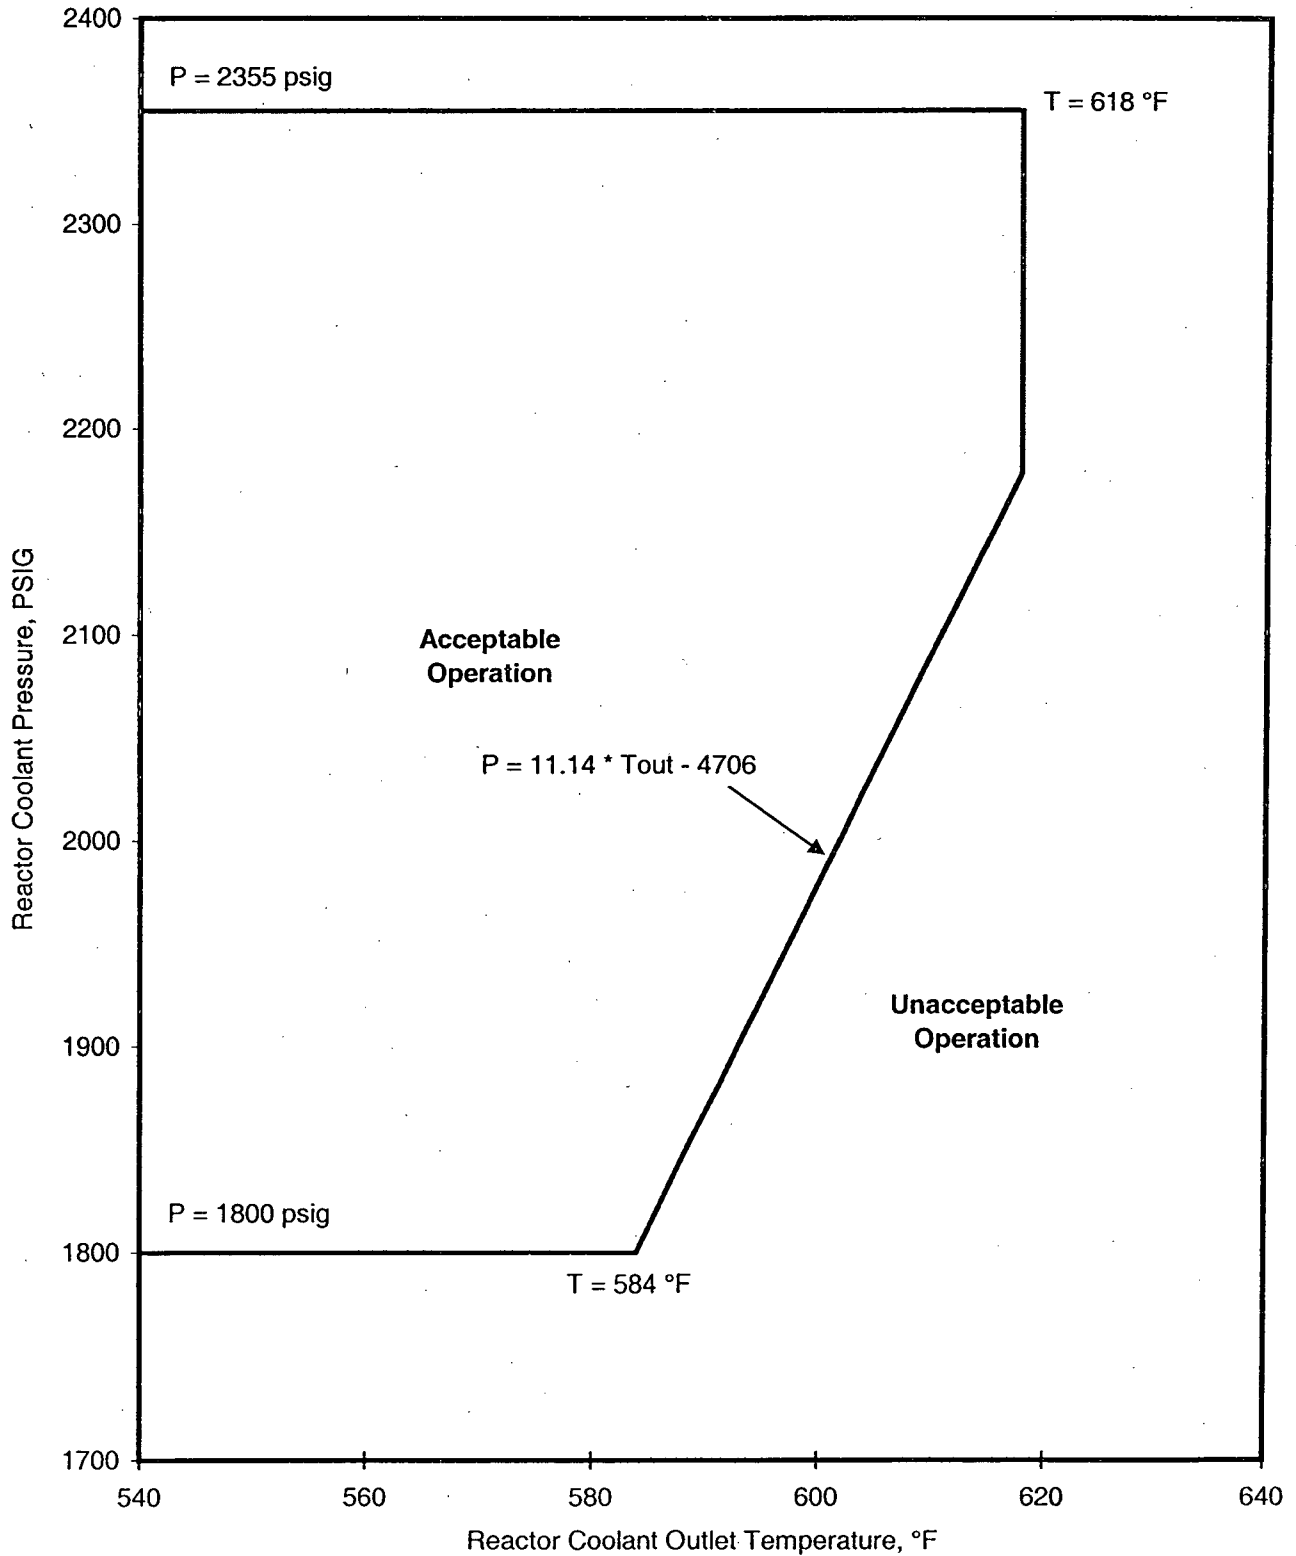

Oconee 2 Cycle 23

RPS Power Imbalance Setpoints

	% FP	% Imbalance
4 Pumps	0.0	-33.0
	88.4	-33.0
	107.9	-12.3
	107.9	14.4
	90.4	33.0
	0.0	33.0
	0.0	33.0
3 Pumps	0.0	-33.0
	61.1	-33.0
	80.6	-12.3
	80.6	14.4
	63.1	33.0
	0.0	33.0
	0.0	33.0

Maximum Allowable RPS Power Imbalance Limits

	% FP	% Imbalance
4 Pumps	0.0	-35.0
	88.0	-35.0
	109.4	-12.3
	109.4	14.4
	90.0	35.0
	0.0	35.0
	0.0	35.0
3 Pumps	0.0	-35.0
	60.3	-35.0
	81.7	-12.3
	81.7	14.4
	62.3	35.0
	0.0	35.0
	0.0	35.0

Oconee 2 Cycle 23

Operational Power Imbalance Setpoints

	%FP	Full Incore	Backup Incore	Out of Core
4 Pumps	0.0	-28.0	-28.0	-28.0
	80.0	-28.0	-28.0	-28.0
	90.0	-26.3	-26.3	-26.3
	100.0	-15.7	-15.7	-15.7
	102.0	-13.6	-13.6	-13.6
	102.0	15.7	15.7	15.7
	100.0	17.8	17.8	17.8
	90.0	28.0	27.6	28.0
	80.0	28.0	27.6	28.0
	0.0	28.0	27.6	28.0
3 Pumps	0.0	-28.0	-28.0	-28.0
	61.1	-28.0	-	-28.0
	61.1	-	-28.0	-
	77.0	-11.1	-11.1	-11.1
	77.0	13.2	13.2	13.2
	63.5	-	27.6	-
	63.1	28.0	-	28.0
	0.0	28.0	27.6	28.0

Oconee 2 Cycle 23
Operational Power Imbalance Setpoints
Operation with 4 RCS Pumps, BOC to EOC

% FP	RPS Trip		Full Incore Alarm		Out of Core Alarm	
107.9	-12.3	14.4				
107.0	-13.3	15.4				
106.0	-14.3	16.4				
105.0	-15.4	17.5				
104.0	-16.4	18.5				
103.0	-17.5	19.6				
102.0	-18.6	20.7	-13.6	15.7	-13.6	15.7
101.0	-19.6	21.7	-14.6	16.7	-14.6	16.7
100.0	-20.7	22.8	-15.7	17.8	-15.7	17.8
99.0	-21.8	23.9	-16.8	18.8	-16.8	18.8
98.0	-22.8	24.9	-17.8	19.8	-17.8	19.8
97.0	-23.9	26.0	-18.9	20.9	-18.9	20.9
96.0	-24.9	27.0	-19.9	21.9	-19.9	21.9
95.0	-26.0	28.1	-21.0	22.9	-21.0	22.9
94.0	-27.1	29.2	-22.1	23.9	-22.1	23.9
93.0	-28.1	30.2	-23.1	24.9	-23.1	24.9
92.0	-29.2	31.3	-24.2	26.0	-24.2	26.0
91.0	-30.2	32.3	-25.2	27.0	-25.2	27.0
90.4	-30.9	33.0	-25.9	27.6	-25.9	27.6
90.0	-31.3	33.0	-26.3	28.0	-26.3	28.0
89.0	-32.4	33.0	-26.5	28.0	-26.5	28.0
88.4	-33.0	33.0	-26.6	28.0	-26.6	28.0
88.0	-33.0	33.0	-26.6	28.0	-26.6	28.0
87.0	-33.0	33.0	-26.8	28.0	-26.8	28.0
86.0	-33.0	33.0	-27.0	28.0	-27.0	28.0
85.0	-33.0	33.0	-27.2	28.0	-27.2	28.0
84.0	-33.0	33.0	-27.3	28.0	-27.3	28.0
83.0	-33.0	33.0	-27.5	28.0	-27.5	28.0
82.0	-33.0	33.0	-27.7	28.0	-27.7	28.0
81.0	-33.0	33.0	-27.8	28.0	-27.8	28.0
80.0	-33.0	33.0	-28.0	28.0	-28.0	28.0
0.0	-33.0	33.0	-28.0	28.0	-28.0	28.0
% FP	RPS Trip		Full Incore Alarm		Out of Core Alarm	

Oconee 2 Cycle 23

Operational Power Imbalance Setpoints


Operation with 3 RCS Pumps, BOC to EOC

% FP	RPS Trip		Full Incore Alarm		Out of Core Alarm	
80.6	-12.3	14.4				
80.0	-12.9	15.0				
79.0	-14.0	16.1				
78.0	-15.0	17.1				
77.0	-16.1	18.2	-11.1	13.2	-11.1	13.2
76.0	-17.2	19.3	-12.2	14.3	-12.2	14.3
75.0	-18.2	20.3	-13.2	15.3	-13.2	15.3
74.0	-19.3	21.4	-14.3	16.4	-14.3	16.4
73.0	-20.3	22.4	-15.3	17.4	-15.3	17.4
72.0	-21.4	23.5	-16.4	18.5	-16.4	18.5
71.0	-22.5	24.6	-17.5	19.6	-17.5	19.6
70.0	-23.5	25.6	-18.5	20.6	-18.5	20.6
69.0	-24.6	26.7	-19.6	21.7	-19.6	21.7
68.0	-25.7	27.8	-20.7	22.8	-20.7	22.8
67.0	-26.7	28.8	-21.7	23.8	-21.7	23.8
66.0	-27.8	29.9	-22.8	24.9	-22.8	24.9
65.0	-28.8	30.9	-23.8	25.9	-23.8	25.9
64.0	-29.9	32.0	-24.9	27.0	-24.9	27.0
63.1	-30.9	33.0	-25.9	28.0	-25.9	28.0
63.0	-31.0	33.0	-26.0	28.0	-26.0	28.0
62.0	-32.0	33.0	-27.0	28.0	-27.0	28.0
61.1	-33.0	33.0	-28.0	28.0	-28.0	28.0
61.0	-33.0	33.0	-28.0	28.0	-28.0	28.0
60.0	-33.0	33.0	-28.0	28.0	-28.0	28.0
0.0	-33.0	33.0	-28.0	28.0	-28.0	28.0
% FP	RPS Trip		Full Incore Alarm		Out of Core Alarm	

Oconee 2 Cycle 23 RPS Power Imbalance Setpoints


Referred to by TS 3.3.1

Thermal Power Level, %FP

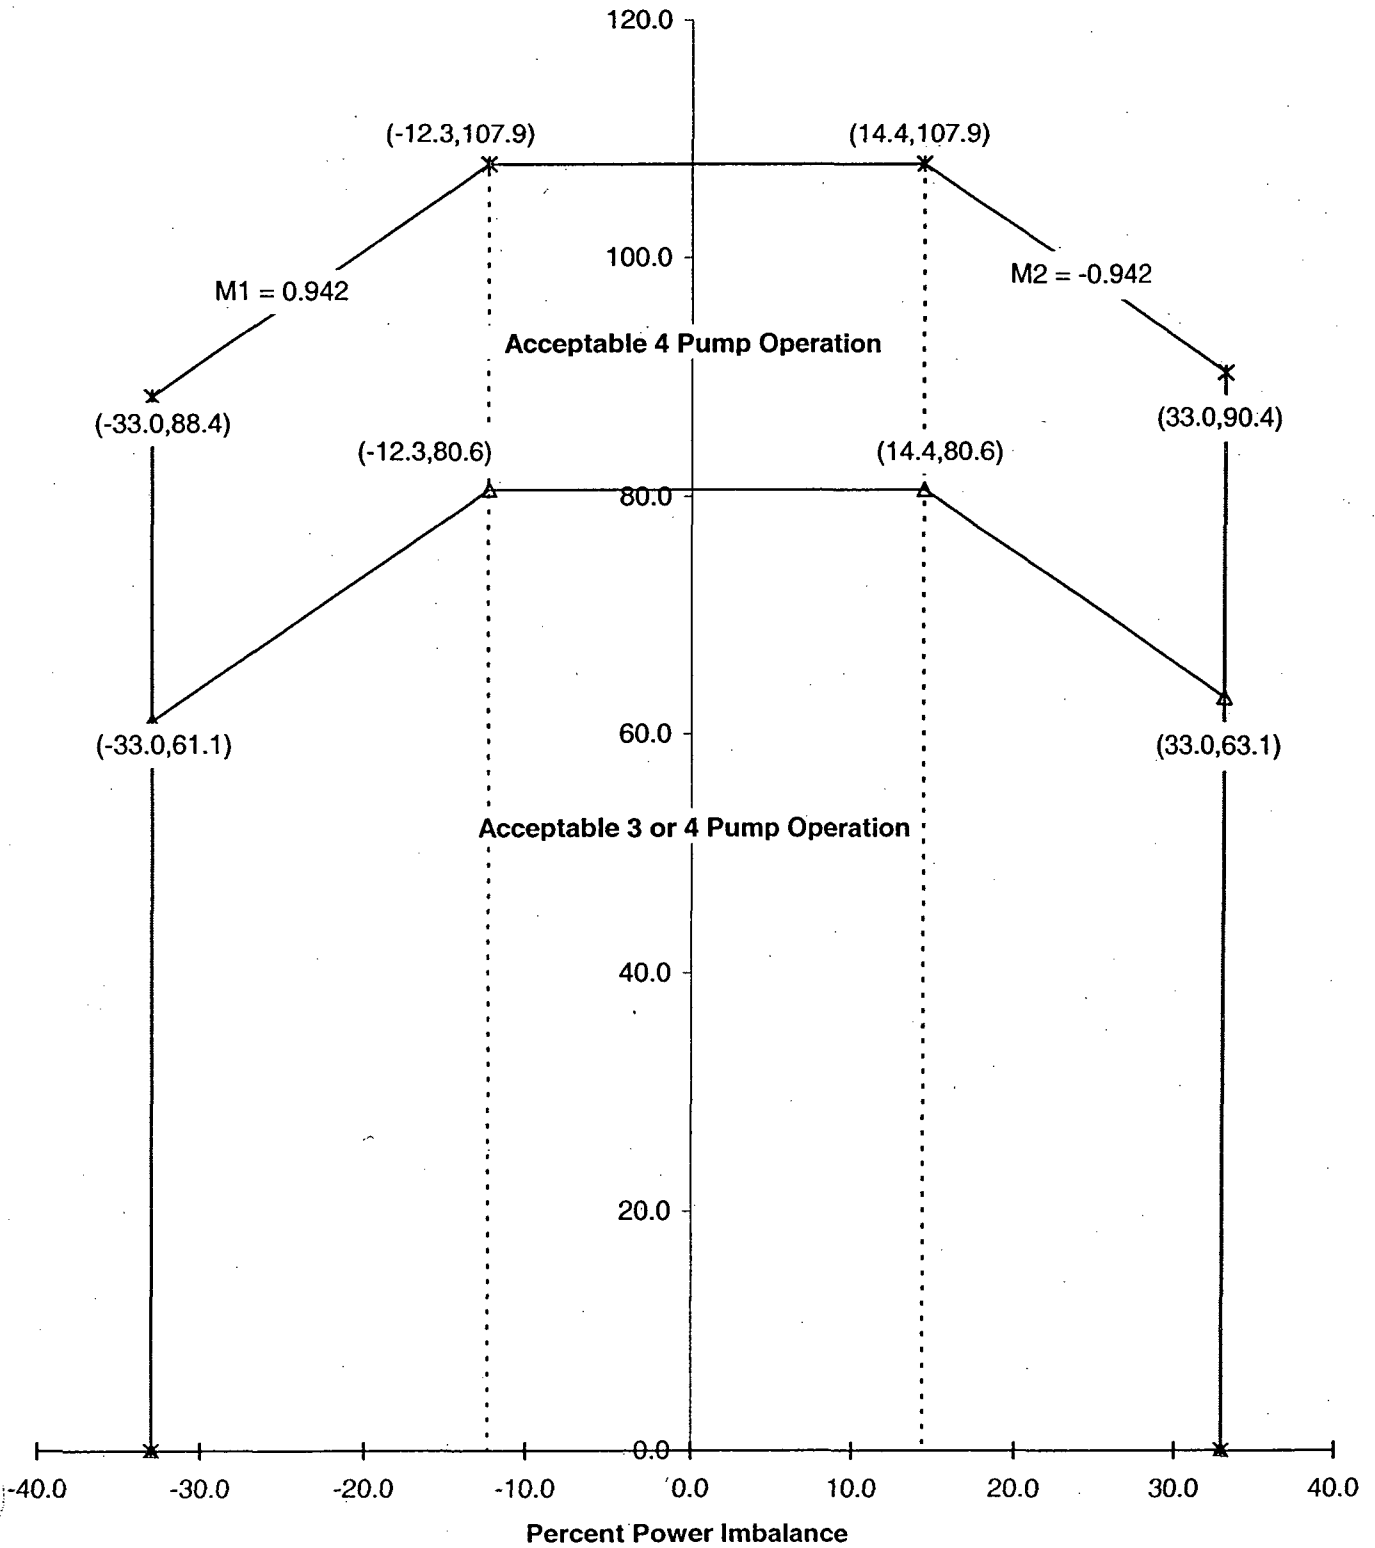


Oconee 2 Cycle 23

Imbalance Setpoints for 4 Pump Operation, BOC to EOC

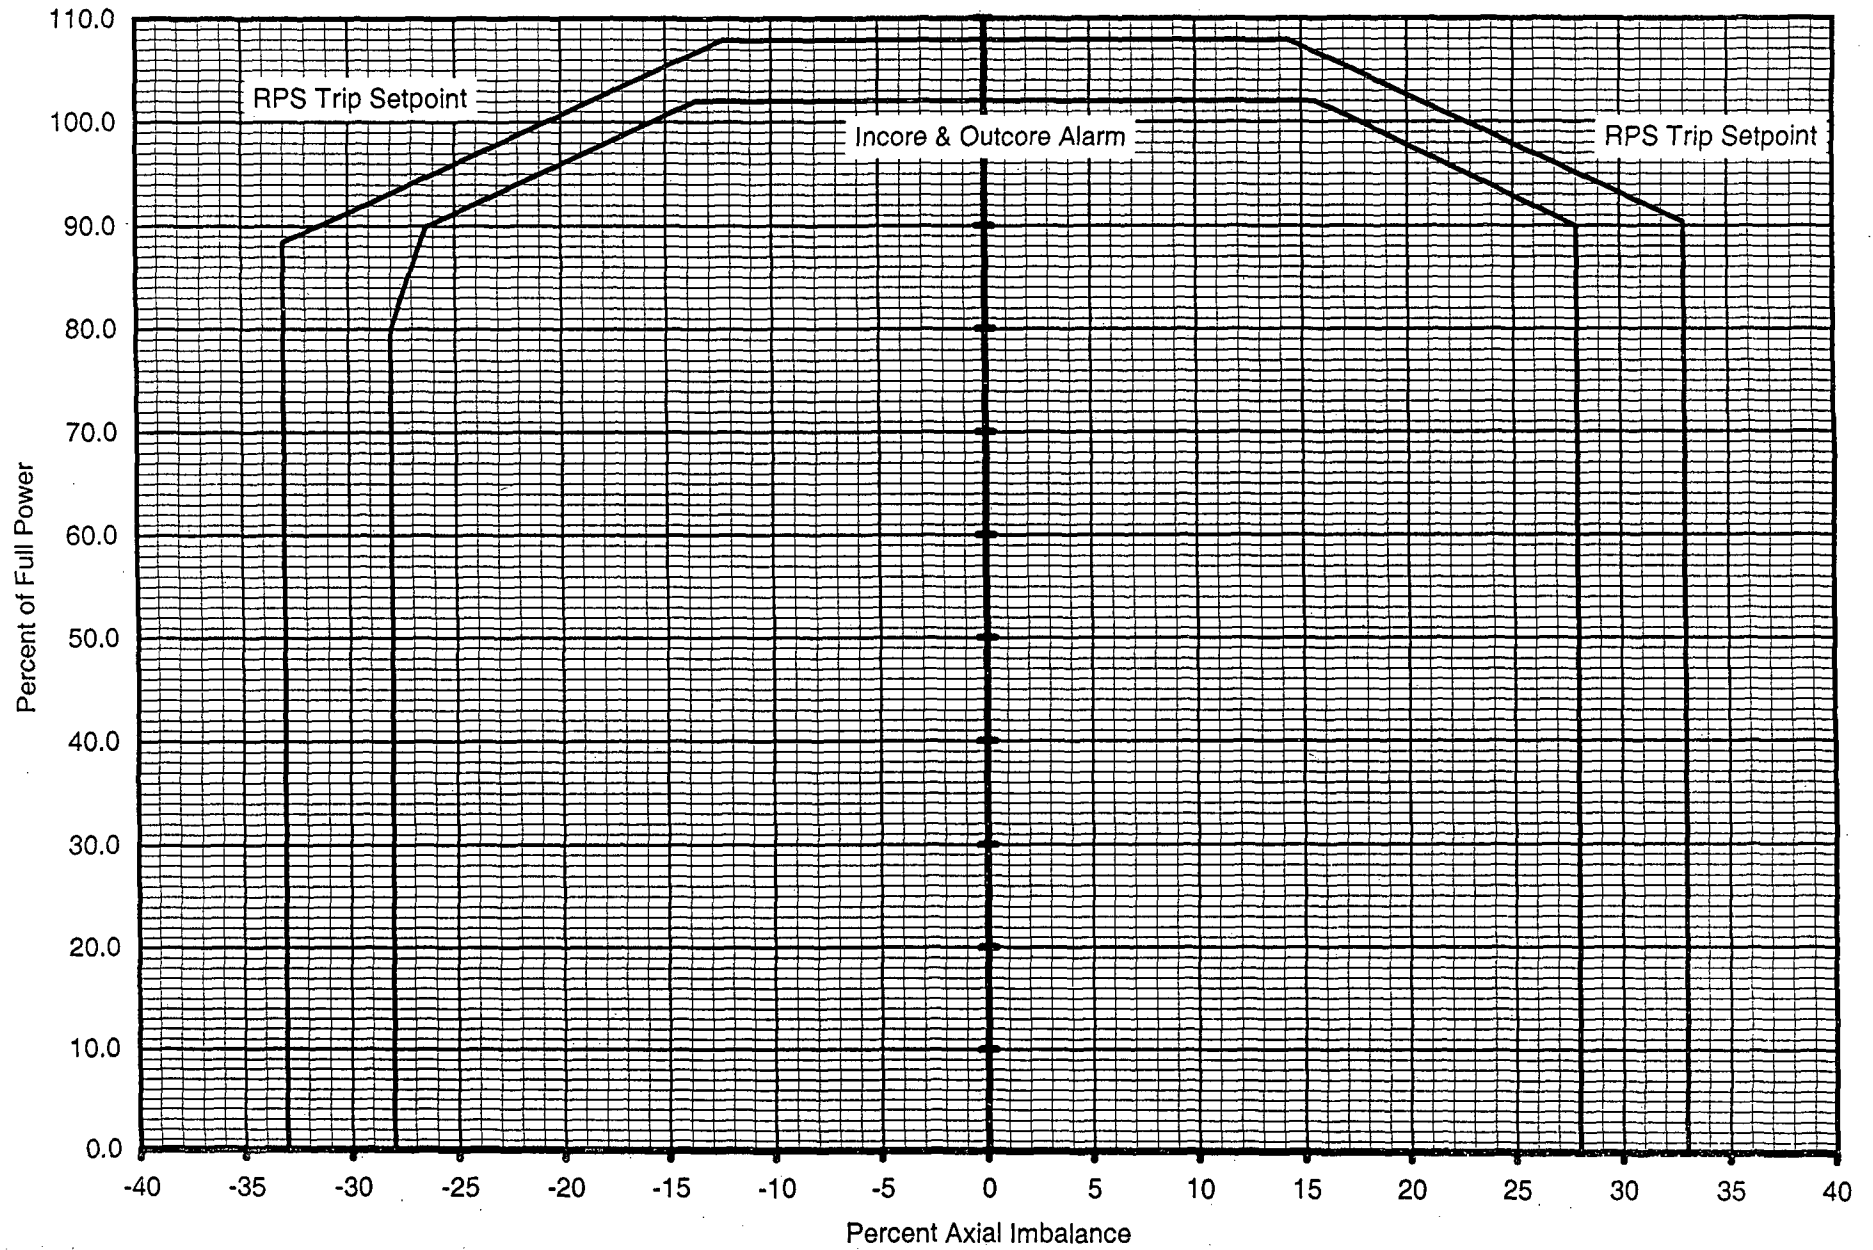

Oconee 2 Cycle 23

Imbalance Setpoints for 3 Pump Operation, BOC to EOC

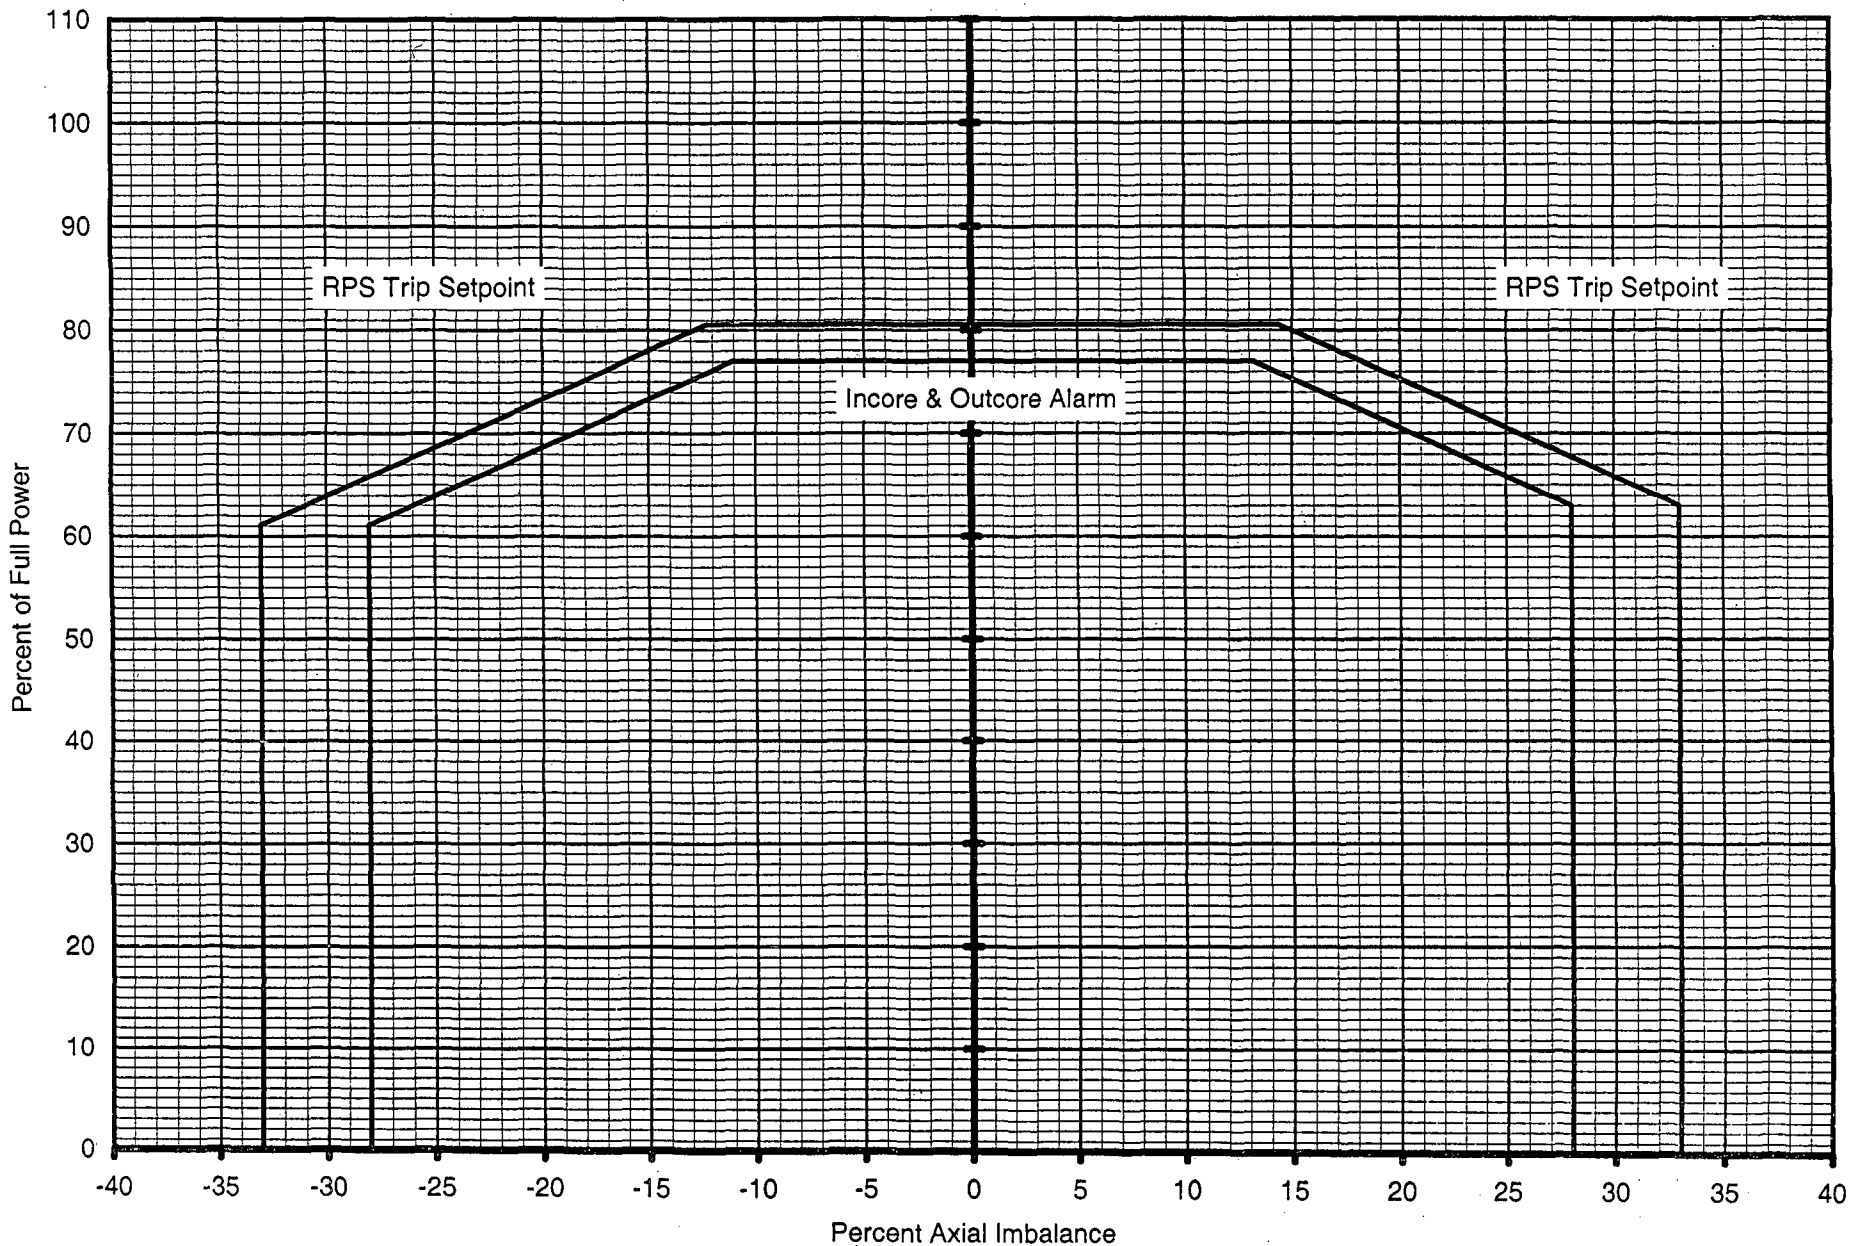

Oconee 2 Cycle 23

Operational Rod Index Setpoints

	%FP	RI Insertion Setpoint		RI Withdrawal Setpoint
		No Inop Rod	1 Inop Rod	
4 Pumps	102.0	263.5	283.4	300
	100.0	261.5	281.5	300
	90.0	251.5	271.9	300
	80.0	251.5	262.3	300
	50.0	201.5	233.4	300
	48.0	195.2	231.5	300
	15.0	91.5	165.5	300
	13.0	76.5	161.5	300
	5.0	16.5	93.5	300
	3.0	1.5	76.5	300
	2.8	0.0	74.8	300
	0.0	0.0	51.0	300
3 Pumps	77.0	246.5	285.2	300
	75.0	243.2	281.5	300
	50.0	201.5	235.2	300
	48.0	195.2	231.5	300
	15.0	91.5	165.5	300
	13.0	76.5	161.5	300
	5.0	16.5	93.5	300
	3.0	1.5	76.5	300
	2.8	0.0	74.8	300
	0.0	0.0	51.0	300

Oconee 2 Cycle 23


Shutdown Margin Rod Index Setpoints


	%FP	RI Insertion Setpoint		RI Withdrawal Setpoint
		No Inop Rod	1 Inop Rod	
4 Pumps	102.0	224.6	283.4	300
	100.0	221.5	281.5	300
	48.0	141.5	231.5	300
	13.0	76.5	161.5	300
	3.0	1.5	76.5	300
	2.8	0.0	74.8	300
	0.0	0.0	51.0	300
3 Pumps	77.0	227.4	285.2	300
	75.0	221.5	281.5	300
	48.0	141.5	231.5	300
	13.0	76.5	161.5	300
	3.0	1.5	76.5	300
	2.8	0.0	74.8	300
	0.0	0.0	51.0	300


% FP	Shutdown Margin Setpoint			Operational Alarm Setpoint		
	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
49	100	43.0	0	100	86.7	11.7
48	100	41.5	0	100	85.1	10.1
47	100	39.6	0	100	83.5	8.5
46	100	37.8	0	100	82.0	7.0
45	100	35.9	0	100	80.4	5.4
44	100	34.1	0	100	78.8	3.8
43	100	32.2	0	100	77.2	2.2
42	100	30.4	0	100	75.7	0.7
41.6	100	29.6	0	100	75.0	0
41	100	28.5	0	100	73.2	0
40	100	26.6	0	100	70.1	0
39.1	100	25.0	0	100	67.3	0
39	99.9	24.9	0	100	66.9	0
38	99.0	24.0	0	100	63.8	0
37	98.0	23.0	0	100	60.6	0
36	97.1	22.1	0	100	57.5	0
35	96.2	21.2	0	100	54.3	0
34	95.2	20.2	0	100	51.2	0
33	94.3	19.3	0	100	48.1	0
32	93.4	18.4	0	100	44.9	0
31	92.5	17.5	0	100	41.8	0
30	91.5	16.5	0	100	38.6	0
29	90.6	15.6	0	100	35.5	0
28	89.7	14.7	0	100	32.4	0
27	88.8	13.8	0	100	29.2	0
26	87.8	12.8	0	100	26.1	0
25.7	87.5	12.5	0	100	25.0	0
25	86.9	11.9	0	99.0	24.0	0
24	86.0	11.0	0	97.4	22.4	0
23	85.0	10.0	0	95.8	20.8	0
22	84.1	9.1	0	94.2	19.2	0
21	83.2	8.2	0	92.7	17.7	0
20	82.2	7.2	0	91.1	16.1	0
19	81.3	6.3	0	89.5	14.5	0
18	80.4	5.4	0	88.0	13.0	0
17	79.5	4.5	0	86.4	11.4	0
16	78.5	3.5	0	84.8	9.8	0
15	77.6	2.6	0	83.2	8.2	0
14	76.7	1.7	0	79.5	4.5	0
13	75.8	0.8	0	75.8	0.8	0
12.8	75.0	0	0	75.0	0	0
12	69.0	0	0	69.0	0	0
11	61.5	0	0	61.5	0	0
10	54.0	0	0	54.0	0	0
9	46.5	0	0	46.5	0	0
8	39.0	0	0	39.0	0	0
7	31.5	0	0	31.5	0	0
6	24.0	0	0	24.0	0	0
5	16.5	0	0	16.5	0	0
4	9.0	0	0	9.0	0	0
3	1.5	0	0	1.5	0	0
2.8	0	0	0	0	0	0
2	0	0	0	0	0	0
1	0	0	0	0	0	0
0	0	0	0	0	0	0
% FP	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
	Shutdown Margin Setpoint			Operational Alarm Setpoint		


% FP	Shutdown Margin Setpoint			Operational Alarm Setpoint		
	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
102	100	100	83.4	100	100	83.4
101	100	100	82.5	100	100	82.5
100	100	100	81.5	100	100	81.5
99	100	100	80.5	100	100	80.5
98	100	100	79.6	100	100	79.6
97	100	100	78.6	100	100	78.6
96	100	100	77.7	100	100	77.7
95	100	100	76.7	100	100	76.7
94	100	100	75.7	100	100	75.7
93	100	100	74.8	100	100	74.8
92	100	100	73.8	100	100	73.8
91	100	100	72.8	100	100	72.9
90	100	100	71.9	100	100	71.9
89	100	100	70.9	100	100	70.9
88	100	100	70.0	100	100	70.0
87	100	100	69.0	100	100	69.0
86	100	100	68.0	100	100	68.1
85	100	100	67.1	100	100	67.1
84	100	100	66.1	100	100	66.1
83	100	100	65.2	100	100	65.2
82	100	100	64.2	100	100	64.2
81	100	100	63.2	100	100	63.3
80	100	100	62.3	100	100	62.3
79	100	100	61.3	100	100	61.3
78	100	100	60.3	100	100	60.4
77	100	100	59.4	100	100	59.4
76	100	100	58.4	100	100	58.4
75	100	100	57.5	100	100	57.5
74	100	100	56.5	100	100	56.5
73	100	100	55.5	100	100	55.6
72	100	100	54.6	100	100	54.6
71	100	100	53.6	100	100	53.6
70	100	100	52.7	100	100	52.7
69	100	100	51.7	100	100	51.7
68	100	100	50.7	100	100	50.7
67	100	100	49.8	100	100	49.8
66	100	100	48.8	100	100	48.8
65	100	100	47.8	100	100	47.8
64	100	100	46.9	100	100	46.9
63	100	100	45.9	100	100	45.9
62	100	100	45.0	100	100	45.0
61	100	100	44.0	100	100	44.0
60	100	100	43.0	100	100	43.0
59	100	100	42.1	100	100	42.1
58	100	100	41.1	100	100	41.1
57	100	100	40.2	100	100	40.2
56	100	100	39.2	100	100	39.2
55	100	100	38.2	100	100	38.2
54	100	100	37.3	100	100	37.3
53	100	100	36.3	100	100	36.3
52	100	100	35.3	100	100	35.3
51	100	100	34.4	100	100	34.4
50	100	100	33.4	100	100	33.4
49	100	100	32.5	100	100	32.5
48	100	100	31.5	100	100	31.5
% FP	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
	Shutdown Margin Setpoint			Operational Alarm Setpoint		

% FP	Shutdown Margin Setpoint			Operational Alarm Setpoint		
	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
77	100	100	85.2	100	100	85.2
76	100	100	83.4	100	100	83.4
75	100	100	81.5	100	100	81.5
74	100	100	79.6	100	100	79.6
73	100	100	77.8	100	100	77.8
72	100	100	75.9	100	100	75.9
71	100	100	74.1	100	100	74.1
70	100	100	72.2	100	100	72.2
69	100	100	70.4	100	100	70.4
68	100	100	68.5	100	100	68.5
67	100	100	66.7	100	100	66.7
66	100	100	64.8	100	100	64.8
65	100	100	63.0	100	100	63.0
64	100	100	61.1	100	100	61.1
63	100	100	59.3	100	100	59.3
62	100	100	57.4	100	100	57.4
61	100	100	55.6	100	100	55.6
60	100	100	53.7	100	100	53.7
59	100	100	51.9	100	100	51.9
58	100	100	50.0	100	100	50.0
57	100	100	48.2	100	100	48.2
56	100	100	46.3	100	100	46.3
55	100	100	44.5	100	100	44.5
54	100	100	42.6	100	100	42.6
53	100	100	40.8	100	100	40.8
52	100	100	38.9	100	100	38.9
51	100	100	37.1	100	100	37.1
50	100	100	35.2	100	100	35.2
49	100	100	33.4	100	100	33.4
48	100	100	31.5	100	100	31.5
47	100	100	29.5	100	100	29.5
46	100	100	27.5	100	100	27.5
45	100	100	25.5	100	100	25.5
44.8	100	100	25.0	100	100	25.0
44	100	99.2	24.2	100	99.2	24.2
43	100	98.2	23.2	100	98.2	23.2
42	100	97.2	22.2	100	97.2	22.2
41	100	96.2	21.2	100	96.2	21.2
40	100	95.2	20.2	100	95.2	20.2
39	100	94.2	19.2	100	94.2	19.2
38	100	93.2	18.2	100	93.2	18.2
37	100	92.2	17.2	100	92.2	17.2
36	100	91.2	16.2	100	91.2	16.2
35	100	90.2	15.2	100	90.2	15.2
34	100	89.2	14.2	100	89.2	14.2
33	100	88.2	13.2	100	88.2	13.2
32	100	87.2	12.2	100	87.2	12.2
31	100	86.2	11.2	100	86.2	11.2
30	100	85.2	10.2	100	85.2	10.2
29	100	84.2	9.2	100	84.2	9.2
28	100	83.2	8.2	100	83.2	8.2
27	100	82.2	7.2	100	82.2	7.2
26	100	81.2	6.2	100	81.2	6.2
25	100	80.2	5.2	100	80.2	5.2
24	100	79.2	4.2	100	79.2	4.2
% FP	CRGP 5	CRGP 6	CRGP 7	CRGP 5	CRGP 6	CRGP 7
	Shutdown Margin Setpoint			Operational Alarm Setpoint		

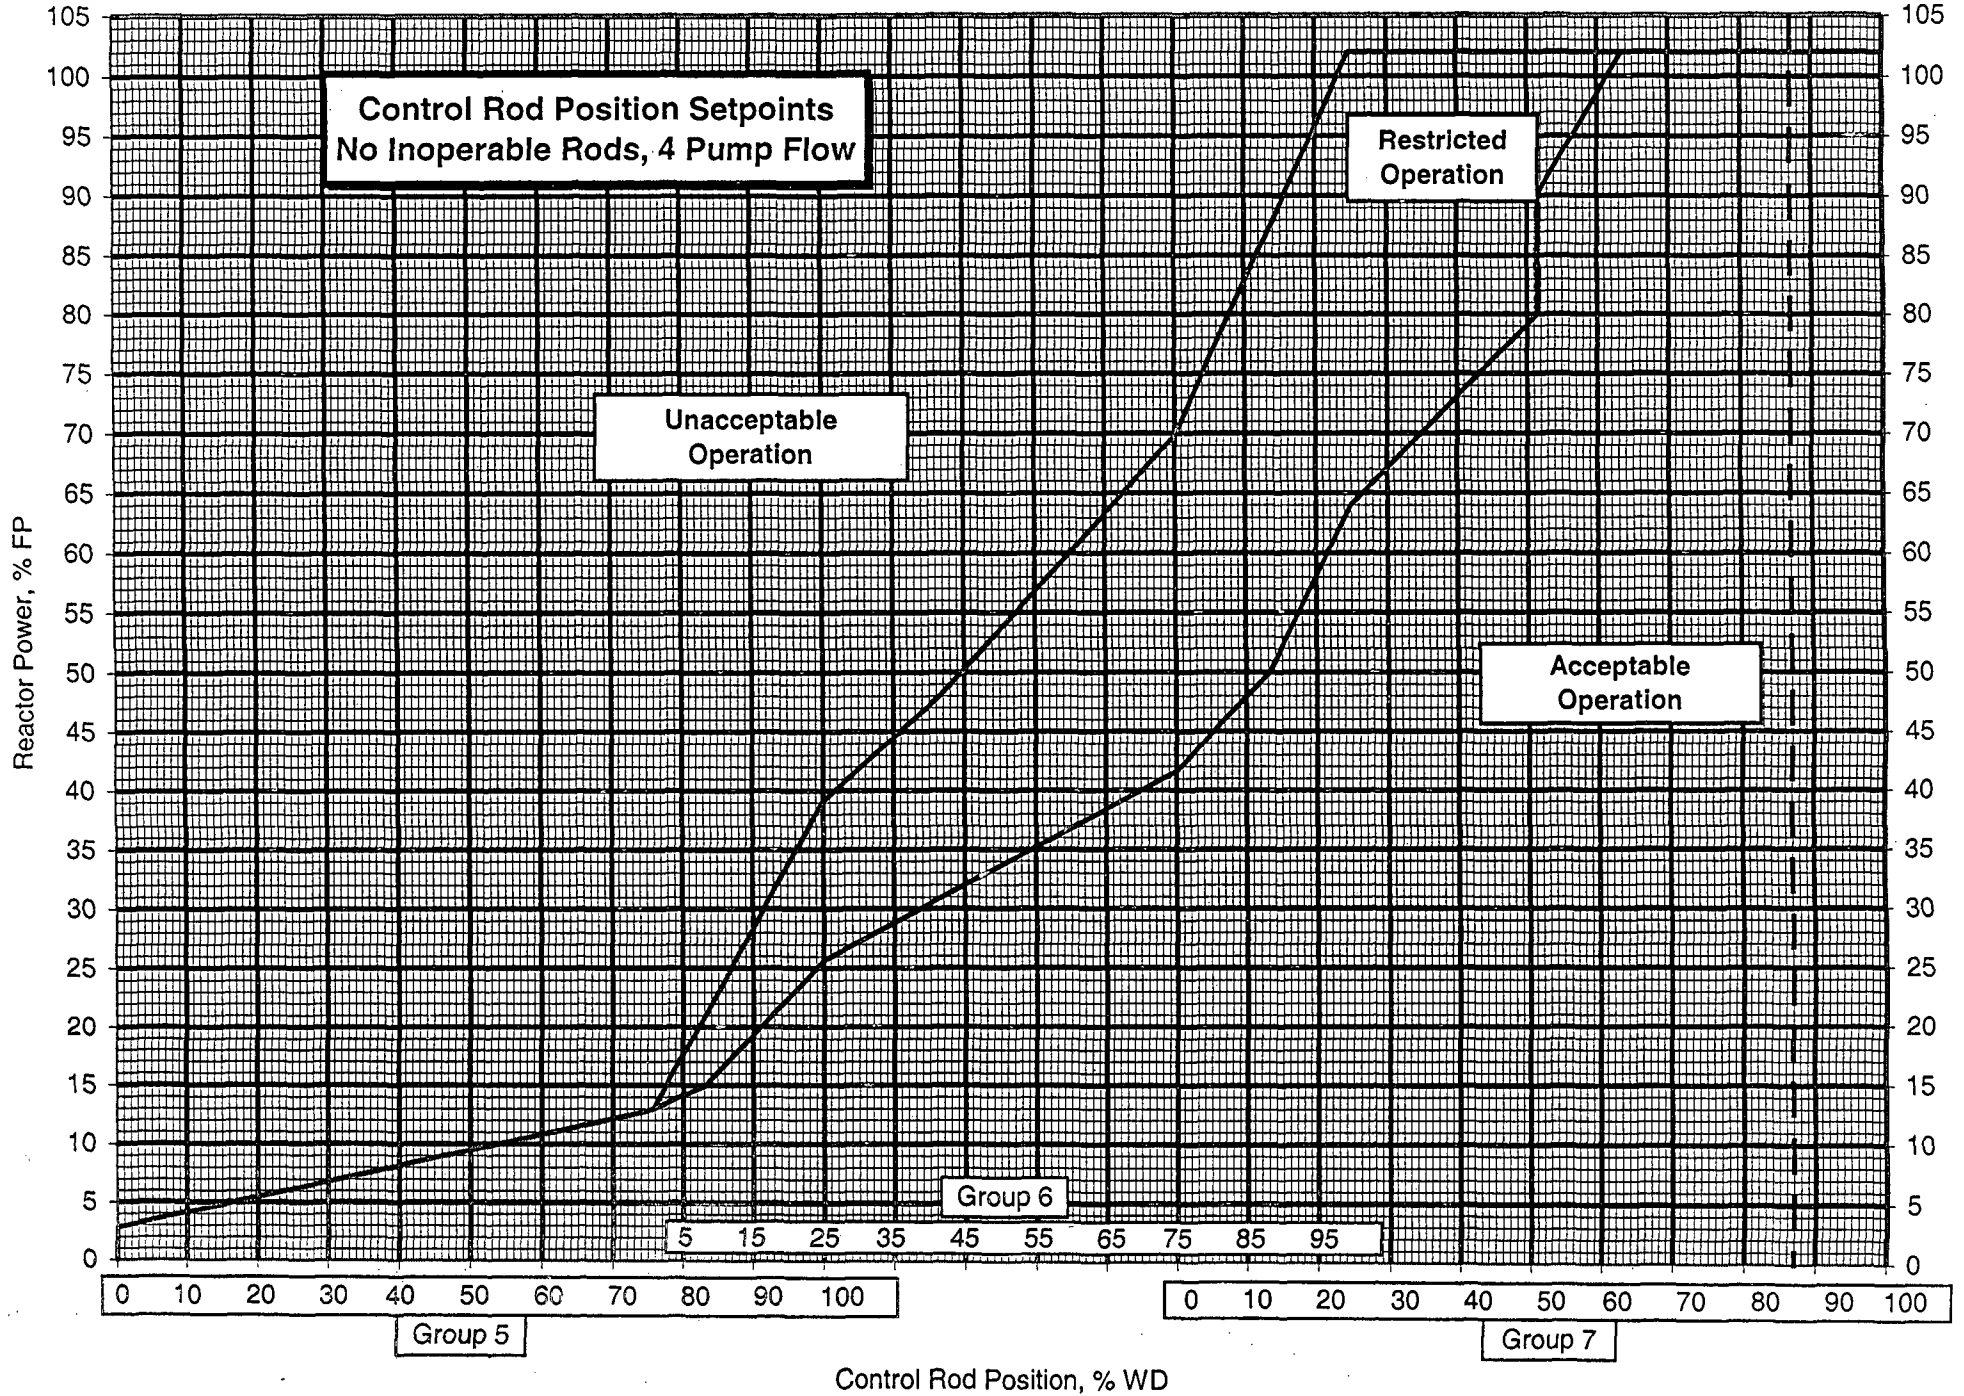

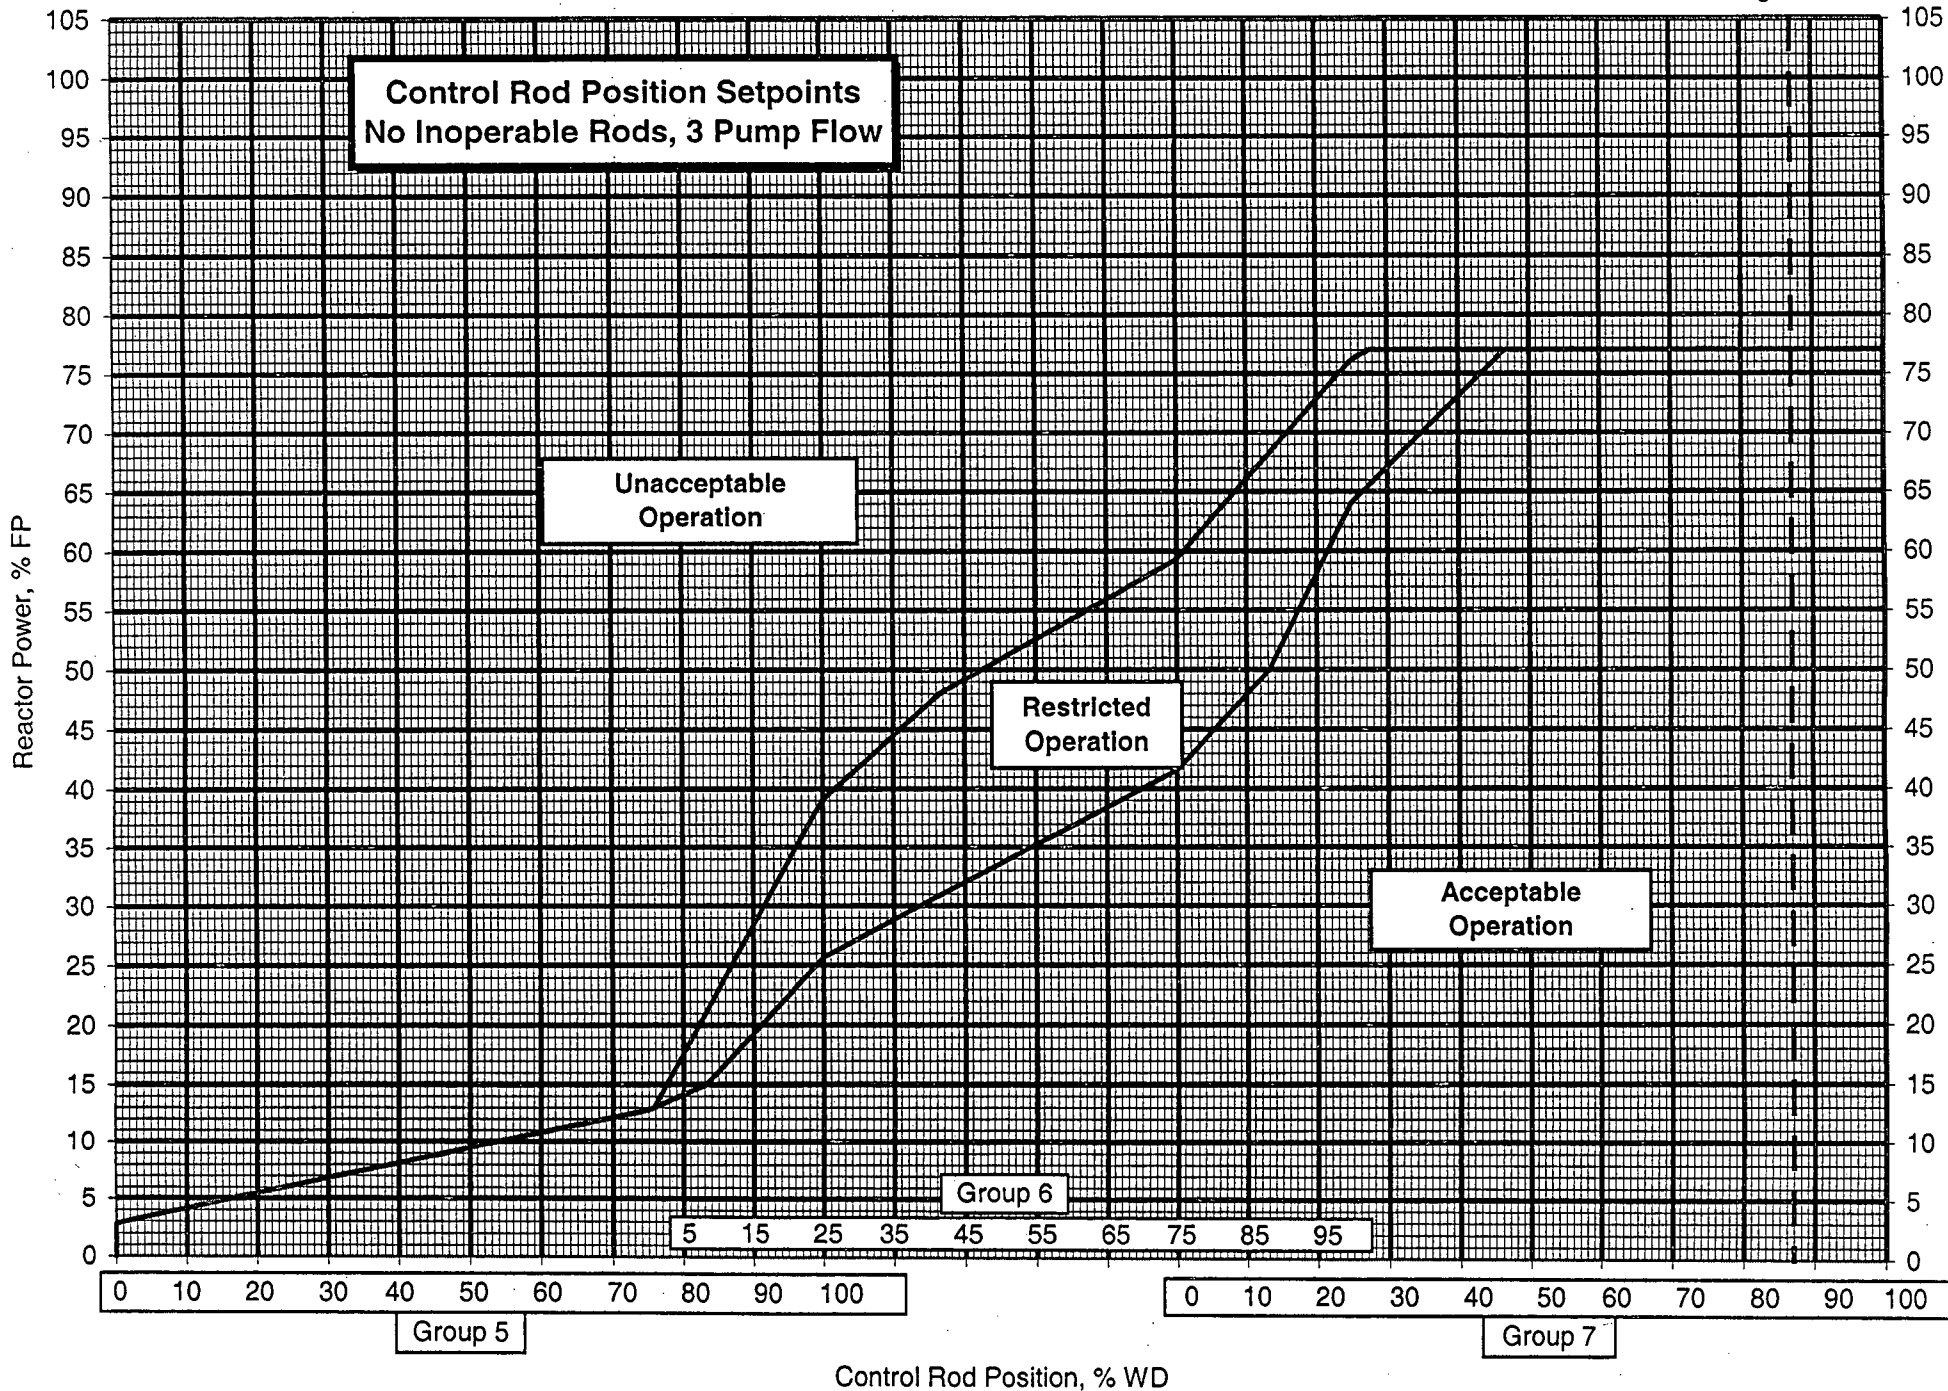

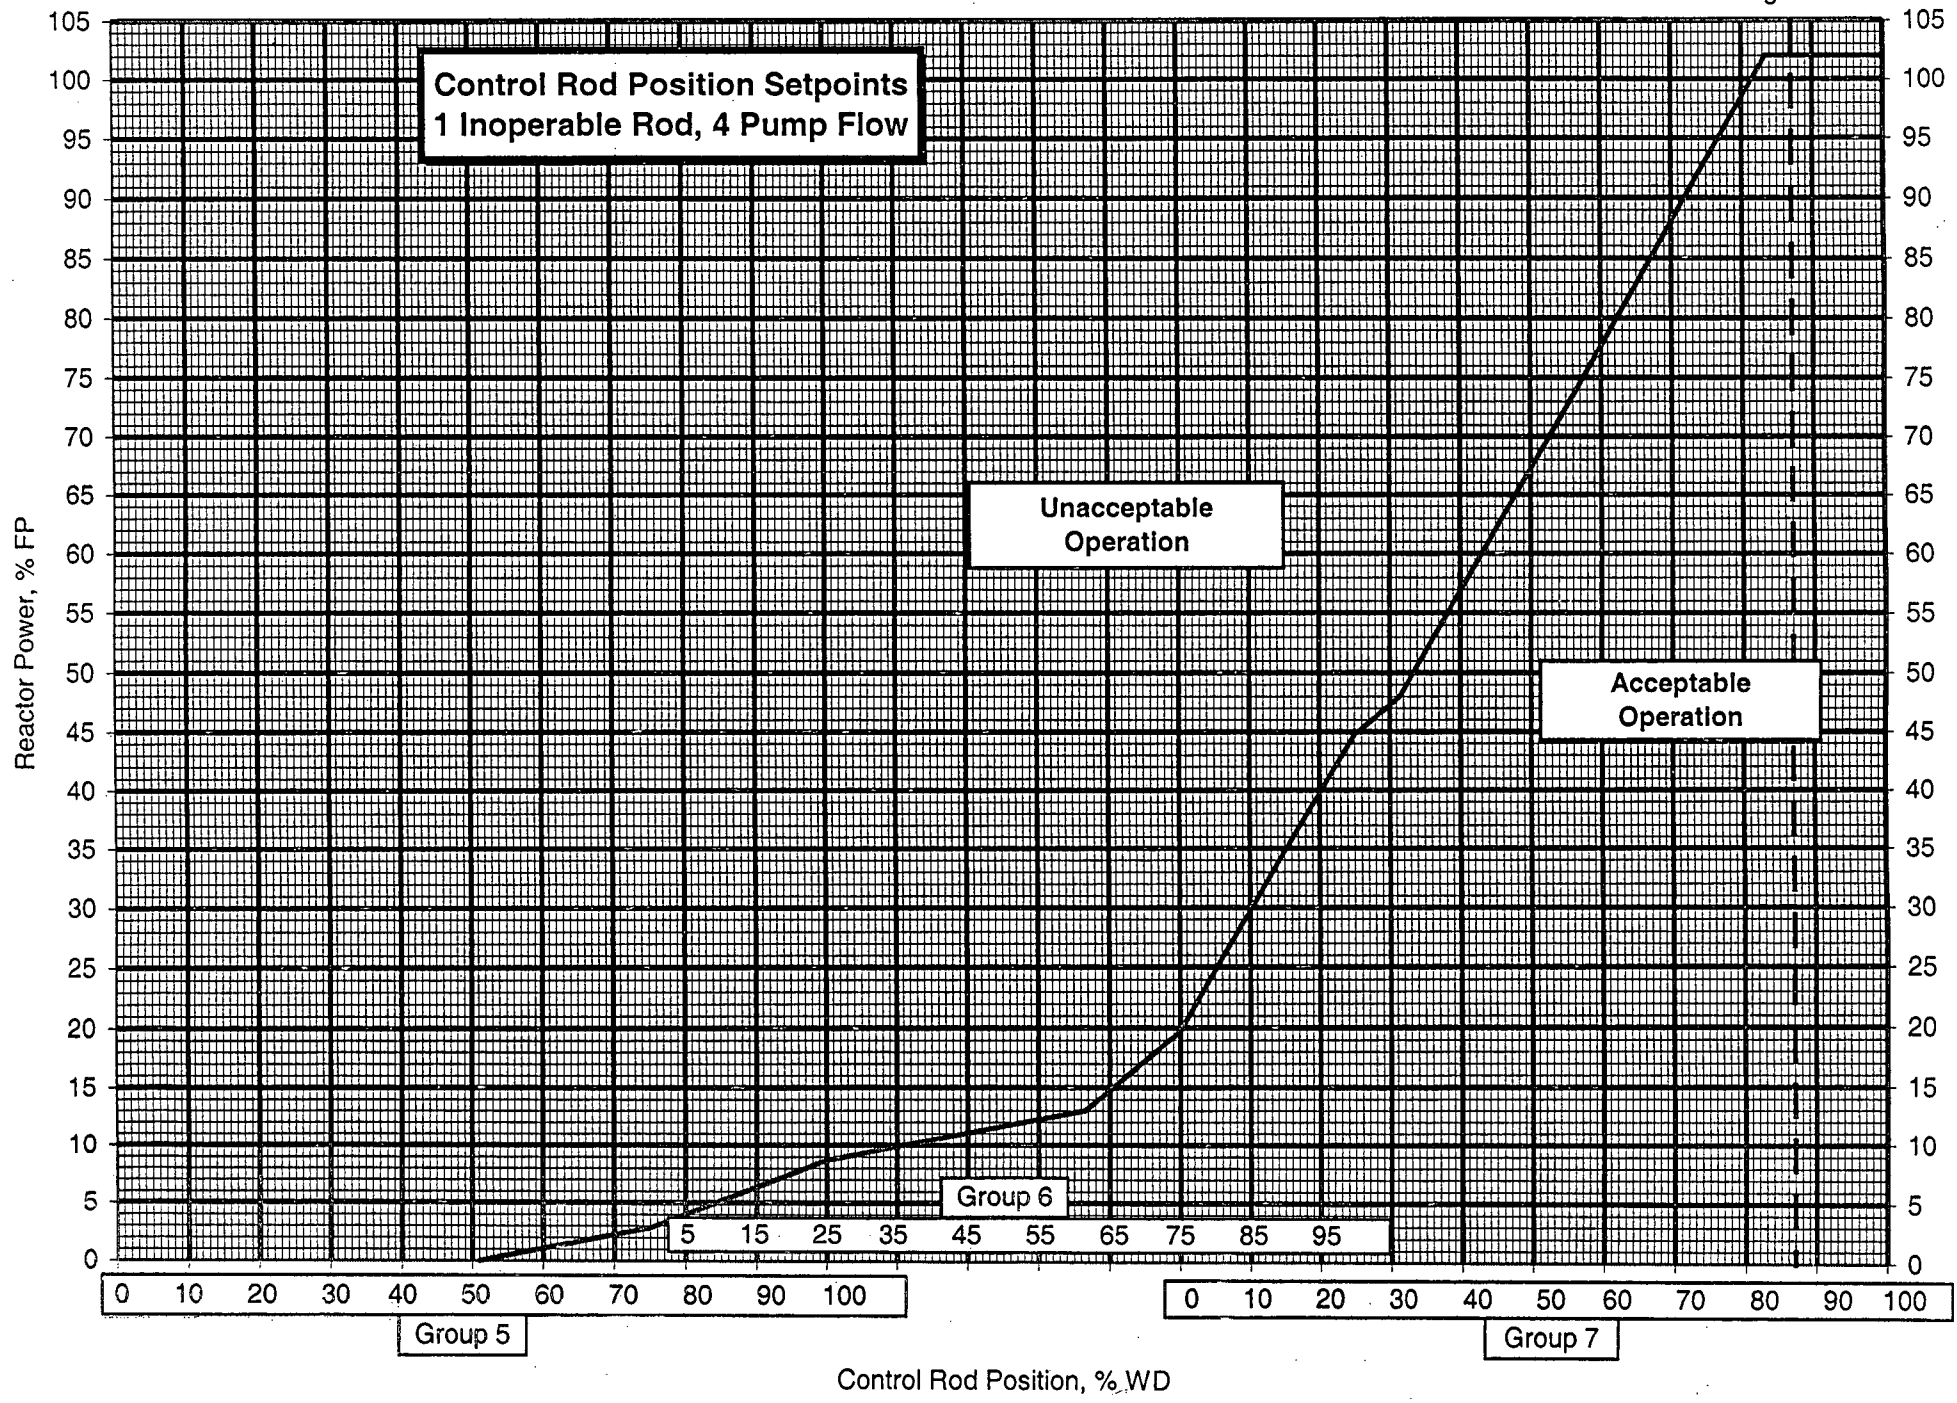

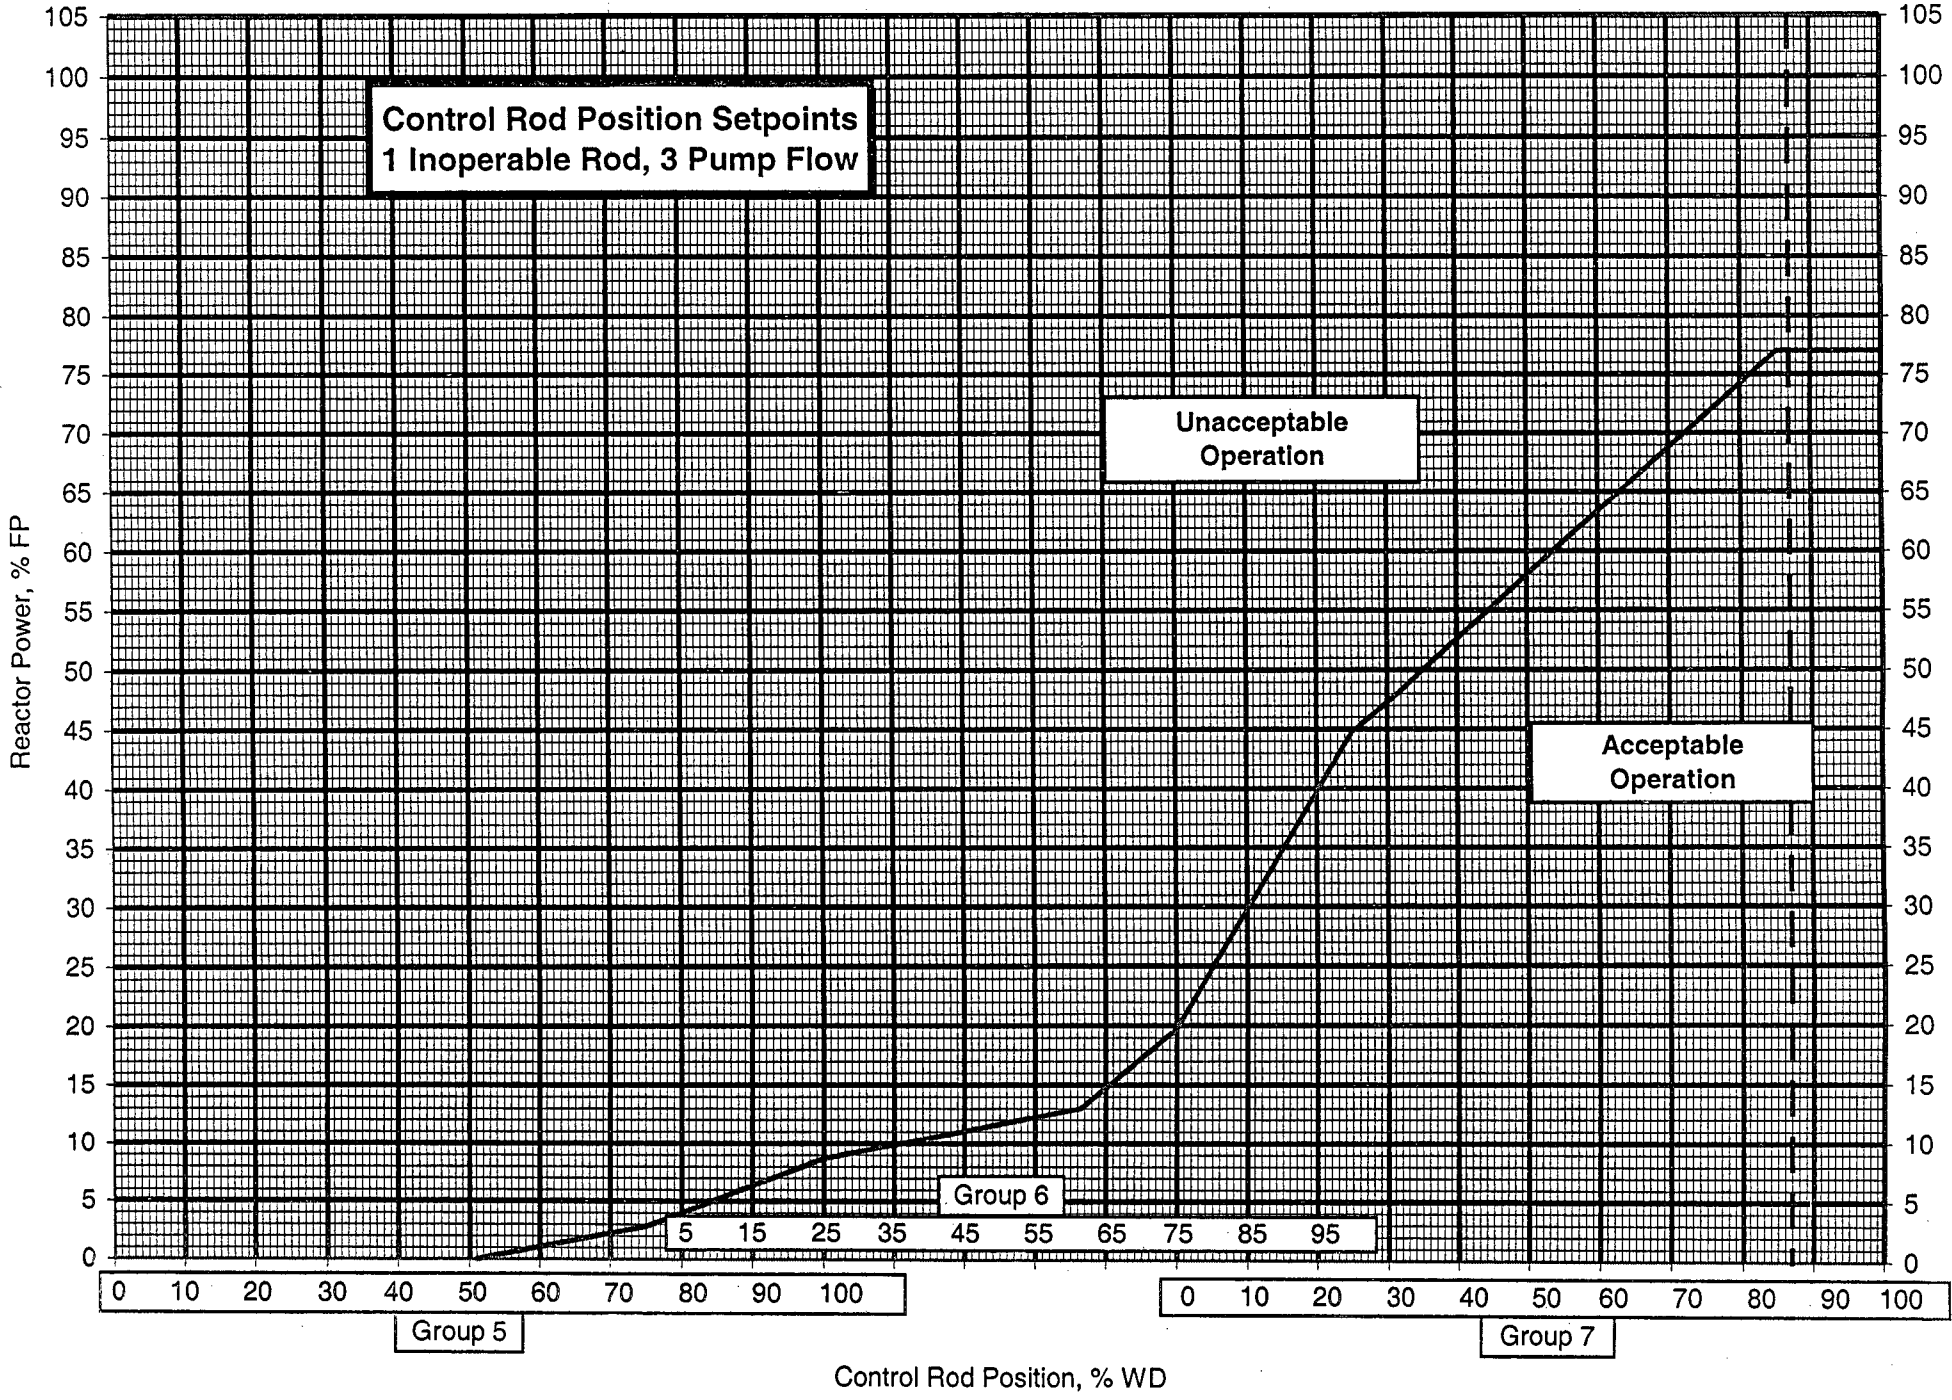

Oconee 2 Cycle 23

2.0 Core Operating Limits -- Not Error Adjusted

The data provided on the following pages satisfies a licensing commitment to identify specific parameters before instrumentation uncertainties are incorporated.

References provided in section 1 of this COLR identify the sources for the data which follows.

Information provided in this section should not be used in plant procedures.

Quadrant Power Tilt Limits

Referred to by TS 3.2.3

	Steady State		Transient		Maximum
Core Power Level, %FP	30 - 100	0 - 30	30 - 100	0 - 30	0 - 100
Quadrant Power Tilt, %	5.40	10.00	9.44	12.00	20.00

Variable Low RCS Pressure Protective Limits

Referred to by TS 2.1.1

Core Outlet Pressure psia	Reactor Coolant Outlet Temperature, °F	
	3 RCS Pumps	4 RCS Pumps
1800	581.0	578.3
1900	590.0	587.3
2000	598.9	596.3
2100	607.9	605.2
2200	616.9	614.2
2300	625.9	623.2

Oconee 2 Cycle 23

Axial Power Imbalance Protective Limits

Referred to by TS 2.1.1

Not for Plant Use

	%FP	RPS	Operational
4 Pumps	0.0	-35.0	-39.5
	80.0	-	-39.5
	88.0	-35.0	-
	90.0	-	-38.1
	100.0	-	-25.8
	109.4	-12.3	-
	109.4	14.4	-
	100.0	-	28.4
	90.0	35.0	39.5
	80.0	-	39.5
	0.0	35.0	39.5
3 Pumps	0.0	-35.0	-39.5
	60.3	-35.0	-
	77.0	-	-39.5
	81.7	-12.3	-
	81.7	14.4	-
	77.0	-	39.5
	62.3	35.0	-
	0.0	35.0	39.5

Oconee 2 Cycle 23

Rod Index Limits

Referred to by TS 3.2.1

Not for Plant Use

	%FP	Operational RI Insertion Limit	Shutdown Margin RI No Inop Rod	Insertion Limit 1 Inop Rod	RI Withdrawal Limit
4 Pumps	102	262	220	280	300
	100	260	-	-	300
	90	250	-	-	300
	80	250	-	-	300
	50	200	140	230	300
	15	90	75	160	300
	5	0	0	75	300
3 Pumps	77	245	220	280	300
	50	200	140	230	300
	15	90	75	160	300
	5	0	0	75	300

Oconee 2 Cycle 23

LOCA Limits

Not for Plant Use

Mk-B11 Fuel	Core Elevation	LOCA LHR kw/ft Limit Versus Burnup		
	Feet	0 GWd/mtU	40 GWd/mtU	62 GWd/mtU
	0.000	16.6	16.6	12.2
	2.506	17.5	17.5	12.2
	4.264	17.6	17.6	12.2
	6.021	17.7	17.7	12.2
	7.779	17.6	17.6	12.2
	9.536	17.5	17.5	12.2
	12.00	16.6	16.6	12.2

Oconee 2 Cycle 23

Not for Plant Use
 Instrument uncertainties are not included in the values shown.

ΔT_{cold} , °F	4 RCP Operation - Loop Average Temp., °F	3 RCP Operation - Loop Average Temp., °F
	Tavg (Analytical)	Tavg (Analytical)
0.0	<581.0	<581.0
0.1	<581.0	<581.0
0.2	<581.1	<581.0
0.3	<581.1	<581.1
0.4	<581.2	<581.1
0.5	<581.2	<581.1
0.6	<581.2	<581.1
0.7	<581.3	<581.2
0.8	<581.3	<581.2
0.9	<581.3	<581.2
1.0	<581.4	<581.2
1.1	<581.4	<581.2
1.2	<581.5	<581.3
1.3	<581.5	<581.3
1.4	<581.5	<581.3
1.5	<581.6	<581.3
1.6	<581.6	<581.4
1.7	<581.6	<581.4
1.8	<581.7	<581.4
1.9	<581.7	<581.4
2.0	<581.8	<581.4
2.1	<581.8	<581.5
2.2	<581.8	<581.5
2.3	<581.9	<581.5
2.4	<581.9	<581.5
2.5	<582.0	<581.6
2.6	<582.0	<581.6
2.7	<582.0	<581.6
2.8	<582.1	<581.6
2.9	<582.1	<581.6
3.0	<582.1	<581.7
3.1	<582.2	<581.7
3.2	<582.2	<581.7
3.3	<582.3	<581.7
3.4	<582.3	<581.7
3.5	<582.3	<581.8
3.6	<582.4	<581.8
3.7	<582.4	<581.8
3.8	<582.4	<581.8
3.9	<582.5	<581.9
4.0	<582.5	<581.9
4.1	<582.6	<581.9
4.2	<582.6	<581.9
4.3	<582.6	<581.9
4.4	<582.7	<582.0
4.5	<582.7	<582.0
4.6	<582.7	<582.0
4.7	<582.8	<582.0
4.8	<582.8	<582.1
4.9	<582.9	<582.1
5.0	<582.9	<582.1