



Entergy Nuclear Operations, Inc.
Palisades Nuclear Plant
27780 Blue Star Memorial Highway
Covert, MI 49043

April 11, 2007

Technical Specification 5.6.8

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, DC 20555-0001

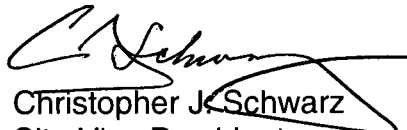
Palisades Nuclear Power Plant
Docket 50-255
License No. DPR-20

Steam Generator Tube Integrity Assessment from the 2006 Refueling Outage

Entergy Nuclear Operations, Inc. (ENO) is providing the Palisades Nuclear Plant (PNP) Steam Generator Tube Integrity Assessment Report for the 2006 refueling outage. The inservice inspection was completed on April 19, 2006. At the time of the inspection, PNP Technical Specification (TS) 5.6.8.b required that this report be submitted to the Nuclear Regulatory Commission within 12 months following the completion of the inservice inspection. Subsequent to this inspection, TS 5.6.8 was revised with implementation of Amendment 223. ENO is required to submit future Steam Generator Tube Integrity Assessment Reports within 180 days after the initial entry into mode 4.

Summary of Commitments

This letter contains no new commitments and no revisions to existing commitments.


Christopher J. Schwarz
Site Vice President
Palisades Nuclear Plant

Enclosure (1)

CC Administrator, Region III, USNRC
Project Manager, Palisades, USNRC
Resident Inspector, Palisades, USNRC

A122

ENCLOSURE 1

STEAM GENERATOR TUBE INTEGRITY ASSESSMENT
2006 REFUELING OUTAGE

55 Pages Follow

PALISADES NUCLEAR PLANT

**STEAM GENERATOR
TUBE SURVEILLANCE REPORT
2006 REFUELING OUTAGE**

John Hager, 3-21-2007
Assessment Sponsor Date

[Signature], 21 MAR 07
Eddy Current Level III Review Date

[Signature], 3/22/07
Supervisor Review Date

[Signature], 3/23/07
Manager Review Date

TABLE OF CONTENTS

TITLE PAGE	1
TABLE OF CONTENTS	2
1.0 <u>PURPOSE</u>	3
1.1 TECHNICAL SPECIFICATIONS	3
TABLE 1 NUMBER AND EXTENT OF TUBES INSPECTED	3
TABLE 2 IDENTIFICATION OF TUBES PLUGGED	4
TABLE 3 SUPPORT STRUCTURE NOMENCLATURE	5
TABLE 4 ACRONYMS AND THREE LETTER NDE CODES	5
ATTACHMENT 1 STEAM GENERATOR E-50A INDICATIONS	6
ATTACHMENT 2 STEAM GENERATOR E-50B INDICATIONS	34

1.0 PURPOSE

1.1 TECHNICAL SPECIFICATIONS

It is the intent of this Steam Generator Tube Surveillance Report to provide all the information required to meet the reporting requirements of Palisades Technical Specification 5.6.8b. The specific information is identified below:

- Number (as a percentage) and extent of tubes inspected is located in Table 1.
- Identification of tubes plugged is located in Table 2.
- Location and percent wall-thickness penetration for each indication of an imperfection is located in Attachment 1 for Steam Generator E-50A Indications and Attachment 2 for Steam Generator E-50B Indications.

Steam generator support structure nomenclature can be found in Table 3. Acronyms and three letter NDE codes be found in Table 4.

**Table 1
Number and Extent of Tubes Inspected**

Scope	Probe Type	SG E-50A	SG E-50B
Full Length ^①	Bobbin	100%	100%
Row 1 through 3 U-bends	MRPC	100%	100%
Row 4 U-bends	MRPC	N/A	100%
Hot Leg Tubesheets TTS+3"/-13.5"	MRPC	100%	100%
Cold Leg Periphery TTS+2"/-2"	MRPC	11.3%	11.4%
Dings and Dents > 5.0 Volts	MRPC	100%	100%
Eggcrate Dents ≥ 2.0 but ≤ 5.0 Volts	MRPC	100%	100%
Historical Wear at Eggcrates	MRPC	100%	100%
Historical Wear at Diagonal Bars and Vertical Straps	MRPC	25%	25%
Supplemental ^②	MRPC	100%	100%
Plug Visual	N/A	100%	100%

① Except the bend portion of rows 1 through 3

② All DNI, DSI, NQI, PLP (Bound MRPC PLP's), PVN and new wear indications.

Table 2
Identification of Tubes Plugged

SG	Row	Column	Location	Reason For Plugging
E-50A	5	12	TSH	Restricted Tube (RST) Foreign Object
E-50A	93	32	VS6 + 16.81"	Single Axial Indication (SAI)(10.5 Volt DNG)
E-50A	34	47	TSH + 0.02"	Single Axial Indication (SAI)
E-50A	26	53	TSH + 0.43"	Single Axial Indication (SAI)
E-50A	90	67	TSH + 0.25"	Single Volumetric Indication (SVI)(PLP)
E-50A	134	67	VS7 + 0.78"	40% Throughwall Wear (WAR)
E-50A	137	72	VS6 – 0.86"	43% Throughwall Wear (WAR)
E-50A	70	75	TSH + 0.61"	Single Axial Indication (SAI)
E-50A	133	76	VS2 – 0.92"	40% Throughwall Wear (WAR)
E-50A	77	78	TSH + 0.01"	Single Circumferential Indication (SCI)
E-50A	138	79	DBH + 1.99"	40% Throughwall Wear (WAR)
E-50A	72	81	TSH – 0.04"	Single Circumferential Indication (SCI)
E-50A	71	84	01H – 0.22"	Single Axial Indication (SAI)
E-50A	72	87	TSH – 0.01"	Single Circumferential Indication (SCI)
E-50A	133	90	04H + 7.52"	Single Axial Indication (SAI)(NQi)
E-50A	73	96	TSH + 0.69"	Single Axial Indication (SAI)
E-50A	56	105	TSH + 0.22" TSH + 0.23"	Two Single Axial Indications (2 SAI's)
E-50A	24	109	TSH – 0.44" TSH – 0.97"	Two Single Axial Indications (2 SAI's)
E-50A	126	113	VS1 – 0.63"	42% Throughwall Wear (WAR)
E-50A	27	118	TSH – 0.01"	Single Circumferential Indication (SCI)
E-50A	57	128	TSH + 0.11"	Single Circumferential Indication (SCI)
E-50A	80	131	05H + 18.61" to 06H + 11.3"	Seven Single Axial Indications (7 SAI's)
E-50B	26	3	TSC + 0.39"	Single Volumetric Indication (SVI)(PLP)
E-50B	29	48	TSH + 0.63"	Single Axial Indication (SAI)
E-50B	128	75	TSH + 0.78"	Possible Loose Part (TBP)
E-50B	130	75	TSH + 0.10" to TSH + 0.92"	Three Possible Loose Parts (TBP)
E-50B	129	76	TSH + 0.33" TSH + 0.60"	Two Possible Loose Parts (TBP)
E-50B	131	76	TSH + 0.06" TSH + 0.41"	Two Single Volumetric Indications (SVI)(PLP)
E-50B	79	90	TSH + 0.41"	Single Axial Indication (SAI)
E-50B	74	95	TSH + 0.84"	Single Axial Indication (SAI)
E-50B	3	130	05C/05H	Administrative (TBP)
E-50B	45	136	VS4 + 0.91"	40% Throughwall Wear (WAR)

**Table 3
Support Structure Nomenclature**

Name	Description	Name	Description
TEH	Tube End - Hot Side	VS4	Fourth Vertical Strap
TSH	Top of Tubesheet - Hot Side	VS5	Fifth Vertical Strap
01H	First Eggcrate - Hot Side	VS6	Sixth Vertical Strap
02H	Second Eggcrate - Hot Side	VS7	Seventh Vertical Strap
03H	Third Eggcrate - Hot Side	DBC	Diagonal Strap - Cold Side
04H	Fourth Eggcrate - Hot Side	08C	Eighth Eggcrate - Cold Side
05H	Fifth Eggcrate - Hot Side	07C	Seventh Eggcrate - Cold Side
06H	Sixth Eggcrate - Hot Side	06C	Sixth Eggcrate - Cold Side
07H	Seventh Eggcrate - Hot Side	05C	Fifth Eggcrate - Cold Side
08H	Eighth Eggcrate - Hot Side	04C	Fourth Eggcrate - Cold Side
DBH	Diagonal Strap - Hot Side	03C	Third Eggcrate - Cold Side
VS1	First Vertical Strap	02C	Second Eggcrate - Cold Side
VS2	Second Vertical Strap	01C	First Eggcrate - Cold Side
VS3	Third Vertical Strap	TSC	Top of Tubesheet - Cold Side
		TEC	Tube End - Cold Side

**Table 4
Acronyms and Three Letter NDE Codes**

Acronym	Definition
MRPC	Motorized Rotating Pancake Coil (+Pt.™)
NDE	Non Destructive Examination
NTE	No Tube Expansion
SAI	Single Axial Indication
SVI	Single Volumetric Indication
TBP	To Be Plugged
TTS	Top of Tubesheet
<TS	Less Than Technical Specification
WAR	Wear Indication

Attachment 1
Steam Generator E-50A Indications

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
1	E-50A	C	9	2	19	02C	0.12	0	<TS
2	E-50A	C	13	2	9	02H	-1.01	0	<TS
3	E-50A	C	13	2	19	02H	0.93	0	<TS
4	E-50A	C	14	3	24	02C	0.79	0	<TS
5	E-50A	C	26	3	20	02C	-1	0	<TS
6	E-50A	C	26	5	8	02H	-1.02	0	<TS
7	E-50A	C	26	5	16	02H	-0.17	0	<TS
8	E-50A	C	28	5	16	DBC	1.48	0	<TS
9	E-50A	C	40	5	16	01C	-0.86	0	<TS
10	E-50A	C	42	5	15	02H	0.9	0	<TS
11	E-50A	C	41	6	14	02C	-0.26	0	<TS
12	E-50A	C	32	7	20	02C	-0.92	0	<TS
13	E-50A	C	42	7	11	02C	0.06	0	<TS
14	E-50A	C	42	7	21	02C	0.9	0	<TS
15	E-50A	C	48	7	24	01C	0.86	0	<TS
16	E-50A	C	47	8	16	01H	-0.85	0	<TS
17	E-50A	C	55	8	15	01C	-0.03	0	<TS
18	E-50A	C	28	9	25	05C	-1.2	0	<TS
19	E-50A	C	49	10	20	VS4	0.92	0	<TS
20	E-50A	C	53	10	16	01C	-0.95	0	<TS
21	E-50A	C	62	11	16	01C	-0.84	0	<TS
22	E-50A	C	64	11	13	06H	0.73	0	<TS
23	E-50A	C	64	11	25	VS4	-0.86	0	<TS
24	E-50A	C	64	11	16	VS5	1.14	0	<TS
25	E-50A	C	63	12	16	01C	-0.92	0	<TS
26	E-50A	C	65	12	22	06H	0.6	0	<TS
27	E-50A	C	67	12	15	03H	0.86	0	<TS
28	E-50A	C	64	13	17	04H	0.96	0	<TS
29	E-50A	C	64	13	19	VS4	-0.95	0	<TS
30	E-50A	C	67	14	25	05H	0.84	0	<TS
31	E-50A	C	73	14	14	05H	-0.93	0	<TS
32	E-50A	C	34	15	14	VS4	-0.96	0	<TS
33	E-50A	C	74	15	22	VS4	0.79	0	<TS
34	E-50A	C	74	15	14	01C	-0.91	0	<TS
35	E-50A	C	76	15	31	DBC	-1.52	0	<TS
36	E-50A	C	31	16	25	VS4	0.84	0	<TS
37	E-50A	C	51	16	17	VS4	-0.54	0	<TS
38	E-50A	C	75	16	28	VS5	-0.85	0	<TS
39	E-50A	C	75	16	22	06C	0.09	0	<TS
40	E-50A	C	77	16	29	VS4	-0.93	0	<TS
41	E-50A	C	79	16	15	DBH	-1.24	0	<TS
42	E-50A	C	38	17	20	05H	-0.11	0	<TS
43	E-50A	C	51	18	7	VS4	0.47	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
44	E-50A	C	51	18	7	DBC	1.98	0	<TS
45	E-50A	C	79	18	14	VS4	-0.59	0	<TS
46	E-50A	C	4	19	16	DBH	0.45	0	<TS
47	E-50A	C	28	19	21	VS4	-0.8	0	<TS
48	E-50A	C	44	19	11	VS4	0.58	0	<TS
49	E-50A	C	48	19	34	VS4	-0.43	0	<TS
50	E-50A	C	48	19	26	VS4	0.62	0	<TS
51	E-50A	C	76	19	10	DBC	1.69	0	<TS
52	E-50A	C	84	19	18	VS2	0.66	0	<TS
53	E-50A	C	84	19	23	VS4	-0.92	0	<TS
54	E-50A	C	84	19	22	VS4	0.65	0	<TS
55	E-50A	C	84	19	18	VS5	0.84	0	<TS
56	E-50A	C	41	20	15	05H	0.85	0	<TS
57	E-50A	C	49	20	26	VS4	-0.73	0	<TS
58	E-50A	C	49	20	24	VS4	0.82	0	<TS
59	E-50A	C	51	20	31	VS3	-0.68	0	<TS
60	E-50A	C	85	20	23	VS4	-0.84	0	<TS
61	E-50A	C	85	20	21	VS4	0.65	0	<TS
62	E-50A	C	87	20	18	VS4	-0.12	0	<TS
63	E-50A	C	87	20	22	VS4	0.66	0	<TS
64	E-50A	C	44	21	26	VS4	-0.77	0	<TS
65	E-50A	C	44	21	20	VS4	-0.06	0	<TS
66	E-50A	C	44	21	26	VS4	0.68	0	<TS
67	E-50A	C	48	21	24	VS4	-0.75	0	<TS
68	E-50A	C	68	21	22	VS4	-0.82	0	<TS
69	E-50A	C	68	21	22	VS4	0.92	0	<TS
70	E-50A	C	68	21	15	VS5	-0.06	0	<TS
71	E-50A	C	68	21	19	VS5	0.9	0	<TS
72	E-50A	C	88	21	23	VS4	-0.84	0	<TS
73	E-50A	C	39	22	21	01H	0.82	0	<TS
74	E-50A	C	69	22	25	VS4	-1.04	0	<TS
75	E-50A	C	69	22	16	VS4	-0.03	0	<TS
76	E-50A	C	69	22	27	VS4	0.88	0	<TS
77	E-50A	C	69	22	24	VS5	0.88	0	<TS
78	E-50A	C	81	22	13	DBC	-1.52	0	<TS
79	E-50A	C	87	22	16	VS4	-0.83	0	<TS
80	E-50A	C	91	22	31	VS4	0.65	0	<TS
81	E-50A	C	90	23	13	VS4	-0.81	0	<TS
82	E-50A	C	92	23	18	VS2	0.56	0	<TS
83	E-50A	C	92	23	17	VS2	1.01	0	<TS
84	E-50A	C	92	23	24	VS6	0.98	0	<TS
85	E-50A	C	47	24	13	04H	-0.68	0	<TS
86	E-50A	C	49	24	14	VS4	-0.8	0	<TS
87	E-50A	C	67	24	25	06H	0.8	0	<TS
88	E-50A	C	95	24	26	VS4	-0.72	0	<TS
89	E-50A	C	95	24	18	VS4	0.32	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
90	E-50A	C	14	25	17	05H	-1.1	0	<TS
91	E-50A	C	18	25	14	VS4	-1.19	0	<TS
92	E-50A	C	88	25	13	VS4	-0.68	0	<TS
93	E-50A	C	94	25	17	VS4	-0.93	0	<TS
94	E-50A	C	96	25	20	02H	0.84	0	<TS
95	E-50A	C	96	25	35	VS4	0.88	0	<TS
96	E-50A	C	85	26	17	03H	0.82	0	<TS
97	E-50A	C	99	26	27	VS4	-0.7	0	<TS
98	E-50A	C	56	27	13	03H	-0.76	0	<TS
99	E-50A	C	66	27	14	06C	0.8	0	<TS
100	E-50A	C	80	27	16	VS3	0.98	0	<TS
101	E-50A	C	98	27	19	VS2	0.58	0	<TS
102	E-50A	C	98	27	11	VS6	-0.73	0	<TS
103	E-50A	C	98	27	18	VS6	0.87	0	<TS
104	E-50A	C	100	27	25	VS4	-0.84	0	<TS
105	E-50A	C	100	27	17	VS4	0.96	0	<TS
106	E-50A	C	49	28	15	03C	0.9	0	<TS
107	E-50A	C	48	29	17	03C	0.93	0	<TS
108	E-50A	C	50	29	14	04C	0.9	0	<TS
109	E-50A	C	54	29	18	02C	0.9	0	<TS
110	E-50A	C	60	29	19	04H	0.96	0	<TS
111	E-50A	C	84	29	20	VS2	0.82	0	<TS
112	E-50A	C	100	29	17	04H	0.9	0	<TS
113	E-50A	C	100	29	21	05H	0.86	0	<TS
114	E-50A	C	100	29	21	06H	0.88	0	<TS
115	E-50A	C	100	29	16	VS2	-0.74	0	<TS
116	E-50A	C	100	29	22	VS2	0.93	0	<TS
117	E-50A	C	100	29	20	VS4	0.82	0	<TS
118	E-50A	C	102	29	23	VS4	-1.11	0	<TS
119	E-50A	C	37	30	15	05H	0.83	0	<TS
120	E-50A	C	45	30	16	04H	-0.84	0	<TS
121	E-50A	C	45	30	12	04H	-0.15	0	<TS
122	E-50A	C	51	30	13	06H	-0.82	0	<TS
123	E-50A	C	59	30	17	03C	0.84	0	<TS
124	E-50A	C	67	30	16	06C	-0.99	0	<TS
125	E-50A	C	95	30	36	VS4	-0.68	0	<TS
126	E-50A	C	95	30	31	VS4	0.88	0	<TS
127	E-50A	C	101	30	20	04H	-0.11	0	<TS
128	E-50A	C	101	30	17	VS4	-0.72	0	<TS
129	E-50A	C	103	30	17	VS4	0.77	0	<TS
130	E-50A	C	105	30	27	VS4	-0.52	0	<TS
131	E-50A	C	28	31	20	VS4	-0.9	0	<TS
132	E-50A	C	52	31	16	03C	0.81	0	<TS
133	E-50A	C	66	31	20	04H	0.92	0	<TS
134	E-50A	C	94	31	22	VS4	-1.03	0	<TS
135	E-50A	C	104	31	19	VS4	-0.84	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
136	E-50A	C	104	31	20	VS4	1	0	<TS
137	E-50A	C	106	31	31	VS6	-0.77	0	<TS
138	E-50A	C	106	31	29	VS6	0.97	0	<TS
139	E-50A	C	106	31	23	04C	0.92	0	<TS
140	E-50A	C	9	32	16	DBC	0.98	0	<TS
141	E-50A	C	103	32	19	VS4	-0.92	0	<TS
142	E-50A	C	105	32	18	01C	0.15	0	<TS
143	E-50A	C	107	32	32	VS4	-0.79	0	<TS
144	E-50A	C	42	33	9	DBH	-1.64	0	<TS
145	E-50A	C	42	33	15	DBC	-1.62	0	<TS
146	E-50A	C	52	33	13	06H	0.82	0	<TS
147	E-50A	C	60	33	16	DBC	1.88	0	<TS
148	E-50A	C	62	33	17	03H	0.9	0	<TS
149	E-50A	C	84	33	20	VS2	-0.79	0	<TS
150	E-50A	C	106	33	19	VS4	-0.74	0	<TS
151	E-50A	C	108	33	30	VS4	-0.79	0	<TS
152	E-50A	C	108	33	27	VS4	0.9	0	<TS
153	E-50A	C	13	34	20	03C	-0.92	0	<TS
154	E-50A	C	37	34	22	DBC	1.65	0	<TS
155	E-50A	C	41	34	15	03H	-0.78	0	<TS
156	E-50A	C	47	34	14	03C	0.75	0	<TS
157	E-50A	C	109	34	15	01H	0.98	0	<TS
158	E-50A	C	109	34	31	VS4	0.6	0	<TS
159	E-50A	C	38	35	23	03H	0.92	0	<TS
160	E-50A	C	38	35	26	04H	0.92	0	<TS
161	E-50A	C	38	35	14	05H	0.08	0	<TS
162	E-50A	C	38	35	17	05H	0.78	0	<TS
163	E-50A	C	40	35	15	02C	0.2	0	<TS
164	E-50A	C	62	35	17	03H	0.85	0	<TS
165	E-50A	C	66	35	16	03H	1	0	<TS
166	E-50A	C	66	35	18	04H	0.91	0	<TS
167	E-50A	C	106	35	21	03C	0.85	0	<TS
168	E-50A	C	108	35	28	01C	0.12	0	<TS
169	E-50A	C	108	35	19	01C	0.91	0	<TS
170	E-50A	C	110	35	18	01H	1.01	0	<TS
171	E-50A	C	37	36	8	04H	-0.96	0	<TS
172	E-50A	C	37	36	14	04H	-0.22	0	<TS
173	E-50A	C	113	36	19	VS4	-0.62	0	<TS
174	E-50A	C	32	37	9	03H	0.03	0	<TS
175	E-50A	C	32	37	15	03H	0.93	0	<TS
176	E-50A	C	64	37	15	VS3	0.21	0	<TS
177	E-50A	C	64	37	17	VS5	0.97	0	<TS
178	E-50A	C	84	37	17	VS2	-0.84	0	<TS
179	E-50A	C	96	37	15	VS6	-0.99	0	<TS
180	E-50A	C	112	37	10	DBH	-2.3	0	<TS
181	E-50A	C	112	37	21	02C	-1.05	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
182	E-50A	C	114	37	31	DBH	1.28	0	<TS
183	E-50A	C	114	37	39	VS2	-0.81	0	<TS
184	E-50A	C	114	37	13	VS2	0.88	0	<TS
185	E-50A	C	114	37	15	VS6	0.94	0	<TS
186	E-50A	C	114	37	6	08C	-1.13	0	<TS
187	E-50A	C	114	37	20	08C	1.03	0	<TS
188	E-50A	C	37	38	19	03C	0.75	0	<TS
189	E-50A	C	59	38	16	03H	0.86	0	<TS
190	E-50A	C	67	38	14	06H	0.95	0	<TS
191	E-50A	C	115	38	13	VS4	0.67	0	<TS
192	E-50A	C	115	38	17	02C	-0.89	0	<TS
193	E-50A	C	115	38	17	02C	0.06	0	<TS
194	E-50A	C	50	39	14	04H	0.89	0	<TS
195	E-50A	C	84	39	12	VS2	-0.8	0	<TS
196	E-50A	C	84	39	20	VS3	-0.83	0	<TS
197	E-50A	C	110	39	19	VS2	0.88	0	<TS
198	E-50A	C	116	39	17	VS6	-0.56	0	<TS
199	E-50A	C	116	39	30	02C	-0.84	0	<TS
200	E-50A	C	23	40	16	VS4	1.02	0	<TS
201	E-50A	C	55	40	9	DBC	1.49	0	<TS
202	E-50A	C	69	40	16	04H	0.9	0	<TS
203	E-50A	C	87	40	19	07H	-0.63	0	<TS
204	E-50A	C	87	40	11	07H	0.03	0	<TS
205	E-50A	C	87	40	18	07C	0.79	0	<TS
206	E-50A	C	117	40	24	VS4	-0.93	0	<TS
207	E-50A	C	117	40	13	02C	-0.17	0	<TS
208	E-50A	C	117	40	24	02C	0.81	0	<TS
209	E-50A	C	24	41	15	VS4	-0.87	0	<TS
210	E-50A	C	42	41	30	VS4	-0.81	0	<TS
211	E-50A	C	42	41	25	VS4	0.47	0	<TS
212	E-50A	C	44	41	21	VS4	-0.03	0	<TS
213	E-50A	C	48	41	35	VS4	-0.87	0	<TS
214	E-50A	C	48	41	19	VS4	0.87	0	<TS
215	E-50A	C	56	41	14	02H	-0.11	0	<TS
216	E-50A	C	68	41	14	04H	0.93	0	<TS
217	E-50A	C	96	41	14	VS6	-0.47	0	<TS
218	E-50A	C	96	41	18	VS6	1.16	0	<TS
219	E-50A	C	100	41	15	06C	0.7	0	<TS
220	E-50A	C	108	41	17	VS4	0.86	0	<TS
221	E-50A	C	112	41	18	VS4	-0.96	0	<TS
222	E-50A	C	118	41	20	VS4	-0.87	0	<TS
223	E-50A	C	118	41	27	02C	-0.03	0	<TS
224	E-50A	C	39	42	18	03C	-0.86	0	<TS
225	E-50A	C	59	42	12	VS3	0.84	0	<TS
226	E-50A	C	113	42	16	VS4	-0.88	0	<TS
227	E-50A	C	113	42	11	VS4	0.98	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
228	E-50A	C	117	42	35	01C	-1	0	<TS
229	E-50A	C	42	43	21	04H	0.9	0	<TS
230	E-50A	C	48	43	36	VS4	-0.75	0	<TS
231	E-50A	C	48	43	10	VS4	0.24	0	<TS
232	E-50A	C	48	43	23	VS4	0.75	0	<TS
233	E-50A	C	118	43	34	01C	-0.96	0	<TS
234	E-50A	C	41	44	13	05C	-0.95	0	<TS
235	E-50A	C	41	44	16	03C	-0.96	0	<TS
236	E-50A	C	43	44	15	04C	0.95	0	<TS
237	E-50A	C	73	44	16	04H	0.9	0	<TS
238	E-50A	C	73	44	20	06C	-0.87	0	<TS
239	E-50A	C	75	44	33	VS3	-0.96	0	<TS
240	E-50A	C	75	44	20	VS3	0.84	0	<TS
241	E-50A	C	77	44	17	VS3	1.06	0	<TS
242	E-50A	C	77	44	18	VS4	-0.1	0	<TS
243	E-50A	C	77	44	23	VS5	0.88	0	<TS
244	E-50A	C	107	44	15	05H	-0.98	0	<TS
245	E-50A	C	107	44	18	05H	-0.14	0	<TS
246	E-50A	C	107	44	15	VS2	0.78	0	<TS
247	E-50A	C	107	44	12	VS4	0.91	0	<TS
248	E-50A	C	111	44	19	06C	-0.2	0	<TS
249	E-50A	C	121	44	16	VS4	0.15	0	<TS
250	E-50A	C	121	44	17	01C	-1.02	0	<TS
251	E-50A	C	68	45	15	06H	0.8	0	<TS
252	E-50A	C	106	45	14	05H	-0.14	0	<TS
253	E-50A	C	33	46	16	02H	0.86	0	<TS
254	E-50A	C	43	46	24	VS4	-1.08	0	<TS
255	E-50A	C	55	46	13	04H	-0.98	0	<TS
256	E-50A	C	81	46	25	VS5	0.94	0	<TS
257	E-50A	C	97	46	18	VS6	-0.7	0	<TS
258	E-50A	C	97	46	16	VS6	-0.11	0	<TS
259	E-50A	C	115	46	14	VS4	-0.8	0	<TS
260	E-50A	C	38	47	16	02H	0.89	0	<TS
261	E-50A	C	48	47	28	VS4	-0.84	0	<TS
262	E-50A	C	48	47	37	VS4	1.05	0	<TS
263	E-50A	C	106	47	15	04C	-0.06	0	<TS
264	E-50A	C	106	47	15	04C	0.72	0	<TS
265	E-50A	C	118	47	16	02H	0.89	0	<TS
266	E-50A	C	79	48	15	04C	-0.17	0	<TS
267	E-50A	C	91	48	19	07C	0.14	0	<TS
268	E-50A	C	91	48	16	05C	-0.94	0	<TS
269	E-50A	C	95	48	21	06C	0.97	0	<TS
270	E-50A	C	97	48	16	VS4	-0.88	0	<TS
271	E-50A	C	97	48	16	VS4	0.96	0	<TS
272	E-50A	C	97	48	18	VS6	-0.78	0	<TS
273	E-50A	C	97	48	17	VS6	0.89	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
274	E-50A	C	97	48	10	DBC	1.74	0	<TS
275	E-50A	C	123	48	16	05C	0.91	0	<TS
276	E-50A	C	125	48	22	VS4	-0.63	0	<TS
277	E-50A	C	18	49	13	VS4	-0.81	0	<TS
278	E-50A	C	44	49	18	04H	0.96	0	<TS
279	E-50A	C	44	49	28	VS4	-0.49	0	<TS
280	E-50A	C	44	49	25	VS4	0.15	0	<TS
281	E-50A	C	44	49	21	05C	-1.02	0	<TS
282	E-50A	C	62	49	16	05H	0.89	0	<TS
283	E-50A	C	124	49	15	01H	0.9	0	<TS
284	E-50A	C	37	50	11	04H	-0.79	0	<TS
285	E-50A	C	37	50	16	04H	0.96	0	<TS
286	E-50A	C	47	50	16	VS4	0.93	0	<TS
287	E-50A	C	59	50	15	06H	0.83	0	<TS
288	E-50A	C	75	50	24	VS3	-1.01	0	<TS
289	E-50A	C	75	50	17	VS3	0.9	0	<TS
290	E-50A	C	97	50	29	VS2	-0.79	0	<TS
291	E-50A	C	97	50	18	VS2	0.87	0	<TS
292	E-50A	C	97	50	22	VS4	-0.8	0	<TS
293	E-50A	C	97	50	21	VS4	0.93	0	<TS
294	E-50A	C	97	50	22	VS6	0.84	0	<TS
295	E-50A	C	115	50	16	VS4	-0.83	0	<TS
296	E-50A	C	121	50	15	06C	0.86	0	<TS
297	E-50A	C	38	51	30	04C	0.98	0	<TS
298	E-50A	C	46	51	18	03H	0.86	0	<TS
299	E-50A	C	50	51	14	03H	0.91	0	<TS
300	E-50A	C	76	51	16	VS4	0.9	0	<TS
301	E-50A	C	94	51	17	04C	0.85	0	<TS
302	E-50A	C	98	51	16	05C	0.96	0	<TS
303	E-50A	C	116	51	21	07H	0.97	0	<TS
304	E-50A	C	126	51	24	03H	0.91	0	<TS
305	E-50A	C	41	52	25	VS4	-0.68	0	<TS
306	E-50A	C	45	52	15	03H	0.93	0	<TS
307	E-50A	C	63	52	15	06C	0.79	0	<TS
308	E-50A	C	97	52	10	VS2	-0.81	0	<TS
309	E-50A	C	97	52	23	VS2	0.81	0	<TS
310	E-50A	C	97	52	30	VS4	-0.83	0	<TS
311	E-50A	C	97	52	28	VS6	0.73	0	<TS
312	E-50A	C	107	52	16	02H	0.99	0	<TS
313	E-50A	C	119	52	25	06C	0.84	0	<TS
314	E-50A	C	127	52	13	03C	-0.11	0	<TS
315	E-50A	C	28	53	18	02H	0.93	0	<TS
316	E-50A	C	28	53	21	VS4	-0.9	0	<TS
317	E-50A	C	28	53	11	DBC	-1.77	0	<TS
318	E-50A	C	46	53	28	VS4	-0.87	0	<TS
319	E-50A	C	46	53	23	VS4	1	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
320	E-50A	C	68	53	14	04H	-0.11	0	<TS
321	E-50A	C	70	53	23	03C	0.17	0	<TS
322	E-50A	C	84	53	24	VS2	-0.84	0	<TS
323	E-50A	C	88	53	20	VS4	0.9	0	<TS
324	E-50A	C	88	53	23	07C	0.78	0	<TS
325	E-50A	C	116	53	15	05C	0.92	0	<TS
326	E-50A	C	122	53	16	06H	0.88	0	<TS
327	E-50A	C	128	53	21	02H	-0.88	0	<TS
328	E-50A	C	41	54	16	04C	-1.01	0	<TS
329	E-50A	C	69	54	19	03C	-0.95	0	<TS
330	E-50A	C	71	54	15	04H	0.97	0	<TS
331	E-50A	C	71	54	14	03C	0.77	0	<TS
332	E-50A	C	81	54	17	05C	-1.06	0	<TS
333	E-50A	C	97	54	15	05C	-0.12	0	<TS
334	E-50A	C	97	54	16	05C	0.87	0	<TS
335	E-50A	C	129	54	26	02C	-0.92	0	<TS
336	E-50A	C	46	55	19	VS4	0.93	0	<TS
337	E-50A	C	70	55	23	03C	-0.69	0	<TS
338	E-50A	C	72	55	19	03C	-0.89	0	<TS
339	E-50A	C	76	55	23	03C	0.75	0	<TS
340	E-50A	C	98	55	15	05H	0.92	0	<TS
341	E-50A	C	98	55	14	DBC	-1.79	0	<TS
342	E-50A	C	37	56	22	04H	0.95	0	<TS
343	E-50A	C	53	56	17	03H	0.83	0	<TS
344	E-50A	C	65	56	16	06C	0.79	0	<TS
345	E-50A	C	69	56	16	03C	0.75	0	<TS
346	E-50A	C	73	56	15	05C	-0.88	0	<TS
347	E-50A	C	87	56	17	04C	0.8	0	<TS
348	E-50A	C	127	56	16	VS1	-0.77	0	<TS
349	E-50A	C	129	56	21	02H	1.01	0	<TS
350	E-50A	C	88	57	21	07C	0.81	0	<TS
351	E-50A	C	130	57	24	08H	0.82	0	<TS
352	E-50A	C	87	58	13	VS2	-0.58	0	<TS
353	E-50A	C	93	58	26	VS2	-0.85	0	<TS
354	E-50A	C	93	58	22	VS2	0.93	0	<TS
355	E-50A	C	93	58	21	VS4	0.8	0	<TS
356	E-50A	C	93	58	28	VS6	0.93	0	<TS
357	E-50A	C	97	58	19	07C	0.92	0	<TS
358	E-50A	C	117	58	16	06C	0.9	0	<TS
359	E-50A	C	129	58	30	02H	0.88	0	<TS
360	E-50A	C	129	58	16	07H	-1	0	<TS
361	E-50A	C	40	59	18	05H	0.95	0	<TS
362	E-50A	C	42	59	19	04H	0.99	0	<TS
363	E-50A	C	64	59	15	05C	0.84	0	<TS
364	E-50A	C	66	59	18	06C	0.84	0	<TS
365	E-50A	C	88	59	15	05C	0.21	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
366	E-50A	C	88	59	18	05C	0.93	0	<TS
367	E-50A	C	92	59	14	VS4	-0.73	0	<TS
368	E-50A	C	92	59	15	VS4	0.95	0	<TS
369	E-50A	C	92	59	14	VS6	0.69	0	<TS
370	E-50A	C	96	59	18	04C	-0.84	0	<TS
371	E-50A	C	106	59	24	VS4	-1.16	0	<TS
372	E-50A	C	106	59	34	VS4	1.03	0	<TS
373	E-50A	C	106	59	22	VS6	-0.81	0	<TS
374	E-50A	C	112	59	26	VS4	-0.4	0	<TS
375	E-50A	C	112	59	31	VS6	0.95	0	<TS
376	E-50A	C	41	60	25	05H	0.84	0	<TS
377	E-50A	C	87	60	19	VS2	-0.83	0	<TS
378	E-50A	C	93	60	15	VS2	-0.74	0	<TS
379	E-50A	C	93	60	22	VS2	0.83	0	<TS
380	E-50A	C	93	60	17	VS6	-0.96	0	<TS
381	E-50A	C	93	60	14	VS6	1.07	0	<TS
382	E-50A	C	119	60	16	VS4	-0.91	0	<TS
383	E-50A	C	133	60	13	02H	-0.87	0	<TS
384	E-50A	C	133	60	13	02H	0.93	0	<TS
385	E-50A	C	133	60	13	VS4	0.57	0	<TS
386	E-50A	C	66	61	16	04H	0.79	0	<TS
387	E-50A	C	82	61	18	VS3	-0.87	0	<TS
388	E-50A	C	84	61	14	03C	0.09	0	<TS
389	E-50A	C	84	61	30	03C	0.83	0	<TS
390	E-50A	C	88	61	24	03C	0.54	0	<TS
391	E-50A	C	88	61	24	02C	0.86	0	<TS
392	E-50A	C	96	61	16	06H	0.92	0	<TS
393	E-50A	C	96	61	19	06C	0	0	<TS
394	E-50A	C	126	61	11	08C	-0.92	0	<TS
395	E-50A	C	132	61	14	01H	0.22	0	<TS
396	E-50A	C	37	62	22	04H	1.04	0	<TS
397	E-50A	C	39	62	13	05H	0.17	0	<TS
398	E-50A	C	97	62	20	06C	0.78	0	<TS
399	E-50A	C	97	62	17	05C	-0.9	0	<TS
400	E-50A	C	111	62	22	VS2	-0.89	0	<TS
401	E-50A	C	133	62	16	03H	0.76	0	<TS
402	E-50A	C	28	63	18	VS4	-0.87	0	<TS
403	E-50A	C	34	63	15	DBC	1.27	0	<TS
404	E-50A	C	56	63	19	VS5	0	0	<TS
405	E-50A	C	86	63	14	06C	0.69	0	<TS
406	E-50A	C	96	63	22	04C	0.93	0	<TS
407	E-50A	C	104	63	15	07C	-0.84	0	<TS
408	E-50A	C	106	63	13	VS4	-1.2	0	<TS
409	E-50A	C	106	63	15	VS4	0.19	0	<TS
410	E-50A	C	108	63	17	VS2	0.8	0	<TS
411	E-50A	C	116	63	14	VS6	-0.4	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
412	E-50A	C	118	63	19	VS4	-0.88	0	<TS
413	E-50A	C	118	63	15	VS4	0.95	0	<TS
414	E-50A	C	19	64	20	DBH	-1.5	0	<TS
415	E-50A	C	19	64	21	DBC	-1.54	0	<TS
416	E-50A	C	21	64	12	DBH	-1.39	0	<TS
417	E-50A	C	97	64	20	06C	-0.95	0	<TS
418	E-50A	C	133	64	17	05H	-0.08	0	<TS
419	E-50A	C	133	64	13	VS1	0.96	0	<TS
420	E-50A	C	44	65	23	VS4	-0.65	0	<TS
421	E-50A	C	46	65	17	VS4	0.77	0	<TS
422	E-50A	C	56	65	18	VS4	1	0	<TS
423	E-50A	C	96	65	15	05H	-0.85	0	<TS
424	E-50A	C	98	65	22	VS2	-0.74	0	<TS
425	E-50A	C	102	65	30	05H	-0.75	0	<TS
426	E-50A	C	134	65	23	07H	-0.11	0	<TS
427	E-50A	C	134	65	16	08H	0.88	0	<TS
428	E-50A	C	134	65	14	DBH	-1.97	0	<TS
429	E-50A	C	49	66	19	VS4	0.03	0	<TS
430	E-50A	C	49	66	19	VS4	0.81	0	<TS
431	E-50A	C	91	66	17	05C	0.9	0	<TS
432	E-50A	C	133	66	16	VS4	-0.58	0	<TS
433	E-50A	C	94	67	19	VS6	-0.95	0	<TS
434	E-50A	C	94	67	12	VS6	0.95	0	<TS
435	E-50A	C	100	67	30	VS6	-0.95	0	<TS
436	E-50A	C	102	67	13	07C	0.15	0	<TS
437	E-50A	C	106	67	21	VS6	0.47	0	<TS
438	E-50A	C	132	67	19	VS2	-0.87	0	<TS
439	E-50A	C	134	67	24	VS4	-0.91	0	<TS
440	E-50A	C	134	67	23	VS4	0.06	0	<TS
441	E-50A	C	134	67	12	VS4	0.9	0	<TS
442	E-50A	C	134	67	39	VS7	-0.84	0	<TS
443	E-50A	C	75	68	19	02C	0.85	0	<TS
444	E-50A	C	113	68	15	VS6	0.97	0	<TS
445	E-50A	C	46	69	14	VS4	-0.25	0	<TS
446	E-50A	C	48	69	32	VS4	0.81	0	<TS
447	E-50A	C	70	69	15	05H	-0.11	0	<TS
448	E-50A	C	92	69	17	05C	0.18	0	<TS
449	E-50A	C	92	69	15	05C	0.8	0	<TS
450	E-50A	C	106	69	15	VS4	-1.2	0	<TS
451	E-50A	C	106	69	15	VS6	0.81	0	<TS
452	E-50A	C	126	69	14	08H	-1.04	0	<TS
453	E-50A	C	126	69	15	VS4	-0.93	0	<TS
454	E-50A	C	126	69	35	VS4	0.89	0	<TS
455	E-50A	C	128	69	18	08H	0.91	0	<TS
456	E-50A	C	134	69	20	VS7	0.15	0	<TS
457	E-50A	C	134	69	28	VS7	0.69	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
458	E-50A	C	136	69	17	VS7	-0.98	0	<TS
459	E-50A	C	136	69	13	DBC	-1.85	0	<TS
460	E-50A	C	136	69	14	DBC	1.2	0	<TS
461	E-50A	C	49	70	18	VS4	0.86	0	<TS
462	E-50A	C	89	70	19	06C	0.96	0	<TS
463	E-50A	C	89	70	14	05C	-0.8	0	<TS
464	E-50A	C	91	70	15	VS6	0.98	0	<TS
465	E-50A	C	97	70	15	07H	0.75	0	<TS
466	E-50A	C	99	70	14	06H	-0.21	0	<TS
467	E-50A	C	101	70	16	05H	0.88	0	<TS
468	E-50A	C	131	70	13	DBC	1.7	0	<TS
469	E-50A	C	82	71	15	VS3	1.01	0	<TS
470	E-50A	C	94	71	14	05C	-0.83	0	<TS
471	E-50A	C	104	71	15	DBH	1.99	0	<TS
472	E-50A	C	128	71	20	VS1	-0.9	0	<TS
473	E-50A	C	128	71	31	VS1	0.94	0	<TS
474	E-50A	C	128	71	17	VS2	0.09	0	<TS
475	E-50A	C	130	71	20	VS4	-0.96	0	<TS
476	E-50A	C	134	71	16	VS1	0.22	0	<TS
477	E-50A	C	134	71	20	VS1	0.89	0	<TS
478	E-50A	C	79	72	17	VS3	0.09	0	<TS
479	E-50A	C	127	72	20	VS6	-0.36	0	<TS
480	E-50A	C	135	72	28	VS1	-1.03	0	<TS
481	E-50A	C	135	72	16	VS1	0.91	0	<TS
482	E-50A	C	135	72	15	VS7	0.36	0	<TS
483	E-50A	C	137	72	17	VS2	0.68	0	<TS
484	E-50A	C	137	72	26	DBC	1.29	0	<TS
485	E-50A	C	84	73	17	05C	0.84	0	<TS
486	E-50A	C	88	73	19	02H	-0.2	0	<TS
487	E-50A	C	130	73	14	VS6	0.86	0	<TS
488	E-50A	C	130	73	21	VS7	0.68	0	<TS
489	E-50A	C	134	73	16	VS6	1.1	0	<TS
490	E-50A	C	49	74	20	VS4	-0.8	0	<TS
491	E-50A	C	83	74	15	05H	0.81	0	<TS
492	E-50A	C	129	74	17	VS1	-0.99	0	<TS
493	E-50A	C	133	74	19	VS4	0.15	0	<TS
494	E-50A	C	133	74	24	VS4	0.75	0	<TS
495	E-50A	C	135	74	18	VS4	-0.52	0	<TS
496	E-50A	C	137	74	9	VS1	-0.41	0	<TS
497	E-50A	C	137	74	18	VS1	0.28	0	<TS
498	E-50A	C	137	74	17	VS1	0.87	0	<TS
499	E-50A	C	78	75	12	02H	0.19	0	<TS
500	E-50A	C	98	75	22	06C	0.96	0	<TS
501	E-50A	C	102	75	16	VS2	-0.5	0	<TS
502	E-50A	C	114	75	12	06H	0.87	0	<TS
503	E-50A	C	136	75	11	06C	0.81	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
504	E-50A	C	138	75	10	07H	-1.04	0	<TS
505	E-50A	C	138	75	13	07H	0.78	0	<TS
506	E-50A	C	138	75	24	DBH	1.7	0	<TS
507	E-50A	C	138	75	9	08C	-0.99	0	<TS
508	E-50A	C	138	75	15	08C	0.15	0	<TS
509	E-50A	C	138	75	13	07C	0.9	0	<TS
510	E-50A	C	65	76	12	02H	-0.08	0	<TS
511	E-50A	C	83	76	17	02H	0.95	0	<TS
512	E-50A	C	93	76	19	VS4	0.03	0	<TS
513	E-50A	C	113	76	18	VS6	0.86	0	<TS
514	E-50A	C	127	76	17	VS1	-0.91	0	<TS
515	E-50A	C	133	76	18	VS1	-0.95	0	<TS
516	E-50A	C	133	76	28	VS1	0.86	0	<TS
517	E-50A	C	133	76	18	VS4	0.2	0	<TS
518	E-50A	C	133	76	25	VS4	0.69	0	<TS
519	E-50A	C	133	76	15	VS6	-0.68	0	<TS
520	E-50A	C	133	76	28	VS6	0.98	0	<TS
521	E-50A	C	135	76	18	DBC	1.88	0	<TS
522	E-50A	C	137	76	28	VS4	-0.81	0	<TS
523	E-50A	C	137	76	23	VS4	-0.26	0	<TS
524	E-50A	C	80	77	20	04H	0.99	0	<TS
525	E-50A	C	94	77	16	VS2	-0.46	0	<TS
526	E-50A	C	94	77	27	VS2	0.79	0	<TS
527	E-50A	C	120	77	10	07C	0.17	0	<TS
528	E-50A	C	126	77	16	VS1	0.92	0	<TS
529	E-50A	C	128	77	18	07C	0.97	0	<TS
530	E-50A	C	136	77	25	DBC	1.86	0	<TS
531	E-50A	C	71	78	12	VS4	-0.64	0	<TS
532	E-50A	C	71	78	10	VS4	0.89	0	<TS
533	E-50A	C	71	78	17	06C	-1.01	0	<TS
534	E-50A	C	89	78	11	07H	-0.88	0	<TS
535	E-50A	C	89	78	19	07H	0.88	0	<TS
536	E-50A	C	115	78	21	06H	-0.72	0	<TS
537	E-50A	C	135	78	15	VS1	0.95	0	<TS
538	E-50A	C	135	78	33	VS6	0.83	0	<TS
539	E-50A	C	135	78	21	08C	-1.02	0	<TS
540	E-50A	C	135	78	10	08C	0.84	0	<TS
541	E-50A	C	137	78	19	VS4	-0.67	0	<TS
542	E-50A	C	137	78	20	VS4	1.03	0	<TS
543	E-50A	C	137	78	14	VS7	0.78	0	<TS
544	E-50A	C	82	79	16	07C	0.71	0	<TS
545	E-50A	C	110	79	18	06C	-0.22	0	<TS
546	E-50A	C	136	79	13	08C	-0.99	0	<TS
547	E-50A	C	136	79	10	07C	-0.82	0	<TS
548	E-50A	C	136	79	29	07C	-0.11	0	<TS
549	E-50A	C	138	79	11	08H	0.03	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
550	E-50A	C	138	79	14	08H	0.87	0	<TS
551	E-50A	C	138	79	15	VS1	-0.86	0	<TS
552	E-50A	C	138	79	18	VS1	0.95	0	<TS
553	E-50A	C	138	79	16	VS6	-0.9	0	<TS
554	E-50A	C	53	80	10	03H	-0.94	0	<TS
555	E-50A	C	53	80	13	03H	0.97	0	<TS
556	E-50A	C	55	80	13	02H	0.94	0	<TS
557	E-50A	C	91	80	16	05C	0.96	0	<TS
558	E-50A	C	127	80	15	VS7	0.63	0	<TS
559	E-50A	C	127	80	18	06C	0.91	0	<TS
560	E-50A	C	137	80	19	VS6	-0.97	0	<TS
561	E-50A	C	137	80	17	VS7	0.23	0	<TS
562	E-50A	C	137	80	26	VS7	0.82	0	<TS
563	E-50A	C	68	81	7	03H	-0.85	0	<TS
564	E-50A	C	68	81	17	03H	1.07	0	<TS
565	E-50A	C	70	81	17	DBC	1.55	0	<TS
566	E-50A	C	116	81	15	VS6	-0.85	0	<TS
567	E-50A	C	120	81	20	07C	0.17	0	<TS
568	E-50A	C	120	81	19	07C	0.96	0	<TS
569	E-50A	C	120	81	16	06C	1.03	0	<TS
570	E-50A	C	122	81	22	VS4	1.12	0	<TS
571	E-50A	C	138	81	28	DBH	1.88	0	<TS
572	E-50A	C	138	81	13	VS1	-0.93	0	<TS
573	E-50A	C	138	81	8	VS1	0.99	0	<TS
574	E-50A	C	138	81	21	VS4	0.94	0	<TS
575	E-50A	C	138	81	36	VS6	-0.95	0	<TS
576	E-50A	C	138	81	28	VS6	0.84	0	<TS
577	E-50A	C	138	81	18	VS7	0.06	0	<TS
578	E-50A	C	138	81	19	VS7	0.75	0	<TS
579	E-50A	C	138	81	18	08C	-0.93	0	<TS
580	E-50A	C	63	82	21	03H	1.05	0	<TS
581	E-50A	C	63	82	11	06H	1.12	0	<TS
582	E-50A	C	75	82	14	03H	1.09	0	<TS
583	E-50A	C	79	82	18	03H	1.04	0	<TS
584	E-50A	C	87	82	18	05H	0.9	0	<TS
585	E-50A	C	103	82	12	05H	-0.77	0	<TS
586	E-50A	C	103	82	19	05H	-0.16	0	<TS
587	E-50A	C	103	82	10	06H	0.08	0	<TS
588	E-50A	C	103	82	17	06H	0.88	0	<TS
589	E-50A	C	117	82	14	05H	-0.89	0	<TS
590	E-50A	C	121	82	17	VS4	-0.46	0	<TS
591	E-50A	C	135	82	18	08H	0.84	0	<TS
592	E-50A	C	54	83	21	03H	0.99	0	<TS
593	E-50A	C	54	83	13	04H	-0.11	0	<TS
594	E-50A	C	64	83	11	03H	1.1	0	<TS
595	E-50A	C	66	83	13	06C	0.9	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
596	E-50A	C	88	83	15	04H	-0.7	0	<TS
597	E-50A	C	88	83	15	05H	-0.71	0	<TS
598	E-50A	C	92	83	14	05C	0.72	0	<TS
599	E-50A	C	126	83	15	07H	0.06	0	<TS
600	E-50A	C	138	83	15	08H	-1.12	0	<TS
601	E-50A	C	138	83	9	08H	-0.16	0	<TS
602	E-50A	C	138	83	23	DBH	2.24	0	<TS
603	E-50A	C	138	83	14	VS1	-0.42	0	<TS
604	E-50A	C	63	84	11	DBH	-1.68	0	<TS
605	E-50A	C	81	84	29	VS4	0.98	0	<TS
606	E-50A	C	81	84	21	07C	-0.27	0	<TS
607	E-50A	C	133	84	18	08H	-0.03	0	<TS
608	E-50A	C	58	85	16	03H	1.06	0	<TS
609	E-50A	C	70	85	16	03H	0.94	0	<TS
610	E-50A	C	72	85	13	05C	0	0	<TS
611	E-50A	C	84	85	12	04H	-0.99	0	<TS
612	E-50A	C	84	85	18	04H	0.89	0	<TS
613	E-50A	C	92	85	16	VS6	1.07	0	<TS
614	E-50A	C	98	85	16	06C	0.7	0	<TS
615	E-50A	C	128	85	17	DBH	1.89	0	<TS
616	E-50A	C	136	85	17	08H	-1.07	0	<TS
617	E-50A	C	138	85	16	08H	-1.07	0	<TS
618	E-50A	C	138	85	21	VS7	0.87	0	<TS
619	E-50A	C	138	85	16	DBC	-1.66	0	<TS
620	E-50A	C	138	85	15	08C	-0.11	0	<TS
621	E-50A	C	138	85	11	08C	0.68	0	<TS
622	E-50A	C	63	86	16	03C	-1.08	0	<TS
623	E-50A	C	63	86	14	02C	-0.97	0	<TS
624	E-50A	C	69	86	17	06C	0.86	0	<TS
625	E-50A	C	91	86	14	05H	0.11	0	<TS
626	E-50A	C	103	86	16	VS2	0.22	0	<TS
627	E-50A	C	103	86	18	VS2	0.69	0	<TS
628	E-50A	C	135	86	18	VS4	0.92	0	<TS
629	E-50A	C	135	86	18	DBC	-1.18	0	<TS
630	E-50A	C	96	87	15	05H	0.91	0	<TS
631	E-50A	C	96	87	19	05C	1.07	0	<TS
632	E-50A	C	98	87	12	06C	-0.87	0	<TS
633	E-50A	C	98	87	24	06C	0.87	0	<TS
634	E-50A	C	104	87	24	04C	-0.75	0	<TS
635	E-50A	C	138	87	15	08C	0.84	0	<TS
636	E-50A	C	53	88	14	03C	-0.91	0	<TS
637	E-50A	C	55	88	15	02C	-0.91	0	<TS
638	E-50A	C	83	88	7	04C	-0.39	0	<TS
639	E-50A	C	83	88	19	04C	0.82	0	<TS
640	E-50A	C	137	88	16	VS4	-0.75	0	<TS
641	E-50A	C	137	88	14	VS6	-0.69	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
642	E-50A	C	137	88	18	VS6	-0.12	0	<TS
643	E-50A	C	92	89	20	04C	0.65	0	<TS
644	E-50A	C	102	89	19	04C	0.65	0	<TS
645	E-50A	C	112	89	16	VS4	-0.86	0	<TS
646	E-50A	C	116	89	21	VS1	0.94	0	<TS
647	E-50A	C	116	89	31	VS4	-1.2	0	<TS
648	E-50A	C	116	89	35	VS4	-0.91	0	<TS
649	E-50A	C	116	89	35	VS6	0.97	0	<TS
650	E-50A	C	130	89	13	DBC	-1.72	0	<TS
651	E-50A	C	134	89	13	DBC	-1.98	0	<TS
652	E-50A	C	51	90	15	04C	-0.14	0	<TS
653	E-50A	C	59	90	13	02C	-0.99	0	<TS
654	E-50A	C	65	90	14	02C	0.89	0	<TS
655	E-50A	C	79	90	11	04C	-1.01	0	<TS
656	E-50A	C	79	90	19	04C	-0.21	0	<TS
657	E-50A	C	91	90	22	03C	0.67	0	<TS
658	E-50A	C	97	90	24	VS6	-0.62	0	<TS
659	E-50A	C	105	90	19	05C	0.96	0	<TS
660	E-50A	C	115	90	16	VS2	-1.02	0	<TS
661	E-50A	C	115	90	39	VS4	-0.74	0	<TS
662	E-50A	C	135	90	20	08C	0.82	0	<TS
663	E-50A	C	76	91	16	02C	0.7	0	<TS
664	E-50A	C	132	91	20	DBC	-1.71	0	<TS
665	E-50A	C	134	91	20	VS6	-0.45	0	<TS
666	E-50A	C	134	91	26	VS7	-0.9	0	<TS
667	E-50A	C	134	91	30	DBC	1.96	0	<TS
668	E-50A	C	136	91	20	08C	-0.89	0	<TS
669	E-50A	C	136	91	26	08C	0.92	0	<TS
670	E-50A	C	136	91	20	07C	-0.84	0	<TS
671	E-50A	C	136	91	20	06C	-1.06	0	<TS
672	E-50A	C	51	92	6	02C	-0.38	0	<TS
673	E-50A	C	51	92	16	02C	0.94	0	<TS
674	E-50A	C	53	92	19	03C	0.93	0	<TS
675	E-50A	C	77	92	16	02C	-1.02	0	<TS
676	E-50A	C	87	92	20	04C	0.68	0	<TS
677	E-50A	C	115	92	27	VS1	0.75	0	<TS
678	E-50A	C	133	92	24	VS6	0.89	0	<TS
679	E-50A	C	137	92	33	VS6	-0.77	0	<TS
680	E-50A	C	137	92	25	VS6	-0.14	0	<TS
681	E-50A	C	137	92	17	VS6	0.94	0	<TS
682	E-50A	C	137	92	18	08C	-0.84	0	<TS
683	E-50A	C	137	92	25	08C	0.9	0	<TS
684	E-50A	C	137	92	16	07C	-0.91	0	<TS
685	E-50A	C	137	92	29	05C	0.03	0	<TS
686	E-50A	C	137	92	15	04C	0.77	0	<TS
687	E-50A	C	137	92	18	02C	0.79	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
688	E-50A	C	54	93	15	02C	0.91	0	<TS
689	E-50A	C	90	93	21	03C	0.62	0	<TS
690	E-50A	C	132	93	28	VS2	0.73	0	<TS
691	E-50A	C	53	94	14	03C	0.09	0	<TS
692	E-50A	C	79	94	11	03C	-1.1	0	<TS
693	E-50A	C	91	94	14	05H	0	0	<TS
694	E-50A	C	129	94	18	VS4	0.86	0	<TS
695	E-50A	C	131	94	15	08H	-0.77	0	<TS
696	E-50A	C	131	94	19	08H	1.04	0	<TS
697	E-50A	C	133	94	19	VS2	0.89	0	<TS
698	E-50A	C	135	94	16	VS6	-0.67	0	<TS
699	E-50A	C	135	94	23	VS6	0.97	0	<TS
700	E-50A	C	135	94	25	VS7	-0.33	0	<TS
701	E-50A	C	135	94	27	DBC	-1.19	0	<TS
702	E-50A	C	90	95	21	06C	0.72	0	<TS
703	E-50A	C	90	95	19	04C	0.69	0	<TS
704	E-50A	C	94	95	18	07C	-0.9	0	<TS
705	E-50A	C	130	95	24	VS4	-1.03	0	<TS
706	E-50A	C	132	95	31	VS7	0.92	0	<TS
707	E-50A	C	134	95	20	VS2	0.06	0	<TS
708	E-50A	C	134	95	28	VS4	-0.89	0	<TS
709	E-50A	C	134	95	9	VS4	1.16	0	<TS
710	E-50A	C	134	95	31	VS6	1	0	<TS
711	E-50A	C	134	95	28	VS7	0.86	0	<TS
712	E-50A	C	49	96	16	03C	0.98	0	<TS
713	E-50A	C	55	96	11	02C	-0.18	0	<TS
714	E-50A	C	107	96	18	02H	0.87	0	<TS
715	E-50A	C	131	96	22	06C	0.71	0	<TS
716	E-50A	C	135	96	38	VS6	1.03	0	<TS
717	E-50A	C	135	96	14	VS7	-0.49	0	<TS
718	E-50A	C	135	96	18	VS7	1.1	0	<TS
719	E-50A	C	48	97	29	VS4	0.8	0	<TS
720	E-50A	C	52	97	16	02C	-0.95	0	<TS
721	E-50A	C	76	97	12	04C	0.81	0	<TS
722	E-50A	C	86	97	23	03H	0.98	0	<TS
723	E-50A	C	96	97	13	05C	0.84	0	<TS
724	E-50A	C	104	97	22	04C	-1.06	0	<TS
725	E-50A	C	118	97	19	VS2	-0.85	0	<TS
726	E-50A	C	132	97	11	08C	0.12	0	<TS
727	E-50A	C	107	98	12	04C	-0.17	0	<TS
728	E-50A	C	109	98	30	VS2	-0.85	0	<TS
729	E-50A	C	80	99	11	07C	1	0	<TS
730	E-50A	C	84	99	20	VS2	-0.91	0	<TS
731	E-50A	C	92	99	7	07H	-0.87	0	<TS
732	E-50A	C	104	99	17	06C	0.75	0	<TS
733	E-50A	C	118	99	15	VS2	0.88	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
734	E-50A	C	130	99	12	03C	-0.95	0	<TS
735	E-50A	C	130	99	25	03C	-0.17	0	<TS
736	E-50A	C	132	99	15	DBC	1.71	0	<TS
737	E-50A	C	132	99	12	06C	0.94	0	<TS
738	E-50A	C	134	99	17	04C	-1.01	0	<TS
739	E-50A	C	75	100	10	03H	-1.02	0	<TS
740	E-50A	C	75	100	17	03H	1.08	0	<TS
741	E-50A	C	77	100	19	05H	-0.05	0	<TS
742	E-50A	C	79	100	14	03H	1.15	0	<TS
743	E-50A	C	79	100	11	05H	1.11	0	<TS
744	E-50A	C	81	100	14	05H	0.96	0	<TS
745	E-50A	C	83	100	22	04H	0.93	0	<TS
746	E-50A	C	87	100	18	04H	1.01	0	<TS
747	E-50A	C	93	100	18	VS2	-0.7	0	<TS
748	E-50A	C	103	100	14	05C	-1.01	0	<TS
749	E-50A	C	135	100	20	VS6	-0.78	0	<TS
750	E-50A	C	135	100	32	VS7	-0.49	0	<TS
751	E-50A	C	135	100	11	DBC	-1.75	0	<TS
752	E-50A	C	135	100	20	DBC	1.63	0	<TS
753	E-50A	C	135	100	15	04C	-0.99	0	<TS
754	E-50A	C	135	100	20	02C	0.9	0	<TS
755	E-50A	C	76	101	17	02H	-0.73	0	<TS
756	E-50A	C	86	101	19	04H	-0.78	0	<TS
757	E-50A	C	90	101	17	02C	0.17	0	<TS
758	E-50A	C	92	101	17	VS2	-0.78	0	<TS
759	E-50A	C	92	101	16	VS2	0.94	0	<TS
760	E-50A	C	94	101	23	04C	-1.01	0	<TS
761	E-50A	C	106	101	19	04H	1.01	0	<TS
762	E-50A	C	118	101	14	04H	0.03	0	<TS
763	E-50A	C	118	101	14	VS4	0.93	0	<TS
764	E-50A	C	128	101	17	VS2	-0.72	0	<TS
765	E-50A	C	51	102	5	03C	-0.29	0	<TS
766	E-50A	C	51	102	16	03C	0.87	0	<TS
767	E-50A	C	69	102	15	04H	0.86	0	<TS
768	E-50A	C	81	102	19	07C	-1.07	0	<TS
769	E-50A	C	81	102	12	07C	-0.14	0	<TS
770	E-50A	C	83	102	18	05C	-0.28	0	<TS
771	E-50A	C	87	102	22	05H	0.98	0	<TS
772	E-50A	C	103	102	16	03C	-0.2	0	<TS
773	E-50A	C	105	102	15	VS6	0.8	0	<TS
774	E-50A	C	96	103	14	05C	0.93	0	<TS
775	E-50A	C	98	103	18	06C	-0.86	0	<TS
776	E-50A	C	98	103	20	04C	-0.99	0	<TS
777	E-50A	C	98	103	14	04C	0.9	0	<TS
778	E-50A	C	100	103	20	02C	0.88	0	<TS
779	E-50A	C	104	103	12	DBC	-1.45	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
780	E-50A	C	112	103	5	04H	0.13	0	<TS
781	E-50A	C	112	103	16	04H	0.97	0	<TS
782	E-50A	C	112	103	13	VS2	-0.59	0	<TS
783	E-50A	C	126	103	9	VS2	0.88	0	<TS
784	E-50A	C	126	103	32	VS4	-1	0	<TS
785	E-50A	C	128	103	12	VS2	1	0	<TS
786	E-50A	C	134	103	16	DBC	-1.67	0	<TS
787	E-50A	C	134	103	16	02C	-0.94	0	<TS
788	E-50A	C	39	104	12	04H	0.87	0	<TS
789	E-50A	C	39	104	15	03C	-0.63	0	<TS
790	E-50A	C	53	104	15	03C	0.91	0	<TS
791	E-50A	C	63	104	13	04C	-0.14	0	<TS
792	E-50A	C	63	104	18	03C	0.99	0	<TS
793	E-50A	C	79	104	5	05H	-0.27	0	<TS
794	E-50A	C	79	104	14	05H	0.88	0	<TS
795	E-50A	C	87	104	11	06H	0.93	0	<TS
796	E-50A	C	93	104	33	VS4	-0.42	0	<TS
797	E-50A	C	93	104	13	VS6	-0.76	0	<TS
798	E-50A	C	93	104	25	VS6	0.91	0	<TS
799	E-50A	C	99	104	17	02C	-0.85	0	<TS
800	E-50A	C	99	104	13	02C	0.14	0	<TS
801	E-50A	C	101	104	14	05C	-0.06	0	<TS
802	E-50A	C	111	104	12	04C	-0.17	0	<TS
803	E-50A	C	121	104	14	VS4	0.85	0	<TS
804	E-50A	C	121	104	14	VS6	-0.59	0	<TS
805	E-50A	C	121	104	11	VS6	0.23	0	<TS
806	E-50A	C	133	104	12	08C	-0.47	0	<TS
807	E-50A	C	133	104	13	08C	0.86	0	<TS
808	E-50A	C	133	104	14	07C	0.75	0	<TS
809	E-50A	C	133	104	14	06C	-0.17	0	<TS
810	E-50A	C	133	104	10	05C	0.03	0	<TS
811	E-50A	C	133	104	15	05C	0.87	0	<TS
812	E-50A	C	54	105	16	02C	0.94	0	<TS
813	E-50A	C	90	105	22	05C	0.95	0	<TS
814	E-50A	C	96	105	17	VS6	-0.94	0	<TS
815	E-50A	C	98	105	20	05C	-1.02	0	<TS
816	E-50A	C	98	105	22	04C	0.91	0	<TS
817	E-50A	C	116	105	26	VS4	-1.11	0	<TS
818	E-50A	C	122	105	14	04C	0	0	<TS
819	E-50A	C	37	106	21	03C	-0.96	0	<TS
820	E-50A	C	43	106	17	03C	0.73	0	<TS
821	E-50A	C	55	106	11	06H	1.03	0	<TS
822	E-50A	C	59	106	17	02C	0.78	0	<TS
823	E-50A	C	65	106	19	04C	0.88	0	<TS
824	E-50A	C	65	106	14	03C	0.96	0	<TS
825	E-50A	C	65	106	16	02C	0.85	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
826	E-50A	C	67	106	15	05C	0.95	0	<TS
827	E-50A	C	69	106	13	VS5	1.19	0	<TS
828	E-50A	C	93	106	22	VS2	-0.46	0	<TS
829	E-50A	C	97	106	24	VS4	-0.83	0	<TS
830	E-50A	C	97	106	16	VS4	0.91	0	<TS
831	E-50A	C	101	106	16	04C	0.85	0	<TS
832	E-50A	C	127	106	17	VS4	-0.61	0	<TS
833	E-50A	C	66	107	19	03H	0.03	0	<TS
834	E-50A	C	66	107	15	02C	-0.97	0	<TS
835	E-50A	C	68	107	12	03H	-0.21	0	<TS
836	E-50A	C	70	107	16	04C	-0.93	0	<TS
837	E-50A	C	80	107	22	DBH	1.77	0	<TS
838	E-50A	C	90	107	13	05C	0.19	0	<TS
839	E-50A	C	90	107	18	05C	0.76	0	<TS
840	E-50A	C	100	107	15	VS4	-0.88	0	<TS
841	E-50A	C	100	107	9	VS4	1.06	0	<TS
842	E-50A	C	100	107	7	04C	-0.19	0	<TS
843	E-50A	C	100	107	15	04C	0.95	0	<TS
844	E-50A	C	124	107	15	VS2	-0.59	0	<TS
845	E-50A	C	128	107	17	03C	0.78	0	<TS
846	E-50A	C	128	107	16	02C	0.98	0	<TS
847	E-50A	C	130	107	17	03C	-0.3	0	<TS
848	E-50A	C	130	107	20	02C	0.81	0	<TS
849	E-50A	C	132	107	15	03C	-0.97	0	<TS
850	E-50A	C	132	107	14	03C	0.75	0	<TS
851	E-50A	C	41	108	15	03C	0.89	0	<TS
852	E-50A	C	45	108	21	03C	0.98	0	<TS
853	E-50A	C	65	108	17	03H	-0.88	0	<TS
854	E-50A	C	69	108	16	04H	0.94	0	<TS
855	E-50A	C	71	108	15	05C	0.95	0	<TS
856	E-50A	C	71	108	15	04C	0.08	0	<TS
857	E-50A	C	71	108	17	02C	-0.14	0	<TS
858	E-50A	C	89	108	25	06H	0.93	0	<TS
859	E-50A	C	103	108	18	07C	-0.22	0	<TS
860	E-50A	C	103	108	8	07C	0.71	0	<TS
861	E-50A	C	127	108	18	05C	-0.9	0	<TS
862	E-50A	C	129	108	15	08C	0.8	0	<TS
863	E-50A	C	44	109	17	DBH	-2.19	0	<TS
864	E-50A	C	44	109	18	03C	0.03	0	<TS
865	E-50A	C	66	109	14	03H	-0.83	0	<TS
866	E-50A	C	66	109	15	04C	0.11	0	<TS
867	E-50A	C	66	109	15	04C	0.94	0	<TS
868	E-50A	C	66	109	20	02C	0.97	0	<TS
869	E-50A	C	92	109	13	05C	-0.91	0	<TS
870	E-50A	C	98	109	17	05C	1	0	<TS
871	E-50A	C	104	109	18	VS6	-0.71	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
872	E-50A	C	110	109	14	05C	0.82	0	<TS
873	E-50A	C	126	109	11	05C	0	0	<TS
874	E-50A	C	126	109	16	05C	0.9	0	<TS
875	E-50A	C	126	109	14	03C	0.15	0	<TS
876	E-50A	C	47	110	18	VS4	-0.72	0	<TS
877	E-50A	C	57	110	11	02C	-0.2	0	<TS
878	E-50A	C	57	110	16	02C	0.85	0	<TS
879	E-50A	C	71	110	15	04H	0.88	0	<TS
880	E-50A	C	95	110	14	02C	-0.88	0	<TS
881	E-50A	C	101	110	15	VS2	0.17	0	<TS
882	E-50A	C	101	110	18	VS2	0.76	0	<TS
883	E-50A	C	111	110	17	VS4	-0.86	0	<TS
884	E-50A	C	117	110	14	03C	1.02	0	<TS
885	E-50A	C	119	110	20	04C	-0.93	0	<TS
886	E-50A	C	123	110	12	VS2	0.99	0	<TS
887	E-50A	C	125	110	22	03C	1.02	0	<TS
888	E-50A	C	127	110	28	VS2	-0.93	0	<TS
889	E-50A	C	127	110	17	VS2	1.12	0	<TS
890	E-50A	C	127	110	13	VS4	-0.9	0	<TS
891	E-50A	C	127	110	13	VS4	-0.2	0	<TS
892	E-50A	C	129	110	19	04C	0.03	0	<TS
893	E-50A	C	129	110	25	02C	0.88	0	<TS
894	E-50A	C	46	111	8	02C	-0.99	0	<TS
895	E-50A	C	46	111	14	02C	0.93	0	<TS
896	E-50A	C	48	111	15	02C	0.94	0	<TS
897	E-50A	C	52	111	21	02C	0.88	0	<TS
898	E-50A	C	76	111	13	05C	0.9	0	<TS
899	E-50A	C	76	111	17	04C	0.82	0	<TS
900	E-50A	C	86	111	18	05C	0.78	0	<TS
901	E-50A	C	96	111	21	05C	0.84	0	<TS
902	E-50A	C	96	111	15	04C	0.16	0	<TS
903	E-50A	C	96	111	16	04C	0.82	0	<TS
904	E-50A	C	98	111	16	07H	0.18	0	<TS
905	E-50A	C	98	111	11	VS2	-0.18	0	<TS
906	E-50A	C	98	111	17	VS2	0.51	0	<TS
907	E-50A	C	106	111	18	DBC	1.59	0	<TS
908	E-50A	C	122	111	17	05C	-0.93	0	<TS
909	E-50A	C	126	111	13	VS6	-0.87	0	<TS
910	E-50A	C	126	111	18	VS7	0.82	0	<TS
911	E-50A	C	126	111	13	07C	0.76	0	<TS
912	E-50A	C	126	111	15	03C	-0.95	0	<TS
913	E-50A	C	126	111	13	02C	-1.06	0	<TS
914	E-50A	C	128	111	19	05C	0.7	0	<TS
915	E-50A	C	49	112	22	VS4	-0.73	0	<TS
916	E-50A	C	83	112	18	02C	-0.27	0	<TS
917	E-50A	C	89	112	16	05H	-0.94	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
918	E-50A	C	89	112	16	05H	0.23	0	<TS
919	E-50A	C	89	112	16	05H	0.83	0	<TS
920	E-50A	C	99	112	20	04C	0.71	0	<TS
921	E-50A	C	105	112	21	05H	1.02	0	<TS
922	E-50A	C	123	112	16	03C	0.72	0	<TS
923	E-50A	C	125	112	23	07H	-0.1	0	<TS
924	E-50A	C	125	112	12	04C	-1.11	0	<TS
925	E-50A	C	125	112	19	03C	-0.05	0	<TS
926	E-50A	C	127	112	28	03C	-1.09	0	<TS
927	E-50A	C	66	113	16	03H	0.81	0	<TS
928	E-50A	C	66	113	14	02C	0.85	0	<TS
929	E-50A	C	78	113	20	02C	0.85	0	<TS
930	E-50A	C	126	113	27	VS4	-0.67	0	<TS
931	E-50A	C	126	113	31	VS4	0	0	<TS
932	E-50A	C	126	113	17	VS6	0	0	<TS
933	E-50A	C	126	113	24	VS6	1.13	0	<TS
934	E-50A	C	55	114	15	02C	0.88	0	<TS
935	E-50A	C	67	114	25	02C	0.99	0	<TS
936	E-50A	C	77	114	16	04H	0.94	0	<TS
937	E-50A	C	91	114	18	VS2	-0.76	0	<TS
938	E-50A	C	97	114	16	VS4	-0.83	0	<TS
939	E-50A	C	38	115	6	02C	-1.13	0	<TS
940	E-50A	C	38	115	14	02C	0.91	0	<TS
941	E-50A	C	56	115	19	02C	0.85	0	<TS
942	E-50A	C	90	115	19	VS2	-0.89	0	<TS
943	E-50A	C	90	115	18	VS6	-0.63	0	<TS
944	E-50A	C	100	115	17	05H	-0.75	0	<TS
945	E-50A	C	102	115	19	VS2	-0.72	0	<TS
946	E-50A	C	102	115	21	VS2	-0.08	0	<TS
947	E-50A	C	108	115	18	05H	0.97	0	<TS
948	E-50A	C	120	115	16	04C	0.69	0	<TS
949	E-50A	C	126	115	15	05H	0.99	0	<TS
950	E-50A	C	126	115	17	VS6	-0.89	0	<TS
951	E-50A	C	126	115	20	04C	0.69	0	<TS
952	E-50A	C	126	115	21	02C	-1.03	0	<TS
953	E-50A	C	126	115	12	02C	0.03	0	<TS
954	E-50A	C	37	116	18	03C	0.9	0	<TS
955	E-50A	C	65	116	15	VS3	0.87	0	<TS
956	E-50A	C	87	116	21	04C	0.79	0	<TS
957	E-50A	C	87	116	7	03C	-0.85	0	<TS
958	E-50A	C	87	116	16	03C	-0.06	0	<TS
959	E-50A	C	91	116	28	VS2	-0.98	0	<TS
960	E-50A	C	93	116	10	04H	0.99	0	<TS
961	E-50A	C	97	116	21	VS4	-0.88	0	<TS
962	E-50A	C	97	116	21	05C	0.73	0	<TS
963	E-50A	C	109	116	18	04H	-0.66	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
964	E-50A	C	111	116	17	03C	0.84	0	<TS
965	E-50A	C	121	116	21	03C	0.59	0	<TS
966	E-50A	C	52	117	23	02C	0.85	0	<TS
967	E-50A	C	102	117	21	03H	0.97	0	<TS
968	E-50A	C	106	117	16	06C	-1.17	0	<TS
969	E-50A	C	108	117	15	05C	0.97	0	<TS
970	E-50A	C	120	117	15	04C	0.66	0	<TS
971	E-50A	C	122	117	13	VS1	1	0	<TS
972	E-50A	C	124	117	16	03C	0.09	0	<TS
973	E-50A	C	51	118	18	02C	-0.88	0	<TS
974	E-50A	C	53	118	16	02C	0.82	0	<TS
975	E-50A	C	59	118	11	02C	-0.14	0	<TS
976	E-50A	C	59	118	14	02C	0.91	0	<TS
977	E-50A	C	63	118	20	03C	0.89	0	<TS
978	E-50A	C	67	118	17	03C	0.76	0	<TS
979	E-50A	C	97	118	24	VS4	0.65	0	<TS
980	E-50A	C	109	118	17	04C	-0.9	0	<TS
981	E-50A	C	113	118	17	04C	0.08	0	<TS
982	E-50A	C	121	118	32	VS4	-0.8	0	<TS
983	E-50A	C	121	118	29	03C	0.96	0	<TS
984	E-50A	C	54	119	15	02C	0.93	0	<TS
985	E-50A	C	60	119	23	02C	0.93	0	<TS
986	E-50A	C	100	119	24	VS2	-0.63	0	<TS
987	E-50A	C	100	119	27	VS2	0.05	0	<TS
988	E-50A	C	100	119	13	VS2	0.79	0	<TS
989	E-50A	C	100	119	18	VS4	-0.9	0	<TS
990	E-50A	C	100	119	16	VS6	0.84	0	<TS
991	E-50A	C	102	119	21	04H	0.88	0	<TS
992	E-50A	C	106	119	13	VS4	0.9	0	<TS
993	E-50A	C	114	119	14	07C	0.71	0	<TS
994	E-50A	C	114	119	13	03C	0.67	0	<TS
995	E-50A	C	116	119	22	03C	0.72	0	<TS
996	E-50A	C	120	119	25	03C	0.7	0	<TS
997	E-50A	C	124	119	12	02C	-0.92	0	<TS
998	E-50A	C	39	120	21	04H	0.86	0	<TS
999	E-50A	C	55	120	15	02C	-0.3	0	<TS
1000	E-50A	C	67	120	13	06H	-0.13	0	<TS
1001	E-50A	C	67	120	18	VS5	0.69	0	<TS
1002	E-50A	C	75	120	18	03C	0.85	0	<TS
1003	E-50A	C	79	120	13	04H	0.89	0	<TS
1004	E-50A	C	87	120	18	VS2	0.11	0	<TS
1005	E-50A	C	87	120	20	VS2	0.96	0	<TS
1006	E-50A	C	97	120	16	VS2	-0.83	0	<TS
1007	E-50A	C	97	120	29	VS2	0.91	0	<TS
1008	E-50A	C	101	120	13	03C	0.71	0	<TS
1009	E-50A	C	107	120	17	DBH	1.98	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
1010	E-50A	C	109	120	23	03C	-0.24	0	<TS
1011	E-50A	C	117	120	14	03H	1.03	0	<TS
1012	E-50A	C	117	120	15	02C	0.68	0	<TS
1013	E-50A	C	121	120	15	06H	0.81	0	<TS
1014	E-50A	C	26	121	19	VS4	-0.63	0	<TS
1015	E-50A	C	26	121	6	VS4	-0.12	0	<TS
1016	E-50A	C	60	121	22	02C	0.79	0	<TS
1017	E-50A	C	62	121	15	02C	0.91	0	<TS
1018	E-50A	C	74	121	13	03H	-0.83	0	<TS
1019	E-50A	C	82	121	11	05H	0.86	0	<TS
1020	E-50A	C	96	121	18	VS6	1.14	0	<TS
1021	E-50A	C	102	121	24	VS4	-0.62	0	<TS
1022	E-50A	C	106	121	15	05C	0.03	0	<TS
1023	E-50A	C	106	121	10	04C	0.03	0	<TS
1024	E-50A	C	106	121	19	04C	0.93	0	<TS
1025	E-50A	C	116	121	7	04C	0	0	<TS
1026	E-50A	C	116	121	25	04C	0.99	0	<TS
1027	E-50A	C	120	121	25	05C	0.91	0	<TS
1028	E-50A	C	45	122	17	03C	-0.91	0	<TS
1029	E-50A	C	47	122	26	VS4	0	0	<TS
1030	E-50A	C	47	122	30	VS4	0.9	0	<TS
1031	E-50A	C	49	122	12	04C	-0.88	0	<TS
1032	E-50A	C	51	122	17	02C	-0.17	0	<TS
1033	E-50A	C	53	122	13	04C	0.88	0	<TS
1034	E-50A	C	53	122	23	02C	-0.17	0	<TS
1035	E-50A	C	55	122	17	02C	-0.2	0	<TS
1036	E-50A	C	63	122	22	03C	0.87	0	<TS
1037	E-50A	C	103	122	22	DBC	1.5	0	<TS
1038	E-50A	C	103	122	13	07C	0.94	0	<TS
1039	E-50A	C	42	123	20	DBH	0.03	0	<TS
1040	E-50A	C	44	123	17	06H	0	0	<TS
1041	E-50A	C	44	123	22	VS4	-0.6	0	<TS
1042	E-50A	C	44	123	22	VS4	-0.06	0	<TS
1043	E-50A	C	44	123	15	VS4	0.81	0	<TS
1044	E-50A	C	50	123	20	04C	0.17	0	<TS
1045	E-50A	C	64	123	18	04C	0.79	0	<TS
1046	E-50A	C	104	123	18	04C	0.74	0	<TS
1047	E-50A	C	108	123	18	VS2	-0.96	0	<TS
1048	E-50A	C	110	123	16	08H	-0.83	0	<TS
1049	E-50A	C	114	123	21	03C	-1.03	0	<TS
1050	E-50A	C	116	123	18	06C	-0.11	0	<TS
1051	E-50A	C	120	123	18	01H	0.03	0	<TS
1052	E-50A	C	33	124	18	03C	0.91	0	<TS
1053	E-50A	C	45	124	24	VS4	0.87	0	<TS
1054	E-50A	C	47	124	14	VS4	-0.79	0	<TS
1055	E-50A	C	47	124	23	VS4	0.03	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
1056	E-50A	C	47	124	24	VS4	0.76	0	<TS
1057	E-50A	C	63	124	12	04C	-0.09	0	<TS
1058	E-50A	C	63	124	17	04C	0.88	0	<TS
1059	E-50A	C	87	124	14	04C	-0.94	0	<TS
1060	E-50A	C	95	124	19	VS2	-0.8	0	<TS
1061	E-50A	C	95	124	20	VS2	0.77	0	<TS
1062	E-50A	C	107	124	17	VS2	-0.08	0	<TS
1063	E-50A	C	119	124	15	VS4	-0.81	0	<TS
1064	E-50A	C	119	124	9	VS4	0.6	0	<TS
1065	E-50A	C	46	125	14	VS4	-0.11	0	<TS
1066	E-50A	C	46	125	14	VS4	0.22	0	<TS
1067	E-50A	C	46	125	15	VS4	0.81	0	<TS
1068	E-50A	C	48	125	25	02C	0.08	0	<TS
1069	E-50A	C	92	125	12	03H	0.87	0	<TS
1070	E-50A	C	110	125	20	VS2	0.71	0	<TS
1071	E-50A	C	118	125	20	VS7	-0.88	0	<TS
1072	E-50A	C	31	126	20	VS4	-0.45	0	<TS
1073	E-50A	C	39	126	20	03C	0.85	0	<TS
1074	E-50A	C	43	126	30	VS4	0.93	0	<TS
1075	E-50A	C	43	126	15	DBC	1.52	0	<TS
1076	E-50A	C	47	126	25	VS4	-0.74	0	<TS
1077	E-50A	C	47	126	25	VS4	0.03	0	<TS
1078	E-50A	C	47	126	14	04C	0.11	0	<TS
1079	E-50A	C	51	126	19	02C	0.09	0	<TS
1080	E-50A	C	51	126	13	02C	0.79	0	<TS
1081	E-50A	C	59	126	11	06H	0.85	0	<TS
1082	E-50A	C	63	126	17	04C	0.76	0	<TS
1083	E-50A	C	71	126	11	05C	0.11	0	<TS
1084	E-50A	C	71	126	21	05C	0.71	0	<TS
1085	E-50A	C	97	126	15	VS4	0.17	0	<TS
1086	E-50A	C	111	126	17	04C	0.94	0	<TS
1087	E-50A	C	2	127	22	05C	0.74	0	<TS
1088	E-50A	H	2	127	14	DBH	0.57	0	<TS
1089	E-50A	C	38	127	17	03H	0.93	0	<TS
1090	E-50A	C	44	127	17	03C	-0.34	0	<TS
1091	E-50A	C	50	127	13	03C	-0.82	0	<TS
1092	E-50A	C	50	127	9	03C	0.17	0	<TS
1093	E-50A	C	52	127	13	VS5	-1.11	0	<TS
1094	E-50A	C	58	127	9	04C	0.09	0	<TS
1095	E-50A	C	58	127	24	04C	0.88	0	<TS
1096	E-50A	C	72	127	20	04C	0.81	0	<TS
1097	E-50A	C	98	127	21	07H	1.01	0	<TS
1098	E-50A	C	31	128	18	VS4	-0.76	0	<TS
1099	E-50A	C	31	128	23	VS4	0.96	0	<TS
1100	E-50A	C	37	128	21	VS4	0.94	0	<TS
1101	E-50A	C	45	128	14	03H	0	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
1102	E-50A	C	79	128	24	04C	0.91	0	<TS
1103	E-50A	C	89	128	14	05H	0.89	0	<TS
1104	E-50A	C	107	128	15	04C	-1.09	0	<TS
1105	E-50A	C	111	128	21	03C	-0.93	0	<TS
1106	E-50A	C	111	128	16	03C	0.83	0	<TS
1107	E-50A	C	44	129	13	03C	0.92	0	<TS
1108	E-50A	C	114	129	16	08H	-1.15	0	<TS
1109	E-50A	C	114	129	23	VS4	-0.71	0	<TS
1110	E-50A	C	39	130	12	DBC	-1.46	0	<TS
1111	E-50A	C	81	130	19	VS3	-0.68	0	<TS
1112	E-50A	C	83	130	10	VS2	0.89	0	<TS
1113	E-50A	C	93	130	12	03H	-0.69	0	<TS
1114	E-50A	C	93	130	22	VS2	-0.7	0	<TS
1115	E-50A	C	93	130	15	VS2	0.89	0	<TS
1116	E-50A	C	93	130	22	VS4	-0.93	0	<TS
1117	E-50A	C	93	130	37	VS4	1.01	0	<TS
1118	E-50A	C	95	130	13	04H	1.02	0	<TS
1119	E-50A	C	95	130	20	VS2	0.79	0	<TS
1120	E-50A	C	107	130	23	VS2	-0.76	0	<TS
1121	E-50A	C	111	130	22	04C	-0.09	0	<TS
1122	E-50A	C	113	130	21	VS4	-0.98	0	<TS
1123	E-50A	C	113	130	24	VS4	-0.58	0	<TS
1124	E-50A	C	34	131	13	05C	-0.26	0	<TS
1125	E-50A	C	44	131	14	05C	0.86	0	<TS
1126	E-50A	C	76	131	10	VS4	0.94	0	<TS
1127	E-50A	C	92	131	13	04H	0.96	0	<TS
1128	E-50A	C	96	131	22	04C	-1.1	0	<TS
1129	E-50A	C	100	131	15	05C	0.95	0	<TS
1130	E-50A	C	110	131	26	DBH	-1.77	0	<TS
1131	E-50A	C	110	131	20	03C	0.89	0	<TS
1132	E-50A	C	27	132	20	02H	0.41	0	<TS
1133	E-50A	C	31	132	14	VS4	0.88	0	<TS
1134	E-50A	C	49	132	17	02C	0.79	0	<TS
1135	E-50A	C	95	132	20	VS2	0.95	0	<TS
1136	E-50A	C	95	132	13	VS4	1.03	0	<TS
1137	E-50A	C	97	132	17	VS4	1.02	0	<TS
1138	E-50A	C	105	132	21	03C	0.85	0	<TS
1139	E-50A	C	109	132	20	04C	0.9	0	<TS
1140	E-50A	C	92	133	19	07H	0.92	0	<TS
1141	E-50A	C	92	133	23	04C	0.93	0	<TS
1142	E-50A	C	102	133	14	03C	-1.08	0	<TS
1143	E-50A	C	102	133	11	03C	0.68	0	<TS
1144	E-50A	C	104	133	14	05C	-0.28	0	<TS
1145	E-50A	C	106	133	21	DBC	1.7	0	<TS
1146	E-50A	C	108	133	17	04C	-0.95	0	<TS
1147	E-50A	C	108	133	15	04C	0.81	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
1148	E-50A	C	45	134	18	03C	0.94	0	<TS
1149	E-50A	C	63	134	14	03C	0.73	0	<TS
1150	E-50A	C	69	134	17	06C	-0.96	0	<TS
1151	E-50A	C	71	134	13	VS3	-0.66	0	<TS
1152	E-50A	C	73	134	16	06C	-0.9	0	<TS
1153	E-50A	C	95	134	25	04C	-0.91	0	<TS
1154	E-50A	C	95	134	15	03C	-1.07	0	<TS
1155	E-50A	C	97	134	11	VS2	0.92	0	<TS
1156	E-50A	C	97	134	12	VS4	-0.73	0	<TS
1157	E-50A	C	97	134	19	VS4	0.96	0	<TS
1158	E-50A	C	103	134	16	04C	0.11	0	<TS
1159	E-50A	C	103	134	15	04C	0.68	0	<TS
1160	E-50A	C	107	134	24	VS4	-0.91	0	<TS
1161	E-50A	C	107	134	16	VS4	0.79	0	<TS
1162	E-50A	C	107	134	27	02C	-1.03	0	<TS
1163	E-50A	C	48	135	21	01C	-0.11	0	<TS
1164	E-50A	C	82	135	14	VS3	-0.84	0	<TS
1165	E-50A	C	90	135	12	04H	0.95	0	<TS
1166	E-50A	C	90	135	18	04C	0.89	0	<TS
1167	E-50A	C	92	135	17	04C	0.82	0	<TS
1168	E-50A	C	98	135	14	03C	0.05	0	<TS
1169	E-50A	C	102	135	18	04C	0.76	0	<TS
1170	E-50A	C	102	135	19	03C	-0.34	0	<TS
1171	E-50A	C	104	135	27	03C	0.82	0	<TS
1172	E-50A	C	106	135	25	VS4	-0.62	0	<TS
1173	E-50A	C	67	136	20	VS3	0.86	0	<TS
1174	E-50A	C	69	136	16	VS3	-0.7	0	<TS
1175	E-50A	C	69	136	17	VS5	0.86	0	<TS
1176	E-50A	C	93	136	20	03C	-0.91	0	<TS
1177	E-50A	C	93	136	17	03C	0.85	0	<TS
1178	E-50A	C	95	136	19	VS2	-0.87	0	<TS
1179	E-50A	C	95	136	24	VS2	0.82	0	<TS
1180	E-50A	C	101	136	11	03C	-0.98	0	<TS
1181	E-50A	C	101	136	16	02C	0.05	0	<TS
1182	E-50A	C	12	137	13	02H	-0.87	0	<TS
1183	E-50A	C	56	137	17	03C	-0.03	0	<TS
1184	E-50A	C	90	137	19	06C	0.91	0	<TS
1185	E-50A	C	100	137	13	VS4	-0.67	0	<TS
1186	E-50A	C	100	137	17	05C	-0.98	0	<TS
1187	E-50A	C	100	137	16	04C	0.87	0	<TS
1188	E-50A	C	100	137	21	03C	-0.9	0	<TS
1189	E-50A	C	100	137	27	03C	-0.03	0	<TS
1190	E-50A	C	65	138	30	04C	-0.14	0	<TS
1191	E-50A	C	91	138	9	04C	-1.06	0	<TS
1192	E-50A	C	91	138	16	04C	0.82	0	<TS
1193	E-50A	C	97	138	18	02C	0.74	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
1194	E-50A	C	99	138	16	VS4	0	0	<TS
1195	E-50A	C	99	138	17	VS4	0.68	0	<TS
1196	E-50A	C	99	138	18	02C	-0.99	0	<TS
1197	E-50A	C	99	138	15	02C	0.14	0	<TS
1198	E-50A	C	101	138	21	VS4	0.74	0	<TS
1199	E-50A	C	68	139	30	VS3	-0.67	0	<TS
1200	E-50A	C	68	139	17	VS5	-0.9	0	<TS
1201	E-50A	C	68	139	35	VS5	0.84	0	<TS
1202	E-50A	C	98	139	16	02C	-0.16	0	<TS
1203	E-50A	C	100	139	19	VS4	-0.59	0	<TS
1204	E-50A	C	100	139	16	03C	-0.19	0	<TS
1205	E-50A	C	55	140	22	06C	-0.27	0	<TS
1206	E-50A	C	95	140	22	04C	0.71	0	<TS
1207	E-50A	C	99	140	26	VS4	-0.67	0	<TS
1208	E-50A	C	99	140	14	03C	-0.95	0	<TS
1209	E-50A	C	99	140	18	03C	-0.14	0	<TS
1210	E-50A	C	68	141	22	DBH	2.13	0	<TS
1211	E-50A	C	82	141	22	VS3	-0.81	0	<TS
1212	E-50A	C	84	141	22	04C	0.88	0	<TS
1213	E-50A	C	92	141	16	02C	-0.4	0	<TS
1214	E-50A	C	94	141	18	03C	0.92	0	<TS
1215	E-50A	C	63	142	16	04C	0.87	0	<TS
1216	E-50A	C	95	142	23	02C	0.6	0	<TS
1217	E-50A	C	54	143	11	04C	0.8	0	<TS
1218	E-50A	C	58	143	15	03C	0.84	0	<TS
1219	E-50A	C	72	143	20	DBC	1.87	0	<TS
1220	E-50A	C	86	143	16	03C	-1.03	0	<TS
1221	E-50A	C	90	143	21	03C	-1	0	<TS
1222	E-50A	C	90	143	14	03C	-0.08	0	<TS
1223	E-50A	C	90	143	25	02C	-1.05	0	<TS
1224	E-50A	C	90	143	22	02C	0.05	0	<TS
1225	E-50A	C	59	144	15	04C	0.82	0	<TS
1226	E-50A	C	61	144	14	DBH	1.56	0	<TS
1227	E-50A	C	79	144	15	VS5	-0.84	0	<TS
1228	E-50A	C	79	144	22	VS5	0.93	0	<TS
1229	E-50A	C	87	144	20	03C	-0.8	0	<TS
1230	E-50A	C	91	144	15	VS4	0.63	0	<TS
1231	E-50A	C	32	145	21	VS4	-0.94	0	<TS
1232	E-50A	C	70	145	14	DBC	-1.59	0	<TS
1233	E-50A	C	86	145	18	04C	0.82	0	<TS
1234	E-50A	C	88	145	20	VS4	0.79	0	<TS
1235	E-50A	C	88	145	23	04C	-1.01	0	<TS
1236	E-50A	C	88	145	32	02C	0.14	0	<TS
1237	E-50A	C	11	146	15	03C	0.86	0	<TS
1238	E-50A	C	85	146	24	03C	-0.71	0	<TS
1239	E-50A	C	87	146	19	VS4	-0.99	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
1240	E-50A	C	87	146	21	VS4	0.38	0	<TS
1241	E-50A	C	40	147	27	VS4	-0.99	0	<TS
1242	E-50A	C	40	147	23	VS4	-0.37	0	<TS
1243	E-50A	C	66	147	13	03C	-0.16	0	<TS
1244	E-50A	C	80	147	19	07H	0.82	0	<TS
1245	E-50A	C	84	147	22	VS3	0.93	0	<TS
1246	E-50A	C	77	148	17	07H	-0.94	0	<TS
1247	E-50A	C	77	148	23	03C	0.8	0	<TS
1248	E-50A	C	79	148	13	02C	1.02	0	<TS
1249	E-50A	C	81	148	20	05C	-0.06	0	<TS
1250	E-50A	C	83	148	20	03C	-0.98	0	<TS
1251	E-50A	C	8	149	18	05H	0.76	0	<TS
1252	E-50A	C	52	149	18	VS3	1.05	0	<TS
1253	E-50A	C	52	149	13	VS4	-0.93	0	<TS
1254	E-50A	C	72	149	21	DBH	1.95	0	<TS
1255	E-50A	C	80	149	17	VS4	-0.75	0	<TS
1256	E-50A	C	1	150	21	02C	0.83	0	<TS
1257	E-50A	C	1	150	14	01C	-0.4	0	<TS
1258	E-50A	C	75	150	14	04C	0.96	0	<TS
1259	E-50A	C	75	150	14	02C	0.96	0	<TS
1260	E-50A	C	77	150	17	02C	0.89	0	<TS
1261	E-50A	C	79	150	19	VS4	0.97	0	<TS
1262	E-50A	C	79	150	18	02C	-0.03	0	<TS
1263	E-50A	C	79	150	14	02C	0.74	0	<TS
1264	E-50A	C	65	152	22	VS3	0.9	0	<TS
1265	E-50A	C	69	152	24	VS3	-0.82	0	<TS
1266	E-50A	C	69	152	22	VS3	0.94	0	<TS
1267	E-50A	C	70	153	23	VS3	-0.84	0	<TS
1268	E-50A	C	67	154	15	04C	0.8	0	<TS
1269	E-50A	C	67	154	18	02C	0.86	0	<TS
1270	E-50A	C	50	157	33	VS3	-0.85	0	<TS
1271	E-50A	C	50	157	21	VS3	1	0	<TS
1272	E-50A	C	22	159	16	02H	0.81	0	<TS
1273	E-50A	C	48	159	10	01H	-0.9	0	<TS
1274	E-50A	C	48	159	14	01H	-0.21	0	<TS
1275	E-50A	C	48	159	6	01H	0.78	0	<TS
1276	E-50A	H	1	160	18	04H	-0.18	0	<TS
1277	E-50A	C	24	161	17	02C	0.66	0	<TS
1278	E-50A	C	32	161	19	DBC	-0.28	0	<TS
1279	E-50A	C	29	162	15	01H	-0.85	0	<TS
1280	E-50A	H	4	163	19	04H	-1.19	0	<TS
1281	E-50A	C	24	163	20	02C	0.69	0	<TS

Attachment 2
Steam Generator E-50B Indications

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
1	E-50B	C	8	3	18	03C	-0.2	0	<TS
2	E-50B	C	28	3	12	VS4	-0.8	0	<TS
3	E-50B	C	35	4	29	DBC	1.84	0	<TS
4	E-50B	C	22	5	18	VS4	-0.54	0	<TS
5	E-50B	C	32	5	20	02C	1.03	0	<TS
6	E-50B	C	40	5	20	02C	-0.81	0	<TS
7	E-50B	C	43	6	16	02C	-0.9	0	<TS
8	E-50B	C	43	6	25	02C	-0.23	0	<TS
9	E-50B	C	45	6	22	02C	-0.91	0	<TS
10	E-50B	C	45	6	20	02C	-0.08	0	<TS
11	E-50B	C	46	7	20	01C	-0.11	0	<TS
12	E-50B	C	46	7	6	01C	0.71	0	<TS
13	E-50B	C	50	7	15	DBH	1.95	0	<TS
14	E-50B	C	41	8	23	04C	0.84	0	<TS
15	E-50B	C	49	8	25	VS4	0.59	0	<TS
16	E-50B	C	53	8	15	01C	0.84	0	<TS
17	E-50B	C	48	9	28	VS4	-0.79	0	<TS
18	E-50B	C	48	9	27	VS4	-0.03	0	<TS
19	E-50B	C	48	9	19	VS4	0.82	0	<TS
20	E-50B	C	37	10	18	03C	-0.82	0	<TS
21	E-50B	C	49	10	19	01C	0.87	0	<TS
22	E-50B	C	34	11	18	VS4	0.81	0	<TS
23	E-50B	C	33	12	14	VS4	-1.01	0	<TS
24	E-50B	C	33	12	20	VS4	1.2	0	<TS
25	E-50B	C	37	12	15	VS4	-0.9	0	<TS
26	E-50B	C	41	12	16	VS4	-0.34	0	<TS
27	E-50B	C	41	12	16	VS4	0.03	0	<TS
28	E-50B	C	41	12	25	VS4	0.62	0	<TS
29	E-50B	C	41	12	20	05C	0.14	0	<TS
30	E-50B	C	47	12	15	VS4	-0.7	0	<TS
31	E-50B	C	47	12	23	VS4	0.91	0	<TS
32	E-50B	C	61	12	15	06H	-0.28	0	<TS
33	E-50B	C	34	13	25	VS4	0.68	0	<TS
34	E-50B	C	38	13	18	VS4	0.71	0	<TS
35	E-50B	C	48	13	22	VS4	-0.34	0	<TS
36	E-50B	C	48	13	27	VS4	0.23	0	<TS
37	E-50B	C	48	13	21	VS4	0.76	0	<TS
38	E-50B	C	41	14	24	VS4	-0.09	0	<TS
39	E-50B	C	41	14	18	VS4	0.5	0	<TS
40	E-50B	C	47	14	24	VS4	0.7	0	<TS
41	E-50B	C	76	15	24	DBH	1.72	0	<TS
42	E-50B	C	57	16	18	06H	-0.15	0	<TS
43	E-50B	C	66	17	18	06H	0.68	0	<TS
44	E-50B	C	72	17	22	DBH	1.6	0	<TS
45	E-50B	C	74	17	21	VS3	-0.8	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
46	E-50B	C	74	17	14	VS3	0.85	0	<TS
47	E-50B	C	74	17	20	VS4	-0.98	0	<TS
48	E-50B	C	80	17	30	DBH	1.6	0	<TS
49	E-50B	C	84	19	24	07H	-1.08	0	<TS
50	E-50B	C	47	20	25	VS4	-1.03	0	<TS
51	E-50B	C	47	20	27	VS4	0.88	0	<TS
52	E-50B	C	44	21	24	VS4	-1.01	0	<TS
53	E-50B	C	44	21	29	VS4	0.84	0	<TS
54	E-50B	C	66	21	18	06H	0.74	0	<TS
55	E-50B	C	68	21	14	VS5	-1.06	0	<TS
56	E-50B	C	76	21	18	VS4	-1.14	0	<TS
57	E-50B	C	76	21	28	VS4	0.79	0	<TS
58	E-50B	C	47	22	18	VS4	-0.18	0	<TS
59	E-50B	C	77	22	23	01H	-0.34	0	<TS
60	E-50B	C	81	22	24	VS3	0.84	0	<TS
61	E-50B	C	81	22	21	VS4	0.67	0	<TS
62	E-50B	C	91	22	25	VS6	0.94	0	<TS
63	E-50B	C	30	23	13	VS4	-0.84	0	<TS
64	E-50B	C	44	23	23	DBH	-1.75	0	<TS
65	E-50B	C	44	23	19	VS4	0.95	0	<TS
66	E-50B	C	46	23	18	VS4	-0.91	0	<TS
67	E-50B	C	46	23	23	VS4	0.97	0	<TS
68	E-50B	C	62	23	17	VS5	0.97	0	<TS
69	E-50B	C	74	23	17	VS3	-0.8	0	<TS
70	E-50B	C	74	23	15	VS4	-0.89	0	<TS
71	E-50B	C	78	23	18	DBH	-1.57	0	<TS
72	E-50B	C	75	24	14	DBC	-1.55	0	<TS
73	E-50B	C	79	24	21	VS4	-0.04	0	<TS
74	E-50B	C	79	24	26	VS4	0.6	0	<TS
75	E-50B	C	81	24	19	VS3	-0.81	0	<TS
76	E-50B	C	40	25	15	05H	-0.91	0	<TS
77	E-50B	C	40	25	14	VS4	-0.84	0	<TS
78	E-50B	C	46	25	15	VS4	-0.79	0	<TS
79	E-50B	C	72	25	25	VS3	-0.64	0	<TS
80	E-50B	C	27	26	17	05H	0.79	0	<TS
81	E-50B	C	42	27	21	VS4	-0.34	0	<TS
82	E-50B	C	44	27	24	VS4	-0.88	0	<TS
83	E-50B	C	44	27	25	VS4	0.99	0	<TS
84	E-50B	C	74	27	18	VS4	-0.84	0	<TS
85	E-50B	C	76	27	9	06H	-0.91	0	<TS
86	E-50B	C	98	27	18	04C	-0.78	0	<TS
87	E-50B	C	100	27	24	VS4	-0.97	0	<TS
88	E-50B	C	1	28	10	02C	1.01	0	<TS
89	E-50B	C	83	28	22	VS6	-0.82	0	<TS
90	E-50B	C	97	28	18	03C	1.02	0	<TS
91	E-50B	C	44	29	27	VS4	-0.15	0	<TS
92	E-50B	C	44	29	12	VS4	0.76	0	<TS
93	E-50B	C	74	29	13	VS5	-0.94	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
94	E-50B	C	76	29	15	VS3	-0.33	0	<TS
95	E-50B	C	76	29	23	VS3	0.06	0	<TS
96	E-50B	C	76	29	22	VS3	0.72	0	<TS
97	E-50B	C	76	29	24	VS4	0.07	0	<TS
98	E-50B	C	96	29	13	VS4	1.05	0	<TS
99	E-50B	C	96	29	15	DBC	-1.85	0	<TS
100	E-50B	C	100	29	20	VS6	-0.71	0	<TS
101	E-50B	C	100	29	22	03C	0.97	0	<TS
102	E-50B	C	102	29	15	04C	1	0	<TS
103	E-50B	C	93	30	19	VS4	-0.6	0	<TS
104	E-50B	C	101	30	15	04C	1.08	0	<TS
105	E-50B	C	101	30	16	03C	-0.83	0	<TS
106	E-50B	C	101	30	11	03C	0.97	0	<TS
107	E-50B	C	101	30	10	02C	0.96	0	<TS
108	E-50B	C	103	30	14	01C	0.2	0	<TS
109	E-50B	C	105	30	29	VS4	0.93	0	<TS
110	E-50B	C	105	30	21	02C	0.8	0	<TS
111	E-50B	C	34	31	22	VS4	0.62	0	<TS
112	E-50B	C	40	31	19	VS4	0.53	0	<TS
113	E-50B	C	44	31	34	VS4	-0.82	0	<TS
114	E-50B	C	44	31	19	VS4	0.26	0	<TS
115	E-50B	C	102	31	16	VS4	0.7	0	<TS
116	E-50B	C	102	31	20	02C	-0.71	0	<TS
117	E-50B	C	104	31	18	VS4	0.87	0	<TS
118	E-50B	C	104	31	9	DBC	-1.6	0	<TS
119	E-50B	C	104	31	16	02C	-0.06	0	<TS
120	E-50B	C	106	31	15	VS4	0.2	0	<TS
121	E-50B	C	106	31	21	VS4	0.81	0	<TS
122	E-50B	C	106	31	15	03C	1.08	0	<TS
123	E-50B	C	106	31	15	02C	1.02	0	<TS
124	E-50B	C	45	32	23	VS4	-0.81	0	<TS
125	E-50B	C	45	32	21	VS4	0.09	0	<TS
126	E-50B	C	45	32	19	VS4	0.99	0	<TS
127	E-50B	C	67	32	14	VS3	0.39	0	<TS
128	E-50B	C	91	32	18	02C	-0.8	0	<TS
129	E-50B	C	99	32	12	VS2	-0.82	0	<TS
130	E-50B	C	99	32	14	02C	0.95	0	<TS
131	E-50B	C	101	32	16	VS2	0.85	0	<TS
132	E-50B	C	107	32	17	VS4	-0.93	0	<TS
133	E-50B	C	46	33	26	VS4	-0.75	0	<TS
134	E-50B	C	72	33	26	VS3	-0.87	0	<TS
135	E-50B	C	72	33	27	VS3	-0.03	0	<TS
136	E-50B	C	102	33	18	03C	-0.77	0	<TS
137	E-50B	C	106	33	17	03C	0.26	0	<TS
138	E-50B	C	108	33	27	08H	0.5	0	<TS
139	E-50B	C	108	33	17	DBH	-1.6	0	<TS
140	E-50B	C	45	34	16	VS4	-0.68	0	<TS
141	E-50B	C	45	34	24	VS4	-0.06	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
142	E-50B	C	45	34	15	VS4	0.71	0	<TS
143	E-50B	C	49	34	14	VS4	-0.8	0	<TS
144	E-50B	C	49	34	20	VS4	0.86	0	<TS
145	E-50B	C	77	34	20	VS3	0.69	0	<TS
146	E-50B	C	97	34	13	VS6	-0.77	0	<TS
147	E-50B	C	105	34	16	03C	-0.72	0	<TS
148	E-50B	C	105	34	17	02C	0.22	0	<TS
149	E-50B	C	109	34	22	VS4	-0.84	0	<TS
150	E-50B	C	109	34	22	04C	0.2	0	<TS
151	E-50B	C	46	35	18	VS4	-0.6	0	<TS
152	E-50B	C	76	35	18	DBH	1.58	0	<TS
153	E-50B	C	102	35	18	03C	0.97	0	<TS
154	E-50B	C	106	35	20	04H	0.79	0	<TS
155	E-50B	C	106	35	15	02C	0.06	0	<TS
156	E-50B	C	108	35	24	04H	0.67	0	<TS
157	E-50B	C	108	35	16	04C	-0.77	0	<TS
158	E-50B	C	108	35	16	04C	0.94	0	<TS
159	E-50B	C	110	35	24	VS4	1	0	<TS
160	E-50B	C	35	36	21	VS4	0.66	0	<TS
161	E-50B	C	45	36	26	VS4	0.16	0	<TS
162	E-50B	C	45	36	20	VS4	0.85	0	<TS
163	E-50B	C	71	36	14	VS3	-0.24	0	<TS
164	E-50B	C	71	36	20	VS3	0.77	0	<TS
165	E-50B	C	71	36	20	VS4	0.73	0	<TS
166	E-50B	C	71	36	16	VS5	-0.7	0	<TS
167	E-50B	C	71	36	24	VS5	0.17	0	<TS
168	E-50B	C	95	36	16	VS4	-1	0	<TS
169	E-50B	C	95	36	16	VS4	0.97	0	<TS
170	E-50B	C	107	36	22	VS2	0.91	0	<TS
171	E-50B	C	109	36	17	02C	-0.77	0	<TS
172	E-50B	C	111	36	21	VS4	-0.78	0	<TS
173	E-50B	C	111	36	17	02C	0.19	0	<TS
174	E-50B	C	111	36	12	02C	0.94	0	<TS
175	E-50B	C	111	36	16	01C	0.94	0	<TS
176	E-50B	C	113	36	11	VS6	-0.81	0	<TS
177	E-50B	C	113	36	13	VS6	0.7	0	<TS
178	E-50B	C	113	36	15	02C	0.91	0	<TS
179	E-50B	C	44	37	22	VS4	-0.25	0	<TS
180	E-50B	C	44	37	25	VS4	0.13	0	<TS
181	E-50B	C	44	37	16	VS4	0.69	0	<TS
182	E-50B	C	46	37	15	VS4	-0.69	0	<TS
183	E-50B	C	46	37	16	VS4	0.78	0	<TS
184	E-50B	C	94	37	11	VS2	-0.9	0	<TS
185	E-50B	C	106	37	25	VS2	-0.77	0	<TS
186	E-50B	C	112	37	33	04C	-0.85	0	<TS
187	E-50B	C	114	37	27	DBH	1.08	0	<TS
188	E-50B	C	114	37	24	VS2	-0.71	0	<TS
189	E-50B	C	114	37	28	VS2	0.05	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
190	E-50B	C	114	37	18	VS4	-0.78	0	<TS
191	E-50B	C	114	37	30	VS4	0.96	0	<TS
192	E-50B	C	89	38	17	VS2	-0.8	0	<TS
193	E-50B	C	105	38	15	03C	0.94	0	<TS
194	E-50B	C	115	38	33	01C	0.06	0	<TS
195	E-50B	C	46	39	10	VS4	-0.57	0	<TS
196	E-50B	C	46	39	14	VS4	0.15	0	<TS
197	E-50B	C	46	39	19	VS4	0.57	0	<TS
198	E-50B	C	66	39	15	VS5	-0.81	0	<TS
199	E-50B	C	86	39	14	VS6	-0.39	0	<TS
200	E-50B	C	106	39	25	VS2	-0.85	0	<TS
201	E-50B	C	106	39	27	03C	0.97	0	<TS
202	E-50B	C	114	39	22	VS2	-0.87	0	<TS
203	E-50B	C	114	39	36	VS4	0.81	0	<TS
204	E-50B	C	114	39	19	VS6	-0.6	0	<TS
205	E-50B	C	107	40	19	VS2	-0.85	0	<TS
206	E-50B	C	107	40	20	VS2	0.93	0	<TS
207	E-50B	C	109	40	20	VS2	-0.79	0	<TS
208	E-50B	C	109	40	18	VS2	0.82	0	<TS
209	E-50B	C	117	40	21	04C	0	0	<TS
210	E-50B	C	117	40	23	03C	-0.78	0	<TS
211	E-50B	C	117	40	23	02C	-1.11	0	<TS
212	E-50B	C	117	40	18	02C	0.06	0	<TS
213	E-50B	C	117	40	18	02C	0.81	0	<TS
214	E-50B	C	42	41	20	VS4	-0.82	0	<TS
215	E-50B	C	42	41	27	VS4	0.19	0	<TS
216	E-50B	C	42	41	33	VS4	0.88	0	<TS
217	E-50B	C	44	41	20	02C	-0.06	0	<TS
218	E-50B	C	60	41	26	02H	-0.08	0	<TS
219	E-50B	C	66	41	18	VS3	-0.69	0	<TS
220	E-50B	C	68	41	22	04H	0.75	0	<TS
221	E-50B	C	72	41	26	06C	0.86	0	<TS
222	E-50B	C	82	41	24	VS3	0.86	0	<TS
223	E-50B	C	98	41	15	VS2	-0.87	0	<TS
224	E-50B	C	98	41	22	VS2	0.89	0	<TS
225	E-50B	C	98	41	26	VS4	0.79	0	<TS
226	E-50B	C	98	41	12	VS6	0.86	0	<TS
227	E-50B	C	102	41	7	06H	-0.81	0	<TS
228	E-50B	C	102	41	16	06H	0.7	0	<TS
229	E-50B	C	35	42	17	05H	0.9	0	<TS
230	E-50B	C	45	42	21	VS4	-0.6	0	<TS
231	E-50B	C	45	42	16	VS4	0.87	0	<TS
232	E-50B	C	53	42	11	VS5	-0.44	0	<TS
233	E-50B	C	61	42	16	VS3	0.73	0	<TS
234	E-50B	C	63	42	15	VS3	0.91	0	<TS
235	E-50B	C	97	42	15	VS2	-0.8	0	<TS
236	E-50B	C	107	42	26	VS2	-0.79	0	<TS
237	E-50B	C	107	42	29	VS2	0.9	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
238	E-50B	C	107	42	18	VS4	0.21	0	<TS
239	E-50B	C	107	42	29	VS4	0.95	0	<TS
240	E-50B	C	107	42	18	VS6	-0.8	0	<TS
241	E-50B	C	107	42	12	VS6	0.8	0	<TS
242	E-50B	C	113	42	14	VS4	0.97	0	<TS
243	E-50B	C	119	42	20	VS7	-0.83	0	<TS
244	E-50B	C	119	42	19	04C	-0.06	0	<TS
245	E-50B	C	119	42	15	03C	1.03	0	<TS
246	E-50B	C	46	43	25	01H	0.84	0	<TS
247	E-50B	C	74	43	11	VS3	-0.51	0	<TS
248	E-50B	C	74	43	17	VS4	-0.36	0	<TS
249	E-50B	C	82	43	9	VS3	-0.3	0	<TS
250	E-50B	C	82	43	19	VS3	0.22	0	<TS
251	E-50B	C	82	43	17	VS3	0.91	0	<TS
252	E-50B	C	82	43	20	VS5	-0.94	0	<TS
253	E-50B	C	82	43	21	VS5	0	0	<TS
254	E-50B	C	108	43	16	VS4	-0.91	0	<TS
255	E-50B	C	112	43	21	VS2	-0.82	0	<TS
256	E-50B	C	112	43	19	VS2	0.93	0	<TS
257	E-50B	C	112	43	17	VS4	-0.88	0	<TS
258	E-50B	C	114	43	10	07H	0.97	0	<TS
259	E-50B	C	116	43	14	VS4	1	0	<TS
260	E-50B	C	118	43	18	VS4	0.99	0	<TS
261	E-50B	C	118	43	20	VS6	-0.14	0	<TS
262	E-50B	C	120	43	21	01C	-0.8	0	<TS
263	E-50B	C	119	44	18	02H	0.69	0	<TS
264	E-50B	C	121	44	20	01H	0.86	0	<TS
265	E-50B	C	30	45	18	VS4	0.88	0	<TS
266	E-50B	C	36	45	18	VS4	-0.67	0	<TS
267	E-50B	C	38	45	16	02C	0.08	0	<TS
268	E-50B	C	44	45	22	VS4	0.78	0	<TS
269	E-50B	C	44	45	17	04C	0.85	0	<TS
270	E-50B	C	44	45	14	03C	0.75	0	<TS
271	E-50B	C	74	45	16	VS5	-0.89	0	<TS
272	E-50B	C	80	45	23	06H	0	0	<TS
273	E-50B	C	120	45	16	02C	0.92	0	<TS
274	E-50B	C	9	46	20	DBH	0.37	0	<TS
275	E-50B	C	47	46	18	VS4	-0.51	0	<TS
276	E-50B	C	47	46	15	VS4	0.11	0	<TS
277	E-50B	C	49	46	12	VS4	-0.6	0	<TS
278	E-50B	C	67	46	12	DBC	2	0	<TS
279	E-50B	C	97	46	13	VS4	0.86	0	<TS
280	E-50B	C	107	46	24	VS6	-0.87	0	<TS
281	E-50B	C	44	47	24	VS4	-0.7	0	<TS
282	E-50B	C	58	47	15	VS5	-0.91	0	<TS
283	E-50B	C	68	47	12	VS4	0.96	0	<TS
284	E-50B	C	80	47	19	VS3	-0.75	0	<TS
285	E-50B	C	80	47	21	VS5	0.89	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
286	E-50B	C	108	47	16	VS2	-0.52	0	<TS
287	E-50B	C	112	47	22	VS2	-0.81	0	<TS
288	E-50B	C	114	47	12	VS4	-0.75	0	<TS
289	E-50B	C	114	47	11	VS4	0.86	0	<TS
290	E-50B	C	116	47	17	VS4	0.97	0	<TS
291	E-50B	C	120	47	19	03C	0.96	0	<TS
292	E-50B	C	43	48	23	05C	0.92	0	<TS
293	E-50B	C	45	48	18	VS4	-0.91	0	<TS
294	E-50B	C	45	48	21	VS4	0.27	0	<TS
295	E-50B	C	45	48	23	VS4	0.63	0	<TS
296	E-50B	C	47	48	18	06C	0.81	0	<TS
297	E-50B	C	59	48	18	06H	0.81	0	<TS
298	E-50B	C	59	48	24	03C	0.83	0	<TS
299	E-50B	C	77	48	18	VS4	0.92	0	<TS
300	E-50B	C	103	48	17	VS4	-1.05	0	<TS
301	E-50B	C	113	48	28	VS2	-0.87	0	<TS
302	E-50B	C	113	48	34	VS4	-0.75	0	<TS
303	E-50B	C	125	48	19	VS4	0.85	0	<TS
304	E-50B	C	125	48	18	VS6	0.95	0	<TS
305	E-50B	C	38	49	19	VS4	0.72	0	<TS
306	E-50B	C	72	49	24	03C	1.05	0	<TS
307	E-50B	C	92	49	18	05H	0.89	0	<TS
308	E-50B	C	98	49	20	VS2	-0.69	0	<TS
309	E-50B	C	120	49	17	VS2	0.11	0	<TS
310	E-50B	C	124	49	19	02C	-0.83	0	<TS
311	E-50B	C	111	50	17	VS2	0.9	0	<TS
312	E-50B	C	36	51	11	VS4	-0.79	0	<TS
313	E-50B	C	36	51	15	VS4	0.98	0	<TS
314	E-50B	C	38	51	16	VS4	-0.76	0	<TS
315	E-50B	C	42	51	33	VS4	-0.76	0	<TS
316	E-50B	C	42	51	20	VS4	0.98	0	<TS
317	E-50B	C	64	51	19	VS5	0.09	0	<TS
318	E-50B	C	64	51	16	VS5	0.88	0	<TS
319	E-50B	C	88	51	21	VS4	-0.56	0	<TS
320	E-50B	C	102	51	16	07C	0.97	0	<TS
321	E-50B	C	106	51	19	07C	0.9	0	<TS
322	E-50B	C	108	51	24	VS2	-0.52	0	<TS
323	E-50B	C	108	51	16	VS2	0.8	0	<TS
324	E-50B	C	124	51	17	VS4	0.55	0	<TS
325	E-50B	C	69	52	19	VS3	0	0	<TS
326	E-50B	C	69	52	22	VS4	-0.8	0	<TS
327	E-50B	C	69	52	14	VS4	0.13	0	<TS
328	E-50B	C	69	52	17	VS5	-1.03	0	<TS
329	E-50B	C	69	52	16	VS5	1.03	0	<TS
330	E-50B	C	71	52	17	03C	0.88	0	<TS
331	E-50B	C	81	52	29	VS3	0.73	0	<TS
332	E-50B	C	109	52	20	VS2	-0.9	0	<TS
333	E-50B	C	109	52	31	VS2	0.85	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
334	E-50B	C	109	52	17	VS6	1.07	0	<TS
335	E-50B	C	123	52	19	02C	1.04	0	<TS
336	E-50B	C	30	53	17	02C	0.72	0	<TS
337	E-50B	C	112	53	19	VS2	-0.84	0	<TS
338	E-50B	C	112	53	18	VS2	0.89	0	<TS
339	E-50B	C	41	54	15	VS4	-0.73	0	<TS
340	E-50B	C	41	54	22	VS4	0.88	0	<TS
341	E-50B	C	85	54	6	VS4	-0.52	0	<TS
342	E-50B	C	91	54	16	02C	1.05	0	<TS
343	E-50B	C	105	54	22	VS6	-0.85	0	<TS
344	E-50B	C	127	54	16	01H	-1.09	0	<TS
345	E-50B	C	36	55	13	VS4	0.94	0	<TS
346	E-50B	C	72	55	18	VS3	-0.82	0	<TS
347	E-50B	C	98	55	27	VS2	-0.49	0	<TS
348	E-50B	C	110	55	29	VS2	-0.86	0	<TS
349	E-50B	C	116	55	11	VS2	-0.88	0	<TS
350	E-50B	C	116	55	18	VS4	0.91	0	<TS
351	E-50B	C	128	55	22	01C	0	0	<TS
352	E-50B	C	130	55	14	02C	0.99	0	<TS
353	E-50B	C	45	56	15	03H	0.84	0	<TS
354	E-50B	C	47	56	15	VS4	-0.83	0	<TS
355	E-50B	C	47	56	29	VS4	0.92	0	<TS
356	E-50B	C	111	56	14	VS4	-0.69	0	<TS
357	E-50B	C	111	56	10	VS6	-0.72	0	<TS
358	E-50B	C	129	56	19	01H	0.75	0	<TS
359	E-50B	C	42	57	12	VS4	0.23	0	<TS
360	E-50B	C	42	57	27	VS4	0.82	0	<TS
361	E-50B	C	44	57	11	VS4	-0.61	0	<TS
362	E-50B	C	44	57	11	VS4	0.15	0	<TS
363	E-50B	C	78	57	14	03C	0.96	0	<TS
364	E-50B	C	47	58	8	VS4	-0.95	0	<TS
365	E-50B	C	47	58	16	VS4	0.88	0	<TS
366	E-50B	C	51	58	18	01H	1.02	0	<TS
367	E-50B	C	51	58	19	03H	0.8	0	<TS
368	E-50B	C	67	58	9	03C	0.19	0	<TS
369	E-50B	C	67	58	14	03C	0.89	0	<TS
370	E-50B	C	105	58	18	VS2	-0.91	0	<TS
371	E-50B	C	105	58	16	VS6	0.71	0	<TS
372	E-50B	C	131	58	28	01C	0.88	0	<TS
373	E-50B	C	44	59	20	VS4	-0.06	0	<TS
374	E-50B	C	44	59	13	VS4	0.75	0	<TS
375	E-50B	C	46	59	20	03C	0.88	0	<TS
376	E-50B	C	48	59	12	VS4	0.8	0	<TS
377	E-50B	C	76	59	15	VS3	-0.84	0	<TS
378	E-50B	C	98	59	16	VS2	-0.84	0	<TS
379	E-50B	C	98	59	14	VS2	0.92	0	<TS
380	E-50B	C	108	59	19	VS2	-0.92	0	<TS
381	E-50B	C	108	59	18	VS2	0.87	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
382	E-50B	C	112	59	18	VS2	-0.32	0	<TS
383	E-50B	C	112	59	19	VS2	0.09	0	<TS
384	E-50B	C	112	59	17	VS2	0.35	0	<TS
385	E-50B	C	89	60	15	04C	-0.85	0	<TS
386	E-50B	C	97	60	18	VS2	0.93	0	<TS
387	E-50B	C	78	61	21	VS3	-0.8	0	<TS
388	E-50B	C	120	61	19	08C	0.73	0	<TS
389	E-50B	C	132	61	27	02H	-0.93	0	<TS
390	E-50B	C	13	62	13	DBC	-1.77	0	<TS
391	E-50B	C	13	62	11	05C	-0.83	0	<TS
392	E-50B	C	57	62	11	DBC	0.89	0	<TS
393	E-50B	C	65	62	18	04H	-1.13	0	<TS
394	E-50B	C	101	62	16	VS2	-0.87	0	<TS
395	E-50B	C	103	62	17	03C	0.94	0	<TS
396	E-50B	C	109	62	17	07C	0.91	0	<TS
397	E-50B	C	44	63	11	VS4	-0.91	0	<TS
398	E-50B	C	44	63	19	VS4	0.92	0	<TS
399	E-50B	C	66	63	19	VS3	-0.81	0	<TS
400	E-50B	C	66	63	19	VS3	-0.39	0	<TS
401	E-50B	C	106	63	23	VS2	0.16	0	<TS
402	E-50B	C	134	63	16	DBH	-1.79	0	<TS
403	E-50B	C	21	64	14	DBC	-1.64	0	<TS
404	E-50B	C	25	64	16	DBH	-1.73	0	<TS
405	E-50B	C	91	64	21	03C	-0.9	0	<TS
406	E-50B	C	103	64	27	VS2	0.94	0	<TS
407	E-50B	C	123	64	17	VS4	0.93	0	<TS
408	E-50B	C	131	64	28	VS7	0.93	0	<TS
409	E-50B	C	44	65	16	VS4	-0.21	0	<TS
410	E-50B	C	44	65	16	VS4	0.03	0	<TS
411	E-50B	C	44	65	21	VS4	0.72	0	<TS
412	E-50B	C	48	65	26	VS4	-0.75	0	<TS
413	E-50B	C	130	65	20	VS4	0.99	0	<TS
414	E-50B	C	130	65	28	VS7	1.01	0	<TS
415	E-50B	C	134	65	24	02H	0.73	0	<TS
416	E-50B	C	59	66	17	02H	-1	0	<TS
417	E-50B	C	97	66	11	VS2	-0.92	0	<TS
418	E-50B	C	101	66	11	VS4	-0.75	0	<TS
419	E-50B	C	101	66	14	VS4	1.04	0	<TS
420	E-50B	C	111	66	19	07H	0.95	0	<TS
421	E-50B	C	48	67	16	VS4	-0.03	0	<TS
422	E-50B	C	88	67	15	VS2	-0.8	0	<TS
423	E-50B	C	88	67	16	VS2	0.73	0	<TS
424	E-50B	C	92	67	17	VS6	-0.76	0	<TS
425	E-50B	C	92	67	13	VS6	0.68	0	<TS
426	E-50B	C	61	68	15	02H	-0.8	0	<TS
427	E-50B	C	117	68	21	05H	0.96	0	<TS
428	E-50B	C	135	68	19	VS7	1.06	0	<TS
429	E-50B	C	46	69	16	DBH	-1.6	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
430	E-50B	C	90	69	14	07H	-0.91	0	<TS
431	E-50B	C	90	69	13	07H	0.77	0	<TS
432	E-50B	C	92	69	16	04C	0.92	0	<TS
433	E-50B	C	108	69	17	05H	0.87	0	<TS
434	E-50B	C	134	69	17	04H	0.11	0	<TS
435	E-50B	C	134	69	22	04H	0.93	0	<TS
436	E-50B	C	134	69	29	VS7	1.02	0	<TS
437	E-50B	C	47	70	16	VS4	-0.68	0	<TS
438	E-50B	C	63	70	15	04H	0.79	0	<TS
439	E-50B	C	113	70	19	07C	0	0	<TS
440	E-50B	C	113	70	19	07C	0.78	0	<TS
441	E-50B	C	60	71	14	VS5	0.55	0	<TS
442	E-50B	C	98	71	13	VS2	0.95	0	<TS
443	E-50B	C	106	71	15	VS2	-0.38	0	<TS
444	E-50B	C	59	72	18	03H	0.94	0	<TS
445	E-50B	C	69	72	17	06C	-0.93	0	<TS
446	E-50B	C	123	72	21	VS4	-0.74	0	<TS
447	E-50B	C	80	73	19	03H	-0.8	0	<TS
448	E-50B	C	92	73	15	VS2	0.79	0	<TS
449	E-50B	C	118	73	20	VS6	-0.99	0	<TS
450	E-50B	C	128	73	27	VS1	0.15	0	<TS
451	E-50B	C	128	73	19	VS4	0.8	0	<TS
452	E-50B	C	49	74	15	DBH	-1.68	0	<TS
453	E-50B	C	106	75	15	VS2	0.9	0	<TS
454	E-50B	C	69	76	14	VS5	0.79	0	<TS
455	E-50B	C	105	76	18	VS2	0.9	0	<TS
456	E-50B	C	135	76	22	VS7	-0.83	0	<TS
457	E-50B	C	135	76	24	08C	-1.16	0	<TS
458	E-50B	C	135	76	22	08C	0.83	0	<TS
459	E-50B	C	72	77	20	02H	0.82	0	<TS
460	E-50B	C	84	77	16	05C	-0.9	0	<TS
461	E-50B	C	106	77	24	VS2	0.93	0	<TS
462	E-50B	C	116	77	21	VS2	0.78	0	<TS
463	E-50B	C	130	77	23	VS2	0.97	0	<TS
464	E-50B	C	130	77	20	VS4	0.67	0	<TS
465	E-50B	C	136	77	21	03H	1.01	0	<TS
466	E-50B	C	138	77	19	VS4	1.12	0	<TS
467	E-50B	C	85	78	16	05H	0.88	0	<TS
468	E-50B	C	105	78	13	VS2	0.89	0	<TS
469	E-50B	C	105	78	21	VS6	-0.93	0	<TS
470	E-50B	C	105	78	22	VS6	0.96	0	<TS
471	E-50B	C	107	78	11	VS2	-1.03	0	<TS
472	E-50B	C	107	78	14	VS2	0.9	0	<TS
473	E-50B	C	109	78	15	04C	-0.87	0	<TS
474	E-50B	C	110	79	19	VS2	-0.05	0	<TS
475	E-50B	C	112	79	20	VS2	0.64	0	<TS
476	E-50B	C	138	79	25	VS1	-0.67	0	<TS
477	E-50B	C	138	79	9	VS1	0.84	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
478	E-50B	C	138	79	21	VS2	0.65	0	<TS
479	E-50B	C	138	79	18	VS4	0.92	0	<TS
480	E-50B	C	138	79	17	VS6	-0.91	0	<TS
481	E-50B	C	138	79	16	VS6	0.91	0	<TS
482	E-50B	C	53	80	23	03C	0.71	0	<TS
483	E-50B	C	105	80	25	VS2	-0.23	0	<TS
484	E-50B	C	125	80	14	VS4	0.93	0	<TS
485	E-50B	C	137	80	16	08H	0.73	0	<TS
486	E-50B	C	78	81	19	03H	0.76	0	<TS
487	E-50B	C	84	81	20	02C	0.83	0	<TS
488	E-50B	C	98	81	19	VS2	0.93	0	<TS
489	E-50B	C	98	81	24	VS4	-0.75	0	<TS
490	E-50B	C	116	81	23	VS7	-1.02	0	<TS
491	E-50B	C	116	81	19	07C	-1.04	0	<TS
492	E-50B	C	116	81	17	07C	-0.27	0	<TS
493	E-50B	C	132	81	16	05H	0.92	0	<TS
494	E-50B	C	138	81	18	VS4	-0.81	0	<TS
495	E-50B	C	59	82	11	VS4	0.82	0	<TS
496	E-50B	C	63	82	23	VS4	1.05	0	<TS
497	E-50B	C	63	82	21	VS5	1.05	0	<TS
498	E-50B	C	85	82	13	VS6	-0.62	0	<TS
499	E-50B	C	87	82	16	03H	0.76	0	<TS
500	E-50B	C	99	82	11	VS2	-0.74	0	<TS
501	E-50B	C	103	82	16	VS2	0.91	0	<TS
502	E-50B	C	107	82	30	VS2	-0.6	0	<TS
503	E-50B	C	107	82	25	VS2	0.96	0	<TS
504	E-50B	C	125	82	14	VS1	-0.65	0	<TS
505	E-50B	C	135	82	22	VS7	-0.74	0	<TS
506	E-50B	C	135	82	27	VS7	0.85	0	<TS
507	E-50B	C	92	83	18	05H	0.94	0	<TS
508	E-50B	C	79	84	20	VS4	-0.47	0	<TS
509	E-50B	C	89	84	21	03H	1.01	0	<TS
510	E-50B	C	91	84	19	VS6	0.03	0	<TS
511	E-50B	C	97	84	20	07C	-0.92	0	<TS
512	E-50B	C	97	84	16	07C	-0.18	0	<TS
513	E-50B	C	109	84	17	04H	-0.2	0	<TS
514	E-50B	C	113	84	18	02H	-0.8	0	<TS
515	E-50B	C	113	84	17	04H	-0.87	0	<TS
516	E-50B	C	115	84	18	03H	-0.78	0	<TS
517	E-50B	C	129	84	19	06H	0.9	0	<TS
518	E-50B	C	56	85	25	03C	0.98	0	<TS
519	E-50B	C	56	85	15	02C	-0.8	0	<TS
520	E-50B	C	102	85	28	VS6	-0.83	0	<TS
521	E-50B	C	106	85	13	02C	0.88	0	<TS
522	E-50B	C	112	85	13	VS6	0.79	0	<TS
523	E-50B	C	124	85	17	VS4	-0.62	0	<TS
524	E-50B	C	138	85	22	DBH	1.46	0	<TS
525	E-50B	C	63	86	12	02C	-0.83	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
526	E-50B	C	79	86	16	03H	0.92	0	<TS
527	E-50B	C	118	87	15	VS2	0.96	0	<TS
528	E-50B	C	126	87	31	VS2	0.94	0	<TS
529	E-50B	C	126	87	31	VS4	-0.55	0	<TS
530	E-50B	C	126	87	17	VS4	1.16	0	<TS
531	E-50B	C	126	87	18	VS6	0.67	0	<TS
532	E-50B	C	136	87	14	08C	-1.04	0	<TS
533	E-50B	C	138	87	18	VS1	-0.79	0	<TS
534	E-50B	C	138	87	19	VS4	-0.68	0	<TS
535	E-50B	C	91	88	18	04H	-0.84	0	<TS
536	E-50B	C	119	88	22	08C	0.78	0	<TS
537	E-50B	C	118	89	22	VS2	0.92	0	<TS
538	E-50B	C	118	89	17	VS4	0.68	0	<TS
539	E-50B	C	136	89	23	VS2	0.61	0	<TS
540	E-50B	C	138	89	14	VS4	-0.57	0	<TS
541	E-50B	C	138	89	28	VS7	0.95	0	<TS
542	E-50B	C	57	90	13	03C	-0.92	0	<TS
543	E-50B	C	57	90	18	03C	0.91	0	<TS
544	E-50B	C	101	90	9	VS6	-0.81	0	<TS
545	E-50B	C	105	90	19	VS2	0.95	0	<TS
546	E-50B	C	105	90	21	VS4	0.9	0	<TS
547	E-50B	C	105	90	17	07C	0.73	0	<TS
548	E-50B	C	135	90	29	VS7	0.65	0	<TS
549	E-50B	C	137	90	20	DBH	1.51	0	<TS
550	E-50B	C	137	90	14	VS4	0.87	0	<TS
551	E-50B	C	137	90	16	VS6	-0.74	0	<TS
552	E-50B	C	137	90	19	VS7	-0.8	0	<TS
553	E-50B	C	137	90	17	VS7	0.97	0	<TS
554	E-50B	C	137	90	11	DBC	1.93	0	<TS
555	E-50B	C	116	91	15	VS2	-0.74	0	<TS
556	E-50B	C	130	91	24	DBC	1.66	0	<TS
557	E-50B	C	136	91	17	DBC	1.98	0	<TS
558	E-50B	C	127	92	21	08C	-0.11	0	<TS
559	E-50B	C	135	92	39	VS7	-0.76	0	<TS
560	E-50B	C	135	92	36	08C	0.9	0	<TS
561	E-50B	C	135	92	20	07C	0.76	0	<TS
562	E-50B	C	137	92	19	VS6	-0.74	0	<TS
563	E-50B	C	137	92	18	VS6	1.12	0	<TS
564	E-50B	C	137	92	20	VS7	-0.72	0	<TS
565	E-50B	C	84	93	15	02C	-1	0	<TS
566	E-50B	C	94	93	10	04C	-1.05	0	<TS
567	E-50B	C	94	93	17	04C	-0.12	0	<TS
568	E-50B	C	94	93	13	03C	-0.7	0	<TS
569	E-50B	C	124	93	11	VS1	0.7	0	<TS
570	E-50B	C	124	93	18	VS2	-0.71	0	<TS
571	E-50B	C	124	93	26	VS2	0.08	0	<TS
572	E-50B	C	124	93	15	VS2	0.87	0	<TS
573	E-50B	C	124	93	13	VS4	-0.84	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
574	E-50B	C	103	94	19	VS2	-0.75	0	<TS
575	E-50B	C	103	94	9	VS2	0.99	0	<TS
576	E-50B	C	125	94	18	VS2	-0.62	0	<TS
577	E-50B	C	135	94	28	DBC	1.68	0	<TS
578	E-50B	C	80	95	24	04H	0.87	0	<TS
579	E-50B	C	88	95	20	03C	0.98	0	<TS
580	E-50B	C	96	95	17	VS2	-0.81	0	<TS
581	E-50B	C	96	95	17	VS2	1	0	<TS
582	E-50B	C	102	95	7	VS6	-0.91	0	<TS
583	E-50B	C	104	95	17	VS2	-0.66	0	<TS
584	E-50B	C	104	95	13	VS2	0.06	0	<TS
585	E-50B	C	104	95	16	VS2	0.8	0	<TS
586	E-50B	C	124	95	15	VS4	-0.81	0	<TS
587	E-50B	C	124	95	19	VS4	0.95	0	<TS
588	E-50B	C	126	95	28	VS4	-0.66	0	<TS
589	E-50B	C	126	95	20	VS6	0.99	0	<TS
590	E-50B	C	134	95	23	DBC	1.47	0	<TS
591	E-50B	C	136	95	17	03C	0.95	0	<TS
592	E-50B	C	47	96	13	VS4	-0.34	0	<TS
593	E-50B	C	47	96	19	VS4	0.67	0	<TS
594	E-50B	C	105	96	16	04C	-0.93	0	<TS
595	E-50B	C	107	96	21	VS2	0.97	0	<TS
596	E-50B	C	107	96	14	VS4	0.26	0	<TS
597	E-50B	C	131	96	21	04C	0.92	0	<TS
598	E-50B	C	56	97	15	04C	0.77	0	<TS
599	E-50B	C	74	97	17	VS4	1.19	0	<TS
600	E-50B	C	92	97	7	04C	-0.09	0	<TS
601	E-50B	C	92	97	13	04C	0.91	0	<TS
602	E-50B	C	110	97	20	08H	1.18	0	<TS
603	E-50B	C	132	97	17	VS2	-0.23	0	<TS
604	E-50B	C	136	97	27	VS7	-0.74	0	<TS
605	E-50B	C	136	97	14	VS7	1.03	0	<TS
606	E-50B	C	136	97	15	08C	-1.09	0	<TS
607	E-50B	C	136	97	11	08C	0	0	<TS
608	E-50B	C	136	97	16	07C	0.67	0	<TS
609	E-50B	C	136	97	19	03C	0.78	0	<TS
610	E-50B	C	47	98	22	VS4	0.9	0	<TS
611	E-50B	C	131	98	24	VS6	1.12	0	<TS
612	E-50B	C	131	98	30	VS7	0.86	0	<TS
613	E-50B	C	70	99	20	VS3	0.76	0	<TS
614	E-50B	C	102	99	10	07C	0.29	0	<TS
615	E-50B	C	102	99	18	07C	0.82	0	<TS
616	E-50B	C	126	99	19	08C	0.85	0	<TS
617	E-50B	C	126	99	19	07C	0.97	0	<TS
618	E-50B	C	134	99	17	VS6	-0.74	0	<TS
619	E-50B	C	134	99	25	VS6	1.14	0	<TS
620	E-50B	C	133	100	18	VS7	0.2	0	<TS
621	E-50B	C	74	101	15	VS5	-0.93	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
622	E-50B	C	106	101	18	VS2	-0.77	0	<TS
623	E-50B	C	128	101	22	05C	0.76	0	<TS
624	E-50B	C	132	101	13	06C	-0.2	0	<TS
625	E-50B	C	132	101	17	06C	0.84	0	<TS
626	E-50B	C	134	101	23	VS7	1.05	0	<TS
627	E-50B	C	39	102	17	VS4	-0.92	0	<TS
628	E-50B	C	61	102	16	05C	-0.2	0	<TS
629	E-50B	C	63	102	20	04C	-0.94	0	<TS
630	E-50B	C	127	102	16	07C	-0.11	0	<TS
631	E-50B	C	129	102	19	08C	-0.98	0	<TS
632	E-50B	C	131	102	22	06C	-1.04	0	<TS
633	E-50B	C	131	102	19	05C	0.81	0	<TS
634	E-50B	C	133	102	18	07C	-0.96	0	<TS
635	E-50B	C	44	103	29	VS4	1	0	<TS
636	E-50B	C	46	103	11	04C	0.82	0	<TS
637	E-50B	C	92	103	19	DBC	0.78	0	<TS
638	E-50B	C	116	103	11	VS2	-0.79	0	<TS
639	E-50B	C	126	103	20	VS4	0.88	0	<TS
640	E-50B	C	67	104	17	06C	-0.06	0	<TS
641	E-50B	C	77	104	21	05H	0.84	0	<TS
642	E-50B	C	77	104	22	05C	0.94	0	<TS
643	E-50B	C	83	104	27	DBC	1.57	0	<TS
644	E-50B	C	101	104	22	DBH	1.51	0	<TS
645	E-50B	C	109	104	28	VS2	0.89	0	<TS
646	E-50B	C	119	104	17	VS1	-0.72	0	<TS
647	E-50B	C	121	104	18	05H	0.67	0	<TS
648	E-50B	C	125	104	20	07H	0.87	0	<TS
649	E-50B	C	125	104	20	07C	-0.2	0	<TS
650	E-50B	C	131	104	28	VS7	0.88	0	<TS
651	E-50B	C	133	104	20	VS7	0.91	0	<TS
652	E-50B	C	118	105	15	VS4	-0.6	0	<TS
653	E-50B	C	120	105	21	VS2	-0.77	0	<TS
654	E-50B	C	95	106	22	04C	-0.94	0	<TS
655	E-50B	C	127	106	23	07C	-0.34	0	<TS
656	E-50B	C	129	106	9	08C	-0.2	0	<TS
657	E-50B	C	129	106	18	08C	0.96	0	<TS
658	E-50B	C	133	106	37	VS6	0	0	<TS
659	E-50B	C	133	106	26	VS6	0.96	0	<TS
660	E-50B	C	133	106	24	VS7	-0.85	0	<TS
661	E-50B	C	38	107	20	02C	0.92	0	<TS
662	E-50B	C	44	107	15	VS4	-0.86	0	<TS
663	E-50B	C	44	107	20	VS4	1.12	0	<TS
664	E-50B	C	48	107	12	04C	0.87	0	<TS
665	E-50B	C	48	107	12	02C	0.74	0	<TS
666	E-50B	C	132	107	23	02C	-0.95	0	<TS
667	E-50B	C	39	108	15	DBH	-1.71	0	<TS
668	E-50B	C	47	108	22	06H	0.73	0	<TS
669	E-50B	C	47	108	19	VS4	-0.69	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
670	E-50B	C	47	108	21	VS4	0.91	0	<TS
671	E-50B	C	61	108	14	VS3	0.75	0	<TS
672	E-50B	C	103	108	19	VS6	-0.73	0	<TS
673	E-50B	C	113	108	14	VS2	0.71	0	<TS
674	E-50B	C	34	109	16	03C	0.8	0	<TS
675	E-50B	C	38	109	16	VS4	-0.33	0	<TS
676	E-50B	C	68	109	17	02H	0.87	0	<TS
677	E-50B	C	70	109	16	VS4	-1.01	0	<TS
678	E-50B	C	78	109	14	02H	-0.91	0	<TS
679	E-50B	C	78	109	9	03H	0.08	0	<TS
680	E-50B	C	78	109	17	03H	0.89	0	<TS
681	E-50B	C	100	109	26	VS2	-0.48	0	<TS
682	E-50B	C	102	109	10	04C	-0.84	0	<TS
683	E-50B	C	126	109	18	04H	0.77	0	<TS
684	E-50B	C	130	109	16	04H	0.78	0	<TS
685	E-50B	C	63	110	19	03H	-0.11	0	<TS
686	E-50B	C	65	110	19	03H	0.89	0	<TS
687	E-50B	C	69	110	17	03C	0.78	0	<TS
688	E-50B	C	71	110	18	04H	-0.86	0	<TS
689	E-50B	C	79	110	28	VS5	0.81	0	<TS
690	E-50B	C	85	110	19	04C	0.77	0	<TS
691	E-50B	C	113	110	14	04C	0.96	0	<TS
692	E-50B	C	30	111	17	03C	-0.91	0	<TS
693	E-50B	C	36	111	19	VS4	0.85	0	<TS
694	E-50B	C	116	111	23	04C	-0.83	0	<TS
695	E-50B	C	109	112	20	07H	0.74	0	<TS
696	E-50B	C	111	112	13	VS2	0.94	0	<TS
697	E-50B	C	117	112	18	04H	0.81	0	<TS
698	E-50B	C	119	112	20	04C	0.79	0	<TS
699	E-50B	C	125	112	20	02C	0.81	0	<TS
700	E-50B	C	127	112	20	02C	0.83	0	<TS
701	E-50B	C	36	113	21	03C	0.78	0	<TS
702	E-50B	C	68	113	17	03H	0.86	0	<TS
703	E-50B	C	68	113	17	04H	-0.78	0	<TS
704	E-50B	C	68	113	22	04H	0.76	0	<TS
705	E-50B	C	72	113	17	02H	-0.93	0	<TS
706	E-50B	C	72	113	9	02H	0.87	0	<TS
707	E-50B	C	72	113	15	04C	0.81	0	<TS
708	E-50B	C	106	113	16	VS2	0	0	<TS
709	E-50B	C	108	113	22	VS4	-0.82	0	<TS
710	E-50B	C	108	113	20	VS4	0.9	0	<TS
711	E-50B	C	120	113	24	VS2	-0.76	0	<TS
712	E-50B	C	120	113	20	VS2	0.91	0	<TS
713	E-50B	C	128	113	21	02C	-0.96	0	<TS
714	E-50B	C	55	114	13	03C	0.2	0	<TS
715	E-50B	C	55	114	13	03C	0.96	0	<TS
716	E-50B	C	61	114	13	04C	0.88	0	<TS
717	E-50B	C	81	114	15	VS5	-0.17	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
718	E-50B	C	109	114	23	VS2	-0.32	0	<TS
719	E-50B	C	109	114	17	VS2	0.05	0	<TS
720	E-50B	C	109	114	36	VS4	-0.62	0	<TS
721	E-50B	C	109	114	32	VS6	-0.54	0	<TS
722	E-50B	C	109	114	6	VS6	0.72	0	<TS
723	E-50B	C	121	114	18	VS4	-0.85	0	<TS
724	E-50B	C	125	114	18	03C	0.81	0	<TS
725	E-50B	C	127	114	18	02C	0.96	0	<TS
726	E-50B	C	22	115	16	04C	-0.77	0	<TS
727	E-50B	C	80	115	16	VS3	0.74	0	<TS
728	E-50B	C	80	115	18	VS4	-0.96	0	<TS
729	E-50B	C	108	115	14	07C	0.84	0	<TS
730	E-50B	C	116	115	22	VS4	0.96	0	<TS
731	E-50B	C	120	115	25	03C	0.86	0	<TS
732	E-50B	C	126	115	12	02C	0.09	0	<TS
733	E-50B	C	126	115	24	02C	0.74	0	<TS
734	E-50B	C	39	116	19	VS4	-0.85	0	<TS
735	E-50B	C	39	116	32	VS4	0.74	0	<TS
736	E-50B	C	107	116	23	VS2	-0.86	0	<TS
737	E-50B	C	107	116	17	VS2	0.13	0	<TS
738	E-50B	C	107	116	25	VS2	0.76	0	<TS
739	E-50B	C	123	116	34	VS6	-0.87	0	<TS
740	E-50B	C	125	116	19	02H	0.9	0	<TS
741	E-50B	C	125	116	18	VS4	-0.77	0	<TS
742	E-50B	C	40	117	17	03C	0.86	0	<TS
743	E-50B	C	74	117	13	VS3	-0.98	0	<TS
744	E-50B	C	116	117	14	03C	-0.87	0	<TS
745	E-50B	C	116	117	19	03C	-0.12	0	<TS
746	E-50B	C	118	117	14	04C	-0.06	0	<TS
747	E-50B	C	124	117	17	VS7	-0.14	0	<TS
748	E-50B	C	124	117	20	04C	0.8	0	<TS
749	E-50B	C	45	118	18	06H	0.24	0	<TS
750	E-50B	C	123	118	28	VS6	-0.81	0	<TS
751	E-50B	C	123	118	16	VS7	-0.92	0	<TS
752	E-50B	C	39	120	22	VS4	1.04	0	<TS
753	E-50B	C	41	120	8	05C	0.77	0	<TS
754	E-50B	C	45	120	14	VS4	-0.46	0	<TS
755	E-50B	C	57	120	17	05C	0.58	0	<TS
756	E-50B	C	69	120	11	03C	0.11	0	<TS
757	E-50B	C	69	120	15	03C	0.86	0	<TS
758	E-50B	C	107	120	13	DBC	1.68	0	<TS
759	E-50B	C	40	121	16	VS4	-0.86	0	<TS
760	E-50B	C	40	121	25	VS4	0.9	0	<TS
761	E-50B	C	76	121	15	04C	0.78	0	<TS
762	E-50B	C	102	121	11	VS2	-0.78	0	<TS
763	E-50B	C	116	121	11	VS2	-0.59	0	<TS
764	E-50B	C	37	122	30	VS4	-0.88	0	<TS
765	E-50B	C	41	122	19	VS4	-0.93	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
766	E-50B	C	41	122	19	VS4	0.66	0	<TS
767	E-50B	C	45	122	25	VS4	-0.92	0	<TS
768	E-50B	C	45	122	30	VS4	0.8	0	<TS
769	E-50B	C	49	122	12	VS4	-0.48	0	<TS
770	E-50B	C	49	122	17	04C	0.91	0	<TS
771	E-50B	C	59	122	17	03C	-0.09	0	<TS
772	E-50B	C	65	122	16	02C	0.74	0	<TS
773	E-50B	C	79	122	17	03H	0.94	0	<TS
774	E-50B	C	40	123	18	VS4	0.49	0	<TS
775	E-50B	C	42	123	32	VS4	0.71	0	<TS
776	E-50B	C	118	123	23	04C	-1	0	<TS
777	E-50B	C	1	124	16	02C	0.91	0	<TS
778	E-50B	C	37	124	25	VS4	-0.79	0	<TS
779	E-50B	C	37	124	26	VS4	0.93	0	<TS
780	E-50B	C	55	124	17	VS3	0.72	0	<TS
781	E-50B	C	69	124	12	03C	-0.72	0	<TS
782	E-50B	C	91	124	13	04C	0.97	0	<TS
783	E-50B	C	115	124	19	05C	-0.73	0	<TS
784	E-50B	C	38	125	17	VS4	-1.04	0	<TS
785	E-50B	C	38	125	36	VS4	0.92	0	<TS
786	E-50B	C	56	125	15	VS4	-0.94	0	<TS
787	E-50B	C	66	125	15	02C	0.83	0	<TS
788	E-50B	C	72	125	19	06C	1.02	0	<TS
789	E-50B	C	100	125	27	VS2	-0.65	0	<TS
790	E-50B	C	100	125	29	VS2	0	0	<TS
791	E-50B	C	100	125	15	VS4	-0.76	0	<TS
792	E-50B	C	100	125	21	VS4	0.94	0	<TS
793	E-50B	C	100	125	16	VS6	0	0	<TS
794	E-50B	C	100	125	18	VS6	0.79	0	<TS
795	E-50B	C	116	125	15	04C	0.19	0	<TS
796	E-50B	C	116	125	18	04C	1	0	<TS
797	E-50B	C	116	125	31	03C	0.97	0	<TS
798	E-50B	C	33	126	18	VS4	0.7	0	<TS
799	E-50B	C	45	126	19	02C	0.84	0	<TS
800	E-50B	C	47	126	31	VS4	-0.91	0	<TS
801	E-50B	C	47	126	31	VS4	1.06	0	<TS
802	E-50B	C	63	126	15	VS3	0.98	0	<TS
803	E-50B	C	69	126	13	VS5	-0.56	0	<TS
804	E-50B	C	81	126	20	07C	0.78	0	<TS
805	E-50B	C	103	126	18	04H	0.93	0	<TS
806	E-50B	C	103	126	28	VS2	0	0	<TS
807	E-50B	C	103	126	32	VS6	0.77	0	<TS
808	E-50B	C	109	126	24	04H	0.78	0	<TS
809	E-50B	C	109	126	13	VS4	0.96	0	<TS
810	E-50B	C	38	127	27	VS4	0.97	0	<TS
811	E-50B	C	44	127	22	02C	0.89	0	<TS
812	E-50B	C	74	127	20	DBH	-1.62	0	<TS
813	E-50B	C	76	127	16	DBH	-1.18	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
814	E-50B	C	112	127	28	03C	-0.03	0	<TS
815	E-50B	C	114	127	18	03C	0.96	0	<TS
816	E-50B	C	37	128	21	VS4	-0.55	0	<TS
817	E-50B	C	37	128	22	VS4	1.04	0	<TS
818	E-50B	C	47	128	28	VS4	-0.85	0	<TS
819	E-50B	C	53	128	19	03C	1.13	0	<TS
820	E-50B	C	69	128	12	03C	0.97	0	<TS
821	E-50B	C	73	128	18	VS4	0.03	0	<TS
822	E-50B	C	79	128	12	03C	0.92	0	<TS
823	E-50B	C	115	128	16	VS4	-0.86	0	<TS
824	E-50B	C	46	129	22	VS4	0.84	0	<TS
825	E-50B	C	48	129	13	03C	-0.08	0	<TS
826	E-50B	C	56	129	12	03C	-0.91	0	<TS
827	E-50B	C	56	129	20	03C	1.01	0	<TS
828	E-50B	C	70	129	16	06C	-0.81	0	<TS
829	E-50B	C	72	129	16	VS5	-0.91	0	<TS
830	E-50B	C	15	130	24	05C	-0.8	0	<TS
831	E-50B	C	45	130	17	VS4	1.15	0	<TS
832	E-50B	C	103	130	15	VS2	-0.27	0	<TS
833	E-50B	C	105	130	20	VS2	-0.84	0	<TS
834	E-50B	C	105	130	14	VS2	-0.27	0	<TS
835	E-50B	C	105	130	16	VS2	0.83	0	<TS
836	E-50B	C	105	130	24	03C	0.78	0	<TS
837	E-50B	C	107	130	20	03H	0.82	0	<TS
838	E-50B	C	109	130	29	02C	0.83	0	<TS
839	E-50B	C	111	130	22	VS4	0.96	0	<TS
840	E-50B	C	113	130	22	VS4	-0.81	0	<TS
841	E-50B	C	38	131	17	VS4	-0.97	0	<TS
842	E-50B	C	38	131	23	VS4	1.06	0	<TS
843	E-50B	C	44	131	20	03C	1.08	0	<TS
844	E-50B	C	48	131	17	VS4	-0.63	0	<TS
845	E-50B	C	52	131	27	VS5	-0.62	0	<TS
846	E-50B	C	108	131	16	03C	0.12	0	<TS
847	E-50B	C	108	131	24	02C	0.83	0	<TS
848	E-50B	C	110	131	16	03C	-0.88	0	<TS
849	E-50B	C	110	131	27	03C	0.9	0	<TS
850	E-50B	C	110	131	16	02C	-0.83	0	<TS
851	E-50B	C	110	131	7	02C	0.06	0	<TS
852	E-50B	C	110	131	16	02C	0.79	0	<TS
853	E-50B	C	39	132	39	VS4	0.7	0	<TS
854	E-50B	C	39	132	18	03C	1.13	0	<TS
855	E-50B	C	41	132	17	VS4	0.84	0	<TS
856	E-50B	C	43	132	14	VS4	1	0	<TS
857	E-50B	C	45	132	17	VS4	0.85	0	<TS
858	E-50B	C	47	132	14	VS4	-0.69	0	<TS
859	E-50B	C	47	132	16	VS4	1.06	0	<TS
860	E-50B	C	53	132	20	02C	0.81	0	<TS
861	E-50B	C	59	132	11	VS4	-0.75	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
862	E-50B	C	63	132	18	VS3	0.77	0	<TS
863	E-50B	C	71	132	13	VS5	0.99	0	<TS
864	E-50B	C	99	132	20	VS2	-0.79	0	<TS
865	E-50B	C	99	132	24	VS2	0.77	0	<TS
866	E-50B	C	99	132	10	VS4	-0.84	0	<TS
867	E-50B	C	99	132	16	VS4	0.9	0	<TS
868	E-50B	C	103	132	16	VS2	0.03	0	<TS
869	E-50B	C	107	132	25	03C	1	0	<TS
870	E-50B	C	109	132	17	05C	0.97	0	<TS
871	E-50B	C	109	132	18	04C	0.14	0	<TS
872	E-50B	C	22	133	24	VS4	0.64	0	<TS
873	E-50B	C	34	133	19	03C	1.01	0	<TS
874	E-50B	C	60	133	19	03C	-0.78	0	<TS
875	E-50B	C	100	133	15	VS4	-0.71	0	<TS
876	E-50B	C	108	133	15	02C	0.28	0	<TS
877	E-50B	C	39	134	26	VS4	-1	0	<TS
878	E-50B	C	39	134	19	VS4	0.82	0	<TS
879	E-50B	C	41	134	14	03C	0.98	0	<TS
880	E-50B	C	51	134	14	03C	-0.83	0	<TS
881	E-50B	C	53	134	17	03C	1.01	0	<TS
882	E-50B	C	67	134	23	06C	-0.97	0	<TS
883	E-50B	C	67	134	14	03C	0.75	0	<TS
884	E-50B	C	69	134	18	VS3	-0.52	0	<TS
885	E-50B	C	69	134	32	VS4	-0.59	0	<TS
886	E-50B	C	69	134	29	VS4	0.85	0	<TS
887	E-50B	C	69	134	18	VS5	-0.56	0	<TS
888	E-50B	C	105	134	25	02C	0.83	0	<TS
889	E-50B	C	38	135	20	VS4	0.21	0	<TS
890	E-50B	C	46	135	15	VS4	-0.51	0	<TS
891	E-50B	C	64	135	12	VS3	-0.73	0	<TS
892	E-50B	C	98	135	22	VS2	0	0	<TS
893	E-50B	C	98	135	25	VS4	-0.56	0	<TS
894	E-50B	C	98	135	26	VS4	0.89	0	<TS
895	E-50B	C	104	135	17	VS4	0.84	0	<TS
896	E-50B	C	45	136	11	VS4	-0.61	0	<TS
897	E-50B	C	63	136	13	VS5	0.82	0	<TS
898	E-50B	C	69	136	17	VS5	-0.99	0	<TS
899	E-50B	C	69	136	12	VS5	0.93	0	<TS
900	E-50B	C	71	136	15	06C	-0.83	0	<TS
901	E-50B	C	71	136	10	06C	-0.14	0	<TS
902	E-50B	C	99	136	15	04C	0.89	0	<TS
903	E-50B	C	101	136	12	03H	0.84	0	<TS
904	E-50B	C	103	136	16	VS4	0.96	0	<TS
905	E-50B	C	6	137	16	04C	-0.92	0	<TS
906	E-50B	C	96	137	11	VS4	-0.31	0	<TS
907	E-50B	C	96	137	20	VS4	0.9	0	<TS
908	E-50B	C	96	137	17	04C	-0.06	0	<TS
909	E-50B	C	102	137	12	VS4	-0.84	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
910	E-50B	C	102	137	17	VS4	0.9	0	<TS
911	E-50B	C	63	138	18	03C	0.72	0	<TS
912	E-50B	C	67	138	22	VS3	0	0	<TS
913	E-50B	C	67	138	18	03C	0	0	<TS
914	E-50B	C	67	138	22	03C	0.83	0	<TS
915	E-50B	C	95	138	39	VS4	0.83	0	<TS
916	E-50B	C	99	138	17	DBH	2.18	0	<TS
917	E-50B	C	96	139	16	VS2	0.98	0	<TS
918	E-50B	C	96	139	21	03C	-0.89	0	<TS
919	E-50B	C	96	139	12	03C	0.83	0	<TS
920	E-50B	C	98	139	26	VS4	0.44	0	<TS
921	E-50B	C	98	139	21	VS4	0.71	0	<TS
922	E-50B	C	45	140	20	VS4	0.88	0	<TS
923	E-50B	C	47	140	17	VS4	0.91	0	<TS
924	E-50B	C	69	140	18	VS5	-0.95	0	<TS
925	E-50B	C	69	140	11	VS5	0.77	0	<TS
926	E-50B	C	83	140	12	VS3	-0.71	0	<TS
927	E-50B	C	95	140	17	03C	-1.08	0	<TS
928	E-50B	C	97	140	15	VS4	-0.9	0	<TS
929	E-50B	C	18	141	14	03C	-1.07	0	<TS
930	E-50B	C	70	141	16	VS3	-0.77	0	<TS
931	E-50B	C	76	141	17	DBH	1.7	0	<TS
932	E-50B	C	78	141	10	VS3	-0.81	0	<TS
933	E-50B	C	78	141	10	VS4	-0.83	0	<TS
934	E-50B	C	96	141	17	VS2	1.1	0	<TS
935	E-50B	C	96	141	20	VS4	0.49	0	<TS
936	E-50B	C	49	142	18	DBC	-0.47	0	<TS
937	E-50B	C	95	142	23	VS4	0.99	0	<TS
938	E-50B	C	95	142	13	VS6	-0.87	0	<TS
939	E-50B	C	2	143	17	02C	0.99	0	<TS
940	E-50B	C	68	143	16	06H	0.75	0	<TS
941	E-50B	C	82	143	28	VS3	-0.61	0	<TS
942	E-50B	C	82	143	20	VS4	-0.49	0	<TS
943	E-50B	C	55	144	19	VS3	-0.39	0	<TS
944	E-50B	C	61	144	14	06H	0.76	0	<TS
945	E-50B	C	69	144	16	VS3	-0.89	0	<TS
946	E-50B	C	69	144	21	VS5	-0.95	0	<TS
947	E-50B	C	71	144	28	VS3	-0.97	0	<TS
948	E-50B	C	71	144	19	VS3	1	0	<TS
949	E-50B	C	91	144	14	VS4	-0.84	0	<TS
950	E-50B	C	91	144	14	VS4	0.92	0	<TS
951	E-50B	C	38	145	10	VS4	-0.94	0	<TS
952	E-50B	C	38	145	13	VS4	0.97	0	<TS
953	E-50B	C	56	145	18	04C	-0.78	0	<TS
954	E-50B	C	80	145	31	VS4	-0.7	0	<TS
955	E-50B	C	80	145	21	VS5	0.89	0	<TS
956	E-50B	C	82	145	24	VS3	-0.59	0	<TS
957	E-50B	C	82	145	18	VS3	1.02	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
958	E-50B	C	82	145	19	VS4	-0.62	0	<TS
959	E-50B	C	82	145	27	VS4	0.95	0	<TS
960	E-50B	C	49	146	14	VS4	-0.33	0	<TS
961	E-50B	C	71	146	17	VS4	1.15	0	<TS
962	E-50B	C	71	146	30	VS5	-1.03	0	<TS
963	E-50B	C	87	146	20	VS4	-0.64	0	<TS
964	E-50B	C	87	146	31	03C	0.89	0	<TS
965	E-50B	C	38	147	23	VS4	-1.09	0	<TS
966	E-50B	C	38	147	11	VS4	0.97	0	<TS
967	E-50B	C	66	147	13	VS3	-0.92	0	<TS
968	E-50B	C	66	147	14	VS3	0.89	0	<TS
969	E-50B	C	70	147	15	VS3	-0.85	0	<TS
970	E-50B	C	37	148	19	VS4	-1	0	<TS
971	E-50B	C	45	148	10	VS4	-0.85	0	<TS
972	E-50B	C	45	148	13	VS4	0.94	0	<TS
973	E-50B	C	45	148	15	06C	-0.28	0	<TS
974	E-50B	C	47	148	13	04C	0.95	0	<TS
975	E-50B	C	81	148	14	VS4	-0.93	0	<TS
976	E-50B	C	81	148	17	VS4	1.06	0	<TS
977	E-50B	C	81	148	17	04C	0.84	0	<TS
978	E-50B	C	83	148	22	VS4	-0.96	0	<TS
979	E-50B	C	4	149	8	04C	-0.85	0	<TS
980	E-50B	C	66	149	19	06H	0.84	0	<TS
981	E-50B	C	72	149	27	DBH	1.68	0	<TS
982	E-50B	C	80	149	21	01H	-0.76	0	<TS
983	E-50B	C	1	150	17	01C	-0.86	0	<TS
984	E-50B	C	1	150	17	01C	-0.14	0	<TS
985	E-50B	C	39	150	23	VS4	0.85	0	<TS
986	E-50B	C	67	150	16	VS3	-0.7	0	<TS
987	E-50B	C	67	150	16	VS3	0.9	0	<TS
988	E-50B	C	69	150	23	VS3	-0.78	0	<TS
989	E-50B	C	69	150	18	VS3	0.87	0	<TS
990	E-50B	C	69	150	11	VS4	0.92	0	<TS
991	E-50B	C	69	150	16	VS5	0.77	0	<TS
992	E-50B	C	77	150	22	DBH	2	0	<TS
993	E-50B	C	77	150	9	VS3	-0.84	0	<TS
994	E-50B	C	77	150	13	VS4	-0.82	0	<TS
995	E-50B	C	77	150	19	VS4	0.82	0	<TS
996	E-50B	C	46	151	27	VS4	0.73	0	<TS
997	E-50B	C	68	151	19	VS3	-0.67	0	<TS
998	E-50B	C	68	151	10	VS5	0.83	0	<TS
999	E-50B	C	71	152	13	VS4	0.83	0	<TS
1000	E-50B	C	71	152	16	VS5	0.96	0	<TS
1001	E-50B	C	30	153	13	VS4	-0.52	0	<TS
1002	E-50B	C	70	153	14	VS4	-0.86	0	<TS
1003	E-50B	C	70	153	13	VS4	0.91	0	<TS
1004	E-50B	C	70	153	15	03C	0.19	0	<TS
1005	E-50B	C	37	154	16	VS4	-0.06	0	<TS

NO.	S/G	LEG	ROW	COL	PERCENT	LOCATION	ELEV FROM	ELEV TO	STATUS
1006	E-50B	C	41	154	11	VS4	-0.8	0	<TS
1007	E-50B	C	41	154	14	VS4	0.83	0	<TS
1008	E-50B	C	61	154	11	VS5	0.86	0	<TS
1009	E-50B	C	33	156	13	VS4	-0.86	0	<TS
1010	E-50B	C	37	156	22	VS4	-0.79	0	<TS
1011	E-50B	C	37	156	27	VS4	1.18	0	<TS
1012	E-50B	C	51	156	20	VS5	-0.87	0	<TS
1013	E-50B	C	50	157	22	01H	-0.97	0	<TS
1014	E-50B	C	1	158	20	02C	0.91	0	<TS
1015	E-50B	C	33	158	20	02C	0.84	0	<TS
1016	E-50B	C	49	158	17	01C	0.06	0	<TS
1017	E-50B	C	44	159	13	01H	-1	0	<TS
1018	E-50B	C	46	159	13	01C	0.19	0	<TS
1019	E-50B	H	1	160	11	04H	-0.14	0	<TS
1020	E-50B	H	1	160	17	04H	0.89	0	<TS
1021	E-50B	C	37	160	15	VS4	-0.56	0	<TS
1022	E-50B	C	37	160	16	VS4	0.85	0	<TS
1023	E-50B	C	39	160	17	02H	0.72	0	<TS
1024	E-50B	C	38	161	26	02H	0.83	0	<TS
1025	E-50B	H	2	163	15	02H	0.96	0	<TS
1026	E-50B	C	22	163	17	02C	0.75	0	<TS
1027	E-50B	C	1	164	21	02C	-0.85	0	<TS
1028	E-50B	C	11	164	21	04C	0.84	0	<TS
1029	E-50B	C	11	164	17	02C	-0.94	0	<TS
1030	E-50B	C	19	164	19	02C	0.84	0	<TS
1031	E-50B	C	2	165	18	01C	0.93	0	<TS
1032	E-50B	C	6	165	17	02C	-0.88	0	<TS
1033	E-50B	C	8	165	19	02C	-0.89	0	<TS
1034	E-50B	C	10	165	20	02H	0.7	0	<TS