BY KML DATE
CHKD. BY DATE

SUBJECT NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
SHEET NO. OF
JOB NO. 2520-02

REV. NO. NO3

IL-E-70-3 SHT. NO. 107C

DWG. NO. I.D.-105 SHEET-4

INSTALLATION DETAILS-TEMPERATURE DETECTORS FOR NUCLEAR BOILER SYSTEMS LEAK DETECTION

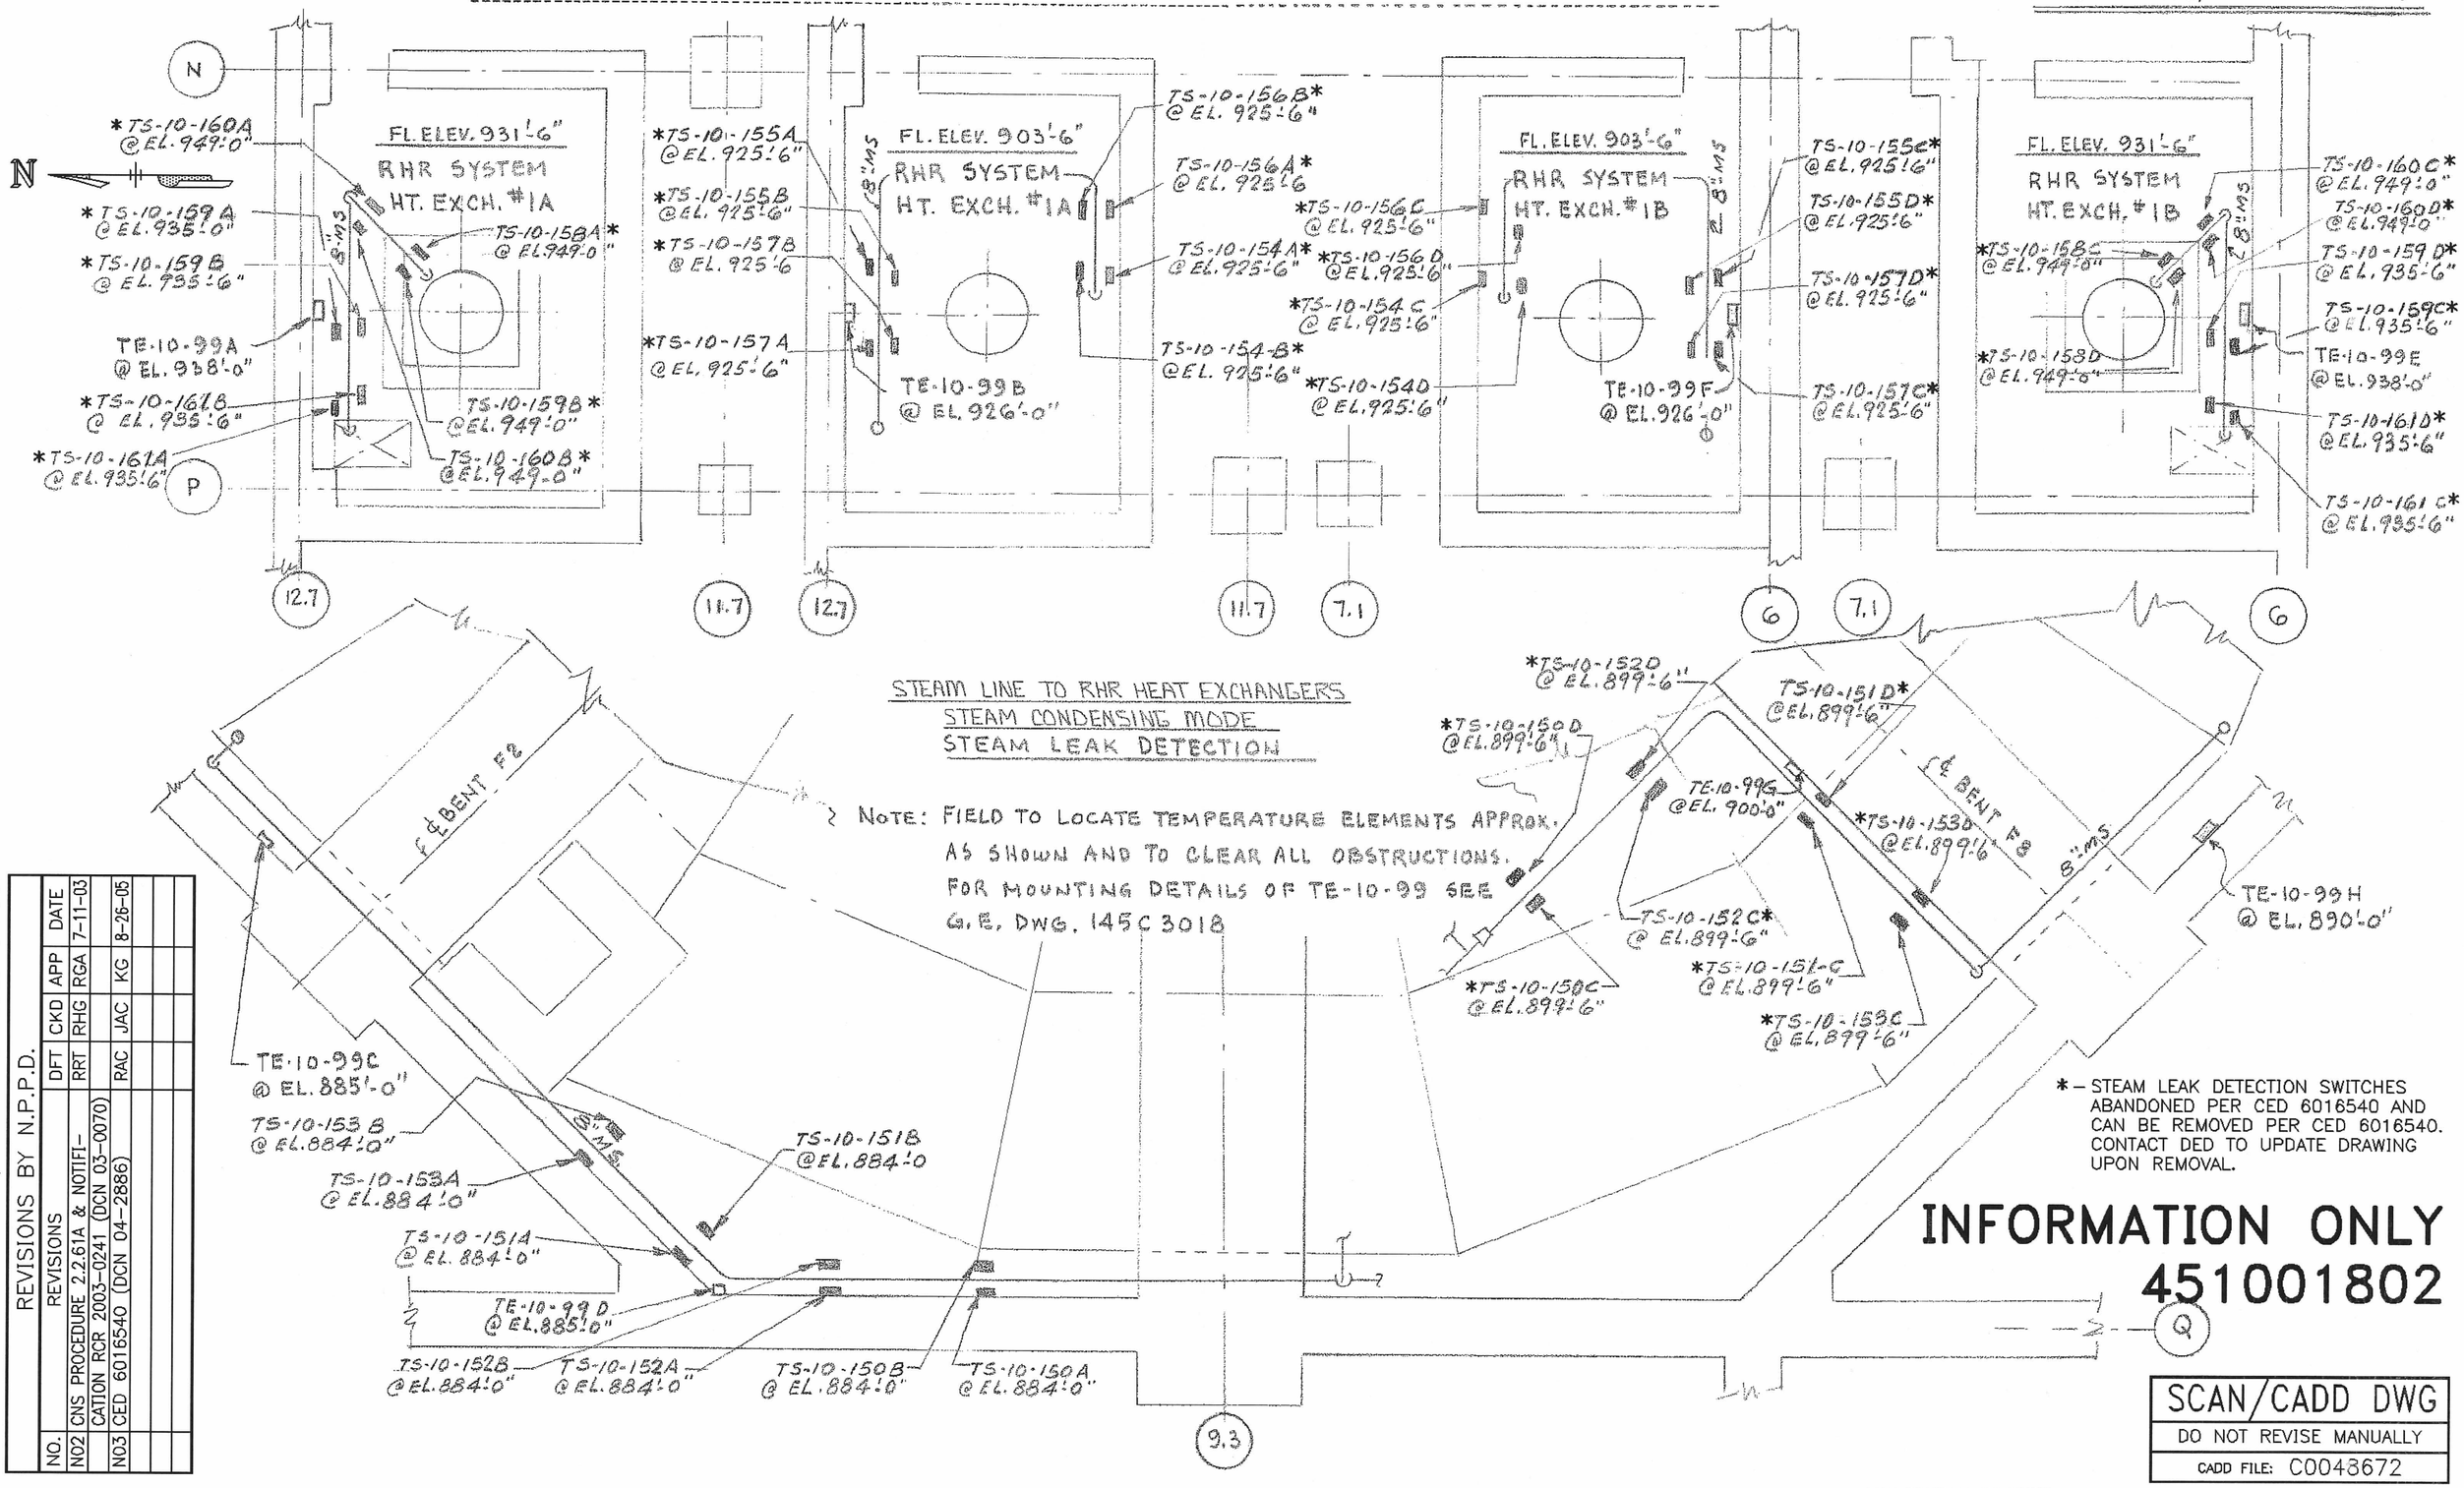

*– STEAM LEAK DETECTION SWITCHES ABANDONED PER CED 6016540 AND CAN BE REMOVED PER CED 6016540. CONTACT DED TO UPDATE DRAWING UPON REMOVAL.

INFORMATION ONLY
451001802

FOR PREVIOUS REVISIONS, SEE SUPERSEDED CARDS.

REVISIONS BY N.P.P.D.

NO.	REVISIONS	DFT	CKD	APP	DATE
NO2	CNS PROCEDURE 2.2.61A & NOTIFICATION RCR 2003-0241 (DCN 03-0070)	RRT	RHG	RGA	7-11-03
NO3	CED 6016540 (DCN 04-2886)	RAC	JAC	KG	8-26-05

SCAN/CADD DWG
DO NOT REVISE MANUALLY
CADD FILE: C0048672

NON CONTROLLED PRINT
MAR 20 2007
N.P.P.D., RIMS

D-66