

APPENDIX 19B EX-VESSEL SEVERE ACCIDENT PHENOMENA

One of the key AP1000 severe accident design features is the capability to retain the core debris within the reactor vessel for a large number of severe accident sequences by flooding the reactor cavity and submerging the outer surface of the reactor vessel. The heat removal capability of the water on the external surface of the reactor vessel prevents the reactor vessel wall from reaching temperatures where failure of the reactor vessel could occur. This has been termed in-vessel retention (IVR) and is described in detail in Chapter 39 of the AP1000 Level 2 PRA. The primary benefit of in-vessel retention of the core is that ex-vessel severe accident phenomena associated with relocation of core debris to the containment, which can be a dominant containment failure mechanism, are physically prevented. Thus, retention of the core within the reactor vessel results in a significant reduction in the potential for large fission product releases to the environment for core damage accidents.

The probability of various levels of fission product releases (release categories) has been determined in the AP1000 Level 2 PRA, using a containment event tree which describes the various severe accident phenomena that can impact the fission product release quantities and probability of release. In the quantification of the AP1000 Level 2 PRA it was conservatively assumed that the containment would fail at the time of reactor vessel failure for all core damage sequences in which the core debris could not be retained within the reactor vessel. The two principle ways identified in the Level 2 PRA of retaining the core within the reactor vessel are reflooding the core with water before the core begins to relocate within the reactor vessel and submerging the outer surface of the reactor vessel to the reactor coolant loop nozzles. Using this approach, the regulatory and industry severe accident performance targets for the AP1000 design criteria were met. Therefore, it was considered unnecessary to investigate the consequences of reactor vessel failure on a realistic basis, including quantification of uncertainties.

The AP1000 design includes features to enhance the likelihood of retaining the core within the reactor vessel for severe accident sequences. These features include:

- Depressurization of the reactor coolant system (RCS) in the event of an accident by either automatic or manual actuation of the highly reliable automatic depressurization system (ADS)
- A containment layout wherein the water relieved from the reactor coolant system (either from the ADS discharge or a break in the RCS) accumulates in the reactor cavity region
- The capability to manually initiate flooding of the reactor cavity by gravity draining the in-containment refueling water storage tank (IRWST) into the reactor cavity
- The absence of in-core penetrations in the reactor vessel bottom head eliminates a possible reactor vessel failure mode
- The reactor cavity layout provides for rapid flooding of the reactor vessel to the reactor coolant loop nozzle elevation

- The reactor vessel insulation design promotes the two-phase natural circulation in the vessel cooling annulus
- The external reactor vessel surface treatment is bare metal

Some of the AP1000 design features to reduce the probability of a core damage accident and to enhance the likelihood of in-vessel retention of core debris in the event of a core damage accident are counter to the design philosophy that would be used to mitigate the consequences of ex-vessel severe accident phenomena. In particular, two of the design features are mutually exclusive between preventing ex-vessel phenomena and mitigating the consequences of ex-vessel phenomena. On balance, the AP1000 severe accident risk profile is substantially reduced by the features that prevent ex-vessel severe accident phenomena. Two of the more noteworthy features are:

- The large mass of the AP1000 core provides for a slower accident progression, which enhances the capability to prevent a core damage accident (i.e., a reduced core damage frequency). The larger mass of core materials may result in more severe consequences from some of the potential ex-vessel phenomena such as core debris coolability and core concrete interactions.
- The small reactor cavity floor area reduces the amount of water required to completely submerge the reactor vessel. The small cavity floor area also provides for a more rapid flooding of the cavity if manual initiation of IRWST draining to the reactor cavity is required to submerge the reactor vessel. The small reactor cavity floor area may result in more severe consequences from some of the severe accident ex-vessel phenomena such as core debris coolability and core concrete interactions.

The purpose of this section is to provide the results of a limited number of deterministic investigations of the consequences of ex-vessel severe accident phenomena for the AP1000 design. The results of these deterministic investigations show that the challenges to the integrity of the containment posed by ex-vessel severe accident phenomena are generally within the structural capability of the containment. From these investigations, the conclusion is the capability to prevent large fission product releases to the environment does not depend on the ability to retain the core within the reactor vessel for core damage accident sequences.

The limited deterministic investigations of ex-vessel severe accident phenomena described in this section includes: ex-vessel steam explosions, direct containment heating and core concrete interactions. These ex-vessel phenomena are strongly dependent on the assumptions made concerning the mode of reactor vessel failure for the AP1000 design. Therefore, the reactor vessel failure mode is described first, followed by a description of the ex-vessel phenomena investigations.

19B.1 Reactor Vessel Failure

The AP1000 reactor vessel has a main cylindrical section approximately 4 meters in diameter and a hemispherical bottom head. The bottom head is approximately 15 cm (6 inches) thick and is made of carbon steel with an inner cladding of stainless steel to prevent contact between reactor

coolant and carbon steel during normal plant operations. The bottom head of the reactor vessel does not contain any discontinuities or penetrations that could impact the mode of reactor vessel failure as the molten core material relocates to the bottom head.

Based on the similar vessel configurations of AP600 and AP1000, the possible failure modes for the AP600 reactor vessel, as documented in Reference 19B-1, are extended to the AP1000. The most likely failure mode is creep failure of the vessel wall due to heating of the vessel wall by the core debris that has relocated to the reactor vessel bottom head. Since creep failure is a strongly temperature-dependent phenomena, the location of the failure is predicted to be at the upper surface of the core debris pool that has relocated to the reactor vessel bottom head. For most severe accident sequences, this location is near the junction of the hemispherical bottom head and the cylindrical portion of the vessel.

As described in Reference 19B-2, the presence of water on the external surface of the reactor vessel, as in the case of a flooded reactor cavity, does not alter the conclusion that the highest heat fluxes to the reactor vessel walls will be at a point near the top of the in-vessel molten core pool. This would correspond to the region of the reactor vessel most susceptible to creep failure. However, reactor vessel failure will not occur for the case in which the reactor coolant system is depressurized and the reactor cavity is filled with water to the reactor coolant loop elevation.

For the case in which the outside of the reactor vessel is initially submerged but a sufficient in-flow of water to the reactor cavity cannot be maintained, the reactor vessel wall location experiencing the highest heat fluxes would uncover and lose its external cooling before other locations on the reactor vessel lower head. Thus, creep failure of the vessel would be expected to occur at the same location as the case with no water in the reactor cavity.

Two reactor vessel failure cases, as described below, are carried through the deterministic analyses of ex-vessel steam explosions and core concrete interactions. For the consideration of ex-vessel steam explosions and core concrete interactions, it is assumed that the reactor vessel is initially submerged in water but that gravity draining of water from the IRWST does not occur. As the water in the reactor cavity boils down, the outside of the reactor vessel at the elevation at the top of the in-vessel core pool will dry out and begin to heat up. As the vessel wall heats up, it undergoes thinning due to dissolution and melting until failure occurs. The manner in which the reactor vessel fails is treated in two separate scenarios described below.

In the first scenario, the formation of a localized opening occurs due to asymmetric heating around the circumference followed by the vessel tearing around nearly all of its circumference. This would result in the bottom part of the reactor vessel and the bottom head hinging such that the lower head swings downward and comes to rest on the cavity floor. This behavior is illustrated in Figure 19B-1. A hinging type of failure would result in an immediate pouring of core debris onto the cavity floor with metal flowing ahead of oxide. The relationship between the height of the reactor vessel above the floor is such that all but a minor part of the oxide melt would be free to flow immediately out of the head.

In the second scenario, the head and bottom part of the vessel do not hinge downward. In this scenario, the formation of a localized opening permits molten core debris to drain into the cavity lowering the in-vessel core debris depth and thereby decreasing the thermal load on the vessel

wall formerly adjacent to the melt. This type of failure is illustrated in Figure 19B-2. In this case, the continued boildown of water level is followed by the release of the core debris located above the water level after a delay interval during which heatup, thinning, and localized failure of the wall will occur. Over time, the elevation of the failure location moves downward over the vessel wall and lower head. This type of failure gives rise to a very slow release rate with the core debris first relocating downward through the water before collecting and spreading on the cavity floor.

19B.2 Direct Containment Heating

Direct containment heating (DCH) is defined as the rapid energy addition to the containment atmosphere as a result of several physical and chemical processes that can occur if the core debris is forcibly ejected from the reactor vessel. The prerequisites for direct containment heating are vessel failure occurs at a location where a substantial portion of the core debris that has relocated to the lower head is ejected into the reactor cavity before the RCS gases are discharged from the RCS and the RCS is at a high pressure (sometimes called high pressure melt ejection or HPME).

To preclude the potential for high-pressure core melt ejection leading to containment failure via DCH, SECY-93-087 (Reference 19B-4) directs passive light water reactor (LWR) designs to:

- Provide a reliable depressurization system
- Provide cavity design features to decrease the amount of ejected core debris that reaches the upper compartment

The AP1000 design incorporated design features that prevent high-pressure core melt. These features include the passive residual heat removal (PRHR) system and the ADS, both subsystems of the passive core cooling system (PXS). Depressurization of the AP1000 RCS in the event of an accident is provided by automatic or manual actuation of the ADS. Redundancy and diversity are included within the ADS design to ensure a highly reliable depressurization system. The ADS consists of four different valve stages that open sequentially to reduce reactor coolant system pressure in a controlled fashion. All four-valve stages are arranged into two identical groups. Different valve types/sizes are utilized within the ADS stages to provide diversity. Based on these ADS design features, a highly reliable depressurization system is provided which precludes the potential for high-pressure core melt ejection in the AP1000 design. The AP1000 PRHR and ADS subsystems are described in additional detail in Chapters 8 and 11 of the AP1000 PRA and in Section 6.3 of the *AP1000 Design Control Document* (DCD).

Even though high-pressure core melt ejection is not a likely scenario for the AP1000, SECY-93-087 directs passive LWR designs to include cavity design features to decrease the amount of ejected core debris from reaching the upper compartment. The AP1000 design includes design features to retain and quench the core debris within the reactor cavity in the unlikely event of core debris relocation outside the reactor vessel. These features include:

- A containment layout wherein the water accumulates in the reactor cavity region
- The capability to manually initiate flooding of the reactor cavity by gravity draining the IRWST into the reactor cavity

- The reactor cavity geometry is arranged to provide a torturous pathway from the reactor cavity to the loop compartment and no direct pathway for the impingement of debris on the containment shell

19B.3 Ex-Vessel Steam Explosions

The first level of defense for ex-vessel steam explosion is the in-vessel retention of the molten core debris. If molten debris does not relocate from the vessel to the containment, there are no conditions for ex-vessel steam explosion. In the event that the reactor cavity is not flooded and the vessel fails, the PRA containment event tree assumes that the containment fails in the early time frame.

An analysis of the structural response of the reactor cavity was performed for the AP600 (Reference 19B-3). As in the in-vessel steam explosion analysis, the results of this AP600 ex-vessel steam explosion analysis are extended to the AP1000. The vessel failure modes for AP600 and AP1000 are the same. The initial debris mass participating in the interaction, superheat and composition are assumed to be the same as for AP600. The mass assumption is conservative since the AP1000 reactor vessel lower head is closer to the cavity floor resulting in less debris mass participating in the interaction. The reactor cavity geometry and water depth prior to vessel failure are the same as AP600. Therefore, the results of the AP600 ex-vessel steam explosion analysis are considered to be appropriate for the AP1000.

19B.4 Core Concrete Interactions

If the reactor vessel fails when the RCS is at a low pressure, the molten core debris will pour from the reactor vessel onto the reactor cavity floor. If a steam explosion does not occur, the pour will spread over the cavity floor and begin to transfer heat to the concrete floor of the reactor cavity. Due to the predicted mode of reactor vessel failure and the shape of the AP600 reactor cavity, analyses of the possible spreading of the core debris over the cavity floor were conducted. The results were used as input to the MAAP4 code for analysis of core concrete interactions for AP1000.

An investigation of the spreading of core debris that pours into the reactor cavity was conducted for reactor vessel failure that occurs at low RCS pressure. The investigation considered the vessel failure mode and location, as well as the recognition that the oxide and metal components of the in-vessel core debris are predicted to be separated. Since the oxide and metal components of the core debris have very different physical characteristics (e.g., viscosity or heat capacity), the separated in-vessel layers influence the spreading of the core debris in the reactor cavity. The melt spreading analysis was conducted for two reactor vessel failure modes, hinged and localized failures.

For the hinged vessel failure case, the analysis results show that the core debris is spread relatively uniformly over the reactor cavity floor. However, the distribution of the metal and oxide components of the core debris are not uniformly distributed over the reactor cavity floor. In the region directly under the reactor vessel, the core debris consists primarily of the oxide component. At the opposite end of the reactor cavity, the core debris consists mainly of the metal component

of the core debris released from the reactor vessel. The core debris is still almost totally molten at the end of the spreading analysis.

A different behavior is predicted for the localized reactor vessel failure case. The analysis predicts that the core debris will accumulate at the reactor vessel end of the reactor cavity. The distribution of the metal and oxide components of the core debris are not uniformly distributed over the reactor cavity floor. In the region directly under the reactor vessel, the core debris consists primarily of the oxide component. At the opposite end of the reactor cavity, the core debris consists mainly of the metal component of the core debris released from the reactor vessel. The core debris is almost totally frozen at the end of the spreading analysis.

The core concrete interactions for the AP1000 design were analyzed for two concrete types: basaltic concrete and common limestone-sand concrete. The common limestone-sand concrete has a significantly higher noncondensable gas generation rate, compared to basaltic concrete and should therefore present a more severe containment pressurization transient. On the other hand, the basaltic concrete suffers higher ablation rate, due to its physical properties (mainly, its lower decomposition energy), and should therefore present a more severe basemat penetration failure mode, compared to common limestone-sand concrete. In all cases, a 3.5 m deep water pool is initially present in the cavity while debris is being released into it.

Based on analyses, it can be concluded that: a) the goal of protecting the containment fission product boundary during the first 24 hours of a core melt accident is met, b) it is not necessary to specify a concrete type for the containment basemat since credible containment basemat failure that could lead to fission product releases to the atmosphere are likely to occur at times well beyond 24 hours, and c) the reactor cavity sump is adequately protected such that it is not a weakness in containment basemat integrity during postulated accidents that lead to core concrete interactions.

19B.4.1 Containment Pressurization due to Core Concrete Interactions

The containment pressurization due to steam and noncondensable gas generation during the episodes of core concrete interactions described above was assessed to determine the effect of core concrete interactions on the containment integrity.

The indicator of a challenge to containment integrity for the containment pressurization due to the noncondensable gases produced from core concrete interactions is the Service Level “C” pressure, which is 91 psig (0.73 MPa). This is well below the 50 percent containment failure probability value of 135 psig (1.03 MPa).

The results also show that, in all cases the containment does not pressurize to Service Level “C” containment challenge indicator value prior to the time that the core debris completely penetrates the containment basemat. Thus, for these cases there is no potential challenge to containment integrity due to overpressurization since: a) there is no longer a source of mass and energy input to the containment after the core debris penetrates the entire basemat, and b) basemat penetration assures that the containment will be depressurized through the basemat failure.

Based on these analyses, it can be concluded that it is not necessary to specify a concrete type for the containment basemat since containment overpressure failure due to non-condensable gas generation from core concrete interactions is not likely for any credible severe accident scenarios.

19B.5 Conclusions

The results of the limited deterministic analyses of ex-vessel severe accident phenomena presented in this section show that early containment failure is not a certainty if the reactor vessel fails. Based on the deterministic analyses, direct containment heating that might ensue from a high pressure melt ejection would not challenge the integrity of the containment. Ex-vessel steam explosions, assessed on a very conservative basis would not produce impulse loads that would challenge the integrity of the containment due to localized failures of the reactor cavity floor and walls. In addition, these analyses indicate that the ex-vessel steam explosion loads are not strong enough to displace the reactor vessel from its location inside the biological shield. Thus, there is no challenge to any containment penetrations connected to the reactor vessel or to the reactor coolant loops. In the case of a vessel failure at a low RCS pressure, the core concrete interactions analyses indicate that the containment integrity would not be challenged in the first 24 hours of the event and thus no significant releases of fission products are predicted in that time frame.

Thus, it is concluded that prevention of large fission product releases to the environment is not dependent on the integrity of the reactor vessel. If reactor vessel failure occurs, there may be challenges to the containment integrity, but these challenges are highly uncertain and the most likely challenge (containment failure by core penetration of the cavity basemat) would not occur in the first 24 hours of the accident. Thus, the AP1000 assumption that reactor vessel failure always leads to containment failure is a conservatism in the AP1000 risk profile.

19B.6 References

- 19B-1 “AP600 Phenomenological Evaluation Summaries,” WCAP-13388 (Proprietary) Rev. 0, June 1992 and WCAP-13389 (Nonproprietary), Rev. 1, 1994.
- 19B-2 Theofanous, T. G., et al., “In-Vessel Coolability and Retention of a Core Melt,” DOE/ID-10460, July 1995.
- 19B-3 “AP600 Probabilistic Risk Assessment,” GW-GL-022, August 1998.
- 19B-4 “Policy, Technical, and Licensing Issues Pertaining to Evolutionary and Advanced Light-Water Reactor (ALWR) Design,” SECY-93-087, dated April 2, 1993.

TABLE 19B-1 NOT INCLUDED IN THE DCD.

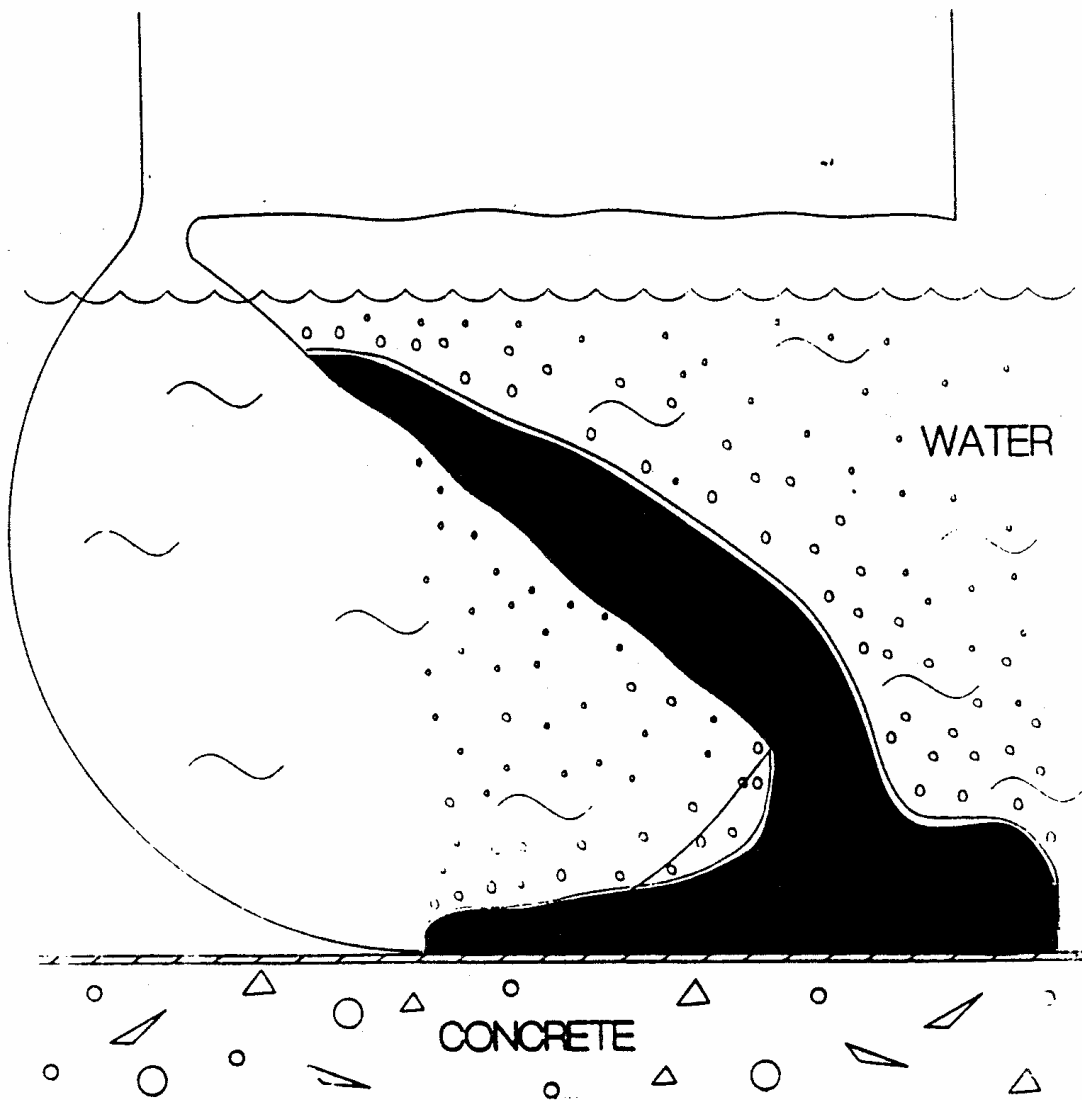


Figure 19B-1

**Illustration of Hinging Type of Failure Resulting
in Rapid Melt Release**

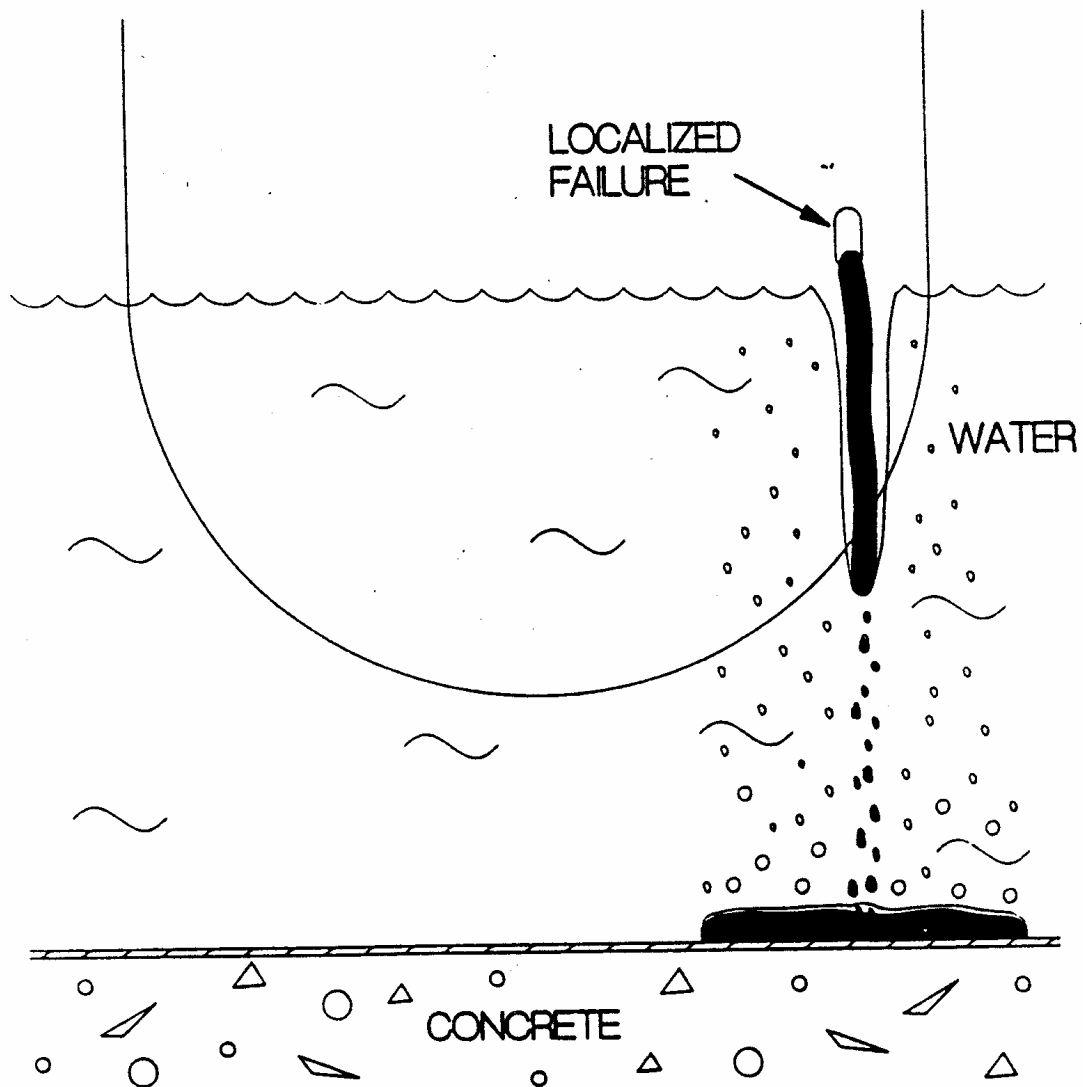


Figure 19B-2

**Illustration of Localized Type of Failure Resulting
in Slow Melt Release**

FIGURES 19B-3 THROUGH 19B-8b NOT INCLUDED IN THE DCD.