

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Sensitivity of Parameters Affecting Seismic Risk

19th International Conference on
Structural Mechanics in Reactor Technology (SMiRT-19)
August 12-17, 2007

Biswajit Dasgupta, Center for Nuclear Waste Regulatory Analyses
Mahendra Shah, U.S. Nuclear Regulatory Commission
Asadul Chowdhury, Center for Nuclear Waste Regulatory Analyses

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

DISCLAIMER

This paper is an independent product of the CNWRA and does not necessarily reflect the view, nor regulatory position of NRC. The NRC staff views expressed herein are preliminary and do not constitute a final judgment, nor determination of the matters addressed, nor of the acceptability of a license application for a geologic repository at Yucca Mountain

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Outline

- Purpose
- Seismic Risk
- Regulatory Context
- Seismic hazard and fragility curves
- Annual probability of unacceptable performance, P_F
- Parametric study
- Results
- Conclusions

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Purpose

This study provides insights on sensitivity of seismic risk to parameters in the hazard and fragility curves

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Seismic Risk

- The probability of occurrence of a seismically initiated event sequence depends on performance of structures, systems, or components (SSCs) in the event sequence

- The mean annual probability of unacceptable performance of an SSC during a seismic event, or seismic risk, is determined by convolving the mean seismic hazard curve with the mean fragility curve of the SSC

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Regulatory Context

- The *Code of Federal Regulations*, Title 10, Part 63, for licensing of the potential repository at Yucca Mountain, NV, requires U.S. Department of Energy (DOE) to
  - comply with dose performance objectives
  - perform preclosure safety analysis and evaluate potential event sequences for hazards, including seismic events

- Dose performance objectives can be met by showing that
  - a potential event sequence that may release radioactivity has a chance of less than 1 in 10,000 of occurring before permanent closure; or
  - radiological dose resulting from the event sequence is less than the regulatory dose performance objective

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Seismic Hazard and Fragility Curves

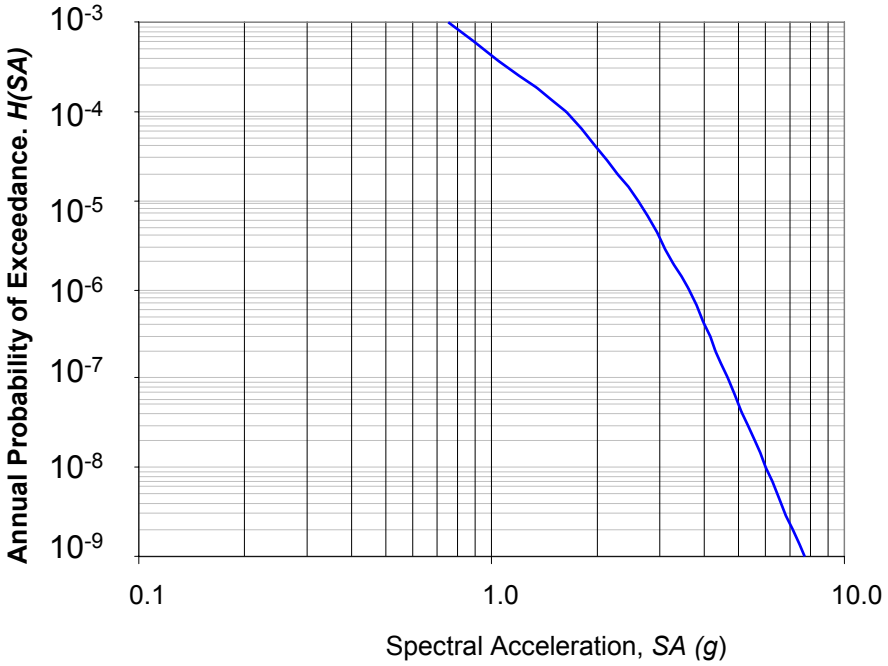

An Example Seismic Hazard Curve, *H(a)*, for Spectral Acceleration at 10 Hz

(*a* represents spectral acceleration *SA*)

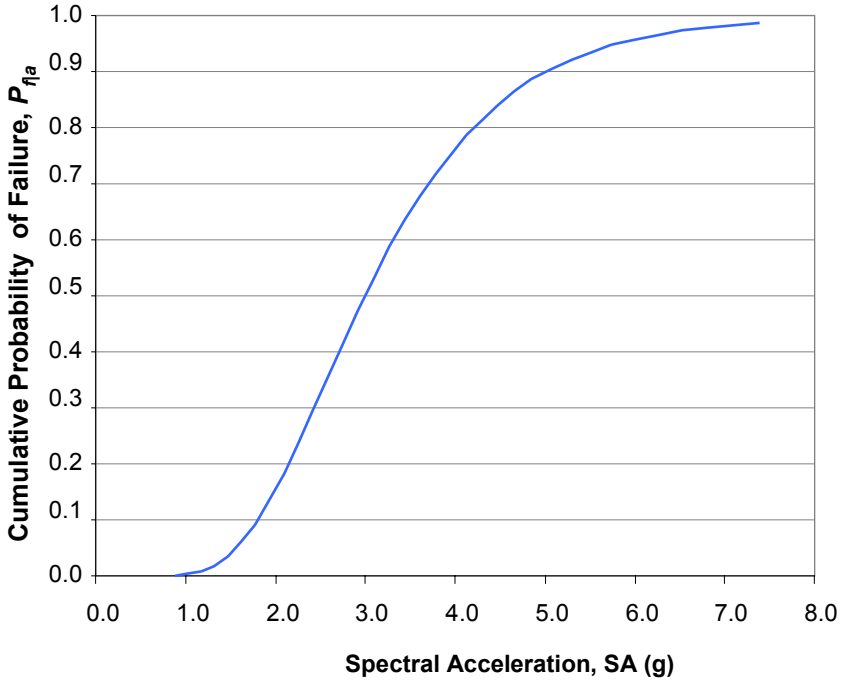

An Example Fragility Curve, $P_{f|a}$ with $C_{50\%}$ = 3.0 g and β = 0.4 for Spectral Acceleration at 10 Hz

$C_{50\%}$ - median capacity
β - log standard deviation

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Annual Probability of Unacceptable Performance, P_F

$$P_F = \int_0^{\infty} P_{f|a} \left(-\frac{dH(a)}{da} \right) da$$

Numerical Integration

Hazard curve discretized into N equal intervals

Product of hazard exceedance value and fragility for each segment

Sum product over N intervals

$$P_F = 2.26\text{x}10^{-5}$$

Closed-Form Solution

$$H(a) = K_1 a^{-K_H}, \; K_H = 1/\log(A_R)$$

$$P_F = K_1 (C_{50\%})^{-K_H} e^{0.5(K_H \beta)^2}$$

$$P_F = 3.4\text{x}10^{-5}$$

A_R - seismic hazard curve slope parameter
K_1 - constant

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Annual Probability of Unacceptable Performance, P_F (continued)

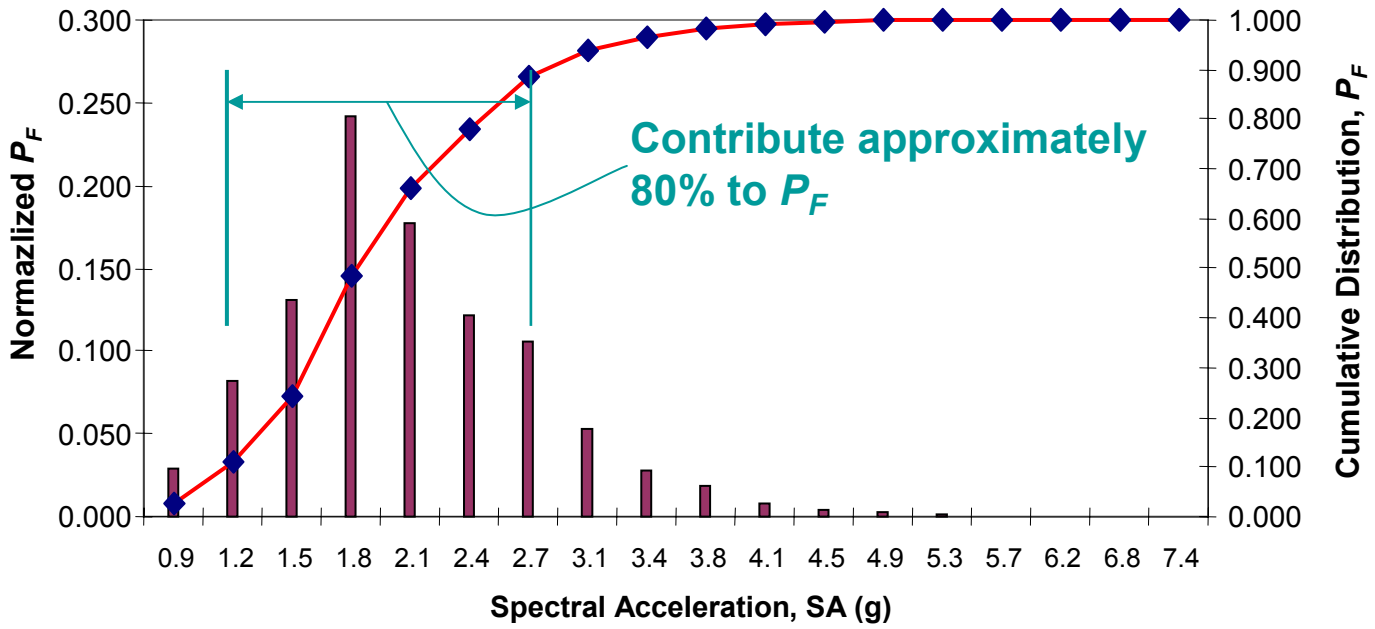

Histogram and cumulative distribution of P_F vs. spectral acceleration - numerical integration

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Parametric Study

Effects of the following parameters on P_F were studied:

A. Discretization steps - numerical integration

B. Low-probability range of the seismic hazard curve - numerical integration

C. Slope of the hazard curve – closed-form solution

D. Log standard deviation of the fragility curve, β - numerical integration

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

A. Discretization Steps – Numerical Integration

n Number of discretization steps	P_F (x10^{-5})	Ratio = $P_{F,n} / P_{F,120}$
6	2.018	0.8835
12	2.235	0.9785
18	2.263	0.9908
24	2.272	0.9947
30	2.277	0.9969
60	2.283	0.9996
120	2.284	1.0000

Provides reasonable accuracy

Note: H(a) and $P_{f|a}$, as shown in Slide 6

B. Low-Probability Range of the Seismic Hazard Curve – Numerical Integration

(1)	(2)	(3)
Annual Probability of Exceedance of Hazard Curve, *H(SA)*	**Probability of Unacceptable Performance, P_F ($\times 10^{-5}$)**	**Ratio Column 2/P_F @ 10^{-9}**
10^{-5}	1.766	0.78
10^{-6}	2.186	0.97
10^{-7}	2.254	0.99
10^{-8}	2.262	1.0
10^{-9}	2.263	1.0

Contribution below this range negligible

Note: H(a) and $P_{f|a}$, as shown in Slide 6

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

C. Slope of the Hazard Curve – Closed-Form Solution

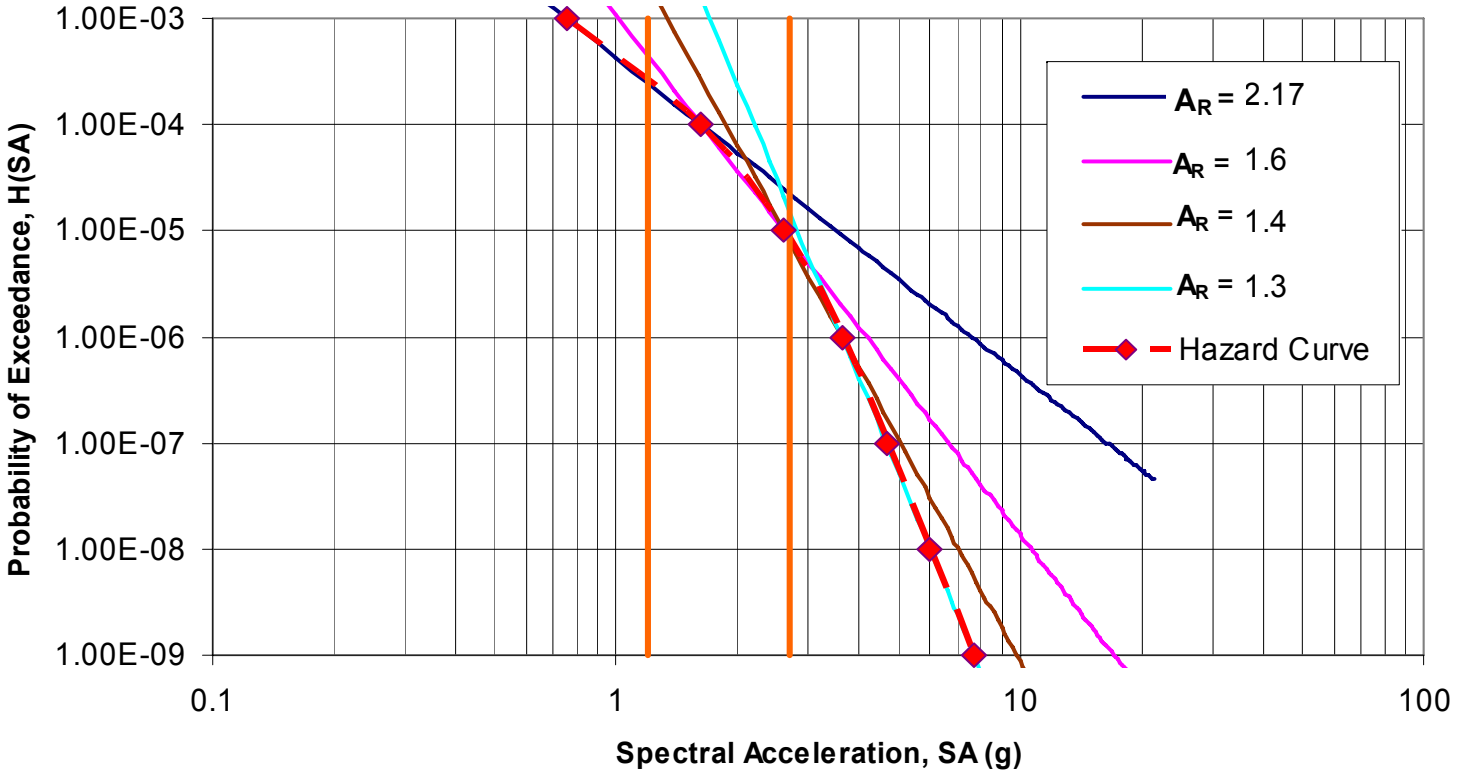

Hazard Curve and the Linearized Forms of the Hazard Curve

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

C. Slope of the Hazard Curve – Closed-Form Solution (contd.)

$H(a)$	SA	A_{R^*}	K_H	K_1	P_F (x10^{-5})
10^{-3}	0.753	-	-	-	
10^{-4}	1.627	2.17	2.99	0.000428	3.28
10^{-5}	2.603	1.6	4.90	0.00109	3.40
10^{-6}	3.627	1.4	6.94	0.00765	17.6
10^{-7}	4.663	1.3	9.16	0.134	471.0

P_F by numerical integration = 2.26E–5

*$A_R = SA_{0.1H(a)}/SA_{H(a)}$, where a is spectral acceleration.

Note: $P_{f|a}$ as shown in Slide 6

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

D. Log standard deviation of the fragility curve, β – numerical integration

Fragility Curve anchored at $C_{50\%}$

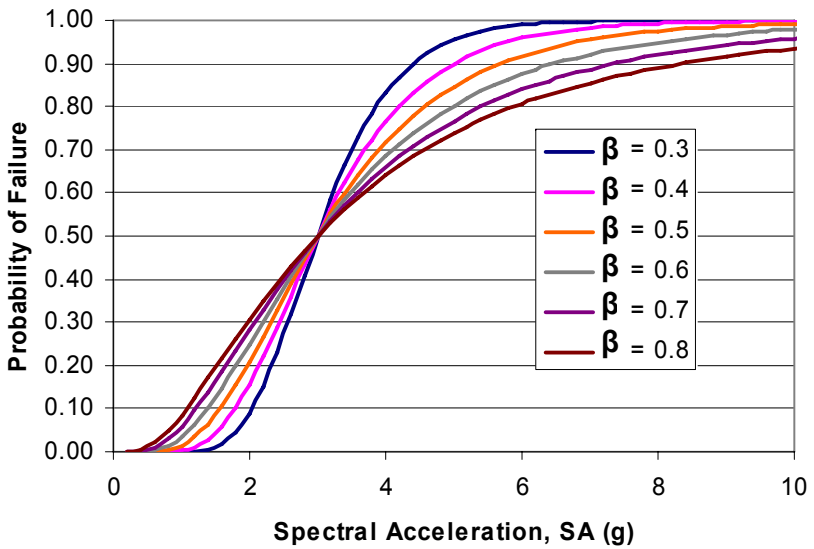

$C_{50\%}$ = 3.0g and β varies from 0.3-0.8

Fragility Curve anchored at $C_{1\%}$

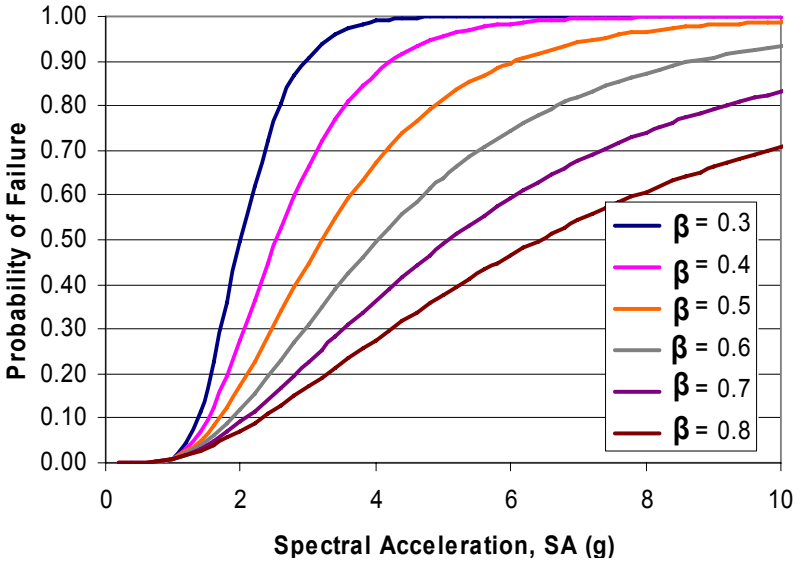

$C_{1\%}$ = 1.0g and β varies from 0.3-0.8

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

D. Log standard deviation of the fragility curve, β – numerical integration (contd.)

P_F with Varying β for $C_{50\%}$= 3.0g

β	P_F ($\times 10^{-5}$)	Ratio $P_{F,(\beta)}/P_{F(\beta=0.3)}$
0.3	1.29	1.0
0.4	2.28	1.8
0.5	3.82	3.0
0.6	5.87	4.6
0.7	8.24	6.4
0.8	10.7	8.3

Increases

P_F with Varying β for $C_{1\%}$= 1.0g

β	P_F ($\times 10^{-5}$)	Ratio $P_{F(\beta)}/P_{F(\beta=0.3)}$
0.3	6.85	1.0
0.4	4.32	0.63
0.5	3.06	0.45
0.6	2.38	0.35
0.7	1.99	0.29
0.8	1.75	0.25

Decreases

Note: H(a), as shown in Slide 6

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Conclusions

- In the numerical integration method,
  - approximately 18 points on the hazard curve provided reasonable accuracy in calculating probabilities of unacceptable performance in the example presented
  - contribution of the seismic hazard curve beyond 10^{-7} probability of exceedance is negligible for this study

- For the closed-form solution method,
  - the use of slope of the seismic hazard curve, between and 10^{-4} and 10^{-5}, gives performance results comparable to the numerical integration method

U.S.NRC
UNITED STATES NUCLEAR REGULATORY COMMISSION
Protecting People and the Environment

CNWRA
A center of excellence in earth sciences and engineering™

Conclusions (continued)

- Probability of unacceptable performance of SSCs
  - increases as log standard deviation, β, increases for the case where the fragility curve is based on the median capacity
  - decreases as log standard deviation, β, increases for the case where the fragility curve is based on the 1 percent probability of failure capacity. Using this approach, capacity at probability of failure greater than 1 percent is over-predicted when unrealistic value of β is used