



September 11, 2007

L-2007-144  
10 CFR 50.4  
10 CFR 50.55a

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, DC 20555

Re: St. Lucie Units 1 and 2  
Docket Nos. 50-335 and 50-389  
Fourth Ten-Year Interval  
In-Service-Test Program Submittal


The fourth ten-year in-service-test (IST) interval for St. Lucie Units 1 and 2 begins on February 11, 2008 and ends on February 10, 2018. Pursuant to the provisions of 10 CFR 50.55a(f)(4)(ii), the enclosed program outlines the IST plans for St. Lucie Units and 2 based on the requirements of the American Society of Mechanical Engineers (ASME) OM Code 2001 Edition through 2003 Addenda (ASME OM Code 2001/2003a). The IST program plan includes Mandatory Appendix II of the ASME OM Code 2001 Edition through 2002 Addenda (as modified by 10CFR50.55a(b)(3)(iv)(A), (B), and (D)) for check valve condition monitoring activities.

This submittal also contains relief requests for the fourth ten- year interval requiring NRC approval in accordance with 10 CFR 50.55a(a)(3)(i), 50.55a(a)(3)(ii), and 50.55a(f)(5)(iii), for relief from, or as alternatives to, the requirements of the ASME OM Code.

The details of the 10CFR 50.55a relief requests are provided in Attachment 1. The IST Fourth Ten-Year IST Program is provided in Attachment 2.

Please contact Ken Frehafer at (772) 467-7748 if there are any questions on this submittal.

Very truly yours,

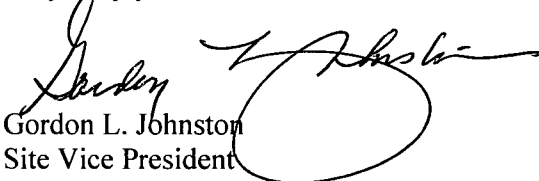  
Gordon L. Johnston  
Site Vice President  
St. Lucie Plant

Attachments

GLJ/KWF

A047

NLR



**Pump Relief Request – PR-01**  
**Charging Pump Vibration Frequency Response Range**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(a)(3)(ii)

Hardship or Unusual Difficulty without Compensating Increase in Level of Quality  
or Safety

1. **ASME Code Component(s) Affected**

| Pump    | Description                      | Class | Category | Unit |
|---------|----------------------------------|-------|----------|------|
| 1CHG 1A | Reactor Coolant Charging Pump 1A | 2     | Group A  | 1    |
| 1CHG 1B | Reactor Coolant Charging Pump 1B | 2     | Group A  | 1    |
| 1CHG 1C | Reactor Coolant Charging Pump 1C | 2     | Group A  | 1    |
| 2CHG 2A | Reactor Coolant Charging Pump 2A | 2     | Group A  | 2    |
| 2CHG 2B | Reactor Coolant Charging Pump 2B | 2     | Group A  | 2    |
| 2CHG 2C | Reactor Coolant Charging Pump 2C | 2     | Group A  | 2    |

2. **Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

3. **Applicable Code Requirement**

ISTB-3510(e), *Frequency Response Range*. The frequency response range of the vibration-measuring transducers and their readout system shall be from one-third minimum pump shaft rotational speed to at least 1000 Hz.

4. **Reason for Request**

The reactor coolant charging pumps are positive displacement pumps that operate at approximately 205-210 rpm which equates to a rotational frequency of 3.41 Hz. The one-third minimum speed frequency response required for the vibration instrumentation correlates to 1.13 Hz (68 cpm).

The equipment used to measure vibration at St. Lucie is the Computational Systems Inc. (CSI) model 2120 Machinery Analyzer with Wilcoxon model 793 accelerometer probes. The CSI 2120 Machinery Analyzer integrator frequency response is essentially flat down to DC<sup>(1)</sup>. While the Wilcoxon model 793 accelerometer probe frequency response range meets the Code accuracy range requirement of  $\pm 5.0\%$  in the range from 1.5 – 5,000 Hz, the frequency response drops to only  $\pm 10\%$  for frequencies between 1.0 – 1.5 Hz. As a result the vibration instrumentation meets



**Pump Relief Request – PR-01**  
(Page 2 of 3)

all of the Code accuracy requirements down to 1.5 Hz, but does not meet the frequency response accuracy of less than  $\pm 5.0\%$  for between 1.13 and 1.5 Hz, which is the low end of the one-third minimum speed requirement of ISTB-3510(e).

In addition to the physical limitations of the available instrumentation, calibration of the instrumentation can only be performed to a minimum frequency of only 2 Hz. The provider of calibration services for St. Lucie is unable to qualify calibration to frequencies less than 2 Hz. This is due to the unavailability of suitable vibration measurement standards for performing the calibration. The NIST Calibration Service Users Guide lists the lowest frequency NIST standard pickup (24010C) available is calibrated at 2 Hz. FPL Quality Assurance Program requires this instrumentation to be calibrated and traceable to NIST standards

This frequency response range of this instrumentation, while not meeting the extreme low end of the readout requirements of ISTB-3510(e) adequately envelops all potential noise contributors that could indicate degradation of the charging pumps. The instrumentation is fully qualified to measure all expected synchronous vibration levels.

Additionally, this test equipment will be used for measuring the vibrational frequencies which would equate to that of the pumps one-third running speed. Qualification of the accuracy of the readings at these frequencies is considered unnecessary and would impose undue hardship. This is considered acceptable as there are virtually no mechanical degradation scenarios where only a sub-synchronous vibration component would develop on the charging pumps. For example:

- a) Oil whirl, which presents itself at frequencies below the rotational frequency of the pump (i.e.  $0.38X - 0.48X$ ) is not applicable to a horizontal, triplex, reciprocating pump.
- b) A light rub / impact could generate a vibrational component at a frequency below the pump's rotational frequency (e.g.  $0.5X$  (102.5 cpm)), but would also usually generate a harmonic vibrational components that would present as either integer and half-integer multiples of the running speed of the pump. (e.g. a light rub vibrations occurring at  $0.5X$ , where  $X$  equals the rotational frequency of the pump, could also produce a vibrational component that could be measured at integer multiples of the original frequency, i.e.  $1X$ ,  $1.5X$ ,  $2X$ , etc), and would thus be identified in the calibrated range of the equipment.
- c) A heavy rub generates increased integer values of multiple running speed components, as well as processing the  $1X$  phase measurement. In either case the overall vibration level would still show an increase from both the attenuated sub-synchronous and  $1X$  vibration components as well as the higher harmonic vibration components.



**Pump Relief Request – PR-01**  
(Page 3 of 3)

- d) Looseness in the power train would most likely be identified through the measurement of a vibrational component(s) found at frequencies which are multiples of the pumps rotational frequency. (i.e. 1X and 2X where X equals the rotational frequency of the pump).

Based on the above information, the use of Computational Systems Inc. (CSI) model 2120 Machinery Analyzer with Wilcoxon model 793 accelerometer probes provides sufficiently reliable data to identify changes from baseline readings to indicate possible problems with the pumps.

**5. Proposed Alternative and Basis for Use**

The measurement of the vibration associated with the Reactor Coolant Charging Pumps 1A, 1B, 1C, 2A, 2B, and 2C will be taken utilizing the Computational Systems Inc. (CSI) model 2120 Machinery Analyzer with Wilcoxon model 793 accelerometer probes, or equivalent. Calibration of the instrumentation will be qualified to a minimum frequency of only 2 Hz.

These pumps as a result of their design are not susceptible to degradation mechanisms that would only manifest themselves in the unmonitored/non-calibrated range (1.13 to 2 Hz) without also becoming prevalent in the monitored range (2-1000 Hz)

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

This relief request was initially approved as Relief Request PR-07 on a 1 year interim basis by Safety Evaluation and letter dated March 16, 1999, for the third ten-year interval at St. Lucie Plant 1 & 2. Then on December 7, 2000, following the purchase of equipment with greater low end accuracy, this Relief Request again identified as PR-07, was approved for the remainder of the third ten-year interval at St. Lucie Plant 1 & 2.

<sup>(1)</sup> – DC stands for ‘Direct Current’, and relates to the description of the CSI 2120 integrator frequency in that when there is no vibration, there is no sinusoidal component to the electrical signal generated, which is what would be found with the measurement of direct current, as apposed to an alternating current.



**Pump Relief Request – PR-02**  
**Hydrazine Pump Vibration Frequency Response Range**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(f)(5)(iii)

Inservice Testing Impracticality

**1. ASME Code Component(s) Affected**

| <b>Pump</b> | <b>Description</b> | <b>Class</b> | <b>Category</b> | <b>Unit</b> |
|-------------|--------------------|--------------|-----------------|-------------|
| 2HYD 2A     | Hydrazine Pump 2A  | 2            | Group B         | 2           |
| 2HYD 2B     | Hydrazine Pump 2B  | 2            | Group B         | 2           |

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-5323(d) and (e) - Comprehensive Test Procedure.

(d) Vibration (displacement or velocity) shall be determined and compared with corresponding reference values. Vibration measurements are to be broad band (unfiltered). If velocity measurements are used, they shall be peak. If displacement amplitudes are used, they shall be peak-to-peak.

(e) All deviations from the reference values shall be compared with the ranges of Table ISTB-5300-1 or Table ISTB-5300-2, as applicable, and corrective action taken as specified in ISTB-6200. For reciprocating positive displacement pumps, vibration measurements shall be compared to the relative criteria shown in the alert and required action ranges of Table ISTB-5300-1 [2]

**4. Impracticality of Compliance**

The hydrazine pumps are reciprocating positive displacement pumps which are characterized as metering pumps. These pump operate at extremely slow speed (2HYD 2A at 39 rpm and 2HYD 2B at 37 rpm), which equates to a rotational frequency of 0.65 Hz. In accordance with the Code, the required low limit of the frequency response for the vibration instruments would be one third of this or 0.21 Hz. Portable instruments satisfying this requirement are commercially unavailable. The low frequency vibration instrumentation presently in use at St. Lucie is the Computational Systems Inc. (CSI) model 2120 Machinery Analyzer with Wilcoxon model 793 accelerometer probes.



**Pump Relief Request – PR-02**  
(Page 2 of 3)

While the Wilcoxon model 793 accelerometer probe frequency response range meets the Code accuracy range requirement of  $\pm 5.0\%$  in the range from 1.5 – 5,000 Hz, the frequency response drops to only  $\pm 10\%$  for frequencies between 1.0 – 1.5 Hz. Below 1.0 Hz, the frequency response is not provided by the vendor. For these reason, vibration readings taken, even with the low frequency probe, are essentially meaningless and of no value in identifying degradation of these pumps. Furthermore, the classical analysis of rotating components upon which the Code is based is not readily adaptable to slow moving components such as these positive displacement pumps.

These pumps are classified as Group B pumps per ISTB-2000. While these pumps which are designed and built for continuous operation, they are only operated 1 to 2 hours per year. That calculates to less than 5000 cycles between comprehensive testing when the measurement of the pumps vibration is called for. The mechanisms of wear and degradation of rotating machinery are time and cycle dependant and, in this case, the number of repetitive wearing actions (cycles) is small both in frequency and absolute numbers. As a result, little degradation is expected with respect to vibration performance between testing periods. Thus, the probability of any significant pump deterioration over the plant's lifetime is extremely small.

**5. Burden Caused by Compliance**

The performance of vibrational testing with the equipment currently commercially available, is not capable of measuring the pumps vibrational response to accuracies as required by the Code. Vibrational testing at the available accuracy limits with the currently commercially available equipment would not be expected to detect pump degradation as these pumps. These pumps, classified as Group B pumps, operate so infrequently that wear due to operation is not expected during the plants life time, making the effort of taking vibrational measurement effectively meaningless.

**6. Proposed Alternative and Basis for Use**

In lieu of measuring pump vibration on a comprehensive biennial frequency, these pumps will be maintained and inspected in accordance with the St. Lucie Preventative Maintenance Program that reflects the recommendations of the pump's manufacturer (Union Pump Co.) dated May 24, 1999. Preventative Maintenance, at a minimum, includes the periodic changing of the crankcase lubricating oil and oil analyses to identify significant wearing of internals, disassembly and inspection as well as the verification of bolting torque. This program is adequate for determining pump degradation that could impact operability and reliability.



**Pump Relief Request – PR-02**  
(Page 3 of 3)

7. **Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

8. **Precedents**

This relief request was previously approved for the third ten-year interval at St. Lucie Plant 1 & 2 as Relief Request PR-08, by Safety Evaluation and Letter dated March 16, 1999.



**Pump Relief Request – PR-03**  
**Hydrazine Pump Flow Testing**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(f)(5)(iii)

Inservice Testing Impracticality

1. **ASME Code Component(s) Affected**

| Pump    | Description       | Class | Category | Unit |
|---------|-------------------|-------|----------|------|
| 2HYD 2A | Hydrazine Pump 2A | 2     | Group B  | 2    |
| 2HYD 2B | Hydrazine Pump 2B | 2     | Group B  | 2    |

2. **Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

3. **Applicable Code Requirement**

ISTB-5322 – Group B Test Procedure, section (b), The flow rate shall be determined and compared to its reference value.

4. **Impracticality of Compliance**

The hydrazine pumps are reciprocating positive displacement pumps with variable speed control. They are classified as metering pumps and are designed to accurately displace a predetermined volume of liquid in a specific period of time. The pump has a single plunger and makes only one suction and one discharge stroke during each cycle (shaft rotation).

The pumps operate at a very slow speed (2HYD 2B is tested at 37 cpm) to supply the Technical Specification required hydrazine flowrate of 0.71 to 0.82 gpm. [TSR 4.6.2.2] Due to the simplified design of these pumps, instantaneous flow is continuously accelerating and decelerating - following an oscillating waveform. Each cycle of the pump is approximately 1.6 seconds in duration with no flow produced during the pumps' 0.8 second suction stroke. The installed flowrate instrumentation utilizes a differential pressure orifice located in the suction line common to both pumps. Due to the characteristic oscillating flowrate, flow through this orifice pulsates sharply with each pump stroke resulting in erratic flowrate readings. The flow orifice also senses pressure feedback during each pump stroke cycle as a result of echoes of the pressure pulsation produced by the pump stroke which are reflected back to the flow element by the system piping and valves. The characteristic oscillating flowrate also makes it impractical to dampen using standard dampening devices.



**Pump Relief Request – PR-03**  
(Page 2 of 3)

Attempts to use various techniques in averaging the indicated flowrate readings were proven to be inconsistent and inaccurate when compared to actual flow.

It was therefore determined that as a result of the pumps flow characteristics combined with the design limitation of the installed flow instrumentation, flow measurements to the requirements of ISTB-5322 can not be obtained under the current configuration.

As an alternative to the use of the installed instrumentation, the flowrates of the pumps can be determined through collection of the pumps' output in a container of known volume over a measured period of time. This method has been verified accurate through a comparison of the measured results to the correlation between pump speed and piston displacement.

**5. Burden Caused by Compliance**

While the method of verifying the pumps flowrate through the time dependent collection of the pumps discharge into a container of known volume is proven to be accurate, it is undesirable to perform this measurement on the Group B quarterly frequency based on the personnel hazards associated with testing. Hydrazine is a hazardous, highly flammable liquid with cumulative toxic effects when absorbed through the skin, inhaled or ingested. It has also been identified as a known carcinogen.

**6. Proposed Alternative and Basis for Use**

For this reason, it is proposed to only perform the IST acceptable measurement of flow during the comprehensive pump test which is performed on a biennial frequency, during refueling outages. Measuring the flowrate as described above during each refueling outage in conjunction with the sites application of it's Preventative Maintenance Program that reflects the recommendations of the pump's manufacturer (Union Pump Co.) dated May 24, 1999. The preventative maintenance performed on these pumps per the manufactures recommendations consists of, at a minimum, the periodic changing of the crankcase lubrication oil and oil analyses to identify significant wearing of internals, disassembly and inspection as well as the verification of bolting torque. Application of these preventative maintenance requirements along with the biennial measurement of the pumps flowrate, differential pressure and speed is appropriate and adequate for detecting any significant pump degradation and ensuring the continued operability and reliability of these pumps.



**Pump Relief Request – PR-03**  
(Page 3 of 3)

Quarterly pump tests will consist of the verification of each pumps discharge pressure when operated at rated speed.

The basis for the acceptability of this proposed alternative test is that these pumps are standby pumps that only operate 1-2 hours per year and are only energized for testing, thus, service-related degradation with respect to hydraulic performance between testing periods is unlikely. The quarterly verification of the pumps developed head at rated speed will ensure continued operability and availability for accident mitigation.

7. **Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

8. **Precedents**

This relief request was previously approved for the third ten-year interval at St. Lucie Plant 1 & 2 as Relief Request PR-09, by Safety Evaluation and Letter dated March 16, 1999.



**Pump Relief Request – PR-04**  
**Low Pressure Safety Injection Pump Group Classification**  
(Page 1 of 5)

Proposed Alternative in Accordance with 10 CFR 50.55a(a)(3)(i)

Alternative Provides Acceptable Level of Quality and Safety

**1. ASME Code Component(s) Affected**

| <b>Pump</b> | <b>Description</b>                    | <b>Class</b> | <b>Category</b> | <b>Unit</b> |
|-------------|---------------------------------------|--------------|-----------------|-------------|
| 1LPSI 1A    | Low Pressure Safety Injection Pump 1A | 2            | A/B             | 1           |
| 1LPSI 1B    | Low Pressure Safety Injection Pump 1B | 2            | A/B             | 1           |
| 2LPSI 2A    | Low Pressure Safety Injection Pump 2A | 2            | A/B             | 2           |
| 2LPSI 2B    | Low Pressure Safety Injection Pump 2B | 2            | A/B             | 2           |

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-1300. All pumps within the scope of ISTA-1100 and ISTB-1100 shall be categorized as either a Group A or Group B pump.

ISTB-1400(b), identify each pump to be tested in accordance with the rules of this Subsection and categorize it as either a Group A or Group B pump and list the pumps in the plant records (see ISTB-9000). A pump that meets both Group A and Group B definitions shall be categorized as a Group A pump.

**4. Reason for Request**

At St. Lucie, the Low Pressure Safety Injection Pumps are pumps that are used during cold shutdown and refueling conditions in order to provide cooling flow through the reactor, each individually providing approximately 3000 gpm of flow. During normal power operation, these pumps are unable to develop sufficient head to overcome the pressure necessary to inject into the RCS, and thus are only able to operate through their minimum flow lines, recirculating flow back to the Refueling Water Tank (RWT) at only 40 gpm for Unit 1 and 100 gpm for Unit 2.



**Pump Relief Request – PR-04**  
(Page 2 of 5)

Operation of these high capacity pumps under these low flow conditions results in the generation of vibrational levels greater than those measured during pump full flow operation. The low flow vibrational level for St. Lucie Unit 1 pumps 1LPSI 1A and B, have been know to exceed the vibrational alert levels as prescribed by Table ISTB-5100-1 of 0.325 in./sec.

Prior to the issuance of the 1995 edition of the OM Code, where the ISTB Group A and Group B concept were introduced, St. Lucie addressed the Unit 1 pumps normal generation of excess vibration during low flow quarterly testing through the submittal of a Relief Request to increase the Codes alert limits from 0.325 in./sec to 0.500 in./sec. This request was made under the rules of 10 CFR 50.59a(a)(3)(ii), "Hardship or Unusual Difficulty without Compensating Increase in Level of Quality or Safety", and was approved by the NRC by Safety Evaluation and Letter dated March 16, 1998. (St. Lucie 3<sup>rd</sup> Interval Relief Request PR-12).

In addition to the vibration concern with the Unit 1 LPSI pumps, St. Lucie has previously requested and been granted relief from measuring flow during normal operation of both Unit 1 and Unit 2 LPSI pumps. The reason for this request was that during operation, these high flow, low head pumps were incapable of developing sufficient head to overcome reactor coolant system (RCS) pressure, thus leaving only the min flow recirculation flow path available, which is not equipped with flow measurement instrumentation. Relief was granted via NRC Safety Evaluation and Letter dated March 16, 1999 under the rules of 10 CFR 50.559(f)(6)(i), "Inservice Testing Impracticability" (St. Lucie 3<sup>rd</sup> Interval Relief Request PR-06). This Relief essentially categorized these pumps as Group B during normal plant operation, and Group A during Refueling Operation.

It was also pointed out in the St. Lucie's 3<sup>rd</sup> Interval Relief Request PR-06, that the elimination of flowrate measurement through the minimum flow line was consistent with the philosophy and intent of NRC Generic Letter 89-04, Position 9 provided flow testing is performed under substantial flow condition that are present during either cold shutdown or refueling conditions.

The concept of ISTB Group A and Group B was developed recognizing that pumps that operate in a standby role, (i.e. Group B) are not subjected to the same wear and fatigue mechanism as those pump that operate either continuously or routinely. With this realization, it was recognized that it was not necessary to perform the same level of testing on a Group B pump as it was on a Group A pump, as a result of the Group B pumps standby nature. The mechanisms which contribute to possible degradation are simply not present. Without a wear mechanism to produce degradation, there would be no need to inspect for signs of degradation as a result of wear.



**Pump Relief Request – PR-04**  
(Page 3 of 5)

In addition, as is the case with these Low Pressure Safety Injection Pumps, prolonged operation under minimum flow conditions can be detrimental to the long term health of the pump. During low flow conditions, vibration velocity levels of five and ten times the running speed frequency (5X/10X), are significantly greater due to elevated vane pass vibration caused by the velocity vector not striking the volute at an optimal angle.<sup>(1)</sup> In order to maintain the long term health of these pump, it is the operational goal to keep to a minimum the amount of time that each pump is run on a min flow configuration. Recognizing that most Group B pumps share the same min flow configuration which can result in increased levels of vibrations that could contribute to a reduction in the pumps health, the OM Code has even removed the minimum 2 minute run time requirement for Group B testing. [ISTB-5100(a)(2), ISTB-5200(a)(2) and ISTB-5300(a)(2)]

This proposed relief will result in a lower potential for pump degradation due to pump wear, while still being capable of measuring/determining pump performance. The basis of this relief request will show that the proposed alternative would provide an acceptable level of quality and safety.

The Low Pressure Safety Injection Pumps meet the categorization requirements of a Group A pumps in that they are operated routinely during plant shutdowns and refueling outages. However, these pumps also meet the criteria of a Group B pump, in that during normal operation (reactor critical) they are not operated except for testing.

Classifying these pumps as group B during power operation minimizes the time required to perform quarterly testing. The 2001/2003a OM Code testing requirements eliminated the two-minute minimum pump run-time for quarterly Group B pump testing. Eliminating the minimum pump run-time requirement and the requirement to record vibration levels is expected to reduce the length of time that each pump is run quarterly. As these pumps are only called upon to operate during normal plant operation in support of either their own or in support of a required surveillance, there is no time or wear related degradation mechanism that would warrant performing more than Group B quarterly testing.

NUREG/CP-0137, Vol. 1, Proceedings of the Third NRC/American Society of Mechanical Engineers (ASME) Symposium on Valve and Pump Testing, includes a paper entitled, "Description of Comprehensive Pump Test Change to ASME Code, Subsection ISTB."<sup>(2)</sup> This paper details the philosophy of classifying pumps as Group A or Group B. According to the author, the intent of having different test requirements for different pump groups is so to relate the requirements for the amount and degree of quarterly performance monitoring to the amount of degradation expected based on pump operation.



**Pump Relief Request – PR-04**  
(Page 4 of 5)

Testing the LPSI pumps quarterly as Group A pumps during power operation is contrary to the philosophy elucidated by this referenced paper. Quarterly Group A testing during normal operation on minimum flow recirculation would subject these pumps to an increased potential for degradation due to pump wear (caused by low-flow operation) than would the quarterly perform of a Group B battery of tests. Group A testing during power operation may be more detrimental to the long-term health of these components than Group B testing.

In addition, the quarterly performance of the required Group A vibration monitoring would result in the placement of the Unit 1 pumps into an Alert category, resulting in the doubling of their quarterly testing frequency, all because these pumps when operated under a low flow condition have a natural tendency to exhibit higher than permitted amplitudes that allowed in the Code. Doubling of these pumps testing frequency would only result in these pumps being subjected to more potentially detrimental damage.

It is believed that the proposed alternate testing is adequate and appropriate, and is capable of properly monitoring pump operability as intended by the Code. It should be recognized that extended operation of these pumps under minimum flow conditions for no justifiable reason does not add to plant safety and could have a significant negative impact on pump and system operability and reliability.

**5. Proposed Alternative and Basis for Use**

It Is proposed that the Low Pressure Safety Injection Pumps be tested as standby pumps (Group B) during power operation and as continuously operating pumps (Group A) during refueling operations.

Using the provisions of this relief request as an alternative to the specific requirements of ISTB-1300 and ISTB-1400(b) identified above will provide adequate indication of pump performance and continue to provide an acceptable level of quality and safety.

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

A similar relief request identified as PR-12 has been previously approved for Calvert Cliffs Nuclear Power Plant on May 16, 2002 (TAC Nos. MB3782 and MB3783), as has a similar relief request identified as PR-04 for Three Mile Island, Unit 1 on July 7, 2005 (TAC. Nos. MC2558)



**Pump Relief Request – PR-04**  
(Page 5 of 5)

**8. References**

- <sup>(1)</sup> - J. Stall, FPL, to USNRC, "Inservice Test Program, Relief Request PR-12 Supplement," L-98-264, October 9, 1998
- <sup>(2)</sup> - R. Scott Hartley "Description of Comprehensive Pump Test Change to ASME Code, Subsection ISTB," July, 1994



**Pump Relief Request – PR-05**  
**LPSI Pressure Instrumentation**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(a)(3)(i)

Alternative Provides Acceptable Level of Quality and Safety

**1. ASME Code Component(s) Affected**

| <b>Pump</b> | <b>Description</b>             | <b>Class</b> | <b>Category</b> | <b>Unit</b> |
|-------------|--------------------------------|--------------|-----------------|-------------|
| 1LPSI 1A    | Low Press. Safety Inj. Pump 1A | 2            | A/B             | 1           |
| 1LPSI 1B    | Low Press. Safety Inj. Pump 1B | 2            | A/B             | 1           |
| 2LPSI 2A    | Low Press. Safety Inj. Pump 2A | 2            | A/B             | 2           |
| 2LPSI 2B    | Low Press. Safety Inj. Pump 2B | 2            | A/B             | 2           |

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-3510(b)(1) – *Range*, The full scale range of each analog instrument shall be not greater than three times the reference value.

**4. Reason for Request**

Table ISTB-3500-1 requires the accuracy of instruments used to measure differential pressure for Group A and B tests to be equal to or better than  $\pm 2$  percent based on full-scale reading of the instrument. This means that the accuracy of the actual measurement can vary as much as  $\pm 6$  percent for Group A and B tests, assuming the range of the instrument is extended to the maximum allowed deviation (3 times the reference value).



**Pump Relief Request – PR-05**  
(Page 2 of 3)

An example of calculating indicated instrument accuracy for Group A and B test is as follows (from NUREG-1482, Rev. 1, Paragraph 5.5.1):

This example uses a reference pressure value of 20 psig and an analog pressure gauge with full scale range of 60 psig that is calibrated to  $\pm 2\%$  of full scale.

Code requirement:

Reference value = 20 psig  
3 x reference value = 60 psig  
Instrument tolerance = 1.2 psig ( $\pm 2.0\% \times 60$  psig)

Indicated accuracy:

Instrument tolerance / Reference value x 100 = Indicated accuracy

$$\pm 1.2 \text{ psig} / 20 \text{ psig} \times 100 = \pm 6\%$$

Following the methodology used in NUREG-1482 and the example above, the indicated instrument accuracy can be calculated for each pressure instrument in this relief request. The following table provides the calculated indicated instrument accuracies:

Table 1: Calculated Instrument Accuracies for Selected Pressure Instruments

| PUMP ID | INSTR NUMBER | PARAMETER          | REF VALUE | INSTR RANGE | INSTR ACCUR | INSTR TOL    | IND ACCUR   |
|---------|--------------|--------------------|-----------|-------------|-------------|--------------|-------------|
| 1A LPSI | PI-3314      | Discharge Pressure | 200 PSIG  | 0-600 PSIG  | $\pm 0.5\%$ | $\pm 3$ PSIG | $\pm 1.5\%$ |
| 1B LPSI | PI-3315      | Discharge Pressure | 195 PSIG  | 0-600 PSIG  | $\pm 0.5\%$ | $\pm 3$ PSIG | $\pm 1.5\%$ |
| 2A LPSI | PI-3314      | Discharge Pressure | 190 PSIG  | 0-600 PSIG  | $\pm 0.5\%$ | $\pm 3$ PSIG | $\pm 1.6\%$ |
| 2B LPSI | PI-3315      | Discharge Pressure | 185 PSIG  | 0-600 PSIG  | $\pm 0.5\%$ | $\pm 3$ PSIG | $\pm 1.6\%$ |

Where:

REF VALUE = reference value established by the procedure

INSTR ACCUR = accuracy to which instrument is calibrated

INSTR TOL = maximum INSTR RANGE times INSTR ACCUR

IND ACCUR = INSTR TOL divided by REF VALUE times 100



**Pump Relief Request – PR-05**  
(Page 3 of 3)

As shown on Table 1, the indicated accuracy for all the instruments is less than or equal to 1.6% of the reference value. These accuracy's are better than those allowed by the Code for both Group A or B test. Therefore, there is no overall impact on the capability to detect and monitor degradation during pump tests based on use of these instruments. Continued use of the existing installed instruments is supported by NUREG-1482, Rev. 1, Paragraph 5.5.1 which states that when the range of an installed analog instrument is greater than 3 times the reference value but the accuracy of the instrument is more conservative than the Code, NRC staff may grant relief when the combination of the range and accuracy yields a reading at least equivalent to the reading achieved from instruments that meet the Code requirements (i.e., up to  $\pm 6\%$  for Group A and B test).

**5. Proposed Alternative and Basis for Use**

Since the indicated accuracy of each permanently installed instrument is less than the allowed tolerance, FPL requests approval for continued use of the instruments listed in this relief request.

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

This relief request was previously approved for the third ten-year interval at St. Lucie Plant 1 & 2 as Relief Request PR-13, by Safety Evaluation and Letter dated December 7, 2000.



**Pump Relief Request – PR-06**  
**Boric Acid Makeup (BAM) Pumps Quarterly Flow Test**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(f)(5)(iii)

Inservice Testing Impracticality

**1. ASME Code Component(s) Affected**

| <b>Pump</b> | <b>Description</b>        | <b>Class</b> | <b>Category</b> | <b>Unit</b> |
|-------------|---------------------------|--------------|-----------------|-------------|
| 1BAM 1A     | Boric Acid Makeup Pump 1A | 2            | Group A         | 1           |
| 1BAM 1B     | Boric Acid Makeup Pump 1B | 2            | Group A         | 1           |
| 2BAM 2A     | Boric Acid Makeup Pump 2A | 2            | Group A         | 2           |
| 2BAM 2B     | Boric Acid Makeup Pump 2B | 2            | Group A         | 2           |
|             |                           |              |                 |             |

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-5121(b) – The resistance of the system shall be varied until the flow rate equals the reference point. The differential pressure shall then be determined and compared to its reference value. Alternatively, the flow rate shall be varied until the differential pressure equals the reference point and the flow rate determined and compared to the reference flow rate value.

**4. Reason for Request**

There are four flowpaths available for performing inservice testing of the BAM Pumps. These include the primary flow path to the charging pump suction header, a recirculation line leading back to the Refueling Water Tank (RWT), a line leading to the Volume Control Tank (VCT) and the BAM Tank recirculation line. For reasons stated below, none of these flow paths are either available or equipped to support pump Group A testing during plant operation or cold shutdown:

- a. Operating of the BAM Pumps aligned to discharge into the charging pump suction header will result in the introduction of highly concentrated boric acid solution from the boric acid makeup tanks into the suction of the charging pumps. During plant operation this would result in the addition of excess boron to the RCS. This rapid insertion of negative reactivity would result in RCS cooldown and de-pressurization. A large enough boron addition could



**Pump Relief Request – PR-06**  
(Page 2 of 3)

result in an unscheduled plant trip and a possible safety injection system actuation. During cold shutdown, the introduction of excess quantities of boric acid into the RCS via this flowpath is also undesirable from the aspect of maintaining proper plant chemistry and the inherent difficulties that may be encountered during the subsequent startup due to the over-boration of the RCS. In addition, the waste management system would be overburdened by the large amounts of RCS coolant that would then require processing to reduce boron concentration.

- b. Another alternate flowpath would involve the operation of a BAM Pump aligned to recirculate water to the Refueling Water Tank (RWT). This alignment would result in depletion of the associated BAM Tank inventory. During normal operation Technical Specifications requires a combination of one or both BAM Tanks be maintained with a certain volume and concentration of boric acid. The transfer of borated water from either one or both of the BAM Tanks could result not only the loss of a required boration source as defined by Technical Specifications, but in the case of St. Lucie Unit 2, could result in an increase of boron concentration above the RWT concentration limit. (Unit 2 RWT boron concentration is required to be between 1720 and 2100 ppm) In addition this flow path is not equipped with flow measurement instrumentation, so flow could not be readily determined.
- c. Alignment of a BAM Pump to the Volume Control Tank (VCT) will also result in the same issues as described in (b) above in regards to the depletion of the associated BAM tank of it's inventory. In this case, not only could the transfer of borated water from either one or both of the BAM Tanks result in a loss of the required boration sources as defined by Technical Specifications, but injecting the highly borated water into the VCT would introduce this highly borated water to the suction of the charging pumps, resulting in the addition of negative reactivity into the RCS, with the possible same results as described in (a) above. Again, this flow path is also not equipped with flow measuring instrumentation.

It is noted that in options (b) and (c) above, transference of the contents of a BAM tank, a fixed and limited amount of volume, will result in the reduction of suction pressure over the course of the test, to the BAM Pump with the result of producing a variable flow rate which could not be easily compared/trended to previous flow measurements.(i.e. repeatability) BAM Tanks' level typically varies from test to test by as much as 15 to 20 feet.

- d. Alignment of a BAM Pump to recirculate flow back to the BAM Tank is accomplished through a fixed resistance circuit, which is essentially the pumps minimum flow test line, the same flowpath which is also utilized to periodically mix the contents of each tank, so as to prevent stratification of the



**Pump Relief Request – PR-06**  
(Page 3 of 3)

highly borated water. While operation of the BAM Pumps can be accomplished without the introduction of highly borated water to the RCS or affecting the limits associated with the maintenance of the required number of borated water sources, there is no flowrate measuring instrumentation installed in these lines

**5. Proposed Alternative and Basis for Use**

It is proposed that quarterly Group A testing of the BAM pumps be accomplished utilizing the fixed-resistance BAM tank recirculation line. Pump differential pressure and vibration will be measured and compared to their respective reference values per ISTB-5121(c) and (d).

The removal of quarterly flow testing of these pumps has been deemed acceptable per NRC Generic Letter 89-04, Position 9, which allows elimination of minimum flow test line flowrate measurements providing inservice tests are performed during cold shutdowns or refueling periods under full or substantial flow conditions where pump flowrate is recorded and evaluated. The proposed alternate testing is consistent with this philosophy and the intent of Position 9.

Full flow testing will continue to be performed on a Comprehensive test frequency, during refueling conditions.

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

This relief request was previously approved for the third ten-year interval at St. Lucie Plant 1 & 2 as Relief Request PR-03, by Safety Evaluation and Letter dated March 16, 1999.



St. Lucie Inservice Testing Program for Pumps and Valves

Fourth Ten-Year Interval

(PSL-ENG-SEOS-07-030 Appendix 1 Rev. 0 - 263 total pages)



**FPL**

**St Lucie**

**Inservice Testing (IST) Program**

**for**

**Pumps and Valves**

**4<sup>th</sup> 10 yr Interval**



## 1.0 INTRODUCTION

### 1.1 Purpose

To provide requirements for the performance and administration of assessing the operational readiness of those pumps and valves with specific functions that are required to:

- Shutdown the reactor to the safe shutdown condition,
- Maintaining the safe shutdown condition, and/or
- To mitigate the consequences of an accident.

St. Lucie Plant, Unit 1 was designed and licensed to operate with the Hot Standby condition defined as the "safe" shutdown condition (Unit 1 UFSAR, Section 7.4).

St. Lucie Plant, Unit 2 was designed and licensed to operate with "safe shutdown" being defined depending on plant operating conditions as hot standby, hot shutdown or cold shutdown (Unit 2 UFSAR, Section 7.4).

The Inservice Inspection (ISI) Classification Boundaries are identical to the Design Classification or Quality Group Boundaries shown on the plant Piping and Instrument Diagrams (P&IDs) listed in Attachment 1. This Inservice Testing (IST) Program was developed using the following documents:

- Title 10, Code of Federal Regulations, Part 50, Paragraph 50.55a
- Standard Review Plan 3.9.6, "Inservice Testing of Pumps and Valves"
- Safety Analysis Report, St. Lucie Plant
- Technical Specifications, St. Lucie Plant, Unit 1
- Technical Specifications, St. Lucie Plant, Unit 2
- NUREG-1482, Rev. 1 "Guidelines for Inservice Testing at Nuclear Power Plants"

### 1.2 SCOPE

The IST program plan has been prepared to meet the requirements of the American Society of Mechanical Engineers (ASME) OM Code 2001 Edition through 2003 Addenda (ASME OM Code 2001/2003a). Mandatory Appendix II of the ASME OM Code 2001 Edition through 2002 Addenda (as modified by 10CFR50.55a(b)(3)(iv)(A), (B) and (D)) will be used for check valve condition monitoring activities.

- ASME OM Code 2001/2003a, Subsection ISTA, "*General Requirements*"

ISTA contains the requirements directly applicable to inservice testing including the Owner's Responsibility and Records Requirements.

- ASME OM Code 2001/2003a, Subsection ISTB, "*Inservice Testing of Pumps in Light-Water Reactor Nuclear Power Plants*"



ISTB establishes the requirements for inservice testing of pumps in light-water reactor nuclear power plants. The pumps covered are those provided with an emergency power source; that are required in shutting down of the reactor to a safe shutdown condition, in maintaining the safe shutdown condition, and/or in mitigation of the consequences of an accident.

- ASME OM Code 2001/2003a, Subsection ISTC, *"Inservice Testing of Valves in Light-Water Reactor Nuclear Power Plants"*

ISTC establishes the requirements for inservice testing of valves in light-water reactor nuclear power plants. The valves covered include those which provide overpressure protection and those which are required to perform a specific function, either actively through the changing of valve obturator position or passively by maintaining required obturator position in shutting down a reactor to the safe shutdown condition, in maintaining the safe shutdown condition, or in mitigating the consequences of an accident.

- ASME OM Code 2001/2003a, Mandatory Appendix I, *"Inservice Testing of Pressure Relief Devices in Light-Water Reactor Nuclear Power Plants"*

Provides the requirements for performance testing and monitoring of nuclear plant pressure relief devices. Methods, intervals, and record requirements for monitoring and testing are established, as well as guidelines for the evaluation of results. The Appendix applies to safety valves, safety relief valves, pilot-operated pressure relief valves, power-actuated pressure relief valves, nonreclosing pressure relief devices and vacuum relief devices, including all accessories and appurtenances.

- ASME OM Code 2001/2003a, Mandatory Appendix II, *"Check Valve Condition Monitoring Program"*

Provides an alternative to the testing or examination requirements of ISTC-3510 through ISTC-5221. The purpose of this program is both to improve valve performance and to optimize testing, examination, and preventive maintenance activities in order to maintain the continued acceptable performance of a select group of check valves.



The St. Lucie Nuclear Plant fourth 120-month Pump and Valve Inservice Testing Plan for Unit's 1 and 2 will be in effect as follows:

- Unit One: **Begin:** February 11, 2008<sup>(1)</sup> **End:** February 10, 2018
- Unit Two: **Begin:** February 11, 2008<sup>(2)</sup> **End:** February 10, 2018

The NRC also reviewed and found "No Significant Impact" as it relates the environmental impact associated with the combining of interval dates as documented by NRC letter dated May 30, 2001.

- (1) - By letter L-85-431 dated November 13, 1985, Florida Power & Light Company (FPL) requested NRC's approval to extend the first ten-year inspection interval for St. Lucie Unit 1 to February 11, 1988. By letter dated November 20, 1985 (Denton to Williams), the NRC staff approved the expansion and, as a result, the second ten-year inservice testing interval for St. Lucie Unit 1 began February 11, 1988, and the third interval began February 11, 1998.
- (2) - St. Lucie Plant Unit No. 2 – Exemption from the requirements of 10 CFR 50.55a(f)(4)(ii) and 10 CFR 50.55a(f)(5)(i) regarding schedule for second and third inservice testing program interval (TAC No. MB0615), was approved by the NRC under correspondence Docket No. 50-389, dated June 12, 2001. This exemption effectively set the start of the Unit 2 third 120 month interval to correspond with the start of the Unit 1 third 120 month interval.



## 2.0 INSERVICE TESTING PLAN FOR PUMPS

### 2.1 Pump Inservice Testing Plan Description

This testing program for pumps meets the requirements of the ASME OM Code 2001 edition through 2003a, Section ISTB *"Inservice Testing of Pumps in Light-Water Reactor Nuclear Power Plants"*. Where these requirements have been determined to be impractical, specific requests for relief were written and are included in Attachment 3. NRC Generic Letter 89-04 and NUREG 1482, Revision 1 have been used as guidance in the development of the IST Program.

### 2.2 Pump Plan Table Description

The pumps included in the St. Lucie Nuclear Plant IST Plan are listed in Attachment 13. The information contained in these tables identifies those pumps which are required to be tested to the requirements of Subsection ISTB of the ASME OM Code 2001 Edition through 2003 Addenda, along with their applicable tests, and test frequencies. The Pump Plan Table is divided into sections based upon Plant System. The headings for the pump tables are delineated below.

|                        |  |  |
|------------------------|--|--|
| <u>Pump Number</u>     | A unique identifier for the pump. Each pump is preceded with a Unit designator for the pump: |  |
|                        | 1  | Unit 1                                 |
|                        | 2  | Unit 2                                 |
| <u>Pump Name</u>       | The descriptive name for the pump.   |  |
| <u>P&amp;ID</u>        | The Piping and Instrumentation Drawing on which the pump is represented.                     |  |
| <u>P&amp;ID Coord.</u> | The P&ID Coordinate location of the pump.  |  |
| <u>IST Group</u>       | Pump Group as defined in ISTB-2000.  |  |
|                        | Group A  | Continuous or routinely operated pumps |
|                        | Group B  | Standby pumps not operated routinely   |
|                        | N/A  | Not Applicable (Skid Mounted)          |



## 2.2 Pump Plan Table Description (Cont'd)

|                     |  |                          |
|---------------------|--|--------------------------|
| <u>Safety Class</u> | The ASME Code classification of the valve. |                          |
|                     | 1  | Class 1                  |
|                     | 2  | Class 2                  |
|                     | 3  | Class 3                  |
|                     | NC   | Non-Code, Safety Related |
|                     | NS   | Non-Safety Related       |
| <u>Pump Type</u>    | The type of pump.                          |                          |
|                     | Centrifugal                                |                          |
|                     | Positive Displacement                      |                          |
|                     | Vertical Line Shaft                        |                          |
| <u>Pump Driver</u>  | The type of pump driver.                   |                          |
|                     | Motor                                      | Motor driven             |
|                     | Turbine                                    | Steam turbine driven     |
|                     | Engine                                     | Combustion Engine        |



## 2.2 Pump Plan Table Description (Cont'd)

| <u>Test Type</u>     | Measured test parameters.  |
|----------------------|--|
| DIS-P <sup>(1)</sup> | Discharge Pressure (Measured only for positive displacement pumps)   |
| dP <sup>(1)</sup>    | Differential Pressure as calculated by subtracting the suction from the discharge pressures or obtained by direct measurement. |
| Q <sup>(1)</sup>     | Flow Rate as measured using a rate or quantity meter installed in the pump test circuit.                                       |
| S <sup>(1)</sup>     | Pump Speed (Measured only for variable speed pumps)  |
| SKID                 | Parameter(s) as determined by St. Lucie Plant are verified through the testing of the sub-assemblies parent/major component    |
| V <sup>(1)</sup>     | Vibration, (Pump bearing).   |

<sup>(1)</sup> Following the specification of each 'Test Type', within parenthesis will be denoted as to which of the following test criteria will be applied:

- a – Denotes a Group A Pump Test
- b – Denotes a Group B Pump Test
- c – Denotes a Comprehensive Pump Test

| <u>Test Freq.</u> | The frequency for performing the specified Inservice Test. |
|-------------------|--|
| M3                | Quarterly (92 Days)  |
| 2Y                | Two Years (Biennial)                                       |



## 2.2 Pump Plan Table Description (Cont'd)

|                       |  |
|-----------------------|--|
| <u>Relief Request</u> | A relief request number is listed when a specific Code requirement is determined to be impracticable.  |
| <u>Tech. Pos.</u>     | Reference a Technical Position(s) by it's specific number(s). A Technical Position is written to document how Code requirements are being implemented at the station when the requirement(s) of the Code are not easily interpreted. |



### 3.0 INSERVICE TESTING PLAN FOR VALVES

#### 3.1 Valve Inservice Testing Plan Description

This testing program for valves meets the requirements of the ASME OM Code 2001 edition through 2003a, Section ISTC *"Inservice Testing of Valves in Light-Water Reactor Nuclear Power Plants"*; Mandatory Appendix I *"Inservice Testing of Pressure Relief Devices in Light-Water Reactor Nuclear Power Plants"*; Mandatory Appendix II *"Check Valve Condition Monitoring Program"* with the limitations imposed by 10 CFR 50.55a(b)(3)(iv)(A), (B) and (D). Where these requirements are determined to be impractical, specific requests for relief have been written and are included in Attachment 4.

Where the frequency requirements for valve testing have been determined to be impracticable, Cold Shutdown or Refuel Outage Justifications have been identified and written. These justifications are provided in Attachments 7 and 9 respectively.

#### 3.2 Valve Plan Table Description

The valves in Attachment 15 list all ASME Class 1, 2, 3 and NC Valves that have been scoped to be with in the IST Program and have been assigned Valve Categories. Valves exempt per ASME OM Code ISTC-1200 are not listed. The Valve Plan Table is divided into sections by Plant System. The following information is included for each valve.

Valve Tag      A unique identifier for the valve. Each Valve is preceded with a Unit designator:

|   |        |
|---|--------|
| 1 | Unit 1 |
| 2 | Unit 2 |

Valve Name      The description of the valve.

P&ID              The Piping and Instrumentation Drawing (P&ID) number on which the valve appears. (If the valve appears on multiple P&IDs, the primary P&ID will be listed.)

P&ID Coord.      The drawing coordinate location on the P&ID for the valve.



### 3.2 Valve Plan Table Description (Cont'd)

|                     |                                       |                          |
|---------------------|---------------------------------------|--------------------------|
| <u>Safety Class</u> | The ASME Classification of the valve. |                          |
|                     | 1                                     | ASME Code Class 1        |
|                     | 2                                     | ASME Code Class 2        |
|                     | 3                                     | ASME Code Class 3        |
|                     | NC                                    | Non-Code, Safety Related |

|                     |   |  |
|---------------------|---|--|
| <u>IST Category</u> | <p>The category(s) assigned to the valve based on the definitions per ASME OM Code ISTC-1300. The following categories are defined in the Code:</p> <p>Category A – Valves for which seat leakage is limited to a specific maximum amount in the closed position for fulfillment of their function.</p> <p>Category B – Valves for which seat leakage in the closed position is inconsequential for fulfillment of their function.</p> <p>Category C – Valves, which are self-actuating in response to some system characteristic, such as pressure (relief valves) or flow direction (check valves).</p> <p>Category D – Valves, which are actuated by an energy source capable of only one operation, such as rupture disks or explosive-actuated valves.</p> <p>N/A – Valves which have been included into the IST Program as the result of either a regulatory or utility commitment.</p> |  |
| <u>Valve Size</u>   | The nominal size of the valve, in inches.   |  |



### 3.2 Valve Plan Table Description (Cont'd)

|                       |   |  |
|-----------------------|---|--|
| <u>Valve Type</u>     | The valve body design as indicated by the following abbreviation.                   |  |
|                       | 3W  | 3-Way Valve                                |
|                       | 4W  | 4-Way Valve                                |
|                       | ANG   | Angle                                      |
|                       | BAL   | Ball Valve                                 |
|                       | BTF   | Butterfly Valve                            |
|                       | CK  | Check Valve                                |
|                       | DIA   | Diaphragm Valve                            |
|                       | GA  | Gate Valve                                 |
|                       | GL  | Globe Valve                                |
|                       | NEEDLE  | Needle Valve                               |
|                       | PCHECK  | Power Check Valve                          |
|                       | PLG   | Plug Valve                                 |
|                       | PLT   | Pilot Valve                                |
|                       | RPD   | Rupture Disk                               |
|                       | RV  | Relief Valve                               |
|                       | SCK   | Stop Check Valve                           |
|                       | SV  | Safety                                     |
|                       | XFC   | Excess Flow Check Valve                    |
| <u>ACT. Type</u>      | The actuator type abbreviation.   |  |
|                       | AO  | Air Operator                               |
|                       | M   | Manual                                     |
|                       | MO  | Motor Operator                             |
|                       | PO  | Power Operated                             |
|                       | SA  | Self-Actuating                             |
|                       | SAP   | Self-Actuated Pilot                        |
|                       | SO  | Solenoid Operator                          |
| <u>Active/Passive</u> | Active or Passive function determination for the valve in accordance with ISTA-2000 |  |
|                       | A   | Active                                     |
|                       | P   | Passive                                    |
|                       | N/A   | Not Applicable (Non-Safety Related Valves) |



### 3.2 Valve Plan Table Description (Cont'd)

Normal Position The normal position of the valve during normal power operation. If the valves system does not operate during power operation, then the normal position is the position of the valve when the system is not operating.

|      |                                     |
|------|-------------------------------------|
| C    | Closed                              |
| FLOW | Flow straight through a 3-way valve |
| LC   | Locked Closed                       |
| LO   | Locked Open                         |
| LT   | Locked Throttled                    |
| N/A  | Not Applicable                      |
| O    | Open                                |
| SYS  | System Condition Dependent          |
| TH   | Throttled                           |
| VENT | Vent out the side of a 3-way valve  |

Safety Position The valves safety function position(s). For valves that perform safety functions in the open and closed positions more than one safety function position may be specified.

|      |                                       |
|------|---------------------------------------|
| C    | Closed                                |
| D    | De-energized (3-way and 4-way valves) |
| FLOW | Flow straight through a 3-way valve   |
| LT   | Locked Throttled                      |
| N/A  | Valve has no Safety Related Position  |
| O    | Open                                  |
| O/C  | Open or Closed                        |
| VENT | Vent out the side of a 3-way valve    |



### 3.2 Valve Plan Table Description (Cont'd)

#### Test Rqmt

The test(s) that will be performed to fulfill the requirements of ASME OM Code ISTC. The definitions and abbreviations are identified below:

|      |   |
|------|---|
| CC   | Exercised Closed – Check Valve <sup>1</sup> |
| CO   | Exercise Open – Check Valve <sup>1</sup>    |
| CP   | Partial Exercise Open <sup>1</sup>          |
| DT   | Rupture Disk / Explosive Valves             |
| FSC  | Fail Safe Test Closed                       |
| FSO  | Fail Safe Test Open                         |
| FSS  | Fail Safe Solenoid                          |
| FSV  | Fail Safe Vent                              |
| LT-J | Leakage Rate Test (Appendix J)              |
| LT-S | Leakage Rate Test (Seat, ISTC-3630)         |
| ME   | Manual Exercise                             |
| OPR  | Operator Rounds (condition monitoring)      |
| PIT  | Position Indication Test                    |
| RVT  | Relief Valve Test                           |
| SD   | Solenoid De-energize                        |
| SE   | Solenoid Energize                           |
| ST-C | Stroke Time Closed                          |
| ST-O | Stroke Time Open                            |
| TMP  | Temperature Monitoring                      |
| VAC  | Vacuum Breaker Test                         |

<sup>1</sup> Three letter designations may be used for Check Valve Condition Monitoring tests to differentiate between the various methods of exercising check valves. The letter following "CC" or "CO", or "CP" is "A" for acoustics, "D" for disassembly and examination, "F" for flow indication, "M" for magnetics, "R" for radiography, "T" for break away torque, "U" for ultrasonic, or "X" for manual exercise.



### 3.2 Valve Plan Table Description (Cont'd)

Test Freq. The test frequency abbreviation.

|      |                                   |
|------|-----------------------------------|
| AppJ | Appendix J                        |
| CM   | Condition Monitoring <sup>1</sup> |
| CS   | Cold Shutdown                     |
| M3   | Quarterly                         |
| OP   | Operating Activities <sup>2</sup> |
| RR   | Refuel Outage                     |
| 2Y   | Every 2 years                     |
| 5Y   | Every 5 years                     |
| 10Y  | Every 10 years                    |

*- Note that the frequency listed in the Program Plan is that frequency as required by the applicable section for the Code. The test/operator activity which is performed for which credit is taken may occur more frequently.*

Relief Request The applicable Relief Request as it applies to the subject test.

Deferred Just. Deferred Test Justification. This field refers to either an applicable Cold Shutdown Justifications or Refuel Outage Justifications.

A **Cold Shutdown Justification** is a document that provides a justification as allowed by ISTC-3510 to extend the applicable testing frequency to that which coincides with the plants "Cold Shutdown" frequency. A Cold Shutdown Justification is identified by its unique number identifier which has a "CS" prefix. Cold Shutdown Justifications are contained in Attachment 7 of this document.

A **Refuel Outage Justification** is a document that provides a justification as allowed by ISTC-3510 to extend the applicable testing frequency to that which coincides with the plants "Refuel Outages" frequency. A Refuel Outage Justification is identified by its unique number identifier which has a "RJ" prefix. Refueling Outage Justifications are contained in Attachment 9 of this document.

<sup>1</sup> Frequency is as indicated in respective Condition Monitoring Plan for that valve group.

<sup>2</sup> Satisfied i.a.w. Technical Position, TP-05, "Check Valve in Regular Use"



Technical Position. A Technical Position is a document which is used by the utility/Owner uses to clarify their interpretation of Code requirements when it is felt by the utility or Owner that either the requirements of the Code are not easily interpreted or when they simply want to document how Code requirement is being implemented at the station. Technical Positions are identified by their unique number identifier which contains either a "TP" prefix. Technical Positions are contained in Attachment 11 of this document.

Also in this column are identified the applicable Check Valve Condition Monitoring Program groups, when applicable.



#### 4.0 ATTACHMENTS:

**Attachment 1**  
System and P&ID Listing

**Attachment 2**  
Pump Relief Request Index

**Attachment 3**  
Pump Relief Requests

**Attachment 4**  
Valve Relief Request Index

**Attachment 5**  
Valve Relief Requests

**Attachment 6**  
Cold Shutdown Justification Index

**Attachment 7**  
Cold Shutdown Justifications

**Attachment 8**  
Refuel Outage Justification Index

**Attachment 9**  
Refuel Outage Justifications

**Attachment 10**  
Technical Positions Index

**Attachment 11**  
Technical Positions

**Attachment 12**  
Inservice Testing Pump Table Index



**4.0 ATTACHMENTS (Cont'd)**

**Attachment 13**

Inservice Testing Pump Table

**Attachment 14**

Inservice Testing Valve Table Index

**Attachment 15**

Inservice Testing Valve Table



# ATTACHMENT 1

## SYSTEM AND P&ID LISTING

### UNIT 1

| Drawing Number / Sheet | Rev   | Title                                       |
|------------------------|-------|---|
| 8770-G-078/110A        | 30    | Reactor Coolant System                      |
| 8770-G-078/110B        | 25    | Reactor Coolant System                      |
| 8770-G-078/111A        | 14    | Reactor Coolant Pump 1A1                    |
| 8770-G-078/111B        | 14    | Reactor Coolant Pump 1A2                    |
| 8770-G-078/111C        | 13    | Reactor Coolant Pump 1B1                    |
| 8770-G-078/111D        | 15    | Reactor Coolant Pump 1B2                    |
| 8770-G-078/120A        | 23    | Chemical and Volume Control                 |
| 8770-G-078/120B        | 16 17 | Chemical and Volume Control                 |
| 8770-G-078/121A        | 33 38 | Chemical and Volume Control                 |
| 8770-G-078/121B        | 30 32 | Chemical and Volume Control                 |
| 8770-G-078/130A        | 26 27 | Safety Injection System                     |
| 8770-G-078/130B        | 29 31 | Safety Injection System                     |
| 8770-G-078/131A        | 26 27 | Safety Injection System                     |
| 8770-G-078/131B        | 18 19 | Safety Injection System                     |
| 8770-G-078/140         | 17    | Fuel Pool System                            |
| 8770-G-078/150         | 12 13 | Sampling System                             |
| 8770-G-078/160A        | 18 21 | Waste Management System                     |
| 8770-G-078/163A        | 34    | Waste Management System                     |
| 8770-G-078/163B        | 32    | Waste Management System                     |
| 8770-G-079/1           | 51 52 | Main Steam System                           |
| 8770-G-079/7           | 4     | Main Steam System                           |
| 8770-G-080/3           | 51 53 | Feedwater and Condensate Systems            |
| 8770-G-080/4           | 39 40 | Feedwater and Condensate Systems            |
| 8770-G-080/5           | 3     | Main Feedwater                              |
| 8770-G-082/2           | 23 24 | Circulating and Intake Cooling Water System |
| 8770-G-083/1A          | 57 58 | Component Cooling System                    |
| 8770-G-083/1B          | 55 56 | Component Cooling System                    |
| 8770-G-084/1B          | 44    | Domestic & Make-up Water Systems            |
| 8770-G-084/1C          | 43    | Domestic & Make-up Water Systems            |
| 8770-G-085/1A          | 38    | Service Air System                          |
| 8770-G-085/2A          | 39    | Instrument Air System                       |
| 8770-G-085/2C          | 40 41 | Instrument Air System                       |
| 8770-G-085/3           | 21    | Instrument Air System                       |
| 8770-G-086/1           | 41 42 | Miscellaneous Systems                       |



**ATTACHMENT 1 (Cont'd)**

**SYSTEM AND P&ID LISTING**

**UNIT 1**  
(continued)

| <b>Drawing Number / Sheet</b> | <b>Rev</b> | <b>Title</b>  |
|-------------------------------|------------|---|
| 8770-G-088/1                  | 47 50      | Containment Spray and Refueling Water Systems         |
| 8770-G-088/2                  | 44 46      | Containment Spray and Refueling Water Systems         |
| 8770-G-091/1                  | 6 7        | Miscellaneous Systems                                 |
| 8770-G-092/1                  | 29         | Miscellaneous Sampling Systems                        |
| 8770-G-093                    | 39 40      | Miscellaneous Systems                                 |
| 8770-G-096/1A                 | 17 18      | Emergency Diesel Generator System - Diesel Engine 1A1 |
| 8770-G-096/1B                 | 16         | Emergency Diesel Generator System - Diesel Engine 1A2 |
| 8770-G-096/1C                 | 16 17      | Emergency Diesel Generator System - Air Start Pkg. 1A |
| 8770-G-096/2A                 | 15 16      | Emergency Diesel Generator System - Diesel Engine 1B1 |
| 8770-G-096/2B                 | 15         | Emergency Diesel Generator System - Diesel Engine 1B2 |
| 8770-G-096/2C                 | 13 14      | Emergency Diesel Generator System - Air Start Pkg. 1B |
| 8770-G-878                    | 33         | HVAC - Control Diagrams (Sheet 1)                     |
| 8770-G-879                    | 39         | HVAC - Control Diagrams (Sheet 2)                     |



**ATTACHMENT 1 (Cont'd)**

**SYSTEM AND P&ID LISTING**

**UNIT 2**

| <b>Drawing Number / Sheet</b> | <b>Rev</b> | <b>Title</b>                                  |
|-------------------------------|------------|---|
| 2998-G-078/107                | 11         | Reactor Coolant System                        |
| 2998-G-078/108                | 4 5        | Reactor Coolant System                        |
| 2998-G-078/109                | 16 18      | Reactor Coolant System                        |
| 2998-G-078/110                | 7          | Reactor Coolant System                        |
| 2998-G-078/115                | 6          | Reactor Coolant System                        |
| 2998-G-078/120                | 16 17      | Chemical and Volume Control                   |
| 2998-G-078/121A               | 29 30      | Chemical and Volume Control                   |
| 2998-G-078/121B               | 24 27      | Chemical and Volume Control                   |
| 2998-G-078/122                | 24 25      | Chemical and Volume Control                   |
| 2998-G-078/130A               | 18 19      | Safety Injection System                       |
| 2998-G-078/130B               | 27 28      | Safety Injection System                       |
| 2998-G-078/131                | 18 19      | Safety Injection System                       |
| 2998-G-078/132                | 8 9        | Safety Injection System                       |
| 2998-G-078/140                | 8          | Fuel Pool System                              |
| 2998-G-078/153                | 8          | Sampling System                               |
| 2998-G-078/160A               | 9 11       | Waste Management System                       |
| 2998-G-078/163A               | 20         | Waste Management System                       |
| 2998-G-078/163B               | 17 18      | Waste Management System                       |
| 2998-G-079/1                  | 37 38      | Main Steam System                             |
| 2998-G-079/7                  | 1          | Main Steam System                             |
| 2998-G-080/2A                 | 38 41      | Feedwater and Condensate Systems              |
| 2998-G-080/2B                 | 35         | Feedwater and Condensate Systems              |
| 2998-G-082/2                  | 51 52      | Circulating and Intake Cooling Water System   |
| 2998-G-083/1                  | 38 39      | Component Cooling System                      |
| 2998-G-083/2                  | 36 39      | Component Cooling System                      |
| 2998-G-084/1                  | 34 35      | Domestic & Make-up Water Systems              |
| 2998-G-085/1                  | 27 28      | Service Air System                            |
| 2998-G-085/2A                 | 36 37      | Instrument Air System                         |
| 2998-G-085/2B                 | 44 46      | Instrument Air System                         |
| 2998-G-085/2C                 | 37 39      | Instrument Air System                         |
| 2998-G-086/1                  | 46         | Miscellaneous Systems                         |
| 2998-G-088/1                  | 36 38      | Containment Spray and Refueling Water Systems |
| 2998-G-088/2                  | 37 40      | Containment Spray and Refueling Water Systems |
| 2998-G-091/1                  | 24         | Miscellaneous Systems                         |
| 2998-G-092/1                  | 25         | Miscellaneous Sampling Systems                |



**ATTACHMENT 1 (Cont'd)**

**SYSTEM AND P&ID LISTING**

**UNIT 2**  
(continued)

| <b>Drawing Number / Sheet</b> | <b>Rev</b> | <b>Title</b>  |
|-------------------------------|------------|---|
| 2998-G-096/1A                 | 16         | Emergency Diesel Generator System - Diesel Engine 2A1 |
| 2998-G-096/1B                 | 16         | Emergency Diesel Generator System - Diesel Engine 2A2 |
| 2998-G-096/1C                 | 14 15      | Emergency Diesel Generator System - Air Start Pkg. 2A |
| 2998-G-096/2A                 | 15         | Emergency Diesel Generator System - Diesel Engine 2B1 |
| 2998-G-096/2B                 | 16         | Emergency Diesel Generator System - Diesel Engine 2B2 |
| 2998-G-096/2C                 | 10 12      | Emergency Diesel Generator System - Air Start Pkg. 2B |
| 2998-G-878                    | 33         | HVAC - Control Diagrams (Sheet 1)                     |
| 2998-G-879/2                  | 27         | HVAC - Control Diagrams (Sheet 2)                     |
| 2998-G-879/3                  | 29         | HVAC - Control Diagrams (Sheet 3)                     |
| 2298-9695                     | 11         | MFIV Hydraulic Actuator                               |



**ATTACHMENT 2**

**PUMP RELIEF REQUEST INDEX**

| <b><u>Designator</u></b> | <b><u>Description</u></b>   | <b><u>Approval Date</u></b> |
|--------------------------|---|-----------------------------|
| PR-01                    | Charging Pump Vibration<br>Frequency Response Range               |                             |
| PR-02                    | Hydrazine Pump Vibration<br>Frequency Response Range              |                             |
| PR-03                    | Hydrazine Pump Flow<br>Testing                                    |                             |
| PR-04                    | Low Pressure Safety<br>Injection Pump Group<br>Classification     |                             |
| PR-05                    | LPSI Pressure<br>Instrumentation                                  |                             |
| PR-06                    | Boric Acid Makeup (BAM)<br>Pumps Quarterly Flow Test              |                             |
| PR-07                    | Diesel Fuel Oil Transfer<br>Pump 2A Comprehensive<br>Flow Testing |                             |
| PR-08                    | Unit 1 Diesel Fuel Oil<br>Transfer Pump Testing                   |                             |



**ATTACHMENT 3**

**PUMP RELIEF REQUESTS**



**Pump Relief Request – PR-01**  
**Charging Pump Vibration Frequency Response Range**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(a)(3)(ii)

Hardship or Unusual Difficulty without Compensating Increase in Level of Quality  
or Safety

**1. ASME Code Component(s) Affected**

| Pump    | Description                      | Class | Category | Unit |
|---------|----------------------------------|-------|----------|------|
| 1CHG 1A | Reactor Coolant Charging Pump 1A | 2     | Group A  | 1    |
| 1CHG 1B | Reactor Coolant Charging Pump 1B | 2     | Group A  | 1    |
| 1CHG 1C | Reactor Coolant Charging Pump 1C | 2     | Group A  | 1    |
| 2CHG 2A | Reactor Coolant Charging Pump 2A | 2     | Group A  | 2    |
| 2CHG 2B | Reactor Coolant Charging Pump 2B | 2     | Group A  | 2    |
| 2CHG 2C | Reactor Coolant Charging Pump 2C | 2     | Group A  | 2    |

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-3510(e), *Frequency Response Range*. The frequency response range of the vibration-measuring transducers and their readout system shall be from one-third minimum pump shaft rotational speed to at least 1000 Hz.

**4. Reason for Request**

The reactor coolant charging pumps are positive displacement pumps that operate at approximately 205-210 rpm which equates to a rotational frequency of 3.41 Hz. The one-third minimum speed frequency response required for the vibration instrumentation correlates to 1.13 Hz (68 cpm).

The equipment used to measure vibration at St. Lucie is the Computational Systems Inc. (CSI) model 2120 Machinery Analyzer with Wilcoxon model 793 accelerometer probes. The CSI 2120 Machinery Analyzer integrator frequency response is essentially flat down to DC<sup>(1)</sup>. While the Wilcoxon model 793 accelerometer probe frequency response range meets the Code accuracy range requirement of  $\pm 5.0\%$  in the range from 1.5 – 5,000 Hz, the frequency response drops to only  $\pm 10\%$  for frequencies between 1.0 – 1.5 Hz. As a result the vibration instrumentation meets



**Pump Relief Request – PR-01**  
(Page 2 of 3)

all of the Code accuracy requirements down to 1.5 Hz, but does not meet the frequency response accuracy of less than  $\pm 5.0\%$  for between 1.13 and 1.5 Hz, which is the low end of the one-third minimum speed requirement of ISTB-3510(e).

In addition to the physical limitations of the available instrumentation, calibration of the instrumentation can only be performed to a minimum frequency of only 2 Hz. The provider of calibration services for St. Lucie is unable to qualify calibration to frequencies less than 2 Hz. This is due to the unavailability of suitable vibration measurement standards for performing the calibration. The NIST Calibration Service Users Guide lists the lowest frequency NIST standard pickup (24010C) available is calibrated at 2 Hz. FPL Quality Assurance Program requires this instrumentation to be calibrated and traceable to NIST standards

This frequency response range of this instrumentation, while not meeting the extreme low end of the readout requirements of ISTB-3510(e) adequately envelops all potential noise contributors that could indicate degradation of the charging pumps. The instrumentation is fully qualified to measure all expected synchronous vibration levels.

Additionally, this test equipment will be used for measuring the vibrational frequencies which would equate to that of the pumps one-third running speed. Qualification of the accuracy of the readings at these frequencies is considered unnecessary and would impose undue hardship. This is considered acceptable as there are virtually no mechanical degradation scenarios where only a sub-synchronous vibration component would develop on the charging pumps. For example:

- a) Oil whirl, which presents itself at frequencies below the rotational frequency of the pump (i.e.  $0.38X - 0.48X$ ) is not applicable to a horizontal, triplex, reciprocating pump.
- b) A light rub / impact could generate a vibrational component at a frequency below the pump's rotational frequency (e.g.  $0.5X$  (102.5 cpm)), but would also usually generate a harmonic vibrational components that would present as either integer and half-integer multiples of the running speed of the pump. (e.g. a light rub vibrations occurring at  $0.5X$ , where  $X$  equals the rotational frequency of the pump, could also produce a vibrational component that could be measured at integer multiples of the original frequency, i.e.  $1X$ ,  $1.5X$ ,  $2X$ , etc), and would thus be identified in the calibrated range of the equipment.
- c) A heavy rub generates increased integer values of multiple running speed components, as well as processing the  $1X$  phase measurement. In either case the overall vibration level would still show an increase from both the attenuated sub-synchronous and  $1X$  vibration components as well as the higher harmonic vibration components.



**Pump Relief Request – PR-01**  
(Page 3 of 3)

- d) Looseness in the power train would most likely be identified through the measurement of a vibrational component(s) found at frequencies which are multiples of the pumps rotational frequency. (i.e. 1X and 2X where X equals the rotational frequency of the pump).

Based on the above information, the use of Computational Systems Inc. (CSI) model 2120 Machinery Analyzer with Wilcoxon model 793 accelerometer probes provides sufficiently reliable data to identify changes from baseline readings to indicate possible problems with the pumps.

**5. Proposed Alternative and Basis for Use**

The measurement of the vibration associated with the Reactor Coolant Charging Pumps 1A, 1B, 1C, 2A, 2B, and 2C will be taken utilizing the Computational Systems Inc. (CSI) model 2120 Machinery Analyzer with Wilcoxon model 793 accelerometer probes, or equivalent. Calibration of the instrumentation will be qualified to a minimum frequency of only 2 Hz.

These pumps as a result of their design are not susceptible to degradation mechanisms that would only manifest themselves in the unmonitored/non-calibrated range (1.13 to 2 Hz) without also becoming prevalent in the monitored range (2-1000 Hz)

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

This relief request was initially approved as Relief Request PR-07 on a 1 year interim basis by Safety Evaluation and letter dated March 16, 1999, for the third ten-year interval at St. Lucie Plant 1 & 2. Then on December 7, 2000, following the purchase of equipment with greater low end accuracy, this Relief Request again identified as PR-07, was approved for the remainder of the third ten-year interval at St. Lucie Plant 1 & 2.

(1) – DC stands for 'Direct Current', and relates to the description of the CSI 2120 integrator frequency in that when there is no vibration, there is no sinusoidal component to the electrical signal generated, which is what would be found with the measurement of direct current, as apposed to an alternating current.



**Pump Relief Request – PR-02**  
**Hydrazine Pump Vibration Frequency Response Range**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(f)(5)(iii)

Inservice Testing Impracticality

**1. ASME Code Component(s) Affected**

| Pump    | Description       | Class | Category | Unit |
|---------|-------------------|-------|----------|------|
| 2HYD 2A | Hydrazine Pump 2A | 2     | Group B  | 2    |
| 2HYD 2B | Hydrazine Pump 2B | 2     | Group B  | 2    |

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-5323(d) and (e) - Comprehensive Test Procedure.

(d) Vibration (displacement or velocity) shall be determined and compared with corresponding reference values. Vibration measurements are to be broad band (unfiltered). If velocity measurements are used, they shall be peak. If displacement amplitudes are used, they shall be peak-to-peak.

(e) All deviations from the reference values shall be compared with the ranges of Table ISTB-5300-1 or Table ISTB-5300-2, as applicable, and corrective action taken as specified in ISTB-6200. For reciprocating positive displacement pumps, vibration measurements shall be compared to the relative criteria shown in the alert and required action ranges of Table ISTB-5300-1 [2]

**4. Impracticality of Compliance**

The hydrazine pumps are reciprocating positive displacement pumps which are characterized as metering pumps. These pump operate at extremely slow speed (2HYD 2A at 39 rpm and 2HYD 2B at 37 rpm), which equates to a rotational frequency of 0.65 Hz. In accordance with the Code, the required low limit of the frequency response for the vibration instruments would be one third of this or 0.21 Hz. Portable instruments satisfying this requirement are commercially unavailable. The low frequency vibration instrumentation presently in use at St. Lucie is the Computational Systems Inc. (CSI) model 2120 Machinery Analyzer with Wilcoxon model 793 accelerometer probes.



**Pump Relief Request – PR-02**  
(Page 2 of 3)

While the Wilcoxon model 793 accelerometer probe frequency response range meets the Code accuracy range requirement of  $\pm 5.0\%$  in the range from 1.5 – 5,000 Hz, the frequency response drops to only  $\pm 10\%$  for frequencies between 1.0 – 1.5 Hz. Below 1.0 Hz, the frequency response is not provided by the vendor. For these reason, vibration readings taken, even with the low frequency probe, are essentially meaningless and of no value in identifying degradation of these pumps. Furthermore, the classical analysis of rotating components upon which the Code is based is not readily adaptable to slow moving components such as these positive displacement pumps.

These pumps are classified as Group B pumps per ISTB-2000. While these pumps which are designed and built for continuous operation, they are only operated 1 to 2 hours per year. That calculates to less than 5000 cycles between comprehensive testing when the measurement of the pumps vibration is called for. The mechanisms of wear and degradation of rotating machinery are time and cycle dependant and, in this case, the number of repetitive wearing actions (cycles) is small both in frequency and absolute numbers. As a result, little degradation is expected with respect to vibration performance between testing periods. Thus, the probability of any significant pump deterioration over the plant's lifetime is extremely small.

**5. Burden Caused by Compliance**

The performance of vibrational testing with the equipment currently commercially available, is not capable of measuring the pumps vibrational response to accuracies as required by the Code. Vibrational testing at the available accuracy limits with the currently commercially available equipment would not be expected to detect pump degradation as these pumps. These pumps, classified as Group B pumps, operate so infrequently that wear due to operation is not expected during the plants life time, making the effort of taking vibrational measurement effectively meaningless.

**6. Proposed Alternative and Basis for Use**

In lieu of measuring pump vibration on a comprehensive biennial frequency, these pumps will be maintained and inspected in accordance with the St. Lucie Preventative Maintenance Program that reflects the recommendations of the pump's manufacturer (Union Pump Co.) dated May 24, 1999. Preventative Maintenance, at a minimum, includes the periodic changing of the crankcase lubricating oil and oil analyses to identify significant wearing of internals, disassembly and inspection as well as the verification of bolting torque. This program is adequate for determining pump degradation that could impact operability and reliability.



**Pump Relief Request – PR-02**  
(Page 3 of 3)

**7. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**8. Precedents**

This relief request was previously approved for the third ten-year interval at St. Lucie Plant 1 & 2 as Relief Request PR-08, by Safety Evaluation and Letter dated March 16, 1999.



**Pump Relief Request – PR-03**  
**Hydrazine Pump Flow Testing**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(f)(5)(iii)

Inservice Testing Impracticality

1. **ASME Code Component(s) Affected**

| Pump    | Description       | Class | Category | Unit |
|---------|-------------------|-------|----------|------|
| 2HYD 2A | Hydrazine Pump 2A | 2     | Group B  | 2    |
| 2HYD 2B | Hydrazine Pump 2B | 2     | Group B  | 2    |

2. **Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

3. **Applicable Code Requirement**

ISTB-5322 – Group B Test Procedure, section (b), The flow rate shall be determined and compared to its reference value.

4. **Impracticality of Compliance**

The hydrazine pumps are reciprocating positive displacement pumps with variable speed control. They are classified as metering pumps and are designed to accurately displace a predetermined volume of liquid in a specific period of time. The pump has a single plunger and makes only one suction and one discharge stroke during each cycle (shaft rotation).

The pumps operate at a very slow speed (2HYD 2B is tested at 37 cpm) to supply the Technical Specification required hydrazine flowrate of 0.71 to 0.82 gpm. [TSR 4.6.2.2] Due to the simplified design of these pumps, instantaneous flow is continuously accelerating and decelerating - following an oscillating waveform. Each cycle of the pump is approximately 1.6 seconds in duration with no flow produced during the pumps' 0.8 second suction stroke. The installed flowrate instrumentation utilizes a differential pressure orifice located in the suction line common to both pumps. Due to the characteristic oscillating flowrate, flow through this orifice pulsates sharply with each pump stroke resulting in erratic flowrate readings. The flow orifice also senses pressure feedback during each pump stroke cycle as a result of echoes of the pressure pulsation produced by the pump stroke which are reflected back to the flow element by the system piping and valves. The characteristic oscillating flowrate also makes it impractical to dampen using standard dampening devices.



**Pump Relief Request – PR-03**  
(Page 2 of 3)

Attempts to use various techniques in averaging the indicated flowrate readings were proven to be inconsistent and inaccurate when compared to actual flow.

It was therefore determined that as a result of the pumps flow characteristics combined with the design limitation of the installed flow instrumentation, flow measurements to the requirements of ISTB-5322 can not be obtained under the current configuration.

As an alternative to the use of the installed instrumentation, the flowrates of the pumps can be determined through collection of the pumps' output in a container of known volume over a measured period of time. This method has been verified accurate through a comparison of the measured results to the correlation between pump speed and piston displacement.

**5. Burden Caused by Compliance**

While the method of verifying the pumps flowrate through the time dependent collection of the pumps discharge into a container of known volume is proven to be accurate, it is undesirable to perform this measurement on the Group B quarterly frequency based on the personnel hazards associated with testing. Hydrazine is a hazardous, highly flammable liquid with cumulative toxic effects when absorbed through the skin, inhaled or ingested. It has also been identified as a known carcinogen.

**6. Proposed Alternative and Basis for Use**

For this reason, it is proposed to only perform the IST acceptable measurement of flow during the comprehensive pump test which is performed on a biennial frequency, during refueling outages. Measuring the flowrate as described above during each refueling outage in conjunction with the sites application of it's Preventative Maintenance Program that reflects the recommendations of the pump's manufacturer (Union Pump Co.) dated May 24, 1999. The preventative maintenance performed on these pumps per the manufactures recommendations consists of, at a minimum, the periodic changing of the crankcase lubrication oil and oil analyses to identify significant wearing of internals, disassembly and inspection as well as the verification of bolting torque. Application of these preventative maintenance requirements along with the biennial measurement of the pumps flowrate, differential pressure and speed is appropriate and adequate for detecting any significant pump degradation and ensuring the continued operability and reliability of these pumps.



**Pump Relief Request – PR-03**  
(Page 3 of 3)

Quarterly pump tests will consist of the verification of each pumps discharge pressure when operated at rated speed.

The basis for the acceptability of this proposed alternative test is that these pumps are standby pumps that only operate 1-2 hours per year and are only energized for testing, thus, service-related degradation with respect to hydraulic performance between testing periods is unlikely. The quarterly verification of the pumps developed head at rated speed will ensure continued operability and availability for accident mitigation.

**7. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**8. Precedents**

This relief request was previously approved for the third ten-year interval at St. Lucie Plant 1 & 2 as Relief Request PR-09, by Safety Evaluation and Letter dated March 16, 1999.



**Pump Relief Request – PR-04**  
**Low Pressure Safety Injection Pump Group Classification**  
(Page 1 of 5)

Proposed Alternative in Accordance with 10 CFR 50.55a(a)(3)(i)

Alternative Provides Acceptable Level of Quality and Safety

**1. ASME Code Component(s) Affected**

| <b>Pump</b> | <b>Description</b>                    | <b>Class</b> | <b>Category</b> | <b>Unit</b> |
|-------------|---------------------------------------|--------------|-----------------|-------------|
| 1LPSI 1A    | Low Pressure Safety Injection Pump 1A | 2            | A/B             | 1           |
| 1LPSI 1B    | Low Pressure Safety Injection Pump 1B | 2            | A/B             | 1           |
| 2LPSI 2A    | Low Pressure Safety Injection Pump 2A | 2            | A/B             | 2           |
| 2LPSI 2B    | Low Pressure Safety Injection Pump 2B | 2            | A/B             | 2           |

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-1300. All pumps within the scope of ISTA-1100 and ISTB-1100 shall be categorized as either a Group A or Group B pump.

ISTB-1400(b), identify each pump to be tested in accordance with the rules of this Subsection and categorize it as either a Group A or Group B pump and list the pumps in the plant records (see ISTB-9000). A pump that meets both Group A and Group B definitions shall be categorized as a Group A pump.

**4. Reason for Request**

At St. Lucie, the Low Pressure Safety Injection Pumps are pumps that are used during cold shutdown and refueling conditions in order to provide cooling flow through the reactor, each individually providing approximately 3000 gpm of flow. During normal power operation, these pumps are unable to develop sufficient head to overcome the pressure necessary to inject into the RCS, and thus are only able to operate through their minimum flow lines, recirculating flow back to the Refueling Water Tank (RWT) at only 40 gpm for Unit 1 and 100 gpm for Unit 2.



**Pump Relief Request – PR-04**  
(Page 2 of 5)

Operation of these high capacity pumps under these low flow conditions results in the generation of vibrational levels greater than those measured during pump full flow operation. The low flow vibrational level for St. Lucie Unit 1 pumps 1LPSI 1A and B, have been known to exceed the vibrational alert levels as prescribed by Table ISTB-5100-1 of 0.325 in./sec.

Prior to the issuance of the 1995 edition of the OM Code, where the ISTB Group A and Group B concept were introduced, St. Lucie addressed the Unit 1 pumps normal generation of excess vibration during low flow quarterly testing through the submittal of a Relief Request to increase the Codes alert limits from 0.325 in./sec to 0.500 in./sec. This request was made under the rules of 10 CFR 50.59a(a)(3)(ii), "Hardship or Unusual Difficulty without Compensating Increase in Level of Quality or Safety", and was approved by the NRC by Safety Evaluation and Letter dated March 16, 1998. (St. Lucie 3<sup>rd</sup> Interval Relief Request PR-12).

In addition to the vibration concern with the Unit 1 LPSI pumps, St. Lucie has previously requested and been granted relief from measuring flow during normal operation of both Unit 1 and Unit 2 LPSI pumps. The reason for this request was that during operation, these high flow, low head pumps were incapable of developing sufficient head to overcome reactor coolant system (RCS) pressure, thus leaving only the min flow recirculation flow path available, which is not equipped with flow measurement instrumentation. Relief was granted via NRC Safety Evaluation and Letter dated March 16, 1999 under the rules of 10 CFR 50.559(f)(6)(i), "Inservice Testing Impracticability" (St. Lucie 3<sup>rd</sup> Interval Relief Request PR-06). This Relief essentially categorized these pumps as Group B during normal plant operation, and Group A during Refueling Operation.

It was also pointed out in the St. Lucie's 3<sup>rd</sup> Interval Relief Request PR-06, that the elimination of flowrate measurement through the minimum flow line was consistent with the philosophy and intent of NRC Generic Letter 89-04, Position 9 provided flow testing is performed under substantial flow condition that are present during either cold shutdown or refueling conditions.

The concept of ISTB Group A and Group B was developed recognizing that pumps that operate in a standby role, (i.e. Group B) are not subjected to the same wear and fatigue mechanism as those pump that operate either continuously or routinely. With this realization, it was recognized that it was not necessary to perform the same level of testing on a Group B pump as it was on a Group A pump, as a result of the Group B pumps standby nature. The mechanisms which contribute to possible degradation are simply not present. Without a wear mechanism to produce degradation, there would be no need to inspect for signs of degradation as a result of wear.



**Pump Relief Request – PR-04**  
(Page 3 of 5)

In addition, as is the case with these Low Pressure Safety Injection Pumps, prolonged operation under minimum flow conditions can be detrimental to the long term health of the pump. During low flow conditions, vibration velocity levels of five and ten times the running speed frequency (5X/10X), are significantly greater due to elevated vane pass vibration caused by the velocity vector not striking the volute at an optimal angle.<sup>(1)</sup> In order to maintain the long term health of these pump, it is the operational goal to keep to a minimum the amount of time that each pump is run on a min flow configuration. Recognizing that most Group B pumps share the same min flow configuration which can result in increased levels of vibrations that could contribute to a reduction in the pumps health, the OM Code has even removed the minimum 2 minute run time requirement for Group B testing. [ISTB-5100(a)(2), ISTB-5200(a)(2) and ISTB-5300(a)(2)]

This proposed relief will result in a lower potential for pump degradation due to pump wear, while still being capable of measuring/determining pump performance. The basis of this relief request will show that the proposed alternative would provide an acceptable level of quality and safety.

The Low Pressure Safety Injection Pumps meet the categorization requirements of a Group A pumps in that they are operated routinely during plant shutdowns and refueling outages. However, these pumps also meet the criteria of a Group B pump, in that during normal operation (reactor critical) they are not operated except for testing.

Classifying these pumps as group B during power operation minimizes the time required to perform quarterly testing. The 2001/2003a OM Code testing requirements eliminated the two-minute minimum pump run-time for quarterly Group B pump testing. Eliminating the minimum pump run-time requirement and the requirement to record vibration levels is expected to reduce the length of time that each pump is run quarterly. As these pumps are only called upon to operate during normal plant operation in support of either their own or in support of a required surveillance, there is no time or wear related degradation mechanism that would warrant performing more than Group B quarterly testing.

NUREG/CP-0137, Vol. 1, Proceedings of the Third NRC/American Society of Mechanical Engineers (ASME) Symposium on Valve and Pump Testing, includes a paper entitled, "Description of Comprehensive Pump Test Change to ASME Code, Subsection ISTB."<sup>(2)</sup> This paper details the philosophy of classifying pumps as Group A or Group B. According to the author, the intent of having different test requirements for different pump groups is so to relate the requirements for the amount and degree of quarterly performance monitoring to the amount of degradation expected based on pump operation.



**Pump Relief Request – PR-04**  
(Page 4 of 5)

Testing the LPSI pumps quarterly as Group A pumps during power operation is contrary to the philosophy elucidated by this referenced paper. Quarterly Group A testing during normal operation on minimum flow recirculation would subject these pumps to an increased potential for degradation due to pump wear (caused by low-flow operation) than would the quarterly performance of a Group B battery of tests. Group A testing during power operation may be more detrimental to the long-term health of these components than Group B testing.

In addition, the quarterly performance of the required Group A vibration monitoring would result in the placement of the Unit 1 pumps into an Alert category, resulting in the doubling of their quarterly testing frequency, all because these pumps when operated under a low flow condition have a natural tendency to exhibit higher than permitted amplitudes that allowed in the Code. Doubling of these pumps testing frequency would only result in these pumps being subjected to more potentially detrimental damage.

It is believed that the proposed alternate testing is adequate and appropriate, and is capable of properly monitoring pump operability as intended by the Code. It should be recognized that extended operation of these pumps under minimum flow conditions for no justifiable reason does not add to plant safety and could have a significant negative impact on pump and system operability and reliability.

**5. Proposed Alternative and Basis for Use**

It is proposed that the Low Pressure Safety Injection Pumps be tested as standby pumps (Group B) during power operation and as continuously operating pumps (Group A) during refueling operations.

Using the provisions of this relief request as an alternative to the specific requirements of ISTB-1300 and ISTB-1400(b) identified above will provide adequate indication of pump performance and continue to provide an acceptable level of quality and safety.

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

A similar relief request identified as PR-12 has been previously approved for Calvert Cliffs Nuclear Power Plant on May 16, 2002 (TAC Nos. MB3782 and MB3783), as has a similar relief request identified as PR-04 for Three Mile Island, Unit 1 on July 7, 2005 (TAC. Nos. MC2558)



**Pump Relief Request – PR-04**  
(Page 5 of 5)

**8. References**

- (1) - J. Stall, FPL, to USNRC, "Inservice Test Program, Relief Request PR-12 Supplement," L-98-264, October 9, 1998
- (2) - R. Scott Hartley "Description of Comprehensive Pump Test Change to ASME Code, Subsection ISTB," July, 1994



**Pump Relief Request – PR-05**  
**LPSI Pressure Instrumentation**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(a)(3)(i)

Alternative Provides Acceptable Level of Quality and Safety

1. **ASME Code Component(s) Affected**

| Pump     | Description                    | Class | Category | Unit |
|----------|--------------------------------|-------|----------|------|
| 1LPSI 1A | Low Press. Safety Inj. Pump 1A | 2     | A/B      | 1    |
| 1LPSI 1B | Low Press. Safety Inj. Pump 1B | 2     | A/B      | 1    |
| 2LPSI 2A | Low Press. Safety Inj. Pump 2A | 2     | A/B      | 2    |
| 2LPSI 2B | Low Press. Safety Inj. Pump 2B | 2     | A/B      | 2    |

2. **Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

3. **Applicable Code Requirement**

ISTB-3510(b)(1) – *Range*, The full scale range of each analog instrument shall be not greater than three times the reference value.

4. **Reason for Request**

Table ISTB-3500-1 requires the accuracy of instruments used to measure differential pressure for Group A and B tests to be equal to or better than  $\pm 2$  percent based on full-scale reading of the instrument. This means that the accuracy of the actual measurement can vary as much as  $\pm 6$  percent for Group A and B tests, assuming the range of the instrument is extended to the maximum allowed deviation (3 times the reference value).



**Pump Relief Request – PR-05**  
(Page 2 of 3)

An example of calculating indicated instrument accuracy for Group A and B test is as follows (from NUREG-1482, Rev. 1, Paragraph 5.5.1):

This example uses a reference pressure value of 20 psig and an analog pressure gauge with full scale range of 60 psig that is calibrated to  $\pm 2\%$  of full scale.

Code requirement:

Reference value = 20 psig  
3 x reference value = 60 psig  
Instrument tolerance = 1.2 psig ( $\pm 2.0\% \times 60$  psig)

Indicated accuracy:

Instrument tolerance / Reference value x 100 = Indicated accuracy

$$\pm 1.2 \text{ psig} / 20 \text{ psig} \times 100 = \pm 6\%$$

Following the methodology used in NUREG-1482 and the example above, the indicated instrument accuracy can be calculated for each pressure instrument in this relief request. The following table provides the calculated indicated instrument accuracies:

Table 1: Calculated Instrument Accuracies for Selected Pressure Instruments

| PUMP ID | INSTR NUMBER | PARAMETER          | REF VALUE | INSTR RANGE | INSTR ACCUR | INSTR TOL    | IND ACCUR   |
|---------|--------------|--------------------|-----------|-------------|-------------|--------------|-------------|
| 1A LPSI | PI-3314      | Discharge Pressure | 200 PSIG  | 0-600 PSIG  | $\pm 0.5\%$ | $\pm 3$ PSIG | $\pm 1.5\%$ |
| 1B LPSI | PI-3315      | Discharge Pressure | 195 PSIG  | 0-600 PSIG  | $\pm 0.5\%$ | $\pm 3$ PSIG | $\pm 1.5\%$ |
| 2A LPSI | PI-3314      | Discharge Pressure | 190 PSIG  | 0-600 PSIG  | $\pm 0.5\%$ | $\pm 3$ PSIG | $\pm 1.6\%$ |
| 2B LPSI | PI-3315      | Discharge Pressure | 185 PSIG  | 0-600 PSIG  | $\pm 0.5\%$ | $\pm 3$ PSIG | $\pm 1.6\%$ |

Where:

REF VALUE = reference value established by the procedure

INSTR ACCUR = accuracy to which instrument is calibrated

INSTR TOL = maximum INSTR RANGE times INSTR ACCUR

IND ACCUR = INSTR TOL divided by REF VALUE times 100



**Pump Relief Request – PR-05**  
(Page 3 of 3)

As shown on Table 1, the indicated accuracy for all the instruments is less than or equal to 1.6% of the reference value. These accuracy's are better than those allowed by the Code for both Group A or B test. Therefore, there is no overall impact on the capability to detect and monitor degradation during pump tests based on use of these instruments. Continued use of the existing installed instruments is supported by NUREG-1482, Rev. 1, Paragraph 5.5.1 which states that when the range of an installed analog instrument is greater than 3 times the reference value but the accuracy of the instrument is more conservative than the Code, NRC staff may grant relief when the combination of the range and accuracy yields a reading at least equivalent to the reading achieved from instruments that meet the Code requirements (i.e., up to  $\pm 6\%$  for Group A and B test).

**5. Proposed Alternative and Basis for Use**

Since the indicated accuracy of each permanently installed instrument is less than the allowed tolerance, FPL requests approval for continued use of the instruments listed in this relief request.

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

This relief request was previously approved for the third ten-year interval at St. Lucie Plant 1 & 2 as Relief Request PR-13, by Safety Evaluation and Letter dated December 7, 2000.



**Pump Relief Request – PR-06**  
**Boric Acid Makeup (BAM) Pumps Quarterly Flow Test**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(f)(5)(iii)

Inservice Testing Impracticality

**1. ASME Code Component(s) Affected**

| Pump    | Description               | Class | Category | Unit |
|---------|---------------------------|-------|----------|------|
| 1BAM 1A | Boric Acid Makeup Pump 1A | 2     | Group A  | 1    |
| 1BAM 1B | Boric Acid Makeup Pump 1B | 2     | Group A  | 1    |
| 2BAM 2A | Boric Acid Makeup Pump 2A | 2     | Group A  | 2    |
| 2BAM 2B | Boric Acid Makeup Pump 2B | 2     | Group A  | 2    |
|         |                           |       |          |      |

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-5121(b) – The resistance of the system shall be varied until the flow rate equals the reference point. The differential pressure shall then be determined and compared to its reference value. Alternatively, the flow rate shall be varied until the differential pressure equals the reference point and the flow rate determined and compared to the reference flow rate value.

**4. Reason for Request**

There are four flowpaths available for performing inservice testing of the BAM Pumps. These include the primary flow path to the charging pump suction header, a recirculation line leading back to the Refueling Water Tank (RWT), a line leading to the Volume Control Tank (VCT) and the BAM Tank recirculation line. For reasons stated below, none of these flow paths are either available or equipped to support pump Group A testing during plant operation or cold shutdown:

- a. Operating of the BAM Pumps aligned to discharge into the charging pump suction header will result in the introduction of highly concentrated boric acid solution from the boric acid makeup tanks into the suction of the charging pumps. During plant operation this would result in the addition of excess boron to the RCS. This rapid insertion of negative reactivity would result in RCS cooldown and de-pressurization. A large enough boron addition could



**Pump Relief Request – PR-06**  
(Page 2 of 3)

result in an unscheduled plant trip and a possible safety injection system actuation. During cold shutdown, the introduction of excess quantities of boric acid into the RCS via this flowpath is also undesirable from the aspect of maintaining proper plant chemistry and the inherent difficulties that may be encountered during the subsequent startup due to the over-boration of the RCS. In addition, the waste management system would be overburdened by the large amounts of RCS coolant that would then require processing to reduce boron concentration.

- b. Another alternate flowpath would involve the operation of a BAM Pump aligned to recirculate water to the Refueling Water Tank (RWT). This alignment would result in depletion of the associated BAM Tank inventory. During normal operation Technical Specifications requires a combination of one or both BAM Tanks be maintained with a certain volume and concentration of boric acid. The transfer of borated water from either one or both of the BAM Tanks could result not only the loss of a required boration source as defined by Technical Specifications, but in the case of St. Lucie Unit 2, could result in an increase of boron concentration above the RWT concentration limit. (Unit 2 RWT boron concentration is required to be between 1720 and 2100 ppm) In addition this flow path is not equipped with flow measurement instrumentation, so flow could not be readily determined.
- c. Alignment of a BAM Pump to the Volume Control Tank (VCT) will also result in the same issues as described in (b) above in regards to the depletion of the associated BAM tank of it's inventory. In this case, not only could the transfer of borated water from either one or both of the BAM Tanks result in a loss of the required boration sources as defined by Technical Specifications, but injecting the highly borated water into the VCT would introduce this highly borated water to the suction of the charging pumps, resulting in the addition of negative reactivity into the RCS, with the possible same results as described in (a) above. Again, this flow path is also not equipped with flow measuring instrumentation.

It is noted that in options (b) and (c) above, transference of the contents of a BAM tank, a fixed and limited amount of volume, will result in the reduction of suction pressure over the course of the test, to the BAM Pump with the result of producing a variable flow rate which could not be easily compared/trended to previous flow measurements.(i.e. repeatability) BAM Tanks' level typically varies from test to test by as much as 15 to 20 feet.

- d. Alignment of a BAM Pump to recirculate flow back to the BAM Tank is accomplished through a fixed resistance circuit, which is essentially the pumps minimum flow test line, the same flowpath which is also utilized to periodically mix the contents of each tank, so as to prevent stratification of the



**Pump Relief Request – PR-06**  
(Page 3 of 3)

highly borated water. While operation of the BAM Pumps can be accomplished without the introduction of highly borated water to the RCS or affecting the limits associated with the maintenance of the required number of borated water sources, there is no flowrate measuring instrumentation installed in these lines

**5. Proposed Alternative and Basis for Use**

It is proposed that quarterly Group A testing of the BAM pumps be accomplished utilizing the fixed-resistance BAM tank recirculation line. Pump differential pressure and vibration will be measured and compared to their respective reference values per ISTB-5121(c) and (d).

The removal of quarterly flow testing of these pumps has been deemed acceptable per NRC Generic Letter 89-04, Position 9, which allows elimination of minimum flow test line flowrate measurements providing inservice tests are performed during cold shutdowns or refueling periods under full or substantial flow conditions where pump flowrate is recorded and evaluated. The proposed alternate testing is consistent with this philosophy and the intent of Position 9.

Full flow testing will continue to be performed on a Comprehensive test frequency, during refueling conditions.

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

This relief request was previously approved for the third ten-year interval at St. Lucie Plant 1 & 2 as Relief Request PR-03, by Safety Evaluation and Letter dated March 16, 1999.



**Pump Relief Request – PR-07**  
**Diesel Fuel Oil Transfer Pump 2A Comprehensive Flow Testing**  
(Page 1 of 3)

Proposed Alternative in Accordance with 10 CFR 50.55a(a)(3)(i)

Alternative Provides Acceptable Level of Quality  
and Safety

**1. ASME Code Component(s) Affected**

| Pump    | Description                      | Class | Category | Unit |
|---------|----------------------------------|-------|----------|------|
| 2DOT 2A | Diesel Fuel Oil Transfer Pump 1A | 3*    | Group B  | 2    |
|         |                                  |       |          |      |

\* - Optional Upgrade to Class 3

**NOTE**

The St. Lucie Units 1 & 2 diesel fuel oil system was optionally upgraded to Class 3 and thus, testing is optional per ISTA-1320, "Classification". Consequently, this relief request is provided for information only and approval is not required.

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-3300(e)(1) – Reference values shall be established within +/- 20% of pump design flow rate for the comprehensive test.

**4. Reason for Request**

Pursuant to 10 CFR 50.55a, "Codes and Standards", paragraph (a)(3), relief is requested from the requirement of ASME OM Code ISTB-3300(3)(1). The basis of the relief request is that the proposed alternative would provide an acceptable level of quality and safety.

The specified +/- 20% of pump design flow rate can not be achieved for the subject pump during normal quarterly Group B testing or during the Comprehensive pump test due to the alignment of the respective units diesel oil storage tanks. The design flow rate of the diesel oil transfer pump is 64 gpm at 68 feet of head as determined from the manufacturers pump curve at the Best Efficiency Point (BEP).



**Pump Relief Request – PR-07**  
(Page 2 of 3)

Specifically, relief is requested from ISTB-3300(e)(1) in meeting the specified +/- 20% of design flow (51.2 gpm [64 gpm x 80%]) during the comprehensive pump test.

**5. Proposed Alternative and Basis for Use**

The Diesel Fuel Oil Transfer pump is required to automatically start when the associated Emergency Diesel Generator (EDG) is started during accident conditions and the associated Day Tank level decreases below the low level setpoint. The pump is required to transfer fuel oil from the Diesel Oil Storage Tank to the associated EDG Day Tank for consumption by the EDG.

The pump has an original manufacturers design rating of 25 gpm. UFSAR Table 9.5-1 indicates a flow rate of 25 gpm corresponding to 30 psig discharge pressure for the pump. The St. Lucie EDG Design Basis requires a flow rate of 9.5 gpm, which is at least twice the consumption rate of the EDG (4.75 gpm).

The 2A Diesel Oil Transfer Pump is a constant speed, centrifugal pump model 3196 manufactured by Gould. During normal operation the pump is in the standby mode aligned to take suction from the Diesel Oil Storage Tank (DOST) and discharge to the EDG Day Tank.

The design of the Diesel Fuel Oil system is such that the test loop used during quarterly testing allows recirculating flow back to the respective DOST. This flow path is un-instrumented and considered a fixed resistance system (see Attachment 1, Unit 2 Diesel Oil Transfer Pump Flow Path Sketch). Since the pump is categorized as a group B pump, differential pressure is used as the measured parameter while flow is not measured, nor is it required to be measured.

For the comprehensive test, however, the 2A Diesel Oil Transfer pump is aligned to take suction from the 2A DOST and discharge to the 2B DOST. In this alignment, the level change in the DOST can be correlated to pump delivered flow. Several issues exist with this alignment including a narrow band of DOST level constrained by Technical Specifications. The Unit 2 DOSTs are 125 gallons per inch of level. The overflows are located at 29 feet 2 ¼ inches. The minimum Unit 2 Technical Specification volume is greater than 40,000 gallons. Adding the unusable volume in the DOST, the minimum Technical Specification level corresponds to 27 feet.

The associated diesel consumption rate for the subject pump is less than 10 gpm, however, the pump Best Efficiency Point (BEP) flow rate is approximately 64 gpm. During the comprehensive pump test using the flow path described above, the reference value for flow is approximately 46 gpm. This value is 71.9 % of the BEP flow rate. The minimum Code required flow rate for the comprehensive test is 51.2 or 80%.



**Pump Relief Request – PR-07**  
(Page 3 of 3)

As an alternative to testing at +/- 20 % of design flow, St. Lucie will test the 2A Diesel Oil Transfer pump at a reference flow rate of approximately 46 gpm versus 51.2 gpm (20 % of design flow of 64 gpm) each refueling outage. All other requirements of the comprehensive test will be followed. At this reference point of 46 gpm, the characteristic curve for the pump is essentially the same slope as at the Code required 51.2 gpm. Pump degradation as noted by measuring flow rate can be detected for a given differential pressure reference value.

The reference flow rate of 46 gpm corresponds to 71.9 % of pump design flow. At the reference conditions the flow values are currently at a point on the curve that is effective for monitoring and detecting degradation. Testing at this reference point has resulted in very repeatable measurements. To establish the flow rate within +/- 20 % of the BEP would require a flow rate of at least 51.2 gpm. Establishing the flow at 51.2 gpm does not increase the ability to detect degradation or assess pump conditions since the slope of the pump curve is essentially a straight line from 40 gpm to 60 gpm. Therefore, testing at higher flows does not increase the ability to detect hydraulic degradation.

The proposed flow rate reference value for the comprehensive test is 46 gpm. The slope of the pump manufacturer's curve at 46 gpm is approximately 4 gpm change for a change of 2 feet of head. The slope of the manufacturer's pump curve at the minimum Code required test point (51.2 gpm) is approximately 4 gpm change for a change of 2 feet of head. There is no significant difference between the slopes at these two points on the curve. Therefore the ability to detect and monitor degradation is not increased by increasing the flow rate.

Performance of the comprehensive test at approximately 5 gpm less than the Code required flow provides an accurate assessment of pump health and operational readiness.

Based on inventory concerns with the performance of this test, coupled with the risk of declaring multiple diesel generators inoperable, this alternative provides an acceptable level of quality and safety.

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

None




10 CFR 50.55a Request Number PR-07

(continued)

Attachment 1

Unit 2 Diesel Oil Transfer Pump Flow Path Sketch

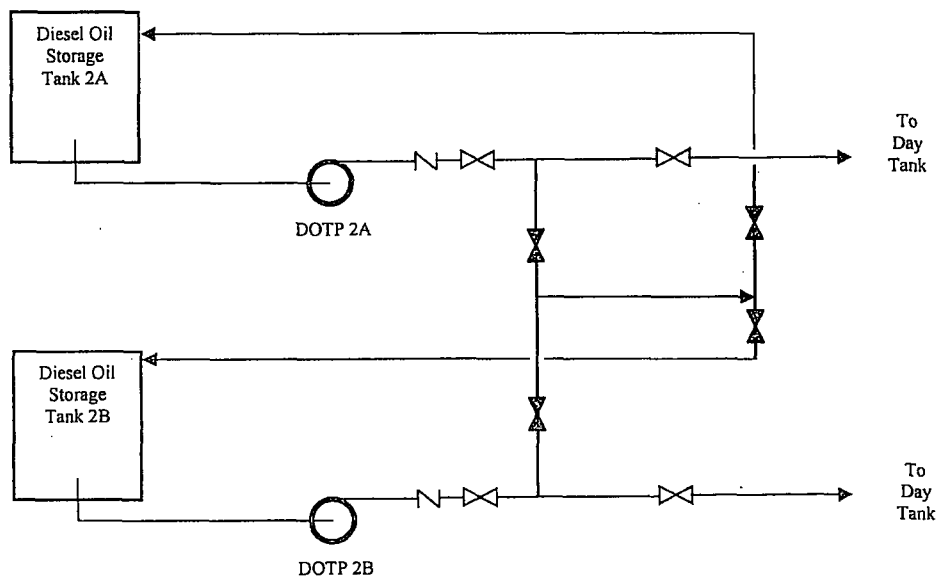



**Pump Relief Request – PR-08**  
**Unit 1 Diesel Fuel Oil Transfer Pump Testing**  
(Page 1 of 4)

Proposed Alternative in Accordance with 10 CFR 50.55a(a)(3)(i)

Alternative Provides Acceptable Level of Quality and Safety

**1. ASME Code Component(s) Affected**

| Pump    | Description                      | Class | Category | Unit |
|---------|----------------------------------|-------|----------|------|
| 1DOT 1A | Diesel Fuel Oil Transfer Pump 1A | 3*    | Group B  | 1    |
| 1DOT 1B | Diesel Fuel Oil Transfer Pump 1B | 3*    | Group B  | 1    |
|         |                                  |       |          |      |

\* - Optional Upgrade to Class 3

**NOTE**

The St. Lucie Units 1 & 2 diesel fuel oil system was optionally upgraded to Class 3 and thus, testing is optional per ISTA-1320, "Classification". Consequently, this relief request is provided for information only and approval is not required.

**2. Applicable Code Edition and Addenda**

ASME OM Code 2001 Edition through 2003 Addenda

**3. Applicable Code Requirement**

ISTB-5223 requires that "Comprehensive tests shall be conducted with the pump operating at a specified reference point."

**4. Reason for Request**

Pursuant to 10 CFR 50.55a, "Codes and Standards", paragraph (a)(3), relief is requested from the requirements of ASME OM Code ISTB-5223. The basis of the relief request is that the proposed alternative would provide an acceptable level of quality and safety.

As discussed in NUREG-1482 Revision 1, "Guidance for Inservice Testing at Nuclear Power Plants," Section 5.2, the use of pump curves for reference values of flow rate and differential pressure is acceptable when it is impractical to establish a set of fixed reference values. Section 5.2 of NUREG-1482 delineates the elements



**Pump Relief Request – PR-08**  
(Page 2 of 4)

on the procedures for developing and implementing the curves that should be incorporated in to the IST Program. These elements are included in ASME OM Code Case OMN-9. Since Code Case OMN-9 is applicable to OM Code 1990 through Omb Code 1992, relief is required to implement Code Case OMN-9 with later editions of the Code.

In the latest (last revised August 2, 2006) issuance of 10 CFR 50.55a, 10 CFR 50.55(a)(b) states in part, that Regulatory Guide 1.192, "Operating and Maintenance Code Case Acceptability, ASME Code" (June 2003), has been approved for incorporation by reference by the Director of the Office of the Federal Register pursuant to 5 U.S.C. 552(a) and 1 CFR part 51. In Regulatory Guide 1.192, it states within Table 2, "Conditionally Acceptable OM Code Cases", that the alternative rules of ASME Code Case OMN-9, Rev. 0, may be applied with the following provisions:

(1) When a reference curve may have been affected by repair, replacement, or routine servicing of a pump, a new reference curve must be determined, or an existing reference curve must be reconfirmed, in accordance with Section 3 of this Code Case.

(2) If it is necessary or desirable, for some reason other than that stated in Section 4 of this Code Case, to establish an additional reference curve or set of curves, these new curves must be determined in accordance with Section 3.

This conditional acceptance of OMN-9, Rev. 0, per Regulatory Guide 1.192 is applicable in lieu of the provisions for using a pump curve for testing as specified in Subsection ISTB of the 1995 Edition up to and including the 2000 Addenda of the ASME OM Code.

St. Lucie Power Station proposes to adopt the requirements of Code Case OMN-9, as presented reaffirmed in the ASME Omb Code for 2006, in lieu of those requirements stated in ISTB-5223 for operating the pump at a specified reference point during the Comprehensive tests.

**5. Proposed Alternative and Basis for Use**

There is no instrumentation installed on the diesel fuel oil transfer system for readily determining pump flow rate information. Testing is performed by transferring fuel oil from one fuel oil storage tank to the opposite trains tank. Measurements of initial and final fuel oil tank levels are utilized for determining pump flow rate over the duration of the test. This methodology does not readily allow pump flow to be fixed to a reference value without repeated iterations of testing. Repeated testing is impractical due to the complex nature of the test and the relatively narrow band of fuel oil storage tank inventory available for testing.



**Pump Relief Request – PR-08**  
(Page 3 of 4)

As discussed above it is extremely difficult to return to a specific value of flow rate for testing of these pumps. Multiple reference points could be established according to the Code, but it would be impracticable to obtain reference values at every possible point.

Therefore, the subject pumps will be tested in a range of flows and the results will be compared to acceptance criteria based on a portion of the pump curve and the hydraulic acceptance criteria given in ISTB.

Evaluation of pump performance and system requirements indicates that the diesel fuel oil transfer pumps have been performing acceptably. Comparison of pump head and flow values to expected values derived from the manufacturers pump curves indicates no abnormalities or degradation.

The following elements are used in developing and implementing the reference pump curves.

- (1) A reference pump curve (flow rate vs. discharge pressure) has been established for the 1A and 1 B diesel fuel oil transfer pumps. These curves represent acceptable pump performance which exceeds the performance indicated on the manufacturers pump curves.
- (2) To reduce the uncertainty associated with the pump curves and increase the adequacy of the acceptance criteria, special pressure test gauges (plus or minus 0.5 full scale accuracy) were installed. Level in the fuel oil tank is measured using a level tape that is capable of measuring fuel oil tank level change to plus or minus 1/16th of an inch. The amount of fuel transferred is sufficient to include allowance for fuel oil tank volume inaccuracy within this 1/16th of an inch level span. The combination of level measurement accuracy and test interval facilitates accurate flow rate measurements meeting Code accuracy requirements.
- (3) The reference pump curves are based on five test points enveloping the rated capacity of the pumps and the portion of the curves to be duplicated during future testing.
- (4) The reference pump curves exhibit an essentially constant downward slope throughout all flows for the pumps. The design flow is within in the range of test flow points. The pump design flow and the Best Efficiency Point (BEP) for the pumps bound the portion of the curves to be duplicated for future testing.



**Pump Relief Request – PR-08**  
(Page 4 of 4)

(5) The acceptance criteria limits do not conflict with Technical Specifications or Final Safety Analysis Report operability criteria. The testing is adequate for ensuring the design flow of 25 gpm is capable of being transferred to the emergency diesel generators as required.

(6) Review of vibration data shows no significant variance in vibration readings over the range of flows tested. Thus only one fixed reference value has been assigned for each vibration location.

(7) After any maintenance or repair that may affect the existing reference pump curve, a new reference pump curve shall be determined or the existing pump curve validated by an inservice test. New reference pump curves shall be established based upon at least 5 points enveloping the rated capacity of the pumps and the portion of the curves to be duplicated during future testing.

Acceptance criteria will be based on a portion of the pump curve and not on discreet reference values. The guidelines set forth in Code Case OMN-9 and the conditions identified in Regulatory Guide 1.192 will be followed.

Using the provisions of this relief request as an alternative to the specific requirements of ISTB-5223 identified above will provide adequate indication of pump performance and continue to provide an acceptable level of quality and safety. Therefore, pursuant to 10 CFR 50.55a(a)(3)(i) we request relief from the specific ISTB Code requirements identified in this relief request.

**6. Duration of Proposed Alternative**

This proposed alternative will be utilized for the entire 4<sup>th</sup> 120 month interval.

**7. Precedents**

A similar relief request was utilized during the third ten-year interval at St. Lucie Plant Unit 1 and was identified as Relief Request PR-14.

Similar relief requests, P-3 and P-4, were previously approved for North Anna Power Station Units 1 & 2 on April 11, 2006. Docket Nos. 50-338 and 50-339 (TAC Nos. MC6663, MC6664, MC6665, and MC6666).



**ATTACHMENT 4**

**VALVE RELIEF REQUEST INDEX**

| <u>Designator</u> | <u>Description</u> | <u>Approval Date</u> |
|-------------------|--------------------|----------------------|
|                   | NONE               |                      |



**ATTACHMENT 5**

**VALVE RELIEF REQUESTS**

NONE



## ATTACHMENT 6

### COLD SHUTDOWN JUSTIFICATION INDEX

| <b>Cold<br/>Shutdown<br/>Justification<br/>No.</b> | <b>Description</b>                                 |
|--|--|
| CS-01  | Pressurizer Spray Control Valves – Unit 1          |
| CS-02  | Reactor Coolant System Vents                       |
| CS-03  | Auxiliary Pressurizer Spray Valves                 |
| CS-04  | Letdown Line Isolation Valves                      |
| CS-05  | Volume Control Tank Outlet Valve                   |
| CS-06  | RCP Seal Water Return Valves                       |
| CS-07  | SI Pump Discharge Check Valves                     |
| CS-08  | Shutdown Cooling Suction RCS Isolation Valves      |
| CS-09  | Main Steam Isolation Valves                        |
| CS-10  | Main Steam Isolation Valve Bypass Valves           |
| CS-11  | Main Feedwater Pump Isolation Valves               |
| CS-12  | Main Feedwater Isolation Valves                    |
| CS-13  | RCP Cooling Water Supply / Return Isolation Valves |
| CS-14  | SIT Vent Valves                                    |
| CS-15  | Primary Containment Instrument Air Supply          |
| CS-16  | Unit 2 Containment Purge Valves                    |



**ATTACHMENT 7**

**COLD SHUTDOWN JUSTIFICATIONS**



**Cold Shutdown Justification - CS-01**

(Rev. 0)  
(Page 1 of 1)

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1PCV-1100E                     | RCS                  | 1                   | B                      | 1                  |
| 1PCV-1100F                     | RCS                  | 1                   | B                      | 1                  |

**Function**

These angle valves are the unit 1 Pressurizer Spray Valves. During normal power operations, these two air operated valves are used to control RCS pressure by automatically throttling the spray flow into the pressurizer. During a post-LOCA recovery, hot-leg injection into the reactor is required. The alternate flowpath for hot-leg injection is via the auxiliary spray line into the pressurizer and out through the surge line into the RCS hot-leg. To insure the maximum hot-leg injection flow, this valve must be closed to block any back flow through the normal spray line into the RCS cold-leg.

**Justification**

It is impracticable to full stroke close exercise these valves during operation as it would have an immediate negative effect on RCS pressure. The increased spray flow would condense part of the steam bubble inside the pressurizer, resulting in a rapid drop in pressurizer pressure, resulting in a rapid drop in RCS pressure, resulting in a plant trip.

**Alternative Frequency**

These subject valves shall be full-stroke exercised to the closed position during cold shutdown per ISTC-3521(c)



**Cold Shutdown Justification - CS-02**

(Rev. 0)  
(Page 1 of 1)

| <u>Valve<br/>Number</u> | <u>System</u> | <u>Class</u> | <u>Category</u> | <u>Unit</u> |
|-------------------------|---------------|--------------|-----------------|-------------|
| 1V1441                  | RCS           | 2            | B               | 1           |
| 1V1442                  | RCS           | 2            | B               | 1           |
| 1V1443                  | RCS           | 2            | B               | 1           |
| 1V1444                  | RCS           | 2            | B               | 1           |
| 1V1445                  | RCS           | 2            | B               | 1           |
| 1V1446                  | RCS           | 2            | B               | 1           |
| 1V1449                  | RCS           | 2            | B               | 1           |
| 2V1460                  | RCS           | 2            | B               | 2           |
| 2V1461                  | RCS           | 2            | B               | 2           |
| 2V1462                  | RCS           | 2            | B               | 2           |
| 2V1463                  | RCS           | 2            | B               | 2           |
| 2V1464                  | RCS           | 2            | B               | 2           |
| 2V1465                  | RCS           | 2            | B               | 2           |
| 2V1466                  | RCS           | 2            | B               | 2           |

**Function**

These globe valves are the Reactor Coolant Gas Vent Valves. This normally closed (key locked) solenoid operated valve must open to vent non-condensable gases trapped in the reactor vessel head/pressurizer to either the quench tank or the containment atmosphere during post accident conditions when large quantities of gases may collect in these high points. During normal plant operation, the valve is maintained closed to prevent inadvertent operation of the system .

**Justification**

It is impracticable to exercise these valves closed during normal power operations. Stroking these valves during normal operation would result in not only an increase in the leakage rate from the RCS to levels not allowable in Technical Specifications, but due to a high dP across the valve, would result in a higher probability of the valve sticking open, which would result in even greater leakage from the RCS and result in the violation of Technical Specification 3.4.15 (both Unit 1 and 2), which requires that these valves be closed during modes 1 through 4. It is therefore impractical to stroke these valves which are required by Technical Specifications to be locked closed during Modes 1 through 4.

**Alternative Frequency**

These subject valves shall be full-stroke exercised to during cold shutdown per ISTC-3521(c)



**Cold Shutdown Justification - CS-03**  
**(Rev. 0)**  
**(Page 1 of 1)**

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1SE-02-03                      | CVCS                 | 1                   | B                      | 1                  |
| 1SE-02-04                      | CVCS                 | 1                   | B                      | 1                  |
| 2SE-02-03                      | CVCS                 | 1                   | B                      | 2                  |
| 2SE-02-04                      | CVCS                 | 1                   | B                      | 2                  |

**Function**

These normally locked closed (key switch) solenoid operated globe valves are the Aux Pressurizer Spray Isolation Valve. These valves must open by remote manual operation to provide a flow path from the charging system to the pressurizer. This function provides an auxiliary flow path to cool and depressurize the pressurizer. The Unit 1 valves must also open by remote manual operation to provide an alternate hot leg injection flow path from the HPSI pumps to the pressurizer during long term post accident cooling

**Justification**

It is impracticable to exercise these valves open or closed during normal power operations. Opening either one of the units valves (or failure in the open position) during plant operation would result in an undesirable RCS pressure transient that could result in a plant trip. In addition to the immediate pressure transient consequences, flow through these valves would result in subjecting the pressurizer lines and spray nozzles to a thermal shock.

**Alternative Frequency**

These subject valves shall be full-stroke exercised during cold shutdown per ISTC-3521(c)



**Cold Shutdown Justification - CS-04**

(Rev. 0)

(Page 1 of 1)

| <u>Valve<br/>Number</u> | <u>System</u> | <u>Class</u> | <u>Category</u> | <u>Unit</u> |
|-------------------------|---------------|--------------|-----------------|-------------|
| 1V2515                  | CVCS          | 1            | A               | 1           |
| 1V2516                  | CVCS          | 1            | A               | 1           |
| 2V2515                  | CVCS          | 1            | B               | 2           |
| 2V2516                  | CVCS          | 1            | A               | 2           |
| 2V2522                  | CVCS          | 2            | A               | 2           |
| 2V2523                  | CVCS          | 2            | B               | 2           |

**Function**

Valves 1(2)V2515/16 are air operated globe valves, located in the supply line to the Regenerative Heat Exchanger from the RCS. These valves are required to close upon receipt of either a CIS or SIAS signal and function as containment isolation valves. (except for 2V2515, which only closes on an SIAS and does not function as a CIV)

Valve 2V2522 is the Unit 2 Letdown Containment Isolation Valve, an air operated globe valve and closes on a CIS signal.

Valve 2V2523 is the Unit 2 Charging Header Isolation Valve, an air operated gate valve, through which charging flow passes on its way back to the RCS

**Justification**

It is impracticable to exercise these valves open or closed during normal power operations. Stroke time testing any of these valve, which would involve the closure of the valve during operation would result in either the removal of charging into the RCS, or the cessation of letdown flow, resulting in pressurizer level transients that could result in a potential plant trip and shutdown.

In addition to pressurizer level transients, closure of 2V2523 has the potential of causing damage to the operating charging pump by dead heading the pump and lifting it's relief valve.

**Alternative Frequency**

These subject valves shall be full-stroke exercised during cold shutdown per ISTC-3521(c)



**Cold Shutdown Justification - CS-05**

(Rev. 0)  
(Page 1 of 1)

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1V2501                         | CVCS                 | 2                   | B                      | 1                  |
| 2V2501                         | CVCS                 | 2                   | B                      | 2                  |

**Function**

Valves 1(2)V2501 are the Unit 1 and 2 Volume Control Tank (VCT) Discharge Isolation Gate Valves. These valve remain open during power operation, providing a suction flowpath from the VCT to the charging pump suction. These valves close upon receipt of a SIAS to prevent diversion, along with it's associated downstream check valve, of flow from the charging system back into the VCT.

**Justification**

It is impracticable to exercise these valves open or closed during normal power operations. Closing this valve during power operation would isolate the VCT from the charging pump suction header and potentially damage any operating charging pump. In addition, loss of suction flow to a charging pump would result in loss of charging flow, which would then be accompanied by a pressurizer level transient resulting in the potential of a plant trip.

**Alternative Frequency**

These subject valves shall be full-stroke exercised during cold shutdown per ISTC-3521(c)



**Cold Shutdown Justification - CS-06**

(Rev. 0)

(Page 1 of 1)

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1SE-01-1                       | CVCS                 | 2                   | A                      | 1                  |
| 1V2505                         | CVCS                 | 2                   | A                      | 1                  |
| 2V2505                         | CVCS                 | 2                   | A                      | 2                  |
| 2V2524                         | CVCS                 | 2                   | A                      | 2                  |

**Function**

These above reference valves are either air operated gate or globe valves in the Reactor Coolant Pump (RCP) seal return line. These valve close upon a CIS.

**Justification**

It is impracticable to exercise these valves closed during normal power operations. The closure of any of these valves during power operation, which would be during RCP operation, would remove RCP seal flow, resulting in damage to the pumps seal package. Pump seal failure would result in immediate plant shutdown.

**Alternative Frequency**

These subject valves shall be full-stroke exercised during cold shutdown, when RCPs are secured per ISTC-3521(c)



**Cold Shutdown Justification - CS-07**

(Rev. 0)

(Page 1 of 1)

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1V3659                         | SI                   | 2                   | B                      | 1                  |
| 1V3660                         | SI                   | 2                   | B                      | 1                  |

**Function**

These motor operated valves must remain open to provide a flowpath for minimum flow requirements for the HPSI and LPSI pumps. These valves must also close so as to isolate the min flow path from the HPSI and LPSI Pumps to the RWT following receipt of a recirculation actuation signal (RAS).

**Justification**

It is impracticable to exercise these valves closed during normal power operations. Closure of either of these two valves during Modes 1-4 would result in rendering all the HPSI and LPSI pumps inoperable, having removed their recirculation path back to the RWT. Without a pump min flow recirculation path, operation of either class of pump could result in damage to the pump due to loss of cooling flow. As a result, it is undesirable to stroke time test these valves in any other condition then when the associated pumps are OOS, to prevent potential damage to the pump.

**Alternative Frequency**

These subject valves shall be full-stroke exercised during cold shutdown, when neither the LPSI or HPSI pumps are capable of automatic starting. ISTC-3521(c)



**Cold Shutdown Justification - CS-08**  
**(Rev. 0)**  
**(Page 1 of 1)**

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1V3480                         | SI                   | 1                   | A                      | 1                  |
| 1V3481                         | SI                   | 1                   | A                      | 1                  |
| 1V3651                         | SI                   | 1                   | A                      | 1                  |
| 1V3652                         | SI                   | 1                   | A                      | 1                  |
| 2V3480                         | SI                   | 1                   | A                      | 2                  |
| 2V3481                         | SI                   | 1                   | A                      | 2                  |
| 2V3651                         | SI                   | 1                   | A                      | 2                  |
| 2V3652                         | SI                   | 1                   | A                      | 2                  |

**Function**

These motor operated gate valves are the shutdown cooling suction isolation valves. These valves must open to provide a suction flowpath from the RCS for shutdown cooling. The Unit 1 valves must open to provide a flowpath following a LOCA for hot let injection. These valves must also close to provide a Pressure Isolation Valve (PIV) function between the RCS and the shutdown cooling system.

**Justification**

It is impracticable to exercise these valves open or closed (full or partial) during normal power operations since opening the valves places the plant in an undesirable configuration.

These valves are provided with electrical interlocks that prevent opening during reactor power operation, when RCS pressure exceeds 267 psia (276 psia for Unit 2). If the interlocks were to be defeated during normal operation these valves would be subjected to a large differential pressure (in excess of 2000 psid). At this differential pressure the valve operators are incapable of opening the valves. Then even if they could be opened at these higher differential pressure, the resultant stroking of the valve could result in damage to their seating surfaces. For these reasons exercising these valves in any plant condition other than cold shutdown is impractical.

**Alternative Frequency**

These valves will be exercised open and closed on a Cold Shutdown frequency during conditions which allow for an adequate test to be performed per. ISTC-3521(c)



**Cold Shutdown Justification - CS-09**

(Rev. 0)

(Page 1 of 1)

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1HCV-08-1A                     | MS                   | 2                   | B/C                    | 1                  |
| 1HCV-08-1B                     | MS                   | 2                   | B/C                    | 1                  |
| 2HCV-08-1A                     | MS                   | 2                   | B                      | 2                  |
| 2HCV-08-1B                     | MS                   | 2                   | B                      | 2                  |

**Function**

These valves on Unit 1 are air operated power check valves, and on Unit two are air operated globe valves. These valves are open to provide a flow path for steam from the steam generators to the turbine. This valve must close to prevent the uncontrolled blowdown of the associated steam generator in the event of a main steam line break, and to prevent the release of radioactive material in the event of a Steam Generator Tube Rupture.

**Justification**

It is impracticable to exercise these valves closed during normal power operations since closing these valves places the plant in an undesirable configuration.

Closing these valves for testing during normal power operations would interrupt steam flow from the Steam Generator to the main steam/turbine systems and result in a severe transient. Partial stroke exercising these valves is also impracticable since even a part-stroke exercise increases the risk of a valve closure when the unit is generating power.

**Alternative Frequency**

These valves will be exercised closed on a Cold Shutdown frequency during conditions which allow for an adequate test to be performed per. ISTC-3521(c)



**Cold Shutdown Justification - CS-10**

(Rev. 0)

(Page 1 of 1)

| <u>Valve<br/>Number</u> | <u>System</u> | <u>Class</u> | <u>Category</u> | <u>Unit</u> |
|-------------------------|---------------|--------------|-----------------|-------------|
| 2MV-08-1A               | MS            | 2            | B               | 2           |
| 2MV-08-1B               | MS            | 2            | B               | 2           |

**Function**

These motor operated globe valves are the Main Steam Isolation Valve Bypass Valves. These valve are opened during start up to provide steam downstream of the MSIV's to warm the lines. These valves are closed to provide pressure boundary integrity, containment integrity and provide isolation of the affected steam generator following a SGTR.

**Justification**

It is impracticable to exercise these valves closed during normal power operations since opening the valves places the plant in an undesirable configuration.

These Unit 2 valves, while installed in an orientation that ensures that they will close on an MSIS can not be assured to close against reverse steam flow. As a result both physical and administrative controls have been put in place so that during normal plant operation, the bypass valves are closed and the control circuit defeat switches are in the DEFEAT position with the key removed. [Ref. System Training Instruction 0711304, Rev. 16, page 19]

The operating criteria and interlocks prevent opening either of these valves whenever the MSIV or Bypass valve in the other steam line are open. Thus during normal plant operation these valves cannot be cycled.

**Alternative Frequency**

These valves will be exercised closed on a Cold Shutdown frequency during conditions which allow for an adequate test to be performed per. ISTC-3521(c)



**Cold Shutdown Justification - CS-11**

(Rev. 0)

(Page 1 of 1)

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1MV-09-01                      | FW                   | NC                  | B                      | 1                  |
| 1MV-09-02                      | FW                   | NC                  | B                      | 1                  |

**Function**

These motor driven gate valves are the Main Feedwater Pump Discharge Isolation Valves. This valve close upon receipt of either a Safety Injection Actuation Signal (SIAS) or Main Steam Isolation Signal (MSIS) to minimize the amount of water that may be injected into a faulted Steam Generator.

**Justification**

It is impracticable to exercise these valves closed during normal power operations since exercising these valves may result in a plant transient and subsequent reactor trip.

Exercising these valves closed during normal power operations requires isolating normal feedwater flow to the Steam Generator. This testing could result in a severe transient (i.e. level) in the associated Steam Generator and subsequent trip of the reactor. Partial stroke exercising these valves is also impracticable since even a part-stroke exercise increases the risk of a valve closure when the unit is generating power.

**Alternative Frequency**

These valves will be exercised to their safety related positions on a Cold Shutdown frequency during conditions which allow for an adequate test to be performed per. ISTC-3521(c)



**Cold Shutdown Justification - CS-12**

(Rev. 0)

(Page 1 of 1)

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1HCV-09-7                      | FW                   | 2                   | B                      | 1                  |
| 1HCV-09-8                      | FW                   | 2                   | B                      | 1                  |
| 2HCV-09-1A                     | FW                   | 2                   | B                      | 2                  |
| 2HCV-09-1B                     | FW                   | 2                   | B                      | 2                  |
| 2HCV-09-2A                     | FW                   | 2                   | B                      | 2                  |
| 2HCV-09-2B                     | FW                   | 2                   | B                      | 2                  |

**Function**

These gate valves are the units Main Feedwater Isolation Valves. The Unit 1 pneumatically operated valves close to isolate main feedwater flow from the generator upon both an Safety Injection Isolation Signal (SIAS) and Main Steam Isolation Signal (MSIS). The Unit 2 hydraulic-pneumatically operated valves close to isolate main feedwater flow from the generator upon both a MSIS and an Aux Feedwater Actuation Signal (AFAS)

**Justification**

It is impracticable to exercise these valves closed during normal power operations since exercising these valves may result in a plant transient and subsequent reactor trip.

Exercising these valves closed during normal power operations requires isolating normal feedwater flow to the Steam Generator. This testing could result in a severe transient (i.e. level) in the associated Steam Generator and subsequent trip or the reactor. Partial stroke exercising these valves is also impracticable since even a part-stroke exercise increases the risk of a valve closure when the unit is generating power.

**Alternative Frequency**

These valves will be exercised closed on a Cold Shutdown frequency during conditions which allow for an adequate test to be performed per. ISTC-3521(c)



**Cold Shutdown Justification - CS-13**

(Rev. 0)

(Page 1 of 1)

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1HCV-14-1                      | CCW                  | 2                   | A                      | 1                  |
| 1HCV-14-2                      | CCW                  | 2                   | A                      | 1                  |
| 1HCV-14-6                      | CCW                  | 2                   | A                      | 1                  |
| 1HCV-14-7                      | CCW                  | 2                   | A                      | 1                  |
| 2HCV-14-1                      | CCW                  | 2                   | A                      | 2                  |
| 2HCV-14-2                      | CCW                  | 2                   | A                      | 2                  |
| 2HCV-14-6                      | CCW                  | 2                   | A                      | 2                  |
| 2HCV-14-7                      | CCW                  | 2                   | A                      | 2                  |

**Function**

These power operated butterfly valves are the RCP Cooling Water Containment Isolation Valves. Flow through these valves provide cooling for both the RCPs and the Control Rod Drive (CRD) motors. These valves close so as to provide containment isolation.

**Justification**

It is impracticable to exercise these valves during normal power operations since closing the valves places the plant in an undesirable configuration.

These valves are required to remain open to ensure a continued supply of cooling water to both the reactor coolant pump and the control rod drives. Closing any of these valves during plant operation could result in severe RCP and CRD damage leading to plant operation in a potentially unsafe mode and a subsequent plant shutdown.

**Alternative Frequency**

These valves will be exercised closed on a Cold Shutdown frequency during conditions which allow for an adequate test to be performed per. ISTC-3521(c)



**Cold Shutdown Justification - CS-14**

(Rev. 0)

(Page 1 of 1)

| <u>Valve<br/>Number</u> | <u>System</u> | <u>Class</u> | <u>Category</u> | <u>Unit</u> |
|-------------------------|---------------|--------------|-----------------|-------------|
| 2V3733                  | SI            | 2            | B               | 2           |
| 2V3734                  | SI            | 2            | B               | 2           |
| 2V3735                  | SI            | 2            | B               | 2           |
| 2V3736                  | SI            | 2            | B               | 2           |
| 2V3737                  | SI            | 2            | B               | 2           |
| 2V3738                  | SI            | 2            | B               | 2           |
| 2V3739                  | SI            | 2            | B               | 2           |
| 2V3740                  | SI            | 2            | B               | 2           |

**Function**

These globe valves are the Safety Injection Tank (SIT) Vent valves. These valves must open to vent the SIT in the event the SIT outlet MOV cannot be closed to isolate the SIT from the RCS during plant cooldown. These valves must also remain closed to maintain Safety Injection Tank nitrogen pressure during Modes 1-3.

**Justification**

It is impracticable to exercise these valves during normal power operations since the act of testing this valve in would result in placing the plant in an undesirable configuration.

Stroking these valves during Modes 1-3 would result in venting the pressurized nitrogen cover gas from the SIT's, possibility reducing the pressure to below Technical Specification limits, potentially resulting in the unnecessary shutdown of the plant. It is for that reason that these valves are normally locked closed with their fuses pulled.

**Alternative Frequency**

These valve will be exercised open and closed on a Cold Shutdown frequency during conditions which allow for an adequate test to be performed per. ISTC-3521(c)



**Cold Shutdown Justification - CS-15**

(Rev. 0)

(Page 1 of 1)

| <u>Valve<br/>Number</u> | <u>System</u> | <u>Class</u> | <u>Category</u> | <u>Unit</u> |
|-------------------------|---------------|--------------|-----------------|-------------|
| 2HCV-18-1               | IA            | 2            | A               | 2           |

**Function**

This globe valve is the Instrument Air Containment Isolation Valve. This valve provides a flow path for instrument air into containment, and must close to provide containment isolation.

**Justification**

It is impracticable to exercise this valve during normal power operations since the act of testing this valve would result in placing the plant in an undesirable configuration..

Closing this valve isolates operating air to critical components in the containment building including the pressurizer spray, RCP cooling water supply and return, and CVCS letdown isolation valves and could cause severe plant transients, RCP damage and a plant trip. Failure in the closed position would cause a plant shutdown and RCP damage.

**Alternative Frequency**

These valve will be exercised open and closed on a Cold Shutdown frequency during conditions which allow for an adequate test to be performed per. ISTC-3521(c)



**Cold Shutdown Justification - CS-16**

(Rev. 0)

(Page 1 of 1)

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 2FCV-25-1                      | HVAC                 | 2                   | B                      | 2                  |
| 2FCV-25-2                      | HVAC                 | 2                   | A                      | 2                  |
| 2FCV-25-3                      | HVAC                 | 2                   | A                      | 2                  |
| 2FCV-25-4                      | HVAC                 | 2                   | A                      | 2                  |
| 2FCV-25-5                      | HVAC                 | 2                   | A                      | 2                  |
| 2FCV-25-6                      | HVAC                 | 2                   | B                      | 2                  |

**Function**

These butterfly valves are the Containment Purge Isolation Valves. These valves provide a flow path for the introduction of exhaust air from the containment, and must close to provide containment isolation.

**Justification**

It is impracticable to exercise these valves during normal power operations since the act of testing this valves would result in placing the plant in an undesirable configuration.

These valves are required by Technical Specification 3.6.1.7 to be maintained in the closed position when the plant is operating in Modes 1, 2, 3 or 4. Stroking these valves while in either Modes 1, 2, 3 or 4 would result in the plant entering in an Action statement which is not the intent of the IST Program.

**Alternative Frequency**

These valve will be exercised open and closed on a Cold Shutdown frequency during conditions which allow for an adequate test to be performed per. ISTC-3521(c)



**ATTACHMENT 8**

**REFUEL OUTAGE JUSTIFICATION INDEX**  
(Page 1 of 1)

| <b><u>Refueling<br/>Outage<br/>Justification<br/>No.</u></b> | <b><u>Description</u></b> |
|--|---------------------------|
|  | NONE                      |



**ATTACHMENT 9**

**REFUEL OUTAGE JUSTIFICATIONS**

**NONE**



**ATTACHMENT 10**

**STATION TECHNICAL POSITION INDEX**

| <b><u>Technical<br/>Position No.</u></b> | <b><u>Description</u></b>   |
|--|---|
| TP-01                                    | Bi-directional Testing of Check Valves with Non Safety Positions                |
| TP-02                                    | Passive Valves without Test Requirements  |
| TP-03                                    | Fail Safe Testing of Valves   |
| TP-04                                    | Manual Valve Exercise Frequency   |
| TP-05                                    | Check Valves in Regular Use   |
| TP-06                                    | Categorization of IST Pumps (Group A or B)                                      |
| TP-07                                    | Check Valve Condition Monitoring  |
| TP-08                                    | Thermal Relief Valves   |
| TP-09                                    | Classification of Skid Mounted Components                                       |
| TP-10                                    | Testing of Containment Purge Valves.  |
| TP-11                                    | Testing of Power Operated Valves with Both Active and Passive Safety Functions. |



**ATTACHMENT 11**

**STATION TECHNICAL POSITIONS**



**Technical Position TP-01**

(Page 1 of 3)  
(Rev. 0)

**Bi-directional Testing of Check Valves with Non-Safety Positions**

**Purpose**

The purpose of this Technical Position is to establish the station position for the verification of the non-safety direction exercise testing of check valves by normal plant operations.

**Applicability**

This Technical Position is applicable to those valves which are included in the Inservice Testing Program that are required to be exercised tested in their non-safety related direction of flow. This position applies to those check valves required to be tested in accordance with Subsection ISTC (ASME OM Code 2001 Edition through 2003 Addenda) and Appendix II. This Technical Position does not apply to testing of the safety function (direction) of check valves included in the Inservice Testing Program.

**Background**

The ASME OM Code 2001 through 2003 Addenda section ISTC-3550, "Valves in Regular Use", states:

"Valves that operate in the course of plant operation at a frequency that would satisfy the exercising requirements of this Subsection need not be additionally exercised, provided that the observations otherwise required for testing are made and analyzed during such operation and recorded in the plant record at intervals no greater than specified in ISTC-3510."

Section ISTC-3510 requires that check valves shall be exercised nominally every 3 months with exceptions (for extended periods) referenced.

Section ISTC-5221(a)(2) states:

"Check valves that have a safety function in only the open direction shall be exercised by initiating flow and observing that the obturator has traveled to either the full open position or to the position required to perform its intended function(s) (see ISTC-1100), and verify closure."



**Technical Position TP-01**  
(Page 2 of 3)

Section ISTC-5221(a)(3) states:

"Check valves that have a safety function in only the close direction shall be exercised by initiating flow and observing that the obturator has traveled [to] at least the partially open position,<sup>3</sup> and verify that on cessation or reversal of flow, the obturator has traveled to the seat."

"<sup>3</sup> The partially open position should correspond to the normal or expected system flow."

Normal and/or expected system flow may vary with plant configuration and alignment. St. Lucie Operations staff is trained in recognizing normal plant conditions. For check valves that have a non-safety related function in the open position, Operator judgment has been deemed acceptable in determining whether or not the normal or expected flow rates for plant operation has been obtained. For check valves that have a non-safety related function in the closed position, Operator judgment is also deemed acceptable in determining whether or not flow has subsidence has occurred resulting in obturator travel to the closed position.

**Position**

St. Lucie will verify the non-safety position of check valves included in the Inservice Testing Program. In lieu of a dedicated surveillance to perform the non-safety direction testing, the following alternate verifications may be performed as follows:

1. An appropriate means shall be determined which establishes the method for determining the open/closed non-safety function of the check valve during normal operations. The position determination may be by direct indicator, or by other positive means such as changes in system pressure, flow rate, level, temperature, seat leakage, etc. This determination shall be documented in the respective Condition Monitoring Plan for the specific check valve group. For check valves included in the Inservice Testing Program and not included in the Condition Monitoring Plan, this determination shall be documented in the IST Bases Document for the specific check valve group.



**Technical Position TP-01**

(Page 3 of 3)

2. Observation and analysis of plant processes that a check valve is satisfying its non-safety direction function may be used. For an example, consider a check valve that has a safety function only in the closed direction and normally provides a flow path to maintain plant operations. If this check valve does not open to pass flow when required, an alarm or indication would identify a problem to the operator. The operator would respond by taking the appropriate actions. A Condition Report would then be generated for the abnormal plant condition which would identify the check valve failure.
3. Observation and analysis of plant logs and other records may be an acceptable method for verifying a check valves non-safety direction function verification during normal plant operations.

The open/closed non-safety function shall be recorded at a frequency required by ISTC-3510, nominally every 3 months, (with exceptions as allowed), in plant records such as the St. Lucie Station Operating Logs, Electronic Rounds, chart recorders, automated data loggers, etc. The safety function direction testing requires a Quality Record in the form of a surveillance test. Records as indicated above in 1 through 3 are satisfactory for the non-safety direction testing. A Condition report shall be generated for any issues regarding check valve operability.

**Justification**

This Technical Position establishes the acceptability of the methods used in determining the ability of a valve to satisfy its non-safety function. Through normal plant system operation and Operator actions, a valves non-safety function is verified through either observation or analysis of plant records and logs. Additionally, the recording of parameters which demonstrate valve position will take place at a frequency to meet the frequency requirements of ISTC-3510. These actions collectively demonstrate the non-safety position of Inservice Testing Program check valves in regular use as required by ISTC-3550.



**Technical Position TP-02**

(Page 1 of 2)  
(Rev. 0)

**Passive Valves Without Test Requirements**

**Purpose**

The purpose of this Technical Position is to establish the station position for valves which perform a passive safety function for which there is no testing required in accordance with ISTC.

**Applicability**

This Technical Position is applicable to valves that perform a passive function in accordance with ISTA-2000 and do not have inservice testing requirements per Table ISTC-3500-1. This position is typical of Category B, passive valves that do not have position indication.

'An example is a manual valve which must remain in its normal position during an accident, to perform its intended function.'

Typically, manual valves that perform a safety function are locked in their safety position and administratively controlled by St. Lucie site procedures. These valves would be considered passive. If they do not have remote position indicating systems and are categorized as B, they would not be subjected to any test requirements in accordance with Table ISTC-3500-1.

**Position**

The St. Lucie Inservice Testing Program, Valve Tables - Attachment 17, will not list valves that meet the following criteria.

- The valve is categorized B (seat leakage in the closed position is inconsequential for fulfillment of the valves' required function(s)) in accordance with ISTC-1300.
- The valve is considered passive (valve maintains obturator position and is not required to change obturator position to accomplish the required function(s)) in accordance with ISTA-2000.
- The valve does not have a remote position indicating system which detects and indicates valve position.



**Technical Position TP-02**  
(Page 2 of 2)

**Justification**

Valves that meet this position will not be listed in the St. Lucie Inservice Testing Program, Valve Tables - Attachment 15, however, the basis for categorization and consideration of active/passive functions shall be documented in the IST Program Basis Document.



**Technical Position TP-03**

(Page 1 of 2)

(Rev. 0)

**Fail Safe Testing of Valves**

**Purpose**

The purpose of this Technical Position is to establish the station position for fail safe testing of valves in conjunction with stroke time exercising or position indication testing.

**Applicability**

This Technical Position is applicable to valves with fail-safe actuators required to be tested in accordance with ISTC-3560.

**Background**

The ASME OM Code 2001 through 2003 Addenda section ISTC-3560 requires;

"Valves with fail-safe actuators shall be tested by observing the operation of the actuator upon loss of valve actuating power in accordance with the exercising frequency of ISTC-3510."

Section ISTC-3510 states;

"Active Category A, Category B, and Category C check valves shall exercised nominally every 3 months..."

**Position**

In cases where the valve operator moves the valve to the open or closed position following de-energizing the operator electrically, by venting air, or both, the resultant valve exercise will satisfy the fail safe test requirements and an additional test specific for fail safe testing will not be performed.

St. Lucie will also use remote position indication as applicable to verify proper fail-safe operation, provided that the indication system for the valve is periodically verified in accordance with ISTC-3700.



**Technical Position TP-03**  
(Page 2 of 2)

**Justification**

Fail Safe Testing tests the ability of the fail safe mechanism of the valves to go to its fail safe position. Whether or not the actuation of this fail safe mechanism is due to Operator Action or failure of either the valves air or electric power source, the resultant action of the valve will be the same. Therefore, the verification of a valve's fail safe ability can be taken credit for with the performance of either a stroke time exercising or position indication test.



**Technical Position TP-04**

(Page 1 of 2)  
(Rev. 0)

**Manual Valve Exercise Frequency**

**Purpose**

The purpose of this Technical Position is to establish the station position for the frequency of exercising those manual valves which are required to be exercised.

**Applicability**

This Technical Position is applicable to the manual valves included in the Inservice Testing Program.

**Background**

The ASME OM Code 2001 through 2003 Addenda section ISTC-3540 states;

"Manual valves shall be full-stroke exercised at least once every 5 years, except where adverse conditions<sup>2</sup> may require the valve to be tested more frequently to ensure operational readiness."

<sup>2</sup>Harsh service environment, lubricant hardening, corrosive or sediment laden process fluid, or degraded valve components are some examples of adverse conditions.

In 10CFR 50.55a(b)(3)(vi), the NRC stated the following with regards to manual valve exercise frequency;

"Manual valves must be exercised on a 2-year interval rather than the 5-year interval specified in paragraph ISTC-3540 of the 1999 Addenda through the latest edition and addenda incorporated by reference in paragraph (b)(3) of this section, provided that adverse conditions do not require more frequent testing."

Which as written, includes the 2001/2003a of the ASME Code.

**Position**

St. Lucie will perform exercising of manual valves within the scope of the IST Program at a frequency not to exceed 2 years.



**Technical Position TP-04**  
(Page 2 of 2)

**Justification**

The NRC Rule Change has been adopted for the frequency of exercising manual valves at least once every 2 years. This interval is more frequent than required by the Edition of the Code used by St. Lucie, therefore no other justification is required.



**Technical Position TP-05**

(Page 1 of 2)

(Rev. 0)

**Check Valves in Regular Use**

**Purpose**

The purpose of this Technical Position is to establish the station position for check valves that are in regular use during normal plant operations.

**Applicability**

This Technical Position is applicable to check valves that are capable of being demonstrated to be open during routine operations.

**Background**

The ASME OM Code 2001 through 2003 Addenda section ISTC-3550, "Valves in Regular Use", states:

"Valves that operate in the course of plant operation at a frequency that would satisfy the exercising requirements of this Subsection need not be additionally exercised, provided that the observations otherwise required for testing are made and analyzed during such operation and recorded in the plant record at intervals no greater than specified in ISTC-3510."

Section ISTC-3510 requires that check valves shall be exercised nominally every 3 months with exceptions (for extended periods) referenced.

Normal and/or expected system flow may vary with plant configuration and alignment. The open "safety function" of a check valve typically requires a specified design accident flow rate. For these subject valves, the normal system flow is above the design accident flow rates. Since the St. Lucie Operations staff is trained so as to be able to recognize normal plant conditions, Operator judgment has been deemed acceptable for the purpose of determining check valve open demonstration by observing either normal or expected flow rates for the plant operating condition.

**Position**

St. Lucie will verify the open position of these subject check valves by observing plant logs, computer systems, strip chart recorders, etc., during normal plant operations. The open/closed safety function shall be recorded at a frequency required by ISTC-3510, nominally every 3 months, (with exceptions as provided), in plant records such as St. Lucie Operating Logs, Electronic Rounds, chart recorders, automated data loggers, etc.



**Technical Position TP-05**  
(Page 2 of 2)

**Justification**

Normal plant systems operation and operator actions provide for the observations and analysis that these subject valves are capable of satisfying their open safety function. Additionally, the recording of parameters which demonstrate valve position will take place at a frequency in accordance with ISTC-3510. These actions collectively demonstrate the open safety function of Inservice Testing Program check valves in regular use as required by ISTC-3550.



**Technical Position TP-06**

(Page 1 of 3)

(Rev. 0)

**Categorization of IST Pumps (Group A or B)**

**Position**

The St. Lucie Station has categorized the pumps which are required to be included in the Inservice Testing Program<sup>a</sup> as either Group A and/or B in accordance with the requirements of ISTB-2001/2003a and St. Lucie Relief Request PR-04.

Group A pumps are pumps that are operated continuously or routinely during normal operation, cold shutdown, or refueling operations. The following pumps are categorized as Group A at the St. Lucie Nuclear Station:

| <b>Pump EPN</b> | <b>Class</b> | <b>Group</b> | <b>Type</b>     | <b>Function</b>         |
|-----------------|--------------|--------------|-----------------|-------------------------|
| CCW PP 1A       | 3            | A            | Centrifugal     | Component Cooling Water |
| CCW PP 1B       | 3            | A            | Centrifugal     | Component Cooling Water |
| CCW PP 1C       | 3            | A            | Centrifugal     | Component Cooling Water |
| CCW PP 2A       | 3            | A            | Centrifugal     | Component Cooling Water |
| CCW PP 2B       | 3            | A            | Centrifugal     | Component Cooling Water |
| CCW PP 2C       | 3            | A            | Centrifugal     | Component Cooling Water |
| BAM PP 1A       | 2            | A            | Centrifugal     | Boric Acid Makeup       |
| BAM PP 1B       | 2            | A            | Centrifugal     | Boric Acid Makeup       |
| BAM PP 2A       | 2            | A            | Centrifugal     | Boric Acid Makeup       |
| BAM PP 2B       | 2            | A            | Centrifugal     | Boric Acid Makeup       |
| CHRG PP 1A      | 2            | A            | Positive Disp   | Charging                |
| CHRG PP 1B      | 2            | A            | Positive Disp   | Charging                |
| CHRG PP 1C      | 2            | A            | Positive Disp   | Charging                |
| CHRG PP 2A      | 2            | A            | Positive Disp   | Charging                |
| CHRG PP 2B      | 2            | A            | Positive Disp   | Charging                |
| CHRG PP 2C      | 2            | A            | Positive Disp   | Charging                |
| ICW PP 1A       | 3            | A            | Vert Line Shaft | Intake Cooling Water    |
| ICW PP 1B       | 3            | A            | Vert Line Shaft | Intake Cooling Water    |
| ICW PP 1C       | 3            | A            | Vert Line Shaft | Intake Cooling Water    |
| ICW PP 2A       | 3            | A            | Vert Line Shaft | Intake Cooling Water    |
| ICW PP 2B       | 3            | A            | Vert Line Shaft | Intake Cooling Water    |
| ICW PP 2C       | 3            | A            | Vert Line Shaft | Intake Cooling Water    |
|                 |              |              |                 |                         |

<sup>a</sup> – Pumps classified as "Skid Mounted" per ISTB-1200(c) are not required to be tested in accordance with ISTB, so are therefore not assigned a "Group".



**Technical Position TP-06**  
(Page 2 of 3)

Group B pumps are those pumps in standby systems that are not operated routinely except for testing. The following pumps are categorized as Group B at the St. Lucie Station:

| Pump EPN        | Class | Group | Type           | Function              |
|-----------------|-------|-------|----------------|-----------------------|
| CNTMT SPR PP 1A | 2     | B     | Centrifugal    | Containment Spray     |
| CNTMT SPR PP 1B | 2     | B     | Centrifugal    | Containment Spray     |
| CNTMT SPR PP 2A | 2     | B     | Centrifugal    | Containment Spray     |
| CNTMT SPR PP 2B | 2     | B     | Centrifugal    | Containment Spray     |
| HYDRZN PP 2A    | 2     | B     | Positive Disp. | Hydrazine             |
| HYDRZN PP 2B    | 2     | B     | Positive Disp. | Hydrazine             |
| AFW PP 1A       | 3     | B     | Centrifugal    | Aux Feed Water        |
| AFW PP 1B       | 3     | B     | Centrifugal    | Aux Feed Water        |
| AFW PP 1C       | 3     | B     | Centrifugal    | Aux Feed Water        |
| AFW PP 2A       | 3     | B     | Centrifugal    | Aux Feed Water        |
| AFW PP 2B       | 3     | B     | Centrifugal    | Aux Feed Water        |
| AFW PP 2C       | 3     | B     | Centrifugal    | Aux Feed Water        |
| HPSI PP 1A      | 2     | B     | Centrifugal    | High Press Safety Inj |
| HPSI PP 1B      | 2     | B     | Centrifugal    | High Press Safety Inj |
| HPSI PP 2A      | 2     | B     | Centrifugal    | High Press Safety Inj |
| HPSI PP 2B      | 2     | B     | Centrifugal    | High Press Safety Inj |
|                 |       |       |                |                       |

ASME OM ISTB-1400(b) states in part that a pump that meets both Group A and Group B pump definitions shall be categorized as a Group A pump. Relief Request PR-04 however provides for the treatment of the below pumps as both Group A and Group B, based upon the circumstances and evaluation provided with Relief Request PR-04.

| Pump EPN   | Class | Group | Type        | Function             |
|------------|-------|-------|-------------|----------------------|
| LPSI PP 1A | 2     | A/B   | Centrifugal | Low Press Safety Inj |
| LPSI PP 1B | 2     | A/B   | Centrifugal | Low Press Safety Inj |
| LPSI PP 2A | 2     | A/B   | Centrifugal | Low Press Safety Inj |
| LPSI PP 2B | 2     | A/B   | Centrifugal | Low Press Safety Inj |
|            |       |       |             |                      |



**Technical Position TP-06**  
(Page 3 of 3)

The following summarizes the Group A, B, and Comprehensive Pump Test requirements as specified by the ASME OM Code Subsection ISTB.

Group A Pump Tests – Group A tests are performed quarterly for each pump categorized as A. The following inservice test parameters are measured for each Group A pump test:

- Speed (if pump is variable speed)
- Differential Pressure
- Discharge Pressure, (for positive displacement pumps)
- Flow Rate
- Vibration

Group B Pump Tests – Group B tests are performed quarterly for each pump categorized as B. The following inservice test parameters are measured for each Group B pump test.

- Speed (if pump is variable speed)
- Differential Pressure<sup>(1)</sup>
- Flow Rate<sup>(1)</sup>

<sup>(1)</sup> For positive displacement pumps, only flow rate shall be measured or determined, for all other pumps, either differential pressure or flow rate shall be measured or determined.

Comprehensive Pump Tests – Comprehensive pump tests are performed biennially for all pumps in the Inservice Testing Program. The following inservice test parameters are measured for each Comprehensive pump test:

- Speed (if pump is variable speed)
- Differential Pressure
- Discharge Pressure, (for positive displacement pumps)
- Flow Rate (The ISTB Design Flow for the comprehensive pump test shall be defined as the System's Accident Condition Flow for a single pump)
- Vibration

The following instrument accuracy requirements apply to each test type:

| <b>Parameter</b>      | <b>Group A</b> | <b>Group B</b> | <b>Comprehensive</b> |
|-----------------------|----------------|----------------|----------------------|
| Pressure              | +/- 2.0%       | +/- 2.0%       | +/- 0.5%             |
| Flow Rate             | +/- 2.0%       | +/- 2.0%       | +/- 2.0%             |
| Speed                 | +/- 2.0%       | +/- 2.0%       | +/- 2.0%             |
| Vibration             | +/- 5.0%       | +/- 5.0%       | +/- 5.0%             |
| Differential Pressure | +/- 2.0%       | +/- 2.0%       | +/- 0.5%             |



**Technical Position - TP-07**

(Page 1 of 6)  
(Rev. 0)

**Check Valve Condition Monitoring**

**Purpose**

The purpose of this Technical Position is to document the St. Lucie Station's position on establishing and implementing a Check Valve Condition Monitoring Program in accordance with mandatory Appendix II of the ASME OM Code 2001 Edition through 2003 Addenda. The Condition Monitoring Program specified in Appendix II provides certain flexibility in establishing test types, examinations, and preventive maintenance activities along with their associated intervals, when justified based on check valve performance and operating condition.

**Applicability**

This Technical Position is applicable to certain valves or groups of valves as permitted by ISTC-5222, Condition Monitoring Program.

**Background**

10CFR50.55a was revised 11/22/99 to endorse the ASME OMa-1995 Edition with 1996 Addenda with modifications. These modifications have been incorporated into the 2003 Addenda of the 2001 Edition of the ASME OM Code. This edition of the ASME OM Code provides provisions to implement a check valve condition monitoring program for selected valves or groups of valves in accordance with mandatory Appendix II. St. Lucie's Inservice Testing Program for the 4th Ten Year Interval has been developed in accordance with the ASME OM Code 2001 Edition through 2003 Addenda. This edition of the Code provides an alternative in section ISTC-5222, Condition Monitoring Program, to the testing requirements of ISTC-3510, ISTC-3520, ISTC-3550 and ISTC-5221. This section specifies that the program shall be implemented in accordance with Appendix II, Check Valve Condition Monitoring Program.

**Position**

St. Lucie Station will implement a Check Valve Condition Monitoring program for selected valves or groups of valves in accordance with ISTC-5222 and Appendix II. The following guidelines will be adhered to for administering this program. Additionally, if the Appendix II program is discontinued for a valve or group of valves, then the requirements of ISTC-3510, ISTC-3520, ISTC-3550, and ISTC-5221 shall be implemented.



**Technical Position - TP-07**  
(Page 2 of 6)

1. Purpose

The purpose of the Check Valve Condition Monitoring Program is to improve check valve performance and to optimize testing, examination, and preventive maintenance activities in order to maintain the continued acceptable performance of a select valve or group of valves.

2. Scope

The St. Lucie Station Check Valve Condition Monitoring Program will be applied to individual check valves or groups of check valves which are either candidates for improved performance or candidates which will be monitored for improved valve performance.

- a. Candidates for improved valve performance are those check valves which may exhibit one or more of the following attributes:
  - i. The valve(s) exhibits an unusually high failure rate during inservice testing or operations;
  - ii. The valve(s) can not be exercised under normal operating conditions or during shutdown;
  - iii. The valve(s) exhibits unusual, abnormal, or unexpected behavior during exercising or operations.
- b. Candidates for monitoring for improved valve performance using optimization techniques, examination, and preventive maintenance activities are those check valves with documented acceptable performance that:
  - i. Have had their performance improved under this program;
  - ii. Cannot be exercised or are not readily exercised during normal operating condition or during shutdown;
  - iii. Can only be disassembled and examined; or
  - iv. It is decided that all of the associated activities of the valve or group will be optimized.



**Technical Position - TP-07**  
(Page 3 of 6)

3. Groupings

For valves which are grouped together the following valve attributes shall be considered:

- a. Valves shall be of the same manufacturer, design, size, service media, materials of construction, and orientation.
- b. Maintenance and modification history shall be reviewed.
- c. Test history and results shall be reviewed.
- d. System design shall be considered to determine potential flow instabilities, degree of disassembly, and the need for tolerance and dimensional measurements

4. Analysis

An analysis of the test and maintenance history shall be performed to establish the basis for specifying inservice testing, examination, and preventive maintenance activities. This analysis shall include the following:

- a. Identify any common failure mode or corrective maintenance patterns.
- b. Analyze these common patterns to determine their significance and to identify potential failure mechanisms:
  - i. Determine if certain preventive maintenance activities would mitigate the failure or maintenance patterns;
  - ii. Determine if certain condition monitoring activities are possible and effective in monitoring for these failure mechanisms;
  - iii. Determine if periodic disassembly and examination would be an effective method in monitoring for these failure mechanisms.
  - iv. Determine if the valve grouping is required to be changed.

5. Condition Monitoring Activities

Valve obturator movement during applicable test or examination activities shall be sufficient to determine the bidirectional functionality of the moving parts. A full open exercise test, or an open test to the position required to perform its intended function is not required for this assessment.



**Technical Position - TP-07**  
(Page 4 of 6)

a. Performance Improvement Activities

- i. If sufficient information is not available or the results of the analysis performed in 4 above are not conclusive, an interim period not to exceed 5 years or 2 refueling outages, whichever is less, shall be established to determine the cause of the failure or maintenance patterns. The following activities shall be performed at sufficient intervals over the interim period.
  1. Identify interim tests (e.g. nonintrusive) to assess the performance of the valve or group of valves.
  2. Identify interim examinations to evaluate potential degradation mechanisms.
  3. Identify other types of analysis to be performed which will assess check valve condition.
  4. Identify which of these activities will be performed on each valve.
  5. Identify the interval of each activity.
- ii. Identify attributes that will be trended. Trending and evaluation of existing data must be used as the bases to reduce or extend the time interval between tests or examinations.
- iii. Complete or revise the condition monitoring test plans to document the check valve program performance improvement activities and their associated frequencies.
- iv. Perform these activities at their assigned intervals until:
  1. Sufficient information is obtained to permit an adequate analysis.
  2. Until the end of the interim period (2 refueling outages or 5 years, whichever is less).
- v. After performance, a review shall be performed for each trended attribute along with results for each activity to determine if changes to the program are required. If changes are required, the program shall be revised before the next performance of the activity.



**Technical Position - TP-07**  
(Page 5 of 6)

b. Optimization of Condition Monitoring Activities

- i. If sufficient information is available to assess the performance adequacy of the check valve or group, then the following activities shall be performed:
  1. Identify appropriate preventive maintenance activities including the intervals that are required to maintain the continued acceptable performance of the check valve or group of check valves.
  2. Identify the applicable examination activities including the interval that will be used to periodically assess the condition of each check valve or group of check valves.
  3. Identify the applicable test activities including intervals that will be used to periodically verify the acceptable performance of each check valve or group of check valves.
  4. Identify which of these activities will be performed on each valve in the group.
  5. Identify the interval of each activity. Interval extensions shall be limited to one fuel cycle per extension. Intervals shall not exceed the maximum interval shown in Table II-4000-1. All valves in a group sampling plan must be tested or examined again, before the interval can be extended again, or until the maximum interval would be exceeded.
- ii. Identify attributes that will be trended. Trending and evaluation of existing data must be used to reduce or extend the time interval between tests or examinations.
- iii. Revise the condition monitoring plans to document the optimized *condition monitoring program activities and associated intervals* for each activity.
- iv. Continue performance of these activities at their associated intervals.



**Technical Position - TP-07**  
(Page 6 of 6)

- v. Review the results of the performance of each activity to determine if changes to the optimized condition monitoring program are required. Changes to IST intervals must consider plant safety and be supported by trending and evaluating both generic and plant-specific performance data to ensure the component is capable of performing its intended function(s) over the entire interval.

6. Corrective Maintenance

If corrective maintenance is performed on a check valve, the analysis used to formulate the basis of the condition-monitoring activities for that valve and its associated valve group shall be reviewed to determine if any changes are required.

7. Documentation

The condition monitoring program shall be documented in IST Manager or equivalent forms. The plan for each check valve or group of check valves shall be documented in the Condition Monitoring Tab and shall contain as a minimum the following information:

- a. The list of valves in each group including the group basis.
- b. Date the valve or group of valves was evaluated for inclusion or exclusion from the condition monitoring program.
- c. Safety function of valve or valve group.
- d. Analysis/justification which forms the basis for the program.
- e. Identification of the failure or maintenance patterns for each valve
- f. Condition monitoring activities including the trended attributes and the bases for the associated intervals for each valve or valve group.



**Technical Position - TP-08**

(Page 1 of 3)  
(Rev. 0)

**Thermal Relief Valves**

**Purpose**

The purpose of this Technical Position is to establish the station position on the method and frequency of testing of valves that can be classified as Thermal Relief Valves.

**Applicability**

This Technical Position is applicable to the following valves at St. Lucie.

| <b><u>Valve Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|----------------------------|----------------------|---------------------|------------------------|--------------------|
| 1-SR-07276                 | FP                   | 2                   | A/C                    | 1                  |
| 1-SR-07277                 | FP                   | 2                   | A/C                    | 1                  |
| 1-SR-07278                 | W-MAN                | N/C                 | C                      | 1                  |
| 1-SR-14-7A                 | CCW                  | 3                   | C                      | 1                  |
| 1-SR-14-7B                 | CCW                  | 3                   | C                      | 1                  |
| 1-SR-14-8A                 | CCW                  | 3                   | C                      | 1                  |
| 1-SR-14-8B                 | CCW                  | 3                   | C                      | 1                  |
| 1-SR-14-8C                 | CCW                  | 3                   | C                      | 1                  |
| 1-SR-14-8D                 | CCW                  | 3                   | C                      | 1                  |
| 1-V-2315                   | CVCS                 | 2                   | C                      | 1                  |
| 1-V-2318                   | CVCS                 | 2                   | C                      | 1                  |
| 1-V-2321                   | CVCS                 | 2                   | C                      | 1                  |
| 1-V-3407                   | SI                   | 3                   | C                      | 1                  |
| 1-V-3412                   | SI                   | 2                   | C                      | 1                  |
| 1-V-3430                   | SI                   | 2                   | C                      | 1                  |
| 1-V-3431                   | SI                   | 2                   | C                      | 1                  |
| 1-V-3439                   | SI                   | 2                   | C                      | 1                  |
| 2-SR-02123                 | CVCS                 | 2                   | C                      | 2                  |
| 2-SR-03-1                  | SI                   | 3                   | C                      | 2                  |
| 2-SR-03-2                  | SI                   | 3                   | C                      | 2                  |
| 2-SR-07474                 | W-MAN                | 2                   | A/C                    | 2                  |
| 2-SR-07475                 | FP                   | 2                   | A/C                    | 2                  |



**Technical Position - TP-08**

(Page 2 of 3)

| <b><u>Valve Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|----------------------------|----------------------|---------------------|------------------------|--------------------|
| 2-SR-07476                 | FP                   | 2                   | A/C                    | 2                  |
| 2-SR-07477                 | W-MAN                | 4                   | N/A                    | 2                  |
| 2-SR-14307                 | CCW                  | 2                   | C                      | 2                  |
| 2-SR-14318                 | CCW                  | 2                   | C                      | 2                  |
| 2-SR-14329                 | CCW                  | 2                   | C                      | 2                  |
| 2-SR-14342                 | CCW                  | 2                   | C                      | 2                  |
| 2-SR-14350                 | CCW                  | 3                   | C                      | 2                  |
| 2-SR-14359                 | CCW                  | 3                   | C                      | 2                  |
| 2-SR-14636                 | CCW                  | 2                   | A/C                    | 2                  |
| 2-SR-14637                 | CCW                  | 2                   | A/C                    | 2                  |
| 2-SR-15925                 | MUW                  | NC                  | C                      | 2                  |
| 2-SR-17221                 | EDG-F                | 3                   | C                      | 2                  |
| 2-SR-17222                 | EDG-F                | 3                   | C                      | 2                  |
| 2-V-2318                   | CVCS                 | 2                   | C                      | 2                  |
| 2-V-2321                   | CVCS                 | 2                   | C                      | 2                  |
| 2-V-2588                   | CVCS                 | 2                   | C                      | 2                  |
| 2-V-3407                   | SI                   | 3                   | C                      | 2                  |
| 2-V-3412                   | SI                   | 2                   | C                      | 2                  |
| 2-V-3430                   | SI                   | 2                   | C                      | 1                  |
| 2-V-3431                   | SI                   | 2                   | C                      | 1                  |
| 2-V-3439                   | SI                   | 2                   | C                      | 2                  |
| 2-V-3468                   | SI                   | 2                   | C                      | 2                  |
| 2-V-3483                   | SI                   | 2                   | C                      | 2                  |
| 2-V-3507                   | SI                   | 2                   | C                      | 2                  |
| 2-V-3513                   | SI                   | 2                   | C                      | 2                  |
| 2-V-3688                   | SI                   | 2                   | C                      | 2                  |

**Background**

When this technical position for thermal relief valves was first drafted, the position was based upon 10CFR50.55a(b) endorsement of Regulatory Guide 1.192, "Operation and Maintenance Code Case Acceptability, ASME OM Code", as issued on June 2003. This Reg. Guide contains a list of ASME Code Cases which either in full or in part, are allowed by the NRC to be used by licensees, without the submittal of a request for relief from the NRC. Table 1 of the Reg Guide 1.197 contains a list of Code Cases that can be adopted by the utility with out conditions or modifications, which includes Code Case OMN-2, Rev. 0, "Thermal Relief Valve Code Case", 1998 Edition.



**Technical Position - TP-08**  
(Page 3 of 3)

Code Case OMN-2 states in part:

"It is the opinion of the Committee that in lieu of the requirements specified in ASME OM Code 1995, paragraphs I 1.3.5(a), (b), and (c) testing for Class 2 and Class 3 pressure relief devices whose only overpressure protection function is to protect isolated components from fluid expansion caused by changes in fluid temperature shall be performed once every ten years on each device unless performance data indicates that more frequent testing is needed to assure device function. In lieu of test, the Owner may replace these devices every ten years unless performance data indicates more frequent replacement is needed to assure device function."

However, in the current edition of the ASME Code 2001/2003a, Mandatory Appendix I, "Inservice Testing of Pressure Relief Devices in Light-Water Reactor Nuclear power Plants", section I-1390 has been created which removes the need for OMN-2. This section states:

"Test shall be performed on all Class 2 and 3 relief devices used in thermal relief application every 10 years, unless performance data indicate more frequent testing is necessary. in lieu of tests the Owner may replace the relief devices at a frequency of every 10 years, unless performance data indicate more frequent replacement are necessary."

**Position**

St. Lucie Station will treat those valves designated as thermal relief valves per the requirements of I-1390 in that they will be replaced on a 10 year frequency unless performance data indicates more frequent replacement being necessary.

**History**

Thermal Relief Valves were addressed in Interval 3 in Generic Relief Request VR-23



**Technical Position TP-09**

(Page 1 of 10)

(Rev. 0)

**Classification of Skid Mounted Components**

**Purpose**

The purpose of this technical position is to clarify requirements for classification of various skid mounted components, and to clarify the testing requirements of these components.

**Background**

The ASME Code allows classification of some components as skid mounted when their satisfactory operation is demonstrated by the satisfactory performance of the associated major components. Testing of the major component is sufficient to satisfy Inservice Testing requirements for skid mounted components. In section 3.4 of NUREG 1482 Rev 1, the NRC supports the designation of components as skid mounted:

"The staff has determined that the testing of the major component is an acceptable means for verifying the operational readiness of the skid-mounted and component subassemblies if the licensee documents this approach in the IST Program. This is acceptable for both Code class components and non-Code class components tested and tracked by the IST Program."

In the 1996a addenda to the ASME OM Code (endorsed by 10CFR50.55(a) in October 2000), the term skid-mounted was clarified by the addition of ISTA paragraph 1.7: ISTA 1.7 Definitions

*Skid mounted components and component sub assemblies* – components integral to or that support operation of major components, even though these components may not be located directly on the skid. In general, these components are supplied by the manufacturer of the major component. Examples include: diesel skid-mounted fuel oil pumps and valves, steam admission and trip throttle valves for high-pressure coolant injection or Auxiliary Feedwater turbine-driven pumps, and solenoid-operated valve provided to control the air-operated valve.



**Technical Position TP-09**  
(Page 2 of 10)

This definition was further clarified in the 2001/2003a Editions of the ASME OM Code:

**ISTA-2000 DEFINITIONS**

*Skid mounted pumps and valves* – pumps and valves integral to or that support operation of major components, even though these components may not be located directly on the skid. In general, these pumps and valves are supplied by the manufacturer of the major component. Examples include:

- (a) diesel fuel oil pumps and valves;
- (b) steam admission and trip throttle valves for high-pressure coolant injection pumps;
- (c) steam admission and trip throttle valves for Auxiliary Feedwater turbine driven pumps;
- (d) solenoid-operated valves provided to control an air-operated valve.

Additionally the Subsections pertaining to pumps (ISTB) and valves (ISTC) includes exclusions/exemptions for skid mounted components;

**ISTB-1200(c) Exclusions**

Skid-mounted pumps that are tested as part of the major component and are justified by the Owner to be adequately tested.

**ISTC-1200 Exemptions**

Skid-mounted valves are excluded from this Subsection provided they are tested as part of the major component and are justified by the Owner to be adequately tested.

**Position**

The 2001/2003a ASME OM Code definition of skid mounted will be used for classification of components in the St. Lucie Inservice Testing Program. In addition, for a component to be considered skid mounted:

- The major component associated with the skid mounted component must be surveillance tested at a frequency sufficient to meet ASME Code test frequency for the skid mounted component, unless otherwise justified by St. Lucie.



**Technical Position TP-09**  
(Page 3 of 10)

- Satisfactory operation\*, of the skid mounted component must be demonstrated by satisfactory operation of the major component.
- The IST Bases Document should describe the bases for classifying a component as skid mounted, and the IST Program Plan should reference this technical position for the component.

\* - as defined by the utility

**Justification**

Recognition and classification of components as skid mounted eliminates the need for the redundant testing of the sub component(s) as the testing of major (parent) component satisfactory demonstrates operation of the "skid mounted" component(s).

**Resultant Discussion**

**Skid Mounted Pumps**

In recognition of this Technical Position on skid mounted components, pumps classified as Skid Mounted need not be classified as either Group A or Group B as the acceptable performance of the skid mounted pump is based upon the acceptable performance of the major component to which it gives support, not the manner in which it operators. The frequency at which this skid mounted pump's ability to function in support of its major component will be verified is quarterly, as a minimum. This frequency is chosen so as to not be greater than the minimum test frequency associated with an IST pump that is not classified as skid mounted.

If the frequency associated with the testing of the skid mounted pump is ever determined to be greater than quarterly, that evaluation/justification will be provided in that specific pump basis.



**Technical Position TP-09**  
(Page 4 of 10)

The following IST pumps have been classified as skid mounted;

| Pump EPN        | Class | Type          | Function                         |
|-----------------|-------|---------------|----------------------------------|
| EDG EPP 1A1     | 3     | Positive Disp | Diesel Fuel Elec Priming         |
| EDG EPP 1A2     | 3     | Positive Disp | Diesel Fuel Elec Priming         |
| EDG EPP 1B1     | 3     | Positive Disp | Diesel Fuel Elec Priming         |
| EDG EPP 1B2     | 3     | Positive Disp | Diesel Fuel Elec Priming         |
| EDG EPP 2A1     | 3     | Positive Disp | Diesel Fuel Elec Priming         |
| EDG EPP 2A2     | 3     | Positive Disp | Diesel Fuel Elec Priming         |
| EDG EPP 2B1     | 3     | Positive Disp | Diesel Fuel Elec Priming         |
| EDG EPP 2B2     | 3     | Positive Disp | Diesel Fuel Elec Priming         |
| EDG SBLO AC 1A1 | 3     | Positive Disp | Diesel Soak Back Lube Oil AC     |
| EDG SBLO AC 1A2 | 3     | Positive Disp | Diesel Soak Back Lube Oil AC     |
| EDG SBLO AC 1B1 | 3     | Positive Disp | Diesel Soak Back Lube Oil AC     |
| EDG SBLO AC 1B2 | 3     | Positive Disp | Diesel Soak Back Lube Oil AC     |
| EDG SBLO AC 2A1 | 3     | Positive Disp | Diesel Soak Back Lube Oil AC     |
| EDG SBLO AC 2A2 | 3     | Positive Disp | Diesel Soak Back Lube Oil AC     |
| EDG SBLO AC 2B1 | 3     | Positive Disp | Diesel Soak Back Lube Oil AC     |
| EDG SBLO AC 2B2 | 3     | Positive Disp | Diesel Soak Back Lube Oil AC     |
| EDG SBLO DC 1A1 | 3     | Positive Disp | Diesel Soak Back Lube Oil DC     |
| EDG SBLO DC 1A2 | 3     | Positive Disp | Diesel Soak Back Lube Oil DC     |
| EDG SBLO DC 1B1 | 3     | Positive Disp | Diesel Soak Back Lube Oil DC     |
| EDG SBLO DC 1B2 | 3     | Positive Disp | Diesel Soak Back Lube Oil DC     |
| EDG SBLO DC 2A1 | 3     | Positive Disp | Diesel Soak Back Lube Oil DC     |
| EDG SBLO DC 2A2 | 3     | Positive Disp | Diesel Soak Back Lube Oil DC     |
| EDG SBLO DC 2B1 | 3     | Positive Disp | Diesel Soak Back Lube Oil DC     |
| EDG SBLO DC 2B2 | 3     | Positive Disp | Diesel Soak Back Lube Oil DC     |
| EDG TCLO AC 2A1 | 3     | Positive Disp | Diesel Turbo Charger Lube Oil AC |
| EDG TCLO AC 2A2 | 3     | Positive Disp | Diesel Turbo Charger Lube Oil AC |
| EDG TCLO AC 2B1 | 3     | Positive Disp | Diesel Turbo Charger Lube Oil AC |
| EDG TCLO AC 2B2 | 3     | Positive Disp | Diesel Turbo Charger Lube Oil AC |
| EDG TCLO DC 2A1 | 3     | Positive Disp | Diesel Turbo Charger Lube Oil DC |
| EDG TCLO DC 2A2 | 3     | Positive Disp | Diesel Turbo Charger Lube Oil DC |
| EDG TCLO DC 2B1 | 3     | Positive Disp | Diesel Turbo Charger Lube Oil DC |
| EDG TCLO DC 2B2 | 3     | Positive Disp | Diesel Turbo Charger Lube Oil DC |
|                 |       |               |                                  |



**Technical Position TP-09**  
(Page 5 of 10)

**Skid Mounted Valves**

In recognition of this Technical Position on skid mounted components, only those parameters necessary for a specific valve to function in support of it's safety related major component need be considered when evaluating the ability of the major components test ability to verify the required function of the skid mounted valve. (e.g. If a skid mounted check valve has a non-safety related open function, the major component testing need not consider verification of the open non-safety function, as would have been required if the check valve were not classified as skid mounted.)

The frequency at which this skid mounted valves ability to function in support of its major component will be verified quarterly, as a minimum. This frequency is chosen so as to not be greater than the minimum test frequency associated with a non-skid mounted IST valve. If the frequency associated with the testing of a skid mounted valve is determined to be greater than quarterly, that evaluation/justification will be provided in that specific valves basis.

The following IST valves have been classified as skid mounted;

| Valve EPN    | Class | Type  | Function                                      |
|--------------|-------|-------|---|
| 1-FCV-59-1A1 | 3     | Gate  | 1A EDG Starting Air Control Valve             |
| 1-FCV-59-1B1 | 3     | Gate  | 1B EDG Starting Air Control Valve             |
| 1-FCV-59-2A1 | 3     | Gate  | 1A EDG Starting Air Control Valve             |
| 1-FCV-59-2B1 | 3     | Gate  | 1B EDG Starting Air Control Valve             |
| 1-FCV-59-3A1 | 3     | Gate  | 1A EDG Starting Air Control Valve             |
| 1-FCV-59-3B1 | 3     | Gate  | 1B EDG Starting Air Control Valve             |
| 1-FCV-59-4A1 | 3     | Gate  | 1A EDG Starting Air Control Valve             |
| 1-FCV-59-4B1 | 3     | Gate  | 1B EDG Starting Air Control Valve             |
| 1-MV-08-3    | 2     | Gate  | 1C AFW Turbine Trip Throttle Valve            |
| 1-SE-08-1A1  | NC    | 3-way | MSIV HCV-08-1A Open Control Valve             |
| 1-SE-08-1A2  | NC    | 3-way | MSIV HCV-08-1A Open Control Valve             |
| 1-SE-08-1A3  | NC    | 3-way | MSIV HCV-08-1A Close Control Valve            |
| 1-SE-08-1A4  | NC    | 3-way | MSIV HCV-08-1A Close Control Valve            |
| 1-SE-08-1B1  | NC    | 3-way | MSIV HCV-08-1B Open Control Valve             |
| 1-SE-08-1B2  | NC    | 3-way | MSIV HCV-08-1B Open Control Valve             |
| 1-SE-08-1B3  | NC    | 3-way | MSIV HCV-08-1B Close Control Valve            |
| 1-SE-08-1B4  | NC    | 3-way | MSIV HCV-08-1B Close Control Valve            |
| 1-SE-09-843  | 3     | 3-way | HCV-09-7 Actuator Train "A" Control Solenoids |
| 1-SE-09-847  | 3     | 3-way | HCV-09-7 Actuator Train "B" Control Solenoids |
| 1-SE-09-870  | 3     | 3-way | HCV-09-8 Actuator Train "B" Control Solenoids |
| 1-SE-09-874  | 3     | 3-way | HCV-09-8 Actuator Train "A" Control Solenoids |
| 1-SE-37-1    | 3     | 3-way | UHS Valve SB-37-1 Air Control Valve           |
| 1-SE-37-2    | 3     | 3-way | UHS Valve SB-37-2 Air Control Valve           |



**Technical Position TP-09**

(Page 6 of 10)

| Valve EPN    | Class | Type  | Function  |
|--------------|-------|-------|---|
| 1-SE-59-1A   | 3     | Globe | A Fuel Oil Day Tank Inlet Isolation Valve                 |
| 1-SE-59-1B   | 3     | Globe | B Fuel Oil Day Tank Inlet Isolation Valve                 |
| 1-SE-59-3A   | 3     | Globe | 1A EDG Starting Air Control Valve Pilot Valve             |
| 1-SE-59-3B   | 3     | Globe | 1B EDG Starting Air Control Valve Pilot Valve             |
| 1-SE-59-4A   | 3     | Globe | 1A EDG Starting Air Control Valve Pilot Valve             |
| 1-SE-59-4B   | 3     | Globe | 1B EDG Starting Air Control Valve Pilot Valve             |
| 1-SE-59-5A   | 3     | Globe | 1A EDG Starting Air Control Valve Pilot Valve             |
| 1-SE-59-5B   | 3     | Globe | 1B EDG Starting Air Control Valve Pilot Valve             |
| 1-SE-59-6A   | 3     | Globe | 1A EDG Starting Air Control Valve Pilot Valve             |
| 1-SE-59-6B   | 3     | Globe | 1B EDG Starting Air Control Valve Pilot Valve             |
| 1-TCV-59-1A1 | 3     | 3-way | EDG 1A1 Engine Water TCV                                  |
| 1-TCV-59-1A2 | 3     | 3-way | EDG 1A2 Engine Water TCV                                  |
| 1-TCV-59-1B1 | 3     | 3-way | EDG 1B1 Engine Water TCV                                  |
| 1-TCV-59-1B2 | 3     | 3-way | EDG 1B2 Engine Water TCV                                  |
| 1-V-09831    | 3     | 3-way | HCV-09-7 Actuator "A" Train Open Pilot Vlv                |
| 1-V-09832    | 3     | 3-way | HCV-09-7 Actuator "B" Train Open Pilot Vlv                |
| 1-V-09833    | 3     | 3-way | HCV-09-7 Actuator "A" Train Close Pilot Vlv               |
| 1-V-09834    | 3     | 3-way | HCV-09-7 Actuator "B" Train Close Pilot Vlv               |
| 1-V-09861    | 3     | 3-way | HCV-09-8 Actuator "A" Train Open Pilot Vlv                |
| 1-V-09862    | 3     | 3-way | HCV-09-8 Actuator "B" Train Open Pilot Vlv                |
| 1-V-09863    | 3     | 3-way | HCV-09-8 Actuator "A" Train Close Pilot Vlv               |
| 1-V-09864    | 3     | 3-way | HCV-09-8 Actuator "B" Train Close Pilot Vlv               |
| 1-V-59010    | 3     | Check | Soakback Lube Oil A/C Pump Discharge Check for Diesel 1A1 |
| 1-V-59011    | 3     | Check | Soakback Lube Oil D/C Pump Discharge Check for Diesel 1A1 |
| 1-V-59025    | 3     | Check | Soakback Lube Oil A/C Pump Discharge Check for Diesel 1A2 |
| 1-V-59026    | 3     | Check | Soakback Lube Oil D/C Pump Discharge Check for Diesel 1A2 |
| 1-V-59040    | 3     | Check | Soakback Lube Oil A/C Pump Discharge Check for Diesel 1B1 |
| 1-V-59041    | 3     | Check | Soakback Lube Oil D/C Pump Discharge Check for Diesel 1B1 |
| 1-V-59055    | 3     | Check | Soakback Lube Oil D/C Pump Discharge Check for Diesel 1B2 |
| 1-V-59056    | 3     | Check | Soakback Lube Oil A/C Pump Discharge Check for Diesel 1B2 |



**Technical Position TP-09**

(Page 7 of 10)

| Valve EPN    | Class | Type  | Function  |
|--------------|-------|-------|---|
| 1-V-59200    | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 1-V-59201    | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 1-V-59202    | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 1-V-59203    | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 2-FCV-59-1A1 | 3     | Gate  | 2A EDG Starting Air Control Valve                         |
| 2-FCV-59-1B1 | 3     | Gate  | 2B EDG Starting Air Control Valve                         |
| 2-FCV-59-2A1 | 3     | Gate  | 2A EDG Starting Air Control Valve                         |
| 2-FCV-59-2B1 | 3     | Gate  | 2B EDG Starting Air Control Valve                         |
| 2-FCV-59-3A1 | 3     | Gate  | 2A EDG Starting Air Control Valve                         |
| 2-FCV-59-3B1 | 3     | Gate  | 2B EDG Starting Air Control Valve                         |
| 2-FCV-59-4A1 | 3     | Gate  | 2A EDG Starting Air Control Valve                         |
| 2-FCV-59-4B1 | 3     | Gate  | 2B EDG Starting Air Control Valve                         |
| 2-SE-08-896  | NC    | 3-way | MSIV Instrument Air Supply Valve                          |
| 2-SE-08-897  | NC    | 3-way | MSIV Instrument Air Supply Valve                          |
| 2-SE-08-934  | NC    | 3-way | MSIV Instrument Air Supply Valve                          |
| 2-SE-08-935  | NC    | 3-way | MSIV Instrument Air Supply Valve                          |
| 2-SE-59-1A1  | 3     | Globe | Fuel Oil Day Tank Inlet Isolation Valve                   |
| 2-SE-59-1A2  | 3     | Globe | Fuel Oil Day Tank Inlet Isolation Valve                   |
| 2-SE-59-1B1  | 3     | Globe | Fuel Oil Day Tank Inlet Isolation Valve                   |
| 2-SE-59-1B2  | 3     | Globe | Fuel Oil Day Tank Inlet Isolation Valve                   |
| 2-SE-59-3A   | 3     | Globe | 2A EDG Starting Air Control Valve Pilot Valve             |
| 2-SE-59-3B   | 3     | Globe | 2B EDG Starting Air Control Valve Pilot Valve             |
| 2-SE-59-4A   | 3     | Globe | 2A EDG Starting Air Control Valve Pilot Valve             |
| 2-SE-59-4B   | 3     | Globe | 2B EDG Starting Air Control Valve Pilot Valve             |
| 2-SE-59-5A   | 3     | Globe | 2A EDG Starting Air Control Valve Pilot Valve             |
| 2-SE-59-5B   | 3     | Globe | 2B EDG Starting Air Control Valve Pilot Valve             |
| 2-SE-59-6A   | 3     | Globe | 2A EDG Starting Air Control Valve Pilot Valve             |
| 2-SE-59-6B   | 3     | Globe | 2B EDG Starting Air Control Valve Pilot Valve             |
| 2-TCV-59-1A1 | 3     | 3-way | EDG Engine Water TCV                                      |
| 2-TCV-59-1A2 | 3     | 3-way | EDG Engine Water TCV                                      |
| 2-TCV-59-1B1 | 3     | 3-way | EDG Engine Water TCV                                      |
| 2-TCV-59-1B2 | 3     | 3-way | EDG Engine Water TCV                                      |
| 2-V-08887    | 2     | 3-way | MSIV 1A Control Valve 2                                   |
| 2-V-08888    | 2     | 3-way | MSIV 1A Control Valve 3                                   |
| 2-V-08889    | 2     | 3-way | MSIV 1A Control Valve 4                                   |
| 2-V-08890    | 2     | 3-way | MSIV 1A Control Valve 5                                   |



**Technical Position TP-09**  
(Page 8 of 10)

| Valve EPN | Class | Type  | Function  |
|-----------|-------|-------|---|
| 2-V-08925 | 2     | 3-way | MSIV 1B Control Valve 2                                   |
| 2-V-08926 | 2     | 3-way | MSIV 1B Control Valve 3                                   |
| 2-V-08927 | 2     | 3-way | MSIV 1B Control Valve 4                                   |
| 2-V-08928 | 2     | 3-way | MSIV 1B Control Valve 5                                   |
| 2-V-08965 | 2     | Check | MSIV 1A Actuator Vacuum Breaker Check Valve               |
| 2-V-08966 | 2     | Check | MSIV 1B Actuator Vacuum Breaker Check Valve               |
| 2-V-59002 | 3     | Check | Check Valve for Diesel Oil from Day Tank                  |
| 2-V-59005 | 3     | Check | Check Valve for Electric Motor Driven Diesel Oil Priming  |
| 2-V-59010 | 3     | Check | Soakback Lube Oil A/C Pump Discharge Check for Diesel 2A1 |
| 2-V-59011 | 3     | Check | Soakback Lube Oil D/C Pump Discharge Check for Diesel 2A1 |
| 2-V-59017 | 3     | Check | Turbo Lube Oil D/C Pump Discharge Check for Diesel 2A1    |
| 2-V-59021 | 3     | Check | Turbo Lube Oil A/C Pump Discharge Check for Diesel 2A1    |
| 2-V-59025 | 3     | Check | Soakback Lube Oil A/C Pump Discharge Check for Diesel 2A2 |
| 2-V-59026 | 3     | Check | Soakback Lube Oil D/C Pump Discharge Check for Diesel 2A2 |
| 2-V-59040 | 3     | Check | Soakback Lube Oil A/C Pump Discharge Check for Diesel 2B1 |
| 2-V-59041 | 3     | Check | Soakback Lube Oil D/C Pump Discharge Check for Diesel 2B1 |
| 2-V-59048 | 3     | Check | Turbo Lube Oil D/C Pump Discharge Check for Diesel 2A2    |
| 2-V-59051 | 3     | Check | Turbo Lube Oil A/C Pump Discharge Check for Diesel 2A2    |
| 2-V-59055 | 3     | Check | Soakback Lube Oil D/C Pump Discharge Check for Diesel 2B2 |
| 2-V-59056 | 3     | Check | Soakback Lube Oil A/C Pump Discharge Check for Diesel 2B2 |
| 2-V-59062 | 3     | Check | Check Valve for Diesel Oil from Day Tank                  |
| 2-V-59066 | 3     | Check | Check Valve for Standby Lube Oil to D/G Engine            |
| 2-V-59078 | 3     | Check | Check Valve for Diesel Oil from Day Tank                  |
| 2-V-59081 | 3     | Check | Check Valve for Electric Motor Driven Diesel Oil Priming  |



**Technical Position TP-09**

(Page 9 of 10)

| Valve EPN | Class | Type  | Function  |
|-----------|-------|-------|---|
| 2-V-59089 | 3     | Check | Turbo Lube Oil A/C Pump Discharge Check for Diesel 2B1    |
| 2-V-59116 | 3     | Check | Check Valve for Diesel Oil from Day Tank                  |
| 2-V-59119 | 3     | Check | Check Valve for Electric Motor Driven Diesel Oil Priming  |
| 2-V-59121 | 3     | Check | Check Valve for Electric Motor-Driven Diesel Oil Priming  |
| 2-V-59127 | 3     | Check | Turbo Lube Oil A/C Pump Discharge Check for Diesel 2B2    |
| 2-V-59165 | 3     | Check | Turbo Lube Oil D/C Pump Discharge Check for Diesel 2B1    |
| 2-V-59183 | 3     | Check | EDG 2A1 North Air Start Sequencing Check Valve            |
| 2-V-59187 | 3     | Check | EDG 2A1 South Air Start Sequencing Check Valve            |
| 2-V-59191 | 3     | Check | EDG 2A2 North Air Start Sequencing Check Valve            |
| 2-V-59192 | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 2-V-59193 | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 2-V-59194 | 3     | Check | Check Valve for Standby Lube Oil to D/G Engine            |
| 2-V-59197 | 3     | Check | EDG 2A2 South Air Start Sequencing Check Valve            |
| 2-V-59198 | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 2-V-59199 | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 2-V-59213 | 3     | Check | Check Valve for Standby Lube Oil to D/G Engine            |
| 2-V-59219 | 3     | Check | Turbo Lube Oil D/C Pump Discharge Check for Diesel 2B2    |
| 2-V-59231 | 3     | Check | EDG 2B1 South Air Start Sequencing Check Valve            |
| 2-V-59232 | 3     | Check | Check Valve for Standby Lube Oil to D/G Engine            |
| 2-V-59235 | 3     | Check | EDG 2B1 North Air Start Sequencing Check Valve            |
| 2-V-59239 | 3     | Check | EDG 2B2 North Air Start Sequencing Check Valve            |
| 2-V-59240 | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |



**Technical Position TP-09**  
(Page 10 of 10)

| Valve EPN | Class | Type  | Function  |
|-----------|-------|-------|---|
| 2-V-59241 | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 2-V-59245 | 3     | Check | EDG 2B2 South Air Start Sequencing Check Valve            |
| 2-V-59246 | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 2-V-59247 | 3     | Check | Check Valve Assembly for D/G Engine Governor Air Boosters |
| 2-V-59333 | 3     | Check | Fuel Oil Priming Pump Relief Check Valve                  |
| 2-V-59334 | 3     | Check | Fuel Oil Priming Pump Relief Check Valve                  |
| 2-V-59335 | 3     | Check | Fuel Oil Priming Pump Relief Check Valve                  |
| 2-V-59336 | 3     | Check | Fuel Oil Priming Pump Relief Check Valve                  |
|           |       |       |   |

**History**

None



**Technical Position TP-10**

(Page 1 of 2)

(Rev. 0)

**Testing of Containment Purge Valves**

**Purpose**

The purpose of this Technical Position is to establish the testing requirements for Primary Containment Purge and Vent Valves which during normal operation have their fuses pulled.

**Applicability**

This Technical Position is applicable to those valves listed below.

| <b><u>Valve<br/>Number</u></b> | <b><u>System</u></b> | <b><u>Class</u></b> | <b><u>Category</u></b> | <b><u>Unit</u></b> |
|--------------------------------|----------------------|---------------------|------------------------|--------------------|
| 1FCV-25-1                      | HVAC                 | 2                   | B                      | 1                  |
| 1FCV-25-2                      | HVAC                 | 2                   | A                      | 1                  |
| 1FCV-25-3                      | HVAC                 | 2                   | A                      | 1                  |
| 1FCV-25-4                      | HVAC                 | 2                   | A                      | 1                  |
| 1FCV-25-5                      | HVAC                 | 2                   | A                      | 1                  |
| 1FCV-25-6                      | HVAC                 | 2                   | B                      | 1                  |

**Background**

These valves are the Containment Purge Isolation Valves, both supply and exhaust. These valves are 48" butterfly valves and are either closed, or locked closed during normal power operation. (Modes 1-4)

ISTC-3510 states that active category A, B and C valves shall be exercised nominally every 3 months, except as provided by ISTC-3520, ISTC-3540, ISTC-3550, ISTC-3560, ISTC-5221, and ISTC-5222.

Of relevance in this case is ISTC-3570, which states that for a valve in a system declared inoperable or not required to be operable, the exercising test schedule need not be followed. Within 3 months before placing the system in an operable status, the valves shall be exercised and the schedule followed in accordance with (the) requirements of this Subsection.



**Technical Position TP-10**

(Page 2 of 2)  
(Rev. 0)

In the case of these valves in the Containment Purge System, per each unit's locked valve procedures, [i.e. 1-0010123], these valves are closed, with their breakers/fuses removed. This places these valves in an inoperable position.

**Position**

St. Lucie Station will continue to list the stroke time and fail safe testing associated with these valve as being performed on a quarterly frequency, but with the recognition that these valves during normal operation have their power removed, will recognize them as Out of Service (OOS) per ISTC-3570. As a result, the stroke time and fail safe testing will only be scheduled to be performed on these valve immediately following the restoration of power to these valves, provided that they have not been tested within the previous 3 months.

**References**

Procedure 1-0010123, "Administrative Control of Valves, Locks and Switches, Rev. 157, Appendix O.



**Technical Position TP-11**

(Page 1 of 2)

(Rev. 0)

**Testing of Power Operated Valves with Both  
Active and Passive Safety Functions**

**Purpose**

The purpose of this Technical Position is to establish the testing requirements for power operated valves which have both an active and passive safety function.

**Applicability**

This Technical Position is applicable to power operated valves which have an active safety function in one direction while performing a passive safety function in the other direction.

**Background**

The IST Program requires valves to be exercised to the position(s) required to fulfill their safety function(s). In addition, valves with remote position indication shall have their position indication verified. The Code does not restrict position indication to active valves.

**Position**

Several valves included in the plant are designed to perform passive safety functions during accident conditions, and then based on plant accident response, are designed to change positions to perform another (active) function. Once in their final position, there exist no conditions (for certain valves) in which they would be required to be placed in their original passive position.

These valves are typically emergency core cooling system valves, which require changing position during different phases of the accident. After the original passive safety function (e.g. provide flow path) is performed, the valves are repositioned to perform the active safety function (e.g. provide containment isolation or to allow injection from another water source). The valves are not required to return to their original position.

Power operated valves with passive functions in one direction and active in the other, will be exercised and stroke timed to only their active position. If these valves have position indication, the position indication verification will include verification of both positions.



**Technical Position TP-11**  
(Page 2 of 2)

**Justification**

Code Interpretation 01-02 (response to inquiry OMI 99-07) addressed this issue.

Question: If a valve has safety functions in both the open and closed positions and is maintained in one of these positions, but is only required to move from the initial position to the other and is not required to return to the initial position, is stroke timing in both directions required?

Reply: No

**History**

None



**ATTACHMENT 12**

**INSERVICE TESTING PUMP TABLE INDEX**

| <b><u>System Designator</u></b> | <b><u>System Description</u></b>   |
|---------------------------------|------------------------------------|
| CCW                             | Component Cooling Water            |
| CS                              | Containment Spray                  |
| CVCS                            | Chemical and Volume Control System |
| EDG-F                           | Emergency Diesel Generator – Fuel  |
| EDG-L                           | Emergency Diesel Generator – Lube  |
| FW                              | Feed Water                         |
| ICW                             | Intake Cooling Water               |
| SI                              | Safety Injection                   |



## Attachment 13

[illegible]



## Attachment 13

| Pump Tag        | P&ID         | P&ID<br>Coor. | Category | Safety<br>Class | Pump Type   | Pump<br>Driver | Test Type  | Test<br>Freq.           | Relief<br>Request | Tech.<br>Pos. |
|-----------------|--------------|---------------|----------|-----------------|-------------|----------------|------------|-------------------------|-------------------|---------------|
| CNTMT SPR PP 1A | 8770 G 088-1 | G-6           | B        | 2               | Centrifugal | Motor          | dP(b)      | M3                      |                   |               |
|                 |              |               |          |                 |             |                | dP(c)      | Y2                      |                   |               |
|                 |              |               |          |                 |             |                | Q(c)       | Y2                      |                   |               |
|                 |              |               |          |                 |             |                | V(c)       | Y2                      |                   |               |
|                 |              |               |          |                 |             |                | Pump Name: | Containment Spray Pumps |                   |               |
| CNTMT SPR PP 1B | 8770 G 088-1 | H-6           | B        | 2               | Centrifugal | Motor          | dP(b)      | M3                      |                   |               |
|                 |              |               |          |                 |             |                | dP(c)      | Y2                      |                   |               |
|                 |              |               |          |                 |             |                | Q(c)       | Y2                      |                   |               |
|                 |              |               |          |                 |             |                | V(c)       | Y2                      |                   |               |
|                 |              |               |          |                 |             |                | Pump Name: | Containment Spray Pumps |                   |               |



## Attachment 13

| Pump Tag   | P&ID            | P&ID<br>Coor.           | Category | Safety<br>Class | Pump Type             | Pump<br>Driver | Test Type  | Test<br>Freq.                    | Relief<br>Request | Tech.<br>Pos. |
|------------|-----------------|-------------------------|----------|-----------------|-----------------------|----------------|--|----------------------------------|-------------------|---------------|
| BAM PP 1A  | 8770 G 078-121B | G-4                     | A        | 2               | Centrifugal           | Motor          | dP(a)<br>dP(c)<br>Q(a)<br>Q(c)<br>V(a)<br>V(c)       | M3<br>Y2<br>M3<br>Y2<br>M3<br>Y2 | PR-06             |               |
| Pump Name: |                 | Boric Acid Makeup Pumps |          |                 |                       |                |  |                                  |                   |               |
| BAM PP 1B  | 8770 G 078-121B | F-4                     | A        | 2               | Centrifugal           | Motor          | dP(a)<br>dP(c)<br>Q(a)<br>Q(c)<br>V(a)<br>V(c)       | M3<br>Y2<br>M3<br>Y2<br>M3<br>Y2 | PR-06             |               |
| Pump Name: |                 | Boric Acid Makeup Pumps |          |                 |                       |                |  |                                  |                   |               |
| CHRG PP 1A | 8770 G 078-120B | C-2                     | A        | 2               | Positive Displacement | Motor          | DIS-P(a)<br>DIS-P(c)<br>Q(a)<br>Q(c)<br>V(a)<br>V(c) | M3<br>Y2<br>M3<br>Y2<br>M3<br>Y2 | PR-01<br>PR-01    |               |
| Pump Name: |                 | Charging Pumps          |          |                 |                       |                |  |                                  |                   |               |
| CHRG PP 1B | 8770 G 078-120B | E-2                     | A        | 2               | Positive Displacement | Motor          | DIS-P(a)<br>DIS-P(c)<br>Q(a)<br>Q(c)<br>V(a)<br>V(c) | M3<br>Y2<br>M3<br>Y2<br>M3<br>Y2 | PR-01<br>PR-01    |               |
| Pump Name: |                 | Charging Pumps          |          |                 |                       |                |  |                                  |                   |               |
| CHRG PP 1C | 8770 G 078-120B | G-2                     | A        | 2               | Positive Displacement | Motor          | DIS-P(a)<br>DIS-P(c)<br>Q(a)<br>Q(c)<br>V(a)<br>V(c) | M3<br>Y2<br>M3<br>Y2<br>M3<br>Y2 | PR-01<br>PR-01    |               |
| Pump Name: |                 | Charging Pumps          |          |                 |                       |                |  |                                  |                   |               |



## Attachment 13

[illegible]



## Attachment 13

| Pump Tag        | P&ID          | Coor.                             | Category | Safety Class | Pump Type             | Pump Driver | Test Type | Test Freq. | Relief Request | Tech. Pos. |
|-----------------|---------------|-----------------------------------|----------|--------------|-----------------------|-------------|-----------|------------|----------------|------------|
| EDG SBLO AC 1A1 | 8770 G 096-1A | B-5                               | N/A      | 3            | Positive Displacement | Motor       | SKID      | M3         |                | TP-09      |
|                 | Pump Name:    | Diesel Soak Back Lube Oil AC Pump |          |              |                       |             |           |            |                |            |
| EDG SBLO AC 1A2 | 8770 G 096-1B | G-3                               | N/A      | 3            | Positive Displacement | Motor       | SKID      | M3         |                | TP-09      |
|                 | Pump Name:    | Diesel Soak Back Lube Oil AC Pump |          |              |                       |             |           |            |                |            |
| EDG SBLO AC 1B1 | 8770 G 096-2A | B-5                               | N/A      | 3            | Positive Displacement | Motor       | SKID      | M3         |                | TP-09      |
|                 | Pump Name:    | Diesel Soak Back Lube Oil AC Pump |          |              |                       |             |           |            |                |            |
| EDG SBLO AC 1B2 | 8770 G 096-2B | G-3                               | N/A      | 3            | Positive Displacement | Motor       | SKID      | M3         |                | TP-09      |
|                 | Pump Name:    | Diesel Soak Back Lube Oil AC Pump |          |              |                       |             |           |            |                |            |
| EDG SBLO DC 1A1 | 8770 G 096-1A | B-5                               | N/A      | 3            | Positive Displacement | Motor       | SKID      | M3         |                | TP-09      |
|                 | Pump Name:    | Diesel Soak Back Lube Oil DC Pump |          |              |                       |             |           |            |                |            |
| EDG SBLO DC 1A2 | 8770 G 096-1B | F-3                               | N/A      | 3            | Positive Displacement | Motor       | SKID      | M3         |                | TP-09      |
|                 | Pump Name:    | Diesel Soak Back Lube Oil DC Pump |          |              |                       |             |           |            |                |            |
| EDG SBLO DC 1B1 | 8770 G 096-2A | B-5                               | N/A      | 3            | Positive Displacement | Motor       | SKID      | M3         |                | TP-09      |
|                 | Pump Name:    | Diesel Soak Back Lube Oil DC Pump |          |              |                       |             |           |            |                |            |
| EDG SBLO DC 1B2 | 8770 G 096-2B | F-3                               | N/A      | 3            | Positive Displacement | Motor       | SKID      | M3         |                | TP-09      |
|                 | Pump Name:    | Diesel Soak Back Lube Oil DC Pump |          |              |                       |             |           |            |                |            |



**Feedwater (FW)**

Attachment 13

| Pump Tag   | P&ID         | P&ID<br>Coor. | Category | Safety<br>Class                          | Pump Type   | Pump<br>Driver | Test Type  | Test<br>Freq. | Relief<br>Request | Tech.<br>Pos. |
|------------|--------------|---------------|----------|--|-------------|----------------|------------|---------------|-------------------|---------------|
| AFW PP 1A  | 8770 G 080-4 | E-4           | B        | 3  | Centrifugal | Motor          | dP(b)      | M3            |                   |               |
|            |              |               |          |  |             |                | dP(c)      | Y2            |                   |               |
|            |              |               |          |  |             |                | Q(c)       | Y2            |                   |               |
|            |              |               |          |  |             |                | V(c)       | Y2            |                   |               |
|            |              |               |          |  |             |                | Pump Name: |               |                   |               |
| AFW PP 1B  | 8770 G 080-4 | C-4           | B        | 3  | Centrifugal | Motor          | dP(b)      | M3            |                   |               |
|            |              |               |          |  |             |                | dP(c)      | Y2            |                   |               |
|            |              |               |          |  |             |                | Q(c)       | Y2            |                   |               |
|            |              |               |          |  |             |                | V(c)       | Y2            |                   |               |
|            |              |               |          |  |             |                | Pump Name: |               |                   |               |
| AFW PP 1C  | 8770 G 080-4 | F-4           | B        | 3  | Centrifugal | Turbine        | dP(b)      | M3            |                   |               |
|            |              |               |          |  |             |                | dP(c)      | Y2            |                   |               |
|            |              |               |          |  |             |                | Q(c)       | Y2            |                   |               |
|            |              |               |          |  |             |                | S(b)       | M3            |                   |               |
|            |              |               |          |  |             |                | S(c)       | Y2            |                   |               |
|            |              |               |          |  |             |                | V(c)       | Y2            |                   |               |
| Pump Name: |              |               |          | Steam Driven Auxiliary Feedwater Pump 1C |             |                |            |               |                   |               |



## Attachment 13

| Pump Tag  | P&ID         | P&ID<br>Coor. | Category | Safety<br>Class | Pump Type           | Pump<br>Driver | Test Type  | Test<br>Freq. | Relief<br>Request | Tech.<br>Pos. |
|-----------|--------------|---------------|----------|-----------------|---------------------|----------------|------------|---------------|-------------------|---------------|
| ICW PP 1A | 8770 G 082-2 | H-5           | A        | 3               | Vertical Line Shaft | Motor          | dP(a)      | M3            |                   |               |
|           |              |               |          |                 |                     |                | dP(c)      | Y2            |                   |               |
|           |              |               |          |                 |                     |                | Q(a)       | M3            |                   |               |
|           |              |               |          |                 |                     |                | Q(c)       | Y2            |                   |               |
|           |              |               |          |                 |                     |                | V(a)       | M3            |                   |               |
|           |              |               |          |                 |                     |                | V(c)       | Y2            |                   |               |
|           |              |               |          |                 |                     |                | Pump Name: |               |                   |               |
| ICW PP 1B | 8770 G 082-2 | H-7           | A        | 3               | Vertical Line Shaft | Motor          | dP(a)      | M3            |                   |               |
|           |              |               |          |                 |                     |                | dP(c)      | Y2            |                   |               |
|           |              |               |          |                 |                     |                | Q(a)       | M3            |                   |               |
|           |              |               |          |                 |                     |                | Q(c)       | Y2            |                   |               |
|           |              |               |          |                 |                     |                | V(a)       | M3            |                   |               |
|           |              |               |          |                 |                     |                | V(c)       | Y2            |                   |               |
|           |              |               |          |                 |                     |                | Pump Name: |               |                   |               |
| ICW PP 1C | 8770 G 082-2 | H-7           | A        | 3               | Vertical Line Shaft | Motor          | dP(a)      | M3            |                   |               |
|           |              |               |          |                 |                     |                | dP(c)      | Y2            |                   |               |
|           |              |               |          |                 |                     |                | Q(a)       | M3            |                   |               |
|           |              |               |          |                 |                     |                | Q(c)       | Y2            |                   |               |
|           |              |               |          |                 |                     |                | V(a)       | M3            |                   |               |
|           |              |               |          |                 |                     |                | V(c)       | Y2            |                   |               |
|           |              |               |          |                 |                     |                | Pump Name: |               |                   |               |



## Attachment 13

| Pump Tag   | P&ID            | P&ID<br>Coord. | Category | Safety<br>Class | Pump Type   | Pump<br>Driver | Test Type                                       | Test<br>Freq. | Relief<br>Request | Tech.<br>Pos. |
|------------|-----------------|----------------|----------|-----------------|-------------|----------------|---|---------------|-------------------|---------------|
| HPSI PP 1A | 8770 G 078-130A | C-3            | B        | 2               | Centrifugal | Motor          | dP(b)   | M3            |                   |               |
|            |                 |                |          |                 |             |                | dP(c)   | Y2            |                   |               |
|            |                 |                |          |                 |             |                | Q(c)  | Y2            |                   |               |
|            |                 |                |          |                 |             |                | V(c)  | Y2            |                   |               |
|            |                 |                |          |                 |             |                | Pump Name: High Pressure Safety Injection Pumps |               |                   |               |
| HPSI PP 1B | 8770 G 078-130A | G-3            | B        | 2               | Centrifugal | Motor          | dP(b)   | M3            |                   |               |
|            |                 |                |          |                 |             |                | dP(c)   | Y2            |                   |               |
|            |                 |                |          |                 |             |                | Q(c)  | Y2            |                   |               |
|            |                 |                |          |                 |             |                | V(c)  | Y2            |                   |               |
|            |                 |                |          |                 |             |                | Pump Name: High Pressure Safety Injection Pumps |               |                   |               |
| LPSI PP 1A | 8770 G 078-130B | F-3            | A/B      | 2               | Centrifugal | Motor          | dP(b)   | M3            | PR-04,05          |               |
|            |                 |                |          |                 |             |                | dP(c)   | Y2            |                   |               |
|            |                 |                |          |                 |             |                | Q(c)  | Y2            |                   |               |
|            |                 |                |          |                 |             |                | V(c)  | Y2            |                   |               |
|            |                 |                |          |                 |             |                | Pump Name: Low Pressure Safety Injection Pumps  |               |                   |               |
| LPSI PP 1B | 8770 G 078-130B | G-3            | A/B      | 2               | Centrifugal | Motor          | dP(b)   | M3            | PR-04,05          |               |
|            |                 |                |          |                 |             |                | dP(c)   | Y2            |                   |               |
|            |                 |                |          |                 |             |                | Q(c)  | Y2            |                   |               |
|            |                 |                |          |                 |             |                | V(c)  | Y2            |                   |               |
|            |                 |                |          |                 |             |                | Pump Name: Low Pressure Safety Injection Pumps  |               |                   |               |



## Attachment 13

| Pump Tag  | P&ID         | P&ID<br>Coor. | Category | Safety<br>Class | Pump Type   | Pump<br>Driver | Test Type  | Test<br>Freq.                 | Relief<br>Request | Tech.<br>Pos. |
|-----------|--------------|---------------|----------|-----------------|-------------|----------------|------------|-------------------------------|-------------------|---------------|
| CCW PP 2A | 2998 G 083-1 | E-6           | A        | 3               | Centrifugal | Motor          | dP(a)      | M3                            |                   |               |
|           |              |               |          |                 |             |                | dP(c)      | Y2                            |                   |               |
|           |              |               |          |                 |             |                | Q(a)       | M3                            |                   |               |
|           |              |               |          |                 |             |                | Q(c)       | Y2                            |                   |               |
|           |              |               |          |                 |             |                | V(a)       | M3                            |                   |               |
|           |              |               |          |                 |             |                | V(c)       | Y2                            |                   |               |
|           |              |               |          |                 |             |                | Pump Name: | Component Cooling Water Pumps |                   |               |
| CCW PP 2B | 2998 G 083-1 | E-6           | A        | 3               | Centrifugal | Motor          | dP(a)      | M3                            |                   |               |
|           |              |               |          |                 |             |                | dP(c)      | Y2                            |                   |               |
|           |              |               |          |                 |             |                | Q(a)       | M3                            |                   |               |
|           |              |               |          |                 |             |                | Q(c)       | Y2                            |                   |               |
|           |              |               |          |                 |             |                | V(a)       | M3                            |                   |               |
|           |              |               |          |                 |             |                | V(c)       | Y2                            |                   |               |
|           |              |               |          |                 |             |                | Pump Name: | Component Cooling Water Pumps |                   |               |
| CCW PP 2C | 2998 G 083-1 | E-6           | A        | 3               | Centrifugal | Motor          | dP(a)      | M3                            |                   |               |
|           |              |               |          |                 |             |                | dP(c)      | Y2                            |                   |               |
|           |              |               |          |                 |             |                | Q(a)       | M3                            |                   |               |
|           |              |               |          |                 |             |                | Q(c)       | Y2                            |                   |               |
|           |              |               |          |                 |             |                | V(a)       | M3                            |                   |               |
|           |              |               |          |                 |             |                | V(c)       | Y2                            |                   |               |
|           |              |               |          |                 |             |                | Pump Name: | Component Cooling Water Pumps |                   |               |



Containment Spray (CS)

Attachment 13

| Pump Tag                   | P&ID         | P&ID<br>Coor. | Category | Safety<br>Class | Pump Type             | Pump<br>Driver | Test Type                          | Test<br>Freq. | Relief<br>Request | Tech.<br>Pos. |
|----------------------------|--------------|---------------|----------|-----------------|-----------------------|----------------|------------------------------------|---------------|-------------------|---------------|
| CNTMT SPR PP 2A            | 2998 G 088-1 | G-5           | B        | 2               | Centrifugal           | Motor          | dP(b)                              | M3            |                   |               |
|                            |              |               |          |                 |                       |                | dP(c)                              | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | Q(c)                               | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | V(c)                               | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | Pump Name: Containment Spray Pumps |               |                   |               |
| CNTMT SPR PP 2B            | 2998 G 088-1 | H-5           | B        | 2               | Centrifugal           | Motor          | dP(b)                              | M3            |                   |               |
|                            |              |               |          |                 |                       |                | dP(c)                              | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | Q(c)                               | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | V(c)                               | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | Pump Name: Containment Spray Pumps |               |                   |               |
| HYDRZN PP 2A               | 2998 G 088-1 | G-3           | B        | 2               | Positive Displacement | Motor          | DIS-P(b)                           | M3            | PR-03             |               |
|                            |              |               |          |                 |                       |                | DIS-P(c)                           | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | Q(c)                               | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | Sb                                 | M3            |                   |               |
|                            |              |               |          |                 |                       |                | Sc                                 | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | V(c)                               | Y2            | PR-02             |               |
| Pump Name: Hydrazine Pumps |              |               |          |                 |                       |                |                                    |               |                   |               |
| HYDRZN PP 2B               | 2998 G 088-1 | H-3           | B        | 2               | Positive Displacement | Motor          | DIS-P(b)                           | M3            | PR-03             |               |
|                            |              |               |          |                 |                       |                | DIS-P(c)                           | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | Q(c)                               | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | Sb                                 | M3            |                   |               |
|                            |              |               |          |                 |                       |                | Sc                                 | Y2            |                   |               |
|                            |              |               |          |                 |                       |                | V(c)                               | Y2            | PR-02             |               |
| Pump Name: Hydrazine Pumps |              |               |          |                 |                       |                |                                    |               |                   |               |



## Attachment 13

| Pump Tag  | P&ID            | P&ID<br>Coor. | Category | Safety<br>Class | Pump Type             | Pump<br>Driver | Test Type                                    | Test<br>Freq. | Relief<br>Request | Tech.<br>Pos. |
|-----------|-----------------|---------------|----------|-----------------|-----------------------|----------------|--|---------------|-------------------|---------------|
| BAM PP 2A | 2998 G 078-121B | F-4           | A        | 2               | Centrifugal           | Motor          | dP(a)  | M3            | PR-06             |               |
|           |                 |               |          |                 |                       |                | dP(c)  | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Q(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | Q(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | V(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | V(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Pump Name: Boric Acid Makeup Pumps           |               |                   |               |
| BAM PP 2B | 2998 G 078-121B | G-4           | A        | 2               | Centrifugal           | Motor          | dP(a)  | M3            | PR-06             |               |
|           |                 |               |          |                 |                       |                | dP(c)  | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Q(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | Q(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | V(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | V(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Pump Name: Boric Acid Makeup Pumps           |               |                   |               |
| CHG PP 2A | 2998 G 078-122  | G-2           | A        | 2               | Positive Displacement | Motor          | DIS-P(a)                                     | M3            | PR-01             |               |
|           |                 |               |          |                 |                       |                | DIS-P(c)                                     | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Q(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | Q(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | V(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | V(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Pump Name: Chemical and Volume Control Pumps |               |                   |               |
| CHG PP 2B | 2998 G 078-122  | E-2           | A        | 2               | Positive Displacement | Motor          | DIS-P(a)                                     | M3            | PR-01             |               |
|           |                 |               |          |                 |                       |                | DIS-P(c)                                     | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Q(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | Q(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | V(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | V(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Pump Name: Chemical and Volume Control Pumps |               |                   |               |
| CHG PP 2C | 2998 G 078-122  | B-2           | A        | 2               | Positive Displacement | Motor          | DIS-P(a)                                     | M3            | PR-01             |               |
|           |                 |               |          |                 |                       |                | DIS-P(c)                                     | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Q(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | Q(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | V(a)   | M3            |                   |               |
|           |                 |               |          |                 |                       |                | V(c)   | Y2            |                   |               |
|           |                 |               |          |                 |                       |                | Pump Name: Chemical and Volume Control Pumps |               |                   |               |



## Attachment 13

| Pump Tag    | P&ID          | P&ID<br>Coor.                            | Category | Safety<br>Class | Pump Type             | Pump<br>Driver | Test Type                      | Test<br>Freq.        | Relief<br>Request | Tech.<br>Pos. |
|-------------|---------------|--|----------|-----------------|-----------------------|----------------|--------------------------------|----------------------|-------------------|---------------|
| DOT 2A      | 2998 G 086-1  | B-2                                      | B        | 3               | Centrifugal           | Motor          | dP(b)<br>dP(c)<br>Q(c)<br>V(c) | M3<br>Y2<br>Y2<br>Y2 | PR-07<br>PR-07    |               |
| Pump Name:  |               | Emergency Diesel Fuel Oil Transfer Pumps |          |                 |                       |                |                                |                      |                   |               |
| DOT 2B      | 2998 G 086-1  | D-2                                      | B        | 3               | Centrifugal           | Motor          | dP(b)<br>dP(c)<br>Q(c)<br>V(c) | Y2<br>Y2<br>Y2       |                   |               |
| Pump Name:  |               | Emergency Diesel Fuel Oil Transfer Pumps |          |                 |                       |                |                                |                      |                   |               |
| EDG EPP 2A1 | 2998 G 096-1A | B-4                                      | N/A      | 3               | Positive Displacement | Motor          | SKID                           | M3                   |                   | TP-09         |
| Pump Name:  |               | Diesel Fuel Electric Priming Pump        |          |                 |                       |                |                                |                      |                   |               |
| EDG EPP 2A2 | 2998 G 096-1B | H-4                                      | N/A      | 3               | Positive Displacement | Motor          | SKID                           | M3                   |                   | TP-09         |
| Pump Name:  |               | Diesel Fuel Electric Priming Pump        |          |                 |                       |                |                                |                      |                   |               |
| EDG EPP 2B1 | 2998 G 096-2A | B-4                                      | N/A      | 3               | Positive Displacement | Motor          | SKID                           | M3                   |                   | TP-09         |
| Pump Name:  |               | Diesel Fuel Electric Priming Pump        |          |                 |                       |                |                                |                      |                   |               |
| EDG EPP 2B2 | 2998 G 096-2B | H-4                                      | N/A      | 3               | Positive Displacement | Motor          | SKID                           | M3                   |                   | TP-09         |
| Pump Name:  |               | Diesel Fuel Electric Priming Pump        |          |                 |                       |                |                                |                      |                   |               |



### Emergency Diesel Generator - Lube (EDG-L)

Attachment 13

| Pump Tag        | P&ID          | P&ID<br>Coor.                         | Category | Safety<br>Class | Pump Type             | Pump<br>Driver | Test Type | Test<br>Freq. | Relief<br>Request | Tech.<br>Pos. |
|-----------------|---------------|---------------------------------------|----------|-----------------|-----------------------|----------------|-----------|---------------|-------------------|---------------|
| EDG SBLO AC 2A1 | 2998 G 096-1A | G-5                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Soak Back Lube Oil AC Pump     |          |                 |                       |                |           |               |                   |               |
| EDG SBLO AC 2A2 | 2998 G 096-1B | B-5                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Soak Back Lube Oil AC Pump     |          |                 |                       |                |           |               |                   |               |
| EDG SBLO AC 2B1 | 2998 G 096-2A | G-5                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Soak Back Lube Oil AC Pump     |          |                 |                       |                |           |               |                   |               |
| EDG SBLO AC 2B2 | 2998 G 096-2B | B-5                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Soak Back Lube Oil AC Pump     |          |                 |                       |                |           |               |                   |               |
| EDG SBLO DC 2A1 | 2998 G 096-1A | G-4                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Soak Back Lube Oil DC Pump     |          |                 |                       |                |           |               |                   |               |
| EDG SBLO DC 2A2 | 2998 G 096-1B | B-4                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Soak Back Lube Oil DC Pump     |          |                 |                       |                |           |               |                   |               |
| EDG SBLO DC 2B1 | 2998 G 096-2A | G-4                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Soak Back Lube Oil DC Pump     |          |                 |                       |                |           |               |                   |               |
| EDG SBLO DC 2B2 | 2998 G 096-2B | B-4                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Soak Back Lube Oil DC Pump     |          |                 |                       |                |           |               |                   |               |
| EDG TCLO AC 2A1 | 2998 G 096-1A | G-3                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Turbo Charger Lube Oil AC Pump |          |                 |                       |                |           |               |                   |               |
| EDG TCLO AC 2A2 | 2998 G 096-1B | B-3                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Turbo Charger Lube Oil AC Pump |          |                 |                       |                |           |               |                   |               |
| EDG TCLO AC 2B1 | 2998 G 096-2A | G-3                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Turbo Charger Lube Oil AC Pump |          |                 |                       |                |           |               |                   |               |
| EDG TCLO AC 2B2 | 2998 G 096-2B | B-3                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Turbo Charger Lube Oil AC Pump |          |                 |                       |                |           |               |                   |               |
| EDG TCLO DC 2A1 | 2998 G 096-1A | G-4                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Turbo Charger Lube Oil DC Pump |          |                 |                       |                |           |               |                   |               |
| EDG TCLO DC 2A2 | 2998 G 096-1B | B-3                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Turbo Charger Lube Oil DC Pump |          |                 |                       |                |           |               |                   |               |
| EDG TCLO DC 2B1 | 2998 G 096-2A | G-4                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Turbo Charger Lube Oil DC Pump |          |                 |                       |                |           |               |                   |               |
| EDG TCLO DC 2B2 | 2998 G 096-2B | B-4                                   | N/A      | 3               | Positive Displacement | Motor          | SKID      | M3            |                   | TP-09         |
|                 | Pump Name:    | Diesel Turbo Charger Lube Oil DC Pump |          |                 |                       |                |           |               |                   |               |



## Attachment 13

| Pump Tag  | P&ID          | P&ID<br>Coor. | Category | Safety<br>Class | Pump Type   | Pump<br>Driver | Test Type   | Test<br>Freq. | Relief<br>Request | Tech.<br>Pos. |
|-----------|---------------|---------------|----------|-----------------|-------------|----------------|---|---------------|-------------------|---------------|
| AFW PP 2A | 2998 G 080-2B | B-4           | B        | 3               | Centrifugal | Motor          | dP(b)   | M3            |                   |               |
|           |               |               |          |                 |             |                | dP(c)   | Y2            |                   |               |
|           |               |               |          |                 |             |                | Q(c)  | Y2            |                   |               |
|           |               |               |          |                 |             |                | V(c)  | Y2            |                   |               |
|           |               |               |          |                 |             |                | Pump Name: Motor Driven Auxiliary Feedwater Pumps 2A/2B |               |                   |               |
| AFW PP 2B | 2998 G 080-2B | E-4           | B        | 3               | Centrifugal | Motor          | dP(b)   | M3            |                   |               |
|           |               |               |          |                 |             |                | dP(c)   | Y2            |                   |               |
|           |               |               |          |                 |             |                | Q(c)  | Y2            |                   |               |
|           |               |               |          |                 |             |                | V(c)  | Y2            |                   |               |
|           |               |               |          |                 |             |                | Pump Name: Motor Driven Auxiliary Feedwater Pumps 2A/2B |               |                   |               |
| AFW PP 2C | 2998 G 080-2B | F-3           | B        | 3               | Centrifugal | Turbine        | dP(b)   | M3            |                   |               |
|           |               |               |          |                 |             |                | dP(c)   | Y2            |                   |               |
|           |               |               |          |                 |             |                | Q(c)  | Y2            |                   |               |
|           |               |               |          |                 |             |                | S(b)  | M3            |                   |               |
|           |               |               |          |                 |             |                | S(c)  | Y2            |                   |               |
|           |               |               |          |                 |             |                | V(c)  | Y2            |                   |               |
|           |               |               |          |                 |             |                | Pump Name: Steam Driven Auxiliary Feedwater Pump 2C     |               |                   |               |



### Intake Cooling Water (ICW)

Attachment 13

| Pump Tag  | P&ID         | P&ID<br>Coord. | Category | Safety<br>Class | Pump Type           | Pump<br>Driver | Test Type  | Test<br>Freq. | Relief<br>Request | Tech.<br>Pos. |
|-----------|--------------|----------------|----------|-----------------|---------------------|----------------|------------|---------------|-------------------|---------------|
| ICW PP 2A | 2998 G 082-2 | H-5            | A        | 3               | Vertical Line Shaft | Motor          | dP(a)      | M3            |                   |               |
|           |              |                |          |                 |                     |                | dP(c)      | Y2            |                   |               |
|           |              |                |          |                 |                     |                | Q(a)       | M3            |                   |               |
|           |              |                |          |                 |                     |                | Q(c)       | Y2            |                   |               |
|           |              |                |          |                 |                     |                | V(a)       | M3            |                   |               |
|           |              |                |          |                 |                     |                | V(c)       | Y2            |                   |               |
|           |              |                |          |                 |                     |                | Pump Name: |               |                   |               |
| ICW PP 2B | 2998 G 082-2 | H-7            | A        | 3               | Vertical Line Shaft | Motor          | dP(a)      | M3            |                   |               |
|           |              |                |          |                 |                     |                | dP(c)      | Y2            |                   |               |
|           |              |                |          |                 |                     |                | Q(a)       | M3            |                   |               |
|           |              |                |          |                 |                     |                | Q(c)       | Y2            |                   |               |
|           |              |                |          |                 |                     |                | V(a)       | M3            |                   |               |
|           |              |                |          |                 |                     |                | V(c)       | Y2            |                   |               |
|           |              |                |          |                 |                     |                | Pump Name: |               |                   |               |
| ICW PP 2C | 2998 G 082-2 | H-6            | A        | 3               | Vertical Line Shaft | Motor          | dP(a)      | M3            |                   |               |
|           |              |                |          |                 |                     |                | dP(c)      | Y2            |                   |               |
|           |              |                |          |                 |                     |                | Q(a)       | M3            |                   |               |
|           |              |                |          |                 |                     |                | Q(c)       | Y2            |                   |               |
|           |              |                |          |                 |                     |                | V(a)       | M3            |                   |               |
|           |              |                |          |                 |                     |                | V(c)       | Y2            |                   |               |
|           |              |                |          |                 |                     |                | Pump Name: |               |                   |               |



[illegible]



**ATTACHMENT 14**

**INSERVICE TESTING VALVE TABLE INDEX**

| <b>System Designator</b> | <b>System Description</b>                  |
|--------------------------|--|
| CCW                      | Component Cooling Water                    |
| CS                       | Containment Spray                          |
| CVCS                     | Chemical and Volume Control System         |
| EDG-A                    | Emergency Diesel Generator – Air           |
| EDG-C                    | Emergency Diesel Generator - Cooling Water |
| EDG-F                    | Emergency Diesel Generator – Fuel          |
| EDG-L                    | Emergency Diesel Generator - Lube          |
| FP                       | Fuel Pool Cooling and Make-up              |
| FW                       | Feedwater                                  |
| HVAC                     | Heating, Ventilation and Air Conditioning  |
| IA                       | Instrument Air                             |
| ICW                      | Intake Cooling Water                       |
| ILRT                     | Integrated Leak Rate Penetrations          |
| MS                       | Main Steam                                 |
| M-SAM                    | Miscellaneous Sampling                     |
| MUW                      | Make-up Water                              |
| RCS                      | Reactor Coolant System                     |
| SA                       | Service Air                                |
| SAM                      | Sampling System                            |
| SGDB                     | Steam Generator Blowdown                   |
| SI                       | Safety Injection                           |
| W-MAN                    | Waste Management                           |



| Valve Tag   | P&ID          | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.           | Relief<br>Request | Deferred<br>Just.  | Tech.<br>Pos. |
|-------------|---------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|-------------------------|-------------------|--------------------|---------------|
| 1-HCV-14-1  | 8770 G 083-1B | E-6   | 2               | A    | 8    | BTF           | PO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-13<br><br>CS-13 | TP-03         |
| Valve Name: |               | RCP Cooling Water Inlet Containment Isolation Valve   |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 1-HCV-14-10 | 8770 G 083-1A | H-6   | 3               | B    | 16   | BTF           | PO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C         | M3<br>Y2<br>M3          |                   |                    | TP-03         |
| Valve Name: |               | Nonessential Header Outlet Isolation Valve            |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 1-HCV-14-2  | 8770 G 083-1B | E-7   | 2               | A    | 8    | BTF           | PO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-13<br><br>CS-13 | TP-03         |
| Valve Name: |               | RCP Cooling Water Outlet Containment Isolation Valve  |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 1-HCV-14-3A | 8770 G 083-1A | F-1   | 3               | B    | 14   | BTF           | AO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O         | M3<br>Y2<br>M3          |                   |                    | TP-03         |
| Valve Name: |               | 1A Shutdown Cooling Heat Exchanger Water Return Valve |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 1-HCV-14-3B | 8770 G 083-1A | F-2   | 3               | B    | 14   | BTF           | AO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O         | M3<br>Y2<br>M3          |                   |                    | TP-03         |
| Valve Name: |               | 1B Shutdown Cooling Heat Exchanger Water Return Valve |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 1-HCV-14-6  | 8770 G 083-1B | D-7   | 2               | A    | 8    | BTF           | PO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-13<br><br>CS-13 | TP-03         |
| Valve Name: |               | RCP Cooling Water Outlet Containment Isolation Valve  |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 1-HCV-14-7  | 8770 G 083-1B | D-6   | 2               | A    | 8    | BTF           | PO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-13<br><br>CS-13 | TP-03         |
| Valve Name: |               | RCP Cooling Water Inlet Containment Isolation Valve   |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |



### Component Cooling Water (CCW)

| Valve Tag   | P&ID          | P&ID<br>Coord.                                      | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type       | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|---------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------------|----------------|-------------------|-------------------|---------------|
| 1-HCV-14-8A | 8770 G 083-1A | D-4   | 3               | B    | 16   | BTF           | PO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |               | Nonessential Header Inlet Isolation Valve           |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-HCV-14-8B | 8770 G 083-1A | D-5   | 3               | B    | 16   | BTF           | PO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |               | Nonessential Header Inlet Isolation Valve           |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-HCV-14-9  | 8770 G 083-1A | H-5   | 3               | B    | 16   | BTF           | PO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |               | Nonessential Header Outlet Isolation Valve          |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-MV-14-1   | 8770 G 083-1A | E-6   | 3               | B    | 24   | BTF           | MO           | P                   | C                  | C                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |               | 1C CCW Pump to Header A Discharge Stop Valve        |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-MV-14-2   | 8770 G 083-1A | E-7   | 3               | B    | 24   | BTF           | MO           | P                   | O                  | C                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |               | 1C CCW Pump to Header B Discharge Stop Valve        |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-MV-14-3   | 8770 G 083-1A | G-7   | 3               | B    | 24   | BTF           | MO           | P                   | C                  | C                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |               | Header A to 1C CCW Pump Suction Stop Valve          |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-MV-14-4   | 8770 G 083-1A | G-7   | 3               | B    | 24   | BTF           | MO           | P                   | O                  | C                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |               | Header B to 1C CCW Pump Suction Stop Valve          |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-MV-14-5   | 8770 G 083-1A | C-2   | 2               | B    | 10   | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |               | Containment Cooling Units CCW Isolation Valve       |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-MV-14-6   | 8770 G 083-1A | C-3   | 2               | B    | 10   | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |               | Containment Cooling Units CCW Isolation Valve       |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-MV-14-7   | 8770 G 083-1A | H-2   | 2               | B    | 10   | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |               | Containment Cooling Units CCW Isolation Valve       |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-MV-14-8   | 8770 G 083-1A | F-3   | 2               | B    | 10   | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |               | Containment Cooling Units CCW Isolation Valve       |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 1-SR-14-7A  | 8770 G 083-1A | E-2   | 3               | C    | 1x2  | RV            | SA           | A                   | C                  | O/C                | RVT                | Y10            |                   |                   | TP-08         |
| Valve Name: |               | 1A Shutdown Heat Exchangers Shell Side Relief Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |



[illegible]



| Valve Tag   | P&ID         | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.        | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|----------------------|-------------------|-------------------|---------------|
| 1-FCV-07-1A | 8770 G 088-2 | B-3   | 2               | B    | 12   | BTF           | AO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O         | M3<br>Y2<br>M3       |                   |                   | TP-03         |
| Valve Name: |              | Containment Spray Discharge Header Control Valve              |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-FCV-07-1B | 8770 G 088-2 | D-3   | 2               | B    | 12   | BTF           | AO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O         | M3<br>Y2<br>M3       |                   |                   | TP-03         |
| Valve Name: |              | Containment Spray Discharge Header Control Valve              |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-MV-07-1A  | 8770 G 088-1 | E-5   | 2               | B    | 24   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C                | Y2<br>M3             |                   |                   | TP-11         |
| Valve Name: |              | Isolation for RWT Feed to 'A' Train LPSI, HPSI, & CNTMT SPR   |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-MV-07-1B  | 8770 G 088-1 | E-5   | 2               | B    | 24   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C                | Y2<br>M3             |                   |                   | TP-11         |
| Valve Name: |              | Isolation for RWT to 'B' Train LPSI, HPSI, & CNTMT Spray Pump |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-MV-07-3A  | 8770 G 088-2 | B-3   | 2               | B    | 12   | GA            | MO           | A                   | LO                 | O                  | PIT<br>ST-C                | Y2<br>M3             |                   |                   |               |
| Valve Name: |              | Containment Spray Discharge Header Stop Valve                 |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-MV-07-3B  | 8770 G 088-2 | D-3   | 2               | B    | 12   | GA            | MO           | A                   | LO                 | O                  | PIT<br>ST-C                | Y2<br>M3             |                   |                   |               |
| Valve Name: |              | Containment Spray Discharge Header Stop Valve                 |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-SE-07-1A  | 8770 G 088-1 | G-1   | 2               | B    | 2    | GL            | SO           | A                   | C                  | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | M3<br>Y2<br>M3<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | NaOH Storage Tank Discharge Valve                             |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-SE-07-1B  | 8770 G 088-1 | G-3   | 2               | B    | 2    | GL            | SO           | A                   | C                  | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | M3<br>Y2<br>M3<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | NaOH Storage Tank Discharge Valve                             |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |



[illegible]



| Valve Tag | P&ID         | P&ID<br>Coor.                        | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|--------------|--------------------------------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-V-07256 | 8770 G 088-1 | G-4                                  | 2               | C    | 2    | CK            | SA           | A                   | C                  | O/C                | CC           | CM            |                   |                   | TP-07         |
|           |              |                                      |                 |      |      |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
|           | Valve Name:  | NaOH Supply Check Valve              |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-07258 | 8770 G 088-1 | H-4                                  | 2               | C    | 2    | CK            | SA           | A                   | C                  | O/C                | CC           | CM            |                   |                   | TP-07         |
|           |              |                                      |                 |      |      |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
|           | Valve Name:  | NaOH Supply Check Valve              |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-07271 | 8770 G 088-1 | H-3                                  | 2               | B    | 3    | GA            | M            | A                   | LO                 | O                  | ME           | Y2            |                   |                   | TP-04         |
|           | Valve Name:  | LPSI to CS Pump 1B Suction Iso Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-07272 | 8770 G 088-1 | G-4                                  | 2               | B    | 3    | GA            | M            | A                   | LO                 | O                  | ME           | Y2            |                   |                   | TP-04         |
|           | Valve Name:  | LPSI to CS Pump 1A Suction Iso Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag   | P&ID            | P&ID<br>Coord.                                  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.           | Relief<br>Request | Deferred<br>Just.           | Tech.<br>Pos. |
|-------------|-----------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|-------------------------|-------------------|-----------------------------|---------------|
| 1-FCV-2161  | 8770 G 078-121B | G-5   | 2               | B    | 1    | GL            | AO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C         | M3<br>Y2<br>M3          |                   |                             | TP-03         |
| Valve Name: |                 | Boric Acid Makeup Pumps Disch to VCT Stop Valve |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                             |               |
| 1-MV-02-2   | 8770 G 078-120B | F-5   | 2               | B    | 2    | GL            | MO           | P                   | O                  | O                  | PIT                        | Y2                      |                   |                             |               |
| Valve Name: |                 | Charging Header Iso Valve                       |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                             |               |
| 1-SE-01-1   | 8770 G 078-121A | C-2   | 2               | A    | 0.75 | GL            | SO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-06<br><br>CS-06          | TP-03         |
| Valve Name: |                 | RCP Seal Water Return Isolation Valve           |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                             |               |
| 1-SE-02-1   | 8770 G 078-120B | D-6   | 1               | B    | 2    | GL            | SO           | A                   | O                  | O/C                | FSO<br>PIT<br>ST-C<br>ST-O | M3<br>Y2<br>M3<br>M3    |                   |                             | TP-03         |
| Valve Name: |                 | Charging Line to RCS Cold Leg Stop Valve        |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                             |               |
| 1-SE-02-2   | 8770 G 078-120B | C-6   | 1               | B    | 2    | GL            | SO           | A                   | O                  | O/C                | FSO<br>PIT<br>ST-C<br>ST-O | M3<br>Y2<br>M3<br>M3    |                   |                             | TP-03         |
| Valve Name: |                 | Charging Line to RCS Cold Leg Stop Valve        |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                             |               |
| 1-SE-02-3   | 8770 G 078-120B | F-6   | 1               | B    | 2    | GL            | SO           | A                   | LC                 | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | CS<br>Y2<br>CS<br>CS    |                   | CS-03<br><br>CS-03<br>CS-03 | TP-03         |
| Valve Name: |                 | Auxiliary Pressurizer Spray Isolation Valve     |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                             |               |
| 1-SE-02-4   | 8770 G 078-120B | E-6   | 1               | B    | 2    | GL            | SO           | A                   | LC                 | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | CS<br>Y2<br>CS<br>CS    |                   | CS-03<br><br>CS-03<br>CS-03 | TP-03         |
| Valve Name: |                 | Auxiliary Pressurizer Spray Isolation Valve     |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                             |               |
| 1-V-02132   | 8770 G 078-120B | C-3   | 2               | C    | 2    | CK            | SA           | A                   | SYS                | O/C                | CC<br>CO                   | M3<br>M3                |                   |                             |               |
| Valve Name: |                 | 1A Charging Pump Discharge CV                   |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                             |               |



| Valve Tag | P&ID            | P&ID Safety<br>Coord.                          | Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-----------|-----------------|--|-------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|-----------------------|
| 1-V-02133 | 8770 G 078-120B | E-3  | 2     | C    | 2    | CK            | SA           | A                   | SYS                | O/C                | CC<br>CO     | M3<br>M3      |                   |                   |                       |
|           | Valve Name:     | 1B Charging Pump Discharge CV                  |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-02134 | 8770 G 078-120B | G-3  | 2     | C    | 2    | CK            | SA           | A                   | SYS                | O/C                | CC<br>CO     | M3<br>M3      |                   |                   |                       |
|           | Valve Name:     | 1C Charging Pump Discharge CV                  |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2115  | 8770 G 078-121A | D-5  | 3     | C    | 4    | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                       |
|           | Valve Name:     | Relief Valve for VCT Outlet                    |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2118  | 8770 G 078-121A | E-5  | 2     | C    | 4    | CK            | SA           | A                   | O                  | O/C                | CC<br>CO     | CM<br>CM      |                   |                   | TP-07<br>TP-07        |
|           | Valve Name:     | VCT Discharge Header Check Valve               |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2177  | 8770 G 078-121B | H-5  | 2     | C    | 3    | CK            | SA           | A                   | C                  | O                  | COF<br>NI    | CM<br>CM      |                   |                   | TP-07<br>TP-01, TP-07 |
|           | Valve Name:     | BAM Pump Discharge CV to Charging Pump Suction |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2190  | 8770 G 078-121B | G-2  | 2     | C    | 3    | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | Boric Acid Gravity Feed Check Valve            |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2191  | 8770 G 078-121A | F-5  | 2     | C    | 3    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | CM<br>CM      |                   |                   | TP-07<br>TP-07        |
|           | Valve Name:     | RWT to Charging Pump Suction Check Valve       |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2311  | 8770 G 078-121A | F-6  | 2     | C    | 0.5  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                       |
|           | Valve Name:     | Charging Pump Suction Header Relief Valve      |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2315  | 8770 G 078-120B | B-2  | 2     | C    | 0.5  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08                 |
|           | Valve Name:     | 1A Charging Pump Suction Relief Valve          |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2318  | 8770 G 078-120B | D-2  | 2     | C    | 0.5  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08                 |
|           | Valve Name:     | 1B Charging Pump Suction Relief Valve          |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2321  | 8770 G 078-120B | F-2  | 2     | C    | 0.5  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08                 |
|           | Valve Name:     | 1C Charging Pump Suction Relief Valve          |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2324  | 8770 G 078-120B | F-3  | 2     | C    | 1.5  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                       |
|           | Valve Name:     | 1C Charging Pump Discharge Relief Valve        |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |



| Valve Tag | P&ID            | P&ID Safety<br>Coord.                              | Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-----------|-----------------|--|-------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|-----------------------|
| 1-V-2325  | 8770 G 078-120B | D-3  | 2     | C    | 1.5  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                       |
|           | Valve Name:     | 1B Charging Pump Discharge Relief Valve            |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2326  | 8770 G 078-120B | B-3  | 2     | C    | 1.5  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                       |
|           | Valve Name:     | 1A Charging Pump Discharge Relief Valve            |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2336  | 8770 G 078-120B | G-3  | 2     | B    | 2    | GL            | M            | A                   | LO                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:     | 1C Charging Pump Discharge Isolation Valve         |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2337  | 8770 G 078-120B | E-3  | 2     | B    | 2    | GL            | M            | A                   | LO                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:     | 1B Charging Pump Discharge Isolation Valve         |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2338  | 8770 G 078-120B | D-3  | 2     | B    | 2    | GA            | M            | A                   | LO                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:     | CVCS to HPSI Auxiliary Header Isolation Valve      |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2339  | 8770 G 078-120B | C-3  | 2     | B    | 2    | GL            | M            | A                   | LO                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:     | 1A Charging Pump Discharge Isolation Valve         |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2340  | 8770 G 078-120B | A-3  | 2     | B    | 2    | GA            | M            | A                   | C                  | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:     | CVCS to HSPI Auxiliary Header Cross-Connect        |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2354  | 8770 G 078-120A | C-6  | 3     | C    | 3    | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                       |
|           | Valve Name:     | Safety Rlf for Letdown Holdup Tank Dwnstrm FE-2202 |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2429  | 8770 G 078-120B | B-4  | 2     | B    | 2    | GA            | M            | A                   | LO                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:     | Charging Line Isolation Valve                      |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2430  | 8770 G 078-120B | B-5  | 2     | C    | 2    | CK            | SA           | A                   | O                  | O                  | CCNI<br>COF  | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | Charging Header Check Valve                        |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2431  | 8770 G 078-120B | F-7  | 1     | C    | 2    | CK            | SA           | A                   | C                  | O                  | CCNI<br>COF  | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | Auxiliary Pressurizer Spray Check Valve            |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2432  | 8770 G 078-120B | D-7  | 1     | C    | 2    | CK            | SA           | A                   | O                  | O                  | CCNI<br>COF  | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | RCS Cold Leg Chrgng Line CV                        |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-2433  | 8770 G 078-120B | C-7  | 1     | C    | 2    | CK            | SA           | A                   | O                  | O                  | CCNI<br>COF  | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | RCS Cold Leg Chrgng Line CV                        |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |



### Chemical and Volume Control System (CVCS)

[illegible]



| Valve Tag  | P&ID            | P&ID<br>Coord. | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.           | Relief<br>Request | Deferred<br>Just.  | Tech.<br>Pos.         |
|--|-----------------|----------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|-------------------------|-------------------|--------------------|-----------------------|
| 1-V-2511   | 8770 G 078-121B | D-4            | 2               | B    | 1    | GL            | AO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C         | M3<br>Y2<br>M3          |                   |                    | TP-03                 |
| Valve Name: 1B Boric Acid Makeup Pump Recirc Control Valve       |                 |                |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |                       |
| 1-V-2514   | 8770 G 078-121B | H-5            | 2               | B    | 3    | GA            | MO           | A                   | C                  | O                  | PIT<br>ST-O                | Y2<br>M3                |                   |                    |                       |
| Valve Name: Boric Acid Makeup Pump Disch to Chargin Pump Suction |                 |                |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |                       |
| 1-V-2515   | 8770 G 078-120B | G-7            | 1               | A    | 2    | GL            | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-04<br><br>CS-04 | TP-03                 |
| Valve Name: Letdown Isolation Valve                              |                 |                |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |                       |
| 1-V-2516   | 8770 G 078-120B | G-6            | 1               | A    | 2    | GL            | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-04<br><br>CS-04 | TP-03                 |
| Valve Name: Letdown Isolation Valve                              |                 |                |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |                       |
| 1-V-2525   | 8770 G 078-121A | G-4            | 3               | B    | 4    | GA            | MO           | A                   | C                  | C                  | PIT<br>ST-C                | Y2<br>M3                |                   |                    |                       |
| Valve Name: BMT and RMW to Charging Pump Suction Iso Valve       |                 |                |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |                       |
| 1-V-2526   | 8770 G 078-121A | D-5            | 3               | C    | 4    | CK            | SA           | A                   | O                  | O                  | CC<br>CO                   | CM<br>CM                |                   |                    | TP-01, TP-07<br>TP-07 |
| Valve Name: Volume Control Tank Discharge Check Valve            |                 |                |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |                       |
| 1-V-2621   | 8770 G 078-121A | C-4            | 3               | B    | 3    | GA            | M            | A                   | O                  | C                  | ME                         | Y2                      |                   |                    | TP-04                 |
| Valve Name: PMW/BAM Supply to VCT Check Valve                    |                 |                |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |                       |



| Valve Tag    | P&ID          | P&ID<br>Coor.                                 | Safety<br>Class | Valve<br>Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|--------------|---------------|---|-----------------|---------------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-FCV-59-1A1 | 8770 G 096-1C | H-2   | 3               | B             | 1.5  | GA            | AO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1A EDG Starting Air Control Valve             |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-FCV-59-1B1 | 8770 G 096-2C | G-4   | 3               | B             | 1.5  | GA            | AO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1B EDG Starting Air Control Valve             |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-FCV-59-2A1 | 8770 G 096-1C | H-4   | 3               | B             | 1.5  | GA            | AO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1A EDG Starting Air Control Valve             |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-FCV-59-2B1 | 8770 G 096-2C | G-2   | 3               | B             | 1.5  | GA            | AO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1B EDG Starting Air Control Valve             |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-FCV-59-3A1 | 8770 G 096-1C | G-4   | 3               | B             | 1.5  | GA            | AO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1A EDG Starting Air Control Valve             |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-FCV-59-3B1 | 8770 G 096-2C | H-4   | 3               | B             | 1.5  | GA            | AO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1B EDG Starting Air Control Valve             |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-FCV-59-4A1 | 8770 G 096-1C | G-2   | 3               | B             | 1.5  | GA            | AO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1A EDG Starting Air Control Valve             |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-FCV-59-4B1 | 8770 G 096-2C | H-2   | 3               | B             | 1.5  | GA            | AO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1B EDG Starting Air Control Valve             |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-59-3A   | 8770 G 096-1C | G-2   | 3               | B             | 0.5  | GL            | SO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1A EDG Starting Air Control Valve Pilot Valve |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-59-3B   | 8770 G 096-2C | H-2   | 3               | B             | 0.5  | GL            | SO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1B EDG Starting Air Control Valve Pilot Valve |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-59-4A   | 8770 G 096-1C | F-2   | 3               | B             | 0.5  | GL            | SO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1A EDG Starting Air Control Valve Pilot Valve |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-59-4B   | 8770 G 096-2C | F-2   | 3               | B             | 0.5  | GL            | SO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1B EDG Starting Air Control Valve Pilot Valve |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-59-5A   | 8770 G 096-1C | G-4   | 3               | B             | 0.5  | GL            | SO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1A EDG Starting Air Control Valve Pilot Valve |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-59-5B   | 8770 G 096-2C | G-4   | 3               | B             | 0.5  | GL            | SO           | A                   | C                  | O/C                | ST-O         | Y2            |                   |                   | TP-09         |
|              | Valve Name:   | 1B EDG Starting Air Control Valve Pilot Valve |                 |               |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



### Emergency Diesel Generator - Air (EDG-A)

| Valve Tag  | P&ID          | P&ID<br>Coord.  | Safety<br>Class | Cal. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.  |
|------------|---------------|---|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|----------------|
| 1-SR-59-5A | 8770 G 096-1C | C-2   | 3               | C    | 0.75  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                |
|            | Valve Name:   | 1A EDG Starting Air Receiver Relief Valve                 |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-SR-59-5B | 8770 G 096-2C | C-2   | 3               | C    | 0.75  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                |
|            | Valve Name:   | 1B EDG Starting Air Receiver Relief Valve                 |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-SR-59-6A | 8770 G 096-1C | C-1   | 3               | C    | 0.75  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                |
|            | Valve Name:   | 1A EDG Starting Air Receiver Relief Valve                 |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-SR-59-6B | 8770 G 096-2C | C-1   | 3               | C    | 0.75  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                |
|            | Valve Name:   | 1B EDG Starting Air Receiver Relief Valve                 |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-V-59079  | 8770 G 096-1C | D-5   | 3               | C    | 1     | CK            | SA           | A                   | C                  | C                  | CC<br>CO     | M3<br>OP      |                   |                   | TP-05, TP-01   |
|            | Valve Name:   | 1A EDG Air Start Receiver Check Valve                     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-V-59125  | 8770 G 096-2C | D-5   | 3               | C    | 1     | CK            | SA           | A                   | C                  | C                  | CC<br>CO     | M3<br>OP      |                   |                   | TP-05, TP-01   |
|            | Valve Name:   | 1B EDG Air Start Receiver Check Valve                     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-V-59156  | 8770 G 096-1C | D-5   | 3               | C    | 1     | CK            | SA           | A                   | C                  | C                  | CC<br>CO     | M3<br>OP      |                   |                   | TP-05, TP-01   |
|            | Valve Name:   | 1A EDG Air Start Receiver Check Valve                     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-V-59158  | 8770 G 096-2C | D-5   | 3               | C    | 1     | CK            | SA           | A                   | C                  | C                  | CC<br>CO     | M3<br>OP      |                   |                   | TP-05, TP-01   |
|            | Valve Name:   | 1B EDG Air Start Receiver Check Valve                     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-V-59200  | 8770 G 096-1C | F-1   | 3               | C    | 0.375 | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | Y2<br>Y2      |                   |                   | TP-09<br>TP-09 |
|            | Valve Name:   | Check Valve Assembly for D/G Engine Governor Air Boosters |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-V-59201  | 8770 G 096-1C | F-5   | 3               | C    | 0.375 | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | Y2<br>Y2      |                   |                   | TP-09<br>TP-09 |
|            | Valve Name:   | Check Valve Assembly for D/G Engine Governor Air Boosters |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |
| 1-V-59202  | 8770 G 096-2C | F-1   | 3               | C    | 0.375 | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | Y2<br>Y2      |                   |                   | TP-09<br>TP-09 |
|            | Valve Name:   | Check Valve Assembly for D/G Engine Governor Air Boosters |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                |



## Attachment 15

[illegible]



[illegible]



[illegible]



| Valve Tag | P&ID          | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|---------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-V-59010 | 8770 G 096-1A | B-5   | 3               | C    | 0.5  | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil A/C Pump Discharge Check for Diesel 1A1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-59011 | 8770 G 096-1A | B-4   | 3               | C    | 0.5  | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil D/C Pump Discharge Check for Diesel 1A1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-59025 | 8770 G 096-1B | G-4   | 3               | C    | 0.5  | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil A/C Pump Discharge Check for Diesel 1A2 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-59026 | 8770 G 096-1B | F-4   | 3               | C    | 0.5  | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil D/C Pump Discharge Check for Diesel 1A2 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-59040 | 8770 G 096-2A | B-4   | 3               | C    | 1    | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil A/C Pump Discharge Check for Diesel 1B1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-59041 | 8770 G 096-2A | B-4   | 3               | C    | 0.5  | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil D/C Pump Discharge Check for Diesel 1B1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-59055 | 8770 G 096-2B | F-4   | 3               | C    | 0.5  | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil D/C Pump Discharge Check for Diesel 1B2 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-59056 | 8770 G 096-2B | G-4   | 3               | C    | 1    | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil A/C Pump Discharge Check for Diesel 1B2 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



[illegible]



| Valve Tag   | P&ID         | P&ID<br>Coor.                              | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|-----------------------|
| 1-SR-09-841 | 8770 G 080-5 | D-3  | 3               | C    | 1    | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                       |
|             | Valve Name:  | MFIV N2 Accumulator 1A Relief Valve        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-SR-09-868 | 8770 G 080-5 | H-3  | 3               | C    | 1    | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |                       |
|             | Valve Name:  | MFIV N2 Accumulator 1B Relief Valve        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09107   | 8770 G 080-4 | E-4  | 3               | C    | 4    | CK            | SA           | A                   | C                  | O                  | CCF<br>COF   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|             | Valve Name:  | 1A AFW Pump Discharge Check Valve          |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09119   | 8770 G 080-4 | E-7  | 2               | C    | 4    | CK            | SA           | A                   | C                  | O                  | CCL<br>COF   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|             | Valve Name:  | 1A AFW Supply Header Check Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09120   | 8770 G 080-4 | E-7  | 2               | B    | 4    | GA            | M            | A                   | LO                 | C                  | ME           | Y2            |                   |                   | TP-04                 |
|             | Valve Name:  | Manual Auxiliary Feedwater Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09123   | 8770 G 080-4 | B-4  | 3               | C    | 4    | CK            | SA           | A                   | C                  | O                  | CCF<br>COF   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|             | Valve Name:  | 1B AFW Pump Discharge Check Valve          |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09135   | 8770 G 080-4 | B-7  | 2               | C    | 4    | CK            | SA           | A                   | C                  | O                  | CCL<br>COF   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|             | Valve Name:  | 1B AFW Supply Header Check Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09136   | 8770 G 080-4 | B-7  | 2               | B    | 4    | GA            | M            | A                   | LO                 | C                  | ME           | Y2            |                   |                   | TP-04                 |
|             | Valve Name:  | Manual Auxiliary Feedwater Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09139   | 8770 G 080-4 | F-4  | 3               | C    | 6    | CK            | SA           | A                   | C                  | O                  | CCL<br>COF   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|             | Valve Name:  | 1C AFW Pump Discharge Check Valve          |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09151   | 8770 G 080-4 | H-7  | 2               | C    | 4    | CK            | SA           | A                   | C                  | O                  | CCF<br>COL   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|             | Valve Name:  | 1C AFW Supply to 1A Header Check Valve     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09152   | 8770 G 080-4 | H-7  | 2               | B    | 4    | GA            | M            | A                   | LO                 | C                  | ME           | Y2            |                   |                   | TP-04                 |
|             | Valve Name:  | Manual Auxiliary Feedwater Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-09157   | 8770 G 080-4 | F-7  | 2               | C    | 4    | CK            | SA           | A                   | C                  | O                  | CCF<br>COL   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|             | Valve Name:  | 1C AFW Supply to 1B Header Check Valve     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |



| Valve Tag   | P&ID   | P&ID Safety Coord. | Class | Cat. | Size  | Valve Type | Act. Type | Active / Passive | Normal Position | Safety Position | Test Type | Test Freq. | Relief Request | Deferred Just. | Tech. Pos.   |
|---|--|--------------------|-------|------|-------|------------|-----------|------------------|-----------------|-----------------|-----------|------------|----------------|----------------|--------------|
| 1-V-09158   | 8770 G 080-4   | F-7                | 2     | B    | 4     | GA         | M         | A                | LO              | C               | ME        | Y2         |                |                | TP-04        |
|   | Valve Name: Manual Auxiliary Feedwater Isolation Valve |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09248   | 8770 G 080-3   | B-5                | 2     | C    | 20    | CK         | SA        | A                | O               | C               | CCD       | CM         |                |                | TP-07        |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COD       | CM         |                |                | TP-01, TP-07 |
| Valve Name: 1A Steam Generator Outboard Feedwater Check Valve |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09252   | 8770 G 080-3   | B-7                | 2     | C    | 18    | CK         | SA        | A                | O               | O               | CCD       | CM         |                |                | TP-01, TP-07 |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COF       | CM         |                |                | TP-07        |
| Valve Name: 1A Steam Generator Inboard Feedwater Check Valve  |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09280   | 8770 G 080-3   | C-5                | 2     | C    | 20    | CK         | SA        | A                | O               | C               | CCD       | CM         |                |                | TP-07        |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COD       | CM         |                |                | TP-01, TP-07 |
| Valve Name: 1B Steam Generator Outboard Feedwater Check Valve |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09294   | 8770 G 080-3   | C-7                | 2     | C    | 18    | CK         | SA        | A                | O               | O               | CCD       | CM         |                |                | TP-01, TP-07 |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COF       | CM         |                |                | TP-07        |
| Valve Name: 1B Steam Generator Inboard Feedwater Check Valve  |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09303   | 8770 G 080-4   | E-3                | 3     | C    | 2     | CK         | SA        | A                | C               | O               | CCU       | CM         |                |                | TP-01, TP-07 |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COU       | CM         |                |                | TP-07        |
| Valve Name: 1C AFW Pump Minimum Flow Check Valve              |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09304   | 8770 G 080-4   | C-3                | 3     | C    | 2     | CK         | SA        | A                | C               | O               | CCU       | CM         |                |                | TP-01, TP-07 |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COU       | CM         |                |                | TP-07        |
| Valve Name: 1B AFW Pump Minimum Flow Check Valve              |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09305   | 8770 G 080-4   | D-3                | 3     | C    | 2     | CK         | SA        | A                | C               | O               | CCU       | CM         |                |                | TP-01, TP-07 |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COU       | CM         |                |                | TP-07        |
| Valve Name: 1A AFW Pump Minimum Flow Check Valve              |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09824   | 8770 G 080-4   | A-6                | 3     | C    | 0.375 | CK         | SA        | A                | C               | C               | CCL       | CM         |                |                | TP-07        |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COF       | CM         |                |                | TP-01, TP-07 |
| Valve Name: AFWF 1B to SG 1B Chemical Addition Check Valves   |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09825   | 8770 G 080-4   | D-6                | 3     | C    | 0.375 | CK         | SA        | A                | C               | C               | CCL       | CM         |                |                | TP-07        |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COF       | CM         |                |                | TP-01, TP-07 |
| Valve Name: AFWF 1A to SG 1A Chemical Addition Check Valves   |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |
| 1-V-09826   | 8770 G 080-4   | G-6                | 3     | C    | 0.375 | CK         | SA        | A                | C               | C               | CCL       | CM         |                |                | TP-07        |
|   |  |                    |       |      |       |            |           |                  |                 |                 | COF       | CM         |                |                | TP-01, TP-07 |
| Valve Name: AFWF 1C to SG 1B Chemical Addition Check Valves   |  |                    |       |      |       |            |           |                  |                 |                 |           |            |                |                |              |



| Valve Tag | P&ID         | P&ID<br>Coor.                                   | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|--------------|---|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-V-09827 | 8770 G 080-4 | E-6   | 3               | C    | 0.375 | CK            | SA           | A                   | C                  | C                  | CCL          | CM            |                   |                   | TP-07         |
|           |              |   |                 |      |       |               |              |                     |                    |                    | COF          | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:  | AFWF 1C to SG 1A Chemical Addition Check Valves |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09828 | 8770 G 080-5 | D-3   | 3               | C    | 0.5   | CK            | SA           | A                   | C                  | C                  | CO           | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:  | MFIV Accumulator 1A Outboard Inlet Ck Vlv       |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09829 | 8770 G 080-5 | D-3   | 3               | C    | 0.5   | CK            | SA           | A                   | C                  | C                  | CC           | CM            |                   |                   | TP-07         |
|           |              |   |                 |      |       |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:  | MFIV Accumulator 1A Inboard Inlet Ck Vlv        |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09831 | 8770 G 080-5 | B-2   | 3               | B    | 1     | 3W            | AO           | A                   | Vent               | Flow               | SE           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | HCV-09-7 Actuator "A" Train Open Pilot Vlv      |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09832 | 8770 G 080-5 | B-3   | 3               | B    | 1     | 3W            | AO           | A                   | Vent               | Flow               | SE           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | HCV-09-7 Actuator "B" Train Open Pilot Vlv      |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09833 | 8770 G 080-5 | B-4   | 3               | B    | 1     | 3W            | AO           | A                   | Vent               | Flow               | SE           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | HCV-09-7 Actuator "A" Train Close Pilot Vlv     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09834 | 8770 G 080-5 | B-4   | 3               | B    | 1     | 3W            | AO           | A                   | Vent               | Flow               | SE           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | HCV-09-7 Actuator "B" Train Close Pilot Vlv     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09855 | 8770 G 080-5 | H-3   | 3               | C    | 0.5   | CK            | SA           | A                   | C                  | C                  | CC           | CM            |                   |                   | TP-07         |
|           |              |   |                 |      |       |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:  | MFIV Accumulator 1B Outboard Inlet Ck Vlv       |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09856 | 8770 G 080-5 | H-3   | 3               | C    | 0.5   | CK            | SA           | A                   | C                  | C                  | CC           | CM            |                   |                   | TP-07         |
|           |              |   |                 |      |       |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:  | MFIV Accumulator 1B Inboard Inlet Ck Vlv        |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09861 | 8770 G 080-5 | F-2   | 3               | B    | 1     | 3W            | AO           | A                   | Vent               | Flow               | SE           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | HCV-09-8 Actuator "A" Train Open Pilot Vlv      |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09862 | 8770 G 080-5 | F-3   | 3               | B    | 1     | 3W            | AO           | A                   | Vent               | Flow               | SE           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | HCV-09-8 Actuator "B" Train Open Pilot Vlv      |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09863 | 8770 G 080-5 | F-4   | 3               | B    | 1     | 3W            | AO           | A                   | Vent               | Flow               | SE           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | HCV-09-8 Actuator "A" Train Close Pilot Vlv     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-09864 | 8770 G 080-5 | F-4   | 3               | B    | 1     | 3W            | AO           | A                   | Vent               | Flow               | SE           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | HCV-09-8 Actuator "B" Train Close Pilot Vlv     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag | P&ID         | P&ID<br>Coord.                                 | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-----------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|-----------------------|
| 1-V-12174 | 8770 G 080-4 | C-2  | 3               | C    | 8    | CK            | SA           | A                   | C                  | O                  | CCD<br>COD   | CM.<br>CM     |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:  | 1C AFW Pump Suction Check Valve From CST       |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-12175 | 8770 G 080-4 | B-2  | 3               | B    | 8    | GA            | M            | A                   | LC                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:  | Unit 1/2 CST/AFW Suction Cross Connect Valves  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-12177 | 8770 G 080-4 | B-2  | 3               | B    | 8    | GA            | M            | A                   | LC                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:  | Unit 1/2 CST/AFW Suction Cross Connect Valves  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-12497 | 8770 G 080-4 | C-1  | 3               | B    | 8    | GL            | M            | A                   | LO                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:  | Condensate Storage Tank Outlet Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-12506 | 8770 G 080-4 | C-1  | 3               | B    | 8    | GL            | M            | A                   | LO                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:  | Condensate Storage Tank Outlet Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |



| Valve Tag   | P&ID       | P&ID<br>Coord.                                  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type        | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.             |
|-------------|------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|---------------------|----------------|-------------------|-------------------|---------------------------|
| 1-FCV-25-1  | 8770 G 878 | C-2   | 2               | B    | 48   | BTF           | PO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C  | M3<br>Y2<br>M3 |                   |                   | TP-03, TP-10<br><br>TP-10 |
| Valve Name: |            | Containment Purge Isolation Valve               |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                           |
| 1-FCV-25-11 | 8770 G 879 | H-14  | 2               | B    | 24   | BTF           | MO           | A                   | C                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                           |
| Valve Name: |            | A SBVS Cooling Air Isolation Valves             |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                           |
| 1-FCV-25-12 | 8770 G 879 | J-14  | 2               | B    | 24   | BTF           | MO           | A                   | C                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                           |
| Valve Name: |            | B SBVS Cooling Air Isolation Valves             |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                           |
| 1-FCV-25-13 | 8770 G 879 | I-16  | 2               | B    | 12   | BTF           | MO           | A                   | O                  | O                  | PIT<br>ST-O         | Y2<br>M3       |                   |                   |                           |
| Valve Name: |            | SBVS Cross Connect Valve                        |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                           |
| 1-FCV-25-14 | 8770 G 879 | E-11  | 3               | B    | 12   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                           |
| Valve Name: |            | Control Room Outside Air Intake Isolation Valve |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                           |
| 1-FCV-25-15 | 8770 G 879 | E-11  | 3               | B    | 12   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                           |
| Valve Name: |            | Control Room Outside Air Intake Isolation Valve |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                           |
| 1-FCV-25-16 | 8770 G 879 | E-10  | 3               | B    | 12   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                           |
| Valve Name: |            | Control Room Outside Air Intake Isolation Valve |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                           |
| 1-FCV-25-17 | 8770 G 879 | E-11  | 3               | B    | 12   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                           |
| Valve Name: |            | Control Room Outside Air Intake Isolation Valve |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                           |



[illegible]



| Valve Tag   | P&ID       | P&ID<br>Coor.   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type                       | Test<br>Freq.                 | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.                  |
|-------------|------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|------------------------------------|-------------------------------|-------------------|-------------------|--------------------------------|
| 1-FCV-25-6  | 8770 G 878 | C-8   | 2               | B    | 48   | BTF           | PO           | A                   | LC                 | C                  | FSC<br>PIT<br>ST-C                 | M3<br>Y2<br>M3                |                   |                   | TP-03, TP-10<br><br>TP-10      |
| Valve Name: |            | Containment Purge Isolation Valve                               |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |
| 1-FCV-25-7  | 8770 G 878 | C-15  | 2               | A    | 24   | BTF           | AO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03                          |
| Valve Name: |            | Containment Vacuum Relief Isolation Valve                       |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |
| 1-FCV-25-8  | 8770 G 878 | C-15  | 2               | A    | 24   | BTF           | AO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03                          |
| Valve Name: |            | Containment Vacuum Relief Isolation Valve                       |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |
| 1-V-25011   | 8770 G 878 | N-7   | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J                               | App J                         |                   |                   |                                |
| Valve Name: |            | Isolation for Containment H2 Purge Make up Air (Pen P 56)       |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |
| 1-V-25013   | 8770 G 878 | K-7   | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J                               | App J                         |                   |                   |                                |
| Valve Name: |            | Isolation for Containment H2 Purge Exhaust Thru HVE 7 (P 57)    |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |
| 1-V-25015   | 8770 G 878 | N-7   | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J                               | App J                         |                   |                   |                                |
| Valve Name: |            | Isolation for Cntmnt H2 Purge Exhaust Bypass HVE 7 (P 58)       |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |
| 1-V-25-12   | 8770 G 878 | N-8   | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J                               | App J                         |                   |                   |                                |
| Valve Name: |            | Containment Isolation Valve for H2 Purge Make up. (Pen P 56)    |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |
| 1-V-25-14   | 8770 G 878 | K-8   | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J                               | App J                         |                   |                   |                                |
| Valve Name: |            | Containment Isolation Valve for H2 Purge Exhaust. (Pen P 57)    |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |
| 1-V-25-16   | 8770 G 878 | M-8   | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J                               | App J                         |                   |                   |                                |
| Valve Name: |            | Containment Isolation Valve for H2 Purge Exhaust Bypass. (P 58) |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |
| 1-V-25-20   | 8770 G 878 | C-14  | 2               | A/C  | 24   | CK            | SA           | A                   | C                  | O                  | CC<br>CO<br>LT-J<br>VAC            | CM<br>CM<br>App J<br>CM       |                   |                   | TP-01, TP-07<br>TP-07<br>TP-07 |
| Valve Name: |            | Containment Vacuum Relief Check Valve                           |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                                |



| Valve Tag | P&ID        | P&ID<br>Coor.                         | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|-------------|---------------------------------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-V-25-21 | 8770 G 878  | C-14                                  | 2               | A/C  | 24   | CK            | SA           | A                   | C                  | O                  | CC           | CM            |                   |                   | TP-01, TP-07  |
|           |             |                                       |                 |      |      |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
|           |             |                                       |                 |      |      |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|           |             |                                       |                 |      |      |               |              |                     |                    |                    | VAC          | CM            |                   |                   | TP-07         |
|           | Valve Name: | Containment Vacuum Relief Check Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-25-23 | 8770 G 879  | J-14                                  | 2               | C    | 24   | CK            | SA           | A                   | C                  | O/C                | CCD          | CM            |                   |                   | TP-07         |
|           |             |                                       |                 |      |      |               |              |                     |                    |                    | COF          | CM            |                   |                   | TP-07         |
|           | Valve Name: | 1B SBVS Cooling Air Check Valve       |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-25-24 | 8770 G 879  | H-14                                  | 2               | C    | 24   | CK            | SA           | A                   | C                  | O/C                | CCD          | CM            |                   |                   | TP-07         |
|           |             |                                       |                 |      |      |               |              |                     |                    |                    | COF          | CM            |                   |                   | TP-07         |
|           | Valve Name: | 1A SBVS Cooling Air Check Valve       |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



| Valve Tag | P&ID          | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|---------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-V-18295 | 8770 G 085-2A | G-2   | 2               | C    | 0.75 | CK            | SA           | A                   | C                  | C                  | CCL          | CM            |                   |                   | TP-07         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | COF          | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:   | Ck Viv for Inst Air to Air Accumulator for Vacuum Relief FCV-25-8 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-18695 | 8770 G 085-3  | B-2   | 3               | C    | 1    | CK            | SA           | A                   | O                  | C                  | CCL          | CM            |                   |                   | TP-07         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | COF          | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:   | Check Valve for Instrument Air Supply to MSIV Accumulators        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-18696 | 8770 G 085-3  | B-2   | 3               | C    | 1    | CK            | SA           | A                   | O                  | C                  | CCL          | CM            |                   |                   | TP-07         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | COF          | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:   | Check Valve for Instrument Air Supply to MSIV Accumulators        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-18699 | 8770 G 085-3  | B-5   | 3               | C    | 1    | CK            | SA           | A                   | O                  | C                  | CCL          | CM            |                   |                   | TP-07         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | COF          | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:   | Check Valve for Instrument Air Supply to MSIV Accumulators        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



| Valve Tag   | P&ID         | P&ID<br>Coord.                                   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-TCV-14-4A | 8770 G 082-2 | A-5  | 3               | B    | 30   | BTF           | PO           | A                   | O                  | O                  | FSO          | M3            |                   |                   | TP-03         |
|             | Valve Name:  | 1A CCW Heat Exchanger Temperature Control Valve  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-TCV-14-4B | 8770 G 082-2 | A-6  | 3               | B    | 30   | BTF           | PO           | A                   | O                  | O                  | FSO          | M3            |                   |                   | TP-03         |
|             | Valve Name:  | 1B CCW Heat Exchanger Temperature Control Valve  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-21162   | 8770 G 082-2 | G-5  | 3               | C    | 30   | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   |               |
|             | Valve Name:  | 1A ICW Pump Discharge Check Valve                |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-21205   | 8770 G 082-2 | G-6  | 3               | C    | 30   | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   |               |
|             | Valve Name:  | 1C ICW Pump Discharge Check Valve                |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-21208   | 8770 G 082-2 | G-7  | 3               | C    | 30   | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   |               |
|             | Valve Name:  | 1B ICW Pump Discharge Check Valve                |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-21402   | 8770 G 082-2 | D-4  | 3               | C    | 2    | CK            | SA           | A                   | O                  | O                  | CC           | CM            |                   |                   | TP-01, TP-07  |
|             | Valve Name:  | Check Valves for Vacuum Breaker on the 1A CCW Hx |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-21403   | 8770 G 082-2 | D-8  | 3               | C    | 2    | CK            | SA           | A                   | O                  | O                  | CC           | CM            |                   |                   | TP-01, TP-07  |
|             | Valve Name:  | Check Valves for Vacuum Breaker on the 1B CCW Hx |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



### Main Steam (MS)

| Valve Tag   | P&ID         | P&ID  | Safety | Coor. | Class | Cat.   | Size | Valve Type | Act. Type | Active / Passive | Normal Position | Safety Position | Test Type | Test Freq. | Relief Request | Deferred Just. | Tech. Pos. |
|-------------|--------------|---|--------|-------|-------|--------|------|------------|-----------|------------------|-----------------|-----------------|-----------|------------|----------------|----------------|------------|
| 1-HCV-08-1A | 8770 G 079-1 | B-6   | 2      | B/C   | 34    | PCHECK | AO   | A          | O         | C                | PIT             | Y2              | ST-C      | CS         |                | CS-09          |            |
| Valve Name: |              | 1A Main Steam Isolation Valve (MSIV)            |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| 1-HCV-08-1B | 8770 G 079-1 | E-6   | 2      | B/C   | 34    | PCHECK | AO   | A          | O         | C                | PIT             | Y2              | ST-C      | CS         |                | CS-09          |            |
| Valve Name: |              | 1B Main Steam Isolation Valve (MSIV)            |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| 1-HCV-08-2A | 8770 G 079-1 | B-4   | 2      | B     | 6     | ANG    | AO   | A          | C         | C                | FSC             | M3              | PIT       | Y2         |                |                | TP-03      |
|             |              | ST-C M3   |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
|             |              | ST-O M3   |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| Valve Name: |              | 1A Main Steamline Atmospheric Dump Valve        |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| 1-HCV-08-2B | 8770 G 079-1 | E-4   | 2      | B     | 6     | ANG    | AO   | A          | C         | C                | FSC             | M3              | PIT       | Y2         |                |                | TP-03      |
|             |              | ST-C M3   |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
|             |              | ST-O M3   |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| Valve Name: |              | 1B Main Steamline Atmospheric Dump Valve        |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| 1-MV-08-13  | 8770 G 079-1 | H-4   | 2      | B     | 3     | GA     | MO   | A          | C         | O/C              | PIT             | Y2              | ST-C      | M3         |                |                |            |
|             |              | ST-O M3   |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| Valve Name: |              | AFW Pump Turbine Steam Supply Valve from 1A S/G |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| 1-MV-08-14  | 8770 G 079-1 | H-3   | 2      | B     | 3     | GA     | MO   | A          | C         | O/C              | PIT             | Y2              | ST-C      | M3         |                |                |            |
|             |              | ST-O M3   |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| Valve Name: |              | AFW Pump Turbine Steam Supply Valve from 1B S/G |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| 1-MV-08-1A  | 8770 G 079-1 | B-6   | 2      | B     | 3     | GL     | MO   | A          | C         | C                | PIT             | Y2              | ST-C      | M3         |                |                |            |
| Valve Name: |              | 1A MSIV Bypass Valve                            |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| 1-MV-08-1B  | 8770 G 079-1 | E-6   | 2      | B     | 3     | GL     | MO   | A          | C         | C                | PIT             | Y2              | ST-C      | M3         |                |                |            |
| Valve Name: |              | 1B MSIV Bypass Valve                            |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |
| 1-MV-08-3   | 8770 G 079-1 | G-6   | 2      | B     | 4     | GA     | MO   | A          | C         | O                | PIT             | Y2              | ST-O      | M3         |                |                | TP-09      |
| Valve Name: |              | 1C AFW Turbine Trip Throttle Valve              |        |       |       |        |      |            |           |                  |                 |                 |           |            |                |                |            |



| Valve Tag   | P&ID         | P&ID<br>Coord.                               | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-RD-08-1A1 | 8770 G 079-7 | D-3  | 3               | C    | 2    | RPD           | SA           | A                   | C                  | O                  | DT           | Y5            |                   |                   |               |
|             | Valve Name:  | MSIV Pneumatic Operating System Rupture Disc |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-RD-08-1A2 | 8770 G 079-7 | D-2  | 3               | C    | 2    | RPD           | SA           | A                   | C                  | O                  | DT           | Y5            |                   |                   |               |
|             | Valve Name:  | MSIV Pneumatic Operating System Rupture Disc |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-RD-08-1A3 | 8770 G 079-7 | D-2  | 3               | C    | 2    | RPD           | SA           | A                   | C                  | O                  | DT           | Y5            |                   |                   |               |
|             | Valve Name:  | MSIV Pneumatic Operating System Rupture Disc |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-RD-08-1B1 | 8770 G 079-7 | G-3  | 3               | C    | 2    | RPD           | SA           | A                   | C                  | O                  | DT           | Y5            |                   |                   |               |
|             | Valve Name:  | MSIV Pneumatic Operating System Rupture Disc |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-RD-08-1B2 | 8770 G 079-7 | H-2  | 3               | C    | 2    | RPD           | SA           | A                   | C                  | O                  | DT           | Y5            |                   |                   |               |
|             | Valve Name:  | MSIV Pneumatic Operating System Rupture Disc |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-RD-08-1B3 | 8770 G 079-7 | H-2  | 3               | C    | 2    | RPD           | SA           | A                   | C                  | O                  | DT           | Y5            |                   |                   |               |
|             | Valve Name:  | MSIV Pneumatic Operating System Rupture Disc |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-08-1A1 | 8770 G 079-7 | C-4  | 3               | B    | 1    | 3W            | SO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |              |  |                 |      |      |               |              |                     |                    |                    | SD           | CS            |                   |                   | TP-09         |
|             | Valve Name:  | MSIV HCV-08-1A Open Control Valve            |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-08-1A2 | 8770 G 079-7 | D-4  | 3               | B    | 1    | 3W            | SO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |              |  |                 |      |      |               |              |                     |                    |                    | SD           | CS            |                   |                   | TP-09         |
|             | Valve Name:  | MSIV HCV-08-1A Open Control Valve            |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-08-1A3 | 8770 G 079-7 | A-4  | 3               | B    | 1    | 3W            | SO           | A                   | Vent               | Flow               | FSS          | CS            |                   |                   | TP-03, TP-09  |
|             |              |  |                 |      |      |               |              |                     |                    |                    | SD           | CS            |                   |                   | TP-09         |
|             | Valve Name:  | MSIV HCV-08-1A Close Control Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-08-1A4 | 8770 G 079-7 | B-5  | 3               | B    | 1    | 3W            | SO           | A                   | Vent               | Flow               | FSS          | CS            |                   |                   | TP-03, TP-09  |
|             |              |  |                 |      |      |               |              |                     |                    |                    | SD           | CS            |                   |                   | TP-09         |
|             | Valve Name:  | MSIV HCV-08-1A Close Control Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-08-1B1 | 8770 G 079-7 | G-4  | 3               | B    | 1    | 3W            | SO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |              |  |                 |      |      |               |              |                     |                    |                    | SD           | CS            |                   |                   | TP-09         |
|             | Valve Name:  | MSIV HCV-08-1B Open Control Valve            |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SE-08-1B2 | 8770 G 079-7 | G-4  | 3               | B    | 1    | 3W            | SO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |              |  |                 |      |      |               |              |                     |                    |                    | SD           | CS            |                   |                   | TP-09         |
|             | Valve Name:  | MSIV HCV-08-1B Open Control Valve            |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



| Valve Tag | P&ID         | P&ID   | Safety | Coord. | Class | Cat. | Size | Valve | Act. | Active / | Normal   | Safety   | Test | Relief | Deferred | Tech. |              |
|-----------|--------------|--|--------|--------|-------|------|------|-------|------|----------|----------|----------|------|--------|----------|-------|--------------|
|           |              |  |        |        |       |      |      | Type  | Type | Passive  | Position | Position | Type | Freq.  | Request  | Just. | Pos.         |
| 1-V-08373 | 8770 G 079-1 | F-4  | 2      | C      | 0.75  | CK   | SA   | A     | O    | C        | CCL      | CM       |      |        |          |       | TP-07        |
|           |              |  |        |        |       |      |      |       |      |          |          | COF      | CM   |        |          |       | TP-01, TP-07 |
|           | Valve Name:  | AFW Steam Supply Bypass Check Valve for MV-08-13 |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-08384 | 8770 G 079-1 | H-4  | 2      | B      | 0.75  | GL   | M    | A     | O    | C        | ME       | Y2       |      |        |          |       | TP-04        |
|           | Valve Name:  | 1C AFW Pump Steam Supply Valve MV-08 14 Bypass   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-08387 | 8770 G 079-1 | F-4  | 2      | B      | 0.75  | GL   | M    | A     | O    | C        | ME       | Y2       |      |        |          |       | TP-04        |
|           | Valve Name:  | 1C AFW Pump Steam Supply Valve MV-08 13 Bypass   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8201  | 8770 G 079-1 | B-5  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8202  | 8770 G 079-1 | B-5  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8203  | 8770 G 079-1 | B-5  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8204  | 8770 G 079-1 | B-5  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8205  | 8770 G 079-1 | E-5  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8206  | 8770 G 079-1 | D-5  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8207  | 8770 G 079-1 | E-5  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8208  | 8770 G 079-1 | D-5  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8209  | 8770 G 079-1 | B-5  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8210  | 8770 G 079-1 | B-6  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |
| 1-V-8211  | 8770 G 079-1 | B-6  | 2      | C      | 6     | SV   | SA   | A     | C    | O/C      | RVT      | Y5       |      |        |          |       |              |
|           | Valve Name:  | Main Steam Safety/Relief Valve                   |        |        |       |      |      |       |      |          |          |          |      |        |          |       |              |



### Main Steam (MS)

| Valve Tag | P&ID         | P&ID<br>Coord.                 | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|--------------|--------------------------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-V-8212  | 8770 G 079-1 | B-6                            | 2               | C    | 6    | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety/Relief Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-8213  | 8770 G 079-1 | E-5                            | 2               | C    | 6    | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety/Relief Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-8214  | 8770 G 079-1 | D-6                            | 2               | C    | 6    | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety/Relief Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-8215  | 8770 G 079-1 | E-6                            | 2               | C    | 6    | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety/Relief Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-8216  | 8770 G 079-1 | D-6                            | 2               | C    | 6    | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety/Relief Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



[illegible]



| Valve Tag   | P&ID         | P&ID<br>Coord.   | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type                       | Test<br>Freq.                 | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.  |
|-------------|--------------|--|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|------------------------------------|-------------------------------|-------------------|-------------------|----------------|
| 1-FSE-27-5  | 8770 G 092-1 | B-7  | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03          |
| Valve Name: |              | H2 Analyzer B Dome Sample Solenoid Vlv                         |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                |
| 1-FSE-27-6  | 8770 G 092-1 | A-7  | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03          |
| Valve Name: |              | H2 Analyzer B RCP 1B2 Sample Solenoid Vlv                      |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                |
| 1-FSE-27-7  | 8770 G 092-1 | A-7  | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03          |
| Valve Name: |              | H2 Analyzer B RCP 1B1 Sample Solenoid Vlv                      |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                |
| 1-FSE-27-8  | 8770 G 092-1 | B-6  | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03          |
| Valve Name: |              | H2 Analyzer A Inlet CIV Solenoid Vlv                           |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                |
| 1-FSE-27-9  | 8770 G 092-1 | B-6  | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03          |
| Valve Name: |              | H2 Analyzer B Inlet CIV Solenoid Vlv                           |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                |
| 1-V-27101   | 8770 G 092-1 | B-6  | 2               | A/C  | 0.375 | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-J                   | CM<br>CM<br>App J             |                   |                   | TP-07<br>TP-07 |
| Valve Name: |              | Containment Isolation Check Valve for the 1A Hydrogen Analyzer |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                |



| Valve Tag | P&ID         | P&ID<br>Coord.   | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-----------|--------------|--|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|-----------------------|
| 1-V-27102 | 8770 G 092-1 | B-6  | 2               | A/C  | 0.375 | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | CM<br>CM      | LT-J<br>App J     |                   | TP-07<br>TP-07        |
|           | Valve Name:  | Containment Isolation Check Valve for the 1B Hydrogen Analyzer |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-27105 | 8770 G 092-1 | C-6  | 2               | C    | 0.375 | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:  | Check Valve for the 1A Hydrogen Analyzer                       |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-27110 | 8770 G 092-1 | C-6  | 2               | C    | 0.375 | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:  | Check Valve for the 1B Hydrogen Analyzer                       |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-29213 | 8770 G 092-1 | F-5  | 2               | B    | 0.25  | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:  | H2 Analyzer B Reagent Supply Check Viv                         |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 1-V-29217 | 8770 G 092-1 | E-5  | 2               | B    | 0.25  | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:  | H2 Analyzer A Reagent Supply Check Viv                         |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |



[illegible]



[illegible]



| Valve Tag | P&ID            | P&ID<br>Coord. | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type                               | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|-----------------|----------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--|---------------|-------------------|-------------------|---------------|
| 1-V-1442  | 8770 G 078-110A | G-1            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC  | CS            |                   | CS-02             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Reactor Coolant Gas Vent Valve |               |                   |                   |               |
| 1-V-1443  | 8770 G 078-110A | D-2            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC  | CS            |                   | CS-02             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Reactor Coolant Gas Vent Valve |               |                   |                   |               |
| 1-V-1444  | 8770 G 078-110A | D-2            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC  | CS            |                   | CS-02             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Reactor Coolant Gas Vent Valve |               |                   |                   |               |
| 1-V-1445  | 8770 G 078-110A | E-1            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC  | CS            |                   | CS-02             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Reactor Coolant Gas Vent Valve |               |                   |                   |               |
| 1-V-1446  | 8770 G 078-110A | E-1            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC  | CS            |                   | CS-02             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Reactor Coolant Gas Vent Valve |               |                   |                   |               |
| 1-V-1449  | 8770 G 078-110A | G-2            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC  | CS            |                   | CS-02             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O                                       | CS            | CS-02             |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Reactor Coolant Gas Vent Valve |               |                   |                   |               |



| Valve Tag  | P&ID          | Safety<br>Coord.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|------------|---------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-SH-18797 | 8770 G 085-1A | F-2   | 2               | A    | 1    | BAL           | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|            | Valve Name:   | Containment Isolation Valve (Inner) for Service Air Supply to RCB |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-SH-18798 | 8770 G 085-1A | E-2   | 2               | A    | 1    | BAL           | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|            | Valve Name:   | Containment Isolation Valve (Outer) for Service Air Supply to RCB |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-18794  | 8770 G 085-1A | F-4   | 2               | A    | 2    | GL            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|            | Valve Name:   | Isolation Valve (Outer) for Service Air Supply to RCB (Pen P 8)   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-18796  | 8770 G 085-1A | F-4   | 2               | A    | 2    | GL            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|            | Valve Name:   | Isolation Valve (Inner) for Service Air Supply to RCB (Pen P 8)   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag   | P&ID           | P&ID<br>Coord.   | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.           | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|----------------|--|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|-------------------------|-------------------|-------------------|---------------|
| 1-V-5200    | 8770 G 078-150 | B-2  | 2               | A    | 0.375 | GL            | AO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | Isolation Valve from RCS Hot Leg Loop A to the Sample System   |                 |      |       |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 1-V-5201    | 8770 G 078-150 | C-2  | 2               | A    | 0.375 | GL            | AO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | Isolation from the Pressurizer Surge Line to the Sample System |                 |      |       |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 1-V-5202    | 8770 G 078-150 | D-2  | 2               | A    | 0.375 | GL            | AO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | Isolation from the Pzr Steam Space to the Sample System        |                 |      |       |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 1-V-5203    | 8770 G 078-150 | B-2  | 2               | A    | 0.375 | GL            | AO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | Isolation Valve from RCS Hot Leg Loop A to the Sample System   |                 |      |       |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 1-V-5204    | 8770 G 078-150 | C-2  | 2               | A    | 0.375 | GL            | AO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | Isolation from the Pressurizer Surge Line to the Sample System |                 |      |       |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 1-V-5205    | 8770 G 078-150 | D-2  | 2               | A    | 0.375 | GL            | AO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | Isolation Valve from the Pressurizer Steam Space to the Sample |                 |      |       |               |              |                     |                    |                    |                            |                         |                   |                   |               |



[illegible]



[illegible]



[illegible]



[illegible]



| Valve Tag   | P&ID            | P&ID   | Safety | Coord. | Class   | Cat. | Size | Valve Type | Act. Type | Active / Passive | Normal Position | Safety Position | Test Type | Test Freq. | Relief Request | Deferred Just. | Tech. Pos.            |
|-------------|-----------------|--|--------|--------|---------|------|------|------------|-----------|------------------|-----------------|-----------------|-----------|------------|----------------|----------------|-----------------------|
| 1-MV-07-2B  | 8770 G 088-2    | H-3  | 2      | B      | 24      | BTF  | MO   | A          | C         | O/C              | PIT             | Y2              | ST-C      | M3         | ST-O           | M3             |                       |
| Valve Name: |                 | 'B' Train SI Pump Containment Sump Suction Valve           |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-SR-07-1A  | 8770 G 078-130B | F-2  | 2      | C      | 1.5x2.5 | RV   | SA   | A          | C         | O/C              | RVT             | Y10             |           |            |                |                |                       |
| Valve Name: |                 | A Train Safety Injection Pumps Suction Header Relief Valve |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-SR-07-1B  | 8770 G 078-130B | G-2  | 2      | C      | 1.5x2.5 | RV   | SA   | A          | C         | O/C              | RVT             | Y10             |           |            |                |                |                       |
| Valve Name: |                 | B Train Safety Injection Pumps Suction Header Relief Valve |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-03920   | 8770 G 078-130B | B-4  | 3      | B      | 2       | GL   | M    | A          | C         | O/C              | ME              | Y2              |           |            |                |                | TP-04                 |
| Valve Name: |                 | Isolation Valve For SIT Outlet Drain to VCT                |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-07000   | 8770 G 078-130B | F-2  | 2      | C      | 14      | CK   | SA   | A          | C         | O                | CC              | CM              | CO        | CM         |                |                | TP-01, TP-07<br>TP-07 |
| Valve Name: |                 | 1A LPSI Pump Suction Check Valve                           |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-07001   | 8770 G 078-130B | G-2  | 2      | C      | 14      | CK   | SA   | A          | C         | O                | CC              | CM              | CO        | CM         |                |                | TP-01, TP-07<br>TP-07 |
| Valve Name: |                 | 1B LPSI Pump Suction Check Valves                          |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-07009   | 8770 G 078-130B | A-4  | 2      | A      | 2       | GA   | M    | A          | LC        | O/C              | LT-J            | App J           | ME        | Y2         |                |                | TP-04                 |
| Valve Name: |                 | SI Tank Drain/Test Line to RWT (P 41)                      |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-07172   | 8770 G 088-2    | H-2  | 2      | C      | 24      | CK   | SA   | A          | C         | O/C              | CC              | CM              | CO        | CM         |                |                | TP-01, TP-07<br>TP-07 |
| Valve Name: |                 | 1B SI Pump Containment Sump Suction Check Valve            |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-07174   | 8770 G 088-2    | G-2  | 2      | C      | 24      | CK   | SA   | A          | C         | O/C              | CC              | CM              | CO        | CM         |                |                | TP-01, TP-07<br>TP-07 |
| Valve Name: |                 | 1A SI Pump Containment Sump Suction Check Valve            |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3101    | 8770 G 078-130A | B-4  | 2      | C      | 2       | CK   | SA   | A          | C         | O                | CC              | CM              | CO        | CM         |                |                | TP-01, TP-07<br>TP-07 |
| Valve Name: |                 | 1A HPSI Minimum Flow CV                                    |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3103    | 8770 G 078-130A | F-4  | 2      | C      | 2       | CK   | SA   | A          | C         | O                | CC              | CM              | CO        | CM         |                |                | TP-01, TP-07<br>TP-07 |
| Valve Name: |                 | 1B HPSI Minimum Flow CV                                    |        |        |         |      |      |            |           |                  |                 |                 |           |            |                |                |                       |



| Valve Tag   | P&ID            | Safety<br>Coord.                        | Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type     | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.  |
|-------------|-----------------|---|-------|------|------|---------------|--------------|---------------------|--------------------|--------------------|------------------|----------------|-------------------|-------------------|----------------|
| 1-V-3104    | 8770 G 078-130B | F-4                                     | 2     | C    | 2    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO         | CM<br>CM       |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | 1A LPSI Minimum Flow Check Valve        |       |      |      |               |              |                     |                    |                    |                  |                |                   |                   |                |
| 1-V-3105    | 8770 G 078-130B | F-4                                     | 2     | C    | 2    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO         | CM<br>CM       |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | 1B LPSI Minimum Flow Check Valve        |       |      |      |               |              |                     |                    |                    |                  |                |                   |                   |                |
| 1-V-3106    | 8770 G 078-130B | F-4                                     | 2     | C    | 10   | CK            | SA           | A                   | C                  | O/C                | CC<br>CO         | CM<br>CM       |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | 1A LPSI Pump Discharge Check Valve      |       |      |      |               |              |                     |                    |                    |                  |                |                   |                   |                |
| 1-V-3107    | 8770 G 078-130B | G-4                                     | 2     | C    | 10   | CK            | SA           | A                   | C                  | O/C                | CC<br>CO         | CM<br>CM       |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | 1B LPSI Pump Discharge Check Valve      |       |      |      |               |              |                     |                    |                    |                  |                |                   |                   |                |
| 1-V-3113    | 8770 G 078-131A | B-3                                     | 1     | A/C  | 2    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | HPSI 1A2 Cold Leg Injection Check Valve |       |      |      |               |              |                     |                    |                    |                  |                |                   |                   |                |
| 1-V-3114    | 8770 G 078-131A | A-3                                     | 1     | A/C  | 6    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | LPSI 1A2 Cold Leg Injection Check Valve |       |      |      |               |              |                     |                    |                    |                  |                |                   |                   |                |
| 1-V-3123    | 8770 G 078-131A | C-3                                     | 1     | A/C  | 2    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | HPSI 1A1 Cold Leg Injection Check Valve |       |      |      |               |              |                     |                    |                    |                  |                |                   |                   |                |
| 1-V-3124    | 8770 G 078-131A | C-3                                     | 1     | A/C  | 6    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | LPSI 1A1 Cold Leg Injection Check Valve |       |      |      |               |              |                     |                    |                    |                  |                |                   |                   |                |
| 1-V-3133    | 8770 G 078-131A | F-3                                     | 1     | A/C  | 2    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | HPSI 1B1 Cold Leg Injection Check Valve |       |      |      |               |              |                     |                    |                    |                  |                |                   |                   |                |



| Valve Tag   | P&ID            | P&ID<br>Coord.                                  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type        | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.  |
|-------------|-----------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|---------------------|----------------|-------------------|-------------------|----------------|
| 1-V-3134    | 8770 G 078-131A | E-3   | 1               | A/C  | 6    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S    | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | LPSI 1B1 Cold Leg Injection Check Valve         |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                |
| 1-V-3143    | 8770 G 078-131A | H-3   | 1               | A/C  | 2    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S    | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | HPSI 1B2 Cold Leg Injection Check Valve         |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                |
| 1-V-3144    | 8770 G 078-131A | G-3   | 1               | A/C  | 6    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S    | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | LPSI 1B2 Cold Leg Injection Check Valve         |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                |
| 1-V-3206    | 8770 G 078-130B | F-4   | 2               | B    | 10   | GA            | MO           | A                   | LO                 | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                |
| Valve Name: |                 | 1A LPSI Pump Discharge Valve                    |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                |
| 1-V-3207    | 8770 G 078-130B | G-4   | 2               | B    | 10   | GA            | MO           | A                   | LO                 | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                |
| Valve Name: |                 | 1B LPSI Pump Discharge Valve                    |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                |
| 1-V-3211    | 8770 G 078-131B | A-6   | 2               | C    | 1x1  | RV            | SA           | A                   | C                  | O/C                | RVT                 | Y10            |                   |                   |                |
| Valve Name: |                 | 1A2 Safety Injection Tank Relief Valve          |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                |
| 1-V-3215    | 8770 G 078-131B | C-6   | 2               | A/C  | 12   | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S    | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | 1A2 Safety Injection Tank Discharge Check Valve |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                |
| 1-V-3217    | 8770 G 078-131B | E-7   | 1               | A/C  | 12   | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S    | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07 |
| Valve Name: |                 | 1A2 SI Header Inboard Check Valve               |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                |
| 1-V-3221    | 8770 G 078-131B | A-3   | 2               | C    | 1x1  | RV            | SA           | A                   | C                  | O/C                | RVT                 | Y10            |                   |                   |                |
| Valve Name: |                 | 1A1 Safety Injection Tank Relief Valve          |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                |



[illegible]



### Safety Injection (SI)

| Valve Tag | P&ID            | P&ID  | Safety | Coor. | Class | Cat. | Size | Valve Type | Act. Type | Active / Passive | Normal Position | Safety Position | Test Type | Test Freq. | Relief Request | Deferred Just. | Tech. Pos.            |
|-----------|-----------------|---|--------|-------|-------|------|------|------------|-----------|------------------|-----------------|-----------------|-----------|------------|----------------|----------------|-----------------------|
| 1-V-3410  | 8770 G 078-130A | G-2   | 2      | C     | 8     | CK   | SA   | A          | C         | O                | CC              | CM              | CO        | CM         |                |                | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | 1B HPSI Pump Suction Check Valve                  |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3412  | 8770 G 078-130A | F-6   | 2      | C     | 1     | RV   | SA   | A          | C         | O/C              | RVT             | Y10             |           |            |                |                | TP-08                 |
|           | Valve Name:     | HPSI Relief Valve                                 |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3414  | 8770 G 078-130A | G-4   | 2      | C     | 3     | CK   | SA   | A          | C         | O/C              | CC              | CM              | CO        | CM         |                |                | TP-07<br>TP-07        |
|           | Valve Name:     | 1B HPSI Pump Discharge Stop Check Valve           |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3417  | 8770 G 078-130A | C-6   | 2      | C     | 1     | RV   | SA   | A          | C         | O/C              | RVT             | Y10             |           |            |                |                |                       |
|           | Valve Name:     | HPSI Relief Valves                                |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3427  | 8770 G 078-130A | C-4   | 2      | C     | 3     | CK   | SA   | A          | C         | O/C              | CC              | CM              | CO        | CM         |                |                | TP-07<br>TP-07        |
|           | Valve Name:     | 1A HPSI Pump Discharge Stop Check Valve           |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3430  | 8770 G 078-130A | F-2   | 2      | C     | 1     | RV   | SA   | A          | C         | O/C              | RVT             | Y10             |           |            |                |                | TP-08                 |
|           | Valve Name:     | 1B Shutdown Cooling Heat Exchanger Relief Valve   |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3431  | 8770 G 078-130A | B-2   | 2      | C     | 1     | RV   | SA   | A          | C         | O/C              | RVT             | Y10             |           |            |                |                | TP-08                 |
|           | Valve Name:     | 1A Shutdown Cooling Heat Exchanger Relief Valve   |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3432  | 8770 G 078-130B | G-2   | 2      | B     | 14    | GA   | MO   | A          | LO        | O/C              | PIT             | Y2              | ST-C      | M3         |                |                | TP-11                 |
|           | Valve Name:     | 1B LPSI Pump Suction Isolation Valve              |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3439  | 8770 G 078-130B | H-7   | 2      | C     | 1x2   | RV   | SA   | A          | C         | O/C              | RVT             | Y10             |           |            |                |                | TP-08                 |
|           | Valve Name:     | Low Pressure Safety Injection Header Relief Valve |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3444  | 8770 G 078-130B | F-2   | 2      | B     | 14    | GA   | MO   | A          | LO        | O/C              | PIT             | Y2              | ST-C      | M3         |                |                | TP-11                 |
|           | Valve Name:     | 1A LPSI Pump Suction Isolation Valve              |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3452  | 8770 G 078-130B | C-2   | 2      | B     | 12    | GA   | MO   | A          | LC        | O/C              | PIT             | Y2              | ST-O      | M3         |                |                | TP-11                 |
|           | Valve Name:     | 1A LPSI Pumps Discharge to Shutdown Cooling Valve |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |
| 1-V-3453  | 8770 G 078-130B | D-2   | 2      | B     | 12    | GA   | MO   | A          | LC        | O/C              | PIT             | Y2              | ST-O      | M3         |                |                | TP-11                 |
|           | Valve Name:     | 1B LPSI Pumps Discharge to Shutdown Cooling Valve |        |       |       |      |      |            |           |                  |                 |                 |           |            |                |                |                       |



| Valve Tag   | P&ID            | P&ID<br>Coord.   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|-----------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 1-V-3456    | 8770 G 078-130B | D-7  | 2               | B    | 10   | GA            | MO           | A                   | LC                 | O/C                | PIT          | Y2            | ST-O              | M3                | TP-11         |
| Valve Name: |                 | 1A Shutdown Cooling to LPSI Injection Header Valve       |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-3457    | 8770 G 078-130B | E-7  | 2               | B    | 10   | GA            | MO           | A                   | LC                 | O/C                | PIT          | Y2            | ST-O              | M3                | TP-11         |
| Valve Name: |                 | 1B Shutdown Cooling to LPSI Injection Header Valve       |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-3463    | 8770 G 078-130B | A-4  | 2               | A    | 2    | GA            | M            | A                   | LC                 | O/C                | LT-J         | App J         | ME                | Y2                | TP-04         |
| Valve Name: |                 | SI Tank Drain/Test Line to RWT (P 41)                    |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-3466    | 8770 G 078-130B | A-3  | 3               | C    | 2x3  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
| Valve Name: |                 | SI Check Valve Leakage Test Line Relief Valve            |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-3468    | 8770 G 078-131A | D-2  | 2               | C    | 2x3  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
| Valve Name: |                 | 1B Shutdown Cooling Suction Relief Valve                 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-3469    | 8770 G 078-131A | D-6  | 1               | C    | 1x1  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
| Valve Name: |                 | 1B Shutdown Cooling Suction Isolation Valve Relief Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-3480    | 8770 G 078-131A | D-7  | 1               | A    | 10   | GA            | MO           | A                   | LC                 | O/C                | LT-S         | Y2            | PIT               | Y2                |               |
|             |                 |  |                 |      |      |               |              |                     |                    |                    |              | ST-C          | CS                | CS-08             |               |
|             |                 |  |                 |      |      |               |              |                     |                    |                    |              | ST-O          | CS                | CS-08             |               |
| Valve Name: |                 | 1A Shutdown Cooling Suction Isolation Valve              |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-3481    | 8770 G 078-131A | D-5  | 1               | A    | 10   | GA            | MO           | A                   | LC                 | O/C                | LT-S         | Y2            | PIT               | Y2                |               |
|             |                 |  |                 |      |      |               |              |                     |                    |                    |              | ST-C          | CS                | CS-08             |               |
|             |                 |  |                 |      |      |               |              |                     |                    |                    |              | ST-O          | CS                | CS-08             |               |
| Valve Name: |                 | 1A Shutdown Cooling Suction Isolation Valve              |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-3482    | 8770 G 078-131A | D-6  | 1               | C    | 1x1  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
| Valve Name: |                 | 1A Shutdown Cooling Suction Isolation Valve Relief Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 1-V-3483    | 8770 G 078-131A | D-2  | 2               | C    | 2x3  | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
| Valve Name: |                 | 1A Shutdown Cooling Suction Relief Valve                 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag | P&ID   | P&ID<br>Coord. | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.        | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|--|----------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|----------------------|-------------------|-------------------|---------------|
| 1-V-3611  | 8770 G 078-131B                                | C-6            | 2               | B    | 1    | GL            | AO           | A                   | C                  | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | M3<br>Y2<br>M3<br>M3 |                   |                   | TP-03         |
|           | Valve Name: 1A2 SI Tank Drain/Fill Valve       |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3612  | 8770 G 078-131B                                | B-6            | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                        | Y2                   |                   |                   |               |
|           | Valve Name: 1A2 SI Tank Nitrogen Supply Valve  |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3613  | 8770 G 078-131B                                | B-5            | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                        | Y2                   |                   |                   |               |
|           | Valve Name: 1A2 SI Tank Nitrogen Vent Valve    |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3614  | 8770 G 078-131B                                | C-6            | 1               | B    | 12   | GA            | MO           | P                   | LO                 | O                  | PIT                        | Y2                   |                   |                   |               |
|           | Valve Name: 1A2 SI Tank Outlet Isolation Valve |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3621  | 8770 G 078-131B                                | C-3            | 2               | B    | 1    | GL            | AO           | A                   | C                  | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | M3<br>Y2<br>M3<br>M3 |                   |                   | TP-03         |
|           | Valve Name: 1A1 SI Tank Drain/Fill Valve       |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3622  | 8770 G 078-131B                                | B-3            | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                        | Y2                   |                   |                   |               |
|           | Valve Name: 1A1 SI Tank Nitrogen Supply Valve  |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3623  | 8770 G 078-131B                                | B-2            | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                        | Y2                   |                   |                   |               |
|           | Valve Name: 1A1 SI Tank Nitrogen Vent Valve    |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3624  | 8770 G 078-131B                                | C-3            | 1               | B    | 12   | GA            | MO           | P                   | LO                 | O                  | PIT                        | Y2                   |                   |                   |               |
|           | Valve Name: 1A1 SI Tank Outlet Isolation Valve |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3631  | 8770 G 078-131B                                | G-3            | 2               | B    | 1    | GL            | AO           | A                   | C                  | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | M3<br>Y2<br>M3<br>M3 |                   |                   | TP-03         |
|           | Valve Name: 1B1 SI Tank Drain/Fill Valve       |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3632  | 8770 G 078-131B                                | F-3            | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                        | Y2                   |                   |                   |               |
|           | Valve Name: 1B1 SI Tank Nitrogen Supply Valve  |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |
| 1-V-3633  | 8770 G 078-131B                                | F-2            | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                        | Y2                   |                   |                   |               |
|           | Valve Name: 1B1 SI Tank Nitrogen Vent Valve    |                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                   |               |



| Valve Tag | P&ID  | P&ID<br>Coord. | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type                | Test<br>Freq.        | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|---|----------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|-----------------------------|----------------------|-------------------|-------------------|---------------|
| 1-V-3634  | 8770 G 078-131B   | G-3            | 1               | B    | 12   | GA            | MO           | P                   | LO                 | O                  | PIT                         | Y2                   |                   |                   |               |
|           | Valve Name: 1B1 SI Tank Outlet Isolation Valve                  |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |
| 1-V-3641  | 8770 G 078-131B   | G-6            | 2               | B    | 1    | GL            | AO           | A                   | C                  | O/C                | FSC<br>PIT<br>ST-C<br>ST-O  | M3<br>Y2<br>M3<br>M3 |                   |                   | TP-03         |
|           | Valve Name: 1B2 SI Tank Drain/Fill Valve                        |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |
| 1-V-3642  | 8770 G 078-131B   | F-6            | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                         | Y2                   |                   |                   |               |
|           | Valve Name: 1B2 SI Tank Nitrogen Supply Valve                   |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |
| 1-V-3643  | 8770 G 078-131B   | F-5            | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                         | Y2                   |                   |                   |               |
|           | Valve Name: 1B2 SI Tank Nitrogen Vent Valve                     |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |
| 1-V-3644  | 8770 G 078-131B   | G-6            | 1               | B    | 12   | GA            | MO           | P                   | LO                 | O                  | PIT                         | Y2                   |                   |                   |               |
|           | Valve Name: 1B2 SI Tank Outlet Isolation Valve                  |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |
| 1-V-3651  | 8770 G 078-131A   | E-5            | 1               | A    | 10   | GA            | MO           | A                   | LC                 | O/C                | LT-S<br>PIT<br>ST-C<br>ST-O | Y2<br>Y2<br>CS<br>CS |                   | CS-08<br>CS-08    |               |
|           | Valve Name: 1B Shutdown Cooling Suction Isolation Valve         |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |
| 1-V-3652  | 8770 G 078-131A   | E-7            | 1               | A    | 10   | GA            | MO           | A                   | LC                 | O/C                | LT-S<br>PIT<br>ST-C<br>ST-O | Y2<br>Y2<br>CS<br>CS |                   | CS-08<br>CS-08    |               |
|           | Valve Name: 1B Shutdown Cooling Suction Isolation Valve         |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |
| 1-V-3654  | 8770 G 078-130A   | G-5            | 2               | B    | 6    | GA            | MO           | P                   | LO                 | O                  | PIT                         | Y2                   |                   |                   |               |
|           | Valve Name: 1B HPSI Pump Discharge Valve                        |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |
| 1-V-3656  | 8770 G 078-130A   | D-5            | 2               | B    | 6    | GA            | MO           | A                   | LO                 | O/C                | PIT<br>ST-C                 | Y2<br>M3             |                   |                   | TP-11         |
|           | Valve Name: 1A HPSI Pump Discharge Valve                        |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |
| 1-V-3659  | 8770 G 078-130B   | A-7            | 2               | B    | 3    | GA            | MO           | A                   | O                  | O/C                | PIT<br>ST-C                 | Y2<br>CS             |                   | CS-07             | TP-11         |
|           | Valve Name: Isolation Valve for SI Pump Mini Flow Recirc to RWT |                |                 |      |      |               |              |                     |                    |                    |                             |                      |                   |                   |               |



### Safety Injection (SI)

[illegible]



### Waste Management (W-MAN)

[illegible]



### Waste Management (W-MAN)

| Valve Tag | P&ID            | P&ID<br>Coor. | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type  | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.             |
|-----------|-----------------|---------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|---|---------------|-------------------|-------------------|---------------------------|
| 1-V-6741  | 8770 G 078-163B | F-5           | 2               | A    | 1    | GL            | AO           | A                   | C                  | C                  | FSC   | M3            |                   |                   | TP-03                     |
|           |                 |               |                 |      |      |               |              |                     |                    |                    | LT-J  | App J         |                   |                   |                           |
|           |                 |               |                 |      |      |               |              |                     |                    |                    | PIT   | Y2            |                   |                   |                           |
|           |                 |               |                 |      |      |               |              |                     |                    |                    | ST-C  | M3            |                   |                   |                           |
|           |                 |               |                 |      |      |               |              |                     |                    |                    |   |               |                   |                   |                           |
|           |                 |               |                 |      |      |               |              |                     |                    |                    | <b>Valve Name:</b> Containment Isolation Valve for Nitrogen Supply to the RCB   |               |                   |                   |                           |
| 1-V-6779  | 8770 G 078-163B | F-4           | 2               | A/C  | 1    | CK            | SA           | A                   | C                  | C                  | CC  | CM            |                   |                   | TP-07<br><br>TP-01, TP-07 |
|           |                 |               |                 |      |      |               |              |                     |                    |                    | CO  | CM            |                   |                   |                           |
|           |                 |               |                 |      |      |               |              |                     |                    |                    | LT-J  | App J         |                   |                   |                           |
|           |                 |               |                 |      |      |               |              |                     |                    |                    |   |               |                   |                   |                           |
|           |                 |               |                 |      |      |               |              |                     |                    |                    |   |               |                   |                   |                           |
|           |                 |               |                 |      |      |               |              |                     |                    |                    | <b>Valve Name:</b> Cntmnt Isolation Check Valve for N2 Supply to the RCB (P 14) |               |                   |                   |                           |



| Valve Tag   | P&ID         | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.           | Relief<br>Request | Deferred<br>Just.  | Tech.<br>Pos. |
|-------------|--------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|-------------------------|-------------------|--------------------|---------------|
| 2-HCV-14-1  | 2998 G 083-2 | D-6   | 2               | A    | 8    | BTF           | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-13<br><br>CS-13 | TP-03         |
| Valve Name: |              | RCP Cooling Water Containment Isolation Valve         |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 2-HCV-14-10 | 2998 G 083-1 | F-6   | 3               | B    | 16   | BTF           | PO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C         | M3<br>Y2<br>M3          |                   |                    | TP-03         |
| Valve Name: |              | Nonessential Header Isolation Valve                   |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 2-HCV-14-2  | 2998 G 083-2 | C-1   | 2               | A    | 8    | BTF           | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-13<br><br>CS-13 | TP-03         |
| Valve Name: |              | RCP Cooling Water Containment Isolation Valve         |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 2-HCV-14-3A | 2998 G 083-1 | H-1   | 3               | B    | 14   | BTF           | AO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O         | M3<br>Y2<br>M3          |                   |                    | TP-03         |
| Valve Name: |              | 2A Shutdown Heat Exchanger Cooling Water Return Valve |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 2-HCV-14-3B | 2998 G 083-1 | H-2   | 3               | B    | 14   | BTF           | AO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O         | M3<br>Y2<br>M3          |                   |                    | TP-03         |
| Valve Name: |              | 2A Shutdown Heat Exchanger Cooling Water Return Valve |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 2-HCV-14-6  | 2998 G 083-2 | D-2   | 2               | A    | 8    | BTF           | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-13<br><br>CS-13 | TP-03         |
| Valve Name: |              | RCP Cooling Water Containment Isolation Valve         |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |
| 2-HCV-14-7  | 2998 G 083-2 | D-6   | 2               | A    | 8    | BTF           | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>Y2<br>CS |                   | CS-13<br><br>CS-13 | TP-03         |
| Valve Name: |              | RCP Cooling Water Containment Isolation Valve         |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                    |               |



| Valve Tag   | P&ID         | P&ID<br>Coord.                                   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type       | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------------|----------------|-------------------|-------------------|---------------|
| 2-HCV-14-8A | 2998 G 083-1 | E-5  | 3               | B    | 16   | BTF           | PO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | Nonessential Header Isolation Valve              |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-HCV-14-8B | 2998 G 083-1 | E-5  | 3               | B    | 16   | BTF           | PO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | Nonessential Header Isolation Valve              |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-HCV-14-9  | 2998 G 083-1 | F-6  | 3               | B    | 16   | BTF           | PO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | Nonessential Header Isolation Valve              |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-14-1   | 2998 G 083-1 | D-6  | 3               | B    | 24   | BTF           | MO           | P                   | O                  | C                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |              | 2C CCW Pump Discharge Stop Valve                 |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-14-10  | 2998 G 083-1 | B-2  | 2               | B    | 8    | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |              | 2A Containment Cooling Units CCW Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-14-11  | 2998 G 083-1 | B-4  | 2               | B    | 8    | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |              | 2B Containment Cooling Units CCW Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-14-12  | 2998 G 083-1 | B-3  | 2               | B    | 8    | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |              | 2B Containment Cooling Units CCW Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-14-13  | 2998 G 083-1 | B-1  | 2               | B    | 8    | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |              | 2C Containment Cooling Units CCW Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-14-14  | 2998 G 083-1 | B-1  | 2               | B    | 8    | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |              | 2C Containment Cooling Units CCW Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-14-15  | 2998 G 083-1 | B-2  | 2               | B    | 8    | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |              | 2D Containment Cooling Units CCW Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-14-16  | 2998 G 083-1 | B-2  | 2               | B    | 8    | BTF           | MO           | P                   | O                  | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |              | 2D Containment Cooling Units CCW Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-14-17  | 2998 G 083-1 | E-4  | 3               | B    | 12   | BTF           | MO           | A                   | SYS                | C                  | PIT<br>ST-C        | Y2<br>M3       |                   |                   |               |
| Valve Name: |              | CCW to Fuel Pool Heat Exchangers Inlet Isolation |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |



| Valve Tag  | P&ID   | P&ID<br>Coord. | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|------------|--|----------------|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-MV-14-18 | 2998 G 083-1   | E-4            | 3               | B    | 12    | BTF           | MO           | A                   | SYS                | C                  | PIT          | Y2            | ST-C              | M3                |               |
|            | Valve Name: CCW to Fuel Pool Heat Exchangers Inlet Isolation       |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-14-2  | 2998 G 083-1   | D-6            | 3               | B    | 24    | BTF           | MO           | P                   | C                  | C                  | PIT          | Y2            |                   |                   |               |
|            | Valve Name: 2C CCW Pump Discharge Stop Valve                       |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-14-3  | 2998 G 083-1   | F-6            | 3               | B    | 24    | BTF           | MO           | P                   | O                  | C                  | PIT          | Y2            |                   |                   |               |
|            | Valve Name: 2C CCW Pump Suction Stop Valve                         |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-14-4  | 2998 G 083-1   | F-6            | 3               | B    | 24    | BTF           | MO           | P                   | C                  | C                  | PIT          | Y2            |                   |                   |               |
|            | Valve Name: 2C CCW Pump Suction Stop Valve                         |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-14-9  | 2998 G 083-1   | B-3            | 2               | B    | 8     | BTF           | MO           | P                   | O                  | O                  | PIT          | Y2            |                   |                   |               |
|            | Valve Name: 2A Containment Cooling Units CCW Isolation Valve       |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SE-26-1  | 2998 G 083-1   | C-7            | 3               | B    | 1     | GL            | SO           | A                   | O                  | C                  | FSC          | M3            | PIT               | Y2                | TP-03         |
|            |  |                |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|            | Valve Name: Solenoid valve for CCW to Radiation Monitor            |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SE-26-2  | 2998 G 083-1   | D-7            | 3               | B    | 1     | GL            | SO           | A                   | O                  | C                  | FSC          | M3            | PIT               | Y2                | TP-03         |
|            |  |                |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|            | Valve Name: Solenoid valve for CCW to Radiation Monitor            |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-14307 | 2998 G 083-1   | A-3            | 2               | C    | 1x1.5 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08         |
|            | Valve Name: 2A Containment Cooling Unit CCW Relief Valve           |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-14318 | 2998 G 083-1   | A-3            | 2               | C    | 1x1.5 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08         |
|            | Valve Name: 2B Containment Cooling Unit CCW Relief Valve           |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-14329 | 2998 G 083-1   | A-1            | 2               | C    | 1x1.5 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08         |
|            | Valve Name: 2C Containment Cooling Unit CCW Relief Valve           |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-14342 | 2998 G 083-1   | A-2            | 2               | C    | 1x1.5 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08         |
|            | Valve Name: 2D Containment Cooling Unit CCW Relief Valve           |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-14350 | 2998 G 083-1   | G-1            | 3               | C    | 1x1.5 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08         |
|            | Valve Name: 2A Shutdown Heat Exchanger CCW Shell Side Relief Valve |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
|            |  |                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag   | P&ID   | P&ID<br>Coor.  | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--|--|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-SR-14359  | 2998 G 083-1   | G-2  | 3               | C    | 1x1.5 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08         |
|             | Valve Name:  | 2B Shutdown Heat Exchanger CCW Shell Side Relief Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-14636  | 2998 G 083-2   | D-6  | 2               | A/C  | 0.75  | RV            | SA           | A                   | C                  | O/C                | LT-J         | App J         |                   |                   | TP-08         |
|             |  |  |                 |      |       |               |              |                     |                    |                    | RVT          | Y10           |                   |                   |               |
| Valve Name: | Component Cooling Water Header Supply Thermal Relief Valve |  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-14637  | 2998 G 083-2   | D-2  | 2               | A/C  | 0.75  | RV            | SA           | A                   | C                  | O/C                | LT-J         | App J         |                   |                   | TP-08         |
|             |  |  |                 |      |       |               |              |                     |                    |                    | RVT          | Y10           |                   |                   |               |
| Valve Name: | Component Cooling Water Header Return Thermal Relief Valve |  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-14143   | 2998 G 083-1   | D-6  | 3               | C    | 20    | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   |               |
|             |  |  |                 |      |       |               |              |                     |                    |                    | CO           | M3            |                   |                   |               |
| Valve Name: | 2A CCW Pump Discharge Check Valve                          |  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-14147   | 2998 G 083-1   | D-7  | 3               | C    | 20    | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   |               |
|             |  |  |                 |      |       |               |              |                     |                    |                    | CO           | M3            |                   |                   |               |
| Valve Name: | 2B CCW Pump Discharge Check Valve                          |  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-14151   | 2998 G 083-1   | D-6  | 3               | C    | 20    | CK            | SA           | A                   | O                  | O/C                | CC           | M3            |                   |                   |               |
|             |  |  |                 |      |       |               |              |                     |                    |                    | CO           | M3            |                   |                   |               |
| Valve Name: | 2C CCW Pump Discharge Check Valve                          |  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-14601   | 2998 G 083-1   | F-7  | 3               | C    | 1     | CK            | SA           | A                   | O                  | C                  | CC           | M3            |                   |                   | TP-01         |
|             |  |  |                 |      |       |               |              |                     |                    |                    | CO           | M3            |                   |                   |               |
| Valve Name: | Check Valve for RS 26 2 for the CCW Pump                   |  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-14602   | 2998 G 083-1   | F-7  | 3               | C    | 1     | CK            | SA           | A                   | O                  | C                  | CC           | M3            |                   |                   | TP-01         |
|             |  |  |                 |      |       |               |              |                     |                    |                    | CO           | M3            |                   |                   |               |
| Valve Name: | Check Valve for RS 26 1 for the CCW Pump                   |  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag   | P&ID         | P&ID<br>Coord.                                   | Safety<br>Class | Cat. | Size    | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type       | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|--|-----------------|------|---------|---------------|--------------|---------------------|--------------------|--------------------|--------------------|----------------|-------------------|-------------------|---------------|
| 2-FCV-07-1A | 2998 G 088-2 | C-3  | 2               | B    | 12      | BTF           | AO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | Containment Spray Discharge Header Control Valve |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-FCV-07-1B | 2998 G 088-2 | D-3  | 2               | B    | 12      | BTF           | AO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | Containment Spray Discharge Header Control Valve |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-07-1A  | 2998 G 088-1 | E-5  | 2               | B    | 24      | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C        | Y2<br>M3       |                   |                   | TP-11         |
| Valve Name: |              | RWT Outlet Stop Valve                            |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-07-1B  | 2998 G 088-1 | E-5  | 2               | B    | 24      | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C        | Y2<br>M3       |                   |                   | TP-11         |
| Valve Name: |              | RWT Outlet Stop Valve                            |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-07-3   | 2998 G 088-2 | C-2  | 2               | B    | 12      | GA            | MO           | A                   | O                  | O                  | PIT<br>ST-C        | Y2<br>M3       |                   |                   |               |
| Valve Name: |              | Containment Spray Discharge Header Stop Valve    |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-07-4   | 2998 G 088-2 | D-2  | 2               | B    | 12      | GA            | MO           | A                   | O                  | O                  | PIT<br>ST-C        | Y2<br>M3       |                   |                   |               |
| Valve Name: |              | Containment Spray Discharge Header Stop Valve    |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-SE-07-3A  | 2998 G 088-1 | G-3  | 2               | B    | 0.5     | GL            | SO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | Hydrazine Injection Isolation Valve              |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-SE-07-3B  | 2998 G 088-1 | H-3  | 2               | B    | 0.5     | GL            | SO           | A                   | C                  | O                  | FSO<br>PIT<br>ST-O | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | Hydrazine Injection Isolation Valve              |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-SR-07-1C  | 2998 G 088-1 | E-2  | 2               | C    | 1x1     | RV            | SA           | A                   | C                  | O/C                | RVT                | Y10            |                   |                   |               |
| Valve Name: |              | Hydrazine Storage Tank Safety/Relief Valve       |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-SR-07-2A  | 2998 G 088-1 | F-3  | 2               | C    | 0.5x0.5 | RV            | SA           | A                   | C                  | O/C                | RVT                | Y10            |                   |                   |               |
| Valve Name: |              | Hydrazine Injection Header Safety/Relief Valve   |                 |      |         |               |              |                     |                    |                    |                    |                |                   |                   |               |



| Valve Tag   | P&ID  | P&ID Safety Coord.                                  | Class | Cat. | Size    | Valve Type | Act. Type | Active / Passive | Normal Position | Safety Position | Test Type | Test Freq. | Relief Request | Deferred Just. | Tech. Pos.   |
|-------------|---|---|-------|------|---------|------------|-----------|------------------|-----------------|-----------------|-----------|------------|----------------|----------------|--------------|
| 2-SR-07-2B  | 2998 G 088-1                                      | G-3   | 2     | C    | 0.5x0.5 | RV         | SA        | A                | C               | O/C             | RVT       | Y10        |                |                |              |
|             | Valve Name:                                       | Hydrazine Injection Header Safety/Relief Valve      |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07119   | 2998 G 088-1                                      | E-6   | 2     | C    | 24      | CK         | SA        | A                | C               | O/C             | CCL       | CM         |                |                | TP-07        |
|             |   |   |       |      |         |            |           |                  |                 |                 | COF       | CM         |                |                | TP-07        |
| Valve Name: | RWT Outlet Check Valve                            |   |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07120   | 2998 G 088-1                                      | E-6   | 2     | C    | 24      | CK         | SA        | A                | C               | O/C             | CCL       | CM         |                |                | TP-07        |
|             |   |   |       |      |         |            |           |                  |                 |                 | COF       | CM         |                |                | TP-07        |
| Valve Name: | RWT Outlet Check Valve                            |   |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07129   | 2998 G 088-1                                      | H-6   | 2     | C    | 12      | CK         | SA        | A                | C               | O               | CCL       | CM         |                |                | TP-01, TP-07 |
|             |   |   |       |      |         |            |           |                  |                 |                 | COF       | CM         |                |                | TP-07        |
| Valve Name: | 2B Containment Spray Pump Discharge Check Valve   |   |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07130   | 2998 G 088-1                                      | H-6   | 2     | B    | 12      | GA         | M         | A                | LO              | O/C             | ME        | Y2         |                |                | TP-04        |
|             | Valve Name:                                       | 2B Containment Spray Pump Discharge Isolation Valve |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07143   | 2998 G 088-1                                      | G-6   | 2     | C    | 12      | CK         | SA        | A                | C               | O               | CCL       | CM         |                |                | TP-01, TP-07 |
|             |   |   |       |      |         |            |           |                  |                 |                 | COF       | CM         |                |                | TP-07        |
| Valve Name: | 2A Containment Spray Pump Discharge Check Valve   |   |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07145   | 2998 G 088-1                                      | G-6   | 2     | B    | 12      | GA         | M         | A                | LO              | O/C             | ME        | Y2         |                |                | TP-04        |
|             | Valve Name:                                       | 2A Containment Spray Pump Discharge Isolation Valve |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07192   | 2998 G 088-2                                      | C-4   | 2     | C    | 10      | CK         | SA        | A                | C               | O               | CCD       | CM         |                |                | TP-01, TP-07 |
|             |   |   |       |      |         |            |           |                  |                 |                 | COD       | CM         |                |                | TP-07        |
| Valve Name: | 2B Containment Spray Discharge Header Check Valve |   |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07193   | 2998 G 088-2                                      | C-4   | 2     | C    | 10      | CK         | SA        | A                | C               | O               | CCD       | CM         |                |                | TP-01, TP-07 |
|             |   |   |       |      |         |            |           |                  |                 |                 | COD       | CM         |                |                | TP-07        |
| Valve Name: | 2A Containment Spray Discharge Header Check Valve |   |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07231   | 2998 G 088-1                                      | E-2   | 2     | C    | 2       | CK         | SA        | A                | C               | O               | CC        | M3         |                |                | TP-01        |
|             |   |   |       |      |         |            |           |                  |                 |                 | CO        | M3         |                |                |              |
| Valve Name: | Hydrazine Storage Tank Vacuum Breaker             |   |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |
| 2-V-07232   | 2998 G 088-1                                      | E-2   | 2     | C    | 2       | CK         | SA        | A                | C               | O               | CC        | M3         |                |                | TP-01        |
|             |   |   |       |      |         |            |           |                  |                 |                 | CO        | M3         |                |                |              |
| Valve Name: | Hydrazine Storage Tank Vacuum Breaker             |   |       |      |         |            |           |                  |                 |                 |           |            |                |                |              |



| Valve Tag | P&ID         | P&ID<br>Coord.                                | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|--------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-07256 | 2998 G 088-1 | G-3   | 2               | C    | 0.5  | CK            | SA           | A                   | C                  | O/C                | CC           | CM            |                   |                   | TP-07         |
|           |              |   |                 |      |      |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
|           | Valve Name:  | 2A Hydrazine Injection Check Valve            |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-07258 | 2998 G 088-1 | H-3   | 2               | C    | 0.5  | CK            | SA           | A                   | C                  | O/C                | CC           | CM            |                   |                   | TP-07         |
|           |              |   |                 |      |      |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
|           | Valve Name:  | 2B Hydrazine Injection Check Valve            |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-07412 | 2998 G 088-1 | F-3   | 2               | C    | 0.5  | CK            | SA           | A                   | C                  | O                  | CC           | M3            |                   |                   | TP-01         |
|           |              |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   |               |
|           | Valve Name:  | Hydrazine Pump Recirculation Line Check Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-29431 | 2998 G 088-1 | D-2   | 2               | C    | 1    | CK            | SA           | A                   | C                  | C                  | CCR          | CM            |                   |                   | TP-07         |
|           |              |   |                 |      |      |               |              |                     |                    |                    | COF          | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:  | Hydrazine Storage Tank Nitrogen Check Valve   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-29432 | 2998 G 088-1 | D-1   | 2               | C    | 1    | CK            | SA           | A                   | C                  | C                  | CCR          | CM            |                   |                   | TP-07         |
|           |              |   |                 |      |      |               |              |                     |                    |                    | COF          | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:  | Hydrazine Storage Tank Nitrogen Check Valve   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag   | P&ID            | P&ID<br>Coord.   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.        | Relief<br>Request | Deferred<br>Just.       | Tech.<br>Pos.  |
|-------------|-----------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|----------------------|-------------------|-------------------------|----------------|
| 2-FCV-2210Y | 2998 G 078-121B | F-6  | 2               | B    | 1    | GL            | AO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C         | M3<br>Y2<br>M3       |                   |                         | TP-03          |
| Valve Name: |                 | Boric Acid Makeup Pumps Disch. to VCT Stop Valve         |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                         |                |
| 2-SE-02-1   | 2998 G 078-122  | D-6  | 1               | B    | 2    | GL            | SO           | A                   | O                  | O/C                | FSO<br>PIT<br>ST-C<br>ST-O | M3<br>Y2<br>M3<br>M3 |                   |                         | TP-03          |
| Valve Name: |                 | Charging To RCS Cold Legs Stop Valve                     |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                         |                |
| 2-SE-02-2   | 2998 G 078-122  | C-6  | 1               | B    | 2    | GL            | SO           | A                   | O                  | O/C                | FSO<br>PIT<br>ST-C<br>ST-O | M3<br>Y2<br>M3<br>M3 |                   |                         | TP-03          |
| Valve Name: |                 | Charging to RCS Cold Legs Stop Valve                     |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                         |                |
| 2-SE-02-3   | 2998 G 078-122  | E-6  | 1               | B    | 2    | GL            | SO           | A                   | C                  | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | CS<br>Y2<br>CS<br>CS |                   | CS-03<br>CS-03<br>CS-03 | TP-03          |
| Valve Name: |                 | Auxiliary Pressurizer Spray Isolation Valve              |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                         |                |
| 2-SE-02-4   | 2998 G 078-122  | E-6  | 1               | B    | 2    | GL            | SO           | A                   | C                  | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | CS<br>Y2<br>CS<br>CS |                   | CS-03<br>CS-03<br>CS-03 | TP-03          |
| Valve Name: |                 | Auxiliary Pressurizer Spray Isolation Valve              |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                         |                |
| 2-SR-02123  | 2998 G 078-121A | C-2  | 2               | A/C  | 1    | RV            | SA           | A                   | C                  | O/C                | LT-J<br>RVT                | App J<br>Y10         |                   |                         | TP-08          |
| Valve Name: |                 | CVCS Reactor Coolant Pump Bleed-off Thermal Relief Valve |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                         |                |
| 2-V-2115    | 2998 G 078-121A | E-4  | 3               | C    | 4x6  | RV            | SA           | A                   | C                  | O/C                | RVT                        | Y10                  |                   |                         |                |
| Valve Name: |                 | VCT Safety / Relief Valve                                |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                         |                |
| 2-V-2118    | 2998 G 078-121A | E-5  | 2               | C    | 4    | CK            | SA           | A                   | O                  | O/C                | CC<br>CO                   | CM<br>CM             |                   |                         | TP-07<br>TP-07 |
| Valve Name: |                 | VCT Discharge Header Check Valve                         |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                         |                |



| Valve Tag | P&ID            | P&ID Safety<br>Coord.                                  | Class | Cat. | Size    | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|-----------------|--|-------|------|---------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-2167  | 2998 G 078-122  | C-3  | 2     | C    | 2       | CK            | SA           | A                   | SYS                | O/C                | CC           | M3            |                   |                   |               |
|           | Valve Name:     | 2C Charging Pump Discharge CV                          |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2168  | 2998 G 078-122  | E-3  | 2     | C    | 2       | CK            | SA           | A                   | SYS                | O/C                | CC           | M3            |                   |                   |               |
|           | Valve Name:     | 2B Charging Pump Discharge CV                          |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2169  | 2998 G 078-122  | G-3  | 2     | C    | 2       | CK            | SA           | A                   | SYS                | O/C                | CC           | M3            |                   |                   |               |
|           | Valve Name:     | 2A Charging Pump Discharge CV                          |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2177  | 2998 G 078-121B | H-5  | 2     | C    | 3       | CK            | SA           | A                   | C                  | O                  | COF          | CM            |                   |                   | TP-07         |
|           | Valve Name:     | Boric Acid Makeup Pump Disch. to Charging Pump Suction |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2190  | 2998 G 078-121B | G-2  | 2     | C    | 3       | CK            | SA           | A                   | C                  | O                  | CC           | CM            |                   |                   | TP-01, TP-07  |
|           | Valve Name:     | Boric Acid Gravity Feed Check Valve                    |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2191  | 2998 G 078-121A | E-6  | 2     | C    | 3       | CK            | SA           | A                   | C                  | O/C                | CC           | CM            |                   |                   | TP-07         |
|           | Valve Name:     | RWT to Charging Pump Suction Check Valve               |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2311  | 2998 G 078-121A | F-5  | 2     | C    | 0.5     | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
|           | Valve Name:     | Chg Pump Common Suction Hdr. Relief Valve              |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2318  | 2998 G 078-122  | D-2  | 2     | C    | 0.5X1.5 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08         |
|           | Valve Name:     | 2B Charging Pump Suction Safety/Relief Valve           |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2321  | 2998 G 078-122  | F-2  | 2     | C    | 0.5X1.5 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   | TP-08         |
|           | Valve Name:     | 2A Charging Pump Suction Safety/Relief Valve           |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2324  | 2998 G 078-122  | F-3  | 2     | C    | 1.5     | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
|           | Valve Name:     | 2A Charging Pump Discharge Safety/Relief Valve         |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2325  | 2998 G 078-122  | D-2  | 2     | C    | 1.5     | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
|           | Valve Name:     | 2B Charging Pump Discharge Safety/Relief Valve         |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-2326  | 2998 G 078-122  | B-2  | 2     | C    | 1.5     | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
|           | Valve Name:     | 2C Charging Pump Discharge Safety/Relief Valve         |       |      |         |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



### Chemical and Volume Control System (CVCS)

| Valve Tag | P&ID            | P&ID<br>Coord. | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type   | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|-----------------|----------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--|---------------|-------------------|-------------------|---------------|
| 2-V-2501  | 2998 G 078-121A | D-5            | 2               | B    | 4    | GA            | MO           | A                   | O                  | O/C                | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C   | CS            |                   | CS-05             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O   | CS            |                   | CS-05             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: VCT Discharge Isolation Valve                          |               |                   |                   |               |
| 2-V-2504  | 2998 G 078-121A | F-6            | 2               | B    | 3    | GA            | MO           | A                   | C                  | O/C                | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C   | M3            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O   | M3            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: RWT To Charging Pump Suction Isolation Valve           |               |                   |                   |               |
| 2-V-2505  | 2998 G 078-121A | C-3            | 2               | A    | 0.75 | GL            | AO           | A                   | O                  | C                  | FSC  | CS            |                   | CS-06             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | LT-J   | App J         |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C   | CS            |                   | CS-06             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: RCP Seal Water Return Valve                            |               |                   |                   |               |
| 2-V-2508  | 2998 G 078-121B | F-3            | 2               | B    | 3    | GA            | MO           | A                   | C                  | O                  | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O   | M3            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Boric Acid Gravity Feed Isolation Valve                |               |                   |                   |               |
| 2-V-2509  | 2998 G 078-121B | F-2            | 2               | B    | 3    | GA            | MO           | A                   | C                  | O                  | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O   | M3            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Boric Acid Gravity Feed Isolation Valve                |               |                   |                   |               |
| 2-V-2514  | 2998 G 078-121B | H-5            | 2               | B    | 3    | GA            | MO           | A                   | C                  | O                  | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O   | M3            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Boric Acid Makeup Pump Disch. To Charging Pump Suction |               |                   |                   |               |
| 2-V-2515  | 2998 G 078-122  | G-7            | 1               | B    | 2    | GL            | AO           | A                   | O                  | C                  | FSC  | CS            |                   | CS-04             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C   | CS            |                   | CS-04             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Letdown Isolation Valve                                |               |                   |                   |               |
| 2-V-2516  | 2998 G 078-122  | G-6            | 1               | A    | 2    | GL            | AO           | A                   | O                  | C                  | FSC  | CS            |                   | CS-04             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | LT-J   | App J         |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT  | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C   | CS            |                   | CS-04             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: Letdown Isolation Valve                                |               |                   |                   |               |



[illegible]



[illegible]



[illegible]



[illegible]



| Valve Tag | P&ID          | P&ID<br>Coord.                                  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|---------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-59183 | 2998 G 096-1C | G-2   | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | C                  | CC           | Y2            |                   |                   | TP-09         |
|           | Valve Name:   | EDG 2A1 North Air Start Sequencing Check Valve  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59187 | 2998 G 096-1C | E-2   | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | C                  | CC           | Y2            |                   |                   | TP-09         |
|           | Valve Name:   | EDG 2A1 South Air Start Sequencing Check Valve  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59191 | 2998 G 096-1C | G-4   | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | C                  | CC           | Y2            |                   |                   | TP-09         |
|           | Valve Name:   | EDG 2A2 North Air Start Sequencing Check Valve  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59192 | 2998 G 096-1C | E-2   | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | O/C                | CC           | Y2            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | Y2            |                   |                   | TP-09         |
|           | Valve Name:   | Check Valve for D/G Engine Governor Air Booster |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59193 | 2998 G 096-1C | E-2   | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | O/C                | CC           | Y2            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | Y2            |                   |                   | TP-09         |
|           | Valve Name:   | Check Valve for D/G Engine Governor Air Booster |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59197 | 2998 G 096-1C | E-4   | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | C                  | CC           | Y2            |                   |                   | TP-09         |
|           | Valve Name:   | EDG 2A2 South Air Start Sequencing Check Valve  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59198 | 2998 G 096-1C | E-5   | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | O/C                | CC           | Y2            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | Y2            |                   |                   | TP-09         |
|           | Valve Name:   | Check Valve for D/G Engine Governor Air Booster |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59199 | 2998 G 096-1C | E-5   | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | O/C                | CC           | Y2            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | Y2            |                   |                   | TP-09         |
|           | Valve Name:   | Check Valve for D/G Engine Governor Air Booster |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59203 | 2998 G 096-2C | B-5   | 3               | C    | 1.25 | CK            | SA           | A                   | C                  | C                  | CC           | M3            |                   |                   | TP-05, TP-01  |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | OP            |                   |                   |               |
|           | Valve Name:   | 2B EDG Air Start Receiver Check Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59204 | 2998 G 096-2C | B-4   | 3               | C    | 1.25 | CK            | SA           | A                   | C                  | C                  | CC           | M3            |                   |                   | TP-05, TP-01  |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | OP            |                   |                   |               |
|           | Valve Name:   | 2B EDG Air Start Receiver Check Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59205 | 2998 G 096-2C | B-3   | 3               | C    | 1.25 | CK            | SA           | A                   | C                  | C                  | CC           | M3            |                   |                   | TP-05, TP-01  |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | OP            |                   |                   |               |
|           | Valve Name:   | 2B EDG Air Start Receiver Check Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag | P&ID          | P&ID<br>Coord.                                   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.  |
|-----------|---------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|----------------|
| 2-V-59206 | 2998 G 096-2C | B-2  | 3               | C    | 1.25 | CK            | SA           | A                   | C                  | C                  | CC<br>CO     | M3<br>OP      |                   |                   | TP-05, TP-01   |
|           | Valve Name:   | 2B EDG Air Start Receiver Check Valve            |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |
| 2-V-59231 | 2998 G 096-2C | G-2  | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | C                  | CC           | Y2            |                   |                   | TP-09          |
|           | Valve Name:   | EDG 2B1 South Air Start Sequencing Check Valve   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |
| 2-V-59235 | 2998 G 096-2C | E-2  | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | C                  | CC           | Y2            |                   |                   | TP-09          |
|           | Valve Name:   | EDG 2B1 North Air Start Sequencing Check Valve   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |
| 2-V-59236 | 2998 G 096-1C | B-4  | 3               | C    | 1.25 | CK            | SA           | A                   | C                  | C                  | CC<br>CO     | M3<br>OP      |                   |                   | TP-05, TP-01   |
|           | Valve Name:   | 2A EDG Air Start Receiver Check Valve            |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |
| 2-V-59239 | 2998 G 096-2C | G-4  | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | C                  | CC           | Y2            |                   |                   | TP-09          |
|           | Valve Name:   | EDG 2B2 North Air Start Sequencing Check Valve   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |
| 2-V-59240 | 2998 G 096-2C | E-2  | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | Y2<br>Y2      |                   |                   | TP-09<br>TP-09 |
|           | Valve Name:   | Check Valve for D/G Engine Governor Air Boosters |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |
| 2-V-59241 | 2998 G 096-2C | E-2  | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | Y2<br>Y2      |                   |                   | TP-09<br>TP-09 |
|           | Valve Name:   | Check Valve for D/G Engine Governor Air Boosters |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |
| 2-V-59245 | 2998 G 096-2C | E-4  | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | C                  | CC           | Y2            |                   |                   | TP-09          |
|           | Valve Name:   | EDG 2B2 South Air Start Sequencing Check Valve   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |
| 2-V-59246 | 2998 G 096-2C | E-5  | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | Y2<br>Y2      |                   |                   | TP-09<br>TP-09 |
|           | Valve Name:   | Check Valve for D/G Engine Governor Air Boosters |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |
| 2-V-59247 | 2998 G 096-2C | E-5  | 3               | C    | 0.25 | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | Y2<br>Y2      |                   |                   | TP-09<br>TP-09 |
|           | Valve Name:   | Check Valve for D/G Engine Governor Air Boosters |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                |



| Valve Tag    | P&ID          | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|--------------|---------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-SR-59-1A1  | 2998 G 096-1A | C-5   | 3               | C    | 1.25 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
|              | Valve Name:   | Safety Relief Valve for the D/G Radiator Expansion Tank |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-59-1A2  | 2998 G 096-1B | F-2   | 3               | C    | 1.25 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
|              | Valve Name:   | Safety Relief Valve for the D/G Radiator Expansion Tank |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-59-1B1  | 2998 G 096-2A | B-5   | 3               | C    | 1.25 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
|              | Valve Name:   | Safety Relief Valve for the D/G Radiator Expansion Tank |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-59-1B2  | 2998 G 096-2B | F-2   | 3               | C    | 1.25 | RV            | SA           | A                   | C                  | O/C                | RVT          | Y10           |                   |                   |               |
|              | Valve Name:   | Safety Relief Valve for the D/G Radiator Expansion Tank |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-TCV-59-1A1 | 2998 G 096-1A | E-6   | 3               | C    | 4    | 3W            | SA           | A                   | C                  | O/C                | TMP          | M3            |                   |                   | TP-09         |
|              | Valve Name:   | EDG Engine Water TCV                                    |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-TCV-59-1A2 | 2998 G 096-1B | E-2   | 3               | C    | 4    | 3W            | SA           | A                   | C                  | O/C                | TMP          | M3            |                   |                   | TP-09         |
|              | Valve Name:   | EDG Engine Water TCV                                    |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-TCV-59-1B1 | 2998 G 096-2A | E-6   | 3               | C    | 4    | 3W            | SA           | A                   | C                  | O/C                | TMP          | M3            |                   |                   | TP-09         |
|              | Valve Name:   | EDG Engine Water TCV                                    |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-TCV-59-1B2 | 2998 G 096-2B | E-2   | 3               | C    | 4    | 3W            | SA           | A                   | C                  | O/C                | TMP          | M3            |                   |                   | TP-09         |
|              | Valve Name:   | EDG Engine Water TCV                                    |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



[illegible]



| Valve Tag | P&ID          | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|---------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-59010 | 2998 G 096-1A | G-5   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil A/C Pump Discharge Check for Diesel 2A1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59011 | 2998 G 096-1A | G-5   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil D/C Pump Discharge Check for Diesel 2A1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59017 | 2998 G 096-1A | G-4   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Turbo Lube Oil D/C Pump Discharge Check for Diesel 2A1    |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59021 | 2998 G 096-1A | G-3   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Turbo Lube Oil A/C Pump Discharge Check for Diesel 2A1    |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59025 | 2998 G 096-1B | B-5   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil A/C Pump Discharge Check for Diesel 2A2 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59026 | 2998 G 096-1B | B-4   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil D/C Pump Discharge Check for Diesel 2A2 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59040 | 2998 G 096-2A | G-5   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil A/C Pump Discharge Check for Diesel 2B1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59041 | 2998 G 096-2A | G-5   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Soakback Lube Oil D/C Pump Discharge Check for Diesel 2B1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59048 | 2998 G 096-1B | B-3   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Turbo Lube Oil D/C Pump Discharge Check for Diesel 2A2    |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-59051 | 2998 G 096-1B | B-3   | 3               | C    | 1    | CK            | SA           | A                   | C                  | O/C                | CC           | M3            |                   |                   | TP-09         |
|           |               |   |                 |      |      |               |              |                     |                    |                    | CO           | M3            |                   |                   | TP-09         |
|           | Valve Name:   | Turbo Lube Oil A/C Pump Discharge Check for Diesel 2A2    |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



| Valve Tag  | P&ID         | P&ID<br>Coord.   | Safety<br>Class | Cal. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-SR-07475 | 2998 G 088-2 | E-4  | 2               | A/C  | 0.75 | RV            | SA           | A                   | C                  | O/C                | LT-J         | App J         | RVT               | Y10               | TP-08         |
|            | Valve Name:  | Containment Spray Rx Cavity Purification Supply Thermal Relief |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SR-07476 | 2998 G 088-2 | E-4  | 2               | A/C  | 0.75 | RV            | SA           | A                   | C                  | O/C                | LT-J         | App J         | RVT               | Y10               | TP-08         |
|            | Valve Name:  | Containment Spray Rx Cavity Purification Supply Thermal Relief |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-07170  | 2998 G 088-2 | E-3  | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|            | Valve Name:  | Refueling Cavity Containment Isolation Valve (PEN P 47)        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-07188  | 2998 G 088-2 | E-4  | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|            | Valve Name:  | Refueling Cavity Containment Isolation Valve (PEN P 47)        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-07189  | 2998 G 088-2 | E-4  | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|            | Valve Name:  | Refueling Cavity Containment Isolation Valve (PEN P 47)        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-07206  | 2998 G 088-2 | E-3  | 2               | A    | 3    | GA            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|            | Valve Name:  | Refueling Cavity Containmnet Isolation Valve (PEN P 47)        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag   | P&ID          | P&ID<br>Coor.   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type        | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-------------|---------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|---------------------|----------------|-------------------|-------------------|-----------------------|
| 2-CHKVLV-1A | 2998 9695     | F-3   | NC              | C    | 0.5  | CK            | SA           | A                   | C                  | C                  | CCL<br>COF          | CM<br>CM       |                   |                   | TP-07<br>TP-01, TP-07 |
| Valve Name: |               | MFW Header Isolation Valve HCV-09-1A Air Supply Check Valve |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |
| 2-CHKVLV-1B | 2998 9695     | F-3   | NC              | C    | 0.5  | CK            | SA           | A                   | C                  | C                  | CCL<br>COF          | CM<br>CM       |                   |                   | TP-07<br>TP-01, TP-07 |
| Valve Name: |               | MFW Header Isolation Valve HCV-09-1B Air Supply Check Valve |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |
| 2-CHKVLV-2A | 2998 9695     | F-3   | NC              | C    | 0.5  | CK            | SA           | A                   | C                  | C                  | CCL<br>COF          | CM<br>CM       |                   |                   | TP-07<br>TP-01, TP-07 |
| Valve Name: |               | MFW Header Isolation Valve HCV-09-2A Air Supply Check Valve |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |
| 2-CHKVLV-2B | 2998 9695     | F-3   | NC              | C    | 0.5  | CK            | SA           | A                   | C                  | C                  | CCL<br>COF          | CM<br>CM       |                   |                   | TP-07<br>TP-01, TP-07 |
| Valve Name: |               | MFW Header Isolation Valve HCV-09-2B Air Supply Check Valve |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |
| 2-HCV-09-1A | 2998 G 080-2A | B-5   | 2               | B    | 20   | GA            | PO           | A                   | O                  | C                  | PIT<br>ST-C         | Y2<br>CS       |                   | CS-12             |                       |
| Valve Name: |               | Main Feedwater Block Valve                                  |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |
| 2-HCV-09-1B | 2998 G 080-2A | B-5   | 2               | B    | 20   | GA            | PO           | A                   | O                  | C                  | PIT<br>ST-C         | Y2<br>CS       |                   | CS-12             |                       |
| Valve Name: |               | Main Feedwater Block Valve                                  |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |
| 2-HCV-09-2A | 2998 G 080-2A | C-5   | 2               | B    | 20   | GA            | PO           | A                   | O                  | C                  | PIT<br>ST-C         | Y2<br>CS       |                   | CS-12             |                       |
| Valve Name: |               | Main Feedwater Block Valve                                  |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |
| 2-HCV-09-2B | 2998 G 080-2A | C-5   | 2               | B    | 20   | GA            | PO           | A                   | O                  | C                  | PIT<br>ST-C         | Y2<br>CS       |                   | CS-12             |                       |
| Valve Name: |               | Main Feedwater Block Valve                                  |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |
| 2-MV-09-10  | 2998 G 080-2B | D-6   | 2               | B    | 4    | GL            | MO           | A                   | C                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                       |
| Valve Name: |               | 2B AFW Flow Control Valve                                   |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |
| 2-MV-09-11  | 2998 G 080-2B | F-6   | 2               | B    | 4    | GL            | MO           | A                   | C                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                   |                       |
| Valve Name: |               | 2C AFW Flow Control Valve                                   |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                   |                       |



[illegible]



[illegible]



| Valve Tag | P&ID          | P&ID<br>Coor.                                | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-----------|---------------|--|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|-----------------------|
| 2-V-09252 | 2998 G 080-2A | B-7  | 2               | C    | 18    | CK            | SA           | A                   | O                  | O                  | CCD<br>COF   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:   | 2A Steam Generator Feedwater Check Valve     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-09294 | 2998 G 080-2A | C-7  | 2               | C    | 18    | CK            | SA           | A                   | O                  | O                  | CCD<br>COF   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:   | 2B Steam Generator Feedwater Check Valve     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-09303 | 2998 G 080-2B | G-3  | 3               | B    | 2     | CK            | SA           | A                   | C                  | O                  | CCU<br>COU   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:   | 2C AFW Pump Minimum Flow Check Valve         |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-09304 | 2998 G 080-2B | E-3  | 3               | B    | 1.5   | CK            | SA           | A                   | C                  | O                  | CCU<br>COU   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:   | 2B AFW Pump Minimum Flow Check Valve         |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-09305 | 2998 G 080-2B | C-3  | 3               | B    | 1.5   | CK            | SA           | A                   | C                  | O                  | CCU<br>COU   | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:   | 2A AFW Pump Minimum Flow Check Valve         |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-09724 | 2998 G 080-2B | A-6  | 3               | C    | 0.375 | CK            | SA           | A                   | C                  | C                  | CCL<br>COF   | CM<br>CM      |                   |                   | TP-07<br>TP-01, TP-07 |
|           | Valve Name:   | Chemical Addition Check Valve                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-09725 | 2998 G 080-2B | E-6  | 3               | C    | 0.375 | CK            | SA           | A                   | C                  | C                  | CCL<br>COF   | CM<br>CM      |                   |                   | TP-07<br>TP-01, TP-07 |
|           | Valve Name:   | Chemical Addition Check Valve                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-09726 | 2998 G 080-2B | H-6  | 3               | C    | 0.375 | CK            | SA           | A                   | C                  | C                  | CCL<br>COF   | CM<br>CM      |                   |                   | TP-07<br>TP-01, TP-07 |
|           | Valve Name:   | Chemical Addition Check Valve                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-09727 | 2998 G 080-2B | H-6  | 3               | C    | 0.375 | CK            | SA           | A                   | C                  | C                  | CCL<br>COF   | CM<br>CM      |                   |                   | TP-07<br>TP-01, TP-07 |
|           | Valve Name:   | Chemical Addition Check Valve                |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-12801 | 2998 G 080-2B | A-2  | 3               | B    | 8     | GA            | M            | A                   | LC                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:   | Unit 1/2 CST/AFW Suction Cross Connect Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-12802 | 2998 G 080-2B | A-2  | 3               | B    | 8     | GA            | M            | A                   | LC                 | O/C                | ME           | Y2            |                   |                   | TP-04                 |
|           | Valve Name:   | Unit 1/2 CST/AFW Suction Cross Connect Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |                       |



**Feedwater (FW)**

| Valve Tag | P&ID          | P&ID<br>Coord.                               | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|---------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-12803 | 2998 G 080-2B | A-2  | 3               | B    | 8    | GA            | M            | A                   | LC                 | O/C                | ME           | Y2            |                   |                   | TP-04         |
|           | Valve Name:   | Isolation Valve for CST Inlet to/from Unit 1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-12805 | 2998 G 080-2B | A-3  | NC              | B    | 8    | GA            | M            | A                   | LC                 | O/C                | ME           | Y2            |                   |                   | TP-04         |
|           | Valve Name:   | Isolation Valve for CST Inlet to/from Unit 1 |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-12806 | 2998 G 080-2B | A-3  | NC              | C    | 8    | CK            | SA           | A                   | C                  | O                  | CC           | CM            |                   |                   | TP-01, TP-07  |
|           |               |  |                 |      |      |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
|           | Valve Name:   | Unit 2 CST To Unit 1 Check Valve             |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag   | P&ID         | P&ID<br>Coord.   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type        | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just.  | Tech.<br>Pos. |
|-------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|---------------------|----------------|-------------------|--------------------|---------------|
| 2-FCV-25-1  | 2998 G 878   | C-2  | 2               | B    | 48   | BTF           | PO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C  | CS<br>Y2<br>CS |                   | CS-16<br><br>CS-16 | TP-03         |
| Valve Name: |              | Containment Purge Isolation Valve                        |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                    |               |
| 2-FCV-25-11 | 2998 G 879-3 | H-4  | 2               | B    | 24   | BTF           | MO           | A                   | C                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                    |               |
| Valve Name: |              | Shield Building Ventilation System Cooling Air Isolation |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                    |               |
| 2-FCV-25-12 | 2998 G 879-3 | J-4  | 2               | B    | 24   | BTF           | MO           | A                   | C                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                    |               |
| Valve Name: |              | Shield Building Ventilation System Cooling Air Isolation |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                    |               |
| 2-FCV-25-13 | 2998 G 879-3 | I-13   | 2               | B    | 12   | BTF           | MO           | A                   | O                  | O                  | PIT<br>ST-O         | Y2<br>M3       |                   |                    |               |
| Valve Name: |              | SBVS Cross Connect Valve                                 |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                    |               |
| 2-FCV-25-14 | 2998 G 879-2 | E-5  | 3               | B    | 12   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                    |               |
| Valve Name: |              | Control Room Outside Air Intake Isolation Valve          |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                    |               |
| 2-FCV-25-15 | 2998 G 879-2 | E-7  | 3               | B    | 12   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                    |               |
| Valve Name: |              | Control Room Outside Air Intake Isolation Valve          |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                    |               |
| 2-FCV-25-16 | 2998 G 879-2 | E-6  | 3               | B    | 12   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                    |               |
| Valve Name: |              | Control Room Outside Air Intake Isolation Valve          |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                    |               |
| 2-FCV-25-17 | 2998 G 879-2 | E-8  | 3               | B    | 12   | BTF           | MO           | A                   | O                  | O/C                | PIT<br>ST-C<br>ST-O | Y2<br>M3<br>M3 |                   |                    |               |
| Valve Name: |              | Control Room Outside Air Intake Isolation Valve          |                 |      |      |               |              |                     |                    |                    |                     |                |                   |                    |               |



## Heating, Ventilation and Air Conditioning (HVAC)

| Valve Tag   | P&ID         | P&ID<br>Coord.   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-FCV-25-18 | 2998 G 879-2 | C-17   | 3               | B    | 6    | BTF           | MO           | A                   | O                  | C                  | PIT          | Y2            | ST-C              | M3                |               |
| Valve Name: |              | Control Room Toilet Area Exhaust Isolation Valve       |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FCV-25-19 | 2998 G 879-2 | C-17   | 3               | B    | 6    | BTF           | MO           | A                   | O                  | C                  | PIT          | Y2            | ST-C              | M3                |               |
| Valve Name: |              | Control Room Toilet Area Exhaust Isolation Valve       |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FCV-25-2  | 2998 G 878   | C-3  | 2               | A    | 48   | BTF           | PO           | A                   | C                  | C                  | FSC          | CS            |                   | CS-16             | TP-03         |
|             |              | LT-J App J   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
|             |              | PIT CS   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
|             |              | ST-C M3 CS-16  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| Valve Name: |              | Containment Purge Isolation Valve                      |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FCV-25-20 | 2998 G 879-3 | M-1  | 2               | A    | 8    | BTF           | PO           | A                   | C                  | C                  | FSC          | M3            |                   |                   | TP-03         |
|             |              | LT-J App J   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
|             |              | PIT Y2   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
|             |              | ST-C M3  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| Valve Name: |              | Containment/Hydrogen Purge Containment Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FCV-25-21 | 2998 G 879-3 | M-2  | 2               | A    | 8    | BTF           | PO           | A                   | C                  | C                  | FSC          | M3            |                   |                   | TP-03         |
|             |              | LT-J App J   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
|             |              | PIT Y2   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
|             |              | ST-C M3  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| Valve Name: |              | Containment/Hydrogen Purge Containment Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FCV-25-24 | 2998 G 879-2 | A-17   | 3               | B    | 10   | BTF           | MO           | A                   | O                  | C                  | PIT          | Y2            |                   |                   |               |
|             |              | ST-C M3  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| Valve Name: |              | Control Room Kitchen Exhaust Isolation Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FCV-25-25 | 2998 G 879-2 | A-17   | 3               | B    | 10   | BTF           | MO           | A                   | O                  | C                  | PIT          | Y2            |                   |                   |               |
|             |              | ST-C M3  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| Valve Name: |              | Control Room Kitchen Exhaust Isolation Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FCV-25-26 | 2998 G 879-3 | N-2  | 2               | A    | 8    | BTF           | PO           | A                   | C                  | C                  | FSC          | M3            |                   |                   | TP-03         |
|             |              | LT-J App J   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
|             |              | PIT Y2   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
|             |              | ST-C M3  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| Valve Name: |              | Containment/Hydrogen Purge Containment Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag   | P&ID         | P&ID<br>Coord.   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.           | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|-------------------------|-------------------|-------------------|---------------|
| 2-FCV-25-29 | 2998 G 879-3 | K-3  | 2               | B    | 4    | BTF           | MO           | P                   | LC                 | N/A                | PIT                        | Y2                      |                   |                   |               |
|             | Valve Name:  | Containment/Hydrogen Purge to SBVS Crosstie Isolation  |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-25-3  | 2998 G 878   | C-3  | 2               | A    | 48   | BTF           | PO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | CS<br>App J<br>CS<br>M3 |                   | CS-16             | TP-03         |
|             | Valve Name:  | Containment Purge Isolation Valve                      |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-25-30 | 2998 G 879-3 | H-4  | 2               | B    | 20   | BTF           | MO           | A                   | O                  | O/C                | PIT                        | Y2                      |                   |                   |               |
|             |              |  |                 |      |      |               |              |                     |                    |                    | ST-C                       | M3                      |                   |                   |               |
|             |              |  |                 |      |      |               |              |                     |                    |                    | ST-O                       | M3                      |                   |                   |               |
|             | Valve Name:  | Fuel Pool Exhaust to SBVS Crosstie Isolation           |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-25-31 | 2998 G 879-3 | J-4  | 2               | B    | 20   | BTF           | MO           | A                   | O                  | O/C                | PIT                        | Y2                      |                   |                   |               |
|             |              |  |                 |      |      |               |              |                     |                    |                    | ST-C                       | M3                      |                   |                   |               |
|             |              |  |                 |      |      |               |              |                     |                    |                    | ST-O                       | M3                      |                   |                   |               |
|             | Valve Name:  | Fuel Pool Exhaust to SBVS Crosstie Isolation           |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-25-32 | 2998 G 879-3 | H-4  | 2               | B    | 30   | BTF           | MO           | A                   | C                  | O/C                | PIT                        | Y2                      |                   |                   |               |
|             |              |  |                 |      |      |               |              |                     |                    |                    | ST-C                       | M3                      |                   |                   |               |
|             |              |  |                 |      |      |               |              |                     |                    |                    | ST-O                       | M3                      |                   |                   |               |
|             | Valve Name:  | SBVS Suction Isolation Valve                           |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-25-33 | 2998 G 879-3 | J-4  | 2               | B    | 30   | BTF           | MO           | A                   | C                  | O/C                | PIT                        | Y2                      |                   |                   |               |
|             |              |  |                 |      |      |               |              |                     |                    |                    | ST-C                       | M3                      |                   |                   |               |
|             |              |  |                 |      |      |               |              |                     |                    |                    | ST-O                       | M3                      |                   |                   |               |
|             | Valve Name:  | SBVS Suction Isolation Valve                           |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-25-34 | 2998 G 879-3 | H-2  | 2               | B    | 4    | BTF           | MO           | P                   | LC                 | N/A                | PIT                        | Y2                      |                   |                   |               |
|             | Valve Name:  | Containment/Hydrogen Purge to SBVS Crosstie Isolation  |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-25-36 | 2998 G 879-3 | N-1  | 2               | A    | 8    | BTF           | PO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
|             | Valve Name:  | Containment/Hydrogen Purge Containment Isolation Valve |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |



| Valve Tag   | P&ID       | P&ID<br>Coor.                             | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type                       | Test<br>Freq.                 | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.           |
|-------------|------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|------------------------------------|-------------------------------|-------------------|-------------------|-------------------------|
| 2-FCV-25-4  | 2998 G 878 | C-6                                       | 2               | A    | 48   | BTF           | PO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C         | CS<br>App J<br>Y2<br>CS       |                   | CS-16             | TP-03                   |
| Valve Name: |            | Containment Purge Isolation Valve         |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                         |
| 2-FCV-25-5  | 2998 G 878 | C-7                                       | 2               | A    | 48   | BTF           | PO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C         | CS<br>App J<br>Y2<br>CS       |                   | CS-16             | TP-03                   |
| Valve Name: |            | Containment Purge Isolation Valve         |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                         |
| 2-FCV-25-6  | 2998 G 878 | C-8                                       | 2               | B    | 48   | BTF           | PO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C                 | CS<br>Y2<br>CS                |                   | CS-16             | TP-03                   |
| Valve Name: |            | Containment Purge Isolation Valve         |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                         |
| 2-FCV-25-7  | 2998 G 878 | C-15                                      | 2               | A/C  | 24   | BTF           | PO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03                   |
| Valve Name: |            | Containment Vacuum Relief Isolation Valve |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                         |
| 2-FCV-25-8  | 2998 G 878 | C-15                                      | 2               | A/C  | 24   | BTF           | PO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03                   |
| Valve Name: |            | Containment Vacuum Relief Isolation Valve |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                         |
| 2-V-25-20   | 2998 G 878 | C-13                                      | 2               | A/C  | 24   | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-J<br>VAC            | CM<br>CM<br>App J<br>CM       |                   |                   | TP-07<br>TP-07<br>TP-07 |
| Valve Name: |            | Containment Vacuum Relief Check Valve     |                 |      |      |               |              |                     |                    |                    |                                    |                               |                   |                   |                         |



| Valve Tag | P&ID         | P&ID<br>Coor. | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type                                      | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |  |  |  |  |  |  |  |  |  |
|-----------|--------------|---------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|---|---------------|-------------------|-------------------|---------------|--|--|--|--|--|--|--|--|--|
| 2-V-25-21 | 2998 G 878   | C-13          | 2               | A/C  | 24   | CK            | SA           | A                   | C                  | O/C                | CC  | CM            |                   |                   | TP-07         |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    | CO  | CM            |                   |                   | TP-07         |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    | LT-J  | App J         |                   |                   |               |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    | VAC   | CM            |                   |                   | TP-07         |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    | Valve Name: Containment Vacuum Relief Check Valve |               |                   |                   |               |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    |   |               |                   |                   |               |  |  |  |  |  |  |  |  |  |
| 2-V-25-23 | 2998 G 879-3 | J-4           | 2               | C    | 24   | CK            | SA           | A                   | C                  | O/C                | CCD   | CM            |                   |                   | TP-07         |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    | COF   | CM            |                   |                   | TP-07         |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    | Valve Name: SBVS Cooling Air Check Valve          |               |                   |                   |               |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    |   |               |                   |                   |               |  |  |  |  |  |  |  |  |  |
| 2-V-25-24 | 2998 G 879-3 | H-4           | 2               | C    | 24   | CK            | SA           | A                   | C                  | O/C                | CCD   | CM            |                   |                   | TP-07         |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    | COF   | CM            |                   |                   | TP-07         |  |  |  |  |  |  |  |  |  |
|           |              |               |                 |      |      |               |              |                     |                    |                    | Valve Name: SBVS Cooling Air Check Valve          |               |                   |                   |               |  |  |  |  |  |  |  |  |  |



**Instrument Air (IA)**

| Valve Tag  | P&ID          | P&ID Safety<br>Coord.                                       | Safety Class | Cat. | Size  | Valve Type | Act.<br>Type | Active /<br>Passive | Normal Position | Safety Position | Test Type         | Test Freq.     | Relief Request | Deferred Just. | Tech. Pos.         |
|------------|---------------|---|--------------|------|-------|------------|--------------|---------------------|-----------------|-----------------|-------------------|----------------|----------------|----------------|--------------------|
| 2-HCV-18-1 | 2998 G 085-2C | G-3   | 2            | A    | 1     | GL         | AO           | A                   | O               | C               | FSC LT-J PIT ST-C | CS App J Y2 CS |                | CS-15          | TP-03              |
|            | Valve Name:   | <b>Instrument Air Containment Isolation Valve (Pen P 9)</b> |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |
| 2-SR-18-6A | 2998 G 085-2A | D-2   | 2            | C    | 0.5x1 | RV         | SA           | A                   | C               | O/C             | RVT               | Y10            |                |                |                    |
|            | Valve Name:   | <b>Shield Building Hatch Door Seal Relief Valve</b>         |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |
| 2-SR-18-6B | 2998 G 085-2A | D-1   | 2            | C    | 0.5x1 | RV         | SA           | A                   | C               | O/C             | RVT               | Y10            |                |                |                    |
|            | Valve Name:   | <b>Shield Building Hatch Door Seal Relief Valve</b>         |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |
| 2-V-18195  | 2998 G 085-2A | E-6   | 2            | A/C  | 2     | CK         | SA           | A                   | O               | C               | CCL COF LT-J      | CM CM App J    |                |                | TP-07 TP-01, TP-07 |
|            | Valve Name:   | <b>Instrument Air Containment Isolation Valve (Pen P 9)</b> |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |
| 2-V-18279  | 2998 G 085-2A | B-2   | 2            | C    | 0.5   | CK         | SA           | A                   | C               | C               | CCL COF           | CM CM          |                |                | TP-07 TP-01, TP-07 |
|            | Valve Name:   | <b>Shield Bldg Hatch Door Seal Accumulator Check Valve</b>  |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |
| 2-V-18283  | 2998 G 085-2A | A-3   | 2            | C    | 0.5   | CK         | SA           | A                   | C               | C               | CCL COF           | CM CM          |                |                | TP-07 TP-01, TP-07 |
|            | Valve Name:   | <b>Shield Bldg Hatch Door Seal Accumulator Check Valve</b>  |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |
| 2-V-18290  | 2998 G 085-2A | G-2   | 2            | C    | 0.75  | CK         | SA           | A                   | C               | C               | CCL COF           | CM CM          |                |                | TP-07 TP-01, TP-07 |
|            | Valve Name:   | <b>Containment Vacuum Relief Accumulator Check Valve</b>    |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |
| 2-V-18291  | 2998 G 085-2A | G-2   | 2            | C    | 0.75  | CK         | SA           | A                   | C               | C               | CCL COF           | CM CM          |                |                | TP-07 TP-01, TP-07 |
|            | Valve Name:   | <b>Containment Vacuum Relief Accumulator Check Valve</b>    |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |
| 2-V-18294  | 2998 G 085-2A | H-2   | 2            | C    | 0.75  | CK         | SA           | A                   | C               | C               | CCL COF           | CM CM          |                |                | TP-07 TP-01, TP-07 |
|            | Valve Name:   | <b>Containment Vacuum Relief Accumulator Check Valve</b>    |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |
| 2-V-18295  | 2998 G 085-2A | H-2   | 2            | C    | 0.75  | CK         | SA           | A                   | C               | C               | CCL COF           | CM CM          |                |                | TP-07 TP-01, TP-07 |
|            | Valve Name:   | <b>Containment Vacuum Relief Accumulator Check Valve</b>    |              |      |       |            |              |                     |                 |                 |                   |                |                |                |                    |



| Valve Tag   | P&ID         | P&ID<br>Coor.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type       | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------------|----------------|-------------------|-------------------|---------------|
| 2-HCV-21-7A | 2998 G 082-2 | D-4  | 3               | B    | 6    | GL            | PO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   |               |
| Valve Name: |              | SS-21-2A Debris Discharge Isolation                    |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-HCV-21-7B | 2998 G 082-2 | D-7  | 3               | B    | 6    | GL            | PO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   |               |
| Valve Name: |              | SS-21-2B Debris Discharge Isolation                    |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-21-2   | 2998 G 082-2 | F-4  | 3               | B    | 24   | BTF           | MO           | A                   | O                  | C                  | PIT<br>ST-C        | Y2<br>M3       |                   |                   |               |
| Valve Name: |              | Turbine Cooling Water Header Isolation Valve           |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-MV-21-3   | 2998 G 082-2 | G-4  | 3               | B    | 24   | BTF           | MO           | A                   | O                  | C                  | PIT<br>ST-C        | Y2<br>M3       |                   |                   |               |
| Valve Name: |              | Turbine Cooling Water Header Isolation Valve           |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-SB-21385  | 2998 G 082-2 | B-3  | 3               | B    | 3    | BTF           | M            | A                   | C                  | O                  | ME                 | Y2             |                   |                   | TP-04         |
| Valve Name: |              | Emergency Make up to Fuel Pool from SS 21 1A, 1B Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-SB-21386  | 2998 G 082-2 | C-7  | 3               | B    | 3    | BTF           | M            | A                   | C                  | O                  | ME                 | Y2             |                   |                   | TP-04         |
| Valve Name: |              | Emergency Make up to Fuel Pool From SS 21 1A, 1B       |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-SH-212023 | 2998 G 082-2 | B-4  | 3               | B    | 1    | BAL           | M            | A                   | O                  | C                  | ME                 | Y2             |                   |                   | TP-04         |
| Valve Name: |              | Emerg Make up to SFP Train 2A Drain Valves             |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-SH-212024 | 2998 G 082-2 | C-7  | 3               | B    | 1    | BAL           | M            | A                   | O                  | C                  | ME                 | Y2             |                   |                   | TP-04         |
| Valve Name: |              | Emerg Make up to SFP Train 2B Drain Valves             |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-TCV-14-4A | 2998 G 082-2 | A-5  | 3               | B    | 30   | BTF           | PO           | A                   | O                  | O                  | FSO<br>ST-O        | M3<br>M3       |                   |                   | TP-03         |
| Valve Name: |              | CCW Heat Exchanger Temp. Control Valve                 |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-TCV-14-4B | 2998 G 082-2 | A-6  | 3               | B    | 30   | BTF           | PO           | A                   | O                  | O                  | FSO<br>ST-O        | M3<br>M3       |                   |                   | TP-03         |
| Valve Name: |              | CCW Heat Exchanger Temp. Control Valve                 |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-21162   | 2998 G 082-2 | G-5  | 3               | C    | 30   | CK            | SA           | A                   | O                  | O/C                | CC<br>CO           | M3<br>M3       |                   |                   |               |
| Valve Name: |              | 2A ICW Pump Discharge Check Valve                      |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |



| Valve Tag   | P&ID         | P&ID<br>Coord.                           | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|-----------------------|
| 2-V-21205   | 2998 G 082-2 | G-6                                      | 3               | C    | 30   | CK            | SA           | A                   | O                  | O/C                | CC<br>CO     | M3<br>M3      |                   |                   |                       |
| Valve Name: |              | 2C ICW Pump Discharge Check Valve        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-21208   | 2998 G 082-2 | G-7                                      | 3               | C    | 30   | CK            | SA           | A                   | O                  | O/C                | CC<br>CO     | M3<br>M3      |                   |                   |                       |
| Valve Name: |              | 2B ICW Pump Discharge Check Valve        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-21402   | 2998 G 082-2 | D-4                                      | 3               | C    | 2    | CK            | SA           | A                   | O                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
| Valve Name: |              | CCW Hx Outlet Vacuum Breaker Check Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-21403   | 2998 G 082-2 | D-7                                      | 3               | C    | 2    | CK            | SA           | A                   | O                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
| Valve Name: |              | CCW Hx Outlet Vacuum Breaker Check Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |



### Integrated Leak Rate Penetrations (ILRT)

| Valve Tag | P&ID         | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|--------------|---|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-00101 | 2998 G 091-1 | B-5   | 2               | A    | 8     | GA            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|           | Valve Name:  | Isolation Valve for Containment ILRT Press                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-00139 | 2998 G 091-1 | C-4   | 2               | A    | 0.375 | GL            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|           | Valve Name:  | Isolation Valve (Pen P 52E) for Containment ILRT Pressure   |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-00140 | 2998 G 091-1 | D-4   | 2               | A    | 1     | GL            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|           | Valve Name:  | Isolation Valve (Pen P 52D) for Containment ILRT Controlled |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-00143 | 2998 G 091-1 | D-5   | 2               | A    | 1     | GL            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|           | Valve Name:  | Isolation Valve (Pen P 52D) for Containment ILRT Controlled |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-00144 | 2998 G 091-1 | C-5   | 2               | A    | 0.375 | GL            | M            | P                   | LC                 | C                  | LT-J         | App J         |                   |                   |               |
|           | Valve Name:  | Containment ILRT Pressure Sensing Isolation Valve           |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |



### Main Steam (MS)

| Valve Tag   | P&ID         | P&ID<br>Coor.                                       | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-HCV-08-1A | 2998 G 079-1 | C-6   | 2               | B    | 34   | GL            | AO           | A                   | O                  | C                  | PIT          | Y2            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-C         | CS            |                   | CS-09             |               |
|             | Valve Name:  | Main Steam Isolation Valve (MSIV)                   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-HCV-08-1B | 2998 G 079-1 | E-6   | 2               | B    | 34   | GL            | AO           | A                   | O                  | C                  | PIT          | Y2            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-C         | CS            |                   | CS-09             |               |
|             | Valve Name:  | Main Steam Isolation Valve (MSIV)                   |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-08-12  | 2998 G 079-1 | G-4   | 2               | B    | 4    | GA            | MO           | A                   | C                  | O/C                | PIT          | Y2            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Auxiliary Feedwater Pump Turbine Steam Supply Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-08-13  | 2998 G 079-1 | G-4   | 2               | B    | 4    | GA            | MO           | A                   | C                  | O/C                | PIT          | Y2            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Auxiliary Feedwater Pump Turbine Steam Supply Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-08-14  | 2998 G 079-1 | B-4   | 2               | B    | 8    | GA            | MO           | P                   | LO                 | O/C                | PIT          | Y2            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   | TP-11         |
|             | Valve Name:  | Main Steamline Atmospheric Dump Block Valve         |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-08-15  | 2998 G 079-1 | B-4   | 2               | B    | 8    | GA            | MO           | P                   | LO                 | O/C                | PIT          | Y2            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   | TP-11         |
|             | Valve Name:  | Main Steamline Atmospheric Dump Block Valve         |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-08-16  | 2998 G 079-1 | E-4   | 2               | B    | 8    | GA            | MO           | P                   | LO                 | O/C                | PIT          | Y2            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   | TP-11         |
|             | Valve Name:  | Main Steamline Atmospheric Dump Block Valve         |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-08-17  | 2998 G 079-1 | E-4   | 2               | B    | 8    | GA            | MO           | P                   | LO                 | O/C                | PIT          | Y2            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   | TP-11         |
|             | Valve Name:  | Main Steamline Atmospheric Dump Block Valve         |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-MV-08-18A | 2998 G 079-1 | A-4   | 2               | B    | 10   | ANG           | MO           | A                   | C                  | O/C                | PIT          | Y2            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |   |                 |      |      |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Main Steamline Atmospheric Dump Valve               |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



### Main Steam (MS)

[illegible]



| Valve Tag   | P&ID                                 | P&ID<br>Coor.                    | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------------------------------|----------------------------------|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-SE-08-935 | 2998 G 079-7                         | F-5                              | 2               | B    | 0.375 | 3W            | SO           | A                   | Flow               | Vent               | ST-O         | CS            |                   |                   | TP-03, TP-09  |
|             | Valve Name:                          | MSIV Instrument Air Supply Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08130   | 2998 G 079-1                         | G-4                              | 3               | C    | 4     | CK            | SA           | A                   | O                  | O/C                | CCD          | CM            |                   |                   | TP-07         |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | COD          | CM            |                   |                   | TP-07         |
| Valve Name: | AFW Turbine Steam Supply Check Valve |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08163   | 2998 G 079-1                         | G-4                              | 3               | C    | 4     | CK            | SA           | A                   | O                  | O/C                | CCD          | CM            |                   |                   | TP-07         |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | COD          | CM            |                   |                   | TP-07         |
| Valve Name: | AFW Turbine Steam Supply Check Valve |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08887   | 2998 G 079-7                         | C-2                              | 2               | B    | 1     | 3W            | AO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | ST-O         | CS            |                   |                   | TP-09         |
| Valve Name: | MSIV 1A Control Valve 2              |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08888   | 2998 G 079-7                         | C-3                              | 2               | B    | 1     | 3W            | AO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | ST-O         | CS            |                   |                   | TP-09         |
| Valve Name: | MSIV 1A Control Valve 3              |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08889   | 2998 G 079-7                         | C-4                              | 2               | B    | 1     | 3W            | AO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | ST-O         | CS            |                   |                   | TP-09         |
| Valve Name: | MSIV 1A Control Valve 4              |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08890   | 2998 G 079-7                         | C-5                              | 2               | B    | 1     | 3W            | AO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | ST-O         | CS            |                   |                   | TP-09         |
| Valve Name: | MSIV 1A Control Valve 5              |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08925   | 2998 G 079-7                         | G-2                              | 2               | B    | 1     | 3W            | AO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | ST-O         | CS            |                   |                   | TP-09         |
| Valve Name: | MSIV 1B Control Valve 2              |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08926   | 2998 G 079-7                         | G-3                              | 2               | B    | 1     | 3W            | AO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | ST-O         | CS            |                   |                   | TP-09         |
| Valve Name: | MSIV 1B Control Valve 3              |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08927   | 2998 G 079-7                         | G-4                              | 2               | B    | 1     | 3W            | AO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | ST-O         | CS            |                   |                   | TP-09         |
| Valve Name: | MSIV 1B Control Valve 4              |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08928   | 2998 G 079-7                         | G-5                              | 2               | B    | 1     | 3W            | AO           | A                   | Flow               | Vent               | FSV          | CS            |                   |                   | TP-03, TP-09  |
|             |                                      |                                  |                 |      |       |               |              |                     |                    |                    | ST-O         | CS            |                   |                   | TP-09         |
| Valve Name: | MSIV 1B Control Valve 5              |                                  |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |



### Main Steam (MS)

| Valve Tag | P&ID         | P&ID Safety<br>Coord.                       | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|--------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-08965 | 2998 G 079-7 | A-3   | 2               | B    |      | CK            | SA           | A                   | C                  | O                  | CO           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | MSIV 1A Actuator Vacuum Breaker Check Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-08966 | 2998 G 079-7 | E-3   | 2               | B    |      | CK            | SA           | A                   | C                  | O                  | CO           | CS            |                   |                   | TP-09         |
|           | Valve Name:  | MSIV 1B Actuator Vacuum Breaker Check Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8201  | 2998 G 079-1 | B-5   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8202  | 2998 G 079-1 | B-5   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8203  | 2998 G 079-1 | B-5   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8204  | 2998 G 079-1 | B-5   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8205  | 2998 G 079-1 | E-5   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8206  | 2998 G 079-1 | D-5   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8207  | 2998 G 079-1 | E-5   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8208  | 2998 G 079-1 | D-5   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8209  | 2998 G 079-1 | B-6   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8210  | 2998 G 079-1 | B-6   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8211  | 2998 G 079-1 | B-6   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8212  | 2998 G 079-1 | B-6   | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



### Main Steam (MS)

| Valve Tag | P&ID         | P&ID<br>Coor.           | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|--------------|-------------------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-8213  | 2998 G 079-1 | E-6                     | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8214  | 2998 G 079-1 | D-6                     | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8215  | 2998 G 079-1 | E-6                     | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-8216  | 2998 G 079-1 | D-6                     | 2               | C    | 6x10 | SV            | SA           | A                   | C                  | O/C                | RVT          | Y5            |                   |                   |               |
|           | Valve Name:  | Main Steam Safety Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag  | P&ID         | P&ID<br>Coor.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.           | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|------------|--------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|-------------------------|-------------------|-------------------|---------------|
| 2-FCV-26-1 | 2998 G 092-1 | B-2  | 2               | A    | 1    | GL            | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
|            | Valve Name:  | Containment Air Radiation Monitors Containment Isolation |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-26-2 | 2998 G 092-1 | B-2  | 2               | A    | 1    | GL            | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
|            | Valve Name:  | Containment Air Radiation Monitors Containment Isolation |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-26-3 | 2998 G 092-1 | B-3  | 2               | A    | 1    | GL            | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
|            | Valve Name:  | Containment Air Radiation Monitors Containment Isolation |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-26-4 | 2998 G 092-1 | B-3  | 2               | A    | 1    | GL            | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
|            | Valve Name:  | Containment Air Radiation Monitors Containment Isolation |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-26-5 | 2998 G 092-1 | B-3  | 2               | A    | 1    | GL            | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
|            | Valve Name:  | Containment Air Radiation Monitors Containment Isolation |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-FCV-26-6 | 2998 G 092-1 | B-3  | 2               | A    | 1    | GL            | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
|            | Valve Name:  | Containment Air Radiation Monitors Containment Isolation |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |



| Valve Tag   | P&ID         | P&ID<br>Coord.                  | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|---------------------------------|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-FSE-27-10 | 2998 G 092-1 | A-5                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FSE-27-11 | 2998 G 092-1 | B-5                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FSE-27-12 | 2998 G 092-1 | B-6                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FSE-27-13 | 2998 G 092-1 | A-6                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FSE-27-14 | 2998 G 092-1 | A-6                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FSE-27-15 | 2998 G 092-1 | B-6                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |



| Valve Tag   | P&ID         | P&ID<br>Coord.                  | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|---------------------------------|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-FSE-27-16 | 2998 G 092-1 | B-6                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FSE-27-17 | 2998 G 092-1 | B-6                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FSE-27-18 | 2998 G 092-1 | B-6                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FSE-27-8  | 2998 G 092-1 | A-5                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-FSE-27-9  | 2998 G 092-1 | A-5                             | 2               | A    | 0.375 | GL            | SO           | A                   | C                  | O/C                | FSC          | M3            |                   |                   | TP-03         |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|             |              |                                 |                 |      |       |               |              |                     |                    |                    | ST-O         | M3            |                   |                   |               |
|             | Valve Name:  | Hydrogen Sample Isolation Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SE-07-5A  | 2998 G 088-2 | C-6                             | 2               | B    | 0.375 | GL            | SO           | P                   | O                  | O                  | PIT          | Y2            |                   |                   | TP-11         |
|             | Valve Name:  | Solenoid Valve for Pen P 55     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SE-07-5B  | 2998 G 088-2 | D-6                             | 2               | B    | 0.375 | GL            | SO           | P                   | O                  | O                  | PIT          | Y2            |                   |                   | TP-11         |
|             | Valve Name:  | Solenoid Valve for Pen P 72     |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |



### Miscellaneous Sampling (M-SAM)

| Valve Tag   | P&ID  | P&ID<br>Coor.               | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|---|-----------------------------|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-SE-07-5C  | 2998 G 088-2                                    | D-6                         | 2               | B    | 0.375 | GL            | SO           | P                   | O                  | O                  | PIT          | Y2            |                   |                   | TP-11         |
|             | Valve Name:                                     | Solenoid Valve for Pen P 58 |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-SE-07-5D  | 2998 G 088-2                                    | D-6                         | 2               | B    | 0.375 | GL            | SO           | P                   | O                  | O                  | PIT          | Y2            |                   |                   | TP-11         |
|             | Valve Name:                                     | Solenoid Valve for Pen P 71 |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-27101   | 2998 G 092-1                                    | B-6                         | 2               | A/C  | 0.375 | CK            | SA           | A                   | C                  | O/C                | CC           | CM            |                   |                   | TP-07         |
|             |   |                             |                 |      |       |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
|             |   |                             |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             | Valve Name:                                     | Hydrogen Sample Check Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-27102   | 2998 G 092-1                                    | B-6                         | 2               | A/C  | 0.375 | CK            | SA           | A                   | C                  | O/C                | CC           | CM            |                   |                   | TP-07         |
|             |   |                             |                 |      |       |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
|             |   |                             |                 |      |       |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|             | Valve Name:                                     | Hydrogen Sample Check Valve |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-29455   | 2998 G 092-1                                    | F-5                         | 2               | C    | 0.5   | CK            | SA           | A                   | C                  | O                  | CC           | CM            |                   |                   | TP-01, TP-07  |
|             |   |                             |                 |      |       |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
| Valve Name: | Check Valve for Oxygen to Hydrogen Analyzers 2A |                             |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-29456   | 2998 G 092-1                                    | F-5                         | 2               | C    | 0.5   | CK            | SA           | A                   | C                  | O                  | CC           | CM            |                   |                   | TP-01, TP-07  |
|             |   |                             |                 |      |       |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-07         |
| Valve Name: | Check Valve for Oxygen to Hydrogen Analyzers 2B |                             |                 |      |       |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



| Valve Tag | P&ID           | P&ID<br>Coord.                  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.        | Relief<br>Request | Deferred<br>Just.           | Tech.<br>Pos. |
|-----------|----------------|---------------------------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|----------------------|-------------------|-----------------------------|---------------|
| 2-V-1200  | 2998 G 078-109 | C-4                             | 1               | C    | 3    | SV            | SA           | A                   | C                  | O/C                | RVT                        | Y5                   |                   |                             |               |
|           | Valve Name:    | Pressurizer Safety/Relief Valve |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                             |               |
| 2-V-1201  | 2998 G 078-109 | C-4                             | 1               | C    | 3    | SV            | SA           | A                   | C                  | O/C                | RVT                        | Y5                   |                   |                             |               |
|           | Valve Name:    | Pressurizer Safety/Relief Valve |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                             |               |
| 2-V-1202  | 2998 G 078-109 | C-4                             | 1               | C    | 3    | SV            | SA           | A                   | C                  | O/C                | RVT                        | Y5                   |                   |                             |               |
|           | Valve Name:    | Pressurizer Safety/Relief Valve |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                             |               |
| 2-V-1460  | 2998 G 078-107 | C-5                             | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | CS<br>Y2<br>CS<br>CS |                   | CS-02<br><br>CS-02<br>CS-02 | TP-03         |
|           | Valve Name:    | Reactor Coolant Gas Vent Valve  |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                             |               |
| 2-V-1461  | 2998 G 078-107 | D-5                             | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | CS<br>Y2<br>CS<br>CS |                   | CS-02<br><br>CS-02<br>CS-02 | TP-03         |
|           | Valve Name:    | Reactor Coolant Gas Vent Valve  |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                             |               |
| 2-V-1462  | 2998 G 078-107 | D-5                             | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | CS<br>Y2<br>CS<br>CS |                   | CS-02<br><br>CS-02<br>CS-02 | TP-03         |
|           | Valve Name:    | Reactor Coolant Gas Vent Valve  |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                             |               |
| 2-V-1463  | 2998 G 078-107 | E-5                             | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | CS<br>Y2<br>CS<br>CS |                   | CS-02<br><br>CS-02<br>CS-02 | TP-03         |
|           | Valve Name:    | Reactor Coolant Gas Vent Valve  |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                             |               |
| 2-V-1464  | 2998 G 078-107 | D-6                             | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC<br>PIT<br>ST-C<br>ST-O | CS<br>Y2<br>CS<br>CS |                   | CS-02<br><br>CS-02<br>CS-02 | TP-03         |
|           | Valve Name:    | Reactor Coolant Gas Vent Valve  |                 |      |      |               |              |                     |                    |                    |                            |                      |                   |                             |               |



[illegible]



### Service Air (SA)

[illegible]



### Sampling System (SAM)

[illegible]



[illegible]



### Steam Generator Blowdown (SGBD)

| Valve Tag   | P&ID         | P&ID<br>Coord.                        | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type       | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|--------------|---------------------------------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------------|----------------|-------------------|-------------------|---------------|
| 2-FCV-23-3  | 2998 G 086-1 | C-6                                   | 2               | B    | 3    | GL            | AO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | 2A Steam Generator Blowdown Isolation |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-FCV-23-5  | 2998 G 086-1 | C-6                                   | 2               | B    | 3    | GL            | AO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | 2B Steam Generator Blowdown Isolation |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-FCV-23-7  | 2998 G 086-1 | C-7                                   | 2               | B    | 0.5  | GL            | AO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>CS |                   |                   | TP-03         |
| Valve Name: |              | 2A Steam Generator Blowdown Isolation |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-FCV-23-9  | 2998 G 086-1 | C-6                                   | 2               | B    | 0.5  | GL            | AO           | A                   | O                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |              | 2B Steam Generator Blowdown Isolation |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |



### Safety Injection (SI)

[illegible]



### Safety Injection (SI)

[illegible]



[illegible]



| Valve Tag   | P&ID            | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type                       | Test<br>Freq.                 | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-------------|-----------------|---|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|------------------------------------|-------------------------------|-------------------|-------------------|-----------------------|
| 2-SE-03-1D  | 2998 G 078-132  | G-6   | 2               | B    | 1     | GL            | SO           | A                   | C                  | O/C                | FSC<br>PIT<br>ST-C<br>ST-O         | M3<br>Y2<br>M3<br>M3          |                   |                   | TP-03                 |
| Valve Name: |                 | SI Tank Drain/fill Isolation Valve                      |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                       |
| 2-SE-03-2A  | 2998 G 078-130B | B-7   | 2               | A    | 2     | GL            | SO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03                 |
| Valve Name: |                 | SI Tank Drain/Test Line to RWT                          |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                       |
| 2-SE-03-2B  | 2998 G 078-130B | C-7   | 2               | A    | 2     | GL            | SO           | A                   | C                  | O/C                | FSC<br>LT-J<br>PIT<br>ST-C<br>ST-O | M3<br>App J<br>Y2<br>M3<br>M3 |                   |                   | TP-03                 |
| Valve Name: |                 | SI Tank Drain/Test Line to RWT                          |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                       |
| 2-SR-03-1   | 2998 G 078-130B | G-6   | 3               | C    | 3/4x1 | RV            | SA           | A                   | C                  | O/C                | RVT                                | Y10                           |                   |                   | TP-08                 |
| Valve Name: |                 | Shutdown Cooling To/From CVCS Purification Relief Valve |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                       |
| 2-SR-03-2   | 2998 G 078-131  | D-3   | 3               | C    | 3/4x1 | RV            | SA           | A                   | C                  | O/C                | RVT                                | Y10                           |                   |                   | TP-08                 |
| Valve Name: |                 | Shutdown Cooling To/From CVCS Purification              |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                       |
| 2-SR-07-1A  | 2998 G 078-130B | E-1   | 2               | C    | 3/4x1 | RV            | SA           | A                   | C                  | O                  | RVT                                | Y10                           |                   |                   |                       |
| Valve Name: |                 | Safety Injection Pumps Suction Header Relief Valve      |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                       |
| 2-SR-07-1B  | 2998 G 078-130B | G-1   | 2               | C    | 3/4x1 | RV            | SA           | A                   | C                  | O                  | RVT                                | Y10                           |                   |                   |                       |
| Valve Name: |                 | Safety Injection Pumps Suction Header Relief Valve      |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                       |
| 2-V-03002   | 2998 G 078-132  | C-5   | 3               | C    | 1     | CK            | SA           | A                   | C                  | O                  | CC<br>CO                           | CM<br>CM                      |                   |                   | TP-01, TP-07<br>TP-07 |
| Valve Name: |                 | SIT Drain To RWT Check Valve                            |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                       |
| 2-V-03003   | 2998 G 078-132  | G-2   | 3               | C    | 1     | CK            | SA           | A                   | C                  | O                  | CC<br>CO                           | CM<br>CM                      |                   |                   | TP-01, TP-07<br>TP-07 |
| Valve Name: |                 | SIT Drain To RWT Check Valve                            |                 |      |       |               |              |                     |                    |                    |                                    |                               |                   |                   |                       |



| Valve Tag | P&ID            | P&ID Safety<br>Coord.                        | Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-----------|-----------------|--|-------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|-----------------------|
| 2-V-03004 | 2998 G 078-132  | C-2  | 3     | C    | 1    | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | SIT Drain To RWT Check Valve                 |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-03005 | 2998 G 078-132  | G-5  | 3     | C    | 1    | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | SIT Drain To RWT Check Valve                 |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-07000 | 2998 G 078-130B | E-1  | 2     | C    | 14   | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | 2A LPSI Pump Suction Check Valve             |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-07001 | 2998 G 078-130B | F-1  | 2     | C    | 14   | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | 2B LPSI Pump Suction Check Valve             |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-07172 | 2998 G 088-2    | G-2  | 2     | C    | 24   | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | SI Pump Containment Sump Suction Check Valve |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-07174 | 2998 G 088-2    | G-2  | 2     | C    | 24   | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | SI Pump Containment Sump Suction Check Valve |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-3101  | 2998 G 078-130B | B-6  | 3     | C    | 2    | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | Safety Injection Supply To VCT               |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-3102  | 2998 G 078-130A | B-3  | 2     | C    | 2    | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | 2A HPSI Minimum Flow Check Valve             |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-3103  | 2998 G 078-130A | E-4  | 2     | C    | 2    | CK            | SA           | A                   | C                  | O                  | CC<br>CO     | CM<br>CM      |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | 2B HPSI Minimum Flow Check Valve             |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |
| 2-V-3104  | 2998 G 078-130B | F-3  | 2     | C    | 2    | CK            | SA           | A                   | C                  | O/C                | CC<br>CO     | CM<br>CM      |                   |                   | TP-07<br>TP-07        |
|           | Valve Name:     | 2A LPSI Minimum Flow Check Valve             |       |      |      |               |              |                     |                    |                    |              |               |                   |                   |                       |



[illegible]



[illegible]



### Safety Injection (SI)

| Valve Tag | P&ID            | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size    | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type     | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.         |
|-----------|-----------------|---|-----------------|------|---------|---------------|--------------|---------------------|--------------------|--------------------|------------------|----------------|-------------------|-------------------|-----------------------|
| 2-V-3241  | 2998 G 078-132  | E-6   | 2               | C    | 1.5x2.5 | RV            | SA           | A                   | C                  | O/C                | RVT              | Y10            |                   |                   |                       |
|           | Valve Name:     | <b>2B2 Safety Injection Tank Relief Valve</b>           |                 |      |         |               |              |                     |                    |                    |                  |                |                   |                   |                       |
| 2-V-3245  | 2998 G 078-132  | G-6   | 2               | A/C  | 12      | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07        |
|           | Valve Name:     | <b>2B2 Safety Injection Tank Discharge Check Valve</b>  |                 |      |         |               |              |                     |                    |                    |                  |                |                   |                   |                       |
| 2-V-3247  | 2998 G 078-132  | H-7   | 1               | A/C  | 12      | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07        |
|           | Valve Name:     | <b>2A2 SI Header Inboard Check Valve</b>                |                 |      |         |               |              |                     |                    |                    |                  |                |                   |                   |                       |
| 2-V-3258  | 2998 G 078-132  | D-3   | 1               | A/C  | 6       | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07        |
|           | Valve Name:     | <b>2A1 SI Header Outboard Check Valve</b>               |                 |      |         |               |              |                     |                    |                    |                  |                |                   |                   |                       |
| 2-V-3259  | 2998 G 078-132  | D-6   | 1               | A/C  | 6       | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07        |
|           | Valve Name:     | <b>2A2 SI Header Outboard Check Valve</b>               |                 |      |         |               |              |                     |                    |                    |                  |                |                   |                   |                       |
| 2-V-3260  | 2998 G 078-132  | H-3   | 1               | A/C  | 6       | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07        |
|           | Valve Name:     | <b>2B1 SI Header Outboard Check Valve</b>               |                 |      |         |               |              |                     |                    |                    |                  |                |                   |                   |                       |
| 2-V-3261  | 2998 G 078-132  | H-6   | 1               | A/C  | 6       | CK            | SA           | A                   | C                  | O/C                | CC<br>CO<br>LT-S | CM<br>CM<br>Y2 |                   |                   | TP-07<br>TP-07        |
|           | Valve Name:     | <b>2B2 SI Header Outboard Check Valve</b>               |                 |      |         |               |              |                     |                    |                    |                  |                |                   |                   |                       |
| 2-V-3401  | 2998 G 078-130A | B-2   | 2               | C    | 6       | CK            | SA           | A                   | C                  | O                  | CC<br>CO         | CM<br>CM       |                   |                   | TP-01, TP-07<br>TP-07 |
|           | Valve Name:     | <b>HPSI Pump Suction Check Valve</b>                    |                 |      |         |               |              |                     |                    |                    |                  |                |                   |                   |                       |
| 2-V-3407  | 2998 G 078-130B | B-6   | 3               | C    | 1/2 x 1 | RV            | SA           | A                   | C                  | O/C                | RVT              | Y10            |                   |                   | TP-08                 |
|           | Valve Name:     | <b>Safety Injection Tank Recirculation Relief Valve</b> |                 |      |         |               |              |                     |                    |                    |                  |                |                   |                   |                       |



[illegible]



| Valve Tag   | P&ID            | P&ID<br>Coord.                                   | Safety<br>Class | Cat. | Size  | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type                | Test<br>Freq.        | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos.  |
|-------------|-----------------|--|-----------------|------|-------|---------------|--------------|---------------------|--------------------|--------------------|-----------------------------|----------------------|-------------------|-------------------|----------------|
| 2-V-3463    | 2998 G 078-130B | B-6  | 2               | A    | 2     | GA            | M            | A                   | LC                 | O/C                | LT-J<br>ME                  | App J<br>Y2          |                   |                   | TP-04          |
| Valve Name: |                 | SI Tank Drain/Test Line to RWT                   |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |
| 2-V-3466    | 2998 G 078-130B | A-7  | 3               | C    | 1.5x2 | RV            | SA           | A                   | C                  | O/C                | RVT                         | Y10                  |                   |                   |                |
| Valve Name: |                 | SI Check Valve Leakage Test Line Relief Valve    |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |
| 2-V-3468    | 2998 G 078-131  | D-2  | 2               | C    | 2x3   | RV            | SA           | A                   | C                  | O/C                | RVT                         | Y10                  |                   |                   | TP-08          |
| Valve Name: |                 | 2B Shutdown Cooling Suction Relief Valve         |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |
| 2-V-3469    | 2998 G 078-131  | D-6  | 1               | C    | 0.75  | RV            | SA           | A                   | C                  | O/C                | RVT                         | Y5                   |                   |                   |                |
| Valve Name: |                 | 2B Shutdown Cooling Isolation Relief Valve       |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |
| 2-V-3480    | 2998 G 078-131  | D-7  | 1               | A    | 10    | GA            | MO           | A                   | LC                 | O/C                | LT-S<br>PIT<br>ST-C<br>ST-O | Y2<br>Y2<br>CS<br>CS |                   | CS-08<br>CS-08    |                |
| Valve Name: |                 | 2A Shutdown Cooling Isolation Valve              |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |
| 2-V-3481    | 2998 G 078-131  | D-6  | 1               | A    | 10    | GA            | MO           | A                   | LC                 | O/C                | LT-S<br>PIT<br>ST-C<br>ST-O | Y2<br>Y2<br>CS<br>CS |                   | CS-08<br>CS-08    |                |
| Valve Name: |                 | 2A Shutdown Cooling Isolation Valve              |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |
| 2-V-3482    | 2998 G 078-131  | D-6  | 1               | C    | 0.75  | RV            | SA           | A                   | C                  | O/C                | RVT                         | Y5                   |                   |                   |                |
| Valve Name: |                 | 2A Shutdown Cooling Isolation Relief Valve       |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |
| 2-V-3483    | 2998 G 078-131  | D-2  | 2               | C    | 2x3   | RV            | SA           | A                   | C                  | O/C                | RVT                         | Y10                  |                   |                   | TP-08          |
| Valve Name: |                 | 2A Shutdown Cooling Suction Relief Valve         |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |
| 2-V-3495    | 2998 G 078-130B | B-4  | 2               | B    | 6     | GL            | SO           | A                   | LO                 | O/C                | FSC<br>PIT<br>ST-C          | M3<br>Y2<br>M3       |                   |                   | TP-03<br>TP-11 |
| Valve Name: |                 | A Train SI Pump Common Mini Flow Isolation Valve |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |
| 2-V-3496    | 2998 G 078-130B | B-3  | 2               | B    | 6     | GL            | SO           | A                   | LO                 | O/C                | FSC<br>PIT<br>ST-C          | M3<br>Y2<br>M3       |                   |                   | TP-03<br>TP-11 |
| Valve Name: |                 | B Train SI Pump Common Mini Flow Isolation Valve |                 |      |       |               |              |                     |                    |                    |                             |                      |                   |                   |                |



### Safety Injection (SI)

[illegible]



[illegible]



| Valve Tag   | P&ID           | P&ID<br>Coord.                         | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type       | Test<br>Freq.  | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-------------|----------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------------|----------------|-------------------|-------------------|---------------|
| 2-V-3572    | 2998 G 078-131 | C-6                                    | 1               | B    | 1    | GL            | AO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | SIT Fill Line Isolation Valve          |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3611    | 2998 G 078-132 | C-6                                    | 2               | B    | 1    | GL            | AO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | 2A2 SI Tank Drain/Fill Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3612    | 2998 G 078-132 | B-6                                    | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |                | 2A2 SI Tank Nitrogen Supply Valve      |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3614    | 2998 G 078-132 | C-6                                    | 1               | B    | 12   | GA            | MO           | P                   | LO                 | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |                | 2A2 SI Tank Outlet Isolation Valve     |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3621    | 2998 G 078-132 | C-3                                    | 2               | B    | 1    | GL            | AO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | 2A1 SI Tank Drain/Fill Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3622    | 2998 G 078-132 | B-3                                    | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |                | 2A1 SI Tank Nitrogen Supply Valve      |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3624    | 2998 G 078-132 | C-3                                    | 1               | B    | 12   | GA            | MO           | P                   | LO                 | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |                | 2A1 SI Tank Outlet Isolation Valve     |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3631    | 2998 G 078-132 | G-3                                    | 2               | B    | 1    | GL            | AO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | 2B1 SI Tank Drain/Fill Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3632    | 2998 G 078-132 | F-3                                    | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |                | 2B1 SI Tank Nitrogen Supply Valve      |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3634    | 2998 G 078-132 | G-3                                    | 1               | B    | 12   | GA            | MO           | P                   | LO                 | O                  | PIT                | Y2             |                   |                   |               |
| Valve Name: |                | 2B1 SI Tank Outlet Isolation Valve     |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |
| 2-V-3641    | 2998 G 078-132 | G-6                                    | 2               | B    | 1    | GL            | AO           | A                   | C                  | C                  | FSC<br>PIT<br>ST-C | M3<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name: |                | 2B2 SI Tank Drain/Fill Isolation Valve |                 |      |      |               |              |                     |                    |                    |                    |                |                   |                   |               |



| Valve Tag | P&ID            | P&ID<br>Coord.                                   | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|-----------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-3642  | 2998 G 078-132  | F-6  | 2               | B    | 0.5  | GL            | AO           | P                   | C                  | C                  | PIT          | Y2            |                   |                   |               |
|           | Valve Name:     | 2B2 SI Tank Nitrogen Supply Valve                |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-3644  | 2998 G 078-132  | G-6  | 1               | B    | 12   | GA            | MO           | P                   | LO                 | O                  | PIT          | Y2            |                   |                   |               |
|           | Valve Name:     | 2B2 SI Tank Outlet Isolation Valve               |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-3651  | 2998 G 078-131  | E-5  | 1               | A    | 10   | GA            | MO           | A                   | LC                 | O/C                | LT-S         | Y2            |                   |                   |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | ST-C         | CS            |                   | CS-08             |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | ST-O         | CS            |                   | CS-08             |               |
|           | Valve Name:     | 2B Shutdown Cooling Isolation Valve              |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-3652  | 2998 G 078-131  | E-7  | 1               | A    | 10   | GA            | MO           | A                   | LC                 | O/C                | LT-S         | Y2            |                   |                   |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | ST-C         | CS            |                   | CS-08             |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | ST-O         | CS            |                   | CS-08             |               |
|           | Valve Name:     | 2B Shutdown Cooling Isolation Valve              |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-3654  | 2998 G 078-130A | F-4  | 2               | B    | 6    | GA            | MO           | A                   | LO                 | O/C                | PIT          | Y2            |                   |                   |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|           | Valve Name:     | 2B HPSI Pump Discharge Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-3656  | 2998 G 078-130A | B-4  | 2               | B    | 6    | GA            | MO           | A                   | LO                 | O/C                | PIT          | Y2            |                   |                   |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|           | Valve Name:     | 2A HPSI Pump Discharge Valve                     |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-3658  | 2998 G 078-130B | D-2  | 2               | B    | 12   | GA            | MO           | A                   | LC                 | O/C                | PIT          | Y2            |                   |                   |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | ST-O         | M3            |                   |                   | TP-11         |
|           | Valve Name:     | 2B LPSI Pump Discharge to SDC Hx Valve           |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-3659  | 2998 G 078-130B | C-4  | 2               | B    | 3    | GA            | MO           | A                   | LO                 | O/C                | PIT          | Y2            |                   |                   |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   | TP-11         |
|           | Valve Name:     | A Train SI Pump Common Mini Flow Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-3660  | 2998 G 078-130B | C-3  | 2               | B    | 3    | GA            | MO           | A                   | LO                 | O/C                | PIT          | Y2            |                   |                   |               |
|           |                 |  |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   | TP-11         |
|           | Valve Name:     | B Train SI Pump Common Mini Flow Isolation Valve |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-3661  | 2998 G 078-130B | B-7  | 3               | B    | 1    | GA            | AO           | P                   | C                  | C                  | PIT          | Y2            |                   |                   | TP-11         |
|           | Valve Name:     | SIT Outlet Drain to RDT 2A Control Valve         |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |



[illegible]



| Valve Tag | P&ID            | P&ID<br>Coord. | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type  | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|-----------------|----------------|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|---|---------------|-------------------|-------------------|---------------|
| 2-V-3737  | 2998 G 078-132  | E-2            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC   | CS            |                   | CS-14             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT   | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C  | CS            |                   | CS-14             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O  | CS            |                   | CS-14             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: 2B1 SI Tank Vent Valve                  |               |                   |                   |               |
| 2-V-3738  | 2998 G 078-132  | F-2            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC   | CS            |                   | CS-14             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT   | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C  | CS            |                   | CS-14             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O  | CS            |                   | CS-14             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: 2B1 SI Tank Vent Valve                  |               |                   |                   |               |
| 2-V-3739  | 2998 G 078-132  | E-5            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC   | CS            |                   | CS-14             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT   | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C  | CS            |                   | CS-14             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O  | CS            |                   | CS-14             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: 2B2 SI Tank Vent Valve                  |               |                   |                   |               |
| 2-V-3740  | 2998 G 078-132  | F-5            | 2               | B    | 1    | GL            | SO           | A                   | LC                 | O/C                | FSC   | CS            |                   | CS-14             | TP-03         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | PIT   | Y2            |                   |                   |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-C  | CS            |                   | CS-14             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | ST-O  | CS            |                   | CS-14             |               |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: 2B2 SI Tank Vent Valve                  |               |                   |                   |               |
| 2-V-3766  | 2998 G 078-131  | C-3            | 2               | C    | 2    | CK            | SA           | A                   | C                  | O                  | CC  | CM            |                   |                   | TP-01, TP-07  |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | CO  | CM            |                   |                   | TP-07         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: HPSI 2A1 Cold Leg Injection Check Valve |               |                   |                   |               |
| 2-V-3767  | 2998 G 078-130B | F-4            | 2               | B    | 2    | GL            | M            | A                   | LO                 | O/C                | ME  | Y2            |                   |                   | TP-04         |
|           |                 |                |                 |      |      |               |              |                     |                    |                    | Valve Name: 2A LPSI Pump Recirc to RWT Iso Valve    |               |                   |                   |               |



| Valve Tag    | P&ID            | P&ID<br>Coor.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type               | Test<br>Freq.           | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|--------------|-----------------|--|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|----------------------------|-------------------------|-------------------|-------------------|---------------|
| 2-LCV-07-11A | 2998 G 088-2    | G-4  | 2               | A    | 2    | GL            | AO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name:  |                 | Containment Sump Pump Discharge Valve                      |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-LCV-07-11B | 2998 G 088-2    | G-3  | 2               | A    | 2    | GL            | AO           | A                   | C                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name:  |                 | Containment Sump Pump Discharge Valve                      |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-SR-07474   | 2998 G 088-2    | F-4  | 2               | A/C  | 0.75 | RV            | SA           | A                   | C                  | O                  | LT-J<br>RVT                | App J<br>Y10            |                   |                   | TP-08         |
| Valve Name:  |                 | Containment Spray Rx Cavity Sump Discharge Thermal Relief  |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-SR-07477   | 2998 G 088-2    | F-5  | 4               | N/A  | 0.75 | RV            | SA           | N/A                 | C                  | N/A                | RVT                        | Y10                     |                   |                   | TP-08         |
| Valve Name:  |                 | Containment Spray Rx Cavity Sump Discharge Thermal Relief  |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-V-6341     | 2998 G 078-160A | G-3  | 2               | A    | 3    | DIA           | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name:  |                 | Reactor Drain Tank Pump Suction Isolation Valve (Pen P 43) |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-V-6342     | 2998 G 078-160A | G-4  | 2               | A    | 3    | DIA           | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name:  |                 | Reactor Drain Tank Pump Suction Isolation Valve (Pen P 43) |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |
| 2-V-6718     | 2998 G 078-163A | B-3  | 2               | A    | 1    | DIA           | AO           | A                   | O                  | C                  | FSC<br>LT-J<br>PIT<br>ST-C | M3<br>App J<br>Y2<br>M3 |                   |                   | TP-03         |
| Valve Name:  |                 | QT/RDT Vent to Gas Surge Tank 2A Isolation Valve           |                 |      |      |               |              |                     |                    |                    |                            |                         |                   |                   |               |



| Valve Tag | P&ID            | P&ID<br>Coord.  | Safety<br>Class | Cat. | Size | Valve<br>Type | Act.<br>Type | Active /<br>Passive | Normal<br>Position | Safety<br>Position | Test<br>Type | Test<br>Freq. | Relief<br>Request | Deferred<br>Just. | Tech.<br>Pos. |
|-----------|-----------------|---|-----------------|------|------|---------------|--------------|---------------------|--------------------|--------------------|--------------|---------------|-------------------|-------------------|---------------|
| 2-V-6741  | 2998 G 078-163B | D-4   | 2               | A    | 1    | GL            | PO           | A                   | C                  | C                  | FSC          | M3            |                   |                   | TP-03         |
|           |                 |   |                 |      |      |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|           |                 |   |                 |      |      |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|           |                 |   |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|           | Valve Name:     | Nitrogen Supply Containment Isolation Valve (Pen P 14)  |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-6750  | 2998 G 078-163A | B-3   | 2               | A    | 1    | DIA           | AO           | A                   | O                  | C                  | FSC          | M3            |                   |                   | TP-03         |
|           |                 |   |                 |      |      |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|           |                 |   |                 |      |      |               |              |                     |                    |                    | PIT          | Y2            |                   |                   |               |
|           |                 |   |                 |      |      |               |              |                     |                    |                    | ST-C         | M3            |                   |                   |               |
|           | Valve Name:     | QT/RDT Vent to Gas Surge Tank 2A Isolation Valve        |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |
| 2-V-6792  | 2998 G 078-163B | D-3   | 2               | A/C  | 1    | CK            | SA           | A                   | C                  | C                  | CC           | CM            |                   |                   | TP-07         |
|           |                 |   |                 |      |      |               |              |                     |                    |                    | CO           | CM            |                   |                   | TP-01, TP-07  |
|           |                 |   |                 |      |      |               |              |                     |                    |                    | LT-J         | App J         |                   |                   |               |
|           | Valve Name:     | Nitrogen Supply Containment Isolation Valve. (Pen P 14) |                 |      |      |               |              |                     |                    |                    |              |               |                   |                   |               |