

2.12 Station Electrical Systems

The information in this section of the reference ABWR DCD, including all subsections, figures and tables, is incorporated by reference with the following departures.

STD DEP T1 2.12-1 (Tables 2.12.1, 2.12.12, 2.12.14 and 2.12.15)

STD DEP T1 2.12-2 (Figure 2.12.15)

2.12.1 Electrical Power Distribution System

Design Description

STD DEP T1 2.12-1

EPD System interrupting devices (circuit breakers and fuses) are coordinated to the maximum extent possible, so that the circuit interrupter closest to the fault opens before other devices.

2.12.12 Direct Current Power Supply

Design Description

STD DEP T1 2.12-1

Class 1E DC electrical distribution system circuit interrupting devices (circuit breakers and fuses) are coordinated to the maximum extent possible, so that the circuit interrupter closest to the fault opens before other devices.

2.12.14 Vital AC Power Supply

Design Description

STD DEP T1 2.12-1

Class 1E Vital AC Power Supply system interrupting devices (circuit breakers and fuses) are coordinated to the maximum extent possible, so that the circuit interrupter closest to the fault opens before other devices.

2.12.15 Instrument and Control Power Supply***Design Description***

STD DEP T1 2.12-2

The Class 1E Instrument and Control Power Supply consists of ~~three~~ four divisions (Division I, II, ~~and III~~, and IV) of interruptible power supplies with their respective distribution panels. Each Class 1E power supply provides interruptible, regulated AC power to Class 1E circuits which do not require continuity of power during a loss of preferred power (LOPP).

STD DEP T1 2.12-1

Class 1E Instrument and Control Power Supply system interrupting devices (circuit breakers and fuses) are coordinated to the maximum extent possible, so that the circuit interrupter closest to the fault opens before other devices.

Table 2.12.1 Electric Power Distribution System

Design Commitment	Inspections, Tests, Analyses and Acceptance Criteria	Acceptance Criteria
<p>11. EPD System interrupting devices (circuit breakers and fuses) are coordinated to the maximum extent possible, so that the circuit interrupter closest to the fault opens before other devices.</p>	<p>11. Analyses for the as-built EPD System to determine circuit interrupting device coordination will be performed.</p>	<p>11. Analyses for the as-built EPD System exist and conclude that, to the maximum extent possible, the analyzed circuit interrupter closest to the fault will open before other devices.</p>
<p>22. The EPD System supplies an operating voltage at the terminals of the Class 1E utilization equipment that is within the utilization equipment's voltage tolerance limits.</p>	<p>22.</p> <p>a. Analyses for the as-built EPD System to determine voltage drops will be performed.</p> <p>b. Tests of the as-built Class 1E EPD System will be conducted by operating connected Class 1E loads at their analyzed minimum voltage.</p> <p>b. Type tests at manufacturer's shop will be performed for the operating voltage range of the Class 1E electrical equipment.</p> <p>c. System preoperational and Startup tests will be conducted of the as-built Class 1E EPD System.</p>	<p>22.</p> <p>a. Analyses for the as-built EPD System exist and conclude that the analyzed operating voltage supplied at the terminals of the Class 1E utilization equipment is within the utilization equipment's voltage tolerance limits, as determined by their nameplate ratings.</p> <p>b. Connected Class 1E loads operate at their analyzed minimum voltage, as determined by the voltage drop analyses.</p> <p>b. Manufacturer's type test reports exist and conclude that the operating range is within the tested voltage range for the Class 1E electrical equipment.</p> <p>c. The test voltages from preoperational test reports are compared against system voltage analysis of the as-built Class 1E EPD system. The results of comparison conclude that the available voltage is within the operating range for the as-installed equipment.</p>

Table 2.12.12 Direct Current Power Supply

Design Commitment	Inspections, Tests, Analyses and Acceptance Criteria	Inspections, Tests, Analyses	Acceptance Criteria
<p>8. Class 1E DC electrical distribution system circuit interrupting devices (circuit breakers and fuses) are coordinated to the maximum extent possible, so that the circuit interrupter closest to the fault opens before other devices.</p>	<p>8. Analyses for the as-built Class 1E DC electrical distribution system to determine circuit interrupting device coordination will be performed.</p>	<p>8. Analyses for the as-built Class 1E DC electrical distribution system circuit interrupting devices exist and conclude that, to the maximum extent possible, the analyzed circuit interrupter closest to the fault will open before other devices.</p>	

Table 2.12.12 Direct Current Power Supply (Continued)

Design Commitment	Inspections, Tests, Analyses	Acceptance Criteria
<p>11. The Class 1E DC electrical distribution system supplies an operating voltage at the terminals of the Class 1E utilization equipment that is within the utilization equipment's voltage tolerance limits.</p>	<p>11. a. Analyses for the as-built Class 1E DC electrical distribution system to determine system voltage drops will be performed.</p>	<p>11. a. Analyses for the as-built Class 1E DC electrical distribution system exist and conclude that the analyzed operating voltage supplied at the terminals of the Class 1E utilization equipment is within the utilization equipment's voltage tolerance limits, as determined by their nameplate ratings.</p>
	<p>b. Tests of the as-built Class 1E DC system will be conducted by operating connected Class 1E loads at less than or equal to the minimum allowable battery voltage and at greater than or equal to the maximum battery charging voltage.</p>	<p>b. Connected as-built Class 1E loads operate at less than or equal to the minimum allowable battery voltage and at greater than or equal to the maximum battery charging voltage.</p>
	<p>b. Type tests at manufacturer's shop will be performed for the operating voltage range of the Class 1E DC electrical equipment.</p>	<p>b. Manufacturer's type test reports exist and conclude that the operating range is within the tested voltage range for the Class 1E DC electrical equipment.</p>
	<p>c. System preoperational tests will be conducted on the as-built Class 1E DC system.</p>	<p>c. The test voltages from preoperational test reports are compared against system voltage analysis of the as-built Class 1E EPD system. The results of comparison conclude that the available voltage is within the operating range for the as-installed DC equipment.</p>

Table 2.12.14 Vital AC Power Supply Inspections, Tests, Analyses and Acceptance Criteria

Design Commitment	Inspections, Tests, Analyses	Acceptance Criteria
<p>10. Class 1E Vital AC Power Supply system interrupting devices (circuit breakers and fuses) are coordinated to the maximum extent possible, so that the circuit interrupter closest to the fault opens before other devices.</p>	<p>10. Analyses for the as-built Class 1E distribution system to determine circuit interrupting device coordination will be performed.</p>	<p>10. Analyses for the as-built Class 1E Vital AC Power Supply system circuit interrupting devices (circuit breakers and fuses) coordination exist and conclude that, to the maximum extent possible, the analyzed circuit interrupter closes to the fault will open before other devices.</p>

Table 2.12.15 Instrument and Control Power Supply

Design Commitment	Inspections, Tests, Analyses and Acceptance Criteria	Acceptance Criteria
<p>9. Class 1E Instrument and Control Power Supply system interrupting devices (circuit breakers and fuses) are coordinated to the maximum extent possible, so that the circuit interrupter closest the fault opens before other devices.</p>	<p>9. Analyses for the as-built Class 1E distribution system to determine circuit interrupting device coordination will be performed.</p>	<p>9. Analyses for the as-built Class 1E Instrument and Control Power Supply system circuit interrupting devices (circuit breakers and fuses) coordination exist and conclude that, to the maximum extent possible, the analyzed circuit interrupter closest to the fault will open before other devices.</p>

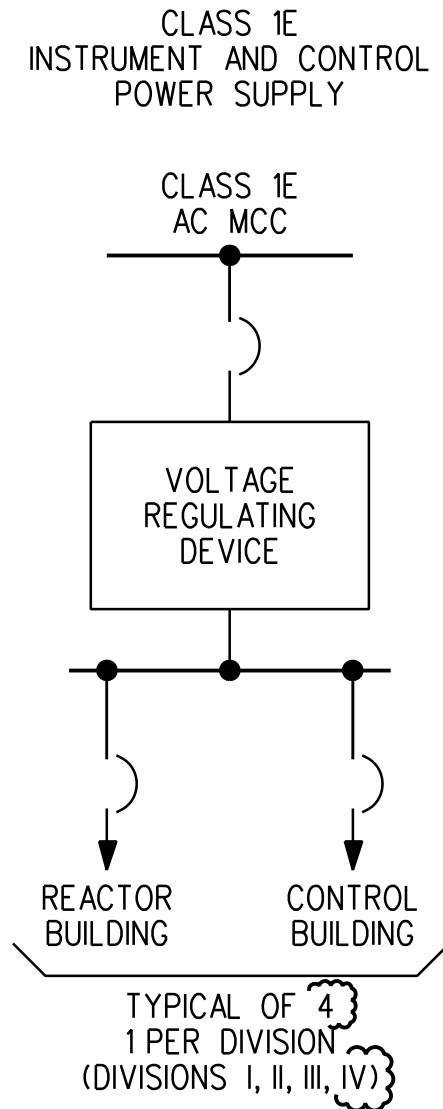


Figure 2.12.15 Instrument and Control Power Supply