GE-Hitachi Nuclear Energy

26A6642AN
Revision 4
September 2007

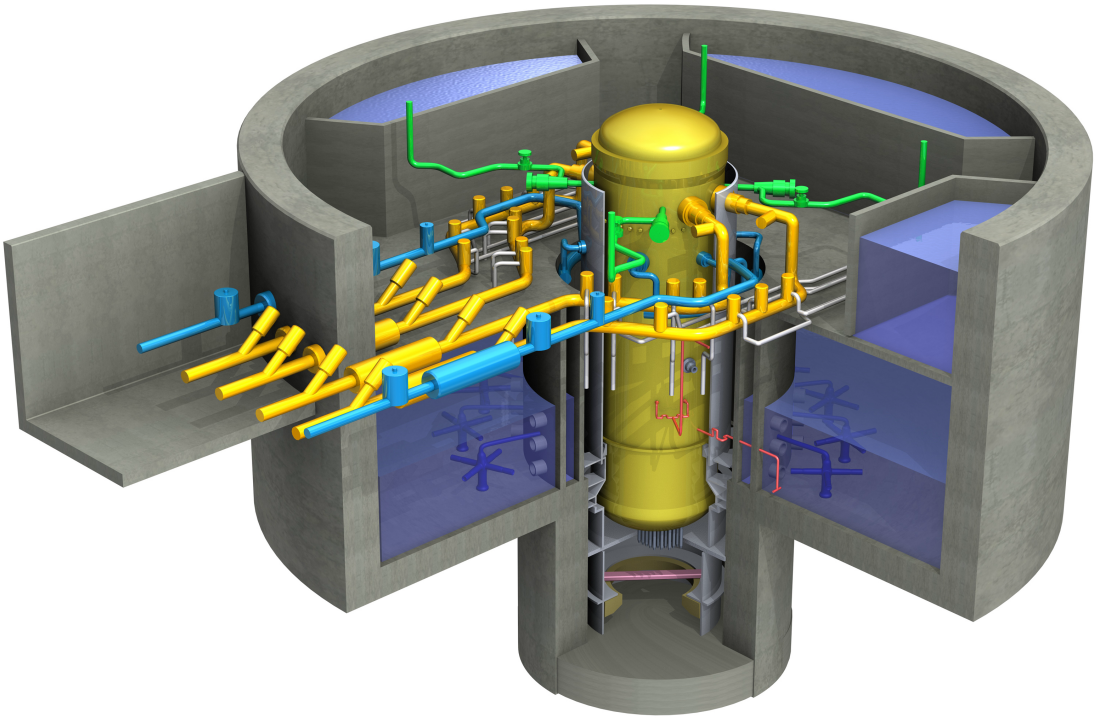

ESBWR Design Control Document
Tier 2

Chapter 3
Design of Structures, Components, Equipment, and Systems
Appendices 3G – 3L

Contents

3G. DESIGN DETAILS AND EVALUATION RESULTS OF SEISMIC CATEGORY I STRUCTURES 3G-1
3G.1 Reactor Building 3G-1
3G.1.1 Objective and Scope 3G-1
3G.1.2 Conclusions 3G-1
3G.1.3 Structural Description 3G-2
3G.1.3.1 Description of the Reactor Building 3G-2
3G.1.3.1.1 Reactor Building Structure 3G-2
3G.1.3.1.2 Containment and Containment Structure 3G-2
3G.1.3.1.3 Reactor Building Structure/Containment Structure Connections 3G-3
3G.1.3.1.4 Containment Internal Structures 3G-3
3G.1.4 Analytical Models 3G-3
3G.1.4.1 Structural Models 3G-3
3G.1.4.2 Foundation Models 3G-4
3G.1.5 Structural Analysis and Design 3G-5
3G.1.5.1 Site Design Parameters 3G-5
3G.1.5.2 Design Loads, Load Combinations, and Material Properties 3G-5
3G.1.5.2.1 Design Loads 3G-5
3G.1.5.2.1.1 Dead Load (D) and Live Load (L and L_o) 3G-5
3G.1.5.2.1.2 Snow and Rain Load 3G-5
3G.1.5.2.1.3 Lateral Soil Pressure at Rest 3G-5
3G.1.5.2.1.4 Wind Load (W) 3G-5
3G.1.5.2.1.5 Tornado Load (W_t) 3G-6
3G.1.5.2.1.6 Thermal Loads 3G-6
3G.1.5.2.1.7 Pressure Loads 3G-6
3G.1.5.2.1.8 Condensation Oscillation (CO) and Chugging (CHUG) Loads 3G-6
3G.1.5.2.1.9 Safety Relief Valve (SRV) Loads 3G-6
3G.1.5.2.1.10 Steam Tunnel Subcompartment Pressure 3G-7
3G.1.5.2.1.11 Subcompartment Pressure in Other Compartments 3G-7
3G.1.5.2.1.12 Annulus Pressurization (AP) Loads 3G-7
3G.1.5.2.1.13 Design Seismic Loads 3G-7
3G.1.5.2.2 Load Combinations and Acceptance Criteria 3G-7
3G.1.5.2.2.1 Reinforced Concrete Containment Vessel (RCCV) 3G-7
3G.1.5.2.2.2 Steel Containment Components 3G-8
3G.1.5.2.2.3 Containment Internal Structures 3G-8
3G.1.5.2.2.4 Reactor Building (RB) Concrete Structures Including Pool Girders 3G-8
3G.1.5.2.3 Material Properties 3G-8
3G.1.5.2.3.1 Concrete 3G-8
3G.1.5.2.3.2 Reinforcing Steel 3G-9
3G.1.5.2.3.3 Structural Steel 3G-9
3G.1.5.3 Stability Requirements 3G-9
3G.1.5.4 Structural Design Evaluation 3G-9
3G.1.5.4.1 Containment Structure 3G-10
3G.1.5.4.1.1 Containment Wall Including RPV Pedestal 3G-10

3G.1.5.4.1.2 Containment Top Slab and Suppression Pool Slab 3G-11
3G.1.5.4.1.3 Containment Foundation Mat 3G-11
3G.1.5.4.1.4 Drywell Head 3G-11
3G.1.5.4.2 Containment Internal Structures 3G-12
3G.1.5.4.2.1 Diaphragm Floor 3G-13
3G.1.5.4.2.2 Vent Wall Structure 3G-14
3G.1.5.4.2.3 Reactor Shield Wall 3G-14
3G.1.5.4.2.4 RPV Support Bracket 3G-14
3G.1.5.4.2.5 Gravity-Driven Cooling System Pool 3G-14
3G.1.5.4.3 Reactor Building 3G-15
3G.1.5.4.3.1 RB Shear Walls 3G-15
3G.1.5.4.3.2 RB Foundation Mat Outside Containment 3G-15
3G.1.5.4.3.3 RB Floor Slabs 3G-15
3G.1.5.4.3.4 Pool Girders 3G-16
3G.1.5.4.3.5 Main Steam Tunnel Floors and Walls 3G-16
3G.1.5.5 Foundation Stability 3G-16
3G.1.5.5.1 Effect of Basemat Uplift 3G-17
3G.1.5.5.2 Effect of Horizontal Variation of Soil Spring 3G-17
3G.1.5.5.3 Effect of Construction Sequence 3G-17
3G.1.5.5.4 Foundation Settlement 3G-18
3G.1.5.6 Tornado Missile Evaluation 3G-18
3G.1.6 References 3G-18
3G.2 Control Building 3G-190
3G.2.1 Objective and Scope 3G-190
3G.2.2 Conclusions 3G-190
3G.2.3 Structural Description 3G-190
3G.2.4 Analytical Models 3G-190
3G.2.4.1 Structural Model 3G-190
3G.2.4.2 Foundation Models 3G-191
3G.2.5 Structural Analysis and Design 3G-191
3G.2.5.1 Site Design Parameters 3G-191
3G.2.5.2 Design Loads, Load Combinations, and Material Properties 3G-191
3G.2.5.2.1 Design Loads 3G-191
3G.2.5.2.1.1 Dead Load (D) and Live Load (L and Lo) 3G-191
3G.2.5.2.1.2 Snow and Rain Load 3G-191
3G.2.5.2.1.3 Lateral Soil Pressure at Rest 3G-192
3G.2.5.2.1.4 Wind Load (W) 3G-192
3G.2.5.2.1.5 Tornado Load (W_t) 3G-192
3G.2.5.2.1.6 Thermal Load (T_o and T_a) 3G-192
3G.2.5.2.1.7 Design Seismic Loads 3G-192
3G.2.5.2.2 Load Combinations and Acceptance Criteria 3G-192
3G.2.5.2.3 Material Properties 3G-193
3G.2.5.3 Stability Requirements 3G-193
3G.2.5.4 Structural Design Evaluation 3G-193
3G.2.5.4.1 Shear Walls 3G-193
3G.2.5.4.2 Floor Slabs 3G-193

3G.2.5.4.3 Foundation Mat 3G-193
3G.2.5.5 Foundation Stability 3G-194
3G.2.5.5.1 Foundation Settlement 3G-194
3G.2.5.6 Tornado Missile Evaluation 3G-194
3G.3 Fuel Building 3G-246
3G.3.1 Objective and Scope 3G-246
3G.3.2 Conclusions 3G-246
3G.3.3 Structural Description 3G-246
3G.3.4 Analytical Models 3G-246
3G.3.5 Structural Analysis and Design 3G-247
3G.3.5.1 Site Design Parameters 3G-247
3G.3.5.2 Design Loads, Load Combinations, and Material Properties 3G-247
3G.3.5.2.1 Design Loads 3G-247
3G.3.5.2.1.1 Dead Load (D) and Live Load (L and Lo) 3G-247
3G.3.5.2.1.2 Snow and Rain Load 3G-247
3G.3.5.2.1.3 Lateral Soil Pressure at Rest 3G-247
3G.3.5.2.1.4 Wind Load (W) 3G-247
3G.3.5.2.1.5 Tornado Load (W_t) 3G-247
3G.3.5.2.1.6 Thermal Load (T_o) 3G-247
3G.3.5.2.1.7 Design Seismic Loads 3G-248
3G.3.5.2.2 Load Combinations and Acceptance Criteria 3G-248
3G.3.5.2.3 Material Properties 3G-248
3G.3.5.3 Stability Requirements 3G-248
3G.3.5.4 Structural Design Evaluation 3G-248
3G.3.5.4.1 Shear Walls and Spent Fuel Pool Walls 3G-248
3G.3.5.4.2 Floor Slabs 3G-249
3G.3.5.4.3 Foundation Mat 3G-249
3G.3.5.5 Foundation Stability 3G-249
3G.3.5.6 Tornado Missile Evaluation 3G-249
3G.4 Fire Water Service Complex 3G-276
3G.4.1 Objective and Scope 3G-276
3G.4.2 Conclusion 3G-276
3G.4.3 Structural Description 3G-276
3G.4.4 Analytical Models 3G-276
3G.4.4.1 Structural Model 3G-276
3G.4.4.2 Foundation Models 3G-277
3G.4.5 Structural Analysis and Design 3G-277
3G.4.5.1 Site Design Parameters 3G-277
3G.4.5.2 Design Loads, Load Combinations, and Material Properties 3G-277
3G.4.5.2.1 Design Loads 3G-277
3G.4.5.2.1.1 Dead Load (D) and Live Load (L and L_o) 3G-277
3G.4.5.2.1.2 Snow and Rain Load 3G-277
3G.4.5.2.1.3 Lateral Soil Pressure 3G-277
3G.4.5.2.1.4 Wind Load (W) 3G-277
3G.4.5.2.1.5 Tornado Load (W_t) 3G-278
3G.4.5.2.1.6 Thermal Load (T_o) 3G-278

3G.4.5.2.1.7 Design Seismic Loads 3G-278
3G.4.5.2.2 Load Combinations and Acceptance Criteria 3G-278
3G.4.5.2.3 Material Properties 3G-278
3G.4.5.3 Stability Requirements 3G-278
3G.4.5.4 Structural Design Evaluation 3G-278
3G.4.5.4.1 Shear Walls 3G-279
3G.4.5.4.2 Roof Floor Slabs 3G-279
3G.4.5.4.3 Foundation Mat 3G-279
3G.4.5.5 Foundation Stability 3G-279
3G.4.5.5.1 Foundation Settlement 3G-280
3G.4.5.6 Tornado Missile Evaluation 3G-280
3H. EQUIPMENT QUALIFICATION DESIGN ENVIRONMENTAL CONDITIONS 3H-1
3H.1 Introduction 3H-1
3H.2 Plant Zones 3H-1
3H.2.1 Containment Vessel 3H-1
3H.2.2 Outside Containment Vessel 3H-1
3H.3 Environmental Conditions 3H-2
3H.3.1 Plant Normal Operating Conditions 3H-2
3H.3.2 Accident Conditions 3H-2
3H.3.3 Water Quality 3H-2
3H.3.4 Locations of Safety-Related Equipment 3H-3
3H.3.5 Mild Environment Conditions 3H-3
3H.3.6 COL Information 3H-3
3H.4 References 3H-3
3I. DESIGNATED NEDE-24326-1-P MATERIAL WHICH MAY NOT CHANGE WITHOUT PRIOR NRC APPROVAL 3I-1
3I.1 General Requirements for Dynamic Testing 3I-1
3I.2 Product and Assembly Testing 3I-2
3I.3 Multiple-Frequency Tests 3I-2
3I.4 Single- and Multi-axis Tests 3I-3
3I.5 Single Frequency Tests 3I-3
3I.6 Damping 3I-3
3I.7 Qualification Determination 3I-3
3I.8 Dynamic Qualification by Analysis 3I-4
3I.9 Required Response Spectra 3I-4
3I.10 Time History Analysis 3I-4
3I.11 References 3I-5
3J. EVALUATION OF POSTULATED RUPTURES IN HIGH ENERGY PIPES 3J-1
3J.1 Background and Scope 3J-1
3J.2 Identification of Rupture Locations and Rupture Geometry 3J-1
3J.2.1 Ruptures in Containment Penetration Area. 3J-1
3J.2.2 Ruptures in Areas other than Containment Penetration. 3J-2

3J.2.3 Determination of the Type of Pipe Break 3J-2
3J.3 Design and Selection of Pipe Whip Restraints 3J-2
3J.3.1 Preliminary Selection of Pipe Whip Restraint 3J-2
3J.3.2 Preparation of Simplified Computer Model of Piping-Pipe Whip Restraint System.. 3J-2
3J.3.3 Piping Dynamic Analysis 3J-2
3J.3.4 Selection of Pipe Whip Restraint for Pipe Whip Restraint Analysis 3J-3
3J.4 Pipe Rupture Evaluation 3J-3
3J.4.1 General Approach 3J-3
3J.4.2 Procedure For Dynamic Time-History Analysis With Simplified Model 3J-4
3J.4.2.1 Modeling of Piping System 3J-4
3J.4.2.2 Dynamic Analysis of Simplified Piping Model 3J-4
3J.4.3 Procedure For Dynamic Time-History Analysis Using Detailed Piping Model 3J-5
3J.4.3.1 Modeling of Piping System 3J-5
3J.4.3.2 Dynamic Analysis using Detail Piping Model 3J-5
3J.5 Jet Impingement on Safety-related Piping 3J-5
3K. RESOLUTION OF INTERSYSTEM LOSS OF COOLANT ACCIDENT 3K-1
3K.1 Introduction 3K-1
3K.2 Regulatory Positions 3K-1
3K.3 Boundary Limits of Ultimate Rupture Strength 3K-2
3K.4 Evaluation Procedure 3K-2
3K.5 Systems Evaluated 3K-2
3K.6 Piping Design Pressure for Ultimate Rupture Strength Compliance 3K-3
3K.7 Applicability of Ultimate Rupture Strength Non-piping Components 3K-3
3K.8 Results 3K-3
3K.9 Valve Misalignment Due To Operator Error 3K-3
3K.10 Summary 3K-4
3K.11 References 3K-4
ATTACHMENT 3KA. ULTIMATE RUPTURE STRENGTH SYSTEM BOUNDARY EVALUATION 3K-5
3KA.1 Control Rod Drive System 3K-5
3KA.1.1 System URS Boundary Description 3K-5
3KA.1.2 Downstream Interfaces 3K-5
3KA.1.3 Low-Pressure Piping Systems and Components Designed to URS Pressure 3K-6
3KA.2 Standby Liquid Control System 3K-7
3KA.2.1 System URS Boundary Description 3K-7
3KA.2.2 Downstream interfaces 3K-7
3KA.2.3 Low Pressure Piping Systems and Components Designed to URS Pressure..... 3K-7
3KA.3 Reactor Water Cleanup/Shutdown Cooling System 3K-8
3KA.3.1 System URS Boundary Description 3K-8
3KA.3.2 Downstream Interfaces 3K-8
3KA.3.3 Low-Pressure Piping Systems and Components Designed to URS Pressure 3K-8
3KA.4 Fuel And Auxiliary Pools Cooling System 3K-9
3KA.4.1 System URS Boundary Description 3K-9

3KA.4.2 Downstream Interfaces 3K-9
3KA.4.3 Low-Pressure Piping Systems and Components Designed to URS Pressure 3K-9
3KA.5 Nuclear Boiler System 3K-10
3KA.5.1 System URS Boundary Description 3K-10
3KA.5.2 Downstream Interfaces 3K-10
3KA.5.3 Low-Pressure Piping Systems and Components Designed to URS Pressure .. 3K-10
3KA.6 Condensate And Feedwater System 3K-11
3KA.6.1 System URS Boundary Description 3K-11
3KA.6.2 Downstream Interfaces 3K-11
3KA.6.3 Low-Pressure Piping Systems and Components Designed to URS Pressure .. 3K-11
3L. REACTOR INTERNALS FLOW INDUCED VIBRATION PROGRAM 3L-1
3L.1 Introduction 3L-1
3L.2 Reactor Internal Components FIV Evaluation 3L-2
3L.2.1 Evaluation Process – Part 1 ..... 3L-2
3L.2.2 Evaluation Process – Part 2 ..... 3L-4
3L.3 Chimney Partition Assembly Evaluation 3L-5
3L.3.1 Design and Materials 3L-5
3L.3.2 Prior Operating Experience 3L-5
3L.3.3 Testing and Two-phase Flow Analysis 3L-5
3L.4 Steam Dryer Evaluation Program 3L-7
3L.4.1 Steam Dryer Design and Performance 3L-7
3L.4.2 Materials and Fabrication 3L-7
3L.4.3 Load Combinations 3L-8
3L.4.4 Fluid Loads on the Dryer 3L-8
3L.4.5 Structural Evaluation 3L-9
3L.4.6 Instrumentation and Startup Testing 3L-9
3L.5 Startup Test Program 3L-12
3L.5.1 Component Selections 3L-12
3L.5.2 Sensor Locations 3L-12
3L.5.3 Test Conditions 3L-12
3L.5.4 Data Reduction Methods 3L-13
3L.5.4.1 Time History Analysis 3L-13
3L.5.4.2 Frequency Analysis 3L-14
3L.5.5 Data Evaluation Methods 3L-15
3L.5.5.1 Finite Element Models 3L-15
3L.5.5.1.1 Chimney Head and Steam Separators 3L-15
3L.5.5.1.2 Shroud and Chimney 3L-15
3L.5.5.1.3 Steam Dryer 3L-16
3L.5.5.1.4 Standby Liquid Control Lines 3L-17
3L.5.5.2 Stress Evaluation 3L-17
3L.5.5.2.1 Methods I and II 3L-19
3L.5.5.2.2 (Deleted) 3L-22
3L.6 References 3L-23

List of Tables

Abbreviations And Acronyms List
Table 3G.1-1 Soil Spring Constants for the RB Analysis Model
Table 3G.1-2 Site Design Parameters
Table 3G.1-3 Equipment and Hydrostatic Loads inside RCCV
Table 3G.1-4 Equipment and Hydrostatic Loads in RB Pools
Table 3G.1-5 Miscellaneous Structures, Piping, and Commodity Loads on RB Floor
Table 3G.1-6 Equivalent Linear Temperature Distributions at Various Sections
Table 3G.1-7 Pressure Loads Inside RCCV
Table 3G.1-8 Pressure Loads Inside IC/PCCS Pools
Table 3G.1-9 Maximum Vertical Acceleration
Table 3G.1-10 Selected Load Combinations for the RCCV
Table 3G.1-11 Selected Load Combinations for the RB
Table 3G.1-12 Material Constants for Design Calculations
Table 3G.1-13 Results of NASTRAN Analysis, Dead Load
Table 3G.1-14 Results of NASTRAN Analysis, Drywell Unit Pressure (1 MPa)
Table 3G.1-15 Results of NASTRAN Analysis, Wetwell Unit Pressure (1 MPa)
Table 3G.1-16 Results of NASTRAN Analysis, Thermal Load (Normal Operation: Winter)
Table 3G.1-17 Results of NASTRAN Analysis, Thermal Load (LOCA After 6 minutes: Winter)
Table 3G.1-18 Results of NASTRAN Analysis, Thermal Load (LOCA After 72 hours: Winter)
Table 3G.1-19 Results of NASTRAN Analysis, Seismic Load (Horizontal: North to South Direction)
Table 3G.1-20 Results of NASTRAN Analysis, Seismic Load (Horizontal: East to West Direction)
Table 3G.1-21 Results of NASTRAN Analysis, Seismic Load (Vertical: Upward Direction)
Table 3G.1-22 Combined Forces and Moments: RCCV, Selected Load Combination CV-1
Table 3G.1-23 Combined Forces and Moments: RCCV, Selected Load Combination CV-7a
Table 3G.1-24 Combined Forces and Moments: RCCV, Selected Load Combination CV-7b
Table 3G.1-25 Combined Forces and Moments: RCCV, Selected Load Combination CV-11a
Table 3G.1-26 Combined Forces and Moments: RCCV, Selected Load Combination CV-11b
Table 3G.1-27 Sectional Thicknesses and Rebar Ratios of RCCV Used in the Evaluation
Table 3G.1-28 Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-1
Table 3G.1-29 Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-7a
Table 3G.1-30 Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-7b
Table 3G.1-31 Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-11a
Table 3G.1-32 Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-11b
Table 3G.1-33 Transverse Shear of RCCV
Table 3G.1-34 Tangential Shear of RCCV
Table 3G.1-35 Containment Liner Plate Strains (Max)
Table 3G.1-36 Drywell Head Elements Stress Summary
Table 3G.1-37 Diaphragm Floor (D/F) Slab Elements Stress Summary
Table 3G.1-38 Diaphragm Floor (D/F) Slab Anchorage Structural Capacity
Table 3G.1-39 Vent Wall Structural Elements Stress Summary
Table 3G.1-40 Reactor Shield Wall (RSW) Structural Element Stress Summary
Table 3G.1-41 RPV Support Bracket Structural Elements Stress Summary

Table 3G.1-42 Vent Wall and RPV Support Bracket Anchorage Structural Capacity
Table 3G.1-43 Gravity Driven Cooling System (GDCS) Pool Structural Elements Stress Summary
Table 3G.1-44 Gravity Driven Cooling System (GDCS) Pool Anchorage Structural Capacity
Table 3G.1-45 Combined Forces and Moments: RB, Selected Load Combination RB-4
Table 3G.1-46 Combined Forces and Moments: RB, Selected Load Combination RB-8a
Table 3G.1-47 Combined Forces and Moments: RB, Selected Load Combination RB-8b
Table 3G.1-48 Combined Forces and Moments: RB, Selected Load Combination RB-9a
Table 3G.1-49 Combined Forces and Moments: RB, Selected Load Combination RB-9b
Table 3G.1-50 Sectional Thicknesses and Rebar Ratios of RB Used in the Evaluation
Table 3G.1-51 Rebar and Concrete Stresses of RB: Selected Load Combination RB-4
Table 3G.1-52 Rebar and Concrete Stresses of RB: Selected Load Combination RB-8a
Table 3G.1-53 Rebar and Concrete Stresses of RB: Selected Load Combination RB-8b
Table 3G.1-54 Rebar and Concrete Stresses of RB: Selected Load Combination RB-9a
Table 3G.1-55 Rebar and Concrete Stresses of RB: Selected Load Combination RB-9b
Table 3G.1-56 Transverse Shear of RB
Table 3G.1-57 Factors of Safety for Foundation Stability
Table 3G.1-58 Maximum Soil Bearing Stress Involving SSE
Table 3G.1-59 Stress Calculation Results for Basemat Uplift Analysis
Table 3G.2-1 Soil Spring Constants for the CB Analysis Model
Table 3G.2-2 Equipment Load of CB
Table 3G.2-3 Miscellaneous Structures, Piping, and Commodity Load of CB
Table 3G.2-4 Equivalent Liner Temperature Distributions at Various Sections
Table 3G.2-5 Maximum Vertical Acceleration
Table 3G.2-6 Selected Load Combinations for the CB
Table 3G.2-7 Results of NASTRAN Analysis: Dead Load
Table 3G.2-8 Results of NASTRAN Analysis: Thermal Load (LOCA: Winter)
Table 3G.2-9 Results of NASTRAN Analysis: Seismic Load (Horizontal: North to South Direction)
Table 3G.2-10 Results of NASTRAN Analysis: Seismic Load (Horizontal: East to West Direction)
Table 3G.2-11 Results of NASTRAN Analysis: Seismic Load (Vertical: Upward Direction)
Table 3G.2-12 Combined Forces and Moments: Selected Load Combination CB-3
Table 3G.2-13 Combined Forces and Moments: Selected Load Combination CB-4
Table 3G.2-14 Combined Forces and Moments: Selected Load Combination CB-7
Table 3G.2-15 Combined Forces and Moments: Selected Load Combination CB-9
Table 3G.2-16 Sectional Thicknesses and Rebar Ratios Used in the Evaluation
Table 3G.2-17 Rebar and Concrete Stresses (Basemat and Slabs): Selected Load Combination CB-3
Table 3G.2-18 Rebar and Concrete Stresses (Walls): Selected Load Combination CB-3
Table 3G.2-19 Rebar and Concrete Stresses (Basemat and Slabs): Selected Load Combination CB-4
Table 3G.2-20 Rebar and Concrete Stresses (Walls): Selected Load Combination CB-4
Table 3G.2-21 Rebar and Concrete Stresses (Basemat and Slabs): Selected Load Combination CB-7
Table 3G.2-22 Rebar and Concrete Stresses (Walls): Selected Load Combination CB-7

Table 3G.2-23 Rebar and Concrete Stresses (Basemat and Slabs): Selected Load Combination CB-9
Table 3G.2-24 Rebar and Concrete Stresses (Walls): Selected Load Combination CB-9
Table 3G.2-25 Calculation Results for Transverse Shear
Table 3G.2-26 Factors of Safety for Foundation Stability
Table 3G.2-27 Maximum Soil Bearing Stress Involving SSE
Table 3G.3-1 Miscellaneous Structures and Commodity in Spent Fuel Pool
Table 3G.3-2 Miscellaneous Structures, Piping, and Commodity Load on FB Floor
Table 3G.3-3 Equivalent Liner Temperature Distributions at Various Sections
Table 3G.3-4 Selected Load Combinations for the FB
Table 3G.3-5 Results of NASTRAN Analysis: Dead Load
Table 3G.3-6 Results of NASTRAN Analysis: Thermal Load (Winter)
Table 3G.3-7 Results of NASTRAN Analysis: Seismic Load (Horizontal: North to South Direction)
Table 3G.3-8 Results of NASTRAN Analysis: Seismic Load (Horizontal: East to West Direction)
Table 3G.3-9 Results of NASTRAN Analysis: Seismic Load (Vertical: Upward Direction)
Table 3G.3-10 Combined Forces and Moments: Selected Load Combination FB-4
Table 3G.3-11 Combined Forces and Moments: Selected Load Combination FB-8
Table 3G.3-12 Combined Forces and Moments: Selected Load Combination FB-9
Table 3G.3-13 Sectional Thicknesses and Rebar Ratios Used in the Evaluation
Table 3G.3-14 Rebar and Concrete Stresses: Selected Load Combination FB-4
Table 3G.3-15 Rebar and Concrete Stresses: Selected Load Combination FB-8
Table 3G.3-16 Rebar and Concrete Stresses: Selected Load Combination FB-9
Table 3G.3-17 Transverse Shear of FB
Table 3G.4-1 Soil Spring Constants for FWSC Analysis Model
Table 3G.4-2 Equipment Load of FWSC
Table 3G.4-3 Miscellaneous Structures, Piping, and Commodity Load of FWSC
Table 3G.4-4 Equivalent Linear Temperature Distributions at Various Sections
Table 3G.4-5 Maximum Vertical Acceleration
Table 3G.4-6 Selected Load Combinations for FWSC
Table 3G.4-7 Results of NASTRAN Analysis: Dead Load
Table 3G.4-8 Results of NASTRAN Analysis: Thermal Load (Winter)
Table 3G.4-9 Results of NASTRAN Analysis: Seismic Load (Horizontal: North to South Direction)
Table 3G.4-10 Results of NASTRAN Analysis: Seismic Load (Horizontal: East to West Direction)
Table 3G.4-11 Results of NASTRAN Analysis: Seismic Load (Vertical: Upward Direction)
Table 3G.4-12 Combined Forces and Moments: Selected Load Combination FWSC-3
Table 3G.4-13 Combined Forces and Moments: Selected Load Combination FWSC-4
Table 3G.4-14 Combined Forces and Moments: Selected Load Combination FWSC-6
Table 3G.4-15 Combined Forces and Moments: Selected Load Combination FWSC -7
Table 3G.4-16 Sectional Thicknesses and Rebar Ratios Used in the Evaluation
Table 3G.4-17 Rebar and Concrete Stresses: Selected Load Combination FWSC-3
Table 3G.4-18 Rebar and Concrete Stresses: Selected Load Combination FWSC-4
Table 3G.4-19 Rebar and Concrete Stresses: Selected Load Combination FWSC-6

Table 3G.4-20 Rebar and Concrete Stresses: Selected Load Combination FWSC-7
Table 3G.4-21 Calculation Results for Transverse Shear
Table 3G.4-22 Factors of Safety for Foundation Stability
Table 3G.4-23 Maximum Soil Bearing Stress Involving SSE
Table 3H-1 Cross Reference of Plant Environmental Data and Location
Table 3H-2 Thermodynamic Environment Conditions Inside Containment Vessel for Normal Operating Conditions
Table 3H-3 Thermodynamic Environment Conditions Inside Reactor Building for Normal Operating Conditions
Table 3H-4 Thermodynamic Environment Conditions Inside Control Building for Normal Operating Conditions
Table 3H-5 Radiation Environment Conditions Inside Containment Vessel for Normal Operating Conditions
Table 3H-6 Radiation Environment Conditions Inside Reactor Building for Normal Operating Conditions
Table 3H-7 Radiation Environment Conditions Inside Control Building for Normal Operating Conditions
Table 3H-8 Thermodynamic Environment Conditions Inside Containment Vessel for Accident Conditions
Table 3H-9 Thermodynamic Environment Conditions Inside Reactor Building for Accident Conditions
Table 3H-10 Thermodynamic Environment Conditions Inside Control Building for Accident Conditions
Table 3H-11 Radiation Environment Conditions Inside Containment Vessel for Accident Conditions
Table 3H-12 Room Heat Loads
Table 3H-13 Typical Mild Environment Parameter Limits
Table 3L-1 Comparison of Major Steam Dryer Configuration Parameters
Table 3L-2 Specific Steam Dryer Load Definition Legend
Table 3L-3 Typical Vibration Sensors
Table 3L-4 Typical Sensor Locations and Types(1)
Table 3L-5 Applicable Data Reduction Method for Comparison to Criteria
Table 3L-6 Parameters Used in Spectrum Generation
Table 3L-7 Data Evaluation Methods to be Used for Each Component

List of Illustrations

Figure 3G.1-1. RB and FB Concrete Outline Plan at EL -11500
Figure 3G.1-2. RB and FB Concrete Outline Plan at EL 4650
Figure 3G.1-3. RB and FB Concrete Outline Plan at EL 17500
Figure 3G.1-4. RB and FB Concrete Outline Plan at EL 27000
Figure 3G.1-5. RB Concrete Outline Plan at EL 34000
Figure 3G.1-6. RB and FB Concrete Outline N-S Section
Figure 3G.1-7. RB and FB Concrete Outline E-W Section
Figure 3G.1-8. FE Model of RB/FB (Isometric View)
Figure 3G.1-9. FE Model of RB/FB (Foundation Mat)
Figure 3G.1-10. FE Model of RB/FB (RCCV Wall)
Figure 3G.1-11. FE Model of RB/FB (RPV Pedestal)
Figure 3G.1-12. FE Model of RB/FB (Top Slab)
Figure 3G.1-13. FE Model of RB/FB (Suppression Pool Slab)
Figure 3G.1-14. FE Model of RB/FB (External Wall: North Side)
Figure 3G.1-15. FE Model of RB/FB (External Wall: East Side)
Figure 3G.1-16. FE Model of RB/FB (Internal Wall on R7/F1 Column Line)
Figure 3G.1-17. FE Model of RB/FB (RCCV Internals)
Figure 3G.1-18. FE Model of RB/FB (RCCV Liner)
Figure 3G.1-19. Soil Pressure at Rest
Figure 3G.1-20. Sections Where Thermal Loads Are Defined
Figure 3G.1-21. Condensation Oscillation (CO) Pressure Loads
Figure 3G.1-22. Chugging (CHUG) Pressure Loads
Figure 3G.1-23. Safety Relief Valve (SRV) Pressure Loads
Figure 3G.1-24. Design Seismic Shears and Moments for RB and FB Walls
Figure 3G.1-25. Design Seismic Shears and Moments for RCCV
Figure 3G.1-26. Design Seismic Shears and Moments for RPV Pedestal and Vent Wall
Figure 3G.1-27. Seismic Lateral Soil Pressure
Figure 3G.1-28. Section Considered for Analysis
Figure 3G.1-29. Force and Moment in Shell Element
Figure 3G.1-30. Section Deformation for Dead Load
Figure 3G.1-31. Section Deformation for Drywell Unit Pressure (1 MPa)
Figure 3G.1-32. Section Deformation for Wetwell Unit Pressure (1 MPa)
Figure 3G.1-33. Section Deformation for Thermal Load (Normal Operation: Winter)
Figure 3G.1-34. Section Deformation for Thermal Load (LOCA After 6 min.: Winter)
Figure 3G.1-35. Section Deformation for Thermal Load (LOCA After 72 hr.: Winter)
Figure 3G.1-36. Section Deformation for Seismic Load (Horizontal: North to South)
Figure 3G.1-37. Section Deformation for Seismic Load (Horizontal: East to West)
Figure 3G.1-38. Section Deformation for Seismic Load (Vertical: Upward)
Figure 3G.1-39. Flow Chart for Structural Analysis and Design
Figure 3G.1-40. Reinforcing Steel of Foundation Mat: Plan
Figure 3G.1-41. Reinforcing Steel of Foundation Mat: Section A-A
Figure 3G.1-42. Reinforcing Steel of RCCV Wall
Figure 3G.1-43. Reinforcing Steel of Suppression Pool Slab
Figure 3G.1-44. Reinforcing Steel of Top Slab

Figure 3G.1-45. Reinforcing Steel of RPV Pedestal
Figure 3G.1-46. Reinforcing Steel of IC/PCCS Pool Girder
Figure 3G.1-47. List of RB Wall and Slab Reinforcement
Figure 3G.1-48. Liner Anchor
Figure 3G.1-49. Liner Plate Plans
Figure 3G.1-50. Liner Plate Development Elevation
Figure 3G.1-51. Drywell Head
Figure 3G.1-52. Equipment Hatch
Figure 3G.1-53. Wetwell Hatch
Figure 3G.1-54. Personnel Airlock
Figure 3G.1-55. Diaphragm Floor
Figure 3G.1-56. Diaphragm Floor Slab Anchor
Figure 3G.1-57. RPV Support Bracket & Vent Wall
Figure 3G.1-58. Reactor Shield Wall
Figure 3G.1-59. GDCS Pool
Figure 3G.1-60. Comparison of Basemat Deformation without Tension Springs (NS Direction SSE)
Figure 3G.1-61. Comparison of Basemat Deformation without Tension Springs (EW Direction SSE)
Figure 3G.1-62. Comparison of Basemat Sectional Moments (S to N SSE)
Figure 3G.1-63. Comparison of Basemat Sectional Moments (W to E SSE)
Figure 3G.1-64. Comparison of Basemat Sectional Moments (E to W SSE)
Figure 3G.1-65. Concrete Backfill in Sliding Evaluation
Figure 3G.2-1. CB Concrete Outline Plan at EL -7400 and Foundation Reinforcement
Figure 3G.2-2. CB Concrete Outline Plan at EL –2000/4850 and Section Details
Figure 3G.2-3. CB Concrete Outline Plan at EL 9060, Section and Section Detail
Figure 3G.2-4. FE Model of CB (Isometric View)
Figure 3G.2-5. FE Model of CB (Foundation Mat)
Figure 3G.2-6. FE Model of CB (External Wall: South Side)
Figure 3G.2-7. FE Model of CB (External Wall: East Side)
Figure 3G.2-8. FE Model of CB (Floor Slab: EL -2000)
Figure 3G.2-9. FE Model of CB (Floor Slab: EL 4650)
Figure 3G.2-10. FE Model of CB (Floor Slab: EL 9060)
Figure 3G.2-11. FE Model of CB (Roof: EL 13800)
Figure 3G.2-12. Soil Pressure at Rest
Figure 3G.2-13. Sections Where Thermal Loads Are Defined
Figure 3G.2-14. Design Seismic Shears and Moments for CB
Figure 3G.2-15. Seismic Lateral Soil Pressure
Figure 3G.2-16. Force and Moment in Shell Element
Figure 3G.2-17. Concrete Backfill in Sliding Evaluation
Figure 3G.3-1. Sections Where Thermal Loads Are Defined
Figure 3G.3-2. Section Considered for Analysis
Figure 3G.3-3. Force and Moment in Shell Element
Figure 3G.3-4. Reinforcing Steel of Spent Fuel Pool Walls
Figure 3G.3-5. List of FB Wall and Slab Reinforcement
Figure 3G.4-1. FWSC Concrete Outline and Typical Rebar Arrangement

Figure 3G.4-2. FE Model of FWSC (Isometric View)
Figure 3G.4-3. FE Model of FWSC (Foundation Mat)
Figure 3G.4-4. FE Model of FWSC (South FWS Wall)
Figure 3G.4-5. FE Model of FWSC (FPE Wall: East and South)
Figure 3G.4-6. FE Model of FWSC (FPE Roof Slab, South FWS Roof Slab)
Figure 3G.4-7. Sections Where Thermal Loads Are Defined
Figure 3G.4-8. Design Seismic Shears and Moments for FWSC (FWS)
Figure 3G.4-9. Design Seismic Shears and Moments for FWSC (FPE)
Figure 3G.4-10. Force and Moment in Shell Element
Figure 3G.4-11. Shear Keys and Concrete Backfill in Sliding Evaluation
Figure 3H-1. Control Room Habitability Area
Figure 3J-1. Simplified Piping Models
Figure 3J-2. Representation of Pipe With Both Ends Supported With a Longitudinal Break
Figure 3L-1. Chimney and Partition Assembly
Figure 3L-2. ESBWR Steam Dryer Assembly

Abbreviations And Acronyms List

Term	Definition
10 CFR	Title 10, Code of Federal Regulations
ABS	Absolute Sum
ABWR	Advanced Boiling Water Reactor
AC	Alternating Current
ACI	American Concrete Institute
AISC	American Institute of Steel Construction
ALWR	Advanced Light Water Reactor
ANS	American Nuclear Society
ANSI/AISC	American National Standards Institute/American Institute of Steel Construction
AOO	Anticipated Operational Occurrence
AP	Annulus Pressurization
ASCE	American Society of Civil Engineers
ASME	American Society of Mechanical Engineers
ASTM	American Society of Testing Methods
B&PV	Boiler and Pressure Vessel
BWR	Boiling Water Reactor
BWRVIP	Boiling Water Reactor Vessel Internals Program
C&FS	Condensate and Feedwater System
CB	Control Building
CBHVAS	Control Building Heating, ventilation and Air Conditioning System
CHUG	Chugging
CO	Condensation Oscillation
COL	Combined Operating License
CRD	Control Rod Drive
CRDH	Control Rod Drive Housing
CRGT	Control Rod Guide Tube
CRHA	Control Room Habitability Area
CS&TS	Condensate Storage and Transfer System
CSF	Combined shape factor
CST	Condensate Storage Tank
D/F	Diaphragm Floor
DBA	Design Basis Accident
DCD	Design Control Document
DCIS	Distributed Control and Information System
DLF	Dynamic Load Factor
DPV	Depressurization Valve
EQ	Environmental Qualification
FAPCS	Fuel and Auxiliary Pools Cooling System

Abbreviations And Acronyms List

Term	Definition
FB	Fuel Building
FEA	Finite Element Analysis
FIV	Flow-Induced Vibration
FO	Diesel Fuel Oil Storage Tank
FPE	Fire Pump Enclosure
FW	Feedwater
FWS	Fire Water Storage Tank
FWSC	Fire Water Service Complex
GDCS	Gravity-Driven Cooling System
HCU	Hydraulic Control Unit
HELB	High Energy Line Break
HP	High Pressure
HVAC	Heating, Ventilation and Air Conditioning
IC	Isolation Condenser
IC/PCC	Isolation Condenser/Passive Containment Cooling
IC/PCCS	Isolation Condenser/Passive Containment Cooling System
ICM	In-core Monitor
ICMGT	In-core Monitor Guide Tubes
ICMH	In-core Monitor Housing
ICS	Isolation Condenser System
IEEE	Institute of Electrical and Electronic Engineers
IGA	Intergranular Attack
IGSCC	Intergranular Stress Corrosion Cracking
ISI	In-Service Inspection
ISLOCA	Intersystem Loss-of-Coolant-Accident
LOCA	Loss-of-Coolant-Accident
LPCI	Low Pressure Coolant Injection
LVDT	Linear Variable Differential Transformer
MCR	Main Control Room
MS	Main Steam
MSL	Main Steamline
NBS	Nuclear Boiler System
NRC	Nuclear Regulatory Commission
p-p	Peak-to-Peak
PCC	Passive Containment Cooling
PCCS	Passive Containment Cooling System
PDA	Pipe Dynamic Analysis
PMP	Probable Maximum Precipitation
PMWP	Probable Maximum Winter Precipitation

Abbreviations And Acronyms List

Term	Definition
PPQS	Product Performance Qualification Specification
PSS	Process Sampling System
RB	Reactor Building
RB/FB	Reactor Building/Fuel Building
RBV	Reactor Building Vibration
RCCV	Reinforced Concrete Containment Vessel
RCPB	Reactor Coolant Pressure Boundary
RMS	Root Mean Square
RPV	Reactor Pressure Vessel
RPVSB	RPV Support Bracket
RRS	Required Response Spectrum
RSW	Reactor Shield Wall
RWCU	Reactor Water Cleanup
RWCU/SDC	Reactor Water Cleanup/Shutdown Cooling
SBO	Station Blackout
SCF	Stress Concentration Factor
SIL	Service Information Letter
SIT	Structural Integrity Test
SLC	Standby Liquid Control
SRP	Standard Review Plan
SRSS	Square Root of the Sum of the Squares
SRV	Safety Relief Valve
SSE	Safe Shutdown Earthquake
TRS	Test Response Spectra
URS	Ultimate Rupture Strength
USNRC	United States Nuclear Regulatory Commission
VW	Vent Wall
ZPA	Zero Period Acceleration

3G. DESIGN DETAILS AND EVALUATION RESULTS OF SEISMIC CATEGORY I STRUCTURES

This appendix presents the structural design and analysis for the Reactor Building, Control Building, Fuel Building and Fire Water Service Complex of the ESBWR Standard Plant. It addresses all applicable items included in Appendix C to United States Nuclear Regulatory Commision (USNRC) Standard Review Plan, NUREG-0800, Subsection 3.8.4. Drawings depicted in the Design Control Document (DCD) are not used for construction. Construction drawings meet the technical licensing commitments made in the DCD but are issued under different contractual/industrial rules than the DCD drawings.

3G.1 REACTOR BUILDING

The Reactor Building (RB) encloses the concrete containment and its internal systems, structures, and components. In addition, the RB contains the Isolation Condenser/Passive Containment Cooling (IC/PCC) pools and the services pools for storage of Dryer/Separator on the top of the concrete containment.

3G.1.1 Objective and Scope

The objective of this subsection is to document the structural design details, inputs and analytical results from the analysis of the ESBWR main building structures encased in the Reactor Building. The scope includes the design and analysis of the structure for normal, severe environmental, extreme environmental, and abnormal loads.

3G.1.2 Conclusions

The following are the major summary conclusions on the design and analysis of the Reactor Building, the concrete containment and the containment internal structures.

- Based on the results of finite element analyses performed in accordance with the design conditions identified in Subsections 3G.1.3 and 3G.1.5, stresses and/or strains in concrete, reinforcement, liner and containment internal structures are less than the allowable stresses and/or strains per the applicable regulations, codes or standards listed in Section 3.8.
- The factors of safety against floatation, sliding, and overturning of the structure under various loading combinations are higher than the required minimum.
- The thickness of the roof slabs and exterior walls are more than the minimum required to preclude penetration, perforation or spalling resulting from impact of design basis tornado missiles.

3G.1.3 Structural Description

3G.1.3.1 Description of the Reactor Building

3G.1.3.1.1 Reactor Building Structure

The RB structure and the containment structure share the same wall structure which encloses the Gravity-Driven Cooling System (GDCS) pools and the Suppression pool. The RB structure consists of the following areas that are not part of the containment structure.

- RB super structure at and above the refueling floor, up to the support for the bridge crane, including the roof, is made of reinforced concrete floors and walls (floor slabs can also be composite structure). Roof trusses and their supporting columns are made of structural steel.
- Passive Containment Cooling System (PCCS) and Isolation Condenser (IC) heat exchanger pools, the separator/dryer storage pool, the reactor cavity and the buffer pool.
- Rooms at several elevation levels outside the containment but attaching to the containment structure.
- The main steam tunnel that consists of reinforced concrete walls and floor.

The key dimensions of the RB are summarized in Table 3.8-8. Figures 3G.1-1 through 3G.1-7 show the configurations of the RB.

The Fuel Building (FB) is integrated with the RB in the ESBWR standard plant. The RB and FB share a common wall between them and a large common basemat. The summary of the FB design is described in Section 3G.3.

3G.1.3.1.2 Containment and Containment Structure

The containment is a reinforced concrete containment vessel (RCCV), which encloses the reactor pressure vessel (RPV) and its related systems and components. The containment is divided into a drywell region and a wetwell region with an interconnecting vent system.

The key dimensions of the RCCV are summarized in Table 3.8-1. Figure 3.8-1 shows the configuration of the RCCV.

The containment structure boundary consists of the containment top slab with removable drywell head, the containment cylindrical wall that is also the outer wall of the suppression pool, the suppression pool floor slab, the RPV pedestal that encloses the volume under the RPV, and the basemat. The concrete containment is lined with a steel liner for leak-tightness. The containment cylindrical outer wall extends below the suppression pool floor slab to the basemat. This extension is not part of the containment pressure boundary, however, it supports the upper containment cylinder. The reinforced concrete basemat foundation supports the entire containment system, which includes the RPV pedestal, and extends to support the reactor building surrounding the containment. The outline drawings are shown in Figures 3G.1-1 through 3G.1-7.

3G.1.3.1.3 Reactor Building Structure/Containment Structure Connections

The RCCV and the RB structure are integrated by the Isolation Condenser/Passive Containment Cooling System (IC/PCCS) pool girders at the top of the containment and by floor slabs at elevations that are defined as part of the RB structure and the basemat. The IC/PCCS pool girders are deep reinforced concrete girders, and they are integrated with the containment top slab and with RB walls.

3G.1.3.1.4 Containment Internal Structures

The containment internal structures consist of the diaphragm floor slab, vent wall, GDCS pool walls, reactor shield wall, and the RPV support bracket. These structures are shown in the general arrangement drawings in this appendix.

The diaphragm floor slab acts as a barrier between the drywell and the wetwell. The diaphragm floor slab is supported on the reinforced concrete containment wall at its outer periphery and on the vent wall at its inner periphery. The diaphragm floor slab is a concrete-filled steel structure. The space between the floor slab top and bottom plates is filled with concrete. The slab is supported by a system of radial beams spaced evenly all around and spanning between the vent wall structure and the reinforced concrete containment wall.

The vent wall structure is also a concrete–filled steel design consisting of two concentric carbon steel cylinders connected together by vertical web plates evenly spaced all around. The vent wall structure is anchored at the bottom into the RPV pedestal and is restrained at the top by the diaphragm floor slab. The cylindrical annulus carries 12 vent pipes and 12 safety relief valve downcomer pipes with sleeves, from the drywell into the suppression pool. The space in the cylindrical annulus is filled with concrete.

There are three GDCS pools supported on top of the diaphragm floor slab. The pools on one side are contained by the reinforced concrete containment wall and on the other side by structural steel walls.

The reactor shield wall is a thick steel cylindrical structure that surrounds the RPV. It is supported by the RPV support brackets and the reactor pedestal. The function of the reactor shield wall is to attenuate radiation emanating from the RPV. In addition, the reactor shield wall provides structural support for the RPV stabilizer, the RPV insulation and miscellaneous equipment, piping and commodities. Openings are provided in the reactor shield wall to permit the routing of necessary piping to the RPV and to permit inservice inspection of the RPV and piping.

3G.1.4 Analytical Models

3G.1.4.1 Structural Models

The RB and the RCCV including its internal structures are analyzed as one integrated structure utilizing the finite element computer program NASTRAN. The finite element model consists of quadrilateral, triangular, and beam elements. The quadrilateral and triangular elements are used to represent the slabs and walls. Beam elements are used to represent columns and beams. The model is shown in Figures 3G.1-8 to 3G.1-18.

As shown in Figure 3G.1-8, the FB is also included in the model, because the FB is integrated with the RB. The model includes the whole (360°) portion of the RB including the RCCV and FB taking the application of nonaxisymmetrical loads and the asymmetric layout of the FB structure into consideration.

Liner plates of various thicknesses as shown in Figure 3G.1-48 are included in the model at locations of the pressure boundary of the containment. The liner plate nodal points are connected to the containment nodal points by rigid beams. The liner plate elements are shown in Figure 3G.1-18. Pressure loads in the containment are applied on the liner plate.

The vent wall and the diaphragm floor are concrete-filled structures consisting of steel plates and concrete. The infill concrete is neglected in analysis model conservatively. Steel plates including connecting rib plates and girders are modeled by shell elements. The GDCS pool, the reactor shield wall and the RPV support brackets are also included in the analysis model. These structures are modeled by shell elements, except the GDCS pool beams which are modeled by beam elements. The analysis model of these structures is shown in Figure 3G.1-17. For the GDCS pool, the detail stress evaluation is performed using a local model.

The following major penetrations in the concrete containment are included in the model in order to take local reduction of the wall stiffness into consideration. The penetrations in the model are shown in Figures 3G.1-10 and 3G.1-11.

- upper drywell equipment and personnel hatches
- lower drywell equipment and personnel hatches
- wetwell access hatch
- main steam and feedwater pipe penetrations.

Small penetrations in the containment are not modeled because their effects on the wall stiffness are negligible.

The nodal points are defined by a right hand Cartesian coordinate system X, Y, Z. This system, called the global coordinate system, has its origin located at the center of the containment at the bottom of the RPV, i.e., EL 0. The positive X axis is parallel with the IC/PCCS pool girder in the 180° direction of the containment; the Y axis is perpendicular to the IC/PCCS pool girder in the 90° direction of the containment; the Z axis is vertical upward. This coordinate system is shown in Figure 3G.1-8.

3G.1.4.2 Foundation Models

The foundation soil is represented by soil springs. The spring constants for rocking and translations are determined based on the following soil parameters which correspond to the Soft Site conditions described in Appendix 3A.

- Shear wave velocity: 300 m/s (1000 ft/s)
- Unit weight: 0.0196 MN/m^3 (125 lbf/ft^3)
- Shear modulus: 180 MN/m^2 (26110 psi)
- Poisson's Ratio: 0.478

Soil springs are attached to the bottom of the foundation mat, and the constraints by side soil are not included in the model. The values of the soil springs used in the analysis are shown in Table 3G.1-1. The springs have perfectly elastic stiffness.

These spring values are multiplied by the foundation mat nodal point tributary areas to compute the spring constants assigned to the base slab nodal points.

3G.1.5 Structural Analysis and Design

3G.1.5.1 Site Design Parameters

The key site design parameters are located in Table 3G.1-2.

3G.1.5.2 Design Loads, Load Combinations, and Material Properties

3G.1.5.2.1 Design Loads

3G.1.5.2.1.1 Dead Load (D) and Live Load (L and L_o)

The weights of structures are evaluated using the following unit weights.

- reinforced concrete: 23.5 kN/m^3 (150 lbf/ft^3)
- plain concrete: 22.5 kN/m^3 (143 lbf/ft^3)
- steel: 77.0 kN/m^3 (490 lbf/ft^3)

Weights of major equipment, miscellaneous structures, piping, and commodities are summarized in Tables 3G.1-3 through 3G.1-5.

Live loads on the RB floor and roof slabs are described in Subsection 3.8.4.3.1.1.

For the computation of global seismic loads, the value of floor live load is limited to the expected live load, L_o, during normal plant operation. The values of L_o are 25% of the above full floor live loads, L, when used in combination with seismic and dead loads as described in Subsection 3.8.4.3.1.1.

3G.1.5.2.1.2 Snow and Rain Load

The snow load and rain load is applied to the roof slabs and is taken as shown in Table 3G.1-2. One hundred percent of the snow load is applied when combined with seismic loads.

3G.1.5.2.1.3 Lateral Soil Pressure at Rest

The lateral soil pressure at rest is applied to external walls below grade and is based on soil properties given in Table 3G.1-2. Pressures to be applied to the walls are provided in Figure 3G.1-19.

3G.1.5.2.1.4 Wind Load (W)

The wind load is applied to the roof slabs and external walls above grade and is based on basic wind speed given in Table 3G.1-2.

3G.1.5.2.1.5 Tornado Load (W_t)

The tornado load is applied to the roof slabs and external walls above grade and its characteristics are given in Table 3G.1-2. The tornado load, W_t, is further defined by the following combinations:

$W_t = W_w$

$W_t = W_p$

$W_t = W_m$

$W_t = W_w + 0.5W_p$

$W_t = W_w + W_m$

$W_t = W_w + 0.5W_p + W_m$

where,

W_t = Total Tornado Load

W_w = Tornado Wind Load

W_p = Tornado Differential Pressure Load

W_m = Tornado Missile Load

3G.1.5.2.1.6 Thermal Loads

Thermal loads are evaluated for the normal operating conditions and abnormal (Loss-of-Coolant-Accident [LOCA]) conditions. Figure 3G.1-20 shows the section location for temperature distributions for various structural elements, and Table 3G.1-6 shows the magnitude of equivalent linear temperature distribution.

The evaluation method of temperature effect on the concrete design is based on ACI 349-01 Commentary Figure RA.1.

The two cases, winter and summer, are considered in the analysis.

Stress-free temperature is 15.5°C (60°F).

3G.1.5.2.1.7 Pressure Loads

Table 3G.1-7 shows the pressure loads applied to the RCCV during normal operation, structural integrity test, and the LOCA. Pressure loads in the IC/PCCS pools are provided in Table 3G.1-8.

3G.1.5.2.1.8 Condensation Oscillation (CO) and Chugging (CHUG) Loads

The condensation oscillation (CO) and chugging (CHUG) pressure loads along with Dynamic Load Factors (DLF) are provided in Figures 3G.1-21 and 3G.1-22.

3G.1.5.2.1.9 Safety Relief Valve (SRV) Loads

The SRV loads along with DLF are provided in Figure 3G.1-23.

3G.1.5.2.1.10 Steam Tunnel Subcompartment Pressure

The design pressure in the RB main steam tunnel to account for a main steam line break is 76.0 kPag (11.0 psig). Thermal loads need not be included due to short duration of the tunnel pressurization.

3G.1.5.2.1.11 Subcompartment Pressure in Other Compartments

For ESBWR, the Reactor Water Cleanup/Shutdown Cooling (RWCU/SDC) system is considered high energy during normal operation. The maximum design pressure inside the affected subcompartments from the high energy line break (HELB) of the system is 34.5 kPag (5.0 psig). Thermal loads need not be included due to short duration of subcompartment pressurization.

3G.1.5.2.1.12 Annulus Pressurization (AP) Loads

The annulus pressurization (AP) loads due to Feedwater (FW) and RWCU breaks are considered. AP loads contain pressure load and associated jet forces and pipe whip restraint loads.

3G.1.5.2.1.13 Design Seismic Loads

The design seismic loads are obtained by soil – structure interaction analyses, which are described in Appendix 3A. The seismic loads used for design are as follows:

- Figure 3G.1-24: design seismic shears and moments for RB and FB walls
- Figure 3G.1-25: design seismic shears and moments for RCCV
- Figure 3G.1-26: design seismic shears and moments for RPV Pedestal and Vent Wall
- Table 3G.1-9: maximum vertical acceleration

The seismic loads are composed of one vertical and two perpendicular horizontal components. The effects of the three components are combined based on the 100/40/40 method as described in Subsection 3.8.1.3.6.

Seismic lateral soil pressure for wall design is provided in Figure 3G.1-27 using the envelope pressure of the elastic procedure described in ASCE 4-98 Subsection 3.5.3.2 and SASSI results as described in Subsection 3A.8.8.

Seismic member forces for each section are obtained directly from the NASTRAN analysis using these seismic input loads.

3G.1.5.2.2 Load Combinations and Acceptance Criteria

Load combinations and acceptance criteria for the various elements of the RB complex are discussed on the following subsections.

3G.1.5.2.2.1 Reinforced Concrete Containment Vessel (RCCV)

Table 3.8-2 gives a detailed list of various Service and Factored load combinations with acceptance criteria per ASME Section III Division 2. Based on previous experience, critical load combinations are selected for the RCCV design. They are mainly combinations including LOCA loads and seismic loads as shown in Table 3G.1-10. The acceptance criteria for the selected combinations are also included in Table 3G.1-10.

3G.1.5.2.2.2 Steel Containment Components

Table 3.8-4 gives a detailed list of various load combinations with acceptance criteria per ASME Section III Division 1, Subsection NE. For the drywell head, the loads of W, W', R_o, R_a and Y are not direct loads and their indirect effects through the supporting RCCV top slab are negligibly small.

3G.1.5.2.2.3 Containment Internal Structures

Table 3.8-7 gives a detailed list of various load combinations with acceptance criteria per ANSI/AISC N690.

3G.1.5.2.2.4 Reactor Building (RB) Concrete Structures Including Pool Girders

Table 3.8-15 gives load combinations for the safety-related reinforced concrete structure. Based on previous experience, critical load combinations are selected for the RB design. They are mainly combinations including LOCA loads and seismic loads as shown in Table 3G.1-11. The acceptance criteria for the selected combinations are also included in Table 3G.1-11.

3G.1.5.2.3 Material Properties

3G.1.5.2.3.1 Concrete

Properties of concrete used for the design analyses are shown in Table 3G.1-12.

Concrete has a tendency to change properties when subjected to elevated temperatures. For the ESBWR design, reduction of concrete strength due to high temperature is determined based upon the average value of the following upper bound and lower bound equations excerpted from Reference 3G.1-1.

- Lower bound reduction factor
  - $\phi = 1.0 - 0.0030\ (T-21.1)$ $\quad$ 21.1°C (70°F) ≤ T ≤ 121.1°C (250°F)
  - $\phi = 0.70 - 0.00083\ (T-121.1)$ $\quad$ 121.1°C (250°F) ≤ T
- Upper bound reduction factor
  - $\phi = 1.0$ $\quad$ T ≤ 260.0°C (500°F)
  - $\phi = 1.0 - 0.00081\ (T-260.0)$ $\quad$ 260.0°C (500°F) ≤ T

Young's modulus for concrete is also determined based upon the average value of the following upper bound and lower bound equations excerpted from Reference 3G.1-1.

- Lower bound reduction factor
  - $\phi = 1.0 - 0.0069\ (T-21.1)$ $\quad$ 21.1°C (70°F) ≤ T ≤ 93.3°C (200°F)
  - $\phi = 0.50 - 0.0009\ (T-93.3)$ $\quad$ 93.3°C (200°F) ≤ T
- Upper bound reduction factor
  - $\phi = 1.0 - 0.00056\ (T-21.1)$ $\quad$ 21.1°C (70°F) ≤ T ≤ 204.4°C (400°F)
  - $\phi = 0.90 - 0.0015\ (T-204.4)$ $\quad$ 204.4°C (400°F) ≤ T

The design temperature of the drywell is 171°C (340°F) as shown in Table 1.3-3, and it satisfies the concrete temperature limit, 177°C (350°F), for accident or short term period specified in ASME Section III, Subsection CC-3440.

3G.1.5.2.3.2 Reinforcing Steel

Reinforcing steel is deformed billet steel conforming to ASTM A-615 grade 60. Minimum yield strength, F_y, is 413.6 MPa (60 ksi).

Reinforcing steel also has tendency to decrease in strength at elevated temperatures. The reduction of reinforcing steel strength is based upon the following equation excerpted from Reference 3G.1-1.

- Reduction Factor
  - $\phi = 1.0 - 0.000873\ (T-21.1)$ 21.1°C (70°F) ≤ T ≤ 204.4°C (400°F)

3G.1.5.2.3.3 Structural Steel

Properties of structural steel used for the design analyses are included in Table 3G.1-12.

3G.1.5.3 Stability Requirements

The RB foundation has the following safety factors against overturning and sliding. Because the impact on the stability by seismic load is larger than wind and tornado, the load combinations for W and W_t, which are shown in Table 3.8-14, are excluded.

Load Combination	Overturning	Sliding	Floatation
D + H + E'	1.1	1.1	
D + F'			1.1

Where
D = Dead Load, F' = Buoyant forces of design basis flood
H = Lateral soil pressure, E' = Safe Shutdown Earthquake

3G.1.5.4 Structural Design Evaluation

The evaluation of the containment structure, the containment internal structures, and the RB structures is based on the results from the load combinations indicated in Subsection 3G.1.5.2.2.

Figure 3G.1-28 shows the location of the sections that are selected for evaluation of reinforced concrete structures. They are selected, in principle, from the center and both ends of walls and slabs, where it is reasonably expected that the critical stresses appear based on engineering experience and judgment. The computer program SSDP-2D is used for the evaluation of stresses in rebar and concrete. The input to SSDP-2D consists of rebar ratios, material properties, and element geometry at the section under consideration together with the forces and moments from the NASTRAN analysis, which are shown in Tables 3G.1-13 through 3G.1-21. Element forces and moments listed in the tables are defined with relation to the element coordinate system shown in Figure 3G.1-29. Figures 3G.1-30 through 3G.1-38 indicate deformations of structures obtained by NASTRAN analyses for the loads corresponding to Table 3G.1-13 through 3G.1-21.

Figure 3G.1-39 shows a flow chart for the structural analysis and design. Figures 3G.1-40 through 3G.1-47 present the design drawings used for the evaluation of the containment and the Reactor Building structural design. Figures 3G.1-48 through 3G.1-50 show the design details of containment liner plate. Figures 3G.1-51 through 3G.1-54 show the design details of containment major penetrations. Figures 3G.1-55 through 3G.1-59 show the details of containment internal structures.

3G.1.5.4.1 Containment Structure

Tables 3G.1-22 through 3G.1-26 show the resultant combined forces and moments in accordance with the selected load combinations listed in Table 3G.1-10. Table 3G.1-27 lists the sectional thicknesses and rebar ratios used in the evaluation. At each section, in general, three elements are analyzed at azimuth 0°, 90° and 135°.

Tables 3G.1-28 through 3G.1-32 show the rebar and concrete stresses at these sections for the representative elements. Tables 3G.1-33 and 3G.1-34 summarize evaluation results for transverse shear and tangential shear in accordance with ASME Section III, Division 2, Article CC-3520.

Table 3G.1-35 shows the maximum strains of containment liner plate. Table 3G.1-36 shows the stress summary of drywell head.

3G.1.5.4.1.1 Containment Wall Including RPV Pedestal

Sections 1 through 9 shown in Figure 3G.1-28 are considered critical sections for the containment wall including the RPV pedestal. Maximum stress in the meridional rebar is found to be 287.5 MPa (41.70 ksi) at Section 4 near the bottom of the RCCV Wetwell due to load combination CV-11a, as shown in Table 3G.1-31. The maximum stress in the circumferential rebar is found to be 343.6 MPa (49.83 ksi), which occurs also at Section 4, the bottom of the RCCV Wetwell due to load combination CV-11a, as shown in Table 3G.1-31. The maximum concrete stress is found to be 17.7 MPa (2.57 ksi), which occurs at Section 1 due to load combination CV-11a.

The maximum transverse shear stress is found to be 4.56 MPa (0.66 ksi) at Section 1 for the load combination CV-11b. The amounts of shear ties provided satisfy the required values at all sections, as indicated in Table 3G.1-33.

As for tangential shear, the maximum stress of 4.26 MPa (0.62 ksi) is found at Section 4, the bottom of the Wetwell, due to the combination CV-11b. The value is less than the allowable tangential shear stress provided by orthogonal reinforcement, which is described in Table 3.8-3. The amounts of reinforcement provided satisfy the required values at all sections, as indicated in Table 3G.1-34.

Table 3G.1-35 shows liner plate strains. The liner maximum strain is found to be 0.0045 at Section 6, which is within allowable limits given in Table CC-3720-1, ASME Code Section III, Division 2. The liner stresses during construction are kept within the allowable values found in Table CC-3720-1 of ASME Code Section III, Division 2 by limiting concrete placement pressure to a maximum of 167 kPa (24.22 psi) for the top slab, 48 kPa (6.96 psi) for the upper drywell/lower drywell wall and 32 kPa (4.64 psi) for the wetwell wall.

3G.1.5.4.1.2 Containment Top Slab and Suppression Pool Slab

Sections 12 through 17 are examined for the Containment Top Slab and Suppression Pool Slab. The locations of these sections are shown in Figure 3G.1-28. The maximum rebar stresses are found to be 260.3 MPa (37.75 ksi) at Section 17 due to the load combination CV-11b in the Top Slab, and 252.9 MPa (36.68 ksi) at Section 14 due to the combination CV-11a in the Suppression Pool Slab. The maximum concrete stresses are 12.9 MPa (1.87 ksi) and 19.6 MPa (2.84 ksi) in the Top Slab and the Suppression Pool Slab, respectively.

The maximum transverse shear stresses are found to be 1.13 MPa (0.16 ksi) at Section 15 for the load combination CV-11b in the Top Slab, and 4.15 MPa (0.60 ksi) at Section 12 for the combination CV-11a in the Suppression Pool Slab. The amounts of shear ties provided satisfy the required values at all sections, as indicated in Table 3G.1-33.

Maximum Liner strain is found to be 0.0029 at Section 12 as shown in Table 3G.1-35 and is within ASME Code allowable.

3G.1.5.4.1.3 Containment Foundation Mat

Sections 10 and 11 are evaluated for the part of the concrete containment in the foundation mat. The sections are shown in Figure 3G.1-28. The maximum rebar stress is calculated as 287.4 MPa (41.68 ksi) at Section 11 just inside the RPV Pedestal and is shown in Table 3G.1-32. The maximum transverse shear stress of 1.37 MPa (0.2 ksi) is found also at the Section 11 for the load combination CV-11a.

The liner plate maximum strain is found to be 0.0004 at Section 11 as shown in Table 3G.1-35.

3G.1.5.4.1.4 Drywell Head

Figure 3G.1-51 shows the design details. The highest stresses are summarized in Table 3G.1-36. The stresses except PL+Pb+Q at service Level A and B are well within the allowable stress limits. PL+Pb+Q at service Level A and B exceeds allowable, however, it meets all requirements for simplified elastic-plastic analysis stipulated in NE-3228.3 of ASME B&PV Code, Sec. III.

Simplified Elastic-Plastic Analysis

The range of primary plus secondary stress intensity S_n is 797 MPa (116 ksi) and the allowable of $3S_{m1}$ is 456 MPa (66.1 ksi) from Table 3G.1-36. S_n exceeds $3S_{m1}$, so simplified elastic-plastic analysis is required. The results of comparison against each requirement of NE-3228.3 are as follows.

(1) NE-3228.3 (a)

The range of primary plus secondary membrane plus bending stress intensity, excluding thermal bending stress is 393 MPa (57.0 ksi) from the result of FEM analysis.

(2) NE-3228.3 (b)

The values of S_a used for entering the design fatigue curve is multiplied by the factor K_e. The values of m and n are decided as 3 and 0.2 respectively from Table NE-3228.3(b) -1 of ASME B&PV Code, Sec. III. Because S_{m1} is 152 MPa (22.0 ksi) from Table 2A of ASME B&PV Code, Sec. II, Part D, $3 \cdot m \cdot S_{m1}$ is calculated as 1368 MPa (198 ksi). S_n = 797 MPa

(116 ksi) is between $3 \cdot S_{m1}$ = 456 MPa (66.1 ksi) and $3 \cdot m \cdot S_{m1}$ = 1368 MPa (198 ksi), so K_e is calculated by the following Formula:

$$K_e = 1.0 + \left[(1-n)/n \cdot (m-1)\right] \cdot \left[(S_n/3 \cdot S_{m1}) - 1\right] = 2.5$$

(3) NE-3228.3 (c)

Fatigue evaluation is conducted as follows:

$S_a = K_e \cdot S_n$ = 1993 MPa (289 ksi)

E_1 = 207 GPa (30000 ksi)

E_2 = 194 GPa (28100 ksi)

Where

E_1: Modulus of elasticity given on the design fatigue curve from Figure I-9.1 of Appendix I of Sec. III.

E_2: Modulus of elasticity at 340°F (171°C) from Table TM-1 of Sec. II, Part D

$S_a' = S_a \cdot (E_1/E_2)$ = 2131 MPa (309 ksi)

S_a for 10 cycles is 3999 MPa (580 ksi) from Table I-9.1 (UTS ≤ 80 ksi) and N for S_a' = 2131 MPa (309 ksi) is obtained as 38 from Table I-9.1, General Note (b). So the requirement of NE-3228.3 (c) is satisfied.

(4) NE-3228.3 (d)

Because an accident temperature T_a is not a cyclic load, the thermal ratcheting can be neglected.

(5) NE-3228.3 (e)

From Table NE-3228.3(b)-1, the maximum temperature T_{max} is 370°C (700°F) for carbon steel. T_a is 171°C (340°F), so it satisfies this requirement.

(6) NE-3228.3 (f)

Specified minimum yield strength S_y and specified minimum tensile strength S_u of SA-516 Gr. 70 are 262 MPa (38 ksi) and 483 MPa (70 ksi) respectively. The ratio of S_y to S_u is calculated as 0.543. This value is below 0.80. So it satisfies this requirement.

Fatigue Evaluation

Fatigue evaluation is performed in accordance with ASME B&PV Code Section III, Subsection NE-3221.5(d) in which the limits on peak stress intensities as governed by fatigue are considered and satisfied when the Service Loadings meet the stipulated condtion.

3G.1.5.4.2 Containment Internal Structures

Tables 3G.1-37 through 3G.1-44 show the summary of stress analysis results for containment internal structures.

The type of analyses for various loads considered for the containment internal structures, such as diaphragm floor, vent wall (VW), RPV support bracket (RPVSB), reactor shield wall and GDCS pool are:

(1) Dead load

Static analysis is performed for the dead load to all containment internal structures. Hydrostatic loads of pool water are also applied statically to vent wall and GDCS pool.

(2) Pressure load

Static analysis is performed for the pressure load (P_o and P_a) applied to diaphragm floor and vent wall.

(3) Thermal load

Static analysis is performed for the thermal load (T_o and T_a) to all internal structures. All steel temperature is the same as atmospheric temperature. The temperature of the intermediate node of VW rib plate is the average value of outer and inner plate ones.

(4) Seismic load

Static analyses are performed for the seismic load on diaphragm floor, vent wall, RPV support bracket and reactor shield wall in the integral NASTRAN model, and on GDCS pool in the GDCS pool local model.

In this response spectra analysis, it is assumed that all pool water mass is distributed uniformly on the GDCS pool wall and RCCV wall. This is considered as a conservative assumption, therefore sloshing is not considered in GDCS pool local model. For integral NASTRAN model, however, sloshing load is considered as the static pressure load on DF upper surface and static reaction load from GDCS pool wall. The results from integral NASTRAN model due to these loads are used for the structural integrity evaluation of the structures other than GDCS pool, while the results from GDCS pool local model are used for evaluation of GDCS pool itself.

(5) Hydrodynamic load

Static analysis is performed for the hydrodynamic load (CO, CH and SRV) on vent wall taking DLF = 2 into account.

(6) Pipe Break loads consist of Annulus Pressurization (AP) load, jet impingement and pipe-whip restraint loads

These loads acting on the Reactor Shield Wall (RSW) are first analyzed for dynamic response using the NASTRAN beam model. The resulting maximum values of bending moment and shear force are then applied to the integral NASTRAN static analysis model.

The Absolute Sum (ABS) method is used to combine the stresses due to dynamic loads, such as seismic, hydrodynamic and AP loads, for all steel structures except for the GDCS Pool for which the Square Root of the Sum of the Squares (SRSS) method is applied.

3G.1.5.4.2.1 Diaphragm Floor

Design of Structural Components

The design of the diaphragm floor (D/F) is based on the elastic analysis results obtained from model described in Subsection 3G.1.4. Figure 3G.1-55 shows design details. Table 3G.1-37 summarizes the highest stresses in various structural elements of the D/F slab. All stresses are within allowable stress limits.

Design of Anchorage

Figure 3G.1-56 shows diaphragm floor anchorage into the RCCV wall. Rebars are used for anchoring the steel plates. Threaded couplers are used so that the anchor bars can be connected after installation of the reinforcing steel of the RCCV wall. The anchorage is designed so as to avoid interference with the RCCV reinforcing steel. Anchorage requirements for various loading combinations and the capacity of anchorage provided is shown in Table 3G.1-38.

3G.1.5.4.2.2 Vent Wall Structure

Design of Structural Components

Figure 3G.1-57 shows the design details. Highest stresses in inner cylinder, outer cylinder and the web plates are summarized in Table 3G.1-39. The stresses are shown to be within allowable stress limits.

Design of Anchorage

Figure 3G.1-57 shows vent wall anchorage into the RCCV wall. Rebars are used for anchoring the steel plates. Threaded couplers are used so that the anchor bars can be connected after installation of the reinforcing steel of the RCCV wall. The anchorage is designed so as to avoid interference with the RCCV reinforcing steel. Anchorage requirements for various loading combinations and the capacity of anchorage provided is shown in Table 3G.1-42.

3G.1.5.4.2.3 Reactor Shield Wall

The reactor shield wall is designed to resist the loads and loading combinations discussed in Subsections 3G.1.5.2. AP loads are also considered.

Figure 3G.1-58 shows the design details. The highest stresses are summarized in Table 3G.1-40. The stresses are well within the allowable stress limits.

3G.1.5.4.2.4 RPV Support Bracket

Design of Structural Components

Figure 3G.1-57 shows the design details. The calculated stresses in various elements of the support bracket are shown in Table 3G.1-41 and are within allowable stress limits.

Design of Anchorage

Figure 3G.1-57 shows RPV support bracket anchorage into the RCCV wall. Rebars are used for anchoring the steel plates. Threaded couplers are used so that the anchor bars can be connected after installation of the reinforcing steel of the RCCV wall. The anchorage is designed so as to avoid interference with the RCCV reinforcing steel. Anchorage requirements for various loading combinations and the capacity of anchorage provided is shown in Table 3G.1-42.

3G.1.5.4.2.5 Gravity-Driven Cooling System Pool

Design of Structural Components

Figure 3G.1-59 shows the design details. Highest stresses are summarized in Table 3G.1-43. The stresses are within allowable stress limits.

Design of Anchorage

Threaded mechanical coupler with anchor bars are used as shown in Figure 3G.1-59. Table 3G.1-44 shows the anchorage requirements and capacity of anchorage provided.

3G.1.5.4.3 Reactor Building

Tables 3G.1-45 through 3G.1-49 show the resultant combined forces and moments in accordance with the selected load combinations listed in Table 3G.1-11. Table 3G.1-50 lists the sectional thicknesses and rebar ratios used in the evaluation. At each section, in general, three elements are analyzed at azimuth 0°, 90° and 135° (or 45°).

Tables 3G.1-51 through 3G.1-55 show the rebar and concrete stresses at these sections for the representative elements. Table 3G.1-56 summarizes evaluation results for transverse shear in accordance with ACI 349, Chapter 11.

Sections 18 through 31 shown in Figure 3G.1-28 are analyzed for the RB outside the containment. Sections 18 to 23 are selected for the RB shear walls, Section 24 for the basemat outside the containment, Sections 25 to 27 for the RB slabs, Sections 28 to 30 for the IC/PCCS pool girders and Section 31 for the Main Steam tunnel wall and slab.

3G.1.5.4.3.1 RB Shear Walls

The maximum rebar stress of 369.1 MPa (53.5 ksi) is found in the vertical rebar at Section 21 due to the load combination RB-9b as shown in Table 3G.1-55. The maximum horizontal rebar stress is found to be 364.8 MPa (52.9 ksi) also at Section 23 due to the load combination RB-9b as shown in Table 3G.1-55. The maximum transverse shear force is found to be 5.20 MN/m (29.7 kips/in) against the shear strength of 5.29 MN/m (30.2 kips/in) at Section 20, the top of the cylindrical wall below the RCCV wall.

3G.1.5.4.3.2 RB Foundation Mat Outside Containment

Section 24 is selected for the foundation mat outside the containment at the junction with the cylindrical wall below the RCCV wall. The maximum rebar stress of 161.7 MPa (23.4 ksi) is found in the top rebar as shown in Table 3G.1-55. The maximum bottom rebar stress is found to be 136.4 MPa (19.8-ksi) also as shown in Table 3G.1-54. The maximum transverse shear force is found to be 12.90 MN/m (73.78 kips/in) against the shear strength of 14.18 MN/m (80.97 kips/in).

3G.1.5.4.3.3 RB Floor Slabs

Sections 25 to 27 are selected for the floor slabs at elevations EL 4650, EL 17500 and EL 27000 (see Figure 3G.1-28) at their junction with the RCCV. Floor slabs are composite structures, which are reinforced by rebars at their top surfaces and by steel plates at the bottom surfaces, as described in Subsection 3.8.4.1.1. However, the slabs surrounding the Main Steam (MS) tunnel are constructed of conventional reinforced concrete. Among the elements at Sections 26 and 27, Element #96113 and 98424 are included in the MS tunnel slabs.

The maximum rebar stress of 357.7 MPa (51.9 ksi) is found at Section 26 as shown in Table 3G.1-55, whereas the maximum stress of steel plate is found to be 161.0 MPa (23.3 ksi) at

Section 27 as shown in Table 3G.1-55. The maximum transverse shear force is found to be 7.53 MN/m (43.08 kips/in) against the shear strength of 7.70 MN/m (43.97 kips/in).

3G.1.5.4.3.4 Pool Girders

The maximum rebar stress of 255.9 MPa (37.1 ksi) is found in the horizontal rebar at Section 29 as shown in Table 3G.1-55, whereas the maximum vertical rebar stress is found to be 257.5 MPa (37.3 ksi) at Section 30 as shown in Table 3G.1-55. The maximum transverse shear force is found to be 0.26 MN/m (1.5 kips/in) against the shear strength of 2.90 MN/m (16.6 kips/in).

3G.1.5.4.3.5 Main Steam Tunnel Floors and Walls

Section 31 is selected for the MS tunnel wall (Element #150122) and slabs (Elements #96611 and #98614). The MS tunnel is composed of the reinforced concrete structures as described in Subsection 3G.1.5.4.3.3.

The maximum rebar stress is found to be 220.7 MPa (32.0 ksi) in Table 3G.1-51, and the maximum transverse shear force is found to be 0.50 MN/m (2.86 kips/in) against the shear strength of 1.55 MN/m (8.85 kips/in).

3G.1.5.5 Foundation Stability

The Reactor Building, the concrete containment and the Fuel Building share a common foundation. The stabilities of the foundation against overturning, sliding and floatation are evaluated. The energy approach is used in calculating the factor of safety against overturning.

The factors of safety against overturning, sliding and floatation are given in Table 3G.1-57. All of these meet the acceptance criteria given in Table 3.8-14. In the sliding evaluation the gap between the building and excavated soil is backfilled with concrete up to the top level of the basemat as shown in Figure 3G.1-65.

Maximum soil bearing stress is found to be 699 kPa (14600 psf) due to dead plus live loads.

The maximum bearing stresses shown in Table 3G.1-58 are evaluated using the Energy Balance Method (Reference 3G.1-2). In order to verify the results, toe pressures obtained by the FE analyses using the Reactor Building/Fuel Building (RB/FB) global model are compared with the values in Table 3G.1-58. As a result, the bearing pressures calculated by the Energy Balance Method envelop the pressures of FE analyses.

A series of parametric analyses are performed to verify the assumptions and results of the global FE analysis is used as the baseline for the basemat design.

- Lateral variations of soil stiffness are evaluated using the global FE model. Analyses are performed assuming “Hard spot” and “Soft spot” under the RPV Pedestal area.
- Construction loads are evaluated in the design of the basemat. The analyses focus on the response of the basemat during the early stage of construction when it could be susceptible to differential loading and deformations.
- The analyses are performed to confirm acceptability of allowable total and differential settlement that are specified over the length of the foundation.

Details are provided in Subsections 3G.1.5.5.2 through 3G.1.5.5.4.

3G.1.5.5.1 Effect of Basemat Uplift

As described in Appendix 3G.1.4.2, the foundation soil is represented by elastic soil springs which resist both compression and tension. However, actual foundation soil cannot bear tensile force. This difference has an influence on the stresses in the basemat, if the basemat is uplifted due to design loads. Therefore, analyses to evaluate the effect of potential uplift of the basemat are performed using the RB/FB global FE model shown in Figure 3G.1-8.

An iterative approach is used. Based on the result from the initial analysis, the tension capability is removed in the next iteration for those springs that are in tension. This iterative process is continued until there are no more springs in tension.

Analyses are performed for the horizontal Safe Shutdown Earthquake (SSE) loads. Figures 3G.1-60 through 3G.1-64 show the comparison of the sectional deformations of the basemat and the bending moments generated in the basemat respectively at the final step of iteration. In the area close to the RCCV wall, bending moments are higher than that of the linear analysis results; however the resulting stresses in the concrete and reinforcement for the design "SSE + LOCA" load combination are still below the code allowables with large margins as shown in Table 3G.1-59. Therefore, it can be concluded that the effect of uplift is negligible to the linear analysis using the global FE model.

3G.1.5.5.2 Effect of Horizontal Variation of Soil Spring

To account for potential horizontal variation of foundation soil stiffness over the basemat width, stiff soil springs are considered under the RPV Pedestal area assuming linear variation to the edge of the mat. The RPV Pedestal is selected because it produces the largest clear span for the mat and is likely to be the first structure constructed on the mat. This is used as the "Hard Spot". In addition, the inverted variation, i.e. softer soil springs assumed under the RPV Pedestal area, is also considered and called the "Soft Spot". Based on the analysis results for these soil conditions, some of the "Soft Spot" case results predict larger mat bending moments than the uniform soil condition. However, the DCD design envelopes the results of horizontal variation of soil spring as long as the ratio of spring stiffness at the basemat center to that at the basemat edge does not exceed 3. This spring stiffness ratio converts to $\sqrt{3}$ (1.7) for the corresponding shear wave velocity ratio.

3G.1.5.5.3 Effect of Construction Sequence

The basemat design is checked against the loads expected during construction of the basemat. The RB/FB basemat is divided into 7 zones for concrete pour and these zones are investigated for three possible construction sequences. The moment differences between sequences considered are negligibly small in comparison with the moments used in the basemat design. In addition to basemat construction sequence, the impact of the building structures construction sequence, i.e., RPV Pedestal, RCCV and walls, on the basemat design is also investigated. The evaluation results confirm that the building structures construction sequence has negligible effect on the basemat design. These studies include horizontal soil spring variations, "Hard Spot" and "Soft Spot" as described in Subsection 3G.1.5.5.2.

3G.1.5.5.4 Foundation Settlement

The basemat design is checked against the normal and differential settlement of the RB/FB. It is found that the basemat can resist the maximum mat foundation corner settlement of 103 mm (4.0 in) and the settlement averaged at four corners of 65 mm (2.6 in). The relative displacement between two corners along the longest dimension of the building basemat calculated under linearly varying soil stiffness is 77 mm (3.0 in). The estimated differential settlement between buildings (RB/FB and CB) is 85 mm (3.3 in). These values are specified as maximum settlements in Table 2.0-1.

3G.1.5.6 Tornado Missile Evaluation

The minimum thickness required to prevent penetration, concrete spalling and scabbing is evaluated. The methods and procedures are shown in Subsection 3.5.3.1.1. The minimum thickness required is less than the minimum 1000 mm (39.4 in) and 700 mm (27.6 in) thickness provided for the RB external walls and roof, respectively.

3G.1.6 References

3G.1-1 Burns & Roe, "State-of-the-Art Report on High Temperature Concrete Design," prepared for US. Department of Energy, Document No. DOE/CH/94000-1, November 1985.

3G.1-2 Tseng, W.S. and Liou, D.D., “Simplified Methods for Predicting Seismic basemat Uplift of Nuclear Power Plant Structures, Transactions of the 6th International Conference on SmiRT”, Paris, France, August 1981.

Table 3G.1-1

Soil Spring Constants for the RB Analysis Model

Direction of Spring		Loads	Stiffness ($MN/m/m^2$)
Horizontal	X-direction	All	9.107
	Y-direction	All	9.654
Vertical		Horizontal Seismic Loads	38.35
		Other Loads	13.66

Table 3G.1-2

Site Design Parameters

Parameter	Value(s)
Soil:	
Minimum Shear Wave Velocity, m/s (ft/s)	300 (1000)
Maximum Ground Water Level, m (ft)	0.61 (2.0) below plant grade
Maximum Flood (or Tsunami) Level, m (ft)	0.30 (1.0) below plant grade
Maximum Ground Snow Load (100-year recurrence interval), kPa (lbf/ft^2)**	2.394 (50)
Design Exterior Temperatures	
Summer, °C (°F)	46.1 (115)
Winter, °C (°F)	-40.0 (-40)
Seismology: For seismic design parameters, refer to Subsection 3.7.1.	
Extreme Wind	
Basic Wind Speed (100-year recurrence interval (3-sec gust)), m/s (mph)*	67.1 (150)
Exposure Category	Exposure D
Tornado	
Maximum Tornado Wind Speed, m/s (mph)	147.5 (330)
Maximum Rotational Speed, m/s (mph)	116.2 (260)
Translational Speed, m/s (mph)	31.3 (70)
Radius, m (ft)	45.7 (150)
Pressure Drop, kPa (psi)	16.6 (2.4)
Rate of Pressure Drop, kPa/s (psi/s)	11.7 (1.7)
Missile Spectra	Spectra I of SRP 3.5.1.4, Rev. 2 applied to full building.
Maximum Rainfall**	
Design Rainfall, cm/hr (in/hr)	49.3 (19.4)
48-hour Winter Rainfall, cm (in)	91.4 (36)

Note * Equivalent to 62.6 m/s (140 mi/hr) 50-year recurrence interval wind speed (3-sec gust) with importance factor of 1.15 per ASCE 7-02.

** Based on probable maximum precipitation (PMP) for one hour over 2.6 km^2 (one square mile) with a ratio of 5 minutes to one hour PMP of 0.32 as found in National Weather Source Publication Hydrometeorology Report No. 52 (HMR-52). 49.3 cm/hr (19.4 in/hr) for maximum rainfall rate is selected for design. The maximum short term rate selected is 15.7 cm (6.2 in) in 5 minutes. The roof scuppers and drains are designed independently to handle the PMP or 48-hour probable maximum winter precipitation (PMWP) with no more than 100 mm (4 in) of water accumulation on the roof. The roof is designed for 2873 Pa (60 psf) as live load category on all Seismic Category I structures and accommodates design roof snow load and 48-hour PMWP. ASCE 7-02 requirements for snow are used to analyze the various roof geometries and heights.

Table 3G.1-3

Equipment and Hydrostatic Loads inside RCCV

Description	Weight
Reactor Pressure Vessel (normal operating condition)	21600 kN
Drywell Top Head (including refueling facilities bulkhead plate)	1100 kN
Top Slab	
a. Liner below slab	2.5 kN/m^2
b. Miscellaneous attachments below slab	2.4 kN/m^2
Upper Drywell	
a. Wall Liner	2.7 kN/m^2
b. Personal Airlock (EL17500)	200 kN
c. Equipment Hatch (EL17500)	110 kN
d. Miscellaneous attachments to wall	2.4 kN/m^2
GDCS Pool	
a. Water (H=6.8 m)	67 kN/m^2
Wetwell	
a. Water (H=5.5 m) HWL	54 kN/m^2
b. Wall Liner	1.6 kN/m^2
c. Floor Liner	2.4 kN/m^2
d. Access Hatch (EL13570)	90 kN
e. Quenchers (12 units)	510 kN
f. Miscellaneous attachments to wall	2.4 kN/m^2
Lower Drywell	
a. Wall Liner	3.1 kN/m^2
b. Floor Liner	0.6 kN/m^2
c. Sacrificial (basaltic) concrete (H=1.6 m)	36 kN/m^2
d. Personal Airlock (EL-6400)	200 kN
e. Equipment Hatch (EL-6400)	110 kN
f. Miscellaneous attachments to wall	2.4 kN/m^2
RCCV Internal Structures except Diaphragm Floor	
a. Equipment and piping on the slab	2.4 kN/m^2
Diaphragm Floor (excluding GDCS pool areas)	
a. Equipment and piping on the slab	9.8 kN/m^2

Table 3G.1-4

Equipment and Hydrostatic Loads in RB Pools

Description	Weight	Remarks
Reactor Cavity Pool		
a. Water (H=6.7m)	66 kN/m^2	
b. Wall Liner	1.0 kN/m^2	
c. Floor Liner	1.6 kN/m^2	
Dryer / Separator Pool		
a. Water (H=6.7m)	66 kN/m^2	
b. Wall Liner	1.0 kN/m^2	
c. Floor Liner	1.6 kN/m^2	
d. Steam Dryer, Steam Separator	66 kN/m^2	During refueling
Fuel Buffer Pool		
a. Water (H=6.7m)	66 kN/m^2	
b. Wall Liner	1.0 kN/m^2	
c. Floor Liner	1.6 kN/m^2	
d. Fuel Storage Racks	153 kN/m^2	During refueling
IC / PCCS Pool		
a. Water (H=4.8m)	47 kN/m^2	
b. Wall Liner	1.0 kN/m^2	
c. Floor Liner	1.6 kN/m^2	
d. IC heat exchanger	333 kN/unit	
e. PCCS heat exchanger	233 kN/unit	
Fuel Transfer Tube Pool		
a. Water (H=11.64m)	114 kN/m^2	
b. Wall Liner	1.0 kN/m^2	
c. Floor Liner	1.6 kN/m^2	
IC / PCCS Expansion Pools		
a. Water (H=4.8m)	47 kN/m^2	
b. Wall Liner	1.0 kN/m^2	
c. Floor Liner	1.6 kN/m^2	
Dryer/Separator Storage Pool Gate	300 kN	
Reactor Well Gate	50 kN	
Fuel Transfer Channel Pool Gate	50 kN	

Table 3G.1-5

Miscellaneous Structures, Piping, and Commodity Loads on RB Floor

Elevation (mm)	Weights	Remarks
52,400	2.4 kN/m^2 (50psf)	
34,000	2.4 kN/m^2 (50psf)	
27,000	2.4 kN/m^2 (50psf)	
17,500	2.4 kN/m^2 (50psf) 20.0 kN/m^2 (415psf)	 Main Steam Tunnel
13,570	2.4 kN/m^2 (50psf)	
9,060	2.4 kN/m^2 (50psf)	
4,650	2.4 kN/m^2 (50psf)	
-1,000	2.4 kN/m^2 (50psf)	
-6,400	2.4 kN/m^2 (50psf)	
-11,500	2.4 kN/m^2 (50psf)	

Table 3G.1-6

Equivalent Linear Temperature Distributions at Various Sections

Section*1	Side*2		Equivalent Linear Temperature*3 (°C)					
			Normal Operation Winter		DBA (6 min) Winter		DBA (72 hr) Winter	
	1	2	Td	Tg	Td	Tg	Td	Tg
C1	DW	RM	33.5	38.1	34.7	45.2	58.2	127.3
C2	WW	RM	26.5	26.7	27.4	32.0	47.0	101.0
C3	SP	RM	28.2	29.5	28.8	32.7	45.2	90.8
C4	SP	RM	28.2	29.5	28.7	32.4	45.2	90.8
C5	DW	IP	49.4	12.8	50.6	17.6	83.4	36.0
C6	DW	XP	49.4	12.8	50.6	17.7	83.4	36.0
C7	DW	RM	33.5	39.3	34.5	45.5	53.9	121.2
M1	DW	GR	27.5	23.9	27.5	23.9	27.5	23.9
M2	RM	GR	12.9	-5.2	12.9	-5.2	12.9	-5.2
P1	IP	DP	43.0	0.0	43.3	1.5	64.0	65.1
P2	IP	XP	43.0	0.0	44.2	0.3	109.8	0.0
W1	RM	RM	10.0	0.0	10.0	0.0	10.0	0.0
W2	RM	GR	13.0	-4.9	13.0	-4.9	13.0	-4.9
W3	RM	AT	-17.7	42.3	-17.7	42.3	-17.7	42.3
S1	RM	RM	10.0	0.0	10.0	0.0	10.0	0.0
S2	RM	AT	-20.0	36.0	-20.0	36.0	-20.0	36.0

Note *1: See Figure 3G.1-20 for the location of sections.

Note *2: DW: Drywell
WW: Wetwell Air Space
SP: Suppression Pool
IP: IC/PCCS Pool
XP: Expansion Pool
RM: RB Room outside Containment
GR: Ground
AT: Air

Note *3: Td: Average Temperature
Tg: Surface Temperature Difference (positive when temperature at Side 1 is higher)

Table 3G.1-7

Pressure Loads Inside RCCV

Event	Drywell pressure in kPag (psig)	Wetwell pressure in kPag (psig)	Note
Normal operation	5.2 (0.75)	5.2 (0.75)	
SIT 1	356.8 (51.8)	356.8 (51.8)	Maximum pressure
SIT 2	310 (45)	32.5 (4.75)	Maximum differential pressure
LOCA (6 minutes)	257 (37.3)	241 (35.0)	
LOCA (72 hours)	310 (45.0)	310 (45.0)	

Table 3G.1-8

Pressure Loads Inside IC/PCCS Pools

Event	IC/PCCS pool pressure in kPag (psig)
Normal operation	34.5 (5)
LOCA	48.3 (7)

Table 3G.1-9

Maximum Vertical Acceleration

RB/FB Walls		
Elev. (m)	Node No.	Max. Vertical Acceleration (g)
52.40*	110	1.25
34.00	109	0.83
27.00	108	0.73
22.50	107	0.73
17.50	106	0.73
13.57	105	0.74
9.06	104	0.73
4.65	103	0.78
-1.00	102	0.76
-6.40	101	0.68
-11.50	2	0.63
-15.50	1	0.51
RCCV Wall		
34.00	209	0.90
27.00	208	0.88
17.50	206	0.73
13.57	205	0.78
9.06	204	0.65
4.65	203	0.69
-1.00	202	0.59
-6.40	201	0.59
RPV Pedestal/Vent Wall		
17.50	701	1.10
14.50	702	1.04
11.50	703	0.92
8.50	704	0.77
7.4625	705	0.70
4.65	706, 303	0.67
2.4165	377	0.64
-1.00	302	0.59
-2.753	376	0.51
-6.40	301	0.50

RB/FB Slabs		
Elev. (m)	Node No.	Max. Vertical Acceleration (g)
52.40*	9101	1.20
	9102	1.82
	9103	3.14
	9104	2.26
	9105	2.32
	9106	2.99
	9107	2.80
	9108	2.61
34.00	9091	1.29
	9092	1.06
27.00	9081	1.16
	9082	0.99
	9083	1.09
	9084	1.31
	9085	0.97
22.50	9071	1.60
	9072	1.31
	9073	2.03
	9074	1.31
	9075	1.16
17.50	9061	1.79
	9062	1.49
	9063	0.82
	9064	1.84
	9065	1.42
	99064	1.07
13.57	9051	0.81
	9052	1.46
9.06	9041	0.88
	9042	1.42
4.65	9031	1.17
	9032	0.97
	9033	1.02
	9034	1.51
	9035	1.38
-1.00	9021	1.12
	9022	1.45
	9023	1.01
	9024	0.89
	9025	1.34
	9026	1.57
	9027	0.88
-6.40	9011	0.92
	9012	0.92
	9013	1.35

Note: See Figure 3A.7-4 for the node numbers.

*: The difference between the modeled elevation 52.4 m and the actual elevation 52.7 m at the RB roof is negligibly small.

Table 3G.1-10

Selected Load Combinations for the RCCV

Category	Load Combination											Acceptance Criteria*1
	No.*2	D	L	P_t	P_a	T_a	E'	R_a	SRV	CO	CHUG	
SIT (maximum pressure)	CV-1	1.0	1.0	1.0								S
LOCA (1.5Pa) 6 minutes	CV-7a	1.0	1.0		1.5	1.0		1.0	1.0	1.5		U
LOCA (1.5Pa) 72 hours	CV-7b	1.0	1.0		1.5	1.0		1.0	1.0		1.5	U
LOCA + SSE 6 minutes	CV-11a	1.0	1.0		1.0	1.0	1.0	1.0	1.0	1.0		U
LOCA + SSE 72 hours	CV-11b	1.0	1.0		1.0	1.0	1.0	1.0	1.0		1.0	U

Note:

*1: S = Allowable Stress as in ASME Section III, Div. 2, Subsection CC-3430 for Service Load Combination.
U = Allowable Stress as in ASME Section III, Div. 2, Subsection CC-3420 for Factored Load Combination.

*2: Based on Table 3.8-2

Table 3G.1-11

Selected Load Combinations for the RB

Category	Load Combination								Acceptance Criteria*1
	No.*2	D	L	P_a*3	T_o	T_a*3	E'	W	
Severe Environmental	RB-4	1.05	1.3		1.3			1.3	U
LOCA ($1.5P_a$) 6 minutes	RB-8a	1.0	1.0	1.5		1.0			U
LOCA ($1.5P_a$) 72 hours	RB-8b	1.0	1.0	1.5		1.0			U
LOCA + SSE 6 minutes	RB-9a	1.0	1.0	1.0		1.0	1.0		U
LOCA + SSE 72 hours	RB-9b	1.0	1.0	1.0		1.0	1.0		U

Note:

*1: U = Required section strength based on the strength design method per ACI 349.

*2: Based on Table 3.8-15

*3: P_a and T_a are accident pressure load within the containment and thermal load generated by LOCA, respectively.
P_a and T_a are indirect loads, but their effects are considered in the RB design.

Table 3G.1-12

Material Constants for Design Calculations

			Reinforced Concrete		Steel		
		Temperature (°C)	Basemat f'c=4000psi 27.6MPa	Others f'c=5000psi 34.5MPa	Carbon Steel Liner	Stainless Steel Liner	Structural Steel
Young's Modulus (MPa)	**Temperature Loads**	<21	2.49×10^{4}	2.78×10^{4}	2.00×10^{5}		
		93	1.81×10^{4}	2.03×10^{4}			
		204	1.62×10^{4}	1.81×10^{4}			
	Other Loads		2.49×10^{4}	2.78×10^{4}	2.00×10^{1}		2.00×10^{5}
Poisson's Ratio			0.17		0.3		
Thermal Expansion (m/m°C)			9.90×10^{-6}		1.17×10^{-5}	1.52×10^{-5}	1.17×10^{-5}
Weight Density (MN/m^3)			0.0235		0.0770		

Table 3G.1-13

Results of NASTRAN Analysis, Dead Load

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	0.064	-5.383	0.162	-0.159	-0.910	0.015	-0.024	-0.280
Pedestal	5013	-0.340	-6.070	0.256	-0.101	-0.559	-0.001	-0.013	-0.078
Bottom	5024	-0.697	-6.037	0.010	-0.060	-0.418	0.002	0.010	-0.020
2 RPV	6006	0.035	-5.280	0.276	0.009	0.015	0.030	0.038	-0.039
Pedestal	6013	-0.026	-5.365	0.399	-0.053	-0.059	0.008	-0.014	0.014
Mid-Height	6024	0.068	-4.008	-0.430	0.014	-0.110	0.012	0.024	0.075
3 RPV	6606	0.045	-3.874	0.723	0.237	1.691	0.149	0.009	-0.762
Pedestal	6613	0.021	-3.930	-0.042	0.173	1.593	-0.179	0.021	-0.732
Top	6624	0.111	-3.788	0.254	0.200	1.575	0.183	-0.028	-0.709
4 RCCV	1806	-0.458	-4.796	0.153	-0.006	-0.134	0.007	0.000	0.017
Wetwell	1813	-0.553	-4.707	0.175	-0.017	-0.059	0.002	0.001	0.058
Bottom	1824	-0.441	-5.239	-0.086	-0.017	-0.100	0.003	-0.004	0.037
5 RCCV	2606	-0.142	-4.294	0.201	0.003	-0.028	0.001	0.002	-0.074
Wetwell	2613	-0.196	-4.310	0.172	-0.026	-0.065	0.002	-0.003	-0.039
Mid-Height	2624	-0.224	-4.718	-0.043	-0.005	-0.023	0.001	0.000	-0.069
6 RCCV	3406	-0.107	-3.635	0.344	0.031	0.244	0.013	0.013	-0.103
Wetwell	3413	-0.013	-4.040	0.131	-0.016	-0.082	-0.071	0.022	0.004
Top	3424	-0.070	-4.068	-0.010	0.005	0.022	-0.008	0.028	0.003
7 RCCV	3606	0.025	-3.246	0.282	-0.010	0.122	0.006	0.020	0.137
Drywell	3613	0.127	-3.625	0.157	0.060	0.325	-0.067	-0.016	0.245
Bottom	3624	-0.039	-4.070	0.044	0.056	0.307	-0.005	0.024	0.137
8 RCCV	4006	0.492	-2.715	0.193	-0.188	-0.473	-0.030	0.015	0.242
Drywell	4013	0.508	-3.702	0.278	-0.040	-0.379	0.008	-0.009	0.151
Mid-Height	4976	0.028	-3.324	0.148	-0.001	-0.181	-0.004	-0.008	0.104
9 RCCV	4406	0.426	-2.171	-0.112	-0.357	-1.785	-0.034	-0.009	0.448
Drywell	4413	-0.353	-3.760	0.154	-0.196	-1.039	0.009	-0.007	0.230
Top	4424	0.055	-2.608	0.113	-0.047	-0.473	0.006	0.002	0.096
10 Basemat	80003	-0.595	-0.810	0.121	4.897	5.313	-0.041	0.282	-0.229
@ Center	80007	-0.620	-0.834	0.110	4.916	5.313	-0.039	-0.040	-0.366
	80012	-0.613	-0.880	0.111	4.908	5.307	-0.037	-0.349	-0.054
11 Basemat	80206	-0.515	-0.686	0.188	1.271	1.864	1.201	1.394	-1.308
Inside	80213	-0.617	-0.863	0.198	2.480	0.266	-0.150	-0.073	-1.959
RPV Pedestal	80224	-0.692	-1.183	0.106	0.339	2.657	-0.226	-1.803	-0.165
12 S/P Slab	83306	0.143	0.603	-0.221	1.342	0.958	-0.041	0.934	-0.028
@ RPV	83313	0.358	0.483	-0.106	1.364	0.962	0.038	0.943	0.029
	83324	0.302	0.633	0.039	1.336	0.941	-0.043	0.931	-0.030
13 S/P Slab	83406	0.169	0.502	-0.205	-0.866	0.327	-0.007	0.324	0.001
@ Center	83413	0.433	0.341	-0.001	-0.856	0.313	0.000	0.329	0.001
	83424	0.352	0.525	-0.003	-0.863	0.305	-0.002	0.324	-0.001
14 S/P Slab	83506	0.190	0.400	-0.199	-0.873	-0.026	-0.011	-0.139	0.003
@ RCCV	83513	0.475	0.293	0.040	-0.891	-0.042	-0.002	-0.131	0.003
	83524	0.384	0.488	-0.004	-0.889	-0.040	-0.002	-0.135	-0.001
15 Topslab	98120	1.121	0.285	0.420	-0.445	-0.268	-0.295	0.053	0.296
@ Drywell Head	98135	2.720	0.205	-0.181	-0.695	0.247	0.119	-0.073	0.343
Opening	98104	0.078	0.714	-0.090	-0.215	-1.358	0.287	0.011	0.268
16 Topslab	98149	1.693	-0.351	0.511	-0.802	-0.379	0.114	-0.046	-0.291
@ Center	98170	1.280	-0.056	0.057	-0.802	-1.028	0.062	0.004	-0.013
	98109	0.112	0.525	-0.024	-0.693	-0.901	0.156	0.095	0.062
17 Topslab	98174	0.792	-0.177	0.206	-0.784	-0.782	-0.199	-0.176	0.064
@ RCCV	98197	0.263	0.022	-0.214	-0.374	1.158	0.148	0.046	0.723
	98103	-0.160	0.376	0.027	1.875	0.296	0.212	0.932	0.113

Table 3G.1-13

Results of NASTRAN Analysis, Dead Load (Continued)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall	6	0.098	-7.187	0.532	-0.213	-1.573	0.012	-0.039	-0.487
Below RCCV	13	0.235	-5.597	0.423	-0.507	-2.677	0.003	-0.006	-0.802
Bottom	24	0.190	-6.139	-0.209	-0.540	-2.860	0.005	0.000	-0.840
19 Wall	806	-0.039	-6.071	0.155	0.024	-0.035	-0.020	0.010	-0.114
Below RCCV	813	-0.215	-5.476	0.359	-0.027	-0.048	-0.010	-0.013	-0.187
Mid-Height	824	-0.156	-6.045	-0.195	-0.031	-0.008	-0.006	0.001	-0.205
20 Wall	1606	-0.601	-5.326	0.088	0.105	0.505	0.004	-0.004	-0.212
Below RCCV	1613	-0.707	-5.187	0.244	0.097	0.598	0.003	0.000	-0.254
Top	1624	-0.592	-5.727	-0.141	0.095	0.561	0.001	-0.006	-0.229
21 Exterior Wall	20011	-0.548	-3.821	-0.508	0.028	0.278	-0.021	0.065	0.179
@ EL-11.50	20023	-0.005	-1.413	-0.527	0.070	-0.326	-0.004	-0.137	-0.187
~-10.50m	30010	-0.193	-2.243	-0.046	-0.303	-1.717	0.018	0.013	0.402
	30020	-0.043	-1.266	-0.257	0.183	-0.649	-0.058	0.154	0.221
	40001	-0.040	-1.297	0.230	0.184	-0.648	0.060	-0.152	0.211
	40011	-0.324	-2.649	-0.012	-0.375	-2.020	-0.009	-0.001	0.487
22 Exterior Wall	22011	0.221	-3.131	0.658	-0.011	0.061	0.009	-0.018	0.056
@ EL-4.65	22023	0.020	-1.547	-0.466	-0.161	-0.010	-0.019	0.102	0.012
~-6.60m	32010	-0.005	-1.819	0.064	0.001	0.038	0.001	0.000	-0.019
	32020	-0.046	-2.033	-0.065	-0.059	-0.002	-0.005	-0.054	-0.008
	42001	-0.057	-2.108	-0.060	-0.076	-0.004	0.002	0.039	-0.002
	42011	-0.311	-2.271	-0.112	-0.002	0.031	-0.003	0.002	-0.012
23 Exterior Wall	24211	-0.192	-1.804	0.074	-0.067	-0.442	0.004	-0.006	-0.022
@ EL22.50	24224	-0.034	-1.037	0.295	0.031	-0.043	-0.043	-0.064	-0.034
~24.60m	34210	-0.006	-0.760	0.088	0.001	-0.034	0.002	0.003	0.001
	34220	0.048	-0.915	-0.153	0.052	-0.026	-0.009	0.041	0.001
	44201	0.026	-1.078	-0.327	0.044	-0.013	0.015	-0.047	-0.002
24 Basemat	90140	0.241	-0.797	-0.158	-1.395	-1.122	2.519	-1.759	2.016
@ Wall	90182	-0.255	-0.326	-0.066	0.661	-1.041	-0.319	0.232	0.645
Below RCCV	90111	-0.385	-0.561	0.033	-0.920	0.830	-0.397	0.692	0.138
25 Slab	93140	-0.161	0.140	0.087	0.077	0.097	-0.067	0.120	-0.097
EL4.65m	93182	0.143	0.091	0.000	0.028	0.111	0.008	-0.008	-0.148
@ RCCV	93111	0.054	0.172	-0.030	0.131	0.027	0.005	-0.139	-0.004
26 Slab	96144	-0.094	0.147	0.184	0.047	0.063	-0.045	0.104	-0.081
EL17.5m	96186	0.284	-0.071	-0.021	-0.003	-0.004	-0.002	-0.003	-0.035
@ RCCV	96113	-0.065	0.538	-0.051	-0.176	0.016	0.000	0.198	0.027
27 Slab	98472	0.379	0.078	0.055	0.161	0.242	-0.194	0.224	-0.249
EL27.0m	98514	0.024	0.144	0.045	0.029	0.087	0.023	-0.003	-0.159
@ RCCV	98424	-0.118	0.419	0.009	0.706	0.196	-0.050	-0.981	-0.067
28 Pool Girder	123054	0.442	-2.495	-0.798	0.051	0.033	0.054	-0.011	-0.028
@ Storage Pool	123154	1.379	-0.505	-0.627	0.083	0.031	0.100	0.018	0.008
29 Pool Girder	123062	0.476	0.604	0.306	-0.024	-0.166	0.028	-0.001	-0.090
@ Cavity	123162	-1.398	0.167	0.181	-0.075	-0.057	0.023	0.089	0.039
30 Pool Girder	123067	0.491	-2.417	1.408	0.011	-0.049	-0.076	-0.119	-0.061
@ Fuel Pool	123167	0.518	-0.609	1.216	0.038	0.027	0.015	-0.030	0.009
31 MS Tunnel	150122	-0.026	0.047	0.280	0.022	0.045	0.016	-0.010	-0.042
Wall and Slab	96611	-0.011	0.296	-0.014	0.062	-0.081	-0.052	-0.073	0.017
	98614	-0.021	-0.175	-0.019	0.010	-0.511	-0.062	-0.051	0.030

Table 3G.1-14

Results of NASTRAN Analysis, Drywell Unit Pressure (1 MPa)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	-3.691	-4.672	-0.082	1.293	7.769	0.037	-0.011	3.421
Pedestal	5013	-3.771	-4.277	-0.247	1.264	7.674	-0.004	-0.002	3.458
Bottom	5024	-3.625	-3.457	0.045	1.335	7.195	-0.035	0.029	3.109
2 RPV	6006	4.551	-4.403	-0.466	-0.166	-0.605	-0.012	0.044	-0.493
Pedestal	6013	4.467	-4.272	-0.254	-0.166	-0.652	-0.012	0.020	-0.489
Mid-Height	6024	5.180	-2.748	-0.354	0.183	-0.345	-0.003	-0.054	-0.211
3 RPV	6606	2.350	-4.274	0.036	-0.252	-1.748	-0.293	0.218	1.031
Pedestal	6613	1.827	-4.806	-0.359	-0.255	-1.239	0.271	-0.171	0.803
Top	6624	2.250	-4.596	0.028	-0.261	-1.874	-0.239	0.162	1.078
4 RCCV	1806	0.548	3.676	-0.563	0.281	1.664	0.002	-0.001	0.216
Wetwell	1813	0.515	2.795	-0.040	0.275	1.709	-0.001	-0.002	0.288
Bottom	1824	0.628	4.314	0.023	0.279	1.489	-0.007	0.003	0.213
5 RCCV	2606	1.528	3.662	-0.616	0.015	0.513	0.036	-0.001	0.191
Wetwell	2613	1.262	2.468	-0.012	0.038	0.404	-0.005	-0.001	0.201
Mid-Height	2624	1.510	4.224	-0.032	0.144	0.326	-0.005	0.003	0.115
6 RCCV	3406	4.379	3.739	-0.076	-1.035	-5.767	1.331	-1.003	1.977
Wetwell	3413	3.269	2.059	-0.415	-0.713	-4.144	-1.211	0.767	1.514
Top	3424	2.985	4.111	0.796	-0.667	-4.226	1.473	-0.897	1.498
7 RCCV	3606	4.452	7.434	-0.032	0.160	1.050	1.441	-0.406	1.617
Drywell	3613	3.451	5.759	-0.371	0.362	2.279	-1.270	0.152	2.109
Bottom	3624	3.474	9.458	0.714	0.560	2.852	1.534	-0.152	1.903
8 RCCV	4006	1.108	7.713	0.010	0.168	1.110	0.190	0.265	-1.516
Drywell	4013	1.577	5.589	0.372	-0.188	0.078	0.072	-0.031	-0.846
Mid-Height	4976	2.955	8.498	-0.503	0.112	0.457	0.002	-0.004	-1.047
9 RCCV	4406	-0.539	7.823	0.930	1.550	10.447	0.000	0.047	-2.609
Drywell	4413	0.389	5.174	0.469	1.175	8.381	0.132	0.071	-2.780
Top	4424	2.733	7.185	-0.455	1.209	7.161	0.053	0.007	-2.127
10 Basemat	80003	2.658	2.970	-0.031	-17.349	-16.644	0.022	-0.451	0.335
@ Center	80007	2.689	2.989	-0.021	-17.339	-16.636	0.026	0.064	0.548
	80012	2.676	3.012	-0.016	-17.355	-16.630	0.025	0.541	0.074
11 Basemat	80206	2.759	2.811	0.000	-12.124	-12.135	-1.542	-1.227	0.879
Inside	80213	2.814	3.036	-0.113	-13.892	-10.394	0.075	-0.011	1.558
RPV Pedestal	80224	2.812	2.787	-0.038	-10.824	-13.369	0.135	1.711	0.047
12 S/P Slab	83306	-1.209	0.977	-0.125	-3.755	-2.157	-0.050	-1.321	0.019
@ RPV	83313	-1.410	0.822	-0.015	-3.752	-2.180	0.027	-1.331	-0.001
	83324	-1.148	0.999	-0.001	-3.808	-2.215	0.002	-1.357	-0.004
13 S/P Slab	83406	-0.659	0.353	-0.049	0.528	-1.319	-0.039	-0.919	-0.001
@ Center	83413	-0.708	0.337	-0.049	0.526	-1.337	0.011	-0.914	-0.002
	83424	-0.653	0.347	0.034	0.514	-1.313	0.006	-0.933	0.000
14 S/P Slab	83506	-0.458	0.124	-0.003	3.051	-0.101	-0.011	-0.699	-0.013
@ RCCV	83513	-0.452	0.198	-0.053	3.034	-0.117	0.004	-0.699	0.000
	83524	-0.522	0.088	0.035	3.076	-0.066	0.003	-0.714	0.000
15 Topslab	98120	-3.451	1.215	1.603	3.872	2.802	1.932	1.005	-3.076
@ Drywell Head	98135	-10.627	-1.883	-0.732	4.187	-1.235	0.130	0.675	-4.326
Opening	98104	-1.044	3.871	-1.765	2.884	11.255	-1.647	-1.381	-2.726
16 Topslab	98149	-5.608	4.248	-2.829	3.306	1.495	0.396	0.330	1.923
@ Center	98170	-4.342	2.378	-1.380	4.089	4.865	-0.242	-0.150	-0.276
	98109	0.320	2.192	-0.396	4.793	7.944	-1.042	-0.385	-0.920
17 Topslab	98174	-0.929	2.977	-1.063	2.722	3.390	1.749	1.000	-0.642
@ RCCV	98197	-0.271	3.130	-0.121	0.773	-7.522	-0.703	-0.301	-5.157
	98103	1.994	3.158	-0.433	-7.748	0.454	-1.512	-5.099	-0.911

Table 3G.1-14

Results of NASTRAN Analysis, Drywell Unit Pressure (1 MPa) (Continued)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall	6	-0.811	3.022	-0.520	0.541	3.152	-0.009	0.024	1.051
Below RCCV	13	-0.629	2.747	-0.123	0.574	3.275	-0.001	-0.001	1.019
Bottom	24	-0.982	3.180	0.076	0.606	3.445	-0.005	0.004	1.075
19 Wall	806	0.122	3.122	-0.450	-0.007	0.032	0.012	-0.010	0.100
Below RCCV	813	0.192	2.524	-0.104	-0.004	0.033	0.006	0.024	0.196
Mid-Height	824	0.054	3.360	0.101	0.024	-0.025	0.004	-0.001	0.181
20 Wall	1606	0.822	3.045	-0.486	-0.313	-1.810	0.001	0.000	0.509
Below RCCV	1613	0.798	2.208	-0.073	-0.319	-1.796	-0.004	-0.001	0.541
Top	1624	0.875	3.602	0.068	-0.317	-1.988	-0.003	0.003	0.589
21 Exterior Wall	20011	0.027	0.595	0.041	0.179	0.562	0.013	0.005	0.204
@ EL-11.50	20023	0.012	-0.081	-0.105	-0.056	0.036	-0.002	0.001	0.020
~-10.50m	30010	0.283	-0.179	-0.012	0.230	1.172	-0.028	-0.013	-0.230
	30020	0.099	-0.301	-0.045	-0.096	0.024	0.029	0.034	0.001
	40001	0.051	-0.249	0.183	-0.088	0.099	-0.016	-0.008	-0.017
	40011	-0.156	0.065	-0.027	0.318	1.534	0.012	0.000	-0.332
22 Exterior Wall	22011	0.055	0.671	-0.099	0.009	0.005	0.005	0.004	-0.136
@ EL-4.65	22023	-0.005	-0.241	-0.101	-0.001	0.025	-0.005	0.015	-0.006
~-6.60m	32010	0.212	0.107	0.003	0.011	0.091	0.002	0.000	0.044
	32020	0.015	-0.457	0.369	0.016	0.035	-0.007	-0.003	0.025
	42001	-0.013	-0.383	0.406	0.016	0.029	-0.009	-0.001	0.000
	42011	0.032	0.866	-0.056	0.019	0.012	0.008	-0.004	0.081
23 Exterior Wall	24211	0.961	0.484	-0.090	0.181	0.997	0.029	0.031	-0.628
@ EL22.50	24224	0.035	-1.265	-0.349	0.006	0.169	0.061	0.107	0.114
~24.60m	34210	1.013	0.106	0.022	-0.041	0.131	0.017	-0.008	0.073
	34220	0.092	-1.192	0.475	0.033	0.112	0.006	0.031	-0.003
	44201	0.032	-0.899	0.666	0.069	0.082	-0.024	-0.016	-0.013
24 Basemat	90140	-0.179	0.400	0.822	2.961	2.401	-3.390	0.333	-0.649
@ Wall	90182	1.649	0.073	-0.088	-0.866	4.383	0.450	-0.077	-0.583
Below RCCV	90111	0.119	0.768	-0.104	4.456	-0.713	0.507	-0.644	-0.067
25 Slab	93140	-0.060	0.041	0.046	0.082	0.056	-0.060	0.013	-0.016
EL4.65m	93182	0.103	-0.078	0.016	-0.007	0.075	0.005	0.000	0.015
@ RCCV	93111	-0.079	0.009	0.010	0.131	0.006	0.003	-0.034	-0.002
26 Slab	96144	0.383	0.384	1.127	0.207	0.283	-0.200	0.044	-0.091
EL17.5m	96186	1.099	-0.517	0.123	0.029	0.359	-0.058	0.015	-0.145
@ RCCV	96113	-0.717	1.173	0.322	2.192	0.202	-0.348	-0.905	-0.093
27 Slab	98472	0.043	0.845	-0.660	-0.321	-0.461	0.489	-0.235	0.261
EL27.0m	98514	0.183	-0.019	-0.075	-0.111	-0.818	-0.061	0.020	0.223
@ RCCV	98424	-0.424	2.098	-0.150	-2.932	-0.611	-0.190	1.537	0.088
28 Pool Girder	123054	-0.660	7.978	5.592	0.039	-0.019	-0.475	-0.086	-0.113
@ Storage Pool	123154	-3.073	1.076	4.883	-0.014	0.046	-0.629	-0.231	0.056
29 Pool Girder	123062	-0.849	-4.834	-4.220	-0.022	0.824	-0.044	0.166	0.459
@ Cavity	123162	8.265	-1.756	-3.007	0.232	0.224	-0.096	-0.266	-0.145
30 Pool Girder	123067	-1.020	8.837	-6.949	-0.078	0.008	0.332	0.318	-0.068
@ Fuel Pool	123167	-2.381	1.860	-6.334	-0.051	-0.077	0.006	0.070	0.047
31 MS Tunnel	150122	0.130	-0.696	0.208	-0.004	0.081	-0.012	0.009	-0.069
Wall and Slab	96611	-0.036	0.673	-0.029	-0.062	-0.110	-0.020	0.021	0.008
	98614	0.010	-0.272	0.006	-0.482	-1.082	-0.164	0.146	0.052

Table 3G.1-15

Results of NASTRAN Analysis, Wetwell Unit Pressure (1 MPa)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	-0.608	-1.082	0.028	0.141	0.842	0.002	0.002	0.391
Pedestal	5013	-0.617	-0.943	0.105	0.139	0.834	0.000	-0.001	0.398
Bottom	5024	-0.646	-0.792	0.023	0.150	0.865	-0.006	0.003	0.413
2 RPV	6006	-0.383	-1.217	0.051	-0.018	-0.160	0.005	0.005	-0.061
Pedestal	6013	-0.438	-0.971	0.108	-0.024	-0.151	0.003	-0.013	-0.068
Mid-Height	6024	-0.505	-0.482	-0.011	-0.063	-0.149	-0.004	0.006	-0.038
3 RPV	6606	0.238	-1.879	0.127	0.728	4.751	0.094	0.206	-1.285
Pedestal	6613	0.381	-1.609	0.122	0.681	4.526	-0.104	-0.184	-1.198
Top	6624	0.312	-1.185	-0.018	0.734	4.721	0.086	0.176	-1.277
4 RCCV	1806	2.194	4.383	0.004	0.857	5.150	0.000	0.002	1.949
Wetwell	1813	2.120	4.041	-0.025	0.850	5.150	-0.006	-0.003	1.978
Bottom	1824	2.362	3.999	0.029	0.824	5.092	0.013	0.000	1.973
5 RCCV	2606	6.309	4.449	-0.071	-0.457	-2.275	-0.020	0.012	-0.091
Wetwell	2613	5.859	3.895	-0.016	-0.474	-2.067	-0.002	-0.011	-0.061
Mid-Height	2624	6.107	3.815	-0.012	-0.445	-2.084	-0.006	0.005	-0.186
6 RCCV	3406	2.774	4.473	-0.470	0.796	4.660	-1.229	0.929	-1.771
Wetwell	3413	2.772	3.974	0.483	0.473	3.728	1.171	-0.714	-1.508
Top	3424	2.834	4.000	-0.754	0.795	4.958	-1.376	0.827	-1.853
7 RCCV	3606	2.182	0.922	-0.604	-0.216	-1.305	-1.244	0.372	-0.657
Drywell	3613	2.237	0.431	0.665	-0.555	-2.305	1.256	-0.117	-0.877
Bottom	3624	2.320	-0.311	-0.867	-0.496	-2.553	-1.437	0.134	-0.801
8 RCCV	4006	2.016	0.427	-0.177	0.115	-0.582	-0.035	-0.225	0.019
Drywell	4013	1.579	0.025	-0.032	-0.070	-0.172	-0.062	0.029	-0.367
Mid-Height	4976	1.561	-0.253	0.000	-0.037	-0.041	0.006	-0.008	-0.368
9 RCCV	4406	0.928	-0.133	-0.105	0.412	0.242	0.108	0.004	-0.508
Drywell	4413	0.230	-0.214	-0.110	0.147	0.684	-0.026	-0.035	-0.136
Top	4424	0.486	-0.195	0.017	0.136	0.794	-0.005	-0.011	-0.210
10 Basemat	80003	0.408	0.437	-0.001	-2.029	-1.955	0.012	0.032	-0.004
@ Center	80007	0.412	0.432	-0.003	-2.005	-1.950	0.016	0.025	-0.008
	80012	0.409	0.427	-0.002	-1.993	-1.949	0.013	0.015	0.000
11 Basemat	80206	0.436	0.437	0.020	-2.210	-2.063	0.075	0.082	-0.041
Inside	80213	0.431	0.444	-0.001	-2.025	-2.105	0.102	0.079	-0.056
RPV Pedestal	80224	0.429	0.367	-0.011	-1.958	-2.001	0.003	0.007	-0.012
12 S/P Slab	83306	1.804	1.744	-0.093	-0.725	1.218	-0.004	4.169	-0.060
@ RPV	83313	1.989	1.716	0.091	-0.648	1.243	-0.017	4.194	0.064
	83324	1.727	1.771	-0.024	-0.666	1.259	-0.001	4.192	-0.057
13 S/P Slab	83406	1.883	1.764	-0.040	-6.216	-1.484	-0.011	-0.326	0.001
@ Center	83413	2.058	1.708	0.041	-6.190	-1.474	-0.013	-0.318	0.001
	83424	1.865	1.847	-0.004	-6.201	-1.466	0.002	-0.316	0.001
14 S/P Slab	83506	1.884	1.742	-0.018	2.774	-0.378	-0.008	-3.774	-0.003
@ RCCV	83513	2.059	1.735	0.037	2.786	-0.377	-0.002	-3.771	-0.002
	83524	1.940	1.900	-0.020	2.768	-0.371	-0.001	-3.769	0.003
15 Topslab	98120	0.432	0.565	0.334	-0.010	-0.031	-0.006	-0.002	-0.015
@ Drywell Head	98135	0.813	0.168	-0.194	-0.050	-0.007	0.008	-0.002	-0.001
Opening	98104	0.173	1.084	-0.195	-0.002	-0.026	0.001	-0.001	0.004
16 Topslab	98149	0.518	0.726	-0.005	-0.055	-0.071	0.032	0.018	-0.067
@ Center	98170	0.696	0.263	0.044	-0.083	-0.134	-0.017	-0.010	-0.027
	98109	0.378	0.735	-0.003	-0.054	-0.048	-0.004	-0.020	0.003
17 Topslab	98174	0.548	0.834	0.102	-0.283	-0.383	0.159	0.073	-0.092
@ RCCV	98197	0.320	0.266	-0.023	-0.201	-0.223	-0.052	-0.033	-0.011
	98103	0.340	0.582	0.039	-0.219	-0.063	0.000	-0.024	-0.003

Table 3G.1-15

Results of NASTRAN Analysis, Wetwell Unit Pressure (1 MPa) (Continued)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall	6	-0.243	0.189	-0.085	0.105	0.634	-0.004	0.007	0.193
Below RCCV	13	-0.221	-0.024	-0.050	0.131	0.728	0.000	0.001	0.218
Bottom	24	-0.279	-0.069	0.036	0.135	0.761	-0.001	0.001	0.230
19 Wall	806	0.150	0.147	0.020	0.041	0.234	0.012	0.001	-0.019
Below RCCV	813	0.194	-0.064	-0.019	0.066	0.253	0.004	0.004	0.015
Mid-Height	824	0.168	-0.093	0.037	0.047	0.251	0.000	-0.001	0.024
20 Wall	1606	1.582	0.093	0.009	-0.454	-2.619	0.000	0.002	0.845
Below RCCV	1613	1.552	-0.184	-0.020	-0.468	-2.683	-0.005	-0.002	0.910
Top	1624	1.745	-0.225	0.024	-0.492	-2.729	0.008	-0.001	0.940
21 Exterior Wall	20011	0.135	0.506	0.015	0.069	0.229	0.009	-0.006	0.091
@ EL-11.50	20023	0.002	-0.002	-0.016	-0.025	0.039	0.000	0.014	0.019
~-10.50m	30010	0.176	0.255	-0.012	0.090	0.487	-0.007	-0.004	-0.100
	30020	0.026	-0.145	-0.023	-0.045	0.042	0.013	0.003	-0.008
	40001	0.016	-0.132	0.058	-0.045	0.059	-0.009	0.002	-0.013
	40011	0.124	0.354	0.022	0.108	0.582	0.003	0.002	-0.125
22 Exterior Wall	22011	0.988	0.290	-0.103	-0.002	0.134	0.004	-0.015	0.308
@ EL-4.65	22023	0.115	0.346	0.199	0.296	0.060	-0.058	-0.101	-0.013
~-6.60m	32010	1.122	0.165	-0.061	-0.014	0.105	0.016	-0.001	-0.304
	32020	0.106	0.608	0.254	0.219	0.042	-0.106	0.154	0.013
	42001	0.146	0.653	-0.054	0.288	0.041	0.041	-0.106	0.021
	42011	1.033	0.244	0.147	-0.054	0.071	-0.025	0.003	-0.295
23 Exterior Wall	24211	0.412	0.468	0.003	0.032	0.214	-0.002	-0.005	-0.013
@ EL22.50	24224	0.020	0.303	-0.156	-0.040	-0.051	0.014	0.000	-0.066
~24.60m	34210	0.476	0.175	0.002	0.014	0.165	-0.019	0.002	0.032
	34220	-0.020	0.130	0.004	-0.014	0.029	0.017	-0.029	-0.015
	44201	-0.014	0.151	0.117	-0.008	0.021	-0.012	0.030	-0.009
24 Basemat	90140	0.067	0.126	0.143	0.061	0.035	-0.432	-0.083	0.008
@ Wall	90182	0.335	0.103	0.010	-0.304	0.000	0.061	-0.005	0.272
Below RCCV	90111	0.101	0.245	-0.016	-0.086	-0.322	0.074	0.319	0.006
25 Slab	93140	0.301	0.395	0.345	0.058	0.044	-0.052	0.002	-0.003
EL4.65m	93182	0.688	0.229	-0.053	-0.007	0.087	0.005	0.002	0.067
@ RCCV	93111	0.237	0.673	-0.131	0.061	-0.014	-0.001	0.060	-0.001
26 Slab	96144	-0.061	0.902	0.406	0.038	-0.087	0.044	0.008	0.024
EL17.5m	96186	0.854	-0.302	-0.427	0.019	-0.019	0.075	-0.023	-0.107
@ RCCV	96113	-0.512	1.384	-0.705	-0.863	-0.011	0.377	0.042	0.027
27 Slab	98472	-0.087	0.036	0.303	0.102	0.132	-0.078	0.081	-0.072
EL27.0m	98514	0.092	0.106	0.001	0.028	0.187	0.006	0.000	-0.124
@ RCCV	98424	0.100	0.375	0.013	0.213	0.042	0.010	-0.177	-0.011
28 Pool Girder	123054	0.169	0.020	-0.047	0.000	-0.013	0.003	0.016	-0.016
@ Storage Pool	123154	0.061	0.018	-0.051	0.005	0.007	0.000	0.006	0.001
29 Pool Girder	123062	0.273	0.031	0.062	-0.012	-0.007	0.001	0.018	0.002
@ Cavity	123162	0.169	0.027	0.070	-0.004	0.000	-0.004	0.007	-0.004
30 Pool Girder	123067	0.124	-0.617	-0.016	-0.030	-0.050	-0.024	-0.026	-0.050
@ Fuel Pool	123167	0.276	-0.169	-0.053	0.007	0.008	-0.001	-0.013	0.000
31 MS Tunnel	150122	0.012	-0.082	-0.008	-0.007	0.018	0.006	0.001	-0.004
Wall and Slab	96611	-0.069	0.450	-0.054	0.004	-0.027	0.005	0.001	0.000
	98614	0.009	-0.135	0.006	-0.049	-0.086	-0.019	0.013	0.005

Table 3G.1-16

Results of NASTRAN Analysis, Thermal Load (Normal Operation: Winter)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	-3.416	-0.436	-0.238	-5.952	-6.243	-0.028	0.065	0.689
Pedestal	5013	-3.155	-0.243	-0.162	-6.057	-6.556	-0.004	0.027	0.609
Bottom	5024	-3.256	-0.080	-0.017	-6.096	-6.224	-0.019	-0.022	0.607
2 RPV	6006	-1.888	-0.211	0.032	-5.713	-5.278	0.160	0.048	-0.729
Pedestal	6013	-1.987	-0.330	-0.228	-5.852	-5.207	-0.029	-0.014	-0.829
Mid-Height	6024	-2.007	-0.140	-0.005	-6.482	-3.985	-0.230	0.007	-0.734
3 RPV	6606	-0.852	-0.110	0.197	-5.574	-3.430	-0.009	-0.362	-1.752
Pedestal	6613	-0.660	-0.140	-0.234	-5.555	-3.418	0.040	0.441	-1.801
Top	6624	-0.487	-0.239	0.047	-5.510	-3.225	0.025	-0.598	-1.760
4 RCCV	1806	-2.358	-1.165	-0.421	-3.691	-5.525	0.051	0.067	-0.418
Wetwell	1813	-2.830	-3.329	-0.393	-3.575	-5.572	-0.013	-0.005	-0.443
Bottom	1824	-2.263	-3.895	-0.014	-3.677	-5.576	0.011	-0.055	-0.441
5 RCCV	2606	-2.856	-1.338	-0.368	-3.046	-2.370	-0.002	0.047	-0.123
Wetwell	2613	-4.046	-4.137	-0.098	-2.639	-1.951	0.004	-0.050	0.067
Mid-Height	2624	-3.419	-4.641	-0.097	-2.943	-2.006	-0.020	0.049	0.035
6 RCCV	3406	0.470	-1.734	0.025	-3.082	-3.544	-0.095	0.193	0.550
Wetwell	3413	-1.541	-5.105	0.245	-2.833	-3.201	0.000	0.007	0.537
Top	3424	0.137	-5.954	0.242	-2.664	-1.583	-0.006	-0.001	0.021
7 RCCV	3606	-2.433	-1.900	-0.266	-4.072	-4.066	0.066	0.186	0.027
Drywell	3613	-1.821	-5.901	0.870	-2.991	-2.674	-0.069	-0.021	0.188
Bottom	3624	-13.503	-7.189	0.027	0.195	1.095	0.041	0.024	1.815
8 RCCV	4006	0.430	-1.593	0.317	-4.004	-3.958	0.072	0.025	-0.043
Drywell	4013	0.904	-6.941	0.766	-3.143	-2.964	0.022	-0.090	0.112
Mid-Height	4976	-8.130	-6.549	0.417	-0.447	-1.747	0.005	0.009	-0.182
9 RCCV	4406	4.610	-0.745	0.406	-4.039	-4.586	0.241	0.299	0.468
Drywell	4413	0.773	-7.522	-0.125	-3.419	-4.182	0.246	-0.068	0.634
Top	4424	-8.585	-5.738	0.624	0.049	0.695	-0.018	-0.019	-1.557
10 Basemat	80003	-4.857	-5.448	0.017	-7.898	-7.846	-0.038	0.023	-0.005
@ Center	80007	-4.874	-5.410	0.050	-7.870	-7.841	-0.035	0.019	-0.007
	80012	-4.878	-5.344	0.037	-7.860	-7.846	-0.031	0.014	0.001
11 Basemat	80206	-4.880	-5.796	0.110	-8.292	-8.185	-0.019	0.008	-0.043
Inside	80213	-5.034	-5.446	0.111	-8.059	-8.291	-0.167	-0.052	-0.079
RPV Pedestal	80224	-4.937	-5.240	0.069	-8.070	-7.944	-0.032	-0.041	0.009
12 S/P Slab	83306	-5.495	-1.113	-0.094	-2.913	-2.638	-0.002	0.165	-0.007
@ RPV	83313	-5.874	-0.758	0.026	-2.875	-2.650	-0.022	0.211	0.009
	83324	-5.758	-0.544	0.382	-2.796	-2.575	-0.007	0.260	0.007
13 S/P Slab	83406	-4.104	-2.465	-0.329	-3.136	-2.789	-0.010	0.088	0.004
@ Center	83413	-4.777	-1.978	0.284	-3.253	-2.846	-0.009	0.147	-0.001
	83424	-4.441	-1.787	0.049	-3.257	-2.800	0.000	0.167	-0.001
14 S/P Slab	83506	-3.395	-2.904	-0.296	-3.304	-2.966	-0.023	0.034	0.005
@ RCCV	83513	-4.170	-2.753	0.327	-3.681	-3.033	-0.006	0.146	0.002
	83524	-3.667	-2.323	-0.003	-3.676	-3.022	0.013	0.132	-0.005
15 Topslab	98120	-8.337	-6.183	-4.444	1.186	1.119	1.039	0.013	0.123
@ Drywell Head	98135	-12.892	-3.716	2.322	2.079	0.076	-0.350	0.159	-0.066
Opening	98104	-3.417	-7.424	2.577	0.229	2.121	-0.472	0.061	-0.120
16 Topslab	98149	-8.148	-5.411	-1.942	1.760	1.872	0.385	0.071	0.275
@ Center	98170	-8.561	-5.053	-0.697	1.762	2.875	-0.007	0.031	0.317
	98109	-7.314	-4.890	1.122	1.237	1.961	0.002	0.227	-0.048
17 Topslab	98174	-6.900	-5.123	-0.762	2.423	3.574	0.010	-0.252	0.687
@ RCCV	98197	-10.270	-4.990	-0.959	1.538	2.496	0.193	0.165	-0.575
	98103	-8.144	-5.619	-0.074	3.118	2.696	0.101	0.446	0.082

Table 3G.1-16

Results of NASTRAN Analysis, Thermal Load (Normal Operation: Winter) (Continued)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall	6	1.183	-0.300	-0.581	0.093	0.945	-0.030	0.017	0.053
Below RCCV	13	0.441	-2.496	-0.621	0.358	2.024	-0.003	0.017	0.440
Bottom	24	0.625	-2.602	0.113	0.368	2.055	-0.004	-0.001	0.455
19 Wall	806	1.027	-1.059	0.066	0.150	0.802	0.069	-0.032	0.019
Below RCCV	813	0.606	-2.435	-0.494	0.083	0.771	-0.021	0.006	0.460
Mid-Height	824	0.486	-2.695	0.084	0.100	0.786	0.014	0.008	0.416
20 Wall	1606	6.931	-1.621	0.058	-0.399	-1.816	0.061	0.067	1.357
Below RCCV	1613	6.697	-2.790	-0.429	-0.487	-2.828	-0.002	-0.010	1.700
Top	1624	7.208	-3.505	-0.098	-0.548	-2.796	-0.004	-0.051	1.746
21 Exterior Wall	20011	2.574	2.597	0.476	0.200	0.736	0.056	-0.073	0.287
@ EL-11.50	20023	-0.925	-0.790	1.316	-3.134	-2.253	0.245	-0.347	0.683
~-10.50m	30010	0.009	1.822	-0.198	0.940	3.078	-0.021	0.006	-0.537
	30020	-0.117	-1.021	-0.217	0.131	1.082	0.109	-0.029	-0.274
	40001	-0.159	-0.676	-0.069	0.171	1.185	-0.072	0.112	-0.306
	40011	0.795	2.396	0.046	1.003	3.267	0.006	0.011	-0.588
22 Exterior Wall	22011	1.925	2.250	-0.099	-0.073	-0.062	0.031	0.017	0.121
@ EL-4.65	22023	1.232	-3.735	-1.275	-0.066	-0.177	-0.206	0.125	-0.014
~-6.60m	32010	12.335	5.926	0.007	-2.697	-2.526	-0.002	-0.003	-0.172
	32020	0.311	4.026	2.291	-0.572	-1.830	-0.392	0.720	0.111
	42001	2.251	2.853	2.394	-0.735	-1.651	-0.048	-0.662	-0.269
	42011	10.754	3.993	0.067	-2.795	-2.459	0.077	0.067	-0.088
23 Exterior Wall	24211	2.517	2.010	-0.424	-0.009	-0.240	0.045	-0.136	1.718
@ EL22.50	24224	0.131	3.816	-3.363	0.643	-0.242	-0.548	-0.617	-0.219
~24.60m	34210	13.392	4.444	-0.424	-2.795	-2.684	0.027	-0.009	-0.153
	34220	1.581	3.765	2.290	0.665	-1.618	-0.429	1.494	0.117
	44201	0.864	4.461	-0.104	0.302	-1.803	0.423	-1.817	0.106
24 Basemat	90140	0.873	1.372	1.288	0.726	-0.013	-0.887	-0.526	-0.103
@ Wall	90182	1.585	0.442	0.526	-0.091	-3.059	0.150	-0.137	2.362
Below RCCV	90111	0.524	2.382	-0.013	-3.376	-0.411	0.037	2.470	0.114
25 Slab	93140	-0.669	1.616	2.623	-0.429	-0.327	0.237	-0.118	0.097
EL4.65m	93182	2.339	-2.693	-0.780	-0.291	-1.477	-0.064	0.060	1.092
@ RCCV	93111	-2.390	2.999	-0.080	-1.455	-0.267	-0.037	0.958	0.002
26 Slab	96144	0.037	2.659	2.995	-0.150	-0.129	0.102	-0.027	0.043
EL17.5m	96186	2.697	-1.893	-1.088	-0.101	-0.478	-0.033	0.018	0.385
@ RCCV	96113	-4.345	-3.843	-0.730	-3.634	-2.664	-0.140	0.735	-0.030
27 Slab	98472	-0.481	-0.876	4.539	-0.424	-0.140	-0.156	0.326	-0.432
EL27.0m	98514	-0.577	-2.450	-1.127	-0.529	-0.404	-0.022	0.038	-0.377
@ RCCV	98424	-7.365	-12.824	-1.255	-6.259	-1.618	0.047	-5.241	0.054
28 Pool Girder	123054	0.576	-3.049	1.394	2.218	2.151	0.031	-0.307	0.545
@ Storage Pool	123154	0.880	0.664	-0.256	1.849	1.112	-0.332	-0.107	0.234
29 Pool Girder	123062	-2.850	-0.164	-0.502	0.099	0.139	0.035	-0.092	0.077
@ Cavity	123162	-2.523	-0.132	-0.510	0.074	-0.199	0.056	-0.181	0.097
30 Pool Girder	123067	-2.952	-4.659	-1.603	0.547	0.394	-0.075	-0.114	0.513
@ Fuel Pool	123167	-2.741	-2.321	-2.085	0.182	-0.525	-0.232	0.019	0.153
31 MS Tunnel	150122	0.267	-0.537	1.825	1.079	3.150	-0.033	-0.584	0.414
Wall and Slab	96611	-0.243	2.762	-0.171	-1.125	-6.748	-0.368	0.367	0.186
	98614	-0.177	2.271	-0.137	-0.721	-10.197	0.036	0.428	0.285

Table 3G.1-17

Results of NASTRAN Analysis, Thermal Load (LOCA After 6 minutes: Winter)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	-3.477	1.650	-0.339	-6.696	-6.473	-0.045	0.110	1.009
Pedestal	5013	-3.130	1.794	-0.083	-6.863	-6.856	-0.006	0.023	0.926
Bottom	5024	-3.394	1.906	-0.001	-6.891	-6.143	-0.027	-0.034	1.037
2 RPV	6006	0.067	1.755	0.162	-6.160	-4.019	0.265	0.075	-1.529
Pedestal	6013	-0.091	1.447	-0.178	-6.439	-3.908	-0.057	-0.026	-1.669
Mid-Height	6024	-0.234	2.057	0.062	-7.399	-2.300	-0.303	-0.003	-1.551
3 RPV	6606	21.003	2.199	0.571	-6.642	-5.535	-0.046	-1.920	0.884
Pedestal	6613	21.062	1.960	-0.446	-6.709	-5.541	0.140	2.058	0.853
Top	6624	21.918	2.602	0.224	-6.666	-5.662	0.008	-2.345	1.058
4 RCCV	1806	2.538	0.393	-0.222	-4.442	-8.116	0.066	0.081	-1.726
Wetwell	1813	1.857	-2.167	-0.444	-4.275	-7.777	-0.024	-0.007	-1.526
Bottom	1824	2.938	-2.477	0.048	-4.432	-8.139	0.019	-0.085	-1.670
5 RCCV	2606	1.389	0.550	-0.146	-3.335	-1.060	0.021	0.034	0.043
Wetwell	2613	0.113	-2.558	-0.121	-3.089	-1.048	0.009	-0.074	0.369
Mid-Height	2624	0.970	-2.907	-0.086	-3.292	-0.934	-0.026	0.067	0.189
6 RCCV	3406	11.700	1.428	0.353	-4.152	-8.450	-0.228	0.462	3.344
Wetwell	3413	8.031	-3.446	0.040	-4.382	-9.149	-0.403	0.539	3.335
Top	3424	10.294	-4.168	0.471	-3.680	-5.044	-0.038	-0.007	2.165
7 RCCV	3606	8.481	1.351	0.705	-5.341	-9.025	0.605	0.535	-1.974
Drywell	3613	4.607	-4.166	1.002	-4.955	-6.228	-0.363	0.318	-0.820
Bottom	3624	-4.289	-6.045	0.252	-0.934	-2.499	0.068	-0.001	0.350
8 RCCV	4006	5.934	2.176	0.228	-5.109	-5.059	0.011	-0.128	-0.683
Drywell	4013	4.288	-5.853	1.039	-4.672	-4.288	0.013	-0.132	-0.308
Mid-Height	4976	-2.657	-5.340	0.578	-0.953	-1.777	0.004	0.013	-0.585
9 RCCV	4406	6.443	1.716	-0.228	-4.470	-3.808	0.301	0.088	-0.153
Drywell	4413	0.718	-6.633	-0.295	-4.753	-4.468	0.253	-0.244	0.644
Top	4424	-5.839	-4.178	0.764	-0.362	1.133	-0.024	-0.022	-1.462
10 Basemat	80003	-4.361	-5.064	0.010	-8.115	-8.087	-0.031	0.030	-0.007
@ Center	80007	-4.380	-5.029	0.041	-8.081	-8.084	-0.028	0.028	-0.008
	80012	-4.384	-4.970	0.030	-8.065	-8.094	-0.024	0.023	0.001
11 Basemat	80206	-4.366	-5.447	0.114	-8.537	-8.473	0.021	0.002	-0.045
Inside	80213	-4.494	-5.044	0.109	-8.253	-8.556	-0.118	-0.004	-0.108
RPV Pedestal	80224	-4.424	-4.901	0.060	-8.160	-8.192	-0.035	-0.034	0.010
12 S/P Slab	83306	-10.578	10.974	0.416	-4.708	-2.771	0.029	-0.296	0.000
@ RPV	83313	-10.828	11.228	-0.835	-4.734	-2.849	-0.041	-0.301	-0.027
	83324	-10.705	11.877	1.291	-4.485	-2.653	0.007	-0.155	0.046
13 S/P Slab	83406	-6.461	4.868	-0.561	-3.802	-3.176	-0.003	-0.312	0.014
@ Center	83413	-6.987	5.300	0.324	-3.901	-3.259	-0.016	-0.276	-0.011
	83424	-6.636	5.835	0.088	-3.896	-3.148	-0.002	-0.210	0.009
14 S/P Slab	83506	-3.917	2.321	-0.471	-2.874	-3.120	-0.034	-0.284	0.013
@ RCCV	83513	-4.564	2.411	0.445	-3.195	-3.177	-0.008	-0.190	-0.001
	83524	-4.044	3.212	-0.010	-3.279	-3.153	0.013	-0.167	-0.005
15 Topslab	98120	-7.159	-4.295	-0.826	0.963	0.733	2.771	-0.163	-0.005
@ Drywell Head	98135	-8.776	-5.279	0.213	3.150	-2.057	-1.132	0.380	-0.267
Opening	98104	-4.990	-1.708	0.576	-1.459	3.716	-1.501	0.186	-0.213
16 Topslab	98149	-6.095	-2.564	-1.166	2.235	2.318	0.500	0.036	0.047
@ Center	98170	-5.522	-3.576	-1.068	2.144	2.867	-0.043	0.030	0.389
	98109	-6.255	-0.872	0.768	1.221	2.566	-0.119	0.329	-0.005
17 Topslab	98174	-4.857	-2.720	-0.479	2.355	3.217	0.258	-0.023	0.433
@ RCCV	98197	-7.582	-2.932	-1.375	1.918	3.109	0.128	0.154	-0.449
	98103	-6.579	-2.446	-0.073	3.434	3.309	0.118	0.451	0.084

Table 3G.1-17

Results of NASTRAN Analysis, Thermal Load (LOCA After 6 minutes: Winter) (Continued)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall	6	1.107	-0.568	-0.679	0.118	1.100	-0.036	0.029	0.063
Below RCCV	13	0.363	-3.011	-0.654	0.407	2.278	-0.002	0.019	0.473
Bottom	24	0.428	-3.036	0.150	0.424	2.345	-0.005	-0.001	0.512
19 Wall	806	1.520	-1.444	0.161	0.260	1.324	0.084	-0.040	-0.084
Below RCCV	813	1.025	-2.960	-0.498	0.172	1.284	-0.025	0.005	0.446
Mid-Height	824	0.901	-3.042	0.134	0.177	1.308	0.018	0.011	0.397
20 Wall	1606	11.606	-2.114	0.220	-0.682	-3.317	0.083	0.083	2.345
Below RCCV	1613	11.216	-3.473	-0.445	-0.783	-4.373	-0.006	-0.013	2.707
Top	1624	12.199	-3.966	-0.117	-0.867	-4.482	-0.002	-0.082	2.818
21 Exterior Wall	20011	2.783	3.204	0.556	0.250	0.892	0.077	-0.085	0.330
@ EL-11.50	20023	-0.928	-0.756	1.256	-3.151	-2.204	0.242	-0.326	0.699
~-10.50m	30010	0.279	2.139	-0.239	1.005	3.442	-0.023	0.006	-0.574
	30020	-0.088	-1.198	-0.236	0.082	1.103	0.123	-0.022	-0.270
	40001	-0.155	-0.832	0.018	0.125	1.237	-0.081	0.115	-0.310
	40011	0.876	2.784	0.049	1.074	3.671	0.007	0.012	-0.636
22 Exterior Wall	22011	3.512	2.672	-0.082	-0.124	-0.157	0.051	0.033	-0.023
@ EL-4.65	22023	1.402	-3.214	-1.242	0.313	-0.113	-0.213	-0.014	-0.031
~-6.60m	32010	14.393	6.122	0.004	-2.798	-2.758	0.004	-0.008	0.041
	32020	0.444	4.718	2.528	-0.284	-1.833	-0.377	0.922	0.167
	42001	2.452	3.605	2.538	-0.370	-1.611	-0.058	-0.794	-0.254
	42011	12.436	4.406	0.147	-2.976	-2.775	0.081	0.081	0.173
23 Exterior Wall	24211	3.817	2.954	-0.367	0.094	0.338	0.049	-0.142	1.510
@ EL22.50	24224	0.353	4.746	-3.617	0.874	-0.344	-0.444	-0.820	-0.411
~24.60m	34210	15.330	4.791	-0.312	-2.778	-2.408	0.015	-0.011	0.104
	34220	1.720	4.438	2.296	0.979	-1.464	-0.240	1.609	0.013
	44201	1.001	5.210	0.298	0.667	-1.698	0.337	-1.910	0.044
24 Basemat	90140	0.890	1.411	1.346	0.397	-0.251	-0.837	-0.696	-0.036
@ Wall	90182	1.777	0.495	0.537	-0.265	-3.839	0.161	-0.125	2.759
Below RCCV	90111	0.563	2.234	-0.012	-4.126	-0.521	0.053	2.855	0.124
25 Slab	93140	-0.598	2.335	4.275	-0.542	-0.409	0.304	-0.147	0.123
EL4.65m	93182	4.223	-4.036	-1.099	-0.353	-1.823	-0.083	0.075	1.366
@ RCCV	93111	-3.605	4.959	-0.256	-1.768	-0.316	-0.047	1.178	0.000
26 Slab	96144	-0.270	4.701	6.966	-0.228	-0.122	0.166	-0.072	0.023
EL17.5m	96186	6.688	-4.125	-1.417	-0.090	-0.313	-0.048	0.016	0.346
@ RCCV	96113	-8.342	2.577	-1.679	-4.480	-2.783	-0.199	1.239	-0.059
27 Slab	98472	-0.766	-0.797	5.408	-0.313	0.033	-0.312	0.451	-0.562
EL27.0m	98514	0.438	-2.394	-1.401	-0.532	-0.068	-0.006	0.036	-0.727
@ RCCV	98424	-7.591	-10.575	-1.415	-5.823	-1.582	0.072	-5.617	0.028
28 Pool Girder	123054	1.312	-2.833	1.438	2.280	2.119	0.026	-0.231	0.481
@ Storage Pool	123154	1.029	0.746	-0.399	1.924	1.145	-0.340	-0.086	0.247
29 Pool Girder	123062	-1.258	-0.152	-0.701	0.103	0.324	0.027	0.057	0.173
@ Cavity	123162	-1.667	-0.034	-0.462	0.130	-0.117	-0.002	-0.152	0.085
30 Pool Girder	123067	-2.311	-5.928	-1.779	0.647	0.431	-0.116	-0.149	0.467
@ Fuel Pool	123167	-2.108	-2.650	-2.209	0.276	-0.451	-0.231	-0.013	0.179
31 MS Tunnel	150122	0.224	-0.517	1.902	1.053	3.141	-0.007	-0.584	0.363
Wall and Slab	96611	-0.447	4.104	-0.332	-1.287	-7.108	-0.423	0.426	0.209
	98614	-0.188	1.992	-0.146	-0.862	-10.483	-0.011	0.470	0.303

Table 3G.1-18

Results of NASTRAN Analysis, Thermal Load (LOCA After 72 hours: Winter)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	-12.845	0.250	-0.532	-16.012	-12.643	-0.092	0.231	4.151
Pedestal	5013	-12.361	0.340	-0.091	-16.298	-13.248	-0.007	0.018	4.060
Bottom	5024	-12.833	0.244	0.006	-16.283	-11.850	-0.073	-0.052	4.256
2 RPV	6006	-2.421	0.594	0.451	-16.077	-14.899	0.436	0.156	-1.788
Pedestal	6013	-2.655	0.215	-0.207	-16.601	-14.799	-0.049	-0.033	-2.015
Mid-Height	6024	-2.716	0.675	0.078	-18.530	-11.372	-0.660	0.021	-1.706
3 RPV	6606	8.843	0.688	0.583	-16.162	-12.321	0.045	-1.373	-1.999
Pedestal	6613	9.187	0.728	-0.380	-16.206	-12.531	0.030	1.514	-1.961
Top	6624	9.562	0.849	0.249	-16.169	-12.374	0.070	-1.774	-1.798
4 RCCV	1806	-1.529	-1.095	-0.255	-10.252	-14.624	0.079	0.094	-1.532
Wetwell	1813	-2.046	-4.246	-0.418	-10.039	-14.124	-0.042	-0.006	-1.257
Bottom	1824	-0.999	-4.101	0.138	-10.225	-14.390	0.027	-0.105	-1.324
5 RCCV	2606	-4.260	-1.284	-0.207	-9.988	-7.587	0.005	0.040	0.086
Wetwell	2613	-5.195	-5.332	-0.051	-9.724	-7.431	-0.015	-0.092	0.416
Mid-Height	2624	-4.918	-4.757	-0.110	-10.020	-7.637	-0.043	0.078	0.193
6 RCCV	3406	5.175	-0.376	0.529	-10.840	-14.111	0.026	0.145	2.473
Wetwell	3413	3.430	-7.155	0.358	-10.781	-14.122	-0.110	0.133	2.640
Top	3424	2.847	-6.404	0.482	-9.992	-9.739	0.046	-0.109	0.898
7 RCCV	3606	0.830	-0.284	0.115	-12.664	-14.950	0.281	0.181	-0.832
Drywell	3613	-0.941	-8.496	1.387	-12.338	-13.243	-0.243	0.025	-0.346
Bottom	3624	-10.574	-8.041	0.298	-7.214	-6.867	0.090	-0.064	1.481
8 RCCV	4006	1.875	0.839	-0.303	-12.243	-12.221	0.193	-0.156	-0.809
Drywell	4013	1.199	-10.522	1.291	-12.197	-11.582	0.045	-0.165	-0.458
Mid-Height	4976	-7.090	-6.964	0.636	-7.680	-8.654	0.012	0.038	-0.306
9 RCCV	4406	6.737	0.276	-1.384	-11.629	-9.857	0.511	0.461	-0.604
Drywell	4413	-0.979	-11.885	-0.375	-12.126	-10.998	0.410	-0.181	0.175
Top	4424	-10.166	-5.578	0.969	-7.106	-5.867	-0.070	-0.009	-1.762
10 Basemat	80003	-1.679	-2.344	-0.012	-8.432	-8.745	-0.031	0.023	-0.009
@ Center	80007	-1.684	-2.300	0.024	-8.412	-8.747	-0.031	0.015	-0.013
	80012	-1.690	-2.227	0.016	-8.402	-8.767	-0.023	0.005	0.002
11 Basemat	80206	-1.712	-2.848	0.097	-8.908	-9.252	0.053	-0.011	-0.059
Inside	80213	-1.772	-2.262	0.036	-8.632	-9.316	-0.133	-0.013	-0.169
RPV Pedestal	80224	-1.625	-2.127	0.040	-8.608	-8.912	-0.042	-0.100	0.019
12 S/P Slab	83306	-11.644	3.829	0.179	-9.646	-8.196	0.033	-0.080	-0.040
@ RPV	83313	-11.916	4.301	-0.412	-9.666	-8.271	-0.027	-0.074	0.012
	83324	-11.700	4.708	0.978	-9.527	-8.129	-0.001	0.005	0.006
13 S/P Slab	83406	-8.113	-0.586	-0.539	-9.089	-8.498	-0.001	-0.113	0.014
@ Center	83413	-8.751	0.101	0.493	-9.200	-8.593	-0.013	-0.068	-0.007
	83424	-8.215	0.434	0.022	-9.166	-8.498	0.001	-0.042	0.006
14 S/P Slab	83506	-6.242	-2.430	-0.408	-8.821	-8.626	-0.045	-0.143	0.019
@ RCCV	83513	-7.029	-2.087	0.617	-9.213	-8.689	-0.011	-0.020	0.001
	83524	-6.242	-1.435	-0.072	-9.173	-8.644	0.017	-0.038	-0.005
15 Topslab	98120	-11.552	-10.624	-5.088	7.064	5.010	5.160	-1.418	-1.083
@ Drywell Head	98135	-16.116	-6.978	2.414	10.532	-0.434	-1.821	1.058	-1.141
Opening	98104	-6.693	-12.082	2.871	2.391	11.786	-3.140	0.877	-0.610
16 Topslab	98149	-11.296	-3.042	-1.890	5.802	8.895	0.962	0.549	-1.908
@ Center	98170	-9.623	-4.570	-0.897	4.305	5.412	-0.102	-0.115	0.049
	98109	-7.853	-1.630	0.872	9.058	11.508	-0.323	0.767	0.077
17 Topslab	98174	-9.246	-4.000	-1.475	5.058	6.605	0.114	-0.062	0.290
@ RCCV	98197	-11.730	-4.691	-1.514	4.218	6.201	0.219	0.358	-0.440
	98103	-7.871	-5.553	-0.329	12.884	12.663	0.252	0.585	0.155

Table 3G.1-18

Results of NASTRAN Analysis, Thermal Load (LOCA After 72 hours: Winter) (Continued)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall	6	0.673	-1.073	-0.904	0.256	1.958	-0.049	0.048	0.311
Below RCCV	13	-0.119	-4.048	-0.748	0.603	3.352	-0.002	0.023	0.782
Bottom	24	0.118	-3.760	0.215	0.593	3.309	-0.007	-0.003	0.776
19 Wall	806	1.824	-2.260	0.204	0.332	1.720	0.091	-0.055	-0.103
Below RCCV	813	1.349	-3.956	-0.557	0.219	1.696	-0.032	0.005	0.598
Mid-Height	824	1.162	-3.729	0.206	0.225	1.731	0.027	0.015	0.503
20 Wall	1606	15.858	-3.186	0.301	-0.853	-4.075	0.108	0.100	3.080
Below RCCV	1613	15.698	-4.645	-0.441	-1.003	-5.526	-0.010	-0.016	3.605
Top	1624	16.701	-4.840	-0.100	-1.115	-5.550	0.000	-0.106	3.700
21 Exterior Wall	20011	3.065	4.610	0.680	0.386	1.389	0.095	-0.105	0.549
@ EL-11.50	20023	-0.923	-0.709	1.214	-3.198	-2.113	0.237	-0.314	0.735
~-10.50m	30010	0.517	3.114	-0.366	1.209	4.571	-0.033	-0.002	-0.827
	30020	-0.057	-1.480	-0.391	0.022	1.207	0.144	-0.026	-0.281
	40001	-0.091	-1.142	0.059	0.040	1.330	-0.097	0.105	-0.322
	40011	1.307	3.629	0.056	1.243	4.651	0.011	0.014	-0.842
22 Exterior Wall	22011	5.013	4.358	-0.217	-0.171	-0.224	0.069	0.046	0.082
@ EL-4.65	22023	1.628	-2.769	-1.390	0.748	-0.043	-0.218	-0.198	-0.044
~-6.60m	32010	16.724	7.722	-0.080	-2.893	-3.002	-0.001	-0.014	0.024
	32020	0.652	4.868	2.520	0.104	-1.860	-0.395	1.226	0.199
	42001	2.721	3.799	2.647	0.131	-1.563	-0.051	-0.998	-0.239
	42011	14.114	5.515	0.239	-3.165	-3.047	0.073	0.090	0.170
23 Exterior Wall	24211	5.670	5.757	-0.305	0.173	0.680	0.046	-0.169	1.421
@ EL22.50	24224	1.023	5.452	-3.719	1.968	0.070	-0.635	-1.559	-0.317
~24.60m	34210	21.820	5.544	-0.576	-2.904	-2.819	0.035	-0.002	-0.128
	34220	2.793	5.435	4.410	2.628	-1.178	-0.711	2.570	0.094
	44201	1.791	6.589	0.558	2.230	-1.491	0.539	-2.966	0.044
24 Basemat	90140	0.676	1.652	1.723	-0.528	-1.081	-0.960	-1.149	0.173
@ Wall	90182	2.064	0.701	0.416	-0.892	-5.505	0.237	-0.094	3.815
Below RCCV	90111	0.729	2.934	-0.023	-5.319	-1.147	0.110	3.683	0.149
25 Slab	93140	-0.316	3.040	5.795	-0.766	-0.578	0.430	-0.204	0.176
EL4.65m	93182	6.154	-5.153	-1.520	-0.480	-2.502	-0.114	0.105	1.898
@ RCCV	93111	-4.497	6.824	-0.447	-2.369	-0.414	-0.066	1.593	0.001
26 Slab	96144	0.733	5.828	8.140	-0.230	-0.175	0.172	-0.041	0.066
EL17.5m	96186	9.998	-4.559	-2.164	-0.149	-0.672	-0.057	0.023	0.636
@ RCCV	96113	-9.167	5.153	-1.808	-4.376	-2.755	-0.236	1.009	-0.100
27 Slab	98472	-3.634	-3.174	5.923	-1.728	-1.314	-0.297	0.535	-0.686
EL27.0m	98514	-2.861	-2.861	-1.575	-1.927	-1.717	-0.031	0.065	-0.722
@ RCCV	98424	-6.661	-7.075	-2.107	-3.864	-0.717	0.116	-5.743	0.001
28 Pool Girder	123054	3.582	1.292	2.390	3.612	2.453	-0.343	0.113	0.316
@ Storage Pool	123154	3.638	3.573	-2.903	3.370	1.304	-0.375	-0.255	0.413
29 Pool Girder	123062	0.502	0.112	-1.366	3.839	3.894	0.009	0.033	0.189
@ Cavity	123162	1.956	0.408	-1.831	3.805	2.820	0.092	-0.289	0.644
30 Pool Girder	123067	-2.007	-7.205	-2.944	3.600	3.532	-0.636	0.318	0.813
@ Fuel Pool	123167	-0.584	-2.758	-3.092	2.757	1.832	-0.245	-0.178	0.615
31 MS Tunnel	150122	0.316	-0.714	1.798	0.940	3.102	0.011	-0.551	0.426
Wall and Slab	96611	-0.557	4.665	-0.414	-1.253	-7.115	-0.406	0.420	0.206
	98614	-0.043	0.730	-0.044	-0.852	-9.932	-0.019	0.460	0.307

Table 3G.1-19

Results of NASTRAN Analysis, Seismic Load (Horizontal: North to South Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	-3.083	-4.179	-1.043	0.834	5.073	0.047	0.056	2.171
Pedestal	5013	-0.386	1.517	-1.467	0.299	1.833	-0.045	0.184	0.677
Bottom	5024	2.337	7.411	-0.116	-0.519	-1.859	0.009	0.013	-1.002
2 RPV	6006	0.378	-2.346	-0.857	-0.144	-0.036	0.005	0.128	-0.014
Pedestal	6013	-0.383	1.441	-1.462	-0.312	-0.154	-0.039	-0.054	0.014
Mid-Height	6024	-0.473	3.710	0.280	0.239	0.150	-0.040	-0.032	-0.200
3 RPV	6606	0.029	-1.486	-0.173	-0.294	-2.727	-0.251	0.592	0.878
Pedestal	6613	-1.065	1.318	-1.163	-0.442	-1.612	0.330	-0.195	0.299
Top	6624	0.369	3.868	-0.083	0.207	-0.056	0.042	-0.140	-0.076
4 RCCV	1806	-1.589	-1.567	-3.991	0.297	2.001	-0.076	0.034	0.745
Wetwell	1813	-0.405	2.958	-4.573	0.114	0.846	-0.039	0.019	0.342
Bottom	1824	0.815	6.234	-0.283	-0.033	-0.312	-0.008	0.003	-0.223
5 RCCV	2606	-0.346	-1.042	-4.073	-0.060	-0.098	-0.121	-0.015	0.196
Wetwell	2613	-0.776	2.655	-4.531	-0.046	-0.085	-0.043	-0.028	0.156
Mid-Height	2624	-0.028	4.643	-0.272	0.074	0.157	-0.002	-0.003	-0.036
6 RCCV	3406	0.035	-0.512	-3.752	-0.091	-0.207	-0.078	0.006	0.126
Wetwell	3413	-0.619	2.314	-4.331	-0.025	-0.166	-0.108	0.117	0.070
Top	3424	-0.571	3.381	-0.181	0.062	0.327	0.035	-0.019	-0.130
7 RCCV	3606	0.140	-0.286	-3.727	0.110	0.811	-0.008	0.027	0.355
Drywell	3613	-0.650	2.004	-3.952	0.094	0.504	-0.021	0.110	0.203
Bottom	3624	-0.605	3.577	-0.197	-0.053	-0.253	0.053	0.003	-0.002
8 RCCV	4006	1.236	-0.186	-3.298	0.011	-0.325	-0.061	-0.071	0.239
Drywell	4013	-0.213	2.268	-3.816	0.015	-0.083	-0.085	0.017	0.120
Mid-Height	4976	-0.526	2.697	-0.249	-0.081	-0.180	-0.016	0.012	-0.035
9 RCCV	4406	1.239	-0.078	-2.463	-0.163	-0.895	0.060	0.075	0.195
Drywell	4413	0.639	2.552	-3.237	-0.108	-0.448	-0.002	0.013	0.079
Top	4424	-1.004	1.993	-0.209	-0.074	-0.379	-0.022	-0.007	-0.003
10 Basemat	80003	3.094	2.293	-0.511	-7.882	-6.864	0.154	0.538	0.093
@ Center	80007	3.129	2.486	-0.433	-7.171	-6.643	0.308	0.666	0.119
	80012	2.801	2.812	-0.255	-6.619	-6.341	0.091	0.746	0.004
11 Basemat	80206	3.728	1.278	-1.436	-9.997	-7.683	0.702	0.556	0.033
Inside	80213	3.163	2.513	-2.028	-6.085	-4.599	1.367	0.861	0.777
RPV Pedestal	80224	2.483	4.246	-0.218	-0.049	-2.844	0.233	1.886	0.111
12 S/P Slab	83306	-0.353	-0.814	-1.453	-2.816	-1.585	-0.298	-1.007	0.148
@ RPV	83313	-0.392	-1.414	0.724	-1.612	-1.010	-0.429	-0.553	0.176
	83324	-0.612	-0.175	0.190	-0.243	-0.272	-0.029	-0.036	0.018
13 S/P Slab	83406	-0.294	-1.163	-1.325	0.403	-0.878	-0.230	-0.705	-0.010
@ Center	83413	-0.303	-1.143	0.680	0.211	-0.628	-0.292	-0.403	0.009
	83424	-0.867	-0.199	0.099	0.031	-0.303	-0.018	-0.056	0.001
14 S/P Slab	83506	-0.142	-1.302	-1.091	2.375	0.032	-0.032	-0.543	-0.049
@ RCCV	83513	-0.268	-0.930	0.663	1.309	-0.079	-0.045	-0.310	-0.055
	83524	-0.904	-0.298	0.053	0.152	-0.213	0.000	-0.035	-0.004
15 Topslab	98120	0.281	0.042	0.123	-0.067	-0.093	-0.055	-0.055	-0.029
@ Drywell Head	98135	0.983	0.099	-0.149	-0.201	-0.006	0.014	-0.024	0.022
Opening	98104	-0.055	-1.663	0.067	-0.066	-0.366	0.013	-0.045	0.019
16 Topslab	98149	0.450	0.540	0.228	-0.114	0.038	-0.116	-0.056	0.024
@ Center	98170	0.223	-0.296	0.240	-0.122	-0.159	-0.015	-0.024	-0.022
	98109	0.124	-1.422	-0.076	-0.251	-0.419	-0.015	-0.074	0.067
17 Topslab	98174	0.057	1.170	0.209	0.166	0.142	-0.291	-0.094	0.055
@ RCCV	98197	0.190	-0.521	0.523	0.097	0.029	-0.112	0.026	0.134
	98103	-0.121	-1.604	0.051	-1.192	-0.617	0.011	-0.274	0.018

Table 3G.1-19

Results of NASTRAN Analysis, Seismic Load (Horizontal: North to South Direction) (Continued)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall	6	-4.083	-2.977	-3.250	0.947	5.610	0.025	0.009	2.083
Below RCCV	13	0.052	2.819	-3.746	0.608	3.221	-0.054	0.099	0.998
Bottom	24	2.853	8.172	-0.025	0.203	1.099	-0.007	0.001	0.037
19 Wall	806	-2.115	-2.451	-3.494	-0.083	-0.290	-0.011	0.023	0.210
Below RCCV	813	-0.323	3.125	-4.705	0.000	-0.041	-0.034	-0.003	0.282
Mid-Height	824	1.110	7.464	-0.158	0.028	0.187	-0.002	0.001	0.136
20 Wall	1606	-1.409	-1.886	-3.817	-0.276	-1.323	-0.067	0.013	0.201
Below RCCV	1613	-0.183	2.987	-4.708	-0.232	-1.215	-0.026	0.007	0.350
Top	1624	0.878	6.181	-0.226	-0.043	-0.345	-0.008	0.003	0.182
21 Exterior Wall	20011	-0.512	-1.066	0.964	1.452	5.558	-0.070	0.112	2.751
@ EL-11.50	20023	0.146	-0.892	-1.069	-0.799	1.249	0.157	1.180	0.822
~-10.50m	30010	1.188	1.837	-3.871	0.447	2.431	-0.047	-0.047	-0.675
	30020	0.106	2.162	-0.478	0.057	1.102	0.015	-0.290	-0.250
	40001	0.368	1.941	-0.759	-0.170	0.567	-0.075	0.005	-0.162
	40011	3.316	3.611	-0.077	0.120	1.040	0.010	0.003	-0.191
22 Exterior Wall	22011	-0.376	-6.628	2.328	0.102	0.902	0.147	-0.031	0.818
@ EL-4.65	22023	-0.012	-4.348	-1.292	-0.263	0.155	-0.135	0.325	0.120
~-6.60m	32010	-0.882	1.251	-4.092	-0.010	-0.012	-0.003	-0.001	-0.103
	32020	-0.043	3.041	-1.627	0.150	0.029	0.005	0.127	-0.005
	42001	0.119	3.230	-1.627	0.200	-0.013	-0.015	-0.074	-0.006
	42011	0.725	3.106	0.252	0.005	-0.066	0.009	0.000	0.083
23 Exterior Wall	24211	-0.997	-4.957	0.239	-0.188	-0.707	-0.045	0.002	0.879
@ EL22.50	24224	-0.236	-6.918	0.356	0.662	0.954	-0.281	0.148	1.032
~24.60m	34210	-1.180	0.230	-3.572	-0.029	-0.186	-0.009	0.011	-0.087
	34220	-0.063	1.557	-1.273	-0.005	0.005	0.001	0.002	-0.008
	44201	-0.115	1.861	-1.070	0.020	0.037	-0.013	0.025	-0.016
24 Basemat	90140	0.225	1.227	-1.955	-7.003	-0.836	-0.227	-2.968	1.213
@ Wall	90182	3.258	0.671	-1.457	-1.578	-0.618	1.400	-1.589	0.692
Below RCCV	90111	1.123	5.945	-0.260	0.284	-1.147	0.352	-1.960	-0.122
25 Slab	93140	-2.210	0.336	-0.123	-0.395	-0.241	0.172	-0.091	0.120
EL4.65m	93182	-0.562	-0.143	-0.464	-0.087	-0.334	-0.010	0.019	0.309
@ RCCV	93111	-0.075	-0.104	0.020	0.080	0.000	0.008	-0.054	0.002
26 Slab	96144	-0.484	0.162	0.142	-0.313	-0.250	0.168	-0.065	0.076
EL17.5m	96186	-0.592	-0.131	-0.041	-0.074	-0.339	-0.010	0.025	0.271
@ RCCV	96113	0.214	-1.016	-0.015	0.456	-0.039	-0.008	-0.426	-0.064
27 Slab	98472	1.002	-0.251	-0.205	-0.188	-0.233	0.105	-0.090	0.122
EL27.0m	98514	-0.239	-0.147	-0.193	-0.069	-0.240	0.005	0.008	0.256
@ RCCV	98424	0.935	-1.153	0.103	0.127	-0.148	0.099	1.044	0.050
28 Pool Girder	123054	-0.161	1.563	-0.510	-0.070	-0.003	0.024	-0.010	0.023
@ Storage Pool	123154	-1.233	0.501	-0.406	-0.103	-0.035	0.015	-0.033	0.003
29 Pool Girder	123062	-0.152	-0.112	0.300	-0.072	-0.019	-0.024	0.025	0.017
@ Cavity	123162	-0.923	-0.130	0.184	-0.152	-0.036	-0.019	0.056	0.002
30 Pool Girder	123067	-0.644	1.895	0.900	0.094	0.043	0.024	0.036	0.040
@ Fuel Pool	123167	-1.125	0.351	1.205	0.031	0.033	0.004	0.006	0.003
31 MS Tunnel	150122	-0.011	0.177	-0.048	-0.038	-0.144	-0.009	0.008	-0.030
Wall and Slab	96611	0.034	-0.291	0.032	-0.098	-0.390	-0.021	0.042	0.016
	98614	0.043	-0.218	0.034	0.124	0.444	0.050	-0.039	-0.018

Table 3G.1-20

Results of NASTRAN Analysis, Seismic Load (Horizontal: East to West Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	3.619	7.901	-1.996	-0.849	-4.472	-0.071	0.270	-1.900
Pedestal	5013	5.109	12.272	0.228	-1.290	-6.832	-0.010	0.019	-3.065
Bottom	5024	0.410	0.732	3.303	-0.102	-0.451	0.017	-0.296	-0.197
2 RPV	6006	-0.516	4.034	-2.798	0.015	0.148	-0.181	-0.003	-0.069
Pedestal	6013	-0.993	6.128	0.364	0.228	0.113	-0.037	0.000	-0.218
Mid-Height	6024	-0.166	1.388	5.021	0.017	0.037	0.335	0.177	0.035
3 RPV	6606	-0.943	2.275	-2.277	0.229	1.650	0.166	-0.115	-0.730
Pedestal	6613	-0.781	3.355	0.060	0.555	2.494	-0.059	-0.144	-1.078
Top	6624	-0.105	0.242	3.332	0.039	0.167	-0.210	0.271	-0.086
4 RCCV	1806	0.712	5.471	-4.584	-0.208	-1.031	-0.020	0.000	-0.390
Wetwell	1813	1.099	7.041	0.944	-0.272	-1.620	-0.014	0.005	-0.662
Bottom	1824	0.050	0.540	7.271	-0.030	-0.115	0.089	-0.054	-0.058
5 RCCV	2606	0.057	3.854	-4.126	0.016	0.080	-0.051	-0.010	-0.106
Wetwell	2613	0.047	5.263	0.953	0.047	0.137	-0.018	-0.009	-0.248
Mid-Height	2624	0.046	0.286	6.675	0.010	0.038	0.110	0.036	-0.014
6 RCCV	3406	-0.400	2.524	-3.901	0.040	0.164	-0.195	0.169	-0.105
Wetwell	3413	-0.306	3.941	0.989	0.062	0.355	0.040	-0.073	-0.249
Top	3424	-0.181	0.192	5.779	0.027	0.036	0.019	0.008	-0.005
7 RCCV	3606	-0.456	2.346	-3.563	-0.046	-0.348	-0.054	0.165	-0.141
Drywell	3613	-0.308	4.114	1.141	-0.137	-0.791	-0.005	-0.061	-0.289
Bottom	3624	-0.122	0.244	5.540	-0.030	-0.089	0.021	0.023	-0.042
8 RCCV	4006	-0.964	1.376	-3.270	0.013	0.141	-0.094	0.037	-0.114
Drywell	4013	-1.100	3.208	0.978	0.060	0.305	0.005	-0.049	-0.319
Mid-Height	4976	0.128	0.107	5.745	0.044	0.036	0.022	0.038	-0.014
9 RCCV	4406	-1.376	0.549	-2.744	0.128	0.524	-0.010	0.004	-0.226
Drywell	4413	-0.918	2.449	0.849	0.026	0.943	0.165	0.052	-0.019
Top	4424	0.263	0.047	6.065	0.046	-0.005	-0.003	0.040	0.029
10 Basemat	80003	0.038	0.223	1.347	0.305	0.542	-0.514	0.018	0.897
@ Center	80007	0.573	-0.211	0.796	0.709	0.790	-0.262	-0.006	0.862
	80012	-0.120	0.176	0.666	0.115	0.115	0.122	-0.008	0.900
11 Basemat	80206	1.779	-0.230	2.679	3.698	4.686	-2.110	-0.626	1.546
Inside	80213	2.987	-0.462	0.727	4.768	7.922	-0.214	0.021	2.209
RPV Pedestal	80224	0.147	0.114	-1.880	0.484	0.394	1.018	0.080	0.432
12 S/P Slab	83306	-0.493	-0.422	0.892	1.324	0.614	-0.365	0.518	0.182
@ RPV	83313	-0.972	-0.307	0.265	1.940	0.952	0.057	0.747	-0.005
	83324	-0.058	-0.047	-1.474	0.134	0.059	0.519	0.051	-0.251
13 S/P Slab	83406	-0.360	-0.133	0.349	-0.242	0.242	-0.260	0.338	0.008
@ Center	83413	-1.017	-0.152	0.191	-0.305	0.399	0.036	0.490	0.001
	83424	-0.070	-0.035	-0.750	-0.021	0.021	0.360	0.034	0.005
14 S/P Slab	83506	-0.145	-0.183	0.082	-1.213	-0.197	-0.032	0.273	-0.057
@ RCCV	83513	-0.917	-0.245	0.143	-1.685	-0.241	0.013	0.385	0.006
	83524	-0.040	-0.061	-0.420	-0.124	-0.023	0.009	0.029	0.092
15 Topslab	98120	-1.127	-0.929	-0.811	-0.056	-0.437	-0.148	-0.111	-0.105
@ Drywell Head	98135	0.030	0.279	-0.487	-0.182	-0.215	0.083	0.029	-0.102
Opening	98104	0.347	0.488	-0.530	-0.010	-0.417	-0.023	0.037	-0.352
16 Topslab	98149	-1.027	-0.287	-0.558	-0.032	-0.226	-0.014	0.056	0.021
@ Center	98170	-1.067	0.053	-0.811	-0.018	-0.041	-0.012	0.022	-0.024
	98109	0.103	-0.009	-0.648	-0.025	-0.205	-0.121	0.002	-0.119
17 Topslab	98174	-1.558	-0.285	-0.734	-0.272	-0.273	0.089	0.119	-0.127
@ RCCV	98197	-1.467	-0.076	-0.703	-0.029	-0.309	-0.031	-0.036	-0.004
	98103	-0.205	0.204	-1.155	-0.035	-0.053	-0.209	0.040	-0.046

Table 3G.1-20

Results of NASTRAN Analysis, Seismic Load (Horizontal: East to West Direction) (Continued)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall	6	4.233	10.965	-4.292	-0.722	-3.492	-0.050	0.149	-1.466
Below RCCV	13	4.825	10.405	0.411	-0.322	-2.045	-0.014	0.031	-1.063
Bottom	24	0.620	0.744	6.330	0.012	-0.156	0.097	-0.142	-0.100
19 Wall	806	0.709	8.375	-5.149	-0.027	0.177	-0.138	-0.023	0.007
Below RCCV	813	2.014	9.099	0.735	0.003	0.271	-0.015	-0.012	-0.119
Mid-Height	824	0.182	0.748	7.529	0.025	0.045	0.096	0.050	0.019
20 Wall	1606	0.575	5.838	-5.328	0.080	0.661	-0.014	-0.018	-0.148
Below RCCV	1613	0.955	7.092	0.918	0.184	1.109	-0.006	0.009	-0.240
Top	1624	0.049	0.603	7.470	-0.009	0.017	0.051	-0.040	0.018
21 Exterior Wall	20011	-0.564	-1.392	-9.721	-0.075	0.353	-0.043	0.146	0.140
@ EL-11.50	20023	-0.001	5.315	-0.104	0.230	0.272	-0.071	-0.017	0.073
~-10.50m	30010	3.433	4.595	1.613	-0.245	-0.714	-0.024	-0.053	0.238
	30020	0.484	3.247	1.307	-0.086	0.523	0.039	0.023	-0.160
	40001	-0.010	3.553	0.797	0.338	1.289	0.004	0.411	-0.235
	40011	-0.266	-0.415	4.311	0.014	-0.081	0.083	0.119	-0.014
22 Exterior Wall	22011	0.539	3.319	-6.600	0.042	-0.014	-0.018	0.032	0.006
@ EL-4.65	22023	0.113	5.590	-3.162	0.088	-0.083	0.066	-0.177	-0.075
~-6.60m	32010	0.672	4.353	1.027	-0.012	-0.086	-0.013	0.000	0.204
	32020	0.056	3.984	2.778	0.123	-0.061	0.010	0.091	0.017
	42001	-0.010	3.742	2.914	0.166	0.068	-0.011	-0.064	-0.030
	42011	0.192	-0.627	5.808	0.041	0.003	0.018	0.036	-0.014
23 Exterior Wall	24211	0.053	0.269	-5.636	-0.006	0.032	0.014	0.006	0.033
@ EL22.50	24224	0.330	5.457	-4.142	-0.306	-0.138	-0.007	0.293	-0.060
~24.60m	34210	-0.158	1.713	0.814	0.068	0.380	-0.007	-0.004	0.144
	34220	-0.136	1.761	2.503	0.147	0.144	0.006	0.041	-0.017
	44201	0.125	1.808	3.005	0.096	0.015	0.058	-0.091	0.023
24 Basemat	90140	0.196	4.886	3.019	0.180	3.227	-2.914	3.394	-5.502
@ Wall	90182	5.515	0.685	0.434	0.172	-0.757	-0.215	-0.079	-3.641
Below RCCV	90111	-0.237	0.778	-0.620	-0.499	0.380	1.210	-0.063	-2.796
25 Slab	93140	0.740	-0.260	-0.201	0.173	0.132	-0.099	0.050	-0.041
EL4.65m	93182	-0.084	-0.021	-0.148	0.083	0.458	0.014	-0.022	-0.413
@ RCCV	93111	0.141	0.032	-0.216	0.000	-0.009	-0.025	0.011	0.004
26 Slab	96144	-0.135	-0.266	-0.205	0.151	0.125	-0.097	0.048	-0.018
EL17.5m	96186	-0.434	0.196	-0.261	0.112	0.624	0.022	-0.033	-0.498
@ RCCV	96113	0.084	-0.188	0.581	0.078	0.029	0.003	-0.024	0.039
27 Slab	98472	0.134	-0.988	-0.434	-0.013	-0.032	0.005	-0.041	0.047
EL27.0m	98514	-0.426	0.174	-0.383	0.063	0.484	-0.007	-0.011	-0.325
@ RCCV	98424	0.236	-0.165	-5.772	0.064	0.050	-0.180	0.048	0.098
28 Pool Girder	123054	0.346	0.142	0.151	0.329	0.157	-0.068	0.025	0.209
@ Storage Pool	123154	-0.375	0.352	0.698	0.191	-0.067	-0.089	0.037	-0.008
29 Pool Girder	123062	-0.434	0.924	0.205	0.076	0.040	-0.040	-0.059	0.058
@ Cavity	123162	-0.560	0.907	0.222	0.102	-0.017	0.008	-0.115	-0.018
30 Pool Girder	123067	0.073	0.122	0.288	0.162	0.145	0.059	0.023	0.256
@ Fuel Pool	123167	-0.405	0.441	-0.305	0.042	-0.117	0.066	-0.051	-0.018
31 MS Tunnel	150122	-0.002	0.117	-0.022	-0.031	-0.114	-0.044	0.008	0.254
Wall and Slab	96611	0.034	-0.078	-0.059	-0.013	-0.065	0.102	-0.004	-0.075
	98614	0.016	0.007	-0.009	0.034	0.114	0.346	-0.032	-0.021

Table 3G.1-21

Results of NASTRAN Analysis, Seismic Load (Vertical: Upward Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	-1.345	2.103	-0.142	0.415	2.396	-0.007	0.016	1.001
Pedestal	5013	-1.093	2.640	-0.205	0.361	2.148	0.000	0.011	0.870
Bottom	5024	-0.809	2.853	-0.014	0.334	1.966	-0.008	-0.003	0.791
2 RPV	6006	0.148	2.127	-0.204	-0.015	-0.066	-0.022	-0.020	0.014
Pedestal	6013	0.166	2.267	-0.308	0.018	-0.024	-0.009	0.013	-0.025
Mid-Height	6024	0.050	1.699	0.177	-0.004	0.032	-0.006	-0.014	-0.053
3 RPV	6606	0.340	1.738	-0.317	-0.388	-2.605	-0.100	-0.083	0.872
Pedestal	6613	0.364	1.780	-0.164	-0.345	-2.530	0.118	0.054	0.844
Top	6624	0.262	1.713	-0.051	-0.364	-2.531	-0.122	-0.050	0.831
4 RCCV	1806	0.411	4.305	-0.145	0.086	0.579	-0.010	0.000	0.124
Wetwell	1813	0.526	4.230	-0.135	0.092	0.505	-0.004	0.000	0.093
Bottom	1824	0.435	4.683	0.049	0.092	0.546	-0.002	0.003	0.111
5 RCCV	2606	0.220	3.890	-0.198	-0.003	0.025	-0.007	0.000	0.093
Wetwell	2613	0.257	3.949	-0.137	0.023	0.051	-0.002	0.001	0.069
Mid-Height	2624	0.283	4.302	0.008	-0.001	0.004	-0.002	0.001	0.100
6 RCCV	3406	0.300	3.275	-0.281	-0.098	-0.605	0.063	-0.097	0.217
Wetwell	3413	0.082	3.767	-0.143	-0.036	-0.290	-0.033	0.040	0.112
Top	3424	0.163	3.711	-0.005	-0.045	-0.310	0.068	-0.075	0.088
7 RCCV	3606	0.145	3.079	-0.156	0.015	-0.027	0.058	-0.076	-0.104
Drywell	3613	-0.085	3.710	-0.179	0.015	0.042	-0.050	0.023	-0.136
Bottom	3624	0.100	3.861	-0.050	0.000	-0.055	0.070	-0.040	-0.076
8 RCCV	4006	-0.475	2.621	-0.082	0.173	0.558	0.047	-0.008	-0.247
Drywell	4013	-0.520	3.947	-0.244	0.053	0.440	0.001	0.007	-0.087
Mid-Height	4976	-0.013	3.207	-0.184	0.019	0.202	0.005	0.007	-0.055
9 RCCV	4406	-0.487	2.126	0.200	0.310	1.746	0.030	0.014	-0.374
Drywell	4413	0.508	4.138	-0.095	0.163	0.891	-0.006	0.007	-0.163
Top	4424	0.015	2.545	-0.148	0.030	0.339	-0.004	-0.001	-0.039
10 Basemat	80003	1.110	1.331	-0.056	-7.799	-8.005	0.028	-0.247	0.194
@ Center	80007	1.132	1.351	-0.047	-7.810	-8.003	0.027	0.036	0.313
	80012	1.129	1.387	-0.047	-7.807	-8.000	0.026	0.303	0.044
11 Basemat	80206	1.057	1.206	-0.090	-5.055	-5.495	-0.898	-1.046	0.926
Inside	80213	1.134	1.393	-0.134	-5.967	-4.328	0.102	0.047	1.428
RPV Pedestal	80224	1.230	1.557	-0.051	-4.333	-6.041	0.156	1.375	0.112
12 S/P Slab	83306	-0.129	-0.373	0.192	-1.917	-1.346	0.009	-1.085	0.025
@ RPV	83313	-0.284	-0.266	0.051	-1.928	-1.341	-0.009	-1.090	-0.024
	83324	-0.256	-0.391	0.019	-1.925	-1.341	0.015	-1.089	0.023
13 S/P Slab	83406	-0.187	-0.348	0.142	0.901	-0.610	0.001	-0.486	0.000
@ Center	83413	-0.380	-0.198	0.016	0.891	-0.590	0.001	-0.490	-0.002
	83424	-0.327	-0.343	0.005	0.897	-0.590	0.002	-0.491	0.001
14 S/P Slab	83506	-0.183	-0.303	0.139	1.509	-0.005	0.009	-0.061	-0.005
@ RCCV	83513	-0.395	-0.180	-0.010	1.525	0.016	0.003	-0.070	-0.003
	83524	-0.326	-0.339	0.001	1.536	0.015	0.001	-0.070	0.001
15 Topslab	98120	-1.049	-0.279	-0.390	0.418	0.251	0.276	-0.051	-0.286
@ Drywell Head	98135	-2.538	-0.166	0.136	0.662	-0.249	-0.110	0.072	-0.336
Opening	98104	-0.044	-0.600	0.042	0.204	1.305	-0.272	-0.011	-0.257
16 Topslab	98149	-1.573	0.293	-0.499	0.768	0.364	-0.128	0.039	0.289
@ Center	98170	-1.210	0.089	-0.101	0.785	0.972	-0.053	-0.003	0.014
	98109	-0.064	-0.446	-0.020	0.667	0.868	-0.147	-0.090	-0.060
17 Topslab	98174	-0.712	0.087	-0.213	0.774	0.772	0.157	0.163	-0.060
@ RCCV	98197	-0.153	0.023	0.169	0.425	-1.039	-0.134	-0.048	-0.662
	98103	0.196	-0.283	-0.064	-1.812	-0.296	-0.205	-0.905	-0.109

Table 3G.1-21

Results of NASTRAN Analysis, Seismic Load (Vertical: Upward Direction) (Continued)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall	6	-0.369	6.045	-0.433	0.327	2.162	-0.011	0.033	0.697
Below RCCV	13	-0.498	4.718	-0.323	0.569	3.088	-0.003	0.004	0.952
Bottom	24	-0.464	5.193	0.150	0.595	3.234	-0.005	0.001	0.976
19 Wall	806	-0.057	5.223	-0.089	-0.016	0.030	0.023	-0.007	0.122
Below RCCV	813	0.110	4.678	-0.266	0.023	0.034	0.009	0.017	0.211
Mid-Height	824	0.060	5.154	0.138	0.028	-0.004	0.006	-0.001	0.220
20 Wall	1606	0.592	4.611	-0.068	-0.168	-0.903	-0.009	0.004	0.312
Below RCCV	1613	0.717	4.487	-0.182	-0.163	-0.990	-0.005	0.000	0.358
Top	1624	0.624	4.934	0.094	-0.163	-0.963	0.000	0.005	0.341
21 Exterior Wall	20011	0.492	3.325	0.340	0.048	0.031	0.019	-0.049	-0.032
@ EL-11.50	20023	0.002	1.060	0.425	-0.108	0.221	0.007	0.092	0.139
~-10.50m	30010	0.228	1.737	0.025	0.322	1.788	-0.022	-0.014	-0.417
	30020	0.047	0.816	0.159	-0.174	0.513	0.054	-0.113	-0.174
	40001	0.049	0.841	-0.148	-0.182	0.520	-0.053	0.112	-0.169
	40011	0.328	2.098	0.008	0.394	2.089	0.010	0.001	-0.500
22 Exterior Wall	22011	-0.178	2.690	-0.603	0.011	-0.021	0.002	0.022	-0.021
@ EL-4.65	22023	-0.004	1.365	0.331	0.115	0.002	0.013	-0.073	-0.012
~-6.60m	32010	0.012	1.478	-0.046	-0.001	-0.033	-0.002	0.000	0.007
	32020	0.040	1.566	0.054	0.052	0.002	0.007	0.047	0.007
	42001	0.049	1.628	0.032	0.067	0.004	-0.002	-0.034	0.002
	42011	0.251	1.839	0.087	0.001	-0.025	0.003	-0.002	0.004
23 Exterior Wall	24211	0.133	1.429	-0.116	0.085	0.587	-0.013	0.004	0.143
@ EL22.50	24224	0.047	1.075	-0.329	-0.021	0.047	0.060	0.054	0.030
~24.60m	34210	0.008	0.651	-0.050	-0.005	0.004	-0.001	-0.004	-0.013
	34220	-0.039	0.802	0.142	-0.038	0.021	0.004	-0.032	0.000
	44201	-0.023	0.949	0.280	-0.032	0.012	-0.013	0.037	0.001
24 Basemat	90140	-0.090	0.743	0.430	1.673	1.226	-2.811	1.354	-1.582
@ Wall	90182	0.637	0.337	0.029	-0.857	1.734	0.351	-0.170	-0.448
Below RCCV	90111	0.384	0.879	-0.046	1.649	-0.996	0.430	-0.499	-0.097
25 Slab	93140	0.063	-0.102	-0.056	-0.091	-0.107	0.070	-0.132	0.109
EL4.65m	93182	-0.101	-0.089	-0.021	-0.034	-0.118	-0.007	0.009	0.174
@ RCCV	93111	-0.058	-0.120	0.023	-0.136	-0.034	-0.005	0.160	0.003
26 Slab	96144	0.239	-0.170	-0.124	-0.056	-0.058	0.040	-0.097	0.074
EL17.5m	96186	-0.239	0.093	0.038	-0.003	-0.002	-0.005	0.006	0.052
@ RCCV	96113	0.067	-0.427	0.079	0.132	-0.032	-0.016	-0.157	-0.020
27 Slab	98472	-0.341	0.011	-0.110	-0.186	-0.285	0.206	-0.230	0.258
EL27.0m	98514	0.034	-0.088	-0.059	-0.037	-0.115	-0.024	0.000	0.171
@ RCCV	98424	0.218	-0.319	-0.008	-0.719	-0.214	0.047	1.004	0.064
28 Pool Girder	123054	-0.418	2.390	0.732	-0.048	-0.028	-0.052	0.007	0.024
@ Storage Pool	123154	-1.388	0.436	0.560	-0.072	-0.034	-0.096	-0.022	-0.007
29 Pool Girder	123062	-0.465	-0.598	-0.336	0.024	0.163	-0.031	0.000	0.087
@ Cavity	123162	1.265	-0.170	-0.200	0.073	0.059	-0.027	-0.090	-0.039
30 Pool Girder	123067	-0.503	2.667	-1.237	-0.015	0.047	0.078	0.118	0.054
@ Fuel Pool	123167	-0.679	0.641	-1.015	-0.040	-0.022	-0.011	0.032	-0.008
31 MS Tunnel	150122	0.026	-0.083	-0.250	-0.017	-0.020	-0.016	0.010	0.049
Wall and Slab	96611	0.014	-0.303	0.015	-0.044	0.161	0.065	0.071	-0.022
	98614	0.016	0.219	0.015	0.003	0.460	0.054	0.039	-0.029

Table 3G.1-22

Combined Forces and Moments: RCCV, Selected Load Combination CV-1

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV Pedestal Bottom	5006	OTHR	-2.179	-7.664	-0.044	0.372	2.180	0.033	-0.011	1.260
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	5013	OTHR	-2.702	-8.067	0.048	0.310	2.378	-0.003	-0.005	1.446
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	5024	OTHR	-2.542	-7.478	0.051	0.482	2.127	-0.010	0.011	1.240
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
2 RPV Pedestal Mid-Height	6006	OTHR	1.178	-7.401	0.008	-0.051	-0.211	0.024	0.075	-0.347
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	6013	OTHR	0.890	-7.369	0.188	-0.205	-0.269	0.004	-0.002	-0.329
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	6024	OTHR	1.233	-5.428	-0.513	0.296	0.070	0.015	-0.008	-0.265
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
3 RPV Pedestal Top	6606	OTHR	0.578	-6.185	0.793	0.431	2.798	0.035	0.233	-0.992
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	6613	OTHR	0.262	-6.369	-0.098	0.291	2.824	-0.105	-0.093	-1.045
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	6624	OTHR	0.816	-6.021	0.318	0.407	2.485	0.144	0.061	-0.803
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
4 RCCV Wetwell Bottom	1806	OTHR	0.294	-1.968	-0.043	0.371	2.210	0.018	0.011	0.785
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1813	OTHR	0.100	-2.364	0.195	0.364	2.331	-0.001	-0.003	0.895
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1824	OTHR	0.537	-2.271	0.002	0.363	2.112	0.008	-0.005	0.824
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
5 RCCV Wetwell Mid-Height	2606	OTHR	2.620	-1.497	-0.092	-0.167	-0.662	-0.001	0.008	-0.046
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	2613	OTHR	2.292	-2.136	0.184	-0.192	-0.683	0.000	-0.007	0.013
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	2624	OTHR	2.619	-1.806	-0.015	-0.120	-0.694	-0.003	0.004	-0.082
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
6 RCCV Wetwell Top	3406	OTHR	2.444	-0.818	0.117	-0.070	-0.222	0.069	-0.031	-0.014
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	3413	OTHR	2.125	-1.980	0.135	-0.107	-0.259	-0.095	0.048	0.018
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	3424	OTHR	2.106	-1.152	0.048	0.023	0.078	0.059	-0.019	-0.054
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
7 RCCV Drywell Bottom	3606	OTHR	2.397	-0.272	0.027	-0.020	0.093	0.100	0.003	0.496
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	3613	OTHR	2.138	-1.511	0.222	-0.001	0.364	-0.080	0.001	0.698
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	3624	OTHR	2.089	-0.761	0.040	0.112	0.559	0.059	0.011	0.563
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
8 RCCV Drywell Mid-Height	4006	OTHR	1.606	0.170	0.101	-0.086	-0.271	0.024	0.033	-0.282
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4013	OTHR	1.637	-1.776	0.362	-0.132	-0.408	0.009	-0.010	-0.271
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4976	OTHR	1.629	-0.340	-0.007	0.037	-0.016	0.001	-0.013	-0.375
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
9 RCCV Drywell Top	4406	OTHR	0.583	0.552	0.151	0.331	1.982	0.002	0.010	-0.641
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4413	OTHR	-0.112	-2.054	0.252	0.270	2.156	0.046	0.005	-0.797
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4424	OTHR	1.198	-0.078	-0.023	0.427	2.309	0.024	0.003	-0.714
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000

OTHR: Loads other than thermal loads
TEMP: Thermal loads

Table 3G.1-22

Combined Forces and Moments: RCCV, Selected Load Combination CV-1 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
10 Basemat @ Center	80003	OTHR	-2.855	-1.584	0.149	-0.654	-0.071	-0.045	0.163	-0.110
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	80007	OTHR	-2.881	-1.591	0.133	-0.578	-0.049	-0.028	0.005	-0.179
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	80012	OTHR	-2.933	-1.579	0.135	-0.572	-0.046	-0.031	-0.151	-0.018
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
11 Basemat Inside RPV Pedestal	80206	OTHR	-2.522	-1.736	0.229	-2.544	-2.331	0.704	0.961	-1.141
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	80213	OTHR	-2.623	-1.585	0.088	-1.661	-3.097	-0.111	-0.079	-1.522
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	80224	OTHR	-3.106	-1.997	0.060	-2.752	-1.746	-0.161	-1.211	-0.143
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
12 S/P Slab @ RPV	83306	OTHR	0.000	1.180	-0.424	-0.272	0.607	-0.065	1.932	-0.038
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	83313	OTHR	0.198	0.925	-0.089	-0.214	0.621	0.041	1.945	0.051
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	83324	OTHR	0.228	1.415	0.052	-0.307	0.573	-0.038	1.893	-0.055
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
13 S/P Slab @ Center	83406	OTHR	0.249	0.879	-0.317	-2.852	-0.673	-0.030	-0.134	0.003
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	83413	OTHR	0.577	0.668	-0.017	-2.824	-0.680	-0.004	-0.125	0.002
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	83424	OTHR	0.416	1.101	0.029	-2.793	-0.672	0.005	-0.155	0.000
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
14 S/P Slab @ RCCV	83506	OTHR	0.380	0.724	-0.243	1.283	-0.178	-0.026	-1.744	0.000
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	83513	OTHR	0.745	0.609	0.005	1.267	-0.185	-0.005	-1.734	0.002
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	83524	OTHR	0.481	0.995	0.030	1.391	-0.133	-0.001	-1.763	0.001
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
15 Topslab @ Drywell Head Opening	98120	OTHR	0.089	0.956	1.143	0.925	0.713	0.387	0.410	-0.808
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	98135	OTHR	-0.763	-0.415	-0.496	0.767	-0.198	0.170	0.167	-1.200
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	98104	OTHR	-0.244	2.457	-0.771	0.811	2.636	-0.298	-0.482	-0.707
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
16 Topslab @ Center	98149	OTHR	-0.094	1.438	-0.475	0.346	0.112	0.267	0.077	0.368
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	98170	OTHR	0.007	0.882	-0.384	0.610	0.623	-0.030	-0.054	-0.128
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	98109	OTHR	0.356	1.560	-0.142	0.993	1.907	-0.220	-0.050	-0.266
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
17 Topslab @ RCCV	98174	OTHR	0.674	1.192	-0.120	0.082	0.272	0.472	0.200	-0.196
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	98197	OTHR	0.314	1.223	-0.231	-0.172	-1.587	-0.120	-0.070	-1.106
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	98103	OTHR	0.666	1.694	-0.091	-0.975	0.421	-0.330	-0.897	-0.215
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000

Table 3G.1-23

Combined Forces and Moments: RCCV, Selected Load Combination CV-7a

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	OTHR	-4.997	-15.433	0.146	0.966	5.792	0.057	-0.038	2.910
Pedestal		TEMP	-3.477	1.650	-0.339	-6.696	-6.473	-0.045	0.110	1.009
Bottom	5013	OTHR	-5.695	-15.636	0.756	0.953	6.170	-0.001	-0.016	3.247
		TEMP	-3.130	1.794	-0.083	-6.863	-6.856	-0.006	0.023	0.926
	5024	OTHR	-5.245	-12.621	0.320	1.038	5.276	-0.026	0.041	2.770
		TEMP	-3.394	1.906	-0.001	-6.891	-6.143	-0.027	-0.034	1.037
2 RPV	6006	OTHR	1.143	-15.990	0.409	-0.131	-0.390	0.066	0.134	-0.464
Pedestal		TEMP	0.067	1.755	0.162	-6.160	-4.019	0.265	0.075	-1.529
Mid-Height	6013	OTHR	0.669	-14.859	0.837	-0.349	-0.594	0.000	-0.019	-0.414
		TEMP	-0.091	1.447	-0.178	-6.439	-3.908	-0.057	-0.026	-1.669
	6024	OTHR	0.896	-8.921	-0.774	0.252	-0.406	-0.013	0.012	-0.255
		TEMP	-0.234	2.057	0.062	-7.399	-2.300	-0.303	-0.003	-1.551
3 RPV	6606	OTHR	0.753	-13.627	2.136	0.755	5.501	0.171	0.209	-2.190
Pedestal		TEMP	21.003	2.199	0.571	-6.642	-5.535	-0.046	-1.920	0.884
Top	6613	OTHR	0.298	-13.017	0.087	0.607	5.825	-0.032	-0.096	-2.209
		TEMP	21.062	1.960	-0.446	-6.709	-5.541	0.140	2.058	0.853
	6624	OTHR	0.323	-10.654	0.635	1.109	6.680	0.229	0.601	-2.027
		TEMP	21.918	2.602	0.224	-6.666	-5.662	0.008	-2.345	1.058
4 RCCV	1806	OTHR	1.448	-1.190	-0.074	1.096	6.653	0.005	0.021	2.550
Wetwell		TEMP	2.538	0.393	-0.222	-4.442	-8.116	0.066	0.081	-1.726
Bottom	1813	OTHR	1.266	-1.364	-0.164	1.093	6.730	-0.007	-0.005	2.732
		TEMP	1.857	-2.167	-0.444	-4.275	-7.777	-0.024	-0.007	-1.526
	1824	OTHR	1.469	-1.109	-0.551	1.095	6.518	0.025	-0.016	2.684
		TEMP	2.938	-2.477	0.048	-4.432	-8.139	0.019	-0.085	-1.670
5 RCCV	2606	OTHR	4.319	-0.795	-0.215	-0.256	-0.743	-0.027	0.014	-0.277
Wetwell		TEMP	1.389	0.550	-0.146	-3.335	-1.060	0.021	0.034	0.043
Mid-Height	2613	OTHR	3.841	-1.179	-0.316	-0.262	-0.949	-0.031	-0.007	-0.143
		TEMP	0.113	-2.558	-0.121	-3.089	-1.048	0.009	-0.074	0.369
	2624	OTHR	4.100	-0.699	-0.535	-0.233	-1.105	-0.005	0.016	-0.311
		TEMP	0.970	-2.907	-0.086	-3.292	-0.934	-0.026	0.067	0.189
6 RCCV	3406	OTHR	4.082	0.019	0.209	-0.305	-1.079	0.209	-0.309	0.509
Wetwell		TEMP	11.700	1.428	0.353	-4.152	-8.450	-0.228	0.462	3.344
Top	3413	OTHR	3.034	-1.039	-0.335	-0.121	-0.562	-0.239	0.203	0.315
		TEMP	8.031	-3.446	0.040	-4.382	-9.149	-0.403	0.539	3.335
	3424	OTHR	2.410	-0.191	-0.397	-0.004	-0.168	0.053	-0.004	0.105
		TEMP	10.294	-4.168	0.471	-3.680	-5.044	-0.038	-0.007	2.165
7 RCCV	3606	OTHR	4.105	0.816	0.001	-0.090	0.033	0.099	-0.279	0.786
Drywell		TEMP	8.481	1.351	0.705	-5.341	-9.025	0.605	0.535	-1.974
Bottom	3613	OTHR	2.952	-0.671	-0.024	0.153	0.956	-0.051	0.124	0.822
		TEMP	4.607	-4.166	1.002	-4.955	-6.228	-0.363	0.318	-0.820
	3624	OTHR	2.204	0.029	-0.407	0.255	1.240	0.151	0.052	0.787
		TEMP	-4.289	-6.045	0.252	-0.934	-2.499	0.068	-0.001	0.350
8 RCCV	4006	OTHR	3.178	1.121	0.031	0.008	-0.710	0.081	-0.195	-0.480
Drywell		TEMP	5.934	2.176	0.228	-5.109	-5.059	0.011	-0.128	-0.683
Mid-Height	4013	OTHR	2.588	-0.629	0.258	-0.055	-0.362	0.092	0.077	-0.102
		TEMP	4.288	-5.853	1.039	-4.672	-4.288	0.013	-0.132	-0.308
	4976	OTHR	1.664	0.350	-0.384	0.055	-0.031	-0.009	-0.011	-0.281
		TEMP	-2.657	-5.340	0.578	-0.953	-1.777	0.004	0.013	-0.585
9 RCCV	4406	OTHR	1.049	1.126	0.157	0.520	2.827	0.080	0.014	-1.054
Drywell		TEMP	6.443	1.716	-0.228	-4.470	-3.808	0.301	0.088	-0.153
Top	4413	OTHR	0.830	-0.623	0.610	0.335	1.895	-0.163	0.179	-1.044
		TEMP	0.718	-6.633	-0.295	-4.753	-4.468	0.253	-0.244	0.644
	4424	OTHR	1.194	0.480	-0.292	0.396	2.116	0.021	-0.002	-0.659
		TEMP	-5.839	-4.178	0.764	-0.362	1.133	-0.024	-0.022	-1.462

Table 3G.1-23

Combined Forces and Moments: RCCV, Selected Load Combination CV-7a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
10 Basemat @ Center	80003	OTHR	-1.028	0.072	-0.012	-7.398	-6.258	0.058	0.524	-0.457
		TEMP	-4.361	-5.064	0.010	-8.115	-8.087	-0.031	0.030	-0.007
	80007	OTHR	-1.082	0.061	-0.012	-7.167	-6.230	0.073	0.237	-0.590
		TEMP	-4.380	-5.029	0.041	-8.081	-8.084	-0.028	0.028	-0.008
	80012	OTHR	-1.154	-0.009	0.030	-6.915	-6.005	-0.063	-0.078	-0.293
		TEMP	-4.384	-4.970	0.030	-8.065	-8.094	-0.024	0.023	0.001
11 Basemat Inside RPV Pedestal	80206	OTHR	-0.477	0.111	0.044	-12.319	-11.359	2.108	2.045	-2.216
		TEMP	-4.366	-5.447	0.114	-8.537	-8.473	0.021	0.002	-0.045
	80213	OTHR	-0.825	0.155	-0.069	-9.763	-13.177	0.625	0.499	-2.890
		TEMP	-4.494	-5.044	0.109	-8.253	-8.556	-0.118	-0.004	-0.108
	80224	OTHR	-1.414	-0.776	0.097	-9.849	-8.673	-0.788	-1.677	-0.677
		TEMP	-4.424	-4.901	0.060	-8.160	-8.192	-0.035	-0.034	0.010
12 S/P Slab @ RPV	83306	OTHR	0.386	2.593	-0.707	-2.409	0.772	-0.142	5.029	-0.082
		TEMP	-10.578	10.974	0.416	-4.708	-2.771	0.029	-0.296	0.000
	83313	OTHR	1.089	2.283	-0.413	-2.228	0.886	-0.091	5.092	0.113
		TEMP	-10.828	11.228	-0.835	-4.734	-2.849	-0.041	-0.301	-0.027
	83324	OTHR	2.117	2.667	-0.326	-1.834	1.173	-0.198	5.256	-0.093
		TEMP	-10.705	11.877	1.291	-4.485	-2.653	0.007	-0.155	0.046
13 S/P Slab @ Center	83406	OTHR	0.833	2.252	-0.598	-8.126	-2.546	-0.052	-0.752	-0.001
		TEMP	-6.461	4.868	-0.561	-3.802	-3.176	-0.003	-0.312	0.014
	83413	OTHR	1.645	2.024	-0.094	-8.128	-2.492	-0.098	-0.709	0.004
		TEMP	-6.987	5.300	0.324	-3.901	-3.259	-0.016	-0.276	-0.011
	83424	OTHR	2.244	2.303	-0.188	-8.155	-2.315	-0.081	-0.628	0.004
		TEMP	-6.636	5.835	0.088	-3.896	-3.148	-0.002	-0.210	0.009
14 S/P Slab @ RCCV	83506	OTHR	1.196	2.056	-0.439	4.713	-0.643	-0.040	-5.268	-0.007
		TEMP	-3.917	2.321	-0.471	-2.874	-3.120	-0.034	-0.284	0.013
	83513	OTHR	1.930	1.988	0.001	4.574	-0.619	-0.034	-5.238	-0.009
		TEMP	-4.564	2.411	0.445	-3.195	-3.177	-0.008	-0.190	-0.001
	83524	OTHR	2.232	2.176	-0.184	4.354	-0.570	-0.026	-5.180	-0.009
		TEMP	-4.044	3.212	-0.010	-3.279	-3.153	0.013	-0.167	-0.005
15 Topslab @ Drywell Head Opening	98120	OTHR	0.489	1.023	1.429	0.936	0.670	0.370	0.441	-0.869
		TEMP	-7.159	-4.295	-0.826	0.963	0.733	2.771	-0.163	-0.005
	98135	OTHR	-0.149	-0.341	-0.626	0.751	-0.265	0.203	0.190	-1.322
		TEMP	-8.776	-5.279	0.213	3.150	-2.057	-1.132	0.380	-0.267
	98104	OTHR	-0.205	2.185	-0.957	0.849	2.666	-0.314	-0.522	-0.859
		TEMP	-4.990	-1.708	0.576	-1.459	3.716	-1.501	0.186	-0.213
16 Topslab @ Center	98149	OTHR	0.554	1.688	-0.513	0.394	0.233	0.240	0.066	0.320
		TEMP	-6.095	-2.564	-1.166	2.235	2.318	0.500	0.036	0.047
	98170	OTHR	0.570	1.385	-0.394	0.660	0.719	-0.014	-0.015	-0.069
		TEMP	-5.522	-3.576	-1.068	2.144	2.867	-0.043	0.030	0.389
	98109	OTHR	0.411	1.391	-0.493	1.087	1.947	-0.282	-0.046	-0.298
		TEMP	-6.255	-0.872	0.768	1.221	2.566	-0.119	0.329	-0.005
17 Topslab @ RCCV	98174	OTHR	1.414	1.552	-0.085	0.094	0.266	0.482	0.270	-0.233
		TEMP	-4.857	-2.720	-0.479	2.355	3.217	0.258	-0.023	0.433
	98197	OTHR	1.303	1.680	-0.053	-0.178	-1.989	-0.102	-0.101	-1.132
		TEMP	-7.582	-2.932	-1.375	1.918	3.109	0.128	0.154	-0.449
	98103	OTHR	0.752	1.539	-0.474	-1.329	0.278	-0.389	-1.076	-0.238
		TEMP	-6.579	-2.446	-0.073	3.434	3.309	0.118	0.451	0.084

Table 3G.1-24

Combined Forces and Moments: RCCV, Selected Load Combination CV-7b

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV	5006	OTHR	-4.650	-14.025	0.107	0.939	5.632	0.054	-0.031	2.814
Pedestal		TEMP	-12.845	0.250	-0.532	-16.012	-12.643	-0.092	0.231	4.151
Bottom	5013	OTHR	-5.293	-14.085	0.695	0.910	5.932	-0.002	-0.013	3.109
		TEMP	-12.361	0.340	-0.091	-16.298	-13.248	-0.007	0.018	4.060
	5024	OTHR	-4.844	-11.269	0.359	1.014	5.107	-0.025	0.035	2.656
		TEMP	-12.833	0.244	0.006	-16.283	-11.850	-0.073	-0.052	4.256
2 RPV	6006	OTHR	1.592	-14.539	0.281	-0.125	-0.346	0.056	0.124	-0.478
Pedestal		TEMP	-2.421	0.594	0.451	-16.077	-14.899	0.436	0.156	-1.788
Mid-Height	6013	OTHR	1.129	-13.432	0.777	-0.327	-0.535	-0.001	-0.012	-0.436
		TEMP	-2.655	0.215	-0.207	-16.601	-14.799	-0.049	-0.033	-2.015
	6024	OTHR	1.406	-7.848	-0.597	0.279	-0.331	-0.010	0.004	-0.278
		TEMP	-2.716	0.675	0.078	-18.530	-11.372	-0.660	0.021	-1.706
3 RPV	6606	OTHR	1.119	-12.352	1.924	0.607	4.489	0.138	0.173	-1.810
Pedestal		TEMP	8.843	0.688	0.583	-16.162	-12.321	0.045	-1.373	-1.999
Top	6613	OTHR	0.610	-11.804	0.127	0.477	4.883	0.004	-0.054	-1.856
		TEMP	9.187	0.728	-0.380	-16.206	-12.531	0.030	1.514	-1.961
	6624	OTHR	0.634	-9.449	0.646	0.974	5.684	0.175	0.581	-1.658
		TEMP	9.562	0.849	0.249	-16.169	-12.374	0.070	-1.774	-1.798
4 RCCV	1806	OTHR	1.456	-0.642	-0.120	0.972	5.903	0.008	0.019	2.184
Wetwell		TEMP	-1.529	-1.095	-0.255	-10.252	-14.624	0.079	0.094	-1.532
Bottom	1813	OTHR	1.214	-0.991	-0.092	0.971	6.012	-0.004	-0.006	2.366
		TEMP	-2.046	-4.246	-0.418	-10.039	-14.124	-0.042	-0.006	-1.257
	1824	OTHR	1.386	-0.650	-0.414	0.980	5.807	0.023	-0.015	2.327
		TEMP	-0.999	-4.101	0.138	-10.225	-14.390	0.027	-0.105	-1.324
5 RCCV	2606	OTHR	4.608	-0.216	-0.252	-0.274	-0.890	-0.019	0.013	-0.194
Wetwell		TEMP	-4.260	-1.284	-0.207	-9.988	-7.587	0.005	0.040	0.086
Mid-Height	2613	OTHR	4.087	-0.831	-0.195	-0.288	-1.045	-0.023	-0.007	-0.080
		TEMP	-5.195	-5.332	-0.051	-9.724	-7.431	-0.015	-0.092	0.416
	2624	OTHR	4.380	-0.256	-0.401	-0.233	-1.182	-0.004	0.014	-0.249
		TEMP	-4.918	-4.757	-0.110	-10.020	-7.637	-0.043	0.078	0.193
6 RCCV	3406	OTHR	4.321	0.573	0.118	-0.251	-0.874	0.159	-0.226	0.358
Wetwell		TEMP	5.175	-0.376	0.529	-10.840	-14.111	0.026	0.145	2.473
Top	3413	OTHR	3.350	-0.715	-0.204	-0.130	-0.442	-0.184	0.155	0.202
		TEMP	3.430	-7.155	0.358	-10.781	-14.122	-0.110	0.133	2.640
	3424	OTHR	2.842	0.307	-0.286	0.031	0.066	0.036	0.005	-0.015
		TEMP	2.847	-6.404	0.482	-9.992	-9.739	0.046	-0.109	0.898
7 RCCV	3606	OTHR	4.276	1.251	-0.065	-0.081	-0.008	0.093	-0.202	0.778
Drywell		TEMP	0.830	-0.284	0.115	-12.664	-14.950	0.281	0.181	-0.832
Bottom	3613	OTHR	3.261	-0.368	0.074	0.081	0.743	-0.033	0.095	0.879
		TEMP	-0.941	-8.496	1.387	-12.338	-13.243	-0.243	0.025	-0.346
	3624	OTHR	2.686	0.604	-0.317	0.210	1.024	0.111	0.046	0.807
		TEMP	-10.574	-8.041	0.298	-7.214	-6.867	0.090	-0.064	1.481
8 RCCV	4006	OTHR	3.090	1.554	0.023	0.016	-0.560	0.079	-0.140	-0.563
Drywell		TEMP	1.875	0.839	-0.303	-12.243	-12.221	0.193	-0.156	-0.809
Mid-Height	4013	OTHR	2.649	-0.466	0.313	-0.102	-0.392	0.070	0.055	-0.260
		TEMP	1.199	-10.522	1.291	-12.197	-11.582	0.045	-0.165	-0.458
	4976	OTHR	2.068	0.872	-0.324	0.055	0.007	-0.006	-0.012	-0.440
		TEMP	-7.090	-6.964	0.636	-7.680	-8.654	0.012	0.038	-0.306
9 RCCV	4406	OTHR	1.005	1.588	0.219	0.660	3.573	0.076	0.017	-1.238
Drywell		TEMP	6.737	0.276	-1.384	-11.629	-9.857	0.511	0.461	-0.604
Top	4413	OTHR	0.651	-0.598	0.549	0.433	2.759	-0.100	0.138	-1.240
		TEMP	-0.979	-11.885	-0.375	-12.126	-10.998	0.410	-0.181	0.175
	4424	OTHR	1.490	0.928	-0.253	0.526	2.887	0.026	-0.002	-0.886
		TEMP	-10.166	-5.578	0.969	-7.106	-5.867	-0.070	-0.009	-1.762

Table 3G.1-24

Combined Forces and Moments: RCCV, Selected Load Combination CV-7b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
10 Basemat @ Center	80003	OTHR	-1.248	-0.072	0.023	-7.413	-6.354	0.048	0.438	-0.376
		TEMP	-1.679	-2.344	-0.012	-8.432	-8.745	-0.031	0.023	-0.009
	80007	OTHR	-1.292	-0.086	0.016	-7.188	-6.324	0.066	0.242	-0.470
		TEMP	-1.684	-2.300	0.024	-8.412	-8.747	-0.031	0.015	-0.013
	80012	OTHR	-1.367	-0.143	0.051	-6.952	-6.112	-0.061	0.015	-0.261
		TEMP	-1.690	-2.227	0.016	-8.402	-8.767	-0.023	0.005	0.002
11 Basemat Inside RPV Pedestal	80206	OTHR	-0.711	-0.059	0.096	-11.269	-10.446	1.733	1.711	-1.893
		TEMP	-1.712	-2.848	0.097	-8.908	-9.252	0.053	-0.011	-0.059
	80213	OTHR	-1.001	0.000	-0.036	-9.073	-11.819	0.613	0.490	-2.415
		TEMP	-1.772	-2.262	0.036	-8.632	-9.316	-0.133	-0.013	-0.169
	80224	OTHR	-1.610	-0.860	0.076	-8.703	-8.109	-0.728	-1.276	-0.633
		TEMP	-1.625	-2.127	0.040	-8.608	-8.912	-0.042	-0.100	0.019
12 S/P Slab @ RPV	83306	OTHR	0.083	2.459	-0.613	-2.289	0.514	-0.140	4.248	-0.071
		TEMP	-11.644	3.829	0.179	-9.646	-8.196	0.033	-0.080	-0.040
	83313	OTHR	0.731	2.119	-0.438	-2.116	0.624	-0.092	4.307	0.100
		TEMP	-11.916	4.301	-0.412	-9.666	-8.271	-0.027	-0.074	0.012
	83324	OTHR	1.776	2.473	-0.324	-1.763	0.901	-0.184	4.459	-0.087
		TEMP	-11.700	4.708	0.978	-9.527	-8.129	-0.001	0.005	0.006
13 S/P Slab @ Center	83406	OTHR	0.545	2.098	-0.530	-6.946	-2.276	-0.051	-0.712	0.000
		TEMP	-8.113	-0.586	-0.539	-9.089	-8.498	-0.001	-0.113	0.014
	83413	OTHR	1.316	1.831	-0.134	-6.945	-2.227	-0.094	-0.670	0.004
		TEMP	-8.751	0.101	0.493	-9.200	-8.593	-0.013	-0.068	-0.007
	83424	OTHR	1.919	2.069	-0.179	-6.974	-2.054	-0.075	-0.597	0.004
		TEMP	-8.215	0.434	0.022	-9.166	-8.498	0.001	-0.042	0.006
14 S/P Slab @ RCCV	83506	OTHR	0.912	1.895	-0.388	4.307	-0.541	-0.038	-4.599	-0.006
		TEMP	-6.242	-2.430	-0.408	-8.821	-8.626	-0.045	-0.143	0.019
	83513	OTHR	1.623	1.783	-0.051	4.179	-0.527	-0.033	-4.569	-0.009
		TEMP	-7.029	-2.087	0.617	-9.213	-8.689	-0.011	-0.020	0.001
	83524	OTHR	1.911	1.926	-0.169	3.980	-0.471	-0.025	-4.517	-0.008
		TEMP	-6.242	-1.435	-0.072	-9.173	-8.644	0.017	-0.038	-0.005
15 Topslab @ Drywell Head Opening	98120	OTHR	0.147	1.183	1.541	1.274	0.926	0.545	0.520	-1.120
		TEMP	-11.552	-10.624	-5.088	7.064	5.010	5.160	-1.418	-1.083
	98135	OTHR	-1.117	-0.502	-0.681	1.119	-0.355	0.206	0.243	-1.667
		TEMP	-16.116	-6.978	2.414	10.532	-0.434	-1.821	1.058	-1.141
	98104	OTHR	-0.284	2.701	-1.085	1.090	3.632	-0.454	-0.632	-1.058
		TEMP	-6.693	-12.082	2.871	2.391	11.786	-3.140	0.877	-0.610
16 Topslab @ Center	98149	OTHR	-0.025	2.129	-0.745	0.680	0.350	0.290	0.097	0.468
		TEMP	-11.296	-3.042	-1.890	5.802	8.895	0.962	0.549	-1.908
	98170	OTHR	0.147	1.568	-0.512	0.997	1.120	-0.041	-0.031	-0.092
		TEMP	-9.623	-4.570	-0.897	4.305	5.412	-0.102	-0.115	0.049
	98109	OTHR	0.474	1.713	-0.435	1.479	2.623	-0.357	-0.081	-0.369
		TEMP	-7.853	-1.630	0.872	9.058	11.508	-0.323	0.767	0.077
17 Topslab @ RCCV	98174	OTHR	1.227	1.874	-0.168	0.321	0.545	0.648	0.346	-0.272
		TEMP	-9.246	-4.000	-1.475	5.058	6.605	0.114	-0.062	0.290
	98197	OTHR	1.088	1.952	-0.111	-0.138	-2.597	-0.175	-0.121	-1.555
		TEMP	-11.730	-4.691	-1.514	4.218	6.201	0.219	0.358	-0.440
	98103	OTHR	0.946	1.932	-0.406	-1.926	0.353	-0.506	-1.474	-0.311
		TEMP	-7.871	-5.553	-0.329	12.884	12.663	0.252	0.585	0.155

Table 3G.1-25

Combined Forces and Moments: RCCV, Selected Load Combination CV-11a

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV Pedestal Bottom	5006	OTHR	-3.935	-13.378	0.121	0.675	4.052	0.047	-0.031	2.126
		TEMP	-3.477	1.650	-0.339	-6.696	-6.473	-0.045	0.110	1.009
		EQEW	3.619	7.901	-1.996	-0.849	-4.472	-0.071	0.270	-1.900
		EQNS	-3.083	-4.179	-1.043	0.834	5.073	0.047	0.056	2.171
		EQZ	-1.345	2.103	-0.142	0.415	2.396	-0.007	0.016	1.001
		EQT	0.321	0.181	0.237	0.002	-0.172	-0.018	0.038	-0.099
		SPKW	-0.273	0.022	0.188	-0.025	-0.020	-0.035	0.019	0.062
		SPKN	-0.244	-0.027	-0.214	0.030	0.053	0.027	-0.005	0.084
	5013	OTHR	-4.592	-13.600	0.745	0.658	4.405	-0.001	-0.015	2.429
		TEMP	-3.130	1.794	-0.083	-6.863	-6.856	-0.006	0.023	0.926
		EQEW	5.109	12.272	0.228	-1.290	-6.832	-0.010	0.019	-3.065
		EQNS	-0.386	1.517	-1.467	0.299	1.833	-0.045	0.184	0.677
		EQZ	-1.093	2.640	-0.205	0.361	2.148	0.000	0.011	0.870
		EQT	0.245	0.242	0.274	-0.072	-0.267	-0.017	0.037	-0.137
		SPKW	0.269	0.346	0.022	0.130	-0.289	0.004	-0.002	-0.118
		SPKN	-0.734	-0.262	-0.099	-0.140	0.211	-0.006	0.011	0.212
	5024	OTHR	-4.221	-11.023	0.356	0.755	3.710	-0.017	0.029	2.060
		TEMP	-3.394	1.906	-0.001	-6.891	-6.143	-0.027	-0.034	1.037
		EQEW	0.410	0.732	3.303	-0.102	-0.451	0.017	-0.296	-0.197
		EQNS	2.337	7.411	-0.116	-0.519	-1.859	0.009	0.013	-1.002
		EQZ	-0.809	2.853	-0.014	0.334	1.966	-0.008	-0.003	0.791
		EQT	0.018	0.009	0.449	-0.008	-0.020	-0.013	0.008	-0.008
		SPKW	-0.691	-0.252	-0.020	-0.142	0.239	0.004	-0.002	0.216
		SPKN	0.336	0.365	-0.009	0.117	-0.385	0.000	-0.006	-0.157
2 RPV Pedestal Mid-Height	6006	OTHR	0.691	-13.969	0.382	-0.091	-0.218	0.059	0.118	-0.373
		TEMP	0.067	1.755	0.162	-6.160	-4.019	0.265	0.075	-1.529
		EQEW	-0.516	4.034	-2.798	0.015	0.148	-0.181	-0.003	-0.069
		EQNS	0.378	-2.346	-0.857	-0.144	-0.036	0.005	0.128	-0.014
		EQZ	0.148	2.127	-0.204	-0.015	-0.066	-0.022	-0.020	0.014
		EQT	-0.020	0.000	0.137	0.021	0.031	-0.038	-0.006	-0.012
		SPKW	-0.476	0.064	-0.279	-0.053	0.057	-0.063	-0.169	-0.094
		SPKN	-0.207	0.093	0.212	-0.014	-0.003	0.049	0.131	-0.050
	6013	OTHR	0.249	-12.948	0.843	-0.296	-0.403	0.002	-0.015	-0.329
		TEMP	-0.091	1.447	-0.178	-6.439	-3.908	-0.057	-0.026	-1.669
		EQEW	-0.993	6.128	0.364	0.228	0.113	-0.037	0.000	-0.218
		EQNS	-0.383	1.441	-1.462	-0.312	-0.154	-0.039	-0.054	0.014
		EQZ	0.166	2.267	-0.308	0.018	-0.024	-0.009	0.013	-0.025
		EQT	-0.035	-0.012	0.336	0.013	0.043	-0.038	0.000	-0.017
		SPKW	0.050	0.002	0.080	0.544	0.319	0.016	0.043	-0.226
		SPKN	-0.621	0.082	-0.143	-0.432	-0.140	-0.018	-0.026	-0.002
	6024	OTHR	0.392	-7.650	-0.545	0.248	-0.264	-0.007	0.017	-0.224
		TEMP	-0.234	2.057	0.062	-7.399	-2.300	-0.303	-0.003	-1.551
		EQEW	-0.166	1.388	5.021	0.017	0.037	0.335	0.177	0.035
		EQNS	-0.473	3.710	0.280	0.239	0.150	-0.040	-0.032	-0.200
		EQZ	0.050	1.699	0.177	-0.004	0.032	-0.006	-0.014	-0.053
		EQT	-0.021	0.115	0.612	-0.005	0.000	-0.001	0.012	0.001
		SPKW	-0.658	0.103	0.041	-0.483	-0.126	-0.003	0.026	-0.022
		SPKN	-0.132	-0.158	-0.041	0.556	0.405	0.003	-0.028	-0.231

OTHR: Loads other than thermal and seismic loads
TEMP: Thermal loads
EQEW: Horizontal seismic loads in the E-W direction
EQNS: Horizontal seismic loads in the N-S direction
EQZ: Vertical seismic loads
EQT: Torsional seismic loads
SPKW: Dynamic soil pressure during a horizontal earthquake in the E-W direction
SPKN: Dynamic soil pressure during a horizontal earthquake in the N-S direction

Table 3G.1-25

Combined Forces and Moments: RCCV, Selected Load Combination CV-11a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
3 RPV Pedestal Top	6606	OTHR	0.565	-11.635	1.928	0.565	4.268	0.200	0.092	-1.880
		TEMP	21.003	2.199	0.571	-6.642	-5.535	-0.046	-1.920	0.884
		EQEW	-0.943	2.275	-2.277	0.229	1.650	0.166	-0.115	-0.730
		EQNS	0.029	-1.486	-0.173	-0.294	-2.727	-0.251	0.592	0.878
		EQZ	0.340	1.738	-0.317	-0.388	-2.605	-0.100	-0.083	0.872
		EQT	-0.054	-0.058	0.212	0.004	0.080	-0.032	-0.001	-0.026
		SPKW	-0.707	0.028	-0.415	-0.097	0.046	0.252	-0.579	-0.151
		SPKN	-0.309	0.064	0.339	0.062	0.038	-0.231	0.468	-0.127
	6613	OTHR	0.132	-11.046	0.195	0.439	4.596	-0.054	0.016	-1.894
		TEMP	21.062	1.960	-0.446	-6.709	-5.541	0.140	2.058	0.853
		EQEW	-0.781	3.355	0.060	0.555	2.494	-0.059	-0.144	-1.078
		EQNS	-1.065	1.318	-1.163	-0.442	-1.612	0.330	-0.195	0.299
		EQZ	0.364	1.780	-0.164	-0.345	-2.530	0.118	0.054	0.844
		EQT	-0.016	-0.104	0.277	0.035	0.157	-0.049	-0.006	-0.052
		SPKW	0.421	-0.022	-0.017	0.292	0.038	-0.034	0.079	-0.010
		SPKN	-1.101	0.093	0.050	-0.219	0.032	0.054	-0.064	-0.242
	6624	OTHR	0.095	-8.819	0.659	0.925	5.468	0.230	0.515	-1.727
		TEMP	21.918	2.602	0.224	-6.666	-5.662	0.008	-2.345	1.058
		EQEW	-0.105	0.242	3.332	0.039	0.167	-0.210	0.271	-0.086
		EQNS	0.369	3.868	-0.083	0.207	-0.056	0.042	-0.140	-0.076
		EQZ	0.262	1.713	-0.051	-0.364	-2.531	-0.122	-0.050	0.831
		EQT	-0.016	-0.007	0.424	0.003	0.013	-0.048	0.038	-0.009
		SPKW	-1.384	0.137	0.034	-0.266	0.016	-0.044	0.041	-0.265
		SPKN	0.423	-0.077	0.004	0.260	-0.015	0.017	-0.038	0.032
4 RCCV Wetwell Bottom	1806	OTHR	0.976	-2.257	-0.006	0.796	4.852	0.008	0.019	1.893
		TEMP	2.538	0.393	-0.222	-4.442	-8.116	0.066	0.081	-1.726
		EQEW	0.712	5.471	-4.584	-0.208	-1.031	-0.020	0.000	-0.390
		EQNS	-1.589	-1.567	-3.991	0.297	2.001	-0.076	0.034	0.745
		EQZ	0.411	4.305	-0.145	0.086	0.579	-0.010	0.000	0.124
		EQT	0.102	0.070	0.791	-0.006	-0.047	-0.017	-0.001	-0.025
		SPKW	-0.491	0.082	0.290	-0.008	0.010	0.058	0.006	0.057
		SPKN	-0.148	0.090	0.003	-0.038	-0.052	-0.023	0.001	-0.005
	1813	OTHR	0.755	-2.358	-0.036	0.799	4.956	-0.002	-0.006	2.059
		TEMP	1.857	-2.167	-0.444	-4.275	-7.777	-0.024	-0.007	-1.526
		EQEW	1.099	7.041	0.944	-0.272	-1.620	-0.014	0.005	-0.662
		EQNS	-0.405	2.958	-4.573	0.114	0.846	-0.039	0.019	0.342
		EQZ	0.526	4.230	-0.135	0.092	0.505	-0.004	0.000	0.093
		EQT	0.105	-0.037	0.893	-0.008	-0.053	-0.029	0.001	-0.038
		SPKW	0.021	-0.033	-0.072	0.039	-0.035	-0.003	0.002	0.030
		SPKN	-0.495	0.023	0.169	-0.034	0.032	0.003	-0.005	0.052
	1824	OTHR	0.855	-2.383	-0.400	0.816	4.829	0.022	-0.016	2.042
		TEMP	2.938	-2.477	0.048	-4.432	-8.139	0.019	-0.085	-1.670
		EQEW	0.050	0.540	7.271	-0.030	-0.115	0.089	-0.054	-0.058
		EQNS	0.815	6.234	-0.283	-0.033	-0.312	-0.008	0.003	-0.223
		EQZ	0.435	4.683	0.049	0.092	0.546	-0.002	0.003	0.111
		EQT	0.002	-0.002	1.137	-0.003	-0.006	-0.012	-0.005	-0.004
		SPKW	-0.616	0.125	-0.039	-0.049	0.042	-0.002	0.005	0.064
		SPKN	-0.027	-0.021	0.069	0.051	-0.022	0.004	-0.013	0.038

Table 3G.1-25

Combined Forces and Moments: RCCV, Selected Load Combination CV-11a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
5 RCCV Wetwell Mid-Height	2606	OTHR	3.036	-1.875	-0.114	-0.184	-0.525	-0.023	0.011	-0.245
		TEMP	1.389	0.550	-0.146	-3.335	-1.060	0.021	0.034	0.043
		EQEW	0.057	3.854	-4.126	0.016	0.080	-0.051	-0.010	-0.106
		EQNS	-0.346	-1.042	-4.073	-0.060	-0.098	-0.121	-0.015	0.196
		EQZ	0.220	3.890	-0.198	-0.003	0.025	-0.007	0.000	0.093
		EQT	-0.001	0.064	0.752	0.002	0.002	-0.019	0.005	-0.005
		SPKW	-0.091	0.053	0.134	-0.014	-0.045	0.019	0.004	0.001
		SPKN	-0.081	0.032	0.001	-0.017	0.003	-0.017	-0.003	-0.003
	2613	OTHR	2.665	-2.117	-0.149	-0.198	-0.700	-0.019	-0.005	-0.133
		TEMP	0.113	-2.558	-0.121	-3.089	-1.048	0.009	-0.074	0.369
		EQEW	0.047	5.263	0.953	0.047	0.137	-0.018	-0.009	-0.248
		EQNS	-0.776	2.655	-4.531	-0.046	-0.085	-0.043	-0.028	0.156
		EQZ	0.257	3.949	-0.137	0.023	0.051	-0.002	0.001	0.069
		EQT	0.110	-0.092	0.860	0.011	0.024	-0.025	-0.002	-0.012
		SPKW	0.236	0.085	-0.048	0.027	-0.048	-0.003	0.000	0.016
		SPKN	-0.300	-0.037	0.161	-0.036	-0.018	0.005	0.002	-0.008
	2624	OTHR	2.882	-1.922	-0.370	-0.173	-0.820	-0.002	0.012	-0.254
		TEMP	0.970	-2.907	-0.086	-3.292	-0.934	-0.026	0.067	0.189
		EQEW	0.046	0.286	6.675	0.010	0.038	0.110	0.036	-0.014
		EQNS	-0.028	4.643	-0.272	0.074	0.157	-0.002	-0.003	-0.036
		EQZ	0.283	4.302	0.008	-0.001	0.004	-0.002	0.001	0.100
		EQT	0.000	-0.017	0.943	0.000	0.006	-0.016	0.004	-0.001
		SPKW	-0.305	-0.006	-0.022	-0.046	-0.030	-0.005	0.005	-0.022
		SPKN	0.210	0.107	0.028	0.024	-0.050	0.002	-0.003	0.029
6 RCCV Wetwell Top	3406	OTHR	2.795	-1.134	0.233	-0.211	-0.707	0.159	-0.227	0.349
		TEMP	11.700	1.428	0.353	-4.152	-8.450	-0.228	0.462	3.344
		EQEW	-0.400	2.524	-3.901	0.040	0.164	-0.195	0.169	-0.105
		EQNS	0.035	-0.512	-3.752	-0.091	-0.207	-0.078	0.006	0.126
		EQZ	0.300	3.275	-0.281	-0.098	-0.605	0.063	-0.097	0.217
		EQT	0.053	0.038	0.722	-0.008	-0.026	-0.024	-0.004	0.009
		SPKW	-0.020	0.037	0.040	-0.006	-0.011	0.016	-0.012	-0.007
		SPKN	-0.029	0.001	0.041	-0.001	0.014	-0.012	0.007	-0.006
	3413	OTHR	2.071	-1.943	-0.198	-0.088	-0.425	-0.194	0.156	0.240
		TEMP	8.031	-3.446	0.040	-4.382	-9.149	-0.403	0.539	3.335
		EQEW	-0.306	3.941	0.989	0.062	0.355	0.040	-0.073	-0.249
		EQNS	-0.619	2.314	-4.331	-0.025	-0.166	-0.108	0.117	0.070
		EQZ	0.082	3.767	-0.143	-0.036	-0.290	-0.033	0.040	0.112
		EQT	0.099	-0.114	0.879	0.007	0.027	-0.012	-0.010	-0.005
		SPKW	0.140	0.130	-0.024	0.009	-0.055	-0.004	0.004	0.031
		SPKN	-0.166	-0.068	0.090	-0.011	0.022	0.000	-0.002	-0.021
	3424	OTHR	1.665	-1.383	-0.269	-0.013	-0.208	0.042	-0.001	0.115
		TEMP	10.294	-4.168	0.471	-3.680	-5.044	-0.038	-0.007	2.165
		EQEW	-0.181	0.192	5.779	0.027	0.036	0.019	0.008	-0.005
		EQNS	-0.571	3.381	-0.181	0.062	0.327	0.035	-0.019	-0.130
		EQZ	0.163	3.711	-0.005	-0.045	-0.310	0.068	-0.075	0.088
		EQT	-0.030	-0.005	0.786	0.002	0.000	-0.028	0.000	0.002
		SPKW	-0.158	-0.065	-0.004	-0.006	0.050	-0.005	0.003	-0.033
		SPKN	0.178	0.141	0.005	-0.005	-0.121	0.003	-0.004	0.046

Table 3G.1-25

Combined Forces and Moments: RCCV, Selected Load Combination CV-11a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
7 RCCV Drywell Bottom	3606	OTHR	2.849	-0.431	0.068	-0.059	0.108	0.079	-0.199	0.590
		TEMP	8.481	1.351	0.705	-5.341	-9.025	0.605	0.535	-1.974
		EQEW	-0.456	2.346	-3.563	-0.046	-0.348	-0.054	0.165	-0.141
		EQNS	0.140	-0.286	-3.727	0.110	0.811	-0.008	0.027	0.355
		EQZ	0.145	3.079	-0.156	0.015	-0.027	0.058	-0.076	-0.104
		EQT	0.058	0.033	0.666	-0.014	-0.052	-0.022	-0.003	-0.017
		SPKW	-0.017	0.035	0.021	-0.003	0.001	-0.002	-0.012	0.001
		SPKN	-0.024	0.000	0.032	0.000	0.010	0.001	0.008	0.004
	3613	OTHR	2.045	-1.584	0.012	0.139	0.826	-0.057	0.088	0.645
		TEMP	4.607	-4.166	1.002	-4.955	-6.228	-0.363	0.318	-0.820
		EQEW	-0.308	4.114	1.141	-0.137	-0.791	-0.005	-0.061	-0.289
		EQNS	-0.650	2.004	-3.952	0.094	0.504	-0.021	0.110	0.203
		EQZ	-0.085	3.710	-0.179	0.015	0.042	-0.050	0.023	-0.136
		EQT	0.104	-0.094	0.800	-0.002	-0.018	-0.014	-0.009	-0.007
		SPKW	0.111	0.104	-0.015	0.021	0.024	-0.002	0.003	0.001
		SPKN	-0.142	-0.069	0.047	-0.011	0.012	-0.001	-0.001	0.013
	3624	OTHR	1.498	-1.269	-0.254	0.217	1.055	0.114	0.042	0.602
		TEMP	-4.289	-6.045	0.252	-0.934	-2.499	0.068	-0.001	0.350
		EQEW	-0.122	0.244	5.540	-0.030	-0.089	0.021	0.023	-0.042
		EQNS	-0.605	3.577	-0.197	-0.053	-0.253	0.053	0.003	-0.002
		EQZ	0.100	3.861	-0.050	0.000	-0.055	0.070	-0.040	-0.076
		EQT	-0.018	-0.005	0.801	-0.005	-0.008	-0.025	0.002	-0.005
		SPKW	-0.132	-0.047	-0.003	-0.013	-0.003	-0.001	0.003	0.003
		SPKN	0.139	0.069	0.003	0.021	0.040	-0.001	-0.004	0.007
8 RCCV Drywell Mid-Height	4006	OTHR	2.369	-0.079	0.057	-0.050	-0.636	0.046	-0.134	-0.238
		TEMP	5.934	2.176	0.228	-5.109	-5.059	0.011	-0.128	-0.683
		EQEW	-0.964	1.376	-3.270	0.013	0.141	-0.094	0.037	-0.114
		EQNS	1.236	-0.186	-3.298	0.011	-0.325	-0.061	-0.071	0.239
		EQZ	-0.475	2.621	-0.082	0.173	0.558	0.047	-0.008	-0.247
		EQT	0.007	0.017	0.636	-0.005	-0.014	-0.024	0.001	-0.009
		SPKW	-0.011	0.024	-0.010	-0.002	0.000	0.010	-0.002	-0.002
		SPKN	-0.012	0.001	0.054	0.001	-0.004	-0.005	0.001	0.002
	4013	OTHR	1.941	-1.549	0.245	-0.043	-0.356	0.067	0.053	0.003
		TEMP	4.288	-5.853	1.039	-4.672	-4.288	0.013	-0.132	-0.308
		EQEW	-1.100	3.208	0.978	0.060	0.305	0.005	-0.049	-0.319
		EQNS	-0.213	2.268	-3.816	0.015	-0.083	-0.085	0.017	0.120
		EQZ	-0.520	3.947	-0.244	0.053	0.440	0.001	0.007	-0.087
		EQT	0.087	-0.138	0.787	-0.005	-0.021	-0.003	-0.001	0.009
		SPKW	0.058	0.138	-0.015	0.012	0.004	-0.002	0.000	0.012
		SPKN	-0.060	-0.076	0.037	-0.010	-0.008	-0.001	0.000	-0.003
	4976	OTHR	1.119	-0.810	-0.208	0.043	-0.078	-0.006	-0.010	-0.127
		TEMP	-2.657	-5.340	0.578	-0.953	-1.777	0.004	0.013	-0.585
		EQEW	0.128	0.107	5.745	0.044	0.036	0.022	0.038	-0.014
		EQNS	-0.526	2.697	-0.249	-0.081	-0.180	-0.016	0.012	-0.035
		EQZ	-0.013	3.207	-0.184	0.019	0.202	0.005	0.007	-0.055
		EQT	0.037	-0.016	0.857	0.007	0.002	-0.027	0.007	0.000
		SPKW	-0.054	-0.052	0.004	-0.004	0.010	-0.002	0.000	-0.011
		SPKN	0.061	0.074	-0.005	0.006	-0.009	0.002	0.000	0.018

Table 3G.1-25

Combined Forces and Moments: RCCV, Selected Load Combination CV-11a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
9 RCCV Drywell Top	4406	OTHR	0.868	0.073	0.051	0.227	1.285	0.045	0.008	-0.551
		TEMP	6.443	1.716	-0.228	-4.470	-3.808	0.301	0.088	-0.153
		EQEW	-1.376	0.549	-2.744	0.128	0.524	-0.010	0.004	-0.226
		EQNS	1.239	-0.078	-2.463	-0.163	-0.895	0.060	0.075	0.195
		EQZ	-0.487	2.126	0.200	0.310	1.746	0.030	0.014	-0.374
		EQT	-0.061	-0.009	0.759	0.014	0.098	-0.019	-0.032	-0.039
		SPKW	-0.008	0.013	-0.021	0.001	0.009	0.006	0.008	-0.004
		SPKN	-0.013	0.000	0.060	0.000	-0.007	-0.003	-0.004	0.000
	4413	OTHR	0.515	-1.537	0.474	0.155	0.858	-0.115	0.126	-0.613
		TEMP	0.718	-6.633	-0.295	-4.753	-4.468	0.253	-0.244	0.644
		EQEW	-0.918	2.449	0.849	0.026	0.943	0.165	0.052	-0.019
		EQNS	0.639	2.552	-3.237	-0.108	-0.448	-0.002	0.013	0.079
		EQZ	0.508	4.138	-0.095	0.163	0.891	-0.006	0.007	-0.163
		EQT	-0.015	-0.177	1.005	0.006	0.062	-0.009	0.001	-0.034
		SPKW	0.077	0.159	-0.005	-0.004	-0.055	0.001	0.000	0.024
		SPKN	-0.048	-0.073	0.032	-0.002	0.014	-0.001	0.000	-0.012
	4424	OTHR	0.809	-0.493	-0.154	0.237	1.179	0.016	0.000	-0.381
		TEMP	-5.839	-4.178	0.764	-0.362	1.133	-0.024	-0.022	-1.462
		EQEW	0.263	0.047	6.065	0.046	-0.005	-0.003	0.040	0.029
		EQNS	-1.004	1.993	-0.209	-0.074	-0.379	-0.022	-0.007	-0.003
		EQZ	0.015	2.545	-0.148	0.030	0.339	-0.004	-0.001	-0.039
		EQT	0.063	-0.014	1.211	0.008	0.002	-0.018	-0.015	0.003
		SPKW	-0.012	-0.046	0.005	0.008	0.055	0.000	-0.001	-0.018
		SPKN	0.017	0.066	-0.005	-0.012	-0.078	0.000	0.001	0.027
10 Basemat @ Center	80003	OTHR	-1.755	-0.660	0.032	-3.813	-2.871	0.041	0.538	-0.457
		TEMP	-4.361	-5.064	0.010	-8.115	-8.087	-0.031	0.030	-0.007
		EQEW	0.038	0.223	1.347	0.305	0.542	-0.514	0.018	0.897
		EQNS	3.094	2.293	-0.511	-7.882	-6.864	0.154	0.538	0.093
		EQZ	1.110	1.331	-0.056	-7.799	-8.005	0.028	-0.247	0.194
		EQT	0.031	-0.005	0.478	0.009	0.025	-0.083	0.014	0.032
		SPKW	0.652	-2.463	-0.002	0.452	0.434	-0.004	-0.011	-0.004
		SPKN	-2.623	0.639	0.027	0.492	0.405	-0.035	0.016	0.003
	80007	OTHR	-1.805	-0.681	0.022	-3.595	-2.843	0.057	0.217	-0.603
		TEMP	-4.380	-5.029	0.041	-8.081	-8.084	-0.028	0.028	-0.008
		EQEW	0.573	-0.211	0.796	0.709	0.790	-0.262	-0.006	0.862
		EQNS	3.129	2.486	-0.433	-7.171	-6.643	0.308	0.666	0.119
		EQZ	1.132	1.351	-0.047	-7.810	-8.003	0.027	0.036	0.313
		EQT	0.069	-0.063	0.398	0.033	0.042	-0.065	0.018	0.018
		SPKW	0.653	-2.466	-0.002	0.434	0.430	-0.005	-0.005	-0.003
		SPKN	-2.618	0.652	0.033	0.511	0.414	-0.029	0.011	0.003
	80012	OTHR	-1.879	-0.745	0.056	-3.363	-2.638	-0.066	-0.126	-0.278
		TEMP	-4.384	-4.970	0.030	-8.065	-8.094	-0.024	0.023	0.001
		EQEW	-0.120	0.176	0.666	0.115	0.115	0.122	-0.008	0.900
		EQNS	2.801	2.812	-0.255	-6.619	-6.341	0.091	0.746	0.004
		EQZ	1.129	1.387	-0.047	-7.807	-8.000	0.026	0.303	0.044
		EQT	0.014	-0.012	0.364	0.006	0.008	-0.044	0.005	0.010
		SPKW	0.663	-2.458	-0.001	0.438	0.437	-0.007	-0.002	-0.002
		SPKN	-2.621	0.659	0.031	0.509	0.419	-0.031	0.010	0.000

Table 3G.1-25

Combined Forces and Moments: RCCV, Selected Load Combination CV-11a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
11 Basemat Inside RPV Pedestal	80206	OTHR	-1.231	-0.606	0.107	-8.901	-8.071	2.104	2.023	-2.147
		TEMP	-4.366	-5.447	0.114	-8.537	-8.473	0.021	0.002	-0.045
		EQEW	1.779	-0.230	2.679	3.698	4.686	-2.110	-0.626	1.546
		EQNS	3.728	1.278	-1.436	-9.997	-7.683	0.702	0.556	0.033
		EQZ	1.057	1.206	-0.090	-5.055	-5.495	-0.898	-1.046	0.926
		EQT	0.135	-0.069	0.661	-0.169	0.364	-0.276	0.124	0.220
		SPKW	0.476	-2.265	-0.017	0.007	0.953	-0.017	0.220	0.234
		SPKN	-2.505	0.389	0.007	0.952	-0.156	-0.016	-0.224	-0.233
	80213	OTHR	-1.535	-0.605	-0.003	-6.326	-9.904	0.565	0.467	-2.842
		TEMP	-4.494	-5.044	0.109	-8.253	-8.556	-0.118	-0.004	-0.108
		EQEW	2.987	-0.462	0.727	4.768	7.922	-0.214	0.021	2.209
		EQNS	3.163	2.513	-2.028	-6.085	-4.599	1.367	0.861	0.777
		EQZ	1.134	1.393	-0.134	-5.967	-4.328	0.102	0.047	1.428
		EQT	0.300	-0.034	0.462	0.210	0.275	-0.002	0.129	0.033
		SPKW	0.327	-2.467	-0.041	-0.032	0.632	0.013	-0.011	0.124
		SPKN	-2.299	0.654	0.010	0.980	0.226	-0.032	0.001	-0.117
	80224	OTHR	-2.150	-1.441	0.080	-6.772	-5.477	-0.764	-1.744	-0.650
		TEMP	-4.424	-4.901	0.060	-8.160	-8.192	-0.035	-0.034	0.010
		EQEW	0.147	0.114	-1.880	0.484	0.394	1.018	0.080	0.432
		EQNS	2.483	4.246	-0.218	-0.049	-2.844	0.233	1.886	0.111
		EQZ	1.230	1.557	-0.051	-4.333	-6.041	0.156	1.375	0.112
		EQT	0.029	-0.009	-0.127	0.055	0.006	-0.149	0.011	-0.195
		SPKW	0.705	-2.121	0.002	0.206	0.885	0.018	-0.126	0.032
		SPKN	-2.626	0.377	0.026	0.753	0.024	-0.027	0.129	-0.015
12 S/P Slab @ RPV	83306	OTHR	0.047	2.033	-0.596	-1.470	0.786	-0.130	3.990	-0.066
		TEMP	-10.578	10.974	0.416	-4.708	-2.771	0.029	-0.296	0.000
		EQEW	-0.493	-0.422	0.892	1.324	0.614	-0.365	0.518	0.182
		EQNS	-0.353	-0.814	-1.453	-2.816	-1.585	-0.298	-1.007	0.148
		EQZ	-0.129	-0.373	0.192	-1.917	-1.346	0.009	-1.085	0.025
		EQT	-0.001	0.008	-0.051	0.058	0.025	-0.025	0.018	0.012
		SPKW	-0.525	-0.661	1.219	-0.042	-0.032	0.005	-0.031	0.007
		SPKN	-0.226	-0.402	-0.984	-0.010	-0.008	0.006	-0.004	-0.004
	83313	OTHR	0.711	1.728	-0.456	-1.321	0.891	-0.090	4.043	0.089
		TEMP	-10.828	11.228	-0.835	-4.734	-2.849	-0.041	-0.301	-0.027
		EQEW	-0.972	-0.307	0.265	1.940	0.952	0.057	0.747	-0.005
		EQNS	-0.392	-1.414	0.724	-1.612	-1.010	-0.429	-0.553	0.176
		EQZ	-0.284	-0.266	0.051	-1.928	-1.341	-0.009	-1.090	-0.024
		EQT	-0.016	0.052	-0.095	0.101	0.051	0.003	0.036	0.003
		SPKW	-0.712	0.270	-0.098	-0.049	-0.025	0.000	-0.055	0.002
		SPKN	-0.210	-0.989	0.111	-0.022	-0.014	0.000	-0.001	-0.004
	83324	OTHR	1.766	2.045	-0.324	-0.969	1.164	-0.185	4.194	-0.079
		TEMP	-10.705	11.877	1.291	-4.485	-2.653	0.007	-0.155	0.046
		EQEW	-0.058	-0.047	-1.474	0.134	0.059	0.519	0.051	-0.251
		EQNS	-0.612	-0.175	0.190	-0.243	-0.272	-0.029	-0.036	0.018
		EQZ	-0.256	-0.391	0.019	-1.925	-1.341	0.015	-1.089	0.023
		EQT	0.002	-0.010	-0.243	0.009	0.005	0.028	0.003	-0.014
		SPKW	-0.226	-1.287	-0.130	-0.040	-0.036	0.000	-0.008	0.005
		SPKN	-0.524	0.272	0.062	-0.042	-0.013	-0.001	-0.050	-0.002

Table 3G.1-25

Combined Forces and Moments: RCCV, Selected Load Combination CV-11a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
13 S/P Slab @ Center	83406	OTHR	0.400	1.782	-0.530	-6.289	-1.841	-0.042	-0.488	0.000
		TEMP	-6.461	4.868	-0.561	-3.802	-3.176	-0.003	-0.312	0.014
		EQEW	-0.360	-0.133	0.349	-0.242	0.242	-0.260	0.338	0.008
		EQNS	-0.294	-1.163	-1.325	0.403	-0.878	-0.230	-0.705	-0.010
		EQZ	-0.187	-0.348	0.142	0.901	-0.610	0.001	-0.486	0.000
		EQT	0.001	0.050	-0.002	0.005	0.010	-0.018	0.012	0.001
		SPKW	-0.448	-0.645	0.909	0.056	-0.005	-0.009	-0.024	0.012
		SPKN	-0.219	-0.371	-0.667	0.007	-0.005	0.011	-0.004	-0.005
	83413	OTHR	1.159	1.531	-0.132	-6.290	-1.792	-0.092	-0.450	0.004
		TEMP	-6.987	5.300	0.324	-3.901	-3.259	-0.016	-0.276	-0.011
		EQEW	-1.017	-0.152	0.191	-0.305	0.399	0.036	0.490	0.001
		EQNS	-0.303	-1.143	0.680	0.211	-0.628	-0.292	-0.403	0.009
		EQZ	-0.380	-0.198	0.016	0.891	-0.590	0.001	-0.490	-0.002
		EQT	-0.017	0.077	-0.041	-0.007	0.023	0.003	0.024	-0.001
		SPKW	-1.035	0.099	-0.050	0.123	0.022	0.001	-0.041	-0.001
		SPKN	-0.004	-0.786	0.023	-0.014	-0.013	-0.004	-0.002	0.001
	83424	OTHR	1.799	1.749	-0.185	-6.310	-1.627	-0.076	-0.379	0.004
		TEMP	-6.636	5.835	0.088	-3.896	-3.148	-0.002	-0.210	0.009
		EQEW	-0.070	-0.035	-0.750	-0.021	0.021	0.360	0.034	0.005
		EQNS	-0.867	-0.199	0.099	0.031	-0.303	-0.018	-0.056	0.001
		EQZ	-0.327	-0.343	0.005	0.897	-0.590	0.002	-0.491	0.001
		EQT	0.002	-0.008	-0.137	-0.001	0.002	0.020	0.002	0.000
		SPKW	0.046	-1.045	-0.106	-0.012	-0.028	0.001	-0.006	-0.001
		SPKN	-0.830	0.080	0.053	0.113	0.027	-0.001	-0.036	0.001
14 S/P Slab @ RCCV	83506	OTHR	0.734	1.625	-0.397	3.337	-0.489	-0.035	-3.987	-0.003
		TEMP	-3.917	2.321	-0.471	-2.874	-3.120	-0.034	-0.284	0.013
		EQEW	-0.145	-0.183	0.082	-1.213	-0.197	-0.032	0.273	-0.057
		EQNS	-0.142	-1.302	-1.091	2.375	0.032	-0.032	-0.543	-0.049
		EQZ	-0.183	-0.303	0.139	1.509	-0.005	0.009	-0.061	-0.005
		EQT	-0.008	0.086	0.017	-0.029	-0.006	-0.006	0.009	-0.002
		SPKW	-0.424	-0.631	0.740	0.114	0.030	-0.036	-0.017	0.012
		SPKN	-0.144	-0.282	-0.455	0.012	0.001	0.017	-0.001	-0.002
	83513	OTHR	1.417	1.502	-0.042	3.216	-0.469	-0.033	-3.959	-0.008
		TEMP	-4.564	2.411	0.445	-3.195	-3.177	-0.008	-0.190	-0.001
		EQEW	-0.917	-0.245	0.143	-1.685	-0.241	0.013	0.385	0.006
		EQNS	-0.268	-0.930	0.663	1.309	-0.079	-0.045	-0.310	-0.055
		EQZ	-0.395	-0.180	-0.010	1.525	0.016	0.003	-0.070	-0.003
		EQT	-0.012	0.098	-0.025	-0.076	-0.008	0.006	0.019	-0.001
		SPKW	-1.157	-0.104	-0.028	0.243	0.075	0.002	-0.033	0.000
		SPKN	0.097	-0.595	-0.048	-0.021	-0.007	-0.006	0.001	0.000
	83524	OTHR	1.754	1.645	-0.172	3.031	-0.421	-0.025	-3.909	-0.008
		TEMP	-4.044	3.212	-0.010	-3.279	-3.153	0.013	-0.167	-0.005
		EQEW	-0.040	-0.061	-0.420	-0.124	-0.023	0.009	0.029	0.092
		EQNS	-0.904	-0.298	0.053	0.152	-0.213	0.000	-0.035	-0.004
		EQZ	-0.326	-0.339	0.001	1.536	0.015	0.001	-0.070	0.001
		EQT	0.008	-0.007	-0.092	-0.008	-0.001	0.001	0.002	0.005
		SPKW	0.176	-0.780	-0.090	-0.013	-0.012	0.003	-0.001	0.000
		SPKN	-0.976	-0.119	0.071	0.227	0.074	-0.003	-0.032	0.001

Table 3G.1-25

Combined Forces and Moments: RCCV, Selected Load Combination CV-11a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
15 Topslab @ Drywell Head Opening	98120	OTHR	0.754	0.794	1.122	0.462	0.344	0.139	0.312	-0.479
		TEMP	-7.159	-4.295	-0.826	0.963	0.733	2.771	-0.163	-0.005
		EQEW	-1.127	-0.929	-0.811	-0.056	-0.437	-0.148	-0.111	-0.105
		EQNS	0.281	0.042	0.123	-0.067	-0.093	-0.055	-0.055	-0.029
		EQZ	-1.049	-0.279	-0.390	0.418	0.251	0.276	-0.051	-0.286
		EQT	0.082	0.043	0.048	0.013	0.045	0.013	-0.005	-0.003
		SPKW	0.030	-0.009	0.008	-0.005	0.004	0.000	0.002	0.001
		SPKN	-0.032	-0.003	-0.013	0.003	-0.005	-0.001	-0.001	0.001
	98135	OTHR	0.859	-0.159	-0.470	0.250	-0.098	0.179	0.102	-0.766
		TEMP	-8.776	-5.279	0.213	3.150	-2.057	-1.132	0.380	-0.267
		EQEW	0.030	0.279	-0.487	-0.182	-0.215	0.083	0.029	-0.102
		EQNS	0.983	0.099	-0.149	-0.201	-0.006	0.014	-0.024	0.022
		EQZ	-2.538	-0.166	0.136	0.662	-0.249	-0.110	0.072	-0.336
		EQT	0.018	-0.014	0.031	0.002	0.007	-0.011	-0.012	0.005
		SPKW	0.085	0.008	-0.008	-0.008	0.002	-0.001	-0.001	0.002
		SPKN	-0.089	-0.011	0.013	0.005	-0.002	0.001	0.001	-0.001
	98104	OTHR	-0.116	1.656	-0.662	0.489	1.295	-0.109	-0.344	-0.489
		TEMP	-4.990	-1.708	0.576	-1.459	3.716	-1.501	0.186	-0.213
		EQEW	0.347	0.488	-0.530	-0.010	-0.417	-0.023	0.037	-0.352
		EQNS	-0.055	-1.663	0.067	-0.066	-0.366	0.013	-0.045	0.019
		EQZ	-0.044	-0.600	0.042	0.204	1.305	-0.272	-0.011	-0.257
		EQT	-0.018	-0.021	0.028	-0.009	-0.022	0.014	-0.003	-0.009
		SPKW	-0.001	-0.048	0.001	-0.002	0.014	-0.001	-0.002	0.000
		SPKN	-0.004	0.029	0.004	0.000	-0.020	0.002	0.002	0.000
16 Topslab @ Center	98149	OTHR	0.996	1.004	-0.160	-0.017	0.023	0.192	0.026	0.117
		TEMP	-6.095	-2.564	-1.166	2.235	2.318	0.500	0.036	0.047
		EQEW	-1.027	-0.287	-0.558	-0.032	-0.226	-0.014	0.056	0.021
		EQNS	0.450	0.540	0.228	-0.114	0.038	-0.116	-0.056	0.024
		EQZ	-1.573	0.293	-0.499	0.768	0.364	-0.128	0.039	0.289
		EQT	0.089	-0.037	-0.014	0.007	0.017	-0.005	-0.009	-0.011
		SPKW	0.045	-0.022	-0.004	-0.006	0.009	-0.003	0.000	0.000
		SPKN	-0.046	-0.003	0.004	0.005	-0.006	0.001	-0.001	0.000
	98170	OTHR	0.853	0.905	-0.218	0.160	0.116	0.014	-0.008	-0.053
		TEMP	-5.522	-3.576	-1.068	2.144	2.867	-0.043	0.030	0.389
		EQEW	-1.067	0.053	-0.811	-0.018	-0.041	-0.012	0.022	-0.024
		EQNS	0.223	-0.296	0.240	-0.122	-0.159	-0.015	-0.024	-0.022
		EQZ	-1.210	0.089	-0.101	0.785	0.972	-0.053	-0.003	0.014
		EQT	0.067	0.032	-0.003	-0.002	0.008	-0.010	0.004	0.001
		SPKW	0.046	-0.007	-0.001	-0.003	0.012	0.001	0.000	0.003
		SPKN	-0.045	-0.003	0.009	0.003	-0.012	0.001	0.000	-0.002
	98109	OTHR	0.302	1.080	-0.340	0.486	0.976	-0.138	0.002	-0.179
		TEMP	-6.255	-0.872	0.768	1.221	2.566	-0.119	0.329	-0.005
		EQEW	0.103	-0.009	-0.648	-0.025	-0.205	-0.121	0.002	-0.119
		EQNS	0.124	-1.422	-0.076	-0.251	-0.419	-0.015	-0.074	0.067
		EQZ	-0.064	-0.446	-0.020	0.667	0.868	-0.147	-0.090	-0.060
		EQT	0.001	0.037	-0.011	-0.009	-0.019	0.006	-0.002	-0.013
		SPKW	0.017	-0.010	-0.002	-0.008	0.014	0.000	0.000	-0.001
		SPKN	-0.024	0.004	0.004	0.005	-0.019	-0.001	0.000	0.002

Table 3G.1-25

Combined Forces and Moments: RCCV, Selected Load Combination CV-11a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
17 Topslab @ RCCV	98174	OTHR	1.256	0.974	0.019	-0.203	-0.096	0.241	0.120	-0.137
		TEMP	-4.857	-2.720	-0.479	2.355	3.217	0.258	-0.023	0.433
		EQEW	-1.558	-0.285	-0.734	-0.272	-0.273	0.089	0.119	-0.127
		EQNS	0.057	1.170	0.209	0.166	0.142	-0.291	-0.094	0.055
		EQZ	-0.712	0.087	-0.213	0.774	0.772	0.157	0.163	-0.060
		EQT	0.144	-0.096	-0.013	-0.008	-0.045	0.014	0.000	-0.020
		SPKW	0.030	-0.011	-0.012	-0.009	0.013	-0.002	0.003	0.001
		SPKN	-0.033	-0.018	0.008	0.009	-0.010	-0.001	-0.002	-0.001
	98197	OTHR	1.029	1.114	-0.073	-0.240	-0.935	-0.014	-0.052	-0.503
		TEMP	-7.582	-2.932	-1.375	1.918	3.109	0.128	0.154	-0.449
		EQEW	-1.467	-0.076	-0.703	-0.029	-0.309	-0.031	-0.036	-0.004
		EQNS	0.190	-0.521	0.523	0.097	0.029	-0.112	0.026	0.134
		EQZ	-0.153	0.023	0.169	0.425	-1.039	-0.134	-0.048	-0.662
		EQT	0.039	0.081	-0.033	-0.018	-0.020	0.007	-0.004	-0.011
		SPKW	0.054	-0.024	0.001	0.004	0.005	0.002	0.001	0.000
		SPKN	-0.040	0.005	0.009	0.003	-0.003	0.000	0.000	0.002
	98103	OTHR	0.438	1.123	-0.314	-0.280	0.261	-0.191	-0.411	-0.121
		TEMP	-6.579	-2.446	-0.073	3.434	3.309	0.118	0.451	0.084
		EQEW	-0.205	0.204	-1.155	-0.035	-0.053	-0.209	0.040	-0.046
		EQNS	-0.121	-1.604	0.051	-1.192	-0.617	0.011	-0.274	0.018
		EQZ	0.196	-0.283	-0.064	-1.812	-0.296	-0.205	-0.905	-0.109
		EQT	-0.018	0.057	-0.193	0.003	0.005	-0.004	0.010	0.007
		SPKW	0.018	0.008	0.003	0.003	0.019	0.000	0.005	-0.001
		SPKN	-0.024	-0.011	-0.002	-0.015	-0.027	0.000	-0.008	0.001

Table 3G.1-26

Combined Forces and Moments: RCCV, Selected Load Combination CV-11b

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 RPV Pedestal Bottom	5006	OTHR	-3.704	-12.440	0.095	0.658	3.945	0.045	-0.027	2.062
		TEMP	-12.845	0.250	-0.532	-16.012	-12.643	-0.092	0.231	4.151
		EQEW	3.619	7.901	-1.996	-0.849	-4.472	-0.071	0.270	-1.900
		EQNS	-3.083	-4.179	-1.043	0.834	5.073	0.047	0.056	2.171
		EQZ	-1.345	2.103	-0.142	0.415	2.396	-0.007	0.016	1.001
		EQT	0.321	0.181	0.237	0.002	-0.172	-0.018	0.038	-0.099
		SPKW	-0.273	0.022	0.188	-0.025	-0.020	-0.035	0.019	0.062
		SPKN	-0.244	-0.027	-0.214	0.030	0.053	0.027	-0.005	0.084
	5013	OTHR	-4.324	-12.567	0.704	0.630	4.247	-0.001	-0.013	2.337
		TEMP	-12.361	0.340	-0.091	-16.298	-13.248	-0.007	0.018	4.060
		EQEW	5.109	12.272	0.228	-1.290	-6.832	-0.010	0.019	-3.065
		EQNS	-0.386	1.517	-1.467	0.299	1.833	-0.045	0.184	0.677
		EQZ	-1.093	2.640	-0.205	0.361	2.148	0.000	0.011	0.870
		EQT	0.245	0.242	0.274	-0.072	-0.267	-0.017	0.037	-0.137
		SPKW	0.269	0.346	0.022	0.130	-0.289	0.004	-0.002	-0.118
		SPKN	-0.734	-0.262	-0.099	-0.140	0.211	-0.006	0.011	0.212
	5024	OTHR	-3.954	-10.121	0.381	0.739	3.597	-0.017	0.025	1.984
		TEMP	-12.833	0.244	0.006	-16.283	-11.850	-0.073	-0.052	4.256
		EQEW	0.410	0.732	3.303	-0.102	-0.451	0.017	-0.296	-0.197
		EQNS	2.337	7.411	-0.116	-0.519	-1.859	0.009	0.013	-1.002
		EQZ	-0.809	2.853	-0.014	0.334	1.966	-0.008	-0.003	0.791
		EQT	0.018	0.009	0.449	-0.008	-0.020	-0.013	0.008	-0.008
		SPKW	-0.691	-0.252	-0.020	-0.142	0.239	0.004	-0.002	0.216
		SPKN	0.336	0.365	-0.009	0.117	-0.385	0.000	-0.006	-0.157
2 RPV Pedestal Mid-Height	6006	OTHR	0.991	-13.002	0.296	-0.087	-0.188	0.052	0.111	-0.383
		TEMP	-2.421	0.594	0.451	-16.077	-14.899	0.436	0.156	-1.788
		EQEW	-0.516	4.034	-2.798	0.015	0.148	-0.181	-0.003	-0.069
		EQNS	0.378	-2.346	-0.857	-0.144	-0.036	0.005	0.128	-0.014
		EQZ	0.148	2.127	-0.204	-0.015	-0.066	-0.022	-0.020	0.014
		EQT	-0.020	0.000	0.137	0.021	0.031	-0.038	-0.006	-0.012
		SPKW	-0.476	0.064	-0.279	-0.053	0.057	-0.063	-0.169	-0.094
		SPKN	-0.207	0.093	0.212	-0.014	-0.003	0.049	0.131	-0.050
	6013	OTHR	0.555	-11.997	0.804	-0.282	-0.365	0.002	-0.011	-0.344
		TEMP	-2.655	0.215	-0.207	-16.601	-14.799	-0.049	-0.033	-2.015
		EQEW	-0.993	6.128	0.364	0.228	0.113	-0.037	0.000	-0.218
		EQNS	-0.383	1.441	-1.462	-0.312	-0.154	-0.039	-0.054	0.014
		EQZ	0.166	2.267	-0.308	0.018	-0.024	-0.009	0.013	-0.025
		EQT	-0.035	-0.012	0.336	0.013	0.043	-0.038	0.000	-0.017
		SPKW	0.050	0.002	0.080	0.544	0.319	0.016	0.043	-0.226
		SPKN	-0.621	0.082	-0.143	-0.432	-0.140	-0.018	-0.026	-0.002
	6024	OTHR	0.732	-6.935	-0.427	0.266	-0.214	-0.005	0.011	-0.239
		TEMP	-2.716	0.675	0.078	-18.530	-11.372	-0.660	0.021	-1.706
		EQEW	-0.166	1.388	5.021	0.017	0.037	0.335	0.177	0.035
		EQNS	-0.473	3.710	0.280	0.239	0.150	-0.040	-0.032	-0.200
		EQZ	0.050	1.699	0.177	-0.004	0.032	-0.006	-0.014	-0.053
		EQT	-0.021	0.115	0.612	-0.005	0.000	-0.001	0.012	0.001
		SPKW	-0.658	0.103	0.041	-0.483	-0.126	-0.003	0.026	-0.022
		SPKN	-0.132	-0.158	-0.041	0.556	0.405	0.003	-0.028	-0.231

Table 3G.1-26

Combined Forces and Moments: RCCV, Selected Load Combination CV-11b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
3 RPV Pedestal Top	6606	OTHR	0.809	-10.786	1.787	0.466	3.594	0.178	0.067	-1.627
		TEMP	8.843	0.688	0.583	-16.162	-12.321	0.045	-1.373	-1.999
		EQEW	-0.943	2.275	-2.277	0.229	1.650	0.166	-0.115	-0.730
		EQNS	0.029	-1.486	-0.173	-0.294	-2.727	-0.251	0.592	0.878
		EQZ	0.340	1.738	-0.317	-0.388	-2.605	-0.100	-0.083	0.872
		EQT	-0.054	-0.058	0.212	0.004	0.080	-0.032	-0.001	-0.026
		SPKW	-0.707	0.028	-0.415	-0.097	0.046	0.252	-0.579	-0.151
		SPKN	-0.309	0.064	0.339	0.062	0.038	-0.231	0.468	-0.127
	6613	OTHR	0.341	-10.238	0.222	0.353	3.968	-0.030	0.044	-1.659
		TEMP	9.187	0.728	-0.380	-16.206	-12.531	0.030	1.514	-1.961
		EQEW	-0.781	3.355	0.060	0.555	2.494	-0.059	-0.144	-1.078
		EQNS	-1.065	1.318	-1.163	-0.442	-1.612	0.330	-0.195	0.299
		EQZ	0.364	1.780	-0.164	-0.345	-2.530	0.118	0.054	0.844
		EQT	-0.016	-0.104	0.277	0.035	0.157	-0.049	-0.006	-0.052
		SPKW	0.421	-0.022	-0.017	0.292	0.038	-0.034	0.079	-0.010
		SPKN	-1.101	0.093	0.050	-0.219	0.032	0.054	-0.064	-0.242
	6624	OTHR	0.302	-8.015	0.667	0.835	4.805	0.195	0.502	-1.481
		TEMP	9.562	0.849	0.249	-16.169	-12.374	0.070	-1.774	-1.798
		EQEW	-0.105	0.242	3.332	0.039	0.167	-0.210	0.271	-0.086
		EQNS	0.369	3.868	-0.083	0.207	-0.056	0.042	-0.140	-0.076
		EQZ	0.262	1.713	-0.051	-0.364	-2.531	-0.122	-0.050	0.831
		EQT	-0.016	-0.007	0.424	0.003	0.013	-0.048	0.038	-0.009
		SPKW	-1.384	0.137	0.034	-0.266	0.016	-0.044	0.041	-0.265
		SPKN	0.423	-0.077	0.004	0.260	-0.015	0.017	-0.038	0.032
4 RCCV Wetwell Bottom	1806	OTHR	0.981	-1.892	-0.037	0.714	4.352	0.010	0.018	1.649
		TEMP	-1.529	-1.095	-0.255	-10.252	-14.624	0.079	0.094	-1.532
		EQEW	0.712	5.471	-4.584	-0.208	-1.031	-0.020	0.000	-0.390
		EQNS	-1.589	-1.567	-3.991	0.297	2.001	-0.076	0.034	0.745
		EQZ	0.411	4.305	-0.145	0.086	0.579	-0.010	0.000	0.124
		EQT	0.102	0.070	0.791	-0.006	-0.047	-0.017	-0.001	-0.025
		SPKW	-0.491	0.082	0.290	-0.008	0.010	0.058	0.006	0.057
		SPKN	-0.148	0.090	0.003	-0.038	-0.052	-0.023	0.001	-0.005
	1813	OTHR	0.720	-2.109	0.011	0.717	4.478	0.000	-0.007	1.815
		TEMP	-2.046	-4.246	-0.418	-10.039	-14.124	-0.042	-0.006	-1.257
		EQEW	1.099	7.041	0.944	-0.272	-1.620	-0.014	0.005	-0.662
		EQNS	-0.405	2.958	-4.573	0.114	0.846	-0.039	0.019	0.342
		EQZ	0.526	4.230	-0.135	0.092	0.505	-0.004	0.000	0.093
		EQT	0.105	-0.037	0.893	-0.008	-0.053	-0.029	0.001	-0.038
		SPKW	0.021	-0.033	-0.072	0.039	-0.035	-0.003	0.002	0.030
		SPKN	-0.495	0.023	0.169	-0.034	0.032	0.003	-0.005	0.052
	1824	OTHR	0.800	-2.078	-0.309	0.739	4.356	0.021	-0.014	1.803
		TEMP	-0.999	-4.101	0.138	-10.225	-14.390	0.027	-0.105	-1.324
		EQEW	0.050	0.540	7.271	-0.030	-0.115	0.089	-0.054	-0.058
		EQNS	0.815	6.234	-0.283	-0.033	-0.312	-0.008	0.003	-0.223
		EQZ	0.435	4.683	0.049	0.092	0.546	-0.002	0.003	0.111
		EQT	0.002	-0.002	1.137	-0.003	-0.006	-0.012	-0.005	-0.004
		SPKW	-0.616	0.125	-0.039	-0.049	0.042	-0.002	0.005	0.064
		SPKN	-0.027	-0.021	0.069	0.051	-0.022	0.004	-0.013	0.038

Table 3G.1-26

Combined Forces and Moments: RCCV, Selected Load Combination CV-11b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
5 RCCV Wetwell Mid-Height	2606	OTHR	3.228	-1.490	-0.139	-0.196	-0.624	-0.018	0.011	-0.190
		TEMP	-4.260	-1.284	-0.207	-9.988	-7.587	0.005	0.040	0.086
		EQEW	0.057	3.854	-4.126	0.016	0.080	-0.051	-0.010	-0.106
		EQNS	-0.346	-1.042	-4.073	-0.060	-0.098	-0.121	-0.015	0.196
		EQZ	0.220	3.890	-0.198	-0.003	0.025	-0.007	0.000	0.093
		EQT	-0.001	0.064	0.752	0.002	0.002	-0.019	0.005	-0.005
		SPKW	-0.091	0.053	0.134	-0.014	-0.045	0.019	0.004	0.001
		SPKN	-0.081	0.032	0.001	-0.017	0.003	-0.017	-0.003	-0.003
	2613	OTHR	2.829	-1.885	-0.069	-0.215	-0.764	-0.013	-0.005	-0.091
		TEMP	-5.195	-5.332	-0.051	-9.724	-7.431	-0.015	-0.092	0.416
		EQEW	0.047	5.263	0.953	0.047	0.137	-0.018	-0.009	-0.248
		EQNS	-0.776	2.655	-4.531	-0.046	-0.085	-0.043	-0.028	0.156
		EQZ	0.257	3.949	-0.137	0.023	0.051	-0.002	0.001	0.069
		EQT	0.110	-0.092	0.860	0.011	0.024	-0.025	-0.002	-0.012
		SPKW	0.236	0.085	-0.048	0.027	-0.048	-0.003	0.000	0.016
		SPKN	-0.300	-0.037	0.161	-0.036	-0.018	0.005	0.002	-0.008
	2624	OTHR	3.069	-1.626	-0.281	-0.173	-0.871	-0.002	0.011	-0.213
		TEMP	-4.918	-4.757	-0.110	-10.020	-7.637	-0.043	0.078	0.193
		EQEW	0.046	0.286	6.675	0.010	0.038	0.110	0.036	-0.014
		EQNS	-0.028	4.643	-0.272	0.074	0.157	-0.002	-0.003	-0.036
		EQZ	0.283	4.302	0.008	-0.001	0.004	-0.002	0.001	0.100
		EQT	0.000	-0.017	0.943	0.000	0.006	-0.016	0.004	-0.001
		SPKW	-0.305	-0.006	-0.022	-0.046	-0.030	-0.005	0.005	-0.022
		SPKN	0.210	0.107	0.028	0.024	-0.050	0.002	-0.003	0.029
6 RCCV Wetwell Top	3406	OTHR	2.955	-0.765	0.173	-0.175	-0.571	0.126	-0.172	0.248
		TEMP	5.175	-0.376	0.529	-10.840	-14.111	0.026	0.145	2.473
		EQEW	-0.400	2.524	-3.901	0.040	0.164	-0.195	0.169	-0.105
		EQNS	0.035	-0.512	-3.752	-0.091	-0.207	-0.078	0.006	0.126
		EQZ	0.300	3.275	-0.281	-0.098	-0.605	0.063	-0.097	0.217
		EQT	0.053	0.038	0.722	-0.008	-0.026	-0.024	-0.004	0.009
		SPKW	-0.020	0.037	0.040	-0.006	-0.011	0.016	-0.012	-0.007
		SPKN	-0.029	0.001	0.041	-0.001	0.014	-0.012	0.007	-0.006
	3413	OTHR	2.282	-1.727	-0.111	-0.094	-0.344	-0.157	0.124	0.165
		TEMP	3.430	-7.155	0.358	-10.781	-14.122	-0.110	0.133	2.640
		EQEW	-0.306	3.941	0.989	0.062	0.355	0.040	-0.073	-0.249
		EQNS	-0.619	2.314	-4.331	-0.025	-0.166	-0.108	0.117	0.070
		EQZ	0.082	3.767	-0.143	-0.036	-0.290	-0.033	0.040	0.112
		EQT	0.099	-0.114	0.879	0.007	0.027	-0.012	-0.010	-0.005
		SPKW	0.140	0.130	-0.024	0.009	-0.055	-0.004	0.004	0.031
		SPKN	-0.166	-0.068	0.090	-0.011	0.022	0.000	-0.002	-0.021
	3424	OTHR	1.953	-1.051	-0.195	0.010	-0.052	0.031	0.005	0.035
		TEMP	2.847	-6.404	0.482	-9.992	-9.739	0.046	-0.109	0.898
		EQEW	-0.181	0.192	5.779	0.027	0.036	0.019	0.008	-0.005
		EQNS	-0.571	3.381	-0.181	0.062	0.327	0.035	-0.019	-0.130
		EQZ	0.163	3.711	-0.005	-0.045	-0.310	0.068	-0.075	0.088
		EQT	-0.030	-0.005	0.786	0.002	0.000	-0.028	0.000	0.002
		SPKW	-0.158	-0.065	-0.004	-0.006	0.050	-0.005	0.003	-0.033
		SPKN	0.178	0.141	0.005	-0.005	-0.121	0.003	-0.004	0.046

Table 3G.1-26

Combined Forces and Moments: RCCV, Selected Load Combination CV-11b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
7 RCCV Drywell Bottom	3606	OTHR	2.964	-0.141	0.024	-0.053	0.080	0.075	-0.148	0.584
		TEMP	0.830	-0.284	0.115	-12.664	-14.950	0.281	0.181	-0.832
		EQEW	-0.456	2.346	-3.563	-0.046	-0.348	-0.054	0.165	-0.141
		EQNS	0.140	-0.286	-3.727	0.110	0.811	-0.008	0.027	0.355
		EQZ	0.145	3.079	-0.156	0.015	-0.027	0.058	-0.076	-0.104
		EQT	0.058	0.033	0.666	-0.014	-0.052	-0.022	-0.003	-0.017
		SPKW	-0.017	0.035	0.021	-0.003	0.001	-0.002	-0.012	0.001
		SPKN	-0.024	0.000	0.032	0.000	0.010	0.001	0.008	0.004
	3613	OTHR	2.251	-1.383	0.078	0.091	0.683	-0.045	0.069	0.684
		TEMP	-0.941	-8.496	1.387	-12.338	-13.243	-0.243	0.025	-0.346
		EQEW	-0.308	4.114	1.141	-0.137	-0.791	-0.005	-0.061	-0.289
		EQNS	-0.650	2.004	-3.952	0.094	0.504	-0.021	0.110	0.203
		EQZ	-0.085	3.710	-0.179	0.015	0.042	-0.050	0.023	-0.136
		EQT	0.104	-0.094	0.800	-0.002	-0.018	-0.014	-0.009	-0.007
		SPKW	0.111	0.104	-0.015	0.021	0.024	-0.002	0.003	0.001
		SPKN	-0.142	-0.069	0.047	-0.011	0.012	-0.001	-0.001	0.013
	3624	OTHR	1.819	-0.886	-0.194	0.187	0.911	0.088	0.038	0.615
		TEMP	-10.574	-8.041	0.298	-7.214	-6.867	0.090	-0.064	1.481
		EQEW	-0.122	0.244	5.540	-0.030	-0.089	0.021	0.023	-0.042
		EQNS	-0.605	3.577	-0.197	-0.053	-0.253	0.053	0.003	-0.002
		EQZ	0.100	3.861	-0.050	0.000	-0.055	0.070	-0.040	-0.076
		EQT	-0.018	-0.005	0.801	-0.005	-0.008	-0.025	0.002	-0.005
		SPKW	-0.132	-0.047	-0.003	-0.013	-0.003	-0.001	0.003	0.003
		SPKN	0.139	0.069	0.003	0.021	0.040	-0.001	-0.004	0.007
8 RCCV Drywell Mid-Height	4006	OTHR	2.310	0.209	0.052	-0.045	-0.536	0.044	-0.097	-0.294
		TEMP	1.875	0.839	-0.303	-12.243	-12.221	0.193	-0.156	-0.809
		EQEW	-0.964	1.376	-3.270	0.013	0.141	-0.094	0.037	-0.114
		EQNS	1.236	-0.186	-3.298	0.011	-0.325	-0.061	-0.071	0.239
		EQZ	-0.475	2.621	-0.082	0.173	0.558	0.047	-0.008	-0.247
		EQT	0.007	0.017	0.636	-0.005	-0.014	-0.024	0.001	-0.009
		SPKW	-0.011	0.024	-0.010	-0.002	0.000	0.010	-0.002	-0.002
		SPKN	-0.012	0.001	0.054	0.001	-0.004	-0.005	0.001	0.002
	4013	OTHR	1.982	-1.441	0.282	-0.075	-0.376	0.052	0.038	-0.103
		TEMP	1.199	-10.522	1.291	-12.197	-11.582	0.045	-0.165	-0.458
		EQEW	-1.100	3.208	0.978	0.060	0.305	0.005	-0.049	-0.319
		EQNS	-0.213	2.268	-3.816	0.015	-0.083	-0.085	0.017	0.120
		EQZ	-0.520	3.947	-0.244	0.053	0.440	0.001	0.007	-0.087
		EQT	0.087	-0.138	0.787	-0.005	-0.021	-0.003	-0.001	0.009
		SPKW	0.058	0.138	-0.015	0.012	0.004	-0.002	0.000	0.012
		SPKN	-0.060	-0.076	0.037	-0.010	-0.008	-0.001	0.000	-0.003
	4976	OTHR	1.388	-0.462	-0.168	0.043	-0.052	-0.004	-0.011	-0.233
		TEMP	-7.090	-6.964	0.636	-7.680	-8.654	0.012	0.038	-0.306
		EQEW	0.128	0.107	5.745	0.044	0.036	0.022	0.038	-0.014
		EQNS	-0.526	2.697	-0.249	-0.081	-0.180	-0.016	0.012	-0.035
		EQZ	-0.013	3.207	-0.184	0.019	0.202	0.005	0.007	-0.055
		EQT	0.037	-0.016	0.857	0.007	0.002	-0.027	0.007	0.000
		SPKW	-0.054	-0.052	0.004	-0.004	0.010	-0.002	0.000	-0.011
		SPKN	0.061	0.074	-0.005	0.006	-0.009	0.002	0.000	0.018

Table 3G.1-26

Combined Forces and Moments: RCCV, Selected Load Combination CV-11b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
9 RCCV Drywell Top	4406	OTHR	0.838	0.382	0.092	0.320	1.782	0.042	0.010	-0.674
		TEMP	6.737	0.276	-1.384	-11.629	-9.857	0.511	0.461	-0.604
		EQEW	-1.376	0.549	-2.744	0.128	0.524	-0.010	0.004	-0.226
		EQNS	1.239	-0.078	-2.463	-0.163	-0.895	0.060	0.075	0.195
		EQZ	-0.487	2.126	0.200	0.310	1.746	0.030	0.014	-0.374
		EQT	-0.061	-0.009	0.759	0.014	0.098	-0.019	-0.032	-0.039
		SPKW	-0.008	0.013	-0.021	0.001	0.009	0.006	0.008	-0.004
		SPKN	-0.013	0.000	0.060	0.000	-0.007	-0.003	-0.004	0.000
	4413	OTHR	0.396	-1.521	0.433	0.220	1.434	-0.073	0.098	-0.744
		TEMP	-0.979	-11.885	-0.375	-12.126	-10.998	0.410	-0.181	0.175
		EQEW	-0.918	2.449	0.849	0.026	0.943	0.165	0.052	-0.019
		EQNS	0.639	2.552	-3.237	-0.108	-0.448	-0.002	0.013	0.079
		EQZ	0.508	4.138	-0.095	0.163	0.891	-0.006	0.007	-0.163
		EQT	-0.015	-0.177	1.005	0.006	0.062	-0.009	0.001	-0.034
		SPKW	0.077	0.159	-0.005	-0.004	-0.055	0.001	0.000	0.024
		SPKN	-0.048	-0.073	0.032	-0.002	0.014	-0.001	0.000	-0.012
	4424	OTHR	1.006	-0.195	-0.129	0.324	1.693	0.020	0.000	-0.533
		TEMP	-10.166	-5.578	0.969	-7.106	-5.867	-0.070	-0.009	-1.762
		EQEW	0.263	0.047	6.065	0.046	-0.005	-0.003	0.040	0.029
		EQNS	-1.004	1.993	-0.209	-0.074	-0.379	-0.022	-0.007	-0.003
		EQZ	0.015	2.545	-0.148	0.030	0.339	-0.004	-0.001	-0.039
		EQT	0.063	-0.014	1.211	0.008	0.002	-0.018	-0.015	0.003
		SPKW	-0.012	-0.046	0.005	0.008	0.055	0.000	-0.001	-0.018
		SPKN	0.017	0.066	-0.005	-0.012	-0.078	0.000	0.001	0.027
10 Basemat @ Center	80003	OTHR	-1.902	-0.756	0.056	-3.823	-2.935	0.034	0.480	-0.403
		TEMP	-1.679	-2.344	-0.012	-8.432	-8.745	-0.031	0.023	-0.009
		EQEW	0.038	0.223	1.347	0.305	0.542	-0.514	0.018	0.897
		EQNS	3.094	2.293	-0.511	-7.882	-6.864	0.154	0.538	0.093
		EQZ	1.110	1.331	-0.056	-7.799	-8.005	0.028	-0.247	0.194
		EQT	0.031	-0.005	0.478	0.009	0.025	-0.083	0.014	0.032
		SPKW	0.652	-2.463	-0.002	0.452	0.434	-0.004	-0.011	-0.004
		SPKN	-2.623	0.639	0.027	0.492	0.405	-0.035	0.016	0.003
	80007	OTHR	-1.945	-0.779	0.041	-3.609	-2.906	0.052	0.220	-0.523
		TEMP	-1.684	-2.300	0.024	-8.412	-8.747	-0.031	0.015	-0.013
		EQEW	0.573	-0.211	0.796	0.709	0.790	-0.262	-0.006	0.862
		EQNS	3.129	2.486	-0.433	-7.171	-6.643	0.308	0.666	0.119
		EQZ	1.132	1.351	-0.047	-7.810	-8.003	0.027	0.036	0.313
		EQT	0.069	-0.063	0.398	0.033	0.042	-0.065	0.018	0.018
		SPKW	0.653	-2.466	-0.002	0.434	0.430	-0.005	-0.005	-0.003
		SPKN	-2.618	0.652	0.033	0.511	0.414	-0.029	0.011	0.003
	80012	OTHR	-2.021	-0.834	0.070	-3.388	-2.710	-0.065	-0.064	-0.257
		TEMP	-1.690	-2.227	0.016	-8.402	-8.767	-0.023	0.005	0.002
		EQEW	-0.120	0.176	0.666	0.115	0.115	0.122	-0.008	0.900
		EQNS	2.801	2.812	-0.255	-6.619	-6.341	0.091	0.746	0.004
		EQZ	1.129	1.387	-0.047	-7.807	-8.000	0.026	0.303	0.044
		EQT	0.014	-0.012	0.364	0.006	0.008	-0.044	0.005	0.010
		SPKW	0.663	-2.458	-0.001	0.438	0.437	-0.007	-0.002	-0.002
		SPKN	-2.621	0.659	0.031	0.509	0.419	-0.031	0.010	0.000

Table 3G.1-26

Combined Forces and Moments: RCCV, Selected Load Combination CV-11b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
11 Basemat Inside RPV Pedestal	80206	OTHR	-1.387	-0.719	0.141	-8.201	-7.462	1.854	1.800	-1.931
		TEMP	-1.712	-2.848	0.097	-8.908	-9.252	0.053	-0.011	-0.059
		EQEW	1.779	-0.230	2.679	3.698	4.686	-2.110	-0.626	1.546
		EQNS	3.728	1.278	-1.436	-9.997	-7.683	0.702	0.556	0.033
		EQZ	1.057	1.206	-0.090	-5.055	-5.495	-0.898	-1.046	0.926
		EQT	0.135	-0.069	0.661	-0.169	0.364	-0.276	0.124	0.220
		SPKW	0.476	-2.265	-0.017	0.007	0.953	-0.017	0.220	0.234
		SPKN	-2.505	0.389	0.007	0.952	-0.156	-0.016	-0.224	-0.233
	80213	OTHR	-1.653	-0.708	0.019	-5.866	-8.999	0.557	0.461	-2.525
		TEMP	-1.772	-2.262	0.036	-8.632	-9.316	-0.133	-0.013	-0.169
		EQEW	2.987	-0.462	0.727	4.768	7.922	-0.214	0.021	2.209
		EQNS	3.163	2.513	-2.028	-6.085	-4.599	1.367	0.861	0.777
		EQZ	1.134	1.393	-0.134	-5.967	-4.328	0.102	0.047	1.428
		EQT	0.300	-0.034	0.462	0.210	0.275	-0.002	0.129	0.033
		SPKW	0.327	-2.467	-0.041	-0.032	0.632	0.013	-0.011	0.124
		SPKN	-2.299	0.654	0.010	0.980	0.226	-0.032	0.001	-0.117
	80224	OTHR	-2.281	-1.497	0.066	-6.008	-5.101	-0.724	-1.477	-0.620
		TEMP	-1.625	-2.127	0.040	-8.608	-8.912	-0.042	-0.100	0.019
		EQEW	0.147	0.114	-1.880	0.484	0.394	1.018	0.080	0.432
		EQNS	2.483	4.246	-0.218	-0.049	-2.844	0.233	1.886	0.111
		EQZ	1.230	1.557	-0.051	-4.333	-6.041	0.156	1.375	0.112
		EQT	0.029	-0.009	-0.127	0.055	0.006	-0.149	0.011	-0.195
		SPKW	0.705	-2.121	0.002	0.206	0.885	0.018	-0.126	0.032
		SPKN	-2.626	0.377	0.026	0.753	0.024	-0.027	0.129	-0.015
12 S/P Slab @ RPV	83306	OTHR	-0.155	1.943	-0.534	-1.390	0.615	-0.129	3.469	-0.059
		TEMP	-11.644	3.829	0.179	-9.646	-8.196	0.033	-0.080	-0.040
		EQEW	-0.493	-0.422	0.892	1.324	0.614	-0.365	0.518	0.182
		EQNS	-0.353	-0.814	-1.453	-2.816	-1.585	-0.298	-1.007	0.148
		EQZ	-0.129	-0.373	0.192	-1.917	-1.346	0.009	-1.085	0.025
		EQT	-0.001	0.008	-0.051	0.058	0.025	-0.025	0.018	0.012
		SPKW	-0.525	-0.661	1.219	-0.042	-0.032	0.005	-0.031	0.007
		SPKN	-0.226	-0.402	-0.984	-0.010	-0.008	0.006	-0.004	-0.004
	83313	OTHR	0.472	1.618	-0.472	-1.246	0.716	-0.091	3.519	0.081
		TEMP	-11.916	4.301	-0.412	-9.666	-8.271	-0.027	-0.074	0.012
		EQEW	-0.972	-0.307	0.265	1.940	0.952	0.057	0.747	-0.005
		EQNS	-0.392	-1.414	0.724	-1.612	-1.010	-0.429	-0.553	0.176
		EQZ	-0.284	-0.266	0.051	-1.928	-1.341	-0.009	-1.090	-0.024
		EQT	-0.016	0.052	-0.095	0.101	0.051	0.003	0.036	0.003
		SPKW	-0.712	0.270	-0.098	-0.049	-0.025	0.000	-0.055	0.002
		SPKN	-0.210	-0.989	0.111	-0.022	-0.014	0.000	-0.001	-0.004
	83324	OTHR	1.539	1.916	-0.322	-0.921	0.982	-0.175	3.663	-0.074
		TEMP	-11.700	4.708	0.978	-9.527	-8.129	-0.001	0.005	0.006
		EQEW	-0.058	-0.047	-1.474	0.134	0.059	0.519	0.051	-0.251
		EQNS	-0.612	-0.175	0.190	-0.243	-0.272	-0.029	-0.036	0.018
		EQZ	-0.256	-0.391	0.019	-1.925	-1.341	0.015	-1.089	0.023
		EQT	0.002	-0.010	-0.243	0.009	0.005	0.028	0.003	-0.014
		SPKW	-0.226	-1.287	-0.130	-0.040	-0.036	0.000	-0.008	0.005
		SPKN	-0.524	0.272	0.062	-0.042	-0.013	-0.001	-0.050	-0.002

Table 3G.1-26

Combined Forces and Moments: RCCV, Selected Load Combination CV-11b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
13 S/P Slab @ Center	83406	OTHR	0.208	1.679	-0.484	-5.502	-1.661	-0.041	-0.461	0.000
		TEMP	-8.113	-0.586	-0.539	-9.089	-8.498	-0.001	-0.113	0.014
		EQEW	-0.360	-0.133	0.349	-0.242	0.242	-0.260	0.338	0.008
		EQNS	-0.294	-1.163	-1.325	0.403	-0.878	-0.230	-0.705	-0.010
		EQZ	-0.187	-0.348	0.142	0.901	-0.610	0.001	-0.486	0.000
		EQT	0.001	0.050	-0.002	0.005	0.010	-0.018	0.012	0.001
		SPKW	-0.448	-0.645	0.909	0.056	-0.005	-0.009	-0.024	0.012
		SPKN	-0.219	-0.371	-0.667	0.007	-0.005	0.011	-0.004	-0.005
	83413	OTHR	0.940	1.402	-0.159	-5.502	-1.615	-0.089	-0.424	0.004
		TEMP	-8.751	0.101	0.493	-9.200	-8.593	-0.013	-0.068	-0.007
		EQEW	-1.017	-0.152	0.191	-0.305	0.399	0.036	0.490	0.001
		EQNS	-0.303	-1.143	0.680	0.211	-0.628	-0.292	-0.403	0.009
		EQZ	-0.380	-0.198	0.016	0.891	-0.590	0.001	-0.490	-0.002
		EQT	-0.017	0.077	-0.041	-0.007	0.023	0.003	0.024	-0.001
		SPKW	-1.035	0.099	-0.050	0.123	0.022	0.001	-0.041	-0.001
		SPKN	-0.004	-0.786	0.023	-0.014	-0.013	-0.004	-0.002	0.001
	83424	OTHR	1.583	1.593	-0.178	-5.523	-1.453	-0.072	-0.358	0.003
		TEMP	-8.215	0.434	0.022	-9.166	-8.498	0.001	-0.042	0.006
		EQEW	-0.070	-0.035	-0.750	-0.021	0.021	0.360	0.034	0.005
		EQNS	-0.867	-0.199	0.099	0.031	-0.303	-0.018	-0.056	0.001
		EQZ	-0.327	-0.343	0.005	0.897	-0.590	0.002	-0.491	0.001
		EQT	0.002	-0.008	-0.137	-0.001	0.002	0.020	0.002	0.000
		SPKW	0.046	-1.045	-0.106	-0.012	-0.028	0.001	-0.006	-0.001
		SPKN	-0.830	0.080	0.053	0.113	0.027	-0.001	-0.036	0.001
14 S/P Slab @ RCCV	83506	OTHR	0.544	1.518	-0.363	3.067	-0.421	-0.033	-3.541	-0.003
		TEMP	-6.242	-2.430	-0.408	-8.821	-8.626	-0.045	-0.143	0.019
		EQEW	-0.145	-0.183	0.082	-1.213	-0.197	-0.032	0.273	-0.057
		EQNS	-0.142	-1.302	-1.091	2.375	0.032	-0.032	-0.543	-0.049
		EQZ	-0.183	-0.303	0.139	1.509	-0.005	0.009	-0.061	-0.005
		EQT	-0.008	0.086	0.017	-0.029	-0.006	-0.006	0.009	-0.002
		SPKW	-0.424	-0.631	0.740	0.114	0.030	-0.036	-0.017	0.012
		SPKN	-0.144	-0.282	-0.455	0.012	0.001	0.017	-0.001	-0.002
	83513	OTHR	1.213	1.366	-0.077	2.953	-0.407	-0.033	-3.513	-0.007
		TEMP	-7.029	-2.087	0.617	-9.213	-8.689	-0.011	-0.020	0.001
		EQEW	-0.917	-0.245	0.143	-1.685	-0.241	0.013	0.385	0.006
		EQNS	-0.268	-0.930	0.663	1.309	-0.079	-0.045	-0.310	-0.055
		EQZ	-0.395	-0.180	-0.010	1.525	0.016	0.003	-0.070	-0.003
		EQT	-0.012	0.098	-0.025	-0.076	-0.008	0.006	0.019	-0.001
		SPKW	-1.157	-0.104	-0.028	0.243	0.075	0.002	-0.033	0.000
		SPKN	0.097	-0.595	-0.048	-0.021	-0.007	-0.006	0.001	0.000
	83524	OTHR	1.540	1.479	-0.162	2.781	-0.355	-0.025	-3.466	-0.007
		TEMP	-6.242	-1.435	-0.072	-9.173	-8.644	0.017	-0.038	-0.005
		EQEW	-0.040	-0.061	-0.420	-0.124	-0.023	0.009	0.029	0.092
		EQNS	-0.904	-0.298	0.053	0.152	-0.213	0.000	-0.035	-0.004
		EQZ	-0.326	-0.339	0.001	1.536	0.015	0.001	-0.070	0.001
		EQT	0.008	-0.007	-0.092	-0.008	-0.001	0.001	0.002	0.005
		SPKW	0.176	-0.780	-0.090	-0.013	-0.012	0.003	-0.001	0.000
		SPKN	-0.976	-0.119	0.071	0.227	0.074	-0.003	-0.032	0.001

Table 3G.1-26

Combined Forces and Moments: RCCV, Selected Load Combination CV-11b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
15 Topslab @ Drywell Head Opening	98120	OTHR	0.526	0.901	1.197	0.687	0.515	0.256	0.364	-0.646
		TEMP	-11.552	-10.624	-5.088	7.064	5.010	5.160	-1.418	-1.083
		EQEW	-1.127	-0.929	-0.811	-0.056	-0.437	-0.148	-0.111	-0.105
		EQNS	0.281	0.042	0.123	-0.067	-0.093	-0.055	-0.055	-0.029
		EQZ	-1.049	-0.279	-0.390	0.418	0.251	0.276	-0.051	-0.286
		EQT	0.082	0.043	0.048	0.013	0.045	0.013	-0.005	-0.003
		SPKW	0.030	-0.009	0.008	-0.005	0.004	0.000	0.002	0.001
		SPKN	-0.032	-0.003	-0.013	0.003	-0.005	-0.001	-0.001	0.001
	98135	OTHR	0.213	-0.267	-0.507	0.495	-0.158	0.181	0.138	-0.996
		TEMP	-16.116	-6.978	2.414	10.532	-0.434	-1.821	1.058	-1.141
		EQEW	0.030	0.279	-0.487	-0.182	-0.215	0.083	0.029	-0.102
		EQNS	0.983	0.099	-0.149	-0.201	-0.006	0.014	-0.024	0.022
		EQZ	-2.538	-0.166	0.136	0.662	-0.249	-0.110	0.072	-0.336
		EQT	0.018	-0.014	0.031	0.002	0.007	-0.011	-0.012	0.005
		SPKW	0.085	0.008	-0.008	-0.008	0.002	-0.001	-0.001	0.002
		SPKN	-0.089	-0.011	0.013	0.005	-0.002	0.001	0.001	-0.001
	98104	OTHR	-0.169	1.999	-0.747	0.650	1.939	-0.202	-0.418	-0.622
		TEMP	-6.693	-12.082	2.871	2.391	11.786	-3.140	0.877	-0.610
		EQEW	0.347	0.488	-0.530	-0.010	-0.417	-0.023	0.037	-0.352
		EQNS	-0.055	-1.663	0.067	-0.066	-0.366	0.013	-0.045	0.019
		EQZ	-0.044	-0.600	0.042	0.204	1.305	-0.272	-0.011	-0.257
		EQT	-0.018	-0.021	0.028	-0.009	-0.022	0.014	-0.003	-0.009
		SPKW	-0.001	-0.048	0.001	-0.002	0.014	-0.001	-0.002	0.000
		SPKN	-0.004	0.029	0.004	0.000	-0.020	0.002	0.002	0.000
16 Topslab @ Center	98149	OTHR	0.610	1.297	-0.315	0.173	0.101	0.225	0.047	0.215
		TEMP	-11.296	-3.042	-1.890	5.802	8.895	0.962	0.549	-1.908
		EQEW	-1.027	-0.287	-0.558	-0.032	-0.226	-0.014	0.056	0.021
		EQNS	0.450	0.540	0.228	-0.114	0.038	-0.116	-0.056	0.024
		EQZ	-1.573	0.293	-0.499	0.768	0.364	-0.128	0.039	0.289
		EQT	0.089	-0.037	-0.014	0.007	0.017	-0.005	-0.009	-0.011
		SPKW	0.045	-0.022	-0.004	-0.006	0.009	-0.003	0.000	0.000
		SPKN	-0.046	-0.003	0.004	0.005	-0.006	0.001	-0.001	0.000
	98170	OTHR	0.571	1.027	-0.297	0.385	0.384	-0.004	-0.019	-0.068
		TEMP	-9.623	-4.570	-0.897	4.305	5.412	-0.102	-0.115	0.049
		EQEW	-1.067	0.053	-0.811	-0.018	-0.041	-0.012	0.022	-0.024
		EQNS	0.223	-0.296	0.240	-0.122	-0.159	-0.015	-0.024	-0.022
		EQZ	-1.210	0.089	-0.101	0.785	0.972	-0.053	-0.003	0.014
		EQT	0.067	0.032	-0.003	-0.002	0.008	-0.010	0.004	0.001
		SPKW	0.046	-0.007	-0.001	-0.003	0.012	0.001	0.000	0.003
		SPKN	-0.045	-0.003	0.009	0.003	-0.012	0.001	0.000	-0.002
	98109	OTHR	0.344	1.295	-0.301	0.747	1.427	-0.188	-0.022	-0.226
		TEMP	-7.853	-1.630	0.872	9.058	11.508	-0.323	0.767	0.077
		EQEW	0.103	-0.009	-0.648	-0.025	-0.205	-0.121	0.002	-0.119
		EQNS	0.124	-1.422	-0.076	-0.251	-0.419	-0.015	-0.074	0.067
		EQZ	-0.064	-0.446	-0.020	0.667	0.868	-0.147	-0.090	-0.060
		EQT	0.001	0.037	-0.011	-0.009	-0.019	0.006	-0.002	-0.013
		SPKW	0.017	-0.010	-0.002	-0.008	0.014	0.000	0.000	-0.001
		SPKN	-0.024	0.004	0.004	0.005	-0.019	-0.001	0.000	0.002

Table 3G.1-26

Combined Forces and Moments: RCCV, Selected Load Combination CV-11b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
17 Topslab @ RCCV	98174	OTHR	1.132	1.189	-0.036	-0.052	0.090	0.352	0.170	-0.164
		TEMP	-9.246	-4.000	-1.475	5.058	6.605	0.114	-0.062	0.290
		EQEW	-1.558	-0.285	-0.734	-0.272	-0.273	0.089	0.119	-0.127
		EQNS	0.057	1.170	0.209	0.166	0.142	-0.291	-0.094	0.055
		EQZ	-0.712	0.087	-0.213	0.774	0.772	0.157	0.163	-0.060
		EQT	0.144	-0.096	-0.013	-0.008	-0.045	0.014	0.000	-0.020
		SPKW	0.030	-0.011	-0.012	-0.009	0.013	-0.002	0.003	0.001
		SPKN	-0.033	-0.018	0.008	0.009	-0.010	-0.001	-0.002	-0.001
	98197	OTHR	0.886	1.296	-0.111	-0.214	-1.341	-0.062	-0.066	-0.786
		TEMP	-11.730	-4.691	-1.514	4.218	6.201	0.219	0.358	-0.440
		EQEW	-1.467	-0.076	-0.703	-0.029	-0.309	-0.031	-0.036	-0.004
		EQNS	0.190	-0.521	0.523	0.097	0.029	-0.112	0.026	0.134
		EQZ	-0.153	0.023	0.169	0.425	-1.039	-0.134	-0.048	-0.662
		EQT	0.039	0.081	-0.033	-0.018	-0.020	0.007	-0.004	-0.011
		SPKW	0.054	-0.024	0.001	0.004	0.005	0.002	0.001	0.000
		SPKN	-0.040	0.005	0.009	0.003	-0.003	0.000	0.000	0.002
	98103	OTHR	0.567	1.385	-0.269	-0.678	0.311	-0.268	-0.677	-0.170
		TEMP	-7.871	-5.553	-0.329	12.884	12.663	0.252	0.585	0.155
		EQEW	-0.205	0.204	-1.155	-0.035	-0.053	-0.209	0.040	-0.046
		EQNS	-0.121	-1.604	0.051	-1.192	-0.617	0.011	-0.274	0.018
		EQZ	0.196	-0.283	-0.064	-1.812	-0.296	-0.205	-0.905	-0.109
		EQT	-0.018	0.057	-0.193	0.003	0.005	-0.004	0.010	0.007
		SPKW	0.018	0.008	0.003	0.003	0.019	0.000	0.005	-0.001
		SPKN	-0.024	-0.011	-0.002	-0.015	-0.027	0.000	-0.008	0.001

Table 3G.1-27

Sectional Thicknesses and Rebar Ratios of RCCV Used in the Evaluation

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Direction 1*1		Direction2*1			
				Arrangement*2	Ratio (%)	Arrangement*2	Ratio (%)	Arrangement	Ratio (%)
1 RPV Pedestal Bottom	5006 5013 5024	2.4	Inside	2-#18@300	0.717	3-#18@3.6º	0.755	#9@1.8ºx300	1.007
			Outside	3-#18@300	1.075	3-#18@1.8º	1.510		
2 RPV Pedestal Mid-Height	6006 6013 6024	2.4	Inside	2-#18@300	0.717	3-#18@3.6º	0.755	#9@3.6ºx600	0.252
			Outside	3-#18@300	1.075	3-#18@1.8º	1.510		
3 RPV Pedestal Top	6606 6613 6624	2.4	Inside	2-#18@300 +1-#18@600	0.896	3-#18@3.6º	0.755	#9@1.8ºx300	1.007
			Outside	3-#18@300	1.075	3-#18@1.8º	1.510		
4 RCCV Wetwell Bottom	1806 1813 1824	2.0	Inside	2-#18@300	0.860	3-#18@0.9º +1-#18@3.6	1.405	#9@1.2ºx300	0.540
			Outside	3-#18@300	1.290	3-#18@0.9º +1-#18@1.8º	1.513		
5 RCCV Wetwell Mid-Height	2606 2613 2624	2.0	Inside	2-#18@300	0.860	2-#18@0.9º	0.865	#9@1.2ºx600	0.270
			Outside	3-#18@300	1.290	3-#18@0.9º	1.297		
6 RCCV Wetwell Top	3406 3413 3424	2.0	Inside	2-#18@300 +2-#18@600	1.290	2-#18@0.9º	0.865	#9@0.9ºx300	0.721
			Outside	3-#18@300 +1-#18@300	1.720	3-#18@0.9º +1-#18@0.9º	1.729		
7 RCCV Drywell Bottom	3606 3613 3624	2.0	Inside	2-#18@300 +1-#18@600	1.075	2-#18@0.9º	0.865	#9@0.9ºx300	0.721
			Outside	3-#18@300 +1-#18@300	1.720	3-#18@0.9º +1-#18@0.9º	1.729		
8 RCCV Drywell Mid-Height	4006 4013 4976	2.0	Inside	2-#18@300	0.860	2-#18@0.9º	0.865	#9@1.2ºx600	0.270
			Outside	3-#18@300	1.290	3-#18@0.9º	1.297		
9 RCCV Drywell Top	4406 4413	2.0	Inside	2-#18@300	0.860	2-#18@0.9º	0.865	#9@1.2ºx300	0.540
			Outside	3-#18@300	1.290	3-#18@0.9º	1.297		
	4424	2.0	Inside	2-#18@300	0.860	2-#18@0.9º (+1-#18@1.8º)	1.081	#9@1.2ºx300	0.540
			Outside	3-#18@300	1.290	3-#18@0.9º	1.297		

Note *1: RCCV, Pedestal Direction1: Hoop Direction2: Vertical
S/P Slab Direction1: Radial Direction2: Circumferential,
Top slab Direction1: N-S Direction2: E-W
Basemat @center Direction1: N-S Direction2 : E-W,
Basemat Inside RPV Pedestal Direction1: Top: Radial, Bottom: N-S Direction2: Top: Circumferential, Bottom: E-W

Note *2: Rebar in parentheses indicates additional bars locally required.

Table 3G.1-27

Sectional Thicknesses and Rebar Ratios of RCCV Used in the Evaluation (Continued)

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Direction 1*		Direction2*			
				Arrangement	Ratio (%)	Arrangement	Ratio (%)	Arrangement	Ratio (%)
10 Basemat @ Center	80003 80007 80012	5.1	Top	2-#11@120	0.329	2-#11@120	0.329	#9@600x600	0.179
			Bottom	5-#11@200	0.493	5-#11@200	0.493		
11 Basemat Inside RPV Pedestal	80206 80213 80224	5.1	Top	4-#11@1.8°	0.405	2-#11@200 +2-#11@400	0.296	#11@1.8°x400	1.292
			Bottom	5-#11@200	0.493	5-#11@200	0.493		
12 S/P Slab @ RPV	83306 83313 83324	2.0	Top	2-#18@1.8º	0.913	2-#18@300	0.860	#9@1.2ºx300	1.141
			Bottom	2-#18@1.8º	0.913	2-#18@300	0.860		
13 S/P Slab @ Center	83406 83413 83424	2.0	Top	2-#18@0.9º	1.264	2-#18@300	0.860	#9@1.8ºx600	0.263
			Bottom	2-#18@0.9º	1.264	2-#18@300	0.860		
14 S/P Slab @ RCCV	83506 83513 83524	2.0	Top	2-#18@0.9º	0.966	2-#18@300	0.860	#9@0.72ºx300	1.007
			Bottom	2-#18@0.9º	0.966	2-#18@300	0.860		
15 Top slab @ Drywell Head Opening	98120 98135	2.4	Top	3-#14@300	0.605	3-#14@300	0.605	#9@600x300	0.358
			Bottom	3-#14@300	0.605	3-#14@300	0.605		
	98104	2.4	Top	3-#14@300	0.605	3-#14@300 +1-#14#300	0.806	#9@600x300	0.358
			Bottom	3-#14@300	0.605	3-#14@300	0.605		
16 Top slab @ Center	98149 93109	2.4	Top	3-#14@300	0.605	3-#14@300 +1-#14@300	0.806	#9@600x600	0.179
			Bottom	3-#14@300	0.605	3-#14@300	0.605		
	98170	2.4	Top	3-#14@300	0.605	3-#14@300	0.605	#9@600x600	0.179
			Bottom	3-#14@300	0.605	3-#14@300	0.605		
17 Top slab @ RCCV	98174	2.4	Top	3-#14@300	0.605	3-#14@300	0.605	#9@600x600	0.179
			Bottom	3-#14@300	0.605	3-#14@300	0.605		
	98197	2.4	Top	3-#14@300	0.605	3-#14@300	0.605	#9@300x300	0.717
			Bottom	3-#14@300	0.605	3-#14@300	0.605		
	98103	2.4	Top	3-#14@300	0.605	3-#14@300 +1-#14@300	0.806	#9@300x300	0.717
			Bottom	3-#14@300	0.605	3-#14@300	0.605		

Note *: RCCV, Pedestal Direction1: Hoop Direction2: Vertical S/P Slab Direction1: Radial Direction2 : Circumferential,
Top slab Direction1: N-S Direction2: E-W Basemat @center Direction1: N-S Direction2 : E-W
Basemat Inside RPV Pedestal Direction1: Top:Radial, Bottom: N-S Direction2 Top: Circumferential, Bottom: E-W

Table 3G.1-28

Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-1

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
1 RPV	5006	-4.4	-15.5	-2.5	-3.1	-10.9	-25.8	310.2
Pedestal	5013	-4.7	-15.5	-4.2	-3.9	-10.9	-27.4	310.2
Bottom	5024	-4.3	-15.5	-3.1	-4.6	-10.5	-25.0	310.2
2 RPV	6006	-3.1	-15.5	33.4	23.2	-21.0	-17.4	310.2
Pedestal	6013	-3.1	-15.5	19.4	21.6	-21.1	-17.1	310.2
Mid-Height	6024	-2.1	-15.5	49.0	17.0	-13.8	-12.9	310.2
3 RPV	6606	-4.7	-15.5	29.6	6.6	-0.8	-25.4	310.2
Pedestal	6613	-4.6	-15.5	13.9	3.9	-5.2	-25.9	310.2
Top	6624	-4.3	-15.5	31.6	7.8	-4.6	-24.1	310.2
4 RCCV	1806	-4.8	-15.5	24.1	3.6	24.8	-17.4	310.2
Wetwell	1813	-5.1	-15.5	19.1	2.7	23.5	-18.6	310.2
Bottom	1824	-4.6	-15.5	31.5	5.7	18.4	-18.0	310.2
5 RCCV	2606	-1.4	-15.5	71.2	54.1	-11.9	1.4	310.2
Wetwell	2613	-1.7	-15.5	60.4	49.1	-16.1	1.9	310.2
Mid-Height	2624	-1.7	-15.5	73.3	52.4	-10.2	-2.1	310.2
6 RCCV	3406	-0.9	-15.5	49.7	34.2	2.5	-3.2	310.2
Wetwell	3413	-1.0	-15.5	40.9	31.3	-17.9	3.4	310.2
Top	3424	-0.6	-15.5	44.9	27.5	0.2	-5.8	310.2
7 RCCV	3606	-0.9	-15.5	59.0	32.6	13.3	-6.5	310.2
Drywell	3613	-1.3	-15.5	52.8	30.0	-5.4	-2.7	310.2
Bottom	3624	-0.7	-15.5	55.7	25.7	8.6	-10.5	310.2
8 RCCV	4006	-0.3	-15.5	46.1	33.2	0.2	14.4	310.2
Drywell	4013	-1.4	-15.5	44.9	35.9	-6.8	-1.3	310.2
Mid-Height	4976	-0.2	-15.5	51.0	29.1	-1.2	-0.9	310.2
9 RCCV	4406	-5.1	-15.5	37.5	8.8	94.1	1.5	310.2
Drywell	4413	-5.2	-15.5	12.2	2.5	35.7	-15.3	310.2
Top	4424	-5.2	-15.5	55.4	12.3	70.2	-6.7	310.2
10 Basemat	80003	-0.7	-12.4	-4.4	-2.8	-1.7	-1.7	310.2
@ Center	80007	-0.7	-12.4	-4.4	-3.0	-1.7	-1.7	310.2
	80012	-0.7	-12.4	-4.5	-3.0	-1.6	-1.7	310.2
11 Basemat	80206	-1.3	-12.4	-4.7	0.2	-3.0	1.9	310.2
Inside	80213	-1.2	-12.4	-2.8	-1.6	-4.4	6.4	310.2
RPV Pedestal	80224	-1.2	-12.4	-5.6	-0.6	-3.1	-0.4	310.2
12 S/P Slab	83306	-0.7	-15.5	13.9	20.8	72.8	12.1	310.2
@ RPV	83313	-0.2	-15.5	0.7	18.6	55.7	0.9	310.2
	83324	-0.2	-15.5	-3.2	22.1	67.6	15.8	310.2
13 S/P Slab	83406	-6.0	-15.5	-7.0	81.8	13.2	60.7	310.2
@ Center	83413	-5.6	-15.5	-4.9	83.1	5.5	46.3	310.2
	83424	-5.8	-15.5	-7.3	79.2	10.8	59.7	310.2
14 S/P Slab	83506	-3.7	-15.5	67.3	-12.6	25.7	18.0	310.2
@ RCCV	83513	-3.1	-15.5	69.8	-8.5	13.5	10.9	310.2
	83524	-3.9	-15.5	66.2	-14.4	28.5	19.0	310.2
15 Topslab	98120	-3.3	-15.5	107.6	12.3	115.3	22.7	310.2
@ Drywell Head	98135	-1.1	-15.5	5.0	-9.4	-5.8	5.6	310.2
Opening	98104	-4.3	-15.5	83.4	11.0	163.4	16.4	310.2
16 Topslab	98149	-1.0	-15.5	19.1	17.9	43.3	65.5	310.2
@ Center	98170	-1.7	-15.5	45.9	4.0	69.3	12.9	310.2
	98109	-4.0	-15.5	70.0	7.5	104.8	8.0	310.2
17 Topslab	98174	-3.3	-15.5	25.4	66.8	73.3	33.7	310.2
@ RCCV	98197	-2.7	-15.5	10.5	26.2	8.4	106.5	310.2
	98103	-3.6	-15.5	36.7	59.3	58.9	47.1	310.2

Note: Negative value means compression.
Note *: RCCV, Pedestal Direction1: Hoop Direction2: Vertical S/P Slab Direction1: Radial Direction2: Circumferential
Top slab Direction1: N-S Direction2 : E-W Basemat @center Direction1: N-S Direction2: E-W
Basemat Inside RPV Pedestal Direction1: Top :Radial, Bottom: N-S Direction2 Top: Circumferential, Bottom: E-W

Table 3G.1-29

Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-7a

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
1 RPV	5006	-9.2	-28.7	-6.1	-4.6	-23.4	-53.9	367.9
Pedestal	5013	-9.0	-28.7	-8.6	-6.6	-21.5	-52.5	367.9
Bottom	5024	-7.5	-28.7	-7.7	-7.2	-16.5	-43.0	367.9
2 RPV	6006	-7.9	-28.7	17.4	33.0	-50.6	-36.6	367.9
Pedestal	6013	-7.5	-28.7	8.1	30.0	-47.4	-29.1	367.9
Mid-Height	6024	-4.6	-28.7	24.8	22.3	-26.5	-18.6	367.9
3 RPV	6606	-6.6	-28.7	-5.7	-5.2	-39.2	-28.1	367.9
Pedestal	6613	-6.0	-28.7	-9.0	-5.9	-37.1	-26.4	367.9
Top	6624	-4.3	-28.7	-7.1	-7.1	-27.0	-24.0	367.9
4 RCCV	1806	-11.2	-29.0	50.1	10.1	105.8	-26.5	369.7
Wetwell	1813	-11.3	-29.0	93.6	31.6	101.1	-27.8	369.7
Bottom	1824	-12.3	-29.0	154.2	62.0	90.8	-33.1	369.7
5 RCCV	2606	-0.9	-29.1	128.5	120.3	-26.8	34.6	370.2
Wetwell	2613	-1.5	-29.1	84.9	97.5	-37.1	26.7	370.2
Mid-Height	2624	-1.4	-29.1	124.9	108.0	-39.0	43.2	370.2
6 RCCV	3406	-11.0	-29.1	70.3	90.2	-48.8	79.7	370.2
Wetwell	3413	-8.5	-29.1	42.8	68.4	33.0	27.9	370.2
Top	3424	-2.7	-29.1	168.0	126.2	-16.7	-6.9	370.2
7 RCCV	3606	-9.1	-28.7	113.0	130.6	65.5	58.0	367.8
Drywell	3613	-2.6	-28.7	84.9	114.3	-29.9	42.0	367.8
Bottom	3624	-2.8	-27.7	55.7	3.5	-11.5	-13.0	360.2
8 RCCV	4006	-0.6	-28.7	76.2	137.0	12.1	97.1	367.8
Drywell	4013	-1.9	-28.7	76.2	124.2	-9.3	31.1	367.8
Mid-Height	4976	-0.4	-27.7	37.0	18.5	-2.3	5.5	360.2
9 RCCV	4406	-6.9	-28.7	59.0	82.9	144.7	48.3	367.8
Drywell	4413	-2.4	-28.7	0.4	52.3	6.4	-12.5	367.8
Top	4424	-5.4	-27.7	11.6	4.3	77.2	-6.4	360.2
10 Basemat	80003	-5.1	-23.2	-3.7	60.4	0.2	67.9	370.2
@ Center	80007	-5.0	-23.2	-4.1	57.5	0.6	68.2	370.2
	80012	-5.0	-23.2	-5.0	53.4	-0.2	64.6	370.2
11 Basemat	80206	-10.3	-23.2	38.2	121.0	-10.6	112.8	370.2
Inside	80213	-8.4	-23.2	15.3	83.2	4.8	133.8	370.2
RPV Pedestal	80224	-7.5	-23.2	5.4	77.3	1.2	78.3	370.2
12 S/P Slab	83306	-6.2	-29.0	-38.7	75.4	112.2	59.4	369.8
@ RPV	83313	-2.2	-29.0	-72.4	138.4	127.6	63.9	369.8
	83324	-1.6	-29.0	-69.2	156.4	142.4	66.2	369.8
13 S/P Slab	83406	-19.6	-29.0	-28.4	236.2	33.5	216.1	369.8
@ Center	83413	-19.1	-29.0	-23.7	240.3	18.0	169.7	369.8
	83424	-18.1	-29.0	-21.0	249.1	15.4	166.9	369.8
14 S/P Slab	83506	-11.8	-29.0	186.4	-48.4	49.5	61.9	369.8
@ RCCV	83513	-0.9	-29.0	197.0	-104.2	69.6	155.4	369.8
	83524	-10.4	-29.0	184.9	-37.9	11.5	39.0	369.8
15 Topslab	98120	-6.8	-27.9	60.1	-6.7	140.3	26.1	361.7
@ Drywell Head	98135	-4.3	-27.9	27.6	-16.2	-1.0	3.6	361.7
Opening	98104	-6.6	-27.9	18.5	-3.0	175.0	7.0	361.7
16 Topslab	98149	-2.5	-28.0	4.2	-1.1	90.8	38.1	362.7
@ Center	98170	-4.2	-28.0	71.2	1.8	135.0	13.4	362.7
	98109	-3.6	-28.0	55.2	1.7	125.5	9.1	362.7
17 Topslab	98174	-4.1	-28.0	11.9	-3.0	114.5	9.0	362.7
@ RCCV	98197	-1.5	-28.0	79.7	28.9	35.0	121.2	362.7
	98103	-1.6	-28.0	2.9	10.5	62.6	23.2	362.7

Note: Negative value means compression.
Note *: RCCV, Pedesta Direction1: Hoop Direction2: Vertical S/P Slab Direction1: Radial Direction2: Circumferential
Top slab Direction1: N-S Direction2: E-W Basemat @center Direction1: N-S Direction2: E-W
Basemat Inside RPV Pedestal Direction1: Top :Radial, Bottom: N-S Direction2 Top: Circumferential, Bottom: E-W

Table 3G.1-30
Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-7b

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
1 RPV	5006	-7.9	-27.9	-27.3	-21.4	-16.9	-43.5	361.6
Pedestal	5013	-7.7	-27.9	-33.0	-26.7	-17.9	-42.2	361.6
Bottom	5024	-6.4	-27.9	-34.1	-29.1	-12.7	-33.1	361.6
2 RPV	6006	-8.0	-27.9	62.5	72.7	-47.2	-26.2	361.6
Pedestal	6013	-8.2	-27.9	47.0	75.7	-50.9	-19.7	361.6
Mid-Height	6024	-5.5	-27.9	79.2	67.8	-28.1	-11.5	361.6
3 RPV	6606	-6.4	-27.9	227.4	202.9	-5.8	-33.3	361.6
Pedestal	6613	-5.8	-27.9	205.9	203.0	-21.9	-36.7	361.6
Top	6624	-3.6	-27.9	225.1	191.7	28.5	-76.3	361.6
4 RCCV	1806	-8.0	-28.3	58.7	20.3	78.6	-18.9	364.4
Wetwell	1813	-9.7	-28.3	31.4	22.6	73.4	-23.2	364.4
Bottom	1824	-7.7	-28.3	46.9	19.8	64.1	-21.9	364.4
5 RCCV	2606	-1.0	-28.2	86.5	108.3	-49.7	60.0	363.8
Wetwell	2613	-2.4	-28.2	54.3	99.4	-45.8	31.5	363.8
Mid-Height	2624	-1.7	-28.2	89.8	99.7	-62.4	57.6	363.8
6 RCCV	3406	-7.1	-28.2	47.5	77.4	-29.1	70.4	363.8
Wetwell	3413	-2.6	-28.2	43.4	62.0	-45.3	23.1	363.8
Top	3424	-1.9	-28.2	36.0	42.5	-19.1	15.7	363.8
7 RCCV	3606	-6.6	-27.7	22.1	145.4	-6.4	74.2	360.2
Drywell	3613	-4.4	-27.7	9.4	115.6	-13.0	14.5	360.2
Bottom	3624	-2.2	-26.7	49.2	25.6	18.1	14.0	352.9
8 RCCV	4006	-6.2	-27.7	27.9	177.0	5.7	108.0	360.2
Drywell	4013	-3.5	-27.7	26.4	159.9	-3.9	57.3	360.2
Mid-Height	4976	-0.4	-26.7	37.5	52.8	-1.0	20.7	352.9
9 RCCV	4406	-3.3	-27.7	32.5	169.0	140.0	26.2	360.2
Drywell	4413	-4.9	-27.7	-7.9	64.5	13.1	-14.0	360.2
Top	4424	-2.5	-26.7	62.7	1.1	27.2	10.1	352.9
10 Basemat	80003	-4.5	-23.2	-0.7	62.0	3.9	72.3	370.2
@ Center	80007	-4.5	-23.2	-1.1	59.1	4.1	72.3	370.2
	80012	-4.5	-23.2	-1.7	55.6	3.8	69.7	370.2
11 Basemat	80206	-9.0	-23.2	39.0	106.8	-7.4	115.8	370.2
Inside	80213	-7.2	-23.2	16.7	79.4	7.1	124.6	370.2
RPV Pedestal	80224	-6.5	-23.2	7.5	69.2	4.7	80.0	370.2
12 S/P Slab	83306	-6.5	-28.3	-52.2	83.7	125.0	94.5	364.4
@ RPV	83313	-3.4	-28.3	-86.4	118.1	129.5	98.6	364.4
	83324	-14.9	-28.3	-43.5	135.1	103.1	105.7	364.4
13 S/P Slab	83406	-18.2	-28.3	-25.2	214.9	29.6	200.7	364.4
@ Center	83413	-18.5	-28.3	-26.9	215.4	20.5	179.0	364.4
	83424	-17.6	-28.3	-24.8	225.3	15.5	161.8	364.4
14 S/P Slab	83506	-1.0	-28.3	138.2	-86.1	27.9	122.3	364.4
@ RCCV	83513	-0.8	-28.3	153.9	-82.6	3.1	120.5	364.4
	83524	-0.4	-28.3	139.6	-71.9	9.9	111.4	364.4
15 Topslab	98120	-12.5	-26.2	106.2	-18.4	101.2	2.9	349.2
@ Drywell Head	98135	-8.5	-26.2	29.6	-37.7	-11.0	2.8	349.2
Opening	98104	-11.6	-26.2	14.9	-7.9	198.4	-13.1	349.2
16 Topslab	98149	-6.7	-26.6	-7.3	-19.9	253.5	22.5	352.0
@ Center	98170	-8.3	-26.6	99.8	-4.0	193.3	12.0	352.0
	98109	-7.0	-27.2	97.8	0.8	179.8	7.6	356.6
17 Topslab	98174	-7.6	-26.6	22.3	-10.1	226.3	19.8	352.0
@ RCCV	98197	-2.1	-26.6	77.4	21.5	47.3	114.1	352.0
	98103	-1.6	-27.2	22.1	4.1	95.4	10.9	356.6

Note: Negative value means compression.
Note *: RCCV, Pedestal Direction1: Hoop Direction2: Vertical S/P Slab Direction1: Radial Direction2: Circumferential,
Top slab Direction1: N-S Direction2: E-W Basemat @center Direction1: N-S Direction2: E-W
Basemat Inside RPV Pedesta Direction1: Top :Radial, Bottom: N-S Direction2 Top: Circumferential, Bottom: E-W

Table 3G.1-31
Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-11a

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
1 RPV	5006	-16.6	-28.7	27.1	76.0	-46.5	-90.1	367.9
Pedestal	5013	-17.7	-28.7	28.7	95.5	-46.3	-95.8	367.9
Bottom	5024	-10.0	-28.7	11.2	18.4	-39.9	-57.4	367.9
2 RPV	6006	-9.6	-28.7	28.2	36.4	-58.2	-46.6	367.9
Pedestal	6013	-9.2	-28.7	24.9	35.0	-61.8	-44.7	367.9
Mid-Height	6024	-7.7	-28.7	116.4	78.4	48.9	52.2	367.9
3 RPV	6606	-12.0	-28.7	-13.8	-11.7	-63.4	-34.8	367.9
Pedestal	6613	-11.2	-28.7	-18.7	-13.1	-60.6	-34.5	367.9
Top	6624	-7.0	-28.7	-13.1	-11.8	-39.9	-32.0	367.9
4 RCCV	1806	-13.9	-29.0	236.4	135.2	287.5	120.4	369.7
Wetwell	1813	-13.0	-29.0	218.6	125.6	277.8	109.8	369.7
Bottom	1824	-9.8	-29.0	343.6	200.0	281.6	113.5	369.7
5 RCCV	2606	-7.6	-29.1	285.7	210.9	223.6	236.9	370.2
Wetwell	2613	-6.8	-29.1	207.2	165.3	186.3	224.5	370.2
Mid-Height	2624	-9.1	-29.1	308.5	212.5	206.7	238.8	370.2
6 RCCV	3406	-11.7	-29.1	184.2	141.9	99.2	188.6	370.2
Wetwell	3413	-10.3	-29.1	146.4	122.8	135.5	156.8	370.2
Top	3424	-7.5	-29.1	272.0	197.4	143.5	118.0	370.2
7 RCCV	3606	-10.6	-28.7	252.2	195.0	102.1	193.7	367.8
Drywell	3613	-8.9	-28.7	178.3	178.7	177.2	167.8	367.8
Bottom	3624	-7.4	-27.7	170.4	67.4	134.8	73.5	360.2
8 RCCV	4006	-6.8	-28.7	206.8	219.2	163.8	211.2	367.8
Drywell	4013	-7.4	-28.7	214.7	201.1	134.7	136.1	367.8
Mid-Height	4976	-7.3	-27.7	234.8	141.7	175.7	155.3	360.2
9 RCCV	4406	-7.1	-28.7	204.1	210.0	273.5	159.9	367.8
Drywell	4413	-5.8	-28.7	108.9	152.5	164.5	133.1	367.8
Top	4424	-8.2	-27.7	229.6	144.9	226.6	143.3	360.2
10 Basemat	80003	-10.2	-23.2	-19.0	143.0	25.7	179.5	370.2
@ Center	80007	-9.8	-23.2	-20.0	135.9	26.0	178.4	370.2
	80012	-8.7	-23.2	-19.1	127.9	23.1	165.4	370.2
11 Basemat	80206	-17.5	-23.2	115.8	252.0	46.1	263.4	370.2
Inside	80213	-13.3	-23.2	52.4	163.4	30.9	276.4	370.2
RPV Pedestal	80224	-9.3	-23.2	-20.4	103.8	37.1	168.6	370.2
12 S/P Slab	83306	-15.3	-29.0	60.0	189.1	213.4	160.8	369.8
@ RPV	83313	-13.9	-29.0	70.2	181.4	224.8	144.4	369.8
	83324	-11.9	-29.0	-68.9	183.4	201.0	130.6	369.8
13 S/P Slab	83406	-17.7	-29.0	-35.9	209.8	37.0	204.2	369.8
@ Center	83413	-17.3	-29.0	-34.2	212.2	28.2	151.3	369.8
	83424	-17.0	-29.0	-29.9	229.8	25.6	147.5	369.8
14 S/P Slab	83506	-15.7	-29.0	252.9	-86.0	78.3	112.2	369.8
@ RCCV	83513	-14.7	-29.0	225.2	-99.3	88.2	143.7	369.8
	83524	-13.5	-29.0	172.2	-48.0	-31.7	65.9	369.8
15 Topslab	98120	-8.1	-27.9	178.5	-31.6	202.8	72.0	361.7
@ Drywell Head	98135	-4.9	-27.9	131.2	62.8	27.5	62.1	361.7
Opening	98104	-6.9	-27.9	38.2	42.1	187.2	84.3	361.7
16 Topslab	98149	-3.4	-28.0	42.8	39.5	97.5	36.3	362.7
@ Center	98170	-5.4	-28.0	73.2	35.6	143.4	51.2	362.7
	98109	-4.2	-28.0	86.0	15.8	160.1	69.0	362.7
17 Topslab	98174	-5.2	-28.0	82.3	58.8	156.5	35.1	362.7
@ RCCV	98197	-2.6	-28.0	92.7	73.2	118.5	118.5	362.7
	98103	-7.1	-28.0	109.2	63.0	132.9	61.0	362.7

Note: Negative value means compression.
Note *: RCCV, Pedestal Direction1: Hoop Direction2: Vertical S/P Slab Direction1: Radial Direction2: Circumferential,
Top slab Direction1: N-S Direction2: E-W Basemat @center Direction1: N-S Direction2: E-W,
Basemat Inside RPV Pedestal Direction1: Top: Radial, Bottom: N-S Direction2 Top: Circumferential, Bottom: E-W

Table 3G.1-32
Rebar and Concrete Stresses of RCCV: Selected Load Combination CV-11b

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
1 RPV	5006	-15.5	-27.9	-37.8	-32.8	-41.0	-80.9	361.6
Pedestal	5013	-16.6	-27.9	-41.2	-38.3	-43.7	105.7	361.6
Bottom	5024	-9.0	-27.9	-37.2	-33.5	-37.0	-48.8	361.6
2 RPV	6006	-9.9	-27.9	74.2	75.0	-54.3	-35.0	361.6
Pedestal	6013	-10.3	-27.9	72.2	77.7	-65.8	-36.6	361.6
Mid-Height	6024	-8.8	-27.9	160.6	130.3	50.9	97.1	361.6
3 RPV	6606	-8.5	-27.9	243.1	236.4	109.7	-104.7	361.6
Pedestal	6613	-8.6	-27.9	220.4	234.4	-82.1	-49.1	361.6
Top	6624	-7.8	-27.9	261.2	218.7	156.8	-107.8	361.6
4 RCCV	1806	-11.3	-28.3	237.2	152.1	261.3	163.6	364.4
Wetwell	1813	-11.6	-28.3	172.2	122.8	249.2	133.2	364.4
Bottom	1824	-9.0	-28.3	261.4	166.6	244.0	122.7	364.4
5 RCCV	2606	-7.6	-28.2	233.3	191.2	209.5	265.8	363.8
Wetwell	2613	-7.2	-28.2	187.6	175.1	150.2	239.2	363.8
Mid-Height	2624	-9.2	-28.2	265.2	200.2	179.5	265.4	363.8
6 RCCV	3406	-8.5	-28.2	165.1	133.9	103.8	176.1	363.8
Wetwell	3413	-7.2	-28.2	136.6	124.7	99.0	140.5	363.8
Top	3424	-7.3	-28.2	156.6	128.9	157.1	147.2	363.8
7 RCCV	3606	-7.5	-27.7	129.3	205.0	120.6	191.5	360.2
Drywell	3613	-7.8	-27.7	65.9	182.8	66.2	132.3	360.2
Bottom	3624	-7.1	-26.7	188.1	113.3	227.9	120.3	352.9
8 RCCV	4006	-8.4	-27.7	131.5	270.2	140.8	240.1	360.2
Drywell	4013	-7.7	-27.7	139.3	234.6	116.3	148.5	360.2
Mid-Height	4976	-7.5	-26.7	232.9	168.4	189.3	183.0	352.9
9 RCCV	4406	-8.4	-27.7	142.6	276.7	227.5	197.2	360.2
Drywell	4413	-7.4	-27.7	-87.4	189.7	165.8	129.2	360.2
Top	4424	-8.4	-26.7	270.5	139.9	151.9	211.8	352.9
10 Basemat	80003	-9.7	-23.2	18.1	152.0	31.1	190.7	370.2
@ Center	80007	-9.3	-23.2	-17.2	138.2	29.9	184.8	370.2
	80012	-8.2	-23.2	-16.3	130.2	26.4	170.3	370.2
11 Basemat	80206	-16.9	-23.2	128.2	261.6	58.0	280.6	370.2
Inside	80213	-12.6	-23.2	60.1	196.7	64.1	287.4	370.2
RPV Pedestal	80224	-8.4	-23.2	25.9	120.1	40.9	169.9	370.2
12 S/P Slab	83306	-16.7	-28.3	-68.4	198.0	227.0	188.6	364.4
@ RPV	83313	-15.9	-28.3	-89.9	178.4	227.1	176.5	364.4
	83324	-13.8	-28.3	-82.4	192.4	195.3	151.0	364.4
13 S/P Slab	83406	-17.8	-28.3	-40.6	195.3	37.0	201.4	364.4
@ Center	83413	-16.9	-28.3	-36.9	198.0	28.6	163.5	364.4
	83424	-17.0	-28.3	-31.1	219.1	25.0	148.3	364.4
14 S/P Slab	83506	-13.3	-28.3	200.4	-67.8	65.8	128.4	364.4
@ RCCV	83513	-13.0	-28.3	187.1	-80.2	25.5	104.0	364.4
	83524	-12.3	-28.3	130.4	-63.2	-35.8	100.1	364.4
15 Topslab	98120	-12.9	-26.2	177.2	-26.9	152.9	13.4	349.2
@ Drywell Head	98135	-8.5	-26.2	100.0	-42.0	-10.8	4.6	349.2
Opening	98104	-11.9	-26.2	59.0	-9.0	201.5	-26.0	349.2
16 Topslab	98149	-7.3	-26.6	-11.5	-24.6	253.4	21.2	352.0
@ Center	98170	-9.0	-26.6	109.3	-10.6	193.9	17.6	352.0
	98109	-6.7	-27.2	125.8	-9.7	204.8	32.7	356.6
17 Topslab	98174	-7.7	-26.6	83.9	-16.4	260.3	31.5	352.0
@ RCCV	98197	-4.7	-26.6	121.7	43.4	119.2	109.1	352.0
	98103	-8.7	-27.2	133.1	24.1	161.6	36.9	356.6

Note: Negative value means compression.
Note *: RCCV, Pedestal Direction1: Hoop Direction2: Vertical S/P Slab Direction1: Radial Direction2: Circumferential
Top slab Direction1: N-S Direction2: E-W Basemat @center Direction1: N-S Direction2: E-W
Basemat Inside RPV Pedestal Direction1: Top: Radial Bottom: N-S Direction2 Top: Circumferential, Bottom: E-W

Table 3G.1-33

Transverse Shear of RCCV

Location	Element ID	LOAD ID	Shear Force Q (MN/m)	d (m)	Shear Stress (MPa)			Shear Tie Ratio (%)	
					Vu	Vc	Vs	required	provided
1 RPV	5006	CV-11b	6.81	1.97	4.07	3.01	1.05	0.261	1.010
Pedestal	5013	CV-11b	7.63	1.97	4.56	3.24	1.32	0.327	1.010
Bottom	5024	CV-11b	4.94	1.97	2.95	2.51	0.45	0.111	1.010
2 RPV	6006	CV-7b	2.15	1.94	1.31	2.74	0.00	0.000	0.252
Pedestal	6013	CV-7b	2.57	1.94	1.56	2.69	0.00	0.000	0.252
Mid-Height	6024	CV-7b	2.12	1.94	1.29	2.31	0.00	0.000	0.252
3 RPV	6606	CV-7b	2.03	1.97	1.22	2.59	0.00	0.000	1.010
Pedestal	6613	CV-7b	2.04	1.97	1.22	2.56	0.00	0.000	1.010
Top	6624	CV-7b	1.83	1.97	1.09	2.42	0.00	0.000	1.010
4 RCCV	1806	CV-11a	1.90	1.59	1.41	0.50	0.91	0.222	0.540
Wetwell	1813	CV-11a	1.97	1.59	1.46	0.30	1.16	0.283	0.540
Bottom	1824	CV-11a	1.51	1.59	1.12	0.19	0.93	0.227	0.540
5 RCCV	2606	CV-11a	0.39	1.54	0.30	0.29	0.01	0.002	0.270
Wetwell	2613	CV-7a	0.17	1.54	0.13	1.88	0.00	0.000	0.270
Mid-Height	2624	CV-7a	0.31	1.54	0.24	1.12	0.00	0.000	0.270
6 RCCV	3406	CV-11b	1.02	1.59	0.76	0.38	0.37	0.092	0.721
Wetwell	3413	CV-1	0.05	1.67	0.03	0.03	0.00	0.000	0.721
Top	3424	CV-7b	0.34	1.59	0.26	1.29	0.00	0.000	0.721
7 RCCV	3606	CV-11b	0.58	1.67	0.41	0.25	0.16	0.041	0.721
Drywell	3613	CV-7a	0.60	1.61	0.44	0.80	0.00	0.000	0.721
Bottom	3624	CV-7b	0.04	1.60	0.03	0.03	0.00	0.000	0.721
8 RCCV	4006	CV-11a	0.45	1.57	0.34	0.00	0.34	0.082	0.270
Drywell	4013	CV-7b	0.32	1.54	0.24	1.36	0.00	0.000	0.270
Mid-Height	4976	CV-7b	0.52	1.54	0.40	1.64	0.00	0.000	0.270
9 RCCV	4406	CV-11a	0.91	1.68	0.64	0.42	0.22	0.054	0.540
Drywell	4413	CV-1	0.80	1.68	0.48	0.92	0.00	0.000	0.540
Top	4424	CV-11b	0.92	1.54	0.70	0.61	0.09	0.023	0.540
10 Basemat	80003	CV-7a	0.71	4.59	0.18	0.90	0.00	0.000	0.179
@ Center	80007	CV-7a	0.64	4.58	0.17	0.89	0.00	0.000	0.179
	80012	CV-7a	0.30	4.57	0.08	0.89	0.00	0.000	0.179
11 Basemat	80206	CV-11a	5.31	4.59	1.36	0.94	0.43	0.104	1.290
Inside	80213	CV-11a	5.35	4.61	1.37	0.97	0.39	0.095	1.290
RPV Pedestal	80224	CV-7a	1.82	4.61	0.47	0.92	0.00	0.000	1.290
12 S/P Slab	83306	CV-11a	5.38	1.53	4.15	1.97	2.18	0.531	1.140
@ RPV	83313	CV-11a	5.35	1.53	4.13	1.91	2.22	0.541	1.140
	83324	CV-11a	5.23	1.53	4.04	1.72	2.31	0.563	1.140
13 S/P Slab	83406	CV-1	0.13	1.76	0.08	0.08	0.00	0.000	0.263
@ Center	83413	CV-1	0.13	1.76	0.07	0.07	0.00	0.000	0.263
	83424	CV-1	0.16	1.76	0.09	0.09	0.00	0.000	0.263
14 S/P Slab	83506	CV-7a	5.20	1.53	4.01	0.90	3.11	0.757	1.010
@ RCCV	83513	CV-7a	5.24	1.53	4.04	0.80	3.24	0.789	1.010
	83524	CV-7a	5.17	1.53	3.99	0.75	3.24	0.789	1.010
15 Topslab	98120	CV-7b	1.25	1.95	0.76	1.73	0.00	0.000	0.358
@ Drywell Head	98135	CV-7b	1.70	2.00	1.00	1.84	0.00	0.000	0.358
Opening	98104	CV-11b	1.91	2.00	1.13	0.79	0.33	0.086	0.358
16 Topslab	98149	CV-7a	0.33	2.00	0.20	0.20	0.00	0.000	0.179
@ Center	98170	CV-1	0.14	1.94	0.07	0.07	0.00	0.000	0.179
	98109	CV-1	0.27	2.00	0.14	0.14	0.00	0.000	0.179
17 Topslab	98174	CV-1	0.28	1.96	0.14	0.14	0.00	0.000	0.179
@ RCCV	98197	CV-7b	1.62	2.00	0.95	0.82	0.14	0.034	0.717
	98103	CV-1	0.92	1.93	0.48	0.86	0.00	0.000	0.717

Table 3G.1-34

Tangential Shear of RCCV

Location	Element ID	Load ID	Section Forces			Thickness	Rebar Area (cm^2/m)		rAs/pAs	v_{so} (MPa)		v_u (MPa)	
			Nx/Ny (MN/m)	Nxl/Nyl (MN/m)	V (MN/m)	t (m)	Required rAs	Provided pAs		Calculated	Allowable	Calculated	Allowable $0.4f_c'-v_{so}$
1 RPV Pedestal Bottom	5006	CV-11a	-1.741	-8.275	1.548	2.40	179.4	431.3	0.416	0.65	4.41	0.65	13.15
		CV-11a	-7.071	-16.890	1.661	2.40	266.0	543.6	0.489	0.69	4.41	0.69	13.11
	5013	CV-11a	-2.255	-8.307	-0.504	2.40	163.0	431.3	0.378	0.21	4.41	0.21	13.59
		CV-11a	-7.530	-20.006	0.834	2.40	335.6	543.6	0.617	0.35	4.41	0.35	13.45
	5024	CV-11a	-2.105	-4.359	-3.423	2.40	92.3	431.3	0.214	1.43	4.41	1.43	12.37
		CV-11a	-7.042	-12.570	-1.354	2.40	150.5	543.6	0.277	0.56	4.41	0.56	13.24
2 RPV Pedestal Mid-Height	6006	CV-11b	0.982	-0.265	3.433	2.40	118.9	431.3	0.276	1.43	4.41	1.43	12.37
		CV-11a	-6.820	-12.871	2.812	2.40	170.7	543.6	0.314	1.17	4.41	1.17	12.63
	6013	CV-11b	0.702	-0.863	2.565	2.40	91.5	431.3	0.212	1.07	4.41	1.07	12.73
		CV-11a	-6.829	-13.708	1.345	2.40	186.6	543.6	0.343	0.56	4.41	0.56	13.24
	6024	CV-11b	1.014	-1.349	5.910	2.40	190.1	431.3	0.441	2.46	4.41	2.46	11.34
		CV-11a	-5.099	-6.178	-5.860	2.40	91.8	543.6	0.169	2.44	4.41	2.44	11.36
3 RPV Pedestal Top	6606	CV-11a	0.316	0.160	3.560	2.40	104.2	474.2	0.220	1.48	4.41	1.48	12.32
		CV-11a	-5.541	-9.664	3.422	2.40	126.6	543.6	0.233	1.43	4.41	1.43	12.37
	6613	CV-11b	0.163	-2.263	-0.999	2.40	70.8	474.2	0.149	0.42	4.41	0.42	13.38
		CV-11a	-5.702	-10.028	1.021	2.40	117.6	543.6	0.216	0.43	4.41	0.43	13.37
	6624	CV-11b	0.692	-1.979	4.194	2.40	143.2	474.2	0.302	1.75	4.41	1.75	12.05
		CV-11a	-5.426	-7.878	2.220	2.40	74.1	543.6	0.136	0.93	4.41	0.93	12.87
4 RCCV Wetwell Bottom	1806	CV-11b	0.147	0.034	6.907	2.00	189.5	430.0	0.441	3.45	4.41	3.45	10.35
		CV-11b	-2.367	7.288	-6.349	2.00	196.1	584.0	0.336	3.17	4.41	3.17	10.63
	1813	CV-11b	0.011	1.551	5.547	2.00	155.0	430.0	0.360	2.77	4.41	2.77	11.03
		CV-11b	-2.642	10.287	-2.342	2.00	212.4	584.0	0.364	1.17	4.41	1.17	12.63
	1824	CV-11b	0.369	-0.664	-8.513	2.00	239.3	430.0	0.556	4.26	4.41	4.26	9.54
		CV-11b	-2.690	5.071	-8.483	2.00	193.3	584.0	0.331	4.24	4.41	4.24	9.56

Note : Top and bottom lines for each element indicate evaluation results for hoop and vertical rebars, respectively.

Nomenclature:

Nx, Ny: axial forces in the hoop and vertical directions due to pressure and dead loads, respectively

Nxl, Nyl: axial forces in the hoop and vertical directions due to lateral loads, respectively

V: tangential shear due to lateral loads

v_{so}: tangential shear stress borne by orthogonal rebars (Refer to Table 3.8-3.)

Table 3G.1-34

Tangential Shear of RCCV (Continued)

Location	Element ID	Load ID	Section Forces			Thickness	Rebar Area (cm^2/m)		rAs/pAs	v_{so} (MPa)		v_u (MPa)	
			Nx/Ny (MN/m)	Nxl/Nyl (MN/m)	V (MN/m)	t (m)	Required rAs	Provided pAs		Calculated	Allowable	Calculated	Allowable $0.4f_c'-v_{so}$
5 RCCV Wetwell Mid-Height	2606	CV-11b	2.307	1.204	6.376	2.00	236.3	430.0	0.549	3.19	4.41	3.19	10.61
		CV-11b	-1.907	5.730	-6.170	2.00	175.0	433.0	0.404	3.08	4.41	3.08	10.72
	2613	CV-11b	2.062	1.477	5.453	2.00	207.2	430.0	0.482	2.73	4.41	2.73	11.07
		CV-11b	-2.372	8.215	-2.212	2.00	164.8	433.0	0.381	1.11	4.41	1.11	12.69
	2624	CV-11b	2.307	0.556	-7.683	2.00	268.9	430.0	0.625	3.84	4.41	3.84	9.96
		CV-11b	-2.228	4.201	-7.643	2.00	174.4	433.0	0.403	3.82	4.41	3.82	9.98
6 RCCV Wetwell Top	3406	CV-11b	2.208	1.152	5.857	2.00	219.7	602.0	0.365	2.93	4.41	2.93	10.87
		CV-11b	-1.369	4.151	-5.585	2.00	150.2	519.0	0.289	2.79	4.41	2.79	11.01
	3413	CV-11b	1.909	0.158	-5.380	2.00	195.9	602.0	0.325	2.69	4.41	2.69	11.11
		CV-11b	-2.116	5.690	-4.873	2.00	144.4	519.0	0.278	2.44	4.41	2.44	11.36
	3424	CV-11b	1.816	0.075	-6.790	2.00	231.2	602.0	0.384	3.39	4.41	3.39	10.41
		CV-11b	-1.629	3.419	-6.750	2.00	159.5	519.0	0.307	3.37	4.41	3.37	10.43
7 RCCV Drywell Bottom	3606	CV-11b	2.153	1.040	5.544	2.00	209.4	560.0	0.374	2.77	4.41	2.77	11.03
		CV-11b	-0.846	4.024	-5.193	2.00	153.8	519.0	0.296	2.60	4.41	2.60	11.20
	3613	CV-11b	1.922	0.846	4.957	2.00	186.7	560.0	0.333	2.48	4.41	2.48	11.32
		CV-11b	-1.625	5.266	-4.372	2.00	140.2	519.0	0.270	2.19	4.41	2.19	11.61
	3624	CV-11b	1.827	0.050	-6.458	2.00	222.6	560.0	0.397	3.23	4.41	3.23	10.57
		CV-11b	-1.082	3.190	-6.411	2.00	163.3	519.0	0.315	3.21	4.41	3.21	10.59
8 RCCV Drywell Mid-Height	4006	CV-11b	1.474	1.623	-5.004	2.00	180.9	430.0	0.421	2.50	4.41	2.50	11.30
		CV-11b	-0.358	3.292	-4.889	2.00	148.7	433.0	0.343	2.44	4.41	2.44	11.36
	4013	CV-11b	1.460	0.474	4.899	2.00	171.4	430.0	0.399	2.45	4.41	2.45	11.35
		CV-11b	-1.669	5.162	-4.218	2.00	134.2	433.0	0.310	2.11	4.41	2.11	11.69
	4976	CV-11b	1.392	0.204	-6.713	2.00	217.8	430.0	0.507	3.36	4.41	3.36	10.44
		CV-11b	-0.618	2.684	-6.663	2.00	176.4	433.0	0.407	3.33	4.41	3.33	10.47
9 RCCV Drywell Top	4406	CV-11b	0.560	0.926	-4.502	2.00	138.5	430.0	0.322	2.25	4.41	2.25	11.55
		CV-11b	-0.007	2.416	-4.502	2.00	137.1	433.0	0.317	2.25	4.41	2.25	11.55
	4413	CV-11a	0.134	-0.146	4.694	2.00	129.8	430.0	0.302	2.35	4.41	2.35	11.45
		CV-11b	-1.722	5.141	-3.715	2.00	124.1	433.0	0.287	1.86	4.41	1.86	11.94
	4424	CV-11b	1.010	0.237	-7.133	2.00	218.9	430.0	0.509	3.57	4.41	3.57	10.23
		CV-11b	-0.258	2.365	-7.083	2.00	193.7	476.0	0.407	3.54	4.41	3.54	10.26

Table 3G.1-35

Containment Liner Plate Strains (Max)

Category	Calculated Strain					Allowable Tension Allowable Compression
	Cylinder	Pedestal	DW Bottom	WW Bottom	Top Slab	
Test	0.0004 -0.0011	0.0004 -0.0006	0.0000 -0.0001	0.0002 -0.0002	0.0003 0.0001	0.002 -0.002
Normal Operation	0.0005 -0.0008	0.0004 -0.0010	0.0001 -0.0003	0.0004 -0.0006	0.0002 -0.0005	0.002 -0.002
Severe Environment	0.0005 -0.0008	0.0004 -0.0010	0.0001 -0.0003	0.0004 -0.0006	0.0002 -0.0005	0.003 -0.005
Extreme Environment	0.0005 -0.0008	0.0004 -0.0010	0.0001 -0.0003	0.0004 -0.0006	0.0002 -0.0005	0.003 -0.005
Abnormal ; LOCA	0.0005 -0.0036	0.0005 -0.0028	0.0001 -0.0003	0.0005 -0.0023	0.0003 -0.0017	0.003 -0.005
Abnormal/Extreme Environment	0.0014 -0.0045	0.0007 -0.0031	0.0002 -0.0004	0.0011 -0.0029	0.0006 -0.0018	0.003 -0.005

Table 3G.1-35

Containment Liner Plate Strains (Max) (Continued)

Category	Calculated Strain		Allowable Tension Allowable Compression
	DF Thick PLate	Pedestal Thick Plate	
Test	0.0005 -0.0002	0.0002 -0.0002	0.002 -0.002
Normal Operation	0.0002 -0.0005	0.0002 -0.0007	0.002 -0.002
Severe Environment	0.0002 -0.0005	0.0003 -0.0007	0.003 -0.005
Extreme Environment	0.0002 -0.0005	0.0003 -0.0007	0.003 -0.005
Abnormal ; LOCA	0.0005 -0.0017	0.0003 -0.0021	0.003 -0.005
Abnormal/Extreme Environment	0.0007 -0.0017	0.0004 -0.0022	0.003 -0.005

Table 3G.1-36

Drywell Head Elements Stress Summary

Service Level	PL		PL+Pb		PL+Pb+Q	
	Calculated Stress (MPa)	Allowable Stress (MPa)	Calculated Stress (MPa)	Allowable Stress (MPa)	Calculated Stress (MPa)	Allowable Stress (MPa)
Test Condition	77	262	77	262	-	-
Design Condition	66	227	66	227	-	-
A, B	82	227	82	227	797*1	456
C	122	342	122	342	-	-
D	122	430	122	430	-	-

*1 Acceptable by meeting all requirements for simplified elastic-plastic analysis stipulated in NE-3228.3 of ASME B&PV Code, Sec.III.

Table 3G.1-37

Diaphragm Floor (D/F) Slab Elements Stress Summary

Structural Elements	Member Size	Governing Load Combination	Stress or Stress Ratio	Allowable Stress	Acceptance Criteria*2
Top Plate*1	25mm	Normal Normal	σmin = -214MPa τmax = 107MPa	σ = 261MPa τ = 174MPa	1.0S 1.0S
Bottom Plate	25mm	Normal Abnormal/Extreme	σmax = 202MPa τmax = 150MPa	σ = 272MPa τ = 253MPa	1.0S 1.4S
Radial Web Plate (Upper Web)	25mm	Abnormal Abnormal/Extreme	σmin = -309MPa τmax = 235MPa	σ = 391MPa τ = 243MPa	1.5S 1.4S
Radial Web Plate (Lower Web)*1	25mm	Normal Abnormal/Extreme	σmin = -229MPa τmax = 226MPa	σ = 261MPa τ = 253MPa	1.0S 1.4S
Tangential Web Plate*1	25mm	Severe Abnormal/Extreme	σmin = -89MPa τmax = 100MPa	σ = 261MPa τ = 243MPa	1.0S 1.4S
Bottom Flange*1	38mm	Normal Normal	σmin = -186MPa τmax = 93MPa	σ = 269MPa τ = 181MPa	1.0S 1.0S

*1 Thermal stress associated with extreme and abnormal load conditions meets deformation limits of AISC N690 Subsection Q1.5.7.2. The total stress excluding thermal stress satisfies the allowable stress limit in Table Q1.5.7.1 of AISC N690.

*2 S = Allowable stress limit specified in part 1 of AISC N690.

Table 3G.1-38

Diaphragm Floor (D/F) Slab Anchorage Structural Capacity

Anchor Locations	Governing Load Combination	Design Load (kN)	No. of Anchor Bars Provided	Total Capacity (kN)	Acceptance Criteria*1
Top Plate	Normal (SIT)	736/deg	1-#18 @ 0.9 deg	782/deg	0.66Fy
Bottom Plate	Abnormal/Extreme	337/deg	1-#18 @ 0.9 deg	1066/deg	0.9Fy
Girder Radial Web Plate	Abnormal/Extreme	3885	5-#18	4804	0.9Fy
Girder Bottom Flange	Abnormal/Extreme	1255	5-#18	4804	0.9Fy

*1 F_y = Specified minimum yield stress.

Table 3G.1-39

Vent Wall Structural Elements Stress Summary

Structural Elements	Member Size	Governing Load Combination	Calculated Stress	Allowable Stress	Acceptance Criteria*1
Inner Cylinder	25mm	Abnormal/Extreme Abnormal/Extreme	σmin= -239MPa τmax= 146MPa	σ = 417MPa τ = 243MPa	1.6S 1.4S
Outer Cylinder	25mm	Abnormal Abnormal/Extreme	σmin = -264MPa τmax = 153MPa	σ = 408MPa τ = 253MPa	1.5S 1.4S
Radial Web Plate	25mm	Abnormal/Extreme Abnormal/Extreme	σmin = -299MPa τmax = 170MPa	σ = 417MPa τ = 243MPa	1.6S 1.4S

*1 S = Allowable stress limit specified in part 1 of AISC N690.

Table 3G.1-40

Reactor Shield Wall (RSW) Structural Element Stress Summary

Structural Element	Member Size	Governing Load Combination	Calculated Stress	Allowable	Acceptance Criteria*1
RSW Cylindrical Shell	210mm 210mm	Abnormal Abnormal/Extreme	σmin = -264MPa τmax = 140MPa	σ = 391MPa τ = 243MPa	1.5S 1.4S

*1 S = Allowable stress limit specified in part 1 of AISC N690.

Table 3G.1-41

RPV Support Bracket Structural Elements Stress Summary

Structural Elements	Member Size	Governing Load Combination	Stress or Stress Ratio	Allowable Stress	Acceptance Criteria*1
Horizontal Plate	150mm	Severe Severe	σmax = 77MPa τmax = 57MPa	σ = 141MPa τ = 94MPa	1.0S 1.0S
Vertical Plate	150mm	Severe Abnormal/Extreme	σmin = -115MPa τmax = 105MPa	σ = 141MPa τ = 131MPa	1.0S 1.4S

*1 S = Allowable stress limit specified in Part 1 of AISC N690.

Table 3G.1-42

Vent Wall and RPV Support Bracket Anchorage Structural Capacity

Anchor Locations	Governing Load Combination	Design Load (kN)	No. of Anchor Bars Provided	Total Capacity (kN)	Acceptance Criteria*1
Vent Wall	Abnormal/Extreme	1710/deg	4-#18 @ 1.8deg	2112/deg	0.9Fy
RPV Support Bracket	Abnormal/Extreme	35653	72-#18	69178	0.9Fy

*1 Fy = Specified minimum yield stress.

Table 3G.1-43

Gravity Driven Cooling System (GDCS) Pool Structural Elements Stress Summary

Structural Elements	Member Size	Governing Load Combination	Stress or Stress Ratio	Allowable Stress	Acceptance Criteria*2
Wall Plate	16mm	Abnormal Abnormal/Extreme	σmin= -385MPa τmax= 220MPa	σ = 391MPa τ = 243MPa	1.5S 1.4S
Vertical Column	550x550x25	Abnormal/Extreme Abnormal/Extreme	Ratio =0.80 τ = 103MPa	Ratio=1.0 τ = 243MPa	1.6S 1.4S
Vertical Column*1	800x800x65	Abnormal/Extreme Abnormal/Extreme	Ratio =0.95 τ = 97MPa	Ratio=1.0 τ = 243MPa	1.6S 1.4S
Horizontal Member *1	450x450x25	Severe Severe	Ratio =0.86 τ = 51MPa	Ratio=1.0 τ = 174MPa	S S
Bracing Member	350x350x35	Abnormal/Extreme Abnormal/Extreme	Ratio =0.81 τ = 36MPa	Ratio=1.0 τ = 243MPa	1.6S 1.4S

*1 Thermal stress associated with extreme and abnormal load conditions meets deformation limits of AISC N690 Subsection Q1.5.7.2. The total stress excluding thermal stress satisfies the allowable stress limit in Table Q1.5.7.1 of AISC N690.

*2 S = Allowable stress limit specified in Part 1 of AISC N690.

Table 3G.1-44

Gravity Driven Cooling System (GDCS) Pool Anchorage Structural Capacity

Anchor Locations	Governing Load Combination	Design Load/Anchor Bar (kN)	Capacity/Anchor Bar (kN)	Acceptance Criteria*1
Bracing Members @ RCCV Wall	Abnormal/Extreme	503	960	0.9Fy
Horizontal Members @ RCCV Wall	Abnormal/Extreme	609	960	0.9Fy

*1 F_y = Specified minimum yield stress.

Table 3G.1-45

Combined Forces and Moments: RB, Selected Load Combination RB-4

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall Below RCCV Bottom	6	OTHR	-1.555	-7.551	-0.221	-0.202	-1.479	-0.005	0.000	-0.341
		TEMP	1.537	-0.389	-0.755	0.122	1.228	-0.039	0.022	0.069
	13	OTHR	-1.526	-5.795	-0.068	-0.547	-2.891	0.007	-0.004	-0.799
		TEMP	0.573	-3.245	-0.807	0.465	2.632	-0.004	0.023	0.572
	24	OTHR	-1.090	-6.305	-0.197	-0.613	-3.702	0.000	0.001	-1.244
		TEMP	0.812	-3.383	0.147	0.479	2.672	-0.006	-0.001	0.591
19 Wall Below RCCV Mid-Height	806	OTHR	-1.566	-6.312	-0.138	-0.008	-0.036	-0.030	-0.017	-0.096
		TEMP	1.335	-1.376	0.086	0.195	1.043	0.090	-0.042	0.025
	813	OTHR	-2.076	-5.625	0.102	-0.040	0.061	-0.009	-0.004	-0.080
		TEMP	0.788	-3.166	-0.642	0.108	1.002	-0.027	0.008	0.597
	824	OTHR	-2.351	-6.242	-0.079	0.118	0.441	0.012	-0.001	0.099
		TEMP	0.632	-3.503	0.110	0.130	1.022	0.018	0.011	0.541
20 Wall Below RCCV Top	1606	OTHR	-1.036	-5.635	0.069	0.044	0.267	0.031	0.007	-0.191
		TEMP	9.010	-2.107	0.075	-0.519	-2.361	0.079	0.087	1.764
	1613	OTHR	-1.230	-5.395	0.239	0.017	0.251	-0.001	-0.002	-0.189
		TEMP	8.707	-3.627	-0.557	-0.634	-3.677	-0.003	-0.013	2.210
	1624	OTHR	-0.815	-5.799	-0.021	-0.015	-0.193	0.005	-0.008	0.004
		TEMP	9.370	-4.556	-0.128	-0.712	-3.635	-0.006	-0.066	2.270
21 Exterior Wall @ EL-11.50 ~-10.50m	20011	OTHR	-2.107	-3.832	-0.776	0.051	0.495	-0.020	0.056	0.243
		TEMP	3.346	3.376	0.619	0.260	0.956	0.073	-0.095	0.374
	20023	OTHR	-1.512	-1.519	-0.587	-0.013	-0.246	0.020	-0.032	-0.138
		TEMP	-1.202	-1.026	1.711	-4.074	-2.929	0.319	-0.451	0.888
	30010	OTHR	-1.729	-2.531	-0.418	-0.309	-1.708	0.020	0.018	1.154
		TEMP	0.012	2.369	-0.258	1.222	4.001	-0.027	0.008	-0.699
	30020	OTHR	-1.290	-1.597	-0.210	-0.698	-0.855	0.025	-0.256	0.369
		TEMP	-0.152	-1.327	-0.282	0.171	1.407	0.142	-0.038	-0.357
	40001	OTHR	-0.999	-1.835	0.308	-0.426	-1.296	-0.265	0.133	0.769
		TEMP	-0.207	-0.879	-0.090	0.222	1.540	-0.093	0.146	-0.398
	40011	OTHR	-1.636	-3.390	-0.031	-0.396	-2.268	-0.004	0.007	2.057
		TEMP	1.034	3.115	0.060	1.304	4.248	0.008	0.014	-0.764
22 Exterior Wall @ EL-4.65 ~-6.60m	22011	OTHR	-0.239	-3.267	0.764	-0.005	0.072	0.012	-0.024	0.114
		TEMP	2.502	2.926	-0.129	-0.095	-0.081	0.041	0.022	0.157
	22023	OTHR	-0.107	-1.769	0.030	0.006	0.018	-0.065	0.073	0.020
		TEMP	1.601	-4.856	-1.657	-0.085	-0.230	-0.268	0.163	-0.018
	32010	OTHR	-0.381	-2.070	0.002	-0.025	-0.085	0.000	0.001	-0.009
		TEMP	16.036	7.703	0.010	-3.506	-3.284	-0.002	-0.003	-0.224
	32020	OTHR	-0.049	-1.908	-0.002	-0.099	-0.076	-0.017	-0.039	0.020
		TEMP	0.404	5.234	2.979	-0.744	-2.379	-0.509	0.936	0.144
	42001	OTHR	-0.038	-1.995	-0.033	-0.085	-0.111	0.058	0.032	0.054
		TEMP	2.926	3.709	3.112	-0.956	-2.147	-0.063	-0.861	-0.349
	42011	OTHR	-0.558	-2.717	-0.050	-0.035	-0.167	0.003	0.006	0.024
		TEMP	13.980	5.191	0.087	-3.634	-3.197	0.101	0.088	-0.114
23 Exterior Wall @ EL22.50 ~24.60m	24211	OTHR	-0.229	-2.022	0.124	-0.079	-0.523	0.005	-0.005	-0.044
		TEMP	3.272	2.613	-0.551	-0.011	-0.312	0.059	-0.176	2.233
	24224	OTHR	-0.025	-1.198	0.369	0.065	-0.039	-0.047	-0.089	-0.024
		TEMP	0.171	4.961	-4.372	0.836	-0.314	-0.712	-0.803	-0.285
	34210	OTHR	-0.029	-0.875	0.015	-0.003	-0.056	0.001	0.003	0.000
		TEMP	17.409	5.777	-0.551	-3.634	-3.489	0.035	-0.012	-0.199
	34220	OTHR	0.042	-0.939	-0.187	0.044	-0.032	-0.008	0.047	0.002
		TEMP	2.055	4.894	2.977	0.865	-2.104	-0.558	1.943	0.152
	44201	OTHR	0.038	-1.112	-0.344	0.048	-0.014	0.018	-0.042	-0.003
		TEMP	1.124	5.800	-0.135	0.392	-2.344	0.549	-2.362	0.138

OTHR: Loads other than thermal loads

TEMP: Thermal loads

Table 3G.1-45

Combined Forces and Moments: RB, Selected Load Combination RB-4 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
24 Basemat @ Wall Below RCCV	90140	OTHR	-4.106	-3.413	-0.094	-2.175	-1.141	2.657	-2.117	1.893
		TEMP	1.135	1.784	1.674	0.944	-0.017	-1.153	-0.683	-0.134
	90182	OTHR	-3.767	-3.256	-0.029	0.476	-2.537	-0.110	0.012	0.535
		TEMP	2.061	0.574	0.684	-0.118	-3.977	0.195	-0.178	3.070
	90111	OTHR	-5.052	-3.293	0.001	-3.338	0.348	-0.364	0.095	0.137
		TEMP	0.681	3.097	-0.017	-4.388	-0.534	0.048	3.211	0.148
25 Slab EL4.65m @ RCCV	93140	OTHR	-0.521	-0.089	0.152	0.055	0.084	-0.060	0.132	-0.109
		TEMP	-0.870	2.100	3.409	-0.558	-0.425	0.308	-0.153	0.126
	93182	OTHR	-0.135	-0.248	0.040	0.007	0.000	0.002	-0.003	-0.050
		TEMP	3.041	-3.500	-1.015	-0.379	-1.920	-0.084	0.078	1.419
	93111	OTHR	-0.318	0.071	0.026	-0.068	-0.008	-0.003	0.012	-0.005
		TEMP	-3.107	3.899	-0.105	-1.891	-0.348	-0.047	1.246	0.002
26 Slab EL17.5m @ RCCV	96144	OTHR	-0.094	0.182	0.207	0.053	0.074	-0.057	0.129	-0.102
		TEMP	0.048	3.457	3.894	-0.195	-0.168	0.133	-0.035	0.056
	96186	OTHR	0.286	-0.076	0.011	-0.011	-0.045	-0.004	-0.001	-0.011
		TEMP	3.506	-2.460	-1.415	-0.131	-0.622	-0.043	0.023	0.501
	96113	OTHR	-0.058	0.660	-0.014	-0.275	-0.012	-0.013	0.301	0.036
		TEMP	-5.648	-4.996	-0.948	-4.724	-3.463	-0.182	0.955	-0.039
27 Slab EL27.0m @ RCCV	98472	OTHR	0.456	0.111	0.050	0.159	0.240	-0.199	0.229	-0.253
		TEMP	-0.625	-1.138	5.901	-0.551	-0.182	-0.203	0.424	-0.562
	98514	OTHR	0.049	0.181	0.075	0.024	0.057	0.025	-0.003	-0.136
		TEMP	-0.750	-3.185	-1.465	-0.688	-0.525	-0.028	0.049	-0.490
	98424	OTHR	-0.120	0.442	0.018	0.688	0.172	-0.051	-0.971	-0.067
		TEMP	-9.575	-16.671	-1.631	-8.137	-2.103	0.061	-6.814	0.070
28 Pool Girder @ Storage Pool	123054	OTHR	0.400	-2.583	-0.853	0.048	0.032	0.056	-0.011	-0.031
		TEMP	0.749	-3.964	1.813	2.884	2.796	0.040	-0.399	0.708
	123154	OTHR	1.274	-0.550	-0.663	0.078	0.032	0.102	0.018	0.011
		TEMP	1.144	0.863	-0.333	2.403	1.446	-0.432	-0.139	0.304
29 Pool Girder @ Cavity	123062	OTHR	0.466	0.629	0.346	-0.027	-0.178	0.030	0.001	-0.095
		TEMP	-3.706	-0.214	-0.653	0.128	0.181	0.046	-0.120	0.100
	123162	OTHR	-1.565	0.164	0.201	-0.079	-0.063	0.025	0.094	0.042
		TEMP	-3.280	-0.171	-0.663	0.096	-0.258	0.073	-0.236	0.126
30 Pool Girder @ Fuel Pool	123067	OTHR	0.513	-2.456	1.526	0.019	-0.049	-0.077	-0.126	-0.061
		TEMP	-3.838	-6.056	-2.084	0.711	0.512	-0.098	-0.148	0.667
	123167	OTHR	0.518	-0.622	1.328	0.042	0.025	0.018	-0.034	0.012
		TEMP	-3.563	-3.017	-2.711	0.236	-0.682	-0.302	0.025	0.198
31 MS Tunnel Wall and Slab	150122	OTHR	-0.024	0.031	0.299	0.026	0.059	0.018	-0.011	-0.040
		TEMP	0.348	-0.699	2.373	1.402	4.094	-0.043	-0.760	0.538
	96611	OTHR	-0.008	0.284	-0.012	0.078	-0.048	-0.051	-0.081	0.016
		TEMP	-0.316	3.590	-0.222	-1.462	-8.773	-0.478	0.477	0.241
	98614	OTHR	-0.022	-0.159	-0.020	0.020	-0.552	-0.067	-0.060	0.031
		TEMP	-0.230	2.953	-0.178	-0.937	-13.256	0.047	0.557	0.371

Table 3G.1-46

Combined Forces and Moments: RB, Selected Load Combination RB-8a

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall Below RCCV Bottom	6	OTHR	-3.155	-9.203	-0.129	0.491	2.506	-0.001	-0.010	1.004
		TEMP	1.107	-0.568	-0.679	0.118	1.100	-0.036	0.029	0.063
	13	OTHR	-2.576	-7.308	-0.157	0.080	0.714	0.008	-0.002	0.374
		TEMP	0.363	-3.011	-0.654	0.407	2.278	-0.002	0.019	0.473
	24	OTHR	-1.787	-6.996	-0.745	-0.125	-0.683	-0.009	0.016	-0.259
		TEMP	0.428	-3.036	0.150	0.424	2.345	-0.005	-0.001	0.512
19 Wall Below RCCV Mid-Height	806	OTHR	-1.512	-7.969	0.085	0.030	0.201	0.014	-0.010	-0.015
		TEMP	1.520	-1.444	0.161	0.260	1.324	0.084	-0.040	-0.084
	813	OTHR	-1.826	-7.286	-0.134	0.025	0.276	-0.017	0.010	0.142
		TEMP	1.025	-2.960	-0.498	0.172	1.284	-0.025	0.005	0.446
	824	OTHR	-1.928	-7.183	-0.811	0.131	0.562	-0.010	-0.004	0.188
		TEMP	0.901	-3.042	0.134	0.177	1.308	0.018	0.011	0.397
20 Wall Below RCCV Top	1606	OTHR	0.929	-7.392	0.065	-0.860	-4.878	0.014	0.013	1.339
		TEMP	11.606	-2.114	0.220	-0.682	-3.317	0.083	0.083	2.345
	1613	OTHR	0.778	-7.236	-0.106	-0.887	-4.986	-0.010	-0.011	1.446
		TEMP	11.216	-3.473	-0.445	-0.783	-4.373	-0.006	-0.013	2.707
	1624	OTHR	0.884	-7.048	-0.729	-0.812	-4.783	0.013	-0.019	1.418
		TEMP	12.199	-3.966	-0.117	-0.867	-4.482	-0.002	-0.082	2.818
21 Exterior Wall @ EL-11.50 ~-10.50m	20011	OTHR	-1.526	-2.982	0.320	0.524	2.120	-0.008	0.054	1.009
		TEMP	2.783	3.204	0.556	0.250	0.892	0.077	-0.085	0.330
	20023	OTHR	-1.159	-2.366	-0.701	-0.165	-0.066	0.035	0.093	-0.021
		TEMP	-0.928	-0.756	1.256	-3.151	-2.204	0.242	-0.326	0.699
	30010	OTHR	-0.891	-2.502	-1.001	0.084	0.314	-0.004	0.006	0.502
		TEMP	0.279	2.139	-0.239	1.005	3.442	-0.023	0.006	-0.574
	30020	OTHR	-0.969	-2.616	-0.575	-0.570	-0.857	0.026	-0.126	0.377
		TEMP	-0.088	-1.198	-0.236	0.082	1.103	0.123	-0.022	-0.270
	40001	OTHR	-0.701	-2.866	0.369	-0.431	-1.257	-0.206	-0.024	0.675
		TEMP	-0.155	-0.832	0.018	0.125	1.237	-0.081	0.115	-0.310
	40011	OTHR	-0.786	-3.246	-0.364	-0.098	-0.652	-0.001	0.001	1.350
		TEMP	0.876	2.784	0.049	1.074	3.671	0.007	0.012	-0.636
22 Exterior Wall @ EL-4.65 ~-6.60m	22011	OTHR	0.578	-4.347	1.842	-0.013	0.263	0.046	-0.031	0.443
		TEMP	3.512	2.672	-0.082	-0.124	-0.157	0.051	0.033	-0.023
	22023	OTHR	-0.019	-2.543	0.355	0.260	0.111	-0.127	0.032	0.030
		TEMP	1.402	-3.214	-1.242	0.313	-0.113	-0.213	-0.014	-0.031
	32010	OTHR	0.492	-2.278	-0.519	-0.047	-0.034	0.007	-0.001	-0.263
		TEMP	14.393	6.122	0.004	-2.798	-2.758	0.004	-0.008	0.041
	32020	OTHR	0.042	-2.514	-0.182	0.095	-0.035	-0.064	0.084	0.019
		TEMP	0.444	4.718	2.528	-0.284	-1.833	-0.377	0.922	0.167
	42001	OTHR	0.065	-2.585	-0.414	0.148	-0.060	0.066	-0.058	0.053
		TEMP	2.452	3.605	2.538	-0.370	-1.611	-0.058	-0.794	-0.254
	42011	OTHR	0.028	-2.759	-0.461	-0.058	-0.082	-0.008	0.011	-0.228
		TEMP	12.436	4.406	0.147	-2.976	-2.775	0.081	0.081	0.173
23 Exterior Wall @ EL22.50 ~24.60m	24211	OTHR	0.177	-2.474	0.588	-0.047	-0.265	-0.016	0.011	-0.031
		TEMP	3.817	2.954	-0.367	0.094	0.338	0.049	-0.142	1.510
	24224	OTHR	-0.040	-2.443	0.590	0.254	0.120	-0.055	-0.135	0.089
		TEMP	0.353	4.746	-3.617	0.874	-0.344	-0.444	-0.820	-0.411
	34210	OTHR	0.676	-0.895	-0.270	-0.016	0.019	0.022	-0.002	-0.014
		TEMP	15.330	4.791	-0.312	-2.778	-2.408	0.015	-0.011	0.104
	34220	OTHR	0.129	-1.662	-0.196	0.091	0.000	-0.039	0.071	0.007
		TEMP	1.720	4.438	2.296	0.979	-1.464	-0.240	1.609	0.013
	44201	OTHR	0.031	-1.788	-0.402	0.090	0.027	0.010	-0.072	-0.013
		TEMP	1.001	5.210	0.298	0.667	-1.698	0.337	-1.910	0.044

Table 3G.1-46

Combined Forces and Moments: RB, Selected Load Combination RB-8a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
24 Basemat @ Wall Below RCCV	90140	OTHR	-2.223	-2.611	0.168	-2.411	-1.408	0.998	-3.308	3.019
		TEMP	0.890	1.411	1.346	0.397	-0.251	-0.837	-0.696	-0.036
	90182	OTHR	-1.169	-2.190	-0.443	-1.048	-0.679	0.351	0.075	1.912
		TEMP	1.777	0.495	0.537	-0.265	-3.839	0.161	-0.125	2.759
	90111	OTHR	-3.615	-0.826	-0.020	-0.801	-0.814	-0.258	0.944	0.435
		TEMP	0.563	2.234	-0.012	-4.126	-0.521	0.053	2.855	0.124
25 Slab EL4.65m @ RCCV	93140	OTHR	-0.683	0.458	0.721	0.056	0.089	-0.113	0.107	-0.084
		TEMP	-0.598	2.335	4.275	-0.542	-0.409	0.304	-0.147	0.123
	93182	OTHR	0.680	-0.263	-0.045	-0.047	-0.006	0.012	0.006	0.181
		TEMP	4.223	-4.036	-1.099	-0.353	-1.823	-0.083	0.075	1.366
	93111	OTHR	-0.042	0.716	-0.141	0.058	-0.035	-0.001	0.083	-0.005
		TEMP	-3.605	4.959	-0.256	-1.768	-0.316	-0.047	1.178	0.000
26 Slab EL17.5m @ RCCV	96144	OTHR	0.082	0.635	1.339	-0.001	0.034	-0.043	0.112	-0.094
		TEMP	-0.270	4.701	6.966	-0.228	-0.122	0.166	-0.072	0.023
	96186	OTHR	1.289	-0.466	0.017	-0.062	-0.239	-0.010	0.012	0.158
		TEMP	6.688	-4.125	-1.417	-0.090	-0.313	-0.048	0.016	0.346
	96113	OTHR	-0.410	1.591	-0.345	-0.100	-0.034	-0.017	0.224	0.029
		TEMP	-8.342	2.577	-1.679	-4.480	-2.783	-0.199	1.239	-0.059
27 Slab EL27.0m @ RCCV	98472	OTHR	0.679	0.635	-0.134	-0.023	-0.043	0.008	0.164	-0.154
		TEMP	-0.766	-0.797	5.408	-0.313	0.033	-0.312	0.451	-0.562
	98514	OTHR	0.621	0.352	0.339	-0.065	-0.446	0.001	0.004	0.084
		TEMP	0.438	-2.394	-1.401	-0.532	-0.068	-0.006	0.036	-0.727
	98424	OTHR	-0.153	1.201	-0.166	-0.388	-0.144	-0.133	-0.134	-0.034
		TEMP	-7.591	-10.575	-1.415	-5.823	-1.582	0.072	-5.617	0.028
28 Pool Girder @ Storage Pool	123054	OTHR	0.119	0.874	1.051	0.054	0.039	-0.116	-0.070	-0.044
		TEMP	1.312	-2.833	1.438	2.280	2.119	0.026	-0.231	0.481
	123154	OTHR	-0.012	0.007	0.913	0.059	0.023	-0.108	-0.082	0.024
		TEMP	1.029	0.746	-0.399	1.924	1.145	-0.340	-0.086	0.247
29 Pool Girder @ Cavity	123062	OTHR	0.442	-1.072	-1.438	-0.018	0.156	-0.004	0.063	0.126
		TEMP	-1.258	-0.152	-0.701	0.103	0.324	0.027	0.057	0.173
	123162	OTHR	1.349	-0.368	-1.108	0.036	0.006	-0.006	-0.025	-0.039
		TEMP	-1.667	-0.034	-0.462	0.130	-0.117	-0.002	-0.152	0.085
30 Pool Girder @ Fuel Pool	123067	OTHR	0.137	2.418	-0.690	-0.016	-0.092	0.025	-0.031	-0.036
		TEMP	-2.311	-5.928	-1.779	0.647	0.431	-0.116	-0.149	0.467
	123167	OTHR	-0.850	0.617	-0.663	-0.010	-0.050	0.028	-0.074	-0.005
		TEMP	-2.108	-2.650	-2.209	0.276	-0.451	-0.231	-0.013	0.179
31 MS Tunnel Wall and Slab	150122	OTHR	0.059	-0.352	0.356	0.031	0.129	0.019	-0.007	-0.067
		TEMP	0.224	-0.517	1.902	1.053	3.141	-0.007	-0.584	0.363
	96611	OTHR	-0.038	0.652	-0.049	0.109	0.030	-0.040	-0.088	0.014
		TEMP	-0.447	4.104	-0.332	-1.287	-7.108	-0.423	0.426	0.209
	98614	OTHR	-0.010	-0.212	-0.018	-0.188	-1.042	-0.143	0.006	0.060
		TEMP	-0.188	1.992	-0.146	-0.862	-10.483	-0.011	0.470	0.303

Table 3G.1-47

Combined Forces and Moments: RB, Selected Load Combination RB-8b

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall Below RCCV Bottom	6	OTHR	-2.866	-7.963	-0.227	0.438	2.214	-0.004	-0.003	0.894
		TEMP	0.673	-1.073	-0.904	0.256	1.958	-0.049	0.048	0.311
	13	OTHR	-2.375	-6.214	-0.189	0.060	0.577	0.007	-0.002	0.314
		TEMP	-0.119	-4.048	-0.748	0.603	3.352	-0.002	0.023	0.782
	24	OTHR	-1.697	-5.984	-0.626	-0.115	-0.672	-0.008	0.014	-0.264
		TEMP	0.118	-3.760	0.215	0.593	3.309	-0.007	-0.003	0.776
19 Wall Below RCCV Mid-Height	806	OTHR	-1.371	-6.706	-0.030	0.028	0.190	0.008	-0.012	-0.020
		TEMP	1.824	-2.260	0.204	0.332	1.720	0.091	-0.055	-0.103
	813	OTHR	-1.702	-6.182	-0.149	0.019	0.262	-0.016	0.012	0.119
		TEMP	1.349	-3.956	-0.557	0.219	1.696	-0.032	0.005	0.598
	824	OTHR	-1.857	-6.078	-0.664	0.131	0.532	-0.007	-0.003	0.181
		TEMP	1.162	-3.729	0.206	0.225	1.731	0.027	0.015	0.503
20 Wall Below RCCV Top	1606	OTHR	0.967	-6.094	-0.011	-0.756	-4.287	0.017	0.012	1.186
		TEMP	15.858	-3.186	0.301	-0.853	-4.075	0.108	0.100	3.080
	1613	OTHR	0.752	-6.139	-0.084	-0.777	-4.333	-0.009	-0.011	1.261
		TEMP	15.698	-4.645	-0.441	-1.003	-5.526	-0.010	-0.016	3.605
	1624	OTHR	0.831	-5.855	-0.583	-0.708	-4.192	0.012	-0.018	1.247
		TEMP	16.701	-4.840	-0.100	-1.115	-5.550	0.000	-0.106	3.700
21 Exterior Wall @ EL-11.50 ~-10.50m	20011	OTHR	-1.555	-2.942	0.123	0.443	1.815	-0.007	0.053	0.851
		TEMP	3.065	4.610	0.680	0.386	1.389	0.095	-0.105	0.549
	20023	OTHR	-1.158	-2.135	-0.681	-0.138	-0.099	0.030	0.062	-0.044
		TEMP	-0.923	-0.709	1.214	-3.198	-2.113	0.237	-0.314	0.735
	30010	OTHR	-0.980	-2.458	-0.859	0.046	0.113	-0.004	0.006	0.562
		TEMP	0.517	3.114	-0.366	1.209	4.571	-0.033	-0.002	-0.827
	30020	OTHR	-0.955	-2.364	-0.497	-0.576	-0.815	0.028	-0.135	0.360
		TEMP	-0.057	-1.480	-0.391	0.022	1.207	0.144	-0.026	-0.281
	40001	OTHR	-0.707	-2.591	0.375	-0.421	-1.192	-0.208	-0.001	0.656
		TEMP	-0.091	-1.142	0.059	0.040	1.330	-0.097	0.105	-0.322
	40011	OTHR	-0.916	-3.118	-0.314	-0.102	-0.698	0.001	0.001	1.363
		TEMP	1.307	3.629	0.056	1.243	4.651	0.011	0.014	-0.842
22 Exterior Wall @ EL-4.65 ~-6.60m	22011	OTHR	0.585	-3.835	1.533	-0.011	0.232	0.038	-0.031	0.376
		TEMP	5.013	4.358	-0.217	-0.171	-0.224	0.069	0.046	0.082
	22023	OTHR	-0.015	-2.268	0.264	0.251	0.101	-0.119	0.022	0.023
		TEMP	1.628	-2.769	-1.390	0.748	-0.043	-0.218	-0.198	-0.044
	32010	OTHR	0.539	-2.124	-0.406	-0.042	-0.011	0.009	0.000	-0.234
		TEMP	16.724	7.722	-0.080	-2.893	-3.002	-0.001	-0.014	0.024
	32020	OTHR	0.042	-2.295	-0.041	0.089	-0.026	-0.072	0.076	0.025
		TEMP	0.652	4.868	2.520	0.104	-1.860	-0.395	1.226	0.199
	42001	OTHR	0.058	-2.345	-0.268	0.140	-0.054	0.067	-0.053	0.054
		TEMP	2.721	3.799	2.647	0.131	-1.563	-0.051	-0.998	-0.239
	42011	OTHR	0.069	-2.454	-0.362	-0.049	-0.063	-0.008	0.010	-0.209
		TEMP	14.114	5.515	0.239	-3.165	-3.047	0.073	0.090	0.170
23 Exterior Wall @ EL22.50 ~24.60m	24211	OTHR	0.341	-2.110	0.460	-0.014	-0.096	-0.006	0.012	-0.156
		TEMP	5.670	5.757	-0.305	0.173	0.680	0.046	-0.169	1.421
	24224	OTHR	-0.028	-2.235	0.423	0.193	0.095	-0.038	-0.102	0.062
		TEMP	1.023	5.452	-3.719	1.968	0.070	-0.635	-1.559	-0.317
	34210	OTHR	0.789	-0.814	-0.185	-0.010	0.093	0.016	-0.002	0.016
		TEMP	21.820	5.544	-0.576	-2.904	-2.819	0.035	-0.002	-0.128
	34220	OTHR	0.121	-1.640	-0.101	0.084	0.020	-0.028	0.062	0.002
		TEMP	2.793	5.435	4.410	2.628	-1.178	-0.711	2.570	0.094
	44201	OTHR	0.031	-1.717	-0.240	0.089	0.036	0.005	-0.061	-0.014
		TEMP	1.791	6.589	0.558	2.230	-1.491	0.539	-2.966	0.044

Table 3G.1-47

Combined Forces and Moments: RB, Selected Load Combination RB-8b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
24 Basemat @ Wall Below RCCV	90140	OTHR	-2.516	-2.587	0.220	-1.659	-0.819	0.655	-2.886	2.569
		TEMP	0.676	1.652	1.723	-0.528	-1.081	-0.960	-1.149	0.173
	90182	OTHR	-1.356	-2.262	-0.357	-0.833	-0.181	0.345	0.030	1.458
		TEMP	2.064	0.701	0.416	-0.892	-5.505	0.237	-0.094	3.815
	90111	OTHR	-3.682	-1.099	-0.029	-0.445	-0.650	-0.197	0.607	0.361
		TEMP	0.729	2.934	-0.023	-5.319	-1.147	0.110	3.683	0.149
25 Slab EL4.65m @ RCCV	93140	OTHR	-0.583	0.409	0.666	0.080	0.104	-0.117	0.114	-0.092
		TEMP	-0.316	3.040	5.795	-0.766	-0.578	0.430	-0.204	0.176
	93182	OTHR	0.630	-0.231	-0.021	-0.033	0.028	0.011	0.003	0.129
		TEMP	6.154	-5.153	-1.520	-0.480	-2.502	-0.114	0.105	1.898
	93111	OTHR	-0.029	0.633	-0.125	0.069	-0.026	-0.001	0.057	-0.005
		TEMP	-4.497	6.824	-0.447	-2.369	-0.414	-0.066	1.593	0.001
26 Slab EL17.5m @ RCCV	96144	OTHR	0.093	0.750	1.325	0.061	0.079	-0.074	0.124	-0.106
		TEMP	0.733	5.828	8.140	-0.230	-0.175	0.172	-0.041	0.066
	96186	OTHR	1.386	-0.530	-0.044	-0.037	-0.118	-0.003	0.006	0.058
		TEMP	9.998	-4.559	-2.164	-0.149	-0.672	-0.057	0.023	0.636
	96113	OTHR	-0.544	1.790	-0.351	0.107	0.013	-0.003	0.065	0.017
		TEMP	-9.167	5.153	-1.808	-4.376	-2.755	-0.236	1.009	-0.100
27 Slab EL27.0m @ RCCV	98472	OTHR	0.625	0.691	-0.143	-0.010	-0.027	0.022	0.176	-0.168
		TEMP	-3.634	-3.174	5.923	-1.728	-1.314	-0.297	0.535	-0.686
	98514	OTHR	0.545	0.407	0.257	-0.055	-0.419	-0.003	0.006	0.023
		TEMP	-2.861	-2.861	-1.575	-1.927	-1.717	-0.031	0.065	-0.722
	98424	OTHR	-0.197	1.457	-0.147	-0.585	-0.156	-0.145	-0.115	-0.029
		TEMP	-6.661	-7.075	-2.107	-3.864	-0.717	0.116	-5.743	0.001
28 Pool Girder @ Storage Pool	123054	OTHR	0.130	1.452	1.564	0.063	0.032	-0.156	-0.068	-0.060
		TEMP	3.582	1.292	2.390	3.612	2.453	-0.343	0.113	0.316
	123154	OTHR	-0.159	0.085	1.366	0.067	0.032	-0.166	-0.096	0.029
		TEMP	3.638	3.573	-2.903	3.370	1.304	-0.375	-0.255	0.413
29 Pool Girder @ Cavity	123062	OTHR	0.389	-1.455	-1.722	-0.023	0.218	-0.006	0.081	0.164
		TEMP	0.502	0.112	-1.366	3.839	3.894	0.009	0.033	0.189
	123162	OTHR	2.209	-0.498	-1.300	0.050	0.019	-0.013	-0.040	-0.050
		TEMP	1.956	0.408	-1.831	3.805	2.820	0.092	-0.289	0.644
30 Pool Girder @ Fuel Pool	123067	OTHR	0.112	2.634	-1.406	-0.031	-0.094	0.045	-0.016	-0.050
		TEMP	-2.007	-7.205	-2.944	3.600	3.532	-0.636	0.318	0.813
	123167	OTHR	-0.814	0.624	-1.345	-0.010	-0.056	0.029	-0.074	0.000
		TEMP	-0.584	-2.758	-3.092	2.757	1.832	-0.245	-0.178	0.615
31 MS Tunnel Wall and Slab	150122	OTHR	0.064	-0.395	0.374	0.026	0.127	0.017	-0.006	-0.073
		TEMP	0.316	-0.714	1.798	0.940	3.102	0.011	-0.551	0.426
	96611	OTHR	-0.051	0.768	-0.055	0.087	-0.021	-0.046	-0.080	0.016
		TEMP	-0.557	4.665	-0.414	-1.253	-7.115	-0.406	0.420	0.206
	98614	OTHR	-0.008	-0.290	-0.015	-0.234	-1.121	-0.157	0.020	0.063
		TEMP	-0.043	0.730	-0.044	-0.852	-9.932	-0.019	0.460	0.307

Table 3G.1-48

Combined Forces and Moments: RB, Selected Load Combination RB-9a

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall Below RCCV Bottom	6	OTHR	-2.700	-8.863	-0.089	0.324	1.541	-0.001	-0.010	0.673
		TEMP	1.107	-0.568	-0.679	0.118	1.100	-0.036	0.029	0.063
		EQEW	4.233	10.965	-4.292	-0.722	-3.492	-0.050	0.149	-1.466
		EQNS	-4.083	-2.977	-3.250	0.947	5.610	0.025	0.009	2.083
		EQZ	-0.369	6.045	-0.433	0.327	2.162	-0.011	0.033	0.697
		EQT	0.678	0.159	0.632	-0.044	-0.288	-0.014	0.027	-0.154
		SPKW	-0.614	0.143	-0.331	-0.051	-0.209	-0.033	0.058	-0.022
		SPKN	-0.469	0.023	-0.061	0.014	0.100	0.011	-0.018	0.074
	13	OTHR	-2.247	-7.027	-0.114	-0.071	-0.157	0.008	-0.003	0.089
		TEMP	0.363	-3.011	-0.654	0.407	2.278	-0.002	0.019	0.473
		EQEW	4.825	10.405	0.411	-0.322	-2.045	-0.014	0.031	-1.063
		EQNS	0.052	2.819	-3.746	0.608	3.221	-0.054	0.099	0.998
		EQZ	-0.498	4.718	-0.323	0.569	3.088	-0.003	0.004	0.952
		EQT	0.561	0.147	0.719	-0.086	-0.389	-0.010	0.018	-0.179
		SPKW	0.172	0.088	0.079	-0.046	-0.641	0.001	-0.002	-0.304
		SPKN	-1.117	-0.011	-0.229	0.003	0.265	0.001	0.001	0.206
	24	OTHR	-1.523	-6.962	-0.637	-0.255	-1.451	-0.006	0.012	-0.500
		TEMP	0.428	-3.036	0.150	0.424	2.345	-0.005	-0.001	0.512
		EQEW	0.620	0.744	6.330	0.012	-0.156	0.097	-0.142	-0.100
		EQNS	2.853	8.172	-0.025	0.203	1.099	-0.007	0.001	0.037
		EQZ	-0.464	5.193	0.150	0.595	3.234	-0.005	0.001	0.976
		EQT	0.080	0.012	0.993	0.002	-0.026	-0.005	0.008	-0.015
		SPKW	-1.094	0.022	0.063	0.015	0.350	0.003	-0.006	0.242
		SPKN	0.141	0.062	-0.055	-0.056	-0.696	-0.005	0.006	-0.333
19 Wall Below RCCV Mid-Height	806	OTHR	-1.439	-7.641	0.075	0.023	0.148	0.005	-0.010	-0.035
		TEMP	1.520	-1.444	0.161	0.260	1.324	0.084	-0.040	-0.084
		EQEW	0.709	8.375	-5.149	-0.027	0.177	-0.138	-0.023	0.007
		EQNS	-2.115	-2.451	-3.494	-0.083	-0.290	-0.011	0.023	0.210
		EQZ	-0.057	5.223	-0.089	-0.016	0.030	0.023	-0.007	0.122
		EQT	0.309	0.090	0.569	0.016	0.062	-0.032	-0.005	-0.003
		SPKW	-1.198	0.171	-0.223	-0.020	0.063	-0.026	-0.048	-0.027
		SPKN	-0.390	0.097	0.074	-0.032	-0.026	-0.010	0.004	0.010
	813	OTHR	-1.794	-6.964	-0.075	0.009	0.216	-0.018	0.006	0.084
		TEMP	1.025	-2.960	-0.498	0.172	1.284	-0.025	0.005	0.446
		EQEW	2.014	9.099	0.735	0.003	0.271	-0.015	-0.012	-0.119
		EQNS	-0.323	3.125	-4.705	0.000	-0.041	-0.034	-0.003	0.282
		EQZ	0.110	4.678	-0.266	0.023	0.034	0.009	0.017	0.211
		EQT	0.211	0.052	0.829	-0.004	0.055	-0.041	0.000	-0.022
		SPKW	-0.822	-0.086	0.009	0.115	0.382	0.004	-0.003	-0.006
		SPKN	-0.797	0.137	-0.119	-0.080	-0.148	-0.002	0.009	-0.006
	824	OTHR	-1.934	-7.108	-0.675	0.118	0.499	-0.008	-0.003	0.145
		TEMP	0.901	-3.042	0.134	0.177	1.308	0.018	0.011	0.397
		EQEW	0.182	0.748	7.529	0.025	0.045	0.096	0.050	0.019
		EQNS	1.110	7.464	-0.158	0.028	0.187	-0.002	0.001	0.136
		EQZ	0.060	5.154	0.138	0.028	-0.004	0.006	-0.001	0.220
		EQT	0.019	0.009	1.110	0.005	0.006	-0.016	0.007	0.002
		SPKW	-0.959	0.291	0.023	-0.103	-0.181	-0.002	0.000	-0.005
		SPKN	-0.836	-0.118	-0.010	0.153	0.380	0.008	-0.001	0.012

OTHR: Loads other than thermal and seismic loads
TEMP: Thermal loads
EQEW: Horizontal seismic loads in the E-W direction
EQNS: Horizontal seismic loads in the N-S direction
EQZ: Vertical seismic loads
EQT: Torsional seismic loads
SPKW: Dynamic soil pressure during a horizontal earthquake in the E-W direction
SPKN: Dynamic soil pressure during a horizontal earthquake in the N-S direction

Table 3G.1-48

Combined Forces and Moments: RB, Selected Load Combination RB-9a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
20 Wall Below RCCV Top	1606	OTHR	0.539	-7.039	0.088	-0.648	-3.660	0.017	0.012	0.987
		TEMP	11.606	-2.114	0.220	-0.682	-3.317	0.083	0.083	2.345
		EQEW	0.575	5.838	-5.328	0.080	0.661	-0.014	-0.018	-0.148
		EQNS	-1.409	-1.886	-3.817	-0.276	-1.323	-0.067	0.013	0.201
		EQZ	0.592	4.611	-0.068	-0.168	-0.903	-0.009	0.004	0.312
		EQT	0.120	0.072	0.709	0.007	0.023	-0.018	-0.003	0.010
		SPKW	-0.597	0.089	0.460	-0.038	-0.149	0.073	0.006	0.014
		SPKN	-0.170	0.099	-0.140	-0.043	-0.073	-0.020	0.000	-0.003
	1613	OTHR	0.337	-6.857	-0.020	-0.666	-3.710	-0.007	-0.011	1.051
		TEMP	11.216	-3.473	-0.445	-0.783	-4.373	-0.006	-0.013	2.707
		EQEW	0.955	7.092	0.918	0.184	1.109	-0.006	0.009	-0.240
		EQNS	-0.183	2.987	-4.708	-0.232	-1.215	-0.026	0.007	0.350
		EQZ	0.717	4.487	-0.182	-0.163	-0.990	-0.005	0.000	0.358
		EQT	0.095	-0.044	0.873	0.017	0.107	-0.027	-0.001	-0.022
		SPKW	-0.049	0.067	-0.063	-0.046	-0.514	-0.001	0.002	0.255
		SPKN	-0.538	0.033	0.121	-0.030	0.062	-0.003	-0.005	-0.096
	1624	OTHR	0.360	-6.920	-0.580	-0.594	-3.523	0.011	-0.018	1.023
		TEMP	12.199	-3.966	-0.117	-0.867	-4.482	-0.002	-0.082	2.818
		EQEW	0.049	0.603	7.470	-0.009	0.017	0.051	-0.040	0.018
		EQNS	0.878	6.181	-0.226	-0.043	-0.345	-0.008	0.003	0.182
		EQZ	0.624	4.934	0.094	-0.163	-0.963	0.000	0.005	0.341
		EQT	0.003	0.006	1.124	-0.002	-0.001	-0.016	-0.006	0.002
		SPKW	-0.679	0.142	-0.046	-0.046	0.071	-0.002	0.005	-0.115
		SPKN	-0.093	0.046	0.052	-0.021	-0.466	0.002	-0.012	0.224

Table 3G.1-48

Combined Forces and Moments: RB, Selected Load Combination RB-9a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
21 Exterior Wall @ EL-11.50 ~-10.50m	20011	OTHR	-1.576	-3.176	0.087	0.411	1.724	-0.011	0.054	0.826
		TEMP	2.783	3.204	0.556	0.250	0.892	0.077	-0.085	0.330
		EQEW	-0.564	-1.392	-9.721	-0.075	0.353	-0.043	0.146	0.140
		EQNS	-0.512	-1.066	0.964	1.452	5.558	-0.070	0.112	2.751
		EQZ	0.492	3.325	0.340	0.048	0.031	0.019	-0.049	-0.032
		EQT	0.013	0.018	0.755	0.037	0.114	-0.024	0.010	0.050
		SPKW	-1.266	0.131	0.140	0.007	0.067	-0.012	-0.003	0.051
		SPKN	0.271	0.091	-0.195	-0.071	-0.218	0.022	-0.012	-0.155
	20023	OTHR	-1.161	-2.155	-0.662	-0.124	-0.111	0.030	0.060	-0.050
		TEMP	-0.928	-0.756	1.256	-3.151	-2.204	0.242	-0.326	0.699
		EQEW	-0.001	5.315	-0.104	0.230	0.272	-0.071	-0.017	0.073
		EQNS	0.146	-0.892	-1.069	-0.799	1.249	0.157	1.180	0.822
		EQZ	0.002	1.060	0.425	-0.108	0.221	0.007	0.092	0.139
		EQT	-0.084	-0.142	0.295	0.170	-0.079	-0.042	-0.284	-0.099
		SPKW	-0.815	-0.150	0.165	-0.091	-0.005	-0.001	0.031	0.028
		SPKN	0.132	0.179	-0.140	-0.037	0.006	0.011	0.022	-0.017
	30010	OTHR	-1.019	-2.483	-0.856	-0.008	-0.160	0.003	0.009	0.613
		TEMP	0.279	2.139	-0.239	1.005	3.442	-0.023	0.006	-0.574
		EQEW	3.433	4.595	1.613	-0.245	-0.714	-0.024	-0.053	0.238
		EQNS	1.188	1.837	-3.871	0.447	2.431	-0.047	-0.047	-0.675
		EQZ	0.228	1.737	0.025	0.322	1.788	-0.022	-0.014	-0.417
		EQT	0.625	-0.156	0.933	-0.064	-0.252	-0.016	-0.030	0.085
		SPKW	-0.010	-0.306	0.022	-0.054	-0.390	-0.008	-0.009	0.528
		SPKN	-1.064	0.111	-0.090	0.019	0.147	0.007	0.009	-0.060
	30020	OTHR	-0.980	-2.363	-0.495	-0.550	-0.848	0.020	-0.136	0.368
		TEMP	-0.088	-1.198	-0.236	0.082	1.103	0.123	-0.022	-0.270
		EQEW	0.484	3.247	1.307	-0.086	0.523	0.039	0.023	-0.160
		EQNS	0.106	2.162	-0.478	0.057	1.102	0.015	-0.290	-0.250
		EQZ	0.047	0.816	0.159	-0.174	0.513	0.054	-0.113	-0.174
		EQT	0.115	-0.208	0.156	-0.041	-0.029	0.007	0.133	-0.019
		SPKW	-0.076	-0.091	-0.129	-0.062	-0.270	0.120	-0.036	0.145
		SPKN	-0.389	-0.054	0.137	-0.340	0.025	-0.039	-0.123	-0.057
	40001	OTHR	-0.721	-2.603	0.343	-0.396	-1.238	-0.202	-0.004	0.667
		TEMP	-0.155	-0.832	0.018	0.125	1.237	-0.081	0.115	-0.310
		EQEW	-0.010	3.553	0.797	0.338	1.289	0.004	0.411	-0.235
		EQNS	0.368	1.941	-0.759	-0.170	0.567	-0.075	0.005	-0.162
		EQZ	0.049	0.841	-0.148	-0.182	0.520	-0.053	0.112	-0.169
		EQT	-0.012	0.041	0.255	0.140	0.015	0.021	0.069	0.056
		SPKW	-0.373	-0.053	-0.139	-0.267	0.046	0.035	0.093	-0.047
		SPKN	-0.109	-0.134	0.125	-0.104	-0.392	-0.158	0.028	0.185
	40011	OTHR	-0.901	-3.267	-0.296	-0.178	-1.074	-0.002	0.001	1.443
		TEMP	0.876	2.784	0.049	1.074	3.671	0.007	0.012	-0.636
		EQEW	-0.266	-0.415	4.311	0.014	-0.081	0.083	0.119	-0.014
		EQNS	3.316	3.611	-0.077	0.120	1.040	0.010	0.003	-0.191
		EQZ	0.328	2.098	0.008	0.394	2.089	0.010	0.001	-0.500
		EQT	-0.018	-0.017	0.904	0.007	0.004	-0.008	-0.008	-0.009
		SPKW	-0.734	0.200	0.003	0.017	0.241	-0.002	-0.003	-0.101
		SPKN	-0.185	-0.364	-0.022	-0.041	-0.414	0.003	0.004	0.598

Table 3G.1-48

Combined Forces and Moments: RB, Selected Load Combination RB-9a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
22 Exterior Wall @ EL-4.65 ~-6.60m	22011	OTHR	0.389	-4.112	1.577	-0.014	0.204	0.038	-0.028	0.356
		TEMP	3.512	2.672	-0.082	-0.124	-0.157	0.051	0.033	-0.023
		EQEW	0.539	3.319	-6.600	0.042	-0.014	-0.018	0.032	0.006
		EQNS	-0.376	-6.628	2.328	0.102	0.902	0.147	-0.031	0.818
		EQZ	-0.178	2.690	-0.603	0.011	-0.021	0.002	0.022	-0.021
		EQT	0.014	-0.368	0.768	-0.006	0.001	-0.020	0.001	-0.003
		SPKW	-0.742	0.207	-0.152	-0.011	-0.013	0.005	-0.003	0.000
		SPKN	0.163	0.149	0.017	0.026	0.046	-0.011	-0.001	0.074
	22023	OTHR	-0.032	-2.328	0.244	0.199	0.085	-0.107	0.038	0.028
		TEMP	1.402	-3.214	-1.242	0.313	-0.113	-0.213	-0.014	-0.031
		EQEW	0.113	5.590	-3.162	0.088	-0.083	0.066	-0.177	-0.075
		EQNS	-0.012	-4.348	-1.292	-0.263	0.155	-0.135	0.325	0.120
		EQZ	-0.004	1.365	0.331	0.115	0.002	0.013	-0.073	-0.012
		EQT	-0.056	0.250	0.613	0.017	-0.006	-0.006	-0.030	-0.017
		SPKW	-0.349	-0.139	0.634	0.025	0.008	-0.008	0.003	-0.007
		SPKN	0.018	0.099	0.148	0.087	0.005	-0.005	-0.035	0.003
	32010	OTHR	0.280	-2.223	-0.375	-0.043	-0.058	0.006	0.000	-0.191
		TEMP	14.393	6.122	0.004	-2.798	-2.758	0.004	-0.008	0.041
		EQEW	0.672	4.353	1.027	-0.012	-0.086	-0.013	0.000	0.204
		EQNS	-0.882	1.251	-4.092	-0.010	-0.012	-0.003	-0.001	-0.103
		EQZ	0.012	1.478	-0.046	-0.001	-0.033	-0.002	0.000	0.007
		EQT	0.239	-0.017	0.999	-0.001	0.007	-0.018	0.002	0.009
		SPKW	-0.030	-0.130	0.000	-0.024	-0.187	-0.002	0.000	0.012
		SPKN	-0.351	0.033	0.056	-0.009	0.000	0.001	0.000	0.002
	32020	OTHR	0.019	-2.391	-0.157	0.047	-0.044	-0.048	0.050	0.016
		TEMP	0.444	4.718	2.528	-0.284	-1.833	-0.377	0.922	0.167
		EQEW	0.056	3.984	2.778	0.123	-0.061	0.010	0.091	0.017
		EQNS	-0.043	3.041	-1.627	0.150	0.029	0.005	0.127	-0.005
		EQZ	0.040	1.566	0.054	0.052	0.002	0.007	0.047	0.007
		EQT	0.006	-0.200	0.867	-0.003	-0.006	-0.011	-0.004	0.011
		SPKW	-0.008	0.003	-0.115	0.017	-0.074	-0.114	-0.072	0.022
		SPKN	-0.208	-0.061	0.239	-0.178	-0.039	0.045	-0.042	0.004
	42001	OTHR	0.036	-2.472	-0.336	0.086	-0.068	0.061	-0.035	0.050
		TEMP	2.452	3.605	2.538	-0.370	-1.611	-0.058	-0.794	-0.254
		EQEW	-0.010	3.742	2.914	0.166	0.068	-0.011	-0.064	-0.030
		EQNS	0.119	3.230	-1.627	0.200	-0.013	-0.015	-0.074	-0.006
		EQZ	0.049	1.628	0.032	0.067	0.004	-0.002	-0.034	0.002
		EQT	-0.021	-0.223	0.861	-0.003	0.014	-0.013	0.003	-0.013
		SPKW	-0.142	-0.019	-0.232	-0.098	-0.026	-0.045	0.006	0.003
		SPKN	-0.038	-0.035	0.108	-0.030	-0.065	0.137	0.139	0.023
	42011	OTHR	-0.145	-2.786	-0.359	-0.045	-0.083	-0.005	0.010	-0.175
		TEMP	12.436	4.406	0.147	-2.976	-2.775	0.081	0.081	0.173
		EQEW	0.192	-0.627	5.808	0.041	0.003	0.018	0.036	-0.014
		EQNS	0.725	3.106	0.252	0.005	-0.066	0.009	0.000	0.083
		EQZ	0.251	1.839	0.087	0.001	-0.025	0.003	-0.002	0.004
		EQT	0.054	-0.059	1.202	0.006	0.001	-0.011	0.005	-0.002
		SPKW	-0.228	0.083	0.028	-0.016	0.002	-0.001	-0.002	-0.001
		SPKN	-0.079	-0.176	0.022	-0.022	-0.152	0.015	0.025	0.007

Table 3G.1-48

Combined Forces and Moments: RB, Selected Load Combination RB-9a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
23 Exterior Wall @ EL22.50 ~24.60m	24211	OTHR	0.023	-2.389	0.467	-0.063	-0.374	-0.012	0.007	-0.009
		TEMP	3.817	2.954	-0.367	0.094	0.338	0.049	-0.142	1.510
		EQEW	0.053	0.269	-5.636	-0.006	0.032	0.014	0.006	0.033
		EQNS	-0.997	-4.957	0.239	-0.188	-0.707	-0.045	0.002	0.879
		EQZ	0.133	1.429	-0.116	0.085	0.587	-0.013	0.004	0.143
		EQT	-0.019	-0.086	0.927	0.000	-0.003	-0.036	-0.006	0.019
		SPKW	-0.050	-0.052	-0.001	0.002	0.010	-0.001	0.000	-0.002
		SPKN	-0.021	0.077	-0.029	-0.003	-0.003	0.000	-0.001	0.010
	24224	OTHR	-0.042	-2.102	0.551	0.202	0.075	-0.056	-0.123	0.058
		TEMP	0.353	4.746	-3.617	0.874	-0.344	-0.444	-0.820	-0.411
		EQEW	0.330	5.457	-4.142	-0.306	-0.138	-0.007	0.293	-0.060
		EQNS	-0.236	-6.918	0.356	0.662	0.954	-0.281	0.148	1.032
		EQZ	0.047	1.075	-0.329	-0.021	0.047	0.060	0.054	0.030
		EQT	-0.037	0.369	0.852	-0.088	-0.215	0.035	-0.101	-0.272
		SPKW	0.003	0.031	-0.008	0.004	-0.006	0.002	-0.011	-0.008
		SPKN	-0.004	-0.084	0.070	0.027	0.052	-0.004	0.032	0.070
	34210	OTHR	0.443	-0.898	-0.188	-0.014	-0.021	0.016	0.000	-0.020
		TEMP	15.330	4.791	-0.312	-2.778	-2.408	0.015	-0.011	0.104
		EQEW	-0.158	1.713	0.814	0.068	0.380	-0.007	-0.004	0.144
		EQNS	-1.180	0.230	-3.572	-0.029	-0.186	-0.009	0.011	-0.087
		EQZ	0.008	0.651	-0.050	-0.005	0.004	-0.001	-0.004	-0.013
		EQT	0.188	-0.023	1.059	0.003	0.019	-0.008	0.000	0.008
		SPKW	0.017	-0.031	0.003	-0.002	-0.020	0.001	0.000	-0.008
		SPKN	-0.088	-0.012	-0.004	-0.001	0.000	-0.001	0.000	0.000
	34220	OTHR	0.108	-1.459	-0.203	0.081	-0.012	-0.032	0.064	0.006
		TEMP	1.720	4.438	2.296	0.979	-1.464	-0.240	1.609	0.013
		EQEW	-0.136	1.761	2.503	0.147	0.144	0.006	0.041	-0.017
		EQNS	-0.063	1.557	-1.273	-0.005	0.005	0.001	0.002	-0.008
		EQZ	-0.039	0.802	0.142	-0.038	0.021	0.004	-0.032	0.000
		EQT	0.028	-0.039	0.879	0.044	0.008	-0.021	0.015	0.020
		SPKW	0.002	0.022	0.009	0.003	-0.001	-0.002	0.002	0.001
		SPKN	-0.001	0.032	-0.018	-0.001	-0.001	0.002	-0.001	-0.001
	44201	OTHR	0.031	-1.611	-0.409	0.077	0.012	0.012	-0.068	-0.010
		TEMP	1.001	5.210	0.298	0.667	-1.698	0.337	-1.910	0.044
		EQEW	0.125	1.808	3.005	0.096	0.015	0.058	-0.091	0.023
		EQNS	-0.115	1.861	-1.070	0.020	0.037	-0.013	0.025	-0.016
		EQZ	-0.023	0.949	0.280	-0.032	0.012	-0.013	0.037	0.001
		EQT	0.043	-0.060	0.877	0.026	0.002	-0.004	-0.037	-0.018
		SPKW	0.003	0.019	0.019	0.003	0.001	-0.001	-0.002	-0.001
		SPKN	0.001	0.033	-0.006	-0.001	-0.002	0.000	0.001	0.000

Table 3G.1-48

Combined Forces and Moments: RB, Selected Load Combination RB-9a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
24 Basemat @ Wall Below RCCV	90140	OTHR	-2.401	-2.665	0.064	-2.387	-1.416	1.447	-3.021	2.785
		TEMP	0.890	1.411	1.346	0.397	-0.251	-0.837	-0.696	-0.036
		EQEW	0.196	4.886	3.019	0.180	3.227	-2.914	3.394	-5.502
		EQNS	0.225	1.227	-1.955	-7.003	-0.836	-0.227	-2.968	1.213
		EQZ	-0.090	0.743	0.430	1.673	1.226	-2.811	1.354	-1.582
		EQT	0.937	-0.464	1.033	0.685	0.000	-0.235	0.304	0.110
		SPKW	0.009	-1.771	0.006	-0.086	-0.025	-0.084	-0.010	-0.177
		SPKN	-2.571	0.180	-0.096	-0.092	-0.006	0.045	-0.049	-0.015
	90182	OTHR	-1.637	-2.273	-0.351	-0.673	-1.133	0.238	0.071	1.628
		TEMP	1.777	0.495	0.537	-0.265	-3.839	0.161	-0.125	2.759
		EQEW	5.515	0.685	0.434	0.172	-0.757	-0.215	-0.079	-3.641
		EQNS	3.258	0.671	-1.457	-1.578	-0.618	1.400	-1.589	0.692
		EQZ	0.637	0.337	0.029	-0.857	1.734	0.351	-0.170	-0.448
		EQT	1.037	0.072	0.561	0.024	0.277	-0.324	0.345	-0.271
		SPKW	0.044	-1.862	-0.133	-0.170	-0.632	0.000	0.024	-0.391
		SPKN	-2.008	0.091	0.145	0.031	-0.224	0.092	-0.099	0.166
	90111	OTHR	-3.710	-1.245	-0.006	-1.375	-0.505	-0.315	0.800	0.377
		TEMP	0.563	2.234	-0.012	-4.126	-0.521	0.053	2.855	0.124
		EQEW	-0.237	0.778	-0.620	-0.499	0.380	1.210	-0.063	-2.796
		EQNS	1.123	5.945	-0.260	0.284	-1.147	0.352	-1.960	-0.122
		EQZ	0.384	0.879	-0.046	1.649	-0.996	0.430	-0.499	-0.097
		EQT	-0.054	0.036	-0.707	-0.081	0.081	0.402	0.011	-0.500
		SPKW	0.145	-1.725	0.035	-0.232	-0.059	0.003	0.202	-0.017
		SPKN	-1.936	-0.068	-0.034	-0.720	-0.158	0.022	-0.413	0.014
25 Slab EL4.65m @ RCCV	93140	OTHR	-0.640	0.344	0.614	0.053	0.085	-0.099	0.111	-0.088
		TEMP	-0.598	2.335	4.275	-0.542	-0.409	0.304	-0.147	0.123
		EQEW	0.740	-0.260	-0.201	0.173	0.132	-0.099	0.050	-0.041
		EQNS	-2.210	0.336	-0.123	-0.395	-0.241	0.172	-0.091	0.120
		EQZ	0.063	-0.102	-0.056	-0.091	-0.107	0.070	-0.132	0.109
		EQT	0.194	-0.086	0.031	0.019	0.013	-0.011	0.006	-0.006
		SPKW	0.062	-0.921	0.092	-0.029	-0.029	0.019	-0.015	0.002
		SPKN	-0.322	0.121	-0.031	-0.002	-0.004	0.002	0.000	0.003
	93182	OTHR	0.504	-0.272	-0.023	-0.033	-0.004	0.010	0.003	0.123
		TEMP	4.223	-4.036	-1.099	-0.353	-1.823	-0.083	0.075	1.366
		EQEW	-0.084	-0.021	-0.148	0.083	0.458	0.014	-0.022	-0.413
		EQNS	-0.562	-0.143	-0.464	-0.087	-0.334	-0.010	0.019	0.309
		EQZ	-0.101	-0.089	-0.021	-0.034	-0.118	-0.007	0.009	0.174
		EQT	0.077	0.030	-0.054	0.008	0.041	0.000	-0.002	-0.037
		SPKW	-0.163	-0.980	-0.027	-0.030	-0.154	-0.010	0.008	0.163
		SPKN	-0.266	-0.030	0.062	0.003	0.012	0.001	-0.001	-0.011
	93111	OTHR	-0.066	0.534	-0.104	0.028	-0.028	-0.002	0.062	-0.005
		TEMP	-3.605	4.959	-0.256	-1.768	-0.316	-0.047	1.178	0.000
		EQEW	0.141	0.032	-0.216	0.000	-0.009	-0.025	0.011	0.004
		EQNS	-0.075	-0.104	0.020	0.080	0.000	0.008	-0.054	0.002
		EQZ	-0.058	-0.120	0.023	-0.136	-0.034	-0.005	0.160	0.003
		EQT	0.008	0.005	-0.006	-0.001	-0.002	-0.002	0.003	0.000
		SPKW	0.019	-0.225	0.024	0.019	0.004	0.001	-0.014	0.000
		SPKN	-0.936	-0.149	0.125	-0.149	-0.027	-0.007	0.131	-0.001

Table 3G.1-48

Combined Forces and Moments: RB, Selected Load Combination RB-9a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
26 Slab EL17.5m @ RCCV	96144	OTHR	0.029	0.475	0.990	0.004	0.036	-0.041	0.112	-0.092
		TEMP	-0.270	4.701	6.966	-0.228	-0.122	0.166	-0.072	0.023
		EQEW	-0.135	-0.266	-0.205	0.151	0.125	-0.097	0.048	-0.018
		EQNS	-0.484	0.162	0.142	-0.313	-0.250	0.168	-0.065	0.076
		EQZ	0.239	-0.170	-0.124	-0.056	-0.058	0.040	-0.097	0.074
		EQT	0.137	-0.045	-0.003	0.013	0.011	-0.007	0.003	-0.001
		SPKW	0.019	-0.035	0.001	-0.003	-0.002	0.001	-0.001	-0.001
		SPKN	-0.059	0.032	-0.002	0.002	-0.001	-0.001	0.001	-0.001
	96186	OTHR	0.969	-0.340	0.029	-0.052	-0.205	-0.009	0.009	0.127
		TEMP	6.688	-4.125	-1.417	-0.090	-0.313	-0.048	0.016	0.346
		EQEW	-0.434	0.196	-0.261	0.112	0.624	0.022	-0.033	-0.498
		EQNS	-0.592	-0.131	-0.041	-0.074	-0.339	-0.010	0.025	0.271
		EQZ	-0.239	0.093	0.038	-0.003	-0.002	-0.005	0.006	0.052
		EQT	0.071	0.033	-0.070	0.005	0.027	-0.001	-0.002	-0.023
		SPKW	0.042	0.013	-0.004	-0.009	-0.044	-0.002	0.002	0.035
		SPKN	-0.073	-0.028	0.033	0.001	0.004	0.001	0.000	-0.003
	96113	OTHR	-0.277	1.285	-0.245	-0.203	-0.038	-0.017	0.280	0.034
		TEMP	-8.342	2.577	-1.679	-4.480	-2.783	-0.199	1.239	-0.059
		EQEW	0.084	-0.188	0.581	0.078	0.029	0.003	-0.024	0.039
		EQNS	0.214	-1.016	-0.015	0.456	-0.039	-0.008	-0.426	-0.064
		EQZ	0.067	-0.427	0.079	0.132	-0.032	-0.016	-0.157	-0.020
		EQT	0.005	-0.010	0.225	0.009	0.009	0.009	0.004	0.012
		SPKW	-0.036	-0.094	-0.005	0.036	0.010	0.002	-0.023	-0.002
		SPKN	0.033	0.096	0.008	-0.101	-0.022	-0.003	0.072	0.006
27 Slab EL27.0m @ RCCV	98472	OTHR	0.616	0.459	-0.087	0.024	0.033	-0.051	0.174	-0.174
		TEMP	-0.766	-0.797	5.408	-0.313	0.033	-0.312	0.451	-0.562
		EQEW	0.134	-0.988	-0.434	-0.013	-0.032	0.005	-0.041	0.047
		EQNS	1.002	-0.251	-0.205	-0.188	-0.233	0.105	-0.090	0.122
		EQZ	-0.341	0.011	-0.110	-0.186	-0.285	0.206	-0.230	0.258
		EQT	-0.117	0.108	0.040	0.021	0.023	-0.012	0.013	-0.011
		SPKW	0.034	-0.014	-0.016	-0.005	-0.006	0.003	-0.005	0.003
		SPKN	-0.072	0.028	0.016	0.001	0.000	0.000	0.001	0.000
	98514	OTHR	0.456	0.267	0.271	-0.041	-0.308	0.008	0.002	0.036
		TEMP	0.438	-2.394	-1.401	-0.532	-0.068	-0.006	0.036	-0.727
		EQEW	-0.426	0.174	-0.383	0.063	0.484	-0.007	-0.011	-0.325
		EQNS	-0.239	-0.147	-0.193	-0.069	-0.240	0.005	0.008	0.256
		EQZ	0.034	-0.088	-0.059	-0.037	-0.115	-0.024	0.000	0.171
		EQT	0.090	0.001	-0.036	0.005	0.021	-0.003	-0.002	-0.021
		SPKW	0.026	-0.006	-0.006	-0.006	-0.029	-0.001	0.000	0.024
		SPKN	-0.021	-0.005	0.023	0.001	-0.001	0.001	0.000	0.000
	98424	OTHR	-0.132	0.928	-0.116	-0.033	-0.050	-0.106	-0.369	-0.044
		TEMP	-7.591	-10.575	-1.415	-5.823	-1.582	0.072	-5.617	0.028
		EQEW	0.236	-0.165	-5.772	0.064	0.050	-0.180	0.048	0.098
		EQNS	0.935	-1.153	0.103	0.127	-0.148	0.099	1.044	0.050
		EQZ	0.218	-0.319	-0.008	-0.719	-0.214	0.047	1.004	0.064
		EQT	0.030	0.005	-0.994	0.012	0.015	0.025	0.001	0.023
		SPKW	-0.001	0.003	-0.002	0.010	0.013	-0.003	-0.032	-0.002
		SPKN	0.001	0.001	0.002	-0.016	-0.020	0.003	0.049	0.002

Table 3G.1-48

Combined Forces and Moments: RB, Selected Load Combination RB-9a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
28 Pool Girder @ Storage Pool	123054	OTHR	0.196	-0.218	0.393	0.051	0.039	-0.059	-0.053	-0.035
		TEMP	1.312	-2.833	1.438	2.280	2.119	0.026	-0.231	0.481
		EQEW	0.346	0.142	0.151	0.329	0.157	-0.068	0.025	0.209
		EQNS	-0.161	1.563	-0.510	-0.070	-0.003	0.024	-0.010	0.023
		EQZ	-0.418	2.390	0.732	-0.048	-0.028	-0.052	0.007	0.024
		EQT	0.059	-0.205	-0.022	0.058	0.026	-0.010	0.002	0.018
		SPKW	0.007	-0.019	-0.009	0.003	0.002	-0.001	0.000	0.001
		SPKN	-0.023	0.036	-0.006	-0.003	-0.002	0.001	-0.001	-0.001
	123154	OTHR	0.400	-0.160	0.362	0.064	0.023	-0.035	-0.050	0.019
		TEMP	1.029	0.746	-0.399	1.924	1.145	-0.340	-0.086	0.247
		EQEW	-0.375	0.352	0.698	0.191	-0.067	-0.089	0.037	-0.008
		EQNS	-1.233	0.501	-0.406	-0.103	-0.035	0.015	-0.033	0.003
		EQZ	-1.388	0.436	0.560	-0.072	-0.034	-0.096	-0.022	-0.007
		EQT	-0.105	-0.124	0.027	0.047	0.002	-0.011	0.003	0.000
		SPKW	-0.008	-0.007	-0.005	0.002	0.000	-0.001	0.000	0.000
		SPKN	-0.017	0.010	-0.008	-0.003	-0.001	0.002	0.000	0.000
29 Pool Girder @ Cavity	123062	OTHR	0.448	-0.515	-0.869	-0.020	0.049	0.006	0.041	0.053
		TEMP	-1.258	-0.152	-0.701	0.103	0.324	0.027	0.057	0.173
		EQEW	-0.434	0.924	0.205	0.076	0.040	-0.040	-0.059	0.058
		EQNS	-0.152	-0.112	0.300	-0.072	-0.019	-0.024	0.025	0.017
		EQZ	-0.465	-0.598	-0.336	0.024	0.163	-0.031	0.000	0.087
		EQT	0.081	0.002	-0.067	-0.005	-0.006	-0.004	0.004	0.001
		SPKW	0.015	0.000	0.000	0.000	0.001	0.000	-0.001	0.000
		SPKN	-0.020	0.001	0.002	0.000	0.000	0.000	0.000	-0.001
	123162	OTHR	0.344	-0.196	-0.692	0.000	-0.015	0.004	0.012	-0.013
		TEMP	-1.667	-0.034	-0.462	0.130	-0.117	-0.002	-0.152	0.085
		EQEW	-0.560	0.907	0.222	0.102	-0.017	0.008	-0.115	-0.018
		EQNS	-0.923	-0.130	0.184	-0.152	-0.036	-0.019	0.056	0.002
		EQZ	1.265	-0.170	-0.200	0.073	0.059	-0.027	-0.090	-0.039
		EQT	0.120	0.003	-0.101	-0.010	-0.009	-0.007	0.010	0.003
		SPKW	-0.022	-0.002	0.002	0.000	0.000	0.001	0.000	0.000
		SPKN	0.006	0.001	-0.001	0.000	0.000	0.000	0.000	0.000
30 Pool Girder @ Fuel Pool	123067	OTHR	0.235	0.979	0.073	-0.004	-0.076	-0.007	-0.057	-0.041
		TEMP	-2.311	-5.928	-1.779	0.647	0.431	-0.116	-0.149	0.467
		EQEW	0.073	0.122	0.288	0.162	0.145	0.059	0.023	0.256
		EQNS	-0.644	1.895	0.900	0.094	0.043	0.024	0.036	0.040
		EQZ	-0.503	2.667	-1.237	-0.015	0.047	0.078	0.118	0.054
		EQT	0.036	0.061	-0.084	-0.040	-0.046	-0.019	-0.012	-0.036
		SPKW	0.005	-0.006	0.018	0.004	0.003	0.002	0.001	0.003
		SPKN	-0.014	0.025	0.002	-0.005	-0.002	-0.002	0.000	-0.002
	123167	OTHR	-0.477	0.257	0.035	0.004	-0.025	0.024	-0.058	0.000
		TEMP	-2.108	-2.650	-2.209	0.276	-0.451	-0.231	-0.013	0.179
		EQEW	-0.405	0.441	-0.305	0.042	-0.117	0.066	-0.051	-0.018
		EQNS	-1.125	0.351	1.205	0.031	0.033	0.004	0.006	0.003
		EQZ	-0.679	0.641	-1.015	-0.040	-0.022	-0.011	0.032	-0.008
		EQT	0.189	0.062	-0.033	-0.022	0.004	-0.010	-0.002	-0.003
		SPKW	-0.012	-0.001	0.015	0.001	0.000	0.001	0.000	0.000
		SPKN	0.009	0.007	0.001	-0.004	0.000	-0.001	0.001	0.000

Table 3G.1-48

Combined Forces and Moments: RB, Selected Load Combination RB-9a (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
31 MS Tunnel Wall and Slab	150122	OTHR	0.034	-0.234	0.333	0.030	0.109	0.019	-0.008	-0.057
		TEMP	0.224	-0.517	1.902	1.053	3.141	-0.007	-0.584	0.363
		EQEW	-0.002	0.117	-0.022	-0.031	-0.114	-0.044	0.008	0.254
		EQNS	-0.011	0.177	-0.048	-0.038	-0.144	-0.009	0.008	-0.030
		EQZ	0.026	-0.083	-0.250	-0.017	-0.020	-0.016	0.010	0.049
		EQT	-0.005	0.032	-0.014	-0.013	-0.015	-0.020	0.001	0.070
		SPKW	0.002	-0.012	0.001	0.001	0.002	-0.001	0.000	0.001
		SPKN	-0.001	0.005	0.000	0.000	0.002	0.001	0.000	0.001
	96611	OTHR	-0.027	0.515	-0.036	0.105	0.021	-0.041	-0.087	0.013
		TEMP	-0.447	4.104	-0.332	-1.287	-7.108	-0.423	0.426	0.209
		EQEW	0.034	-0.078	-0.059	-0.013	-0.065	0.102	-0.004	-0.075
		EQNS	0.034	-0.291	0.032	-0.098	-0.390	-0.021	0.042	0.016
		EQZ	0.014	-0.303	0.015	-0.044	0.161	0.065	0.071	-0.022
		EQT	0.007	-0.018	-0.019	-0.002	-0.008	0.046	-0.002	-0.019
		SPKW	-0.006	0.045	-0.005	0.001	0.005	0.000	-0.001	0.000
		SPKN	0.008	-0.060	0.006	0.005	0.013	0.002	-0.002	-0.001
	98614	OTHR	-0.015	-0.175	-0.019	-0.122	-0.884	-0.118	-0.013	0.050
		TEMP	-0.188	1.992	-0.146	-0.862	-10.483	-0.011	0.470	0.303
		EQEW	0.016	0.007	-0.009	0.034	0.114	0.346	-0.032	-0.021
		EQNS	0.043	-0.218	0.034	0.124	0.444	0.050	-0.039	-0.018
		EQZ	0.016	0.219	0.015	0.003	0.460	0.054	0.039	-0.029
		EQT	0.000	0.013	0.012	0.005	0.011	0.098	-0.006	-0.026
		SPKW	0.001	-0.005	0.001	-0.007	-0.015	-0.003	0.002	0.001
		SPKN	-0.001	0.019	-0.001	0.006	0.006	0.002	-0.002	-0.001

Table 3G.1-49

Combined Forces and Moments: RB, Selected Load Combination RB-9b

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
18 Wall Below RCCV Bottom	6	OTHR	-2.507	-8.036	-0.154	0.289	1.346	-0.002	-0.006	0.599
		TEMP	0.673	-1.073	-0.904	0.256	1.958	-0.049	0.048	0.311
		EQEW	4.233	10.965	-4.292	-0.722	-3.492	-0.050	0.149	-1.466
		EQNS	-4.083	-2.977	-3.250	0.947	5.610	0.025	0.009	2.083
		EQZ	-0.369	6.045	-0.433	0.327	2.162	-0.011	0.033	0.697
		EQT	0.678	0.159	0.632	-0.044	-0.288	-0.014	0.027	-0.154
		SPKW	-0.614	0.143	-0.331	-0.051	-0.209	-0.033	0.058	-0.022
		SPKN	-0.469	0.023	-0.061	0.014	0.100	0.011	-0.018	0.074
	13	OTHR	-2.114	-6.298	-0.135	-0.085	-0.248	0.007	-0.003	0.049
		TEMP	-0.119	-4.048	-0.748	0.603	3.352	-0.002	0.023	0.782
		EQEW	4.825	10.405	0.411	-0.322	-2.045	-0.014	0.031	-1.063
		EQNS	0.052	2.819	-3.746	0.608	3.221	-0.054	0.099	0.998
		EQZ	-0.498	4.718	-0.323	0.569	3.088	-0.003	0.004	0.952
		EQT	0.561	0.147	0.719	-0.086	-0.389	-0.010	0.018	-0.179
		SPKW	0.172	0.088	0.079	-0.046	-0.641	0.001	-0.002	-0.304
		SPKN	-1.117	-0.011	-0.229	0.003	0.265	0.001	0.001	0.206
	24	OTHR	-1.463	-6.287	-0.558	-0.248	-1.443	-0.005	0.011	-0.503
		TEMP	0.118	-3.760	0.215	0.593	3.309	-0.007	-0.003	0.776
		EQEW	0.620	0.744	6.330	0.012	-0.156	0.097	-0.142	-0.100
		EQNS	2.853	8.172	-0.025	0.203	1.099	-0.007	0.001	0.037
		EQZ	-0.464	5.193	0.150	0.595	3.234	-0.005	0.001	0.976
		EQT	0.080	0.012	0.993	0.002	-0.026	-0.005	0.008	-0.015
		SPKW	-1.094	0.022	0.063	0.015	0.350	0.003	-0.006	0.242
		SPKN	0.141	0.062	-0.055	-0.056	-0.696	-0.005	0.006	-0.333
19 Wall Below RCCV Mid-Height	806	OTHR	-1.345	-6.799	-0.003	0.022	0.141	0.001	-0.012	-0.039
		TEMP	1.824	-2.260	0.204	0.332	1.720	0.091	-0.055	-0.103
		EQEW	0.709	8.375	-5.149	-0.027	0.177	-0.138	-0.023	0.007
		EQNS	-2.115	-2.451	-3.494	-0.083	-0.290	-0.011	0.023	0.210
		EQZ	-0.057	5.223	-0.089	-0.016	0.030	0.023	-0.007	0.122
		EQT	0.309	0.090	0.569	0.016	0.062	-0.032	-0.005	-0.003
		SPKW	-1.198	0.171	-0.223	-0.020	0.063	-0.026	-0.048	-0.027
		SPKN	-0.390	0.097	0.074	-0.032	-0.026	-0.010	0.004	0.010
	813	OTHR	-1.711	-6.228	-0.086	0.005	0.207	-0.017	0.007	0.069
		TEMP	1.349	-3.956	-0.557	0.219	1.696	-0.032	0.005	0.598
		EQEW	2.014	9.099	0.735	0.003	0.271	-0.015	-0.012	-0.119
		EQNS	-0.323	3.125	-4.705	0.000	-0.041	-0.034	-0.003	0.282
		EQZ	0.110	4.678	-0.266	0.023	0.034	0.009	0.017	0.211
		EQT	0.211	0.052	0.829	-0.004	0.055	-0.041	0.000	-0.022
		SPKW	-0.822	-0.086	0.009	0.115	0.382	0.004	-0.003	-0.006
		SPKN	-0.797	0.137	-0.119	-0.080	-0.148	-0.002	0.009	-0.006
	824	OTHR	-1.887	-6.371	-0.577	0.118	0.479	-0.006	-0.002	0.141
		TEMP	1.162	-3.729	0.206	0.225	1.731	0.027	0.015	0.503
		EQEW	0.182	0.748	7.529	0.025	0.045	0.096	0.050	0.019
		EQNS	1.110	7.464	-0.158	0.028	0.187	-0.002	0.001	0.136
		EQZ	0.060	5.154	0.138	0.028	-0.004	0.006	-0.001	0.220
		EQT	0.019	0.009	1.110	0.005	0.006	-0.016	0.007	0.002
		SPKW	-0.959	0.291	0.023	-0.103	-0.181	-0.002	0.000	-0.005
		SPKN	-0.836	-0.118	-0.010	0.153	0.380	0.008	-0.001	0.012

Table 3G.1-49

Combined Forces and Moments: RB, Selected Load Combination RB-9b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
20 Wall Below RCCV Top	1606	OTHR	0.564	-6.173	0.038	-0.579	-3.266	0.018	0.011	0.884
		TEMP	15.858	-3.186	0.301	-0.853	-4.075	0.108	0.100	3.080
		EQEW	0.575	5.838	-5.328	0.080	0.661	-0.014	-0.018	-0.148
		EQNS	-1.409	-1.886	-3.817	-0.276	-1.323	-0.067	0.013	0.201
		EQZ	0.592	4.611	-0.068	-0.168	-0.903	-0.009	0.004	0.312
		EQT	0.120	0.072	0.709	0.007	0.023	-0.018	-0.003	0.010
		SPKW	-0.597	0.089	0.460	-0.038	-0.149	0.073	0.006	0.014
		SPKN	-0.170	0.099	-0.140	-0.043	-0.073	-0.020	0.000	-0.003
	1613	OTHR	0.319	-6.126	-0.006	-0.593	-3.275	-0.006	-0.011	0.928
		TEMP	15.698	-4.645	-0.441	-1.003	-5.526	-0.010	-0.016	3.605
		EQEW	0.955	7.092	0.918	0.184	1.109	-0.006	0.009	-0.240
		EQNS	-0.183	2.987	-4.708	-0.232	-1.215	-0.026	0.007	0.350
		EQZ	0.717	4.487	-0.182	-0.163	-0.990	-0.005	0.000	0.358
		EQT	0.095	-0.044	0.873	0.017	0.107	-0.027	-0.001	-0.022
		SPKW	-0.049	0.067	-0.063	-0.046	-0.514	-0.001	0.002	0.255
		SPKN	-0.538	0.033	0.121	-0.030	0.062	-0.003	-0.005	-0.096
	1624	OTHR	0.324	-6.125	-0.483	-0.524	-3.129	0.010	-0.018	0.909
		TEMP	16.701	-4.840	-0.100	-1.115	-5.550	0.000	-0.106	3.700
		EQEW	0.049	0.603	7.470	-0.009	0.017	0.051	-0.040	0.018
		EQNS	0.878	6.181	-0.226	-0.043	-0.345	-0.008	0.003	0.182
		EQZ	0.624	4.934	0.094	-0.163	-0.963	0.000	0.005	0.341
		EQT	0.003	0.006	1.124	-0.002	-0.001	-0.016	-0.006	0.002
		SPKW	-0.679	0.142	-0.046	-0.046	0.071	-0.002	0.005	-0.115
		SPKN	-0.093	0.046	0.052	-0.021	-0.466	0.002	-0.012	0.224

Table 3G.1-49

Combined Forces and Moments: RB, Selected Load Combination RB-9b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
21 Exterior Wall @ EL-11.50 ~-10.50m	20011	OTHR	-1.596	-3.150	-0.044	0.357	1.521	-0.010	0.054	0.721
		TEMP	3.065	4.610	0.680	0.386	1.389	0.095	-0.105	0.549
		EQEW	-0.564	-1.392	-9.721	-0.075	0.353	-0.043	0.146	0.140
		EQNS	-0.512	-1.066	0.964	1.452	5.558	-0.070	0.112	2.751
		EQZ	0.492	3.325	0.340	0.048	0.031	0.019	-0.049	-0.032
		EQT	0.013	0.018	0.755	0.037	0.114	-0.024	0.010	0.050
		SPKW	-1.266	0.131	0.140	0.007	0.067	-0.012	-0.003	0.051
		SPKN	0.271	0.091	-0.195	-0.071	-0.218	0.022	-0.012	-0.155
	20023	OTHR	-1.160	-2.001	-0.649	-0.106	-0.133	0.027	0.039	-0.065
		TEMP	-0.923	-0.709	1.214	-3.198	-2.113	0.237	-0.314	0.735
		EQEW	-0.001	5.315	-0.104	0.230	0.272	-0.071	-0.017	0.073
		EQNS	0.146	-0.892	-1.069	-0.799	1.249	0.157	1.180	0.822
		EQZ	0.002	1.060	0.425	-0.108	0.221	0.007	0.092	0.139
		EQT	-0.084	-0.142	0.295	0.170	-0.079	-0.042	-0.284	-0.099
		SPKW	-0.815	-0.150	0.165	-0.091	-0.005	-0.001	0.031	0.028
		SPKN	0.132	0.179	-0.140	-0.037	0.006	0.011	0.022	-0.017
	30010	OTHR	-1.078	-2.453	-0.760	-0.033	-0.294	0.002	0.009	0.653
		TEMP	0.517	3.114	-0.366	1.209	4.571	-0.033	-0.002	-0.827
		EQEW	3.433	4.595	1.613	-0.245	-0.714	-0.024	-0.053	0.238
		EQNS	1.188	1.837	-3.871	0.447	2.431	-0.047	-0.047	-0.675
		EQZ	0.228	1.737	0.025	0.322	1.788	-0.022	-0.014	-0.417
		EQT	0.625	-0.156	0.933	-0.064	-0.252	-0.016	-0.030	0.085
		SPKW	-0.010	-0.306	0.022	-0.054	-0.390	-0.008	-0.009	0.528
		SPKN	-1.064	0.111	-0.090	0.019	0.147	0.007	0.009	-0.060
	30020	OTHR	-0.971	-2.195	-0.443	-0.554	-0.820	0.022	-0.141	0.356
		TEMP	-0.057	-1.480	-0.391	0.022	1.207	0.144	-0.026	-0.281
		EQEW	0.484	3.247	1.307	-0.086	0.523	0.039	0.023	-0.160
		EQNS	0.106	2.162	-0.478	0.057	1.102	0.015	-0.290	-0.250
		EQZ	0.047	0.816	0.159	-0.174	0.513	0.054	-0.113	-0.174
		EQT	0.115	-0.208	0.156	-0.041	-0.029	0.007	0.133	-0.019
		SPKW	-0.076	-0.091	-0.129	-0.062	-0.270	0.120	-0.036	0.145
		SPKN	-0.389	-0.054	0.137	-0.340	0.025	-0.039	-0.123	-0.057
	40001	OTHR	-0.725	-2.420	0.348	-0.389	-1.195	-0.203	0.011	0.655
		TEMP	-0.091	-1.142	0.059	0.040	1.330	-0.097	0.105	-0.322
		EQEW	-0.010	3.553	0.797	0.338	1.289	0.004	0.411	-0.235
		EQNS	0.368	1.941	-0.759	-0.170	0.567	-0.075	0.005	-0.162
		EQZ	0.049	0.841	-0.148	-0.182	0.520	-0.053	0.112	-0.169
		EQT	-0.012	0.041	0.255	0.140	0.015	0.021	0.069	0.056
		SPKW	-0.373	-0.053	-0.139	-0.267	0.046	0.035	0.093	-0.047
		SPKN	-0.109	-0.134	0.125	-0.104	-0.392	-0.158	0.028	0.185
	40011	OTHR	-0.988	-3.182	-0.263	-0.181	-1.104	-0.001	0.002	1.451
		TEMP	1.307	3.629	0.056	1.243	4.651	0.011	0.014	-0.842
		EQEW	-0.266	-0.415	4.311	0.014	-0.081	0.083	0.119	-0.014
		EQNS	3.316	3.611	-0.077	0.120	1.040	0.010	0.003	-0.191
		EQZ	0.328	2.098	0.008	0.394	2.089	0.010	0.001	-0.500
		EQT	-0.018	-0.017	0.904	0.007	0.004	-0.008	-0.008	-0.009
		SPKW	-0.734	0.200	0.003	0.017	0.241	-0.002	-0.003	-0.101
		SPKN	-0.185	-0.364	-0.022	-0.041	-0.414	0.003	0.004	0.598

Table 3G.1-49

Combined Forces and Moments: RB, Selected Load Combination RB-9b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
22 Exterior Wall @ EL-4.65 ~-6.60m	22011	OTHR	0.393	-3.771	1.371	-0.013	0.183	0.032	-0.028	0.311
		TEMP	5.013	4.358	-0.217	-0.171	-0.224	0.069	0.046	0.082
		EQEW	0.539	3.319	-6.600	0.042	-0.014	-0.018	0.032	0.006
		EQNS	-0.376	-6.628	2.328	0.102	0.902	0.147	-0.031	0.818
		EQZ	-0.178	2.690	-0.603	0.011	-0.021	0.002	0.022	-0.021
		EQT	0.014	-0.368	0.768	-0.006	0.001	-0.020	0.001	-0.003
		SPKW	-0.742	0.207	-0.152	-0.011	-0.013	0.005	-0.003	0.000
		SPKN	0.163	0.149	0.017	0.026	0.046	-0.011	-0.001	0.074
	22023	OTHR	-0.030	-2.145	0.183	0.193	0.078	-0.101	0.031	0.023
		TEMP	1.628	-2.769	-1.390	0.748	-0.043	-0.218	-0.198	-0.044
		EQEW	0.113	5.590	-3.162	0.088	-0.083	0.066	-0.177	-0.075
		EQNS	-0.012	-4.348	-1.292	-0.263	0.155	-0.135	0.325	0.120
		EQZ	-0.004	1.365	0.331	0.115	0.002	0.013	-0.073	-0.012
		EQT	-0.056	0.250	0.613	0.017	-0.006	-0.006	-0.030	-0.017
		SPKW	-0.349	-0.139	0.634	0.025	0.008	-0.008	0.003	-0.007
		SPKN	0.018	0.099	0.148	0.087	0.005	-0.005	-0.035	0.003
	32010	OTHR	0.311	-2.120	-0.300	-0.040	-0.042	0.007	0.000	-0.172
		TEMP	16.724	7.722	-0.080	-2.893	-3.002	-0.001	-0.014	0.024
		EQEW	0.672	4.353	1.027	-0.012	-0.086	-0.013	0.000	0.204
		EQNS	-0.882	1.251	-4.092	-0.010	-0.012	-0.003	-0.001	-0.103
		EQZ	0.012	1.478	-0.046	-0.001	-0.033	-0.002	0.000	0.007
		EQT	0.239	-0.017	0.999	-0.001	0.007	-0.018	0.002	0.009
		SPKW	-0.030	-0.130	0.000	-0.024	-0.187	-0.002	0.000	0.012
		SPKN	-0.351	0.033	0.056	-0.009	0.000	0.001	0.000	0.002
	32020	OTHR	0.019	-2.245	-0.063	0.043	-0.038	-0.053	0.045	0.020
		TEMP	0.652	4.868	2.520	0.104	-1.860	-0.395	1.226	0.199
		EQEW	0.056	3.984	2.778	0.123	-0.061	0.010	0.091	0.017
		EQNS	-0.043	3.041	-1.627	0.150	0.029	0.005	0.127	-0.005
		EQZ	0.040	1.566	0.054	0.052	0.002	0.007	0.047	0.007
		EQT	0.006	-0.200	0.867	-0.003	-0.006	-0.011	-0.004	0.011
		SPKW	-0.008	0.003	-0.115	0.017	-0.074	-0.114	-0.072	0.022
		SPKN	-0.208	-0.061	0.239	-0.178	-0.039	0.045	-0.042	0.004
	42001	OTHR	0.031	-2.312	-0.238	0.080	-0.063	0.062	-0.031	0.050
		TEMP	2.721	3.799	2.647	0.131	-1.563	-0.051	-0.998	-0.239
		EQEW	-0.010	3.742	2.914	0.166	0.068	-0.011	-0.064	-0.030
		EQNS	0.119	3.230	-1.627	0.200	-0.013	-0.015	-0.074	-0.006
		EQZ	0.049	1.628	0.032	0.067	0.004	-0.002	-0.034	0.002
		EQT	-0.021	-0.223	0.861	-0.003	0.014	-0.013	0.003	-0.013
		SPKW	-0.142	-0.019	-0.232	-0.098	-0.026	-0.045	0.006	0.003
		SPKN	-0.038	-0.035	0.108	-0.030	-0.065	0.137	0.139	0.023
	42011	OTHR	-0.117	-2.583	-0.293	-0.040	-0.071	-0.005	0.010	-0.163
		TEMP	14.114	5.515	0.239	-3.165	-3.047	0.073	0.090	0.170
		EQEW	0.192	-0.627	5.808	0.041	0.003	0.018	0.036	-0.014
		EQNS	0.725	3.106	0.252	0.005	-0.066	0.009	0.000	0.083
		EQZ	0.251	1.839	0.087	0.001	-0.025	0.003	-0.002	0.004
		EQT	0.054	-0.059	1.202	0.006	0.001	-0.011	0.005	-0.002
		SPKW	-0.228	0.083	0.028	-0.016	0.002	-0.001	-0.002	-0.001
		SPKN	-0.079	-0.176	0.022	-0.022	-0.152	0.015	0.025	0.007

Table 3G.1-49

Combined Forces and Moments: RB, Selected Load Combination RB-9b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
23 Exterior Wall @ EL22.50 ~24.60m	24211	OTHR	0.133	-2.146	0.381	-0.041	-0.261	-0.005	0.007	-0.093
		TEMP	5.670	5.757	-0.305	0.173	0.680	0.046	-0.169	1.421
		EQEW	0.053	0.269	-5.636	-0.006	0.032	0.014	0.006	0.033
		EQNS	-0.997	-4.957	0.239	-0.188	-0.707	-0.045	0.002	0.879
		EQZ	0.133	1.429	-0.116	0.085	0.587	-0.013	0.004	0.143
		EQT	-0.019	-0.086	0.927	0.000	-0.003	-0.036	-0.006	0.019
		SPKW	-0.050	-0.052	-0.001	0.002	0.010	-0.001	0.000	-0.002
		SPKN	-0.021	0.077	-0.029	-0.003	-0.003	0.000	-0.001	0.010
	24224	OTHR	-0.034	-1.964	0.440	0.161	0.058	-0.045	-0.101	0.040
		TEMP	1.023	5.452	-3.719	1.968	0.070	-0.635	-1.559	-0.317
		EQEW	0.330	5.457	-4.142	-0.306	-0.138	-0.007	0.293	-0.060
		EQNS	-0.236	-6.918	0.356	0.662	0.954	-0.281	0.148	1.032
		EQZ	0.047	1.075	-0.329	-0.021	0.047	0.060	0.054	0.030
		EQT	-0.037	0.369	0.852	-0.088	-0.215	0.035	-0.101	-0.272
		SPKW	0.003	0.031	-0.008	0.004	-0.006	0.002	-0.011	-0.008
		SPKN	-0.004	-0.084	0.070	0.027	0.052	-0.004	0.032	0.070
	34210	OTHR	0.519	-0.844	-0.131	-0.010	0.028	0.012	0.000	0.000
		TEMP	21.820	5.544	-0.576	-2.904	-2.819	0.035	-0.002	-0.128
		EQEW	-0.158	1.713	0.814	0.068	0.380	-0.007	-0.004	0.144
		EQNS	-1.180	0.230	-3.572	-0.029	-0.186	-0.009	0.011	-0.087
		EQZ	0.008	0.651	-0.050	-0.005	0.004	-0.001	-0.004	-0.013
		EQT	0.188	-0.023	1.059	0.003	0.019	-0.008	0.000	0.008
		SPKW	0.017	-0.031	0.003	-0.002	-0.020	0.001	0.000	-0.008
		SPKN	-0.088	-0.012	-0.004	-0.001	0.000	-0.001	0.000	0.000
	34220	OTHR	0.102	-1.444	-0.140	0.076	0.001	-0.025	0.058	0.003
		TEMP	2.793	5.435	4.410	2.628	-1.178	-0.711	2.570	0.094
		EQEW	-0.136	1.761	2.503	0.147	0.144	0.006	0.041	-0.017
		EQNS	-0.063	1.557	-1.273	-0.005	0.005	0.001	0.002	-0.008
		EQZ	-0.039	0.802	0.142	-0.038	0.021	0.004	-0.032	0.000
		EQT	0.028	-0.039	0.879	0.044	0.008	-0.021	0.015	0.020
		SPKW	0.002	0.022	0.009	0.003	-0.001	-0.002	0.002	0.001
		SPKN	-0.001	0.032	-0.018	-0.001	-0.001	0.002	-0.001	-0.001
	44201	OTHR	0.031	-1.563	-0.300	0.076	0.019	0.009	-0.061	-0.010
		TEMP	1.791	6.589	0.558	2.230	-1.491	0.539	-2.966	0.044
		EQEW	0.125	1.808	3.005	0.096	0.015	0.058	-0.091	0.023
		EQNS	-0.115	1.861	-1.070	0.020	0.037	-0.013	0.025	-0.016
		EQZ	-0.023	0.949	0.280	-0.032	0.012	-0.013	0.037	0.001
		EQT	0.043	-0.060	0.877	0.026	0.002	-0.004	-0.037	-0.018
		SPKW	0.003	0.019	0.019	0.003	0.001	-0.001	-0.002	-0.001
		SPKN	0.001	0.033	-0.006	-0.001	-0.002	0.000	0.001	0.000

Table 3G.1-49

Combined Forces and Moments: RB, Selected Load Combination RB-9b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
24 Basemat @ Wall Below RCCV	90140	OTHR	-2.597	-2.649	0.099	-1.886	-1.023	1.218	-2.740	2.485
		TEMP	0.676	1.652	1.723	-0.528	-1.081	-0.960	-1.149	0.173
		EQEW	0.196	4.886	3.019	0.180	3.227	-2.914	3.394	-5.502
		EQNS	0.225	1.227	-1.955	-7.003	-0.836	-0.227	-2.968	1.213
		EQZ	-0.090	0.743	0.430	1.673	1.226	-2.811	1.354	-1.582
		EQT	0.937	-0.464	1.033	0.685	0.000	-0.235	0.304	0.110
		SPKW	0.009	-1.771	0.006	-0.086	-0.025	-0.084	-0.010	-0.177
		SPKN	-2.571	0.180	-0.096	-0.092	-0.006	0.045	-0.049	-0.015
	90182	OTHR	-1.762	-2.321	-0.293	-0.530	-0.801	0.234	0.041	1.326
		TEMP	2.064	0.701	0.416	-0.892	-5.505	0.237	-0.094	3.815
		EQEW	5.515	0.685	0.434	0.172	-0.757	-0.215	-0.079	-3.641
		EQNS	3.258	0.671	-1.457	-1.578	-0.618	1.400	-1.589	0.692
		EQZ	0.637	0.337	0.029	-0.857	1.734	0.351	-0.170	-0.448
		EQT	1.037	0.072	0.561	0.024	0.277	-0.324	0.345	-0.271
		SPKW	0.044	-1.862	-0.133	-0.170	-0.632	0.000	0.024	-0.391
		SPKN	-2.008	0.091	0.145	0.031	-0.224	0.092	-0.099	0.166
	90111	OTHR	-3.754	-1.427	-0.013	-1.138	-0.396	-0.275	0.576	0.327
		TEMP	0.729	2.934	-0.023	-5.319	-1.147	0.110	3.683	0.149
		EQEW	-0.237	0.778	-0.620	-0.499	0.380	1.210	-0.063	-2.796
		EQNS	1.123	5.945	-0.260	0.284	-1.147	0.352	-1.960	-0.122
		EQZ	0.384	0.879	-0.046	1.649	-0.996	0.430	-0.499	-0.097
		EQT	-0.054	0.036	-0.707	-0.081	0.081	0.402	0.011	-0.500
		SPKW	0.145	-1.725	0.035	-0.232	-0.059	0.003	0.202	-0.017
		SPKN	-1.936	-0.068	-0.034	-0.720	-0.158	0.022	-0.413	0.014
25 Slab EL4.65m @ RCCV	93140	OTHR	-0.573	0.311	0.577	0.069	0.095	-0.101	0.116	-0.093
		TEMP	-0.316	3.040	5.795	-0.766	-0.578	0.430	-0.204	0.176
		EQEW	0.740	-0.260	-0.201	0.173	0.132	-0.099	0.050	-0.041
		EQNS	-2.210	0.336	-0.123	-0.395	-0.241	0.172	-0.091	0.120
		EQZ	0.063	-0.102	-0.056	-0.091	-0.107	0.070	-0.132	0.109
		EQT	0.194	-0.086	0.031	0.019	0.013	-0.011	0.006	-0.006
		SPKW	0.062	-0.921	0.092	-0.029	-0.029	0.019	-0.015	0.002
		SPKN	-0.322	0.121	-0.031	-0.002	-0.004	0.002	0.000	0.003
	93182	OTHR	0.471	-0.250	-0.007	-0.025	0.019	0.010	0.001	0.088
		TEMP	6.154	-5.153	-1.520	-0.480	-2.502	-0.114	0.105	1.898
		EQEW	-0.084	-0.021	-0.148	0.083	0.458	0.014	-0.022	-0.413
		EQNS	-0.562	-0.143	-0.464	-0.087	-0.334	-0.010	0.019	0.309
		EQZ	-0.101	-0.089	-0.021	-0.034	-0.118	-0.007	0.009	0.174
		EQT	0.077	0.030	-0.054	0.008	0.041	0.000	-0.002	-0.037
		SPKW	-0.163	-0.980	-0.027	-0.030	-0.154	-0.010	0.008	0.163
		SPKN	-0.266	-0.030	0.062	0.003	0.012	0.001	-0.001	-0.011
	93111	OTHR	-0.057	0.479	-0.093	0.035	-0.022	-0.002	0.045	-0.005
		TEMP	-4.497	6.824	-0.447	-2.369	-0.414	-0.066	1.593	0.001
		EQEW	0.141	0.032	-0.216	0.000	-0.009	-0.025	0.011	0.004
		EQNS	-0.075	-0.104	0.020	0.080	0.000	0.008	-0.054	0.002
		EQZ	-0.058	-0.120	0.023	-0.136	-0.034	-0.005	0.160	0.003
		EQT	0.008	0.005	-0.006	-0.001	-0.002	-0.002	0.003	0.000
		SPKW	0.019	-0.225	0.024	0.019	0.004	0.001	-0.014	0.000
		SPKN	-0.936	-0.149	0.125	-0.149	-0.027	-0.007	0.131	-0.001

Table 3G.1-49

Combined Forces and Moments: RB, Selected Load Combination RB-9b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
26 Slab EL17.5m @ RCCV	96144	OTHR	0.036	0.552	0.981	0.045	0.066	-0.062	0.120	-0.100
		TEMP	0.733	5.828	8.140	-0.230	-0.175	0.172	-0.041	0.066
		EQEW	-0.135	-0.266	-0.205	0.151	0.125	-0.097	0.048	-0.018
		EQNS	-0.484	0.162	0.142	-0.313	-0.250	0.168	-0.065	0.076
		EQZ	0.239	-0.170	-0.124	-0.056	-0.058	0.040	-0.097	0.074
		EQT	0.137	-0.045	-0.003	0.013	0.011	-0.007	0.003	-0.001
		SPKW	0.019	-0.035	0.001	-0.003	-0.002	0.001	-0.001	-0.001
		SPKN	-0.059	0.032	-0.002	0.002	-0.001	-0.001	0.001	-0.001
	96186	OTHR	1.034	-0.383	-0.012	-0.035	-0.124	-0.004	0.006	0.061
		TEMP	9.998	-4.559	-2.164	-0.149	-0.672	-0.057	0.023	0.636
		EQEW	-0.434	0.196	-0.261	0.112	0.624	0.022	-0.033	-0.498
		EQNS	-0.592	-0.131	-0.041	-0.074	-0.339	-0.010	0.025	0.271
		EQZ	-0.239	0.093	0.038	-0.003	-0.002	-0.005	0.006	0.052
		EQT	0.071	0.033	-0.070	0.005	0.027	-0.001	-0.002	-0.023
		SPKW	0.042	0.013	-0.004	-0.009	-0.044	-0.002	0.002	0.035
		SPKN	-0.073	-0.028	0.033	0.001	0.004	0.001	0.000	-0.003
	96113	OTHR	-0.366	1.418	-0.249	-0.065	-0.006	-0.007	0.174	0.026
		TEMP	-9.167	5.153	-1.808	-4.376	-2.755	-0.236	1.009	-0.100
		EQEW	0.084	-0.188	0.581	0.078	0.029	0.003	-0.024	0.039
		EQNS	0.214	-1.016	-0.015	0.456	-0.039	-0.008	-0.426	-0.064
		EQZ	0.067	-0.427	0.079	0.132	-0.032	-0.016	-0.157	-0.020
		EQT	0.005	-0.010	0.225	0.009	0.009	0.009	0.004	0.012
		SPKW	-0.036	-0.094	-0.005	0.036	0.010	0.002	-0.023	-0.002
		SPKN	0.033	0.096	0.008	-0.101	-0.022	-0.003	0.072	0.006
27 Slab EL27.0m @ RCCV	98472	OTHR	0.580	0.496	-0.094	0.033	0.043	-0.041	0.182	-0.183
		TEMP	-3.634	-3.174	5.923	-1.728	-1.314	-0.297	0.535	-0.686
		EQEW	0.134	-0.988	-0.434	-0.013	-0.032	0.005	-0.041	0.047
		EQNS	1.002	-0.251	-0.205	-0.188	-0.233	0.105	-0.090	0.122
		EQZ	-0.341	0.011	-0.110	-0.186	-0.285	0.206	-0.230	0.258
		EQT	-0.117	0.108	0.040	0.021	0.023	-0.012	0.013	-0.011
		SPKW	0.034	-0.014	-0.016	-0.005	-0.006	0.003	-0.005	0.003
		SPKN	-0.072	0.028	0.016	0.001	0.000	0.000	0.001	0.000
	98514	OTHR	0.405	0.304	0.217	-0.035	-0.290	0.006	0.003	-0.004
		TEMP	-2.861	-2.861	-1.575	-1.927	-1.717	-0.031	0.065	-0.722
		EQEW	-0.426	0.174	-0.383	0.063	0.484	-0.007	-0.011	-0.325
		EQNS	-0.239	-0.147	-0.193	-0.069	-0.240	0.005	0.008	0.256
		EQZ	0.034	-0.088	-0.059	-0.037	-0.115	-0.024	0.000	0.171
		EQT	0.090	0.001	-0.036	0.005	0.021	-0.003	-0.002	-0.021
		SPKW	0.026	-0.006	-0.006	-0.006	-0.029	-0.001	0.000	0.024
		SPKN	-0.021	-0.005	0.023	0.001	-0.001	0.001	0.000	0.000
	98424	OTHR	-0.161	1.098	-0.103	-0.164	-0.058	-0.114	-0.356	-0.041
		TEMP	-6.661	-7.075	-2.107	-3.864	-0.717	0.116	-5.743	0.001
		EQEW	0.236	-0.165	-5.772	0.064	0.050	-0.180	0.048	0.098
		EQNS	0.935	-1.153	0.103	0.127	-0.148	0.099	1.044	0.050
		EQZ	0.218	-0.319	-0.008	-0.719	-0.214	0.047	1.004	0.064
		EQT	0.030	0.005	-0.994	0.012	0.015	0.025	0.001	0.023
		SPKW	-0.001	0.003	-0.002	0.010	0.013	-0.003	-0.032	-0.002
		SPKN	0.001	0.001	0.002	-0.016	-0.020	0.003	0.049	0.002

Table 3G.1-49

Combined Forces and Moments: RB, Selected Load Combination RB-9b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
28 Pool Girder @ Storage Pool	123054	OTHR	0.204	0.168	0.735	0.057	0.034	-0.085	-0.052	-0.046
		TEMP	3.582	1.292	2.390	3.612	2.453	-0.343	0.113	0.316
		EQEW	0.346	0.142	0.151	0.329	0.157	-0.068	0.025	0.209
		EQNS	-0.161	1.563	-0.510	-0.070	-0.003	0.024	-0.010	0.023
		EQZ	-0.418	2.390	0.732	-0.048	-0.028	-0.052	0.007	0.024
		EQT	0.059	-0.205	-0.022	0.058	0.026	-0.010	0.002	0.018
		SPKW	0.007	-0.019	-0.009	0.003	0.002	-0.001	0.000	0.001
		SPKN	-0.023	0.036	-0.006	-0.003	-0.002	0.001	-0.001	-0.001
	123154	OTHR	0.301	-0.109	0.664	0.069	0.029	-0.074	-0.059	0.022
		TEMP	3.638	3.573	-2.903	3.370	1.304	-0.375	-0.255	0.413
		EQEW	-0.375	0.352	0.698	0.191	-0.067	-0.089	0.037	-0.008
		EQNS	-1.233	0.501	-0.406	-0.103	-0.035	0.015	-0.033	0.003
		EQZ	-1.388	0.436	0.560	-0.072	-0.034	-0.096	-0.022	-0.007
		EQT	-0.105	-0.124	0.027	0.047	0.002	-0.011	0.003	0.000
		SPKW	-0.008	-0.007	-0.005	0.002	0.000	-0.001	0.000	0.000
		SPKN	-0.017	0.010	-0.008	-0.003	-0.001	0.002	0.000	0.000
29 Pool Girder @ Cavity	123062	OTHR	0.413	-0.770	-1.058	-0.024	0.090	0.005	0.053	0.079
		TEMP	0.502	0.112	-1.366	3.839	3.894	0.009	0.033	0.189
		EQEW	-0.434	0.924	0.205	0.076	0.040	-0.040	-0.059	0.058
		EQNS	-0.152	-0.112	0.300	-0.072	-0.019	-0.024	0.025	0.017
		EQZ	-0.465	-0.598	-0.336	0.024	0.163	-0.031	0.000	0.087
		EQT	0.081	0.002	-0.067	-0.005	-0.006	-0.004	0.004	0.001
		SPKW	0.015	0.000	0.000	0.000	0.001	0.000	-0.001	0.000
		SPKN	-0.020	0.001	0.002	0.000	0.000	0.000	0.000	-0.001
	123162	OTHR	0.918	-0.282	-0.819	0.009	-0.006	-0.001	0.002	-0.020
		TEMP	1.956	0.408	-1.831	3.805	2.820	0.092	-0.289	0.644
		EQEW	-0.560	0.907	0.222	0.102	-0.017	0.008	-0.115	-0.018
		EQNS	-0.923	-0.130	0.184	-0.152	-0.036	-0.019	0.056	0.002
		EQZ	1.265	-0.170	-0.200	0.073	0.059	-0.027	-0.090	-0.039
		EQT	0.120	0.003	-0.101	-0.010	-0.009	-0.007	0.010	0.003
		SPKW	-0.022	-0.002	0.002	0.000	0.000	0.001	0.000	0.000
		SPKN	0.006	0.001	-0.001	0.000	0.000	0.000	0.000	0.000
30 Pool Girder @ Fuel Pool	123067	OTHR	0.218	1.123	-0.404	-0.014	-0.078	0.006	-0.047	-0.051
		TEMP	-2.007	-7.205	-2.944	3.600	3.532	-0.636	0.318	0.813
		EQEW	0.073	0.122	0.288	0.162	0.145	0.059	0.023	0.256
		EQNS	-0.644	1.895	0.900	0.094	0.043	0.024	0.036	0.040
		EQZ	-0.503	2.667	-1.237	-0.015	0.047	0.078	0.118	0.054
		EQT	0.036	0.061	-0.084	-0.040	-0.046	-0.019	-0.012	-0.036
		SPKW	0.005	-0.006	0.018	0.004	0.003	0.002	0.001	0.003
		SPKN	-0.014	0.025	0.002	-0.005	-0.002	-0.002	0.000	-0.002
	123167	OTHR	-0.453	0.262	-0.420	0.004	-0.029	0.024	-0.058	0.003
		TEMP	-0.584	-2.758	-3.092	2.757	1.832	-0.245	-0.178	0.615
		EQEW	-0.405	0.441	-0.305	0.042	-0.117	0.066	-0.051	-0.018
		EQNS	-1.125	0.351	1.205	0.031	0.033	0.004	0.006	0.003
		EQZ	-0.679	0.641	-1.015	-0.040	-0.022	-0.011	0.032	-0.008
		EQT	0.189	0.062	-0.033	-0.022	0.004	-0.010	-0.002	-0.003
		SPKW	-0.012	-0.001	0.015	0.001	0.000	0.001	0.000	0.000
		SPKN	0.009	0.007	0.001	-0.004	0.000	-0.001	0.001	0.000

Table 3G.1-49

Combined Forces and Moments: RB, Selected Load Combination RB-9b (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
31 MS Tunnel Wall and Slab	150122	OTHR	0.037	-0.263	0.345	0.027	0.108	0.018	-0.008	-0.061
		TEMP	0.316	-0.714	1.798	0.940	3.102	0.011	-0.551	0.426
		EQEW	-0.002	0.117	-0.022	-0.031	-0.114	-0.044	0.008	0.254
		EQNS	-0.011	0.177	-0.048	-0.038	-0.144	-0.009	0.008	-0.030
		EQZ	0.026	-0.083	-0.250	-0.017	-0.020	-0.016	0.010	0.049
		EQT	-0.005	0.032	-0.014	-0.013	-0.015	-0.020	0.001	0.070
		SPKW	0.002	-0.012	0.001	0.001	0.002	-0.001	0.000	0.001
		SPKN	-0.001	0.005	0.000	0.000	0.002	0.001	0.000	0.001
	96611	OTHR	-0.035	0.592	-0.040	0.090	-0.013	-0.045	-0.082	0.015
		TEMP	-0.557	4.665	-0.414	-1.253	-7.115	-0.406	0.420	0.206
		EQEW	0.034	-0.078	-0.059	-0.013	-0.065	0.102	-0.004	-0.075
		EQNS	0.034	-0.291	0.032	-0.098	-0.390	-0.021	0.042	0.016
		EQZ	0.014	-0.303	0.015	-0.044	0.161	0.065	0.071	-0.022
		EQT	0.007	-0.018	-0.019	-0.002	-0.008	0.046	-0.002	-0.019
		SPKW	-0.006	0.045	-0.005	0.001	0.005	0.000	-0.001	0.000
		SPKN	0.008	-0.060	0.006	0.005	0.013	0.002	-0.002	-0.001
	98614	OTHR	-0.013	-0.227	-0.017	-0.152	-0.936	-0.127	-0.005	0.052
		TEMP	-0.043	0.730	-0.044	-0.852	-9.932	-0.019	0.460	0.307
		EQEW	0.016	0.007	-0.009	0.034	0.114	0.346	-0.032	-0.021
		EQNS	0.043	-0.218	0.034	0.124	0.444	0.050	-0.039	-0.018
		EQZ	0.016	0.219	0.015	0.003	0.460	0.054	0.039	-0.029
		EQT	0.000	0.013	0.012	0.005	0.011	0.098	-0.006	-0.026
		SPKW	0.001	-0.005	0.001	-0.007	-0.015	-0.003	0.002	0.001
		SPKN	-0.001	0.019	-0.001	0.006	0.006	0.002	-0.002	-0.001

Table 3G.1-50

Sectional Thicknesses and Rebar Ratios of RB Used in the Evaluation

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Direction 1*1		Direction2*1			
				Arrangement*2	Ratio (%)	Arrangement*2	Ratio (%)	Arrangement	Ratio (%)
18 Wall Below RCCV Bottom	6 13 24	2.0	Inside	2-#18@300	0.860	3-#18@0.9º	1.297	#9@0.9ºx300	0.721
			Outside	3-#18@300	1.290	3-#18@0.9º +1-#18@0.9º	1.729		
19 Wall Below Below RCCV Mid-Height	806 813 824	2.0	Inside	2-#18@300	0.860	3-#18@0.9º	1.297	#9@1.2ºx600	0.270
			Outside	3-#18@300	1.290	3-#18@0.9º	1.297		
20 Wall Below RCCV Top	1606 1613 1624	2.0	Inside	2-#18@300	0.860	3-#18@0.9º	1.297	#9@1.2ºx300	0.540
			Outside	3-#18@300	1.290	3-#18@0.9º +1-#18@1.8º	1.513		
21 Exterior Wall @ EL-11.50 ~-10.50m	20011 20023	2.0	Inside	4-#11@200 +1-#11@400	1.132	5-#11@200 (+1-#11@200)	1.510	#7@400x200	0.484
			Outside	4-#11@200 +1-#11@400	1.132	5-#11@200	1.258		
	30010 30020	2.0	Inside	3-#11@200 +1-#11@400	0.881	4-#11@200	1.006	#6@400x400	0.177
			Outside	3-#11@200 +1-#11@400	0.881	4-#11@200	1.006		
	40001 40011	2.0	Inside	3-#11@200	0.755	3-#11@200	0.755	#6@400x400	0.177
			Outside	3-#11@200	0.755	3-#11@200	0.755		
22 Exterior Wall @ EL4.65 ~6.60m	22011	1.5	Inside	3-#11@200 +1-#11@400	1.174	4-#11@200 (+1-#11@200)	1.677	#7@400x200	0.484
			Outside	3-#11@200 +1-#11@400	1.174	4-#11@200 (+1-#11@200)	1.677		
	22023	1.5	Inside	3-#11@200 +1-#11@400	1.174	4-#11@200	1.342	#7@400x200	0.484
			Outside	3-#11@200 +1-#11@400	1.174	4-#11@200	1.342		
	32010	1.5	Inside	3-#11@200	1.006	3-#11@200	1.006	#6@400x400	0.177
			Outside	3-#11@200 (+2-#11@200)	1.677	3-#11@200 (+2-#11@200)	1.677		
	32020	1.5	Inside	3-#11@200	1.006	3-#11@200	1.006	#6@400x400	0.177
			Outside	3-#11@200	1.006	3-#11@200	1.006		
	42001	1.5	Inside	3-#11@200	1.006	3-#11@200	1.006	#7@400x400	0.242
			Outside	4-#11@200	1.342	4-#11@200	1.342		

Note *1: Wall Below RCCV Direction1: Hoop, Direction2: Vertical
Exterior Wall Direction1: Horizontal, Direction2: Vertical
Slab/MS Tunnel Slab Direction1: N-S, Direction2: E-W
Pool Girder Direction1: Horizontal, Direction2: Vertical
MS Tunnel Wall Direction1: Horizontal, Direction2: Vertical
Basemat Direction1: Top; Radial; Bottom; N-S, Direction2: Top; Circumferential; Bottom; E-W
Note *2: Rebar in parentheses indicates additional bars locally required.

Table 3G.1-50

Sectional Thicknesses and Rebar Ratios of RB Used in the Evaluation (Continued)

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Direction 1*1		Direction2*1			
				Arrangement*2	Ratio (%)	Arrangement*2	Ratio (%)	Arrangement	Ratio (%)
22 Exterior Wall @ EL4.65 ~6.60m	42011	1.5	Inside	3-#11@200	1.006	3-#11@200	1.006	#7@400x400	0.242
			Outside	4-#11@200 (+1-#11@200)	1.677	4-#11@200 (+1-#11@200)	1.677		
23 Exterior Wall @ EL22.50 ~24.60m	24211	1.5	Inside	3-#11@200 +1-#11@400	1.174	4-#11@200	1.342	#7@400x200	0.484
			Outside	3-#11@200 +1-#11@400	1.174	4-#11@200	1.342		
	24224	1.5	Inside	3-#11@200 +1-#11@400	1.174	4-#11@200	1.342	#7@200x200	0.968
			Outside	3-#11@200 +1-#11@400	1.174	4-#11@200	1.342		
	34210	1.5	Inside	3-#11@200	1.006	3-#11@200	1.006	#6@400x400	0.177
			Outside	3-#11@200 (+2-#11@200)	1.677	3-#11@200 (+2-#11@200)	1.677		
	34220	1.5	Inside	3-#11@200	1.006	3-#11@200	1.006	#6@200x200	0.710
			Outside	3-#11@200	1.006	3-#11@200	1.006		
	44201	1.5	Inside	3-#11@200	1.006	3-#11@200	1.006	#7@200x200	0.968
			Outside	4-#11@200	1.342	4-#11@200	1.342		
24 Basemat @ Wall Below RCCV	90140 90182 90111	4.0	Top	4-#11@0.9°	0.321	2-#11@200 +2-#11@400	0.377	#11@0.9x400	0.801
			Bottom	5-#11@200	0.629	5-#11@200	0.629		
25 Slab EL4.65m @ RCCV	93140 93182 93111	1.0	Top	2-#11@200	1.006	2-#11@200	1.006	#5@200x200	0.500
			Bottom	PLATE t=16	-	PLATE t=16	-		
26 Slab EL17.5m @ RCCV	96144 96186	1.0	Top	2-#11@200	1.006	2-#11@200	1.006	#5@200x200	0.500
			Bottom	PLATE t=16	-	PLATE t=16	-		
	96113	1.6	Top	2-#11@200	0.629	2-#11@200	0.629	#5@200x200	0.500
			Bottom	3-#11@200	0.944	3-#11@200	0.944		

Note *1: Wall Below RCCV Direction1: Hoop, Direction2: Vertical
Exterior Wall Direction1: Horizontal, Direction2: Vertical
Slab/MS Tunnel Slab Direction1: N-S, Direction2: E-W
Pool Girder Direction1: Horizontal, Direction2: Vertical
MS Tunnel Wall Direction1: Horizontal, Direction2: Vertical
Basemat Direction1: Top; Radial; Bottom; N-S, Direction2: Top; Circumferential; Bottom; E-W
Note *2: Rebar in parentheses indicates additional bars locally required.

Table 3G.1-50

Sectional Thicknesses and Rebar Ratios of RB Used in the Evaluation (Continued)

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Direction 1*1		Direction2*1			
				Arrangement*2	Ratio (%)	Arrangement*2	Ratio (%)	Arrangement	Ratio (%)
27 Slab EL27.0m @ RCCV	98472 98514	1.0	Top	3-#11@200	1.510	3-#11@200	1.510	#5@200x200	0.500
			Bottom	PLATE t=25	-	PLATE t=25	-		
	98424	2.4	Top	4-#11@200	0.839	4-#11@200	0.839	#5@200x200	0.500
			Bottom	4-#11@200	0.839	4-#11@200	0.839		
28 Pool Girder @ Storage Pool	123054 123154	1.6	Inside	3-#11@200	0.944	3-#11@200	0.944	#7@400x200	0.484
			Outside	3-#11@200	0.944	3-#11@200	0.944		
29 Pool Girder @ Cavity	123062 123162	1.6	Inside	3-#11@200	0.944	3-#11@200	0.944	#7@400x400	0.242
			Outside	3-#11@200	0.944	3-#11@200	0.944		
30 Pool Girder @ Fuel Pool	123067 123167	1.6	Inside	3-#11@200	0.944	3-#11@200	0.944	#7@400x200	0.484
			Outside	3-#11@200	0.944	3-#11@200	0.944		
	123167	1.6	Inside	3-#11@200	0.944	3-#11@200	0.944	#7@400x200	0.484
			Outside	3-#11@200	0.944	3-#11@200	0.944		
31 MS Tunnel Wall and Slab	150122	1.3	Inside	2-#11@200	0.774	2-#11@200	0.774	#6@400x400	0.177
			Outside	2-#11@200 +1-#11@400	0.968	2-#11@200 +1-#11@400	0.968		
	96611	1.6	Top	2-#11@200	0.629	2-#11@200	0.629	#5@200x200	0.500
			Bottom	3-#11@200	0.944	3-#11@200	0.944		
	98614	2.4	Top	4-#11@200	0.839	4-#11@200	0.839	#5@200x200	0.500
			Bottom	3-#11@200	0.629	3-#11@200	0.629		

Note *1: Wall Below RCCV Direction1: Hoop, Direction2: Vertical
Exterior Wall Direction1: Horizontal, Direction2: Vertical
Slab/MS Tunnel Slab Direction1: N-S, Direction2: E-W
Pool Girder Direction1: Horizontal, Direction2: Vertical
MS Tunnel Wall Direction1: Horizontal, Direction2: Vertical
Basemat Direction1: Top; Radial; Bottom; N-S, Direction2: Top: Circumferential; Bottom;E-W

Note *2: Rebar in parentheses indicates additional bars locally required.

Table 3G.1-51

Rebar and Concrete Stresses of RB: Selected Load Combination RB-4

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
				Calculated				Allowable
		Calculated	Allowable	Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
18 Wall	6	-3.8	-29.3	3.0	3.2	-25.2	-21.5	372.2
Below RCCV	13	-4.3	-29.3	0.9	1.1	-28.2	-24.2	372.2
Bottom	24	-5.5	-29.3	3.4	3.3	-34.4	-22.5	372.2
19 Wall Below	806	-4.6	-29.3	2.6	2.9	-17.9	-28.1	372.2
Below RCCV	813	-5.1	-29.3	-0.8	0.7	-20.3	-31.3	372.2
Mid-Height	824	-6.1	-29.3	-1.0	-0.9	-21.1	-35.9	372.2
20 Wall	1606	-5.9	-29.3	9.9	14.7	-34.2	-12.4	372.2
Below RCCV	1613	-8.2	-29.3	13.4	16.9	-45.5	-8.6	372.2
Top	1624	-9.3	-29.3	15.6	23.4	-51.4	-11.0	372.2
21 Exterior Wall	20011	-1.5	-29.3	2.2	0.5	4.9	-6.7	372.2
@ EL-11.50	20023	-5.1	-29.1	-17.5	16.1	-14.0	11.1	370.5
~-10.50m	30010	-1.8	-29.3	0.2	-9.5	0.1	-3.6	372.2
	30020	-2.1	-29.3	-7.5	1.4	-4.7	-12.2	372.2
	40001	-1.8	-29.3	-4.2	-0.9	-6.4	-10.0	372.2
	40011	-1.0	-29.3	0.1	-4.2	1.4	-4.7	372.2
22 Exterior Wall	22011	-1.2	-29.3	27.4	28.4	10.1	5.7	372.2
@ EL4.65	22023	-4.6	-29.3	9.3	7.1	-25.0	-27.4	372.2
~6.60m	32010	-3.2	-29.3	18.1	96.1	-7.8	35.1	372.2
	32020	-3.6	-29.3	5.7	46.2	-5.5	54.6	372.2
	42001	-3.3	-29.3	7.8	32.3	-10.3	27.0	372.2
	42011	-4.1	-29.3	27.3	89.4	-12.8	20.1	372.2
23 Exterior Wall	24211	-2.1	-29.3	6.1	15.7	-7.6	10.8	372.2
@ EL22.50	24224	-2.3	-29.3	22.2	-0.1	5.0	8.6	372.2
~24.60m	34210	-4.7	-29.3	53.4	184.1	7.8	152.4	372.2
	34220	-3.9	-29.3	25.8	4.7	-12.4	52.5	372.2
	44201	-0.6	-29.3	53.4	34.5	6.4	72.3	372.2
24 Basemat	90140	-1.9	-23.5	-12.6	-2.8	1.5	-0.2	372.2
@ Wall	90182	-2.3	-23.5	-13.2	-4.2	-0.4	7.7	372.2
Below RCCV	90111	-3.2	-23.5	-19.4	6.1	3.2	-0.8	372.2
25 Slab	93140	-7.1	-29.3	42.0	37.9	73.4	46.6	372.2 (223.3)
EL4.65m	93182	-13.0	-29.3	16.3	23.8	-61.1	64.4	372.2 (223.3)
@ RCCV	93111	-12.9	-29.3	-60.0	69.0	34.1	34.8	372.2 (223.3)
26 Slab	96144	-4.2	-29.3	84.9	38.5	118.0	46.4	372.2 (223.3)
EL17.5m	96186	-5.2	-29.3	47.1	36.1	-28.6	25.1	372.2 (223.3)
@ RCCV	96113	-11.1	-28.8	-46.9	76.9	-30.2	57.1	368.2
27 Slab	98472	-10.2	-29.1	168.2	39.2	160.6	22.3	370.5 (222.2)
EL27.0m	98514	-5.5	-29.1	-2.7	31.4	-16.3	8.0	370.5 (222.2)
@ RCCV	98424	-9.2	-28.1	-37.3	26.9	-43.2	-36.5	363.0
28 Pool Girder	123054	-8.8	-29.0	14.1	69.2	-43.6	-2.7	369.8
@ Storage Pool	123154	-3.5	-29.0	28.7	120.9	5.2	68.4	369.8
29 Pool Girder	123062	-2.0	-28.4	-13.3	-11.1	33.1	11.1	365.1
@ Cavity	123162	-2.7	-28.4	-19.3	-18.9	15.4	3.2	365.1
30 Pool Girder	123067	-5.7	-28.4	-13.2	-2.9	-34.6	-28.7	365.1
@ Fuel Pool	123167	-4.2	-28.4	-12.8	-6.9	-6.7	-18.4	365.1
31 MS Tunnel	150122	-13.6	-29.3	14.0	169.6	-22.8	220.7	372.2
Wall and Slab	96611	-8.6	-29.3	1.4	5.1	-21.3	193.7	372.2
	98614	-6.3	-29.3	2.8	2.6	-3.7	151.3	372.2

Note: Negative value means compression.

Note *1: Wall Below RCCV — Direction1: Hoop, Direction2: Vertical
Exterior Wall — Direction1: Horizontal, Direction2: Vertical
Slab/MS Tunnel Slab — Direction1: N-S, Direction2: E-W
Pool Girder — Direction1: Horizontal, Direction2: Vertical
MS Tunnel Wall — Direction1: Horizontal, Direction2: Vertical
Basemat — Direction1: Top; Radial, Bottom; N-S, Direction2: Top; Circumferential, Bottom; E-W

Note *2: Value in parentheses indicates the allowable stress of the steel plate.

Table 3G.1-52

Rebar and Concrete Stresses of RB: Selected Load Combination RB-8a

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
				Calculated				Allowable
		Calculated	Allowable	Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
18 Wall	6	-8.3	-29.3	-2.1	-2.2	-10.2	-44.9	372.2
Below RCCV	13	-7.7	-29.3	-2.0	-2.8	-15.1	-43.3	372.2
Bottom	24	-6.0	-29.3	0.6	-0.4	-21.4	-36.3	372.2
19 Wall Below	806	-6.0	-29.3	3.1	4.5	-20.4	-35.9	372.2
Below RCCV	813	-6.4	-29.3	1.8	2.5	-22.4	-38.3	372.2
Mid-Height	824	-6.8	-29.3	1.4	1.4	-20.8	-39.6	372.2
20 Wall	1606	-15.8	-29.3	32.5	87.1	-70.7	43.3	372.2
Below RCCV	1613	-17.7	-29.3	35.2	88.3	-79.4	47.9	372.2
Top	1624	-16.9	-29.3	41.9	92.6	-84.0	53.2	372.2
21 Exterior Wall	20011	-4.6	-29.3	21.7	1.9	34.2	-14.5	372.2
@ EL-11.50	20023	-4.4	-29.1	-13.8	19.6	-15.5	5.7	370.5
~-10.50m	30010	-5.6	-29.3	44.1	0.0	60.6	-15.8	372.2
	30020	-2.2	-29.3	-5.5	3.7	-9.6	-13.1	372.2
	40001	-1.9	-29.3	-3.7	2.9	-11.4	-11.5	372.2
	40011	-2.7	-29.3	9.2	-0.5	15.4	-12.3	372.2
22 Exterior Wall	22011	-3.1	-29.3	72.4	70.5	27.5	12.4	372.2
@ EL4.65	22023	-3.5	-29.3	29.3	5.3	-22.9	-23.0	372.2
~6.60m	32010	-0.8	-29.3	103.6	199.6	-21.0	159.5	372.2
	32020	-0.8	-29.3	6.6	0.9	-2.3	5.2	372.2
	42001	-0.6	-29.3	21.8	9.7	-20.7	15.3	372.2
	42011	-8.2	-29.3	64.1	127.7	-18.7	86.6	372.2
23 Exterior Wall	24211	-0.4	-29.3	50.5	50.4	4.4	16.6	372.2
@ EL22.50	24224	-1.7	-29.3	26.2	-3.7	2.9	3.4	372.2
~24.60m	34210	-0.5	-29.3	113.9	205.2	7.6	150.1	372.2
	34220	-2.5	-29.3	42.5	4.8	-2.8	33.4	372.2
	44201	-0.2	-29.3	48.8	17.1	-3.7	51.4	372.2
24 Basemat	90140	-1.7	-23.5	-10.2	2.4	-1.4	-0.2	372.2
@ Wall	90182	-1.9	-23.5	-8.1	8.5	-2.1	9.8	372.2
Below RCCV	90111	-2.1	-23.5	-12.9	2.0	0.2	9.4	372.2
25 Slab	93140	-8.3	-29.3	104.3	69.2	157.7	81.1	372.2 (223.3)
EL4.65m	93182	-13.3	-29.3	69.8	56.1	-66.4	50.0	372.2 (223.3)
@ RCCV	93111	-12.0	-29.3	-59.7	53.4	80.1	60.3	372.2 (223.3)
26 Slab	96144	-10.5	-29.3	249.8	105.0	329.4	120.2	372.2 (223.3)
EL17.5m	96186	-6.8	-29.3	147.7	74.2	-36.9	-8.3	372.2 (223.3)
@ RCCV	96113	-13.1	-28.8	-90.7	36.5	55.6	104.1	368.2
27 Slab	98472	-8.1	-29.1	158.7	33.4	157.4	32.5	370.3 (222.2)
EL27.0m	98514	-4.3	-29.1	9.8	40.6	-12.5	12.7	370.3 (222.2)
@ RCCV	98424	-8.0	-28.1	-32.9	31.2	-25.8	-17.9	363.0
28 Pool Girder	123054	-6.8	-29.0	27.9	135.6	0.7	114.6	369.8
@ Storage Pool	123154	-2.3	-29.0	5.5	67.4	20.9	50.7	369.8
29 Pool Girder	123062	-2.8	-28.4	41.1	57.7	20.4	55.5	365.0
@ Cavity	123162	-2.1	-28.4	60.8	68.5	52.2	49.7	365.0
30 Pool Girder	123067	-3.4	-28.4	17.3	42.7	41.8	56.0	365.0
@ Fuel Pool	123167	-4.2	-28.4	9.9	18.6	33.7	15.3	365.0
31 MS Tunnel	150122	-11.5	-29.3	14.8	141.8	-22.0	174.9	372.2
Wall and Slab	96611	-5.9	-29.3	-1.4	-1.0	-7.9	171.5	372.2
	98614	-6.3	-29.3	2.3	11.2	-5.4	137.4	372.2

Note: Negative value means compression.

Note *1: Wall Below RCCV Direction1: Hoop, Direction2: Vertical
Exterior Wall Direction1: Horizontal, Direction2: Vertical
Slab/MS Tunnel Slab Direction1: N-S, Direction2: E-W
Pool Girder Direction1: Horizontal, Direction2: Vertical
MS Tunnel Wall Direction1: Horizontal, Direction2: Vertical
Basemat Direction1: Top; Radial, Bottom; N-S, Direction2: Top; Circumferential, Bottom; E-W

Note *2: Value in parentheses indicates the allowable stress of the steel plate.

Table 3G.1-53

Rebar and Concrete Stresses of RB: Selected Load Combination RB-8b

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
				Calculated				Allowable
		Calculated	Allowable	Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
18 Wall	6	-8.5	-29.3	-2.7	-2.9	-4.8	-44.6	372.2
Below RCCV	13	-8.9	-29.3	-3.0	-3.5	-9.6	-47.8	372.2
Bottom	24	-7.1	-29.3	0.0	-1.4	-15.5	-40.1	372.2
19 Wall Below	806	-6.3	-29.3	3.4	4.8	-17.0	-36.5	372.2
Below RCCV	813	-6.9	-29.3	2.4	4.5	-20.2	-40.2	372.2
Mid-Height	824	-7.1	-29.3	1.8	2.7	-17.6	-40.4	372.2
20 Wall	1606	-16.2	-29.3	50.8	101.9	-71.0	49.0	372.2
Below RCCV	1613	-18.5	-29.3	44.3	98.4	-81.7	54.2	372.2
Top	1624	-17.5	-29.3	51.8	103.5	-82.7	57.3	372.2
21 Exterior Wall	20011	-3.9	-29.3	20.0	2.1	34.6	-11.0	372.2
@ EL-11.50	20023	-4.3	-29.1	-13.9	19.7	-14.1	6.6	370.5
~-10.50m	30010	-5.7	-29.3	47.0	-0.9	68.4	-14.4	372.2
	30020	-2.4	-29.3	-5.9	5.4	-8.8	-13.9	372.2
	40001	-2.1	-29.3	-4.0	4.2	-10.5	-12.6	372.2
	40011	-2.7	-29.3	12.5	0.2	22.3	-10.9	372.2
22 Exterior Wall	22011	-2.5	-29.3	95.1	100.4	41.7	26.8	372.2
@ EL4.65	22023	-3.3	-29.3	37.0	4.7	-18.3	-20.4	372.2
~6.60m	32010	-0.6	-29.3	110.6	213.8	7.4	184.0	372.2
	32020	-2.4	-29.3	7.4	7.7	-8.0	23.2	372.2
	42001	-4.8	-29.3	29.8	15.1	-20.4	35.2	372.2
	42011	-6.6	-29.3	62.1	136.2	-7.0	102.0	372.2
23 Exterior Wall	24211	-0.3	-29.3	97.9	81.6	69.2	40.2	372.2
@ EL22.50	24224	-3.2	-29.3	48.2	-5.5	18.1	4.3	372.2
~24.60m	34210	-0.3	-29.3	144.4	241.8	36.2	173.8	372.2
	34220	-4.5	-29.3	66.6	-7.2	-2.5	6.2	372.2
	44201	-1.1	-29.3	68.8	-17.8	-19.2	53.6	372.2
24 Basemat	90140	-1.6	-23.5	-10.0	0.3	-1.4	-0.9	372.2
@ Wall	90182	-1.9	-23.5	-8.5	5.5	-1.5	10.6	372.2
Below RCCV	90111	-2.2	-23.5	-13.2	2.5	0.7	7.8	372.2
25 Slab	93140	-10.9	-29.3	149.1	95.6	195.9	100.1	372.2 (223.3)
EL4.65m	93182	-17.7	-29.3	83.0	69.3	-87.1	73.1	372.2 (223.3)
@ RCCV	93111	-16.1	-29.3	-77.5	75.7	90.7	71.8	372.2 (223.3)
26 Slab	96144	-10.5	-29.3	269.0	110.8	353.9	133.3	372.2 (223.3)
EL17.5m	96186	-8.7	-29.3	191.8	95.0	-39.0	8.4	372.2 (223.3)
@ RCCV	96113	-13.7	-28.8	-88.8	20.8	84.8	118.0	368.2
27 Slab	98472	-11.0	-27.6	0.7	89.2	14.1	75.6	359.4 (215.6)
EL27.0m	98514	-14.2	-27.6	-17.6	75.7	-20.5	80.7	359.4 (215.6)
@ RCCV	98424	-6.5	-28.1	-28.1	19.4	-13.8	-8.9	363.0
28 Pool Girder	123054	-8.1	-29.0	24.7	187.8	38.8	189.7	369.8
@ Storage Pool	123154	-4.8	-29.0	11.5	107.8	26.7	79.8	369.8
29 Pool Girder	123062	-13.2	-27.4	35.2	207.0	-0.7	191.7	358.3
@ Cavity	123162	-9.4	-27.4	52.4	237.4	13.3	183.7	358.3
30 Pool Girder	123067	-10.2	-27.4	22.7	166.7	-0.1	162.1	358.3
@ Fuel Pool	123167	-6.7	-27.4	22.9	151.9	17.0	134.1	358.3
31 MS Tunnel	150122	-11.8	-29.3	16.5	133.6	-26.0	166.1	372.2
Wall and Slab	96611	-5.8	-29.3	-1.7	0.5	-5.7	180.0	372.2
	98614	-6.7	-29.3	2.4	5.7	-9.2	128.1	372.2

Note: Negative value means compression.

Note *1:

Wall Below RCCV	Direction1: Hoop,	Direction2: Vertical
Exterior Wall	Direction1: Horizontal,	Direction2: Vertical
Slab/MS Tunnel Slab	Direction1: N-S,	Direction2: E-W
Pool Girder	Direction1: Horizontal,	Direction2: Vertical
MS Tunnel Wall	Direction1: Horizontal,	Direction2: Vertical
Basemat	Direction1: Top; Radial; Bottom; N-S,	Direction2: Top; Circumferential; Bottom;E-W

Note *2: Value in parentheses indicates the allowable stress of the steel plate.

Table 3G.1-54

Rebar and Concrete Stresses of RB: Selected Load Combination RB-9a

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
18 Wall	6	-22.0	-29.3	197.3	130.0	239.5	204.3	372.2
Below RCCV	13	-18.4	-29.3	172.2	108.2	250.1	137.9	372.2
Bottom	24	-12.1	-29.3	190.5	81.3	171.7	-47.8	372.2
19 Wall Below	806	-11.3	-29.3	166.0	99.7	178.5	129.4	372.2
Below RCCV	813	-11.6	-29.3	126.6	73.4	149.6	90.5	372.2
Mid-Height	824	-11.5	-29.3	190.0	98.5	153.7	78.3	372.2
20 Wall	1606	-21.6	-29.3	186.7	215.1	-102.6	300.9	372.2
Below RCCV	1613	-23.8	-29.3	95.3	190.6	-106.9	310.2	372.2
Top	1624	-22.8	-29.3	186.3	266.0	-103.3	316.9	372.2
21 Exterior Wall	20011	-17.0	-29.3	275.6	201.3	295.0	278.3	372.2
@ EL-11.50	20023	-9.6	-29.1	-40.5	98.7	46.8	113.0	370.5
~-10.50m	30010	-12.7	-29.3	222.5	135.4	350.7	169.3	372.2
	30020	-5.4	-29.3	-38.0	41.5	67.8	40.2	372.2
	40001	-6.3	-29.3	-49.9	54.3	101.7	58.9	372.2
	40011	-6.9	-29.3	272.8	171.4	273.6	135.3	372.2
22 Exterior Wall	22011	-14.5	-29.3	231.6	235.7	254.8	274.3	372.2
@ EL4.65	22023	-9.7	-29.3	155.8	92.8	157.1	166.9	372.2
~6.60m	32010	-14.7	-29.3	278.7	318.0	249.9	303.1	372.2
	32020	-7.2	-29.3	142.1	179.2	155.8	257.5	372.2
	42001	-9.0	-29.3	101.3	138.3	134.9	185.3	372.2
	42011	-12.3	-29.3	282.2	292.0	233.2	310.5	372.2
23 Exterior Wall	24211	-9.4	-29.3	257.9	257.2	241.6	206.0	372.2
@ EL22.50	24224	-9.1	-29.3	192.4	201.6	267.9	312.6	372.2
~24.60m	34210	-11.4	-29.3	289.3	307.7	224.6	257.1	372.2
	34220	-5.9	-29.3	167.7	109.7	129.2	152.3	372.2
	44201	-7.5	-29.3	204.2	120.1	163.2	173.5	372.2
24 Basemat	90140	-10.1	-23.5	101.8	134.8	125.2	109.3	372.2
@ Wall	90182	-10.8	-23.5	-41.6	136.4	160.4	97.6	372.2
Below RCCV	90111	-9.6	-23.5	-76.7	113.0	108.3	135.3	372.2
25 Slab	93140	-12.0	-29.3	230.9	87.3	182.4	77.0	372.2 (223.3)
EL4.65m	93182	-18.8	-29.3	98.3	59.4	-89.1	95.7	372.2 (223.3)
@ RCCV	93111	-14.7	-29.3	-72.9	62.4	74.2	54.8	372.2 (223.3)
26 Slab	96144	-13.2	-29.3	300.3	112.8	340.4	130.1	372.2 (223.3)
EL17.5m	96186	-10.7	-29.3	186.3	92.9	-60.3	-24.9	372.2 (223.3)
@ RCCV	96113	-18.2	-28.8	-116.0	78.7	108.8	146.8	368.2
27 Slab	98472	-12.6	-29.1	212.7	48.8	235.5	42.1	370.3 (222.2)
EL27.0m	98514	-7.5	-29.1	50.2	49.4	27.6	27.2	370.3 (222.2)
@ RCCV	98424	-8.7	-28.1	40.5	156.2	60.2	126.5	363.0
28 Pool Girder	123054	-8.3	-29.0	29.5	161.1	-39.7	189.3	369.8
@ Storage Pool	123154	-5.2	-29.0	66.2	141.7	62.5	66.2	369.8
29 Pool Girder	123062	-3.0	-28.4	65.3	64.3	52.0	67.7	365.0
@ Cavity	123162	-2.2	-28.4	84.6	102.1	57.1	59.0	365.0
30 Pool Girder	123067	-5.8	-28.4	55.5	67.1	137.6	142.5	365.0
@ Fuel Pool	123167	-5.7	-28.4	65.8	70.0	78.3	51.2	365.0
31 MS Tunnel	150122	-13.0	-29.3	16.7	160.5	-26.5	200.2	372.2
Wall and Slab	96611	-8.5	-29.3	-4.0	40.6	-18.6	194.2	372.2
	98614	-8.8	-29.3	4.9	57.7	-7.5	170.9	372.2

Note: Negative value means compression.

Note *1:		
Wall Below RCCV	Direction1: Hoop,	Direction2: Vertical
Exterior Wall	Direction1: Horizontal,	Direction2: Vertical
Slab/MS Tunnel Slab	Direction1: N-S,	Direction2: E-W
Pool Girder	Direction1: Horizontal,	Direction2: Vertical
MS Tunnel Wall	Direction1: Horizontal,	Direction2: Vertical
Basemat	Direction1: Top; Radial; Bottom; N-S,	Direction2: Top; Circumferential; Bottom; E-W

Note *2: Value in parentheses indicates the allowable stress of the steel plate.

Table 3G.1-55

Rebar and Concrete Stresses of RB: Selected Load Combination RB-9b

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
				Calculated				Allowable
		Calculated	Allowable	Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
18 Wall	6	-22.8	-29.3	219.7	136.9	261.8	210.3	372.2
Below RCCV	13	-19.9	-29.3	183.3	101.8	270.5	118.5	372.2
Bottom	24	-10.8	-29.3	207.9	77.6	192.4	-52.6	372.2
19 Wall Below	806	-11.8	-29.3	193.1	102.9	188.1	137.8	372.2
Below RCCV	813	-12.2	-29.3	134.5	76.2	162.6	94.5	372.2
Mid-Height	824	-12.0	-29.3	195.8	99.2	168.4	79.2	372.2
20 Wall	1606	-22.6	-29.3	211.0	236.4	-102.0	315.2	372.2
Below RCCV	1613	-25.8	-29.3	110.6	215.8	-113.2	330.6	372.2
Top	1624	-24.4	-29.3	205.3	287.5	-109.9	338.5	372.2
21 Exterior Wall	20011	-16.9	-29.3	271.7	209.5	310.5	282.1	372.2
@ EL-11.50	20023	-9.1	-29.1	-52.4	99.7	55.1	123.3	370.5
~-10.50m	30010	-13.2	-29.3	232.9	134.0	369.1	165.1	372.2
	30020	-5.3	-29.3	-38.6	44.3	73.3	42.1	372.2
	40001	-6.2	-29.3	-48.7	56.9	109.6	62.6	372.2
	40011	-7.6	-29.3	284.5	168.4	305.7	133.3	372.2
22 Exterior Wall	22011	-14.0	-29.3	261.4	267.4	281.9	304.8	372.2
@ EL4.65	22023	-9.5	-29.3	163.5	92.1	158.4	165.2	372.2
~6.60m	32010	-14.5	-29.3	316.6	353.5	275.3	324.8	372.2
	32020	-7.3	-29.3	159.6	173.3	168.7	259.1	372.2
	42001	-8.7	-29.3	131.6	119.9	147.2	183.2	372.2
	42011	-13.0	-29.3	309.6	332.1	253.1	323.0	372.2
23 Exterior Wall	24211	-9.4	-29.3	293.6	277.6	302.1	242.1	372.2
@ EL22.50	24224	-9.3	-29.3	222.8	194.5	272.8	309.8	372.2
~24.60m	34210	-13.4	-29.3	341.9	364.8	234.4	285.1	372.2
	34220	-10.2	-29.3	205.0	103.7	119.5	194.2	372.2
	44201	-7.5	-29.3	231.4	119.9	198.8	202.3	372.2
24 Basemat	90140	-9.7	-23.5	102.4	130.1	138.2	100.7	372.2
@ Wall	90182	-9.4	-23.5	-35.5	131.9	161.7	118.7	372.2
Below RCCV	90111	-11.1	-23.5	-77.2	113.9	105.0	132.4	372.2
25 Slab	93140	-14.6	-29.3	292.3	114.7	227.2	95.7	372.2 (223.3)
EL4.65m	93182	-23.2	-29.3	111.7	73.5	-109.7	121.7	372.2 (223.3)
@ RCCV	93111	-18.7	-29.3	-91.1	84.6	86.1	67.4	372.2 (223.3)
26 Slab	96144	-13.2	-29.3	343.2	123.0	357.7	141.4	372.2 (223.3)
EL17.5m	96186	-12.7	-29.3	225.5	112.1	-68.9	30.2	372.2 (223.3)
@ RCCV	96113	-17.9	-28.8	-108.7	63.7	131.7	157.1	368.2
27 Slab	98472	-14.3	-27.6	71.3	102.7	119.9	86.7	359.4 (215.6)
EL27.0m	98514	-17.4	-27.6	-23.6	80.7	-28.2	97.7	359.4 (215.6)
@ RCCV	98424	-8.3	-28.1	93.7	161.0	127.7	154.0	363.0
28 Pool Girder	123054	-10.1	-29.0	36.8	202.5	87.4	214.2	369.8
@ Storage Pool	123154	-9.3	-29.0	59.3	166.3	82.1	88.8	369.8
29 Pool Girder	123062	-13.6	-27.4	39.8	215.1	17.3	212.1	358.3
@ Cavity	123162	-10.6	-27.4	60.7	255.9	21.5	193.0	358.3
30 Pool Girder	123067	-12.7	-27.4	32.7	194.7	-58.0	257.5	358.3
@ Fuel Pool	123167	-7.1	-27.4	60.3	209.4	39.2	166.4	358.3
31 MS Tunnel	150122	-13.2	-29.3	18.3	152.3	-30.4	191.1	372.2
Wall and Slab	96611	-8.2	-29.3	-4.1	36.2	-16.7	200.8	372.2
	98614	-8.3	-29.3	4.9	59.4	-11.2	159.1	372.2

Note: Negative value means compression.

Note *1:

Wall Below RCCV	Direction1: Hoop,	Direction2: Vertical
Exterior Wall	Direction1: Horizontal,	Direction2: Vertical
Slab/MS Tunnel Slab	Direction1: N-S,	Direction2: E-W
Pool Girder	Direction1: Horizontal,	Direction2: Vertical
MS Tunnel Wall	Direction1: Horizontal,	Direction2: Vertical
Basemat	Direction1: Top; Radial; Bottom; N-S,	Direction2: Top; Circumferential; Bottom; E-W

Note *2: Value in parentheses indicates the allowable stress of the steel plate.

Table 3G.1-56

Transverse Shear of RB

Location	Element ID	Load ID	d (m)	pv (%)	Shear Force (MN/m)				Vu/ϕVn
					Vu	Vc	Vs	ϕVn	
18 Wall	6	RB-9a	1.59	0.721	1.46	0.10	4.74	4.11	0.355
Below RCCV	13	RB-9a	1.59	0.721	1.24	0.80	4.73	4.70	0.263
Bottom	24	RB-4	1.59	0.721	0.65	4.20	4.73	7.59	0.086
19 Wall Below	806	RB-8b	1.57	0.270	0.13	3.88	1.75	4.79	0.028
Below RCCV	813	RB-8b	1.57	0.270	0.72	4.22	1.75	5.07	0.141
Mid-Height	824	RB-8b	1.57	0.270	0.68	4.17	1.75	5.04	0.136
20 Wall	1606	RB-9b	1.57	0.540	4.26	2.72	3.50	5.28	0.807
Below RCCV	1613	RB-9b	1.57	0.540	5.20	2.71	3.50	5.27	0.986
Top	1624	RB-9b	1.57	0.540	4.81	2.76	3.50	5.31	0.906
21 Exterior Wall	20011	RB-9b	1.63	0.484	3.59	1.55	3.27	4.10	0.876
@ EL-11.50	20023	RB-4	1.61	0.484	0.51	3.20	3.23	5.47	0.093
~-10.50m	30010	RB-9b	1.65	0.177	1.52	1.24	1.21	2.08	0.728
	30020	RB-4	1.72	0.177	0.29	3.22	1.26	3.80	0.076
	40001	RB-4	1.73	0.177	0.46	3.35	1.27	3.92	0.118
	40011	RB-9b	1.72	0.177	1.63	1.35	1.26	2.22	0.733
22 Exterior Wall	22011	RB-9a	1.19	0.484	0.41	0.00	2.38	2.02	0.205
@ EL4.65	22023	RB-9b	1.22	0.484	0.67	0.76	2.43	2.71	0.247
~6.60m	32010	RB-9b	1.24	0.177	0.32	0.29	0.91	1.02	0.312
	32020	RB-9b	1.26	0.177	1.32	1.18	0.92	1.78	0.741
	42001	RB-9b	1.26	0.242	0.96	0.62	1.26	1.59	0.603
	42011	RB-4	1.22	0.242	0.03	0.04	1.22	1.07	0.031
23 Exterior Wall	24211	RB-9b	1.15	0.484	1.37	0.90	2.31	2.73	0.502
@ EL22.50	24224	RB-9b	1.19	0.968	2.31	0.48	4.66	4.37	0.528
~24.60m	34210	RB-9a	1.24	0.177	0.26	0.00	0.91	0.77	0.335
	34220	RB-9b	1.26	0.710	2.37	0.58	3.69	3.62	0.655
	44201	RB-9b	1.26	0.968	3.03	0.81	4.89	4.85	0.625
24 Basemat	90140	RB-9a	3.49	0.801	12.90	5.09	11.56	14.15	0.912
@ Wall	90182	RB-9b	3.47	0.801	8.60	5.94	11.50	14.82	0.581
Below RCCV	90111	RB-9a	3.48	0.801	4.33	3.04	11.54	12.39	0.350
25 Slab	93140	RB-4	1.00	0.500	0.11	0.13	2.07	1.87	0.059
EL4.65m	93182	RB-9b	1.00	0.500	2.68	1.69	2.07	3.19	0.841
@ RCCV	93111	RB-9b	1.00	0.500	1.87	1.65	2.07	3.16	0.591
26 Slab	96144	RB-4	1.00	0.500	0.16	2.07	2.07	3.51	0.047
EL17.5m	96186	RB-8b	1.00	0.500	0.69	2.69	2.07	4.05	0.172
@ RCCV	96113	RB-4	1.34	0.500	0.82	1.53	2.76	3.64	0.226
27 Slab	98472	RB-9a	0.62	0.500	1.40	1.51	1.27	2.36	0.592
EL27.0m	98514	RB-9a	0.62	0.500	1.18	1.30	1.27	2.19	0.541
@ RCCV	98424	RB-9b	2.07	0.500	7.53	4.78	4.28	7.70	0.978
28 Pool Girder	123054	RB-8b	1.23	0.484	0.08	0.10	2.46	2.18	0.038
@ Storage Pool	123154	RB-4	1.25	0.484	0.16	0.19	2.50	2.29	0.070
29 Pool Girder	123062	RB-8b	1.24	0.242	0.18	1.33	1.24	2.19	0.084
@ Cavity	123162	RB-8a	1.22	0.242	0.10	0.11	1.22	1.13	0.084
30 Pool Girder	123067	RB-8a	1.23	0.484	0.26	0.93	2.46	2.88	0.092
@ Fuel Pool	123167	RB-8a	1.24	0.484	0.17	0.21	2.48	2.28	0.076
31 MS Tunnel	150122	RB-4	1.04	0.177	0.50	1.06	0.76	1.55	0.322
Wall and Slab	96611	RB-4	1.34	0.500	0.41	2.33	2.76	4.33	0.094
	98614	RB-8a	2.14	0.500	0.50	2.59	4.42	5.96	0.084

Table 3G.1-57

Factors of Safety for Foundation Stability

Load Combination	Overturning		Sliding		Floatation	
	Required	Actual	Required	Actual	Required	Actual
D + H + E'	1.1	111.1	1.1	1.41	--	--
D + F'	--	--	--	--	1.1	3.48

Where,
D = Dead Load
H = Lateral soil pressure
E' = Safe Shutdown Earthquake
F' = Buoyant forces of design basis flood

Table 3G.1-58

Maximum Soil Bearing Stress Involving SSE

	Site Condition*		
	Soft (V_s = 300 m/sec)	Medium (V_s = 800 m/sec)	Hard ($V_s \geq$ 1700 m/sec)
Bearing Stress (MPa)	2.7	7.3	5.4

* See Table 3A.3-1 for site properties. For site specific application, use the larger value or a linearly interpolated value of the applicable range of shear wave velocities at the foundation level.

Table 3G.1-59

Stress Calculation Results for Basemat Uplift Analysis

Seismic Force Direction	Soil Condition	Element ID	Load	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
				Calculated	Allowable	Radial		Circumferential		Allowable
						Top	Bottom	Top	Bottom	
S to N	Soft	80275	SSE+LOCA 6min	-7.8	-23.5	-45.2	8.6	-7.2	17.2	372.2
			SSE+LOCA 72h	-8.8	-23.5	-49.8	15.4	-8.2	28.1	372.2
		90402	SSE+LOCA 6min	-5.0	-23.5	-27.0	17.7	54.5	42.9	372.2
			SSE+LOCA 72h	-4.0	-23.5	-18.9	10.1	58.3	40.2	372.2
		90408	SSE+LOCA 6min	-3.0	-23.5	19.0	-10.3	51.6	-3.2	372.2
			SSE+LOCA 72h	-3.0	-23.5	17.5	-10.5	51.7	-3.0	372.2

Seismic Force Direction	Soil Condition	Element ID	Load	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
				Calculated	Allowable	Radial		Circumferential		Allowable
						Top	Bottom	Top	Bottom	
W to E	Soft	80262	SSE+LOCA 6min	-17.9	-23.5	-58.7	175.6	-20.4	191.1	372.2
			SSE+LOCA 72h	-18.4	-23.5	-60.8	183.5	-20.2	193.4	372.2
		80462	SSE+LOCA 6min	-12.0	-23.5	227.7	-9.8	11.5	-48.2	372.2
			SSE+LOCA 72h	-11.5	-23.5	225.6	-8.4	-11.5	-47.2	372.2
E to W	Soft	80287	SSE+LOCA 6min	-14.6	-23.5	-49.1	140.8	-14.6	149.7	372.2
			SSE+LOCA 72h	-15.3	-23.5	-52.1	147.2	-15.4	150.4	372.2
		80462	SSE+LOCA 6min	-8.5	-23.5	-43.9	166.6	71.4	113.5	372.2
			SSE+LOCA 72h	-9.0	-23.5	-43.9	175.4	64.9	123.6	372.2

Note: Because the seismic force in N to S direction does not cause the basemat uplift, its calculation result is not included in this table. Refer to Figure 3G.1-60.

Figure 3G.1-1. RB and FB Concrete Outline Plan at EL -11500

Figure 3G.1-2. RB and FB Concrete Outline Plan at EL 4650

Figure 3G.1-3. RB and FB Concrete Outline Plan at EL 17500

Figure 3G.1-4. RB and FB Concrete Outline Plan at EL 27000

Figure 3G.1-5. RB Concrete Outline Plan at EL 34000

Figure 3G.1-6. RB and FB Concrete Outline N-S Section

Figure 3G.1-7. RB and FB Concrete Outline E-W Section

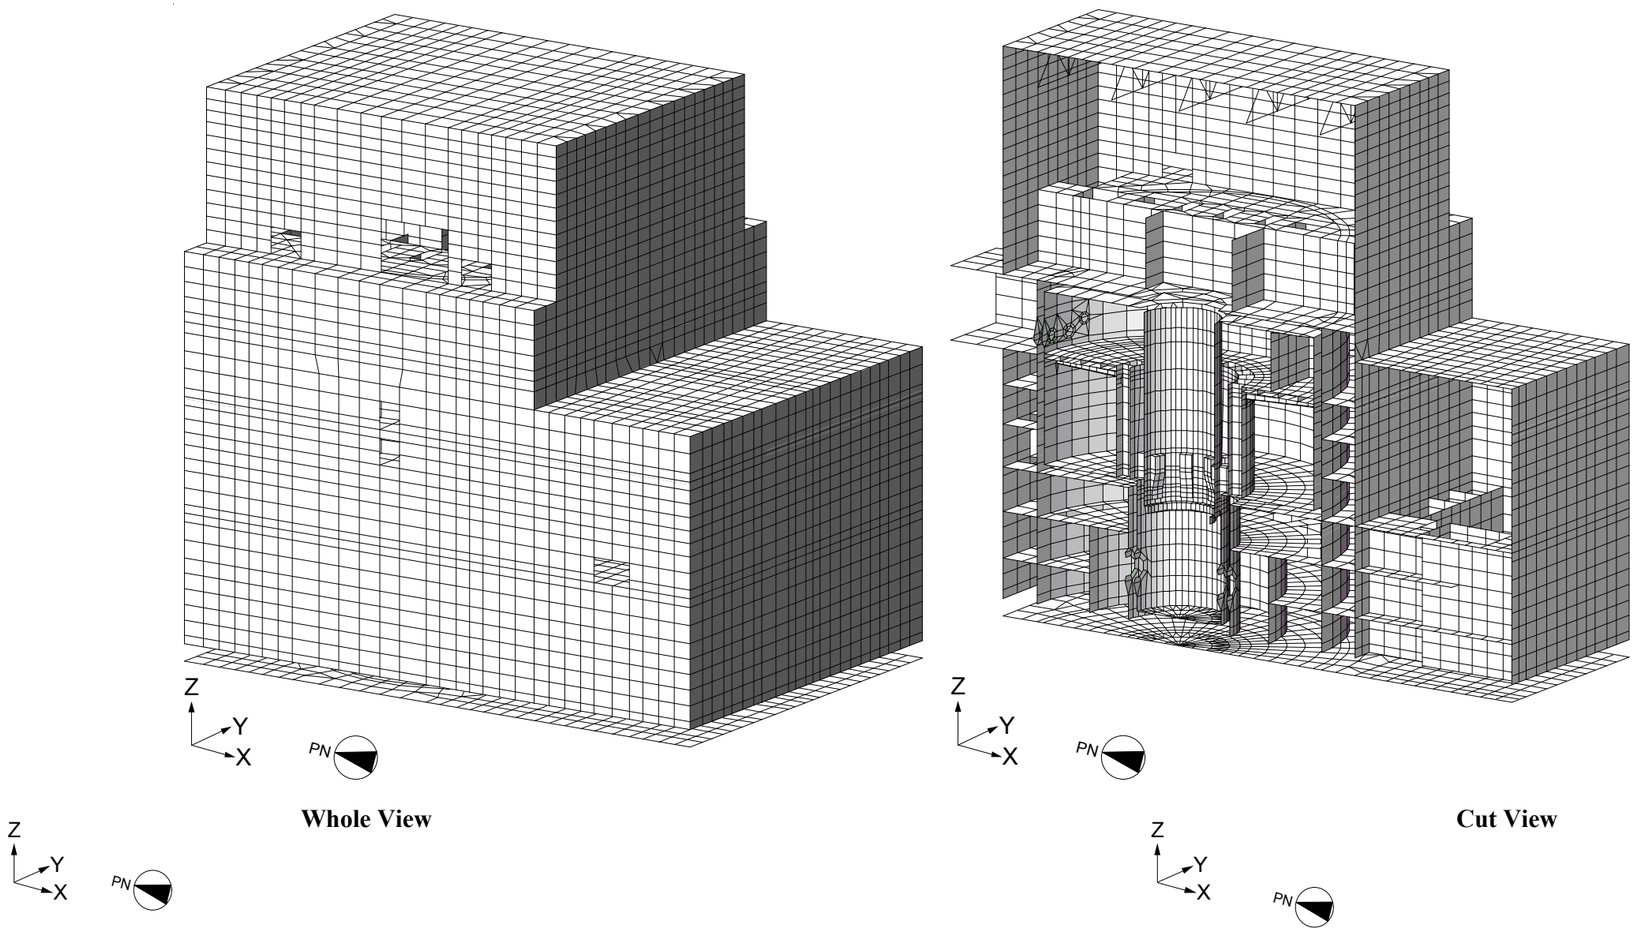

Figure 3G.1-8. FE Model of RB/FB (Isometric View)

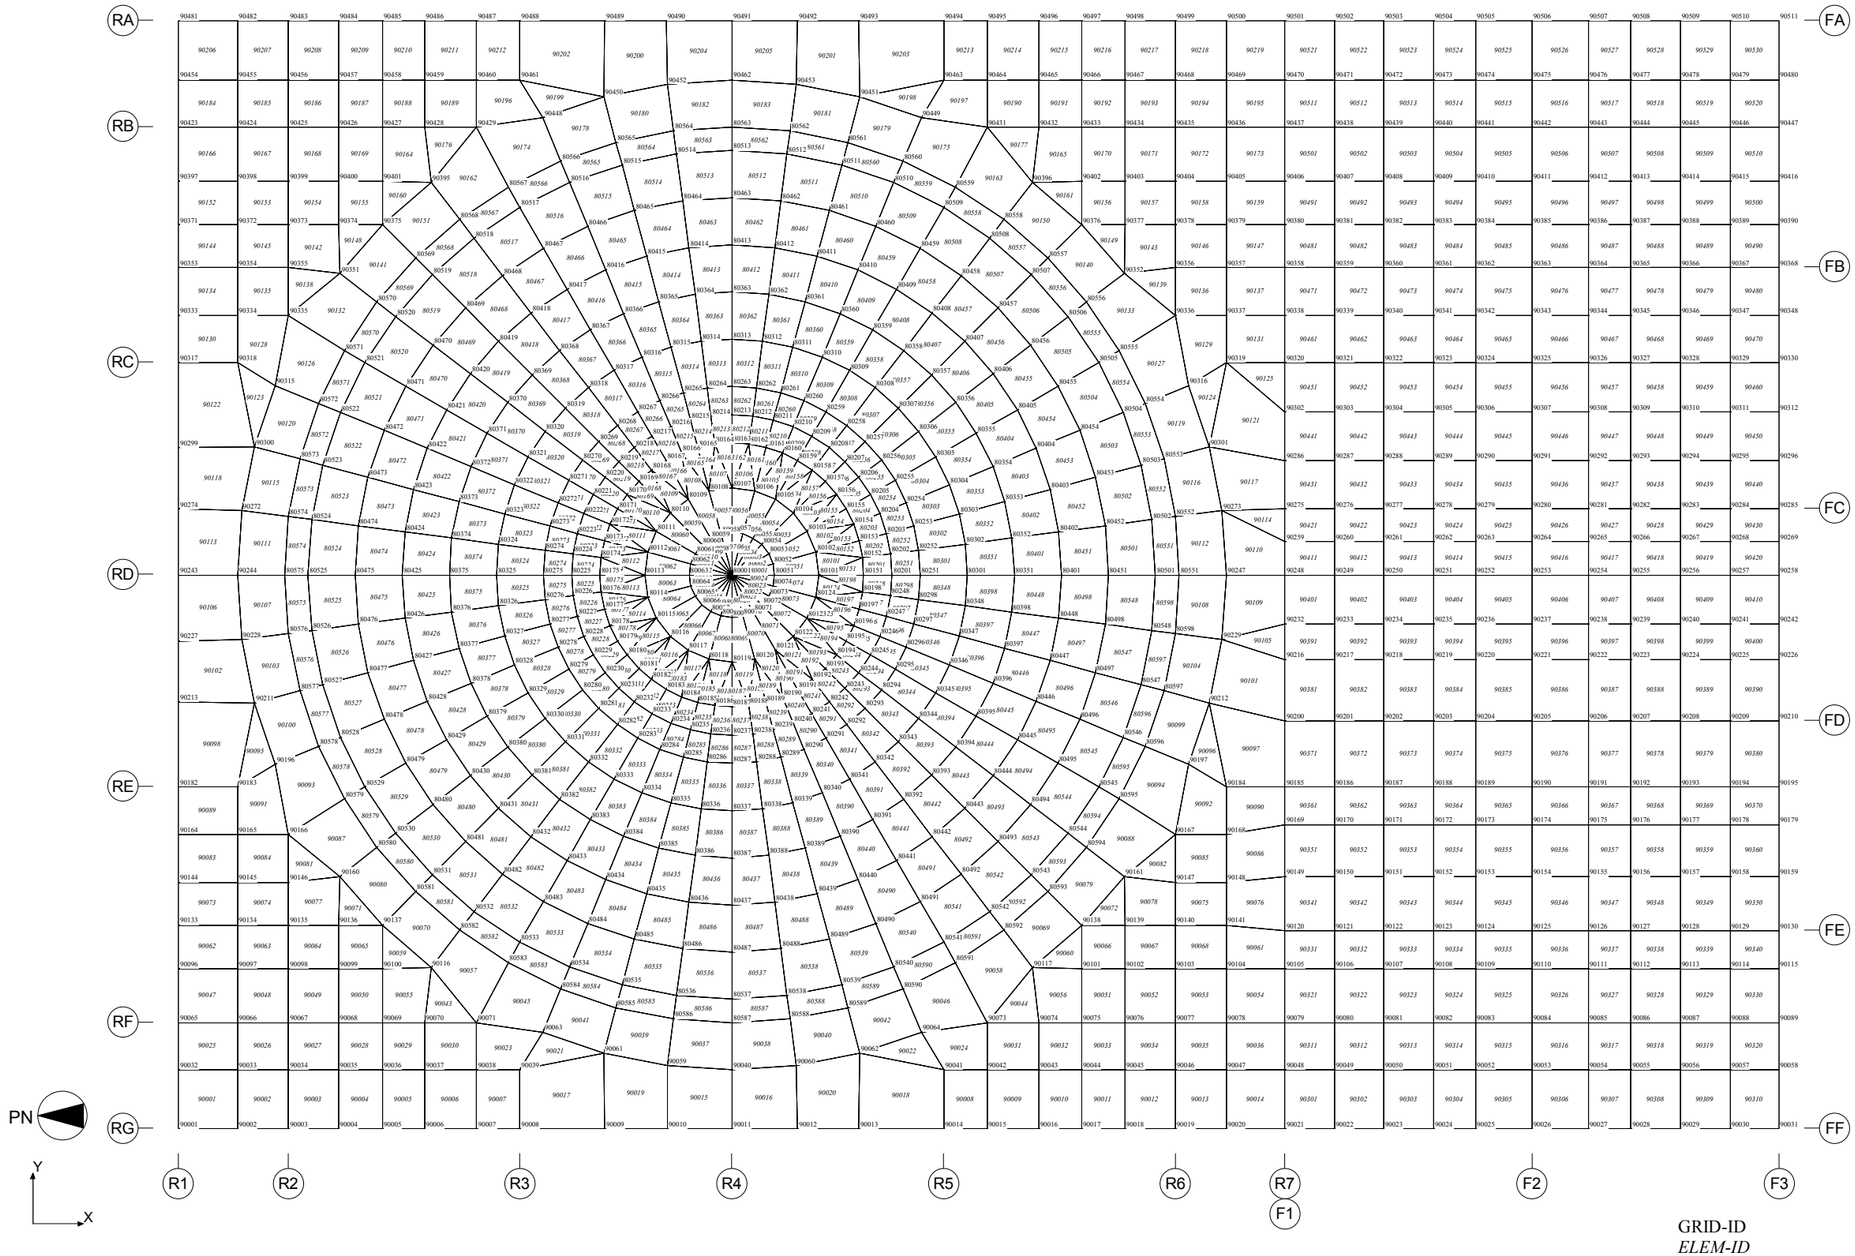

Figure 3G.1-9. FE Model of RB/FB (Foundation Mat)

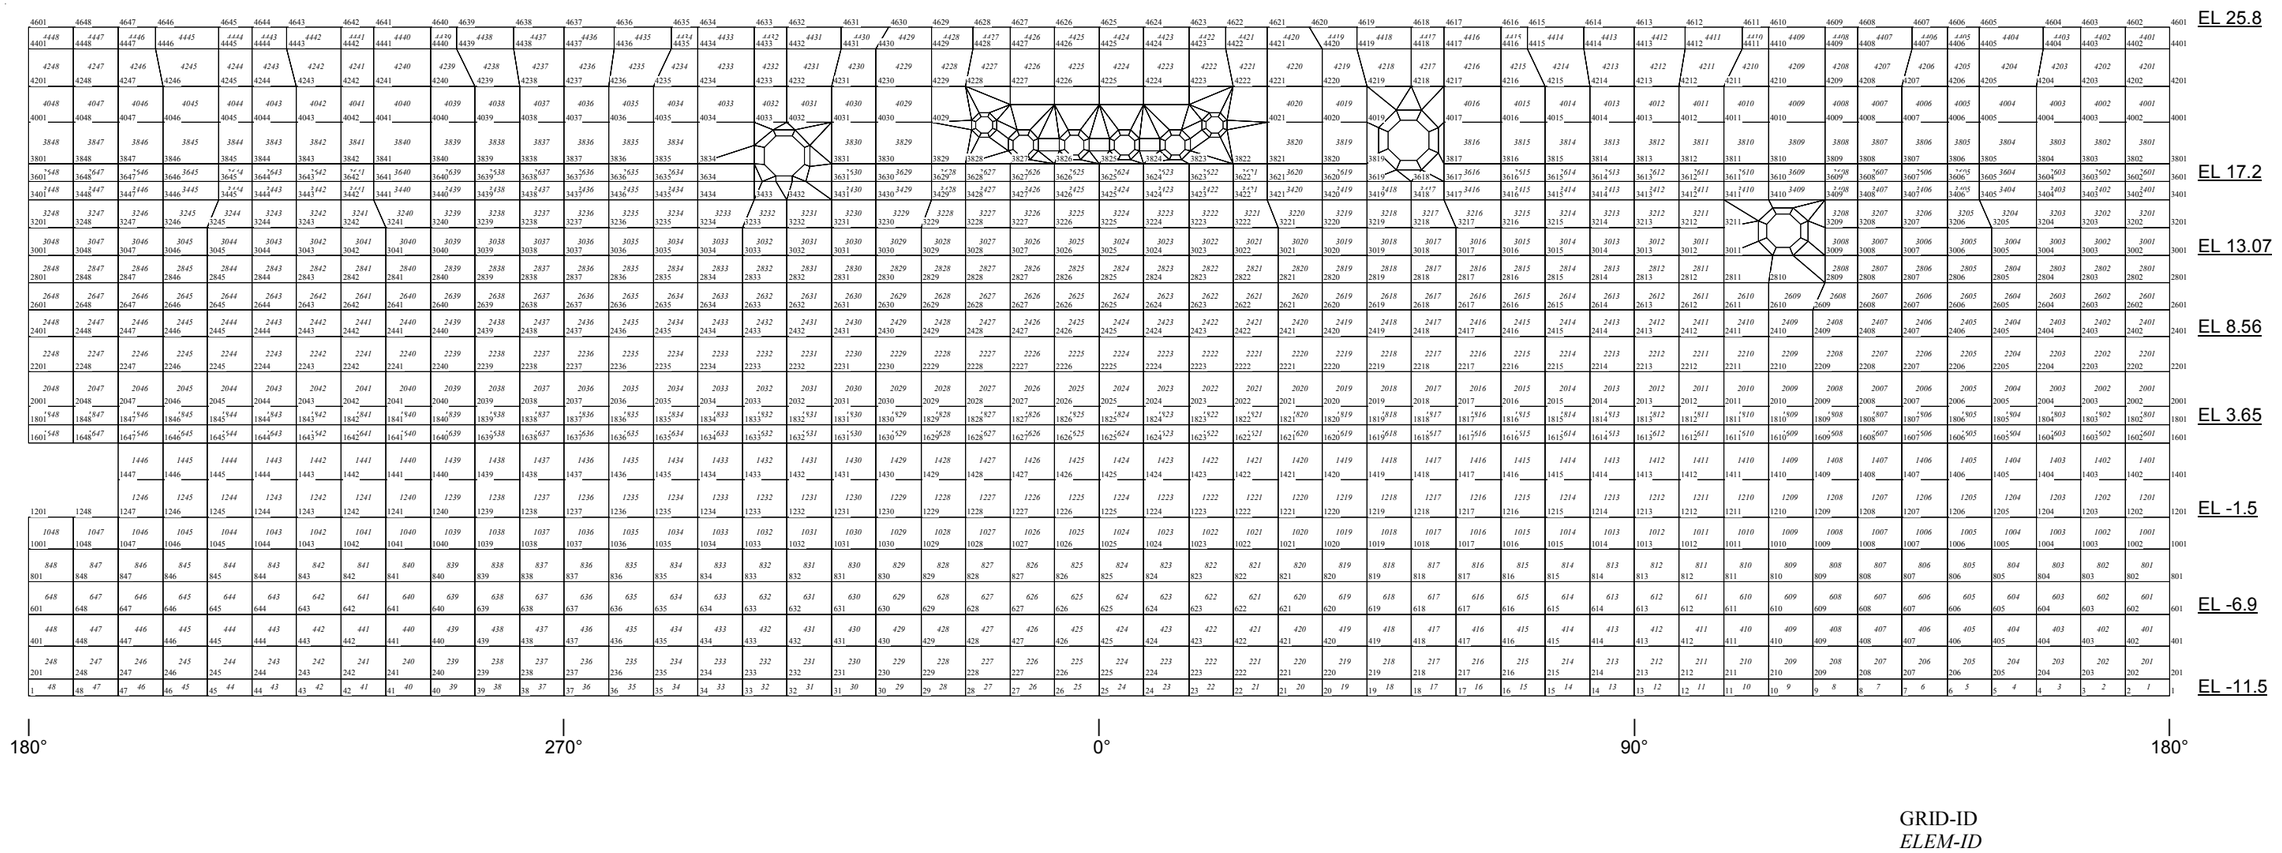

Figure 3G.1-10. FE Model of RB/FB (RCCV Wall)

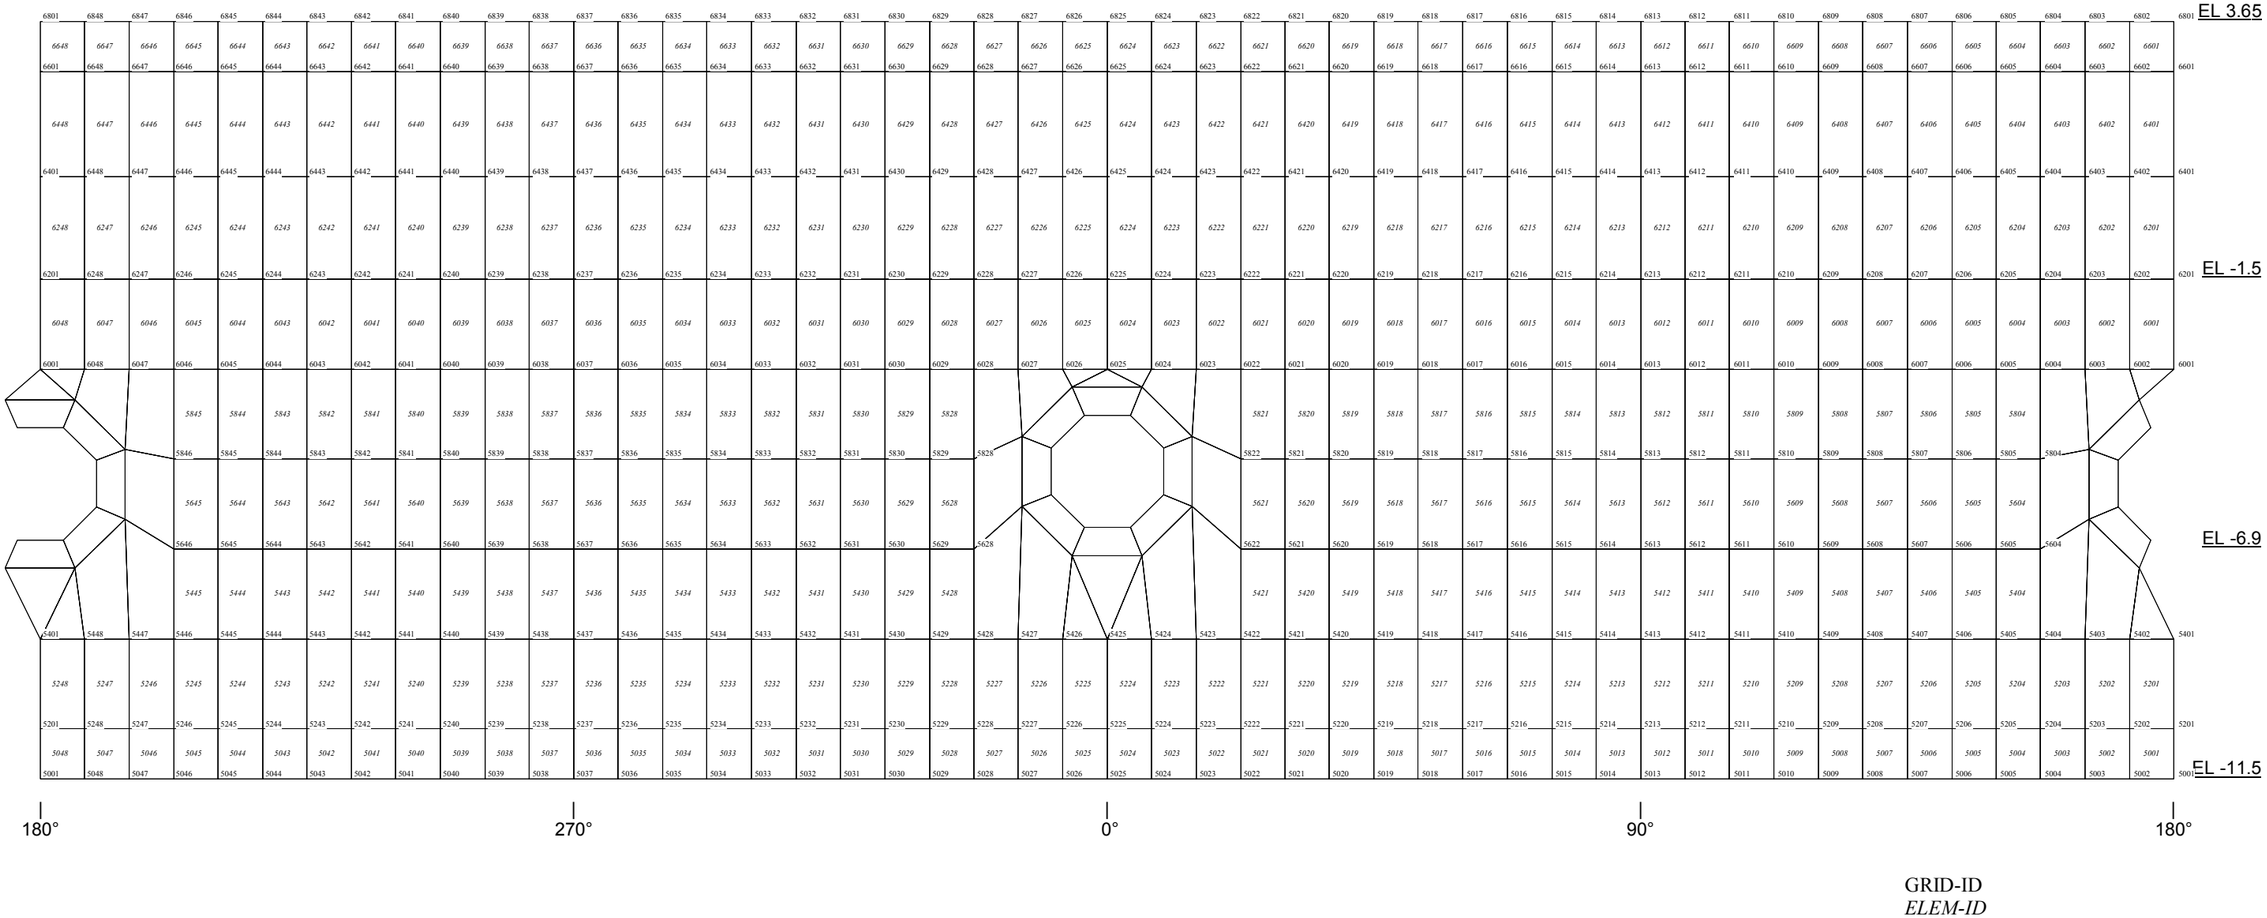

Figure 3G.1-11. FE Model of RB/FB (RPV Pedestal)

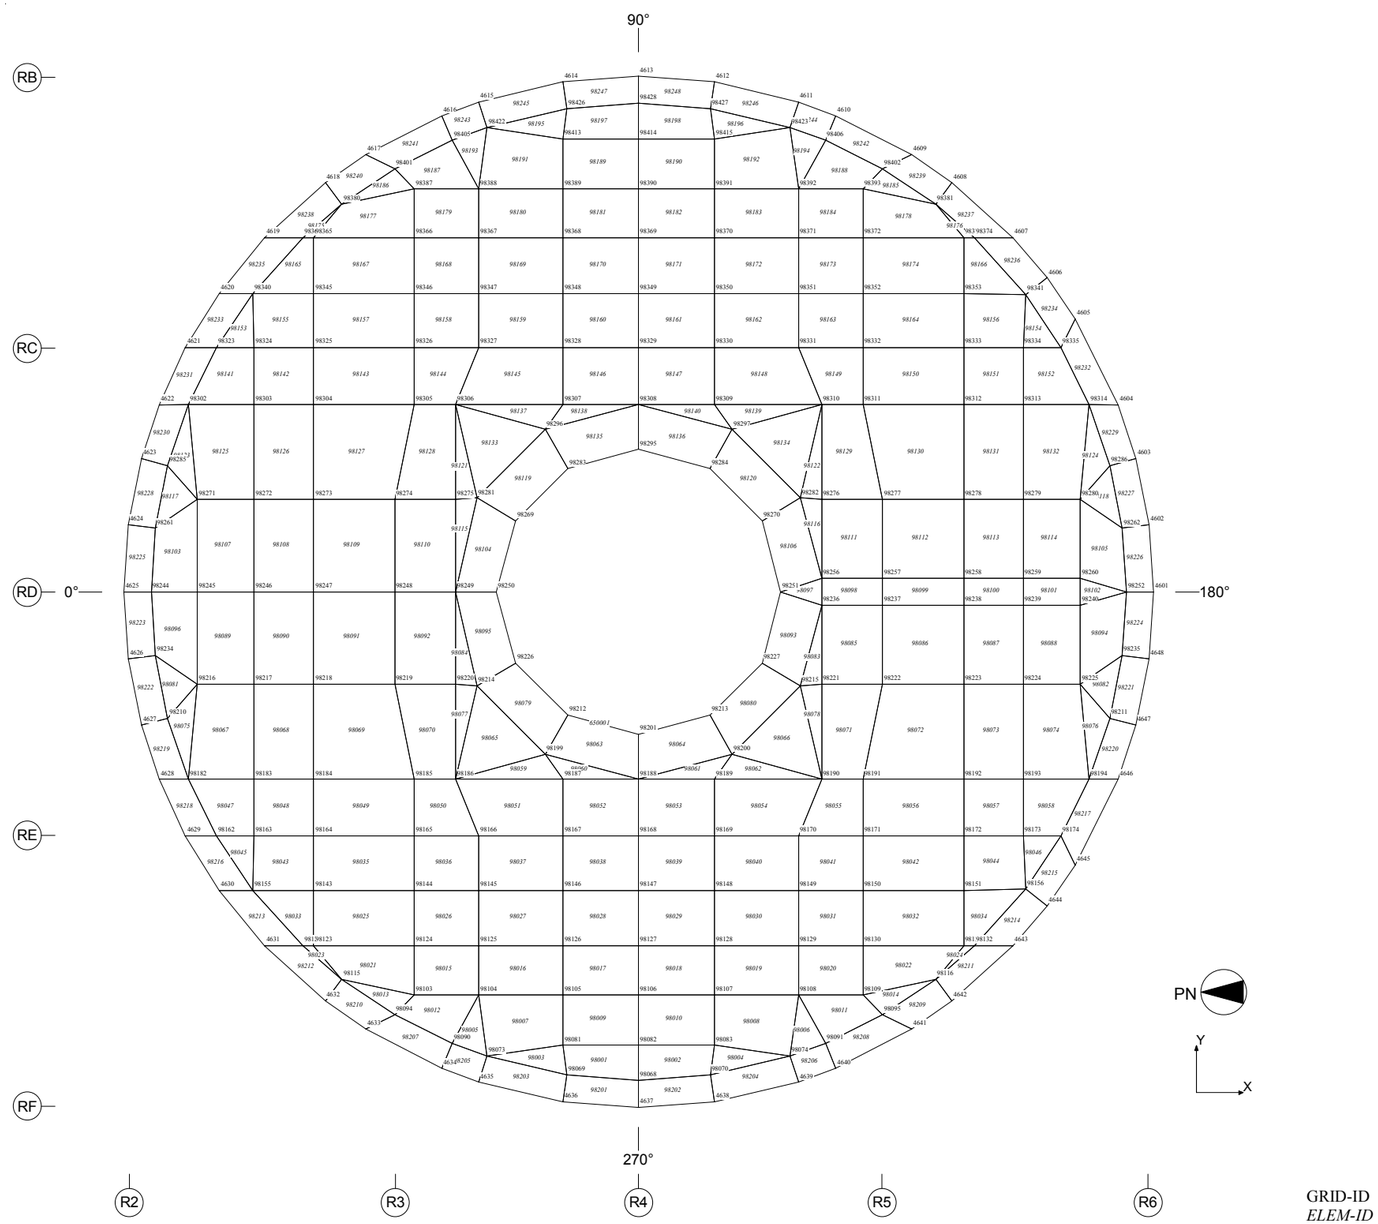

Figure 3G.1-12. FE Model of RB/FB (Top Slab)

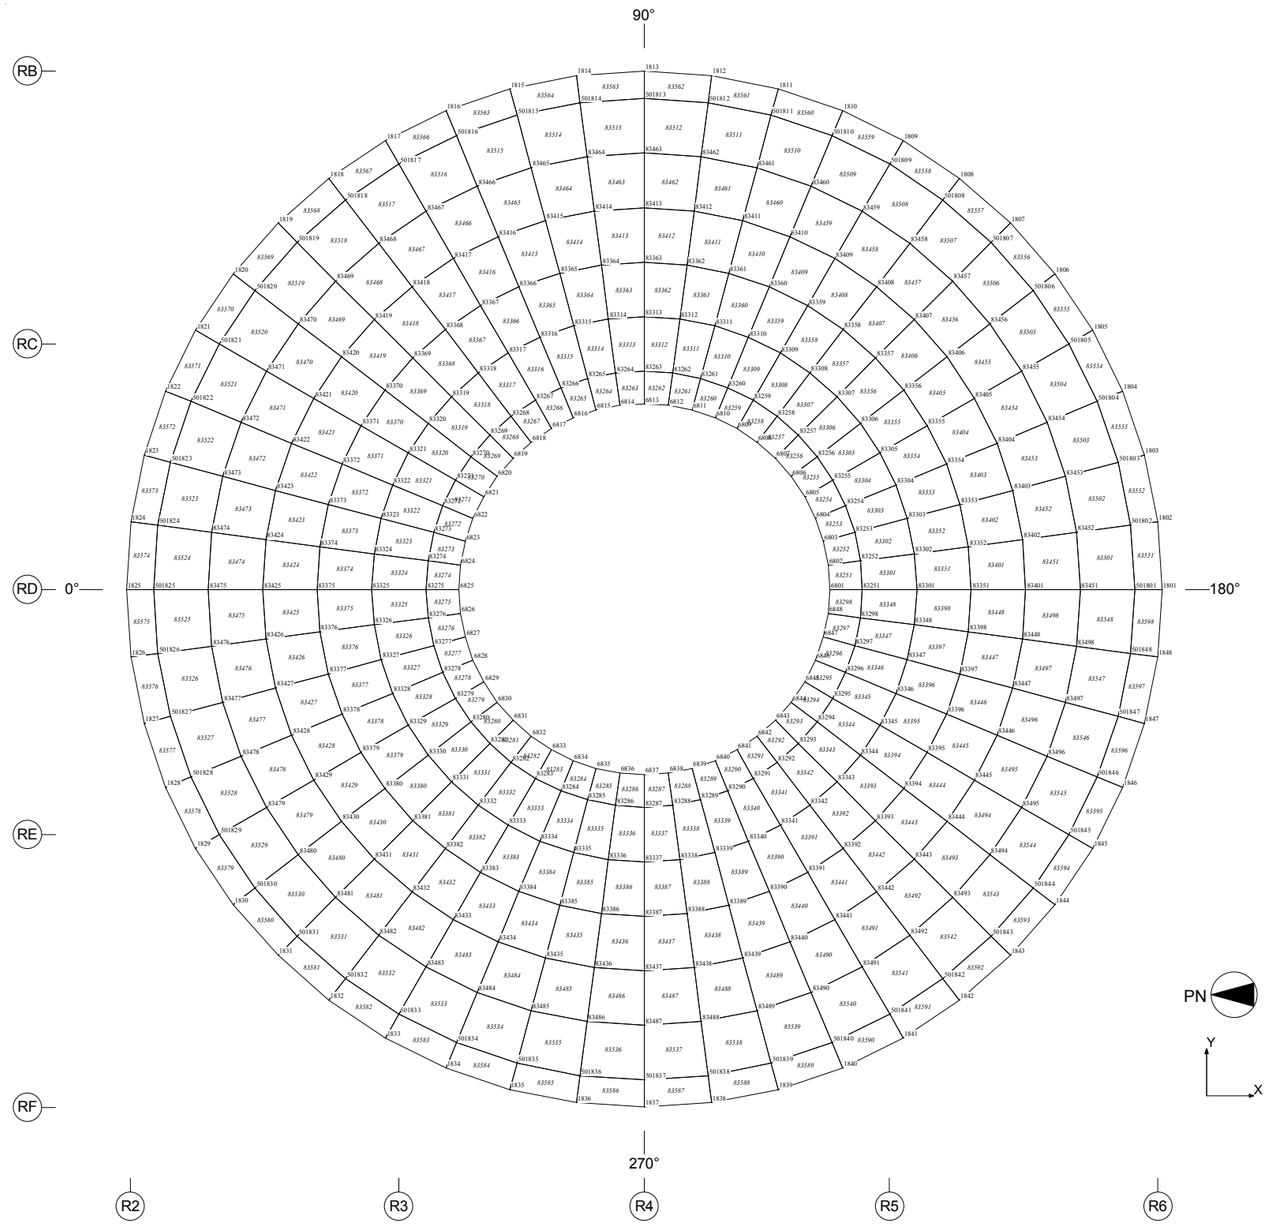

Figure 3G.1-13. FE Model of RB/FB (Suppression Pool Slab)

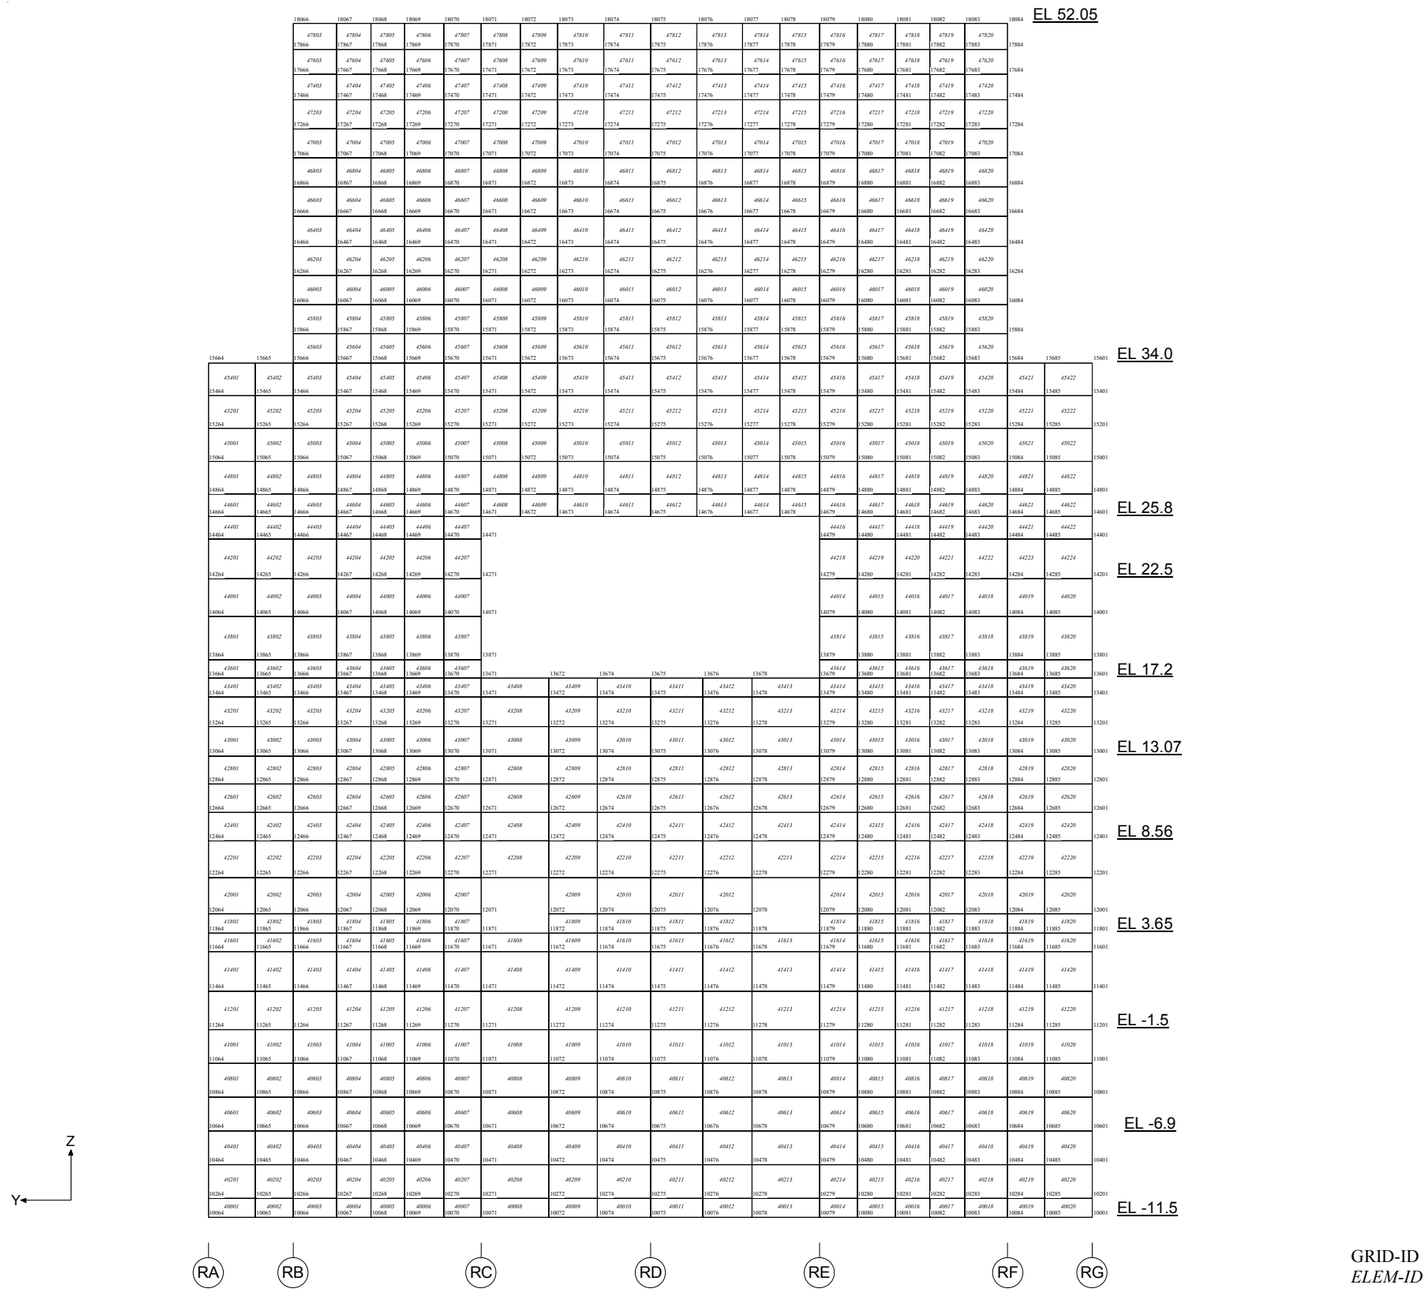

Figure 3G.1-14. FE Model of RB/FB (External Wall: North Side)

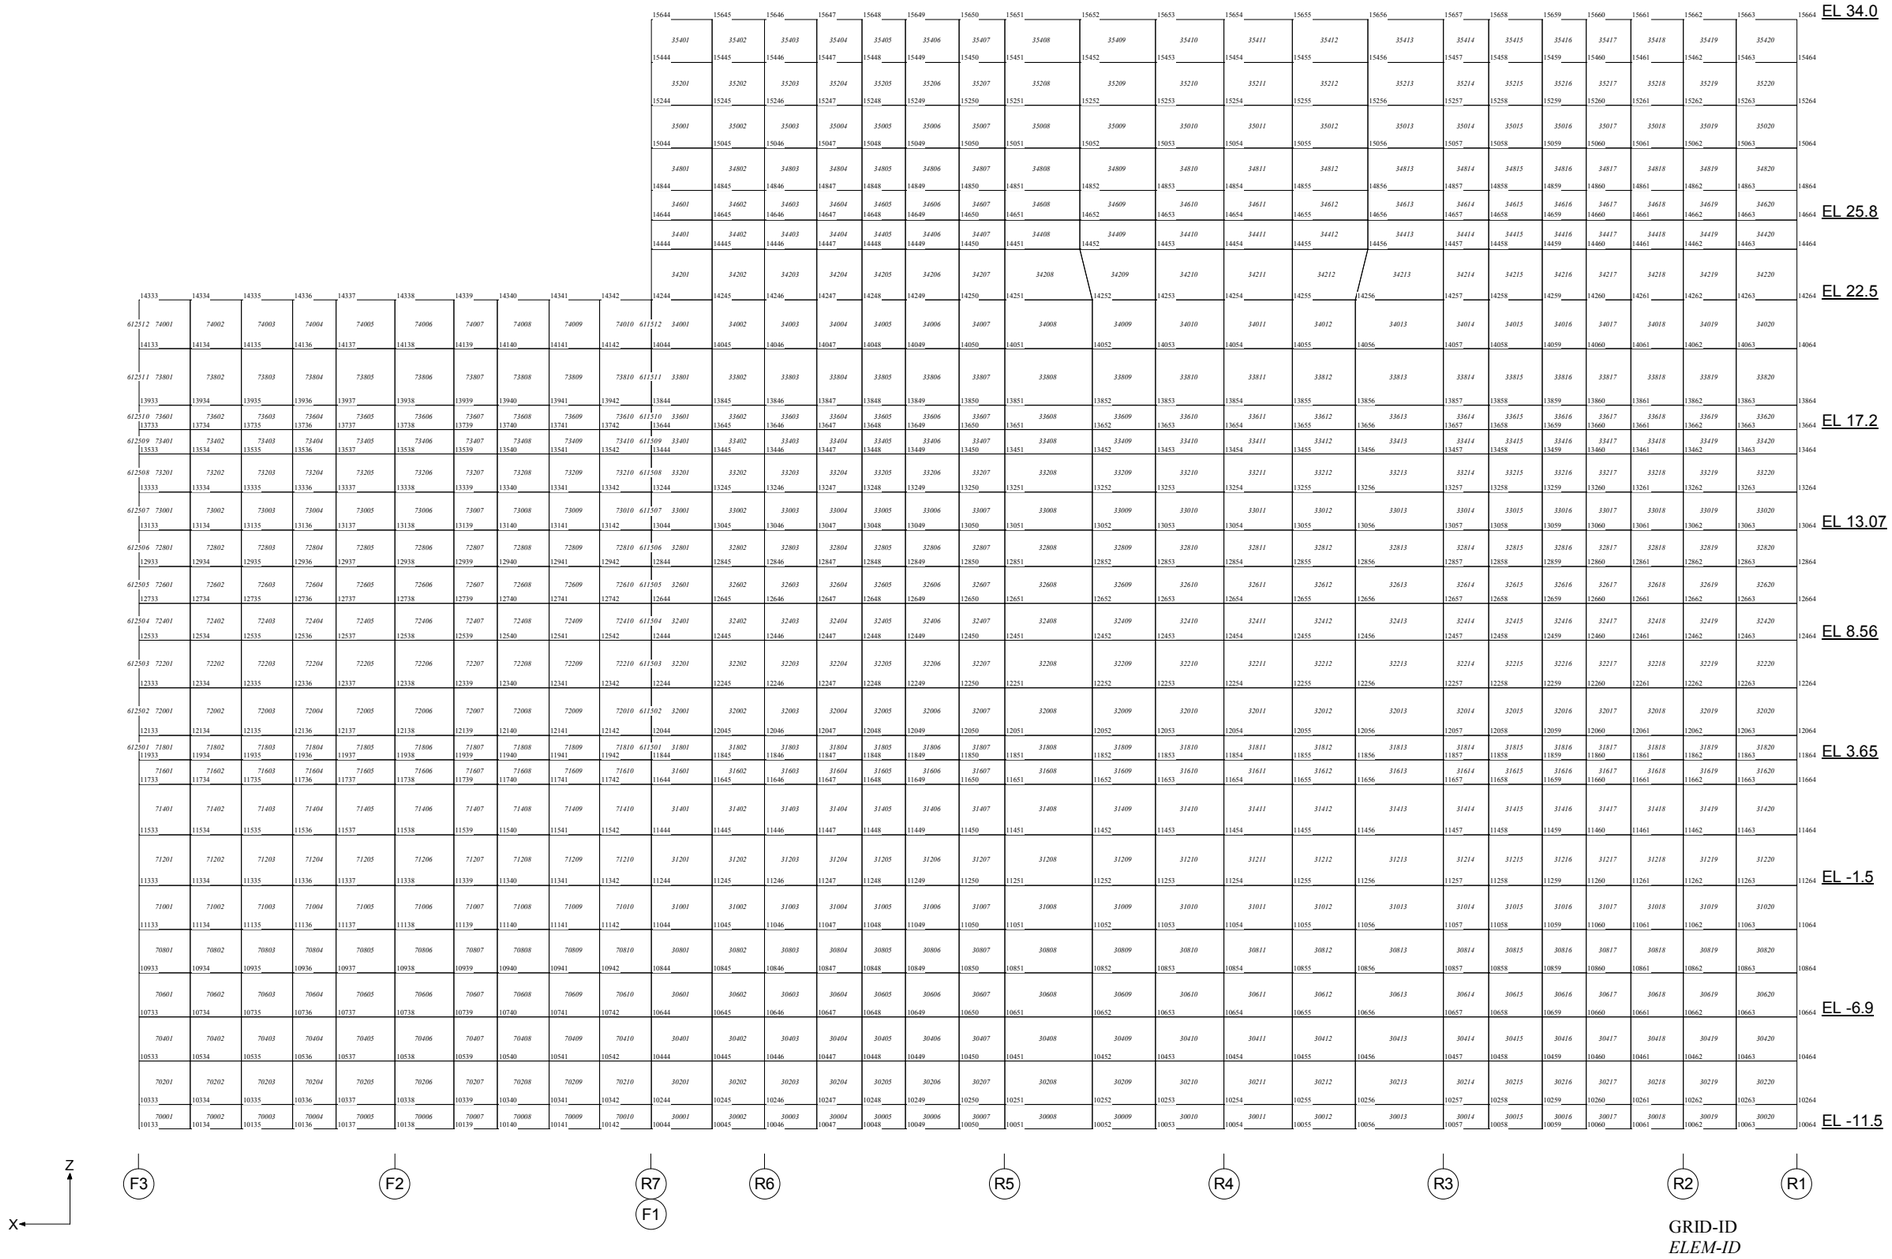

Figure 3G.1-15. FE Model of RB/FB (External Wall: East Side)

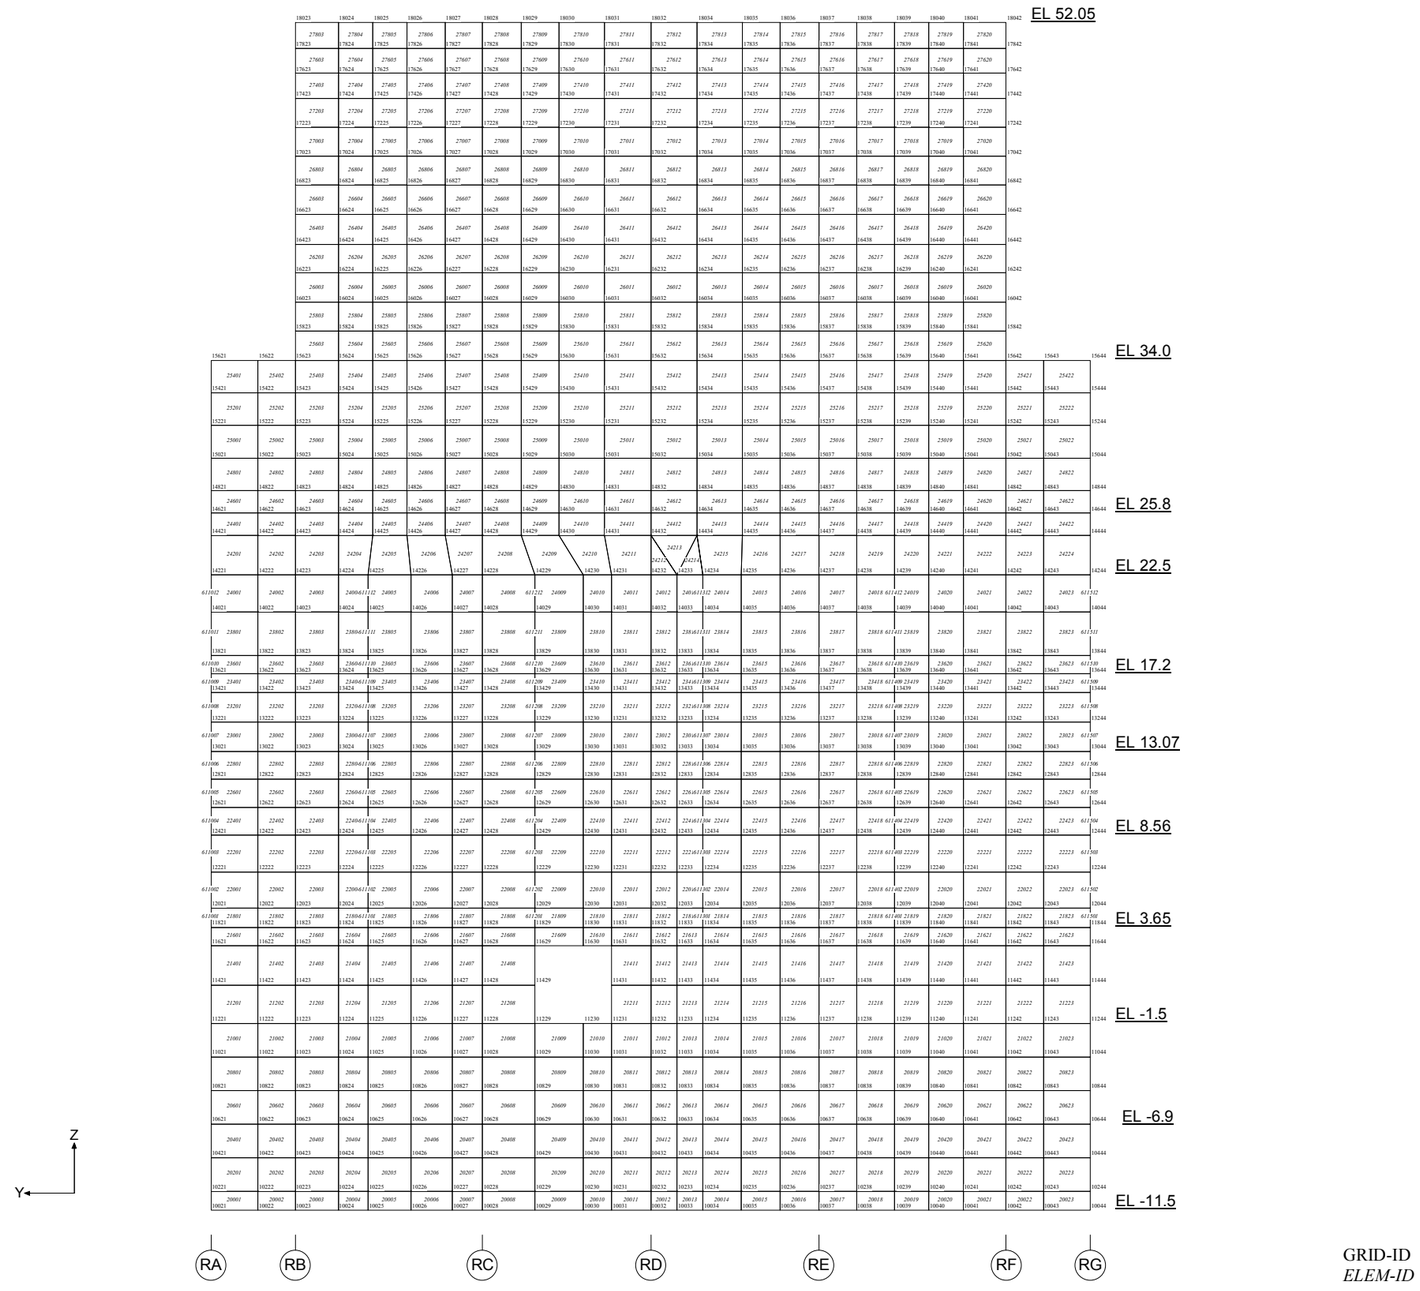

Figure 3G.1-16. FE Model of RB/FB (Internal Wall on R7/F1 Column Line)

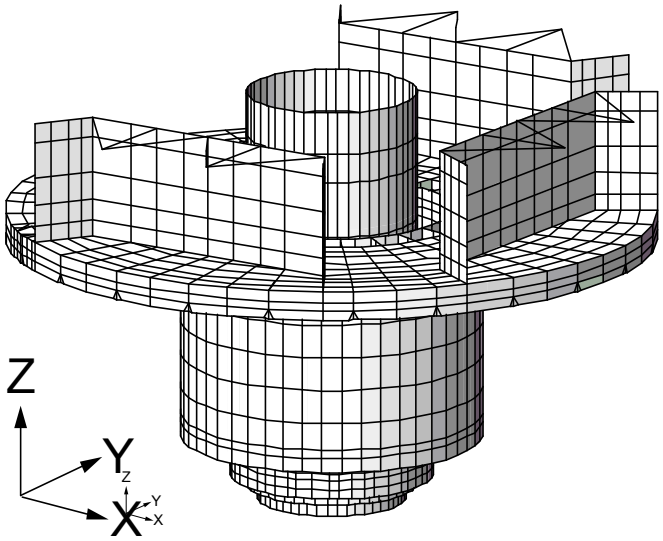

Whole View

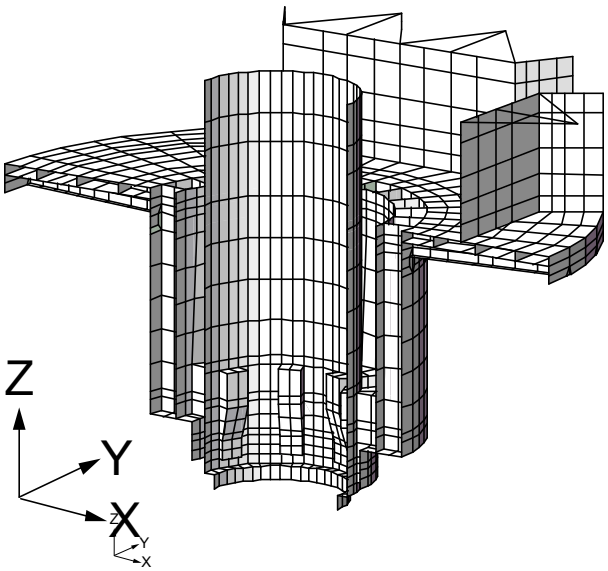

Cut View

Figure 3G.1-17. FE Model of RB/FB (RCCV Internals)

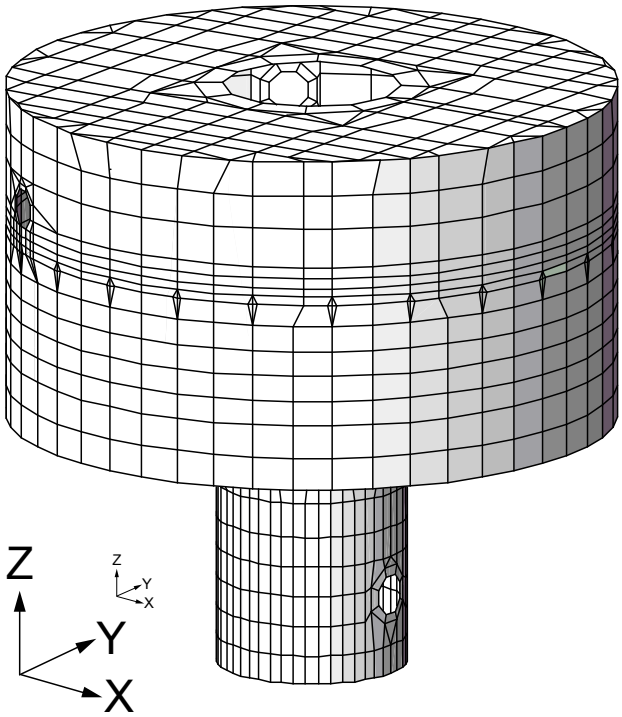

Whole View

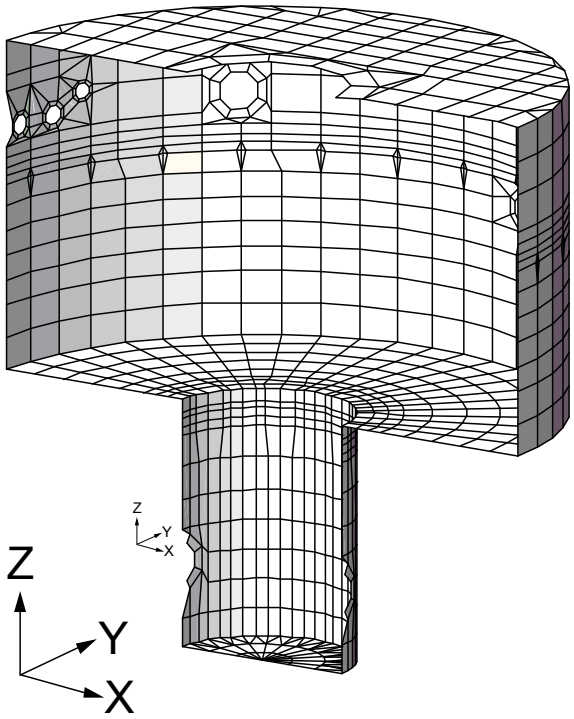

Cut View

Figure 3G.1-18. FE Model of RB/FB (RCCV Liner)

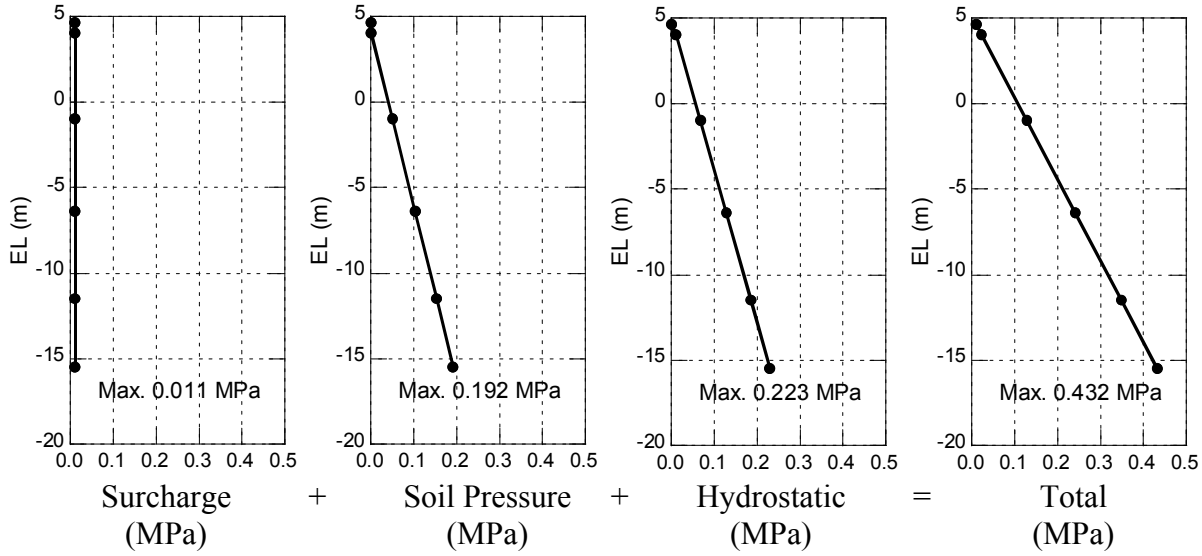

Figure 3G.1-19. Soil Pressure at Rest

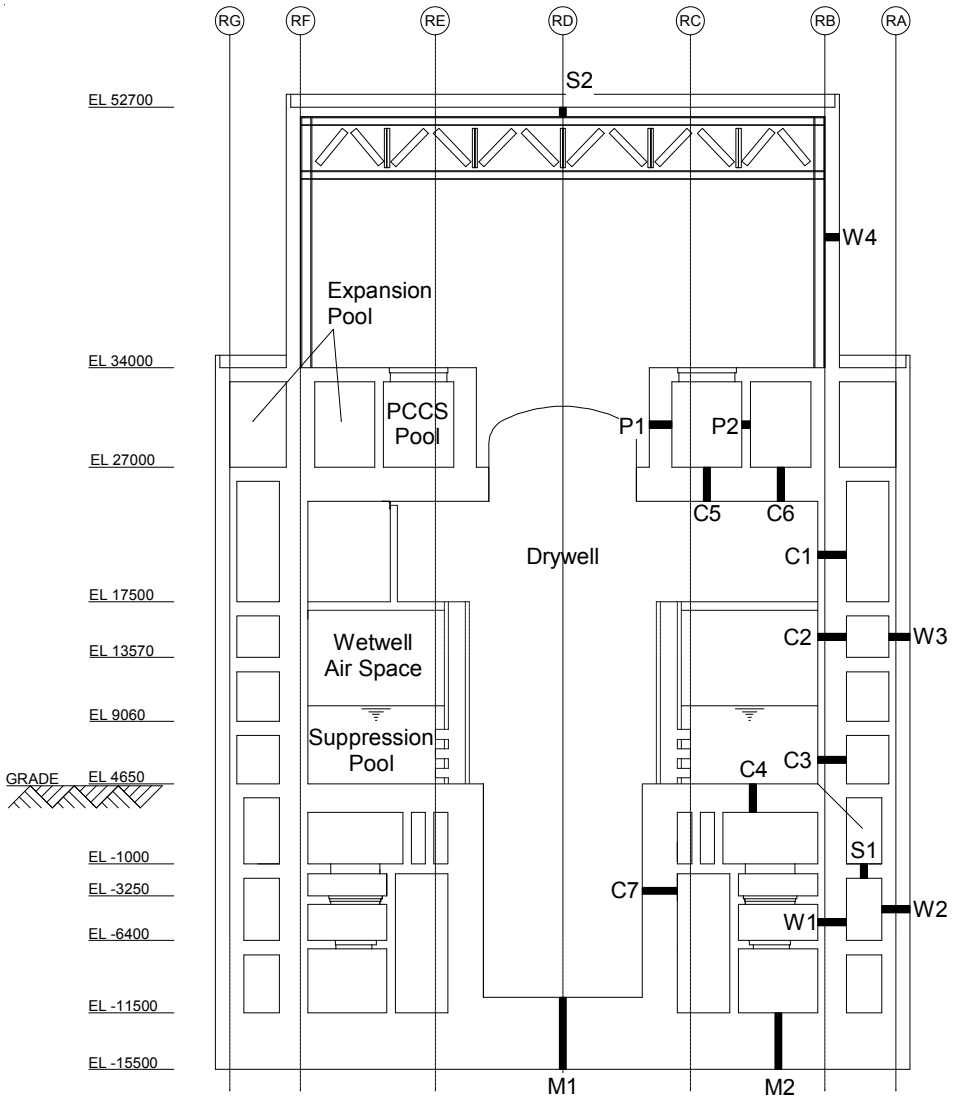

Figure 3G.1-20. Sections Where Thermal Loads Are Defined

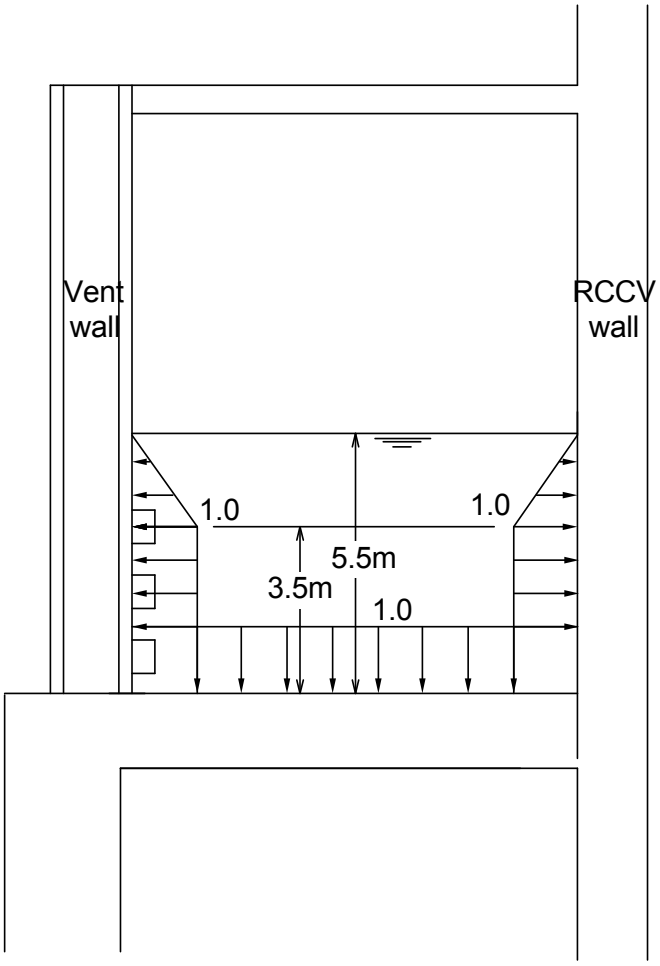

CO Peak Positive Pressure = 186 kPag
CO Peak Negative Pressure = -186 kPag
Dynamic Load Factor (DLF) = 2.0

Figure 3G.1-21. Condensation Oscillation (CO) Pressure Loads

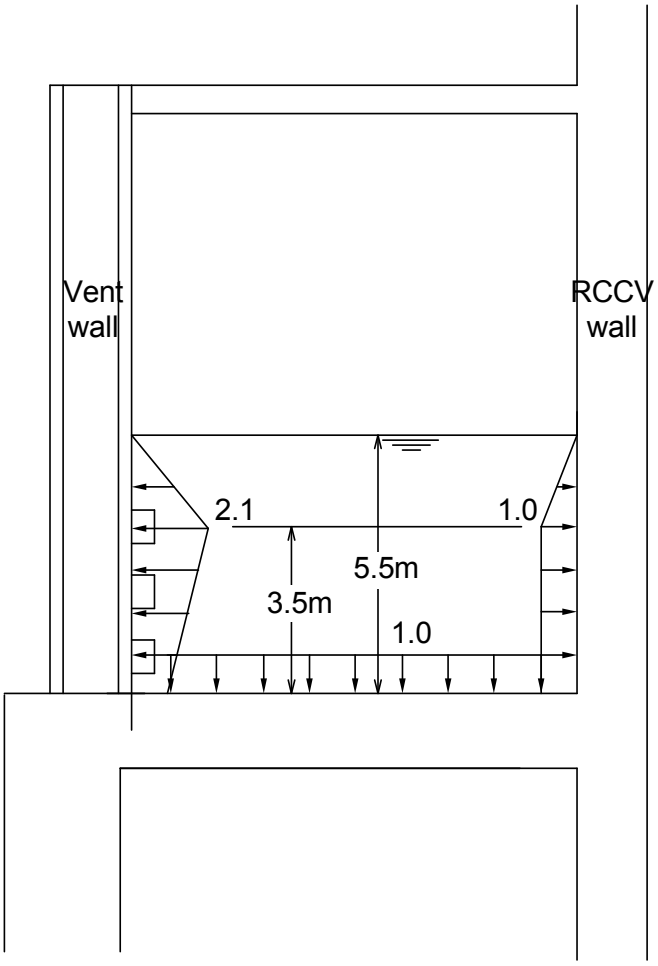

CHUG Peak Positive Pressure = 91 kPag
CHUG Peak Negative Pressure = -66 kPag
Dynamic Load Factor (DLF) = 2.0

Figure 3G.1-22. Chugging (CHUG) Pressure Loads

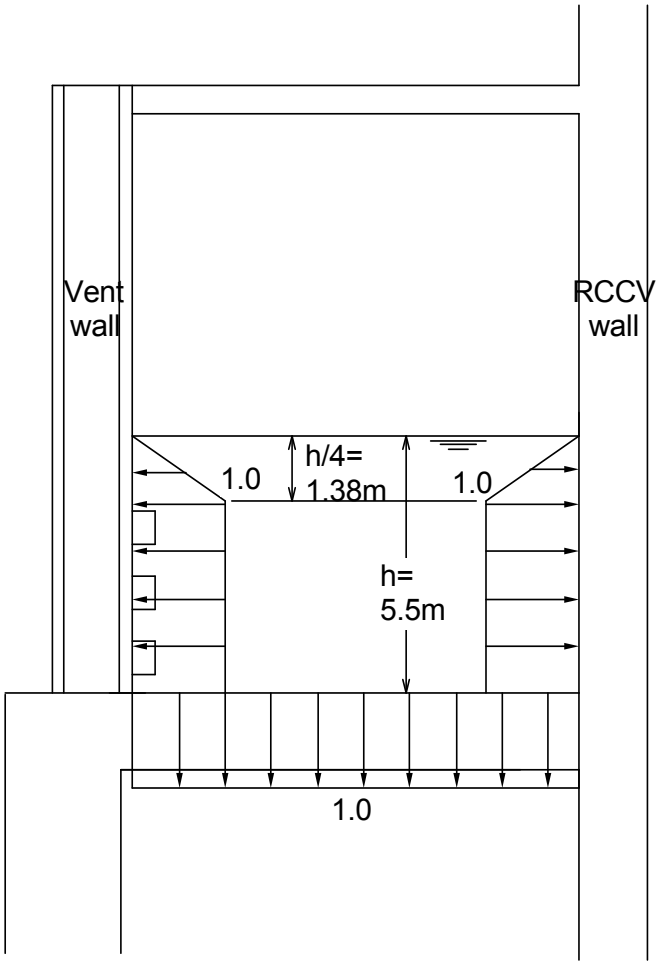

SRV Peak Positive Pressure = 152 kPag
SRV Peak Negative Pressure = -63 kPag
Dynamic Load Factor (DLF) = 2.0

Figure 3G.1-23. Safety Relief Valve (SRV) Pressure Loads

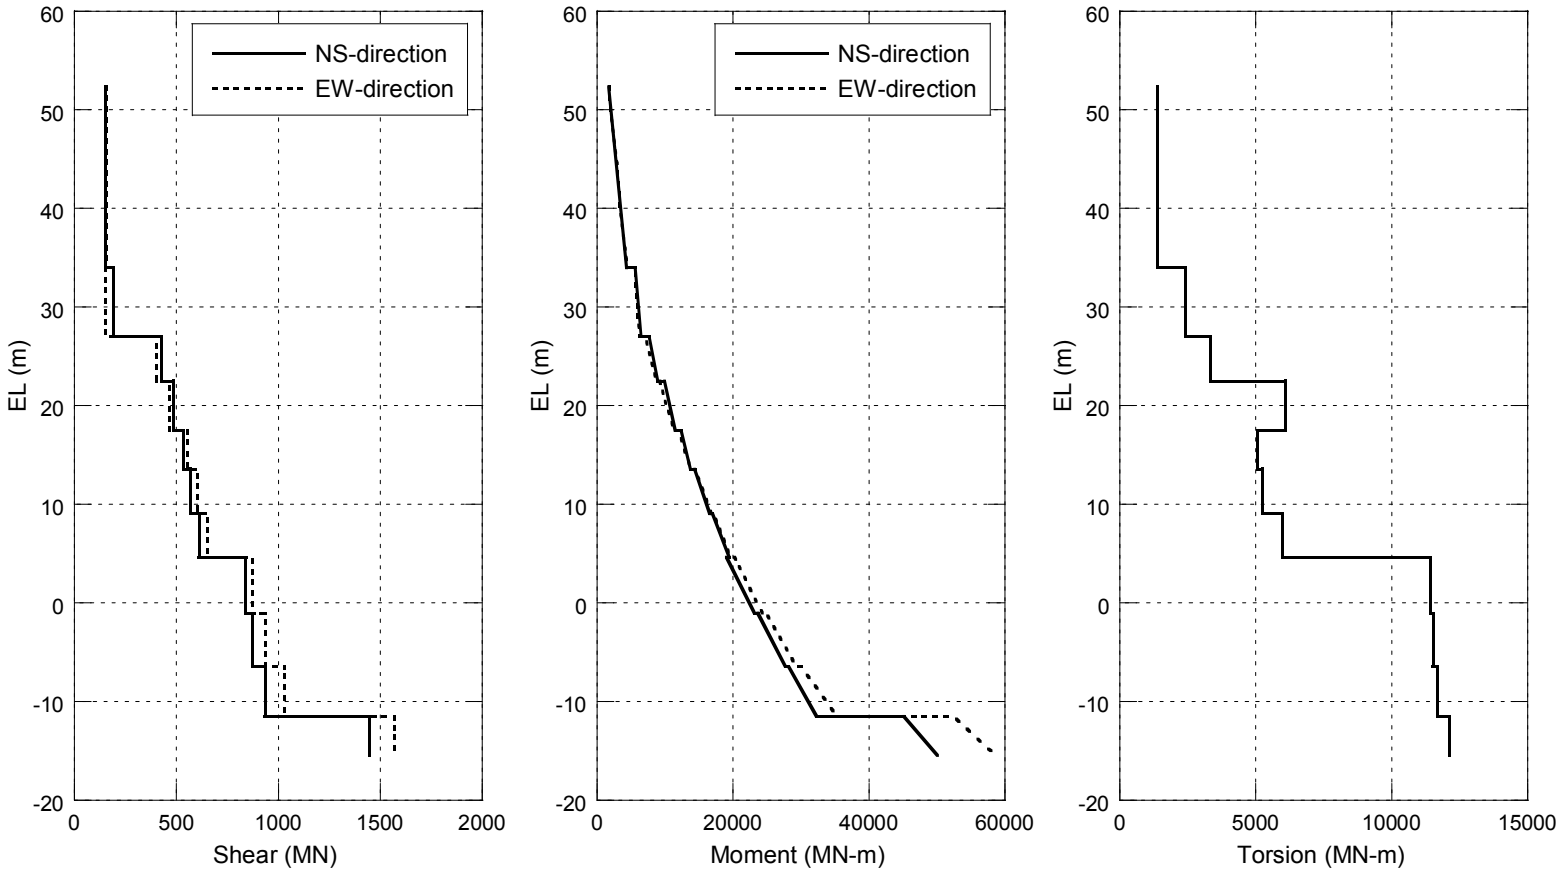

Figure 3G.1-24. Design Seismic Shears and Moments for RB and FB Walls

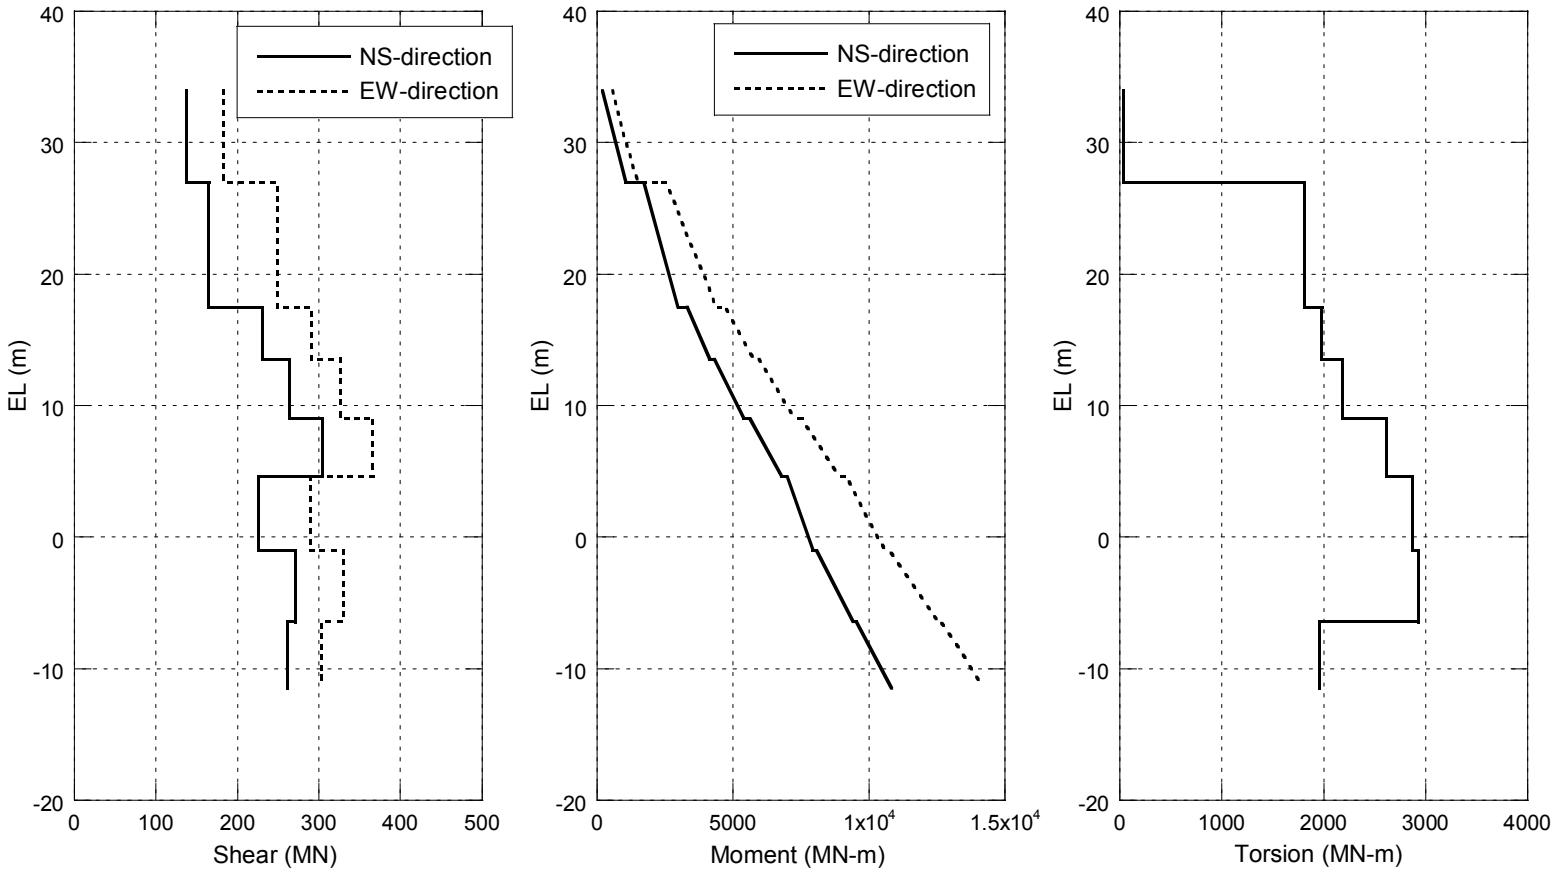

Figure 3G.1-25. Design Seismic Shears and Moments for RCCV

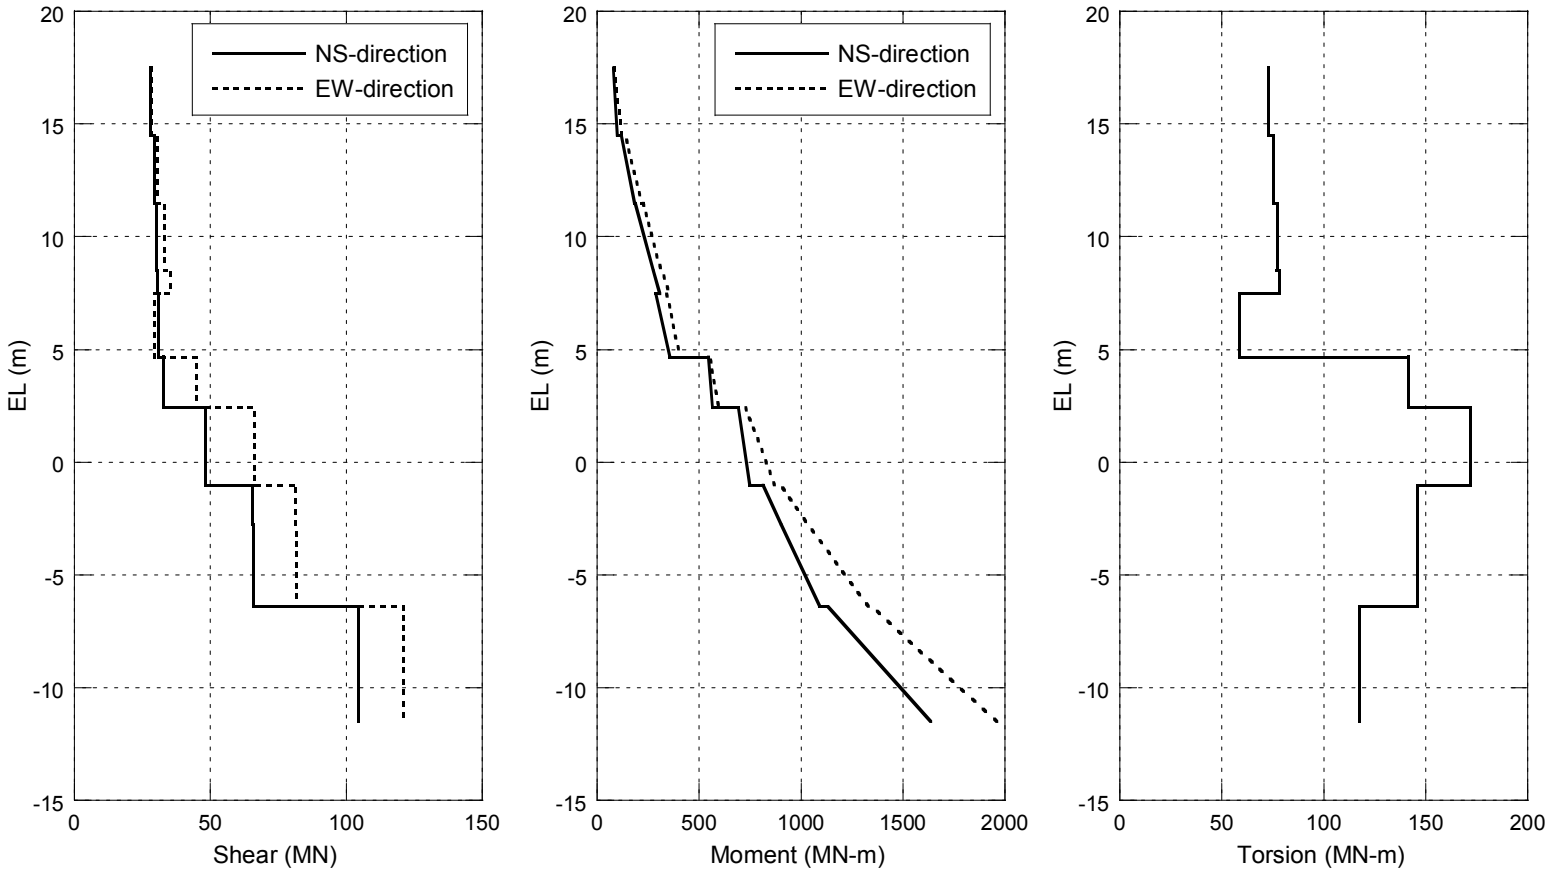

Figure 3G.1-26. Design Seismic Shears and Moments for RPV Pedestal and Vent Wall

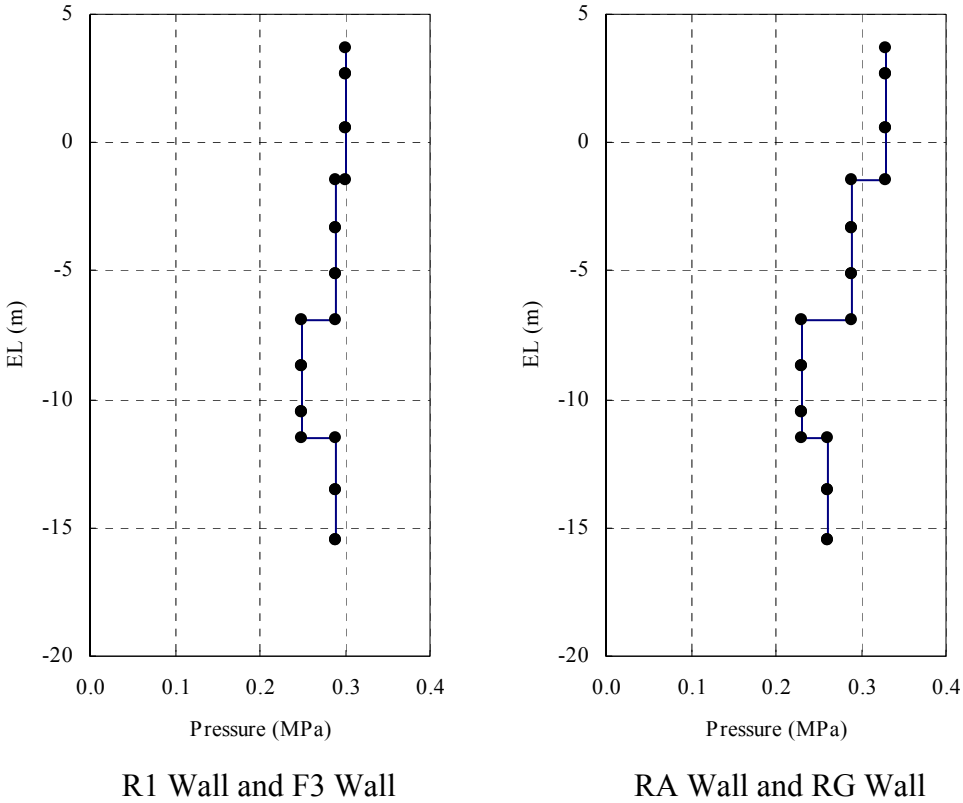

Figure 3G.1-27. Seismic Lateral Soil Pressure

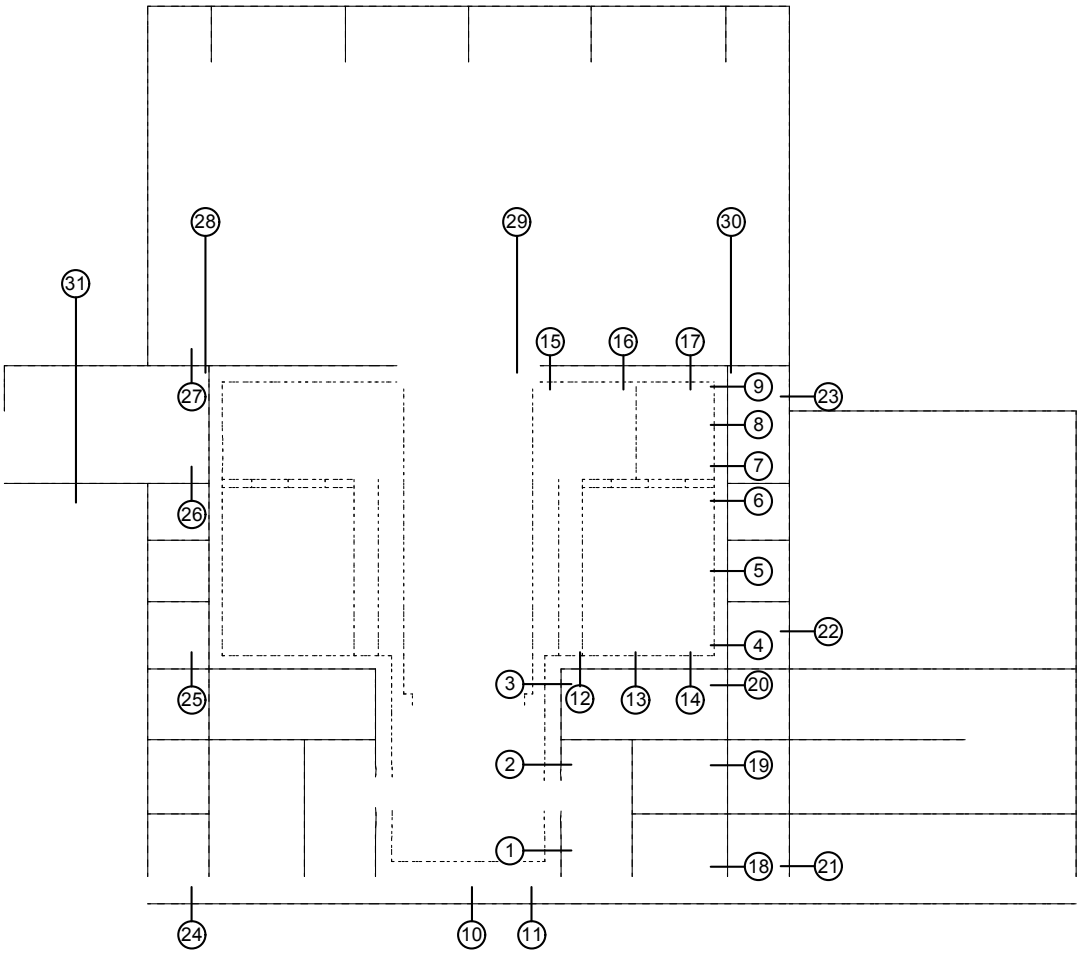

Figure 3G.1-28. Section Considered for Analysis

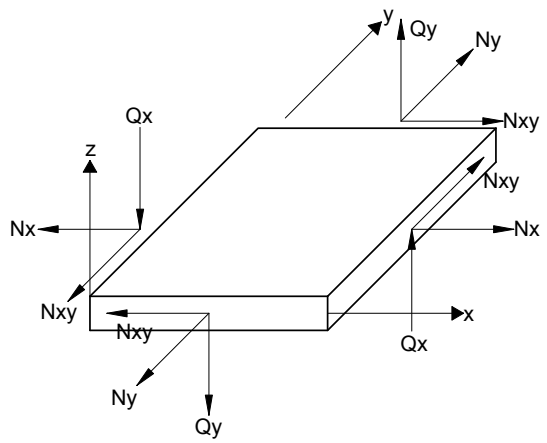

Membrane and Shear Forces

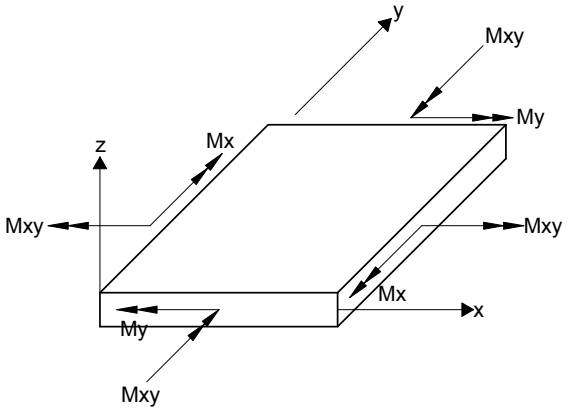

Moments

Definition of Element Coordinate System

Structure	x	y	z
RCCV Wall RPV Pedestal External Wall	horizontal	vertical	outward
Wall in N-S Direction	horizontal	vertical	toward West
Wall in E-W Direction	horizontal	vertical	toward South
Foundation Mat Floor Slab Top Slab	toward South	toward West	downward
Suppression Pool Slab	radial	circumferential	downward

Figure 3G.1-29. Force and Moment in Shell Element

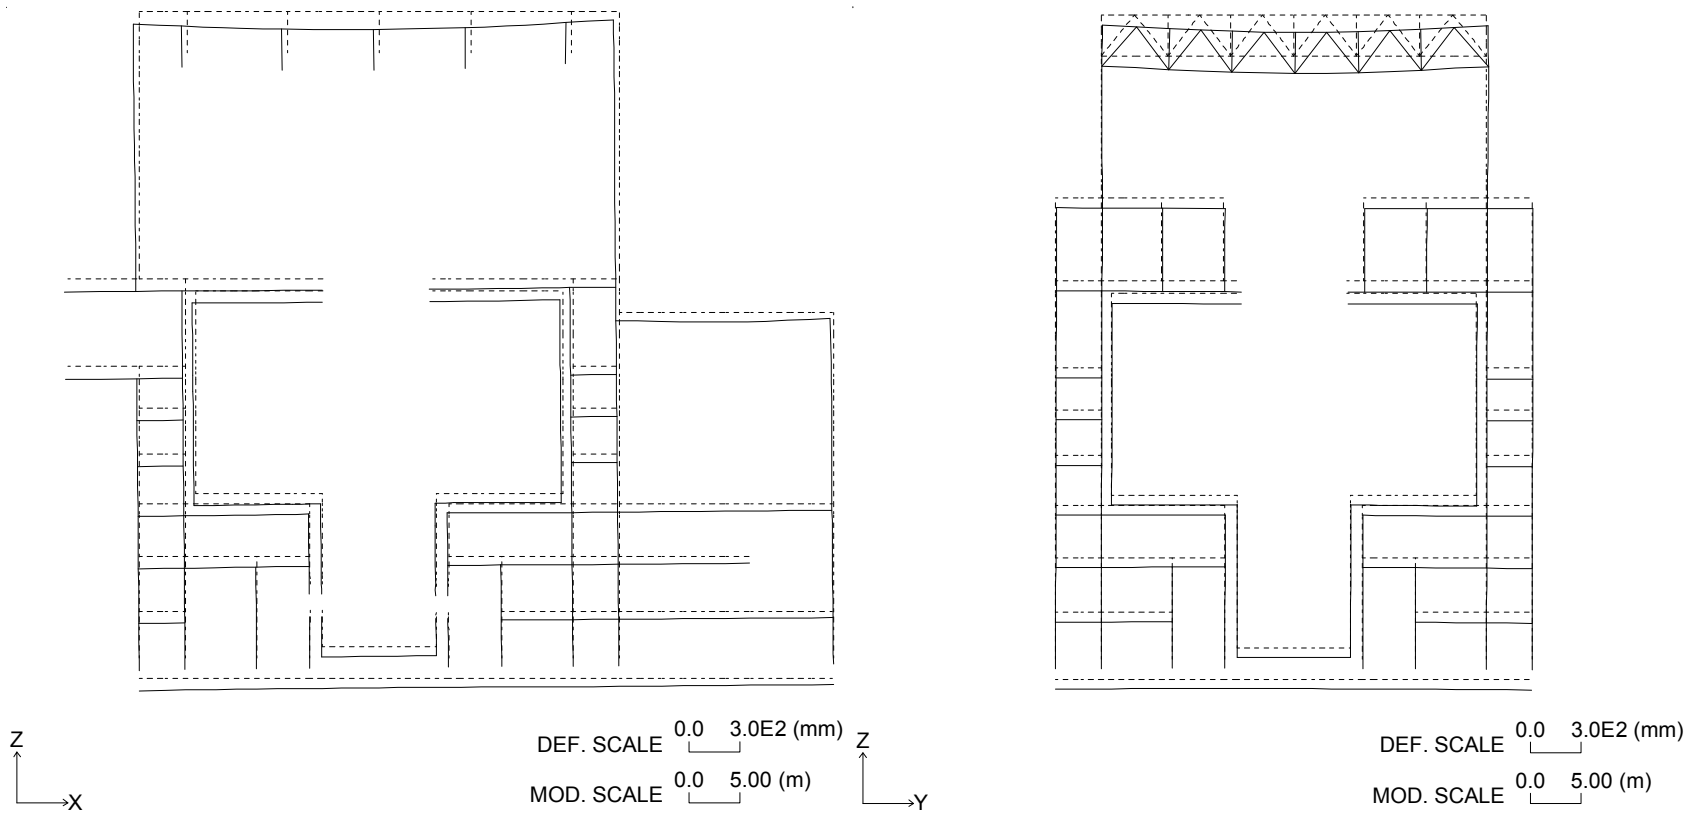

Figure 3G.1-30. Section Deformation for Dead Load

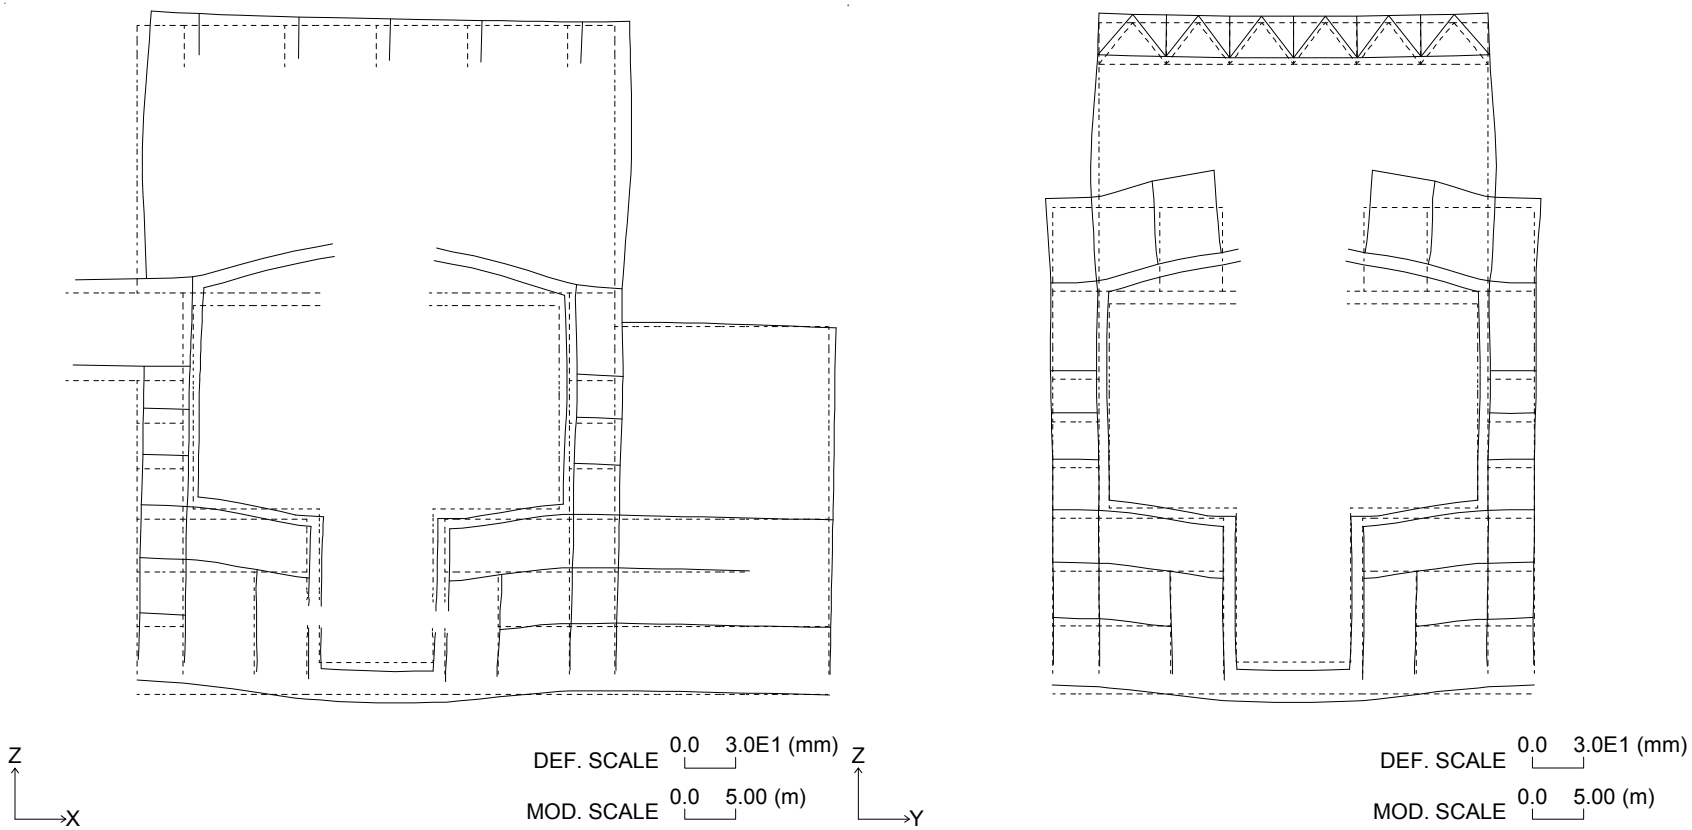

Figure 3G.1-31. Section Deformation for Drywell Unit Pressure (1 MPa)

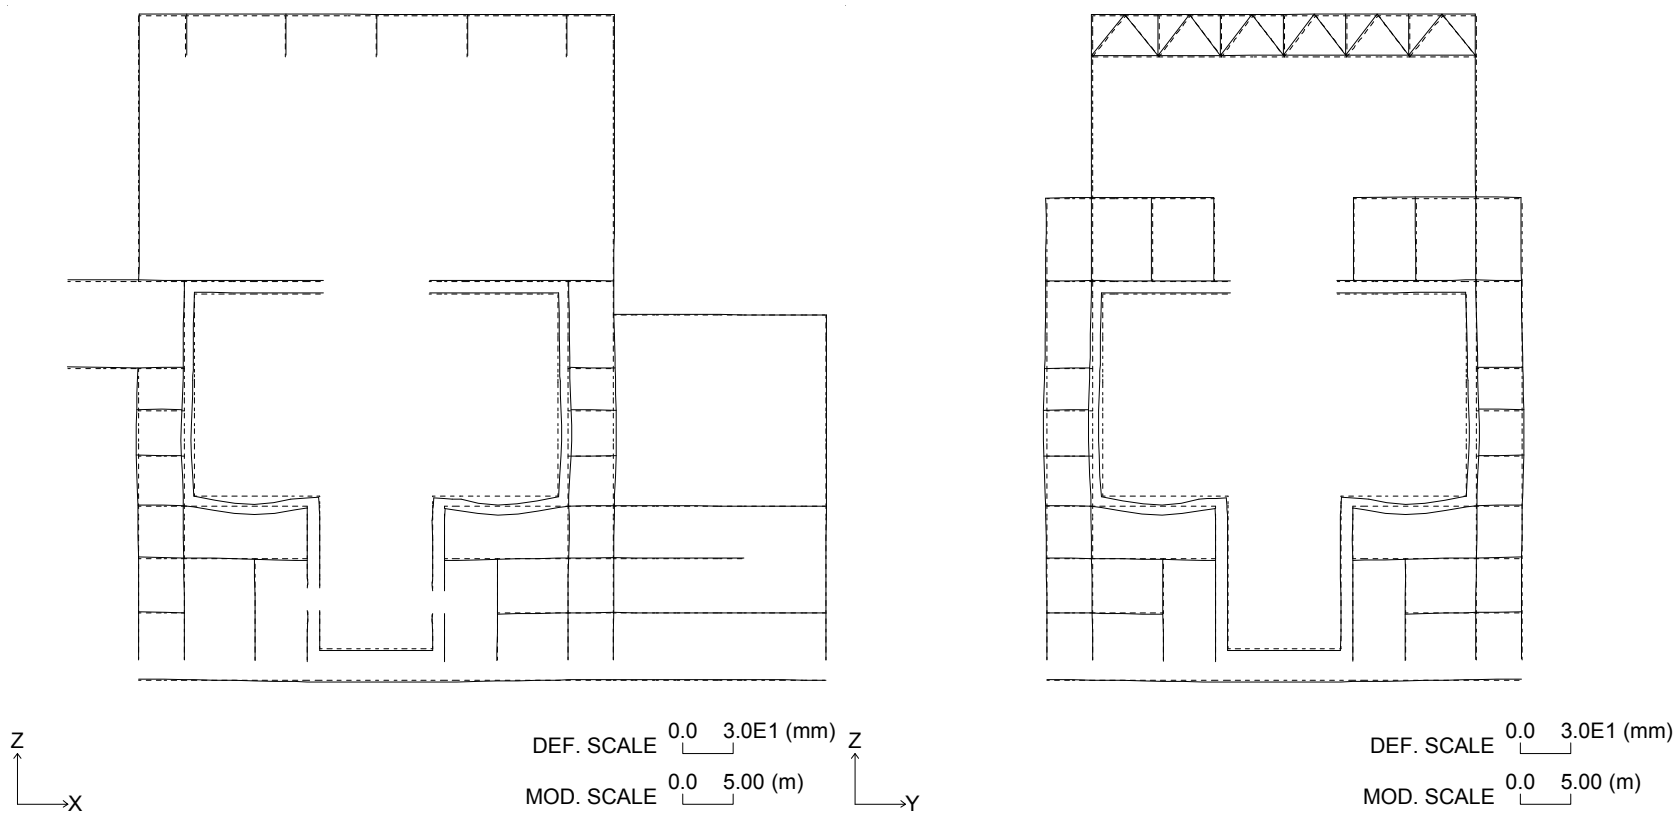

Figure 3G.1-32. Section Deformation for Wetwell Unit Pressure (1 MPa)

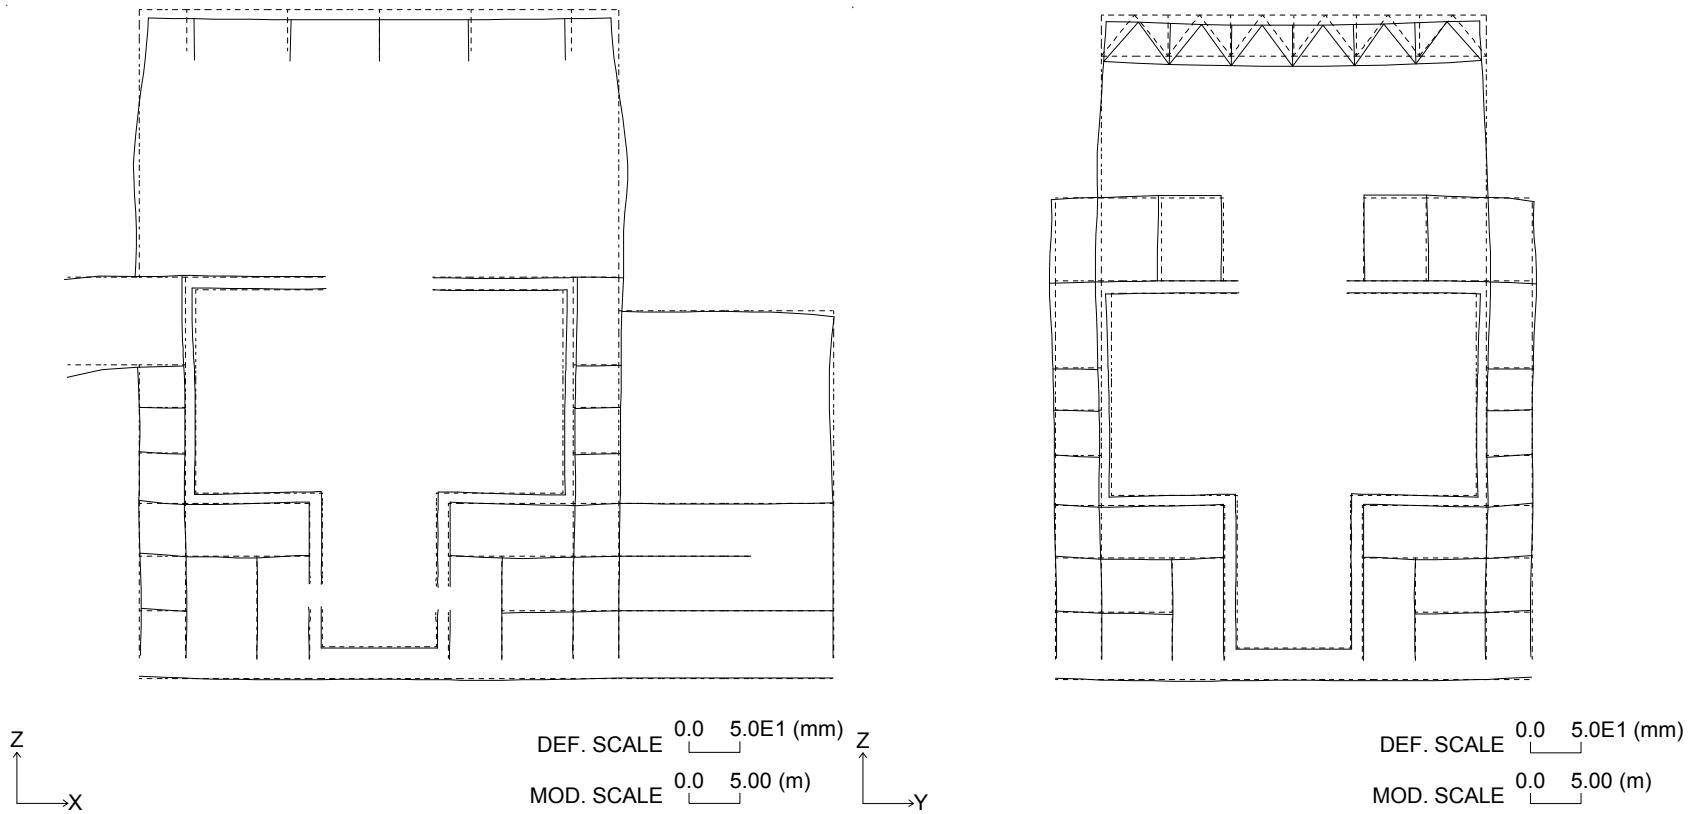

Figure 3G.1-33. Section Deformation for Thermal Load (Normal Operation: Winter)

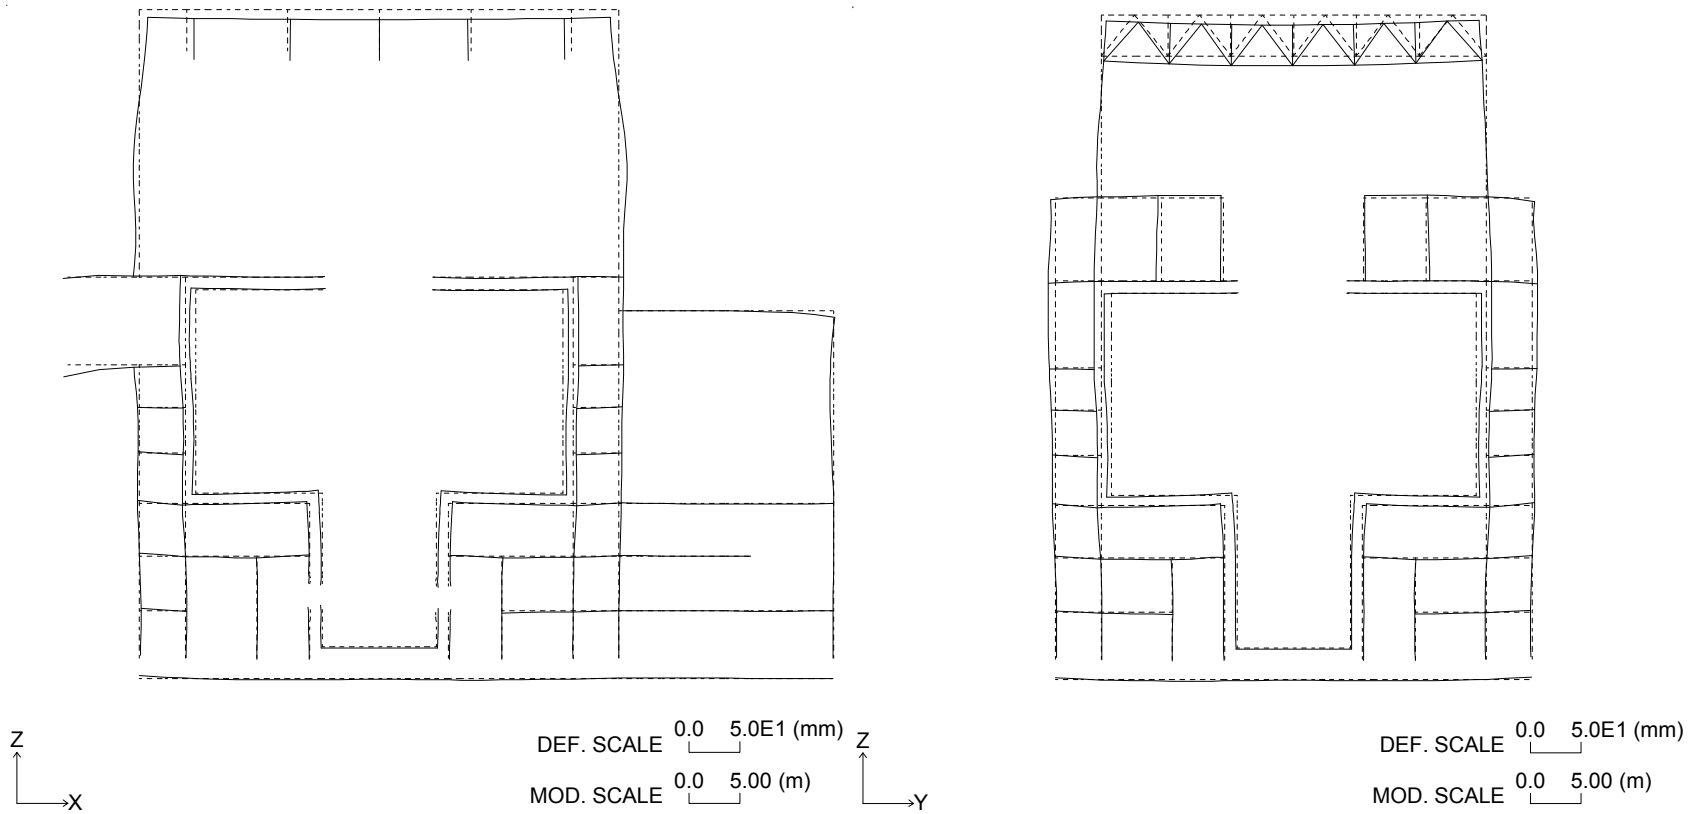

Figure 3G.1-34. Section Deformation for Thermal Load (LOCA After 6 min.: Winter)

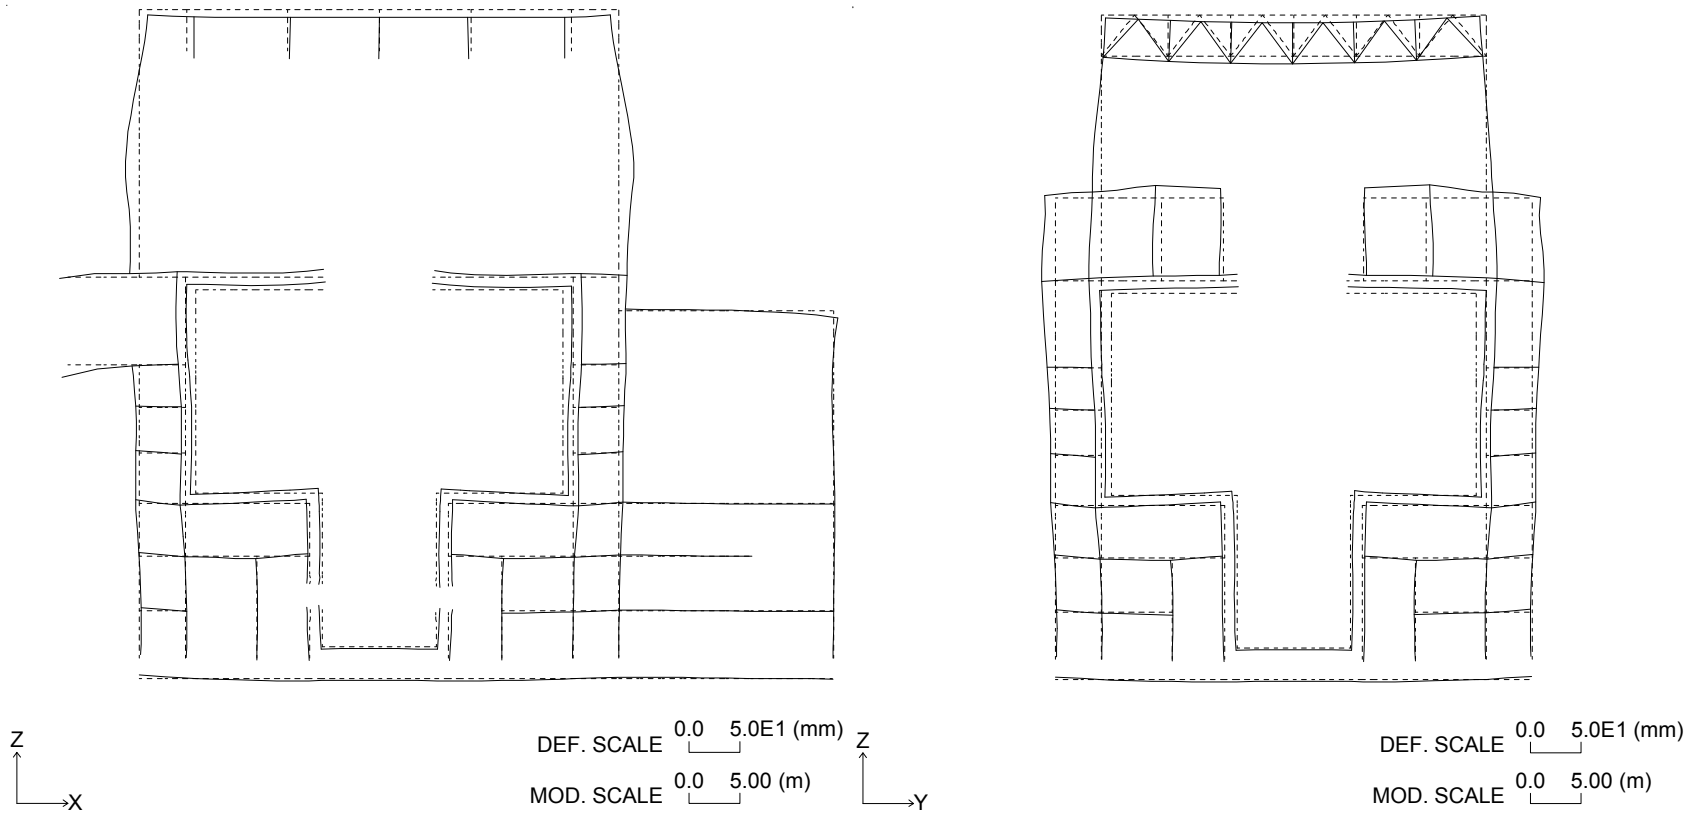

Figure 3G.1-35. Section Deformation for Thermal Load (LOCA After 72 hr.: Winter)

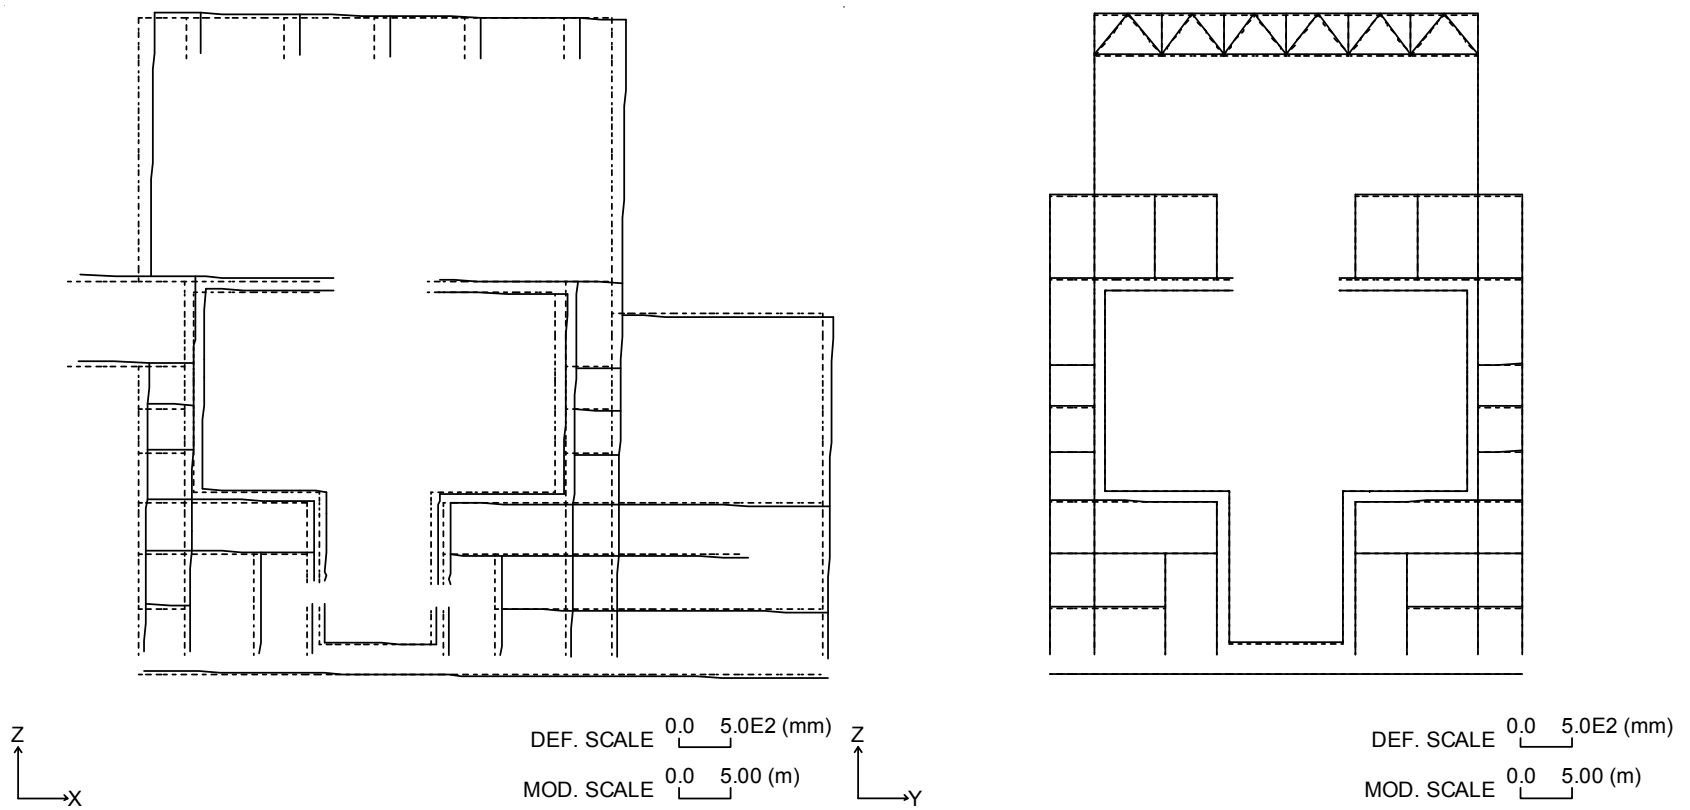

Figure 3G.1-36. Section Deformation for Seismic Load (Horizontal: North to South)

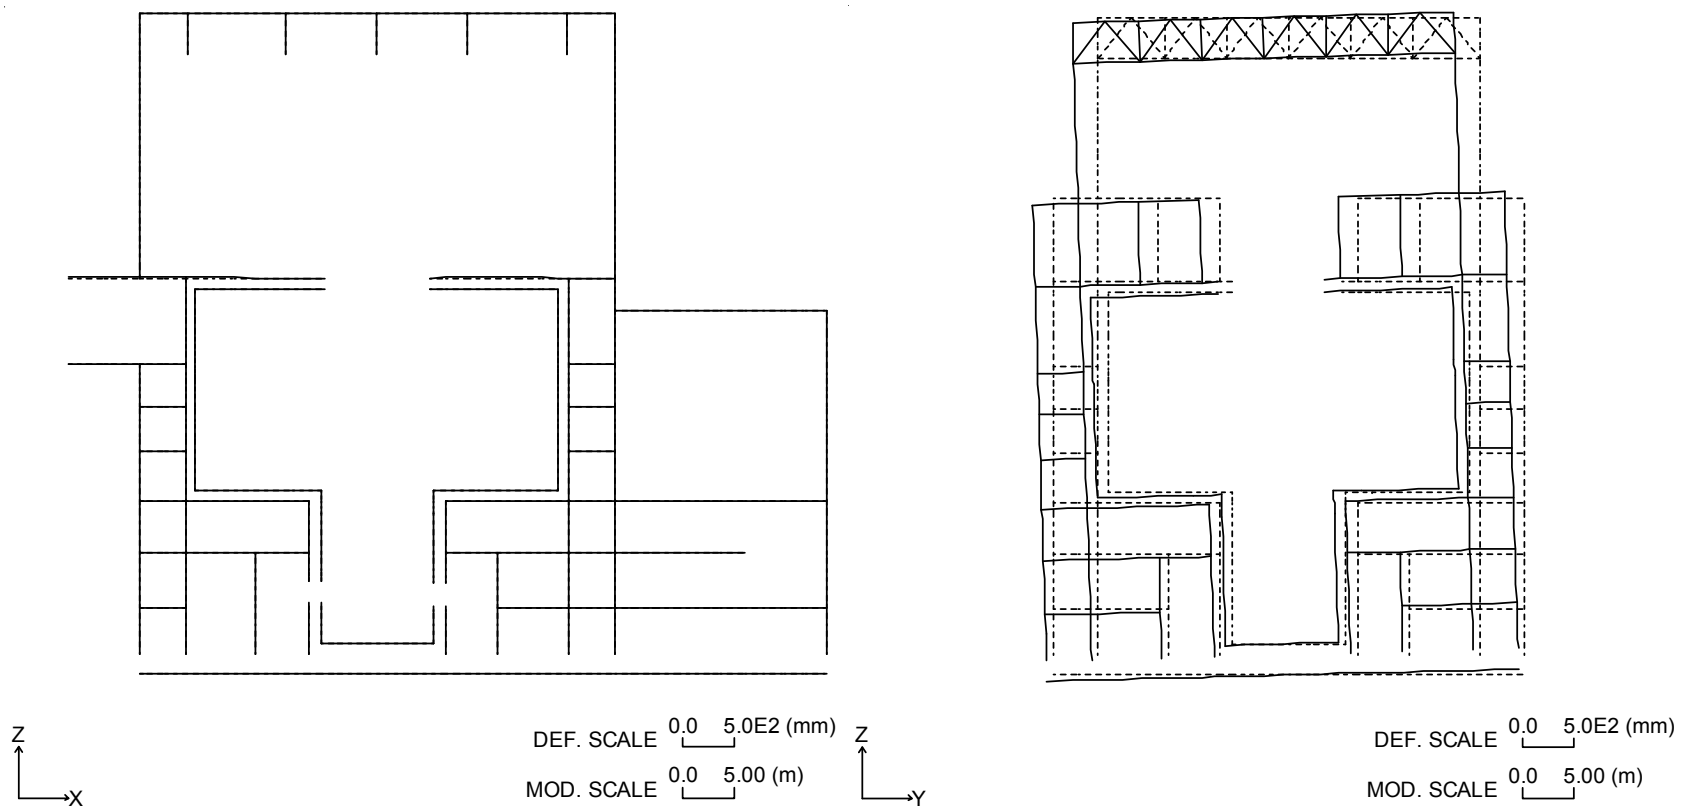

Figure 3G.1-37. Section Deformation for Seismic Load (Horizontal: East to West)

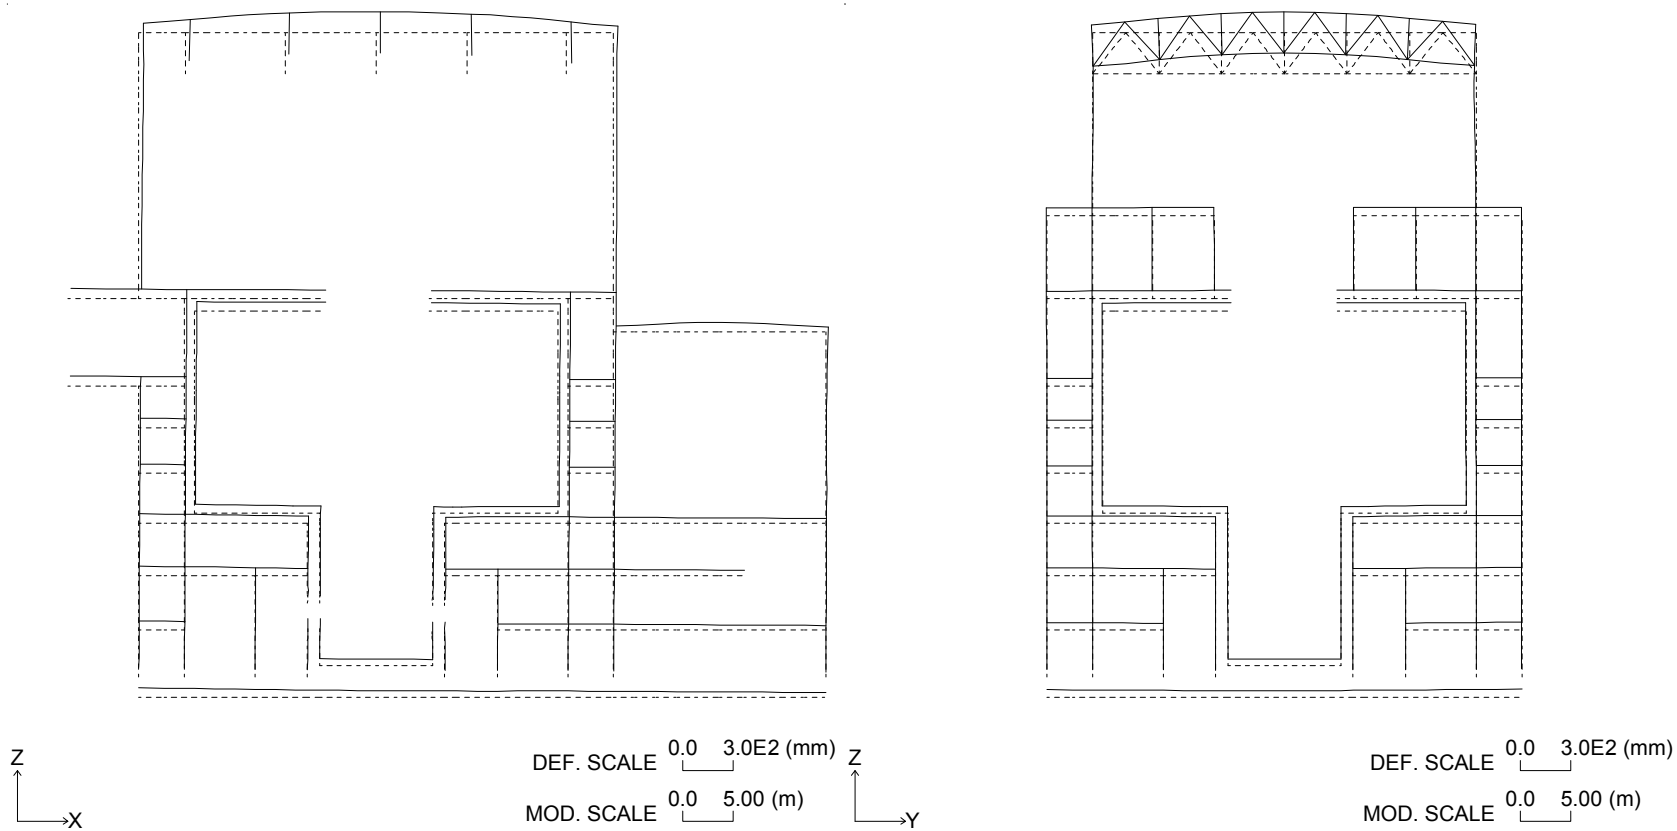

Figure 3G.1-38. Section Deformation for Seismic Load (Vertical: Upward)

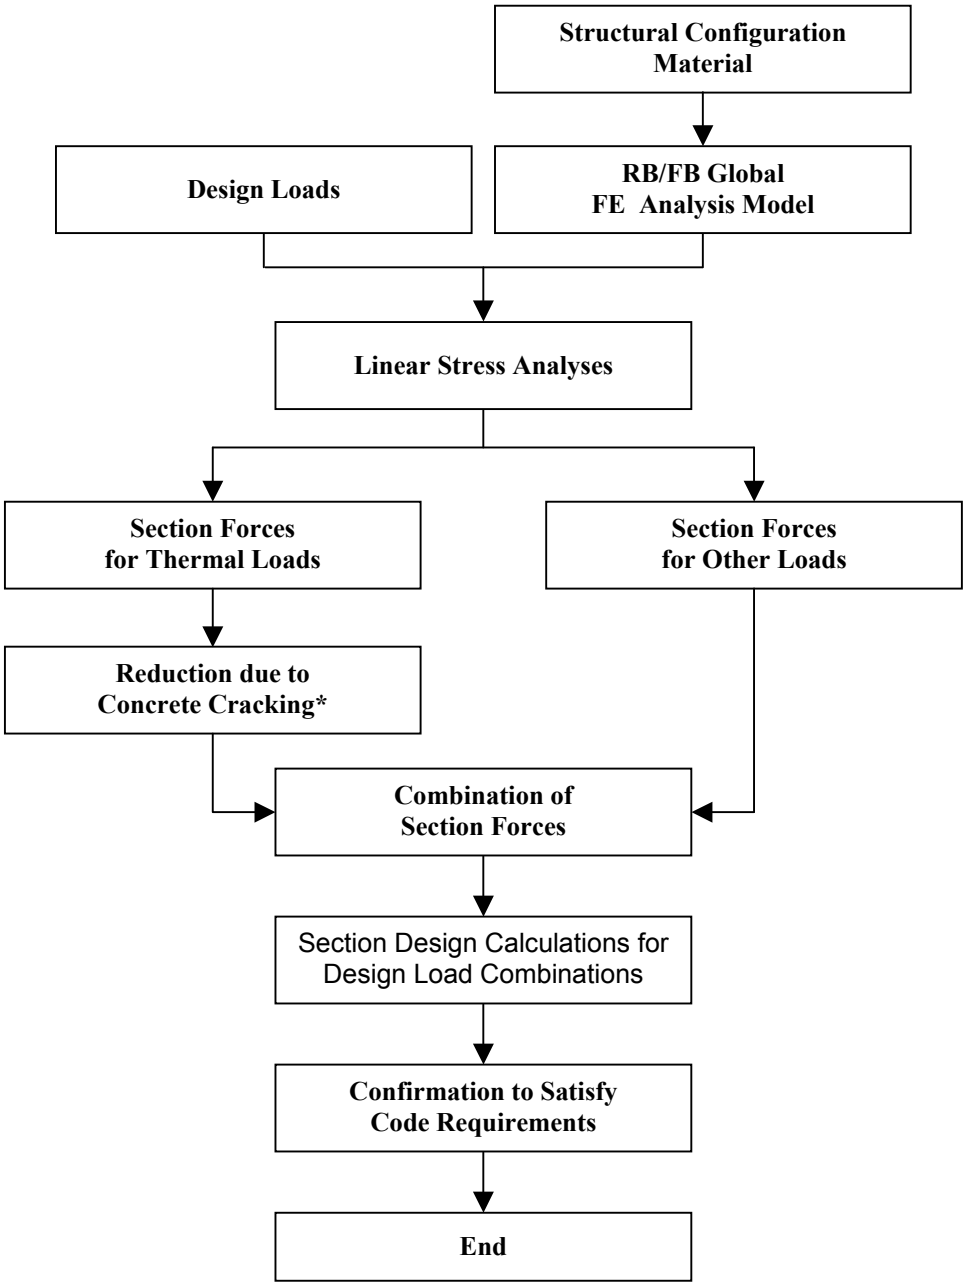

*: Thermal section forces are reduced using the section design calculation program, SSDP-2D, with thermal cracking option selected.
However, for the LOCA thermal loads, "thermal ratios" obtained by 3D nonlinear analyses are multiplied to the section forces obtained by linear stress analyses.
The section forces from the non-linear analyses can also be used directly.
Thermal cracking option of SSDP-2D is not used together with 3D non-linear analyses.
(Refer to Subsections 3.8.1.4.1.2 and 3.8.1.4.1.3.)

Figure 3G.1-39. Flow Chart for Structural Analysis and Design

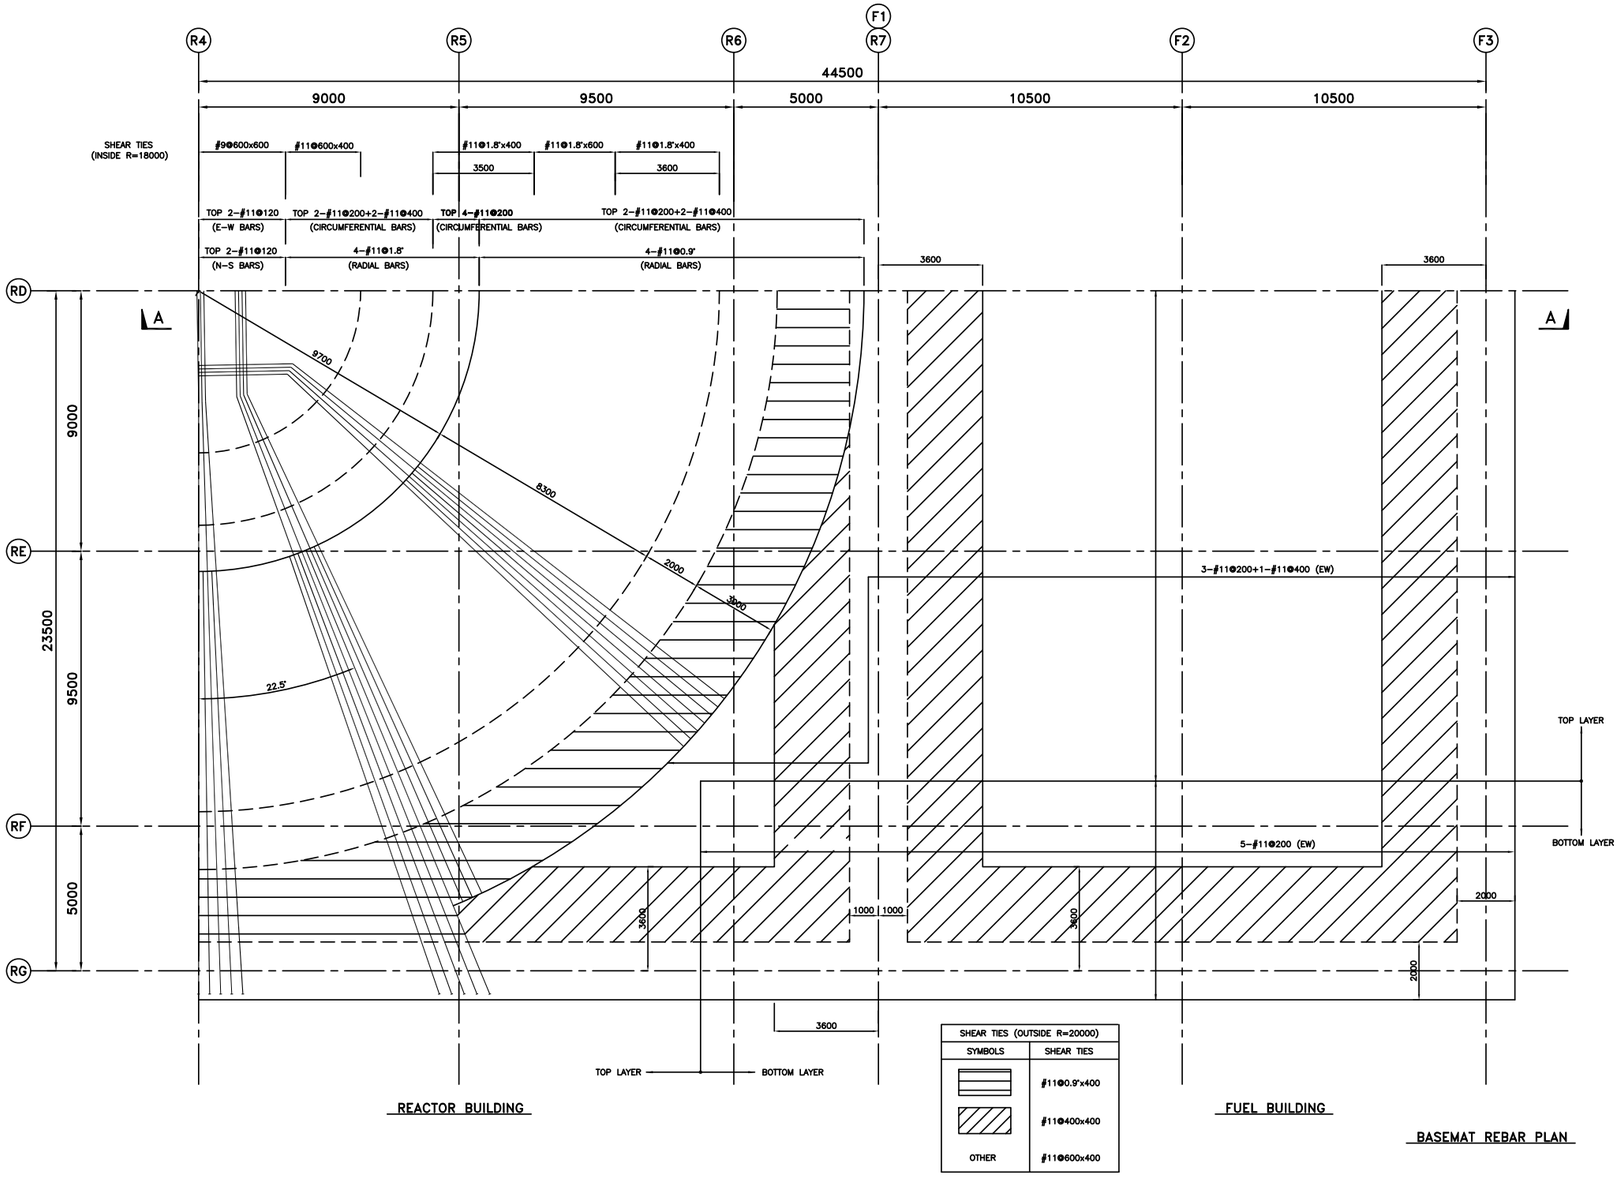

Figure 3G.1-40. Reinforcing Steel of Foundation Mat: Plan

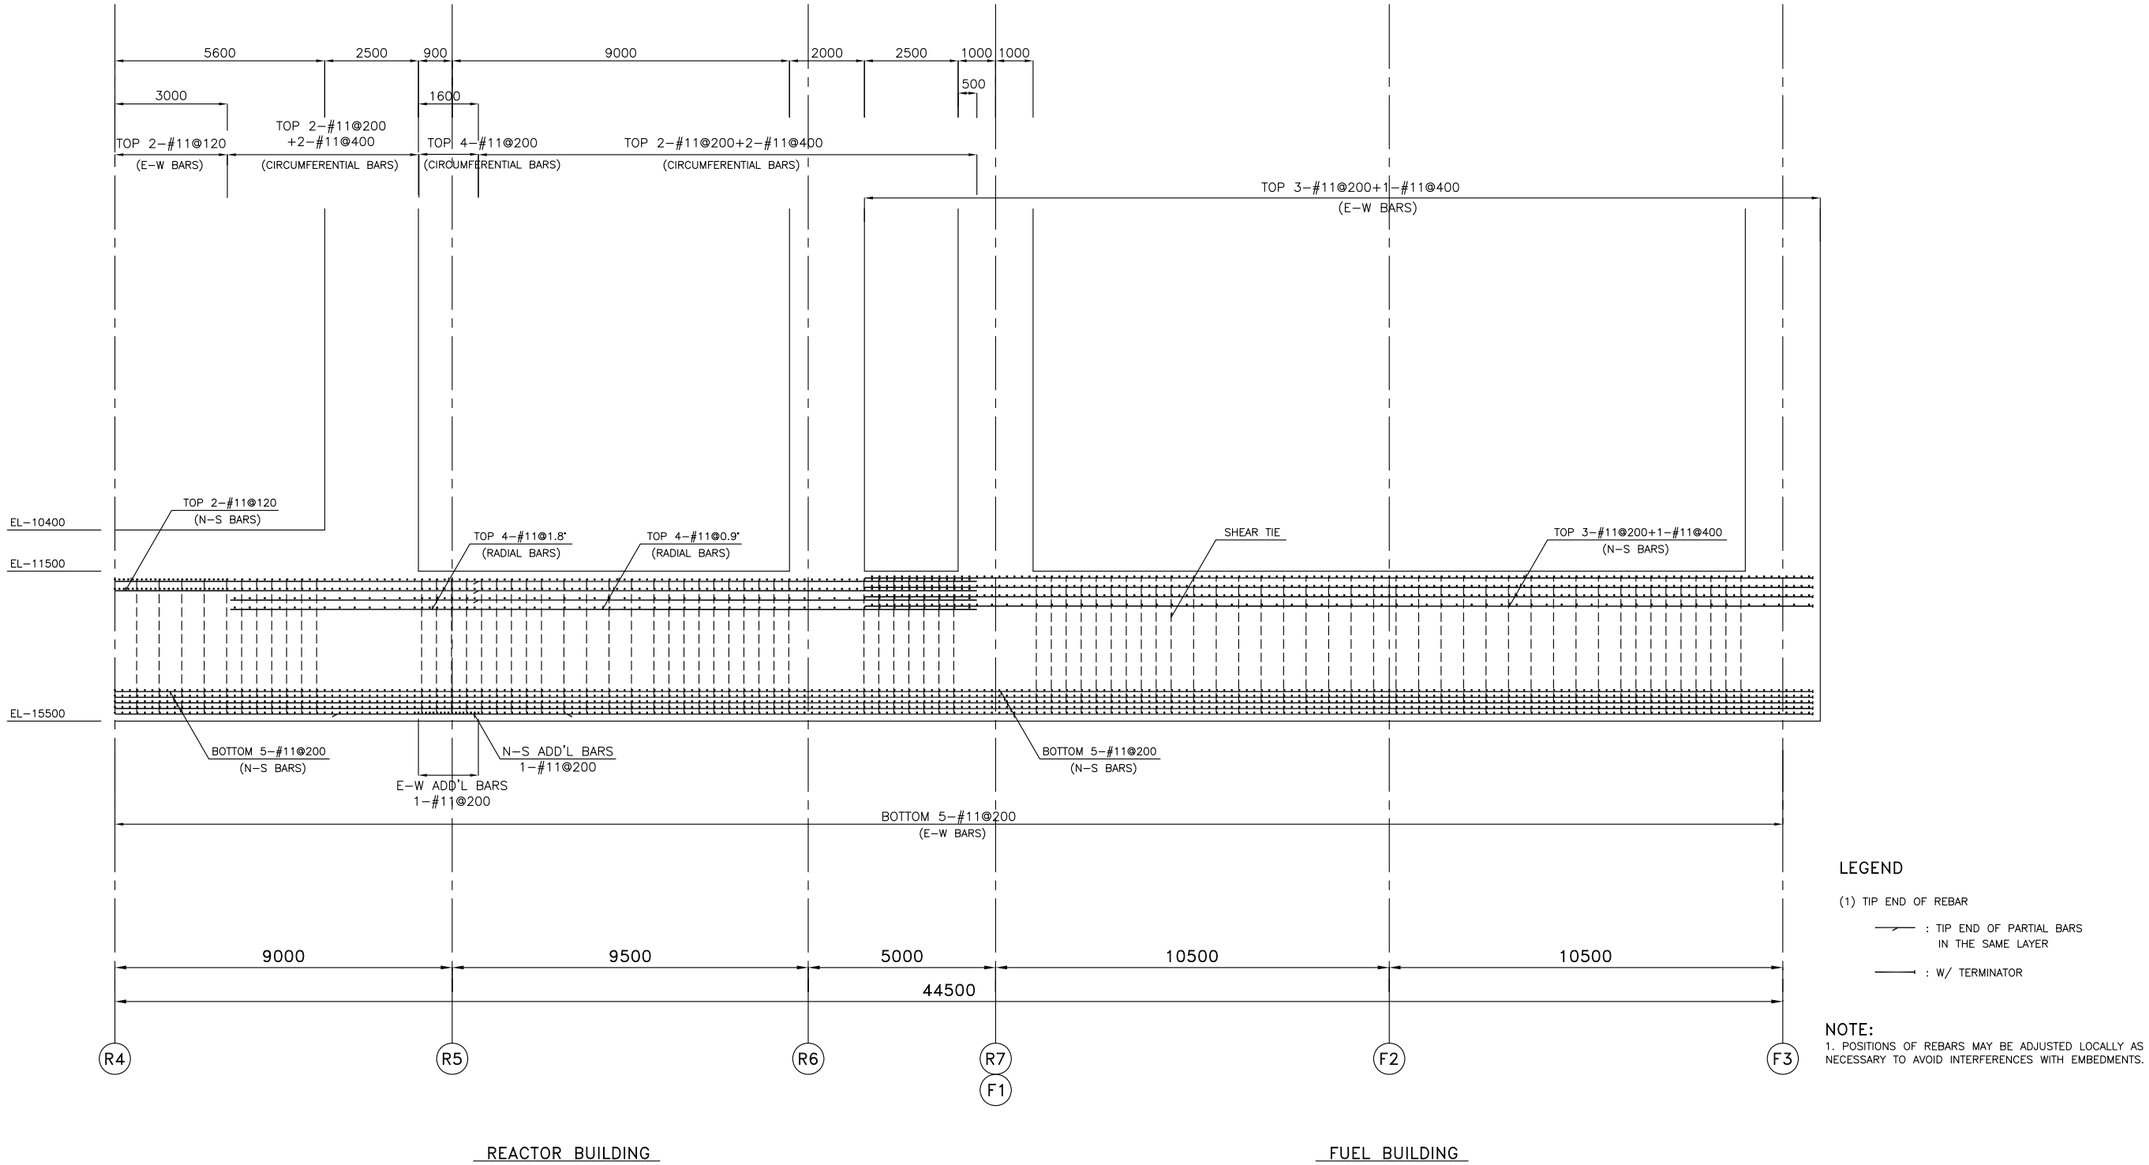

Figure 3G.1-41. Reinforcing Steel of Foundation Mat: Section A-A

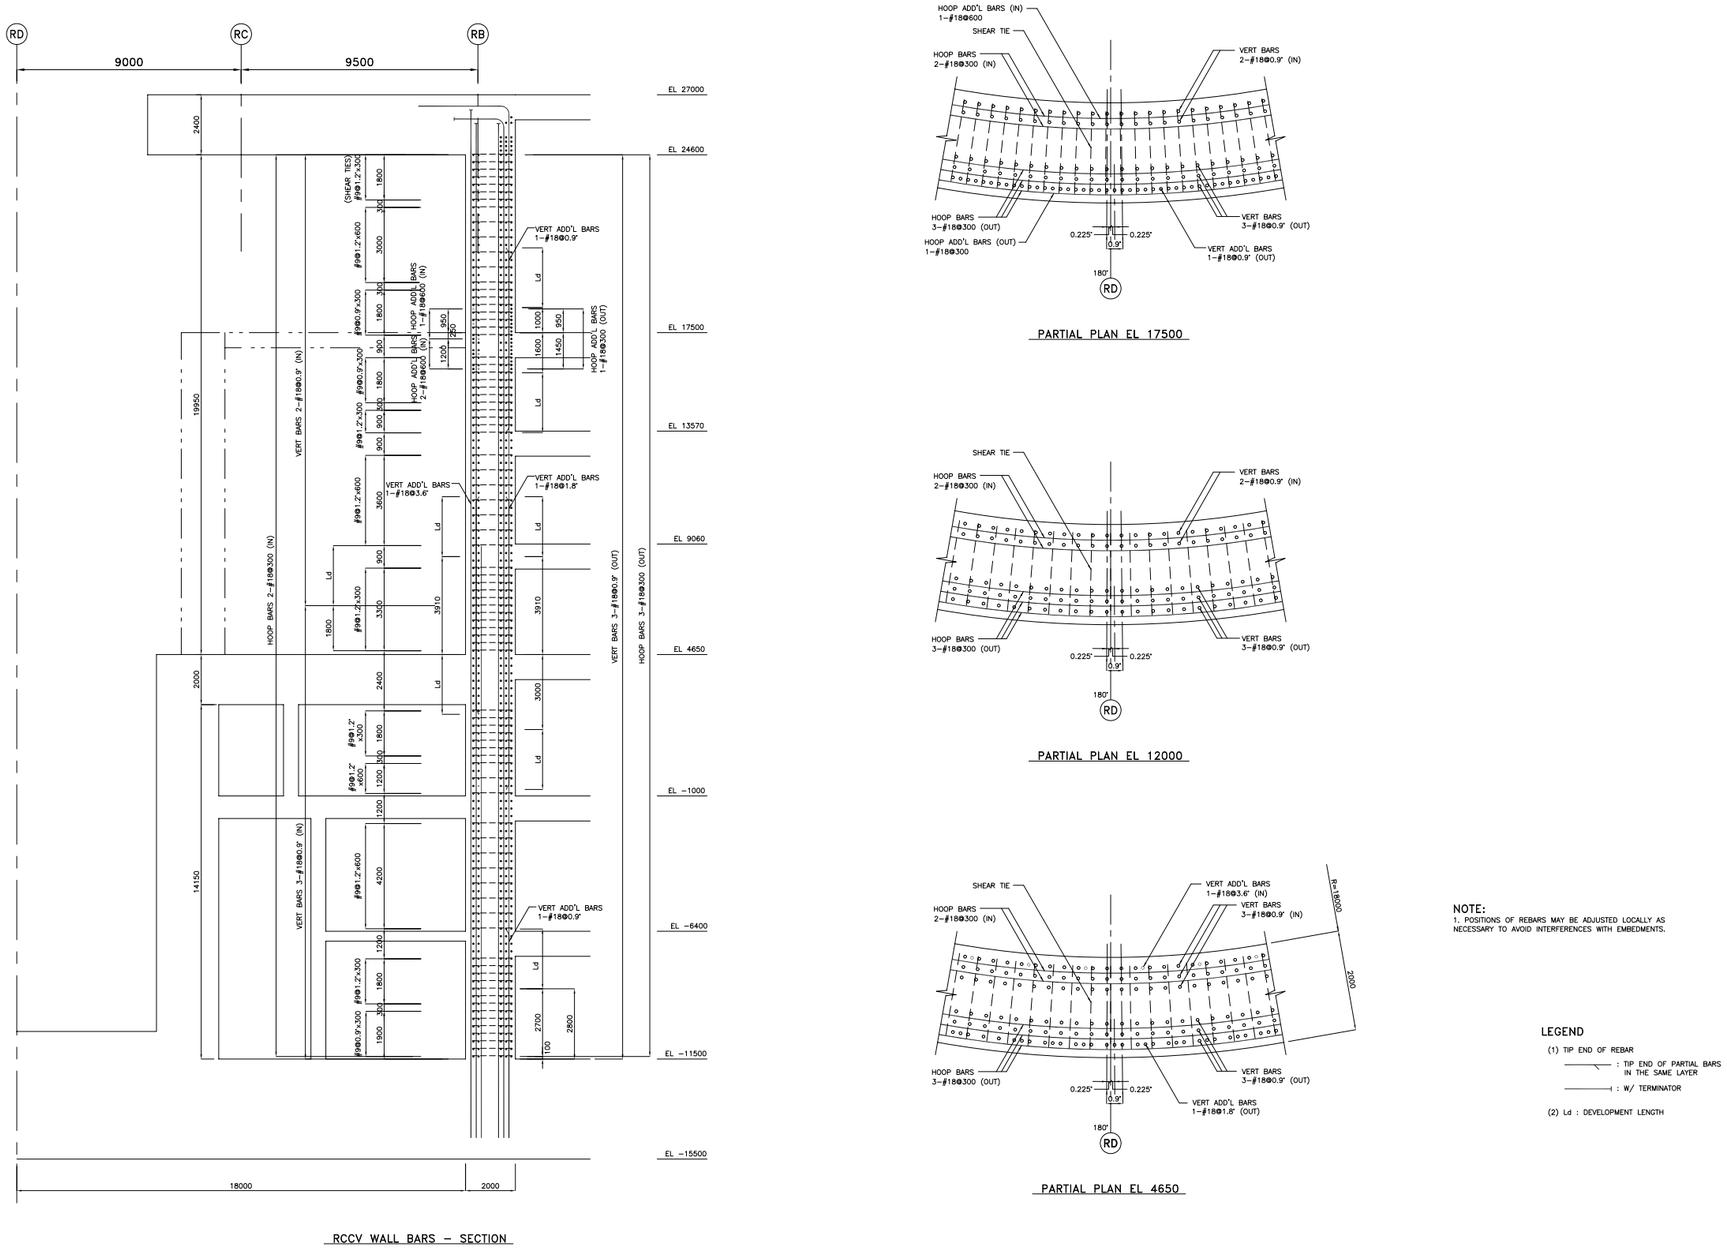

Figure 3G.1-42. Reinforcing Steel of RCCV Wall

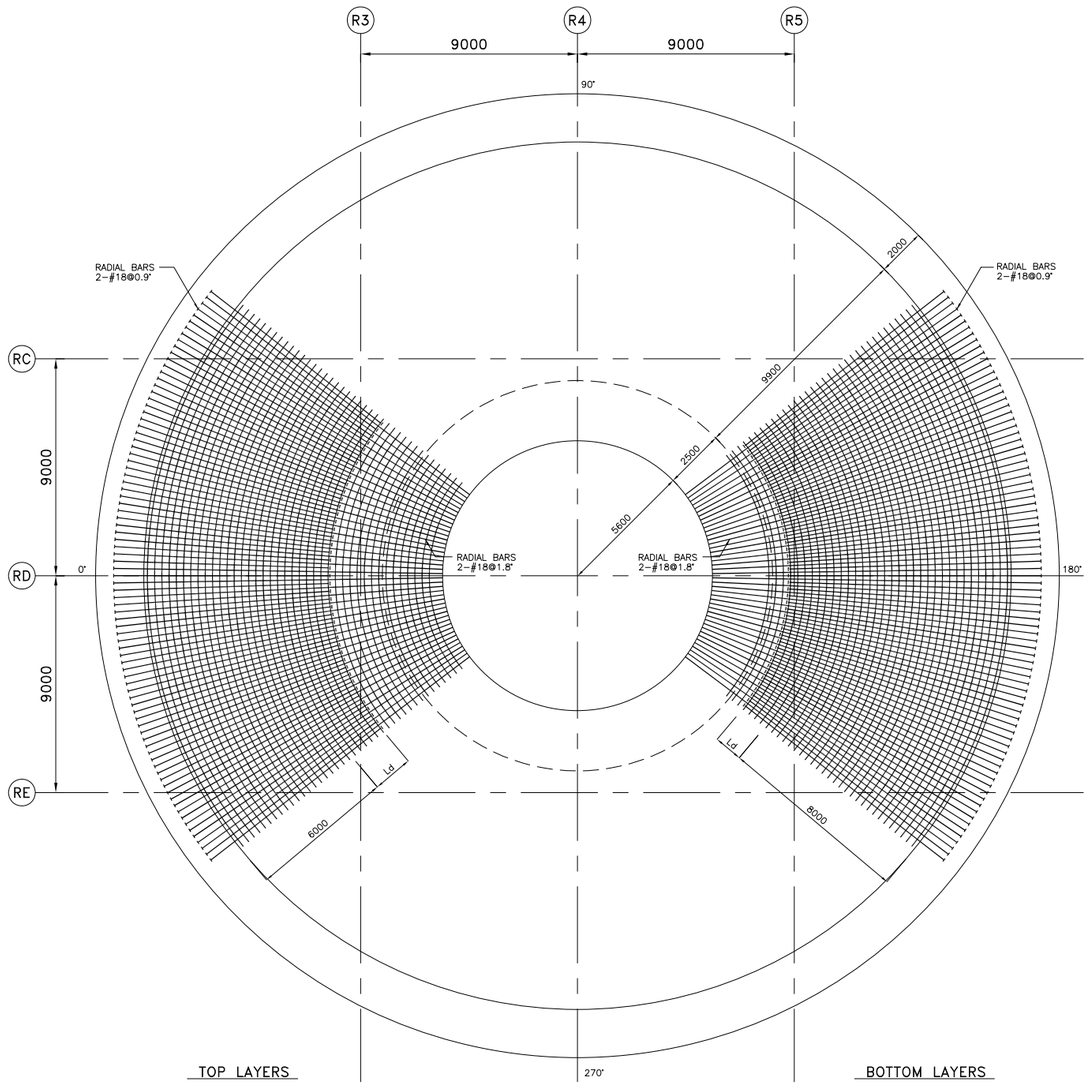

SUPPRESSION POOL SLAB – PLAN

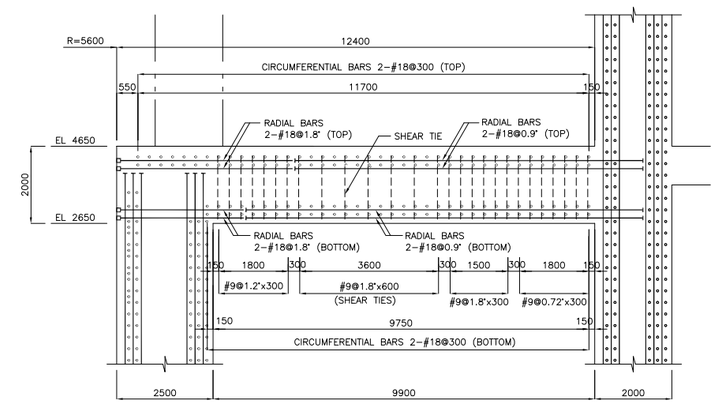

SUPPRESSION POOL SLAB – SECTION

LEGEND

(1) TIP END OF REBAR

——————| : W/ TERMINATOR

(2) Ld : DEVELOPMENT LENGTH

NOTE:

1. POSITIONS OF REBARS MAY BE ADJUSTED LOCALLY AS NECESSARY TO AVOID INTERFERENCES WITH EMBEDMENTS.

Figure 3G.1-43. Reinforcing Steel of Suppression Pool Slab

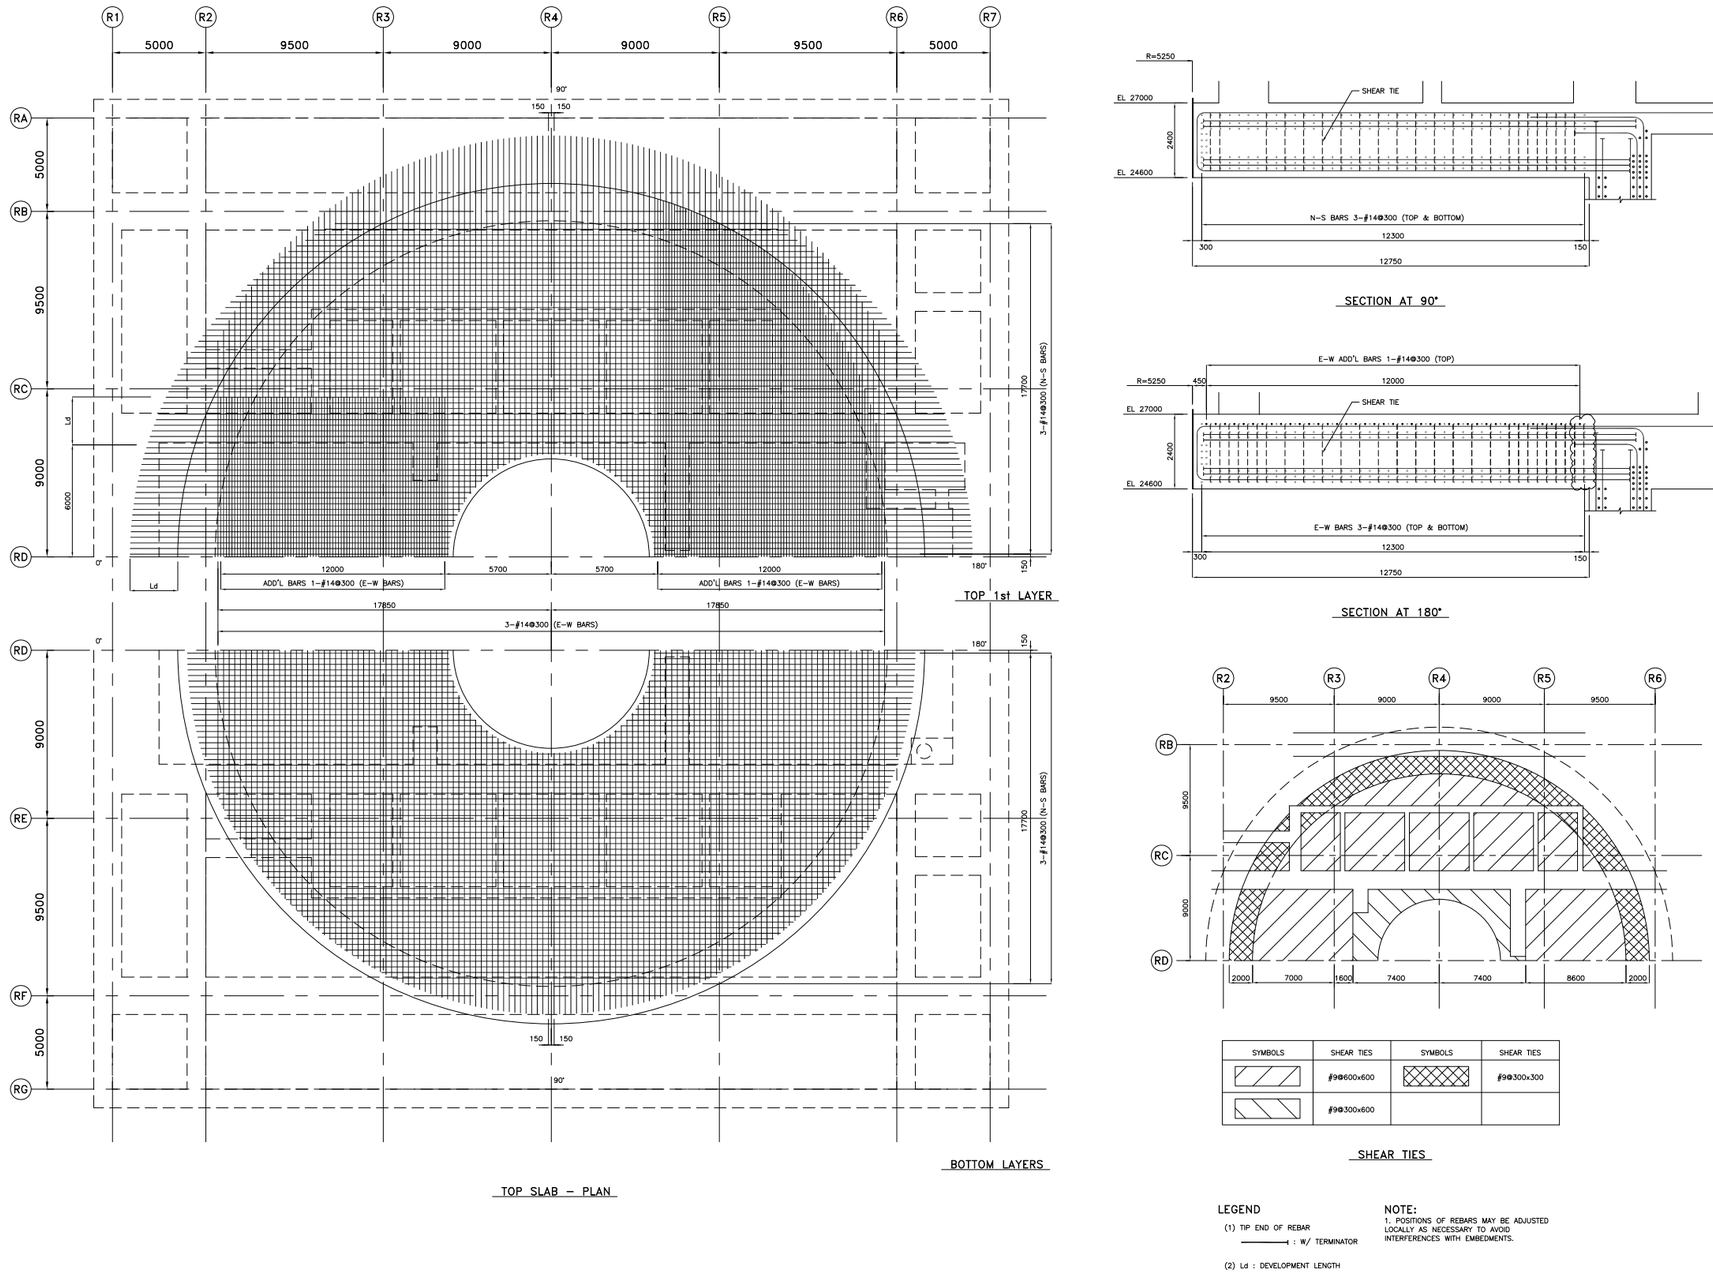

Figure 3G.1-44. Reinforcing Steel of Top Slab

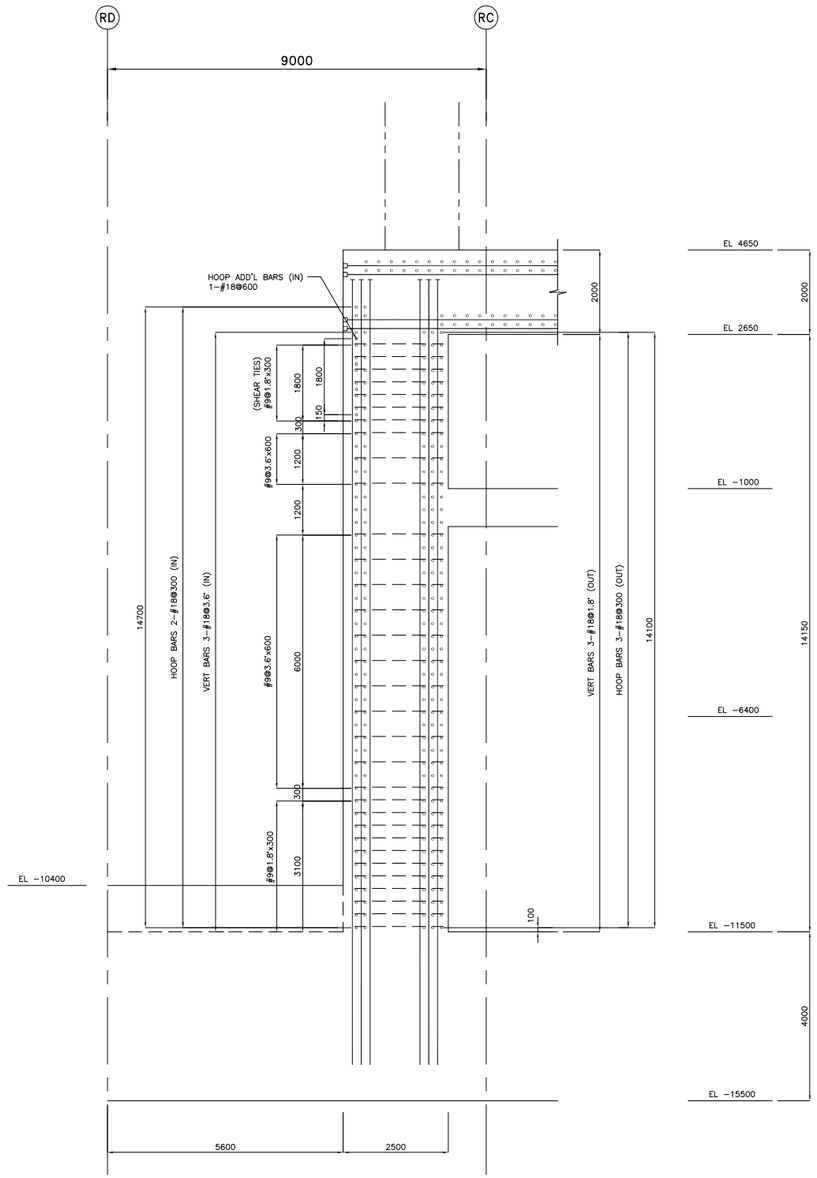

RPV PEDESTAL BARS – SECTION

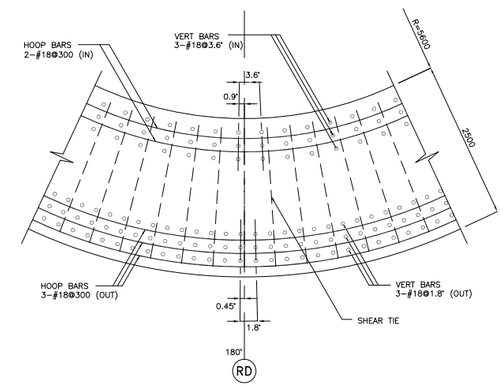

PARTIAL PLAN EL -1000

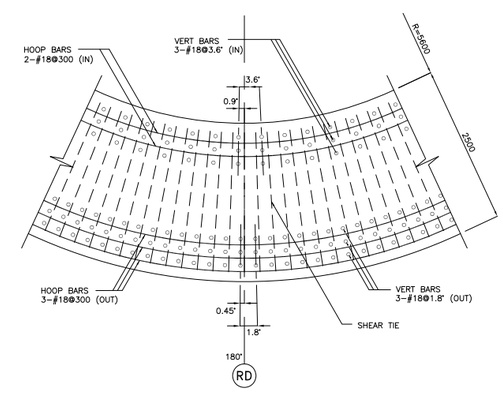

PARTIAL PLAN EL -11500

LEGEND

(1) TIP END OF REBAR

: W/ TERMINATOR

NOTE:

1. POSITIONS OF REBARS MAY BE ADJUSTED LOCALLY AS NECESSARY TO AVOID INTERFERENCES WITH EMBEDMENTS.

Figure 3G.1-45. Reinforcing Steel of RPV Pedestal

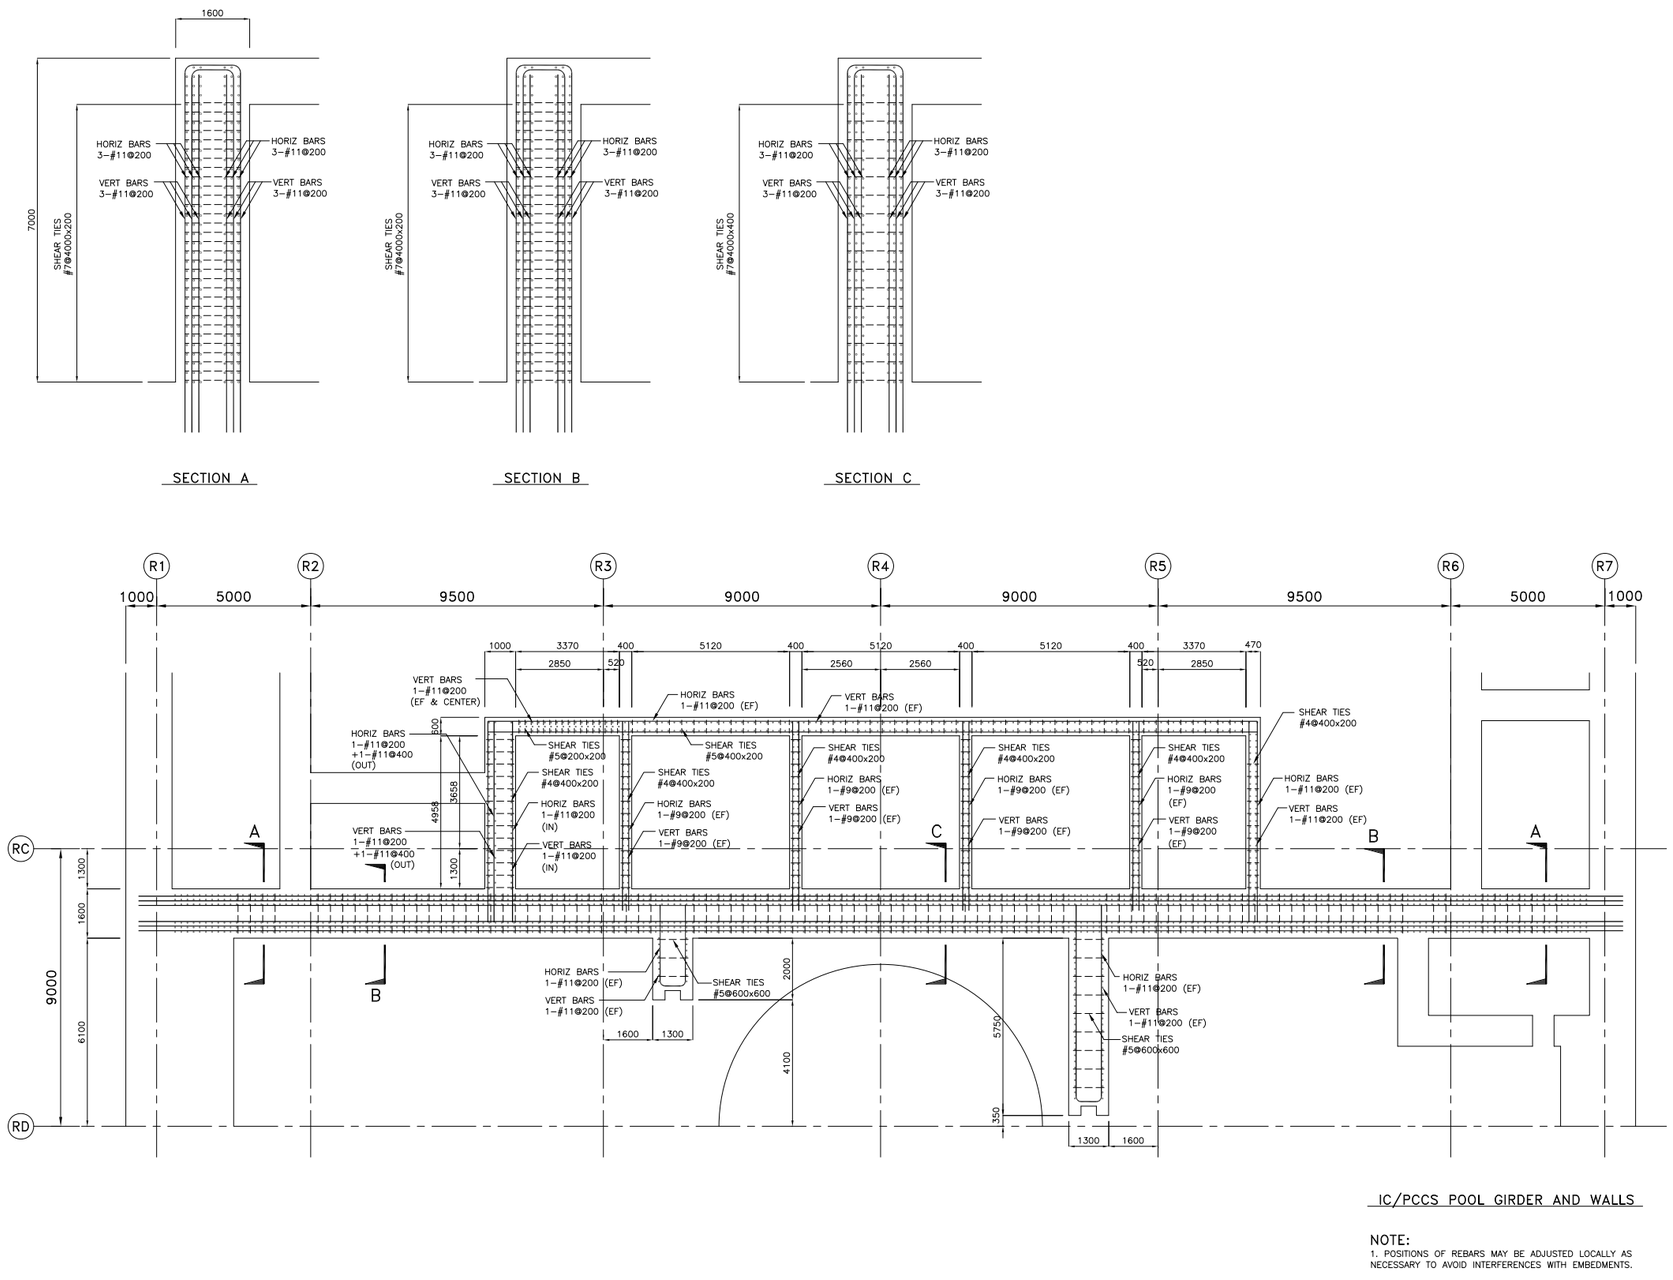

Figure 3G.1-46. Reinforcing Steel of IC/PCCS Pool Girder

RB SEISMIC WALLS REINFORCING SCHEDULE EL−11500 ~ EL34000				
EL 34000	TYPE	OW1		
	SECTION			
	VERT BAR	2−#11 @200 (EF)		
	HORIZ BAR	2−#11 @200 (EF)		
	SHEAR TIE	#5 @400x400		
EL 27000	TYPE	OW1	OW2	OW3
	SECTION			
	VERT BAR	3−#11@200 (OUT) 2−#11@200 (IN)	4−#11@200 (OUT) 3−#11@200 (IN)	6−#11@200 (OUT) 3−#11@200 (IN)
	HORIZ BAR	3−#11@200 (OUT) 2−#11@200 (IN)	4−#11@200 (OUT) 3−#11@200 (IN)	6−#11@200 (OUT) 3−#11@200 (IN)
	SHEAR TIE	#6 @400x400	#7 @400x200	#7 @400x200
EL 17500 ~ EL 4650	TYPE	OW1	OW2	OW3
	SECTION			
	VERT BAR	3−#11 @200 (EF)	4−#11@200 (OUT) 3−#11@200 (IN)	4−#11 @200 (EF)
	HORIZ BAR	3−#11 @200 (EF)	4−#11@200 (OUT) 3−#11@200 (IN)	3−#11@200+1−#11@400 (EF)
	SHEAR TIE	#6 @400x400	#7 @400x400	#7 @400x200
EL −1000 ~ EL −11500	TYPE	OW1	OW2	OW3
	SECTION			
	VERT BAR	4−#11 @200 (EF)	3−#11 @200 (EF)	5−#11 @200 (EF)
	HORIZ BAR	3−#11@200+1−#11@400 (EF)	3−#11 @200 (EF)	4−#11@200+1−#11@400 (EF)
	SHEAR TIE	#6 @400x400	#6 @400x400	#7 @400x200



FLOOR EL 34000



FLOOR EL 27000

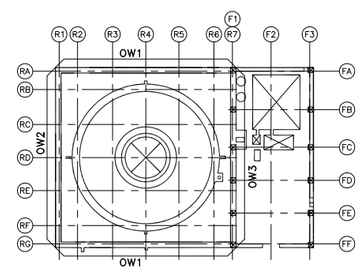

FLOOR EL 4650

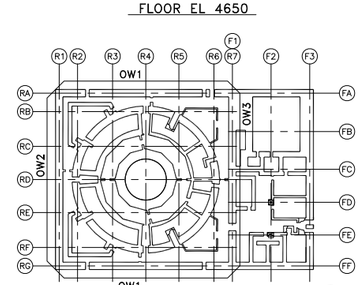

FLOOR EL −11500
KEY PLAN FOR WALL TYPE

MS TUNNEL WALL REINFORCING SCHEDULE		
EL 17500	TYPE	MW
	SECTION	
	VERT BAR	2−#11 @200(IN) 2−#11@200+1−#11@400(OUT)
	HORIZ BAR	2−#11 @200(IN) 2−#11@200+1−#11@400(OUT)
	SHEAR TIE	#6 @400x400

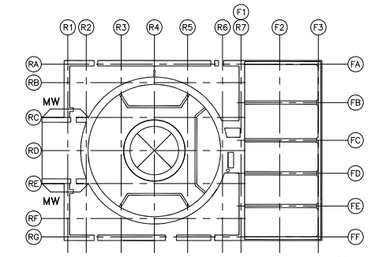

FLOOR EL 17500
KEY PLAN FOR MS WALL

SLAB REINFORCING SCHEDULE			
EL 27000	SECTION		(MS TUNNEL ROOF) 
	TOP	3−#11 @200 (EW)	4−#11 @200 (EW)
	BOTTOM	PLATE t=25	4−#11 @200 (EW)
	SHEAR TIE	#5 @200x200	#5 @200x200
EL 17500	SECTION		(MS TUNNEL SLAB) 
	TOP	2−#11 @200 (EW)	2−#11 @200 (EW)
	BOTTOM	PLATE t=16	3−#11 @200 (EW)
	SHEAR TIE	#5 @200x200	#5 @200x200
EL 4650	SECTION		
	TOP	2−#11 @200 (EW)	
	BOTTOM	PLATE t=16	
	SHEAR TIE	#5 @200x200	

Figure 3G.1-47. List of RB Wall and Slab Reinforcement

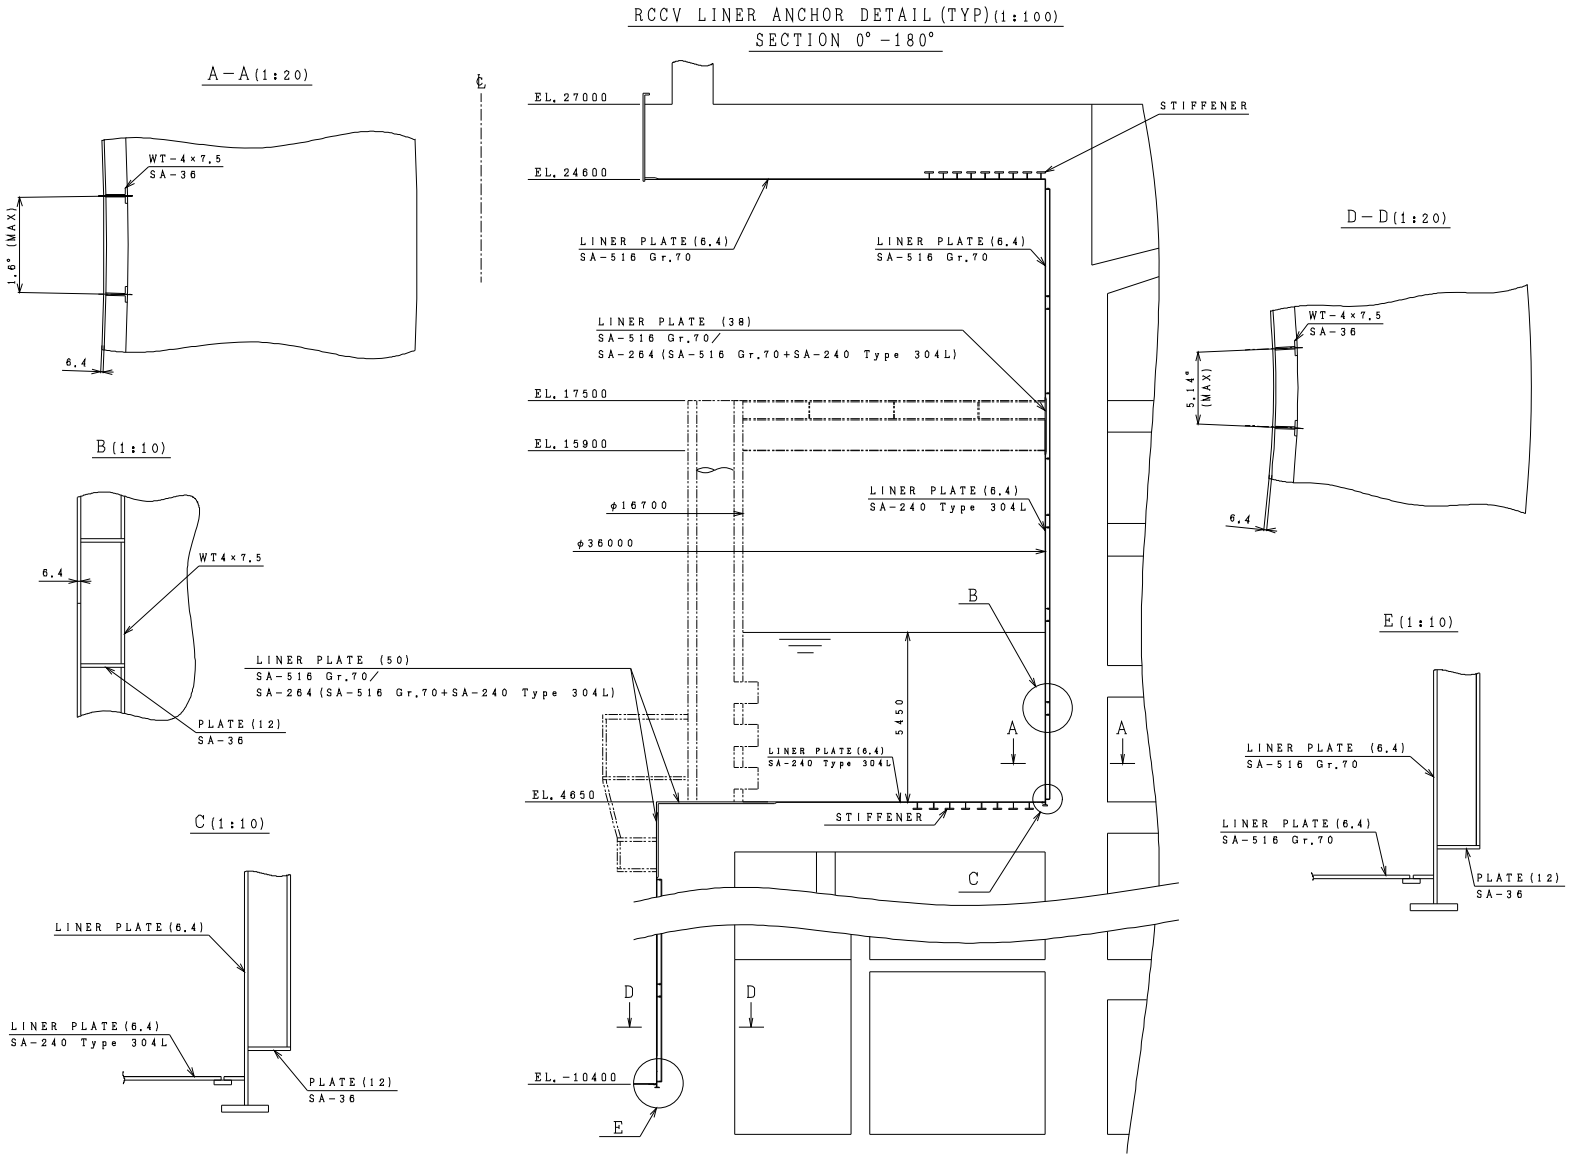

Figure 3G.1-48. Liner Anchor

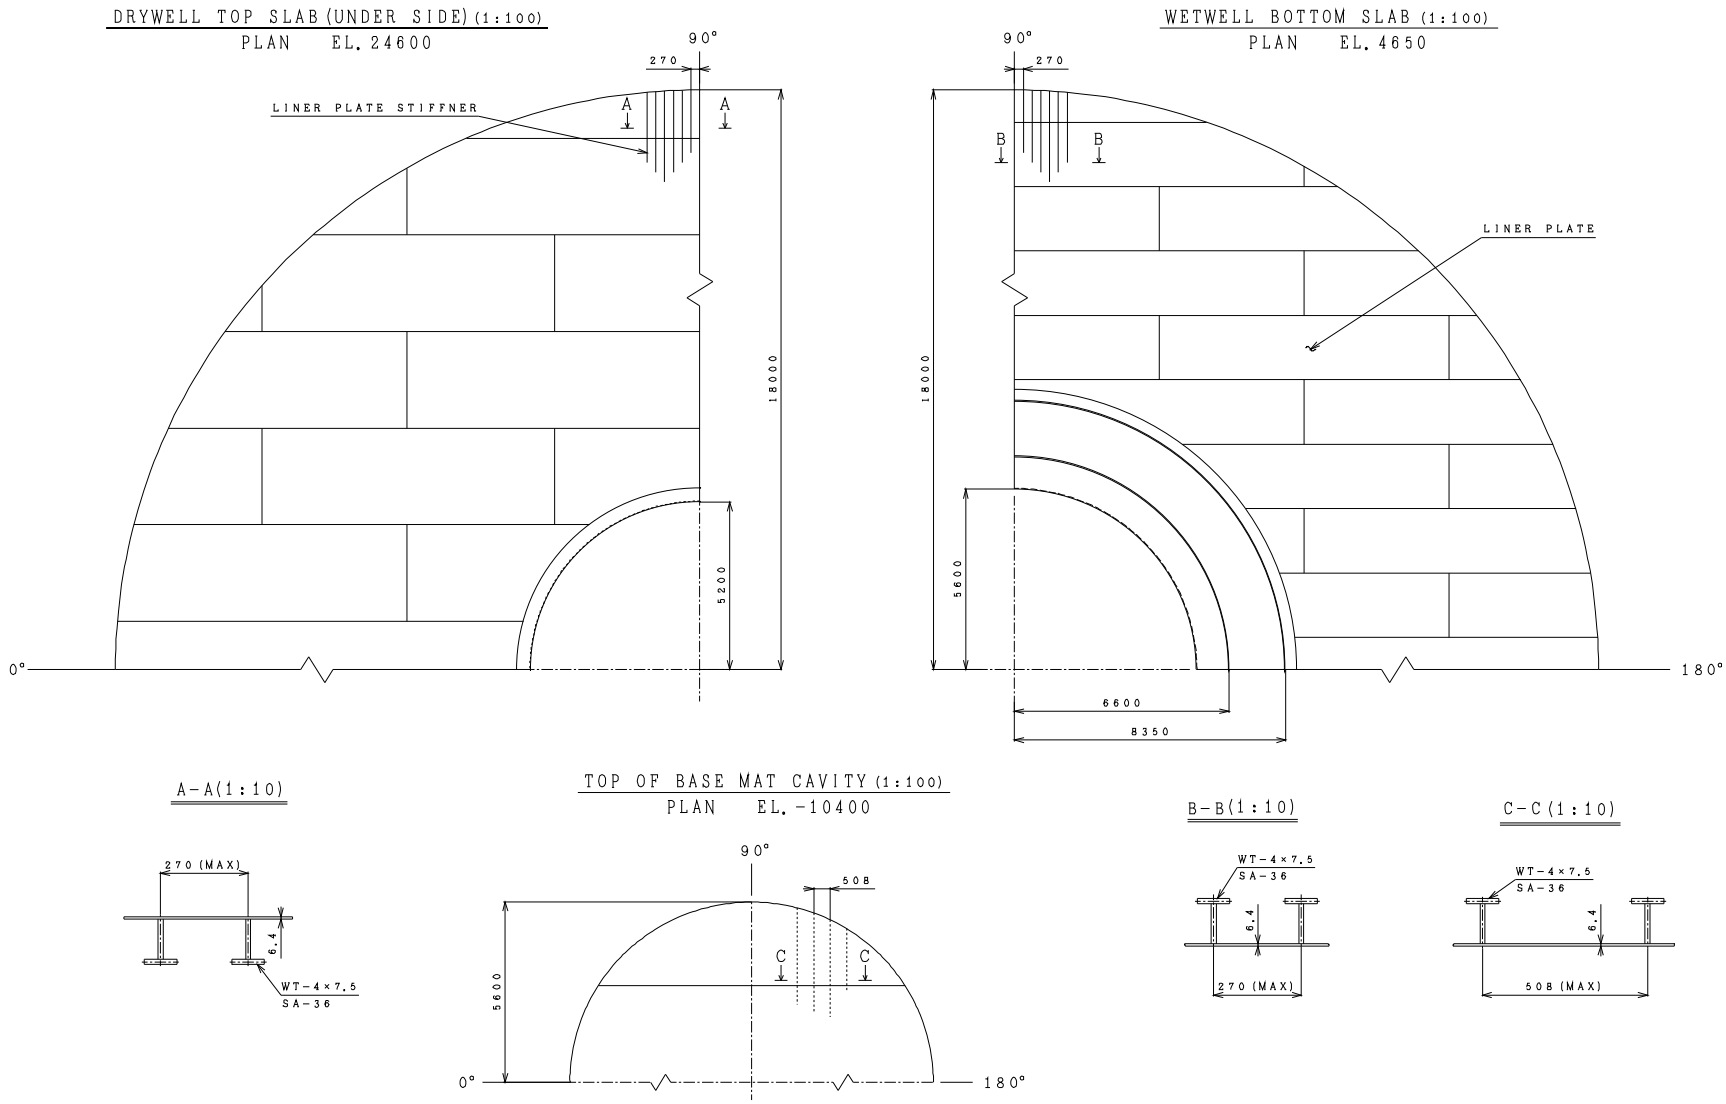

Figure 3G.1-49. Liner Plate Plans

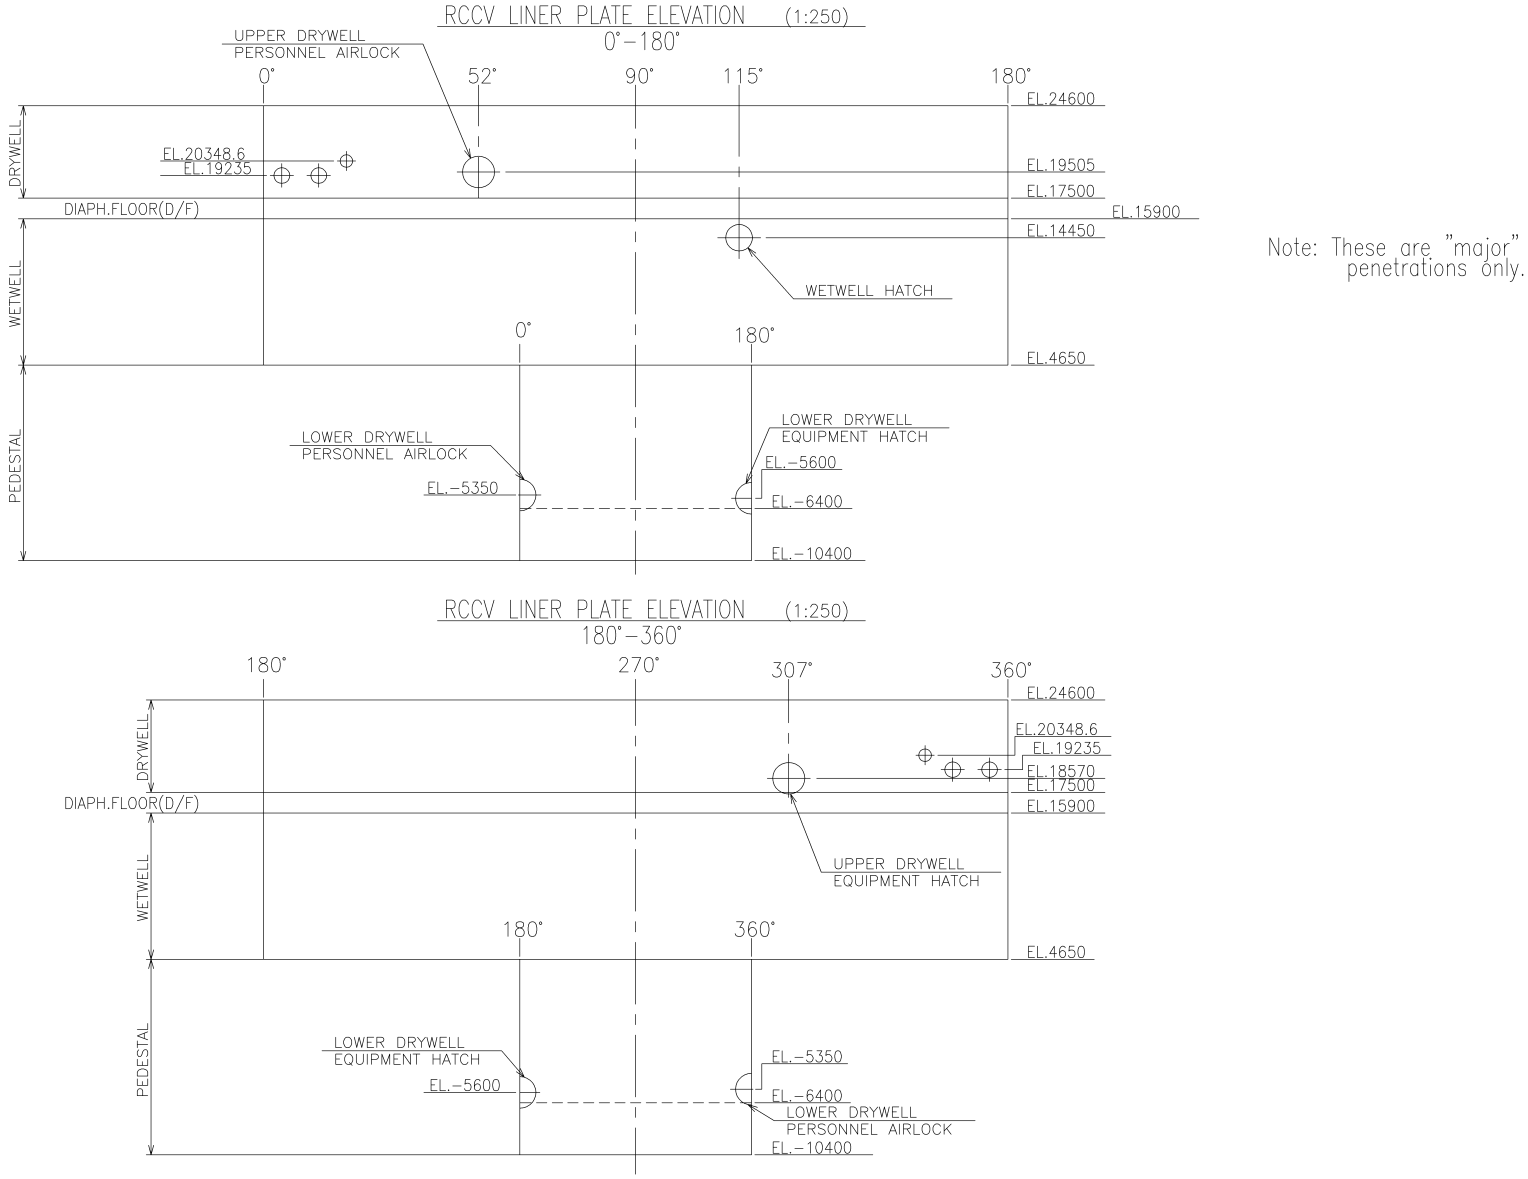

Figure 3G.1-50. Liner Plate Development Elevation

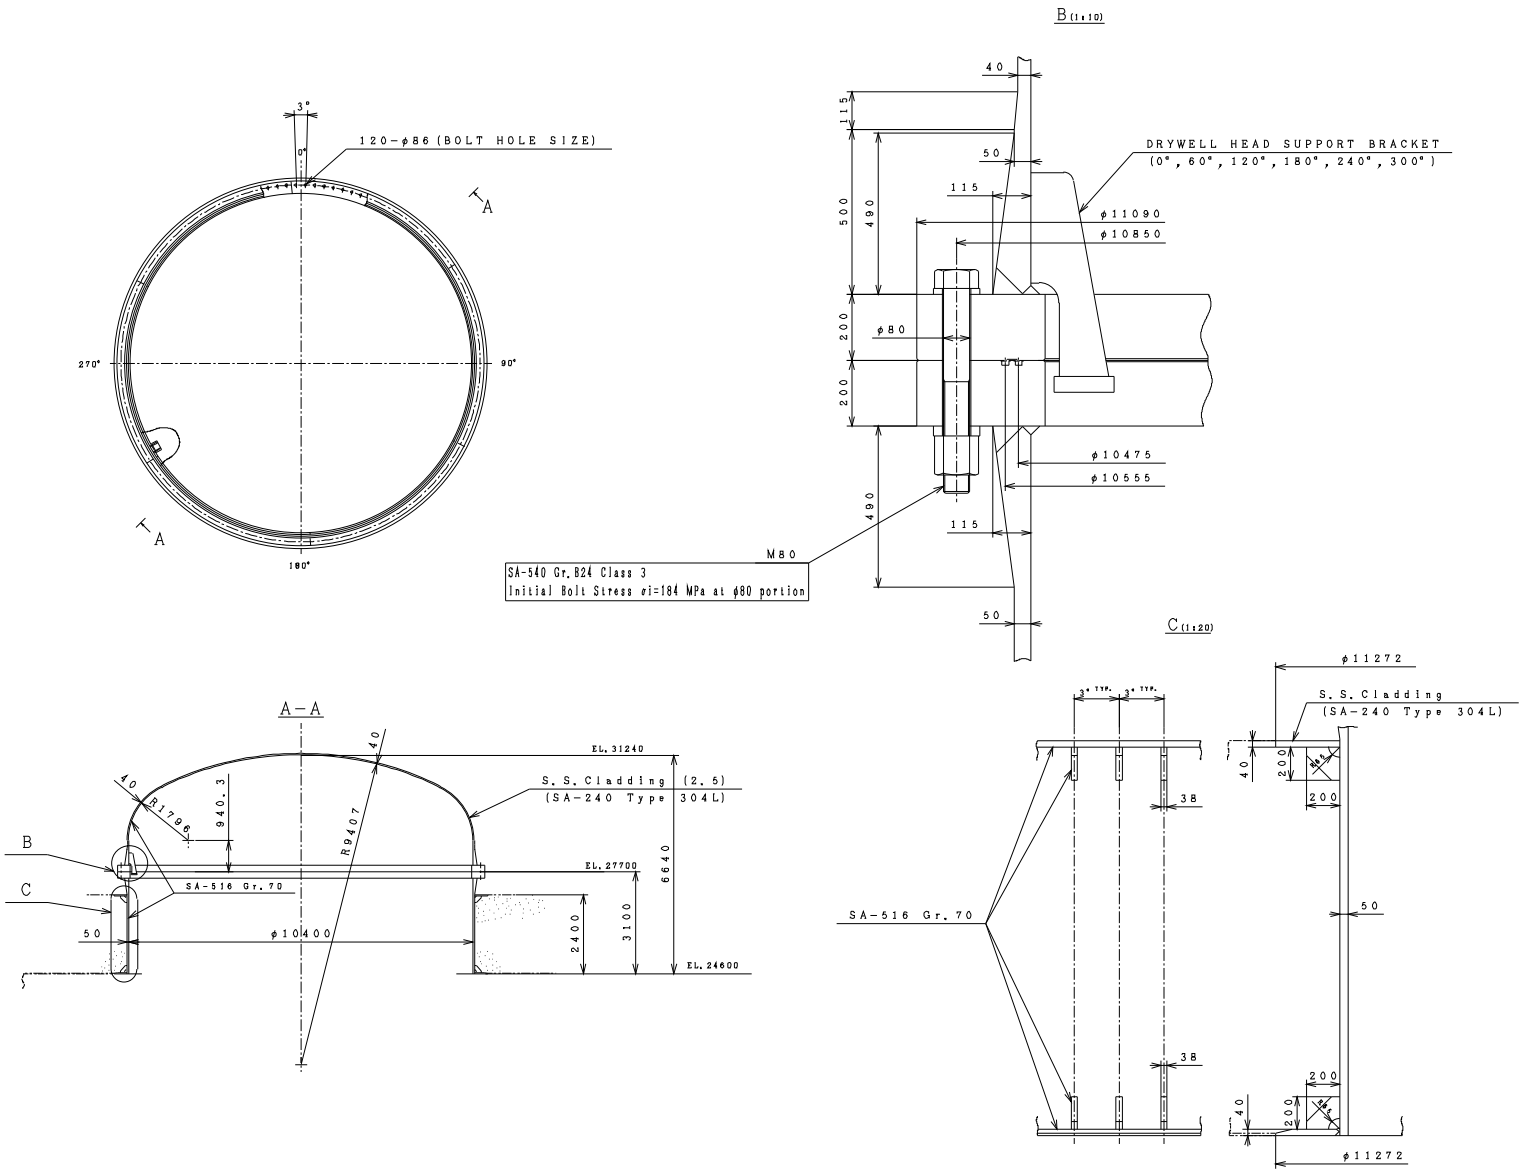

Figure 3G.1-51. Drywell Head

Figure 3G.1-52. Equipment Hatch

Figure 3G.1-53. Wetwell Hatch

Figure 3G.1-54. Personnel Airlock

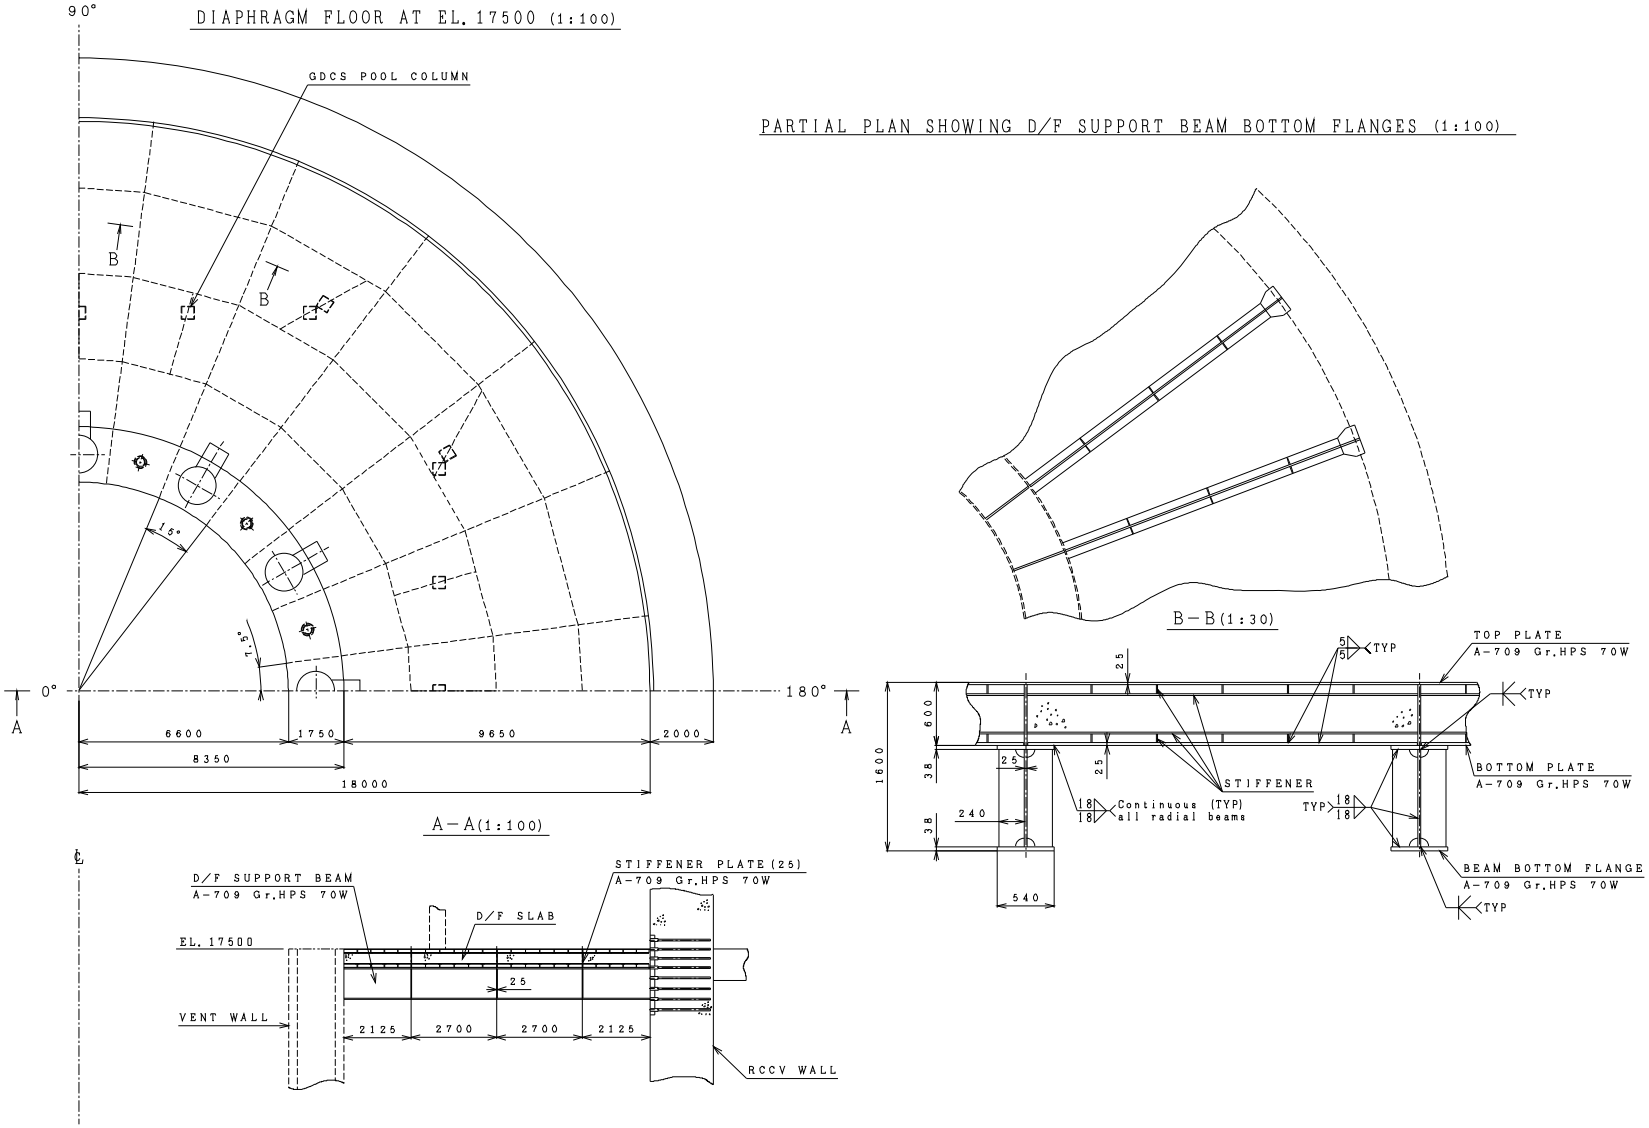

Figure 3G.1-55. Diaphragm Floor

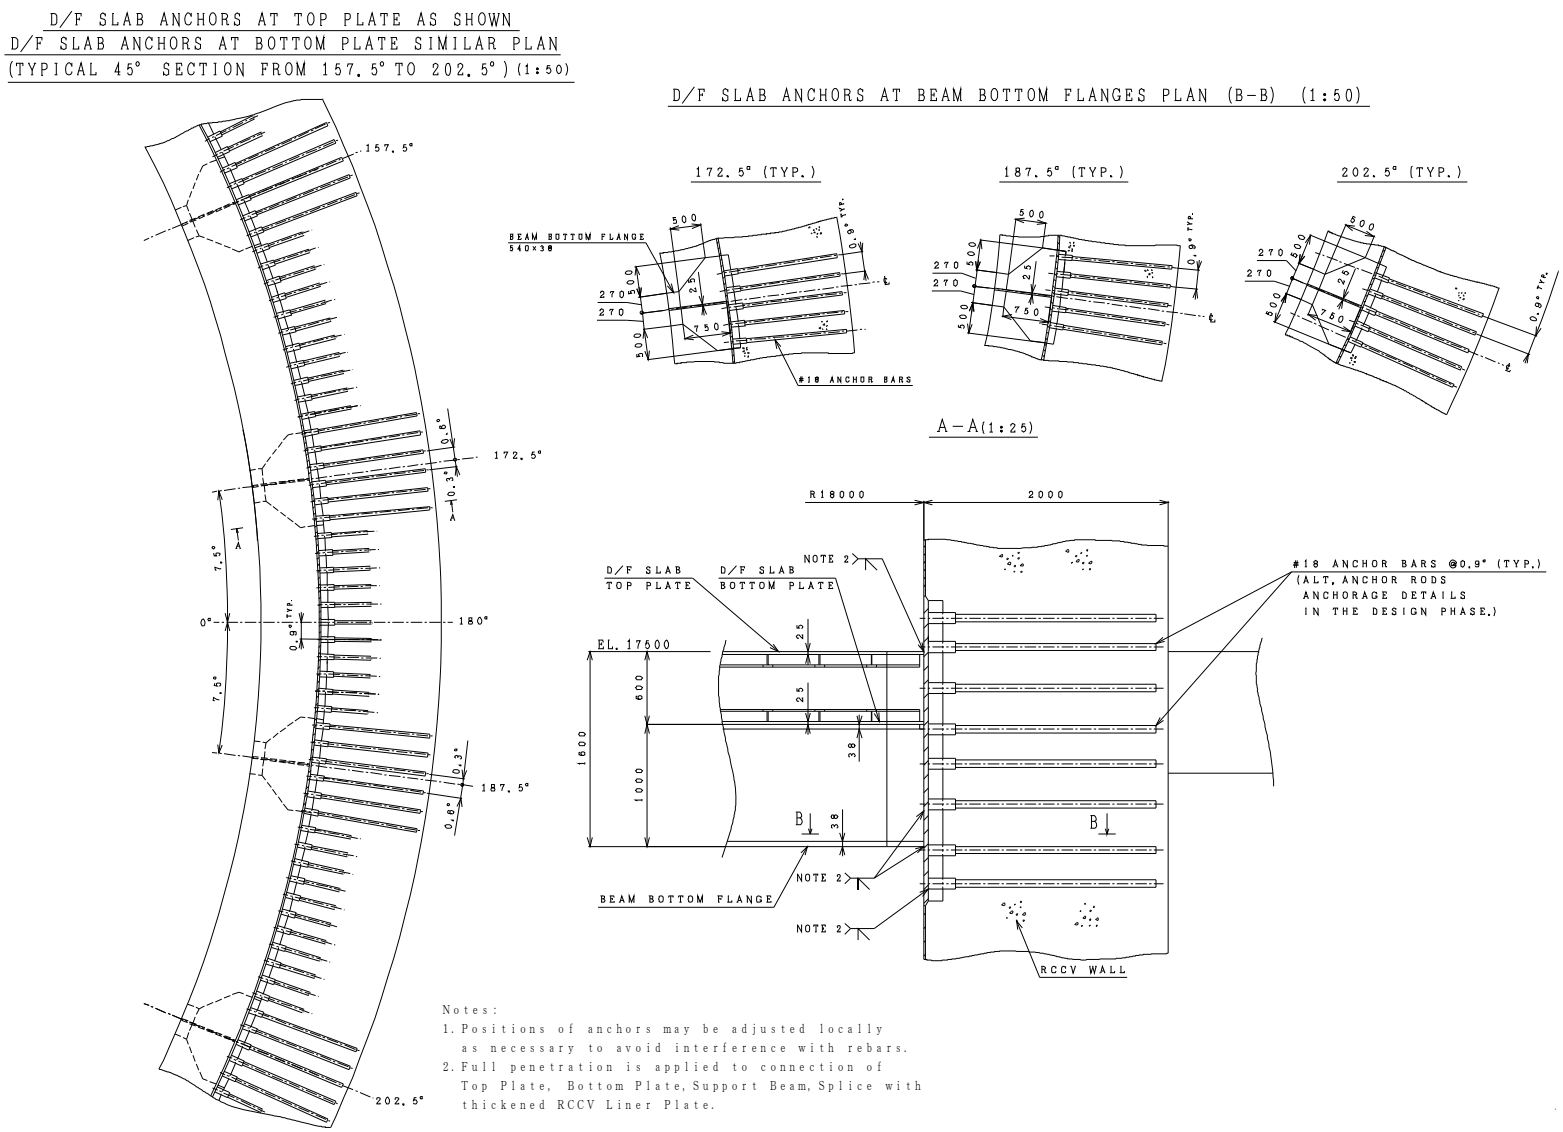

Figure 3G.1-56. Diaphragm Floor Slab Anchor

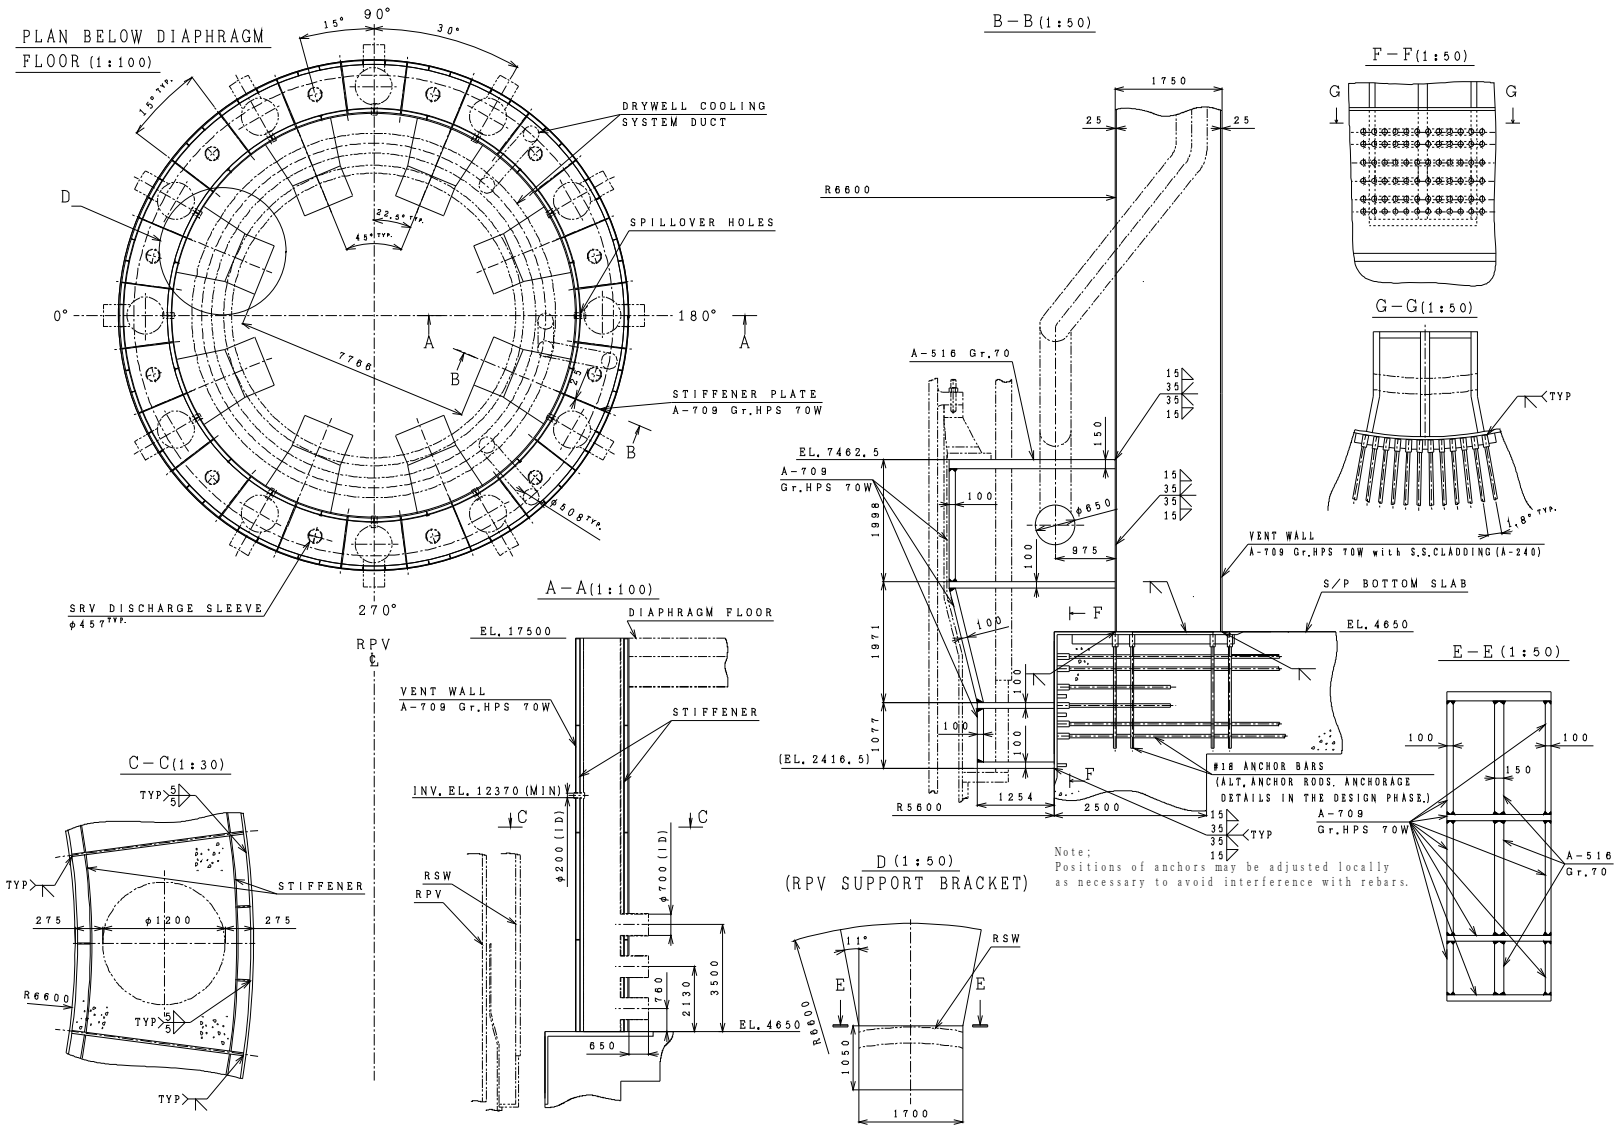

Figure 3G.1-57. RPV Support Bracket & Vent Wall

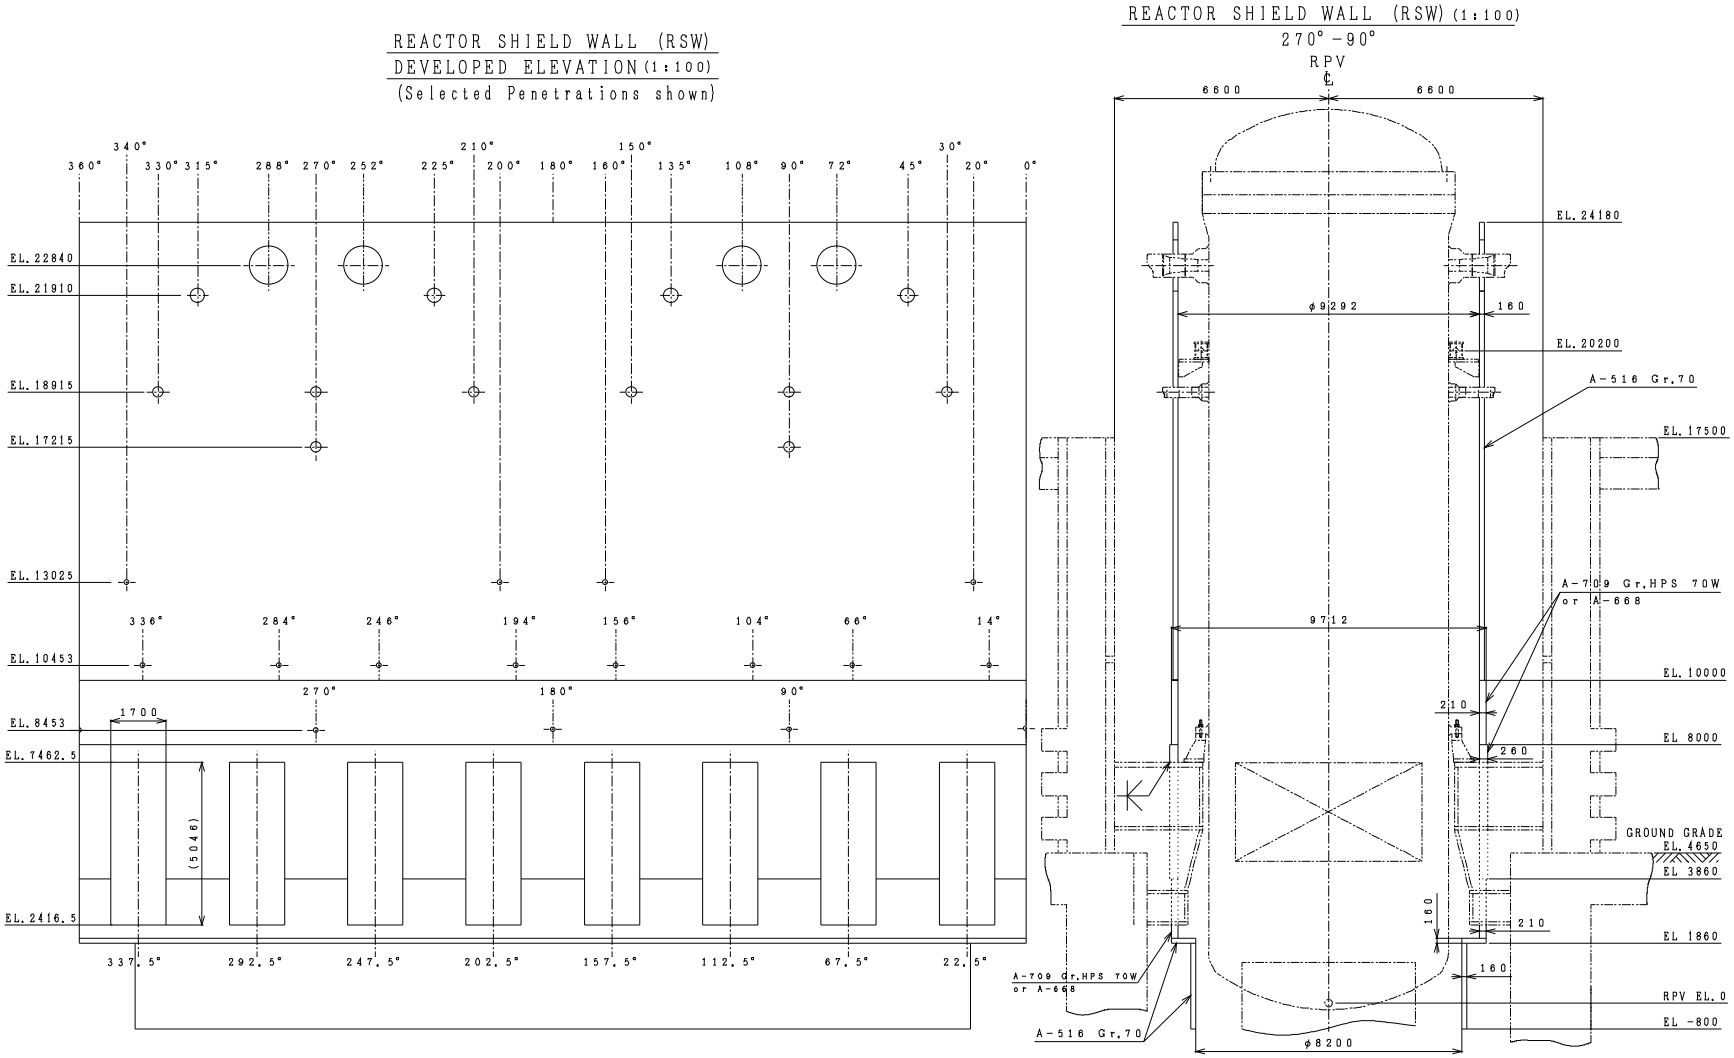

Figure 3G.1-58. Reactor Shield Wall

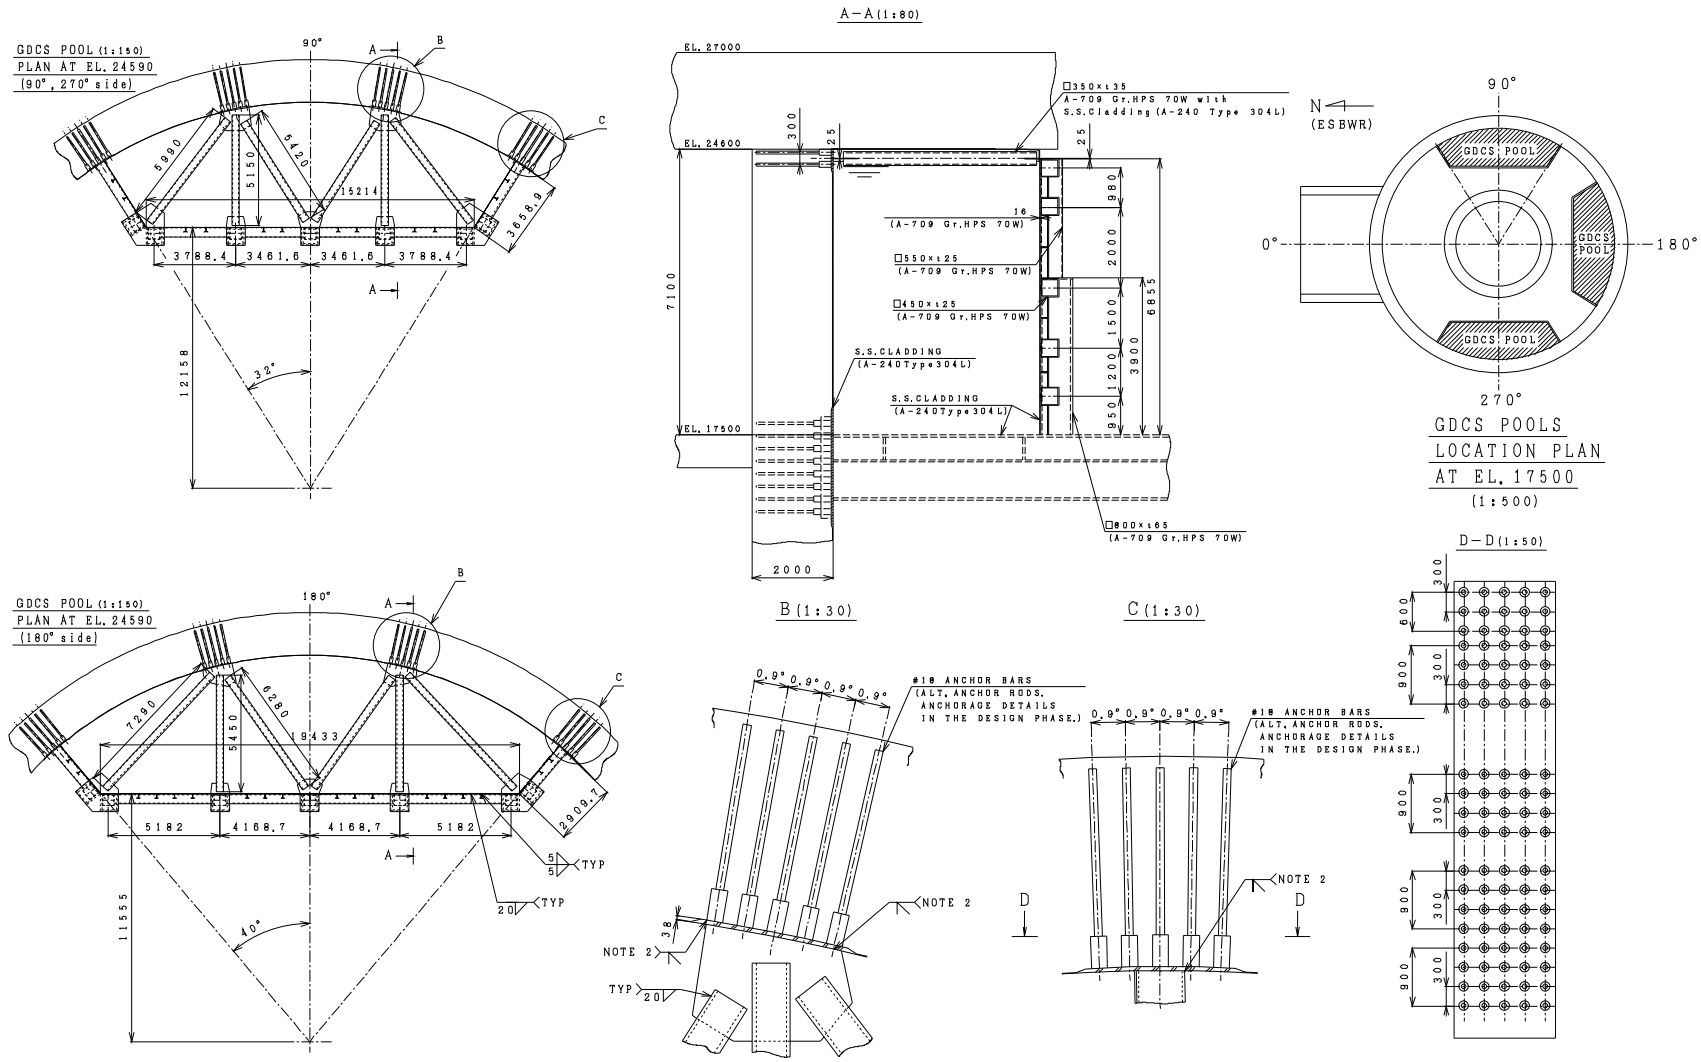

Notes;

1. Positions of anchors may be adjusted locally as necessary to avoid interference with rebars.
2. Full penetration is applied to be connection of Support Beam, Splice with thickened RCCV Liner Plate.

Figure 3G.1-59. GDCS Pool

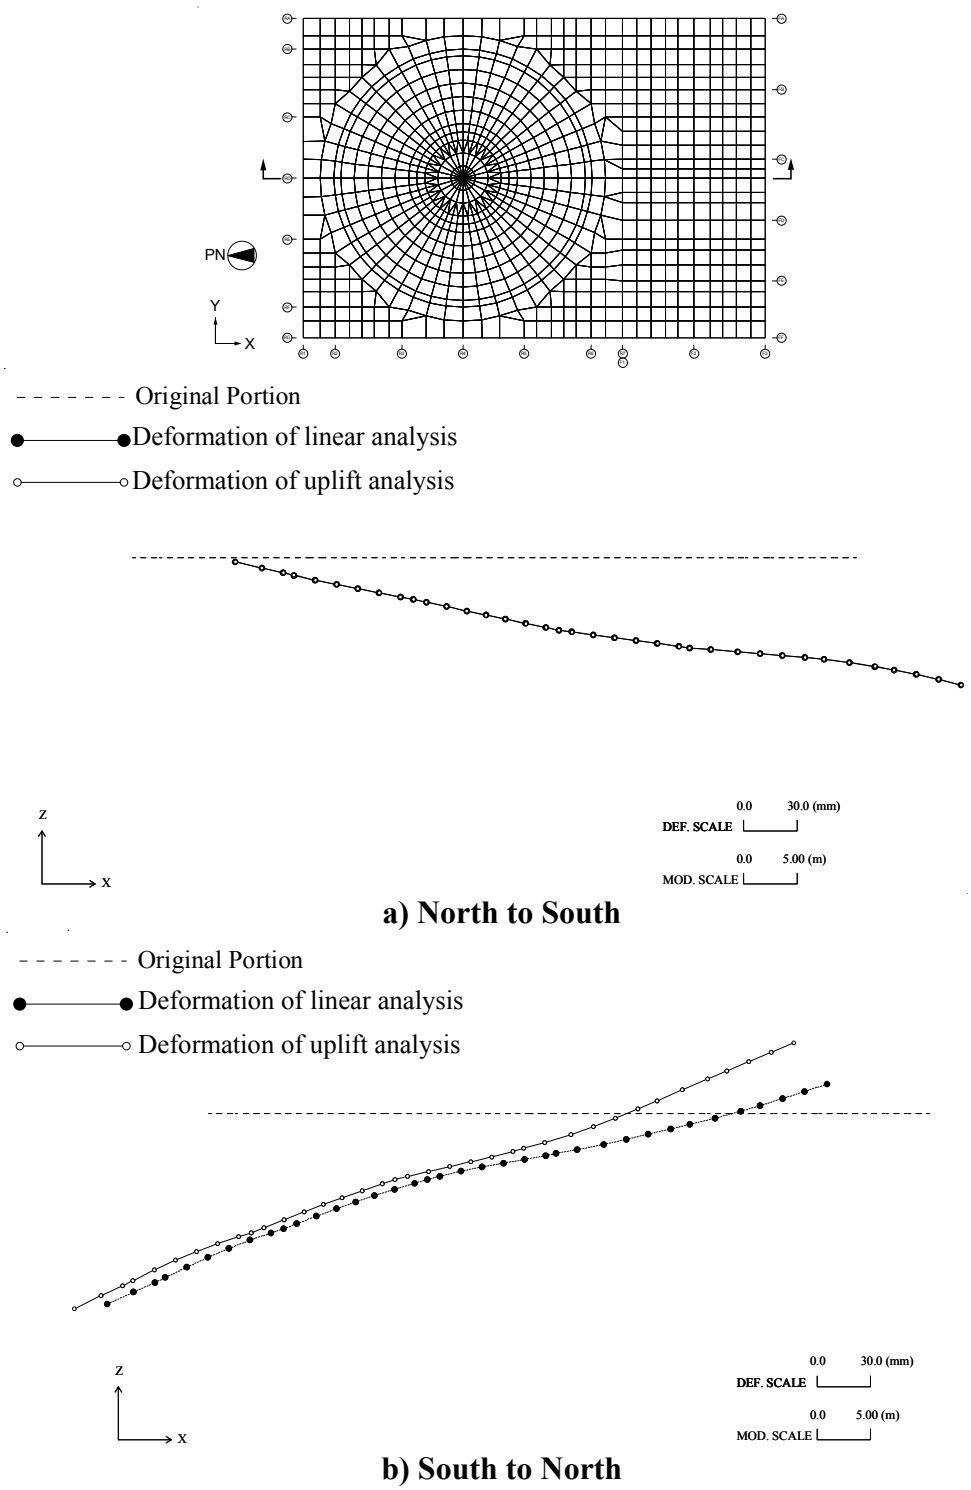

a) North to South

b) South to North

Figure 3G.1-60. Comparison of Basemat Deformation without Tension Springs (NS Direction SSE)

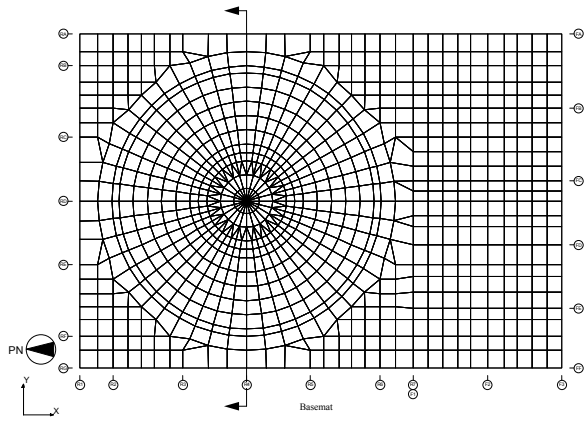

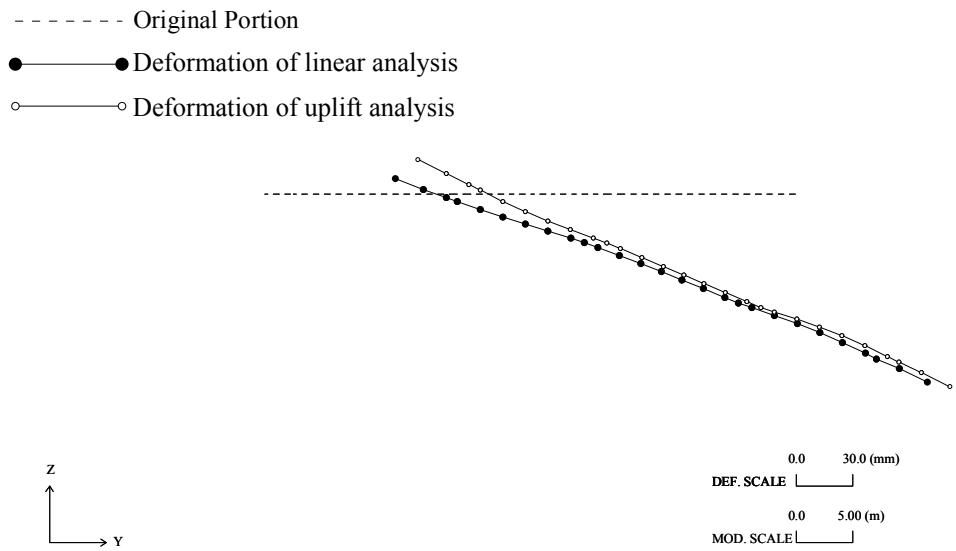

a) West to East

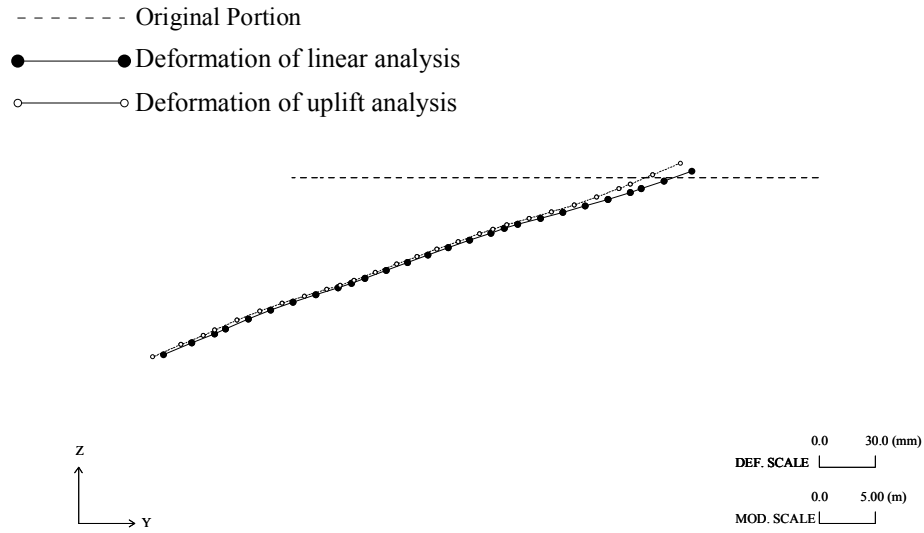

b) East to West

Figure 3G.1-61. Comparison of Basemat Deformation without Tension Springs (EW Direction SSE)

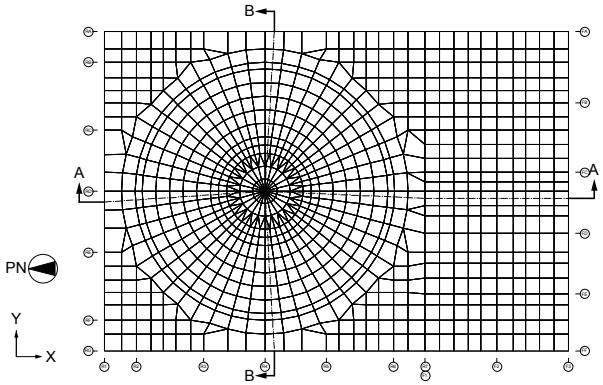

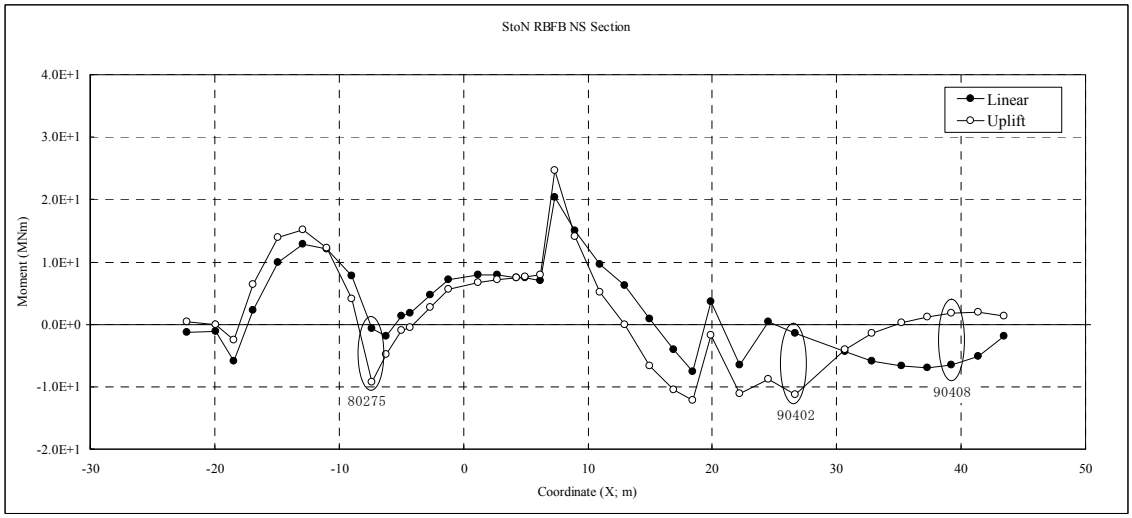

a) Mx in A-A Section

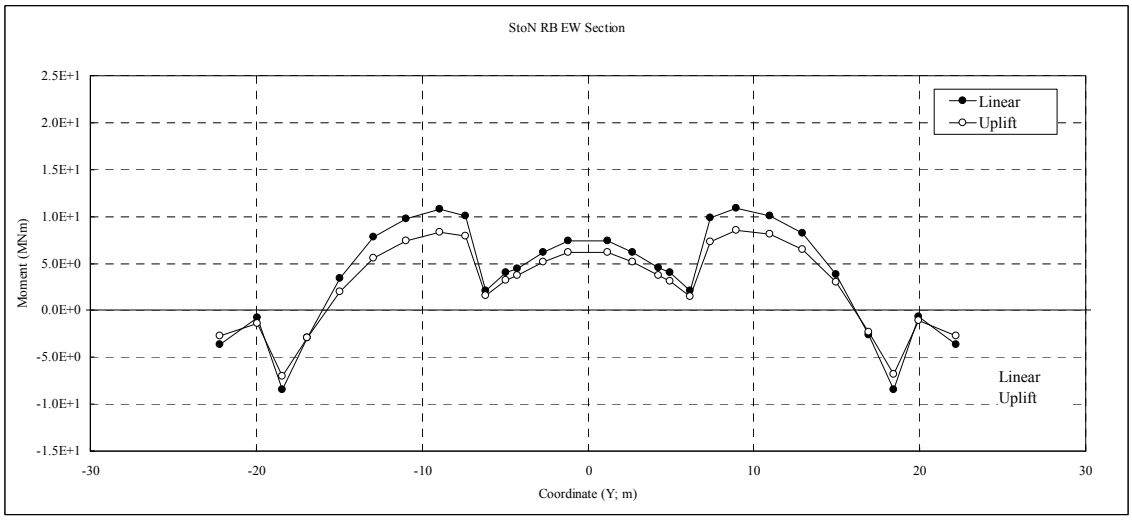

b) My in B-B Section

Figure 3G.1-62. Comparison of Basemat Sectional Moments (S to N SSE)

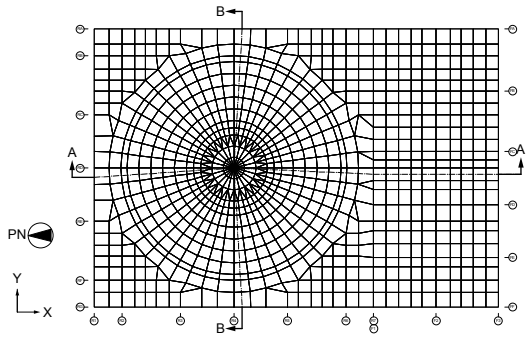

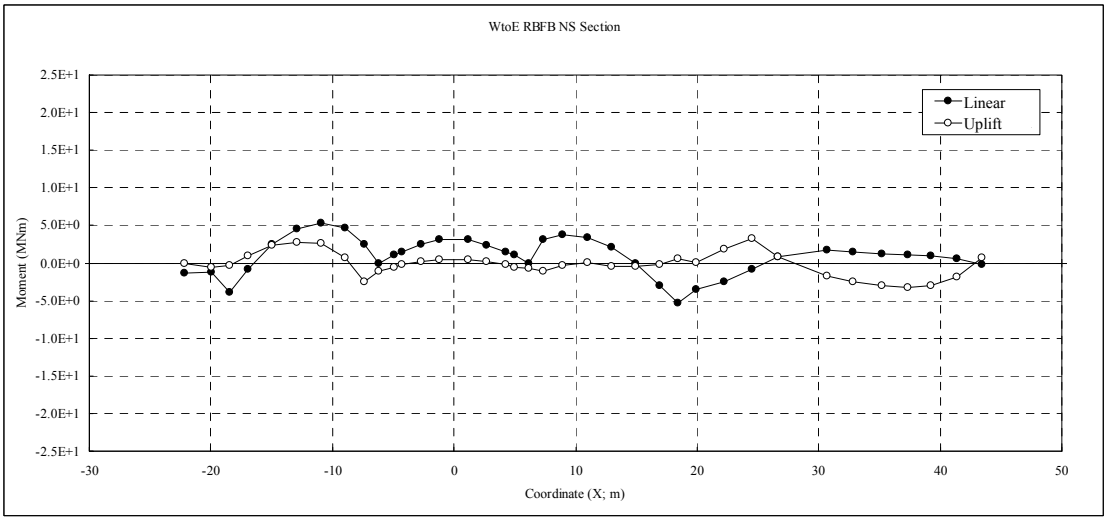

a) Mx in A-A Section

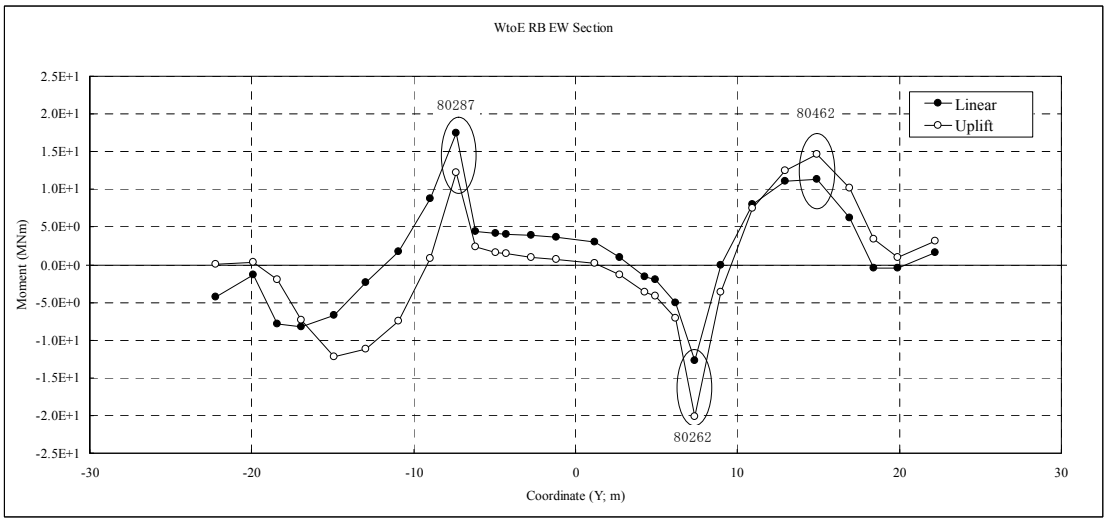

b) My in B-B Section

Figure 3G.1-63. Comparison of Basemat Sectional Moments (W to E SSE)

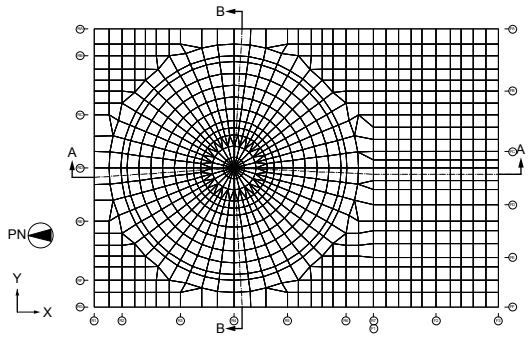

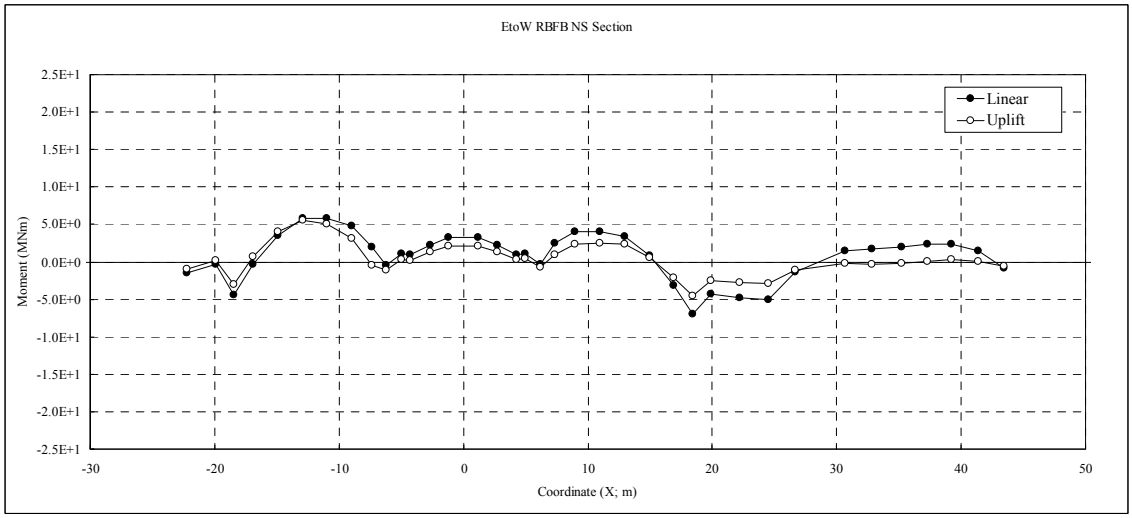

a) Mx in A-A Section

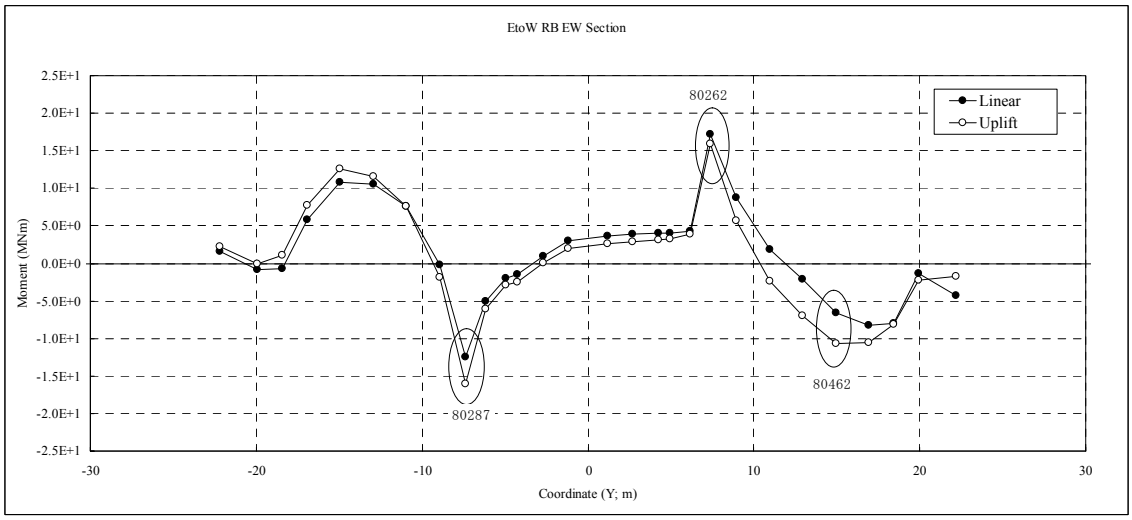

b) My in B-B Section

Figure 3G.1-64. Comparison of Basemat Sectional Moments (E to W SSE)

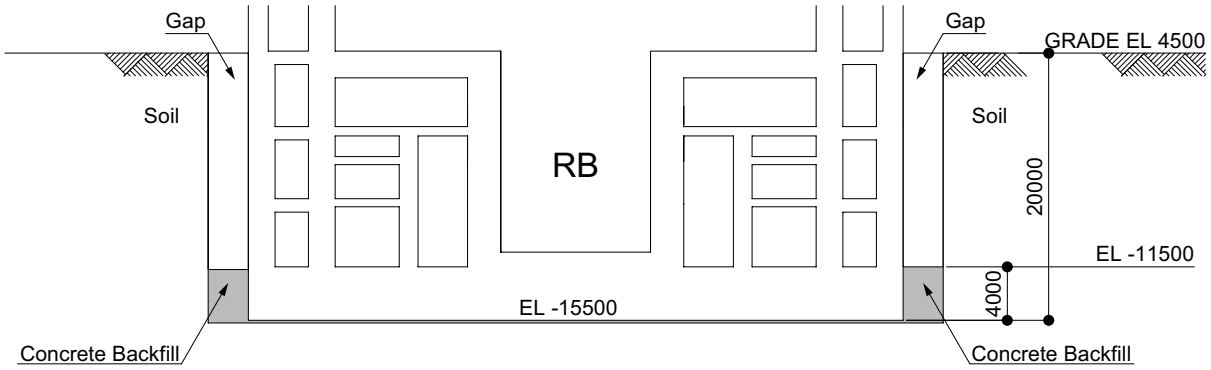

Note: Backfill method for gap and excavation method (e.g., vertical cut, open cut) is determined considering actual site conditions. The gap is completely filled with compacted engineered backfill material.

Figure 3G.1-65. Concrete Backfill in Sliding Evaluation

3G.2 CONTROL BUILDING

3G.2.1 Objective and Scope

The objective of this subsection is to document the structural design details, inputs and analytical results from the analysis of the Control Building (CB) of the standard ESBWR plant. The scope includes the design and analysis of the structure for normal, severe environmental, extreme environmental, and construction loads.

3G.2.2 Conclusions

The following are the major summary conclusions on the design and analysis of the CB.

- Based on the results of finite element analyses performed in accordance with the design conditions identified in Subsection 3G.2.3, stresses in concrete and reinforcement are less than the allowable stresses per the applicable regulations, codes or standards listed in Section 3.8.
- The factors of safety against floatation, sliding, and overturning of the structure under various loading combinations are higher than the required minimum.
- The thickness of the roof slabs and exterior walls are more than the minimum required to preclude penetration, perforation or spalling resulting from impact of design basis tornado missiles.

3G.2.3 Structural Description

The CB houses the safety-related electrical, control and instrumentation equipment, the control room for the Reactor and Turbine Buildings, and the CBHVAC equipment. The CB is a Seismic Category I structure that houses control equipment and operation personnel.

The CB is a reinforced concrete box type shear wall structure consisting of walls and slabs and is supported by a foundation mat. Steel framing is composite with concrete slab and used to support the slabs for vertical loads. The CB is a shear wall structure designed to accommodate all seismic loads with its walls and the connected floors. Therefore, frame members such as beams or columns are designed to accommodate deformations of the walls in case of earthquake conditions. The CB is adjacent to but structurally independent of the Reactor Building (see Figures 1.2-2 through 1.2-5 and Figure 1.2-11).

The key dimensions of the CB are summarized in Table 3.8-8. Figures 3G.2-1 through 3G.2-3 show the outline drawings of the CB.

3G.2.4 Analytical Models

3G.2.4.1 Structural Model

The CB is analyzed utilizing the finite element computer program NASTRAN. The finite element model consists of quadrilateral and beam elements. The quadrilateral elements are used to represent the slabs and walls. Beam elements are used to represent columns and beams. The model is shown in Figures 3G.2-4 to 3G.2-11. The model includes the whole (360°) portion of the CB taking the application of nonaxisymmetrical loads into consideration.

The nodal points are defined by a right hand Cartesian coordinate system X, Y, Z. This system, called the global coordinate system, has its origin located at the north-west corner of the CB at EL 0 mm. The positive X axis is in the south direction; the Y axis is in the east direction; the Z axis is vertical upward. This coordinate system is shown in Figure 3G.2-4.

3G.2.4.2 Foundation Models

The foundation soil is represented by soil springs. The spring constants for rocking and translations are determined based on the following soil parameters which correspond to the Soft Site conditions described in Appendix 3A:

- Shear wave velocity: 300 m/s (1000 ft/s)
- Unit weight: 0.0196 MN/m^3 (125 lbf/ft^3)
- Shear modulus: 180 MN/m^2 (26110 psi)
- Poisson's Ratio: 0.478

Soil springs are attached to the bottom of the foundation mat, and the constraints by side soil are not included in the model. The values of the soil springs used in the analysis are shown in Table 3G.2-1. The springs have perfectly elastic stiffness.

These spring values are multiplied by the foundation mat nodal point tributary areas to compute the spring constants assigned to the base slab nodal points.

3G.2.5 Structural Analysis and Design

3G.2.5.1 Site Design Parameters

The key site design parameters are described in Subsection 3G.1.5.1.

3G.2.5.2 Design Loads, Load Combinations, and Material Properties

3G.2.5.2.1 Design Loads

3G.2.5.2.1.1 Dead Load (D) and Live Load (L and Lo)

The weights of structures are evaluated using the following unit weights.

- reinforced concrete: 23.5 kN/m^3 (150 lbf/ft^3)
- steel: 77.0 kN/m^3 (490 lbf/ft^3)

Weights of major equipment, miscellaneous structures, piping, and commodities are summarized in Tables 3G.2-2 and 3G.2-3.

Live loads on the CB floor and roof slabs are described in Subsection 3.8.4.3.2.

3G.2.5.2.1.2 Snow and Rain Load

The snow and rain load is applied to the roof slab and is taken as shown in Table 3G.1-2. One hundred percent of the snow load is applied when combined with seismic loads.

3G.2.5.2.1.3 Lateral Soil Pressure at Rest

The lateral soil pressure at rest is applied to the external walls below grade and is based on soil properties given in Table 3G.1-2. Pressures to be applied to the walls are provided in Figure 3G.2-12.

3G.2.5.2.1.4 Wind Load (W)

Wind load is applied to the roof slab and external walls above grade and is based on basic wind speed given in Table 3G.1-2.

3G.2.5.2.1.5 Tornado Load (W_t)

The tornado load is applied to the roof slab and external walls above grade and its characteristics are given in Table 3G.1-2. The tornado load, W_t, is further defined by the combinations described in Subsection 3G.1.5.2.1.5.

3G.2.5.2.1.6 Thermal Load (T_o and T_a)

Thermal loads for the CB are evaluated for the normal operating conditions and abnormal (LOCA in combination with a loss of external Alternating Current (AC) power) conditions. Figure 3G.2-13 shows the section location for temperature distributions for various structural elements of the CB, and Table 3G.2-4 shows the magnitude of equivalent linear temperature distribution.

Stress-free temperature is 15.5°C (60°F).

3G.2.5.2.1.7 Design Seismic Loads

The design seismic loads are obtained by soil–structure interaction analyses, which are described in Appendix 3A. The seismic loads used for design are as follows:

- Figure 3G.2-14: design seismic shears and moments
- Table 3G.2-5: maximum vertical acceleration

The seismic loads are composed of two perpendicular horizontal and one vertical components. The effects of the three components are combined based on the 100/40/40 method as described in Subsection 3.8.1.3.6.

Seismic lateral soil pressure for wall design is provided in Figure 3G.2-15 using the enveloped pressure of the elastic procedure described in ASCE 4-98 Section 3.5.3.2 and SASSI results as described in Subsection 3A.8.8.

3G.2.5.2.2 Load Combinations and Acceptance Criteria

Table 3.8-15 gives load combinations for the safety-related reinforced concrete structure. Based on previous experience, critical load combinations are selected for the CB design. They are mainly combinations including LOCA loads and seismic loads as shown in Table 3G.2-6. The acceptance criteria for the selected combinations are also included in Table 3G.2-6.

3G.2.5.2.3 Material Properties

Properties of the materials used for the CB design analyses are the same as those for the RB, and they are described in Subsection 3G.1.5.2.3.

3G.2.5.3 Stability Requirements

The stability requirements for the CB foundation are same as those for the RB, and they are described in Subsection 3G.1.5.3.

3G.2.5.4 Structural Design Evaluation

The evaluation of the Seismic Category I structures in the CB is performed using the same procedure as the RB, which is described in Subsection 3G.1.5.4.

The locations of the sections that are selected for evaluation are indicated in Figures 3G.2-5 through 11. They are selected, in principle, from the center and both ends of wall and slab, where it is reasonably expected that the critical stresses appear based on engineering experience and judgment. Tables 3G.2-7 through 3G.2-11 show the forces and moments at the selected sections from NASTRAN analysis. Element forces and moments listed in the tables are defined with relation to the element coordinate system shown in Figure 3G.2-16. Tables 3G.2-12 through 3G.2-15 show the combined forces and moments in accordance with the selected load combinations listed in Table 3G.2-6.

Table 3G.2-16 lists the sectional thicknesses and rebar ratios used in the evaluation. The values are retrieved from the outline drawings shown in Figures 3G.2-1 through 3G.2-3.

Tables 3G.2-17 through 3G.2-24 show the rebar and concrete stresses at these sections for the representative elements. Table 3G.2-25 summarizes evaluation results for transverse shear in accordance with ACI 349, Chapter 11.

3G.2.5.4.1 Shear Walls

The maximum rebar stress of 338.0 MPa (49.02 ksi) is found in the vertical rebar in the wall at EL -7400 due to the load combination CB-9 as shown in Table 3G.2-24. The maximum horizontal rebar stress is found to be 286.0 MPa (41.48 ksi) also in 2F wall due to the load combination CB-9. The maximum transverse shear force is found to be 1.210 MN/m (6.9 kips/in) against the shear strength of 1.826 MN/m (10.4 kips/in) in the wall at EL -7400.

3G.2.5.4.2 Floor Slabs

The maximum rebar stress of 258.2 MPa (37.45 ksi) is found in the roof at EL 13800 due to the load combination CB-9 as shown in Table 3G.2-23. The maximum transverse shear force is found to be 0.270 MN/m (1.54 kips/in) against the shear strength of 0.734 MN/m (4.19 kips/in).

3G.2.5.4.3 Foundation Mat

The maximum rebar stress is found to be 276.5 MPa (40.10 ksi) due to the load combination CB-9 as shown in Table 3G.2-23. The maximum transverse shear force is found to be 2.094 MN/m (11.96 kips/in) against the shear strength of 4.342 MN/m (24.79 kips/in).

3G.2.5.5 Foundation Stability

The stabilities of the CB foundation against overturning, sliding and floatation are evaluated. The energy approach is used in calculating the factor of safety against overturning.

The factors of safety against overturning, sliding and floatation are given in Table 3G.2-26. All of these meet the acceptance criteria given in Table 3.8-14. In the sliding evaluation the gap between the building and excavated soil is backfilled with concrete up to the top level of the basemat as shown in Figure 3G.2-17.

Maximum soil bearing stress is found to be 292 kPa (6100 psf) due to dead plus live loads. Maximum bearing stresses for load combinations involving SSE are shown in Table 3G.2-27 for various site conditions.

3G.2.5.5.1 Foundation Settlement

The basemat design is checked against the normal and differential settlement of the CB. It is found that the basemat can resist the maximum settlement at mat foundation corner of 18 mm (0.7 in.) and the settlement averaged at four corners of 12 mm (0.5 in.). The relative displacement between two corners along the longest dimension of the building basemat calculated under linearly varying soil stiffness is 14 mm (0.6 in). The estimated differential settlement between buildings (RB/FB and CB) is 85 mm (3.3 in.). These values are specified as maximum settlements in Table 2.0-1.

3G.2.5.6 Tornado Missile Evaluation

The CB is shown in Figure 3G.2-3. The minimum thickness required to prevent penetration, concrete spalling and scabbing is evaluated. The methods and procedures are shown in Subsection 3.5.3.1.1.

Table 3G.2-1

Soil Spring Constants for the CB Analysis Model

Direction of Spring		Loads	Stiffness ($MN/m/m^2$)
Horizontal	X-direction	All	19.650
	Y-direction	All	20.378
Vertical		Horizontal Seismic Loads	79.174
		Other Loads	29.177

Table 3G.2-2

Equipment Load of CB

Description	Weight	Remarks
Division DCIS Room	216 kN	per one room
MCR Display Consoles	230 kN	
Nonsafety-related DCIS Room	490 kN	per one room
HVAC Units	1079 kN	total

Table 3G.2-3

Miscellaneous Structures, Piping, and Commodity Load of CB

Elevation (mm)	Area Load
13,800	2.4 kN/m^2 (50psf)
9,060	2.4 kN/m^2 (50psf)
4,650	2.4 kN/m^2 (50psf)
-2,000	2.4 kN/m^2 (50psf)
-7,400	2.4 kN/m^2 (50psf)

Table 3G.2-4

Equivalent Liner Temperature Distributions at Various Sections

Section*1	Side*2		Equivalent Linear Temperature*3 (°C)			
			Normal Operation Winter		DBA Winter	
	1	2	T_d	T_g	T_d	T_g
M1	DCIS	GR	18.1	5.1	31.5	32.0
W1	DCIS	GR	17.7	4.4	29.2	27.4
W2	MCR	GR	17.7	4.4	21.3	11.5
W3	DCIS	AT	-14.5	46.8	-2.4	69.0
W4	HVAC	AT	-20.0	36.0	-7.9	57.5
S1	MCR	DCIS	21.0	0.0	40.0	-10.3
S2	DCIS	MCR	21.0	0.0	40.0	10.3
S3	HVAC	DCIS	15.5	-5.7	45.0	-5.2
S4	AT	HVAC	-20.0	-36.0	-7.9	-57.5

Note *1: See Figure 3G.2-13 for the location of sections.

Note *2: MCR: Main Control Room
DCIS: Distributed Control and Information System
HVAC: Heating, Ventilation and Air Conditioning
AT: Air
GR: Ground

Note *3: T_d: Average Temperature
T_g: Surface Temperature Difference (positive when temperature at Side 1 is higher)

Table 3G.2-5

Maximum Vertical Acceleration

Walls			Slabs		
Elev. (m)	Node No.	Max. Vertical Acceleration (g)	Elev. (m)	Node No.	Max. Vertical Acceleration (g)
13.80	6	1.00	13.80	9001	2.19
9.06	5	0.86		9002	1.34
4.65	4	0.74		9003	1.43
-2.00	3	0.56	9.06	9101	2.00
-7.40	2	0.51		9102	1.26
-10.40	1	0.51		9103	1.43
			4.65	9201	1.30
				92.02	1.43
			-2.00	9301	1.39

See Figure 3A.7-6 for the node numbers.

Table 3G.2-6

Selected Load Combinations for the CB

Category	Load Combination								Acceptance Criteria*1
	No. *2	D	L	T_o	T_a	E'	W	W_t	
Severe	CB-3	1.4	1.7				1.7		U
Environmental	CB-4	1.05	1.3	1.3			1.3		U
Tornado	CB-7	1.0	1.0	1.0				1.0	U
LOCA + SSE	CB-9	1.0	1.0		1.0	1.0			U

*1: U = Required section strength based on the strength design method per ACI 349

*2: Based on Table 3.8-15.

Table 3G.2-7

Results of NASTRAN Analysis: Dead Load

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL-7.4m	67	0.025	-0.694	0.026	-0.903	-1.046	0.082	0.184	-0.145
	72	-0.053	0.061	0.012	-0.415	-0.221	-0.026	-0.585	0.037
	115	-0.714	-0.265	0.299	-0.214	-0.191	-0.348	-0.032	-0.627
	120	-0.055	-0.024	-0.150	-0.095	-0.152	0.639	-0.026	-0.011
Slab B1F EL-2.0m	567	-0.007	0.684	-0.039	-0.043	-0.019	-0.005	-0.062	0.018
	572	0.078	0.115	-0.011	-0.016	-0.013	0.006	0.082	-0.004
	615	0.159	0.125	-0.239	-0.028	-0.002	0.020	-0.035	-0.003
	620	0.037	0.040	0.052	-0.018	-0.019	-0.023	0.028	0.031
Slab 1F EL4.65m	1067	0.068	0.026	-0.002	0.182	0.072	-0.012	0.027	0.019
	1072	-0.012	0.030	0.002	-0.026	-0.008	0.000	0.063	0.006
	1115	0.104	0.006	0.009	-0.015	-0.149	-0.009	0.000	0.134
	1120	0.018	0.014	0.051	-0.015	-0.013	-0.013	0.016	0.022
Slab 2F EL9.06m	1567	0.014	0.055	-0.002	0.070	0.003	-0.004	0.014	0.008
	1572	0.017	-0.006	0.000	-0.027	-0.010	0.000	0.054	0.000
	1615	0.128	0.105	-0.022	-0.007	-0.103	-0.006	0.006	0.111
	1620	0.014	0.009	0.017	-0.013	-0.013	-0.012	0.014	0.019
Slab RF EL13.8m	1867	-0.072	-0.047	0.002	0.143	0.044	-0.008	0.021	0.001
	1872	-0.030	-0.098	0.001	-0.026	-0.013	0.007	0.052	0.001
	1915	-0.060	-0.096	-0.002	-0.005	-0.116	-0.007	-0.002	0.120
	1920	-0.008	-0.040	0.012	-0.016	-0.014	-0.034	0.014	0.018
Wall EL-7.4m ~EL-2.0m	6007	-0.252	-0.707	-0.216	-0.013	0.094	-0.005	-0.056	0.069
	4006	0.032	-0.859	0.017	-0.035	-0.182	0.000	-0.001	-0.047
	4010	0.065	-0.187	-0.107	0.014	-0.070	-0.006	-0.031	-0.040
Wall EL-2.0m ~EL4.65m	6043	0.163	-1.208	-0.276	0.039	0.027	0.006	0.041	0.002
	4036	0.066	-0.582	-0.005	0.019	0.103	-0.001	-0.002	0.032
	4040	-0.015	-0.334	0.044	-0.004	0.024	0.012	0.017	0.018
Wall EL4.65m ~EL9.06m	6081	0.008	-0.551	-0.033	-0.013	-0.111	-0.007	0.000	-0.056
	4066	-0.011	-0.317	0.004	0.004	0.018	-0.003	-0.003	0.015
	4070	-0.016	-0.246	0.090	-0.003	0.006	0.001	0.005	0.007
Wall EL9.06m ~EL13.8m	6117	0.001	-0.307	-0.052	-0.007	-0.051	0.004	0.005	-0.070
	4096	-0.064	-0.154	0.001	0.006	0.029	0.000	-0.002	0.034
	4100	-0.008	-0.107	0.078	0.003	0.007	-0.001	-0.001	0.009

Table 3G.2-8

Results of NASTRAN Analysis: Thermal Load (LOCA: Winter)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL-7.4m	67	-0.410	-1.284	0.167	6.777	6.386	-0.129	0.288	-0.110
	72	-0.190	-0.285	0.059	1.918	5.859	-0.011	0.285	0.127
	115	-0.190	-0.082	0.188	6.663	2.333	-0.257	0.534	0.937
	120	-0.948	-1.036	-0.270	3.316	3.332	1.783	1.353	1.269
Slab B1F EL-2.0m	567	-0.722	0.440	0.044	-0.078	-0.090	0.002	-0.004	0.006
	572	0.333	-0.748	-0.056	-0.031	-0.063	0.003	-0.022	0.000
	615	-0.855	0.670	-0.731	-0.078	-0.034	0.006	-0.032	-0.075
	620	-0.969	-0.965	-1.404	-0.066	-0.065	0.009	0.007	0.005
Slab 1F EL4.65m	1067	-1.333	-0.474	-0.007	0.065	0.030	0.000	0.004	-0.003
	1072	-0.170	-1.779	-0.096	0.183	0.081	0.007	-0.061	-0.001
	1115	-1.421	0.048	0.018	0.065	0.112	0.002	-0.008	-0.016
	1120	-1.988	-1.963	-2.415	0.130	0.129	-0.007	-0.033	-0.031
Slab 2F EL9.06m	1567	-2.556	-1.079	0.015	-0.027	-0.087	0.002	0.004	0.000
	1572	-0.679	-3.422	-0.099	0.070	-0.022	0.009	-0.099	0.006
	1615	-2.435	0.083	-0.112	0.044	0.193	-0.031	0.036	-0.087
	1620	-3.154	-3.134	-4.156	-0.051	-0.057	0.025	0.020	0.029
Slab RF EL13.8m	1867	1.487	1.030	-0.009	-0.782	-1.031	0.001	0.017	-0.006
	1872	1.593	1.268	0.355	-0.221	-0.741	0.036	-0.311	0.019
	1915	1.851	0.825	0.347	-0.692	-0.390	0.009	0.012	-0.121
	1920	-0.001	-0.168	0.488	-0.636	-0.644	-0.024	-0.012	0.006
Wall EL-7.4m ~EL-2.0m	6007	0.524	1.364	-0.056	0.642	0.904	0.004	-0.032	0.165
	4006	0.758	-0.076	0.091	-0.688	-1.071	-0.001	-0.001	-0.195
	4010	1.043	1.256	-0.326	-0.530	-0.881	-0.042	-0.156	-0.334
Wall EL-2.0m ~EL4.65m	6043	2.537	-1.179	-0.671	0.380	0.488	-0.027	0.132	0.063
	4036	2.469	-0.418	-0.013	-0.288	-0.299	0.000	0.031	0.070
	4040	1.383	1.398	-0.607	-0.080	-0.300	-0.047	-0.217	-0.181
Wall EL4.65m ~EL9.06m	6081	5.514	-0.799	0.343	1.391	0.998	0.007	-0.048	-0.163
	4066	6.360	-0.476	-0.041	-1.488	-1.021	0.000	-0.021	0.188
	4070	3.597	1.334	-1.486	-1.232	-1.168	-0.021	-0.332	-0.163
Wall EL9.06m ~EL13.8m	6117	3.544	-0.629	-1.506	0.909	1.507	-0.023	-0.037	0.383
	4096	3.967	-0.304	-0.182	-0.936	-1.569	0.000	0.034	-0.461
	4100	2.846	1.764	-1.528	-0.680	-1.227	-0.002	-0.347	-0.594

Table 3G.2-9

Results of NASTRAN Analysis: Seismic Load (Horizontal: North to South Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL-7.4m	67	-0.155	-0.143	0.233	-0.513	-0.371	-0.268	0.860	-0.028
	72	-0.182	-3.721	0.007	-2.010	-1.593	0.052	-1.590	0.017
	115	-0.170	-0.077	2.425	0.102	0.016	-2.589	1.271	-0.178
	120	0.089	-0.838	0.274	-0.843	-0.343	0.472	0.143	-0.893
Slab B1F EL-2.0m	567	0.030	-0.010	0.020	0.070	0.000	-0.014	0.023	-0.015
	572	0.279	0.227	-0.049	-0.007	-0.007	-0.001	-0.004	0.003
	615	-0.022	0.004	-0.302	0.042	0.001	0.010	0.039	0.009
	620	0.226	0.087	-0.196	-0.015	0.018	0.001	0.018	-0.021
Slab 1F EL4.65m	1067	0.032	-0.019	0.027	-0.005	-0.005	-0.003	0.008	-0.001
	1072	0.220	0.276	-0.047	0.016	-0.003	0.001	-0.012	0.001
	1115	0.018	-0.009	-0.262	-0.006	0.003	-0.004	0.002	-0.001
	1120	0.140	0.057	-0.075	-0.008	0.012	0.002	0.012	-0.014
Slab 2F EL9.06m	1567	0.029	-0.033	0.017	-0.005	-0.005	-0.003	0.010	-0.001
	1572	0.160	0.325	-0.027	0.016	-0.003	0.001	-0.018	0.002
	1615	-0.326	-0.062	0.017	-0.011	0.002	-0.003	0.005	0.000
	1620	0.092	0.070	-0.097	-0.007	0.011	0.002	0.011	-0.012
Slab RF EL13.8m	1867	0.043	0.020	-0.008	-0.013	-0.012	-0.007	0.019	-0.001
	1872	0.343	0.743	0.023	0.030	-0.011	0.004	-0.031	0.003
	1915	0.097	0.019	-0.352	-0.008	0.005	-0.014	0.000	-0.001
	1920	0.131	0.164	0.003	-0.006	0.013	0.006	0.012	-0.011
Wall EL-7.4m ~EL-2.0m	6007	0.128	-0.241	2.678	-0.072	0.043	-0.015	-0.090	0.039
	4006	-0.916	-2.388	-0.034	0.015	0.063	-0.002	0.001	0.047
	4010	-0.184	-0.785	-0.808	0.043	0.042	-0.025	0.017	0.014
Wall EL-2.0m ~EL4.65m	6043	0.012	-0.043	1.835	-0.003	-0.015	0.012	0.006	-0.004
	4036	0.138	-1.782	-0.107	-0.025	-0.097	-0.001	-0.006	-0.027
	4040	0.035	-0.613	-1.095	0.003	-0.034	-0.013	-0.032	-0.033
Wall EL4.65m ~EL9.06m	6081	0.432	-0.261	1.028	0.005	0.030	-0.003	0.000	0.017
	4066	0.441	-0.800	-0.108	-0.006	0.013	0.001	-0.004	0.005
	4070	0.077	-0.425	-0.868	0.002	0.005	-0.001	-0.010	-0.005
Wall EL9.06m ~EL13.8m	6117	-0.267	0.067	0.567	0.000	0.006	0.001	-0.001	0.013
	4096	0.533	-0.337	-0.079	-0.008	-0.027	0.001	-0.002	-0.024
	4100	0.098	-0.253	-0.560	-0.002	-0.005	-0.002	-0.009	-0.007

Table 3G.2-10

Results of NASTRAN Analysis: Seismic Load (Horizontal: East to West Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL-7.4m	67	-0.148	0.283	-0.555	-0.602	-2.010	-0.036	-0.689	2.642
	72	-0.033	0.005	2.066	-0.075	-0.214	-2.320	-0.154	0.941
	115	-3.308	-0.365	-0.116	-0.200	-0.849	-0.142	0.459	-0.753
	120	-0.807	0.212	0.188	-0.323	-0.775	0.190	-1.080	0.056
Slab B1F EL-2.0m	567	-0.009	-0.033	0.517	-0.027	-0.077	-0.018	-0.019	0.138
	572	0.012	0.011	0.298	0.001	0.000	-0.001	-0.001	-0.002
	615	-0.254	0.268	0.419	-0.008	-0.028	-0.001	0.002	0.016
	620	0.077	0.148	0.266	0.016	-0.020	-0.002	-0.023	0.022
Slab 1F EL4.65m	1067	0.005	0.020	-0.026	-0.002	-0.001	-0.002	0.000	0.000
	1072	0.002	0.007	-0.281	0.000	0.000	-0.002	0.000	-0.002
	1115	0.323	0.160	0.000	-0.014	-0.040	0.000	-0.002	0.015
	1120	0.057	0.121	-0.150	0.011	-0.019	0.000	-0.019	0.019
Slab 2F EL9.06m	1567	0.015	0.038	-0.040	-0.001	0.000	-0.001	0.000	0.000
	1572	0.004	0.004	-0.370	0.000	0.000	-0.002	0.000	-0.001
	1615	0.727	0.224	0.036	-0.002	-0.015	0.001	0.005	0.006
	1620	0.082	0.118	-0.166	0.009	-0.013	-0.001	-0.015	0.014
Slab RF EL13.8m	1867	0.053	0.029	-0.058	-0.002	0.001	-0.001	0.000	0.002
	1872	0.004	-0.003	-0.478	0.000	0.000	-0.006	0.000	-0.004
	1915	1.144	0.274	-0.004	-0.009	-0.029	0.001	0.001	0.006
	1920	0.207	0.077	-0.038	0.008	-0.015	-0.005	-0.016	0.012
Wall EL-7.4m ~EL-2.0m	6007	-1.287	-1.357	0.050	-0.025	-0.006	-0.006	-0.007	0.030
	4006	0.066	-0.182	2.153	-0.009	-0.028	0.018	0.010	-0.011
	4010	0.213	-1.042	0.804	-0.043	-0.132	0.007	-0.048	-0.058
Wall EL-2.0m ~EL4.65m	6043	-0.619	-1.110	-0.069	-0.077	-0.156	0.010	-0.043	-0.073
	4036	0.026	-0.098	1.954	0.000	0.003	-0.006	-0.008	0.001
	4040	0.004	-0.934	1.376	-0.012	0.009	0.021	0.019	0.016
Wall EL4.65m ~EL9.06m	6081	0.289	-0.800	-0.369	0.016	0.065	0.014	0.008	0.006
	4066	0.005	-0.045	1.306	0.000	-0.001	0.005	0.001	-0.001
	4070	0.047	-0.307	1.040	0.019	-0.009	0.008	-0.007	-0.014
Wall EL9.06m ~EL13.8m	6117	0.652	-0.430	-0.425	0.005	0.001	0.000	0.002	-0.011
	4096	-0.006	-0.024	0.678	0.001	0.001	0.001	0.000	0.000
	4100	0.003	-0.173	0.560	0.012	-0.003	0.005	-0.001	-0.014

Table 3G.2-11

Results of NASTRAN Analysis: Seismic Load (Vertical: Upward Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL-7.4m	67	-0.024	0.570	-0.020	0.935	0.842	-0.078	-0.106	0.111
	72	0.040	-0.070	-0.012	0.352	0.134	0.039	0.464	-0.027
	115	0.598	0.226	-0.249	0.207	0.173	0.281	0.030	0.546
	120	0.046	0.022	0.120	0.080	0.139	-0.511	0.031	0.028
Slab B1F EL-2.0m	567	0.001	-0.565	0.032	0.039	0.014	0.004	0.047	-0.014
	572	-0.064	-0.097	0.009	0.017	0.009	-0.004	-0.060	0.003
	615	-0.140	-0.110	0.198	0.021	0.000	-0.015	0.026	0.006
	620	-0.034	-0.035	-0.048	0.013	0.013	0.016	-0.019	-0.021
Slab 1F EL4.65m	1067	-0.072	-0.037	0.003	-0.164	-0.069	0.011	-0.024	-0.016
	1072	0.003	-0.036	-0.002	0.034	0.008	0.001	-0.063	-0.006
	1115	-0.104	-0.028	-0.011	0.015	0.142	0.008	0.000	-0.125
	1120	-0.020	-0.016	-0.049	0.014	0.013	0.013	-0.015	-0.020
Slab 2F EL9.06m	1567	-0.038	-0.065	0.004	-0.080	-0.007	0.005	-0.016	-0.009
	1572	-0.024	-0.008	0.001	0.040	0.012	0.000	-0.069	0.000
	1615	-0.133	-0.113	0.016	0.009	0.125	0.006	-0.006	-0.129
	1620	-0.019	-0.015	-0.005	0.016	0.016	0.013	-0.017	-0.022
Slab RF EL13.8m	1867	0.102	0.080	-0.003	-0.219	-0.066	0.011	-0.032	-0.002
	1872	0.042	0.105	-0.003	0.037	0.021	-0.009	-0.080	-0.001
	1915	0.105	0.139	0.003	0.008	0.174	0.011	0.004	-0.182
	1920	0.021	0.049	-0.015	0.025	0.021	0.052	-0.022	-0.027
Wall EL-7.4m ~EL-2.0m	6007	0.207	0.621	0.184	0.010	-0.077	0.004	0.046	-0.058
	4006	-0.018	0.707	-0.018	0.026	0.141	0.000	0.001	0.037
	4010	-0.053	0.179	0.088	-0.011	0.057	0.004	0.025	0.033
Wall EL-2.0m ~EL4.65m	6043	-0.136	1.097	0.234	-0.033	-0.024	-0.005	-0.034	0.000
	4036	-0.051	0.539	0.001	-0.015	-0.081	0.001	0.002	-0.027
	4040	0.014	0.328	-0.039	0.003	-0.018	-0.008	-0.013	-0.015
Wall EL4.65m ~EL9.06m	6081	-0.004	0.600	-0.001	0.017	0.107	0.004	0.001	0.056
	4066	0.006	0.347	-0.005	-0.006	-0.029	0.003	0.003	-0.021
	4070	0.015	0.253	-0.083	0.002	-0.007	-0.001	-0.006	-0.007
Wall EL9.06m ~EL13.8m	6117	0.012	0.369	0.039	0.010	0.070	-0.005	-0.005	0.104
	4096	0.059	0.192	0.000	-0.007	-0.038	0.000	0.003	-0.051
	4100	0.002	0.109	-0.076	-0.004	-0.009	0.003	0.003	-0.013

Table 3G.2-12

Combined Forces and Moments: Selected Load Combination CB-3

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL-7.4m	67	OTHR	-3.080	-3.266	-0.066	-1.110	-0.419	0.163	-0.048	-0.184
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	72	OTHR	-3.993	-1.014	-0.058	3.306	1.103	-0.065	-0.704	-0.033
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	115	OTHR	-3.842	-2.256	-0.948	-0.225	0.455	0.902	-0.630	-0.840
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	120	OTHR	-3.041	-1.661	-0.164	1.451	0.637	-0.077	-0.543	-0.025
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Slab B1F EL-2.0m	567	OTHR	-1.686	-0.361	0.010	-0.107	-0.030	-0.001	-0.117	0.035
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	572	OTHR	-2.589	-1.033	0.182	-0.007	-0.015	0.009	0.130	-0.008
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	615	OTHR	-0.877	-0.777	0.132	-0.059	-0.008	0.024	-0.068	0.000
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	620	OTHR	-1.211	-0.603	1.563	-0.022	-0.047	-0.040	0.033	0.066
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Slab 1F EL4.65m	1067	OTHR	-0.594	-0.127	-0.021	0.298	0.126	-0.019	0.040	0.025
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1072	OTHR	-1.224	-0.490	0.097	-0.187	-0.032	-0.005	0.174	0.010
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1115	OTHR	-0.364	-0.298	0.325	-0.033	-0.297	-0.011	0.002	0.249
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1120	OTHR	-0.447	-0.115	0.611	-0.057	-0.026	-0.008	0.050	0.027
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Slab 2F EL9.06m	1567	OTHR	0.018	0.084	-0.028	0.124	0.011	-0.006	0.023	0.013
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1572	OTHR	0.138	-0.071	-0.022	-0.081	-0.020	-0.002	0.124	-0.001
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1615	OTHR	0.010	0.184	-0.053	-0.015	-0.187	-0.009	0.010	0.200
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1620	OTHR	0.054	0.026	-0.136	-0.027	-0.026	-0.024	0.026	0.032
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Slab RF EL13.8m	1867	OTHR	-0.100	-0.076	-0.007	0.207	0.095	-0.009	0.022	0.002
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1872	OTHR	-0.058	-0.126	-0.012	-0.081	-0.017	0.004	0.111	-0.001
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1915	OTHR	-0.092	-0.156	-0.030	-0.015	-0.198	-0.004	-0.002	0.182
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	1920	OTHR	-0.007	-0.055	0.037	-0.026	-0.026	-0.058	0.016	0.023
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000

OTHR: Loads other than thermal loads

TEMP: Thermal loads

Table 3G.2-12

Combined Forces and Moments: Selected Load Combination CB-3 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Wall EL-7.4m ~EL-2.0m	6007	OTHR	-1.354	-0.966	-1.429	0.095	0.129	0.051	0.108	0.319
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4006	OTHR	-0.624	-0.760	-0.044	-0.103	-0.599	0.002	-0.006	-1.200
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4010	OTHR	-0.504	-0.669	-0.029	-0.114	-0.238	0.135	0.139	-0.502
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Wall EL-2.0m ~EL4.65m	6043	OTHR	-0.964	-1.377	-0.780	0.060	0.059	-0.022	0.061	0.359
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4036	OTHR	-1.182	-0.376	0.062	0.041	0.085	-0.006	0.037	-0.972
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4040	OTHR	-0.676	-1.347	0.646	-0.178	-0.014	0.165	0.352	-0.286
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Wall EL4.65m ~EL9.06m	6081	OTHR	-0.536	-0.756	0.194	0.006	0.012	0.000	-0.001	-0.049
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4066	OTHR	-0.676	-0.334	0.091	-0.074	-0.513	-0.014	0.013	-0.100
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4070	OTHR	-0.153	-0.601	0.412	-0.041	-0.154	-0.125	0.005	-0.082
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Wall EL9.06m ~EL13.8m	6117	OTHR	-0.092	-0.449	0.025	-0.018	-0.116	0.004	0.007	-0.130
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4096	OTHR	-0.216	-0.246	0.032	0.009	0.052	-0.002	-0.008	0.076
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	4100	OTHR	0.000	-0.071	0.077	0.008	0.005	-0.001	-0.011	0.010
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000

Table 3G.2-13

Combined Forces and Moments: Selected Load Combination CB-4

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL-7.4m	67	OTHR	-2.355	-2.483	-0.051	-0.831	-0.299	0.123	-0.041	-0.138
		TEMP	0.247	0.127	0.023	1.603	1.427	-0.001	-0.012	0.009
	72	OTHR	-3.052	-0.777	-0.045	2.536	0.848	-0.049	-0.527	-0.026
		TEMP	0.067	0.298	0.066	0.288	1.402	-0.043	0.107	0.095
	115	OTHR	-2.923	-1.720	-0.731	-0.168	0.352	0.697	-0.481	-0.630
		TEMP	1.048	0.057	0.134	1.782	0.464	-0.085	0.263	0.173
	120	OTHR	-2.324	-1.270	-0.122	1.112	0.490	-0.072	-0.415	-0.019
		TEMP	-0.179	-0.322	0.371	0.667	0.679	-0.060	0.492	0.335
Slab B1F EL-2.0m	567	OTHR	-1.289	-0.290	0.008	-0.081	-0.022	-0.001	-0.088	0.027
		TEMP	-0.231	0.041	0.005	-0.007	-0.004	0.000	-0.004	0.002
	572	OTHR	-1.982	-0.792	0.140	-0.005	-0.011	0.007	0.098	-0.006
		TEMP	0.092	-0.253	-0.026	-0.017	0.001	0.000	0.007	0.000
	615	OTHR	-0.674	-0.597	0.106	-0.045	-0.006	0.018	-0.051	0.000
		TEMP	-0.427	0.121	-0.119	-0.001	-0.001	0.001	-0.007	-0.012
	620	OTHR	-0.927	-0.462	1.194	-0.017	-0.036	-0.030	0.024	0.050
		TEMP	-0.347	-0.334	-0.506	-0.010	-0.007	0.006	0.006	0.002
Slab 1F EL4.65m	1067	OTHR	-0.455	-0.098	-0.016	0.224	0.095	-0.015	0.030	0.019
		TEMP	-1.232	-0.462	-0.008	0.005	-0.013	0.000	0.003	-0.001
	1072	OTHR	-0.935	-0.376	0.074	-0.143	-0.024	-0.004	0.132	0.008
		TEMP	-0.146	-1.628	-0.079	0.099	0.016	0.005	-0.044	-0.002
	1115	OTHR	-0.281	-0.228	0.248	-0.025	-0.224	-0.008	0.001	0.188
		TEMP	-1.372	0.033	-0.042	-0.004	0.027	0.003	-0.010	-0.005
	1120	OTHR	-0.342	-0.088	0.466	-0.043	-0.020	-0.006	0.038	0.020
		TEMP	-1.746	-1.711	-2.177	0.088	0.086	-0.008	-0.041	-0.038
Slab 2F EL9.06m	1567	OTHR	0.013	0.063	-0.021	0.093	0.009	-0.005	0.017	0.010
		TEMP	-2.063	-0.796	0.007	-0.039	-0.083	0.001	0.003	0.000
	1572	OTHR	0.105	-0.054	-0.017	-0.061	-0.015	-0.001	0.093	0.000
		TEMP	-0.491	-2.748	-0.073	0.026	-0.039	0.006	-0.070	0.005
	1615	OTHR	0.005	0.139	-0.040	-0.011	-0.141	-0.007	0.007	0.150
		TEMP	-1.581	0.170	-0.020	0.019	0.138	-0.025	0.031	-0.070
	1620	OTHR	0.041	0.020	-0.105	-0.021	-0.019	-0.018	0.020	0.024
		TEMP	-2.781	-2.761	-3.526	-0.067	-0.073	0.022	0.020	0.029
Slab RF EL13.8m	1867	OTHR	-0.075	-0.057	-0.005	0.155	0.072	-0.007	0.016	0.002
		TEMP	1.074	0.794	-0.006	-0.620	-0.789	0.001	0.012	-0.004
	1872	OTHR	-0.044	-0.094	-0.009	-0.061	-0.013	0.003	0.084	0.000
		TEMP	1.158	0.807	0.258	-0.218	-0.589	0.025	-0.222	0.013
	1915	OTHR	-0.069	-0.117	-0.023	-0.011	-0.149	-0.003	-0.001	0.137
		TEMP	1.490	0.605	0.263	-0.555	-0.346	0.007	0.010	-0.085
	1920	OTHR	-0.005	-0.041	0.028	-0.020	-0.020	-0.044	0.012	0.017
		TEMP	-0.016	-0.185	0.312	-0.521	-0.531	-0.023	-0.009	0.007

Table 3G.2-13

Combined Forces and Moments: Selected Load Combination CB-4 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Wall EL-7.4m ~EL-2.0m	6007	OTHR	-1.030	-0.724	-1.088	0.073	0.097	0.039	0.084	0.243
		TEMP	0.343	0.085	0.124	0.139	0.188	0.000	-0.006	0.045
	4006	OTHR	-0.478	-0.563	-0.034	-0.078	-0.454	0.001	-0.005	-0.917
		TEMP	0.359	-0.215	0.109	-0.135	-0.143	0.000	-0.001	-0.023
	4010	OTHR	-0.387	-0.508	-0.020	-0.087	-0.180	0.103	0.107	-0.383
		TEMP	0.173	0.675	0.174	-0.115	-0.131	-0.010	-0.006	-0.031
Wall EL-2.0m ~EL4.65m	6043	OTHR	-0.741	-1.028	-0.591	0.045	0.044	-0.017	0.046	0.275
		TEMP	-0.259	-0.861	-0.164	0.134	0.144	-0.007	0.011	-0.063
	4036	OTHR	-0.905	-0.276	0.047	0.031	0.063	-0.004	0.029	-0.744
		TEMP	0.077	-0.843	0.043	-0.138	-0.138	0.000	0.002	0.114
	4040	OTHR	-0.516	-1.023	0.493	-0.136	-0.011	0.126	0.269	-0.219
		TEMP	0.340	2.139	0.158	-0.047	-0.160	-0.042	-0.097	-0.035
Wall EL4.65m ~EL9.06m	6081	OTHR	-0.410	-0.567	0.149	0.005	0.012	0.000	-0.001	-0.036
		TEMP	6.542	-1.019	0.135	1.244	0.956	0.018	-0.056	-0.078
	4066	OTHR	-0.517	-0.249	0.070	-0.057	-0.393	-0.010	0.010	-0.077
		TEMP	7.525	-0.842	-0.101	-1.321	-0.948	-0.001	0.000	0.113
	4070	OTHR	-0.116	-0.454	0.313	-0.031	-0.118	-0.096	0.003	-0.063
		TEMP	4.742	1.674	-2.186	-1.087	-0.988	-0.028	-0.303	-0.234
Wall EL9.06m ~EL13.8m	6117	OTHR	-0.071	-0.337	0.021	-0.013	-0.088	0.003	0.005	-0.098
		TEMP	3.678	-0.611	-1.511	0.729	1.182	-0.019	-0.028	0.286
	4096	OTHR	-0.164	-0.185	0.025	0.006	0.039	-0.001	-0.006	0.058
		TEMP	4.088	-0.354	-0.173	-0.751	-1.230	0.000	0.024	-0.343
	4100	OTHR	0.000	-0.052	0.057	0.006	0.004	-0.001	-0.008	0.007
		TEMP	2.631	1.296	-1.236	-0.554	-0.993	-0.004	-0.282	-0.507

Table 3G.2-14

Combined Forces and Moments: Selected Load Combination CB-7

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL-7.4m	67	OTHR	-1.810	-2.029	-0.031	-0.769	-0.414	0.103	0.020	-0.132
		TEMP	0.190	0.097	0.018	1.233	1.098	-0.001	-0.009	0.007
	72	OTHR	-2.361	-0.644	-0.033	1.860	0.585	-0.038	-0.527	-0.014
		TEMP	0.052	0.229	0.051	0.222	1.078	-0.033	0.082	0.073
	115	OTHR	-2.369	-1.367	-0.482	-0.159	0.242	0.442	-0.359	-0.587
		TEMP	0.806	0.044	0.103	1.371	0.357	-0.066	0.202	0.133
	120	OTHR	-1.795	-0.992	-0.118	0.830	0.350	0.062	-0.320	-0.025
		TEMP	-0.138	-0.248	0.285	0.513	0.522	-0.046	0.378	0.258
Slab B1F EL-2.0m	567	OTHR	-0.992	-0.109	0.000	-0.068	-0.021	-0.002	-0.078	0.024
		TEMP	-0.178	0.031	0.004	-0.006	-0.003	0.000	-0.003	0.002
	572	OTHR	-1.511	-0.589	0.106	-0.006	-0.011	0.007	0.090	-0.005
		TEMP	0.071	-0.194	-0.020	-0.013	0.001	0.000	0.005	0.000
	615	OTHR	-0.493	-0.439	0.043	-0.039	-0.005	0.018	-0.045	0.000
		TEMP	-0.329	0.093	-0.091	-0.001	0.000	0.001	-0.005	-0.009
	620	OTHR	-0.707	-0.348	0.928	-0.016	-0.031	-0.028	0.024	0.044
		TEMP	-0.267	-0.257	-0.389	-0.008	-0.005	0.004	0.005	0.001
Slab 1F EL4.65m	1067	OTHR	-0.341	-0.064	-0.012	0.207	0.086	-0.013	0.029	0.018
		TEMP	-0.947	-0.355	-0.006	0.004	-0.010	0.000	0.002	-0.001
	1072	OTHR	-0.717	-0.275	0.056	-0.113	-0.020	-0.003	0.112	0.007
		TEMP	-0.113	-1.252	-0.061	0.076	0.013	0.004	-0.034	-0.001
	1115	OTHR	-0.200	-0.166	0.186	-0.022	-0.200	-0.008	0.001	0.170
		TEMP	-1.056	0.025	-0.032	-0.003	0.020	0.002	-0.008	-0.004
	1120	OTHR	-0.257	-0.060	0.358	-0.036	-0.017	-0.007	0.033	0.020
		TEMP	-1.343	-1.316	-1.675	0.068	0.066	-0.006	-0.032	-0.030
Slab 2F EL9.06m	1567	OTHR	-0.001	0.063	-0.016	0.085	0.006	-0.004	0.016	0.009
		TEMP	-1.587	-0.612	0.005	-0.030	-0.064	0.001	0.002	0.000
	1572	OTHR	0.090	-0.031	-0.015	-0.049	-0.014	-0.001	0.078	0.000
		TEMP	-0.378	-2.114	-0.056	0.020	-0.030	0.005	-0.053	0.003
	1615	OTHR	0.012	0.127	-0.042	-0.010	-0.124	-0.007	0.007	0.136
		TEMP	-1.216	0.130	-0.015	0.015	0.106	-0.019	0.024	-0.053
	1620	OTHR	0.037	0.024	-0.089	-0.018	-0.017	-0.016	0.018	0.022
		TEMP	-2.140	-2.124	-2.712	-0.051	-0.056	0.017	0.015	0.022
Slab RF EL13.8m	1867	OTHR	-0.062	-0.032	-0.004	0.108	0.055	-0.005	0.011	0.001
		TEMP	0.826	0.611	-0.004	-0.477	-0.607	0.001	0.009	-0.003
	1872	OTHR	-0.029	-0.062	-0.006	-0.048	-0.009	0.002	0.063	0.000
		TEMP	0.891	0.621	0.198	-0.168	-0.453	0.019	-0.171	0.010
	1915	OTHR	-0.050	-0.083	-0.026	-0.009	-0.110	-0.002	-0.001	0.098
		TEMP	1.146	0.465	0.202	-0.427	-0.266	0.006	0.008	-0.065
	1920	OTHR	0.000	-0.027	0.021	-0.014	-0.014	-0.033	0.009	0.012
		TEMP	-0.012	-0.142	0.240	-0.401	-0.408	-0.018	-0.007	0.006

Table 3G.2-14

Combined Forces and Moments: Selected Load Combination CB-7 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Wall EL-7.4m ~EL-2.0m	6007	OTHR	-0.833	-0.672	-0.837	0.053	0.091	0.029	0.054	0.198
		TEMP	0.264	0.065	0.095	0.107	0.144	0.000	-0.005	0.035
	4006	OTHR	-0.374	-0.607	-0.025	-0.066	-0.382	0.001	-0.004	-0.714
		TEMP	0.276	-0.166	0.084	-0.104	-0.110	0.000	-0.001	-0.018
	4010	OTHR	-0.289	-0.429	-0.045	-0.064	-0.150	0.078	0.077	-0.302
		TEMP	0.133	0.519	0.134	-0.088	-0.101	-0.007	-0.004	-0.024
Wall EL-2.0m ~EL4.65m	6043	OTHR	-0.544	-0.978	-0.464	0.041	0.038	-0.012	0.042	0.212
		TEMP	-0.199	-0.663	-0.126	0.103	0.111	-0.006	0.009	-0.049
	4036	OTHR	-0.682	-0.322	0.034	0.027	0.067	-0.004	0.022	-0.567
		TEMP	0.059	-0.648	0.033	-0.106	-0.106	0.000	0.001	0.087
	4040	OTHR	-0.400	-0.849	0.371	-0.106	-0.004	0.099	0.210	-0.165
		TEMP	0.262	1.645	0.121	-0.036	-0.123	-0.032	-0.075	-0.027
Wall EL4.65m ~EL9.06m	6081	OTHR	-0.304	-0.503	0.124	0.002	-0.008	-0.001	0.000	-0.046
		TEMP	5.033	-0.784	0.104	0.957	0.735	0.014	-0.043	-0.060
	4066	OTHR	-0.382	-0.240	0.053	-0.043	-0.301	-0.008	0.007	-0.053
		TEMP	5.788	-0.648	-0.077	-1.016	-0.729	-0.001	0.000	0.087
	4070	OTHR	-0.085	-0.384	0.241	-0.023	-0.090	-0.074	0.002	-0.046
		TEMP	3.648	1.288	-1.682	-0.836	-0.760	-0.021	-0.233	-0.180
Wall EL9.06m ~EL13.8m	6117	OTHR	-0.055	-0.273	0.013	-0.011	-0.074	0.002	0.004	-0.081
		TEMP	2.829	-0.470	-1.162	0.561	0.909	-0.015	-0.022	0.220
	4096	OTHR	-0.115	-0.155	0.018	0.005	0.033	-0.001	-0.005	0.049
		TEMP	3.144	-0.272	-0.133	-0.578	-0.946	0.000	0.018	-0.264
	4100	OTHR	0.005	-0.049	0.043	0.005	0.004	0.000	-0.007	0.007
		TEMP	2.024	0.997	-0.951	-0.426	-0.764	-0.003	-0.217	-0.390

Table 3G.2-15

Combined Forces and Moments: Selected Load Combination CB-9

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL-7.4m	67	OTHR	-1.805	-2.051	-0.035	-0.832	-0.439	0.114	-0.003	-0.135
		TEMP	-0.410	-1.284	0.167	6.777	6.386	-0.129	0.288	-0.110
		EQEW	0.148	-0.283	0.555	0.602	2.010	0.036	0.689	-2.642
		EQNS	-0.155	-0.143	0.233	-0.513	-0.371	-0.268	0.860	-0.028
		EQZ	-0.024	0.570	-0.020	0.935	0.842	-0.078	-0.106	0.111
		EQT	0.001	0.001	0.103	0.000	0.000	0.004	-0.001	-0.001
		SPKW	0.088	-1.357	0.050	0.441	0.712	-0.065	0.156	-0.080
		SPKN	-1.032	0.158	-0.019	-0.153	-0.075	0.011	-0.068	0.039
	72	OTHR	-2.357	-0.556	-0.032	1.878	0.622	-0.045	-0.512	-0.013
		TEMP	-0.190	-0.285	0.059	1.918	5.859	-0.011	0.285	0.127
		EQEW	0.033	-0.005	-2.066	0.075	0.214	2.320	0.154	-0.941
		EQNS	-0.182	-3.721	0.007	-2.010	-1.593	0.052	-1.590	0.017
		EQZ	0.040	-0.070	-0.012	0.352	0.134	0.039	0.464	-0.027
		EQT	0.000	-0.014	-0.184	-0.002	0.001	0.114	0.001	-0.125
		SPKW	0.030	-0.772	-0.003	-0.064	0.096	-0.007	0.078	-0.017
		SPKN	-1.024	-0.150	-0.018	0.904	0.215	0.004	-0.115	-0.013
	115	OTHR	-2.393	-1.377	-0.517	-0.175	0.230	0.483	-0.385	-0.613
		TEMP	-0.190	-0.082	0.188	6.663	2.333	-0.257	0.534	0.937
		EQEW	3.308	0.365	0.116	0.200	0.849	0.142	-0.459	0.753
		EQNS	-0.170	-0.077	2.425	0.102	0.016	-2.589	1.271	-0.178
		EQZ	0.598	0.226	-0.249	0.207	0.173	0.281	0.030	0.546
		EQT	0.024	0.000	0.191	0.020	0.009	-0.083	0.128	0.001
		SPKW	-0.121	-0.758	-0.068	0.128	0.415	0.078	-0.031	0.023
		SPKN	-0.935	0.002	-0.039	0.006	-0.016	0.053	0.003	0.009
	120	OTHR	-1.800	-0.976	-0.125	0.841	0.347	0.070	-0.326	-0.012
		TEMP	-0.948	-1.036	-0.270	3.316	3.332	1.783	1.353	1.269
		EQEW	0.807	-0.212	-0.188	0.323	0.775	-0.190	1.080	-0.056
		EQNS	0.089	-0.838	0.274	-0.843	-0.343	0.472	0.143	-0.893
		EQZ	0.046	0.022	0.120	0.080	0.139	-0.511	0.031	0.028
		EQT	0.064	-0.049	-0.011	-0.018	0.026	0.013	0.104	-0.101
		SPKW	-0.042	-0.689	0.045	0.018	0.352	-0.201	-0.057	-0.060
		SPKN	-0.712	-0.035	0.017	0.377	0.032	-0.109	-0.051	-0.023

OTHR: Loads other than thermal loads
TEMP: Thermal loads
EQEW: Horizontal seismic loads in the E-W direction
EQNS: Horizontal seismic loads in the N-S direction
EQZ: Vertical seismic loads
EQT: Torsional seismic loads
SPKW: Dynamic soil pressure during a horizontal earthquake in the E-W direction
SPKN: Dynamic soil pressure during a horizontal earthquake in the N-S direction

Table 3G.2-15

Combined Forces and Moments: Selected Load Combination CB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Slab B1F EL-2.0m	567	OTHR	-0.994	-0.083	-0.001	-0.072	-0.021	-0.001	-0.080	0.024
		TEMP	-0.722	0.440	0.044	-0.078	-0.090	0.002	-0.004	0.006
		EQEW	0.009	0.033	-0.517	0.027	0.077	0.018	0.019	-0.138
		EQNS	0.030	-0.010	0.020	0.070	0.000	-0.014	0.023	-0.015
		EQZ	0.001	-0.565	0.032	0.039	0.014	0.004	0.047	-0.014
		EQT	0.000	0.000	0.001	0.000	0.000	0.000	0.000	0.000
		SPKW	0.126	-1.175	0.044	0.002	-0.001	0.001	0.000	-0.006
		SPKN	-0.965	0.112	-0.005	-0.001	0.000	0.000	0.000	0.001
	572	OTHR	-1.509	-0.587	0.105	-0.007	-0.011	0.007	0.091	-0.006
		TEMP	0.333	-0.748	-0.056	-0.031	-0.063	0.003	-0.022	0.000
		EQEW	-0.012	-0.011	-0.298	-0.001	0.000	0.001	0.001	0.002
		EQNS	0.279	0.227	-0.049	-0.007	-0.007	-0.001	-0.004	0.003
		EQZ	-0.064	-0.097	0.009	0.017	0.009	-0.004	-0.060	0.003
		EQT	-0.001	0.001	-0.006	0.000	0.000	0.000	0.000	0.000
		SPKW	0.010	-0.479	0.004	-0.011	-0.002	0.000	0.005	0.000
		SPKN	-1.132	-0.208	0.044	0.035	0.006	0.001	-0.015	0.000
	615	OTHR	-0.486	-0.433	0.032	-0.040	-0.005	0.018	-0.046	-0.001
		TEMP	-0.855	0.670	-0.731	-0.078	-0.034	0.006	-0.032	-0.075
		EQEW	0.254	-0.268	-0.419	0.008	0.028	0.001	-0.002	-0.016
		EQNS	-0.022	0.004	-0.302	0.042	0.001	0.010	0.039	0.009
		EQZ	-0.140	-0.110	0.198	0.021	0.000	-0.015	0.026	0.006
		EQT	0.001	0.000	0.002	0.002	0.000	0.000	0.002	0.000
		SPKW	-0.154	-0.933	-0.261	0.002	0.037	0.002	-0.009	-0.039
		SPKN	-0.471	-0.016	0.124	0.001	-0.003	0.000	0.002	0.005
	620	OTHR	-0.706	-0.348	0.928	-0.016	-0.031	-0.028	0.024	0.045
		TEMP	-0.969	-0.965	-1.404	-0.066	-0.065	0.009	0.007	0.005
		EQEW	-0.077	-0.148	-0.266	-0.016	0.020	0.002	0.023	-0.022
		EQNS	0.226	0.087	-0.196	-0.015	0.018	0.001	0.018	-0.021
		EQZ	-0.034	-0.035	-0.048	0.013	0.013	0.016	-0.019	-0.021
		EQT	0.003	-0.002	-0.002	-0.002	0.002	0.000	0.002	-0.002
		SPKW	-0.013	-0.507	0.286	-0.004	0.007	-0.004	0.005	-0.007
		SPKN	-0.502	-0.013	0.361	0.008	-0.004	-0.004	-0.008	0.006

Table 3G.2-15

Combined Forces and Moments: Selected Load Combination CB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Slab 1F EL4.65m	1067	OTHR	-0.336	-0.073	-0.013	0.208	0.087	-0.013	0.028	0.018
		TEMP	-1.333	-0.474	-0.007	0.065	0.030	0.000	0.004	-0.003
		EQEW	-0.005	-0.020	0.026	0.002	0.001	0.002	0.000	0.000
		EQNS	0.032	-0.019	0.027	-0.005	-0.005	-0.003	0.008	-0.001
		EQZ	-0.072	-0.037	0.003	-0.164	-0.069	0.011	-0.024	-0.016
		EQT	0.000	0.001	-0.006	0.000	0.000	0.000	0.000	0.000
		SPKW	0.106	-0.632	0.031	-0.006	0.015	0.001	-0.002	0.002
		SPKN	-0.625	0.096	-0.006	0.001	0.000	-0.001	0.000	-0.001
	1072	OTHR	-0.725	-0.288	0.058	-0.115	-0.020	-0.003	0.114	0.007
		TEMP	-0.170	-1.779	-0.096	0.183	0.081	0.007	-0.061	-0.001
		EQEW	-0.002	-0.007	0.281	0.000	0.000	0.002	0.000	0.002
		EQNS	0.220	0.276	-0.047	0.016	-0.003	0.001	-0.012	0.001
		EQZ	0.003	-0.036	-0.002	0.034	0.008	0.001	-0.063	-0.006
		EQT	0.001	0.001	-0.006	0.000	0.000	0.000	0.000	0.000
		SPKW	0.024	-0.320	-0.007	0.000	0.002	-0.001	0.002	-0.001
		SPKN	-0.731	-0.125	0.024	-0.064	-0.010	-0.002	0.028	0.000
	1115	OTHR	-0.194	-0.179	0.196	-0.022	-0.201	-0.008	0.001	0.170
		TEMP	-1.421	0.048	0.018	0.065	0.112	0.002	-0.008	-0.016
		EQEW	-0.323	-0.160	0.000	0.014	0.040	0.000	0.002	-0.015
		EQNS	0.018	-0.009	-0.262	-0.006	0.003	-0.004	0.002	-0.001
		EQZ	-0.104	-0.028	-0.011	0.015	0.142	0.008	0.000	-0.125
		EQT	0.000	0.000	-0.012	0.000	0.000	0.000	0.000	0.000
		SPKW	-0.105	-0.679	-0.041	-0.011	-0.057	0.002	0.001	0.021
		SPKN	-0.337	0.009	0.029	0.001	0.000	0.000	0.000	0.000
	1120	OTHR	-0.261	-0.068	0.373	-0.036	-0.018	-0.007	0.032	0.020
		TEMP	-1.988	-1.963	-2.415	0.130	0.129	-0.007	-0.033	-0.031
		EQEW	-0.057	-0.121	0.150	-0.011	0.019	0.000	0.019	-0.019
		EQNS	0.140	0.057	-0.075	-0.008	0.012	0.002	0.012	-0.014
		EQZ	-0.020	-0.016	-0.049	0.014	0.013	0.013	-0.015	-0.020
		EQT	0.004	-0.003	-0.002	-0.001	0.001	0.000	0.001	-0.001
		SPKW	0.000	-0.304	0.173	0.006	-0.018	0.006	-0.012	0.016
		SPKN	-0.302	-0.002	0.204	-0.019	0.006	0.007	0.017	-0.012

Table 3G.2-15

Combined Forces and Moments: Selected Load Combination CB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Slab 2F EL9.06m	1567	OTHR	0.018	0.057	-0.017	0.085	0.008	-0.004	0.016	0.009
		TEMP	-2.556	-1.079	0.015	-0.027	-0.087	0.002	0.004	0.000
		EQEW	-0.015	-0.038	0.040	0.001	0.000	0.001	0.000	0.000
		EQNS	0.029	-0.033	0.017	-0.005	-0.005	-0.003	0.010	-0.001
		EQZ	-0.038	-0.065	0.004	-0.080	-0.007	0.005	-0.016	-0.009
		EQT	0.000	0.000	-0.008	0.000	0.000	0.000	0.000	0.000
		SPKW	-0.003	0.042	-0.004	0.001	0.003	0.000	0.000	0.000
		SPKN	0.001	-0.031	0.002	-0.001	0.000	0.000	0.000	0.000
	1572	OTHR	0.080	-0.050	-0.012	-0.054	-0.014	-0.001	0.084	0.000
		TEMP	-0.679	-3.422	-0.099	0.070	-0.022	0.009	-0.099	0.006
		EQEW	-0.004	-0.004	0.370	0.000	0.000	0.002	0.000	0.001
		EQNS	0.160	0.325	-0.027	0.016	-0.003	0.001	-0.018	0.002
		EQZ	-0.024	-0.008	0.001	0.040	0.012	0.000	-0.069	0.000
		EQT	0.000	0.002	-0.002	0.000	0.000	0.000	0.000	0.000
		SPKW	0.007	-0.035	-0.011	-0.001	0.000	0.000	0.002	0.000
		SPKN	0.058	0.014	-0.005	-0.005	-0.001	0.000	0.005	0.000
	1615	OTHR	0.036	0.126	-0.031	-0.010	-0.130	-0.006	0.007	0.138
		TEMP	-2.435	0.083	-0.112	0.044	0.193	-0.031	0.036	-0.087
		EQEW	-0.727	-0.224	-0.036	0.002	0.015	-0.001	-0.005	-0.006
		EQNS	-0.326	-0.062	0.017	-0.011	0.002	-0.003	0.005	0.000
		EQZ	-0.133	-0.113	0.016	0.009	0.125	0.006	-0.006	-0.129
		EQT	-0.024	-0.004	0.009	-0.001	0.000	0.000	0.001	0.000
		SPKW	0.008	0.042	0.018	0.000	-0.002	0.000	-0.001	0.001
		SPKN	-0.126	-0.010	-0.014	-0.001	-0.001	0.000	-0.001	0.000
	1620	OTHR	0.032	0.013	-0.071	-0.019	-0.018	-0.016	0.018	0.023
		TEMP	-3.154	-3.134	-4.156	-0.051	-0.057	0.025	0.020	0.029
		EQEW	-0.082	-0.118	0.166	-0.009	0.013	0.001	0.015	-0.014
		EQNS	0.092	0.070	-0.097	-0.007	0.011	0.002	0.011	-0.012
		EQZ	-0.019	-0.015	-0.005	0.016	0.016	0.013	-0.017	-0.022
		EQT	0.002	-0.003	-0.006	-0.001	0.001	0.000	0.001	-0.001
		SPKW	0.005	0.011	-0.048	0.001	-0.001	-0.001	-0.001	0.001
		SPKN	0.010	0.006	-0.066	-0.001	0.001	-0.001	0.001	-0.002

Table 3G.2-15

Combined Forces and Moments: Selected Load Combination CB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Slab RF EL13.8m	1867	OTHR	-0.076	-0.063	-0.004	0.165	0.068	-0.008	0.019	0.002
		TEMP	1.487	1.030	-0.009	-0.782	-1.031	0.001	0.017	-0.006
		EQEW	-0.053	-0.029	0.058	0.002	-0.001	0.001	0.000	-0.002
		EQNS	0.043	0.020	-0.008	-0.013	-0.012	-0.007	0.019	-0.001
		EQZ	0.102	0.080	-0.003	-0.219	-0.066	0.011	-0.032	-0.002
		EQT	0.000	0.000	-0.009	0.000	0.000	0.000	0.000	0.000
		SPKW	-0.001	0.012	0.000	0.001	0.006	0.000	0.000	0.000
		SPKN	0.013	-0.015	0.000	0.000	0.004	0.000	0.000	0.000
	1872	OTHR	-0.045	-0.106	-0.007	-0.054	-0.014	0.004	0.080	0.000
		TEMP	1.593	1.268	0.355	-0.221	-0.741	0.036	-0.311	0.019
		EQEW	-0.004	0.003	0.478	0.000	0.000	0.006	0.000	0.004
		EQNS	0.343	0.743	0.023	0.030	-0.011	0.004	-0.031	0.003
		EQZ	0.042	0.105	-0.003	0.037	0.021	-0.009	-0.080	-0.001
		EQT	0.001	0.005	-0.015	0.000	0.000	0.000	0.000	0.000
		SPKW	-0.008	-0.001	0.002	-0.011	-0.001	-0.001	0.007	0.000
		SPKN	0.006	0.056	0.002	-0.001	0.000	0.000	0.001	0.000
	1915	OTHR	-0.072	-0.121	-0.014	-0.010	-0.149	-0.005	-0.002	0.142
		TEMP	1.851	0.825	0.347	-0.692	-0.390	0.009	0.012	-0.121
		EQEW	-1.144	-0.274	0.004	0.009	0.029	-0.001	-0.001	-0.006
		EQNS	0.097	0.019	-0.352	-0.008	0.005	-0.014	0.000	-0.001
		EQZ	0.105	0.139	0.003	0.008	0.174	0.011	0.004	-0.182
		EQT	0.008	0.001	-0.017	-0.001	0.000	0.000	0.001	0.000
		SPKW	0.024	-0.001	0.003	-0.001	-0.005	0.000	0.000	0.002
		SPKN	-0.020	-0.006	-0.002	-0.002	-0.005	0.000	0.000	0.002
	1920	OTHR	-0.008	-0.046	0.025	-0.020	-0.020	-0.044	0.013	0.019
		TEMP	-0.001	-0.168	0.488	-0.636	-0.644	-0.024	-0.012	0.006
		EQEW	-0.207	-0.077	0.038	-0.008	0.015	0.005	0.016	-0.012
		EQNS	0.131	0.164	0.003	-0.006	0.013	0.006	0.012	-0.011
		EQZ	0.021	0.049	-0.015	0.025	0.021	0.052	-0.022	-0.027
		EQT	0.010	-0.012	-0.008	-0.001	0.001	0.000	0.001	-0.001
		SPKW	0.000	-0.003	0.019	-0.001	0.000	-0.002	0.000	-0.001
		SPKN	-0.007	0.009	0.011	0.000	0.000	-0.001	-0.001	0.000

Table 3G.2-15

Combined Forces and Moments: Selected Load Combination CB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Wall EL-7.4m ~EL-2.0m	6007	OTHR	-0.845	-0.703	-0.900	0.054	0.093	0.030	0.054	0.200
		TEMP	0.524	1.364	-0.056	0.642	0.904	0.004	-0.032	0.165
		EQEW	1.287	1.357	-0.050	0.025	0.006	0.006	0.007	-0.030
		EQNS	0.128	-0.241	2.678	-0.072	0.043	-0.015	-0.090	0.039
		EQZ	0.207	0.621	0.184	0.010	-0.077	0.004	0.046	-0.058
		EQT	0.011	0.004	0.194	-0.003	0.002	0.002	-0.006	0.002
		SPKW	-0.039	0.069	-0.018	0.034	0.028	0.021	0.054	0.106
		SPKN	-0.384	0.014	0.004	-0.002	-0.018	-0.001	0.003	-0.007
	4006	OTHR	-0.355	-0.593	-0.022	-0.067	-0.386	0.001	-0.004	-0.715
		TEMP	0.758	-0.076	0.091	-0.688	-1.071	-0.001	-0.001	-0.195
		EQEW	-0.066	0.182	-2.153	0.009	0.028	-0.018	-0.010	0.011
		EQNS	-0.916	-2.388	-0.034	0.015	0.063	-0.002	0.001	0.047
		EQZ	-0.018	0.707	-0.018	0.026	0.141	0.000	0.001	0.037
		EQT	-0.006	-0.001	-0.206	0.001	0.002	0.001	-0.002	0.001
		SPKW	-0.350	0.127	-0.008	0.014	0.078	-0.001	0.001	0.032
		SPKN	-0.100	-0.072	-0.018	-0.020	-0.125	0.000	-0.001	-0.290
	4010	OTHR	-0.283	-0.425	-0.031	-0.065	-0.153	0.078	0.076	-0.303
		TEMP	1.043	1.256	-0.326	-0.530	-0.881	-0.042	-0.156	-0.334
		EQEW	-0.213	1.042	-0.804	0.043	0.132	-0.007	0.048	0.058
		EQNS	-0.184	-0.785	-0.808	0.043	0.042	-0.025	0.017	0.014
		EQZ	-0.053	0.179	0.088	-0.011	0.057	0.004	0.025	0.033
		EQT	-0.021	0.011	-0.143	0.005	0.009	0.000	0.003	0.005
		SPKW	-0.224	-0.027	0.050	-0.038	0.016	-0.014	0.033	0.021
		SPKN	-0.047	-0.097	-0.066	-0.008	-0.043	0.044	0.031	-0.125
Wall EL-2.0m ~EL4.65m	6043	OTHR	-0.536	-1.044	-0.530	0.043	0.040	-0.012	0.044	0.212
		TEMP	2.537	-1.179	-0.671	0.380	0.488	-0.027	0.132	0.063
		EQEW	0.619	1.110	0.069	0.077	0.156	-0.010	0.043	0.073
		EQNS	0.012	-0.043	1.835	-0.003	-0.015	0.012	0.006	-0.004
		EQZ	-0.136	1.097	0.234	-0.033	-0.024	-0.005	-0.034	0.000
		EQT	0.000	0.011	0.146	0.000	-0.001	0.002	0.000	0.000
		SPKW	-0.024	-0.085	-0.070	0.029	0.035	-0.018	0.050	0.544
		SPKN	-0.607	0.217	0.065	-0.007	0.007	0.002	-0.013	-0.005
	4036	OTHR	-0.684	-0.324	0.036	0.027	0.069	-0.004	0.022	-0.566
		TEMP	2.469	-0.418	-0.013	-0.288	-0.299	0.000	0.031	0.070
		EQEW	-0.026	0.098	-1.954	0.000	-0.003	0.006	0.008	-0.001
		EQNS	0.138	-1.782	-0.107	-0.025	-0.097	-0.001	-0.006	-0.027
		EQZ	-0.051	0.539	0.001	-0.015	-0.081	0.001	0.002	-0.027
		EQT	0.002	-0.001	-0.132	0.000	-0.001	0.002	0.001	0.000
		SPKW	-0.535	0.174	0.007	-0.007	-0.033	-0.001	-0.003	-0.004
		SPKN	-0.191	-0.029	0.001	0.006	-0.001	-0.001	0.017	-0.514
	4040	OTHR	-0.400	-0.851	0.397	-0.106	-0.004	0.099	0.210	-0.165
		TEMP	1.383	1.398	-0.607	-0.080	-0.300	-0.047	-0.217	-0.181
		EQEW	-0.004	0.934	-1.376	0.012	-0.009	-0.021	-0.019	-0.016
		EQNS	0.035	-0.613	-1.095	0.003	-0.034	-0.013	-0.032	-0.033
		EQZ	0.014	0.328	-0.039	0.003	-0.018	-0.008	-0.013	-0.015
		EQT	-0.013	-0.014	-0.126	0.000	-0.001	0.000	0.000	-0.001
		SPKW	-0.364	-0.137	0.041	-0.112	-0.021	-0.025	0.047	0.025
		SPKN	-0.116	-0.234	0.019	-0.034	-0.008	0.101	0.137	-0.159

Table 3G.2-15

Combined Forces and Moments: Selected Load Combination CB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Wall EL4.65m ~EL9.06m	6081	OTHR	-0.319	-0.560	0.100	0.001	-0.014	-0.001	-0.001	-0.035
		TEMP	5.514	-0.799	0.343	1.391	0.998	0.007	-0.048	-0.163
		EQEW	-0.289	0.800	0.369	-0.016	-0.065	-0.014	-0.008	-0.006
		EQNS	0.432	-0.261	1.028	0.005	0.030	-0.003	0.000	0.017
		EQZ	-0.004	0.600	-0.001	0.017	0.107	0.004	0.001	0.056
		EQT	0.032	0.003	0.102	0.000	0.001	0.001	0.000	0.001
		SPKW	-0.056	-0.018	0.003	0.048	0.323	0.017	-0.013	0.084
		SPKN	-0.319	0.088	0.120	0.002	0.010	-0.002	0.002	0.008
	4066	OTHR	-0.408	-0.258	0.055	-0.042	-0.297	-0.009	0.007	-0.058
		TEMP	6.360	-0.476	-0.041	-1.488	-1.021	0.000	-0.021	0.188
		EQEW	-0.005	0.045	-1.306	0.000	0.001	-0.005	-0.001	0.001
		EQNS	0.441	-0.800	-0.108	-0.006	0.013	0.001	-0.004	0.005
		EQZ	0.006	0.347	-0.005	-0.006	-0.029	0.003	0.003	-0.021
		EQT	0.001	0.000	-0.091	0.000	0.000	0.001	0.000	0.000
		SPKW	-0.340	0.080	0.016	-0.001	-0.006	0.002	-0.002	-0.008
		SPKN	-0.093	-0.008	0.005	-0.051	-0.312	-0.005	0.012	-0.079
	4070	OTHR	-0.097	-0.402	0.267	-0.025	-0.090	-0.073	0.005	-0.048
		TEMP	3.597	1.334	-1.486	-1.232	-1.168	-0.021	-0.332	-0.163
		EQEW	-0.047	0.307	-1.040	-0.019	0.009	-0.008	0.007	0.014
		EQNS	0.077	-0.425	-0.868	0.002	0.005	-0.001	-0.010	-0.005
		EQZ	0.015	0.253	-0.083	0.002	-0.007	-0.001	-0.006	-0.007
		EQT	-0.009	-0.014	-0.094	0.000	0.000	0.001	0.000	0.000
		SPKW	-0.049	-0.047	0.178	-0.019	0.002	0.028	0.008	0.008
		SPKN	-0.041	-0.076	-0.009	-0.014	-0.094	-0.076	-0.005	-0.055
Wall EL9.06m ~EL13.8m	6117	OTHR	-0.054	-0.339	0.002	-0.012	-0.079	0.004	0.005	-0.092
		TEMP	3.544	-0.629	-1.506	0.909	1.507	-0.023	-0.037	0.383
		EQEW	-0.652	0.430	0.425	-0.005	-0.001	0.000	-0.002	0.011
		EQNS	-0.267	0.067	0.567	0.000	0.006	0.001	-0.001	0.013
		EQZ	0.012	0.369	0.039	0.010	0.070	-0.005	-0.005	0.104
		EQT	-0.022	0.018	0.058	0.000	-0.001	0.001	0.000	0.000
		SPKW	0.014	-0.017	-0.014	0.000	0.002	-0.002	-0.001	0.000
		SPKN	-0.074	0.017	0.057	-0.002	-0.013	0.000	0.000	-0.006
	4096	OTHR	-0.150	-0.179	0.020	0.006	0.037	-0.001	-0.005	0.051
		TEMP	3.967	-0.304	-0.182	-0.936	-1.569	0.000	0.034	-0.461
		EQEW	0.006	0.024	-0.678	-0.001	-0.001	-0.001	0.000	0.000
		EQNS	0.533	-0.337	-0.079	-0.008	-0.027	0.001	-0.002	-0.024
		EQZ	0.059	0.192	0.000	-0.007	-0.038	0.000	0.003	-0.051
		EQT	0.002	0.000	-0.043	0.000	0.000	0.000	0.000	0.000
		SPKW	-0.071	-0.003	0.002	0.003	0.020	0.000	0.000	0.011
		SPKN	0.021	-0.015	-0.003	-0.002	-0.008	0.000	-0.002	-0.002
	4100	OTHR	-0.005	-0.066	0.067	0.005	0.004	-0.001	-0.006	0.007
		TEMP	2.846	1.764	-1.528	-0.680	-1.227	-0.002	-0.347	-0.594
		EQEW	-0.003	0.173	-0.560	-0.012	0.003	-0.005	0.001	0.014
		EQNS	0.098	-0.253	-0.560	-0.002	-0.005	-0.002	-0.009	-0.007
		EQZ	0.002	0.109	-0.076	-0.004	-0.009	0.003	0.003	-0.013
		EQT	-0.009	-0.009	-0.050	0.000	0.000	0.000	0.000	-0.001
		SPKW	0.004	0.042	-0.008	0.002	0.003	0.002	0.002	0.002
		SPKN	0.014	0.037	-0.059	0.001	-0.005	0.001	-0.005	-0.003

Table 3G.2-16

Sectional Thicknesses and Rebar Ratios Used in the Evaluation

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Directtion 1*1		Directtion 2*1			
				Arrangement	Ratio (%)	Arrangement	Ratio (%)	Arrangement	Ratio (%)
Basemat EL-7.4	67 72	3.0	Top	1-#11@200 + 1-#11@400	0.252	1-#11@200 + 1-#11@400	0.252	-	-
			Bottom	1-#11@200 + 1-#11@400	0.252	1-#11@200 + 1-#11@400	0.252		
	115 120	3.0	Top	1-#11@200 + 1-#11@400	0.252	1-#11@200 + 1-#11@400	0.252	#7@400x400	0.242
			Bottom	1-#11@200 + 1-#11@400	0.252	1-#11@200 + 1-#11@400	0.252		
Slab B1F EL-2.0	567 572 615 620	0.5	Top	1-#11@200	1.006	1-#11@200	1.006	-	-
			Bottom	1-#11@200	1.006	1-#11@200	1.006		
Slab 1F EL4.65	1067 1072 1115 1120	0.5	Top	1-#11@200	1.006	1-#11@200	1.006	-	-
			Bottom	1-#11@200	1.006	1-#11@200	1.006		
Slab 2F EL9.06m	1567 1572 1620	0.5	Top	1-#11@200	1.006	1-#11@200	1.006	-	-
			Bottom	1-#11@200	1.006	1-#11@200	1.006		
	1615	0.5	Top	1-#11@200	1.006	1-#11@200	1.006	#4@200x200	0.323
			Bottom	1-#11@200	1.006	1-#11@200	1.006		
Slab RF EL13.8m	1867 1872 1915 1920	0.7	Top	1-#11@200	0.719	1-#11@200	0.719	-	-
			Bottom	1-#11@200	0.719	1-#11@200	0.719		

Note *1: Wall Direction 1: Horizontal, Direction 2: Vertical
Basemat, Slab Direction 1: N-S, Direction 2: E-W

Table 3G.2-16

Sectional Thicknesses and Rebar Ratios Used in the Evaluation (Continued)

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Directtion 1*1		Directtion 2*1			
				Arrangement	Ratio (%)	Arrangement	Ratio (%)	Arrangement	Ratio (%)
Wall EL-7.4m ~EL-2.0m	6007	0.9	Inside	2-#11@200	1.118	2-#11@200	1.118	#6@400x200	0.355
			Outside	2-#11@200	1.118	2-#11@200	1.118		
	4006 4010	0.9	Inside	2-#11@200	1.118	2-#11@200	1.118	#6@200x200	0.710
			Outside	2-#11@200	1.118	2-#11@200	1.118		
Wall EL-2.0m ~EL4.65m	6043	0.9	Inside	2-#11@200	1.118	2-#11@200	1.118	#6@400x200	0.355
			Outside	2-#11@200	1.118	2-#11@200	1.118		
	4036 4040	0.9	Inside	2-#11@200	1.118	2-#11@200	1.118	#6@200x200	0.710
			Outside	2-#11@200	1.118	2-#11@200	1.118		
Wall EL4.65m ~EL9.06m	6081 4066	0.9	Inside	1-#11@200	0.559	1-#11@200	0.559	-	-
			Outside	2-#11@200	1.118	2-#11@200	1.118		
	4070	0.9	Inside	1-#11@200	0.559	1-#11@200	0.559	#6@400x400	0.177
			Outside	2-#11@200	1.118	2-#11@200	1.118		
Wall EL9.06m ~EL13.8m	6117	0.7	Inside	1-#11@200	0.719	1-#11@200	0.719	-	-
			Outside	1-#11@200 + 1-#11@400	1.078	1-#11@200 + 1-#11@400	1.078		
	4096 4100	0.7	Inside	1-#11@200	0.719	1-#11@200	0.719	#4@200x200	0.323
			Outside	1-#11@200 + 1-#11@400	1.078	1-#11@200 + 1-#11@400	1.078		

Note *1: Wall Direction 1: Horizontal, Direction 2: Vertical
Basemat, Slab Direction 1: N-S, Direction 2: E-W

Table 3G.2-17

Rebar and Concrete Stresses (Basemat and Slabs): Selected Load Combination CB-3

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				X-direction		Y-direction		
				Top	Bottom	Top	Bottom	
Basemat EL-7.4m	67	-1.7	-20.7	-2.1	-10.8	-6.0	-8.1	372.2
	72	-3.6		-24.7	6.9	-4.7	5.8	
	115	-2.0		-7.6	-10.2	-6.3	-2.2	
	120	-1.9		-12.9	-1.6	-4.8	-1.3	
Slab B1F EL-2.0m	567	-5.3	-25.9	-13.3	-27.6	-0.2	-2.6	372.2
	572	-4.9		-30.2	-30.8	-6.9	-9.4	
	615	-3.3		-5.5	-13.6	-8.2	-8.0	
	620	-8.1		101.0	18.6	131.6	21.8	
Slab 1F EL4.65m	1067	-15.4	-25.9	-10.7	126.5	-2.7	61.7	372.2
	1072	-7.4		10.1	-27.3	-1.6	-4.2	
	1115	-11.8		36.1	8.1	154.4	-28.0	
	1120	-4.3		61.2	5.6	66.8	15.2	
Slab 2F EL9.06m	1567	-6.6	-25.9	3.8	80.7	6.6	24.5	372.2
	1572	-4.2		65.3	7.9	6.7	-0.5	
	1615	-6.7		12.4	5.4	120.9	-10.2	
	1620	-2.5		21.7	14.8	17.0	16.3	
Slab RF EL13.8m	1867	-5.2	-25.9	-4.8	71.9	-3.9	25.9	372.2
	1872	-2.0		27.1	-3.0	0.4	-1.3	
	1915	-3.9		-0.1	0.0	57.5	-14.4	
	1920	-2.8		32.8	7.9	29.9	1.4	

Note: Negative value means compression.

Table 3G.2-18

Rebar and Concrete Stresses (Walls): Selected Load Combination CB-3

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Horizontal direction		Vertical direction		
				Inside	Outside	Inside	Outside	
Wall EL-7.4m ~EL-2.0m	6007	-3.9	-25.9	2.1	20.3	-0.2	32.4	372.2
	4006	-7.8		-4.1	-1.8	-14.7	62.2	
	4010	-5.0		-6.5	16.9	-7.9	23.5	
Wall EL-2.0m ~EL4.65m	6043	-2.3	-25.9	-6.7	-2.4	-9.7	-6.0	372.2
	4036	-1.5		-7.0	-8.5	0.9	-3.3	
	4040	-3.6		-8.2	1.8	-4.9	-9.2	
Wall EL4.65m ~EL9.06m	6081	-1.0	-25.9	-3.2	-2.8	-5.3	-4.5	372.2
	4066	-6.8		-4.3	-1.1	-18.1	69.4	
	4070	-4.2		2.5	36.1	-7.9	36.9	
Wall EL9.06m ~EL13.8m	6117	-2.4	-25.9	-0.1	-0.2	8.4	-7.2	372.2
	4096	-1.1		-1.6	-1.6	1.9	-3.6	
	4100	-0.3		8.5	1.9	4.2	1.3	

Note: Negative value means compression.

Table 3G.2-19

Rebar and Concrete Stresses (Basemat and Slabs): Selected Load Combination CB-4

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				X-direction		Y-direction		
				Top	Bottom	Top	Bottom	
Basemat EL-7.4m	67	-1.5	-23.5	-7.0	-2.0	-9.6	-1.0	372.2
	72	-2.8		-19.0	5.8	-5.5	13.5	
	115	-1.8		-8.7	0.1	-6.3	-0.7	
	120	-1.9		-12.2	0.6	-6.7	0.7	
Slab B1F EL-2.0m	567	-4.6	-29.3	-12.7	-24.5	0.9	-1.4	372.2
	572	-3.9		-20.3	-23.1	-9.0	-10.2	
	615	-3.1		-9.8	-16.0	-4.0	-3.9	
	620	-5.2		60.1	6.4	81.8	7.0	
Slab 1F EL4.65m	1067	-9.7	-29.3	-30.3	20.4	-7.6	23.5	372.2
	1072	-3.7		-6.6	-12.6	-23.0	-23.2	
	1115	-8.0		-14.1	-19.0	102.4	-18.1	
	1120	-6.9		-21.4	-23.7	-22.4	-13.7	
Slab 2F EL9.06m	1567	-4.8	-29.3	-28.8	-19.8	2.5	-13.1	372.2
	1572	-6.3		31.1	3.8	-30.2	-39.0	
	1615	-3.8		-19.2	-19.9	72.5	2.3	
	1620	-14.2		75.0	38.8	76.2	37.5	
Slab RF EL13.8m	1867	-0.6	-29.3	-25.8	55.3	45.7	-14.0	372.2
	1872	-4.6		82.0	10.5	96.1	-6.6	
	1915	-3.9		62.0	11.3	78.2	-10.4	
	1920	-10.2		142.2	7.5	146.2	-16.4	

Note: Negative value means compression.

Table 3G.2-20

Rebar and Concrete Stresses (Walls): Selected Load Combination CB-4

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Horizontal direction		Vertical direction		
				Inside	Outside	Inside	Outside	
Wall EL-7.4m ~EL-2.0m	6007	-3.7	-29.3	-0.6	33.6	0.0	41.3	372.2
	4006	-6.7		-1.9	2.0	-13.3	51.8	
	4010	-4.4		-7.7	18.7	-1.5	29.3	
Wall EL-2.0m ~EL4.65m	6043	-3.4	-29.3	-7.5	0.3	-15.5	-5.3	372.2
	4036	-1.6		-7.1	-2.0	-8.2	-5.4	
	4040	-2.7		10.1	16.6	24.8	-2.2	
Wall EL4.65m ~EL9.06m	6081	-7.1	-29.3	17.9	76.7	-29.2	22.6	372.2
	4066	-10.5		18.6	85.3	-36.0	76.0	
	4070	-9.7		11.3	120.7	-16.3	86.1	
Wall EL9.06m ~EL13.8m	6117	-12.8	-29.3	30.0	102.5	-20.9	105.2	372.2
	4096	-7.7		15.8	58.3	-16.5	58.5	
	4100	-7.0		26.3	80.6	0.7	98.0	

Note: Negative value means compression.

Table 3G.2-21

Rebar and Concrete Stresses (Basemat and Slabs): Selected Load Combination CB-7

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				X-direction		Y-direction		
				Top	Bottom	Top	Bottom	
Basemat EL-7.4m	67	-1.1	-23.5	-4.9	-1.9	-7.0	-1.7	372.2
	72	-2.1		-14.0	3.4	-3.8	7.3	
	115	-1.4		-7.2	0.0	-4.7	-0.9	
	120	-1.4		-9.2	0.3	-5.0	0.2	
Slab B1F EL-2.0m	567	-3.7	-29.3	-9.5	-19.4	4.4	0.0	372.2
	572	-3.1		-15.3	-17.8	-6.5	-7.8	
	615	-2.4		-6.9	-12.4	-2.8	-2.8	
	620	-4.2		52.4	5.9	69.3	6.0	
Slab 1F EL4.65m	1067	-9.5	-29.3	-21.7	39.5	-5.8	27.1	372.2
	1072	-2.9		-4.9	-9.9	-17.4	-17.8	
	1115	-7.2		-9.9	-14.2	95.1	-16.0	
	1120	-5.3		-16.2	-18.4	-17.0	-10.6	
Slab 2F EL9.06m	1567	-4.0	-29.3	-23.3	-14.4	2.4	-10.2	372.2
	1572	-4.9		25.6	3.3	-22.9	-30.0	
	1615	-3.3		-14.6	-15.1	66.6	1.0	
	1620	-11.0		59.2	31.3	60.0	30.6	
Slab RF EL13.8m	1867	-3.5	-29.3	34.8	14.6	71.8	-7.2	372.2
	1872	-3.6		65.4	8.4	77.3	-5.0	
	1915	-3.2		51.5	8.2	63.8	-8.2	
	1920	-7.8		109.0	5.9	112.2	-12.5	

Note: Negative value means compression.

Table 3G.2-22

Rebar and Concrete Stresses (Walls): Selected Load Combination CB-7

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Horizontal direction		Vertical direction		
				Inside	Outside	Inside	Outside	
Wall EL-7.4m ~EL-2.0m	6007	-3.0	-29.3	-1.3	22.4	-2.4	28.7	372.2
	4006	-5.5		-1.4	1.9	-12.9	36.8	
	4010	-3.5		-5.6	16.9	-1.4	25.3	
Wall EL-2.0m ~EL4.65m	6043	-2.9	-29.3	-5.7	0.9	-13.6	-5.9	372.2
	4036	-1.2		-5.3	-1.3	-6.7	-5.4	
	4040	-2.0		6.0	13.1	17.6	-3.2	
Wall EL4.65m ~EL9.06m	6081	-5.3	-29.3	13.9	58.7	-22.7	15.3	372.2
	4066	-8.1		14.4	65.8	-28.2	56.4	
	4070	-7.0		8.2	84.9	33.8	60.0	
Wall EL9.06m ~EL13.8m	6117	-9.8	-29.3	23.0	79.0	-16.2	80.1	372.2
	4096	-5.9		12.3	45.6	-12.9	43.6	
	4100	-5.4		20.6	62.7	0.2	75.1	

Note: Negative value means compression.

Table 3G.2-23

Rebar and Concrete Stresses (Basemat and Slabs): Selected Load Combination CB-9

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				X-direction		Y-direction		
				Top	Bottom	Top	Bottom	
Basemat EL-7.4m	67	-6.9	-23.5	-21.1	41.1	-41.2	67.0	372.2
	72	-9.1		57.7	86.2	96.1	276.5	
	115	-8.2		228.2	112.7	231.0	41.5	
	120	-5.9		-29.8	70.3	-24.0	72.1	
Slab B1F EL-2.0m	567	-10.4	-29.3	-28.9	-48.8	69.9	-21.2	372.2
	572	-5.6		-30.0	-28.3	-16.4	-28.1	
	615	-7.7		46.8	-35.0	30.8	-8.8	
	620	-8.8		99.7	-31.3	127.8	-27.9	
Slab 1F EL4.65m	1067	-21.6	-29.3	-42.8	156.6	-20.8	58.5	372.2
	1072	-6.0		-17.4	-20.3	-35.1	-24.7	
	1115	-12.9		-30.4	-22.6	163.9	-36.9	
	1120	-9.5		-32.5	-27.5	-35.0	-21.8	
Slab 2F EL9.06m	1567	-7.5	-29.3	-40.2	-31.0	1.5	-17.5	372.2
	1572	-7.5		17.7	22.5	-43.4	-49.6	
	1615	-7.3		-42.5	-41.7	153.1	50.0	
	1620	-17.5		120.7	103.1	125.8	96.5	
Slab RF EL13.8m	1867	-11.4	-29.3	157.6	140.6	199.8	-37.4	372.2
	1872	-7.1		230.0	78.5	258.2	66.8	
	1915	-10.1		257.0	76.9	251.8	-25.2	
	1920	-14.5		231.5	16.7	214.9	-21.8	

Note: Negative value means compression.

Table 3G.2-24

Rebar and Concrete Stresses (Walls): Selected Load Combination CB-9

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Horizontal direction		Vertical direction		
				Inside	Outside	Inside	Outside	
Wall EL-7.4m ~EL-2.0m	6007	-10.2	-29.3	82.7	279.2	135.2	297.7	372.2
	4006	-17.8		32.1	230.6	49.6	338.0	
	4010	-11.3		48.0	135.6	41.1	182.4	
Wall EL-2.0m ~EL4.65m	6043	-9.7	-29.3	42.8	166.5	-35.5	179.8	372.2
	4036	-5.5		76.6	124.7	118.9	165.8	
	4040	-6.8		84.5	122.2	132.3	126.6	
Wall EL4.65m ~EL9.06m	6081	-14.7	-29.3	38.4	237.4	-45.8	255.9	372.2
	4066	-19.9		46.3	264.3	-42.3	313.3	
	4070	-16.4		30.4	231.9	-23.8	268.7	
Wall EL9.06m ~EL13.8m	6117	-24.2	-29.3	70.4	286.0	-32.7	260.8	372.2
	4096	-23.3		53.9	302.5	-26.4	284.4	
	4100	-17.8		39.1	229.9	26.4	279.7	

Note: Negative value means compression.

Table 3G.2-25

Calculation Results for Transverse Shear

Location	Element ID	Load ID	d (m)	ρ_w (%)	ρ_v (%)	Shear Forces (MN/m)				Vu/ϕVn
						Vu	Vc	Vs	ϕVn	
Basemat EL-7.4m	67	CB-7	2.776	0.272	0.000	0.255	4.697	0.000	3.992	0.064
	72	CB-3	2.740	0.276	0.000	0.704	4.924	0.000	4.185	0.168
	115	CB-9	2.818	0.268	0.242	2.094	2.285	2.823	4.342	0.482
	120	CB-3	2.740	0.276	0.000	0.567	4.762	0.000	4.048	0.140
Slab B1F EL-2.0m	567	CB-3	0.365	1.384	0.000	0.123	0.862	0.000	0.733	0.168
	572	CB-3	0.360	1.402	0.000	0.130	0.974	0.000	0.828	0.157
	615	CB-3	0.360	1.403	0.000	0.069	0.755	0.000	0.641	0.107
	620	CB-3	0.400	1.262	0.000	0.074	0.274	0.000	0.233	0.316
Slab 1F EL4.65m	1067	CB-3	0.374	1.350	0.000	0.047	0.358	0.000	0.304	0.156
	1072	CB-3	0.360	1.402	0.000	0.174	0.801	0.000	0.681	0.256
	1115	CB-3	0.410	1.232	0.000	0.249	0.417	0.000	0.354	0.703
	1120	CB-3	0.372	1.358	0.000	0.057	0.331	0.000	0.281	0.204
Slab 2F EL9.06m	1567	CB-3	0.373	1.355	0.000	0.026	0.360	0.000	0.306	0.085
	1572	CB-3	0.360	1.403	0.000	0.124	0.322	0.000	0.274	0.453
	1615	CB-9	0.410	1.232	0.323	0.270	0.316	0.548	0.734	0.368
	1620	CB-3	0.391	1.293	0.000	0.042	0.405	0.000	0.344	0.122
Slab RF EL13.8m	1867	CB-3	0.561	0.898	0.000	0.022	0.526	0.000	0.447	0.050
	1872	CB-3	0.550	0.915	0.000	0.113	0.592	0.000	0.503	0.225
	1915	CB-3	0.600	0.839	0.000	0.183	0.617	0.000	0.525	0.349
	1920	CB-3	0.585	0.860	0.000	0.029	0.561	0.000	0.477	0.060
Wall EL-7.4m ~EL-2.0m	6007	CB-9	0.674	1.495	0.355	0.340	0.307	0.991	1.103	0.309
	4006	CB-9	0.672	1.500	0.710	1.210	0.173	1.975	1.826	0.663
	4010	CB-9	0.672	1.500	0.710	0.815	0.521	1.975	2.122	0.384
Wall EL-2.0m ~EL4.65m	6043	CB-9	0.674	1.495	0.355	0.922	0.603	0.991	1.355	0.681
	4036	CB-9	0.673	1.497	0.710	1.131	0.171	1.978	1.827	0.619
	4040	CB-9	0.684	1.474	0.710	0.503	0.478	2.011	2.115	0.238
Wall EL4.65m ~EL9.06m	6081	CB-7	0.673	1.497	0.000	0.123	1.353	0.000	1.150	0.107
	4066	CB-4	0.673	1.498	0.000	0.114	0.676	0.000	0.574	0.198
	4070	CB-9	0.685	1.472	0.177	0.323	0.318	0.502	0.697	0.464
Wall EL9.06m ~EL13.8m	6117	CB-4	0.493	1.533	0.000	0.197	0.508	0.000	0.432	0.456
	4096	CB-4	0.493	1.533	0.000	0.293	0.570	0.000	0.484	0.605
	4100	CB-9	0.501	1.510	0.323	0.392	0.235	0.670	0.770	0.510

Table 3G.2-26

Factors of Safety for Foundation Stability

Load Combination	Overturning		Sliding		Floatation	
	Required	Actual	Required	Actual	Required	Actual
D + H + E'	1.1	62.5	1.1	1.16	--	--
D + F'	--	--	--	--	1.1	1.85

Where,

D = Dead Load

H = Lateral soil pressure

E' = Safe Shutdown Earthquake

F' = Buoyant forces of design basis flood

Table 3G.2-27

Maximum Soil Bearing Stress Involving SSE

	Site Condition*		
	Soft (V_s = 300 m/sec)	Medium (V_s = 800 m/sec)	Hard ($V_s \geq$ 1700 m/sec)
Bearing Stress (MPa)	2.8	2.5	2.4

* See Table 3A.3-1 for site properties. For site specific application, use the larger value or a linearly interpolated value of the applicable range of shear wave velocities at the foundation level.

Figure 3G.2-1. CB Concrete Outline Plan at EL -7400 and Foundation Reinforcement

Figure 3G.2-2. CB Concrete Outline Plan at EL –2000/4850 and Section Details

Figure 3G.2-3. CB Concrete Outline Plan at EL 9060, Section and Section Detail

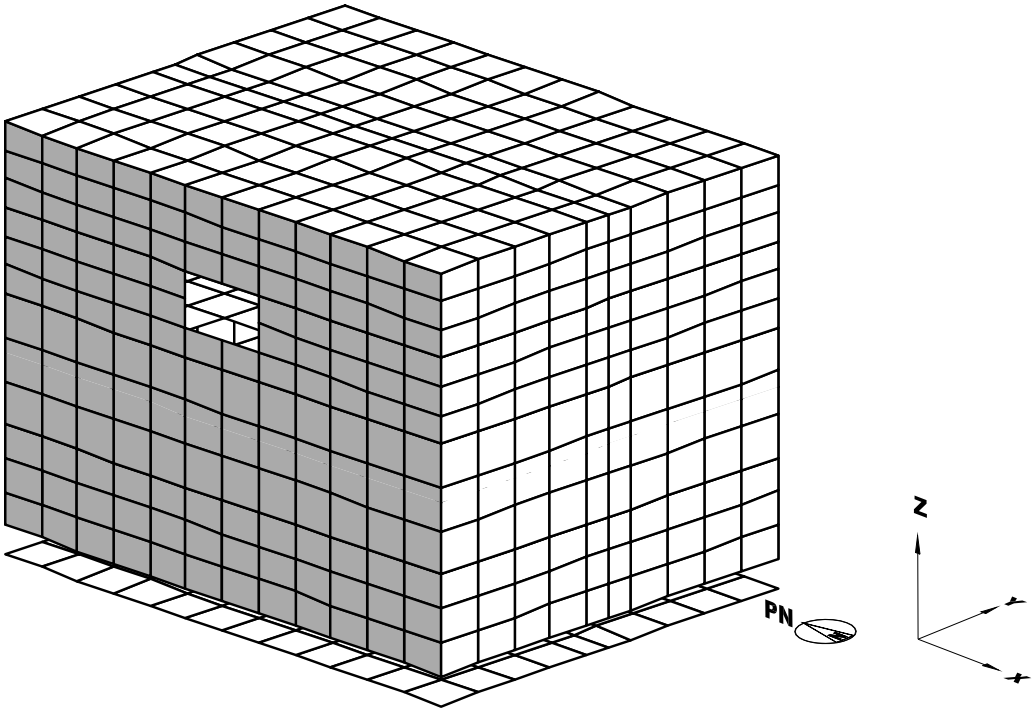

Whole View

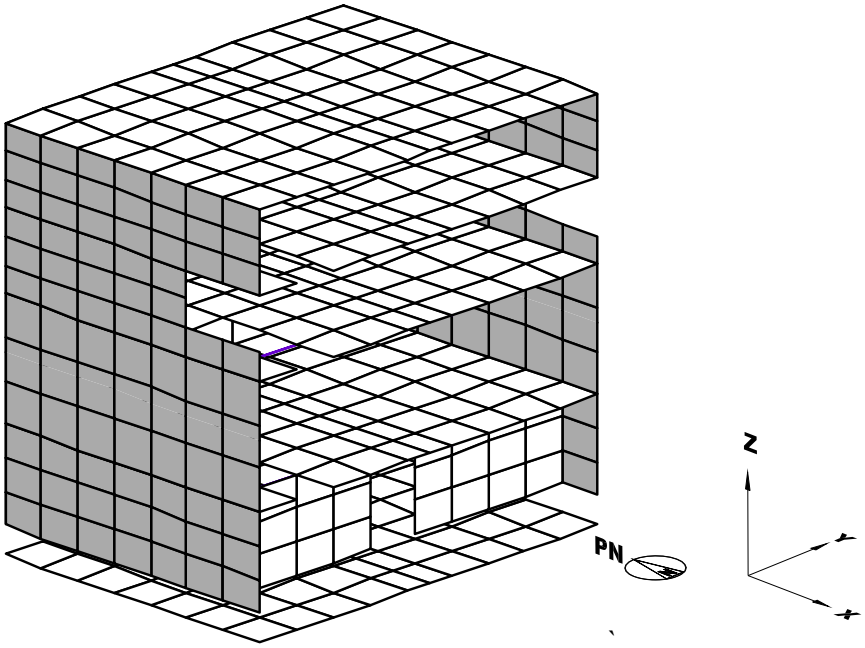

Cut View

Figure 3G.2-4. FE Model of CB (Isometric View)

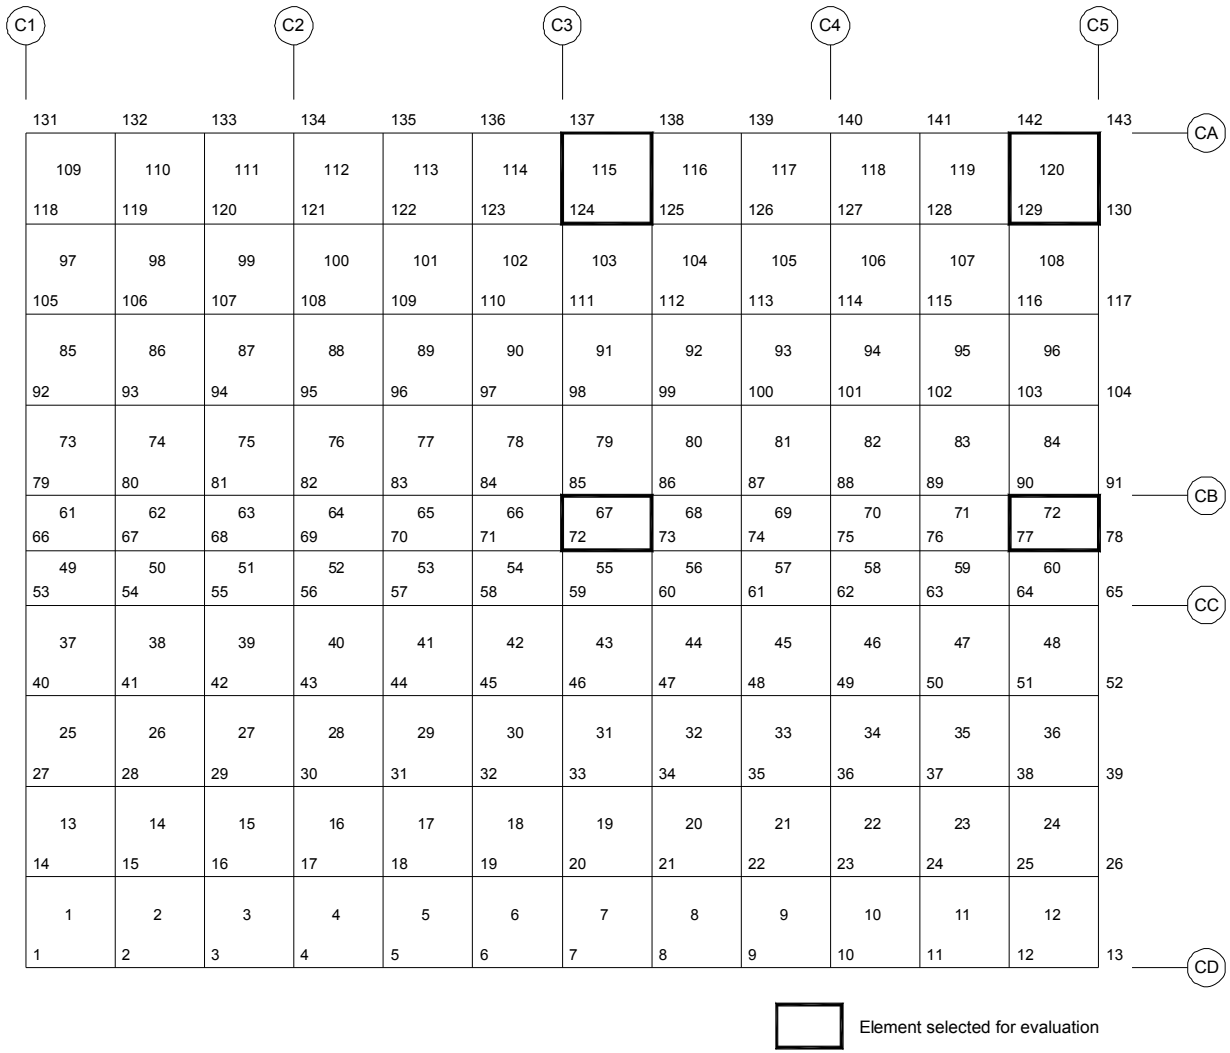

Figure 3G.2-5. FE Model of CB (Foundation Mat)

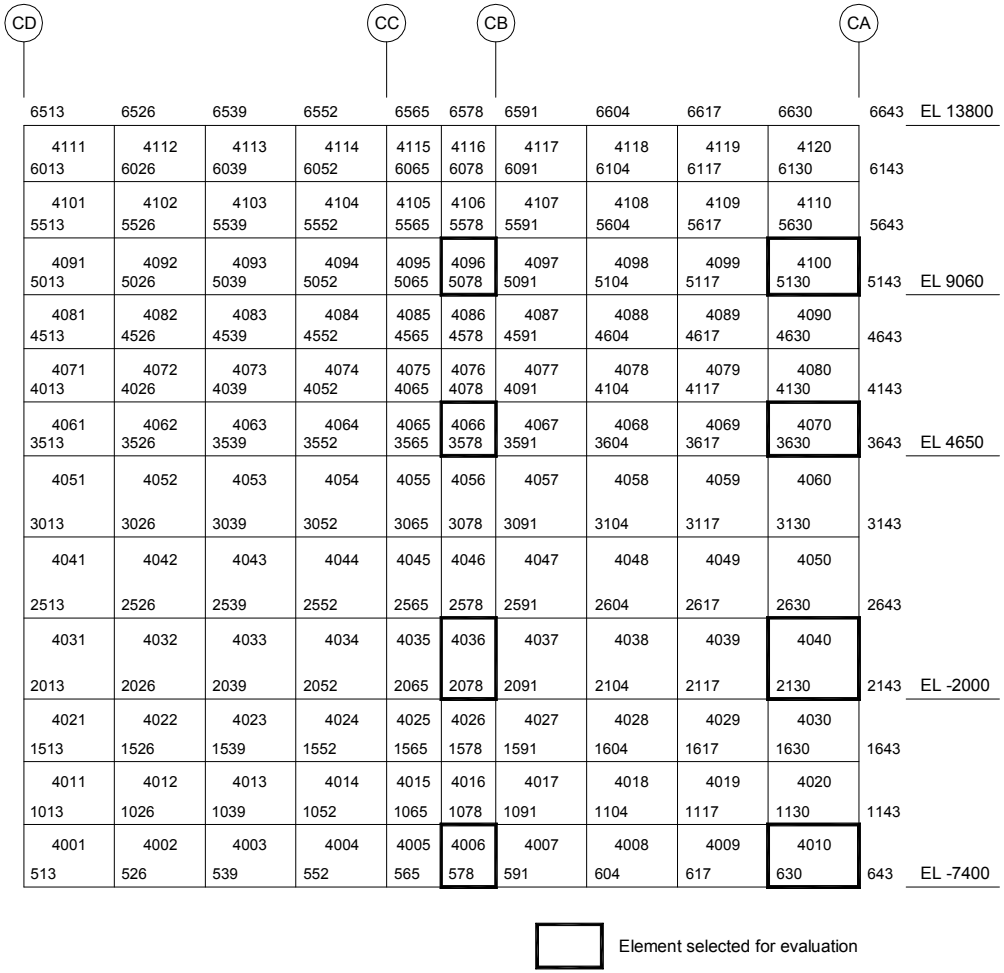

Figure 3G.2-6. FE Model of CB (External Wall: South Side)

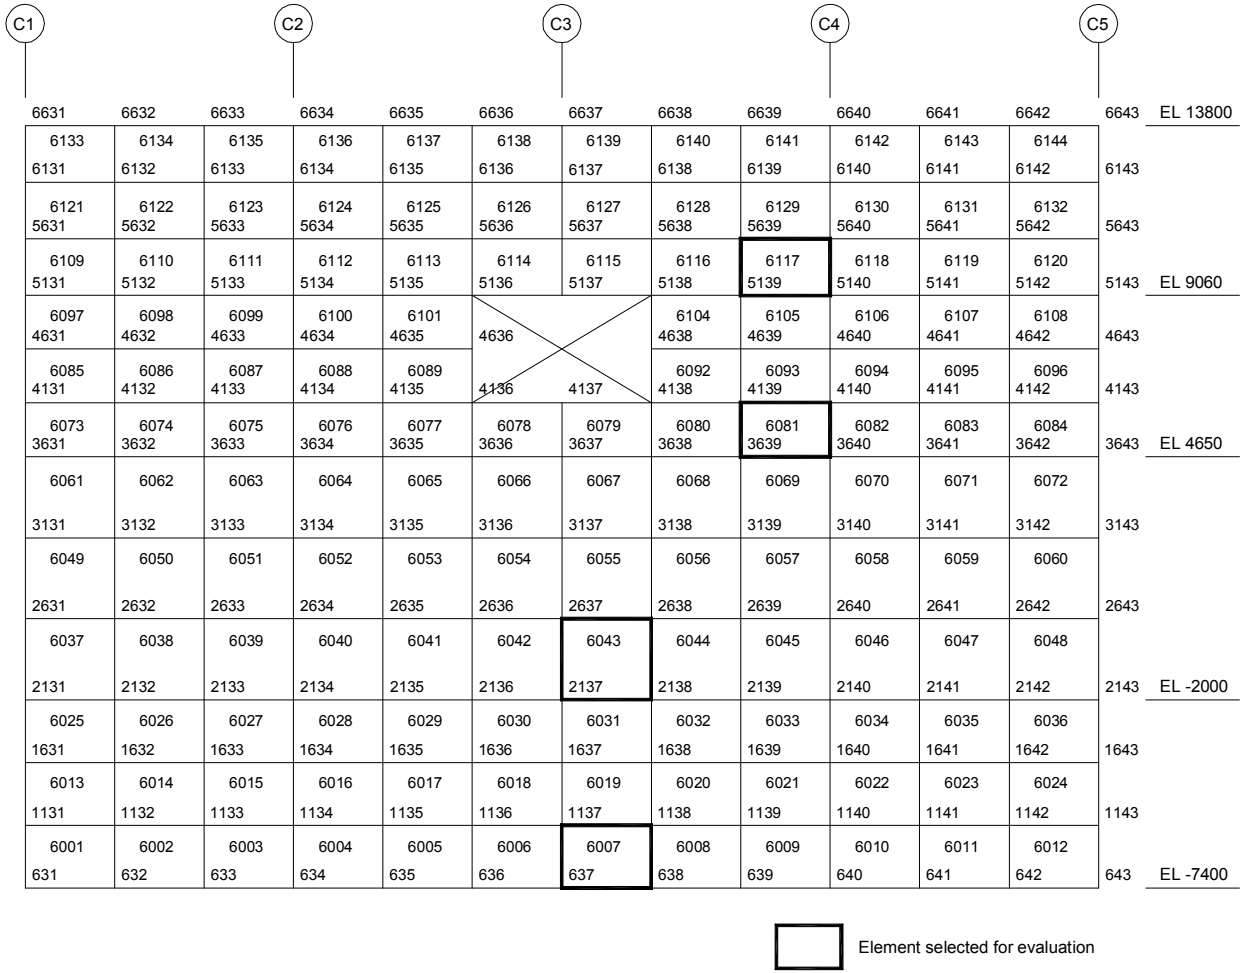

Figure 3G.2-7. FE Model of CB (External Wall: East Side)

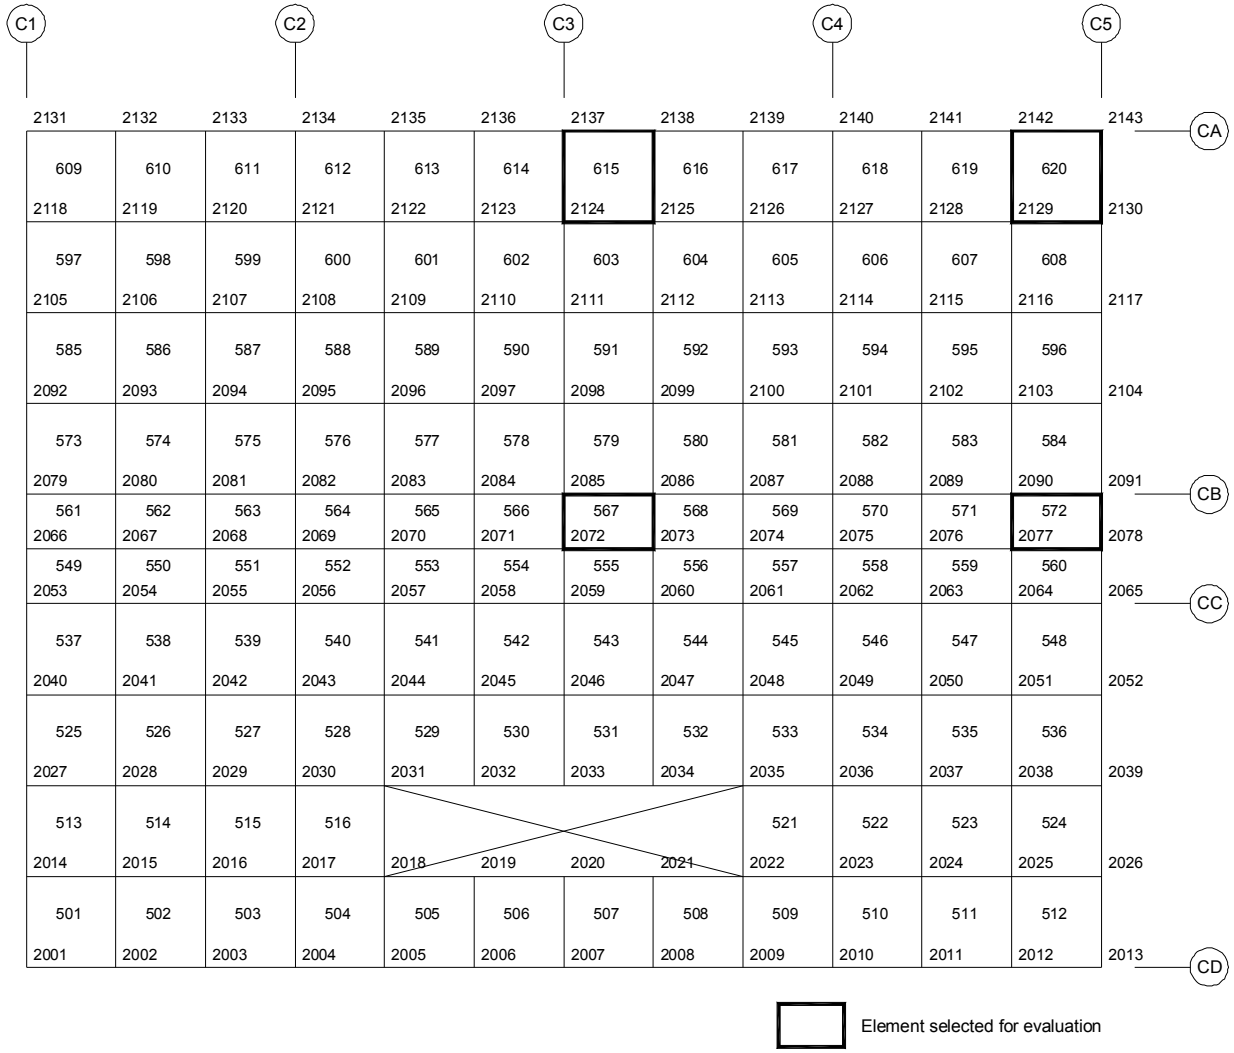

Figure 3G.2-8. FE Model of CB (Floor Slab: EL -2000)

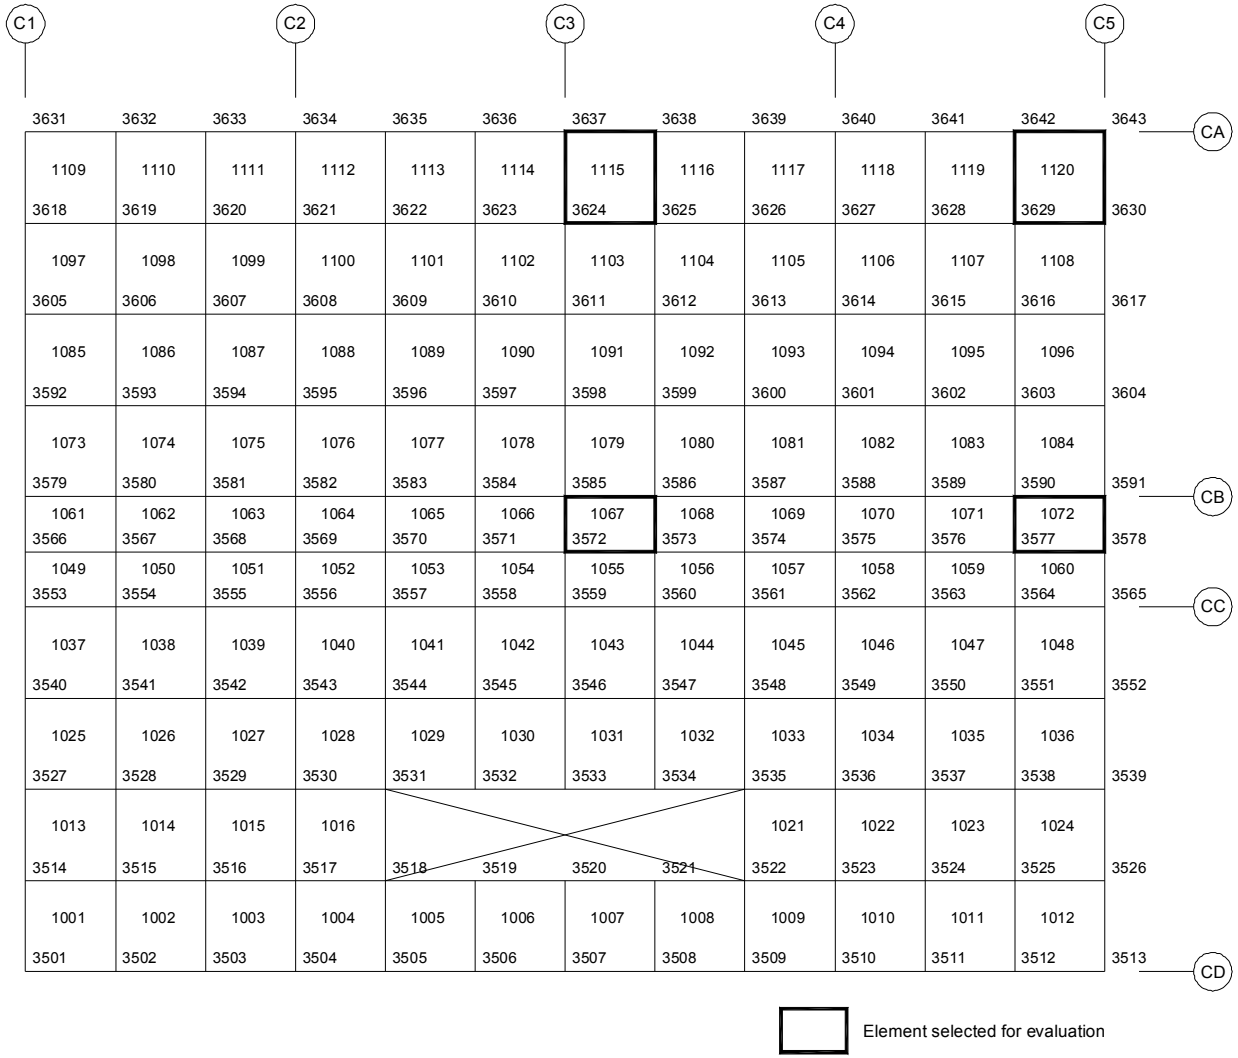

Figure 3G.2-9. FE Model of CB (Floor Slab: EL 4650)

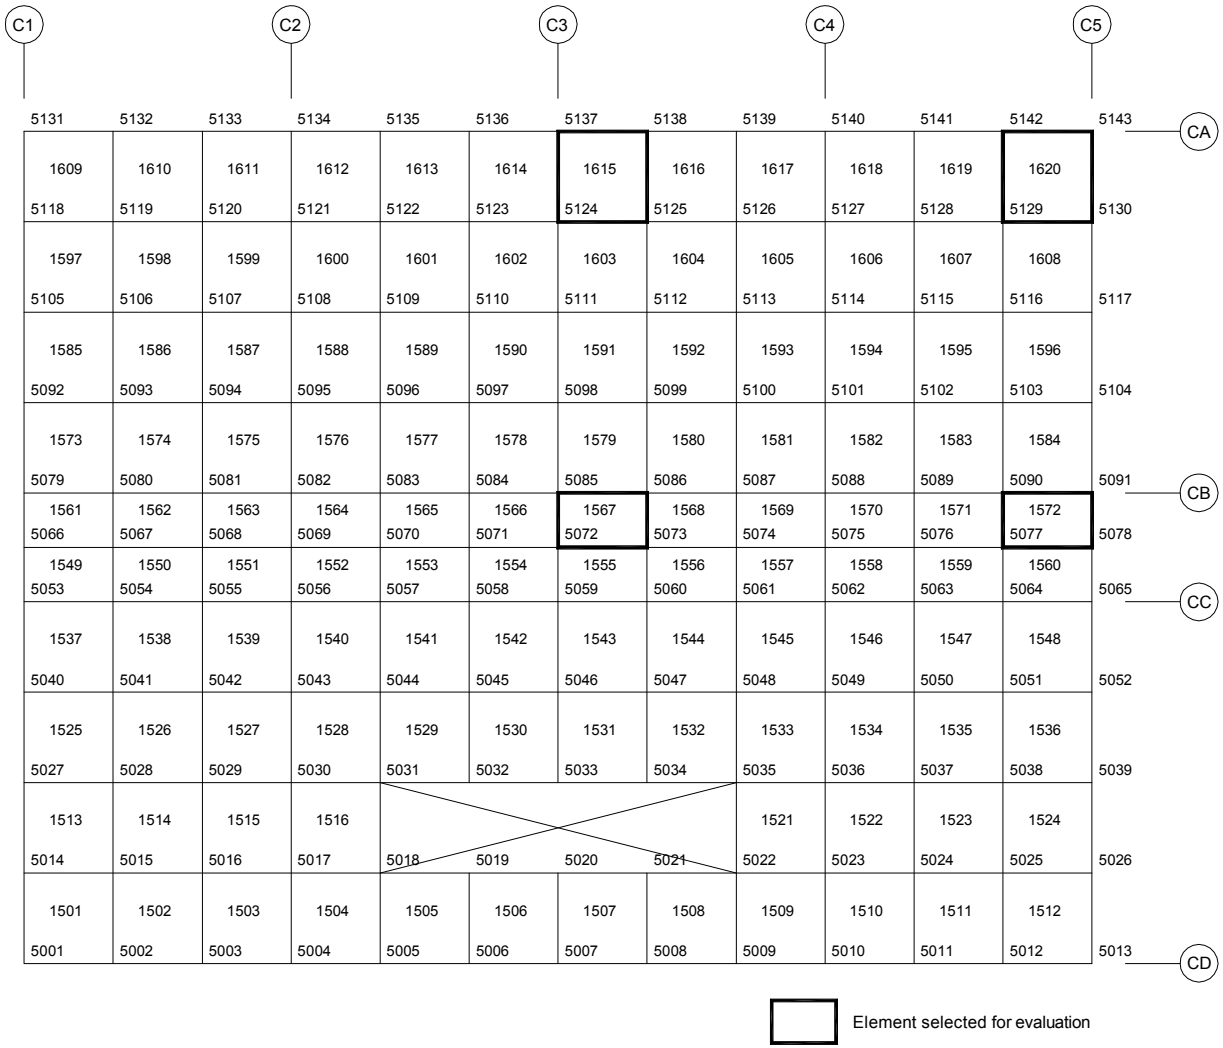

Figure 3G.2-10. FE Model of CB (Floor Slab: EL 9060)

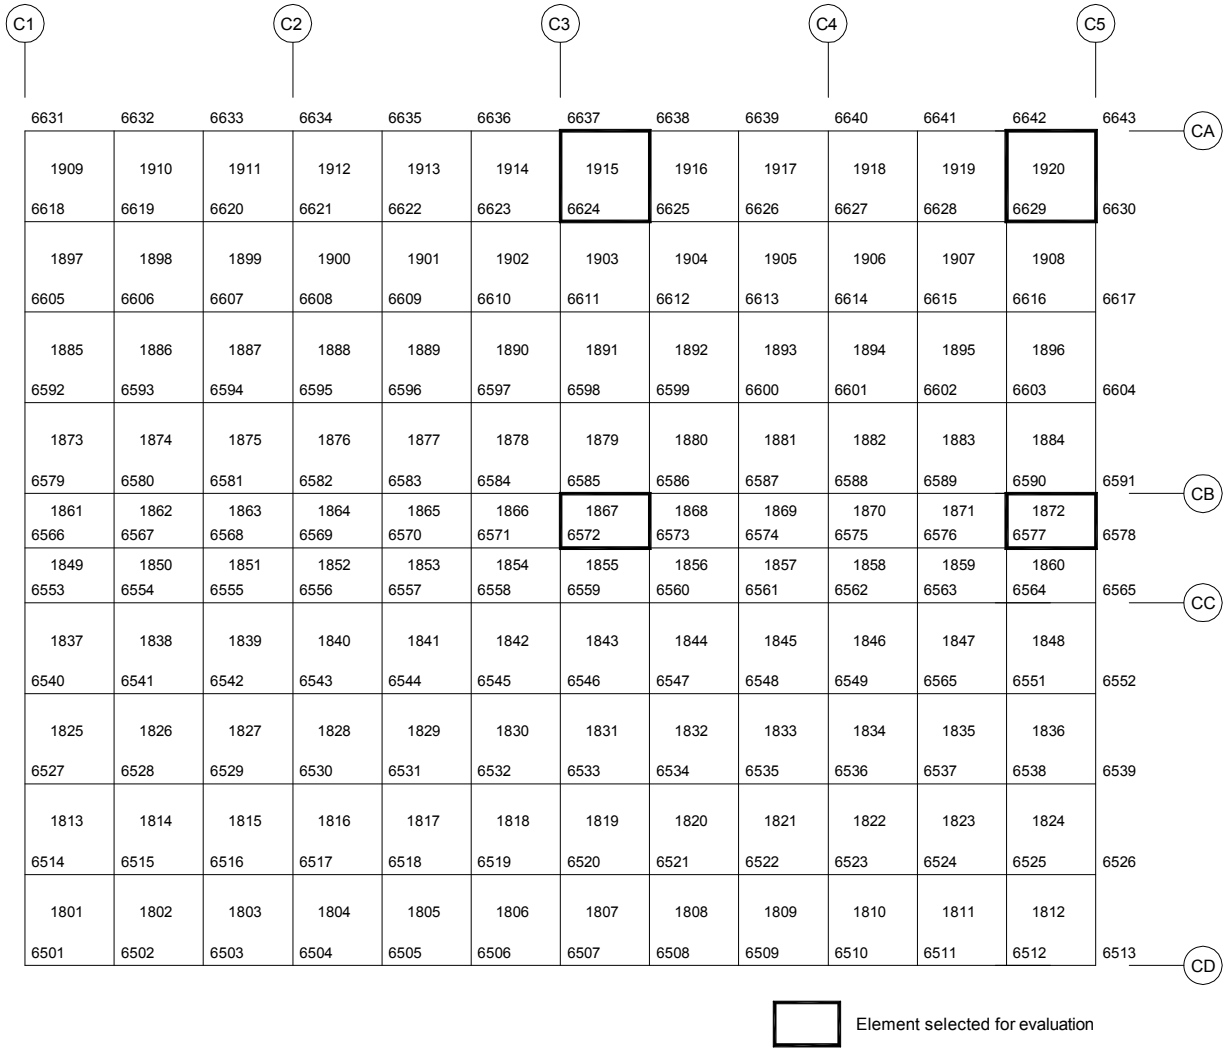

Figure 3G.2-11. FE Model of CB (Roof: EL 13800)

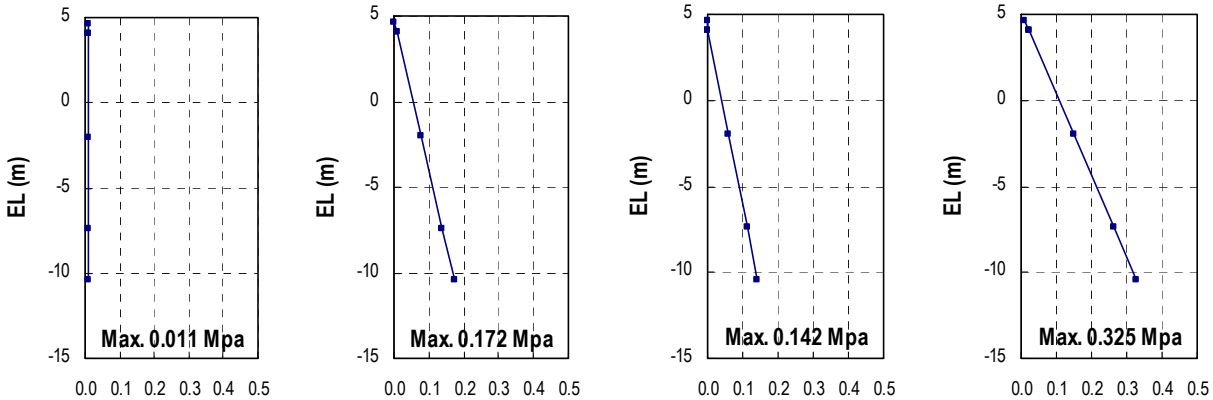

Surcharge (MPa) + Soil Pressure (MPa) + Hydrostatic (MPa) = Total (MPa)

Pressure on Walls CA, CD & C1

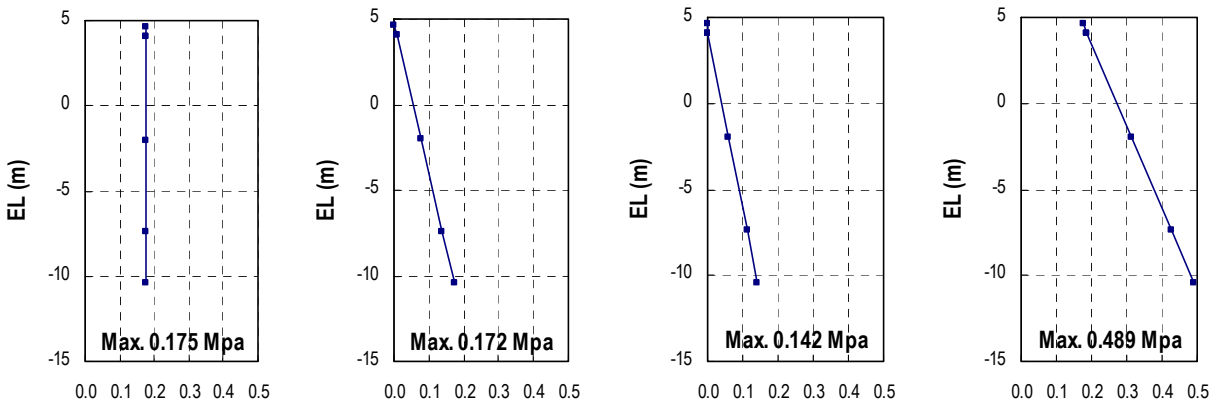

Surcharge (MPa) + Soil Pressure (MPa) + Hydrostatic (MPa) = Total (MPa)

Pressure on Wall C5

Figure 3G.2-12. Soil Pressure at Rest

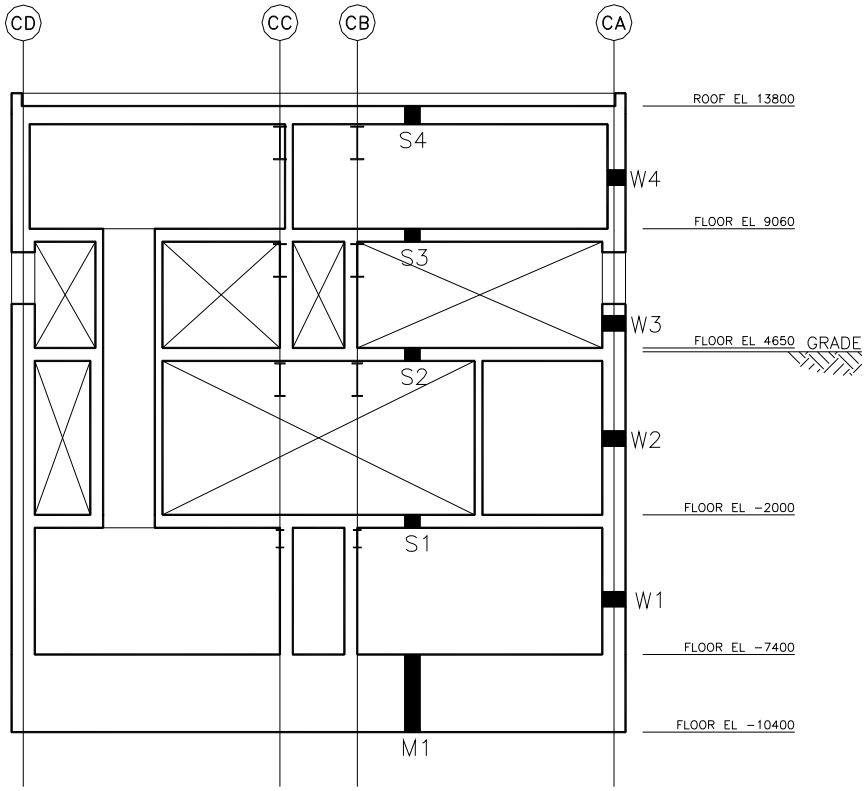

Figure 3G.2-13. Sections Where Thermal Loads Are Defined

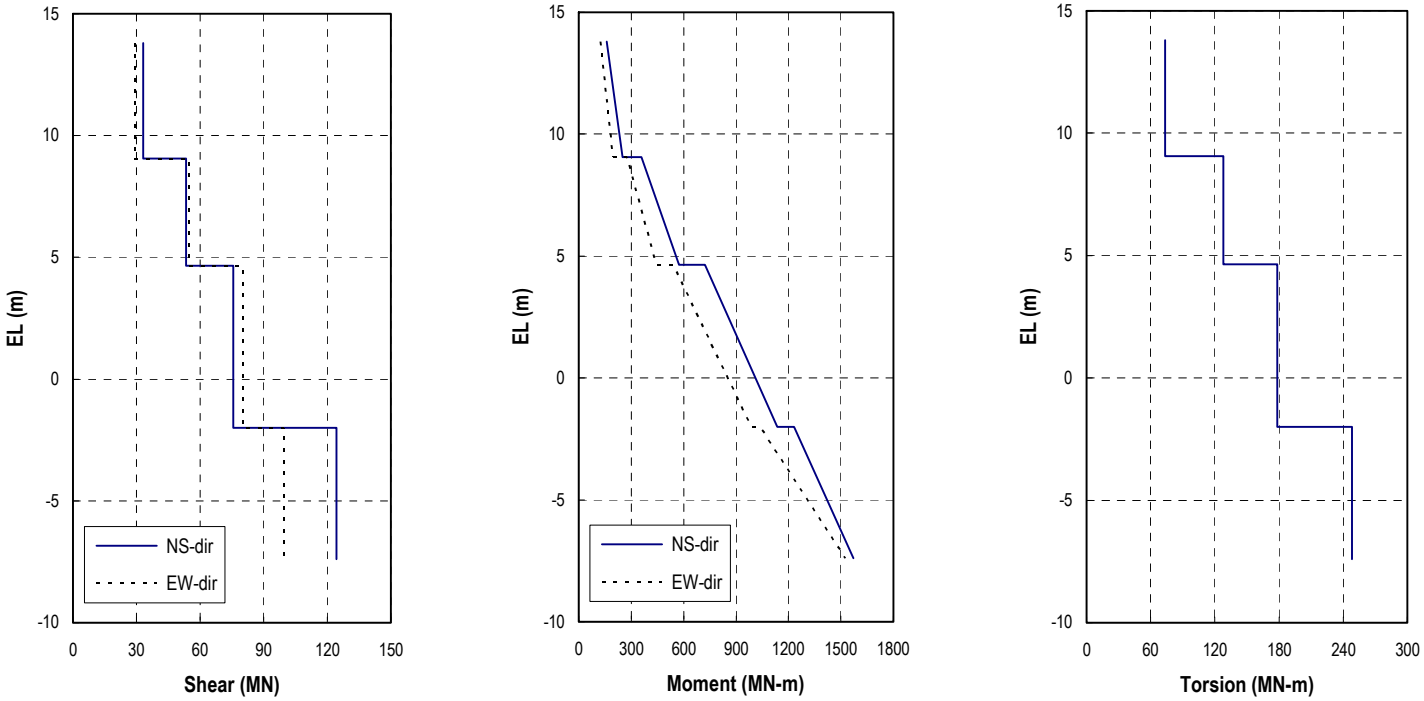

Figure 3G.2-14. Design Seismic Shears and Moments for CB

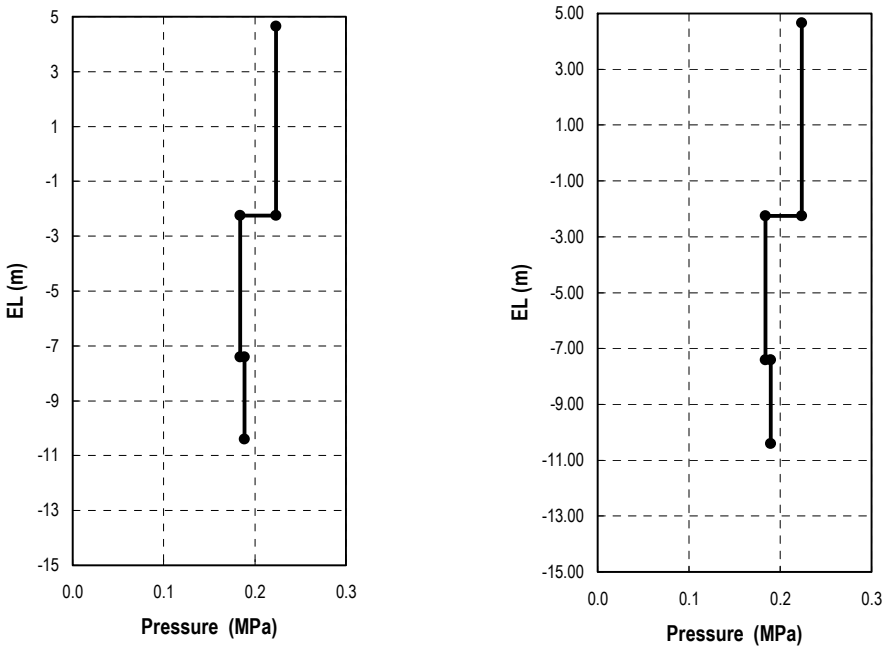

C1 Wall and C5 Wall CA Wall and CD Wall

Figure 3G.2-15. Seismic Lateral Soil Pressure

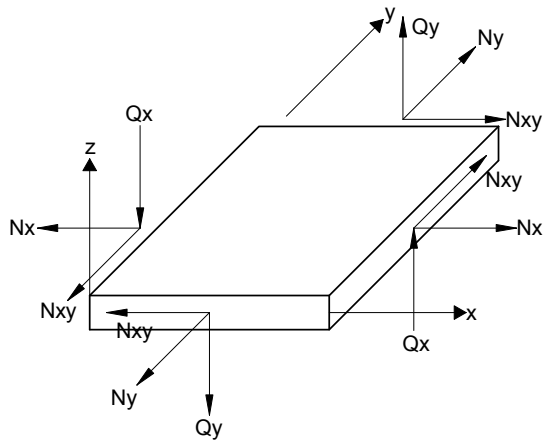

Membrane and Shear Forces

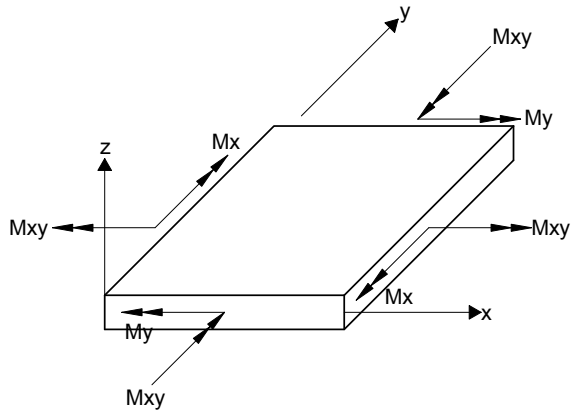

Moments

Definition of Element Coordinate System

Structure	x	y	z
Wall in N-S Direction	horizontal	vertical	toward West
Wall in E-W Direction	horizontal	vertical	toward South
Foundation Mat Floor Slab	toward South	toward East	upward

Figure 3G.2-16. Force and Moment in Shell Element

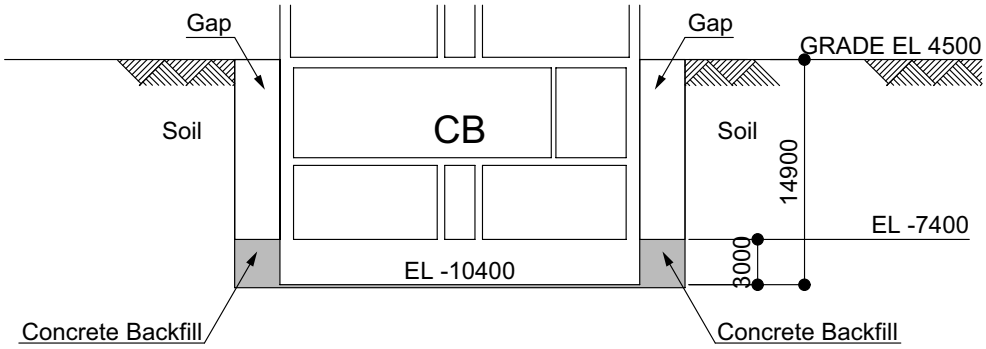

Note: Backfill method for gap and excavation method (e.g., vertical cut, open cut) is determined considering actual site conditions. The gap is completely filled with compacted engineered backfill material.

Figure 3G.2-17. Concrete Backfill in Sliding Evaluation

3G.3 FUEL BUILDING

3G.3.1 Objective and Scope

The objective of this subsection is to document the structural design details, inputs and analytical results from the analysis the Fuel Building (FB) of the standard ESBWR plant. The scope includes the design and analysis of the structure for normal, severe environmental, extreme environmental, and construction loads.

3G.3.2 Conclusions

The following are the major summary conclusions on the design and analysis of the FB.

- Based on the results of finite element analyses performed in accordance with the design conditions identified in Subsection 3G.3.5, stresses in concrete and reinforcement are less than the allowable stresses per the applicable regulations, codes or standards listed in Section 3.8.
- The factors of safety against floatation, sliding, and overturning of the structure under various loading combinations are higher than the required minimum.
- The thickness of the roof slabs and exterior walls are more than the minimum required to preclude penetration, perforation or spalling resulting from impact of design basis tornado missiles.

3G.3.3 Structural Description

The FB is integrated with the RB, sharing a common wall between the RB and the FB and a large common foundation mat (see Subsection 3.8.4.1.3). The FB houses the spent fuel pool facilities and their supporting system, and HVAC equipment. The FB is a Seismic Category I structure except for the penthouse that covers HVAC equipment. The penthouse is a Seismic Category II structure.

The FB is a reinforced concrete box type shear wall structure consisting of walls and slabs and is supported by a foundation mat. Concrete framing (steel beams can be used partially) is composite with concrete slab and used to support the slabs for vertical loads. The FB is a shear wall structure designed to accommodate all seismic loads with its walls and the connected floors. Therefore, frame members such as beams or columns are designed to accommodate deformations of the walls in case of earthquake conditions.

The key dimensions of the FB are summarized in Table 3.8-8. Figures 3G.1-1 through 3G.1-4 and Figure 3G.1-6 show the outline plans of the FB.

3G.3.4 Analytical Models

Because the FB is integrated with the RB, the finite element model which integrates the RB and FB is used for the stress analysis of the FB. The analysis model is described in Subsection 3G.1.4.1.

3G.3.5 Structural Analysis and Design

3G.3.5.1 Site Design Parameters

The key site design parameters are described in Subsection 3G.1.5.1.

3G.3.5.2 Design Loads, Load Combinations, and Material Properties

3G.3.5.2.1 Design Loads

This section presents only the loads which are applied to the FB directly. Other loads which are applied to the RCCV only but have effects on FB structures because of common foundation mat, like P_a and T_a, are also considered in the FB design.

3G.3.5.2.1.1 Dead Load (D) and Live Load (L and Lo)

The weights of structures are evaluated using the following unit weights.

- reinforced concrete: 23.5 kN/m^3 (150 lbf/ft^3)
- steel: 77.0 kN/m^3 (490 lbf/ft^3)

Weights of major equipment, miscellaneous structures, piping, and commodities are summarized in Tables 3G.3-1 and 3G.3-2.

Live loads on the FB floor and roof slabs are described in Subsection 3.8.4.3.3.

3G.3.5.2.1.2 Snow and Rain Load

The snow and rain load is applied to the roof slab and is taken as shown in Table 3G.1-2. One hundred percent of the snow load is applied when combined with seismic loads.

3G.3.5.2.1.3 Lateral Soil Pressure at Rest

The lateral soil pressure at rest is applied to the walls below grade and is based on soil properties given in Table 3G.1-2. Pressures to be applied to the walls are provided in Figure 3G.1-19.

3G.3.5.2.1.4 Wind Load (W)

The wind load is applied to the roof slab and external walls above grade and is based on basic wind speed given in Table 3G.1-2.

3G.3.5.2.1.5 Tornado Load (W_t)

The tornado load is applied to roof slab and external walls above grade and its characteristics are given in Table 3G.1-2. The tornado load, W_t is further defined by the combinations described in Subsection 3G.1.5.2.1.5.

3G.3.5.2.1.6 Thermal Load (T_o)

Thermal loads for the FB are evaluated for the normal operating conditions. Figure 3G.3-1 shows the section location for temperature distributions for various structural elements of the FB, and Table 3G.3-3 shows the magnitude of equivalent linear temperature distribution.

Stress-free temperature is 15.5°C (60°F).

3G.3.5.2.1.7 Design Seismic Loads

The design seismic loads applied to the FB are provided in Subsection 3G.1.5.2.1.13.

Seismic lateral soil pressure for the FB is provided in Subsection 3G.1.5.2.1.13.

3G.3.5.2.2 Load Combinations and Acceptance Criteria

Table 3.8-15 gives load combinations for the safety-related reinforced concrete structure. Based on previous experience, critical load combinations are selected for the FB design. They are mainly combinations including LOCA loads and seismic loads as shown in Table 3G.3-4. The acceptance criteria for the selected combinations are also included in Table 3G.3-4.

3G.3.5.2.3 Material Properties

Properties of the materials used for the FB design analyses are the same as those for the RB, and they are described in Subsection 3G.1.5.2.3.

3G.3.5.3 Stability Requirements

The stability requirements for the FB foundation are the same as the RB and are described in Subsections 3G.1.5.3 and 3G.1.5.5.

3G.3.5.4 Structural Design Evaluation

The evaluation of the seismic Category I structures in the FB is performed with the same procedure as the RB, which is described in Subsection 3G.1.5.4.

Figure 3G.3-2 shows the location of the sections that are selected for evaluation. They are selected, in principle, from the center and both ends of wall and slab, where it is reasonably expected that the critical stresses appear based on engineering experience and judgment. Tables 3G.3-5 through 3G.3-9 show the forces and moments at the selected sections from NASTRAN analysis. Element forces and moments listed in the tables are defined with relation to the element coordinate system shown in Figure 3G.3-3. Tables 3G.3-10 through 3G.3-12 show the combined forces and moments in accordance with the selected load combinations listed in Table 3G.3-4.

Figures 3G.3-4 and 3G.3-5 present the design drawings used for the evaluation of the FB structural design. Table 3G.3-13 lists the sectional thicknesses and rebar ratios used in the evaluation.

Tables 3G.3-14 through 3G.3-16 show the rebar and concrete stresses at these sections for the representative elements. Table 3G.3-17 summarizes evaluation results for transverse shear in accordance with ACI 349, Chapter 11.

3G.3.5.4.1 Shear Walls and Spent Fuel Pool Walls

The maximum rebar stress of 353.2 MPa (51.23 ksi) is found in the horizontal rebar at Section 3 due to the load combination FB-9 as shown in Table 3G.3-16. The maximum vertical rebar stress is found to be 334.0 MPa (48.44 ksi) at Section 3 for the combination FB-9. The maximum transverse shear force is found to be 3.84 MN/m (21.93 kips/in) against the shear strength of 5.88 MN/m (33.58 kips/in) at Section 4, Spent Fuel Pool wall.

3G.3.5.4.2 Floor Slabs

The maximum rebar stress of 249.1 MPa (36.13 ksi) is found due to the load combination FB-9 as shown in Table 3G.3-16. The maximum transverse shear force is found to be 0.48 MN/m (2.74 kips/in) against the shear strength of 4.36 MN/m (24.9 kips/in).

3G.3.5.4.3 Foundation Mat

The maximum rebar stress is found to be 282.4 MPa (40.96 ksi) due to the load combination FB-9 as shown in Table 3G.3-16. The maximum transverse shear force is found to be 12.88 MN/m (73.55 kips/in) against the shear strength of 18.93 MN/m (108.09 kips/in).

3G.3.5.5 Foundation Stability

The FB shares the foundation mat with the RB. Evaluation results of the foundation stability are described in Subsection 3G.1.5.5.

3G.3.5.6 Tornado Missile Evaluation

The minimum thickness required to prevent penetration, concrete spalling and scabbing is evaluated. The methods and procedures are shown in Subsection 3.5.3.1.1. The minimum thickness required is less than the minimum 1000 mm (39.4 in) and 700 mm (27.6 in) thickness provided for the FB external walls and slab at EL 22500, respectively.

Table 3G.3-1

Miscellaneous Structures and Commodity in Spent Fuel Pool

Description	Weight
Fuel Pool	
a. Spent Fuel Storage Racks	102 kN/m^2
b. Floor Liner	1.6 kN/m^2
c. Wall Liner	1.0 kN/m^2
d. Water (14.35 m)	141 kN/m^2
Pool Gate	
a. Spent Fuel Pool Gate	70 kN
b. Cask Pit Gate	70 kN
Spent Fuel Cask Pool	
a. Spent Fuel Cask	120 kN/m^2
b. Floor Liner	1.6 kN/m^2
c. Wall Liner	1.0 kN/m^2
d. Water (14.35 m)	141 kN/m^2
e. Cask Lid	100 kN
f. Cask bearing Plate	20 kN
Fuel Transfer Tube Pool	
a. Floor Liner	1.6 kN/m^2
b. Wall Liner	1.0 kN/m^2
c. Water (14.35 m)	141 kN/m^2
d. Transfer Tube Equipment	160 kN

Table 3G.3-2

Miscellaneous Structures, Piping, and Commodity Load on FB Floor

Elevation (mm)	Area Load
22,500	2.4 kN/m^2 (50psf)
4,650	2.4 kN/m^2 (50psf)
-1,000	2.4 kN/m^2 (50psf)
-6,400	2.4 kN/m^2 (50psf)
-11,500	2.4 kN/m^2 (50psf)

Table 3G.3-3

Equivalent Liner Temperature Distributions at Various Sections

Section*1	Side*2		Equivalent Linear Temperature*3 (°C)	
			Normal Operation (Winter)	
	1	2	T_d	T_g
W1	FP	RM	27.0	26.0
W2	FP	RM	26.6	26.7
W3	FP	GR	27.8	24.5
W4	FP	GR	27.8	24.5

*1: See Figure 3G.3-1 for the location of sections.

*2: FP: Spent Fuel Pool, RM: FB Room, GR: Ground

*3: T_d: Average Temperature, T_g: Surface Temperature Difference (positive when temperature at Side 1 is higher)

Table 3G.3-4

Selected Load Combinations for the FB

Category	Load Combination								Acceptance Criteria*1
	No. *2	D	L	P_a *3	T_o	T_a *3	E'	W	
Severe Environmental	FB-4	1.05	1.3		1.3			1.3	U
LOCA ($1.5P_a$) 72 hours	FB-8	1.0	1.0	1.5		1.0			U
LOCA + SSE 72 hours	FB-9	1.0	1.0	1.0		1.0	1.0		U

*1: U = Required section strength based on the strength design method per ACI 349

*2: Based on Table 3.8-15.

*3: P_a and T_a are accident pressure load within the containment and thermal load generated by LOCA, respectively.

P_a and T_a are indirect loads, but their effects are considered in the FB design.

Table 3G.3-5

Results of NASTRAN Analysis: Dead Load

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	-0.477	-1.784	-0.520	-0.157	-1.133	-0.033	-0.092	-0.356
	60219	0.302	-1.601	-0.289	-0.610	-0.689	-0.135	0.061	0.336
	70201	0.298	-0.171	0.000	0.498	-0.014	0.116	-0.273	0.072
	70204	0.347	-0.849	0.059	-0.064	0.067	0.155	0.005	-0.277
	110718	0.325	-1.355	-0.068	-0.049	0.085	0.007	0.036	0.191
2 Exterior Wall @ EL-4.65 ~-6.60m	62011	0.093	-1.042	0.068	0.043	0.146	0.010	0.010	0.056
	62019	0.126	-0.628	-0.196	-0.032	0.048	-0.031	-0.001	0.021
	72001	0.110	-0.170	0.104	0.106	0.020	-0.006	-0.015	-0.005
	72004	0.146	-0.450	0.196	-0.038	0.004	0.001	-0.016	0.014
3 Exterior Wall @ EL22.50 ~24.60m	64011	0.097	-0.344	-0.097	-0.104	-0.454	-0.007	-0.006	0.069
	64019	-0.104	-0.369	-0.066	-0.061	-0.371	0.053	0.063	0.063
	74001	-0.016	-0.050	0.091	0.049	-0.045	-0.046	-0.020	-0.030
	74004	-0.053	-0.212	0.087	-0.078	-0.336	-0.061	0.019	-0.069
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	0.598	-1.251	-0.498	-1.102	-0.817	-0.249	-0.005	-0.070
	70801	0.676	-0.153	0.008	1.074	0.073	-0.015	-0.548	0.031
	70804	0.581	-0.748	0.129	-0.561	-0.466	0.064	-0.097	0.045
	110748	0.226	-1.010	-0.443	-0.184	-0.081	-0.008	0.073	-0.025
5 Basemat	90306	-1.073	-0.427	0.522	0.941	-0.113	0.179	-0.536	1.181
	90310	-0.132	-0.121	-0.043	-0.151	-0.150	-0.698	0.167	-0.067
	90410	-0.443	-0.909	0.528	-0.673	0.169	1.498	1.392	-0.061
5 Basemat @ Spent Fuel Pool	90486	0.292	0.028	0.090	3.615	2.361	0.284	-0.180	0.122
	90490	0.429	0.183	0.281	1.433	1.257	0.507	1.196	0.263
	90526	0.407	0.365	0.097	1.714	1.727	0.502	-0.256	-0.708
6 Slab EL4.65m	93306	0.188	0.018	0.021	0.047	-0.005	0.005	0.031	-0.098
	93310	0.039	0.055	0.231	0.033	0.007	0.034	-0.024	0.007
	93410	0.313	0.325	-0.454	0.011	0.013	-0.068	0.002	-0.010

Table 3G.3-6

Results of NASTRAN Analysis: Thermal Load (Winter)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	-0.636	-0.044	-0.353	0.917	0.745	0.073	-0.230	-0.155
	60219	1.843	-2.269	0.746	-9.870	-14.164	-0.448	0.101	-1.690
	70201	1.488	2.380	-0.481	-3.056	-3.412	0.239	-0.144	0.462
	70204	1.206	1.126	-0.389	-3.033	-3.631	0.239	0.141	0.118
	110718	-1.525	-2.389	-1.020	-1.514	-1.719	0.009	0.147	-0.172
2 Exterior Wall @ EL-4.65 ~-6.60m	62011	5.921	1.792	0.413	-1.104	-1.231	-0.001	-0.026	-0.065
	62019	7.027	0.254	-1.903	-1.171	-1.410	-0.040	0.027	-0.090
	72001	3.762	-1.877	2.412	-0.511	-0.885	0.036	-0.597	0.202
	72004	6.440	0.553	2.563	-1.239	-1.456	0.072	-0.043	0.127
3 Exterior Wall @ EL22.50 ~24.60m	64011	4.838	0.478	0.309	-0.978	-0.479	-0.011	0.002	-0.071
	64019	5.521	1.413	1.620	-1.022	-0.454	0.019	-0.012	-0.050
	74001	2.905	-0.801	-3.455	-0.749	-0.461	0.131	-0.303	0.096
	74004	4.049	0.185	-3.577	-0.934	-0.309	-0.014	0.017	0.086
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	-1.918	-3.130	-0.361	-7.763	-7.728	-1.038	-0.047	-0.852
	70801	0.306	2.834	-0.059	-2.812	-3.053	0.011	-0.043	-0.032
	70804	-0.615	0.255	0.452	-2.929	-3.146	0.265	-0.046	0.092
	110748	-0.298	-2.140	-0.802	-1.042	-1.404	-0.075	0.291	-0.121
5 Basemat	90306	-0.837	-0.083	0.229	1.845	0.796	0.000	0.027	0.256
	90310	0.116	0.299	0.318	1.213	1.344	0.600	0.178	-0.100
	90410	-0.186	0.128	0.318	0.430	1.623	0.155	0.083	-0.262
5 Basemat @ Spent Fuel Pool	90486	-2.450	-1.493	0.651	-13.369	-14.435	1.996	0.086	0.302
	90490	-1.907	2.615	0.387	-17.342	-17.022	0.768	1.711	1.416
	90526	1.469	0.086	0.117	-14.549	-5.470	1.213	-1.044	1.284
6 Slab EL4.65m	93306	-0.770	-0.028	-1.664	-0.053	0.031	-0.014	0.081	-0.028
	93310	-2.222	-2.171	-3.239	-0.755	-0.782	-0.243	0.270	0.286
	93410	-0.729	-2.313	0.047	-0.069	-0.010	0.019	-0.093	-0.027

Table 3G.3-7

Results of NASTRAN Analysis: Seismic Load (Horizontal: North to South Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	-4.983	-4.120	-0.820	-0.146	-0.960	-0.078	0.053	-0.322
	60219	-4.854	-5.968	-1.445	0.812	0.590	0.207	-0.146	0.245
	70201	0.093	-1.654	-2.670	-0.117	-0.591	-0.047	-0.258	0.100
	70204	1.085	-4.394	-4.210	-0.538	-1.108	-0.060	-0.076	0.246
	110718	1.881	-2.395	1.195	-0.010	0.053	-0.022	0.025	-0.075
2 Exterior Wall @ EL-4.65 ~-6.60m	62011	0.823	-1.305	-0.352	0.055	0.165	0.005	-0.017	0.036
	62019	0.766	-1.212	-2.136	0.016	0.104	-0.012	0.006	0.016
	72001	-0.117	-1.350	-3.531	-0.076	-0.060	0.010	-0.005	0.051
	72004	-0.288	-1.706	-4.140	-0.026	-0.033	-0.002	0.017	0.007
3 Exterior Wall @ EL22.50 ~24.60m	64011	3.349	-0.210	-0.228	-0.048	-0.151	0.010	0.002	0.028
	64019	2.649	0.005	-0.657	-0.056	-0.128	-0.040	-0.025	0.022
	74001	0.142	-0.105	-1.087	0.033	0.046	-0.044	0.037	-0.013
	74004	-1.332	-0.219	-1.585	0.035	0.026	-0.032	0.015	0.009
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	-0.910	-4.128	-2.618	0.316	0.135	0.200	0.109	0.068
	70801	-0.007	-1.700	-4.178	-0.219	-0.129	-0.133	-0.092	-0.050
	70804	0.627	-3.010	-4.995	-0.419	-0.177	-0.202	0.031	0.098
	110748	0.631	-0.360	1.149	0.040	0.092	-0.130	-0.020	0.033
5 Basemat	90306	-1.298	-1.336	5.050	2.391	-0.452	4.930	-4.168	3.137
	90310	0.234	-1.751	0.207	0.851	-0.438	-1.023	-0.690	2.166
	90410	-0.830	-9.222	-0.149	1.442	1.190	2.201	3.051	-0.495
5 Basemat @ Spent Fuel Pool	90486	-1.349	-2.865	-2.048	15.386	8.964	-2.127	-2.177	-0.077
	90490	-0.485	-8.802	0.828	5.797	7.104	0.716	4.705	-0.487
	90526	0.828	-0.765	-4.641	7.256	1.643	-4.294	-2.213	-3.615
6 Slab EL4.65m	93306	2.016	0.406	-0.846	0.334	-0.448	-0.006	-0.048	0.040
	93310	0.669	0.284	0.937	0.426	-0.367	0.015	-0.413	0.417
	93410	0.215	1.007	0.802	0.176	0.077	0.049	-0.050	0.006

Table 3G.3-8

Results of NASTRAN Analysis: Seismic Load (Horizontal: East to West Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	-0.076	-0.171	-6.114	-0.044	-0.676	-0.125	0.087	-0.125
	60219	0.906	7.209	-4.288	1.422	4.526	-0.253	0.003	0.685
	70201	-0.016	2.512	-0.893	-0.105	0.279	-0.138	0.050	-0.154
	70204	0.850	6.342	0.195	0.052	0.306	-0.144	-0.036	0.075
	110718	-0.394	3.741	0.198	0.336	0.757	0.048	0.044	0.449
2 Exterior Wall @ EL-4.65 ~-6.60m	62011	0.198	0.092	-3.939	0.030	0.059	-0.004	-0.028	0.015
	62019	-0.298	1.564	-2.104	0.018	0.025	0.003	0.000	0.006
	72001	-0.053	1.984	-0.528	-0.048	-0.038	0.001	-0.009	0.019
	72004	-0.163	2.436	0.329	0.007	-0.054	-0.016	0.002	-0.004
3 Exterior Wall @ EL22.50 ~24.60m	64011	-0.134	-0.010	-2.157	0.001	-0.009	0.008	0.000	0.003
	64019	-0.603	0.128	-1.312	-0.005	0.000	-0.014	-0.002	0.001
	74001	-0.170	0.249	0.184	-0.053	-0.003	-0.002	0.032	0.026
	74004	-1.057	0.192	0.793	0.002	0.039	0.000	0.004	0.008
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	-0.683	4.640	-3.575	1.094	1.123	-0.068	-0.065	0.334
	70801	-0.419	2.734	-0.987	-0.552	-0.042	-0.049	0.320	-0.083
	70804	-0.390	4.944	0.402	0.318	0.251	-0.082	0.032	-0.044
	110748	-0.575	1.994	0.275	-0.061	-0.144	-0.058	0.107	0.058
5 Basemat	90306	-7.400	-1.893	2.312	4.508	1.334	1.356	-2.149	4.901
	90310	-1.110	-0.660	0.436	-0.184	0.640	-1.501	1.889	0.096
	90410	0.078	0.355	4.879	-0.414	-1.781	7.917	-0.043	-3.734
5 Basemat @ Spent Fuel Pool	90486	1.943	1.502	0.920	-15.692	-16.470	-0.634	0.585	-1.855
	90490	0.979	3.656	4.024	0.462	-7.932	4.394	-6.400	-1.816
	90526	4.646	0.751	1.467	-9.758	-5.415	-0.036	0.796	4.959
6 Slab EL4.65m	93306	1.756	0.201	-0.645	0.337	-0.163	-0.030	0.106	0.079
	93310	0.341	0.480	0.389	-0.139	0.085	-0.013	0.129	-0.068
	93410	-0.266	0.728	0.403	0.097	-0.067	0.121	-0.219	-0.007

Table 3G.3-9

Results of NASTRAN Analysis: Seismic Load (Vertical: Upward Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	0.343	1.446	0.286	0.150	0.918	0.029	0.061	0.277
	60219	0.057	1.559	0.153	0.450	0.641	0.085	-0.039	-0.185
	70201	-0.036	0.251	-0.079	-0.320	0.047	-0.078	0.190	-0.076
	70204	-0.042	0.879	-0.095	0.045	-0.001	-0.109	-0.011	0.173
	110718	-0.174	1.168	0.285	0.063	-0.016	-0.035	-0.020	-0.093
2 Exterior Wall @ EL-4.65 ~-6.60m	62011	-0.056	0.995	-0.110	-0.057	-0.254	-0.012	-0.009	-0.085
	62019	-0.054	0.678	0.051	0.017	-0.116	0.045	-0.002	-0.038
	72001	-0.056	0.232	-0.061	-0.083	-0.016	0.003	0.005	0.002
	72004	-0.057	0.480	-0.094	0.021	-0.027	-0.011	0.010	-0.004
3 Exterior Wall @ EL22.50 ~24.60m	64011	0.043	0.479	0.029	0.173	0.765	0.009	0.007	-0.112
	64019	0.148	0.523	0.058	0.106	0.631	-0.084	-0.102	-0.100
	74001	0.013	0.028	-0.111	-0.083	0.074	0.075	0.037	0.049
	74004	0.076	0.313	-0.070	0.132	0.561	0.097	-0.029	0.114
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	-0.126	1.233	0.310	0.807	0.421	0.189	-0.011	0.076
	70801	-0.114	0.353	-0.032	-0.737	-0.067	0.018	0.367	-0.018
	70804	-0.140	0.741	-0.088	0.356	0.296	-0.048	0.066	-0.040
	110748	-0.119	0.789	0.348	0.105	0.033	0.013	-0.047	0.033
5 Basemat	90306	0.821	0.337	-0.379	-0.719	0.079	-0.130	0.415	-0.934
	90310	0.112	0.080	0.038	0.111	0.107	0.557	-0.158	0.057
	90410	0.345	0.657	-0.328	0.526	-0.134	-1.081	-1.130	-0.056
5 Basemat @ Spent Fuel Pool	90486	0.225	0.452	0.036	-3.151	-2.167	-0.336	0.173	-0.140
	90490	0.290	0.324	-0.116	-0.406	-1.036	-0.310	-1.234	-0.237
	90526	0.216	0.250	0.021	-1.391	-0.833	-0.375	0.204	0.778
6 Slab EL4.65m	93306	-0.122	0.014	-0.050	-0.040	-0.063	-0.010	-0.027	0.132
	93310	-0.021	-0.041	-0.208	-0.042	-0.028	-0.042	0.019	0.002
	93410	-0.284	-0.295	0.277	-0.087	-0.020	0.074	0.046	0.017

Table 3G.3-10

Combined Forces and Moments: Selected Load Combination FB-4

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	OTHR	-2.782	-2.145	-0.858	-0.164	-1.184	0.023	-0.072	-0.943
		TEMP	-1.017	0.051	-0.243	1.227	1.116	0.072	-0.262	-0.131
	60219	OTHR	-2.608	-2.019	-0.547	0.000	-1.238	0.114	-0.002	-1.016
		TEMP	2.220	-2.753	1.202	-12.741	-18.247	-0.446	0.060	-2.161
	70201	OTHR	-0.927	-0.381	0.018	-1.346	-0.893	-0.609	0.588	-0.045
		TEMP	1.923	3.171	-0.800	-4.076	-4.418	0.309	-0.147	0.564
	70204	OTHR	-1.190	-1.489	-0.114	-0.037	-2.340	-0.604	-0.186	1.687
		TEMP	1.559	1.589	-0.839	-3.961	-4.669	0.279	0.179	0.119
	110718	OTHR	-0.743	-1.072	-0.845	-0.078	0.019	0.046	0.072	0.104
		TEMP	-2.039	-3.114	-1.323	-1.981	-2.276	0.015	0.187	-0.244
2 Exterior Wall @ EL-4.65 ~-6.60m	62011	OTHR	-0.208	-1.136	-0.114	0.033	0.190	0.008	0.000	0.075
		TEMP	7.482	2.237	0.531	-1.420	-1.568	0.005	-0.024	-0.078
	62019	OTHR	-0.339	-0.712	-0.080	0.018	0.120	-0.030	0.012	0.059
		TEMP	9.119	0.451	-2.468	-1.523	-1.835	-0.050	0.038	-0.116
	72001	OTHR	-0.073	-0.262	-0.059	-0.268	-0.039	0.054	0.145	0.026
		TEMP	4.868	-1.896	3.166	-0.691	-1.158	0.045	-0.779	0.264
	72004	OTHR	-0.278	-0.665	-0.073	0.390	0.266	0.053	0.061	-0.165
		TEMP	8.179	0.908	3.351	-1.621	-1.894	0.096	-0.050	0.162
3 Exterior Wall @ EL22.50 ~24.60m	64011	OTHR	0.224	-0.374	-0.074	-0.119	-0.512	0.001	-0.005	0.063
		TEMP	5.821	0.590	0.306	-1.279	-0.651	-0.018	0.002	-0.085
	64019	OTHR	0.008	-0.413	-0.084	-0.069	-0.408	0.056	0.067	0.054
		TEMP	6.660	1.810	1.875	-1.321	-0.597	0.022	-0.013	-0.066
	74001	OTHR	-0.023	-0.057	0.118	0.057	-0.051	-0.043	-0.031	-0.029
		TEMP	3.770	-0.963	-4.187	-1.002	-0.608	0.170	-0.382	0.134
	74004	OTHR	-0.026	-0.227	0.084	-0.084	-0.383	-0.062	0.018	-0.061
		TEMP	5.278	0.280	-4.016	-1.228	-0.409	-0.021	0.023	0.114
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	OTHR	-2.103	-1.488	-0.685	0.639	1.077	0.112	0.184	-0.012
		TEMP	-2.590	-3.880	-0.298	-10.036	-10.048	-1.119	-0.047	-1.088
	70801	OTHR	-1.409	-0.700	-0.090	-3.529	-0.259	-0.425	2.180	-0.352
		TEMP	0.304	4.034	-0.223	-3.871	-4.021	0.019	-0.018	-0.047
	70804	OTHR	-1.218	-1.094	-0.094	2.789	1.829	-0.342	0.325	0.256
		TEMP	-1.009	0.515	0.316	-3.843	-4.097	0.295	-0.035	0.114
	110748	OTHR	-0.545	-0.665	-0.427	-0.053	-0.043	-0.069	0.101	-0.059
		TEMP	-0.397	-2.798	-1.041	-1.348	-1.820	-0.082	0.375	-0.162
5 Basemat	90306	OTHR	-4.286	-3.077	0.795	0.955	-0.809	0.433	-0.610	1.574
		TEMP	-0.545	-0.068	0.515	2.178	1.098	0.240	-0.226	0.261
	90310	OTHR	-2.501	-2.559	0.248	-0.648	-0.535	-0.052	0.390	0.197
		TEMP	0.216	0.350	0.514	1.681	1.783	0.945	0.088	-0.115
	90410	OTHR	-3.289	-5.501	0.728	-2.068	-0.019	1.718	1.702	-0.364
		TEMP	-0.166	-0.115	0.222	0.797	2.150	-0.001	0.026	-0.184
5 Basemat @ Spent Fuel Pool	90486	OTHR	-3.438	-5.737	-0.330	3.062	1.530	-0.130	-0.140	-0.221
		TEMP	-3.104	-1.999	0.510	-18.174	-19.158	2.267	-0.021	0.426
	90490	OTHR	-3.541	-4.706	0.206	-1.331	0.797	0.357	1.532	-0.332
		TEMP	-2.445	3.161	0.259	-22.444	-22.186	0.616	2.056	1.795
	90526	OTHR	-3.900	-6.111	-0.434	0.639	-4.278	-0.393	-0.119	-1.552
		TEMP	2.067	0.112	-0.215	-19.234	-7.143	1.074	-1.444	1.760
6 Slab EL4.65m	93306	OTHR	0.044	-0.229	-0.087	0.100	0.165	0.016	0.034	-0.158
		TEMP	-1.209	-0.072	-1.164	-0.072	0.024	-0.024	0.087	-0.036
	93310	OTHR	-0.037	-0.036	0.137	0.093	0.042	0.011	-0.050	0.004
		TEMP	-2.822	-2.800	-3.598	-1.001	-1.004	-0.291	0.366	0.362
	93410	OTHR	-0.050	-0.177	0.010	0.222	0.059	-0.047	-0.099	-0.017
		TEMP	-0.773	-3.228	0.017	-0.189	-0.029	-0.001	-0.071	-0.032

OTHR: Loads other than thermal loads
TEMP: Thermal loads

Table 3G.3-11

Combined Forces and Moments: Selected Load Combination FB-8

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	OTHR	-2.631	-2.378	-0.609	-0.187	-1.275	0.017	-0.087	-0.862
		TEMP	-0.636	-0.044	-0.353	0.917	0.745	0.073	-0.230	-0.155
	60219	OTHR	-2.434	-2.842	-0.462	-0.130	-1.397	0.066	0.010	-0.768
		TEMP	1.843	-2.269	0.746	-9.870	-14.164	-0.448	0.101	-1.690
	70201	OTHR	-0.641	-0.595	-0.183	-0.927	-0.774	-0.445	0.363	0.006
		TEMP	1.488	2.380	-0.481	-3.056	-3.412	0.239	-0.144	0.462
	70204	OTHR	-0.770	-2.110	-0.441	-0.094	-1.948	-0.428	-0.148	1.282
		TEMP	1.206	1.126	-0.389	-3.033	-3.631	0.239	0.141	0.118
	110718	OTHR	-0.293	-1.544	-0.612	-0.087	0.005	0.035	0.066	0.092
		TEMP	-1.525	-2.389	-1.020	-1.514	-1.719	0.009	0.147	-0.172
2 Exterior Wall @ EL-4.65 ~-6.60m	62011	OTHR	-0.066	-1.229	0.081	0.028	0.156	0.008	0.000	0.057
		TEMP	5.921	1.792	0.413	-1.104	-1.231	-0.001	-0.026	-0.065
	62019	OTHR	-0.176	-0.895	-0.180	0.011	0.099	-0.028	0.009	0.042
		TEMP	7.027	0.254	-1.903	-1.171	-1.410	-0.040	0.027	-0.090
	72001	OTHR	-0.071	-0.510	-0.358	-0.202	-0.032	0.036	0.119	0.022
		TEMP	3.762	-1.877	2.412	-0.511	-0.885	0.036	-0.597	0.202
	72004	OTHR	-0.257	-0.895	-0.473	0.304	0.204	0.038	0.046	-0.113
		TEMP	6.440	0.553	2.563	-1.239	-1.456	0.072	-0.043	0.127
3 Exterior Wall @ EL22.50 ~24.60m	64011	OTHR	0.401	-0.396	0.080	-0.120	-0.526	0.002	-0.005	0.078
		TEMP	4.838	0.478	0.309	-0.978	-0.479	-0.011	0.002	-0.071
	64019	OTHR	0.223	-0.414	-0.048	-0.074	-0.433	0.050	0.065	0.070
		TEMP	5.521	1.413	1.620	-1.022	-0.454	0.019	-0.012	-0.050
	74001	OTHR	-0.037	-0.072	0.009	0.059	-0.050	-0.041	-0.031	-0.032
		TEMP	2.905	-0.801	-3.455	-0.749	-0.461	0.131	-0.303	0.096
	74004	OTHR	-0.142	-0.254	-0.112	-0.080	-0.399	-0.060	0.016	-0.080
		TEMP	4.049	0.185	-3.577	-0.934	-0.309	-0.014	0.017	0.086
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	OTHR	-1.554	-2.056	-0.735	0.292	0.605	0.013	0.152	-0.044
		TEMP	-1.918	-3.130	-0.361	-7.763	-7.728	-1.038	-0.047	-0.852
	70801	OTHR	-0.924	-0.897	-0.414	-2.486	-0.194	-0.345	1.550	-0.270
		TEMP	0.306	2.834	-0.059	-2.812	-3.053	0.011	-0.043	-0.032
	70804	OTHR	-0.734	-1.600	-0.546	2.007	1.282	-0.262	0.230	0.221
		TEMP	-0.615	0.255	0.452	-2.929	-3.146	0.265	-0.046	0.092
	110748	OTHR	-0.281	-0.862	-0.360	-0.063	-0.034	-0.071	0.088	-0.055
		TEMP	-0.298	-2.140	-0.802	-1.042	-1.404	-0.075	0.291	-0.121
5 Basemat	90306	OTHR	-3.380	-2.498	1.030	0.959	-0.810	0.665	-0.788	1.530
		TEMP	-0.837	-0.083	0.229	1.845	0.796	0.000	0.027	0.256
	90310	OTHR	-1.879	-2.101	0.172	-0.506	-0.545	-0.212	0.162	0.281
		TEMP	0.116	0.299	0.318	1.213	1.344	0.600	0.178	-0.100
	90410	OTHR	-2.737	-5.179	0.491	-1.744	0.180	1.532	1.890	-0.188
		TEMP	-0.186	0.128	0.318	0.430	1.623	0.155	0.083	-0.262
5 Basemat @ Spent Fuel Pool	90486	OTHR	-2.718	-4.690	-0.293	5.801	3.614	-0.178	-0.290	-0.056
		TEMP	-2.450	-1.493	0.651	-13.369	-14.435	1.996	0.086	0.302
	90490	OTHR	-2.736	-4.599	0.167	-0.360	1.989	0.317	2.258	-0.144
		TEMP	-1.907	2.615	0.387	-17.342	-17.022	0.768	1.711	1.416
	90526	OTHR	-2.992	-4.744	-0.759	2.126	-2.495	-0.487	-0.385	-2.014
		TEMP	1.469	0.086	0.117	-14.549	-5.470	1.213	-1.044	1.284
6 Slab EL4.65m	93306	OTHR	0.130	-0.152	-0.286	0.106	0.083	0.016	0.028	-0.138
		TEMP	-0.770	-0.028	-1.664	-0.053	0.031	-0.014	0.081	-0.028
	93310	OTHR	-0.008	-0.025	0.115	0.127	-0.006	0.012	-0.094	0.044
		TEMP	-2.222	-2.171	-3.239	-0.755	-0.782	-0.243	0.270	0.286
	93410	OTHR	-0.013	-0.027	0.064	0.188	0.057	-0.045	-0.074	-0.014
		TEMP	-0.729	-2.313	0.047	-0.069	-0.010	0.019	-0.093	-0.027

Table 3G.3-12

Combined Forces and Moments: Selected Load Combination FB-9

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	OTHR	-2.541	-2.296	-0.648	-0.181	-1.243	0.016	-0.083	-0.846
		TEMP	-0.636	-0.044	-0.353	0.917	0.745	0.073	-0.230	-0.155
		EQEW	-0.076	-0.171	-6.114	-0.044	-0.676	-0.125	0.087	-0.125
		EQNS	-4.983	-4.120	-0.820	-0.146	-0.960	-0.078	0.053	-0.322
		EQZ	0.343	1.446	0.286	0.150	0.918	0.029	0.061	0.277
		EQT	-0.043	-0.064	0.832	-0.001	0.032	-0.007	0.018	0.005
		SPKW	-1.049	-0.017	0.020	0.012	0.019	0.008	-0.008	-0.025
		SPKN	-0.240	0.063	0.240	-0.071	-0.098	0.026	0.046	-0.281
	60219	OTHR	-2.330	-2.638	-0.465	-0.126	-1.334	0.064	0.010	-0.757
		TEMP	1.843	-2.269	0.746	-9.870	-14.164	-0.448	0.101	-1.690
		EQEW	0.906	7.209	-4.288	1.422	4.526	-0.253	0.003	0.685
		EQNS	-4.854	-5.968	-1.445	0.812	0.590	0.207	-0.146	0.245
		EQZ	0.057	1.559	0.153	0.450	0.641	0.085	-0.039	-0.185
		EQT	0.407	-0.116	0.892	-0.283	-0.340	-0.097	0.089	-0.058
		SPKW	-0.924	0.237	-0.067	-0.318	0.720	0.086	0.053	0.304
		SPKN	-0.709	-0.585	-0.043	1.103	-2.790	0.212	-0.193	-1.820
	70201	OTHR	-0.644	-0.537	-0.142	-0.929	-0.757	-0.445	0.370	0.000
		TEMP	1.488	2.380	-0.481	-3.056	-3.412	0.239	-0.144	0.462
		EQEW	-0.016	2.512	-0.893	-0.105	0.279	-0.138	0.050	-0.154
		EQNS	0.093	-1.654	-2.670	-0.117	-0.591	-0.047	-0.258	0.100
		EQZ	-0.036	0.251	-0.079	-0.320	0.047	-0.078	0.190	-0.076
		EQT	-0.070	0.066	0.517	0.021	0.009	0.014	0.054	0.018
		SPKW	-0.332	-0.092	0.237	-0.752	-0.613	-0.515	0.232	-0.138
		SPKN	-0.285	-0.028	-0.232	-0.596	0.043	0.157	0.214	-0.041
	70204	OTHR	-0.787	-1.944	-0.367	-0.083	-1.914	-0.429	-0.147	1.274
		TEMP	1.206	1.126	-0.389	-3.033	-3.631	0.239	0.141	0.118
		EQEW	0.850	6.342	0.195	0.052	0.306	-0.144	-0.036	0.075
		EQNS	1.085	-4.394	-4.210	-0.538	-1.108	-0.060	-0.076	0.246
		EQZ	-0.042	0.879	-0.095	0.045	-0.001	-0.109	-0.011	0.173
		EQT	-0.357	0.128	0.723	0.115	0.093	0.005	0.009	-0.034
		SPKW	-0.373	-0.381	0.262	0.049	-1.755	-0.480	-0.163	1.041
		SPKN	-0.568	0.198	-0.277	-0.148	0.309	-0.010	0.065	-0.196
	110718	OTHR	-0.335	-1.449	-0.620	-0.083	0.011	0.035	0.066	0.097
		TEMP	-1.525	-2.389	-1.020	-1.514	-1.719	0.009	0.147	-0.172
		EQEW	-0.394	3.741	0.198	0.336	0.757	0.048	0.044	0.449
		EQNS	1.881	-2.395	1.195	-0.010	0.053	-0.022	0.025	-0.075
		EQZ	-0.174	1.168	0.285	0.063	-0.016	-0.035	-0.020	-0.093
		EQT	0.066	-0.159	0.034	-0.058	-0.070	-0.005	0.004	-0.048
		SPKW	0.162	0.032	0.296	-0.038	-0.072	0.042	-0.006	-0.062
		SPKN	-1.370	0.224	-1.607	0.033	0.018	-0.026	0.045	-0.001

OTHR: Loads other than thermal and seismic loads
TEMP: Thermal loads
EQEW: Horizontal seismic loads in the E-W direction
EQNS: Horizontal seismic loads in the N-S direction
EQZ: Vertical seismic loads
EQT: Torsional seismic loads
SPKW: Dynamic soil pressure during a horizontal earthquake in the E-W direction
SPKN: Dynamic soil pressure during a horizontal earthquake in the N-S direction

Table 3G.3-12

Combined Forces and Moments: Selected Load Combination FB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
2 Exterior Wall @ EL-4.65 ~-6.60m	62011	OTHR	-0.080	-1.199	0.045	0.029	0.158	0.008	0.001	0.057
		TEMP	5.921	1.792	0.413	-1.104	-1.231	-0.001	-0.026	-0.065
		EQEW	0.198	0.092	-3.939	0.030	0.059	-0.004	-0.028	0.015
		EQNS	0.823	-1.305	-0.352	0.055	0.165	0.005	-0.017	0.036
		EQZ	-0.056	0.995	-0.110	-0.057	-0.254	-0.012	-0.009	-0.085
		EQT	-0.090	0.002	0.449	-0.005	-0.009	-0.004	0.003	-0.002
		SPKW	-0.499	0.108	-0.117	0.010	0.003	0.005	-0.001	0.001
		SPKN	0.267	-0.066	-0.054	-0.052	-0.009	-0.021	-0.010	-0.011
	62019	OTHR	-0.191	-0.850	-0.162	0.010	0.098	-0.028	0.009	0.042
		TEMP	7.027	0.254	-1.903	-1.171	-1.410	-0.040	0.027	-0.090
		EQEW	-0.298	1.564	-2.104	0.018	0.025	0.003	0.000	0.006
		EQNS	0.766	-1.212	-2.136	0.016	0.104	-0.012	0.006	0.016
		EQZ	-0.054	0.678	0.051	0.017	-0.116	0.045	-0.002	-0.038
		EQT	-0.077	-0.044	0.459	-0.004	-0.009	-0.004	-0.001	-0.002
		SPKW	-0.487	0.108	0.281	-0.040	-0.044	0.005	0.012	-0.002
		SPKN	-0.012	-0.139	-0.237	0.199	0.228	0.017	-0.012	0.056
	72001	OTHR	-0.065	-0.454	-0.282	-0.201	-0.031	0.035	0.118	0.021
		TEMP	3.762	-1.877	2.412	-0.511	-0.885	0.036	-0.597	0.202
		EQEW	-0.053	1.984	-0.528	-0.048	-0.038	0.001	-0.009	0.019
		EQNS	-0.117	-1.350	-3.531	-0.076	-0.060	0.010	-0.005	0.051
		EQZ	-0.056	0.232	-0.061	-0.083	-0.016	0.003	0.005	0.002
		EQT	0.049	-0.054	0.550	0.019	0.010	-0.003	0.002	-0.008
		SPKW	0.021	-0.147	0.193	-0.271	-0.012	0.044	0.196	0.000
		SPKN	-0.618	-0.104	-0.682	-0.231	-0.068	-0.009	0.014	0.019
	72004	OTHR	-0.245	-0.833	-0.369	0.303	0.203	0.037	0.045	-0.113
		TEMP	6.440	0.553	2.563	-1.239	-1.456	0.072	-0.043	0.127
		EQEW	-0.163	2.436	0.329	0.007	-0.054	-0.016	0.002	-0.004
		EQNS	-0.288	-1.706	-4.140	-0.026	-0.033	-0.002	0.017	0.007
		EQZ	-0.057	0.480	-0.094	0.021	-0.027	-0.011	0.010	-0.004
		EQT	0.126	0.043	0.567	0.009	0.010	0.000	-0.002	-0.002
		SPKW	-0.041	-0.163	0.067	0.456	0.326	0.025	0.058	-0.167
		SPKN	-0.724	0.119	-0.502	-0.081	-0.062	0.005	0.024	0.009

Table 3G.3-12

Combined Forces and Moments: Selected Load Combination FB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
3 Exterior Wall @ EL22.50 ~24.60m	64011	OTHR	0.362	-0.394	0.045	-0.121	-0.527	0.001	-0.005	0.079
		TEMP	4.838	0.478	0.309	-0.978	-0.479	-0.011	0.002	-0.071
		EQEW	-0.134	-0.010	-2.157	0.001	-0.009	0.008	0.000	0.003
		EQNS	3.349	-0.210	-0.228	-0.048	-0.151	0.010	0.002	0.028
		EQZ	0.043	0.479	0.029	0.173	0.765	0.009	0.007	-0.112
		EQT	0.026	0.000	0.181	-0.001	0.000	-0.003	-0.001	-0.001
		SPKW	-0.132	0.004	-0.011	0.003	0.003	-0.005	-0.001	0.000
		SPKN	0.236	-0.007	-0.023	-0.009	-0.016	0.025	0.006	0.003
	64019	OTHR	0.173	-0.416	-0.050	-0.073	-0.433	0.050	0.065	0.070
		TEMP	5.521	1.413	1.620	-1.022	-0.454	0.019	-0.012	-0.050
		EQEW	-0.603	0.128	-1.312	-0.005	0.000	-0.014	-0.002	0.001
		EQNS	2.649	0.005	-0.657	-0.056	-0.128	-0.040	-0.025	0.022
		EQZ	0.148	0.523	0.058	0.106	0.631	-0.084	-0.102	-0.100
		EQT	-0.106	-0.014	0.098	0.007	0.007	0.005	0.003	-0.001
		SPKW	-0.077	0.000	0.053	0.000	0.019	0.001	-0.001	-0.008
		SPKN	0.227	0.004	-0.132	0.001	-0.046	-0.026	-0.011	0.012
	74001	OTHR	-0.033	-0.069	0.029	0.057	-0.051	-0.040	-0.031	-0.032
		TEMP	2.905	-0.801	-3.455	-0.749	-0.461	0.131	-0.303	0.096
		EQEW	-0.170	0.249	0.184	-0.053	-0.003	-0.002	0.032	0.026
		EQNS	0.142	-0.105	-1.087	0.033	0.046	-0.044	0.037	-0.013
		EQZ	0.013	0.028	-0.111	-0.083	0.074	0.075	0.037	0.049
		EQT	0.060	-0.023	-0.168	0.010	0.000	0.008	-0.013	-0.001
		SPKW	-0.004	-0.010	0.031	-0.003	-0.011	0.030	-0.020	0.003
		SPKN	-0.006	0.020	-0.041	-0.009	0.011	-0.023	0.020	0.004
	74004	OTHR	-0.113	-0.252	-0.074	-0.082	-0.400	-0.060	0.016	-0.080
		TEMP	4.049	0.185	-3.577	-0.934	-0.309	-0.014	0.017	0.086
		EQEW	-1.057	0.192	0.793	0.002	0.039	0.000	0.004	0.008
		EQNS	-1.332	-0.219	-1.585	0.035	0.026	-0.032	0.015	0.009
		EQZ	0.076	0.313	-0.070	0.132	0.561	0.097	-0.029	0.114
		EQT	0.370	0.000	-0.211	-0.001	-0.004	-0.001	0.001	-0.001
		SPKW	0.084	-0.011	0.016	0.004	-0.040	0.016	-0.009	-0.009
		SPKN	-0.153	0.003	-0.043	0.001	0.024	0.000	0.000	0.011

Table 3G.3-12

Combined Forces and Moments: Selected Load Combination FB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	OTHR	-1.542	-1.918	-0.711	0.293	0.613	0.016	0.149	-0.039
		TEMP	-1.918	-3.130	-0.361	-7.763	-7.728	-1.038	-0.047	-0.852
		EQEW	-0.683	4.640	-3.575	1.094	1.123	-0.068	-0.065	0.334
		EQNS	-0.910	-4.128	-2.618	0.316	0.135	0.200	0.109	0.068
		EQZ	-0.126	1.233	0.310	0.807	0.421	0.189	-0.011	0.076
		EQT	0.011	-0.047	0.806	-0.224	-0.079	-0.174	0.004	-0.031
		SPKW	-1.661	0.263	-0.033	-0.970	-0.137	0.145	0.198	0.151
		SPKN	-0.348	-0.443	-0.111	4.172	1.900	0.312	-0.125	-0.575
	70801	OTHR	-0.931	-0.825	-0.340	-2.491	-0.193	-0.342	1.554	-0.269
		TEMP	0.306	2.834	-0.059	-2.812	-3.053	0.011	-0.043	-0.032
		EQEW	-0.419	2.734	-0.987	-0.552	-0.042	-0.049	0.320	-0.083
		EQNS	-0.007	-1.700	-4.178	-0.219	-0.129	-0.133	-0.092	-0.050
		EQZ	-0.114	0.353	-0.032	-0.737	-0.067	0.018	0.367	-0.018
		EQT	0.054	-0.011	0.767	0.083	0.015	0.007	0.004	0.007
		SPKW	-0.443	-0.320	0.224	-2.598	-0.199	-0.543	1.686	-0.412
		SPKN	-1.669	-0.187	-0.188	-1.221	-0.250	0.215	0.175	0.093
	70804	OTHR	-0.759	-1.471	-0.441	2.015	1.286	-0.260	0.230	0.217
		TEMP	-0.615	0.255	0.452	-2.929	-3.146	0.265	-0.046	0.092
		EQEW	-0.390	4.944	0.402	0.318	0.251	-0.082	0.032	-0.044
		EQNS	0.627	-3.010	-4.995	-0.419	-0.177	-0.202	0.031	0.098
		EQZ	-0.140	0.741	-0.088	0.356	0.296	-0.048	0.066	-0.040
		EQT	0.039	0.007	0.786	0.089	0.007	0.018	-0.007	-0.008
		SPKW	-0.325	-0.282	0.158	2.499	1.272	-0.344	0.242	0.374
		SPKN	-1.539	0.261	-0.114	-0.324	-0.110	-0.071	0.105	-0.067
	110748	OTHR	-0.300	-0.828	-0.370	-0.064	-0.037	-0.068	0.089	-0.054
		TEMP	-0.298	-2.140	-0.802	-1.042	-1.404	-0.075	0.291	-0.121
		EQEW	-0.575	1.994	0.275	-0.061	-0.144	-0.058	0.107	0.058
		EQNS	0.631	-0.360	1.149	0.040	0.092	-0.130	-0.020	0.033
		EQZ	-0.119	0.789	0.348	0.105	0.033	0.013	-0.047	0.033
		EQT	0.018	-0.074	0.025	0.006	0.016	0.004	-0.003	-0.014
		SPKW	0.067	0.151	0.307	0.032	0.019	0.011	0.009	-0.009
		SPKN	-1.108	0.068	-0.963	0.130	0.009	-0.075	0.015	-0.041
5 Basemat	90306	OTHR	-3.417	-2.491	0.965	0.959	-0.773	0.600	-0.744	1.519
		TEMP	-0.837	-0.083	0.229	1.845	0.796	0.000	0.027	0.256
		EQEW	-7.400	-1.893	2.312	4.508	1.334	1.356	-2.149	4.901
		EQNS	-1.298	-1.336	5.050	2.391	-0.452	4.930	-4.168	3.137
		EQZ	0.821	0.337	-0.379	-0.719	0.079	-0.130	0.415	-0.934
		EQT	0.788	0.047	0.988	-0.285	-0.250	0.878	-0.834	0.051
		SPKW	-0.235	-1.422	-0.113	-0.185	-0.598	0.000	0.113	0.122
		SPKN	-1.078	0.016	0.031	-0.175	0.032	-0.010	0.060	-0.043
	90310	OTHR	-1.895	-2.077	0.175	-0.513	-0.523	-0.206	0.199	0.246
		TEMP	0.116	0.299	0.318	1.213	1.344	0.600	0.178	-0.100
		EQEW	-1.110	-0.660	0.436	-0.184	0.640	-1.501	1.889	0.096
		EQNS	0.234	-1.751	0.207	0.851	-0.438	-1.023	-0.690	2.166
		EQZ	0.112	0.080	0.038	0.111	0.107	0.557	-0.158	0.057
		EQT	0.267	-0.235	-0.105	0.123	-0.096	-0.107	-0.564	0.669
		SPKW	-0.061	-1.170	0.041	-0.003	-0.269	0.168	0.105	0.023
		SPKN	-1.183	-0.157	-0.023	-0.408	-0.064	0.098	-0.026	0.249
	90410	OTHR	-2.708	-5.005	0.530	-1.733	0.142	1.561	1.824	-0.214
		TEMP	-0.186	0.128	0.318	0.430	1.623	0.155	0.083	-0.262
		EQEW	0.078	0.355	4.879	-0.414	-1.781	7.917	-0.043	-3.734
		EQNS	-0.830	-9.222	-0.149	1.442	1.190	2.201	3.051	-0.495
		EQZ	0.345	0.657	-0.328	0.526	-0.134	-1.081	-1.130	-0.056
		EQT	-0.020	0.004	-1.094	0.067	0.125	-1.202	0.074	1.012
		SPKW	-0.047	-1.757	-0.015	-0.031	0.017	-0.092	0.048	-0.027
		SPKN	-1.525	-0.619	-0.247	-1.036	-0.261	-0.203	-0.058	0.261

Table 3G.3-12

Combined Forces and Moments: Selected Load Combination FB-9 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
5 Basemat @ Spent Fuel Pool	90486	OTHR	-2.682	-4.629	-0.280	5.238	3.207	-0.151	-0.261	-0.073
		TEMP	-2.450	-1.493	0.651	-13.369	-14.435	1.996	0.086	0.302
		EQEW	1.943	1.502	0.920	-15.692	-16.470	-0.634	0.585	-1.855
		EQNS	-1.349	-2.865	-2.048	15.386	8.964	-2.127	-2.177	-0.077
		EQZ	0.225	0.452	0.036	-3.151	-2.167	-0.336	0.173	-0.140
		EQT	0.212	-0.112	0.608	0.078	0.155	0.009	0.139	0.173
		SPKW	0.445	-2.544	0.088	0.016	-0.837	-0.046	-0.056	-0.195
		SPKN	-3.188	0.146	-0.595	-2.285	-0.305	-0.447	0.295	0.135
	90490	OTHR	-2.716	-4.386	0.177	-0.441	1.754	0.330	2.083	-0.155
		TEMP	-1.907	2.615	0.387	-17.342	-17.022	0.768	1.711	1.416
		EQEW	0.979	3.656	4.024	0.462	-7.932	4.394	-6.400	-1.816
		EQNS	-0.485	-8.802	0.828	5.797	7.104	0.716	4.705	-0.487
		EQZ	0.290	0.324	-0.116	-0.406	-1.036	-0.310	-1.234	-0.237
		EQT	-0.014	0.725	-1.138	-0.434	-0.245	-0.944	0.164	0.784
		SPKW	0.399	-1.100	-0.117	1.320	-0.291	-0.032	-0.262	-0.118
		SPKN	-3.486	-1.253	-0.008	-6.513	-0.973	-0.434	0.647	-0.412
	90526	OTHR	-2.974	-4.720	-0.669	1.854	-2.588	-0.429	-0.338	-1.874
		TEMP	1.469	0.086	0.117	-14.549	-5.470	1.213	-1.044	1.284
		EQEW	4.646	0.751	1.467	-9.758	-5.415	-0.036	0.796	4.959
		EQNS	0.828	-0.765	-4.641	7.256	1.643	-4.294	-2.213	-3.615
		EQZ	0.216	0.250	0.021	-1.391	-0.833	-0.375	0.204	0.778
		EQT	-0.961	-0.025	1.002	0.143	0.246	0.781	0.653	0.170
		SPKW	-0.770	-2.694	0.215	-0.448	-3.914	-0.019	0.136	-0.503
		SPKN	-1.317	0.198	-0.519	-1.273	0.466	-0.669	0.204	0.260
6 Slab EL4.65m	93306	OTHR	0.118	-0.159	-0.241	0.102	0.090	0.015	0.030	-0.138
		TEMP	-0.770	-0.028	-1.664	-0.053	0.031	-0.014	0.081	-0.028
		EQEW	1.756	0.201	-0.645	0.337	-0.163	-0.030	0.106	0.079
		EQNS	2.016	0.406	-0.846	0.334	-0.448	-0.006	-0.048	0.040
		EQZ	-0.122	0.014	-0.050	-0.040	-0.063	-0.010	-0.027	0.132
		EQT	0.047	0.018	0.065	0.021	-0.027	-0.004	-0.020	-0.010
		SPKW	-0.168	-0.839	-0.188	0.054	0.261	-0.003	0.002	-0.056
		SPKN	-0.325	-0.004	0.110	0.011	-0.012	0.011	-0.009	-0.003
	93310	OTHR	-0.012	-0.024	0.122	0.115	0.002	0.012	-0.083	0.035
		TEMP	-2.222	-2.171	-3.239	-0.755	-0.782	-0.243	0.270	0.286
		EQEW	0.341	0.480	0.389	-0.139	0.085	-0.013	0.129	-0.068
		EQNS	0.669	0.284	0.937	0.426	-0.367	0.015	-0.413	0.417
		EQZ	-0.021	-0.041	-0.208	-0.042	-0.028	-0.042	0.019	0.002
		EQT	0.055	-0.002	0.155	0.070	-0.048	0.006	-0.066	0.057
		SPKW	-0.003	-0.327	0.105	-0.025	0.095	-0.021	0.047	-0.058
		SPKN	-0.284	-0.008	0.082	0.119	-0.028	-0.022	-0.073	0.053
	93410	OTHR	-0.011	-0.036	0.033	0.183	0.055	-0.046	-0.074	-0.014
		TEMP	-0.729	-2.313	0.047	-0.069	-0.010	0.019	-0.093	-0.027
		EQEW	-0.266	0.728	0.403	0.097	-0.067	0.121	-0.219	-0.007
		EQNS	0.215	1.007	0.802	0.176	0.077	0.049	-0.050	0.006
		EQZ	-0.284	-0.295	0.277	-0.087	-0.020	0.074	0.046	0.017
		EQT	0.014	-0.196	0.077	-0.009	0.007	-0.001	0.016	0.005
		SPKW	0.017	-0.657	0.246	-0.009	0.004	-0.006	0.001	0.000
		SPKN	-1.013	0.070	0.284	0.260	0.044	0.069	-0.113	0.003

Table 3G.3-13

Sectional Thicknesses and Rebar Ratios Used in the Evaluation

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Direction 1*1		Direction2*1			
				Arrangement	Ratio (%)	Arrangement	Ratio (%)	Arrangement	Ratio (%)
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	2.0	Inside	3-#11@200	0.755	3-#11@200	0.755	#6@400x400	0.177
			Outside	3-#11@200	0.755	3-#11@200	0.755		
	60219	3.6	Inside	3-#11@200	0.419	3-#11@200 (+2-#11@200)	0.699	#6@400x400	0.177
			Outside	3-#11@200	0.419	3-#11@200 (+2-#11@200)	0.699		
	70201	2.0	Inside	4-#11@200	1.006	4-#11@200	1.006	#6@400x400	0.177
			Outside	4-#11@200	1.006	4-#11@200	1.006		
	70204	2.0	Inside	4-#11@200	1.006	4-#11@200	1.006	#6@200x200	0.710
			Outside	4-#11@200	1.006	4-#11@200 (+2-#11@200)	1.510		
	110718	1.5	Inside	2-#11@200	0.671	3-#11@200 (+1-#11@200)	1.342	#6@400x200	0.355
			Outside	2-#11@200	0.671	3-#11@200	1.006		
2 Exterior Wall @ EL4.65 ~6.60m	62011 62019 72001 72004	1.0	Inside	2-#11@200	1.006	2-#11@200	1.006	#5@400x400	0.125
			Outside	3-#11@200	1.510	3-#11@200	1.510		
3 Exterior Wall @ EL22.50 ~24.60m	64011 64019	1.0	Inside	2-#11@200	1.006	2-#11@200	1.006	#5@400x400	0.125
			Outside	2-#11@200	1.006	2-#11@200	1.006		
	74001 74004	1.0	Inside	2-#11@200	1.006	2-#11@200	1.006	#5@400x400	0.125
			Outside	3-#11@200	1.510	3-#11@200	1.510		

Note *1: Exterior Wall, Pool Wall Direction1: Horizontal, Direction2: Vertical
Basemat, Slab Direction1: N-S, Direction2: E-W
Note *2: Rebar in parentheses indicates additional bars locally required.

Table 3G.3-13

Sectional Thicknesses and Rebar Ratios Used in the Evaluation (Continued)

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Direction 1*1		Direction 2*1			
				Arrangement	Ratio (%)	Arrangement	Ratio (%)	Arrangement	Ratio (%)
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	3.6	Inside	3-#11@200	0.419	3-#11@200	0.419	#6@400x400	0.177
			Outside	3-#11@200	0.419	3-#11@200	0.419		
	70801	2.0	Inside	4-#11@200	1.006	4-#11@200	1.006	#6@200x200	0.710
			Outside	4-#11@200	1.006	4-#11@200	1.006		
	70804	2.0	Inside	4-#11@200	1.006	4-#11@200	1.006	#6@400x400	0.177
			Outside	4-#11@200	1.006	4-#11@200	1.006		
	110748	1.5	Inside	2-#11@200	0.671	3-#11@200	1.006	#6@400x400	0.177
			Outside	2-#11@200	0.671	3-#11@200	1.006		
5 Basemat	90306 90310 90410	4.0	Top	3-#11@200 +1-#11@400	0.440	3-#11@200 +1-#11@400	0.440	#11@400x400	0.629
			Bottom	5-#11@200	0.629	5-#11@200	0.629		
5 Basemat @ Spent Fuel Pool	90486	5.5	Top	3-#11@200 +1-#11@400	0.320	3-#11@200 +1-#11@400	0.320	#11@600x400	0.419
			Bottom	5-#11@200	0.457	5-#11@200	0.457		
	90490 90526	5.5	Top	3-#11@200 +1-#11@400	0.320	3-#11@200 +1-#11@400	0.320	#11@400x400	0.629
			Bottom	5-#11@200	0.457	5-#11@200	0.457		
6 Slab EL4.65m	93306 93310 93410	1.3	Top	2-#11@200	0.774	2-#11@200	0.774	#5@200x200	0.500
			Bottom	2-#11@200	0.774	2-#11@200	0.774		

Note *1: Exterior Wall, Pool Wall Direction1: Horizontal, Direction2: Vertical
Basemat, Slab Direction1: N-S, Direction2: E-W
Note *2: Rebar in parentheses indicates additional bars locally required.

Table 3G.3-14

Rebar and Concrete Stresses: Selected Load Combination FB-4

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	-3.3	-29.3	-3.9	-18.6	-6.4	-3.4	372.2
	60219	-5.7	-29.0	-6.6	13.2	-29.8	53.8	370.1
	70201	-9.3	-29.0	-5.9	102.8	2.7	105.4	370.1
	70204	-9.9	-29.0	-1.9	20.3	-23.6	82.4	370.1
	110718	-9.0	-29.1	-11.7	70.8	-19.5	48.0	370.3
2 Exterior Wall @ EL4.65 ~6.60m	62011	-3.0	-29.3	46.6	84.1	-14.1	27.4	372.2
	62019	-9.6	-29.3	46.1	109.7	-23.1	76.7	372.2
	72001	-9.5	-29.3	17.1	107.4	-21.9	73.0	372.2
	72004	-5.5	-29.3	60.2	35.5	3.7	18.0	372.2
3 Exterior Wall @ EL22.50 ~24.60m	64011	-7.7	-29.3	29.2	116.2	-15.7	73.9	372.2
	64019	-6.9	-29.3	38.3	138.5	-4.3	106.7	372.2
	74001	-4.6	-29.3	22.9	92.7	3.0	79.3	372.2
	74004	-7.7	-29.3	12.6	106.8	1.5	117.4	372.2
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	-4.1	-29.0	-16.6	9.4	-18.1	8.6	370.1
	70801	-11.5	-29.0	-26.6	123.7	8.3	44.7	370.1
	70804	-2.2	-29.0	-11.2	-0.9	-2.8	1.4	370.1
	110748	-7.0	-29.1	0.0	44.0	-25.4	26.6	370.3
5 Basemat	90306	-2.1	-23.5	-2.0	-13.9	-4.8	-4.0	372.2
	90310	-0.8	-23.5	-2.6	-4.6	-2.0	-4.8	372.2
	90410	-2.1	-23.5	-8.0	-1.6	-4.8	-13.6	372.2
5 Basemat @ Spent Fuel Pool	90486	-3.5	-23.2	-9.4	4.3	-12.7	4.4	370.1
	90490	-3.5	-23.2	-9.1	15.1	-3.5	5.7	370.1
	90526	-2.7	-23.2	-3.1	8.0	-11.0	1.9	370.1
6 Slab EL4.65m	93306	-1.8	-29.3	18.8	4.7	42.3	5.5	372.2
	93310	-7.5	-29.3	-12.3	54.1	-13.9	57.3	372.2
	93410	-2.5	-29.3	-1.1	-1.9	-15.9	-16.7	372.2

Note: Negative value means compression.
Note *: Exterior Wall, Pool Wall Direction1: Horizontal, Direction2: Vertical
Basemat, Slab Direction1: N-S, Direction2: E-W

Table 3G.3-15

Rebar and Concrete Stresses: Selected Load Combination FB-8

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	-2.6	-29.3	-3.8	-14.9	-10.4	-2.0	372.2
	60219	-5.0	-29.0	-5.5	9.6	-27.9	32.1	370.1
	70201	-6.3	-29.0	-4.1	68.6	-2.1	70.9	370.1
	70204	-7.1	-29.0	-0.5	20.3	-23.7	52.4	370.1
	110718	-7.2	-29.1	-5.2	59.8	-20.4	27.5	370.3
2 Exterior Wall @ EL4.65 ~6.60m	62011	-1.9	-29.3	28.9	58.9	-20.4	11.4	372.2
	62019	-8.9	-29.3	37.4	99.0	-23.3	65.6	372.2
	72001	-7.1	-29.3	12.2	58.6	-30.9	3.6	372.2
	72004	-2.5	-29.3	54.0	46.5	-47.1	28.4	372.2
3 Exterior Wall @ EL22.50 ~24.60m	64011	-8.0	-29.3	34.9	111.5	-18.2	70.0	372.2
	64019	-6.6	-29.3	42.6	107.6	0.0	76.5	372.2
	74001	-4.1	-29.3	30.1	75.2	10.4	66.0	372.2
	74004	-6.6	-29.3	10.8	98.1	3.4	105.4	372.2
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	-3.7	-29.0	-11.2	7.5	-18.3	5.3	370.1
	70801	-7.9	-29.0	-17.2	89.1	3.1	25.9	370.1
	70804	-3.0	-29.0	23.5	-13.4	-6.8	2.8	370.1
	110748	-5.4	-29.1	0.9	35.7	-21.3	15.5	370.3
5 Basemat	90306	-1.8	-23.5	-1.5	-12.0	-4.4	-2.6	372.2
	90310	-0.7	-23.5	-1.7	-3.8	-1.6	-4.0	372.2
	90410	-1.8	-23.5	-7.2	-0.8	-4.5	-12.1	372.2
5 Basemat @ Spent Fuel Pool	90486	-2.6	-23.2	-7.5	0.4	-10.1	1.3	370.1
	90490	-2.7	-23.2	-7.1	10.3	-4.4	2.8	370.1
	90526	-2.0	-23.2	-2.6	3.3	-8.3	0.7	370.1
6 Slab EL4.65m	93306	-2.2	-29.3	53.9	38.3	65.0	46.6	372.2
	93310	-6.0	-29.3	-0.9	49.9	-9.8	59.9	372.2
	93410	-1.8	-29.3	-0.2	-3.6	-10.6	-11.5	372.2

Note: Negative value means compression.
Note *: Exterior Wall, Pool Wall Direction1: Horizontal, Direction2: Vertical
Basemat, Slab Direction1: N-S, Direction2: E-W

Table 3G.3-16

Rebar and Concrete Stresses: Selected Load Combination FB-9

Location	Element ID	Concrete Stress (Mpa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				Direction 1*		Direction 2*		
				In/Top	Out/Bottom	In/Top	Out/Bottom	
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	-9.4	-29.3	216.3	182.8	246.8	254.0	372.2
	60219	-13.2	-29.0	71.9	293.2	186.0	287.0	370.1
	70201	-14.2	-29.0	85.2	217.1	49.1	203.4	370.1
	70204	-15.1	-29.0	65.8	192.3	125.5	262.7	370.1
	110718	-12.3	-29.1	-23.9	130.9	127.3	184.1	370.3
2 Exterior Wall @ EL4.65 ~6.60m	62011	-10.2	-29.3	188.2	312.8	144.4	305.5	372.2
	62019	-14.2	-29.3	144.7	231.9	81.7	223.8	372.2
	72001	-12.0	-29.3	50.4	285.0	69.2	220.9	372.2
	72004	-13.3	-29.3	178.4	230.9	180.4	265.1	372.2
3 Exterior Wall @ EL22.50 ~24.60m	64011	-23.7	-29.3	203.7	353.2	-95.8	334.0	372.2
	64019	-18.3	-29.3	186.4	297.9	68.7	219.3	372.2
	74001	-7.5	-29.3	121.1	126.0	81.5	104.1	372.2
	74004	-13.5	-29.3	92.8	179.6	67.9	201.3	372.2
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	-6.3	-29.0	68.9	127.8	235.2	214.0	370.1
	70801	-22.2	-29.0	-44.1	303.1	64.4	230.2	370.1
	70804	-10.8	-29.0	177.6	69.4	234.7	162.9	370.1
	110748	-7.3	-29.1	13.4	112.1	-32.8	134.6	370.3
5 Basemat	90306	-10.1	-23.5	221.4	177.4	238.2	51.7	372.2
	90310	-2.5	-23.5	-10.1	10.8	-8.0	11.6	372.2
	90410	-12.2	-23.5	219.2	59.1	238.6	111.6	372.2
5 Basemat @ Spent Fuel Pool	90486	-15.5	-23.2	238.7	184.5	83.9	130.4	370.1
	90490	-7.5	-23.2	87.6	97.8	70.7	209.4	370.1
	90526	-10.1	-23.2	282.4	162.4	177.6	71.9	370.1
6 Slab EL4.65m	93306	-4.2	-29.3	249.1	123.6	130.7	176.0	372.2
	93310	-8.2	-29.3	97.2	85.3	51.0	117.4	372.2
	93410	-5.4	-29.3	83.9	-19.8	115.8	52.3	372.2

Note: Negative value means compression.
Note *: Exterior Wall, Pool Wall Direction1: Horizontal, Direction2: Vertical
Basemat, Slab Direction1: N-S, Direction2: E-W

Table 3G.3-17

Transverse Shear of FB

Location	Element ID	Load ID	d (m)	pv (%)	Shear Force (MN/m)				Vu/ϕVn
					Vu	Vc	Vs	ϕVn	
1 Exterior Wall and Pool Wall @ EL-11.50 ~-10.50m	60011	FB-4	1.72	0.177	1.12	3.49	1.26	4.04	0.279
	60219	FB-9	3.34	0.177	3.13	1.82	2.45	3.63	0.863
	70201	FB-4	1.69	0.177	0.54	1.62	1.23	2.42	0.224
	70204	FB-9	1.69	0.710	2.39	0.06	4.97	4.28	0.559
	110718	FB-4	1.21	0.355	0.27	1.23	1.77	2.55	0.104
2 Exterior Wall @ EL4.65 ~6.60m	62011	FB-4	0.72	0.125	0.04	0.71	0.37	0.92	0.047
	62019	FB-4	0.72	0.125	0.06	0.74	0.37	0.95	0.067
	72001	FB-9	0.74	0.125	0.28	0.00	0.38	0.33	0.876
	72004	FB-4	0.72	0.125	0.17	0.89	0.37	1.08	0.161
3 Exterior Wall @ EL22.50 ~24.60m	64011	FB-8	0.78	0.125	0.08	0.78	0.40	1.00	0.075
	64019	FB-4	0.81	0.125	0.07	0.08	0.42	0.43	0.167
	74001	FB-4	0.72	0.125	0.11	0.13	0.37	0.43	0.257
	74004	FB-4	0.72	0.125	0.06	0.07	0.37	0.38	0.168
4 Spent Fuel Pool Wall @ EL-5.10 ~-3.30m	60819	FB-4	3.32	0.177	0.80	6.45	2.43	7.54	0.105
	70801	FB-9	1.69	0.710	3.84	1.95	4.97	5.88	0.654
	70804	FB-9	1.59	0.177	0.67	0.61	1.17	1.51	0.443
	110748	FB-4	1.21	0.177	0.52	1.39	0.89	1.94	0.270
5 Basemat	90306	FB-9	3.51	0.629	6.69	1.96	9.14	9.43	0.709
	90310	FB-4	3.50	0.629	0.47	5.72	9.11	12.61	0.037
	90410	FB-9	3.53	0.629	3.39	2.22	9.18	9.69	0.350
5 Basemat @ Spent Fuel Pool	90486	FB-8	4.99	0.419	0.30	8.65	8.65	14.70	0.020
	90490	FB-9	5.01	0.629	12.88	9.25	13.03	18.93	0.681
	90526	FB-9	4.98	0.629	6.25	5.81	12.95	15.95	0.392
6 Slab EL4.65m	93306	FB-9	1.10	0.500	0.28	0.33	2.27	2.21	0.128
	93310	FB-4	1.10	0.500	0.48	2.86	2.27	4.36	0.111
	93410	FB-4	1.10	0.500	0.18	2.07	2.27	3.69	0.048

Figure 3G.3-1. Sections Where Thermal Loads Are Defined

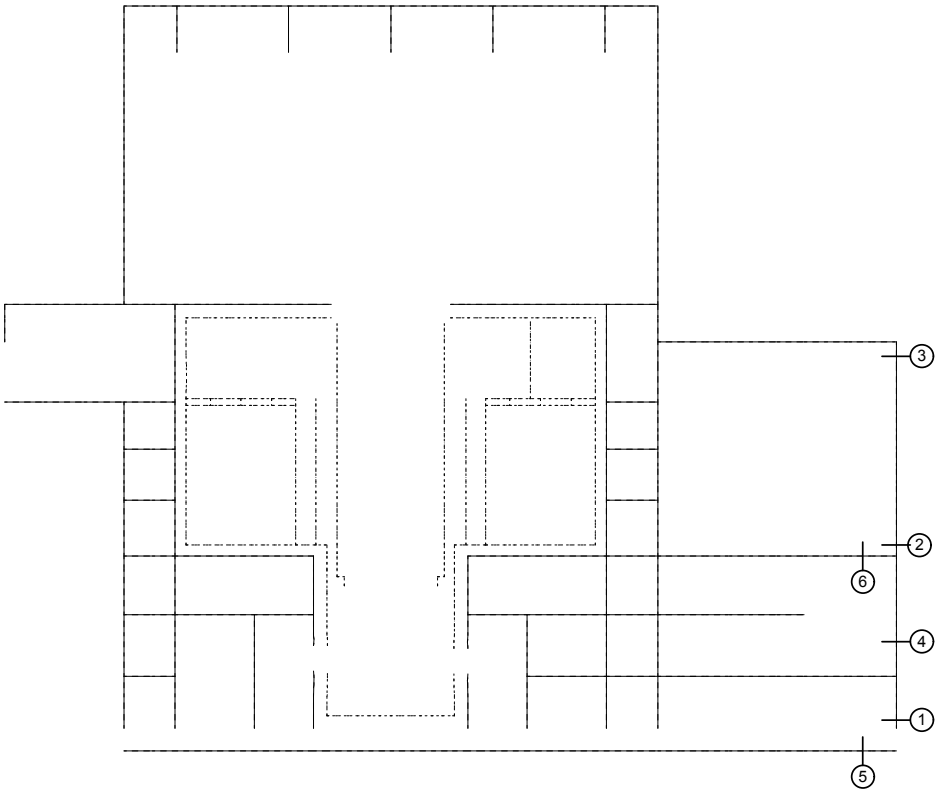

Figure 3G.3-2. Section Considered for Analysis

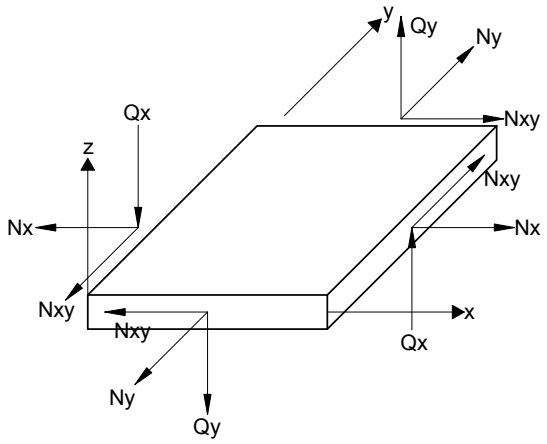

Membrane and Shear Forces

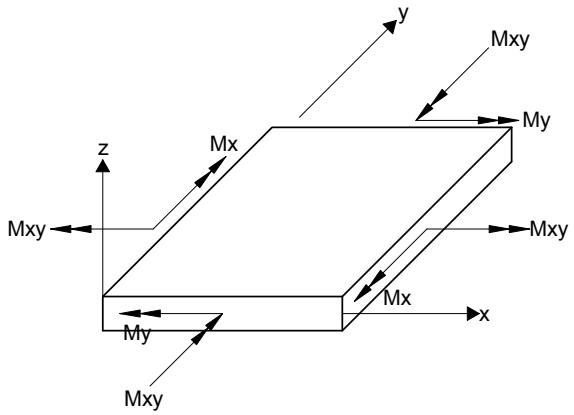

Moments

Definition of Element Coordinate System

Structure	x	y	z
External Wall	horizontal	vertical	outward
Wall in N-S Direction	horizontal	vertical	toward West
Wall in E-W Direction	horizontal	vertical	toward South
Foundation Mat Floor Slab	toward South	toward West	downward

Figure 3G.3-3. Force and Moment in Shell Element

Figure 3G.3-4. Reinforcing Steel of Spent Fuel Pool Walls

Figure 3G.3-5. List of FB Wall and Slab Reinforcement

3G.4 FIRE WATER SERVICE COMPLEX

3G.4.1 Objective and Scope

The objective of this subsection is to document the structural design details, inputs and analytical results from the analysis of the Fire Water Service Complex (FWSC) of the standard ESBWR plant. The scope includes the design and analysis of the structure for normal, severe environmental, extreme environmental, and construction loads.

3G.4.2 Conclusion

The following are the major summary conclusions on the design and analysis of the FWSC.

- Based on the results of finite element analyses performed in accordance with the design conditions identified in Subsection 3G.4.3, stresses in concrete and reinforcement are less than the allowable stresses per the applicable regulations, codes and standards listed in Section 3.8.
- The factors of safety against floatation, sliding, and overturning of the structure under various loading combinations are higher than the required minimum.
- The thickness of the roof slabs and exterior walls are more than the minimum required to preclude penetration, perforation and spalling resulting from impact of design basis tornado missiles.

3G.4.3 Structural Description

The FWSC consists of two Fire Water Storage Tanks (FWS) and a Fire Pump Enclosure (FPE) that share a common basemat. Each FWS is capable of storing 2082 m^3 (550000 gallons) of water. The FPE provides enclosure and protection for the Electric Pump, RPV Makeup Water Pump, Diesel Pump, Tank Recirculation Pump, and Diesel Fuel Oil Storage Tank (FO).

The FWS is designed with a cylindrical reinforced concrete wall and a dome-shaped reinforced concrete roof. The FWS is lined with a stainless steel plate to prevent leakage of the stored water. The liner plate is not designed to provide structural integrity to the FWS. The FPE is a reinforced concrete box type structure with shear walls and a roof slab.

The key dimensions of the FWSC are summarized in Table 3.8-8. Figure 3G.4-1 shows the concrete outline drawing of the FWSC.

3G.4.4 Analytical Models

3G.4.4.1 Structural Model

The FWSC is analyzed utilizing the finite element computer program NASTRAN. The finite element model consists of quadrilateral and triangular elements to represent the slabs and walls. The model is shown in Figures 3G.4-2 to 3G.4-6. The model includes the whole portion of the FWSC taking the application of nonaxisymmetrical loads into consideration.

The nodal points are defined by a right hand Cartesian coordinate system X, Y, Z. This system, called the global coordinate system, has its origin located at the center of the FWSC at EL 0 mm. The positive X axis is in the south direction; the Y axis is in the east direction; the Z axis is vertical upward. This coordinate system is shown in Figure 3G.4-2.

3G.4.4.2 Foundation Models

The foundation soil is represented by soil springs. The spring constants for rocking and translations are determined based on the following soil parameters which correspond to the Soft Site conditions described in Appendix 3A:

- Shear wave velocity: 300 m/s (1000 ft/s)
- Unit weight: 0.0196 MN/m^3 (125 lbf/ft^3)
- Shear modulus: 180 MN/m^2 (26110 psi)
- Poisson's Ratio: 0.478

Soil springs are attached to the bottom of the foundation mat, and the constraints by side soil are not included in the model. The values of the soil springs used in the analysis are shown in Table 3G.4-1. The springs have perfectly elastic stiffness.

These spring values are multiplied by the foundation mat nodal point tributary areas to compute the spring constants assigned to the base slab nodal points.

3G.4.5 Structural Analysis and Design

3G.4.5.1 Site Design Parameters

The key site design parameters are described in Subsection 3G.1.5.1.

3G.4.5.2 Design Loads, Load Combinations, and Material Properties

3G.4.5.2.1 Design Loads

3G.4.5.2.1.1 Dead Load (D) and Live Load (L and L_o)

The weights of structures are evaluated using the following unit weights.

- reinforced concrete: 23.5 kN/m^3 (150 lbf/ft^3)
- steel: 77.0 kN/m^3 (490 lbf/ft^3)

Weights of major equipment, miscellaneous structures, piping, and commodities are summarized in Tables 3G.4-2 and 3G.4-3.

Live loads on the FWSC floor and roof slabs are described in Subsection 3.8.4.3.5.

3G.4.5.2.1.2 Snow and Rain Load

The snow and rain load is applied to the roof slab and is taken as shown in Table 3G.1-2. One hundred percent of the snow load is applied when combined with seismic loads.

3G.4.5.2.1.3 Lateral Soil Pressure

Lateral soil pressure is not considered since the effect of lateral soil pressure against the solid concrete basemat is neglibible.

3G.4.5.2.1.4 Wind Load (W)

Wind load is applied to the roof slab and external walls above grade and is based on basic wind speed given in Table 3G.1-2.

3G.4.5.2.1.5 Tornado Load (W_t)

The tornado load is applied to the roof slab and external walls above grade and its characteristics are given in Table 3G.1-2. The tornado load, W_t, is further defined by the combinations described in Subsection 3G.1.5.2.1.5.

3G.4.5.2.1.6 Thermal Load (T_o)

Thermal load for the FWSC is evaluated for the normal operating condition. Figure 3G.4-7 shows the section location for temperature distributions for various structural elements of the FWSC, and Table 3G.4-4 shows the magnitude of equivalent linear temperature distribution.

Stress-free temperature is 15.5°C (60°F).

3G.4.5.2.1.7 Design Seismic Loads

The design seismic loads are obtained by soil – structure interaction analyses, which are described in Appendix 3A. The seismic loads used for design are as follows:

- Figures 3G.4-8, 3G.4-9: design seismic shears and moments
- Table 3G.4-5: maximum vertical acceleration

The seismic loads are composed of two perpendicular horizontal and one vertical components. The effects of the three components are combined based on the 100/40/40 method as described in Subsection 3.8.1.3.6.

3G.4.5.2.2 Load Combinations and Acceptance Criteria

Table 3.8-15 gives load combinations for the safety-related reinforced concrete structure. Based on previous experience, critical load combinations are selected for the FWSC design as shown in Table 3G.4-6. The acceptance criteria for the selected combinations are also included in Table 3G.4-6.

3G.4.5.2.3 Material Properties

Properties of the materials used for the FWSC design analyses are the same as those for the RB, and they are described in Subsection 3G.1.5.2.3.

3G.4.5.3 Stability Requirements

The stability requirements for the FWSC foundation are same as those for the RB, and they are described in Subsection 3G.1.5.3.

3G.4.5.4 Structural Design Evaluation

The evaluation of the Seismic Category I structures in the FWSC is performed using the same procedure as the RB, which is described in Subsection 3G.1.5.4.

The locations of the sections that are selected for evaluation are indicated in Figures 3G.4-3 through 3G.4-6. They are selected, in principle, from the center and both ends of wall and slab, where it is reasonably expected that the critical stresses appear based on engineering experience and judgment. Tables 3G.4-7 through 3G.4-11 show the forces and moments at the selected sections from NASTRAN analysis. Element forces and moments listed in the tables are defined with relation to the element coordinate system shown in Figure 3G.4-10. Tables 3G.4-12

through 3G.4-15 show the combined forces and moments in accordance with the selected load combinations listed in Table 3G.4-6.

Table 3G.4-16 lists the sectional thicknesses and rebar ratios used in the evaluation. The values are retrieved from the outline drawings shown in Figures 3G.4-1.

Tables 3G.4-17 through 3G.4-20 show the rebar and concrete stresses at these sections for the representative elements. Table 3G.4-21 summarizes evaluation results for transverse shear in accordance with ACI 349, Chapter 11.

3G.4.5.4.1 Shear Walls

The maximum rebar stress of 285.5 MPa (41.41 ksi) is found in the vertical rebar of FWS cylindrical wall due to the load combination FWSC-6 as shown in Table 3G.4-19. The maximum horizontal rebar stress is found to be 230.7 MPa (33.46 ksi) also in FWS cylindrical wall due to the load combination FWSC-6. The maximum transverse shear force is found to be 0.840 MN/m (4.80 kips/in) against the shear strength of 1.632 MN/m (9.32 kips/in) in the FWS cylindrical wall.

As for the FPE, the maximum rebar stress of 220.3 MPa (31.95 ksi) is found in the horizontal rebar of east wall due to the load combination FWSC-6. The maximum vertical rebar stress is found to be 201.5 MPa (29.23 ksi) in south wall in the same load combination. The maximum transverse shear force is found to be 0.838 MN/m (4.79 kips/in) against the shear strength of 1.205 MN/m (6.88 kips/in).

3G.4.5.4.2 Roof Floor Slabs

As for the FPE roof slab, the maximum rebar stress of 253.4 MPa (36.75 ksi) is found due to the load combination FWSC-6 as shown in Table 3G.4-19. The maximum transverse shear force is found to be 0.117 MN/m (0.67 kips/in) against the shear strength of 0.399 MN/m (2.28 kips/in) in the roof of FPE.

On the FWS roof slab, the maximum rebar stress of 177.4 MPa (25.73 ksi) is found due to the load combination FWSC-6. The maximum transverse shear force is found to be 0.065 MN/m (0.37 kips/in) against the shear strength of 0.386 MN/m (2.20 kips/in).

3G.4.5.4.3 Foundation Mat

The maximum rebar stress is found to be 294.8 MPa (42.76 ksi) due to the load combination FWSC-6 as shown in Table 3G.4-19. The maximum transverse shear force is found to be 2.492 MN/m (14.23 kips/in) against the shear strength of 5.394 MN/m (30.80 kips/in).

3G.4.5.5 Foundation Stability

The stabilities of the FWSC foundation against overturning, sliding and floatation are evaluated. The energy approach is used in calculating the factor of safety against overturning.

The factors of safety against overturning, sliding and floatation are given in Table 3G.4-22. All of these meet the acceptance criteria given in Table 3.8-14. Shear keys under the basemat shown in Figure 3G.4-1 are used to resist sliding. In addition, the gap between the basemat and excavated soil is backfilled with concrete up to the grade level as shown in Figure 3G.4-11.

Maximum soil bearing stress is found to be 165 kPa (3450 psf) due to dead plus live loads. Maximum bearing stresses for load combinations involving SSE are shown in Table 3G.4-23 for various site conditions.

3G.4.5.5.1 Foundation Settlement

The basemat design is checked against the normal and differential settlement of the FWSC. It is found that the basemat can resist the maximum settlement at mat foundation corner of 17 mm (0.7 in.) and the settlement averaged at four corners of 10 mm (0.4 in.). The relative displacement between two corners along the longest dimension of the building basemat calculated under linearly varying soil stiffness is 12 mm (0.5 in). These values are specified as maximum settlements in Table 2.0-1.

3G.4.5.6 Tornado Missile Evaluation

The FWSC is shown in Figure 3G.4-1. The minimum thickness required to prevent penetration, concrete spalling and scabbing is evaluated. The methods and procedures are shown in Subsection 3.5.3.1.1.

Table 3G.4-1

Soil Spring Constants for FWSC Analysis Model

Direction of Spring		Loads	Stiffness ($MN/m/m^2$)
Horizontal	X-direction	All	15.303
	Y-direction	All	17.591
Vertical		Horizontal Seismic Loads	63.417
		Other Loads	23.861

Table 3G.4-2

Equipment Load of FWSC

Description	Weight	Remarks
Diesel Pump Skid	106.8 kN (24,000 lbf)	
RPV Makeup Water Pump Skid	106.8 kN (24,000 lbf)	
Electric Pump Skid	89.0 kN (20,000 lbf)	
FO	44.5 kN (10,000 lbf)	Each Tank
Tank Recirculation Pump	2.2 kN (500 lbf)	Each Pump

Table 3G.4-3

Miscellaneous Structures, Piping, and Commodity Load of FWSC

Region	Area Load
Roof of FPE	2.4 kN/m^2 (50psf)

Table 3G.4-4

Equivalent Linear Temperature Distributions at Various Sections

Section*1	Side*2		Equivalent Linear Temperature*3(°C)	
			Normal Operation	
	1	2	T_d	T_g
W1	FWS	AT	-16.9	42.8
W2	FPE	AT	-22.4	31.3
S1	GR	FWS	10.0	11.0
S2	GR	FPE	10.5	10.1
S3	GR	AT	-11.8	54.6
S4	AT	FWS	-16.4	-41.7
S5	AT	FPE	-22.7	-30.6

Note *1: See Figure 3G.4-7 for the location of sections.

Note *2: FWS: Fire Water Storage Tank,
FPE: Fire Pump Enclosure,
AT: Air,
GR: Ground

Note *3: T_d: Average Temperature,
T_g: Surface Temperature Difference (positive when temperature at Side 1 is higher)

Table 3G.4-5

Maximum Vertical Acceleration

Elevation (m)	Node No.	Stick Model	Max. Vertical Acceleration (g)
19.70	10	FWS	1.69
17.25	9	FWS	1.64
15.53	8	FWS	1.58
13.81	7	FWS	1.58
12.10	6	FWS	1.43
11.00	5	FWS	1.23
9.90	4	FWS	1.13
8.81	3	FWS	1.05
6.73	2	FWS	1.00
4.65	8002	FWSC	0.78
2.15	8001	FWSC	0.78
19.70	11	Oscillator	3.26

Elevation (m)	Node No.	Stick Model	Max. Vertical Acceleration (g)
8.25	405	FPE	1.12
6.45	402	FPE	1.09

See Figure 3A.7-7 for the node numbers.

Table 3G.4-6

Selected Load Combinations for FWSC

Category	Load Combination									Acceptance Criteria*1
	No. *2	D	L	H	T_o	E'	W	W_t	R_o	
Severe	FWSC-3	1.4	1.7	1.7			1.7		1.7	U
Environmental	FWSC-4	1.05	1.3	1.3	1.3		1.3		1.3	U
SSE	FWSC-6	1.0	1.0	1.0	1.0	1.0			1.0	U
Tornado	FWSC-7	1.0	1.0	1.0	1.0			1.0	1.0	U

*1: U = Required section strength based on the strength design method per ACI 349

*2: Based on Table 3.8-15.

Table 3G.4-7

Results of NASTRAN Analysis: Dead Load

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL 4.65	18	-0.016	-0.007	-0.036	-0.163	0.079	0.039	-0.018	-0.060
	227	-0.033	0.073	0.012	0.206	0.064	0.012	-0.116	-0.028
	237	0.015	-0.003	-0.024	0.137	0.140	-0.127	-0.159	0.121
	16085	-0.013	0.051	0.009	0.229	0.016	0.040	0.159	0.017
Roof of FPE EL 8.25	51556	-0.025	-0.010	0.002	0.068	0.081	-0.005	0.007	0.011
	51558	-0.037	-0.102	-0.001	-0.043	0.012	-0.011	0.064	-0.003
	51576	0.096	-0.042	0.019	0.002	-0.061	-0.010	-0.004	0.076
	51578	0.016	-0.050	0.028	-0.011	-0.018	-0.026	0.005	0.016
Roof of Tank	26007	-0.160	-0.145	-0.004	0.008	0.008	0.000	0.000	0.000
	26079	0.086	-0.084	0.022	-0.001	-0.021	0.002	-0.003	0.022
	26082	-0.007	0.010	0.091	-0.012	-0.011	0.011	-0.017	0.016
	26085	-0.041	0.046	-0.082	-0.017	-0.007	-0.009	-0.020	-0.012
South Wall of FPE	66004	-0.039	-0.119	0.015	-0.002	-0.004	-0.001	-0.001	0.033
	66006	-0.037	0.017	0.101	0.000	-0.017	-0.003	-0.007	-0.017
	66024	-0.135	-0.109	0.008	-0.015	-0.084	0.003	0.000	0.037
East Wall of FPE	67004	0.063	-0.235	-0.031	-0.003	-0.030	0.001	-0.001	-0.056
	67006	0.089	-0.038	-0.151	-0.005	-0.012	0.002	0.001	-0.025
	67024	0.136	-0.136	-0.028	0.019	0.099	-0.002	0.000	-0.060
Wall of South Tank	35007	-0.037	-0.287	0.015	-0.007	-0.013	-0.001	-0.003	-0.002
	35010	-0.019	-0.401	-0.007	0.003	0.002	0.000	0.003	0.003
	36507	-0.013	-0.216	0.004	-0.004	0.001	0.001	-0.001	-0.004
	36510	-0.002	-0.248	0.005	0.003	0.002	0.000	0.000	-0.002
	38507	0.163	-0.086	0.001	-0.004	-0.016	0.000	0.000	0.027
	38510	0.171	-0.090	0.005	-0.002	-0.016	0.000	0.000	0.029
	45001	-0.029	-0.336	0.008	-0.003	-0.005	-0.001	-0.002	0.002
	46501	-0.011	-0.242	0.000	-0.001	0.002	0.000	-0.001	-0.003
	48501	0.174	-0.091	-0.002	-0.003	-0.016	0.000	0.000	0.029

Table 3G.4-8

Results of NASTRAN Analysis: Thermal Load (Winter)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL 4.65	18	7.239	0.100	2.067	-7.814	-0.851	-0.213	0.297	0.515
	227	-4.086	11.505	-0.511	-4.282	-5.855	0.160	0.414	0.102
	237	2.818	5.077	2.534	-6.217	-3.479	-0.850	-0.598	-0.489
	16085	-5.159	-1.585	0.473	-1.578	0.051	-0.067	-0.302	0.016
Roof of FPE EL 8.25	51556	0.103	0.204	-0.005	-0.288	-0.237	0.000	-0.006	0.006
	51558	0.192	-0.460	-0.035	-0.196	-0.238	-0.007	-0.032	-0.003
	51576	0.873	0.137	0.094	-0.298	-0.299	-0.001	-0.002	0.025
	51578	0.213	-0.240	0.032	-0.255	-0.298	-0.019	-0.033	0.043
Roof of Tank	26007	0.037	-0.050	-0.005	-0.392	-0.393	0.000	0.001	0.001
	26079	0.446	0.095	0.040	-0.447	-0.537	0.011	-0.010	0.080
	26082	0.344	0.122	0.072	-0.485	-0.483	0.042	-0.051	0.050
	26085	0.247	0.155	0.013	-0.494	-0.460	-0.034	-0.054	-0.034
South Wall of FPE	66004	2.987	-0.168	-0.139	-0.422	-0.736	0.004	-0.010	-0.195
	66006	1.814	1.030	-0.411	-0.380	-0.708	-0.026	-0.208	-0.635
	66024	-0.095	0.004	-0.045	-0.350	-0.279	0.001	0.012	-0.224
East Wall of FPE	67004	3.150	-0.678	-0.268	0.383	0.437	-0.002	0.002	0.032
	67006	3.345	0.519	-2.131	0.316	0.400	0.006	0.139	0.169
	67024	1.668	-0.149	-0.255	0.373	0.347	0.001	-0.008	0.049
Wall of South Tank	35007	2.645	-0.874	0.216	-1.095	-0.832	0.004	-0.028	-0.155
	35010	2.442	0.128	-0.119	-1.243	-1.177	0.034	0.012	-0.330
	36507	-0.289	-0.438	0.019	-1.133	-1.146	-0.004	-0.008	0.076
	36510	-0.308	0.014	-0.303	-1.193	-1.142	-0.003	0.011	0.071
	38507	0.145	-0.080	0.002	-1.102	-0.770	0.003	0.001	-0.174
	38510	-0.057	0.007	-0.194	-1.114	-0.771	-0.020	-0.006	-0.206
	45001	3.400	0.799	-0.075	-1.157	-1.218	-0.008	0.025	-0.350
	46501	-0.328	0.546	0.096	-1.199	-1.168	-0.005	-0.001	0.078
	48501	-0.235	0.098	0.060	-1.123	-0.772	0.006	0.002	-0.235

Table 3G.4-9

Results of NASTRAN Analysis: Seismic Load (Horizontal: North to South Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL 4.65	18	0.048	0.126	0.106	-1.330	-0.131	0.314	0.554	0.160
	227	0.535	0.093	-0.191	-4.338	-1.370	0.043	1.814	0.263
	237	0.830	-0.163	0.150	-3.860	-0.806	0.396	0.626	-0.692
	16085	-0.436	0.223	-0.071	-2.915	-1.171	-0.124	-0.704	-0.074
Roof of FPE EL 8.25	51556	0.034	0.060	-0.084	-0.001	-0.003	-0.003	0.002	0.000
	51558	0.048	0.595	-0.002	-0.020	-0.015	0.000	0.010	-0.002
	51576	0.012	0.023	-0.367	0.000	0.004	-0.004	-0.002	-0.003
	51578	-0.010	0.150	-0.101	-0.005	0.007	-0.003	0.006	-0.012
Roof of Tank	26007	0.065	-0.056	0.005	-0.002	-0.002	0.000	-0.003	0.000
	26079	0.128	-0.083	-0.032	-0.005	-0.011	0.004	0.000	0.007
	26082	0.039	-0.242	-0.083	0.002	0.001	-0.003	0.011	-0.007
	26085	-0.030	-0.272	0.156	0.011	0.004	0.006	0.020	0.011
South Wall of FPE	66004	0.294	-0.362	-0.148	-0.001	-0.006	0.000	0.008	0.015
	66006	0.230	0.179	-0.488	-0.009	-0.055	-0.011	-0.005	-0.107
	66024	0.768	-0.081	-0.094	-0.011	-0.027	-0.003	-0.001	0.008
East Wall of FPE	67004	0.066	-0.107	0.573	0.002	0.009	-0.003	-0.001	0.005
	67006	0.530	0.034	0.023	0.004	0.036	-0.003	0.010	0.059
	67024	0.039	-0.028	0.454	-0.001	-0.003	0.001	0.002	0.007
Wall of South Tank	35007	0.452	-0.361	-1.065	-0.011	-0.133	-0.015	0.007	-0.138
	35010	1.140	1.472	-0.998	-0.085	-0.519	0.020	0.007	-0.453
	36507	-0.090	-0.310	-1.088	0.029	0.049	-0.009	-0.017	0.013
	36510	-0.582	0.624	-0.944	0.027	0.088	-0.015	0.010	0.034
	38507	0.111	-0.063	-0.233	0.009	0.005	0.007	0.001	0.031
	38510	-0.483	0.136	-0.305	0.010	0.028	-0.017	-0.006	0.013
	45001	1.299	2.708	0.257	-0.156	-0.709	-0.007	0.016	-0.566
	46501	-0.786	1.186	0.230	-0.019	0.083	0.004	-0.005	0.033
	48501	-0.742	0.238	0.078	0.000	0.035	0.006	0.002	-0.009

Table 3G.4-10

Results of NASTRAN Analysis: Seismic Load (Horizontal: East to West Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL 4.65	18	0.881	0.277	0.491	0.830	-0.330	-0.617	0.283	0.260
	227	0.015	0.180	1.012	-0.022	-0.275	-1.357	0.344	0.278
	237	-0.128	-0.734	0.222	0.943	1.411	-1.068	-0.935	0.864
	16085	0.109	-0.022	-0.178	-0.346	-0.153	-0.364	-0.161	0.095
Roof of FPE EL 8.25	51556	0.080	0.027	-0.078	-0.008	-0.006	-0.006	-0.001	0.009
	51558	0.024	-0.067	-0.272	0.010	0.003	-0.012	-0.010	-0.008
	51576	0.736	-0.018	0.024	-0.029	-0.065	0.002	-0.001	0.024
	51578	0.219	-0.091	-0.034	0.012	-0.021	0.002	-0.029	0.026
Roof of Tank	26007	-0.004	0.004	0.031	0.000	-0.001	-0.001	0.000	-0.003
	26079	0.199	0.062	0.072	0.003	0.001	0.002	-0.003	0.014
	26082	0.121	0.072	0.129	-0.010	-0.003	0.006	-0.011	0.011
	26085	-0.107	0.063	0.082	0.004	0.000	0.001	0.002	0.004
South Wall of FPE	66004	-0.052	0.109	-0.039	-0.004	-0.022	0.006	0.003	-0.016
	66006	-0.312	0.232	0.516	-0.024	-0.075	0.002	-0.004	-0.104
	66024	-0.118	0.012	0.168	0.003	0.011	-0.002	-0.004	-0.016
East Wall of FPE	67004	0.252	-0.387	-0.142	-0.030	-0.155	0.001	-0.004	-0.094
	67006	0.308	-0.093	-0.729	-0.007	-0.082	0.000	-0.034	-0.100
	67024	0.911	-0.130	-0.099	0.010	0.041	0.005	0.004	-0.091
Wall of South Tank	35007	-0.817	-1.381	0.020	0.003	0.285	-0.019	-0.020	0.327
	35010	-0.346	-2.051	-0.981	0.105	0.324	-0.017	0.024	0.239
	36507	0.778	-0.652	0.004	-0.071	-0.088	0.004	-0.013	-0.032
	36510	0.584	-0.910	-0.885	0.049	-0.021	-0.006	-0.015	-0.006
	38507	0.577	-0.159	0.067	-0.023	-0.038	0.014	0.004	-0.033
	38510	0.485	-0.175	-0.177	0.007	-0.025	0.010	0.002	0.010
	45001	0.102	0.562	-1.622	-0.031	-0.080	0.016	0.029	-0.051
	46501	-0.137	0.251	-1.387	-0.020	0.000	-0.021	0.016	0.000
	48501	-0.117	0.046	-0.345	-0.004	0.006	-0.015	-0.004	-0.005

Table 3G.4-11

Results of NASTRAN Analysis: Seismic Load (Vertical: Upward Direction)

Location	Element ID	Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL 4.65	18	0.077	0.020	0.131	0.570	-0.144	-0.060	0.048	0.076
	227	0.086	-0.192	-0.031	0.020	-0.172	0.012	0.373	0.062
	237	-0.045	-0.003	0.044	-0.103	-0.288	0.097	0.402	-0.239
	16085	-0.027	-0.151	-0.025	-0.147	-0.196	-0.037	-0.019	-0.012
Roof of FPE EL 8.25	51556	0.015	-0.035	-0.003	-0.080	-0.109	0.006	-0.008	-0.015
	51558	0.022	0.251	0.009	0.037	-0.023	0.015	-0.072	0.004
	51576	-0.342	0.039	-0.051	0.005	0.086	0.012	0.006	-0.102
	51578	-0.083	0.115	-0.071	0.007	0.025	0.034	0.004	-0.028
Roof of Tank	26007	0.324	0.290	0.009	-0.016	-0.016	0.000	0.001	0.000
	26079	-0.168	0.167	-0.042	0.002	0.042	-0.005	0.005	-0.045
	26082	0.018	-0.024	-0.183	0.025	0.022	-0.021	0.034	-0.031
	26085	0.083	-0.095	0.168	0.033	0.014	0.019	0.040	0.024
South Wall of FPE	66004	0.100	0.092	-0.040	0.012	0.061	0.000	0.002	-0.011
	66006	0.084	-0.177	-0.270	0.006	0.065	0.006	0.021	0.082
	66024	0.347	0.124	-0.022	0.017	0.096	-0.005	-0.001	-0.017
East Wall of FPE	67004	-0.215	0.433	0.097	0.005	0.050	-0.001	0.002	0.082
	67006	-0.312	-0.013	0.490	0.011	0.026	-0.003	-0.002	0.047
	67024	-0.470	0.201	0.086	-0.027	-0.135	0.003	0.000	0.086
Wall of South Tank	35007	0.241	0.351	-0.038	0.001	-0.050	0.002	0.007	-0.052
	35010	0.188	0.601	-0.008	-0.016	-0.069	0.000	-0.007	-0.055
	36507	0.035	0.333	-0.006	0.011	0.010	-0.001	0.002	0.011
	36510	0.011	0.409	-0.017	-0.005	0.005	0.001	0.000	0.008
	38507	-0.324	0.160	-0.001	0.007	0.032	0.000	0.000	-0.054
	38510	-0.344	0.170	-0.016	0.005	0.033	-0.001	-0.001	-0.058
	45001	0.198	0.506	-0.013	-0.004	-0.049	0.001	0.006	-0.047
	46501	0.027	0.413	0.000	0.004	0.005	-0.001	0.001	0.010
	48501	-0.356	0.175	0.005	0.006	0.032	0.000	0.000	-0.059

Table 3G.4-12

Combined Forces and Moments: Selected Load Combination FWSC-3

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL 4.65	18	OTHR	-0.093	-0.003	-0.177	-0.857	0.139	0.112	-0.021	-0.070
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	227	OTHR	-0.106	0.333	0.002	-0.259	0.088	0.009	-0.369	-0.065
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	237	OTHR	0.133	0.020	0.027	-0.104	0.307	-0.157	-0.494	0.283
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	16085	OTHR	0.144	0.365	0.028	-0.243	0.082	0.020	-0.119	-0.006
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Roof of FPE EL 8.25	51556	OTHR	-0.012	0.056	0.001	0.102	0.138	-0.008	0.010	0.019
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	51558	OTHR	-0.019	-0.265	-0.007	-0.048	0.028	-0.019	0.092	-0.006
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	51576	OTHR	0.429	-0.040	0.053	-0.006	-0.107	-0.015	-0.007	0.129
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	51578	OTHR	0.104	-0.131	0.096	-0.008	-0.030	-0.044	-0.005	0.034
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Roof of Tank	26007	OTHR	-0.287	-0.225	-0.013	0.012	0.012	0.000	-0.002	0.000
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	26079	OTHR	0.116	-0.133	0.041	-0.001	-0.030	0.004	-0.004	0.034
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	26082	OTHR	-0.039	0.032	0.151	-0.019	-0.015	0.016	-0.025	0.023
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	26085	OTHR	-0.084	0.085	-0.148	-0.026	-0.010	-0.015	-0.030	-0.018
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000

OTHR: Loads other than thermal loads
TEMP: Thermal loads

Table 3G.4-12

Combined Forces and Moments: Selected Load Combination FWSC-3 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
South Wall of FPE	66004	OTHR	-0.079	-0.161	0.032	-0.015	-0.079	0.000	-0.002	0.019
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	66006	OTHR	-0.063	0.267	0.280	-0.008	-0.090	-0.008	-0.028	-0.113
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	66024	OTHR	-0.367	-0.166	0.014	-0.022	-0.125	0.006	0.002	0.018
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
East Wall of FPE	67004	OTHR	0.277	-0.560	-0.090	-0.007	-0.061	0.001	-0.002	-0.107
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	67006	OTHR	0.450	0.051	-0.635	-0.013	-0.027	0.004	0.005	-0.053
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	67024	OTHR	0.592	-0.257	-0.093	0.034	0.172	-0.003	0.000	-0.103
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Wall of South Tank	35007	OTHR	0.089	-0.330	-0.020	0.003	0.098	-0.003	-0.009	0.166
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	35010	OTHR	0.206	-0.585	-0.082	0.023	0.096	0.000	0.011	0.146
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	36507	OTHR	0.601	-0.274	-0.049	-0.020	-0.037	0.001	-0.003	-0.030
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	36510	OTHR	0.596	-0.359	-0.039	0.004	-0.023	-0.003	-0.001	-0.025
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	38507	OTHR	0.299	-0.125	0.001	-0.007	-0.018	0.001	0.000	0.045
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	38510	OTHR	0.315	-0.142	0.029	-0.001	-0.015	0.004	0.001	0.054
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	45001	OTHR	0.207	-0.384	0.045	0.003	0.053	-0.002	-0.007	0.123
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	46501	OTHR	0.563	-0.356	0.016	-0.003	-0.018	0.002	0.000	-0.029
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
	48501	OTHR	0.335	-0.155	-0.008	0.000	-0.013	-0.001	0.000	0.060
		TEMP	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000

Table 3G.4-13

Combined Forces and Moments: Selected Load Combination FWSC-4

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL 4.65	18	OTHR	-0.070	-0.002	-0.133	-0.644	0.104	0.085	-0.015	-0.052
		TEMP	9.411	0.129	2.687	-10.158	-1.106	-0.277	0.386	0.669
	227	OTHR	-0.079	0.250	0.002	-0.198	0.065	0.007	-0.275	-0.049
		TEMP	-5.312	14.956	-0.664	-5.567	-7.611	0.207	0.538	0.132
	237	OTHR	0.101	0.015	0.020	-0.082	0.230	-0.118	-0.370	0.212
		TEMP	3.664	6.600	3.294	-8.082	-4.523	-1.106	-0.777	-0.636
	16085	OTHR	0.108	0.274	0.021	-0.184	0.059	0.015	-0.089	-0.004
		TEMP	-6.707	-2.060	0.615	-2.051	0.067	-0.087	-0.393	0.020
Roof of FPE EL 8.25	51556	OTHR	-0.009	0.042	0.001	0.077	0.104	-0.006	0.007	0.014
		TEMP	0.133	0.266	-0.007	-0.374	-0.308	0.001	-0.007	0.008
	51558	OTHR	-0.015	-0.198	-0.005	-0.036	0.021	-0.014	0.069	-0.004
		TEMP	0.250	-0.598	-0.045	-0.254	-0.309	-0.010	-0.041	-0.003
	51576	OTHR	0.322	-0.030	0.040	-0.004	-0.080	-0.011	-0.005	0.097
		TEMP	1.135	0.178	0.122	-0.387	-0.388	-0.001	-0.003	0.033
	51578	OTHR	0.078	-0.098	0.072	-0.006	-0.022	-0.033	-0.004	0.026
		TEMP	0.277	-0.311	0.042	-0.331	-0.387	-0.024	-0.043	0.056
Roof of Tank	26007	OTHR	-0.216	-0.169	-0.010	0.009	0.009	0.000	-0.001	0.000
		TEMP	0.048	-0.065	-0.006	-0.510	-0.511	0.000	0.002	0.001
	26079	OTHR	0.087	-0.100	0.031	-0.001	-0.023	0.003	-0.003	0.026
		TEMP	0.580	0.123	0.052	-0.581	-0.699	0.015	-0.013	0.104
	26082	OTHR	-0.030	0.024	0.114	-0.014	-0.012	0.012	-0.019	0.017
		TEMP	0.447	0.158	0.094	-0.630	-0.628	0.055	-0.066	0.066
	26085	OTHR	-0.063	0.064	-0.112	-0.019	-0.008	-0.011	-0.023	-0.014
		TEMP	0.321	0.202	0.017	-0.642	-0.598	-0.045	-0.070	-0.044

Table 3G.4-13

Combined Forces and Moments: Selected Load Combination FWSC-4 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
South Wall of FPE	66004	OTHR	-0.059	-0.122	0.024	-0.012	-0.060	0.000	-0.002	0.015
		TEMP	3.883	-0.219	-0.181	-0.549	-0.956	0.005	-0.013	-0.253
	66006	OTHR	-0.047	0.201	0.209	-0.006	-0.067	-0.006	-0.021	-0.085
		TEMP	2.358	1.340	-0.534	-0.494	-0.920	-0.034	-0.270	-0.825
	66024	OTHR	-0.275	-0.125	0.010	-0.016	-0.094	0.004	0.001	0.014
		TEMP	-0.123	0.005	-0.059	-0.455	-0.363	0.002	0.016	-0.291
East Wall of FPE	67004	OTHR	0.208	-0.421	-0.067	-0.005	-0.045	0.001	-0.002	-0.081
		TEMP	4.095	-0.881	-0.348	0.498	0.568	-0.002	0.003	0.041
	67006	OTHR	0.338	0.039	-0.476	-0.010	-0.020	0.003	0.003	-0.040
		TEMP	4.348	0.675	-2.771	0.411	0.520	0.008	0.181	0.219
	67024	OTHR	0.443	-0.193	-0.069	0.026	0.129	-0.002	0.000	-0.077
		TEMP	2.168	-0.194	-0.332	0.485	0.451	0.001	-0.010	0.064
Wall of South Tank	35007	OTHR	0.068	-0.248	-0.016	0.002	0.073	-0.002	-0.006	0.125
		TEMP	3.439	-1.136	0.280	-1.423	-1.081	0.005	-0.037	-0.202
	35010	OTHR	0.156	-0.439	-0.063	0.017	0.071	0.000	0.008	0.109
		TEMP	3.175	0.166	-0.155	-1.616	-1.530	0.044	0.016	-0.429
	36507	OTHR	0.451	-0.206	-0.038	-0.015	-0.028	0.000	-0.003	-0.023
		TEMP	-0.376	-0.569	0.025	-1.473	-1.489	-0.006	-0.011	0.098
	36510	OTHR	0.447	-0.270	-0.030	0.003	-0.017	-0.003	-0.001	-0.019
		TEMP	-0.400	0.018	-0.394	-1.550	-1.484	-0.003	0.014	0.092
	38507	OTHR	0.225	-0.094	0.001	-0.005	-0.014	0.001	0.000	0.034
		TEMP	0.189	-0.104	0.003	-1.432	-1.001	0.005	0.001	-0.227
	38510	OTHR	0.237	-0.107	0.022	-0.001	-0.011	0.003	0.001	0.041
		TEMP	-0.075	0.009	-0.252	-1.448	-1.002	-0.027	-0.008	-0.268
	45001	OTHR	0.157	-0.287	0.034	0.002	0.039	-0.001	-0.005	0.091
		TEMP	4.420	1.038	-0.097	-1.505	-1.583	-0.010	0.032	-0.455
	46501	OTHR	0.422	-0.267	0.013	-0.002	-0.014	0.001	0.000	-0.021
		TEMP	-0.426	0.710	0.125	-1.559	-1.518	-0.006	-0.001	0.101
	48501	OTHR	0.252	-0.117	-0.006	0.000	-0.009	-0.001	0.000	0.045
		TEMP	-0.305	0.127	0.079	-1.460	-1.004	0.008	0.002	-0.305

Table 3G.4-14

Combined Forces and Moments: Selected Load Combination FWSC-6

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL 4.65	18	OTHR	-0.065	-0.009	-0.130	-0.524	0.117	0.063	-0.044	-0.064
		TEMP	7.239	0.100	2.067	-7.814	-0.851	-0.213	0.297	0.515
		EQEW	-0.881	-0.277	-0.491	-0.830	0.330	0.617	-0.283	-0.260
		EQNS	0.048	0.126	0.106	-1.330	-0.131	0.314	0.554	0.160
		EQZ	0.077	0.020	0.131	0.570	-0.144	-0.060	0.048	0.076
		EQT	0.590	0.006	-0.386	-0.051	-0.043	-0.014	0.028	0.030
	227	OTHR	-0.101	0.224	0.013	0.046	0.141	0.002	-0.340	-0.058
		TEMP	-4.086	11.505	-0.511	-4.282	-5.855	0.160	0.414	0.102
		EQEW	-0.015	-0.180	-1.012	0.022	0.275	1.357	-0.344	-0.278
		EQNS	0.535	0.093	-0.191	-4.338	-1.370	0.043	1.814	0.263
		EQZ	0.086	-0.192	-0.031	0.020	-0.172	0.012	0.373	0.062
		EQT	0.183	-0.070	-0.972	-0.060	0.037	0.228	0.019	-0.178
	237	OTHR	0.054	0.024	0.009	0.119	0.259	-0.124	-0.371	0.227
		TEMP	2.818	5.077	2.534	-6.217	-3.479	-0.850	-0.598	-0.489
		EQEW	0.128	0.734	-0.222	-0.943	-1.411	1.068	0.935	-0.864
		EQNS	0.830	-0.163	0.150	-3.860	-0.806	0.396	0.626	-0.692
		EQZ	-0.045	-0.003	0.044	-0.103	-0.288	0.097	0.402	-0.239
		EQT	-0.910	0.222	-0.397	0.200	-0.150	0.026	-0.077	-0.148
	16085	OTHR	0.133	0.236	0.023	-0.032	0.127	0.019	-0.059	-0.001
		TEMP	-5.159	-1.585	0.473	-1.578	0.051	-0.067	-0.302	0.016
		EQEW	-0.109	0.022	0.178	0.346	0.153	0.364	0.161	-0.095
		EQNS	-0.436	0.223	-0.071	-2.915	-1.171	-0.124	-0.704	-0.074
		EQZ	-0.027	-0.151	-0.025	-0.147	-0.196	-0.037	-0.019	-0.012
		EQT	0.049	0.043	-0.326	0.035	-0.010	-0.093	0.027	-0.207

OTHR: Loads other than thermal loads
TEMP: Thermal loads
EQEW: Horizontal seismic loads in the E-W direction
EQNS: Horizontal seismic loads in the N-S direction
EQZ: Vertical seismic loads
EQT: Torsional seismic loads

Table 3G.4-14

Combined Forces and Moments: Selected Load Combination FWSC-6 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Roof of FPE EL 8.25	51556	OTHR	-0.015	0.029	0.003	0.081	0.108	-0.006	0.008	0.015
		TEMP	0.103	0.204	-0.005	-0.288	-0.237	0.000	-0.006	0.006
		EQEW	-0.080	-0.027	0.078	0.008	0.006	0.006	0.001	-0.009
		EQNS	0.034	0.060	-0.084	-0.001	-0.003	-0.003	0.002	0.000
		EQZ	0.015	-0.035	-0.003	-0.080	-0.109	0.006	-0.008	-0.015
		EQT	0.001	0.000	-0.054	0.000	0.000	0.000	0.000	0.000
	51558	OTHR	-0.025	-0.221	-0.006	-0.040	0.021	-0.015	0.074	-0.004
		TEMP	0.192	-0.460	-0.035	-0.196	-0.238	-0.007	-0.032	-0.003
		EQEW	-0.024	0.067	0.272	-0.010	-0.003	0.012	0.010	0.008
		EQNS	0.048	0.595	-0.002	-0.020	-0.015	0.000	0.010	-0.002
		EQZ	0.022	0.251	0.009	0.037	-0.023	0.015	-0.072	0.004
		EQT	-0.001	0.005	-0.059	-0.001	0.000	-0.001	0.000	0.000
	51576	OTHR	0.304	-0.040	0.046	-0.004	-0.084	-0.012	-0.005	0.101
		TEMP	0.873	0.137	0.094	-0.298	-0.299	-0.001	-0.002	0.025
		EQEW	-0.736	0.018	-0.024	0.029	0.065	-0.002	0.001	-0.024
		EQNS	0.012	0.023	-0.367	0.000	0.004	-0.004	-0.002	-0.003
		EQZ	-0.342	0.039	-0.051	0.005	0.086	0.012	0.006	-0.102
		EQT	0.000	-0.001	-0.057	0.000	-0.001	-0.001	0.000	0.000
	51578	OTHR	0.071	-0.104	0.068	-0.008	-0.024	-0.034	-0.003	0.026
		TEMP	0.213	-0.240	0.032	-0.255	-0.298	-0.019	-0.033	0.043
		EQEW	-0.219	0.091	0.034	-0.012	0.021	-0.002	0.029	-0.026
		EQNS	-0.010	0.150	-0.101	-0.005	0.007	-0.003	0.006	-0.012
		EQZ	-0.083	0.115	-0.071	0.007	0.025	0.034	0.004	-0.028
		EQT	-0.009	0.017	-0.046	-0.001	-0.004	-0.001	-0.001	0.002
Roof of Tank	26007	OTHR	-0.218	-0.193	-0.006	0.010	0.010	0.000	0.000	0.000
		TEMP	0.037	-0.050	-0.005	-0.392	-0.393	0.000	0.001	0.001
		EQEW	0.004	-0.004	-0.031	0.000	0.001	0.001	0.000	0.003
		EQNS	0.065	-0.056	0.005	-0.002	-0.002	0.000	-0.003	0.000
		EQZ	0.324	0.290	0.009	-0.016	-0.016	0.000	0.001	0.000
		EQT	0.000	0.000	-0.001	0.000	0.000	0.000	0.000	0.000
	26079	OTHR	0.101	-0.114	0.027	-0.001	-0.025	0.003	-0.003	0.028
		TEMP	0.446	0.095	0.040	-0.447	-0.537	0.011	-0.010	0.080
		EQEW	-0.199	-0.062	-0.072	-0.003	-0.001	-0.002	0.003	-0.014
		EQNS	0.128	-0.083	-0.032	-0.005	-0.011	0.004	0.000	0.007
		EQZ	-0.168	0.167	-0.042	0.002	0.042	-0.005	0.005	-0.045
		EQT	0.000	-0.001	-0.002	0.000	0.000	0.000	0.000	0.000
	26082	OTHR	-0.021	0.012	0.121	-0.015	-0.013	0.013	-0.021	0.020
		TEMP	0.344	0.122	0.072	-0.485	-0.483	0.042	-0.051	0.050
		EQEW	-0.121	-0.072	-0.129	0.010	0.003	-0.006	0.011	-0.011
		EQNS	0.039	-0.242	-0.083	0.002	0.001	-0.003	0.011	-0.007
		EQZ	0.018	-0.024	-0.183	0.025	0.022	-0.021	0.034	-0.031
		EQT	-0.001	0.000	-0.002	0.000	0.000	0.000	0.000	0.000
	26085	OTHR	-0.062	0.060	-0.113	-0.020	-0.008	-0.012	-0.025	-0.015
		TEMP	0.247	0.155	0.013	-0.494	-0.460	-0.034	-0.054	-0.034
		EQEW	0.107	-0.063	-0.082	-0.004	0.000	-0.001	-0.002	-0.004
		EQNS	-0.030	-0.272	0.156	0.011	0.004	0.006	0.020	0.011
		EQZ	0.083	-0.095	0.168	0.033	0.014	0.019	0.040	0.024
		EQT	0.002	-0.001	-0.001	0.000	0.000	0.000	0.000	0.000

Table 3G.4-14

Combined Forces and Moments: Selected Load Combination FWSC-6 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
South Wall of FPE	66004	OTHR	-0.075	-0.106	0.032	-0.010	-0.052	0.000	-0.002	0.017
		TEMP	2.987	-0.168	-0.139	-0.422	-0.736	0.004	-0.010	-0.195
		EQEW	0.052	-0.109	0.039	0.004	0.022	-0.006	-0.003	0.016
		EQNS	0.294	-0.362	-0.148	-0.001	-0.006	0.000	0.008	0.015
		EQZ	0.100	0.092	-0.040	0.012	0.061	0.000	0.002	-0.011
		EQT	0.007	-0.008	0.147	0.001	0.002	0.001	-0.002	0.001
	66006	OTHR	-0.064	0.166	0.228	-0.005	-0.059	-0.005	-0.019	-0.072
		TEMP	1.814	1.030	-0.411	-0.380	-0.708	-0.026	-0.208	-0.635
		EQEW	0.312	-0.232	-0.516	0.024	0.075	-0.002	0.004	0.104
		EQNS	0.230	0.179	-0.488	-0.009	-0.055	-0.011	-0.005	-0.107
		EQZ	0.084	-0.177	-0.270	0.006	0.065	0.006	0.021	0.082
		EQT	-0.012	-0.084	0.091	0.005	0.008	0.001	-0.001	0.015
	66024	OTHR	-0.303	-0.127	0.017	-0.017	-0.098	0.004	0.001	0.022
		TEMP	-0.095	0.004	-0.045	-0.350	-0.279	0.001	0.012	-0.224
		EQEW	0.118	-0.012	-0.168	-0.003	-0.011	0.002	0.004	0.016
		EQNS	0.768	-0.081	-0.094	-0.011	-0.027	-0.003	-0.001	0.008
		EQZ	0.347	0.124	-0.022	0.017	0.096	-0.005	-0.001	-0.017
		EQT	0.006	0.000	0.128	0.000	0.000	0.002	0.001	0.001
East Wall of FPE	67004	OTHR	0.193	-0.406	-0.087	-0.005	-0.046	0.001	-0.001	-0.079
		TEMP	3.150	-0.678	-0.268	0.383	0.437	-0.002	0.002	0.032
		EQEW	-0.252	0.387	0.142	0.030	0.155	-0.001	0.004	0.094
		EQNS	0.066	-0.107	0.573	0.002	0.009	-0.003	-0.001	0.005
		EQZ	-0.215	0.433	0.097	0.005	0.050	-0.001	0.002	0.082
		EQT	-0.024	0.005	-0.036	-0.001	-0.002	-0.001	0.002	-0.001
	67006	OTHR	0.283	0.020	-0.441	-0.010	-0.022	0.003	0.002	-0.041
		TEMP	3.345	0.519	-2.131	0.316	0.400	0.006	0.139	0.169
		EQEW	-0.308	0.093	0.729	0.007	0.082	0.000	0.034	0.100
		EQNS	0.530	0.034	0.023	0.004	0.036	-0.003	0.010	0.059
		EQZ	-0.312	-0.013	0.490	0.011	0.026	-0.003	-0.002	0.047
		EQT	-0.105	-0.080	0.015	-0.004	-0.009	-0.001	0.003	-0.011
	67024	OTHR	0.418	-0.195	-0.079	0.026	0.133	-0.003	0.000	-0.083
		TEMP	1.668	-0.149	-0.255	0.373	0.347	0.001	-0.008	0.049
		EQEW	-0.911	0.130	0.099	-0.010	-0.041	-0.005	-0.004	0.091
		EQNS	0.039	-0.028	0.454	-0.001	-0.003	0.001	0.002	0.007
		EQZ	-0.470	0.201	0.086	-0.027	-0.135	0.003	0.000	0.086
		EQT	-0.007	0.002	-0.001	0.000	0.001	-0.002	-0.002	-0.001

Table 3G.4-14

Combined Forces and Moments: Selected Load Combination FWSC-6 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Wall of South Tank	35007	OTHR	0.038	-0.227	0.033	0.003	0.073	-0.001	-0.006	0.120
		TEMP	2.645	-0.874	0.216	-1.095	-0.832	0.004	-0.028	-0.155
		EQEW	0.817	1.381	-0.020	-0.003	-0.285	0.019	0.020	-0.327
		EQNS	0.452	-0.361	-1.065	-0.011	-0.133	-0.015	0.007	-0.138
		EQZ	0.241	0.351	-0.038	0.001	-0.050	0.002	0.007	-0.052
		EQT	-0.191	-0.008	0.558	0.004	0.013	-0.006	0.001	0.026
	35010	OTHR	0.078	-0.462	0.004	0.020	0.094	0.000	0.007	0.125
		TEMP	2.442	0.128	-0.119	-1.243	-1.177	0.034	0.012	-0.330
		EQEW	0.346	2.051	0.981	-0.105	-0.324	0.017	-0.024	-0.239
		EQNS	1.140	1.472	-0.998	-0.085	-0.519	0.020	0.007	-0.453
		EQZ	0.188	0.601	-0.008	-0.016	-0.069	0.000	-0.007	-0.055
		EQT	-0.136	0.024	0.583	0.001	0.009	-0.011	0.007	0.020
	36507	OTHR	0.406	-0.209	0.006	-0.013	-0.025	0.001	-0.001	-0.023
		TEMP	-0.289	-0.438	0.019	-1.133	-1.146	-0.004	-0.008	0.076
		EQEW	-0.778	0.652	-0.004	0.071	0.088	-0.004	0.013	0.032
		EQNS	-0.090	-0.310	-1.088	0.029	0.049	-0.009	-0.017	0.013
		EQZ	0.035	0.333	-0.006	0.011	0.010	-0.001	0.002	0.011
		EQT	0.011	-0.004	0.265	0.000	-0.005	-0.004	-0.001	-0.003
	36510	OTHR	0.429	-0.279	0.017	0.002	-0.021	-0.001	0.000	-0.020
		TEMP	-0.308	0.014	-0.303	-1.193	-1.142	-0.003	0.011	0.071
		EQEW	-0.584	0.910	0.885	-0.049	0.021	0.006	0.015	0.006
		EQNS	-0.582	0.624	-0.944	0.027	0.088	-0.015	0.010	0.034
		EQZ	0.011	0.409	-0.017	-0.005	0.005	0.001	0.000	0.008
		EQT	0.005	0.008	0.264	-0.002	-0.004	-0.005	-0.001	-0.003
	38507	OTHR	0.235	-0.104	0.001	-0.004	-0.014	0.000	0.000	0.039
		TEMP	0.145	-0.080	0.002	-1.102	-0.770	0.003	0.001	-0.174
		EQEW	-0.577	0.159	-0.067	0.023	0.038	-0.014	-0.004	0.033
		EQNS	0.111	-0.063	-0.233	0.009	0.005	0.007	0.001	0.031
		EQZ	-0.324	0.160	-0.001	0.007	0.032	0.000	0.000	-0.054
		EQT	0.000	0.000	0.040	0.000	0.000	-0.001	-0.001	0.000
	38510	OTHR	0.254	-0.113	0.015	-0.002	-0.015	0.001	0.001	0.043
		TEMP	-0.057	0.007	-0.194	-1.114	-0.771	-0.020	-0.006	-0.206
		EQEW	-0.485	0.175	0.177	-0.007	0.025	-0.010	-0.002	-0.010
		EQNS	-0.483	0.136	-0.305	0.010	0.028	-0.017	-0.006	0.013
		EQZ	-0.344	0.170	-0.016	0.005	0.033	-0.001	-0.001	-0.058
		EQT	-0.003	0.002	0.043	0.000	0.000	-0.001	0.000	0.000
Wall of South Tank	45001	OTHR	0.062	-0.373	0.014	0.009	0.077	-0.001	-0.005	0.119
		TEMP	3.400	0.799	-0.075	-1.157	-1.218	-0.008	0.025	-0.350
		EQEW	-0.102	-0.562	1.622	0.031	0.080	-0.016	-0.029	0.051
		EQNS	1.299	2.708	0.257	-0.156	-0.709	-0.007	0.016	-0.566
		EQZ	0.198	0.506	-0.013	-0.004	-0.049	0.001	0.006	-0.047
		EQT	0.031	-0.012	0.619	0.001	-0.002	-0.012	0.004	-0.005
	46501	OTHR	0.414	-0.285	0.000	-0.006	-0.021	0.001	-0.001	-0.022
		TEMP	-0.328	0.546	0.096	-1.199	-1.168	-0.005	-0.001	0.078
		EQEW	0.137	-0.251	1.387	0.020	0.000	0.021	-0.016	0.000
		EQNS	-0.786	1.186	0.230	-0.019	0.083	0.004	-0.005	0.033
		EQZ	0.027	0.413	0.000	0.004	0.005	-0.001	0.001	0.010
		EQT	-0.001	-0.002	0.269	0.001	0.001	-0.004	-0.003	0.001
	48501	OTHR	0.265	-0.118	-0.004	-0.002	-0.014	0.000	0.000	0.044
		TEMP	-0.235	0.098	0.060	-1.123	-0.772	0.006	0.002	-0.235
		EQEW	0.117	-0.046	0.345	0.004	-0.006	0.015	0.004	0.005
		EQNS	-0.742	0.238	0.078	0.000	0.035	0.006	0.002	-0.009
		EQZ	-0.356	0.175	0.005	0.006	0.032	0.000	0.000	-0.059
		EQT	0.001	0.000	0.045	0.000	0.000	0.000	0.000	0.000

Table 3G.4-15

Combined Forces and Moments: Selected Load Combination FWSC -7

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
Basemat EL 4.65	18	OTHR	-0.072	0.006	-0.125	-0.724	0.075	0.104	0.020	-0.030
		TEMP	7.239	0.100	2.067	-7.814	-0.851	-0.213	0.297	0.515
	227	OTHR	-0.042	0.252	-0.013	-0.516	-0.035	0.011	-0.170	-0.031
		TEMP	-4.086	11.505	-0.511	-4.282	-5.855	0.160	0.414	0.102
	237	OTHR	0.143	0.001	0.032	-0.332	0.166	-0.087	-0.326	0.165
		TEMP	2.818	5.077	2.534	-6.217	-3.479	-0.850	-0.598	-0.489
	16085	OTHR	0.068	0.289	0.016	-0.379	-0.021	0.005	-0.140	-0.009
		TEMP	-5.159	-1.585	0.473	-1.578	0.051	-0.067	-0.302	0.016
Roof of FPE EL 8.25	51556	OTHR	0.004	0.061	-0.002	0.048	0.070	-0.004	0.004	0.010
		TEMP	0.103	0.204	-0.005	-0.288	-0.237	0.000	-0.006	0.006
	51558	OTHR	0.010	-0.144	-0.005	-0.015	0.016	-0.010	0.042	-0.003
		TEMP	0.192	-0.460	-0.035	-0.196	-0.238	-0.007	-0.032	-0.003
	51576	OTHR	0.316	-0.004	0.026	-0.006	-0.055	-0.007	-0.004	0.065
		TEMP	0.873	0.137	0.094	-0.298	-0.299	-0.001	-0.002	0.025
	51578	OTHR	0.082	-0.076	0.066	0.001	-0.014	-0.023	-0.008	0.019
		TEMP	0.213	-0.240	0.032	-0.255	-0.298	-0.019	-0.033	0.043
Roof of Tank	26007	OTHR	-0.124	-0.050	-0.015	0.003	0.004	0.000	-0.004	0.000
		TEMP	0.037	-0.050	-0.005	-0.392	-0.393	0.000	0.001	0.001
	26079	OTHR	0.022	-0.033	0.029	0.000	-0.008	0.003	-0.001	0.010
		TEMP	0.446	0.095	0.040	-0.447	-0.537	0.011	-0.010	0.080
	26082	OTHR	-0.035	0.038	0.052	-0.006	-0.003	0.004	-0.005	0.005
		TEMP	0.344	0.122	0.072	-0.485	-0.483	0.042	-0.051	0.050
	26085	OTHR	-0.038	0.046	-0.061	-0.008	-0.003	-0.004	-0.007	-0.004
		TEMP	0.247	0.155	0.013	-0.494	-0.460	-0.034	-0.054	-0.034

OTHR: Loads other than thermal loads
TEMP: Thermal loads

Table 3G.4-15

Combined Forces and Moments: Selected Load Combination FWSC -7 (Continued)

Location	Element ID		Nx (MN/m)	Ny (MN/m)	Nxy (MN/m)	Mx (MNm/m)	My (MNm/m)	Mxy (MNm/m)	Qx (MN/m)	Qy (MN/m)
South Wall of FPE	66004	OTHR	-0.034	-0.103	0.012	-0.012	-0.067	0.000	-0.001	-0.001
		TEMP	2.987	-0.168	-0.139	-0.422	-0.736	0.004	-0.010	-0.195
	66006	OTHR	-0.024	0.225	0.164	-0.008	-0.072	-0.006	-0.020	-0.094
		TEMP	1.814	1.030	-0.411	-0.380	-0.708	-0.026	-0.208	-0.635
	66024	OTHR	-0.207	-0.084	0.002	-0.010	-0.059	0.003	0.001	-0.009
		TEMP	-0.095	0.004	-0.045	-0.350	-0.279	0.001	0.012	-0.224
East Wall of FPE	67004	OTHR	0.205	-0.370	-0.035	-0.004	-0.036	0.001	-0.001	-0.064
		TEMP	3.150	-0.678	-0.268	0.383	0.437	-0.002	0.002	0.032
	67006	OTHR	0.369	0.059	-0.472	-0.008	-0.015	0.002	0.004	-0.031
		TEMP	3.345	0.519	-2.131	0.316	0.400	0.006	0.139	0.169
	67024	OTHR	0.434	-0.146	-0.050	0.018	0.089	-0.001	0.000	-0.050
		TEMP	1.668	-0.149	-0.255	0.373	0.347	0.001	-0.008	0.049
Wall of South Tank	35007	OTHR	0.086	-0.220	-0.070	0.002	0.070	-0.004	-0.006	0.120
		TEMP	2.645	-0.874	0.216	-1.095	-0.832	0.004	-0.028	-0.155
	35010	OTHR	0.225	-0.333	-0.135	0.012	0.040	0.000	0.009	0.080
		TEMP	2.442	0.128	-0.119	-1.243	-1.177	0.034	0.012	-0.330
	36507	OTHR	0.456	-0.150	-0.082	-0.016	-0.030	0.000	-0.004	-0.019
		TEMP	-0.289	-0.438	0.019	-1.133	-1.146	-0.004	-0.008	0.076
	36510	OTHR	0.421	-0.198	-0.081	0.004	-0.012	-0.004	-0.002	-0.015
		TEMP	-0.308	0.014	-0.303	-1.193	-1.142	-0.003	0.011	0.071
	38507	OTHR	0.114	-0.041	0.005	-0.004	-0.004	0.002	0.000	0.012
		TEMP	0.145	-0.080	0.002	-1.102	-0.770	0.003	0.001	-0.174
	38510	OTHR	0.112	-0.054	0.029	0.002	0.003	0.005	0.002	0.020
		TEMP	-0.057	0.007	-0.194	-1.114	-0.771	-0.020	-0.006	-0.206
	45001	OTHR	0.247	-0.123	0.054	-0.007	-0.008	-0.001	-0.004	0.048
		TEMP	3.400	0.799	-0.075	-1.157	-1.218	-0.008	0.025	-0.350
	46501	OTHR	0.386	-0.185	0.025	0.002	-0.005	0.002	0.001	-0.018
		TEMP	-0.328	0.546	0.096	-1.199	-1.168	-0.005	-0.001	0.078
	48501	OTHR	0.129	-0.069	-0.008	0.005	0.006	-0.001	0.000	0.027
		TEMP	-0.235	0.098	0.060	-1.123	-0.772	0.006	0.002	-0.235

Table 3G.4-16

Sectional Thicknesses and Rebar Ratios Used in the Evaluation

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Directtion 1*1		Directtion 2*1			
				Arrangement	Ratio (%)	Arrangement	Ratio (%)	Arrangement	Ratio (%)
Basemat EL 4.65	18 16085	2.50	Top	3-#11@200	0.604	3-#11@200	0.604	#7@400x400	0.242
			Bottom	3-#11@200	0.604	3-#11@200	0.604		
	227 237	2.50	Top	3-#11@200 + 1-#11@400	0.705	3-#11@200 + 1-#11@400	0.705	#7@400x200	0.484
			Bottom	3-#11@200	0.604	3-#11@200	0.604		
Roof of FPE EL 8.25	51556 51558 51576 51578	0.60	Top	1-#11@200	0.839	1-#11@200	0.839	-	-
			Bottom	1-#11@200	0.839	1-#11@200	0.839		
Roof of Tank	26007 26079 26082 26085	0.60	Top	1-#9@200	0.538	1-#9@200	0.538	-	-
			Bottom	1-#9@200	0.538	1-#9@200	0.538		

Note *1: Wall Direction 1:Horizontal, Direction 2:Vertical
Basemat, Slab ,Roof Direction 1:N-S, Direction 2:E-W

Table 3G.4-16

Sectional Thicknesses and Rebar Ratios Used in the Evaluation (Continued)

Location	Element ID	Thickness (m)	Primary Reinforcement					Shear Tie	
			Position	Directtion 1*1		Directtion 2*1			
				Arrangement	Ratio (%)	Arrangement	Ratio (%)	Arrangement	Ratio (%)
South Wall of FPE	66004	0.65	Inside	1-#11@200	0.774	1-#11@200	0.774	-	-
			Outside	2-#11@200	1.548	2-#11@200	1.548		
	66006	0.65	Inside	1-#11@200	0.774	1-#11@200	0.774	#6@200x200	0.710
			Outside	2-#11@200	1.548	1-#11@133 + 1-#11@200	1.938		
	66024	0.65	Inside	1-#11@200	0.774	1-#11@200	0.774	-	-
			Outside	1-#11@200 + 1-#11@400	1.161	1-#11@200 + 1-#11@400	1.161		
East Wall of FPE	67004	0.65	Inside	1-#11@200	0.774	1-#11@200	0.774	-	-
			Outside	2-#11@200	1.548	2-#11@200	1.548		
	67006	0.65	Inside	1-#11@200	0.774	1-#11@200	0.774	#6@200x200	0.710
			Outside	2-#11@200	1.548	1-#11@133 + 1-#11@200	1.938		
	67024	0.65	Inside	1-#11@200	0.774	1-#11@200	0.774	-	-
			Outside	1-#11@200 + 1-#11@400	1.161	1-#11@200 + 1-#11@400	1.161		
Wall of South Tank	35007 35010 45001	1.00	Inside	1-#11@150 + 1-#11@300	1.006	1-#11@1° + 1-#11@2°	1.006	#6@1°x300	0.710
			Outside	2-#11@150 + 1-#11@300	1.677	2-#11@1° + 1-#11@2°	1.677		
	36507 36510 46501	1.00	Inside	1-#11@150	0.671	1-#11@1°	0.671	-	-
			Outside	2-#11@150	1.342	2-#11@1°	1.677		
	38507 38510 48501	1.00	Inside	1-#11@150	0.671	1-#11@1°	0.671	-	-
			Outside	1-#11@150	0.671	1-#11@1°	0.671		

Note *1: Wall Direction 1:Horizontal, Direction 2:Vertical
Basemat, Slab ,Roof Direction 1:N-S, Direction 2:E-W

Table 3G.4-17

Rebar and Concrete Stresses: Selected Load Combination FWSC-3

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				X-direction		Y-direction		
				Top	Bottom	Top	Bottom	
Basemat EL 4.65	18	-1.5	-20.7	31.1	-4.4	9.5	3.0	372.2
	227	-0.4		4.8	-1.7	6.6	14.3	
	237	-1.2		7.2	12.9	10.4	11.5	
	16085	-0.1		12.4	-2.3	8.8	15.2	
Roof of FPE EL 8.25	51556	-4.8	-25.9	2.5	49.0	-4.5	67.3	372.2
	51558	-1.8		22.8	-0.8	-3.6	-0.3	
	51576	-4.1		59.5	27.2	59.2	-11.0	
	51578	-2.5		37.9	19.0	31.8	-12.5	
Roof of Tank	26007	-0.7	-25.9	-3.4	-2.2	-2.8	-1.2	372.2
	26079	-0.8		20.1	18.9	5.1	-3.1	
	26082	-1.0		20.3	18.8	27.9	24.0	
	26085	-1.0		23.1	8.7	31.3	31.0	
South Wall of FPE	66004	-2.3	-25.9	1.7	-0.4	12.6	-4.4	372.2
	66006	-2.7		22.3	7.1	46.6	5.9	
	66024	-3.6		-2.7	-3.3	29.9	-4.3	
East Wall of FPE	67004	-1.5	-25.9	28.1	14.9	-0.3	-6.7	372.2
	67006	-2.1		94.2	56.6	79.3	25.4	
	67024	-6.2		26.4	64.3	-9.2	45.8	
Wall of South Tank	35007	-0.9	-25.9	2.2	5.3	-3.8	1.5	372.2
	35010	-1.0		4.3	15.3	-4.9	-1.0	
	36507	-0.4		24.8	41.2	2.9	-4.2	
	36510	-0.5		21.4	46.5	-1.5	-1.8	
	38507	-0.2		21.2	23.3	-0.4	-1.2	
	38510	-0.3		21.2	26.5	-0.7	-0.1	
	45001	-0.6		5.8	11.4	-3.0	-1.1	
	46501	-0.4		21.0	41.9	-1.8	-2.4	
	48501	-0.2		22.2	27.8	-0.7	-1.1	

Note: Negative value means compression.

Table 3G.4-18

Rebar and Concrete Stresses: Selected Load Combination FWSC-4

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				X-direction		Y-direction		
				Top	Bottom	Top	Bottom	
Basemat EL 4.65	18	-4.3	-23.5	164.5	-0.2	52.6	4.3	372.2
	227	-6.3		18.1	-39.7	91.9	19.6	
	237	-5.7		140.8	-10.4	91.9	14.4	
	16085	-4.3		-9.0	-29.2	-4.2	0.1	
Roof of FPE EL 8.25	51556	-2.6	-29.3	40.2	1.7	31.1	5.5	372.2
	51558	-4.5		46.9	4.3	11.4	-17.9	
	51576	-7.8		121.7	32.1	125.9	-14.4	
	51578	-8.6		93.7	14.5	88.8	-19.7	
Roof of Tank	26007	-3.1	-29.3	20.5	-4.0	33.5	-9.2	372.2
	26079	-5.3		85.7	17.2	90.5	-11.7	
	26082	-6.1		125.1	16.0	142.8	-2.3	
	26085	-5.3		99.5	8.9	113.4	3.1	
South Wall of FPE	66004	-10.5	-29.3	66.2	25.1	72.3	-15.3	372.2
	66006	-10.6		90.8	27.4	130.9	4.8	
	66024	-5.4		21.8	-9.7	48.6	-2.3	
East Wall of FPE	67004	-6.1	-29.3	38.4	72.6	-26.9	9.7	372.2
	67006	-9.1		53.3	151.7	13.8	143.2	
	67024	-9.8		37.5	118.2	-11.1	77.7	
Wall of South Tank	35007	-5.0	-29.3	73.4	15.3	8.8	-16.7	372.2
	35010	-5.0		78.9	15.1	29.8	-6.7	
	36507	-6.1		73.0	-4.2	44.2	-11.2	
	36510	-6.9		77.7	-5.3	54.6	-6.1	
	38507	-3.6		88.7	3.0	35.5	-1.6	
	38510	-4.0		87.7	1.1	35.0	-0.7	
	45001	-4.4		79.1	20.2	37.5	-3.0	
	46501	-5.8		72.8	-6.0	51.3	-3.1	
	48501	-4.2		87.3	-0.5	35.1	0.1	

Note: Negative value means compression.

Table 3G.4-19

Rebar and Concrete Stresses: Selected Load Combination FWSC-6

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				X-direction		Y-direction		
				Top	Bottom	Top	Bottom	
Basemat EL 4.65	18	-6.1	-23.5	204.1	118.0	107.4	69.6	372.2
	227	-13.8		294.8	-46.1	235.9	79.5	
	237	-10.2		258.9	152.5	174.0	114.7	
	16085	-8.0		78.8	-36.3	37.9	42.4	
Roof of FPE EL 8.25	51556	-4.6	-29.3	80.7	41.8	69.8	77.5	372.2
	51558	-7.6		118.8	11.1	113.4	-26.8	
	51576	-12.9		253.4	86.3	234.0	-40.4	
	51578	-10.3		123.0	25.2	112.4	-26.8	
Roof of Tank	26007	-4.1	-29.3	79.7	12.5	78.0	-13.9	372.2
	26079	-6.1		136.7	39.7	121.1	-19.2	
	26082	-5.5		152.9	25.8	172.1	23.3	
	26085	-7.6		152.9	21.2	177.4	40.2	
South Wall of FPE	66004	-13.5	-29.3	115.3	42.2	118.5	-23.3	372.2
	66006	-14.8		160.6	39.7	201.5	24.4	
	66024	-10.9		129.8	-23.8	108.9	7.5	
East Wall of FPE	67004	-11.6	-29.3	84.0	119.0	-26.1	119.9	372.2
	67006	-9.7		135.8	219.9	111.4	148.8	
	67024	-17.5		104.1	220.3	-30.6	183.9	
Wall of South Tank	35007	-10.1	-29.3	149.5	51.9	154.6	35.3	372.2
	35010	-14.4		196.3	65.1	245.3	43.0	
	36507	-11.0		154.8	18.8	145.2	-20.7	
	36510	-11.0		165.9	25.8	157.7	30.2	
	38507	-7.2		154.8	27.7	107.1	12.1	
	38510	-7.3		149.9	59.1	128.5	17.3	
	45001	-13.3		230.7	73.5	285.5	56.3	
	46501	-10.5		164.8	25.8	159.6	80.3	
	48501	-7.4		156.6	67.4	123.2	-30.5	

Note: Negative value means compression.

Table 3G.4-20

Rebar and Concrete Stresses: Selected Load Combination FWSC-7

Location	Element ID	Concrete Stress (MPa)		Primary Reinforcement Stress (MPa)				
		Calculated	Allowable	Calculated				Allowable
				X-direction		Y-direction		
				Top	Bottom	Top	Bottom	
Basemat EL 4.65	18	-3.5	-23.5	131.0	-0.9	40.0	3.9	372.2
	227	-5.5		19.8	-32.4	75.5	15.3	
	237	-4.7		116.8	-8.6	71.7	11.6	
	16085	-3.5		-6.1	-23.6	-2.9	0.1	
Roof of FPE EL 8.25	51556	-0.5	-29.3	3.7	7.4	1.0	22.5	372.2
	51558	-3.2		32.0	4.0	8.4	-13.5	
	51576	-5.5		97.7	27.2	90.2	-9.8	
	51578	-6.1		67.6	11.9	63.8	-14.9	
Roof of Tank	26007	-2.7	-29.3	22.5	-1.6	39.8	-5.3	372.2
	26079	-3.7		59.0	11.0	71.1	-6.1	
	26082	-4.3		79.3	9.7	95.2	-1.8	
	26085	-3.4		63.0	5.9	73.6	1.7	
South Wall of FPE	66004	-8.5	-29.3	50.4	17.5	62.8	-11.8	372.2
	66006	-8.8		78.9	23.1	109.5	3.8	
	66024	-3.9		16.6	-7.4	33.9	-1.4	
East Wall of FPE	67004	-4.8	-29.3	33.6	57.9	-20.8	4.6	372.2
	67006	-7.2		46.2	128.1	12.5	118.0	
	67024	-7.3		31.6	94.9	-8.1	57.3	
Wall of South Tank	35007	-3.7	-29.3	57.5	12.3	5.3	-12.9	372.2
	35010	-5.0		70.4	14.8	37.7	-3.5	
	36507	-5.0		61.5	-1.4	35.7	-8.3	
	36510	-6.6		76.0	-2.2	63.3	-3.5	
	38507	-2.9		63.9	0.9	28.2	-0.5	
	38510	-3.2		62.2	-0.6	26.6	0.3	
	45001	-4.0		64.4	20.0	36.7	-2.4	
	46501	-4.5		58.7	-3.3	40.2	-1.8	
	48501	-3.2		61.6	-1.8	25.8	0.6	

Note: Negative value means compression.

Table 3G.4-21

Calculation Results for Transverse Shear

Location	Element ID	Load ID	d (m)	ρ_w (%)	ρ_v (%)	Shear Forces (MN/m)				Vu/ϕVn
						Vu	Vc	Vs	ϕVn	
Basemat EL 4.65	18	FWSC-7	2.144	0.704	0.000	0.219	3.894	0.000	3.309	0.066
	227	FWSC-6	2.141	0.705	0.484	2.492	2.055	4.290	5.394	0.462
	237	FWSC-6	2.156	0.700	0.484	2.361	1.798	4.320	5.200	0.454
	16085	FWSC-7	2.017	0.874	0.000	0.460	3.885	0.000	3.302	0.139
Roof of FPE EL 8.25	51556	FWSC-3	0.500	1.008	0.000	0.022	0.479	0.000	0.407	0.053
	51558	FWSC-3	0.450	1.118	0.000	0.093	0.507	0.000	0.431	0.215
	51576	FWSC-4	0.500	1.007	0.000	0.117	0.470	0.000	0.399	0.293
	51578	FWSC-4	0.498	1.011	0.000	0.069	0.482	0.000	0.410	0.169
Roof of Tank	26007	FWSC-7	0.499	0.646	0.000	0.003	0.465	0.000	0.395	0.009
	26079	FWSC-4	0.499	0.646	0.000	0.052	0.474	0.000	0.403	0.129
	26082	FWSC-4	0.479	0.674	0.000	0.065	0.454	0.000	0.386	0.169
	26085	FWSC-4	0.464	0.696	0.000	0.060	0.441	0.000	0.375	0.161
South Wall of FPE	66004	FWSC-4	0.422	2.387	0.000	0.244	0.468	0.000	0.398	0.614
	66006	FWSC-6	0.436	2.866	0.710	0.838	0.136	1.282	1.205	0.695
	66024	FWSC-4	0.443	1.702	0.000	0.264	0.520	0.000	0.442	0.597
East Wall of FPE	67004	FWSC-4	0.485	1.037	0.000	0.070	0.568	0.000	0.483	0.146
	67006	FWSC-4	0.438	2.754	0.000	0.045	0.181	0.000	0.154	0.291
	67024	FWSC-3	0.443	1.702	0.000	0.109	0.471	0.000	0.400	0.271
Wall of South Tank	35007	FWSC-7	0.718	1.407	0.000	0.120	0.685	0.000	0.582	0.206
	35010	FWSC-6	0.735	2.286	0.631	0.796	0.265	1.920	1.858	0.429
	36507	FWSC-4	0.760	0.883	0.000	0.052	0.736	0.000	0.625	0.083
	36510	FWSC-7	0.773	1.734	0.000	0.053	0.744	0.000	0.632	0.084
	38507	FWSC-7	0.835	0.804	0.000	0.069	0.816	0.000	0.693	0.100
	38510	FWSC-4	0.835	0.804	0.000	0.216	0.892	0.000	0.758	0.285
	45001	FWSC-6	0.735	2.285	0.631	0.840	0.000	1.920	1.632	0.515
	46501	FWSC-4	0.760	0.883	0.000	0.066	1.436	0.000	1.220	0.054
	48501	FWSC-7	0.835	0.804	0.000	0.089	0.808	0.000	0.687	0.130

Table 3G.4-22

Factors of Safety for Foundation Stability

Load Combination	Overturning		Sliding		Floatation	
	Required	Actual	Required	Actual	Required	Actual
D + H + E'	1.1	129.1	1.1	1.13	--	--
D + F'	--	--	--	--	1.1	7.4

Where,

D = Dead Load

H = Lateral soil pressure

E' = Safe Shutdown Earthquake

F' = Buoyant forces of design basis flood

Table 3G.4-23

Maximum Soil Bearing Stress Involving SSE

	Site Condition*		
	Soft	Medium	Hard
Bearing Stress (MPa)	0.44	0.54	0.67

*: See Table 3A.3-1 for site properties. For site specific application, use the larger value or a linearly interpolated value of the applicable range of shear wave velocities at the foundation level.

Figure 3G.4-1. FWSC Concrete Outline and Typical Rebar Arrangement

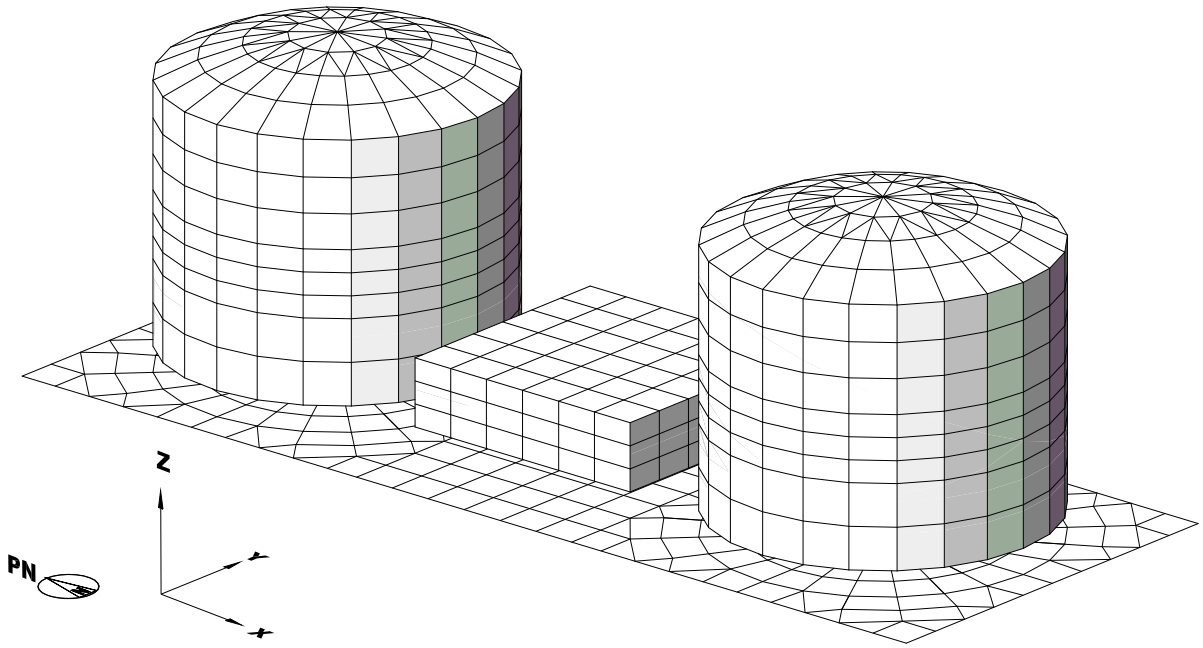

Whole View

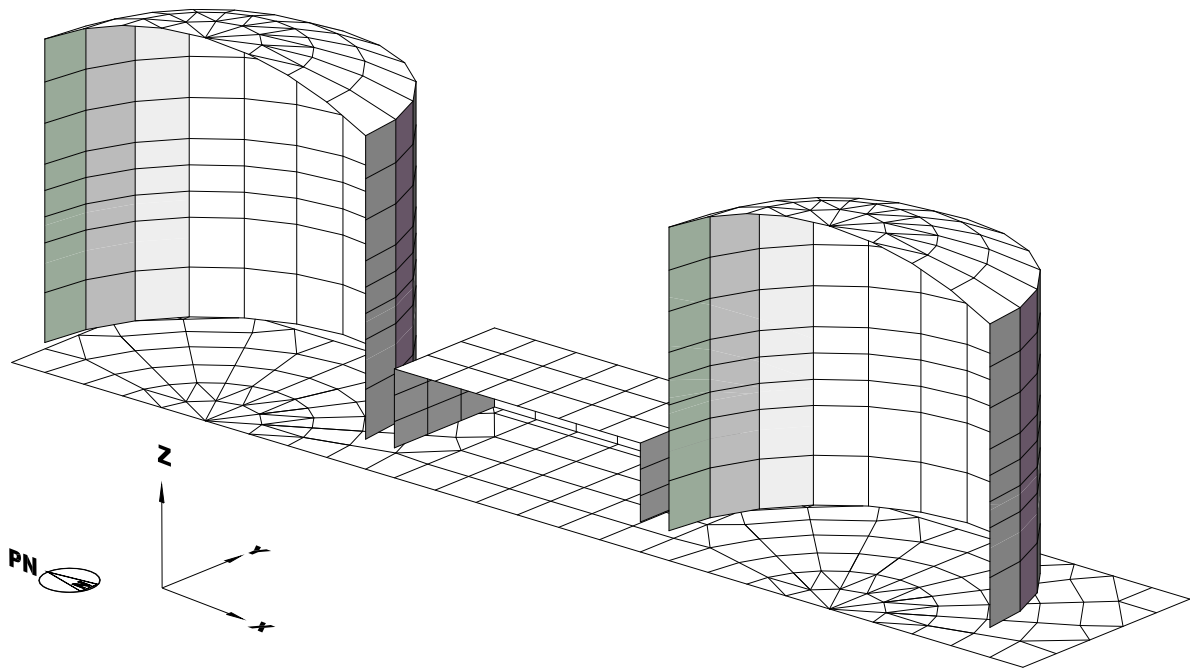

Cut View

Figure 3G.4-2. FE Model of FWSC (Isometric View)

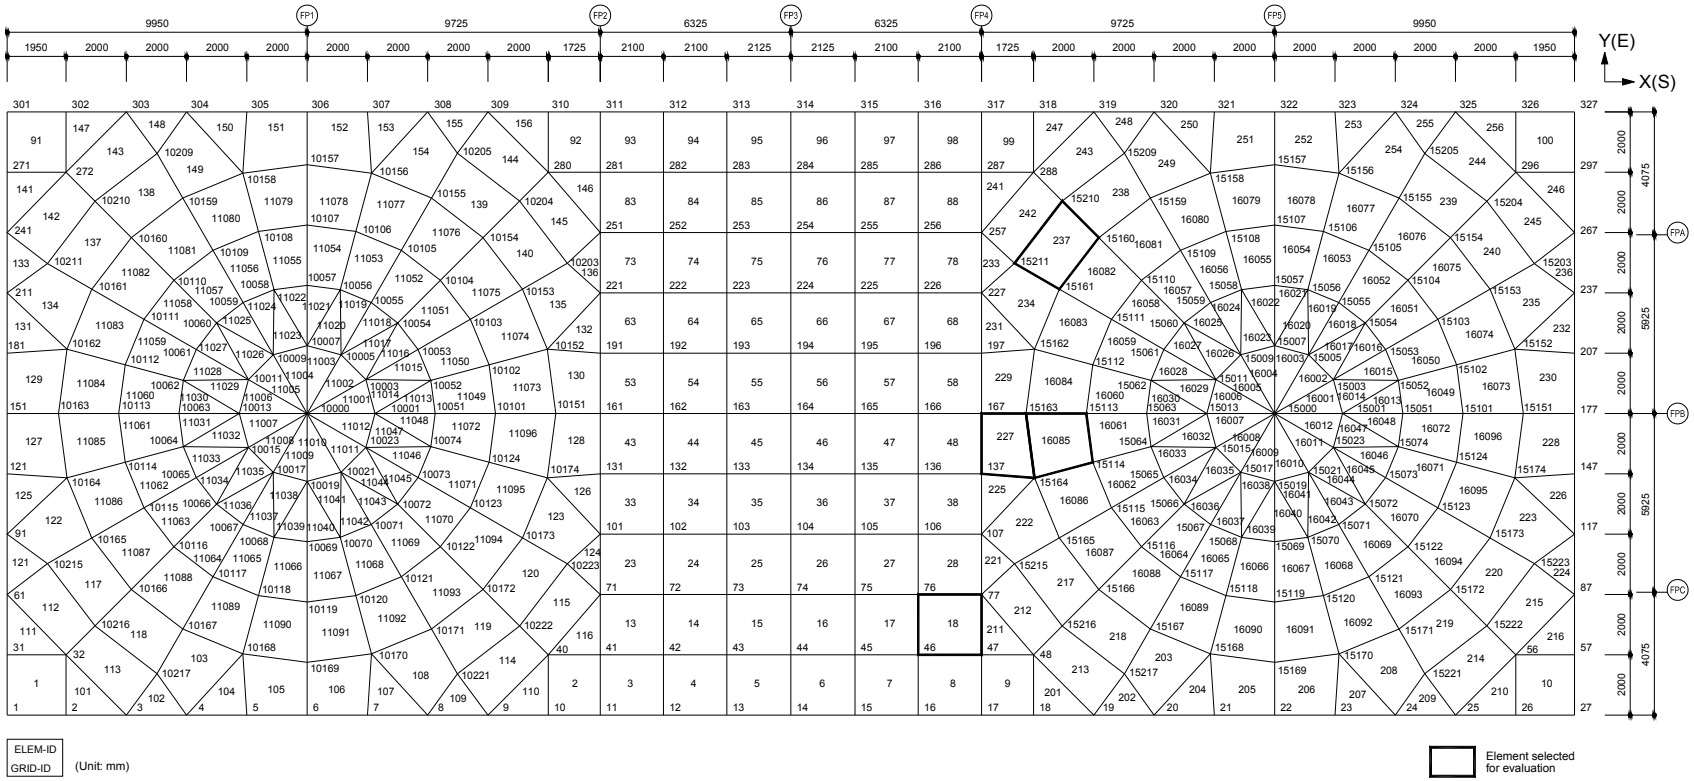

Figure 3G.4-3. FE Model of FWSC (Foundation Mat)

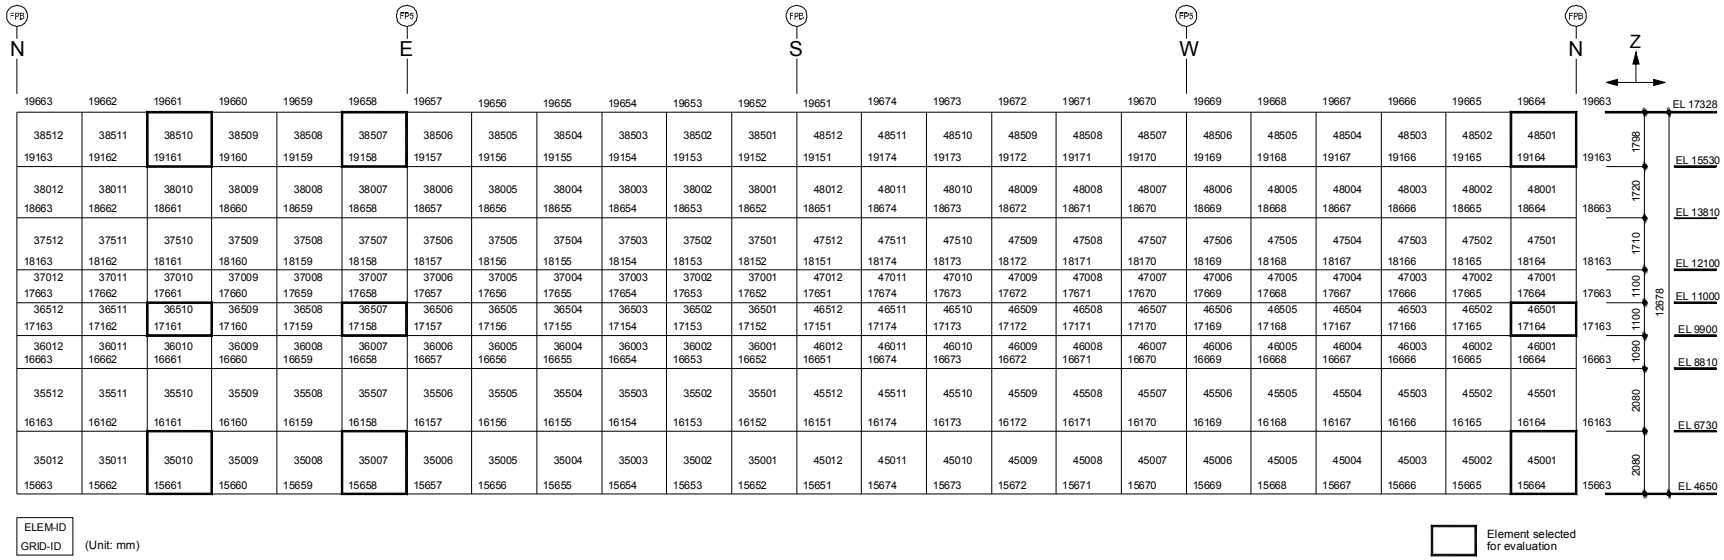

Figure 3G.4-4. FE Model of FWSC (South FWS Wall)

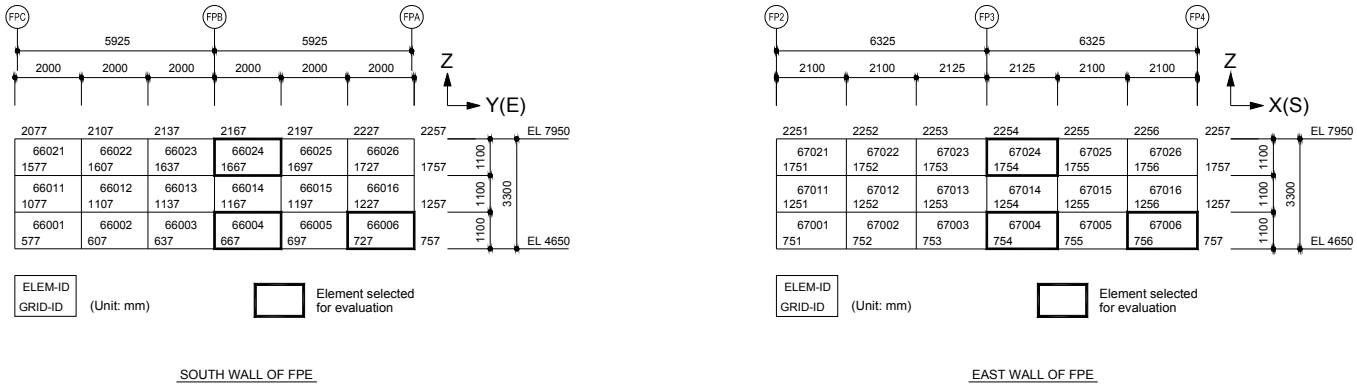

Figure 3G.4-5. FE Model of FWSC (FPE Wall: East and South)

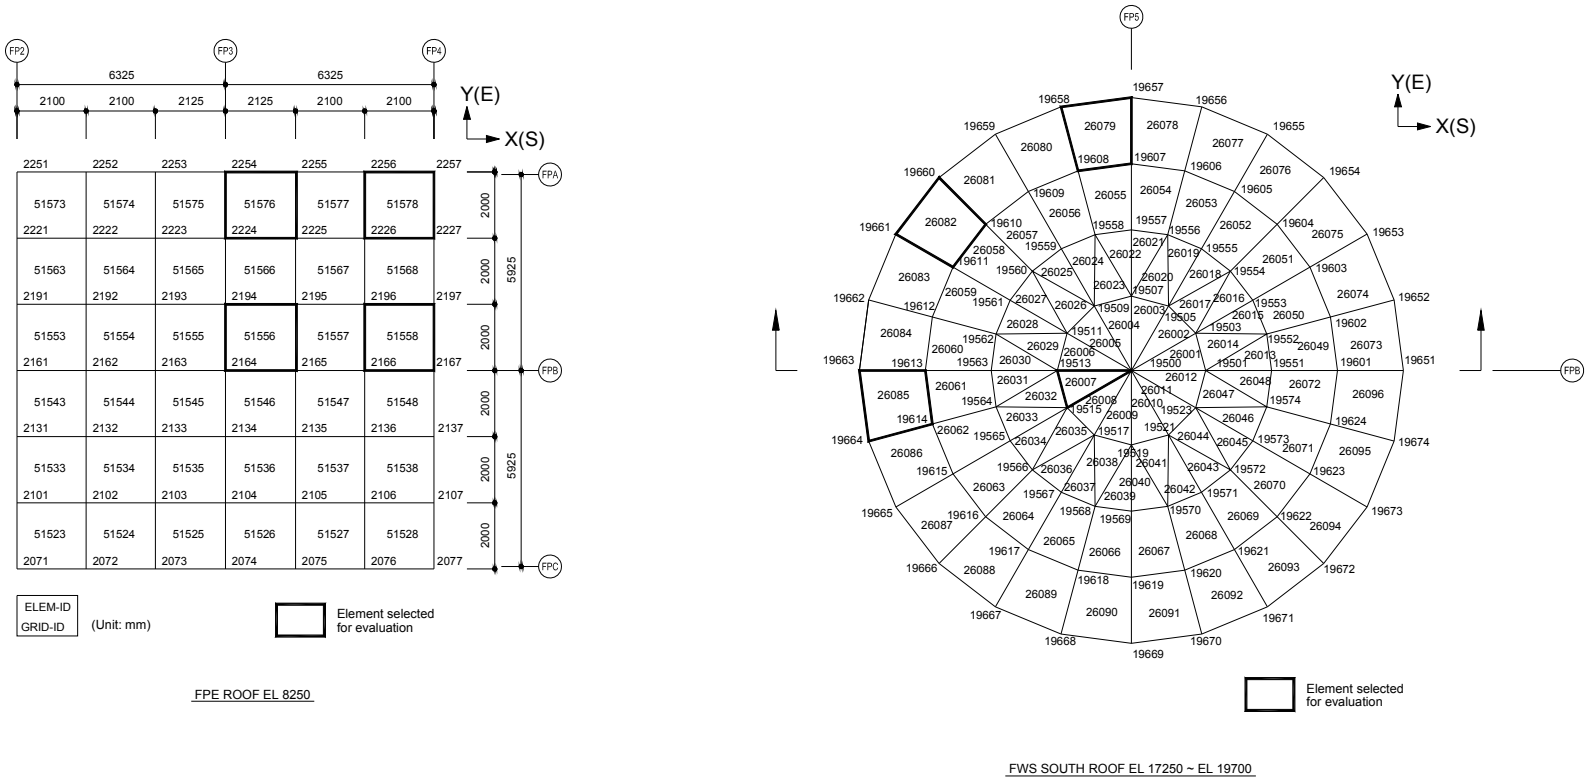

Figure 3G.4-6. FE Model of FWSC (FPE Roof Slab, South FWS Roof Slab)

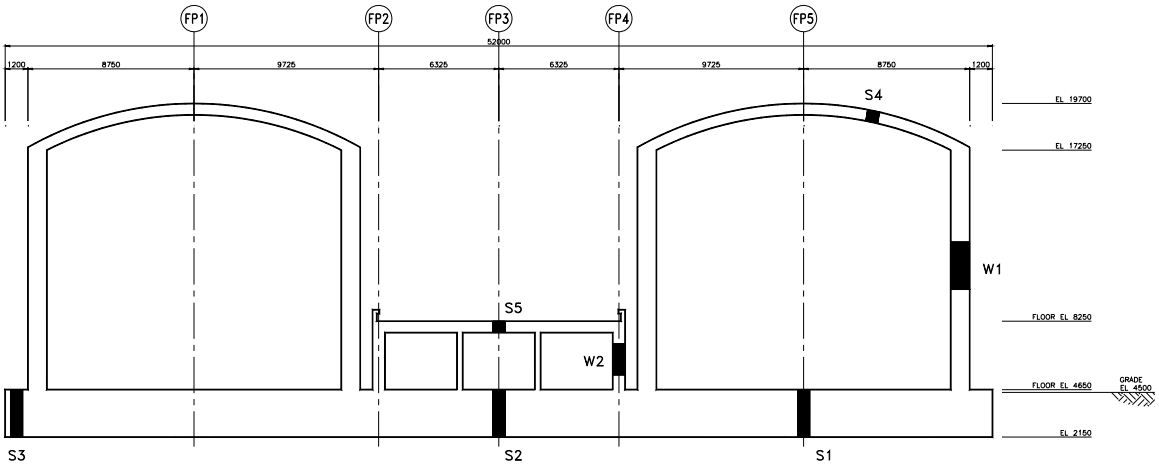

Figure 3G.4-7. Sections Where Thermal Loads Are Defined

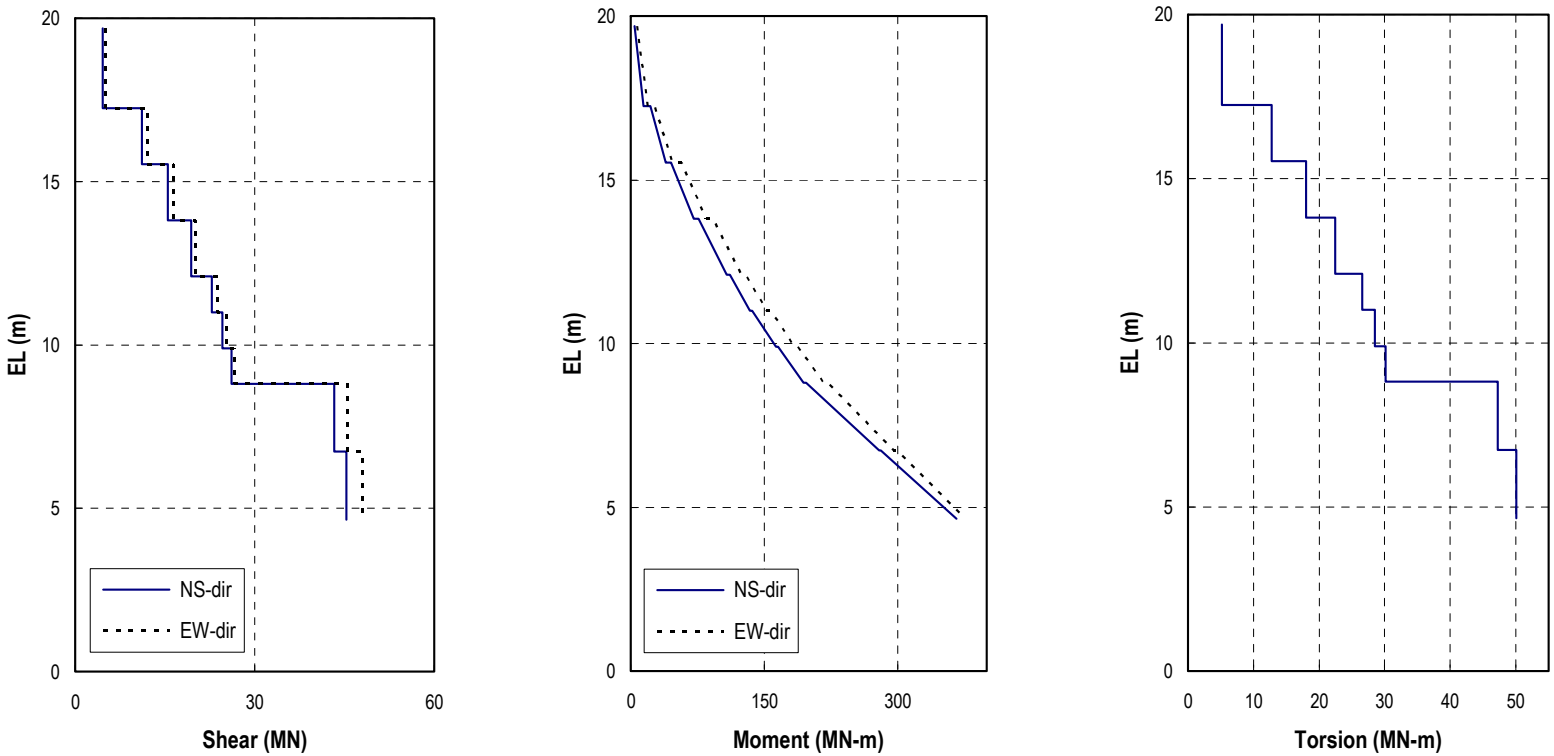

Figure 3G.4-8. Design Seismic Shears and Moments for FWSC (FWS)

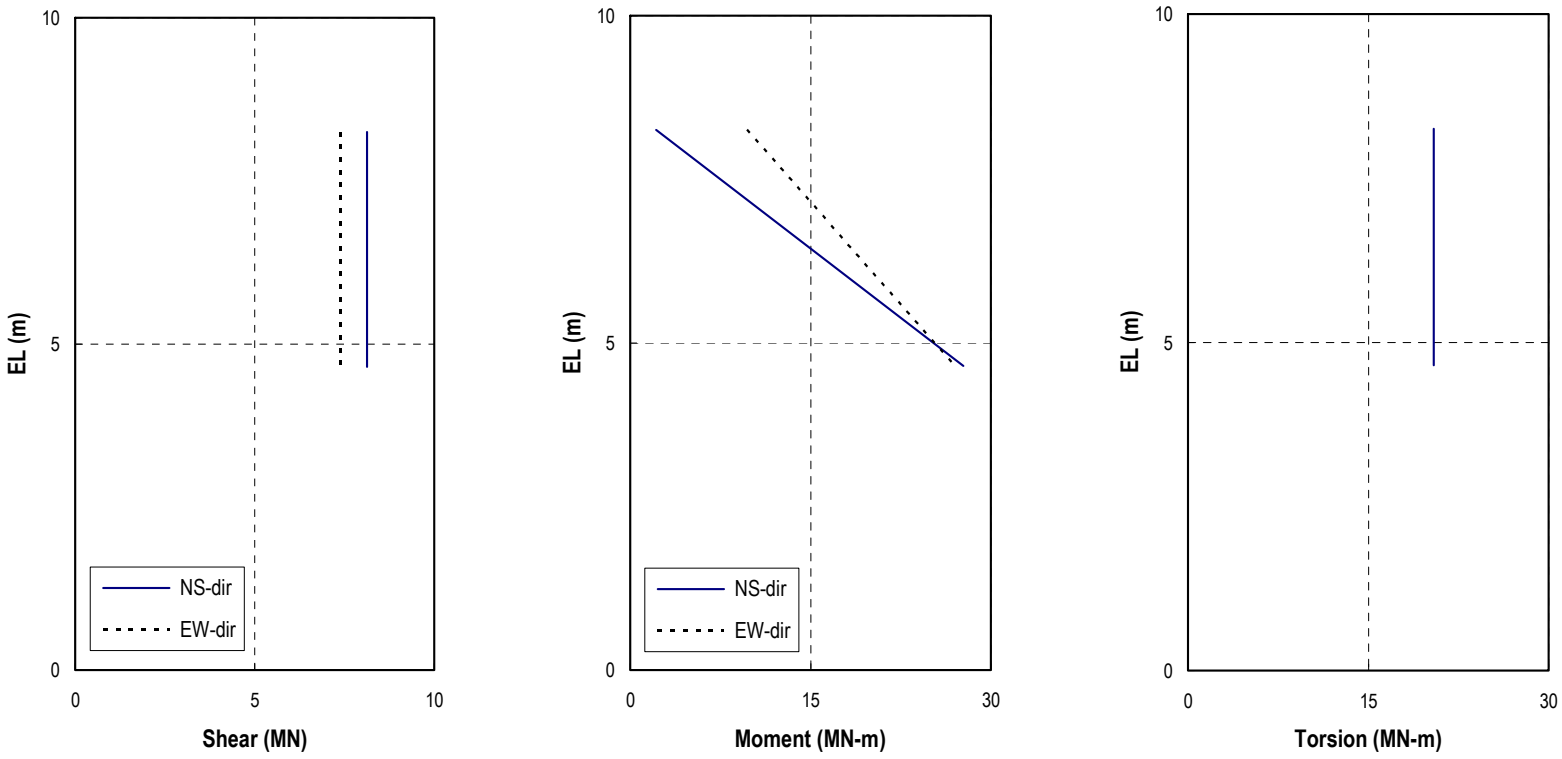

Figure 3G.4-9. Design Seismic Shears and Moments for FWSC (FPE)

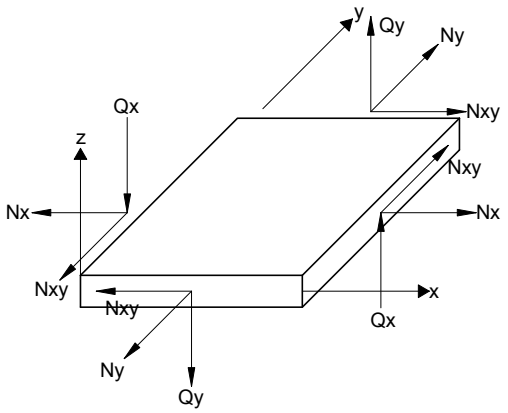

Membrane and Shear Forces

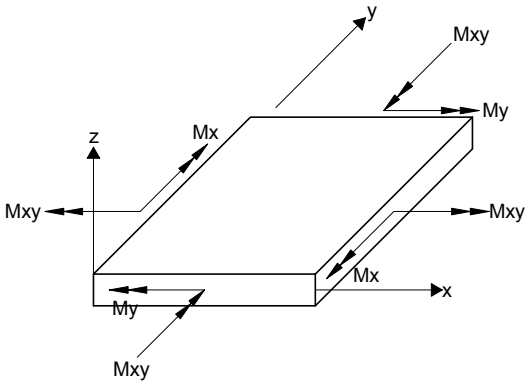

Moments

Definition of Element Coordinate System

Structure	x	y	z
Wall in N-S direction	horizontal	vertical	toward West
Wall in E-W direction	horizontal	vertical	toward North
Tank Wall	horizontal	vertical	outward
Foundation Mat & Roof	toward South	toward North	upward

Figure 3G.4-10. Force and Moment in Shell Element

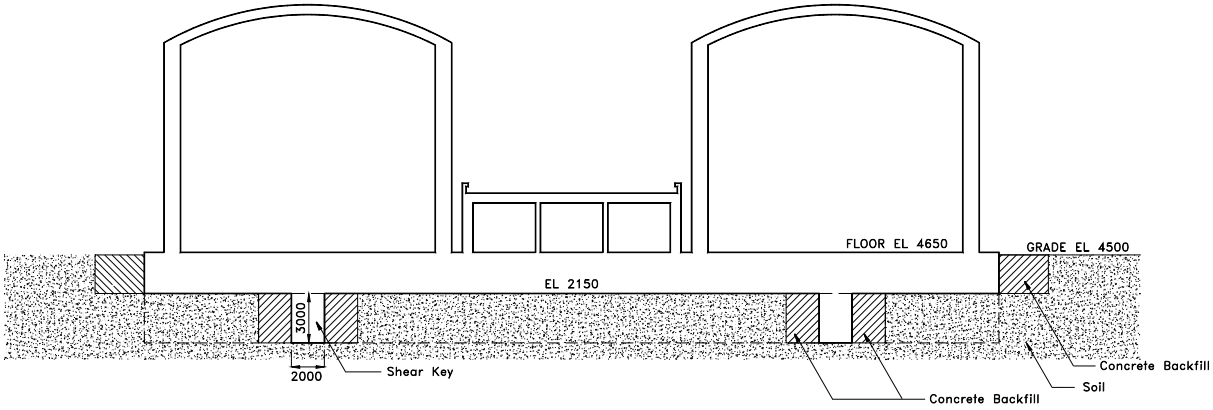

Note: Excavation and backfill method is determined considering actual site conditions.

Figure 3G.4-11. Shear Keys and Concrete Backfill in Sliding Evaluation

3H. EQUIPMENT QUALIFICATION DESIGN ENVIRONMENTAL CONDITIONS

3H.1 INTRODUCTION

This appendix specifies plant environmental conditions, which envelop the actual environment expected over the plant life, for which safety-related equipment (Section 3.11) is designed and qualified. The plant conditions considered in defining the environmental conditions are normal operation including anticipated operational occurrences (AOOs) and test, and accident conditions including post-accident operations. The accident condition considered is a hypothesized single event (not reasonably expected during the course of plant operation) that has the potential to cause severe environmental conditions for safety-related equipment. The specified accident conditions are based on significantly conservative assumptions.

The primary environmental parameters addressed are pressure, temperature, relative humidity, radiation, and chemical conditions. Safety-related equipment inside containment is designed and qualified for the environmental conditions resulting from the most limiting design basis accident and meets the Environmental Qualification (EQ) program acceptance criteria. The parameters specified in this appendix do not include margins that may be required to satisfy applicable codes and standards for equipment qualification. The radiation data specified in this appendix is intended to provide a conservative basis for equipment qualification and is not intended to limit or justify personnel access.

The following areas containing safety-related equipment are considered for equipment qualification purposes:

- Containment Vessel
- Reactor Building
- Control Building

3H.2 PLANT ZONES

3H.2.1 Containment Vessel

The containment vessel is divided into a drywell region and a pressure wetwell with an interconnecting vent system. The containment vessel is shown in Figure 6.2-1. The drywell volume is divided into an upper drywell and lower drywell by the RPV supports and support pedestal. The upper and lower drywell are interconnected. Table 3.2-1 identifies the safety-related equipment located within the containment vessel.

For normal operating conditions, the containment vessel is divided into three thermodynamic and four radiation zones to represent the enveloping levels of the environmental conditions. The environmental zones are shown in Table 3H-2 and Table 3H-5. For accident conditions, zones a-1 and a-2 have the same thermodynamic properties and the containment vessel (zones b-1 through b-3) has the same radiation properties with the exception of the wetwell (zone b-4).

3H.2.2 Outside Containment Vessel

The area outside the containment vessel includes:

- Control Building
- Reactor Building outside containment

The region inside the reactor building surrounding the containment encloses penetrations through the containment. The Control Room Habitability Area (CRHA) includes the main control room and areas adjacent to the control room containing operator facilities. Also located in the control building are safety-related DCIS rooms, located at elevation -7400 mm. Major equipment zones are shown on the reactor building arrangement drawing (Figures 1.2-1 to 1.2-9).

3H.3 ENVIRONMENTAL CONDITIONS

Table 3H-1 contains a cross listing of the environmental data tables arranged by location and by type of condition.

3H.3.1 Plant Normal Operating Conditions

Tables 3H-2 through 3H-4 define the thermodynamic conditions (pressure, temperature and humidity) for normal operating conditions for areas containing safety-related equipment. Figures showing equipment location and system configurations are referenced in each table. Tables 3H-5 through 3H-7 define the radiation conditions for normal operating conditions.

3H.3.2 Accident Conditions

Thermodynamic conditions for safety-related equipment in the containment vessel, Control Building and Reactor Building are presented in Tables 3H-8 through 3H-10 for accident conditions. Post-accident periods for the evaluated heat loads are specified in Table 3H-12. In general, the most severe environmental conditions result from a postulated reactor coolant line break inside the containment, LOCA (bounding case) plus Station Blackout (SBO), see Chapter 6 for detailed information. However, accident conditions were also considered for ruptures occurring in the steam tunnel and breaks in the RWCU/SDC System outside the containment, HELB plus SBO, see Chapter 6 for detailed information. Table 3H-11 specifies the evaluated radiation environmental qualifications for containment vessel during accidents. The EQ program confirms explicit radiation and thermodynamic conditions during accidents.

3H.3.3 Water Quality

Reactor water design quality characteristics during normal operation are:

- PH range: 5.6 to 8.6
- Silica (as SiO_2) ≤ 200 ppb (100 ppb operating target)
- Conductivity at 25°C ≤ 0.1 µS/cm (0.08 µS/cm operating target)
- Dissolved Oxygen (as O_2) ≤ 300 ppb
- Corrosion product metals ≤ 6 ppb

The Standby Liquid Control (SLC) System injects borated water into the Reactor Pressure Vessel during Design Basis Accident (DBA) LOCA. There is no caustic containment spray in the ESBWR project.

3H.3.4 Locations of Safety-Related Equipment

Table 3H-12 identifies the potential location for safety-related equipment assumed for each room or set of rooms and the evaluated heat load capacity. This table also contains the evaluated heat load for nonsafety-related rooms, because nonsafety-related equipment is conservatively assumed to continue to be powered by nonsafety-related batteries during the first 2 hours of SBO and thus contributes to the room heat up during SBO and a DBA. The EQ program confirms equipment locations and heat loads that fall within the specified acceptance criteria.

3H.3.5 Mild Environment Conditions

The environment parameter limits that constitute mild environment conditions are identified in Table 3H-13.

3H.3.6 COL Information

None.

3H.4 REFERENCES

3H.4-1 10 CFR 50 Appendix J, “Primary Reactor Containment Leakage Testing for Water-Cooled Power Reactors.”

3H.4-2 NUREG-1465, “Accident Source Terms for Light-Water Nuclear Power Plants,” February 1995.

3H.4-3 Not used.

3H.4-4 10 CFR Part 50, Appendix A, General Design Criterion 2, "Design Bases for Protection Against Natural Phenomena.”

3H.4-5 10 CFR Part 50, Appendix A, General Design Criterion 4, "Environmental and Dynamic Effects Design Bases.”

3H.4-6 10 CFR Part 50, 50.49, "Environmental Qualification of Electric Equipment Important to Safety of Nuclear Power Plants.”

3H.4-7 Regulatory Guide 1.209-2007, “Guidelines for Environmental Qualification of Safety-Related Computer-Based Instrumentation and Control Systems in Nuclear Power Plants.”

Table 3H-1

Cross Reference of Plant Environmental Data and Location

Plant Environmental Data	Location		
	Containment Vessel	Reactor Building	Control Building
Thermodynamic (Normal Conditions)	Table 3H-2	Table 3H-3	Table 3H-4
Thermodynamic (Accident Conditions)	Table 3H-8	Table 3H-9	Table 3H-10
Radiation	Table 3H-5 (Normal Conditions) Table 3H-11 (Accident Conditions)	Table 3H-6	Table 3H-7
Room Heat Loads	Table 3H-12	Table 3H-12	Table 3H-12
Thermodynamic/Radiation (Mild Environment Limits)	Table 3H-13	Table 3H-13	Table 3H-13

Table 3H-2

Thermodynamic Environment Conditions Inside Containment Vessel for Normal Operating Conditions

Plant Zone/Typical Equipment[1]	Pressure[2][3] (Gauge) kPa (psig)	Temperature[3] °C (°F)	Relative Humidity[3] %
(a-1) Upper drywell and upper area of lower drywell Figure 6.2-1)	9.0 (1.3)	57 (135) Ave 65 (150) Max	Not Controlled
(a-2) Lower area of lower drywell (Figure 6.2-1)	9.0 (1.3)	57 (135) Ave 60 (140) Max	Not Controlled
(a-3) Wetwell - pool and gas space (Figure 6.2-1)	5.3 (0.76) Nom 9.0 (1.3) Max 0 (0) Min	43 (110) Max[4]	100

(1) The containment atmosphere is nitrogen.

(2) The containment vessel is pressurized during leak rate tests once per refueling outage in accordance with 10 CFR 50, Appendix J.

(3) The worst combination of conditions in the table sets the design requirements of equipment.

(4) The suppression pool water may reach 46°C (115°F) during testing. The maximum abnormal temperature is 49°C (120°F).

Table 3H-3

Thermodynamic Environment Conditions Inside Reactor Building for Normal Operating Conditions

Plant Zone/Typical Equipment	Pressure[1] (Gauge) kPag (psig)	Temperature °C (°F)	Relative Humidity
Hydraulic Control Unit (HCU) Rooms HCU, RPS solenoids and RPV water level instrument racks Rooms No 1110, 1120, 1130, 1140 (Figure 1.2-1)	Negative Pressure	29 (85) Max 18 (65) Min	Not controlled
Battery Rooms Div 1, 2, 3 and 4 batteries Rooms No 1210, 1220, 1230, 1240 (Figure 1.2-2)	Negative Pressure	29 (85) Max 18 (65) Min	Not controlled
Div 1, 2, 3 and 4 commodity chases Electrical cables Rooms No 1211, 1221, 1231, 1241 (Figure 1.2-2)	Positive Pressure	40 (104) Max 10 (50) Min	Not controlled
Electrical Division Rooms Div 1, 2, 3 and 4 electrical and electronic equipment Rooms No 1311, 1321, 1331, 1341 (Figure 1.2-3)	Positive Pressure	29 (85) Max 18 (65) Min	Not controlled
Lower drywell non-divisional electrical and mechanical penetration Outboard containment isolation valves Rooms No 1300, 1301, 1302, 1303 (Figure 1.2-3)	Positive Pressure	40 (104) Max 10 (50) Min	Not controlled
Div 1, 2, 2 and 4 electrical penetration rooms Electrical cables and penetrations Rooms No 1312, 1322, 1332, 1342 (Figure 1.2-3)	Positive Pressure	40 (104) Max 10 (50) Min	Not controlled
Remote shutdown panel Rooms No 1313, 1323 (inside rooms 1311 and 1321) (Figure 1.2-3)	Positive Pressure	29 (85) Max 18 (65) Min	Not controlled
Non-divisional electrical equipment Safety-related DCIS panels Rooms No 1500, 1501, 1502, 1503 (Figure 1.2-5)	Positive Pressure	29 (85) Max 18 (65) Min	Not controlled

Table 3H-3

Thermodynamic Environment Conditions Inside Reactor Building for Normal Operating Conditions

Plant Zone/Typical Equipment	Pressure[1] (Gauge) kPag (psig)	Temperature °C (°F)	Relative Humidity
Div 1, 2, 3 and 4 electrical penetrations (EL.13570) Electrical cables and penetration Rooms No 1610, 1620, 1630, 1640 (Figure 1.2-6)	Negative Pressure	40 (104) Max 10 (50) Min	Not controlled
Div 1, 2, 3 and 4 corridors rooms (access to penetration area), divisional electrical cables and safety-related DCIS RMUs Rooms No 1710, 1720, 1730, 1740 (Figure 1.2-7)	Negative Pressure	29 (85) Max 18 (65) Min	Not controlled
Div 1, 2, 3 and 4 electrical penetration (EL. 17500) and Mechanical penetrations Electrical cables and penetrations. Outboard isolation valves Rooms No 1711, 1721, 1731, 1741 and 1712, 1722, 1732, 1742 (Figure 1.2-7)	Negative Pressure	40 (104) Max 10 (50) Min	Not controlled
SLC tank rooms SLC tank instrumentation Rooms No 1713, 1723 (Figure 1.2-7)	Negative Pressure	29 (85) Max 18 (65) Min	Not controlled
Main Steam Tunnel Main Steamline (MSL) isolation valves MSL drain isolation valves FW isolation valves Rooms No 1770 (Figure 1.2-7)	Negative Pressure	40 (104) Max 10 (50) Min	Not controlled
ICS/PCC pools ICS pools instrumentation Rooms No 18P3A/B/C/D, 18P4A/B/C/D/E/F, 18P5A/B/C, 18P6A/B/C (Figure 1.2-8)	Negative Pressure	40 (104) Max 10 (50) Min	100/Water

(1) Relative to surrounding areas.

Table 3H-4

Thermodynamic Environment Conditions Inside Control Building for Normal Operating Conditions

Plant Zone/Typical Equipment	Pressure (Gauge) kPag (psig)	Temperature °C (°F)	Relative Humidity %
Safety-related portions of CRHA Ventilation Subsystem Rooms No 3406, 3407 (Figure 1.2-5)	Positive Pressure	25.6 (78) Max 22.8 (73) Min	60 Max 25 Min
Control Room Habitability Area Main control room panels Rooms No 3275, 3201, 3202, 3204, 3205, 3270, 3271, 3272, 3273 and 3274 (Figure 3H-1)	Positive Pressure	25.6 (78) Max 22.8 (73) Min	60 Max 25 Min
Div 1, 2, 3 and 4 electrical rooms Safety-related DCIS panels Rooms No 3110, 3120, 3130 and 3140 (Figure 1.2-2)	Positive Pressure	25.6 (78) Max 22.8 (73) Min	60 Max 25 Min

Table 3H-5

Radiation Environment Conditions Inside Containment Vessel for Normal Operating Conditions

Plant Zone/Typical Equipment	Operating Dose Rate(1)(2)		Integrated Dose(2)(3)	
	Gamma (R/h)	**Beta** (R/h)	**Gamma** (R)	**Beta** (R)
(b-1) Upper drywell (Figure 6.2-1)	2.61 E+1	Negl.(4)	1.4 E+7	Negl.
(b-2) Upper area of lower drywell (Figure 6.2-1)	2.61 E+1	Negl.	1.4 E+7	Negl.
(b-3) Lower area of lower drywell (Figure 6.2-1)	1.98 E+1	Negl.	1.0 E+7	Negl.
(b-4) Wetwell - Suppression pool and gas space (Figure 6.2-1)	< 1.4	Negl.	1.7 E+2	Negl.

(1) Operating dose rate is at 100% rated power and located at a practical distance from radiation source.

(2) The doses are based on the radiation sources provided in Chapter 12.

(3) Integrated dose means the integrated value over 60 years.

(4) Negl.- Value less than 0.001 mR/h

Table 3H-6

Radiation Environment Conditions Inside Reactor Building for Normal Operating Conditions

Plant Zone/Typical Equipment	Integrated gamma dose (Rads)
Hydraulic Control Unit (HCU) Rooms HCU, RPS solenoids and RPV water level instrument racks Rooms No 1110, 1120, 1130, 1140 (Figure 1.2-1)	$< 10^{4(1)}$ $< 10^{6}$
Battery Rooms Div 1, 2, 3 and 4 batteries Rooms No 1210, 1220, 1230, 1240 (Figure 1.2-2)	$< 10^{6}$
Div 1, 2, 3 and 4 commodity chases Electrical cables Rooms No 1211, 1221, 1231, 1241 (Figure 1.2-2)	$< 10^{6}$
Electrical Division Rooms Div 1, 2, 3 and 4 electrical and electronic equipment Rooms No 1311, 1321, 1331, 1341 (Figure 1.2-3)	$< 10^{4(1)}$ $< 10^{6}$
Lower drywell non-divisional electrical and mechanical penetration Outboard containment isolation valves Rooms No 1300, 1301, 1302, 1303 (Figure 1.2-3)	$< 10^{6}$
Div 1, 2, 3 and 4 electrical penetration rooms Electrical cables and penetrations Rooms No 1312, 1322, 1332, 1342 (Figure 1.2-3)	$< 10^{6}$
Remote shutdown panel Rooms No 1313, 1323 (inside rooms 1311 and 1321) (Figure 1.2-3)	$< 10^{4(1)}$ $< 10^{6}$
Non-divisional electrical equipment Safety-related DCIS panels Rooms No 1500, 1501, 1502, 1503 (Figure 1.2-5)	$< 10^{4(1)}$ $< 10^{6}$
Div 1, 2, 3 and 4 electrical penetrations (EL.13570) Electrical cables and penetration Rooms No 1610, 1620, 1630, 1640 (Figure 1.2-6)	$< 10^{6}$

Table 3H-6

Radiation Environment Conditions Inside Reactor Building for Normal Operating Conditions

Plant Zone/Typical Equipment	Integrated gamma dose (Rads)
Div 1, 2, 3 and 4 corridors rooms (access to penetration area), divisional electrical cables and safety-related DCIS RMUs Rooms No 1710, 1720, 1730, 1740 (Figure 1.2-7)	$< 10^{4(1)}$ $< 10^{6}$
Div 1, 2, 3 and 4 electrical penetration (EL. 17500) and Mechanical penetrations Electrical cables and penetrations. Outboard isolation valves Rooms No 1711, 1721, 1731, 1741 and 1712, 1722, 1732, 1742 (Figure 1.2-7)	$< 10^{6}$
SLC tank rooms SLC tank instrumentation Rooms No 1713, 1723 (Figure 1.2-7)	$< 10^{4(1)}$ $< 10^{6}$
Main Steam Tunnel Main Steamline (MSL) isolation valves MSL drain isolation valves FW isolation valves Rooms No 1770 (Figure 1.2-7)	$< 10^{7}$
ICS/PCC pools ICS pools instrumentation Rooms No 18P3A/B/C/D, 18P4A/B/C/D/E/F, 18P5A/B/C, 18P6A/B/C (Figure 1.2-8)	$< 10^{4}$

(1) Electronic equipment is qualified for gamma dose $< 10^4$ Rads, other equipment is qualified for gamma dose $< 10^6$ Rads. In locations within these zones where the calculated dose is greater than 10^4 Rads the qualification is done for the actual calculated doses plus 10%, or equipment is protected from radiation.

Table 3H-7

Radiation Environment Conditions Inside Control Building for Normal Operating Conditions

Plant Zone/Typical Equipment	Integrated gamma dose (Rads)
Safety-related portions of CRHA Ventilation Subsystem Rooms No 3406, 3407 (Figure 1.2-5)	$< 10^3$
Control Room Habitability Area Main control room panels Rooms No 3275, 3201, 3202, 3204, 3205, 3270, 3271, 3272, 3273 and 3274 (Figure 3H-1)	$< 10^3$
Div 1, 2, 3 and 4 electrical rooms Safety-related DCIS panels Rooms No 3110, 3120, 3130 and 3140 (Figure 1.2-2)	$< 10^3$

Table 3H-8

Thermodynamic Environment Conditions Inside Containment Vessel for Accident Conditions

Plant Zone			
(a-1 & a-2)	Upper and lower drywell [1] (Figure 6.2-1)	Time [2] Temp. °C (°F) Press. kPag (psig) Humidity %	0 h – 72 h. 178 (352) Max. 310 (45) Max. Steam
(a-3)	Wetwell (Figure 6.2-1)	Time [2] Temp. °C (°F) Press. kPag (psig) Humidity %	0 h – 72 h 135 (275) Max. 310 (45) Max. 100

Notes:

(1) For a pipe failure inside the containment vessel, water accumulates in the lower drywell. The amount depends upon the break location.

(2) Time denotes the time after the occurrence of LOCA.

Table 3H-9

Thermodynamic Environment Conditions Inside Reactor Building for Accident Conditions

Plant Zone/Typical Equipment[3]			
Hydraulic Control Unit (HCU) Rooms HCU, RPS solenoids and RPV water level instrument racks Rooms No 1110, 1120, 1130, 1140 (Figure 1.2-1)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 50 (122) Max Not controlled Not controlled	96 h - 100 days 40 (104) Negative Pressure Not controlled
Battery Rooms Div 1, 2, 3 and 4 batteries Rooms No 1210, 1220, 1230, 1240 (Figure 1.2-2)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 50 (122) Max Not controlled Not controlled	96 h - 100 days 40 (104) Positive Pressure Not controlled
Div 1, 2, 3 and 4 commodity chases Electrical cables Rooms No 1211, 1221, 1231, 1241 (Figure 1.2-2)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 110 (230) Max Not controlled Not controlled	96 h - 100 days 50 (122) Positive Pressure Not controlled
Electrical Division Rooms Div 1, 2, 3 and 4 electrical and electronic equipment Rooms No 1311, 1321, 1331, 1341 (Figure 1.2-3)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 63 (145)[4] Not controlled Not controlled	96 h - 100 days <63 (145) Positive Pressure Not controlled
Lower drywell non-divisional electrical and mechanical penetration Outboard containment isolation valves Rooms No 1300, 1301, 1302, 1303 (Figure 1.2-3)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 110 (230) Max Not controlled Not controlled	96 h - 100 days 50 (122) Positive Pressure Not controlled
Div 1, 2, 3 and 4 electrical penetration rooms Electrical cables and penetrations Rooms No 1312, 1322, 1332, 1342 (Figure 1.2-3)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 110 (230) Max Not controlled Not controlled	96 h - 100 days 50 (122) Positive Pressure Not controlled
Remote shutdown panel Rooms No 1313, 1323 (inside rooms 1311 and 1321) (Figure 1.2-3)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 50 (122) Not controlled Not controlled	96 h - 100 days 40 (104) Positive Pressure Not controlled
Non-divisional electrical equipment Safety-related DCIS panels Rooms No 1500, 1501, 1502, 1503 (Figure 1.2-5)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 50 (122) Max Not controlled Not controlled	96 h - 100 days 40 (104) Positive Pressure Not controlled

Table 3H-9

Thermodynamic Environment Conditions Inside Reactor Building for Accident Conditions

Plant Zone/Typical Equipment[3]			
Div 1, 2, 3 and 4 electrical penetrations (EL.13570) Electrical cables and penetration Rooms No 1610, 1620, 1630, 1640 (Figure 1.2-6)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 110 (230) Max Not controlled Not controlled	96 h - 100 days 50 (122) Positive Pressure Not controlled
Div 1, 2, 3 and 4 corridors rooms (access to penetration area), divisional electrical cables and safety-related DCIS RMUs Rooms No 1710, 1720, 1730, 1740 (Figure 1.2-7)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 50 (122) Max Not controlled Not controlled	96 h - 100 days 40 (104) Negative Pressure Not controlled
Div 1, 2, 3 and 4 electrical penetration (EL. 17500) and Mechanical penetrations. Electrical cables and penetrations. Outboard isolation valves Rooms No 1711, 1721, 1731, 1741 and 1712, 1722, 1732, 1742 (Figure 1.2-7)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 110 (230) Max Not controlled Not controlled	96 h - 100 days 50 (122) Negative Pressure Not controlled
SLC tank rooms SLC tank instrumentation Rooms No1713, 1723 (Figure 1.2-7)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 50 (122) Max Not controlled Not controlled	96 h - 100 days 40 (104) Negative Pressure Not controlled
Main Steamline (MSL) isolation valves MSL drain isolation valves FW isolation valves Rooms No 1770 (Figure 1.2-7)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 117 (234) Max 76 (11) 100	96 h - 100 days 60 (140) Negative Pressure Not controlled
ICS/PCC pools ICS pools instrumentation Rooms No 18P3A/B/C/D, 18P4A/B/C/D/E/F, 18P5A/B/C, 18P6A/B/C (Figure 1.2-8)	Time[1] Temp. °C (°F) [2] Press. kPag (psig) Humidity %	0 h - 72 h 112 (234) Max 49 (7.1) 100	96 h - 100 days 100 (212) Positive Pressure 100

(1) Time indicates the time after the occurrence of the accident.

(2) After 72h, the temperature decreases to the temperature value shown for 96h.

(3) Electronic equipment is qualified for 50ºC during 72 hours; other equipment could be qualified for higher temperatures according to the above values. In locations within these zones where room temperature is higher than 50°C, electronic equipment is qualified for the actual calculated temperature within the zone, or the equipment is protected from high temperatures.

(4) The conditions for these rooms are considered to be a mild environment. The equipment is qualified for higher temperatures.

Table 3H-10

Thermodynamic Environment Conditions Inside Control Building for Accident Conditions

Plant Zone/Typical Equipment			
Safety-related portions of CRHA Ventilation Subsystem Rooms No 3406, 3407 (Figure 1.2-5)	Time(1) Temp. °C (°F) Press. Pa (psig) Humidity	0 h - 72 h 50 (122)Max Not controlled Not controlled	10 days – 100 days 26 (79) Max Positive Pressure Not controlled
Control Room Habitability Area Main control room panels Rooms No 3275, 3201, 3202, 3204, 3205, 3270, 3271, 3272, 3273 and 3274 (Figure 3H-1)	Time(1) Temp. °C (°F)(2) Press. Pa (psig) Humidity	0 – 72 h 8.3 (15) Max diff allowed 31 (4.5E-3) Not controlled	10 days 25.6 (78) max 31 (4.5E-3) 60% Max
Div 1, 2, 3 and 4 electrical roomsSafety-related DCIS panels Rooms No 3110, 3120, 3130 and 3140 (Figure 1.2-2)	Time(1) Temp. °C (°F) Press. Pa (psig) Humidity	0 h - 72 h 45 (113)Max Not controlled Not controlled	10 days – 100 days 26 (79) Max Positive Pressure Not controlled

(1) Time indicates the time after the occurrence of the accident.

(2) Maximum rise above normal operating temperature. After 72h, the temperature decreases to the temperature value shown for 10 days.

Table 3H-11

Radiation Environment Conditions Inside Containment Vessel for Accident Conditions

Plant Zone/Typical Equipment	Operating Dose Rate(1)		Integrated Dose(3)	
	Gamma (R/h)	Beta (R/h)	Gamma (R)	Beta (R)
(b-1) Upper drywell (Figure 6.2-1)	2.64 E+7	2.64 E+8	2.64 E+8	2.64 E+9
(b-2) Upper area of lower drywell (Figure 6.2-1)	2.64 E+7	2.64 E+8	2.64 E+8	2.64 E+9
(b-3) Lower area of lower drywell (Figure 6.2-1)	2.64 E+7	2.64 E+8	2.64 E+8	2.64 E+9
(b-4) Wetwell - Suppression pool and gas space (Figure 6.2-1)	4.0 E+7	5.3 E+8	4.0 E+8	6.6 E+9

(1) The radiation sources developed in accordance with NUREG-1465 are used.

(2) Note deleted.

(3) Integrated dose is for 6 months.

Table 3H-12

Room Heat Loads

Rooms	Contain safety-related equipment	Heat Load (W) (1)			Remarks
		0 – 2 hr	2 – 24 hr	24 – 72 hr	
1110, 1120, 1130, 1140	Yes	2300	2300	2300	
1100, 1101, 1102, 1103, 1150, 1151, 1152, 1160, 1161, 1162, 1195	No	1800 HELB	HELB	HELB	Heat load for LOCA with SBO scenario. Rooms bounded by HELB conditions, see Chapter 6
1106, 1107, 1196, 1197, 1198	No	Negligible	0	0	No heat load and no heat sink (conservative assumption)
1250, 1251, 1252, 1260, 1261, 1262, 1293, 1294, 1295, 1296	No	1800 HELB	HELB	HELB	Heat load for LOCA with SBO scenario. Rooms bounded by HELB conditions, see Chapter 6
1210, 1220, 1230, 1240	Yes	7200	6000	6000	
1211, 1221, 1231, 1241	Yes	500	500	500	
1203, 1204	No	Negligible	0	0	No heat load and no heat sink (conservative assumption)
1311, 1321, 1331, 1341	Yes	18200	18200	18200	
1304, 1305, 1306, 1307, 1308	No	HELB	HELB	HELB	Rooms bounded by HELB conditions, see Chapter 6
1300, 1301, 1302, 1303	Yes	1700 / 500	1700 / 500	1700 / 500	The higher heat load applies to the rooms in which the RWCU/SDC piping is located.
1312, 1322, 1332, 1342	Yes	500	500	500	
1313, 1323	Yes	500	500	500	
1400, 1401, 1402, 1403	No	5500	0	0	
1500, 1501, 1502, 1503	Yes	17500	2000	2000	
1600	No	300	0	0	
1610, 1620, 1630, 1640	Yes	500	500	500	
1710, 1720, 1730, 1740	Yes	3450 / 2250	3450 / 2250	3450 / 2250	The higher heat load applies to the rooms in which the RWCU/SDC piping is located.
1711, 1721, 1731, 1741	Yes	500	500	500	
1712, 1722, 1732, 1742	Yes	1200	1200	1200	
1713, 1723	Yes	200	200	200	
1770	Yes	HELB	HELB	HELB	Room bounded by HELB conditions, see Chapter 6

Table 3H-12

Room Heat Loads

Rooms	Contain safety-related equipment	Heat Load (W) (1)			Remarks
		0 – 2 hr	2 – 24 hr	24 – 72 hr	
18P3A/B/C/D, 18P4A/B/C/D/E/F, 18P5A/B/C, 18PA/B/C	Yes	HELB	HELB	HELB	Rooms bounded by HELB conditions, see Chapter 6
3110, 3120, 3130, 3140	Yes	5720	4675	3080	
3100, 3101	No	0	0	0	No heat loads during a 0 - 72 hour period (heat sink)
CRHA (3275, 3201, 3202, 3204, 3205, 3270, 3271, 3272, 3273, 3274)	Yes	7375 (Note this does not include the nonsafety-related heat loads. There is a cooling system sized to remove the nonsafety-related heat loads for 2 hr. See Subsection 9.4.1)	7375	7375	200 l/s of outside air are considered (see Table 9.4-1). It is assumed that the control room habitability area is well mixed. Heat load provided for overall CRHA.
3276	No	2000	0	0	
3200,3203, 3277	No	0	0	0	No heat loads during a 0-72 hour period (heat sink)
3250, 3261	Yes	500	500	500	
3251, 3260	No	0	0	0	No heat loads during a 0-72 hour period (heat sink)
3301, 3302	No	54000	0	0	Louver for each room maintains a maximum temperature of 50ºC during SBO. See Figures 1.2-4, 1.2-5 and 1.2-11.
3401, 3402, 3403, 3404 & corridors	No	0	0	0	No heat loads during a 0-72 hour period (heat sink)
3406, 3407	Yes	500	500	500	

(1) Heat Loads provided per room except as noted.

Table 3H-13

Typical Mild Environment Parameter Limits

Parameter	Limits	Notes
Temperature	50°C (122°F) 63°C (145°F)	Normal Abnormal
Pressure	Atmospheric	Nominal
Humidity	30 – 65% ≤ 95%	Typical Abnormal
Radiation	≤ 1E4 Rads Gamma ≤ 1E3 Rads Gamma	 Electronics
Chemistry	None	
Submergence	None	

Figure 3H-1. Control Room Habitability Area

3I. DESIGNATED NEDE-24326-1-P MATERIAL WHICH MAY NOT CHANGE WITHOUT PRIOR NRC APPROVAL

This appendix presents the necessary NEDE-24326-1-P (Reference 3I-1), "General Electric Environmental Qualification Program," material for *identifying the material, by italics, which shall not be changed without prior NRC approval*. (See Section 3.10.)

3I.1 GENERAL REQUIREMENTS FOR DYNAMIC TESTING

(Paragraph 4.4.2.5.1 of Ref. 3I-1)

(a) ***Mounting*** *– Specimens to be tested will be mounted in a manner that adequately simulates the installed configuration or as described in the applicable GE mounting documentation.* Mounting will be specified in the Product Performance Qualification Specification (PPQS).

(b) ***Monitoring*** *– Sufficient monitoring equipment will be used to evaluate the performance of the specimen before, during, and after the test. Monitoring product is used to allow determination of applied vibration levels and equipment responses. The location of monitoring sensors* shall be specified by the PPQS and *will be documented in the test report.*

When required by the PPQS*, the response of the product will be measured using accelerometers. When required* by the PPQS*, the accelerometers shall be located at a sufficient number of locations on the product to define the mode shapes and/or frequencies which would be required to allow dynamic qualification of individual safety-related components and devices, to support analytical extrapolation of test results, or to verify frequency requirements.*

(c) ***Exploratory Tests*** *– Exploratory vibration tests may be performed on the product to aid in the determination of the test method that will best qualify or determine the dynamic characteristics of the product. If it can be shown that the equipment is not resonant at any frequency within the expected frequency range, it may be considered a rigid body and tested according to methods and procedures discussed in Subsection 4.4.2.5.6 of Reference 3I-1 or analyzed according to the methods of Subsection 4.4.4.1.4.5 of Reference 3I-1.*

If the product contains a single resonance or multiple resonances, one of the methods outlined in Subsection 4.4.2.5.3 of Reference 3I-1 will be used to qualify the product by test.

The exploratory test may be performed in the form of a low-level, continuous sinusoidal sweep at a rate no greater than 2 octave per minute over the frequency range equal to or greater than that to which the equipment is to be qualified. All resonances will be recorded for use in determining the test method to be used or the dynamic characteristics of the equipment. If the configuration of the product is such that critical natural frequencies cannot be ascertained, dynamic qualification will be accomplished by testing by the Response Spectrum method as specified in Paragraph 4.4.2.5.3.6 of Reference 3I-1. An acceptable alternative qualification method is a fragility test as described in Subsection 4.4.2.5.7 of Reference 3I-1.

(d) ***Dynamic Event Aging Tests*** *– The dynamic tests simulate the effect of low level earthquake loads combined with Service Level B RBV dynamic loads. The dynamic tests are performed on aged products unless otherwise justified.* (See Section 3.10)

The test sequence to be used will be:

(1) Vibration aging (if required);

(2) Low level earthquake loads combined with Service level B RBV dynamic loads; and

(3) SSE loads combined with Service level D RBV dynamic loads

Because most testing is biaxial rather than triaxial, the above sequence and durations are applied twice with the equipment being rotated 90 degrees on the table between the two tests. (See Section 3.10)

The Test Response Spectra (TRS) will envelop the RRS as specified in 4.2.2.a(6) of Reference 3I-1. (See Section 3.10)

(e) ***Loading*** *– Dynamic tests will be performed with the product subjected to nominal operating service conditions. If significant, normal operating loads such as electrical, mechanical, pressure, and thermal will be included. Where normal operating loads cannot be included in the dynamic tests, supplemental analysis will be used to qualify the product for those effects*. (See Section 3.10)

3I.2 PRODUCT AND ASSEMBLY TESTING

(Paragraph 4.4.2.5.2 of Ref. 3I-1)

(a) *Products will be tested simulating nominal operating conditions. In addition, dynamic coupling between interacting equipment will be considered*. See Section 3.10. The product shall be mounted on the shaker table as stated in Paragraph 4.4.2.5.1(a) of Reference 3I-1. If the product is intended to be mounted on a panel, the panel will be included in the test mounting.

Alternatively, the response at the product mounting location may be measured in the assembly test as specified in Paragraph 4.4.2.5.1(a) of Reference 3I-1. Then the product will be mounted directly to the shaker table, with the dynamic input being that which was determined at the product mounting location.

3I.3 MULTIPLE-FREQUENCY TESTS

(Paragraph 4.4.2.5.3 of Ref. 3I-1)

(a) ***General*** *– When the dynamic ground motion has not been strongly filtered, the mounting location retains the broadband characteristics. In this case, multi-frequency testing is applicable to dynamic qualification.* (See Section 3.10)

(b) **Response Spectrum Test** – Testing shall be performed by applying artificially generated input excitation to the product, the amplitude of which is controlled in 1/3 octave or narrower bands. *The excitation will be controlled to provide a test response spectrum (TRS) which meets or exceeds the required response spectrum (RRS). The peak value of the input excitation equals or exceeds the zero period acceleration (ZPA) of the RRS*. (See Section 3.10)

3I.4 SINGLE- AND MULTI-AXIS TESTS

(Paragraph 4.4.2.5.4 of Ref. 3I-1)

Single-axis tests may be allowed if the tests are designed to conservatively reflect the dynamic event at the equipment mounting locations or if the product being tested can be shown to respond independently in each of the three orthogonal axis or otherwise withstand the dynamic event at its mounting location.

If the preceding considerations do not apply, multi-axis testing will be used. The minimum is biaxial testing with simultaneous inputs in a principal horizontal axis and the vertical axis. Independent random inputs are preferred, and, if used, the test will be performed in two steps with the equipment rotated 90° in the horizontal plane for the second step. If independent random inputs are not used (such as with single frequency tests), four tests would be run; first, with the inputs in phase; second, with one input 180° out of phase; third, with the equipment rotated 90° horizontally and the inputs in phase; and, finally, with the same equipment orientation as in the third step but with one input 180° out of phase. (See Section 3.10)

3I.5 SINGLE FREQUENCY TESTS

(Paragraph 4.4.2.5.6 of Ref. 3I-1)

If it can be shown that the products, as defined in Regulatory Guide 1.92 have no resonances, or only one resonance, or if resonances are widely spaced and do not interact to reduce the fragility level in the frequency range of interest or, if otherwise justified, single frequency tests may be used to fully test the product. (See Section 3.10)

3I.6 DAMPING

(Paragraph 4.4.2.5.7 of Ref. 3I-1)

The product damping value used for dynamic qualification shall be established. See (Reference 3I-1) Section 5 of IEEE-344. (Also see Subsections 3.9.2.2, 3.9.3, and Section 3.10)

3I.7 QUALIFICATION DETERMINATION

(Paragraph 4.4.3.3 of Ref. 3I-1)

In order for equipment to be qualified by reason of operating experience, documented data will be available confirming that the following criteria have been met:

(a) the product providing the operating experience is identical or justifiably similar to the equipment to be qualified;

(b) the product providing the operating experience has operated under service conditions which equal or exceed, in severity, the service conditions and performance requirements for which the product is to be qualified; and

(c) the installed product must, in general, be removed from service and subjected to partial type testing to include the dynamic and design basis event environments for which the product is to be qualified. (See Section 3.10)

3I.8 DYNAMIC QUALIFICATION BY ANALYSIS

(Paragraph 4.4.4.1.4 of Ref. 3I-1)

(a) The analytical procedures described in this section may be used for dynamic qualification of products.

(b) Many factors control the design of a qualification program. Paragraphs 4.2.2.c(3) and 4.2.2.d(1) of Reference 3I-1 provide general guidelines on dynamic analysis techniques. Analytical techniques and modeling assumptions will, when possible, be based on a correlation of the analytical approach with testing or operating experience performed on similar equipment or structures. *Analysis may be used as a qualification method for the following conditions:*

(1) *if maintaining structural integrity is the only required assurance of the safety-related function* (see Section 3.10);

(2) if the response of the equipment is linear or has a simple nonlinear behavior which can be predicted by conservative analytical methods; or

(3) if the product is too large to test.

3I.9 REQUIRED RESPONSE SPECTRA

(Paragraph 4.4.4.1.4.6.2 of Ref. 3I-1)

(a) *The required response spectra that define the dynamic criteria for the location(s) of the product under consideration are to be given in the PPQS. If the equipment under consideration is attached to the structural system at more than one location, then the dynamic analysis performed takes into consideration the different response spectra at the different support locations. The effect of multiple support attachment points or multiple locations of the particular product can also be accounted for by selecting a single spectrum which will effectively produce the critical maximum responses due to different accelerations existing at different points.* (See Section 3.10.) This may be conservatively accomplished by enveloping the response spectra for the different applicable locations. Alternatively, actual multi-support excitation effects may be taken into account by performing a multi-support excitation analysis.

3I.10 TIME HISTORY ANALYSIS

(Paragraph 4.4.4.1.4.6.3 of Ref. 3I-1)

Time history analysis will be performed when conditions arise invalidating the response spectrum method of analysis due to nonlinear phenomena, or when generation of in-equipment response spectra or a more exact result is desired. To integrate or differentiate, the analysis will be done by an applicable numerical integration technique. The largest time step used in the analysis will be 1/10 of the period of the highest significant mode of vibration of the equipment. *The dynamic input will be the time history motion at the equipment support location.* (See Section 3.10.) For products supported at several locations, the responses will be determined by simultaneous excitations using appropriate time history input at each support location. The scaled time interval will be varied as per Paragraph 4.4.2.a(6) of Reference 3I-1.

If the product frequency is within the range of the supporting structure, then a time interval will be chosen such that the peak of the response spectrum shall be at the product resonance frequency. The total time interval range will be provided with the time history.

3I.11 REFERENCES

3I-1 GE Nuclear Energy, "General Electric Environmental Qualification Program," NEDE-24326-1-P, Proprietary Document, January 1983.

3J. EVALUATION OF POSTULATED RUPTURES IN HIGH ENERGY PIPES

3J.1 BACKGROUND AND SCOPE

The need for an evaluation of the dynamic effects of fluid dynamic forces resulting from postulated ruptures in high energy piping systems is established by Standard Review Plan (SRP) Sections 3.6.1 and 3.6.2. The criteria for performing this evaluation are defined in Subsections 3.6.1 and 3.6.2, SRP Sections 3.6.1 and 3.6.2 and ANS 58.2.

This Appendix defines an acceptable procedure for performing these evaluations.

The evaluation is performed in four major steps:

(1) Identify the location of the postulated rupture and whether the rupture is postulated as circumferential or longitudinal.

(2) Select the type and location of the pipe whip restraints.

(3) Perform a complete system dynamic analysis or a simplified dynamic analysis, as appropriate, of the ruptured pipe and its pipe whip restraints to determine the total movement of the ruptured pipe, the loads on the pipe, strains in the pipe whip restraint, and, if applicable, the stresses in the piping in the penetration area.

(4) Evaluate safety-related equipment that may be impacted by the ruptured pipe or the target of the pipe rupture jet impingement.

The criteria for locations where pipe ruptures must be postulated and the criteria for defining the configuration of the pipe rupture are defined in Subsection 3.6.2. Also defined in Subsection 3.6.2 are:

- the fluid forces acting at the rupture location and in the various segments of the ruptured pipe, and
- the jet impingement effects including jet shape and direction and jet impingement load.

The high energy fluid systems are defined within Subsection 3.6.2.1, and identified in Tables 3.6-3 and 3.6-4. Safety-related systems, components and equipment, or portions thereof, specified in Tables 3.6-1 and 3.6-2, are protected from pipe break effects that would impair their ability to facilitate safe shutdown of the plant.

The information contained in Subsections 3.6.1 and 3.6.2 and in the SRPs and ANS 58.2 is not repeated in this appendix.

3J.2 IDENTIFICATION OF RUPTURE LOCATIONS AND RUPTURE GEOMETRY

3J.2.1 Ruptures in Containment Penetration Area.

Postulation of pipe ruptures in the portion of piping in the containment penetration area is not allowed. This includes the piping between the inner and outer isolation valves. Therefore, the final stress analysis of the piping system is examined to confirm that, for piping in the containment penetration areas, the design stress and fatigue limits specified in Subsection 3.6.2.1 are not exceeded.

3J.2.2 Ruptures in Areas other than Containment Penetration.

Breaks in Class 1 piping are postulated in accordance with Subsection 3.6.2.1.1.

Breaks in Class 2 and 3 piping are postulated in accordance with Subsection 3.6.2.1.1.

Breaks in seismically analyzed non-ASME Class piping are postulated in accordance with the above requirements for Class 2 and 3 piping.

3J.2.3 Determination of the Type of Pipe Break

Determination of whether the high energy line break is longitudinal or circumferential is in accordance with Subsection 3.6.2.1.3.

3J.3 DESIGN AND SELECTION OF PIPE WHIP RESTRAINTS

3J.3.1 Preliminary Selection of Pipe Whip Restraint

The load carrying capability of the GE U-Bar pipe whip restraint is determined by the number, size, bend radius and the straight length of the U-bars. The pipe whip restraint must resist the thrust force at the pipe rupture location and the impact force of the pipe. The magnitude of these forces is a function of the pipe size, fluid, and operating pressure.

A preliminary selection of one of the standard GE pipe whip restraints is made by matching the thrust force at the rupture location with a pipe whip restraint capable of resisting this thrust force. This is done by access to the large database contained in the GE REDEP computer file. This file correlates the pipe size and the resulting thrust force at the pipe rupture with the U-bar pipe whip restraints designed to carry the thrust force. REDEP then supplies the force/deflection data for each pipe whip restraint.

3J.3.2 Preparation of Simplified Computer Model of Piping-Pipe Whip Restraint System.

A simplified computer model of the piping system is prepared as described in Subsection 3J.4.2.1 and as shown in Figure 3J-1 and Figure 3J-2. Critical variables are the length of pipe, type of end condition, distance of pipe from structure and location of the pipe whip restraint. The pipe whip restraint is located as near as practical to the ruptured end of the pipe, but so as to minimize interference to inservice inspection.

3J.3.3 Piping Dynamic Analysis

The Pipe Dynamic Analysis (PDA) computer program is run using the following input:

- The information from the simplified piping model, including pipe length, diameter, wall thickness and pipe whip restraint location.
- Piping information such as pipe material type, stress/strain curve and pipe material mechanical properties.
- Pipe whip restraint properties such as force-deflection data and elastic plastic displacements.
- Force time-history of the thrust at the pipe rupture location.

3J.3.4 Selection of Pipe Whip Restraint for Pipe Whip Restraint Analysis

PDA provides displacements of pipe and pipe whip restraint, pipe whip U-bar strains, pipe forces and moments at fixed end, time at peak load and lapsed time to achieve steady state using thrust load and pipe characteristics.

The displacements at the pipe broken end and at the pipe whip restraint are checked and the loads on the piping and the strains of pipe whip restraint U-bars are compared to allowable loads and strains. If the output results are not satisfactory, PDA is rerun with different pipe whip restraint parameters.

3J.4 PIPE RUPTURE EVALUATION

3J.4.1 General Approach

There are several analytical approaches, that may be used in analyzing the pipe/pipe whip restraint system for the effects of pipe rupture. This procedure defines two acceptable approaches.

(1) **Dynamic Time-History Analysis With Simplified Model** - A dynamic time history analysis of a portion of a piping system may be performed in lieu of a complete system analysis when it can be shown to be conservative by test data or by comparison with a more complete system analysis. For example, in those cases where pipe stresses in the containment penetration region need not be calculated, it is acceptable to model only a portion of the piping system as a simple cantilever with a fixed or pinned end or as a beam with both ends fixed or with one end pinned and one end fixed.

When a circumferential break is postulated, the pipe system is modeled as a simple cantilever, the thrust load is applied opposite the fixed (or pinned) end and the pipe whip restraint acts between the fixed (or pinned) end and the thrust load. It is then assumed that deflection of the pipe is in one plane. As the pipe moves a resisting bending moment in the pipe is created and later a restraining force at the pipe whip restraint. Pipe movement stops when the resisting moments about the fixed (or pinned) end exceed the applied thrust moment.

When a longitudinal break is postulated, the pipe system has both ends supported. To analyze this case, two simplifications are made to allow the use of the cantilever model described above. First, an equivalent point mass is assumed to exist at D (Figure 3J-2) instead of pipe length DE. The inertia characteristics of this mass, as it rotates about point B, are calculated to be identical to those of pipe length DE, as it rotates about point E. Second, an equivalent resisting force is calculated (from the bending moment-angular deflection relationships for end DE) for any deflection for the case of a built-in end. This equivalent force is subtracted from the applied thrust force when calculating the net energy.

See Figure 3J-1 and Figure 3J-2 for the models described above.

(2) **Dynamic Time-History Analysis with Detailed Piping Model**—In many cases it is necessary to calculate stresses in the ruptured pipe at locations remote from the pipe whip restraint location. For example, the pipe in the containment penetration area must meet the limits of SRP 3.6.2. In these cases it is required that the ruptured piping, the pipe supports, and the pipe whip restraints be modeled in sufficient detail to reflect their dynamic

characteristics. A time-history analysis using the fluid forcing functions at the point of rupture and the fluid forcing functions of each pipe segment is performed to determine deflections, strains, loads to structure and equipment and pipe stresses.

3J.4.2 Procedure For Dynamic Time-History Analysis With Simplified Model

3J.4.2.1 Modeling of Piping System

For many piping systems, required information on the response to a postulated pipe rupture can be determined by modeling a portion of the piping system as a cantilever with either a fixed or pinned end. The fixed end model, as shown in Figure 3J-1, is used for piping systems where the stiffness of the piping segment located between A and B is such that the slope of the pipe length, BD, at B, would be approximately zero. The pinned end model, as shown in Figure 3J-1, is used for piping systems where the slope of the pipe length, BD, at B, is much greater than zero. The pinned end model is also used whenever it is not clear that the pipe end is fixed.

A simplified cantilever model may also be used for a postulated longitudinal break in a pipe supported at both ends, as shown in Figure 3J-2. The pipe can have both ends fixed or have pinned end at B and a fixed end at E, as shown in Figure 3J-2. Subsection 3J.4.1(1) discusses the simplification techniques used to allow the use of a cantilever model. A fixed end is used when rotational stiffness of the piping at that location is such that the slope of the pipe at that end is approximately zero. A pinned end is used when the pipe slope at that end is much greater than zero. If it is not clear whether an end is fixed or pinned, the end condition giving more conservative results should be assumed.

The pipe whip restraint is modeled as two components acting in series; the restraint itself and the structure to which the restraint is attached. The restraint and piping behave as determined by an experimentally or analytically determined force-deflection relationship. The structure deflects as a simple linear spring of representative spring constant.

The model must account for the maximum clearance between the restraint and the piping. The clearance is equal to the maximum distance from the pipe during normal operation to the position of the pipe when the pipe whip restraint starts picking up the rupture load. This simplified model is not used if the piping has snubbers or restraints strong enough to affect the pipe movement following a postulated rupture.

3J.4.2.2 Dynamic Analysis of Simplified Piping Model

When the thrust force (as defined in Subsection 3.6.2.2) is applied at the end of the pipe, rotational acceleration would occur about the fixed (or pinned) end. As the pipe moves, the net rotational acceleration would be reduced by the resisting bending moment at the fixed end and by the application of the restraining force at the pipe whip restraint. The kinetic energy would be absorbed by the deflection of the restraint and the bending of the pipe. Movement would continue until equilibrium is reached. The primary acceptance criteria is the pipe whip restraint deflection or strain must not exceed the design strain limit of 50% of the restraint material ultimate uniform strain capacity.

The analysis may be performed by a general purpose computer program with capability for nonlinear time-history analysis such as ANSYS, or by a special purpose computer program

especially written for pipe rupture analysis such as the GE computer program, "Pipe Dynamic Analysis".

3J.4.3 Procedure For Dynamic Time-History Analysis Using Detailed Piping Model

3J.4.3.1 Modeling of Piping System

In general, the rules for modeling the ruptured piping system are the same as the modeling rules followed when performing seismic/dynamic analysis of Seismic Category I piping. These rules are outlined in Subsection 3.7.3.3. The piping, pipe supports and pipe whip restraints are modeled in sufficient detail to reflect their dynamic characteristics. Inertia and stiffness effects of the system and gaps between piping and the restraints must be included.

If the snubbers or other seismic restraints are included in the piping model they should be modeled with the same stiffness used in the seismic analysis of the pipe. However, credit for seismic restraints cannot be taken if the applied load exceeds the Level D rating.

The pipe whip restraints are modeled the same as for the simplified model described in Subsection 3J.4.2.1. For piping designed with the GE U-Bar pipe whip restraints, the selected size and dimensions, and the resulting force-deflection and elastic/plastic stiffness is first determined according to the procedure previously defined in Section 3J.3.

3J.4.3.2 Dynamic Analysis using Detail Piping Model

The pipe break nonlinear time-history analysis can be performed by ANSYS or other NRC approved non-linear computer programs. The force time histories acting at the break location and in each of the segments of the ruptured pipe are determined according to the criteria defined in ANS 58.2. The time step used in the analysis must be sufficiently short to obtain convergence of the solution. (GE has shown that for a rupture of the main steam pipe a time step of 0.001 second is adequate for convergence.) The analysis must not stop until the peaks of the dynamic load and the pipe response are over.

The primary acceptance criteria are:

- The piping stresses between the primary containment isolation valves are within the allowable limits specified in Subsection 3.6.2.1.
- The pipe whip restraint loads and displacements due to the postulated break are within the design limits.
- Specified allowable loads on safety-related valves or equipment to which the ruptured piping is attached are not exceeded.

3J.5 JET IMPINGEMENT ON SAFETY-RELATED PIPING

Postulated pipe ruptures result in a jet of fluid emanating from the rupture point. Safety-related systems and components require protection if they are not designed to withstand the results of the impingement of this jet. Subsection 3.6.2.3.1 provides the criteria and procedure for:

(1) defining the jet shape and direction;

(2) defining the jet impingement load, temperature and impingement location; and

(3) analysis to determine effects of jet impingement on safety-related equipment.

The paragraphs below provide some additional criteria and procedure for the analysis required to determine the effects of jet impingement on piping.

- Jet impingement is a faulted load and the primary stresses it produces in the piping must be combined with the stresses caused by SSE to meet the faulted stress limits for the designated ASME class of piping.
- If a pipe is subjected to more than one jet impingement load, each jet impingement load is applied independently to the piping system and the load which supplies the largest bending moment at each node is used for evaluation.
- A jet impingement load may be characterized as a two part load applied to the piping system—a dynamic portion when the applied force varies with time and a static portion which is considered steady state.

For the dynamic load portion, when static analysis methods are used, a dynamic load factor of 2 is applied. Snubbers are assumed to be activated. Stresses produced by the dynamic load portion are combined by SRSS with primary stresses produced by SSE.

For the static load portion, snubbers are not activated and stresses are combined with SSE stresses by absolute sum.

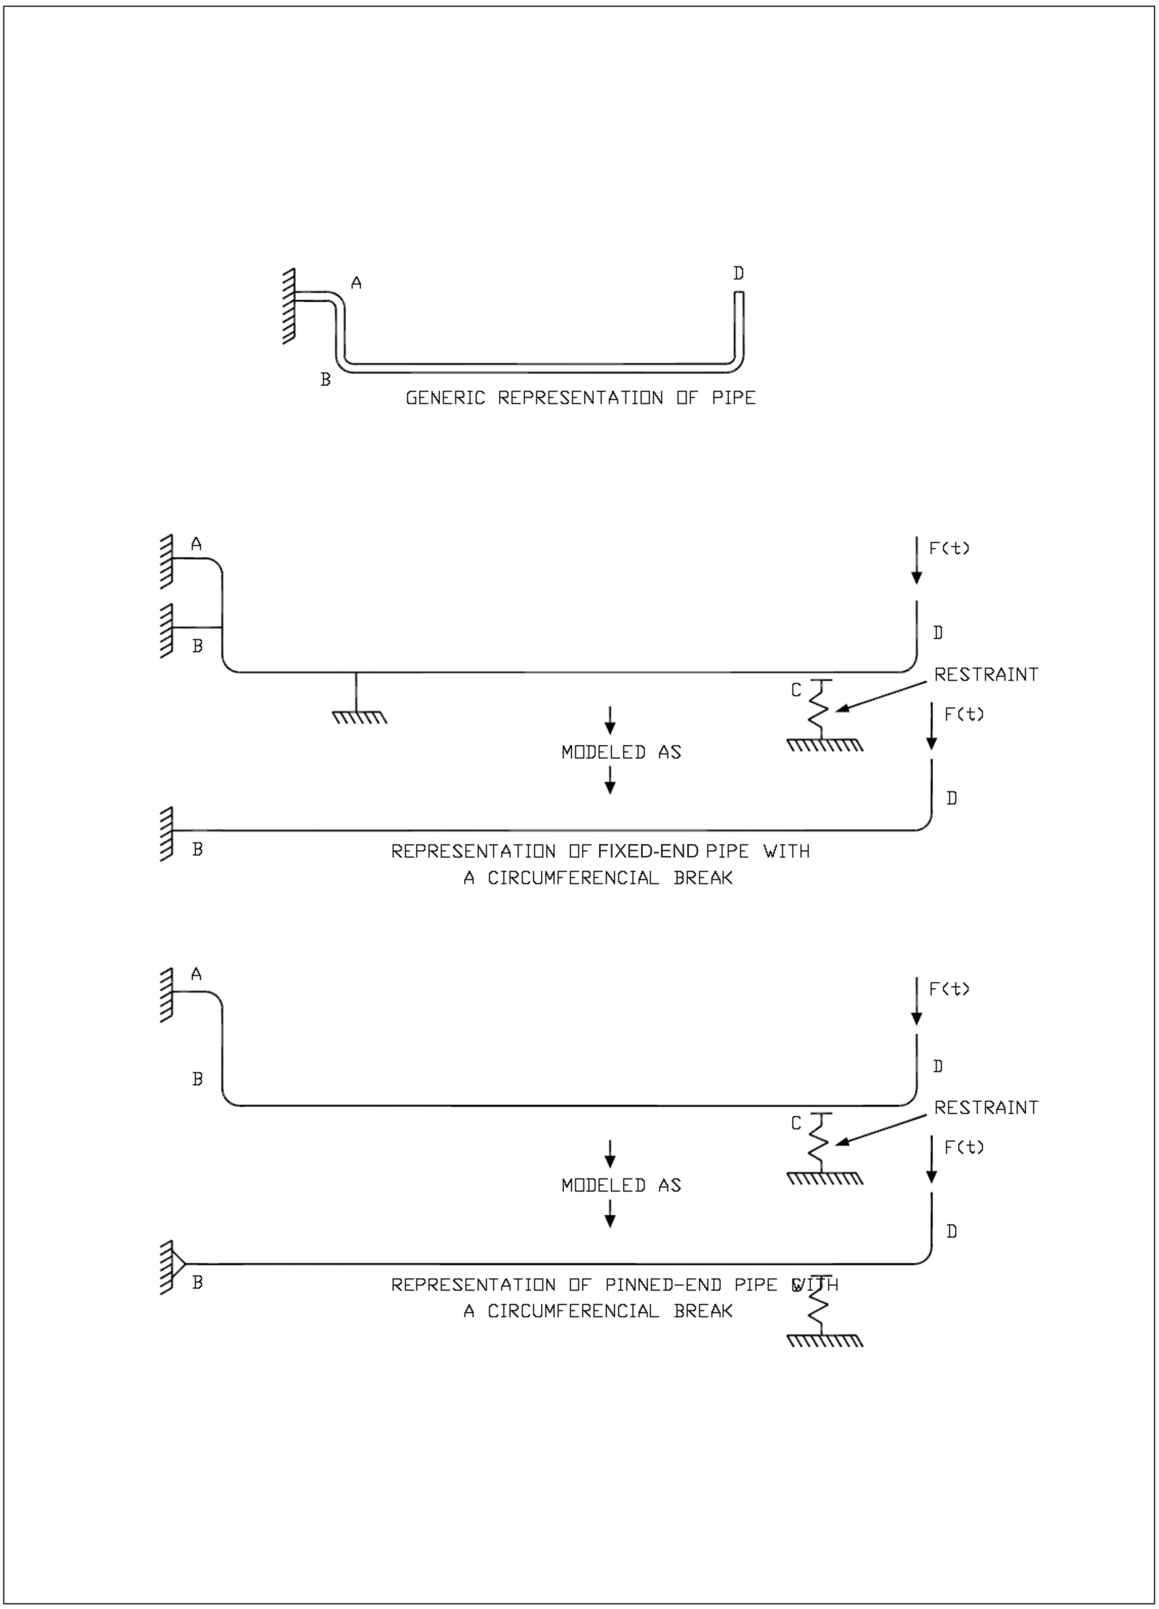

Figure 3J-1. Simplified Piping Models

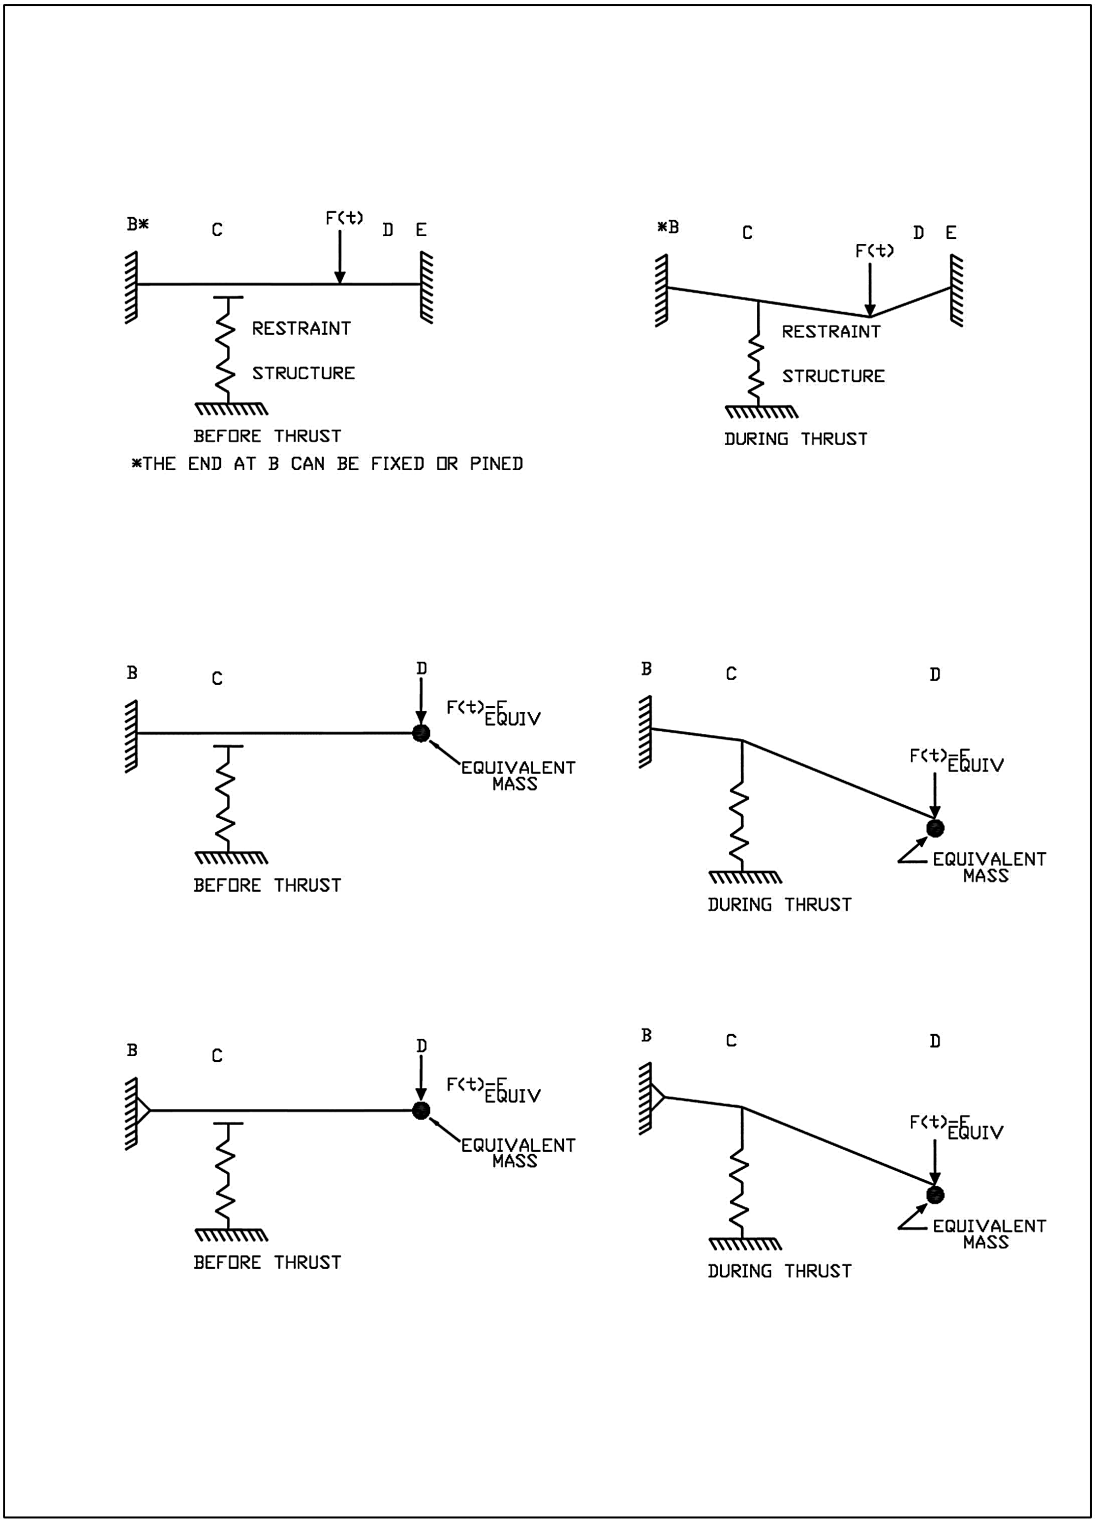

Figure 3J-2. Representation of Pipe With Both Ends Supported With a Longitudinal Break

3K. RESOLUTION OF INTERSYSTEM LOSS OF COOLANT ACCIDENT

3K.1 INTRODUCTION

An Intersystem Loss-of-Coolant-Accident (ISLOCA) is postulated to occur when a series of failures or inadvertent actions occur that allow the high pressure from one system to be applied to the low design pressure of another system, which could potentially rupture the pipe and release coolant from the reactor system pressure boundary. This may also occur within the high and low pressure portions of a single system. Future advanced light water reactor (ALWR) designs like the ESBWR are expected to reduce the possibility of a LOCA outside the containment by designing to the extent practicable all piping systems, major system components (pumps and valves), and subsystems connected to the reactor coolant pressure boundary (RCPB) to an ultimate rupture strength at least equal to the full RCPB pressure. The general Ultimate Rupture Strength (URS) criteria was recommended by the Reference 1 and the NRC Staff recommended specific ultimate rupture strength design characteristics by Reference 2.

3K.2 REGULATORY POSITIONS

In SECY-90-016 and SECY-93-087 (References 3 and 4), the NRC staff resolved the ISLOCA issue for advanced light water reactor plants by requiring that low-pressure piping systems that interface with the reactor coolant pressure boundary be designed to withstand reactor pressure to the extent practicable. However, the staff believes that for those systems that have not been designed to withstand full reactor pressure, evolutionary ALWRs should provide (1) the capability for leak testing the pressure isolation valves, (2) valve position indication that is available in the control room when isolation valve operators are de-energized and (3) high-pressure alarms to warn main control room operators when rising reactor pressure approaches the design pressure of attached low-pressure systems or when both isolation valves are not closed. The staff noted that for some low-pressure systems attached to the RCPB, it may not be practical or necessary to provide a higher system ultimate pressure capability for the entire low-pressure connected system. The staff will evaluate such exceptions on a case-by-case basis during specific design certification reviews.

GE provided a proposed implementation of the issue resolution for the Advanced Boiling Water Reactor (ABWR) in Reference 5 and again in Reference 6. The staff in the Civil Engineering and Geosciences Branch of the Division of Engineering completed its evaluation of the Reference 5 proposal. Specifically, as reported by Reference 2 and summarized below, the staff has evaluated the minimum pressure for which low-pressure systems should be designed to ensure reasonable protection against burst failure should the low-pressure system be subjected to full RCPB pressure.

The design pressure for the low-pressure piping systems that interface with the RCPB should be equal to 0.4 times the normal operating RCPB pressure, the minimum wall thickness of low-pressure piping should be no less than that of a standard weight pipe, and that Class 300 valves are adequate. The design is to be in accordance with the ASME Boiler and Pressure Vessel Code, Section III, Subarticle NC/ND-3600. Furthermore, the staff will continue to require periodic surveillance and leak rate testing of the pressure isolation valves via Technical Specifications, as a part of the ISI program.

The periodic surveillance and leak rate testing requirements for high-pressure to low-pressure isolation valves are not applicable to the ESBWR, because, as shown in this appendix, the ESBWR design does not contain a pressure isolation valve between the reactor coolant pressure boundary and a low pressure piping system.

3K.3 BOUNDARY LIMITS OF ULTIMATE RUPTURE STRENGTH

Guidance given by Reference 3 provides provision for applying practical considerations for the extent to which systems are upgraded to the ultimate rupture strength design pressure. The following items form the basis of what constitutes practicality and set forth the test of practicality used to establish the boundary limits of ultimate rupture strength for the ESBWR:

- It is impractical to consider a disruptive open flow path from reactor pressure to a low pressure sink. A key assumption to understanding the establishment of the boundary limits from this practicality basis is that only static pressure conditions are considered. Static conditions are assumed when the valve adjacent to a low pressure sink remains closed. Thus, the dynamic pressurization effects accompanied by violent high flow transients and temperature escalations which would occur if the full RCPB pressure was connected directly to the low pressure sink, are precluded. As a consequence, the furthest downstream valve in such a path is assumed closed, so that essentially all of the static reactor coolant system pressure is contained by the piping in the ultimate rupture strength upgraded region.
- It is impractical to design or construct large tank structures to the ultimate rupture strength design pressure that are vented to atmosphere and have a low design pressure.
- It is impractical to design piping systems that are connected to low pressure sink features to the ultimate rupture strength design pressure when the piping is always locked open to a low pressure sink by locked open valves. These piping sections are extensions of the low pressure sink and need no greater design pressure than the low pressure sink to which they are connected.

3K.4 EVALUATION PROCEDURE

The pressures of each system piping boundary on the ESBWR system drawings were reviewed to identify where changes were needed to provide ultimate rupture strength protection. Where low pressure piping interfaces with higher pressure piping connected to piping with reactor coolant at reactor pressure, design pressure values are at least rated to the ultimate rupture strength design pressure. The low pressure piping boundaries were upgraded to ultimate rupture strength pressures and extend to the last closed valve connected to piping interfacing a low pressure sink.

3K.5 SYSTEMS EVALUATED

The following systems, interfacing directly with the RCPB, were evaluated.

- Control Rod Drive (CRD) system — Section 4.6
- Standby Liquid Control (SLC) system — Section 9.3
- Reactor Water Cleanup/Shutdown Cooling (RWCU/SDC) system — Section 5.4

- Fuel and Auxiliary Pools Cooling System (FAPCS) Section 9.1
- Nuclear Boiler System (NBS) Section 5.1
- Condensate and Feedwater System (C&FS) Section 10.4

Attachment 3KA contains a system-by-system evaluation of potential reactor pressure application to piping and components, discussing the ultimate rupture strength boundary and listing the upgraded components. For some systems, certain regions of piping and components not upgraded are also listed.

3K.6 PIPING DESIGN PRESSURE FOR ULTIMATE RUPTURE STRENGTH COMPLIANCE

Guidelines for ultimate rupture strength compliance were established by Reference 2, which concluded that for the ESBWR:

- The design pressure for the low-pressure piping systems that interface with the RCPB pressure boundary should be equal to 0.4 times the normal operating RCPB pressure, and
- The minimum wall thickness of the low-pressure piping should be no less than that of a standard weight pipe.

3K.7 APPLICABILITY OF ULTIMATE RUPTURE STRENGTH NON-PIPING COMPONENTS

Reference 2 also provided the NRC Staff's position that:

(1) The remaining components in the low-pressure systems should also be designed to a design pressure of 0.4 times the normal operating reactor pressure. This is shown in the DCD by revised boundary symbols on system design drawings, which includes the piping and components associated with the boundary symbols. A stated parameter (e.g., design pressure) of a boundary symbol on the system design drawing applies to the piping and components that extend away from the boundary symbol, including along any branch line, until another boundary symbol occurs on the drawing. The components include flanges, and pump seals, etc.

(2) A Class 300 valve is adequate for ensuring the pressure of the low-pressure piping system under full reactor pressure. The rated working pressure for Class 300 valves varies widely depending on material and temperature (ASME/ANSI B16.34).

3K.8 RESULTS

The results of this work are incorporated into the ESBWR system drawings.

3K.9 VALVE MISALIGNMENT DUE TO OPERATOR ERROR

The ESBWR design with the ISLOCA ultimate rupture strength applied for the boundary described by this appendix and its attachment, has extended the increased design pressure (ultimate rupture strength) over the full extent of regions that could potentially experience reactor pressure, so that operator misaligned valves will not expose piping to reactor pressure not designed to the ultimate rupture strength pressure.

3K.10 SUMMARY

Based on the NRC staff's new guidance cited in References 1 through 4, the ESBWR is in full compliance. For ISLOCA considerations, a design pressure of at least the ultimate rupture strength design pressure and pipe having a minimum wall thickness equal to standard grade has been provided as an adequate margin with respect to the full reactor operating pressure, by applying the guidance recommended by Reference 2. This design pressure was applied to low pressure piping at the applicable boundary symbols on the system drawings, therefore imposing the requirement on the associated piping, valves, pumps, tanks, instrumentation and other equipment shown between boundary symbols. Notes were added to each ultimate rupture strength upgraded drawing, requiring pipe to have a minimum wall thickness equal to standard grade and requiring valves with a design pressure of at least the ultimate rupture strength design pressure to be a minimum of Class 300.

3K.11 REFERENCES

3K-1 USNRC, Dino Scaletti, NRC, to Patrick Marriott, "GE, Identification of New Issues for the General Electric Company Advanced Boiling Water Reactor Review," September 6, 1991.

3K-2 Chester Poslusny, NRC, to Patrick Marriott, "GE, Preliminary Evaluation of the Resolution of the Intersystem Loss-of-Coolant Accident (ISLOCA) Issue for the Advanced Boiling Water Reactor (ABWR) - Design Pressure for Low-Pressure Systems," December 2, 1992, Docket No. 52-001.

3K-3 James M. Taylor, NRC, to The Commissioners, SECY-90-016, "Evolutionary Light Water Reactor (LWR) Certification Issues and Their Relationship to Current Regulatory Requirements," January 12, 1990.

3K-4 James M. Taylor, NRC, to The Commissioners, SECY-93-087, "Policy, Technical, and Licensing Issues Pertaining to Evolutionary and Advanced Light-Water Reactor (ALWR) Designs," April 2, l993.

3K-5 Jack Fox, GE, to Chet Poslusny, NRC, "Proposed Resolution of ISLOCA Issue for ABWR," October 8, 1992.

3K-6 Jack Fox, GE, to Chet Poslusny, NRC, "Resolution of Intersystem Loss of Coolant Accident for ABWR," April 30, 1993.

ATTACHMENT 3KA. ULTIMATE RUPTURE STRENGTH SYSTEM BOUNDARY EVALUATION

3KA.1 CONTROL ROD DRIVE SYSTEM

3KA.1.1 System URS Boundary Description

The Control Rod Drive (CRD) system interfaces with the reactor in a manner that makes low pressure piping over pressurization very unlikely. The minimum failure path from the reactor to the low pressure piping has three check valves in series and the second check valve is 12.7 mm in size. This path is from the purge flow channels of the CRD, out through the first check valve in the CRD housing, through the purge supply line that has the second 12.7 mm check valve, and to the pump discharge check valve. An alternate path through the accumulator charging line has additionally the normally closed scram valve, and this path is less likely for failure, therefore not considered. The path from the pump discharge, back through the pump to its suction, and back through the suction lines to the condensate storage tank or the condensate feedwater source is an open path. The open pump suction pipeline is a minimum 100 mm diameter through the pump suction filters in the normal mode of operation, and 200 mm diameter when the suction filter bypass lines are open during the reactor high pressure makeup mode of operation. The CRD pumps run continuously while the reactor is at operating pressure, which prevents reactor pressure from reaching the low pressure piping except for the unlikely case when both CRD pumps have failed. Therefore, an ISLOCA condition from a 12.7 mm diameter source could only occur when three check valves in series fail open at the same time both CRD pumps have failed. The ISLOCA guidelines do not provide credit for this rare condition, so the low pressure piping has been upgraded to the URS design criteria over the entire low pressure piping region of the CRD system. The suction path through the Condensate Storage and Transfer System (CS&TS) to the Condensate Storage Tank (CST) from the CRD interface is an open path whose design pressure was not upgraded to URS design criteria. The piping design of the primary suction path through the Condensate and Feedwater System has not been established, but if a check valve is in the path, the design pressure up to and including the check valve will be the URS design pressure.

The normal key assumption, as stated in the Boundary Limits in Section 3K.3 above, that the valve adjacent to a low pressure sink remains closed, means that the pump discharge check valve remains closed as a given. However, this valve is in the high pressure piping, which is unique for the CRD system according to this accepted line of reasoning. The low pressure piping would not have to be upgraded because it would not experience the high reactor pressure. However, the low-pressure piping has been designed to the URS design pressure based on the guidance that states "for all interfacing systems and components which do not meet the full URS criteria, justification is required, which must include engineering feasibility; not solely a risk benefit analysis." Designing the low-pressure piping to the URS design pressure is feasible and was done.

3KA.1.2 Downstream Interfaces

Other systems are listed below that interface with the CRD system and could possibly be exposed to reactor pressure. A description of the interface location and a statement of its applicability to ISLOCA are given.

- RWCU/SDC system at the output of the CRD pump discharge filter units. The RWCU/SDC design pressure exceeds the URS design pressure without upgrade.
- NBS at the output of the CRD pump discharge filter units. The NBS design pressure exceeds the URS design pressure without upgrade.
- CS&TS provides an alternate source of water for the CRD system if the C&FS is not available. Its interfaces with the CRD system are located at pump suction from and system return to the CST. This line cannot be pressurized because of the open communication to the CST, and the CST is vented to atmosphere. There is no source to pressurize the CS&TS line because of closed pump discharge check valves in the CRD URS region.
- C&FS provides a source of water for the CRD pump suction from the turbine building condensate supply. This system is expected to be an open path to a large source similar to CS&TS. Because of the open path, the piping was not considered practical for upgrade to the URS design pressure.
- Process Sampling System (PSS) at the output of the CRD pump discharge filter units. The PSS design pressure exceeds the URS design pressure without upgrade.

3KA.1.3 Low-Pressure Piping Systems and Components Designed to URS Pressure

The following is a listing of low-pressure piping systems and components within CRD that are designed to the minimum URS design pressure of 2.82 MPaG based on the ISLOCA considerations outlined in Appendix 3K.

Pipeline/Component Description (see Figure 4.6-8):

CRD Pump Suction Piping and Associated Components

3KA.2 STANDBY LIQUID CONTROL SYSTEM

3KA.2.1 System URS Boundary Description

The SLC system is a high pressure system which injects enriched sodium pentaborate solution inside the reactor through normally closed squib valves. The leakage path includes two 80 mm check valves in series in addition to a redundant set of normally closed pyrotechnic-type squib valves. The entire SLC system is designed for pressure higher than reactor pressure except the low pressure section from piston pump suction to open mixing drum used for preparation of sodium pentaborate solution. Instrumentation, pressure relief, drain piping and valving are designed to higher than URS design criteria to reduce the level of pressure challenge to these components. The system does not require upgrade to URS design pressure.

3KA.2.2 Downstream interfaces

The SLC system has no further downstream system interfaces that could possibly be exposed to reactor pressure.

3KA.2.3 Low Pressure Piping Systems and Components Designed to URS Pressure

None.

3KA.3 REACTOR WATER CLEANUP/SHUTDOWN COOLING SYSTEM

3KA.3.1 System URS Boundary Description

The RWCU/SDC system is a high pressure system that is designed above the URS pressure with the following exception. Low pressure piping connected to the condenser and the liquid waste management system are provided at the downstream of the overboarding line isolation valves. On the upstream side of the isolation valves, there is a pressure reducing control valve that reduces the pressure before the flow enters the low pressure piping.

3KA.3.2 Downstream Interfaces

Other systems are listed below that interface with RWCU/SDC system and could possibly be exposed to reactor pressure. A description of the interface location and a statement of its applicability to ISLOCA are given.

- FAPCS interfacing piping from the reactor well at the upstream of the Train B of RWCU/SDC system non-regenerative heat exchanger has two locked closed isolation valves in series and the piping provides an open free path to reactor well which is an atmospheric pressure pool.
- FAPCS Low Pressure Coolant Injection (LPCI) interfacing piping with Train B of RWCU/SDC system return piping to Feedwater Line A is designed to a pressure that is above the URS pressure.
- CRD system interfacing piping with Train A of RWCU/SDC system return piping to Feedwater Line B is designed to a pressure that is above the URS pressure.

3KA.3.3 Low-Pressure Piping Systems and Components Designed to URS Pressure

The RWCU/SDC system low pressure piping connected at the downstream side of the overboarding line isolation valves is designed to pressure so that the stresses do not exceed the allowable stresses if the piping is subjected to full reactor pressure.

3KA.4 FUEL AND AUXILIARY POOLS COOLING SYSTEM

3KA.4.1 System URS Boundary Description

FAPCS is a low pressure piping system. Its LPCI line is connected to RWCU/SDC system Loop B discharge line, which has an interface with reactor coolant pressure boundary via the Feedwater Loop A discharge line [Figure 9.1-1]. During reactor power operation, an unisolated break outside the reactor coolant pressure boundary could lead to an ISLOCA with the release of reactor coolant from the reactor system pressure boundary. In the FAPCS case, it would require multiple failures before a LOCA could occur, i.e., a break in the FAPCS piping plus failures of the Feedwater line check valves, which maintain the reactor coolant pressure boundary.

3KA.4.2 Downstream Interfaces

The following design features are provided to the interface between the high and low pressure interfaces to prevent an intersystem LOCA from occurring in FAPCS piping:

- Normally closed isolation valves consisting of an air-operated check valve and a motor-operated gate valve are provided on the LPCI line to separate the low pressure FAPCS piping from the high pressure condition in the RWCU/SDC pipe during reactor power operation.
- Valve position lights are provided to the operator in the main control room (MCR) to confirm these isolation valves in the closed positions.
- The isolation valves are provided with a reactor pressure interlock that closes these valves and prevents them from opening whenever a high reactor pressure signal from the NBS is present. Reactor pressure signals ensure high reliability that the isolation valves remain closed.
- The FAPCS LPCI pipe and components between its interface with RWCU/SDC system and the motor-operated gate valve, including the gate valve are Quality Group B components designed to above URS pressure.

3KA.4.3 Low-Pressure Piping Systems and Components Designed to URS Pressure

The low pressure side of LPCI line and the rest of FAPCS piping are not required to be designed to the URS pressure because they are properly protected by the interlock closed isolation valves described above and by a relief valve installed on the LPCI line that protects the line from the overpressure condition, in case of leakage from the RWCU/SDC system side through the isolation valves.

3KA.5 NUCLEAR BOILER SYSTEM

3KA.5.1 System URS Boundary Description

The Main Steam (MS) and Feedwater piping and instrumentation are designed for reactor pressure and do not require upgrading to URS design pressure.

3KA.5.2 Downstream Interfaces

Other systems are listed below that interface with MS and could possibly be exposed to reactor pressure. A description of the interface location and a statement of its applicability to ISLOCA are given.

- The outlet of the CRD pump discharge filter units provide flow to the NBS.
- The CRD design pressure exceeds the URS design pressure without upgrade.
- RWCU/SDC provides high pressure return flow to the Feedwater lines. The RWCU/SDC design pressure exceeds the URS design pressure without upgrade.
- The Isolation Condenser system connects to a piping stub that connects the Depressurization Valves (DPVs) to the RPV, and also there are IC vent lines that connect to the main steam lines. The IC design pressure exceeds the URS design pressure without upgrade.

3KA.5.3 Low-Pressure Piping Systems and Components Designed to URS Pressure

None.

3KA.6 CONDENSATE AND FEEDWATER SYSTEM

3KA.6.1 System URS Boundary Description

The feedwater subsystem of the C&FS provides high pressure feedwater to the reactor. The feedwater subsystem is designed for high pressure except for the feedwater pump suction and the outlet of the feedwater cleanup valve.

In the feedwater pump, the transition to low pressure occurs from the feedwater pump suction into the direct contact feedwater heater (feedwater tank). The feedwater tank is a low pressure sink. The last closed valve in the path from the reactor is the feedwater pump discharge check valve. The piping to the feedwater pump suction can remain below the URS design pressure because it connects to the low pressure heat sink feedwater tank. The maintenance block valves in the feedwater pump suction lines were upgraded to a LOCKED OPEN status.

In the feedwater cleanup control valve, the transition to low pressure occurs from the feedwater cleanup control valve outlet connection into the condenser shell (hotwell). The hotwell is a low pressure sink. The last closed valve in the path from the reactor in the feedwater cleanup control valve is the normally closed block valve. The piping from the feedwater cleanup control valve to the condenser can remain below the URS design pressure because it connects to the low pressure heat sink hotwell.

The Condensate subsystem of the C&FS provides condensate to the feedwater tank, and the condensate subsystem is designed for a pressure higher than the feedwater tank, except for the condensate pump suction. The high pressure design includes the condensate polishing (hollow fiber filters and demineralizers) units and the feedwater bypass valve. The transition to low pressure occurs from the condensate suction into the High Pressure (HP) condenser shell (hotwell, which is a low pressure sink). The last closed valve in the path from the feedwater tank is the condensate pump discharge check valve. The piping to the condensate pump suction can remain below the feedwater tank design pressure because it connects the low pressure heat sink hotwell. The maintenance block valves in the condensate pump suction lines were upgraded to a LOCKED OPEN status.

3KA.6.2 Downstream Interfaces

None.

3KA.6.3 Low-Pressure Piping Systems and Components Designed to URS Pressure

The maintenance block valves in the condensate pump suction lines were upgraded to a LOCKED OPEN status.

3L. REACTOR INTERNALS FLOW INDUCED VIBRATION PROGRAM

3L.1 INTRODUCTION

A flow-induced vibration (FIV) testing program of the reactor internal components of the ESBWR prototype plant demonstrates that the ESBWR internals design can safely withstand expected FIV forces for reactor operating conditions up to and including 100% power and core flow. This program includes an initial evaluation phase that has the objective of demonstrating that the reactor internals are not subject to FIV issues that can lead to failures due to material fatigue, or fretting and wear issues. Throughout this part of the program, the emphasis is placed on demonstrating that the reactor components will safely operate for the design life of the plant. The results of this evaluation are shown in Reference 3L-1. The second phase of the program is focused on preparing and performing the startup test program that demonstrates through instrumentation and inspection that no FIV problems exist. This part of the program meets the requirements of Regulatory Guide 1.20 with the exception of those requirements related to preoperational testing that are not applicable to a natural circulation plant.

3L.2 REACTOR INTERNAL COMPONENTS FIV EVALUATION

The ESBWR reactor internals are part of an evolutionary Boiling Water Reactor (BWR) design, but fundamentally the components and operation of the reactor vessel and internals are very similar to past BWRs. To a large extent, the ESBWR design of the components relies heavily on the prior design of internals in operating plants to assure that new vibration issues are not introduced. Also, to assure that the flow of steam or water in the reactor vessel is comparable to prior reactors, efforts were made to maintain traditional spacing and dimensional relationships of components. A unique feature of the ESBWR, with respect to FIV, is the fact that it is a natural circulation plant where no recirculation motors exist that would create pressure pulses from the pump vanes that would travel into the reactor vessel. In previous BWR product lines, the pump vane passing frequency, that is variable with flow, typically has a maximum frequency of 120 Hz at full reactor flow. This source of excitation has caused failures in small components inside BWR reactor vessels. For the ESBWR this source of flow excitation does not exist. The design of the ESBWR reactor internals is shown in Figure 5.3-3.

3L.2.1 Evaluation Process – Part 1

The first step in the evaluation process was to establish selection criteria for reactor internal components related to susceptibility to vibration. All reactor internal components were considered as potential candidates for further evaluation. Each component is evaluated against the following selection criteria:

- Is the component safety-related?
- Is the component of a significantly different or new design compared to earlier BWRs?
- Does the component have a history of FIV-related problems?
- Is the component subjected to significantly different or new flow conditions?

Based on these criteria, the following internal component structures are considered to be candidates for additional evaluation and potential to be instrumented in the startup FIV test program:

- Steam Dryer Bank Hoods and End Plates based on history of past FIV related problems (fatigue cracking between hood and endplate).
- Steam Dryer Skirt based on history of past FIV-related problems (fatigue cracking between skirt and drain channels).
- Steam Dryer Drain Channels based on history of FIV-related problems (fatigue cracking between skirt and drain channels).
- Steam Dryer Support Ring based on history of FIV-related problems (dryer rocking) and the resulting new design features for replacement dryer designs (e.g., strengthened weld joints, castings).
- Chimney Partition Assembly based on new design features (elongated chimney shell, partition assembly, chimney restraint), potential new flow conditions, difficulty of repair in event of failure, and limited ability to change the design due to dimensional constraints.

- Chimney Head/Steam Separator assembly based on new design (flat head with beam reinforcement and elongated standpipes).
- Shroud/Chimney assembly based on new design features (discrete shroud support members and the chimney connection), potential new flow conditions and difficulty of repair in event of failure.
- Standby Liquid Control (SLC) internal piping based on new design and is safety-related.

Components that were evaluated but were not considered important for further evaluation were the following components:

- Control Rod Drive Housing (CRDHs)
- Control Rod Guide Tubes (CRGTs)
- In-Core Monitor Guide Tubes (ICMGTs)
- In-Core Monitor Housings (ICMHs)

For each of these components, the length of the components have decreased from prior BWR product lines due to the plant having shorter fuel. This increases the natural frequencies for these components and moves them well beyond the predominated frequencies measured at the prototype ABWR plant. Also, the flow velocities in the RPV bottom head region have decreased and the calculated vortex shedding frequencies are well below the natural frequencies of the components in this region.

Other components such as the top guide and core plate that are not specifically identified as candidates for the instrumentation program are basically proven by past trouble-free BWR experience, and have designs and flow conditions that are similar to prior operating BWR plants.

The results of the Part 1 evaluation are contained in Reference 3L-1.

From the components listed above, the first priority was determined to be the chimney partition assembly. This selection was made since it was a new component where only limited operating experience was available. Also, it is a structure where the geometry of the partitions places limitations on the plate thicknesses, has a long extended length, and is subject to high velocity two-phase steam flow. From this initial selection, a test and analysis program was established and the results are discussed in Subsection 3L.3.3. For this case, testing was required since no prior relevant test data was available for this component.

The steam dryer was established as the second priority. An initial analysis program was started to study the acoustic and flow effects of the ESBWR configuration in comparison to the ABWR steam dryer design. It was determined that the increase in the size of the steam dryer support ring and skirt design and the increase in steam velocity did not have any adverse effects on the steam dryer structural integrity. At the time of the initial assessment, it was also recognized that the evaluation of BWR operating plant dryer loads was an ongoing program that would need to be ultimately factored into the ESBWR steam dryer design and evaluation effort. The progress of the generic steam dryer program is now at a stage that a meaningful effort can now be planned for the ESBWR steam dryer. The detailed program that is planned is described in Section 3L.4. As a result of the advances in the understanding of dryer vibration, differential pressure loads and steam dryer design improvements, the ESBWR uses a steam dryer design patterned after the new steam dryer design developed for BWR operating plants.

3L.2.2 Evaluation Process – Part 2

The next phase of the evaluation program will be to perform additional work to demonstrate the adequacy of the remaining components where it was determined that additional evaluations were required. The objective of this phase will be to complete a more quantitative evaluation and to document the existing facts regarding the individual components. This part of the evaluation will focus on the following:

(1) Similarities and differences of the ESBWR component design configurations as compared to prior designs. In most cases the comparison design will be with ABWR components.

(2) A review of prior calculations for the components being evaluated, to establish the mode shapes and natural frequencies. Estimates of the ESBWR component natural frequencies will then be determined based on this data.

(3) Prior plant startup instrumentation data from the prototype ABWR plant will be reviewed to establish the magnitude and frequency of the measured vibration data, and to review the resulting calculated stress for the components that were instrumented.

(4) A comparison of the flow paths and characteristics of the ESBWR design will be compared to prior BWR designs where a startup vibration test program was conducted.

(5) Using the results of the above items, an assessment as to the likelihood of FIV issues will be completed and documented in a revision to Reference 3L-1. There are two potential outcomes for the components evaluated using this process. The first potential outcome is that the evaluation conclusively demonstrate that FIV will not be an issue for that component and that safety will not be adversely affected. In this case, no further evaluation is necessary. The other potential outcome is that the evaluation performed using Steps 1 through 4 is not sufficient to disposition potential FIV issues for the component. In this case, additional evaluations or instrumentation is necessary. For the components requiring further evaluation or instrumentation, no FIV issues are anticipated, and the objective is to provide additional supporting information that clearly demonstrates that FIV is not an issue.

During this phase, the process as identified in Subsection 3.9.2.3 will be followed to prepare finite element analysis models per the details shown in Subsection 3L.5.5.1, establish correlation functions based on prior instrumentation data, and apply the correlation functions to the model to determine expected stress amplitude. This information will then be used as the basis for the instrumentation in the ESBWR startup test program. It should be noted that the steam dryer and chimney have already been identified in Section 3L.2.1 for inclusion in the startup test program. The results of these evaluations will be documented in a revision to Reference 3L-1.

Because most of the reactor internal components are large durable components where there has been no history of FIV issues, no FIV issues are anticipated. Also, because it is still early in the program, there is still the opportunity to make adjustments as necessary in the component designs to make them more resistant to FIV.

3L.3 CHIMNEY PARTITION ASSEMBLY EVALUATION

3L.3.1 Design and Materials

The chimney partition assembly design consists of a bottom ring of the partition assembly that rests on and is bolted and pinned to the bottom flange of the chimney. The top ring of the partition assembly is supported against the inside of the chimney shell. The partitions are a grid of square structures, each of which encompasses 16 fuel assemblies. The partitions are fabricated using austenitic stainless steel plate that is full length welded at the junctions of the partitions. The austenitic stainless steel material has a 0.02% maximum carbon content to resist Intergranular Stress Corrosion Cracking (IGSCC). The chimney structure that houses the partition structure is cylindrical, similar to the core shroud. A sketch of the chimney and partition assembly is shown in Figure 3L-1. Because the chimney has structural characteristics similar to the shroud, this component is considered under the generic reactor internals vibration program, and the partition assembly is considered to be the unique component that requires special vibration consideration.

3L.3.2 Prior Operating Experience

Prior to the ESBWR design, only one other BWR plant had operating experience with this chimney design. This was the BWR-1 Dodewaard plant, which did not have a vibration instrumentation program. For this plant, the partition size was a square configuration that encompassed four fuel assemblies within the cell, which is ¼ the dimension of the ESBWR partitions. Also, the height was approximately ½ the length of the ESBWR design. The partition thickness was 3 mm (0.125 in) as compared to 9 mm for ESBWR, and the partitions were welded together using intermittent fillet welds as compared to full-length welds for ESBWR. Although the partitions were not instrumented, the plant operated for almost 30 years without any issues related to the chimney structure. Since the design of the ESBWR chimney partitions is more robust, this Dodewaard operational history provides additional assurance that the ESBWR will not have FIV issues.

3L.3.3 Testing and Two-phase Flow Analysis

For the ESBWR, the chimney lattice partition assembly constitutes a structure that needs to have a unique vibration evaluation program as part of the ESBWR reactor internals. In order to assess its capability to maintain structural integrity under plant operating conditions, a flow induced vibration evaluation has been performed in which the fluctuating fluid force acting on the partition plates has been evaluated by a combination of scale tests and two-phase flow analysis.

The test scope comprised both 1/6-scale (100 mm × 100 mm) and 1/12-scale (50 mm × 50 mm) air and water two-phase flow testing of a single chimney cell. The superficial velocities of the gas and liquid components of the two-phase flow were adjusted to be consistent with ESBWR values to simulate the actual two-phase flow pattern. Different inlet flow conditions were used to investigate the influence of inlet mixing within the partition to simulate different power conditions. Pressure fluctuation was measured on the inner surface of the partition wall with pressure transducers.

The results of the scale testing were extrapolated by a two-phase flow analysis to determine the characteristics of the pressure fluctuations acting on the partition wall of a full size cell in steam-

water conditions. This extrapolation included the use of a 1/12 and full scale analytical model. The resulting peak-to-peak pressure fluctuation was determined to be 15 kPa at a peak frequency of approximately 2 Hz.

A structural analysis of the chimney and partition design was then conducted using finite element methods. First, an eigenvalue analysis determined that the lowest natural frequency of the chimney structure is approximately 56 Hz. This was sufficiently greater than the predominant frequency of pressure fluctuation determined by testing (2 Hz) that a static analysis of the structure was concluded to be proper. Based on the results of that static analysis, a maximum stress of 41 MPa was calculated near the edge of the partition plate joint. This stress value is bounded by the allowable vibration peak stress amplitude of 68.9 MPa specified in Subsection 3.9.2.3.

3L.4 STEAM DRYER EVALUATION PROGRAM

3L.4.1 Steam Dryer Design and Performance

The ESBWR steam dryer is designed using modules of dryer vanes enclosed in a housing to make up the steam dryer assembly. The modules or subassemblies of dryer vanes, called dryer units, are arranged in six parallel rows called banks. The dryer banks are attached to an upper support ring, which is supported by steam dryer support brackets that are welded attachments to the reactor pressure vessel (RPV). The steam dryer assembly does not physically connect to the shroud head and steam separator assembly and does not have a direct connection with the core support or shroud. A cylindrical skirt attaches to the upper support ring and will projects downward to form a water seal around the array of steam separators. Normal operating water level is approximately mid-height on the dryer skirt.

Wet steam from the core flows upward from the steam separators into an inlet header, horizontally through the dryer vanes and the outlet side perforated plates, vertically in the outlet header and out into the RPV dome. Dry steam then exits the RPV through the steam outlet nozzles. Moisture (liquid) is separated from the steam by the vane surface and the hooks attached to the vanes. The captured moisture flows downward, under the force of gravity, to a collection trough that carries the liquid flow to vertical drain channels. The liquid flows by gravity through the vertical drain channels to the lower end of the skirt where the flow exists below the normal water level. The prototype for the ESBWR steam dryer is the replacement dryer recently tested and installed in several BWR/3 plants that had experienced high pressure loads under extended power uprate operating conditions. These loads were characterized by an abnormally high pressure tone at approximately 155 Hz that emanated from an acoustic resonance in one or more of the SRV standpipes. The replacement dryer was specifically designed to withstand the flow-induced vibration and acoustic resonance loading that led to fatigue failures in the dryers for these plants. Table 3L-1 provides a comparison between major configuration parameters of the ESBWR and the prototype replacement steam dryer.

During normal refueling outages, the ESBWR steam dryer is supported from the floor of the equipment pool by the lower support ring that is located at the bottom edge of the skirt. The steam dryer is installed and removed from the RPV by the reactor building overhead crane. A steam separator and dryer lifting device, which attaches to four steam dryer lifting rod eyes, is used for lifting the dryer. Guide rods in the RPV are used to aid dryer installation and removal. Upper and lower guides on the dryer assembly are used to interface with the guide rods. The ESBWR steam dryer assembly is shown in Figure 3L-2.

3L.4.2 Materials and Fabrication

Current industry practices are applied to the materials and fabrication of the ESBWR steam dryer. The steam dryer materials are selected to be resistant to corrosion and stress corrosion cracking in the BWR steam/water environment. New industry dryers are currently constructed from wrought 300 series stainless steel and Grade CF3 stainless steel castings. Except for the dryer vane material, the maximum carbon content of the wrought stainless steel is limited to 0.02% and the maximum hardness of wrought 300 series stainless steel is limited to Rockwell B92. Fabrication process controls are applied to minimize the degradation of material properties by forming, cold working, etc. Susceptibility to stress corrosion cracking is avoided by careful

control of the solution heat treatment, sensitization testing and testing for intergranular attack (IGA).

3L.4.3 Load Combinations

Design loads for the steam dryer are based on evaluation of the ASME load combinations provided in Table 3.9-2 except that the load definitions that pertain to the steam dryer are modified as shown in Table 3L-2. These load combinations consist of dryer deadweight loads, static and fluctuating differential pressure loads (including turbulent and acoustic sources), seismic, thermal, and transient acoustic and fluid impact loads.

3L.4.4 Fluid Loads on the Dryer

During normal operation, the dryer experiences a static differential pressure loading across the dryer plates resulting from the pressure drop of the steam flow across the vane banks. The dryer also experiences fluctuating pressure loads resulting from turbulent flow across the dryer and acoustic sources in the vessel and main steamlines. During transient and accident events, the dryer may also experience acoustic and flow impact loads that result from system actions (e.g., turbine stop valve closure) or from the system response (e.g., the two-phase level swell following a main steamline break).

Of particular interest are the fluctuating pressure loads that act on the dryer during normal operation that has led to fatigue damage in previous dryer designs. Scale model testing has identified the likely sources of fluctuating pressure loading acting on the steam dryer. The results of this testing showed that the fluctuating pressure load frequency spectrum can be divided into four regions based on the postulated source of the loading (these frequency ranges are approximate).

- **0-10 Hz:** The pressure loads in this frequency range are dominated by the fundamental main steamline piping acoustics. The source of these pressure loads is believed to be turbulence in the main steamline or vortex shedding in steam dome.
- **10-30 Hz:** The source of the pressure loads in this frequency range may be due to a near-steady-state vortex on the outer hood, penetrating into the Main Steam Line Nozzle. The frequency characteristics of this pressure loading may be governed by harmonics of the main steamline acoustics.
- **>30 Hz:** The lowest steam plenum acoustic modes are located in this frequency range. The dominant excitation is due to broadband turbulent sources located in main steamlines but the acoustic modes may also be excited by sources in the vessel. The plenum acoustic modes have a very high amplification effect on pressure oscillations in this frequency range. The lower frequency vessel acoustic modes exhibit the most significant response to the turbulent excitation present in the system. Higher frequency vessel acoustics exist but are not significantly excited except as discussed below.
- **120-200 Hz:** Strong narrow band pressure loads in this frequency range are caused by acoustic resonances in safety and relief valve branch lines attached to the main steamlines. Higher frequency steam plenum acoustic modes can be excited if the vessel is acoustically coupled to the branch line. The ESBWR SRV standpipe design is intended to reduce or eliminate acoustic resonances in these branch lines. It should be

noted that the 120-200 Hz frequency range is approximate and is dependent on the SRV standpipe design. The frequency range monitored in the FIV test program will be adjusted to bound the range of frequencies determined for the final design.

A detailed description of the acoustic load definition process for the ESBWR steam dryer is provided in Reference 3L-5. The ESBWR steam dryer acoustic load definition is based on the load definitions based on in-plant measurements that were developed for the steam dryer structural analyses in several extended power uprates. These load definitions provide a fine-mesh array of pressure time histories that are consistent with the structural finite element model nodalization. Multiple load definitions are used in the ESBWR dryer analysis in order to evaluate the dryer response over a wide frequency range. These load definitions include the limiting low and high frequency loads observed in plants with instrumented steam dryers. Based on the plant unique plant configurations (e.g., dead legs in the main steam lines) and operating conditions (e.g., high steam line flow velocities) in these instrumented plants, the load definition from these plants are expected to provide a robust load definition for the ESBWR. The amplitude of the in-plant load definitions are scaled up to the ESBWR operating conditions based on a ratio of the square of the main steam line flow velocities. In the vessel acoustic mode frequency range, the frequencies are also scaled to the ESBWR based on a ratio of the vessel diameters (a frequency shift of approximatey 11%). The load definitions developed for the ESBWR will also be benchmarked against the instrumented dryer measurements taken during startup testing for the lead ABWR. The ESBWR and ABWR have the same vessel diameter and steam dome dimensions, vessel steam nozzle design (with flow restricting venture), and similar main steam line layouts; therefore, it is expected that the frequency content of the ESBWR dryer pressure loads will be similar to those measured on the ABWR.

3L.4.5 Structural Evaluation

A finite element analysis (FEA) is performed to confirm that the ESBWR steam dryer is structurally acceptable for operation. The FEA uses the load definitions based on in-plant measurements described in Subsection 3L.4.4. The FEA is performed using a whole dryer analysis model of the ESBWR steam dryer to determine the most highly stressed locations. The FEA consists of time history dynamic analyses for the load combinations identified in Table 3.9-2. If required, locations of high stress identified in the whole dryer analysis are further evaluated using solid finite element models to more accurately predict stresses at these locations. The analysis also confirms that the RPV steam dryer support lugs accommodate the predicted dryer loads under normal operation and transient and accident conditions. (Also see Subsection 3L.5.5.1.3.)

The structural evaluation of the ESBWR steam dryer design is presented in (Reference 3L-6).

3L.4.6 Instrumentation and Startup Testing

The ESBWR steam dryer is instrumented with temporary vibration sensors to obtain flow induced vibration data during power operation. The primary function of this vibration measurement program is to confirm the actual pressure loading on the dryer during power operation is consistent with the pressure loading assumed in the structural fatigue evaluation and to verify that the new steam dryer can adequately withstand flow induced vibration forces for extended period as designed. The detailed objectives are as follows:

- Determine the dryer as-built modal parameters: This is achieved by impact (hammer) testing the dryer components. The results yield natural frequencies, mode shapes and damping of the dryer components for the as-built dryer. These results are used to verify portions of the analytical model of the dryer.
- Confirm the pressure loading: In order to confirm the pressure loading on the dryer due to turbulence, acoustics and other sources, dynamic pressure sensors are installed on the dryer. These measurements will provide the actual pressure loading on the dryer under various operating conditions.
- Verify the new dryer design: Based on past knowledge gained from different dryers, as well as information gleaned from analysis of the new dryer design, selected areas of the dryer are instrumented with strain gages and accelerometers to measure vibratory stresses and displacements on the dryer during power operation. The measured strain values are compared with the allowable values (acceptance criteria) obtained from the analytical model to confirm that the dryer alternating stresses are within allowable limits.

The objective of the steam dryer hammer test is to identify the as-built frequencies and mode shapes of several key components of the steam dryer at ambient conditions. Different components of the steam dryer have different frequencies and mode shapes associated with them. The areas of interest are the drain channel, the outer hood panel, the inner hood panel, the side panel, tie bars and the skirt. These results are used to verify portions of the finite element model of the dryer.

The concern is that local natural frequencies may coincide with existing forcing functions to cause resonance conditions. The resonance could cause high stresses to occur in localized areas of the steam dryer. A finite element modal analysis can calculate the frequency and mode shape of a component, but they are only ideal approximations to the real values due to variations such as plate thickness, welding, and residual stresses that affect the assumed boundary conditions in the finite element model. The mode shapes and frequencies determined by the hammer test are used to validate the finite element modal analysis and determine the uncertainty in the finite element model predictions of the modal response.

The impact hammer test is performed inside the plant with the dryer inside the dryer/separator pool. The tests are performed with dryer resting on simulated dryer support blocks similar to the way the dryer is seated inside the reactor vessel. The hammer test is performed when the installation of the sensors for in-reactor vibration measurement is completed.

Two types of impact tests are performed on the dryer: a (1) Dry hammer test, and a (2) Wet hammer test with the steam dryer skirt and drain channels partially submerged in different water levels (to approximate in-reactor water level). Both tests are conducted in ambient conditions. Temporary bondable accelerometers are installed at predetermined locations for these tests. An instrumented hammer is used to excite the steam dryer at several pre-determined locations and the hammer impulse force and the structural responses from the accelerometers are recorded on a computer. The data is then used to compute experimental mode shape, frequency and damping of the instrumented dryer components using appropriate software. The temporary sensors are then removed and the dryer is cleaned prior to installation in to the reactor vessel.

The steam dryer vibration sensors consist of strain gauges, accelerometers and dynamic pressure sensors, appropriate for the application and environment. A typical list of vibration sensors with

their model numbers is provided in Table 3L-3. The selection and total number of sensors is based on past experience of similar tests conducted on other BWR steam dryers. These sensors are specifically designed to withstand the reactor environment. Details of the steam dryer instrumentation are provided in Reference 3L-7.

Each of the sensors are pressure tested in an autoclave prior to assembly and installation on the dryer. An uncertainty analysis is performed to calculate the expected uncertainty in the measurements.

Prior to initial plant start-up, strain gauges are resistance spot-welded directly to the dryer surface. Accelerometers are tack welded to pads that are permanently welded to the dryer surface. Surface mounted pressure sensors are welded underneath a specially designed dome cover plate to minimize flow disturbances that may affect the measurement. The dome cover plate with the pressure transducer are welded to an annular pad that is welded permanently to the dryer surface. The sensor conduits are routed along a mast on the top of the dryer and fed through the RPV instrument nozzle flange to bring the sensor leads out of the pressure boundary. Sensor leads are routed through the drywell to the data acquisition area outside the primary containment.

Pressure transducers and accelerometers are typically piezoelectric devices, requiring remote charge converters that are located in junction boxes inside the drywell. The data acquisition system consists of strain gauges, pressure transducers and accelerometer signal conditioning electronics, a multi-channel data analyzer and a data recorder. The vibration data from all sensors is recorded on magnetic or optical media for post processing and data archival. The strain gauges, accelerometer and pressure transducers are field calibrated prior to data collection and analysis. The temporary vibration sensors are removed after the first outage.

In addition to the instrumentation on the steam dryer, the main steamlines are instrumented in order to measure the acoustic pressures in the steamlines. These pressure measurements are used as input to an acoustic model for determining the pressures acting on the steam dryer. This acoustic model is calibrated against the pressure transducer measurements taken on the steam dryer to provide an acoustic load definition for use in performing confirmatory structural evaluations. For non-prototype ESBWRs, the steamlines are instrumented and the calibrated acoustic model is used to confirm the pressure loads acting on the steam dryer. Details of the main steamline measurement instrumentation and acoustic model are provided in Reference 3L-7.

During power ascension, the steam dryer instrumentation (strain gages, accelerometers and dynamic pressure transducers) is monitored against established limits to assure the structural integrity of the dryer is maintained. If resonant frequencies are identified and increase above the predetermined criteria, power ascension is stopped. The acceptability of the dryer for continued operation is evaluated by revising the load definition based on the measured loading, repeating the structural analysis using the revised load definition, and determining revised operating limits based on the results of the structural analysis.

Future steam dryer inspections will be in accordance with Reference 3L-2, and in accordance with Boiling Water Reactor Vessel Internals Program (BWRVIP) guidance issued by the BWR owners group specific to reactor internals vibration.

3L.5 STARTUP TEST PROGRAM

This section summarizes the program for preparing and performing the startup FIV testing including the methods and analysis that are performed when the startup test data is available. This section assumes that the initial selection of components identified in Subsection 3L.2.1 will be part of the analysis and instrumentation associated with the startup testing program.

3L.5.1 Component Selections

The components that are selected for instrumentation are determined from the initial evaluation phase as discussed in Subsection 3L.2.1. Many different sensors of four different types are utilized to measure vibration related data on several different reactor internal component structures.

3L.5.2 Sensor Locations

Having determined the components to instrument during the test, sensor locations on those structures are determined based upon the analytically predicted mode shapes for each structure or, in some cases, based upon the location of past FIV-related failures. Strain gages, accelerometers and linear variable differential transformer (LVDT) type relative displacement sensors are used for monitoring vibration levels. Strain gages measure local strain from which local stress can be calculated. Based on knowledge of the natural mode shapes of the structure, peak stresses at other locations on the structure are determined from these data. Accelerometers (with double integration of the output signal) and LVDTs provide measurements of local structural displacement. This information, together with knowledge of the natural mode shapes of the structure, allows the peak stresses to be calculated at other locations. Pressure sensors are also utilized at various locations in the vessel. These are not used to measure structural vibration directly, but rather to measure the pressure variation that is often a forcing function that causes the structural vibration. These pressure sensor data are very useful for determining the source of any excessive vibration amplitudes, if they are to occur during testing. Typical sensor types and potential locations are listed in Table 3L-4.

3L.5.3 Test Conditions

Test conditions are selected early in the FIV test program to consider a variety of steady-state and transient operating conditions that could be expected to occur during the life of the plant.

Reactor pressure vessel (RPV) internals vibration at steady-state conditions is more important than transient conditions for evaluating the structural integrity of components. This is because steady-state normal operating conditions can exist for long periods of time, allowing a very large number of vibration cycles to accumulate. Flow-induced vibration caused by transient operating conditions is far less influential because of the relatively low number of vibration cycles that occur over the lifetime of the plant. The purpose in including transient test conditions is to confirm that extremely high stresses do not occur during transients. This check is accomplished during the actual startup transient tests by the vibration engineers monitoring the test equipment. Transient stress levels near the allowable limit would be easily and immediately detected by the vibration engineers. No such high stress levels are expected to occur during the ESBWR prototype plant FIV transient tests. Therefore, for the purposes of confirming the structural

capability of the internals, steady-state test conditions are the most important conditions to evaluate.

Total volumetric core flow rate is also an important parameter that affects the vibration magnitude of the internals. Vibration amplitude generally increases as the volumetric flow rate increases.

3L.5.4 Data Reduction Methods

Basically, two types of data reduction are performed: (1) time history analyses and (2) spectrum analyses. In either data reduction method, the measured peak-to-peak (p-p) value of each sensor signal is compared to the allowable p-p value. Even though both time history and spectrum analyses are performed for each selected sensor and test condition, the results from only one data reduction method are used for comparison to the allowable values. The selection of the method is dependent on the analysis method used for data evaluation. The different methods of data evaluation are described in detail in Subsection 3L.5.5. Briefly, Method I is used for components that have many closely spaced natural vibration modes and utilizes the strain energy weighting method applied to all modes over the frequency range of interest. This method has previously been applied to the In-core Monitor (ICM) housings, shroud, top guide, and steam dryer skirt and support ring. Method II is similar to Method I, except that it is applied to two frequency bands, 0-100 Hz and 100-200 Hz. This method has previously been applied to the steam dryer drain channels and hood. Method III is used for components that have relatively few, distinct dominant natural modes that are matched to the analytical modes. This method has previously been applied to the in-core guide tubes. Table 3L-5 describes the method of data reduction that is applicable to each component. It should be noted that the 200 Hz frequency range is approximate and is dependent on the SRV standpipe design. The frequency range monitored and evaluated in the FIV test program is adjusted to bound the range of frequencies determined for the final SRV standpipe design.

3L.5.4.1 Time History Analysis

The time history method uses the analyzer's time capture mode of operation. The time capture is performed for a period of several minutes for all the selected sensors and test conditions. The frequency bandwidth for the time capture is chosen to accommodate 0-200 Hz as a minimum for most channels.

For comparison to the allowable vibration amplitude, the measured peak-to-peak (p-p) value over specified bandwidths needs to be obtained for sensors in specific components. The bandwidths used for p-p measurements for various components are shown in Table 3L-5. There are four bandwidths for time history p-p measurement: 0-200 Hz, 0-100 Hz, 100-200 Hz and 0-1600 Hz. The 0-1600 Hz is used only for the accelerometer for the purpose of detecting impacts. The other three bandwidths are used for normal vibrations.

For the 0-200 Hz bandwidth, the maximum p-p values over several minutes of data for selected sensors and test conditions are obtained directly from the time capture. Specification of the bandwidth for time capture (0-200 Hz) automatically results in a low-pass filtered signal.

In order to obtain the maximum p-p in the 0-100 Hz range, the histogram operation is employed on the time capture traces. When the bandwidth (0-100 Hz) is specified in the histogram operation, the signal is automatically low-pass filtered in the specified frequency range. The

histogram measurement shows how the amplitude of the input signal is distributed between its maximum and minimum values. The horizontal axis is the amplitude axis and usually the center of the horizontal axis is the zero point with positive and negative amplitudes on either side of the zero. The vertical axis is the number of counts or the number of times a particular amplitude value occurs in a time-history. From the histogram, the maximum positive and maximum negative values in a time history can be obtained, from which the maximum p-p of the time history can be obtained.

For the 100-200 Hz bandwidth range, the time captured traces are filtered in the 100-200 Hz range and the p-p is obtained over a period of several minutes. The filtered time history between 100 and 200 Hz is scanned to obtain maximum and minimum values to get p-p values.

For the 0-1600 Hz range for accelerometers, the time history signal is examined for the presence of any impacts.

3L.5.4.2 Frequency Analysis

The spectrum shows the signal in the frequency domain. There are several different types of spectra. The linear spectrum is the Fourier transform of the time history signal. The auto power spectrum is the magnitude squared of the linear spectrum, which is computed by multiplying the Fourier transform of the signal by its complex conjugate. This spectrum contains magnitude information only. The spectra generated for ESBWR data reduction are auto power spectra. The spectra for selected sensors and test conditions are obtained from the captured time history described previously.

Signal averaging is used to obtain better statistical properties. It is possible to select the number of averages and the type of averaging. There are three types of averaging:

- Stable (normal)
- Exponential
- Peak Hold

The averaging method used for ESBWR is “Peak Hold”, which compares the current spectral value of each individual frequency during the analysis interval to the last spectral value and holds the larger of the two. The resultant spectrum is a composite spectrum which envelopes the spectrums of all analysis intervals. The parameters used in the spectrum generation are described in Table 3L-6**.**

In order to obtain greater accuracy on amplitude of the frequency spectrum, a flat top window is selected.

From the spectrum, the dominant frequencies of vibration and their root mean square (RMS) magnitudes can be identified. The frequency is in the horizontal axis and the RMS magnitude is in the vertical axis. The p-p value of vibration at each dominant frequency is obtained by multiplying the RMS value (from the peak hold spectrum) by a factor of 6. This factor is obtained from many years of reactor experience and is a conservative estimate of the p-p value. This p-p value is then used to compute the stress at the sensor location and the maximum stress in the structure.

3L.5.5 Data Evaluation Methods

This section describes the methods used to evaluate the reduced test data for the purpose of determining whether maximum stress levels are below the maximum allowable fatigue stress limits for the materials. A significant portion of this evaluation lies in the determination of the natural vibration modes of the instrumented components as determined using finite element models. Subsection 3L.5.5.1 describes the finite element models used in this process. Subsection 3L.5.5.2 describes the steps involved in determining the maximum stress amplitudes from the reduced data.

3L.5.5.1 Finite Element Models

Dynamic analytical finite-element models are developed for the following ESBWR plant reactor internal components:

- Chimney Head and Steam Separators
- Shroud and Chimney
- Steam Dryer
- Standby Liquid Control Line

The dynamic analytical finite-element models are used to predict the natural vibration frequency, modal displacement, and modal strain and stress for each of the dominant vibration response modes. Descriptions of the finite-element models are given in the following sections.

3L.5.5.1.1 Chimney Head and Steam Separators

In order to determine the chimney head and steam separator vibration frequencies and mode shapes, an axisymmetric model is developed using the ANSYS computer code (Reference 3L-3). The detailed model consists of the components that provide structural members within the assembly. Since the separator assembly units are the standard product used on prior BWR product lines, and that operates within the range of the design steam flow rates, detailed modeling is not required. In this model, each nodal point has four degrees of freedom, namely:

- radial displacement;
- tangential displacement;
- vertical displacement; and
- meridian rotation.

3L.5.5.1.2 Shroud and Chimney

In order to determine the shroud vibration frequencies and mode shapes, an axisymmetric shell model is developed using the ANSYS computer code (Reference 3L-3). The detailed shell model consists of both the reactor pressure vessel (RPV), chimney, chimney support, and shroud such that the hydrodynamic interaction effects between the components are accounted for. In this model, each nodal point has four degrees of freedom, namely:

- radial displacement;
- tangential displacement;

- vertical displacement; and
- meridian rotation.

This shell model is applicable only to the axisymmetric finite element analysis of the shroud and vessel. Responses calculated from this model, other than that of the shroud, are not construed as being representative of other reactor components.

The following assumptions are made in generating the axisymmetric shell model:

(1) Discrete components move in unison for guide tubes, steam separators, standpipes, and control rod drive housings and guide tubes.

(2) Masses are lumped at the nodal points. Rotational inertias of the masses are neglected.

(3) Stiffnesses of control rods, control rod drives, steam dryers, and incore housings are neglected.

(4) Top guide beam and core plate are assumed to have zero rotational stiffness.

(5) Masses of CRD housings below the vessel are lumped to the bottom head.

Equivalent shells are used to model the mass and stiffness characteristics of the guide tubes, steam separators, and standpipes such that they match the frequencies obtained from a horizontal beam model.

Diagonal hydrodynamic mass terms are selected such that the beam mode frequencies of the shell model agree with those from the beam model.

The RPV, chimney and shroud are modeled as thin shell elements. Discrete components such as guide tubes are modeled as equivalent thin shell elements. The shell element data are defined in terms of thickness, mass density, modulus of elasticity, and Poisson's ratio for the appropriate material and temperature.

The natural frequencies and mode shapes of the shroud shell model are given in terms of two parameters, termed "n" and "m". The "n" parameter refers to the number of circumferential waves, while the "m" parameter refers to the number of axial half-waves. Thus, for beam types of one vibration, n=1.

3L.5.5.1.3 Steam Dryer

The design of the steam dryer assembly for the ESBWR prototype plant is somewhat different from the original steam dryers used in previous BWR designs. Specifically, the major differences are in:

(1) the skirt and support ring diameters;

(2) the annulus size between the skirt and reactor pressure vessel;

(3) the flow path between the dryer banks and the vessel head; and

(4) the design details of the dryer skirt, drain channels and hoods.

In addition, the total steam flow rate of the ESBWR prototype plant is different from past designs. These differences warrant a detailed vibration analysis and test monitoring to assure the adequacy of the new design to withstand the flow-induced vibration.

In the ESBWR prototype plant FIV test program of the dryer assembly, accelerometers and strain gages are located directly on the skirt, drain channels, support ring and hoods (Reference 3L-7). In addition, pressure sensors are used to measure the pressure differentials between the inside and outside of the dryer hood and dryer skirt. The differential pressure fluctuation across the dryer hoods is the primary forcing function causing vibration of the upper part of the dryer structure. The differential pressure fluctuation across the dryer skirt is the primary forcing function causing the vibration of the steam dryer skirt.

A dynamic finite element model of the dryer assembly is developed using the ANSYS computer code (References 3L-3 and 3L-6). Due to the complicated geometry and the large size of the analytical model, major components may be modeled with coarse meshes such that their dynamic contributions are accounted for in the whole dryer assembly vibration responses. Separate refined dynamic finite element models of the major components are then developed to provide a high resolution of the component's response calculation.

The structural material properties and density for the dryer components at temperature are used in the model. The effect of the water on the dynamic responses is accounted for by using a direct lumped mass input. These added mass inputs include the submerged portions of the dryer skirt, drain channels, and the lower support ring.

Prior analytical models have predicted that the vibration modes are very closely spaced.

3L.5.5.1.4 Standby Liquid Control Lines

In the ESBWR prototype plant reactor, there are two standby liquid control pipes that enter the reactor vessel and are routed to the shroud. To accurately predict the vibration characteristic of the standby liquid control line, a dynamic finite element model of the entire line is developed using the ANSYS computer code. In the model, the ends of the line are fixed anchor points since the lines are welded at the vessel nozzle and the shroud attachment points.

3L.5.5.2 Stress Evaluation

Maximum stress amplitude values for evaluation against allowable limits are determined from the test data and finite element models using one of two different evaluation methods. The method used for a particular component depends on the complexity of that component's vibration characteristics. Each of these methods yield conservatively high predictions of the maximum stress anywhere on the structure. These conservatively high stress predictions are compared against conservatively low acceptance criteria to assure that none of the components is experiencing high stress vibrations that might cause fatigue failures. Table 3L-7 lists the methods that are used for each instrumented component for the ESBWR prototype plant FIV test program. The acceptable fatigue limit stress amplitude for the reactor internals component material [68.9 MPa (10,000 psi)], with the exception of the steam dryer. The fatigue analysis performed for the ESBWR steam dryer will use a fatigue limit stress amplitude of [93.7 MPa (13,600 psi)]. For the outer hood component, which is subjected to higher pressure loading in the region of the main steam lines, the fatigue limit stress amplitude of [74.4 MPa (10,800 psi)]. The higher limit is justified because the dryer is a nonsafety-related component, performs no safety functions, and is only required to maintain its structural integrity (no loose parts generated) for normal, transient and accident conditions.

Method I is used for components that have many closely spaced vibration frequencies and/or closely spaced natural vibration modes distributed over a relatively narrow frequency range. The method utilizes a strain energy weighting method applied to all modes over the entire frequency range. It is applied by determining the maximum peak-to-peak (p-p) amplitude from an unfiltered time history segment. This maximum value is multiplied by a combined shape factor (derived from the strain energy weighting method) and stress concentration factors to yield the maximum stress value that could be expected to be found anywhere on the structure. This value is then compared against the acceptable fatigue limit stress amplitude for the component and material.

Method II is used for components that have many closely spaced vibration frequencies and/or closely spaced natural vibration modes that are unevenly distributed over several frequency ranges. The method is very similar to Method I, except that it is applied over several separate frequency bands. The maximum stress amplitude values for each frequency band are then added together absolutely to yield a conservatively high value for the overall maximum stress amplitude that could be found anywhere on the structure. This value is then compared against the acceptable fatigue limit stress amplitude for the component and material.

These methods have identical initial steps to obtain mode shape factors for each natural mode. The steps for these methods are as follows. (Note: The evaluation method described here relates to strain gages. Similar steps are used for accelerometers used in their displacement mode and for LVDTs. The example assumes a maximum allowable stress amplitude for the material of [68.9 MPa (10,000 psi)] for the purposes of illustration):

(1) The dynamic finite element model of each instrumented component is used to predict the natural vibration modal displacement, frequency and stress for each vibration response mode. Specifically, the computer model provides the following results for each mode:

ω_i = Natural frequency for vibration mode i

$\{\phi\}_i$ = Mass normalized displacement mode shape for vibration mode i.

(Normalized such that the generalized mass, $\{\phi\}_i^T[M]\{\phi\}_i$, is unity, where [M] is the mass matrix.)

$\{\sigma\}_i$ = Normalized stress distribution for vibration mode i.
(The stress corresponding to the mass normalized mode shape, $\{\phi\}_i$)

The theory and methods for calculation of these parameters may be found in text books on the subject of basic vibration analysis, such as Reference 3L-4.

(2) For each vibration mode, stress concentration factors are applied at weld locations and regions with high stress gradient. From this information, the maximum stress intensity location and value is determined for each vibration mode.

$\sigma_{i,\max} = Max\{SCF_i \cdot \sigma_i\}$ considered over the entire structure

where

SCF_i = Stress concentration factor at some location

σ_i = Normalized stress intensity at the same location

$\sigma_{i,max}$ = Normalized maximum stress intensity for mode i

(3) From the stress distribution of Step 1, a mode shape factor is derived relating the stress at the sensor to the stress at the maximum stress location as determined in Step 2:

$$MSF_i = \frac{\sigma_i(\text{at maximum stress intensity location})}{\sigma_{i,sensor}}$$

where

MSF_i = Mode shape factor

$\sigma_{i,sensor}$ = Normalized stress at sensor location for vibration mode i

(4) The mode shape factor from Step 3 and the maximum allowable stress amplitude for the material [68.9 MPa (10,000 psi)] are used to determine the maximum allowable stress value at the sensor location for each mode.

$$\sigma_{i,sensor,allowed} = \frac{68.9\ MPa}{(MSF_i)\cdot(SCF_i)}$$

where

$\sigma_{i,sensor,allowed}$ = Maximum allowed zero to peak stress amplitude at sensor location for vibration mode i (stress amplitude at sensor when maximum stress amplitude in structure is 68.9 MPa)

(5) The allowable strain for mode i ($\varepsilon_{i,allowed}$) is then calculated from this maximum allowed stress amplitude at the sensor location:

$$\varepsilon_{i,allowed} = \frac{\sigma_{i,sensor,allowed}}{E}$$

where

E = Young's modulus [e.g., 1.862×10^5 MPa (27.0×10^6 psi) at 160°C]

This equation is for uniaxial stress components. A similar, but more complex procedure is used for biaxial stress structures such as the dryer skirt, drain channel and hood.

3L.5.5.2.1 Methods I and II

The next two steps are identical for Methods I and II.

(6) A weighting factor is determined by the strain energy method, which begins by obtaining the solution to the following equation based on the expected forcing function:

$$\{U\} = q_1\{\phi\}_1 + q_2\{\phi\}_2 + \ldots = \sum_{i=1}^{N} q_i\{\phi\}_i$$

where

{U} = A vector representing the displacement response of the structure when subjected to the expected forcing function shape. This displacement

response to an input forcing function is calculated from the finite element model on the computer.

$\{\phi\}_i$ = Mass normalized mode shape for vibration mode i. Mode shapes were determined from the modal analysis of the finite element model on the computer. The modes shapes are normalized such that the generalized mass, $\{\phi\}_i^T[M]\{\phi\}_i$, is unity (where [M] is the mass matrix).

q_i = Mode i response, dependent on load distribution. These coefficients are calculated from the previously calculated {U} and $\{\phi\}_i$ using formulas derived from the generalized Fourier Theorem.

This is an application of the generalized Fourier Theorem, which establishes that a displacement function such as {U} can be represented by a linear sum of the eigenfunctions, $\{\phi\}_i$. The theory and methods for calculation of these coefficients may be found in text books on the subject of basic vibration analysis, such as Reference 3L-4.

(7) The strain energy contribution, e_i, for each mode is then calculated:

$$e_i = \frac{1}{2} \cdot q_i^2 \cdot \{\phi\}_i^T \cdot [K] \cdot \{\phi\}_i$$

where

[K] = The structural stiffness matrix (For a more detailed explanation of the theory and calculation methods, see text books on the subject vibration analysis, such as Reference 3L-4.)

The next step is similar for both Methods I and II, the only difference being that Method I includes the entire frequency range in one group, while Method II uses several groups of frequency ranges.

(8) Then the strain energy weighted allowable strain vibration amplitude is calculated over a given frequency range by combining the weighted strain allowable values for each mode as follows:

For

$$\omega_I < \omega_1, \omega_2, \ldots, \omega_n \le \omega_{II}$$

$$\varepsilon_{II,allowed} = \frac{e_1 \cdot \varepsilon_{1,allowed} + e_2 \cdot \varepsilon_{2,allowed} + \ldots + e_n \cdot \varepsilon_{n,allowed}}{e_1 + e_2 + \ldots + e_n}$$

where

$\varepsilon_{II,allowed}$ = Allowable strain value between ω_I and ω_{II}, which includes the stress concentration factor (SCF)

It should be noted that this step conservatively assumes that the peak stress of each mode occurs at the same physical location on the structure. In reality, the maximum stress locations for different modes may occur at different locations. Since the purpose of this calculation is just to confirm that the maximum stress is less than an acceptable limit, it is quite acceptable to add this conservatism. However, it should be understood that the value calculated is conservatively high, and it is not an accurate prediction of the actual stress

amplitude. If a stress calculated in this manner should exceed the limit in a few situations, then a less conservative calculation can be used in those few cases.

The strain value in the above equation is the allowable strain used during the actual execution of the test. It represents the strain level at the sensor location when the maximum stress on the structure is 68.9 MPa (10,000 psi).

Step 9 is the same for both Methods I and II, except that it is applied to each of the multiple frequency ranges associated with Method II; whereas, Method I is only for one frequency range.

(9) The combined shape factor (CSF) is derived to relate the maximum zero-to-peak strain value measured at the sensor location to the corresponding maximum zero-to-peak stress intensity value on the structure.

$$\sigma_{II,\max} = \frac{\varepsilon_{II,measured,\max}}{\varepsilon_{II,allowed}} \cdot (68.9\ MPa) = \varepsilon_{II,measured,\max} \cdot CSF$$

where

$$CSF = \frac{(68.9\ MPa)}{\varepsilon_{II,allowed}}$$ = Combined Shape Factor with the SCF included.

$\sigma_{II,max}$ = Maximum zero-to-peak stress value anywhere on the structure for modes within the frequency range of ω_I to ω_{II}.

$\varepsilon_{II,measured,max}$ = Maximum measured zero-to-peak strain (one-half of maximum measured peak-to-peak) from time history of sensor band pass filtered over the frequency range ω_I to ω_{II}.

This is the maximum zero-to-peak stress value anywhere on the structure as determined by Method I. For Method I, this value is compared to 68.9 MPa (10,000 psi) for determination of acceptability. One additional step remains for Method II.

(10) The maximum stress values for each frequency band are added together absolutely to determine the overall maximum stress on the structure for comparison to the 68.9 MPa (10,000 psi) limit for the material.

$$\sigma_{MAX} = \sigma_{II,\max} + \sigma_{III,\max} + \ldots + \sigma_{N,\max}$$

where

σ_{MAX} = Maximum overall zero-to-peak stress anywhere on structure as determined by Method II.

$\sigma_{N,max}$ = Maximum zero-to-peak stress anywhere on structure within the frequency range of ω_{N-1} to ω_N (N-1 frequency ranges total).

σ_{MAX} is compared to the 68.9 MPa (10,000 psi) limit in order to determine acceptability under Method II.

It should be noted that this step conservatively assumes that the peak stress of each mode occurs at the same time. In reality, the maximum stress occurs at different times. Since the purpose of this calculation is just to confirm that the maximum stress is less than an acceptable limit, it is quite acceptable to add this conservatism. However, it should be understood that the value

calculated is conservatively high, and it is not an accurate prediction of the actual stress amplitude. If a stress calculated in this manner should exceed the limit in a few situations, then a less conservative calculation can be used in those few cases.

3L.5.5.2.2 (Deleted)

3L.6 REFERENCES

3L-1 General Electric Company, "ESBWR Reactor Internals Flow Induced Vibration Program – Part 1", NEDE-33259P, Class III (Proprietary), January 2006, and NEDO-33259, Class I (Non-proprietary), January 2006.

3L-2 General Electric Company, "BWR Steam Dryer Integrity", SIL 644 Revision 2, August 30, 2006.

3L-3 ANSYS Engineering Analysis System User's Manual, applicable revision.

3L-4 Elements of Vibration Analysis, Leonard Meirovitch, McGraw Hill Book Co., 1975.

3L-5 General Electric Company, "Steam Dryer - Acoustic Load Definition," NEDE-33312P, Class III (Proprietary), October 2007, and NEDO-33312, Class I (Non-Proprietary), October 2007.

3L-6 General Electric Company, "Steam Dryer - Structural Evaluation," NEDE-33313P, Class III (Proprietary), October 2007, and NEDO-33313, Class I (Non-Proprietary), October 2007.

3L-7 General Electric Company, "Steam Dryer - Instrumentation and Power Ascension Monitoring," NEDE-33314P, Class III (Proprietary), October 2007, and NEDO-33314, Class I (Non-Proprietary), October 2007.

Table 3L-1

Comparison of Major Steam Dryer Configuration Parameters

Steam Dryer Configuration Parameter	ESBWR Dryer	Replacement BWR/3 Dryer
Number of Banks	6	6
Active height (flow area) for vane modules	1829 mm ($65.6\ m^2$)	1829 mm ($54.3\ m^2$)
Approximate weight	60,000 Kg	45,545 Kg
Outside diameter of upper support ring	6920 mm	6096 mm
Overall height	5700 mm	5436 mm
Length of skirt	2736 mm	2692 mm
Skirt thickness	9 mm	9.65 mm
Cover plate thickness	25.4 mm	25.4 mm
Hood thickness	25.4 mm (outer bank) 12.7 mm (inner banks)	25.4 mm (outer bank) 12.7 mm (inner banks)
Upper support ring cross-section	89 x 242 mm	152.4 x 203.2 mm
Average steamline flow velocity	49.7 m/s	61.6 m/s

Table 3L-2

Specific Steam Dryer Load Definition Legend

Normal (N)	Normal and/or abnormal loads associated with the system operating conditions, including thermal loads, depending on acceptance criteria. These include deadweight, static differential pressure, and fluctuating pressure loads.
TSV	Turbine stop valve closure induced loads in the main steam piping and components integral to or mounted thereon. For the dryer, these include acoustic and flow impact loads. Separate load cases are evaluated for load components that are separated in time (e.g., acoustic impact and flow impact).
LOCA8	Acoustic impact loads on the dryer due to a postulated steamline break. Separate load cases are evaluated for load components that are separated in time (e.g., acoustic impact and level swell impact).
LOCA9	Level swell impact loads on the dryer due to a postulated steamline break. Separate load cases are evaluated for load components that are separated in time (e.g., acoustic impact and level swell impact).

Table 3L-3

Typical Vibration Sensors

Vibration sensor type	Typical sensor model
Strain gauge	Kyowa Model KHC-10-120-G9
Accelerometer	Vibro-meter Model CA901
Dynamic pressure transducer	Vibro-meter Model CP104 and/or Model CP211

Table 3L-4

Typical Sensor Locations and Types(1)

Equipment Item	Location on Equipment	Sensor Type	Location Basis
Steam Dryer Support Ring	On top of dryer support	Accelerometer (Acceleration Mode)	Past experience of dryer rocking.
Steam Dryer Skirt	At bottom of dryer	Accelerometer (Displacement Mode)	Modal analysis.
Steam Dryer Hood	At edge of dryer bank hood and end plate.	Strain Gage Pressure Transducer	Past experience of cracks at weld & to obtain forcing function data if problem occurs
Steam Dryer Drain Channel	At top & bottom, side edge of dryer channels.	Strain Gage	Modal analysis. Past experience of cracks at weld.
Steam Dryer Skirt	At top & bottom of dryer skirt.	Strain Gage Pressure Transducer	Modal analysis & to obtain forcing function data if problem occurs
Shroud	On the outside diameter	Strain Gage	Modal analysis.
Top Guide	On the outside diameter of the top guide mounted to measure tangential & radial relative displacements between top guide and vessel.	Linear Variable Differential Transformer (LVDT)	Past experience to measure shroud motion.
Vessel Dome Region	On steam dryer FIV instrument post.	Pressure Transducer	To obtain forcing function data if problem occurs.
Vessel Annulus	On the vertical FIV mounting bar in the annulus between the shroud and vessel walls.	Pressure Transducer	To obtain forcing function data if problem occurs.
Standby Liquid Control Line	On the joints between the vertical and horizontal runs	Strain Gage	New design

1. Vibration data for all equipment listed in Table 3L-4 will be acquired during initial startup and power ascension testing. Pressure data, however, while recorded during startup testing, will not be evaluated in detail unless the primary vibration measurements indicate the need for further assessment.

Table 3L-5

Applicable Data Reduction Method for Comparison to Criteria

Component	Sensor Type	Applicable Data Reduction Method		Frequency Bandwidth (Hz)(1)
Shroud	Strain Gages	I	Time History	0-100
Steam Dryer Skirt	Strain Gages	I	Time History	0-100
Steam Dryer Skirt	Accelerometer (Displacement)	I	Time History	0-100
Steam Dryer Drain Channels	Strain Gauges	II	Time History	0-100, 100-200
Steam Dryer Hoods	Strain Gages	II	Time History	0-100, 100-200
Steam Dryer Support Ring	Accelerometer	Impact	Time History	0-1600 0-80, 80-200
Top Guide	Displacement	I	Time History	0-100
Vessel Annulus	Pressure sensors	I	Time History	0-200
Standby Liquid Control Lines	Strain Gages	I	Time History	0-200

Notes

1. It should be noted that the 200 Hz frequency range is approximate and is dependent on the SRV standpipe design. The frequency range monitored and evaluated in the FIV test program is adjusted to bound the range of frequencies determined for the final SRV standpipe design.
2. Pressure sensors data reduction from steam dome, steam dryer skirt, and steam dryer hood are not included in this table. The pressure data from these components and the main steamlines are discussed in Reference 3L-7.

Table 3L-6

Parameters Used in Spectrum Generation

Parameter	Value
Bandwidth	0-200 Hz*
Time length	3 minutes
No. of Fourier Lines	400
Resolution	0.5 Hz
Window	Flat Top
No. of averages	90
Overlap	0%
Noise reduction	None
Average Type	Peak-hold
P-P Value	= RMS x 6

* It should be noted that the 200 Hz frequency range is approximate and is dependent on the SRV standpipe design. The frequency range monitored and evaluated in the FIV test program is adjusted to bound the range of frequencies determined for the final SRV standpipe design.

Table 3L-7

Data Evaluation Methods to be Used for Each Component

Internal Component	Data Evaluation Method Used
Shroud and Chimney	I
Steam Dryer	I & II
Standby Liquid Control Line	I

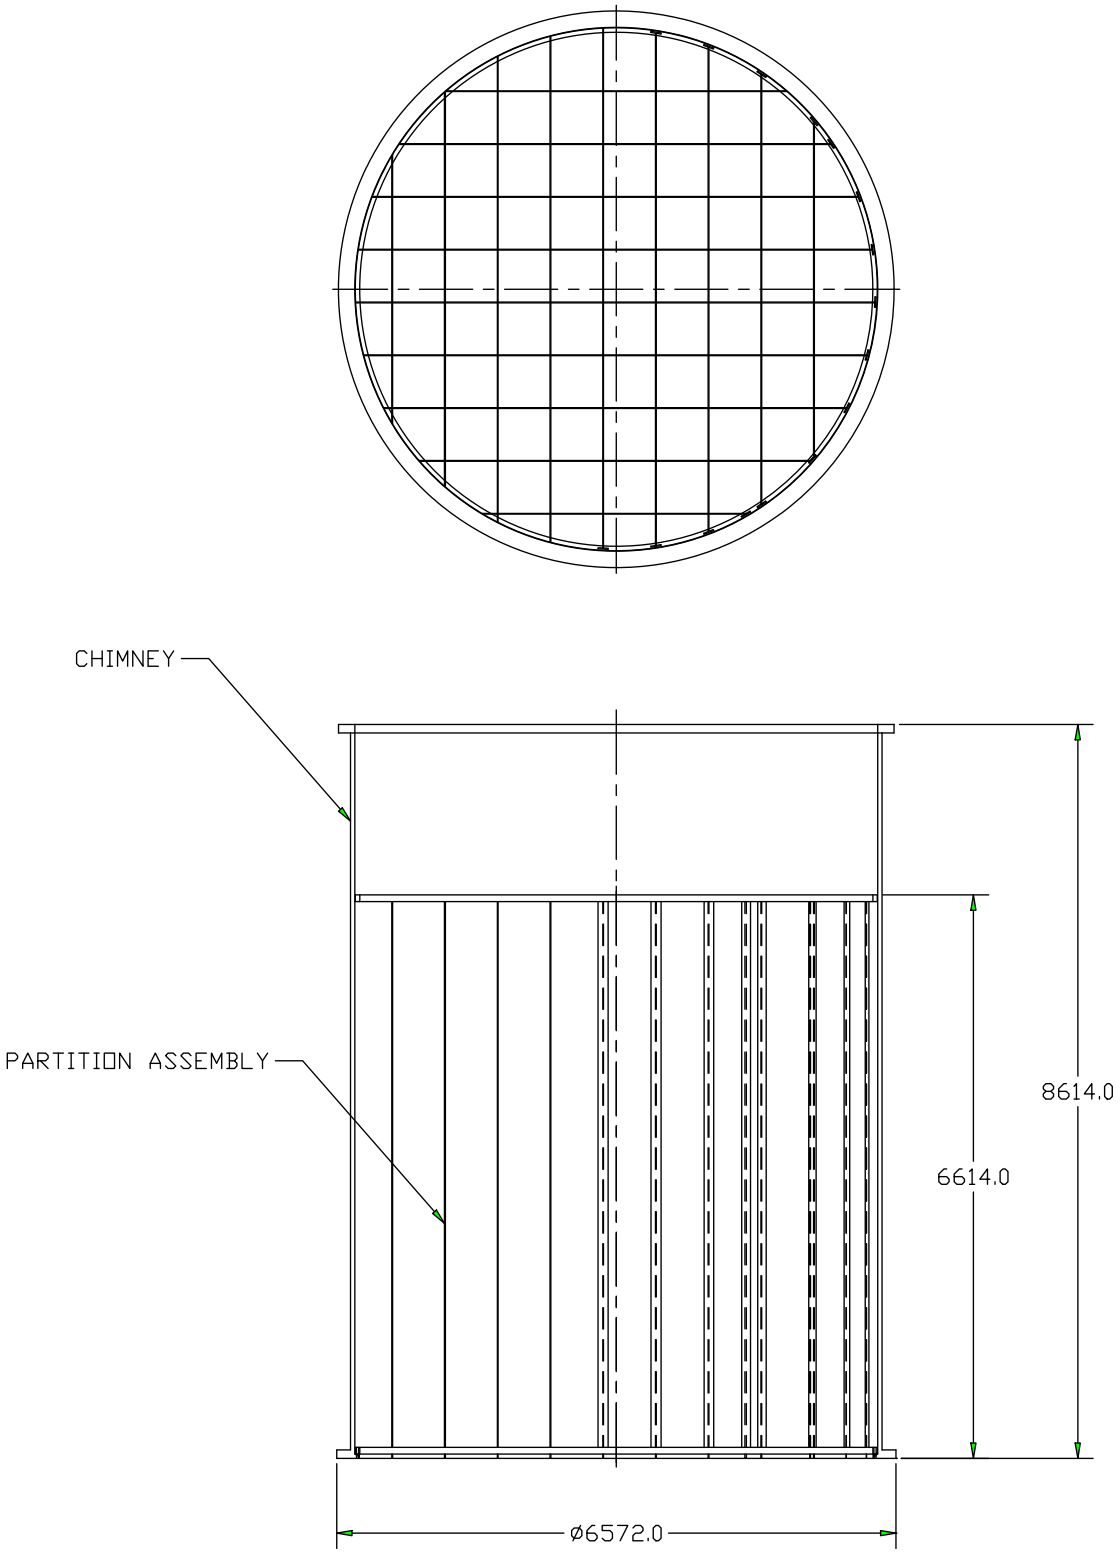

Figure 3L-1. Chimney and Partition Assembly

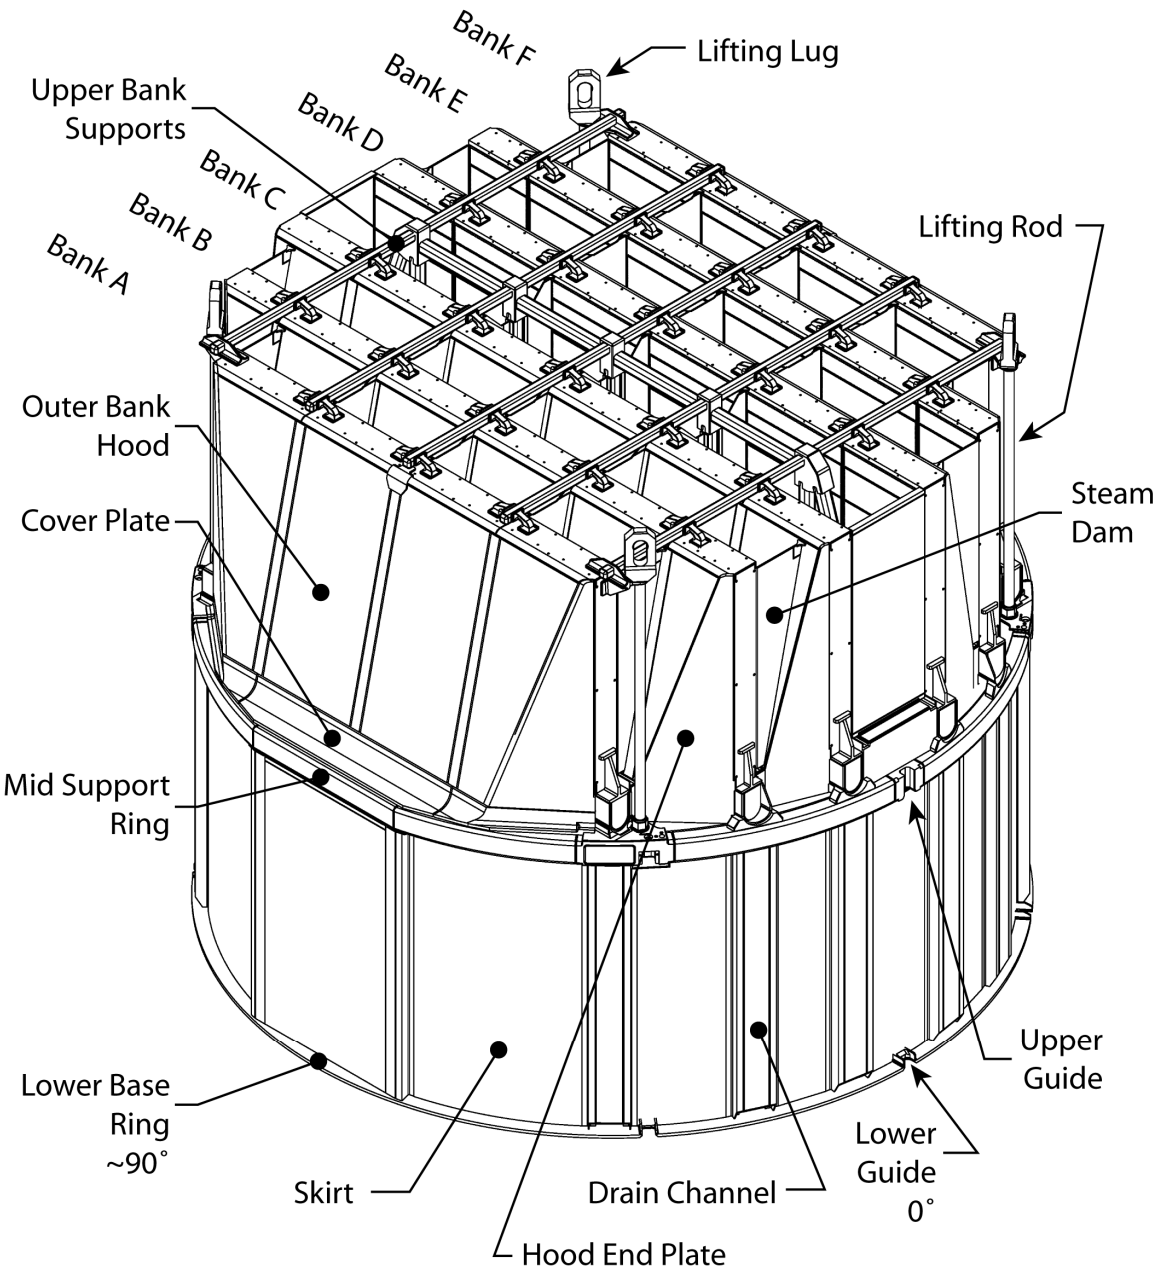

Figure 3L-2. ESBWR Steam Dryer Assembly